
DRAWING NO. 1723001595-EL-DG-00012


REV. 01

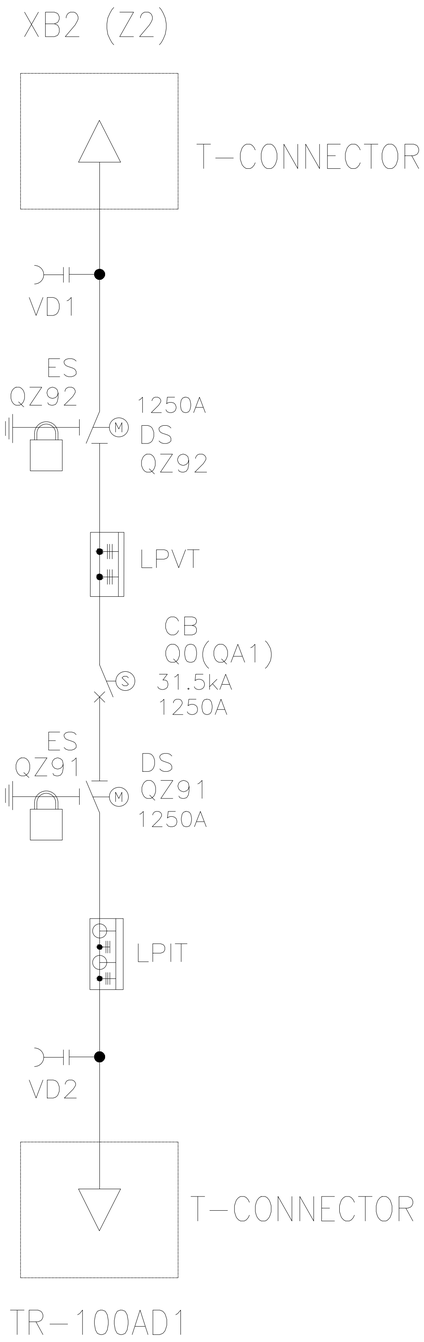

HNA6-AFA70 INTERLOCK TABLE

CLOSE/OPEN INTERLOCK MATRIX OF CB,DS & ES.											REMARK
COMMAND	66kV GIS					6.6KV SWG.		COMMAND SOURCE		OTHER EXTERNAL INTERLOCKS	
	Q0(QA1)	DS(QZ92)	DS(QZ91)	ES(QZ92)	ES(QZ91)	CB	ES	LOCAL	REMOTE		
CB Q0(QA1) (CLOSE)		C	C			O		X	X	GAS PRESSURE IS NOT LOWER THAN 1'ST ALARM PRESSURE CLOSING SPRING NOT DISCHARGED	SERVICE
		O	O			O		X		GAS PRESSURE IS NOT LOWER THAN 1'ST ALARM PRESSURE	TEST
CB(Q0) (OPEN)								X	X	GAS PRESSURE IS NOT LOWER THAN MINIMUM PRESSURE	SERVICE
										GAS PRESSURE IS NOT LOWER THAN MINIMUM PRESSURE	BY PROTECTION RELAY
DS(QZ92) (CLOSE/OPEN)	O			(O)				X	X		SERVICE
DS(QZ91) (CLOSE)	O				(O)		O	X	X		SERVICE
DS(QZ91) (OPEN)	O				(O)			X	X		SERVICE
ES(QZ92) (CLOSE)	O	(O)						X	X	LINE VD RELAY EXCITED	SERVICE
ES(QZ92) (OPEN)	O	(O)						X	X		SERVICE
ES(QZ91) (CLOSE)	O		(O)			O		X	X		SERVICE
ES(QZ91) (OPEN)	O		(O)					X	X		SERVICE

C : CLOSE
O : OPEN
( ) : MECHANICAL INTERLOCK

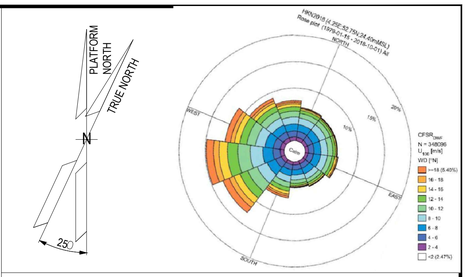

NOTES

LEGEND

HOLDS

REV.	DATE	DRN.	CHKD	APPD	DESCRIPTION
2	06/08/24	Y.D.LEE	Y.W.LEE	S.J.CHO	ACCEPTED FOR CONSTRUCTION
1	21/03/24	Y.D.LEE	Y.W.LEE	S.J.CHO	REVISED AS PER COMMENT
0	01/02/24	Y.D.LEE	Y.W.LEE	S.J.CHO	ISSUE FOR CLIENT REVIEW (ICR)

HYOSUNG HEAVY INDUSTRIES

CROSSWIND | ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
66kV SWITCHGEAR (GIS)
INTER PANEL LOGIC DIAGRAM

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1_:_NS
DRAWN Y.D.LEE	CHECKED Y.W.LEE	APPROVED S.J.CHO	DATE 24/11/23
A1	DRAWING NO. 1723001595-EL-DG-00017	SHEET 001	REV. 02

File Name : DRAWING_NO.