

DRAWING NO. 123A90-DDL-AR-DL-10010


REV. 01



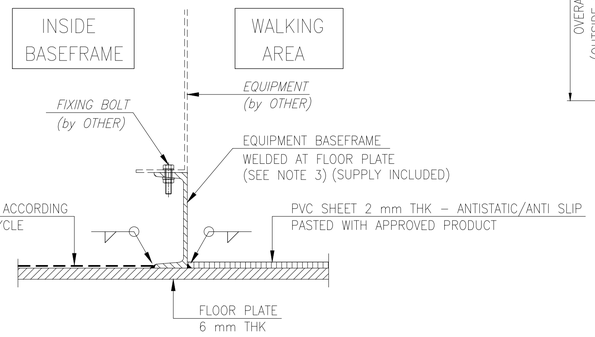

FLOOR FINISHING DETAIL

AND BASEFRAME INTALLATION DETAIL

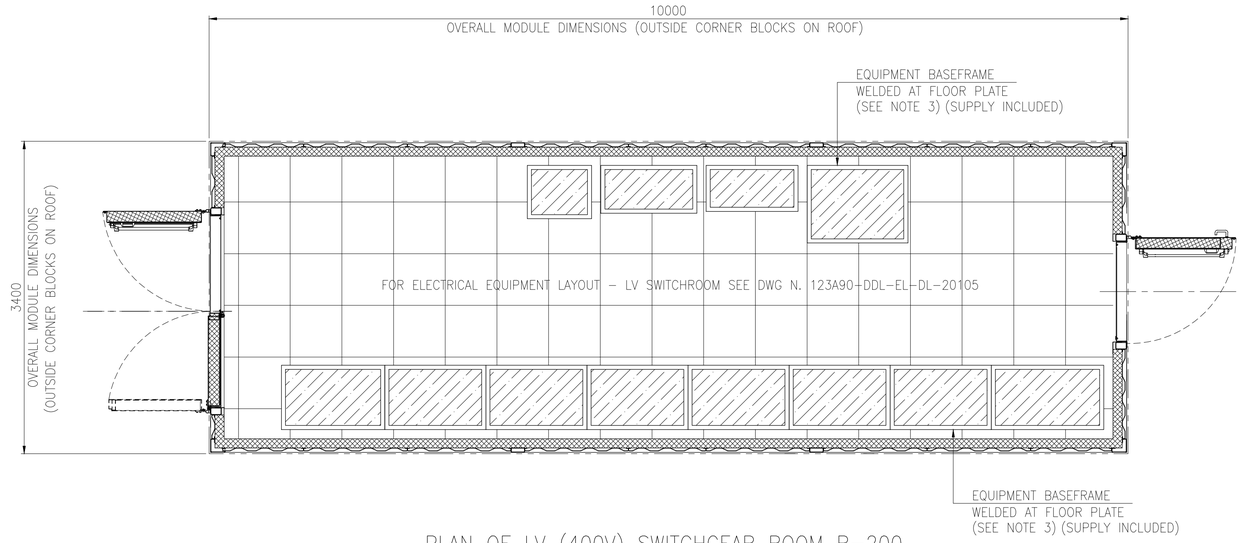


PLAN OF LV (400V) SWITCHGEAR ROOM B-200 FLOOR FINISHING

ALL SUPPORTS FOR FLOOR and WALL MOUNTED CABINETS/EQUIPMENT ARE INCLUDED IN THE SCOPE OF SUPPLY


FOR BASEFRAMES DETAILS REF. TO DOC. B-200 DETAIL DRAWINGS N°. 1724000049-AR-DD-00019 (by VENDOR)

01

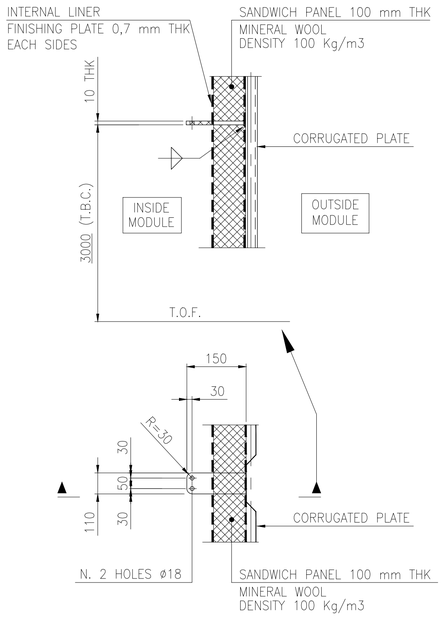


DETAIL OF SEAFASTENING PLATE


TOTAL N. 14 PIECES

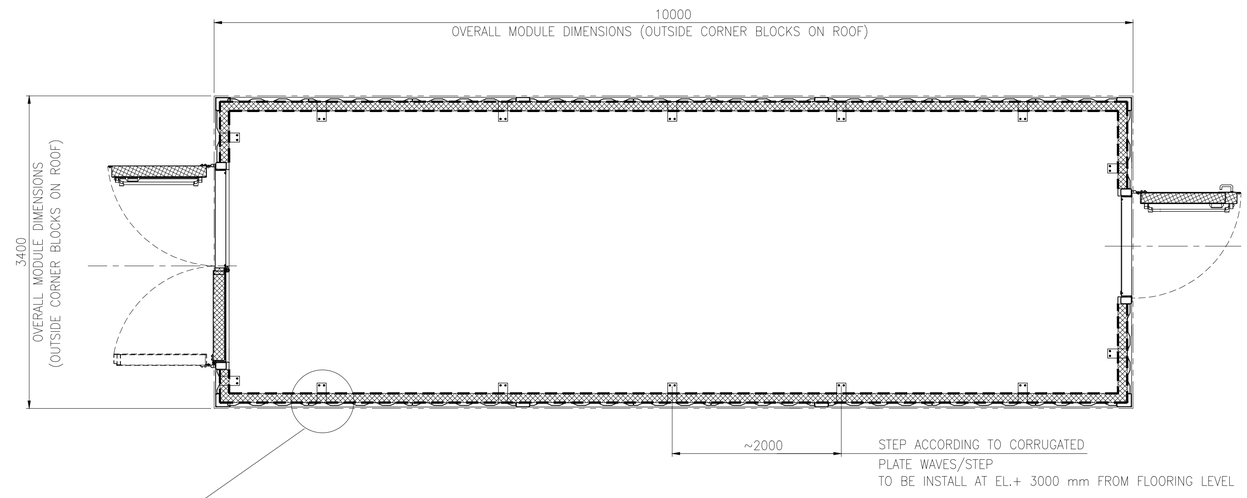

PLAN OF LV (400V) SWITCHGEAR ROOM B-200 INTERNAL LINER & PLATE FOR SEAFASTENING


FOR SEAFASTENING PLATES DETAILS REF. TO DOC. B-200 DETAIL DRAWINGS N°. 1724000049-AR-DD-00019 (by VENDOR)



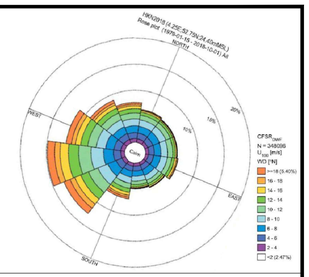

NOTES

1. U.N.O. ALL DIMENSIONS ARE IN MILLIMETERS.
2. ALL WELDS SHALL BE ACCORDING TO A.W.S. CODE.
3. ALL WELDS MUST BE CONTINUOUS, SPOT WELDS ARE NOT PERMITTED
4. U.N.O. ALL FILLET WELDS SHALL HAVE FOLLOWING DIMENSION:



LEGEND


U.N.O.	UNLESS NOTED OTHERWISE
T.O.S.	TOP OF STEEL
T.O.P.	TOP OF PLATE
T.O.F.	TOP OF FLOOR
℄	CENTER LINE
T.B.D.	TO BE DEFINED
T.B.C.	TO BE COMFIRMED
	FLOOR FINISHING – SEAMLESS PVC SHEET 2 mm THK NON-SLIP, ANTI-STATIC SUITABLE FOR HEAVY DUTY USE
	DECK PAINTING ONLY
	LINER 0,7 mm THK INCLUDED IN SANDWICH PANEL
	SEAFASTENING PLATE

HOLDS

REFERENCE

DOCUMENT TITLE	DOCUMENT NUMBER
LV (400V) Switchroom – Supply Specification	123A90-DDL-AR-SP-10007
LV (400V) Switchroom – Architectural General Layout (plan, view, section & typical details)	123A90-DDL-AR-SP-10008
LV (400V) Switchroom – Doors Map and Schedule	123A90-DDL-AR-DL-10009
LV (400V) Switchroom – Fire rated requirement layout (plan, section, typical detail)	123A90-DDL-AR-DL-10011
Electrical Equipment Layout – LV Switchroom	123A90-DDL-EL-DL-20105
B-200 General Arramgement Drawings (by Vendor)	1724000049-AR-DA-00015
B-200 Detail Drawings (by Vendor)	1724000049-AR-DD-00019

KEY PLAN

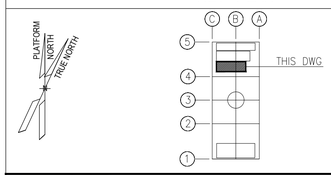

STILOG

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	12/03/24	R. BO	M. GA	D. LO	ACCEPTED FOR CONSTRUCTION (AFC)
00	17/10/23	R. BO	M. GA	D. LO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
LV (400V) SWITCHGEAR ROOM B-200 – ARCHITECTURAL FLOORING and LINING LAYOUT

CONTRACT NO./TITLE	CW-1-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1:33
DRAWN R. BOSSI	CHECKED M. GATTI	APPROVED D. LO STERZO	DATE 12/03/24

A1	DRAWING NO. 123A90-DDL-AR-DL-10010	SHEET 001	REV. 01

File Name : 123A90-DDL-AR-DL-10010