# BASE LOAD POWER HUB (BLPH)

# B-400

# INTERCONNECTION WIRING DIAGRAM

# B400-HSB-001

| | | | | | |
|---|---|---|---|---|---|
| 04 | 14/03/25 | G.M. | A.O. | A.C. | ISSUE FOR INFORMATION (IFI) |
| 03 | 14/11/24 | G.M. | A.O. | A.C. | ISSUE FOR INFORMATION (IFI) |
| 02 | 15/10/24 | G.M. | A.O. | A.C. | ISSUE FOR INFORMATION (IFI) |
| 01 | 04/09/24 | G.M. | A.O. | A.C. | ISSUE FOR INFORMATION (IFI) |
| 00 | 10/07/24 | G.M. | A.O. | A.C. | ISSUE FOR INFORMATION (IFI) |
| REV. | DATE | DRN | CHKD | APPD | DESCRIPTION |

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
INTERCONNECTION WIRING DIAGRAM
FRONT PAGE

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK

SCALE : NTS

A3

DRAWING NO. 1724000049-EL-DG-00025

SHEET 001

REV. 04

| REV. | MOD. | DATE | SIGN | | |
|---|---|---|---|---|---|
| 04 | ISSUE FOR INFORMATION (IFI) | 19/12/24 | | DATE | 05/07/2024 |
| 03 | ISSUE FOR INFORMATION (IFI) | 14/11/24 | | DRN. | F.M. |
| 02 | ISSUE FOR INFORMATION (IFI) | 15/10/24 | F.M. | CHKD | S.S. |
| | | | | APPD | M.G. |

ALEXSISTEMI spa

CLIENT: CROSSWIND

BASE LOAD POWER HUB (BLPH)
B-400
COVER

ROSETTI MARINO

1724000049-EL-DG-00025

F.G. 1

F.S. 2

# LISTA FOGLI \ INDEX

| Foglio Sheet | Descrizione Description | Revisioni Revisions 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 |
|---|---|---|---|---|---|---|---|---|---|---|
| 1 | COVER | X | X | X | X | | | | | |
| 2 | INDEX | X | X | X | X | | | | | |
| 2A | INDEX | X | X | X | X | | | | | |
| 3 | SIMBOL LIST | X | X | X | X | | | | | |
| 4 | INTRCONNECTION | X | X | X | X | | | | | |
| 5 | INTRCONNECTION | X | X | X | X | | | | | |
| 6 | INTRCONNECTION | X | X | X | X | | | | | |
| 7 | INTRCONNECTION | X | X | X | X | | | | | |
| 8 | INTRCONNECTION | X | X | X | X | | | | | |
| 9 | INTERCONNECTION | X | X | X | X | | | | | |
| 10 | INTERCONNECTION | X | X | X | X | | | | | |
| 11 | INTERCONNECTION | X | X | X | X | | | | | |
| 12 | INTERCONNECTION | X | X | X | X | | | | | |

| Foglio Sheet | Descrizione Description | Revisioni Revisions 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 |
|---|---|---|---|---|---|---|---|---|---|---|
| | | | | | | | | | | |

| REV. | MOD. | DATE | SIGN |
|---|---|---|---|
| 04 | ISSUE FOR INFORMATION (IFI) | 19/12/24 | |
| 03 | ISSUE FOR INFORMATION (IFI) | 14/11/24 | |
| 02 | ISSUE FOR INFORMATION (IFI) | 15/10/24 | F.M. |

| | |
|---|---|
| DATE | 05/07/2024 |
| DRN. | F.M. |
| CHKD | S.S. |
| APPD | M.G. |

ALEXSISTEMI spa

CLIENT: CROSSWIND

BASE LOAD POWER HUB (BLPH)
B-400

INDEX

ROSETTI MARINO

1724000049-EL-DG-00025

FG. 2
F.S. 3

| Symbol | Description | Symbol | Description | Symbol | Description |
|---|---|---|---|---|---|
| TR | VOLTAGE TRANSFORMER | | SONIC INDICATOR | F. | FUSE |
| TA | CURRENT TRANSFORMER | * | INDICATOR INSTRUMENT | | CONTACT N.O. |
| M ~ | MOTOR IN C.A. | | SELECTOR SWITCH | | CONTACT N.C. |
| | GROUND : GENERAL SYMBOL | 52. | SWITCH | | COMMUTATION CONTACT |
| L.. | SIGNAL LAMP | 52. | AUTOMATIC CIRCUIT BREAKER | P | CONTACT ACTUATED BY A PRESSURE |
| L.. | SIGNAL LAMP + HEATER | 52. Id | DIFFERENTIAL AUTOMATIC BREAKER | | CONTACT ACTUATED BY A FLOW |
| L.. | SIGNAL LAMP + VOLTAGE TRANSF. | 89. | DISCONNECTING SWITCH | | CONTACT ACTUATED BY A LEVEL |
| | SIGNAL LAMP–PUSH BUTTON | 89. | LOADED CIRCUIT BREAKER | θ | CONTACT ACTUATED BY A TEMPERATURE |
| E | CLOSING BUTTON | 89. | FUSE DISCONNECTING SWITCH | 2 3 4 | TERMINAL STRIP |
| E | OPENING BUTTON | 6. d | CONTACTOR | | SQUARE POWER TERMINAL CLAMP |
| | ROTARY SWITCH | 6.. | CONTACTOR COIL | | SQUARE AUX. TERMINAL CLAMP |
| T.. | CONTACT DELAYED TO THE ATTRACTION N.O. | | AUXILIARY RELAY COIL | | REMOTE TERMINAL CLAMP |
| T.. | CONTACT DELAYED TO THE ATTRACTION N.C. | T.. | TIMER WITH DELAY TO THE ATTRACTION | | ONE–PHASE SYSTEM + NEUTRAL |
| T.. | CONTACT DELAYED TO THE RE–DROP N.O. | T.. | TIMER WITH DELAY TO THE RE–DROP | | THREE–PHASE SYSTEM |
| T.. | CONTACT DELAYED TO THE RE–DROP N.C. | 49.. | THERMAL RELAY | | THREE–PHASE SYSTEM + NEUTRAL |
| 79. | LIMIT SWITCH N.O. | | HEATING ELEMENT | | |
| 79. | LIMIT SWITCH N.C. | | ELECTROVALVE | | |

| REV. | MOD. | DATE | SIGN | APPD | M.G. |
|---|---|---|---|---|---|
| 04 | ISSUE FOR INFORMATION (IFI) | 19/12/24 | | DATE | 05/07/2024 |
| 03 | ISSUE FOR INFORMATION (IFI) | 14/11/24 | | DRN. | F.M. |
| 02 | ISSUE FOR INFORMATION (IFI) | 15/10/24 | F.M. | CHKD | S.S. |

ALEXSISTEMI spa

CLIENT: CROSSWIND

BASE LOAD POWER HUB (BLPH)
B-400

SIMBOL LIST


ROSETTI MARINO

1724000049-EL-DG-00025

F.G. 3
F.S. 4

## B400-HSB-001
## PANEL SIDE


+QG - XM1
MOTOR 1

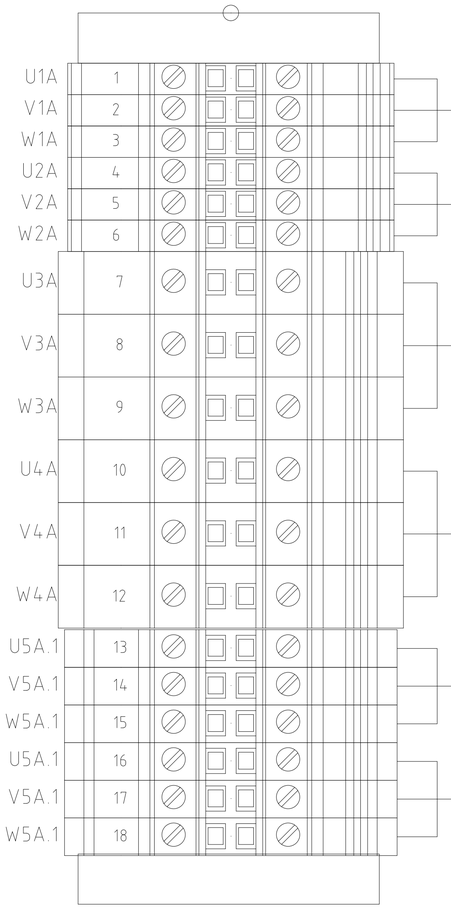


| | | |
|---|---|---|
| 77409-CEL-L1 | 4G2.5 | XLPE/UNEL S2 |
| 77410-CEL-L1 | 4G4 | XLPE/UNEL S2 |
| 77411-CEL-L1 | 4G10 | XLPE/UNEL S2 |
| 77412-CEL-L1 | 4G10 | XLPE/UNEL S2 |
| 77413-CEL-L1 | 4G2.5 | XLPE/UNEL S2 |
| 77414-CEL-L1 | 4G2.5 | XLPE/UNEL S2 |

## HHU-77007
## HJB-77007A

+QG - XM1
MOTOR 1

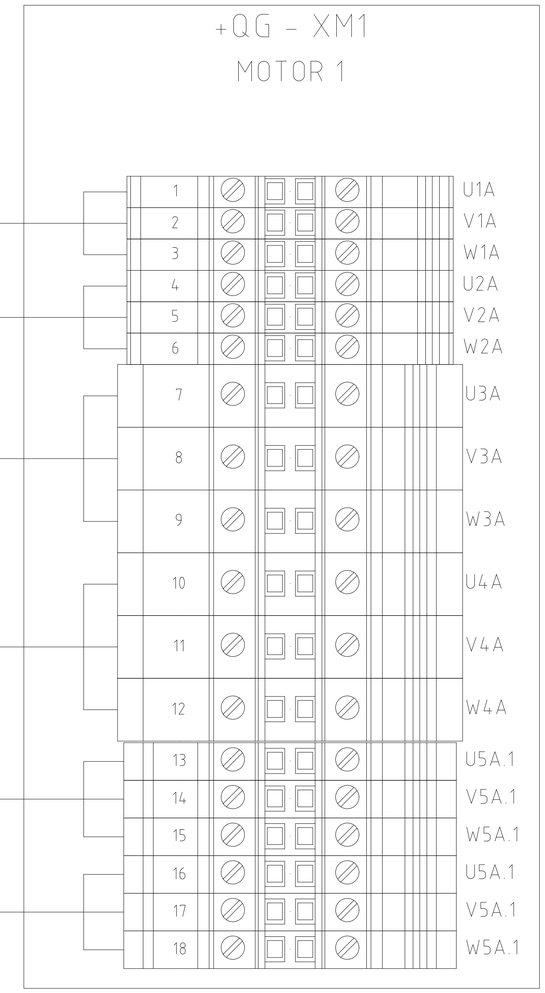


| REV. | MOD. | DATE | SIGN |
|---|---|---|---|
| 04 | ISSUE FOR INFORMATION (IFI) | 19/12/24 | |
| 03 | ISSUE FOR INFORMATION (IFI) | 14/11/24 | |
| 02 | ISSUE FOR INFORMATION (IFI) | 15/10/24 | F.M. |

| | |
|---|---|
| DATE | 05/07/2024 |
| DRN. | F.M. |
| CHKD | S.S. |
| APPD | M.G. |

ALEXSISTEMI spa

CLIENT: CROSSWIND

BASE LOAD POWER HUB (BLPH)
B-400

INTRCONNECTION

ROSETTI MARINO


1724000049-EL-DG-00025

FG. 4
F.S. 5

## B400-HSB-001
## PANEL SIDE

+QG - XMD1

MOTORISED DAMPER 1

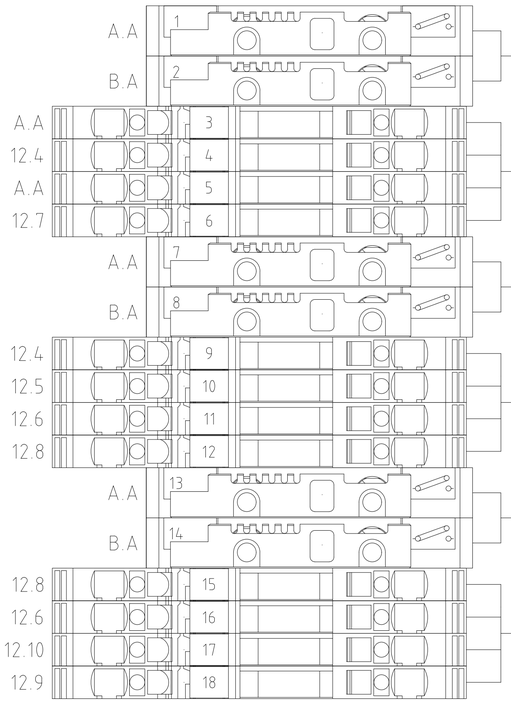



| | | |
|---|---|---|
| 77415-CEL-L1 | 3G1.5 | XLPE/UNEL S2 |
| 77408-CEC-L2 | 4X1.5 | XLPE/UNEL S2 |
| 77416-CEL-L2 | 3G1.5 | XLPE/UNEL S2 |
| 77409-CEC-L2 | 4X1.5 | XLPE/UNEL S2 |
| 77417-CEL-L2 | 3G1.5 | XLPE/UNEL S2 |
| 77410-CEC-L2 | 4X1.5 | XLPE/UNEL S2 |

## HHU-77007
## HJB-77007B

+QG - XMD1

MOTORISED DAMPER 1

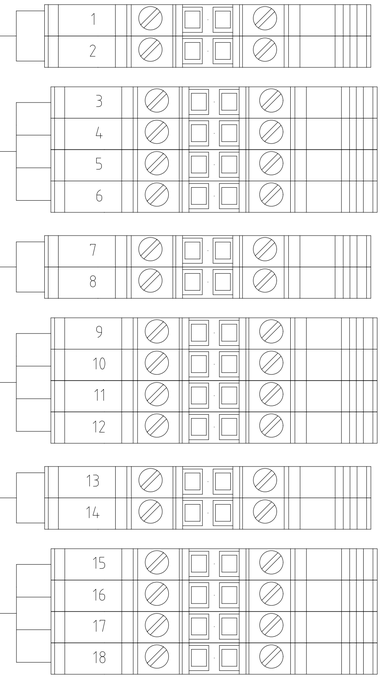


| REV. | MOD. | DATE | SIGN |
|---|---|---|---|
| 04 | ISSUE FOR INFORMATION (IFI) | 19/12/24 | |
| 03 | ISSUE FOR INFORMATION (IFI) | 14/11/24 | |
| 02 | ISSUE FOR INFORMATION (IFI) | 15/10/24 | F.M. |

| | |
|---|---|
| DATE | 05/07/2024 |
| DRN. | F.M. |
| CHKD | S.S. |
| APPD | M.G. |

ALEXSISTEMI spa

CLIENT: CROSSWIND

BASE LOAD POWER HUB (BLPH)
B-400

INTRCONNECTION

ROSETTI MARINO

1724000049-EL-DG-00025

F.G. 5

F.S. 6

## B400-HSB-001
## PANEL SIDE

+QG - XA1
AUXILIARY 1

| | | | | | |
|---|---|---|---|---|---|
| A.A | 100 | 77411-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 100 |
| 13.10 | 101 | | | | 101 |
| 13.7 | 102 | 77412-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 102 |
| 13.8 | 103 | | | | 103 |
| +24VDC | 104 | 77413-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 104 |
| 26.6 | 105 | | | | 105 |
| 13.6 | 106 | 77414-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 106 |
| B.A | 107 | | | | 107 |
| 14.1 | 108 | 77415-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 108 |
| B.A | 109 | | | | 109 |
| 14.13 | 110 | 77416-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 110 |
| B.A | 111 | | | | 111 |
| 15.1 | 112 | 77417-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 112 |
| B.A | 113 | | | | 113 |
| A.A | 114 | 77347-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 114 |
| 15.2 | 115 | | | | 115 |
| A.A | 116 | 77419-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 116 |
| 15.3 | 117 | | | | 117 |
| 11.9 | 118 | 77420-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 118 |
| 11.11 | 119 | | | | 119 |
| A.A | 120 | 77421-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 120 |
| 15.8 | 121 | | | | 121 |
| 15.10 | 122 | 77422-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 122 |
| 15.12 | 123 | | | | 123 |
| A.A | 124 | 77423-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 124 |
| 14.7 | 125 | | | | 125 |
| A.A | 126 | 77424-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 126 |
| 14.9 | 127 | | | | 127 |
| A.A | 128 | 77449-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 128 |
| 15.6 | 129 | | | | 129 |

## HHU-77007
## HJB-77007B

+QG - XA1
AUXILIARY 1

| | |
|---|---|
| 100 | |
| 101 | |
| 102 | |
| 103 | |
| 104 | |
| 105 | |
| 106 | |
| 107 | |
| 108 | |
| 109 | |
| 110 | |
| 111 | |
| 112 | |
| 113 | |
| 114 | |
| 115 | |
| 116 | |
| 117 | |
| 118 | |
| 119 | |
| 120 | |
| 121 | |
| 122 | |
| 123 | |
| 124 | |
| 125 | |
| 126 | |
| 127 | |
| 128 | |
| 129 | |

| REV. | MOD. | DATE | SIGN |
|---|---|---|---|
| 04 | ISSUE FOR INFORMATION (IFI) | 19/12/24 | |
| 03 | ISSUE FOR INFORMATION (IFI) | 14/11/24 | |
| 02 | ISSUE FOR INFORMATION (IFI) | 15/10/24 | F.M. |

| | |
|---|---|
| DATE | 05/07/2024 |
| DRN. | F.M. |
| CHKD | S.S. |
| APPD | M.G. |

ALEXSISTEMI spa

CLIENT: CROSSWIND

BASE LOAD POWER HUB (BLPH)
B-400

INTRCONNECTION

ROSETTI MARINO


1724000049-EL-DG-00025

F.G. 6
F.S. 7

## B400-HSB-001
## PANEL SIDE

+QG - XM2
MOTOR 2

## HHU-77008
## HJB-77008A

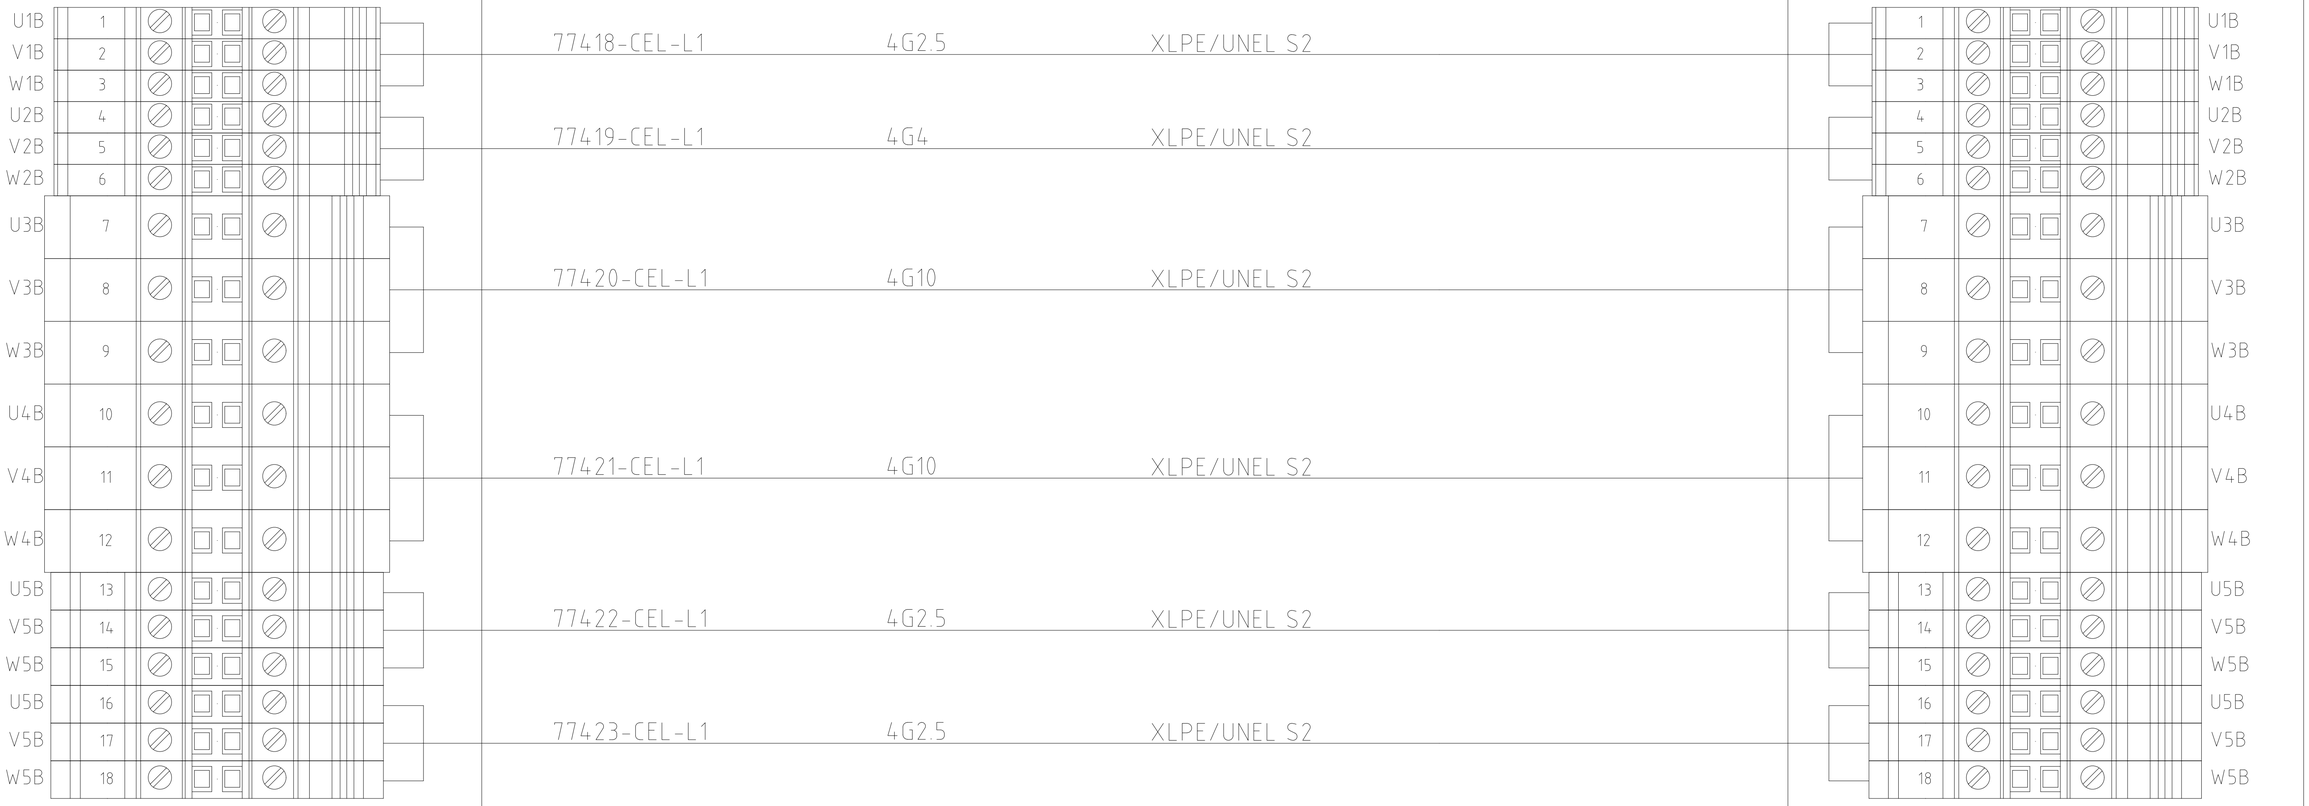


| REV. | MOD. | DATE | SIGN | APPD | M.G. |
|---|---|---|---|---|---|
| 04 | ISSUE FOR INFORMATION (IFI) | 19/12/24 | | DATE | 05/07/2024 |
| 03 | ISSUE FOR INFORMATION (IFI) | 14/11/24 | | DRN. | F.M. |
| 02 | ISSUE FOR INFORMATION (IFI) | 15/10/24 | F.M. | CHKD | S.S. |

ALEXSISTEMI spa

CLIENT: CROSSWIND

BASE LOAD POWER HUB (BLPH)
B-400

INTRCONNECTION

ROSETTI MARINO

1724000049-EL-DG-00025

FG. 7
F.S. 8

B400-HSB-001
PANEL SIDE

+QG - XMD2
MOTORISED DAMPER 2

20.3 — 200
B.B — 201
A.B — 202
20.5 — 203
A.B — 204
20.8 — 205
20.3 — 206
B.B — 207
20.5 — 208
20.6 — 209
20.8 — 210
20.9 — 211
20.3 — 212
B.B — 213
20.6 — 214
20.7 — 215
20.9 — 216
20.10 — 217

| | | | |
|---|---|---|---|
| 77424-CEL-L2 | 3G1.5 | XLPE/UNEL S2 | 200, 201 |
| 77425-CEC-L2 | 4X1.5 | XLPE/UNEL S2 | 202, 203, 204, 205 |
| 77426-CEL-L2 | 3G1.5 | XLPE/UNEL S2 | 206, 207 |
| 77427-CEC-L2 | 4X1.5 | XLPE/UNEL S2 | 208, 209, 210, 211 |
| 77428-CEL-L2 | 3G1.5 | XLPE/UNEL S2 | 212, 213 |
| 77442-CEC-L2 | 4X1.5 | XLPE/UNEL S2 | 214, 215, 216, 217 |

HHU-77008
HJB-77008B

+QG - XMD2
MOTORISED DAMPER 2

200
201
202
203
204
205
206
207
208
209
210
211
212
213
214
215
216
217

| REV. | MOD. | DATE | SIGN |
|---|---|---|---|
| 04 | ISSUE FOR INFORMATION (IFI) | 19/12/24 | |
| 03 | ISSUE FOR INFORMATION (IFI) | 14/11/24 | |
| 02 | ISSUE FOR INFORMATION (IFI) | 15/10/24 | F.M. |

| | |
|---|---|
| DATE | 05/07/2024 |
| DRN. | F.M. |
| CHKD | S.S. |
| APPD | M.G. |

ALEXSISTEMI spa

CLIENT: CROSSWIND

BASE LOAD POWER HUB (BLPH)
B-400

INTRCONNECTION

ROSETTI MARINO

1724000049-EL-DG-00025

FG. 8
F.S. 9

## B400-HSB-001
## PANEL SIDE

+QG - XA2
AUXILIARY 2

| | | | | | |
|---|---|---|---|---|---|
| A.B | 300 | 77428-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 300 |
| 13.11 | 301 | | | | 301 |
| 21.6 | 302 | 77429-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 302 |
| 21.7 | 303 | | | | 303 |
| +24VDC | 304 | 77430-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 304 |
| 26.7 | 305 | | | | 305 |
| 21.5 | 306 | 77431-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 306 |
| B.B | 307 | | | | 307 |
| 22.1 | 308 | 77432-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 308 |
| B.A | 309 | | | | 309 |
| 22.13 | 310 | 77433-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 310 |
| B.A | 311 | | | | 311 |
| 23.1 | 312 | 77434-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 312 |
| B.A | 313 | | | | 313 |
| A.B | 314 | 77450-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 314 |
| 15.2 | 315 | | | | 315 |
| A.B | 316 | 77436-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 316 |
| 15.3 | 317 | | | | 317 |
| 19.3 | 318 | 77437-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 318 |
| 19.4 | 319 | | | | 319 |
| A.B | 320 | 77438EC-L1 | 2X1.5 | XLPE/UNEL S2 | 320 |
| 15.9 | 321 | | | | 321 |
| 23.4 | 322 | 77439-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 322 |
| 15.13 | 323 | | | | 323 |
| A.B | 324 | 77440-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 324 |
| 14.7 | 325 | | | | 325 |
| A.B | 326 | 77441-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 326 |
| 14.9 | 327 | | | | 327 |
| A.B | 328 | 77448-CEC-L1 | 2X1.5 | XLPE/UNEL S2 | 328 |
| 23.6 | 329 | | | | 329 |

## HHU-77008
## HJB-77008B

+QG - XA2
AUXILIARY 2

| | |
|---|---|
| 300 | |
| 301 | |
| 302 | |
| 303 | |
| 304 | |
| 305 | |
| 306 | |
| 307 | |
| 308 | |
| 309 | |
| 310 | |
| 311 | |
| 312 | |
| 313 | |
| 314 | |
| 315 | |
| 316 | |
| 317 | |
| 318 | |
| 319 | |
| 320 | |
| 321 | |
| 322 | |
| 323 | |
| 324 | |
| 325 | |
| 326 | |
| 327 | |
| 328 | |
| 329 | |

| REV. | MOD. | DATE | SIGN |
|---|---|---|---|
| 04 | ISSUE FOR INFORMATION (IFI) | 19/12/24 | |
| 03 | ISSUE FOR INFORMATION (IFI) | 14/11/24 | |
| 02 | ISSUE FOR INFORMATION (IFI) | 15/10/24 | F.M. |

| | |
|---|---|
| DATE | 05/07/2024 |
| DRN. | F.M. |
| CHKD | S.S. |
| APPD | M.G. |

ALEXSISTEMI spa

CLIENT: CROSSWIND

BASE LOAD POWER HUB (BLPH)
B-400


INTERCONNECTION

ROSETTI MARINO


1724000049-EL-DG-00025

FG. 9
F.S. 10


## B400-HSB-001
## PANEL SIDE
+QG - XP1
POWER SUPPLY 1

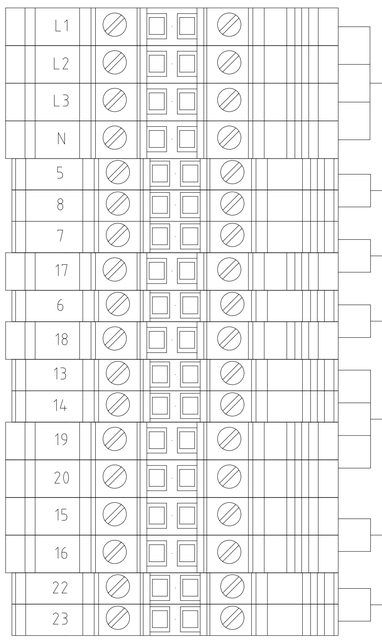



| | | |
|---|---|---|
| POWER SUPPLY | 5G16 | FROM CLIENT |
| 77401-CEL-L1 | 3G2.5 | XLPE/UNEL S2 |
| 77402-CEL-L1 | 3G2.5 | XLPE/UNEL S2 |
| 77403-CEL-L1 | 3G2.5 | XLPE/UNEL S2 |
| 77404-CEL-L1 | 5G2.5 | XLPE/UNEL S2 |
| 77408-CEL-L2 | 3G2.5 | XLPE/UNEL S2 |
| HEATING CSBLE TBA | 2X1.5 | XLPE/UNEL S2 |

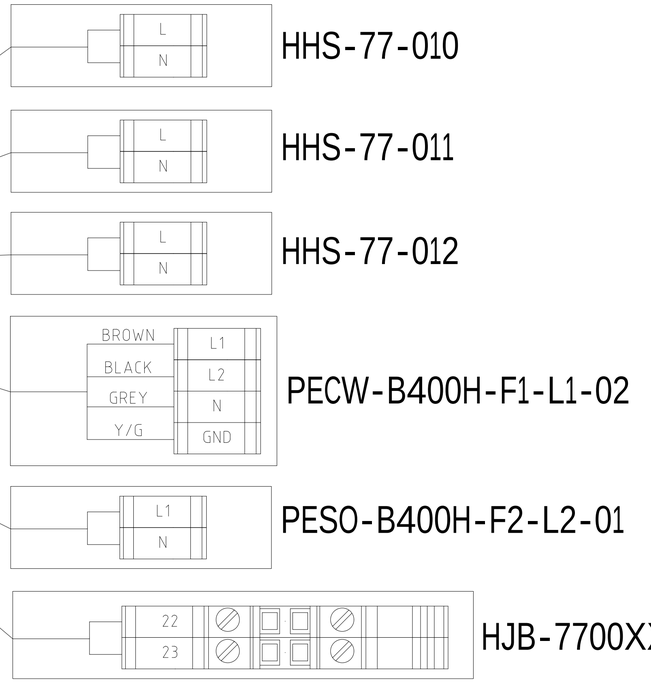


+QG - XC
COMMAND

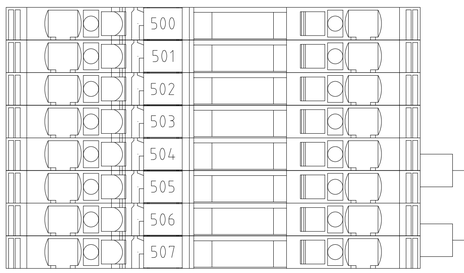


| | | |
|---|---|---|
| 77401-CEC-L1 | 2X1.5 | XLPE/UNEL S2 |
| 77402-CEC-L1 | 2X1.5 | XLPE/UNEL S2 |

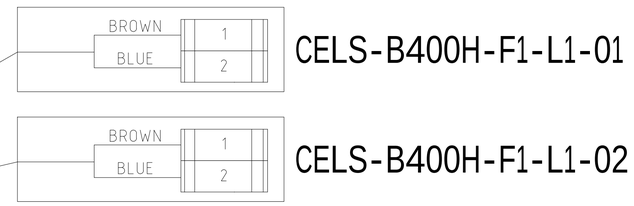


| REV. | MOD. | DATE | SIGN |
|---|---|---|---|
| 04 | ISSUE FOR INFORMATION (IFI) | 19/12/24 | |
| 03 | ISSUE FOR INFORMATION (IFI) | 14/11/24 | |
| 02 | ISSUE FOR INFORMATION (IFI) | 15/10/24 | F.M. |

| | |
|---|---|
| DATE | 05/07/2024 |
| DRN. | F.M. |
| CHKD | S.S. |
| APPD | M.G. |

ALEXSISTEMI spa

CLIENT: CROSSWIND

BASE LOAD POWER HUB (BLPH)
B-400
INTERCONNECTION


ROSETTI MARINO

1724000049-EL-DG-00025

FG. 10
F.S. 11


# B400-HSB-001
# PANEL SIDE

## +QG - XT
TRASMITTER

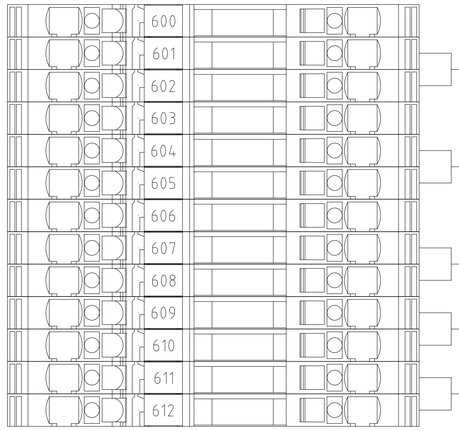


| | | | |
|---|---|---|---|
| 77453-CEC-L1 | 3X1.5+Sh | XLPE/UNEL S2 | 77-TT-401 (+Vdc, Out mA; 1, 2) |
| 77449-CEC-L1 | 3X1.5+Sh | XLPE/UNEL S2 | 77-TT-402 (+Vdc, Out mA; 1, 2) |
| 77450-CEC-L1 | 3X1.5+Sh | XLPE/UNEL S2 | 77-TP-401 (BROWN, BLACK; 1, 2) |
| 77454-CEC-L1 | 3X1.5+Sh | XLPE/UNEL S2 | 77-TT-403 (+Vdc, Out mA; 1, 2) |
| 77455-CEC-L1 | 3X1.5+Sh | XLPE/UNEL S2 | 77-TT-404 (+Vdc, Out mA; 1, 2) |

## +QG - XFD
FIRE DAMPER

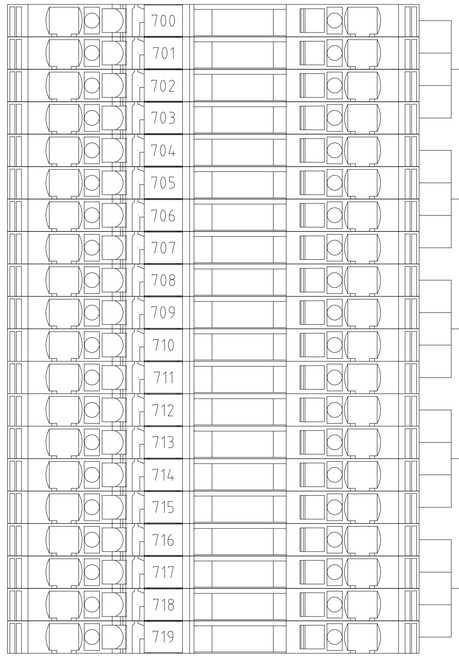


| | | | |
|---|---|---|---|
| 77442-CEC-L2 | 4X1.5 | XLPE/UNEL S2 | HFD-77012 (+, –, PE) |
| 77443-CEC-L2 | 4X1.5 | XLPE/UNEL S2 | HFD-77013 (+, –, PE) |
| 77444-CEC-L2 | 4X1.5 | XLPE/UNEL S2 | HFD-77014 (+, –, PE) |
| 77445-CEC-L2 | 4X1.5 | XLPE/UNEL S2 | HFD-77015 (+, –, PE) |
| 77446-CEC-L2 | 4X1.5 | XLPE/UNEL S2 | HFD-77016 (+, –, PE) |

| REV. | MOD. | DATE | SIGN |
|---|---|---|---|
| 04 | ISSUE FOR INFORMATION (IFI) | 19/12/24 | |
| 03 | ISSUE FOR INFORMATION (IFI) | 14/11/24 | |
| 02 | ISSUE FOR INFORMATION (IFI) | 15/10/24 | F.M. |

| | |
|---|---|
| DATE | 05/07/2024 |
| DRN. | F.M. |
| CHKD | S.S. |
| APPD | M.G. |

ALEXSISTEMI spa

CLIENT: CROSSWIND

BASE LOAD POWER HUB (BLPH)
B-400

INTERCONNECTION


ROSETTI MARINO


1724000049-EL-DG-00025

FG. 11
F.S. 12


B400-HSB-001
PANEL SIDE

+QG - XFD/S
FIRE DAMPERS SIGNAL TO SIS

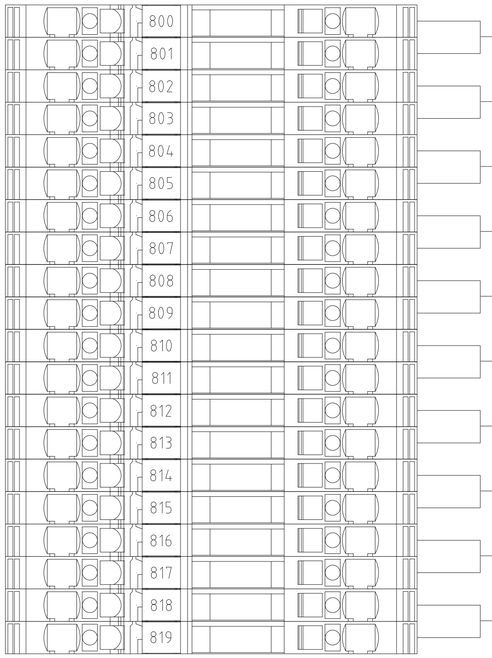




HFD-77012 CLOSED SIGNAL





HFD-77012 OPEN SIGNAL





HFD-77013 CLOSED SIGNAL





HFD-77013 OPEN SIGNAL





HFD-77014 CLOSED SIGNAL





HFD-77014 OPEN SIGNAL





HFD-77015 CLOSED SIGNAL




HFD-77015 OPEN SIGNAL





HFD-77016 CLOSED SIGNAL




HFD-77016 OPEN SIGNAL

+QG - XUPS
UPS POWER SUPPLY




UPS POWER SUPPLY 3G2.5 FROM CLIENT

| REV. | MOD. | DATE | SIGN | | |
|---|---|---|---|---|---|
| 04 | ISSUE FOR INFORMATION (IFI) | 19/12/24 | | DATE | 05/07/2024 |
| 03 | ISSUE FOR INFORMATION (IFI) | 14/11/24 | | DRN. | F.M. |
| 02 | ISSUE FOR INFORMATION (IFI) | 15/10/24 | F.M. | CHKD | S.S. |
| | | | | APPD | M.G. |

ALEXSISTEMI spa

CLIENT: CROSSWIND

BASE LOAD POWER HUB (BLPH)
B-400

INTERCONNECTION

ROSETTI MARINO

1724000049-EL-DG-00025

FG. 12
F.S. /