Base Load Power Hub (BLPH)

NITROGEN GENERATION PACKAGE U-64000

CABLE LIST

Document Number: 1724000437-EL-LIS-00017

ROSETTI MARINO

1	NO COMMENTS - APPROVED - WORK MAY PROCEED
2	MINOR COMMENTS - REVISE AND RESUBMIT - WORK MAY PROCEED
3	MAJOR COMMENTS – REJECTED – DO NOT PROCEED
4	APPROVAL NOT REQUIRED

NOTE: Approval doesn't relieve the supplier from mandatory compliance with contractual documents and specifications. Comments made do not imply acceptance of any cost or delivery impact.

Sign	Date
Giuseppe Cavallo	25/01/25

Document Class: 2

01	02/01/2025	Issue for Information (IFI)	SG	GT	TM
00	07/08/2024	Issue for Information (IFI)	SG	GT	TM
Rev.	Date	Description	Prepared	Reviewed	Approved

COES

This document undergoes an issuance cycle within EDMS Fusionlive". Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

Revision / Change Log

Rev.	Description
00	Issue for Information (IFI)
01	Issue for Information (IFI)

HOLDS LIST

No.	Description
1	
2	
3	
4	

This document undergoes an issuance cycle within EDMS Fusionlive". Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

Table of contents

1 INTRODUCTION 5

1.1 PROJECT OVERVIEW 5

1.1.1 Project Location 5

1.1.2 Project Concept 6

2 DOCUMENT SCOPE 8

2.1 REFERENCES 8

2.2 DEFINITIONS AND ABBREVIATIONS 8

3 CABLE LIST 9

This document undergoes an issuance cycle within EDMS Fusionlive". Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

List of Figures

Figure 1 HOLLANDSE KUST NOORD WIND PARK Location Map 5

Figure 2 - Wind Park Details 6

Figure 3 – BLPH Concept 6

List of tables

Table 1 - Reference Documents 8

Table 2 - Definitions and Abbreviations 8

List of Attachments

None

This document undergoes an issuance cycle within EDMS Fusionlive". Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

1 INTRODUCTION

1.1 PROJECT OVERVIEW

Crosswind, a Shell and Eneco joint venture, was awarded the tender to develop the offshore Hollandse Kust Noord (HKN) wind farm, located 18.5km off the coast of Netherlands near the town of Egmond aan Zee. The consortium plans to have HKN operational in 2023 with an installed capacity of 759MW generating at least 3.3TWh per year. This is sufficient renewable power to supply more than 1 million Dutch households with green electricity.

Offshore wind farms produce intermittent electricity and balancing these dips and peaks and integrating this electricity into the national energy system requires new technologies. For this reason, the offshore wind farm will include several new technologies that could be implemented at full-scale in the future. The new technologies being explored include a floating solar park, a short-duration battery storage as well as long-term storage via green hydrogen produced by water electrolysis and subsequently consumed in a fuel cell. The combination of these individual measures, herein referred to as the Base Load Power Hub (BLPH) will ensure a continuous power supply regardless of the wind situation.

1.1.1 Project Location

The Hollandse Kust Noord (HKN) wind farm is located 18.5km off the coast of the Netherlands near the town of Egmond aan Zee.

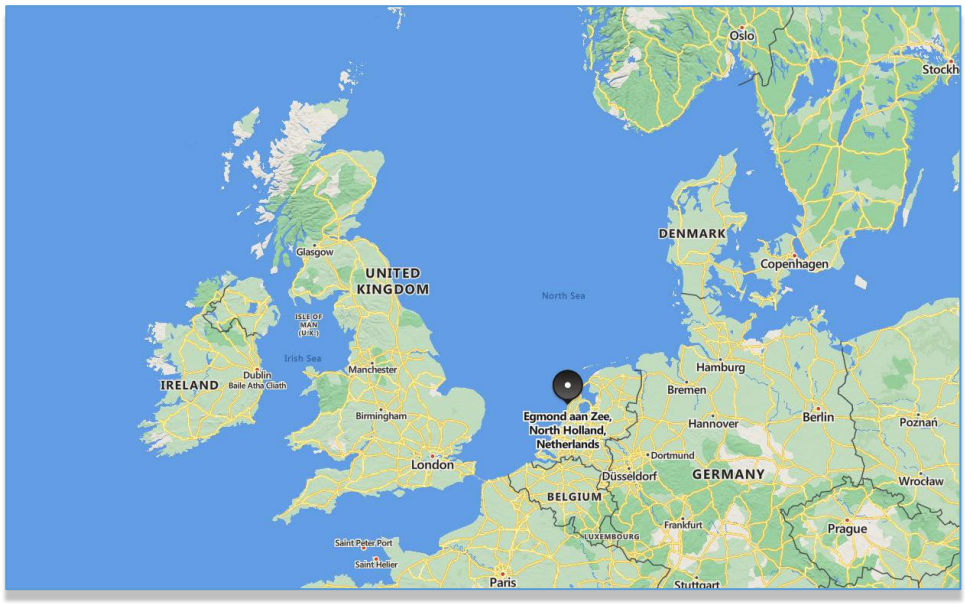


Figure 1 HOLLANDSE KUST NOORD WIND PARK Location Map



Figure 2 - Wind Park Details

The wind farm will consist of No. 69 x 11.5MW wind turbine generators each to be installed on a dedicated monopile structure. A 70th monopile located on coordinates E 590719.1, N 5841602.3 is reserved for installing the platform accommodating the BLPH. The monopile structure was designed and installed by Van Oord Offshore Wind (VooW) and therefore not part of the BLPH scope.

1.1.2 Project Concept

All components included in the BLPH will be integrated onshore on a topsides and installed in an offshore location within the boundaries of the HKN wind farm. At its simplest, the BLPH will store energy during periods of high electricity generation from renewable sources (a wind turbine generator and the floating solar PV farm) and release it during periods of low generation. In practice. It is expected that the energy stored will supplement generation from renewable sources to ensure that at least 1.0MW of power is exported to the electrical grid regardless of wind/solar availability.

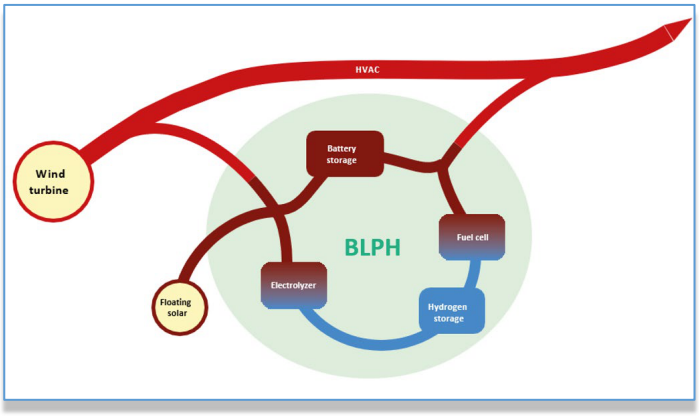


Figure 3 – BLPH Concept

Electricity in the BLPH will be stored in the form of electrons in a battery energy storage system (BESS) as well as converted into green hydrogen via water electrolysis. When the power output from the connecting wind turbine drops to below 1 MWe, the BLPH will return its stored energy to supplement the remaining power output. This will be by discharging the BESS, while stored hydrogen will be converted back into electricity using a fuel cell to extend the discharge duration.

The purpose of the BLPH s to function as a testbed for the integration of energy storage technologies with renewable generation. It is expected that equipment installed on the BLPH will operate as Normally Unmanned Installation for at least two (2) years with no or minimal maintenance and it will have its own independent control room with the ability to communicate with Crosswind's control room.

This document undergoes an issuance cycle within EDMS Fusionlive". Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

2 DOCUMENT SCOPE

This document identifies any electrical equipment to be fed with its main characteristics.

2.1 REFERENCES

Doc. No.	Description
1724000428-PR-PID-00019	PACKAGE P&ID
1724000428-MAC-DS-00011	EQUIPMENT DATA SHEETS INCLUDING MOTORS, AIR COMPRESSOR, DRYERS, ETC.

Table 1 - Reference Documents

2.2 DEFINITIONS AND ABBREVIATIONS

COMPANY or Client (CPY):	Crosswind
CONTRACTOR (CTR):	ROSETTI MARINO S.p.A.
PROJECT:	HOLLANDSE KUST NOORD WIND PARK Project

Table 2 - Definitions and Abbreviations

This document undergoes an issuance cycle within EDMS Fusionlive". Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

3 CABLE LIST

CABLE LIST																
Revision index	Service	Cable Tag.	Cable ID	Section	Colour		Screened		Type	Fire Resistant	Flame Retardant	Routing		Cable lenght (meter)	Cable gland type	Cable gland size
					External	Internal	Overal	Indivudual				From	To			
0	ANS	C-64PT051	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-PT-051	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ANS	C-64PT052	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-PT-052	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ANS	C-64PT053	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-PT-053	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ANS	C-64PT057	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-PT-057	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ANS	C-64PDIT056	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-PDIT-056	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ANS	C-64AIT051	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-AIT-051	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ANS	* C-64PT059	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-PT-059	64-LP-001	N.A.	Double compression	ISO M20x1,5
0	ZS	C-64ZSL051	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSL-051	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSH051	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSH-051	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSL052	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSL-052	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSH052	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSH-052	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSL053	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSL-053	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSH053	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSH-053	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSL054	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSL-054	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSH054	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSH-054	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSL055	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSL-055	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSH055	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSH-055	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSL056	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSL-056	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSH056	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSH-056	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSL057	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSL-057	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSH057	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSH-057	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSL058	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSL-058	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSH058	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSH-058	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSL059	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSL-059	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSH059	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSH-059	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSL060	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSL-060	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSH060	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSH-060	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSL061	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSL-061	64-LP-001	TBA	Double compression	ISO M20x1,5
0	ZS	C-64ZSH061	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x1mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-ZSH-061	64-LP-001	TBA	Double compression	ISO M20x1,5
0	SOV	C-64XY051	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x2,5mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-XY-051	64-LP-001	TBA	Double compression	ISO M20x1,5
0	SOV	C-64XY052	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x2,5mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-XY-052	64-LP-001	TBA	Double compression	ISO M20x1,5
0	SOV	C-64XY053	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x2,5mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-XY-053	64-LP-001	TBA	Double compression	ISO M20x1,5
0	SOV	C-64XY054	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x2,5mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-XY-054	64-LP-001	TBA	Double compression	ISO M20x1,5
0	SOV	C-64XY055	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x2,5mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-XY-055	64-LP-001	TBA	Double compression	ISO M20x1,5
0	SOV	C-64XY056	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x2,5mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-XY-056	64-LP-001	TBA	Double compression	ISO M20x1,5
0	SOV	C-64XY057	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x2,5mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-XY-057	64-LP-001	TBA	Double compression	ISO M20x1,5

This document undergoes an issuance cycle within EDMS Fusionlive". Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

0	SOV	C-64XY058	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x2,5mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-XY-058	64-LP-001	TBA	Double compression	ISO M20x1,5
0	SOV	C-64XY059	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x2,5mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-XY-059	64-LP-001	TBA	Double compression	ISO M20x1,5
0	SOV	C-64XY060	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x2,5mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-XY-060	64-LP-001	TBA	Double compression	ISO M20x1,5
0	SOV	C-64XY061	XLPE/OS/PVC/SWB/PVC - 300V	circular 1x2x2,5mm2 + shield	Grey	Black(+) White(-)	X		SWB Armored	NO	IEC 60332-3-22	64-XY-061	64-LP-001	TBA	Double compression	ISO M20x1,5

Legenda:
SOV = Solenoid Valve
ZS = Switch
ANS = Signal 4-20mA
* = NOT IN COES SCOPE OF SUPPLY

This document undergoes an issuance cycle within EDMS Fusionlive". Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy