
DRAWING NO. 123A90-DDL-AR-DL-10015

REV. 01

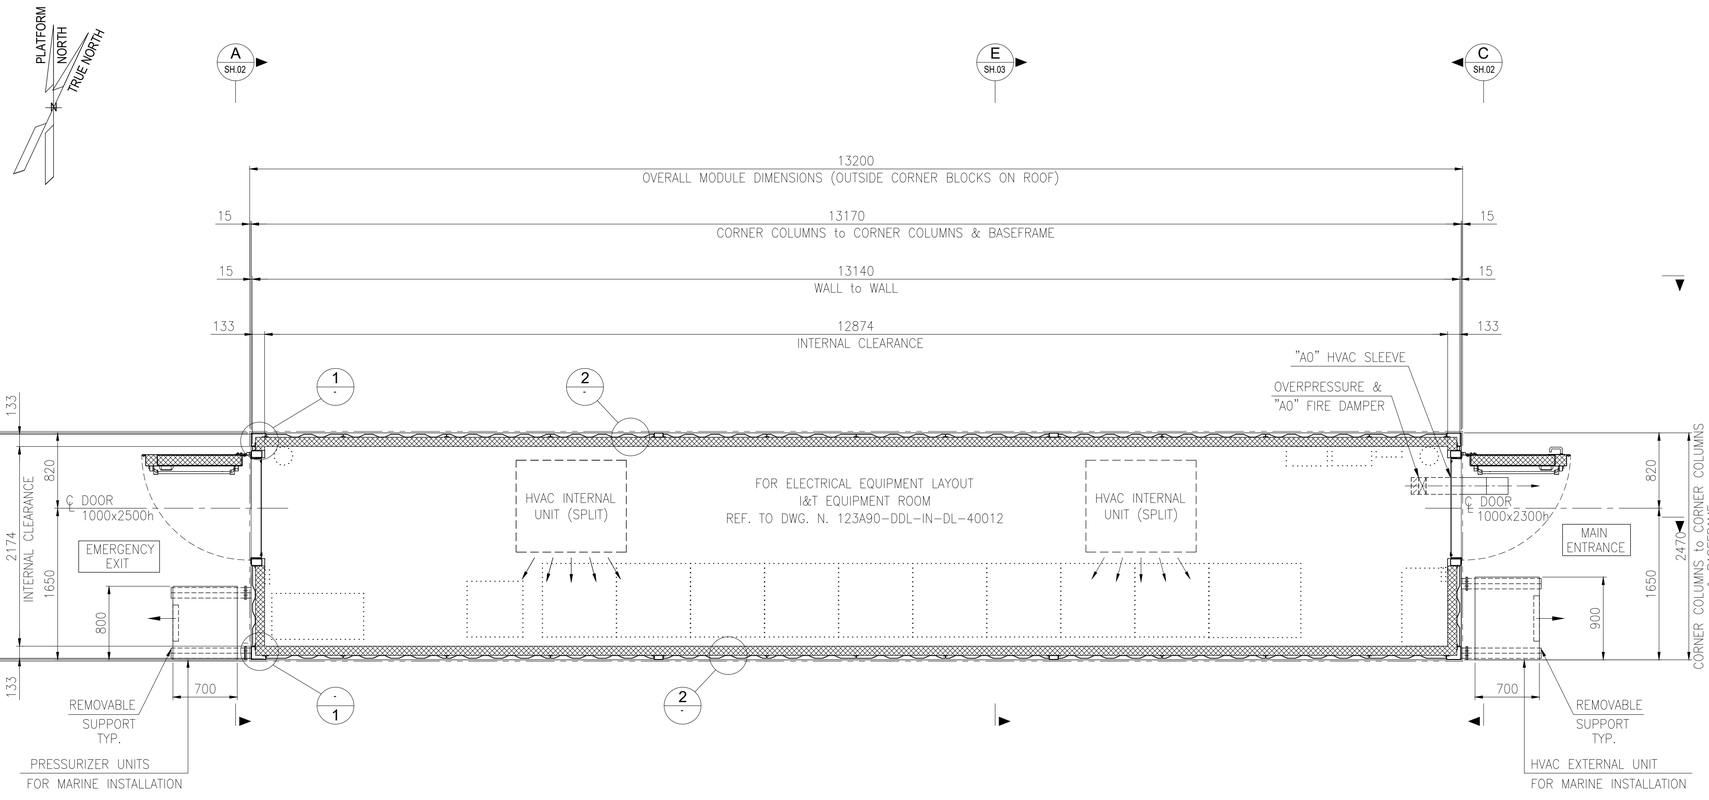


PLAN OF I&T EQUIPMENT ROOM B-400

FOR SECTIONS & VIEWS SEE DWG N. 123A90-DDL-AR-DL-10015 Sh. 02 & 03


INCLUDED IN SUPPLY COMPLETE HVAC SYSTEM, NORMAL AND EMERGENCY LIGHTING SYSTEM INCLUDING CONTROL PANELS

FOR HVAC SYSTEM, LIGHTING SYSTEM, EARTH SYSTEM REF.TO DOC. N.1724000049-AR-DD-00021 (by VENDOR)


01

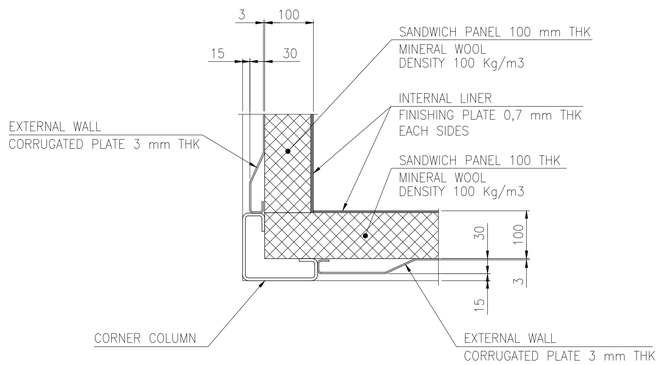

DETAIL 1 . AT CORNERS TYPICAL

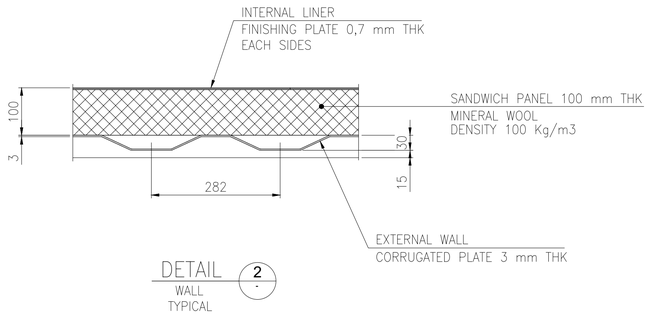

DETAIL 2 . WALL TYPICAL

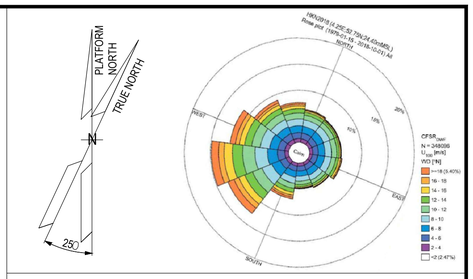

NOTES

1. U.N.O. ALL DIMENSIONS ARE IN MILLIMETERS.
2. ALL WELDS MUST BE CONTINUOUS, SPOT WELDS ARE NOT PERMITTED

LEGEND

U.N.O. _____ UNLESS NOTED OTHERWISE
T.O.S. _____ TOP OF STEEL
T.O.P. _____ TOP OF PLATE
T.B.D. _____ TO BE DEFINED
T.B.C. _____ TO BE COMFIRMED

_____ CORRUGATED PLATE 3 mm THK

_____ THERMAL INSULATION


_____ EQUIPMENT INSIDE MODULE

HOLDS

REFERENCE

DOCUMENT TITLE	DOCUMENT NUMBER
I&T Equipment Room – Supply Specification	123A90-DDL-AR-SP-10014
I&T Equipment Room – Material Requisition	123A90-DDL-AR-MR-10019
I&T Equipment Room – Doors Map and Schedule	123A90-DDL-AR-DL-10016
I&T Equipment Room – Flooring and Lining Layout	123A90-DDL-AR-DL-10017
I&T Equipment Room – Fire rated requirement layout (plan, section, typical detail)	123A90-DDL-AR-DL-10018
I&T Equipment Room – Equipment Layout	23A90-DDL-IN-DL-40012
B-400 General Arramgement Dwg's (by Vendor)	1724000049-AR-DA-00017
B-400 Detail Dwg's (by Vendor)	1724000049-AR-DD-00021
B-400 Structural Calculation (by Vendor)	1724000049-ST-CA-00009
B-400 Foundation Dwg (by Vendor)	1724000049-ST-DD-00013
Lifting Drawings (by Vendor)	1724000049-AR-DD-00062

KEY PLAN

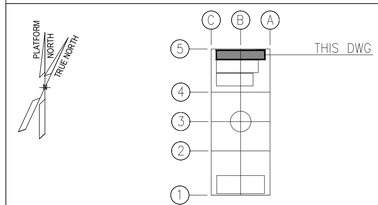

STILOG

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	23/02/24	R. BO	M. GA	D. LO	ACCEPTED FOR CONSTRUCTION (AFC)
00	30/10/23	R. BO	M. GA	D. LO	ISSUE FOR REVIEW (IFR)

CROSSWIND | ROSETTI MARINO


TITLE : BASE LOAD POWER HUB (BLPH)
I&T EQUIPMENT ROOM B-400 – ARCHITECTURAL
GENERAL LAYOUT – PLAN, WIEW, SECT. & TYP. DET.


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:33
DRAWN R. BOSSI	CHECKED M. GATTI	APPROVED D. LO STERZO	DATE 23/02/24

A1	DRAWING NO. 123A90-DDL-AR-DL-10015	SHEET 001	REV. 01

File Name : 123A90-DDL-AR-DL-10015 Rev.01

DRAWING NO. 123A90-DDL-AR-DL-10015 REV. 01

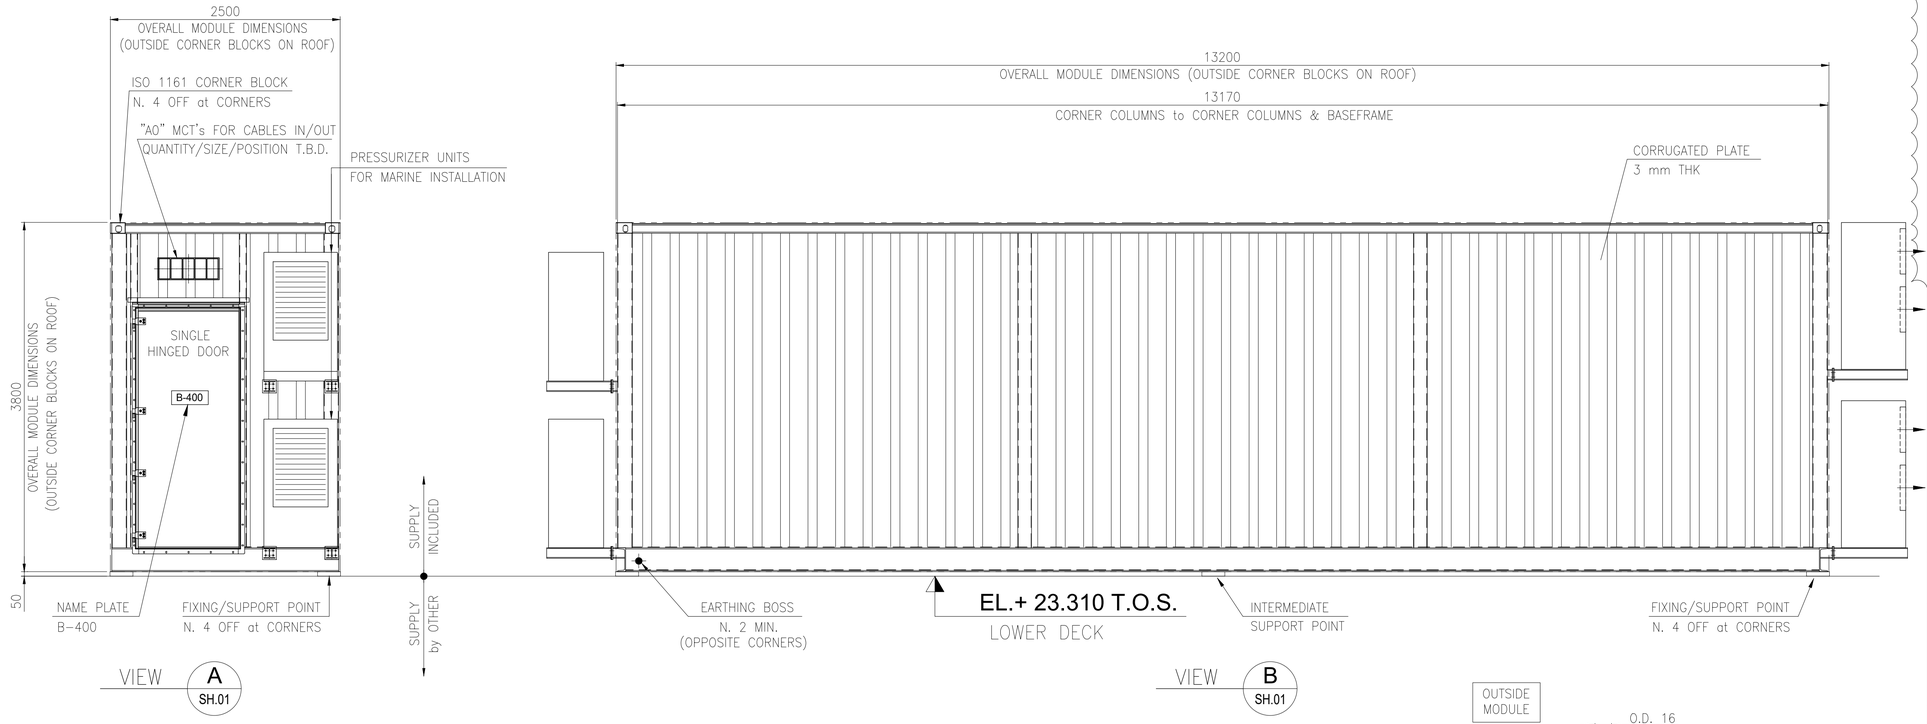

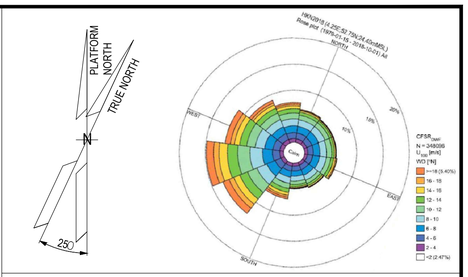

NOTES

1. U.N.O. ALL DIMENSIONS ARE IN MILLIMETERS.
2. ALL WELDS MUST BE CONTINUOUS, SPOT WELDS ARE NOT PERMITTED

LEGEND

U.N.O.	UNLESS NOTED OTHERWISE
T.O.S.	TOP OF STEEL
T.O.P.	TOP OF PLATE
T.B.D.	TO BE DEFINED
T.B.C.	TO BE COMFIRMED
	CORRUGATED PLATE 3 mm THK
	THERMAL INSULATION
	EQUIPMENT INSIDE MODULE

HOLDS


REFERENCE


DOCUMENT TITLE	DOCUMENT NUMBER
I&T Equipment Room – Supply Specification	123A90-DDL-AR-SP-10014
I&T Equipment Room – Material Requisition	123A90-DDL-AR-MR-10019
I&T Equipment Room – Doors Map and Schedule	123A90-DDL-AR-DL-10016
I&T Equipment Room – Flooring and Lining Layout	123A90-DDL-AR-DL-10017
I&T Equipment Room – Fire rated requirement layout (plan, section, typical detail)	123A90-DDL-AR-DL-10018
I&T Equipment Room – Equipment Layout	23A90-DDL-IN-DL-40012
B-400 General Arramgement Dwg's (by Vendor)	1724000049-AR-DA-00017
B-400 Detail Dwg's (by Vendor)	1724000049-AR-DD-00021
B-400 Structural Calculation (by Vendor)	1724000049-ST-CA-00009
B-400 Foundation Dwg (by Vendor)	1724000049-ST-DD-00013
Lifting Drawings (by Vendor)	1724000049-AR-DD-00062

FOR PLAN SEE DWG N. 123A90-DDL-AR-DL-10015 Sh. 01


01

FOR HVAC SYSTEM, LIGHTING SYSTEM, EARTH SYSTEM, MCT's WALL PENETRATIONS
REF. TO DOC. N.1724000049-AR-DD-00021 (by VENDOR)

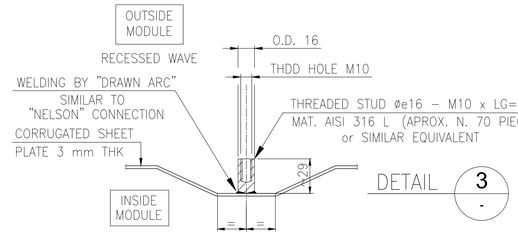

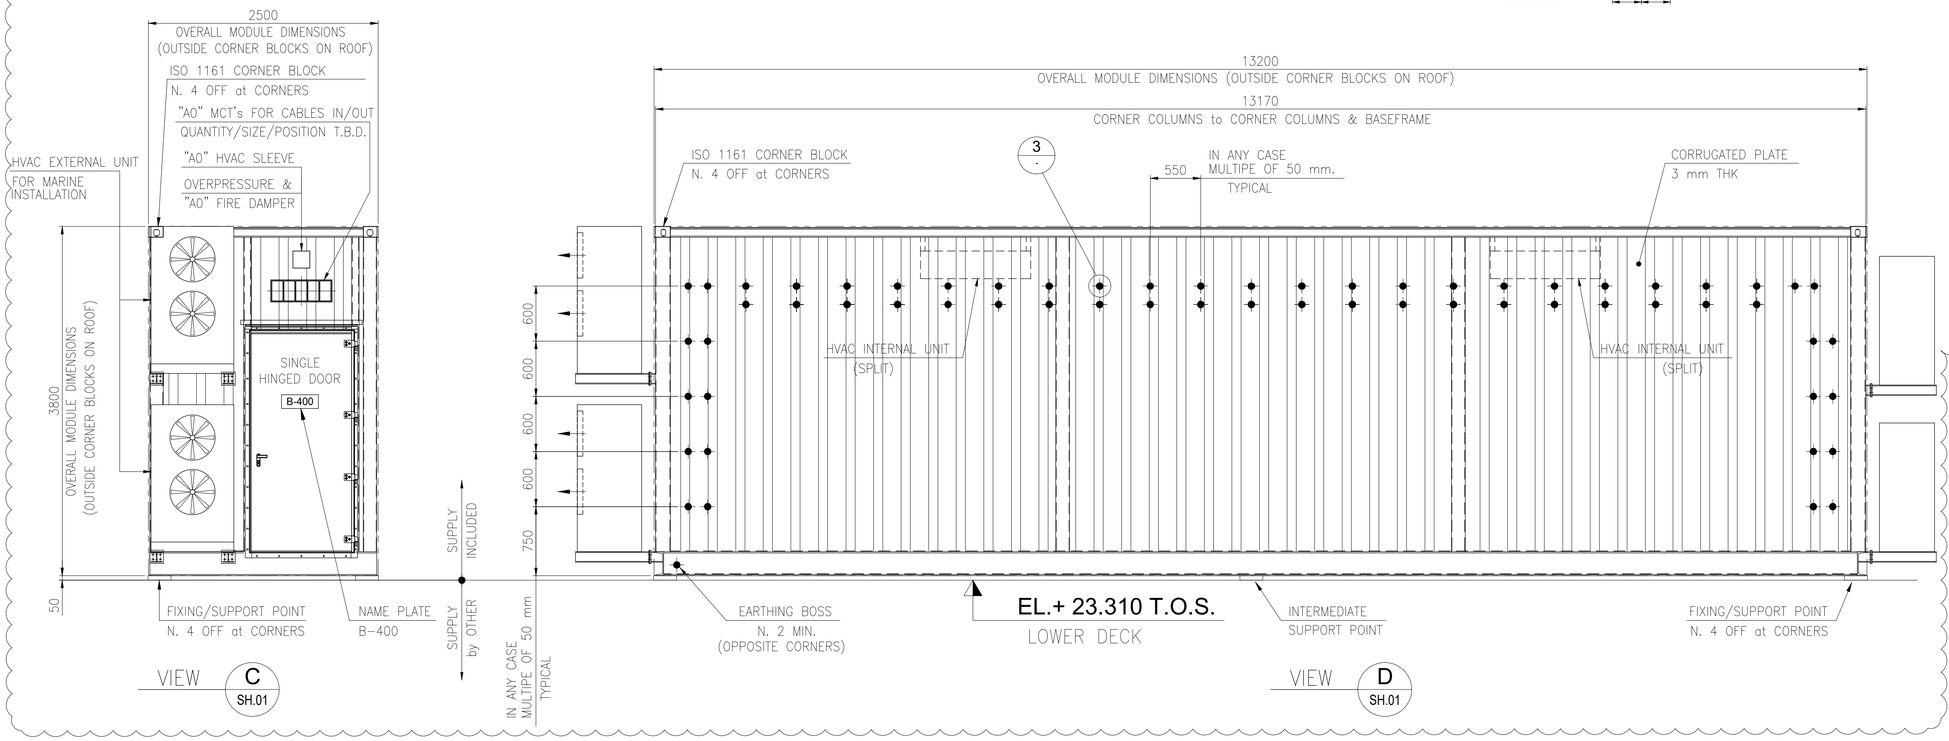

KEY PLAN

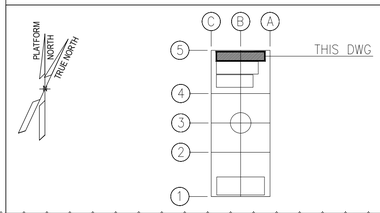

STILOG

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	23/02/24	R. BO	M. GA	D. LO	ACCEPTED FOR CONSTRUCTION (AFC)
00	30/10/23	R. BO	M. GA	D. LO	ISSUE FOR REVIEW (IFR)

CROSSWIND | ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
I&T EQUIPMENT ROOM B-400 – ARCHITECTURAL
GENERAL LAYOUT – PLAN, WIEW, SECT. & TYP. DET.


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:33
DRAWN R. BOSSI	CHECKED M. GATTI	APPROVED D. LO STERZO	DATE 23/02/24

A1	DRAWING NO. 123A90-DDL-AR-DL-10015	SHEET 002	REV. 01

File Name : 123A90-DDL-AR-DL-10015 Rev.01


DRAWING NO. 123A90-DDL-AR-DL-10015

REV. 01

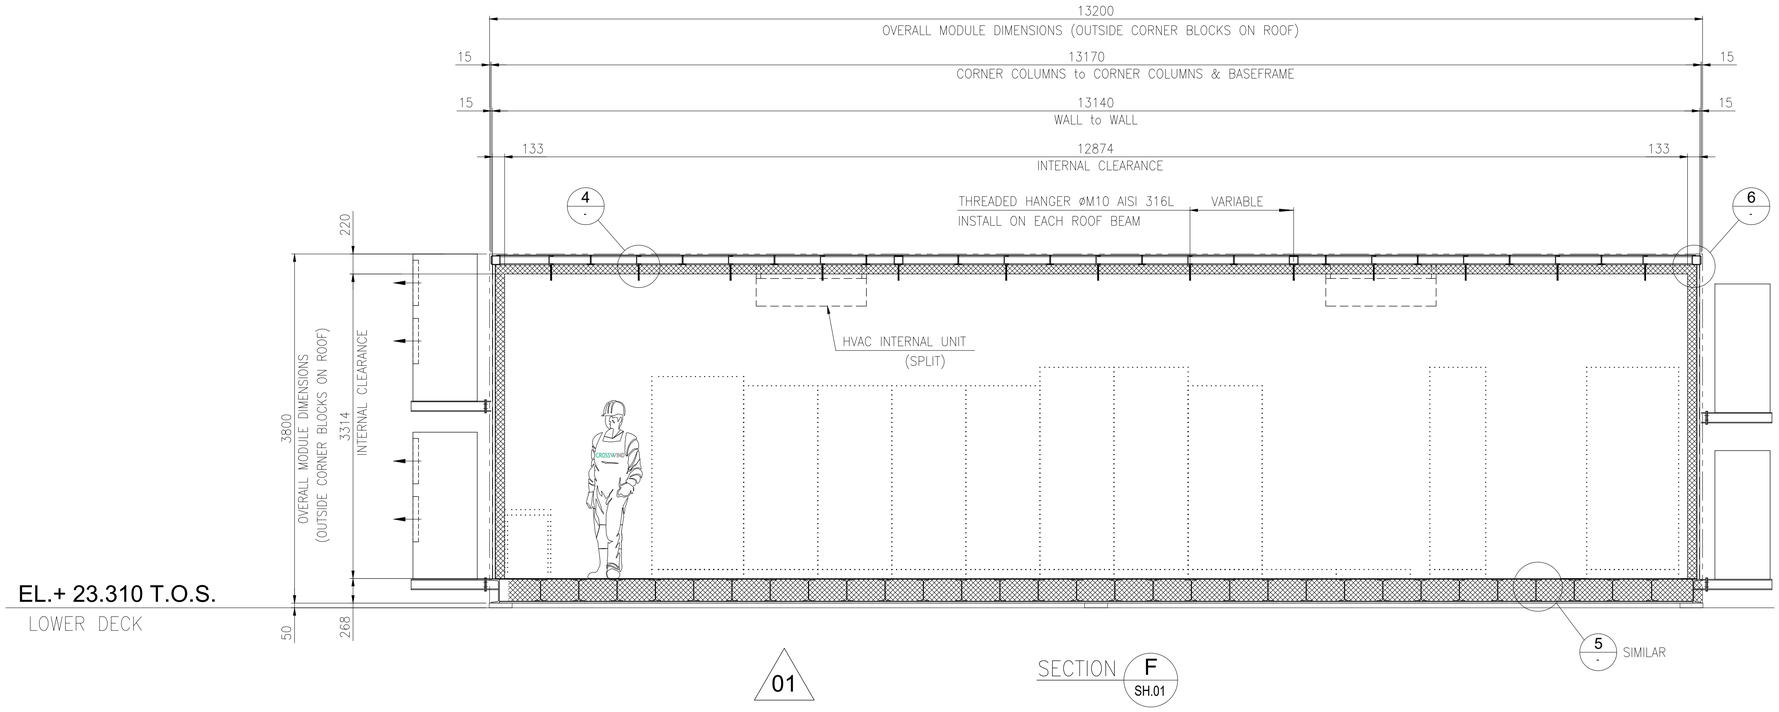

01

SECTION F SH.01

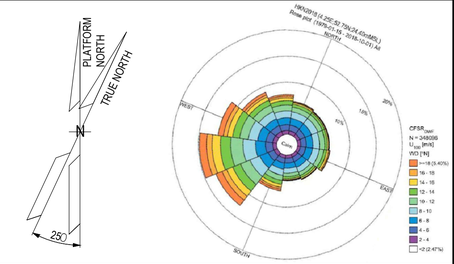

NOTES

1. U.N.O. ALL DIMENSIONS ARE IN MILLIMETERS.
2. ALL WELDS MUST BE CONTINUOUS, SPOT WELDS ARE NOT PERMITTED

LEGEND

U.N.O.	UNLESS NOTED OTHERWISE
T.O.S.	TOP OF STEEL
T.O.P.	TOP OF PLATE
T.B.D.	TO BE DEFINED
T.B.C.	TO BE COMFIRMED
	CORRUGATED PLATE 3 mm THK
	THERMAL INSULATION
	EQUIPMENT INSIDE MODULE


HOLDS

REFERENCE


DOCUMENT TITLE	DOCUMENT NUMBER
I&T Equipment Room – Supply Specification	123A90-DDL-AR-SP-10014
I&T Equipment Room – Material Requisition	123A90-DDL-AR-MR-10019
I&T Equipment Room – Doors Map and Schedule	123A90-DDL-AR-DL-10016
I&T Equipment Room – Flooring and Lining Layout	123A90-DDL-AR-DL-10017
I&T Equipment Room – Fire rated requirement layout (plan, section, typical detail)	123A90-DDL-AR-DL-10018
I&T Equipment Room – Equipment Layout	23A90-DDL-IN-DL-40012
B-400 General Arramgement Dwg's (by Vendor)	1724000049-AR-DA-00017
B-400 Detail Dwg's (by Vendor)	1724000049-AR-DD-00021
B-400 Structural Calculation (by Vendor)	1724000049-ST-CA-00009
B-400 Foundation Dwg (by Vendor)	1724000049-ST-DD-00013
Lifting Drawings (by Vendor)	1724000049-AR-DD-00062

FOR PLAN SEE DWG N. 123A90-DDL-AR-DL-10015 Sh. 01


FOR HVAC SYSTEM, LIGHTING SYSTEM, EARTH SYSTEM, MCT's WALL PENETRATIONS REF. TO DOC. N.1724000049-AR-DD-00021 (by VENDOR)

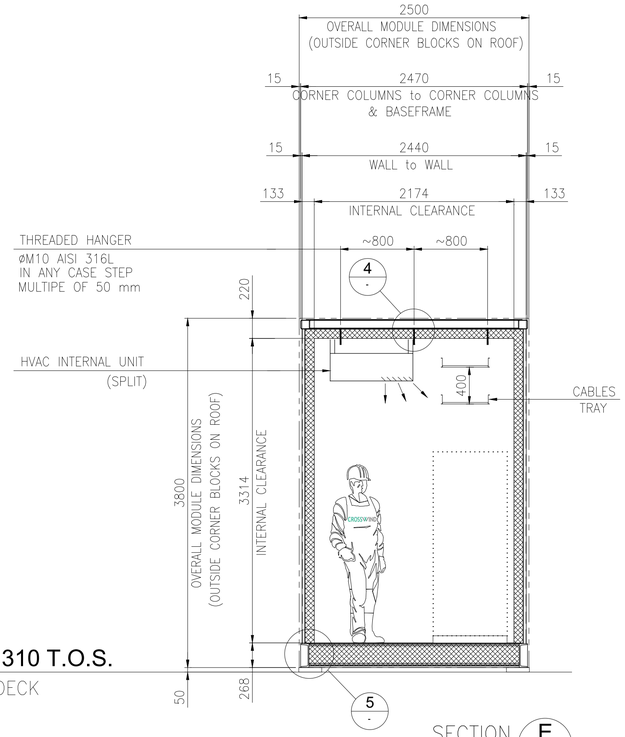


SECTION E SH.01

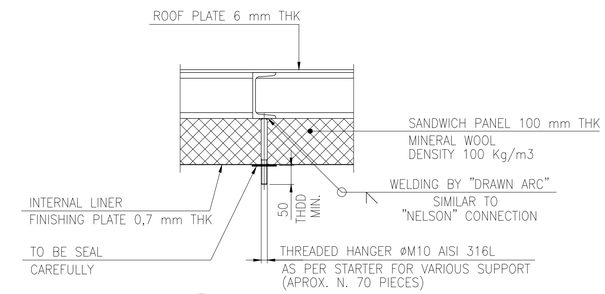

DETAIL 4

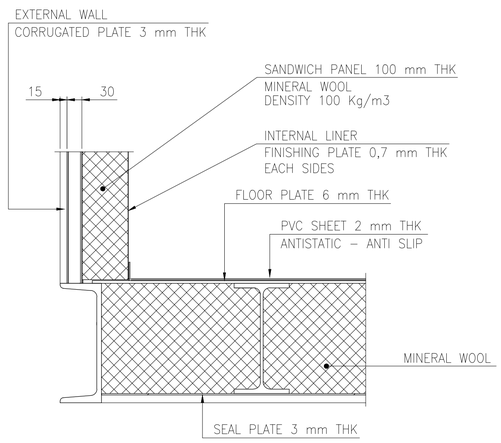


DETAIL 5

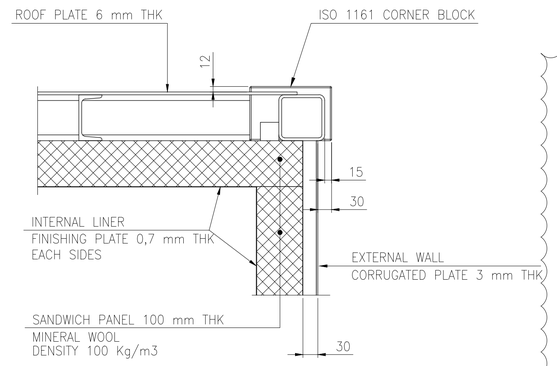

DETAIL 6

KEY PLAN

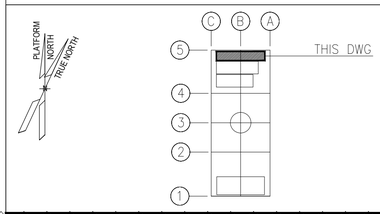

STILOG

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	23/02/24	R. BO	M. GA	D. LO	ACCEPTED FOR CONSTRUCTION (AFC)
00	30/10/23	R. BO	M. GA	D. LO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
I&T EQUIPMENT ROOM B-400 – ARCHITECTURAL
GENERAL LAYOUT – PLAN, WIEW, SECT. & TYP. DET.

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:33
DRAWN R. BOSSI	CHECKED M. GATTI	APPROVED D. LO STERZO	DATE 23/02/24

A1	DRAWING NO. 123A90-DDL-AR-DL-10015	SHEET 003	REV. 01

File Name : 123A90-DDL-AR-DL-10015 Rev.01