Base Load Power Hub (BLPH)

ATEX CERTIFICATION - HYDROGEN VENT

Document Number: 1724000887-MAC-LIS-00013

Document Class: 2

02	06/12/2024	Acceptance for construction (AFC)	SB	RV	ADL
01	25/10/2024	Acceptance for construction (AFC)	SB	RV	ADL
00	19/09/2024	Issue for Review (IFR)	SB	RV	ADL
Rev.	Date	Description	Prepared	Reviewed	Approved

THERMO ENGINEERING AN ENCORE COMBUSTION COMPANY

THERMO ENGINEERING ADVANCED COMBUSTION SYSTEMS

This document undergoes an issuance cycle within EDMS Fusionlive". Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

Revision / Change Log

Rev.	Description
00	Issue for Review (IFR)
01	Acceptance for Construction (AFC)
02	Acceptance for Construction (AFC)

HOLDS LIST

No.	Description
1	
2	
3	
4	

This document undergoes an issuance cycle within EDMS Fusionlive". Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

Table of contents

1 INTRODUCTION 5

1.1 PROJECT OVERVIEW 5

1.1.1 Project Location 5

1.1.2 Project Concept 6

2 DOCUMENT SCOPE 8

2.1 REFERENCES 8

2.2 DEFINITIONS AND ABBREVIATIONS 8

3 ATEX CERTIFICATION 9

This document undergoes an issuance cycle within EDMS Fusionlive". Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

List of Figures

Figure 1 HOLLANDSE KUST NOORD WIND PARK Location Map 5
Figure 2 - Wind Park Details 6
Figure 3 – BLPH Concept 6

List of tables

Table 1 - Reference Documents..... Errore. Il segnalibro non è definito.
Table 2 - Definitions and Abbreviations 8

List of Attachments

Attachment 1

- ETS-05_Baseefa13ATEX0137 Issue 6

Attachment 2

- XTVR_SGS20ATEX0049X_Issue 4

1 INTRODUCTION

1.1 PROJECT OVERVIEW

Crosswind, a Shell and Eneco joint venture, was awarded the tender to develop the offshore Hollandse Kust Noord (HKN) wind farm, located 18.5km off the coast of Netherlands near the town of Egmond aan Zee. The consortium plans to have HKN operational in 2023 with an installed capacity of 759MW generating at least 3.3TWh per year. This is sufficient renewable power to supply more than 1 million Dutch households with green electricity.

Offshore wind farms produce intermittent electricity and balancing these dips and peaks and integrating this electricity into the national energy system requires new technologies. For this reason, the offshore wind farm will include several new technologies that could be implemented at full-scale in the future. The new technologies being explored include a floating solar park, a short-duration battery storage as well as long-term storage via green hydrogen produced by water electrolysis and subsequently consumed in a fuel cell. The combination of these individual measures, herein referred to as the Base Load Power Hub (BLPH) will ensure a continuous power supply regardless of the wind situation.

1.1.1 Project Location

The Hollandse Kust Noord (HKN) wind farm is located 18.5km off the coast of the Netherlands near the town of Egmond aan Zee.

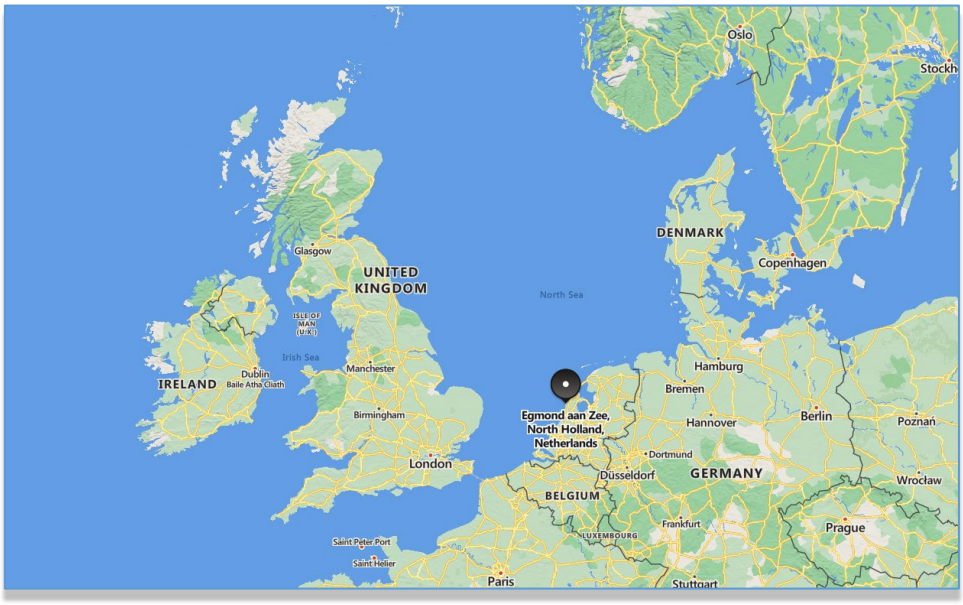


Figure 1 HOLLANDSE KUST NOORD WIND PARK Location Map

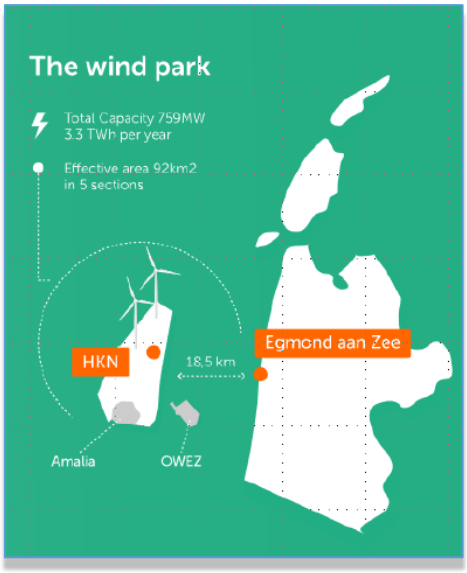


Figure 2 - Wind Park Details

The wind farm will consist of No. 69 x 11.5MW wind turbine generators each to be installed on a dedicated monopile structure. A 70th monopile located on coordinates E 590719.1, N 5841602.3 is reserved for installing the platform accommodating the BLPH. The monopile structure was designed and installed by Van Oord Offshore Wind (VooW) and therefore not part of the BLPH scope.

1.1.2 Project Concept

All components included in the BLPH will be integrated onshore on a topsides and installed in an offshore location within the boundaries of the HKN wind farm. At its simplest, the BLPH will store energy during periods of high electricity generation from renewable sources (a wind turbine generator and the floating solar PV farm) and release it during periods of low generation. In practice. It is expected that the energy stored will supplement generation from renewable sources to ensure that at least 1.0MW of power is exported to the electrical grid regardless of wind/solar availability.

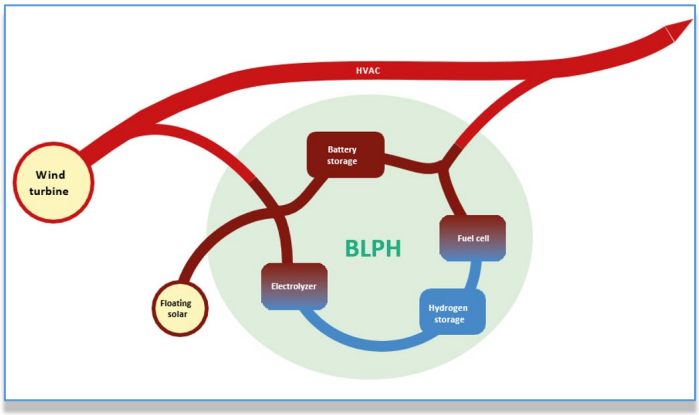


Figure 3 – BLPH Concept

Electricity in the BLPH will be stored in the form of electrons in a battery energy storage system (BESS) as well as converted into green hydrogen via water electrolysis. When the power output from the connecting wind turbine drops to below 1 MWe, the BLPH will return its stored energy to supplement the remaining power output. This will be by discharging the BESS, while stored hydrogen will be converted back into electricity using a fuel cell to extend the discharge duration.

The purpose of the BLPH s to function as a testbed for the integration of energy storage technologies with renewable generation. It is expected that equipment installed on the BLPH will operate as Normally Unmanned Installation for at least two (2) years with no or minimal maintenance and it will have its own independent control room with the ability to communicate with Crosswind's control room.

This document undergoes an issuance cycle within EDMS Fusionlive". Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

2 DOCUMENT SCOPE

This Document includes the Atex Certifications of the project as attachments

2.1 REFERENCES

To see Atex Register – Doc. No.: 1724000887-QC-LIS-00019_03

2.2 DEFINITIONS AND ABBREVIATIONS

COMPANY or Client (CPY):	CROSSWIND
CONTRACTOR (CTR):	ROSETTI MARINO S.p.A.
PROJECT:	HOLLANDSE KUST NOORD WIND PARK Project

Table 1 - Definitions and Abbreviations

1 # EU - TYPE EXAMINATION CERTIFICATE

2 **Equipment or Protective System Intended for use in Potentially Explosive Atmospheres**
Directive 2014/34/EU

3 EU - Type Examination Certificate Number: **Baseefa13ATEX0137 Issue 6**

3.1 In accordance with Article 41 of Directive 2014/34/EU, EC-Type Examination Certificates referring to 94/9/EC that were in existence prior to the date of application of 2014/34/EU (20 April 2016) may be referenced as if they were issued in accordance with Directive 2014/34/EU. Supplementary Certificates to such EC-Type Examination Certificates, and new issues of such certificates, may continue to bear the original certificate number issued prior to 20 April 2016.

4 Product: **ETS-05 Electronic Thermostat**

5 Held by: **nVent Thermal Belgium NV**

6 Address: **Research Park Haasrode - Zone 2, Romeinse straat 14, B-3001 Leuven, Belgium**

7 This re-issued certificate extends EC Type Examination Certificate No. Baseefa13ATEX0137 to apply to product designed and constructed in accordance with the specification set out in the Schedule of the said certificate but having any variations specified in the Schedule attached to this certificate and the documents therein referred to.

8 SGS Fimko Oy, Notified Body number 0598, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this product has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II to the Directive.

8.1 The original certificate was issued by SGS Baseefa Ltd (UK Notified Body 1180). It, and any supplements previously issued by SGS Baseefa Ltd have been transferred to the supervision of SGS Fimko Oy (EU Notified Body 0598). The original certificate number is retained.

The examination and test results are recorded in confidential Report No. **See Certificate History**

9 Compliance with the Essential Health and Safety Requirements has been assured by compliance with:

EN IEC 60079-0:2018 EN IEC 60079-7:2015+A1:2018 EN 60079-11:2012 EN 60079-18: 2015 EN 60079-31:2013

except in respect of those requirements listed at item 18 of the Schedule.

10 If the sign "X" is placed after the certificate number, it indicates that the product is subject to the Specific Conditions of Use specified in the schedule to this certificate.

11 This EU - TYPE EXAMINATION CERTIFICATE relates only to the design and construction of the specified product. Further requirements of the Directive apply to the manufacturing process and supply of this product. These are not covered by this certificate.

12 The marking of the product shall include the following:

Ex **See schedule**

SGS Fimko Oy Customer Reference No. **5034** Project File No. **20/0458**

This document is issued by the Company subject to their General Conditions for Certification Services accessible at hiip://www.sgs.com/en/Terms-and-Conditions.aspx . Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained herein reflects the Company's findings at the time of their intervention only and within the limits of Client's instructions, if any. It does not necessarily indicate that the equipment may be used in particular industries or circumstances. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, schedule included, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

SGS Fimko Oy
Takomotie 8
FI-00380 Helsinki, Finland
Telephone +358 (0)9 696 361
e-mail sgs.fimko@sgs.com
web site www.sgs.fi
Business ID 0978538-5 Member of the SGS Group (SGA SA)

Tuomas Hänninen
SGS Fimko Oy

13 # Schedule

14 ## Certificate Number Baseefa13ATEX0137 – Issue 6

15 Description of Product

The nVent ETS-05 Electronic Thermostat provides accurate temperature control for heating cables.

It comprises a plastic box with terminals inside for connection to the sensor and to the incoming user connections. Relay contacts are present to allow resistive loads of up to 230V a.c. at 32A to be controlled.

ETS-05-a1-bb-c
The supply range for the equipment is 99 to 121V a.c.
Supply & relay terminal block TB1 U_m = 253V. Rated current = 32A.
Relay terminal block TB3 (if present) U_m = 253V.

ETS-05-a1R-bb-c
The supply range for the equipment is 99 to 132V a.c. U_m = 253V.
Supply & relay terminal block TB1 Um = 253V. Rated current = 32A.
Relay terminal block TB3 (if present) Um = 253V.

ETS-05-a2-bb-c
The supply range for the equipment is 195 to 230V a.c. U_m = 253V.
Supply & relay terminal block TB1 Um = 253V. Rated current = 32A.
Relay terminal block TB3 (if present) Um = 253V.

ETS-05-a2R-bb-c
The supply range for the equipment is 195 to 277V a.c. U_m = 277V.
Supply & relay terminal block TB1 Um = 277V. Rated current = 32A.
Relay terminal block TB3 (if present) Um = 277V.

The options a bb & c affect the operational non-safety aspects:-
a = A (0°C to 49°C model)
H (0°C to 499°C model)
L (0°C to 199°C model)
bb = A (American market version)
= E (European market version)
= J (Japanese market version)
c = A (Alarm output model) Rated alarm output = 275V, 3A resistive.
= not present (Alarm output not present)

Sensor Connections - Terminal Block TB2

U_o = 5.88V
I_o = 29mA
P_o = 43mW
C_i =26nF
L_i = 0
U_i = 0

The capacitance and either the inductance or inductance to resistance ratio (L/R) of the load connected to hazardous area terminals must not exceed the following values:

GROUP	CAPACITANCE (µF)	INDUCTANCE (mH)	OR L/R RATIO (µH/ohm)
IIC	43	43	843
IIB	1000	172	3373
IIA	1000	345	6746

The above load parameters apply where:

1. The external circuit contains no combined lumped inductance L_i and capacitance C_i greater than 1% of the above values, or
2. The inductance and capacitance are distributed as in a cable, or
3. The external circuit contains either only lumped inductance or lumped capacitance in combination with a cable.

In all other situations e.g. the external circuit contains combined lumped inductance and lumped capacitance, up to 50% of each of the L and C values is allowed.

The equipment is marked:

Ⓔx II 2(1)G Ex eb ia mb [ia Ga] IIC T5 Gb -40ºC ≤ Ta ≤ +60ºC
Ⓔx II 2D Ex tb IIIC T100ºC Db

16 Report Number

See Certificate History.

17 Specific Conditions of Use

None

18 Essential Health and Safety Requirements

In addition to the Essential Health and Safety Requirements (EHSRs) covered by the standards listed at item 9, the following are considered relevant to this product.

Clause	Subject	Compliance
1.2.7	LVD type requirements	Standards require manufacturer's declaration, supplied.
1.2.8	Overloading of equipment (protection relays, etc.)	Covered by installation rules and manufacturer's instructions
1.4.1	External effects	The Purchaser should make the manufacturer aware of such issues. Covered in Instructions
1.4.2	Aggressive substances, etc.	The Purchaser should make the manufacturer aware of such issues. Covered in Instructions

19 Drawings and Documents

New drawings submitted for this issue of certificate:

Number	Sheet	Issue	Date	Description
RGD 1102-107	1	6	01/05/2021	ETS-05 nVent Certification Label

This drawing is held with IECEx BAS 13.0071 Issue 6.
Other applicable drawings are listed on Baseefa13ATEX0126 Issue 5.

20 Certificate History

Certificate No.	Date	Comments
Baseefa13ATEX0137	26 August 2014	The release of the prime certificate. The associated test and assessment against the requirements of EN60079-0: 2012, EN60079-7: 2007, EN60079-11: 2012, EN60079-18: 2009 & EN60079-31: 2013 is recorded in Report GB/BAS/ExTR14.0185/00 for Project 12/0565
Baseefa13ATEX0137 Issue 1	21 December 2016	This issue reflects the issue of Baseefa13ATEX0126 Issue 1. Report GB/BAS/ExTR16.0395/00, Project 16/0987

Certificate No.	Date	Comments
Baseefa13ATEX0137/2	28 February 2018	To permit the use of an alternative opto-coupler and the correction of the marking code. See report GB/BAS/ExTR18.0099/00 for project 17/0869.
Baseefa13ATEX0137/3	22 January 2019	To confirm the certificate is now held in the name of nVent Thermal Belgium BV, and to permit the label to show name of nVent Thermal Belgium BV. See GB/BAS/ExTR18.0125/00 for project 17/0864.
Baseefa13ATEX0137/4	8 April 2020	To permit the addition of a new variant model ETS-05-x3-x that has an increased voltage range of 195V to 277V, and an increased U_m of 277V. See report GB/BAS/ExTR20.0070/00 for project 20/0005.
Baseefa13ATEX0137 Issue 5	10 August 2020	This issue of the certificate incorporates previously issued primary & supplementary certificates into one certificate, permits the use of an alternative enclosure, and confirms the equipment meets the requirements of EN IEC 60079-0:2018, EN IEC 60079-7: 2015+A1:2018 and EN 60079-18: 2015. See report GB/BAS/ExTR20.0119/00 for project 20/0123.
Baseefa13ATEX0137 Issue 6	30 September 2021	This issue of the certificate permits the addition of models with alarm outputs and permits the introduction of a new model naming convention. See report GB/BAS/ExTR21.0172/00 for project 20/0458.
For drawings applicable to each issue, see original of that issue.		

EU - TYPE EXAMINATION CERTIFICATE

Equipment or Protective System Intended for use in Potentially Explosive Atmospheres
Directive 2014/34/EU

3	EU - Type Examination Certificate Number:	**SGS20ATEX0049X – Issue 4**
4	Product:	**XTV Range of Self-Regulating Trace Heating Systems**
5	Manufacturer:	**nVent Thermal LLC**
6	Address:	**899 Broadway Street, CA, 94063-3104, United States of America**

7 This re-issued certificate extends EU Type Examination Certificate No. **SGS20ATEX0049X** to apply to product designed and constructed in accordance with the specification set out in the Schedule of the said certificate but having any variations specified in the Schedule attached to this certificate and the documents therein referred to.

8 SGS Fimko Oy, Notified Body number 0598, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this product has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II to the Directive.

The examination and test results are recorded in confidential Report No. **See Certificate History**

9 Compliance with the Essential Health and Safety Requirements has been assured by compliance with:

EN IEC 60079-0:2018 EN IEC 60079-7:2015+A1:2018 EN 60079-18:2015+A1:2017 EN 60079-30-1:2017 EN 60079-31:2014

except in respect of those requirements listed at item 18 of the Schedule.

10 If the sign "X" is placed after the certificate number, it indicates that the product is subject to the Specific Conditions of Use specified in the schedule to this certificate.

11 This EU - TYPE EXAMINATION CERTIFICATE relates only to the design and construction of the specified product. Further requirements of the Directive apply to the manufacturing process and supply of this product. These are not covered by this certificate.

12 The marking of the product shall include the following :

Ⓔx II 2 GD Ex 60079-30-1 eb IIC T* Gb or Ex 60079-30-1 eb mb IIC T* Gb Tmin -60°C
Ex 60079-30-1 tb IIIC T°C Db or Ex 60079-30-1 mb tb IIIC T**°C Db (*/** see schedule)**

SGS Fimko Oy Customer Reference No. **0865** Project File No. **23/0318**

This document is issued by the Company subject to their General Conditions for Certification Services accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx . Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained herein reflects the Company's findings at the time of their intervention only and within the limits of Client's instructions, if any. It does not necessarily indicate that the equipment may be used in particular industries or circumstances. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, schedule included, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

SGS Fimko Oy
Takomotie 8
FI-00380 Helsinki, Finland
Telephone +358 (0)9 696 361
e-mail sgs.fimko@sgs.com
web site www.sgs.fi
Business ID 0978538-5 Member of the SGS Group (SGA SA)

Mikko Välimäki
SGS Fimko Oy

13 # Schedule

14 ## Certificate Number SGS20ATEX0049X – Issue 4

15 Description of Product

The XTV Range of Self-Regulating Trace Heating Systems is of the parallel circuit self-regulating type, rated at up to 277V, with power output up to 66W/m (20W/ft). The units have a maximum self-limiting temperature of 240°C. The systems are also suitable for applications at lower temperatures when used as part of a stabilised design. The limiting temperatures of the end seals, splices and power connections must be observed as part of the self-limiting or stabilised design.

Each trace heating system comprises:

- the active heating cable.
- an end seal for terminating the remote end of the unit.
- a cable gland for connecting the powered end of the unit to a suitable terminal enclosure, or alternative integrated power connection systems.

The active heating cable comprises two stranded copper conductors separated by a fluoropolymer spacer around which are wound, in a spiral, a number of carbon loaded polymer fibres, which form the active part of the heating cable. An extruded layer of fluoropolymer covers the fibres and serves to insulate the copper conductors from a conductive covering, which covers the basic heater. A protective anti-corrosion fluoropolymer sheath may be extruded over the conductive cover. In this arrangement the unit is designated the XTV-CT Range of Self-Regulating Trace Heating Systems.

The outer fluoropolymer sheath may optionally be omitted to form the XTV-C Range of Self-Regulating Trace Heating Systems.

The declared maximum withstand temperature for the range is 250°C and the minimum installation temperature is -60°C.

CABLE ACCESSORIES

END SEALS

The end seals for terminating the remote end of the unit may be the following types:

Types E-100-L or E-100, which are mechanical end seals incorporating an end cap which is filled with silicone grease sealant, covered by certificates Sira14ATEX3015X and PTB09ATEX1060U.

Types E-100-L-A or E-100-A, which are mechanical end seals incorporating an end cap which is filled with silicone grease sealant.

A Raychem Type E-40 heat shrink end seal kit.

Type E-150 mechanical end seals, covered by certificate DEKRA20ATEX0011U.

SPLICES AND JOINTS

The following splicing and jointing arrangements are provided:

A Raychem Type S-40 heat shrink splice kit for connecting lengths of active heating cable.

A Raychem T-100 tee connection system, certificate PTB20ATEX1008U, for connecting up to three heater cables.


Type S-150 mechanical splice kit, covered by DEKRA20ATEX0011U.
POWER CONNECTIONS

Power connection may be achieved by the following means:

Connection Type	ATEX Certificate
JBM-100	PTB20ATEX1008U
JBS-100	PTB20ATEX1008U
JBU-100	PTB20ATEX1008U
C-150-E	DEKRA20ATEX0011U
C25-21 Connection Kit	Baseefa16ATEX0037U
C25-100 Connection Kit	Baseefa16ATEX0038U
C25-100-Metal / C3/4-100-Metal / C25-100-Metal-NP / C3/4-100-Metal-NP / C25-100-Metal-SS Kits	Baseefa16ATEX0039U

The C25-100-Metal / C3/4-100-Metal / C25-100-Metal-NP / C3/4-100-Metal-NP / C25-100-Metal-SS Kits include M25 or ¾ NPT gland to Sira01ATEX1270X and core sealer to Baseefa15ATEX0194U.

A number of power levels and voltages, up to the maximum specified, are included in the range. They are identified in the following manner:

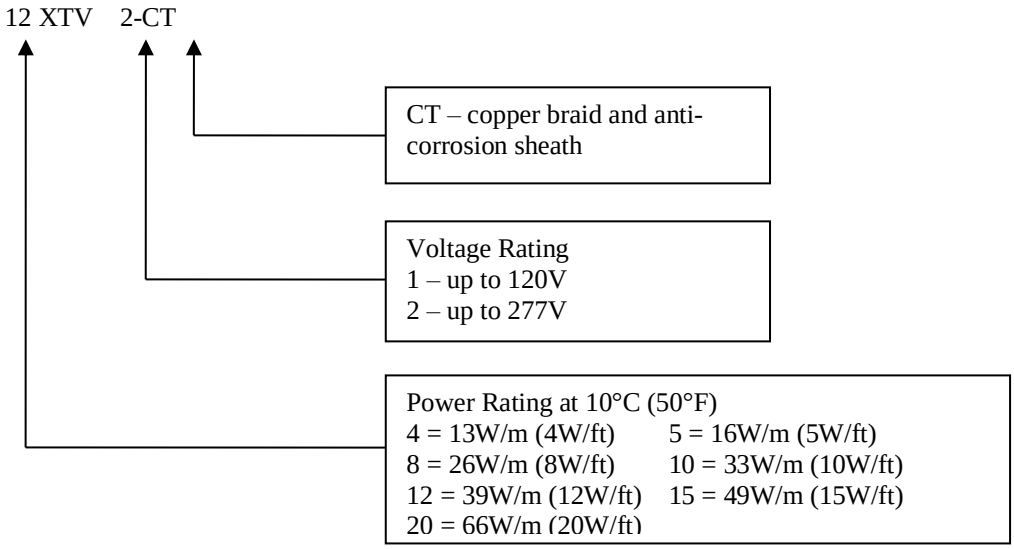

The following temperature classes are assigned:

Output (W/ft)	**Type**	**Temperature Class**
4 , 8 & 12	XTV2	T3
5 & 10	XTV1 & XTV2	T3
15	XTV1	230°C (T2)
15	XTV2	T3
20	XTV1	230°C (T2)
20	XTV2	240°C (T2)


Any of the products in the range may be considered as part of a stabilised design system. In such a system the design is based upon the use of nVent proprietary software Trace calc Pro. The algorithm defined in this software may be used in additional design software. These designs may carry temperature classes other than those described above and are marked with the actual maximum temperature and the appropriate T class in parenthesis.

The minimum bending radii for XTV trace heating cable at specific temperatures are shown in the table below:

Temperature, T (°C)	Minimum Bending Radius (mm)
-60 ≤ T < -20	51
-20 ≤ T < -10	35
-10 ≤ T < 0	25
0 ≤ T < +10	20
T ≥ +10	12

XTVR

The *XTVR*-CT heating cables are equivalent to the *XTV*-CT heating cables apart from an increased maximum continuous operating temperature (maintain temperature) of +150°C (+302°F). The *XTVR*-CT heating cables have number of power levels and voltages, up to the maximum specified, are included in the range. They are identified in the following manner:

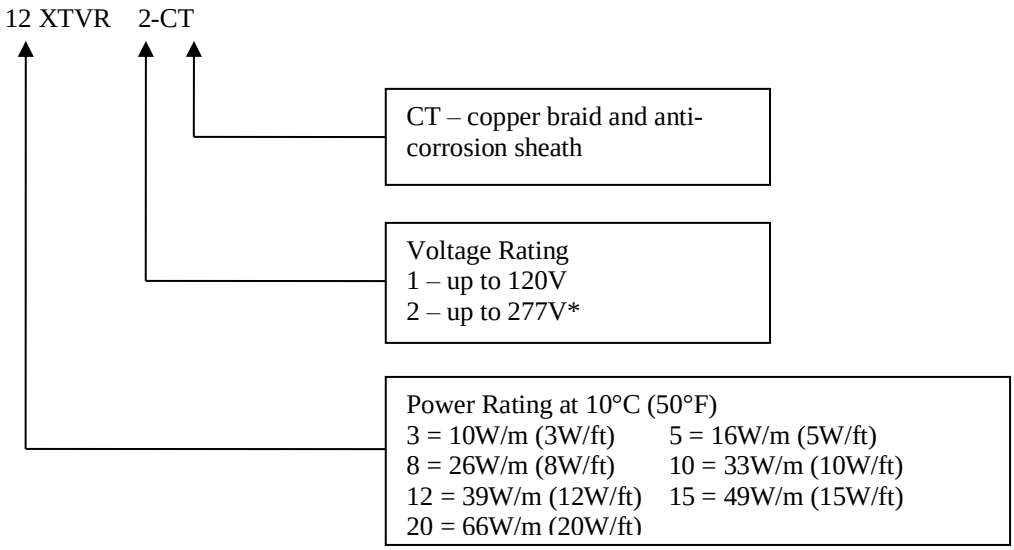

*The 20XTVR2-CT may also have an alternative maximum voltage of 240V.

The following temperature classes are assigned:

Output (W/ft)	Type	Temperature Class
3 & 8	XTVR2	180°C / T3
5	XTVR1 & XTVR2	180°C / T3
10	XTVR1 & XTVR2	200°C / T3
12	XTVR2	200°C / T3
15	XTVR2	200°C / T3
15	XTVR1	215°C / T2
20	XTVR1 & XTVR2	215°C / T2
20	XTVR2 at Max. 240V	200°C / T3

Any of the products in the range may be considered as part of a stabilised design system. In such a system the design is based upon the use of nVent proprietary software Trace calc Pro. The algorithm defined in this software may be used in additional design software. These designs may carry temperature classes other than those described above and are marked with the actual maximum temperature and the appropriate T class in parenthesis.

The minimum bending radii for the XTVR trace heating cable at specific temperatures are shown in the table below:

Temperature, T (°C)	Minimum Bending Radius (mm)
-60 ≤ T < -20	51
-20 ≤ T < -10	35
-10 ≤ T < 0	25
0 ≤ T < +10	20
T ≥ +10	12

16 Report Number

See Certificate History.

17 Specific Conditions of Use

1. The limiting temperatures for the end seals, splices and power connections are:

   260°C for the E-40 and S-40

   150°C for the C-150-E, S-150 and E-150

   151°C for the E-100, E-100-L and JBS-100

   155°C for the JBM-100 and T-100

   110°C for the C25-21 and C25-100

   180°C for the C25-100-Metal / C3/4-100-Metal

   The E-100, E-100-L, JBM-100, JBM-100-L, JBS-100, JBS-100-L and T-100 have limiting temperatures based on an internal component in these accessories. When located on a pipe or other work piece surface, a maximum pipe temperature of 250°C will not cause the limiting temperatures of 151°C or 155°C to be exceeded.

2. The end seals, splices and power connections have the following associated ambient temperatures.

   -60°C to +56°C for the E-40 and S-40

   -55°C to +56°C for the T-100, JBM-100, JBS-100, JBU-100 and E-100

   -40°C to +56°C for the JBS-100-L, JBM-100-L and JBU-100-L

   -55°C to +55°C for the C-150-E, S-150 and E-150

   -40°C to +40°C for the E-100-L

   -55°C to +110°C for the C25-21 and C25-100

   -60°C to +180°C for the C25-100-Metal / C3/4-100-Metal / C25-100-Metal-NP / C3/4-100-Metal-NP / C25-100-Metal-SS

3. The assembly of glands, splices and end terminations shall be carried out in accordance with the manufacturer's instructions.

4. The heating element supply circuit must include an electrical protection device in conformity with Clause 4.4 of EN 60079-30-1. For the JBM-100-L, JBU-100-L and JBS-100-L this shall be limited to 20A maximum when used at ambient temperatures above 40°C.

5. The minimum installation temperature is -60°C. The minimum bending radii at specific temperatures for the Type XTV units are shown in the table in the equipment description.

6. The supply to the heating unit must be terminated in a suitably certified terminal enclosure.

7. At ambient temperatures above 40°C temperature resistant power cable suitable for temperatures above 90°C and metal glands must be used.

8. When the E-100-L is used in ambient temperatures above 40°C metal nameplates must be used.

9. The installer is to carry out a dielectric strength test on Ex equipment in which the C25-21, C25-100 and C25-100-Metal / C3/4-100-Metal / C25-100-Metal-NP / C3/4-100-Metal-NP / C25-100-Metal-SS connection kit is fitted. No dielectric breakdown shall occur. (Alternatively, an insulation resistance test may be undertaken in accordance with EN 60079-30-2).

18 Essential Health and Safety Requirements

In addition to the Essential Health and Safety Requirements (EHSRs) covered by the standards listed at item 9, the following are considered relevant to this product, and conformity is demonstrated in the report:

Clause	Subject
1.2.7	LVD type requirements
1.2.8	Overloading of equipment (protection relays, etc.)
1.4.1	External effects
1.4.2	Aggressive substances, etc.

19 Drawings and Documents

New drawings submitted for this issue of certificate:

None

Current drawings which remain unaffected by this issue:

Number	Sheet	Issue	Date	Description
2000003068[iii]		A	9/12/2022	Approvals Drawing for XTVR Heating Cable
2000003069[iii]		A	9/12/2022	XTVR Heater Units (European System)
906567[i]	1 of 1	P	05/21/21	C25-21, C25-100 and C25-100-METAL-XX, C3/4-100-METAL-XX Connection Kits
907826-A[iii]	1 of 1	F	01/22/21	XTV-C Label
906576-A[iii]	1 of 1	O	1/15/21	XTV Heater Units (European System)
906794-A[ii]	1 of 1	AA	03/30/20	Generic ATEX and IECEx Print Dwg for BTV-CT, QTVR-CT, XTV-CT, KTV-CT Heating Cables
906521-A[iii]	1 of 1	H	05/10/18	XTV-CT
907825-A[iii]	1 of 1	D	09/03/20	XTV-C
906817-A[iv]	1 of 1	L	08/11/20	ATEX Stabilised Design Labels
9242869[v]	1 & 2	O	12/09/19	LABL-JBM-100-L-E
9532687[v]	1 & 2	Q	12/09/19	LABL-JBM-100-L-EP
9621473[v]	1 & 2	O	12/09/19	LABL-JBS-100-L-E
9777523[v]	1 & 2	P	12/09/19	LABL-JBS-100-L-EP
9319676[v]	1 & 2	O	12/09/19	LABL-JBU-100-L-E
9735898[v]	1 & 2	O	12/09/19	LABL-JBU-100-L-EP
908758-A[vi]	1 & 2	A	3/20/20	E-40 Heat Shrinkable End Seal Kit Cut Back Dimensions
908782-A[iv]	1 of 1	A	3/20/20	S-40 Heat Shrinkable Splice Joint Kit Cut Back Dimensions for XTV and KTV

i) This drawing is common to IECEx BAS 16.0040U, IECEx BAS 16.0041U, IECEx 16.0042U, IECEx BAS 20.0008X, IECEx BAS 20.0009X, IECEx BAS 20.0011X, IECEx BAS 20.0012X, IECEx BAS 20.0013X, IECEx BAS 20.0014X, Baseefa16ATEX0037U, Baseefa16ATEX0038U, Baseefa16ATEX0039U,

SGS20ATEX0045X, SGS20ATEX0046X, SGS20ATEX0048X, SGS20ATEX0049X, SGS20ATEX0050X, SGS20ATEX0051X and is held with IECEx BAS 16.0040U.

ii) These drawings are common to IECEx BAS 20.0011X, IECEx BAS 20.0012X, IECEx BAS 20.0013X, IECEx BAS 20.0014X, SGS20ATEX0048X, SGS20ATEX0049X, SGS20ATEX0050X, SGS20ATEX0051X and are held with IECEx BAS 20.0011X.

iii) These drawings are common to IECEx BAS 20.0012X, SGS20ATEX0049X and are held with IECEx BAS 20.0012X.

iv) These drawings are common to IECEx BAS 20.0012X, IECEx BAS 20.0014X, SGS20ATEX0049X, SGS20ATEX0051X and are held with IECEx BAS 20.0012X.

v) These drawings are common to IECEx BAS 20.0008X, IECEx BAS 20.0011X, IECEx BAS 20.0012X, IECEx BAS 20.0013X, IECEx BAS 20.0014X, SGS20ATEX0045X, SGS20ATEX0048X, SGS20ATEX0049X, SGS20ATEX0050X, SGS20ATEX0051X and are held with IECEx BAS 20.0008X.

vi) These drawings are common to IECEx BAS 20.0008X, IECEx BAS 20.0012X, IECEx BAS 20.0014X, SGS20ATEX0045X, SGS20ATEX0049X, SGS20ATEX0051X and are held with IECEx BAS 20.0008X.

20 Certificate History

Certificate No.	Date	Comments
SGS20ATEX0049X	23 October 2020	The release of the prime certificate. The associated test and assessment against the requirements of EN 60079-0:2012+A11:2013, EN IEC 60079-7:2015+A1:2018, EN 60079-18:2015+A1:2017, EN 60079-30-1:2017 and EN 60079-31:2014 is documented in Test Report No. GB/BAS/ExTR20.0030/00.
SGS20ATEX0049X Issue 1	11 February 2021	To assess the XTV range of self-regulating trace heating systems against EN IEC 60079-0:2018, introduce the low profile power connection, splice and end seal kits, types C-150-E, S-150 and E-150 afforded DEKRA20ATEX0011U, minor amendments to the product description, to change the product name to "XTV Range of Self-Regulating Trace Heating Systems" and to amend the Specific Conditions of Use. The associated test and assessment is documented in Test Report No. GB/BAS/ExTR21.0005/00.
SGS20ATEX0049X Issue 2	7 July 2021	Minor drawing updates not affecting certification. Baseefa Certification Report GB/BAS/ExTR21.0060/00 refers.
SGS20ATEX0049X Issue 3	18 January 2023	To introduce the *XTVR*-CT heating cables. SGS Baseefa Certification Report GB/BAS/ExTR22.0182/00 refers.
SGS20ATEX0049X Issue 4	8 August 2023	To increase the temperature classification for the XTVR heating cables and to introduce an alternative maximum voltage 240V for the 20XTVR2-CT heating cable. SGS Certification Report GB/SGS/ExTR23.0071/00 refers.
For drawings applicable to each issue, see original of that issue.		