
DRAWING NO. 123A90-DDL-AR-DL-10023


REV. 01

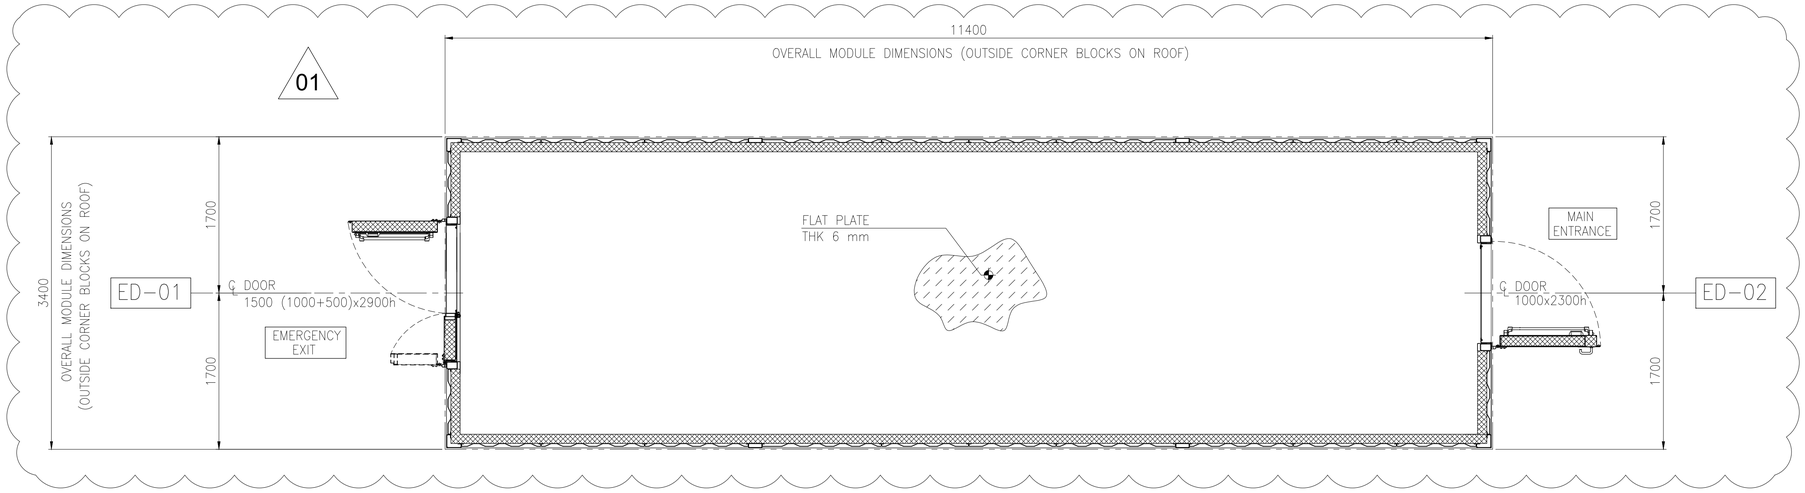


PLAN OF AC UPS FITTED WITH UPS SYSTEM EQUIPMENT ROOM B-300

DOORS MAP


THIS DRAWING IS VALID FOR DOORS MAPS/SCHEDULE ONLY

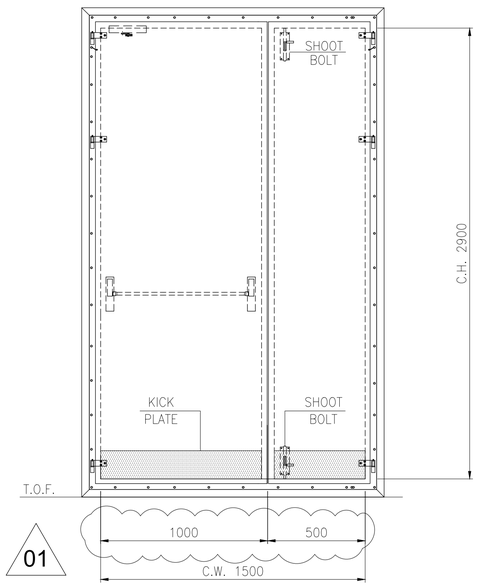

EXTERNAL
DOUBLE DOOR "A0"

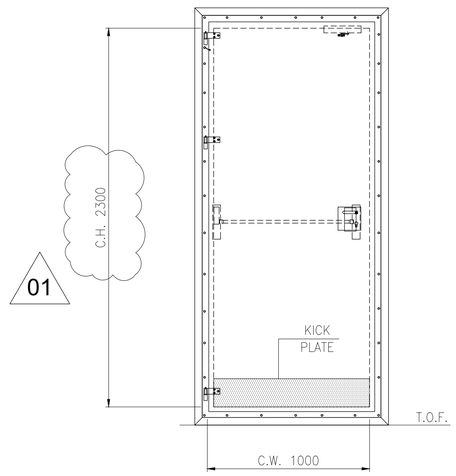

EXTERNAL
SINGLE DOOR "A0"

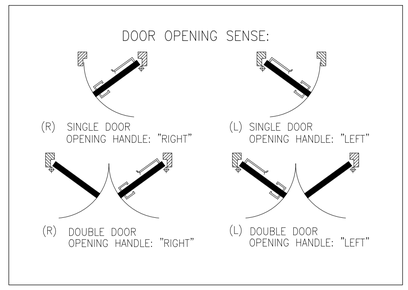

DOORS SCHEDULE HOLD 1

DOOR IDENTIFICATION NUMBER	QUATITY	FIRE CLASS	SIZE AND OPENING SENSE: CLEAR OPENING W x H (mm) 01	SINGLE DOOR	DOUBLE DOOR	LEFT	RIGTH	LOCATION	COATINGS AND COLOURS: DOOR LEAF EXTERNAL MATERIAL	DOOR LEAF EXTERNAL COLOUR RAL	DOOR LEAF INTERNAL MATERIAL	DOOR LEAF INTERNAL COLOUR RAL	FRAME MATERIAL	FRAME TO BE BOLTED	FRAME TO BE WELDED	FRAME COLOUR RAL	LOCK TYPE AND HARDWARE: THRESHOLD (MINIMUM HEIGHT)	HINGE TYPE	HANDLE TYPE EXTERNAL SIDE & ESCUTCHEON	HANDLE TYPE INTERNAL SIDE & ESCUTCHEON	PANIC BAR INTERNAL SIDE	CYLINDER LOCK	SHOOT BOLT (TO BE INTAL. ON THE SEC. WING)	FIRE RESISTANT GASKET DOOR FRAME STRUCTURE FRAME	S.S. KICK PLATE H=200mm ON BOTH SIDES OF EACH DOOR LEAF	SELF CLOSING DEVICE	LIMIT SWITCH	VARIOUS: INTERNAL OVER PRESSURE (Pa) (NORMAL OPERATION)	BLAST RESISTANCE (mbarg)	THERMAL INSULATION (W/m2/°C)	ACOUSTIC INSULATION (dbA) SOUND REDUCTION	VISION PANEL WITH S.S. FRAME 500x200 mm	HINGE NUMBER (AT LEAST)	AIR LEAKEGE MAX 10m3/h*m2 at 50 Pa	EARTHING SYSTEM CONNECTION
ED-01	1	A0	1500 (1000+500)x2900		X	X		TECHNICAL ROOM	S.S.	7035	S.S.	7035	S.S.	X		7035	X	S.S.	N.A.		S.S.	X	X	X	X	X	by other	25	N.A.	0,45	40	N.A.	3+3	X	X
ED-02	1	A0	1000 x 2200	X		X		TECHNICAL ROOM	S.S.	7035	S.S.	7035	S.S.	X		7035	X	S.S.	S.S.		S.S.	X		X	X	X	by other	25	N.A.	0,45	40	N.A.	3	X	X
										01		01				01											01				01				

NOTES

1. U.N.O. ALL DIMENSIONS ARE IN MILLIMETERS
2. IN CASE OF DOUBLE LEAF DOORS, THE DOOR ACCESSORIES ARE INTENDED TO BE INSTALLED ONLY ON THE ACTIVE LEAF
3. ALL WELDS MUST BE CONTINUOUS, SPOT WELDS ARE NOT PERMITTED

LEGEND

U.N.O.	UNLESS NOTED OTHERWISE
T.O.S.	TOP OF STEEL
T.O.P.	TOP OF PLATE
T.O.F.	TOP OF FLOOR
℄	CENTER LINE
G.S.	GALVANIZED STEEL
S.S.	STAINLEES STEEL (AISI 316L)
N.A.	NOT APPLICABLE
T.B.D.	TO BE DEFINED
T.B.C.	TO BE COMFIRMED
C.O.	CLEAR OPENING
C.W.	CLEAR WIDTH
C.H.	CLEAR HEIGHT


XX-ZZ — CONTINUOUS NUMBER
ED=EXTERNAL DOOR

HOLDS

REFERENCE

DOCUMENT TITLE	DOCUMENT NUMBER
AC UPS fitted with UPS system E.R. - Supply Specification	123A90-DDL-AR-SP-10021
AC UPS with UPS system E.R. - General Layout (plan, view, section)	123A90-DDL-AR-DL-10022
AC UPS with UPS system E.R. - Flooring and Lining Layout	123A90-DDL-AR-DL-10024
AC UPS fitted with UPS system E.R. Fire rated requirement layout (plan, section, typical detail)	123A90-DDL-AR-DL-10025
B-300 General Arrangement Drawings (by Vendor)	1724000049-AR-DA-00016
B-300 Detail Drawings (by Vendor)	1724000049-AR-DD-00020

KEY PLAN

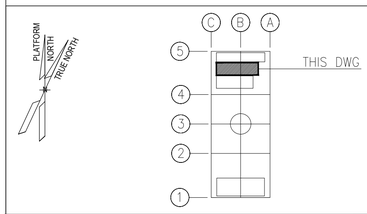

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	29/02/24	R. BO	M. GA	D. LO	ACCEPTED FOR CONSTRUCTION (AFC)
00	30/10/23	R. BO	M. GA	D. LO	ISSUE FOR REVIEW (IFR)

CROSSWIND | ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
AC UPS fitted with UPS system Equipment Room B-300 - ARCHITECTURAL
DOOR MAP and DOOR SCHEDULE

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE 1:33
DRAWN R. BOSSI | CHECKED M. GATTI | APPROVED D. LO STERZO | DATE 29/02/24
A1 | DRAWING NO. 123A90-DDL-AR-DL-10023 | SHEET 001 | REV. 01

File Name : 123A90-DDL-AR-DL-10023 Rev.01