


DRAWING NO. 123A90-DDL-AR-DL-10025

REV. 01

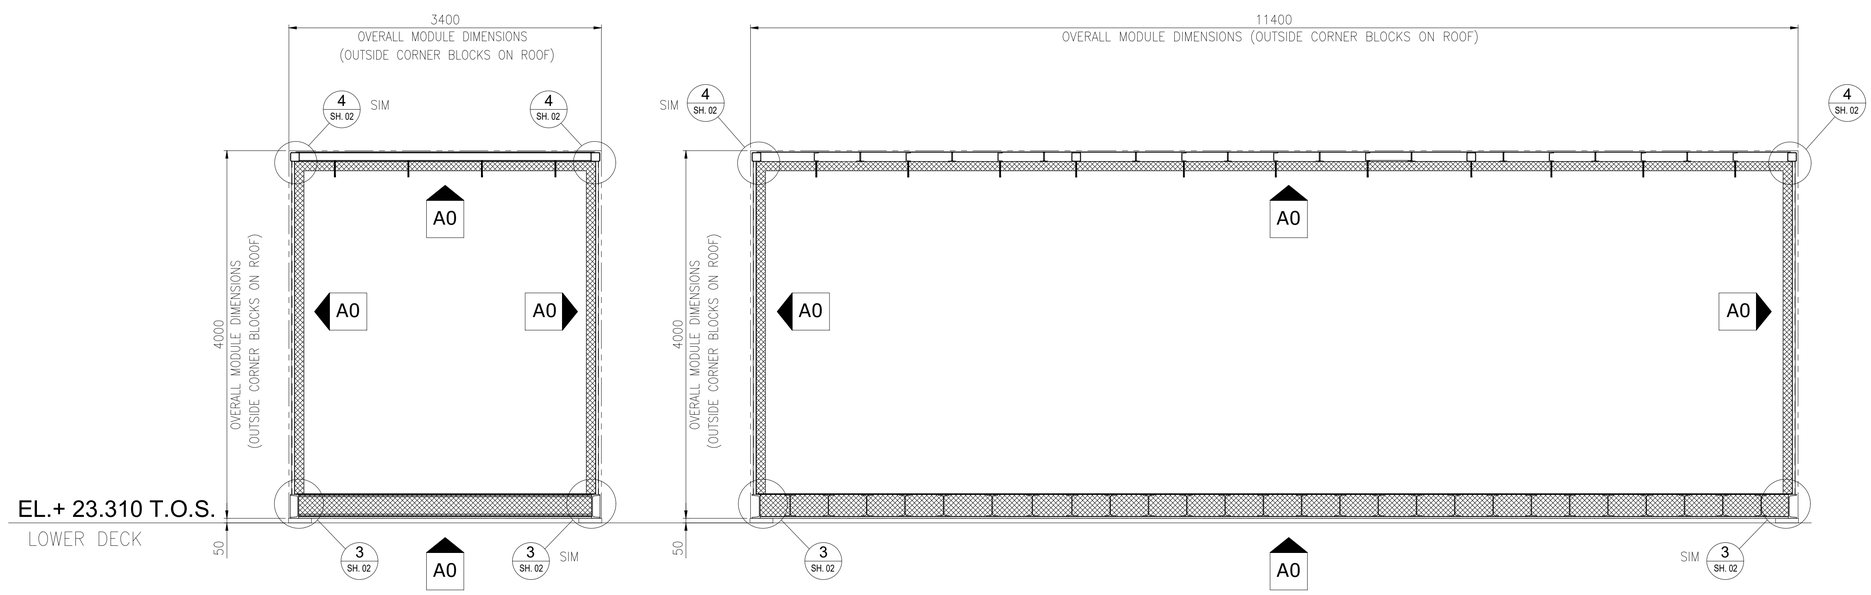



01

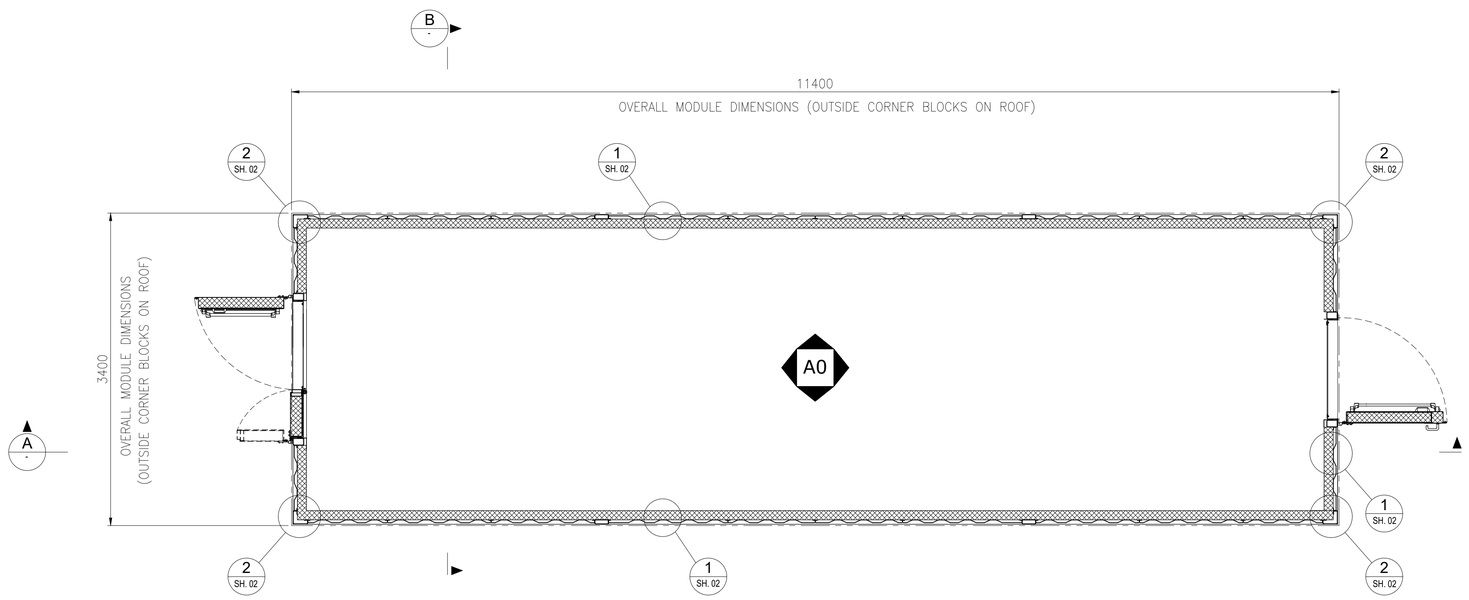


PLAN OF AC UPS FITTED WITH UPS SYSTEM EQUIPMENT ROOM B-300


FIRE SUBDIVISION and THERMAL & FIRE INSULATION

FOR DETAILS SEE DWG N. 123A90-DDL-AR-DL-10025 Sh. 02

THERMAL INSULATION REQUIREMENTS

"U" VALUE = 0,45 [W/m2.K)] — ROOF; EXPOSED BULKHEAD; FLOOR EXPOSED BELOW; INTERNAL BULKHEAD



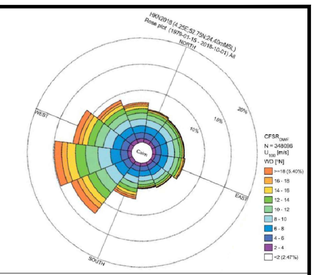

NOTES

1. U.N.O. ALL DIMENSIONS ARE IN MILLIMETERS.
2. FIRE RATING OF DOOR AND PENETRATION SHALL BE THE SAME AS WALL/DECK FIRE RATING.
3. FIRE PROOFING SHALL BE SUPPLIED WITH CERTIFICATE OF TYPICAL APPROVAL BY "IACS MEMBER".
4. FIRE PROOFING DETERMINED ACCORDING TO SOLAS CHAPTER II-2 REGULATION 9

LEGEND


U.N.O.	UNLESS NOTED OTHERWISE
T.O.S.	TOP OF STEEL
T.O.P.	TOP OF PLATE
T.O.F.	TOP OF FLOOR
℄	CENTER LINE
SIM	SIMILAR
T.B.D.	TO BE DEFINED
T.B.C.	TO BE COMFIRMED
A0	IMPACT DIRECTION OF POTENTIAL FIRE RESISTANCE CLASS

HOLDS

REFERENCE

DOCUMENT TITLE	DOCUMENT NUMBER
AC UPS fitted with UPS system E.R. - Supply Specification	123A90-DDL-AR-SP-10021
AC UPS with UPS system E.R. - General Layout (plan, view, section)	123A90-DDL-AR-DL-10022
AC UPS with UPS system E.R. - Doors Map and Schedule	123A90-DDL-AR-DL-10023
AC UPS with UPS system E.R. - Flooring and Lining Layout	123A90-DDL-AR-DL-10024
B-300 General Arrangement Drawings (by Vendor)	1724000049-AR-DA-00016
B-300 Detail Drawings (by Vendor)	1724000049-AR-DD-00020

KEY PLAN

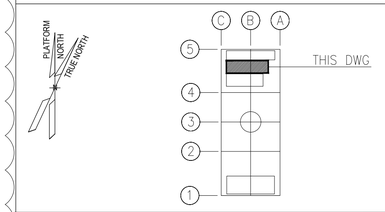

STILOG

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	29/02/24	R. BO	M. GA	D. LO	ACCEPTED FOR CONSTRUCTION (AFC)
00	30/10/23	R. BO	M. GA	D. LO	ISSUE FOR REVIEW (IFR)

CROSSWIND | ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)


AC UPS fitted with UPS system Equipment Room B-300 - ARCHITECTURAL FIRE RATED REQ. - PLAN, SECTION & TYP. DET.

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:33
DRAWN R. BOSSI	CHECKED M. GATTI	APPROVED D. LO STERZO	DATE 29/02/24
A1	DRAWING NO. 123A90-DDL-AR-DL-10025	SHEET 001	REV. 01


File Name : 123A90-DDL-AR-DL-10025 Rev.01

DRAWING NO. 123A90-DDL-AR-DL-10025

REV. 01

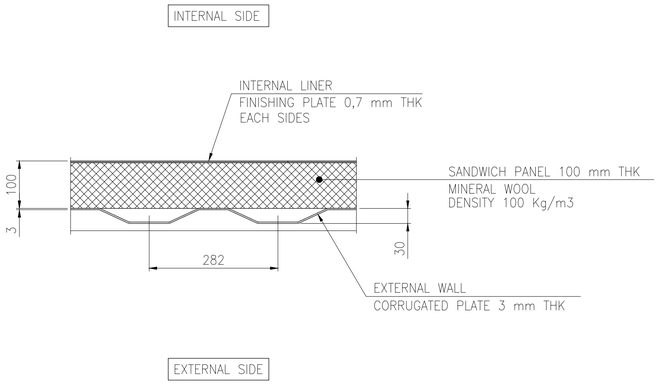


DETAIL 1 SH. 01
WALL TYPICAL

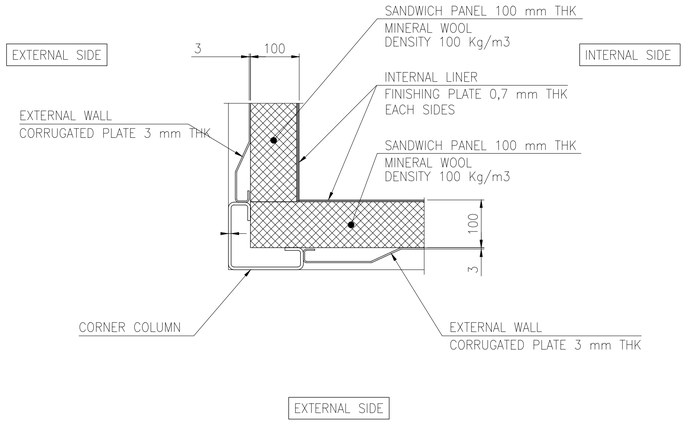


DETAIL 2 SH. 01
AT PLAN CORNERS TYPICAL

01


FOR PLAN SEE DWG N. 123A90-DDL-AR-DL-10025 Sh. 01

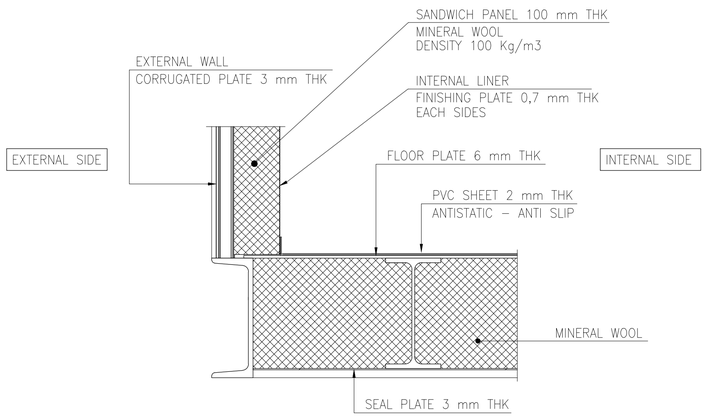

DETAIL 3 SH. 01
AT BOTTOM CORNERS TYPICAL

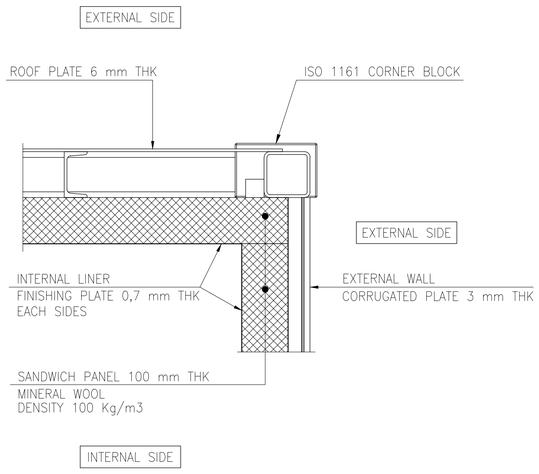

DETAIL 4 SH. 01
AT TOP CORNERS TYPICAL

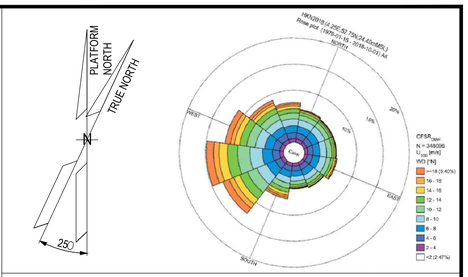

NOTES

1. U.N.O. ALL DIMENSIONS ARE IN MILLIMETERS.
2. FIRE RATING OF DOOR AND PENETRATION SHALL BE THE SAME AS WALL/DECK FIRE RATING.
3. FIRE PROOFING SHALL BE SUPPLIED WITH CERTIFICATE OF TYPICAL APPROVAL BY "IACS MEMBER".
4. FIRE PROOFING DETERMINED ACCORDING TO SOLAS CHAPTER II-2 REGULATION 9

LEGEND

U.N.O.	UNLESS NOTED OTHERWISE
T.O.S.	TOP OF STEEL
T.O.P.	TOP OF PLATE
T.O.F.	TOP OF FLOOR
℄	CENTER LINE
SIM	SIMILAR
T.B.D.	TO BE DEFINED
T.B.C.	TO BE COMFIRMED


A0 — IMPACT DIRECTION OF POTENTIAL FIRE RESISTANCE CLASS

HOLDS

REFERENCE

DOCUMENT TITLE	DOCUMENT NUMBER
AC UPS fitted with UPS system E.R. – Supply Specification	123A90-DDL-AR-SP-10021
AC UPS with UPS system E.R. – General Layout (plan, view, section)	123A90-DDL-AR-DL-10022
AC UPS with UPS system E.R. – Doors Map and Schedule	123A90-DDL-AR-DL-10023
AC UPS with UPS system E.R. – Flooring and Lining Layout	123A90-DDL-AR-DL-10024
B-300 General Arrangement Drawings (by Vendor)	1724000049-AR-DA-00016
B-300 Detail Drawings (by Vendor)	1724000049-AR-DD-00020

KEY PLAN

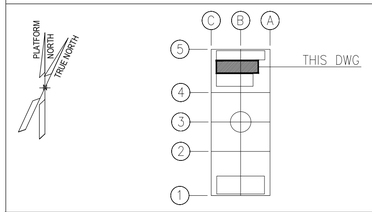

STILOG

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	29/02/24	R. BO	M. GA	D. LO	ACCEPTED FOR CONSTRUCTION (AFC)
0	30/10/23	R. BO	M. GA	D. LO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
AC UPS fitted with UPS system Equipment Room B-300 – ARCHITECTURAL
FIRE RATED REQ. – PLAN, SECTION & TYP. DET.

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE 1:5

DRAWN R. BOSSI | CHECKED M. GATTI | APPROVED D. LO STERZO | DATE 29/02/24

A1 | DRAWING NO. 123A90-DDL-AR-DL-10025 | SHEET 002 | REV. 01

File Name : 123A90-DDL-AR-DL-10025 Rev.01