
CROSSWIND

ROSETTI MARINO

PROVERLIS

PROJECT **123A90 - HOLLANDSE KUST NOORD WIND PARK**
BLPH Project

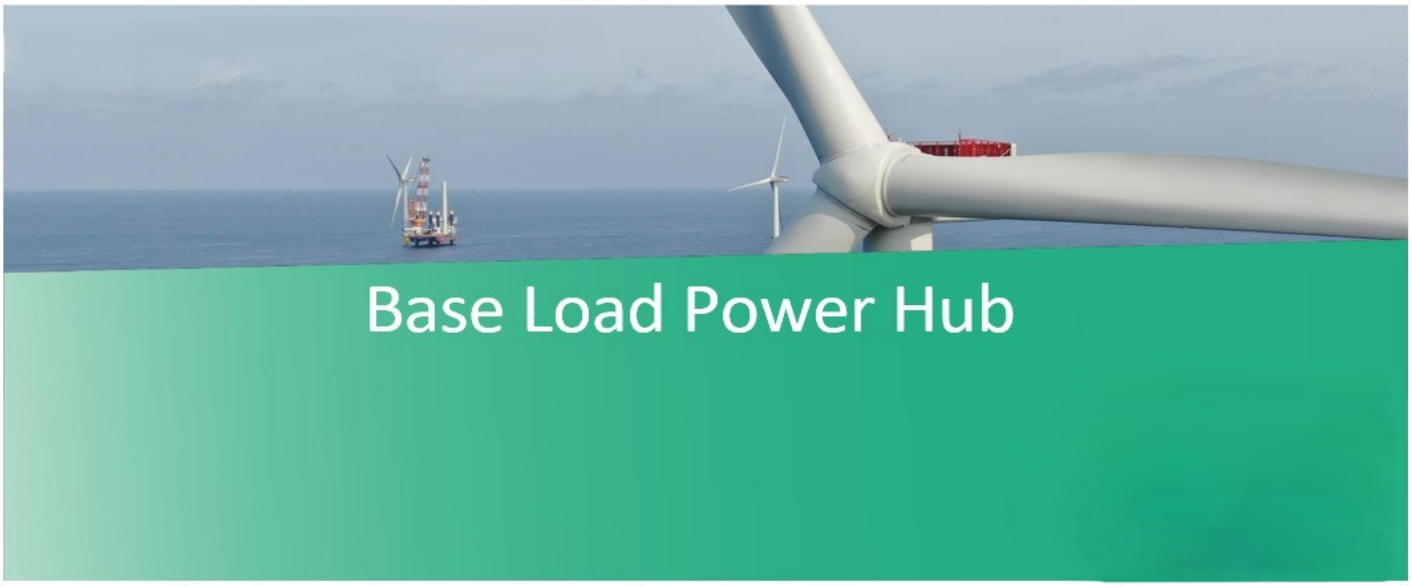

MECHANICAL COMPLETION DOSSIER (ONSHORE)

SYSTEM	25 Hydrogen Storage
SUBSYSTEM	25-07 Hydrogen Storage Vessels Header (Inlet)

CROSSWIND

123A90 - HOLLANDSE KUST NOORD WIND PARK
BLPH Project

MECHANICAL COMPLETION DOSSIER INDEX

ROSETTI MARINO

Sub System N°:	25-07	**Tick as appropriate**	ONSHORE	O
Description:	Hydrogen Storage Vessels Header (Inlet)		OFFSHORE	NA

1.	***READY FOR COMMISSIONING CERTIFICATE*** *Ready For Commissioning Certificate (RFC)*	O
2.	***CONSOLIDATED PUNCH LISTS*** *Cleared and Residual Items*	O
3.	***SYSTEM/SUB-SYSTEM LIMIT DRAWINGS*** *Mark-up drawings showing the limits of the relevant System/Sub-System*	O
4.	***MECHANICAL COMPLETION STATUS INDEX – BUILDING DISCIPLINE*** *Building Sub-System Status Index (Print out) and Check/Test sheets*	NA
5.	***MECHANICAL COMPLETION STATUS INDEX – ELECTRICAL DISCIPLINE*** *Electrical Sub-System Status Index (Print out) and Check/Test Sheets* *Hazardous Area Equipment Detailed Inspection*	O
6.	***MECHANICAL COMPLETION STATUS INDEX - INSTRUMENTAL DISCIPLINE*** *Instrumental Sub-System Status Index (Print out) and Check/Test Sheets*	O
7.	***MECHANICAL COMPLETION STATUS INDEX - MECHANICAL DISCIPLINE*** *Mechanical SubSystem Status Index (Print out) and Check/Test Sheets*	NA
8.	***MECHANICAL COMPLETION STATUS INDEX - TELECOMMUNICATION DISCIPLINE*** *Telecommunication Sub-System Status Index (Print out) and Check/Test Sheets*	NA
9.	***MECHANICAL COMPLETION STATUS INDEX - HVAC DISCIPLINE*** *HVAC Sub-System Status Index (Print out) and Check/Test Sheets*	NA
10.	***MECHANICAL COMPLETION STATUS INDEX - PIPING DISCIPLINE*** *Piping Sub-System Status Index and Check/Test Sheets*	O
11.	***MECHANICAL COMPLETION INDEX - SAFETY DISCIPLINE*** *Safety Sub-System Status Index (Print out) and Check/Test Sheets*	NA
12.	***FAT / VENDOR REPORTS*** *Fat reports issued by vendors and/or vendor reports*	NA
13.	***MECHANICAL COMPLETION CHANGES / MARK-UPS*** *A copy of the changes initiated during the Mechanical Completion process pertaining to the relevant Sub-System will be incorporated in this section*	NA

Note: Under the generic terminology “Building” are also covered the following disciplines: **Structural, Painting**

Under the generic terminology “Instrumental” is also covered the following discipline: **Fire & Gas**

ROSETTI MARINO

123A90 - HOLLANDSE KUST NOORD WIND PARK
BLPH Project

CROSSWIND

Ready For Commissioning (RFC) Certificate

COMPLETE	●	PARTIAL	

Revision:	2		Issued on:	2025-03-11	
System:	25	/	Hydrogen Storage		
SubSystem:	25-07	/	Hydrogen Storage Vessels Header (Inlet)		

1	COMPANY has, at its option and if required, reviewed the mechanical completion associated with the above-named system/sub-system of the SCOPE and observed that such functional sub-system has been brought into readiness for commencement of the associated pre-commissioning and commissioning activities, but for the outstanding punch list items, if any, attached and referred in this Certificate.
2	Issuance of this Certificate shall not release CONTRACTOR from any of his obligations, responsibilities or liabilities under the CONTRACT.
3	Mechanical Completion Status Index attached (per Discipline) Punch List report attached (Outstanding and Cleared)

PUNCH LIST	PENDING POINTS	
Note: All Category "A" Items must be cleared prior to issue a Ready For Commissioning (RFC) Certificate	A 0'	B 76

REMARKS:

	CONTRACTOR Construction Manager	**CONTRACTOR** Commissioning Manager	**COMPANY** Construction Lead (if required)	**COMPANY** Commissioning Lead (if required)
Name	Wolmer Borghi	Anthony Iveson	CPY NOT PRESENT	CPY NOT PRESENT
Date	2025-03-11	2025-03-12	2025-03-13	2025-03-13
Signature	PROVERLIS Digitaly signed by Wolmer Borghi 2025-03-11T11:23:29.551Z	PROVERLIS Digitaly signed by Anthony Iveson 2025-03-12T13:30:17.125Z	PROVERLIS Digitaly signed by CPY NOT PRESEN 2025-03-13T07:34:01.639Z	PROVERLIS Digitaly signed by CPY NOT PRESEN 2025-03-13T07:34:12.152Z

Project CROSSWIND

STATUS INDEX DETAIL

Filtered on subsystem: 25-07 & process: MC

Instrumental	25-07 Hydrogen Storage Vessels Header (Inlet)						
ITEM		TASK					
Code	Description	Location	Code	Form	Progress	Date	Certificate
25-PT-001	Pressure Transmitter - Hyrogen to Vessels Inlet Header	ONSHORE	C10000922	TJX04	100	2024-10-02	RFC 1
25-PT-002	Pressure Transmitter - Hyrogen to Vessels Inlet Header Shut-Down	ONSHORE	C10000923	TJX04	100	2024-10-11	RFC 1
25-RO-024	Restriction Orifice - Hyrogen to vessels inlet header vent system	ONSHORE	C10001208	CJX11	100	2025-02-07	RFC 1
		ONSHORE	C10001436	TJX11	100	2024-12-19	RFC 1
AV-63001/25-XV-008	Pneumatic Connection Air Supply - 25-XV-008	ONSHORE	C10001942	CJX06	100	2025-02-04	RFC 1
AV-63001/25-XV-011	Pneumatic Connection Air Supply - 25-XV-011	ONSHORE	C10001940	CJX06	100	2025-01-30	RFC 1
AV-63002/25-XV-014	Pneumatic Connection Air Supply - 25-XV-014	ONSHORE	C10001948	CJX06	100	2025-02-04	RFC 1
AV-63002/25-XV-017	Pneumatic Connection Air Supply - 25-XV-017	ONSHORE	C10001946	CJX06	100	2025-02-04	RFC 1
AV-63002/25-XV-020	Pneumatic Connection Air Supply - 25-XV-020	ONSHORE	C10001944	CJX06	100	2025-02-04	RFC 1
AV-63010/25-SDV-001	Pneumatic Connection Air Supply - 25-SDV-001	ONSHORE	C10001973	CJX06	100	2025-01-30	RFC 1
AV-63010/25-XV-004	Pneumatic Connection Air Supply - 25-XV-004	ONSHORE	C10001975	CJX06	100	2025-01-30	RFC 1
AV-63010/25-XV-024	Pneumatic Connection Air Supply - 25-XV-024	ONSHORE	C10001974	CJX06	100	2025-02-04	RFC 1
C-25-PT-001/00-JE-11003	PRESSURE TRANSMITTER / MARSHALLING PCS	ONSHORE	C10000048	CJX10	100	2025-02-08	RFC 1
C-25-PT-002/00-JE-21002	PRESSURE TRANSMITTER / MARSHALLING PCS	ONSHORE	C10000136	CJX10	100	2025-02-08	RFC 1
C-25-SDV-001/00-JE-22002	PROXIMITY SWITCH / MARSHALLING PCS	ONSHORE	C10000154	CJX10	100	2025-01-30	RFC 1
C-25-SDY-001/00-JE-23002	SOLENOID VALVE / MARSHALLING PCS	ONSHORE	C10000176	CJX10	100	2025-02-05	RFC 1
C-25-XV-004/00-JE-12004	PROXIMITY SWITCH / MARSHALLING PCS	ONSHORE	C10000084	CJX10	100	2025-01-29	RFC 1
C-25-XV-008/00-JE-12004	PROXIMITY SWITCH / MARSHALLING PCS	ONSHORE	C10000085	CJX10	100	2025-01-29	RFC 1
C-25-XV-011/00-JE-12004	PROXIMITY SWITCH / MARSHALLING PCS	ONSHORE	C10000086	CJX10	100	2025-01-29	RFC 1
C-25-XV-014/00-JE-12004	PROXIMITY SWITCH / MARSHALLING PCS	ONSHORE	C10000087	CJX10	100	2025-01-29	RFC 1
C-25-XV-017/00-JE-12004	PROXIMITY SWITCH / MARSHALLING PCS	ONSHORE	C10000088	CJX10	100	2025-02-05	RFC 1
C-25-XV-020/00-JE-12004	PROXIMITY SWITCH / MARSHALLING PCS	ONSHORE	C10000089	CJX10	100	2025-01-29	RFC 1
C-25-XV-024/00-JE-12005	PROXIMITY SWITCH / MARSHALLING PCS	ONSHORE	C10000102	CJX10	100	2025-01-30	RFC 1
C-25-XY-004/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	ONSHORE	C10000118	CJX10	100	2025-01-29	RFC 1
C-25-XY-008/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	ONSHORE	C10000119	CJX10	100	2025-01-29	RFC 1
C-25-XY-011/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	ONSHORE	C10000120	CJX10	100	2025-02-05	RFC 1
C-25-XY-014/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	ONSHORE	C10000121	CJX10	100	2025-01-29	RFC 1
C-25-XY-017/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	ONSHORE	C10000122	CJX10	100	2025-01-29	RFC 1
C-25-XY-020/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	ONSHORE	C10000123	CJX10	100	2025-01-29	RFC 1

Project CROSSWIND

STATUS INDEX DETAIL

Filtered on subsystem: 25-07 & process: MC

Instrumental	25-07 Hydrogen Storage Vessels Header (Inlet)						
ITEM		TASK					
Code	Description	Location	Code	Form	Progress	Date	Certificate
C-25-XY-024/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	ONSHORE	C10000124	CJX10	100	2025-01-30	RFC 1

Project CROSSWIND

STATUS INDEX DETAIL

Filtered on subsystem: 25-07 & process: MC

Piping	25-07 Hydrogen Storage Vessels Header (Inlet)						
ITEM		TASK					
Code	Description	Location	Code	Form	Progress	Date	Certificate
005-1-J1	Joint 005-1-J1	ONSHORE	C10004321	TMX27	100	2025-01-23	RFC 1
005-1-J2	Joint 005-1-J2	ONSHORE	C10004322	TMX27	100	2025-01-23	RFC 1
005-1-J3	Joint 005-1-J3	ONSHORE	C10004323	TMX27	100	2025-01-23	RFC 1
005-1-J4	Joint 005-1-J4	ONSHORE	C10004324	TMX27	100	2025-01-23	RFC 1
005-2-J5	Joint 005-2-J5	ONSHORE	C10004325	TMX27	100	2025-01-23	RFC 1
005-2-J6	Joint 005-2-J6	ONSHORE	C10004326	TMX27	100	2025-01-23	RFC 1
005-2-J7	Joint 005-2-J7	ONSHORE	C10004327	TMX27	100	2025-02-03	RFC 1
005-2-J8	Joint 005-2-J8	ONSHORE	C10004328	TMX27	100	2025-02-03	RFC 1
009-1-J1	Joint 009-1-J1	ONSHORE	C10003836	TMX27	100	2025-01-24	RFC 1
009-1-J2	Joint 009-1-J2	ONSHORE	C10003837	TMX27	100	2025-01-24	RFC 1
009-1-J3	Joint 009-1-J3	ONSHORE	C10003838	TMX27	100	2025-01-24	RFC 1
010-1-J1	Joint 010-1-J1	ONSHORE	C10003841	TMX27	100	2025-01-24	RFC 1
010-1-J2	Joint 010-1-J2	ONSHORE	C10003842	TMX27	100	2025-01-24	RFC 1
010-1-J3	Joint 010-1-J3	ONSHORE	C10003843	TMX27	100	2025-01-24	RFC 1
011-1-J1	Joint 011-1-J1	ONSHORE	C10003846	TMX27	100	2025-01-27	RFC 1
011-1-J2	Joint 011-1-J2	ONSHORE	C10003847	TMX27	100	2025-01-27	RFC 1
011-1-J3	Joint 011-1-J3	ONSHORE	C10003848	TMX27	100	2025-01-27	RFC 1
012-1-J1	Joint 012-1-J1	ONSHORE	C10003851	TMX27	100	2025-01-27	RFC 1
012-1-J2	Joint 012-1-J2	ONSHORE	C10003852	TMX27	100	2025-01-27	RFC 1
012-1-J3	Joint 012-1-J3	ONSHORE	C10003853	TMX27	100	2025-01-27	RFC 1
013-1-J1	Joint 013-1-J1	ONSHORE	C10003856	TMX27	100	2025-01-24	RFC 1
013-1-J2	Joint 013-1-J2	ONSHORE	C10003857	TMX27	100	2025-01-24	RFC 1
013-1-J3	Joint 013-1-J3	ONSHORE	C10003858	TMX27	100	2025-01-24	RFC 1
014-1-J1	Joint 014-1-J1	ONSHORE	C10003861	TMX27	100	2025-01-24	RFC 1
014-1-J2	Joint 014-1-J2	ONSHORE	C10003862	TMX27	100	2025-01-27	RFC 1
014-1-J3	Joint 014-1-J3	ONSHORE	C10003863	TMX27	100	2025-01-24	RFC 1
056-1-J1	Joint 056-1-J1	ONSHORE	C10003910	TMX27	100	2025-01-27	RFC 1
056-1-J2	Joint 056-1-J2	ONSHORE	C10003911	TMX27	100	2025-01-27	RFC 1
056-1-J3	Joint 056-1-J3	ONSHORE	C10003912	TMX27	100	2025-01-27	RFC 1

Project CROSSWIND

STATUS INDEX DETAIL

Filtered on subsystem: 25-07 & process: MC

Piping	25-07 Hydrogen Storage Vessels Header (Inlet)						
ITEM		TASK					
Code	Description	Location	Code	Form	Progress	Date	Certificate
056-1-J4	Joint 056-1-J4	ONSHORE	C10003913	TMX27	100	2025-01-27	RFC 1
056-1-J5	Joint 056-1-J5	ONSHORE	C10003914	TMX27	100	2025-01-29	RFC 1
056-1-J6	Joint 056-1-J6	ONSHORE	C10003915	TMX27	100	2025-01-30	RFC 1
056-1-J7	Joint 056-1-J7	ONSHORE	C10003916	TMX27	100	2025-01-30	RFC 1
25-07-TP-007	Test Pack 25-07-TP-007	ONSHORE	C10003277	CLX02A	100	2025-01-21	RFC 2
		ONSHORE	C10003278	CLX02B	100	2025-01-30	RFC 2
		ONSHORE	C10003279	CXX02	100	2025-02-05	RFC 2
		ONSHORE	C10003280	TMX03	100	2025-01-21	RFC 2
		ONSHORE	C10003281	TMX05	100	2025-01-21	RFC 2
		ONSHORE	C10003284	TPLX05	100	2025-01-21	RFC 2
25-07-TP-068	Test Pack 25-07-TP-068	ONSHORE	C10004793	CLX02A	100	2025-02-06	RFC 2
		ONSHORE	C10004794	CLX02B	100	2025-02-25	RFC 2
		ONSHORE	C10004795	CXX02	100	2025-02-27	RFC 2
		ONSHORE	C10004796	TMX03	100	2025-02-03	RFC 2
		ONSHORE	C10004797	TMX05	100	2025-02-03	RFC 2
		ONSHORE	C10004799	TPLX05	100	2025-02-03	RFC 2

Project CROSSWIND

STATUS INDEX DETAIL

Filtered on subsystem: 25-07 & process: MC

ATEX	25-07 Hydrogen Storage Vessels Header (Inlet)						
ITEM		TASK					
Code	Description	Location	Code	Form	Progress	Date	Certificate
25-PCV-001	Air Set Filter - Hyrogen to Vessels Inlet Header Shut-Down	ONSHORE	C10001754	CJX01	100	2025-01-31	RFC 1
25-PCV-004	Air Set Filter - Vessel V-25001A Hydrogen Inlet	ONSHORE	C10001755	CJX01	100	2025-01-30	RFC 1
25-PCV-008	Air Set Filter - Vessel V-25001B Hydrogen Inlet	ONSHORE	C10001757	CJX01	100	2025-01-30	RFC 1
25-PCV-011	Air Set Filter - Vessel V-25001C Hydrogen Inlet	ONSHORE	C10001759	CJX01	100	2025-01-30	RFC 1
25-PCV-014	Air Set Filter - Vessel V-25001D Hydrogen Inlet	ONSHORE	C10001761	CJX01	100	2025-01-30	RFC 1
25-PCV-017	Air Set Filter - Vessel V-25001E Hydrogen Inlet	ONSHORE	C10001763	CJX01	100	2025-01-30	RFC 1
25-PCV-020	Air Set Filter - Vessel V-25001F Hydrogen Inlet	ONSHORE	C10001765	CJX01	100	2025-01-30	RFC 1
25-PCV-024	Air Set Filter - Nitrogen to Distribution Header Shut-Down	ONSHORE	C10002040	CJX01	100	2025-01-31	RFC 1
25-PG -004	Air Set Pressure Gauge Filter - Vessel V-25001A Hydrogen Inlet	ONSHORE	C10004819	CJX01	100	2025-02-01	RFC 1
25-PG -008	Air Set Pressure Gauge Filter - Vessel V-25001B Hydrogen Inlet	ONSHORE	C10004821	CJX01	100	2025-02-01	RFC 1
25-PG -011	Air Set Pressure Gauge Filter - Vessel V-25001C Hydrogen Inlet	ONSHORE	C10004823	CJX01	100	2025-02-01	RFC 1
25-PG -014	Air Set Pressure Gauge Filter - Vessel V-25001D Hydrogen Inlet	ONSHORE	C10004825	CJX01	100	2025-02-01	RFC 1
25-PG -017	Air Set Pressure Gauge Filter - Vessel V-25001E Hydrogen Inlet	ONSHORE	C10004827	CJX01	100	2025-02-01	RFC 1
25-PG -020	Air Set Pressure Gauge Filter - Vessel V-25001F Hydrogen Inlet	ONSHORE	C10004829	CJX01	100	2025-02-01	RFC 1
25-PG -024	Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Vent System	ONSHORE	C10004831	CJX01	100	2025-02-01	RFC 1
25-PG-001	Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Shut-Down	ONSHORE	C10004846	CJX01	100	2025-02-01	RFC 1
25-PSV-001	Safety Valve - Hyrogen to Vessels Inlet Header Shut-Down	ONSHORE	C10004849	CJX01	100	2025-02-03	RFC 1
25-PSV-004	Safety Valve - Vessel V-25001A Hydrogen Inlet	ONSHORE	C10004833	CJX01	100	2025-02-03	RFC 1
25-PSV-008	Safety Valve - Vessel V-25001B Hydrogen Inlet	ONSHORE	C10004835	CJX01	100	2025-02-03	RFC 1
25-PSV-011	Safety Valve - Vessel V-25001C Hydrogen Inlet	ONSHORE	C10004837	CJX01	100	2025-02-03	RFC 1
25-PSV-014	Safety Valve - Vessel V-25001D Hydrogen Inlet	ONSHORE	C10004839	CJX01	100	2025-02-03	RFC 1
25-PSV-017	Safety Valve - Vessel V-25001E Hydrogen Inlet	ONSHORE	C10004841	CJX01	100	2025-02-03	RFC 1
25-PSV-020	Safety Valve - Vessel V-25001F Hydrogen Inlet	ONSHORE	C10004843	CJX01	100	2025-02-03	RFC 1
25-PSV-024	Safety Valve - Hyrogen to Vessels Inlet Header Vent System	ONSHORE	C10004845	CJX01	100	2025-02-03	RFC 1
25-PT-001	Pressure Transmitter - Hyrogen to Vessels Inlet Header	ONSHORE	C10001482	CJX01	100	2025-02-08	RFC 1
25-PT-002	Pressure Transmitter - Hyrogen to Vessels Inlet Header Shut-Down	ONSHORE	C10001483	CJX01	100	2025-02-08	RFC 1
25-SDV-001	On/Off Valve - Hyrogen to Vessels Inlet Header Shut-Down	ONSHORE	C10001588	CJX01	100	2025-01-31	RFC 1
25-SDY-001	Solenoid Valve - Hyrogen to Vessels Inlet Header Shut-Down	ONSHORE	C10001712	CJX01	100	2025-02-05	RFC 1
25-XV-004	On-Off Actuated Ball Valve - Vessel V-25001A Hydrogen Inlet	ONSHORE	C10001590	CJX01	100	2025-01-30	RFC 1

Project CROSSWIND

STATUS INDEX DETAIL

Filtered on subsystem: 25-07 & process: MC

ATEX	25-07 Hydrogen Storage Vessels Header (Inlet)						
ITEM		TASK					
Code	Description	Location	Code	Form	Progress	Date	Certificate
25-XV-008	On-Off Actuated Ball Valve - Vessel V-25001B Hydrogen Inlet	ONSHORE	C10001592	CJX01	100	2025-01-30	RFC 1
25-XV-011	On/Off Valve - Vessel V-25001C Hydrogen Inlet	ONSHORE	C10001594	CJX01	100	2025-01-30	RFC 1
25-XV-014	On/Off Valve - Vessel V-25001D Hydrogen Inlet	ONSHORE	C10001596	CJX01	100	2025-01-30	RFC 1
25-XV-017	On/Off Valve - Vessel V-25001E Hydrogen Inlet	ONSHORE	C10001598	CJX01	100	2025-01-30	RFC 1
25-XV-020	On/Off Valve - Vessel V-25001F Hydrogen Inlet	ONSHORE	C10001600	CJX01	100	2025-01-30	RFC 1
25-XV-024	On/Off Valve - Hyrogen to Vessels Inlet Header Vent System	ONSHORE	C10001602	CJX01	100	2025-01-31	RFC 1
25-XY-004	Solenoid Valve - Vessel V-25001A Hydrogen Inlet	ONSHORE	C10001714	CJX01	100	2025-01-29	RFC 1
25-XY-008	Solenoid Valve - Vessel V-25001B Hydrogen Inlet	ONSHORE	C10001716	CJX01	100	2025-01-29	RFC 1
25-XY-011	Solenoid Valve - Vessel V-25001C Hydrogen Inlet	ONSHORE	C10001718	CJX01	100	2025-02-05	RFC 1
25-XY-014	Solenoid Valve - Vessel V-25001D Hydrogen Inlet	ONSHORE	C10001720	CJX01	100	2025-01-29	RFC 1
25-XY-017	Solenoid Valve - Vessel V-25001E Hydrogen Inlet	ONSHORE	C10001722	CJX01	100	2025-01-29	RFC 1
25-XY-020	Solenoid Valve - Vessel V-25001F Hydrogen Inlet	ONSHORE	C10001724	CJX01	100	2025-01-29	RFC 1
25-XY-024	Solenoid Valve - Hyrogen to Vessels Inlet Header Vent System	ONSHORE	C10002038	CJX01	100	2025-01-31	RFC 1
25-ZSHL-001	Limit Switch Box - Hyrogen to Vessels Inlet Header Shut-Down	ONSHORE	C10001726	CJX01	100	2025-01-30	RFC 1
25-ZSHL-004	Limit Switch Box - Vessel V-25001A Hydrogen Inlet	ONSHORE	C10001727	CJX01	100	2025-01-29	RFC 1
25-ZSHL-008	Limit Switch Box - Vessel V-25001B Hydrogen Inlet	ONSHORE	C10001729	CJX01	100	2025-01-29	RFC 1
25-ZSHL-011	Limit Switch Box - Vessel V-25001C Hydrogen Inlet	ONSHORE	C10001731	CJX01	100	2025-01-29	RFC 1
25-ZSHL-014	Limit Switch Box - Vessel V-25001D Hydrogen Inlet	ONSHORE	C10001733	CJX01	100	2025-01-29	RFC 1
25-ZSHL-017	Limit Switch Box - Vessel V-25001E Hydrogen Inlet	ONSHORE	C10001735	CJX01	100	2025-02-05	RFC 1
25-ZSHL-020	Limit Switch Box - Vessel V-25001F Hydrogen Inlet	ONSHORE	C10001737	CJX01	100	2025-01-29	RFC 1
25-ZSHL-024	Limit Switch Box - Hyrogen to Vessels Inlet Header Vent System	ONSHORE	C10002039	CJX01	100	2025-01-30	RFC 1

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

Piping

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003312	A	25-07-TP-007 C10003278	BLPH-MV-014 not istalled	.		AMancini 2025-01-30	2025-02-07	LNovaga 2025-02-07	2025-02-07
C30003313	A	25-07-TP-007 C10003278	BLPH-MV-013 not installed	.		AMancini 2025-01-30	2025-02-07	LNovaga 2025-02-07	2025-02-07
C30003112	B	25-07-TP-007 C10003277	For all supports S-211 the gap, the isolation rubber, the PTFE and the nuts shall be checked during the reinstatement phase.	.		KAlbonetti 2025-01-21	2025-02-07	LNovaga 2025-02-07	2025-02-07
C30003113	B	25-07-TP-007 C10003277	Point n.4 of the ITR has not been checked due the fact that all valves have been removed all the alignment to terminal points are uncheckable.	.		KAlbonetti 2025-01-21	2025-02-07	LNovaga 2025-02-07	2025-02-07
C30003314	B	25-07-TP-007 C10003278	Support PS-03071.1 not installed	.		AMancini 2025-01-30	2025-02-11	LNovaga 2025-02-11	2025-02-11
C30003523	B	25-07-TP-007 C10003279	General touch up do to, especially near the supports of the piping line.	.		KAlbonetti 2025-02-05			
C30003528	B	25-07-TP-007 C10003279	Color coding and fluid direction are missing.	.		KAlbonetti 2025-02-05			
C30003579	B	25-07-TP-068 C10004793	All support and standard will be check during reinstatement phase	.		LNovaga 2025-02-06	2025-02-25	KAlbonetti 2025-02-25	2025-02-25
C30004108	B	25-07-TP-068 C10004794	The isometric is different from the field, produce a mark up. Support PS-02136.1 is missing. There is a S-211 between EW7 and EW8, distance from	.		LNovaga 2025-02-25			

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage
SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

Piping

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30004109	B	25-07-TP-068 C10004794	The hole on the ptfe on new support (see PL C30004108) is larger than the diameter of the washer.	.		LNovaga 2025-02-25	2025-02-25	KAlbonetti 2025-02-25	2025-02-25
C30004166	B	25-07-TP-068 C10004795	Color coding and fluid direction are missing.	.		KAlbonetti 2025-02-27			

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage
SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003280	B	C-25-XY-011/00 -JE-13002 C10000120	The bending radius is not with in the specified limits , is not fix with AISI cable ties.	.		APolo 2025-01-29	2025-02-24	AAndreani 2025-02-24	2025-02-24
C30003298	B	C-25-XY-017/00 -JE-13002 C10000122	The cable need a support near the valve 25-XY-017. See attached photo.	.		Gtangianu 2025-01-29	2025-02-08	AAndreani 2025-02-08	2025-02-08
C30003310	B	C-25-XV-024/00 -JE-12005 C10000102	The cable is not support .	.		APolo 2025-01-30	2025-03-05	JKrizanic 2025-03-05	2025-03-05
C30003311	B	C-25-XY-024/00 -JE-13002 C10000124	The cable is not support .	.		APolo 2025-01-30	2025-03-05	JKrizanic 2025-03-05	2025-03-05
C30003565	B	C-25-XV-017/00 -JE-12004 C10000088	The cable is not support .	.		APolo 2025-02-05	2025-02-13	AAndreani 2025-02-13	2025-02-13
C30003567	B	C-25-SDY-001/0 0-JE-23002 C10000176	the cable installed is temporary. To be replaced	.		APolo 2025-02-05			
C30003602	B	C-25-PT-002/00 -JE-21002 C10000136	Missing the "side slot" on the cable tray (for cable passage) so that the cable is not in crash with the piping.	.		APolo 2025-02-08	2025-02-22	JKrizanic 2025-02-22	2025-02-22
C30003606	B	C-25-PT-001/00 -JE-11003 C10000048	Missing the "side slot" on the cable tray (for cable passage) so that the cable is not in crash with the piping.	.		APolo 2025-02-08	2025-03-01	AAndreani 2025-03-01	2025-03-01
C30003607	B	C-25-PT-001/00 -JE-11003 C10000048	Missing cable tag SS , near JB 00-JE-11003	.		APolo 2025-02-08	2025-02-21	APolo 2025-02-21	2025-02-21

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage
SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003287	B	25-XY-004 C10001714	Missing tag SS , on Solenoid Valve.	.		APolo 2025-01-29	2025-02-24	AAndreani 2025-02-24	2025-02-24
C30003288	B	25-XY-008 C10001716	Missing tag SS , on Solenoid Valve.	.		APolo 2025-01-29	2025-02-24	AAndreani 2025-02-24	2025-02-24
C30003293	B	25-ZSHL-008 C10001729	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-01-29			
C30003294	B	25-ZSHL-014 C10001733	document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field. See attached photo.	.		Gtangianu 2025-01-29			
C30003295	B	25-ZSHL-011 C10001731	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-01-29			
C30003297	B	25-ZSHL-004 C10001727	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-01-29			
C30003299	B	25-ZSHL-020 C10001737	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field . See attached photo.	.		Gtangianu 2025-01-29			
C30003300	B	25-XY-014 C10001720	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field.See attached photo.	.		Gtangianu 2025-01-29			
C30003301	B	25-XY-017 C10001722	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field . See attached photo.	.		Gtangianu 2025-01-29			

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage
SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003302	B	25-XY-020 C10001724	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field. See attached photo.	.		Gtangianu 2025-01-29			
C30003305	B	25-XY-014 C10001720	Missing tag plate SS on the solenoid valve.(25-XY-014).	.		Gtangianu 2025-01-29	2025-02-21	AAndreani 2025-02-21	2025-02-21
C30003306	B	25-XY-017 C10001722	Missing tag plate SS on the solenoid valve.(25-XY-017).	.		Gtangianu 2025-01-29	2025-02-21	AAndreani 2025-02-21	2025-02-21
C30003307	B	25-XY-020 C10001724	Missing tag plate SS on the solenoid valve.(25-XY-020).	.		Gtangianu 2025-01-29	2025-02-21	AAndreani 2025-02-21	2025-02-21
C30003324	B	25-ZSHL-024 C10002039	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-01-30			
C30003325	B	25-XV-004 C10001590	Scratch on painting, general touch-up to be performed	.		Lmussi 2025-01-30			
C30003326	B	25-XV-004 C10001590	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufactuer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-30			
C30003327	B	25-XV-004 C10001590	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-30	2025-03-06	LNovaga 2025-03-06	2025-03-06
C30003328	B	25-XV-008 C10001592	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-30			

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage
SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003329	B	25-XV-008 C10001592	Scratch on painting, general touch-up to be performed	.		Lmussi 2025-01-30			
C30003330	B	25-XV-011 C10001594	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-30			
C30003331	B	25-XV-011 C10001594	Scratch on painting, general touch-up to be performed	.		Lmussi 2025-01-30			
C30003332	B	25-XV-014 C10001596	Scratch on painting, general touch-up to be performed	.		Lmussi 2025-01-30			
C30003333	B	25-XV-014 C10001596	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-30			
C30003334	B	25-XV-017 C10001598	Scratch on painting, general touch-up to be performed	.		Lmussi 2025-01-30			
C30003335	B	25-XV-017 C10001598	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-30			
C30003336	B	25-XV-020 C10001600	Scratch on painting, general touch-up to be performed	.		Lmussi 2025-01-30			
C30003337	B	25-XV-020 C10001600	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-30			

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage
SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003338	B	25-ZSHL-001 C10001726	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-01-30			
C30003365	B	25-PCV-004 C10001755	On ATEX register Model, SN, Atex data are missing	.		Lmussi 2025-01-30			
C30003367	B	25-PCV-004 C10001755	Equipment tag plate is missing	.		Lmussi 2025-01-30	2025-03-01	Lmussi 2025-03-01	2025-03-01
C30003371	B	25-PCV-004 C10001755	ATEX D.o.C. by Manufacturer is missing	.		Lmussi 2025-01-30	2025-02-05	Lmussi 2025-02-05	2025-02-05
C30003372	B	25-PCV-008 C10001757	On ATEX register equipment model, SN and Atex execution are missing	.		Lmussi 2025-01-30			
C30003375	B	25-PCV-008 C10001757	ATEX D.o.C. by Manufacturer is missing	.		Lmussi 2025-01-30	2025-02-05	Lmussi 2025-02-05	2025-02-05
C30003377	B	25-PCV-008 C10001757	Equipment data plate is missing	.		Lmussi 2025-01-30	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003378	B	25-PCV-011 C10001759	On ATEX register equipment model, SN and Atex execution are missing	.		Lmussi 2025-01-30			
C30003379	B	25-PCV-011 C10001759	ATEX D.o.C. by Manufacturer is missing	.		Lmussi 2025-01-30	2025-02-05	Lmussi 2025-02-05	2025-02-05

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage
SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003380	B	25-PCV-011 C10001759	Equipment data plate is missing	.		Lmussi 2025-01-30	2025-03-01	Lmussi 2025-03-01	2025-03-01
C30003381	B	25-PCV-014 C10001761	On ATEX register equipment model, SN and Atex execution are missing	.		Lmussi 2025-01-30			
C30003382	B	25-PCV-014 C10001761	ATEX D.o.C. by Manufacturer is missing	.		Lmussi 2025-01-30	2025-02-05	Lmussi 2025-02-05	2025-02-05
C30003383	B	25-PCV-014 C10001761	Equipment data plate is missing	.		Lmussi 2025-01-30	2025-03-01	Lmussi 2025-03-01	2025-03-01
C30003385	B	25-PCV-017 C10001763	On ATEX register equipment model, SN and Atex execution are missing	.		Lmussi 2025-01-30			
C30003387	B	25-PCV-017 C10001763	ATEX D.o.C. by Manufacturer is missing	.		Lmussi 2025-01-30	2025-02-05	Lmussi 2025-02-05	2025-02-05
C30003389	B	25-PCV-017 C10001763	Equipment data plate is missing	.		Lmussi 2025-01-30	2025-03-01	Lmussi 2025-03-01	2025-03-01
C30003393	B	25-PCV-020 C10001765	On ATEX register equipment model, SN and Atex execution are missing	.		Lmussi 2025-01-30			
C30003394	B	25-PCV-020 C10001765	ATEX D.o.C. by Manufacturer is missing	.		Lmussi 2025-01-30	2025-02-05	Lmussi 2025-02-05	2025-02-05

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage
SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003395	B	25-PCV-020 C10001765	Equipment data plate is missing	.		Lmussi 2025-01-30	2025-03-01	Lmussi 2025-03-01	2025-03-01
C30003396	B	25-PCV-004 C10001755	On ATEX register equipment model, SN and Atex execution are missing	.		Lmussi 2025-01-30	2025-03-06	LNovaga 2025-03-06	2025-03-06
C30003407	B	25-XV-024 C10001602	Scratch on painting, general touch-up to be performed	.		Lmussi 2025-01-31			
C30003408	B	25-XV-024 C10001602	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-31			
C30003409	B	25-PCV-024 C10002040	On ATEX register Model, SN, Atex data are missing	.		Lmussi 2025-01-31			
C30003410	B	25-PCV-024 C10002040	ATEX D.o.C. by Manufacturer is missing	.		Lmussi 2025-01-31	2025-02-05	Lmussi 2025-02-05	2025-02-05
C30003411	B	25-PCV-024 C10002040	Equipment tag plate is missing	.		Lmussi 2025-01-31	2025-03-01	Lmussi 2025-03-01	2025-03-01
C30003412	B	25-SDV-001 C10001588	Scratch on painting, general touch-up to be performed	.		Lmussi 2025-01-31			
C30003413	B	25-SDV-001 C10001588	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 7) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-31			

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage
SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003414	B	25-XY-024 C10002038	Missing tag SS , on Solenoid Valve.	.		APolo 2025-01-31	2025-02-24	AAndreani 2025-02-24	2025-02-24
C30003415	B	25-XY-024 C10002038	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-01-31			
C30003429	B	25-PCV-001 C10001754	On ATEX register Model, SN, Atex data are missing	.		Lmussi 2025-01-31			
C30003431	B	25-PCV-001 C10001754	Equipment tag plate is missing	.		Lmussi 2025-01-31	2025-03-01	Lmussi 2025-03-01	2025-03-01
C30003433	B	25-PCV-001 C10001754	ATEX D.o.C. by Manufacturer is missing	.		Lmussi 2025-01-31	2025-02-05	Lmussi 2025-02-05	2025-02-05
C30003436	B	25-PG -004 C10004819	Equipment Atex label is missing	.		Lmussi 2025-01-31			
C30003437	B	25-PG -004 C10004819	Equipment tag plate is missing	.		Lmussi 2025-01-31	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003440	B	25-PG -008 C10004821	Equipment Atex label is missing	.		Lmussi 2025-01-31			
C30003441	B	25-PG -008 C10004821	Equipment tag is missing	.		Lmussi 2025-01-31	2025-02-16	Lmussi 2025-02-16	2025-02-16

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage
SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003442	B	25-PG -011 C10004823	Equipment ATEX label is missing	.		Lmussi 2025-01-31			
C30003443	B	25-PG -011 C10004823	Equipment tag is missing	.		Lmussi 2025-01-31	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003451	B	25-PG -008 C10004821	Breathing valve is missing	.		Lmussi 2025-02-01			
C30003452	B	25-PG -014 C10004825	Equipment tag is missing	.		Lmussi 2025-02-01	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003453	B	25-PG -014 C10004825	Equipment Atex label is missing	.		Lmussi 2025-02-01			
C30003454	B	25-PG -017 C10004827	Equipment tag plate is missing	.		Lmussi 2025-02-01	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003455	B	25-PG -017 C10004827	Equipment ATEX label is missing	.		Lmussi 2025-02-01			
C30003456	B	25-PG -020 C10004829	Equipment tag plate is missing	.		Lmussi 2025-02-01	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003457	B	25-PG -020 C10004829	Equipment ATEX label is missing	.		Lmussi 2025-02-01			

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage
SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003458	B	25-PG -024 C10004831	Equipment ATEX label is missing	.		Lmussi 2025-02-01			
C30003459	B	25-PG -024 C10004831	Equipment tag plate is missing	.		Lmussi 2025-02-01	2025-03-01	Lmussi 2025-03-01	2025-03-01
C30003460	B	25-PG-001 C10004846	Equipment ATEX label is missing	.		Lmussi 2025-02-01			
C30003461	B	25-PG-001 C10004846	Equipment tag plate is missing	.		Lmussi 2025-02-01	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003470	B	25-PSV-008 C10004835	Equipment tag plate is missing	.		Lmussi 2025-02-03	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003471	B	25-PSV-008 C10004835	ATEX Declaration of Conformity by Manufacturer is missing	.		Lmussi 2025-02-03			
C30003472	B	25-PSV-008 C10004835	ATEX label is missing	.		Lmussi 2025-02-03			
C30003473	B	25-PSV-008 C10004835	On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing	.		Lmussi 2025-02-03			
C30003474	B	25-PSV-011 C10004837	On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing	.		Lmussi 2025-02-03			

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage
SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003475	B	25-PSV-011 C10004837	ATEX Declaration of Conformity by Manufacturer is missing	.		Lmussi 2025-02-03			
C30003476	B	25-PSV-011 C10004837	Equipment tag plate is missing	.		Lmussi 2025-02-03	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003477	B	25-PSV-011 C10004837	Equipment ATEX identification label is missing	.		Lmussi 2025-02-03			
C30003478	B	25-PSV-014 C10004839	Equipment ATEX identification label is missing	.		Lmussi 2025-02-03			
C30003479	B	25-PSV-014 C10004839	On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing	.		Lmussi 2025-02-03			
C30003480	B	25-PSV-014 C10004839	Equipment tag plate is missing	.		Lmussi 2025-02-03	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003481	B	25-PSV-014 C10004839	ATEX Declaration of Conformity by Manufacturer is missing	.		Lmussi 2025-02-03			
C30003482	B	25-PSV-017 C10004841	Equipment ATEX identification label is missing	.		Lmussi 2025-02-03			
C30003483	B	25-PSV-017 C10004841	ATEX Declaration of Conformity by Manufacturer is missing	.		Lmussi 2025-02-03			

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage
SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003484	B	25-PSV-017 C10004841	Equipment tag plate is missing	.		Lmussi 2025-02-03	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003485	B	25-PSV-017 C10004841	On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing	.		Lmussi 2025-02-03			
C30003486	B	25-PSV-020 C10004843	Equipment ATEX identification label is missing	.		Lmussi 2025-02-03			
C30003487	B	25-PSV-020 C10004843	ATEX Declaration of Conformity by Manufacturer is missing	.		Lmussi 2025-02-03			
C30003488	B	25-PSV-020 C10004843	Equipment tag plate is missing	.		Lmussi 2025-02-03	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003489	B	25-PSV-020 C10004843	On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing	.		Lmussi 2025-02-03			
C30003490	B	25-PSV-024 C10004845	Equipment ATEX identification label is missing	.		Lmussi 2025-02-03			
C30003491	B	25-PSV-024 C10004845	ATEX Declaration of Conformity by Manufacturer is missing	.		Lmussi 2025-02-03			
C30003492	B	25-PSV-024 C10004845	Equipment tag plate is missing	.		Lmussi 2025-02-03	2025-02-16	Lmussi 2025-02-16	2025-02-16

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003493	B	25-PSV-024 C10004845	On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing	.		Lmussi 2025-02-03			
C30003494	B	25-PSV-001 C10004849	Equipment ATEX identification label is missing	.		Lmussi 2025-02-03			
C30003495	B	25-PSV-001 C10004849	ATEX Declaration of Conformity by Manufacturer is missing	.		Lmussi 2025-02-03			
C30003496	B	25-PSV-001 C10004849	Equipment tag plate is missing	.		Lmussi 2025-02-03	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003497	B	25-PSV-001 C10004849	On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing	.		Lmussi 2025-02-03			
C30003502	B	25-PSV-004 C10004833	Equipment ATEX identification label is missing	.		Lmussi 2025-02-03			
C30003503	B	25-PSV-004 C10004833	ATEX Declaration of Conformity by Manufacturer is missing	.		Lmussi 2025-02-03			
C30003504	B	25-PSV-004 C10004833	Equipment tag plate is missing	.		Lmussi 2025-02-03	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003505	B	25-PSV-004 C10004833	On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing	.		Lmussi 2025-02-03			

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage
SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003563	B	25-XY-011 C10001718	Missing tag SS , on Solenoid Valve.	.		APolo 2025-02-05	2025-02-24	AAndreani 2025-02-24	2025-02-24
C30003564	B	25-XY-011 C10001718	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-02-05			
C30003566	B	25-ZSHL-017 C10001735	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-02-05			
C30003568	B	25-SDY-001 C10001712	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-02-05			
C30003569	B	25-SDY-001 C10001712	Missing tag SS , on Solenoid Valve.	.		APolo 2025-02-05	2025-02-24	AAndreani 2025-02-24	2025-02-24
C30003603	B	25-PT-002 C10001483	Missing the drainage device (tubing).	.		APolo 2025-02-08	2025-02-22	JKrizanic 2025-02-22	2025-02-22
C30003604	B	25-PT-002 C10001483	Missing tag SS , on the instrument.	.		APolo 2025-02-08	2025-02-24	AAndreani 2025-02-24	2025-02-24
C30003605	B	25-PT-002 C10001483	Missing traffolyte tag side instrument	.		APolo 2025-02-08	2025-02-13	AAndreani 2025-02-13	2025-02-13
C30003608	B	25-PT-001 C10001482	Missing tag SS , on the instrument.	.		APolo 2025-02-08	2025-02-24	AAndreani 2025-02-24	2025-02-24

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage
SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003609	B	25-PT-001 C10001482	Missing traffolyte tag side instrument	.		APolo 2025-02-08	2025-02-13	AAndreani 2025-02-13	2025-02-13
C30003610	B	25-PT-001 C10001482	Missing the drainage device (tubing)	.		APolo 2025-02-08	2025-03-01	AAndreani 2025-03-01	2025-03-01

Section 2 CONSOLIDATED PUNCH LISTS

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

Piping

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003312	A	25-07-TP-007 C10003278	BLPH-MV-014 not istalled	.		AMancini 2025-01-30	2025-02-07	LNovaga 2025-02-07	2025-02-07
C30003313	A	25-07-TP-007 C10003278	BLPH-MV-013 not installed	.		AMancini 2025-01-30	2025-02-07	LNovaga 2025-02-07	2025-02-07
C30003112	B	25-07-TP-007 C10003277	For all supports S-211 the gap, the isolation rubber, the PTFE and the nuts shall be checked during the reinstatement phase.	.		KAlbonetti 2025-01-21	2025-02-07	LNovaga 2025-02-07	2025-02-07
C30003113	B	25-07-TP-007 C10003277	Point n.4 of the ITR has not been checked due the fact that all valves have been removed all the alignment to terminal points are uncheckable.	.		KAlbonetti 2025-01-21	2025-02-07	LNovaga 2025-02-07	2025-02-07
C30003314	B	25-07-TP-007 C10003278	Support PS-03071.1 not installed	.		AMancini 2025-01-30	2025-02-11	LNovaga 2025-02-11	2025-02-11
C30003523	B	25-07-TP-007 C10003279	General touch up do to, especially near the supports of the piping line.	.		KAlbonetti 2025-02-05	2025-03-21	LNovaga 2025-03-21	2025-03-21
C30003528	B	25-07-TP-007 C10003279	Color coding and fluid direction are missing.	.		KAlbonetti 2025-02-05	2025-03-21	LNovaga 2025-03-21	2025-03-21
C30003579	B	25-07-TP-068 C10004793	All support and standard will be check during reinstatement phase	.		LNovaga 2025-02-06	2025-02-25	KAlbonetti 2025-02-25	2025-02-25
C30004108	B	25-07-TP-068 C10004794	The isometric is different from the field, produce a mark up. Support PS-02136.1 is missing. There is a S-211 between EW7 and EW8, distance from	.		LNovaga 2025-02-25			

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

Piping

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30004109	B	25-07-TP-068 C10004794	The hole on the ptfe on new support (see PL C30004108) is larger than the diameter of the washer.	.		LNovaga 2025-02-25	2025-02-25	KAlbonetti 2025-02-25	2025-02-25
C30004166	B	25-07-TP-068 C10004795	Color coding and fluid direction are missing.	.		KAlbonetti 2025-02-27	2025-03-21	LNovaga 2025-03-21	2025-03-21

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003280	B	C-25-XY-011/00 -JE-13002 C10000120	The bending radius is not with in the specified limits , is not fix with AISI cable ties.	.		APolo 2025-01-29	2025-02-24	AAndreani 2025-02-24	2025-02-24
C30003298	B	C-25-XY-017/00 -JE-13002 C10000122	The cable need a support near the valve 25-XY-017. See attached photo.	.		Gtangianu 2025-01-29	2025-02-08	AAndreani 2025-02-08	2025-02-08
C30003310	B	C-25-XV-024/00 -JE-12005 C10000102	The cable is not support .	.		APolo 2025-01-30	2025-03-05	JKrizanic 2025-03-05	2025-03-05
C30003311	B	C-25-XY-024/00 -JE-13002 C10000124	The cable is not support .	.		APolo 2025-01-30	2025-03-05	JKrizanic 2025-03-05	2025-03-05
C30003565	B	C-25-XV-017/00 -JE-12004 C10000088	The cable is not support .	.		APolo 2025-02-05	2025-02-13	AAndreani 2025-02-13	2025-02-13
C30003567	B	C-25-SDY-001/0 0-JE-23002 C10000176	the cable installed is temporary. To be replaced	.		APolo 2025-02-05	2025-04-08	Gtangianu 2025-04-08	2025-04-08
C30003602	B	C-25-PT-002/00 -JE-21002 C10000136	Missing the "side slot" on the cable tray (for cable passage) so that the cable is not in crash with the piping.	.		APolo 2025-02-08	2025-02-22	JKrizanic 2025-02-22	2025-02-22
C30003606	B	C-25-PT-001/00 -JE-11003 C10000048	Missing the "side slot" on the cable tray (for cable passage) so that the cable is not in crash with the piping.	.		APolo 2025-02-08	2025-03-01	AAndreani 2025-03-01	2025-03-01
C30003607	B	C-25-PT-001/00 -JE-11003 C10000048	Missing cable tag SS , near JB 00-JE-11003	.		APolo 2025-02-08	2025-02-21	APolo 2025-02-21	2025-02-21

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003287	B	25-XY-004 C10001714	Missing tag SS , on Solenoid Valve.	.		APolo 2025-01-29	2025-02-24	AAndreani 2025-02-24	2025-02-24
C30003288	B	25-XY-008 C10001716	Missing tag SS , on Solenoid Valve.	.		APolo 2025-01-29	2025-02-24	AAndreani 2025-02-24	2025-02-24
C30003293	B	25-ZSHL-008 C10001729	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-01-29			
C30003294	B	25-ZSHL-014 C10001733	document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field. See attached photo.	.		Gtangianu 2025-01-29			
C30003295	B	25-ZSHL-011 C10001731	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-01-29			
C30003297	B	25-ZSHL-004 C10001727	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-01-29			
C30003299	B	25-ZSHL-020 C10001737	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field . See attached photo.	.		Gtangianu 2025-01-29			
C30003300	B	25-XY-014 C10001720	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field.See attached photo.	.		Gtangianu 2025-01-29			
C30003301	B	25-XY-017 C10001722	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field . See attached photo.	.		Gtangianu 2025-01-29			

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003302	B	25-XY-020 C10001724	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field. See attached photo.	.		Gtangianu 2025-01-29			
C30003305	B	25-XY-014 C10001720	Missing tag plate SS on the solenoid valve.(25-XY-014).	.		Gtangianu 2025-01-29	2025-02-21	AAndreani 2025-02-21	2025-02-21
C30003306	B	25-XY-017 C10001722	Missing tag plate SS on the solenoid valve.(25-XY-017).	.		Gtangianu 2025-01-29	2025-02-21	AAndreani 2025-02-21	2025-02-21
C30003307	B	25-XY-020 C10001724	Missing tag plate SS on the solenoid valve.(25-XY-020).	.		Gtangianu 2025-01-29	2025-02-21	AAndreani 2025-02-21	2025-02-21
C30003324	B	25-ZSHL-024 C10002039	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-01-30			
C30003325	B	25-XV-004 C10001590	Scratch on painting, general touch-up to be performed	.		Lmussi 2025-01-30	2025-04-09	LNovaga 2025-04-09	2025-04-09
C30003326	B	25-XV-004 C10001590	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufactuer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-30			
C30003327	B	25-XV-004 C10001590	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-30	2025-03-06	LNovaga 2025-03-06	2025-03-06
C30003328	B	25-XV-008 C10001592	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-30			

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003329	B	25-XV-008 C10001592	Scratch on painting, general touch-up to be performed	.		Lmussi 2025-01-30	2025-04-09	LNovaga 2025-04-09	2025-04-09
C30003330	B	25-XV-011 C10001594	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-30			
C30003331	B	25-XV-011 C10001594	Scratch on painting, general touch-up to be performed	.		Lmussi 2025-01-30	2025-04-09	LNovaga 2025-04-09	2025-04-09
C30003332	B	25-XV-014 C10001596	Scratch on painting, general touch-up to be performed	.		Lmussi 2025-01-30	2025-03-20	LNovaga 2025-03-20	2025-03-20
C30003333	B	25-XV-014 C10001596	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-30			
C30003334	B	25-XV-017 C10001598	Scratch on painting, general touch-up to be performed	.		Lmussi 2025-01-30	2025-03-20	LNovaga 2025-03-20	2025-03-20
C30003335	B	25-XV-017 C10001598	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-30			
C30003336	B	25-XV-020 C10001600	Scratch on painting, general touch-up to be performed	.		Lmussi 2025-01-30	2025-03-20	LNovaga 2025-03-20	2025-03-20
C30003337	B	25-XV-020 C10001600	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-30			

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003338	B	25-ZSHL-001 C10001726	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-01-30			
C30003365	B	25-PCV-004 C10001755	On ATEX register Model, SN, Atex data are missing	.		Lmussi 2025-01-30			
C30003367	B	25-PCV-004 C10001755	Equipment tag plate is missing	.		Lmussi 2025-01-30	2025-03-01	Lmussi 2025-03-01	2025-03-01
C30003371	B	25-PCV-004 C10001755	ATEX D.o.C. by Manufacturer is missing	.		Lmussi 2025-01-30	2025-02-05	Lmussi 2025-02-05	2025-02-05
C30003372	B	25-PCV-008 C10001757	On ATEX register equipment model, SN and Atex execution are missing	.		Lmussi 2025-01-30			
C30003375	B	25-PCV-008 C10001757	ATEX D.o.C. by Manufacturer is missing	.		Lmussi 2025-01-30	2025-02-05	Lmussi 2025-02-05	2025-02-05
C30003377	B	25-PCV-008 C10001757	Equipment data plate is missing	.		Lmussi 2025-01-30	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003378	B	25-PCV-011 C10001759	On ATEX register equipment model, SN and Atex execution are missing	.		Lmussi 2025-01-30			
C30003379	B	25-PCV-011 C10001759	ATEX D.o.C. by Manufacturer is missing	.		Lmussi 2025-01-30	2025-02-05	Lmussi 2025-02-05	2025-02-05

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003380	B	25-PCV-011 C10001759	Equipment data plate is missing	.		Lmussi 2025-01-30	2025-03-01	Lmussi 2025-03-01	2025-03-01
C30003381	B	25-PCV-014 C10001761	On ATEX register equipment model, SN and Atex execution are missing	.		Lmussi 2025-01-30			
C30003382	B	25-PCV-014 C10001761	ATEX D.o.C. by Manufacturer is missing	.		Lmussi 2025-01-30	2025-02-05	Lmussi 2025-02-05	2025-02-05
C30003383	B	25-PCV-014 C10001761	Equipment data plate is missing	.		Lmussi 2025-01-30	2025-03-01	Lmussi 2025-03-01	2025-03-01
C30003385	B	25-PCV-017 C10001763	On ATEX register equipment model, SN and Atex execution are missing	.		Lmussi 2025-01-30			
C30003387	B	25-PCV-017 C10001763	ATEX D.o.C. by Manufacturer is missing	.		Lmussi 2025-01-30	2025-02-05	Lmussi 2025-02-05	2025-02-05
C30003389	B	25-PCV-017 C10001763	Equipment data plate is missing	.		Lmussi 2025-01-30	2025-03-01	Lmussi 2025-03-01	2025-03-01
C30003393	B	25-PCV-020 C10001765	On ATEX register equipment model, SN and Atex execution are missing	.		Lmussi 2025-01-30			
C30003394	B	25-PCV-020 C10001765	ATEX D.o.C. by Manufacturer is missing	.		Lmussi 2025-01-30	2025-02-05	Lmussi 2025-02-05	2025-02-05

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003395	B	25-PCV-020 C10001765	Equipment data plate is missing	.		Lmussi 2025-01-30	2025-03-01	Lmussi 2025-03-01	2025-03-01
C30003396	B	25-PCV-004 C10001755	On ATEX register equipment model, SN and Atex execution are missing	.		Lmussi 2025-01-30	2025-03-06	LNovaga 2025-03-06	2025-03-06
C30003407	B	25-XV-024 C10001602	Scratch on painting, general touch-up to be performed	.		Lmussi 2025-01-31	2025-04-22	LNovaga 2025-04-22	2025-04-22
C30003408	B	25-XV-024 C10001602	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-31			
C30003409	B	25-PCV-024 C10002040	On ATEX register Model, SN, Atex data are missing	.		Lmussi 2025-01-31			
C30003410	B	25-PCV-024 C10002040	ATEX D.o.C. by Manufacturer is missing	.		Lmussi 2025-01-31	2025-02-05	Lmussi 2025-02-05	2025-02-05
C30003411	B	25-PCV-024 C10002040	Equipment tag plate is missing	.		Lmussi 2025-01-31	2025-03-01	Lmussi 2025-03-01	2025-03-01
C30003412	B	25-SDV-001 C10001588	Scratch on painting, general touch-up to be performed	.		Lmussi 2025-01-31	2025-04-09	LNovaga 2025-04-09	2025-04-09
C30003413	B	25-SDV-001 C10001588	On ATEX register (123A90-DDL-EL-LIS-20094 sheet 7) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.	.		Lmussi 2025-01-31			

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003414	B	25-XY-024 C10002038	Missing tag SS , on Solenoid Valve.	.		APolo 2025-01-31	2025-02-24	AAndreani 2025-02-24	2025-02-24
C30003415	B	25-XY-024 C10002038	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-01-31			
C30003429	B	25-PCV-001 C10001754	On ATEX register Model, SN, Atex data are missing	.		Lmussi 2025-01-31			
C30003431	B	25-PCV-001 C10001754	Equipment tag plate is missing	.		Lmussi 2025-01-31	2025-03-01	Lmussi 2025-03-01	2025-03-01
C30003433	B	25-PCV-001 C10001754	ATEX D.o.C. by Manufacturer is missing	.		Lmussi 2025-01-31	2025-02-05	Lmussi 2025-02-05	2025-02-05
C30003436	B	25-PG -004 C10004819	Equipment Atex label is missing	.		Lmussi 2025-01-31	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003437	B	25-PG -004 C10004819	Equipment tag plate is missing	.		Lmussi 2025-01-31	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003440	B	25-PG -008 C10004821	Equipment Atex label is missing	.		Lmussi 2025-01-31	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003441	B	25-PG -008 C10004821	Equipment tag is missing	.		Lmussi 2025-01-31	2025-02-16	Lmussi 2025-02-16	2025-02-16

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003442	B	25-PG -011 C10004823	Equipment ATEX label is missing	.		Lmussi 2025-01-31	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003443	B	25-PG -011 C10004823	Equipment tag is missing	.		Lmussi 2025-01-31	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003451	B	25-PG -008 C10004821	Breathing valve is missing	.		Lmussi 2025-02-01	2025-03-26	Gtangianu 2025-03-26	2025-03-26
C30003452	B	25-PG -014 C10004825	Equipment tag is missing	.		Lmussi 2025-02-01	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003453	B	25-PG -014 C10004825	Equipment Atex label is missing	.		Lmussi 2025-02-01	2025-04-09	LNovaga 2025-04-09	2025-04-09
C30003454	B	25-PG -017 C10004827	Equipment tag plate is missing	.		Lmussi 2025-02-01	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003455	B	25-PG -017 C10004827	Equipment ATEX label is missing	.		Lmussi 2025-02-01	2025-04-09	LNovaga 2025-04-09	2025-04-09
C30003456	B	25-PG -020 C10004829	Equipment tag plate is missing	.		Lmussi 2025-02-01	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003457	B	25-PG -020 C10004829	Equipment ATEX label is missing	.		Lmussi 2025-02-01	2025-04-09	LNovaga 2025-04-09	2025-04-09

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003458	B	25-PG -024 C10004831	Equipment ATEX label is missing	.		Lmussi 2025-02-01	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003459	B	25-PG -024 C10004831	Equipment tag plate is missing	.		Lmussi 2025-02-01	2025-03-01	Lmussi 2025-03-01	2025-03-01
C30003460	B	25-PG-001 C10004846	Equipment ATEX label is missing	.		Lmussi 2025-02-01	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003461	B	25-PG-001 C10004846	Equipment tag plate is missing	.		Lmussi 2025-02-01	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003470	B	25-PSV-008 C10004835	Equipment tag plate is missing	.		Lmussi 2025-02-03	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003471	B	25-PSV-008 C10004835	ATEX Declaration of Conformity by Manufacturer is missing	.		Lmussi 2025-02-03	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003472	B	25-PSV-008 C10004835	ATEX label is missing	.		Lmussi 2025-02-03	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003473	B	25-PSV-008 C10004835	On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing	.		Lmussi 2025-02-03			
C30003474	B	25-PSV-011 C10004837	On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing	.		Lmussi 2025-02-03			

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003475	B	25-PSV-011 C10004837	ATEX Declaration of Conformity by Manufacturer is missing	.		Lmussi 2025-02-03	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003476	B	25-PSV-011 C10004837	Equipment tag plate is missing	.		Lmussi 2025-02-03	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003477	B	25-PSV-011 C10004837	Equipment ATEX identification label is missing	.		Lmussi 2025-02-03	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003478	B	25-PSV-014 C10004839	Equipment ATEX identification label is missing	.		Lmussi 2025-02-03	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003479	B	25-PSV-014 C10004839	On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing	.		Lmussi 2025-02-03			
C30003480	B	25-PSV-014 C10004839	Equipment tag plate is missing	.		Lmussi 2025-02-03	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003481	B	25-PSV-014 C10004839	ATEX Declaration of Conformity by Manufacturer is missing	.		Lmussi 2025-02-03	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003482	B	25-PSV-017 C10004841	Equipment ATEX identification label is missing	.		Lmussi 2025-02-03	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003483	B	25-PSV-017 C10004841	ATEX Declaration of Conformity by Manufacturer is missing	.		Lmussi 2025-02-03	2025-04-24	Gtangianu 2025-04-24	2025-04-24

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003484	B	25-PSV-017 C10004841	Equipment tag plate is missing	.		Lmussi 2025-02-03	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003485	B	25-PSV-017 C10004841	On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing	.		Lmussi 2025-02-03			
C30003486	B	25-PSV-020 C10004843	Equipment ATEX identification label is missing	.		Lmussi 2025-02-03	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003487	B	25-PSV-020 C10004843	ATEX Declaration of Conformity by Manufacturer is missing	.		Lmussi 2025-02-03	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003488	B	25-PSV-020 C10004843	Equipment tag plate is missing	.		Lmussi 2025-02-03	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003489	B	25-PSV-020 C10004843	On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing	.		Lmussi 2025-02-03			
C30003490	B	25-PSV-024 C10004845	Equipment ATEX identification label is missing	.		Lmussi 2025-02-03	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003491	B	25-PSV-024 C10004845	ATEX Declaration of Conformity by Manufacturer is missing	.		Lmussi 2025-02-03	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003492	B	25-PSV-024 C10004845	Equipment tag plate is missing	.		Lmussi 2025-02-03	2025-02-16	Lmussi 2025-02-16	2025-02-16

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003493	B	25-PSV-024 C10004845	On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing	.		Lmussi 2025-02-03			
C30003494	B	25-PSV-001 C10004849	Equipment ATEX identification label is missing	.		Lmussi 2025-02-03	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003495	B	25-PSV-001 C10004849	ATEX Declaration of Conformity by Manufacturer is missing	.		Lmussi 2025-02-03	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003496	B	25-PSV-001 C10004849	Equipment tag plate is missing	.		Lmussi 2025-02-03	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003497	B	25-PSV-001 C10004849	On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing	.		Lmussi 2025-02-03			
C30003502	B	25-PSV-004 C10004833	Equipment ATEX identification label is missing	.		Lmussi 2025-02-03	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003503	B	25-PSV-004 C10004833	ATEX Declaration of Conformity by Manufacturer is missing	.		Lmussi 2025-02-03	2025-04-24	Gtangianu 2025-04-24	2025-04-24
C30003504	B	25-PSV-004 C10004833	Equipment tag plate is missing	.		Lmussi 2025-02-03	2025-02-16	Lmussi 2025-02-16	2025-02-16
C30003505	B	25-PSV-004 C10004833	On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing	.		Lmussi 2025-02-03			

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003563	B	25-XY-011 C10001718	Missing tag SS , on Solenoid Valve.	.		APolo 2025-02-05	2025-02-24	AAndreani 2025-02-24	2025-02-24
C30003564	B	25-XY-011 C10001718	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-02-05			
C30003566	B	25-ZSHL-017 C10001735	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-02-05			
C30003568	B	25-SDY-001 C10001712	Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)	.		APolo 2025-02-05			
C30003569	B	25-SDY-001 C10001712	Missing tag SS , on Solenoid Valve.	.		APolo 2025-02-05	2025-02-24	AAndreani 2025-02-24	2025-02-24
C30003603	B	25-PT-002 C10001483	Missing the drainage device (tubing).	.		APolo 2025-02-08	2025-02-22	JKrizanic 2025-02-22	2025-02-22
C30003604	B	25-PT-002 C10001483	Missing tag SS , on the instrument.	.		APolo 2025-02-08	2025-02-24	AAndreani 2025-02-24	2025-02-24
C30003605	B	25-PT-002 C10001483	Missing traffolyte tag side instrument	.		APolo 2025-02-08	2025-02-13	AAndreani 2025-02-13	2025-02-13
C30003608	B	25-PT-001 C10001482	Missing tag SS , on the instrument.	.		APolo 2025-02-08	2025-02-24	AAndreani 2025-02-24	2025-02-24

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 25 Hydrogen Storage

SUBSYSTEM 25-07 Hydrogen Storage Vessels Header (Inlet)

ATEX

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30003609	B	25-PT-001 C10001482	Missing traffolyte tag side instrument	.		APolo 2025-02-08	2025-02-13	AAndreani 2025-02-13	2025-02-13
C30003610	B	25-PT-001 C10001482	Missing the drainage device (tubing)	.		APolo 2025-02-08	2025-03-01	AAndreani 2025-03-01	2025-03-01

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003293

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001729	1.4 Discipline	ATEX
1.2 Item	25-ZSHL-008		Limit Switch Box - Vessel V-25001B Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)

Name: Alessio Polo

Date: 2025-01-29

Signature: Digitaly signed by Alessio Polo 2025-01-29T12:39:09.214Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-01-29
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Alessio Polo 2025-01-29T12:39:25.734Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date


Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

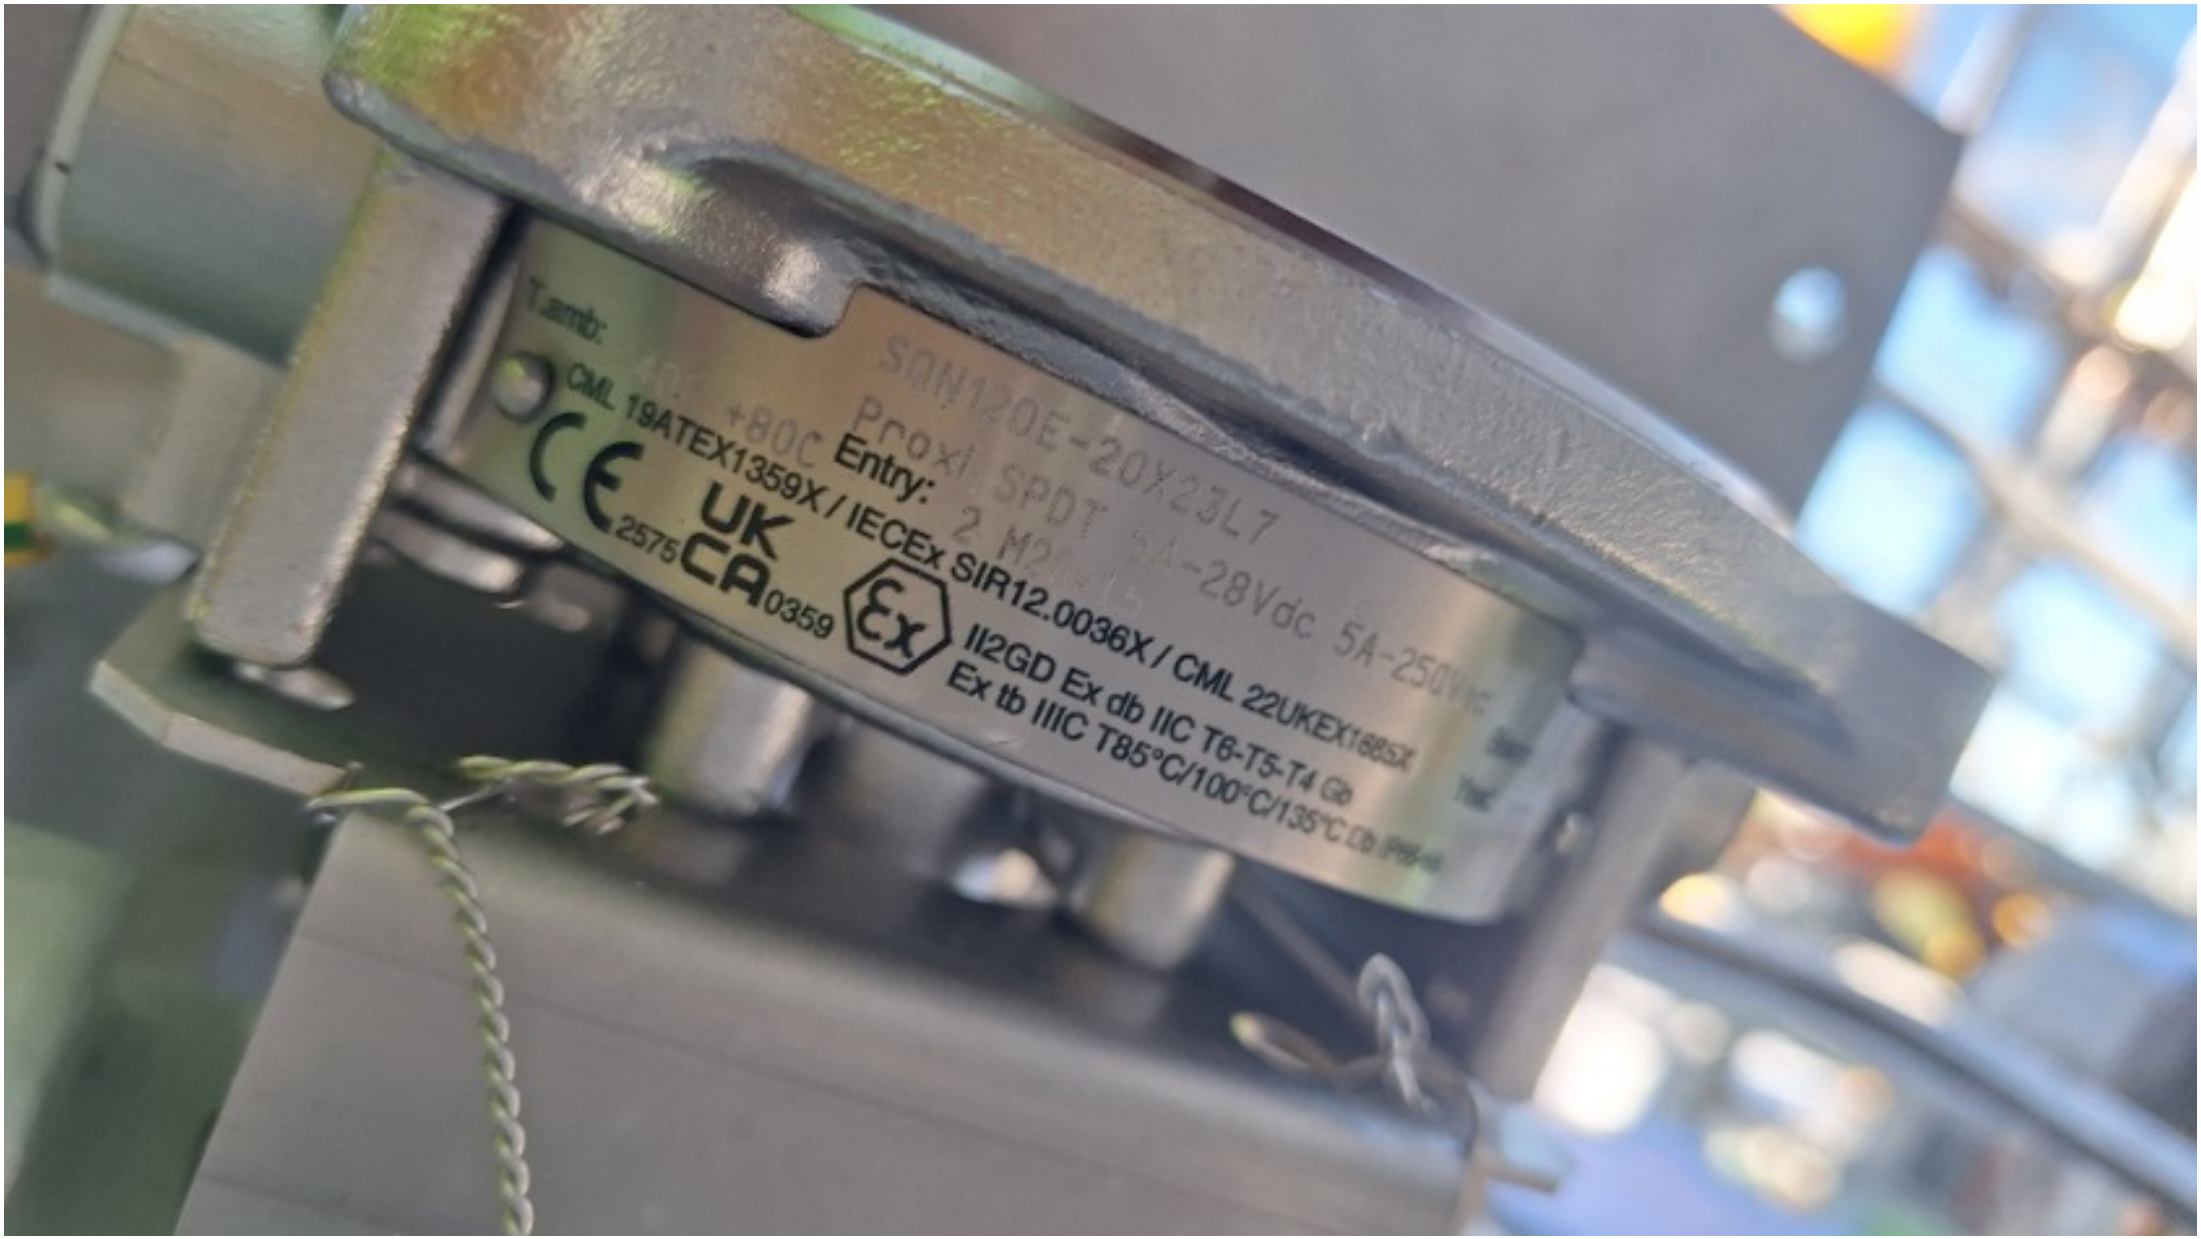
T amb:
+80C
Entry:
CML 19ATEX1359X / IECEx SIR12.0036X / CML 22UKEX1685X
UK
CA
2575
0359
II2GD Ex db IIC T6-T5-T4 Gb
Ex tb IIIC T85°C/100°C/135°C Db


Batch: IT03B0127022
Year: 2024
SIR12.0036X / CML 22UKEX1685X
II2GD Ex db IIC T6-T5-T4 Gb
Ex tb IIIC T85°C/100°C/135°C Db IP66-68

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003294

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001733	1.4 Discipline	ATEX
1.2 Item	25-ZSHL-014	Limit Switch Box - Vessel V-25001D Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field.

See attached photo.

Name: Giovanni Tangianu

Date: 2025-01-29

Signature: Digitaly signed by Giovanni Tangianu 2025-01-29T12:51:47.024Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2025-01-29
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Giovanni Tangianu 2025-01-29T12:52:02.088Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature


6- CLEARANCE APPROVAL

Name

Date

Signature


-20X23L7
SPDT 5A-28Vdc 5A-250Vac
M20x1.5
Batch: JT03B0116129
Year: 2023

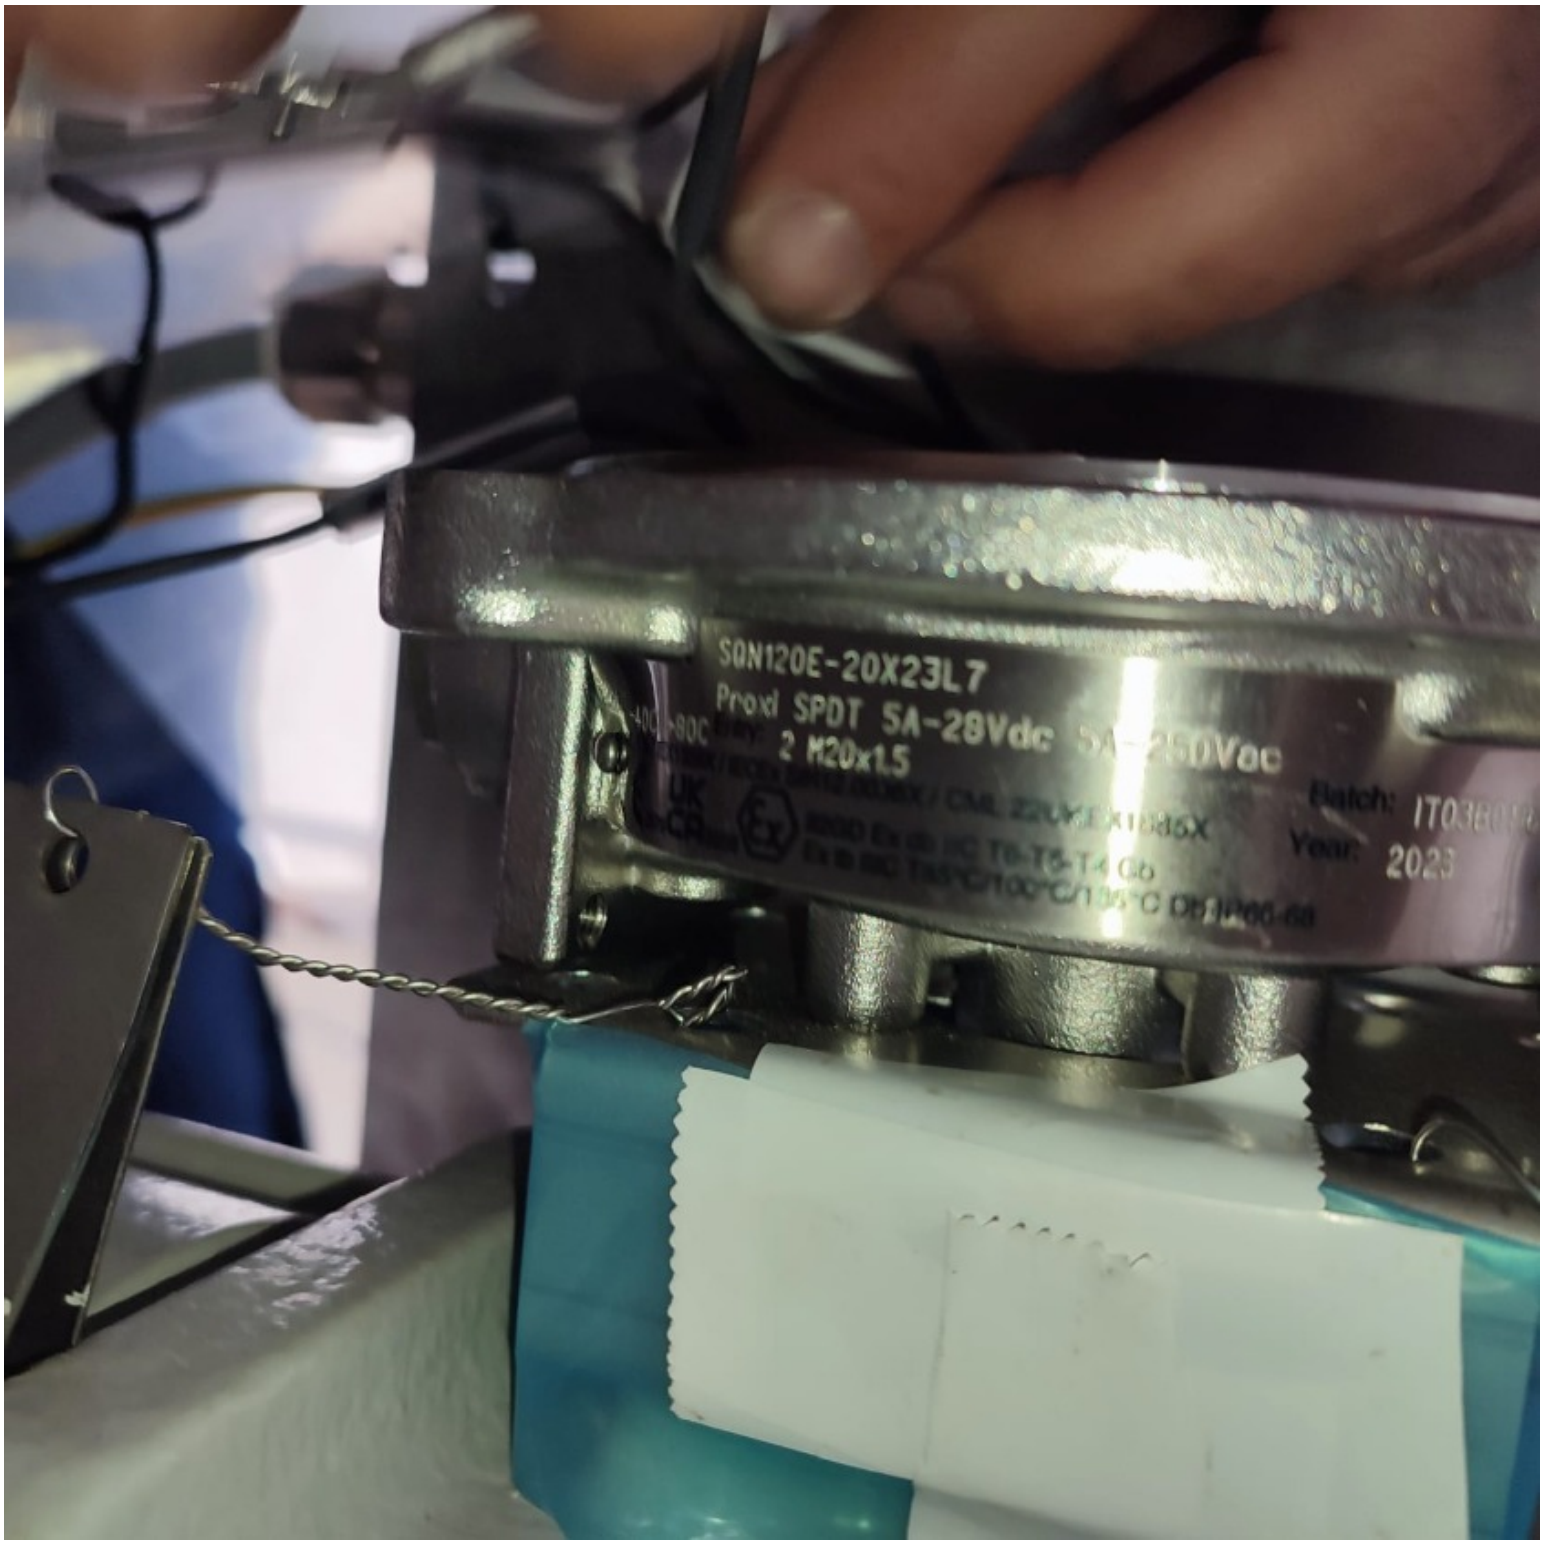
SQN120E-20X23L7
Proxi SPDT 5A-28Vdc 5A-250Vac
2 M20x1.5
Year: 2023

ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003295

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001731	1.4 Discipline	ATEX
1.2 Item	25-ZSHL-011		Limit Switch Box - Vessel V-25001C Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)

Name: Alessio Polo

Date: 2025-01-29

Signature: Digitaly signed by Alessio Polo 2025-01-29T12:56:09.659Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-01-29
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Alessio Polo 2025-01-29T12:56:20.339Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date


Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

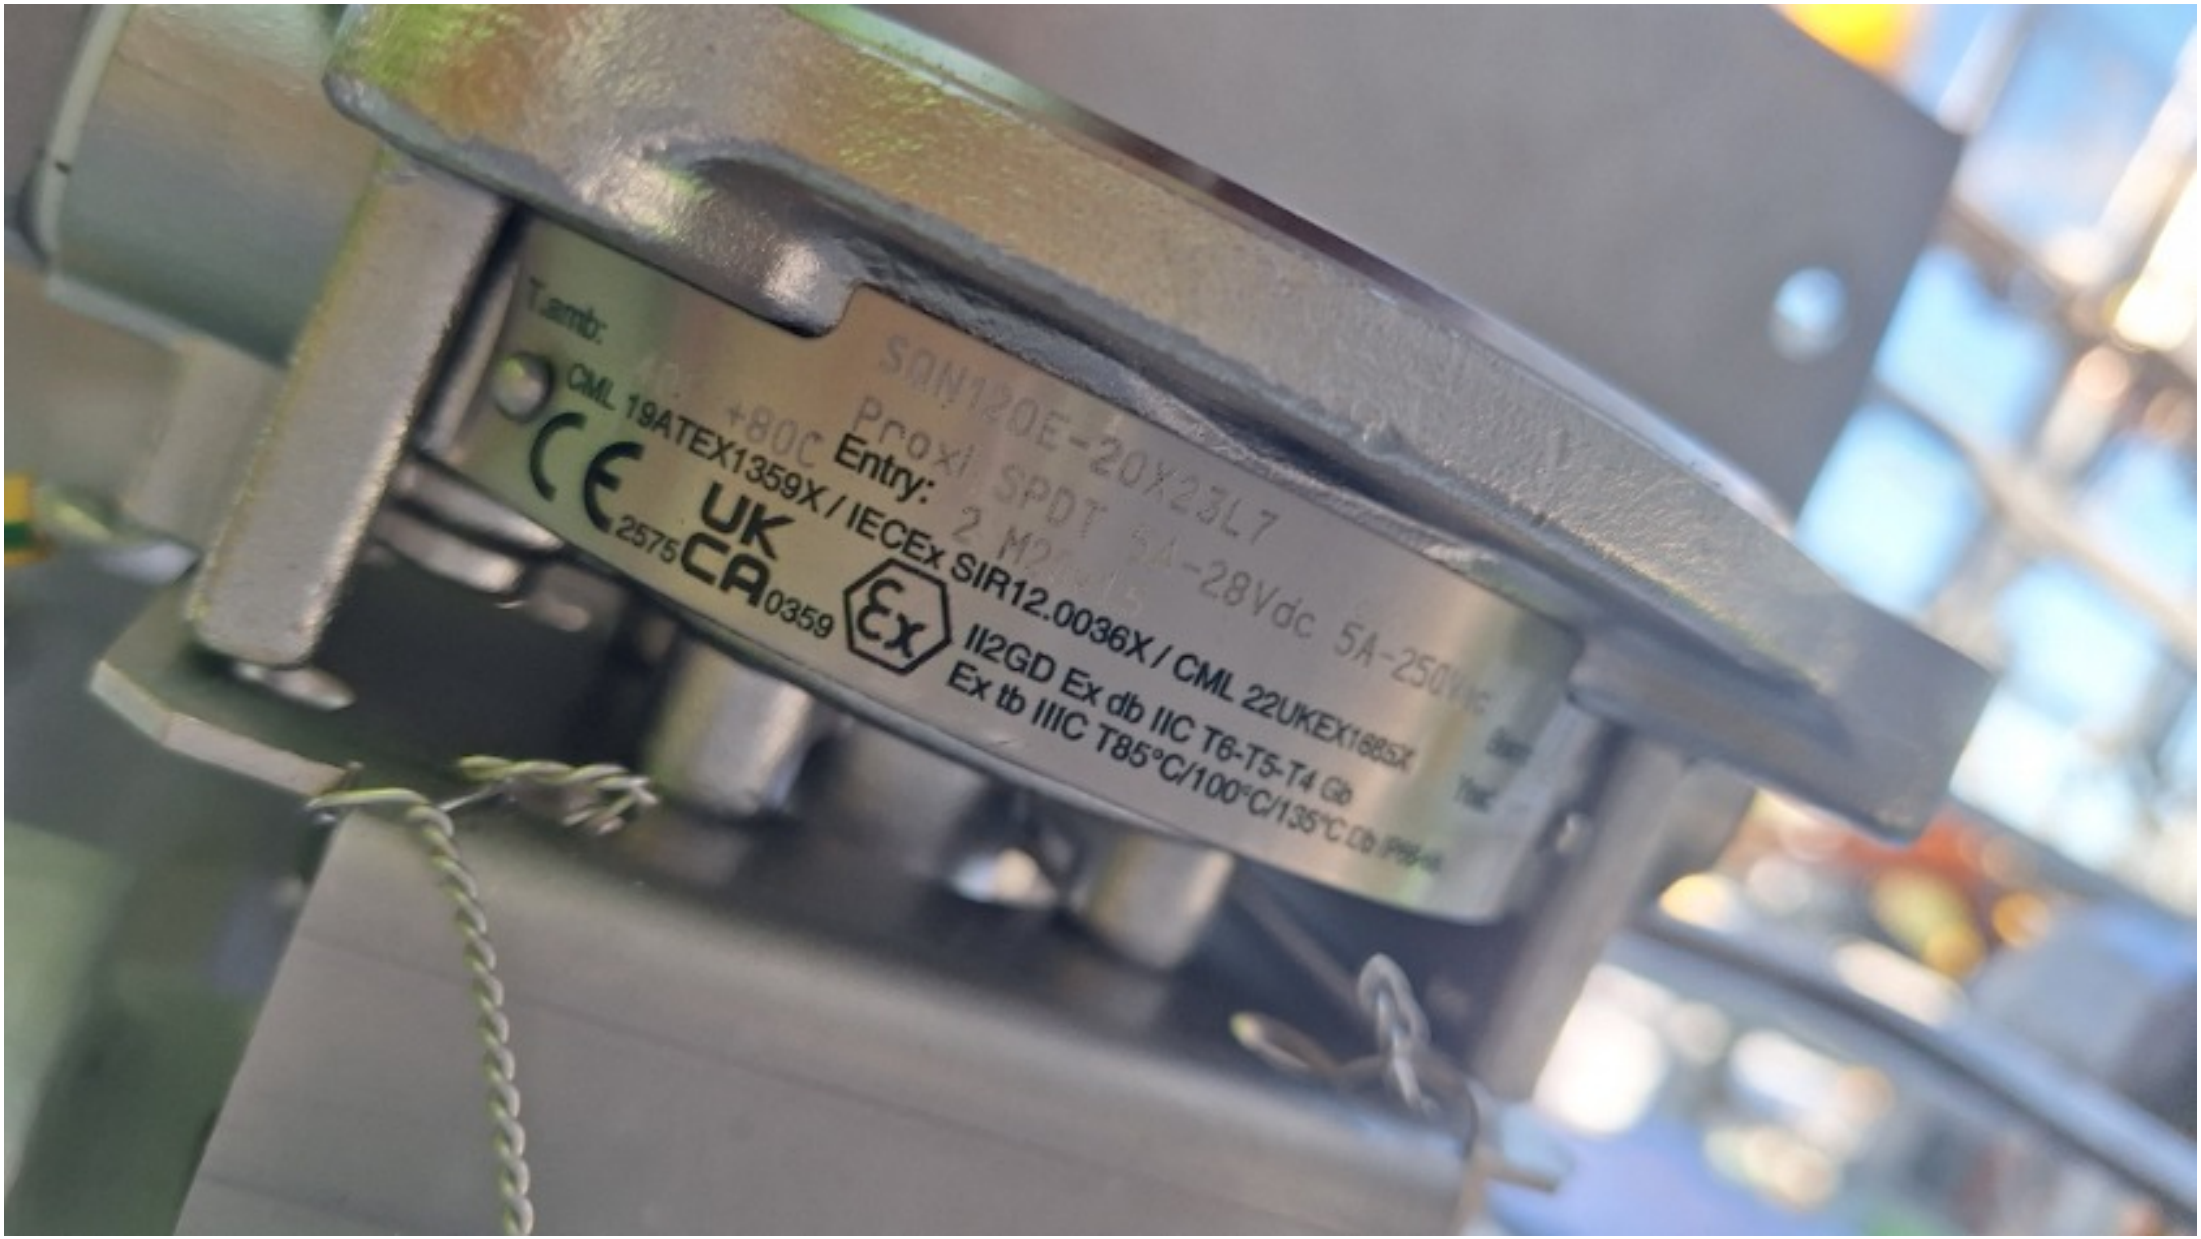
T amb:
+80C
Entry:
CML 19ATEX1359X / IECEx SIR12.0036X / CML 22UKEX1685X
UK
CA
2575
0359
II2GD Ex db IIC T6-T5-T4 Gb
Ex tb IIIC T85°C/100°C/135°C Db


Entry:
CML 19ATEX1359X / IECEx SIR12.0036X / CML 22UKEX1685X
UK
2575 CA 0359
II2GD Ex db IIC T6-T5-T4 Gb
Ex tb IIIC T85°C/100°C/135°C Db IP66-65
Batch:
Year: 2023

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003297

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001727	1.4 Discipline	ATEX
1.2 Item	25-ZSHL-004		Limit Switch Box - Vessel V-25001A Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)

Name: Alessio Polo

Date: 2025-01-29

Signature: Digitaly signed by Alessio Polo 2025-01-29T13:04:30.020Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-01-29
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Alessio Polo 2025-01-29T13:04:39.209Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date


Signature


6- CLEARANCE APPROVAL

Name

Date

Signature

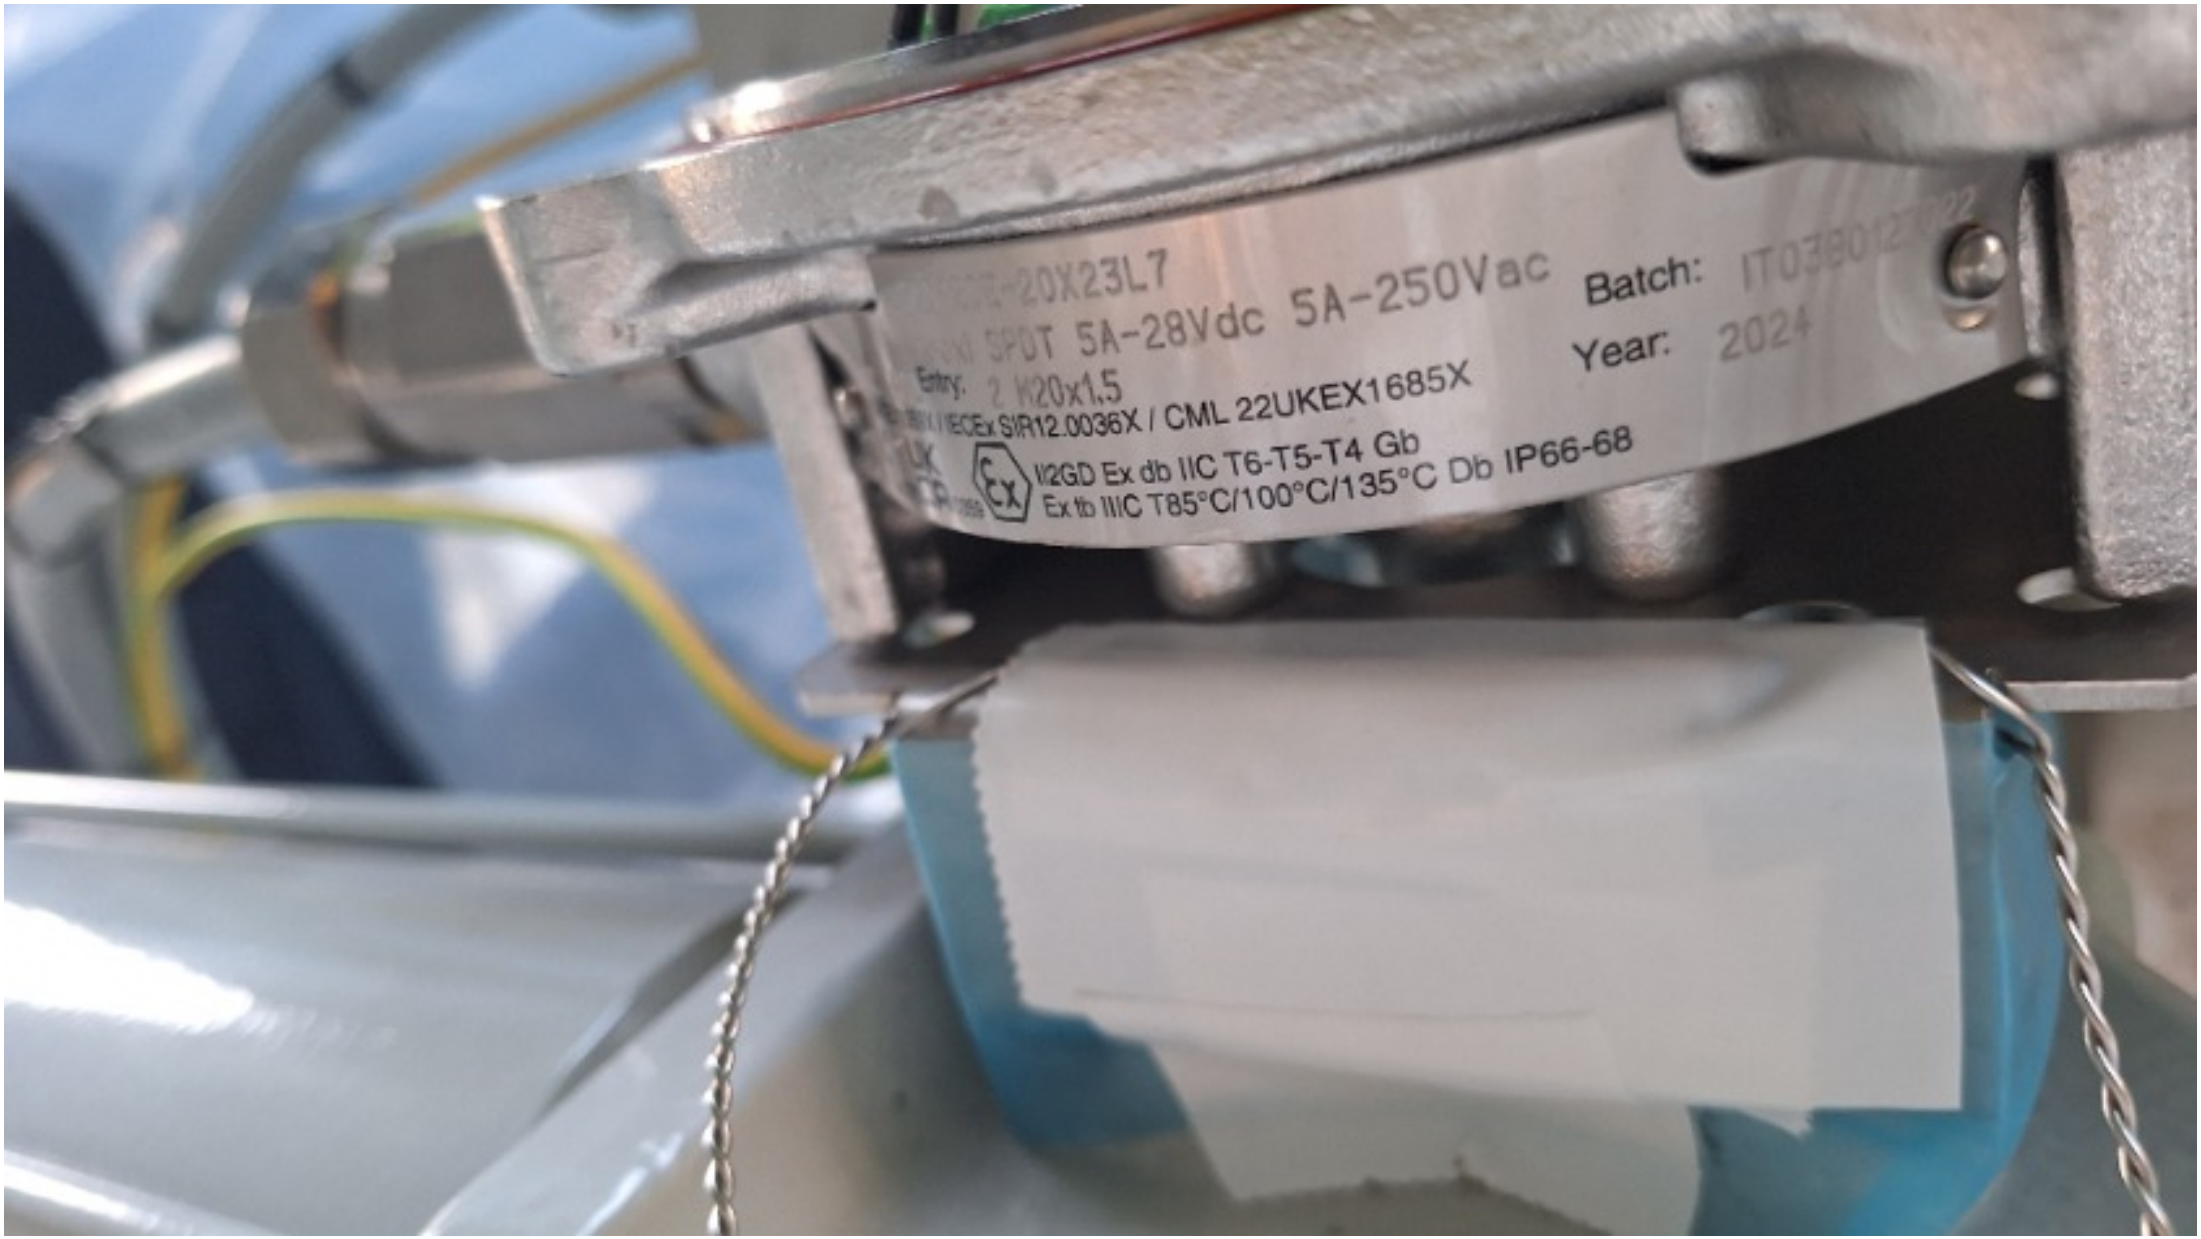
-20X23L7
SPDT 5A-28Vdc 5A-250Vac
Batch:
Year: 2024
Entry: 2 M20x1.5
IECEx SIR12.0036X / CML 22UKEX1685X
II2GD Ex db IIC T6-T5-T4 Gb
Ex tb IIIC T85°C/100°C/135°C Db IP66-68

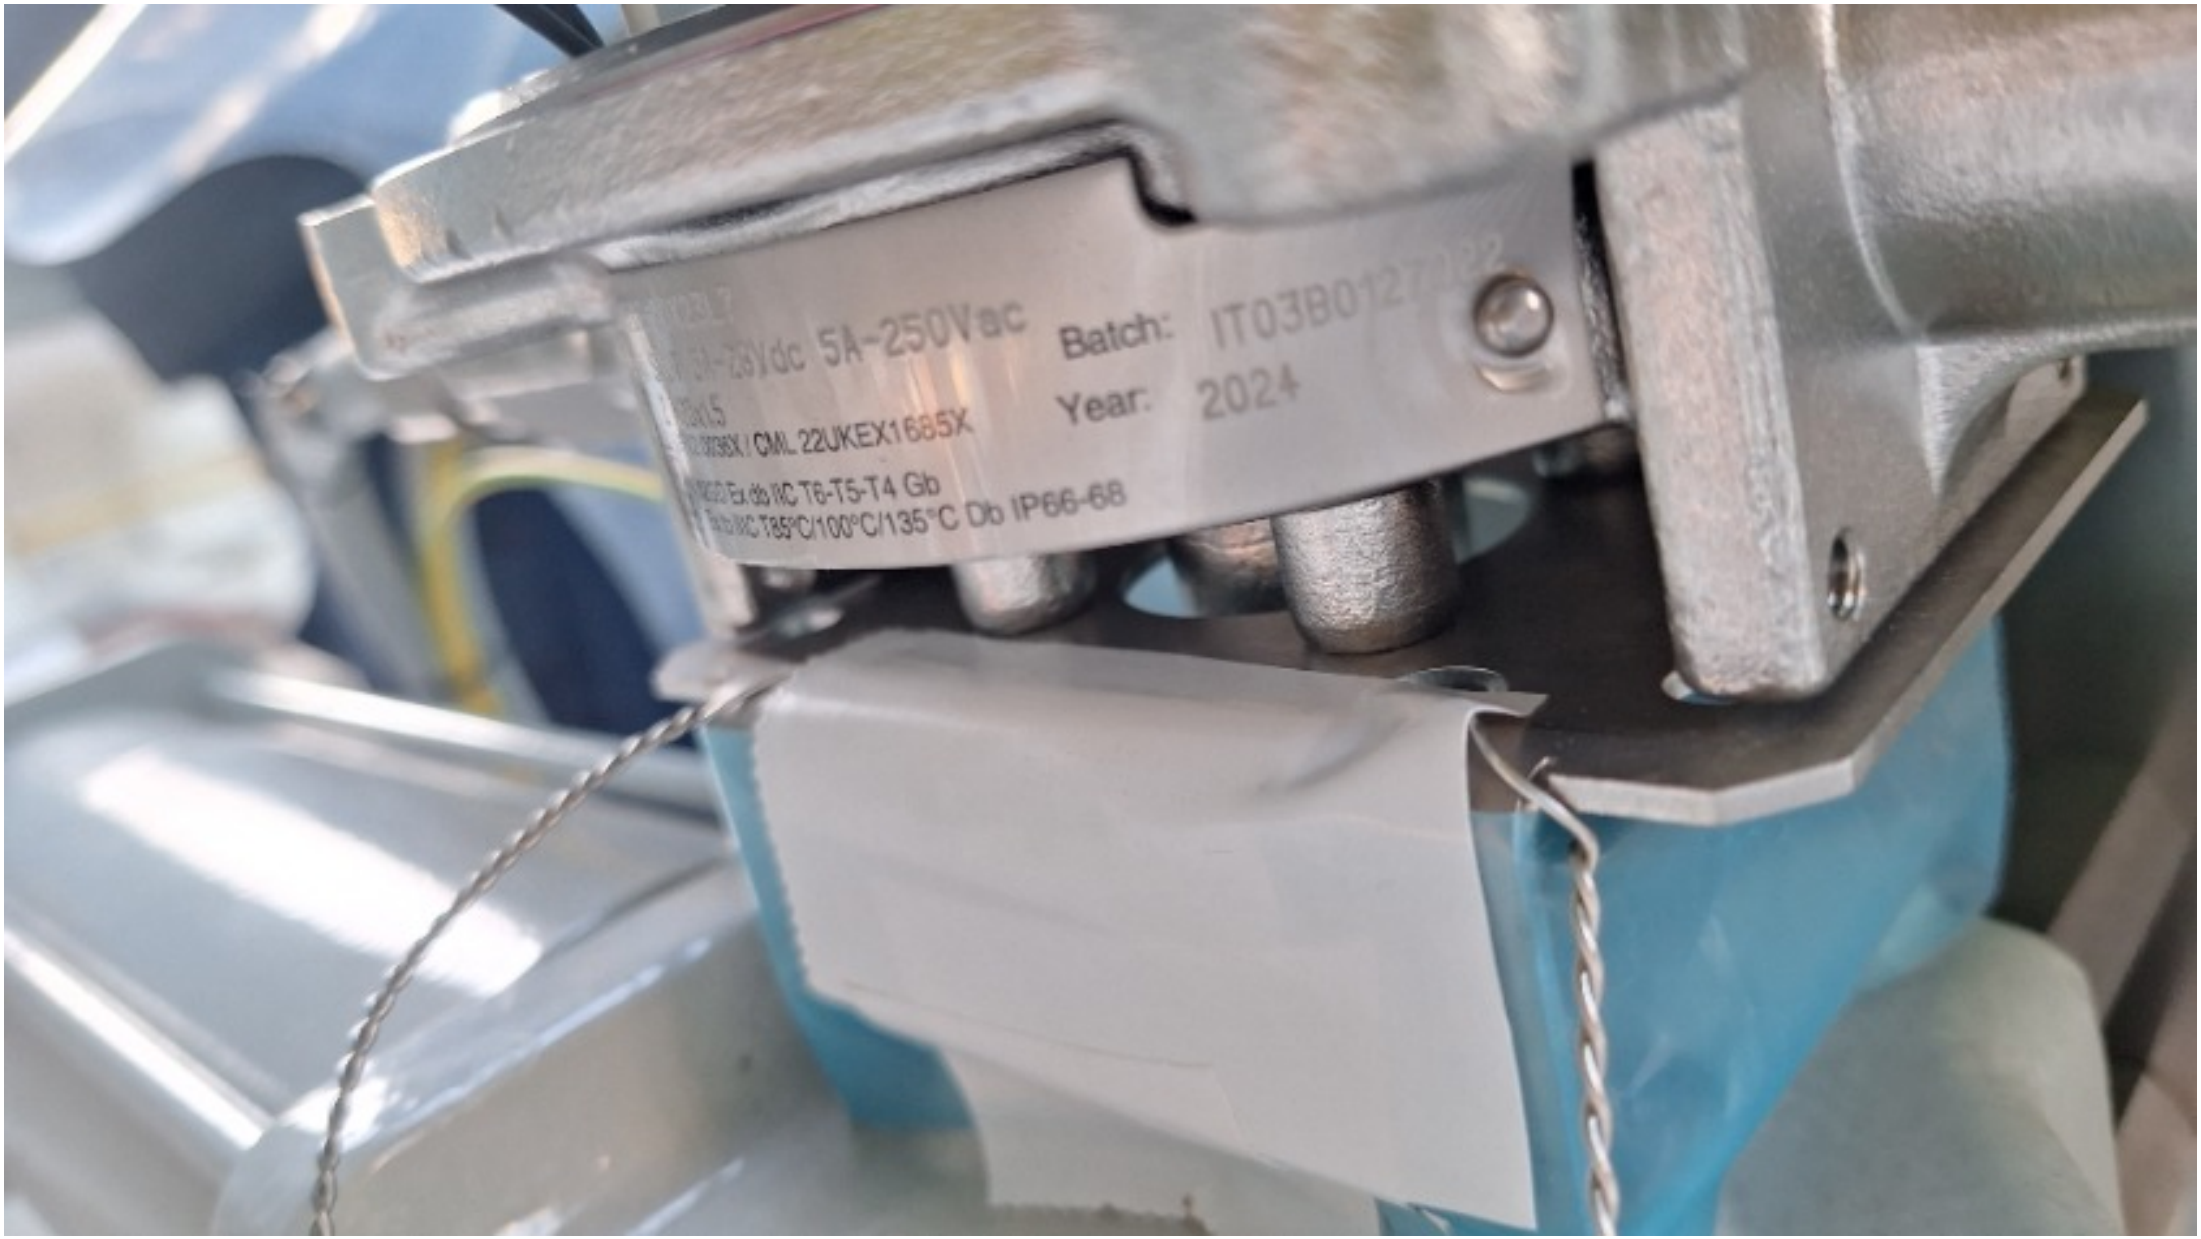
5A-250Vac
Batch:
Year: 2024
CML 22UKEX1685X
T6-T5-T4 Gb
T85°C/100°C/135°C Db IP66-68

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003299

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001737	1.4 Discipline	ATEX
1.2 Item	25-ZSHL-020		Limit Switch Box - Vessel V-25001F Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field . See attached photo.

Name: Giovanni Tangianu

Date: 2025-01-29

Signature: Digitaly signed by Giovanni Tangianu 2025-01-29T13:24:25.692Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2025-01-29
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Giovanni Tangianu 2025-01-29T13:24:38.713Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date


Signature


6- CLEARANCE APPROVAL

Name

Date

Signature

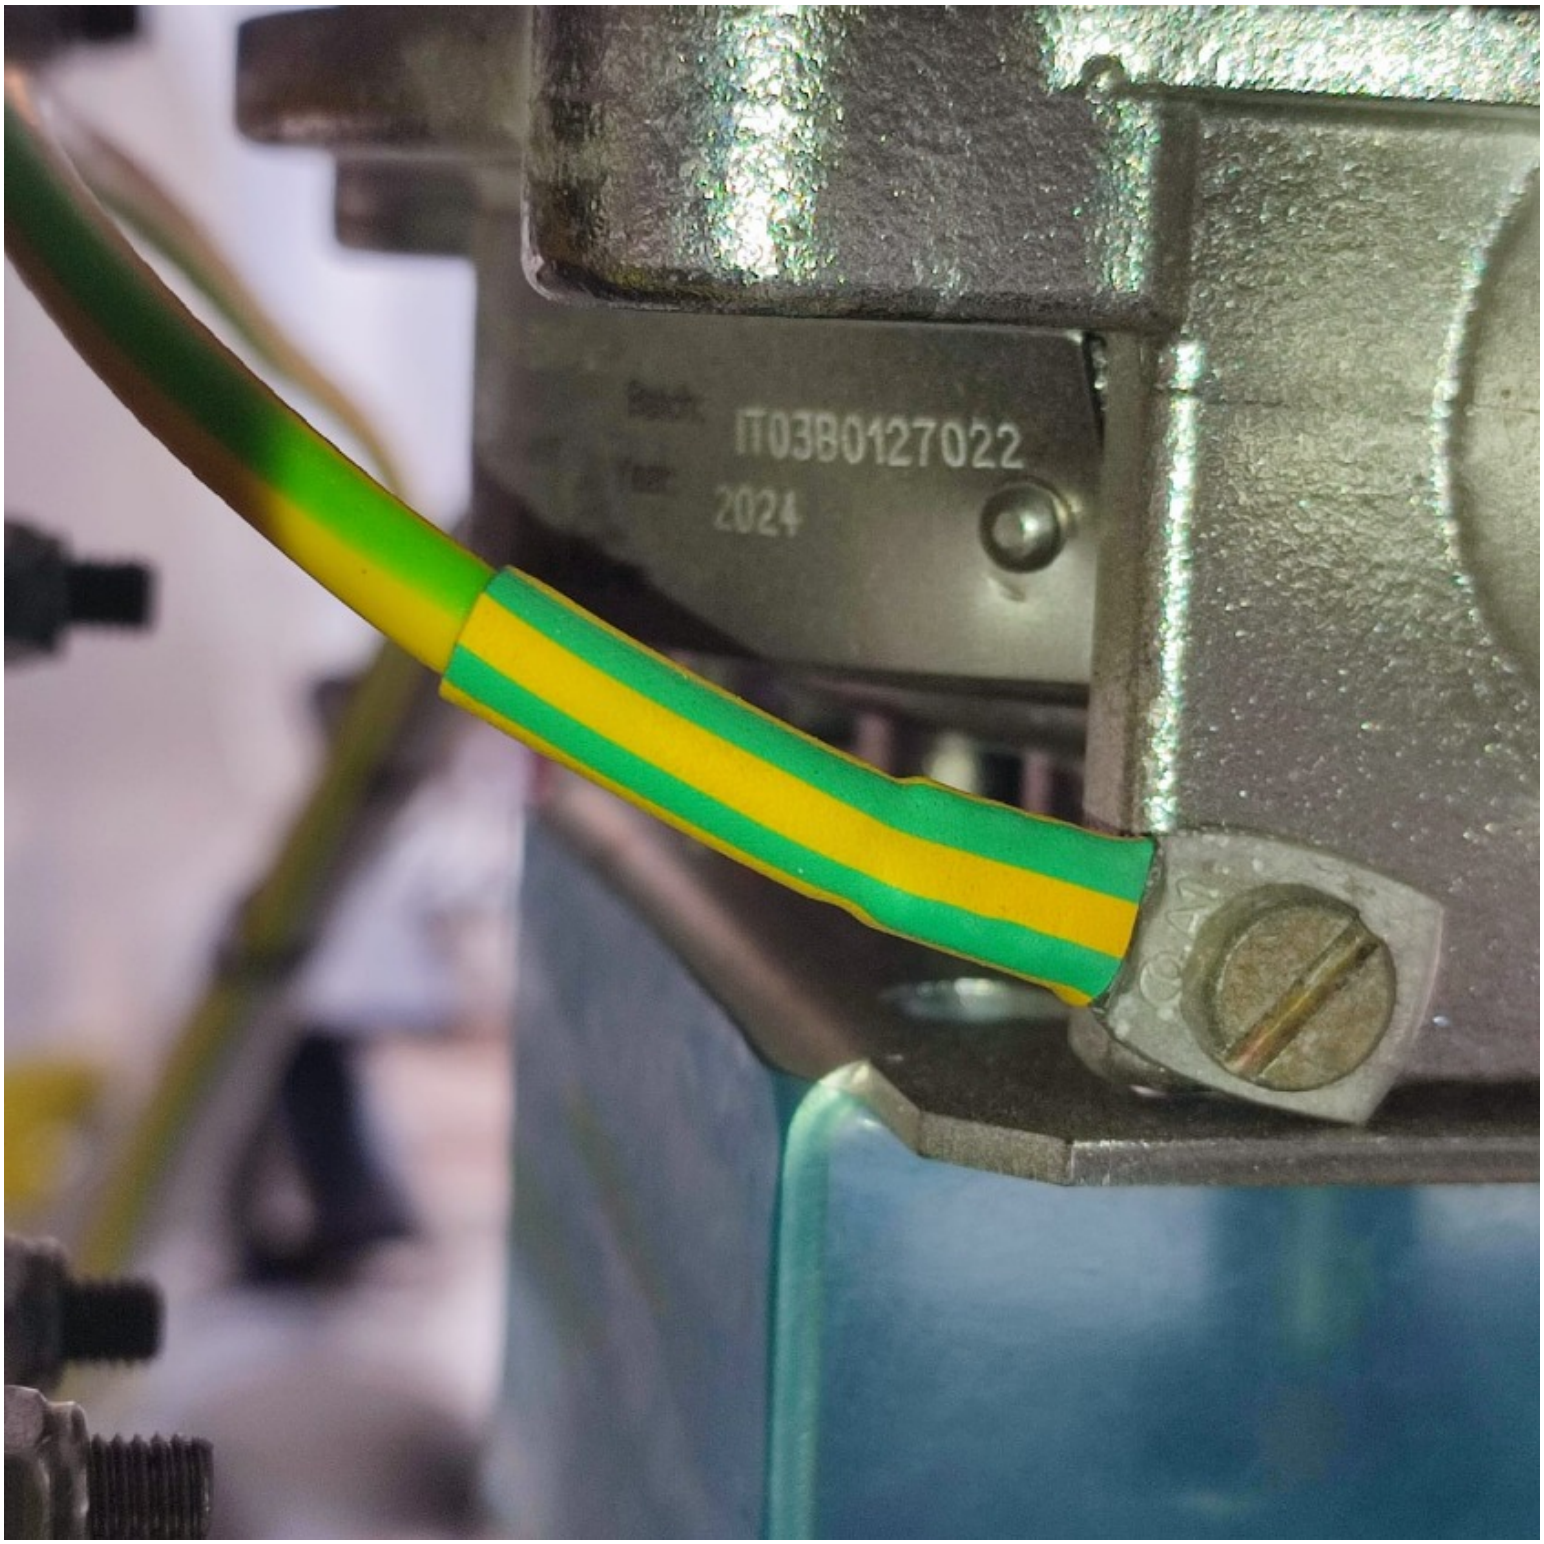
IT03B0127022
2024

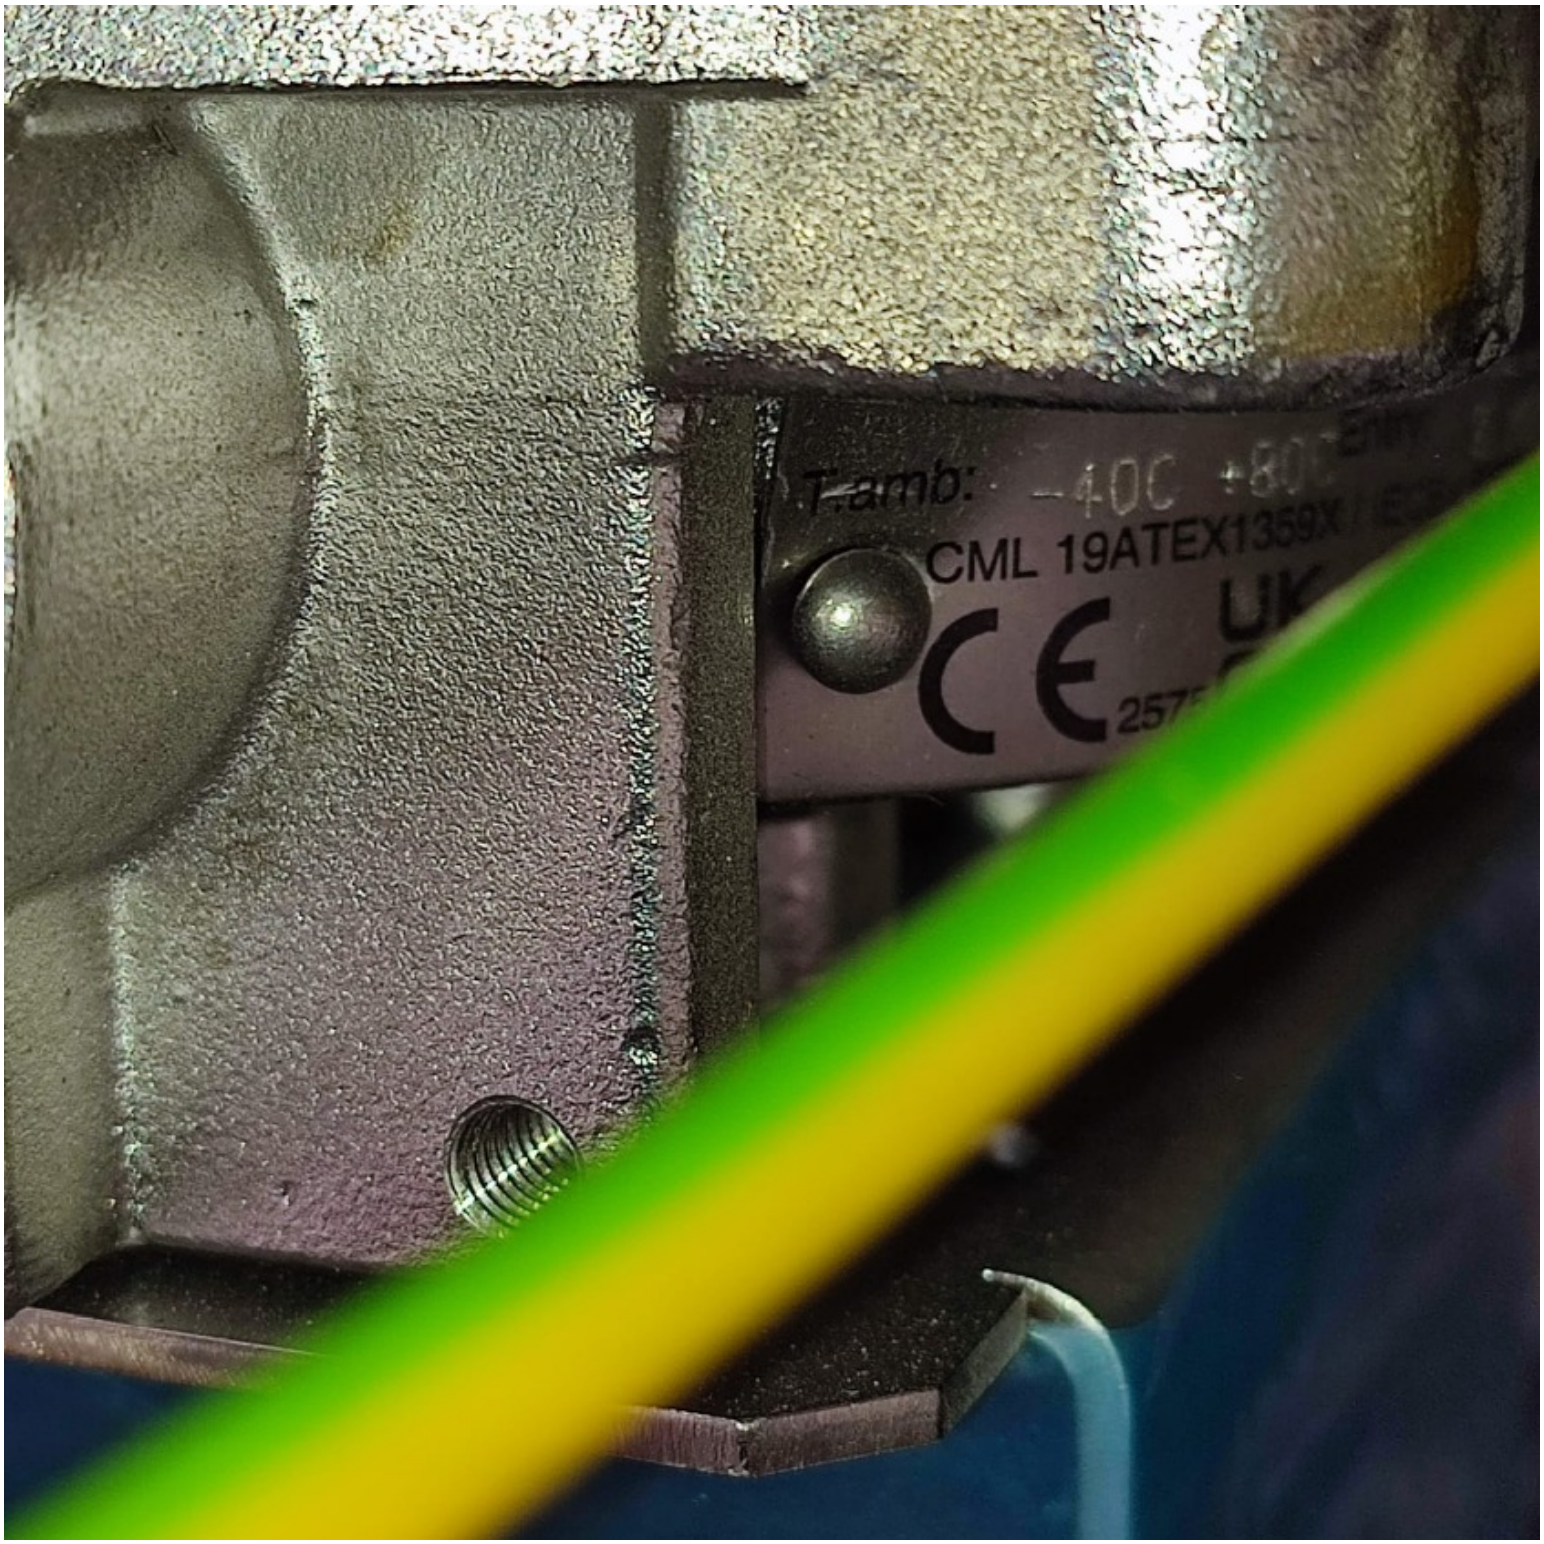
T.amb: -40C
CML 19ATEX1359X
UK

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003300

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001720	1.4 Discipline	ATEX
1.2 Item	25-XY-014		Solenoid Valve - Vessel V-25001D Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field.See attached photo.

Name: Giovanni Tangianu

Date: 2025-01-29

Signature: Digitaly signed by Giovanni Tangianu 2025-01-29T13:32:55.472Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2025-01-29
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Giovanni Tangianu 2025-01-29T13:33:08.508Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature


GYJ19.1148X
IECEx BAS10.0008
KTL-12-KB4B0-0213
Baseefa10ATEX0026
BAS21UKEX0642
UK CA 1180
T4 T135°C (-60°C≤ Tamb ≤ +90°C)
T5 T100°C (-60°C≤ Tamb ≤ +55°C)
T6 T85°C (-60°C≤ Tamb ≤ +40°C)
Ex db IIC Gb
Ex tb IIIC Db
0598
NEMA 4X/IP66 IP67
II 2 GD
IEC Ex BAS 963
DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE MAY BE PRESENT
爆炸性环境时禁开盖
COVER SCREW 44-70 MINIMUM
USE SUPPLY WIRE SUITABLE FOR AT LEAST 90°C@T6/105°C@T5/150°C@T4
VOLTAGE./额定电压：
SERIAL No./序列号：
MODEL No./型号：
英国制造
Bifold
OL9 9XA ENGLAND

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003301

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001722	1.4 Discipline	ATEX
1.2 Item	25-XY-017		Solenoid Valve - Vessel V-25001E Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field . See attached photo.

Name: Giovanni Tangianu

Date: 2025-01-29

Signature: Digitaly signed by Giovanni Tangianu 2025-01-29T13:41:35.851Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2025-01-29
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Giovanni Tangianu 2025-01-29T13:41:51.007Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date


Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

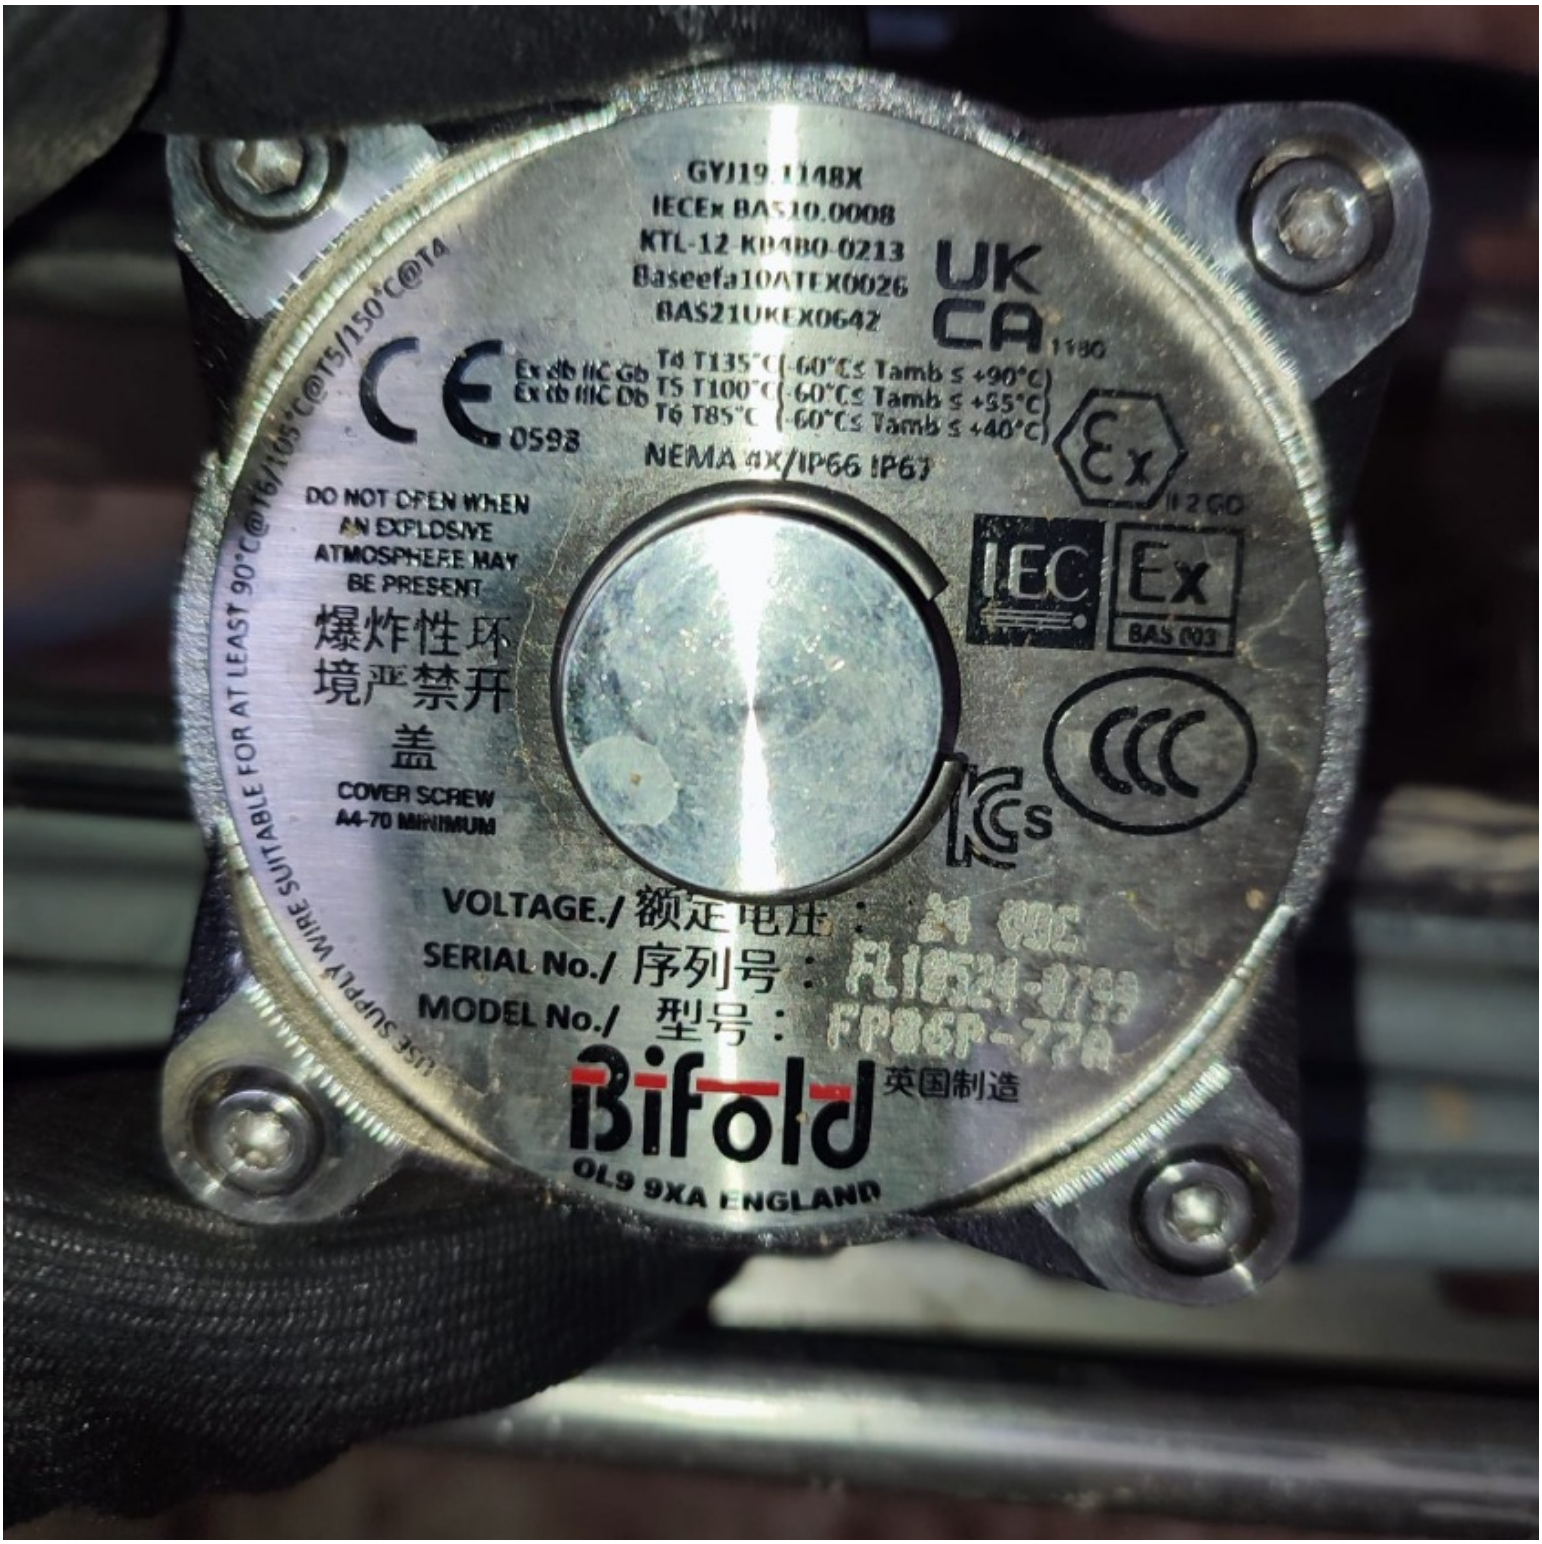
GYJ19 1148X
IECEx BAS10.0008
KTL-12-KD480-0213
Baseefa10ATEX0026
BAS21UKEX0642
UK CA
1180
Ex db IIC Gb
Ex tb IIIC Db
T4 T135°C (-60°C≤ Tamb ≤ +90°C)
T5 T100°C (-60°C≤ Tamb ≤ +55°C)
T6 T85°C (-60°C≤ Tamb ≤ +40°C)
0598
NEMA 4X/IP66 IP67
II 2 GD
DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE MAY BE PRESENT
爆炸性环境严禁开盖
COVER SCREW A4-70 MINIMUM
USE SUPPLY WIRE SUITABLE FOR AT LEAST 90°C@T6/105°C@T5/150°C@T4
IEC Ex
BAS 03
VOLTAGE./ 额定电压：
SERIAL No./ 序列号：
MODEL No./ 型号：
FP66P-77A
Bifold
英国制造
OL9 9XA ENGLAND

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003302

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001724	1.4 Discipline	ATEX
1.2 Item	25-XY-020		Solenoid Valve - Vessel V-25001F Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field.
See attached photo.

Name: Giovanni Tangianu

Date: 2025-01-29

Signature: Digitaly signed by Giovanni Tangianu 2025-01-29T13:50:50.529Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2025-01-29
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Giovanni Tangianu 2025-01-29T13:51:04.785Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature


T4 T135°C -60°C≤ Tamb ≤ +90°C
T5 T100°C -60°C≤ Tamb ≤ +55°C
T6 T85°C -50°C≤ Tamb ≤ +40°C
0598
II 2 GD
IEC Ex
BAS 003
DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE MAY BE PRESENT
爆炸性环境严禁开盖
COVER SCREW A4-70 MINIMUM
VOLTAGE./ 额定电压：
SERIAL No./ 序列号：
MODEL No./ 型号：
Bifold
英国制造
OL9 9XA ENGLAND

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003324

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10002039	1.4 Discipline	ATEX
1.2 Item	25-ZSHL-024		Limit Switch Box - Hyrogen to Vessels Inlet Header Vent System
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)

Name: Alessio Polo

Date: 2025-01-30

Signature: Digitaly signed by Alessio Polo 2025-01-30T10:59:08.756Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Alessio Polo 2025-01-30T10:59:20.816Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date


Signature


6- CLEARANCE APPROVAL

Name

Date

Signature

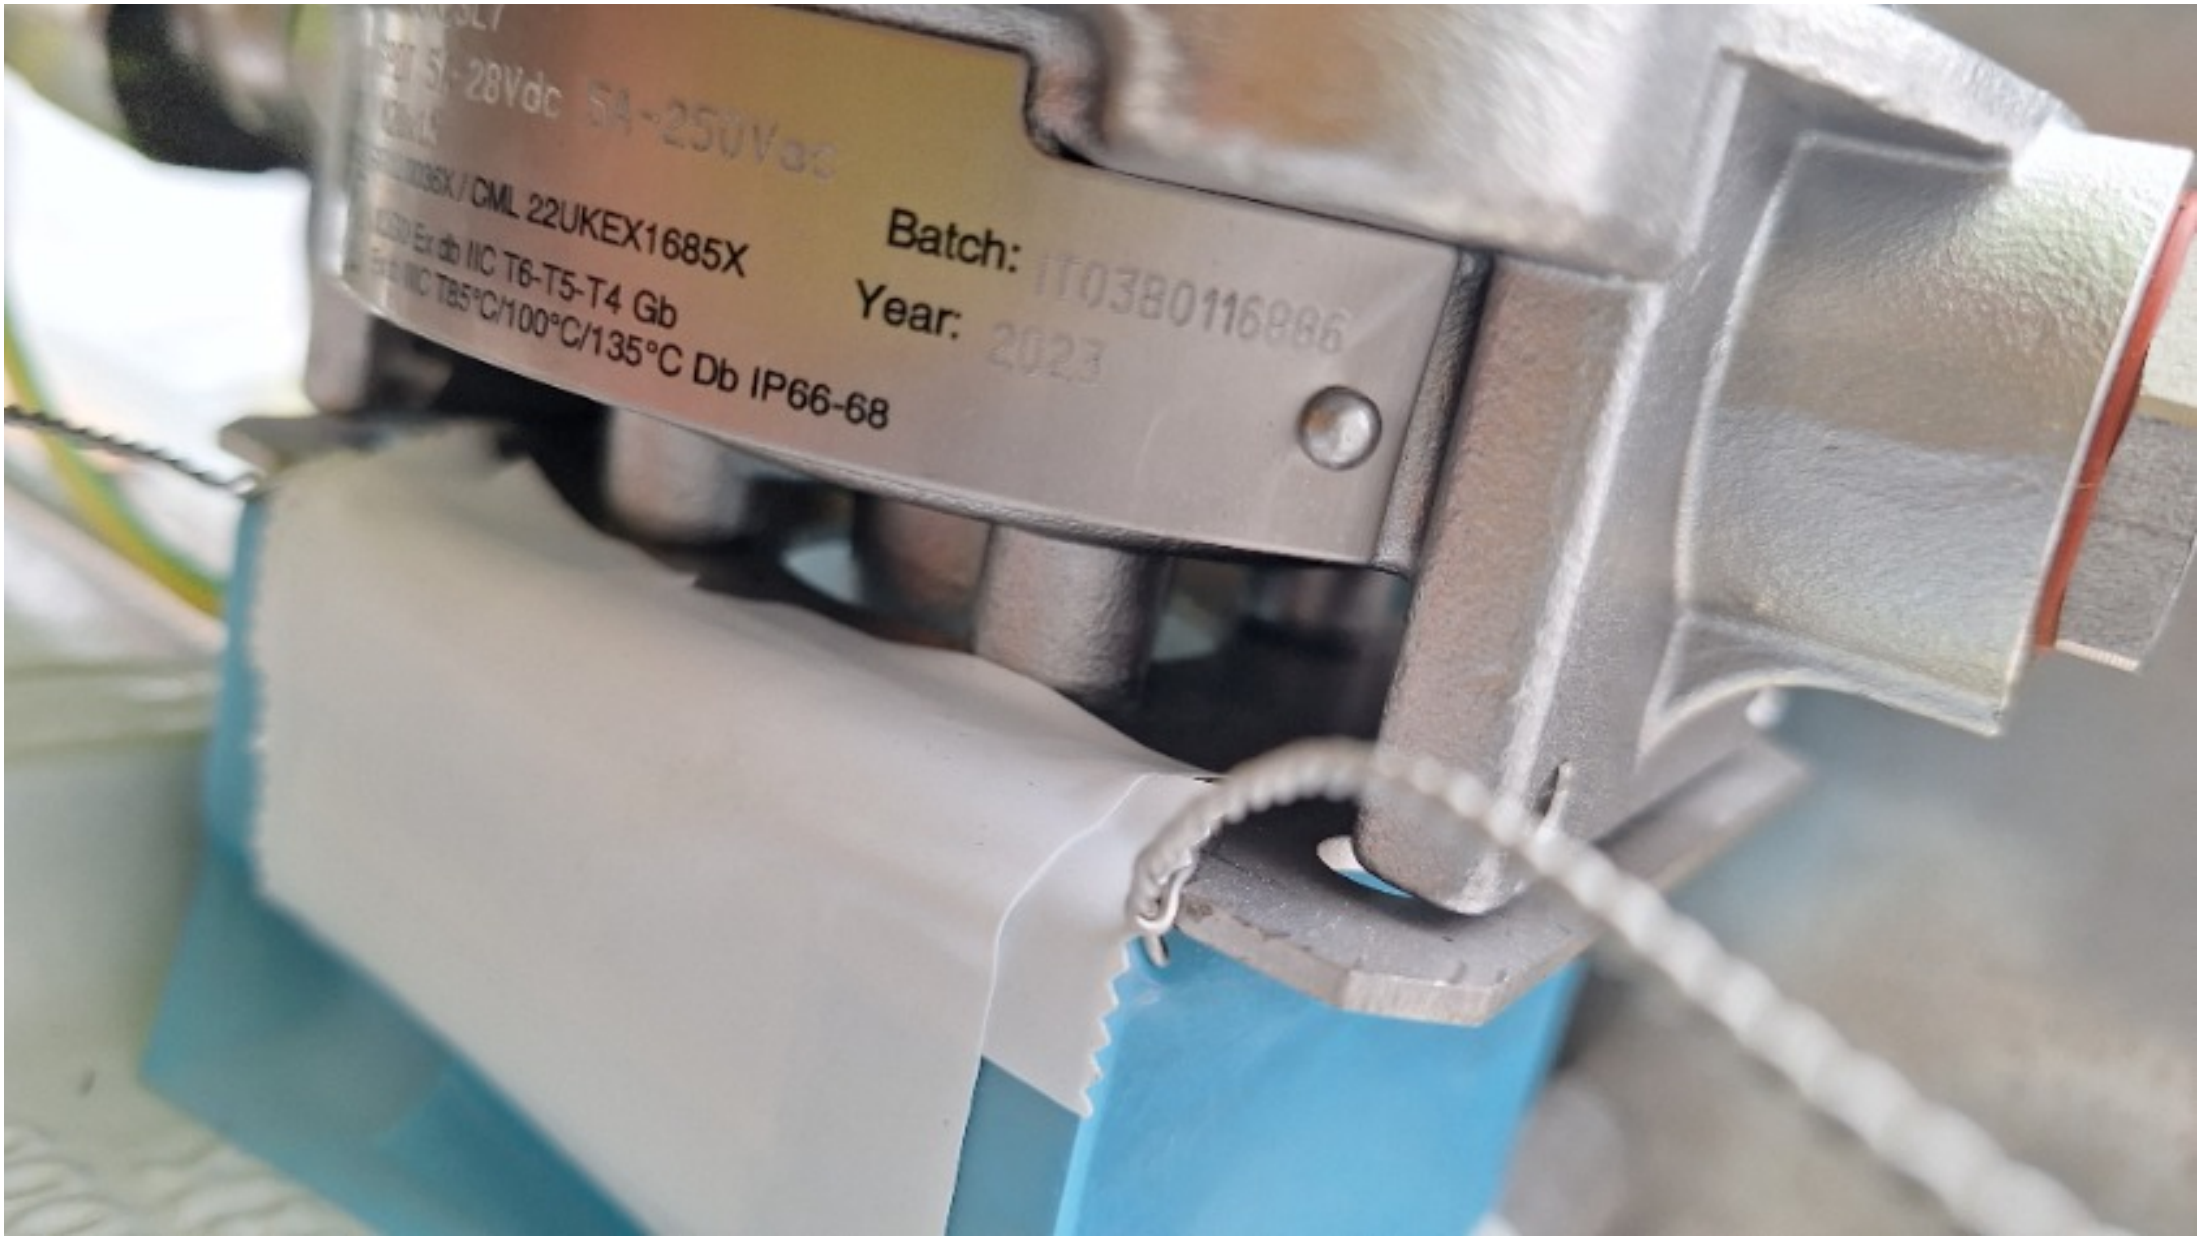
28Vdc 5A-250Vac
CML 22UKEX1685X
Batch:
Year:
2023
Ex db IIC T6-T5-T4 Gb
IIIC T85°C/100°C/135°C Db IP66-68

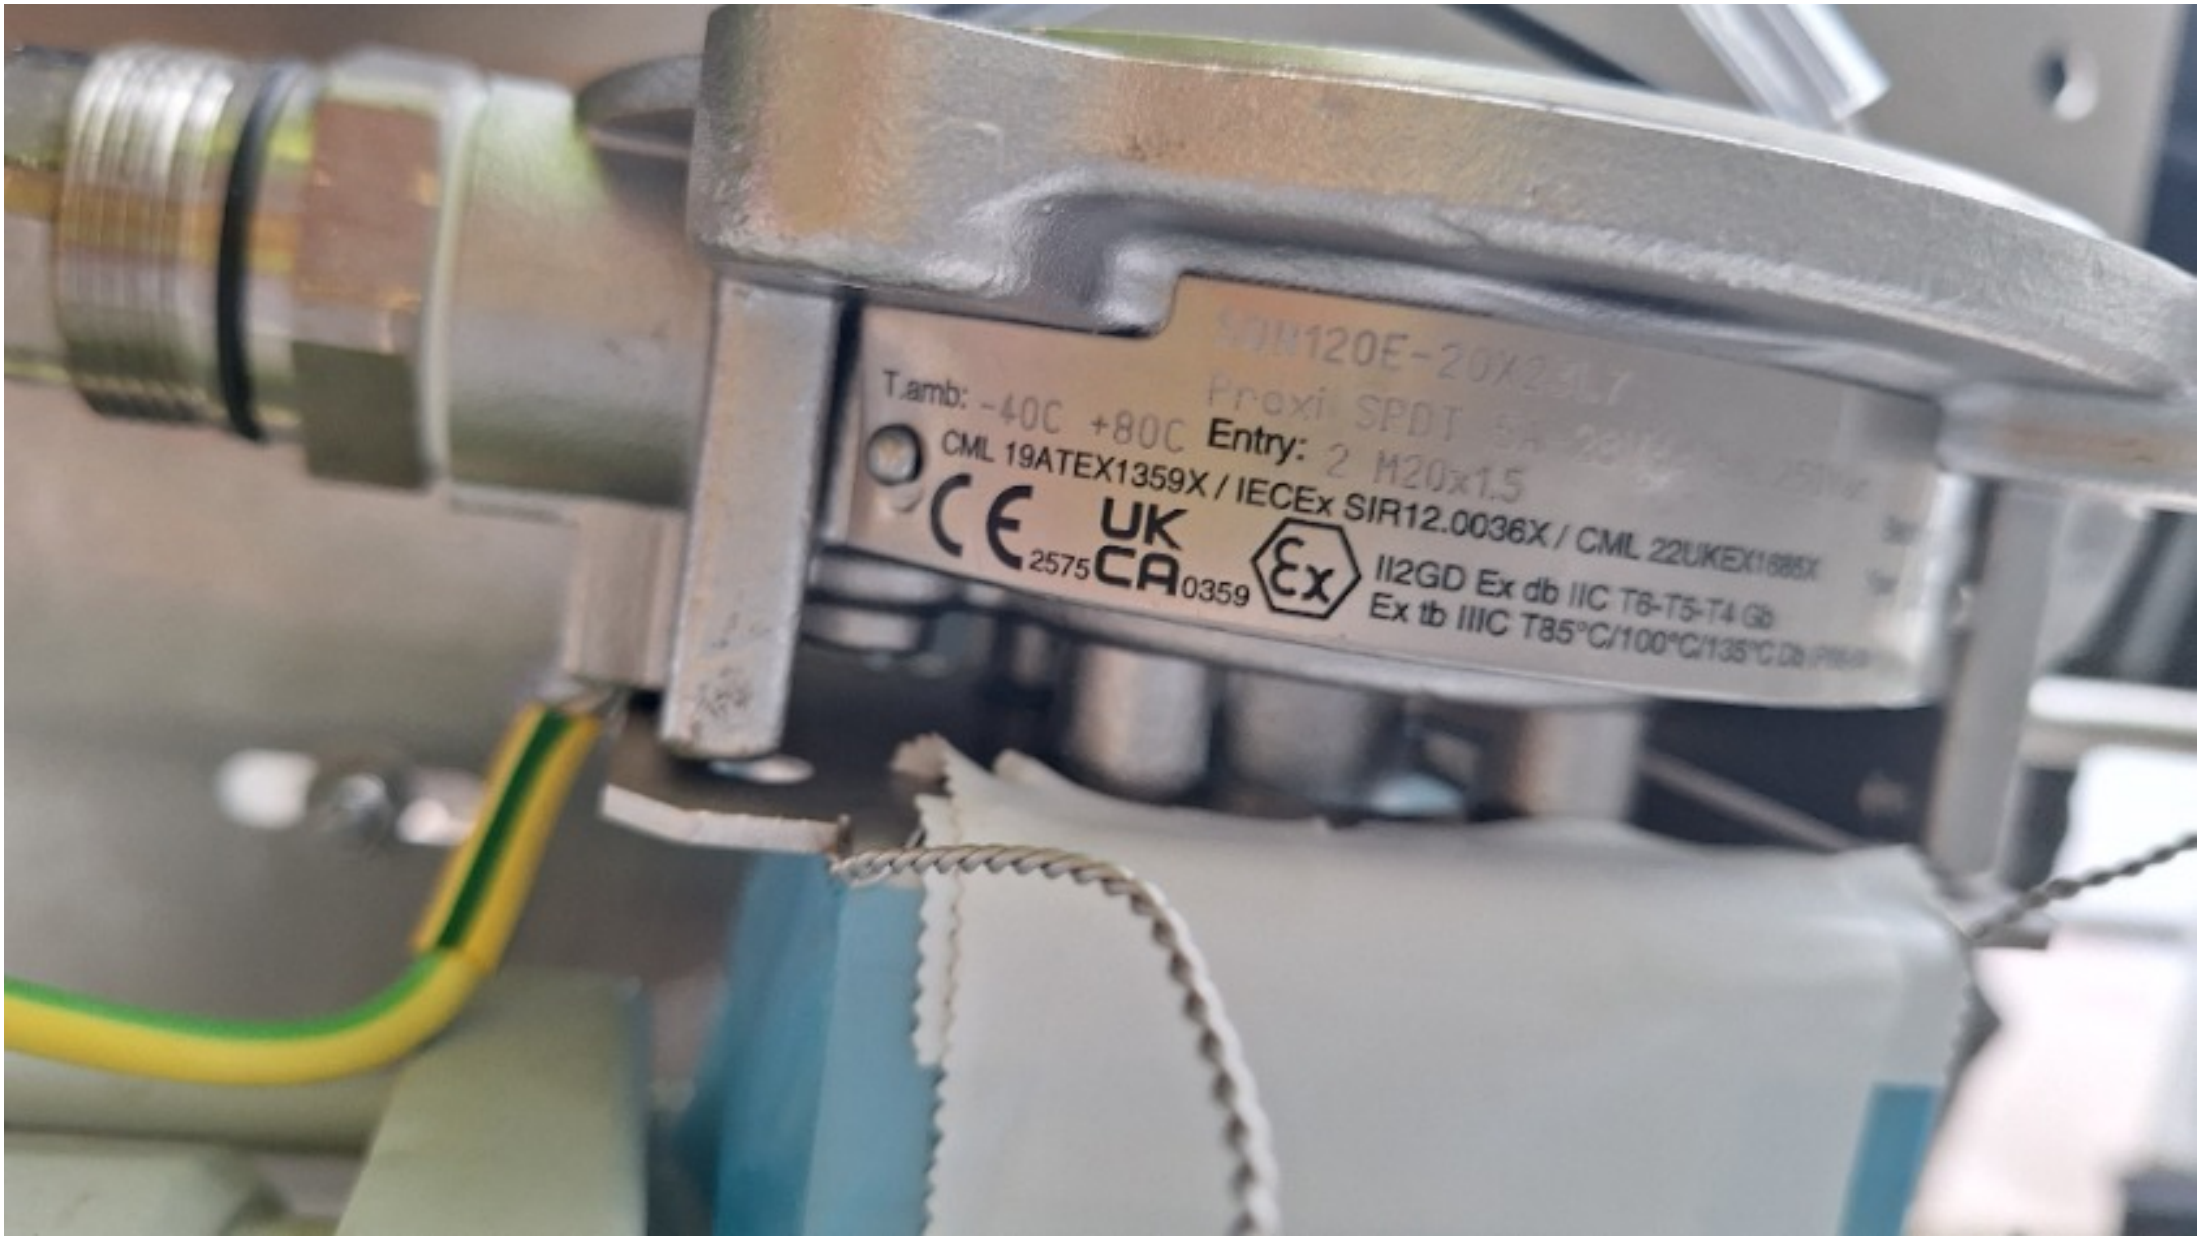
T.amb: -40C +80C
Entry: 2 M20x1.5
CML 19ATEX1359X / IECEx SIR12.0036X / CML 22UKEX1885X
CE 2575
UK CA 0359
II2GD Ex db IIC T6-T5-T4 Gb
Ex tb IIIC T85°C/100°C/135°C Db

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003326

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001590	1.4 Discipline	ATEX
1.2 Item	25-XV-004		On-Off Actuated Ball Valve - Vessel V-25001A Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufactuer, Atex certificate, SN, Atex marking etc. are missing or wrong.

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T11:09:48.420Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-30T11:11:12.917Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003328

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001592	1.4 Discipline	ATEX
1.2 Item	25-XV-008		On-Off Actuated Ball Valve - Vessel V-25001B Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T11:15:26.712Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-30T11:15:59.648Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003330

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001594	1.4 Discipline	ATEX
1.2 Item	25-XV-011		On/Off Valve - Vessel V-25001C Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T11:21:46.071Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-30T11:21:57.191Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003333

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001596	1.4 Discipline	ATEX
1.2 Item	25-XV-014		On/Off Valve - Vessel V-25001D Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T11:30:43.410Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-30T11:30:53.359Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003335

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001598	1.4 Discipline	ATEX
1.2 Item	25-XV-017		On/Off Valve - Vessel V-25001E Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T11:36:21.257Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-30T11:36:31.311Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003337

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001600	1.4 Discipline	ATEX
1.2 Item	25-XV-020		On/Off Valve - Vessel V-25001F Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T11:40:03.173Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-30T11:40:12.086Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003338

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001726	1.4 Discipline	ATEX
1.2 Item	25-ZSHL-001		Limit Switch Box - Hyrogen to Vessels Inlet Header Shut-Down
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)

Name: Alessio Polo

Date: 2025-01-30

Signature: Digitaly signed by Alessio Polo 2025-01-30T12:14:55.258Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-01-30T12:15:07.724Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature


6- CLEARANCE APPROVAL

Name

Date

Signature


SQN120E-20X
Proxi SPDT 5A-28
T.amb: +80C Entry: 2 M20x1.5
CML 19ATEX1359X / IECEx SIR12.00 6X / CML 22UKEX1
2575 UK CA 0359
II2GD Ex db IIC T6-T5-T4 Gb
Ex tb IIIC T85°C/100°C/135°C

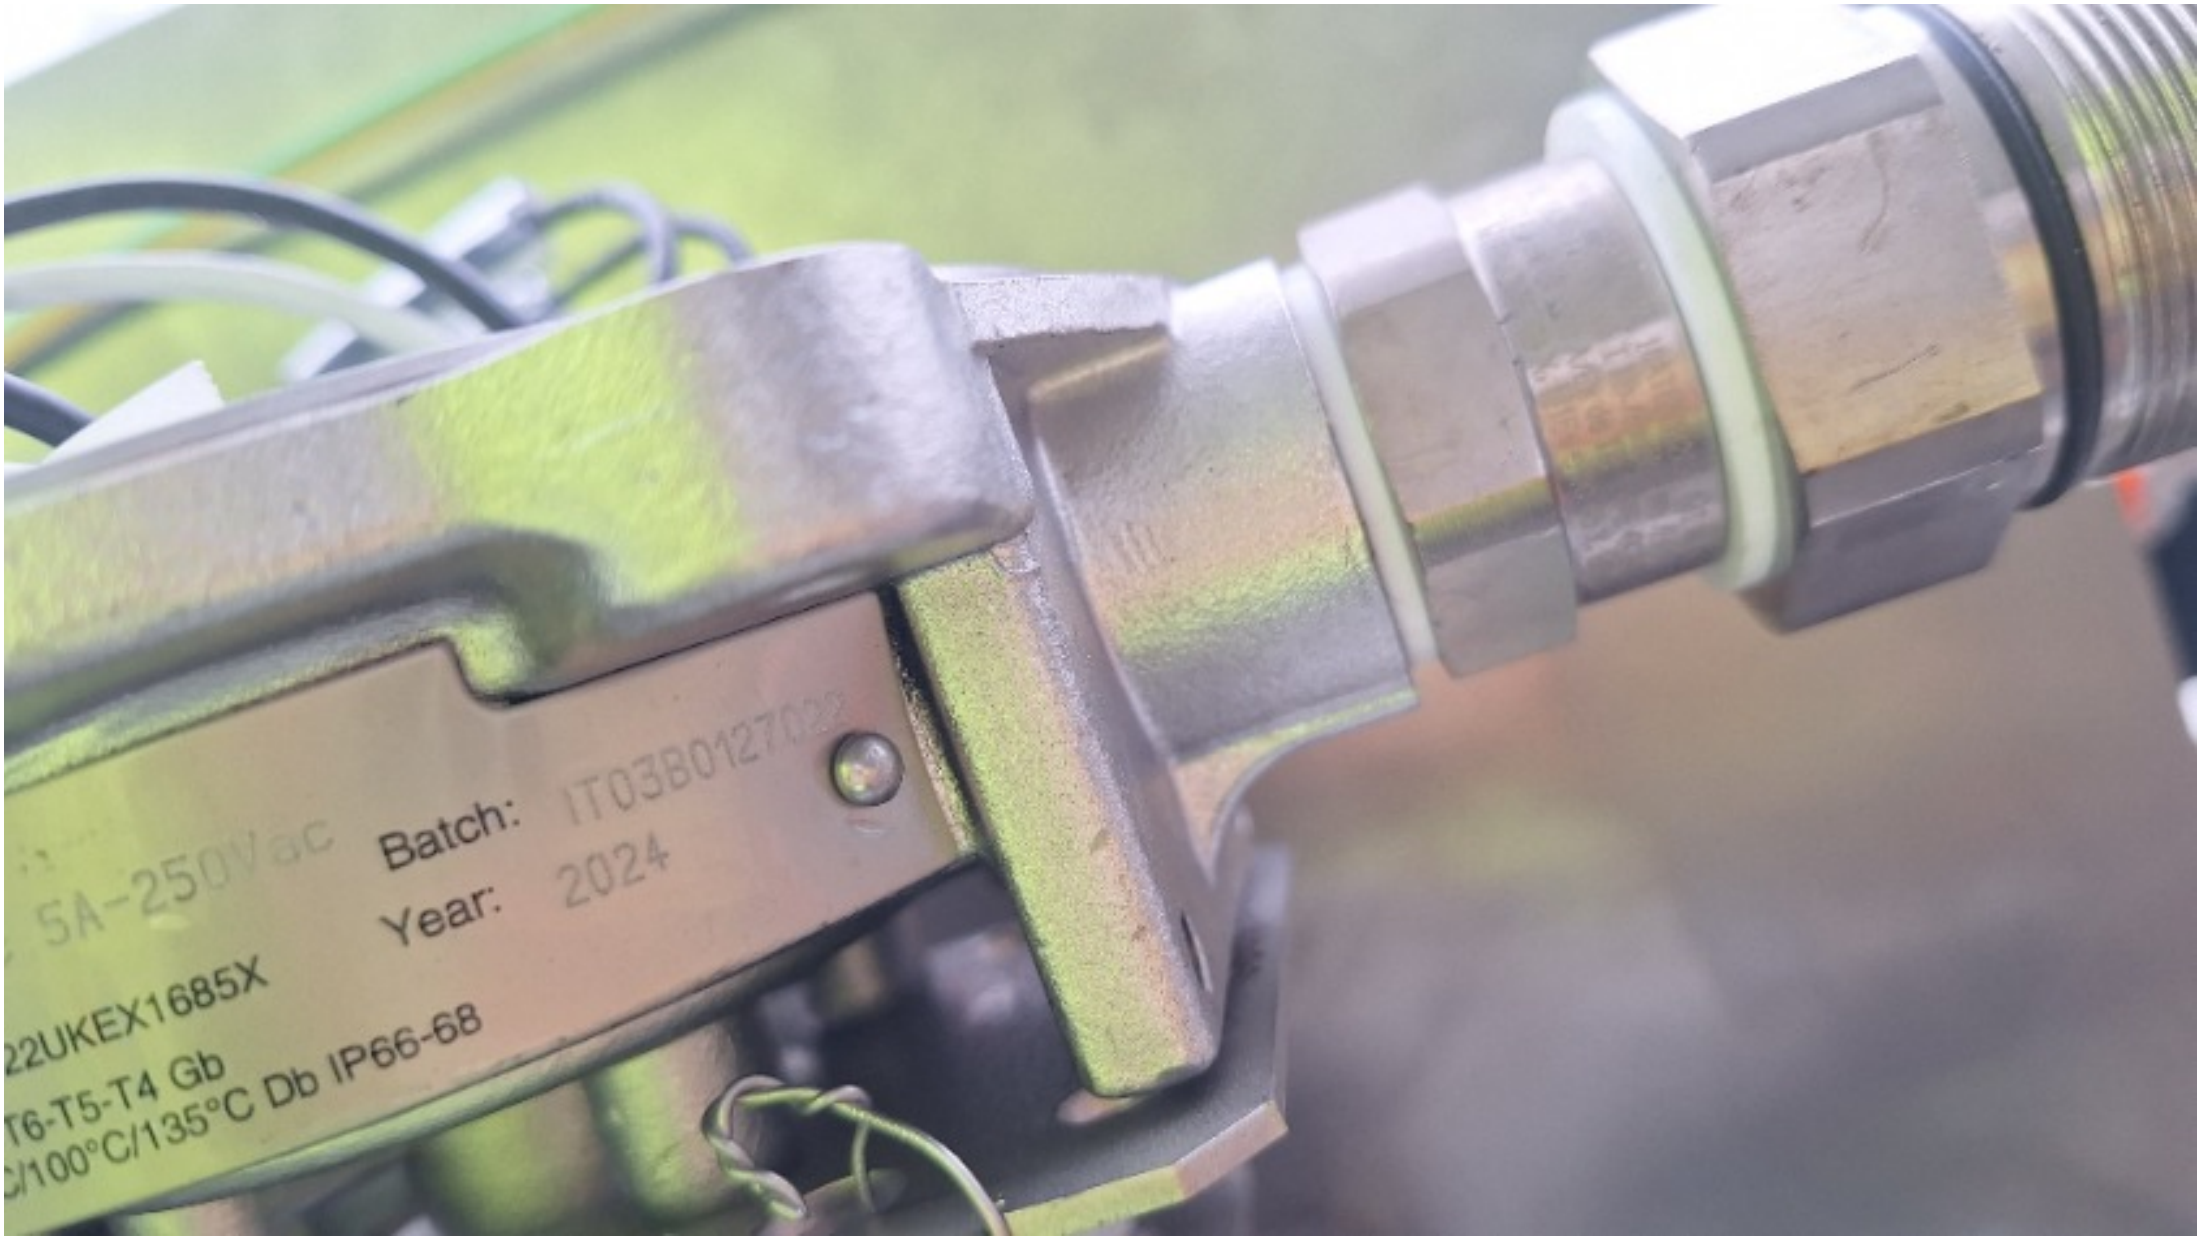
SA-250V ac
Batch: IT03B0127022
Year: 2024
22UKEX1685X
T6-T5-T4 Gb
C/100°C/135°C Db IP66-68

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003365

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001755	1.4 Discipline	ATEX
1.2 Item	25-PCV-004		Air Set Filter - Vessel V-25001A Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register Model, SN, Atex data are missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:05:05.806Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:07:00.253Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003372

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001757	1.4 Discipline	ATEX
1.2 Item	25-PCV-008		Air Set Filter - Vessel V-25001B Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register equipment model, SN and Atex execution are missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:11:08.922Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:11:20.616Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003378

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001759	1.4 Discipline	ATEX
1.2 Item	25-PCV-011		Air Set Filter - Vessel V-25001C Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register equipment model, SN and Atex execution are missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:13:04.709Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:13:22.004Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003381

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001761	1.4 Discipline	ATEX
1.2 Item	25-PCV-014		Air Set Filter - Vessel V-25001D Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register equipment model, SN and Atex execution are missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:14:39.310Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:14:51.154Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003385

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001763	1.4 Discipline	ATEX
1.2 Item	25-PCV-017	Air Set Filter - Vessel V-25001E Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

On ATEX register equipment model, SN and Atex execution are missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:19:36.579Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:19:48.686Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003393

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001765	1.4 Discipline	ATEX
1.2 Item	25-PCV-020	Air Set Filter - Vessel V-25001F Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

On ATEX register equipment model, SN and Atex execution are missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:23:05.366Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:23:17.798Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003408

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001602	1.4 Discipline	ATEX
1.2 Item	25-XV-024		On/Off Valve - Hyrogen to Vessels Inlet Header Vent System
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.

Name: Luca Mussi

Date: 2025-01-31

Signature: Digitaly signed by Luca Mussi 2025-01-31T09:28:44.317Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-31T09:28:57.197Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003409

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10002040	1.4 Discipline	ATEX
1.2 Item	25-PCV-024		Air Set Filter - Nitrogen to Distribution Header Shut-Down
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register Model, SN, Atex data are missing

Name: Luca Mussi

Date: 2025-01-31

Signature: Digitaly signed by Luca Mussi 2025-01-31T09:43:14.843Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-31T09:43:27.027Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003413

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001588	1.4 Discipline	ATEX
1.2 Item	25-SDV-001		On/Off Valve - Hyrogen to Vessels Inlet Header Shut-Down
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094 sheet 7) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.

Name: Luca Mussi

Date: 2025-01-31

Signature: Digitaly signed by Luca Mussi 2025-01-31T10:01:59.017Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-31T10:02:18.929Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003415

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10002038	1.4 Discipline	ATEX
1.2 Item	25-XY-024	Solenoid Valve - Hyrogen to Vessels Inlet Header Vent System	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)

Name: Alessio Polo

Date: 2025-01-31

Signature: Digitaly signed by Alessio Polo 2025-01-31T10:43:46.719Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Alessio Polo 2025-01-31T10:43:56.384Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature


rotork
fluid systems
25-XV-024


GY/19 1148X
IECEx BAS10.0008
KTL-12-KB480-0213
BaseefaI0ATEX0026
BAS21UKEX0642
UK CA
T4 T135°C
T5 T100°C
T6 785°C
-60°C≤ Tamb ≤ +90°C
-60°C≤ Tamb ≤ +55°C
-60°C≤ Tamb ≤ +40°C
Ex
IEC Ex
BAS 09
NEMA 4X/IP66 IP67
0598
DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE MAY BE PRESENT
爆炸性环境!禁开盖
COVER SCREW A4-70 MINIMUM
USE SUPPLY WIRE SUITABLE FOR AT LEAST 90°C@16/105°C@15/135°C@14
VOLTAGE./ 额定电压:
SERIAL No./ 序列号:
MODEL No./ 型号:
英国制造
Bifold
OL9 9XA ENGLAND

ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003429

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001754	1.4 Discipline	ATEX
1.2 Item	25-PCV-001		Air Set Filter - Hyrogen to Vessels Inlet Header Shut-Down
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register Model, SN, Atex data are missing

Name: Luca Mussi

Date: 2025-01-31

Signature: Digitaly signed by Luca Mussi 2025-01-31T12:37:13.819Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-31T12:37:24.908Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003473

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004835	1.4 Discipline	ATEX
1.2 Item	25-PSV-008		Safety Valve - Vessel V-25001B Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T10:59:40.909Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-02-03T10:59:53.076Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003474

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004837	1.4 Discipline	ATEX
1.2 Item	25-PSV-011		Safety Valve - Vessel V-25001C Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T11:00:05.103Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-02-03T11:00:17.638Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003479

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004839	1.4 Discipline	ATEX
1.2 Item	25-PSV-014		Safety Valve - Vessel V-25001D Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T11:07:29.916Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-02-03T11:07:42.984Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003485

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004841	1.4 Discipline	ATEX
1.2 Item	25-PSV-017		Safety Valve - Vessel V-25001E Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T11:16:33.776Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-02-03T11:16:48.698Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003489

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004843	1.4 Discipline	ATEX
1.2 Item	25-PSV-020		Safety Valve - Vessel V-25001F Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T12:25:45.093Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-02-03T12:25:58.972Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003493

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004845	1.4 Discipline	ATEX
1.2 Item	25-PSV-024		Safety Valve - Hyrogen to Vessels Inlet Header Vent System
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T12:32:17.044Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-02-03T12:32:32.788Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003497

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004849	1.4 Discipline	ATEX
1.2 Item	25-PSV-001		Safety Valve - Hyrogen to Vessels Inlet Header Shut-Down
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T12:35:55.407Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-02-03T12:36:07.087Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003505

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004833	1.4 Discipline	ATEX
1.2 Item	25-PSV-004		Safety Valve - Vessel V-25001A Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094) equipment is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T12:42:23.291Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-02-03T12:42:34.611Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003564

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001718	1.4 Discipline	ATEX
1.2 Item	25-XY-011		Solenoid Valve - Vessel V-25001C Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)

Name: Alessio Polo

Date: 2025-02-05

Signature: Digitaly signed by Alessio Polo 2025-02-05T16:23:30.968Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-02-05
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Alessio Polo 2025-02-05T16:23:41.247Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature


GYJ19.1148X
IECEx BAS10.0008
KTL-12-KB480-0211
Baseefa10ATEX0026
BAS21UKEX0642
UK CA
0598
T4 T135°C(-60°C≤ Tamb ≤+90°C)
T5 T100°C(-60°C≤ Tamb ≤+55°C)
T6 T85°C(-60°C≤ Tamb ≤+40°C)
DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE MAY BE PRESENT
爆炸性环境严禁开盖
COVER SCREW A4-70 MINIMUM
USE SUPPLY WIRE SUITABLE FOR AT LEAST 90°C@T6/105°C@T5/150°C@TA
VOLTAGE./ 额定电压：
SERIAL No./ 序列号：
MODEL No./ 型号：
Bifold
英国制造
OL9 9XA ENGLAND

ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003566

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001735	1.4 Discipline	ATEX
1.2 Item	25-ZSHL-017		Limit Switch Box - Vessel V-25001E Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)

Name: Alessio Polo

Date: 2025-02-05

Signature: Digitaly signed by Alessio Polo 2025-02-05T16:38:34.407Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-02-05
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Alessio Polo 2025-02-05T16:38:56.896Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature


25-ZSL-017
25-ZSH-017


5A-250Vac
Batch:
Year
CML 22UKEX1685X
IIC T6-T5-T4 Gb
T85°C/100°C/135°C Db IP66-68

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003568

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001712	1.4 Discipline	ATEX
1.2 Item	25-SDY-001	Solenoid Valve - Hyrogen to Vessels Inlet Header Shut-Down	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Doc: document 123A90-DDL-EL-LIS-20094 does not report what was installed in the field (see picture)

Name: Alessio Polo

Date: 2025-02-05

Signature: Digitaly signed by Alessio Polo 2025-02-05T17:03:15.976Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-02-05
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Alessio Polo 2025-02-05T17:04:41.615Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature


UK CA
0598
DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE MAY BE PRESENT
爆炸性环境严禁开盖
COVER SCREW
VOLTAGE./ 额定电压：
SERIAL No./ 序列号：
MODEL No./ 型号：
英国制造
Bifold
OL9 9XA ENGLAND
USE SUPPLY WIRE SUITABLE FOR AT LEAST 90°C@T6/105°C@T5/150°C@T4


UK CA
CE 0598
IECEx BAS 10.0
DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE MAY BE PRESENT
爆炸性环境严禁开盖
COVER SCREW M4-70 MINIMUM
USE SUPPLY WIRE SUITABLE FOR AT LEAST 90°C @ TA/35°C @ T5/105°C @ T4
VOLTAGE./额定电压：
SERIAL No./序列号：
MODEL No./型号：
英国制造
Bifold
OL9 9XA ENGLAND

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30004108

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004794	1.4 Discipline	Piping
1.2 Item	25-07-TP-068	Test Pack 25-07-TP-068	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

The isometric is different from the field, produce a mark up.
Support PS-02136.1 is missing. There is a S-211 between EW7 and EW8, distance from EW7 is 945 mm. Structural support is Lbeam (60mm) 215mm x 245mm.
See attached for dimension

Name: Lorenzo Novaga

Date: 2025-02-25

Signature: Digitaly signed by Lorenzo Novaga 2025-02-25T07:42:44.761Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Lorenzo Novaga
3.4 Activity code	MC Mechanical Completion	Date	2025-02-25
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Lorenzo Novaga 2025-02-25T07:42:56.322Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Name

Date


Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

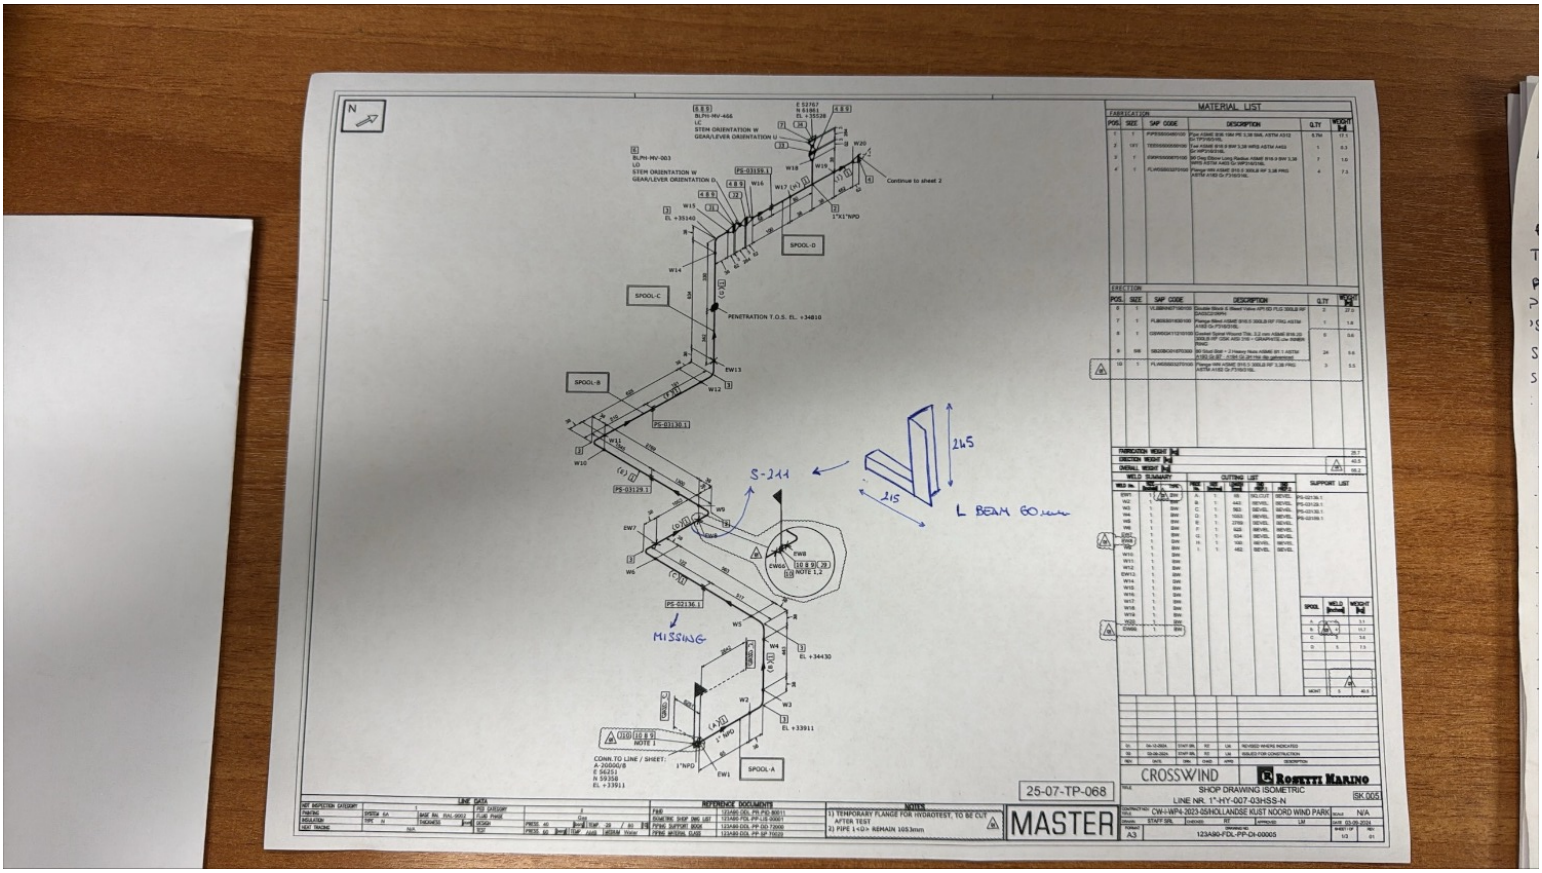
MATERIAL LIST
FABRICATION
ERECTION
CUTTING LIST
SUPPORT LIST
SPOOL-A
SPOOL-B
SPOOL-C
SPOOL-D
PENETRATION T.O.S. EL. +34810
S-211
245
215
L BEAM 60x6mm
MISSING
CONN.TO LINE / SHEET:
A-2000A/B
E 56251
N 59250
EL +33911
Continue to sheet 2
25-07-TP-068
MASTER
CROSSWIND
ROSKITTI MARINO
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-007-03HSS-N
CW-HPA-3023-03HOLLANDSE KUST NOORD WIND PARK
123AS0-FDL-PP-DI-00005
LINE SPEC
REFERENCE DOCUMENTS
NOTES
1) TEMPORARY FLANGE FOR HYDROTEST, TO BE CUT AFTER TEST
2) PIPE L=<G> REMAIN 103.3mm

ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003112

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10003277	1.4 Discipline	Piping
1.2 Item	25-07-TP-007	Test Pack 25-07-TP-007	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

For all supports S-211 the gap, the isolation rubber, the PTFE and the nuts shall be checked during the reinstatement phase.

Name: Kangi Albonetti

Date: 2025-01-21

Signature: Digitaly signed by Kangi Albonetti 2025-01-21T12:20:25.400Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Kangi Albonetti
3.4 Activity code	MC Mechanical Completion	Date	2025-01-21
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Kangi Albonetti 2025-01-21T12:20:42.676Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Activity done.

Name: Lorenzo Novaga

Date: 2025-02-07

Signature: Digitaly signed by Lorenzo Novaga 2025-02-07T12:01:35.203Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003113

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10003277	1.4 Discipline	Piping
1.2 Item	25-07-TP-007	Test Pack 25-07-TP-007	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Point n.4 of the ITR has not been checked due the fact that all valves have been removed all the alignment to terminal points are uncheckable.

Name: Kangi Albonetti

Date: 2025-01-21

Signature: Digitaly signed by Kangi Albonetti 2025-01-21T12:24:19.380Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Kangi Albonetti
3.4 Activity code	MC Mechanical Completion	Date	2025-01-21
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Kangi Albonetti 2025-01-21T12:24:39.504Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Activity done.

Name: Lorenzo Novaga

Date: 2025-02-07

Signature: Digitaly signed by Lorenzo Novaga 2025-02-07T12:02:01.867Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003280

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000120	1.4 Discipline	Instrumental
1.2 Item	C-25-XY-011/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

The bending radius is not with in the specified limits , is not fix with AISI cable ties.

Name: Alessio Polo

Date: 2025-01-29

Signature: Digitaly signed by Alessio Polo 2025-01-29T07:59:50.629Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-01-29
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-01-29T07:59:59.245Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-24

Signature: Digitaly signed by Andrea Andreani 2025-02-24T15:59:53.696Z

6- CLEARANCE APPROVAL

Name

Date

Signature

rotork
fluid systems
www.rotork.com

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003287

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001714	1.4 Discipline	ATEX
1.2 Item	25-XY-004		Solenoid Valve - Vessel V-25001A Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Missing tag SS , on Solenoid Valve.

Name: Alessio Polo

Date: 2025-01-29

Signature: Digitaly signed by Alessio Polo 2025-01-29T11:11:13.059Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-01-29
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-01-29T11:11:22.524Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-24

Signature: Digitaly signed by Andrea Andreani 2025-02-24T16:00:02.035Z

6- CLEARANCE APPROVAL

Name

Date

Signature


rotork
fluid systems

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003288

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001716	1.4 Discipline	ATEX
1.2 Item	25-XY-008		Solenoid Valve - Vessel V-25001B Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Missing tag SS , on Solenoid Valve.

Name: Alessio Polo

Date: 2025-01-29

Signature: Digitaly signed by Alessio Polo 2025-01-29T11:21:07.697Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-01-29
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-01-29T11:21:19.787Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-24

Signature: Digitaly signed by Andrea Andreani 2025-02-24T16:00:09.316Z

6- CLEARANCE APPROVAL

Name

Date

Signature


rotork
fluid systems

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003298

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000122	1.4 Discipline	Instrumental
1.2 Item	C-25-XY-017/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

The cable need a support near the valve 25-XY-017. See attached photo.

Name: Giovanni Tangianu

Date: 2025-01-29

Signature: Digitaly signed by Giovanni Tangianu 2025-01-29T13:12:52.811Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2025-01-29
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Giovanni Tangianu 2025-01-29T13:13:04.057Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-07

Signature: Digitaly signed by Andrea Andreani 2025-02-07T15:09:08.605Z

6- CLEARANCE APPROVAL

Name

Date

Signature


rotary
fluid systems
25-XV-017

ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003305

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001720	1.4 Discipline	ATEX
1.2 Item	25-XY-014	Solenoid Valve - Vessel V-25001D Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Missing tag plate SS on the solenoid valve.(25-XY-014).

Name: Giovanni Tangianu

Date: 2025-01-29

Signature: Digitaly signed by Giovanni Tangianu 2025-01-29T15:17:49.374Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2025-01-29
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Giovanni Tangianu 2025-01-29T15:18:33.574Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-21

Signature: Digitaly signed by Andrea Andreani 2025-02-21T10:47:24.380Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003306

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001722	1.4 Discipline	ATEX
1.2 Item	25-XY-017		Solenoid Valve - Vessel V-25001E Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Missing tag plate SS on the solenoid valve.(25-XY-017).

Name: Giovanni Tangianu

Date: 2025-01-29

Signature: Digitaly signed by Giovanni Tangianu 2025-01-29T15:18:52.935Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2025-01-29
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Giovanni Tangianu 2025-01-29T15:19:06.678Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-21

Signature: Digitaly signed by Andrea Andreani 2025-02-21T10:47:32.496Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003307

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001724	1.4 Discipline	ATEX
1.2 Item	25-XY-020		Solenoid Valve - Vessel V-25001F Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Missing tag plate SS on the solenoid valve.(25-XY-020).

Name: Giovanni Tangianu

Date: 2025-01-29

Signature: Digitaly signed by Giovanni Tangianu 2025-01-29T15:19:37.572Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2025-01-29
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Giovanni Tangianu 2025-01-29T15:19:48.046Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-21

Signature: Digitaly signed by Andrea Andreani 2025-02-21T10:47:40.602Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003310

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000102	1.4 Discipline	Instrumental
1.2 Item	C-25-XV-024/00-JE-12005	PROXIMITY SWITCH / MARSHALLING PCS	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

The cable is not support .

Name: Alessio Polo

Date: 2025-01-30

Signature: Digitaly signed by Alessio Polo 2025-01-30T10:08:19.960Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-01-30T10:08:29.924Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Josip Krizanic

Date: 2025-03-05


Signature: Digitaly signed by Josip Krizanic 2025-03-05T15:48:13.718Z


6- CLEARANCE APPROVAL

Name

Date

Signature

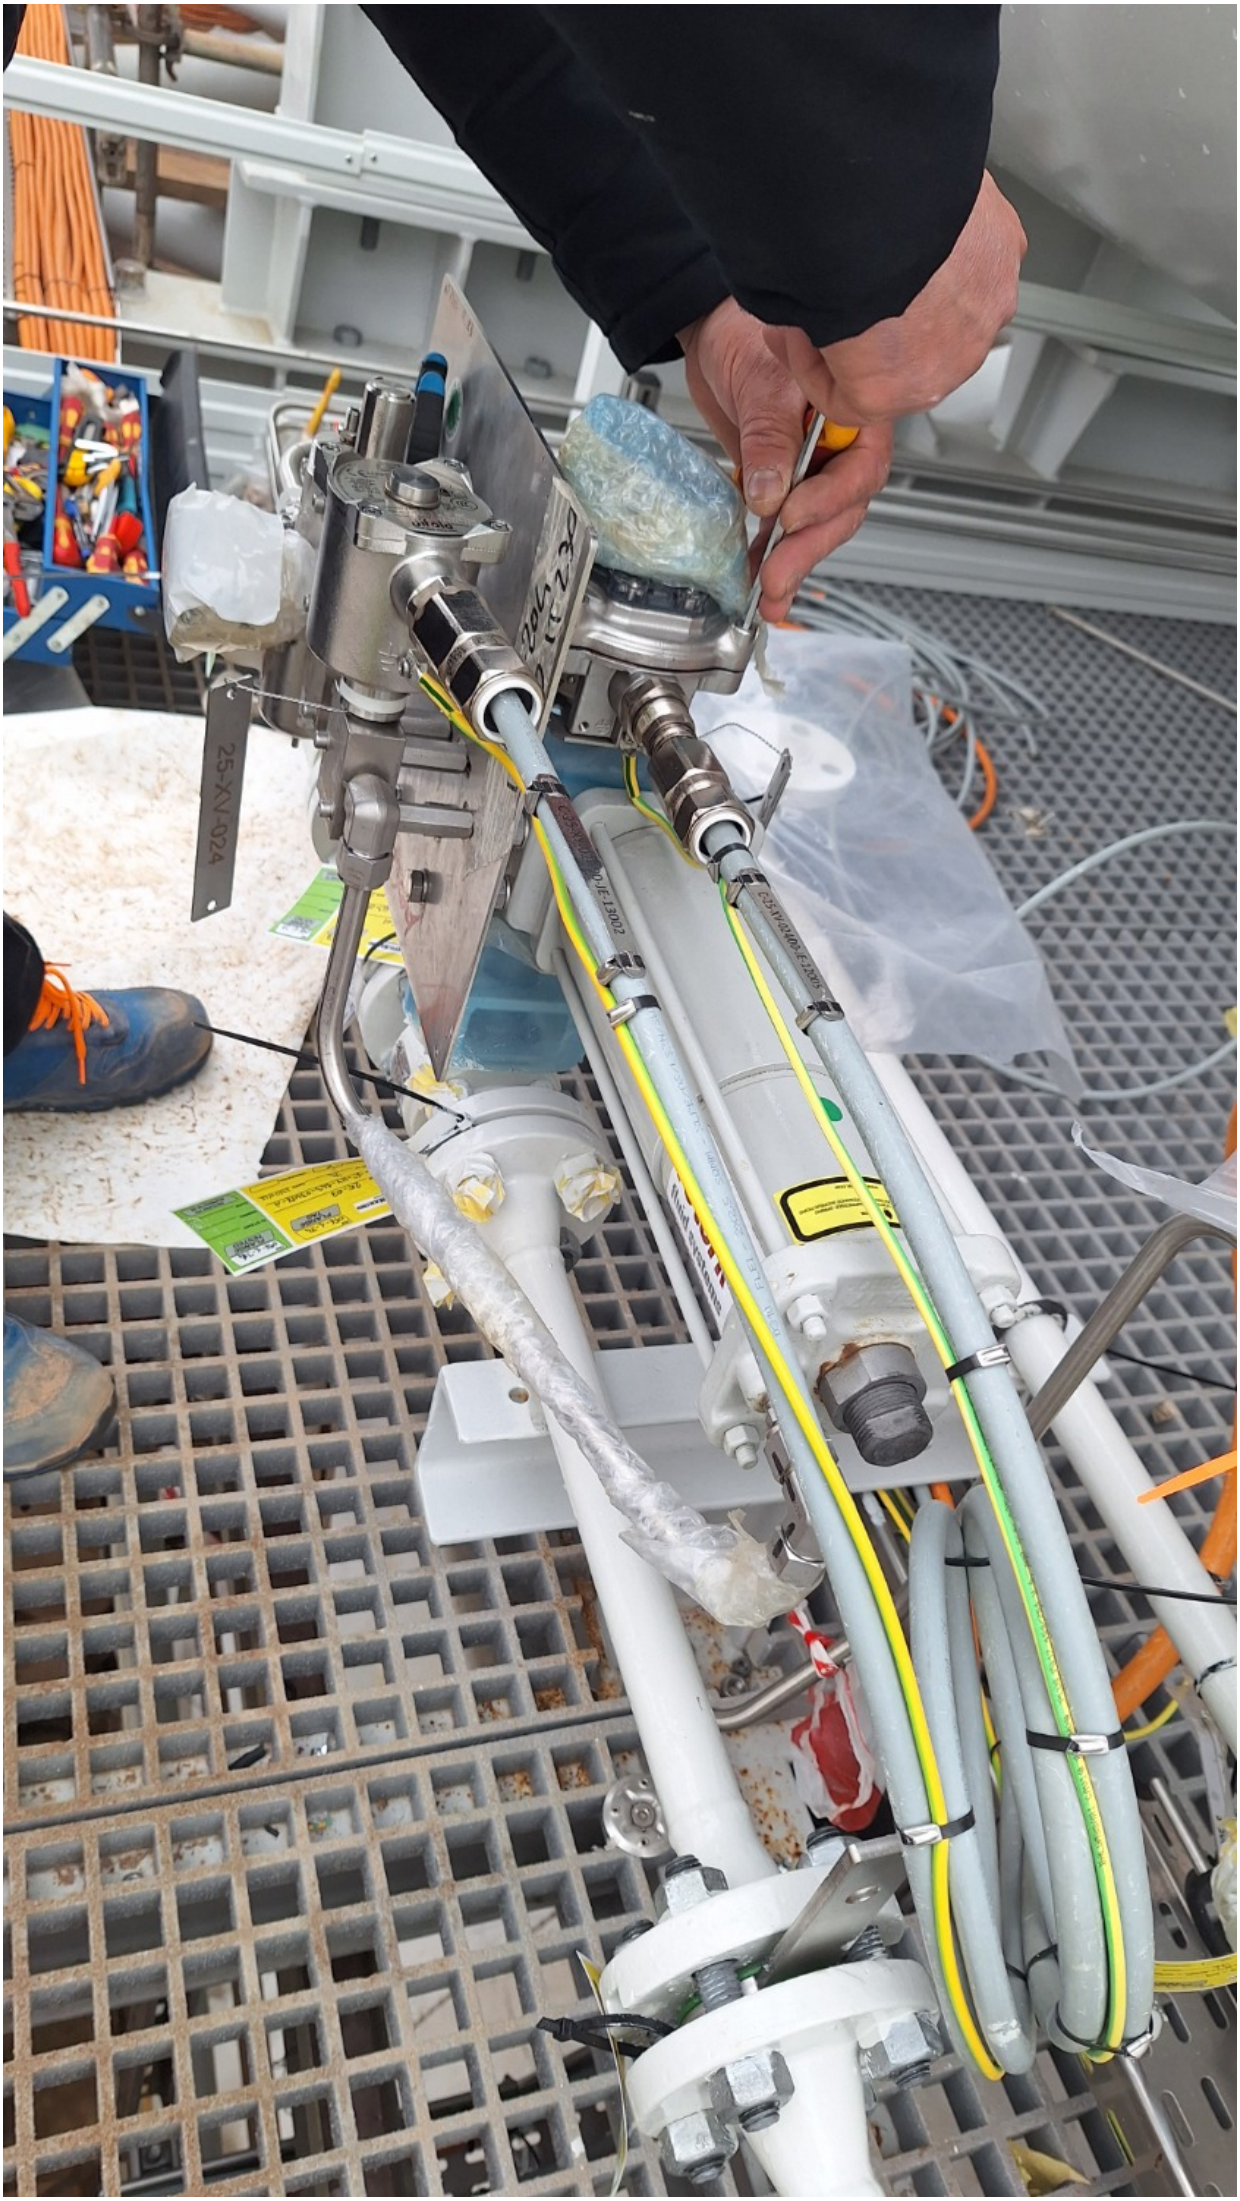
25-XV-024

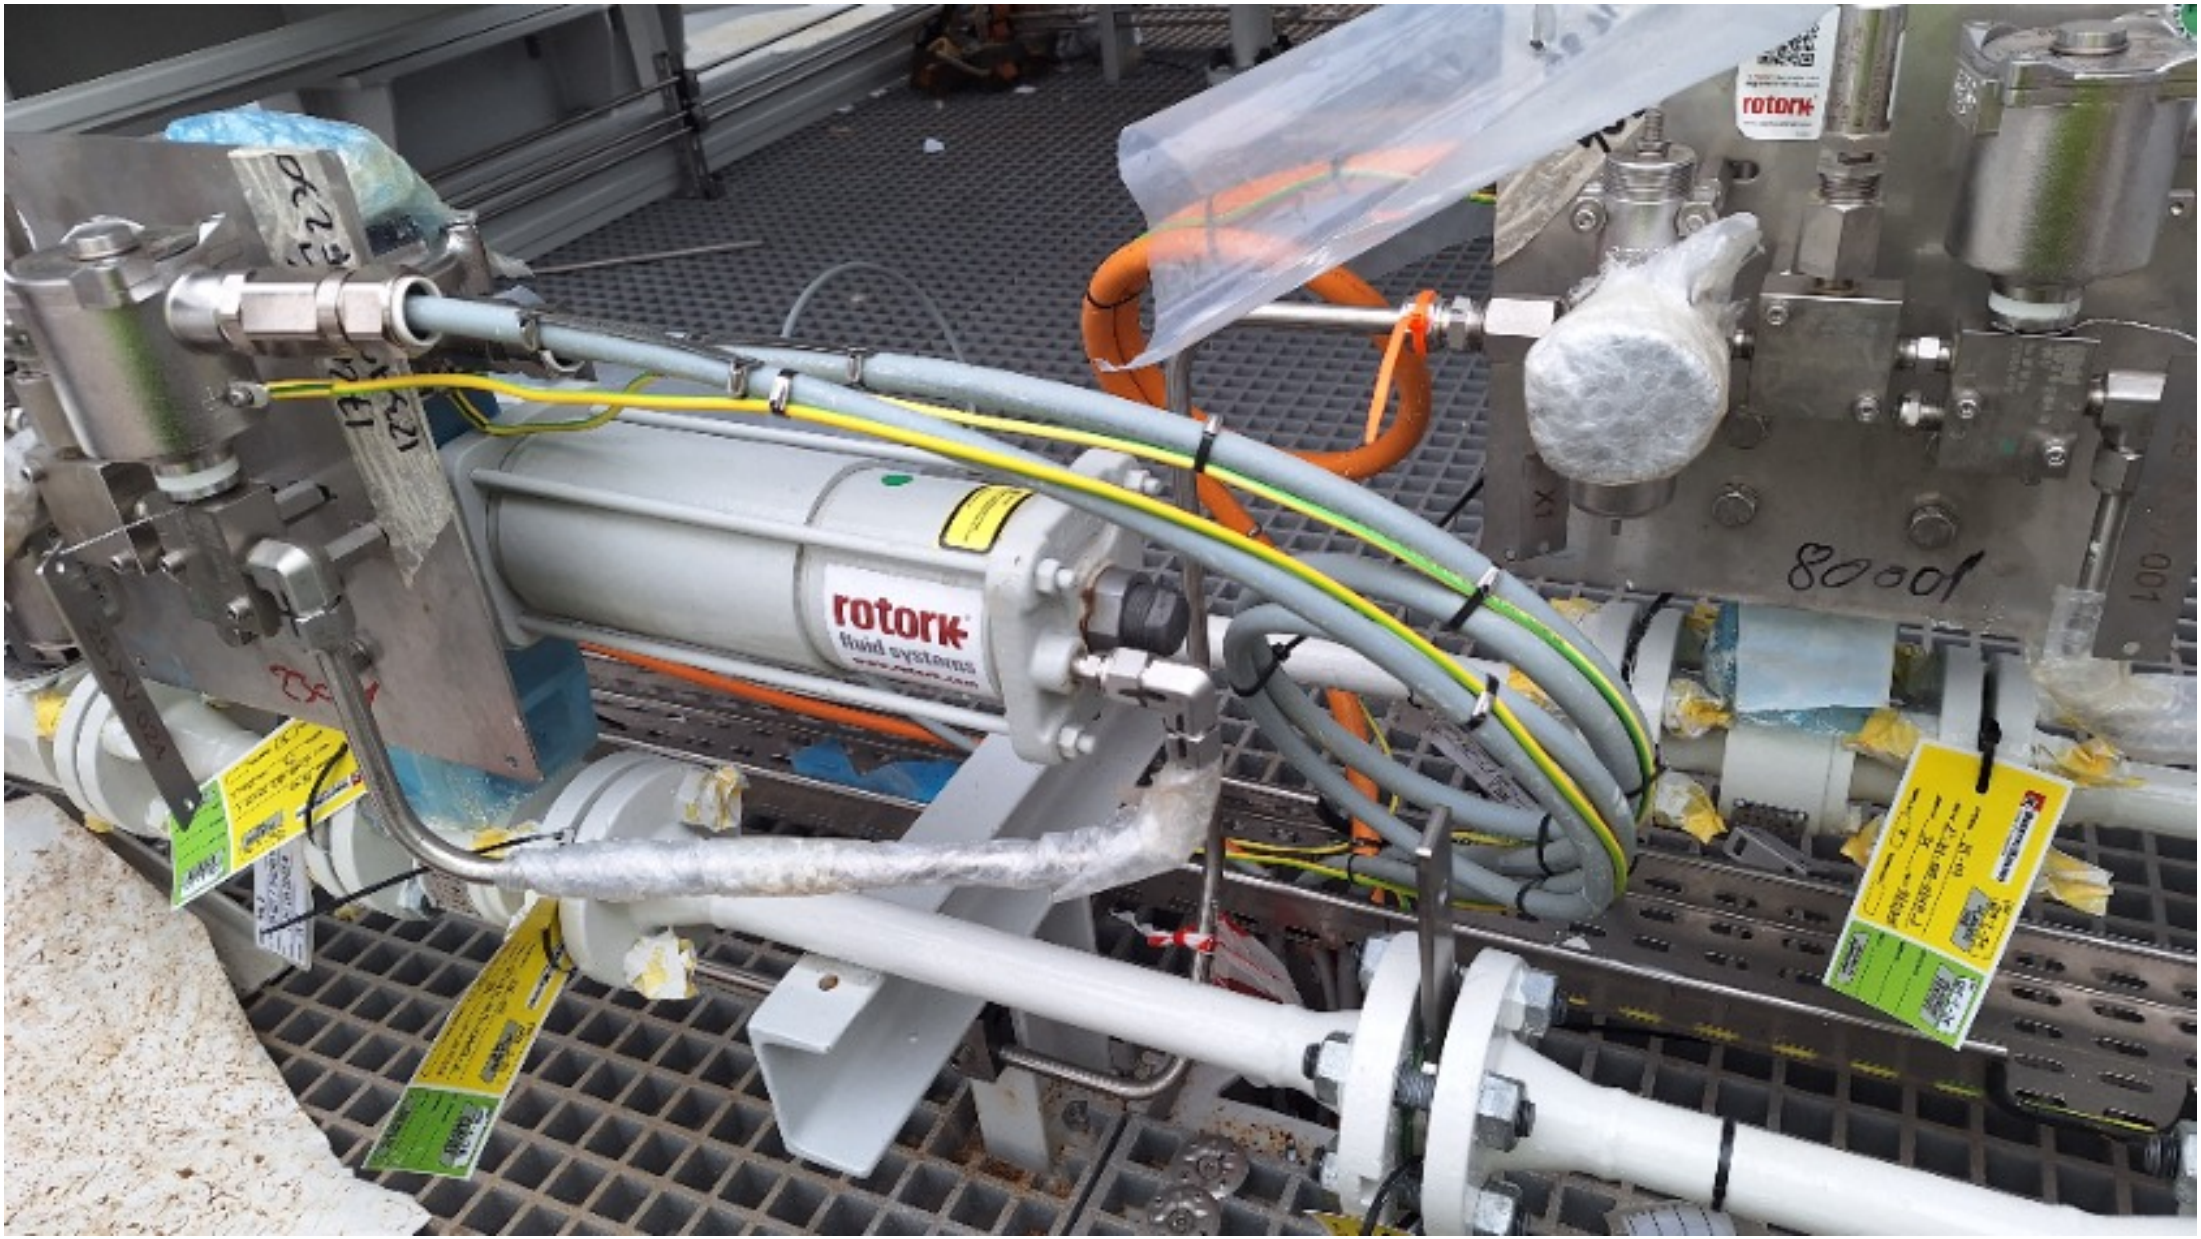
rotork
fluid systems
rotork

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003311

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000124	1.4 Discipline	Instrumental
1.2 Item	C-25-XY-024/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

The cable is not support .

Name: Alessio Polo

Date: 2025-01-30

Signature: Digitaly signed by Alessio Polo 2025-01-30T10:12:52.461Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-01-30T10:13:00.703Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Josip Krizanic

Date: 2025-03-05


Signature: Digitaly signed by Josip Krizanic 2025-03-05T15:48:25.662Z


6- CLEARANCE APPROVAL

Name

Date

Signature

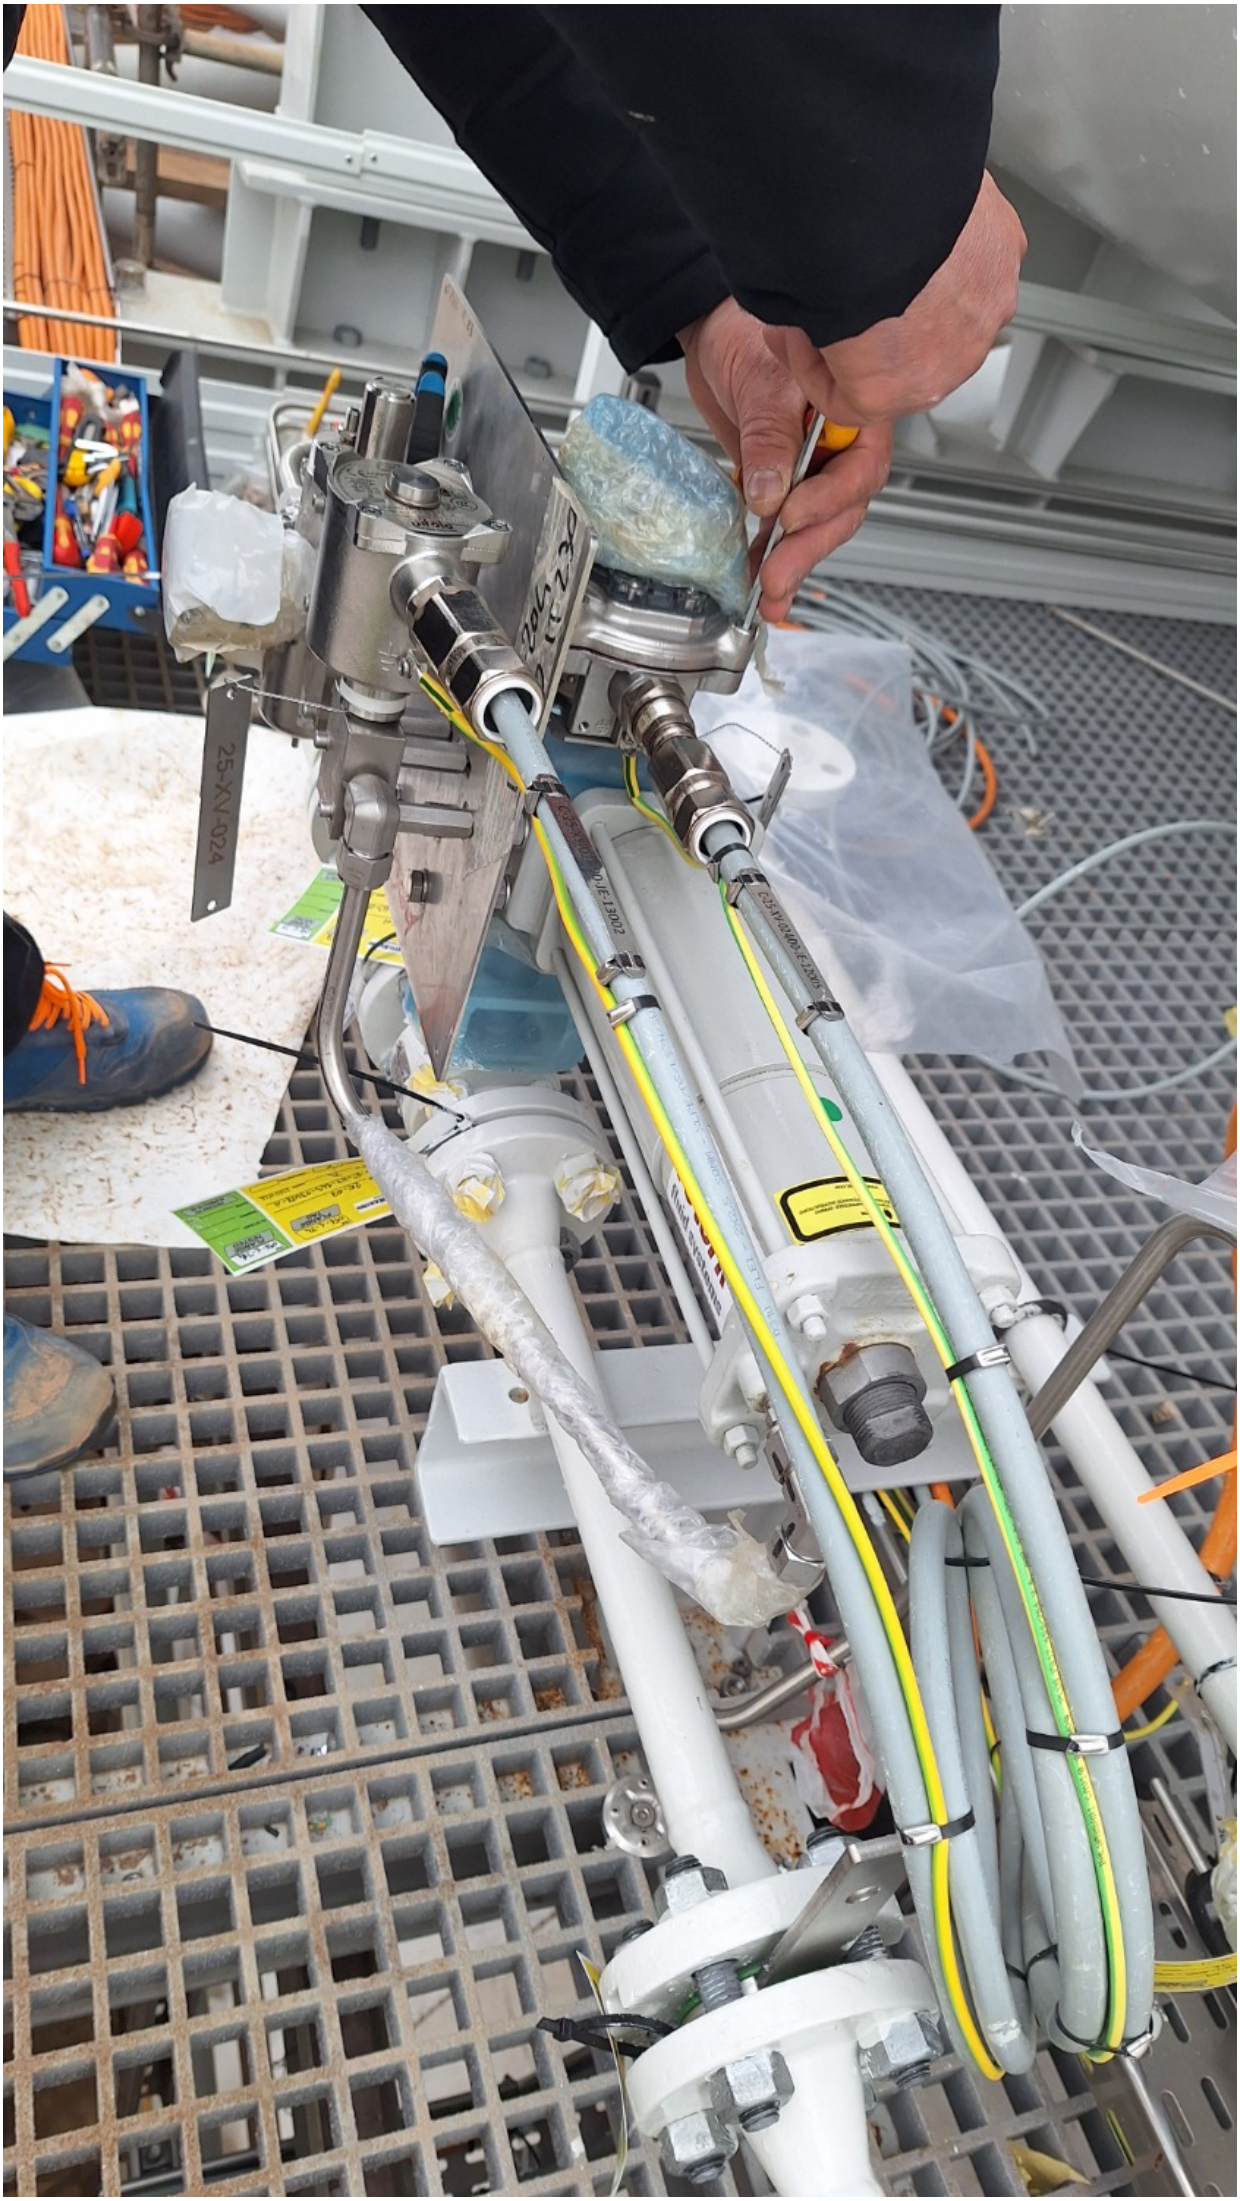
25-XV-024

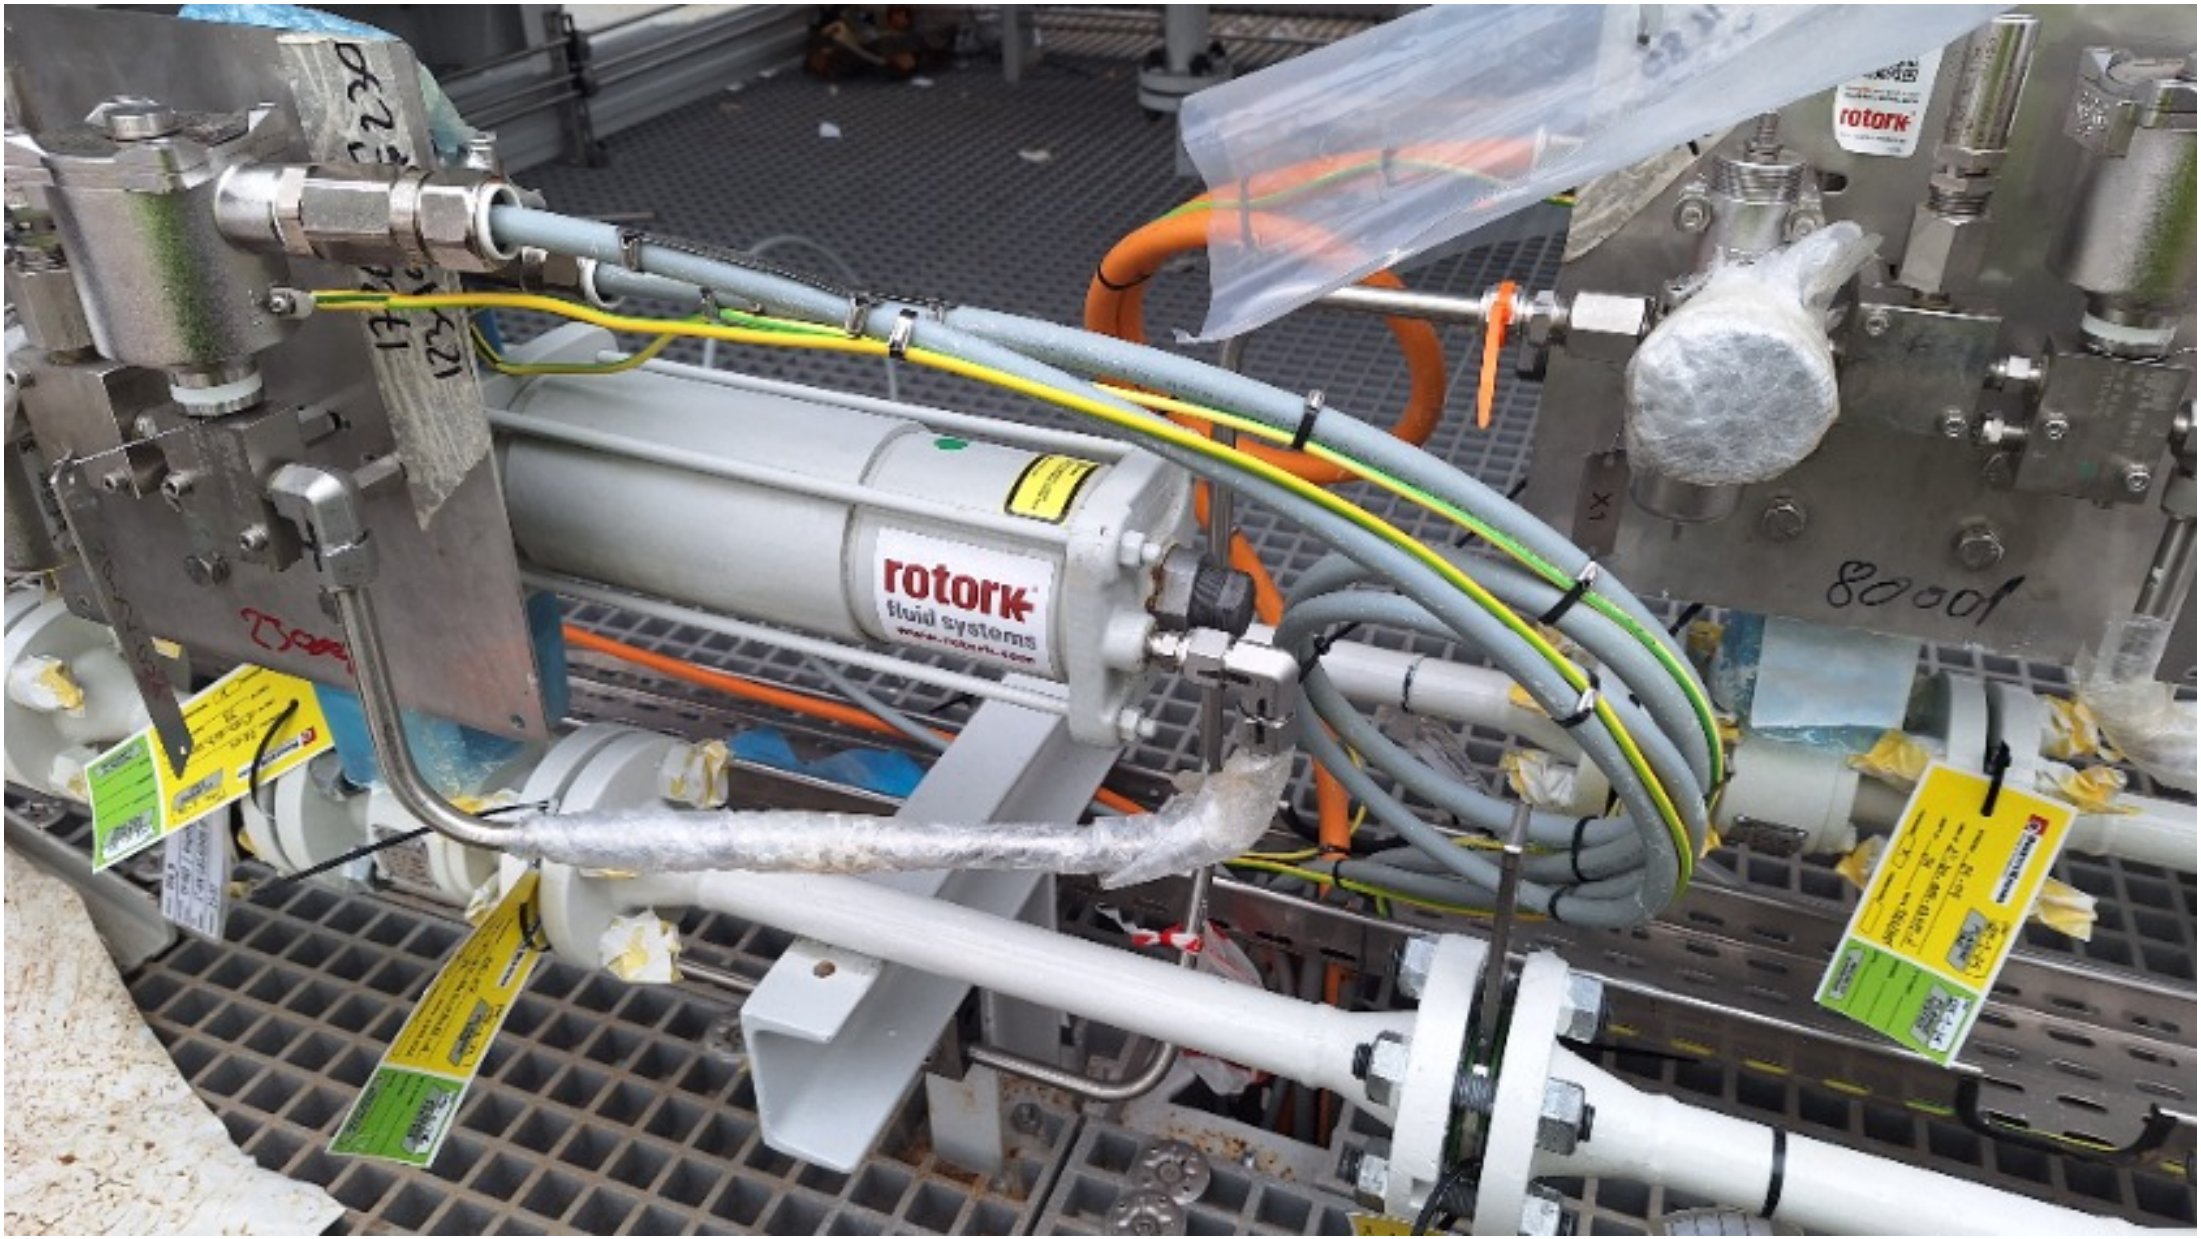
rotork
fluid systems
rotork

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003312

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10003278	1.4 Discipline	Piping
1.2 Item	25-07-TP-007	Test Pack 25-07-TP-007	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

BLPH-MV-014 not installed

Name: Andrea Mancini

Date: 2025-01-30

Signature: Digitaly signed by Andrea Mancini 2025-01-30T10:24:46.215Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	A PL A	Name	Andrea Mancini
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Andrea Mancini 2025-01-30T10:25:04.962Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Valve was installed during reinstatement phase.

Name: Lorenzo Novaga

Date: 2025-02-07

Signature: Digitaly signed by Lorenzo Novaga 2025-02-07T12:02:38.860Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003313

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10003278	1.4 Discipline	Piping
1.2 Item	25-07-TP-007	Test Pack 25-07-TP-007	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

BLPH-MV-013 not installed

Name: Andrea Mancini

Date: 2025-01-30

Signature: Digitaly signed by Andrea Mancini 2025-01-30T10:25:56.840Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	A PL A	Name	Andrea Mancini
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Andrea Mancini 2025-01-30T10:26:11.373Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Valve was installed during reinstatement phase.

Name: Lorenzo Novaga

Date: 2025-02-07

Signature: Digitaly signed by Lorenzo Novaga 2025-02-07T12:03:02.393Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003314

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10003278	1.4 Discipline	Piping
1.2 Item	25-07-TP-007	Test Pack 25-07-TP-007	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Support PS-03071.1 not installed

Name: Andrea Mancini

Date: 2025-01-30

Signature: Digitaly signed by Andrea Mancini 2025-01-30T10:29:27.677Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Mancini
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Andrea Mancini 2025-01-30T10:30:18.412Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Support Installed

Name: Lorenzo Novaga

Date: 2025-02-11

Signature: Digitaly signed by Lorenzo Novaga 2025-02-11T07:24:54.473Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003325

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001590	1.4 Discipline	ATEX
1.2 Item	25-XV-004		On-Off Actuated Ball Valve - Vessel V-25001A Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Scratch on painting, general touch-up to be performed

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T11:06:46.319Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Luca Mussi 2025-01-30T11:06:59.450Z

4 - PERFORMED ACTION

Name

Date: 2025-04-09

Signature

5 - CLEARANCE CHECK

Done.

Name: Lorenzo Novaga

Date: 2025-04-09

Signature: Digitaly signed by Lorenzo Novaga 2025-04-09T13:30:23.975Z


6- CLEARANCE APPROVAL

Name

Date: 2025-04-09

Signature



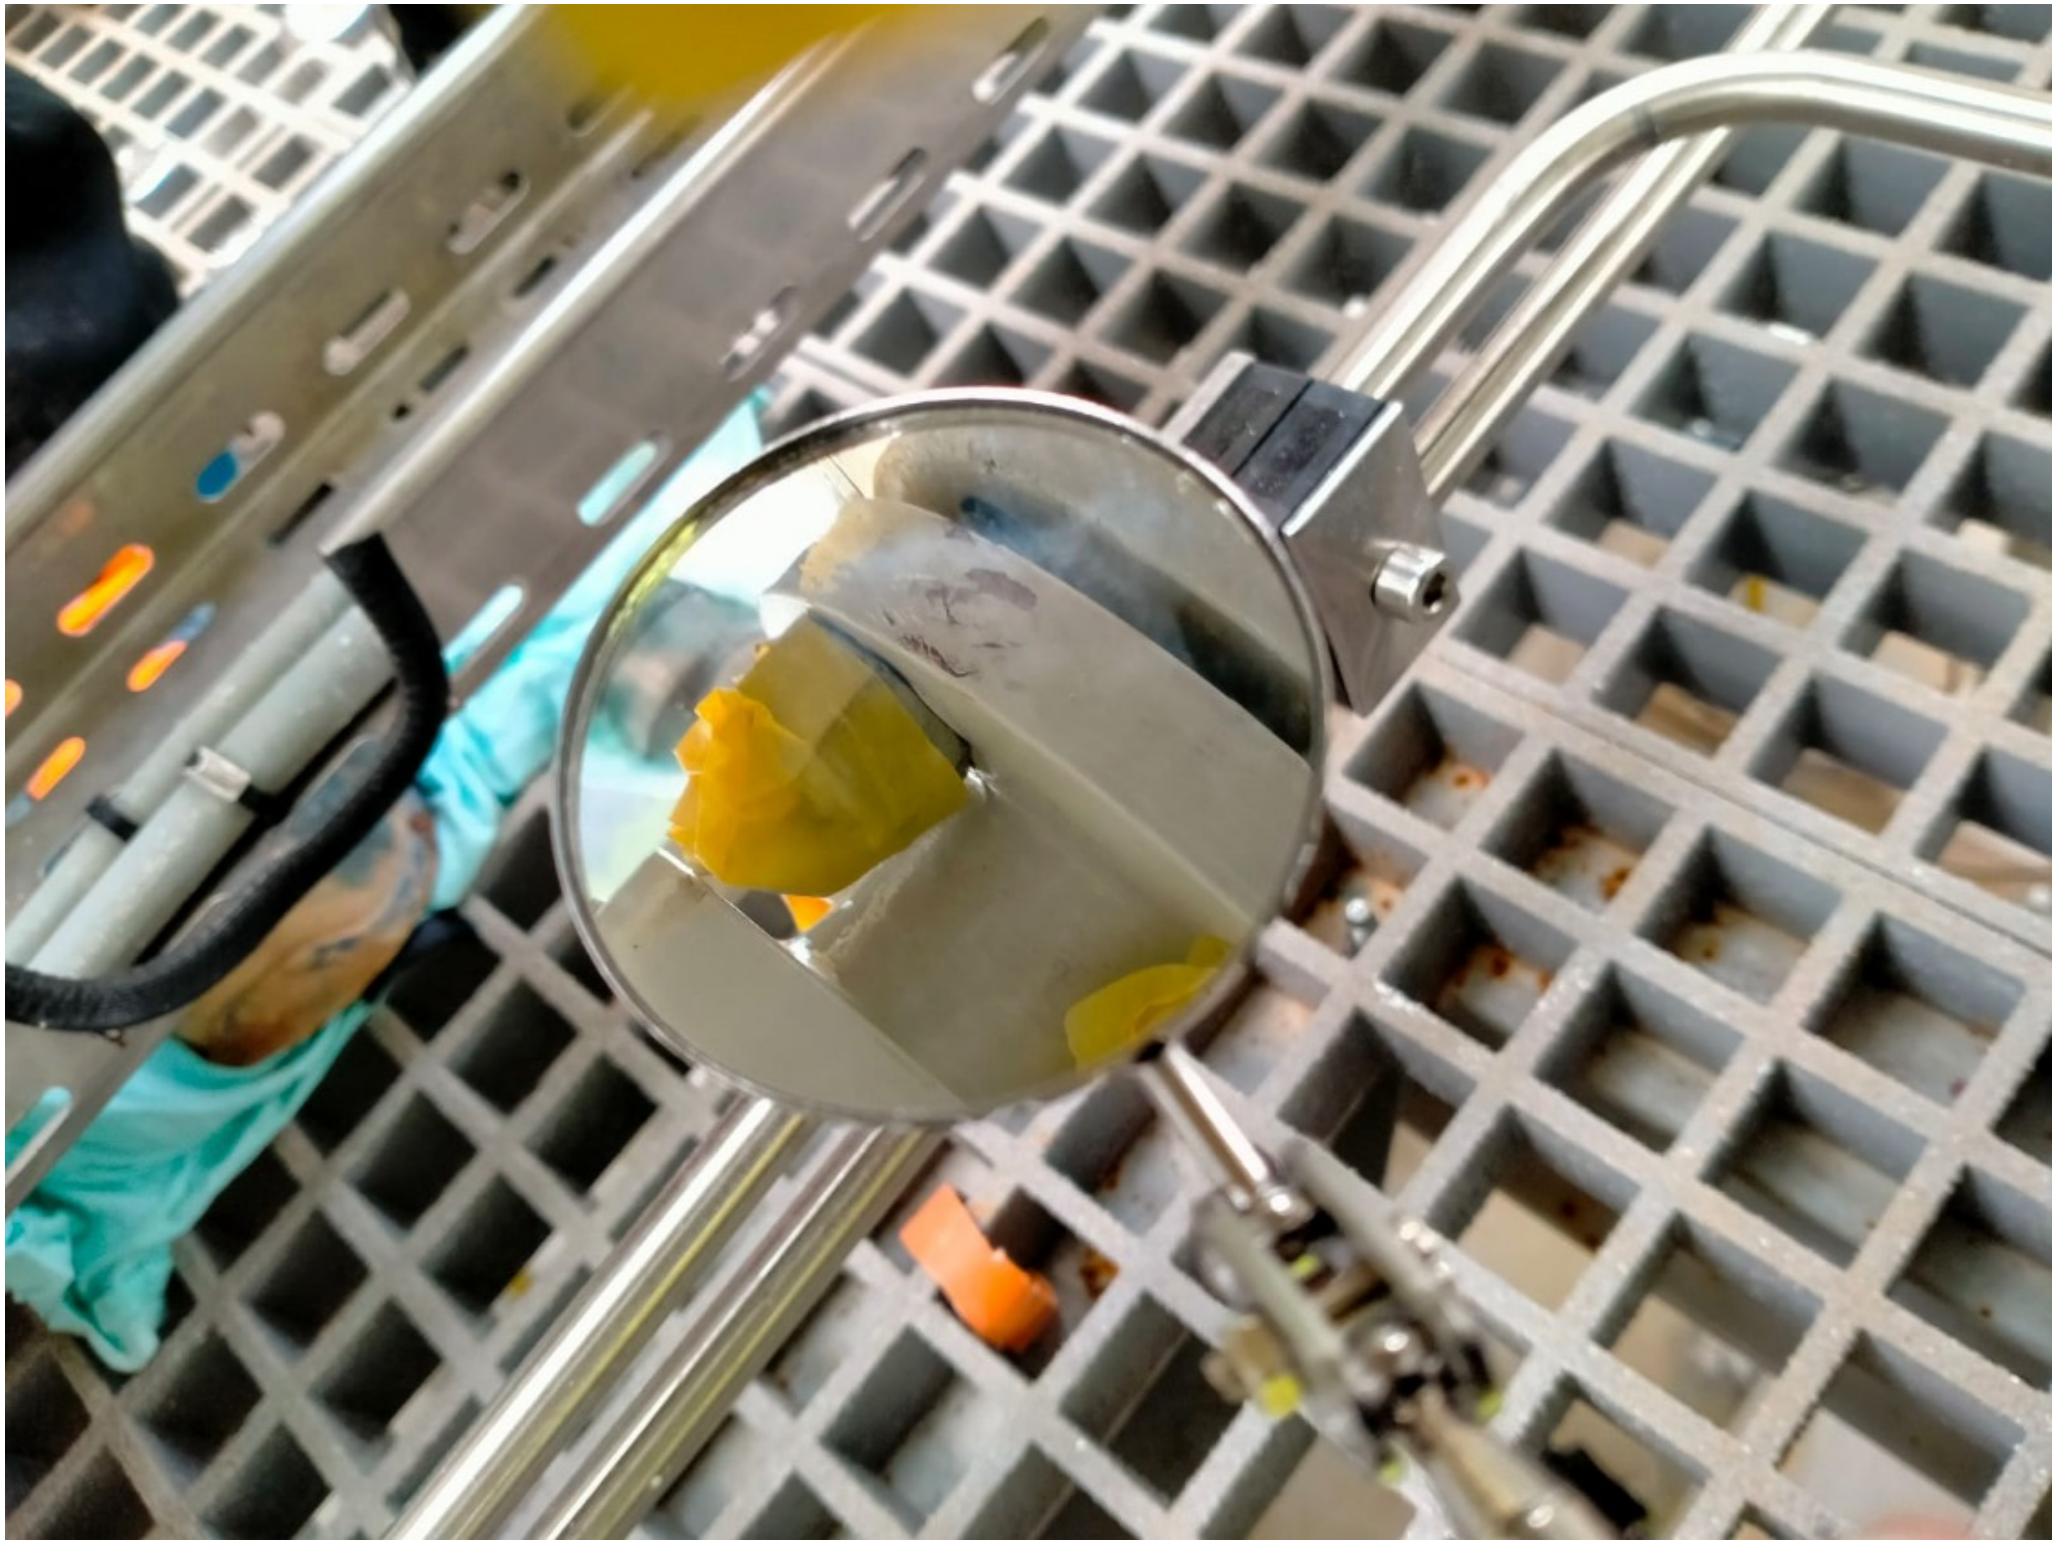

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003327

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001590	1.4 Discipline	ATEX
1.2 Item	25-XV-004		On-Off Actuated Ball Valve - Vessel V-25001A Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register (123A90-DDL-EL-LIS-20094 sheet 8) Manufacturer, Atex certificate, SN, Atex marking etc. are missing or wrong.

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T11:14:32.097Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-30T11:14:42.807Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Refer to punch C30003326

Name: Lorenzo Novaga

Date: 2025-03-06

Signature: Digitaly signed by Lorenzo Novaga 2025-03-06T14:47:07.087Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003329

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001592	1.4 Discipline	ATEX
1.2 Item	25-XV-008		On-Off Actuated Ball Valve - Vessel V-25001B Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Scratch on painting, general touch-up to be performed

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T11:16:56.437Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Luca Mussi 2025-01-30T11:17:05.941Z

4 - PERFORMED ACTION

Name

Date: 2025-04-09

Signature

5 - CLEARANCE CHECK

Done.

Name: Lorenzo Novaga

Date: 2025-04-09


Signature: Digitaly signed by Lorenzo Novaga 2025-04-09T13:30:41.826Z

6- CLEARANCE APPROVAL

Name

Date: 2025-04-09

Signature

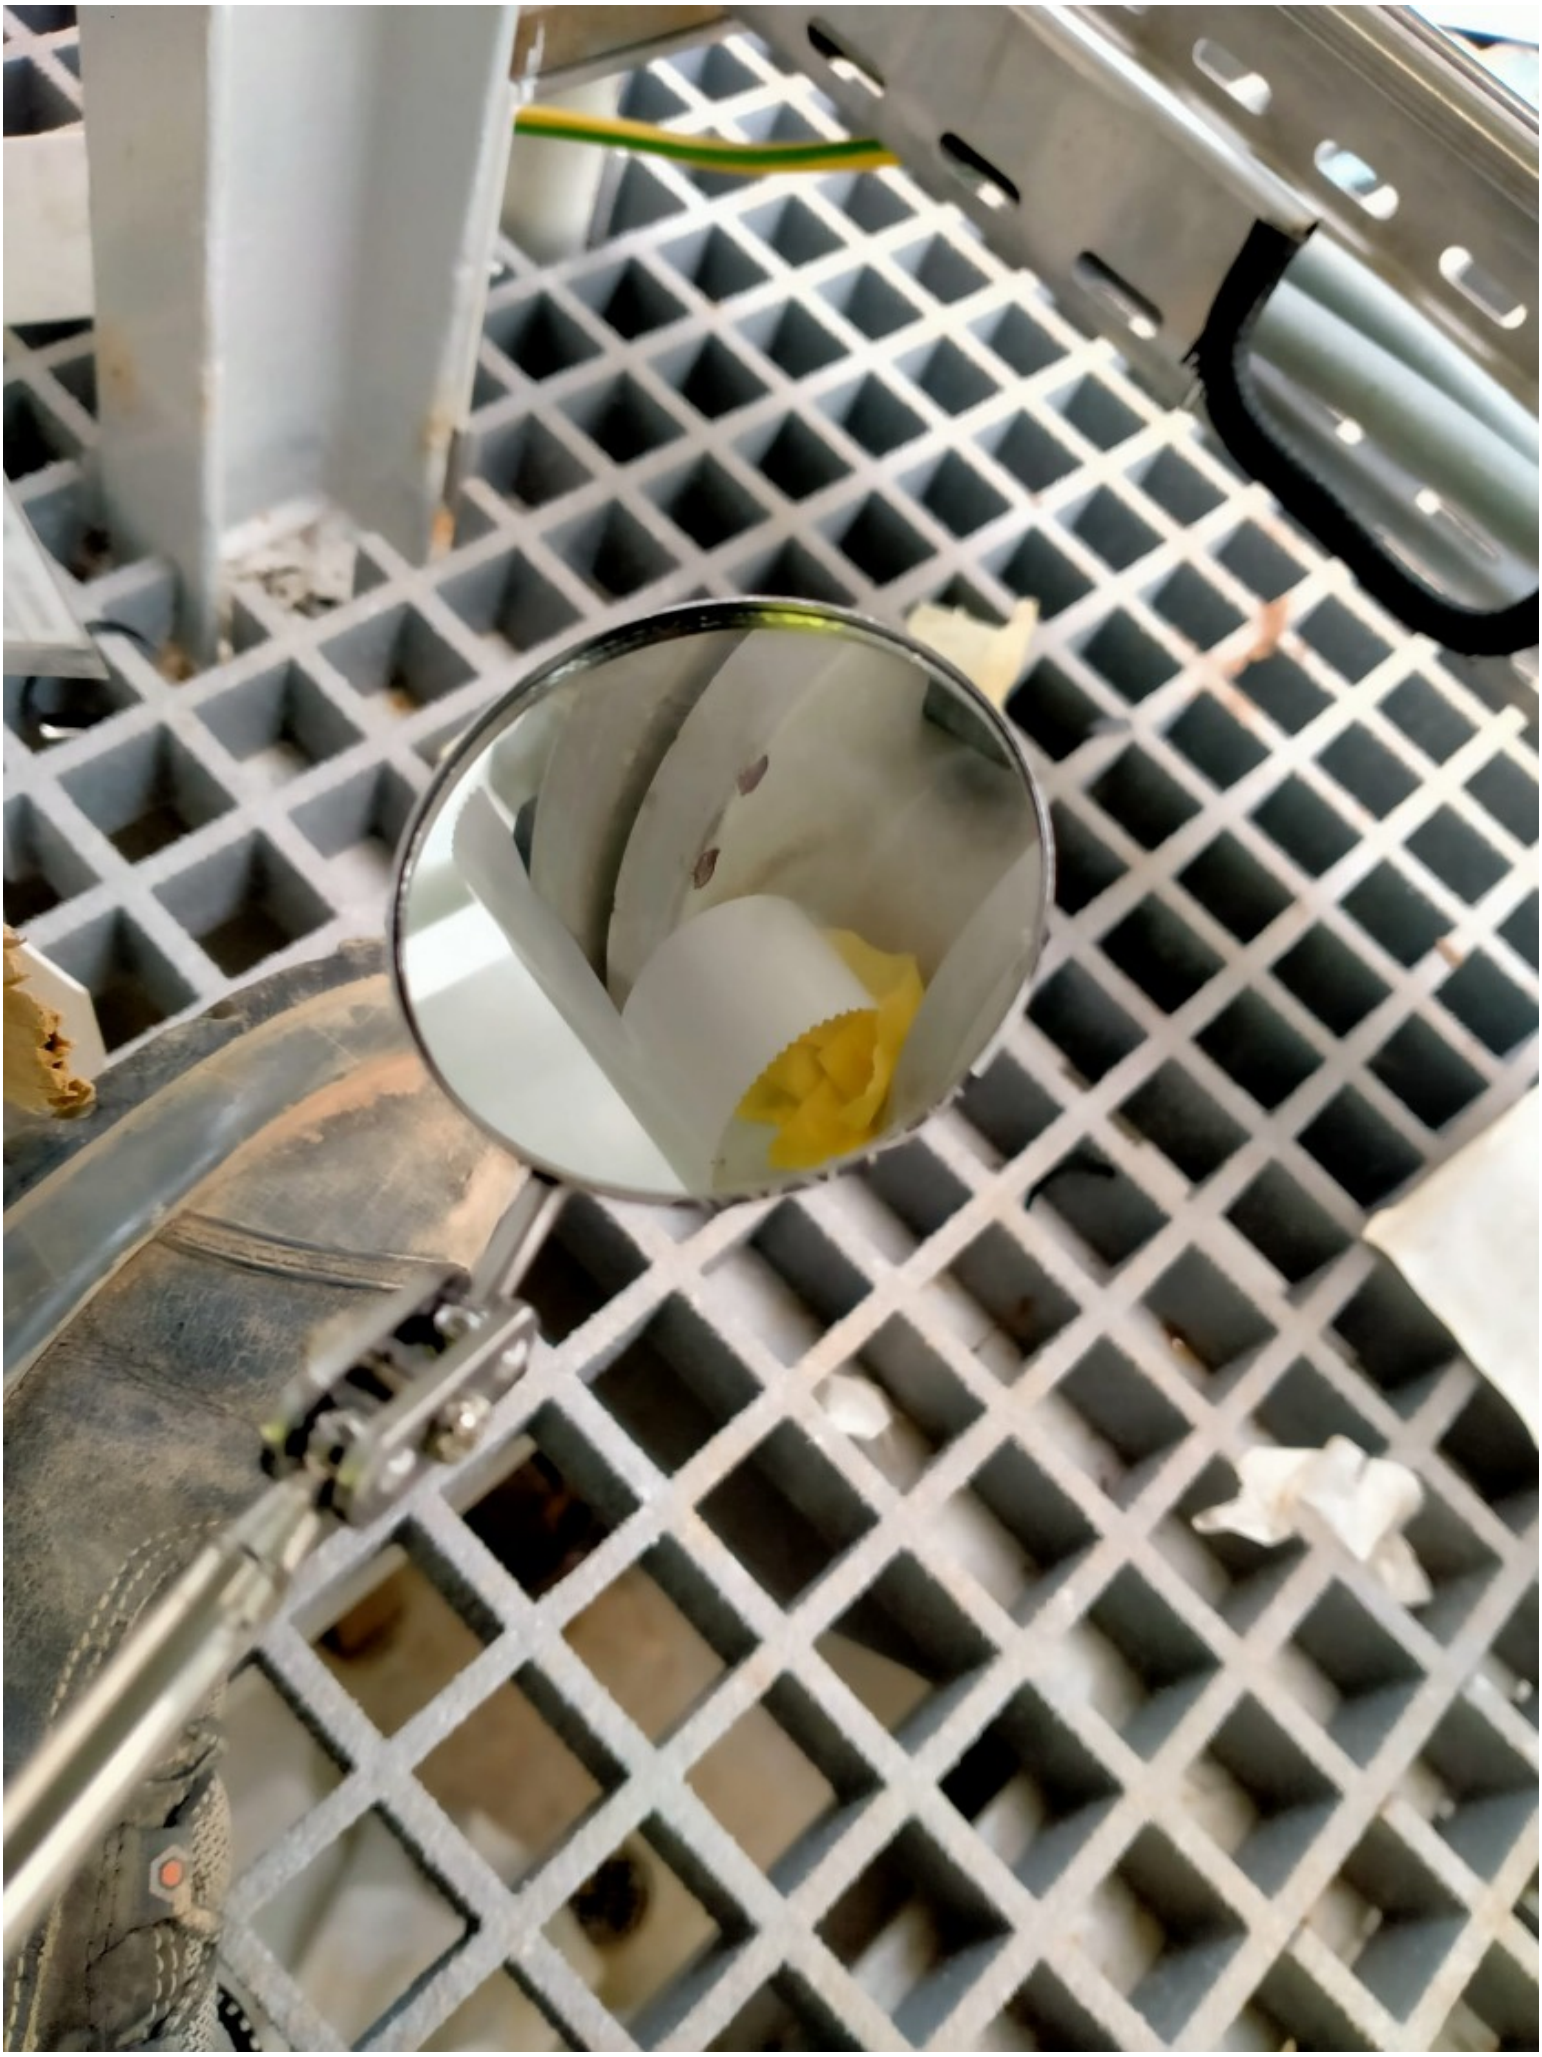



Flutek
Valves

ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003331

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001594	1.4 Discipline	ATEX
1.2 Item	25-XV-011		On/Off Valve - Vessel V-25001C Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Scratch on painting, general touch-up to be performed

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T11:22:30.166Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Luca Mussi 2025-01-30T11:22:40.798Z

4 - PERFORMED ACTION

Name

Date: 2025-04-09

Signature

5 - CLEARANCE CHECK

Done.

Name: Lorenzo Novaga

Date: 2025-04-09

Signature: Digitaly signed by Lorenzo Novaga 2025-04-09T13:30:47.214Z

6- CLEARANCE APPROVAL

Name

Date: 2025-04-09

Signature

TAG
011-1-31
FLANGE TAG
MARINO
25-02
1"-HY-012-03H88-N
Fluitek Valves

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003332

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001596	1.4 Discipline	ATEX
1.2 Item	25-XV-014		On/Off Valve - Vessel V-25001D Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Scratch on painting, general touch-up to be performed

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T11:30:01.652Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Luca Mussi 2025-01-30T11:30:23.984Z

4 - PERFORMED ACTION

Name

Date: 2025-03-20

Signature

5 - CLEARANCE CHECK

Done.

Name: Lorenzo Novaga

Date: 2025-03-20

Signature: Digitaly signed by Lorenzo Novaga 2025-03-20T11:46:59.505Z

6- CLEARANCE APPROVAL

Name

Date: 2025-03-20

Signature



ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003334

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001598	1.4 Discipline	ATEX
1.2 Item	25-XV-017		On/Off Valve - Vessel V-25001E Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Scratch on painting, general touch-up to be performed

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T11:35:34.009Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Luca Mussi 2025-01-30T11:35:49.463Z

4 - PERFORMED ACTION

Name

Date: 2025-03-20

Signature

5 - CLEARANCE CHECK

Done.

Name: Lorenzo Novaga

Date: 2025-03-20

Signature: Digitaly signed by Lorenzo Novaga 2025-03-20T11:46:54.083Z

6- CLEARANCE APPROVAL

Name

Date: 2025-03-20

Signature



ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003336

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001600	1.4 Discipline	ATEX
1.2 Item	25-XV-020		On/Off Valve - Vessel V-25001F Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Scratch on painting, general touch-up to be performed

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T11:39:38.847Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Luca Mussi 2025-01-30T11:39:48.610Z

4 - PERFORMED ACTION

Name

Date: 2025-03-20

Signature

5 - CLEARANCE CHECK

Done.

Name: Lorenzo Novaga

Date: 2025-03-20

Signature: Digitaly signed by Lorenzo Novaga 2025-03-20T11:46:45.708Z

6- CLEARANCE APPROVAL

Name

Date: 2025-03-20

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003367

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001755	1.4 Discipline	ATEX
1.2 Item	25-PCV-004		Air Set Filter - Vessel V-25001A Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment tag plate is missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:08:07.126Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:08:19.610Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-28

Signature: Digitaly signed by Luca Mussi 2025-02-28T14:51:05.732Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003371

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001755	1.4 Discipline	ATEX
1.2 Item	25-PCV-004		Air Set Filter - Vessel V-25001A Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX D.o.C. by Manufacturer is missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:09:37.231Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:09:50.493Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

D.o.C. provided and attached to ITR

Name: Luca Mussi

Date: 2025-02-05

Signature: Digitaly signed by Luca Mussi 2025-02-05T17:13:10.852Z

6- CLEARANCE APPROVAL

Name

Date

Signature

Document Reference: - D of C Baseefa14ATEX0223DR_01

EU Declaration of Conformity

Manufacturer: Bifold Fluidpower Ltd
Address: Broadgate, Oldham Broadway Business Park,
Chadderton, Oldham
Greater Manchester
OL9 9XA
UK

Tel: +44 (0)161-345-4777
E-mail: sales@bifold.co.uk

Product Type (Object of the Declaration):

Type SH, ASH & SC Filter Regulator

Declaration statement:

On behalf of the above company, I declare that, the *Object of the Declaration* described above is in conformity with the relevant Union harmonisation legislation: Directive 2014/34/EU, with the following limitation;

Limitation on the validity of the Declaration of Conformity:

None

Provisions of the Directive fulfilled by the Equipment:

Group II Category 2 Gb Db Ex c IIC T6

Bifold Technical File Reference:

DF-FP_SH_20140627114952

Technical File lodged with Notified Body:

SGS Fimko Oy 0598 Helsinki, Finland

SGS Baseefa Technical File Reference:

Baseefa14ATEX0223DR

Technical basis for compliance with the Essential Health and Safety Requirements of Directive 2014/34/EU: -

BS EN 13463-1: 2009 – Non-electrical equipment for use in potentially explosive atmospheres. Basic method and requirements
BS EN 13463-5: 2011 – Non-electrical equipment for use in potentially explosive atmospheres. Protection by constructional safety 'c'

(A review against the following harmonised standards, shows no significant changes relevant to this equipment): -

BS EN ISO 80079-36: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Basic method and requirements
BS EN ISO 80079-37: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Non-electrical type of protection constructional safety "c", control of ignition sources "b", liquid immersion "k"

Paul Barrow
Quality Manager

4th November 2020

ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003375

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001757	1.4 Discipline	ATEX
1.2 Item	25-PCV-008		Air Set Filter - Vessel V-25001B Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX D.o.C. by Manufacturer is missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:11:42.331Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:11:55.777Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

D.o.C. provided and attached to ITR

Name: Luca Mussi

Date: 2025-02-05

Signature: Digitaly signed by Luca Mussi 2025-02-05T17:13:38.341Z

6- CLEARANCE APPROVAL

Name

Date

Signature

Document Reference: - D of C Baseefa14ATEX0223DR_01

EU Declaration of Conformity

Manufacturer: Bifold Fluidpower Ltd
Address: Broadgate, Oldham Broadway Business Park,
Chadderton, Oldham
Greater Manchester
OL9 9XA
UK

Tel: +44 (0)161-345-4777
E-mail: sales@bifold.co.uk

Product Type (Object of the Declaration):

Type SH, ASH & SC Filter Regulator

Declaration statement:

On behalf of the above company, I declare that, the *Object of the Declaration* described above is in conformity with the relevant Union harmonisation legislation: Directive 2014/34/EU, with the following limitation;

Limitation on the validity of the Declaration of Conformity:

None

Provisions of the Directive fulfilled by the Equipment:

Group II Category 2 Gb Db Ex c IIC T6

Bifold Technical File Reference:

DF-FP_SH_20140627114952

Technical File lodged with Notified Body:

SGS Fimko Oy 0598 Helsinki, Finland

SGS Baseefa Technical File Reference:

Baseefa14ATEX0223DR

Technical basis for compliance with the Essential Health and Safety Requirements of Directive 2014/34/EU: -

BS EN 13463-1: 2009 – Non-electrical equipment for use in potentially explosive atmospheres. Basic method and requirements
BS EN 13463-5: 2011 – Non-electrical equipment for use in potentially explosive atmospheres. Protection by constructional safety 'c'

(A review against the following harmonised standards, shows no significant changes relevant to this equipment): -

BS EN ISO 80079-36: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Basic method and requirements
BS EN ISO 80079-37: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Non-electrical type of protection constructional safety "c", control of ignition sources "b", liquid immersion "k"

Paul Barrow
Quality Manager

4th November 2020

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003377

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001757	1.4 Discipline	ATEX
1.2 Item	25-PCV-008		Air Set Filter - Vessel V-25001B Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment data plate is missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:12:07.815Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:12:21.592Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-16

Signature: Digitaly signed by Luca Mussi 2025-02-16T10:54:33.419Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003379

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001759	1.4 Discipline	ATEX
1.2 Item	25-PCV-011		Air Set Filter - Vessel V-25001C Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX D.o.C. by Manufacturer is missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:13:32.113Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:13:45.242Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

D.o.C. provided and attached to ITR

Name: Luca Mussi

Date: 2025-02-05

Signature: Digitaly signed by Luca Mussi 2025-02-05T17:13:53.189Z

6- CLEARANCE APPROVAL

Name

Date

Signature

Document Reference: - D of C Baseefa14ATEX0223DR_01

EU Declaration of Conformity

Manufacturer: Bifold Fluidpower Ltd
Address: Broadgate, Oldham Broadway Business Park,
Chadderton, Oldham
Greater Manchester
OL9 9XA
UK

Tel: +44 (0)161-345-4777
E-mail: sales@bifold.co.uk

Product Type (Object of the Declaration):

Type SH, ASH & SC Filter Regulator

Declaration statement:

On behalf of the above company, I declare that, the *Object of the Declaration* described above is in conformity with the relevant Union harmonisation legislation: Directive 2014/34/EU, with the following limitation;

Limitation on the validity of the Declaration of Conformity:

None

Provisions of the Directive fulfilled by the Equipment:

Group II Category 2 Gb Db Ex c IIC T6

Bifold Technical File Reference:

DF-FP_SH_20140627114952

Technical File lodged with Notified Body:

SGS Fimko Oy 0598 Helsinki, Finland

SGS Baseefa Technical File Reference:

Baseefa14ATEX0223DR

Technical basis for compliance with the Essential Health and Safety Requirements of Directive 2014/34/EU: -

BS EN 13463-1: 2009 – Non-electrical equipment for use in potentially explosive atmospheres. Basic method and requirements
BS EN 13463-5: 2011 – Non-electrical equipment for use in potentially explosive atmospheres. Protection by constructional safety 'c'

(A review against the following harmonised standards, shows no significant changes relevant to this equipment): -

BS EN ISO 80079-36: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Basic method and requirements
BS EN ISO 80079-37: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Non-electrical type of protection constructional safety "c", control of ignition sources "b", liquid immersion "k"

Paul Barrow
Quality Manager

4th November 2020

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003380

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001759	1.4 Discipline	ATEX
1.2 Item	25-PCV-011		Air Set Filter - Vessel V-25001C Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment data plate is missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:13:56.393Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:14:08.403Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-28

Signature: Digitaly signed by Luca Mussi 2025-02-28T14:51:15.748Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003382

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001761	1.4 Discipline	ATEX
1.2 Item	25-PCV-014		Air Set Filter - Vessel V-25001D Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX D.o.C. by Manufacturer is missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:15:00.746Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:15:13.444Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

D.o.C. provided and attached to ITR

Name: Luca Mussi

Date: 2025-02-05

Signature: Digitaly signed by Luca Mussi 2025-02-05T17:14:11.726Z

6- CLEARANCE APPROVAL

Name

Date

Signature

Document Reference: - D of C Baseefa14ATEX0223DR_01

EU Declaration of Conformity

Manufacturer: Bifold Fluidpower Ltd
Address: Broadgate, Oldham Broadway Business Park,
Chadderton, Oldham
Greater Manchester
OL9 9XA
UK

Tel: +44 (0)161-345-4777
E-mail: sales@bifold.co.uk

Product Type (Object of the Declaration):

Type SH, ASH & SC Filter Regulator

Declaration statement:

On behalf of the above company, I declare that, the *Object of the Declaration* described above is in conformity with the relevant Union harmonisation legislation: Directive 2014/34/EU, with the following limitation;

Limitation on the validity of the Declaration of Conformity:

None

Provisions of the Directive fulfilled by the Equipment:

Group II Category 2 Gb Db Ex c IIC T6

Bifold Technical File Reference:

DF-FP_SH_20140627114952

Technical File lodged with Notified Body:

SGS Fimko Oy 0598 Helsinki, Finland

SGS Baseefa Technical File Reference:

Baseefa14ATEX0223DR

Technical basis for compliance with the Essential Health and Safety Requirements of Directive 2014/34/EU: -

BS EN 13463-1: 2009 – Non-electrical equipment for use in potentially explosive atmospheres. Basic method and requirements
BS EN 13463-5: 2011 – Non-electrical equipment for use in potentially explosive atmospheres. Protection by constructional safety 'c'

(A review against the following harmonised standards, shows no significant changes relevant to this equipment): -

BS EN ISO 80079-36: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Basic method and requirements
BS EN ISO 80079-37: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Non-electrical type of protection constructional safety "c", control of ignition sources "b", liquid immersion "k"

Paul Barrow
Quality Manager

4th November 2020

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003383

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001761	1.4 Discipline	ATEX
1.2 Item	25-PCV-014		Air Set Filter - Vessel V-25001D Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment data plate is missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:15:24.341Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:15:36.483Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-28

Signature: Digitaly signed by Luca Mussi 2025-02-28T14:51:25.169Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003387

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001763	1.4 Discipline	ATEX
1.2 Item	25-PCV-017		Air Set Filter - Vessel V-25001E Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX D.o.C. by Manufacturer is missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:20:01.440Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:20:14.947Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

D.o.C. provided and attached to ITR

Name: Luca Mussi

Date: 2025-02-05

Signature: Digitaly signed by Luca Mussi 2025-02-05T17:14:38.568Z

6- CLEARANCE APPROVAL

Name

Date

Signature

Document Reference: - D of C Baseefa14ATEX0223DR_01

EU Declaration of Conformity

Manufacturer: Bifold Fluidpower Ltd
Address: Broadgate, Oldham Broadway Business Park,
Chadderton, Oldham
Greater Manchester
OL9 9XA
UK

Tel: +44 (0)161-345-4777
E-mail: sales@bifold.co.uk

Product Type (Object of the Declaration):

Type SH, ASH & SC Filter Regulator

Declaration statement:

On behalf of the above company, I declare that, the *Object of the Declaration* described above is in conformity with the relevant Union harmonisation legislation: Directive 2014/34/EU, with the following limitation;

Limitation on the validity of the Declaration of Conformity:

None

Provisions of the Directive fulfilled by the Equipment:

Group II Category 2 Gb Db Ex c IIC T6

Bifold Technical File Reference:

DF-FP_SH_20140627114952

Technical File lodged with Notified Body:

SGS Fimko Oy 0598 Helsinki, Finland

SGS Baseefa Technical File Reference:

Baseefa14ATEX0223DR

Technical basis for compliance with the Essential Health and Safety Requirements of Directive 2014/34/EU: -

BS EN 13463-1: 2009 – Non-electrical equipment for use in potentially explosive atmospheres. Basic method and requirements
BS EN 13463-5: 2011 – Non-electrical equipment for use in potentially explosive atmospheres. Protection by constructional safety 'c'

(A review against the following harmonised standards, shows no significant changes relevant to this equipment): -

BS EN ISO 80079-36: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Basic method and requirements
BS EN ISO 80079-37: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Non-electrical type of protection constructional safety "c", control of ignition sources "b", liquid immersion "k"

Paul Barrow
Quality Manager

4th November 2020

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003389

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001763	1.4 Discipline	ATEX
1.2 Item	25-PCV-017		Air Set Filter - Vessel V-25001E Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment data plate is missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:20:27.733Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:20:40.987Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-28

Signature: Digitaly signed by Luca Mussi 2025-02-28T14:51:35.333Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003394

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001765	1.4 Discipline	ATEX
1.2 Item	25-PCV-020		Air Set Filter - Vessel V-25001F Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX D.o.C. by Manufacturer is missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:23:30.545Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:23:40.823Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

D.o.C. provided and attached to ITR

Name: Luca Mussi

Date: 2025-02-05

Signature: Digitaly signed by Luca Mussi 2025-02-05T17:14:58.310Z

6- CLEARANCE APPROVAL

Name

Date

Signature

Document Reference: - D of C Baseefa14ATEX0223DR_01

EU Declaration of Conformity

Manufacturer: Bifold Fluidpower Ltd
Address: Broadgate, Oldham Broadway Business Park,
Chadderton, Oldham
Greater Manchester
OL9 9XA
UK

Tel: +44 (0)161-345-4777
E-mail: sales@bifold.co.uk

Product Type (Object of the Declaration):

Type SH, ASH & SC Filter Regulator

Declaration statement:

On behalf of the above company, I declare that, the *Object of the Declaration* described above is in conformity with the relevant Union harmonisation legislation: Directive 2014/34/EU, with the following limitation;

Limitation on the validity of the Declaration of Conformity:

None

Provisions of the Directive fulfilled by the Equipment:

Group II Category 2 Gb Db Ex c IIC T6

Bifold Technical File Reference:

DF-FP_SH_20140627114952

Technical File lodged with Notified Body:

SGS Fimko Oy 0598 Helsinki, Finland

SGS Baseefa Technical File Reference:

Baseefa14ATEX0223DR

Technical basis for compliance with the Essential Health and Safety Requirements of Directive 2014/34/EU: -

BS EN 13463-1: 2009 – Non-electrical equipment for use in potentially explosive atmospheres. Basic method and requirements
BS EN 13463-5: 2011 – Non-electrical equipment for use in potentially explosive atmospheres. Protection by constructional safety 'c'

(A review against the following harmonised standards, shows no significant changes relevant to this equipment): -

BS EN ISO 80079-36: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Basic method and requirements
BS EN ISO 80079-37: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Non-electrical type of protection constructional safety "c", control of ignition sources "b", liquid immersion "k"

Paul Barrow
Quality Manager

4th November 2020

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003395

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001765	1.4 Discipline	ATEX
1.2 Item	25-PCV-020		Air Set Filter - Vessel V-25001F Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment data plate is missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:23:53.383Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:24:08.635Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-28

Signature: Digitaly signed by Luca Mussi 2025-02-28T14:51:45.798Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003396

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001755	1.4 Discipline	ATEX
1.2 Item	25-PCV-004		Air Set Filter - Vessel V-25001A Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

On ATEX register equipment model, SN and Atex execution are missing

Name: Luca Mussi

Date: 2025-01-30

Signature: Digitaly signed by Luca Mussi 2025-01-30T16:26:54.442Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-30
3.5 Action by	ENG Engineering	Signature	Digitaly signed by Luca Mussi 2025-01-30T16:27:04.075Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Refer to punch C30003365.

Name: Lorenzo Novaga

Date: 2025-03-06

Signature: Digitaly signed by Lorenzo Novaga 2025-03-06T14:47:31.544Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003407

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001602	1.4 Discipline	ATEX
1.2 Item	25-XV-024		On/Off Valve - Hyrogen to Vessels Inlet Header Vent System
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Scratch on painting, general touch-up to be performed

Name: Luca Mussi

Date: 2025-01-31

Signature: Digitaly signed by Luca Mussi 2025-01-31T09:26:08.741Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Luca Mussi 2025-01-31T09:26:21.100Z

4 - PERFORMED ACTION

Name

Date: 2025-04-22

Signature

5 - CLEARANCE CHECK

Done

Name: Lorenzo Novaga

Date: 2025-04-22

Signature: Digitaly signed by Lorenzo Novaga 2025-04-22T12:05:43.162Z

6- CLEARANCE APPROVAL

Name

Date: 2025-04-22

Signature


CAUTION
PRODUCT CONTAINS COMPRESSED SPRING
REFER TO OPERATING + MAINTENANCE INSTRUCTIONS
WWW.ROTORK.COM


25-XV-024
rotork
fluid systems

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003410

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10002040	1.4 Discipline	ATEX
1.2 Item	25-PCV-024		Air Set Filter - Nitrogen to Distribution Header Shut-Down
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX D.o.C. by Manufacturer is missing

Name: Luca Mussi

Date: 2025-01-31

Signature: Digitaly signed by Luca Mussi 2025-01-31T09:44:03.486Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-31T09:44:16.529Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

D.o.C. provided and attached to ITR

Name: Luca Mussi

Date: 2025-02-05

Signature: Digitaly signed by Luca Mussi 2025-02-05T17:15:13.233Z

6- CLEARANCE APPROVAL

Name

Date

Signature

Document Reference: - D of C Baseefa14ATEX0223DR_01

EU Declaration of Conformity

Manufacturer: Bifold Fluidpower Ltd
Address: Broadgate, Oldham Broadway Business Park,
Chadderton, Oldham
Greater Manchester
OL9 9XA
UK

Tel: +44 (0)161-345-4777
E-mail: sales@bifold.co.uk

Product Type (Object of the Declaration):

Type SH, ASH & SC Filter Regulator

Declaration statement:

On behalf of the above company, I declare that, the *Object of the Declaration* described above is in conformity with the relevant Union harmonisation legislation: Directive 2014/34/EU, with the following limitation;

Limitation on the validity of the Declaration of Conformity:

None

Provisions of the Directive fulfilled by the Equipment:

Group II Category 2 Gb Db Ex c IIC T6

Bifold Technical File Reference:

DF-FP_SH_20140627114952

Technical File lodged with Notified Body:

SGS Fimko Oy 0598 Helsinki, Finland

SGS Baseefa Technical File Reference:

Baseefa14ATEX0223DR

Technical basis for compliance with the Essential Health and Safety Requirements of Directive 2014/34/EU: -

BS EN 13463-1: 2009 – Non-electrical equipment for use in potentially explosive atmospheres. Basic method and requirements
BS EN 13463-5: 2011 – Non-electrical equipment for use in potentially explosive atmospheres. Protection by constructional safety 'c'

(A review against the following harmonised standards, shows no significant changes relevant to this equipment): -

BS EN ISO 80079-36: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Basic method and requirements
BS EN ISO 80079-37: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Non-electrical type of protection constructional safety "c", control of ignition sources "b", liquid immersion "k"

Paul Barrow
Quality Manager

4th November 2020

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003411

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10002040	1.4 Discipline	ATEX
1.2 Item	25-PCV-024		Air Set Filter - Nitrogen to Distribution Header Shut-Down
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment tag plate is missing

Name: Luca Mussi

Date: 2025-01-31

Signature: Digitaly signed by Luca Mussi 2025-01-31T09:44:37.962Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-31T09:44:47.518Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-28

Signature: Digitaly signed by Luca Mussi 2025-02-28T14:51:55.863Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003412

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001588	1.4 Discipline	ATEX
1.2 Item	25-SDV-001		On/Off Valve - Hyrogen to Vessels Inlet Header Shut-Down
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Scratch on painting, general touch-up to be performed

Name: Luca Mussi

Date: 2025-01-31

Signature: Digitaly signed by Luca Mussi 2025-01-31T09:55:15.325Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Luca Mussi 2025-01-31T09:55:48.115Z

4 - PERFORMED ACTION

Name

Date: 2025-04-09

Signature

5 - CLEARANCE CHECK

Done.

Name: Lorenzo Novaga

Date: 2025-04-09

Signature: Digitaly signed by Lorenzo Novaga 2025-04-09T13:30:52.852Z

6- CLEARANCE APPROVAL

Name

Date: 2025-04-09

Signature



ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003414

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10002038	1.4 Discipline	ATEX
1.2 Item	25-XY-024	Solenoid Valve - Hyrogen to Vessels Inlet Header Vent System	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Missing tag SS , on Solenoid Valve.

Name: Alessio Polo

Date: 2025-01-31

Signature: Digitaly signed by Alessio Polo 2025-01-31T10:38:40.798Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-01-31T10:39:05.335Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-24

Signature: Digitaly signed by Andrea Andreani 2025-02-24T16:00:16.446Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003431

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001754	1.4 Discipline	ATEX
1.2 Item	25-PCV-001		Air Set Filter - Hyrogen to Vessels Inlet Header Shut-Down
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment tag plate is missing

Name: Luca Mussi

Date: 2025-01-31

Signature: Digitaly signed by Luca Mussi 2025-01-31T12:37:42.761Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-31T12:37:56.599Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-28

Signature: Digitaly signed by Luca Mussi 2025-02-28T14:52:15.404Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003433

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001754	1.4 Discipline	ATEX
1.2 Item	25-PCV-001		Air Set Filter - Hyrogen to Vessels Inlet Header Shut-Down
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX D.o.C. by Manufacturer is missing

Name: Luca Mussi

Date: 2025-01-31

Signature: Digitaly signed by Luca Mussi 2025-01-31T12:38:18.162Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-31T12:38:30.866Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

D.o.C. provided and attached to ITR

Name: Luca Mussi

Date: 2025-02-05

Signature: Digitaly signed by Luca Mussi 2025-02-05T17:15:36.531Z

6- CLEARANCE APPROVAL

Name

Date

Signature

Document Reference: - D of C Baseefa14ATEX0223DR_01

EU Declaration of Conformity

Manufacturer: Bifold Fluidpower Ltd
Address: Broadgate, Oldham Broadway Business Park,
Chadderton, Oldham
Greater Manchester
OL9 9XA
UK

Tel: +44 (0)161-345-4777
E-mail: sales@bifold.co.uk

Product Type (Object of the Declaration):

Type SH, ASH & SC Filter Regulator

Declaration statement:

On behalf of the above company, I declare that, the *Object of the Declaration* described above is in conformity with the relevant Union harmonisation legislation: Directive 2014/34/EU, with the following limitation;

Limitation on the validity of the Declaration of Conformity:

None

Provisions of the Directive fulfilled by the Equipment:

Group II Category 2 Gb Db Ex c IIC T6

Bifold Technical File Reference:

DF-FP_SH_20140627114952

Technical File lodged with Notified Body:

SGS Fimko Oy 0598 Helsinki, Finland

SGS Baseefa Technical File Reference:

Baseefa14ATEX0223DR

Technical basis for compliance with the Essential Health and Safety Requirements of Directive 2014/34/EU: -

BS EN 13463-1: 2009 – Non-electrical equipment for use in potentially explosive atmospheres. Basic method and requirements
BS EN 13463-5: 2011 – Non-electrical equipment for use in potentially explosive atmospheres. Protection by constructional safety 'c'

(A review against the following harmonised standards, shows no significant changes relevant to this equipment): -

BS EN ISO 80079-36: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Basic method and requirements
BS EN ISO 80079-37: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Non-electrical type of protection constructional safety "c", control of ignition sources "b", liquid immersion "k"

Paul Barrow
Quality Manager

4th November 2020

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003436

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004819	1.4 Discipline	ATEX
1.2 Item	25-PG -004	Air Set Pressure Gauge Filter - Vessel V-25001A Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Equipment Atex label is missing

Name: Luca Mussi

Date: 2025-01-31

Signature: Digitaly signed by Luca Mussi 2025-01-31T12:52:11.341Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-31T12:52:26.235Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Equipment ATEX label was installed by vendor on site.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T13:41:19.320Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003437

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004819	1.4 Discipline	ATEX
1.2 Item	25-PG -004		Air Set Pressure Gauge Filter - Vessel V-25001A Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment tag plate is missing

Name: Luca Mussi

Date: 2025-01-31

Signature: Digitaly signed by Luca Mussi 2025-01-31T12:52:42.319Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-31T12:52:54.464Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-16

Signature: Digitaly signed by Luca Mussi 2025-02-16T10:50:15.613Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003440

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004821	1.4 Discipline	ATEX
1.2 Item	25-PG -008	Air Set Pressure Gauge Filter - Vessel V-25001B Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Equipment Atex label is missing

Name: Luca Mussi

Date: 2025-01-31

Signature: Digitaly signed by Luca Mussi 2025-01-31T13:00:11.280Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-31T13:00:26.355Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Equipment ATEX label was installed by vendor on site.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T13:22:03.672Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003441

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004821	1.4 Discipline	ATEX
1.2 Item	25-PG -008	Air Set Pressure Gauge Filter - Vessel V-25001B Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Equipment tag is missing

Name: Luca Mussi

Date: 2025-01-31

Signature: Digitaly signed by Luca Mussi 2025-01-31T13:01:10.866Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-31T13:01:22.015Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-16

Signature: Digitaly signed by Luca Mussi 2025-02-16T10:50:25.797Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003442

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004823	1.4 Discipline	ATEX
1.2 Item	25-PG -011	Air Set Pressure Gauge Filter - Vessel V-25001C Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Equipment ATEX label is missing

Name: Luca Mussi

Date: 2025-01-31

Signature: Digitaly signed by Luca Mussi 2025-01-31T13:05:20.138Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-31T13:05:44.201Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Equipment ATEX label was installed by vendor on site.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T13:24:02.342Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003443

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004823	1.4 Discipline	ATEX
1.2 Item	25-PG -011	Air Set Pressure Gauge Filter - Vessel V-25001C Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Equipment tag is missing

Name: Luca Mussi

Date: 2025-01-31

Signature: Digitaly signed by Luca Mussi 2025-01-31T13:05:57.605Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-01-31
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-01-31T13:06:07.677Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-16

Signature: Digitaly signed by Luca Mussi 2025-02-16T10:50:51.180Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003451

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004821	1.4 Discipline	ATEX
1.2 Item	25-PG -008	Air Set Pressure Gauge Filter - Vessel V-25001B Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Breathing valve is missing

Name: Luca Mussi

Date: 2025-02-01

Signature: Digitaly signed by Luca Mussi 2025-02-01T11:04:54.705Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-01
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Luca Mussi 2025-02-01T11:05:08.980Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Installed.

Name: Giovanni Tangianu

Date: 2025-03-26


Signature: Digitaly signed by Giovanni Tangianu 2025-03-26T14:37:40.325Z

6- CLEARANCE APPROVAL

Name

Date

Signature

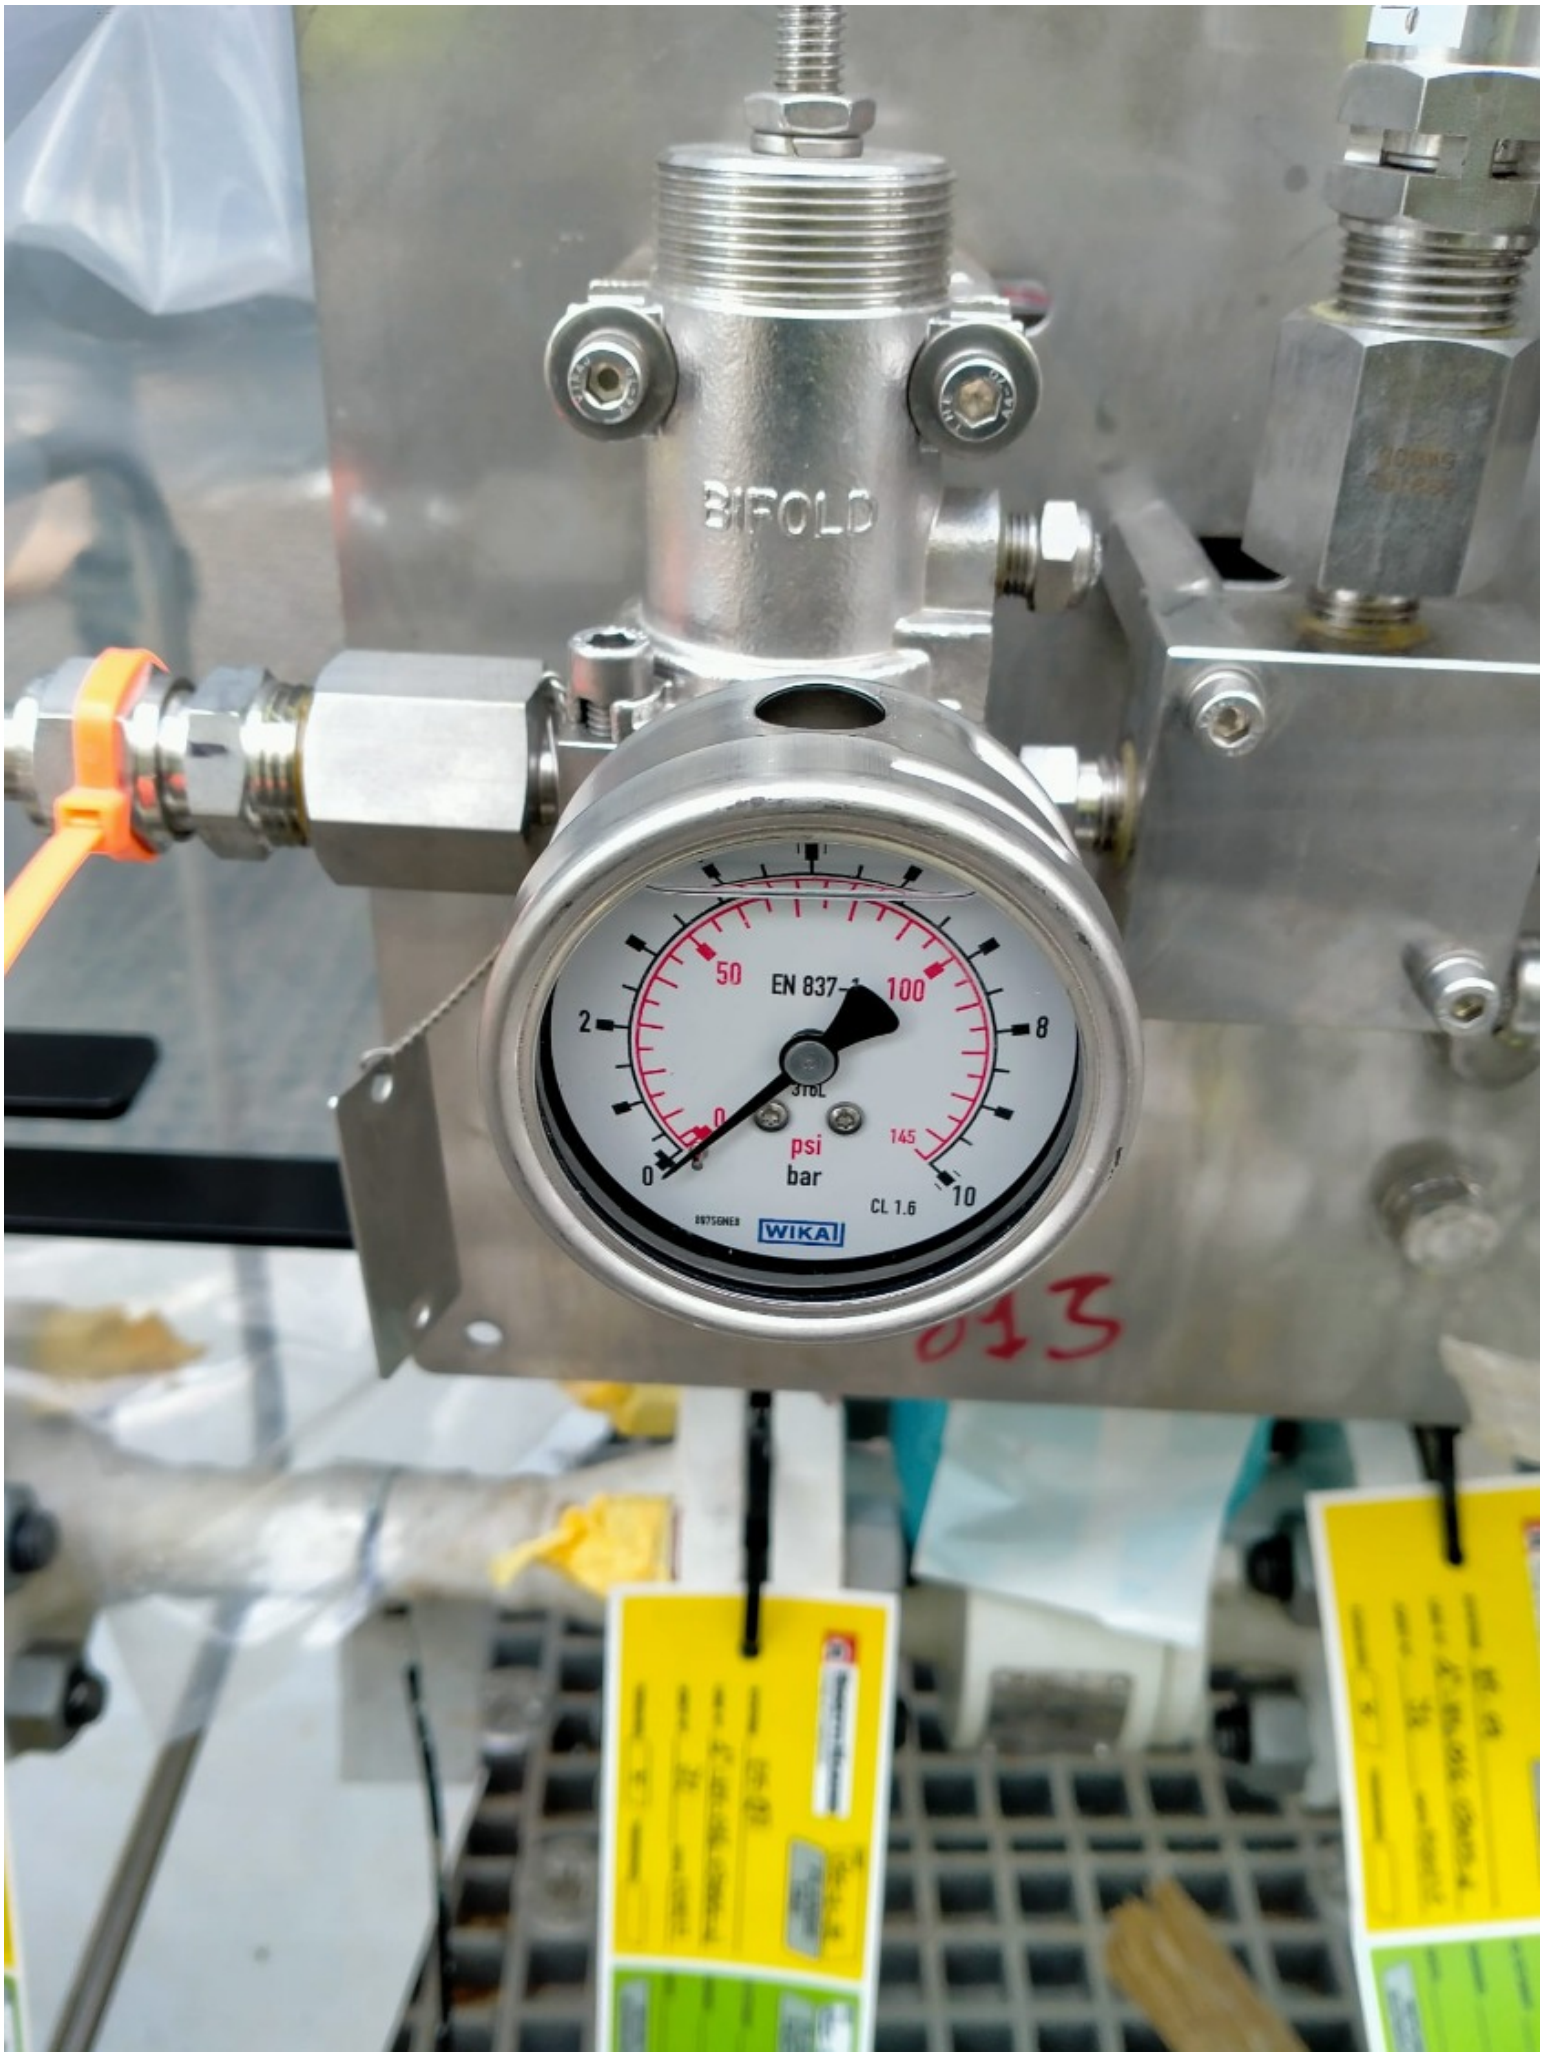
BIFOLD
50
100
2
8
0
psi
bar
145
10
CL 1.6
WIKA
013

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003452

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004825	1.4 Discipline	ATEX
1.2 Item	25-PG -014	Air Set Pressure Gauge Filter - Vessel V-25001D Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Equipment tag is missing

Name: Luca Mussi

Date: 2025-02-01

Signature: Digitaly signed by Luca Mussi 2025-02-01T11:10:04.800Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-01
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-01T11:10:22.347Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-16

Signature: Digitaly signed by Luca Mussi 2025-02-16T10:51:02.780Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003453

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004825	1.4 Discipline	ATEX
1.2 Item	25-PG -014		Air Set Pressure Gauge Filter - Vessel V-25001D Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment Atex label is missing

Name: Luca Mussi

Date: 2025-02-01

Signature: Digitaly signed by Luca Mussi 2025-02-01T11:10:43.344Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-01
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-01T11:11:01.250Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Installed.

Name: Lorenzo Novaga

Date: 2025-04-09

Signature: Digitaly signed by Lorenzo Novaga 2025-04-09T09:56:06.644Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003454

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004827	1.4 Discipline	ATEX
1.2 Item	25-PG -017	Air Set Pressure Gauge Filter - Vessel V-25001E Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Equipment tag plate is missing

Name: Luca Mussi

Date: 2025-02-01

Signature: Digitaly signed by Luca Mussi 2025-02-01T11:40:42.366Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-01
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-01T11:41:00.866Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-16

Signature: Digitaly signed by Luca Mussi 2025-02-16T10:51:17.968Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003455

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004827	1.4 Discipline	ATEX
1.2 Item	25-PG -017	Air Set Pressure Gauge Filter - Vessel V-25001E Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Equipment ATEX label is missing

Name: Luca Mussi

Date: 2025-02-01

Signature: Digitaly signed by Luca Mussi 2025-02-01T11:41:30.415Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-01
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-01T11:41:44.422Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Installed.

Name: Lorenzo Novaga

Date: 2025-04-09

Signature: Digitaly signed by Lorenzo Novaga 2025-04-09T09:56:14.101Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003456

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004829	1.4 Discipline	ATEX
1.2 Item	25-PG -020	Air Set Pressure Gauge Filter - Vessel V-25001F Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Equipment tag plate is missing

Name: Luca Mussi

Date: 2025-02-01

Signature: Digitaly signed by Luca Mussi 2025-02-01T11:44:31.621Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-01
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-01T11:44:44.730Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-16

Signature: Digitaly signed by Luca Mussi 2025-02-16T10:51:26.462Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003457

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004829	1.4 Discipline	ATEX
1.2 Item	25-PG -020	Air Set Pressure Gauge Filter - Vessel V-25001F Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Equipment ATEX label is missing

Name: Luca Mussi

Date: 2025-02-01

Signature: Digitaly signed by Luca Mussi 2025-02-01T11:45:08.393Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-01
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-01T11:45:20.298Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Installed.

Name: Lorenzo Novaga

Date: 2025-04-09

Signature: Digitaly signed by Lorenzo Novaga 2025-04-09T09:56:20.506Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003458

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004831	1.4 Discipline	ATEX
1.2 Item	25-PG -024	Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Vent System	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Equipment ATEX label is missing

Name: Luca Mussi

Date: 2025-02-01

Signature: Digitaly signed by Luca Mussi 2025-02-01T11:47:37.784Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-01
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-01T11:47:50.826Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Equipment ATEX label was installed by vendor on site.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T13:24:26.303Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003459

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004831	1.4 Discipline	ATEX
1.2 Item	25-PG -024	Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Vent System	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Equipment tag plate is missing

Name: Luca Mussi

Date: 2025-02-01

Signature: Digitaly signed by Luca Mussi 2025-02-01T11:48:02.909Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-01
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-01T11:48:16.295Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-28

Signature: Digitaly signed by Luca Mussi 2025-02-28T14:38:08.728Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003460

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004846	1.4 Discipline	ATEX
1.2 Item	25-PG-001	Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Shut-Down	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Equipment ATEX label is missing

Name: Luca Mussi

Date: 2025-02-01

Signature: Digitaly signed by Luca Mussi 2025-02-01T11:50:38.851Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-01
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-01T11:50:55.551Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Equipment ATEX label was installed by vendor on site.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T13:24:47.797Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003461

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004846	1.4 Discipline	ATEX
1.2 Item	25-PG-001	Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Shut-Down	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Equipment tag plate is missing

Name: Luca Mussi

Date: 2025-02-01

Signature: Digitaly signed by Luca Mussi 2025-02-01T11:51:08.734Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-01
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-01T11:51:23.109Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-16

Signature: Digitaly signed by Luca Mussi 2025-02-16T10:51:42.790Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003470

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004835	1.4 Discipline	ATEX
1.2 Item	25-PSV-008		Safety Valve - Vessel V-25001B Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment tag plate is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T10:32:39.556Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T10:32:57.101Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-16

Signature: Digitaly signed by Luca Mussi 2025-02-16T10:51:57.650Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003471

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004835	1.4 Discipline	ATEX
1.2 Item	25-PSV-008		Safety Valve - Vessel V-25001B Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX Declaration of Conformity by Manufacturer is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T10:33:32.373Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T10:33:43.309Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Equipment ATEX conformity label was installed by vendor on site.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T13:52:33.688Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003472

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004835	1.4 Discipline	ATEX
1.2 Item	25-PSV-008		Safety Valve - Vessel V-25001B Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX label is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T10:34:18.342Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T10:34:32.160Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Equipment ATEX conformity label was installed by vendor on site.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T13:53:39.656Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003475

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004837	1.4 Discipline	ATEX
1.2 Item	25-PSV-011		Safety Valve - Vessel V-25001C Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX Declaration of Conformity by Manufacturer is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T11:00:50.483Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T11:01:11.573Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Declaration of conformity has been provide by vendor.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T14:08:26.965Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003476

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004837	1.4 Discipline	ATEX
1.2 Item	25-PSV-011		Safety Valve - Vessel V-25001C Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment tag plate is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T11:01:27.279Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T11:01:39.040Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-16

Signature: Digitaly signed by Luca Mussi 2025-02-16T10:52:12.464Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003477

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004837	1.4 Discipline	ATEX
1.2 Item	25-PSV-011	Safety Valve - Vessel V-25001C Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Equipment ATEX identification label is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T11:02:38.083Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T11:02:50.225Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Equipment ATEX label was installed by vendor on site.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T14:12:40.558Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003478

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004839	1.4 Discipline	ATEX
1.2 Item	25-PSV-014		Safety Valve - Vessel V-25001D Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment ATEX identification label is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T11:06:59.402Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T11:07:09.703Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Equipment ATEX label was installed by vendor on site.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T14:12:38.400Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003480

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004839	1.4 Discipline	ATEX
1.2 Item	25-PSV-014		Safety Valve - Vessel V-25001D Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment tag plate is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T11:08:23.763Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T11:08:34.229Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-16

Signature: Digitaly signed by Luca Mussi 2025-02-16T10:52:53.584Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003481

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004839	1.4 Discipline	ATEX
1.2 Item	25-PSV-014		Safety Valve - Vessel V-25001D Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX Declaration of Conformity by Manufacturer is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T11:08:46.280Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T11:08:56.101Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Declaration of conformity has been provide by vendor.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T14:13:31.055Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003482

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004841	1.4 Discipline	ATEX
1.2 Item	25-PSV-017		Safety Valve - Vessel V-25001E Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment ATEX identification label is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T11:14:06.255Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T11:14:36.874Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Equipment ATEX label was installed by vendor on site.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T14:13:52.653Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003483

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004841	1.4 Discipline	ATEX
1.2 Item	25-PSV-017		Safety Valve - Vessel V-25001E Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX Declaration of Conformity by Manufacturer is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T11:14:52.127Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T11:15:32.431Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Declaration of conformity has been provide by vendor.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T14:14:11.495Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003484

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004841	1.4 Discipline	ATEX
1.2 Item	25-PSV-017	Safety Valve - Vessel V-25001E Hydrogen Inlet	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Equipment tag plate is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T11:16:02.680Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T11:16:14.673Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-16

Signature: Digitaly signed by Luca Mussi 2025-02-16T10:53:01.089Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003486

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004843	1.4 Discipline	ATEX
1.2 Item	25-PSV-020		Safety Valve - Vessel V-25001F Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment ATEX identification label is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T12:24:17.612Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T12:24:29.145Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Equipment ATEX label was installed by vendor on site.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T14:14:37.211Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003487

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004843	1.4 Discipline	ATEX
1.2 Item	25-PSV-020		Safety Valve - Vessel V-25001F Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX Declaration of Conformity by Manufacturer is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T12:24:45.898Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T12:25:03.420Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Declaration of conformity has been provide by vendor.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T14:15:02.418Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003488

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004843	1.4 Discipline	ATEX
1.2 Item	25-PSV-020		Safety Valve - Vessel V-25001F Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment tag plate is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T12:25:18.386Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T12:25:29.953Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-16

Signature: Digitaly signed by Luca Mussi 2025-02-16T10:53:09.639Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003490

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004845	1.4 Discipline	ATEX
1.2 Item	25-PSV-024		Safety Valve - Hyrogen to Vessels Inlet Header Vent System
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment ATEX identification label is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T12:30:05.508Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T12:30:22.354Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Equipment ATEX label was installed by vendor on site.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T14:15:23.811Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003491

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004845	1.4 Discipline	ATEX
1.2 Item	25-PSV-024		Safety Valve - Hyrogen to Vessels Inlet Header Vent System
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX Declaration of Conformity by Manufacturer is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T12:30:38.955Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T12:30:58.067Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Declaration of conformity has been provide by vendor.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T14:15:43.106Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003492

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004845	1.4 Discipline	ATEX
1.2 Item	25-PSV-024		Safety Valve - Hyrogen to Vessels Inlet Header Vent System
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment tag plate is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T12:31:43.152Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T12:31:54.614Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-16

Signature: Digitaly signed by Luca Mussi 2025-02-16T10:53:19.767Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003494

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004849	1.4 Discipline	ATEX
1.2 Item	25-PSV-001		Safety Valve - Hyrogen to Vessels Inlet Header Shut-Down
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment ATEX identification label is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T12:34:32.819Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T12:34:44.967Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Equipment ATEX label was installed by vendor on site.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T14:16:11.516Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003495

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004849	1.4 Discipline	ATEX
1.2 Item	25-PSV-001		Safety Valve - Hyrogen to Vessels Inlet Header Shut-Down
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX Declaration of Conformity by Manufacturer is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T12:35:01.078Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T12:35:12.203Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Declaration of conformity has been provide by vendor.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T14:16:28.065Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003496

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004849	1.4 Discipline	ATEX
1.2 Item	25-PSV-001		Safety Valve - Hyrogen to Vessels Inlet Header Shut-Down
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment tag plate is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T12:35:25.742Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T12:35:40.493Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-16

Signature: Digitaly signed by Luca Mussi 2025-02-16T10:53:35.961Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003502

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004833	1.4 Discipline	ATEX
1.2 Item	25-PSV-004		Safety Valve - Vessel V-25001A Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment ATEX identification label is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T12:40:21.365Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T12:40:35.245Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Equipment ATEX label was installed by vendor on site.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T14:17:34.434Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003503

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004833	1.4 Discipline	ATEX
1.2 Item	25-PSV-004		Safety Valve - Vessel V-25001A Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

ATEX Declaration of Conformity by Manufacturer is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T12:41:22.773Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T12:41:35.412Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Declaration of conformity has been provide by vendor.

Name: Giovanni Tangianu

Date: 2025-04-24

Signature: Digitaly signed by Giovanni Tangianu 2025-04-24T14:17:48.776Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003504

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004833	1.4 Discipline	ATEX
1.2 Item	25-PSV-004		Safety Valve - Vessel V-25001A Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Equipment tag plate is missing

Name: Luca Mussi

Date: 2025-02-03

Signature: Digitaly signed by Luca Mussi 2025-02-03T12:41:49.645Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Luca Mussi
3.4 Activity code	MC Mechanical Completion	Date	2025-02-03
3.5 Action by	VND Vendor	Signature	Digitaly signed by Luca Mussi 2025-02-03T12:42:02.341Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done

Name: Luca Mussi

Date: 2025-02-16

Signature: Digitaly signed by Luca Mussi 2025-02-16T10:49:49.764Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003523

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10003279	1.4 Discipline	Piping
1.2 Item	25-07-TP-007	Test Pack 25-07-TP-007	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

General touch up do to, especially near the supports of the piping line.

Name: Kangi Albonetti

Date: 2025-02-05

Signature: Digitaly signed by Kangi Albonetti 2025-02-05T08:58:27.842Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Kangi Albonetti
3.4 Activity code	MC Mechanical Completion	Date	2025-02-05
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Kangi Albonetti 2025-02-05T09:00:49.310Z

4 - PERFORMED ACTION

Name

Date: 2025-03-21

Signature

5 - CLEARANCE CHECK

Done.

Name: Lorenzo Novaga

Date: 2025-03-21

Signature: Digitaly signed by Lorenzo Novaga 2025-03-21T10:48:02.702Z

6- CLEARANCE APPROVAL

Name

Date: 2025-03-21

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003528

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10003279	1.4 Discipline	Piping
1.2 Item	25-07-TP-007	Test Pack 25-07-TP-007	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Color coding and fluid direction are missing.

Name: Kangi Albonetti

Date: 2025-02-05

Signature: Digitaly signed by Kangi Albonetti 2025-02-05T09:05:28.662Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Kangi Albonetti
3.4 Activity code	MC Mechanical Completion	Date	2025-02-05
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Kangi Albonetti 2025-02-05T09:05:45.874Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done.

Name: Lorenzo Novaga

Date: 2025-03-21

Signature: Digitaly signed by Lorenzo Novaga 2025-03-21T09:34:54.648Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003563

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001718	1.4 Discipline	ATEX
1.2 Item	25-XY-011		Solenoid Valve - Vessel V-25001C Hydrogen Inlet
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Missing tag SS , on Solenoid Valve.

Name: Alessio Polo

Date: 2025-02-05

Signature: Digitaly signed by Alessio Polo 2025-02-05T16:22:33.578Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-02-05
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-02-05T16:22:45.837Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-24

Signature: Digitaly signed by Andrea Andreani 2025-02-24T16:00:24.315Z

6- CLEARANCE APPROVAL

Name

Date

Signature

25-XV-011


25-XV-011

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003565

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000088	1.4 Discipline	Instrumental
1.2 Item	C-25-XV-017/00-JE-12004	PROXIMITY SWITCH / MARSHALLING PCS	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

The cable is not support .

Name: Alessio Polo

Date: 2025-02-05

Signature: Digitaly signed by Alessio Polo 2025-02-05T16:35:59.598Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-02-05
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-02-05T16:36:09.351Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-13

Signature: Digitaly signed by Andrea Andreani 2025-02-13T12:24:34.257Z

6- CLEARANCE APPROVAL

Name

Date

Signature


AV-63002/25-XV-01
X1


AV-63002/25
ROSETTI MARINO
SYSTEM
FRAME
TAG
TORQUED
DATE
TORQUED

ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003567

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000176	1.4 Discipline	Instrumental
1.2 Item	C-25-SDY-001/00-JE-23002	SOLENOID VALVE / MARSHALLING PCS	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

the cable installed is temporary. To be replaced

Name: Alessio Polo

Date: 2025-02-05

Signature: Digitaly signed by Alessio Polo 2025-02-05T16:57:26.590Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-02-05
3.5 Action by	PRE-COMM	Signature	Digitaly signed by Alessio Polo 2025-02-05T16:57:36.277Z

4 - PERFORMED ACTION

Name

Date: 2025-04-08

Signature

5 - CLEARANCE CHECK

THE CABLE HAS BEEN REPLACED.

Name: Giovanni Tangianu

Date: 2025-04-07


Signature: Digitaly signed by Giovanni Tangianu 2025-04-07T12:17:47.992Z

6- CLEARANCE APPROVAL

Name

Date: 2025-04-08

Signature

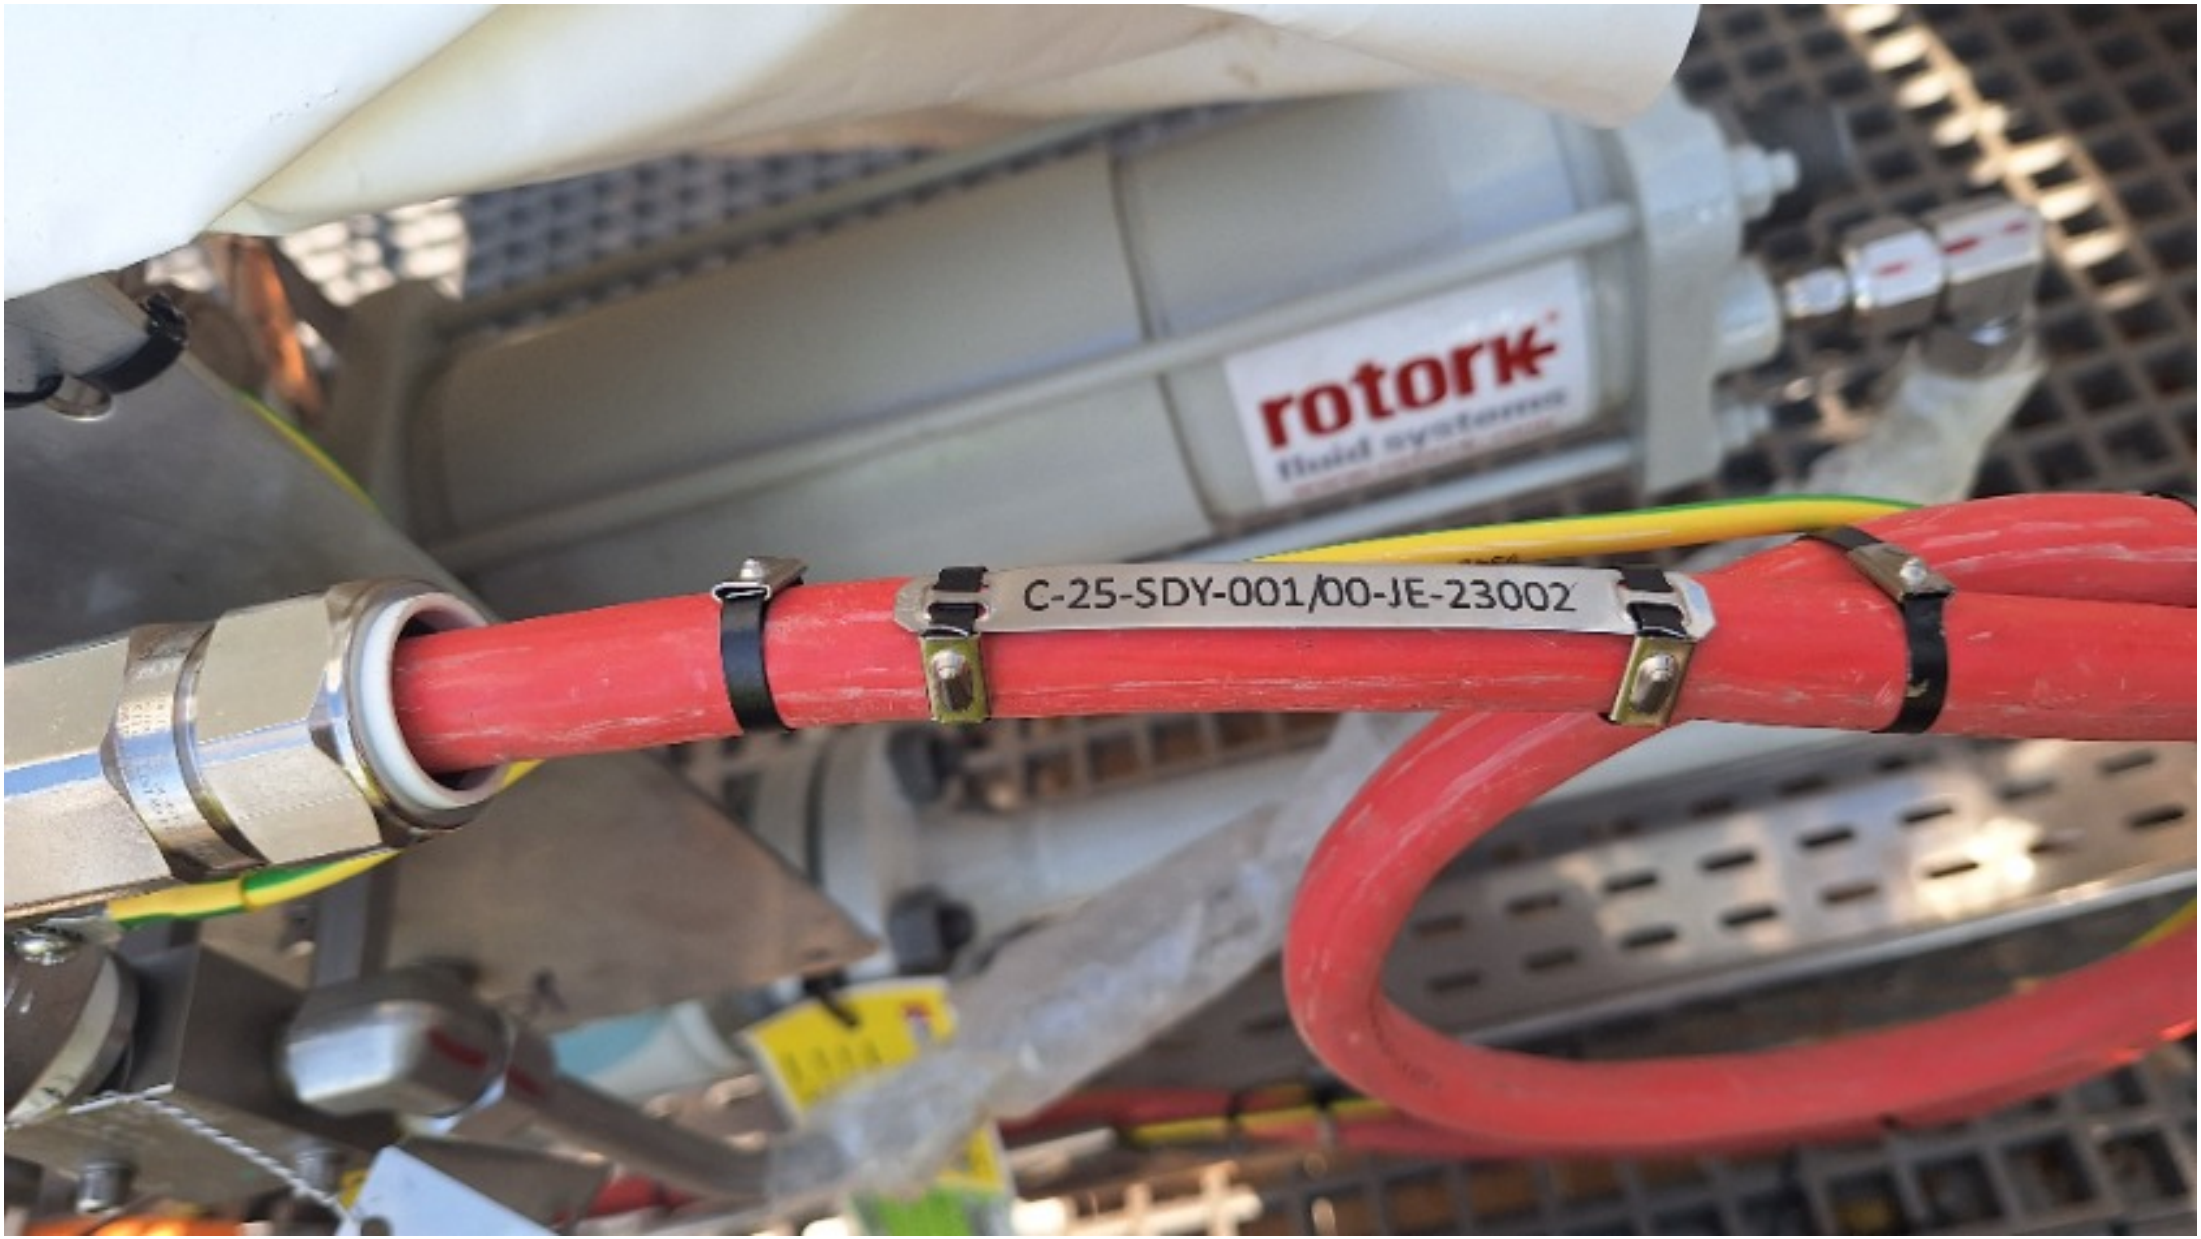
rotork
fluid systems
C-25-SDY-001/00-JE-23002


rotork
fluid system
www.rotork.c

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003569

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001712	1.4 Discipline	ATEX
1.2 Item	25-SDY-001	Solenoid Valve - Hyrogen to Vessels Inlet Header Shut-Down	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Missing tag SS , on Solenoid Valve.

Name: Alessio Polo

Date: 2025-02-05

Signature: Digitaly signed by Alessio Polo 2025-02-05T17:05:51.052Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-02-05
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-02-05T17:06:11.443Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-24

Signature: Digitaly signed by Andrea Andreani 2025-02-24T16:00:39.360Z

6- CLEARANCE APPROVAL

Name

Date

Signature


TESTED
25-SDV-001
www.rotork.com

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003579

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004793	1.4 Discipline	Piping
1.2 Item	25-07-TP-068	Test Pack 25-07-TP-068	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

All support and standard will be check during reinstatement phase

Name: Lorenzo Novaga

Date: 2025-02-06

Signature: Digitaly signed by Lorenzo Novaga 2025-02-06T16:11:54.936Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Lorenzo Novaga
3.4 Activity code	MC Mechanical Completion	Date	2025-02-06
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Lorenzo Novaga 2025-02-06T16:12:05.741Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Done.

Name: Kangi Albonetti

Date: 2025-02-25

Signature: Digitaly signed by Kangi Albonetti 2025-02-25T16:26:34.721Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003602

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000136	1.4 Discipline	Instrumental
1.2 Item	C-25-PT-002/00-JE-21002	PRESSURE TRANSMITTER / MARSHALLING PCS	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Missing the "side slot" on the cable tray (for cable passage) so that the cable is not in crash with the piping.

Name: Alessio Polo

Date: 2025-02-08

Signature: Digitaly signed by Alessio Polo 2025-02-08T09:42:04.661Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-02-08
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-02-08T09:42:19.174Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Josip Krizanic

Date: 2025-02-22

Signature: Digitaly signed by Josip Krizanic 2025-02-22T10:18:02.834Z

6- CLEARANCE APPROVAL

Name

Date

Signature



ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003603

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001483	1.4 Discipline	ATEX
1.2 Item	25-PT-002		Pressure Transmitter - Hyrogen to Vessels Inlet Header Shut-Down
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Missing the drainage device (tubing).

Name: Alessio Polo

Date: 2025-02-08

Signature: Digitaly signed by Alessio Polo 2025-02-08T10:20:07.018Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-02-08
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-02-08T10:20:16.228Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Josip Krizanic

Date: 2025-02-22

Signature: Digitaly signed by Josip Krizanic 2025-02-22T10:18:21.743Z

6- CLEARANCE APPROVAL

Name

Date

Signature



ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003604

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001483	1.4 Discipline	ATEX
1.2 Item	25-PT-002		Pressure Transmitter - Hyrogen to Vessels Inlet Header Shut-Down
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Missing tag SS , on the instrument.

Name: Alessio Polo

Date: 2025-02-08

Signature: Digitaly signed by Alessio Polo 2025-02-08T10:20:50.677Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-02-08
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-02-08T10:21:03.268Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-24

Signature: Digitaly signed by Andrea Andreani 2025-02-24T16:00:49.710Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003605

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001483	1.4 Discipline	ATEX
1.2 Item	25-PT-002		Pressure Transmitter - Hyrogen to Vessels Inlet Header Shut-Down
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Missing traffolyte tag side instrument

Name: Alessio Polo

Date: 2025-02-08

Signature: Digitaly signed by Alessio Polo 2025-02-08T10:21:17.453Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-02-08
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-02-08T10:21:26.268Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-13

Signature: Digitaly signed by Andrea Andreani 2025-02-13T12:23:17.163Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003606

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000048	1.4 Discipline	Instrumental
1.2 Item	C-25-PT-001/00-JE-11003	PRESSURE TRANSMITTER / MARSHALLING PCS	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Missing the "side slot" on the cable tray (for cable passage) so that the cable is not in crash with the piping.

Name: Alessio Polo

Date: 2025-02-08

Signature: Digitaly signed by Alessio Polo 2025-02-08T10:23:37.932Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-02-08
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-02-08T10:23:48.380Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-28

Signature: Digitaly signed by Andrea Andreani 2025-02-28T15:32:54.190Z

6- CLEARANCE APPROVAL

Name

Date

Signature



ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003607

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000048	1.4 Discipline	Instrumental
1.2 Item	C-25-PT-001/00-JE-11003	PRESSURE TRANSMITTER / MARSHALLING PCS	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Missing cable tag SS , near JB 00-JE-11003

Name: Alessio Polo

Date: 2025-02-08

Signature: Digitaly signed by Alessio Polo 2025-02-08T10:24:42.204Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-02-08
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-02-08T10:24:51.758Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-02-21

Signature: Digitaly signed by Alessio Polo 2025-02-21T15:51:36.002Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003608

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001482	1.4 Discipline	ATEX
1.2 Item	25-PT-001		Pressure Transmitter - Hyrogen to Vessels Inlet Header
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Missing tag SS , on the instrument.

Name: Alessio Polo

Date: 2025-02-08

Signature: Digitaly signed by Alessio Polo 2025-02-08T10:28:25.467Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-02-08
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-02-08T10:28:34.486Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-24

Signature: Digitaly signed by Andrea Andreani 2025-02-24T16:01:00.079Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003609

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001482	1.4 Discipline	ATEX
1.2 Item	25-PT-001		Pressure Transmitter - Hyrogen to Vessels Inlet Header
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Missing traffolyte tag side instrument

Name: Alessio Polo

Date: 2025-02-08

Signature: Digitaly signed by Alessio Polo 2025-02-08T10:28:48.985Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-02-08
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-02-08T10:28:58.364Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-13

Signature: Digitaly signed by Andrea Andreani 2025-02-13T12:23:00.004Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30003610

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001482	1.4 Discipline	ATEX
1.2 Item	25-PT-001		Pressure Transmitter - Hyrogen to Vessels Inlet Header
1.3 Subsystem	25-07		Hydrogen Storage Vessels Header (Inlet)

2 - OBSERVATION

Missing the drainage device (tubing)

Name: Alessio Polo

Date: 2025-02-08

Signature: Digitaly signed by Alessio Polo 2025-02-08T10:30:12.108Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2025-02-08
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Alessio Polo 2025-02-08T10:30:23.434Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-28

Signature: Digitaly signed by Andrea Andreani 2025-02-28T15:32:19.045Z

6- CLEARANCE APPROVAL

Name

Date

Signature


ISOLATE

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30004109

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004794	1.4 Discipline	Piping
1.2 Item	25-07-TP-068	Test Pack 25-07-TP-068	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

The hole on the ptfe on new support (see PL C30004108) is larger than the diameter of the washer.

Name: Lorenzo Novaga

Date: 2025-02-25

Signature: Digitaly signed by Lorenzo Novaga 2025-02-25T07:44:32.029Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Lorenzo Novaga
3.4 Activity code	MC Mechanical Completion	Date	2025-02-25
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Lorenzo Novaga 2025-02-25T07:44:41.177Z

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

Teflon has been swapped with new drilled one. Corrected.

Name: Kangi Albonetti

Date: 2025-02-25

Signature: Digitaly signed by Kangi Albonetti 2025-02-25T16:27:36.935Z

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30004166

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10004795	1.4 Discipline	Piping
1.2 Item	25-07-TP-068	Test Pack 25-07-TP-068	
1.3 Subsystem	25-07	Hydrogen Storage Vessels Header (Inlet)	

2 - OBSERVATION

Color coding and fluid direction are missing.

Name: Kangi Albonetti

Date: 2025-02-27

Signature: Digitaly signed by Kangi Albonetti 2025-02-27T15:42:53.151Z

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Kangi Albonetti
3.4 Activity code	MC Mechanical Completion	Date	2025-02-27
3.5 Action by	RM_CONSTR RM	Signature	Digitaly signed by Kangi Albonetti 2025-02-27T15:43:06.563Z

4 - PERFORMED ACTION

Name

Date: 2025-03-21

Signature

5 - CLEARANCE CHECK

Done.

Name: Lorenzo Novaga

Date: 2025-03-21

Signature: Digitaly signed by Lorenzo Novaga 2025-03-21T14:02:04.706Z

6- CLEARANCE APPROVAL

Name

Date: 2025-03-21

Signature


Section 3 SYSTEM,SUB-SYSTEM LIMIT DRAWINGS

DRAWING NO. DRAWING_NO.

REV. REV

Hydrogen Vent Header & Drum System SS 43-00

Hydrogen Storage Vessels Header (Inlet) SS 25-07

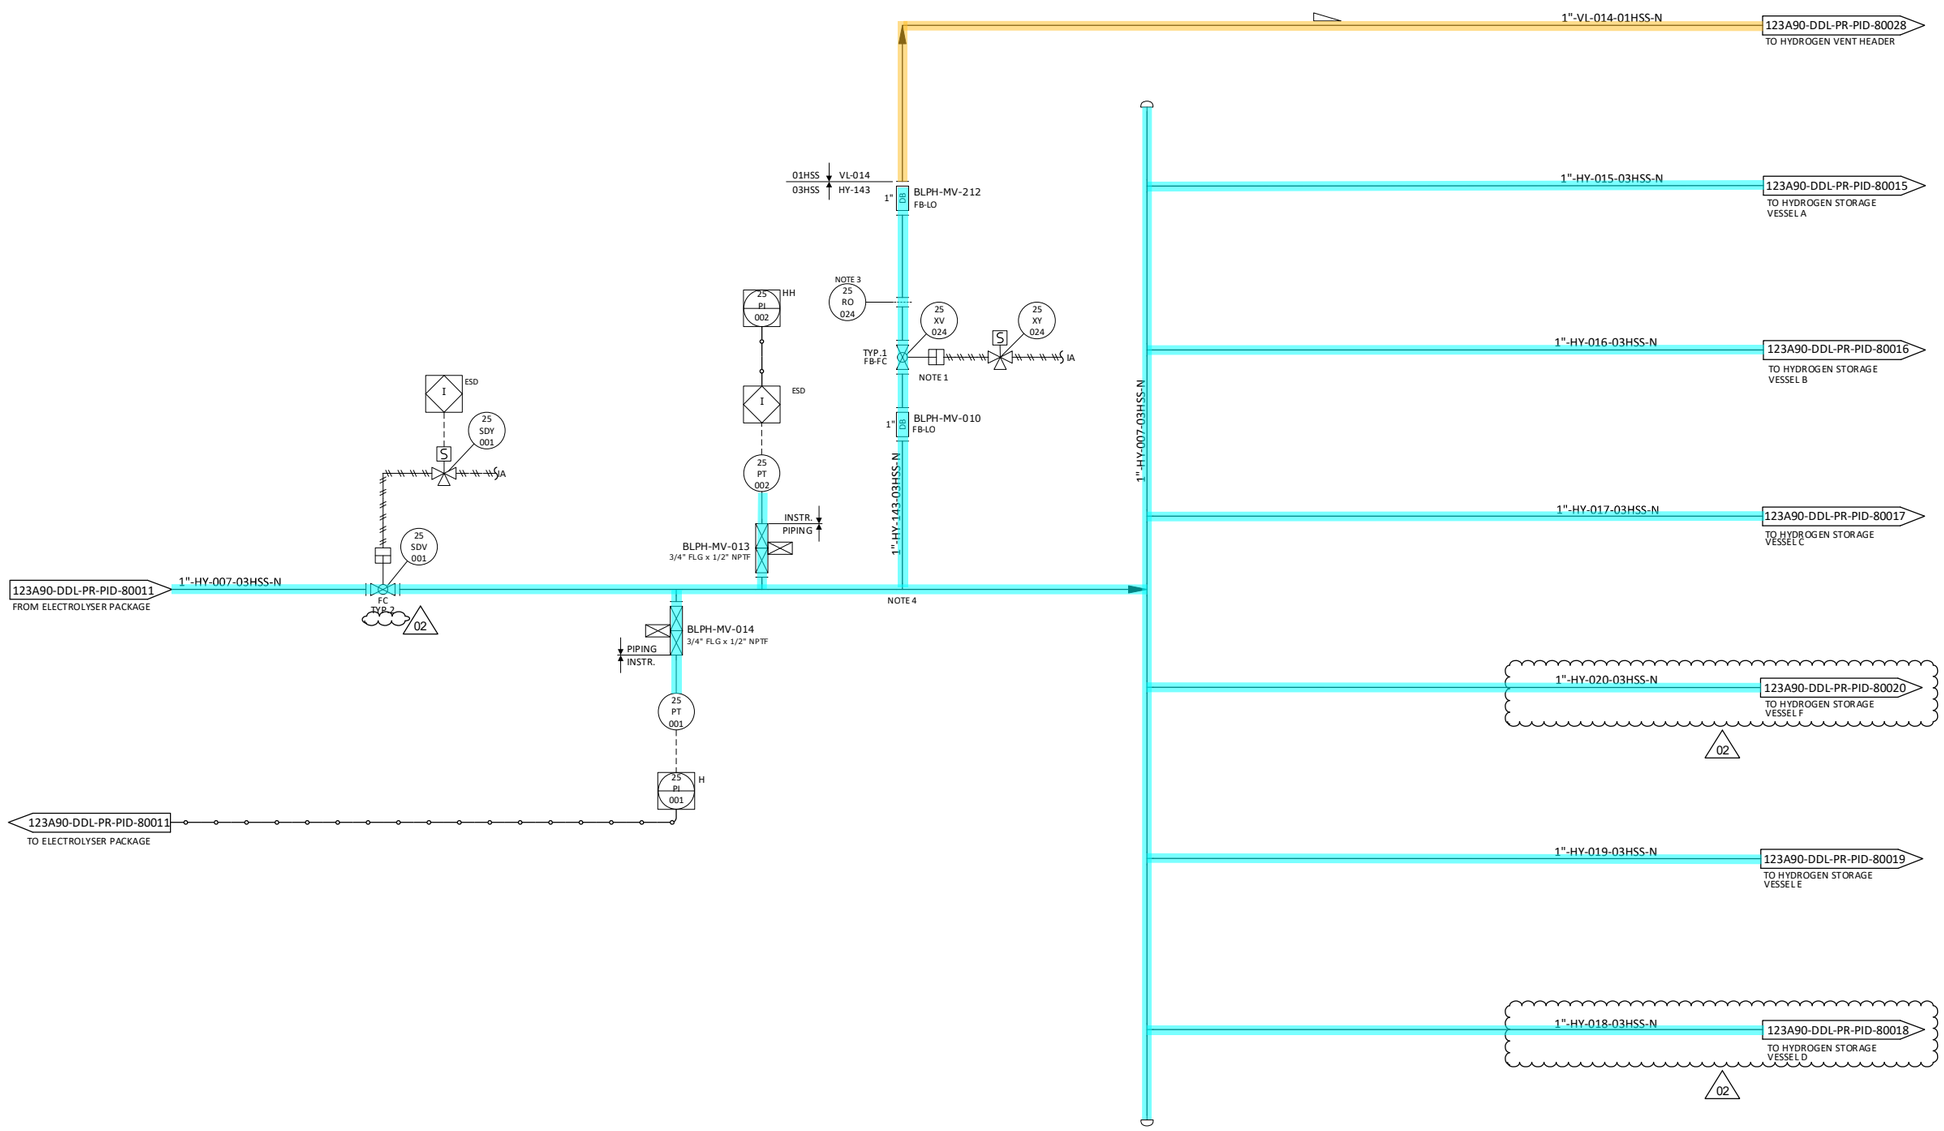

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :

BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSELS HEADER (INLET)

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO.	SHEET	REV.
	123A90-DDL-PR-PID-80013	001	02

File Name : FILE_NAME

DRAWING NO. DRAWING_NO.


REV. REV

Instrumen Air Distribution Network	SS 63-30
Water Desalination & Distribution System	SS 50-10
Hydrogen Storage Vessel Header (Intel)	SS 43-00
Nitrigen Distribution Network	SS 64-11
Waste Water Brine Discharge System	SS 55-01
Waste Water Disposal System	SS 55-00
Hydrigen Storage Vessel Header (Intel)	SS 25-07
Electrolyzer Package	SS 20-00

A-20000

ELECTROLYSER PACKAGE

DUTY: 2.5MW
DESIGN PRESSURE: 40 barg
DESIGN TEMPERATURE: 80 °C
H2 GENERATING CAPACITY: 500 Nm³/h

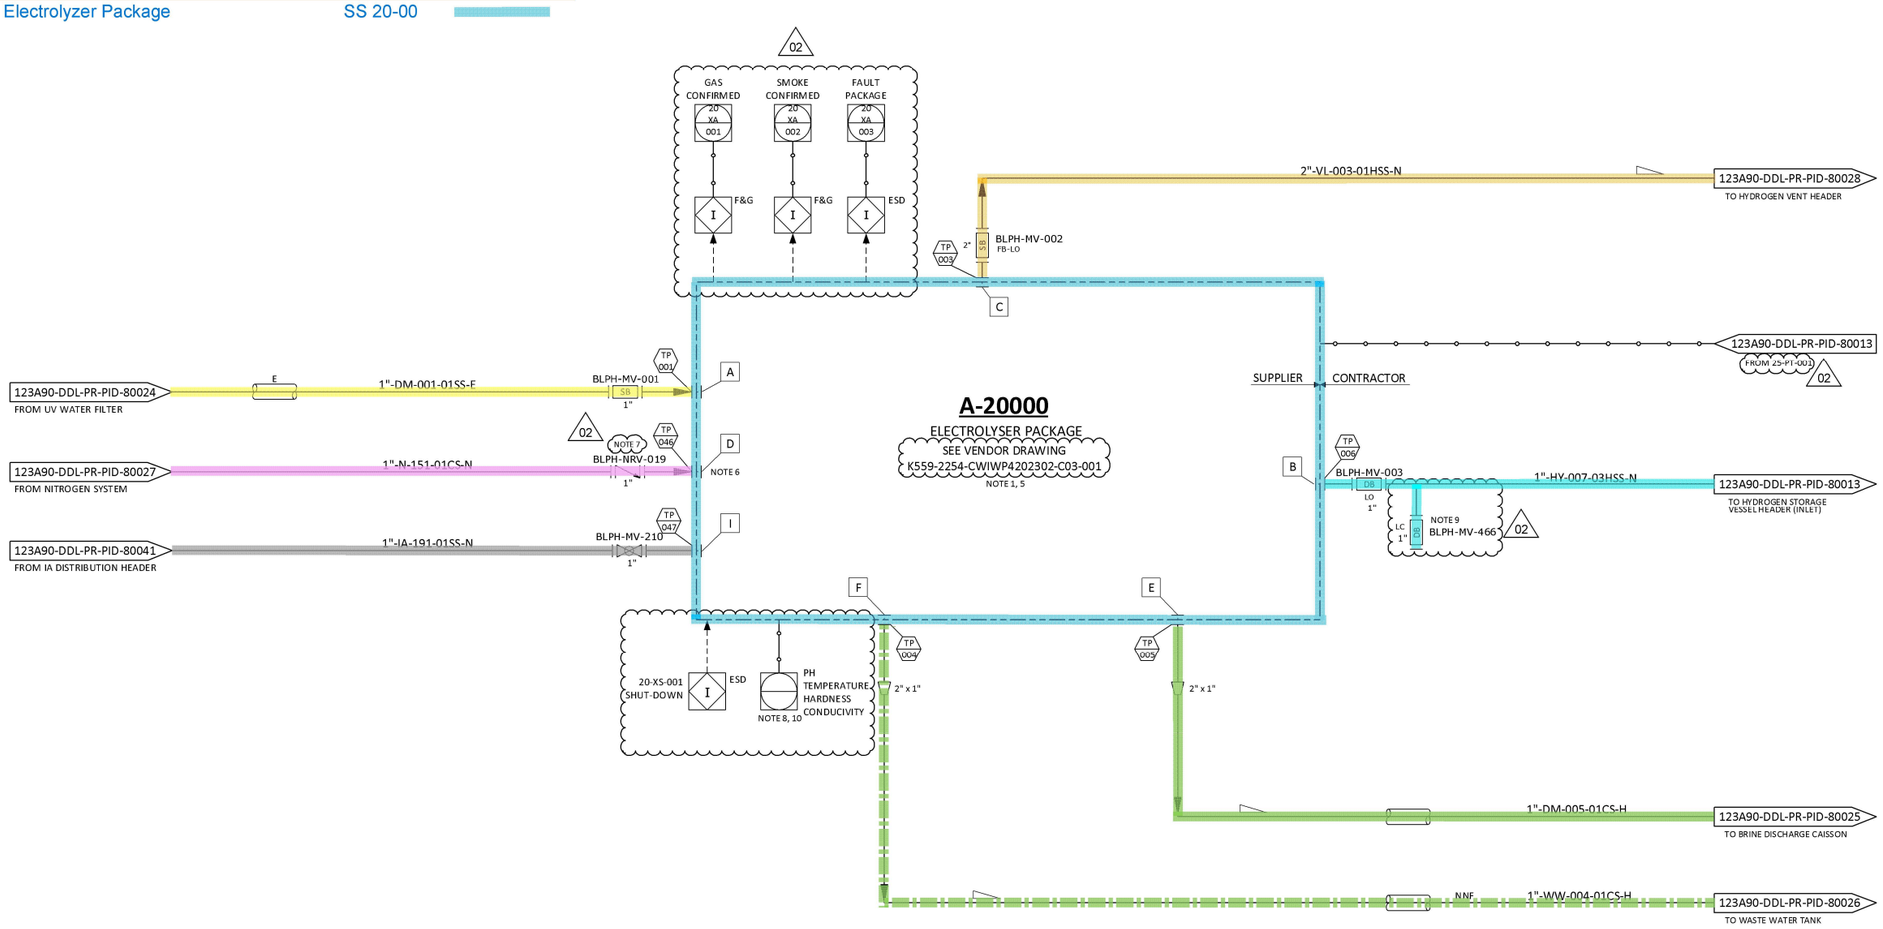

NOTES

1. PACKAGE SUPPLIED WITH POWER FROM THE BLPH ELECTRICAL SYSTEM.
2. DELETED.
3. DELETED.
4. DELETED.
5. ELECTROLYSER PACKAGE INCLUDES AN OXYGEN VENT LINE WHICH IS IN THE SCOPE OF SUPPLY OF THE ELECTROLYSER PACKAGE UP TO THE ATMOSPHERE. NO PHYSICAL INTERFACE IS PRESENT BETWEEN ELECTROLYSER PACKAGE AND CONTRACTOR ON THIS LINE.
6. AN ISOLATION VALVE DOWNSTREAM THE CHECK VALVE NRV-019 IS PROVIDED WITHIN THE PACKAGE A-20000.
7. CHECK VALVE NRV-019 TO BE INSTALLED AS CLOSE AS POSSIBLE TO THE ELECTROLYSER PACKAGE A-20000.
8. SERIAL COMMUNICATION WITH CONTROL SYSTEM.
9. NITROGEN PURGING CONNECTION TO BE LOCATED AS CLOSE AS POSSIBLE TO MANUAL VALVE BLPH-MV-003.
10. PH, TEMPERATURE, HARDNESS AND CONDUCTIVITY SHALL BE SENT FROM CONTROL SYSTEM TO ELECTROLISER UCP IN ADDITION TO THE OTHER SOFTWARE SIGNALS.

02

HOLDS

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
ELECTROLYSER PACKAGE

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80011	SHEET 001	REV. 02

File Name : FILE_NAME

DRAWING_NO. DRAWING_NO.

REV. REV


Hydrogen Storage Vessel A (V-25001A) SS 25-01

Hydrogen Vent Header & Drum System SS 43-00

Hydrogen Storage Vessels Header (inlet) SS 25-07

Hydrogen Storage Vessels Header (Outlet) SS 25-08

Nitrogen Distribution Network SS 64-10

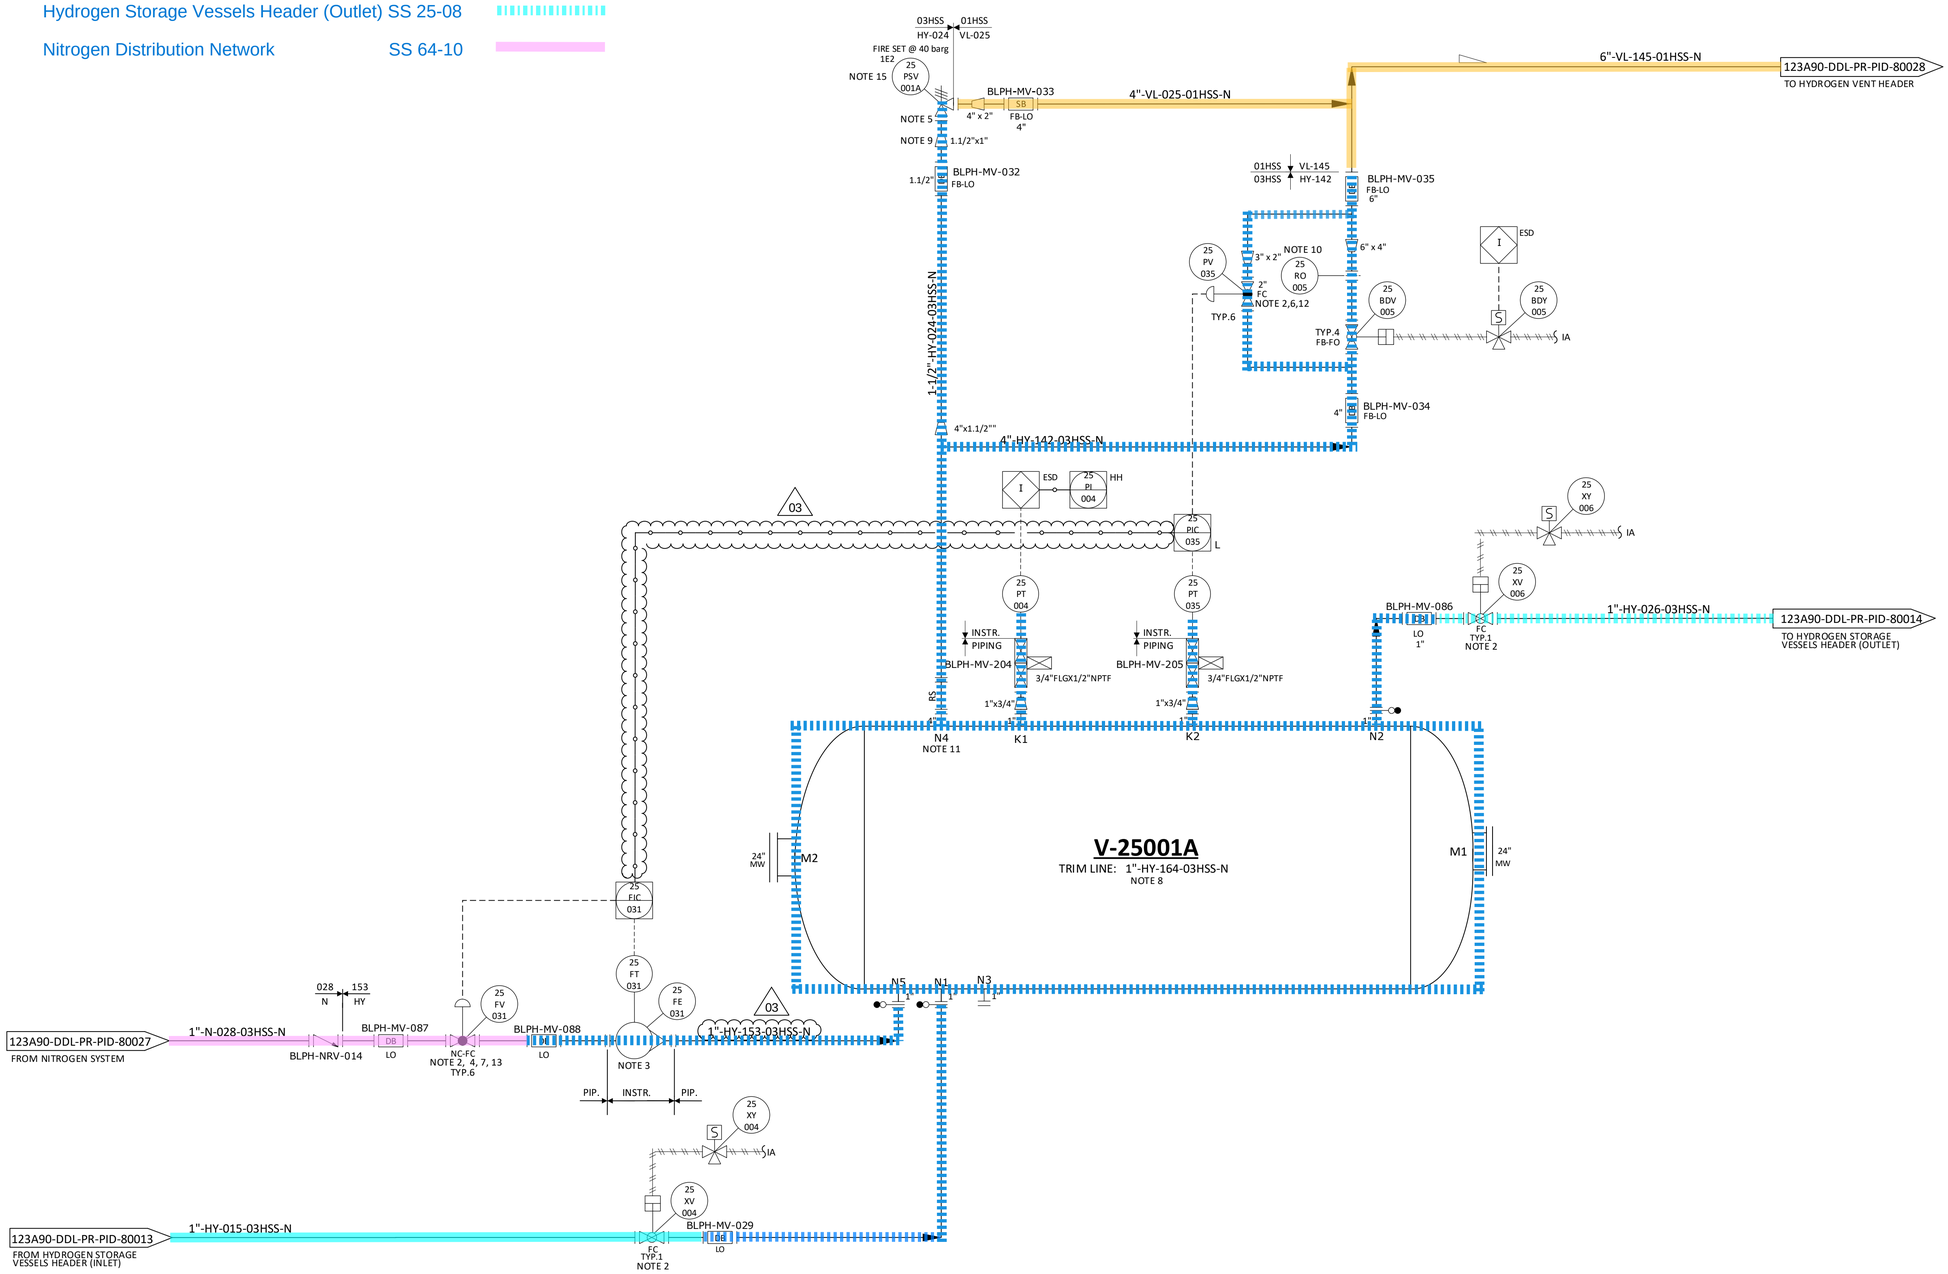

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-031) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-035 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-035 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-031 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-035 HAS FAILED TO CLOSE.
15. 25-PSV-001A SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL A

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO. 123A90-DDL-PR-PID-80015	SHEET 001	REV. 03

File Name : FILE_NAME

DRAWING NO. DRAWING_NO.

REV. REV

Hydrogen Storage Vessel B (V-25001B) SS 25-02

Hydrogen Vent Header & Drum System SS 43-00

Hydrogen Storage Vessels Header (inlet) SS 25-07


Hydrogen Storage Vessels Header (Outlet) SS 25-08

Nitrogen Distribution Network SS 64-10

V-25001 B

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

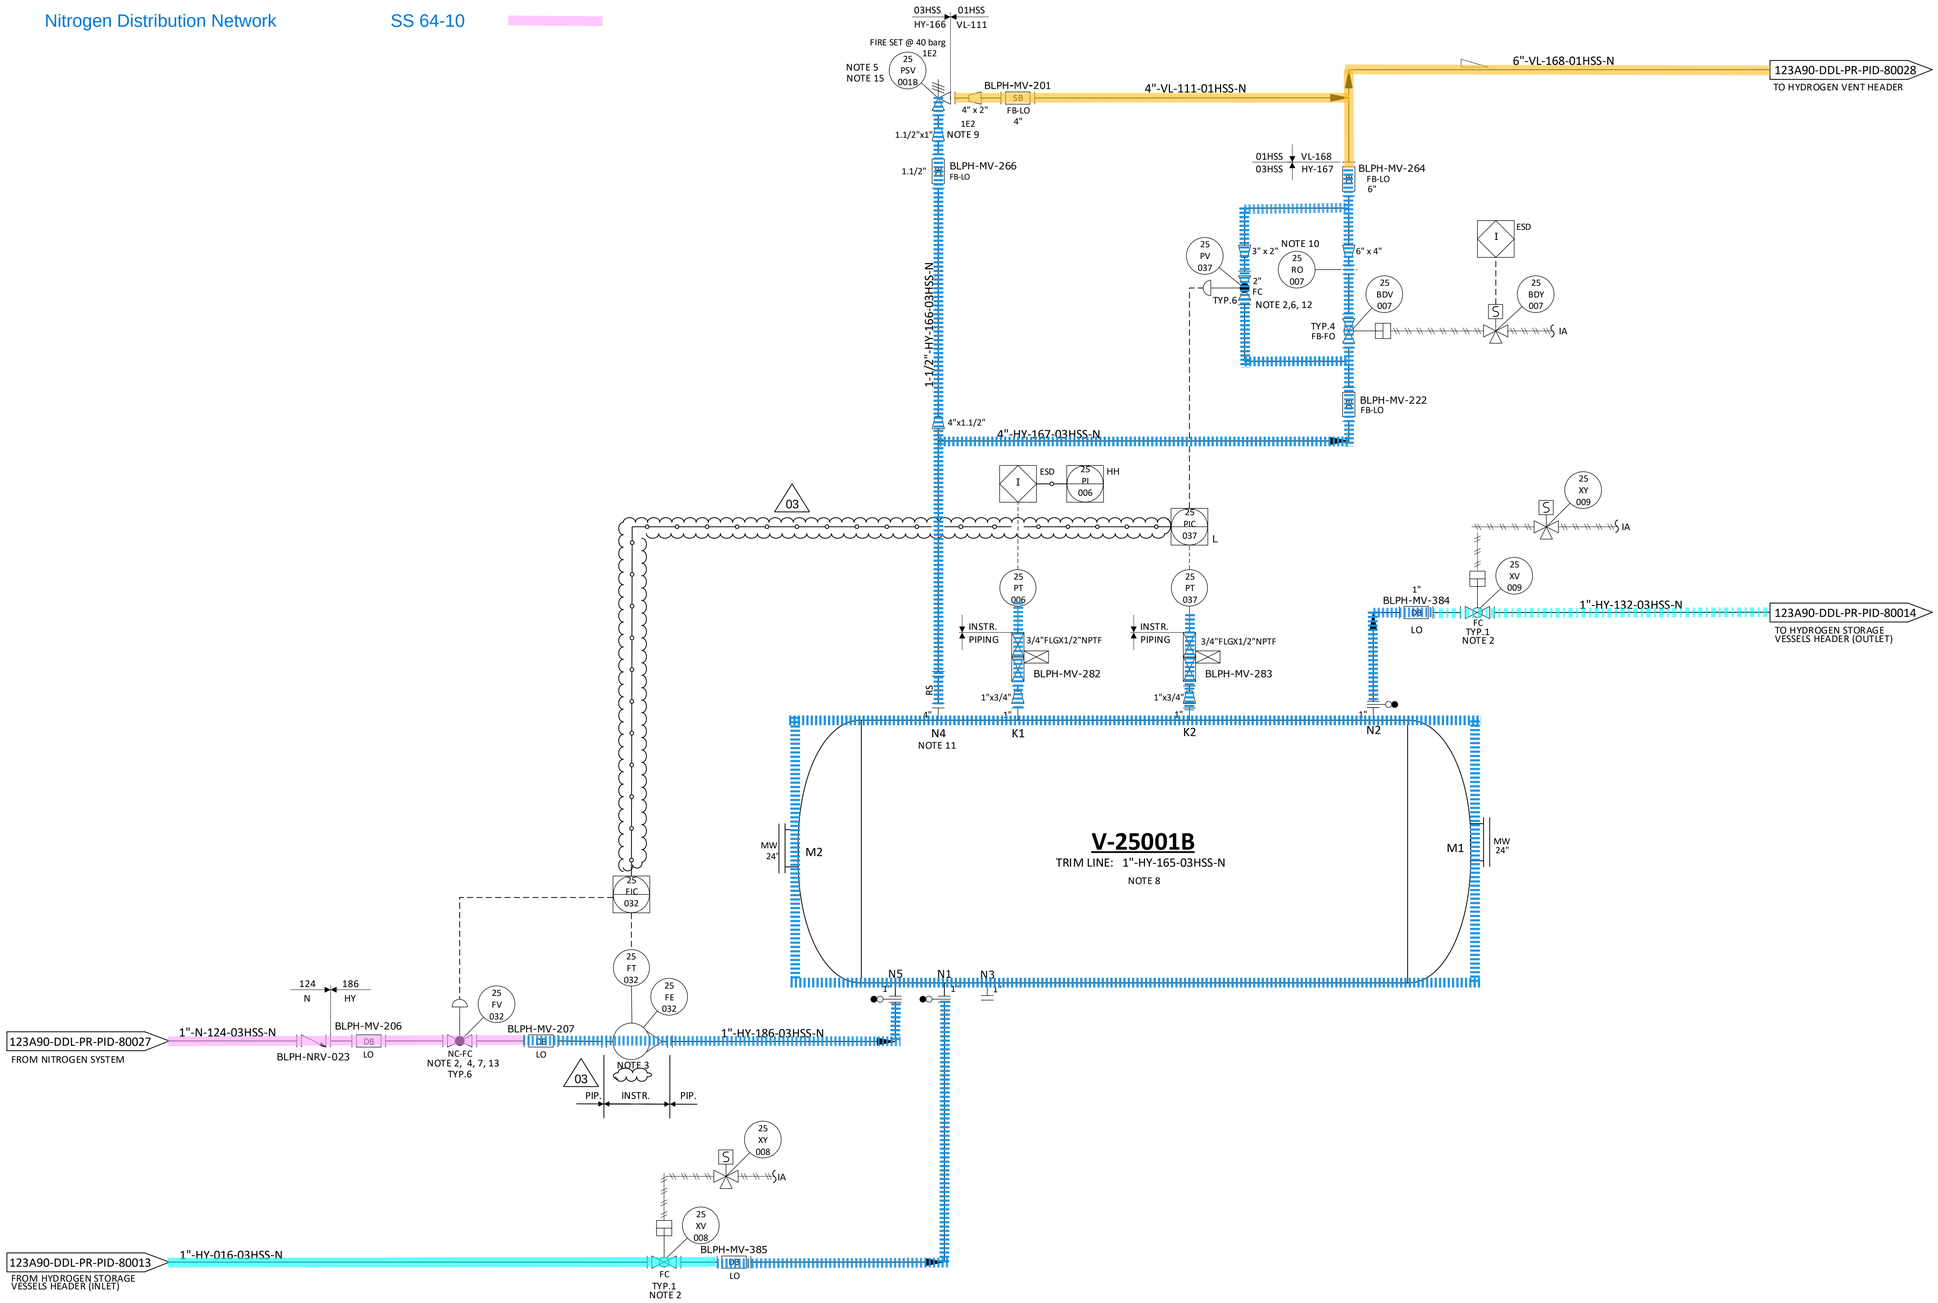

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-032) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-037 BEING OPENED OUTSIDE OR A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC."PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-037 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-032 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-037 HAS FAILED TO CLOSE.
15. 25-PSV-001B SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL B

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-PR-PID-80016	001	03

File Name : FILE_NAME

DRAWING NO. DRAWING_NO.

REV. REV

Hydrogen Storage Vessel C (V-25001C) SS 25-03

Hydrogen Vent Header & Drum System SS 43-00

Hydrogen Storage Vessels Header (inlet) SS 25-07


Hydrogen Storage Vessels Header (Outlet) SS 25-08

Nitrogen Distribution Network SS 64-10

V-25001 C

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

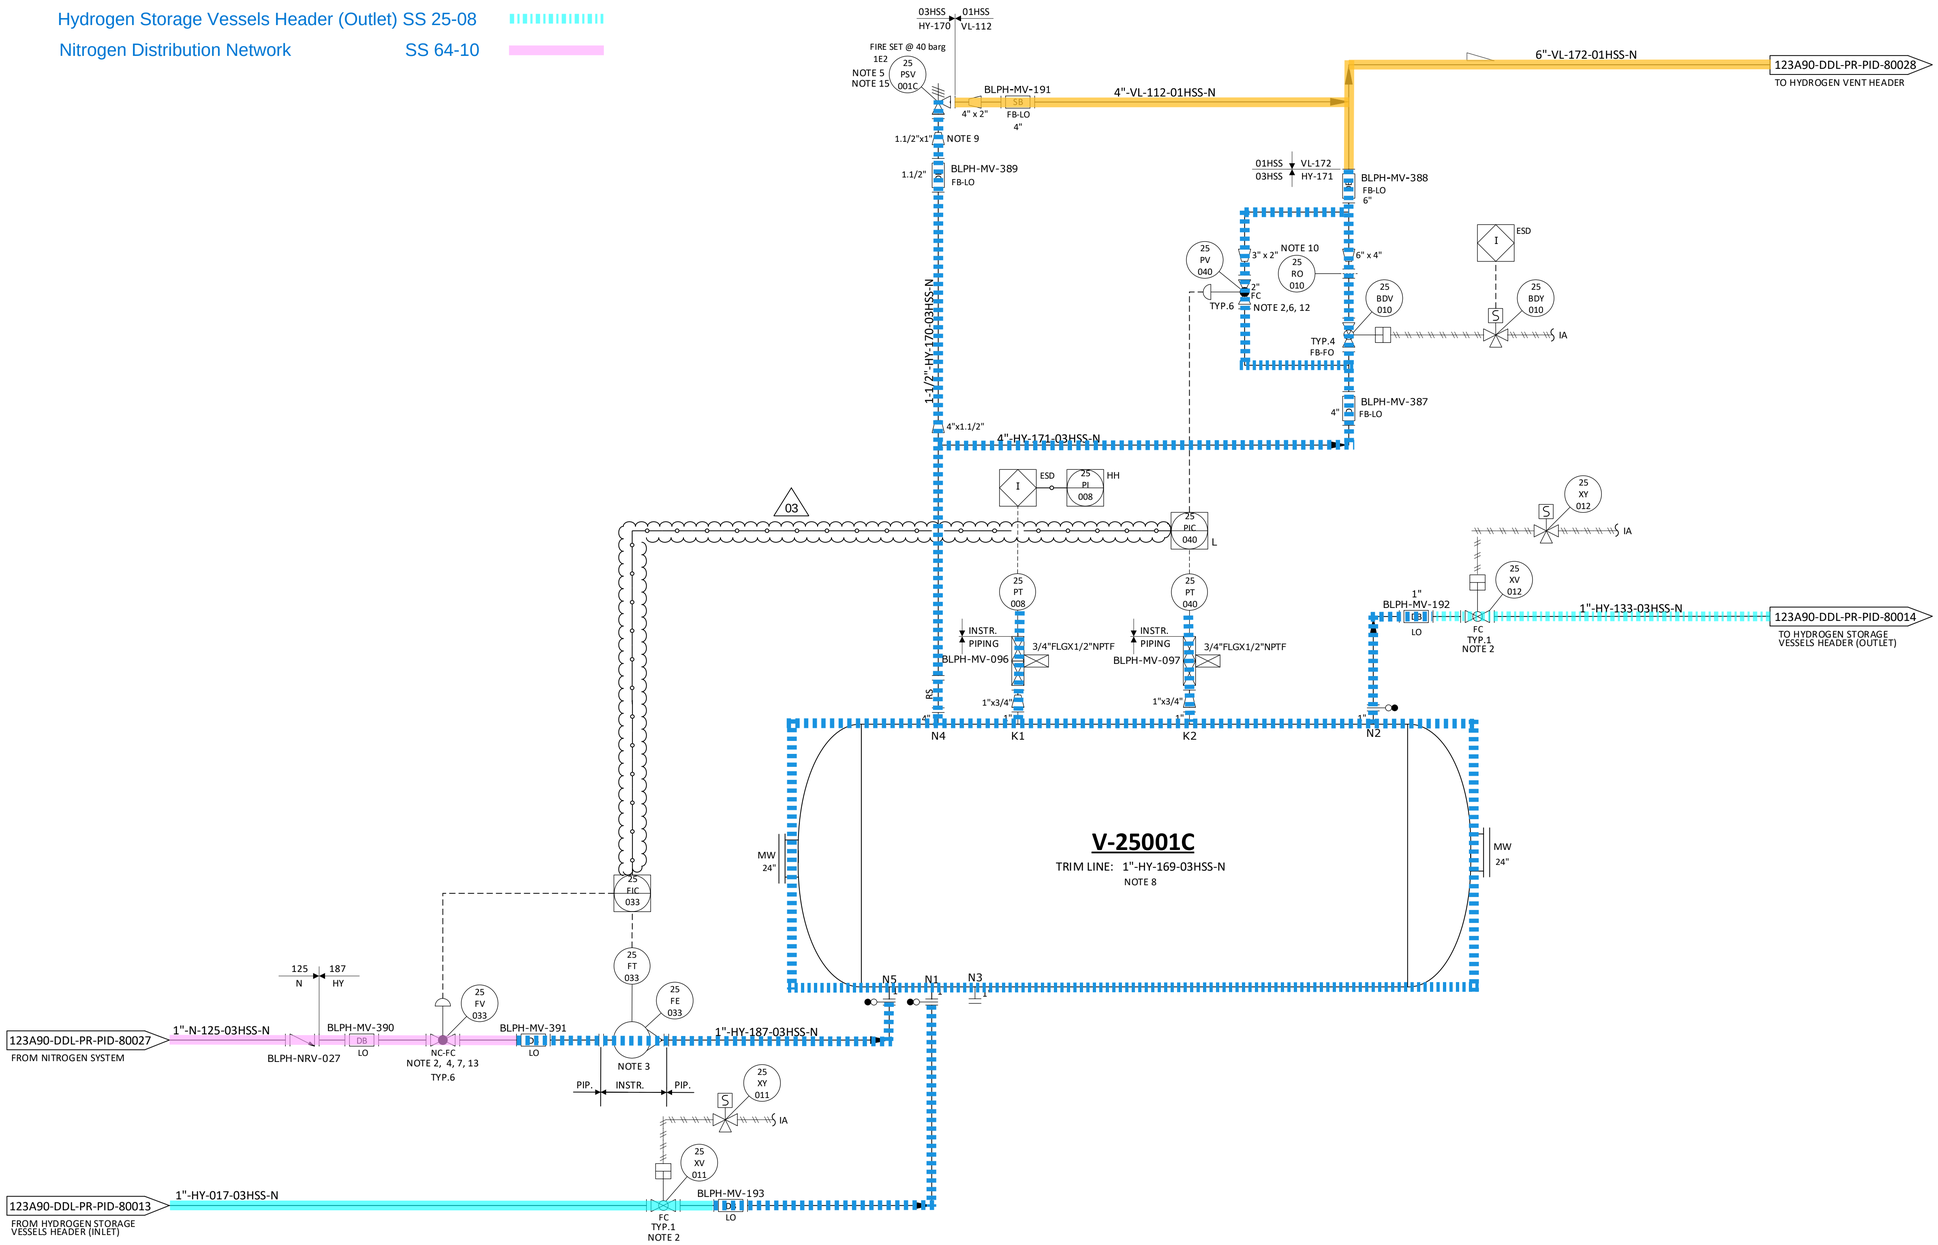

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-033) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-040 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-040 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-033 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-040 HAS FAILED TO CLOSE.
15. 25-PS-V001C SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL C

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80017	SHEET 001	REV. 03

File Name : FILE_NAME

DRAWING NO. DRAWING_NO.

REV. REV

Hydrogen Storage Vessel D (V-25001D) SS 25-04

Hydrogen Vent Header & Drum System SS 43-00

Hydrogen Storage Vessels Header (inlet) SS 25-07


Hydrogen Storage Vessels Header (Outlet) SS 25-08

Nitrogen Distribution Network SS 64-10

V-25001_D

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

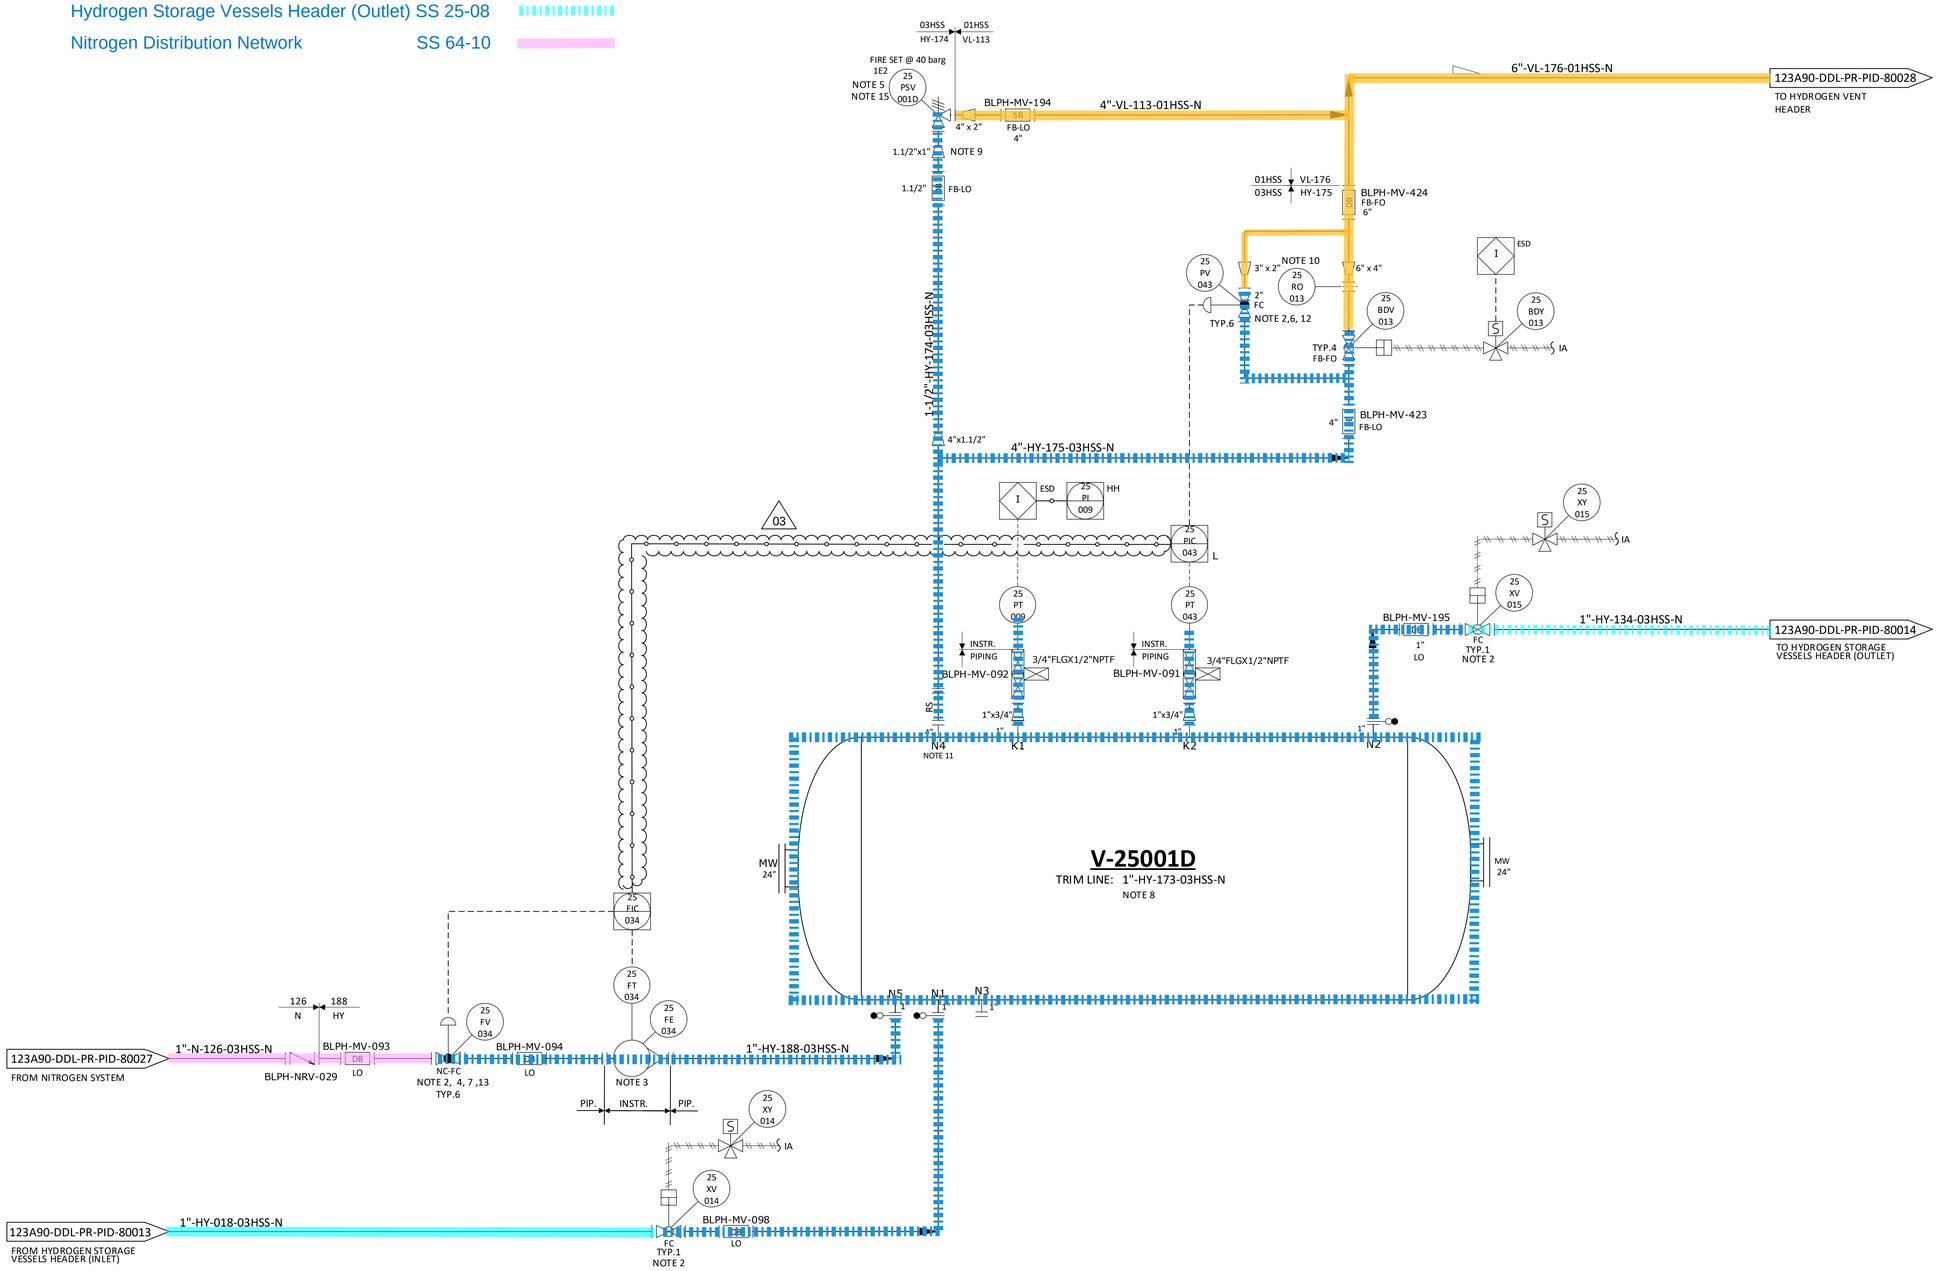

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS. 03
4. NITROGEN CONTROL VALVE (25-FV-034) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE.
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-043 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-043 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-034 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-043 HAS FAILED TO CLOSE.
15. 25-PSV-001D SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL D

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO. 123A90-DDL-PR-PID-80018	SHEET 001	REV. 03

File Name : FILE_NAME

DRAWING NO. DRAWING_NO.

REV. REV


Hydrogen Storage Vessel E (V-25001E) SS 25-05

Hydrogen Vent Header & Drum System SS 43-00

Hydrogen Storage Vessels Header (inlet) SS 25-07

Hydrogen Storage Vessels Header (Outlet) SS 25-08

Nitrogen Distribution Network SS 64-10

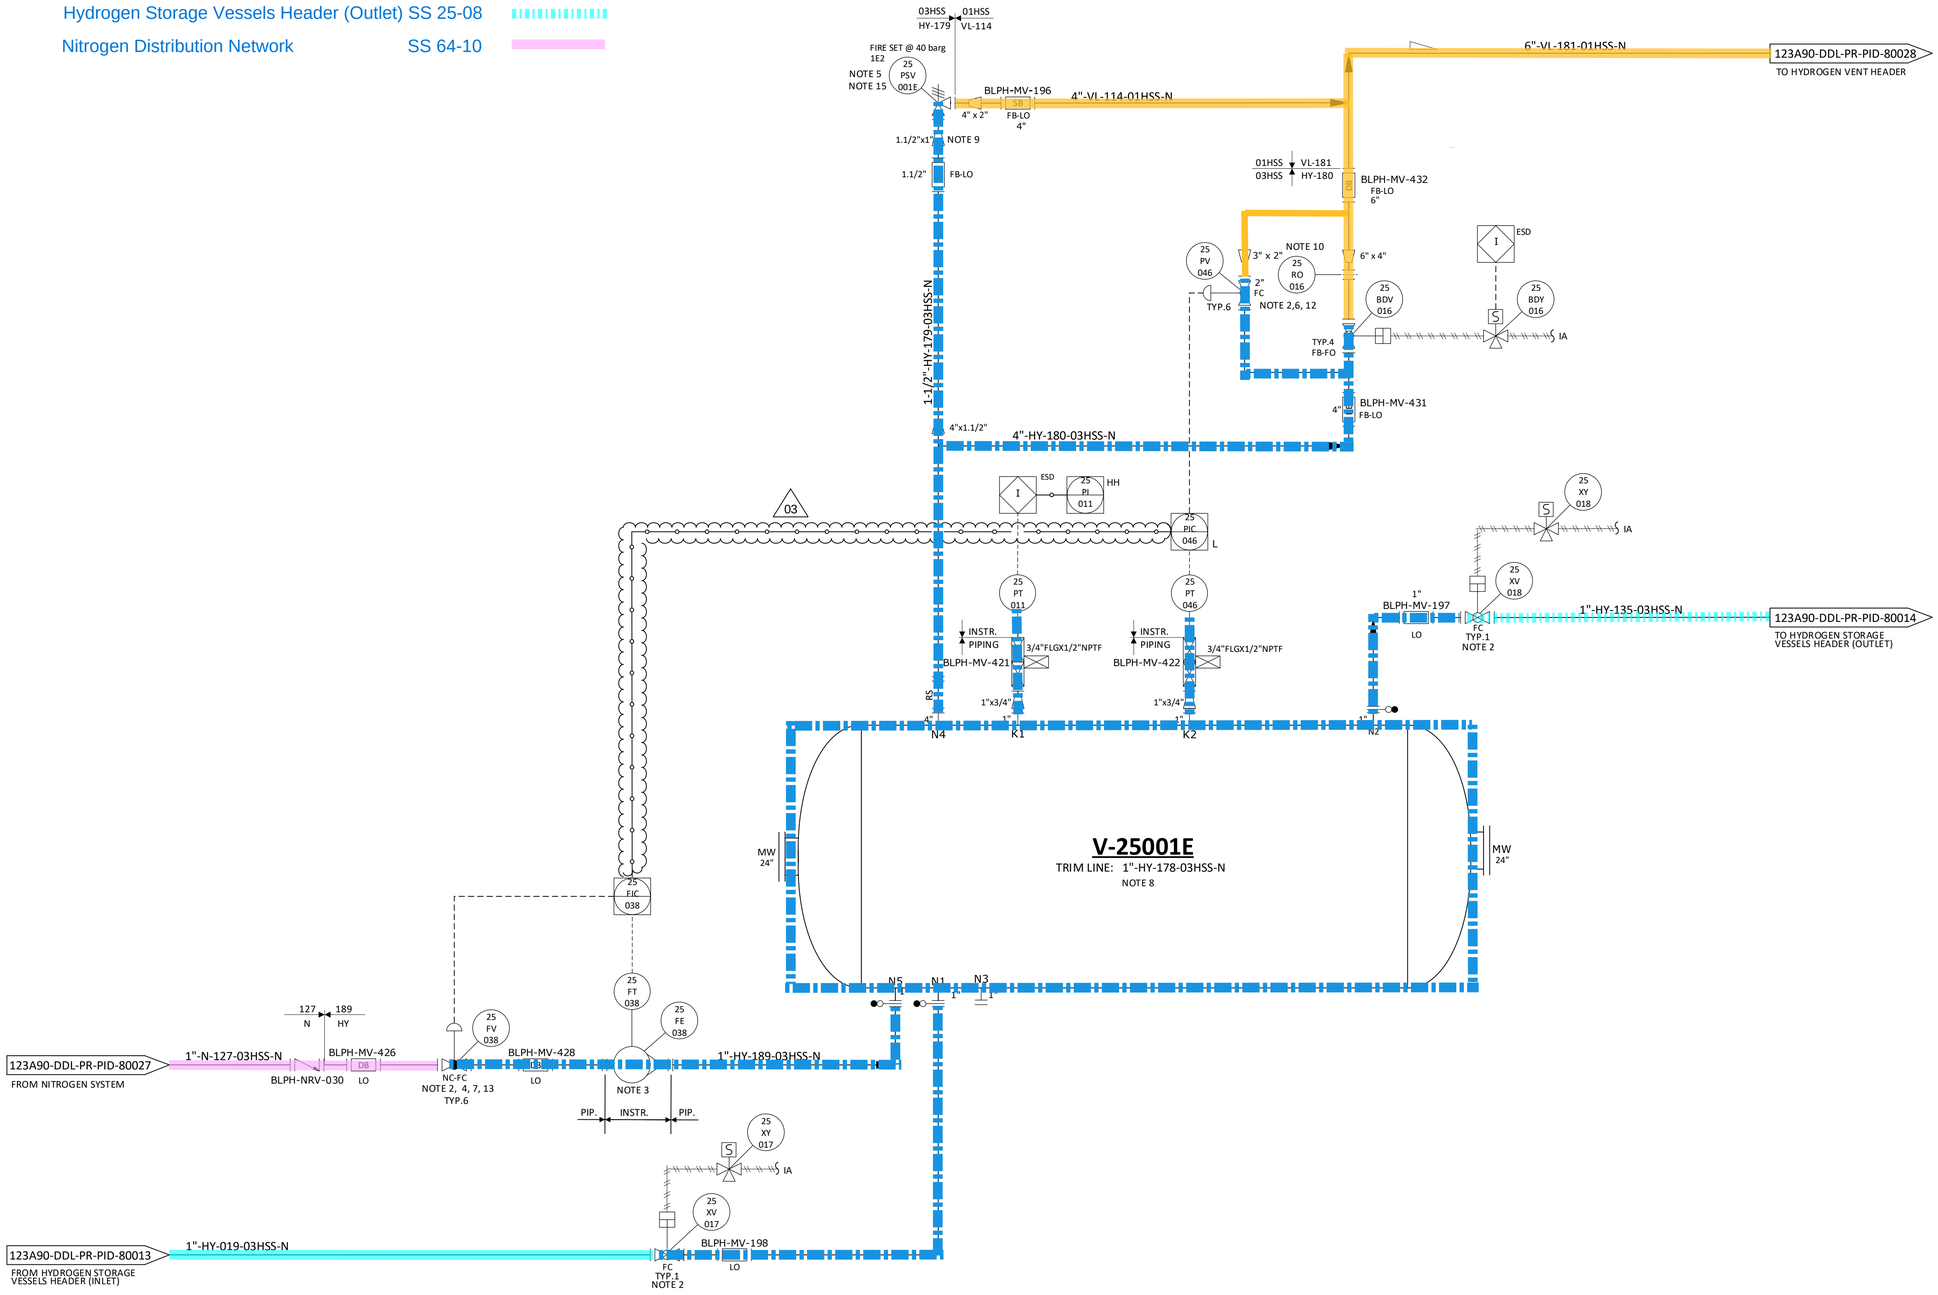

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-038) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-046 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-046 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-038 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-046 HAS FAILED TO CLOSE.
15. 25-PSV-001E SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL E

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO. 123A90-DDL-PR-PID-80019	SHEET 001	REV. 03

File Name : FILE_NAME

DRAWING NO. DRAWING_NO.

REV. REV


Hydrogen Storage Vessel F (V-25001F) SS 25-06

Hydrogen Vent Header & Drum System SS 43-00

Hydrogen Storage Vessels Header (inlet) SS 25-07

Hydrogen Storage Vessels Header (Outlet) SS 25-08

Nitrogen Distribution Network SS 64-10

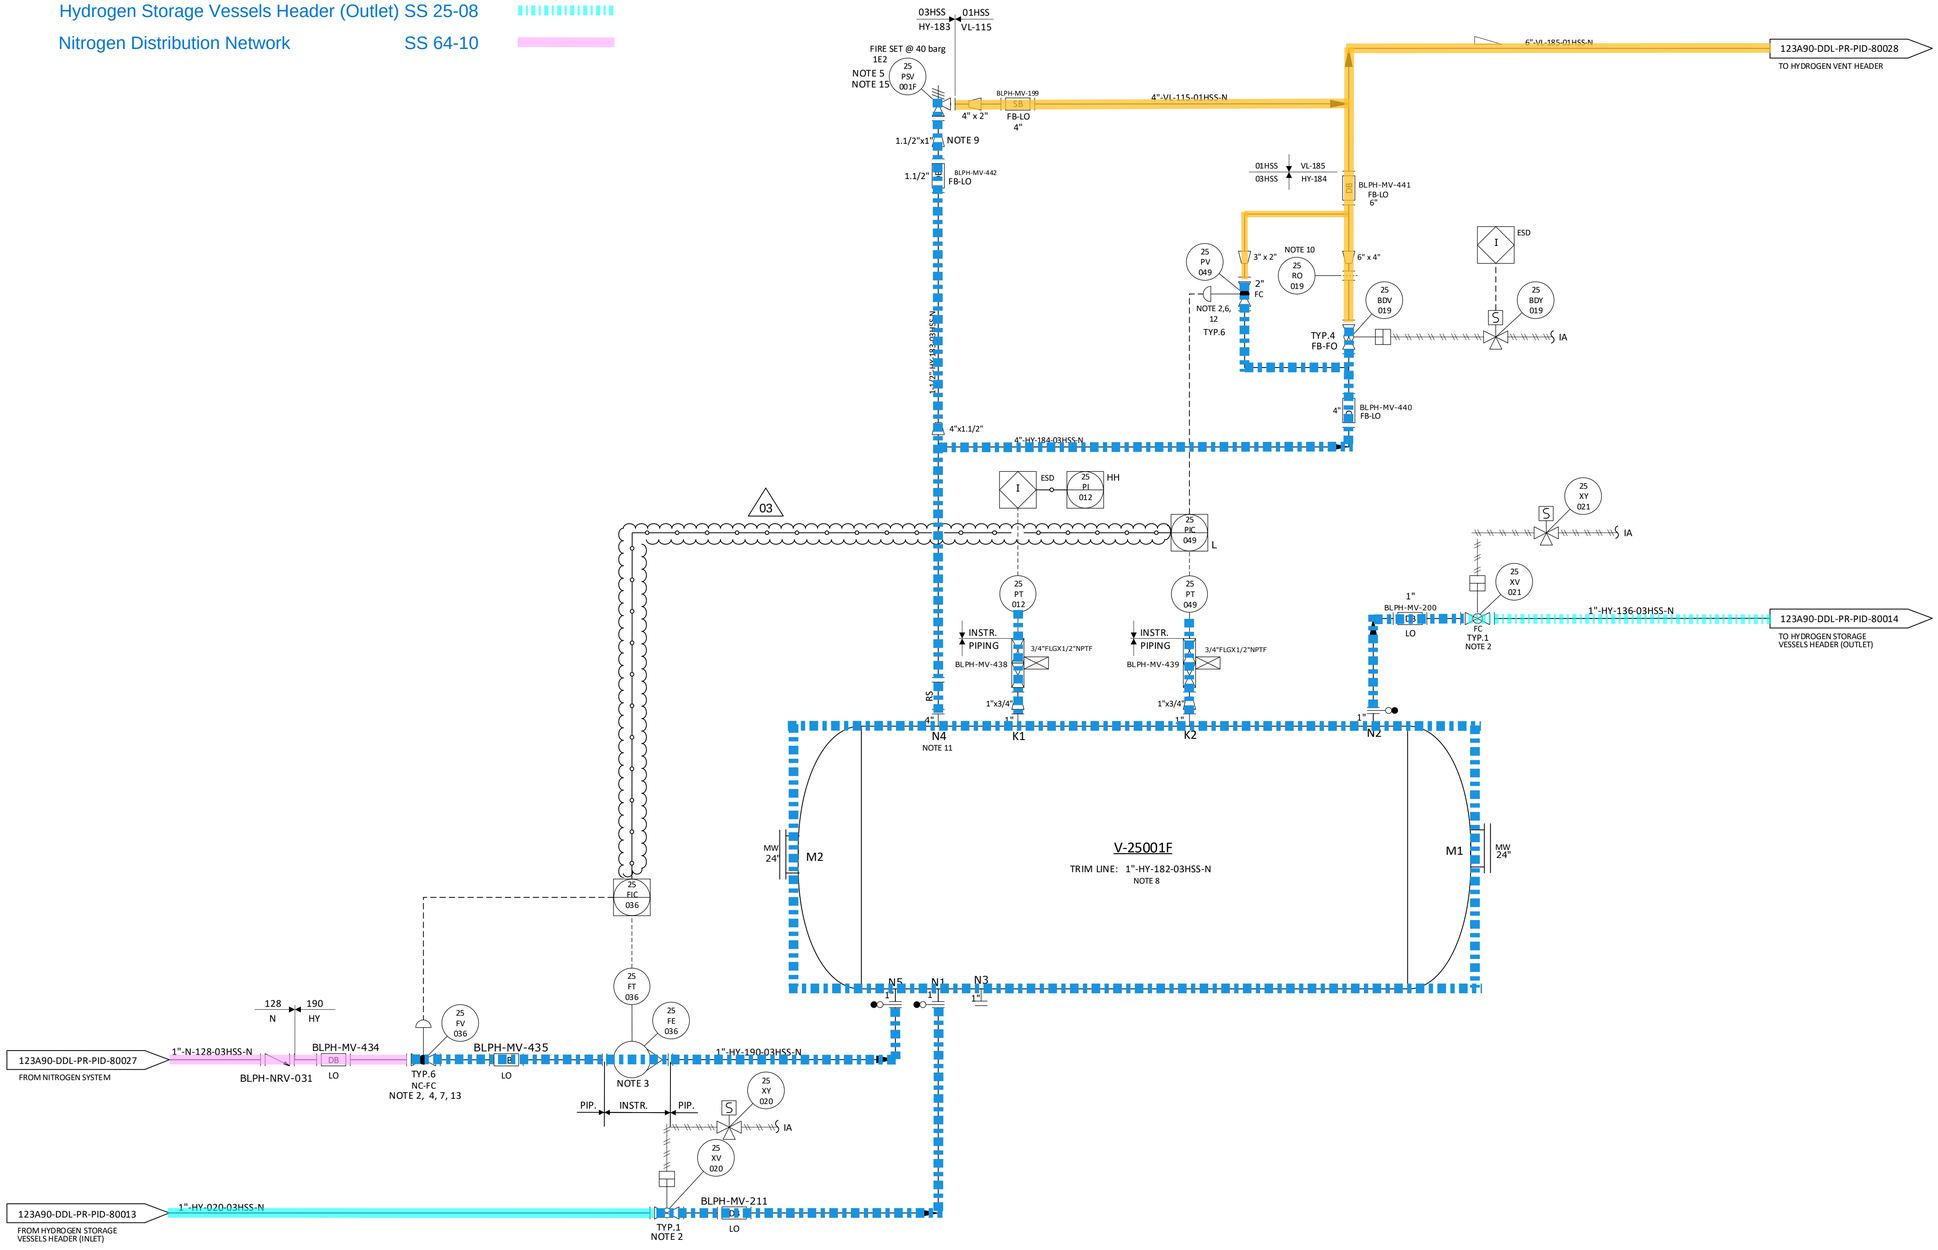

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-036) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-049 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-049 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25FV036 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-049 HAS FAILED TO CLOSE.
15. 25-PSV-001F SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR HAZOP (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :

BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL F

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80020		SHEET 001	REV. 03

File Name : FILE_NAME

Section 4 MECHANICAL COMPLETION STATUS INDEX - BUILDING DISCIPLINE

NOT APPLICABLE

Section 5 MECHANICAL COMPLETION STATUS INDEX - ELECTRICAL DISCIPLINE

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

STATUS INDEX DETAIL

Filtered on subsystem: 25-07 & process: MC & discipline : Y

ATEX	25-07 Hydrogen Storage Vessels Header (Inlet)						
ITEM		TASK					
Code	Description	Location	Code	Form	Progress	Date	Certificate
25-PCV-001	Air Set Filter - Hyrogen to Vessels Inlet Header Shut-Down	ONSHORE	C10001754	CJX01	100	2025-01-31	RFC 1
25-PCV-004	Air Set Filter - Vessel V-25001A Hydrogen Inlet	ONSHORE	C10001755	CJX01	100	2025-01-30	RFC 1
25-PCV-008	Air Set Filter - Vessel V-25001B Hydrogen Inlet	ONSHORE	C10001757	CJX01	100	2025-01-30	RFC 1
25-PCV-011	Air Set Filter - Vessel V-25001C Hydrogen Inlet	ONSHORE	C10001759	CJX01	100	2025-01-30	RFC 1
25-PCV-014	Air Set Filter - Vessel V-25001D Hydrogen Inlet	ONSHORE	C10001761	CJX01	100	2025-01-30	RFC 1
25-PCV-017	Air Set Filter - Vessel V-25001E Hydrogen Inlet	ONSHORE	C10001763	CJX01	100	2025-01-30	RFC 1
25-PCV-020	Air Set Filter - Vessel V-25001F Hydrogen Inlet	ONSHORE	C10001765	CJX01	100	2025-01-30	RFC 1
25-PCV-024	Air Set Filter - Nitrogen to Distribution Header Shut-Down	ONSHORE	C10002040	CJX01	100	2025-01-31	RFC 1
25-PG -004	Air Set Pressure Gauge Filter - Vessel V-25001A Hydrogen Inlet	ONSHORE	C10004819	CJX01	100	2025-04-24	RFC 1
25-PG -008	Air Set Pressure Gauge Filter - Vessel V-25001B Hydrogen Inlet	ONSHORE	C10004821	CJX01	100	2025-04-24	RFC 1
25-PG -011	Air Set Pressure Gauge Filter - Vessel V-25001C Hydrogen Inlet	ONSHORE	C10004823	CJX01	100	2025-04-24	RFC 1
25-PG -014	Air Set Pressure Gauge Filter - Vessel V-25001D Hydrogen Inlet	ONSHORE	C10004825	CJX01	100	2025-04-24	RFC 1
25-PG -017	Air Set Pressure Gauge Filter - Vessel V-25001E Hydrogen Inlet	ONSHORE	C10004827	CJX01	100	2025-04-24	RFC 1
25-PG -020	Air Set Pressure Gauge Filter - Vessel V-25001F Hydrogen Inlet	ONSHORE	C10004829	CJX01	100	2025-04-24	RFC 1
25-PG -024	Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Vent System	ONSHORE	C10004831	CJX01	100	2025-04-24	RFC 1
25-PG-001	Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Shut-Down	ONSHORE	C10004846	CJX01	100	2025-04-24	RFC 1
25-PSV-001	Safety Valve - Hyrogen to Vessels Inlet Header Shut-Down	ONSHORE	C10004849	CJX01	100	2025-02-03	RFC 1
25-PSV-004	Safety Valve - Vessel V-25001A Hydrogen Inlet	ONSHORE	C10004833	CJX01	100	2025-02-03	RFC 1
25-PSV-008	Safety Valve - Vessel V-25001B Hydrogen Inlet	ONSHORE	C10004835	CJX01	100	2025-02-03	RFC 1
25-PSV-011	Safety Valve - Vessel V-25001C Hydrogen Inlet	ONSHORE	C10004837	CJX01	100	2025-02-03	RFC 1
25-PSV-014	Safety Valve - Vessel V-25001D Hydrogen Inlet	ONSHORE	C10004839	CJX01	100	2025-02-03	RFC 1
25-PSV-017	Safety Valve - Vessel V-25001E Hydrogen Inlet	ONSHORE	C10004841	CJX01	100	2025-02-03	RFC 1
25-PSV-020	Safety Valve - Vessel V-25001F Hydrogen Inlet	ONSHORE	C10004843	CJX01	100	2025-02-03	RFC 1
25-PSV-024	Safety Valve - Hyrogen to Vessels Inlet Header Vent System	ONSHORE	C10004845	CJX01	100	2025-02-03	RFC 1
25-PT-001	Pressure Transmitter - Hyrogen to Vessels Inlet Header	ONSHORE	C10001482	CJX01	100	2025-02-08	RFC 1
25-PT-002	Pressure Transmitter - Hyrogen to Vessels Inlet Header Shut-Down	ONSHORE	C10001483	CJX01	100	2025-02-08	RFC 1
25-SDV-001	On/Off Valve - Hyrogen to Vessels Inlet Header Shut-Down	ONSHORE	C10001588	CJX01	100	2025-01-31	RFC 1
25-SDY-001	Solenoid Valve - Hyrogen to Vessels Inlet Header Shut-Down	ONSHORE	C10001712	CJX01	100	2025-02-05	RFC 1
25-XV-004	On-Off Actuated Ball Valve - Vessel V-25001A Hydrogen Inlet	ONSHORE	C10001590	CJX01	100	2025-01-30	RFC 1

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

STATUS INDEX DETAIL

Filtered on subsystem: 25-07 & process: MC & discipline : Y

ATEX	25-07 Hydrogen Storage Vessels Header (Inlet)						
ITEM		TASK					
Code	Description	Location	Code	Form	Progress	Date	Certificate
25-XV-008	On-Off Actuated Ball Valve - Vessel V-25001B Hydrogen Inlet	ONSHORE	C10001592	CJX01	100	2025-01-30	RFC 1
25-XV-011	On/Off Valve - Vessel V-25001C Hydrogen Inlet	ONSHORE	C10001594	CJX01	100	2025-01-30	RFC 1
25-XV-014	On/Off Valve - Vessel V-25001D Hydrogen Inlet	ONSHORE	C10001596	CJX01	100	2025-01-30	RFC 1
25-XV-017	On/Off Valve - Vessel V-25001E Hydrogen Inlet	ONSHORE	C10001598	CJX01	100	2025-01-30	RFC 1
25-XV-020	On/Off Valve - Vessel V-25001F Hydrogen Inlet	ONSHORE	C10001600	CJX01	100	2025-01-30	RFC 1
25-XV-024	On/Off Valve - Hyrogen to Vessels Inlet Header Vent System	ONSHORE	C10001602	CJX01	100	2025-01-31	RFC 1
25-XY-004	Solenoid Valve - Vessel V-25001A Hydrogen Inlet	ONSHORE	C10001714	CJX01	100	2025-01-29	RFC 1
25-XY-008	Solenoid Valve - Vessel V-25001B Hydrogen Inlet	ONSHORE	C10001716	CJX01	100	2025-01-29	RFC 1
25-XY-011	Solenoid Valve - Vessel V-25001C Hydrogen Inlet	ONSHORE	C10001718	CJX01	100	2025-02-05	RFC 1
25-XY-014	Solenoid Valve - Vessel V-25001D Hydrogen Inlet	ONSHORE	C10001720	CJX01	100	2025-01-29	RFC 1
25-XY-017	Solenoid Valve - Vessel V-25001E Hydrogen Inlet	ONSHORE	C10001722	CJX01	100	2025-01-29	RFC 1
25-XY-020	Solenoid Valve - Vessel V-25001F Hydrogen Inlet	ONSHORE	C10001724	CJX01	100	2025-01-29	RFC 1
25-XY-024	Solenoid Valve - Hyrogen to Vessels Inlet Header Vent System	ONSHORE	C10002038	CJX01	100	2025-01-31	RFC 1
25-ZSHL-001	Limit Switch Box - Hyrogen to Vessels Inlet Header Shut-Down	ONSHORE	C10001726	CJX01	100	2025-01-30	RFC 1
25-ZSHL-004	Limit Switch Box - Vessel V-25001A Hydrogen Inlet	ONSHORE	C10001727	CJX01	100	2025-01-29	RFC 1
25-ZSHL-008	Limit Switch Box - Vessel V-25001B Hydrogen Inlet	ONSHORE	C10001729	CJX01	100	2025-01-29	RFC 1
25-ZSHL-011	Limit Switch Box - Vessel V-25001C Hydrogen Inlet	ONSHORE	C10001731	CJX01	100	2025-01-29	RFC 1
25-ZSHL-014	Limit Switch Box - Vessel V-25001D Hydrogen Inlet	ONSHORE	C10001733	CJX01	100	2025-01-29	RFC 1
25-ZSHL-017	Limit Switch Box - Vessel V-25001E Hydrogen Inlet	ONSHORE	C10001735	CJX01	100	2025-02-05	RFC 1
25-ZSHL-020	Limit Switch Box - Vessel V-25001F Hydrogen Inlet	ONSHORE	C10001737	CJX01	100	2025-01-29	RFC 1
25-ZSHL-024	Limit Switch Box - Hyrogen to Vessels Inlet Header Vent System	ONSHORE	C10002039	CJX01	100	2025-01-30	RFC 1

ITEM	Tag	25-PT-001	: Pressure Transmitter - Hyrogen to Vessels Inlet Header	Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001482	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		SE240634			
Manufacturer	Terranova Srl			**Model**		SST76			
Cert No.	TI17ATEX304X - TI17ATEX304X /1			**Equipment Ambient Temp.**		-40°C to +60°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	PL	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	PL	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PT-001	: Pressure Transmitter - Hyrogen to Vessels Inlet Header			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001482		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	OK	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	OK	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-PT-001	: Pressure Transmitter - Hyrogen to Vessels Inlet Header		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001482	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-02-08	2025-02-08	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-02-08T08:10:14.202Z	PROVERLIS Digitaly signed by Alessio Polo 2025-02-08T10:30:44.455Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

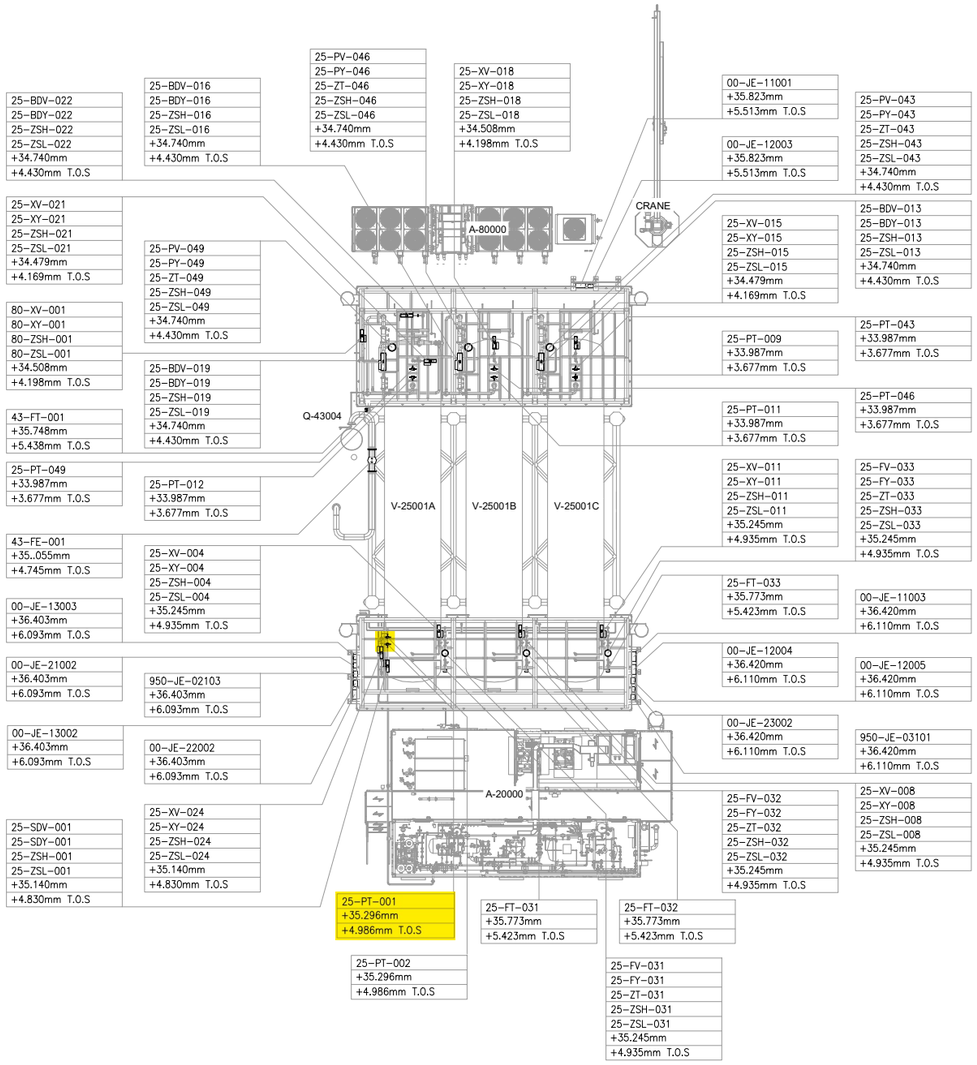

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :


BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING_NO.

REV.

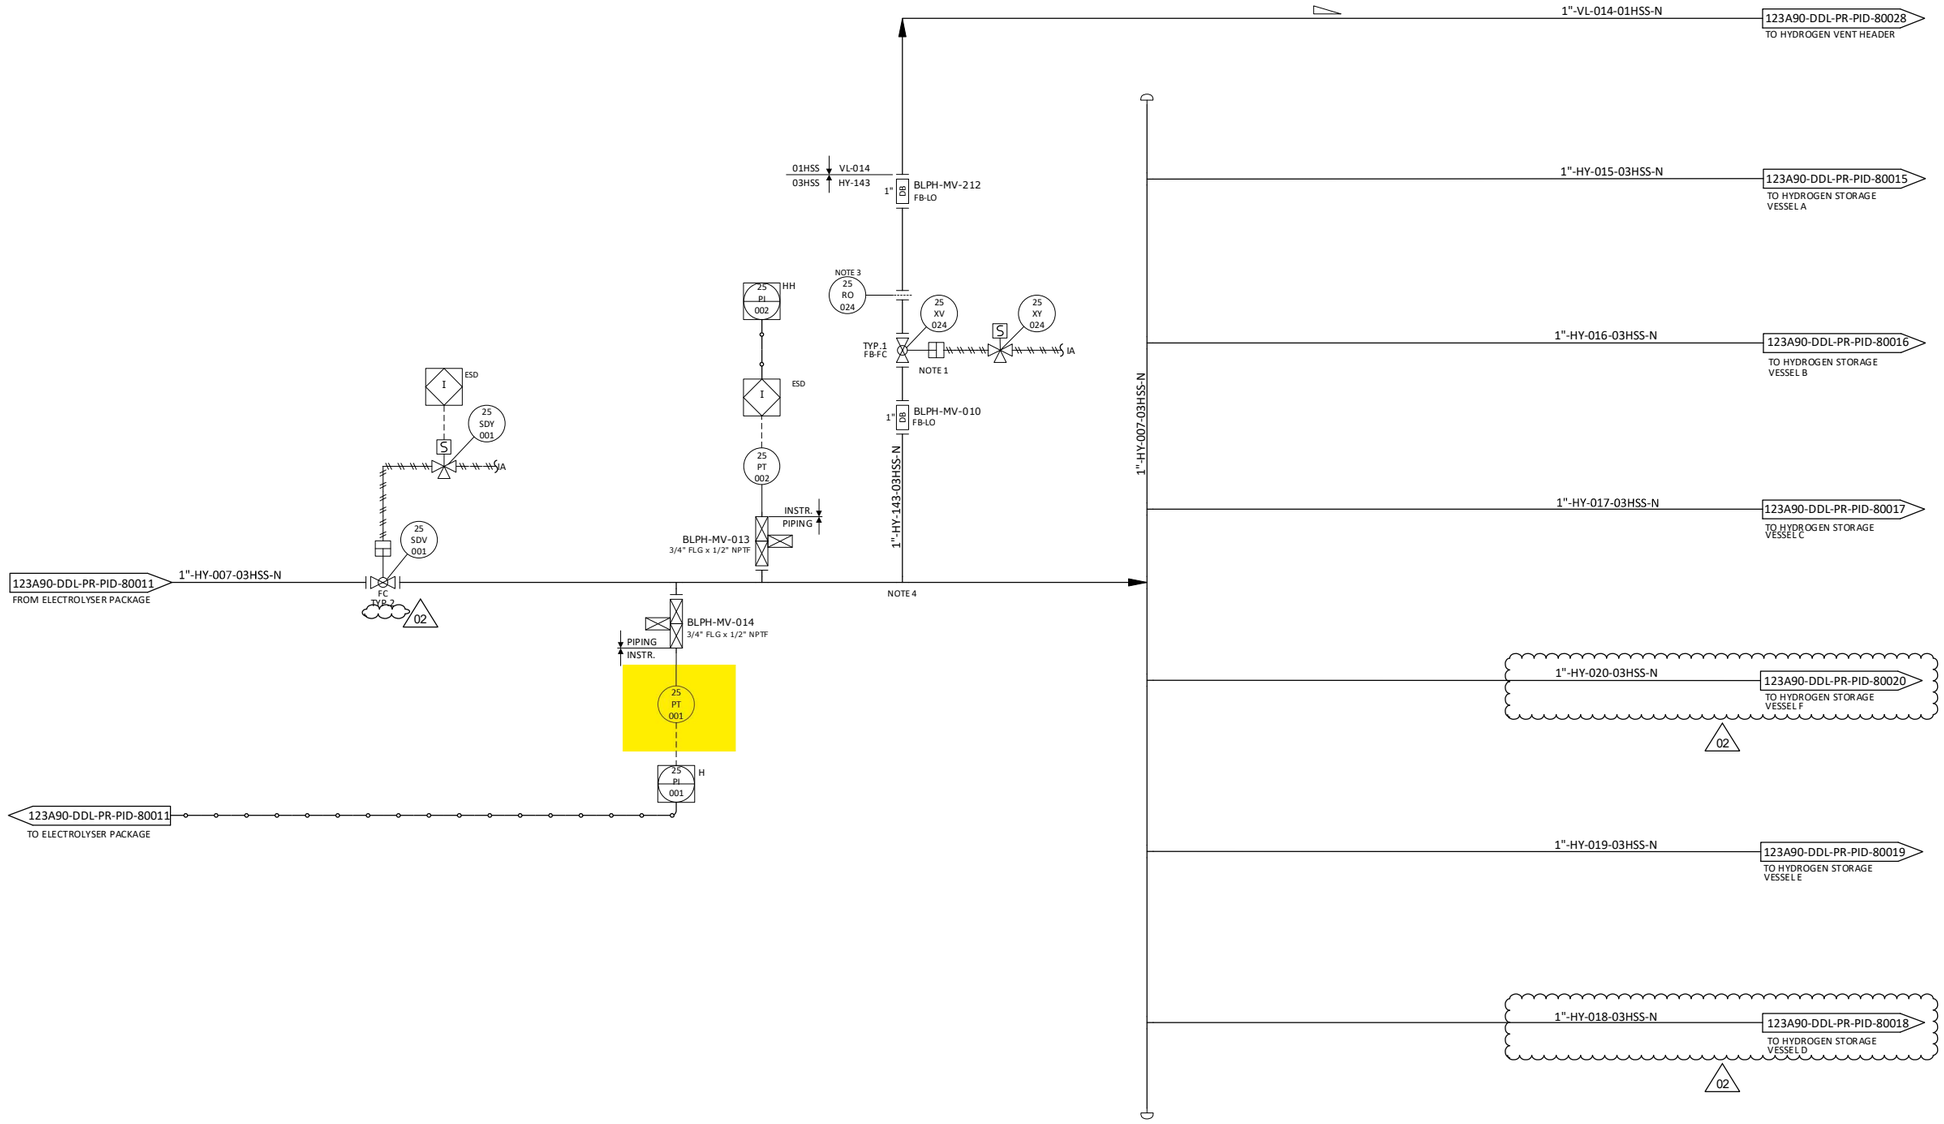

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :

BLPH PIPING AND INSTRUMENTATION DIAGRAM HYDROGEN STORAGE VESSELS HEADER (INLET)

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80013	SHEET 001	REV. 02


File Name : FILE_NAME

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-11003	No.	MARSHALLING CABINET B400-PCS-002

<01>

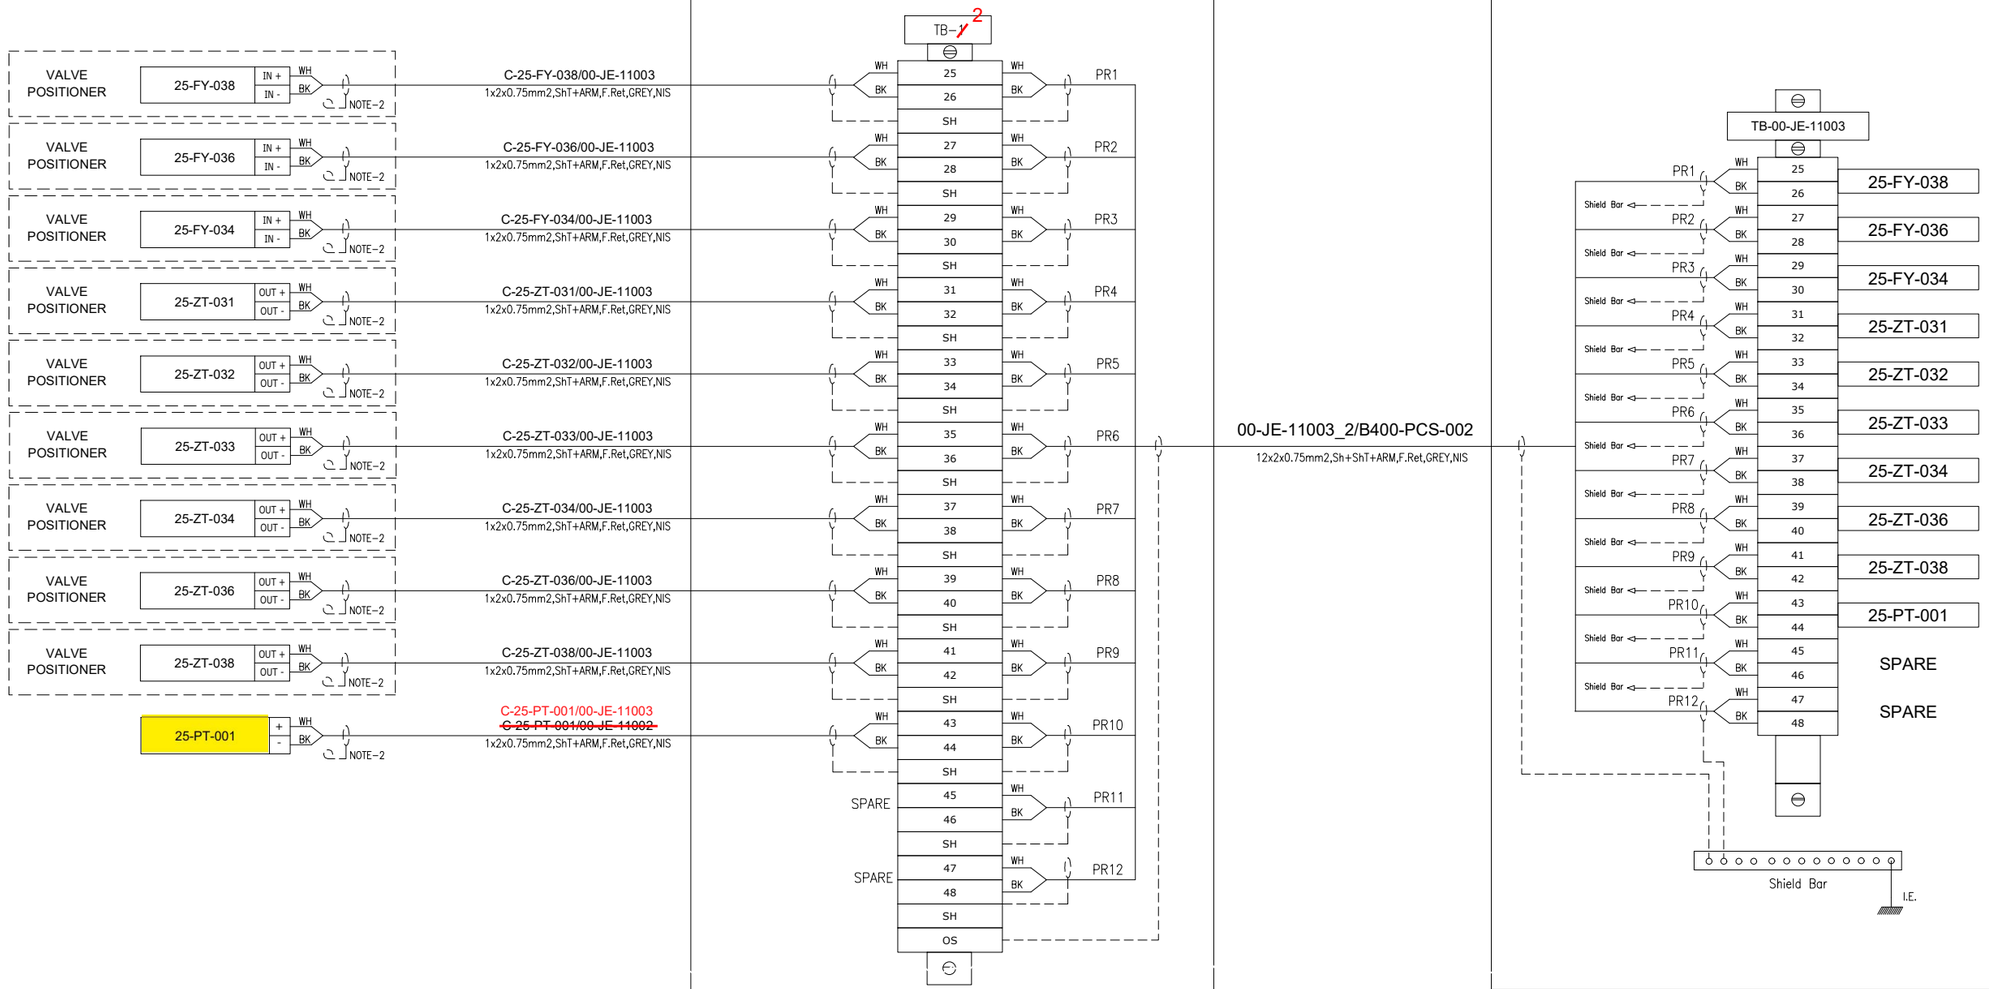

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_I	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00–JE–11003–SH.2 OF 2

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123–A90–DDL–IN–40015	SHEET 008	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

E33

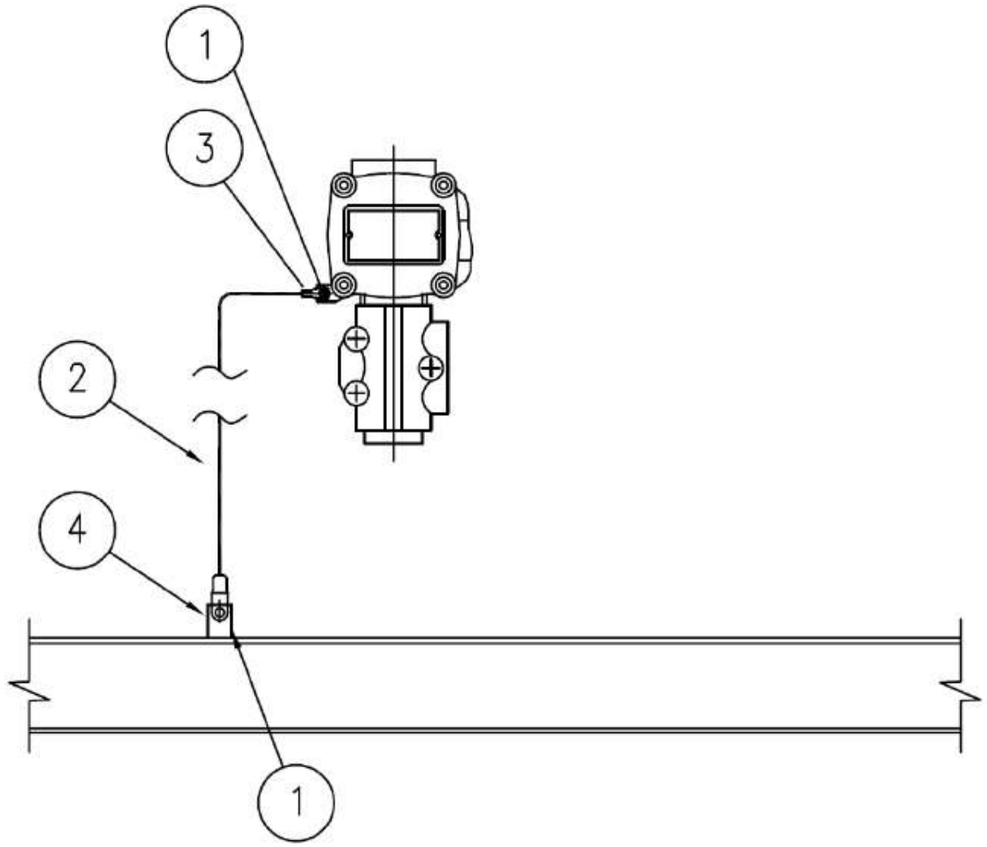

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 6 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR PRESSURE TRANSMITTERS

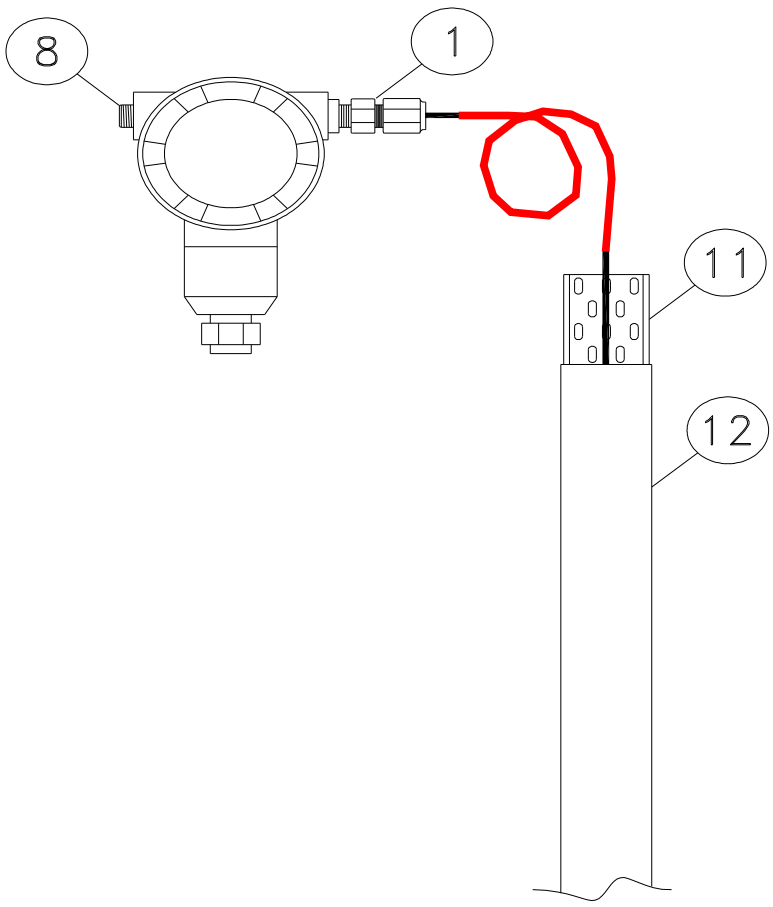

INSTRUMENT TAG	
1	25-PT-001
2	25-PT-035
3	25-PT-037
4	25-PT-040
5	25-PT-043
6	25-PT-046
7	25-PT-049
8	25-PT-055A
9	25-PT-055B
10	43-PT-001
11	50-PT-014
12	63-PT-003
13	64-PT-031A
14	64-PT-031B
15	
16	
17	
18	
19	
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**

REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi


ROSETTI MARINO SpA

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
1		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20S	1

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Process Hook-Ups	Sh. 6 of 8 Date: 06/12/2024 Rev. 02

PRESSURE TRANSMITTERS - Installation for Gas Service

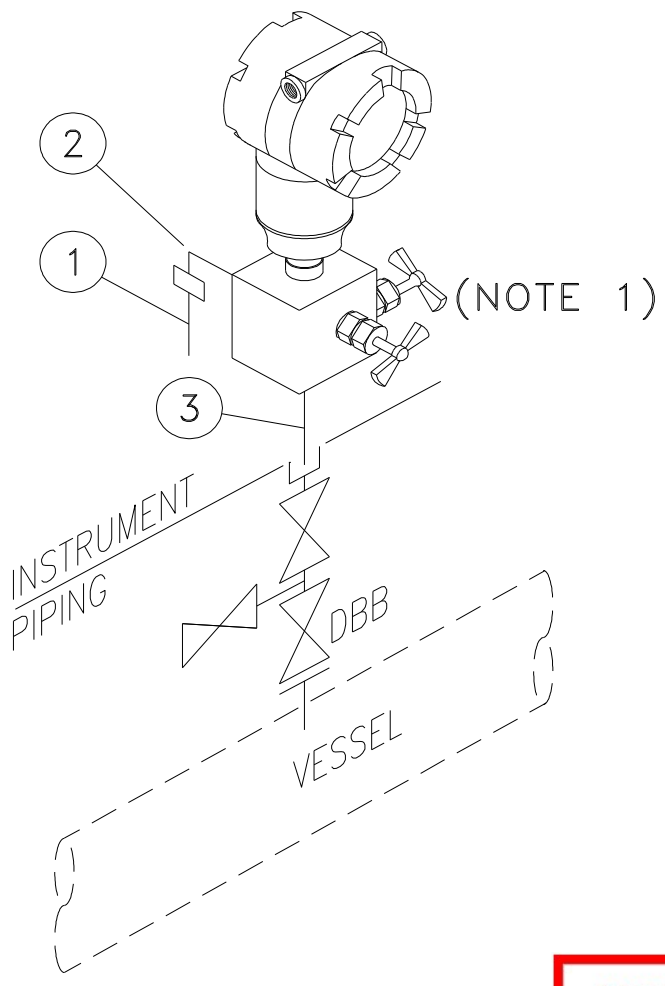

INSTRUMENT TAG	
1	25-PT-004
2	25-PT-006
3	25-PT-008
4	25-PT-009
5	25-PT-011
6	25-PT-012
7	25-PT-035
8	25-PT-037
9	25-PT-040
10	25-PT-043
11	25-PT-046
12	25-PT-049
13	25-PT-001
14	25-PT-002
15	25-PT-055A
16	25-PT-055B
17	43-PT-001
18	50-PT-014
19	63-PT-003
20	63-PT-004
21	~~64-PT-031A~~
22	64-PT-031B
23	64-PT-002
24	80-PT-002
25	
26	
27	
28	
29	
30	

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40077**

REV.:	DATE:	SIGNATURE:
2_B	17/01/25	G.Randi


ROSETTI MARINO SpA

NOTES:
(1) MANIFOLD IS SUPPLIED WITH INSTRUMENT.
(2) VENDOR SHALL GUARANTEE THE MATERIAL COUPLING BETWEEN TUBING AND FITTINGS.

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
3		SS316 NIPPLE	1/2" NPT L=100mm	N. 1
2		ELBOW SS316	1/4" NPT-M x 1/2" O.D	N. 1
1		SS 316L TUBING (NOTE 2)	1/2" x 0,049"Thk	m 0.5

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

SST76 PRESSURE TRANSMITTERS

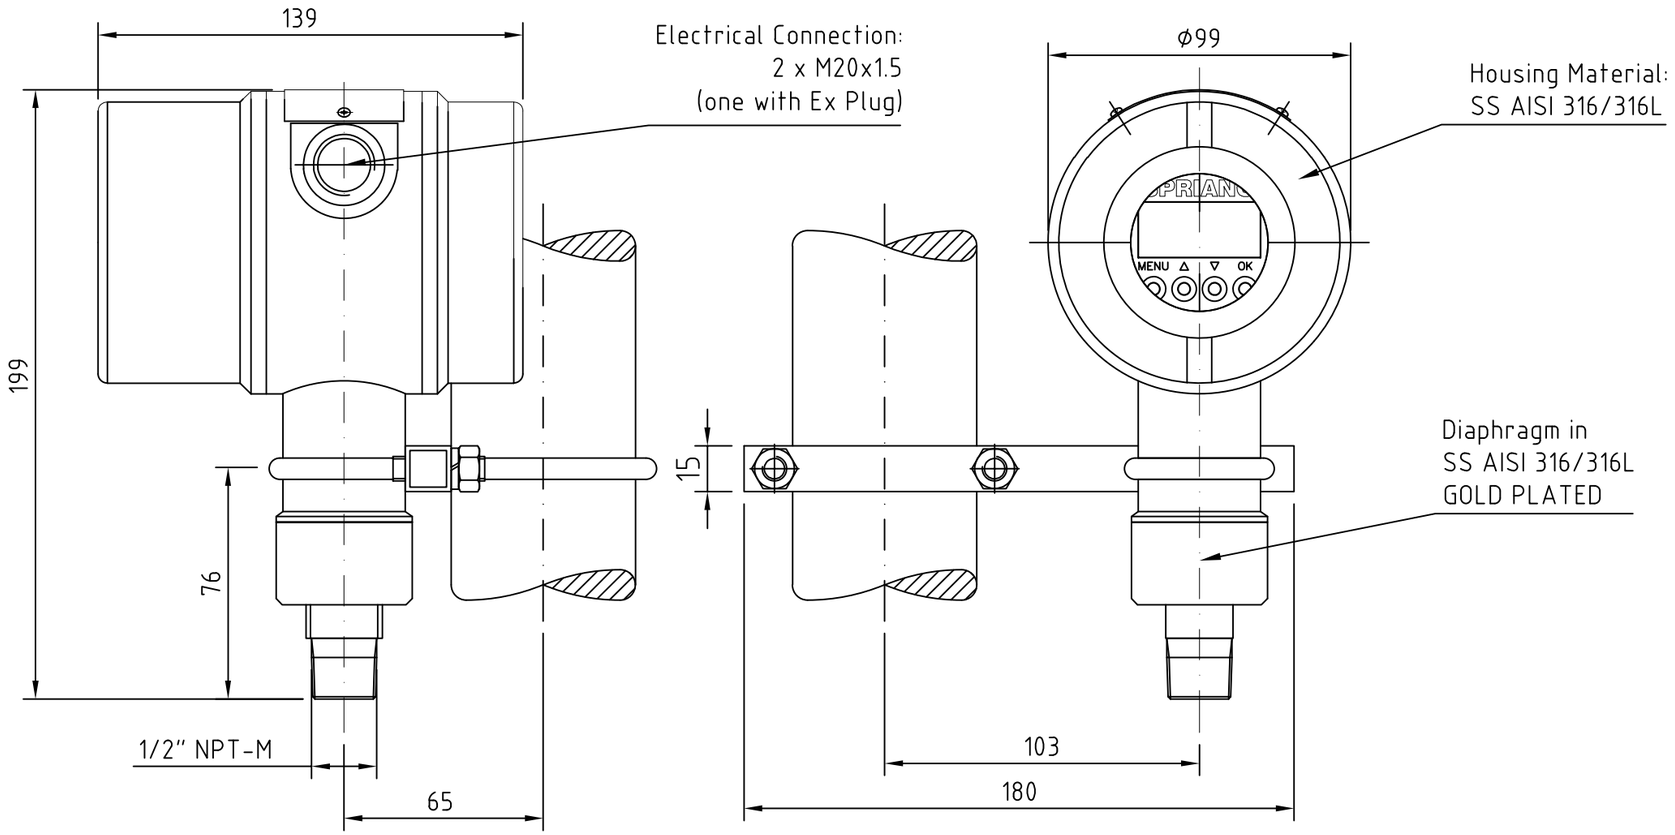


TAG LIST

#	TAG	RANGE	CALIBRATION
1	25-PT-001	0 ÷ 100 barg	0 ÷ 40 barg
2	25-PT-002	0 ÷ 100 barg	0 ÷ 40 barg
3	25-PT-004	0 ÷ 100 barg	0 ÷ 40 barg
4	25-PT-035	0 ÷ 100 barg	0 ÷ 40 barg
5	25-PT-006	0 ÷ 100 barg	0 ÷ 40 barg
6	25-PT-037	0 ÷ 100 barg	0 ÷ 40 barg
7	25-PT-008	0 ÷ 100 barg	0 ÷ 40 barg
8	25-PT-040	0 ÷ 100 barg	0 ÷ 40 barg
9	25-PT-009	0 ÷ 100 barg	0 ÷ 40 barg
10	25-PT-043	0 ÷ 100 barg	0 ÷ 40 barg
11	25-PT-011	0 ÷ 100 barg	0 ÷ 40 barg
12	25-PT-046	0 ÷ 100 barg	0 ÷ 40 barg
13	25-PT-012	0 ÷ 100 barg	0 ÷ 40 barg
14	25-PT-049	0 ÷ 100 barg	0 ÷ 40 barg

TOTAL QUANTITY: 14

MAN2-R6 TWO WAYS AND TWO VALVES MANIFOLD

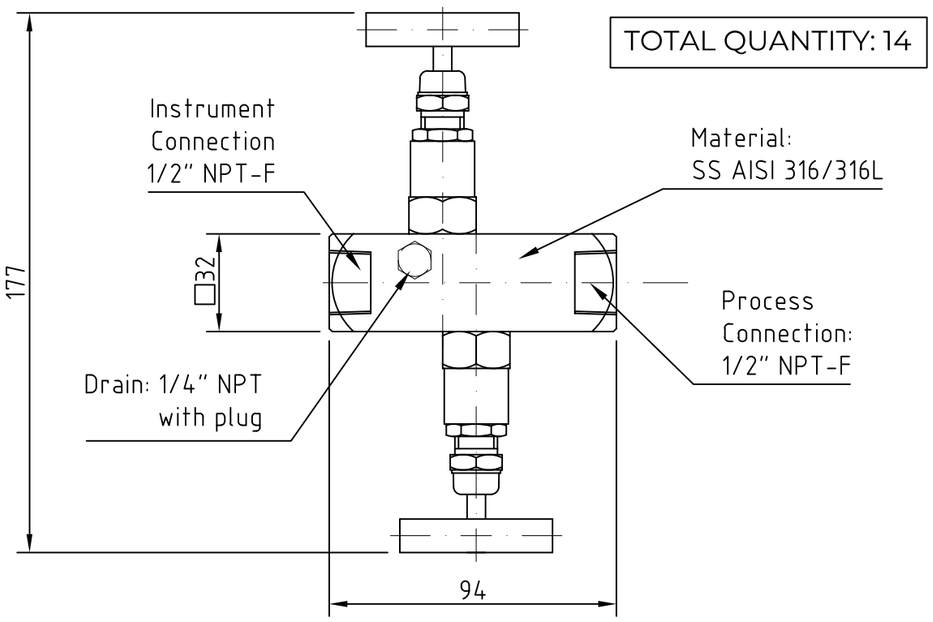

NOTES

SST76 PRESSURE TRANSMITTERS
SST76-H-7-L-2-9-2-1-4 + MAN2-R6

H - OUTPUT: 4-20 mA + HART
7 - PROCESS CONNECTION: 1/2" NPT M;
L - NOMINAL RANGE: 0 ÷ 100 barg
2 - CALIBRATION: 0 ÷ 40 barg
9 - DIAPHRAGM MATERIAL: SS AISI 316/316L GOLD PLATED
2 - OPTIONS: HOUSING MATERIAL STAINLESS STEEL WITH ELECTRICAL CONNECTIONS 2 x 1/2" NPT-F
1 - OPTIONS: MOUNTING BRACKET FOR 2" PIPE MOUNTING
4 - EXPLOSION PROTECTION 2014/34/EU: ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1G Ex ia IIC T6/T5/T4 Ga

to be coupled with:
1. MAN2-R6 TWO VALVES AND TWO WAYS MANIFOLD, MATERIAL SS AISI 316/316L, CONNECTION TO INSTRUMENT 1/2" NPT-F, PROCESS CONNECTION 1/2" NPT-F.

NOTES:
1. OVERALL ACCURACY OF PT (COMPREHENSIVE OF HYSTERESIS, NON-LINEARITY, REPEATABILITY) IS WITHIN +/- 0,07% FS;
2. ALL ITEMS ARE EQUIPPED WITH SS NAMEPLATE;
3. FILLING OF ELEMENT IS FORESEEN WITH DOW CORNING SILICONIC OIL;
4. ELECTRICAL CONNECTION ARE: 2 X 1/2" NPT-F (ONE PLUGGED);
5. INTEGRAL LCD /CONFIGURABLE ENGINEERING UNITS;
6. INGRESS PROTECTION EN 60529: IP66;
7. HOUSING MATERIAL STAINLESS STEEL;
8. ALL INSTRUMENT ARE SIL2/SIL3 CERTIFIED;
9. HART 6.

CERTIFICATES

1. ATEX Ex-d CERTIFICATE (2014/34/EU)
2. IP66 GRADE (EN/IEC 60529)
3. MATERIAL 3.1 (EN 10204) & HYDROTEST CERTIFICATES
4. CALIBRATION CERTIFICATES (IEC 60770)

REV	DATE	STATUS	PURPOSE OF ISSUE	PRE'D.	CHC'D.	APP'D.	AUTH'D.
03	18/JULY/24	FOURTH ISSUE	FOR CONSTRUCTION	M.Toni	G.Amodi	G.Nobile	S.Valletta
02	02/JULY/24	THIRD ISSUE	FOR CONSTRUCTION	M.Toni	G.Amodi	G.Nobile	S.Valletta
01	13/JUN/24	SECOND ISSUE	FOR CONSTRUCTION	M.Toni	G.Amodi	G.Nobile	S.Valletta
00	24/MAY/24	FIRST ISSUE	FOR APPROVAL	M.Toni	G.Amodi	G.Nobile	S.Valletta

CROSSWIND ROSETTI MARINO

P.O. No.: 24/01611/PO | Mod_CAR_Rev17-01 | SCALE - 1:2

TERRANOVA
TERRANOVA SRL

DRAWING TITLE: DIMENSIONAL DRAWINGS

JOB: 4718_OS | SHEET No. 4 OF 10 | REV. 03

GENERAL	1	Tag Number		25-PT-001	
	2	Service		H2 FROM ELECTR. (A-20000) TO H2 STORAGE VESSELS	
	3	P&ID Number	Location	123A90-DDL-PR-PID-80013	1"-HY-007-03HSS-N
	4	Function		PRESSURE MEASUREMENT	
	5	Mounting		DIRECT ON-LINE	
	6	Area Classification		ATEX Zone2 - IIC (IIB+H2) T1	
	7	Ambient Temperature		Min: -8.4 °C, Norm: 10.5 °C, Max: +25.0 °C.	
PROCESS CONDITIONS	8	Fluid		HYDROGEN	
	9	Pressure Des.	Oper. [barg]	40	4(Min.) / 30(Max)
	10	Temperature Des.	Oper. [°C]	-10 / 80	5(Min.) / 65(Max.)
	11	Oper. Spec. Gravity	Oper. Viscosity	-	-
	12	Flow Rate	Allowable Temp.	-	-
	13				
TRANSMITTER	14	Instrument Range Min.	Max.	0	100
	15	Calibration Range Min.	Max. [barg]	0	40
	16	Elevation	Suppresion	-	-
	17	Element Type		Diaphragm	
	18	Element Material		AISI 316/316L + Gold Plate (17)	
	19	Body Material	Body Rating	AISI 316/316L	200 bar
	20	Process Flanges Material		Integral 2 Way Manifold (22)	
	21	Wetted O-Rings Material		-	
	22	Fill Fluid		-	
	23	Bolts	Housing	Manifold/Instrument assembly	AISI 316/316L
	24	Paint		-	
	25	ATEX Certification	Ingress Protection	Atex Ex II 2G Ex db IIC T5	IP66
	26	Process Connection	Electrical Connection	1/2" NPT(F)	N. 2 M20x1.5mm
	27	Repeatability	Accuracy	-	0.07 % of Nominal Range
	28	SIL Certification	PED Certification	-	Required
DIAPHRAGM SEAL	29	Process Connection & Rating		-	
	30	Diaphragm Material	Housing Material	-	-
	31	Fill Fluid	Capillary Material	-	-
	32	Capillary Type	Capillary Length	-	-
	33	Flushing Connection		-	
	34				
OPTIONS	35	Integral Meter	Scale	Integral LCD Display	-
	36	Hydrostatic Testing	Cleaning	Required	-
	37	Mounting Brackets	Manifold Model No	Required	MAN2-R6
	38	Lightning Protection	Barrier Manuf./Model		-
COMMUNICATION AND SOFTWARE	39	Communication Type	Signal Type	HART 6	4-20mA Loop Powered 24 Vdc
	40	D D Revision	CFF Revision	-	-
	41	Device Tag	Hart Tag	-	-
	42	Internal Diagnostics	Capacitance	-	-
	43	Segment	Device Address	-	-
	44	Device Class	Simulate	-	-
	45	Nominal Current	Operating Voltage	-	-
	46				
PURCHASE	47	Manufacturer		TERRANOVA	
	48	Model		SST76-H-7-L-2-9-2-1-4 + MAN2-R6	
	49	Purchase Order Number		1724000979	

Notes:

No.	Date	By	Chkd	Appr	Description
02	06/12/2024	VBA	LCA	DLO	Accepted for Construcion (AFC)
01	29/08/2024	VBA	LCA	DLO	Accepted for Construcion (AFC)
00	16/01/2024	VBA	LCA	DLO	ISSUED FOR REVIEW (IFR)

INSTRUMENT DATASHEET

Pressure Transmitter

CROSSWIND

ROSETTI MARINO

Sheet 8 of 35

Code: 605 | Dwg. No.: 123A90-DDL-IN-DS-40039 Rev 02

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-PSV-055B	Safety Valve	LOWER DECK	1724000740	AST SpA	COITECH	24-03803	SLK	ATEX ZONE 2	Declaration of Conformity By COITECH SLKL-08HA74-015	Coitech EU - Type Examination Certificate	CE Ex - II 2 GD Ex h X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PT-001	Hyrogen to vessels inlet header	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240634	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-002	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240635	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-004	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240636	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PT-006	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240638	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-PT-008	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240640	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-PT-009	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240642	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-PT-011	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240644	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_2
25-PT-012	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240646	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-035	Vessel V-25001A pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240637	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PT-037	Vessel V-25001B pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240639	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-PT-040	Vessel V-25001C pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240641	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-PT-043	Vessel V-25001D pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240643	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-PT-046	Vessel V-25001E pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240645	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_2
25-PT-049	Vessel V-25001F pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240647	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240648	SST76-H-7-K-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PT-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240649	SST76-H-7-K-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PV-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400589	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PV-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400590	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-PV-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400591	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-PV-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400592	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-PV-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400593	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-PV-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400594	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-PV-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400595	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PV-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400596	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PY-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400589	CV-8407	II 2G	ATEX - SN 2400589	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PY-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400590	CV-8407	II 2G	ATEX - SN 2400590	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-PY-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400591	CV-8407	II 2G	ATEX - SN 2400591	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-PY-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400592	CV-8407	II 2G	ATEX - SN 2400592	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-PY-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400593	CV-8407	II 2G	ATEX - SN 2400593	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-PY-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400594	CV-8407	II 2G	ATEX - SN 2400594	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-PY-055A	Hydrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400595	CV-8407	II 2G	ATEX - SN 2400595	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PY-055B	Hydrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400596	CV-8407	II 2G	ATEX - SN 2400596	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SDV-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SDV-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SDY-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SDY-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-SV-031	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-SV-032	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-033	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-SV-034	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-SV-035	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-SV-036	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-037	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2

Technická inšpekcia, a.s.

Trnavská cesta 56, 821 01 Bratislava
Slovenská republika

[1] SUPPLEMENTARY EU-TYPE EXAMINATION CERTIFICATE

[2] Equipment or Protective System Intended for use in potentially explosive atmospheres
Directive 2014/34/EU

[3] Supplementary EU-Type Examination Certificate Number:

TI17ATEX 304 X / 1

[4] Product:

SPRIANO® Electronic transmitter series SST7X
Type: SST70, SST71, SST72, SST75, SST76, SST77B, SST77BL, SST79B and SST70-REM (Indicator)

[5] Manufacturer: **TERRANOVA S.r.l.**

[6] Address: **Via Gramsci, 1, 26827 – Terranova dei Passerini (LO), Italy**

[7] This supplementary certificate extends EU – Type Examination Certificate No. TI17ATEX 304 X to apply to products designed and constructed in accordance with the specification set out in the Schedule of the said certificate but having any variations specified in the Schedule attached to this certificate and the documents therein referred to.

[8] Technická inšpekcia, a.s., Notified Body Number 1354 in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that the product, as modified by this supplementary certificate, has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II to the Directive.

Technická inšpekcia, a.s.
Trnavská cesta 56
821 01 Bratislava, Slovakia
e-mail: tisr@tisr.sk
web: www.tisr.sk
Tel.: +421 2 49208 100

Bratislava, March 08th, 2021

Ing. Dušan Perniš
General Director

NB 1354

[13] **Schedule**

[14] **Supplementary EU-Type Examination Certificate Number: TI17ATEX 304 X / 1**

[15] Description of the variation to the product:

The subject of this supplementary certificate is extension of product SPRIANO® Electronic transmitter series SST7X, Type: SST70, SST71, SST72, SST75, SST76, SST77B, SST77BL, SST79B and SST70-REM (Indicator), which has protection mode "Ex-db" certified by certificate TI17ATEX304X, to the protection mode "Ex-ia" certified by certificate TI17ATEX305X.
Electronic inside the Series SST7X has been used the same as the SST5X described into TI17ATEX305X certificate.
Housing materials to be used Anticorodal Aluminum or Stainless Steel according previous certificates.
New Variation to the product are:

		With Aluminum housing	
		Without safety barrier	
Ex	II 1/2 G	Ex db IIC T6 Ga/Gb	-40°C<Tamb<+60°C
		Ex db IIB T5 Ga/Gb	-40°C<Tamb<+80°C
		or	
		With safety barrier	
Ex	II 1/2 G	Ex ia IIC T6, T5, T4 Ga	-40°C<Tamb<+40°C / +55°C / +80°C
		With SS AISI 316 housing	
		Without safety barrier	
Ex	II 1/2 G	Ex db IIC T6 Ga/Gb	-40°C<Tamb<+60°C
		Ex db IIB T5 Ga/Gb	-40°C<Tamb<+80°C
		or	
		With safety barrier	
Ex	II 1 G	Ex ia IIC T6, T5, T4 Ga	-40°C<Tamb<+40°C / +55°C / +80°C

Basic description of product:

The Transmitters series electronic SST7X measure pressure, level or temperature of liquids, gases and vapors and transmit a current signal 4-20mA + HART®.
According to the process connection, the series SST7X is constituted by the following models, they can be identified by the code following the series name:

SST70	Displacer level transmitter
SST71	Float level transmitter
SST72	Temperature transmitter
SST75	Relative or absolute pressure transmitter with incorporate separating diaphragm (ceramic)
SST76	Relative or absolute pressure transmitter with incorporate separating diaphragm (piezo)
SST77B	Differential pressure transmitter
SST77BL	Pressure transmitter for level measure
SST79B	Submersible level transmitter
SST70-REM	Field digital indicator

CSTA3-128

TERRANOVA® SPRIANO TELCOM MEC-RELA

G. Luca Mergazzoli
W
Director

Model SST70: The transmitter is isolated from the process via a mechanical system to the torsion tube and also the measuring cell presents a separation membrane filled with inert fluid.
Model SST71: The transmitter is isolated from the process via a tube containing reed switches.
Model SST72: The transmitter is isolated from the process via a tube containing sensors PT100.
Models SST75, SST76, SST77B and SST77BL: The transmitter is isolated from the process by membrane separation metal filled with inert fluid.
Model SST79 (version with remote sensor): The remote transmitter is isolated from the process by separation membranes metal filled with inert fluid. It is connected to the housing means shielded cable with 5 wires soldered.
Model SST70-REM (Loop powered field digital indicator): The indicator has no element part but only it is connected via current loop for displaying the desired variable.

Product with variation of Exdb protection:

The instruments are suitable for gas group IIC or IIB depending by the Ambient Temperature and they have the type of protection "Ex db".
Temperature: -40 ° C ≤Tamb≤ + 60 ° C (or -40 ° C ≤Tamb≤ + 80 ° C)
In the case where the process temperatures are higher than the maximum ambient temperature (or below the minimum ambient temperature), the instrument is installed with a suitable finned arm that can dissipate the temperature in excess and ensure the installation inside the ambient temperature range specified by the manufacturer.
The instruments are composed of two parts:
• The housing, the same for all models, which contains the electronic board and the electrical connections.
• The sensing element contained in a body of stainless steel that allows the process connection.
The housing is constituted by the body and by two closing covers (one of which is equipped with transparent windows). The metal parts can be made in Anticorodal Aluminum or Stainless Steel AISI 304 / 316 (Thickness of coating <0.15mm) while the door is tempered-glass glued to the lid with a silicone seal.

Electrical characteristics:

Supply voltage	≤ 30 VDC
Output signal	4 ÷ 20 mA + HART®
Maximum power transferred	0,75 W
ATEX category	II 1/2 G
Protection mode	Ex db IIC T6 Ga/Gb with Tamb [- 40°C, +60°C] Ex db IIB T5 Ga/Gb with Tamb [- 40°C, +80°C]
IP Code	IP 66
The power cables must be at least 22 AWG (0.34mm2 section section - 0.64mm2), suitable for an operating temperature ≥ 90 ° C for Tamb ≥ 70 ° C.	

The marking of the product shall include the following:

⟨Ex⟩ II 1/2 G Ex db IIC T6 Ga/Gb -40°C ≤ Tamb ≤ 60°C
Ex db IIB T5 Ga/Gb -40°C ≤ Tamb ≤ 80°C

Product with variation of Exia protection:

The instruments are suitable for gas group IIC and have the type of protection "Ex i".
The instruments are composed of two parts:
• The housing, the same for all models, which contains the electronic board and the electrical connections.
• The sensing element contained in a body of stainless steel that allows the process connection.
The housing is constituted by the body and by two closing covers (one of which is equipped with transparent windows). The metal parts can be made of stainless steel or aluminum having a content Mg of less than 6% (coating thickness <0.15mm) while the door can be static plastic, 5 mm thick (glue Araldite 2021) or sodalime tempered glass, 5 mm thick (glue Araldite 2011).

TERRANOVA
TECHNOVA INSPEKCIA • SLOVENSKÁ REPUBLIKA • TI NB 1354 -5-

Electrical characteristics:

Parameter	Tamb<60°C	Tamb<80°C
Maximum voltage input **Ui**	30 V	25.2 V
Maximum current input **Ii**	100 mA	100 mA
Power maximum input **Pi**	0.75 W	0.62 W
Maximum capacity Internal	10 nF	10 nF
Maximum Internal Inductance	0.2 mH	0.2 mH
Output signal	4 ÷ 20 mA + HART®	
Degree of protection	IP 66 for Aluminum housing IP67 for SS AISI 316 housing	

The marking of the product shall include the following:

II 1/2G Ex ia IIC T6, T5, T4 Ga/Gb **-40°C ≤ Tamb ≤ 40°C (T6)** **-40°C ≤ Tamb ≤ 55°C (T5)** **-40°C ≤ Tamb ≤ 80°C (T4)** **For Aluminum housing**	**1G Ex ia IIC T6, T5, T4 Ga** **-40°C ≤ Tamb ≤ 40°C (T6)** **-40°C ≤ Tamb ≤ 55°C (T5)** **-40°C ≤ Tamb ≤ 80°C (T4)** **For SS AISI 316 housing**

[16] Report Number:
Inspection report No: 54/5/2021
Final Test Report No: 54/5/2021

[17] Specific Conditions of Use:

Product with variation of Exdb protection:

Ambient temperature:
Ex db IIC T6 Ga/Gb -40°C ≤ Tamb ≤ 60°C
Ex db IIB T5 Ga/Gb -40°C ≤ Tamb ≤ 80°C
In the case where the process temperatures are higher than the maximum ambient temperature (or lower than the minimum ambient temperature), the equipment is installed with a suitable spacer (example: finned arm, syphon, capillary, remote head, etc.) capable of dissipating the excess temperature and ensure the installation inside the temperature range specified by the manufacturer.

Entries for flameproof enclosure:
The accessories used for cable entry into the housing (which must be treated ½ "NPT or M20x1.5) must comply with the standards EN 60079-0 and EN 60079-1.
The entrance hole leads not used should be closed with the cap conforms to EN 60079-1.

Warning marking:
- "WARNING – DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE IS PRESENT"

Informative marking:
- "SEE INSTALLATION INSTRUCTION DOCUMENT".

Product with variation of Exia protection:

Ambient temperature:

-40°C ÷ +40°C	For Class T6
-40°C ÷ +55°C	For Class T5
-40°C ÷ +80°C	For Class T4

In the case where the process temperatures are higher than the maximum ambient temperature (or lower than the minimum ambient temperature), the equipment is installed with a suitable

spacer (example: finned arm, syphon, capillary, remote head, etc.) capable of dissipating the excess temperature and ensure the installation inside the temperature range specified by the manufacturer.

[18] Essential Health and Safety Requirements:
The Essential Health and Safety Requirements (EHSRs) covered by the standards listed at item 9.
Additional information: None.

[19] Drawings and Documents:

Number	Sheet	Issue	Date	Description
DTP-SST7X	4pgs	REV No.21.02	12/02/2021	List of drawings and Documents SPRIANO ® Electronic Switches SST7X By TERRANOVA ®
TI17ATEX305X	3 pgs	-	13/03/2017	EU –Type Examination Certificate (Exia)

Technická inšpekcia, a.s.
Trnavskácesta 56
821 01 Bratislava, Slovakia
e-mail: tisr@tisr.sk
web: www.tisr.sk
Tel.: +421 2 49208 100

TECHNICKÁ INŠPEKCIA • SLOVENSKÁ REPUBLIKA • TI NB 1354 -5-

Bratislava, March 08th, 2021

Ing. Dušan Perniš
General Director

TERRANOVA® SPRIANO Tylcom MEC-RELA

G. Luca Vergazzoli
W
...E...ctor

TECHNICKÁ INŠPEKCIA, a.s.

SLOVENSKÁ REPUBLIKA

CEOC INTERNATIONAL

[1] EU-TYPE EXAMINATION CERTIFICATE

[2] Equipment or Protective System Intended for use in potentially explosive atmospheres
Directive 2014/34/EU

[3] EU-Type Examination Certificate Number:

TI17ATEX 304 X

[4] Product:

SPRIANO® Electronic transmitter series SST7X
Type: SST70, SST71, SST72, SST75, SST76, SST77B, SST77BL, SST79B and SST70-REM (Indicator)

[5] Manufacturer: **TERRANOVA S.r.l.**

[6] Address: **Via Gramsci, 1, 26827 – Terranova dei Passerini (LO), Italy**

[7] This product and any acceptable variation thereto is specified in the schedule to this certificate and the documents therein referred to.

[8] Technická inšpekcia, a.s., Notified Body Number 1354 in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this product has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of product intended for use in potentially explosive atmospheres given in Annex II to the Directive.
The examination and test results are recorded in confidential report No. 304/5/2017.

[9] Compliance with the Essential Health and safety Requirements has been assured by compliance with: **EN 60079-0:2012+A11:2013, EN 60079-1:2014**
except in respect of those requirements listed at item 18 of the Schedule.

[10] If the sign "X" is placed after the certificate number, it indicate that the product is subject to the Specific conditions of Use specified in the schedule to this certificate.

[11] This EU-TYPE EXAMINATION CERTIFICATE relates only to the design and construction of the specified product. Further requirements of this Directive apply to the manufacturing process and supply of this product.

[12] The marking of the product shall include the following:

Ex II 1/2 G Ex db IIC T6 Ga/Gb -40°C ≤ Tamb ≤ 60°C
Ex db IIB T5 Ga/Gb -40°C ≤ Tamb ≤ 80°C

Technická inšpekcia, a.s.
Trnavská cesta 56
821 01 Bratislava, Slovakia
e-mail: tisr@tisr.sk
web: www.tisr.sk
Tel.: +421 2 49208 100

Bratislava, March 13th, 2017

Ing. Dušan Perniš
General Director

TECHNICKÁ INŠPEKCIA • SLOVENSKÁ REPUBLIKA • TI NB 1354 - 5 -

333123

CSTA3-128

NB 1354

[13] **Schedule**

[14] **EU-Type Examination Certificate Number: TI17ATEX 304 X**

[15] Description of product:
The Transmitters series electronic SST7X measure pressure, level or temperature of liquids, gases and vapors and transmit a current signal 4-20mA.
The instruments are suitable for gas group IIC and have the type of protection "Ex db".
Temperature: -40 ° C ≤Tambs≤ + 60 ° C (or -40 ° C ≤Tambs≤ + 80 ° C)
In the case where the process temperatures are higher than the maximum ambient temperature (or below the minimum ambient temperature), the appliance is installed with a suitable spacer can dissipate the temperature in excess and ensure the installation inside the ambient temperature range specified by the manufacturer.
The instruments are composed of two parts:
• The housing, the same for all models, which contains the electronic board and the electrical connections.
• The sensing element contained in a bodice of stainless steel that allows the process connection.
The housing is constituted by the body and by two closing covers (one of which is equipped with transparent windows). The metal parts can be made in anticorodal aluminum or stainless steel AISI 304 (Thickness of coating <0.15mm) while the door is tempered-glass glued to the lid with a silicone seal.

According to the process connection, the series SST7 is formed by the following models, they can be identified by the code following the series name:

SST70	Displacer level transmitter
SST71	Float level transmitter
SST72	Temperature transmitter
SST75	Relative or absolute pressure transmitter with incorporate separating diaphragm (ceramic)
SST76	Relative or absolute pressure transmitter with incorporate separating diaphragm (piezo)
SST77B	Differential pressure transmitter
SST77BL	Pressure transmitter for level measure
SST79B	Submersible level transmitter
SST70-REM	Field digital indicator

Model SST70: The transmitter is isolated from the process via a mechanical system to the torsion tube and also the measuring cell presents a separation membrane filled with inert fluid.

Model SST71: The transmitter is isolated from the process via a tube containing reed switches.

Model SST72: The transmitter is isolated from the process via a tube containing sensors PT100.

Models SST75, SST76, SST77B and SST77BL: The transmitter is isolated from the process by membrane separation metal filled with inert fluid.

Model SST79 (version with remote sensor): The remote transmitter is isolated from the process by separation membranes metal filled with inert fluid. It is connected to the housing means shielded cable with 5 wires soldered.

Model SST70-REM (Loop powered field digital indicator): The indicator has no element part but only it is connected via current loop for displaying the desired variable.

Electrical characteristics:

Supply voltage	≤ 30 VDC
Output signal	4 ÷ 20 mA
Maximum power transferred	0,75 W
ATEX category	1/2 G
Protection mode	Ex db IIC T6 Ga/Gb with Tamb [- 40°C, +60°C] Ex db IIB T5 Ga/Gb with Tamb [- 40°C, +80°C]
IP Code	IP 66
The power cables must be at least 22 AWG (0.34mm2 section section - 0.64mm2), suitable for an operating temperature ≥ 90 ° C for Tamb ≥ 70 ° C.	

[16] Report Number:
Inspection report No: 304/5/2017
Final Test Report No: 304/5/2017

[17] Specific Conditions of Use:

Ambient temperature:

Ex db IIC T6 Ga/Gb	-40°C ≤ Tamb ≤ 60°C
Ex db IIB T5 Ga/Gb	-40°C ≤ Tamb ≤ 80°C

In the case where the process temperatures are higher than the maximum ambient temperature (or lower than the minimum ambient temperature), the equipment is installed with a suitable spacer (example: finned arm, syphon, capillary, remote head, etc.) capable of dissipating the excess temperature and ensure the installation inside the temperature range specified by the manufacturer.

Entries for flameproof enclosure:
The accessories used for cable entry into the housing (which must be treated ½ "NPT) must comply with the standards EN 60079-0 and EN 60079-1.
The entrance hole leads not used should be closed with the cap conforms to EN 60079-1.

Warning marking:
- "WARNING – DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE IS PRESENT"

Informative marking:
- "SEE INSTALLATION INSTRUCTION DOCUMENT".

[18] Essential Health and Safety Requirements:
The Essential Health and Safety Requirements (EHSRs) covered by the standards listed at item 9.
Additional information: None.

[19] Drawings and Documents:

Number	Sheet	Issue	Date	Description
DTP-SST7X	3pgs	REV No.17.01	31/01/2017	List of drawings and Documents SPRIANO® Electronic Switches SST7X

Technická inšpekcia, a.s.
Trnavskácesta 56
821 01 Bratislava, Slovakia
e-mail: tisr@tisr.sk
web: www.tisr.sk
Tel.: +421 2 49208 100

TECHNICKÁ INŠPEKCIA · SLOVENSKÁ REPUBLIKA · TI NB 1354 - 5 -

Bratislava, March 13th, 2017

Ing. Dušan Perniš
General Director

CSTA3-128

DECLARATION of CONFORMITY for SST77B, SST76 and SST72

TERRANOVA® Srl - www.terranova-instruments.com
Factory & Sales: Via Gramsci 1 – 26827 Terranova dei Passerini (LO) – Italy
Head Office: Via Rosso Medardo 16 – 20159 Milano – Italy
Phone: +39 0377 919119 – Fax: +39 0377 855720 - VAT IT07848810151

CE 1354

EU Declaration of Conformity

TERRANOVA® Srl

Via Gramsci 1 – 26827 Terranova dei Passerini (LO) – Italy
declares on his sole responsibility that the product:

SPRIANO® Electronic Transmitter series **SST7x**

(device controlling or regulating the limits of an industrial process, like pressure, level and temperature)
satisfies the essential requirements and conformity assessment procedures of the following legislation:

Directive 2014/34/EU (ATEX)

EU TYPE CERTIFICATE: TI 17 ATEX 304 X / 1

Equipment for use in potentially explosive atmospheres, suitable for Zones 0, 1, 2 (process side and external side)

With Aluminum housing

Without safety barrier

Ex	II 1/2 G	Ex db IIC T6 Ga/Gb	-40°C<Tamb<+60°C
		Ex db IIB T5 Ga/Gb	-40°C<Tamb<+80°C

or

With safety barrier

Ex	II 1/2 G	Ex ia IIC T6, T5, T4 Ga	-40°C<Tamb<+40°C / +55°C / +80°C

With SS AISI 316 housing

Without safety barrier

Ex	II 1/2 G	Ex db IIC T6 Ga/Gb	-40°C<Tamb<+60°C
		Ex db IIB T5 Ga/Gb	-40°C<Tamb<+80°C

or

With safety barrier

Ex	II 1 G	Ex ia IIC T6, T5, T4 Ga	-40°C<Tamb<+40°C / +55°C / +80°C

Presumption of conformity provided by the application of the harmonised standards:
EN IEC 60079-0:2018, EN 60079-1:2014, EN 60079-11:2012, EN 60079-26:2007
The Notified Body NB 1354 Technicka inspekcia a.s. performed Module D, Annex IV, Directive 2014/34/EU and issued the Production Quality Assurance Notification. Periodical Surveillance is provided according to Annex IV, Point 4, Directive 2014/34/EU by the same Notified Body.

Continues in next page.

CE 1354

EU Declaration of Conformity

TERRANOVA® Srl

Via Gramsci 1 – 26827 Terranova dei Passerini (LO) – Italy
declares on his sole responsibility that the product:

SPRIANO® Electronic Transmitter series **SST7x**

(device controlling or regulating the limits of an industrial process, like pressure, level and temperature)
satisfies the essential requirements and conformity assessment procedures of the following legislation:

Directive 2014/68/EU (PED)

EU DESIGN EXAMINATION CERTIFICATE:
1292/1/2017-2 - Carbon steel torque tube level transmitters / switches
1292/1/2017-3 - Stainless steel torque tube level transmitters / switches

1292/1/2017-4 – Carbon steel transmitters / switches
1292/1/2017-5 – Stainless steel transmitters / switches
1292/1/2017-6 – Titanium transmitters / switches
1292/1/2017-7 – Hastelloy alloy transmitters / switches
1292/1/2017-8 – Inconel alloy transmitters / switches

Pressure equipment, up to Category III, for fluids (gases, liquids and vapours) in Group 1.

Presumption of conformity provided by the application of the harmonised standard:
EN 13445-2:2009/A2:2012

The Notified Body NB 1354 Technicka inspekcia a.s. performed Module H1, Directive 2014/68/EU and issued the Production Examination Certificate N.° 1860/1/2020. Periodical Surveillance is provided according to Directive 2014/68/EU by the same Notified Body.

Directive 2014/30/EU (EMC)

Equipment with an adequate level of electromagnetic compatibility.


Presumption of conformity provided by the application of the harmonised standard:
EN 61326-1:2006

Terranova dei Passerini, 08/03/2021


Mr Sergio Valletti,
General Manager

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

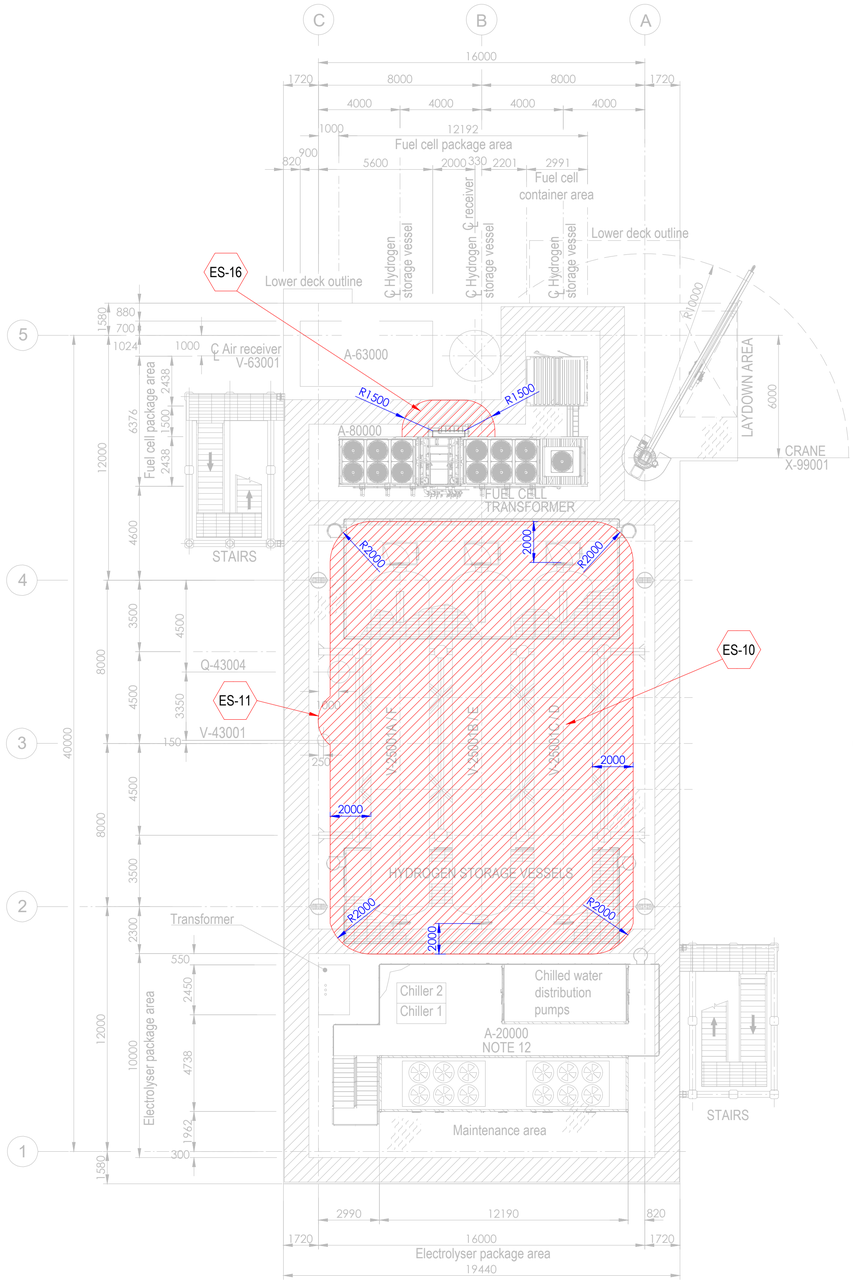


PLAN ON UPPER DECK
EL+30.310 T.O.S.

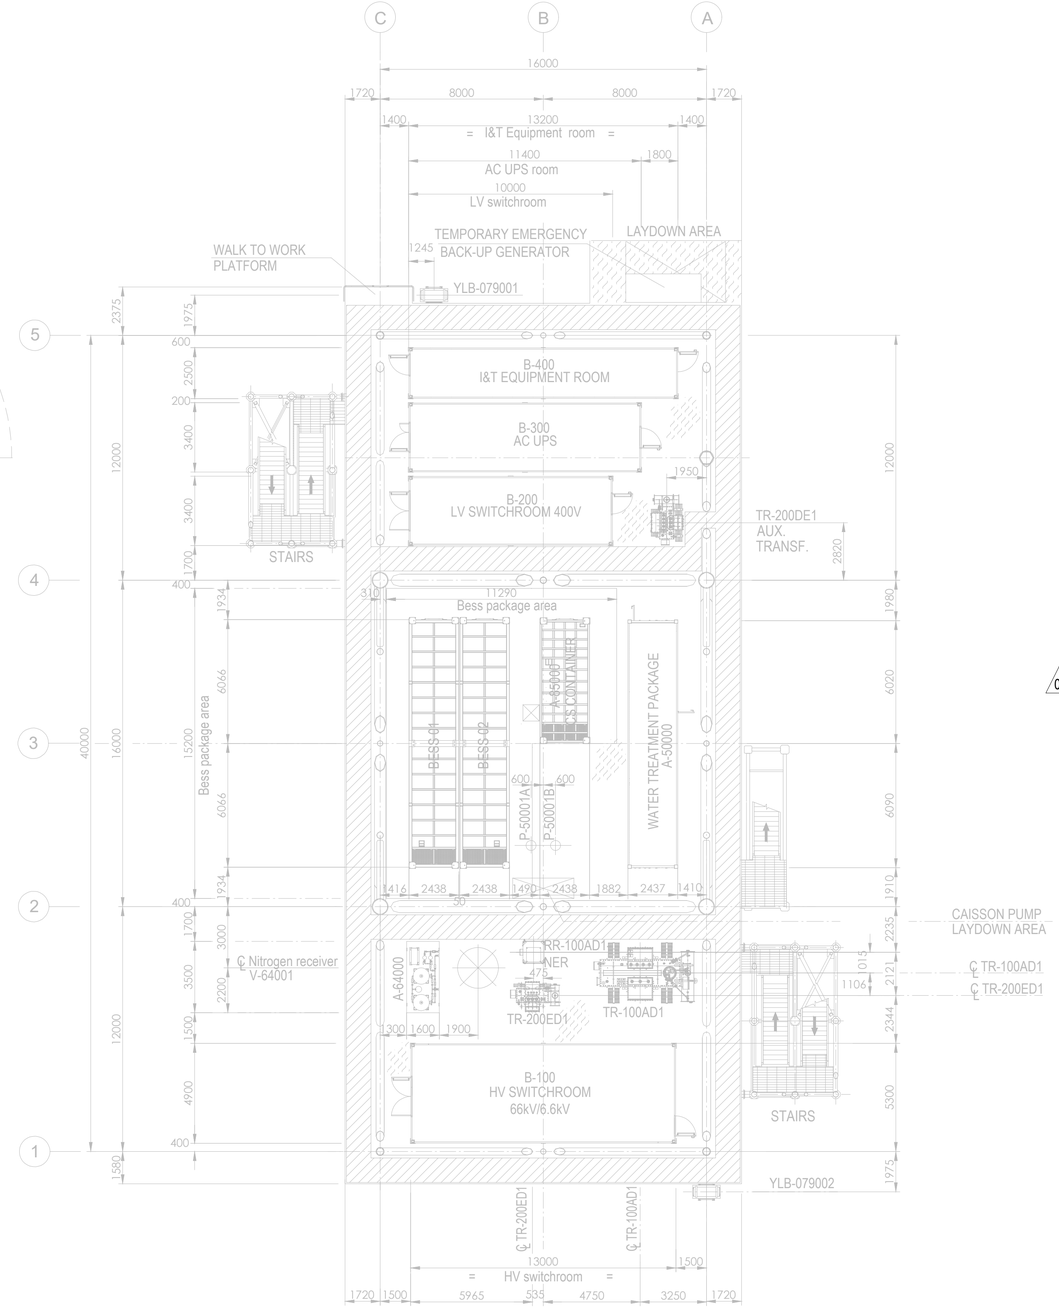

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

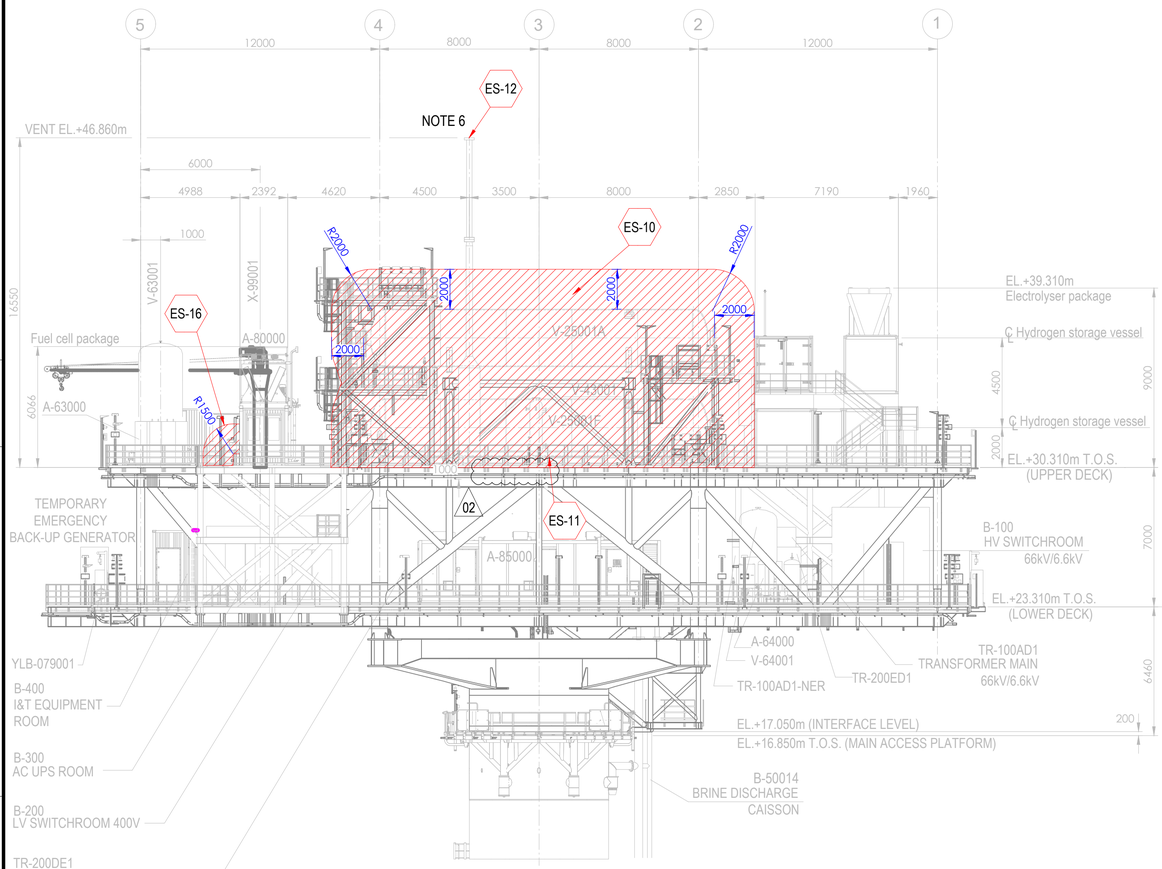



ELEVATION LOOKING EAST

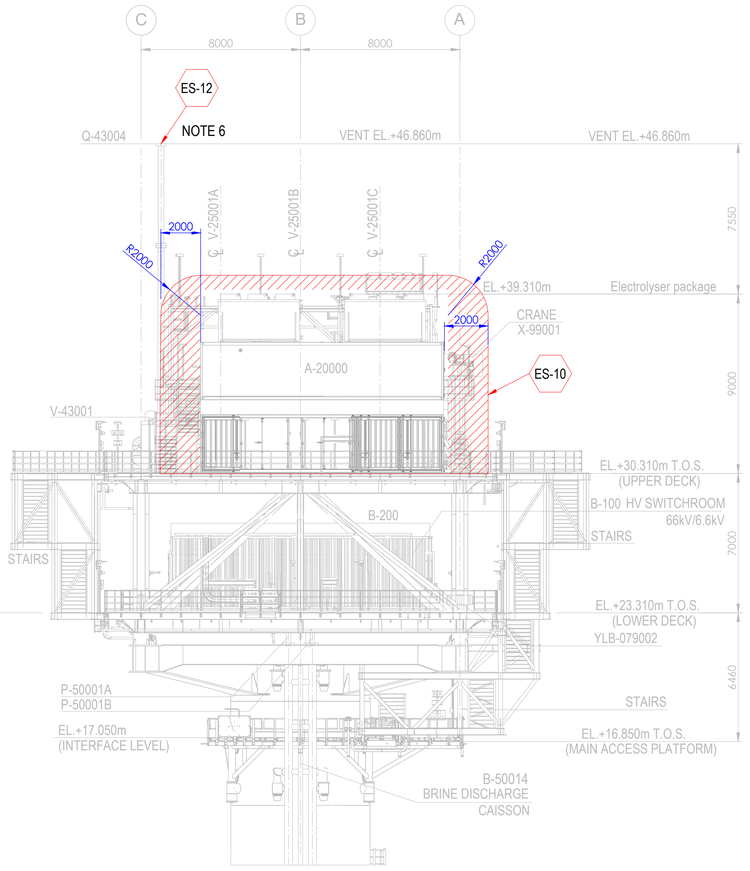

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

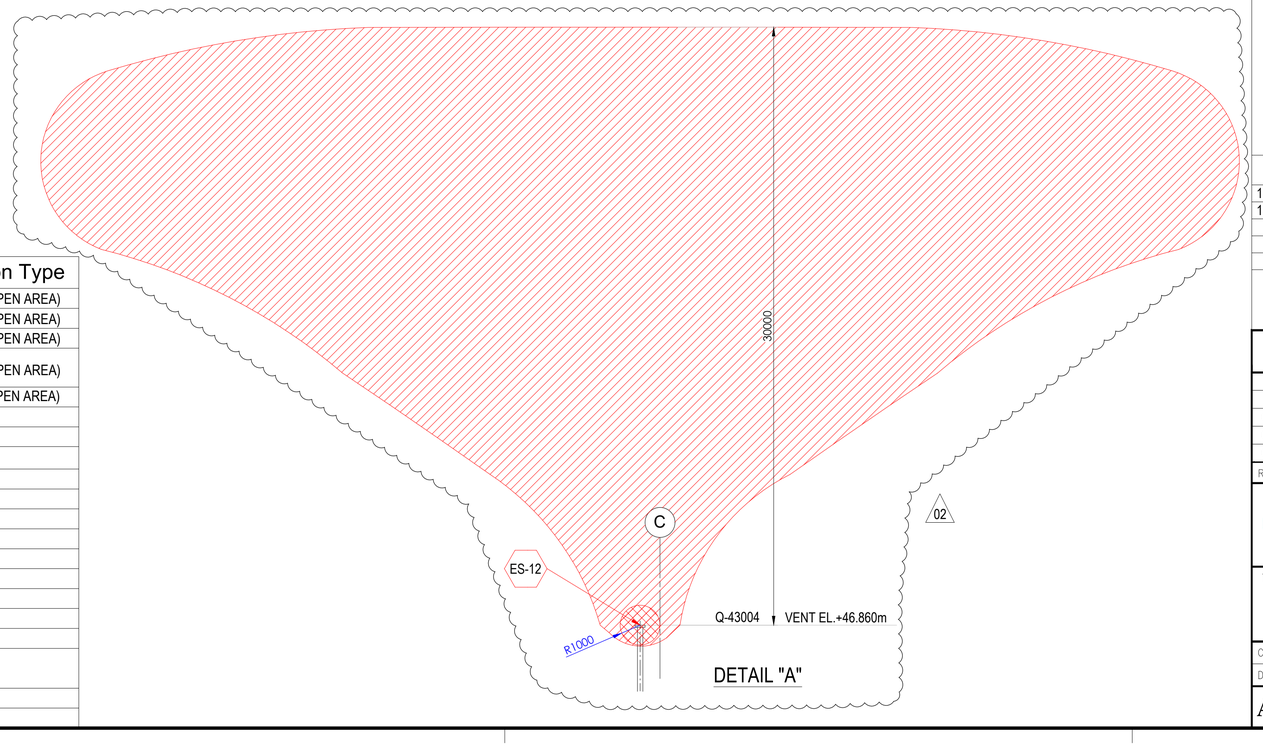



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PT-002	: Pressure Transmitter - Hyrogen to Vessels Inlet Header Shut-Down	Dwg	123A90-DDL-PR-PID-80013		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001483	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		SE240635			
Manufacturer	Terranova Srl			**Model**		SST76			
Cert No.	TI17ATEX304X - TI17ATEX304X /1			**Equipment Ambient Temp.**		-40°C to +60°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	PL	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	OK	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	OK	
23	Breathing and drainage devices are satisfactory	x	PL	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PT-002	: Pressure Transmitter - Hyrogen to Vessels Inlet Header Shut-Down			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001483	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	OK	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-PT-002	: Pressure Transmitter - Hyrogen to Vessels Inlet Header Shut-Down		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001483	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks					
67	All Terminals are Ex n certified (if required on certificate)	x	NA		
68	Hermetically sealed and enclosed break devices are undamaged	x	NA		
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA		
70	Test port, if fitted, is functional (type “nR” only)	x	NA		
71	Breathing operation is satisfactory (type “nR” only)	x	NA		
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA		
73	The ventilation airflow is not impeded	x	NA		
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA		
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA		
76	Variable voltage/frequency installation complies with documentation	x	NA		
Extra Ex p checks					
77	Pressurization gas is correct type	x	NA		
78	Actual pressure is within maximum and minimum settings for equipment	x	NA		
79	Timers set as per certification documentation	x	NA		
80	Alarms and trip functions operate correctly as per certification documentation	x	NA		
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA		
82	Automatic electrical protective devices operate within permitted limits	x	NA		
83	Automatic electrical protective devices are set correctly	x	NA		
84	Protective gas inlet temperature is below maximum specified	x	NA		
85	Ducts, pipes and enclosures are in good condition	x	NA		
86	Protective gas is substantially free from contaminants	x	NA		
87	Protective gas pressure and/or flow is adequate	x	NA		
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA		
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA		
90	Specific conditions of use (if applicable) are complied with		NA		
Extra Ex i (Intrinsically Safe – IS) checks					
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA		
92	Cables are installed in accordance with the documentation	x	NA		
93	Segregation is maintained between IS and non-IS Circuits	x	NA		
94	Cable screens are isolated at one end (field side)	x	NA		
95	Cable screens are earthed in accordance with the documentation	x	NA		
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA		
97	Equipment installed is the one specified in the documentation	x	NA		
98	Ambient temperature range of the apparatus is correct for the installation	x	NA		
99	Service temperature range of the apparatus is correct for the installation	x	NA		
100	Installation is clearly labelled	x	NA		
101	Printed circuit boards are clean and undamaged	x	NA		
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA		
103	Point-to-point connections are all correct	x	NA		
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA		
105	Earth connections maintain the integrity of the type of protection	x	NA		
106	Intrinsically safe circuit earthing is satisfactory	x	NA		
107	Insulation resistance is satisfactory	x	NA		
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA		

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-02-08	2025-02-08	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-02-08T08:10:25.231Z	PROVERLIS Digitaly signed by Alessio Polo 2025-02-08T10:22:07.874Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

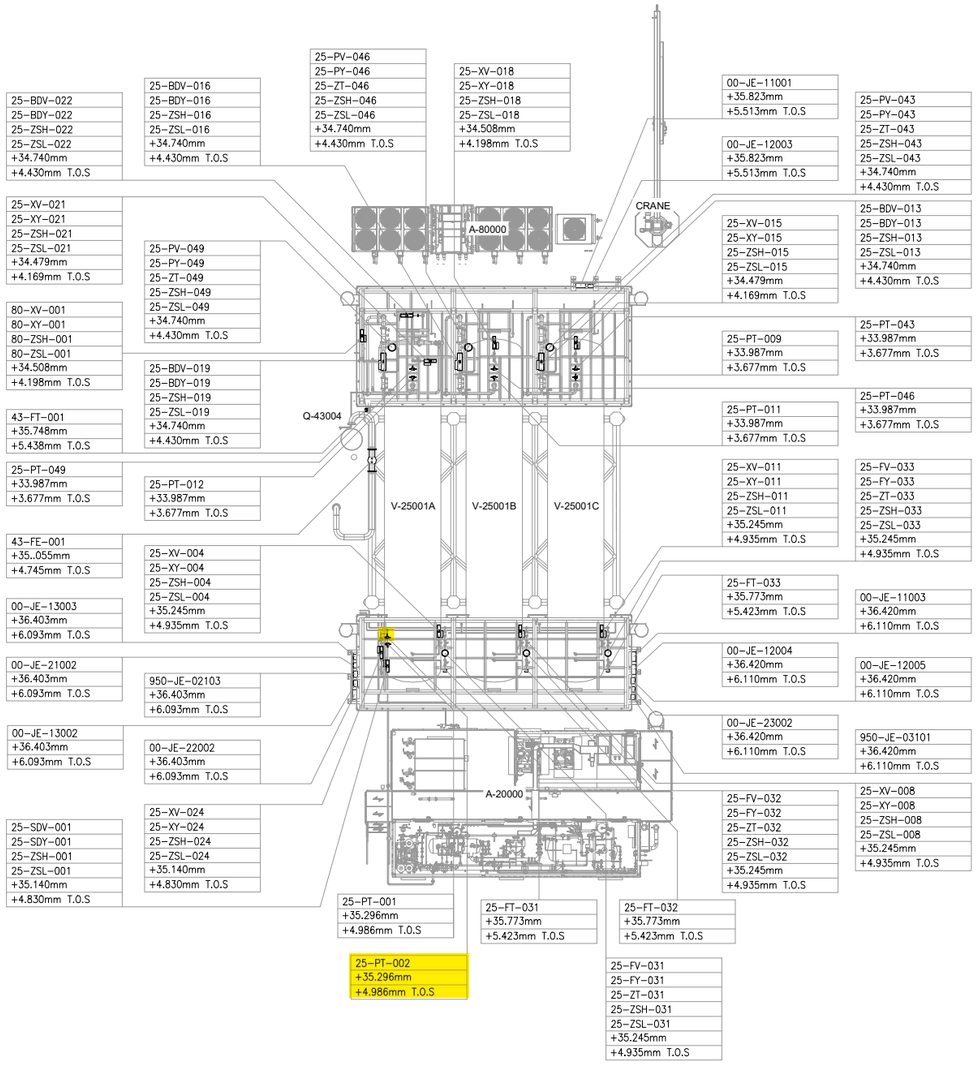

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081
REV.: 2_A | DATE: 07/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA


TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. DRAWING_NO.

REV. REV

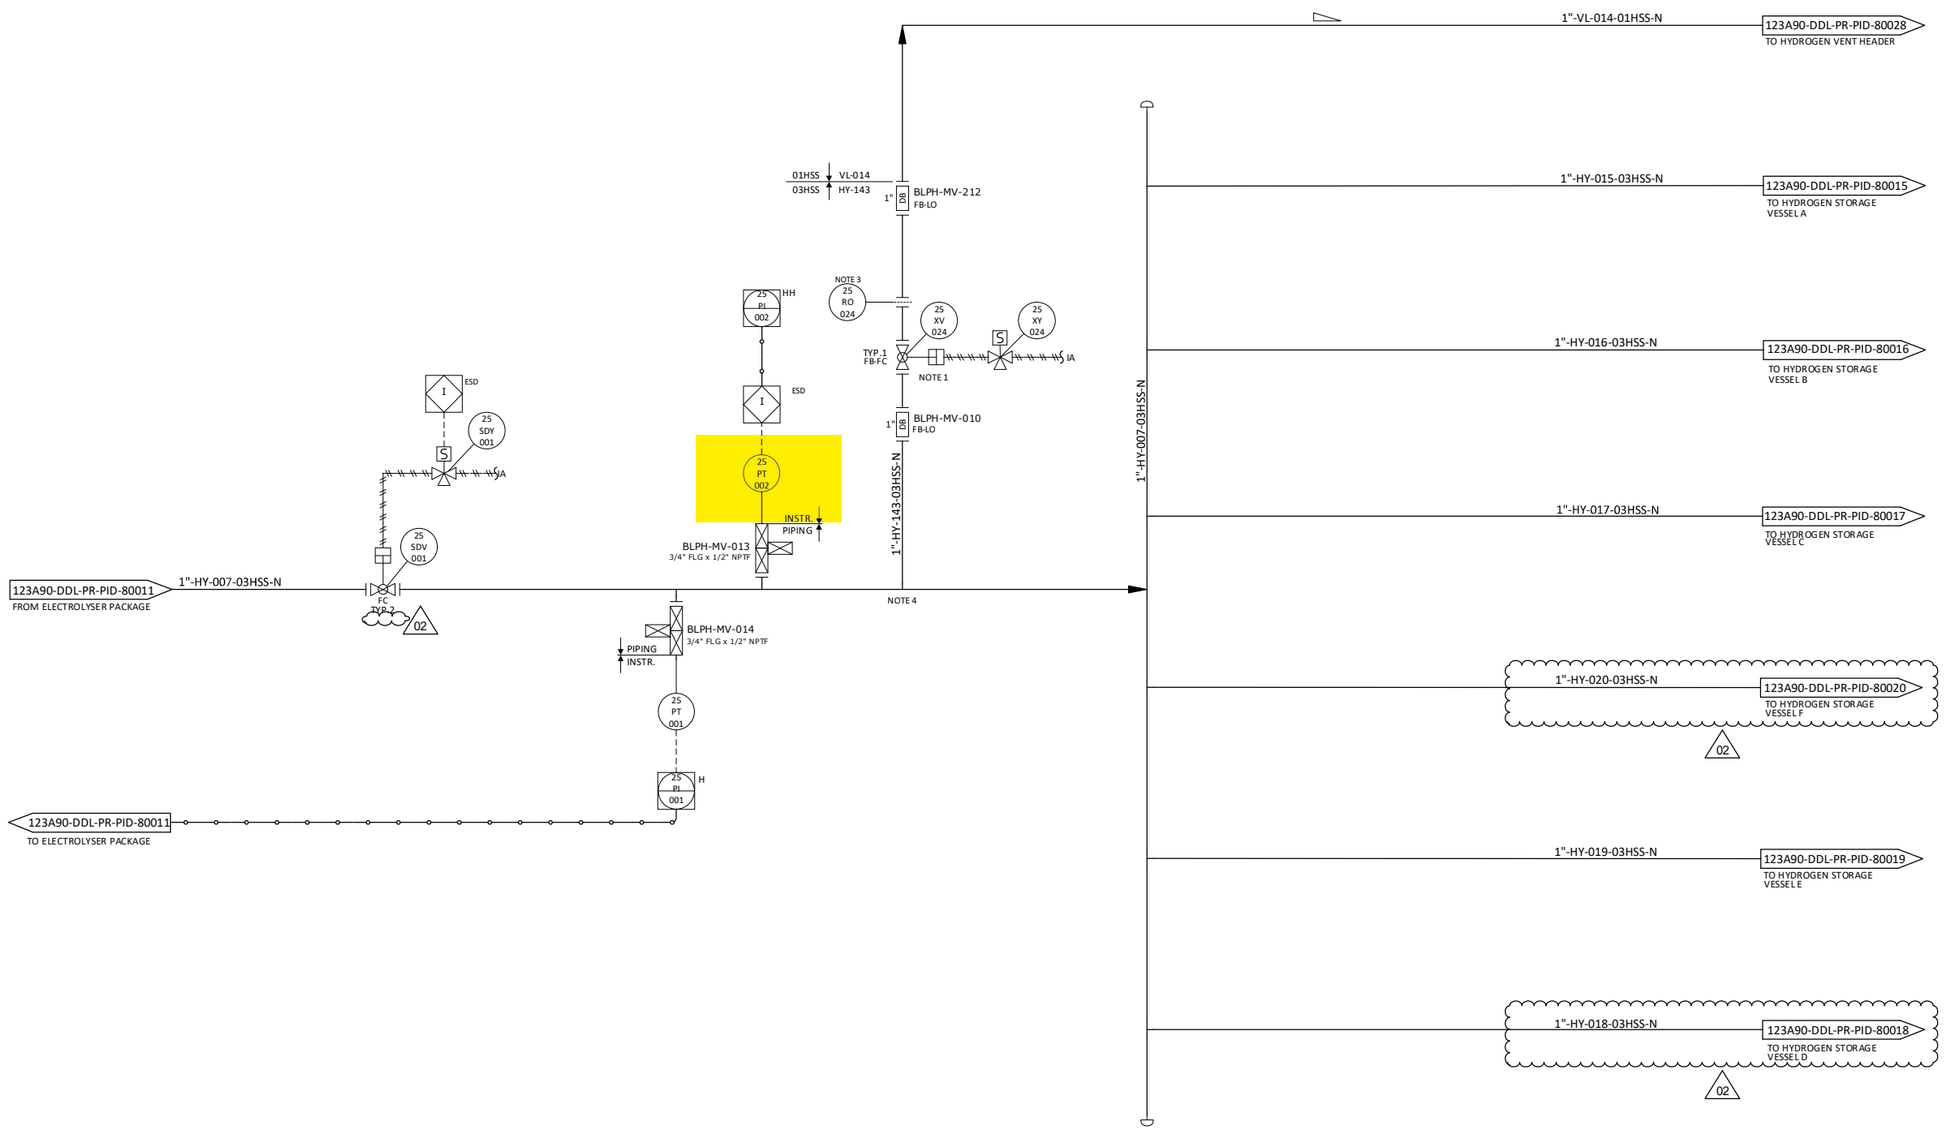

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSELS HEADER (INLET)

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO. 123A90-DDL-PR-PID-80013	SHEET 001	REV. 02

File Name : FILE_NAME

DRAWING NO. 123A90-DDL-IN-DG-40016

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-21002	No.	MARSHALLING CABINET B400-SIS-001

<01>

25-PT-002 (+ WH, - BK) — NOTE-2 — C-25-PT-002/00-JE-21002 1x2x0.75mm2,ShT+ARM,F.Res,ORANGE,NIS

80-PT-002 (+ WH, - BK) — NOTE-2 — C-80-PT-002/00-JE-21002 1x2x0.75mm2,ShT+ARM,F.Res,ORANGE,NIS

43-LT-001 (+ WH, - BK) — C-43-LT-001/00-JE-21002 1x2x0.75mm2,ShT+ARM,F.Res,ORANGE,NIS

64-PT-002 (+ WH, - BK) — NOTE-2 — C-64-PT-002/00-JE-21002 1x2x0.75mm2,ShT+ARM,F.Res,ORANGE,NIS

TB-1

WH / BK	1	WH / BK	PR1
	2		
	SH		
WH / BK	3	WH / BK	PR2
	4		
	SH		
WH / BK	5	WH / BK	PR3
	6		
	SH		
WH / BK	7	WH / BK	PR4
	8		
	SH		
SPARE	9	WH / BK	PR5
	10		
	SH		
SPARE	11	WH / BK	PR6
	12		
	SH		
	OS		

00-JE-21002/B400-SIS-001
6x2x0.75mm2,Sh+ShT+ARM,F.Res,ORANGE,NIS

TB-00-JE-21002

PR1	1	WH / BK	25-PT-002
Shield Bar	2		
PR2	3	WH / BK	80-PT-002
Shield Bar	4		
PR3	5	WH / BK	43-LT-001
Shield Bar	6		
PR4	7	WH / BK	64-PT-002
Shield Bar	8		
PR5	9	WH / BK	SPARE
Shield Bar	10		
PR6	11	WH / BK	SPARE
	12		

Shield Bar — I.E.

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40016**

REV.:	DATE:	SIGNATURE:
1_Q	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND | ROSETTI MARINO


TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT– SAFETY SYSTEM WIRING DIAGRAMS
00–JE–21002

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

	DRAWING NO.	SHEET	REV.
A3	123A90–DDL–IN–DG–40016	006	01

File Name : 123A90-DDL-IN-DG-40016_Rev.01

E33

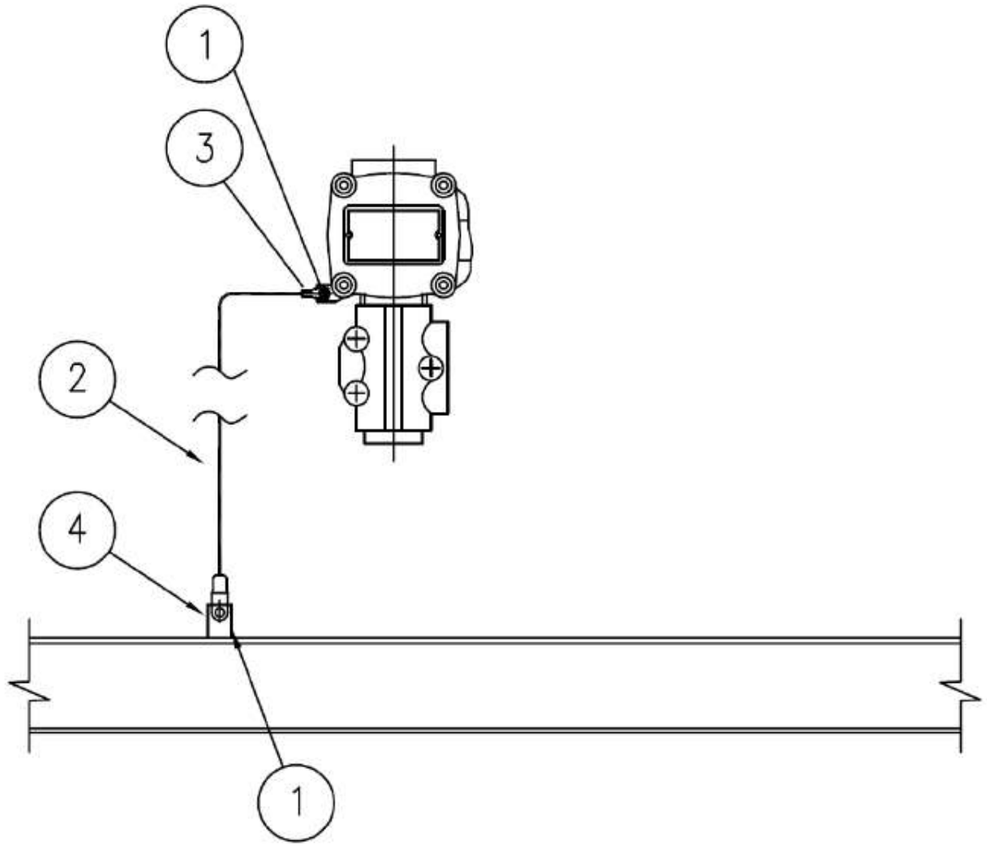

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS

A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

ELECTRICAL HOOK-UP FOR PRESSURE TRANSMITTERS

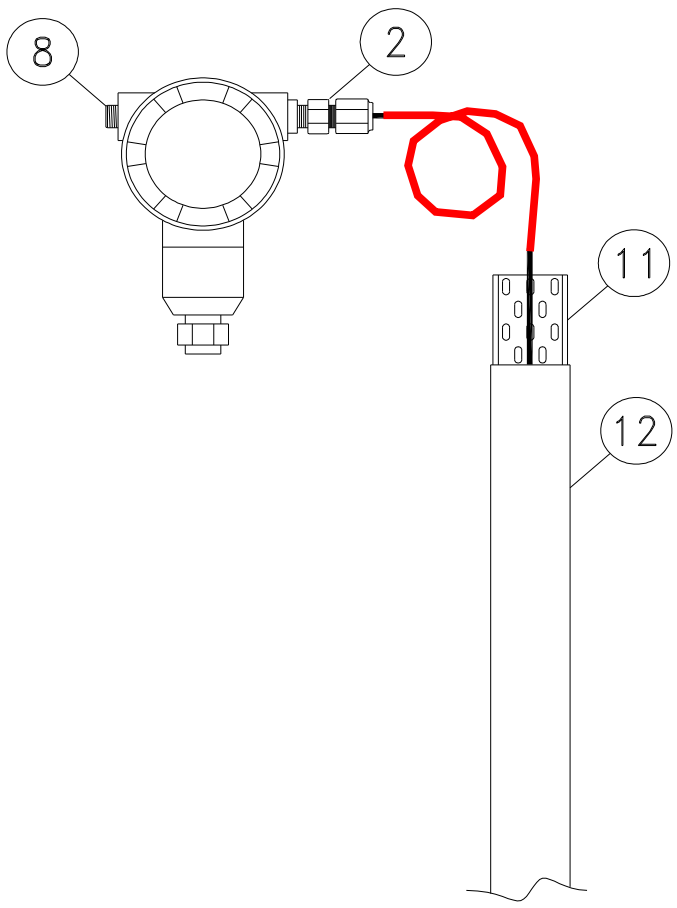

INSTRUMENT TAG	
1	25-PT-002
2	25-PT-004
3	25-PT-006
4	25-PT-008
5	25-PT-009
6	25-PT-011
7	25-PT-012
8	63-PT-004
9	64-PT-002
10	80-PT-002
11	
12	
13	
14	
15	
16	
17	
18	
19	
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**

REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi


ROSETTI MARINO SpA

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	1

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Process Hook-Ups	Sh. 6 of 8 Date: 06/12/2024 Rev. 02

PRESSURE TRANSMITTERS - Installation for Gas Service

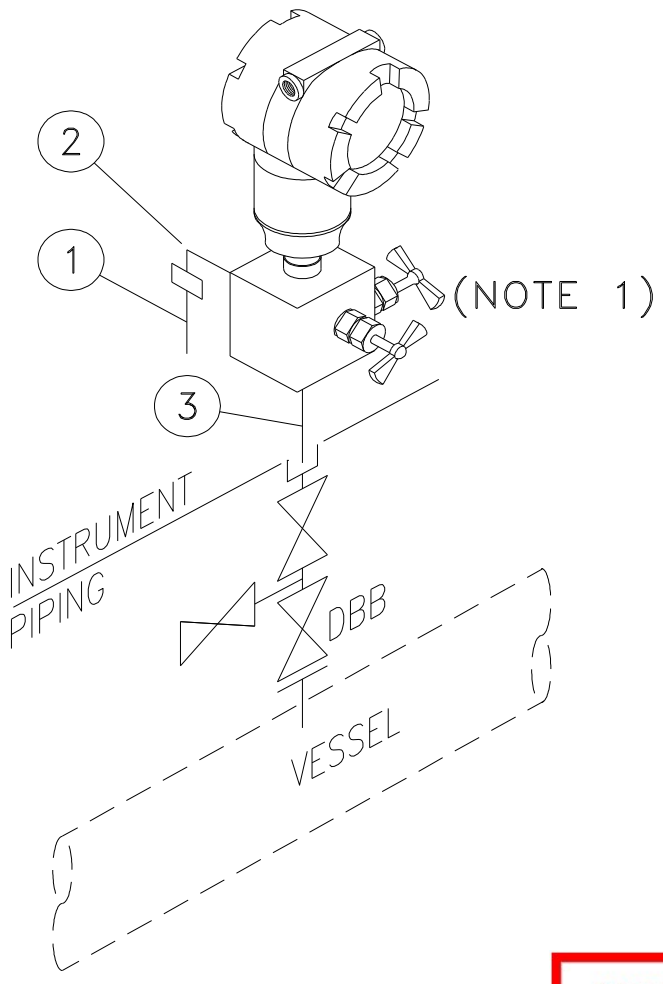

INSTRUMENT TAG	
1	25-PT-004
2	25-PT-006
3	25-PT-008
4	25-PT-009
5	25-PT-011
6	25-PT-012
7	25-PT-035
8	25-PT-037
9	25-PT-040
10	25-PT-043
11	25-PT-046
12	25-PT-049
13	25-PT-001
14	25-PT-002
15	25-PT-055A
16	25-PT-055B
17	43-PT-001
18	50-PT-014
19	63-PT-003
20	63-PT-004
21	~~64-PT-031A~~
22	64-PT-031B
23	64-PT-002
24	80-PT-002
25	
26	
27	
28	
29	
30	

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40077**

REV.:	DATE:	SIGNATURE:
2_B	17/01/25	G.Randi


ROSETTI MARINO SpA

NOTES:
(1) MANIFOLD IS SUPPLIED WITH INSTRUMENT.
(2) VENDOR SHALL GUARANTEE THE MATERIAL COUPLING BETWEEN TUBING AND FITTINGS.

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
3		SS316 NIPPLE	1/2" NPT L=100mm	N. 1
2		ELBOW SS316	1/4" NPT-M x 1/2" O.D	N. 1
1		SS 316L TUBING (NOTE 2)	1/2" x 0,049"Thk	m 0.5

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

SST76 PRESSURE TRANSMITTERS

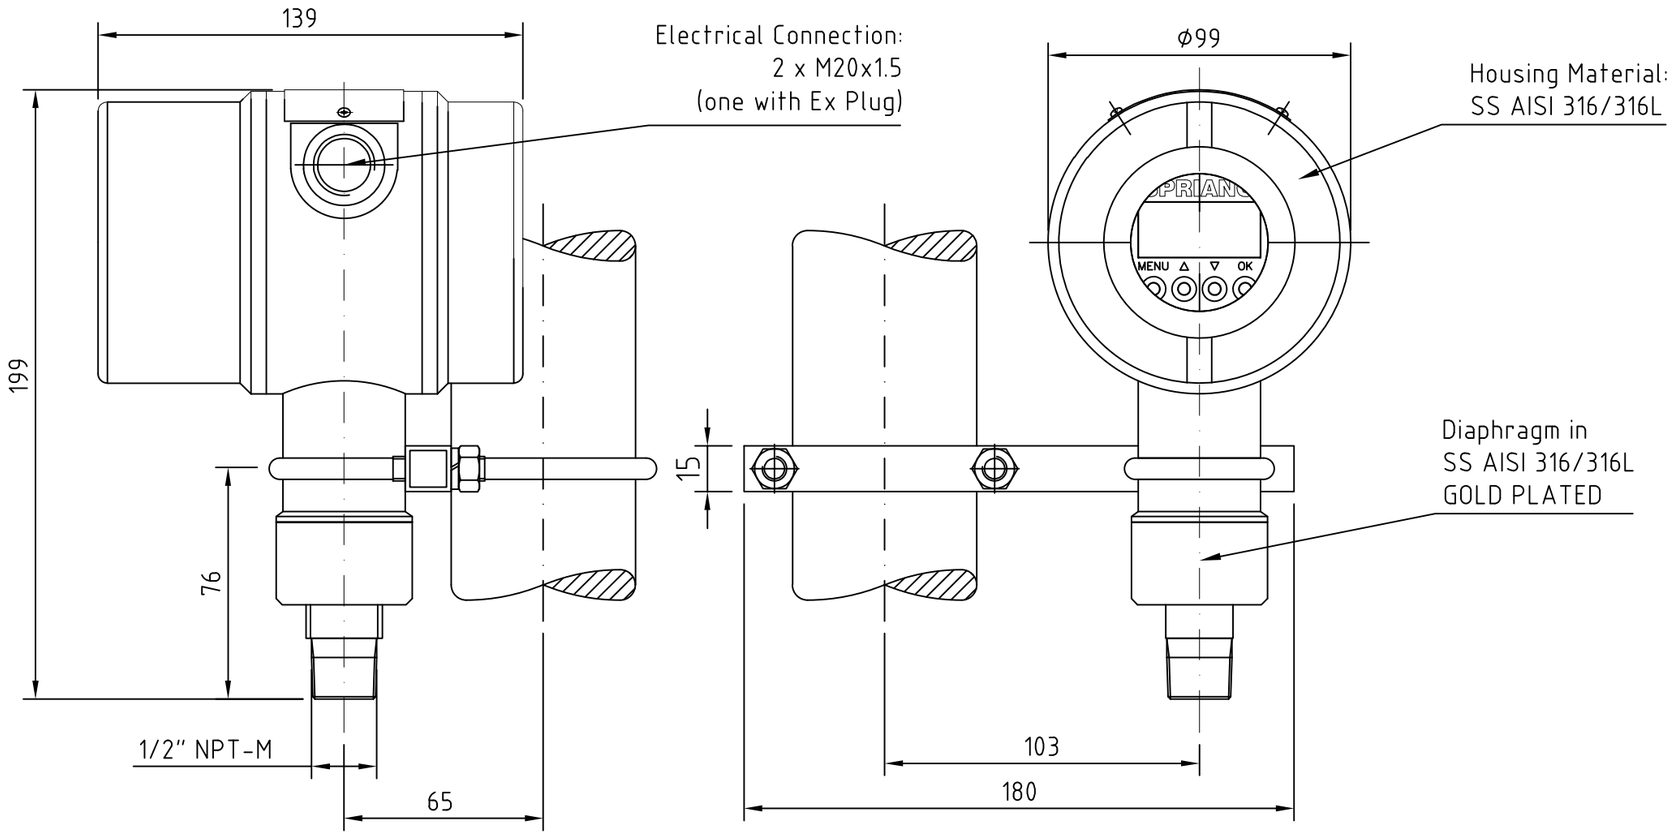


TAG LIST

#	TAG	RANGE	CALIBRATION
1	25-PT-001	0 ÷ 100 barg	0 ÷ 40 barg
2	25-PT-002	0 ÷ 100 barg	0 ÷ 40 barg
3	25-PT-004	0 ÷ 100 barg	0 ÷ 40 barg
4	25-PT-035	0 ÷ 100 barg	0 ÷ 40 barg
5	25-PT-006	0 ÷ 100 barg	0 ÷ 40 barg
6	25-PT-037	0 ÷ 100 barg	0 ÷ 40 barg
7	25-PT-008	0 ÷ 100 barg	0 ÷ 40 barg
8	25-PT-040	0 ÷ 100 barg	0 ÷ 40 barg
9	25-PT-009	0 ÷ 100 barg	0 ÷ 40 barg
10	25-PT-043	0 ÷ 100 barg	0 ÷ 40 barg
11	25-PT-011	0 ÷ 100 barg	0 ÷ 40 barg
12	25-PT-046	0 ÷ 100 barg	0 ÷ 40 barg
13	25-PT-012	0 ÷ 100 barg	0 ÷ 40 barg
14	25-PT-049	0 ÷ 100 barg	0 ÷ 40 barg

TOTAL QUANTITY: 14

MAN2-R6 TWO WAYS AND TWO VALVES MANIFOLD

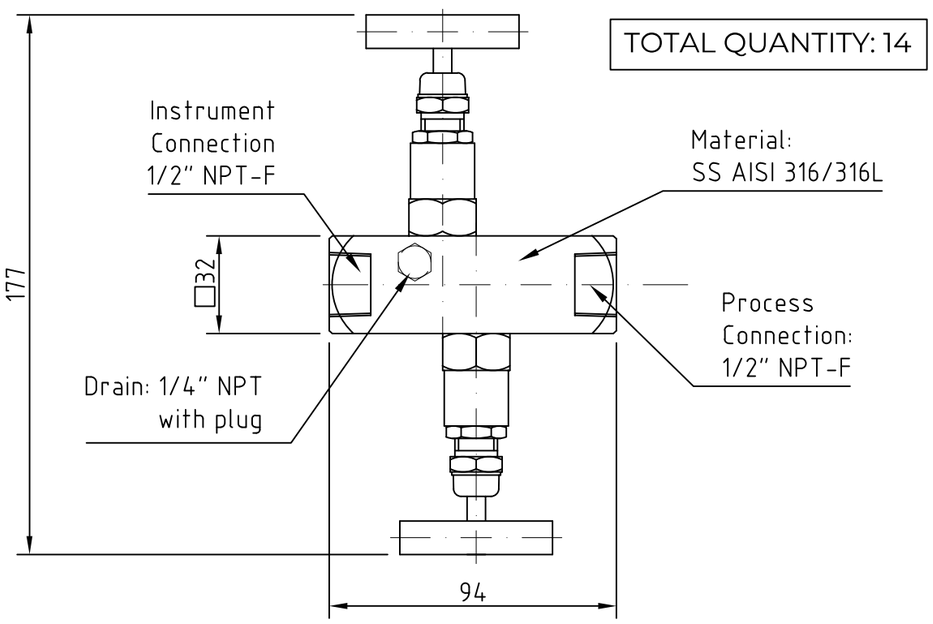

TOTAL QUANTITY: 14

NOTES

SST76 PRESSURE TRANSMITTERS
SST76-H-7-L-2-9-2-1-4 + MAN2-R6

H - OUTPUT: 4-20 mA + HART
7 - PROCESS CONNECTION: 1/2" NPT M;
L - NOMINAL RANGE: 0 ÷ 100 barg
2 - CALIBRATION: 0 ÷ 40 barg
9 - DIAPHRAGM MATERIAL: SS AISI 316/316L GOLD PLATED
2 - OPTIONS: HOUSING MATERIAL STAINLESS STEEL WITH ELECTRICAL CONNECTIONS 2 x 1/2" NPT-F
1 - OPTIONS: MOUNTING BRACKET FOR 2" PIPE MOUNTING
4 - EXPLOSION PROTECTION 2014/34/EU: ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1G Ex ia IIC T6/T5/T4 Ga

to be coupled with:
1. MAN2-R6 TWO VALVES AND TWO WAYS MANIFOLD, MATERIAL SS AISI 316/316L, CONNECTION TO INSTRUMENT 1/2" NPT-F, PROCESS CONNECTION 1/2" NPT-F.

NOTES:
1. OVERALL ACCURACY OF PT (COMPREHENSIVE OF HYSTERESIS, NON-LINEARITY, REPEATABILITY) IS WITHIN +/- 0,07% FS;
2. ALL ITEMS ARE EQUIPPED WITH SS NAMEPLATE;
3. FILLING OF ELEMENT IS FORESEEN WITH DOW CORNING SILICONIC OIL;
4. ELECTRICAL CONNECTION ARE: 2 X 1/2" NPT-F (ONE PLUGGED);
5. INTEGRAL LCD /CONFIGURABLE ENGINEERING UNITS;
6. INGRESS PROTECTION EN 60529: IP66;
7. HOUSING MATERIAL STAINLESS STEEL;
8. ALL INSTRUMENT ARE SIL2/SIL3 CERTIFIED;
9. HART 6.

CERTIFICATES

1. ATEX Ex-d CERTIFICATE (2014/34/EU)
2. IP66 GRADE (EN/IEC 60529)
3. MATERIAL 3.1 (EN 10204) & HYDROTEST CERTIFICATES
4. CALIBRATION CERTIFICATES (IEC 60770)

REV	DATE	STATUS	PURPOSE OF ISSUE	PRE'D.	CHC'D.	APP'D.	AUTH'D.
03	18/JULY/24	FOURTH ISSUE	FOR CONSTRUCTION	M.Toni	G.Amoretti	G.Nicolini	S.Valletta
02	02/JULY/24	THIRD ISSUE	FOR CONSTRUCTION	M.Toni	G.Amoretti	G.Nicolini	S.Valletta
01	13/JUN/24	SECOND ISSUE	FOR CONSTRUCTION	M.Toni	G.Amoretti	G.Nicolini	S.Valletta
00	24/MAY/24	FIRST ISSUE	FOR APPROVAL	M.Toni	G.Amoretti	G.Nicolini	S.Valletta

CROSSWIND ROSETTI MARINO

P.O. No.: 24/01611/PO | Mod_CAR_Rev17-01 | SCALE – 1:2

TERRANOVA
SPRIANO Vulcanic MECFELA
TERRANOVA SRL

DRAWING TITLE: DIMENSIONAL DRAWINGS

JOB: 4718_OS | SHEET No. 4 OF 10 | REV. 03

GENERAL	1	Tag Number		25-PT-002	
	2	Service		H2 FROM ELECTR. (A-20000) TO H2 STORAGE VESSELS	
	3	P&ID Number	Location	123A90-DDL-PR-PID-80013	1"-HY-007-03HSS-N
	4	Function		PRESSURE MEASUREMENT	
	5	Mounting		DIRECT ON-LINE	
	6	Area Classification		ATEX Zone2 - IIC (IIB+H2) T1	
	7	Ambient Temperature		Min: -8.4 °C, Norm: 10.5 °C, Max: +25.0 °C.	
PROCESS CONDITIONS	8	Fluid		HYDROGEN	
	9	Pressure Des.	Oper. [barg]	40	4(Min.) / 30(Max)
	10	Temperature Des.	Oper. [°C]	-10 / 80	5(Min.) / 65(Max.)
	11	Oper. Spec. Gravity	Oper. Viscosity	-	-
	12	Flow Rate	Allowable Temp.	-	-
	13				
TRANSMITTER	14	Instrument Range Min.	Max.	0	100
	15	Calibration Range Min.	Max. [barg]	0	40
	16	Elevation	Suppresion	-	-
	17	Element Type		Diaphragm	
	18	Element Material		AISI 316/316L + Gold Plate (17)	
	19	Body Material	Body Rating	AISI 316/316L	200 bar
	20	Process Flanges Material		Integral 2 Way Manifold (22)	
	21	Wetted O-Rings Material		-	
	22	Fill Fluid		-	
	23	Bolts	Housing	Manifold/Instrument assembly	AISI 316/316L
	24	Paint		-	
	25	ATEX Certification	Ingress Protection	Atex Ex II 2G Ex db IIC T5	IP66
	26	Process Connection	Electrical Connection	1/2" NPT(F)	N. 2 M20x1.5mm
	27	Repeatability	Accuracy	-	0.07 % of Nominal Range
	28	SIL Certification	PED Certification	-	Required
DIAPHRAGM SEAL	29	Process Connection & Rating		-	
	30	Diaphragm Material	Housing Material	-	-
	31	Fill Fluid	Capillary Material	-	-
	32	Capillary Type	Capillary Length	-	-
	33	Flushing Connection		-	
	34				
OPTIONS	35	Integral Meter	Scale	Integral LCD Display	-
	36	Hydrostatic Testing	Cleaning	Required	-
	37	Mounting Brackets	Manifold Model No	Required	MAN2-R6
	38	Lightning Protection	Barrier Manuf./Model		-
COMMUNICATION AND SOFTWARE	39	Communication Type	Signal Type	HART 6	4-20mA Loop Powered 24 Vdc
	40	D D Revision	CFF Revision	-	-
	41	Device Tag	Hart Tag	-	-
	42	Internal Diagnostics	Capacitance	-	-
	43	Segment	Device Address	-	-
	44	Device Class	Simulate	-	-
	45	Nominal Current	Operating Voltage	-	-
	46				
PURCHASE	47	Manufacturer		TERRANOVA	
	48	Model		SST76-H-7-L-2-9-2-1-4 + MAN2-R6	
	49	Purchase Order Number		1724000979	

Notes:

No.	Date	By	Chkd	Appr	Description
02	06/12/2024	VBA	LCA	DLO	Accepted for Construcion (AFC)
01	29/08/2024	VBA	LCA	DLO	Accepted for Construcion (AFC)
00	16/01/2024	VBA	LCA	DLO	ISSUED FOR REVIEW (IFR)

INSTRUMENT DATASHEET

Pressure Transmitter

CROSSWIND

ROSETTI MARINO

Sheet 9 of 35

Code: 605 | Dwg. No.: 123A90-DDL-IN-DS-40039 Rev 02

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-PSV-055B	Safety Valve	LOWER DECK	1724000740	AST SpA	COITECH	24-03803	SLK	ATEX ZONE 2	Declaration of Conformity By COITECH SLKL-08HA74-015	Coitech EU - Type Examination Certificate	CE Ex - II 2 GD Ex h X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PT-001	Hyrogen to vessels inlet header	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240634	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-002	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240635	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-004	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240636	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PT-006	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240638	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-PT-008	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240640	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-PT-009	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240642	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-PT-011	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240644	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_2
25-PT-012	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240646	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-035	Vessel V-25001A pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240637	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PT-037	Vessel V-25001B pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240639	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-PT-040	Vessel V-25001C pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240641	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-PT-043	Vessel V-25001D pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240643	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-PT-046	Vessel V-25001E pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240645	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_2
25-PT-049	Vessel V-25001F pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240647	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240648	SST76-H-7-K-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PT-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240649	SST76-H-7-K-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PV-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400589	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PV-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400590	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-PV-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400591	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-PV-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400592	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-PV-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400593	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-PV-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400594	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-PV-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400595	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PV-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400596	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PY-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400589	CV-8407	II 2G	ATEX - SN 2400589	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PY-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400590	CV-8407	II 2G	ATEX - SN 2400590	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-PY-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400591	CV-8407	II 2G	ATEX - SN 2400591	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-PY-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400592	CV-8407	II 2G	ATEX - SN 2400592	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-PY-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400593	CV-8407	II 2G	ATEX - SN 2400593	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-PY-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400594	CV-8407	II 2G	ATEX - SN 2400594	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-PY-055A	Hydrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400595	CV-8407	II 2G	ATEX - SN 2400595	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PY-055B	Hydrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400596	CV-8407	II 2G	ATEX - SN 2400596	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SDV-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SDV-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SDY-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SDY-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-SV-031	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-SV-032	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-033	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-SV-034	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-SV-035	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-SV-036	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-037	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2

Technická inšpekcia, a.s.

Trnavská cesta 56, 821 01 Bratislava
Slovenská republika

[1] SUPPLEMENTARY EU-TYPE EXAMINATION CERTIFICATE

[2] Equipment or Protective System Intended for use in potentially explosive atmospheres
Directive 2014/34/EU

[3] Supplementary EU-Type Examination Certificate Number:

TI17ATEX 304 X / 1

[4] Product:

SPRIANO® Electronic transmitter series SST7X
Type: SST70, SST71, SST72, SST75, SST76, SST77B, SST77BL, SST79B and SST70-REM (Indicator)

[5] Manufacturer: **TERRANOVA S.r.l.**

[6] Address: **Via Gramsci, 1, 26827 – Terranova dei Passerini (LO), Italy**

[7] This supplementary certificate extends EU – Type Examination Certificate No. TI17ATEX 304 X to apply to products designed and constructed in accordance with the specification set out in the Schedule of the said certificate but having any variations specified in the Schedule attached to this certificate and the documents therein referred to.

[8] Technická inšpekcia, a.s., Notified Body Number 1354 in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that the product, as modified by this supplementary certificate, has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II to the Directive.

Technická inšpekcia, a.s.
Trnavská cesta 56
821 01 Bratislava, Slovakia
e-mail: tisr@tisr.sk
web: www.tisr.sk
Tel.: +421 2 49208 100

Bratislava, March 08th, 2021

Ing. Dušan Perniš
General Director

NB 1354

[13] **Schedule**

[14] **Supplementary EU-Type Examination Certificate Number: TI17ATEX 304 X / 1**

[15] Description of the variation to the product:

The subject of this supplementary certificate is extension of product SPRIANO® Electronic transmitter series SST7X, Type: SST70, SST71, SST72, SST75, SST76, SST77B, SST77BL, SST79B and SST70-REM (Indicator), which has protection mode "Ex-db" certified by certificate TI17ATEX304X, to the protection mode "Ex-ia" certified by certificate TI17ATEX305X.
Electronic inside the Series SST7X has been used the same as the SST5X described into TI17ATEX305X certificate.
Housing materials to be used Anticorodal Aluminum or Stainless Steel according previous certificates.
New Variation to the product are:

		With Aluminum housing	
		Without safety barrier	
Ex	II 1/2 G	Ex db IIC T6 Ga/Gb	-40°C<Tamb<+60°C
		Ex db IIB T5 Ga/Gb	-40°C<Tamb<+80°C
		or	
		With safety barrier	
Ex	II 1/2 G	Ex ia IIC T6, T5, T4 Ga	-40°C<Tamb<+40°C / +55°C / +80°C
		With SS AISI 316 housing	
		Without safety barrier	
Ex	II 1/2 G	Ex db IIC T6 Ga/Gb	-40°C<Tamb<+60°C
		Ex db IIB T5 Ga/Gb	-40°C<Tamb<+80°C
		or	
		With safety barrier	
Ex	II 1 G	Ex ia IIC T6, T5, T4 Ga	-40°C<Tamb<+40°C / +55°C / +80°C

Basic description of product:

The Transmitters series electronic SST7X measure pressure, level or temperature of liquids, gases and vapors and transmit a current signal 4-20mA + HART®.
According to the process connection, the series SST7X is constituted by the following models, they can be identified by the code following the series name:

SST70	Displacer level transmitter
SST71	Float level transmitter
SST72	Temperature transmitter
SST75	Relative or absolute pressure transmitter with incorporate separating diaphragm (ceramic)
SST76	Relative or absolute pressure transmitter with incorporate separating diaphragm (piezo)
SST77B	Differential pressure transmitter
SST77BL	Pressure transmitter for level measure
SST79B	Submersible level transmitter
SST70-REM	Field digital indicator

CSTA3-128

TERRANOVA® SPRIANO TELCOM MEC-RELA

G. Luca Mergazzoli
W
Director

Model SST70: The transmitter is isolated from the process via a mechanical system to the torsion tube and also the measuring cell presents a separation membrane filled with inert fluid.
Model SST71: The transmitter is isolated from the process via a tube containing reed switches.
Model SST72: The transmitter is isolated from the process via a tube containing sensors PT100.
Models SST75, SST76, SST77B and SST77BL: The transmitter is isolated from the process by membrane separation metal filled with inert fluid.
Model SST79 (version with remote sensor): The remote transmitter is isolated from the process by separation membranes metal filled with inert fluid. It is connected to the housing means shielded cable with 5 wires soldered.
Model SST70-REM (Loop powered field digital indicator): The indicator has no element part but only it is connected via current loop for displaying the desired variable.

Product with variation of Exdb protection:

The instruments are suitable for gas group IIC or IIB depending by the Ambient Temperature and they have the type of protection "Ex db".
Temperature: -40 ° C ≤Tamb≤ + 60 ° C (or -40 ° C ≤Tamb≤ + 80 ° C)
In the case where the process temperatures are higher than the maximum ambient temperature (or below the minimum ambient temperature), the instrument is installed with a suitable finned arm that can dissipate the temperature in excess and ensure the installation inside the ambient temperature range specified by the manufacturer.
The instruments are composed of two parts:
• The housing, the same for all models, which contains the electronic board and the electrical connections.
• The sensing element contained in a body of stainless steel that allows the process connection.
The housing is constituted by the body and by two closing covers (one of which is equipped with transparent windows). The metal parts can be made in Anticorodal Aluminum or Stainless Steel AISI 304 / 316 (Thickness of coating <0.15mm) while the door is tempered-glass glued to the lid with a silicone seal.

Electrical characteristics:

Supply voltage	≤ 30 VDC
Output signal	4 ÷ 20 mA + HART®
Maximum power transferred	0,75 W
ATEX category	II 1/2 G
Protection mode	Ex db IIC T6 Ga/Gb with Tamb [- 40°C, +60°C] Ex db IIB T5 Ga/Gb with Tamb [- 40°C, +80°C]
IP Code	IP 66
The power cables must be at least 22 AWG (0.34mm2 section section - 0.64mm2), suitable for an operating temperature ≥ 90 ° C for Tamb ≥ 70 ° C.	

The marking of the product shall include the following:

⟨Ex⟩ II 1/2 G Ex db IIC T6 Ga/Gb -40°C ≤ Tamb ≤ 60°C
Ex db IIB T5 Ga/Gb -40°C ≤ Tamb ≤ 80°C

Product with variation of Exia protection:

The instruments are suitable for gas group IIC and have the type of protection "Ex i".
The instruments are composed of two parts:
• The housing, the same for all models, which contains the electronic board and the electrical connections.
• The sensing element contained in a body of stainless steel that allows the process connection.
The housing is constituted by the body and by two closing covers (one of which is equipped with transparent windows). The metal parts can be made of stainless steel or aluminum having a content Mg of less than 6% (coating thickness <0.15mm) while the door can be static plastic, 5 mm thick (glue Araldite 2021) or sodalime tempered glass, 5 mm thick (glue Araldite 2011).

TERRANOVA
TECHNOVA INSPEKCIA • SLOVENSKÁ REPUBLIKA • TI NB 1354 -5-

Electrical characteristics:

Parameter	Tamb<60°C	Tamb<80°C
Maximum voltage input **Ui**	30 V	25.2 V
Maximum current input **Ii**	100 mA	100 mA
Power maximum input **Pi**	0.75 W	0.62 W
Maximum capacity Internal	10 nF	10 nF
Maximum Internal Inductance	0.2 mH	0.2 mH
Output signal	4 ÷ 20 mA + HART®	
Degree of protection	IP 66 for Aluminum housing IP67 for SS AISI 316 housing	

The marking of the product shall include the following:

II 1/2G Ex ia IIC T6, T5, T4 Ga/Gb **-40°C ≤ Tamb ≤ 40°C (T6)** **-40°C ≤ Tamb ≤ 55°C (T5)** **-40°C ≤ Tamb ≤ 80°C (T4)** **For Aluminum housing**	**1G Ex ia IIC T6, T5, T4 Ga** **-40°C ≤ Tamb ≤ 40°C (T6)** **-40°C ≤ Tamb ≤ 55°C (T5)** **-40°C ≤ Tamb ≤ 80°C (T4)** **For SS AISI 316 housing**

[16] Report Number:
Inspection report No: 54/5/2021
Final Test Report No: 54/5/2021

[17] Specific Conditions of Use:

Product with variation of Exdb protection:

Ambient temperature:
Ex db IIC T6 Ga/Gb -40°C ≤ Tamb ≤ 60°C
Ex db IIB T5 Ga/Gb -40°C ≤ Tamb ≤ 80°C
In the case where the process temperatures are higher than the maximum ambient temperature (or lower than the minimum ambient temperature), the equipment is installed with a suitable spacer (example: finned arm, syphon, capillary, remote head, etc.) capable of dissipating the excess temperature and ensure the installation inside the temperature range specified by the manufacturer.

Entries for flameproof enclosure:
The accessories used for cable entry into the housing (which must be treated ½ "NPT or M20x1.5) must comply with the standards EN 60079-0 and EN 60079-1.
The entrance hole leads not used should be closed with the cap conforms to EN 60079-1.

Warning marking:
- "WARNING – DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE IS PRESENT"

Informative marking:
- "SEE INSTALLATION INSTRUCTION DOCUMENT".

Product with variation of Exia protection:

Ambient temperature:

-40°C ÷ +40°C	For Class T6
-40°C ÷ +55°C	For Class T5
-40°C ÷ +80°C	For Class T4

In the case where the process temperatures are higher than the maximum ambient temperature (or lower than the minimum ambient temperature), the equipment is installed with a suitable

spacer (example: finned arm, syphon, capillary, remote head, etc.) capable of dissipating the excess temperature and ensure the installation inside the temperature range specified by the manufacturer.

[18] Essential Health and Safety Requirements:
The Essential Health and Safety Requirements (EHSRs) covered by the standards listed at item 9.
Additional information: None.

[19] Drawings and Documents:

Number	Sheet	Issue	Date	Description
DTP-SST7X	4pgs	REV No.21.02	12/02/2021	List of drawings and Documents SPRIANO ® Electronic Switches SST7X By TERRANOVA ®
TI17ATEX305X	3 pgs	-	13/03/2017	EU –Type Examination Certificate (Exia)

Technická inšpekcia, a.s.
Trnavskácesta 56
821 01 Bratislava, Slovakia
e-mail: tisr@tisr.sk
web: www.tisr.sk
Tel.: +421 2 49208 100

TECHNICKÁ INŠPEKCIA • SLOVENSKÁ REPUBLIKA • TI NB 1354 -5-

Bratislava, March 08th, 2021

Ing. Dušan Perniš
General Director

TERRANOVA® SPRIANO Tylcom MEC-RELA

G. Luca Vergazzoli
W
...E...ctor

TECHNICKÁ INŠPEKCIA, a.s.

SLOVENSKÁ REPUBLIKA

CEOC INTERNATIONAL

[1] EU-TYPE EXAMINATION CERTIFICATE

[2] Equipment or Protective System Intended for use in potentially explosive atmospheres
Directive 2014/34/EU

[3] EU-Type Examination Certificate Number:

TI17ATEX 304 X

[4] Product:

SPRIANO® Electronic transmitter series SST7X
Type: SST70, SST71, SST72, SST75, SST76, SST77B, SST77BL, SST79B and SST70-REM (Indicator)

[5] Manufacturer: **TERRANOVA S.r.l.**

[6] Address: **Via Gramsci, 1, 26827 – Terranova dei Passerini (LO), Italy**

[7] This product and any acceptable variation thereto is specified in the schedule to this certificate and the documents therein referred to.

[8] Technická inšpekcia, a.s., Notified Body Number 1354 in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this product has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of product intended for use in potentially explosive atmospheres given in Annex II to the Directive.
The examination and test results are recorded in confidential report No. 304/5/2017.

[9] Compliance with the Essential Health and safety Requirements has been assured by compliance with: **EN 60079-0:2012+A11:2013, EN 60079-1:2014**
except in respect of those requirements listed at item 18 of the Schedule.

[10] If the sign "X" is placed after the certificate number, it indicate that the product is subject to the Specific conditions of Use specified in the schedule to this certificate.

[11] This EU-TYPE EXAMINATION CERTIFICATE relates only to the design and construction of the specified product. Further requirements of this Directive apply to the manufacturing process and supply of this product.

[12] The marking of the product shall include the following:

Ex II 1/2 G Ex db IIC T6 Ga/Gb -40°C ≤ Tamb ≤ 60°C
Ex db IIB T5 Ga/Gb -40°C ≤ Tamb ≤ 80°C

Technická inšpekcia, a.s.
Trnavská cesta 56
821 01 Bratislava, Slovakia
e-mail: tisr@tisr.sk
web: www.tisr.sk
Tel.: +421 2 49208 100

Bratislava, March 13th, 2017

Ing. Dušan Perniš
General Director

TECHNICKÁ INŠPEKCIA • SLOVENSKÁ REPUBLIKA • TI NB 1354 - 5 -

333123

CSTA3-128

NB 1354

[13] **Schedule**

[14] **EU-Type Examination Certificate Number: TI17ATEX 304 X**

[15] Description of product:
The Transmitters series electronic SST7X measure pressure, level or temperature of liquids, gases and vapors and transmit a current signal 4-20mA.
The instruments are suitable for gas group IIC and have the type of protection "Ex db".
Temperature: -40 ° C ≤Tambs≤ + 60 ° C (or -40 ° C ≤Tambs≤ + 80 ° C)
In the case where the process temperatures are higher than the maximum ambient temperature (or below the minimum ambient temperature), the appliance is installed with a suitable spacer can dissipate the temperature in excess and ensure the installation inside the ambient temperature range specified by the manufacturer.
The instruments are composed of two parts:
• The housing, the same for all models, which contains the electronic board and the electrical connections.
• The sensing element contained in a bodice of stainless steel that allows the process connection.
The housing is constituted by the body and by two closing covers (one of which is equipped with transparent windows). The metal parts can be made in anticorodal aluminum or stainless steel AISI 304 (Thickness of coating <0.15mm) while the door is tempered-glass glued to the lid with a silicone seal.

According to the process connection, the series SST7 is formed by the following models, they can be identified by the code following the series name:

SST70	Displacer level transmitter
SST71	Float level transmitter
SST72	Temperature transmitter
SST75	Relative or absolute pressure transmitter with incorporate separating diaphragm (ceramic)
SST76	Relative or absolute pressure transmitter with incorporate separating diaphragm (piezo)
SST77B	Differential pressure transmitter
SST77BL	Pressure transmitter for level measure
SST79B	Submersible level transmitter
SST70-REM	Field digital indicator

Model SST70: The transmitter is isolated from the process via a mechanical system to the torsion tube and also the measuring cell presents a separation membrane filled with inert fluid.

Model SST71: The transmitter is isolated from the process via a tube containing reed switches.

Model SST72: The transmitter is isolated from the process via a tube containing sensors PT100.

Models SST75, SST76, SST77B and SST77BL: The transmitter is isolated from the process by membrane separation metal filled with inert fluid.

Model SST79 (version with remote sensor): The remote transmitter is isolated from the process by separation membranes metal filled with inert fluid. It is connected to the housing means shielded cable with 5 wires soldered.

Model SST70-REM (Loop powered field digital indicator): The indicator has no element part but only it is connected via current loop for displaying the desired variable.

Electrical characteristics:

Supply voltage	≤ 30 VDC
Output signal	4 ÷ 20 mA
Maximum power transferred	0,75 W
ATEX category	1/2 G
Protection mode	Ex db IIC T6 Ga/Gb with Tamb [- 40°C, +60°C] Ex db IIB T5 Ga/Gb with Tamb [- 40°C, +80°C]
IP Code	IP 66
The power cables must be at least 22 AWG (0.34mm2 section section - 0.64mm2), suitable for an operating temperature ≥ 90 ° C for Tamb ≥ 70 ° C.	

[16] Report Number:
Inspection report No: 304/5/2017
Final Test Report No: 304/5/2017

[17] Specific Conditions of Use:

Ambient temperature:

Ex db IIC T6 Ga/Gb	-40°C ≤ Tamb ≤ 60°C
Ex db IIB T5 Ga/Gb	-40°C ≤ Tamb ≤ 80°C

In the case where the process temperatures are higher than the maximum ambient temperature (or lower than the minimum ambient temperature), the equipment is installed with a suitable spacer (example: finned arm, syphon, capillary, remote head, etc.) capable of dissipating the excess temperature and ensure the installation inside the temperature range specified by the manufacturer.

Entries for flameproof enclosure:
The accessories used for cable entry into the housing (which must be treated ½ "NPT) must comply with the standards EN 60079-0 and EN 60079-1.
The entrance hole leads not used should be closed with the cap conforms to EN 60079-1.

Warning marking:
- "WARNING – DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE IS PRESENT"

Informative marking:
- "SEE INSTALLATION INSTRUCTION DOCUMENT".

[18] Essential Health and Safety Requirements:
The Essential Health and Safety Requirements (EHSRs) covered by the standards listed at item 9.
Additional information: None.

[19] Drawings and Documents:

Number	Sheet	Issue	Date	Description
DTP-SST7X	3pgs	REV No.17.01	31/01/2017	List of drawings and Documents SPRIANO® Electronic Switches SST7X

Technická inšpekcia, a.s.
Trnavskácesta 56
821 01 Bratislava, Slovakia
e-mail: tisr@tisr.sk
web: www.tisr.sk
Tel.: +421 2 49208 100

TECHNICKÁ INŠPEKCIA · SLOVENSKÁ REPUBLIKA · TI NB 1354 - 5 -


Bratislava, March 13th, 2017

Ing. Dušan Perniš
General Director


CSTA3-128

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

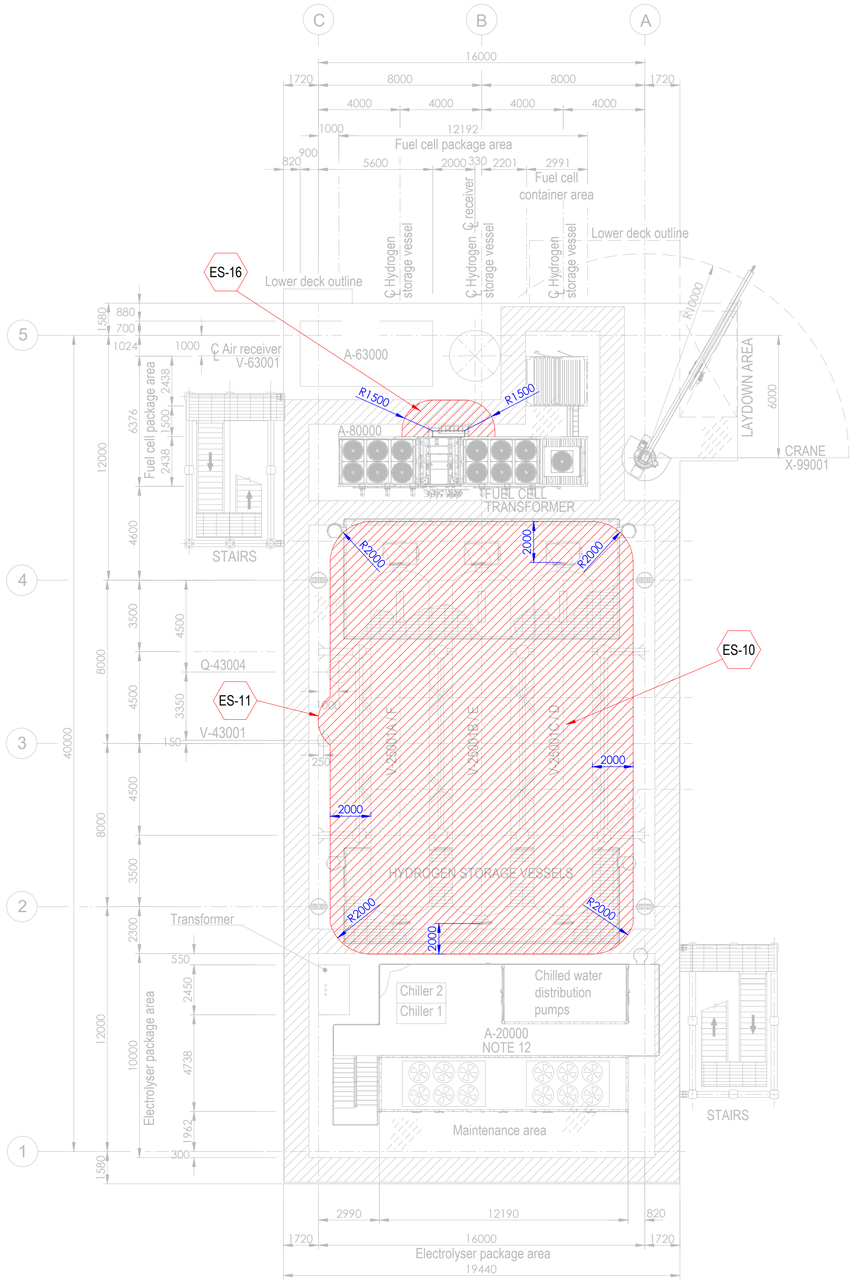


PLAN ON UPPER DECK
EL+30.310 T.O.S.

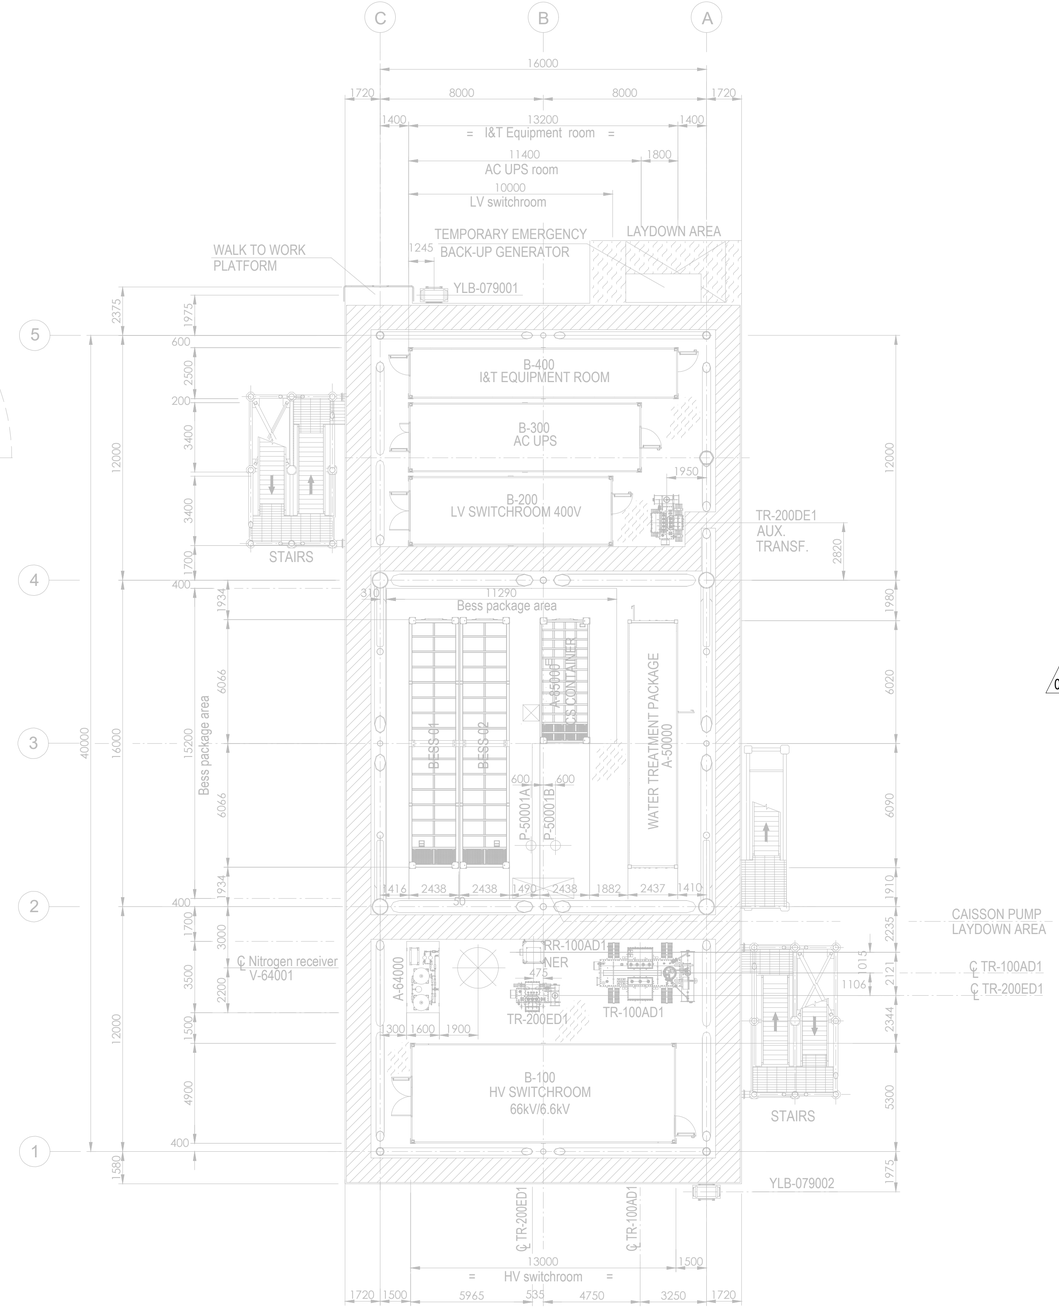

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

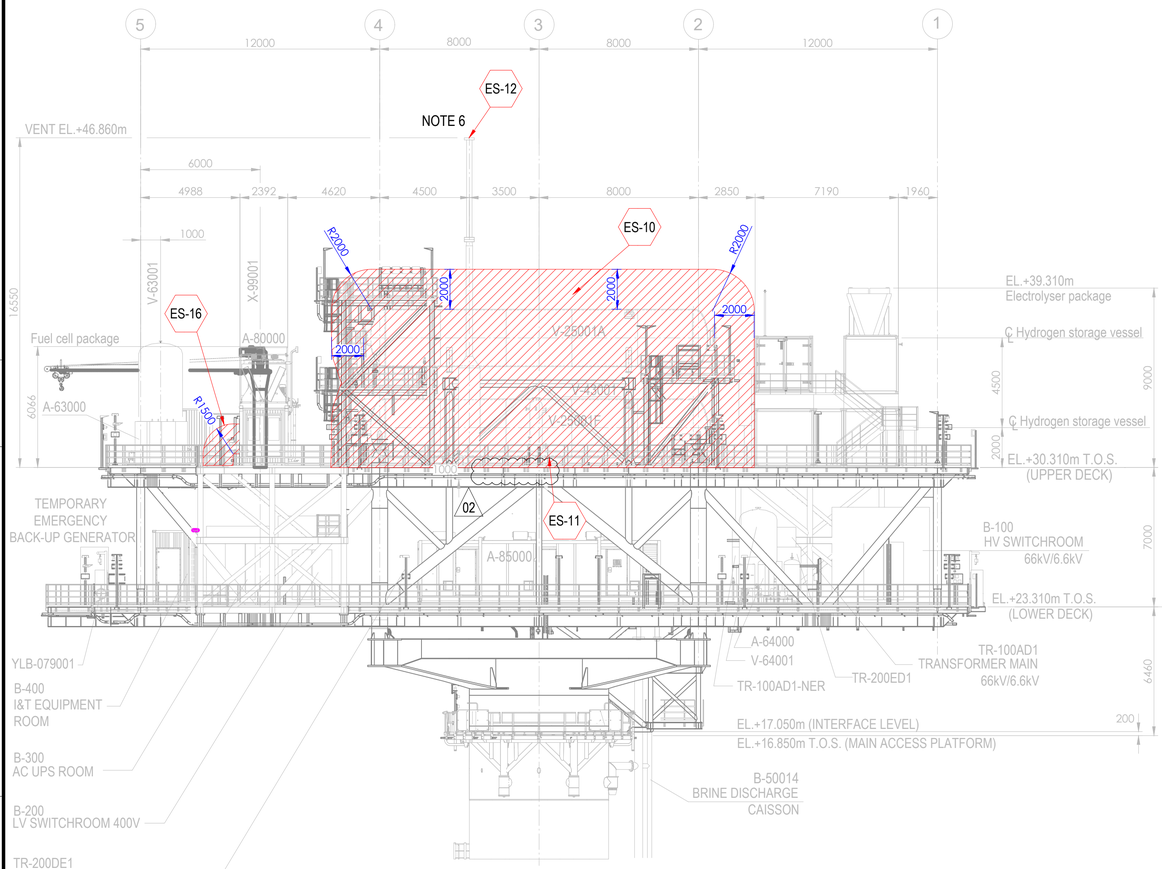



ELEVATION LOOKING EAST

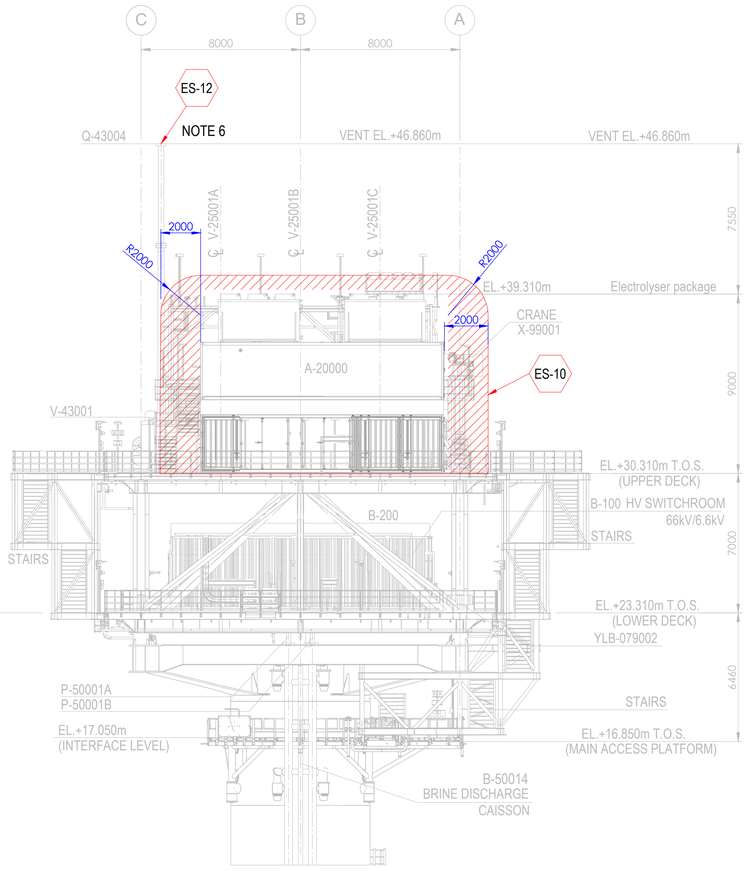

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

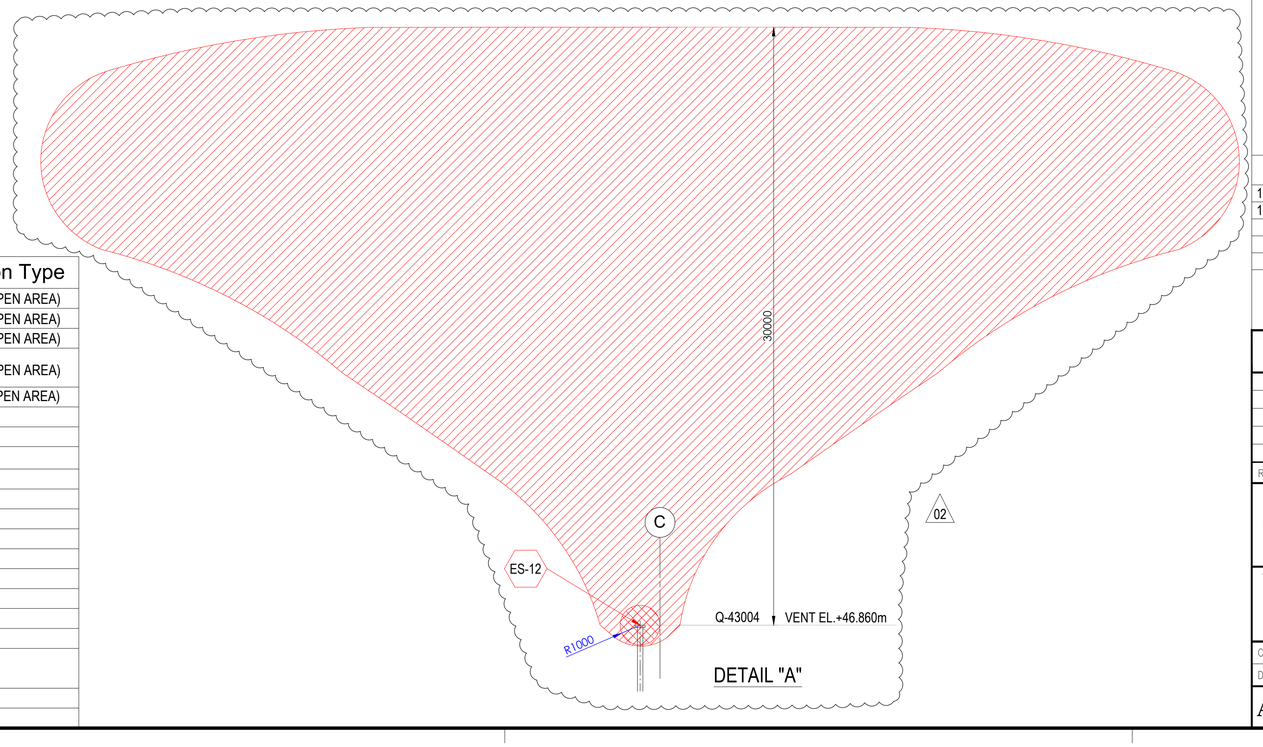



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-SDV-001	: On/Off Valve - Hyrogen to Vessels Inlet Header Shut-Down	Dwg	123A90-DDL-PR-PID-80013		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001588	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		AF770300801			
Manufacturer	Rotork			**Model**		CP/S-035-080A/AA			
Cert No.	Declaration of Conformity by Manufacturer			**Equipment Ambient Temp.**		-20 °C + 40°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T5	**IP Rating**	IP66/IP67

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-SDV-001	: On/Off Valve - Hyrogen to Vessels Inlet Header Shut-Down			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001588		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-SDV-001	: On/Off Valve - Hyrogen to Vessels Inlet Header Shut-Down	Dwg	123A90-DDL-PR-PID-80013		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001588	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks					
67	All Terminals are Ex n certified (if required on certificate)	x	NA		
68	Hermetically sealed and enclosed break devices are undamaged	x	NA		
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA		
70	Test port, if fitted, is functional (type “nR” only)	x	NA		
71	Breathing operation is satisfactory (type “nR” only)	x	NA		
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA		
73	The ventilation airflow is not impeded	x	NA		
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA		
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA		
76	Variable voltage/frequency installation complies with documentation	x	NA		
Extra Ex p checks					
77	Pressurization gas is correct type	x	NA		
78	Actual pressure is within maximum and minimum settings for equipment	x	NA		
79	Timers set as per certification documentation	x	NA		
80	Alarms and trip functions operate correctly as per certification documentation	x	NA		
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA		
82	Automatic electrical protective devices operate within permitted limits	x	NA		
83	Automatic electrical protective devices are set correctly	x	NA		
84	Protective gas inlet temperature is below maximum specified	x	NA		
85	Ducts, pipes and enclosures are in good condition	x	NA		
86	Protective gas is substantially free from contaminants	x	NA		
87	Protective gas pressure and/or flow is adequate	x	NA		
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA		
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA		
90	Specific conditions of use (if applicable) are complied with		NA		
Extra Ex i (Intrinsically Safe – IS) checks					
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA		
92	Cables are installed in accordance with the documentation	x	NA		
93	Segregation is maintained between IS and non-IS Circuits	x	NA		
94	Cable screens are isolated at one end (field side)	x	NA		
95	Cable screens are earthed in accordance with the documentation	x	NA		
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA		
97	Equipment installed is the one specified in the documentation	x	NA		
98	Ambient temperature range of the apparatus is correct for the installation	x	NA		
99	Service temperature range of the apparatus is correct for the installation	x	NA		
100	Installation is clearly labelled	x	NA		
101	Printed circuit boards are clean and undamaged	x	NA		
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA		
103	Point-to-point connections are all correct	x	NA		
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA		
105	Earth connections maintain the integrity of the type of protection	x	NA		
106	Intrinsically safe circuit earthing is satisfactory	x	NA		
107	Insulation resistance is satisfactory	x	NA		
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA		

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-25	2025-01-31	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-25T13:51:46.388Z	PROVERLIS Digitaly signed by Luca Mussi 2025-01-31T10:02:32.940Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

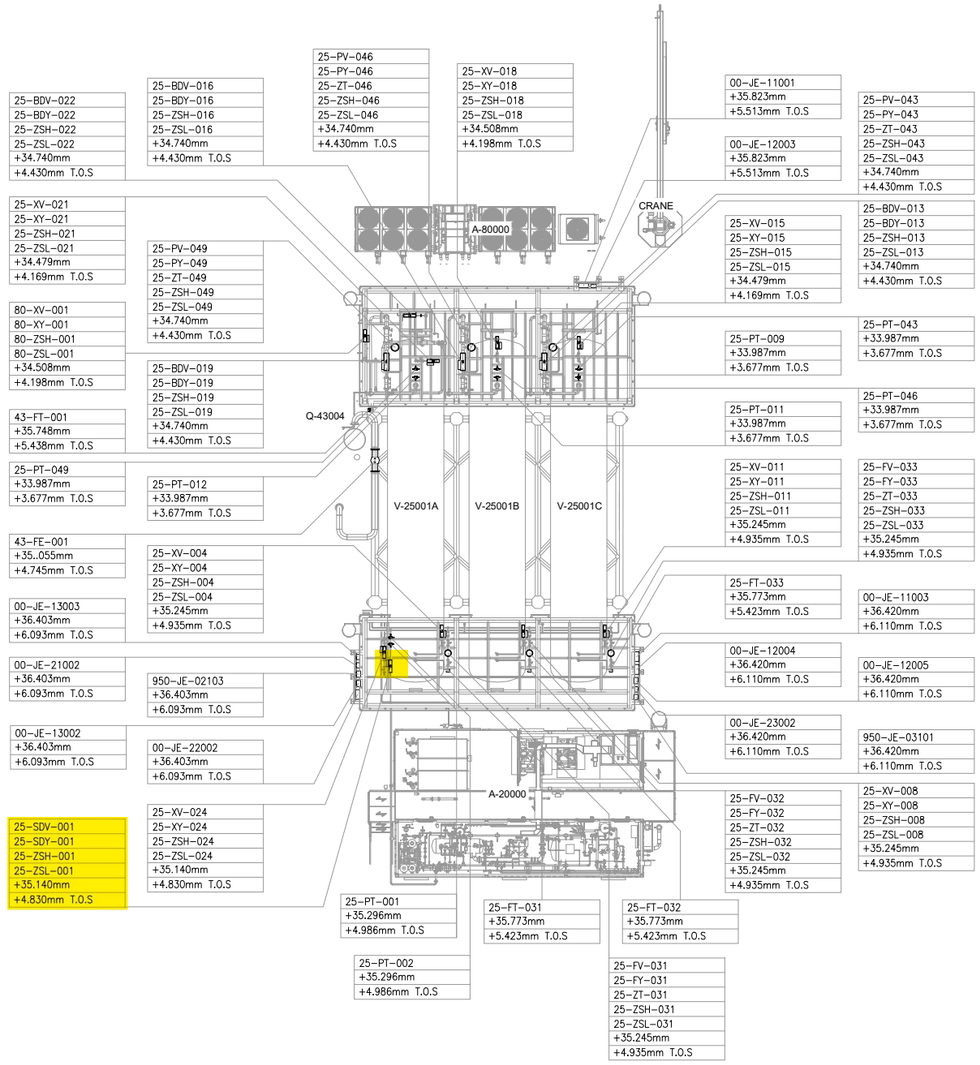

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :


BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING_NO.

REV.

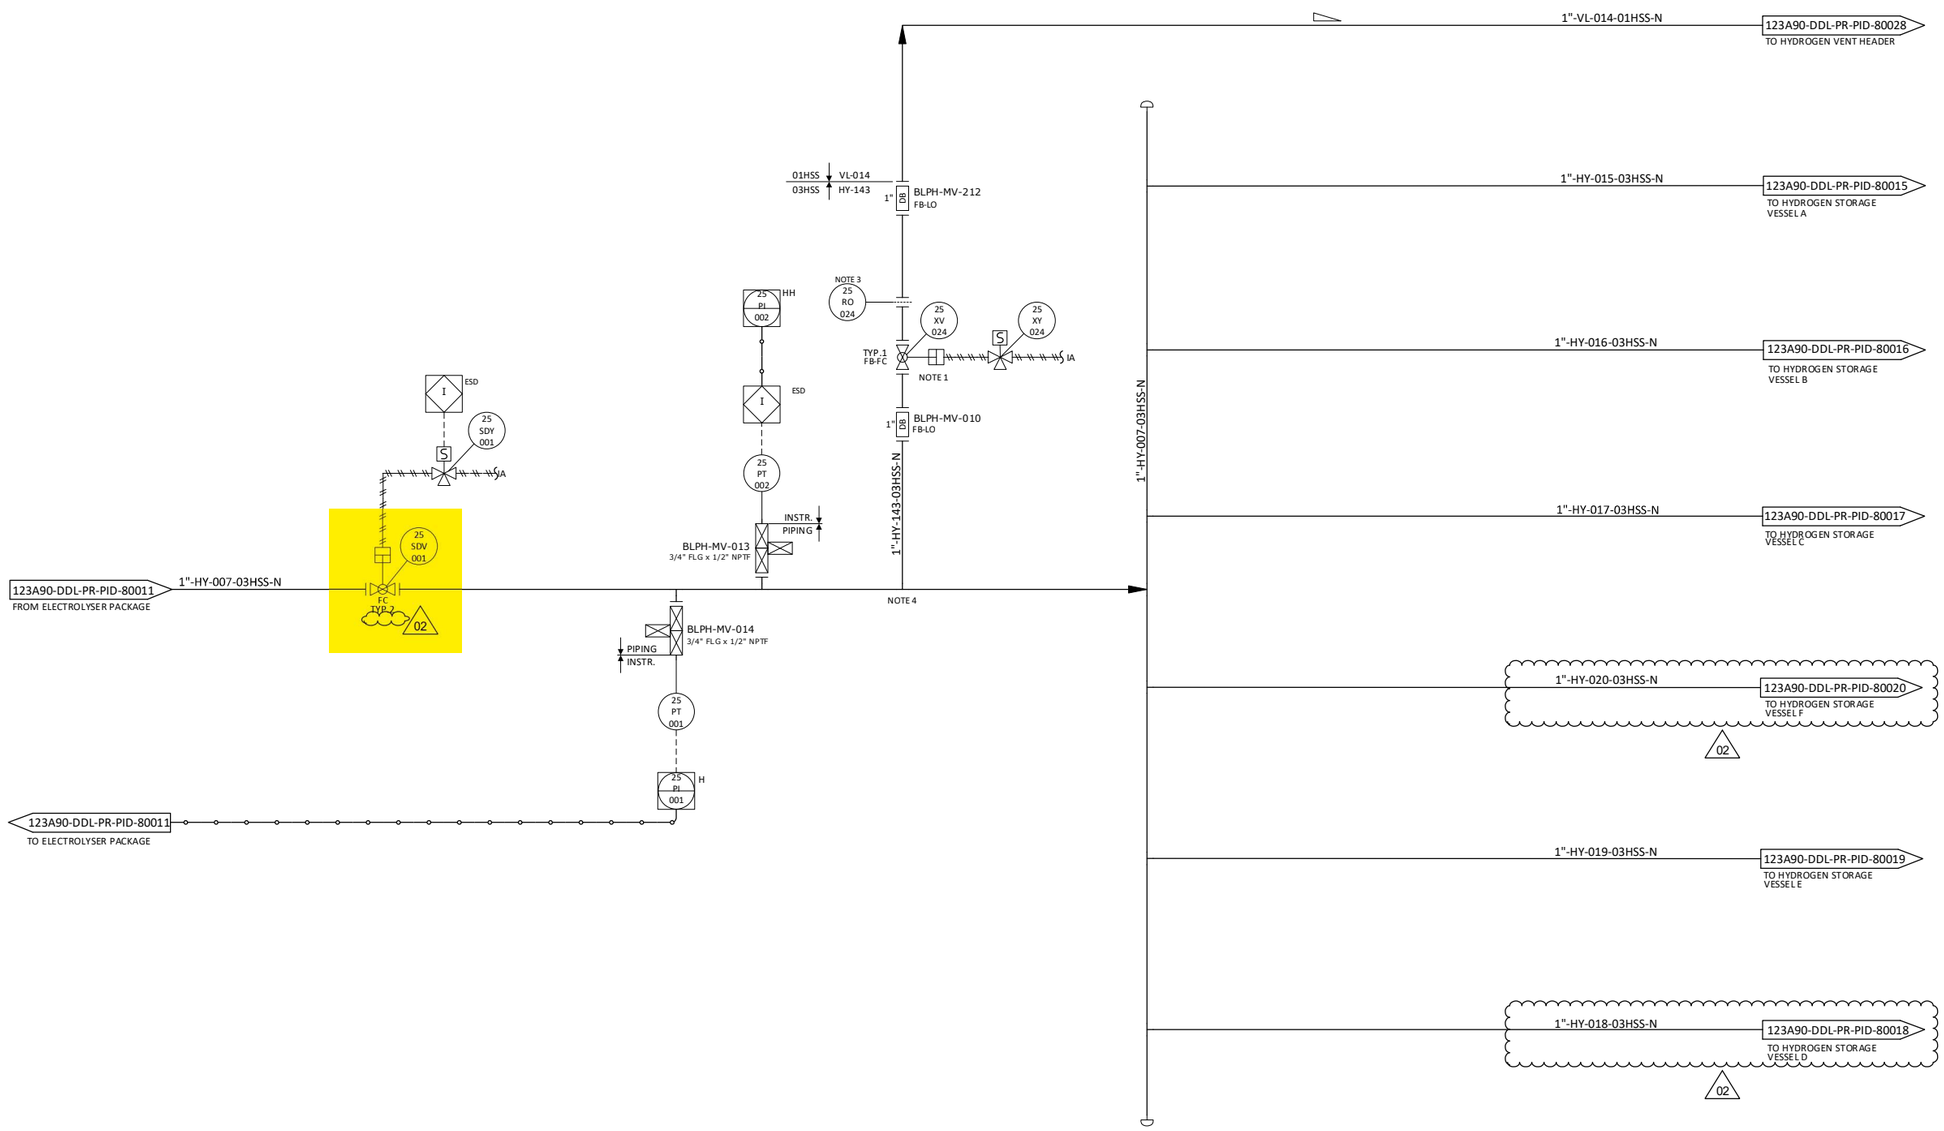

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSELS HEADER (INLET)

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO.	SHEET	REV.
	123A90-DDL-PR-PID-80013	001	02


File Name : FILE_NAME

DRAWING NO.


REV. 00

TYPICAL INSTRUMENTATION VALVE

TYP.1 (XV - ON OFF VALVES)

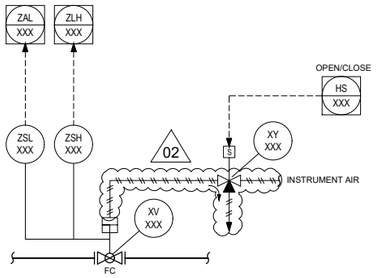


TYP.2 (SDV - SAFETY NO CRITICAL VALVES)

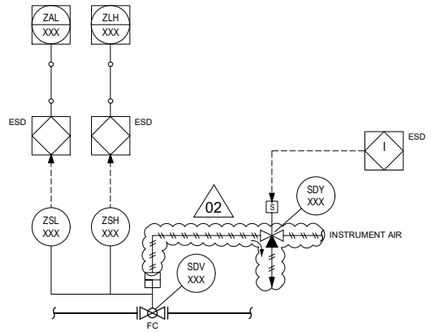


02

TYP.4 (BDV - SAFETY NO CRITICAL VALVES)

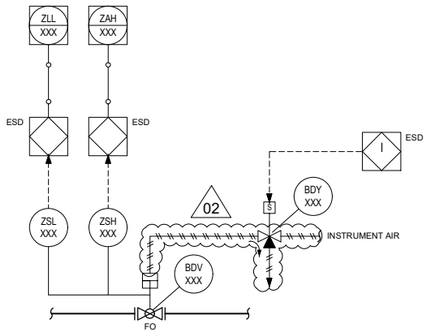

02

TYP.6 (CONTROL VALVES - CRITICAL)

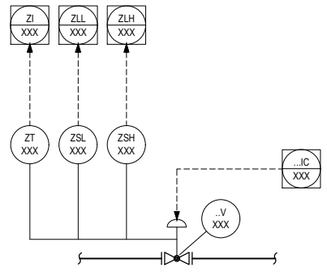


INSTRUMENT SYMBOLOGY DEFINITION

MEANINGS OF IDENTIFICATION LETTERS
THIS TABLE APPLIES TO THE FUNCTIONAL IDENTIFICATION OF INSTRUMENTS

	FIRST- LETTER		SUCCEEDING-LETTER		
	MEASURED OR INITIATING VARIABLE	MODIFIER	READOUT OR PASSIVE FUNCTION	OUTPUT FUNCTION	MODIFIER
A	ANALYSIS		ALARM		
C				CONTROL	
E			SENSOR (PRIMARY ELEMENT) ELEMENT		
F	FLOW RATE	RATIO (FRACTION)			
G			GLASS VIEWING DEVICE		
H	HAND				HIGH
I			INDICATE		
L	LEVEL				LOW
O			ORIFICE, OPEN		
P	PRESSURE, VACUUM				
R		RELIEF			
S		SAFETY		SWITCH	
T	TEMPERATURE			TRANSMIT	
V				VALVE, DAMPER, LOUVER	
X	UNCLASSIFIED				
Y				AUXILIARY DEVICES	
Z	POSITION DIMENSION				

NOTE: FOR FURTHER EXPLANATORY NOTES, REFER TO ANSI/ISA-5.1

TYP.7 (CONTROL VALVES - NOT CRITICAL)



NOTES

1. FOR GENERAL NOTES AND PIPING SYMBOLOGY SEE DRAWINGS: 123A90-DDL-PR-PID-80009 AND 123A90-DDL-PR-PID-80010.
2. DELETED.

HOLDS

1 DELETED 02

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)


CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
INSTRUMENTATION SYMBOLOGY

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80042	SHEET 001	REV. 02

File Name :

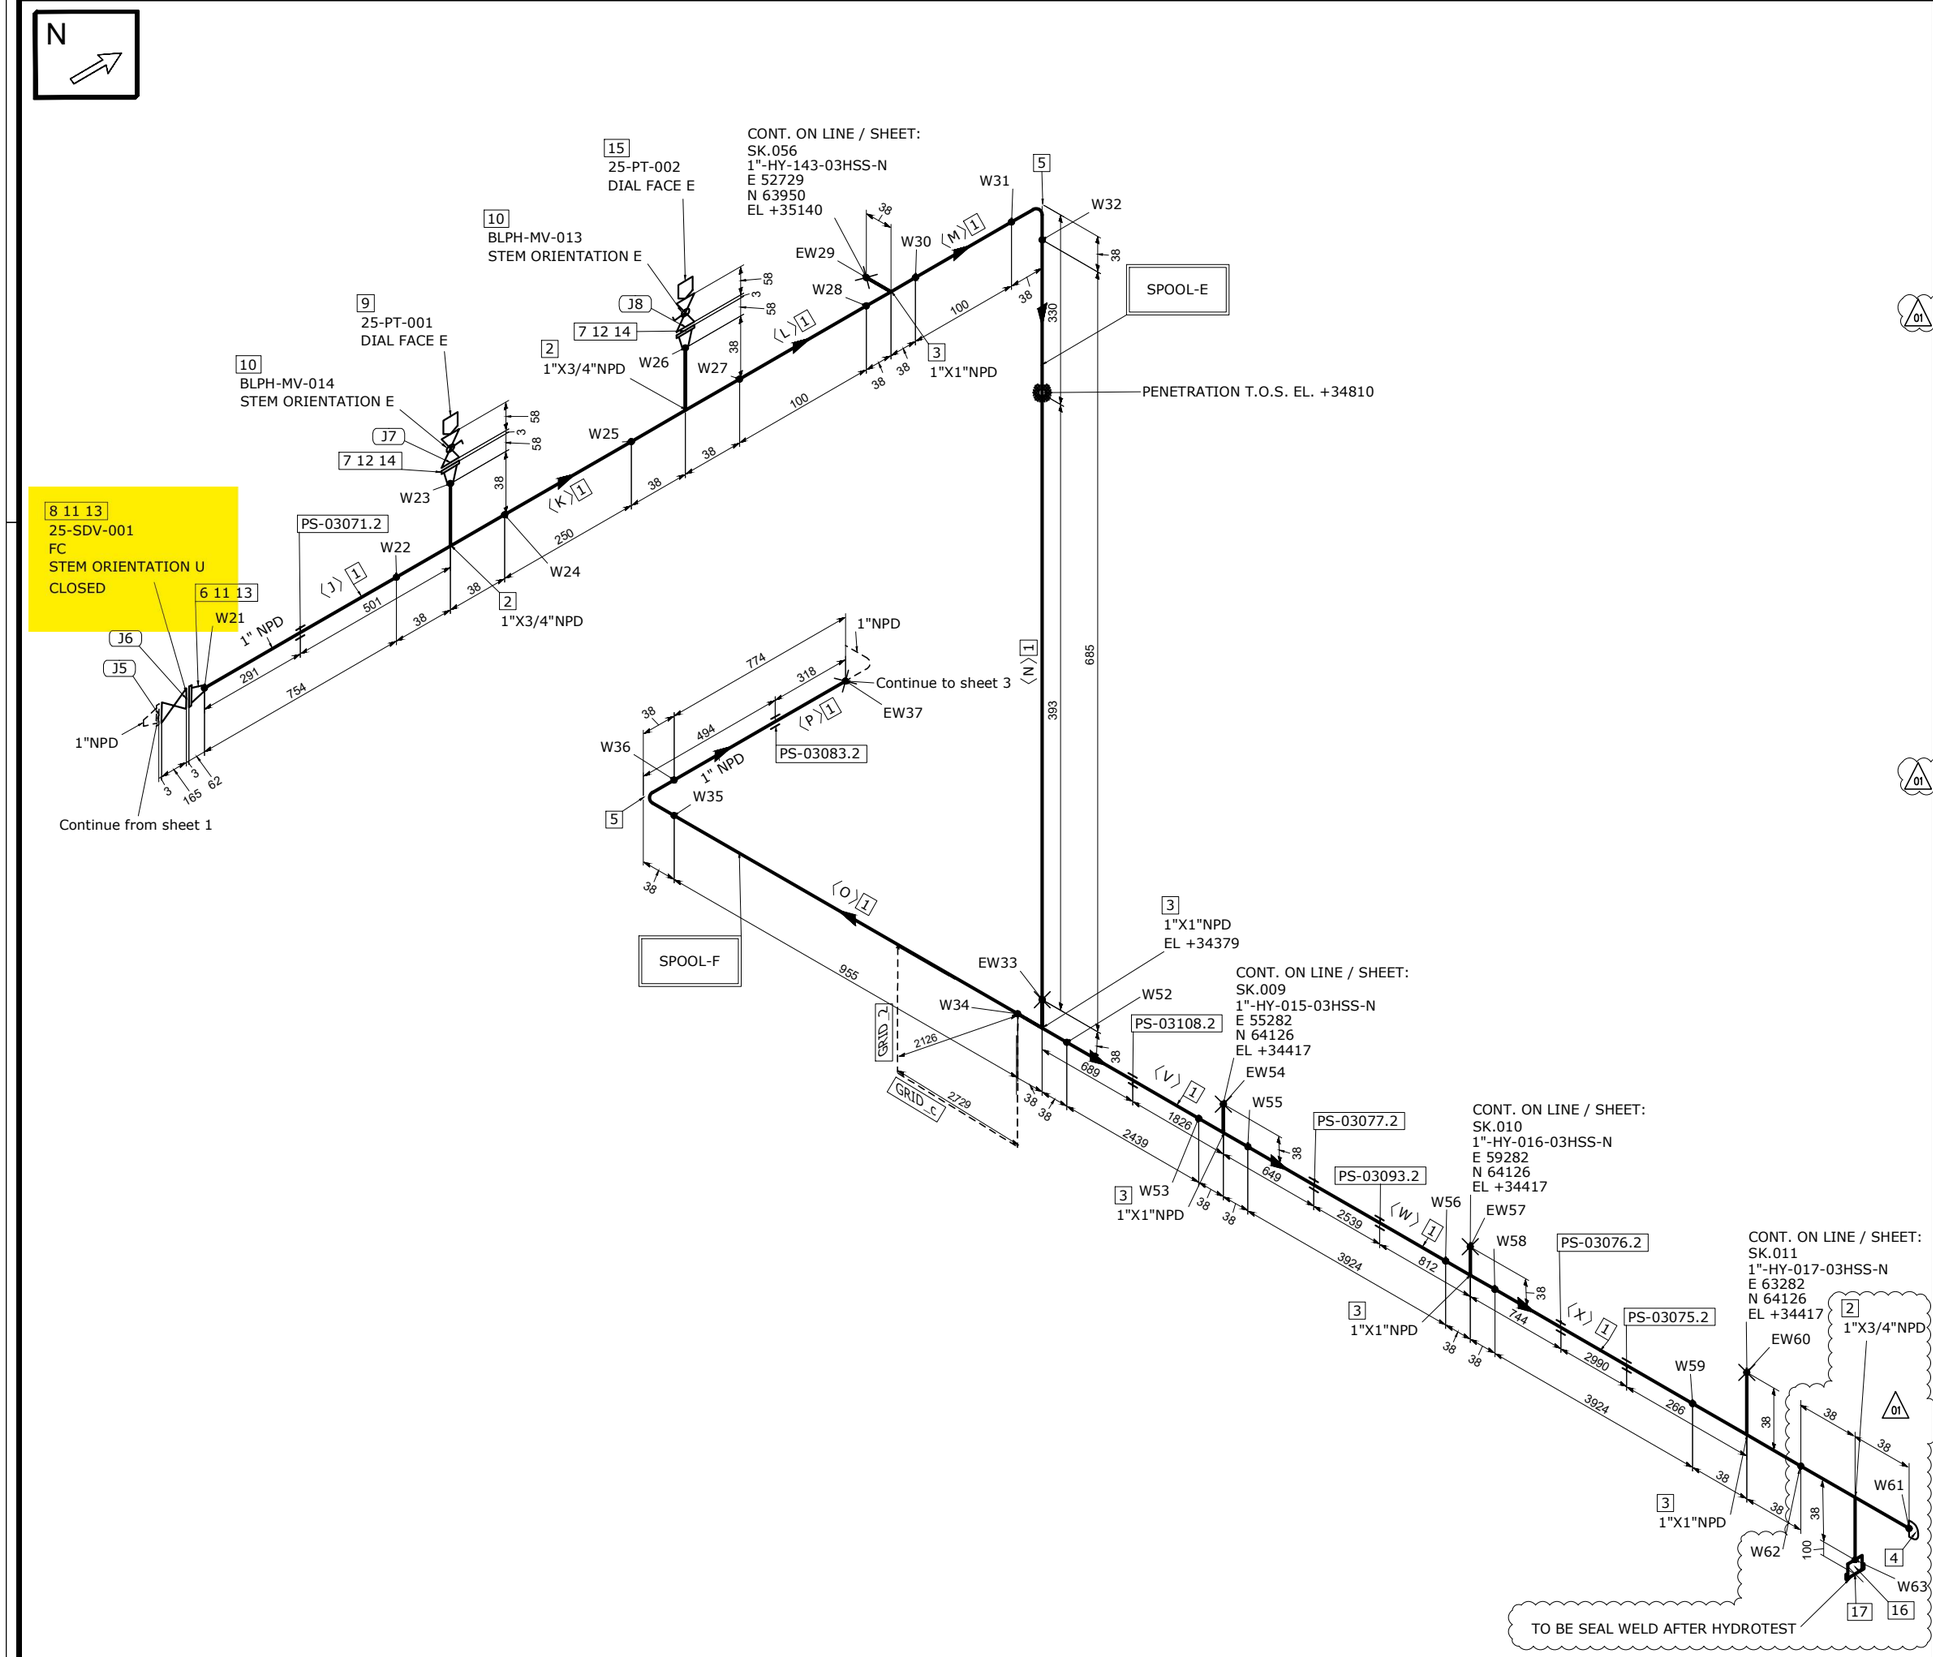

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	13.9M	35.3
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	3 (01)	1.0
3	1X1	TEE0SS00550100	Tee ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	5	1.7
4	1	CAP0SS01030100	Cap ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
5	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	2	0.3
6	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8
7	3/4	FLW0SS01033Q00	Flange WN ASME B16.5 300LB RF 2,87 FRG ASTM A182 Gr.F316/316L	2	2.8
(01) 16	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1/2		Pressure Transmitter - Online	1	0.0
10	3/4X1/2	VLBMNN00013Q0H	Monoflange Double Block & Bleed Valve API 6D FLG x THRD-F NPT 300LB RF MD03C02YH	2	11.6
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	2	0.1
12	3/4	GSW0GK11203Q00	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	2	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	8	1.8
14	5/8	SB20BO07540300	75 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	8	1.8
15	1/2		Pressure Transmitter - Online	1	0.0
(01) 17	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2

FABRICATION WEIGHT [kg]		43.2
ERECTION WEIGHT [kg]	(01)	56.6
OVERALL WEIGHT [kg]		99.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W21	1	BW
W22	1	BW
W23	3/4	BW
W24	1	BW
W25	1	BW
W26	3/4	BW
W27	1	BW
W28	1	BW
EW29	1	BW
W30	1	BW
W31	1	BW
W32	1	BW
EW33	1	BW
W34	1	BW
W35	1	BW
W36	1	BW
EW37	1	BW
W52	1	BW
W53	1	BW
EW54	1	BW
W55	1	BW
W56	1	BW
EW57	1	BW
W58	1	BW
W59	1	BW
EW60	1	BW
W61	1	BW
W62	1	BW
W63	3/4	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
J	1	754	BEVEL	BEVEL
K	1	250	BEVEL	BEVEL
L	1	100	BEVEL	BEVEL
M	1	100	BEVEL	BEVEL
N	1	685	BEVEL	BEVEL
O	1	956	BEVEL	BEVEL
P	1	774	BEVEL	BEVEL
V	1	2439	BEVEL	BEVEL
W	1	3924	BEVEL	BEVEL
X	1	3924	BEVEL	BEVEL

SUPPORT LIST

PS-03071.2
PS-03083.2
PS-03108.2
PS-03077.2
PS-03093.2
PS-03076.2
PS-03075.2

SPOOL	WELD [inches]	WEIGHT [kg]
E	10.5	10.6
F	11.75	32.6
		(01)
MONT	6	56.6

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	03-09-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-007-03HSS-N

SK.005

CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	N/A
DRAWN	STAFF SRL	CHECKED	RT	APPROVED	LM
DATE	17-09-2024				
FORMAT	A3	DRAWING NO.	123A90-FDL-PP-DI-00005	SHEET / OF	2/3
REV.	01				

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II			
PAINTING	SYSTEM 6A	BASE RAL RAL-9002	FLUID PHASE	Gas			
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]		
HEAT TRACING	N/A		TEST	PRESS. 60 [barg]	TEMP. AMB.	MEDIUM Water	


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80011
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

MASTER

E33

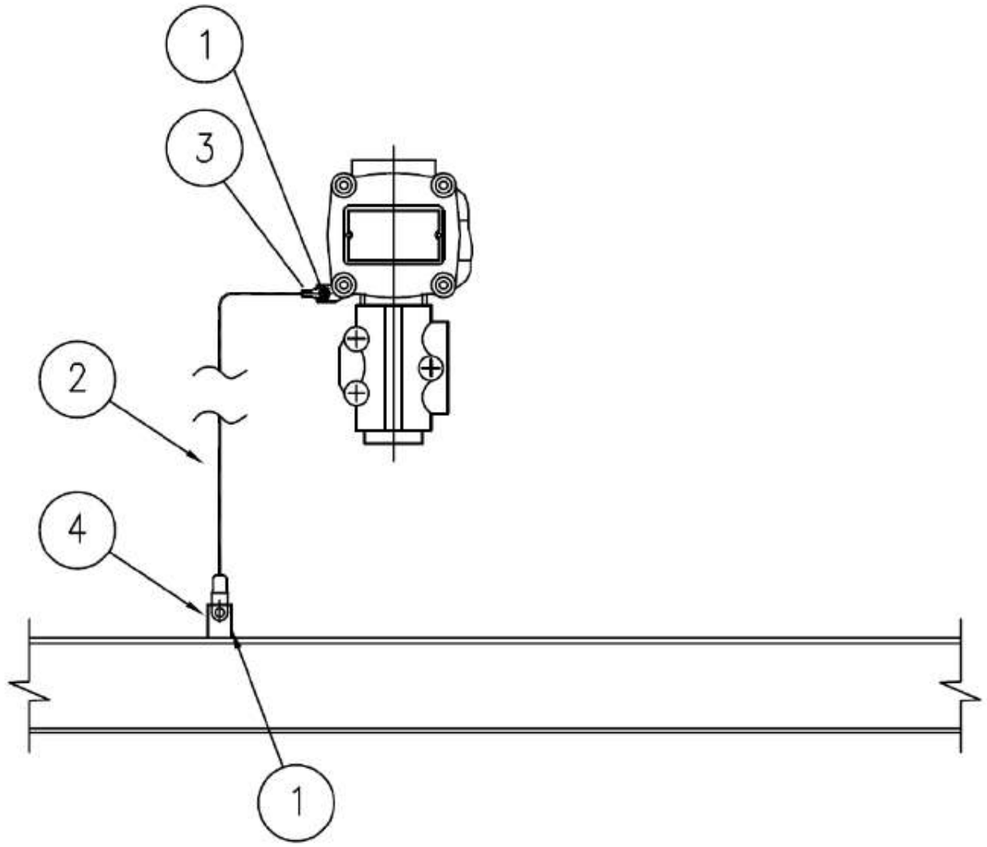

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS

A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG


CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Pneumatic Hook-Ups	Sh. 6 of 6 Date: 08/07/2024 Rev. 01

PNEUMATIC HOOK-UP FOR ON-OFF VALVES

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40078**

REV.:	DATE:	SIGNATURE:
1_B	06/11/24	G.Randi

ROSETTI MARINO SpA

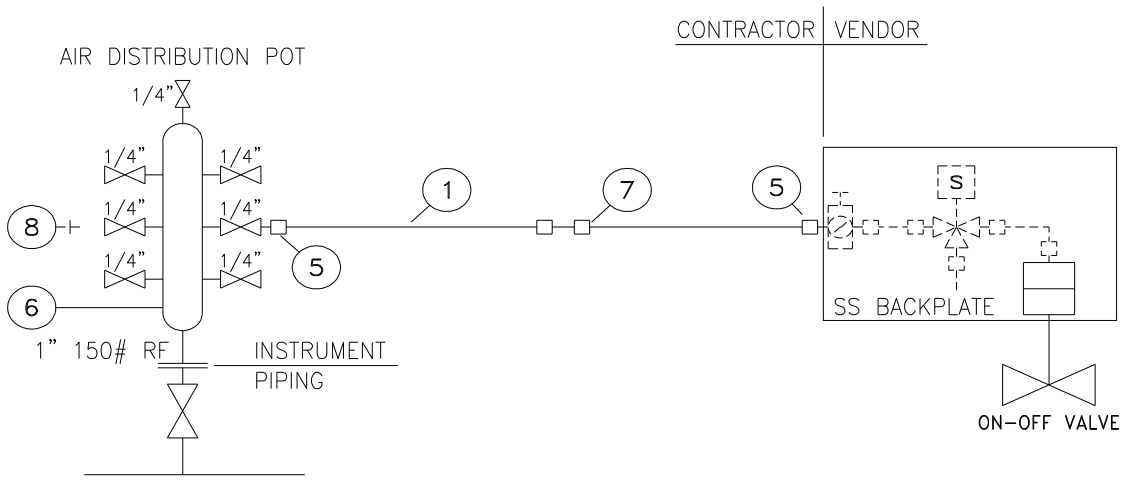

INSTRUMENT TAG	
1	25-BDV-022
2	25-BDV-005
3	25-BDV-007
4	25-BDV-010
5	25-BDV-013
6	25-BDV-016
7	25-BDV-019
8	25-SDV-001
9	25-SDV-023
10	25-XV-004
11	25-XV-006
12	25-XV-008
13	25-XV-009
14	25-XV-011
15	25-XV-012
16	25-XV-014
17	25-XV-015
18	25-XV-017
19	25-XV-018
20	25-XV-020
21	25-XV-021
22	25-XV-024
23	50-XV-001
24	50-XV-002
25	50-XV-003
26	50-XV-004
27	80-XV-001
28	64-SDV-001
29	50-XV-005
30	


NOTE:
(1) For Air Distribution Pot quantities see material take-off on sh. 4

POS.	NORM/STD CODE	DESCRIPTION	SIZE/CONNECTION TYPE	Q.TY
8		SS316 PLUG	1/4" NPT	Note 1
7		SS316 UNION	1/2" O.D. x 1/2" O.D.	N. 1
6		SS316 AIR DISTRIBUTION POT	1" 150#RF - N. 7 1/4" BALL VALVES	Note 1
5		SS316 MALE CONNECTOR	1/4" NPT x 1/2" O.D.	N. 2
1		SS 316L TUBING	1/2" x 0,049"Thk	10 m

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 16 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR SDV/BDV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

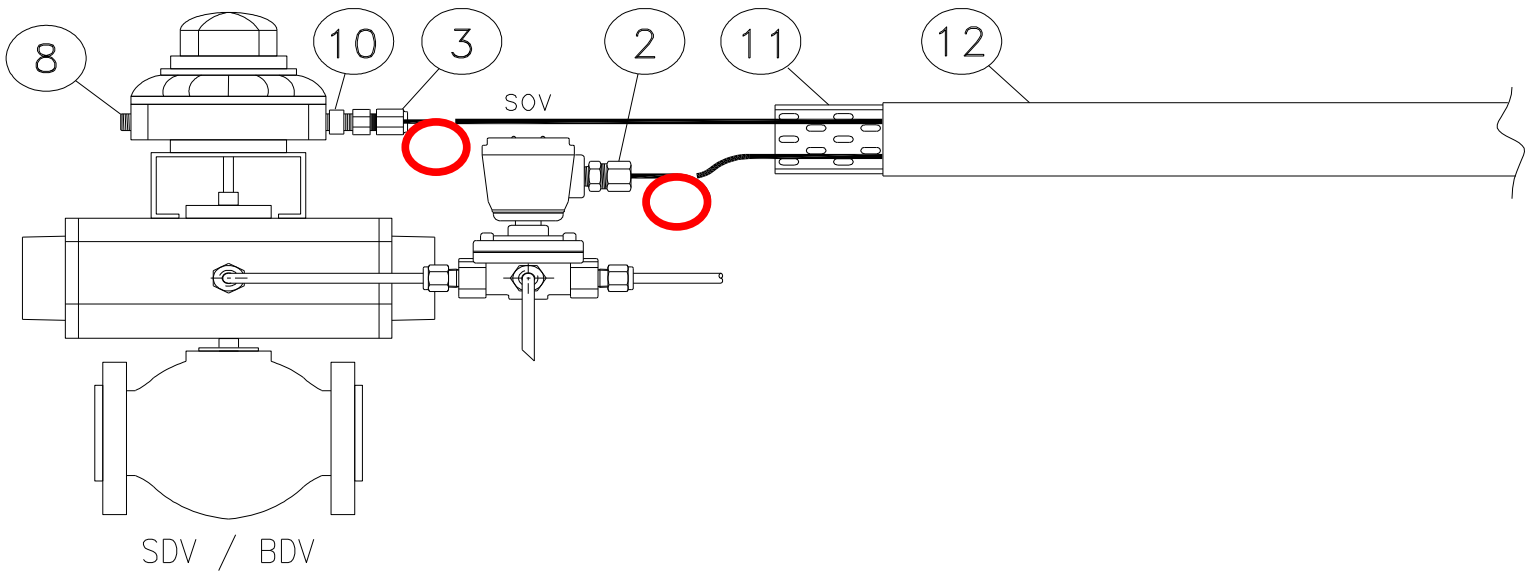

SDV / BDV

INSTRUMENT TAG	
1	25-BDV-005
2	25-BDV-007
3	25-BDV-010
4	25-BDV-013
5	25-BDV-016
6	25-BDV-019
7	25-BDV-022
8	25-SDV-001
9	25-SDV-023
10	64-SDV-001
11	
12	
13	
14	
15	
16	
17	
18	
19	
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
10		Nickel Plated Brass Adaptor Ex-d/e IIC (or IIB + H2) T1	M20 Male x M25 Female	1
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
3		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M25	1
2		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

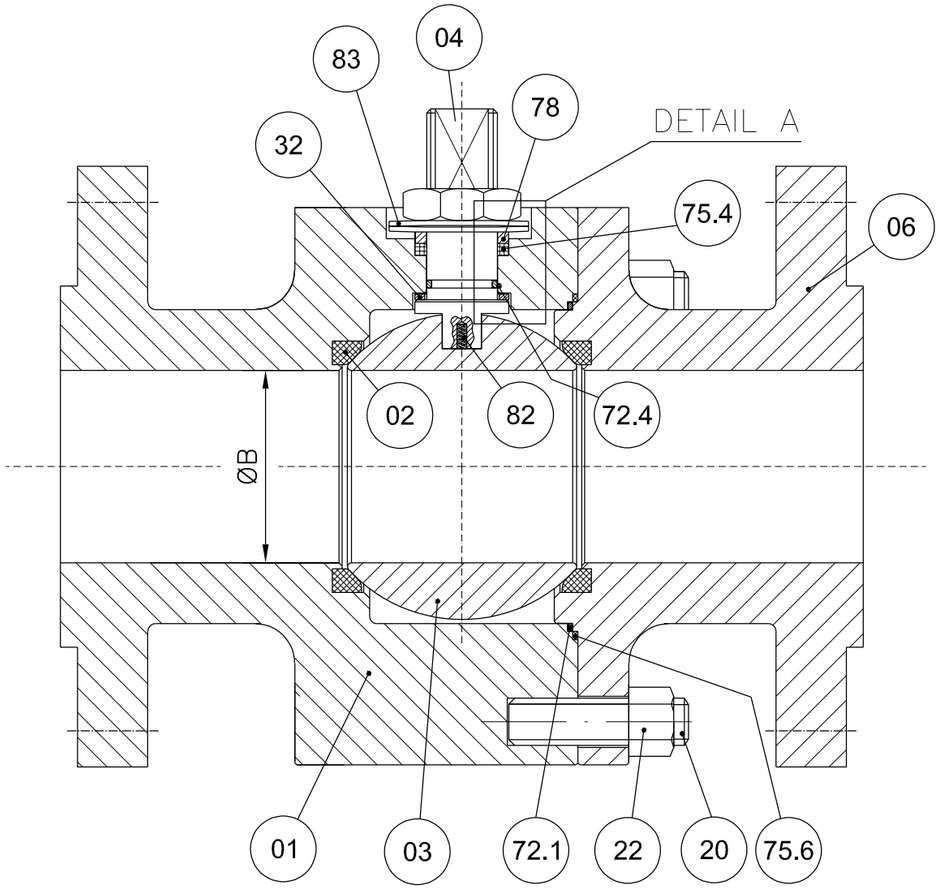




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

GENERAL	1	Tag Number	Location			25-SDV-001	25	
	2	Service				HYDROGEN TO STORAGE TANKS		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80013	Zone 2, Gas Group IIC (or IIB+H2), Class T1	
PIPELINE	4	Line Number				1"-HY-007-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm	1" / 3.38 mm	
	6	Line Material	Line Insulation			ASTM A312/TP316/316L	NOT INSUL. (PAINTED) (35)	
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS	GAS	
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29	80	
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close : (12)	Open : (12)	
	17	Operation (seconds)	Actual			Close : 0.3 minimum	Open : -	
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"	FULL BORE	
	22	Body Material	Bonnet Type			ASTM A182 F316/316L	(*)	
	23	Connections	Rating			FLANGED ASME B16.5	#300	
	24	Flange Finish	Gasket Material			RF	Inside the valve (*) (38)	
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)	(*)	
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork	Spring Return	
	31	Model No.	Size			CP/S	035-100A/AA	
	32	Actuator Orientation	Actuator Form			Horizontal	Cylinder	
	33	Ingress Protection	Certification			IP-66	II 2 G Ex h IIC T5 Gb	
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE	CLOSE	
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-SDY-001 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-001 (9, 17) - Soldo SS	25-ZSH-001 (9, 17) - Soldo SS	
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)	NOT REQUIRED	
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20	H	
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-	-	
	48	Check Valve	Mounting			-	-	
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-PSV-055B	Safety Valve	LOWER DECK	1724000740	AST SpA	COITECH	24-03803	SLK	ATEX ZONE 2	Declaration of Conformity By COITECH SLKL-08HA74-015	Coitech EU - Type Examination Certificate	CE Ex - II 2 GD Ex h X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PT-001	Hyrogen to vessels inlet header	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240634	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-002	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240635	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-004	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240636	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PT-006	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240638	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-PT-008	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240640	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-PT-009	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240642	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-PT-011	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240644	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_2
25-PT-012	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240646	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-035	Vessel V-25001A pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240637	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PT-037	Vessel V-25001B pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240639	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-PT-040	Vessel V-25001C pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240641	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-PT-043	Vessel V-25001D pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240643	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-PT-046	Vessel V-25001E pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240645	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_2
25-PT-049	Vessel V-25001F pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240647	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240648	SST76-H-7-K-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PT-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240649	SST76-H-7-K-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PV-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400589	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PV-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400590	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-PV-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400591	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-PV-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400592	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-PV-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400593	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-PV-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400594	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-PV-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400595	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PV-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400596	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PY-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400589	CV-8407	II 2G	ATEX - SN 2400589	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PY-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400590	CV-8407	II 2G	ATEX - SN 2400590	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-PY-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400591	CV-8407	II 2G	ATEX - SN 2400591	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-PY-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400592	CV-8407	II 2G	ATEX - SN 2400592	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-PY-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400593	CV-8407	II 2G	ATEX - SN 2400593	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-PY-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400594	CV-8407	II 2G	ATEX - SN 2400594	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-PY-055A	Hydrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400595	CV-8407	II 2G	ATEX - SN 2400595	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PY-055B	Hydrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400596	CV-8407	II 2G	ATEX - SN 2400596	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SDV-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SDV-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SDY-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SDY-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-SV-031	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-SV-032	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-033	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-SV-034	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-SV-035	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-SV-036	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-037	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR	25-SDV-023	ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE

CONFORMITY DECLARATION ACCORDING TO EUROPEAN DIRECTIVE 2014/68/UE

DICHIARAZIONE DI CONFORMITÀ AI SENSI DELLA DIRETTIVA EUROPEA 2014/68/UE

THE MANUFACTURER
IL FABBRICANTE

Name Nome	FLUITEK ORSENIGO VALVES S.R.L.
Legal representative and role Legale rappresentante	P. Belotti – Managing Director
Declaration of conformity nr. Dichiarazione di conformità no.	240062
Sede legale Legal office	Via Dei Livelli di Sopra, 7/5 – 24060 COSTA DI MEZZATE (BERGAMO) – ITALY
Sede produttiva Operational office	Via Dei Livelli di Sopra, 7/5 – 24060 COSTA DI MEZZATE (BERGAMO) – ITALY
E-mail E-mail	info@fluitekvalves.com
Website Sito internet	www.fluitekvalves.com
Telephone Telefono	+39 035 666 501
Fax Fax	+39 035 666 5047

DECLARE THAT THE FOLLOWING PRESSURE EQUIPMENT
DICHIARA CHE I SEGUENTI ACCESSORI A PRESSIONE

JOB	FOV Pos.	Serial Number	Client Item	PO N.	Description	Quantity
240062	001	2400620010001	10	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	002	24000620020001	20	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	003	2400620030001	30	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	004	2400620040001	40	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	005	2400620050001	50	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	006	2400620060001	60	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	007	2400620070001	70	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	008	2400620080001	80	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	009	2400620090001	90	1724000204 123A90A	Ball valve 1-1/2'' 300#	**1**
240062	010	2400620100001	100	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	011	2400620110001	110	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	012	2400620120001	120	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	013	2400620130001	130	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	014	2400620140001	140	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	015	2400620150001	150	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	016	2400620160001	160	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	017	2400620170001	170	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	018	2400620180001	180	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	019	2400620190001	190	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	020	2400620200001	200	1724000204 123A90A	Ball valve 1'' 300#	**1**

Fluitek Valves	**CONFORMITY DECLARATION ACCORDING TO EUROPEAN DIRECTIVE 2014/68/UE** DICHIARAZIONE DI CONFORMITÀ AI SENSI DELLA DIRETTIVA EUROPEA 2014/68/UE

240062	021	2400620210001	210	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	022	2400620220001	220	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	023	2400620230001	230	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	024	2400620240001	240	1724000204 123A90A	Ball valve 1-1/2'' 150#	**1**
240062	025	2400620250001	250	1724000204 123A90A	Ball valve 1'' 150#	**1**
240062	026	2400620260001	260	1724000204 123A90A	Ball valve 1-1/2'' 150#	**1**
240062	027	2400620270001	270	1724000204 123A90A	Ball valve 1'' 150#	**1**
240062	028	2400620280001	280	1724000204 123A90A	Ball valve 1'' 150#	**1**

MET THE REQUIREMENTS OF DIRECTIVE 2014/68/UE
SONO CONFORMI AI REQUISITI DELLA DIRETTIVA 2014/68/UE

Conformity assessment procedure used: Procedura di valutazione di conformità utilizzata:	Module H annex III of Directive 2014/68/UE Modulo H Allegato III della Direttiva 2014/68/UE
Notified Body charged of conformity assessment: Organismo Notificato incaricato della valutazione di conformità:	Bureau Veritas (Notified Body No.1370) Bureau Veritas (Ente Notificato N°1370)
Not armonized standards applied to design and manufacture: Norme non armonizzate applicate alla progettazione e alla fabbricazione:	ASME B16.34, ASME VIII, ASME IX, UNI EN 1503 Part.2 ASME B16.34, ASME VIII, ASME IX, UNI EN 1503 Part.2
Classificazione dei fluidi condotta in conformità ai requisiti del	Regolamento CLP CE 1272/2008 Fluid group: **1**

Place COSTA DI MEZZATE (BG), Italy
Luogo COSTA DI MEZZATE (BG), Italia

Date 14/01/2025
Data



Signature
Firma

Fluitek Valves	**DECLARATION OF CONFORMITY ATEX 2014/34/EU** *Dichiarazione di Conformità ATEX 2014/34/EU*	**Cert. DDC No.** **240062 ATEX**

GENERAL INFORMATION – *INFORMAZIONI GENERALI*

Customer ***Cliente***	ROSETTI MARINO S.P.A.		
P. Order ***Ordine***	1724000204 123A90A	**Item/s** ***Item/s***	ALL
FOV Job ***Commessa FOV***	240062	**Position/s** ***Posizione/i***	ALL
Subject ***Oggetto***	BALL VALVE		
Date of execution ***Data di esecuzione***	24/07/2024		

STATEMENT – *DICHIARAZIONE*

We declare that this product has been manufactured in accordance with the Euporean Directive 2014/34/EU to the classification II 2 G/D Tx c.
Technical standards and specifications used are referenced in the Fluitek Orsenigo valves above stated internal job.
The equipment satisfies the provision of directive 2014/34/EU and of standards EN 1127-1, UNI CEI EN ISO 80079-36:2016.
Technical file deposited to Notified Body TUV RHEINLAND 0035.

REMARKS – *NOTE*

SIGNATURE – *FIRME*

Inspection Authority ***Ente Ispettivo***	**Customer Inspector** ***Ispettore Cliente***	**Quality Control** ***Controllo qualità***
		FLUITEK ORSENIGO VALVES S.R.L. Q.C.

rotork Fluid Systems	EU Declaration of Conformity	Rif. JOB nr: AF7703

Manufacturer: Rotork Fluid Systems S.r.l.

Address: Via Padre Jacques Hamel, 138/B
55016 Porcari, Lucca – Italy
Tel. +39 0583 2221
Fax. +39 0585 091362

Section PED: ☐ Applicable ☒ Not Applicable

Under its sole responsibility declares that the items specified below have been designed, manufactured, inspected and tested as required by the relevant provisions of the Pressure Equipment Directive 2014/68/UE.
The equipment has been submitted to the following conformity assessment procedures:

☐**Module H**: **CE-1370-PED-H-RTK 001-23-ITA** **Serial No.:**

☐ **Module H1**: **CE-1370-PED-H1-RTK 001-23-ITA** **Serial No.:**
CE-1370-PED-H1D-RTK 001-20-ITA
CE-1370-PED-H1D-RTK 002-20-ITA

Notified Body: Bureau Veritas Italia SPA Viale Monza 347 20126 MI – Italy
NB Number: 1370

Description: The pressure equipment is a part pressure of pneumatic actuator that is product of Rotork Fluid Systems for quart turn and linear valve. It is composed by a cylinder can and two flanges packaged by tie rods.

Other technical standards and specifications used:
VSR rev.1995; RACCOLTA "M"; RACCOLTA "S"; AD 2000-Merkblatt; ASME VIII Div.1/Div.2; ASME II; EN 13445-3

Section ATEX:

Under its sole responsibility declares that the actuators model:

☒ **GP/GH, CP/CH, RP/RH, LP/LH, HPG, HPL MARKED:** **II 2 G Ex h IIC T5 Gb X**
II 2 D Ex h IIIC T100°C Db X
IP 66M/67M

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / EN 60529

☐ **CQP/CQH MARKED:** **II 2 G Ex h IIC T5 Gb X**
II 2 D Ex h IIIC T100°C Db X
IP 66/68

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / EN 60529

☐ **GO, GOL, EH MARKED:** **II 2 G Ex 60079-46 II_ T_ _ X**
(II 2 D Ex 60079-46 III_ T_ _X)
IP 6_

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / IEC 60079-46, EN 60529

The conformity has been evaluated according to ***Annex VIII (Article 13, Point 1. (b)(ii))*** *of* ***ATEX 2014/34/EU*** *directive.*
TECHNICAL FILE N° TR 219 *(Receipt Number:* ***BVI/ATEX/ITA/24/080*** *Bureau Veritas ITA)*

Section API 6DX: ☐ Applicable ☒ Not Applicable

Under its sole responsibility, the Manufacturer declares that the items specified above have been designed, manufactured, inspected, and tested as required by the applicable provisions of the current edition of the product standard API 6DX and all addenda.


SIGNED ON BEHALF OF ROTORK FLUID SYSTEMS S.R.L. (authorized representative of):

Legal Representative: Metin Gerceker **Signature:**


Place / date: Porcari / 05/02/2025

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

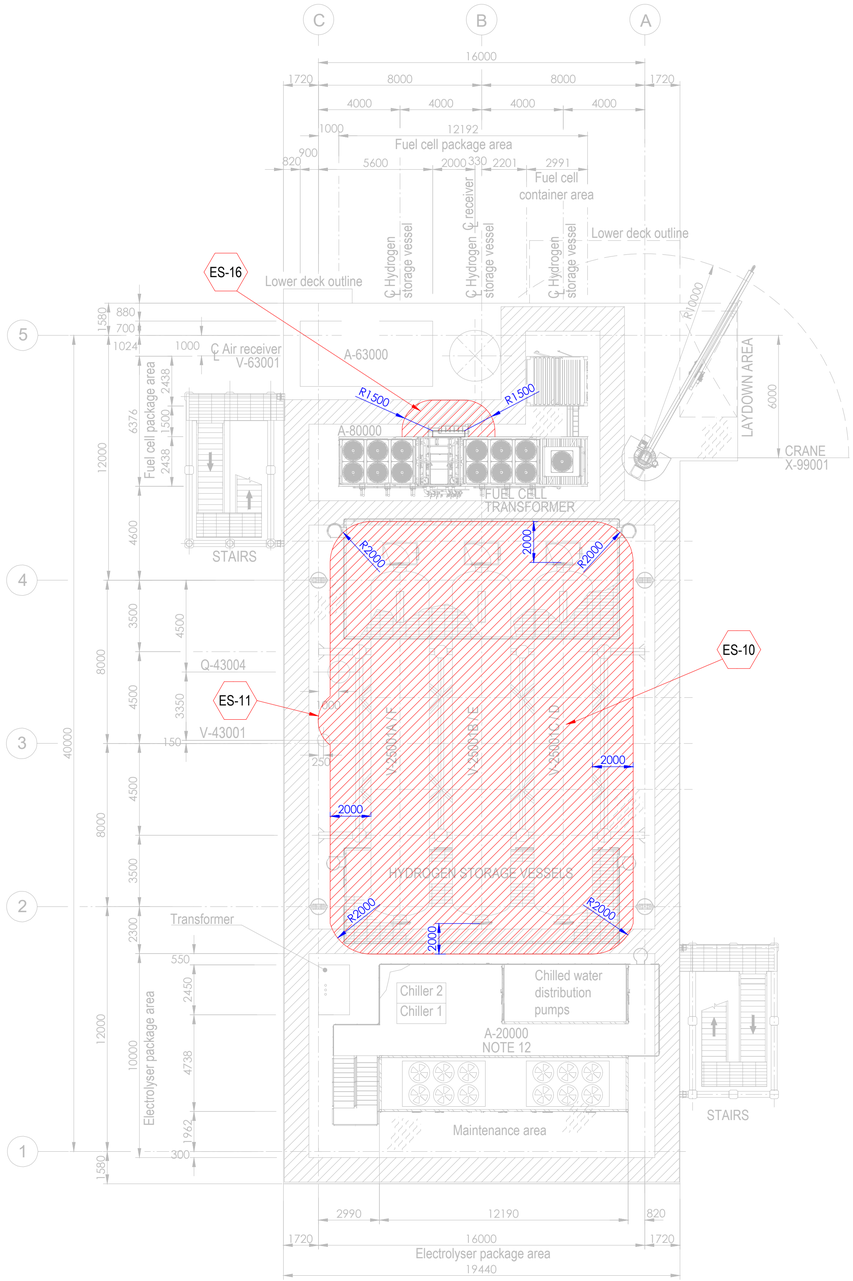


PLAN ON UPPER DECK
EL+30.310 T.O.S.

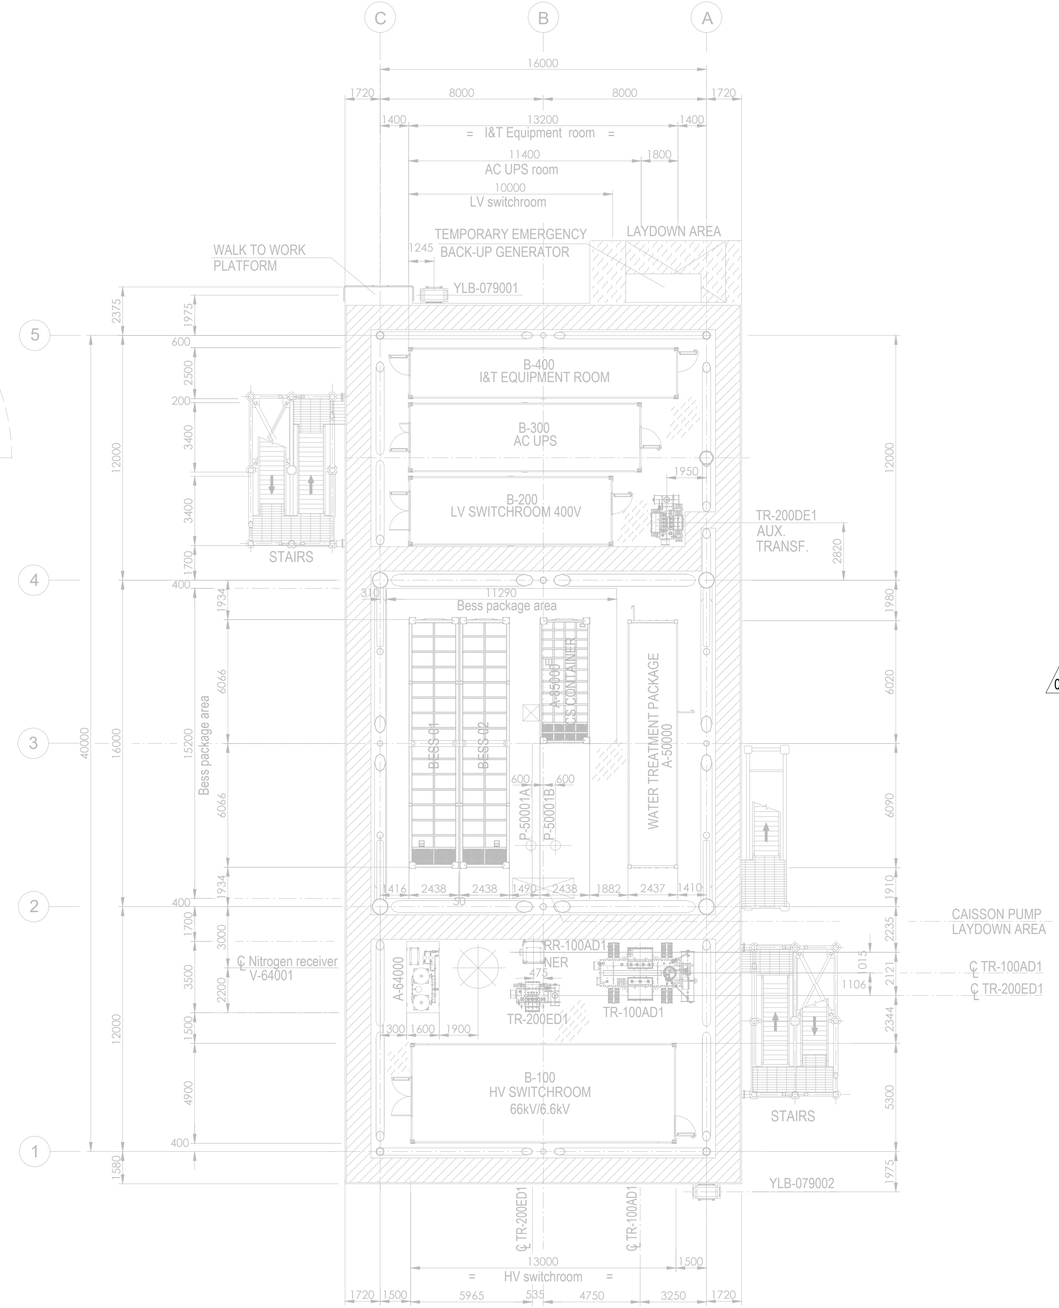

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

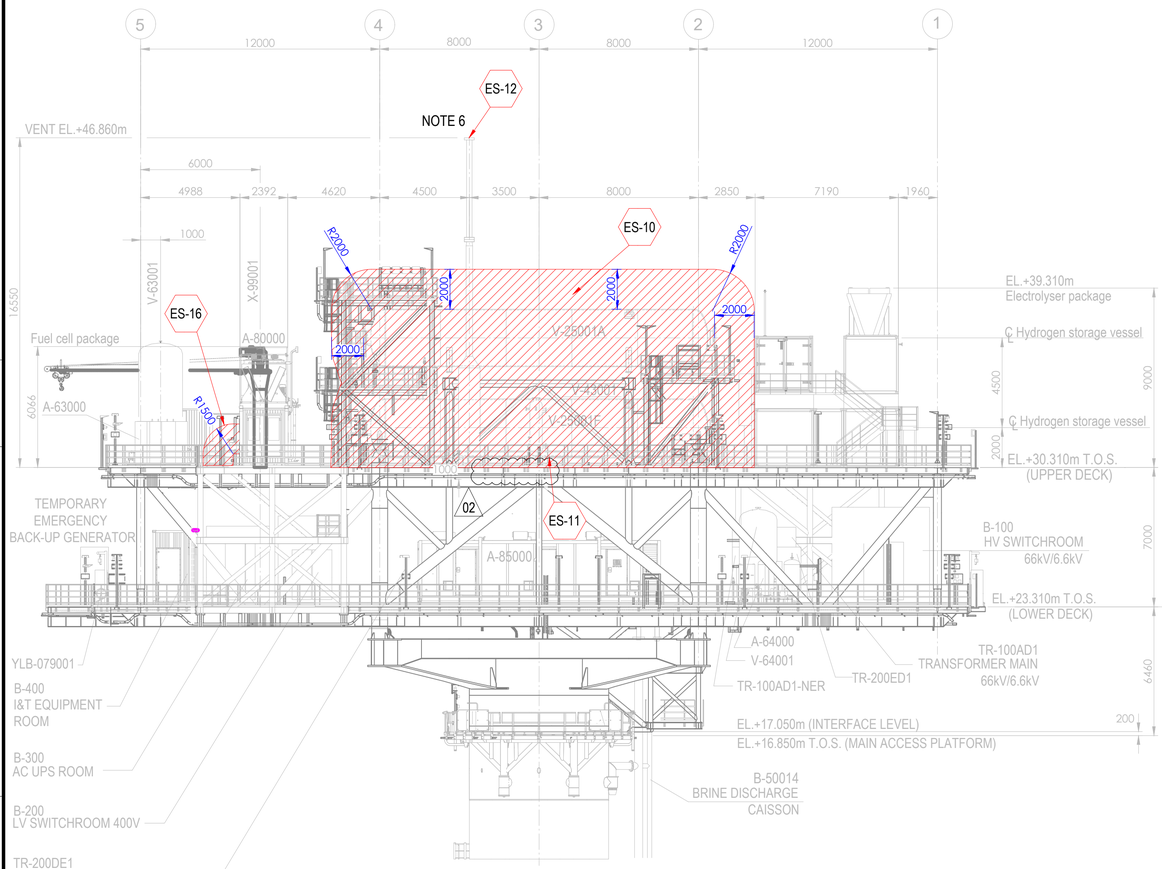



ELEVATION LOOKING EAST

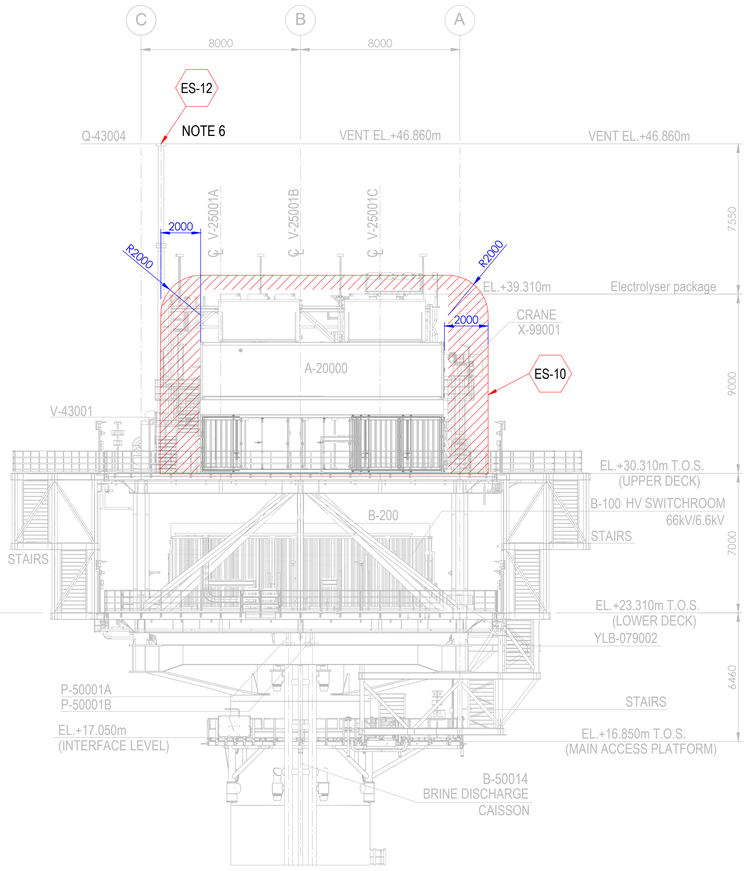

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

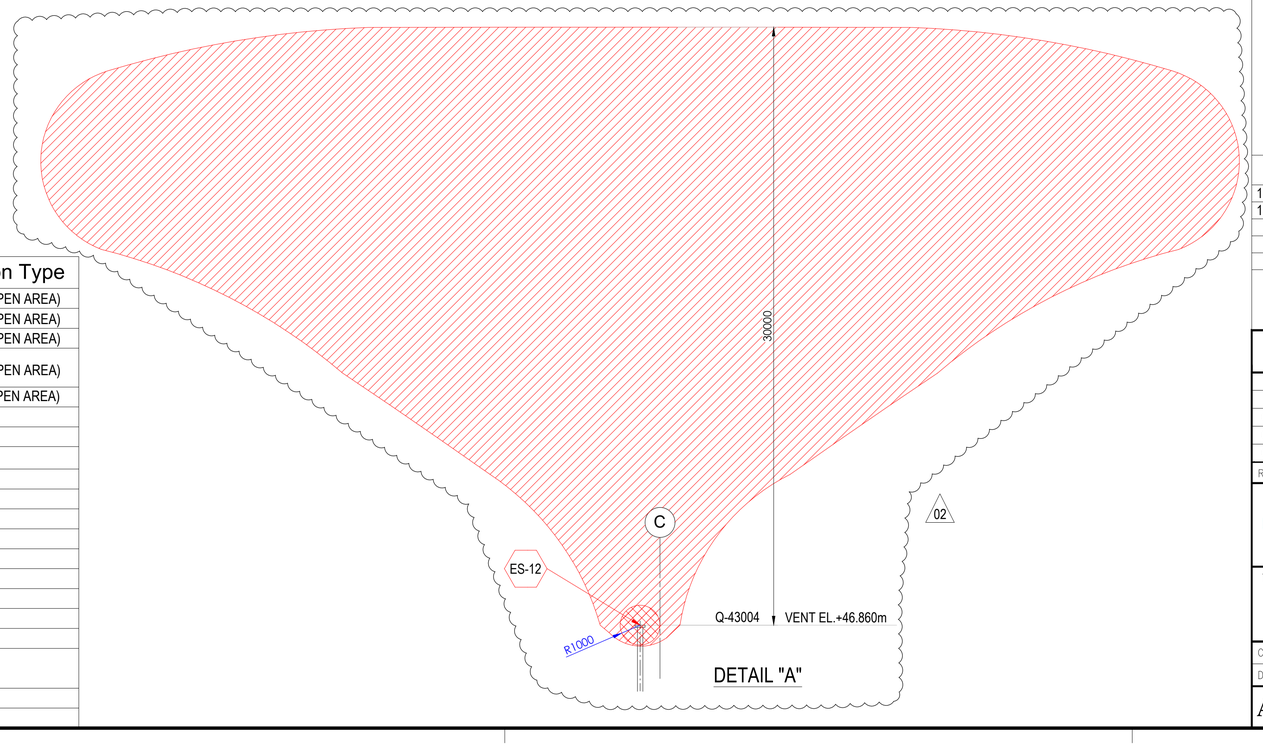



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-XV-004	: On-Off Actuated Ball Valve - Vessel V-25001A Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80015		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001590	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		AF770301101 (Ball valve SN: 2400620110001)			
Manufacturer	Rotork			**Model**		CP/S-035-080A/AA			
Cert No.	Declaration of Conformity by Manufacturer			**Equipment Ambient Temp.**		-20 °C to + 40 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T5	**IP Rating**	IP66/IP67

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-XV-004	: On-Off Actuated Ball Valve - Vessel V-25001A Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80015
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001590		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-XV-004	: On-Off Actuated Ball Valve - Vessel V-25001A Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80015
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001590	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-25	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-25T13:52:08.139Z	PROVERLIS Digitaly signed by Luca Mussi 2025-01-30T11:41:13.043Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

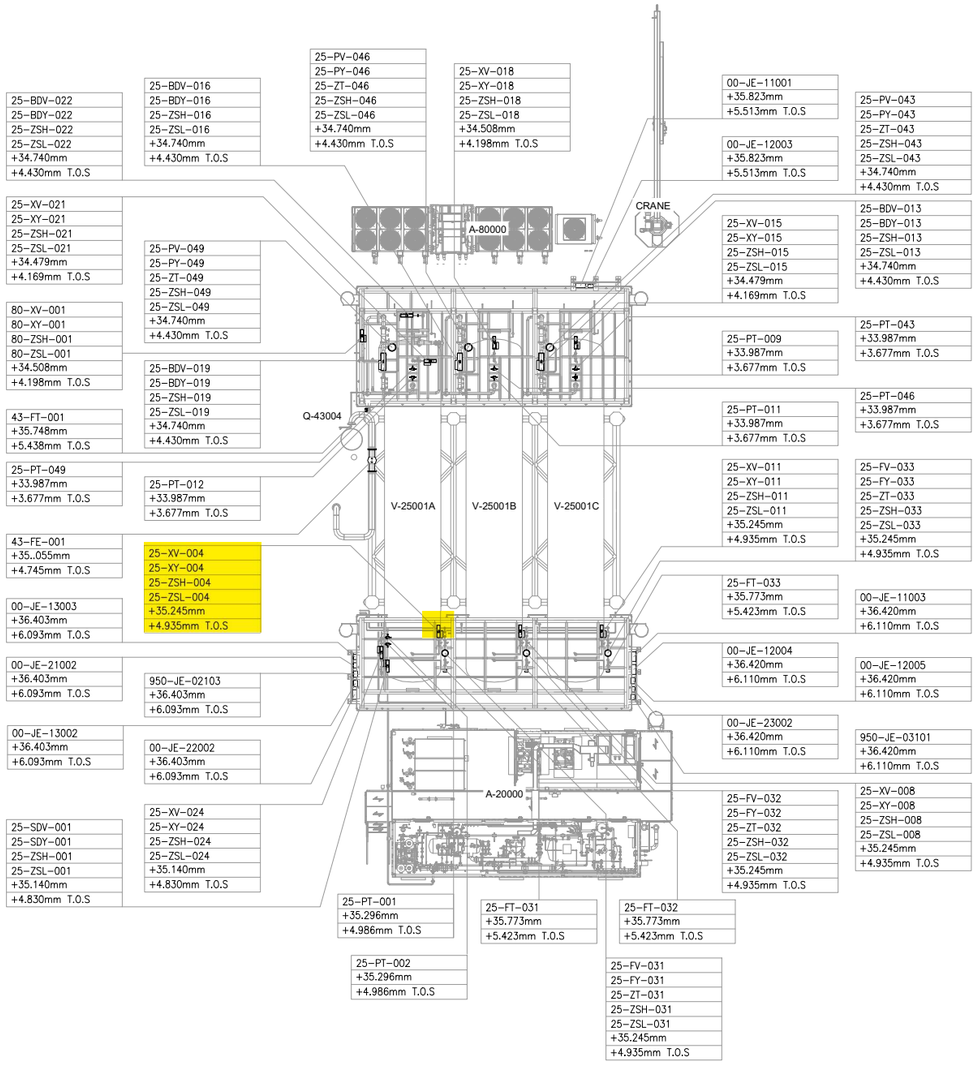

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm

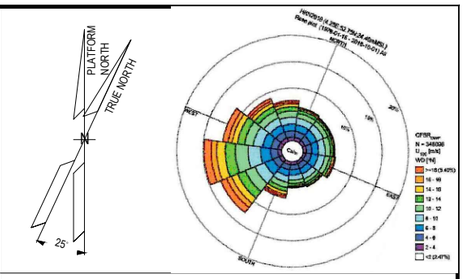

NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 A

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg /AMB

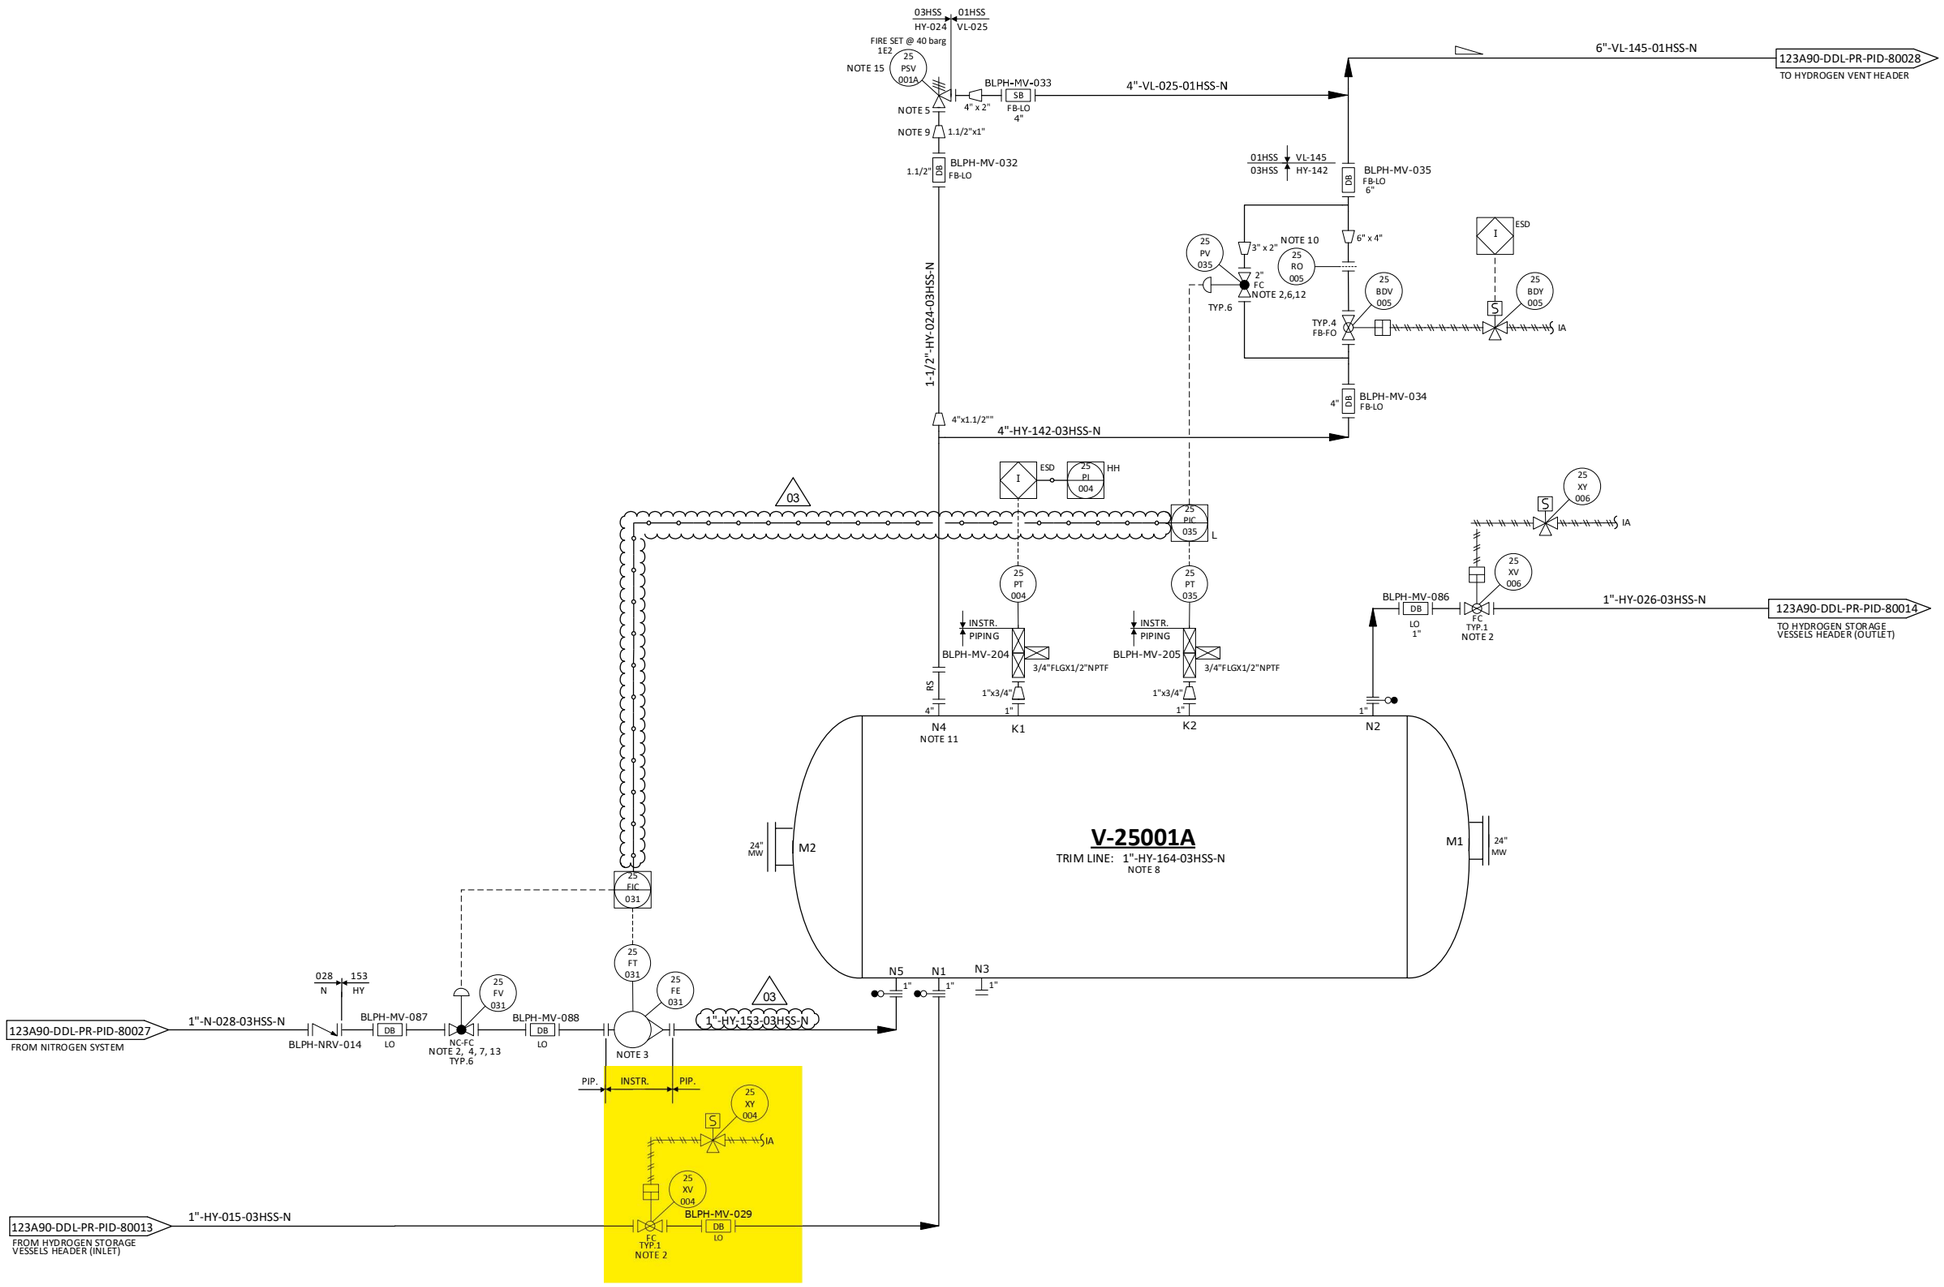

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS. 03
4. NITROGEN CONTROL VALVE (25-FV-031) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE.
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-035 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-035 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-031 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-035 HAS FAILED TO CLOSE.
15. 25-PSV-001A SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL A

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80015		SHEET 001	REV. 03


File Name : FILE_NAME

DRAWING NO.


REV. 00

TYPICAL INSTRUMENTATION VALVE

TYP.1 (XV - ON OFF VALVES)

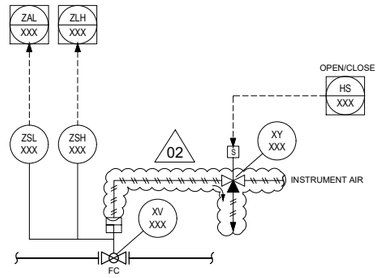


TYP.2 (SDV - SAFETY NO CRITICAL VALVES)

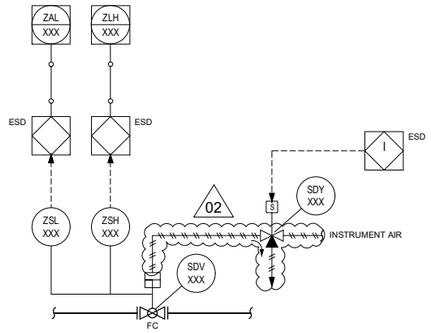


02

TYP.4 (BDV - SAFETY NO CRITICAL VALVES)

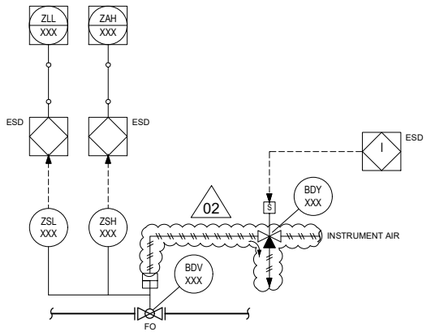

02

TYP.6 (CONTROL VALVES - CRITICAL)

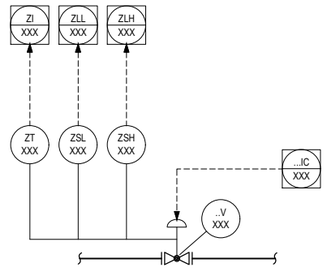


INSTRUMENT SYMBOLOGY DEFINITION

MEANINGS OF IDENTIFICATION LETTERS
THIS TABLE APPLIES TO THE FUNCTIONAL IDENTIFICATION OF INSTRUMENTS

	FIRST- LETTER		SUCCEEDING-LETTER		
	MEASURED OR INITIATING VARIABLE	MODIFIER	READOUT OR PASSIVE FUNCTION	OUTPUT FUNCTION	MODIFIER
A	ANALYSIS		ALARM		
C				CONTROL	
E			SENSOR (PRIMARY ELEMENT) ELEMENT		
F	FLOW RATE	RATIO (FRACTION)			
G			GLASS VIEWING DEVICE		
H	HAND				HIGH
I			INDICATE		
L	LEVEL				LOW
O			ORIFICE, OPEN		
P	PRESSURE, VACUUM				
R		RELIEF			
S		SAFETY		SWITCH	
T	TEMPERATURE			TRANSMIT	
V				VALVE, DAMPER, LOUVER	
X	UNCLASSIFIED				
Y				AUXILIARY DEVICES	
Z	POSITION DIMENSION				

NOTE: FOR FURTHER EXPLANATORY NOTES, REFER TO ANSI/ISA-5.1

TYP.7 (CONTROL VALVES - NOT CRITICAL)



NOTES

1. FOR GENERAL NOTES AND PIPING SYMBOLOGY SEE DRAWINGS: 123A90-DDL-PR-PID-80009 AND 123A90-DDL-PR-PID-80010.
2. DELETED.

HOLDS

1 DELETED 02


REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND | ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
INSTRUMENTATION SYMBOLOGY

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80042	SHEET 001	REV. 02

File Name :

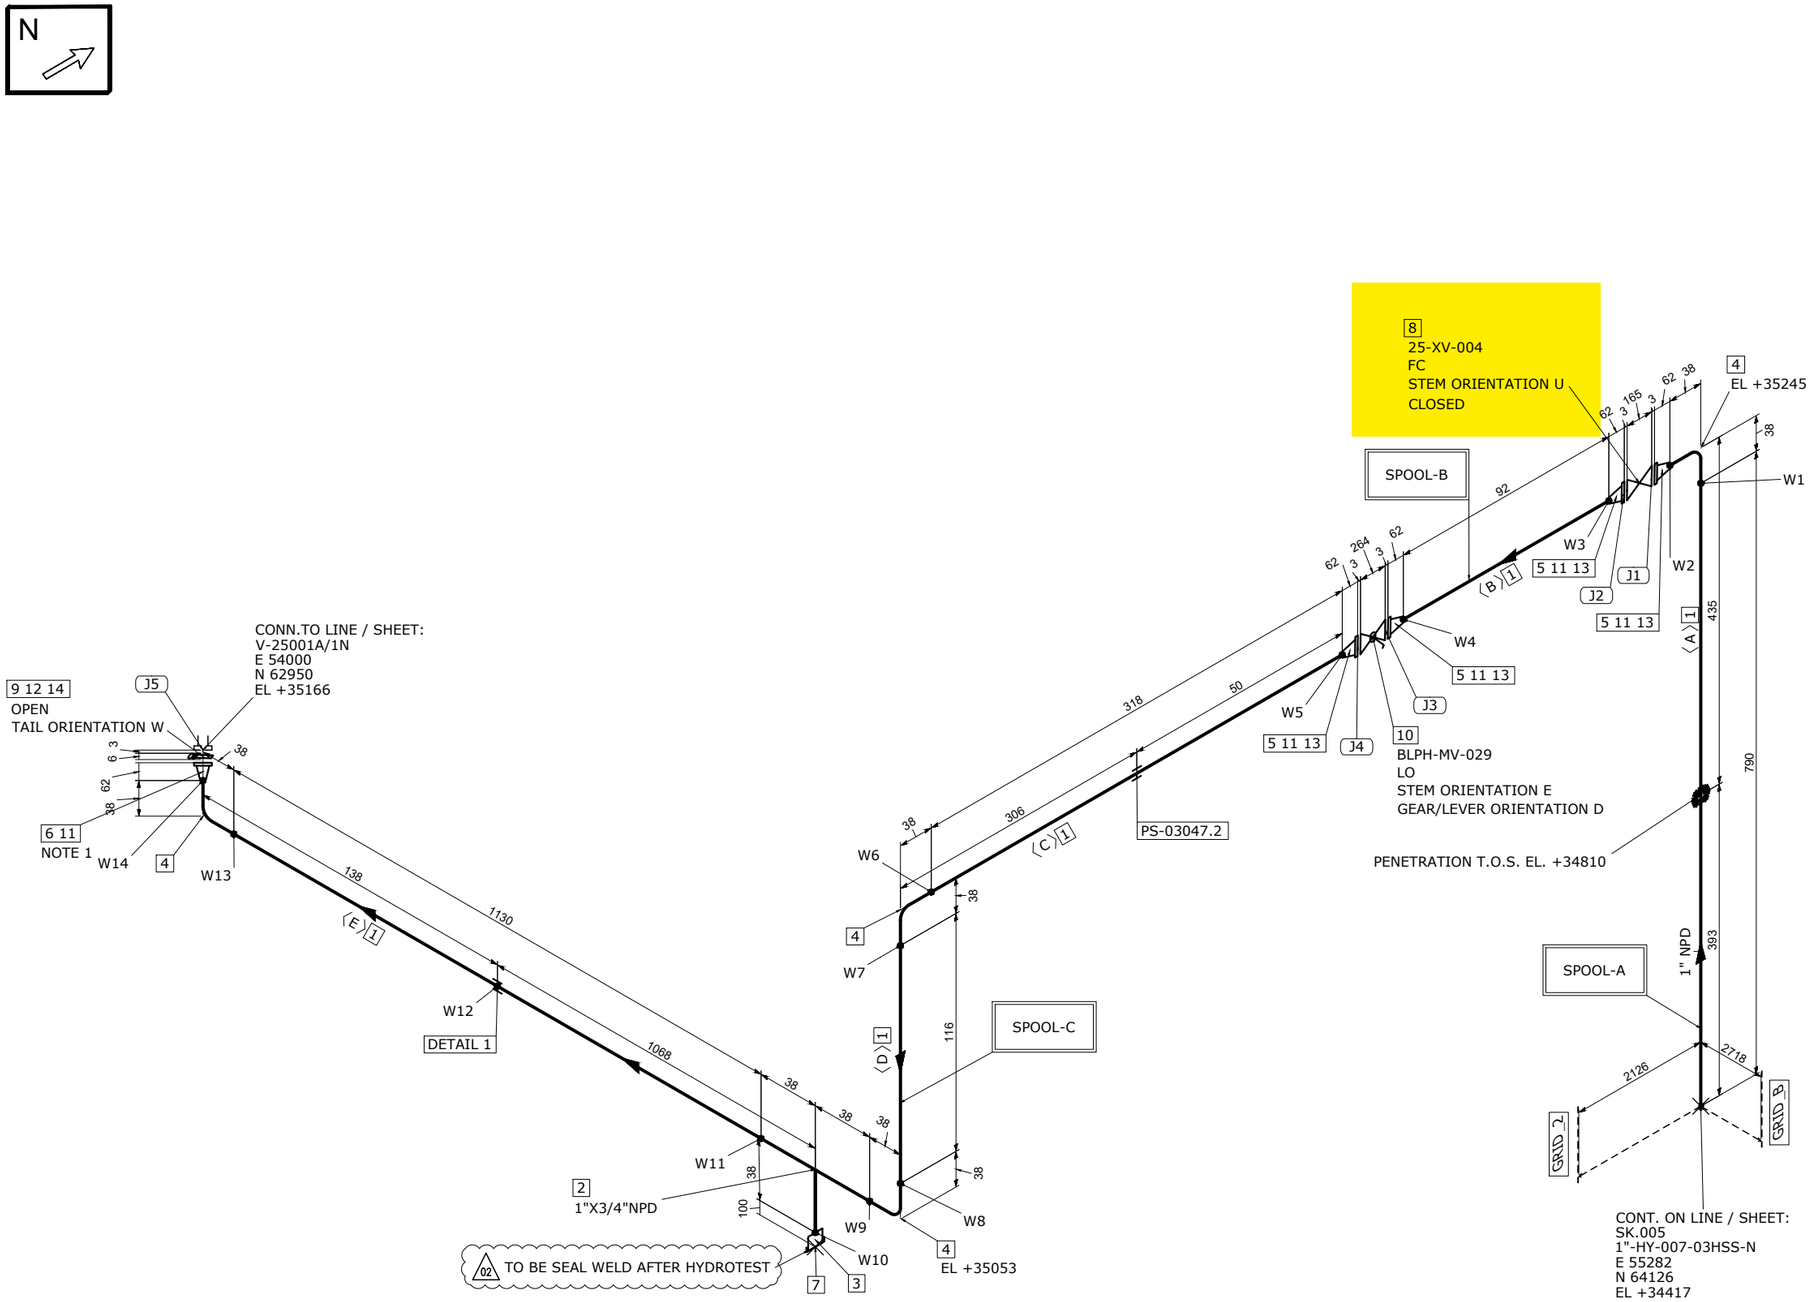

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.4M	6.2
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.4
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.2

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	3/4	BW
W11	1	BW
W12		FW
W13	1	BW
W14	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	790	BEVEL	BEVEL
B	1	92	BEVEL	BEVEL
C	1	318	BEVEL	BEVEL
D	1	116	BEVEL	BEVEL
E	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-03047.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	2	4.0
B	2	3.9
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-015-03HSS-N

SK.009

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK

SCALE: N/A

DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024

FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00009 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		

REFERENCE DOCUMENTS


P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION N/S

MASTER

E33

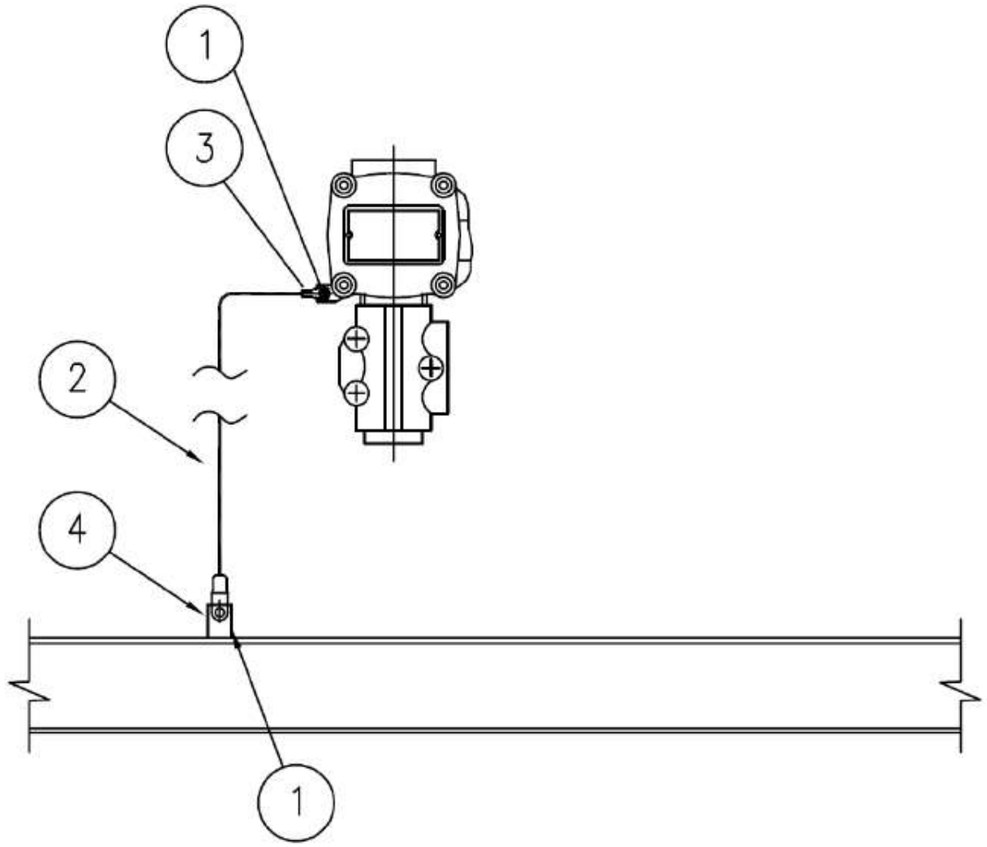

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS

A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

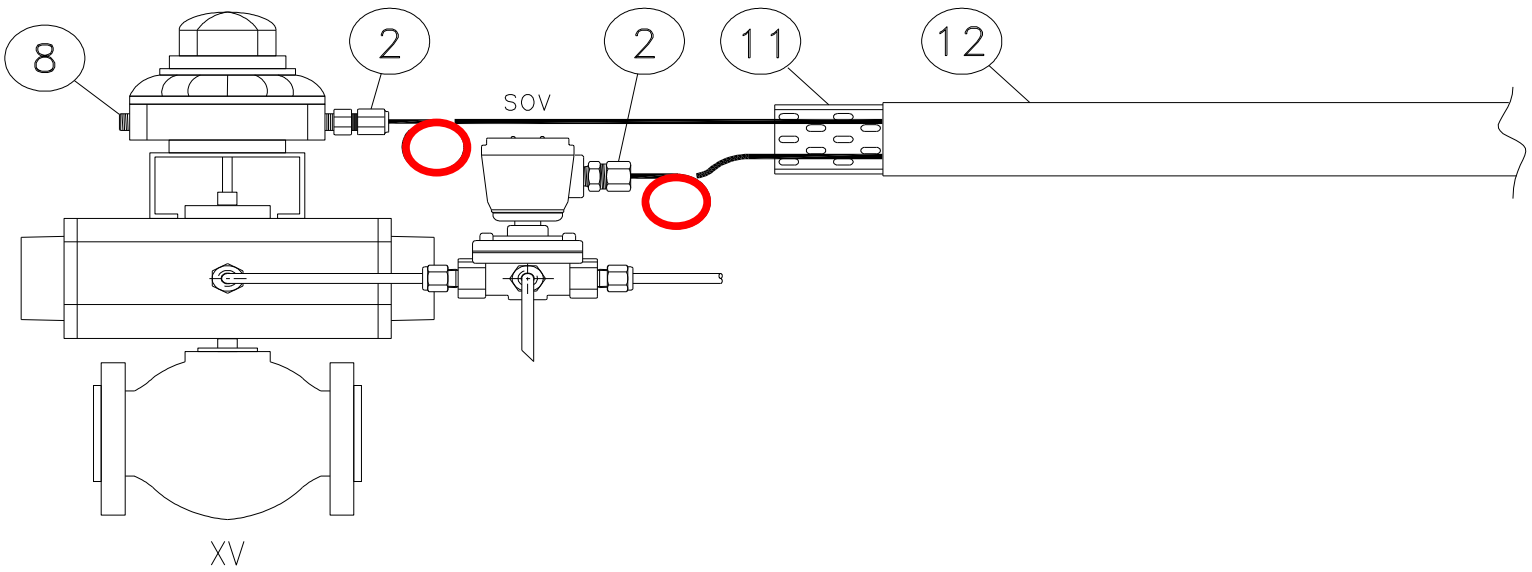

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**

REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy


CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Pneumatic Hook-Ups	Sh. 6 of 6 Date: 08/07/2024 Rev. 01

PNEUMATIC HOOK-UP FOR ON-OFF VALVES

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40078**

REV.:	DATE:	SIGNATURE:
1_B	06/11/24	G.Randi

ROSETTI MARINO SpA

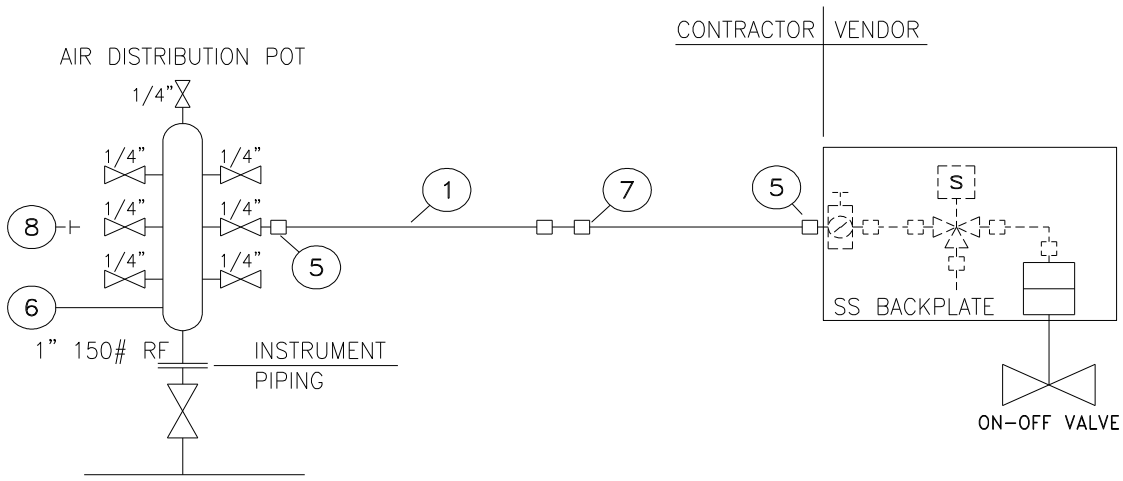



INSTRUMENT TAG	
1	25-BDV-022
2	25-BDV-005
3	25-BDV-007
4	25-BDV-010
5	25-BDV-013
6	25-BDV-016
7	25-BDV-019
8	25-SDV-001
9	25-SDV-023
10	25-XV-004
11	25-XV-006
12	25-XV-008
13	25-XV-009
14	25-XV-011
15	25-XV-012
16	25-XV-014
17	25-XV-015
18	25-XV-017
19	25-XV-018
20	25-XV-020
21	25-XV-021
22	25-XV-024
23	50-XV-001
24	50-XV-002
25	50-XV-003
26	50-XV-004
27	80-XV-001
28	64-SDV-001
29	50-XV-005
30	

NOTE:
(1) For Air Distribution Pot quantities see material take-off on sh. 4


POS.	NORM/STD CODE	DESCRIPTION	SIZE/CONNECTION TYPE	Q.TY
8		SS316 PLUG	1/4" NPT	Note 1
7		SS316 UNION	1/2" O.D. x 1/2" O.D.	N. 1
6		SS316 AIR DISTRIBUTION POT	1" 150#RF - N. 7 1/4" BALL VALVES	Note 1
5		SS316 MALE CONNECTOR	1/4" NPT x 1/2" O.D.	N. 2
1		SS 316L TUBING	1/2" x 0,049"Thk	10 m


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

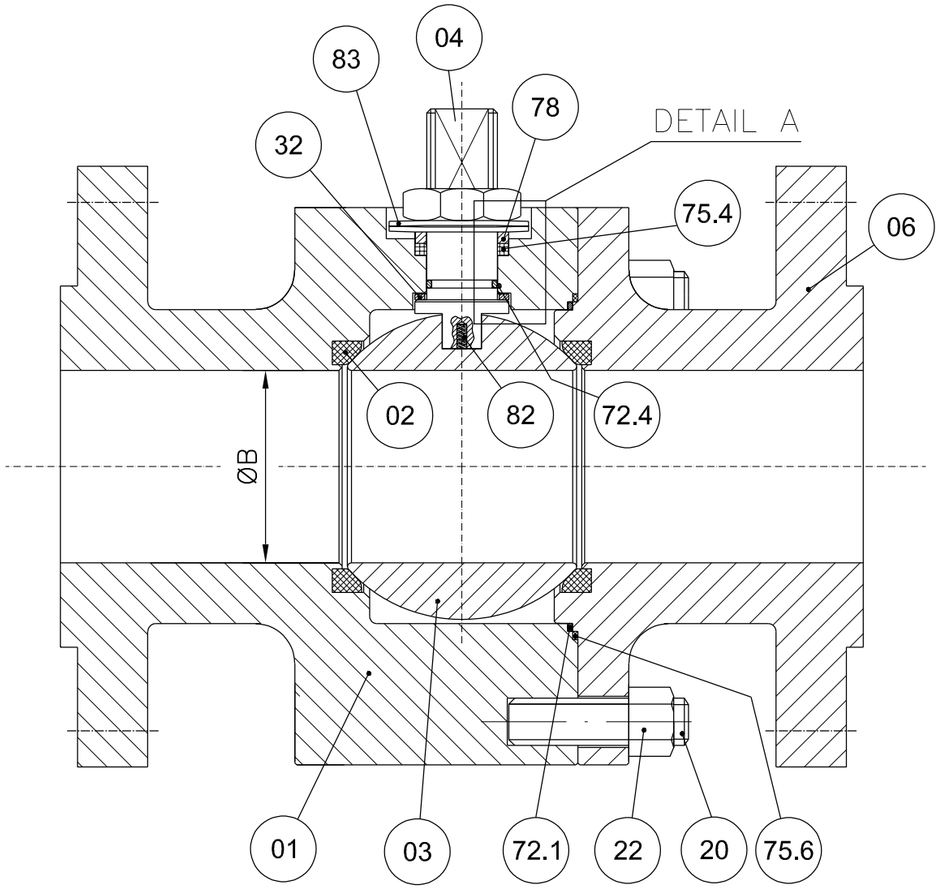




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

Fluitek Valves

DRAWING NOT IN SCALE

DRAWN: S.Madahar — DATE: 26/02/2024
CHK'D: D.Barcella — DATE: 26/02/2024
APPV'D: L.Mora — DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWING NAME: **D240062-08**

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-004		25
	2	Service				HYDROGEN STORAGE TANK V-25001A INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80015		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-015-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close : (12)		Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum		Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-004 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-004 (9, 17) - Soldo SS		25-ZSH-004 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR	25-SDV-023	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE

CONFORMITY DECLARATION ACCORDING TO EUROPEAN DIRECTIVE 2014/68/UE

DICHIARAZIONE DI CONFORMITÀ AI SENSI DELLA DIRETTIVA EUROPEA 2014/68/UE

THE MANUFACTURER
IL FABBRICANTE

Name Nome	FLUITEK ORSENIGO VALVES S.R.L.
Legal representative and role Legale rappresentante	P. Belotti – Managing Director
Declaration of conformity nr. Dichiarazione di conformità no.	240062
Sede legale Legal office	Via Dei Livelli di Sopra, 7/5 – 24060 COSTA DI MEZZATE (BERGAMO) – ITALY
Sede produttiva Operational office	Via Dei Livelli di Sopra, 7/5 – 24060 COSTA DI MEZZATE (BERGAMO) – ITALY
E-mail E-mail	info@fluitekvalves.com
Website Sito internet	www.fluitekvalves.com
Telephone Telefono	+39 035 666 501
Fax Fax	+39 035 666 5047

DECLARE THAT THE FOLLOWING PRESSURE EQUIPMENT
DICHIARA CHE I SEGUENTI ACCESSORI A PRESSIONE

JOB	FOV Pos.	Serial Number	Client Item	PO N.	Description	Quantity
240062	001	2400620010001	10	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	002	24000620020001	20	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	003	2400620030001	30	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	004	2400620040001	40	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	005	2400620050001	50	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	006	2400620060001	60	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	007	2400620070001	70	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	008	2400620080001	80	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	009	2400620090001	90	1724000204 123A90A	Ball valve 1-1/2'' 300#	**1**
240062	010	2400620100001	100	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	011	2400620110001	110	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	012	2400620120001	120	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	013	2400620130001	130	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	014	2400620140001	140	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	015	2400620150001	150	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	016	2400620160001	160	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	017	2400620170001	170	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	018	2400620180001	180	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	019	2400620190001	190	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	020	2400620200001	200	1724000204 123A90A	Ball valve 1'' 300#	**1**

Fluitek Valves	**CONFORMITY DECLARATION ACCORDING TO EUROPEAN DIRECTIVE 2014/68/UE** DICHIARAZIONE DI CONFORMITÀ AI SENSI DELLA DIRETTIVA EUROPEA 2014/68/UE

240062	021	2400620210001	210	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	022	2400620220001	220	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	023	2400620230001	230	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	024	2400620240001	240	1724000204 123A90A	Ball valve 1-1/2'' 150#	**1**
240062	025	2400620250001	250	1724000204 123A90A	Ball valve 1'' 150#	**1**
240062	026	2400620260001	260	1724000204 123A90A	Ball valve 1-1/2'' 150#	**1**
240062	027	2400620270001	270	1724000204 123A90A	Ball valve 1'' 150#	**1**
240062	028	2400620280001	280	1724000204 123A90A	Ball valve 1'' 150#	**1**

MET THE REQUIREMENTS OF DIRECTIVE 2014/68/UE
SONO CONFORMI AI REQUISITI DELLA DIRETTIVA 2014/68/UE

Conformity assessment procedure used: Procedura di valutazione di conformità utilizzata:	Module H annex III of Directive 2014/68/UE Modulo H Allegato III della Direttiva 2014/68/UE
Notified Body charged of conformity assessment: Organismo Notificato incaricato della valutazione di conformità:	Bureau Veritas (Notified Body No.1370) Bureau Veritas (Ente Notificato N°1370)
Not armonized standards applied to design and manufacture: Norme non armonizzate applicate alla progettazione e alla fabbricazione:	ASME B16.34, ASME VIII, ASME IX, UNI EN 1503 Part.2 ASME B16.34, ASME VIII, ASME IX, UNI EN 1503 Part.2
Classificazione dei fluidi condotta in conformità ai requisiti del	Regolamento CLP CE 1272/2008 Fluid group: **1**

Place COSTA DI MEZZATE (BG), Italy
Luogo COSTA DI MEZZATE (BG), Italia

Date 14/01/2025
Data



Signature
Firma

Fluitek Valves	**DECLARATION OF CONFORMITY ATEX 2014/34/EU** *Dichiarazione di Conformità ATEX 2014/34/EU*	**Cert. DDC No.** **240062 ATEX**

GENERAL INFORMATION – *INFORMAZIONI GENERALI*

Customer ***Cliente***	ROSETTI MARINO S.P.A.		
P. Order ***Ordine***	1724000204 123A90A	**Item/s** ***Item/s***	ALL
FOV Job ***Commessa FOV***	240062	**Position/s** ***Posizione/i***	ALL
Subject ***Oggetto***	BALL VALVE		
Date of execution ***Data di esecuzione***	24/07/2024		

STATEMENT – *DICHIARAZIONE*

We declare that this product has been manufactured in accordance with the Euporean Directive 2014/34/EU to the classification II 2 G/D Tx c.
Technical standards and specifications used are referenced in the Fluitek Orsenigo valves above stated internal job.
The equipment satisfies the provision of directive 2014/34/EU and of standards EN 1127-1, UNI CEI EN ISO 80079-36:2016.
Technical file deposited to Notified Body TUV RHEINLAND 0035.

REMARKS – *NOTE*

SIGNATURE – *FIRME*

Inspection Authority ***Ente Ispettivo***	**Customer Inspector** ***Ispettore Cliente***	**Quality Control** ***Controllo qualità***
		FLUITEK ORSENIGO VALVES S.R.L. Q.C.

rotork Fluid Systems	EU Declaration of Conformity	Rif. JOB nr: AF7703

Manufacturer: Rotork Fluid Systems S.r.l.

Address: Via Padre Jacques Hamel, 138/B
55016 Porcari, Lucca – Italy
Tel. +39 0583 2221
Fax. +39 0585 091362

Section PED: ☐ Applicable ☒ Not Applicable

Under its sole responsibility declares that the items specified below have been designed, manufactured, inspected and tested as required by the relevant provisions of the Pressure Equipment Directive 2014/68/UE.
The equipment has been submitted to the following conformity assessment procedures:

☐**Module H**: **CE-1370-PED-H-RTK 001-23-ITA** **Serial No.:**

☐ **Module H1**: **CE-1370-PED-H1-RTK 001-23-ITA** **Serial No.:**
CE-1370-PED-H1D-RTK 001-20-ITA
CE-1370-PED-H1D-RTK 002-20-ITA

Notified Body: Bureau Veritas Italia SPA Viale Monza 347 20126 MI – Italy
NB Number: 1370

Description: The pressure equipment is a part pressure of pneumatic actuator that is product of Rotork Fluid Systems for quart turn and linear valve. It is composed by a cylinder can and two flanges packaged by tie rods.

Other technical standards and specifications used:
VSR rev.1995; RACCOLTA "M"; RACCOLTA "S"; AD 2000-Merkblatt; ASME VIII Div.1/Div.2; ASME II; EN 13445-3

Section ATEX:

Under its sole responsibility declares that the actuators model:

☒ **GP/GH, CP/CH, RP/RH, LP/LH, HPG, HPL MARKED:** **II 2 G Ex h IIC T5 Gb X**
II 2 D Ex h IIIC T100°C Db X
IP 66M/67M

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / EN 60529

☐ **CQP/CQH MARKED:** **II 2 G Ex h IIC T5 Gb X**
II 2 D Ex h IIIC T100°C Db X
IP 66/68

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / EN 60529

☐ **GO, GOL, EH MARKED:** **II 2 G Ex 60079-46 II_ T_ _ X**
(II 2 D Ex 60079-46 III_ T_ _X)
IP 6_

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / IEC 60079-46, EN 60529

The conformity has been evaluated according to ***Annex VIII (Article 13, Point 1. (b)(ii))*** *of* ***ATEX 2014/34/EU*** *directive.*
TECHNICAL FILE N° TR 219 *(Receipt Number:* ***BVI/ATEX/ITA/24/080*** *Bureau Veritas ITA)*

Section API 6DX: ☐ Applicable ☒ Not Applicable

Under its sole responsibility, the Manufacturer declares that the items specified above have been designed, manufactured, inspected, and tested as required by the applicable provisions of the current edition of the product standard API 6DX and all addenda.


SIGNED ON BEHALF OF ROTORK FLUID SYSTEMS S.R.L. (authorized representative of):

Legal Representative: Metin Gerceker **Signature:**


Place / date: Porcari / 05/02/2025

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

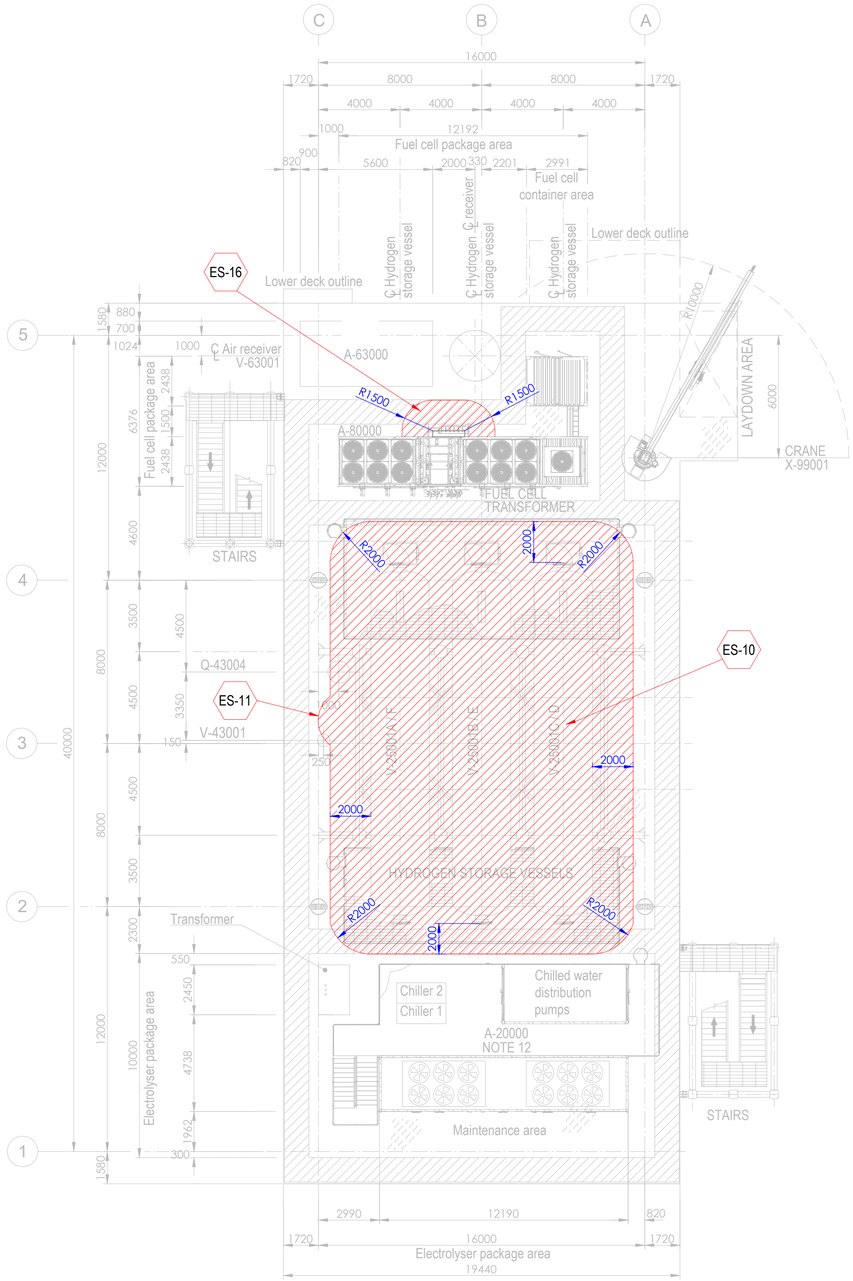


PLAN ON UPPER DECK
EL+30.310 T.O.S.

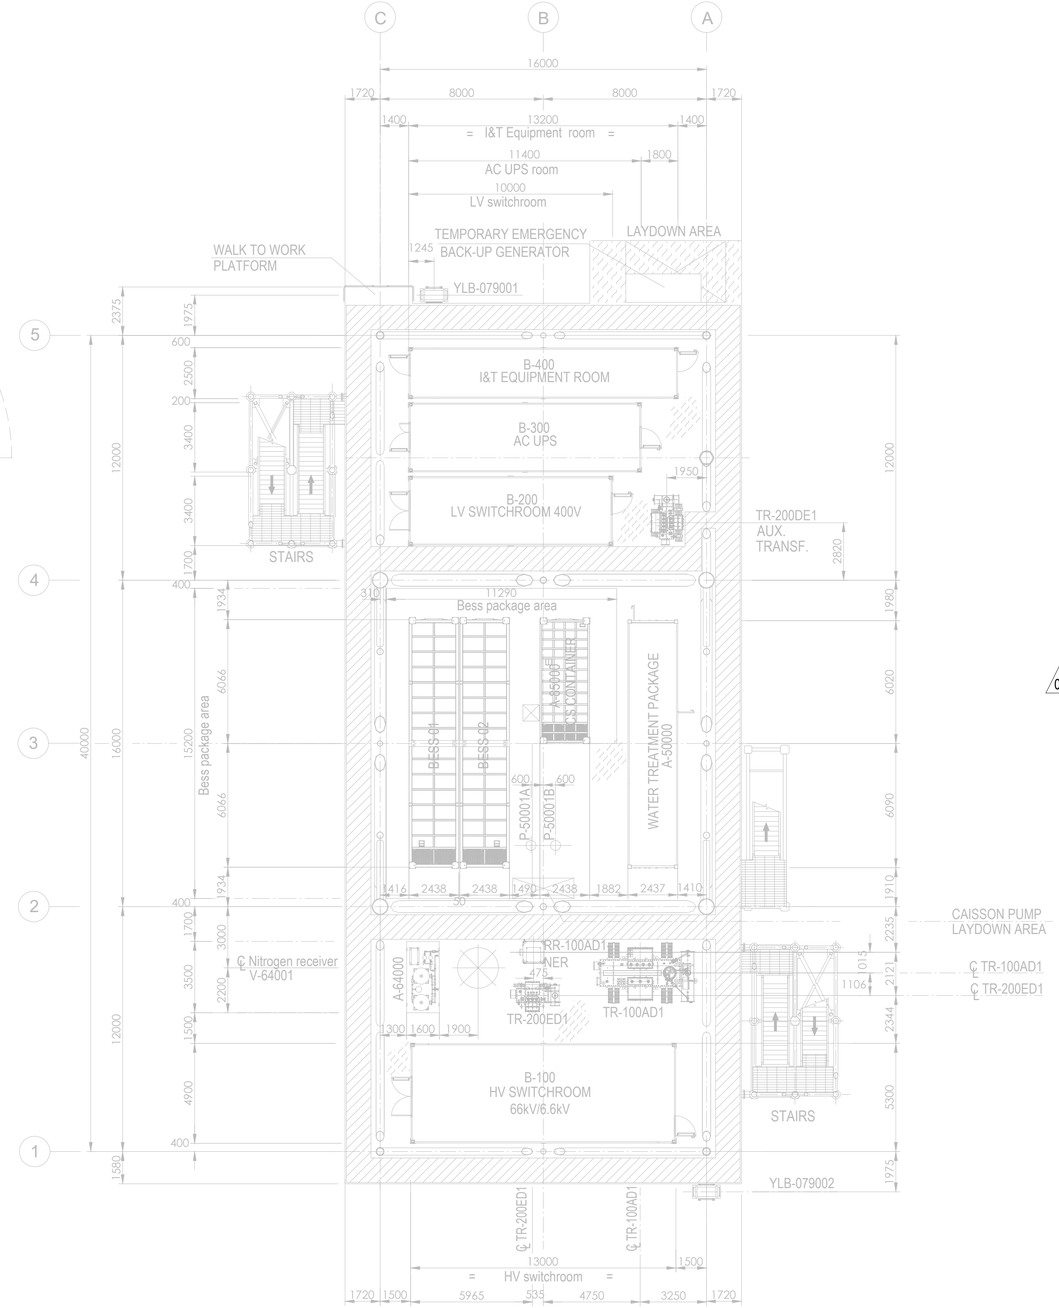

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

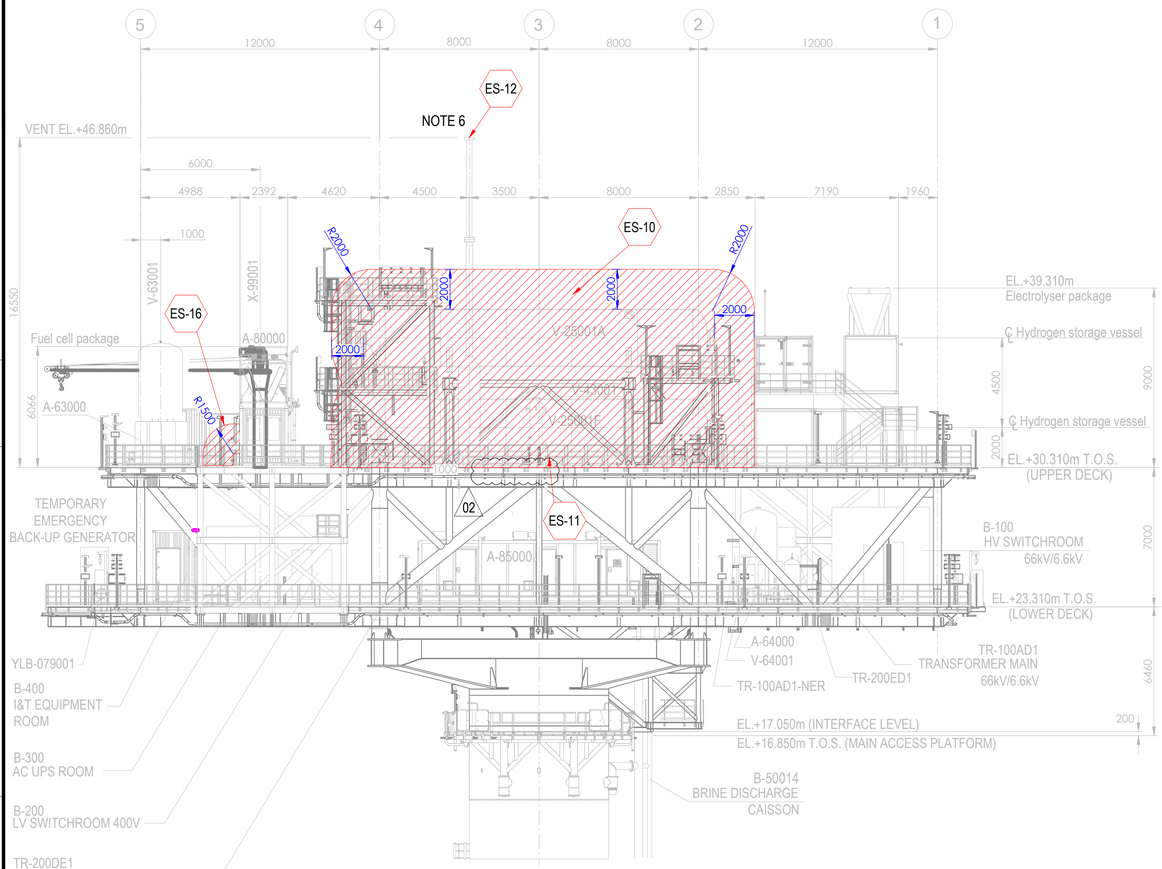



ELEVATION LOOKING EAST

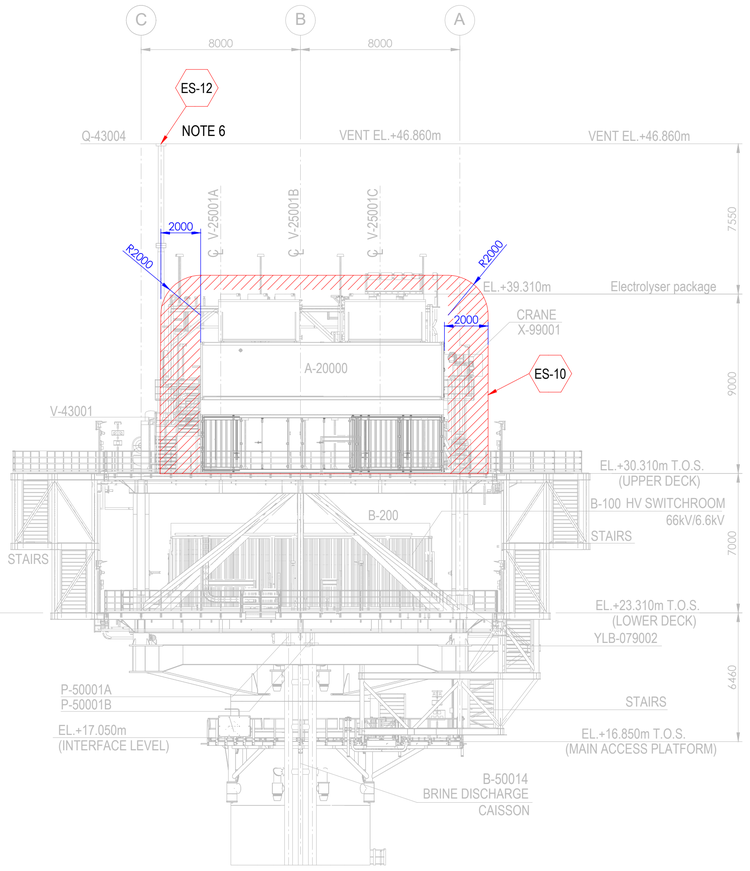

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

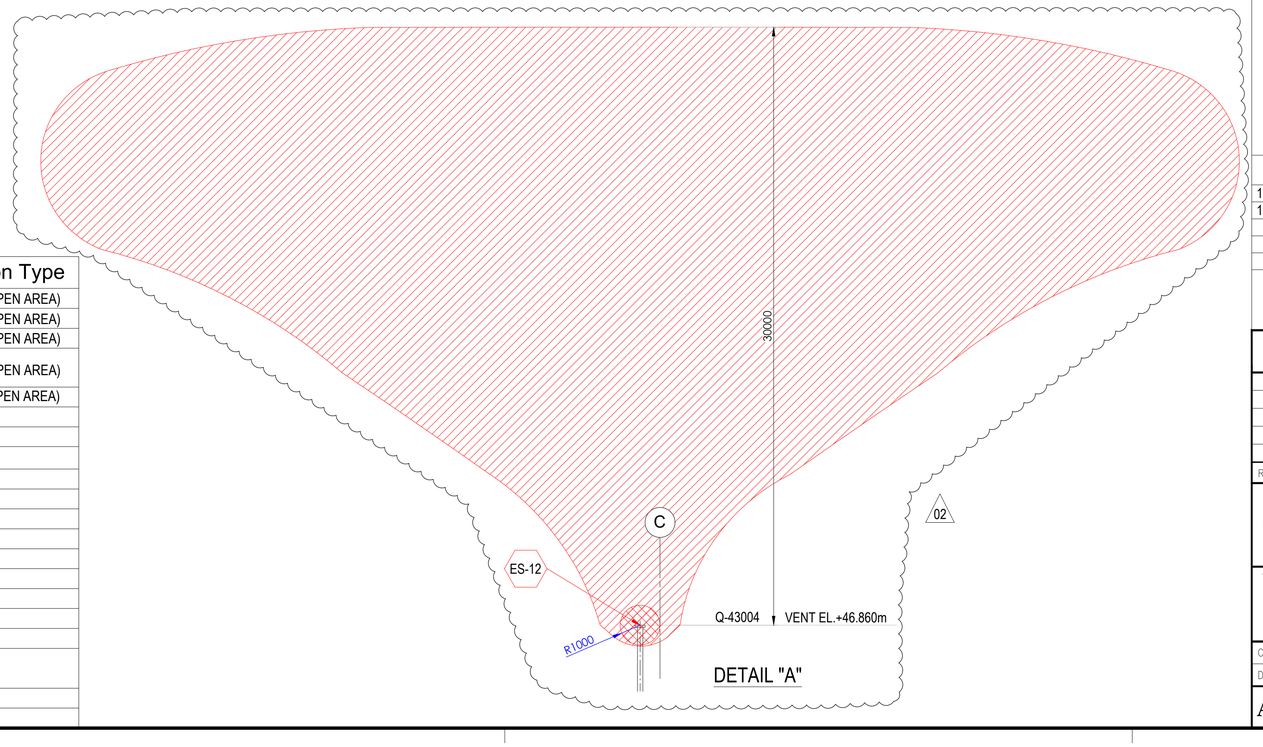



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-XV-008	: On-Off Actuated Ball Valve - Vessel V-25001B Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001592	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		AF770301301 (Ball valve SN: 2400620130001)			
Manufacturer	Rotork			**Model**		CP/S-035-080A/AA			
Cert No.	Declaration of Conformity by Manufacturer			**Equipment Ambient Temp.**		-20 °C to + 40 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T5	**IP Rating**	IP66/IP67

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-XV-008	: On-Off Actuated Ball Valve - Vessel V-25001B Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001592		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-XV-008	: On-Off Actuated Ball Valve - Vessel V-25001B Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001592		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01
							Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-28	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-28T07:48:30.092Z	PROVERLIS Digitaly signed by Luca Mussi 2025-01-30T11:41:22.494Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

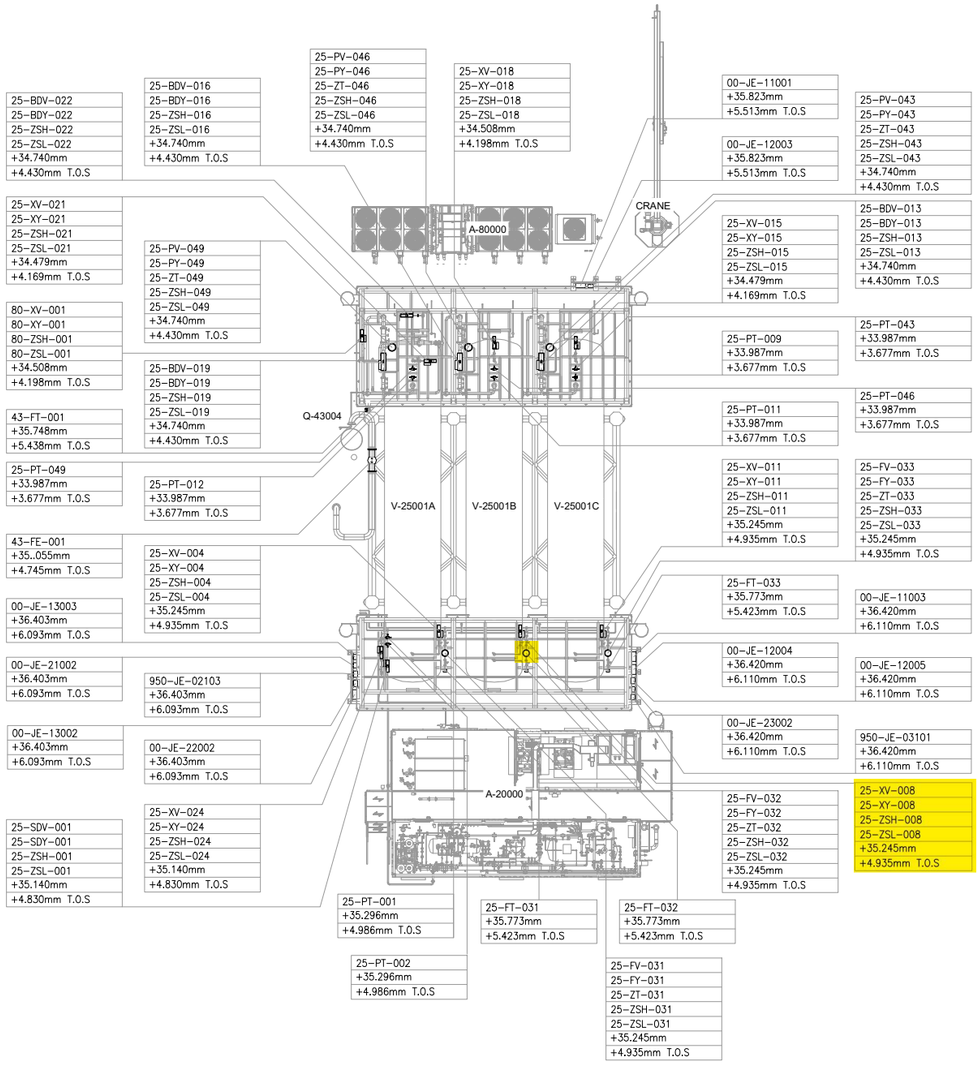

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081
REV.: 2_A | DATE: 07/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90–DDL–IN–DL–40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 B

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

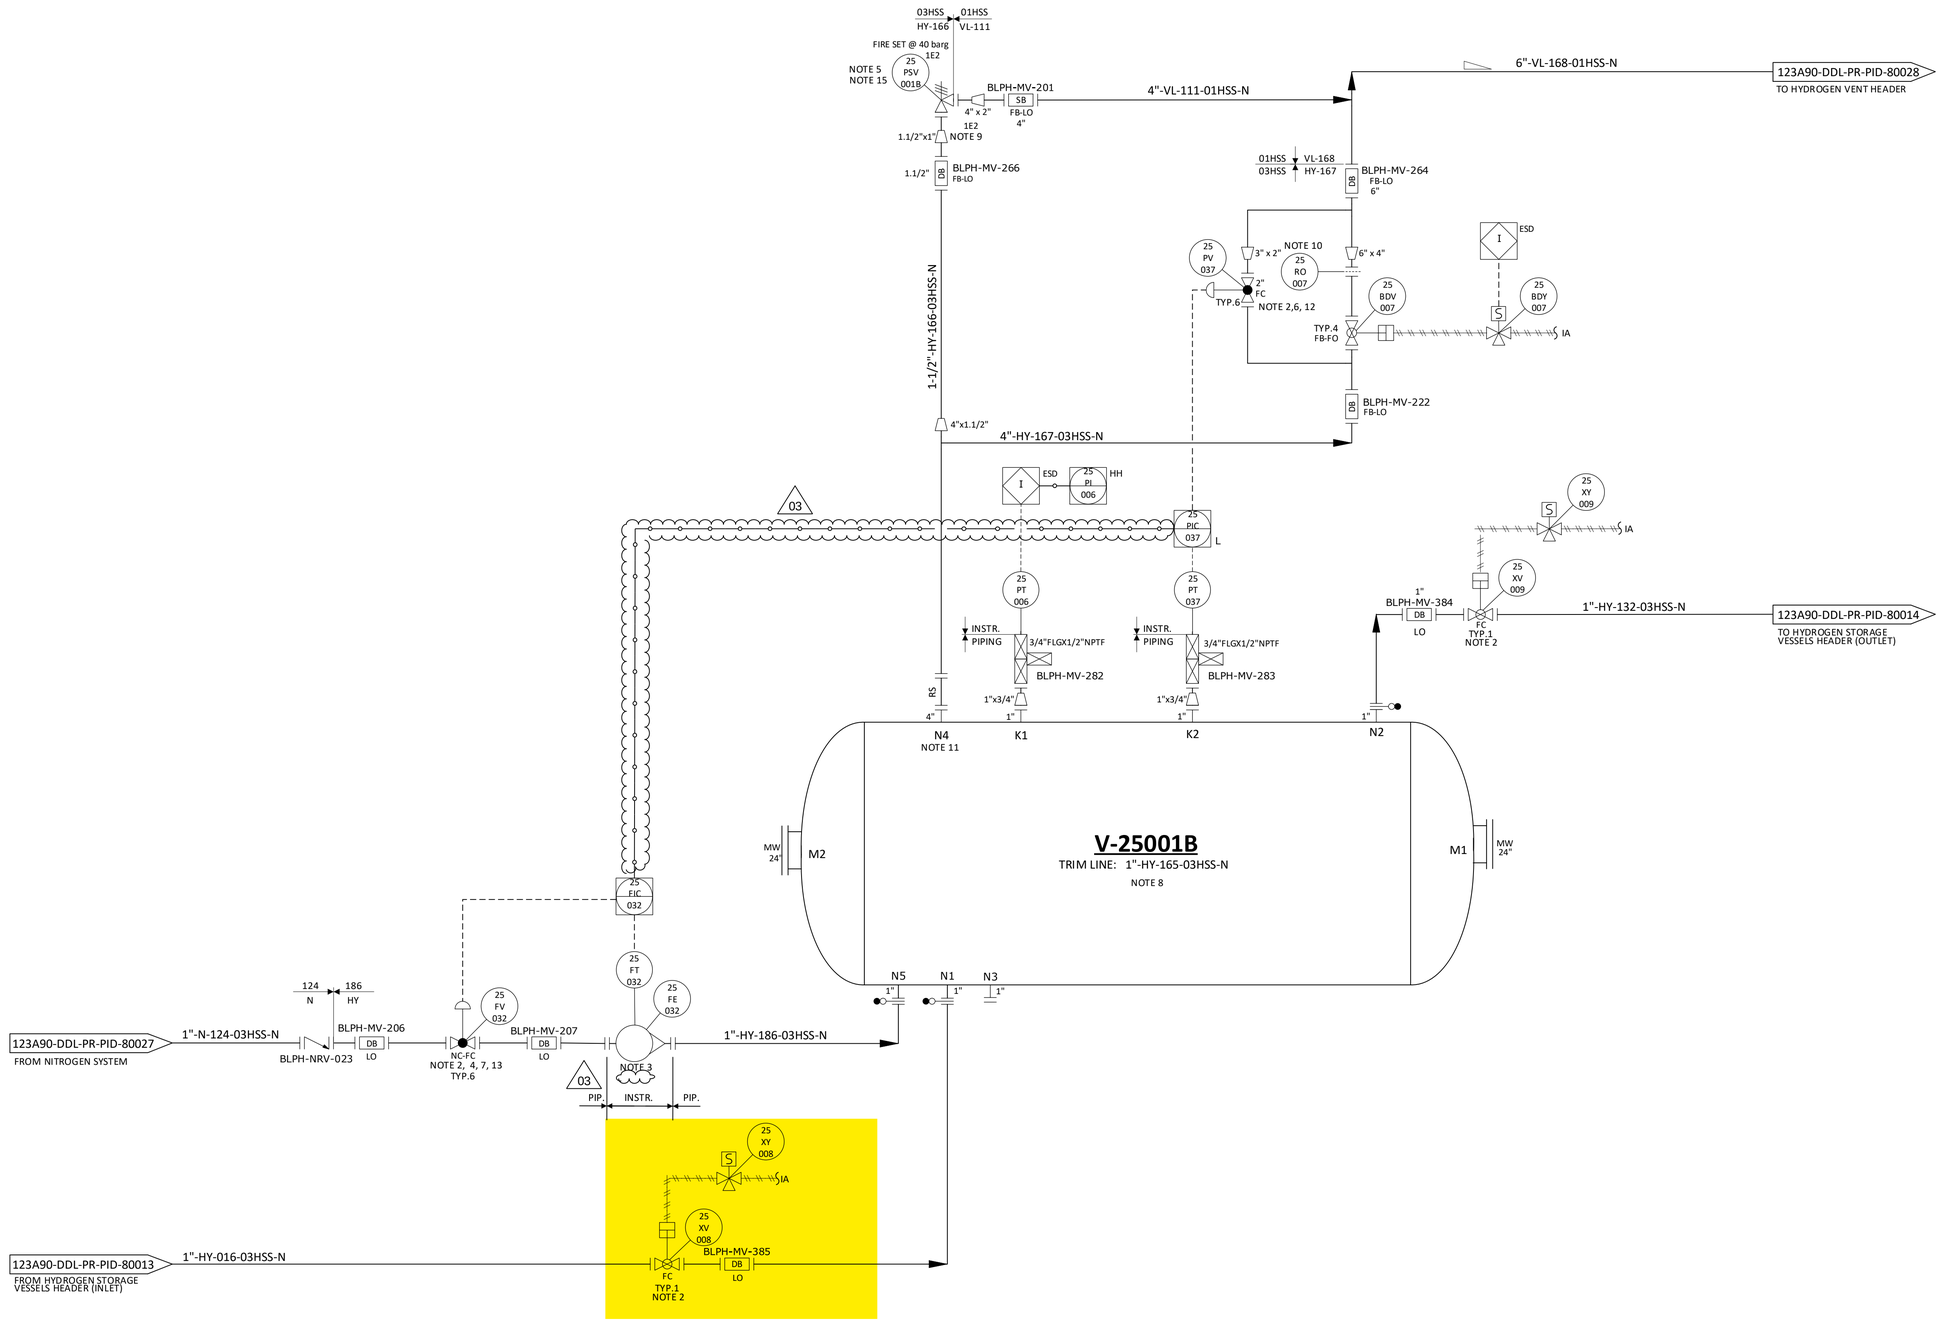

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-032) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. (03)
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-037 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC."PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-037 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. (03)
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-032 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-037 HAS FAILED TO CLOSE.
15. 25-PSV-001B SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL B

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80016	SHEET 001	REV. 03


File Name : FILE_NAME

DRAWING NO.


REV. 00

TYPICAL INSTRUMENTATION VALVE

TYP.1 (XV - ON OFF VALVES)

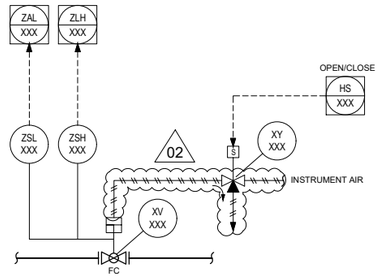


TYP.2 (SDV - SAFETY NO CRITICAL VALVES)

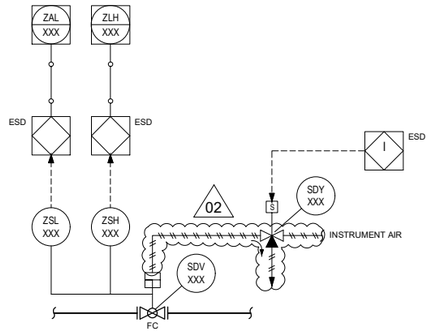


02

TYP.4 (BDV - SAFETY NO CRITICAL VALVES)

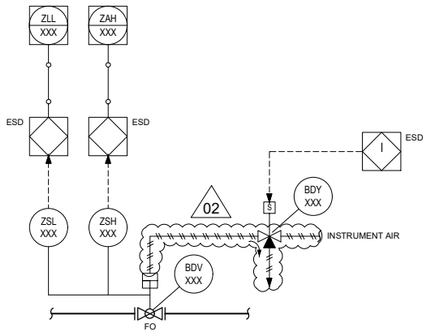

02

TYP.6 (CONTROL VALVES - CRITICAL)

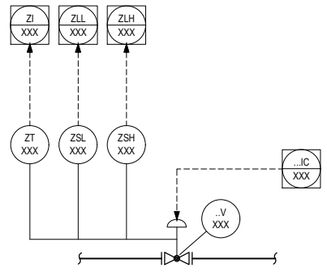


INSTRUMENT SYMBOLOGY DEFINITION

MEANINGS OF IDENTIFICATION LETTERS
THIS TABLE APPLIES TO THE FUNCTIONAL IDENTIFICATION OF INSTRUMENTS

	FIRST- LETTER		SUCCEEDING-LETTER		
	MEASURED OR INITIATING VARIABLE	MODIFIER	READOUT OR PASSIVE FUNCTION	OUTPUT FUNCTION	MODIFIER
A	ANALYSIS		ALARM		
C				CONTROL	
E			SENSOR (PRIMARY ELEMENT) ELEMENT		
F	FLOW RATE	RATIO (FRACTION)			
G			GLASS VIEWING DEVICE		
H	HAND				HIGH
I			INDICATE		
L	LEVEL				LOW
O			ORIFICE, OPEN		
P	PRESSURE, VACUUM				
R		RELIEF			
S		SAFETY		SWITCH	
T	TEMPERATURE			TRANSMIT	
V				VALVE, DAMPER, LOUVER	
X	UNCLASSIFIED				
Y				AUXILIARY DEVICES	
Z	POSITION DIMENSION				

NOTE: FOR FURTHER EXPLANATORY NOTES, REFER TO ANSI/ISA-5.1

TYP.7 (CONTROL VALVES - NOT CRITICAL)



NOTES

1. FOR GENERAL NOTES AND PIPING SYMBOLOGY SEE DRAWINGS: 123A90-DDL-PR-PID-80009 AND 123A90-DDL-PR-PID-80010.
2. DELETED.

HOLDS

1 DELETED 02


REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND | ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
INSTRUMENTATION SYMBOLOGY

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80042	SHEET 001	REV. 02

File Name :

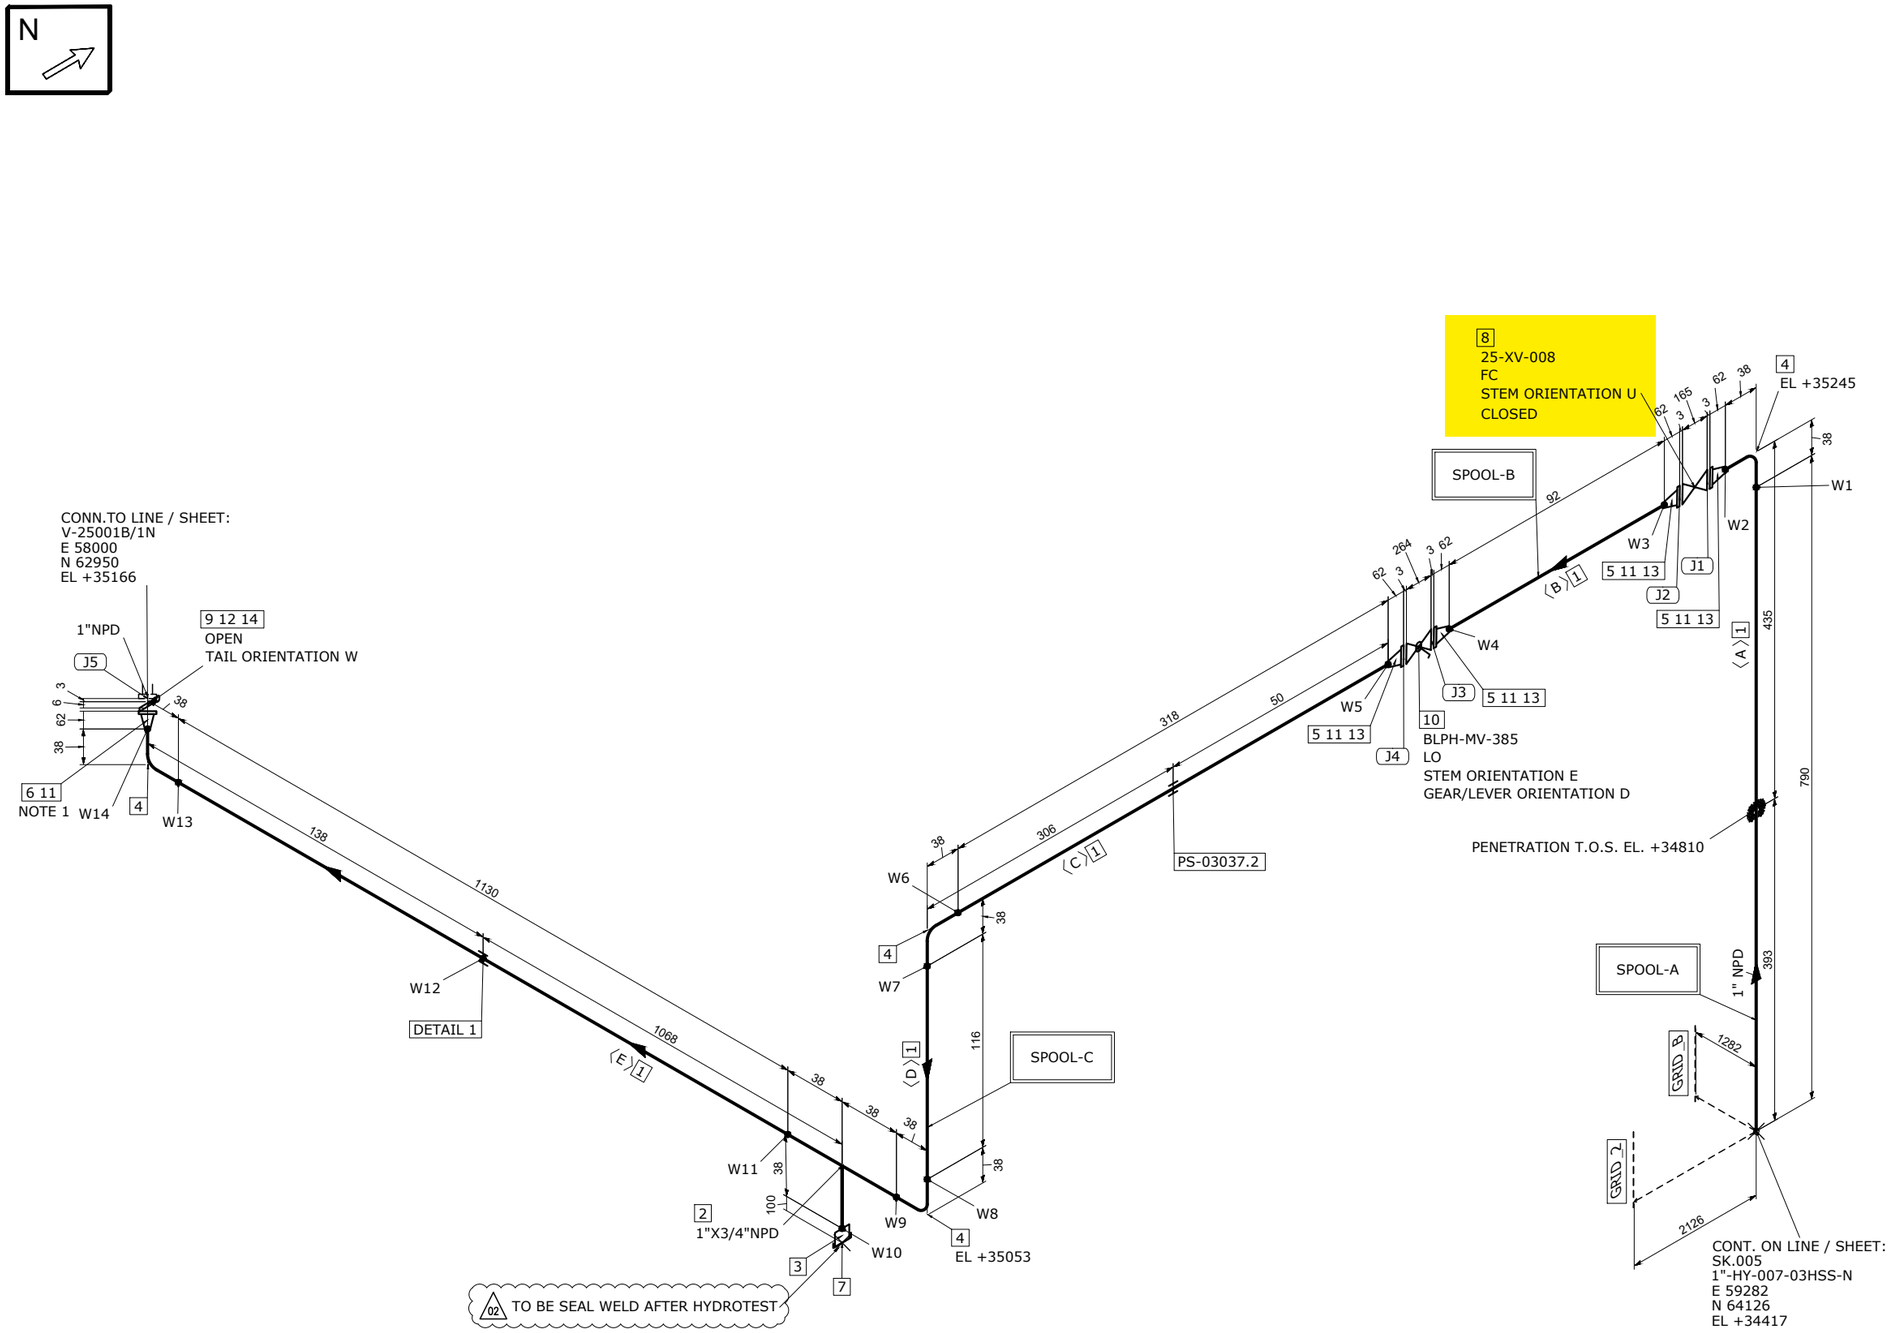

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.4M	6.2
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.4
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	3/4	BW
W11	1	BW
W12		FW
W13	1	BW
W14	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	790	BEVEL	BEVEL
B	1	92	BEVEL	BEVEL
C	1	318	BEVEL	BEVEL
D	1	116	BEVEL	BEVEL
E	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-03037.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	2	4.0
B	2	3.9
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-016-03HSS-N

SK.010

LINE DATA								
NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		


REFERENCE DOCUMENTS	
P&ID	123A90-DDL-PR-PID-80016
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES
1.JACKSCREWS POSITION N/S

MASTER

CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE	N/A
DRAWN	STAFF SRL
CHECKED	RT
APPROVED	LM
DATE	17-09-2024
FORMAT	A3
DRAWING NO.	123A90-FDL-PP-DI-00010
SHEET / OF	1/1
REV.	02

E33

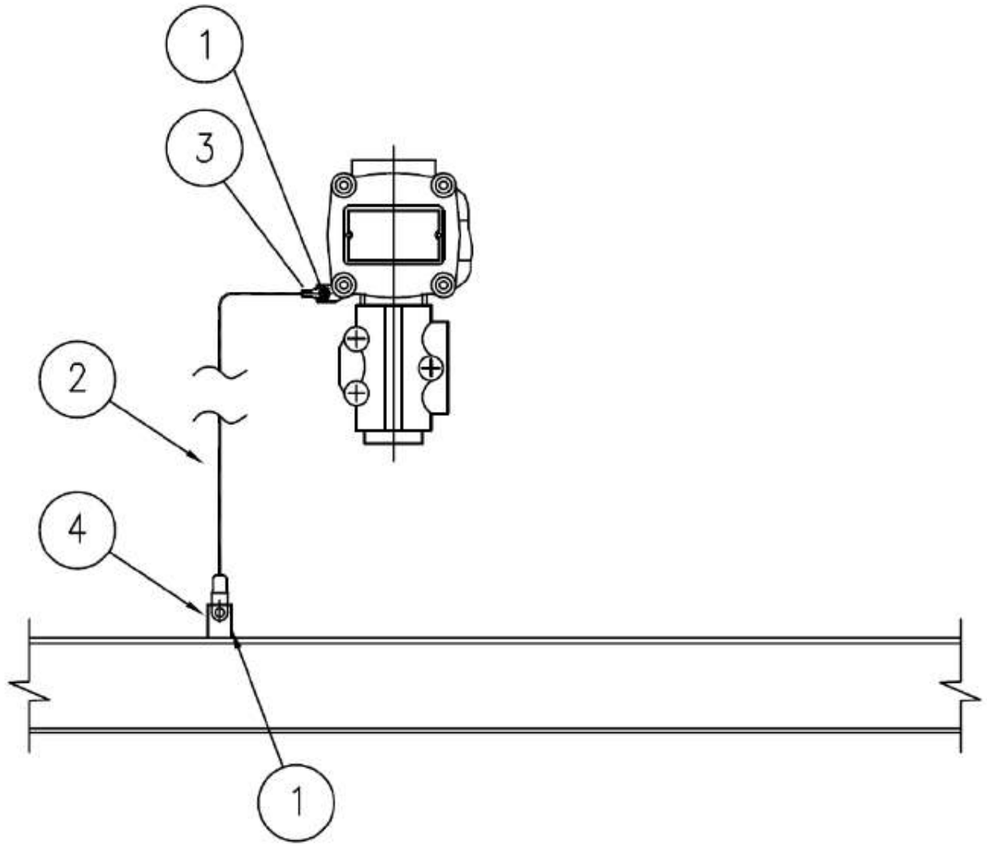

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

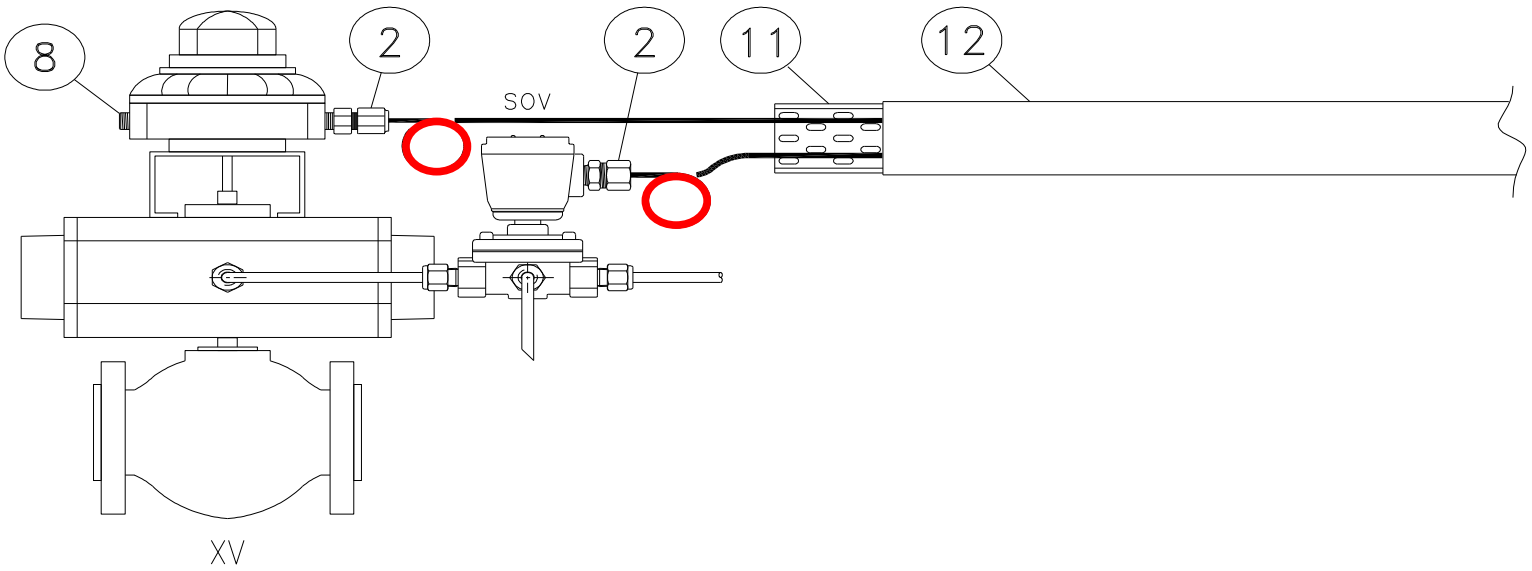

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**

REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy


CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Pneumatic Hook-Ups	Sh. 6 of 6 Date: 08/07/2024 Rev. 01

PNEUMATIC HOOK-UP FOR ON-OFF VALVES

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40078**

REV.:	DATE:	SIGNATURE:
1_B	06/11/24	G.Randi

ROSETTI MARINO SpA

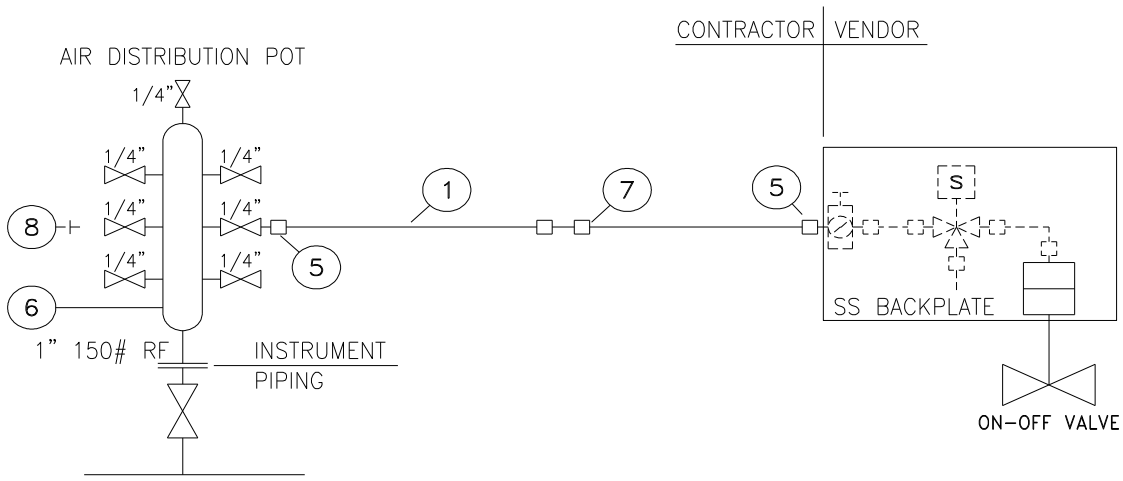



INSTRUMENT TAG	
1	25-BDV-022
2	25-BDV-005
3	25-BDV-007
4	25-BDV-010
5	25-BDV-013
6	25-BDV-016
7	25-BDV-019
8	25-SDV-001
9	25-SDV-023
10	25-XV-004
11	25-XV-006
12	25-XV-008
13	25-XV-009
14	25-XV-011
15	25-XV-012
16	25-XV-014
17	25-XV-015
18	25-XV-017
19	25-XV-018
20	25-XV-020
21	25-XV-021
22	25-XV-024
23	50-XV-001
24	50-XV-002
25	50-XV-003
26	50-XV-004
27	80-XV-001
28	64-SDV-001
29	50-XV-005
30	

NOTE:
(1) For Air Distribution Pot quantities see material take-off on sh. 4


POS.	NORM/STD CODE	DESCRIPTION	SIZE/CONNECTION TYPE	Q.TY
8		SS316 PLUG	1/4" NPT	Note 1
7		SS316 UNION	1/2" O.D. x 1/2" O.D.	N. 1
6		SS316 AIR DISTRIBUTION POT	1" 150#RF - N. 7 1/4" BALL VALVES	Note 1
5		SS316 MALE CONNECTOR	1/4" NPT x 1/2" O.D.	N. 2
1		SS 316L TUBING	1/2" x 0,049"Thk	10 m


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

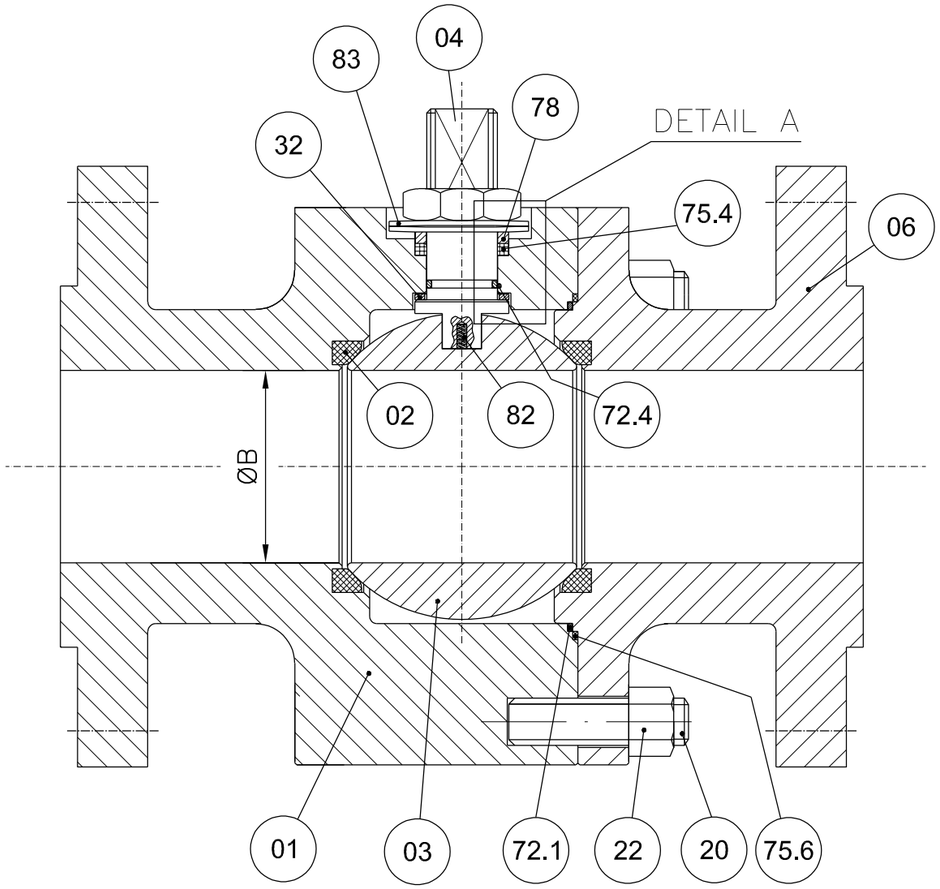




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301



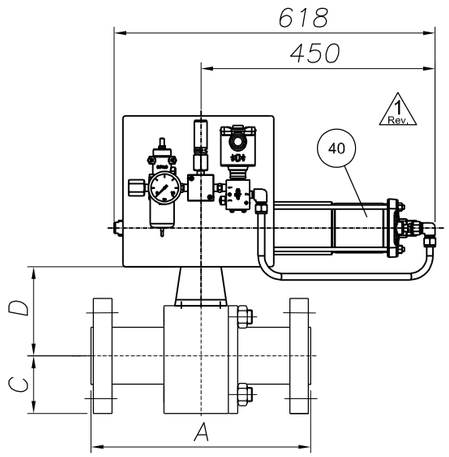

ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

Fluitek Valves

DRAWING NOT IN SCALE

DRAWN: S.Madahar — DATE: 26/02/2024
CHK'D: D.Barcella — DATE: 26/02/2024
APPV'D: L.Mora — DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWING NAME: **D240062-08**

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-008		25
	2	Service				HYDROGEN STORAGE TANK V-25001B INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80016		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-016-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-008(9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-008 (9, 17) - Soldo SS		25-ZSH-008 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR	25-SDV-023	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE

CONFORMITY DECLARATION ACCORDING TO EUROPEAN DIRECTIVE 2014/68/UE

DICHIARAZIONE DI CONFORMITÀ AI SENSI DELLA DIRETTIVA EUROPEA 2014/68/UE

THE MANUFACTURER
IL FABBRICANTE

Name Nome	FLUITEK ORSENIGO VALVES S.R.L.
Legal representative and role Legale rappresentante	P. Belotti – Managing Director
Declaration of conformity nr. Dichiarazione di conformità no.	240062
Sede legale Legal office	Via Dei Livelli di Sopra, 7/5 – 24060 COSTA DI MEZZATE (BERGAMO) – ITALY
Sede produttiva Operational office	Via Dei Livelli di Sopra, 7/5 – 24060 COSTA DI MEZZATE (BERGAMO) – ITALY
E-mail E-mail	info@fluitekvalves.com
Website Sito internet	www.fluitekvalves.com
Telephone Telefono	+39 035 666 501
Fax Fax	+39 035 666 5047

DECLARE THAT THE FOLLOWING PRESSURE EQUIPMENT
DICHIARA CHE I SEGUENTI ACCESSORI A PRESSIONE

JOB	FOV Pos.	Serial Number	Client Item	PO N.	Description	Quantity
240062	001	2400620010001	10	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	002	24000620020001	20	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	003	2400620030001	30	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	004	2400620040001	40	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	005	2400620050001	50	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	006	2400620060001	60	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	007	2400620070001	70	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	008	2400620080001	80	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	009	2400620090001	90	1724000204 123A90A	Ball valve 1-1/2'' 300#	**1**
240062	010	2400620100001	100	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	011	2400620110001	110	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	012	2400620120001	120	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	013	2400620130001	130	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	014	2400620140001	140	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	015	2400620150001	150	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	016	2400620160001	160	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	017	2400620170001	170	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	018	2400620180001	180	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	019	2400620190001	190	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	020	2400620200001	200	1724000204 123A90A	Ball valve 1'' 300#	**1**

Fluitek Valves	**CONFORMITY DECLARATION ACCORDING TO EUROPEAN DIRECTIVE 2014/68/UE** DICHIARAZIONE DI CONFORMITÀ AI SENSI DELLA DIRETTIVA EUROPEA 2014/68/UE

240062	021	2400620210001	210	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	022	2400620220001	220	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	023	2400620230001	230	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	024	2400620240001	240	1724000204 123A90A	Ball valve 1-1/2'' 150#	**1**
240062	025	2400620250001	250	1724000204 123A90A	Ball valve 1'' 150#	**1**
240062	026	2400620260001	260	1724000204 123A90A	Ball valve 1-1/2'' 150#	**1**
240062	027	2400620270001	270	1724000204 123A90A	Ball valve 1'' 150#	**1**
240062	028	2400620280001	280	1724000204 123A90A	Ball valve 1'' 150#	**1**

MET THE REQUIREMENTS OF DIRECTIVE 2014/68/UE
SONO CONFORMI AI REQUISITI DELLA DIRETTIVA 2014/68/UE

Conformity assessment procedure used: Procedura di valutazione di conformità utilizzata:	Module H annex III of Directive 2014/68/UE Modulo H Allegato III della Direttiva 2014/68/UE
Notified Body charged of conformity assessment: Organismo Notificato incaricato della valutazione di conformità:	Bureau Veritas (Notified Body No.1370) Bureau Veritas (Ente Notificato N°1370)
Not armonized standards applied to design and manufacture: Norme non armonizzate applicate alla progettazione e alla fabbricazione:	ASME B16.34, ASME VIII, ASME IX, UNI EN 1503 Part.2 ASME B16.34, ASME VIII, ASME IX, UNI EN 1503 Part.2
Classificazione dei fluidi condotta in conformità ai requisiti del	Regolamento CLP CE 1272/2008 Fluid group: **1**

Place COSTA DI MEZZATE (BG), Italy
Luogo COSTA DI MEZZATE (BG), Italia

Date 14/01/2025
Data



Signature
Firma

Fluitek Valves	**DECLARATION OF CONFORMITY ATEX 2014/34/EU** *Dichiarazione di Conformità ATEX 2014/34/EU*	**Cert. DDC No.** **240062 ATEX**

GENERAL INFORMATION – *INFORMAZIONI GENERALI*

Customer ***Cliente***	ROSETTI MARINO S.P.A.		
P. Order ***Ordine***	1724000204 123A90A	**Item/s** ***Item/s***	ALL
FOV Job ***Commessa FOV***	240062	**Position/s** ***Posizione/i***	ALL
Subject ***Oggetto***	BALL VALVE		
Date of execution ***Data di esecuzione***	24/07/2024		

STATEMENT – *DICHIARAZIONE*

We declare that this product has been manufactured in accordance with the Euporean Directive 2014/34/EU to the classification II 2 G/D Tx c.
Technical standards and specifications used are referenced in the Fluitek Orsenigo valves above stated internal job.
The equipment satisfies the provision of directive 2014/34/EU and of standards EN 1127-1, UNI CEI EN ISO 80079-36:2016.
Technical file deposited to Notified Body TUV RHEINLAND 0035.

REMARKS – *NOTE*

SIGNATURE – *FIRME*

Inspection Authority ***Ente Ispettivo***	**Customer Inspector** ***Ispettore Cliente***	**Quality Control** ***Controllo qualità***
		FLUITEK ORSENIGO VALVES S.R.L. Q.C.

rotork Fluid Systems	EU Declaration of Conformity	Rif. JOB nr: AF7703

Manufacturer: Rotork Fluid Systems S.r.l.

Address: Via Padre Jacques Hamel, 138/B
55016 Porcari, Lucca – Italy
Tel. +39 0583 2221
Fax. +39 0585 091362

Section PED: ☐ Applicable ☒ Not Applicable

Under its sole responsibility declares that the items specified below have been designed, manufactured, inspected and tested as required by the relevant provisions of the Pressure Equipment Directive 2014/68/UE.
The equipment has been submitted to the following conformity assessment procedures:

☐**Module H**: **CE-1370-PED-H-RTK 001-23-ITA** **Serial No.:**

☐ **Module H1**: **CE-1370-PED-H1-RTK 001-23-ITA** **Serial No.:**
CE-1370-PED-H1D-RTK 001-20-ITA
CE-1370-PED-H1D-RTK 002-20-ITA

Notified Body: Bureau Veritas Italia SPA Viale Monza 347 20126 MI – Italy
NB Number: 1370

Description: The pressure equipment is a part pressure of pneumatic actuator that is product of Rotork Fluid Systems for quart turn and linear valve. It is composed by a cylinder can and two flanges packaged by tie rods.

Other technical standards and specifications used:
VSR rev.1995; RACCOLTA "M"; RACCOLTA "S"; AD 2000-Merkblatt; ASME VIII Div.1/Div.2; ASME II; EN 13445-3

Section ATEX:

Under its sole responsibility declares that the actuators model:

☒ **GP/GH, CP/CH, RP/RH, LP/LH, HPG, HPL MARKED:** **II 2 G Ex h IIC T5 Gb X**
II 2 D Ex h IIIC T100°C Db X
IP 66M/67M

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / EN 60529

☐ **CQP/CQH MARKED:** **II 2 G Ex h IIC T5 Gb X**
II 2 D Ex h IIIC T100°C Db X
IP 66/68

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / EN 60529

☐ **GO, GOL, EH MARKED:** **II 2 G Ex 60079-46 II_ T_ _ X**
(II 2 D Ex 60079-46 III_ T_ _X)
IP 6_

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / IEC 60079-46, EN 60529

The conformity has been evaluated according to ***Annex VIII (Article 13, Point 1. (b)(ii))*** *of* ***ATEX 2014/34/EU*** *directive.*
TECHNICAL FILE N° TR 219 *(Receipt Number:* ***BVI/ATEX/ITA/24/080*** *Bureau Veritas ITA)*

Section API 6DX: ☐ Applicable ☒ Not Applicable

Under its sole responsibility, the Manufacturer declares that the items specified above have been designed, manufactured, inspected, and tested as required by the applicable provisions of the current edition of the product standard API 6DX and all addenda.


SIGNED ON BEHALF OF ROTORK FLUID SYSTEMS S.R.L. (authorized representative of):

Legal Representative: Metin Gerceker **Signature:**


Place / date: Porcari / 05/02/2025

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

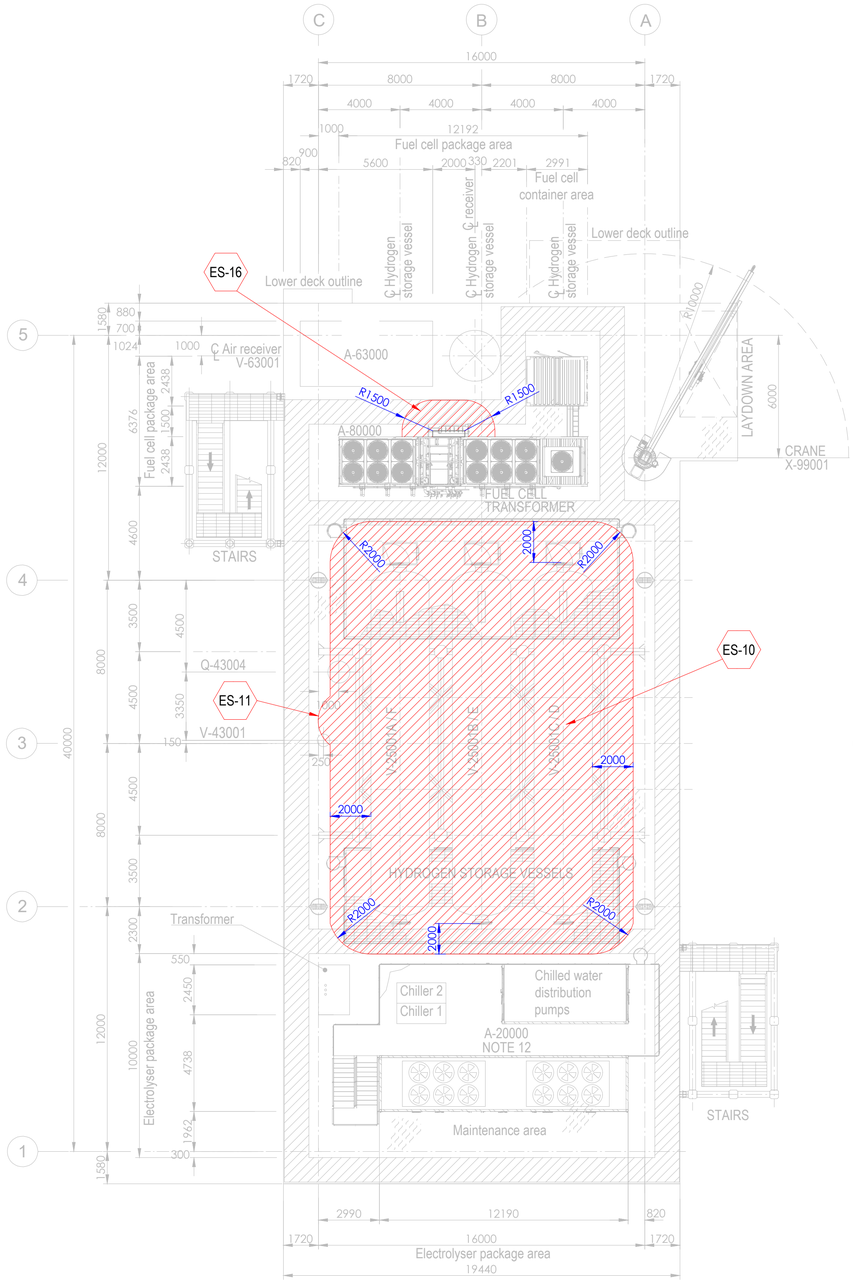


PLAN ON UPPER DECK
EL+30.310 T.O.S.

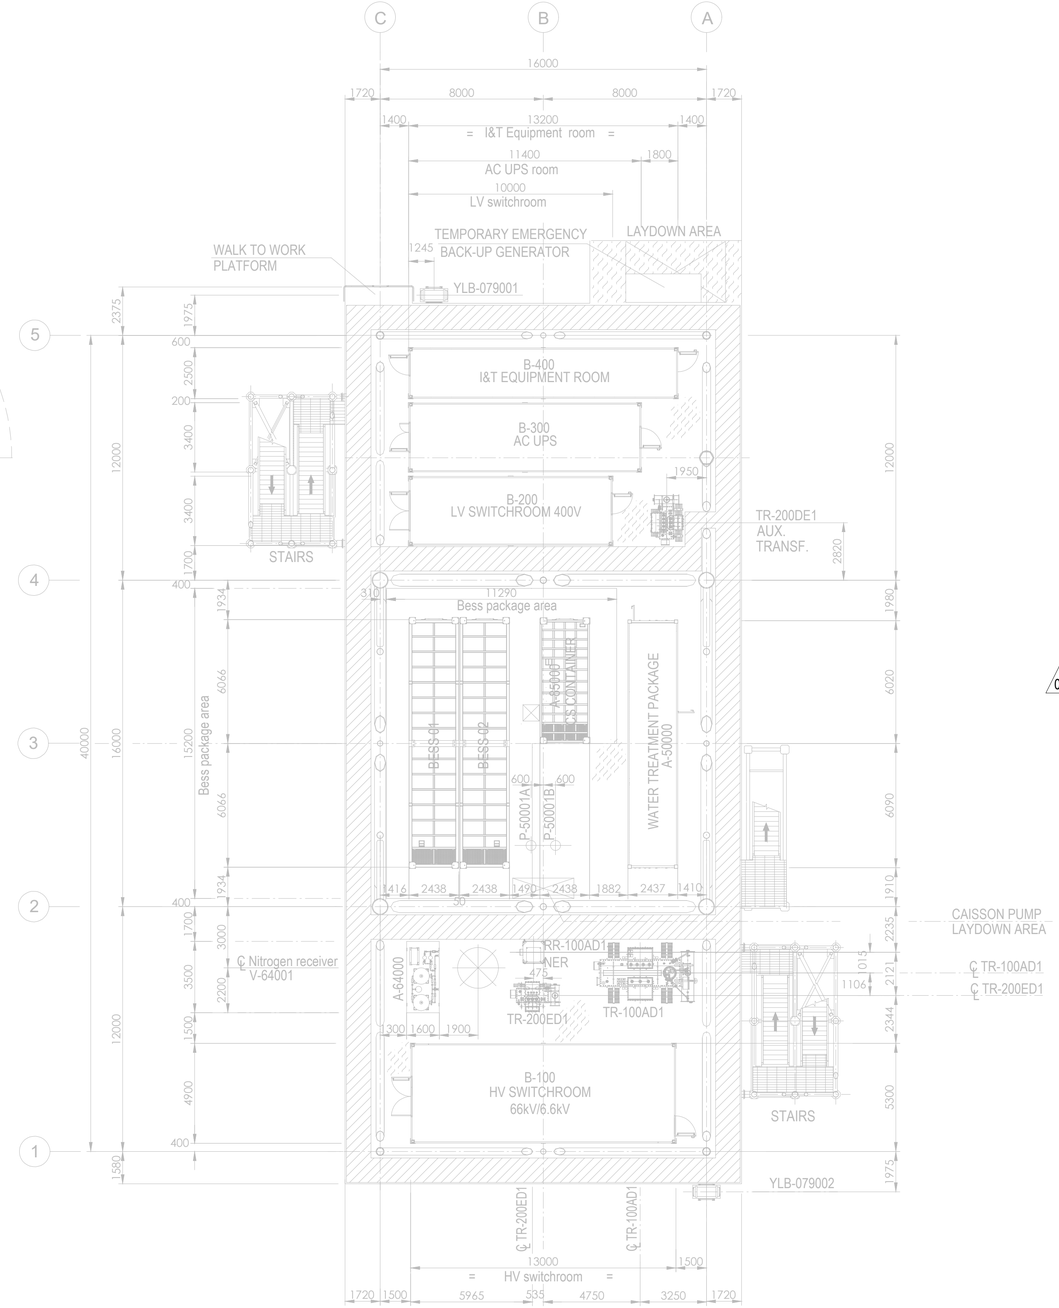

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

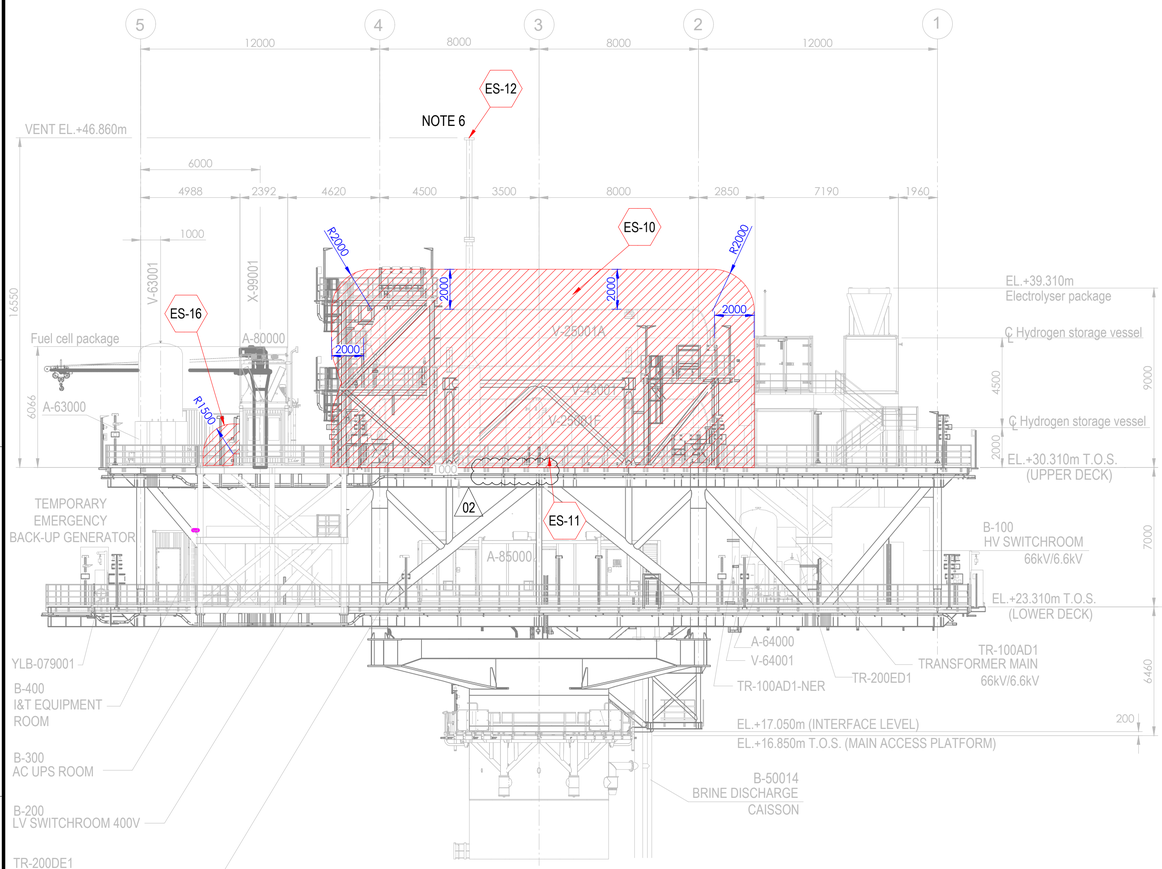



ELEVATION LOOKING EAST

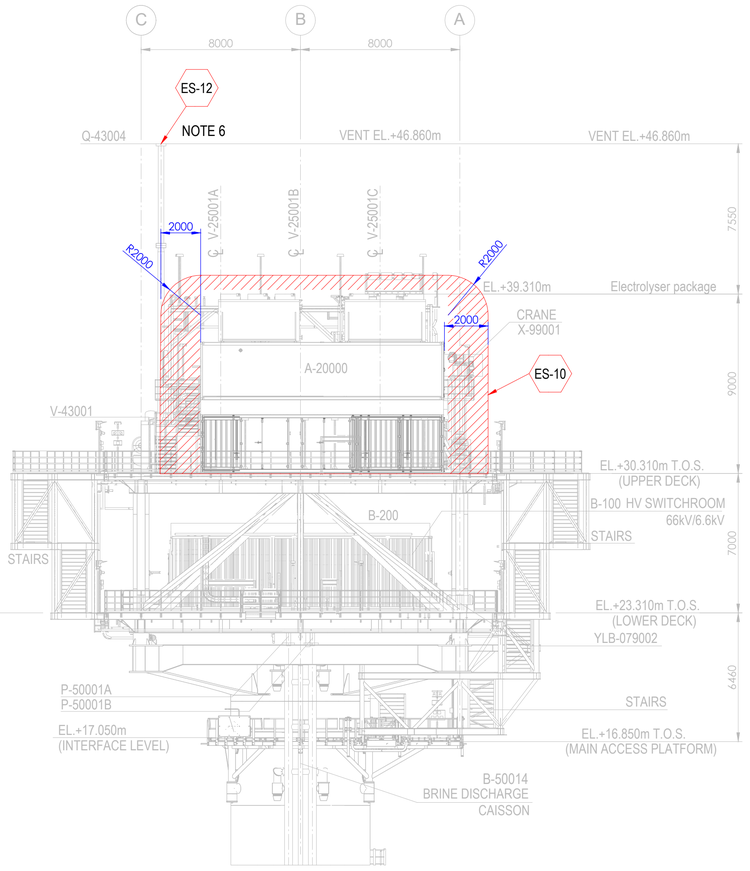

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

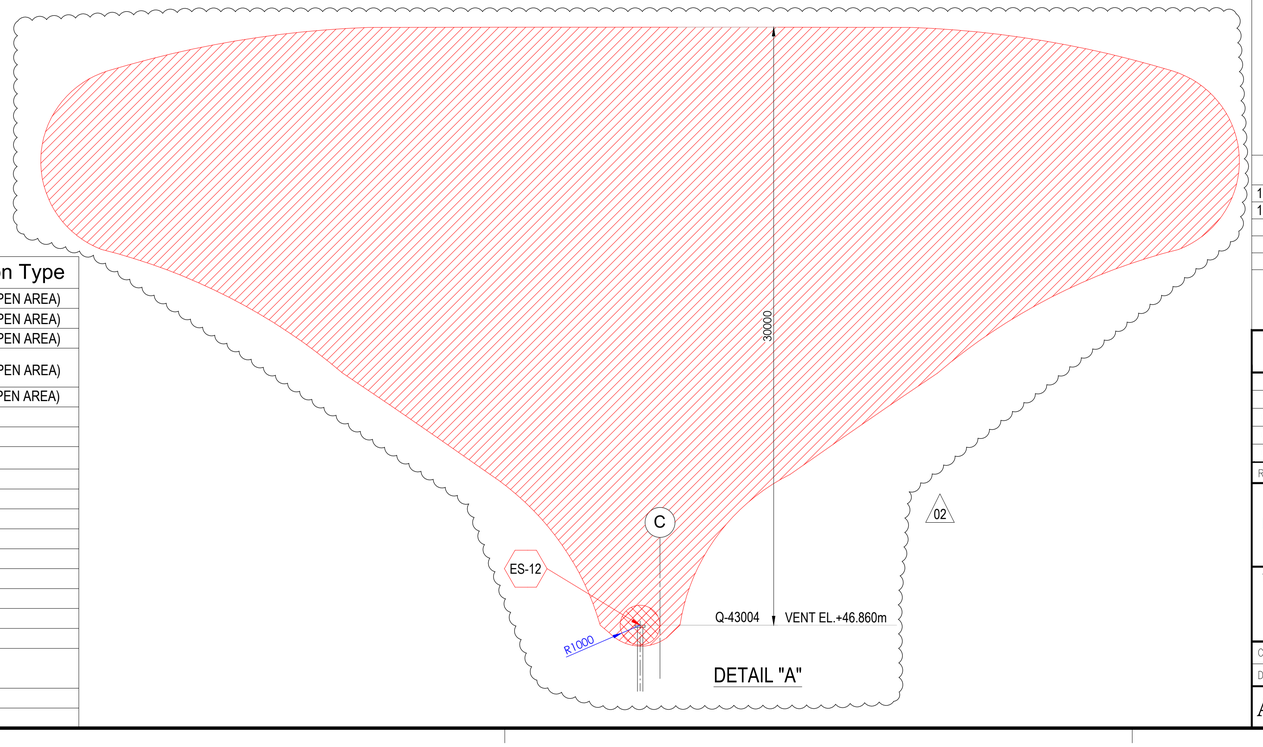



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-XV-011	: On/Off Valve - Vessel V-25001C Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80017
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001594	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		AF770301501 (Ball valve SN: 2400620150001)			
Manufacturer	Rotork			**Model**		CP/S-035-080A/AA			
Cert No.	Declaration of Conformity by Manufacturer			**Equipment Ambient Temp.**		-20 °C to + 40 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T5	**IP Rating**	IP66/IP67

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-XV-011	: On/Off Valve - Vessel V-25001C Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80017
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001594		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-XV-011	: On/Off Valve - Vessel V-25001C Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80017		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001594	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-28	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-28T07:48:47.000Z	PROVERLIS Digitaly signed by Luca Mussi 2025-01-30T11:41:31.763Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

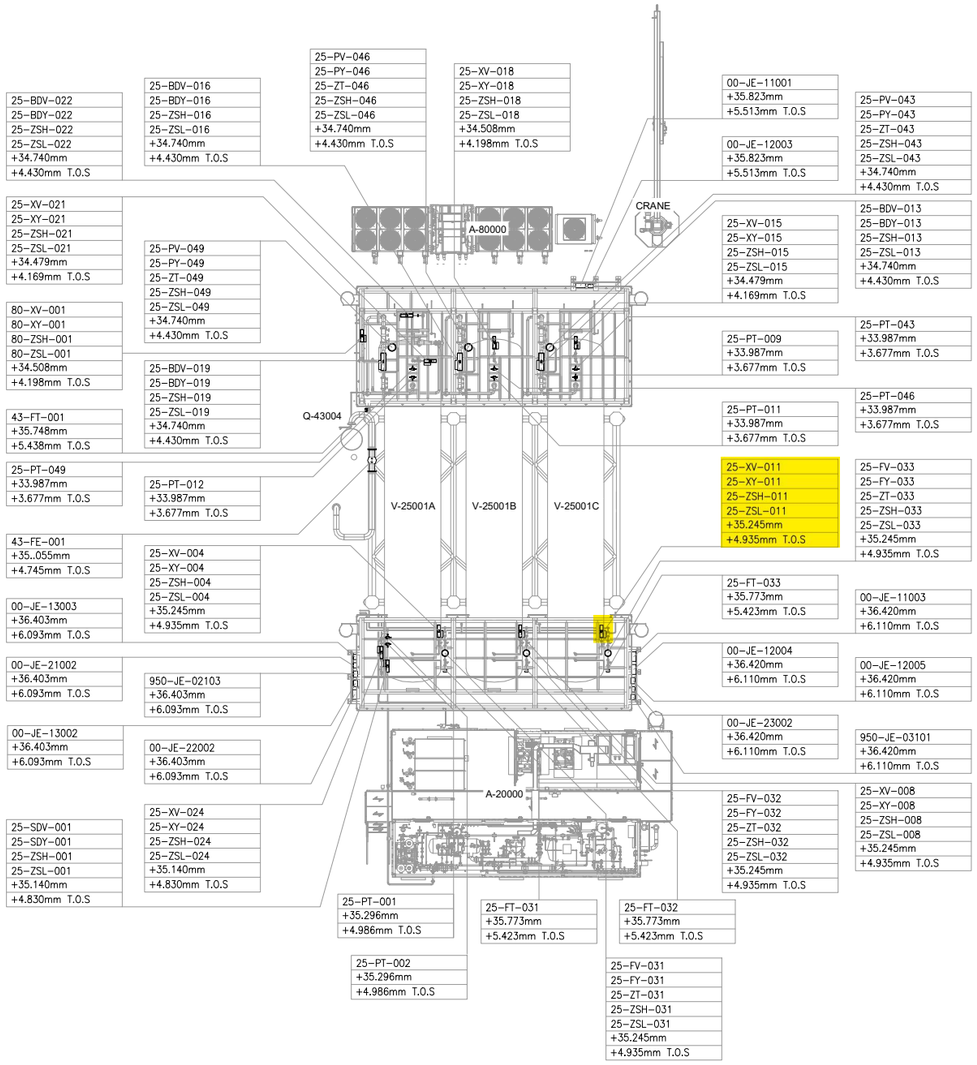

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm

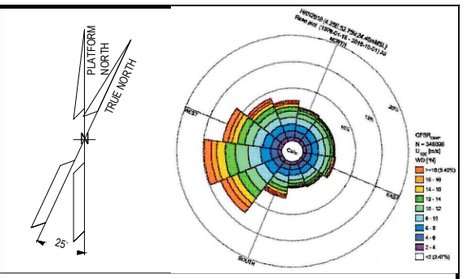

NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING_NO. DRAWING_NO.

REV. REV

V-25001_C

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

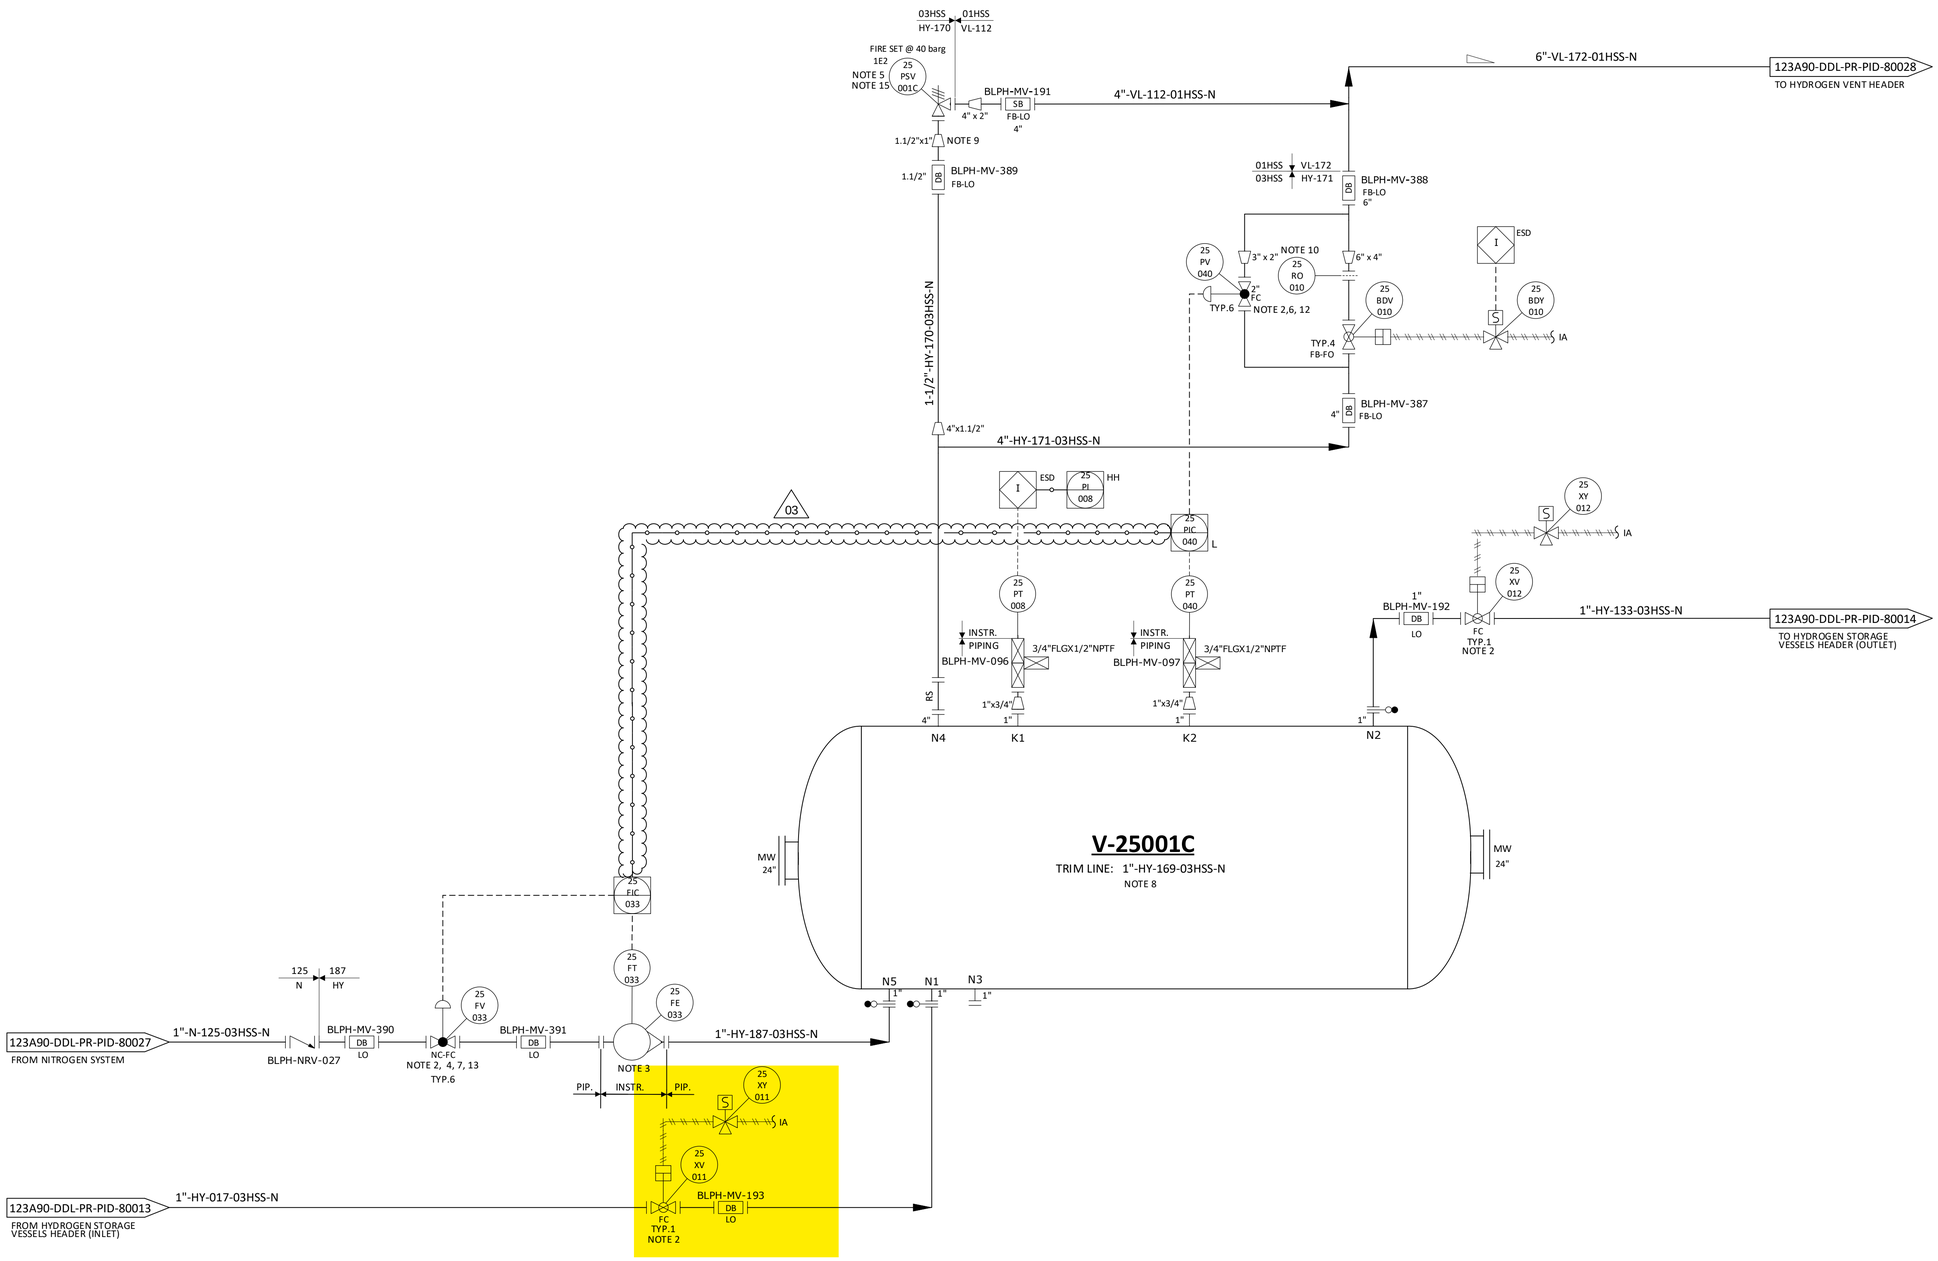

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-033) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-040 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-040 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-033 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-040 HAS FAILED TO CLOSE.
15. 25-PS-V001C SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL C

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE		
A1	DRAWING NO. 123A90-DDL-PR-PID-80017			SHEET 001	REV. 03


File Name = FILE_NAME

DRAWING NO.


REV. 00

TYPICAL INSTRUMENTATION VALVE

TYP.1 (XV - ON OFF VALVES)

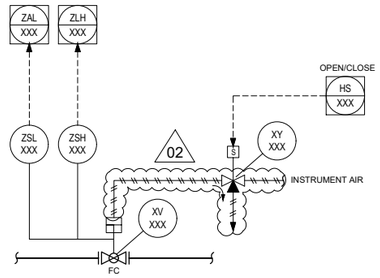


TYP.2 (SDV - SAFETY NO CRITICAL VALVES)

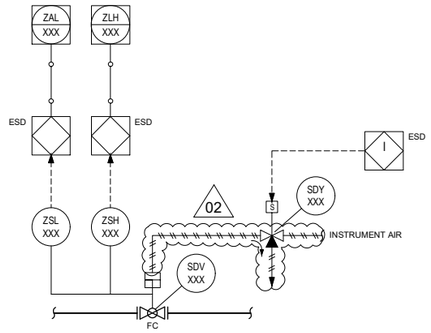


02

TYP.4 (BDV - SAFETY NO CRITICAL VALVES)

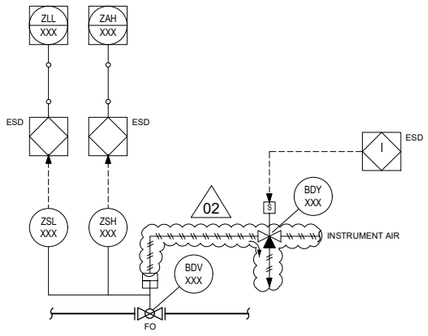

02

TYP.6 (CONTROL VALVES - CRITICAL)

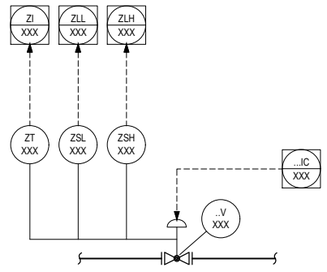


INSTRUMENT SYMBOLOGY DEFINITION

MEANINGS OF IDENTIFICATION LETTERS
THIS TABLE APPLIES TO THE FUNCTIONAL IDENTIFICATION OF INSTRUMENTS

	FIRST- LETTER		SUCCEEDING-LETTER		
	MEASURED OR INITIATING VARIABLE	MODIFIER	READOUT OR PASSIVE FUNCTION	OUTPUT FUNCTION	MODIFIER
A	ANALYSIS		ALARM		
C				CONTROL	
E			SENSOR (PRIMARY ELEMENT) ELEMENT		
F	FLOW RATE	RATIO (FRACTION)			
G			GLASS VIEWING DEVICE		
H	HAND				HIGH
I			INDICATE		
L	LEVEL				LOW
O			ORIFICE, OPEN		
P	PRESSURE, VACUUM				
R		RELIEF			
S		SAFETY		SWITCH	
T	TEMPERATURE			TRANSMIT	
V				VALVE, DAMPER, LOUVER	
X	UNCLASSIFIED				
Y				AUXILIARY DEVICES	
Z	POSITION DIMENSION				

NOTE: FOR FURTHER EXPLANATORY NOTES, REFER TO ANSI/ISA-5.1

TYP.7 (CONTROL VALVES - NOT CRITICAL)



NOTES

1. FOR GENERAL NOTES AND PIPING SYMBOLOGY SEE DRAWINGS: 123A90-DDL-PR-PID-80009 AND 123A90-DDL-PR-PID-80010.
2. DELETED.

HOLDS

1 DELETED 02


REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND | ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
INSTRUMENTATION SYMBOLOGY

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80042	SHEET 001	REV. 02

File Name :

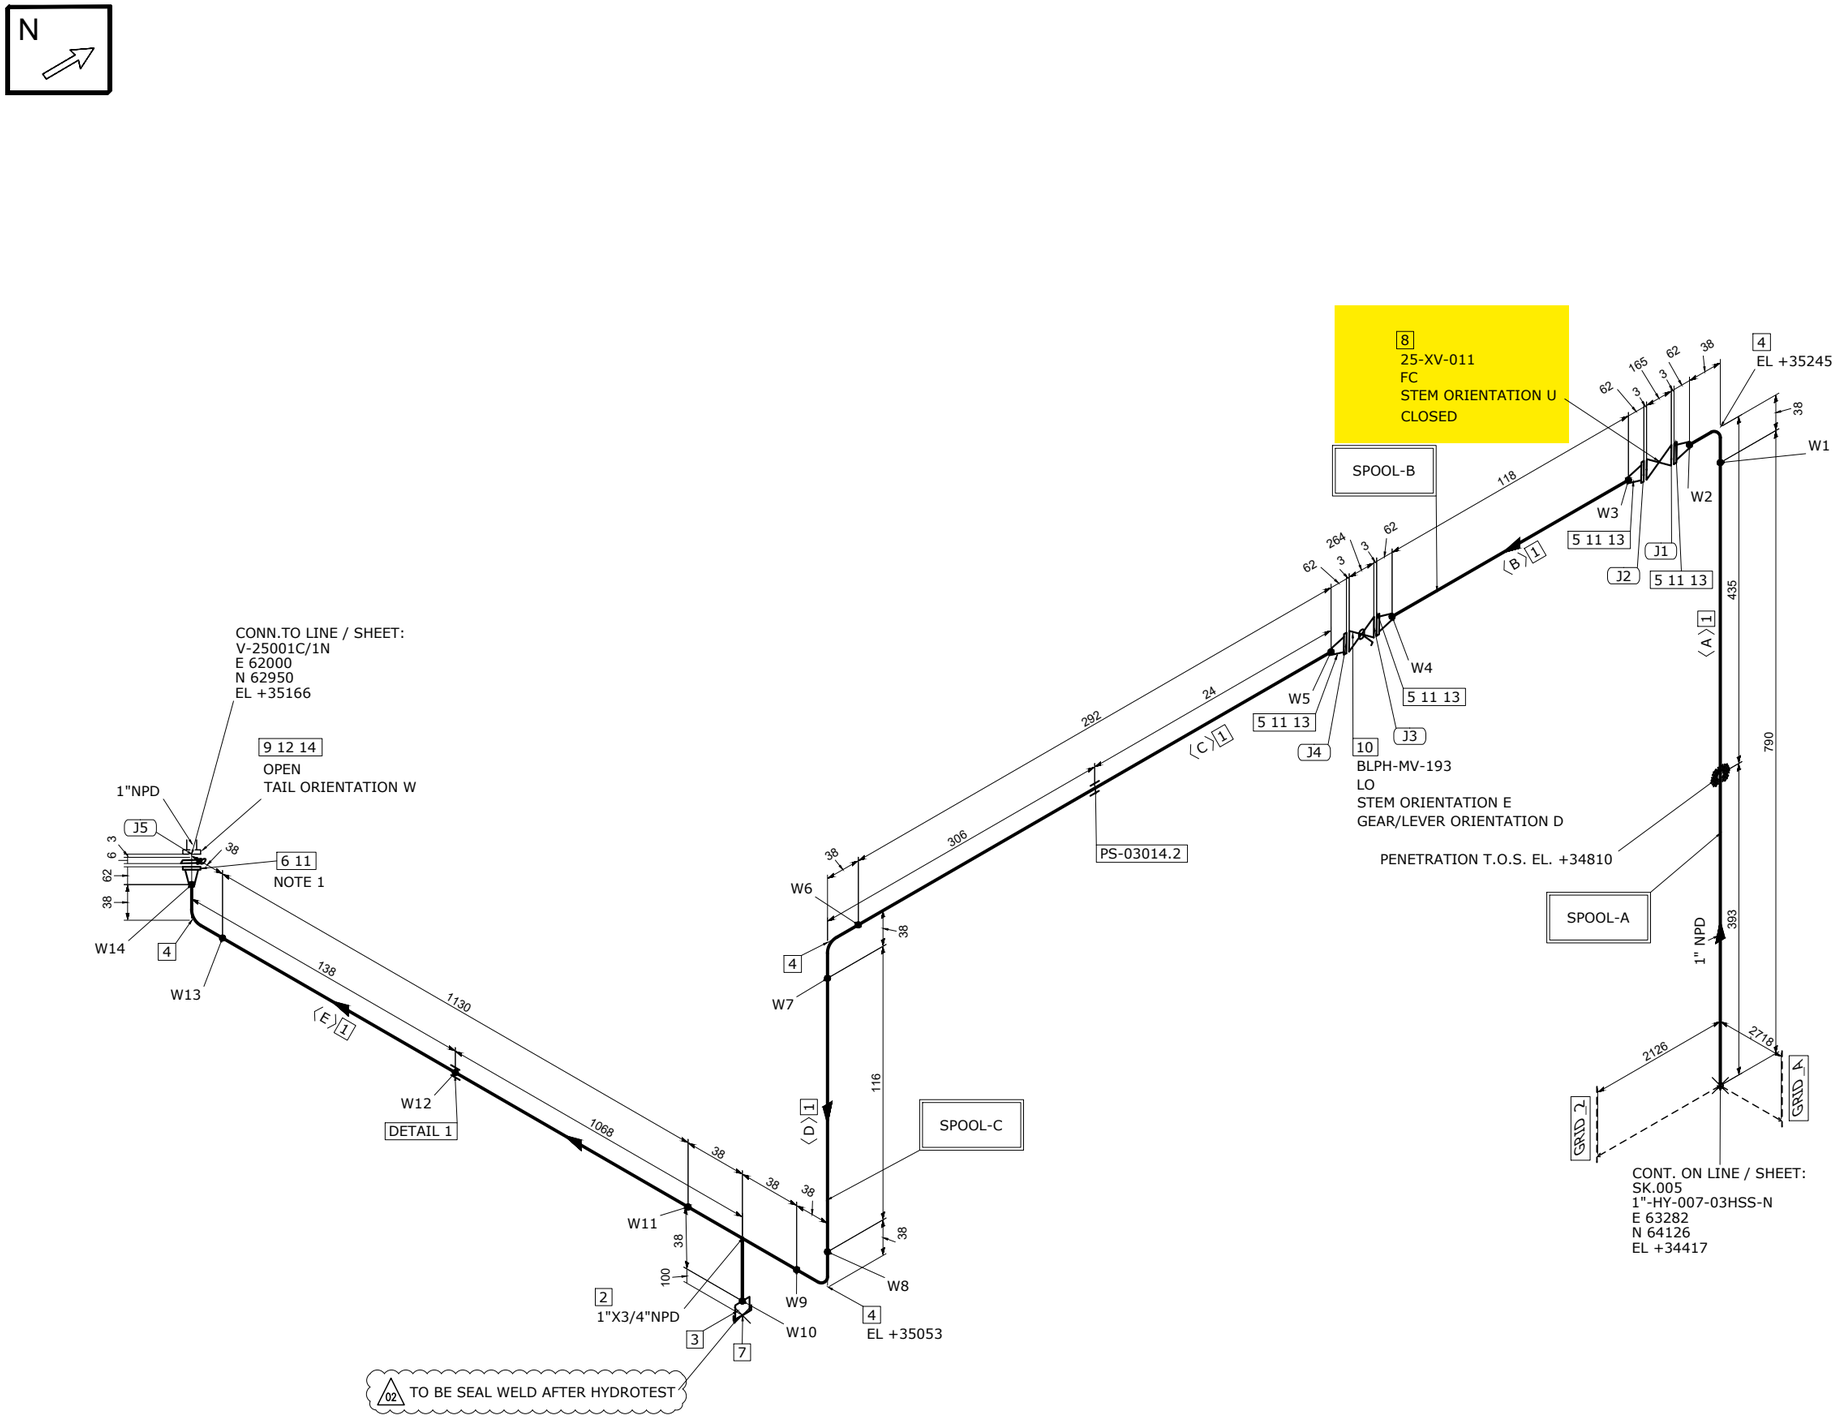

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.4M	6.2
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.4
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	3/4	BW
W11	1	BW
W12		FW
W13	1	BW
W14	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	790	BEVEL	BEVEL
B	1	118	BEVEL	BEVEL
C	1	292	BEVEL	BEVEL
D	1	116	BEVEL	BEVEL
E	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-03014.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	2	4.0
B	2	4.0
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-017-03HSS-N
SK.011

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A
DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024
FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00011 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40	[barg]	TEMP. -29 / 80	[°C]	
HEAT TRACING	--		TEST	PRESS. 60	[barg]	TEMP. AMB	MEDIUM Water	

REFERENCE DOCUMENTS


P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION N/S

MASTER

E33

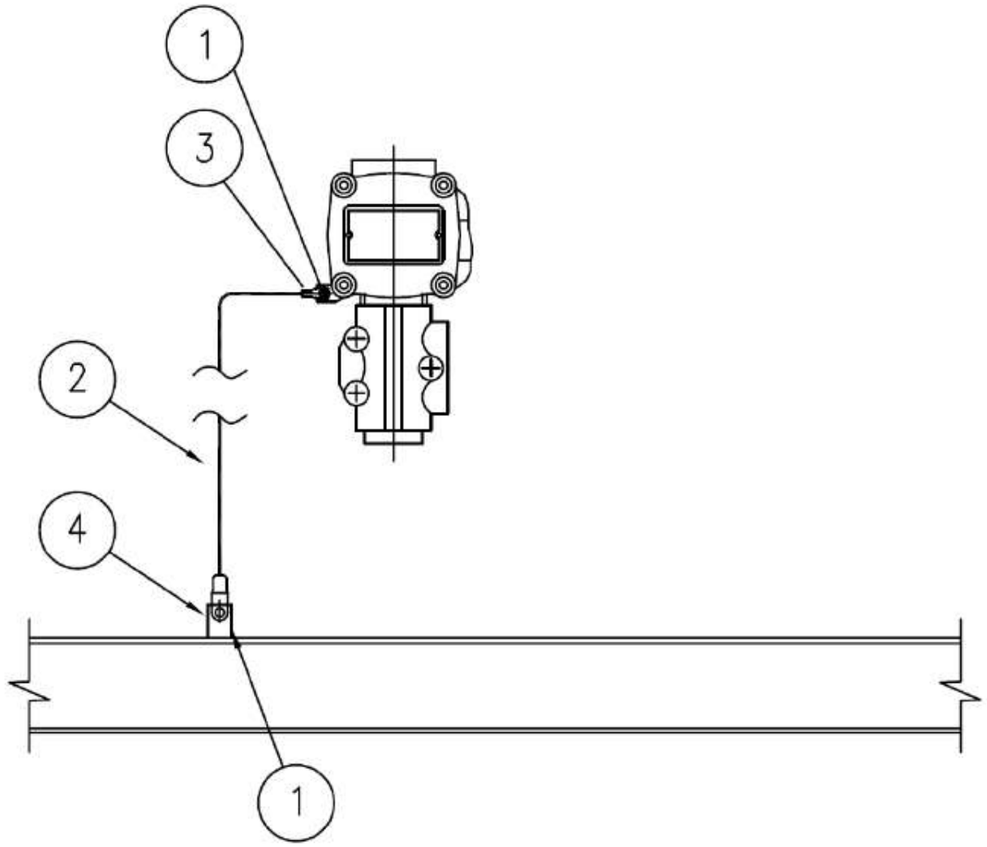

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

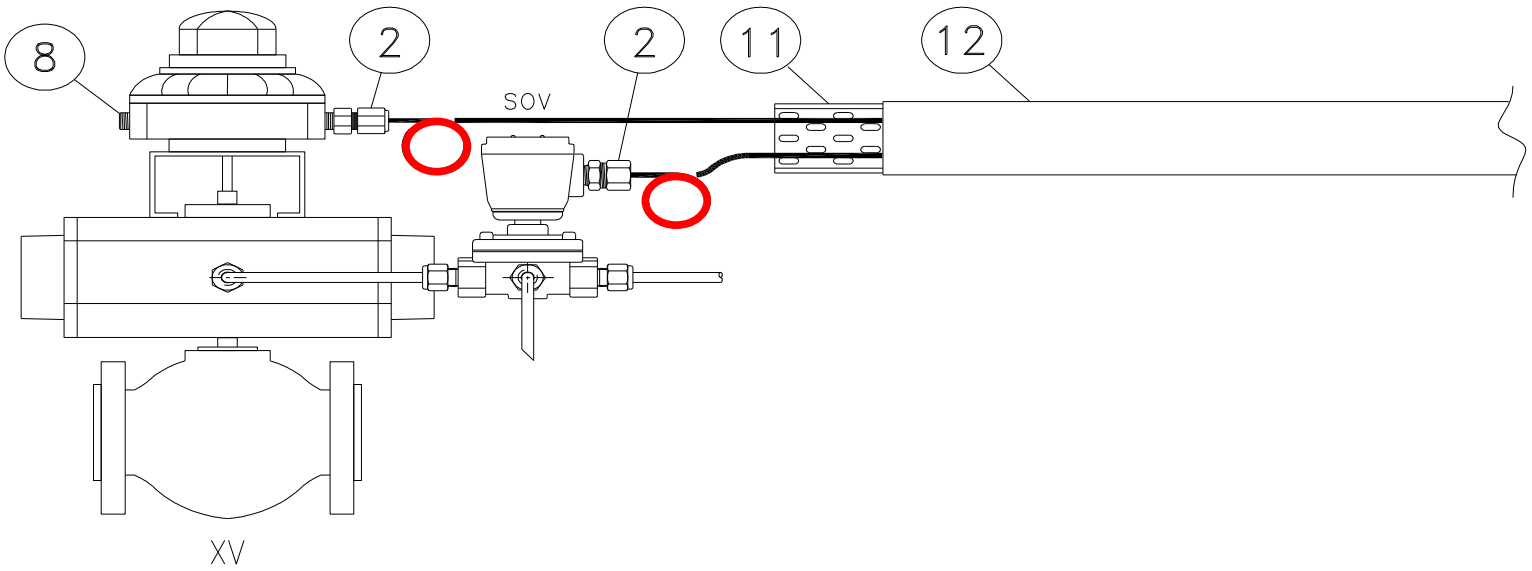

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**

REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy


CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Pneumatic Hook-Ups	Sh. 6 of 6 Date: 08/07/2024 Rev. 01

PNEUMATIC HOOK-UP FOR ON-OFF VALVES

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40078**

REV.:	DATE:	SIGNATURE:
1_B	06/11/24	G.Randi

ROSETTI MARINO SpA

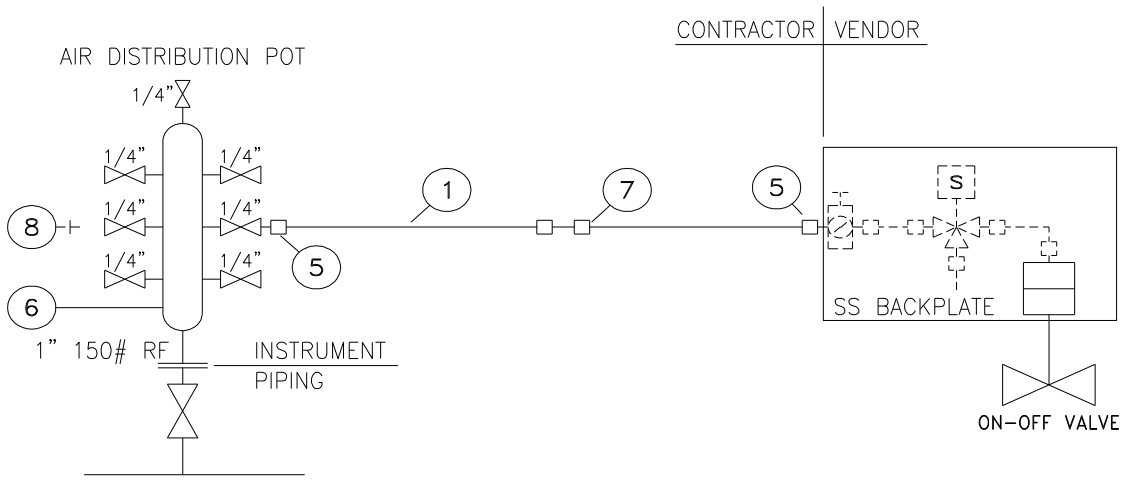



INSTRUMENT TAG	
1	25-BDV-022
2	25-BDV-005
3	25-BDV-007
4	25-BDV-010
5	25-BDV-013
6	25-BDV-016
7	25-BDV-019
8	25-SDV-001
9	25-SDV-023
10	25-XV-004
11	25-XV-006
12	25-XV-008
13	25-XV-009
14	25-XV-011
15	25-XV-012
16	25-XV-014
17	25-XV-015
18	25-XV-017
19	25-XV-018
20	25-XV-020
21	25-XV-021
22	25-XV-024
23	50-XV-001
24	50-XV-002
25	50-XV-003
26	50-XV-004
27	80-XV-001
28	64-SDV-001
29	50-XV-005
30	

NOTE:
(1) For Air Distribution Pot quantities see material take-off on sh. 4


POS.	NORM/STD CODE	DESCRIPTION	SIZE/CONNECTION TYPE	Q.TY
8		SS316 PLUG	1/4" NPT	Note 1
7		SS316 UNION	1/2" O.D. x 1/2" O.D.	N. 1
6		SS316 AIR DISTRIBUTION POT	1" 150#RF - N. 7 1/4" BALL VALVES	Note 1
5		SS316 MALE CONNECTOR	1/4" NPT x 1/2" O.D.	N. 2
1		SS 316L TUBING	1/2" x 0,049"Thk	10 m


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

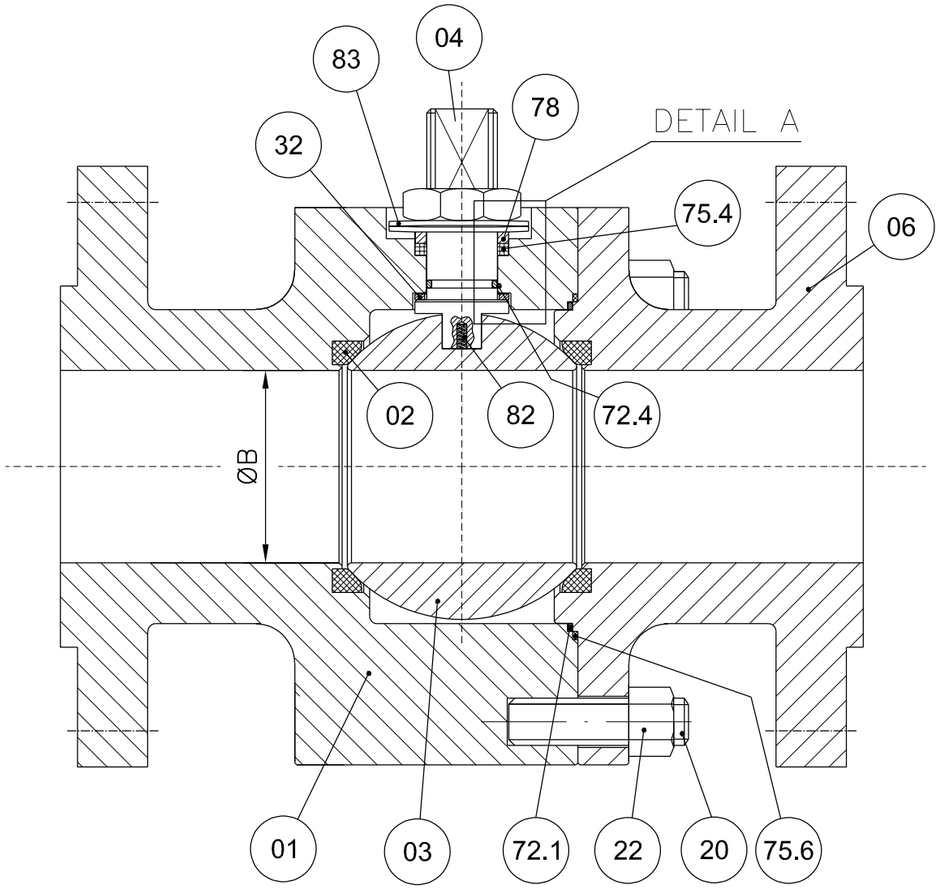




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DRAWN: S.Madahar — DATE: 26/02/2024
CHK'D: D.Barcella — DATE: 26/02/2024
APPV'D: L.Mora — DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWING NAME: **D240062-08**

Rev.: 2

GENERAL	1	Tag Number		Location		25-XV-011		25
	2	Service				HYDROGEN STORAGE TANK V-25001C INLET		
	3	P&ID Number		Area Classification		123A90-DDL-PR-PID-80017		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-017-03HSS-N		
	5	Line Size and Schedule	Inlet		Outlet	1" / 3.38 mm		1" / 3.38 mm
	6	Line Material		Line Insulation		ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State		Phase		GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure		Full Vacuum	[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature		Minimum	Maxi [°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of		Design		Close :	(12)	Open : (12)
	17	Operation (seconds)		Actual		Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size		Body Form		1"		FULL BORE
	22	Body Material		Bonnet Type		ASTM A182 F316/316L		(*)
	23	Connections		Rating		FLANGED ASME B16.5		#300
	24	Flange Finish		Gasket Material		RF		Inside the valve (*) (38)
	25	Packing		Lubrication & Isolation		A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer		Type		Rotork		Spring Return
	31	Model No.		Size		CP/S		035-100A/BA
	32	Actuator Orientation		Actuator Form		Horizontal		Cylinder
	33	Ingress Protection		Certification		IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply		Min	Max Design	4 barg	10 barg	11 barg
	35	Action on Air Failure		Action on Power Failure		CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-011 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed		Limit Switch Open		25-ZSL-011 (9, 17) - Soldo SS		25-ZSH-011 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set		Handwheel		(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection		Electrical Class		No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity		Fabrication Code		-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve		Model		-		-
	48	Check Valve		Mounting		-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

94	IFR	25-XV-009	floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR	25-XV-011	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR	25-XV-012	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR	25-XV-014	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR	25-XV-015	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR	25-XV-017	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR	25-XV-018	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

CONFORMITY DECLARATION ACCORDING TO EUROPEAN DIRECTIVE 2014/68/UE

DICHIARAZIONE DI CONFORMITÀ AI SENSI DELLA DIRETTIVA EUROPEA 2014/68/UE

THE MANUFACTURER
IL FABBRICANTE

Name Nome	FLUITEK ORSENIGO VALVES S.R.L.
Legal representative and role Legale rappresentante	P. Belotti – Managing Director
Declaration of conformity nr. Dichiarazione di conformità no.	240062
Sede legale Legal office	Via Dei Livelli di Sopra, 7/5 – 24060 COSTA DI MEZZATE (BERGAMO) – ITALY
Sede produttiva Operational office	Via Dei Livelli di Sopra, 7/5 – 24060 COSTA DI MEZZATE (BERGAMO) – ITALY
E-mail E-mail	info@fluitekvalves.com
Website Sito internet	www.fluitekvalves.com
Telephone Telefono	+39 035 666 501
Fax Fax	+39 035 666 5047

DECLARE THAT THE FOLLOWING PRESSURE EQUIPMENT
DICHIARA CHE I SEGUENTI ACCESSORI A PRESSIONE

JOB	FOV Pos.	Serial Number	Client Item	PO N.	Description	Quantity
240062	001	2400620010001	10	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	002	24000620020001	20	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	003	2400620030001	30	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	004	2400620040001	40	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	005	2400620050001	50	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	006	2400620060001	60	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	007	2400620070001	70	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	008	2400620080001	80	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	009	2400620090001	90	1724000204 123A90A	Ball valve 1-1/2'' 300#	**1**
240062	010	2400620100001	100	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	011	2400620110001	110	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	012	2400620120001	120	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	013	2400620130001	130	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	014	2400620140001	140	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	015	2400620150001	150	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	016	2400620160001	160	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	017	2400620170001	170	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	018	2400620180001	180	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	019	2400620190001	190	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	020	2400620200001	200	1724000204 123A90A	Ball valve 1'' 300#	**1**

Fluitek Valves	**CONFORMITY DECLARATION ACCORDING TO EUROPEAN DIRECTIVE 2014/68/UE** DICHIARAZIONE DI CONFORMITÀ AI SENSI DELLA DIRETTIVA EUROPEA 2014/68/UE

240062	021	2400620210001	210	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	022	2400620220001	220	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	023	2400620230001	230	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	024	2400620240001	240	1724000204 123A90A	Ball valve 1-1/2'' 150#	**1**
240062	025	2400620250001	250	1724000204 123A90A	Ball valve 1'' 150#	**1**
240062	026	2400620260001	260	1724000204 123A90A	Ball valve 1-1/2'' 150#	**1**
240062	027	2400620270001	270	1724000204 123A90A	Ball valve 1'' 150#	**1**
240062	028	2400620280001	280	1724000204 123A90A	Ball valve 1'' 150#	**1**

MET THE REQUIREMENTS OF DIRECTIVE 2014/68/UE
SONO CONFORMI AI REQUISITI DELLA DIRETTIVA 2014/68/UE

Conformity assessment procedure used: Procedura di valutazione di conformità utilizzata:	Module H annex III of Directive 2014/68/UE Modulo H Allegato III della Direttiva 2014/68/UE
Notified Body charged of conformity assessment: Organismo Notificato incaricato della valutazione di conformità:	Bureau Veritas (Notified Body No.1370) Bureau Veritas (Ente Notificato N°1370)
Not armonized standards applied to design and manufacture: Norme non armonizzate applicate alla progettazione e alla fabbricazione:	ASME B16.34, ASME VIII, ASME IX, UNI EN 1503 Part.2 ASME B16.34, ASME VIII, ASME IX, UNI EN 1503 Part.2
Classificazione dei fluidi condotta in conformità ai requisiti del	Regolamento CLP CE 1272/2008 Fluid group: **1**

Place COSTA DI MEZZATE (BG), Italy
Luogo COSTA DI MEZZATE (BG), Italia

Date 14/01/2025
Data



Signature
Firma

Fluitek Valves	**DECLARATION OF CONFORMITY ATEX 2014/34/EU** *Dichiarazione di Conformità ATEX 2014/34/EU*	**Cert. DDC No.** **240062 ATEX**

GENERAL INFORMATION – *INFORMAZIONI GENERALI*

Customer ***Cliente***	ROSETTI MARINO S.P.A.		
P. Order ***Ordine***	1724000204 123A90A	**Item/s** ***Item/s***	ALL
FOV Job ***Commessa FOV***	240062	**Position/s** ***Posizione/i***	ALL
Subject ***Oggetto***	BALL VALVE		
Date of execution ***Data di esecuzione***	24/07/2024		

STATEMENT – *DICHIARAZIONE*

We declare that this product has been manufactured in accordance with the Euporean Directive 2014/34/EU to the classification II 2 G/D Tx c.
Technical standards and specifications used are referenced in the Fluitek Orsenigo valves above stated internal job.
The equipment satisfies the provision of directive 2014/34/EU and of standards EN 1127-1, UNI CEI EN ISO 80079-36:2016.
Technical file deposited to Notified Body TUV RHEINLAND 0035.

REMARKS – *NOTE*

SIGNATURE – *FIRME*

Inspection Authority ***Ente Ispettivo***	**Customer Inspector** ***Ispettore Cliente***	**Quality Control** ***Controllo qualità***
		FLUITEK ORSENIGO VALVES S.R.L. Q.C.

rotork Fluid Systems	EU Declaration of Conformity	Rif. JOB nr: AF7703

Manufacturer: Rotork Fluid Systems S.r.l.

Address: Via Padre Jacques Hamel, 138/B
55016 Porcari, Lucca – Italy
Tel. +39 0583 2221
Fax. +39 0585 091362

Section PED: ☐ Applicable ☒ Not Applicable

Under its sole responsibility declares that the items specified below have been designed, manufactured, inspected and tested as required by the relevant provisions of the Pressure Equipment Directive 2014/68/UE.
The equipment has been submitted to the following conformity assessment procedures:

☐**Module H**: **CE-1370-PED-H-RTK 001-23-ITA** **Serial No.:**

☐ **Module H1**: **CE-1370-PED-H1-RTK 001-23-ITA** **Serial No.:**
CE-1370-PED-H1D-RTK 001-20-ITA
CE-1370-PED-H1D-RTK 002-20-ITA

Notified Body: Bureau Veritas Italia SPA Viale Monza 347 20126 MI – Italy
NB Number: 1370

Description: The pressure equipment is a part pressure of pneumatic actuator that is product of Rotork Fluid Systems for quart turn and linear valve. It is composed by a cylinder can and two flanges packaged by tie rods.

Other technical standards and specifications used:
VSR rev.1995; RACCOLTA "M"; RACCOLTA "S"; AD 2000-Merkblatt; ASME VIII Div.1/Div.2; ASME II; EN 13445-3

Section ATEX:

Under its sole responsibility declares that the actuators model:

☒ **GP/GH, CP/CH, RP/RH, LP/LH, HPG, HPL MARKED:** **II 2 G Ex h IIC T5 Gb X**
II 2 D Ex h IIIC T100°C Db X
IP 66M/67M

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / EN 60529

☐ **CQP/CQH MARKED:** **II 2 G Ex h IIC T5 Gb X**
II 2 D Ex h IIIC T100°C Db X
IP 66/68

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / EN 60529

☐ **GO, GOL, EH MARKED:** **II 2 G Ex 60079-46 II_ T_ _ X**
(II 2 D Ex 60079-46 III_ T_ _X)
IP 6_

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / IEC 60079-46, EN 60529

The conformity has been evaluated according to ***Annex VIII (Article 13, Point 1. (b)(ii))*** *of* ***ATEX 2014/34/EU*** *directive.*
TECHNICAL FILE N° TR 219 *(Receipt Number:* ***BVI/ATEX/ITA/24/080*** *Bureau Veritas ITA)*

Section API 6DX: ☐ Applicable ☒ Not Applicable

Under its sole responsibility, the Manufacturer declares that the items specified above have been designed, manufactured, inspected, and tested as required by the applicable provisions of the current edition of the product standard API 6DX and all addenda.


SIGNED ON BEHALF OF ROTORK FLUID SYSTEMS S.R.L. (authorized representative of):

Legal Representative: Metin Gerceker **Signature:**


Place / date: Porcari / 05/02/2025

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

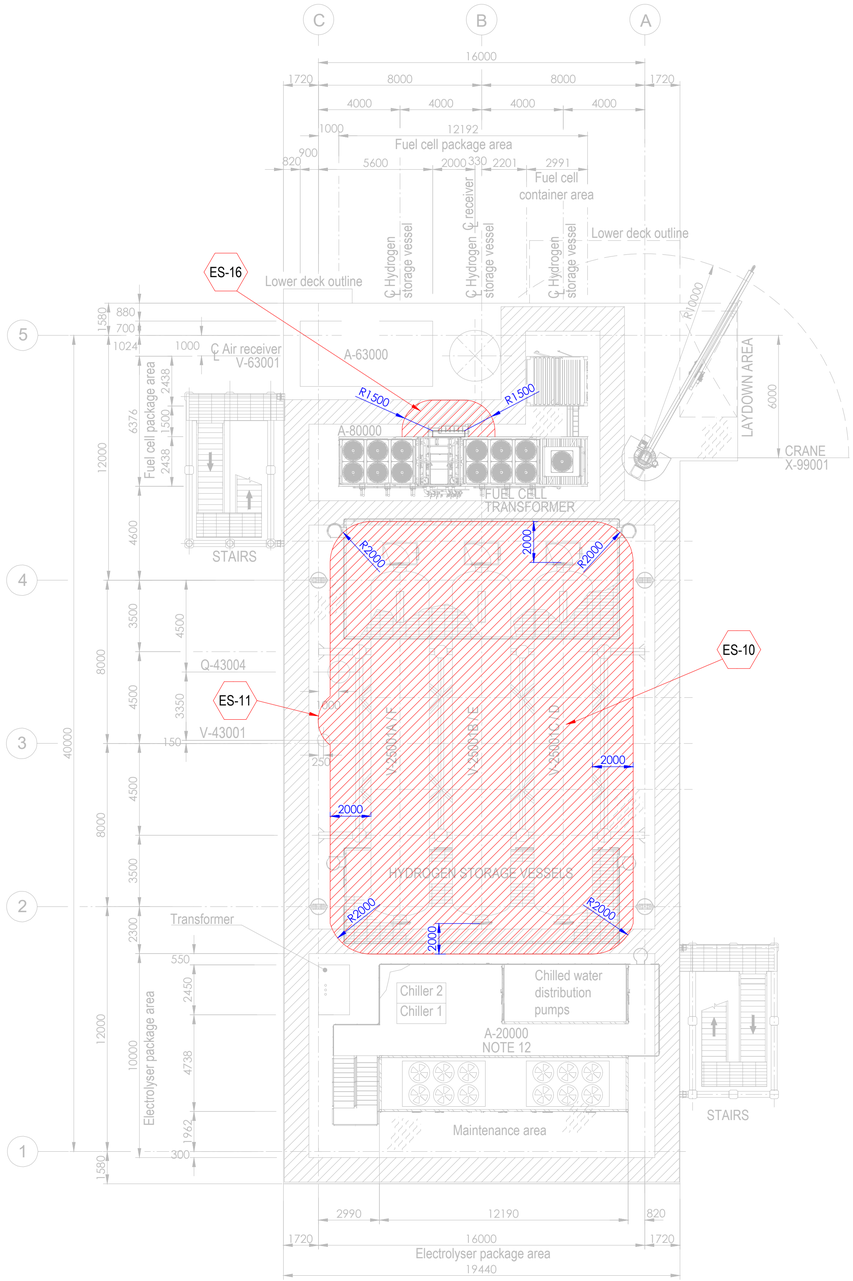


PLAN ON UPPER DECK
EL+30.310 T.O.S.

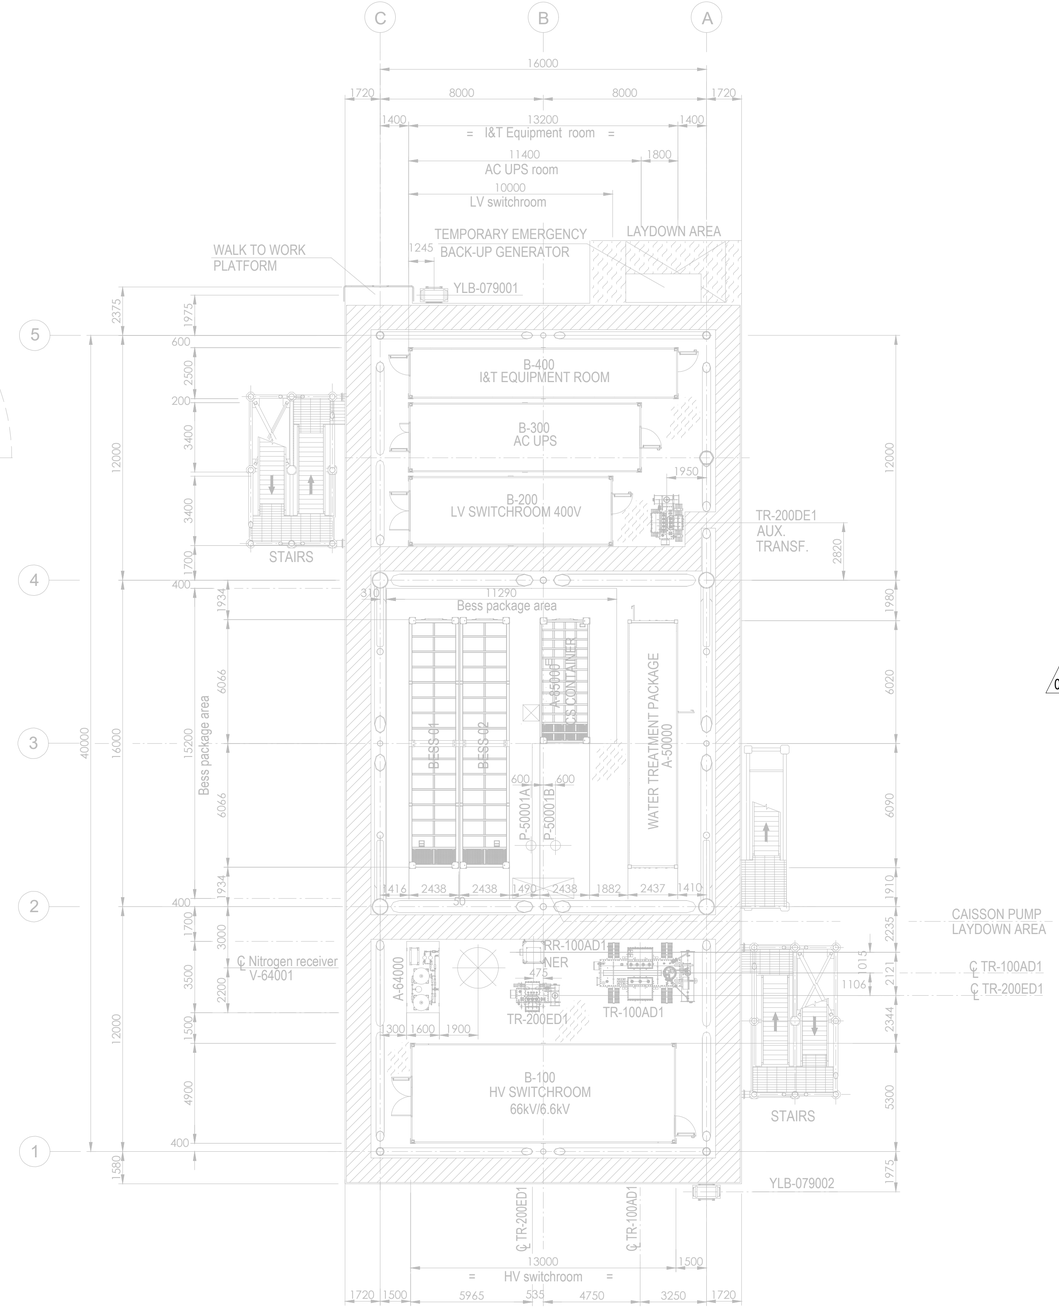

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

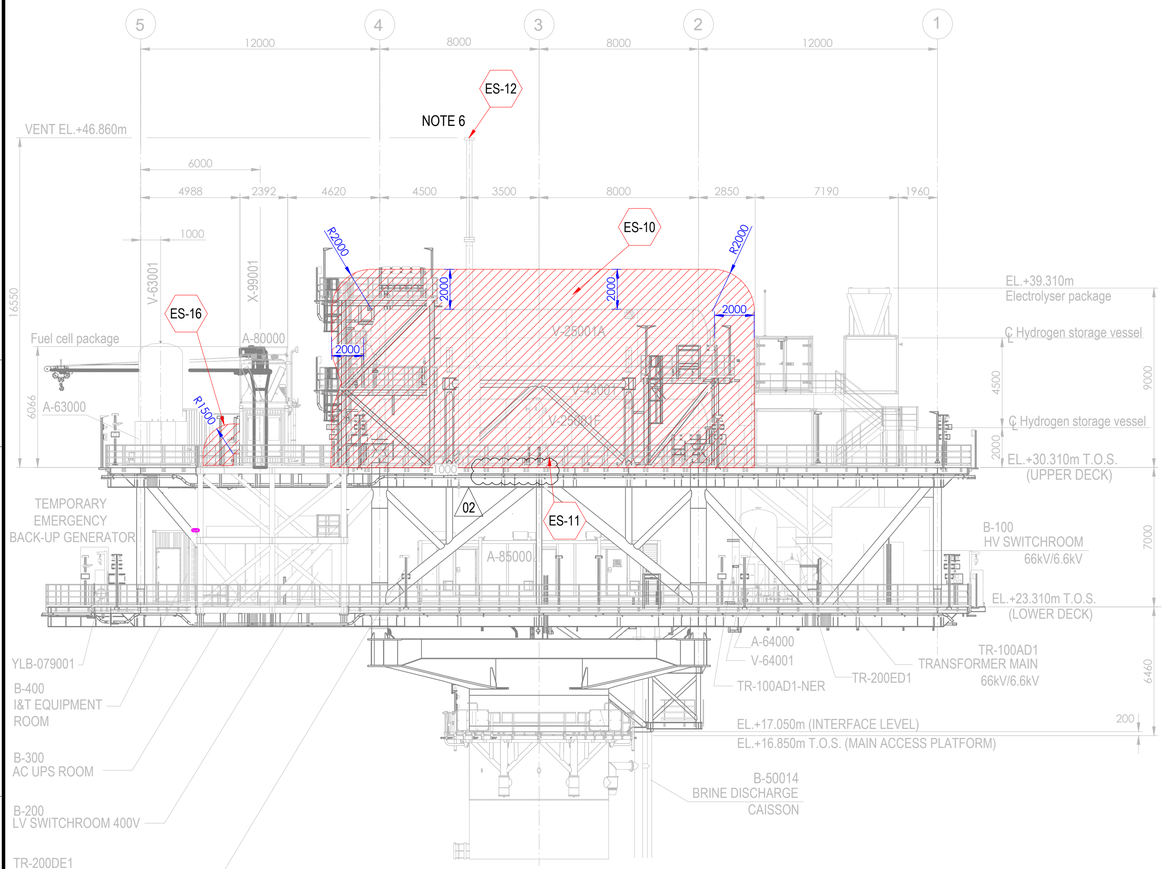



ELEVATION LOOKING EAST

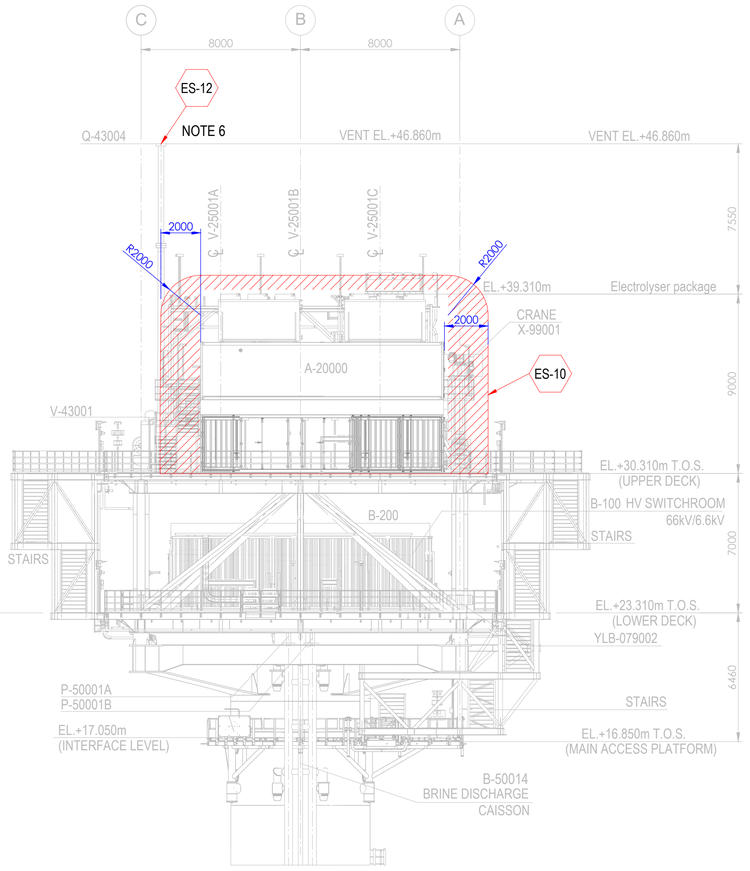

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

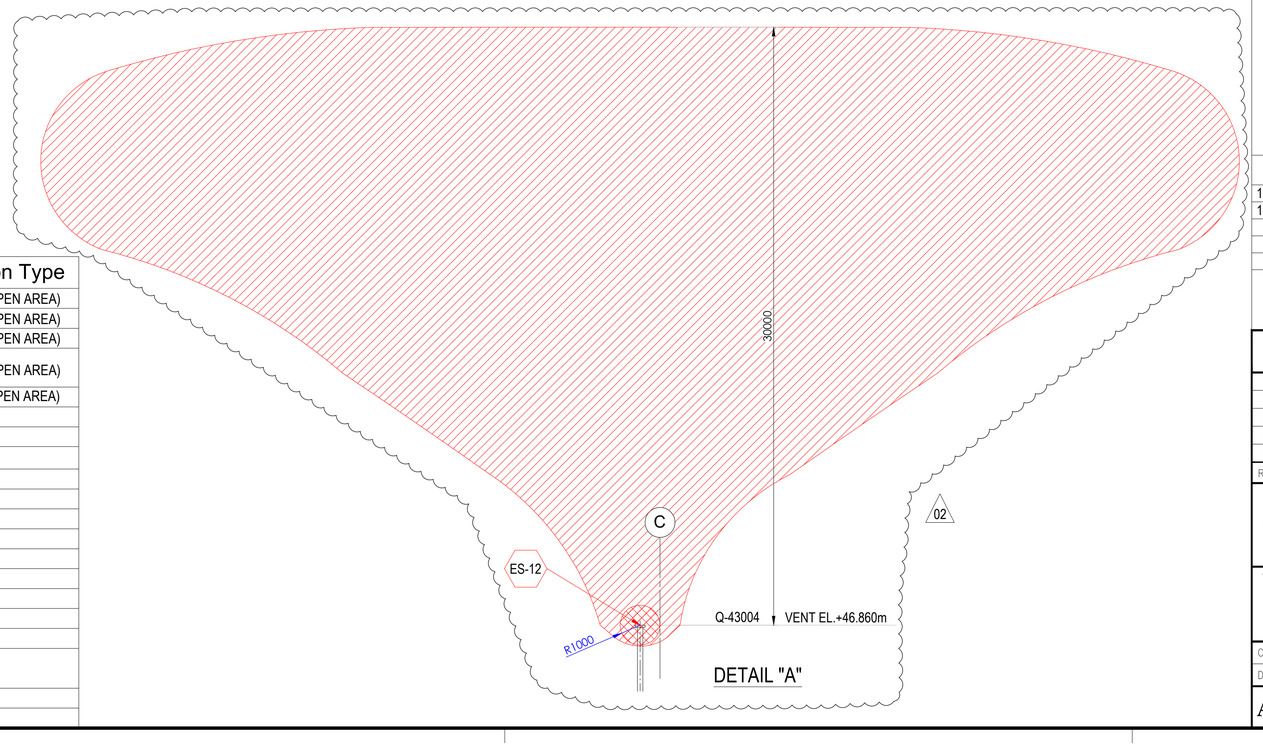



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-XV-014	: On/Off Valve - Vessel V-25001D Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001596	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		AF770301701 (Ball valve SN: 2400620170001)			
Manufacturer	Rotork			**Model**		CP/S-035-080A/AA			
Cert No.	Declaration of Conformity by Manufacturer			**Equipment Ambient Temp.**		-20 °C to + 40 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T5	**IP Rating**	IP66/67

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-XV-014	: On/Off Valve - Vessel V-25001D Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001596		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-XV-014	: On/Off Valve - Vessel V-25001D Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001596	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-28	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-28T07:49:00.328Z	PROVERLIS Digitaly signed by Luca Mussi 2025-01-30T11:41:40.784Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

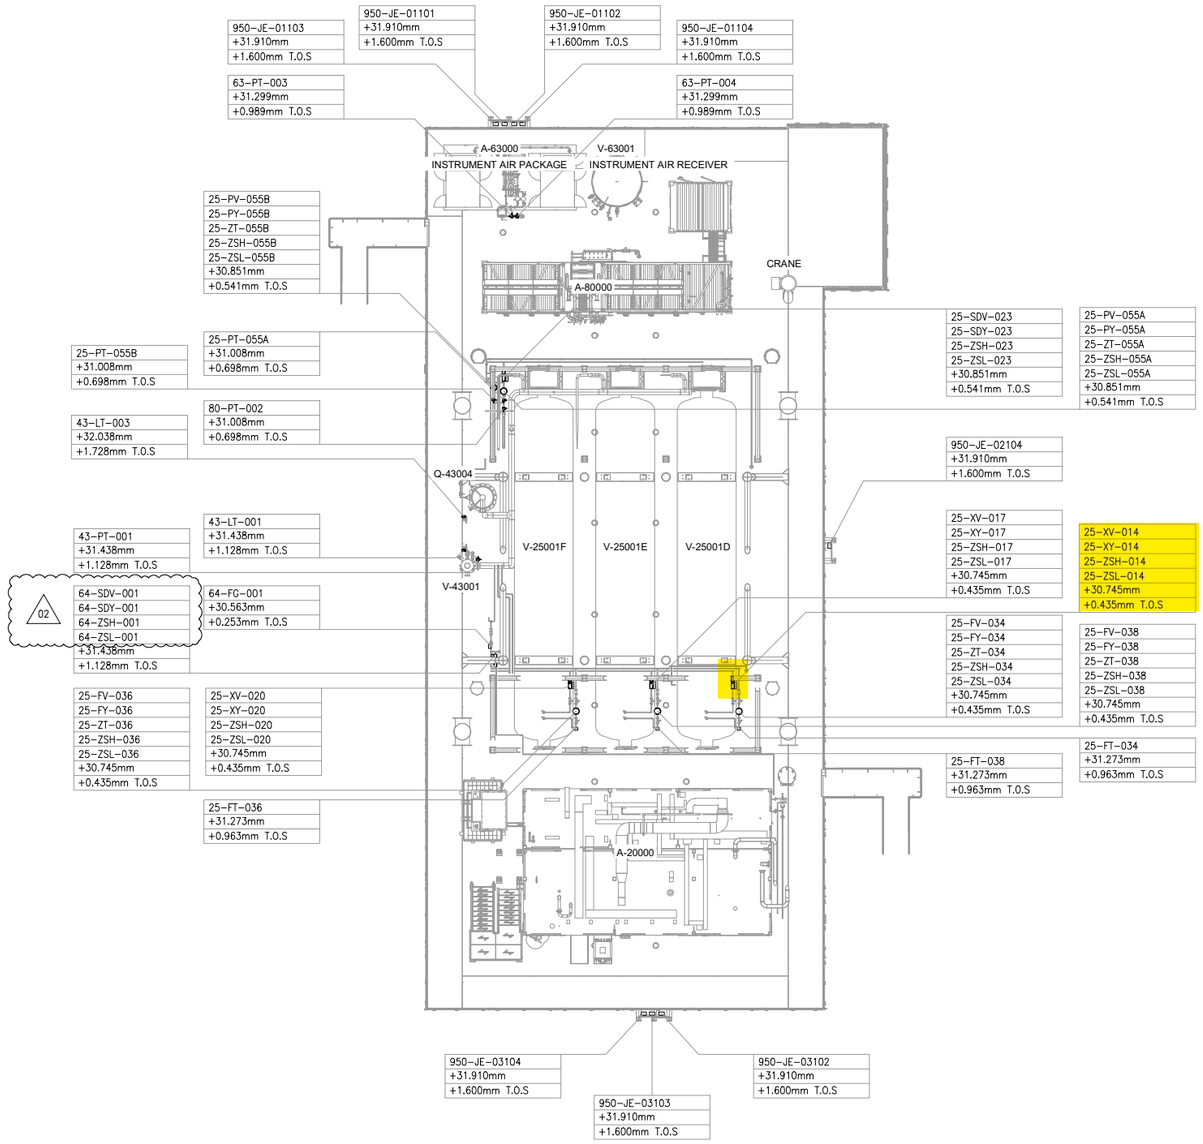


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm



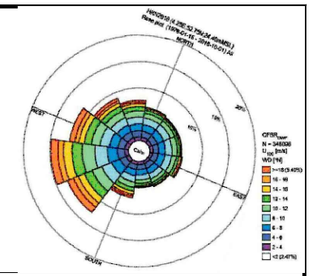

NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001_D

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

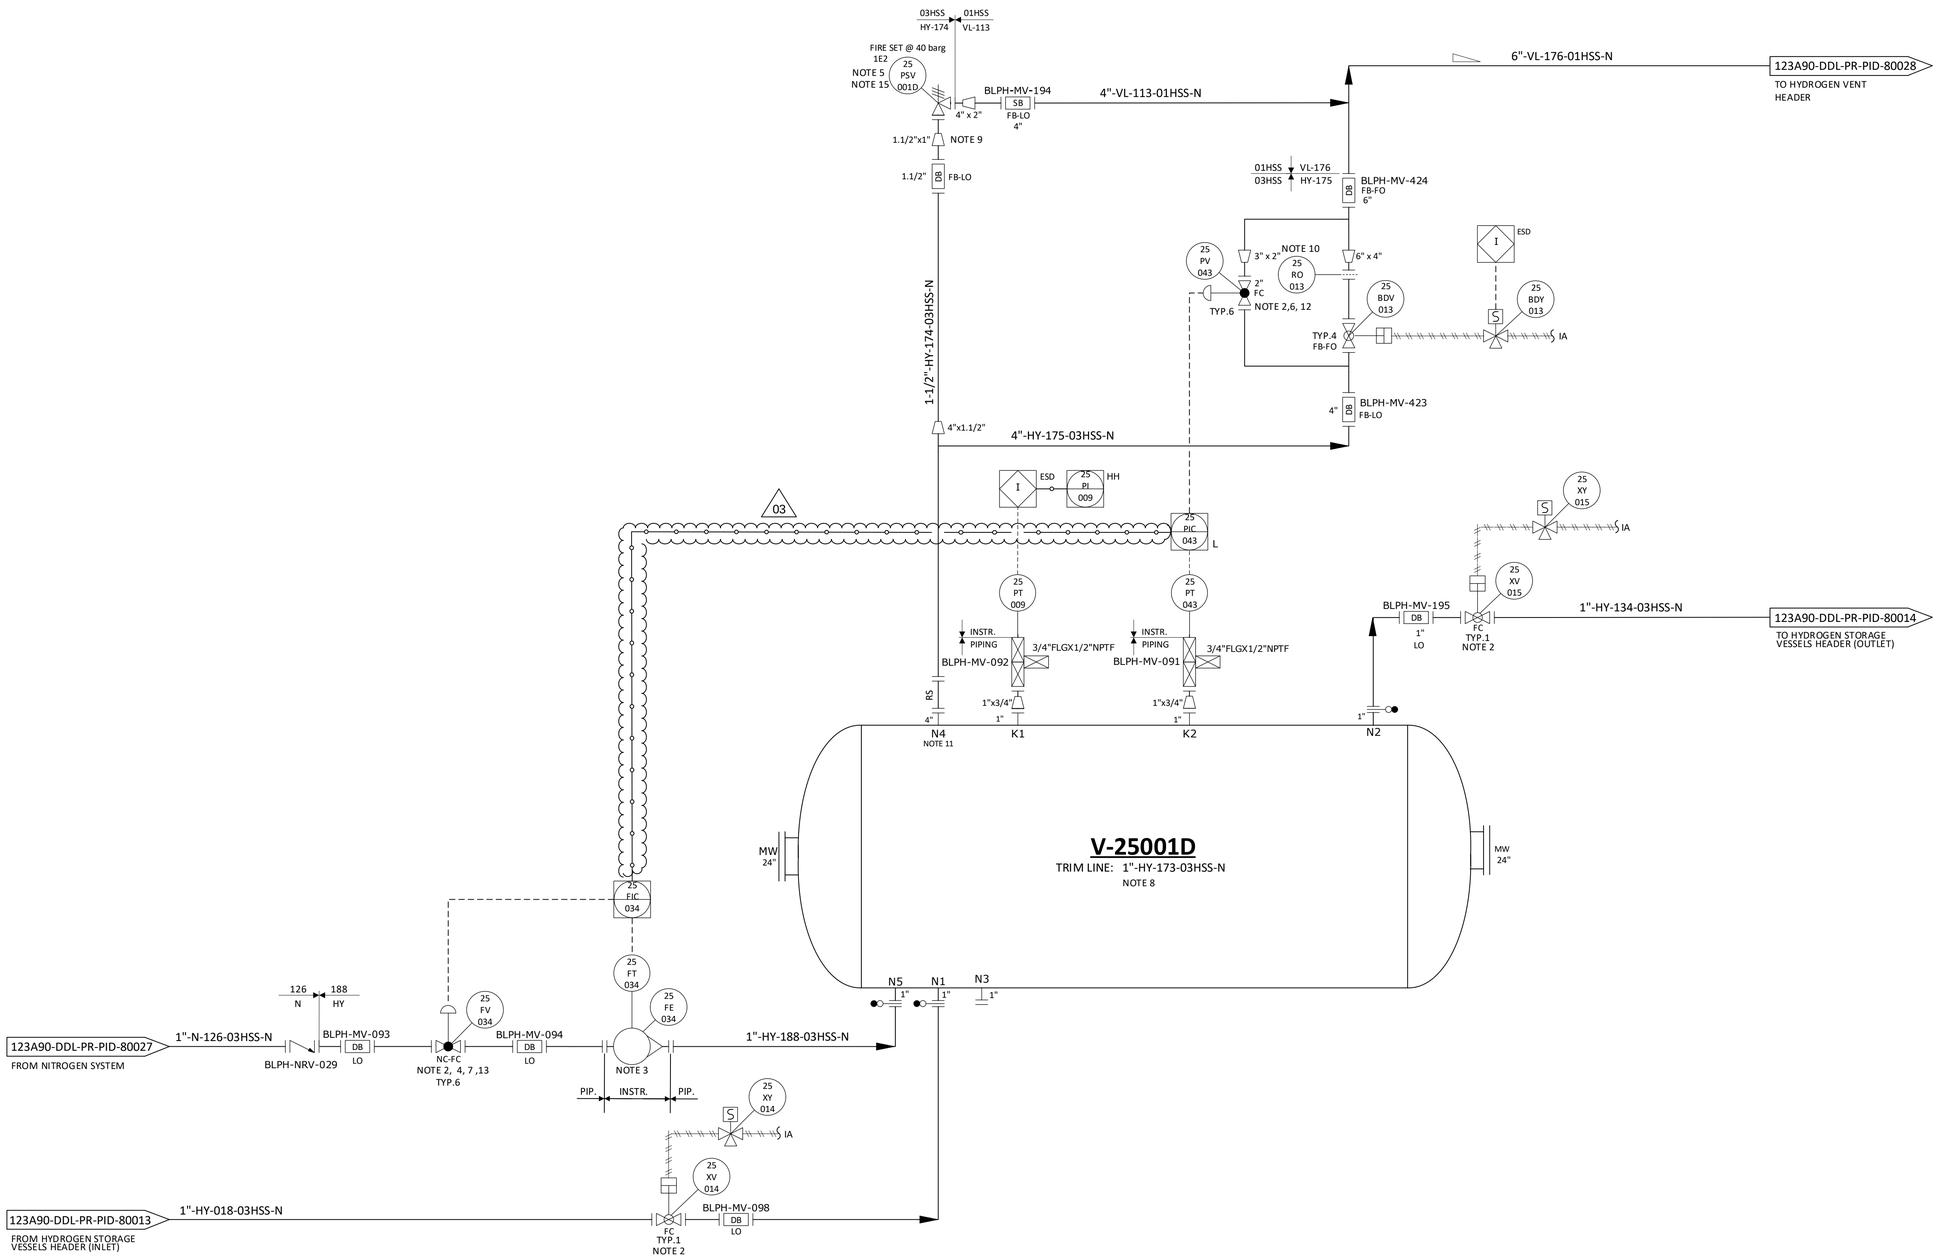

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS. 03
4. NITROGEN CONTROL VALVE (25-FV-034) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE.
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-043 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-043 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-034 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-043 HAS FAILED TO CLOSE.
15. 25-PSV-001D SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL D

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO. 123A90-DDL-PR-PID-80018	SHEET 001	REV. 03


File Name : FILE_NAME

DRAWING NO.


REV. 00

TYPICAL INSTRUMENTATION VALVE

TYP.1 (XV - ON OFF VALVES)

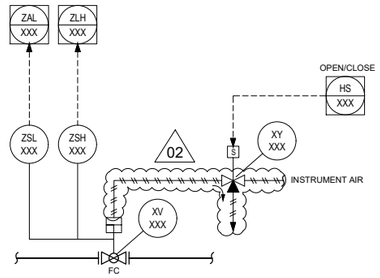


TYP.2 (SDV - SAFETY NO CRITICAL VALVES)

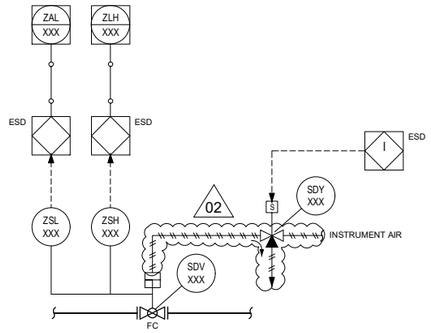


02

TYP.4 (BDV - SAFETY NO CRITICAL VALVES)

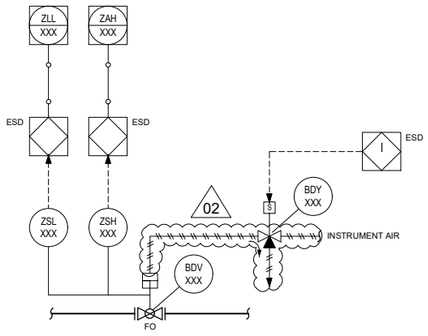

02

TYP.6 (CONTROL VALVES - CRITICAL)

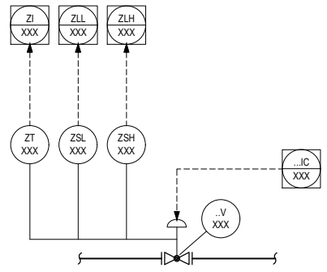


INSTRUMENT SYMBOLOGY DEFINITION

MEANINGS OF IDENTIFICATION LETTERS
THIS TABLE APPLIES TO THE FUNCTIONAL IDENTIFICATION OF INSTRUMENTS

	FIRST- LETTER		SUCCEEDING-LETTER		
	MEASURED OR INITIATING VARIABLE	MODIFIER	READOUT OR PASSIVE FUNCTION	OUTPUT FUNCTION	MODIFIER
A	ANALYSIS		ALARM		
C				CONTROL	
E			SENSOR (PRIMARY ELEMENT) ELEMENT		
F	FLOW RATE	RATIO (FRACTION)			
G			GLASS VIEWING DEVICE		
H	HAND				HIGH
I			INDICATE		
L	LEVEL				LOW
O			ORIFICE, OPEN		
P	PRESSURE, VACUUM				
R		RELIEF			
S		SAFETY		SWITCH	
T	TEMPERATURE			TRANSMIT	
V				VALVE, DAMPER, LOUVER	
X	UNCLASSIFIED				
Y				AUXILIARY DEVICES	
Z	POSITION DIMENSION				

NOTE: FOR FURTHER EXPLANATORY NOTES, REFER TO ANSI/ISA-5.1

TYP.7 (CONTROL VALVES - NOT CRITICAL)



NOTES

1. FOR GENERAL NOTES AND PIPING SYMBOLOGY SEE DRAWINGS: 123A90-DDL-PR-PID-80009 AND 123A90-DDL-PR-PID-80010.
2. DELETED.

HOLDS

1 DELETED 02


REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND | ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
INSTRUMENTATION SYMBOLOGY

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80042	SHEET 001	REV. 02

File Name :

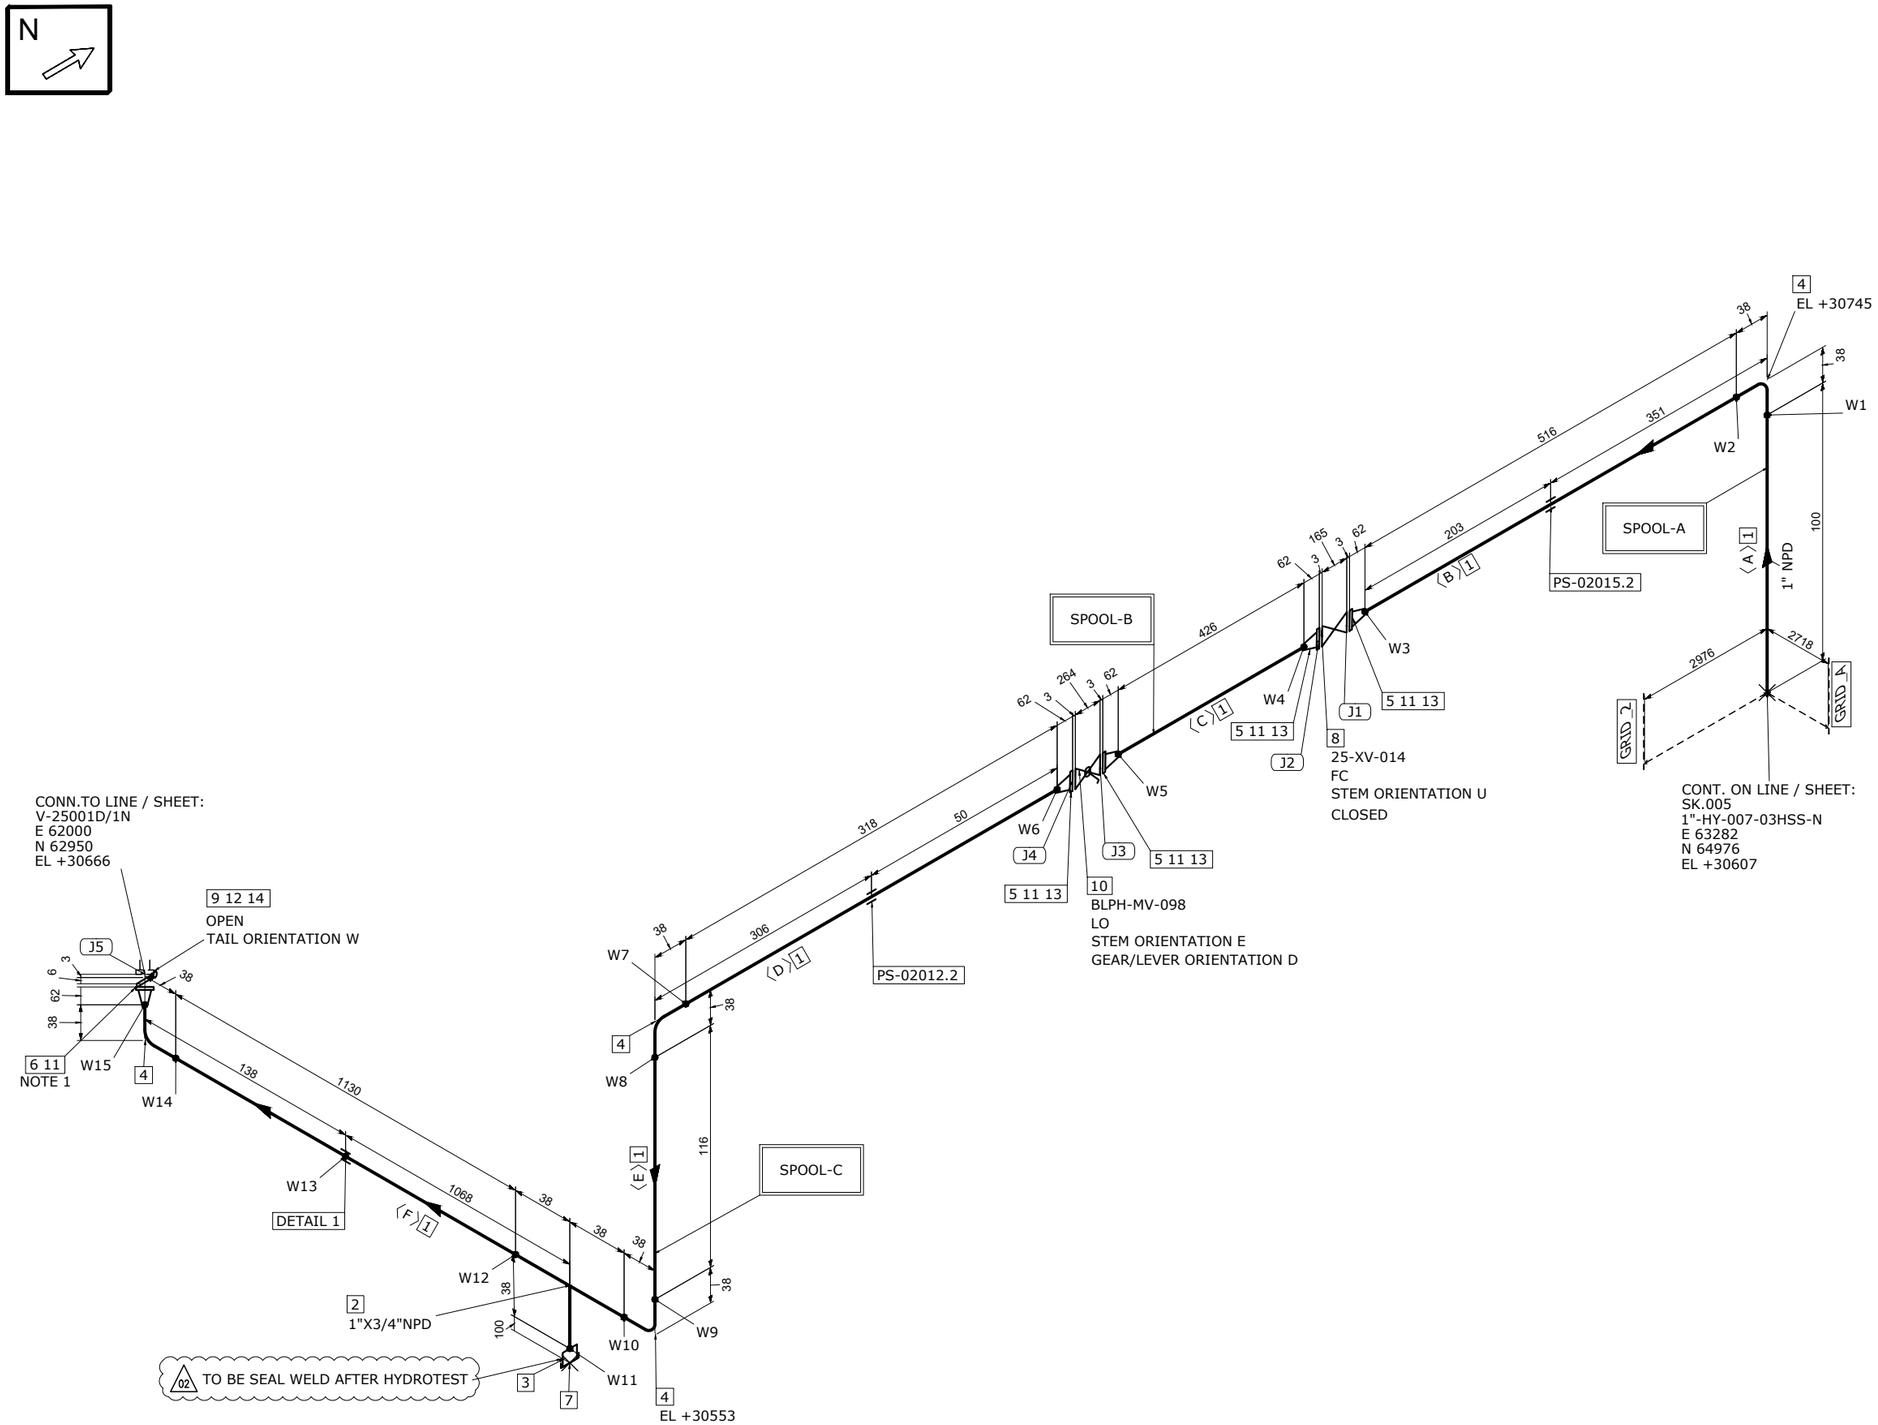

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.6M	6.6
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.8
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	3/4	BW
W12	1	BW
W13		FW
W14	1	BW
W15	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	100	BEVEL	BEVEL
B	1	516	BEVEL	BEVEL
C	1	426	BEVEL	BEVEL
D	1	318	BEVEL	BEVEL
E	1	116	BEVEL	BEVEL
F	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-02015.2
PS-02012.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	3.5
B	2	4.7
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-018-03HSS-N

SK.012

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II			
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS			
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]		
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water	

REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80018
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029


NOTES

1.JACKSCREWS POSITION N/S

MASTER

CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	N/A
DRAWN STAFF SRL	CHECKED RT	APPROVED LM	DATE 17-09-2024
FORMAT A3	DRAWING NO. 123A90-FDL-PP-DI-00012	SHEET / OF 1/1	REV. 02

E33

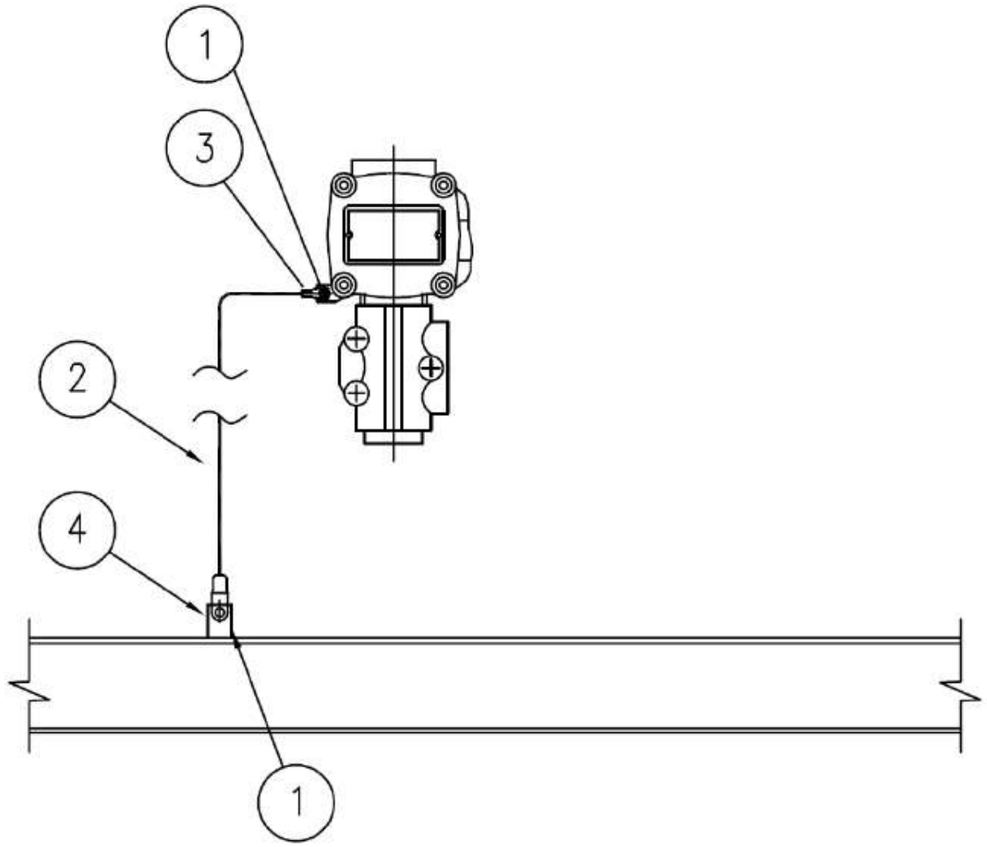

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

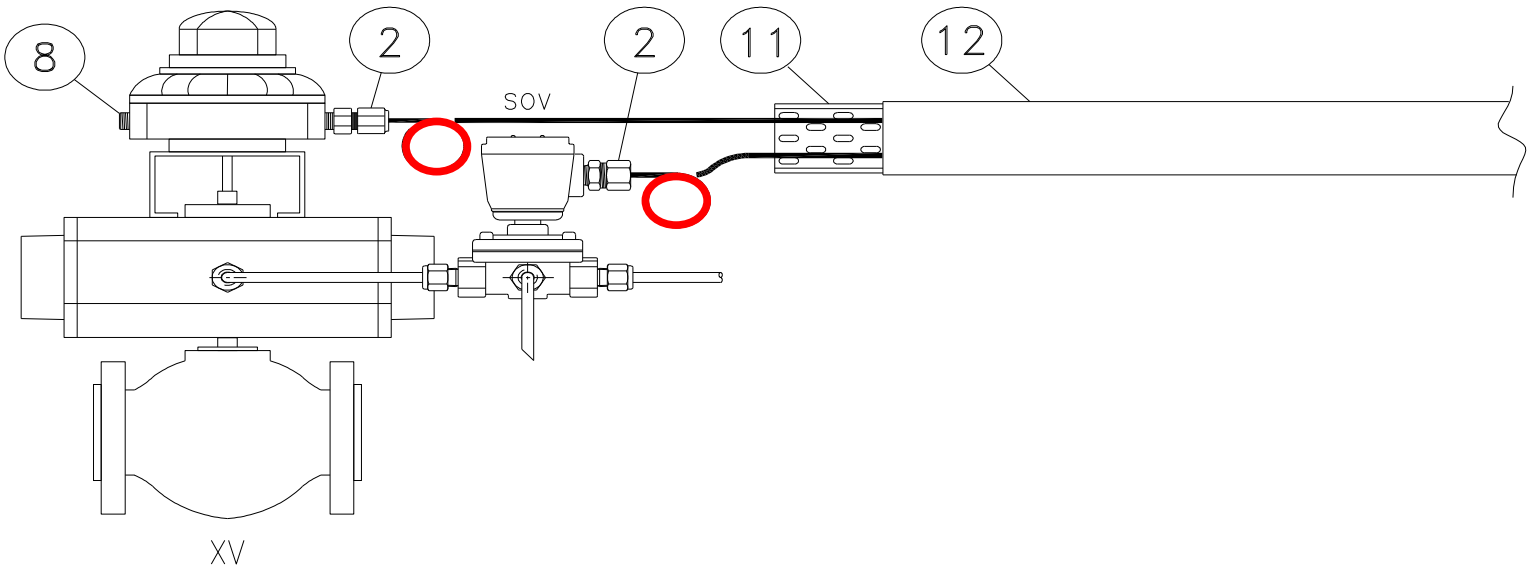

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**

REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy


CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Pneumatic Hook-Ups	Sh. 6 of 6 Date: 08/07/2024 Rev. 01

PNEUMATIC HOOK-UP FOR ON-OFF VALVES

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40078**

REV.:	DATE:	SIGNATURE:
1_B	06/11/24	G.Randi

ROSETTI MARINO SpA

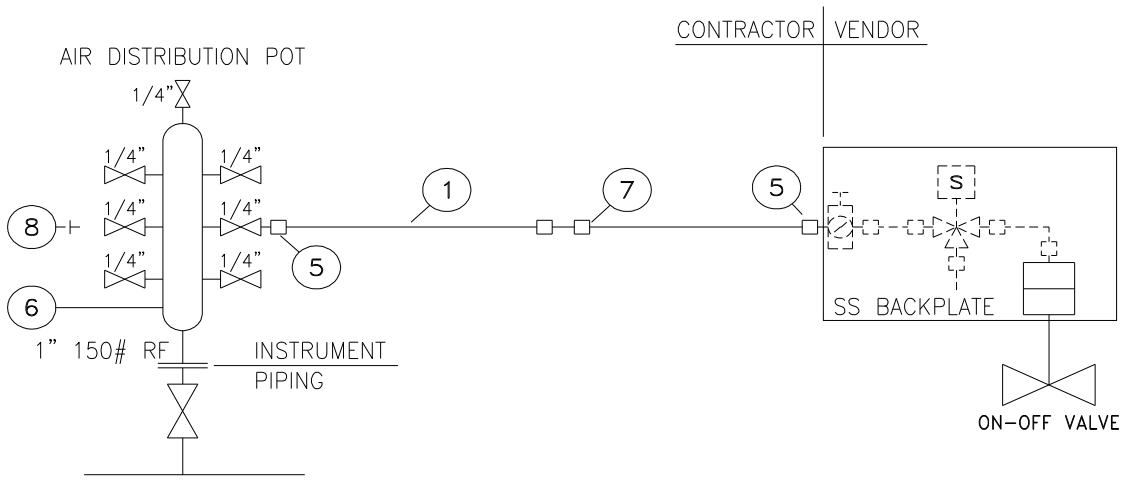



INSTRUMENT TAG	
1	25-BDV-022
2	25-BDV-005
3	25-BDV-007
4	25-BDV-010
5	25-BDV-013
6	25-BDV-016
7	25-BDV-019
8	25-SDV-001
9	25-SDV-023
10	25-XV-004
11	25-XV-006
12	25-XV-008
13	25-XV-009
14	25-XV-011
15	25-XV-012
16	25-XV-014
17	25-XV-015
18	25-XV-017
19	25-XV-018
20	25-XV-020
21	25-XV-021
22	25-XV-024
23	50-XV-001
24	50-XV-002
25	50-XV-003
26	50-XV-004
27	80-XV-001
28	64-SDV-001
29	50-XV-005
30	

NOTE:
(1) For Air Distribution Pot quantities see material take-off on sh. 4


POS.	NORM/STD CODE	DESCRIPTION	SIZE/CONNECTION TYPE	Q.TY
8		SS316 PLUG	1/4" NPT	Note 1
7		SS316 UNION	1/2" O.D. x 1/2" O.D.	N. 1
6		SS316 AIR DISTRIBUTION POT	1" 150#RF - N. 7 1/4" BALL VALVES	Note 1
5		SS316 MALE CONNECTOR	1/4" NPT x 1/2" O.D.	N. 2
1		SS 316L TUBING	1/2" x 0,049"Thk	10 m


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

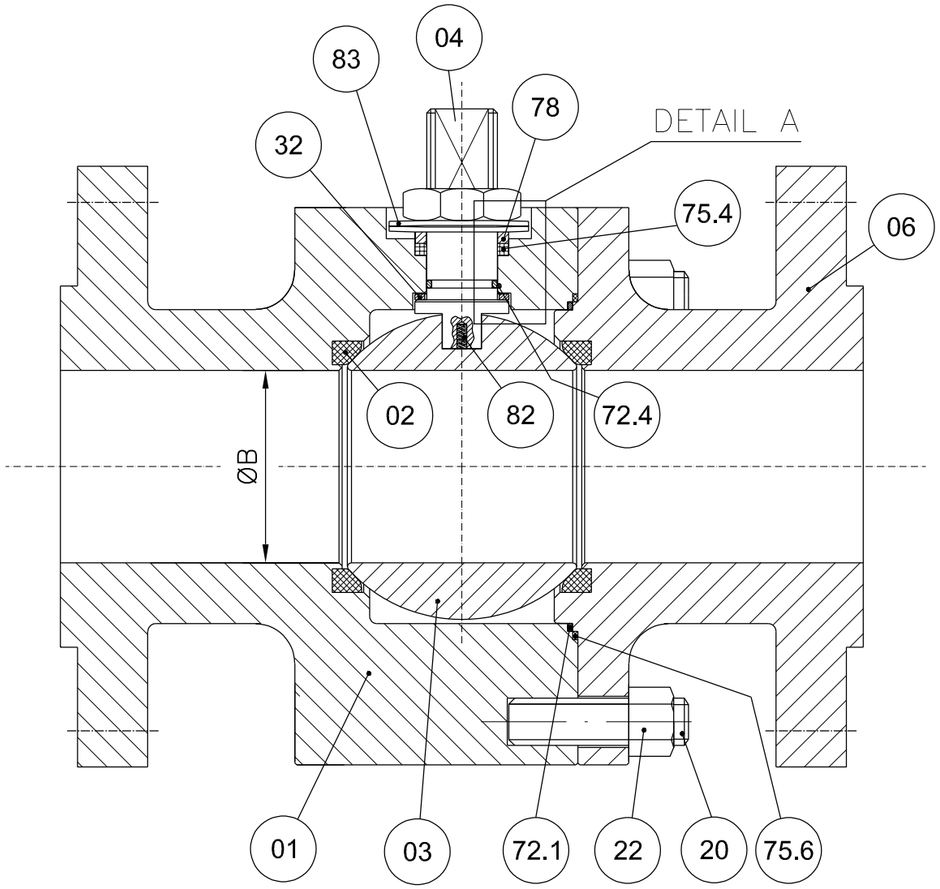




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024
CHK'D: D.Barcella	DATE: 26/02/2024
APPV'D: L.Mora	DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: D240062-08

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-014		25
	2	Service				HYDROGEN STORAGE TANK V-25001D INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80018		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-018-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-014 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-014 (9, 17) - Soldo SS		25-ZSH-014 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

94	IFR	25-XV-009	floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR	25-XV-011	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR	25-XV-012	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR	25-XV-014	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR	25-XV-015	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR	25-XV-017	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR	25-XV-018	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

CONFORMITY DECLARATION ACCORDING TO EUROPEAN DIRECTIVE 2014/68/UE

DICHIARAZIONE DI CONFORMITÀ AI SENSI DELLA DIRETTIVA EUROPEA 2014/68/UE

THE MANUFACTURER
IL FABBRICANTE

Name Nome	FLUITEK ORSENIGO VALVES S.R.L.
Legal representative and role Legale rappresentante	P. Belotti – Managing Director
Declaration of conformity nr. Dichiarazione di conformità no.	240062
Sede legale Legal office	Via Dei Livelli di Sopra, 7/5 – 24060 COSTA DI MEZZATE (BERGAMO) – ITALY
Sede produttiva Operational office	Via Dei Livelli di Sopra, 7/5 – 24060 COSTA DI MEZZATE (BERGAMO) – ITALY
E-mail E-mail	info@fluitekvalves.com
Website Sito internet	www.fluitekvalves.com
Telephone Telefono	+39 035 666 501
Fax Fax	+39 035 666 5047

DECLARE THAT THE FOLLOWING PRESSURE EQUIPMENT
DICHIARA CHE I SEGUENTI ACCESSORI A PRESSIONE

JOB	FOV Pos.	Serial Number	Client Item	PO N.	Description	Quantity
240062	001	2400620010001	10	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	002	24000620020001	20	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	003	2400620030001	30	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	004	2400620040001	40	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	005	2400620050001	50	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	006	2400620060001	60	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	007	2400620070001	70	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	008	2400620080001	80	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	009	2400620090001	90	1724000204 123A90A	Ball valve 1-1/2'' 300#	**1**
240062	010	2400620100001	100	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	011	2400620110001	110	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	012	2400620120001	120	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	013	2400620130001	130	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	014	2400620140001	140	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	015	2400620150001	150	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	016	2400620160001	160	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	017	2400620170001	170	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	018	2400620180001	180	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	019	2400620190001	190	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	020	2400620200001	200	1724000204 123A90A	Ball valve 1'' 300#	**1**

Fluitek Valves	**CONFORMITY DECLARATION ACCORDING TO EUROPEAN DIRECTIVE 2014/68/UE** DICHIARAZIONE DI CONFORMITÀ AI SENSI DELLA DIRETTIVA EUROPEA 2014/68/UE

240062	021	2400620210001	210	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	022	2400620220001	220	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	023	2400620230001	230	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	024	2400620240001	240	1724000204 123A90A	Ball valve 1-1/2'' 150#	**1**
240062	025	2400620250001	250	1724000204 123A90A	Ball valve 1'' 150#	**1**
240062	026	2400620260001	260	1724000204 123A90A	Ball valve 1-1/2'' 150#	**1**
240062	027	2400620270001	270	1724000204 123A90A	Ball valve 1'' 150#	**1**
240062	028	2400620280001	280	1724000204 123A90A	Ball valve 1'' 150#	**1**

MET THE REQUIREMENTS OF DIRECTIVE 2014/68/UE
SONO CONFORMI AI REQUISITI DELLA DIRETTIVA 2014/68/UE

Conformity assessment procedure used: Procedura di valutazione di conformità utilizzata:	Module H annex III of Directive 2014/68/UE Modulo H Allegato III della Direttiva 2014/68/UE
Notified Body charged of conformity assessment: Organismo Notificato incaricato della valutazione di conformità:	Bureau Veritas (Notified Body No.1370) Bureau Veritas (Ente Notificato N°1370)
Not armonized standards applied to design and manufacture: Norme non armonizzate applicate alla progettazione e alla fabbricazione:	ASME B16.34, ASME VIII, ASME IX, UNI EN 1503 Part.2 ASME B16.34, ASME VIII, ASME IX, UNI EN 1503 Part.2
Classificazione dei fluidi condotta in conformità ai requisiti del	Regolamento CLP CE 1272/2008 Fluid group: **1**

Place COSTA DI MEZZATE (BG), Italy
Luogo COSTA DI MEZZATE (BG), Italia

Date 14/01/2025
Data



Signature
Firma

Fluitek Valves	**DECLARATION OF CONFORMITY ATEX 2014/34/EU** *Dichiarazione di Conformità ATEX 2014/34/EU*	**Cert. DDC No.** **240062 ATEX**

GENERAL INFORMATION – *INFORMAZIONI GENERALI*

Customer ***Cliente***	ROSETTI MARINO S.P.A.		
P. Order ***Ordine***	1724000204 123A90A	**Item/s** ***Item/s***	ALL
FOV Job ***Commessa FOV***	240062	**Position/s** ***Posizione/i***	ALL
Subject ***Oggetto***	BALL VALVE		
Date of execution ***Data di esecuzione***	24/07/2024		

STATEMENT – *DICHIARAZIONE*

We declare that this product has been manufactured in accordance with the Euporean Directive 2014/34/EU to the classification II 2 G/D Tx c.
Technical standards and specifications used are referenced in the Fluitek Orsenigo valves above stated internal job.
The equipment satisfies the provision of directive 2014/34/EU and of standards EN 1127-1, UNI CEI EN ISO 80079-36:2016.
Technical file deposited to Notified Body TUV RHEINLAND 0035.

REMARKS – *NOTE*

SIGNATURE – *FIRME*

Inspection Authority ***Ente Ispettivo***	**Customer Inspector** ***Ispettore Cliente***	**Quality Control** ***Controllo qualità***
		FLUITEK ORSENIGO VALVES S.R.L. Q.C.

rotork Fluid Systems	EU Declaration of Conformity	Rif. JOB nr: AF7703

Manufacturer: Rotork Fluid Systems S.r.l.

Address: Via Padre Jacques Hamel, 138/B
55016 Porcari, Lucca – Italy
Tel. +39 0583 2221
Fax. +39 0585 091362

Section PED: ☐ Applicable ☒ Not Applicable

Under its sole responsibility declares that the items specified below have been designed, manufactured, inspected and tested as required by the relevant provisions of the Pressure Equipment Directive 2014/68/UE.
The equipment has been submitted to the following conformity assessment procedures:

☐**Module H**: **CE-1370-PED-H-RTK 001-23-ITA** **Serial No.:**

☐ **Module H1**: **CE-1370-PED-H1-RTK 001-23-ITA** **Serial No.:**
CE-1370-PED-H1D-RTK 001-20-ITA
CE-1370-PED-H1D-RTK 002-20-ITA

Notified Body: Bureau Veritas Italia SPA Viale Monza 347 20126 MI – Italy
NB Number: 1370

Description: The pressure equipment is a part pressure of pneumatic actuator that is product of Rotork Fluid Systems for quart turn and linear valve. It is composed by a cylinder can and two flanges packaged by tie rods.

Other technical standards and specifications used:
VSR rev.1995; RACCOLTA "M"; RACCOLTA "S"; AD 2000-Merkblatt; ASME VIII Div.1/Div.2; ASME II; EN 13445-3

Section ATEX:

Under its sole responsibility declares that the actuators model:

☒ **GP/GH, CP/CH, RP/RH, LP/LH, HPG, HPL MARKED:** **II 2 G Ex h IIC T5 Gb X**
II 2 D Ex h IIIC T100°C Db X
IP 66M/67M

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / EN 60529

☐ **CQP/CQH MARKED:** **II 2 G Ex h IIC T5 Gb X**
II 2 D Ex h IIIC T100°C Db X
IP 66/68

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / EN 60529

☐ **GO, GOL, EH MARKED:** **II 2 G Ex 60079-46 II_ T_ _ X**
(II 2 D Ex 60079-46 III_ T_ _X)
IP 6_

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / IEC 60079-46, EN 60529

The conformity has been evaluated according to ***Annex VIII (Article 13, Point 1. (b)(ii))*** *of* ***ATEX 2014/34/EU*** *directive.*
TECHNICAL FILE N° TR 219 *(Receipt Number:* ***BVI/ATEX/ITA/24/080*** *Bureau Veritas ITA)*

Section API 6DX: ☐ Applicable ☒ Not Applicable

Under its sole responsibility, the Manufacturer declares that the items specified above have been designed, manufactured, inspected, and tested as required by the applicable provisions of the current edition of the product standard API 6DX and all addenda.


SIGNED ON BEHALF OF ROTORK FLUID SYSTEMS S.R.L. (authorized representative of):

Legal Representative: Metin Gerceker **Signature:**


Place / date: Porcari / 05/02/2025

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

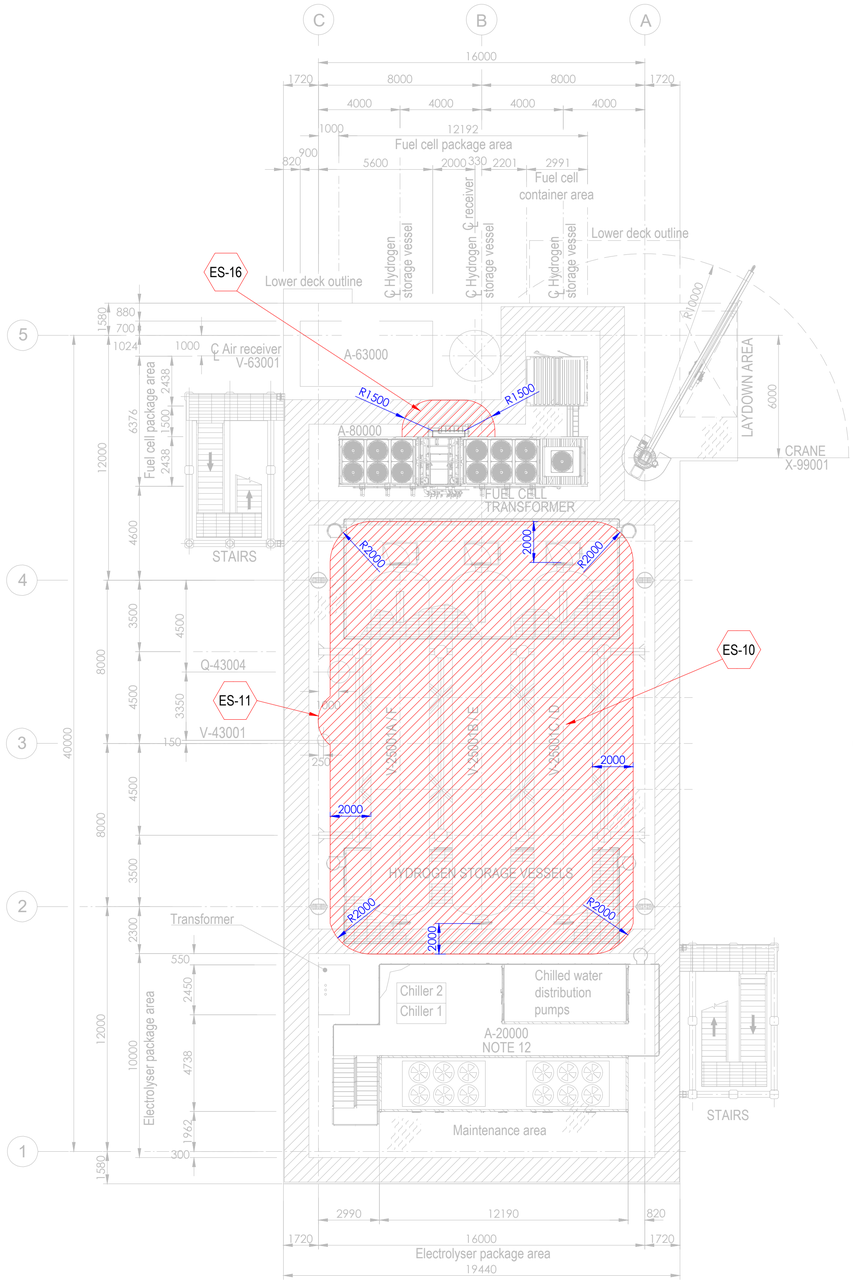


PLAN ON UPPER DECK
EL+30.310 T.O.S.

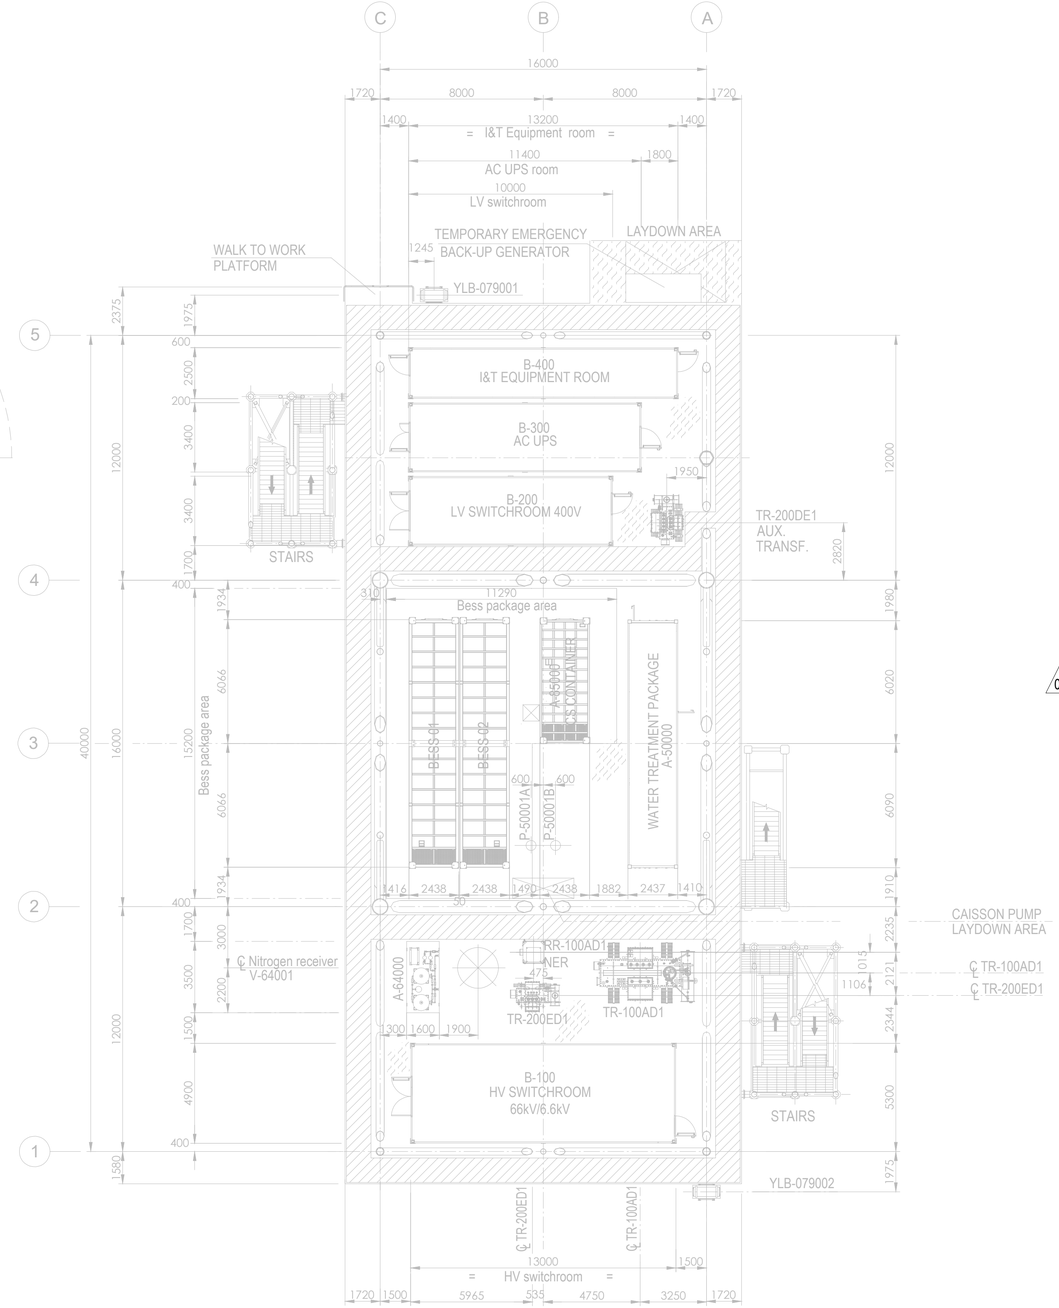

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

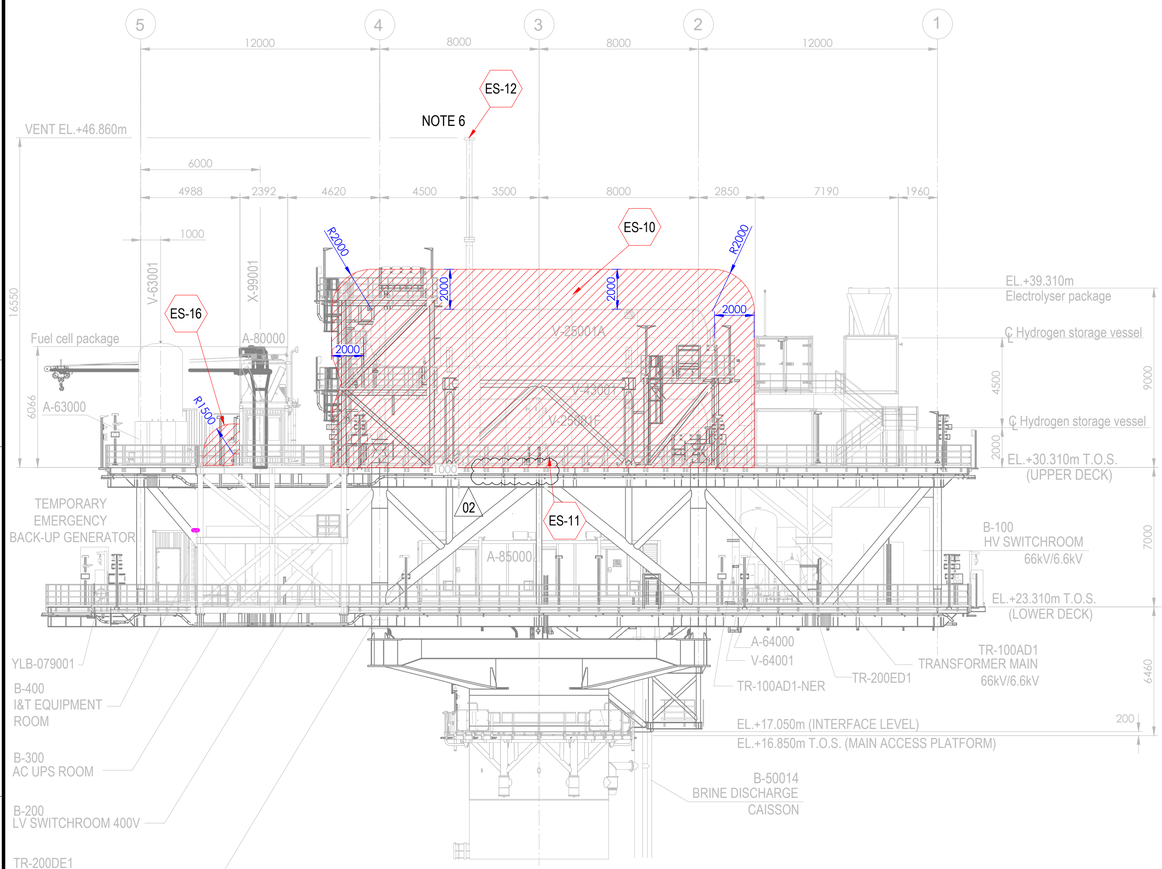



ELEVATION LOOKING EAST

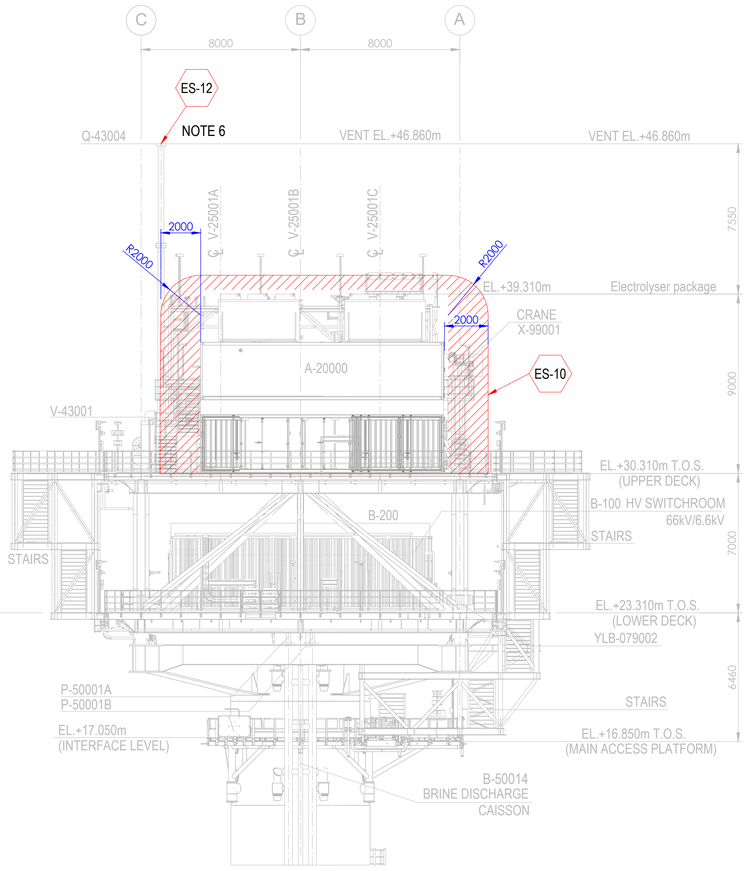

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

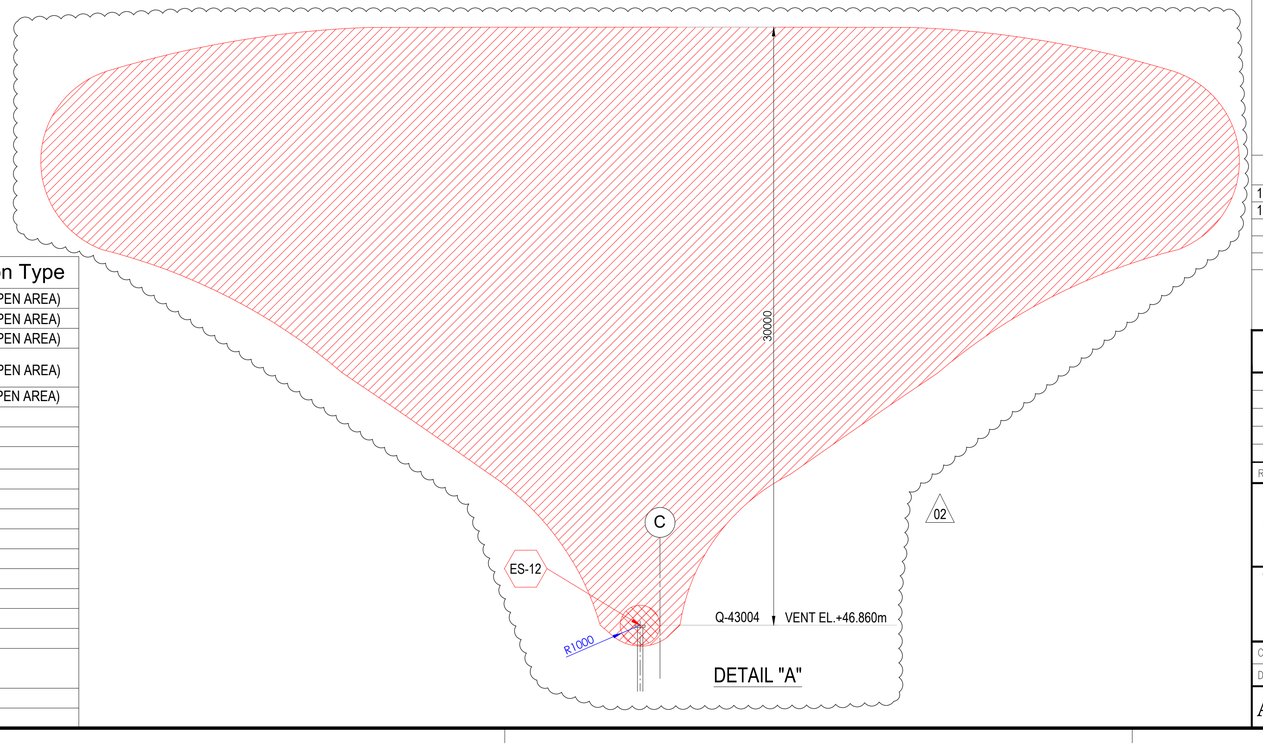



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-XV-017	: On/Off Valve - Vessel V-25001E Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001598	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		AF770301901 (Ball valve SN: 2400620190001)			
Manufacturer	Rotork			**Model**		CP/S-035-080A/AA			
Cert No.	Declaration of Conformity by Manufacturer			**Equipment Ambient Temp.**		-20°C +40°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T5	**IP Rating**	IP66/IP67

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-XV-017	: On/Off Valve - Vessel V-25001E Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001598	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-XV-017	: On/Off Valve - Vessel V-25001E Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001598	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-29	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:32:37.273Z	PROVERLIS Digitaly signed by Luca Mussi 2025-01-30T11:41:50.693Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

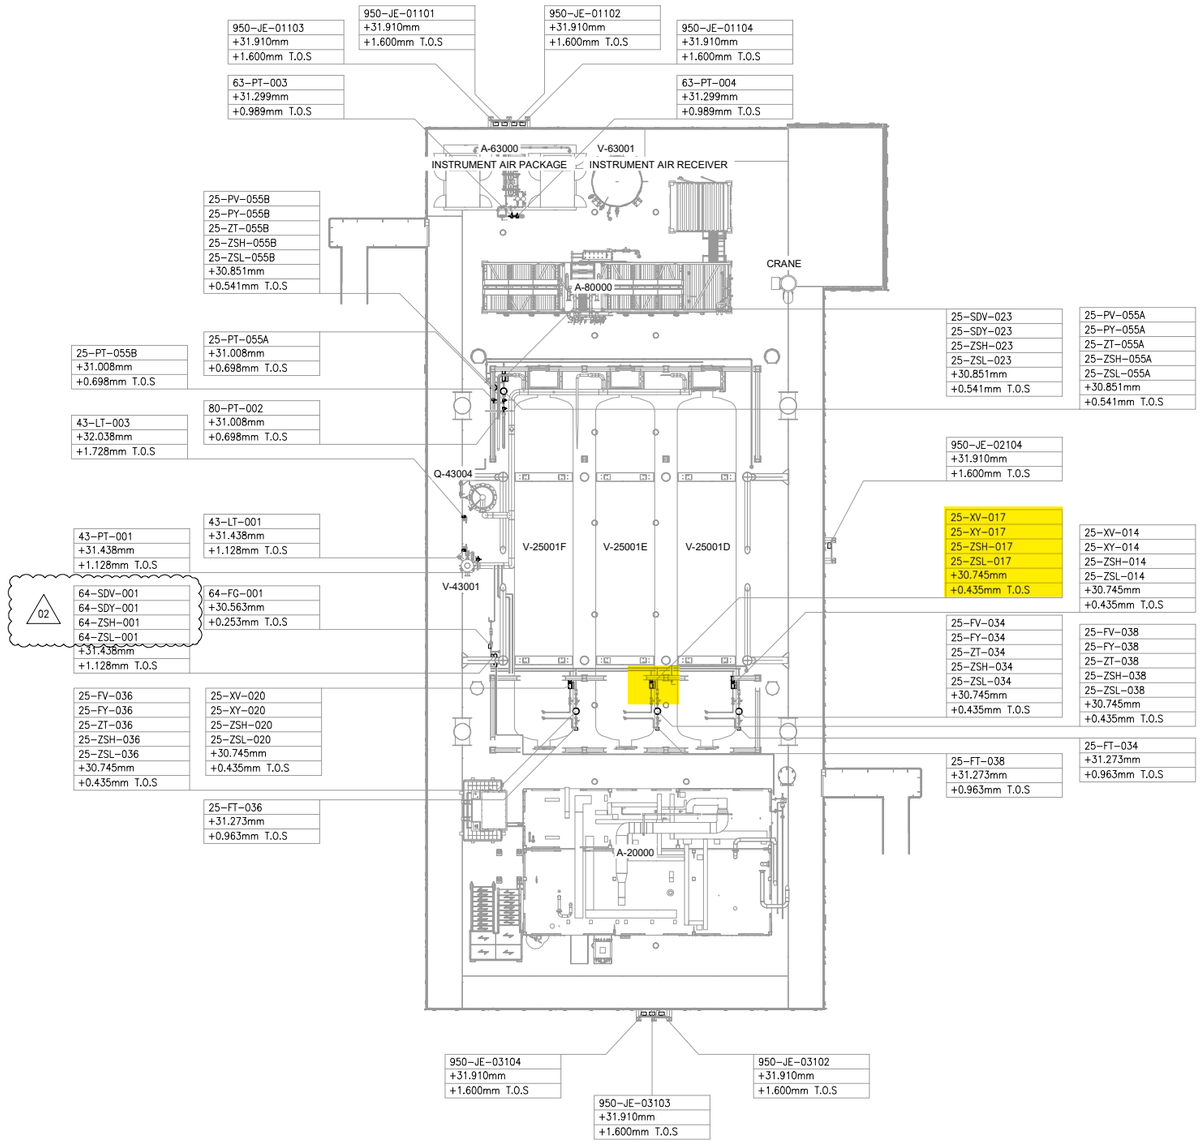


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 E

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

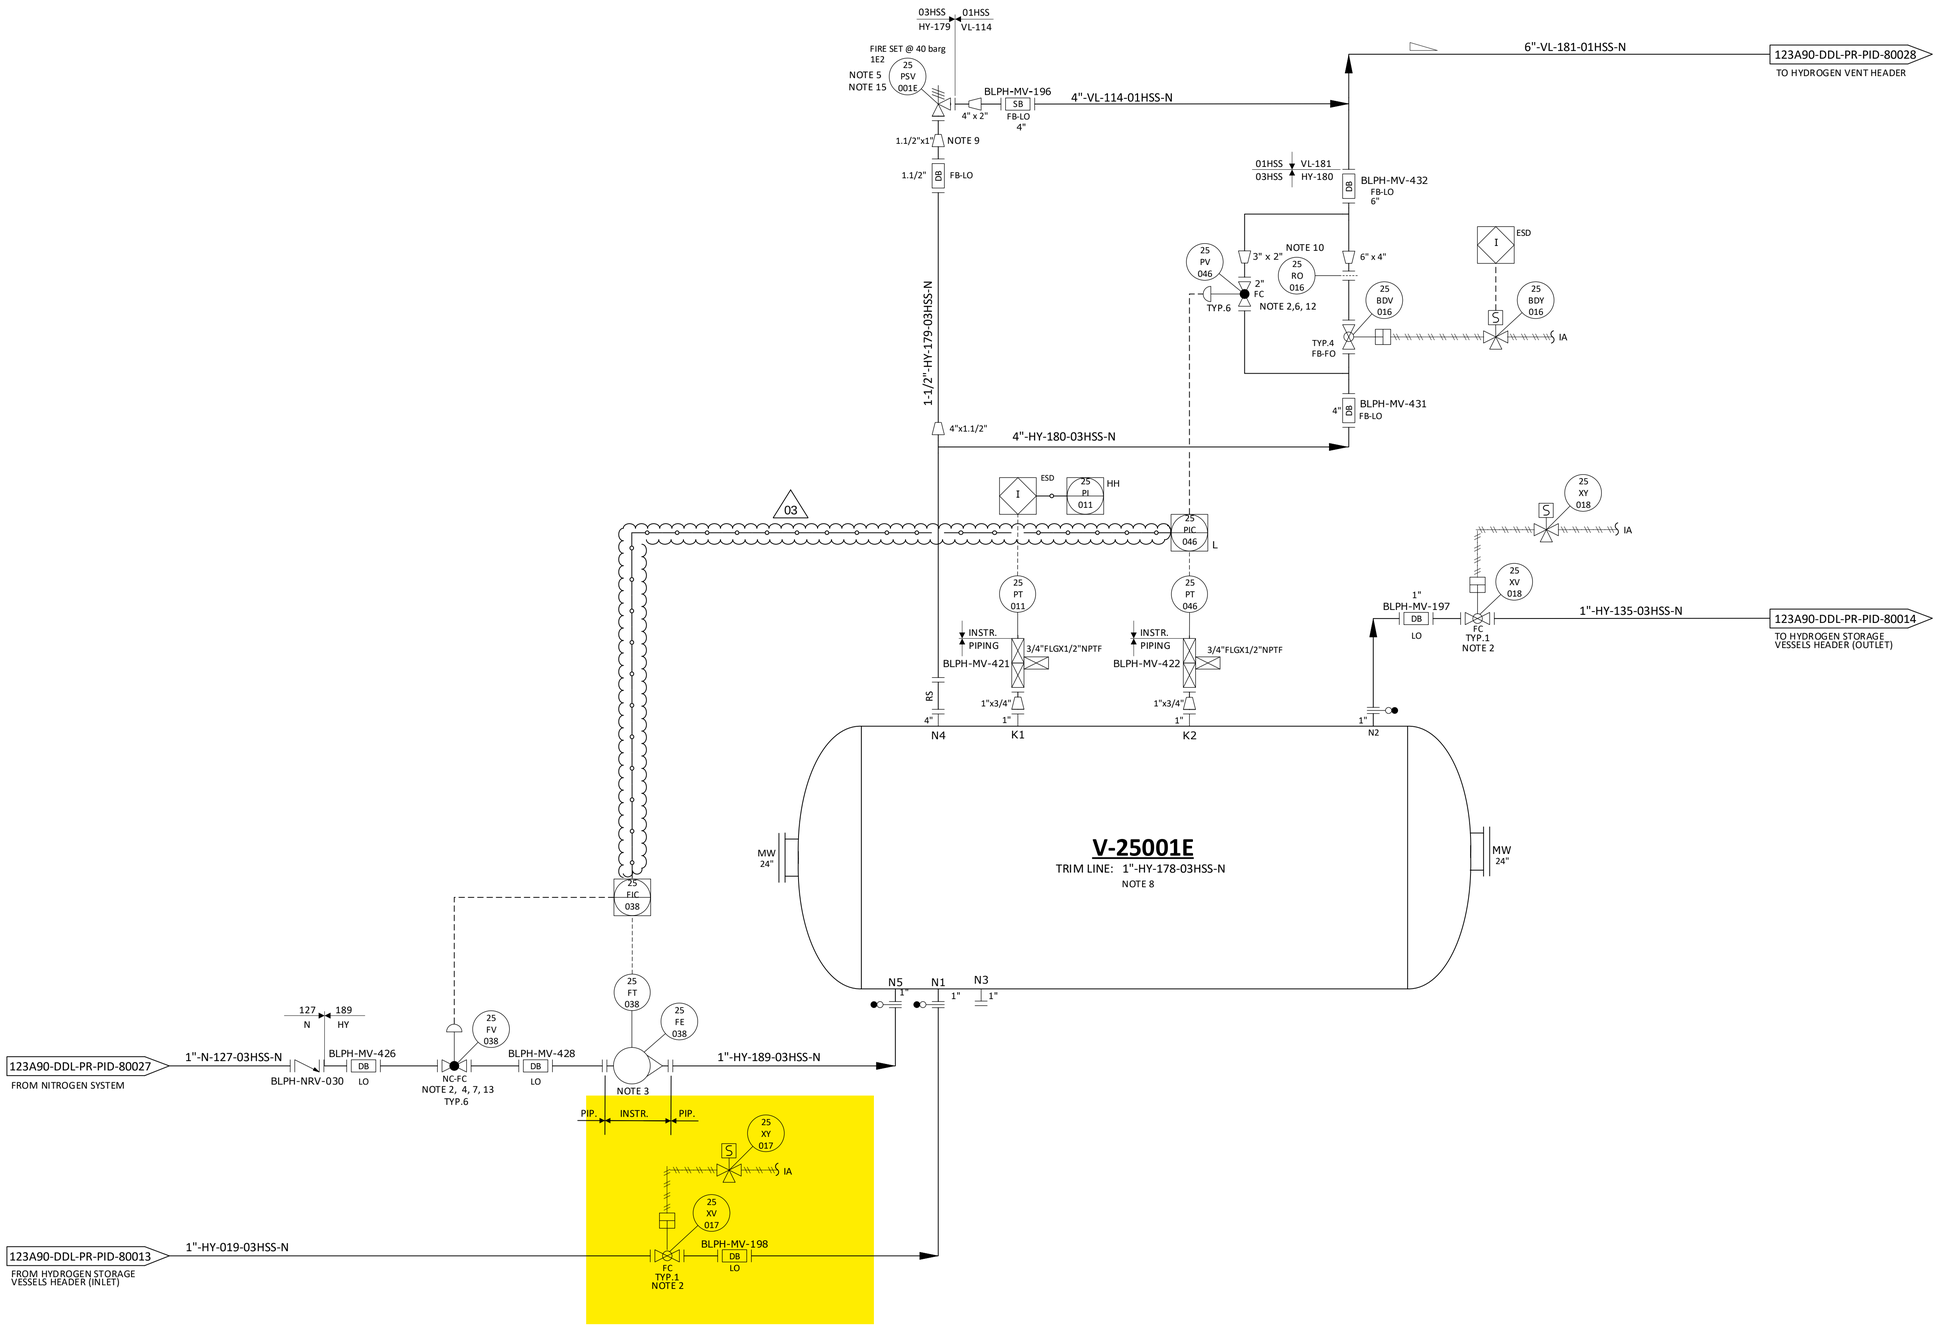

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-038) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-046 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-046 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-038 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-046 HAS FAILED TO CLOSE.
15. 25-PSV-001E SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL E

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE		
A1	DRAWING NO. 123A90-DDL-PR-PID-80019			SHEET 001	REV. 03


File Name = FILE_NAME

DRAWING NO.


REV. 00

TYPICAL INSTRUMENTATION VALVE

TYP.1 (XV - ON OFF VALVES)

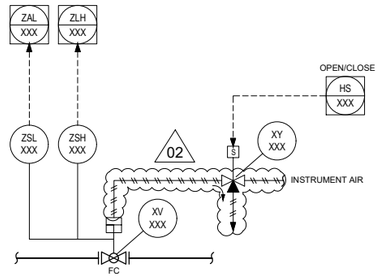


TYP.2 (SDV - SAFETY NO CRITICAL VALVES)

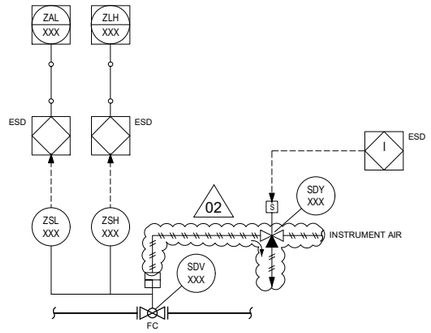


02

TYP.4 (BDV - SAFETY NO CRITICAL VALVES)

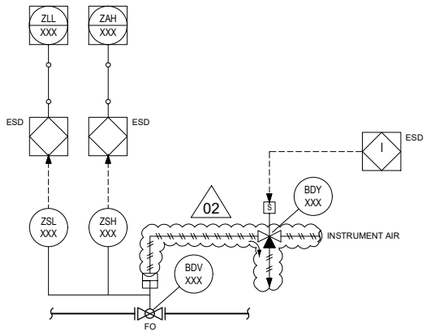

02

TYP.6 (CONTROL VALVES - CRITICAL)

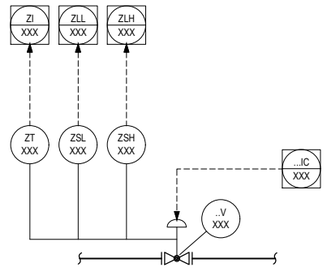


INSTRUMENT SYMBOLOGY DEFINITION

MEANINGS OF IDENTIFICATION LETTERS
THIS TABLE APPLIES TO THE FUNCTIONAL IDENTIFICATION OF INSTRUMENTS

	FIRST- LETTER		SUCCEEDING-LETTER		
	MEASURED OR INITIATING VARIABLE	MODIFIER	READOUT OR PASSIVE FUNCTION	OUTPUT FUNCTION	MODIFIER
A	ANALYSIS		ALARM		
C				CONTROL	
E			SENSOR (PRIMARY ELEMENT) ELEMENT		
F	FLOW RATE	RATIO (FRACTION)			
G			GLASS VIEWING DEVICE		
H	HAND				HIGH
I			INDICATE		
L	LEVEL				LOW
O			ORIFICE, OPEN		
P	PRESSURE, VACUUM				
R		RELIEF			
S		SAFETY		SWITCH	
T	TEMPERATURE			TRANSMIT	
V				VALVE, DAMPER, LOUVER	
X	UNCLASSIFIED				
Y				AUXILIARY DEVICES	
Z	POSITION DIMENSION				

NOTE: FOR FURTHER EXPLANATORY NOTES, REFER TO ANSI/ISA-5.1

TYP.7 (CONTROL VALVES - NOT CRITICAL)



NOTES

1. FOR GENERAL NOTES AND PIPING SYMBOLOGY SEE DRAWINGS: 123A90-DDL-PR-PID-80009 AND 123A90-DDL-PR-PID-80010.
2. DELETED.

HOLDS

1 DELETED 02


REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND | ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
INSTRUMENTATION SYMBOLOGY

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80042	SHEET 001	REV. 02

File Name :

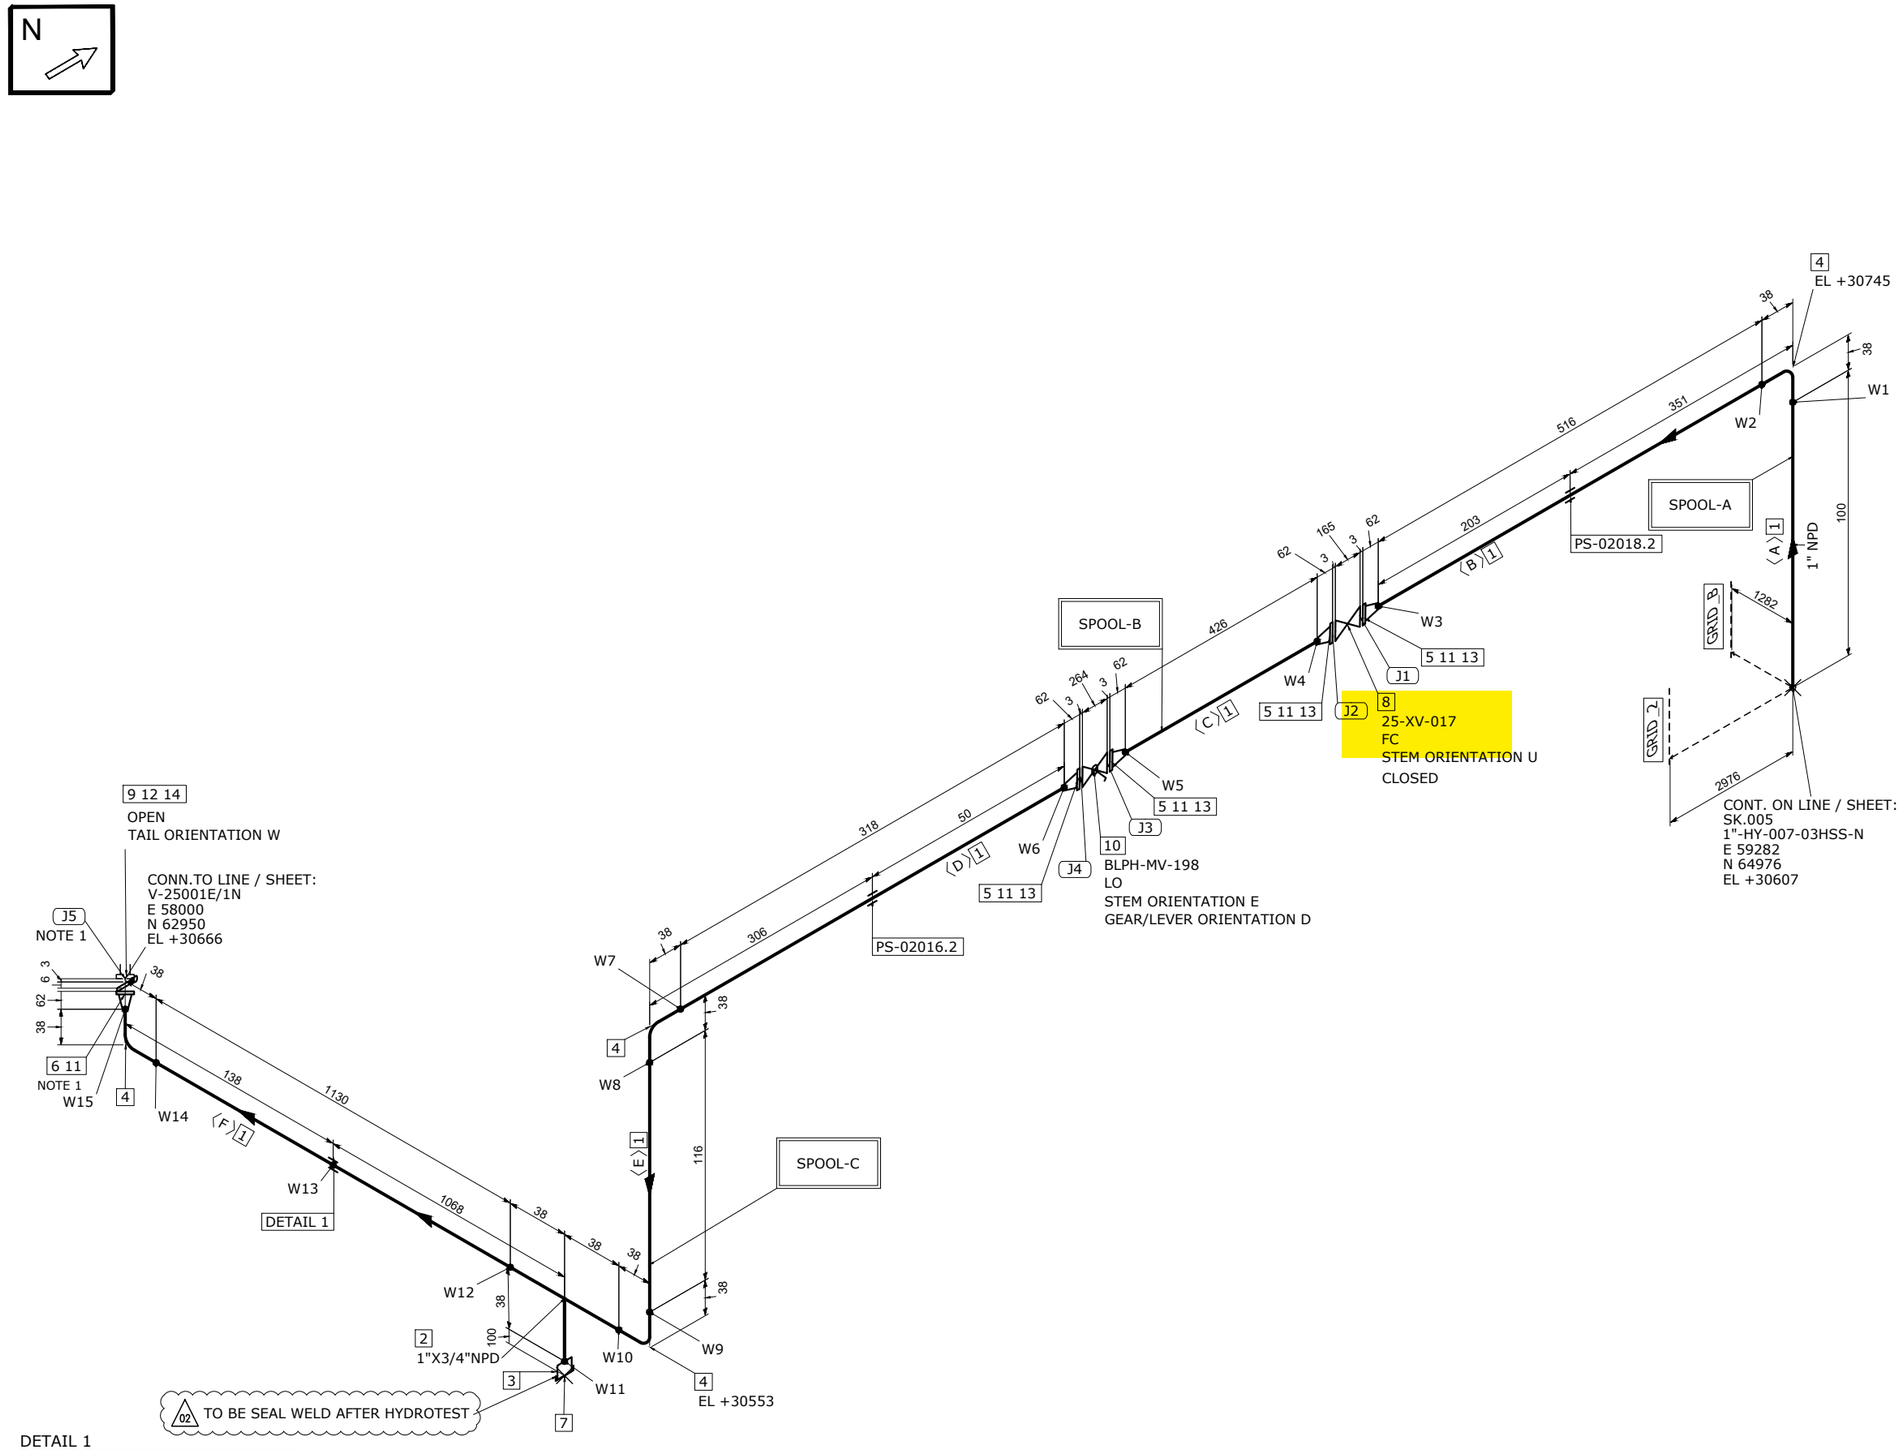

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.6M	6.6
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.8
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	3/4	BW
W12	1	BW
W13		FW
W14	1	BW
W15	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	100	BEVEL	BEVEL
B	1	516	BEVEL	BEVEL
C	1	426	BEVEL	BEVEL
D	1	318	BEVEL	BEVEL
E	1	116	BEVEL	BEVEL
F	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-02018.2
PS-02016.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	3.5
B	2	4.7
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-019-03HSS-N

SK.013

LINE DATA								
NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		


REFERENCE DOCUMENTS	
P&ID	123A90-DDL-PR-PID-80019
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES
1.JACKSCREWS POSITION N/S

MASTER

CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	N/A
DRAWN STAFF SRL	CHECKED RT	APPROVED LM	DATE 17-09-2024
FORMAT A3	DRAWING NO. 123A90-FDL-PP-DI-00013	SHEET / OF 1/1	REV. 02

E33

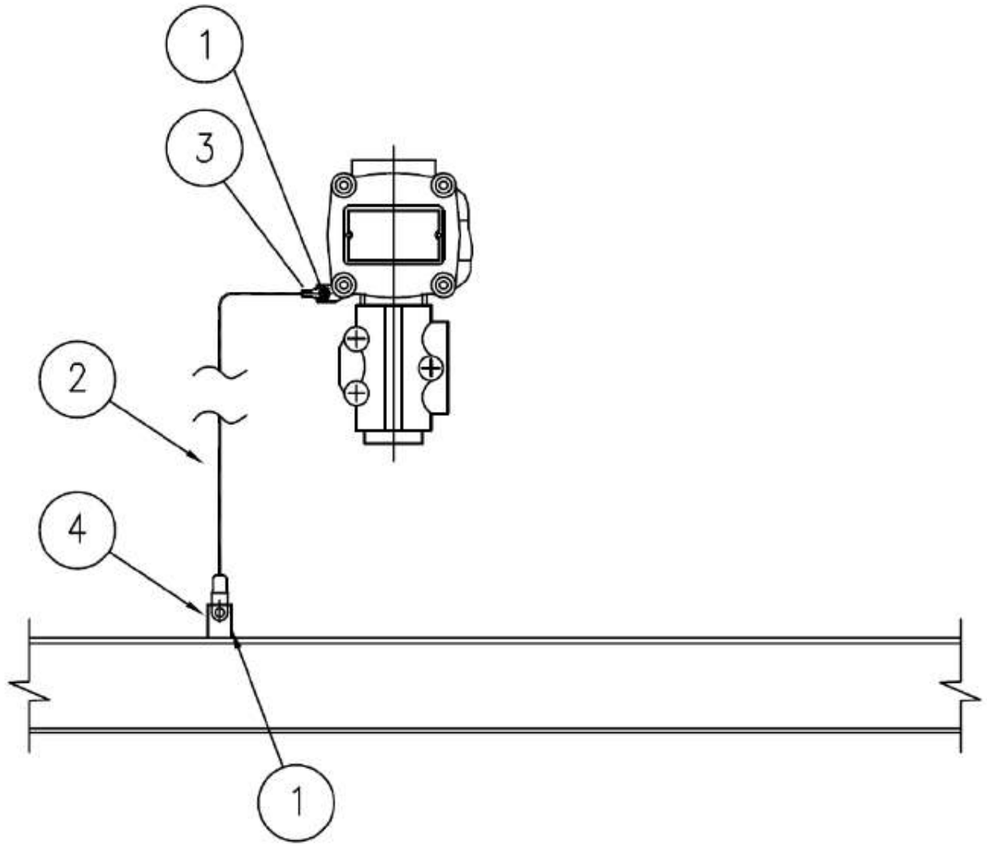

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS

A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

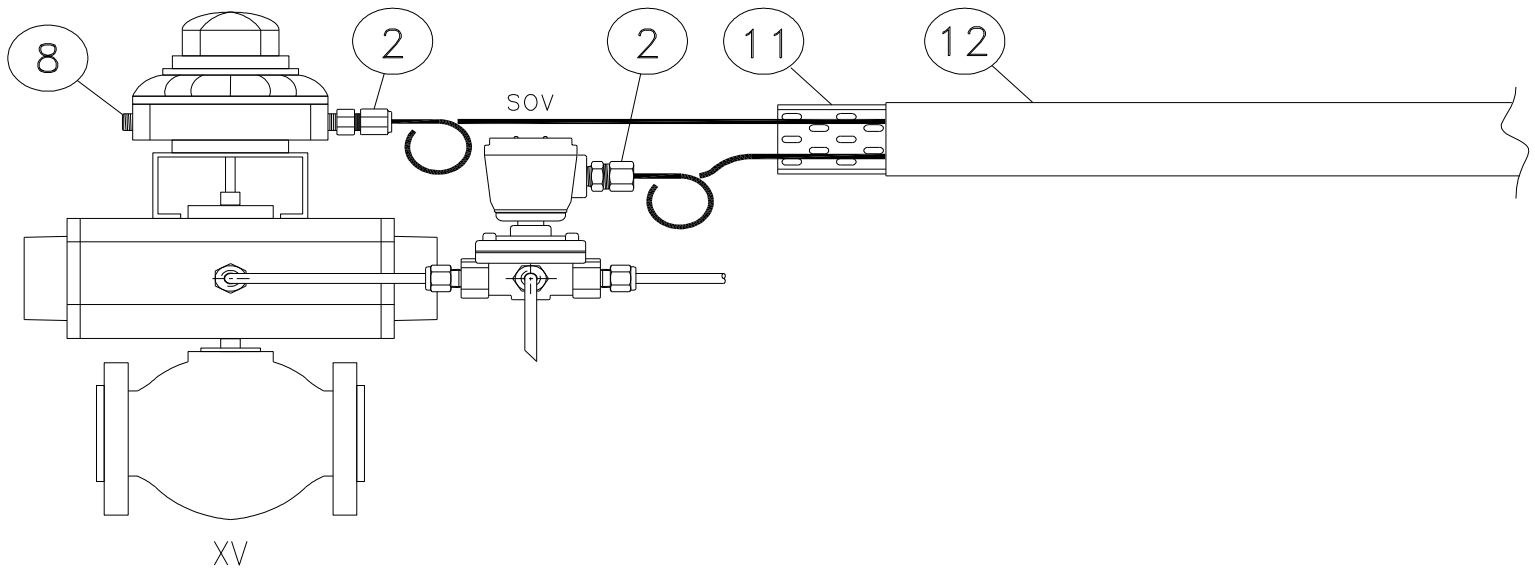

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**

REV.:	DATE:	SIGNATURE:
2_B	06/11/24	G.Randi

ROSETTI MARINO SpA

NOTE:

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy


CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Pneumatic Hook-Ups	Sh. 6 of 6 Date: 08/07/2024 Rev. 01

PNEUMATIC HOOK-UP FOR ON-OFF VALVES

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40078**

REV.:	DATE:	SIGNATURE:
1_B	06/11/24	G.Randi

ROSETTI MARINO SpA

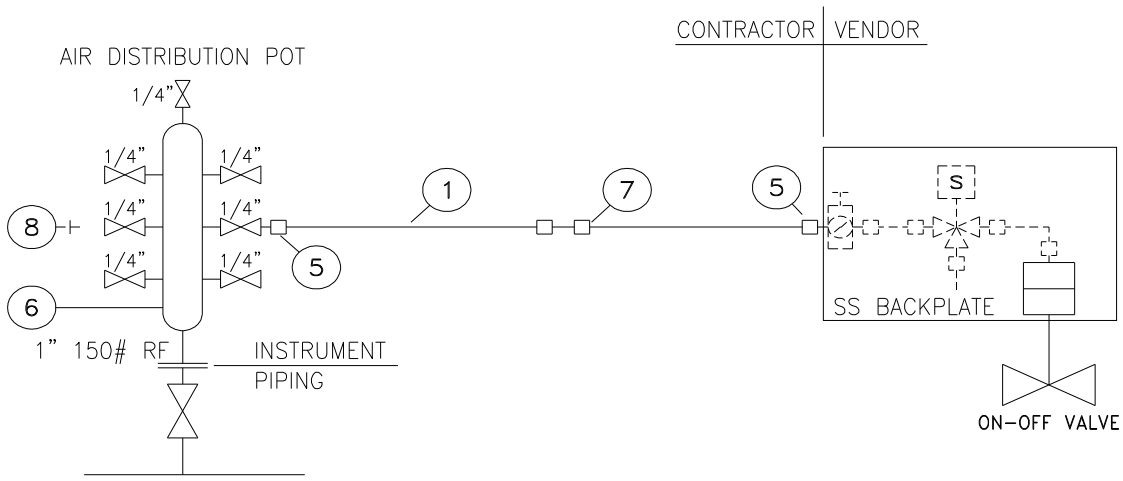



INSTRUMENT TAG	
1	25-BDV-022
2	25-BDV-005
3	25-BDV-007
4	25-BDV-010
5	25-BDV-013
6	25-BDV-016
7	25-BDV-019
8	25-SDV-001
9	25-SDV-023
10	25-XV-004
11	25-XV-006
12	25-XV-008
13	25-XV-009
14	25-XV-011
15	25-XV-012
16	25-XV-014
17	25-XV-015
18	25-XV-017
19	25-XV-018
20	25-XV-020
21	25-XV-021
22	25-XV-024
23	50-XV-001
24	50-XV-002
25	50-XV-003
26	50-XV-004
27	80-XV-001
28	64-SDV-001
29	50-XV-005
30	

NOTE:
(1) For Air Distribution Pot quantities see material take-off on sh. 4


POS.	NORM/STD CODE	DESCRIPTION	SIZE/CONNECTION TYPE	Q.TY
8		SS316 PLUG	1/4" NPT	Note 1
7		SS316 UNION	1/2" O.D. x 1/2" O.D.	N. 1
6		SS316 AIR DISTRIBUTION POT	1" 150#RF - N. 7 1/4" BALL VALVES	Note 1
5		SS316 MALE CONNECTOR	1/4" NPT x 1/2" O.D.	N. 2
1		SS 316L TUBING	1/2" x 0,049"Thk	10 m


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

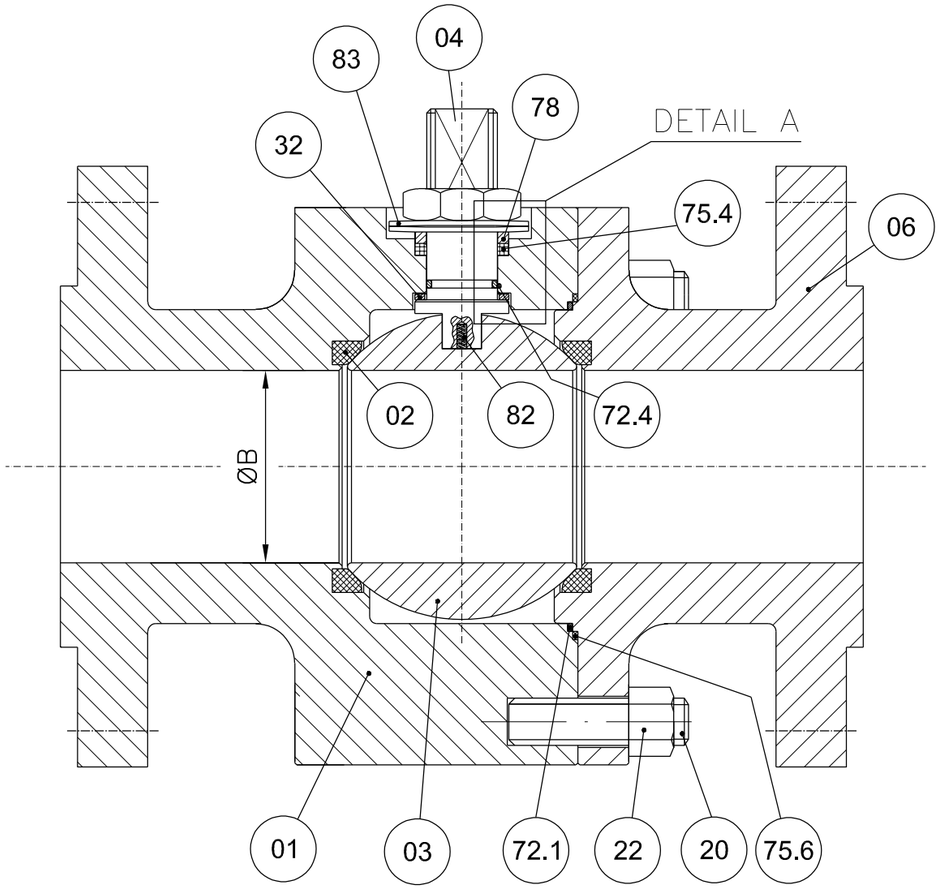




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-017		25
	2	Service				HYDROGEN STORAGE TANK V-25001E INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80019		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-019-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-017 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-017 (9, 17) - Soldo SS		25-ZSH-017 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

94	IFR	25-XV-009	floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR	25-XV-011	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR	25-XV-012	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR	25-XV-014	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR	25-XV-015	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR	25-XV-017	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR	25-XV-018	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

CONFORMITY DECLARATION ACCORDING TO EUROPEAN DIRECTIVE 2014/68/UE

DICHIARAZIONE DI CONFORMITÀ AI SENSI DELLA DIRETTIVA EUROPEA 2014/68/UE

THE MANUFACTURER
IL FABBRICANTE

Name Nome	FLUITEK ORSENIGO VALVES S.R.L.
Legal representative and role Legale rappresentante	P. Belotti – Managing Director
Declaration of conformity nr. Dichiarazione di conformità no.	240062
Sede legale Legal office	Via Dei Livelli di Sopra, 7/5 – 24060 COSTA DI MEZZATE (BERGAMO) – ITALY
Sede produttiva Operational office	Via Dei Livelli di Sopra, 7/5 – 24060 COSTA DI MEZZATE (BERGAMO) – ITALY
E-mail E-mail	info@fluitekvalves.com
Website Sito internet	www.fluitekvalves.com
Telephone Telefono	+39 035 666 501
Fax Fax	+39 035 666 5047

DECLARE THAT THE FOLLOWING PRESSURE EQUIPMENT
DICHIARA CHE I SEGUENTI ACCESSORI A PRESSIONE

JOB	FOV Pos.	Serial Number	Client Item	PO N.	Description	Quantity
240062	001	2400620010001	10	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	002	24000620020001	20	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	003	2400620030001	30	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	004	2400620040001	40	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	005	2400620050001	50	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	006	2400620060001	60	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	007	2400620070001	70	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	008	2400620080001	80	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	009	2400620090001	90	1724000204 123A90A	Ball valve 1-1/2'' 300#	**1**
240062	010	2400620100001	100	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	011	2400620110001	110	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	012	2400620120001	120	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	013	2400620130001	130	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	014	2400620140001	140	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	015	2400620150001	150	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	016	2400620160001	160	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	017	2400620170001	170	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	018	2400620180001	180	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	019	2400620190001	190	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	020	2400620200001	200	1724000204 123A90A	Ball valve 1'' 300#	**1**

Fluitek Valves	**CONFORMITY DECLARATION ACCORDING TO EUROPEAN DIRECTIVE 2014/68/UE** DICHIARAZIONE DI CONFORMITÀ AI SENSI DELLA DIRETTIVA EUROPEA 2014/68/UE

240062	021	2400620210001	210	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	022	2400620220001	220	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	023	2400620230001	230	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	024	2400620240001	240	1724000204 123A90A	Ball valve 1-1/2'' 150#	**1**
240062	025	2400620250001	250	1724000204 123A90A	Ball valve 1'' 150#	**1**
240062	026	2400620260001	260	1724000204 123A90A	Ball valve 1-1/2'' 150#	**1**
240062	027	2400620270001	270	1724000204 123A90A	Ball valve 1'' 150#	**1**
240062	028	2400620280001	280	1724000204 123A90A	Ball valve 1'' 150#	**1**

MET THE REQUIREMENTS OF DIRECTIVE 2014/68/UE
SONO CONFORMI AI REQUISITI DELLA DIRETTIVA 2014/68/UE

Conformity assessment procedure used: Procedura di valutazione di conformità utilizzata:	Module H annex III of Directive 2014/68/UE Modulo H Allegato III della Direttiva 2014/68/UE
Notified Body charged of conformity assessment: Organismo Notificato incaricato della valutazione di conformità:	Bureau Veritas (Notified Body No.1370) Bureau Veritas (Ente Notificato N°1370)
Not armonized standards applied to design and manufacture: Norme non armonizzate applicate alla progettazione e alla fabbricazione:	ASME B16.34, ASME VIII, ASME IX, UNI EN 1503 Part.2 ASME B16.34, ASME VIII, ASME IX, UNI EN 1503 Part.2
Classificazione dei fluidi condotta in conformità ai requisiti del	Regolamento CLP CE 1272/2008 Fluid group: **1**

Place COSTA DI MEZZATE (BG), Italy
Luogo COSTA DI MEZZATE (BG), Italia

Date 14/01/2025
Data



Signature
Firma

Fluitek Valves	**DECLARATION OF CONFORMITY ATEX 2014/34/EU** *Dichiarazione di Conformità ATEX 2014/34/EU*	**Cert. DDC No.** **240062 ATEX**

GENERAL INFORMATION – *INFORMAZIONI GENERALI*

Customer ***Cliente***	ROSETTI MARINO S.P.A.		
P. Order ***Ordine***	1724000204 123A90A	**Item/s** ***Item/s***	ALL
FOV Job ***Commessa FOV***	240062	**Position/s** ***Posizione/i***	ALL
Subject ***Oggetto***	BALL VALVE		
Date of execution ***Data di esecuzione***	24/07/2024		

STATEMENT – *DICHIARAZIONE*

We declare that this product has been manufactured in accordance with the Euporean Directive 2014/34/EU to the classification II 2 G/D Tx c.
Technical standards and specifications used are referenced in the Fluitek Orsenigo valves above stated internal job.
The equipment satisfies the provision of directive 2014/34/EU and of standards EN 1127-1, UNI CEI EN ISO 80079-36:2016.
Technical file deposited to Notified Body TUV RHEINLAND 0035.

REMARKS – *NOTE*

SIGNATURE – *FIRME*

Inspection Authority ***Ente Ispettivo***	**Customer Inspector** ***Ispettore Cliente***	**Quality Control** ***Controllo qualità***
		FLUITEK ORSENIGO VALVES S.R.L. Q.C.

rotork Fluid Systems	EU Declaration of Conformity	Rif. JOB nr: AF7703

Manufacturer: Rotork Fluid Systems S.r.l.

Address: Via Padre Jacques Hamel, 138/B
55016 Porcari, Lucca – Italy
Tel. +39 0583 2221
Fax. +39 0585 091362

Section PED: ☐ Applicable ☒ Not Applicable

Under its sole responsibility declares that the items specified below have been designed, manufactured, inspected and tested as required by the relevant provisions of the Pressure Equipment Directive 2014/68/UE.
The equipment has been submitted to the following conformity assessment procedures:

☐**Module H**: **CE-1370-PED-H-RTK 001-23-ITA** **Serial No.:**

☐ **Module H1**: **CE-1370-PED-H1-RTK 001-23-ITA** **Serial No.:**
CE-1370-PED-H1D-RTK 001-20-ITA
CE-1370-PED-H1D-RTK 002-20-ITA

Notified Body: Bureau Veritas Italia SPA Viale Monza 347 20126 MI – Italy
NB Number: 1370

Description: The pressure equipment is a part pressure of pneumatic actuator that is product of Rotork Fluid Systems for quart turn and linear valve. It is composed by a cylinder can and two flanges packaged by tie rods.

Other technical standards and specifications used:
VSR rev.1995; RACCOLTA "M"; RACCOLTA "S"; AD 2000-Merkblatt; ASME VIII Div.1/Div.2; ASME II; EN 13445-3

Section ATEX:

Under its sole responsibility declares that the actuators model:

☒ **GP/GH, CP/CH, RP/RH, LP/LH, HPG, HPL MARKED:** **II 2 G Ex h IIC T5 Gb X**
II 2 D Ex h IIIC T100°C Db X
IP 66M/67M

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / EN 60529

☐ **CQP/CQH MARKED:** **II 2 G Ex h IIC T5 Gb X**
II 2 D Ex h IIIC T100°C Db X
IP 66/68

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / EN 60529

☐ **GO, GOL, EH MARKED:** **II 2 G Ex 60079-46 II_ T_ _ X**
(II 2 D Ex 60079-46 III_ T_ _X)
IP 6_

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / IEC 60079-46, EN 60529

The conformity has been evaluated according to ***Annex VIII (Article 13, Point 1. (b)(ii))*** *of* ***ATEX 2014/34/EU*** *directive.*
TECHNICAL FILE N° TR 219 *(Receipt Number:* ***BVI/ATEX/ITA/24/080*** *Bureau Veritas ITA)*

Section API 6DX: ☐ Applicable ☒ Not Applicable

Under its sole responsibility, the Manufacturer declares that the items specified above have been designed, manufactured, inspected, and tested as required by the applicable provisions of the current edition of the product standard API 6DX and all addenda.


SIGNED ON BEHALF OF ROTORK FLUID SYSTEMS S.R.L. (authorized representative of):

Legal Representative: Metin Gerceker **Signature:**


Place / date: Porcari / 05/02/2025

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

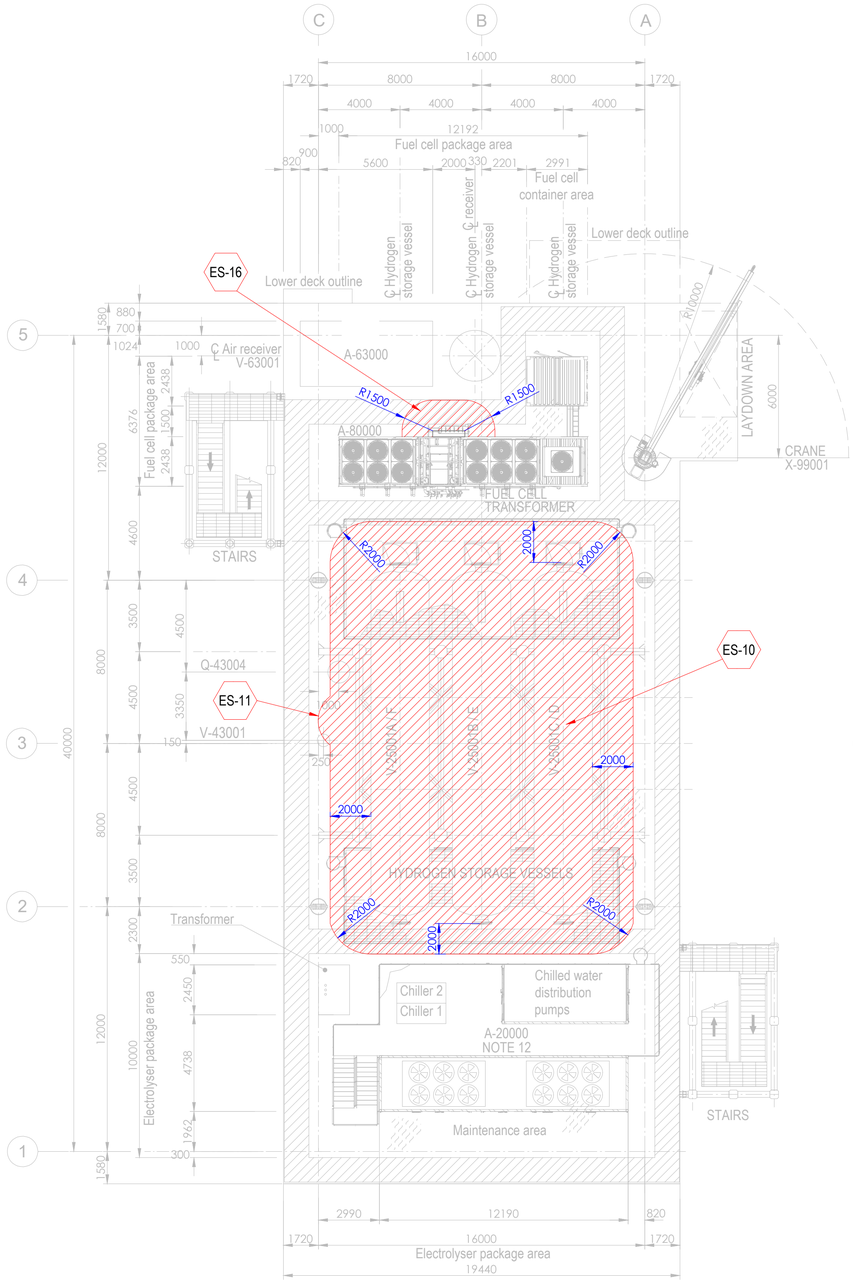


PLAN ON UPPER DECK
EL+30.310 T.O.S.

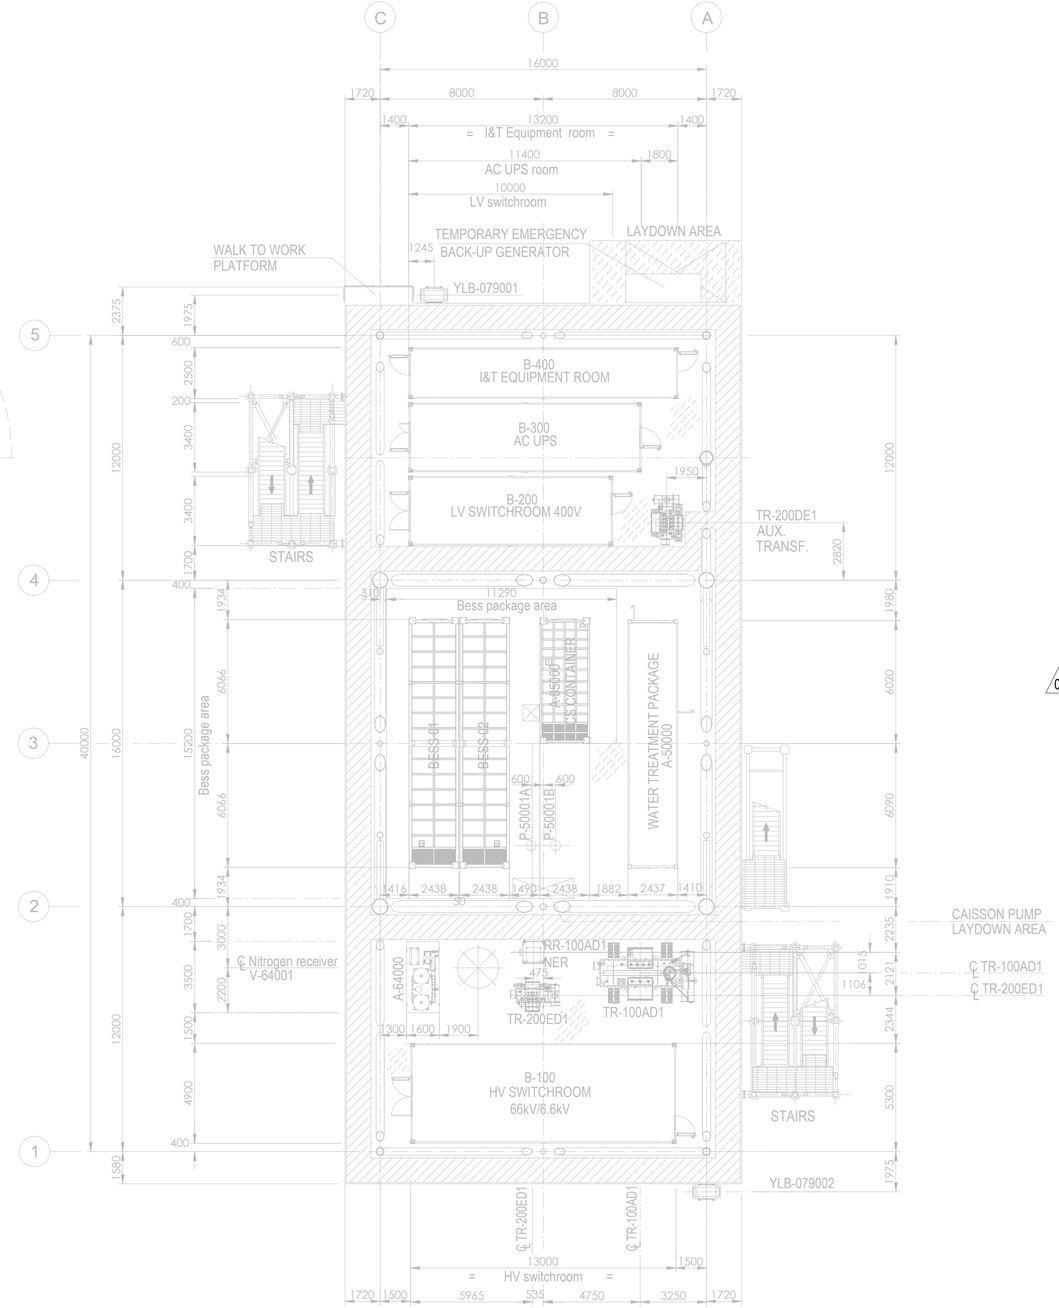

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

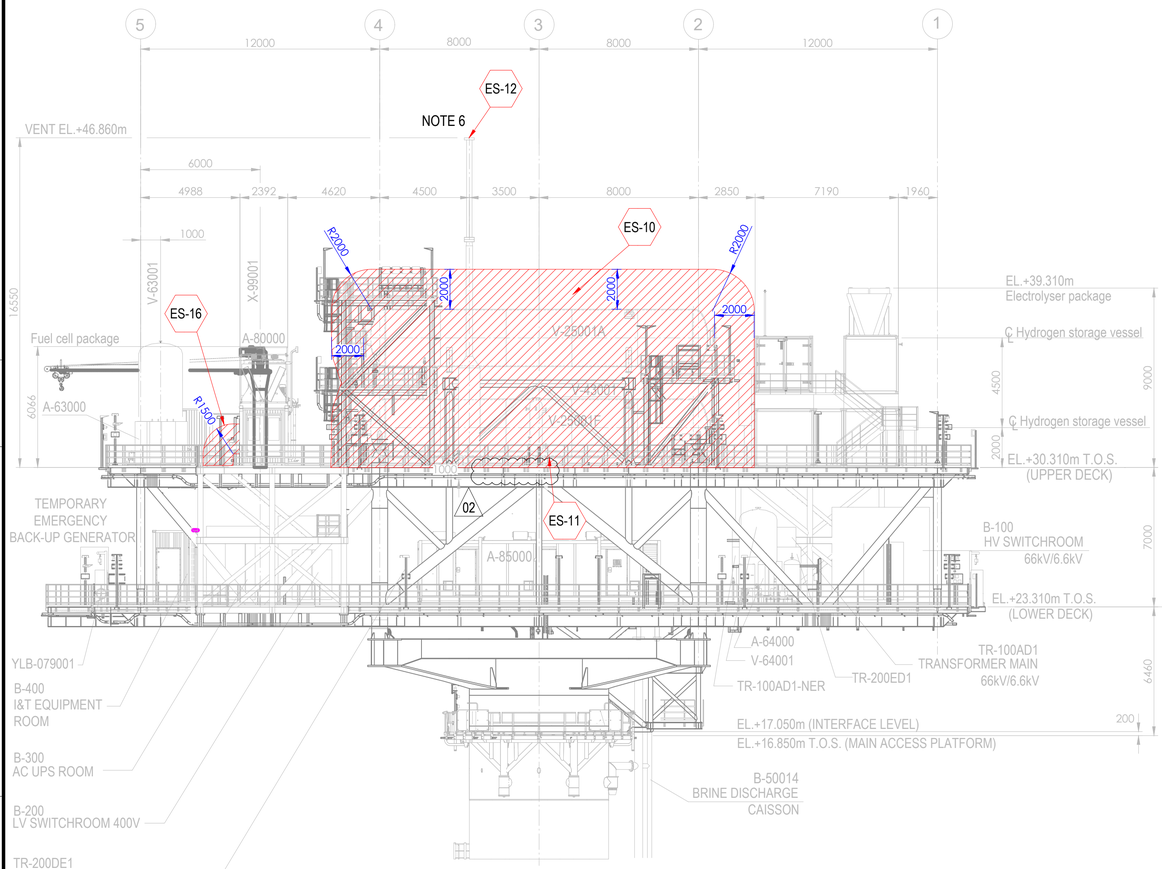



ELEVATION LOOKING EAST

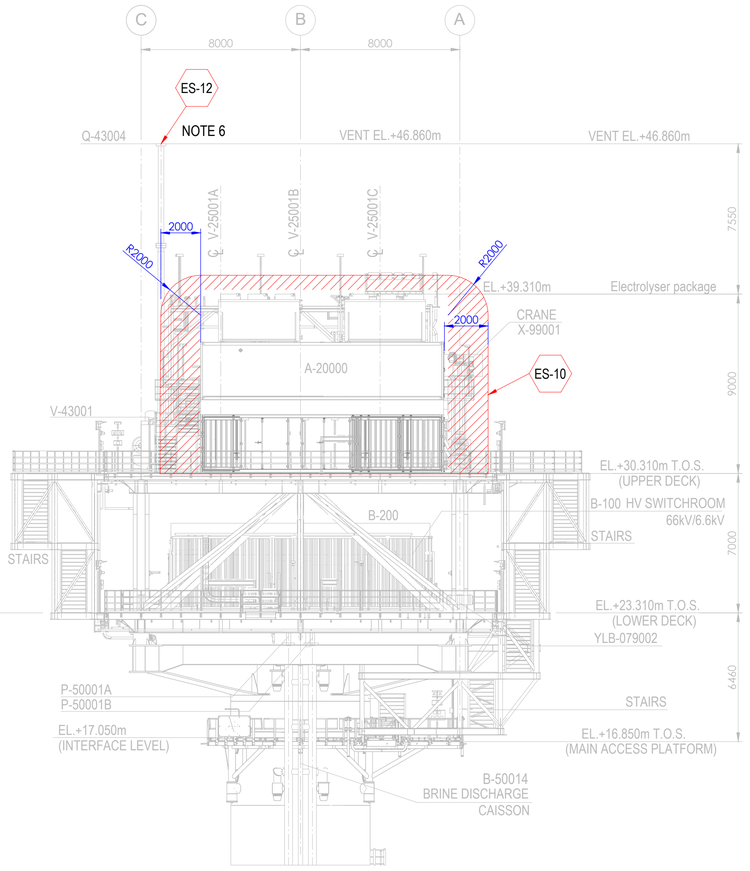

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

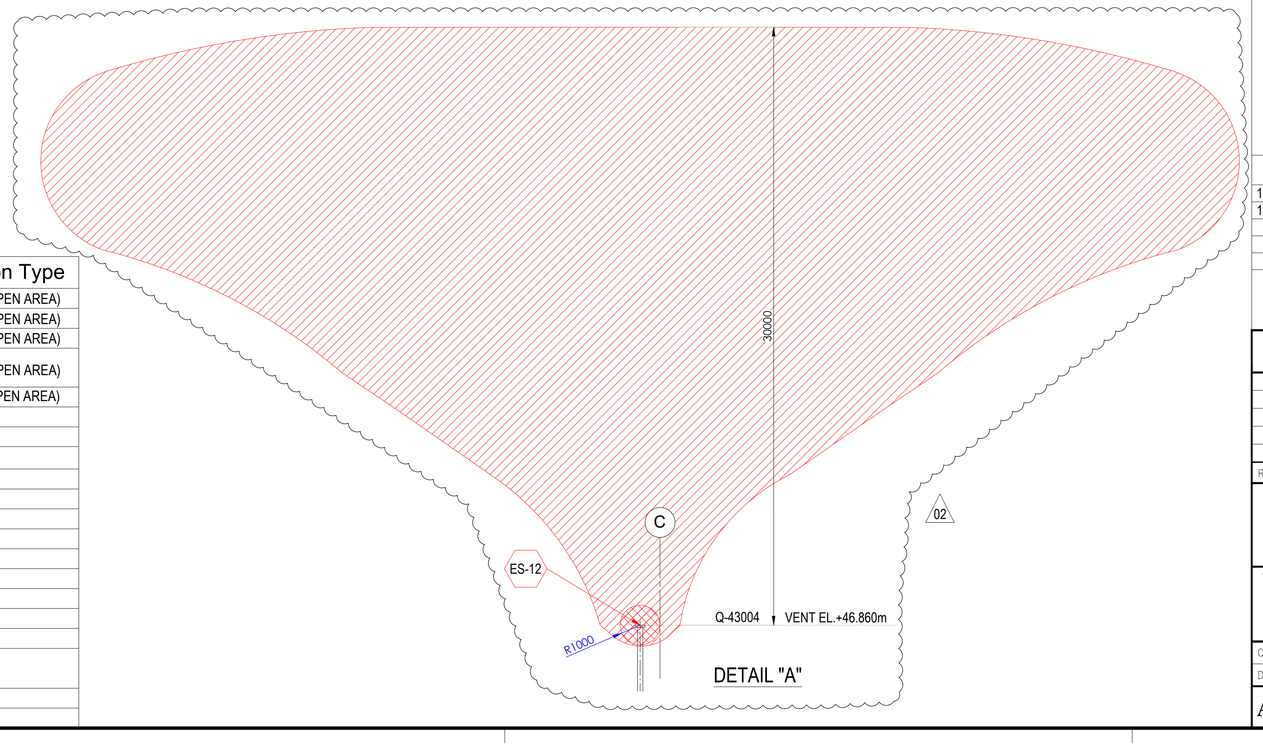



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-XV-020	: On/Off Valve - Vessel V-25001F Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80020		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001600	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		AF770302101 (Ball valve SN 2400620210001)			
Manufacturer	Rotork			**Model**		CP/S-035-080A/AA			
Cert No.	Declaration of Conformity by Manufacturer			**Equipment Ambient Temp.**		-20°C +40°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T5	**IP Rating**	IP66/IP67

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-XV-020	: On/Off Valve - Vessel V-25001F Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80020
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001600		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	25-XV-020	: On/Off Valve - Vessel V-25001F Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80020		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001600	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks					
67	All Terminals are Ex n certified (if required on certificate)	x	NA		
68	Hermetically sealed and enclosed break devices are undamaged	x	NA		
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA		
70	Test port, if fitted, is functional (type “nR” only)	x	NA		
71	Breathing operation is satisfactory (type “nR” only)	x	NA		
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA		
73	The ventilation airflow is not impeded	x	NA		
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA		
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA		
76	Variable voltage/frequency installation complies with documentation	x	NA		
Extra Ex p checks					
77	Pressurization gas is correct type	x	NA		
78	Actual pressure is within maximum and minimum settings for equipment	x	NA		
79	Timers set as per certification documentation	x	NA		
80	Alarms and trip functions operate correctly as per certification documentation	x	NA		
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA		
82	Automatic electrical protective devices operate within permitted limits	x	NA		
83	Automatic electrical protective devices are set correctly	x	NA		
84	Protective gas inlet temperature is below maximum specified	x	NA		
85	Ducts, pipes and enclosures are in good condition	x	NA		
86	Protective gas is substantially free from contaminants	x	NA		
87	Protective gas pressure and/or flow is adequate	x	NA		
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA		
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA		
90	Specific conditions of use (if applicable) are complied with		NA		
Extra Ex i (Intrinsically Safe – IS) checks					
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA		
92	Cables are installed in accordance with the documentation	x	NA		
93	Segregation is maintained between IS and non-IS Circuits	x	NA		
94	Cable screens are isolated at one end (field side)	x	NA		
95	Cable screens are earthed in accordance with the documentation	x	NA		
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA		
97	Equipment installed is the one specified in the documentation	x	NA		
98	Ambient temperature range of the apparatus is correct for the installation	x	NA		
99	Service temperature range of the apparatus is correct for the installation	x	NA		
100	Installation is clearly labelled	x	NA		
101	Printed circuit boards are clean and undamaged	x	NA		
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA		
103	Point-to-point connections are all correct	x	NA		
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA		
105	Earth connections maintain the integrity of the type of protection	x	NA		
106	Intrinsically safe circuit earthing is satisfactory	x	NA		
107	Insulation resistance is satisfactory	x	NA		
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA		

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-25	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-25T13:52:24.071Z	PROVERLIS Digitaly signed by Luca Mussi 2025-01-30T11:42:01.621Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

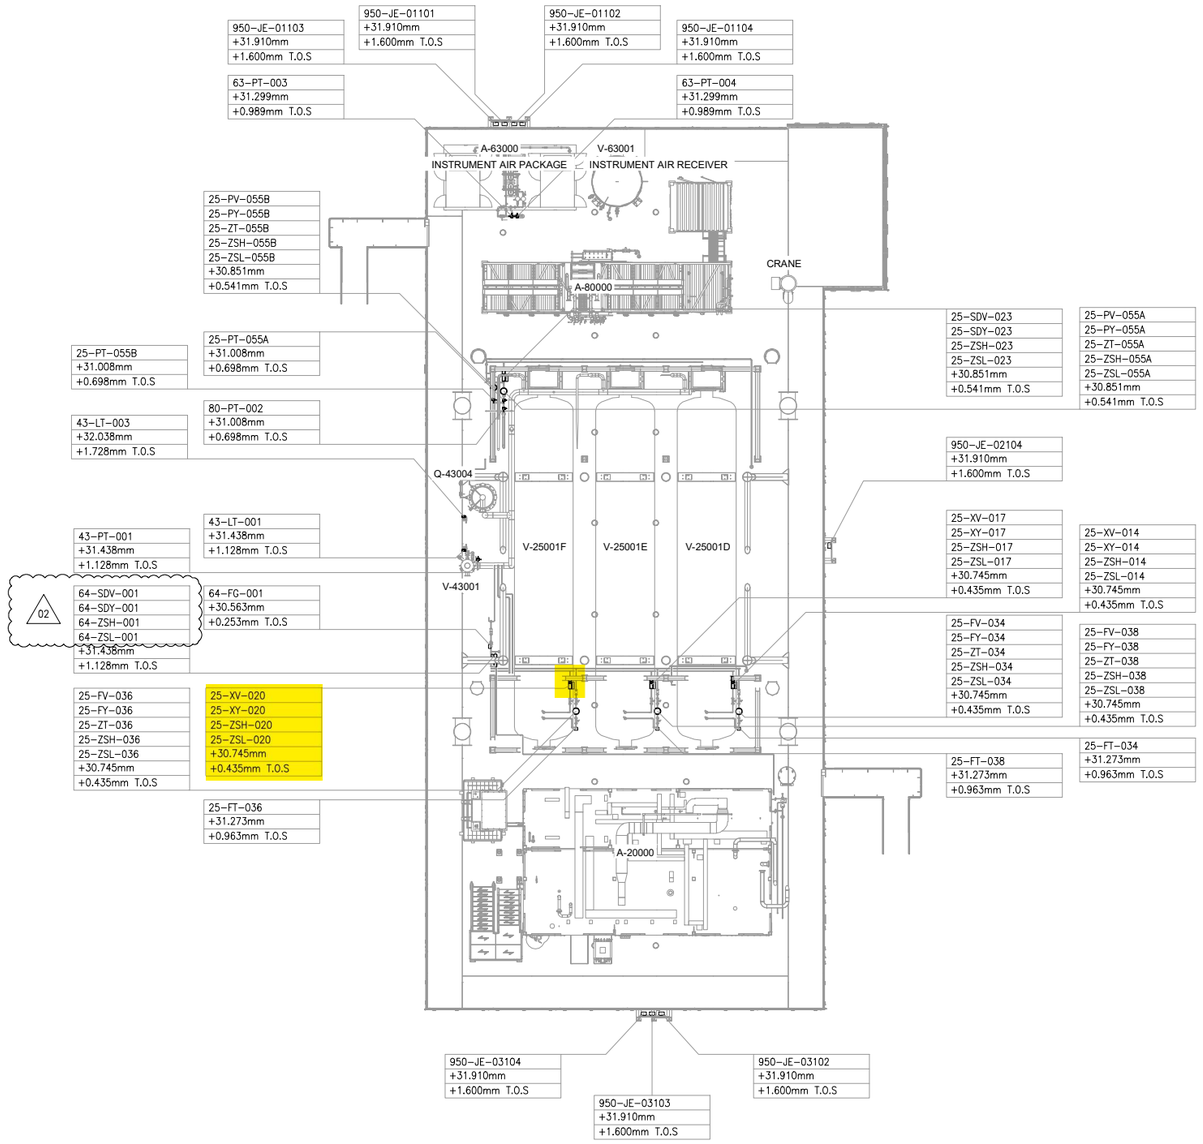


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001_F

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

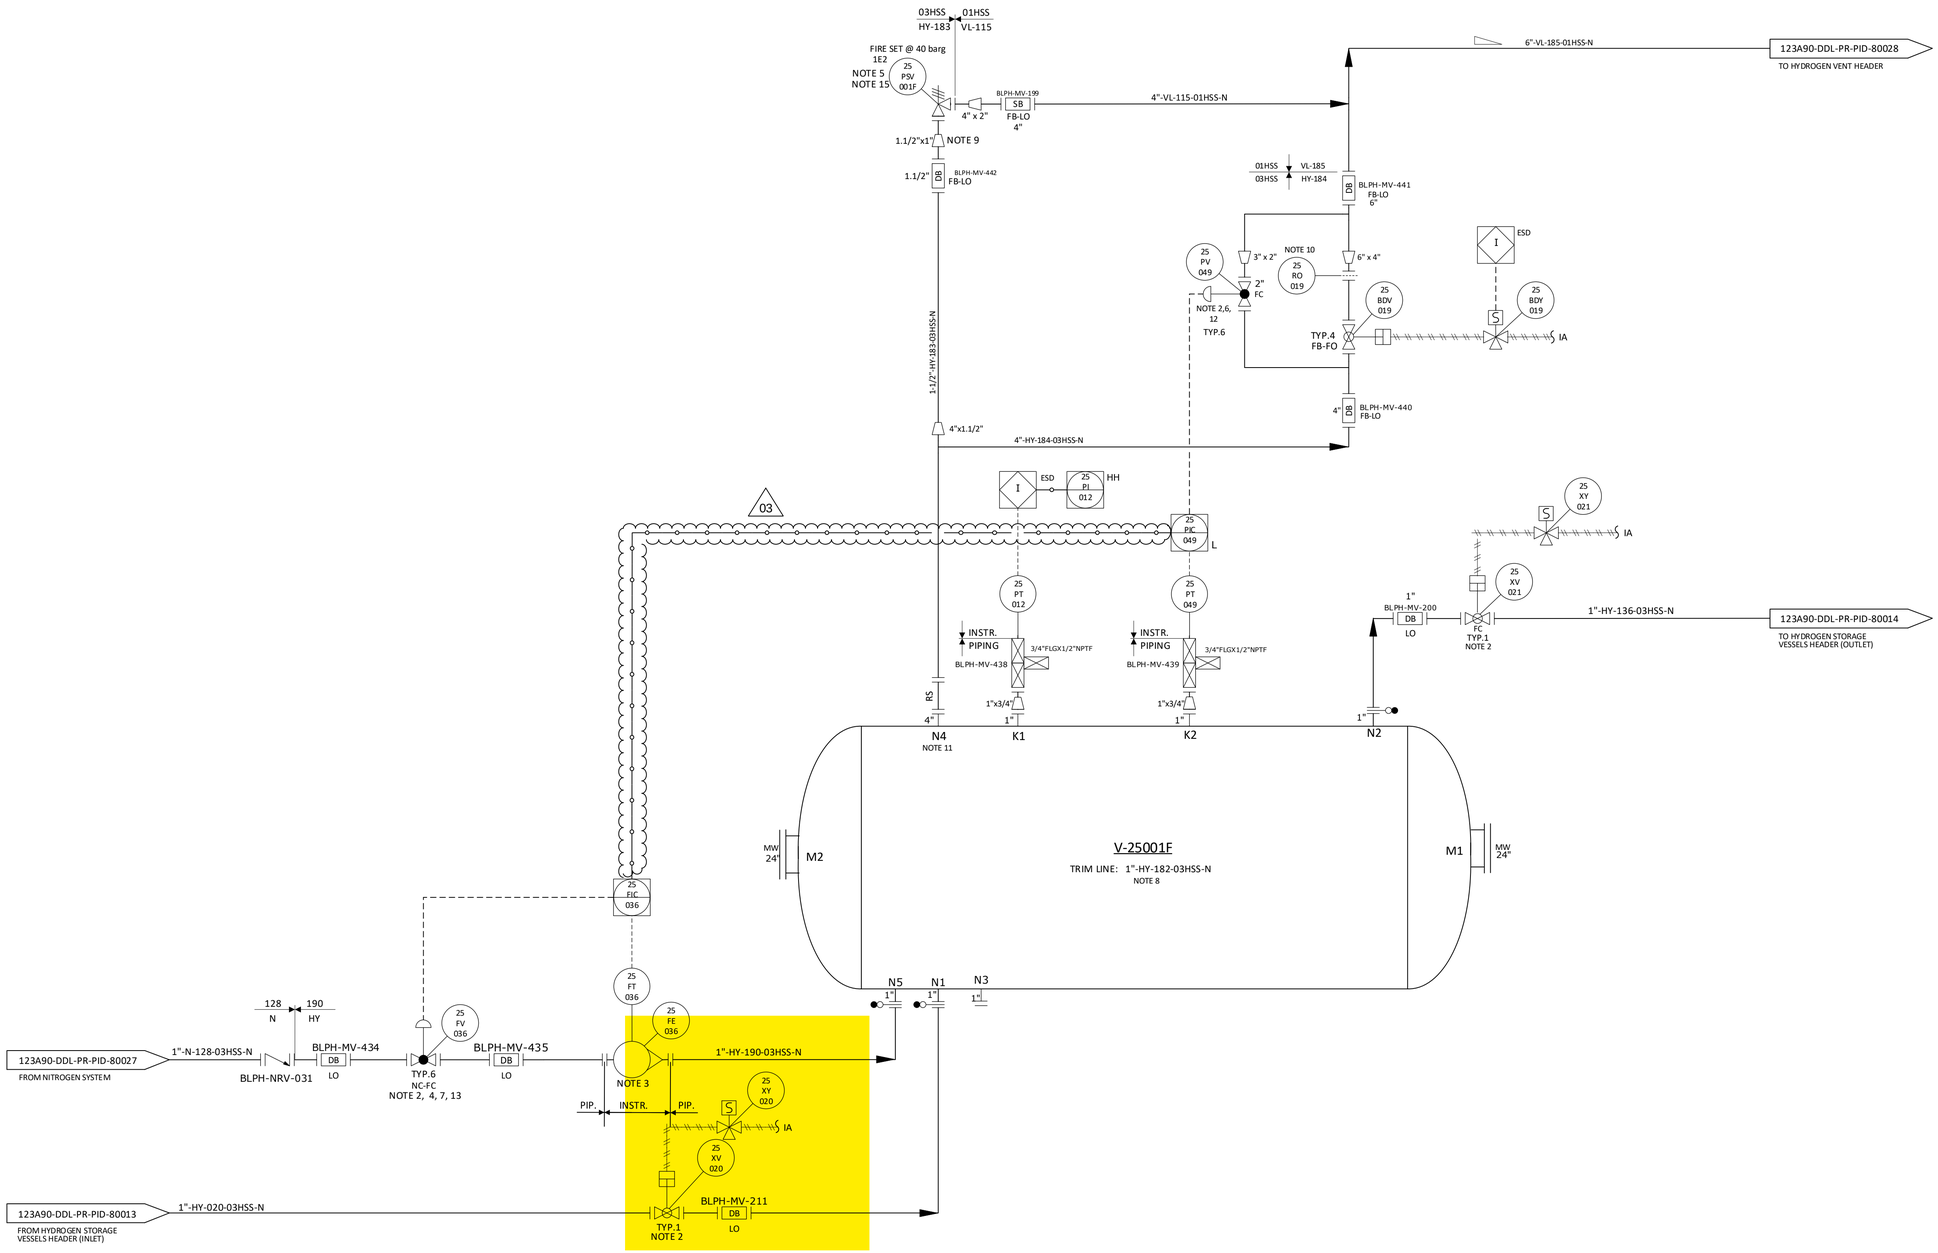

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-036) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-049 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-049 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25FV036 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-049 HAS FAILED TO CLOSE.
15. 25-PSV-001F SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR HAZOP (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL F

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80020		SHEET 001	REV. 03


File Name = FILE_NAME

DRAWING NO.


REV. 00

TYPICAL INSTRUMENTATION VALVE

TYP.1 (XV - ON OFF VALVES)

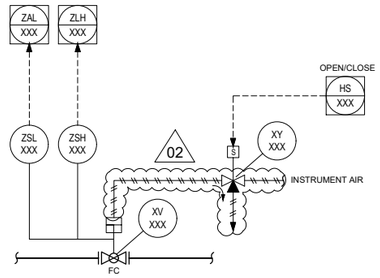


TYP.2 (SDV - SAFETY NO CRITICAL VALVES)

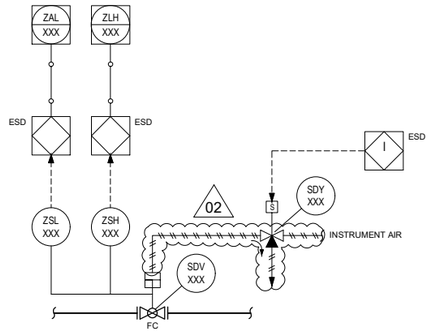


02

TYP.4 (BDV - SAFETY NO CRITICAL VALVES)

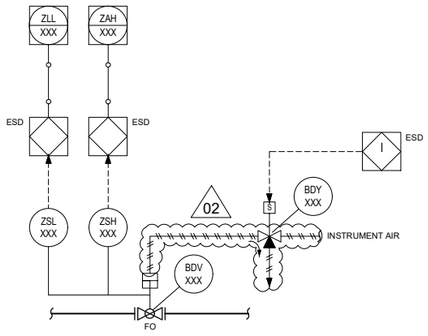

02

TYP.6 (CONTROL VALVES - CRITICAL)

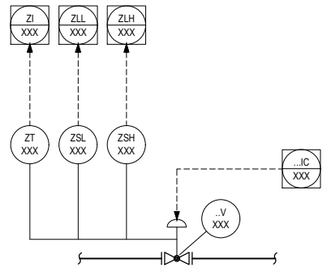


INSTRUMENT SYMBOLOGY DEFINITION

MEANINGS OF IDENTIFICATION LETTERS
THIS TABLE APPLIES TO THE FUNCTIONAL IDENTIFICATION OF INSTRUMENTS

	FIRST- LETTER		SUCCEEDING-LETTER		
	MEASURED OR INITIATING VARIABLE	MODIFIER	READOUT OR PASSIVE FUNCTION	OUTPUT FUNCTION	MODIFIER
A	ANALYSIS		ALARM		
C				CONTROL	
E			SENSOR (PRIMARY ELEMENT) ELEMENT		
F	FLOW RATE	RATIO (FRACTION)			
G			GLASS VIEWING DEVICE		
H	HAND				HIGH
I			INDICATE		
L	LEVEL				LOW
O			ORIFICE, OPEN		
P	PRESSURE, VACUUM				
R		RELIEF			
S		SAFETY		SWITCH	
T	TEMPERATURE			TRANSMIT	
V				VALVE, DAMPER, LOUVER	
X	UNCLASSIFIED				
Y				AUXILIARY DEVICES	
Z	POSITION DIMENSION				

NOTE: FOR FURTHER EXPLANATORY NOTES, REFER TO ANSI/ISA-5.1

TYP.7 (CONTROL VALVES - NOT CRITICAL)



NOTES

1. FOR GENERAL NOTES AND PIPING SYMBOLOGY SEE DRAWINGS: 123A90-DDL-PR-PID-80009 AND 123A90-DDL-PR-PID-80010.
2. DELETED.

HOLDS

1 DELETED 02


REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND | ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
INSTRUMENTATION SYMBOLOGY

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80042	SHEET 001	REV. 02

File Name :

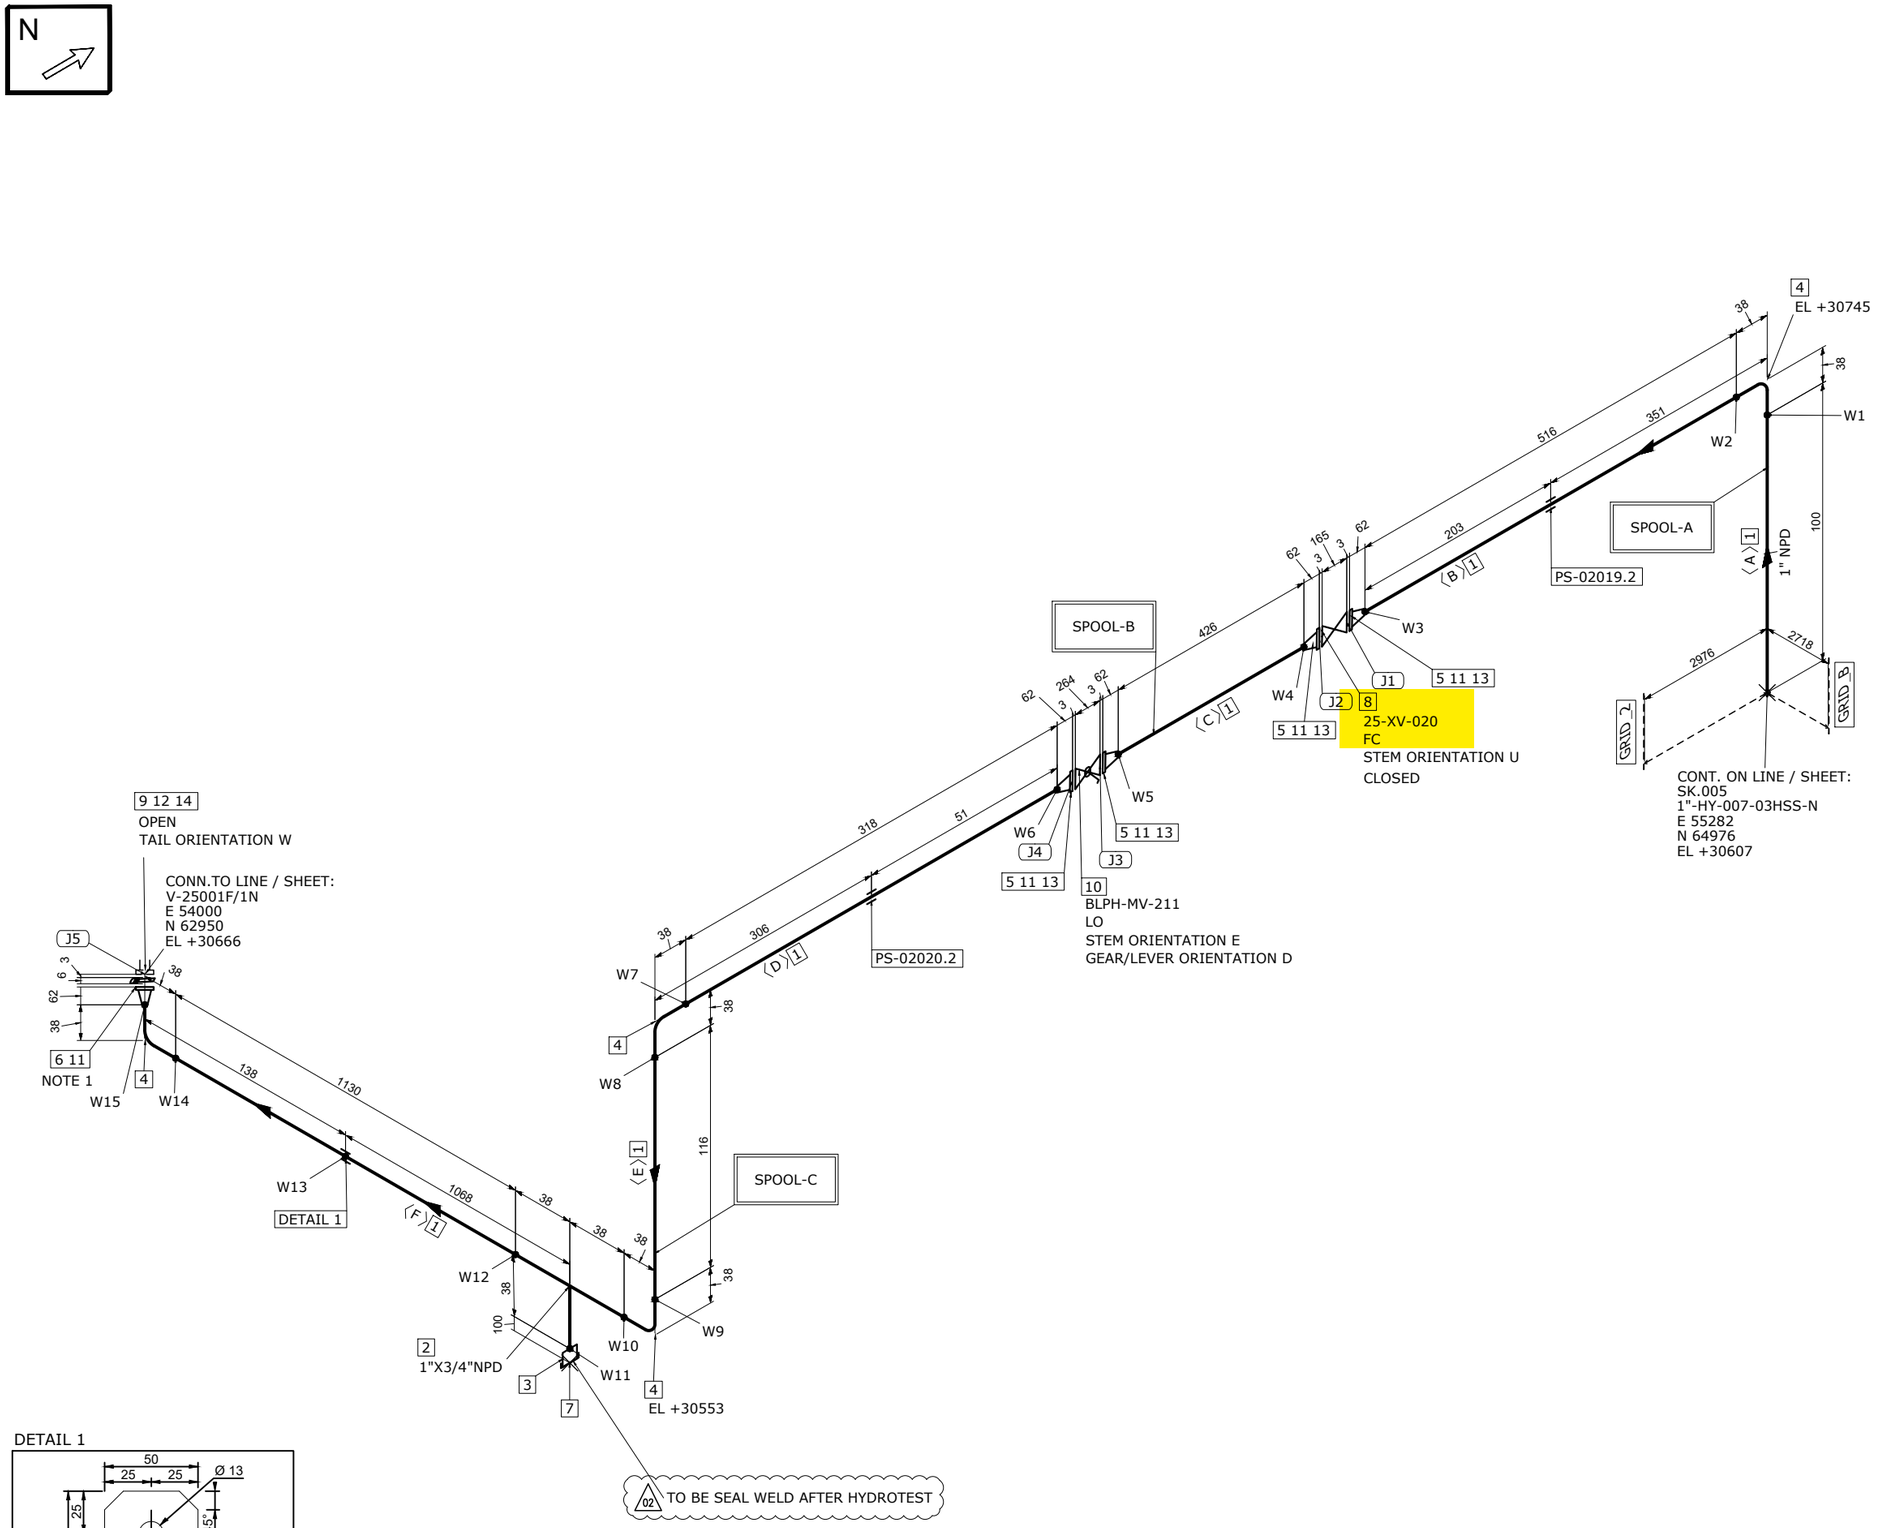

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.6M	6.6
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.8
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	3/4	BW
W12	1	BW
W13		FW
W14	1	BW
W15	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	100	BEVEL	BEVEL
B	1	516	BEVEL	BEVEL
C	1	426	BEVEL	BEVEL
D	1	318	BEVEL	BEVEL
E	1	116	BEVEL	BEVEL
F	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-02019.2
PS-02020.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	3.5
B	2	4.7
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-020-03HSS-N
SK.014

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A
DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024
FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00014 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1			PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002		FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]		DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--			TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		

REFERENCE DOCUMENTS


P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION N/S

MASTER

E33

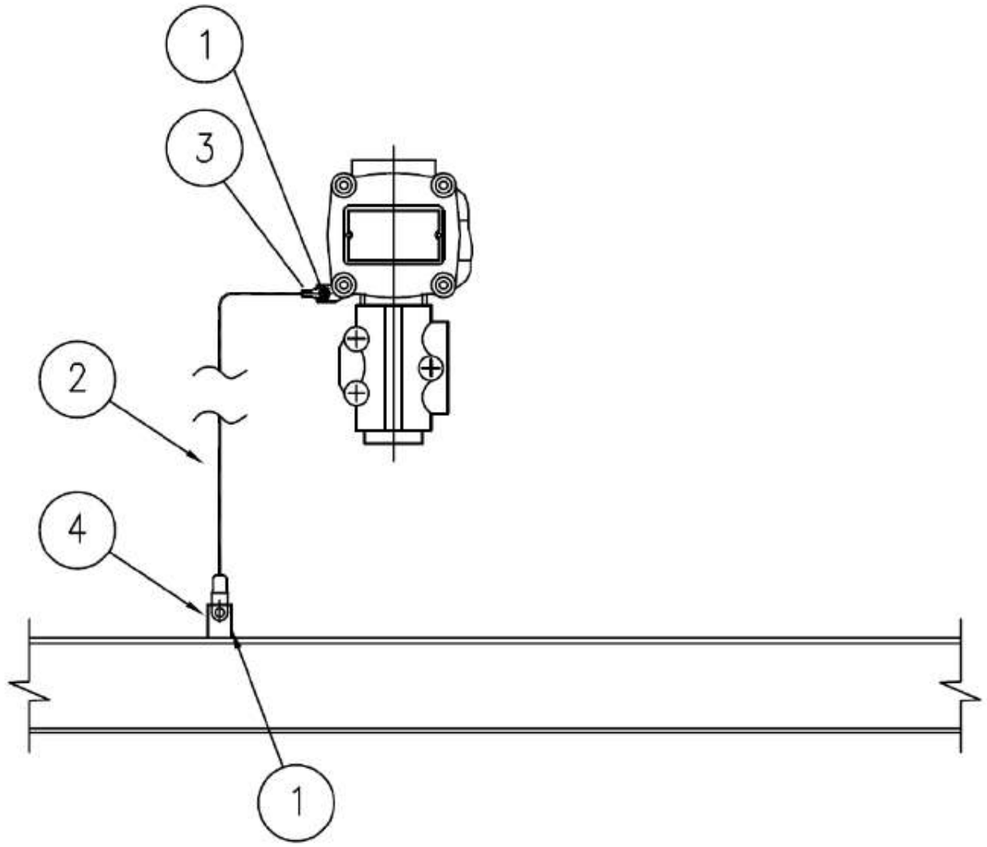

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS

A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

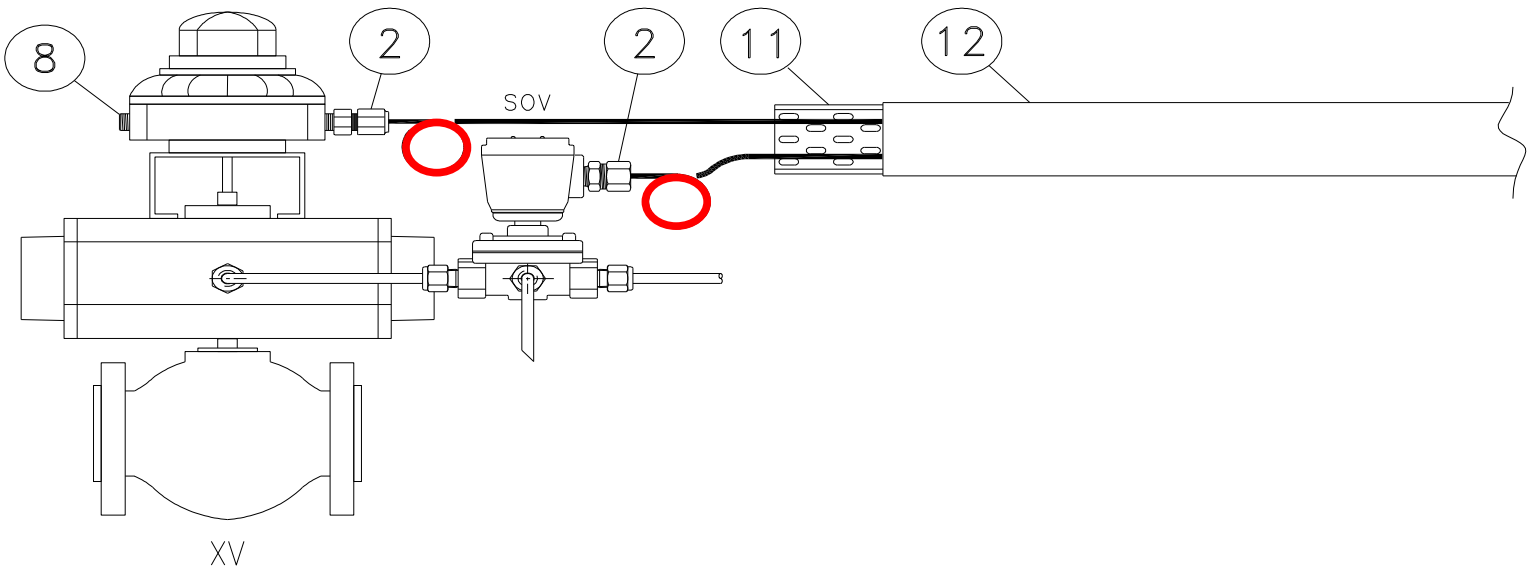

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**

REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy


CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Pneumatic Hook-Ups	Sh. 6 of 6 Date: 08/07/2024 Rev. 01

PNEUMATIC HOOK-UP FOR ON-OFF VALVES

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40078**

REV.:	DATE:	SIGNATURE:
1_B	06/11/24	G.Randi

ROSETTI MARINO SpA

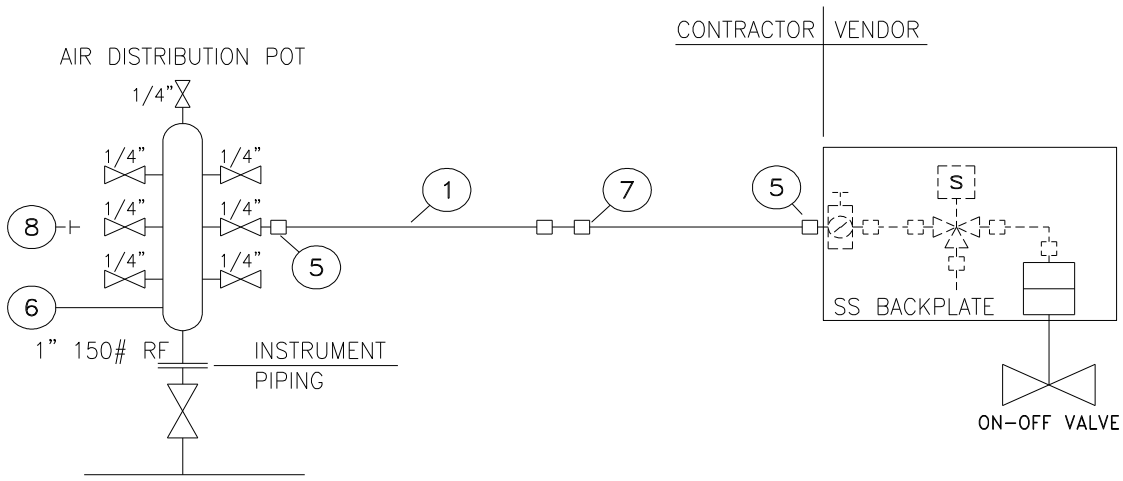



INSTRUMENT TAG	
1	25-BDV-022
2	25-BDV-005
3	25-BDV-007
4	25-BDV-010
5	25-BDV-013
6	25-BDV-016
7	25-BDV-019
8	25-SDV-001
9	25-SDV-023
10	25-XV-004
11	25-XV-006
12	25-XV-008
13	25-XV-009
14	25-XV-011
15	25-XV-012
16	25-XV-014
17	25-XV-015
18	25-XV-017
19	25-XV-018
20	25-XV-020
21	25-XV-021
22	25-XV-024
23	50-XV-001
24	50-XV-002
25	50-XV-003
26	50-XV-004
27	80-XV-001
28	64-SDV-001
29	50-XV-005
30	

NOTE:
(1) For Air Distribution Pot quantities see material take-off on sh. 4


POS.	NORM/STD CODE	DESCRIPTION	SIZE/CONNECTION TYPE	Q.TY
8		SS316 PLUG	1/4" NPT	Note 1
7		SS316 UNION	1/2" O.D. x 1/2" O.D.	N. 1
6		SS316 AIR DISTRIBUTION POT	1" 150#RF - N. 7 1/4" BALL VALVES	Note 1
5		SS316 MALE CONNECTOR	1/4" NPT x 1/2" O.D.	N. 2
1		SS 316L TUBING	1/2" x 0,049"Thk	10 m


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

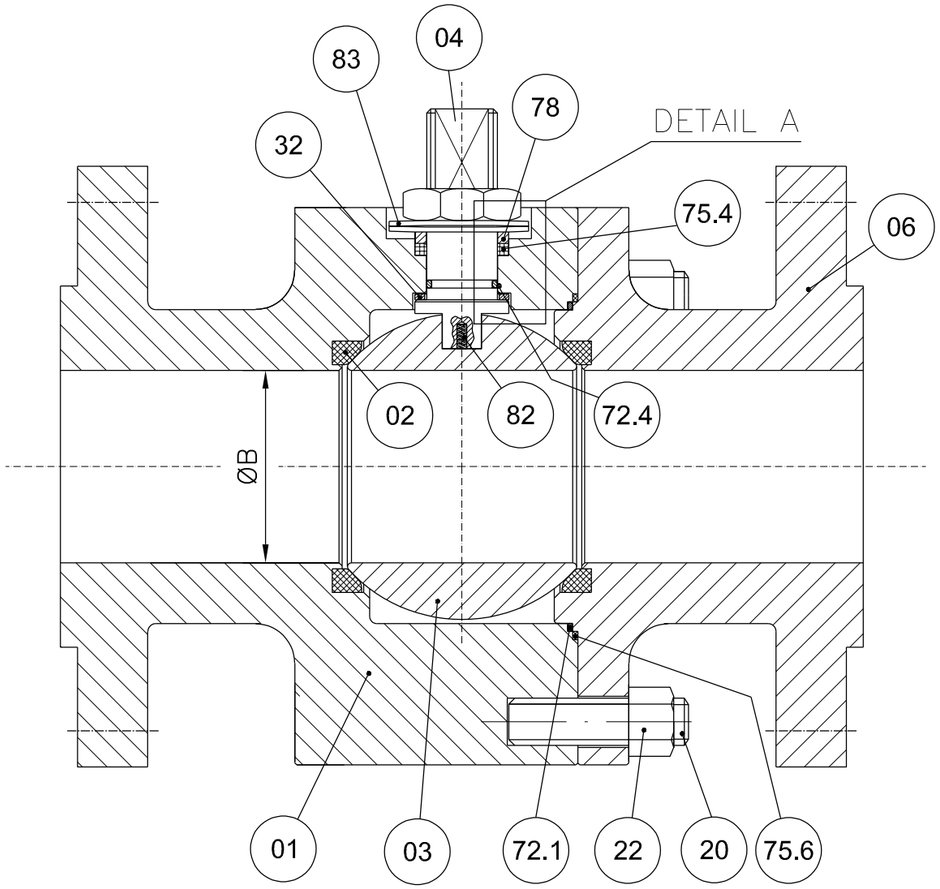




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-020		25
	2	Service				HYDROGEN STORAGE TANK V-25001F INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80020		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-020-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-020 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-020 (9, 17) - Soldo SS		25-ZSH-020 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

140	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
141	IFR	25-XV-020	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
142	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
143	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620210001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
144	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
145	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
146	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323304	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
147	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
148	IFR	25-XV-021	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
149	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
150	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620220001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
151	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
152	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
153	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323297	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
154	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
155	IFR	25-XV-024	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
156	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
157	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620230001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
158	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
159	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
160	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323291	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
161	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
162	IFR	50-XV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
163	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
164	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620240001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
165	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
166	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
167	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323289	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
168	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
169	IFR	50-XV-002	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
170	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
171	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620250001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
172	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
173	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
174	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323290	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
175	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
176	IFR	50-XV-003	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
177	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
178	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620260001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
179	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
180	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
181	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323299	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
182	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
183	IFR	50-XV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
184	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
185	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620270001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
186	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

CONFORMITY DECLARATION ACCORDING TO EUROPEAN DIRECTIVE 2014/68/UE

DICHIARAZIONE DI CONFORMITÀ AI SENSI DELLA DIRETTIVA EUROPEA 2014/68/UE

THE MANUFACTURER
IL FABBRICANTE

Name Nome	FLUITEK ORSENIGO VALVES S.R.L.
Legal representative and role Legale rappresentante	P. Belotti – Managing Director
Declaration of conformity nr. Dichiarazione di conformità no.	240062
Sede legale Legal office	Via Dei Livelli di Sopra, 7/5 – 24060 COSTA DI MEZZATE (BERGAMO) – ITALY
Sede produttiva Operational office	Via Dei Livelli di Sopra, 7/5 – 24060 COSTA DI MEZZATE (BERGAMO) – ITALY
E-mail E-mail	info@fluitekvalves.com
Website Sito internet	www.fluitekvalves.com
Telephone Telefono	+39 035 666 501
Fax Fax	+39 035 666 5047

DECLARE THAT THE FOLLOWING PRESSURE EQUIPMENT
DICHIARA CHE I SEGUENTI ACCESSORI A PRESSIONE

JOB	FOV Pos.	Serial Number	Client Item	PO N.	Description	Quantity
240062	001	2400620010001	10	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	002	24000620020001	20	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	003	2400620030001	30	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	004	2400620040001	40	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	005	2400620050001	50	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	006	2400620060001	60	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	007	2400620070001	70	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	008	2400620080001	80	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	009	2400620090001	90	1724000204 123A90A	Ball valve 1-1/2'' 300#	**1**
240062	010	2400620100001	100	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	011	2400620110001	110	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	012	2400620120001	120	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	013	2400620130001	130	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	014	2400620140001	140	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	015	2400620150001	150	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	016	2400620160001	160	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	017	2400620170001	170	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	018	2400620180001	180	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	019	2400620190001	190	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	020	2400620200001	200	1724000204 123A90A	Ball valve 1'' 300#	**1**

Fluitek Valves	**CONFORMITY DECLARATION ACCORDING TO EUROPEAN DIRECTIVE 2014/68/UE** DICHIARAZIONE DI CONFORMITÀ AI SENSI DELLA DIRETTIVA EUROPEA 2014/68/UE

240062	021	2400620210001	210	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	022	2400620220001	220	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	023	2400620230001	230	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	024	2400620240001	240	1724000204 123A90A	Ball valve 1-1/2'' 150#	**1**
240062	025	2400620250001	250	1724000204 123A90A	Ball valve 1'' 150#	**1**
240062	026	2400620260001	260	1724000204 123A90A	Ball valve 1-1/2'' 150#	**1**
240062	027	2400620270001	270	1724000204 123A90A	Ball valve 1'' 150#	**1**
240062	028	2400620280001	280	1724000204 123A90A	Ball valve 1'' 150#	**1**

MET THE REQUIREMENTS OF DIRECTIVE 2014/68/UE
SONO CONFORMI AI REQUISITI DELLA DIRETTIVA 2014/68/UE

Conformity assessment procedure used: Procedura di valutazione di conformità utilizzata:	Module H annex III of Directive 2014/68/UE Modulo H Allegato III della Direttiva 2014/68/UE
Notified Body charged of conformity assessment: Organismo Notificato incaricato della valutazione di conformità:	Bureau Veritas (Notified Body No.1370) Bureau Veritas (Ente Notificato N°1370)
Not armonized standards applied to design and manufacture: Norme non armonizzate applicate alla progettazione e alla fabbricazione:	ASME B16.34, ASME VIII, ASME IX, UNI EN 1503 Part.2 ASME B16.34, ASME VIII, ASME IX, UNI EN 1503 Part.2
Classificazione dei fluidi condotta in conformità ai requisiti del	Regolamento CLP CE 1272/2008 Fluid group: **1**

Place COSTA DI MEZZATE (BG), Italy
Luogo COSTA DI MEZZATE (BG), Italia

Date 14/01/2025
Data



Signature
Firma

Fluitek Valves	**DECLARATION OF CONFORMITY ATEX 2014/34/EU** *Dichiarazione di Conformità ATEX 2014/34/EU*	**Cert. DDC No.** **240062 ATEX**

GENERAL INFORMATION – *INFORMAZIONI GENERALI*

Customer ***Cliente***	ROSETTI MARINO S.P.A.		
P. Order ***Ordine***	1724000204 123A90A	**Item/s** ***Item/s***	ALL
FOV Job ***Commessa FOV***	240062	**Position/s** ***Posizione/i***	ALL
Subject ***Oggetto***	BALL VALVE		
Date of execution ***Data di esecuzione***	24/07/2024		

STATEMENT – *DICHIARAZIONE*

We declare that this product has been manufactured in accordance with the Euporean Directive 2014/34/EU to the classification II 2 G/D Tx c.
Technical standards and specifications used are referenced in the Fluitek Orsenigo valves above stated internal job.
The equipment satisfies the provision of directive 2014/34/EU and of standards EN 1127-1, UNI CEI EN ISO 80079-36:2016.
Technical file deposited to Notified Body TUV RHEINLAND 0035.

REMARKS – *NOTE*

SIGNATURE – *FIRME*

Inspection Authority ***Ente Ispettivo***	**Customer Inspector** ***Ispettore Cliente***	**Quality Control** ***Controllo qualità***
		FLUITEK ORSENIGO VALVES S.R.L. Q.C.

rotork Fluid Systems	EU Declaration of Conformity	Rif. JOB nr: AF7703

Manufacturer: Rotork Fluid Systems S.r.l.

Address: Via Padre Jacques Hamel, 138/B
55016 Porcari, Lucca – Italy
Tel. +39 0583 2221
Fax. +39 0585 091362

Section PED: ☐ Applicable ☒ Not Applicable

Under its sole responsibility declares that the items specified below have been designed, manufactured, inspected and tested as required by the relevant provisions of the Pressure Equipment Directive 2014/68/UE.
The equipment has been submitted to the following conformity assessment procedures:

☐**Module H**: **CE-1370-PED-H-RTK 001-23-ITA** **Serial No.:**

☐ **Module H1**: **CE-1370-PED-H1-RTK 001-23-ITA** **Serial No.:**
CE-1370-PED-H1D-RTK 001-20-ITA
CE-1370-PED-H1D-RTK 002-20-ITA

Notified Body: Bureau Veritas Italia SPA Viale Monza 347 20126 MI – Italy
NB Number: 1370

Description: The pressure equipment is a part pressure of pneumatic actuator that is product of Rotork Fluid Systems for quart turn and linear valve. It is composed by a cylinder can and two flanges packaged by tie rods.

Other technical standards and specifications used:
VSR rev.1995; RACCOLTA "M"; RACCOLTA "S"; AD 2000-Merkblatt; ASME VIII Div.1/Div.2; ASME II; EN 13445-3

Section ATEX:

Under its sole responsibility declares that the actuators model:

☒ **GP/GH, CP/CH, RP/RH, LP/LH, HPG, HPL MARKED:** **II 2 G Ex h IIC T5 Gb X**
II 2 D Ex h IIIC T100°C Db X
IP 66M/67M

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / EN 60529

☐ **CQP/CQH MARKED:** **II 2 G Ex h IIC T5 Gb X**
II 2 D Ex h IIIC T100°C Db X
IP 66/68

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / EN 60529

☐ **GO, GOL, EH MARKED:** **II 2 G Ex 60079-46 II_ T_ _ X**
(II 2 D Ex 60079-46 III_ T_ _X)
IP 6_

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / IEC 60079-46, EN 60529

The conformity has been evaluated according to ***Annex VIII (Article 13, Point 1. (b)(ii))*** *of* ***ATEX 2014/34/EU*** *directive.*
TECHNICAL FILE N° TR 219 *(Receipt Number:* ***BVI/ATEX/ITA/24/080*** *Bureau Veritas ITA)*

Section API 6DX: ☐ Applicable ☒ Not Applicable

Under its sole responsibility, the Manufacturer declares that the items specified above have been designed, manufactured, inspected, and tested as required by the applicable provisions of the current edition of the product standard API 6DX and all addenda.


SIGNED ON BEHALF OF ROTORK FLUID SYSTEMS S.R.L. (authorized representative of):

Legal Representative: Metin Gerceker **Signature:**


Place / date: Porcari / 05/02/2025

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

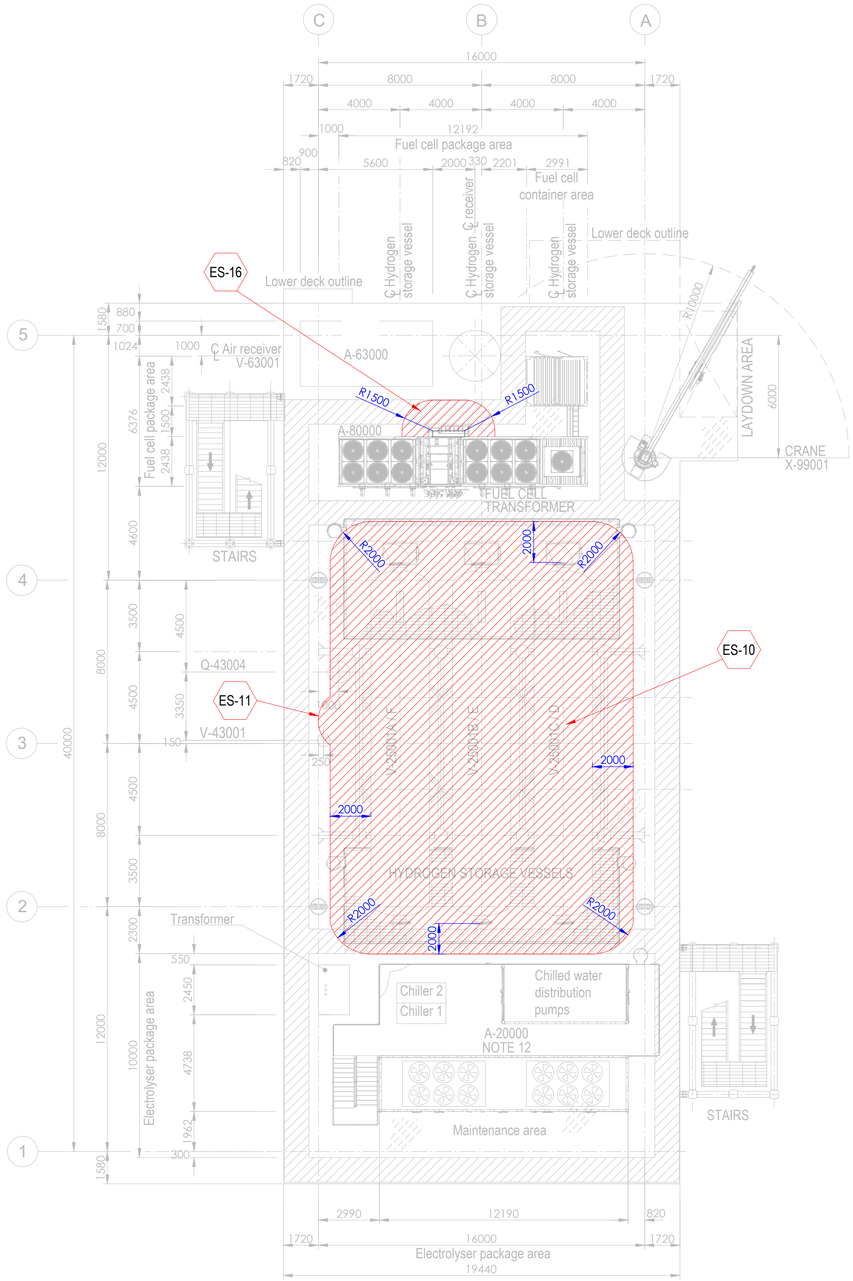


PLAN ON UPPER DECK
EL+30.310 T.O.S.

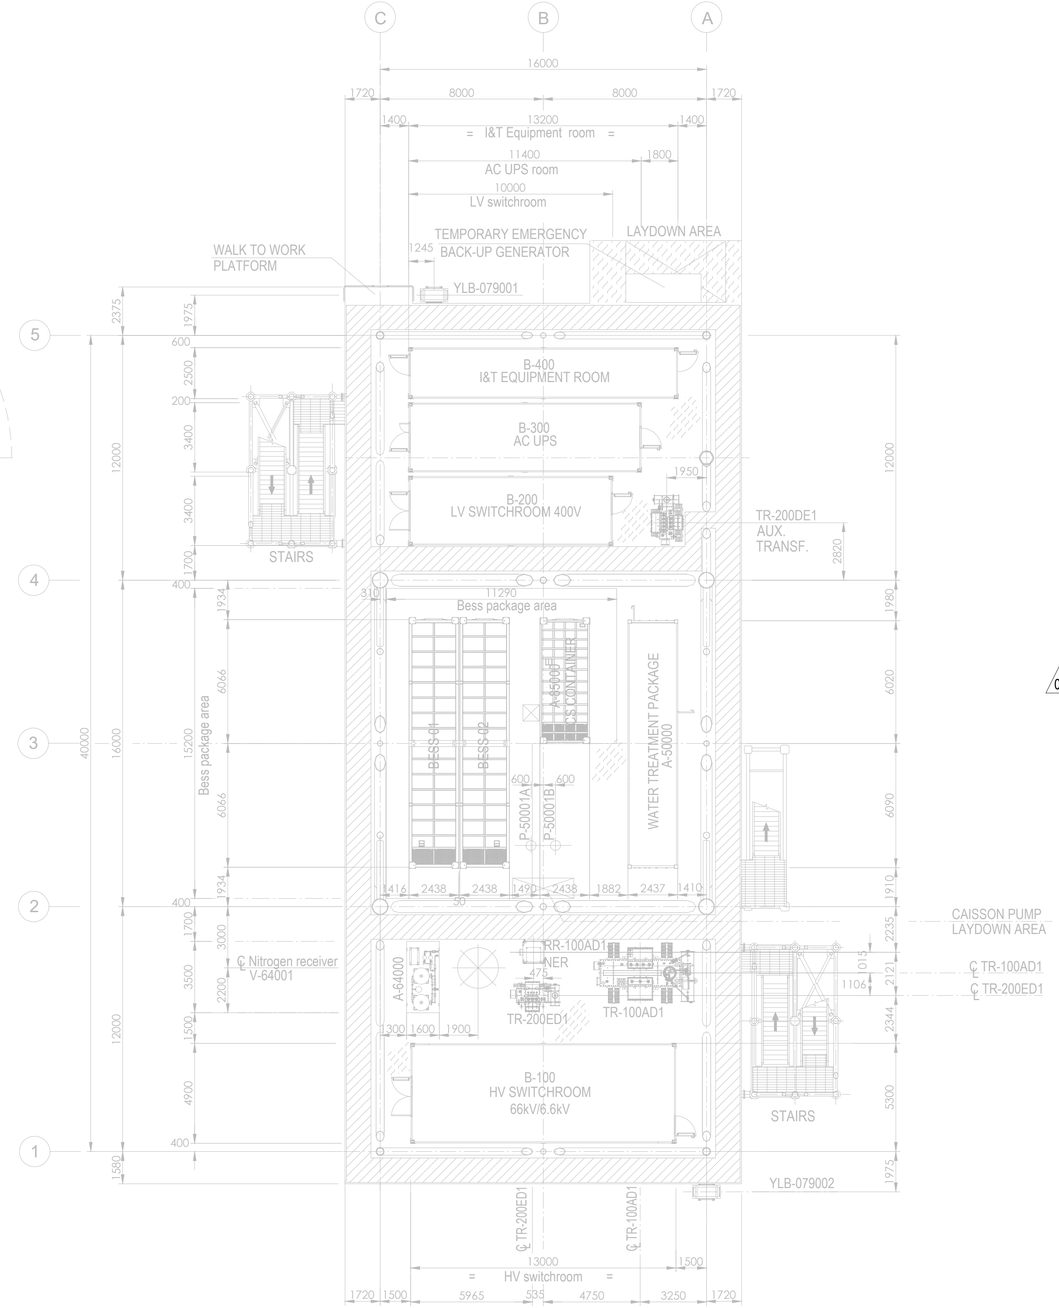

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

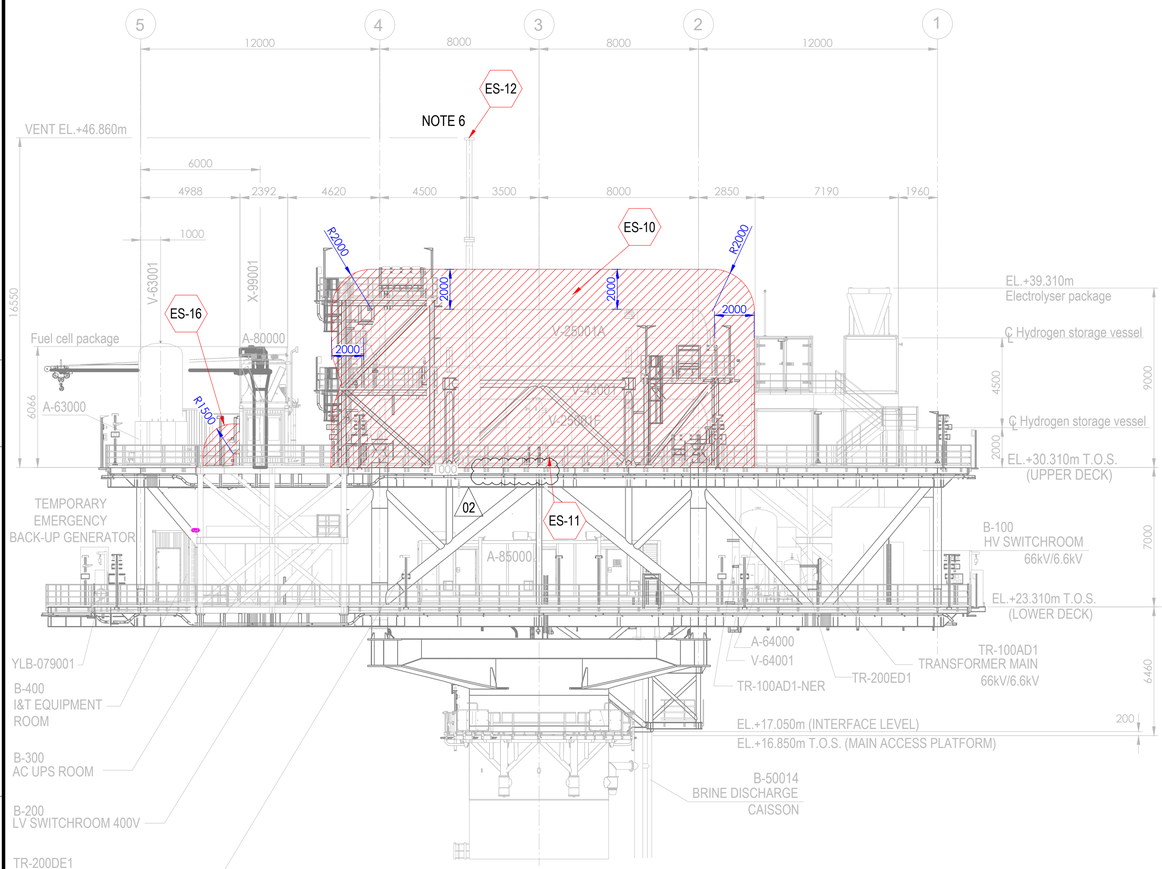



ELEVATION LOOKING EAST

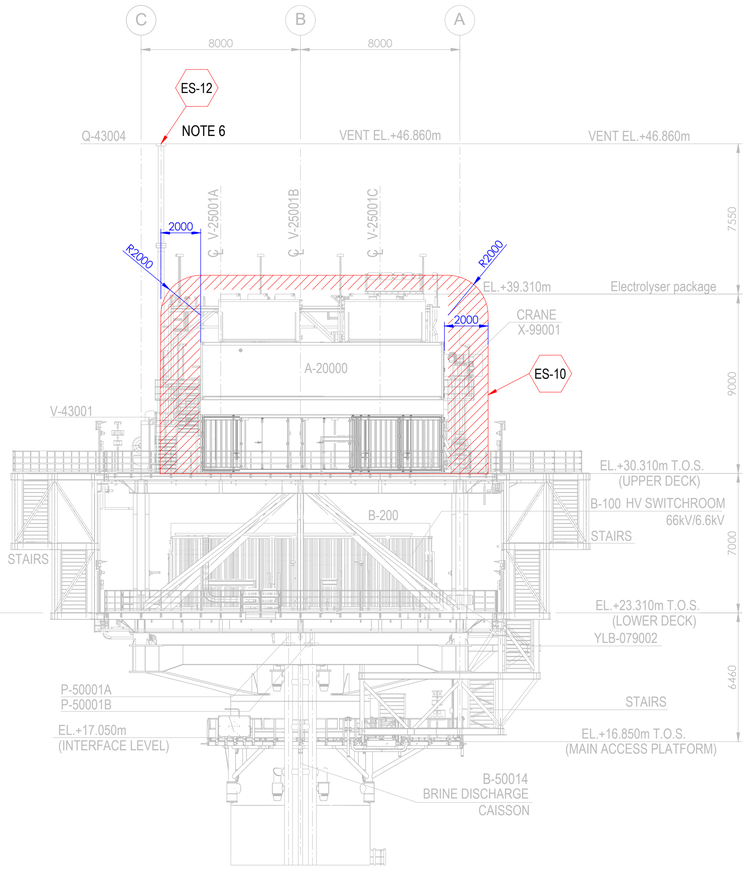

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

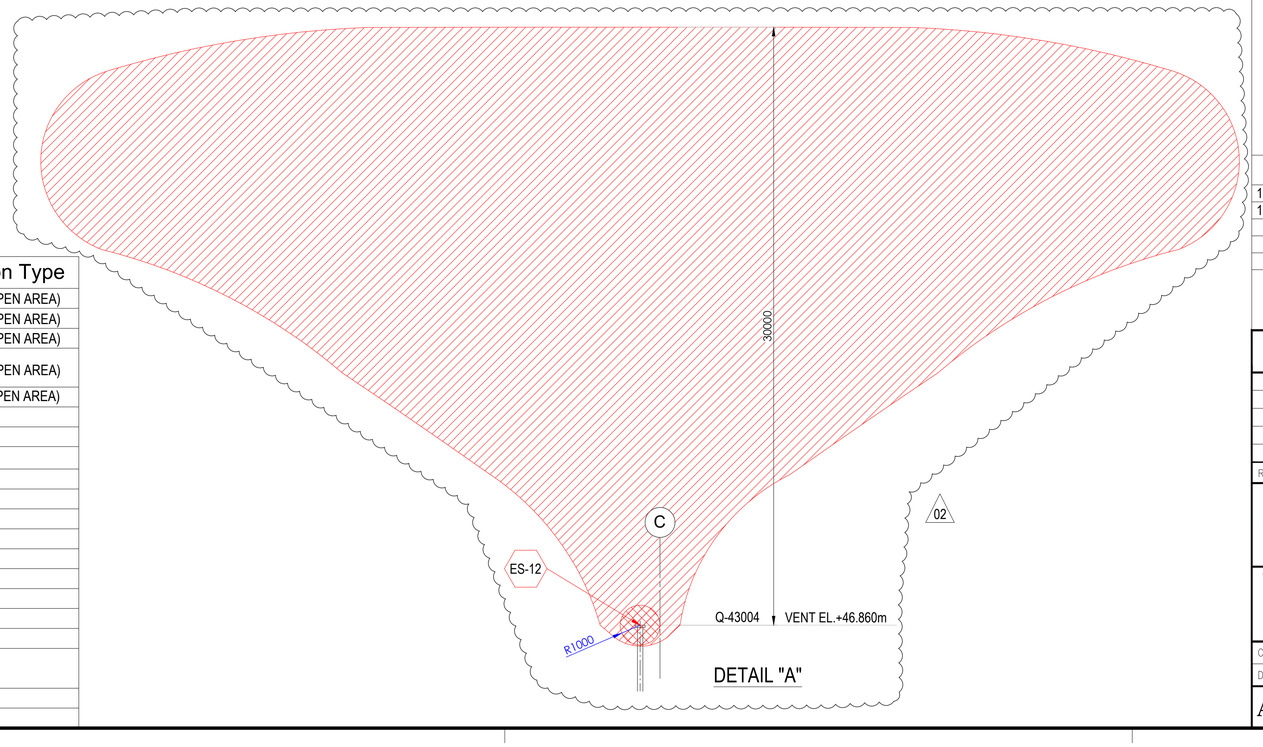



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-XV-024	: On/Off Valve - Hyrogen to Vessels Inlet Header Vent System	Dwg	123A90-DDL-PR-PID-80013		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001602	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		AF770302301 (Ball valve SN: 2400620230001)			
Manufacturer	Rotork			**Model**		CP/S-035-080A/AA			
Cert No.	Declaration of Conformity by Manufactured			**Equipment Ambient Temp.**		-20 °C to + 40 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T5	**IP Rating**	IP66/IP67

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-XV-024	: On/Off Valve - Hyrogen to Vessels Inlet Header Vent System			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001602		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	25-XV-024	: On/Off Valve - Hyrogen to Vessels Inlet Header Vent System	Dwg	123A90-DDL-PR-PID-80013		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001602	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks					
67	All Terminals are Ex n certified (if required on certificate)	x	NA		
68	Hermetically sealed and enclosed break devices are undamaged	x	NA		
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA		
70	Test port, if fitted, is functional (type “nR” only)	x	NA		
71	Breathing operation is satisfactory (type “nR” only)	x	NA		
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA		
73	The ventilation airflow is not impeded	x	NA		
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA		
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA		
76	Variable voltage/frequency installation complies with documentation	x	NA		
Extra Ex p checks					
77	Pressurization gas is correct type	x	NA		
78	Actual pressure is within maximum and minimum settings for equipment	x	NA		
79	Timers set as per certification documentation	x	NA		
80	Alarms and trip functions operate correctly as per certification documentation	x	NA		
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA		
82	Automatic electrical protective devices operate within permitted limits	x	NA		
83	Automatic electrical protective devices are set correctly	x	NA		
84	Protective gas inlet temperature is below maximum specified	x	NA		
85	Ducts, pipes and enclosures are in good condition	x	NA		
86	Protective gas is substantially free from contaminants	x	NA		
87	Protective gas pressure and/or flow is adequate	x	NA		
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA		
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA		
90	Specific conditions of use (if applicable) are complied with		NA		
Extra Ex i (Intrinsically Safe – IS) checks					
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA		
92	Cables are installed in accordance with the documentation	x	NA		
93	Segregation is maintained between IS and non-IS Circuits	x	NA		
94	Cable screens are isolated at one end (field side)	x	NA		
95	Cable screens are earthed in accordance with the documentation	x	NA		
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA		
97	Equipment installed is the one specified in the documentation	x	NA		
98	Ambient temperature range of the apparatus is correct for the installation	x	NA		
99	Service temperature range of the apparatus is correct for the installation	x	NA		
100	Installation is clearly labelled	x	NA		
101	Printed circuit boards are clean and undamaged	x	NA		
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA		
103	Point-to-point connections are all correct	x	NA		
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA		
105	Earth connections maintain the integrity of the type of protection	x	NA		
106	Intrinsically safe circuit earthing is satisfactory	x	NA		
107	Insulation resistance is satisfactory	x	NA		
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA		

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-30	2025-01-31	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-30T10:15:49.618Z	PROVERLIS Digitaly signed by Luca Mussi 2025-01-31T09:29:11.135Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

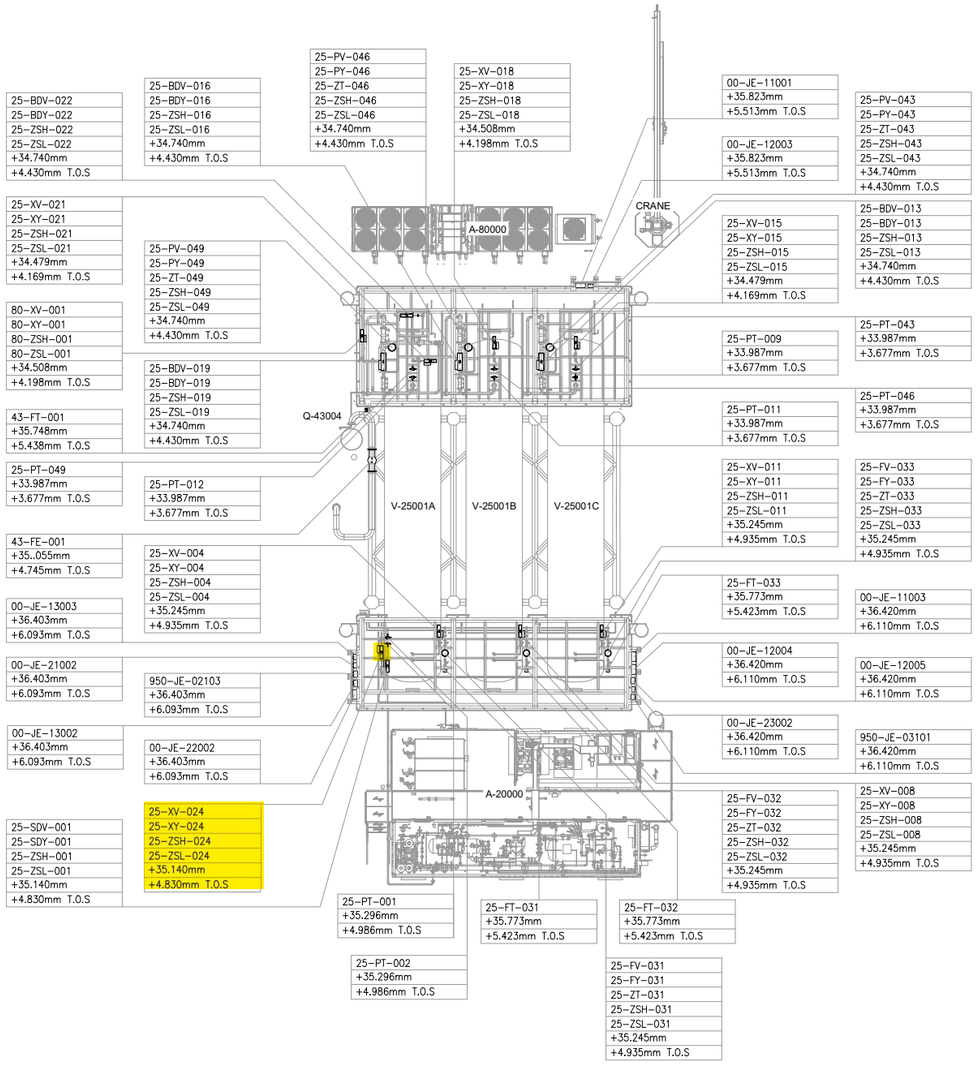

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :


BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. DRAWING_NO.

REV. REV

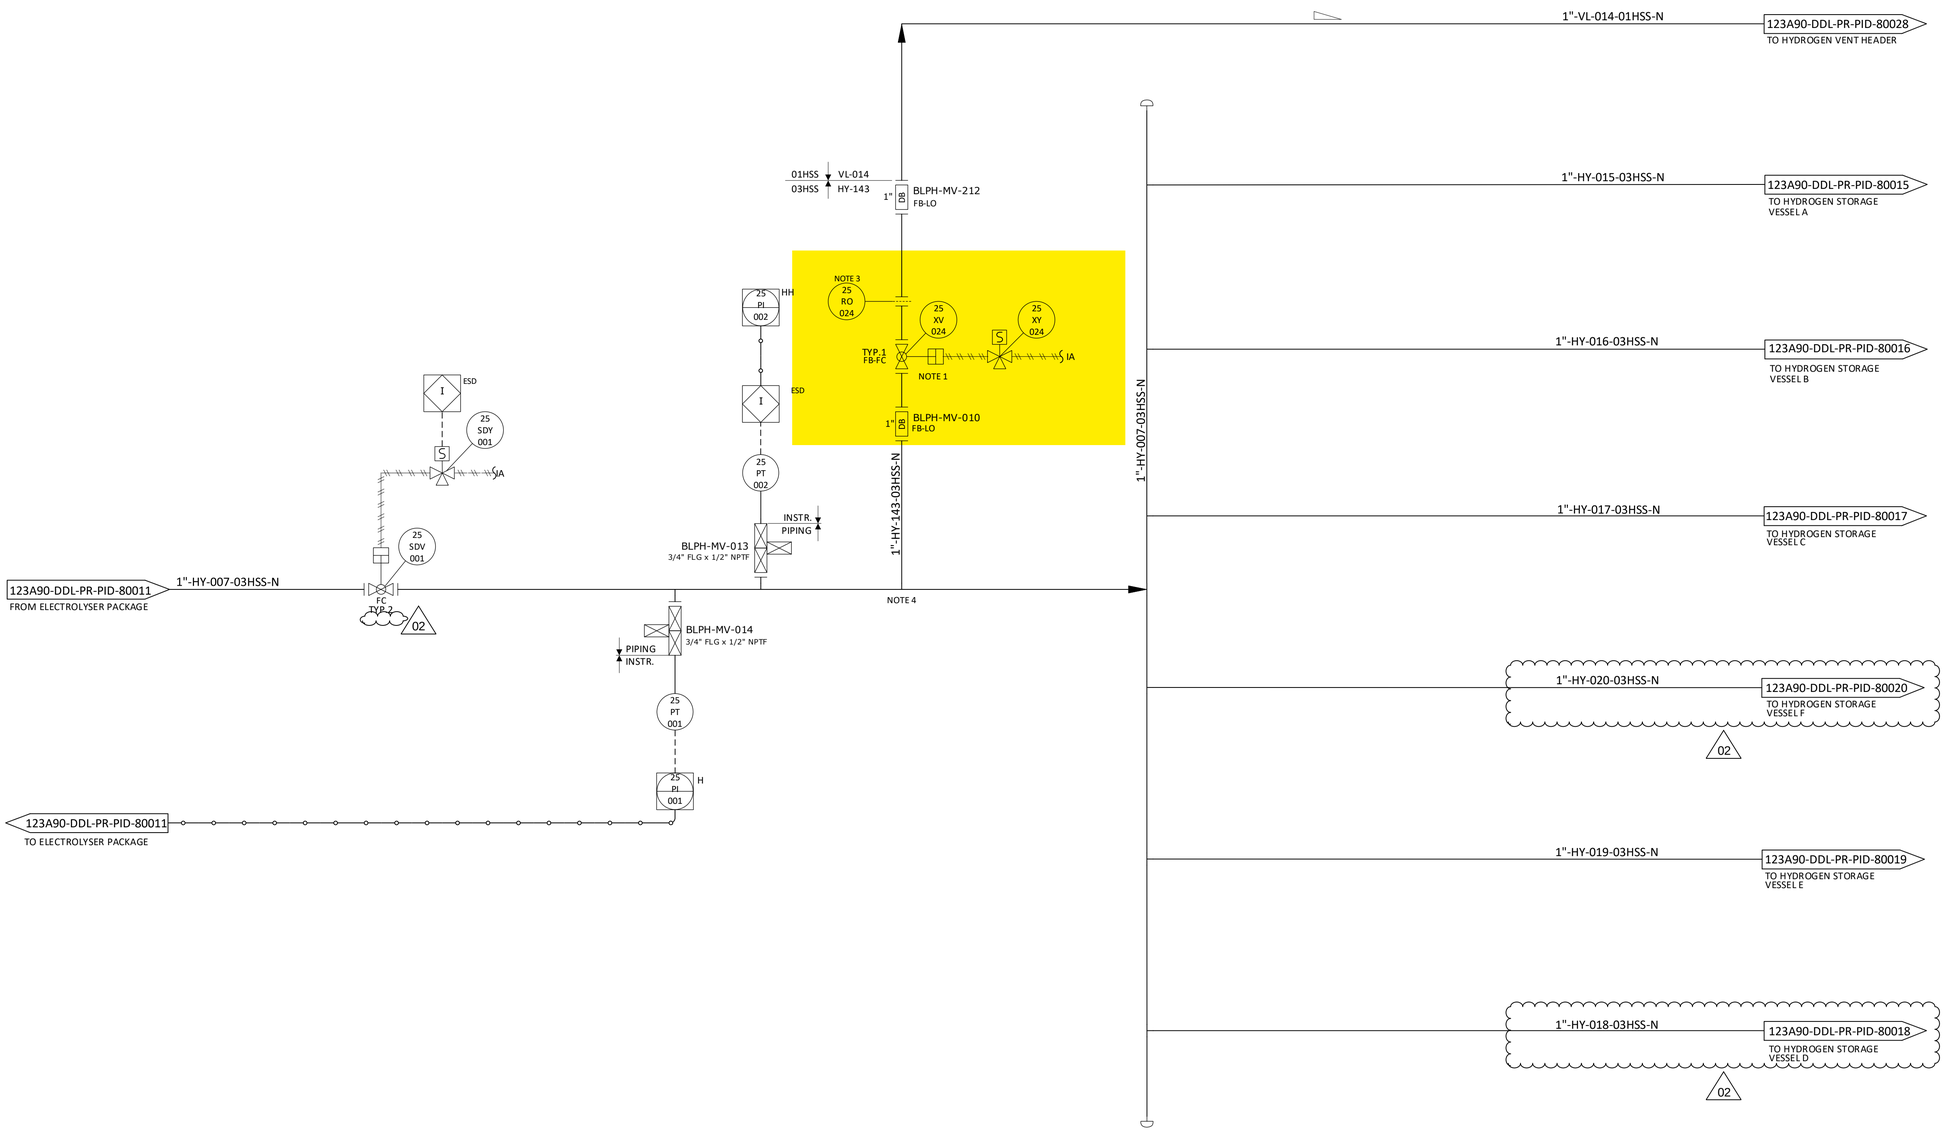

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :

BLPH PIPING AND INSTRUMENTATION DIAGRAM HYDROGEN STORAGE VESSELS HEADER (INLET)

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80013	SHEET 001	REV. 02


File Name : FILE_NAME

DRAWING NO.


REV. 00

TYPICAL INSTRUMENTATION VALVE

TYP.1 (XV - ON OFF VALVES)

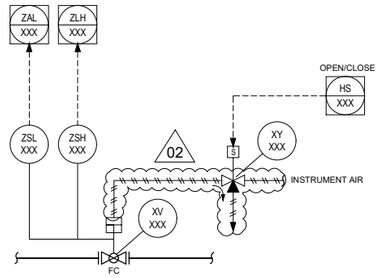


TYP.2 (SDV - SAFETY NO CRITICAL VALVES)

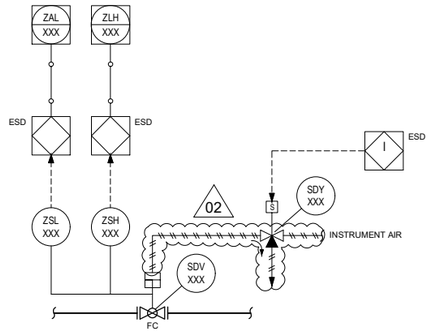


02

TYP.4 (BDV - SAFETY NO CRITICAL VALVES)

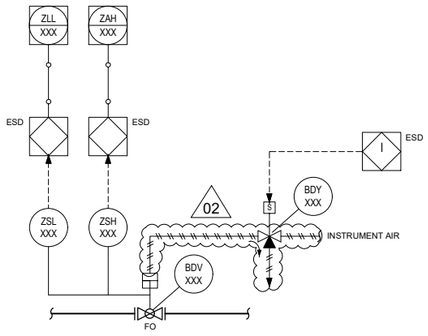

02

TYP.6 (CONTROL VALVES - CRITICAL)

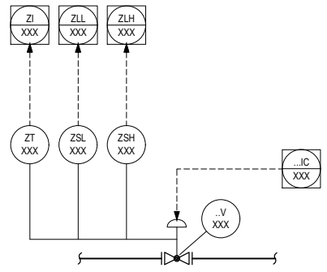


INSTRUMENT SYMBOLOGY DEFINITION

MEANINGS OF IDENTIFICATION LETTERS
THIS TABLE APPLIES TO THE FUNCTIONAL IDENTIFICATION OF INSTRUMENTS

	FIRST- LETTER		SUCCEEDING-LETTER		
	MEASURED OR INITIATING VARIABLE	MODIFIER	READOUT OR PASSIVE FUNCTION	OUTPUT FUNCTION	MODIFIER
A	ANALYSIS		ALARM		
C				CONTROL	
E			SENSOR (PRIMARY ELEMENT) ELEMENT		
F	FLOW RATE	RATIO (FRACTION)			
G			GLASS VIEWING DEVICE		
H	HAND				HIGH
I			INDICATE		
L	LEVEL				LOW
O			ORIFICE, OPEN		
P	PRESSURE, VACUUM				
R		RELIEF			
S		SAFETY		SWITCH	
T	TEMPERATURE			TRANSMIT	
V				VALVE, DAMPER, LOUVER	
X	UNCLASSIFIED				
Y				AUXILIARY DEVICES	
Z	POSITION DIMENSION				

NOTE: FOR FURTHER EXPLANATORY NOTES, REFER TO ANSI/ISA-5.1

TYP.7 (CONTROL VALVES - NOT CRITICAL)



NOTES

1. FOR GENERAL NOTES AND PIPING SYMBOLOGY SEE DRAWINGS: 123A90-DDL-PR-PID-80009 AND 123A90-DDL-PR-PID-80010.
2. DELETED.

HOLDS

1 DELETED 02


REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND | ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
INSTRUMENTATION SYMBOLOGY

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80042	SHEET 001	REV. 02

File Name :

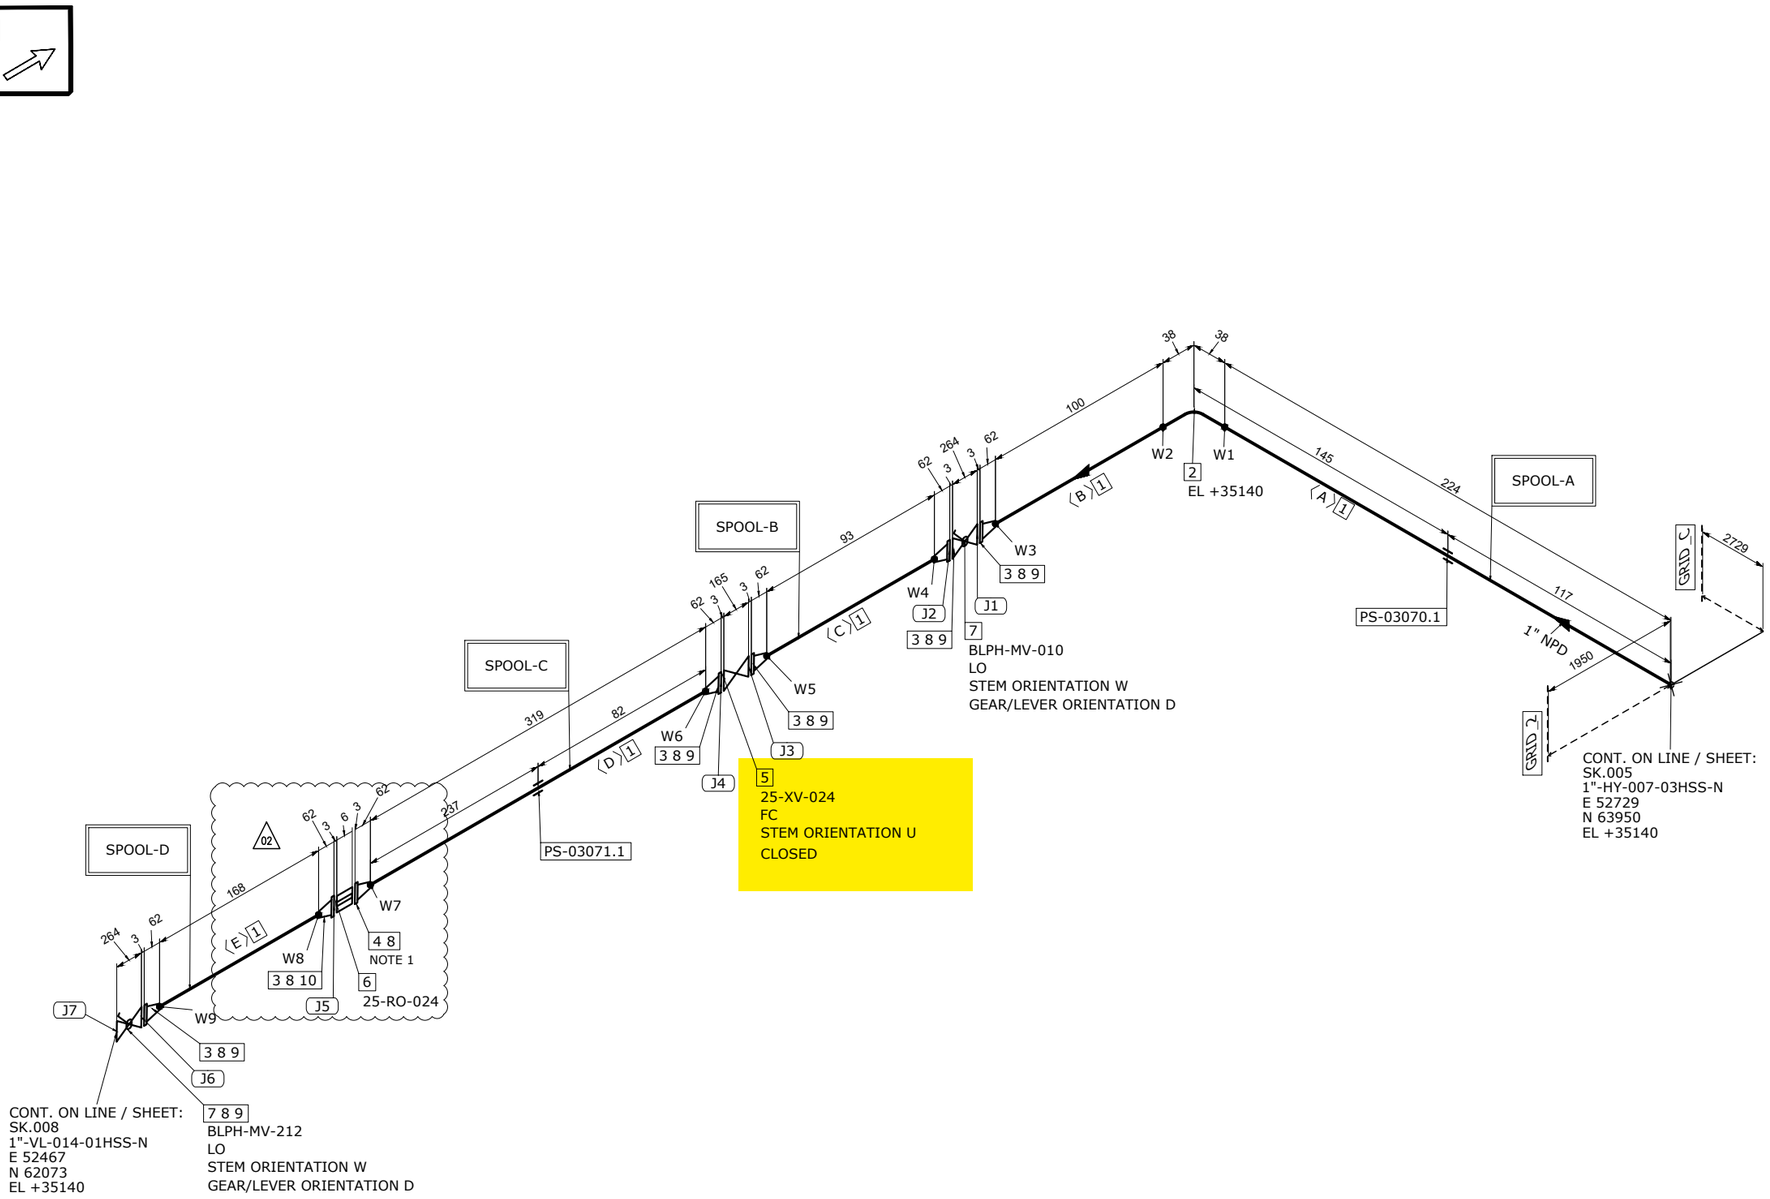

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	0.9M	2.3
2	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
3	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	6	11.0
4	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
5	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
6	1		Restriction Orifice 300#RF	1	1.0
7	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	2	27.0
8	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	8	0.6
9	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	24	5.5
10	5/8	SB20BO04190300	90 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	15.2
ERECTION WEIGHT [kg]	76.1
OVERALL WEIGHT [kg]	91.3

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	224	BEVEL	BEVEL
B	1	100	BEVEL	BEVEL
C	1	93	BEVEL	BEVEL
D	1	319	BEVEL	BEVEL
E	1	168 (02)	BEVEL	BEVEL

SUPPORT LIST

PS-03070.1
PS-03071.1

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	2.8
B	2	3.9
C	2	4.5
D	2	4.1
MONT	0	76.1

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-143-03HSS-N

SK.056

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK

SCALE: N/A

DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024

FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00056 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1			PED CATEGORY	II			
PAINTING	SYSTEM 6A	BASE RAL RAL 9002		FLUID PHASE	GAS			
INSULATION	TYPE N	THICKNESS [mm]		DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]		
HEAT TRACING	--			TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water	

REFERENCE DOCUMENTS


P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION E/W

MASTER

E33

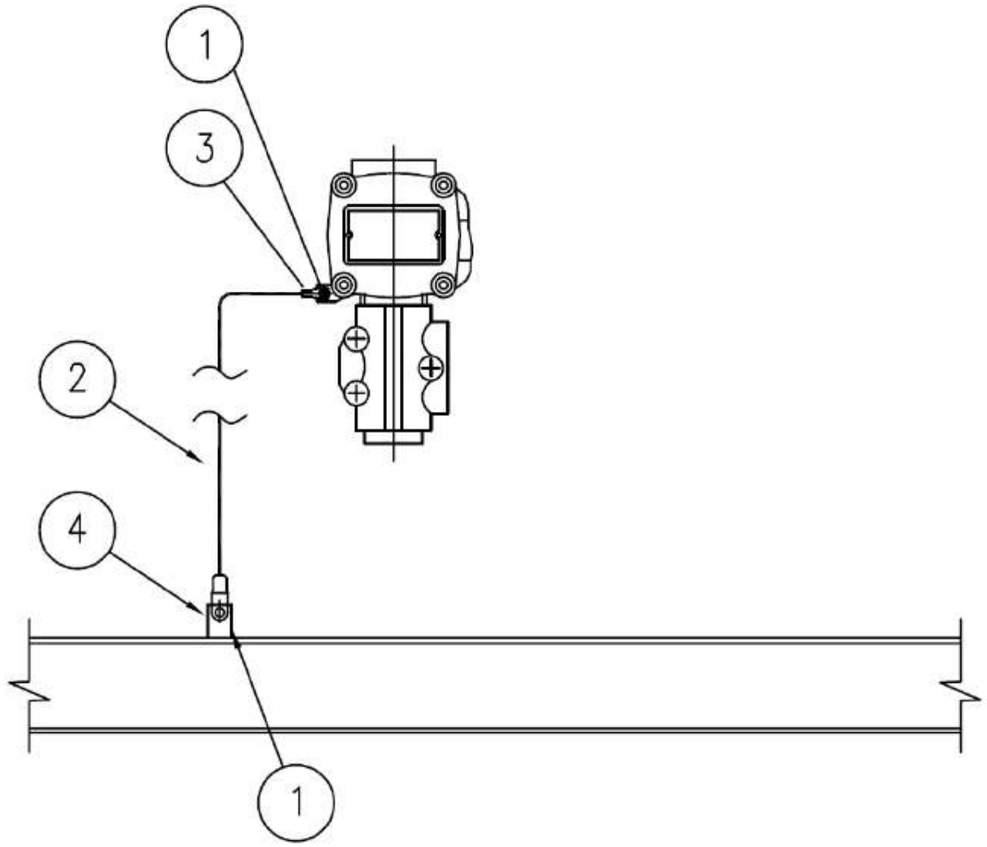

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

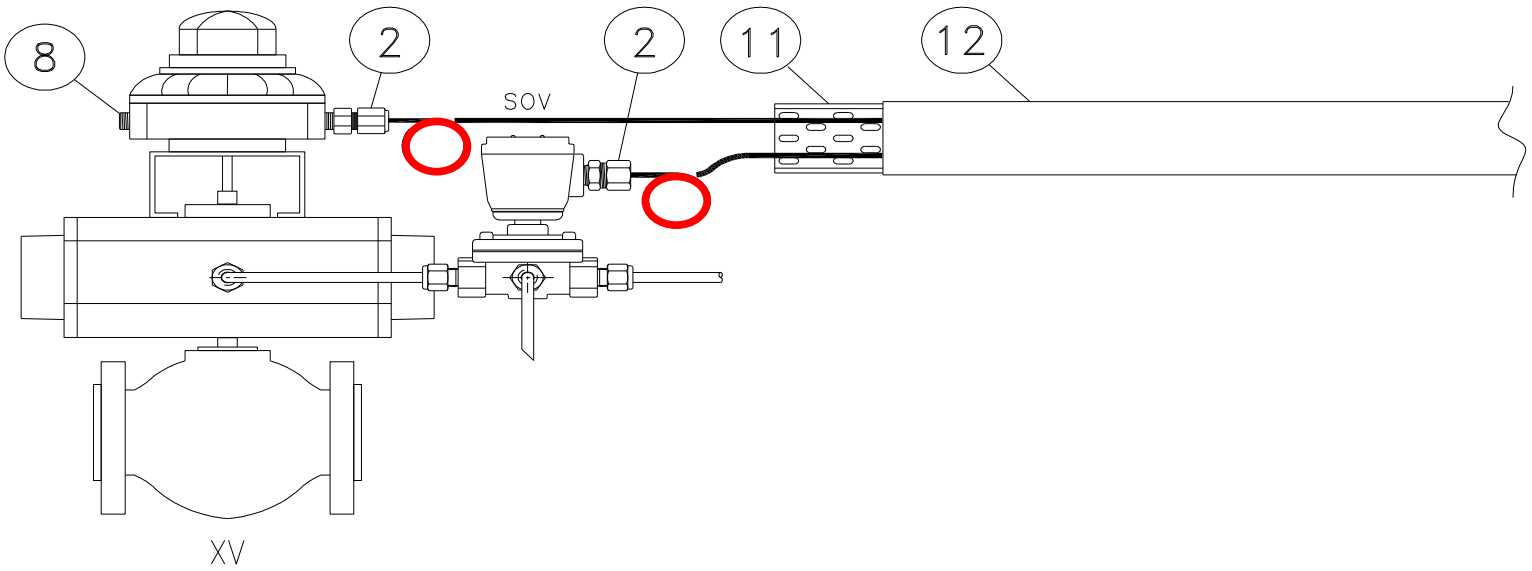

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**

REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy


CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Pneumatic Hook-Ups	Sh. 6 of 6 Date: 08/07/2024 Rev. 01

PNEUMATIC HOOK-UP FOR ON-OFF VALVES

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40078**

REV.:	DATE:	SIGNATURE:
1_B	06/11/24	G.Randi

ROSETTI MARINO SpA

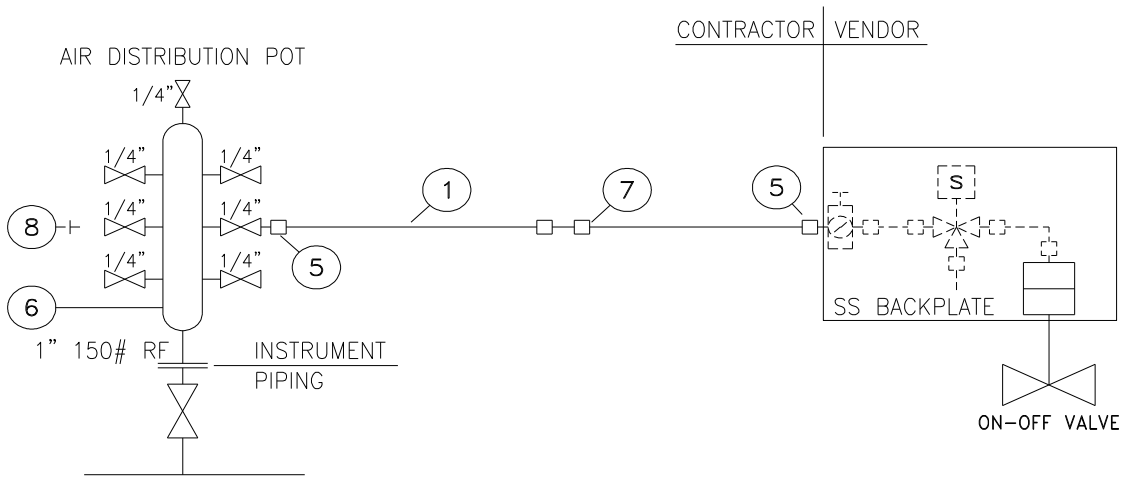


INSTRUMENT TAG	
1	25-BDV-022
2	25-BDV-005
3	25-BDV-007
4	25-BDV-010
5	25-BDV-013
6	25-BDV-016
7	25-BDV-019
8	25-SDV-001
9	25-SDV-023
10	25-XV-004
11	25-XV-006
12	25-XV-008
13	25-XV-009
14	25-XV-011
15	25-XV-012
16	25-XV-014
17	25-XV-015
18	25-XV-017
19	25-XV-018
20	25-XV-020
21	25-XV-021
22	25-XV-024
23	50-XV-001
24	50-XV-002
25	50-XV-003
26	50-XV-004
27	80-XV-001
28	64-SDV-001
29	50-XV-005
30	


NOTE:
(1) For Air Distribution Pot quantities see material take-off on sh. 4

POS.	NORM/STD CODE	DESCRIPTION	SIZE/CONNECTION TYPE	Q.TY
8		SS316 PLUG	1/4" NPT	Note 1
7		SS316 UNION	1/2" O.D. x 1/2" O.D.	N. 1
6		SS316 AIR DISTRIBUTION POT	1" 150#RF - N. 7 1/4" BALL VALVES	Note 1
5		SS316 MALE CONNECTOR	1/4" NPT x 1/2" O.D.	N. 2
1		SS 316L TUBING	1/2" x 0,049"Thk	10 m


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

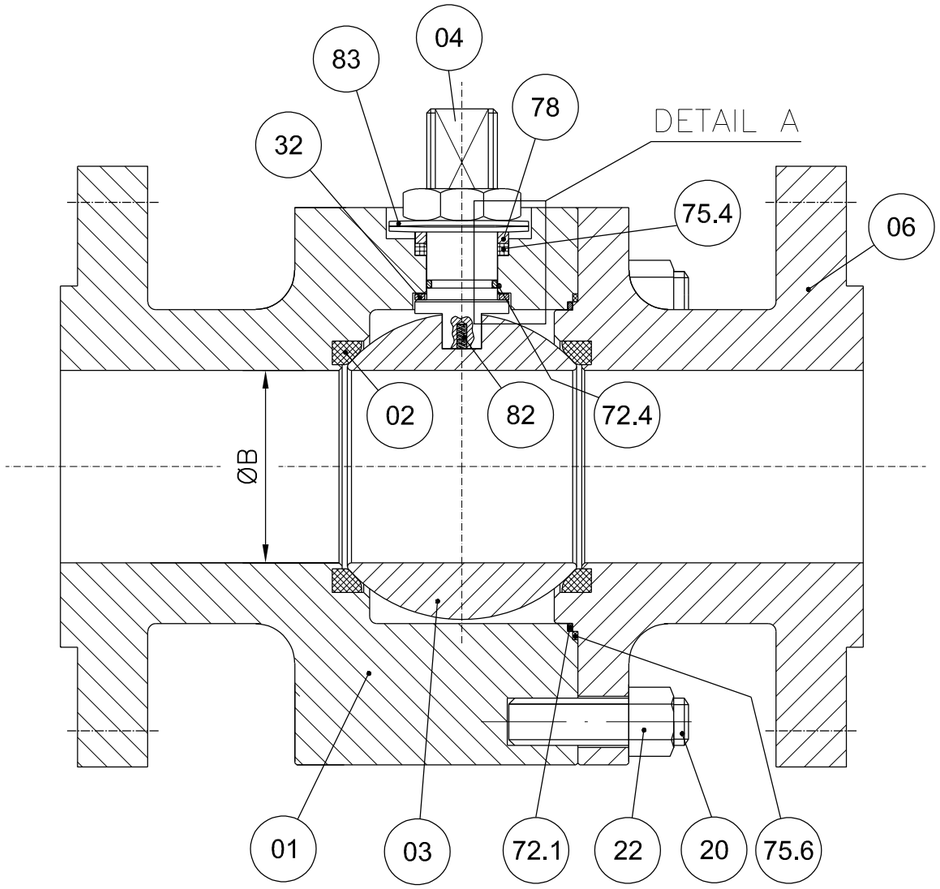


DETAIL A




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWN: S.Madahar	DATE: 26/02/2024
CHK'D: D.Barcella	DATE: 26/02/2024
APPV'D: L.Mora	DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: **D240062-08** | Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-024	25
	2	Service				HYDROGEN TO STORAGE TANKS DEPRESS.	
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80013	Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-143-03HSS-N	
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm	1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L	NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN	
	8	Fluid State	Phase			GAS	GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40	
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29	80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40	
	14						
	15						
	16	Speed of	Design			Close : (12)	Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum	Open : -
	18						
	19						
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)	
	21	Body Size	Body Form			1"	FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L	(*)
	23	Connections	Rating			FLANGED ASME B16.5	#300
	24	Flange Finish	Gasket Material			RF	Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)	(*)
	26	Bolting				A193 B8M / A194 Gr. 8M	
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO	
	29	Fire Safe				(2)	
ACTUATOR	30	Manufacturer	Type			Rotork	Spring Return
	31	Model No.	Size			CP/S	035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal	Cylinder
	33	Ingress Protection	Certification			IP-66	II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE	CLOSE
	36	Fireproofing				NOT APPLICABLE	
	37	Solenoid Valve				25-XY-024 (9, 14, 15, 16) - Bifold FP06P	
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-024 (9, 17) - Soldo SS	25-ZSH-024 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED	
	40	Air Set	Handwheel			(*)	NOT REQUIRED
	41	Mounting Position				HORIZONTAL	
	42	Partial Stroke Test Facility				NOT REQUIRED	
	43	Control Type				-	
	44	Electrical Connection	Electrical Class			No. (*) / M20	H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-	
	47	Safety Valve	Model			-	-
	48	Check Valve	Mounting			-	-
PURCHASE	49	Manufacturer				FLUITEK	
	50	Model				FB3	
	51	Purchase Order Number				1724000204	

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description	Code :
03	06/12/24					
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)	
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)	

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

140	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
141	IFR	25-XV-020	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
142	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
143	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620210001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
144	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
145	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
146	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323304	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
147	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
148	IFR	25-XV-021	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
149	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
150	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620220001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
151	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
152	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
153	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323297	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
154	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
155	IFR	25-XV-024	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
156	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
157	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620230001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
158	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
159	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
160	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323291	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
161	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
162	IFR	50-XV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
163	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
164	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620240001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
165	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
166	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
167	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323289	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
168	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
169	IFR	50-XV-002	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
170	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
171	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620250001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
172	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
173	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
174	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323290	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
175	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
176	IFR	50-XV-003	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
177	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
178	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620260001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
179	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
180	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
181	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323299	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
182	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
183	IFR	50-XV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
184	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
185	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620270001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
186	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

CONFORMITY DECLARATION ACCORDING TO EUROPEAN DIRECTIVE 2014/68/UE

DICHIARAZIONE DI CONFORMITÀ AI SENSI DELLA DIRETTIVA EUROPEA 2014/68/UE

THE MANUFACTURER
IL FABBRICANTE

Name Nome	FLUITEK ORSENIGO VALVES S.R.L.
Legal representative and role Legale rappresentante	P. Belotti – Managing Director
Declaration of conformity nr. Dichiarazione di conformità no.	240062
Sede legale Legal office	Via Dei Livelli di Sopra, 7/5 – 24060 COSTA DI MEZZATE (BERGAMO) – ITALY
Sede produttiva Operational office	Via Dei Livelli di Sopra, 7/5 – 24060 COSTA DI MEZZATE (BERGAMO) – ITALY
E-mail E-mail	info@fluitekvalves.com
Website Sito internet	www.fluitekvalves.com
Telephone Telefono	+39 035 666 501
Fax Fax	+39 035 666 5047

DECLARE THAT THE FOLLOWING PRESSURE EQUIPMENT
DICHIARA CHE I SEGUENTI ACCESSORI A PRESSIONE

JOB	FOV Pos.	Serial Number	Client Item	PO N.	Description	Quantity
240062	001	2400620010001	10	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	002	24000620020001	20	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	003	2400620030001	30	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	004	2400620040001	40	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	005	2400620050001	50	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	006	2400620060001	60	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	007	2400620070001	70	1724000204 123A90A	Ball valve 4'' 300#	**1**
240062	008	2400620080001	80	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	009	2400620090001	90	1724000204 123A90A	Ball valve 1-1/2'' 300#	**1**
240062	010	2400620100001	100	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	011	2400620110001	110	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	012	2400620120001	120	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	013	2400620130001	130	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	014	2400620140001	140	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	015	2400620150001	150	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	016	2400620160001	160	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	017	2400620170001	170	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	018	2400620180001	180	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	019	2400620190001	190	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	020	2400620200001	200	1724000204 123A90A	Ball valve 1'' 300#	**1**

Fluitek Valves	**CONFORMITY DECLARATION ACCORDING TO EUROPEAN DIRECTIVE 2014/68/UE** DICHIARAZIONE DI CONFORMITÀ AI SENSI DELLA DIRETTIVA EUROPEA 2014/68/UE

240062	021	2400620210001	210	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	022	2400620220001	220	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	023	2400620230001	230	1724000204 123A90A	Ball valve 1'' 300#	**1**
240062	024	2400620240001	240	1724000204 123A90A	Ball valve 1-1/2'' 150#	**1**
240062	025	2400620250001	250	1724000204 123A90A	Ball valve 1'' 150#	**1**
240062	026	2400620260001	260	1724000204 123A90A	Ball valve 1-1/2'' 150#	**1**
240062	027	2400620270001	270	1724000204 123A90A	Ball valve 1'' 150#	**1**
240062	028	2400620280001	280	1724000204 123A90A	Ball valve 1'' 150#	**1**

MET THE REQUIREMENTS OF DIRECTIVE 2014/68/UE
SONO CONFORMI AI REQUISITI DELLA DIRETTIVA 2014/68/UE

Conformity assessment procedure used: Procedura di valutazione di conformità utilizzata:	Module H annex III of Directive 2014/68/UE Modulo H Allegato III della Direttiva 2014/68/UE
Notified Body charged of conformity assessment: Organismo Notificato incaricato della valutazione di conformità:	Bureau Veritas (Notified Body No.1370) Bureau Veritas (Ente Notificato N°1370)
Not armonized standards applied to design and manufacture: Norme non armonizzate applicate alla progettazione e alla fabbricazione:	ASME B16.34, ASME VIII, ASME IX, UNI EN 1503 Part.2 ASME B16.34, ASME VIII, ASME IX, UNI EN 1503 Part.2
Classificazione dei fluidi condotta in conformità ai requisiti del	Regolamento CLP CE 1272/2008 Fluid group: **1**

Place COSTA DI MEZZATE (BG), Italy
Luogo COSTA DI MEZZATE (BG), Italia

Date 14/01/2025
Data



Signature
Firma

Fluitek Valves	**DECLARATION OF CONFORMITY ATEX 2014/34/EU** *Dichiarazione di Conformità ATEX 2014/34/EU*	**Cert. DDC No.** **240062 ATEX**

GENERAL INFORMATION – *INFORMAZIONI GENERALI*

Customer ***Cliente***	ROSETTI MARINO S.P.A.		
P. Order ***Ordine***	1724000204 123A90A	**Item/s** ***Item/s***	ALL
FOV Job ***Commessa FOV***	240062	**Position/s** ***Posizione/i***	ALL
Subject ***Oggetto***	BALL VALVE		
Date of execution ***Data di esecuzione***	24/07/2024		

STATEMENT – *DICHIARAZIONE*

We declare that this product has been manufactured in accordance with the Euporean Directive 2014/34/EU to the classification II 2 G/D Tx c.
Technical standards and specifications used are referenced in the Fluitek Orsenigo valves above stated internal job.
The equipment satisfies the provision of directive 2014/34/EU and of standards EN 1127-1, UNI CEI EN ISO 80079-36:2016.
Technical file deposited to Notified Body TUV RHEINLAND 0035.

REMARKS – *NOTE*

SIGNATURE – *FIRME*

Inspection Authority ***Ente Ispettivo***	**Customer Inspector** ***Ispettore Cliente***	**Quality Control** ***Controllo qualità***
		FLUITEK ORSENIGO VALVES S.R.L. Q.C.

rotork Fluid Systems	EU Declaration of Conformity	Rif. JOB nr: AF7703

Manufacturer: Rotork Fluid Systems S.r.l.

Address: Via Padre Jacques Hamel, 138/B
55016 Porcari, Lucca – Italy
Tel. +39 0583 2221
Fax. +39 0585 091362

Section PED: ☐ Applicable ☒ Not Applicable

Under its sole responsibility declares that the items specified below have been designed, manufactured, inspected and tested as required by the relevant provisions of the Pressure Equipment Directive 2014/68/UE.
The equipment has been submitted to the following conformity assessment procedures:

☐**Module H**: **CE-1370-PED-H-RTK 001-23-ITA** **Serial No.:**

☐ **Module H1**: **CE-1370-PED-H1-RTK 001-23-ITA** **Serial No.:**
CE-1370-PED-H1D-RTK 001-20-ITA
CE-1370-PED-H1D-RTK 002-20-ITA

Notified Body: Bureau Veritas Italia SPA Viale Monza 347 20126 MI – Italy
NB Number: 1370

Description: The pressure equipment is a part pressure of pneumatic actuator that is product of Rotork Fluid Systems for quart turn and linear valve. It is composed by a cylinder can and two flanges packaged by tie rods.

Other technical standards and specifications used:
VSR rev.1995; RACCOLTA "M"; RACCOLTA "S"; AD 2000-Merkblatt; ASME VIII Div.1/Div.2; ASME II; EN 13445-3

Section ATEX:

Under its sole responsibility declares that the actuators model:

☒ **GP/GH, CP/CH, RP/RH, LP/LH, HPG, HPL MARKED:** **II 2 G Ex h IIC T5 Gb X**
II 2 D Ex h IIIC T100°C Db X
IP 66M/67M

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / EN 60529

☐ **CQP/CQH MARKED:** **II 2 G Ex h IIC T5 Gb X**
II 2 D Ex h IIIC T100°C Db X
IP 66/68

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / EN 60529

☐ **GO, GOL, EH MARKED:** **II 2 G Ex 60079-46 II_ T_ _ X**
(II 2 D Ex 60079-46 III_ T_ _X)
IP 6_

to which this declaration refers, are in compliance with the following European Directive: **ATEX 2014/34/EU** and they are manufactured according to the following harmonized standards:
EN 12100 / EN ISO 80079-36 / EN ISO 80079-37 / EN ISO4413 / EN ISO4414 / IEC 60079-46, EN 60529

The conformity has been evaluated according to ***Annex VIII (Article 13, Point 1. (b)(ii))*** *of* ***ATEX 2014/34/EU*** *directive.*
TECHNICAL FILE N° TR 219 *(Receipt Number:* ***BVI/ATEX/ITA/24/080*** *Bureau Veritas ITA)*

Section API 6DX: ☐ Applicable ☒ Not Applicable

Under its sole responsibility, the Manufacturer declares that the items specified above have been designed, manufactured, inspected, and tested as required by the applicable provisions of the current edition of the product standard API 6DX and all addenda.


SIGNED ON BEHALF OF ROTORK FLUID SYSTEMS S.R.L. (authorized representative of):

Legal Representative: Metin Gerceker **Signature:**


Place / date: Porcari / 05/02/2025

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

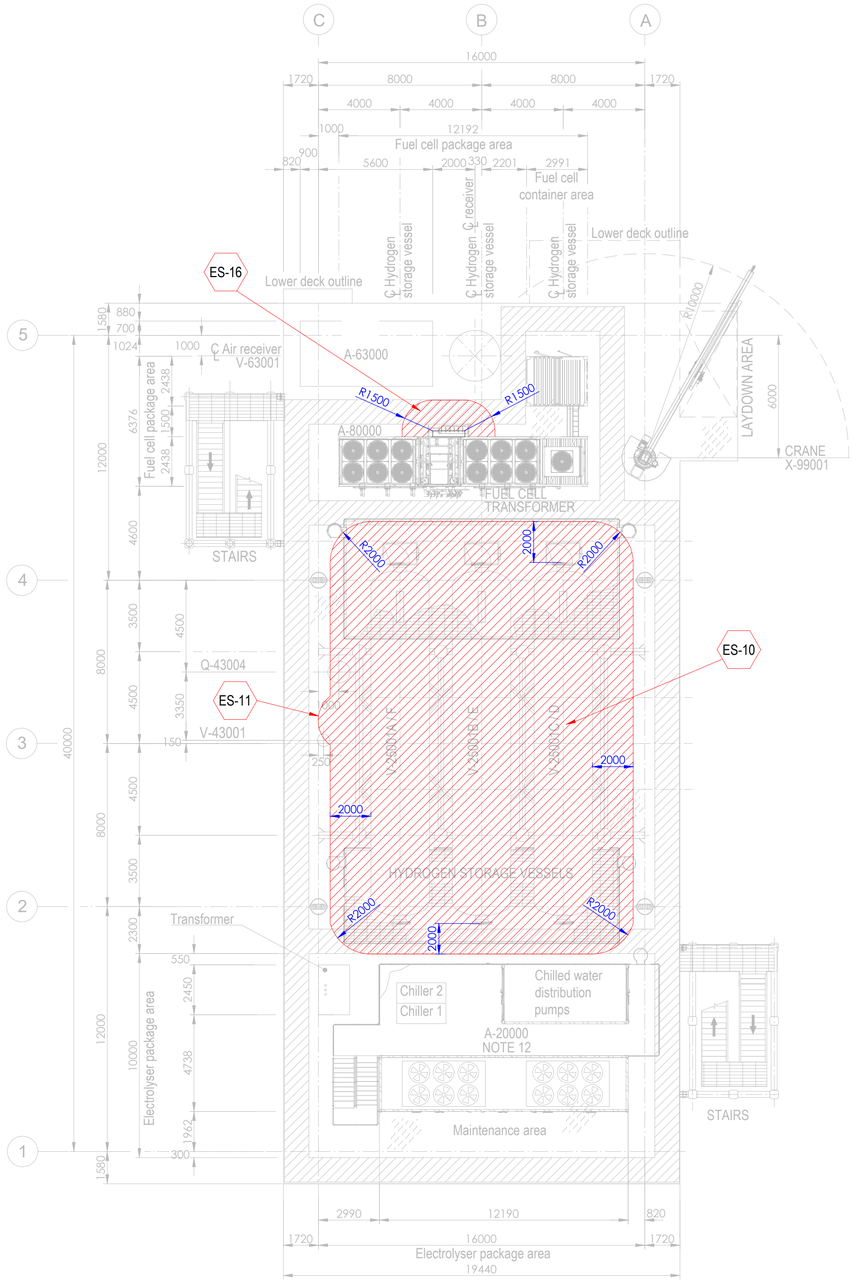


PLAN ON UPPER DECK
EL+30.310 T.O.S.

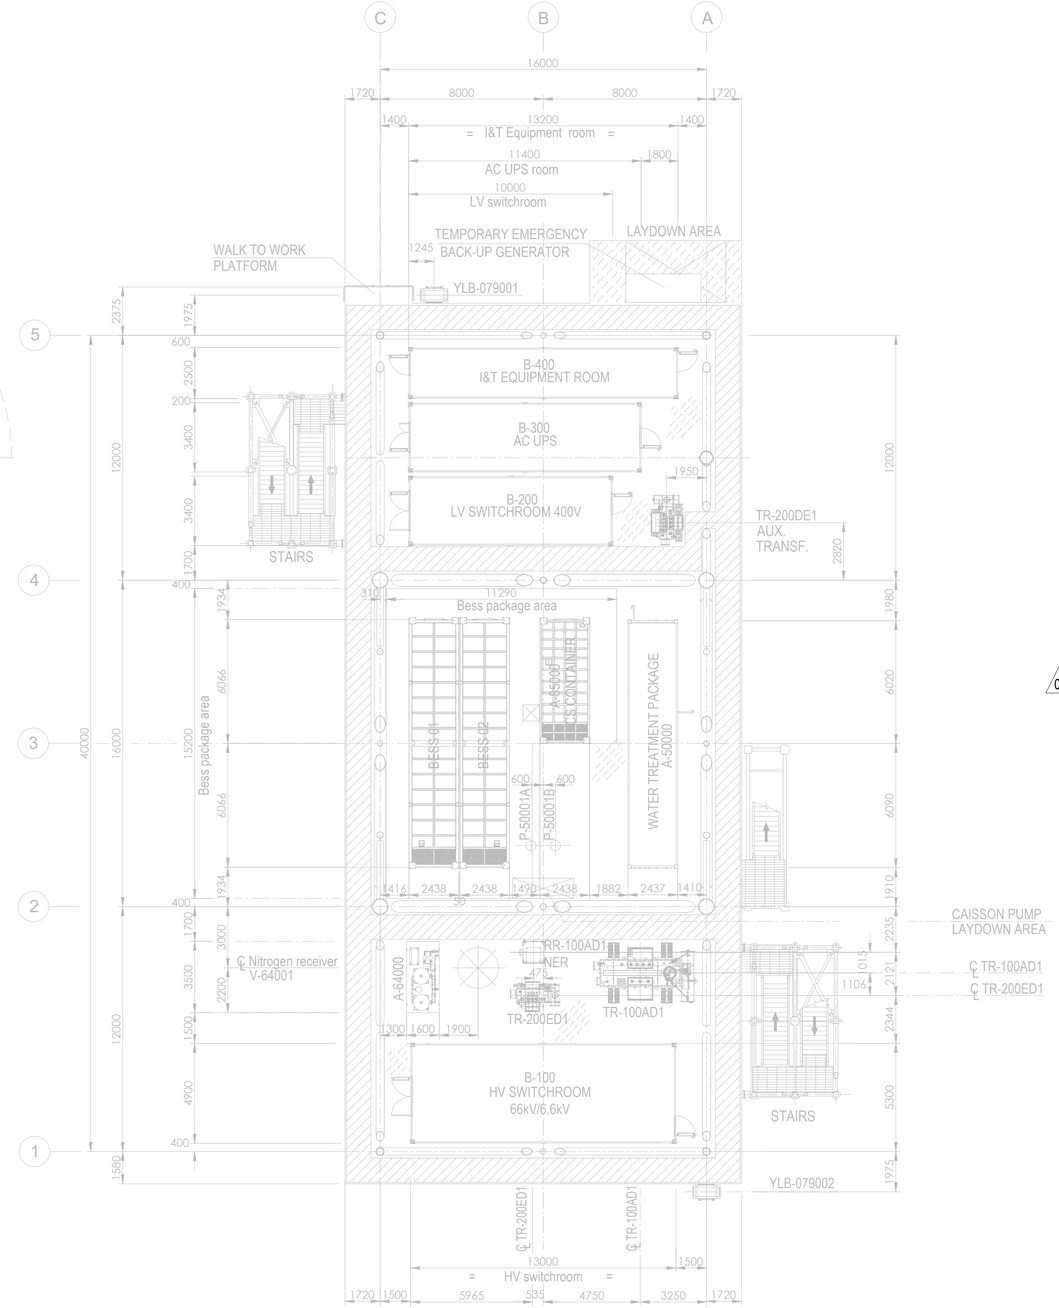

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

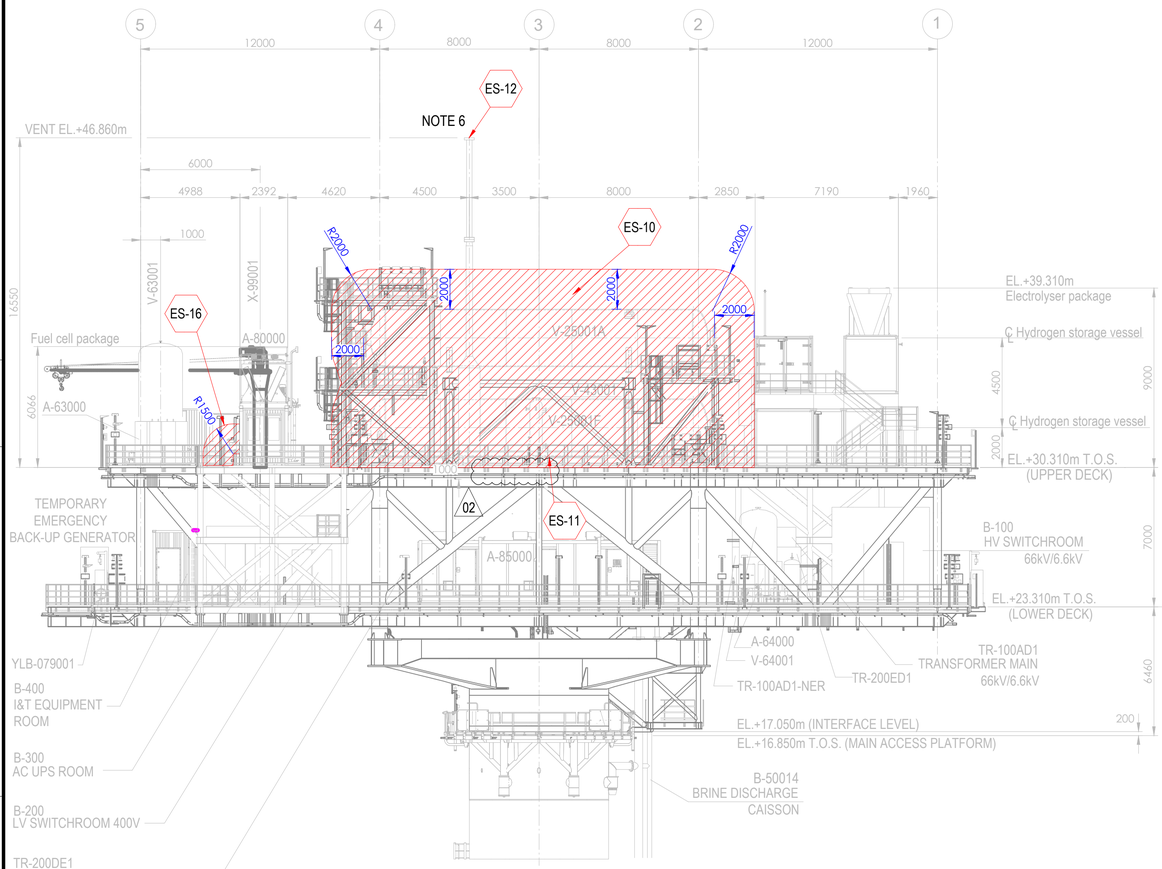



ELEVATION LOOKING EAST

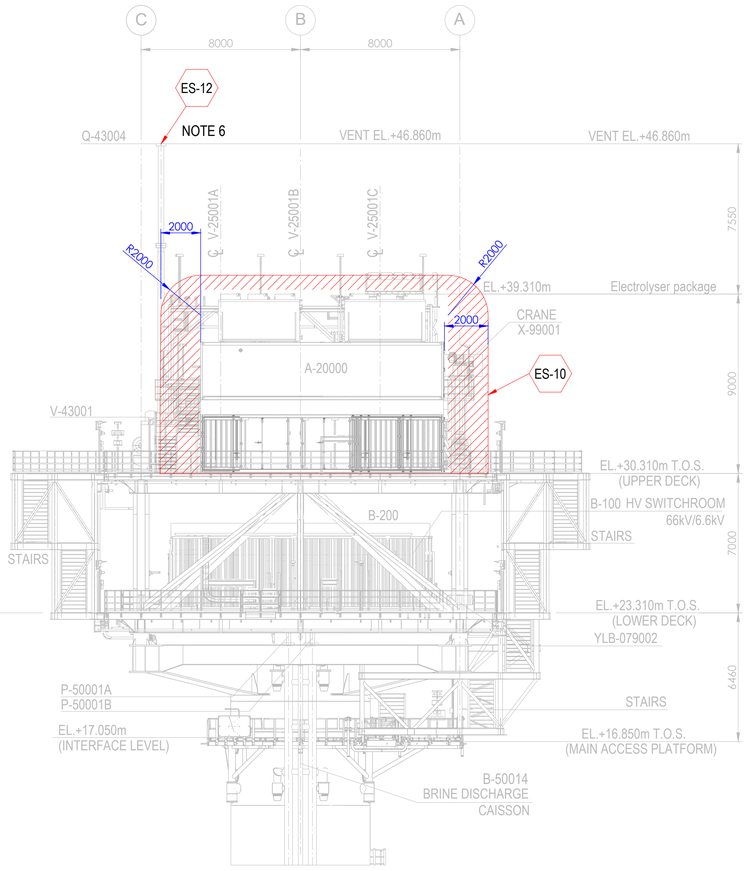

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

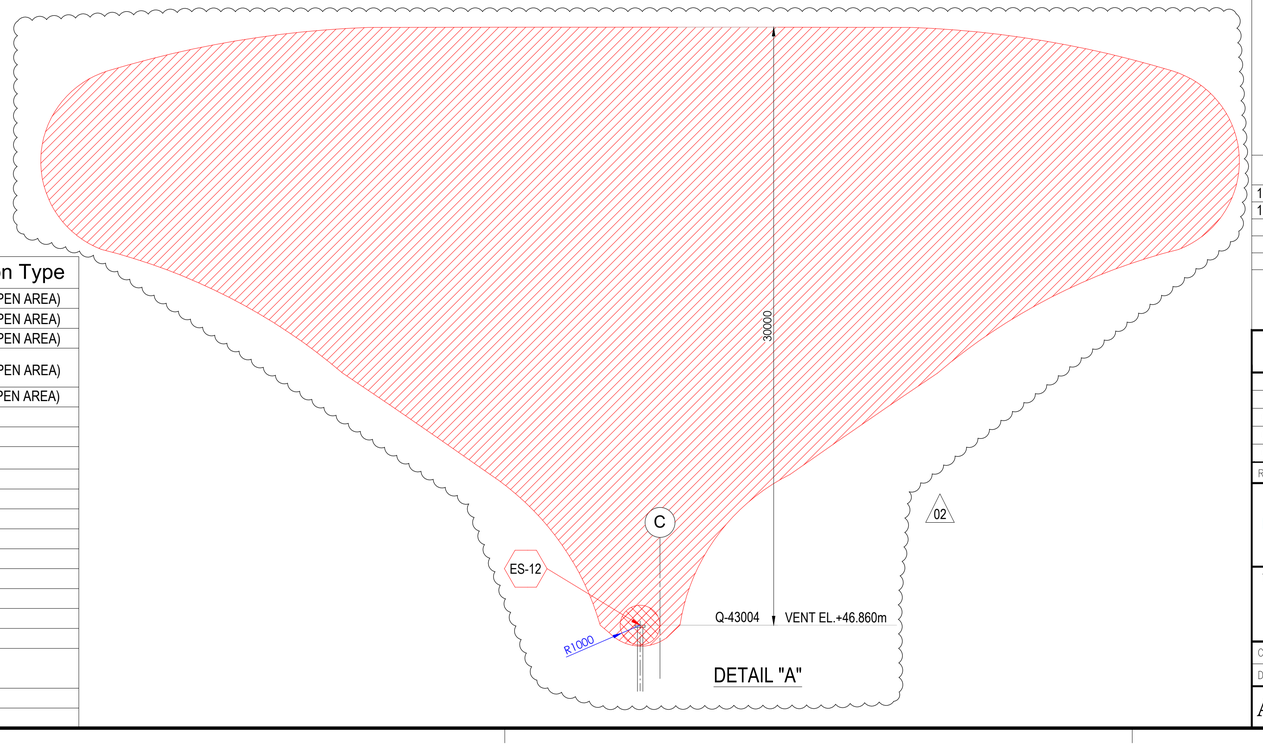



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-SDY-001	: Solenoid Valve - Hyrogen to Vessels Inlet Header Shut-Down	Dwg	123A90-DDL-PR-PID-80013		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001712	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		FL10524-8796			
Manufacturer	BIFOLD			**Model**		FP06P-77A			
Cert No.	Baseefa10ATEX0026			**Equipment Ambient Temp.**		-60°C +40°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	PL	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	OK	

ITEM	Tag	25-SDY-001	: Solenoid Valve - Hyrogen to Vessels Inlet Header Shut-Down			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001712		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	OK	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	25-SDY-001	: Solenoid Valve - Hyrogen to Vessels Inlet Header Shut-Down		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001712	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type "nR" only)	x	NA	
71	Breathing operation is satisfactory (type "nR" only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for 'IS' Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-30	2025-02-05	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-30T10:16:42.497Z	PROVERLIS Digitaly signed by Alessio Polo 2025-02-05T17:06:37.159Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

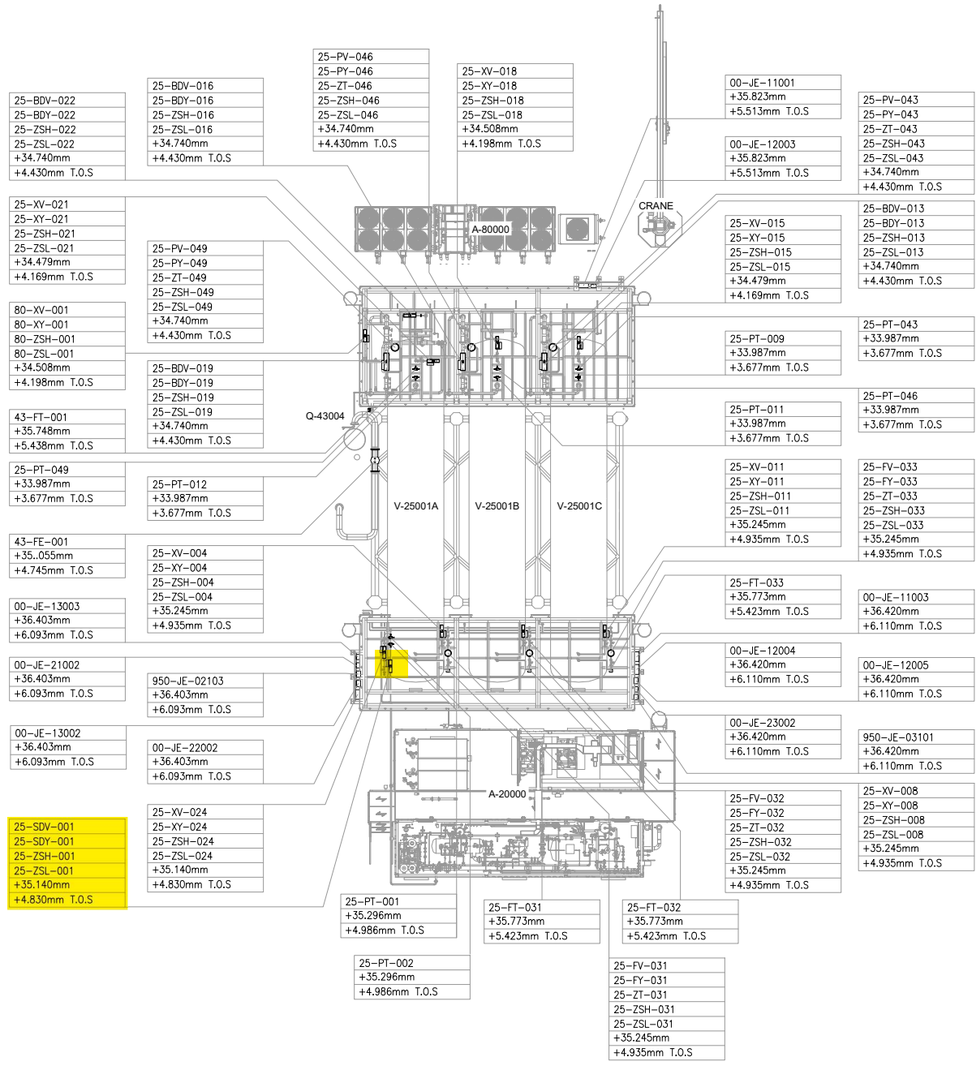

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm

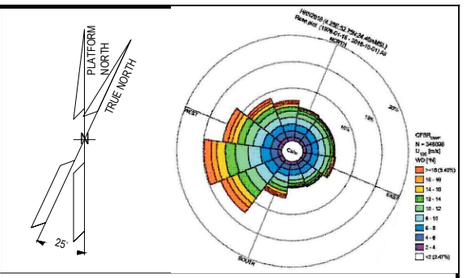

NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90–DDL–IN–DL–40081	002	02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING_NO.

REV.

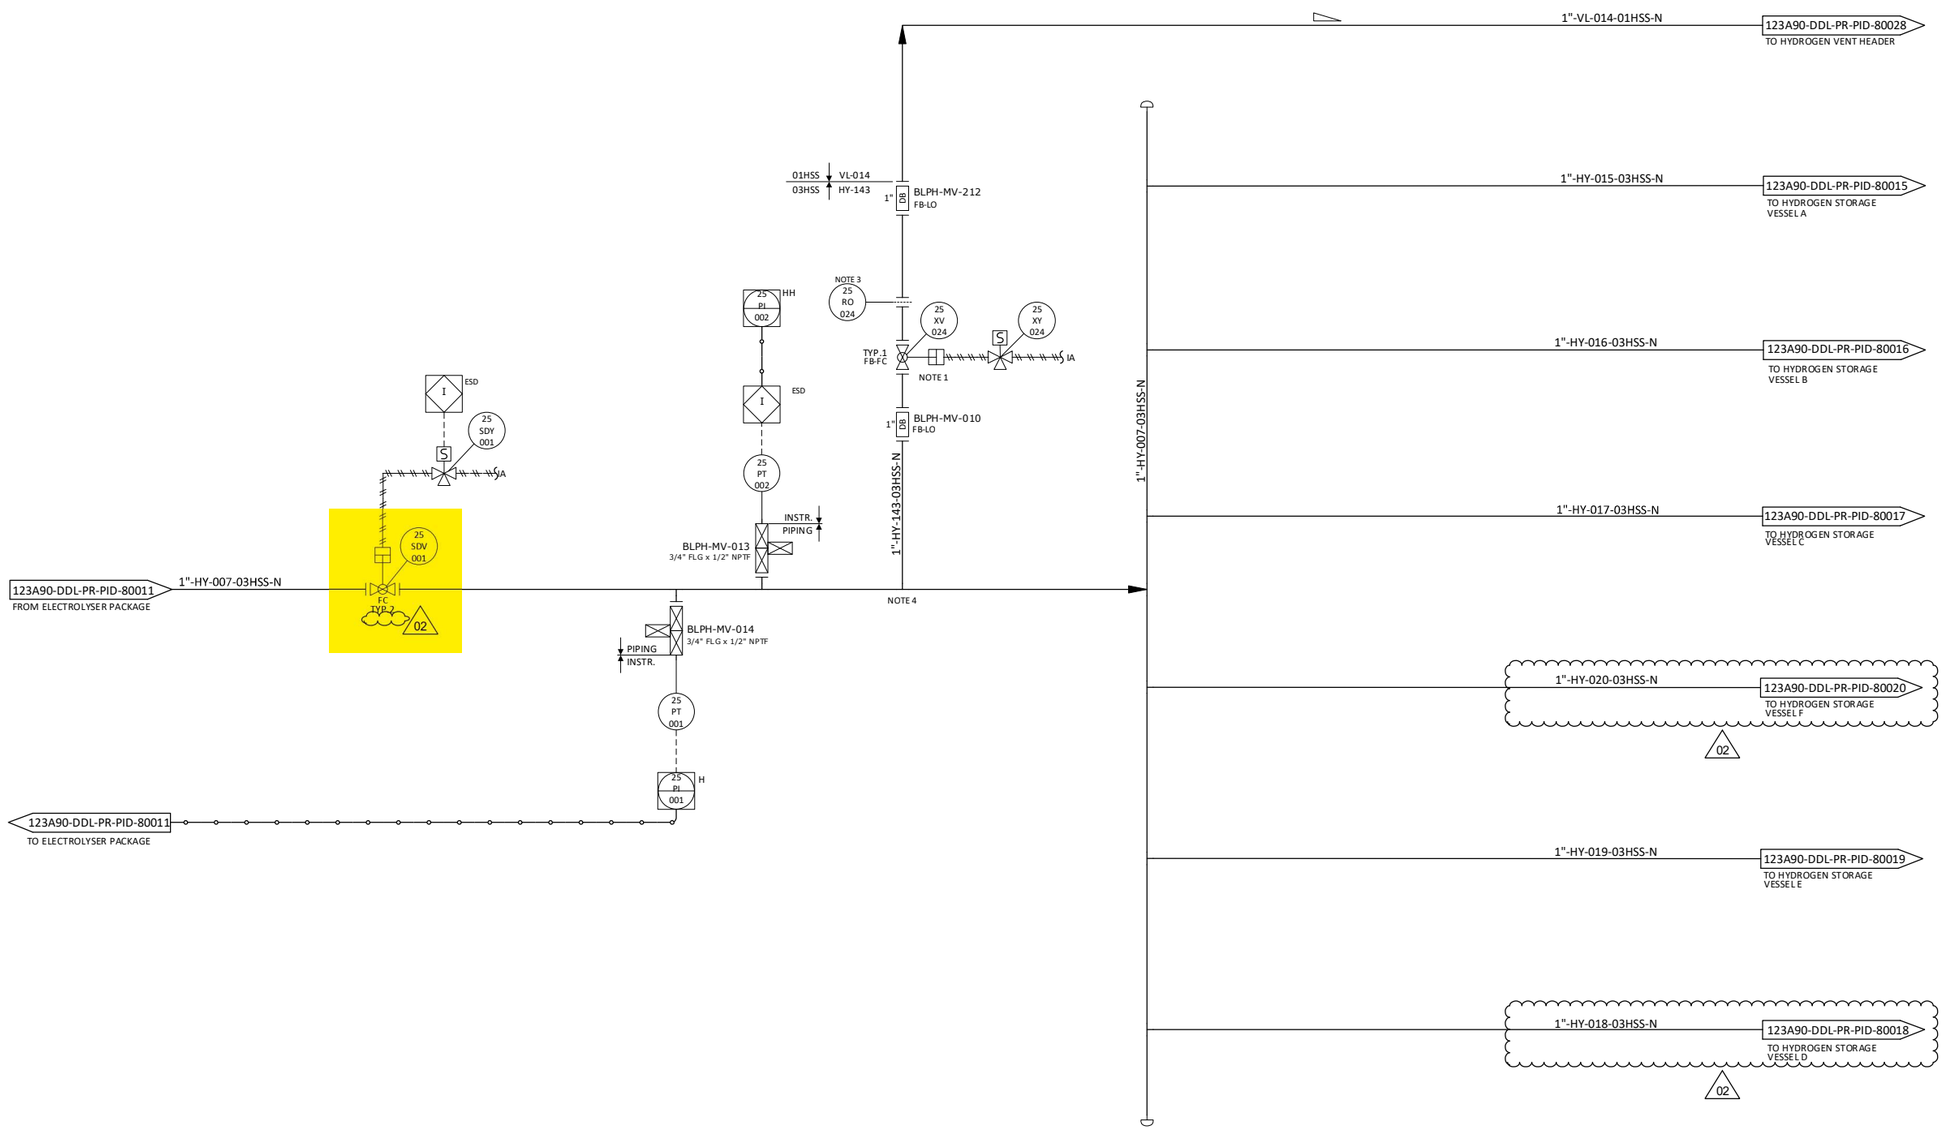

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSELS HEADER (INLET)

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO.	SHEET	REV.
	123A90-DDL-PR-PID-80013	001	02

File Name : FILE_NAME

DRAWING NO. 123A90-DDL-IN-DG-40016

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-23002	No.	MARSHALLING CABINET B400-SIS-001

<01>

25-SDY-001 (+ 1BK, - 2BK) — C-25-SDY-001/00-JE-23002, 2x2.5mm2,ShT+ARM,F.Res,ORANGE,NIS — NOTE-2

25-BDY-022 (+ 1BK, - 2BK) — C-25-BDY-022/00-JE-23002, 2x2.5mm2,ShT+ARM,F.Res,ORANGE,NIS — NOTE-2

25-SDY-023 (+ 1BK, - 2BK) — C-25-SDY-023/00-JE-23002, 2x2.5mm2,ShT+ARM,F.Res,ORANGE,NIS — NOTE-2

64-SDY-001 (+ 1BK, - 2BK) — C-64-SDY-001/00-JE-23002, 2x2.5mm2,ShT+ARM,F.Res,ORANGE,NIS — NOTE-2

TB-1

1BK	1	1BK
2BK	2	2BK
	SH	
SPARE	3	3BK
	4	4BK
	SH	
5BK	5	5BK
6BK	6	6BK
	SH	
7BK	7	7BK
8BK	8	8BK
	SH	
9BK	9	9BK
10BK	10	10BK
	SH	
SPARE	11	11BK
	12	12BK
	SH	
	OS	

00-JE-23002/B400-SIS-001

12x2.5mm2,ShT+ARM,F.Res,ORANGE,NIS

TB-00-JE-23002

1BK	1	25-SDY-001
2BK	2	
3BK	3	SPARE
4BK	4	
5BK	5	25-BDY-022
6BK	6	
7BK	7	25-SDY-023
8BK	8	
9BK	9	64-SDY-001
10BK	10	
11BK	11	SPARE
12BK	12	

Shield Bar — I.E.

<01>

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40016**

REV.:	DATE:	SIGNATURE:
1_Q	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND | ROSETTI MARINO


TITLE :
BASE LOAD POWER HUB (BLPH)
I INSTRUMENT– SAFETY SYSTEM WIRING DIAGRAMS
00–JE–23002

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90–DDL–IN–DG–40016	SHEET 019	REV. 01

File Name : 123A90-DDL-IN-DG-40016_Rev.01

E33

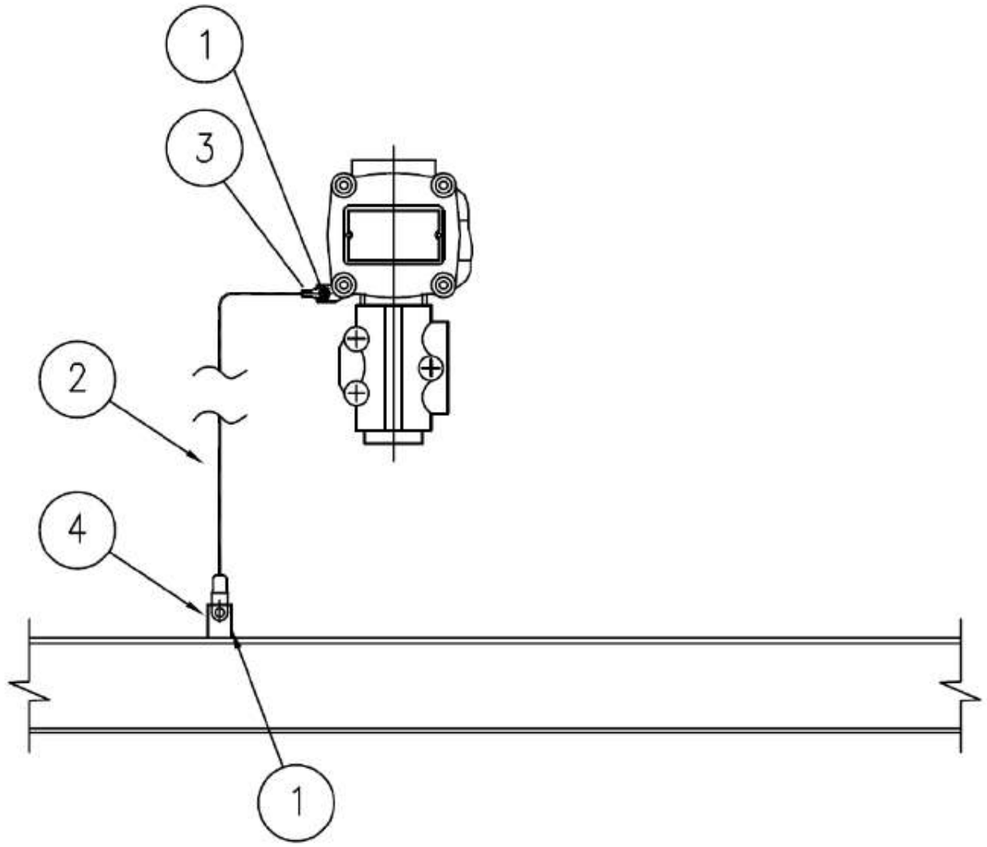

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-EL-DD-20090
REV.: 2_I | DATE: 07/11/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 16 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR SDV/BDV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

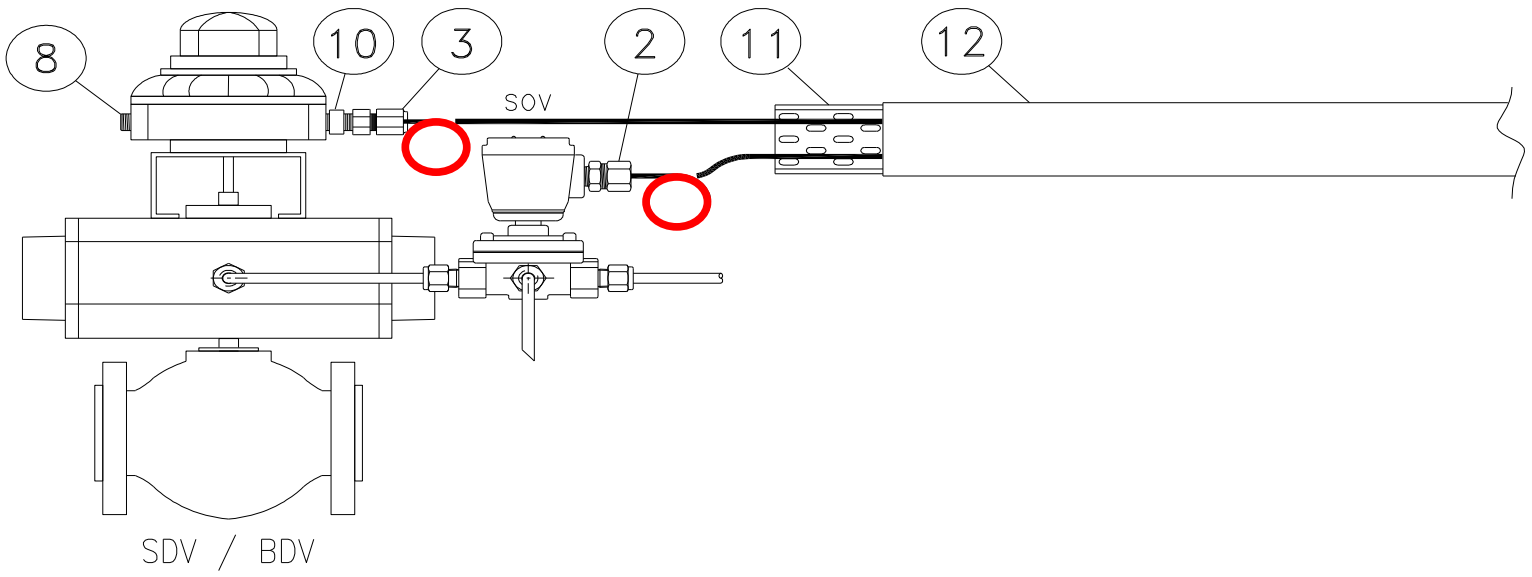

SDV / BDV

INSTRUMENT TAG	
1	25-BDV-005
2	25-BDV-007
3	25-BDV-010
4	25-BDV-013
5	25-BDV-016
6	25-BDV-019
7	25-BDV-022
8	25-SDV-001
9	25-SDV-023
10	64-SDV-001
11	
12	
13	
14	
15	
16	
17	
18	
19	
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
10		Nickel Plated Brass Adaptor Ex-d/e IIC (or IIB + H2) T1	M20 Male x M25 Female	1
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
3		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M25	1
2		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

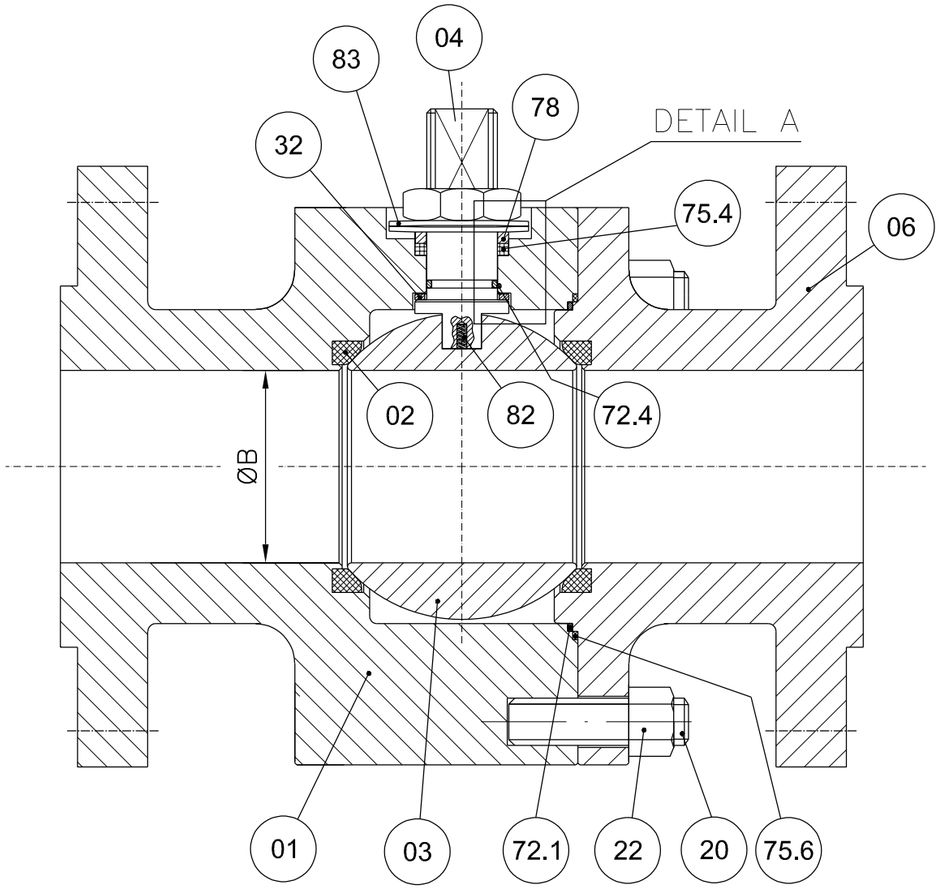




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

GENERAL	1	Tag Number	Location			25-SDV-001		25
	2	Service				HYDROGEN TO STORAGE TANKS		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80013		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-007-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close : (12)		Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum		Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/AA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-SDY-001 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-001 (9, 17) - Soldo SS		25-ZSH-001 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR	25-SDV-023	ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-PSV-055B	Safety Valve	LOWER DECK	1724000740	AST SpA	COITECH	24-03803	SLK	ATEX ZONE 2	Declaration of Conformity By COITECH SLKL-08HA74-015	Coitech EU - Type Examination Certificate	CE Ex - II 2 GD Ex h X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PT-001	Hyrogen to vessels inlet header	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240634	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-002	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240635	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-004	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240636	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PT-006	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240638	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-PT-008	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240640	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-PT-009	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240642	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-PT-011	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240644	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_2
25-PT-012	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240646	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-035	Vessel V-25001A pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240637	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PT-037	Vessel V-25001B pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240639	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-PT-040	Vessel V-25001C pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240641	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-PT-043	Vessel V-25001D pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240643	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-PT-046	Vessel V-25001E pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240645	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_2
25-PT-049	Vessel V-25001F pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240647	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240648	SST76-H-7-K-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PT-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240649	SST76-H-7-K-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PV-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400589	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PV-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400590	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-PV-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400591	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-PV-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400592	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-PV-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400593	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-PV-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400594	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-PV-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400595	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PV-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400596	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PY-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400589	CV-8407	II 2G	ATEX - SN 2400589	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PY-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400590	CV-8407	II 2G	ATEX - SN 2400590	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-PY-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400591	CV-8407	II 2G	ATEX - SN 2400591	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-PY-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400592	CV-8407	II 2G	ATEX - SN 2400592	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-PY-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400593	CV-8407	II 2G	ATEX - SN 2400593	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-PY-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400594	CV-8407	II 2G	ATEX - SN 2400594	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-PY-055A	Hydrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400595	CV-8407	II 2G	ATEX - SN 2400595	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PY-055B	Hydrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400596	CV-8407	II 2G	ATEX - SN 2400596	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SDV-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SDV-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SDY-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SDY-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-SV-031	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-SV-032	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-033	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-SV-034	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-SV-035	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-SV-036	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-037	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2

1 # EU - TYPE EXAMINATION CERTIFICATE

2 **Equipment or Protective System Intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU**

3 EU - Type Examination Certificate Number: **Baseefa10ATEX0026 – Issue 15**

4 Product: **Type 27 & 77 Solenoid Operator**

5 Manufacturer: **Bifold Fluidpower Limited**

6 Address: **Chadderton, Oldham, Greater Manchester, OL9 9XA, UK**

7 This re-issued certificate extends EU Type Examination Certificate No. **Baseefa10ATEX0026** to apply to product designed and constructed in accordance with the specification set out in the Schedule of the said certificate but having any variations specified in the Schedule attached to this certificate and the documents therein referred to.

8 SGS Fimko Oy, Notified Body number 0598, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this product has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II to the Directive.

8.1 The original certificate was issued by SGS Baseefa Ltd (UK Notified Body 1180). It, and any supplements previously issued by SGS Baseefa Ltd have been transferred to the supervision of SGS Fimko Oy (EU Notified Body 0598). The original certificate number is retained.

The examination and test results are recorded in confidential Report No. **See Certificate History**

9 Compliance with the Essential Health and Safety Requirements has been assured by compliance with:

EN IEC 60079-0:2018 **EN 60079-1:2014** **EN 60079-31:2014**

except in respect of those requirements listed at item 18 of the Schedule.

10 If the sign "X" is placed after the certificate number, it indicates that the product is subject to the Specific Conditions of Use specified in the schedule to this certificate.

11 This EU - TYPE EXAMINATION CERTIFICATE relates only to the design and construction of the specified product. Further requirements of the Directive apply to the manufacturing process and supply of this product. These are not covered by this certificate.

12 The marking of the product shall include the following:

Ⓔx II 2GD **Ex db IIC T6 Gb (Tamb -60°C to +40°C)***
Ex tb IIIC T85°C Db (Tamb -60°C to +40°C)* IP66/67
***alternative Temperature class/Ambient combinations may also be marked, see schedule**

SGS Fimko Oy Customer Reference No. **1688** Project File No. **22/0377**

This document is issued by the Company subject to their General Conditions for Certification Services accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx . Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained herein reflects the Company's findings at the time of their intervention only and within the limits of Client's instructions, if any. It does not necessarily indicate that the equipment may be used in particular industries or circumstances. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, schedule included, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

SGS Fimko Oy
Takomotie 8
FI-00380 Helsinki, Finland
Telephone +358 (0)9 696 361
e-mail **sgs.fimko@sgs.com**
web site **www.sgs.fi**
Business ID 0978538-5 Member of the SGS Group (SGA SA)

Mikko Välimäki
Authorised Signatory for SGS Fimko Oy

13 **Schedule**

14 **Certificate Number Baseefa10ATEX0026 – Issue 15**

15 Description of Product

The Type 77 and Type 27 Solenoid Operators are rated at up to 240Vac or dc and have a maximum power dissipation of 14W. The Type 77 Solenoid Operator comprises a stainless steel cylindrical enclosure, whereas the Type 27 comprises an aluminium cylindrical enclosure, both have a spigot cover fitted with a silicone rubber seal.

In addition to the above there is also a two winding alternative designated the 'Pulse-Pulse Solenoid operator' which has a maximum combined coil rating limited to 20.5W.

The base of the enclosure is fitted with an adaptor bush which incorporates venting holes to allow the unit to be fitted onto a valve assembly rated up to a maximum pneumatic pressure of 10 bar. For hydraulic valves and valves with pneumatic pressures greater than 10 bar the top of the valve is provided with additional venting holes.

Internally the unit is fitted with a coil holder, coil and armature onto which is mounted an adjusting rod which forms a cylindrical joint with the adaptor bush and operates the valve when the solenoid is activated.

The cover may be fitted with a pushbutton or a rotary operator which can be used to operate the valve manually either momentarily or permanently.

The cover is secured using four stainless steel socket head cap screws grade of grade A4-70.

The equipment is marked:

Ex db IIC T6 Gb (Tamb -60°C to +40°C)*

Ex tb IIIC T85°C Db (Tamb -60°C to +40°C)* IP66/67

*The following alternative Temperature class/Ambient combinations may also be marked

T5/T100°C (Tamb -60°C to +55°C)

T4/T135°C (Tamb -60°C to +90°C)

An M20 or ½" NPT cable entry hole is provided as specified on the certified drawings for the accommodation of suitable IECEx Equipment (not a Component) certified cable entry device, with or without the interposition of a suitable IECEx Equipment certified (not a Component) flameproof thread adapter.

An M20 cable entry is provided unless the marking 'K85' appears in the Model No. marked on the label, in which case a ½" NPT cable entry hole is provided.

16 Report Number

See Certificate History

17 Specific Conditions of Use

None

18 Essential Health and Safety Requirements

In addition to the Essential Health and Safety Requirements (EHSRs) covered by the standards listed at item 9, the following are considered relevant to this product:

Clause	Subject
1.4.1	External effects
1.4.2	Aggressive substances etc.

19 Drawings and Documents

New drawings submitted for this issue of certificate:

Number	Issue	Date	Description
0-SL0070	0	2022.06.30	TYPE 27 & 77 SOLENOID LABEL - ROTORK BRAND - L240

Current drawings which remain unaffected by this issue:

Number	Issue	Date	Description
0-SC0004	1	09.07.20	Solenoid Lid Options G.A
0-SC0006	0	17.04.09	Latched Energised and Tamperproof Solenoid Options
0-SC0008	1	29.03.11	Override Cover Assembly
0-SC0009	0	12.02.15	Serial Numbers IIB, Type 77
**0-GA0870	0	07.11.17	General Arrangement L209 Variant – Fixed Head Operator
0-SC0003	11	20.09.21	Type 27 and 77 Solenoid Operator
0-SC0007	5	24.11.21	Sol. Operator Pulse-Pulse.
0-SL0056	4	13.01.22	Type 27 & 77 Solenoid housing label Ex d
0-SL0058	5	2022.02.07	Type 27 & 77 Solenoid housing label Ex d
0-SL0068	0	2022.01.17	Label Type 27 and 77 Solenoid Operator

**This drawing is common to this certificate and BAS02ATEX2048, BAS21UKEX0642 and is held with IECEx BAS 10.0008.

20 Certificate History


Certificate No.	Date	Comments
Baseefa10ATEX0026	20 April 2010	The release of the prime certificate. The associated test and assessment against the requirements of EN 60079-0: 2006, EN 60079-1: 2007, EN 61241-0: 2004 and EN 61241-1: 2004 is documented in Test Report No. GB/BAS/ExTR10.0014/00.
Baseefa10ATEX0026/1	7 April 2011	Amendment to the diametral tolerance for the adjusting rod. Omission of drawing 0-SC0001 (previously submitted in error). Alternative design of pushbutton override cover assembly. Minor drawing variations. Documented in Test Report No. GB/BAS/ExTR11.0084/00
Baseefa10ATEX0026/2	8 July 2011	Alternative internal design to form the Pulse-Pulse Solenoid Operator. This unit has two windings with a combined rating of 20.5W. Amended designation for the solenoid housing material. Documented in Test Report No. GB/BAS/ExTR11.0123/00
Baseefa10ATEX0026/3	2 April 2012	Alternative label design incorporating the complete range of temperature class and ambient temperature markings provided for by this certificate. Documented in Test Report No. GB/BAS/ExTR12.0086/00

Certificate No.	Date	Comments
Baseefa10ATEX0026/4	2 December 2013	A re-designation of the Type FP Solenoid Operator, to the Type 77 Solenoid Operator. A satisfactory assessment against the requirements of the updated standards IEC 60079-0: 2011 and IEC 60079-31: 2008 (superseding IEC 61241), complete with a review of the marking. Introduction of an alternative aluminium housing and cover material. Documented in Test Report No. GB/BAS/ExTR13.0291/00
Baseefa10ATEX0026/5	29 July 2014	This issue permits existing information (for example on Schedule Drawings) to be replaced by the revised certificate holders address. No other changes may be made to the certified design. Documented in Test Report No. None.
Baseefa10ATEX0026/6	17 February 2015	Clarification of the Type name. The Type 77 comprises a stainless steel housing and the Type 27 comprises an aluminium housing. To allow the introduction of alternative seal materials. To allow the Type 77 Solenoid Operators having Serial numbers as defined in drawing number 0-SC0009 to be marked with Ex d IIB T6 Gb. Documented in Test Report No. GB/BAS/ExTR14.0317/00
Baseefa10ATEX0026/7	23 June 2016	Minor drawing changes not affecting certification. Documented in Test Report No. GB/BAS/ExTR16.0164/00
Baseefa10ATEX0026/8	16 March 2017	To allow the introduction of an alternative low power circuit. To allow for correction of the Type designation listed on the EU-Type Examination Certificate Baseefa10ATEX0026 To allow for correction of description to include the Pulse Pulse Unit. Documented in Test Report No. GB/BAS/ExTR17.0076/00
Baseefa10ATEX0026/9	20 July 2017	To allow the introduction of an alternative low power circuit. Documented in Test Report No. GB/BAS/ExTR17.0211/00
Baseefa10ATEX0026/10	3 January 2018	To introduce an alternative non-rotational mounting arrangement to attach the adaptor bushing via the coil holder to the enclosure housing. Identification of threaded entry holes on the enclosure wall. Documented in Test Report No. GB/BAS/ExTR17.0274/00
Baseefa10ATEX0026/11	7 March 2018	To introduce alternative terminal plate with a different grounding point design. To introduce optional certification marks in addition to the existing one to be included on to the certification label marking. Documented in Test Report No. GB/BAS/ExTR 18.0041/00
Baseefa10ATEX0026/12	12 July 2019	To assess the Type 27 and 77 Solenoid Operator against the standards EN IEC 60079-0:2018, EN 60079-1:2014 and EN 60079-31:2014 To permit minor drawing changes to the certification label that do not affect certification Documented in Test Report No. GB/BAS/ExTR19.0100/00


Certificate No.	Date	Comments
Baseefa10ATEX0026/13	14 July 2020	To introduce an alternative Detented Manual Over-Ride Lid (alternative spigoted cover), which allows the valve to be operated manually. Documented in Test Report No. GB/BAS/ExTR19.0341/00.
Baseefa10ATEX0026 – issue 14	11 February 2022	This issue of the certificate incorporates previously issued primary & supplementary certificates. To remove drawings 138-10, 138-10-K85, 0-S0252 and 0-S0254 transferring critical details to drawing 0-SC0003 revision 11. To remove drawing 0-SC0001. To add drawing 0-SL0068. To add an alternative encapsulant. To update the nameplate drawings to include UKEX details. Documented in Test Report No. GB/BAS/ExTR21.0158/00
Baseefa10ATEX0026 – issue 15	2 November 2022	This issue of the certificate incorporates previously issued primary & supplementary certificates. To add an alternative marking drawing with a different manufacturer branding. The assessment is documented in test report GB/BAS/ExTR22.0138/00
For drawings applicable to each issue, see original of that issue.		

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

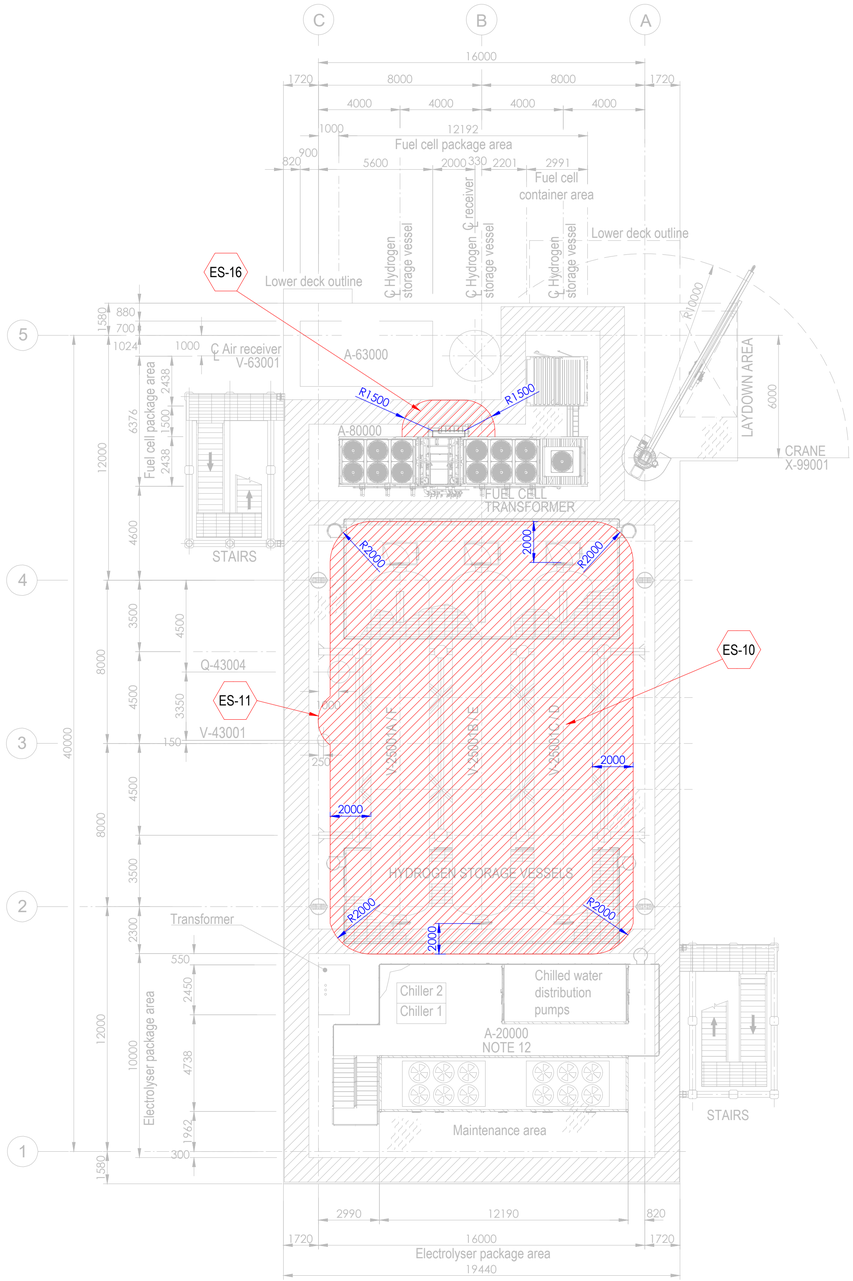


PLAN ON UPPER DECK
EL+30.310 T.O.S.

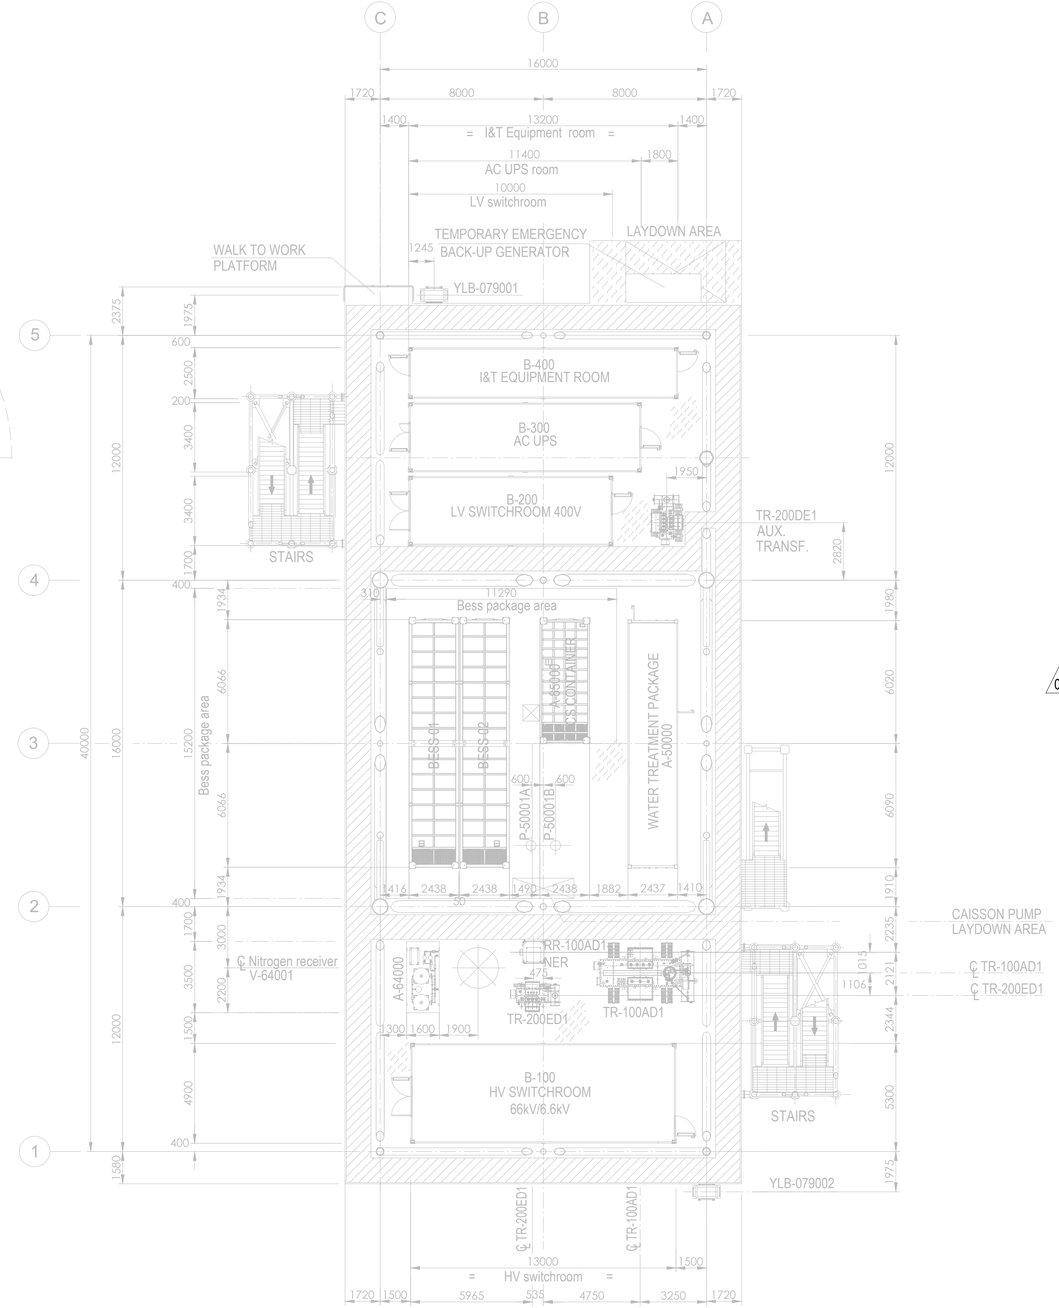

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

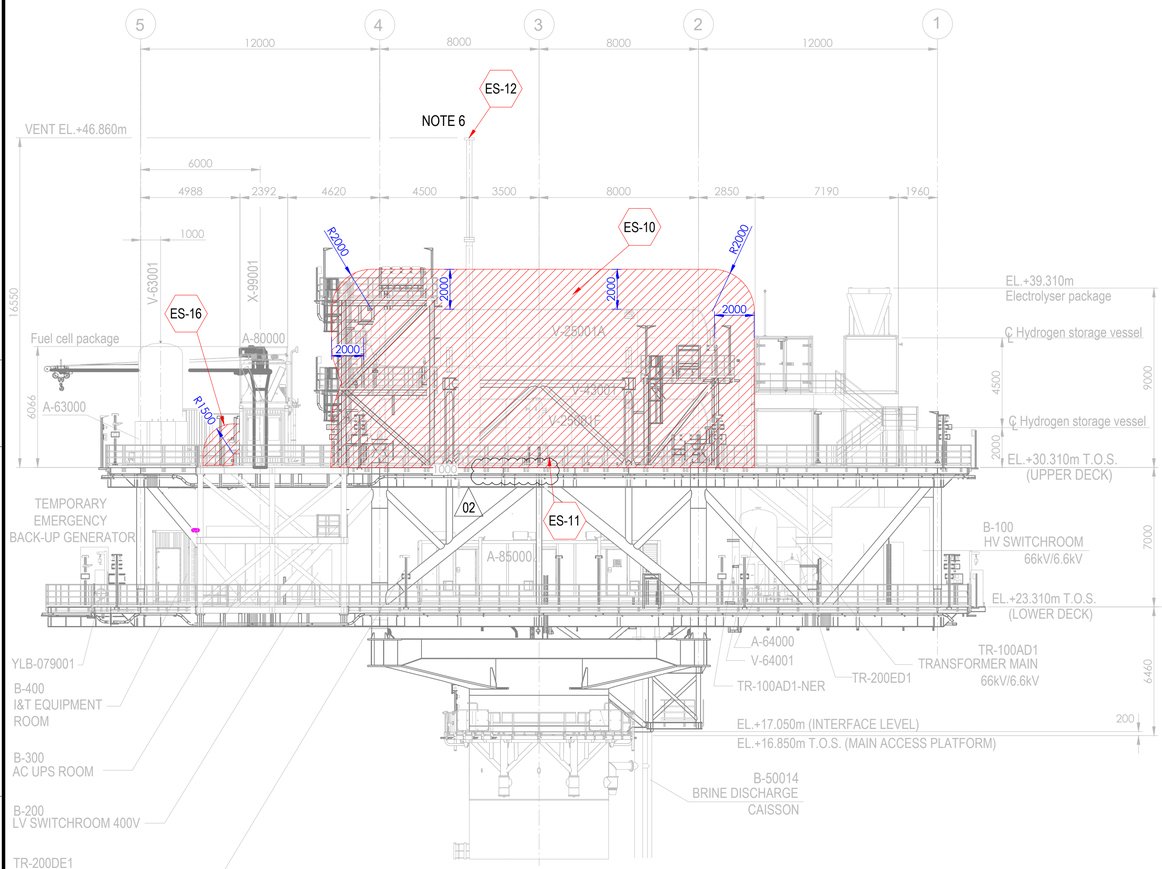



ELEVATION LOOKING EAST

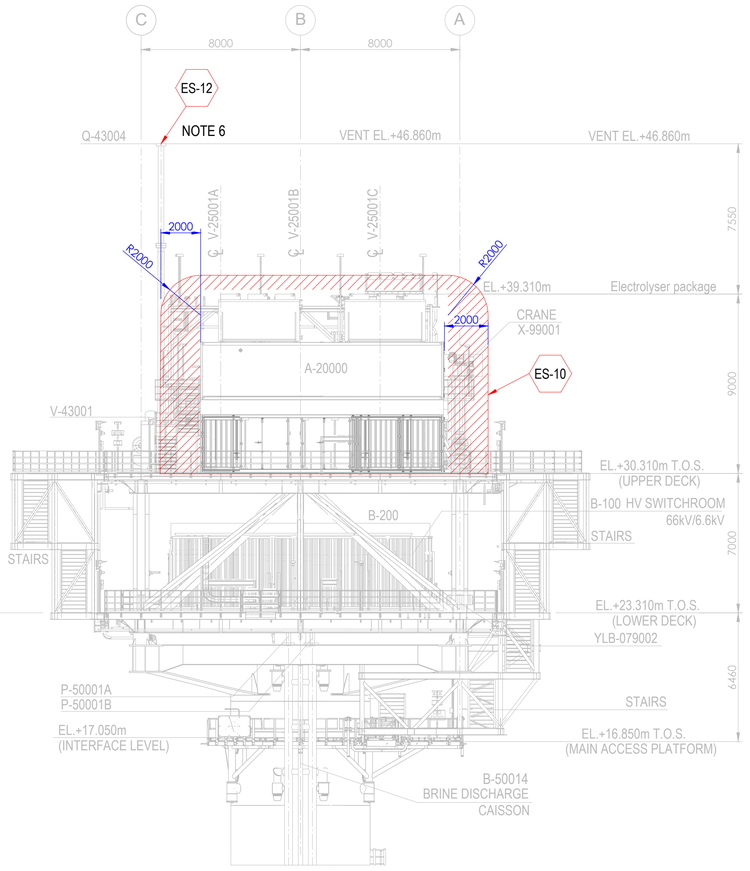

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

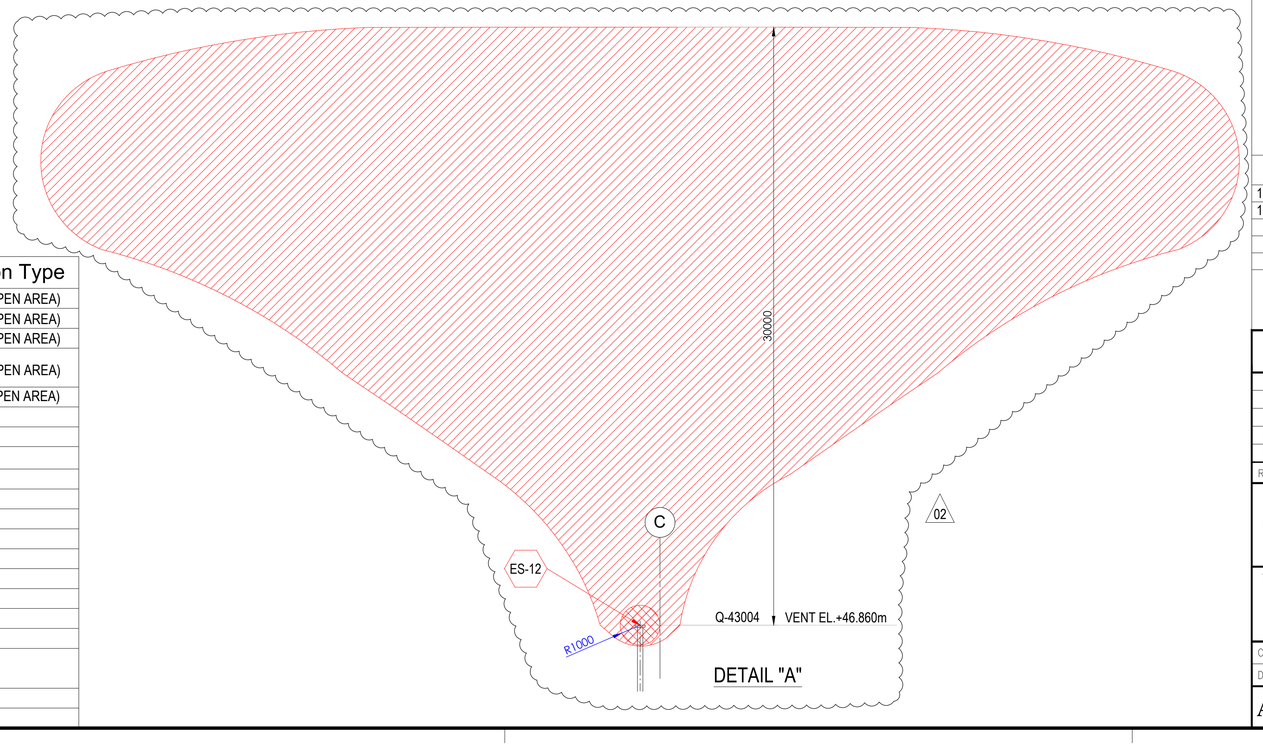



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-XY-004	: Solenoid Valve - Vessel V-25001A Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80015
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001714	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**	FL18524-8831				
Manufacturer	BIFOLD			**Model**	FP06P-77A				
Cert No.	Baseefa10ATEX0026			**Equipment Ambient Temp.**	-60°C to +40°C				
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66/67

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	PL	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	OK	

ITEM	Tag	25-XY-004	: Solenoid Valve - Vessel V-25001A Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80015
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001714		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	OK	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-XY-004	: Solenoid Valve - Vessel V-25001A Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80015
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001714	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-25	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-25T13:52:52.973Z	PROVERLIS Digitaly signed by Alessio Polo 2025-01-29T11:12:08.491Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

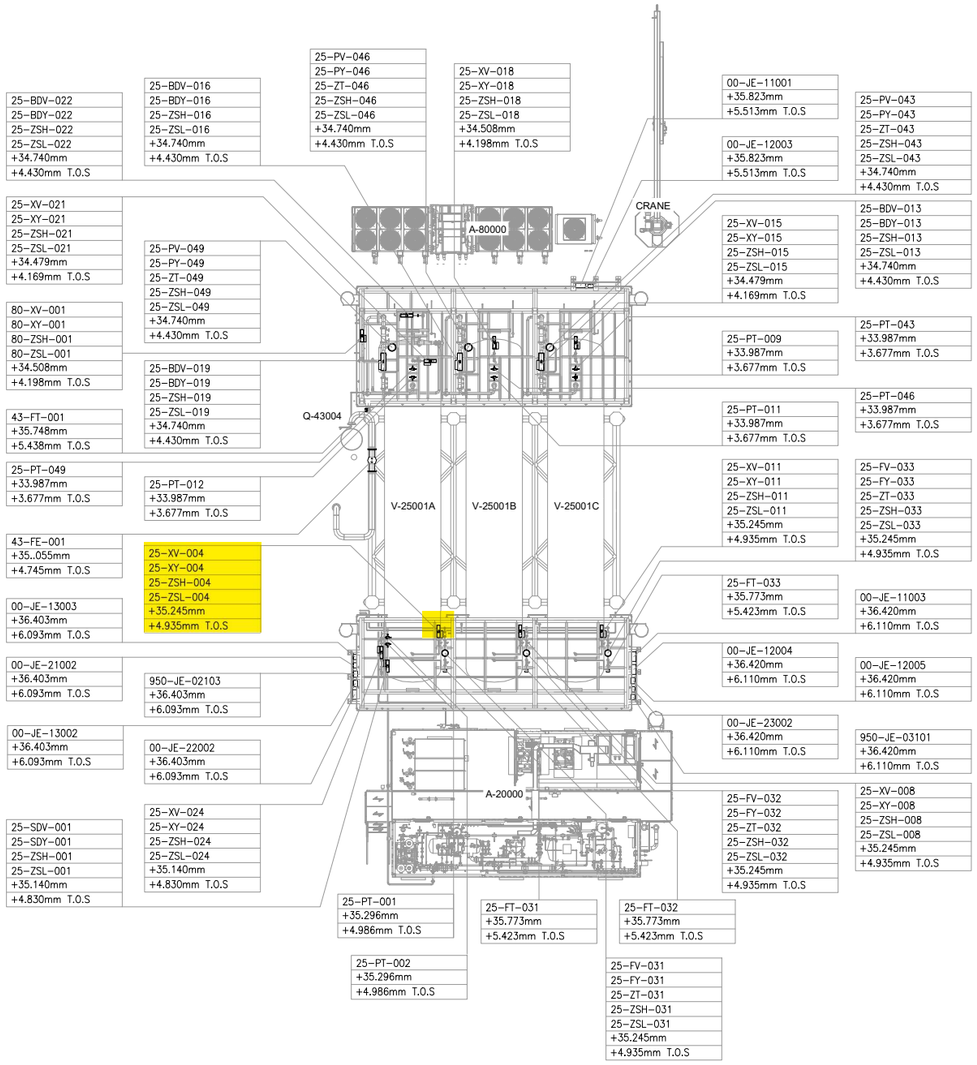

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 A

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg /AMB

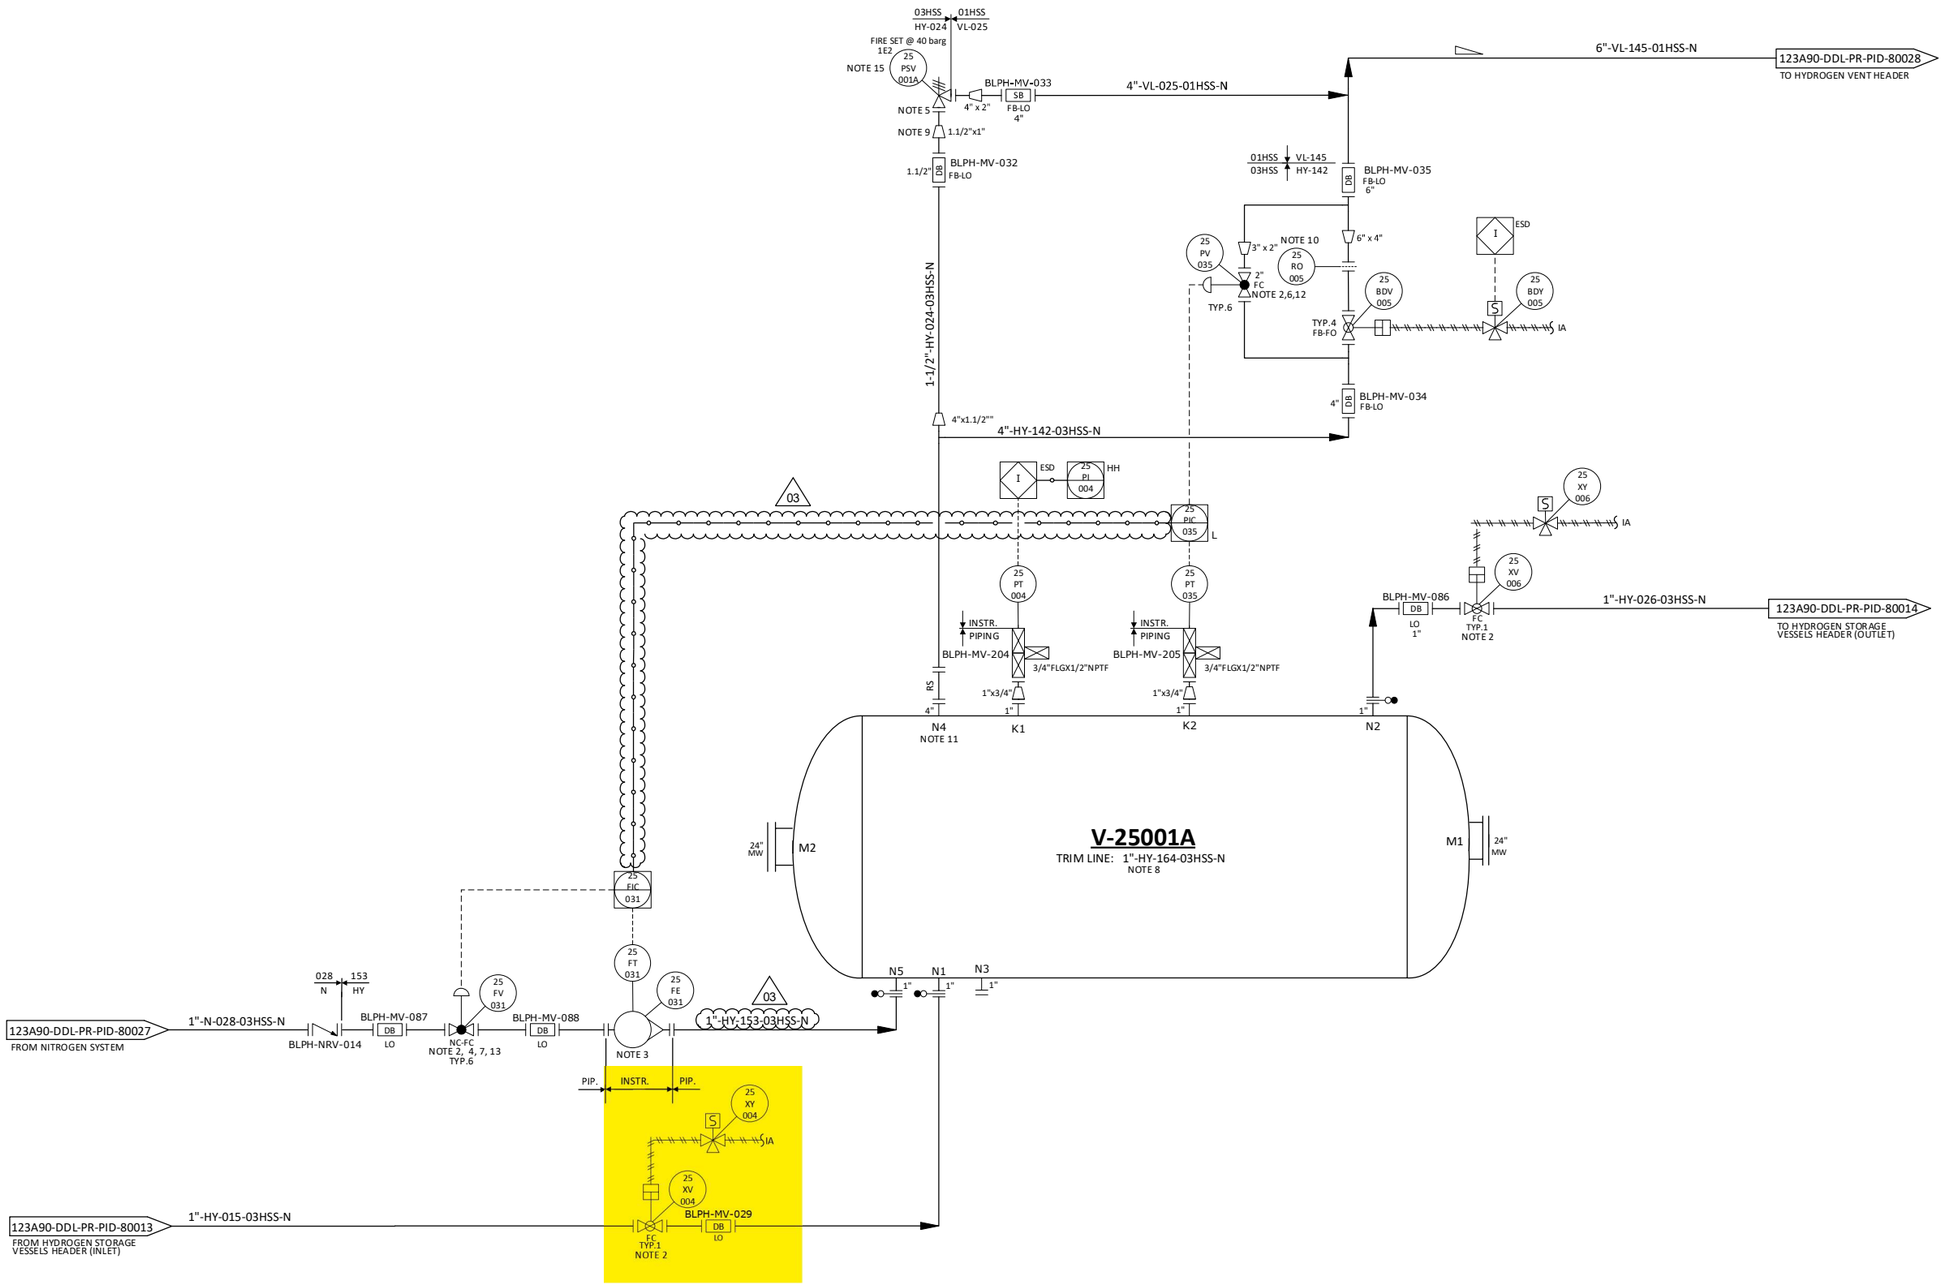

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-031) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-035 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-035 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-031 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-035 HAS FAILED TO CLOSE.
15. 25-PSV-001A SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL A

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80015		SHEET 001	REV. 03


File Name : FILE_NAME

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-13002	No.	MARSHALLING CABINET B400-PCS-002

<01>

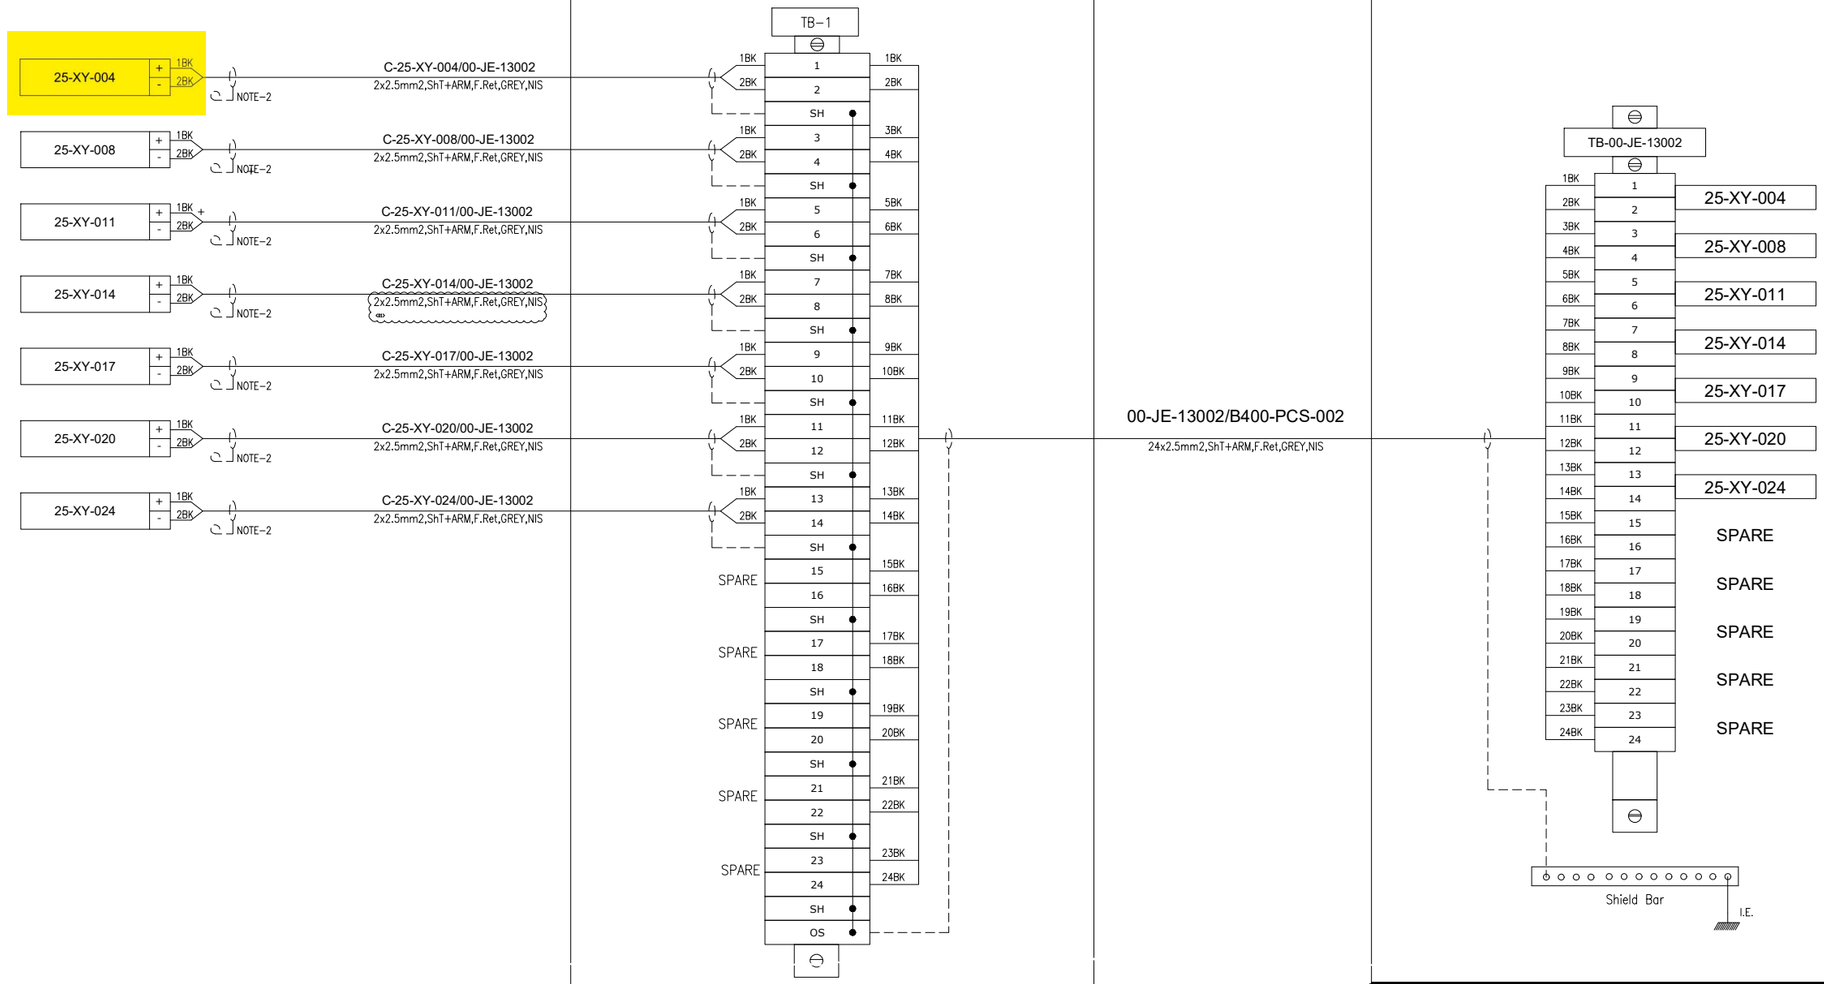

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_D	05/11/24	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-13002

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 029	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

E33

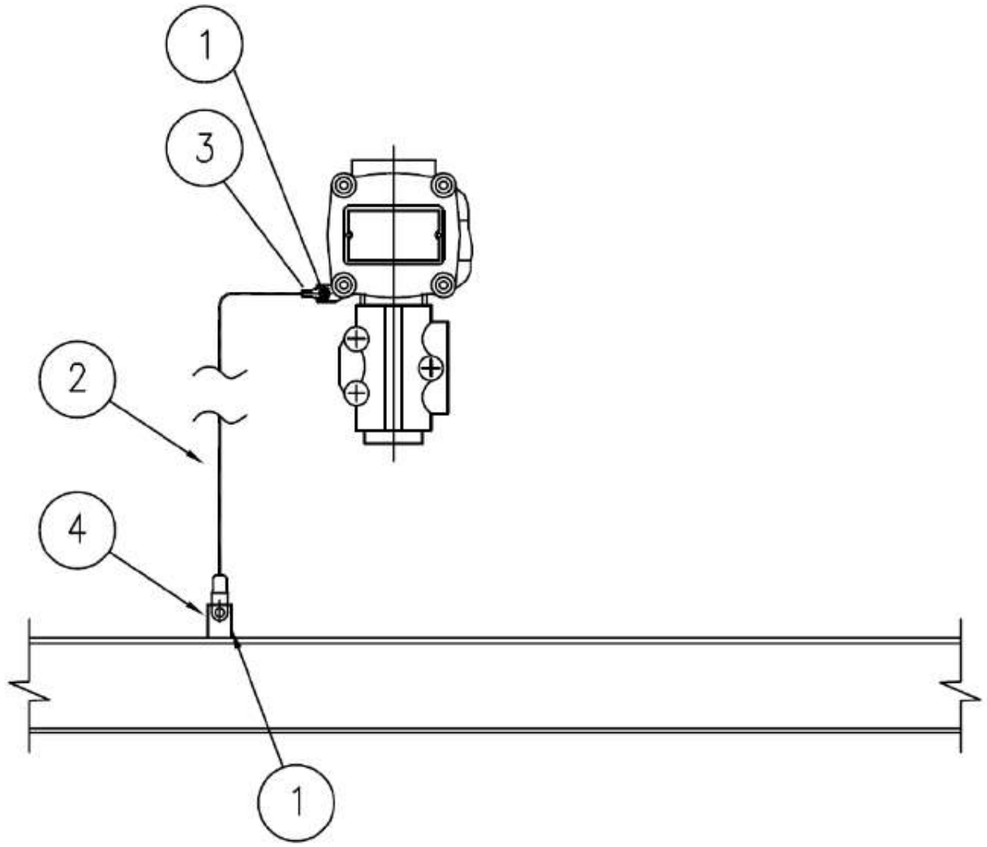

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-EL-DD-20090
REV.: 2_I | DATE: 07/11/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

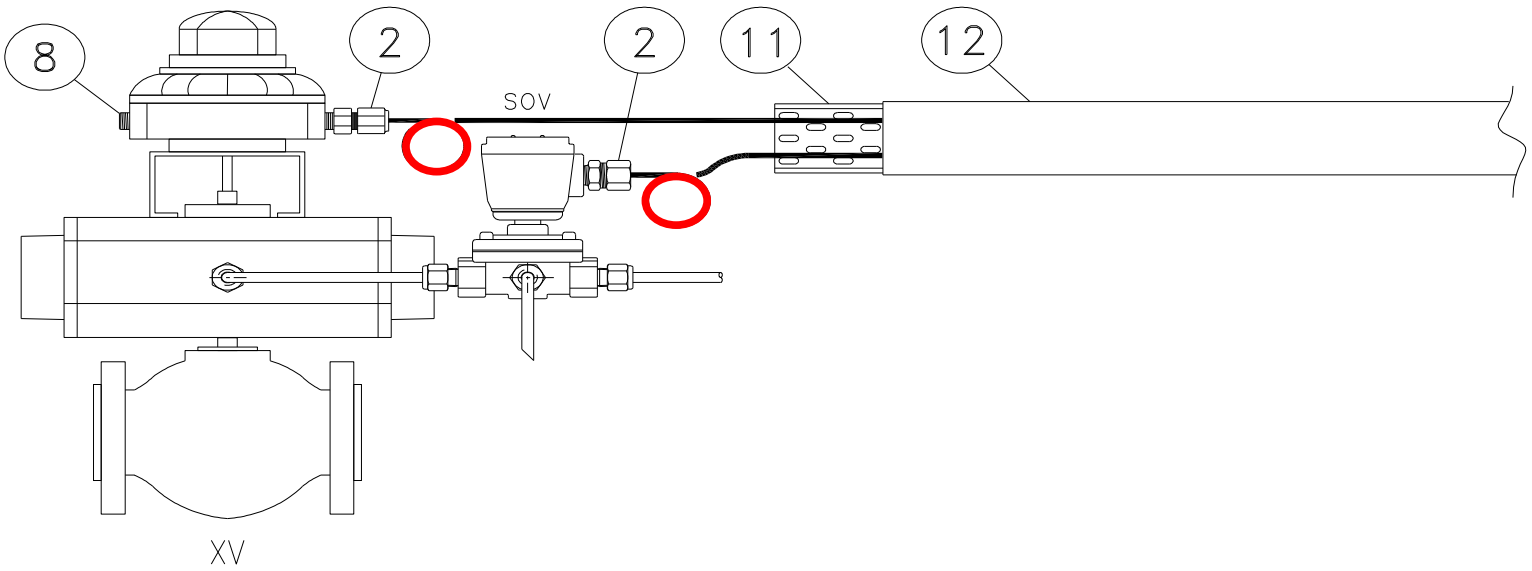

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

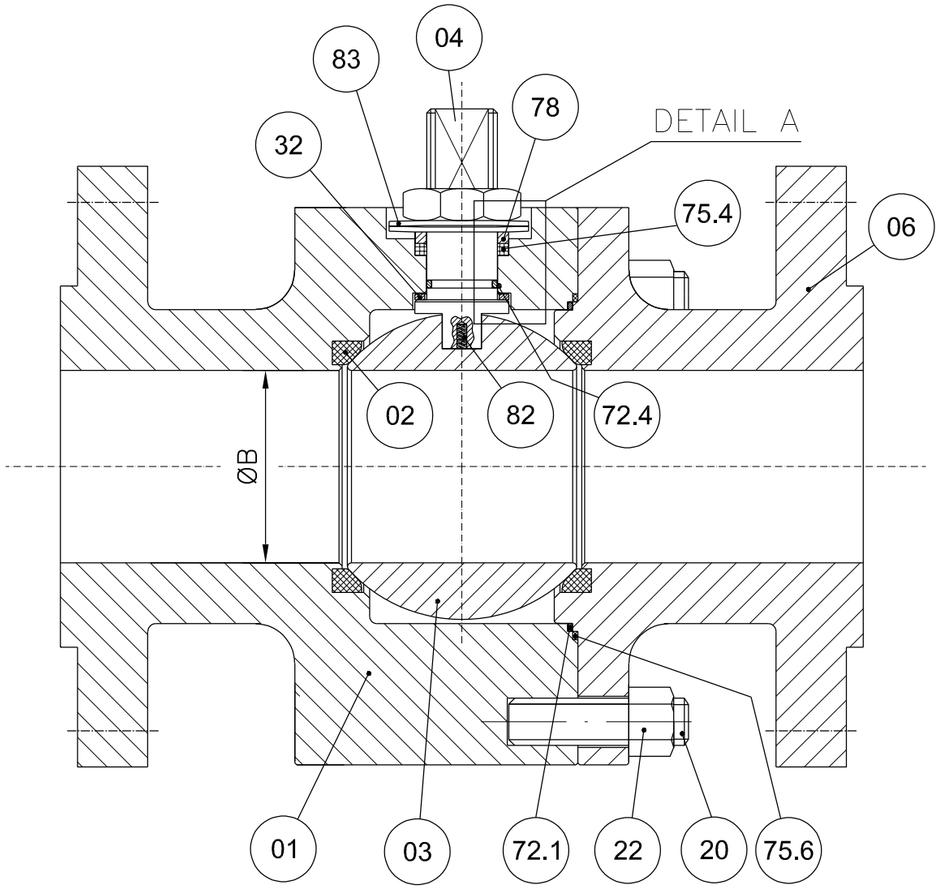

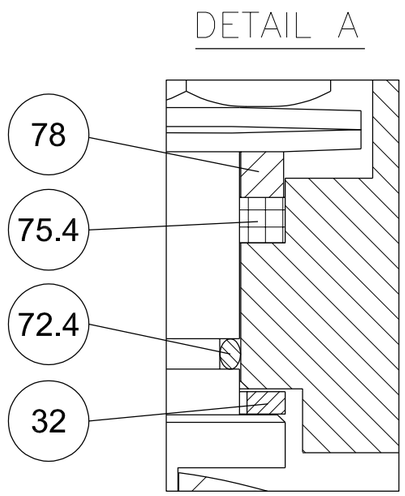


POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR	25-SDV-023	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE

1 # EU - TYPE EXAMINATION CERTIFICATE

2 **Equipment or Protective System Intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU**

3 EU - Type Examination Certificate Number: **Baseefa10ATEX0026 – Issue 15**

4 Product: **Type 27 & 77 Solenoid Operator**

5 Manufacturer: **Bifold Fluidpower Limited**

6 Address: **Chadderton, Oldham, Greater Manchester, OL9 9XA, UK**

7 This re-issued certificate extends EU Type Examination Certificate No. **Baseefa10ATEX0026** to apply to product designed and constructed in accordance with the specification set out in the Schedule of the said certificate but having any variations specified in the Schedule attached to this certificate and the documents therein referred to.

8 SGS Fimko Oy, Notified Body number 0598, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this product has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II to the Directive.

8.1 The original certificate was issued by SGS Baseefa Ltd (UK Notified Body 1180). It, and any supplements previously issued by SGS Baseefa Ltd have been transferred to the supervision of SGS Fimko Oy (EU Notified Body 0598). The original certificate number is retained.

The examination and test results are recorded in confidential Report No. **See Certificate History**

9 Compliance with the Essential Health and Safety Requirements has been assured by compliance with:

EN IEC 60079-0:2018 **EN 60079-1:2014** **EN 60079-31:2014**

except in respect of those requirements listed at item 18 of the Schedule.

10 If the sign "X" is placed after the certificate number, it indicates that the product is subject to the Specific Conditions of Use specified in the schedule to this certificate.

11 This EU - TYPE EXAMINATION CERTIFICATE relates only to the design and construction of the specified product. Further requirements of the Directive apply to the manufacturing process and supply of this product. These are not covered by this certificate.

12 The marking of the product shall include the following:

Ⓔx II 2GD **Ex db IIC T6 Gb (Tamb -60°C to +40°C)***
Ex tb IIIC T85°C Db (Tamb -60°C to +40°C)* IP66/67
***alternative Temperature class/Ambient combinations may also be marked, see schedule**

SGS Fimko Oy Customer Reference No. **1688** Project File No. **22/0377**

This document is issued by the Company subject to their General Conditions for Certification Services accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx . Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained herein reflects the Company's findings at the time of their intervention only and within the limits of Client's instructions, if any. It does not necessarily indicate that the equipment may be used in particular industries or circumstances. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, schedule included, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

SGS Fimko Oy
Takomotie 8
FI-00380 Helsinki, Finland
Telephone +358 (0)9 696 361
e-mail **sgs.fimko@sgs.com**
web site **www.sgs.fi**
Business ID 0978538-5 Member of the SGS Group (SGA SA)

Mikko Välimäki
Authorised Signatory for SGS Fimko Oy

13 **Schedule**

14 **Certificate Number Baseefa10ATEX0026 – Issue 15**

15 Description of Product

The Type 77 and Type 27 Solenoid Operators are rated at up to 240Vac or dc and have a maximum power dissipation of 14W. The Type 77 Solenoid Operator comprises a stainless steel cylindrical enclosure, whereas the Type 27 comprises an aluminium cylindrical enclosure, both have a spigot cover fitted with a silicone rubber seal.

In addition to the above there is also a two winding alternative designated the 'Pulse-Pulse Solenoid operator' which has a maximum combined coil rating limited to 20.5W.

The base of the enclosure is fitted with an adaptor bush which incorporates venting holes to allow the unit to be fitted onto a valve assembly rated up to a maximum pneumatic pressure of 10 bar. For hydraulic valves and valves with pneumatic pressures greater than 10 bar the top of the valve is provided with additional venting holes.

Internally the unit is fitted with a coil holder, coil and armature onto which is mounted an adjusting rod which forms a cylindrical joint with the adaptor bush and operates the valve when the solenoid is activated.

The cover may be fitted with a pushbutton or a rotary operator which can be used to operate the valve manually either momentarily or permanently.

The cover is secured using four stainless steel socket head cap screws grade of grade A4-70.

The equipment is marked:

Ex db IIC T6 Gb (Tamb -60°C to +40°C)*

Ex tb IIIC T85°C Db (Tamb -60°C to +40°C)* IP66/67

*The following alternative Temperature class/Ambient combinations may also be marked

T5/T100°C (Tamb -60°C to +55°C)

T4/T135°C (Tamb -60°C to +90°C)

An M20 or ½" NPT cable entry hole is provided as specified on the certified drawings for the accommodation of suitable IECEx Equipment (not a Component) certified cable entry device, with or without the interposition of a suitable IECEx Equipment certified (not a Component) flameproof thread adapter.

An M20 cable entry is provided unless the marking 'K85' appears in the Model No. marked on the label, in which case a ½" NPT cable entry hole is provided.

16 Report Number

See Certificate History

17 Specific Conditions of Use

None

18 Essential Health and Safety Requirements

In addition to the Essential Health and Safety Requirements (EHSRs) covered by the standards listed at item 9, the following are considered relevant to this product:

Clause	Subject
1.4.1	External effects
1.4.2	Aggressive substances etc.

19 Drawings and Documents

New drawings submitted for this issue of certificate:

Number	Issue	Date	Description
0-SL0070	0	2022.06.30	TYPE 27 & 77 SOLENOID LABEL - ROTORK BRAND - L240

Current drawings which remain unaffected by this issue:

Number	Issue	Date	Description
0-SC0004	1	09.07.20	Solenoid Lid Options G.A
0-SC0006	0	17.04.09	Latched Energised and Tamperproof Solenoid Options
0-SC0008	1	29.03.11	Override Cover Assembly
0-SC0009	0	12.02.15	Serial Numbers IIB, Type 77
**0-GA0870	0	07.11.17	General Arrangement L209 Variant – Fixed Head Operator
0-SC0003	11	20.09.21	Type 27 and 77 Solenoid Operator
0-SC0007	5	24.11.21	Sol. Operator Pulse-Pulse.
0-SL0056	4	13.01.22	Type 27 & 77 Solenoid housing label Ex d
0-SL0058	5	2022.02.07	Type 27 & 77 Solenoid housing label Ex d
0-SL0068	0	2022.01.17	Label Type 27 and 77 Solenoid Operator

**This drawing is common to this certificate and BAS02ATEX2048, BAS21UKEX0642 and is held with IECEx BAS 10.0008.

20 Certificate History

Certificate No.	Date	Comments
Baseefa10ATEX0026	20 April 2010	The release of the prime certificate. The associated test and assessment against the requirements of EN 60079-0: 2006, EN 60079-1: 2007, EN 61241-0: 2004 and EN 61241-1: 2004 is documented in Test Report No. GB/BAS/ExTR10.0014/00.
Baseefa10ATEX0026/1	7 April 2011	Amendment to the diametral tolerance for the adjusting rod. Omission of drawing 0-SC0001 (previously submitted in error). Alternative design of pushbutton override cover assembly. Minor drawing variations. Documented in Test Report No. GB/BAS/ExTR11.0084/00
Baseefa10ATEX0026/2	8 July 2011	Alternative internal design to form the Pulse-Pulse Solenoid Operator. This unit has two windings with a combined rating of 20.5W. Amended designation for the solenoid housing material. Documented in Test Report No. GB/BAS/ExTR11.0123/00
Baseefa10ATEX0026/3	2 April 2012	Alternative label design incorporating the complete range of temperature class and ambient temperature markings provided for by this certificate. Documented in Test Report No. GB/BAS/ExTR12.0086/00

Certificate No.	Date	Comments
Baseefa10ATEX0026/4	2 December 2013	A re-designation of the Type FP Solenoid Operator, to the Type 77 Solenoid Operator. A satisfactory assessment against the requirements of the updated standards IEC 60079-0: 2011 and IEC 60079-31: 2008 (superseding IEC 61241), complete with a review of the marking. Introduction of an alternative aluminium housing and cover material. Documented in Test Report No. GB/BAS/ExTR13.0291/00
Baseefa10ATEX0026/5	29 July 2014	This issue permits existing information (for example on Schedule Drawings) to be replaced by the revised certificate holders address. No other changes may be made to the certified design. Documented in Test Report No. None.
Baseefa10ATEX0026/6	17 February 2015	Clarification of the Type name. The Type 77 comprises a stainless steel housing and the Type 27 comprises an aluminium housing. To allow the introduction of alternative seal materials. To allow the Type 77 Solenoid Operators having Serial numbers as defined in drawing number 0-SC0009 to be marked with Ex d IIB T6 Gb. Documented in Test Report No. GB/BAS/ExTR14.0317/00
Baseefa10ATEX0026/7	23 June 2016	Minor drawing changes not affecting certification. Documented in Test Report No. GB/BAS/ExTR16.0164/00
Baseefa10ATEX0026/8	16 March 2017	To allow the introduction of an alternative low power circuit. To allow for correction of the Type designation listed on the EU-Type Examination Certificate Baseefa10ATEX0026 To allow for correction of description to include the Pulse Pulse Unit. Documented in Test Report No. GB/BAS/ExTR17.0076/00
Baseefa10ATEX0026/9	20 July 2017	To allow the introduction of an alternative low power circuit. Documented in Test Report No. GB/BAS/ExTR17.0211/00
Baseefa10ATEX0026/10	3 January 2018	To introduce an alternative non-rotational mounting arrangement to attach the adaptor bushing via the coil holder to the enclosure housing. Identification of threaded entry holes on the enclosure wall. Documented in Test Report No. GB/BAS/ExTR17.0274/00
Baseefa10ATEX0026/11	7 March 2018	To introduce alternative terminal plate with a different grounding point design. To introduce optional certification marks in addition to the existing one to be included on to the certification label marking. Documented in Test Report No. GB/BAS/ExTR 18.0041/00
Baseefa10ATEX0026/12	12 July 2019	To assess the Type 27 and 77 Solenoid Operator against the standards EN IEC 60079-0:2018, EN 60079-1:2014 and EN 60079-31:2014 To permit minor drawing changes to the certification label that do not affect certification Documented in Test Report No. GB/BAS/ExTR19.0100/00

Certificate No.	Date	Comments
Baseefa10ATEX0026/13	14 July 2020	To introduce an alternative Detented Manual Over-Ride Lid (alternative spigoted cover), which allows the valve to be operated manually. Documented in Test Report No. GB/BAS/ExTR19.0341/00.
Baseefa10ATEX0026 – issue 14	11 February 2022	This issue of the certificate incorporates previously issued primary & supplementary certificates. To remove drawings 138-10, 138-10-K85, 0-S0252 and 0-S0254 transferring critical details to drawing 0-SC0003 revision 11. To remove drawing 0-SC0001. To add drawing 0-SL0068. To add an alternative encapsulant. To update the nameplate drawings to include UKEX details. Documented in Test Report No. GB/BAS/ExTR21.0158/00
Baseefa10ATEX0026 – issue 15	2 November 2022	This issue of the certificate incorporates previously issued primary & supplementary certificates. To add an alternative marking drawing with a different manufacturer branding. The assessment is documented in test report GB/BAS/ExTR22.0138/00
For drawings applicable to each issue, see original of that issue.		

GENERAL	1	Tag Number	Location			25-XV-004		25
	2	Service				HYDROGEN STORAGE TANK V-25001A INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80015		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-015-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close : (12)		Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum		Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-004 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-004 (9, 17) - Soldo SS		25-ZSH-004 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND


ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

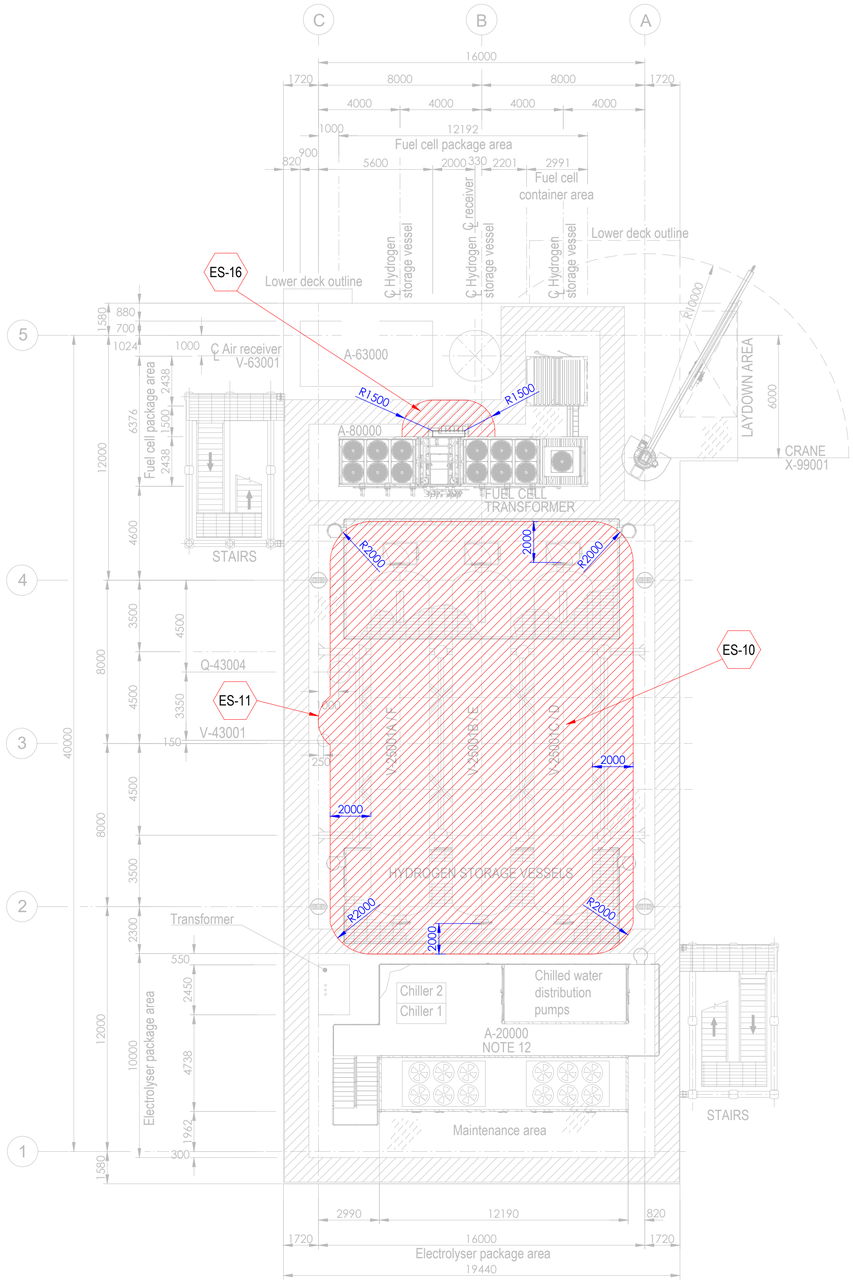


PLAN ON UPPER DECK
EL+30.310 T.O.S.

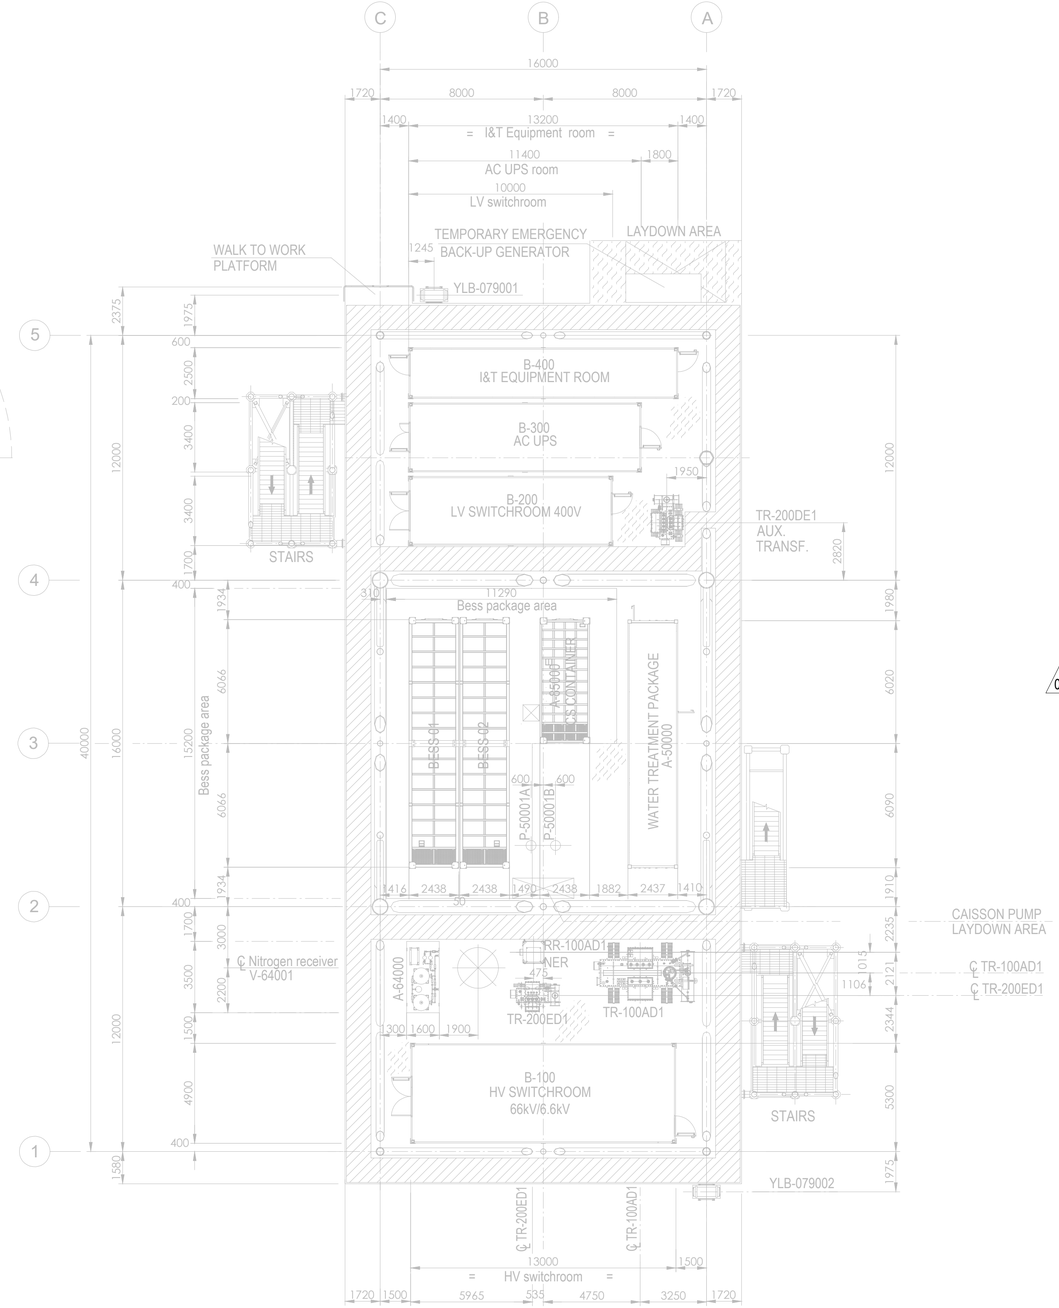

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

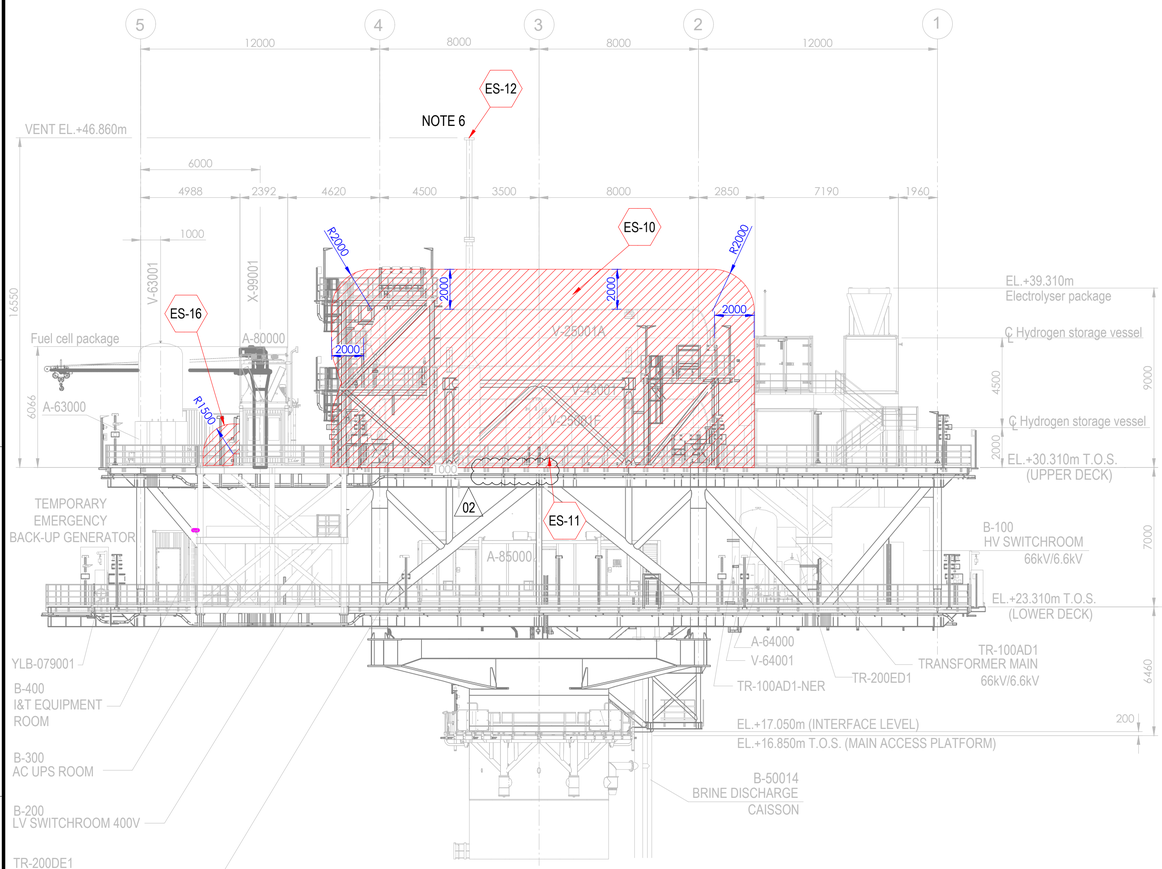



ELEVATION LOOKING EAST

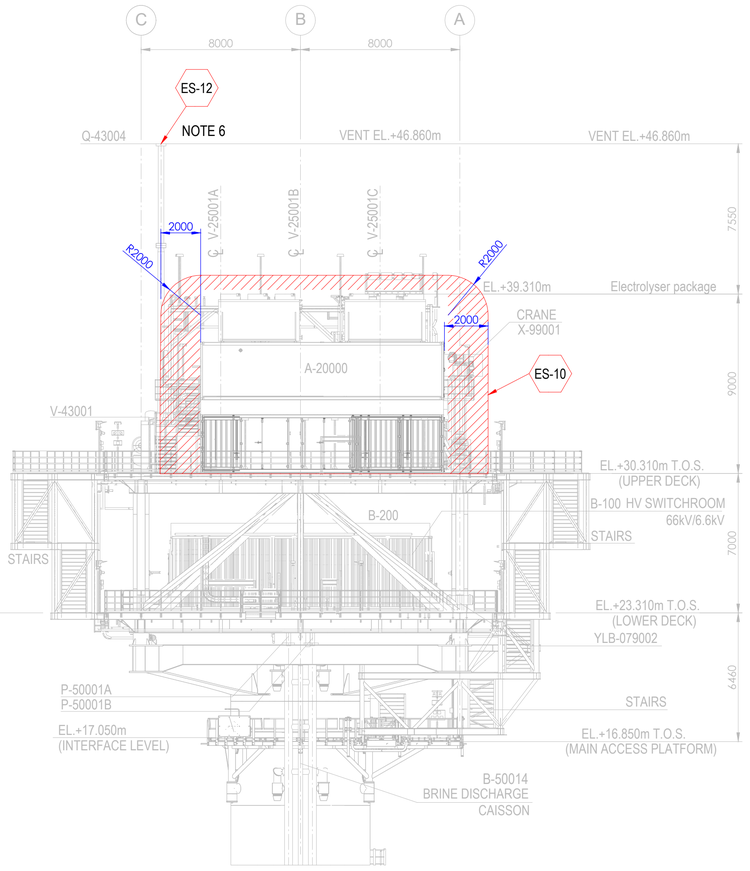

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

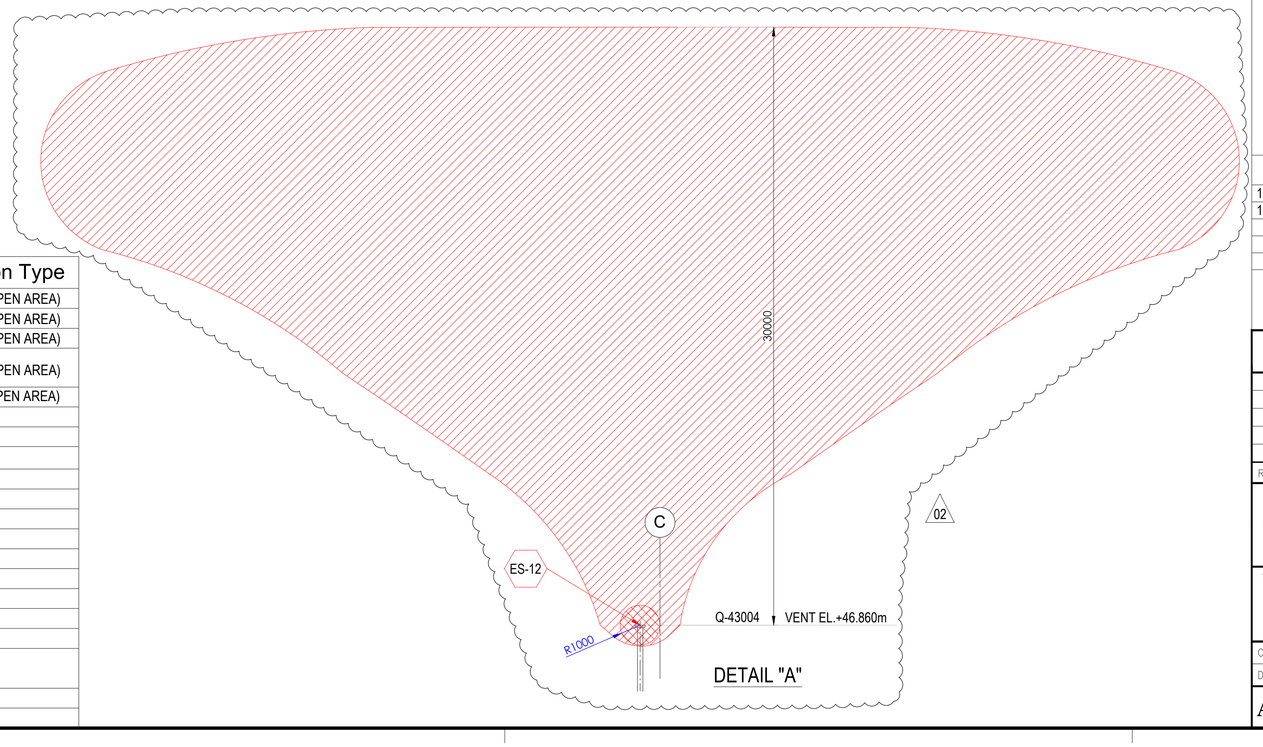



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-XY-008	: Solenoid Valve - Vessel V-25001B Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001716	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**	FL18524-8791				
Manufacturer	BIFOLD			**Model**	FP06P-77A				
Cert No.	Baseefa10ATEX0026			**Equipment Ambient Temp.**	-60°C to +40°C				
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66/67

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	PL	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	OK	

ITEM	Tag	25-XY-008	: Solenoid Valve - Vessel V-25001B Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001716		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	OK	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-XY-008	: Solenoid Valve - Vessel V-25001B Hydrogen Inlet		Dwg	123A90-DDL-PR-PID-80016	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001716	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-28	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-28T07:49:12.214Z	PROVERLIS Digitaly signed by Alessio Polo 2025-01-29T11:21:40.214Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

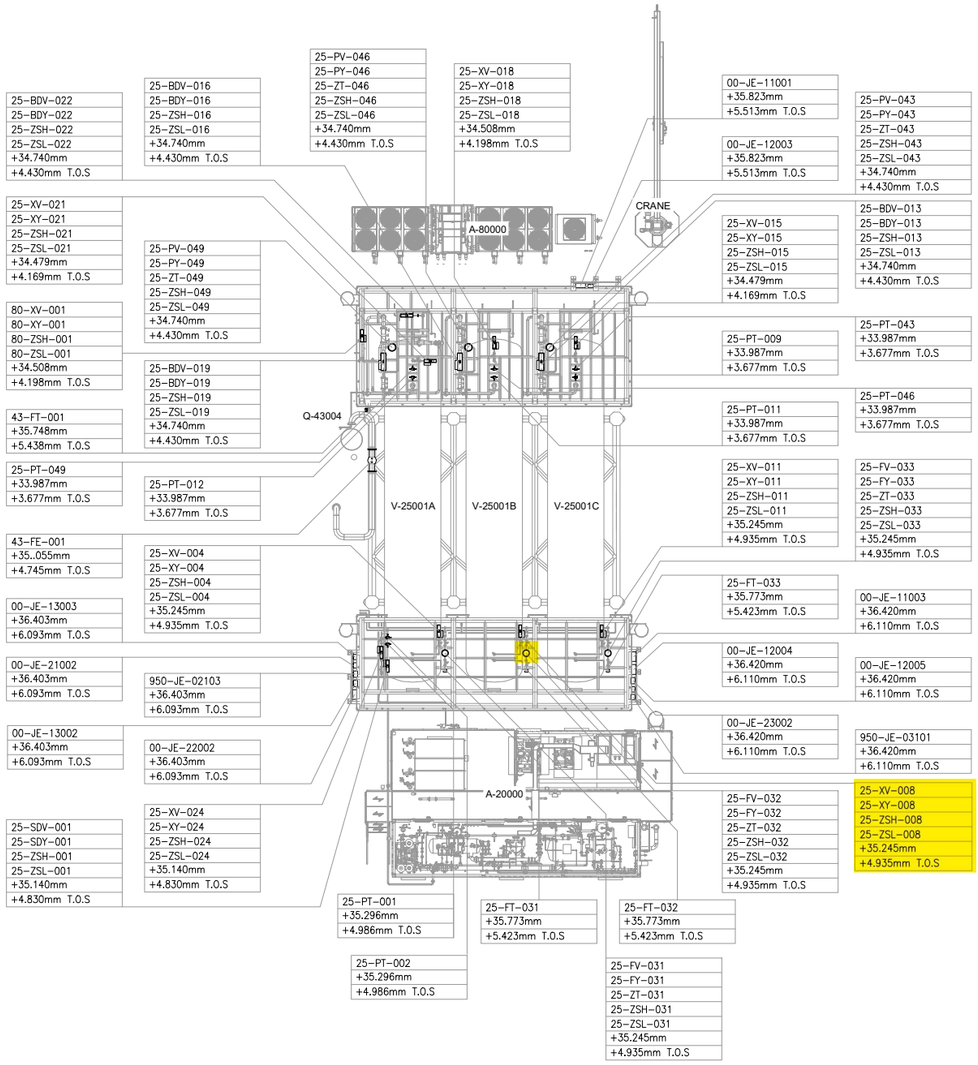

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90–DDL–IN–DL–40081	002	02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 B

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

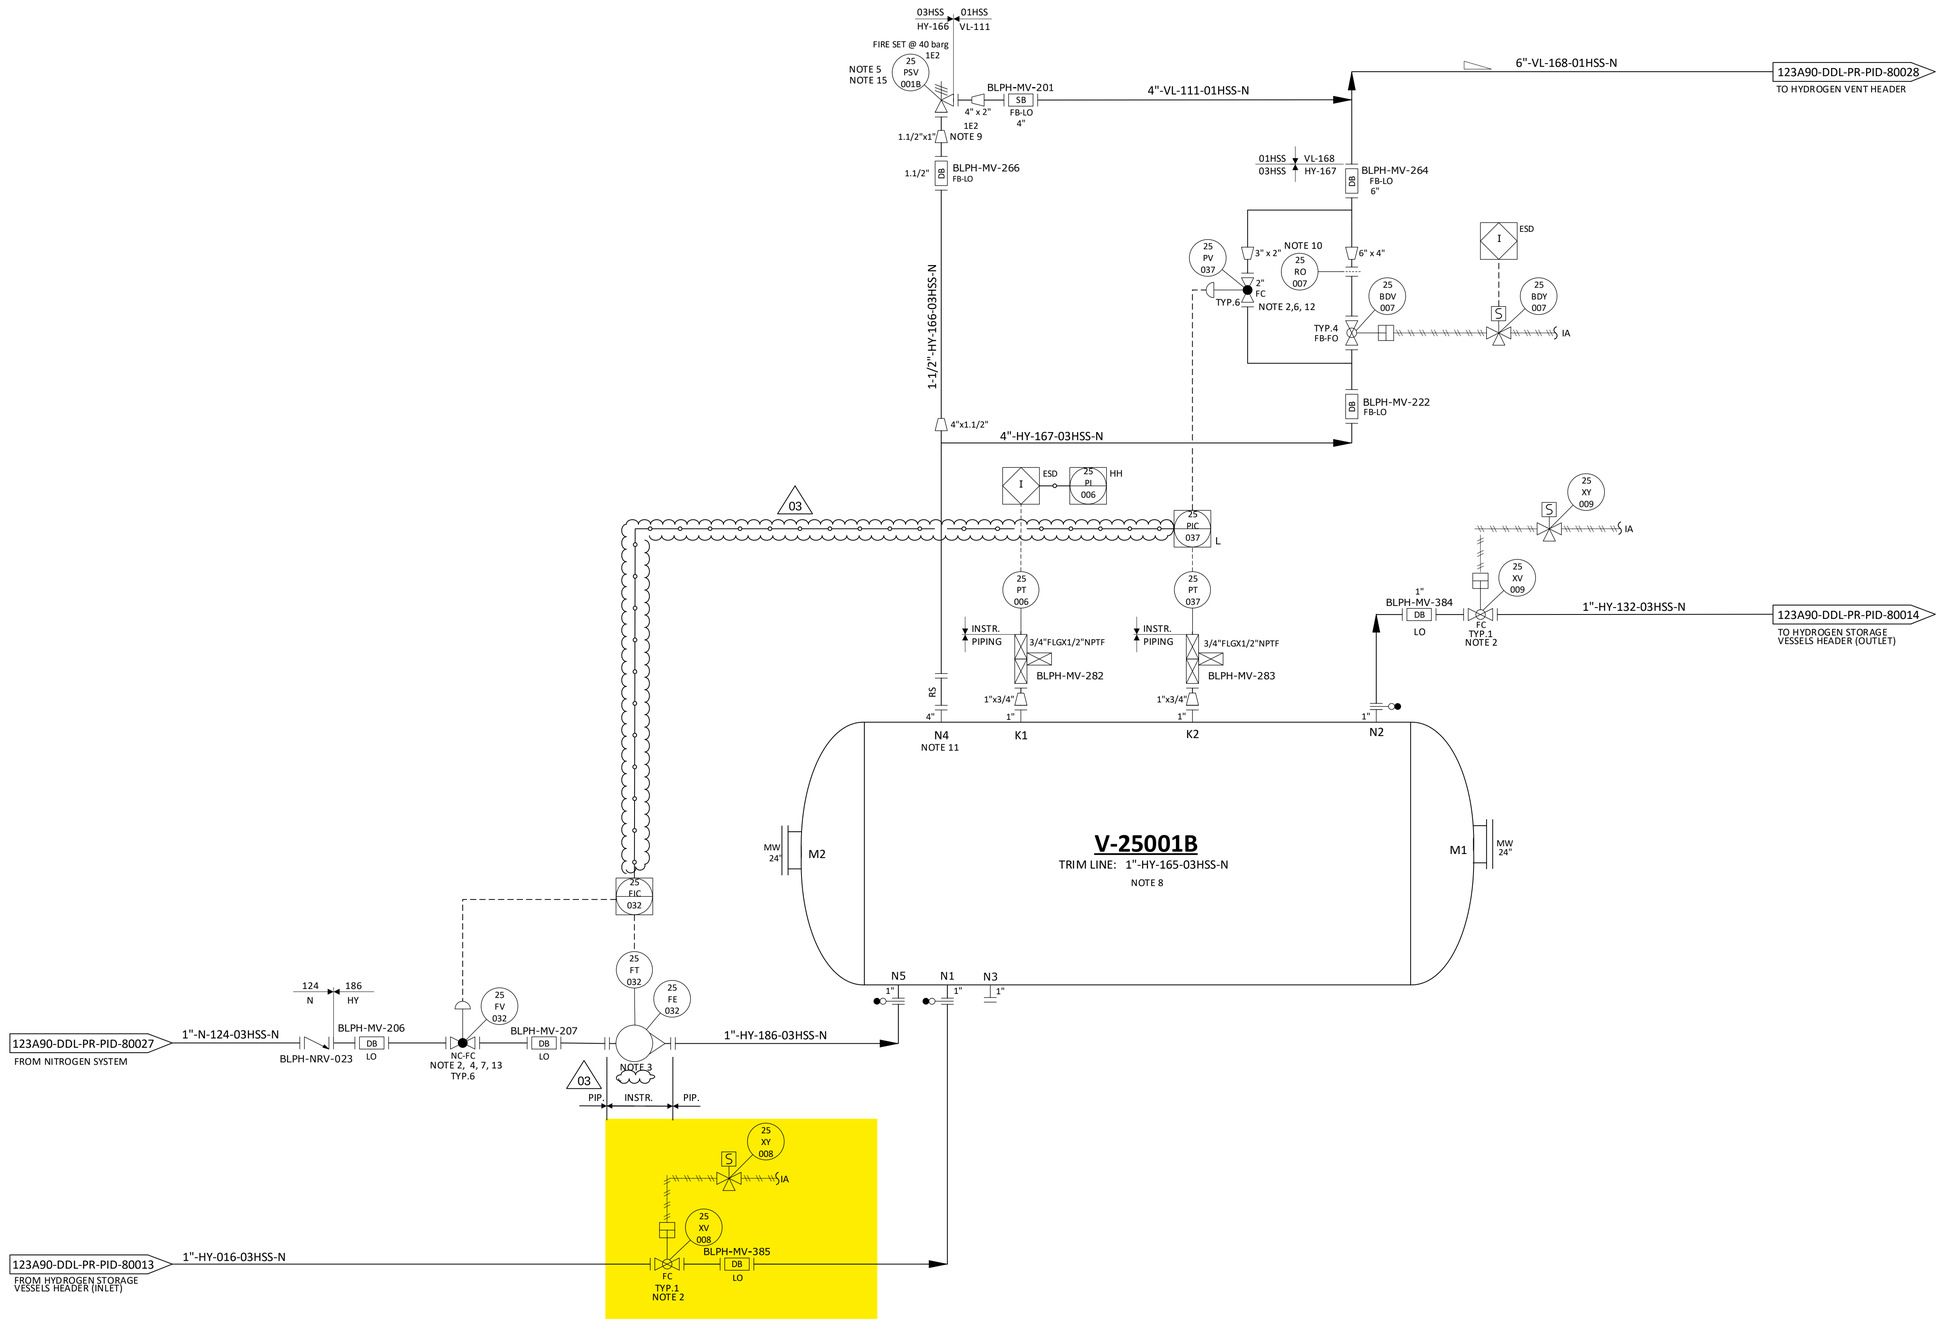

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-032) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. (03)
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-037 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC."PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-037 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. (03)
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-032 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-037 HAS FAILED TO CLOSE.
15. 25-PSV-001B SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL B

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80016	SHEET 001	REV. 03


File Name : FILE_NAME

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-13002	No.	MARSHALLING CABINET B400-PCS-002

<01>

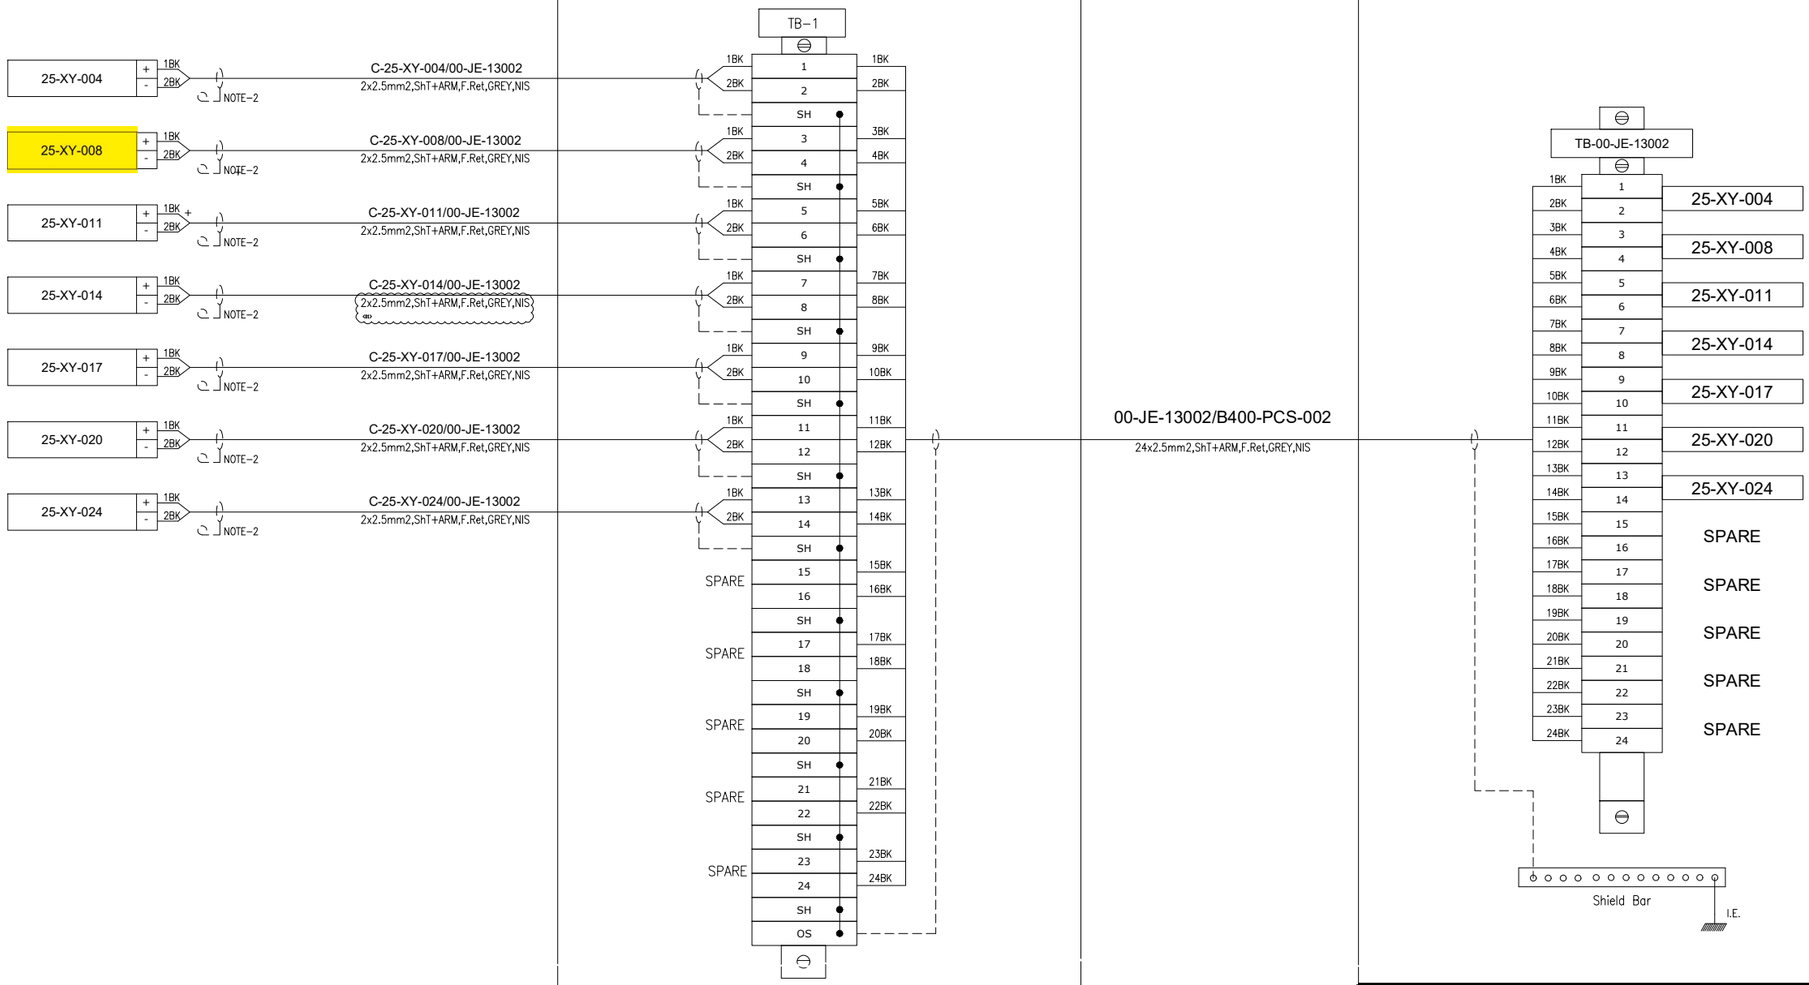

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-13002

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 029	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

E33

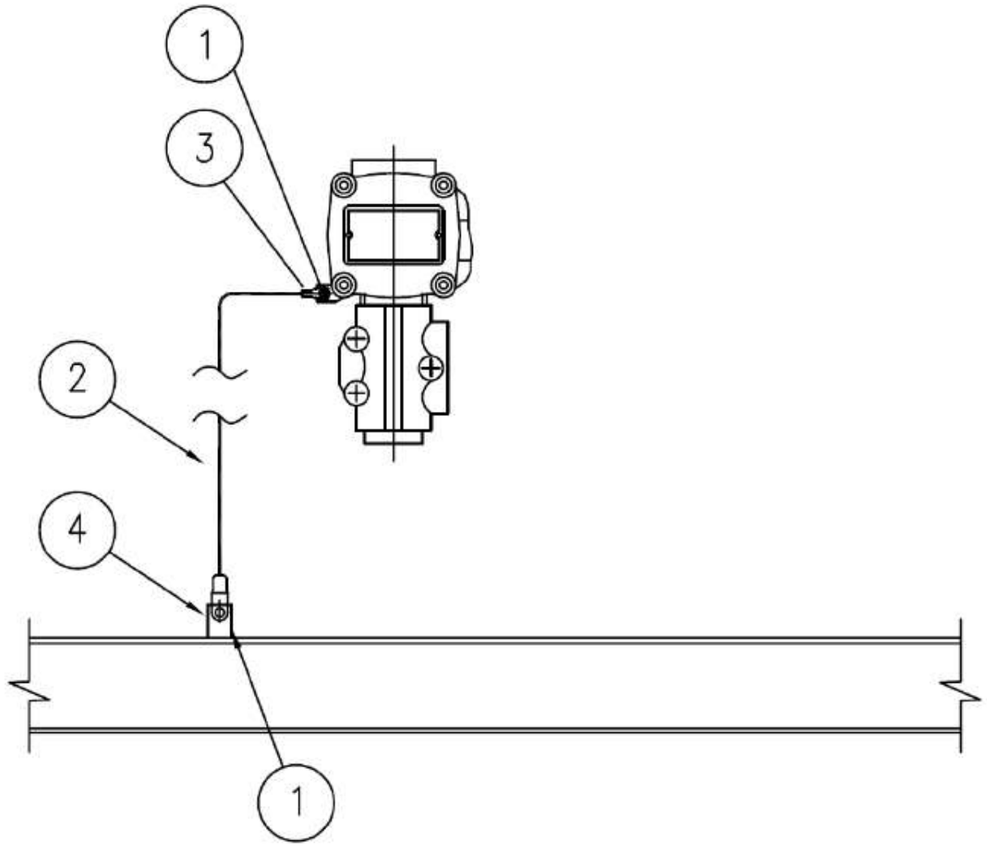

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

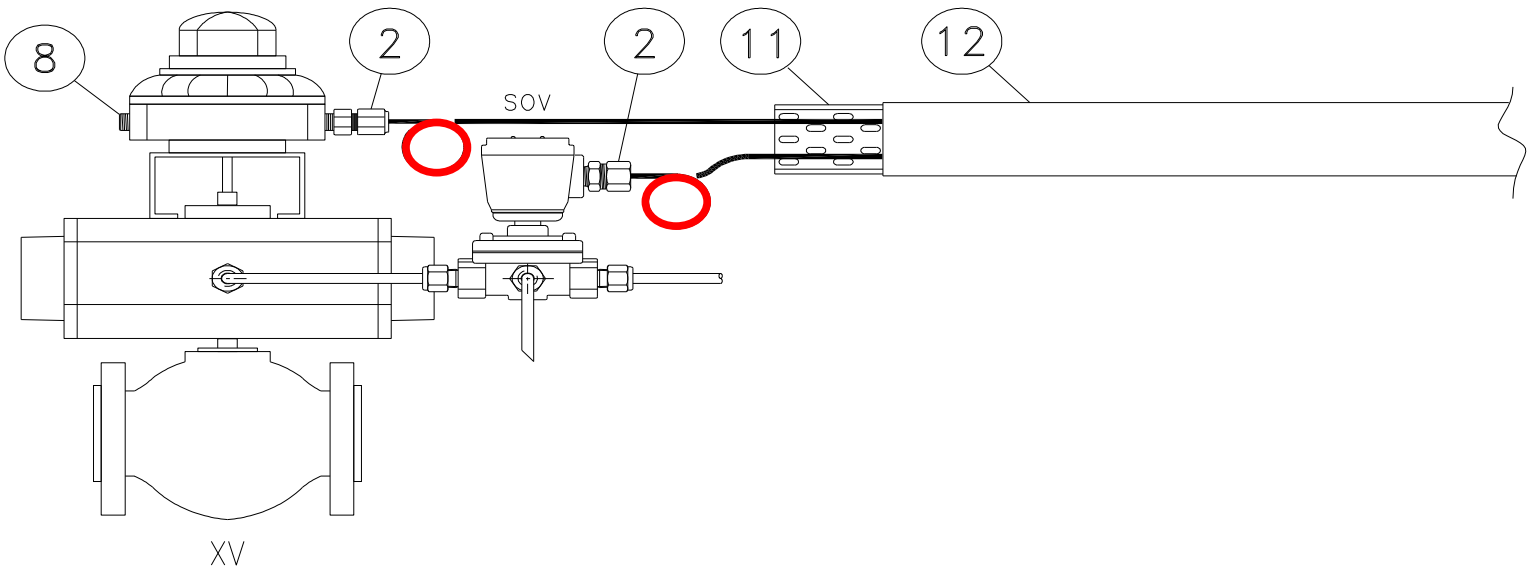

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

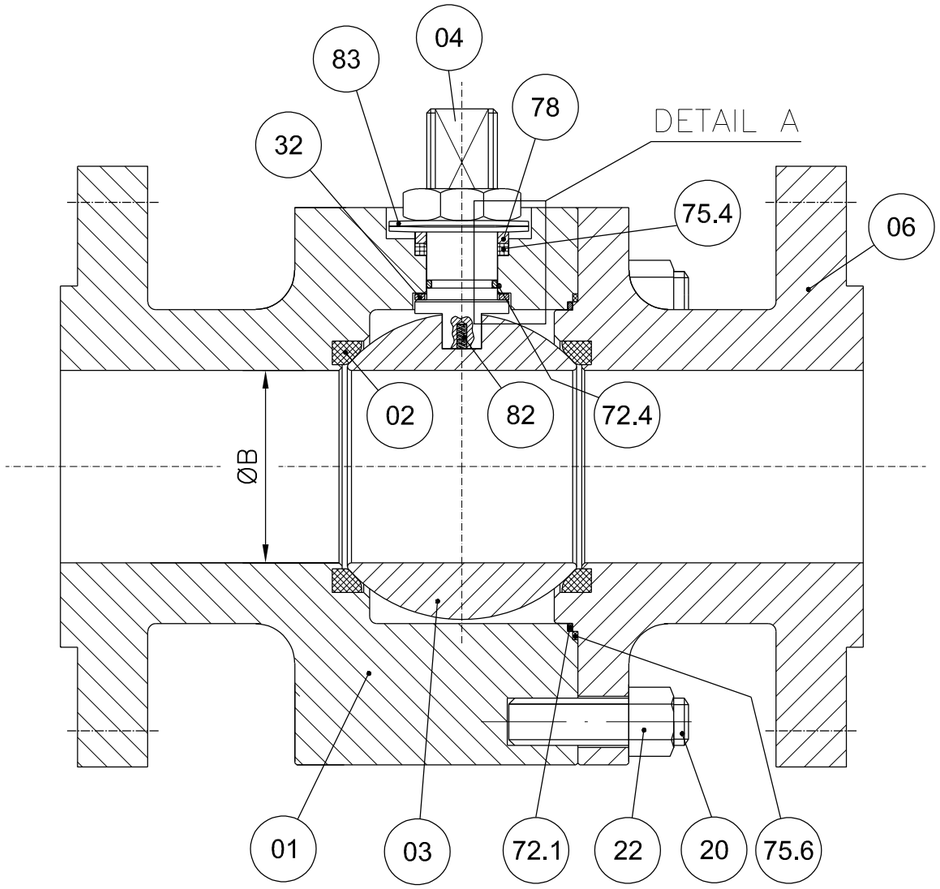

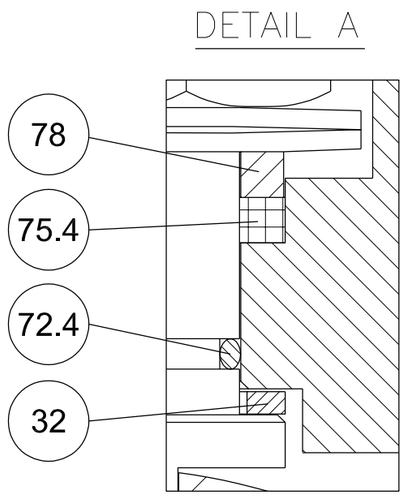


POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: D240062-08 | Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-008	25	
	2	Service				HYDROGEN STORAGE TANK V-25001B INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80016	Zone 2, Gas Group IIC (or IIB+H2), Class T1	
PIPELINE	4	Line Number				1"-HY-016-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm	1" / 3.38 mm	
	6	Line Material	Line Insulation			ASTM A312/TP316/316L	NOT INSUL. (PAINTED) (35)	
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS	GAS	
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29	80	
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close : (12)	Open : (12)	
	17	Operation (seconds)	Actual			Close : 0.3 minimum	Open : -	
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"	FULL BORE	
	22	Body Material	Bonnet Type			ASTM A182 F316/316L	(*)	
	23	Connections	Rating			FLANGED ASME B16.5	#300	
	24	Flange Finish	Gasket Material			RF	Inside the valve (*) (38)	
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)	(*)	
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork	Spring Return	
	31	Model No.	Size			CP/S	035-100A/BA	
	32	Actuator Orientation	Actuator Form			Horizontal	Cylinder	
	33	Ingress Protection	Certification			IP-66	II 2 G Ex h IIC T5 Gb	
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE	CLOSE	
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-008(9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-008 (9, 17) - Soldo SS	25-ZSH-008 (9, 17) - Soldo SS	
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)	NOT REQUIRED	
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20	H	
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-	-	
	48	Check Valve	Mounting			-	-	
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR	25-SDV-023	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE

1 # EU - TYPE EXAMINATION CERTIFICATE

2 **Equipment or Protective System Intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU**

3 EU - Type Examination Certificate Number: **Baseefa10ATEX0026 – Issue 15**

4 Product: **Type 27 & 77 Solenoid Operator**

5 Manufacturer: **Bifold Fluidpower Limited**

6 Address: **Chadderton, Oldham, Greater Manchester, OL9 9XA, UK**

7 This re-issued certificate extends EU Type Examination Certificate No. **Baseefa10ATEX0026** to apply to product designed and constructed in accordance with the specification set out in the Schedule of the said certificate but having any variations specified in the Schedule attached to this certificate and the documents therein referred to.

8 SGS Fimko Oy, Notified Body number 0598, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this product has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II to the Directive.

8.1 The original certificate was issued by SGS Baseefa Ltd (UK Notified Body 1180). It, and any supplements previously issued by SGS Baseefa Ltd have been transferred to the supervision of SGS Fimko Oy (EU Notified Body 0598). The original certificate number is retained.

The examination and test results are recorded in confidential Report No. **See Certificate History**

9 Compliance with the Essential Health and Safety Requirements has been assured by compliance with:

EN IEC 60079-0:2018 **EN 60079-1:2014** **EN 60079-31:2014**

except in respect of those requirements listed at item 18 of the Schedule.

10 If the sign "X" is placed after the certificate number, it indicates that the product is subject to the Specific Conditions of Use specified in the schedule to this certificate.

11 This EU - TYPE EXAMINATION CERTIFICATE relates only to the design and construction of the specified product. Further requirements of the Directive apply to the manufacturing process and supply of this product. These are not covered by this certificate.

12 The marking of the product shall include the following:

Ⓔx II 2GD **Ex db IIC T6 Gb (Tamb -60°C to +40°C)***
Ex tb IIIC T85°C Db (Tamb -60°C to +40°C)* IP66/67
***alternative Temperature class/Ambient combinations may also be marked, see schedule**

SGS Fimko Oy Customer Reference No. **1688** Project File No. **22/0377**

This document is issued by the Company subject to their General Conditions for Certification Services accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx . Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained herein reflects the Company's findings at the time of their intervention only and within the limits of Client's instructions, if any. It does not necessarily indicate that the equipment may be used in particular industries or circumstances. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, schedule included, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

SGS Fimko Oy
Takomotie 8
FI-00380 Helsinki, Finland
Telephone +358 (0)9 696 361
e-mail **sgs.fimko@sgs.com**
web site **www.sgs.fi**
Business ID 0978538-5 Member of the SGS Group (SGA SA)

Mikko Välimäki
Authorised Signatory for SGS Fimko Oy

13 **Schedule**

14 **Certificate Number Baseefa10ATEX0026 – Issue 15**

15 Description of Product

The Type 77 and Type 27 Solenoid Operators are rated at up to 240Vac or dc and have a maximum power dissipation of 14W. The Type 77 Solenoid Operator comprises a stainless steel cylindrical enclosure, whereas the Type 27 comprises an aluminium cylindrical enclosure, both have a spigot cover fitted with a silicone rubber seal.

In addition to the above there is also a two winding alternative designated the 'Pulse-Pulse Solenoid operator' which has a maximum combined coil rating limited to 20.5W.

The base of the enclosure is fitted with an adaptor bush which incorporates venting holes to allow the unit to be fitted onto a valve assembly rated up to a maximum pneumatic pressure of 10 bar. For hydraulic valves and valves with pneumatic pressures greater than 10 bar the top of the valve is provided with additional venting holes.

Internally the unit is fitted with a coil holder, coil and armature onto which is mounted an adjusting rod which forms a cylindrical joint with the adaptor bush and operates the valve when the solenoid is activated.

The cover may be fitted with a pushbutton or a rotary operator which can be used to operate the valve manually either momentarily or permanently.

The cover is secured using four stainless steel socket head cap screws grade of grade A4-70.

The equipment is marked:

Ex db IIC T6 Gb (Tamb -60°C to +40°C)*

Ex tb IIIC T85°C Db (Tamb -60°C to +40°C)* IP66/67

*The following alternative Temperature class/Ambient combinations may also be marked

T5/T100°C (Tamb -60°C to +55°C)

T4/T135°C (Tamb -60°C to +90°C)

An M20 or ½" NPT cable entry hole is provided as specified on the certified drawings for the accommodation of suitable IECEx Equipment (not a Component) certified cable entry device, with or without the interposition of a suitable IECEx Equipment certified (not a Component) flameproof thread adapter.

An M20 cable entry is provided unless the marking 'K85' appears in the Model No. marked on the label, in which case a ½" NPT cable entry hole is provided.

16 Report Number

See Certificate History

17 Specific Conditions of Use

None

18 Essential Health and Safety Requirements

In addition to the Essential Health and Safety Requirements (EHSRs) covered by the standards listed at item 9, the following are considered relevant to this product:

Clause	Subject
1.4.1	External effects
1.4.2	Aggressive substances etc.

19 Drawings and Documents

New drawings submitted for this issue of certificate:

Number	Issue	Date	Description
0-SL0070	0	2022.06.30	TYPE 27 & 77 SOLENOID LABEL - ROTORK BRAND - L240

Current drawings which remain unaffected by this issue:

Number	Issue	Date	Description
0-SC0004	1	09.07.20	Solenoid Lid Options G.A
0-SC0006	0	17.04.09	Latched Energised and Tamperproof Solenoid Options
0-SC0008	1	29.03.11	Override Cover Assembly
0-SC0009	0	12.02.15	Serial Numbers IIB, Type 77
**0-GA0870	0	07.11.17	General Arrangement L209 Variant – Fixed Head Operator
0-SC0003	11	20.09.21	Type 27 and 77 Solenoid Operator
0-SC0007	5	24.11.21	Sol. Operator Pulse-Pulse.
0-SL0056	4	13.01.22	Type 27 & 77 Solenoid housing label Ex d
0-SL0058	5	2022.02.07	Type 27 & 77 Solenoid housing label Ex d
0-SL0068	0	2022.01.17	Label Type 27 and 77 Solenoid Operator

**This drawing is common to this certificate and BAS02ATEX2048, BAS21UKEX0642 and is held with IECEx BAS 10.0008.

20 Certificate History


Certificate No.	Date	Comments
Baseefa10ATEX0026	20 April 2010	The release of the prime certificate. The associated test and assessment against the requirements of EN 60079-0: 2006, EN 60079-1: 2007, EN 61241-0: 2004 and EN 61241-1: 2004 is documented in Test Report No. GB/BAS/ExTR10.0014/00.
Baseefa10ATEX0026/1	7 April 2011	Amendment to the diametral tolerance for the adjusting rod. Omission of drawing 0-SC0001 (previously submitted in error). Alternative design of pushbutton override cover assembly. Minor drawing variations. Documented in Test Report No. GB/BAS/ExTR11.0084/00
Baseefa10ATEX0026/2	8 July 2011	Alternative internal design to form the Pulse-Pulse Solenoid Operator. This unit has two windings with a combined rating of 20.5W. Amended designation for the solenoid housing material. Documented in Test Report No. GB/BAS/ExTR11.0123/00
Baseefa10ATEX0026/3	2 April 2012	Alternative label design incorporating the complete range of temperature class and ambient temperature markings provided for by this certificate. Documented in Test Report No. GB/BAS/ExTR12.0086/00

Certificate No.	Date	Comments
Baseefa10ATEX0026/4	2 December 2013	A re-designation of the Type FP Solenoid Operator, to the Type 77 Solenoid Operator. A satisfactory assessment against the requirements of the updated standards IEC 60079-0: 2011 and IEC 60079-31: 2008 (superseding IEC 61241), complete with a review of the marking. Introduction of an alternative aluminium housing and cover material. Documented in Test Report No. GB/BAS/ExTR13.0291/00
Baseefa10ATEX0026/5	29 July 2014	This issue permits existing information (for example on Schedule Drawings) to be replaced by the revised certificate holders address. No other changes may be made to the certified design. Documented in Test Report No. None.
Baseefa10ATEX0026/6	17 February 2015	Clarification of the Type name. The Type 77 comprises a stainless steel housing and the Type 27 comprises an aluminium housing. To allow the introduction of alternative seal materials. To allow the Type 77 Solenoid Operators having Serial numbers as defined in drawing number 0-SC0009 to be marked with Ex d IIB T6 Gb. Documented in Test Report No. GB/BAS/ExTR14.0317/00
Baseefa10ATEX0026/7	23 June 2016	Minor drawing changes not affecting certification. Documented in Test Report No. GB/BAS/ExTR16.0164/00
Baseefa10ATEX0026/8	16 March 2017	To allow the introduction of an alternative low power circuit. To allow for correction of the Type designation listed on the EU-Type Examination Certificate Baseefa10ATEX0026 To allow for correction of description to include the Pulse Pulse Unit. Documented in Test Report No. GB/BAS/ExTR17.0076/00
Baseefa10ATEX0026/9	20 July 2017	To allow the introduction of an alternative low power circuit. Documented in Test Report No. GB/BAS/ExTR17.0211/00
Baseefa10ATEX0026/10	3 January 2018	To introduce an alternative non-rotational mounting arrangement to attach the adaptor bushing via the coil holder to the enclosure housing. Identification of threaded entry holes on the enclosure wall. Documented in Test Report No. GB/BAS/ExTR17.0274/00
Baseefa10ATEX0026/11	7 March 2018	To introduce alternative terminal plate with a different grounding point design. To introduce optional certification marks in addition to the existing one to be included on to the certification label marking. Documented in Test Report No. GB/BAS/ExTR 18.0041/00
Baseefa10ATEX0026/12	12 July 2019	To assess the Type 27 and 77 Solenoid Operator against the standards EN IEC 60079-0:2018, EN 60079-1:2014 and EN 60079-31:2014 To permit minor drawing changes to the certification label that do not affect certification Documented in Test Report No. GB/BAS/ExTR19.0100/00


Certificate No.	Date	Comments
Baseefa10ATEX0026/13	14 July 2020	To introduce an alternative Detented Manual Over-Ride Lid (alternative spigoted cover), which allows the valve to be operated manually. Documented in Test Report No. GB/BAS/ExTR19.0341/00.
Baseefa10ATEX0026 – issue 14	11 February 2022	This issue of the certificate incorporates previously issued primary & supplementary certificates. To remove drawings 138-10, 138-10-K85, 0-S0252 and 0-S0254 transferring critical details to drawing 0-SC0003 revision 11. To remove drawing 0-SC0001. To add drawing 0-SL0068. To add an alternative encapsulant. To update the nameplate drawings to include UKEX details. Documented in Test Report No. GB/BAS/ExTR21.0158/00
Baseefa10ATEX0026 – issue 15	2 November 2022	This issue of the certificate incorporates previously issued primary & supplementary certificates. To add an alternative marking drawing with a different manufacturer branding. The assessment is documented in test report GB/BAS/ExTR22.0138/00
For drawings applicable to each issue, see original of that issue.		

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

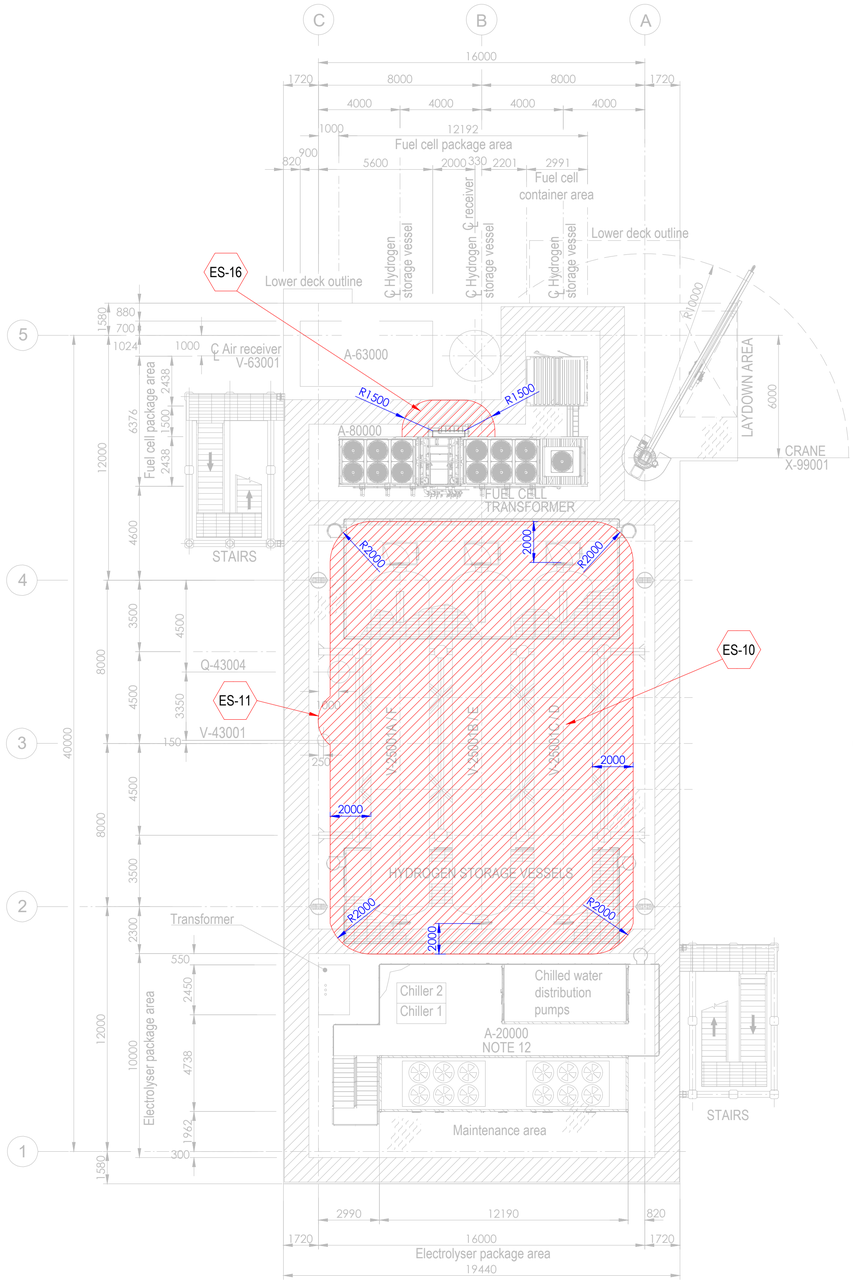


PLAN ON UPPER DECK
EL+30.310 T.O.S.

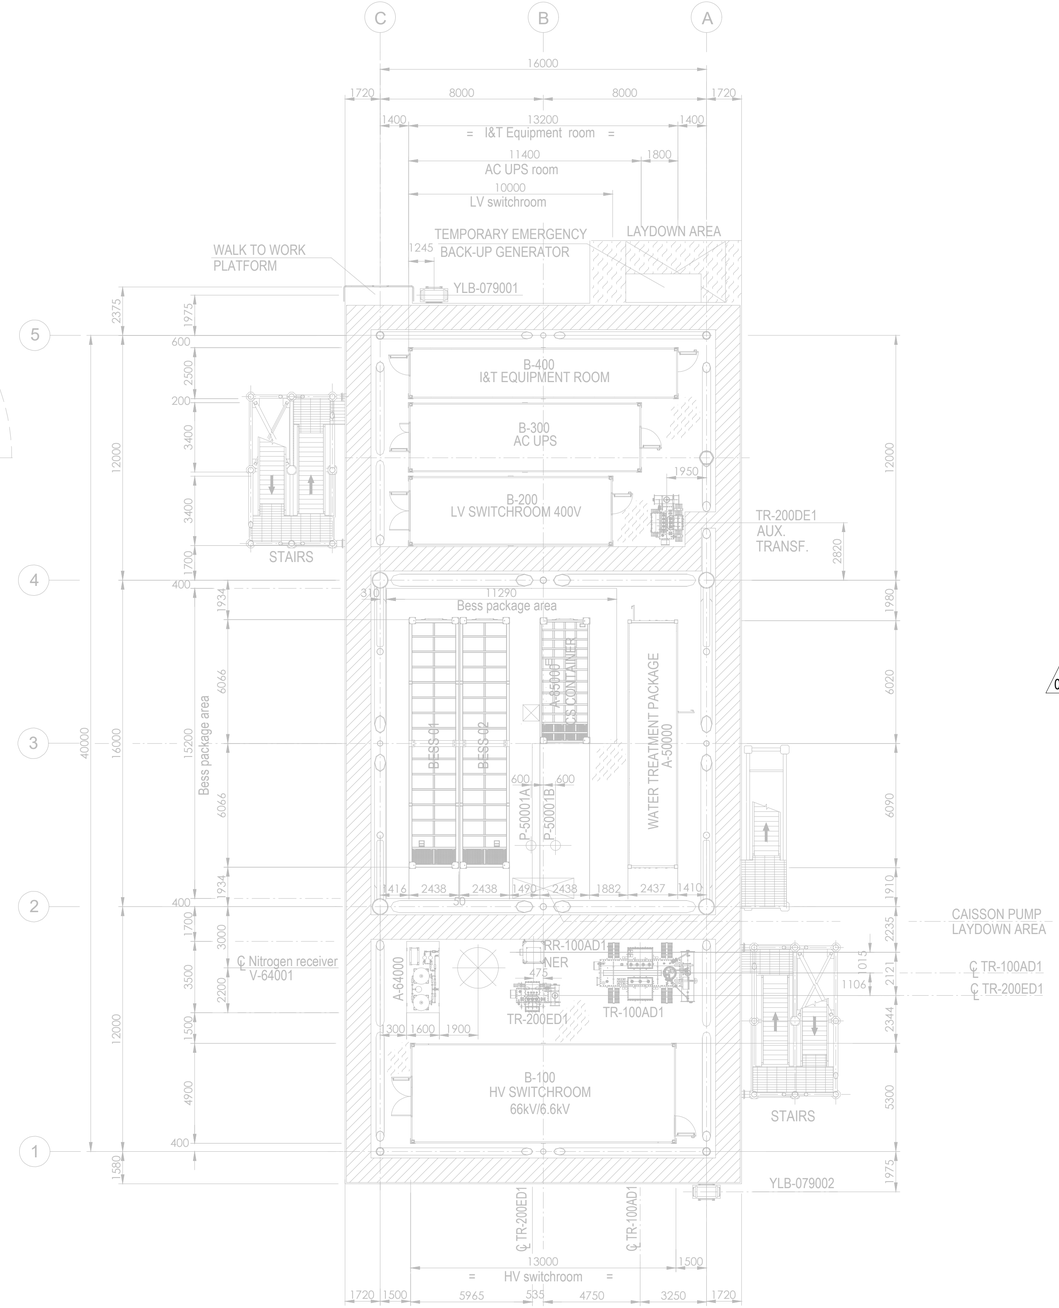

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

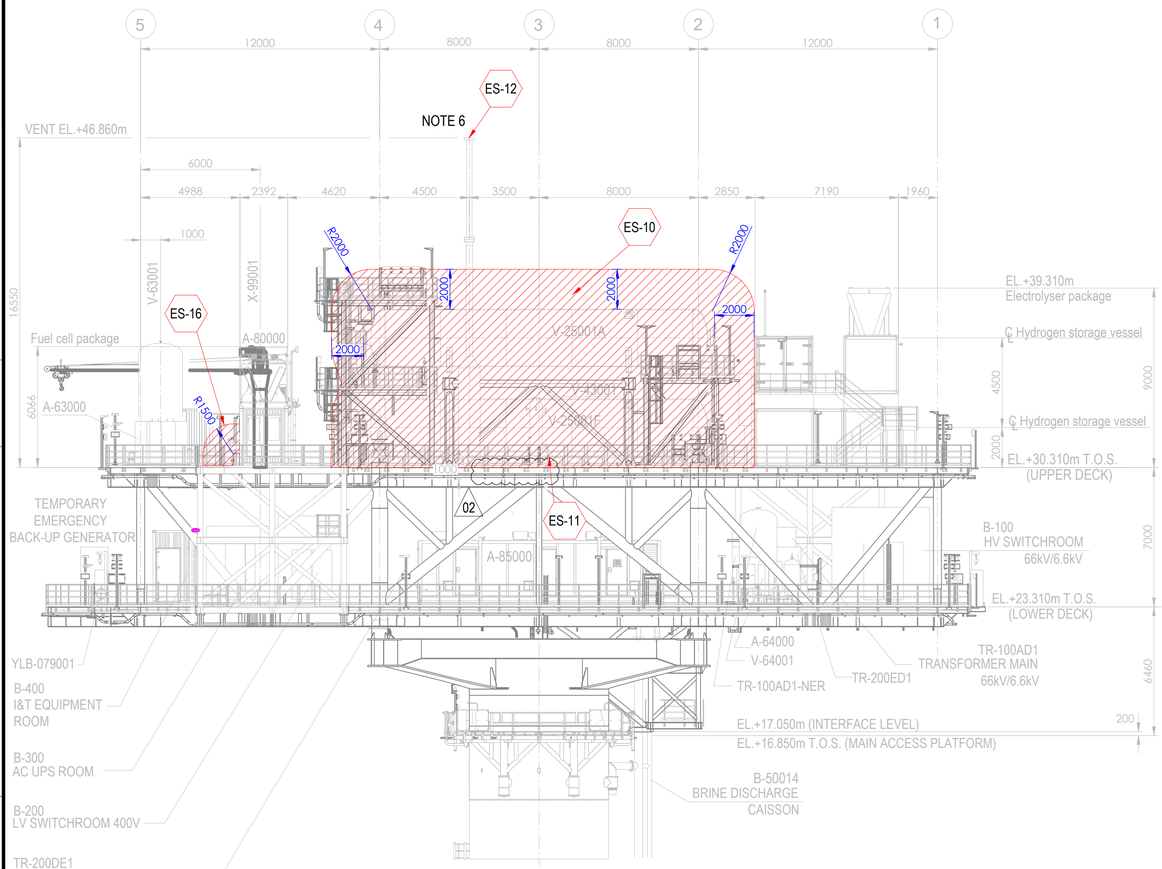



ELEVATION LOOKING EAST

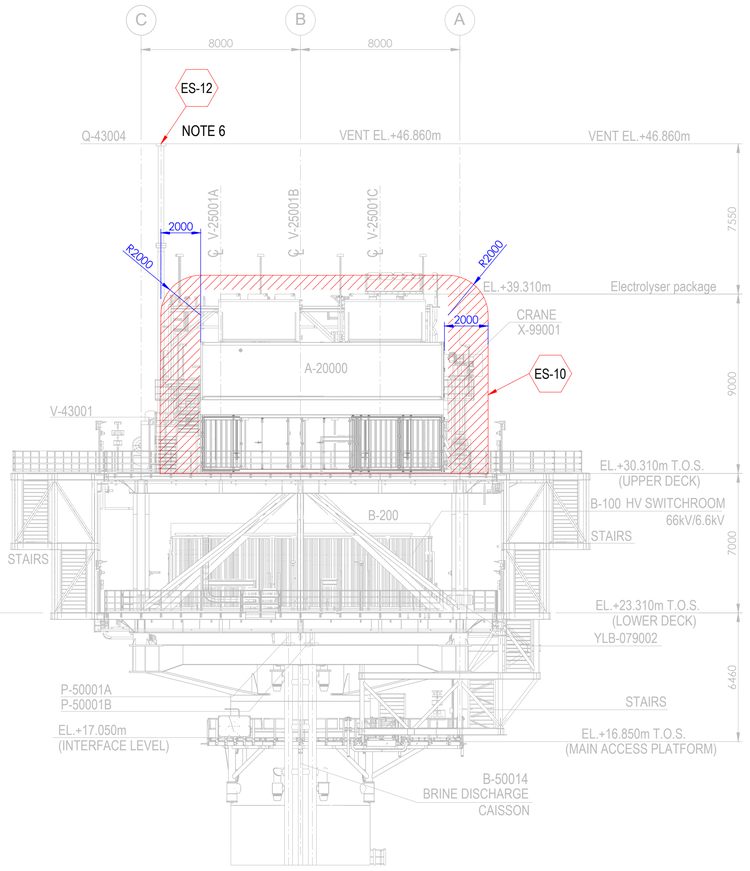

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

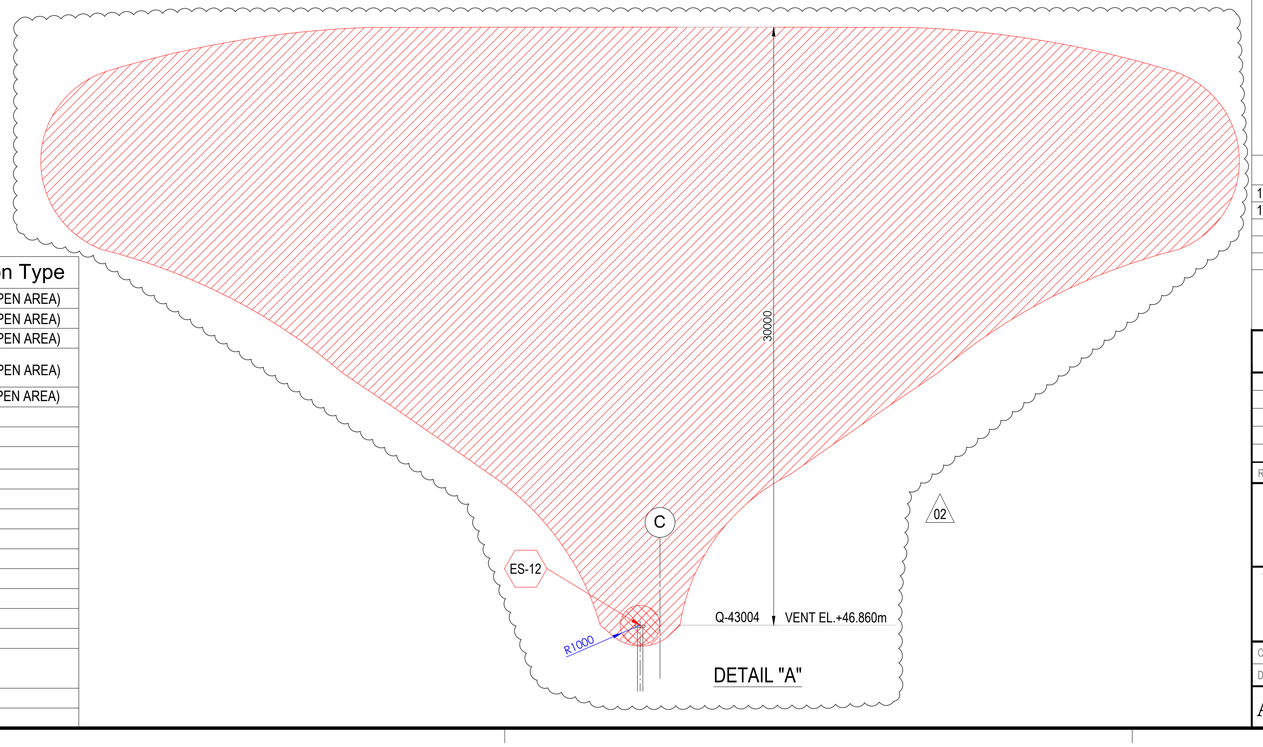



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-XY-011	: Solenoid Valve - Vessel V-25001C Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80017
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001718	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**	FL10424-8688				
Manufacturer	BIFOLD			**Model**	FP06P-77A				
Cert No.	Baseefa10ATEX0026			**Equipment Ambient Temp.**	-60°C to +40°C				
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66/67

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	PL	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	OK	

ITEM	Tag	25-XY-011	: Solenoid Valve - Vessel V-25001C Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80017
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001718		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-XY-011	: Solenoid Valve - Vessel V-25001C Hydrogen Inlet		Dwg	123A90-DDL-PR-PID-80017	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001718	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-02-05	2025-02-05	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-02-05T15:56:24.235Z	PROVERLIS Digitaly signed by Alessio Polo 2025-02-05T16:24:36.244Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

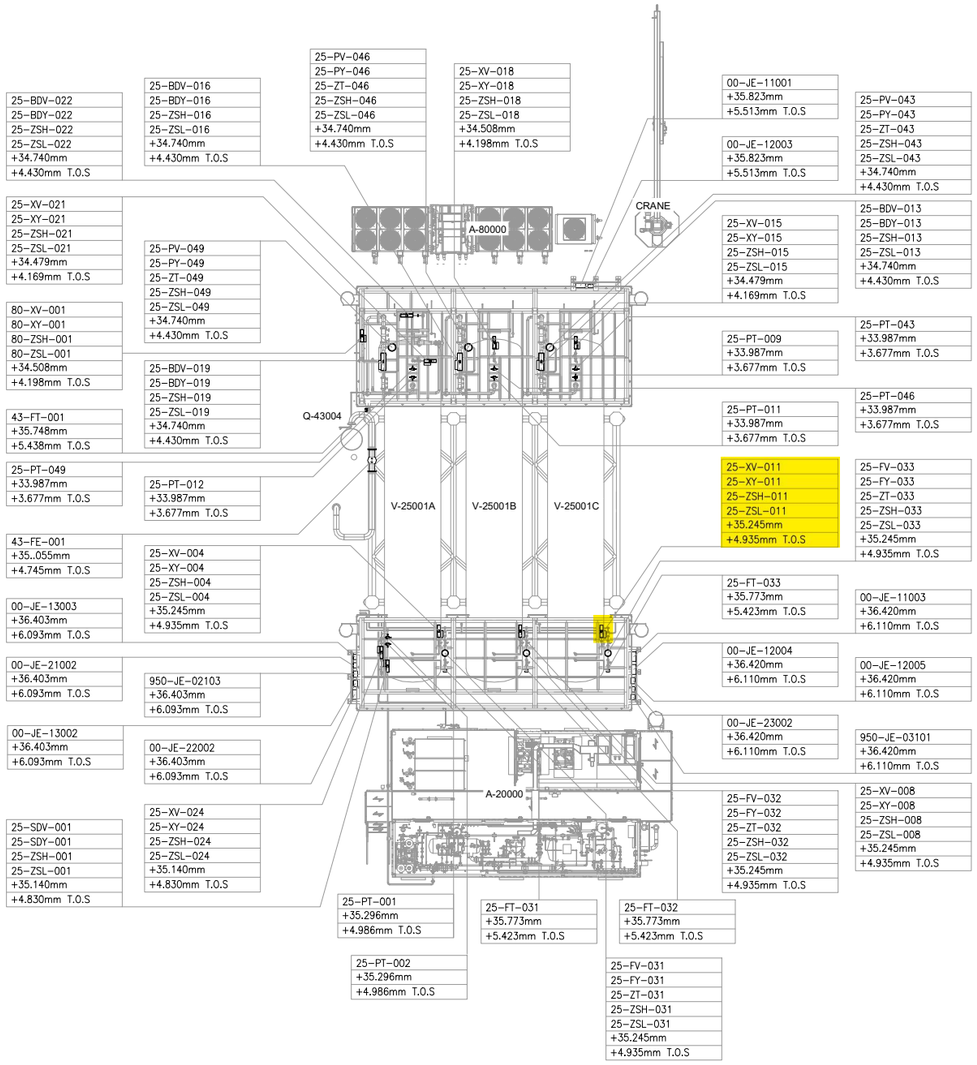

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081
REV.: 2_A | DATE: 07/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING_NO. DRAWING_NO.

REV. REV

V-25001_C

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

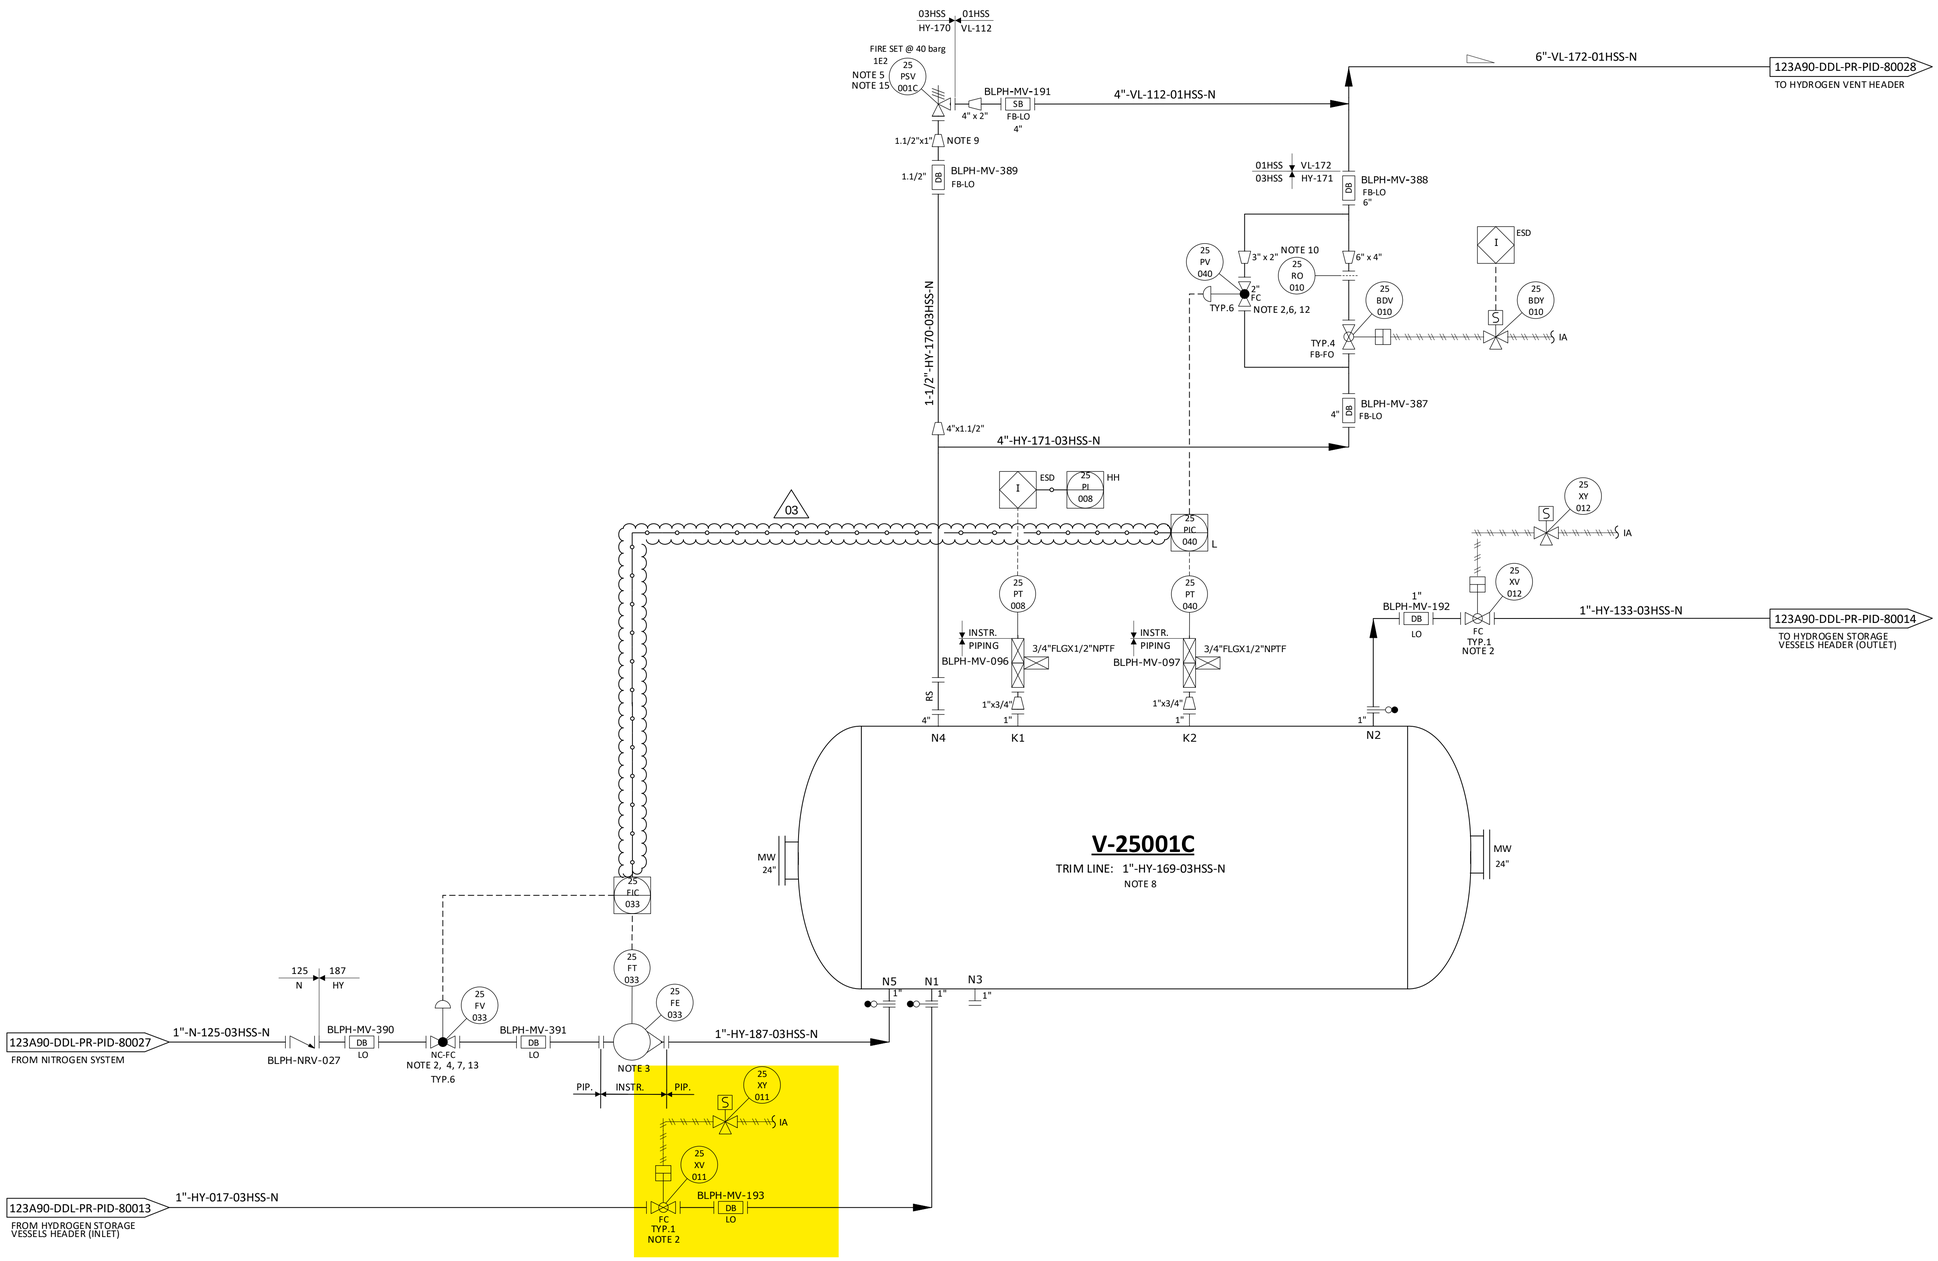

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-033) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-040 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-040 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-033 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-040 HAS FAILED TO CLOSE.
15. 25-PS-V001C SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL C

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE		
A1	DRAWING NO. 123A90-DDL-PR-PID-80017			SHEET 001	REV. 03


File Name = FILE_NAME

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-13002	No.	MARSHALLING CABINET B400-PCS-002

<01>

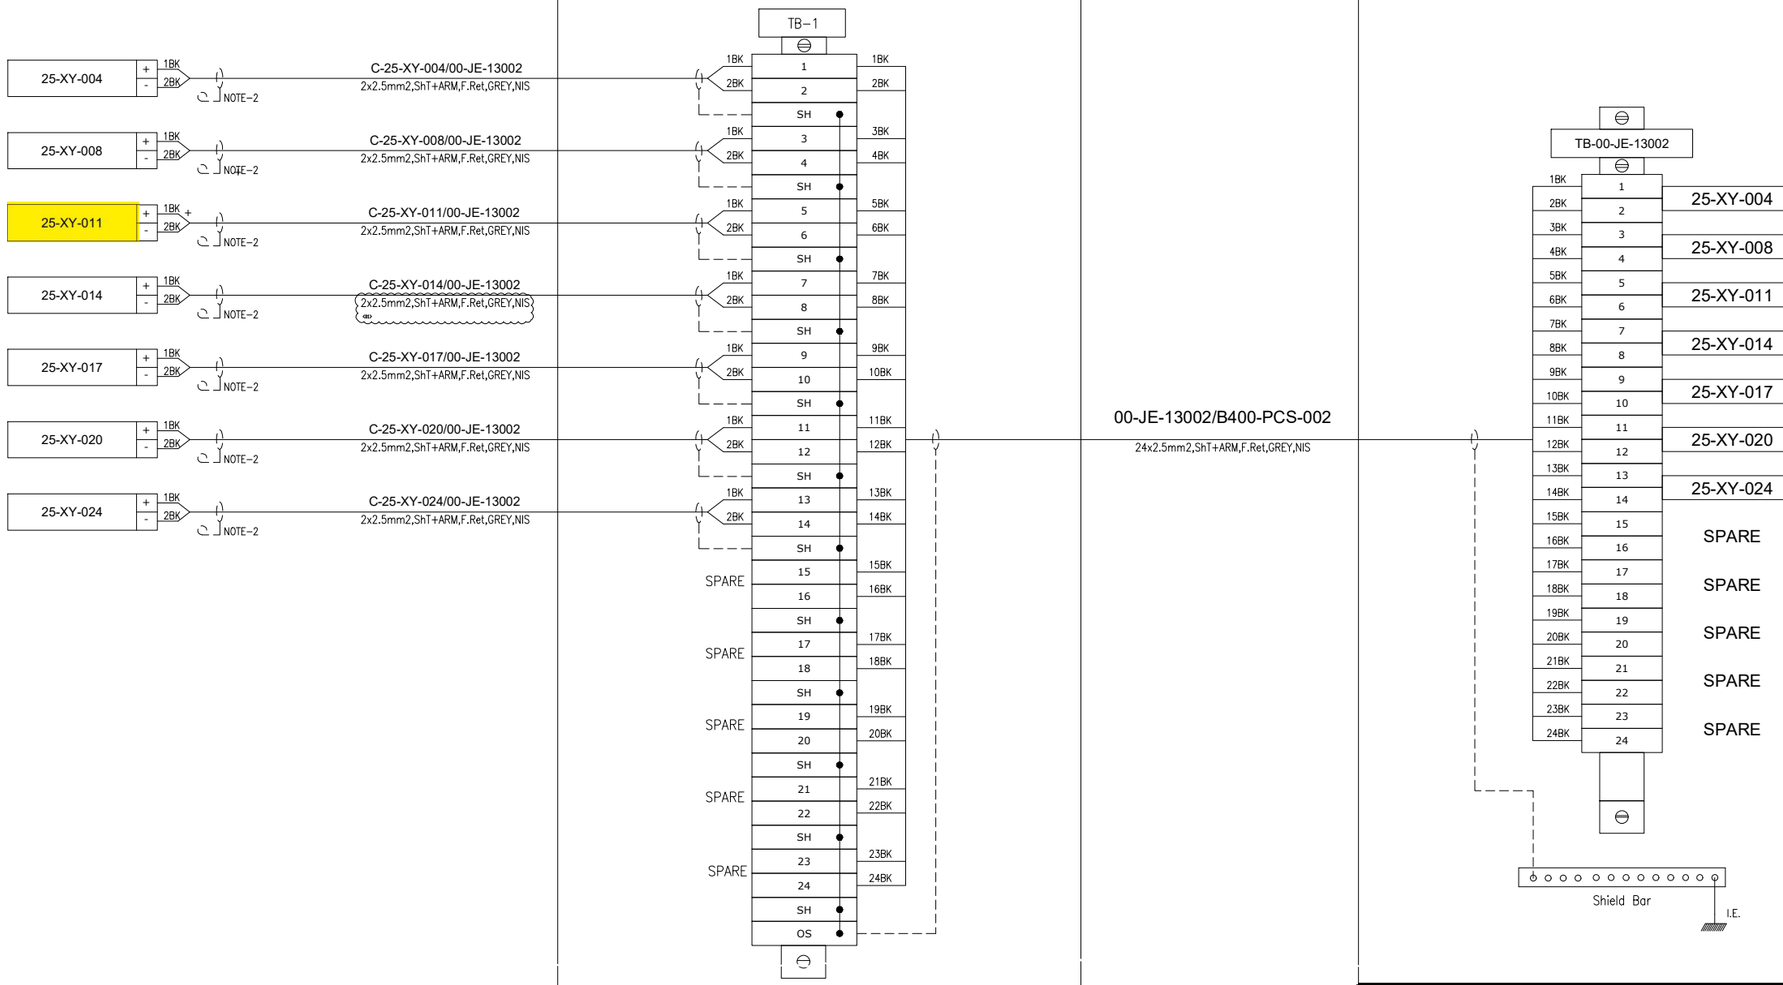

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-13002

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 029	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

E33

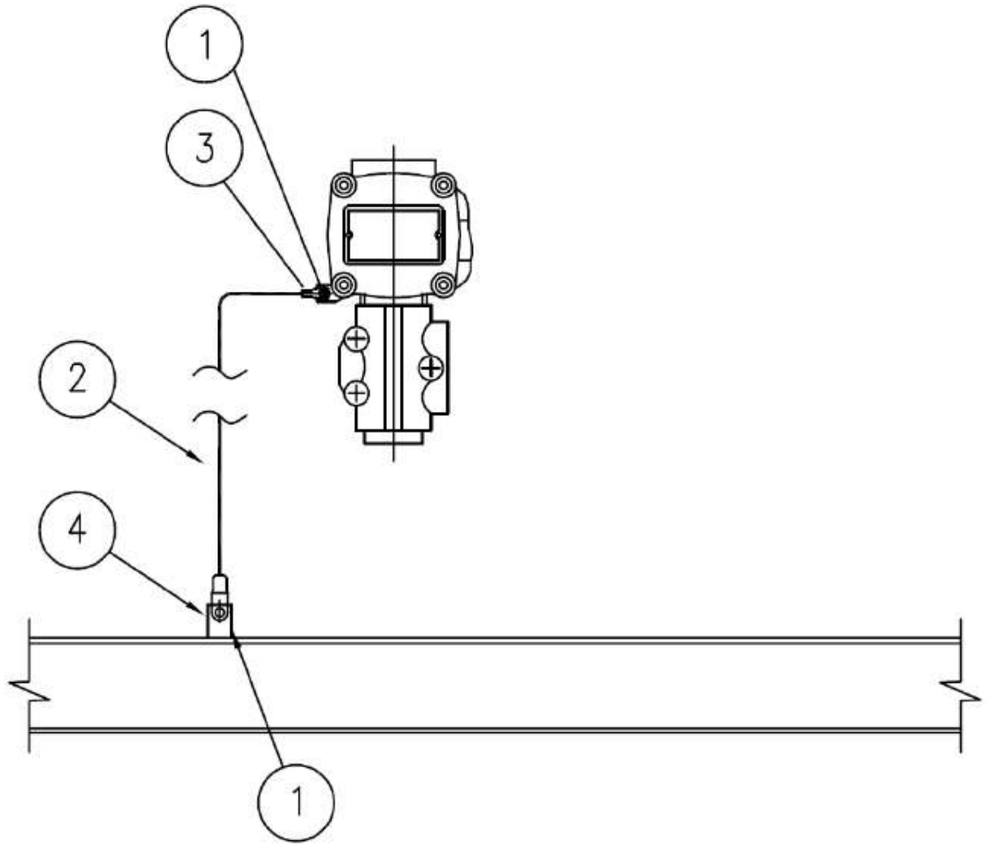

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

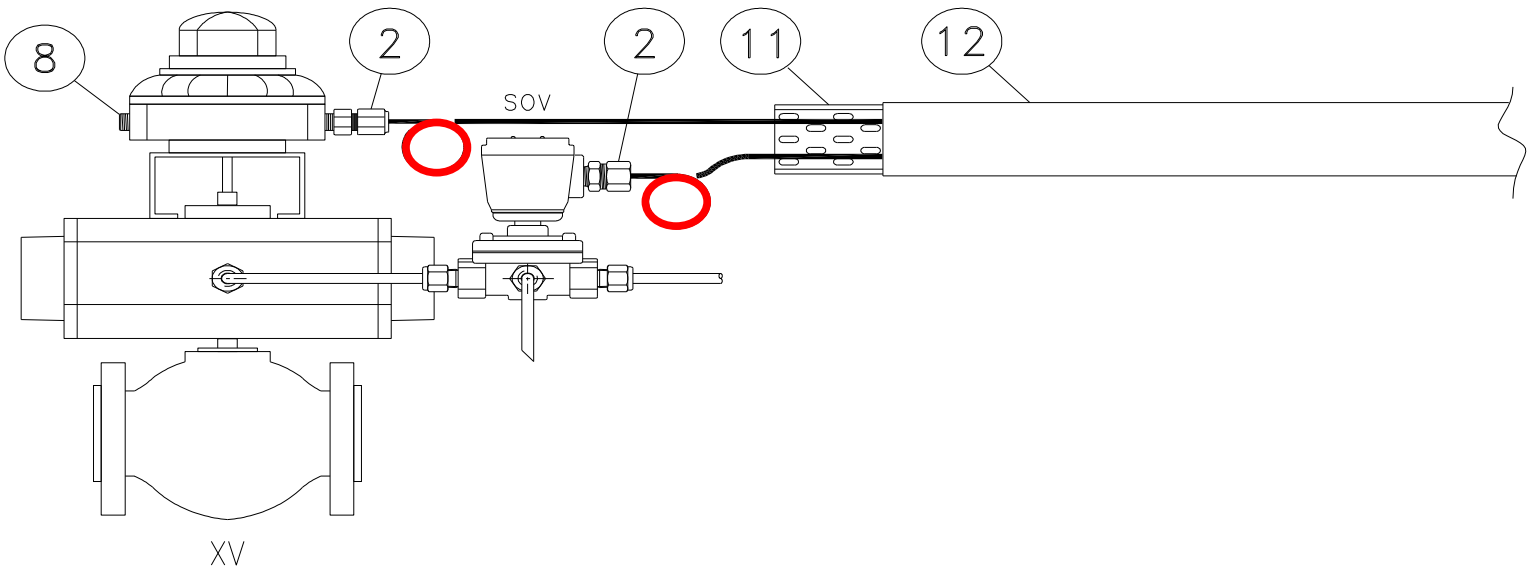

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

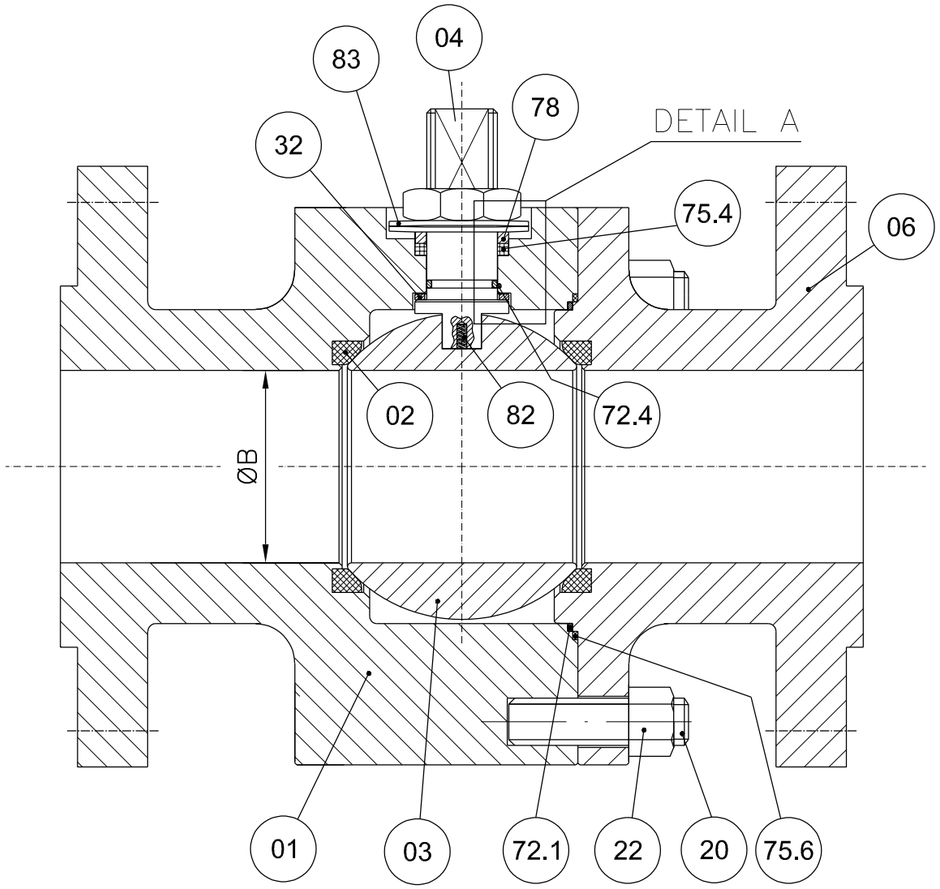




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301



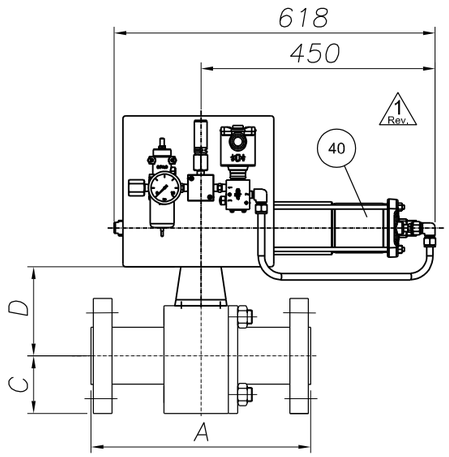

ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DRAWN: S.Madahar — DATE: 26/02/2024
CHK'D: D.Barcella — DATE: 26/02/2024
APPV'D: L.Mora — DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWING NAME: **D240062-08**

Rev.: 2

GENERAL	1	Tag Number		Location		25-XV-011		25
	2	Service				HYDROGEN STORAGE TANK V-25001C INLET		
	3	P&ID Number		Area Classification		123A90-DDL-PR-PID-80017		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-017-03HSS-N		
	5	Line Size and Schedule	Inlet		Outlet	1" / 3.38 mm		1" / 3.38 mm
	6	Line Material		Line Insulation		ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State		Phase		GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure		Full Vacuum	[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature		Minimum	Maxi [°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of		Design		Close :	(12)	Open : (12)
	17	Operation (seconds)		Actual		Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size		Body Form		1"		FULL BORE
	22	Body Material		Bonnet Type		ASTM A182 F316/316L		(*)
	23	Connections		Rating		FLANGED ASME B16.5		#300
	24	Flange Finish		Gasket Material		RF		Inside the valve (*) (38)
	25	Packing		Lubrication & Isolation		A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer		Type		Rotork		Spring Return
	31	Model No.		Size		CP/S		035-100A/BA
	32	Actuator Orientation		Actuator Form		Horizontal		Cylinder
	33	Ingress Protection		Certification		IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply		Min	Max Design	4 barg	10 barg	11 barg
	35	Action on Air Failure		Action on Power Failure		CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-011 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed		Limit Switch Open		25-ZSL-011 (9, 17) - Soldo SS		25-ZSH-011 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set		Handwheel		(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection		Electrical Class		No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity		Fabrication Code		-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve		Model		-		-
	48	Check Valve		Mounting		-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

94	IFR	25-XV-009	floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR	25-XV-011	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR	25-XV-012	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR	25-XV-014	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR	25-XV-015	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR	25-XV-017	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR	25-XV-018	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

1 # EU - TYPE EXAMINATION CERTIFICATE

2 **Equipment or Protective System Intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU**

3 EU - Type Examination Certificate Number: **Baseefa10ATEX0026 – Issue 15**

4 Product: **Type 27 & 77 Solenoid Operator**

5 Manufacturer: **Bifold Fluidpower Limited**

6 Address: **Chadderton, Oldham, Greater Manchester, OL9 9XA, UK**

7 This re-issued certificate extends EU Type Examination Certificate No. **Baseefa10ATEX0026** to apply to product designed and constructed in accordance with the specification set out in the Schedule of the said certificate but having any variations specified in the Schedule attached to this certificate and the documents therein referred to.

8 SGS Fimko Oy, Notified Body number 0598, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this product has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II to the Directive.

8.1 The original certificate was issued by SGS Baseefa Ltd (UK Notified Body 1180). It, and any supplements previously issued by SGS Baseefa Ltd have been transferred to the supervision of SGS Fimko Oy (EU Notified Body 0598). The original certificate number is retained.

The examination and test results are recorded in confidential Report No. **See Certificate History**

9 Compliance with the Essential Health and Safety Requirements has been assured by compliance with:

EN IEC 60079-0:2018 **EN 60079-1:2014** **EN 60079-31:2014**

except in respect of those requirements listed at item 18 of the Schedule.

10 If the sign "X" is placed after the certificate number, it indicates that the product is subject to the Specific Conditions of Use specified in the schedule to this certificate.

11 This EU - TYPE EXAMINATION CERTIFICATE relates only to the design and construction of the specified product. Further requirements of the Directive apply to the manufacturing process and supply of this product. These are not covered by this certificate.

12 The marking of the product shall include the following:

Ⓔx II 2GD **Ex db IIC T6 Gb (Tamb -60°C to +40°C)***
Ex tb IIIC T85°C Db (Tamb -60°C to +40°C)* IP66/67
***alternative Temperature class/Ambient combinations may also be marked, see schedule**

SGS Fimko Oy Customer Reference No. **1688** Project File No. **22/0377**

This document is issued by the Company subject to their General Conditions for Certification Services accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx . Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained herein reflects the Company's findings at the time of their intervention only and within the limits of Client's instructions, if any. It does not necessarily indicate that the equipment may be used in particular industries or circumstances. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, schedule included, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

SGS Fimko Oy
Takomotie 8
FI-00380 Helsinki, Finland
Telephone +358 (0)9 696 361
e-mail **sgs.fimko@sgs.com**
web site **www.sgs.fi**
Business ID 0978538-5 Member of the SGS Group (SGA SA)

Mikko Välimäki
Authorised Signatory for SGS Fimko Oy

13 **Schedule**

14 **Certificate Number Baseefa10ATEX0026 – Issue 15**

15 Description of Product

The Type 77 and Type 27 Solenoid Operators are rated at up to 240Vac or dc and have a maximum power dissipation of 14W. The Type 77 Solenoid Operator comprises a stainless steel cylindrical enclosure, whereas the Type 27 comprises an aluminium cylindrical enclosure, both have a spigot cover fitted with a silicone rubber seal.

In addition to the above there is also a two winding alternative designated the 'Pulse-Pulse Solenoid operator' which has a maximum combined coil rating limited to 20.5W.

The base of the enclosure is fitted with an adaptor bush which incorporates venting holes to allow the unit to be fitted onto a valve assembly rated up to a maximum pneumatic pressure of 10 bar. For hydraulic valves and valves with pneumatic pressures greater than 10 bar the top of the valve is provided with additional venting holes.

Internally the unit is fitted with a coil holder, coil and armature onto which is mounted an adjusting rod which forms a cylindrical joint with the adaptor bush and operates the valve when the solenoid is activated.

The cover may be fitted with a pushbutton or a rotary operator which can be used to operate the valve manually either momentarily or permanently.

The cover is secured using four stainless steel socket head cap screws grade of grade A4-70.

The equipment is marked:

Ex db IIC T6 Gb (Tamb -60°C to +40°C)*

Ex tb IIIC T85°C Db (Tamb -60°C to +40°C)* IP66/67

*The following alternative Temperature class/Ambient combinations may also be marked

T5/T100°C (Tamb -60°C to +55°C)

T4/T135°C (Tamb -60°C to +90°C)

An M20 or ½" NPT cable entry hole is provided as specified on the certified drawings for the accommodation of suitable IECEx Equipment (not a Component) certified cable entry device, with or without the interposition of a suitable IECEx Equipment certified (not a Component) flameproof thread adapter.

An M20 cable entry is provided unless the marking 'K85' appears in the Model No. marked on the label, in which case a ½" NPT cable entry hole is provided.

16 Report Number

See Certificate History

17 Specific Conditions of Use

None

18 Essential Health and Safety Requirements

In addition to the Essential Health and Safety Requirements (EHSRs) covered by the standards listed at item 9, the following are considered relevant to this product:

Clause	Subject
1.4.1	External effects
1.4.2	Aggressive substances etc.

19 Drawings and Documents

New drawings submitted for this issue of certificate:

Number	Issue	Date	Description
0-SL0070	0	2022.06.30	TYPE 27 & 77 SOLENOID LABEL - ROTORK BRAND - L240

Current drawings which remain unaffected by this issue:

Number	Issue	Date	Description
0-SC0004	1	09.07.20	Solenoid Lid Options G.A
0-SC0006	0	17.04.09	Latched Energised and Tamperproof Solenoid Options
0-SC0008	1	29.03.11	Override Cover Assembly
0-SC0009	0	12.02.15	Serial Numbers IIB, Type 77
**0-GA0870	0	07.11.17	General Arrangement L209 Variant – Fixed Head Operator
0-SC0003	11	20.09.21	Type 27 and 77 Solenoid Operator
0-SC0007	5	24.11.21	Sol. Operator Pulse-Pulse.
0-SL0056	4	13.01.22	Type 27 & 77 Solenoid housing label Ex d
0-SL0058	5	2022.02.07	Type 27 & 77 Solenoid housing label Ex d
0-SL0068	0	2022.01.17	Label Type 27 and 77 Solenoid Operator

**This drawing is common to this certificate and BAS02ATEX2048, BAS21UKEX0642 and is held with IECEx BAS 10.0008.

20 Certificate History


Certificate No.	Date	Comments
Baseefa10ATEX0026	20 April 2010	The release of the prime certificate. The associated test and assessment against the requirements of EN 60079-0: 2006, EN 60079-1: 2007, EN 61241-0: 2004 and EN 61241-1: 2004 is documented in Test Report No. GB/BAS/ExTR10.0014/00.
Baseefa10ATEX0026/1	7 April 2011	Amendment to the diametral tolerance for the adjusting rod. Omission of drawing 0-SC0001 (previously submitted in error). Alternative design of pushbutton override cover assembly. Minor drawing variations. Documented in Test Report No. GB/BAS/ExTR11.0084/00
Baseefa10ATEX0026/2	8 July 2011	Alternative internal design to form the Pulse-Pulse Solenoid Operator. This unit has two windings with a combined rating of 20.5W. Amended designation for the solenoid housing material. Documented in Test Report No. GB/BAS/ExTR11.0123/00
Baseefa10ATEX0026/3	2 April 2012	Alternative label design incorporating the complete range of temperature class and ambient temperature markings provided for by this certificate. Documented in Test Report No. GB/BAS/ExTR12.0086/00

Certificate No.	Date	Comments
Baseefa10ATEX0026/4	2 December 2013	A re-designation of the Type FP Solenoid Operator, to the Type 77 Solenoid Operator. A satisfactory assessment against the requirements of the updated standards IEC 60079-0: 2011 and IEC 60079-31: 2008 (superseding IEC 61241), complete with a review of the marking. Introduction of an alternative aluminium housing and cover material. Documented in Test Report No. GB/BAS/ExTR13.0291/00
Baseefa10ATEX0026/5	29 July 2014	This issue permits existing information (for example on Schedule Drawings) to be replaced by the revised certificate holders address. No other changes may be made to the certified design. Documented in Test Report No. None.
Baseefa10ATEX0026/6	17 February 2015	Clarification of the Type name. The Type 77 comprises a stainless steel housing and the Type 27 comprises an aluminium housing. To allow the introduction of alternative seal materials. To allow the Type 77 Solenoid Operators having Serial numbers as defined in drawing number 0-SC0009 to be marked with Ex d IIB T6 Gb. Documented in Test Report No. GB/BAS/ExTR14.0317/00
Baseefa10ATEX0026/7	23 June 2016	Minor drawing changes not affecting certification. Documented in Test Report No. GB/BAS/ExTR16.0164/00
Baseefa10ATEX0026/8	16 March 2017	To allow the introduction of an alternative low power circuit. To allow for correction of the Type designation listed on the EU-Type Examination Certificate Baseefa10ATEX0026 To allow for correction of description to include the Pulse Pulse Unit. Documented in Test Report No. GB/BAS/ExTR17.0076/00
Baseefa10ATEX0026/9	20 July 2017	To allow the introduction of an alternative low power circuit. Documented in Test Report No. GB/BAS/ExTR17.0211/00
Baseefa10ATEX0026/10	3 January 2018	To introduce an alternative non-rotational mounting arrangement to attach the adaptor bushing via the coil holder to the enclosure housing. Identification of threaded entry holes on the enclosure wall. Documented in Test Report No. GB/BAS/ExTR17.0274/00
Baseefa10ATEX0026/11	7 March 2018	To introduce alternative terminal plate with a different grounding point design. To introduce optional certification marks in addition to the existing one to be included on to the certification label marking. Documented in Test Report No. GB/BAS/ExTR 18.0041/00
Baseefa10ATEX0026/12	12 July 2019	To assess the Type 27 and 77 Solenoid Operator against the standards EN IEC 60079-0:2018, EN 60079-1:2014 and EN 60079-31:2014 To permit minor drawing changes to the certification label that do not affect certification Documented in Test Report No. GB/BAS/ExTR19.0100/00


Certificate No.	Date	Comments
Baseefa10ATEX0026/13	14 July 2020	To introduce an alternative Detented Manual Over-Ride Lid (alternative spigoted cover), which allows the valve to be operated manually. Documented in Test Report No. GB/BAS/ExTR19.0341/00.
Baseefa10ATEX0026 – issue 14	11 February 2022	This issue of the certificate incorporates previously issued primary & supplementary certificates. To remove drawings 138-10, 138-10-K85, 0-S0252 and 0-S0254 transferring critical details to drawing 0-SC0003 revision 11. To remove drawing 0-SC0001. To add drawing 0-SL0068. To add an alternative encapsulant. To update the nameplate drawings to include UKEX details. Documented in Test Report No. GB/BAS/ExTR21.0158/00
Baseefa10ATEX0026 – issue 15	2 November 2022	This issue of the certificate incorporates previously issued primary & supplementary certificates. To add an alternative marking drawing with a different manufacturer branding. The assessment is documented in test report GB/BAS/ExTR22.0138/00
For drawings applicable to each issue, see original of that issue.		

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

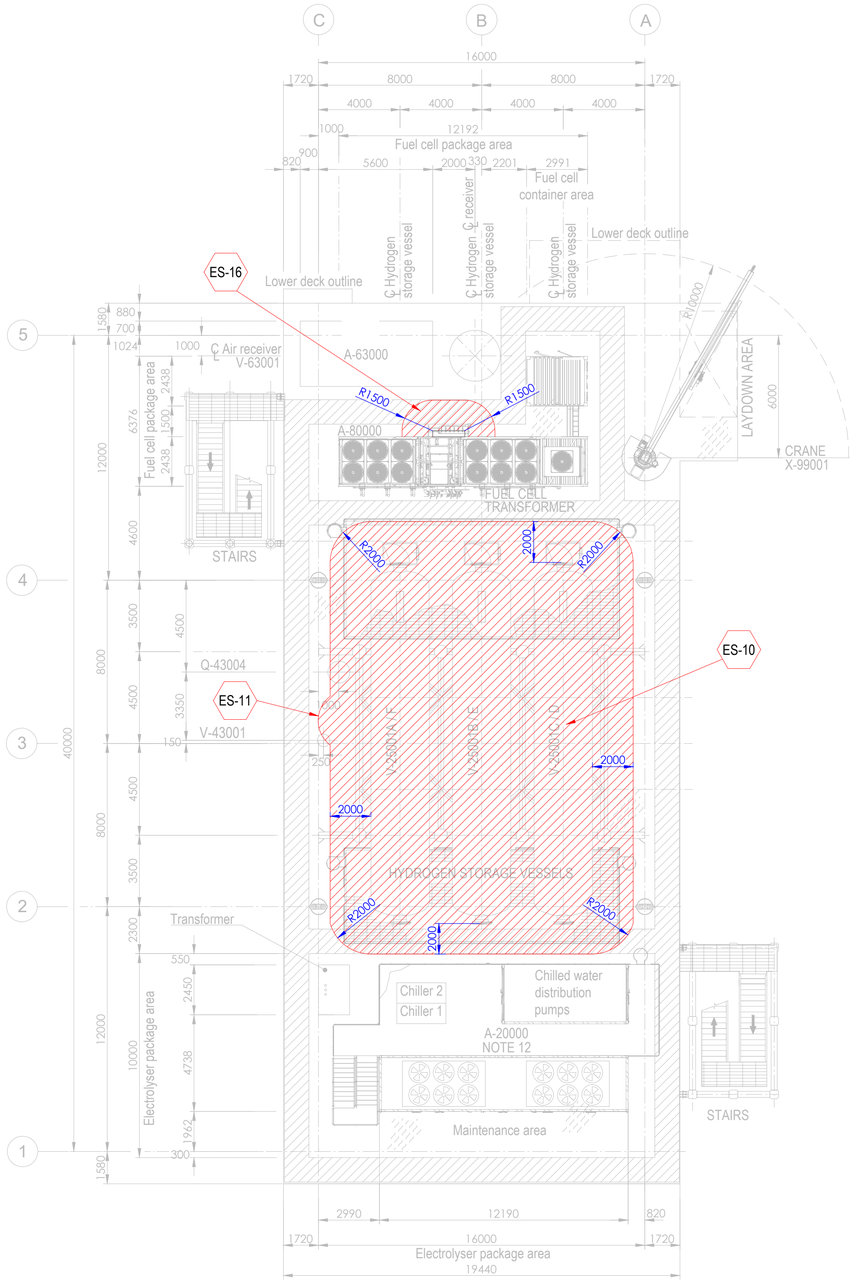


PLAN ON UPPER DECK
EL+30.310 T.O.S.

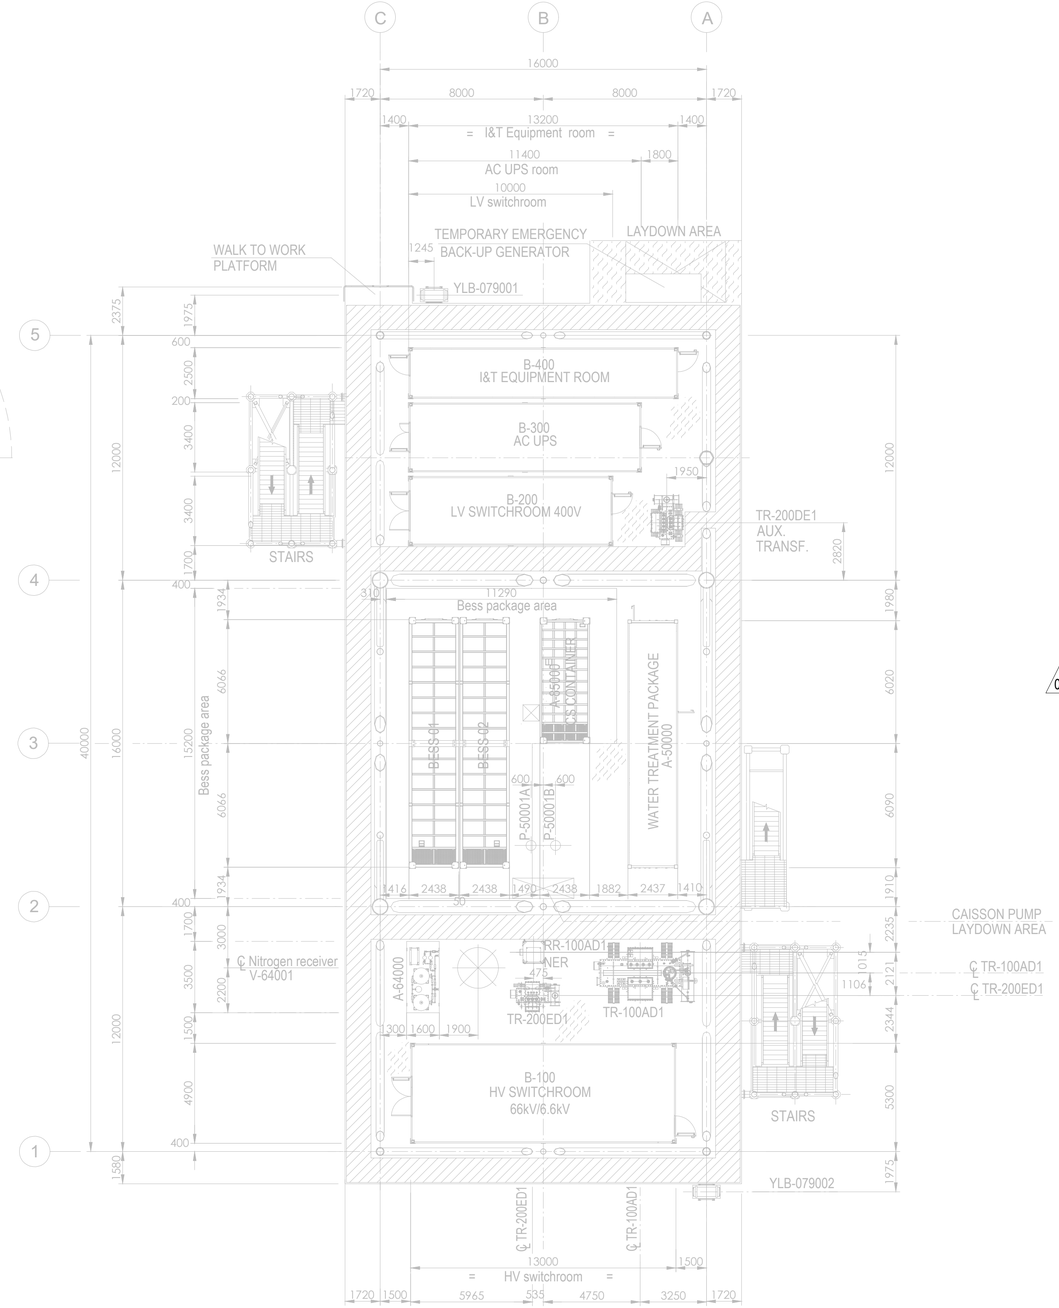

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

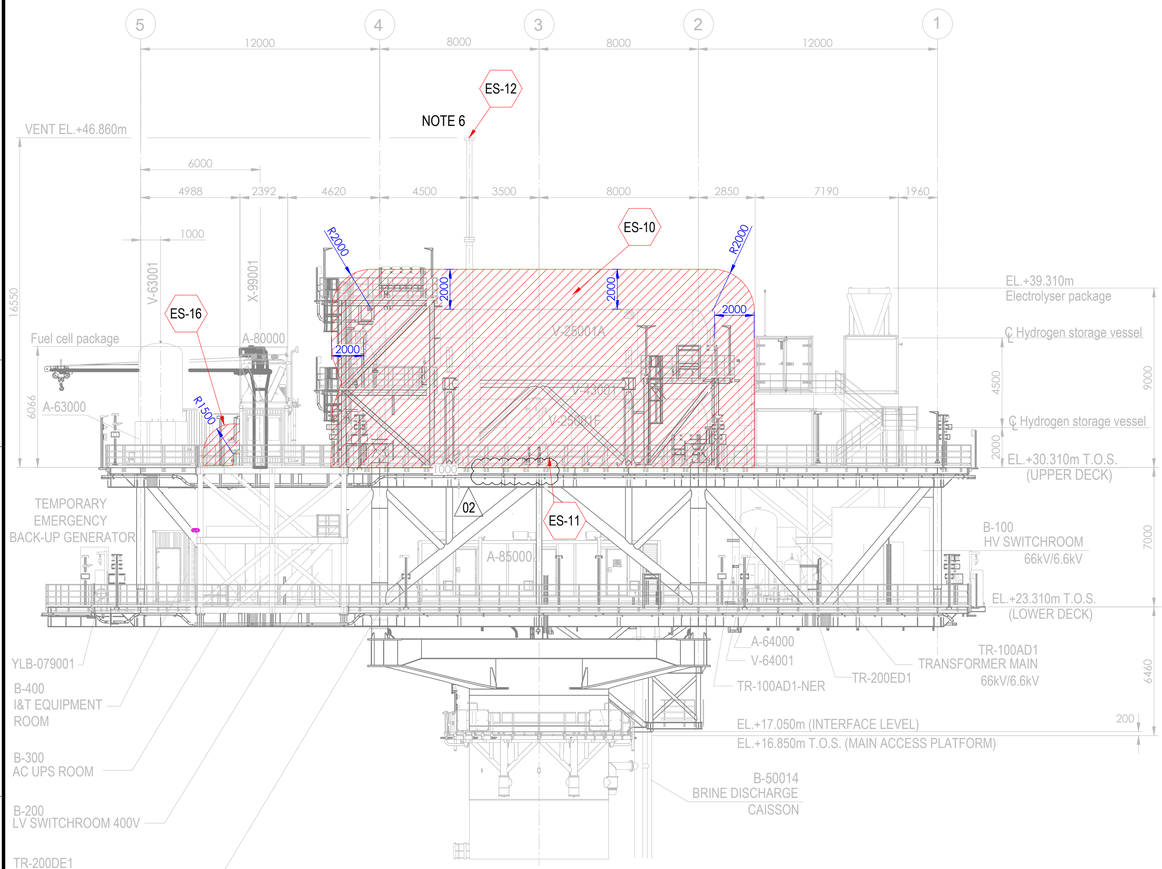



ELEVATION LOOKING EAST

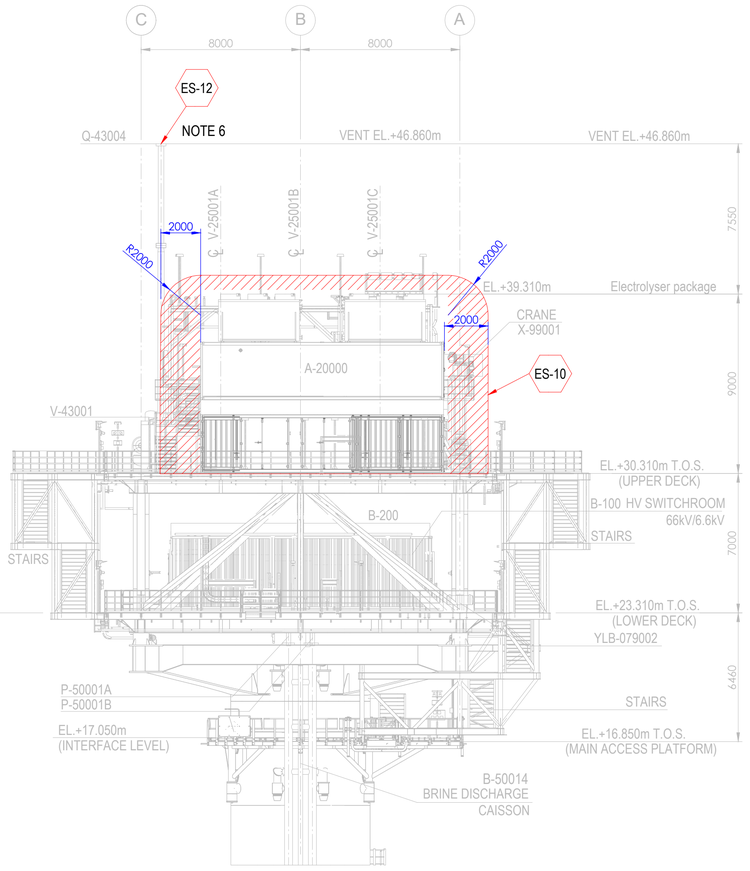

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

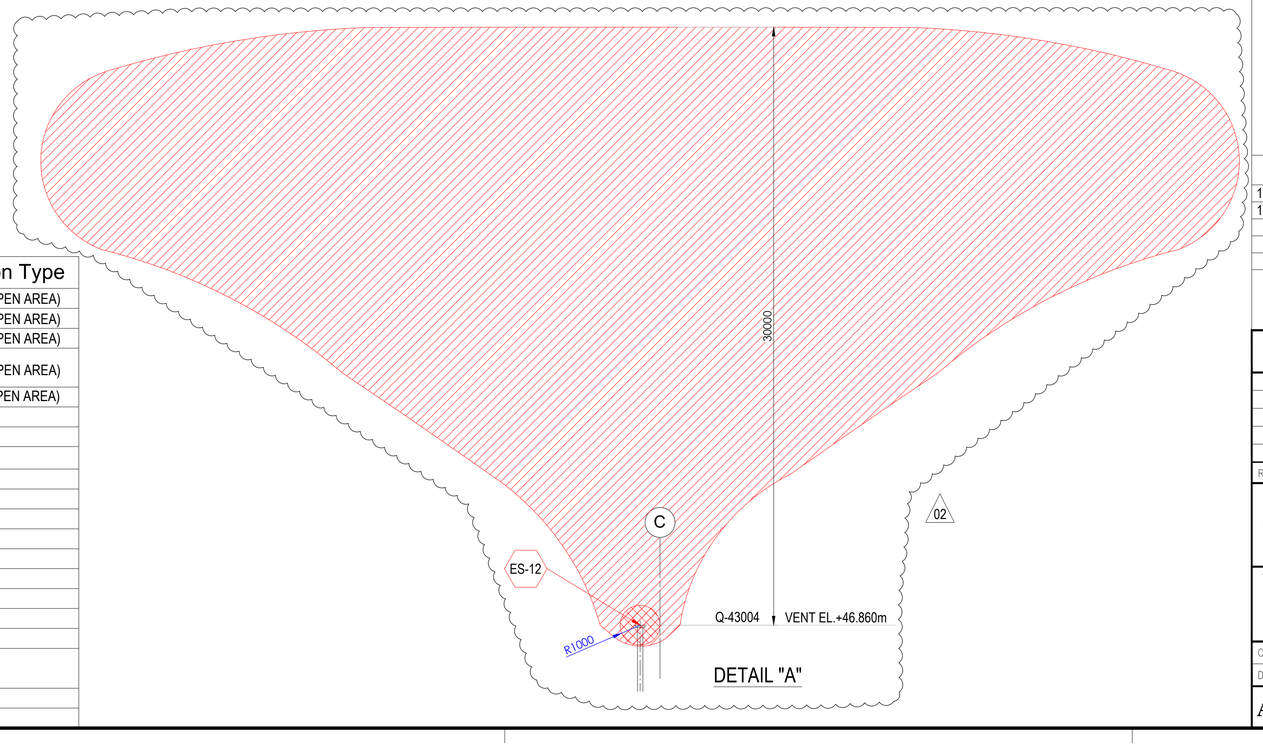



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-XY-014	: Solenoid Valve - Vessel V-25001D Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001720	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		FL18424-1547			
Manufacturer	BIFOLD			**Model**		FP06P-77A			
Cert No.	Baseefa10ATEX0026			**Equipment Ambient Temp.**		-60°C to +40°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66/67

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	OK	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	OK	

ITEM	Tag	25-XY-014	: Solenoid Valve - Vessel V-25001D Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001720		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	OK	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-XY-014	: Solenoid Valve - Vessel V-25001D Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001720		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Giovanni Tangianu	
Date	2025-01-25	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-25T13:53:25.413Z	PROVERLIS Digitaly signed by Giovanni Tangianu 2025-01-29T13:33:33.998Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

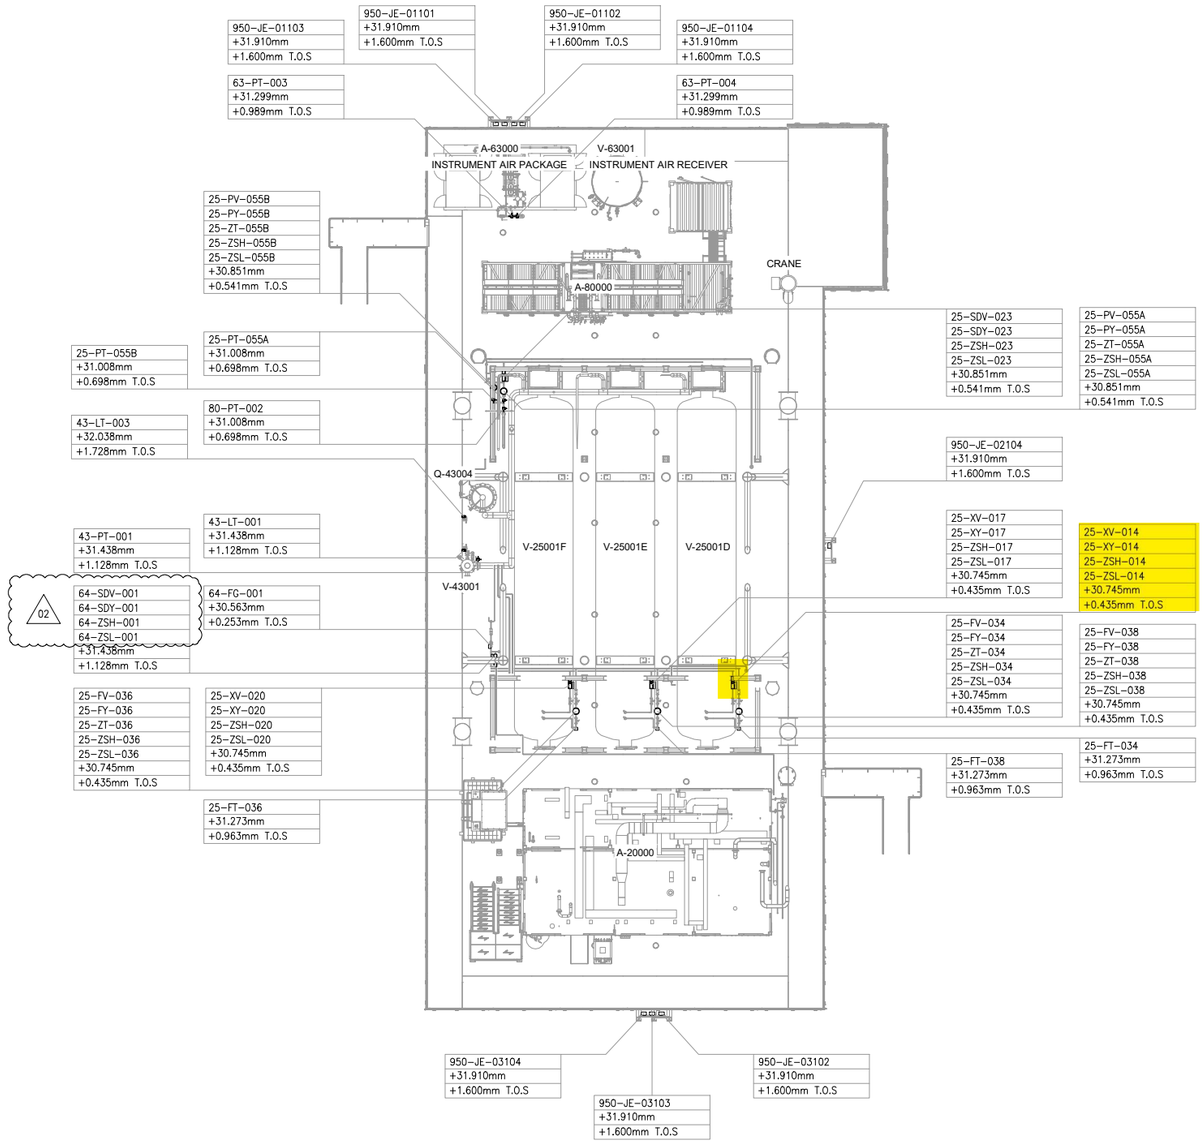


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm



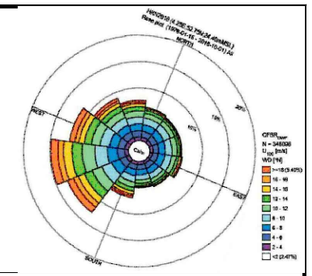

NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001_D

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

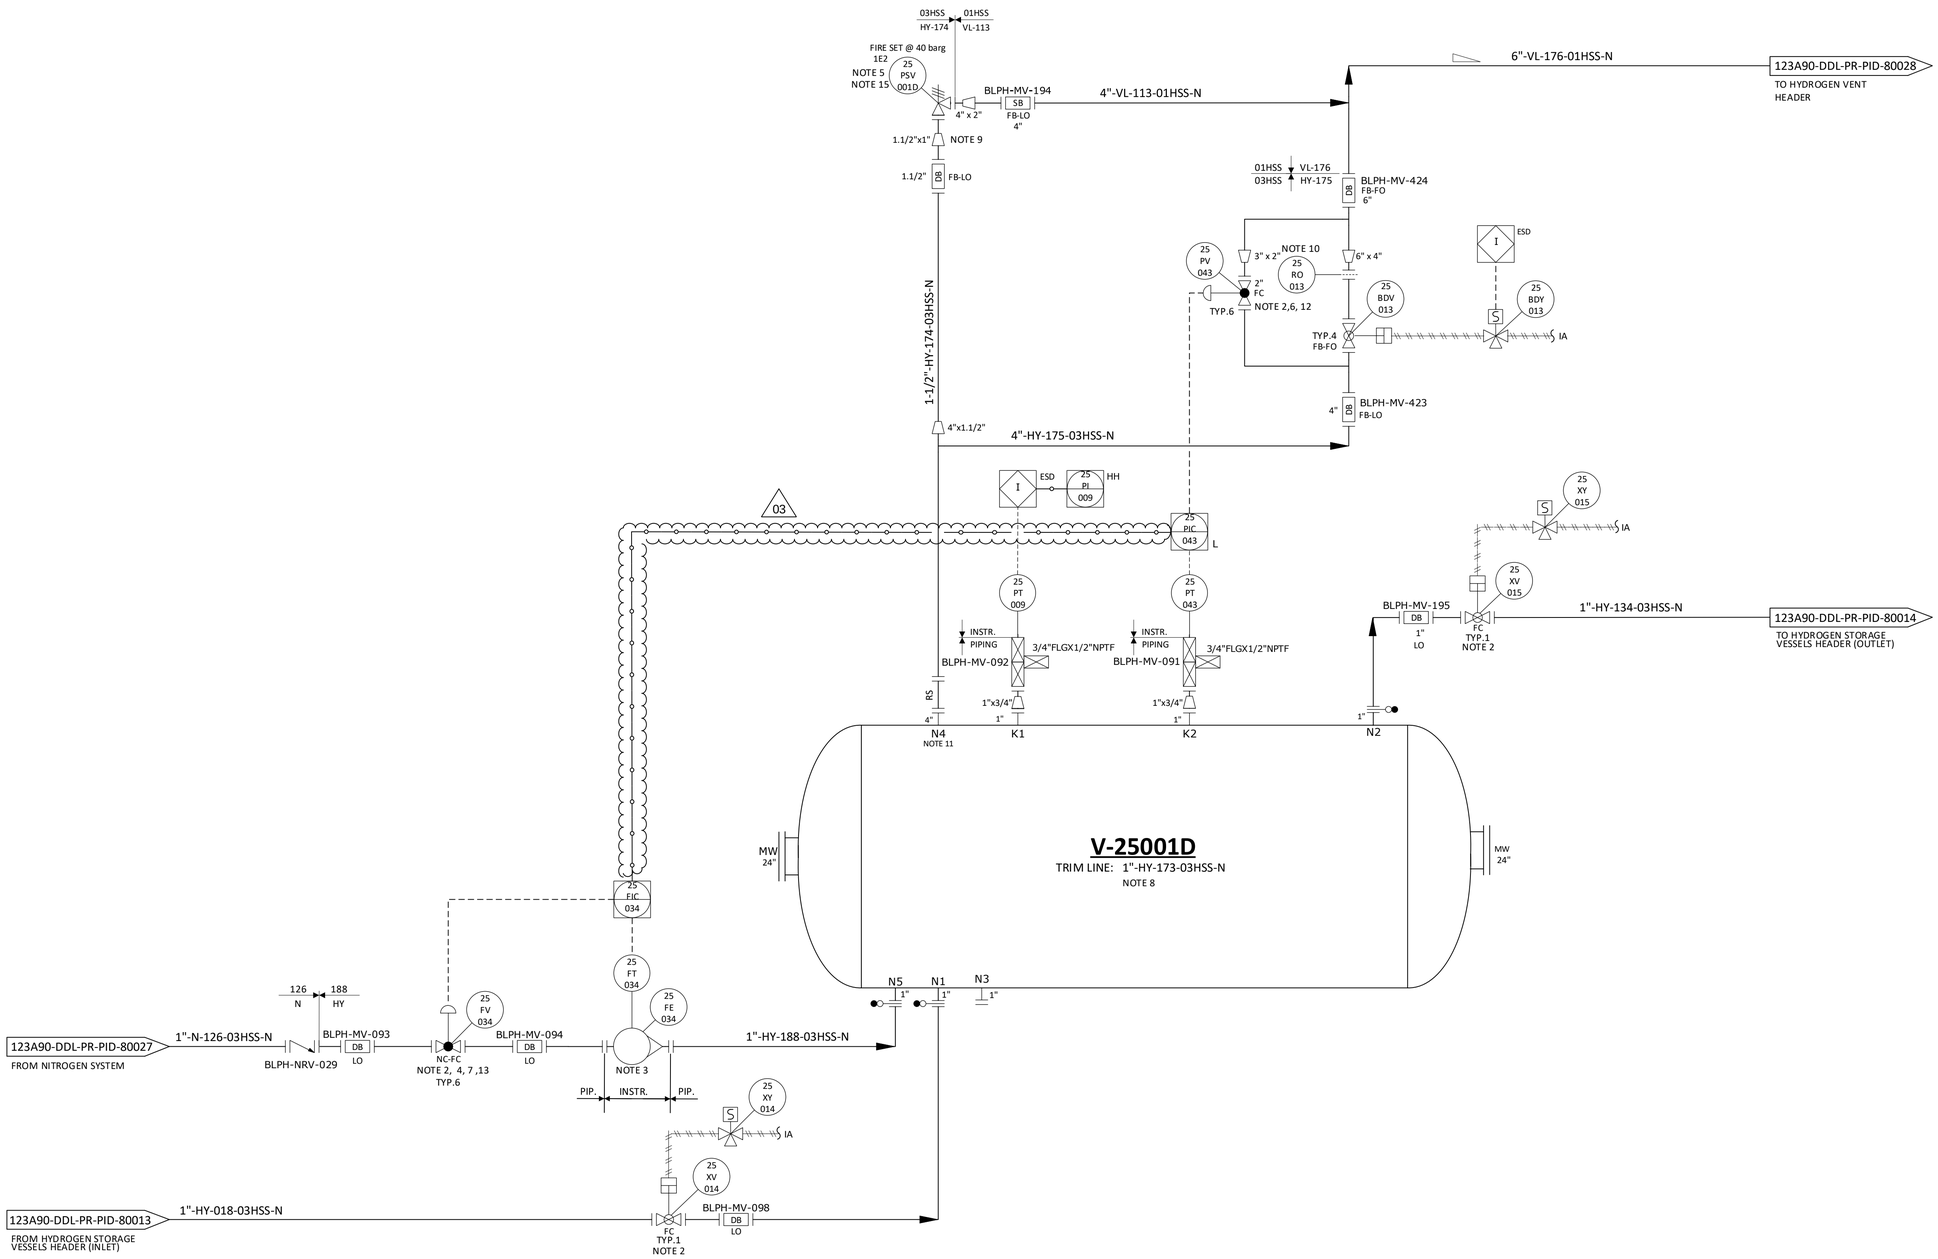

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS. 03
4. NITROGEN CONTROL VALVE (25-FV-034) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE.
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-043 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-043 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-034 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-043 HAS FAILED TO CLOSE.
15. 25-PSV-001D SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL D

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO. 123A90-DDL-PR-PID-80018	SHEET 001	REV. 03


File Name : FILE_NAME

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-13002	No.	MARSHALLING CABINET B400-PCS-002

<01>

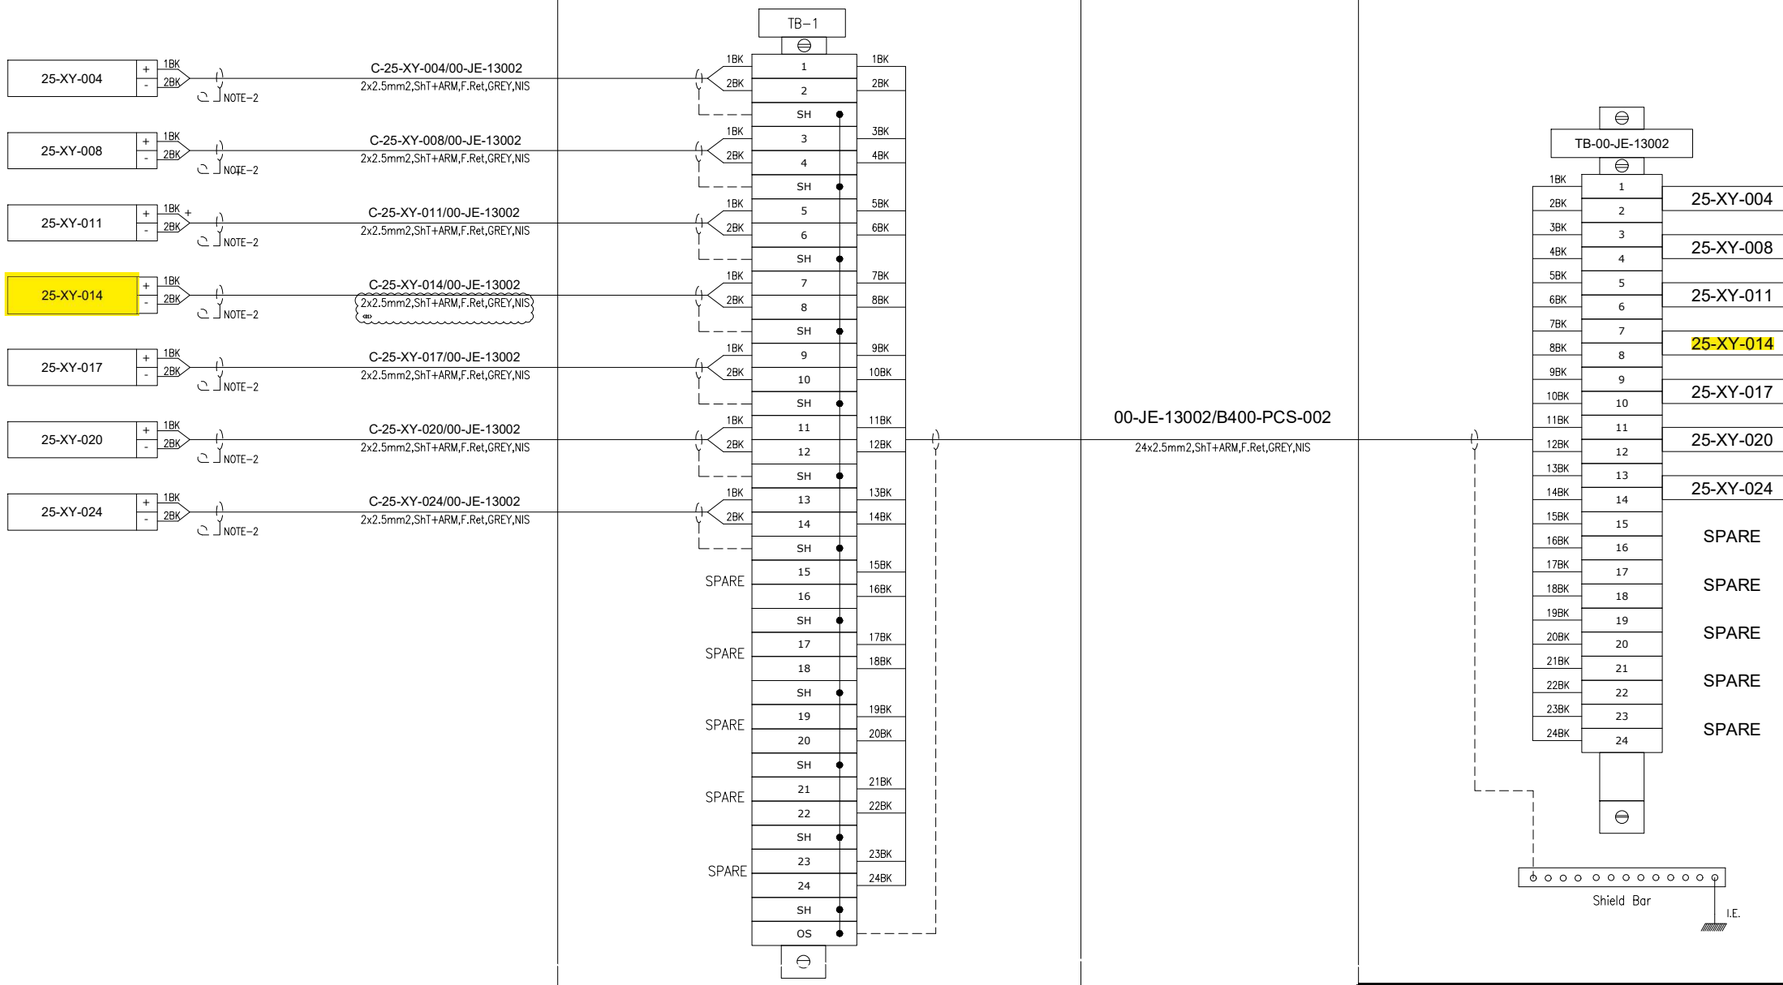

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-13002

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 029	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

E33

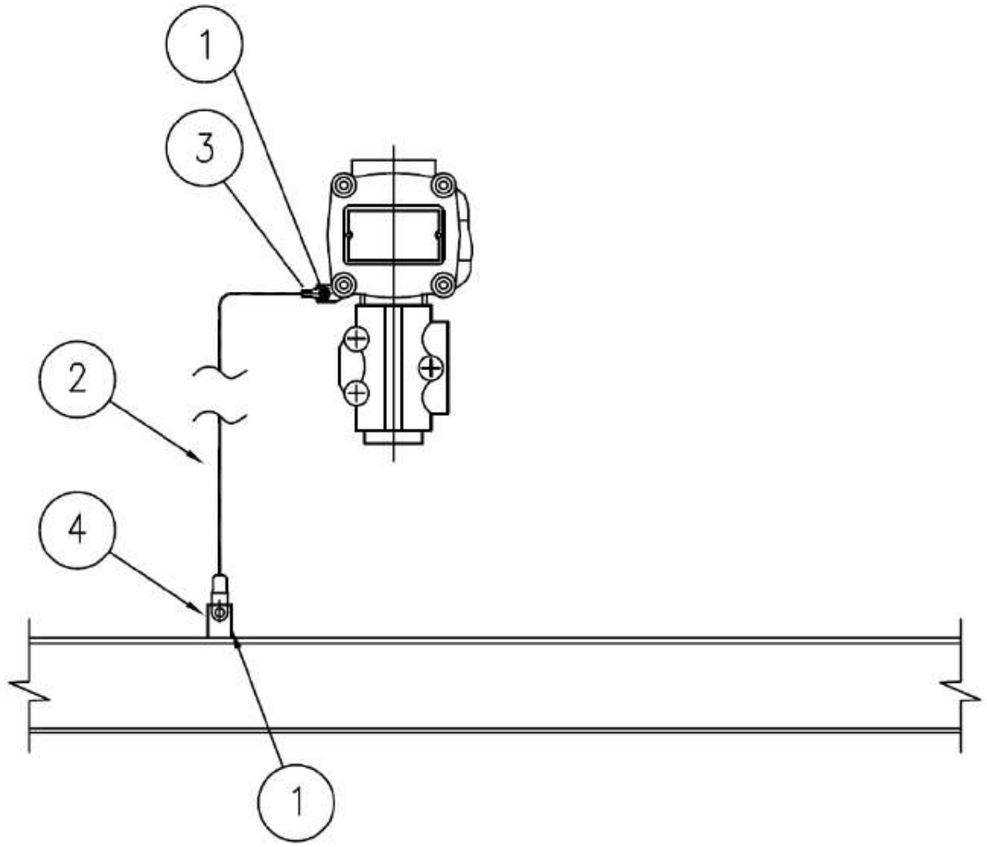

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

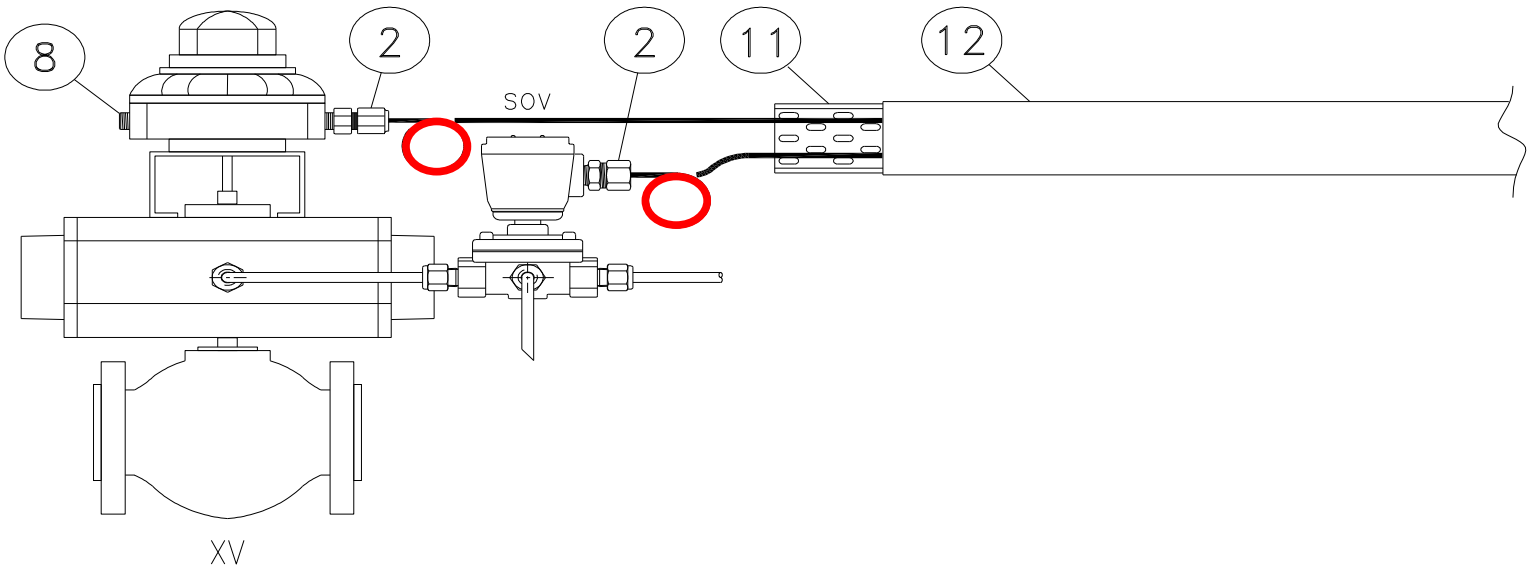

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

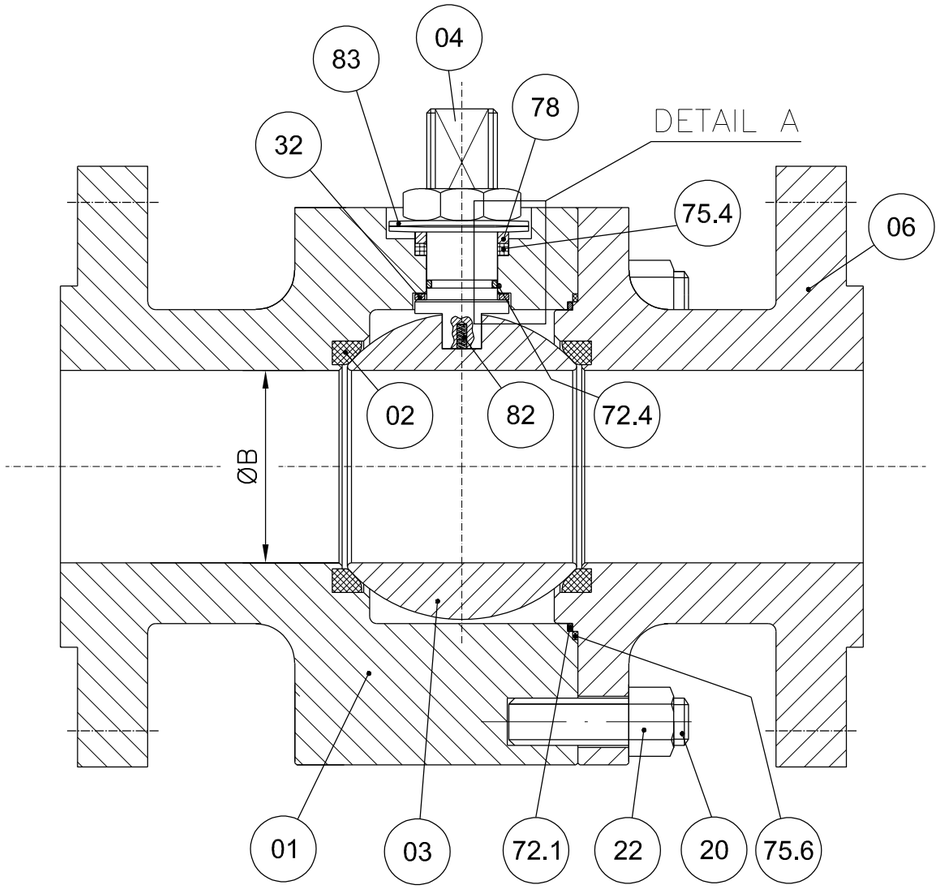




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024
CHK'D: D.Barcella	DATE: 26/02/2024
APPV'D: L.Mora	DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: D240062-08

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-014		25
	2	Service				HYDROGEN STORAGE TANK V-25001D INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80018		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-018-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-014 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-014 (9, 17) - Soldo SS		25-ZSH-014 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

94	IFR	25-XV-009	floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR	25-XV-011	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR	25-XV-012	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR	25-XV-014	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR	25-XV-015	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR	25-XV-017	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR	25-XV-018	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

1 # EU - TYPE EXAMINATION CERTIFICATE

2 **Equipment or Protective System Intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU**

3 EU - Type Examination Certificate Number: **Baseefa10ATEX0026 – Issue 15**

4 Product: **Type 27 & 77 Solenoid Operator**

5 Manufacturer: **Bifold Fluidpower Limited**

6 Address: **Chadderton, Oldham, Greater Manchester, OL9 9XA, UK**

7 This re-issued certificate extends EU Type Examination Certificate No. **Baseefa10ATEX0026** to apply to product designed and constructed in accordance with the specification set out in the Schedule of the said certificate but having any variations specified in the Schedule attached to this certificate and the documents therein referred to.

8 SGS Fimko Oy, Notified Body number 0598, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this product has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II to the Directive.

8.1 The original certificate was issued by SGS Baseefa Ltd (UK Notified Body 1180). It, and any supplements previously issued by SGS Baseefa Ltd have been transferred to the supervision of SGS Fimko Oy (EU Notified Body 0598). The original certificate number is retained.

The examination and test results are recorded in confidential Report No. **See Certificate History**

9 Compliance with the Essential Health and Safety Requirements has been assured by compliance with:

EN IEC 60079-0:2018 **EN 60079-1:2014** **EN 60079-31:2014**

except in respect of those requirements listed at item 18 of the Schedule.

10 If the sign "X" is placed after the certificate number, it indicates that the product is subject to the Specific Conditions of Use specified in the schedule to this certificate.

11 This EU - TYPE EXAMINATION CERTIFICATE relates only to the design and construction of the specified product. Further requirements of the Directive apply to the manufacturing process and supply of this product. These are not covered by this certificate.

12 The marking of the product shall include the following:

Ⓔx II 2GD **Ex db IIC T6 Gb (Tamb -60°C to +40°C)***
Ex tb IIIC T85°C Db (Tamb -60°C to +40°C)* IP66/67
***alternative Temperature class/Ambient combinations may also be marked, see schedule**

SGS Fimko Oy Customer Reference No. **1688** Project File No. **22/0377**

This document is issued by the Company subject to their General Conditions for Certification Services accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx . Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained herein reflects the Company's findings at the time of their intervention only and within the limits of Client's instructions, if any. It does not necessarily indicate that the equipment may be used in particular industries or circumstances. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, schedule included, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

SGS Fimko Oy
Takomotie 8
FI-00380 Helsinki, Finland
Telephone +358 (0)9 696 361
e-mail **sgs.fimko@sgs.com**
web site **www.sgs.fi**
Business ID 0978538-5 Member of the SGS Group (SGA SA)

Mikko Välimäki
Authorised Signatory for SGS Fimko Oy

13 **Schedule**

14 **Certificate Number Baseefa10ATEX0026 – Issue 15**

15 Description of Product

The Type 77 and Type 27 Solenoid Operators are rated at up to 240Vac or dc and have a maximum power dissipation of 14W. The Type 77 Solenoid Operator comprises a stainless steel cylindrical enclosure, whereas the Type 27 comprises an aluminium cylindrical enclosure, both have a spigot cover fitted with a silicone rubber seal.

In addition to the above there is also a two winding alternative designated the 'Pulse-Pulse Solenoid operator' which has a maximum combined coil rating limited to 20.5W.

The base of the enclosure is fitted with an adaptor bush which incorporates venting holes to allow the unit to be fitted onto a valve assembly rated up to a maximum pneumatic pressure of 10 bar. For hydraulic valves and valves with pneumatic pressures greater than 10 bar the top of the valve is provided with additional venting holes.

Internally the unit is fitted with a coil holder, coil and armature onto which is mounted an adjusting rod which forms a cylindrical joint with the adaptor bush and operates the valve when the solenoid is activated.

The cover may be fitted with a pushbutton or a rotary operator which can be used to operate the valve manually either momentarily or permanently.

The cover is secured using four stainless steel socket head cap screws grade of grade A4-70.

The equipment is marked:

Ex db IIC T6 Gb (Tamb -60°C to +40°C)*

Ex tb IIIC T85°C Db (Tamb -60°C to +40°C)* IP66/67

*The following alternative Temperature class/Ambient combinations may also be marked

T5/T100°C (Tamb -60°C to +55°C)

T4/T135°C (Tamb -60°C to +90°C)

An M20 or ½" NPT cable entry hole is provided as specified on the certified drawings for the accommodation of suitable IECEx Equipment (not a Component) certified cable entry device, with or without the interposition of a suitable IECEx Equipment certified (not a Component) flameproof thread adapter.

An M20 cable entry is provided unless the marking 'K85' appears in the Model No. marked on the label, in which case a ½" NPT cable entry hole is provided.

16 Report Number

See Certificate History

17 Specific Conditions of Use

None

18 Essential Health and Safety Requirements

In addition to the Essential Health and Safety Requirements (EHSRs) covered by the standards listed at item 9, the following are considered relevant to this product:

Clause	Subject
1.4.1	External effects
1.4.2	Aggressive substances etc.

19 Drawings and Documents

New drawings submitted for this issue of certificate:

Number	Issue	Date	Description
0-SL0070	0	2022.06.30	TYPE 27 & 77 SOLENOID LABEL - ROTORK BRAND - L240

Current drawings which remain unaffected by this issue:

Number	Issue	Date	Description
0-SC0004	1	09.07.20	Solenoid Lid Options G.A
0-SC0006	0	17.04.09	Latched Energised and Tamperproof Solenoid Options
0-SC0008	1	29.03.11	Override Cover Assembly
0-SC0009	0	12.02.15	Serial Numbers IIB, Type 77
**0-GA0870	0	07.11.17	General Arrangement L209 Variant – Fixed Head Operator
0-SC0003	11	20.09.21	Type 27 and 77 Solenoid Operator
0-SC0007	5	24.11.21	Sol. Operator Pulse-Pulse.
0-SL0056	4	13.01.22	Type 27 & 77 Solenoid housing label Ex d
0-SL0058	5	2022.02.07	Type 27 & 77 Solenoid housing label Ex d
0-SL0068	0	2022.01.17	Label Type 27 and 77 Solenoid Operator

**This drawing is common to this certificate and BAS02ATEX2048, BAS21UKEX0642 and is held with IECEx BAS 10.0008.

20 Certificate History


Certificate No.	Date	Comments
Baseefa10ATEX0026	20 April 2010	The release of the prime certificate. The associated test and assessment against the requirements of EN 60079-0: 2006, EN 60079-1: 2007, EN 61241-0: 2004 and EN 61241-1: 2004 is documented in Test Report No. GB/BAS/ExTR10.0014/00.
Baseefa10ATEX0026/1	7 April 2011	Amendment to the diametral tolerance for the adjusting rod. Omission of drawing 0-SC0001 (previously submitted in error). Alternative design of pushbutton override cover assembly. Minor drawing variations. Documented in Test Report No. GB/BAS/ExTR11.0084/00
Baseefa10ATEX0026/2	8 July 2011	Alternative internal design to form the Pulse-Pulse Solenoid Operator. This unit has two windings with a combined rating of 20.5W. Amended designation for the solenoid housing material. Documented in Test Report No. GB/BAS/ExTR11.0123/00
Baseefa10ATEX0026/3	2 April 2012	Alternative label design incorporating the complete range of temperature class and ambient temperature markings provided for by this certificate. Documented in Test Report No. GB/BAS/ExTR12.0086/00

Certificate No.	Date	Comments
Baseefa10ATEX0026/4	2 December 2013	A re-designation of the Type FP Solenoid Operator, to the Type 77 Solenoid Operator. A satisfactory assessment against the requirements of the updated standards IEC 60079-0: 2011 and IEC 60079-31: 2008 (superseding IEC 61241), complete with a review of the marking. Introduction of an alternative aluminium housing and cover material. Documented in Test Report No. GB/BAS/ExTR13.0291/00
Baseefa10ATEX0026/5	29 July 2014	This issue permits existing information (for example on Schedule Drawings) to be replaced by the revised certificate holders address. No other changes may be made to the certified design. Documented in Test Report No. None.
Baseefa10ATEX0026/6	17 February 2015	Clarification of the Type name. The Type 77 comprises a stainless steel housing and the Type 27 comprises an aluminium housing. To allow the introduction of alternative seal materials. To allow the Type 77 Solenoid Operators having Serial numbers as defined in drawing number 0-SC0009 to be marked with Ex d IIB T6 Gb. Documented in Test Report No. GB/BAS/ExTR14.0317/00
Baseefa10ATEX0026/7	23 June 2016	Minor drawing changes not affecting certification. Documented in Test Report No. GB/BAS/ExTR16.0164/00
Baseefa10ATEX0026/8	16 March 2017	To allow the introduction of an alternative low power circuit. To allow for correction of the Type designation listed on the EU-Type Examination Certificate Baseefa10ATEX0026 To allow for correction of description to include the Pulse Pulse Unit. Documented in Test Report No. GB/BAS/ExTR17.0076/00
Baseefa10ATEX0026/9	20 July 2017	To allow the introduction of an alternative low power circuit. Documented in Test Report No. GB/BAS/ExTR17.0211/00
Baseefa10ATEX0026/10	3 January 2018	To introduce an alternative non-rotational mounting arrangement to attach the adaptor bushing via the coil holder to the enclosure housing. Identification of threaded entry holes on the enclosure wall. Documented in Test Report No. GB/BAS/ExTR17.0274/00
Baseefa10ATEX0026/11	7 March 2018	To introduce alternative terminal plate with a different grounding point design. To introduce optional certification marks in addition to the existing one to be included on to the certification label marking. Documented in Test Report No. GB/BAS/ExTR 18.0041/00
Baseefa10ATEX0026/12	12 July 2019	To assess the Type 27 and 77 Solenoid Operator against the standards EN IEC 60079-0:2018, EN 60079-1:2014 and EN 60079-31:2014 To permit minor drawing changes to the certification label that do not affect certification Documented in Test Report No. GB/BAS/ExTR19.0100/00


Certificate No.	Date	Comments
Baseefa10ATEX0026/13	14 July 2020	To introduce an alternative Detented Manual Over-Ride Lid (alternative spigoted cover), which allows the valve to be operated manually. Documented in Test Report No. GB/BAS/ExTR19.0341/00.
Baseefa10ATEX0026 – issue 14	11 February 2022	This issue of the certificate incorporates previously issued primary & supplementary certificates. To remove drawings 138-10, 138-10-K85, 0-S0252 and 0-S0254 transferring critical details to drawing 0-SC0003 revision 11. To remove drawing 0-SC0001. To add drawing 0-SL0068. To add an alternative encapsulant. To update the nameplate drawings to include UKEX details. Documented in Test Report No. GB/BAS/ExTR21.0158/00
Baseefa10ATEX0026 – issue 15	2 November 2022	This issue of the certificate incorporates previously issued primary & supplementary certificates. To add an alternative marking drawing with a different manufacturer branding. The assessment is documented in test report GB/BAS/ExTR22.0138/00
For drawings applicable to each issue, see original of that issue.		

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

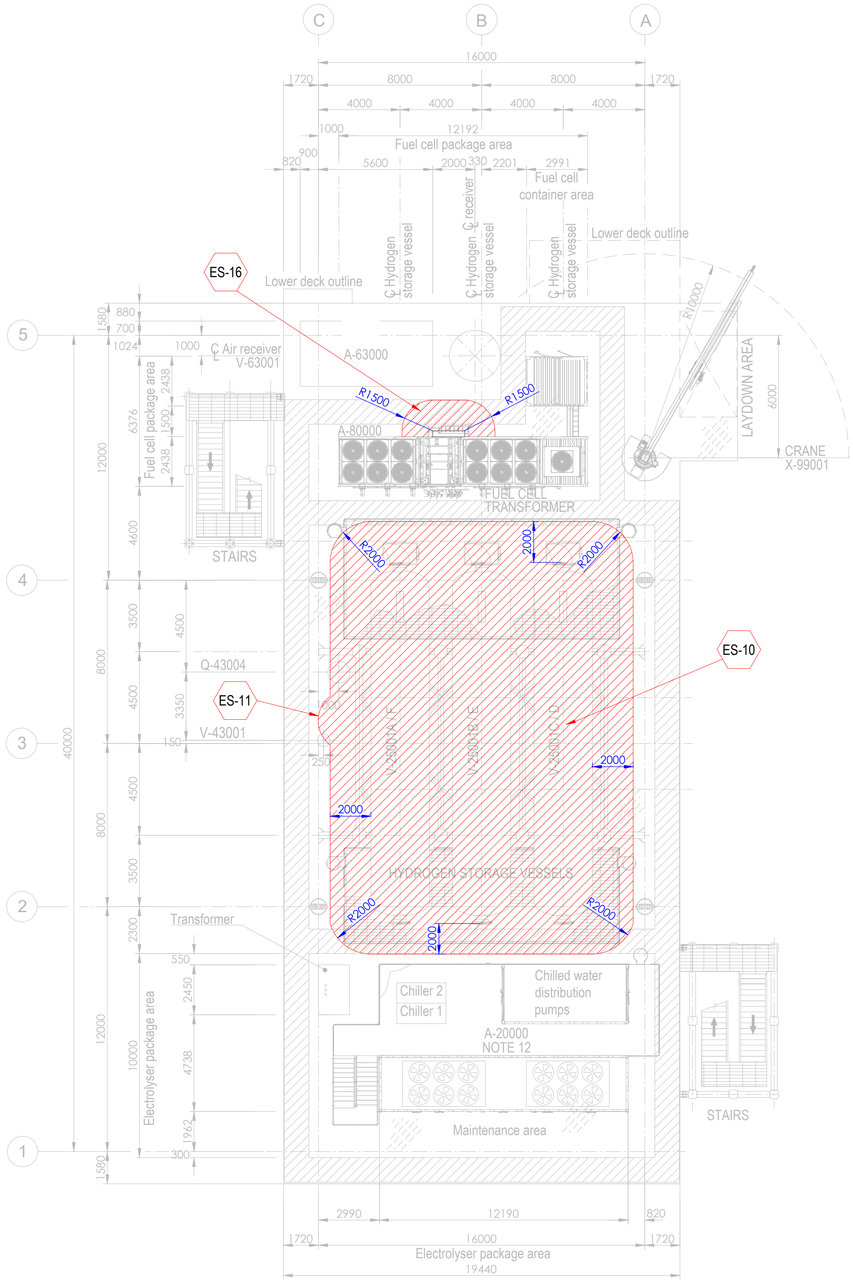


PLAN ON UPPER DECK
EL+30.310 T.O.S.

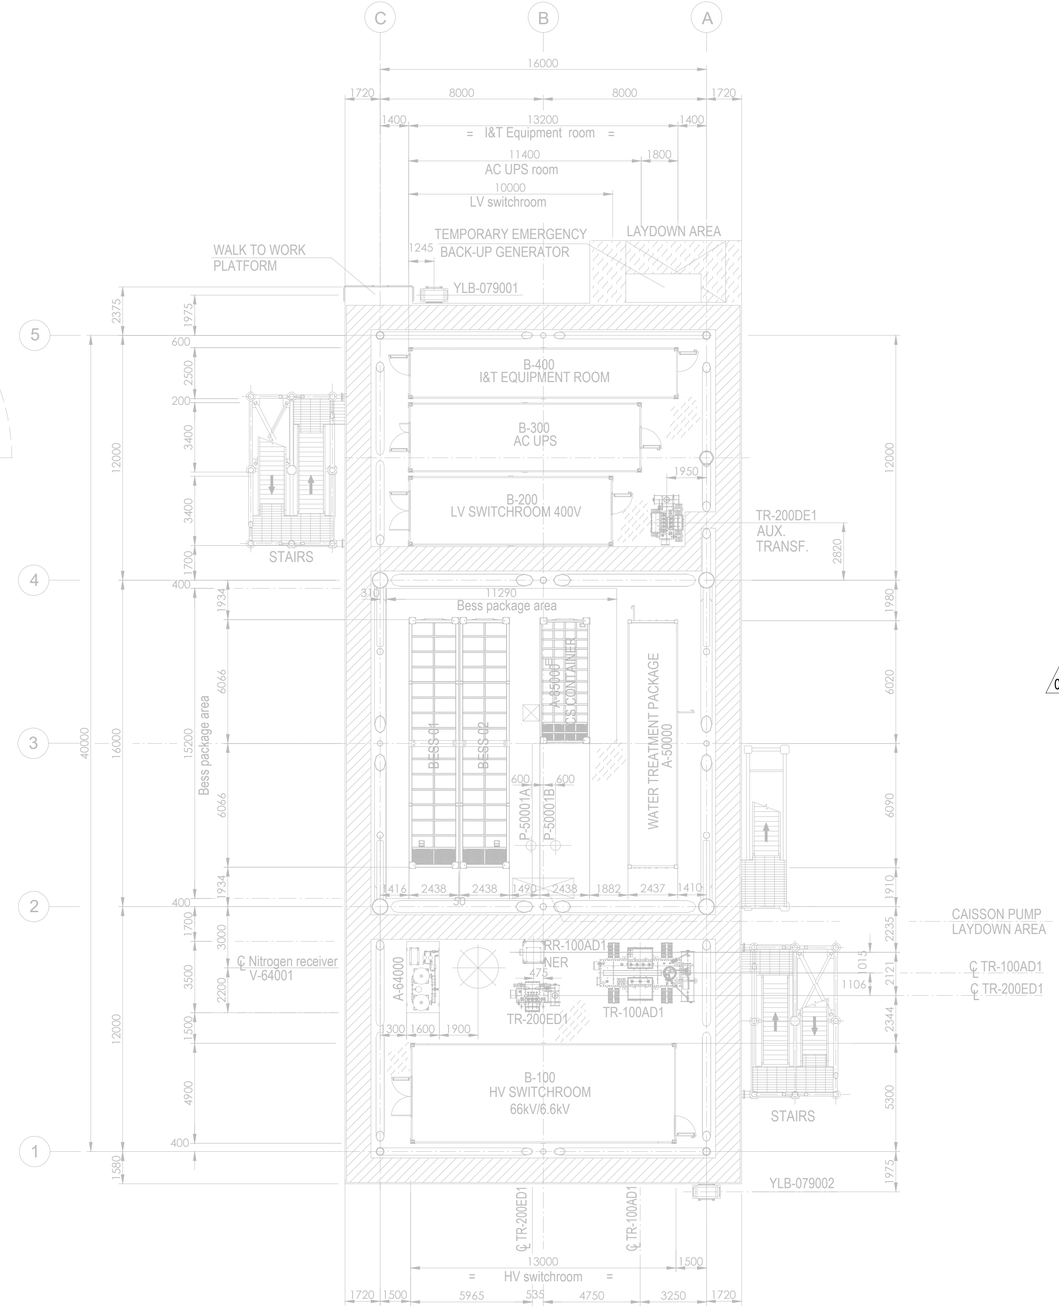

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

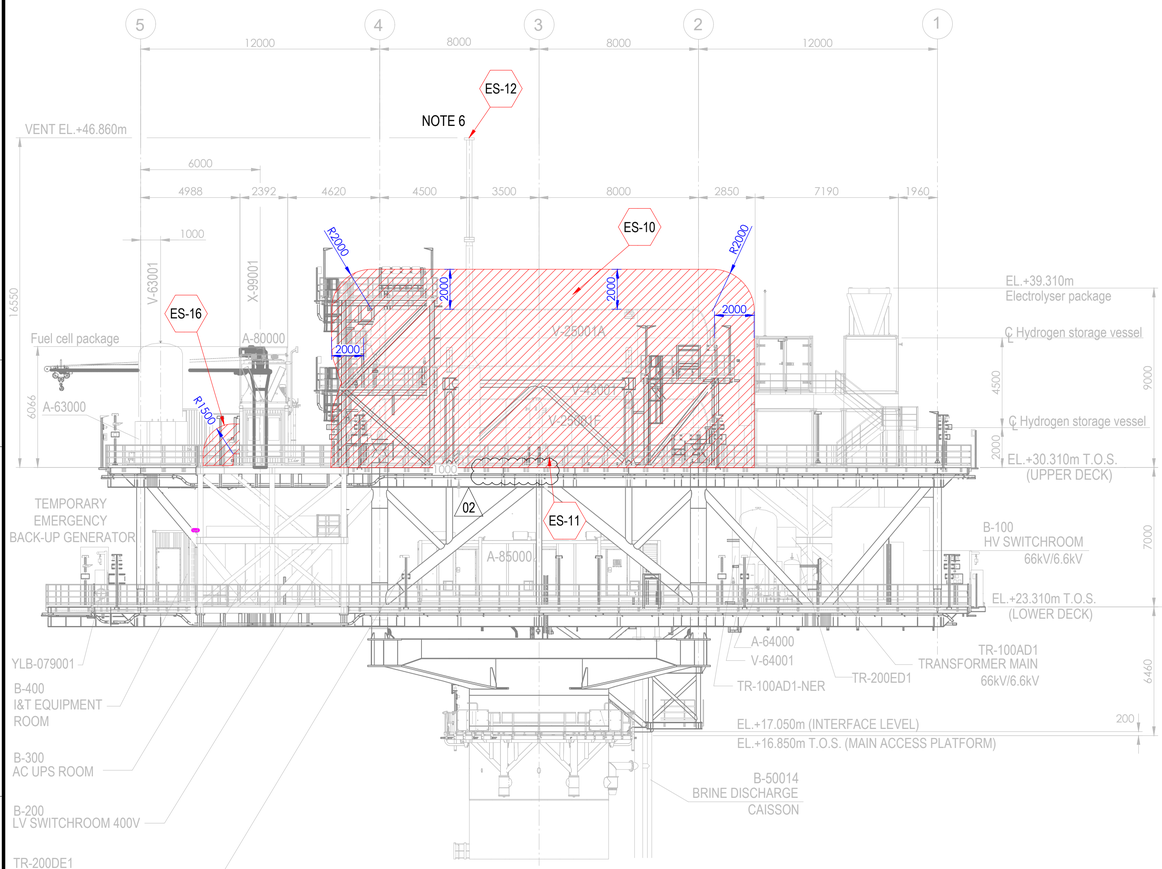



ELEVATION LOOKING EAST

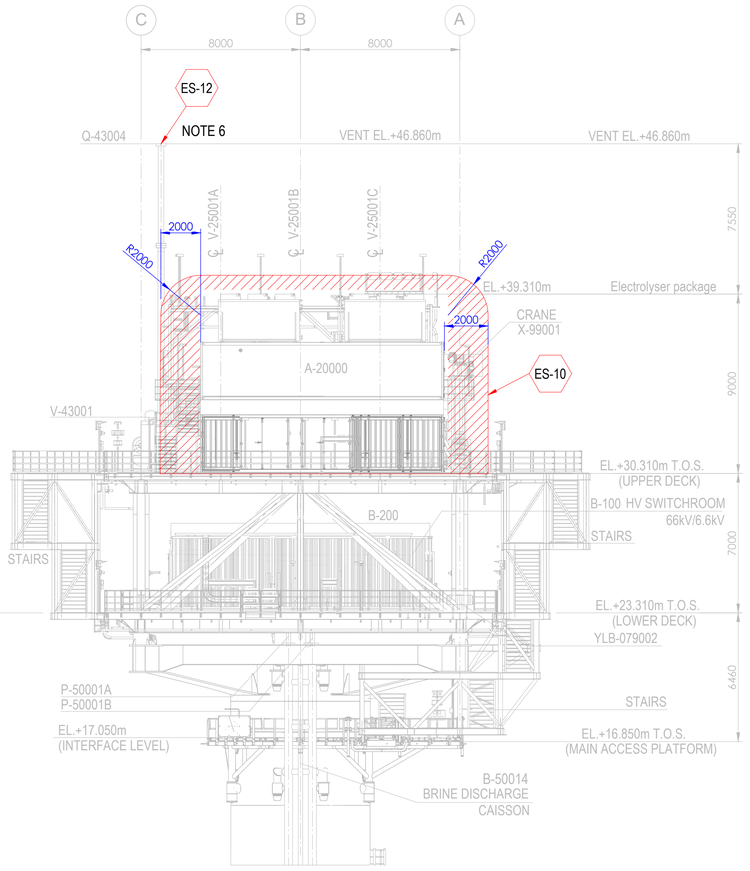

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

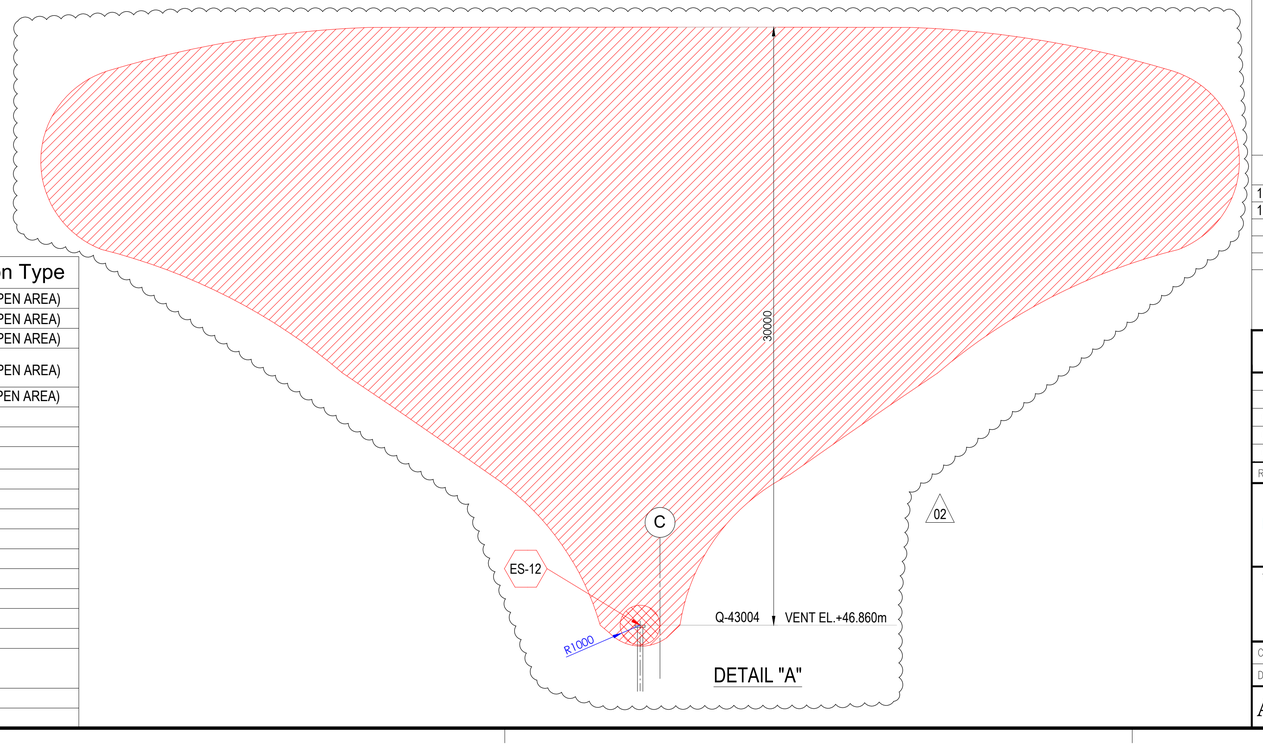



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-XY-017	: Solenoid Valve - Vessel V-25001E Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001722	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**	FL18524-8799				
Manufacturer	BIFOLD			**Model**	FP86P-77P				
Cert No.	Baseefa10ATEX0026			**Equipment Ambient Temp.**	-60°C to +40°C				
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66/67

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	OK	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		OK	
	Physical check	x	OK	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	OK	

ITEM	Tag	25-XY-017	: Solenoid Valve - Vessel V-25001E Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001722		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	OK	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	OK	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-XY-017	: Solenoid Valve - Vessel V-25001E Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001722	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type "nR" only)	x	NA	
71	Breathing operation is satisfactory (type "nR" only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for 'IS' Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Giovanni Tangianu	
Date	2025-01-28	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-28T07:49:55.566Z	PROVERLIS Digitaly signed by Giovanni Tangianu 2025-01-29T13:44:21.598Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

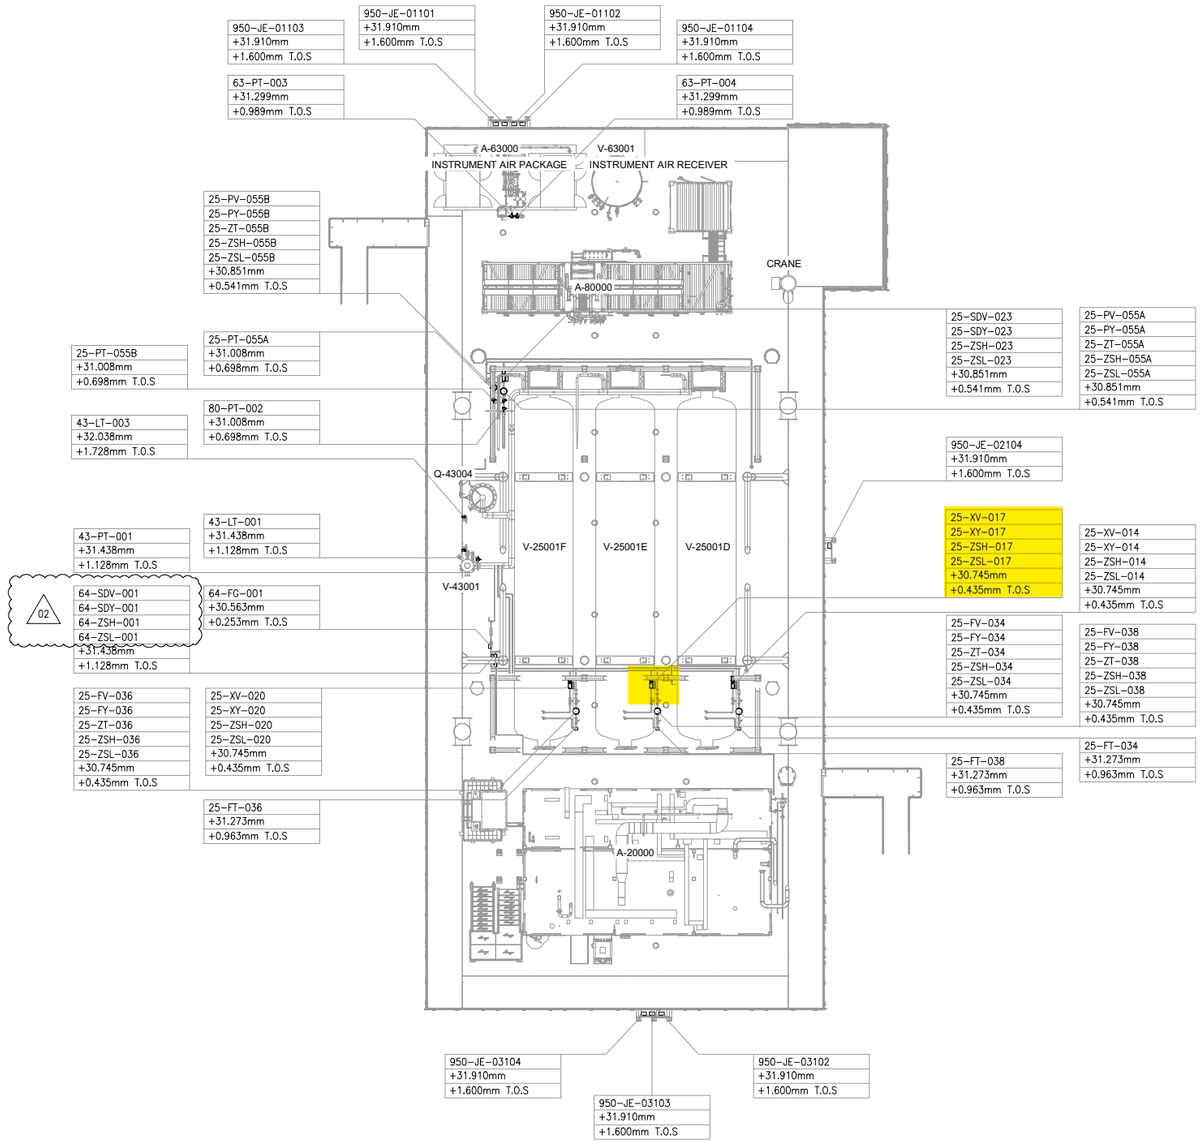


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 E

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

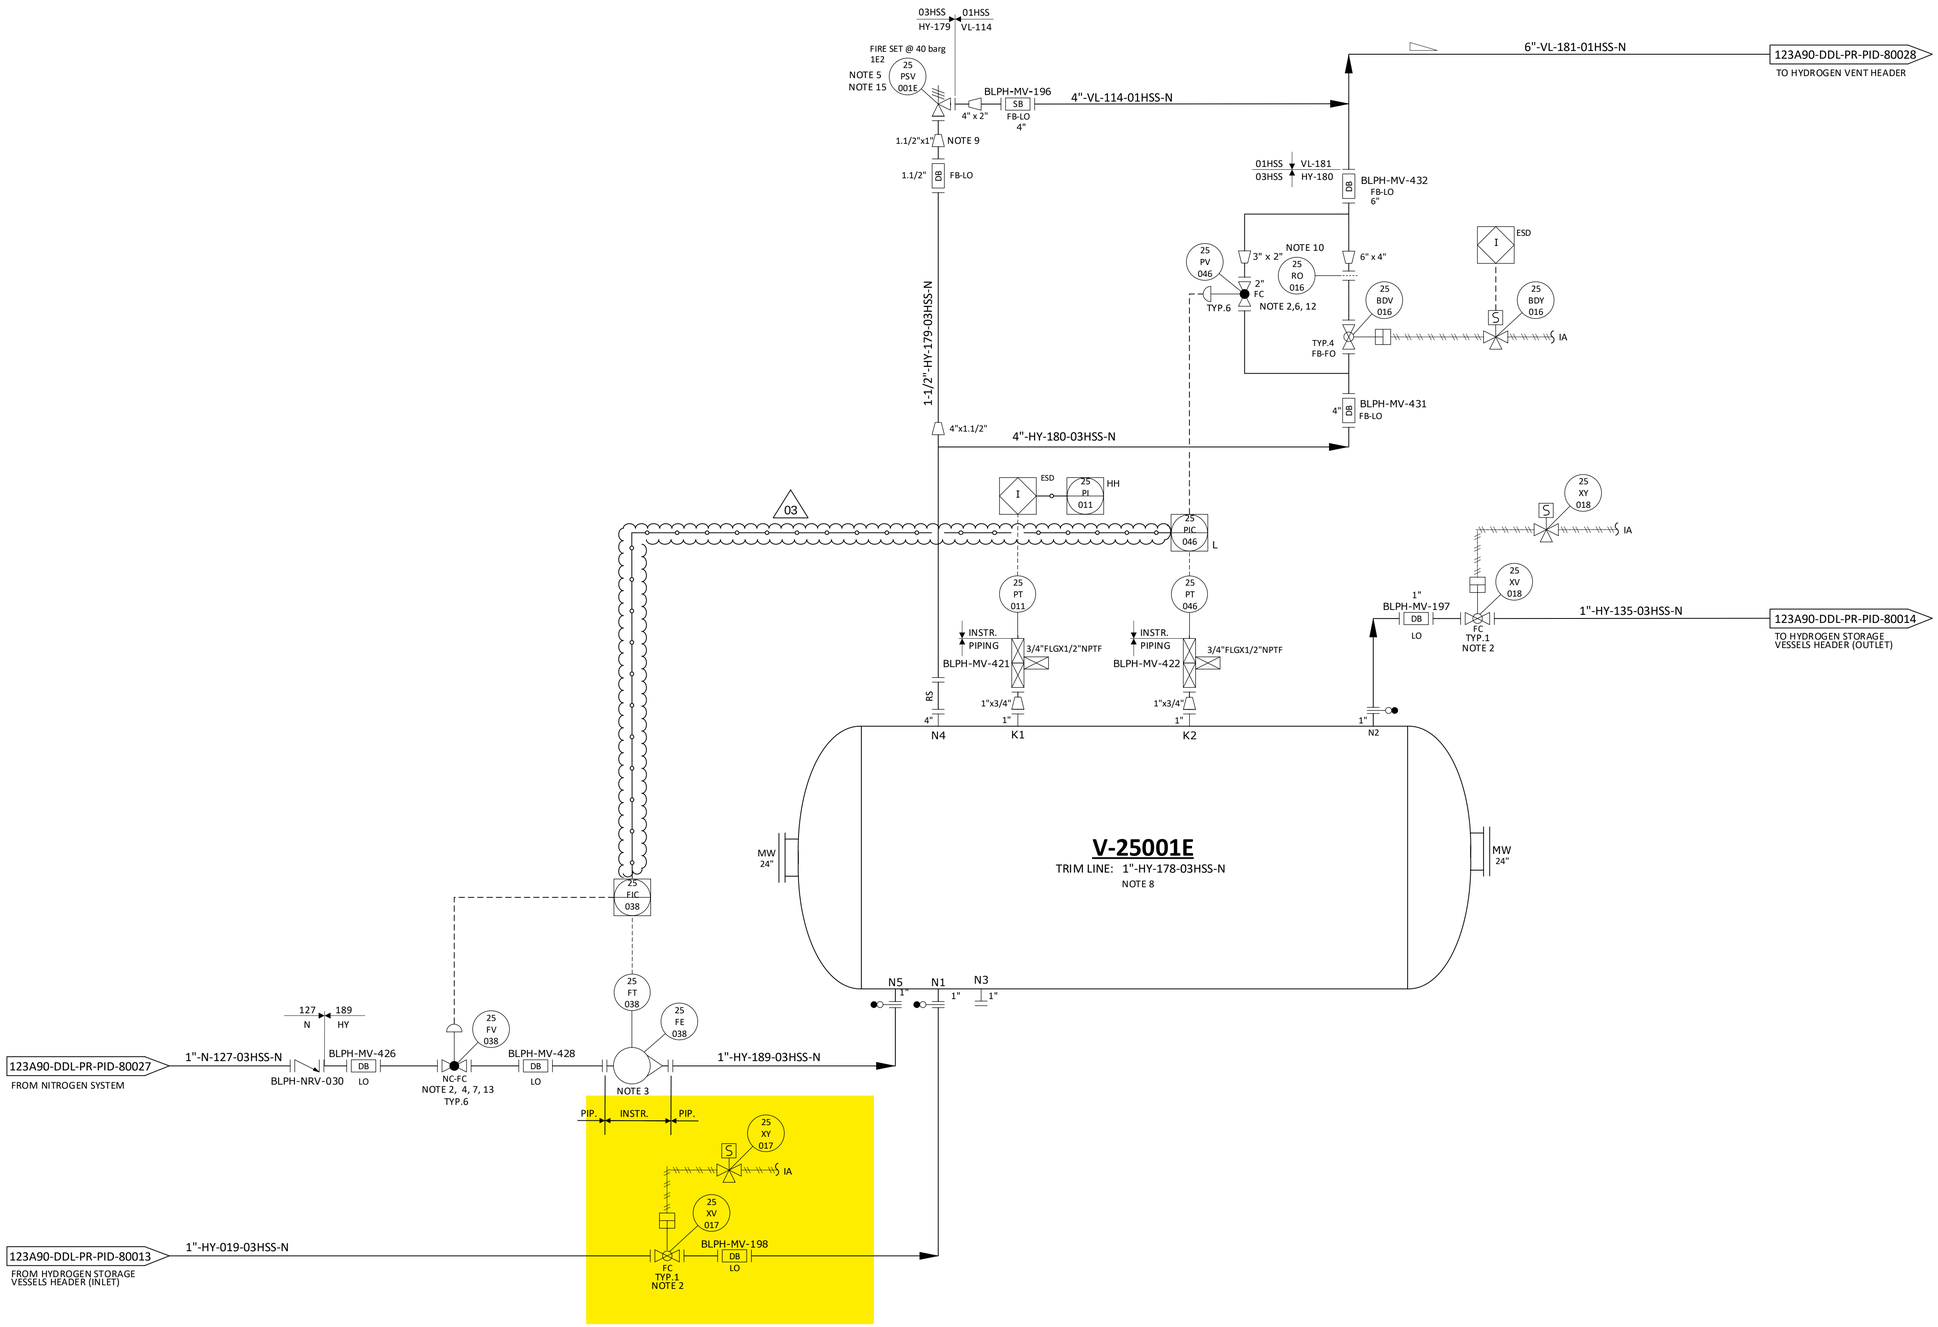

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-038) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-046 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-046 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-038 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-046 HAS FAILED TO CLOSE.
15. 25-PSV-001E SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL E

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE		
A1	DRAWING NO. 123A90-DDL-PR-PID-80019			SHEET 001	REV. 03


File Name = FILE_NAME

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-13002	No.	MARSHALLING CABINET B400-PCS-002

<01>

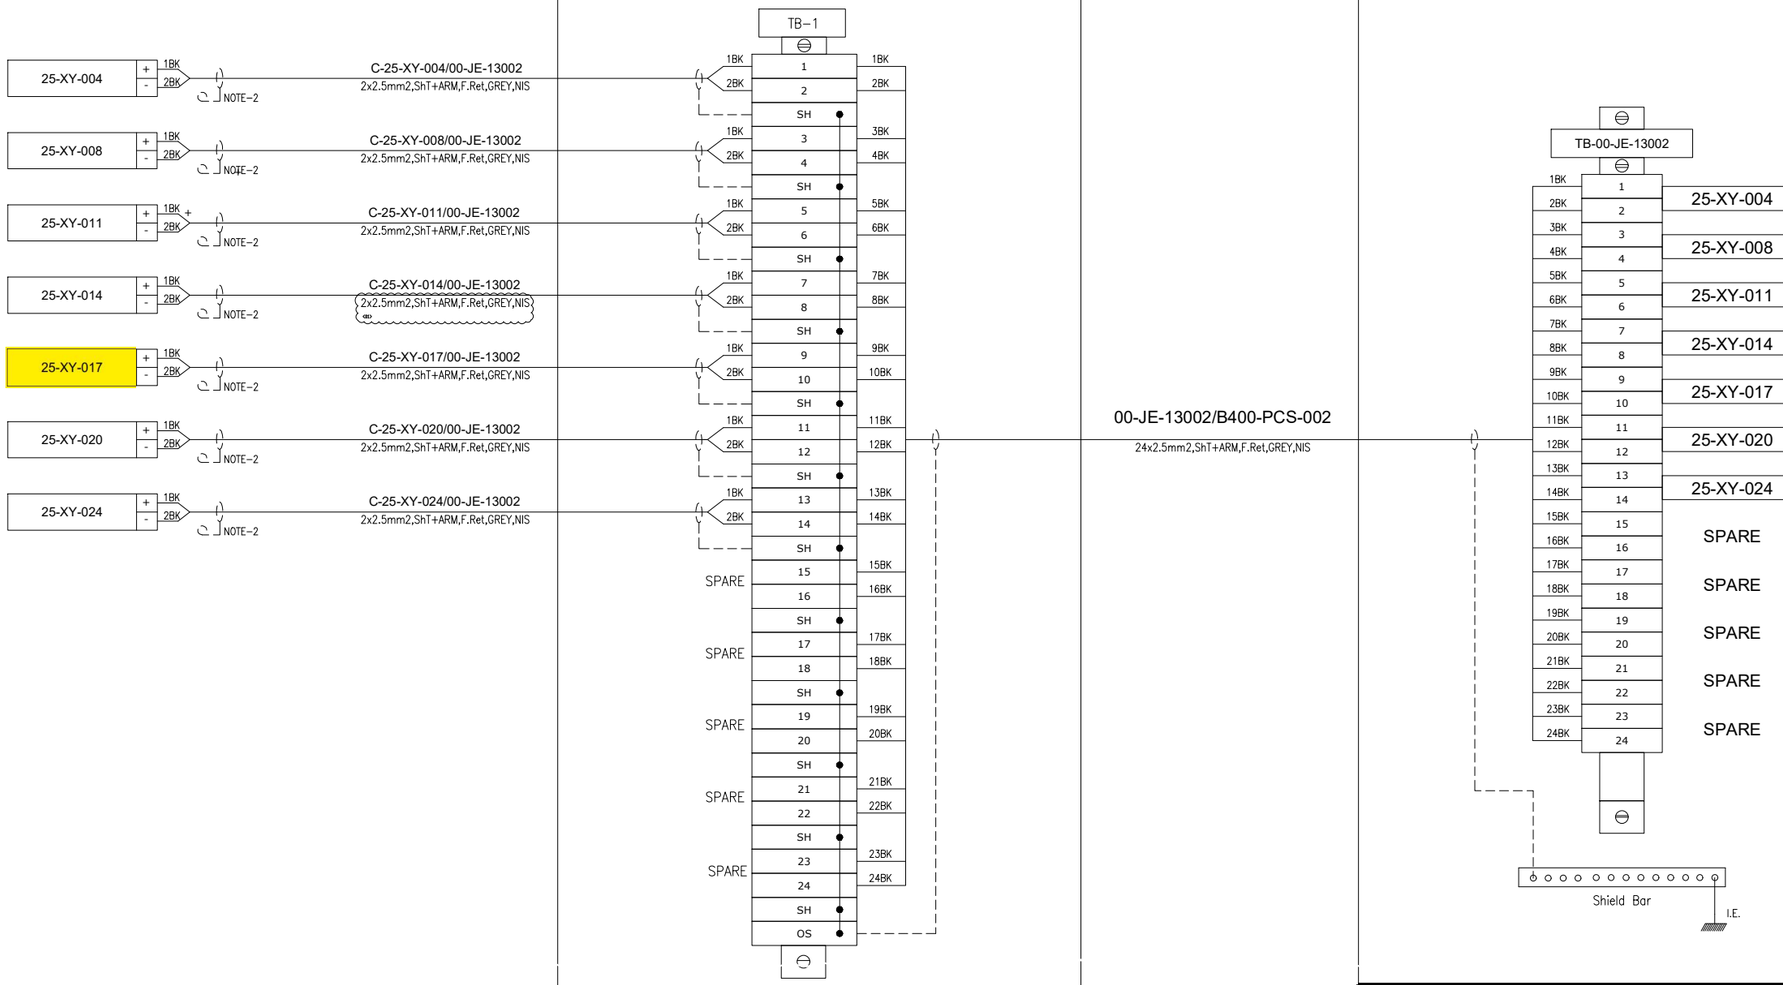

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO


TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-13002

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024
A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 029	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

E33

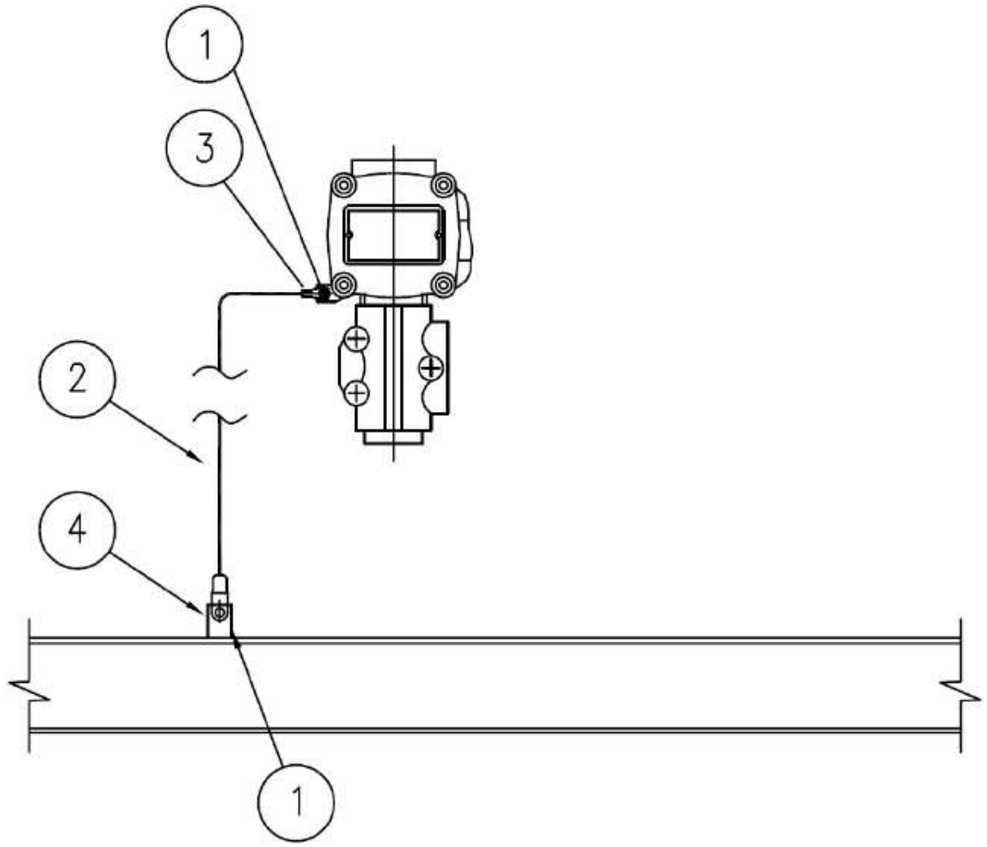

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-EL-DD-20090
REV.: 2_I | DATE: 07/11/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

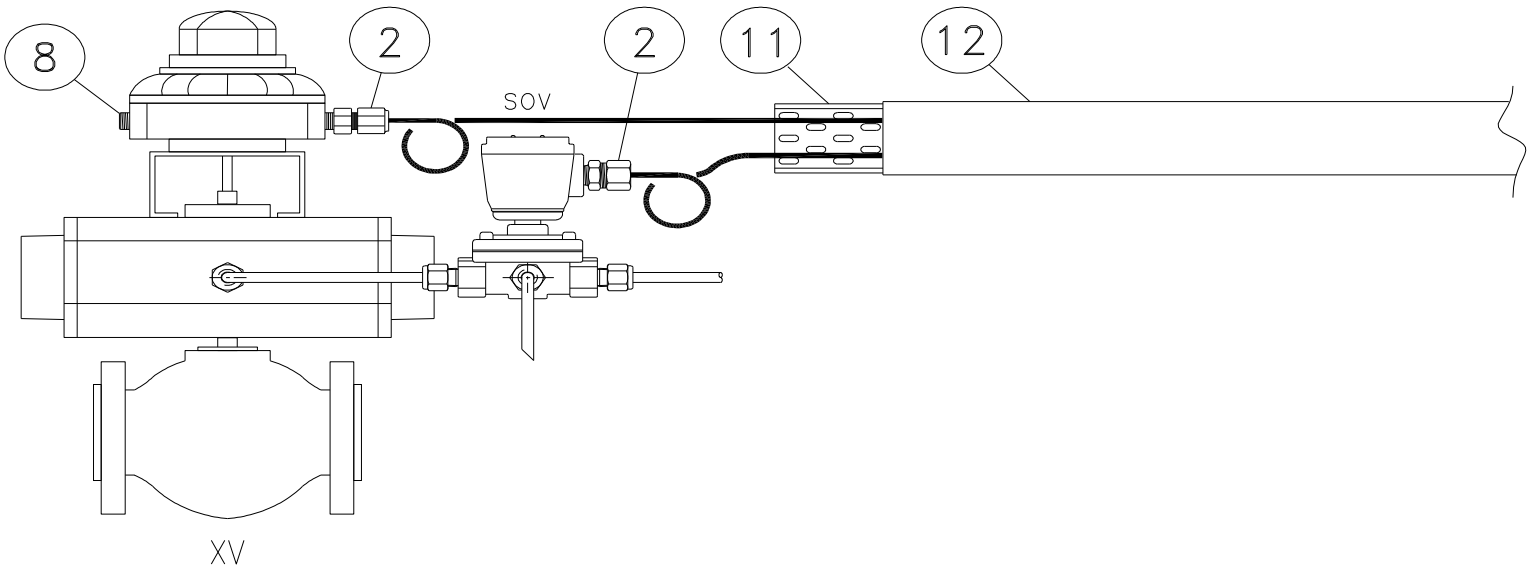

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_B	06/11/24	G.Randi

ROSETTI MARINO SpA


NOTE:

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

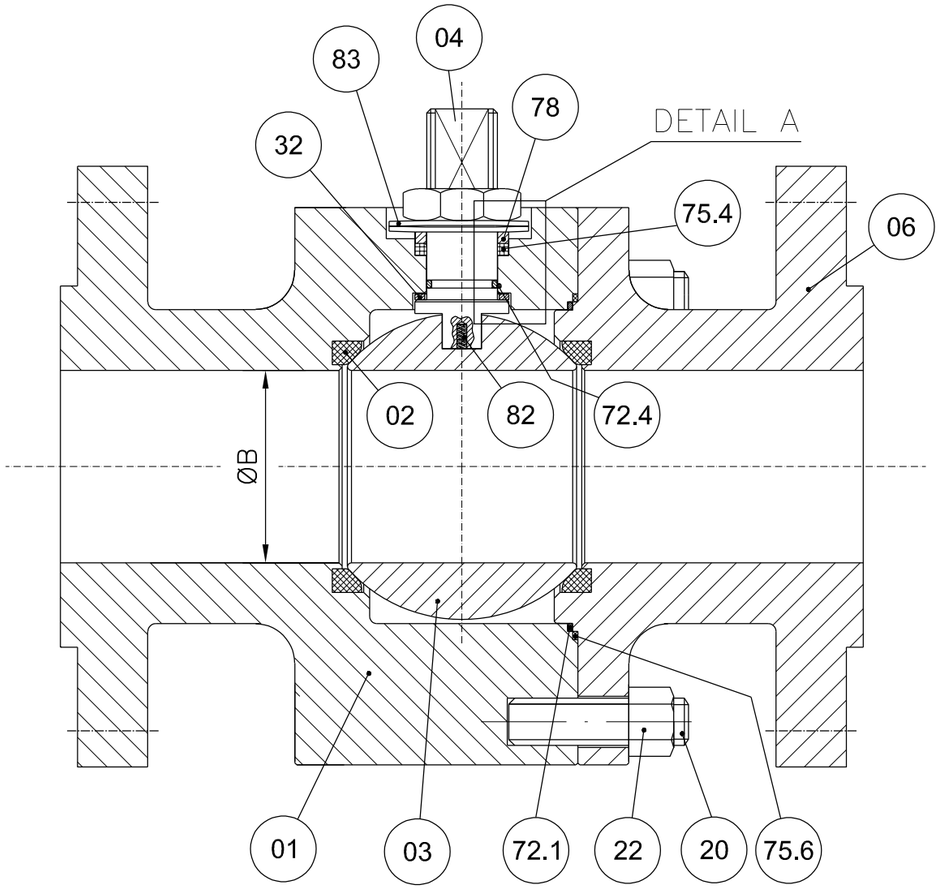


DETAIL A




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: D240062-08 — Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-017		25
	2	Service				HYDROGEN STORAGE TANK V-25001E INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80019		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-019-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-017 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-017 (9, 17) - Soldo SS		25-ZSH-017 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

94	IFR	25-XV-009	floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR	25-XV-011	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR	25-XV-012	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR	25-XV-014	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR	25-XV-015	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR	25-XV-017	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR	25-XV-018	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

1 # EU - TYPE EXAMINATION CERTIFICATE

2 **Equipment or Protective System Intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU**

3 EU - Type Examination Certificate Number: **Baseefa10ATEX0026 – Issue 15**

4 Product: **Type 27 & 77 Solenoid Operator**

5 Manufacturer: **Bifold Fluidpower Limited**

6 Address: **Chadderton, Oldham, Greater Manchester, OL9 9XA, UK**

7 This re-issued certificate extends EU Type Examination Certificate No. **Baseefa10ATEX0026** to apply to product designed and constructed in accordance with the specification set out in the Schedule of the said certificate but having any variations specified in the Schedule attached to this certificate and the documents therein referred to.

8 SGS Fimko Oy, Notified Body number 0598, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this product has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II to the Directive.

8.1 The original certificate was issued by SGS Baseefa Ltd (UK Notified Body 1180). It, and any supplements previously issued by SGS Baseefa Ltd have been transferred to the supervision of SGS Fimko Oy (EU Notified Body 0598). The original certificate number is retained.

The examination and test results are recorded in confidential Report No. **See Certificate History**

9 Compliance with the Essential Health and Safety Requirements has been assured by compliance with:

EN IEC 60079-0:2018 **EN 60079-1:2014** **EN 60079-31:2014**

except in respect of those requirements listed at item 18 of the Schedule.

10 If the sign "X" is placed after the certificate number, it indicates that the product is subject to the Specific Conditions of Use specified in the schedule to this certificate.

11 This EU - TYPE EXAMINATION CERTIFICATE relates only to the design and construction of the specified product. Further requirements of the Directive apply to the manufacturing process and supply of this product. These are not covered by this certificate.

12 The marking of the product shall include the following:

Ⓔx II 2GD **Ex db IIC T6 Gb (Tamb -60°C to +40°C)***
Ex tb IIIC T85°C Db (Tamb -60°C to +40°C)* IP66/67
***alternative Temperature class/Ambient combinations may also be marked, see schedule**

SGS Fimko Oy Customer Reference No. **1688** Project File No. **22/0377**

This document is issued by the Company subject to their General Conditions for Certification Services accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx . Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained herein reflects the Company's findings at the time of their intervention only and within the limits of Client's instructions, if any. It does not necessarily indicate that the equipment may be used in particular industries or circumstances. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, schedule included, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

SGS Fimko Oy
Takomotie 8
FI-00380 Helsinki, Finland
Telephone +358 (0)9 696 361
e-mail **sgs.fimko@sgs.com**
web site **www.sgs.fi**
Business ID 0978538-5 Member of the SGS Group (SGA SA)

Mikko Välimäki
Authorised Signatory for SGS Fimko Oy

13 **Schedule**

14 **Certificate Number Baseefa10ATEX0026 – Issue 15**

15 Description of Product

The Type 77 and Type 27 Solenoid Operators are rated at up to 240Vac or dc and have a maximum power dissipation of 14W. The Type 77 Solenoid Operator comprises a stainless steel cylindrical enclosure, whereas the Type 27 comprises an aluminium cylindrical enclosure, both have a spigot cover fitted with a silicone rubber seal.

In addition to the above there is also a two winding alternative designated the 'Pulse-Pulse Solenoid operator' which has a maximum combined coil rating limited to 20.5W.

The base of the enclosure is fitted with an adaptor bush which incorporates venting holes to allow the unit to be fitted onto a valve assembly rated up to a maximum pneumatic pressure of 10 bar. For hydraulic valves and valves with pneumatic pressures greater than 10 bar the top of the valve is provided with additional venting holes.

Internally the unit is fitted with a coil holder, coil and armature onto which is mounted an adjusting rod which forms a cylindrical joint with the adaptor bush and operates the valve when the solenoid is activated.

The cover may be fitted with a pushbutton or a rotary operator which can be used to operate the valve manually either momentarily or permanently.

The cover is secured using four stainless steel socket head cap screws grade of grade A4-70.

The equipment is marked:

Ex db IIC T6 Gb (Tamb -60°C to +40°C)*

Ex tb IIIC T85°C Db (Tamb -60°C to +40°C)* IP66/67

*The following alternative Temperature class/Ambient combinations may also be marked

T5/T100°C (Tamb -60°C to +55°C)

T4/T135°C (Tamb -60°C to +90°C)

An M20 or ½" NPT cable entry hole is provided as specified on the certified drawings for the accommodation of suitable IECEx Equipment (not a Component) certified cable entry device, with or without the interposition of a suitable IECEx Equipment certified (not a Component) flameproof thread adapter.

An M20 cable entry is provided unless the marking 'K85' appears in the Model No. marked on the label, in which case a ½" NPT cable entry hole is provided.

16 Report Number

See Certificate History

17 Specific Conditions of Use

None

18 Essential Health and Safety Requirements

In addition to the Essential Health and Safety Requirements (EHSRs) covered by the standards listed at item 9, the following are considered relevant to this product:

Clause	Subject
1.4.1	External effects
1.4.2	Aggressive substances etc.

19 Drawings and Documents

New drawings submitted for this issue of certificate:

Number	Issue	Date	Description
0-SL0070	0	2022.06.30	TYPE 27 & 77 SOLENOID LABEL - ROTORK BRAND - L240

Current drawings which remain unaffected by this issue:

Number	Issue	Date	Description
0-SC0004	1	09.07.20	Solenoid Lid Options G.A
0-SC0006	0	17.04.09	Latched Energised and Tamperproof Solenoid Options
0-SC0008	1	29.03.11	Override Cover Assembly
0-SC0009	0	12.02.15	Serial Numbers IIB, Type 77
**0-GA0870	0	07.11.17	General Arrangement L209 Variant – Fixed Head Operator
0-SC0003	11	20.09.21	Type 27 and 77 Solenoid Operator
0-SC0007	5	24.11.21	Sol. Operator Pulse-Pulse.
0-SL0056	4	13.01.22	Type 27 & 77 Solenoid housing label Ex d
0-SL0058	5	2022.02.07	Type 27 & 77 Solenoid housing label Ex d
0-SL0068	0	2022.01.17	Label Type 27 and 77 Solenoid Operator

**This drawing is common to this certificate and BAS02ATEX2048, BAS21UKEX0642 and is held with IECEx BAS 10.0008.

20 Certificate History

Certificate No.	Date	Comments
Baseefa10ATEX0026	20 April 2010	The release of the prime certificate. The associated test and assessment against the requirements of EN 60079-0: 2006, EN 60079-1: 2007, EN 61241-0: 2004 and EN 61241-1: 2004 is documented in Test Report No. GB/BAS/ExTR10.0014/00.
Baseefa10ATEX0026/1	7 April 2011	Amendment to the diametral tolerance for the adjusting rod. Omission of drawing 0-SC0001 (previously submitted in error). Alternative design of pushbutton override cover assembly. Minor drawing variations. Documented in Test Report No. GB/BAS/ExTR11.0084/00
Baseefa10ATEX0026/2	8 July 2011	Alternative internal design to form the Pulse-Pulse Solenoid Operator. This unit has two windings with a combined rating of 20.5W. Amended designation for the solenoid housing material. Documented in Test Report No. GB/BAS/ExTR11.0123/00
Baseefa10ATEX0026/3	2 April 2012	Alternative label design incorporating the complete range of temperature class and ambient temperature markings provided for by this certificate. Documented in Test Report No. GB/BAS/ExTR12.0086/00


Certificate No.	Date	Comments
Baseefa10ATEX0026/4	2 December 2013	A re-designation of the Type FP Solenoid Operator, to the Type 77 Solenoid Operator. A satisfactory assessment against the requirements of the updated standards IEC 60079-0: 2011 and IEC 60079-31: 2008 (superseding IEC 61241), complete with a review of the marking. Introduction of an alternative aluminium housing and cover material. Documented in Test Report No. GB/BAS/ExTR13.0291/00
Baseefa10ATEX0026/5	29 July 2014	This issue permits existing information (for example on Schedule Drawings) to be replaced by the revised certificate holders address. No other changes may be made to the certified design. Documented in Test Report No. None.
Baseefa10ATEX0026/6	17 February 2015	Clarification of the Type name. The Type 77 comprises a stainless steel housing and the Type 27 comprises an aluminium housing. To allow the introduction of alternative seal materials. To allow the Type 77 Solenoid Operators having Serial numbers as defined in drawing number 0-SC0009 to be marked with Ex d IIB T6 Gb. Documented in Test Report No. GB/BAS/ExTR14.0317/00
Baseefa10ATEX0026/7	23 June 2016	Minor drawing changes not affecting certification. Documented in Test Report No. GB/BAS/ExTR16.0164/00
Baseefa10ATEX0026/8	16 March 2017	To allow the introduction of an alternative low power circuit. To allow for correction of the Type designation listed on the EU-Type Examination Certificate Baseefa10ATEX0026 To allow for correction of description to include the Pulse Pulse Unit. Documented in Test Report No. GB/BAS/ExTR17.0076/00
Baseefa10ATEX0026/9	20 July 2017	To allow the introduction of an alternative low power circuit. Documented in Test Report No. GB/BAS/ExTR17.0211/00
Baseefa10ATEX0026/10	3 January 2018	To introduce an alternative non-rotational mounting arrangement to attach the adaptor bushing via the coil holder to the enclosure housing. Identification of threaded entry holes on the enclosure wall. Documented in Test Report No. GB/BAS/ExTR17.0274/00
Baseefa10ATEX0026/11	7 March 2018	To introduce alternative terminal plate with a different grounding point design. To introduce optional certification marks in addition to the existing one to be included on to the certification label marking. Documented in Test Report No. GB/BAS/ExTR 18.0041/00
Baseefa10ATEX0026/12	12 July 2019	To assess the Type 27 and 77 Solenoid Operator against the standards EN IEC 60079-0:2018, EN 60079-1:2014 and EN 60079-31:2014 To permit minor drawing changes to the certification label that do not affect certification Documented in Test Report No. GB/BAS/ExTR19.0100/00

Certificate No.	Date	Comments
Baseefa10ATEX0026/13	14 July 2020	To introduce an alternative Detented Manual Over-Ride Lid (alternative spigoted cover), which allows the valve to be operated manually. Documented in Test Report No. GB/BAS/ExTR19.0341/00.
Baseefa10ATEX0026 – issue 14	11 February 2022	This issue of the certificate incorporates previously issued primary & supplementary certificates. To remove drawings 138-10, 138-10-K85, 0-S0252 and 0-S0254 transferring critical details to drawing 0-SC0003 revision 11. To remove drawing 0-SC0001. To add drawing 0-SL0068. To add an alternative encapsulant. To update the nameplate drawings to include UKEX details. Documented in Test Report No. GB/BAS/ExTR21.0158/00
Baseefa10ATEX0026 – issue 15	2 November 2022	This issue of the certificate incorporates previously issued primary & supplementary certificates. To add an alternative marking drawing with a different manufacturer branding. The assessment is documented in test report GB/BAS/ExTR22.0138/00
For drawings applicable to each issue, see original of that issue.		


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

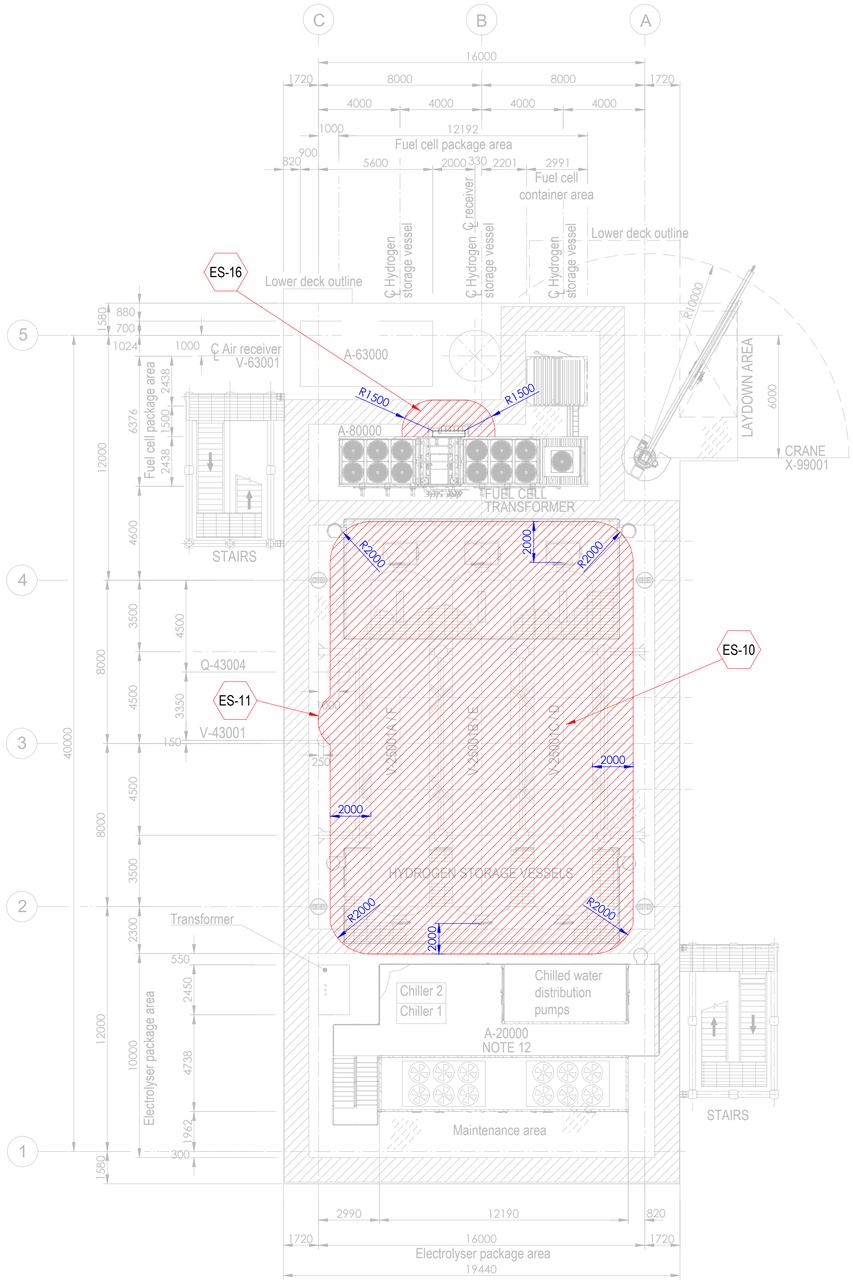


PLAN ON UPPER DECK
EL+30.310 T.O.S.

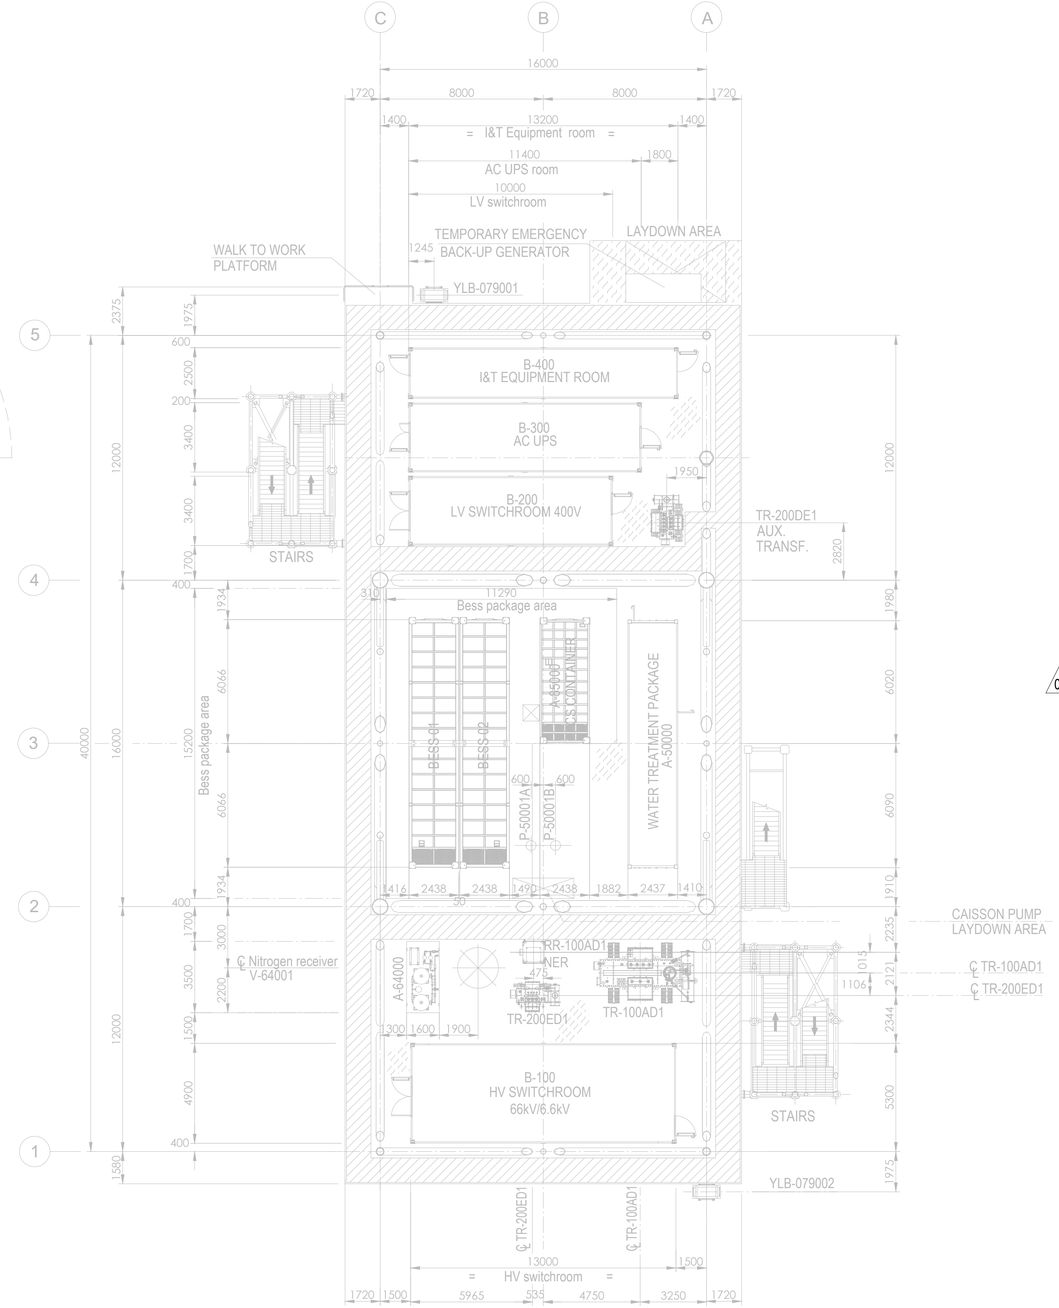

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

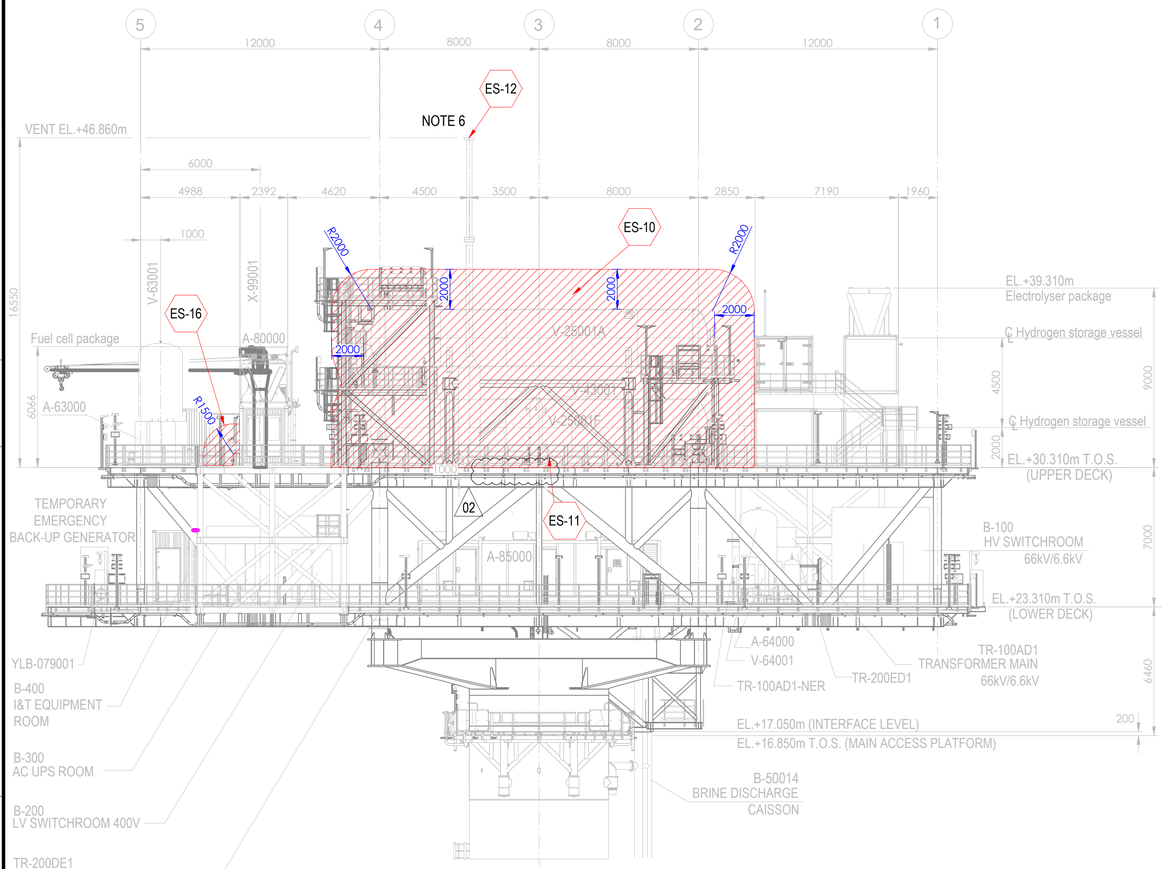



ELEVATION LOOKING EAST

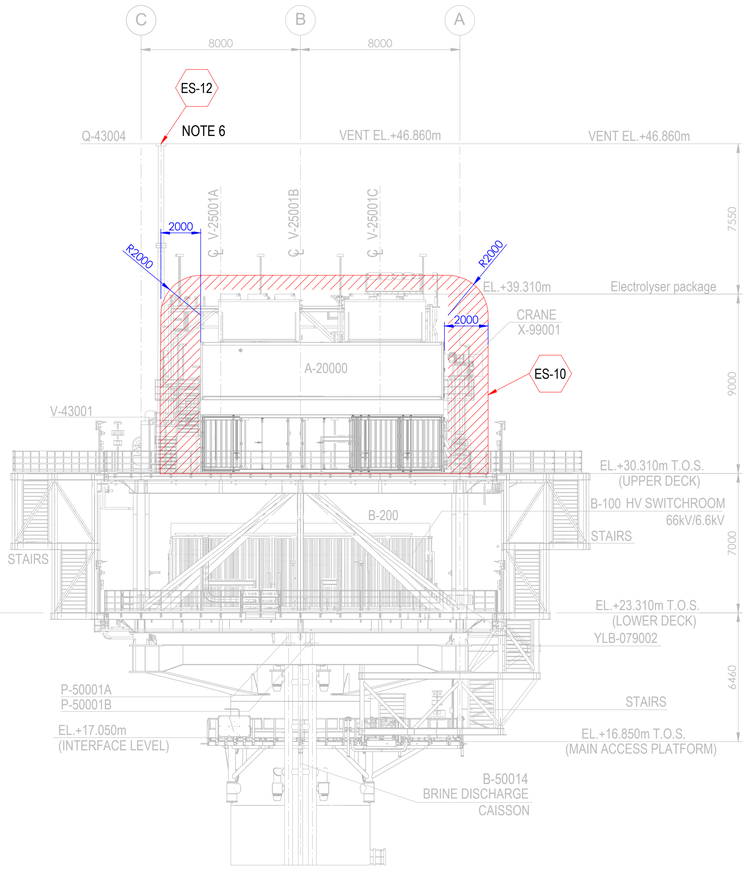

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

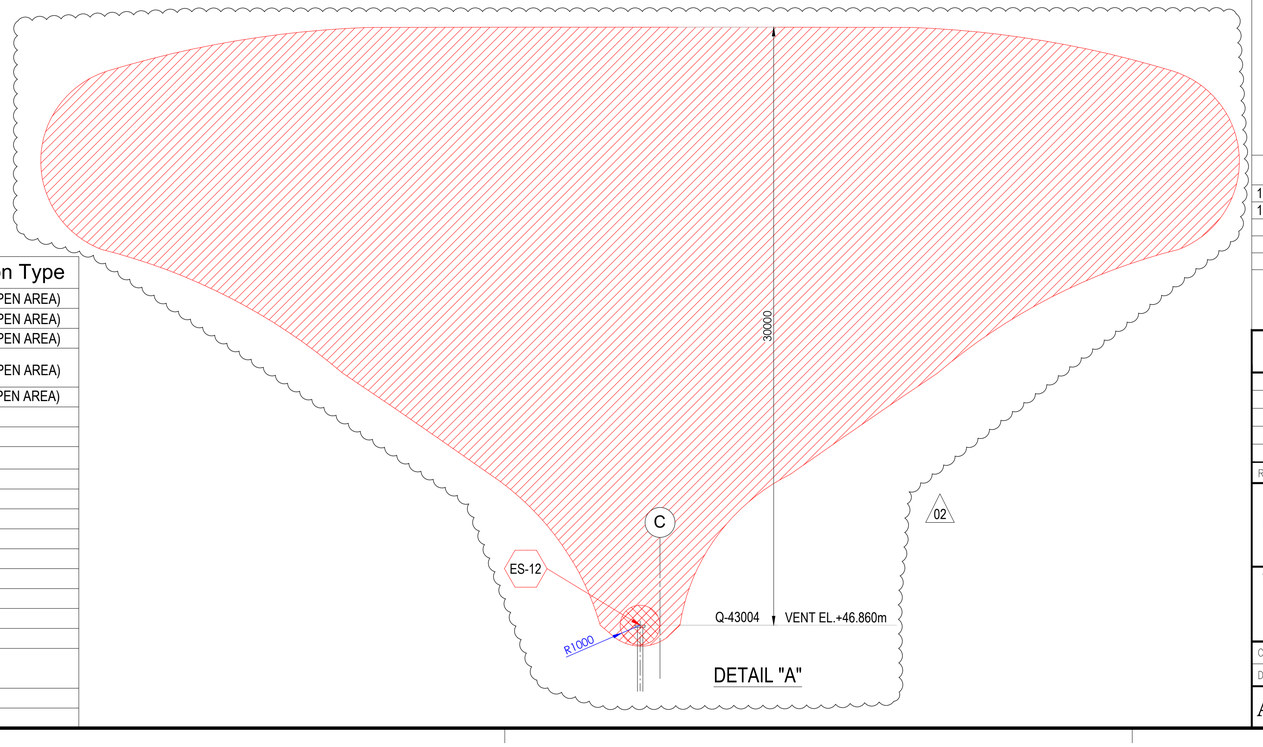



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-XY-020	: Solenoid Valve - Vessel V-25001F Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80020		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001724	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		FL18524-8794			
Manufacturer	BIFOLD			**Model**		FP86P-77A			
Cert No.	Baseefa10ATEX0026			**Equipment Ambient Temp.**		-60°C to +40°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66/67

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	OK	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		OK	
	Physical check	x	OK	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	OK	

ITEM	Tag	25-XY-020	: Solenoid Valve - Vessel V-25001F Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80020
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001724		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	OK	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	OK	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-XY-020	: Solenoid Valve - Vessel V-25001F Hydrogen Inlet		Dwg	123A90-DDL-PR-PID-80020	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001724	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
	Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Giovanni Tangianu	
Date	2025-01-25	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-25T13:53:44.374Z	PROVERLIS Digitaly signed by Giovanni Tangianu 2025-01-29T13:51:47.957Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

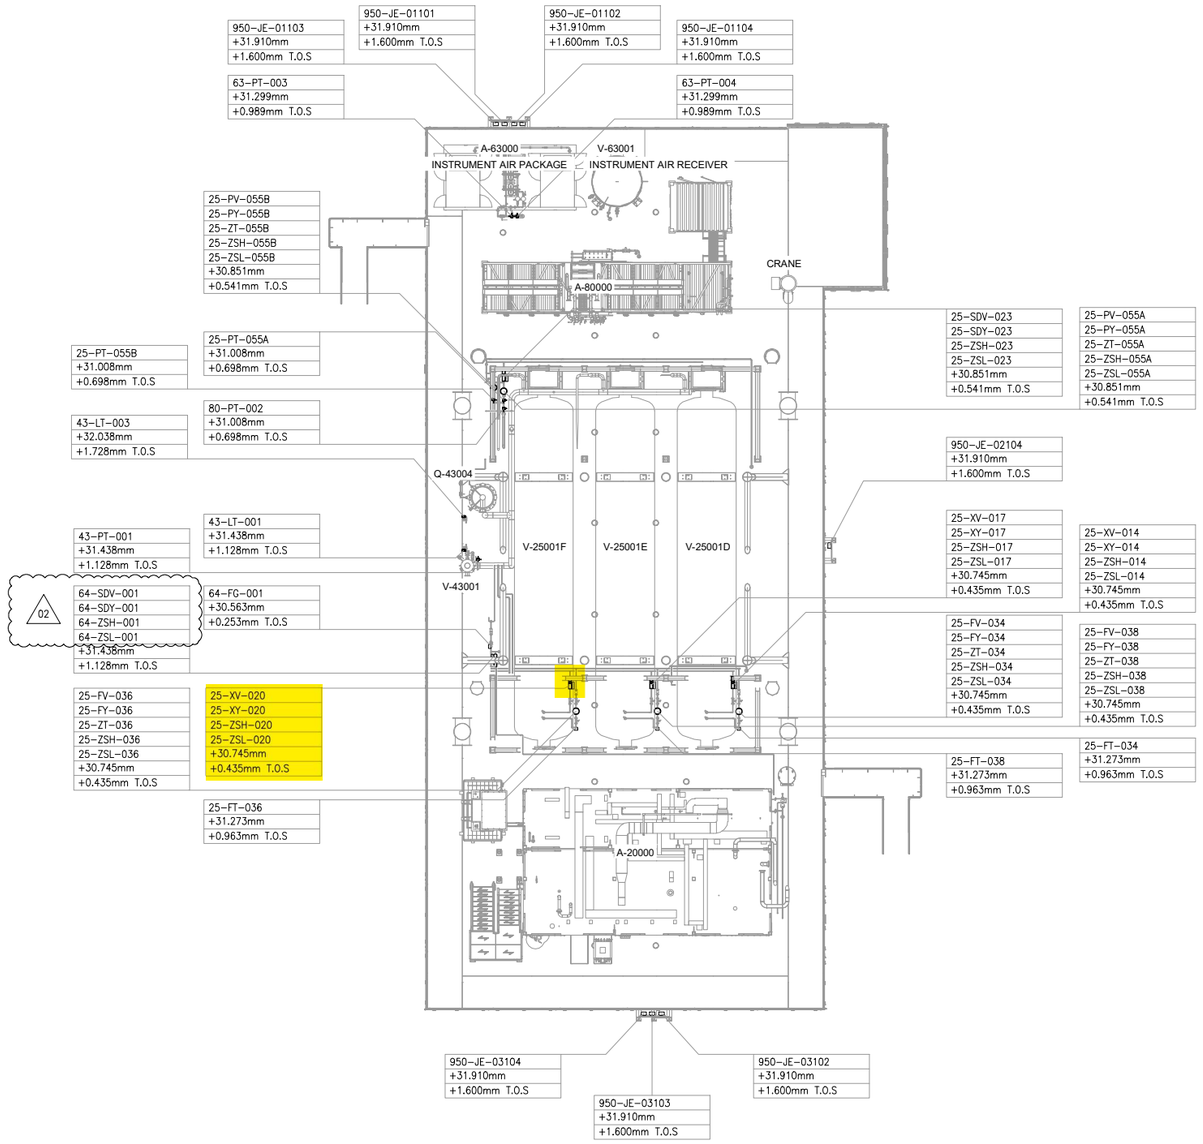


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90-DDL-IN-DL-40081	001	02

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001_F

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

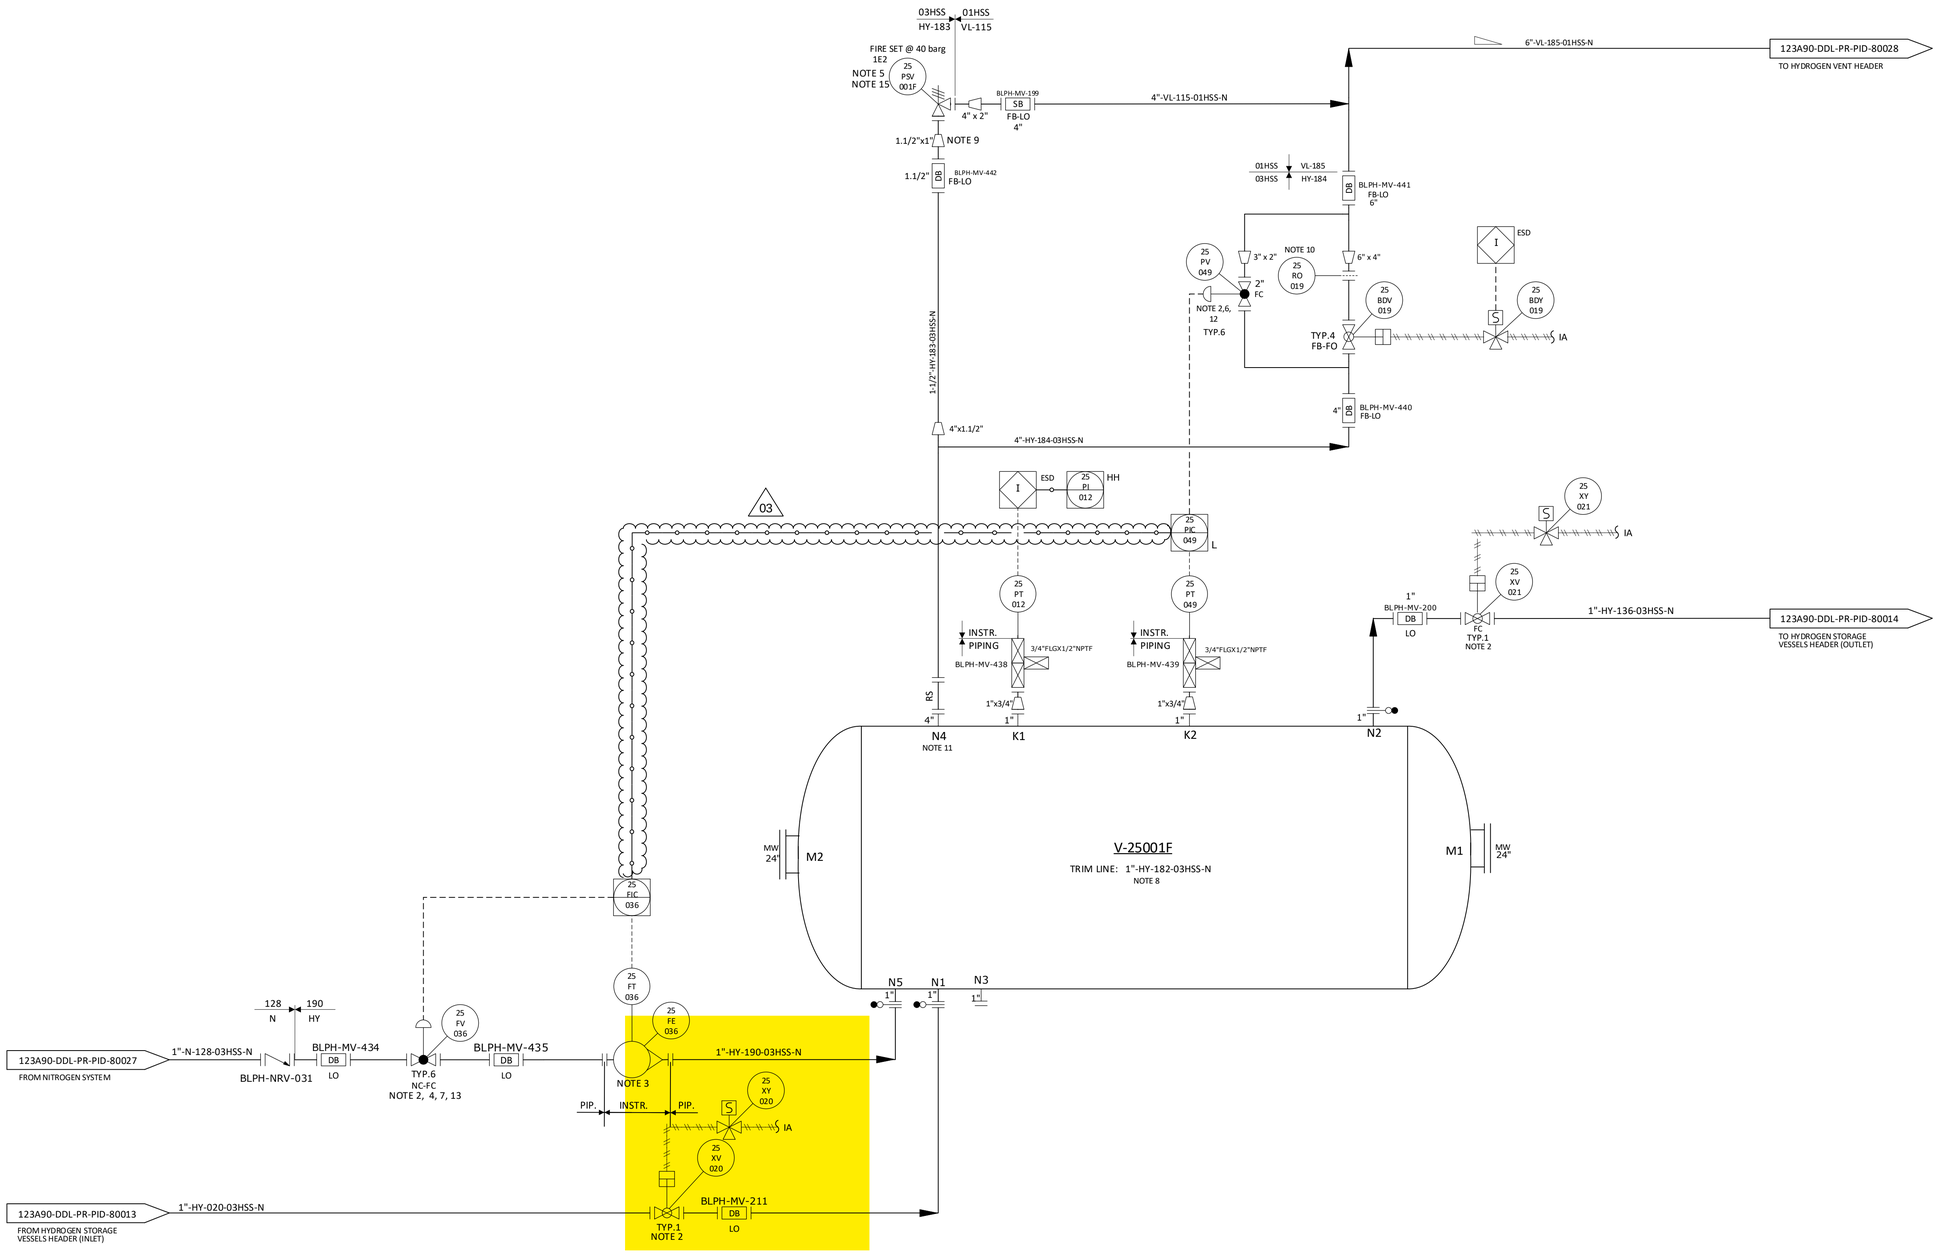

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-036) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-049 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-049 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25FV036 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-049 HAS FAILED TO CLOSE.
15. 25-PSV-001F SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR HAZOP (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL F

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80020		SHEET 001	REV. 03


File Name = FILE_NAME

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-13002	No.	MARSHALLING CABINET B400-PCS-002

<01>

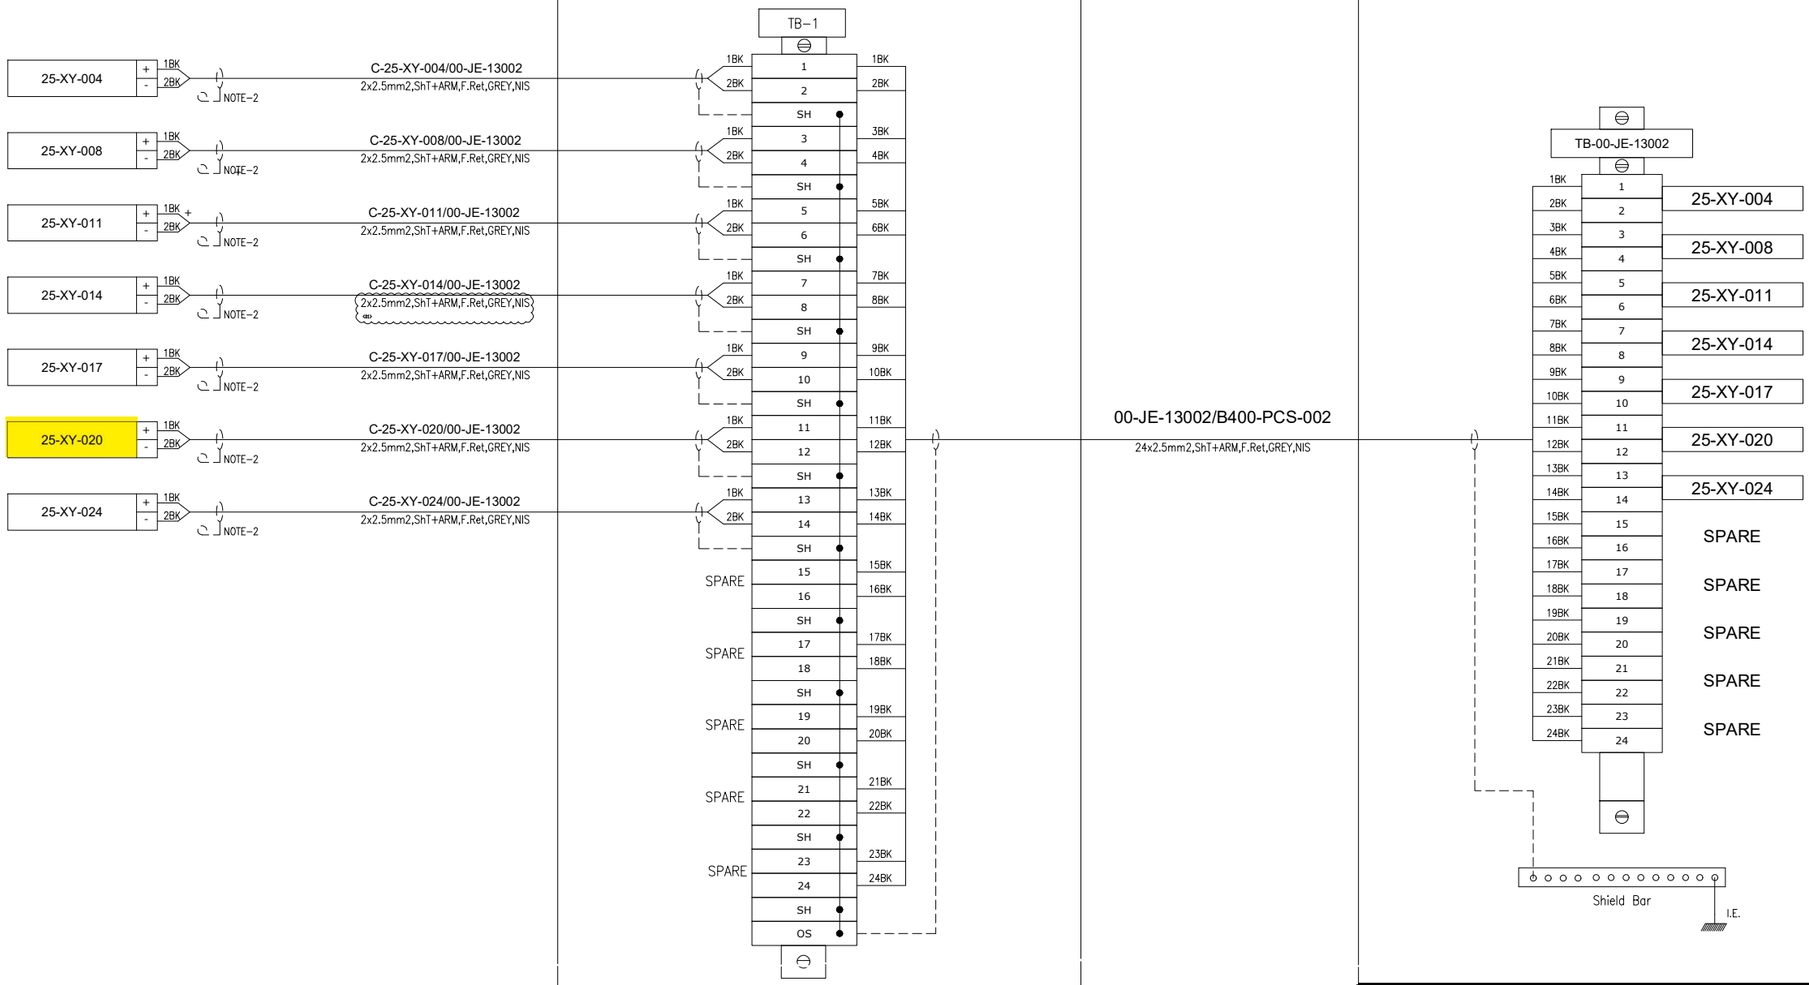

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO


TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-13002

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024
A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 029	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

E33

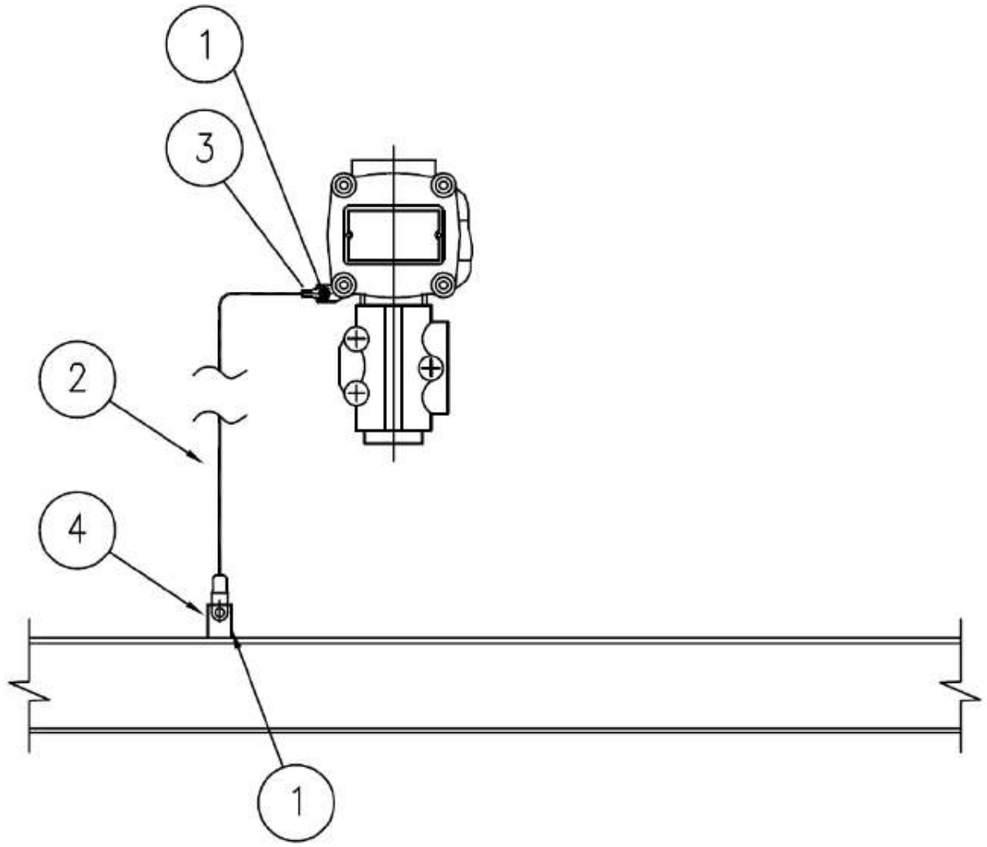

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

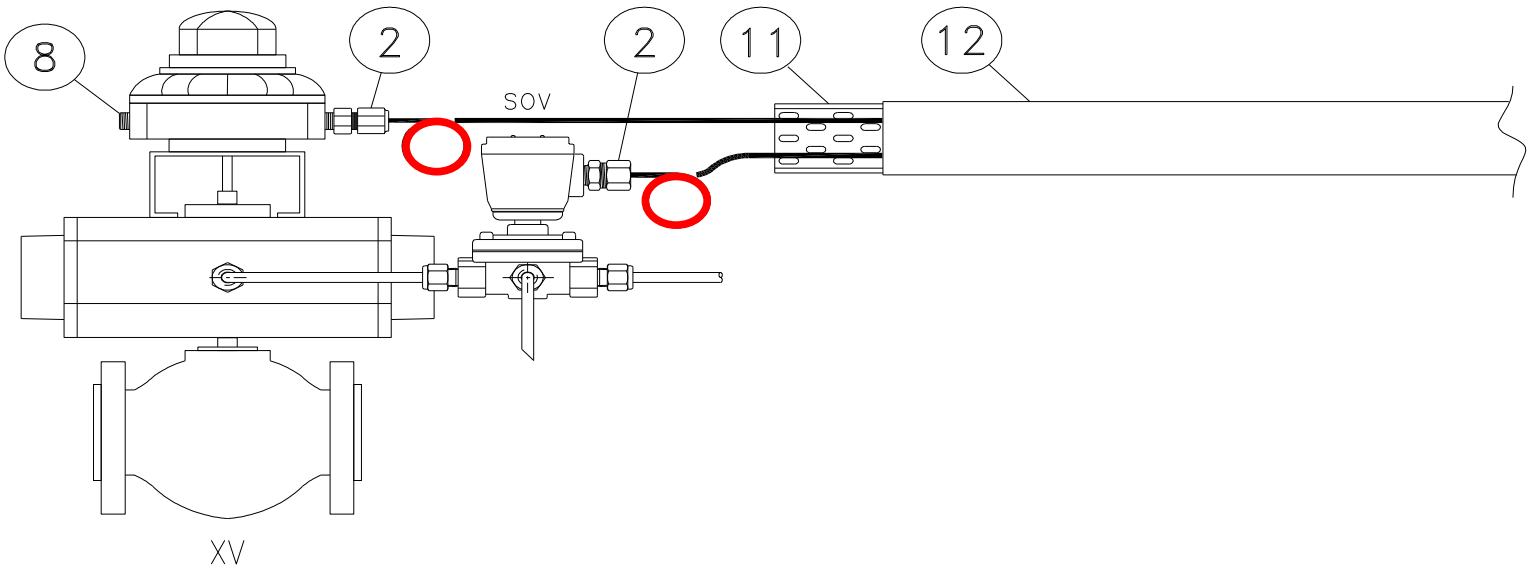

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

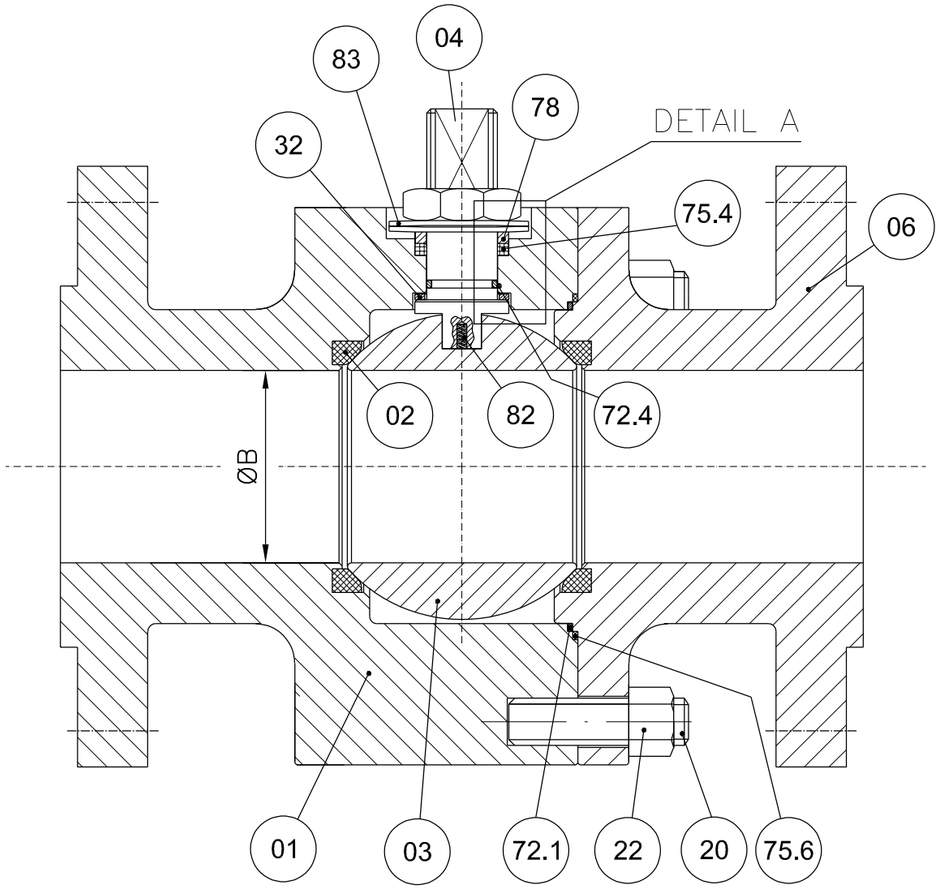




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

1 Rev.

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

1 Rev.

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: **D240062-08** Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-020		25
	2	Service				HYDROGEN STORAGE TANK V-25001F INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80020		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-020-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-020 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-020 (9, 17) - Soldo SS		25-ZSH-020 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

140	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
141	IFR	25-XV-020	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
142	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
143	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620210001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
144	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
145	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
146	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323304	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
147	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
148	IFR	25-XV-021	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
149	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
150	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620220001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
151	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
152	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
153	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323297	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
154	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
155	IFR	25-XV-024	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
156	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
157	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620230001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
158	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
159	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
160	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323291	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
161	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
162	IFR	50-XV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
163	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
164	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620240001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
165	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
166	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
167	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323289	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
168	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
169	IFR	50-XV-002	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
170	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
171	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620250001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
172	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
173	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
174	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323290	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
175	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
176	IFR	50-XV-003	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
177	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
178	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620260001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
179	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
180	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
181	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323299	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
182	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
183	IFR	50-XV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
184	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
185	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620270001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
186	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

1 # EU - TYPE EXAMINATION CERTIFICATE

2 **Equipment or Protective System Intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU**

3 EU - Type Examination Certificate Number: **Baseefa10ATEX0026 – Issue 15**

4 Product: **Type 27 & 77 Solenoid Operator**

5 Manufacturer: **Bifold Fluidpower Limited**

6 Address: **Chadderton, Oldham, Greater Manchester, OL9 9XA, UK**

7 This re-issued certificate extends EU Type Examination Certificate No. **Baseefa10ATEX0026** to apply to product designed and constructed in accordance with the specification set out in the Schedule of the said certificate but having any variations specified in the Schedule attached to this certificate and the documents therein referred to.

8 SGS Fimko Oy, Notified Body number 0598, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this product has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II to the Directive.

8.1 The original certificate was issued by SGS Baseefa Ltd (UK Notified Body 1180). It, and any supplements previously issued by SGS Baseefa Ltd have been transferred to the supervision of SGS Fimko Oy (EU Notified Body 0598). The original certificate number is retained.

The examination and test results are recorded in confidential Report No. **See Certificate History**

9 Compliance with the Essential Health and Safety Requirements has been assured by compliance with:

EN IEC 60079-0:2018 **EN 60079-1:2014** **EN 60079-31:2014**

except in respect of those requirements listed at item 18 of the Schedule.

10 If the sign "X" is placed after the certificate number, it indicates that the product is subject to the Specific Conditions of Use specified in the schedule to this certificate.

11 This EU - TYPE EXAMINATION CERTIFICATE relates only to the design and construction of the specified product. Further requirements of the Directive apply to the manufacturing process and supply of this product. These are not covered by this certificate.

12 The marking of the product shall include the following:

Ⓔx II 2GD **Ex db IIC T6 Gb (Tamb -60°C to +40°C)***
Ex tb IIIC T85°C Db (Tamb -60°C to +40°C)* IP66/67
***alternative Temperature class/Ambient combinations may also be marked, see schedule**

SGS Fimko Oy Customer Reference No. **1688** Project File No. **22/0377**

This document is issued by the Company subject to their General Conditions for Certification Services accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx . Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained herein reflects the Company's findings at the time of their intervention only and within the limits of Client's instructions, if any. It does not necessarily indicate that the equipment may be used in particular industries or circumstances. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, schedule included, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

SGS Fimko Oy
Takomotie 8
FI-00380 Helsinki, Finland
Telephone +358 (0)9 696 361
e-mail **sgs.fimko@sgs.com**
web site **www.sgs.fi**
Business ID 0978538-5 Member of the SGS Group (SGA SA)

Mikko Välimäki
Authorised Signatory for SGS Fimko Oy

13 **Schedule**

14 **Certificate Number Baseefa10ATEX0026 – Issue 15**

15 Description of Product

The Type 77 and Type 27 Solenoid Operators are rated at up to 240Vac or dc and have a maximum power dissipation of 14W. The Type 77 Solenoid Operator comprises a stainless steel cylindrical enclosure, whereas the Type 27 comprises an aluminium cylindrical enclosure, both have a spigot cover fitted with a silicone rubber seal.

In addition to the above there is also a two winding alternative designated the 'Pulse-Pulse Solenoid operator' which has a maximum combined coil rating limited to 20.5W.

The base of the enclosure is fitted with an adaptor bush which incorporates venting holes to allow the unit to be fitted onto a valve assembly rated up to a maximum pneumatic pressure of 10 bar. For hydraulic valves and valves with pneumatic pressures greater than 10 bar the top of the valve is provided with additional venting holes.

Internally the unit is fitted with a coil holder, coil and armature onto which is mounted an adjusting rod which forms a cylindrical joint with the adaptor bush and operates the valve when the solenoid is activated.

The cover may be fitted with a pushbutton or a rotary operator which can be used to operate the valve manually either momentarily or permanently.

The cover is secured using four stainless steel socket head cap screws grade of grade A4-70.

The equipment is marked:

Ex db IIC T6 Gb (Tamb -60°C to +40°C)*

Ex tb IIIC T85°C Db (Tamb -60°C to +40°C)* IP66/67

*The following alternative Temperature class/Ambient combinations may also be marked

T5/T100°C (Tamb -60°C to +55°C)

T4/T135°C (Tamb -60°C to +90°C)

An M20 or ½" NPT cable entry hole is provided as specified on the certified drawings for the accommodation of suitable IECEx Equipment (not a Component) certified cable entry device, with or without the interposition of a suitable IECEx Equipment certified (not a Component) flameproof thread adapter.

An M20 cable entry is provided unless the marking 'K85' appears in the Model No. marked on the label, in which case a ½" NPT cable entry hole is provided.

16 Report Number

See Certificate History

17 Specific Conditions of Use

None

18 Essential Health and Safety Requirements

In addition to the Essential Health and Safety Requirements (EHSRs) covered by the standards listed at item 9, the following are considered relevant to this product:

Clause	Subject
1.4.1	External effects
1.4.2	Aggressive substances etc.

19 Drawings and Documents

New drawings submitted for this issue of certificate:

Number	Issue	Date	Description
0-SL0070	0	2022.06.30	TYPE 27 & 77 SOLENOID LABEL - ROTORK BRAND - L240

Current drawings which remain unaffected by this issue:

Number	Issue	Date	Description
0-SC0004	1	09.07.20	Solenoid Lid Options G.A
0-SC0006	0	17.04.09	Latched Energised and Tamperproof Solenoid Options
0-SC0008	1	29.03.11	Override Cover Assembly
0-SC0009	0	12.02.15	Serial Numbers IIB, Type 77
**0-GA0870	0	07.11.17	General Arrangement L209 Variant – Fixed Head Operator
0-SC0003	11	20.09.21	Type 27 and 77 Solenoid Operator
0-SC0007	5	24.11.21	Sol. Operator Pulse-Pulse.
0-SL0056	4	13.01.22	Type 27 & 77 Solenoid housing label Ex d
0-SL0058	5	2022.02.07	Type 27 & 77 Solenoid housing label Ex d
0-SL0068	0	2022.01.17	Label Type 27 and 77 Solenoid Operator

**This drawing is common to this certificate and BAS02ATEX2048, BAS21UKEX0642 and is held with IECEx BAS 10.0008.

20 Certificate History


Certificate No.	Date	Comments
Baseefa10ATEX0026	20 April 2010	The release of the prime certificate. The associated test and assessment against the requirements of EN 60079-0: 2006, EN 60079-1: 2007, EN 61241-0: 2004 and EN 61241-1: 2004 is documented in Test Report No. GB/BAS/ExTR10.0014/00.
Baseefa10ATEX0026/1	7 April 2011	Amendment to the diametral tolerance for the adjusting rod. Omission of drawing 0-SC0001 (previously submitted in error). Alternative design of pushbutton override cover assembly. Minor drawing variations. Documented in Test Report No. GB/BAS/ExTR11.0084/00
Baseefa10ATEX0026/2	8 July 2011	Alternative internal design to form the Pulse-Pulse Solenoid Operator. This unit has two windings with a combined rating of 20.5W. Amended designation for the solenoid housing material. Documented in Test Report No. GB/BAS/ExTR11.0123/00
Baseefa10ATEX0026/3	2 April 2012	Alternative label design incorporating the complete range of temperature class and ambient temperature markings provided for by this certificate. Documented in Test Report No. GB/BAS/ExTR12.0086/00

Certificate No.	Date	Comments
Baseefa10ATEX0026/4	2 December 2013	A re-designation of the Type FP Solenoid Operator, to the Type 77 Solenoid Operator. A satisfactory assessment against the requirements of the updated standards IEC 60079-0: 2011 and IEC 60079-31: 2008 (superseding IEC 61241), complete with a review of the marking. Introduction of an alternative aluminium housing and cover material. Documented in Test Report No. GB/BAS/ExTR13.0291/00
Baseefa10ATEX0026/5	29 July 2014	This issue permits existing information (for example on Schedule Drawings) to be replaced by the revised certificate holders address. No other changes may be made to the certified design. Documented in Test Report No. None.
Baseefa10ATEX0026/6	17 February 2015	Clarification of the Type name. The Type 77 comprises a stainless steel housing and the Type 27 comprises an aluminium housing. To allow the introduction of alternative seal materials. To allow the Type 77 Solenoid Operators having Serial numbers as defined in drawing number 0-SC0009 to be marked with Ex d IIB T6 Gb. Documented in Test Report No. GB/BAS/ExTR14.0317/00
Baseefa10ATEX0026/7	23 June 2016	Minor drawing changes not affecting certification. Documented in Test Report No. GB/BAS/ExTR16.0164/00
Baseefa10ATEX0026/8	16 March 2017	To allow the introduction of an alternative low power circuit. To allow for correction of the Type designation listed on the EU-Type Examination Certificate Baseefa10ATEX0026 To allow for correction of description to include the Pulse Pulse Unit. Documented in Test Report No. GB/BAS/ExTR17.0076/00
Baseefa10ATEX0026/9	20 July 2017	To allow the introduction of an alternative low power circuit. Documented in Test Report No. GB/BAS/ExTR17.0211/00
Baseefa10ATEX0026/10	3 January 2018	To introduce an alternative non-rotational mounting arrangement to attach the adaptor bushing via the coil holder to the enclosure housing. Identification of threaded entry holes on the enclosure wall. Documented in Test Report No. GB/BAS/ExTR17.0274/00
Baseefa10ATEX0026/11	7 March 2018	To introduce alternative terminal plate with a different grounding point design. To introduce optional certification marks in addition to the existing one to be included on to the certification label marking. Documented in Test Report No. GB/BAS/ExTR 18.0041/00
Baseefa10ATEX0026/12	12 July 2019	To assess the Type 27 and 77 Solenoid Operator against the standards EN IEC 60079-0:2018, EN 60079-1:2014 and EN 60079-31:2014 To permit minor drawing changes to the certification label that do not affect certification Documented in Test Report No. GB/BAS/ExTR19.0100/00


Certificate No.	Date	Comments
Baseefa10ATEX0026/13	14 July 2020	To introduce an alternative Detented Manual Over-Ride Lid (alternative spigoted cover), which allows the valve to be operated manually. Documented in Test Report No. GB/BAS/ExTR19.0341/00.
Baseefa10ATEX0026 – issue 14	11 February 2022	This issue of the certificate incorporates previously issued primary & supplementary certificates. To remove drawings 138-10, 138-10-K85, 0-S0252 and 0-S0254 transferring critical details to drawing 0-SC0003 revision 11. To remove drawing 0-SC0001. To add drawing 0-SL0068. To add an alternative encapsulant. To update the nameplate drawings to include UKEX details. Documented in Test Report No. GB/BAS/ExTR21.0158/00
Baseefa10ATEX0026 – issue 15	2 November 2022	This issue of the certificate incorporates previously issued primary & supplementary certificates. To add an alternative marking drawing with a different manufacturer branding. The assessment is documented in test report GB/BAS/ExTR22.0138/00
For drawings applicable to each issue, see original of that issue.		

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

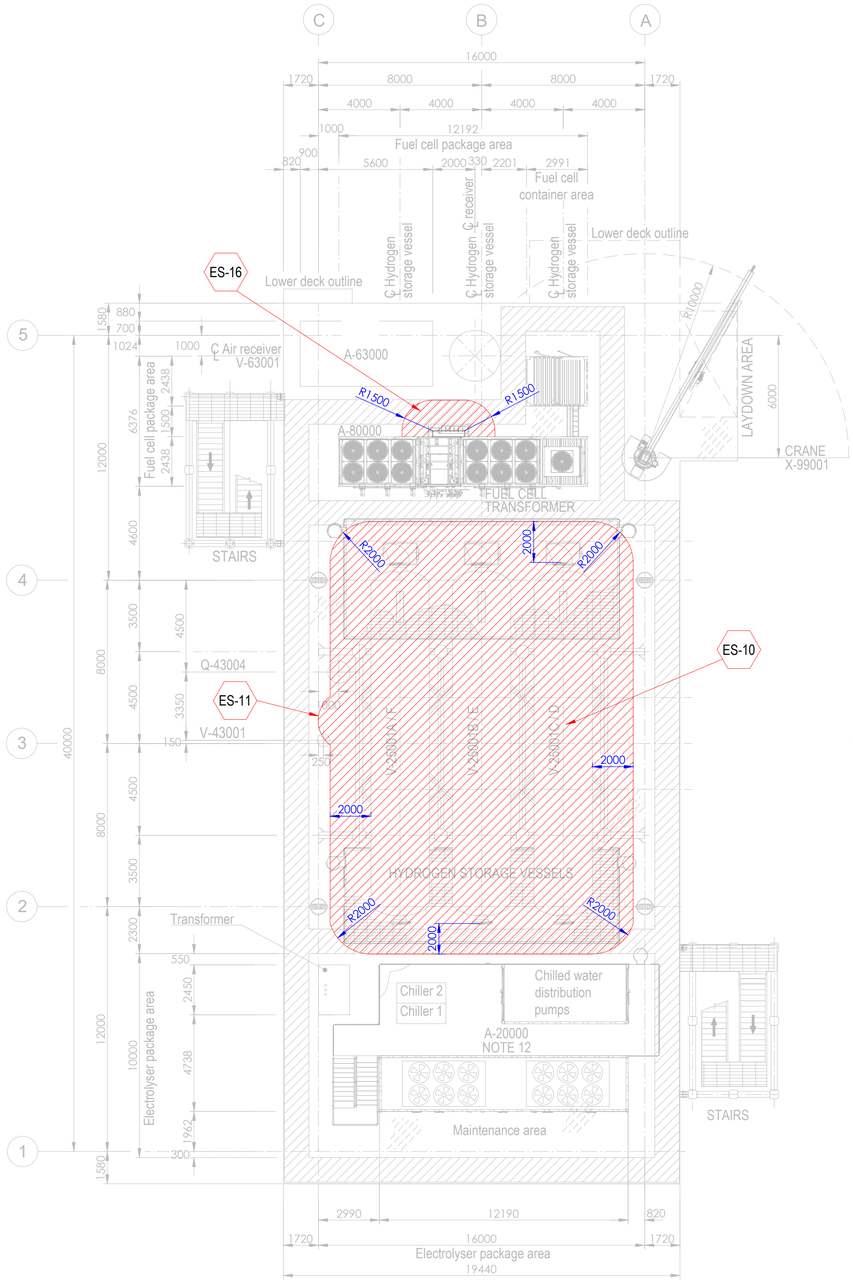


PLAN ON UPPER DECK
EL+30.310 T.O.S.

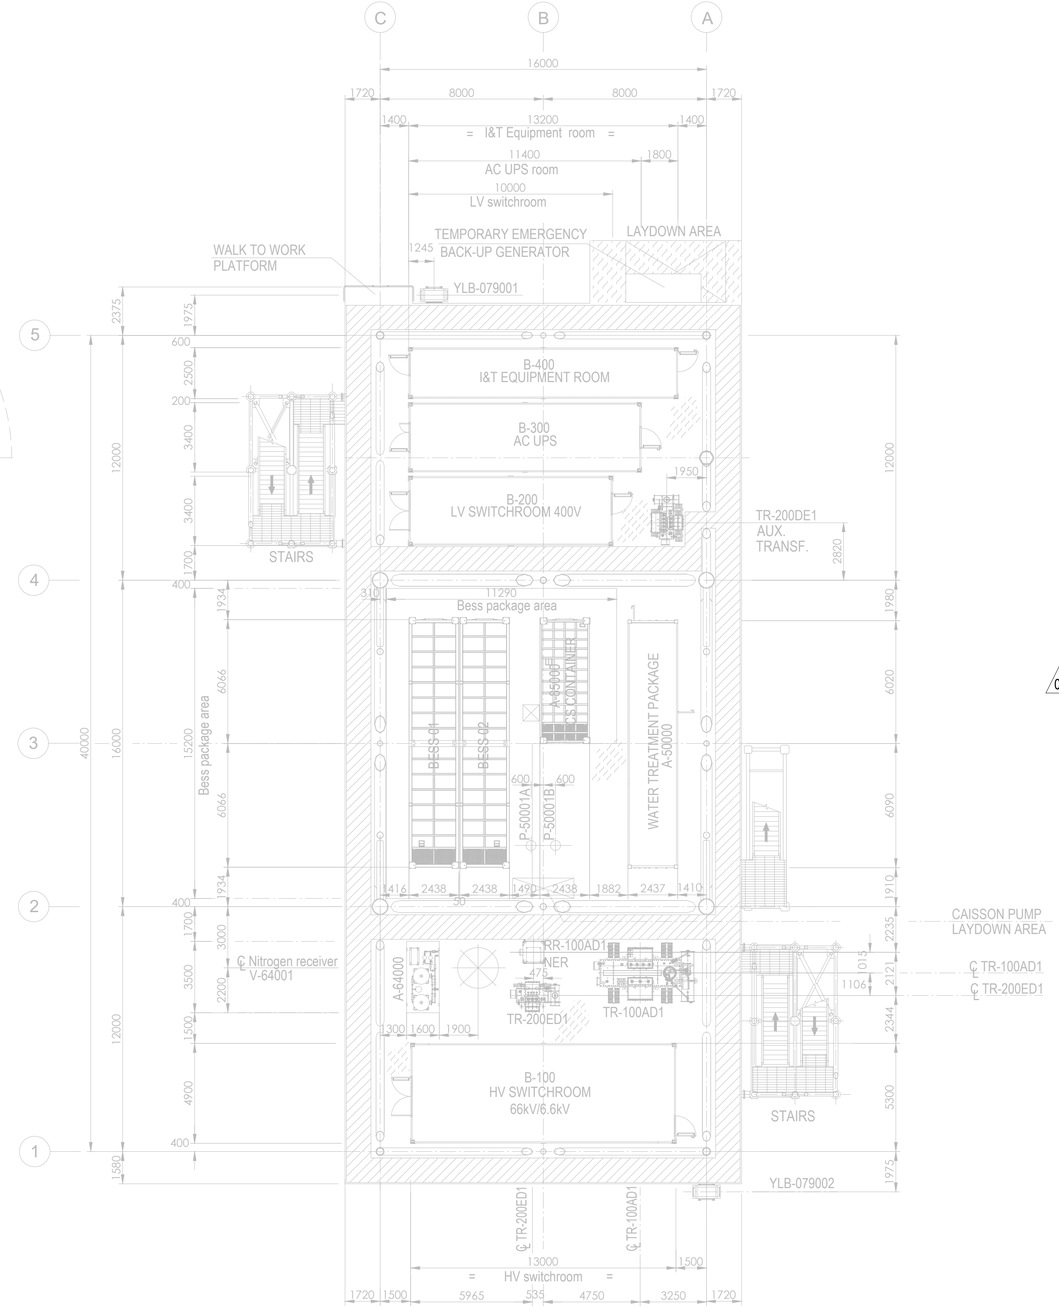

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

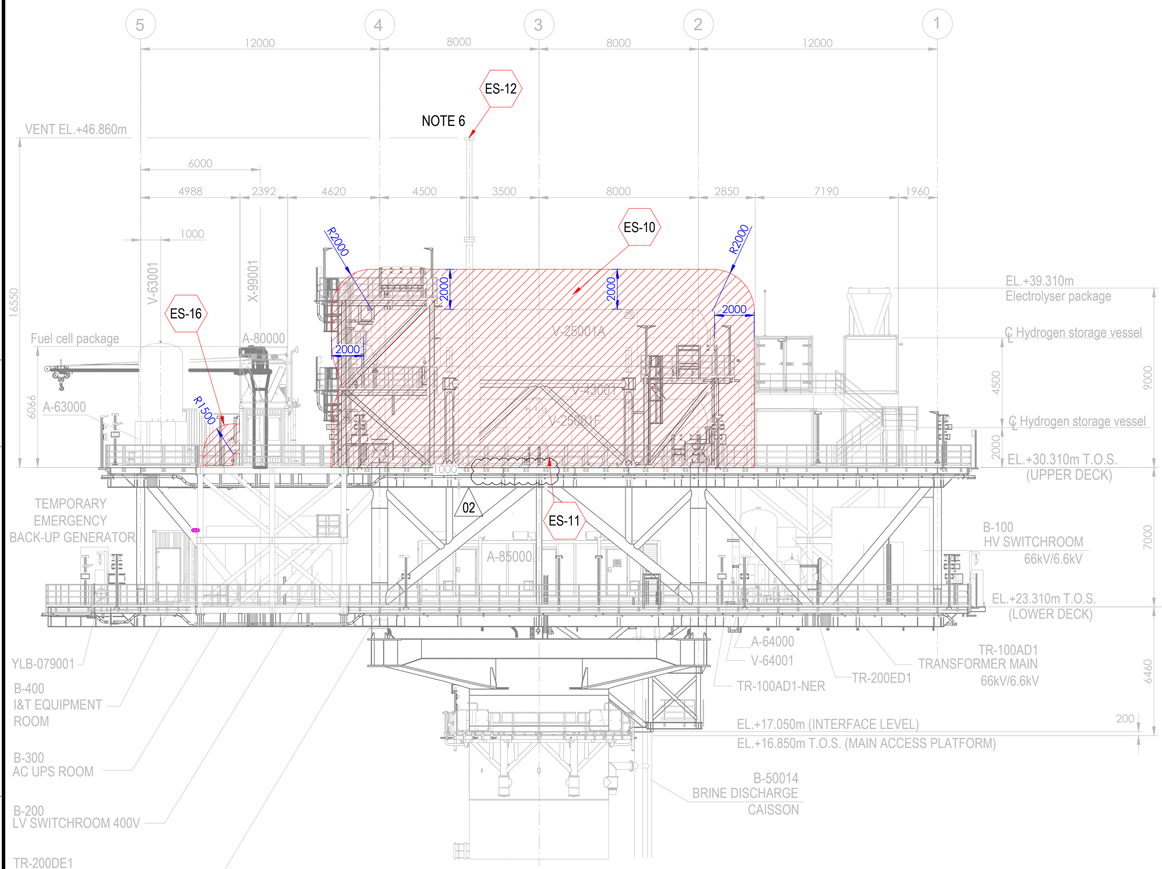



ELEVATION LOOKING EAST

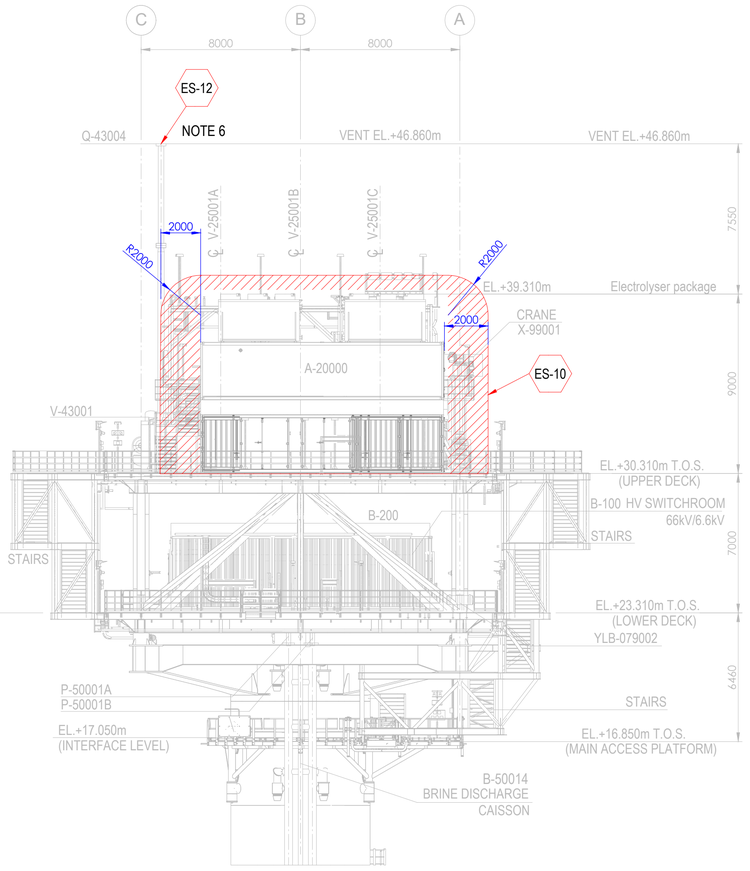

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

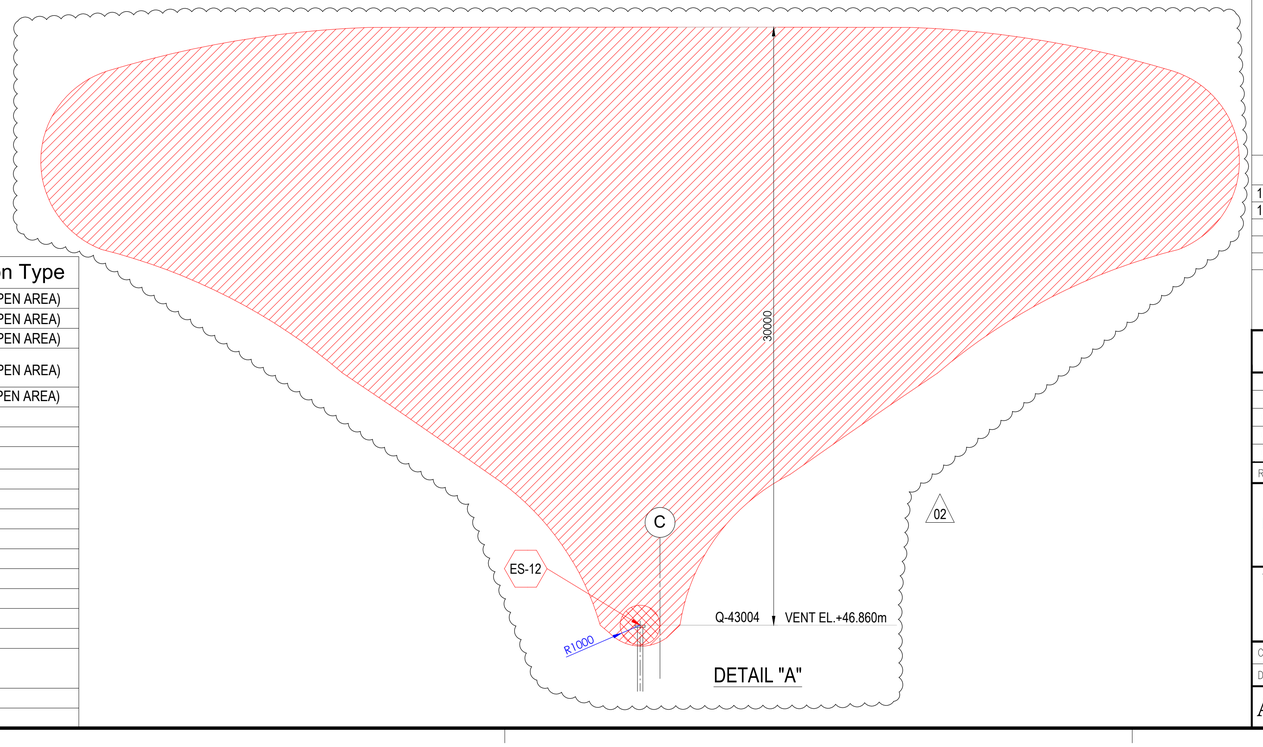



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-ZSHL-001	: Limit Switch Box - Hyrogen to Vessels Inlet Header Shut-Down	Dwg	123A90-DDL-PR-PID-80013		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001726	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		Batch: IT03B0127022			
Manufacturer	SOLDO			**Model**		SQN120E-20X23L7			
Cert No.	CML 19ATEX1359X			**Equipment Ambient Temp.**		-40°C to +80°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66/68

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	OK	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	OK	

ITEM	Tag	25-ZSHL-001	: Limit Switch Box - Hyrogen to Vessels Inlet Header Shut-Down			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001726		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	OK	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-ZSHL-001	: Limit Switch Box - Hyrogen to Vessels Inlet Header Shut-Down		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001726	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-30	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-30T10:17:41.258Z	PROVERLIS Digitaly signed by Alessio Polo 2025-01-30T12:16:26.181Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

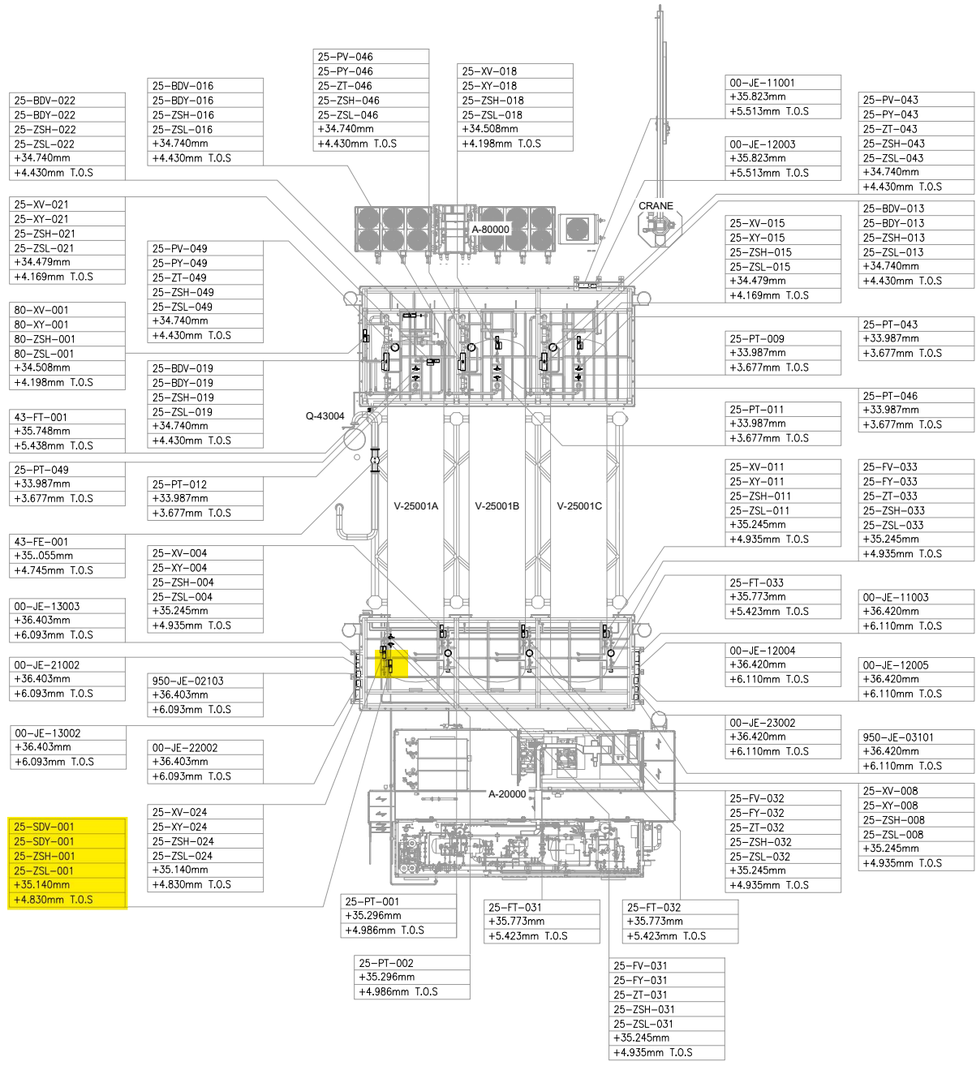

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm

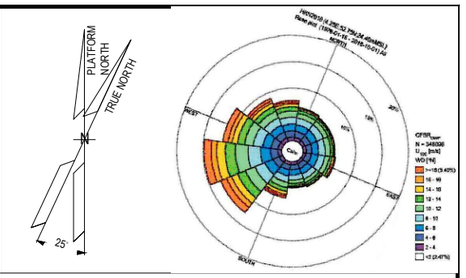

NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90–DDL–IN–DL–40081	002	02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING_NO.

REV.

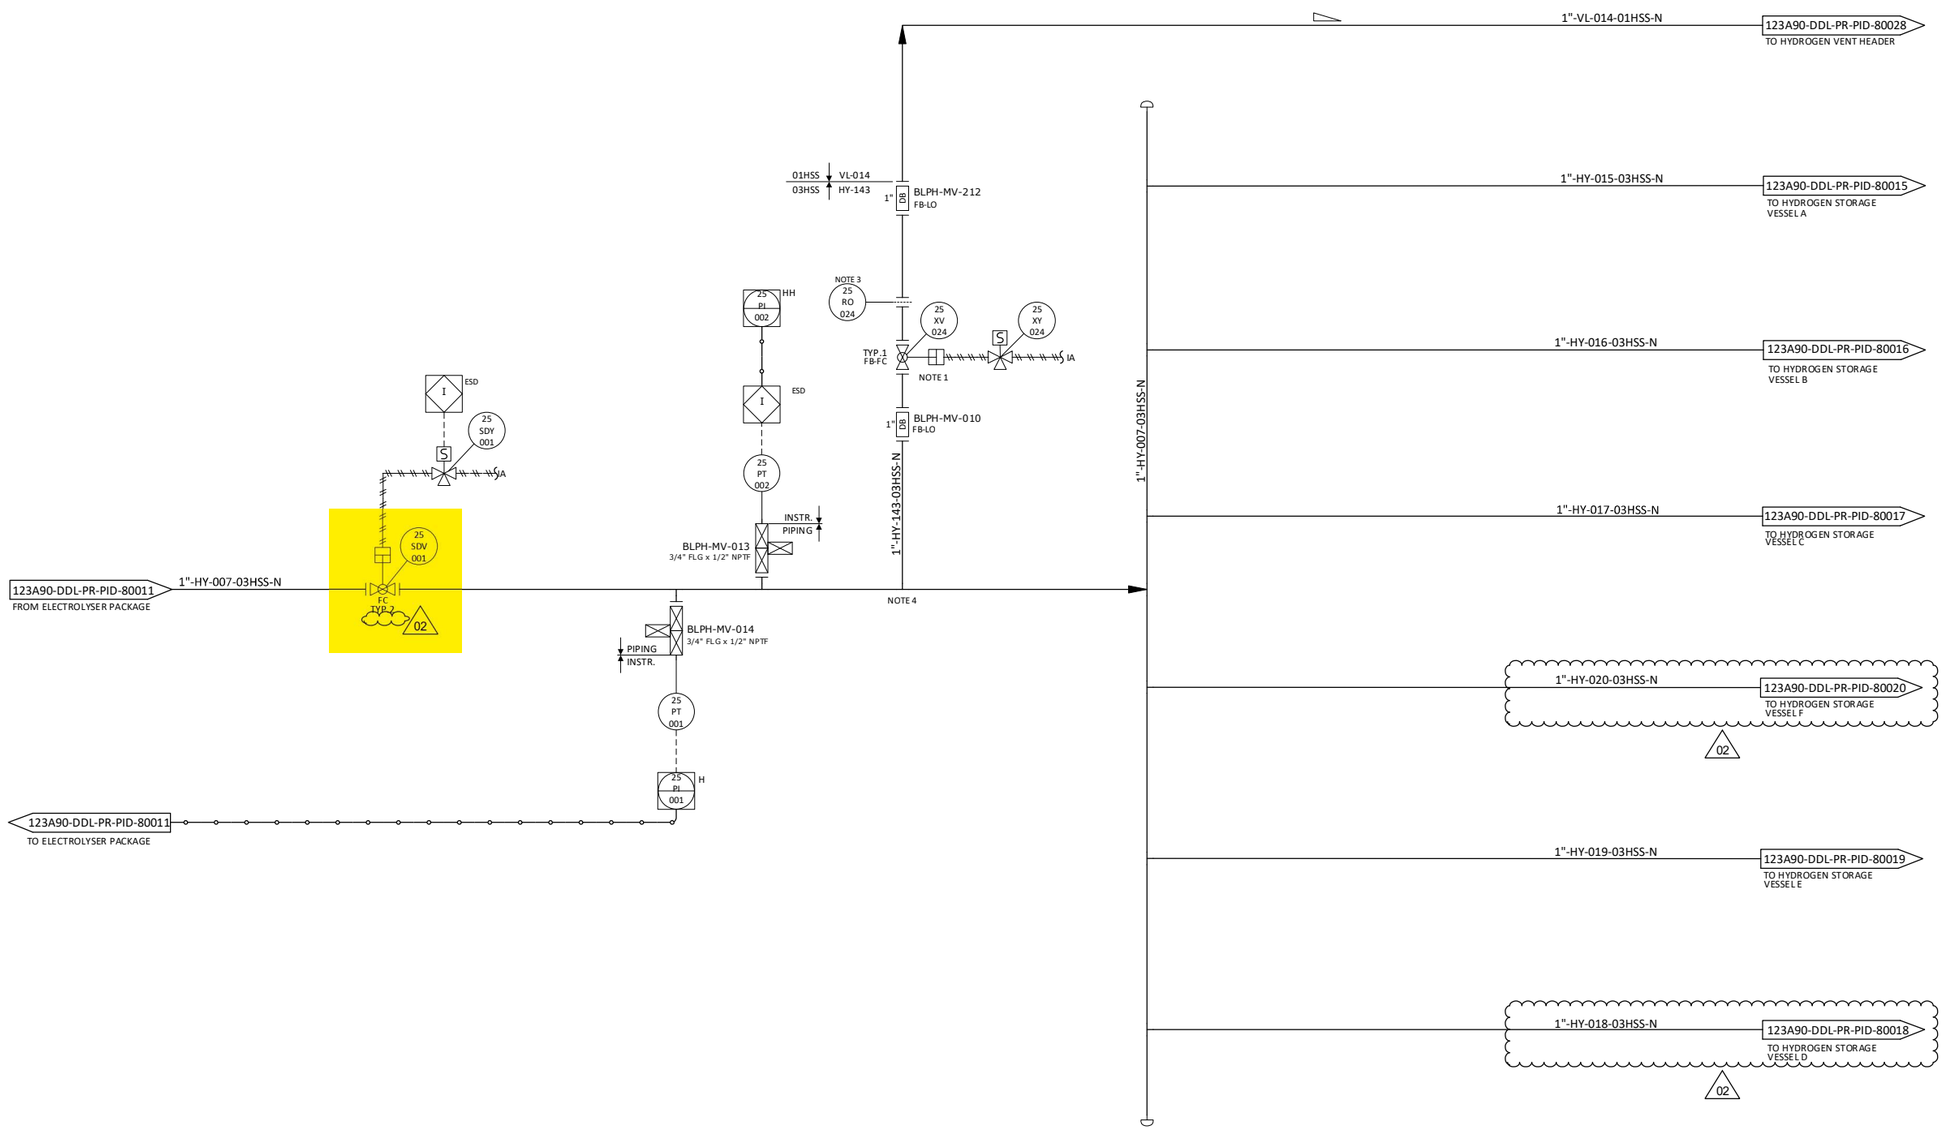

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSELS HEADER (INLET)

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE


A1	DRAWING NO.	SHEET	REV.
	123A90-DDL-PR-PID-80013	001	02

File Name : FILE_NAME

DRAWING NO. 123A90-DDL-IN-DG-40016

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-22002	No.	MARSHALLING CABINET B400-SIS-001

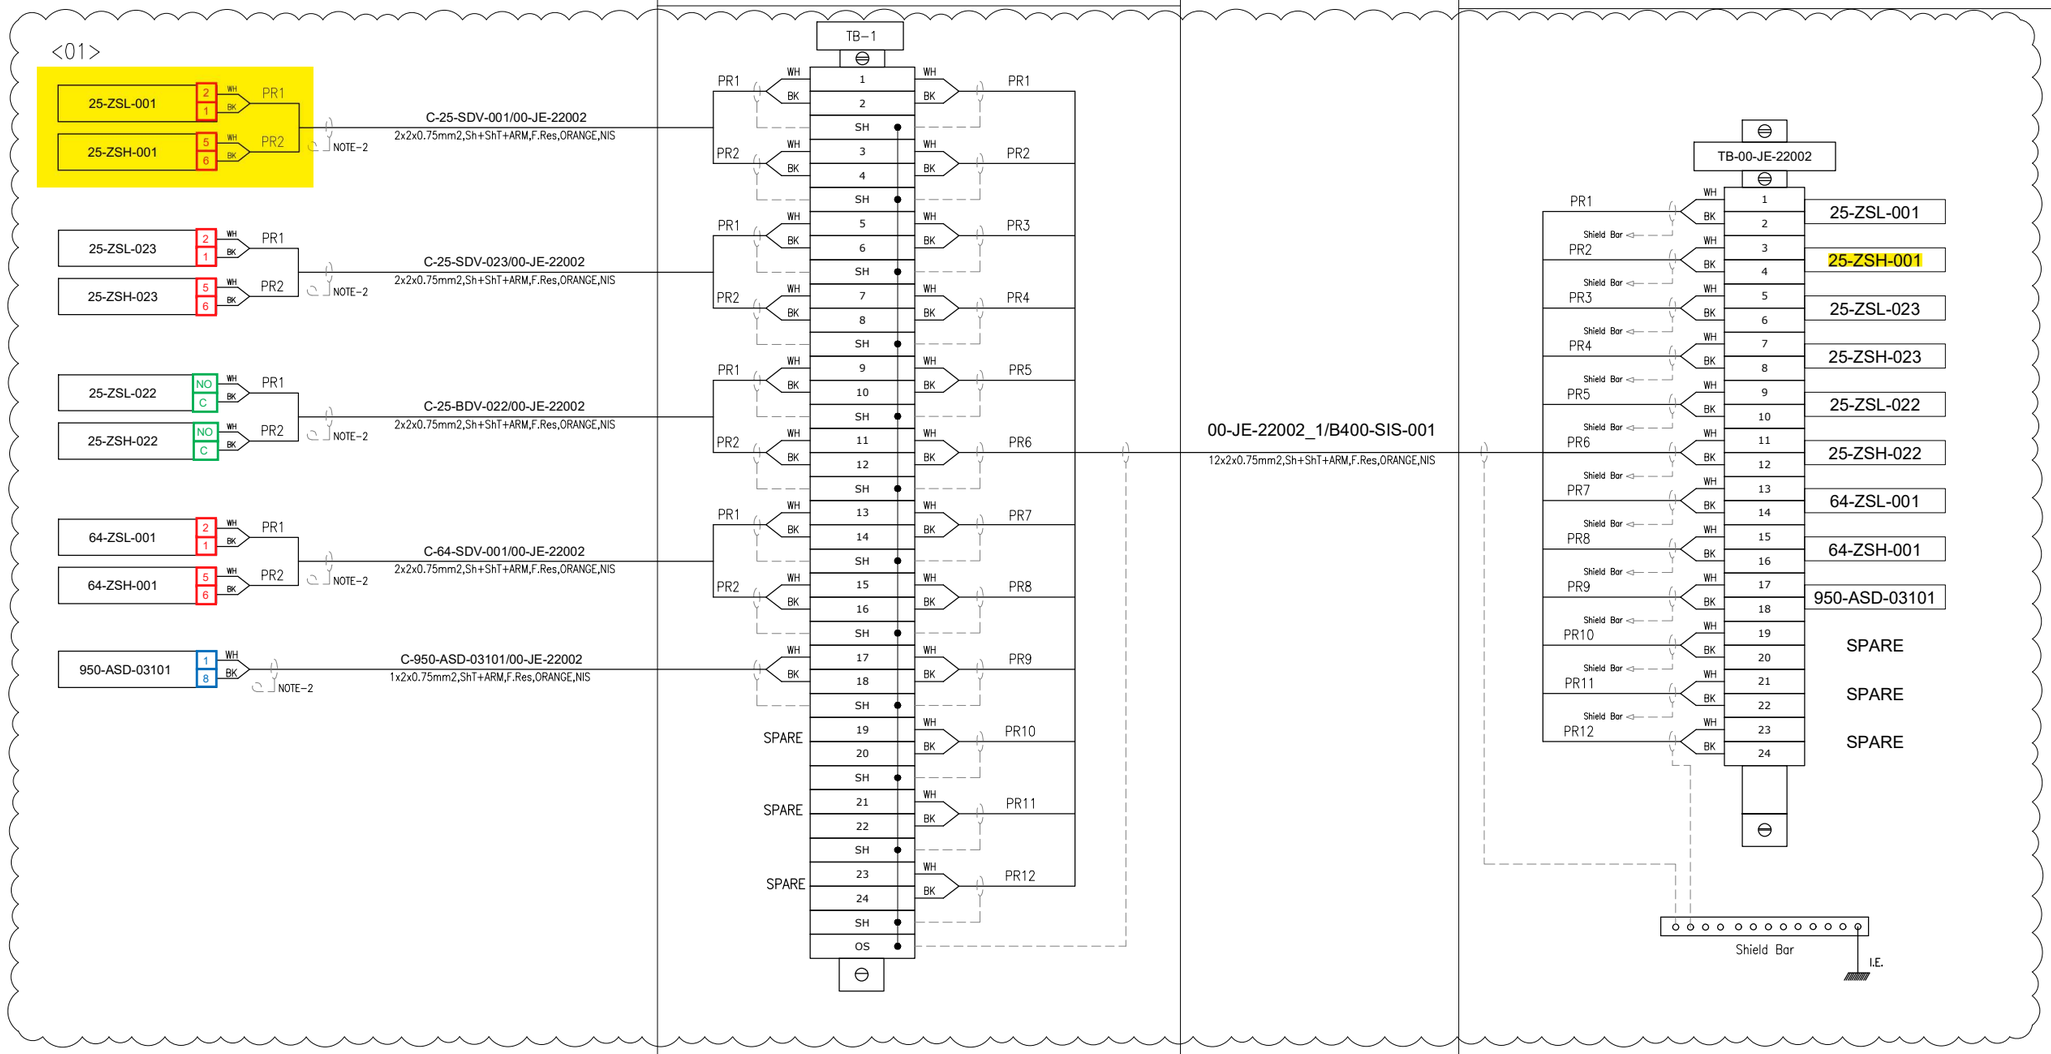

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40016**

REV.:	DATE:	SIGNATURE:
1_Q	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
INSTRUMENT– SAFETY SYSTEM WIRING DIAGRAMS
00–JE–22002–SH.1 OF 2

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90–DDL–IN–DG–40016	SHEET 012	REV. 01

File Name : 123A90-DDL-IN-DG-40016_Rev.01

E33

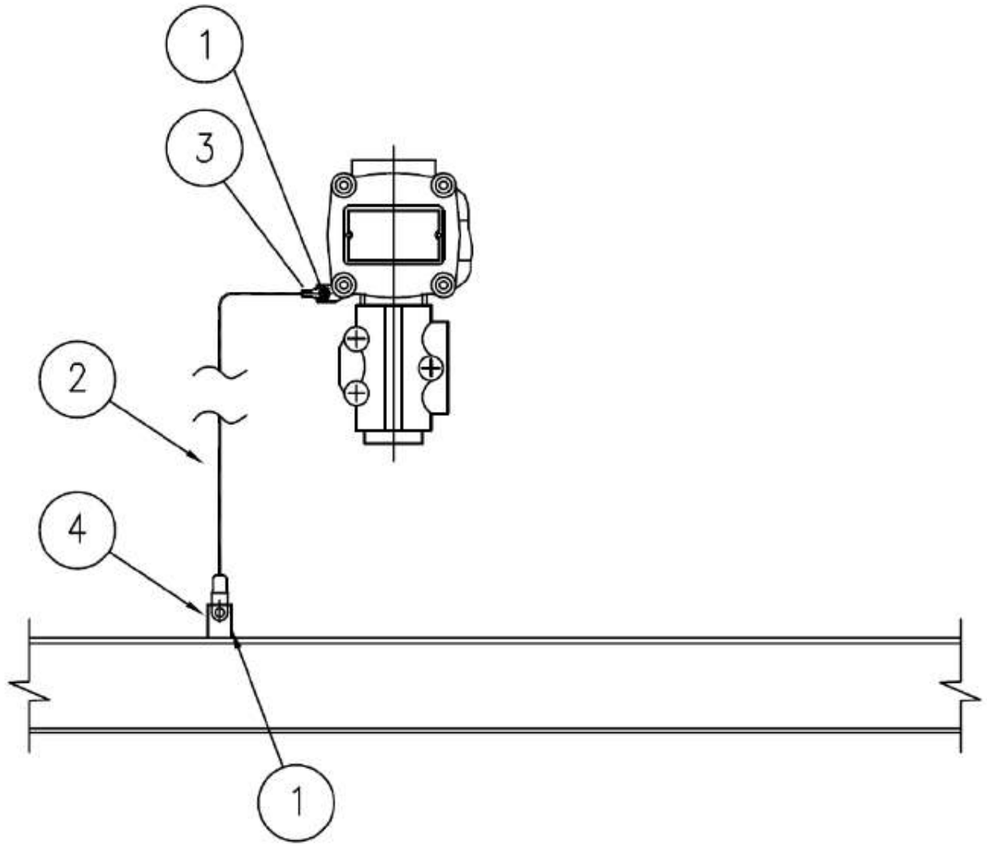

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 16 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR SDV/BDV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

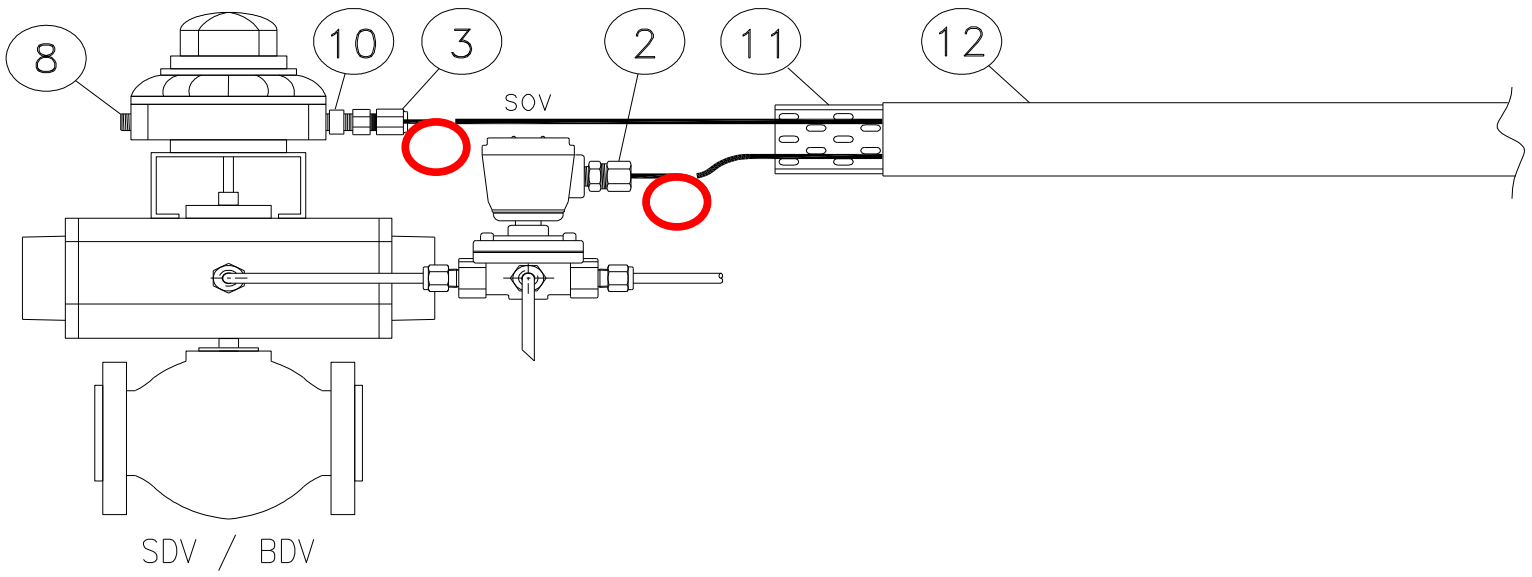

SDV / BDV

INSTRUMENT TAG	
1	25-BDV-005
2	25-BDV-007
3	25-BDV-010
4	25-BDV-013
5	25-BDV-016
6	25-BDV-019
7	25-BDV-022
8	25-SDV-001
9	25-SDV-023
10	64-SDV-001
11	
12	
13	
14	
15	
16	
17	
18	
19	
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
10		Nickel Plated Brass Adaptor Ex-d/e IIC (or IIB + H2) T1	M20 Male x M25 Female	1
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
3		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M25	1
2		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

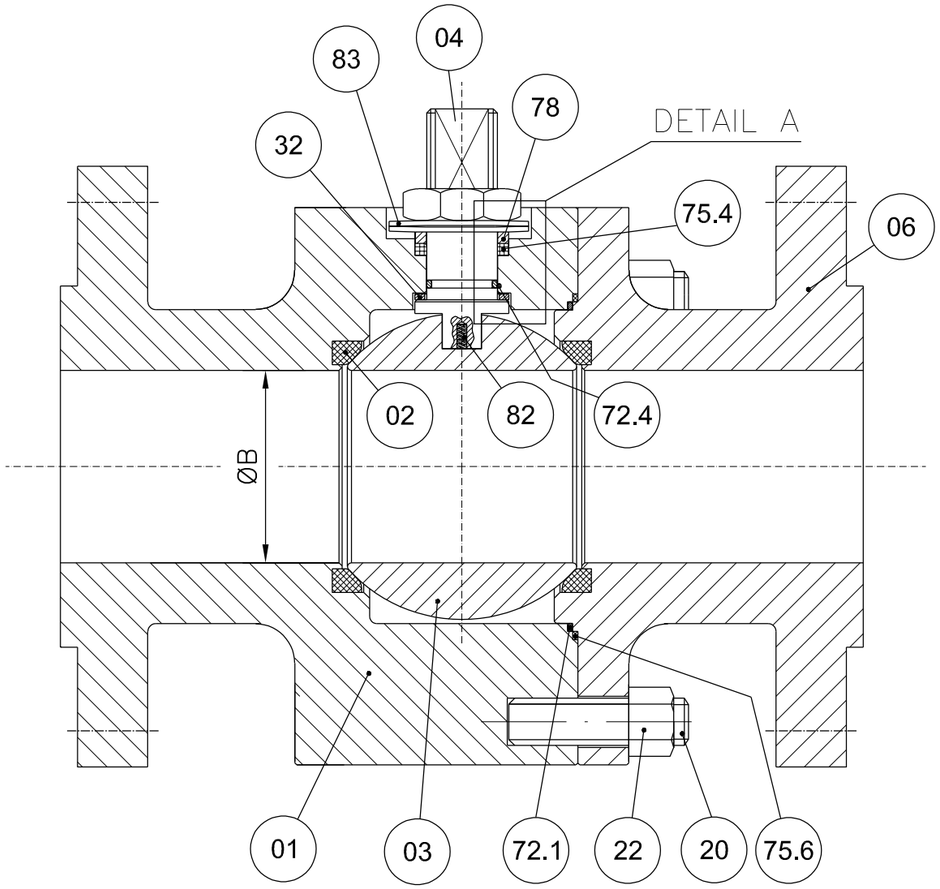




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

GENERAL	1	Tag Number	Location			25-SDV-001		25
	2	Service				HYDROGEN TO STORAGE TANKS		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80013		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-007-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close : (12)		Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum		Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/AA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-SDY-001 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-001 (9, 17) - Soldo SS		25-ZSH-001 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR	25-SDV-023	ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-ZSH-019	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-022	Hyrogen from vessels outlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSH-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-031	Nitrogen to V-25001A vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-032	Nitrogen to V-25001B vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-033	Nitrogen to V-25001C vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-034	Nitrogen to V-25001D vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-036	Nitrogen to V-25001F vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-038	Nitrogen to V-25001E vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSH-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSL-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSL-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSL-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSL-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSL-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSL-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSL-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSL-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSL-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSL-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-ZSL-019	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSL-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSL-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-022	Hyrogen from vessels outlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSL-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSL-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSL-031	Nitrogen to V-25001A vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-032	Nitrogen to V-25001B vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2

EU Type Examination Certificate CML 19ATEX1359X Issue 1

1 Equipment intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU

2 Equipment **SOLDO™ SK and SQ Series Limit Switch Boxes**

3 Manufacturer **Rotork Instruments Italy srl**

4 Address **Via Portico 17**
24050
Orio al Serio (BG)
Italy

5 The equipment is specified in the description of this certificate and the documents to which it refers.

6 CML B.V., Chamber of Commerce No 67386717, Koopvaardijweg 32, 4906CV Oosterhout, The Netherlands, Notified Body Number 2776, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this equipment has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment intended for use in potentially explosive atmospheres given in Annex II to the Directive.

The examination and test results are recorded in the confidential reports listed in Section 12.

7 If an 'X' suffix appears after the certificate number, it indicates that the equipment is subject to conditions of safe use (affecting correct installation or safe use). These are specified in Section 14.

8 This EU Type Examination certificate relates only to the design and construction of the specified equipment or component. Further requirements of Directive 2014/34/EU Article 13 apply to the manufacture of the equipment or component and are separately certified.

9 Compliance with the Essential Health and Safety Requirements, with the exception of those listed in the confidential report, has been demonstrated through compliance with the following documents:

EN IEC 60079-0:2018 EN 60079-1:2014 EN 60079-31:2014

10 The equipment shall be marked with the following:

Ⅱ 2 G D

Ex db IIC T* Gb

Ex tb IIIC T*°C Db

Ta = -55°C to +*°C

**The ambient temperature classes and maximum surface temperature for dust depend upon the ambient temperature ranges. See Table in Section 11.*

11 Description

The SOLDO™ SK and SQ Series Limit Switch Boxes are electromechanical devices used to indicate the position of valves/actuators etc. by means of an electrical signal and an optional visual indicator. The metallic enclosure is constructed from aluminium (SK) or 316 or 316L stainless steel (SQ) and comprises of two enclosure halves secured with 4 x M6 stainless steel fasteners with a minimum property class of 500 MPa. An operating rod passes through each enclosure half for connection to the device being monitored. The rod operates the internal switch/sensor for signalling and passes through to the external indicator (when fitted). There are two threaded entries (M20 or ½" NPT) into the enclosure for cable entry.

The applicable ambient temperature ranges and corresponding Temperature Classes and Maximum Surface Temperatures for Dust are detailed in the table below:

Ambient Temp. Range	T Class	Maximum Surface Temp. for Dust
-55°C to +60°C	T6	T85°C
-55°C to +80°C	T5	T100°C
-55°C to +105°C	T4	T135°C

Rating:

Max. Voltage: 125 Vdc/250 Vac
Max. Current: 10 A
Max. Power: 10 W

Notes:

- Sira 12ATEX1098X is superseded by this certificate.
- The product covered by Issue 0 of this certificate remains identical to that previously covered by Sira 12ATEX1098X.
- Where Sira 12ATEX1098X is specified in other product certification, or other technical specifications, this certificate reference for the product shall be used in its place; updating of the other product certificate or technical specification is not required.

Variation 1

This variation introduced the following changes:

i. Introduction of power dissipation calculation as supporting certification document.

12 Certificate history and evaluation reports

Issue	Date	Associated report	Notes
0	04 Oct 2019	R12654A/00	Initial issue
1	27 Mar 2024	R17518A/00	Introduction of Variation 1

Note: Drawings that describe the equipment or component are listed in the Annex.

13 Conditions of Manufacture

The following conditions are required of the manufacturing process for compliance with the certification.

i. Where the product incorporates certified parts or safety critical components, the manufacturer of the product defined on this certificate shall continually monitor these parts/components for any modifications introduced by the manufacturer(s) of these constituent parts. If the manufacturer of any constituent part introduces any changes which affect the compliance of the certified product that is the subject of this certificate, the manufacturer is required to have this certificate updated.

ii. The power dissipation inside the flameproof enclosure shall not exceed 10 W.

14 Specific Conditions of Use (Special Conditions)

The following conditions relate to safe installation and/or use of the equipment.

i. The equipment is fitted with a non-conducting position indicator which could potentially generate an ignition-capable level of electrostatic charge under certain extreme conditions. Therefore, the equipment shall not be installed in a location where it may be subjected to external conditions (such as high-pressure steam) which might cause a build-up of electrostatic charge on the non-conducting surfaces. Additionally, cleaning of the equipment should be done only with a damp cloth.

ii. The maximum temperature at the cable entry points may exceed 70°C. The user shall refer to the manufacturer's instructions document for guidance in respect of the selection of suitable cabling for the equipment.


iii. Dust layers in excess of 50 mm shall not be allowed to form on the equipment.

iv. The following have a minimum flamepath width (L) and maximum gap (i_c) other than that detailed in EN 60079-1 Table 3 and are detailed below:


Flamepath	**Joint Width (L) mm**	**Max. Gap (i_c) mm**
Cover shaft/Cover	26	0.097
Body Shaft/Body	26	0.097

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

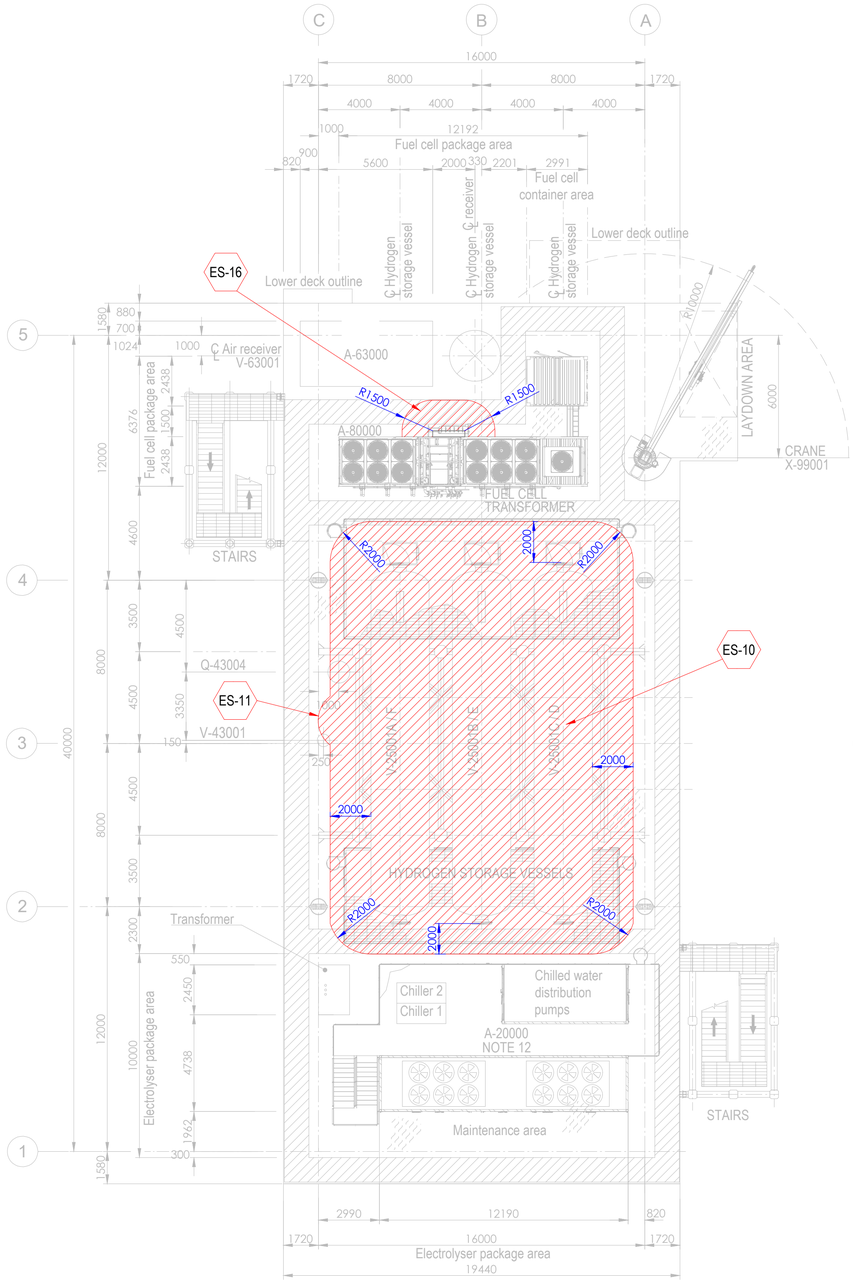


PLAN ON UPPER DECK
EL+30.310 T.O.S.

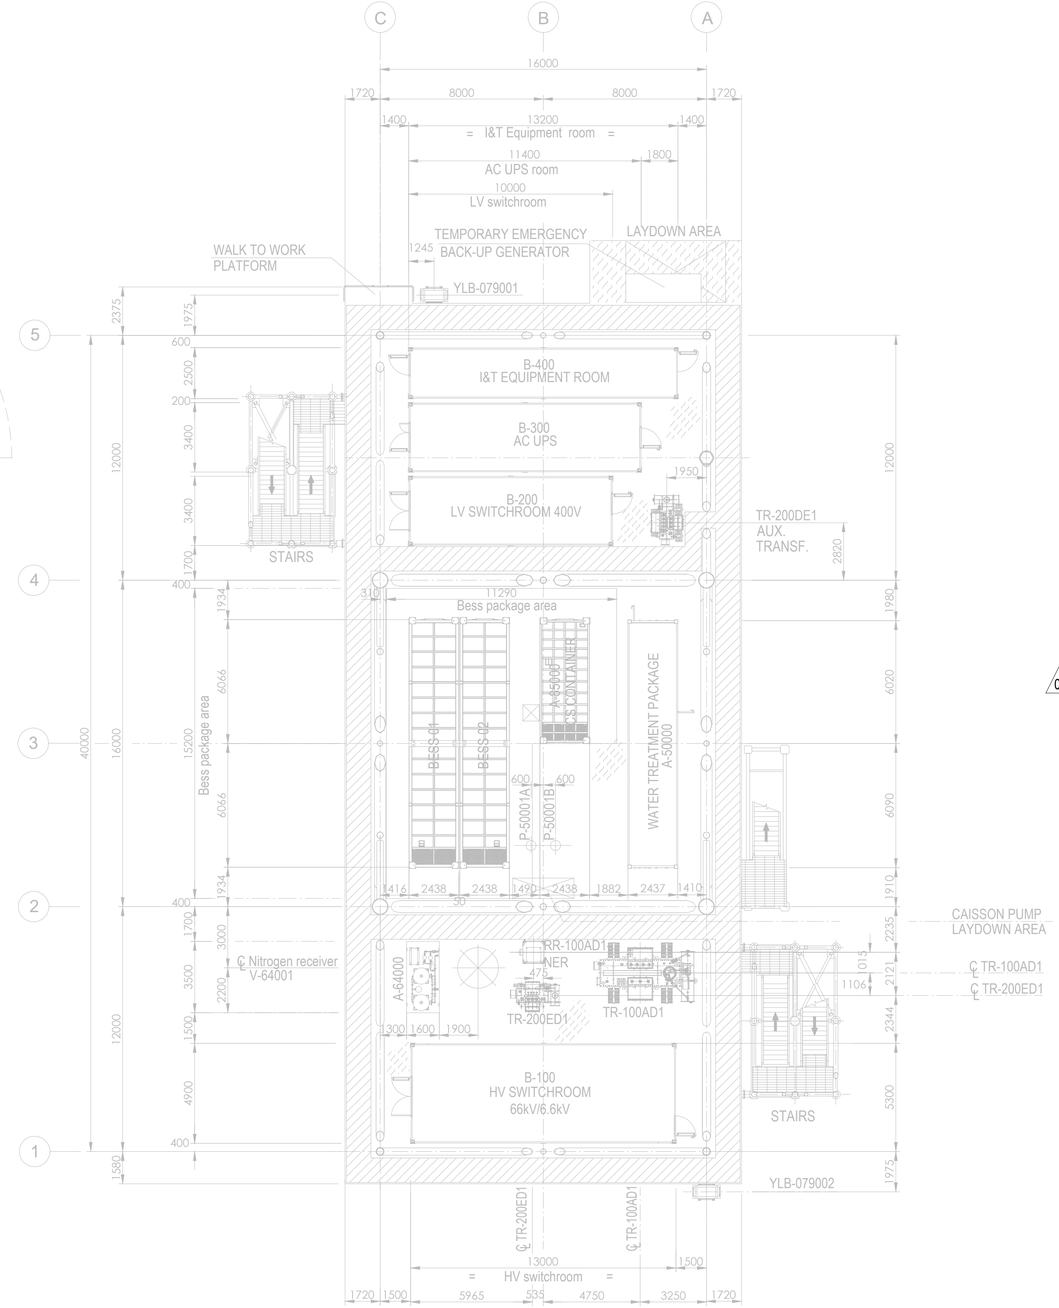

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

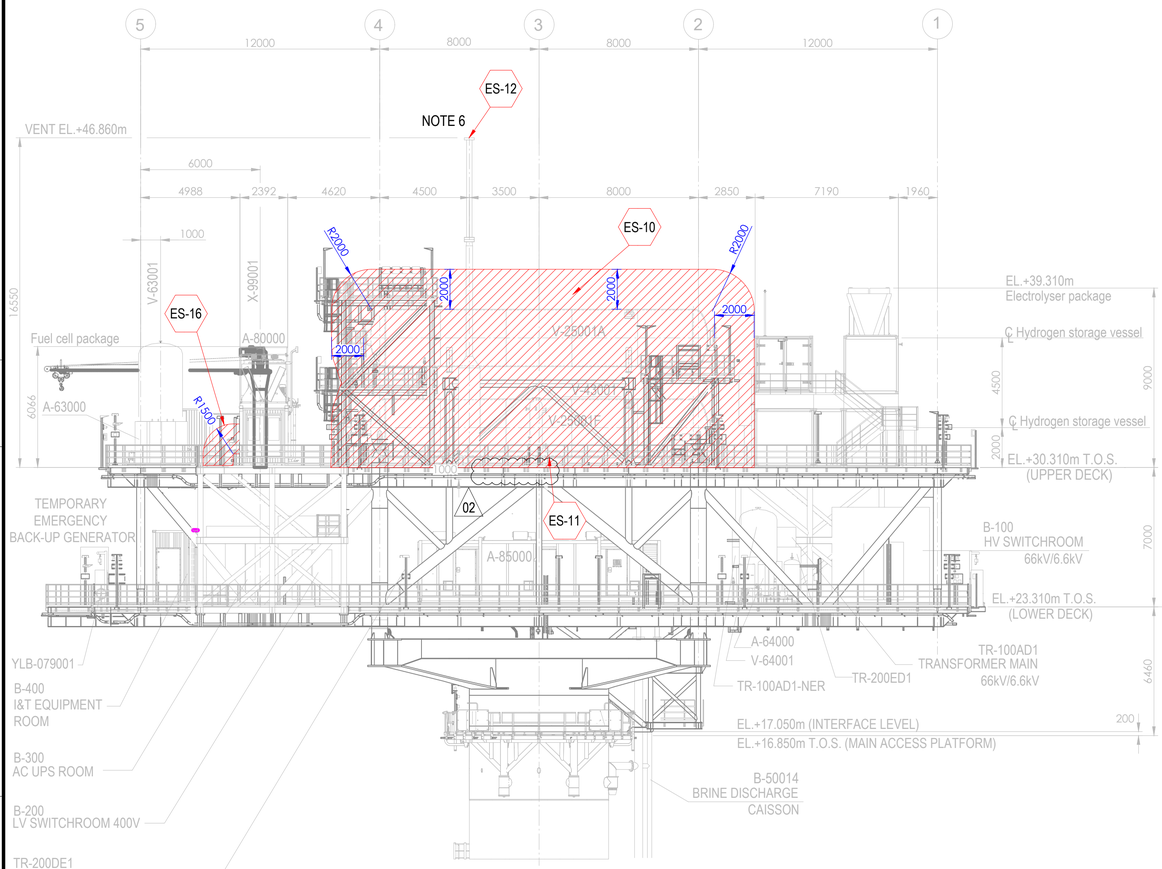



ELEVATION LOOKING EAST

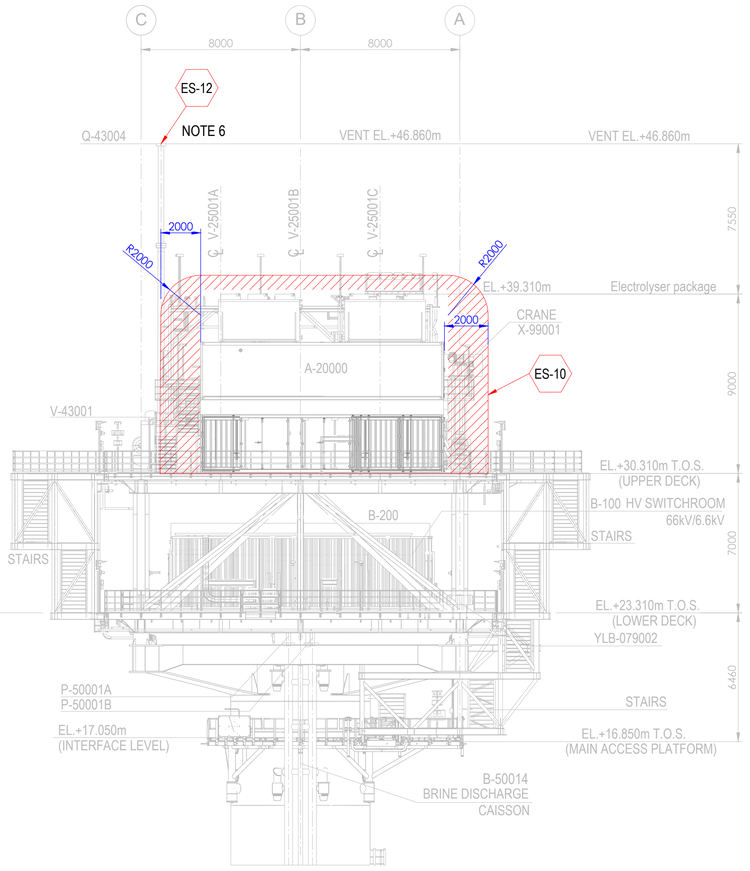

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

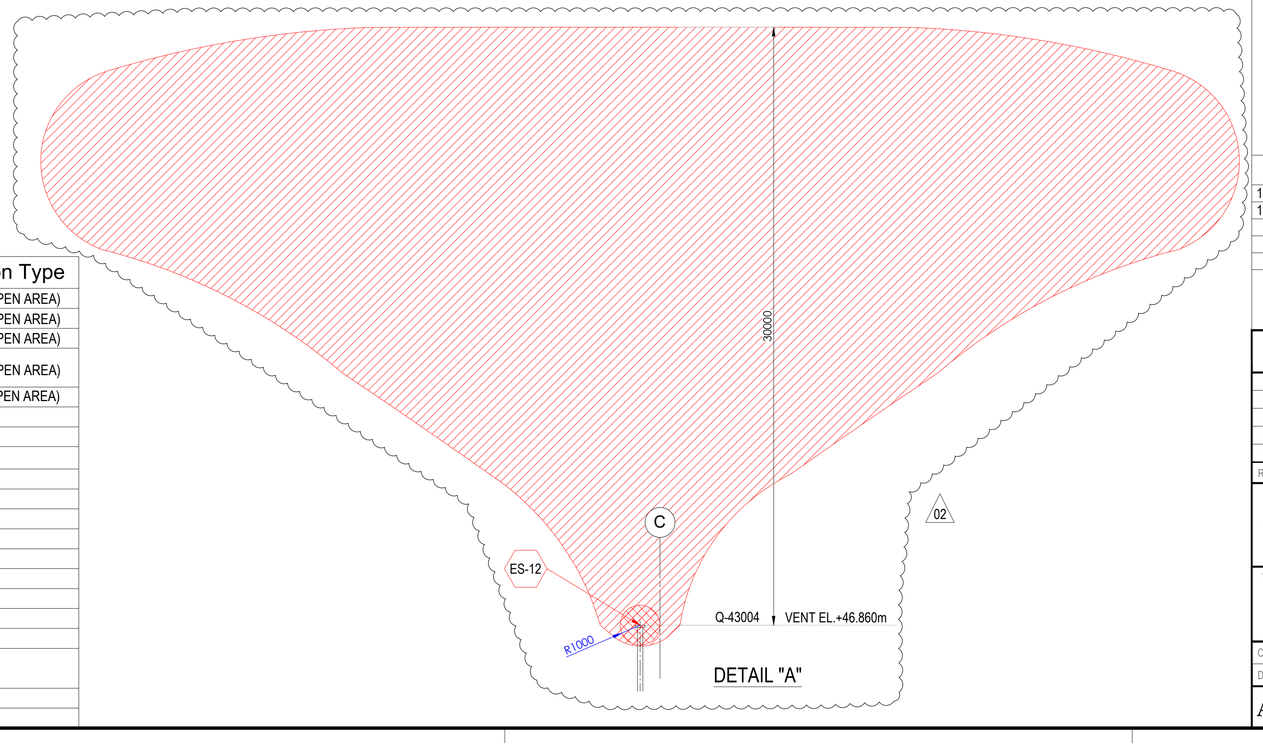



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-ZSHL-004	: Limit Switch Box - Vessel V-25001A Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80015
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001727	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		Batch n°:IT03B0127022			
Manufacturer	SOLDO			**Model**		SQN120E-20X23L7			
Cert No.	CML 19ATEX1359X			**Equipment Ambient Temp.**		-40°C to +80°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66/68

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	OK	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	OK	

ITEM	Tag	25-ZSHL-004	: Limit Switch Box - Vessel V-25001A Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80015
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001727		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	OK	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-ZSHL-004	: Limit Switch Box - Vessel V-25001A Hydrogen Inlet		Dwg	123A90-DDL-PR-PID-80015	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001727	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-29	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:33:42.930Z	PROVERLIS Digitaly signed by Alessio Polo 2025-01-29T13:08:11.087Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

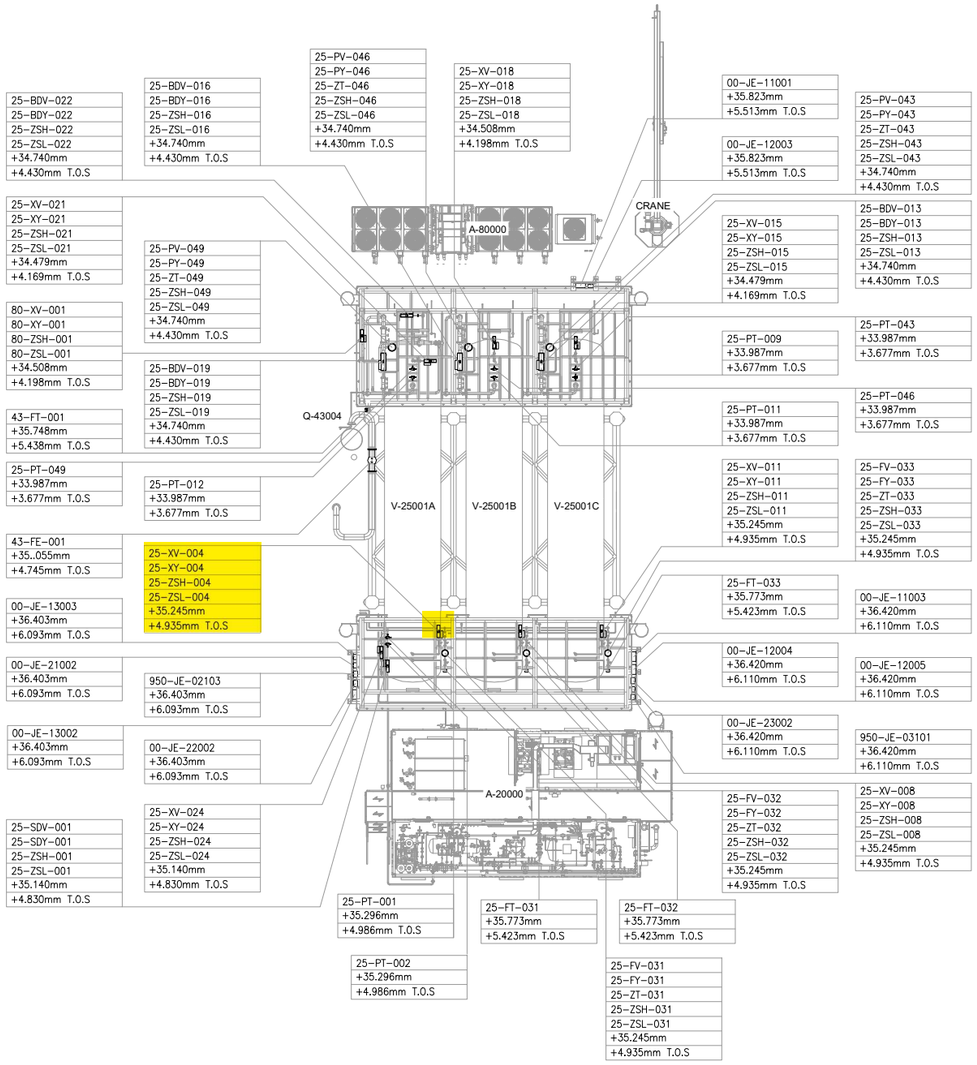

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 A

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg /AMB

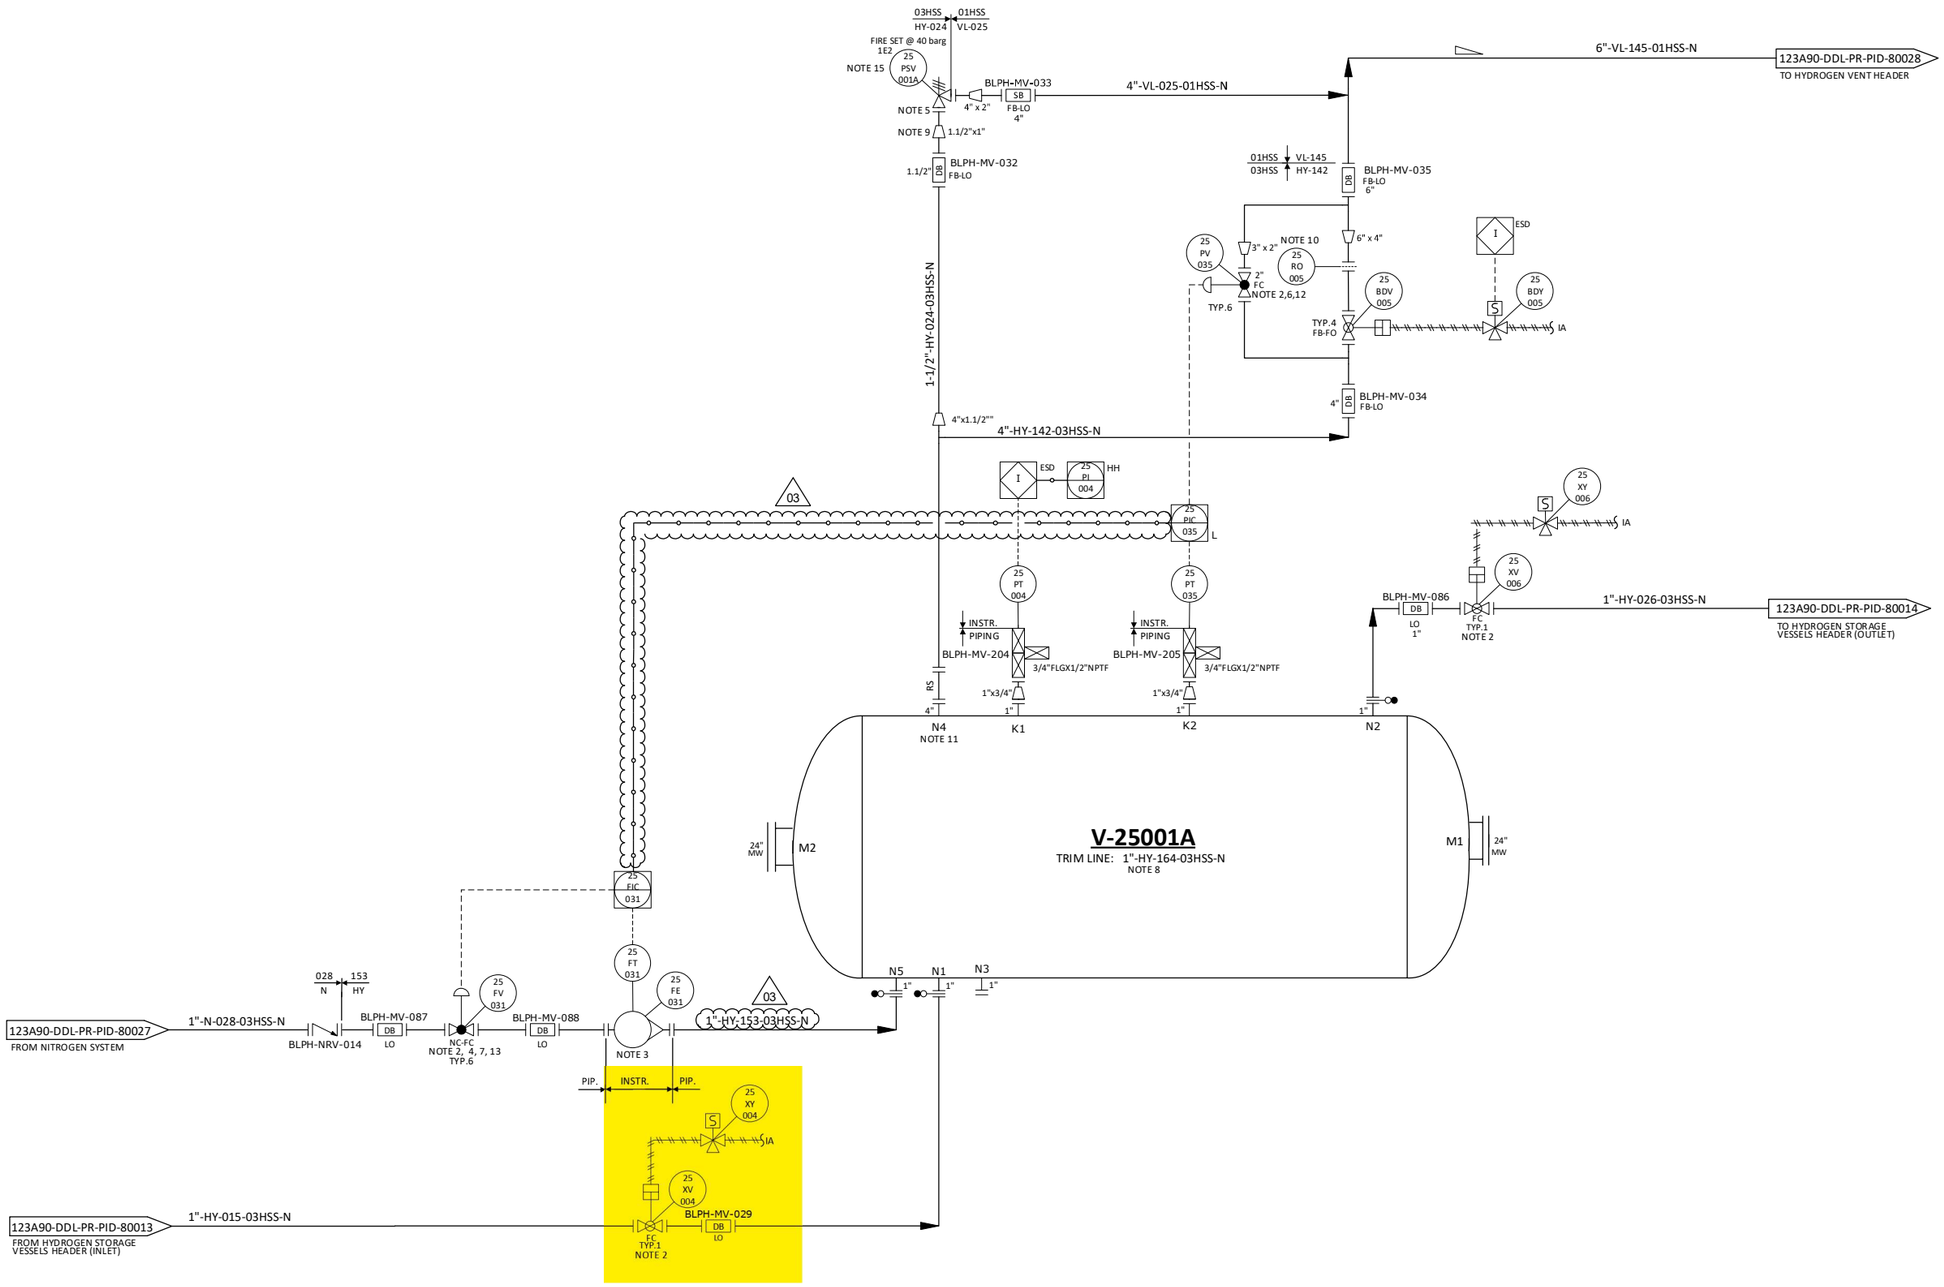

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-031) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-035 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-035 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-031 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-035 HAS FAILED TO CLOSE.
15. 25-PSV-001A SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL A

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80015		SHEET 001	REV. 03

File Name : FILE_NAME

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-12004	No.	MARSHALLING CABINET B400-PCS-002

<01>

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-004 (1, 2) WH BK PR1
- 25-ZSH-004 (5, 6) WH BK PR2

NOTE-2

C-25-XV-004/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-008 (1, 2) WH BK PR1
- 25-ZSH-008 (5, 6) WH BK PR2

NOTE-2

C-25-XV-008/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-011 (1, 2) WH BK PR1
- 25-ZSH-011 (5, 6) WH BK PR2

NOTE-2

C-25-XV-011/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-014 (1, 2) WH BK PR1
- 25-ZSH-014 (5, 6) WH BK PR2

NOTE-2

C-25-XV-014/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-017 (1, 2) WH BK PR1
- 25-ZSH-017 (5, 6) WH BK PR2

NOTE-2

C-25-XV-017/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-1

WH BK	1	WH BK	PR1
	2		
	SH		
WH BK	3	WH BK	PR2
	4		
	SH		
WH BK	5	WH BK	PR3
	6		
	SH		
WH BK	7	WH BK	PR4
	8		
	SH		
WH BK	9	WH BK	PR5
	10		
	SH		
WH BK	11	WH BK	PR6
	12		
	SH		
WH BK	13	WH BK	PR7
	14		
	SH		
WH BK	15	WH BK	PR8
	16		
	SH		
WH BK	17	WH BK	PR9
	18		
	SH		
WH BK	19	WH BK	PR10
	20		
	SH		
SPARE	21	WH BK	PR11
	22		
	SH		
SPARE	23	WH BK	PR12
	24		
	SH		
	OS		

00-JE-12004_1/B400-PCS-002
12x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-00-JE-12004

PR1 WH BK	1	25-ZSL-004
Shield Bar	2	
PR2 WH BK	3	25-ZSH-004
Shield Bar	4	
PR3 WH BK	5	25-ZSL-008
Shield Bar	6	
PR4 WH BK	7	25-ZSH-008
Shield Bar	8	
PR5 WH BK	9	25-ZSL-011
Shield Bar	10	
PR6 WH BK	11	25-ZSH-011
Shield Bar	12	
PR7 WH BK	13	25-ZSL-014
Shield Bar	14	
PR8 WH BK	15	25-ZSH-014
Shield Bar	16	
PR9 WH BK	17	25-ZSL-017
Shield Bar	18	
PR10 WH BK	19	25-ZSH-017
Shield Bar	20	
PR11 WH BK	21	SPARE
Shield Bar	22	
PR12 WH BK	23	SPARE
	24	

Shield Bar
I.E.

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO


TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-12004-SH.1 OF 2

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 019	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

E33

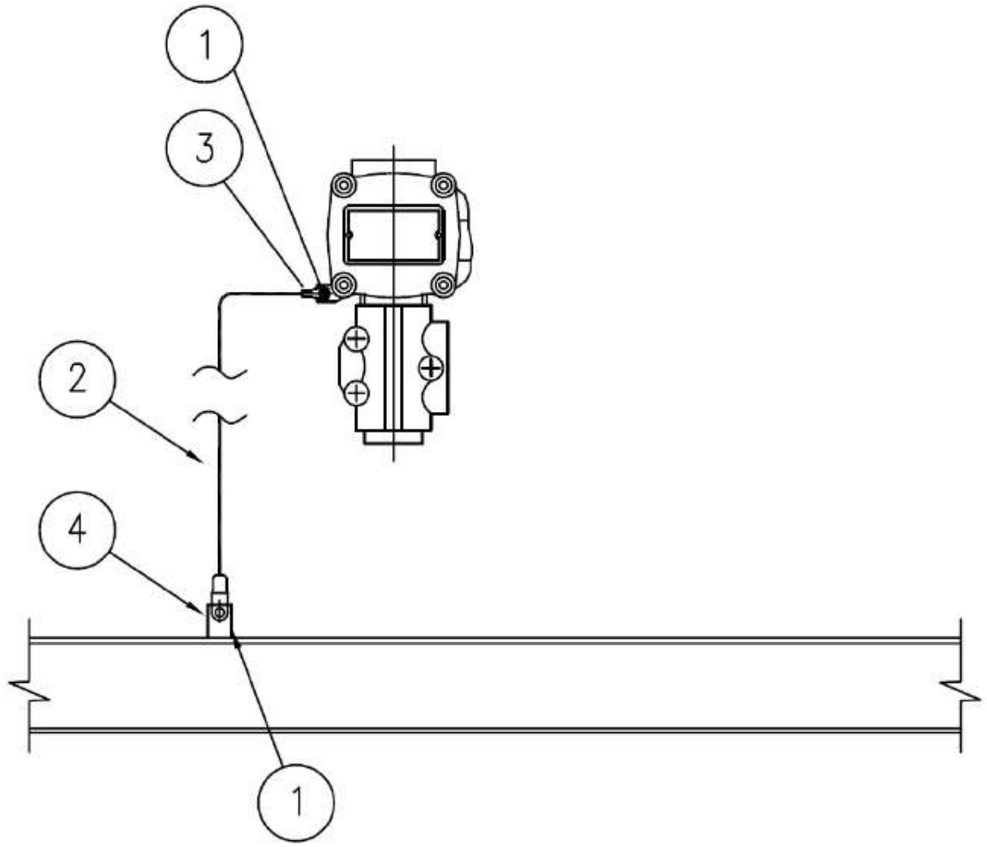

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

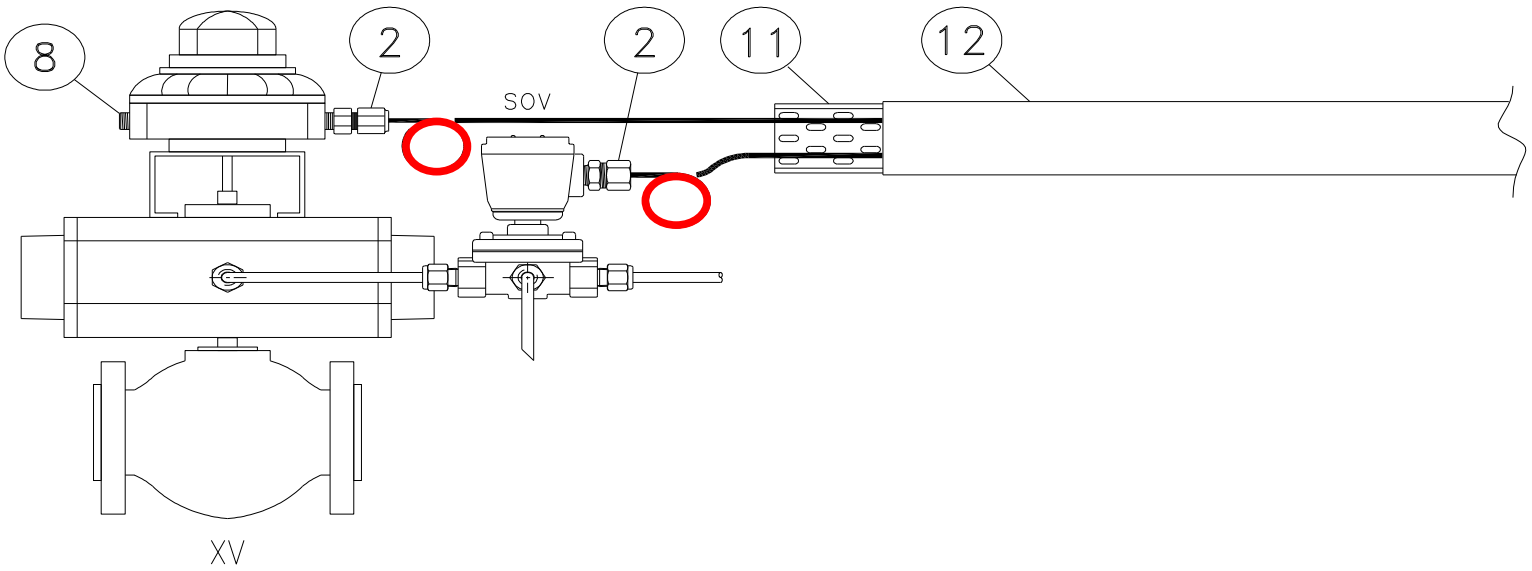

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

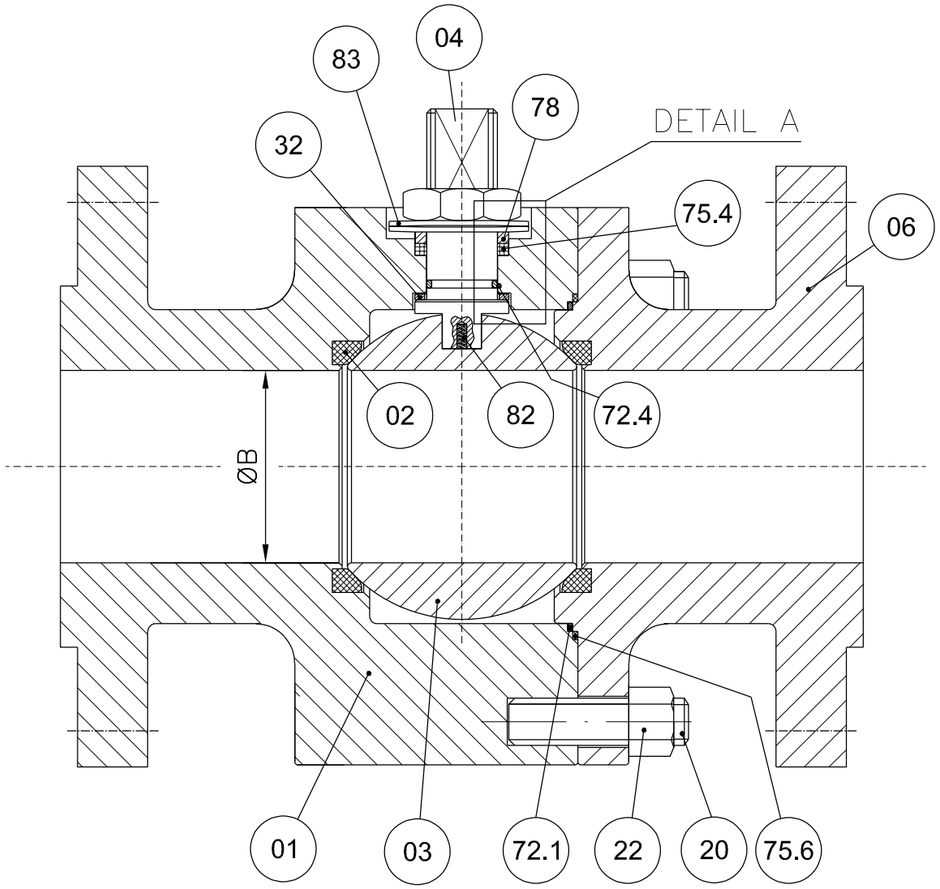

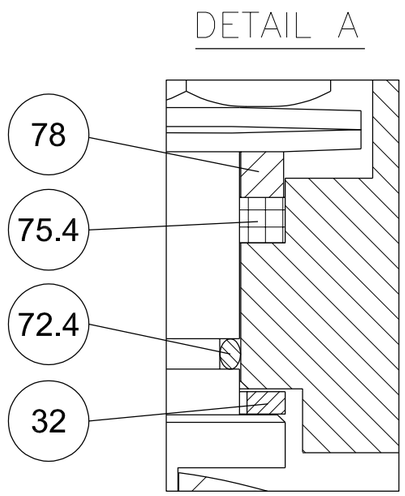


POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-ZSH-019	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-022	Hyrogen from vessels outlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSH-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-031	Nitrogen to V-25001A vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-032	Nitrogen to V-25001B vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-033	Nitrogen to V-25001C vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-034	Nitrogen to V-25001D vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-036	Nitrogen to V-25001F vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-038	Nitrogen to V-25001E vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSH-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSL-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSL-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSL-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSL-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSL-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSL-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSL-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSL-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSL-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSL-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-ZSL-019	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSL-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSL-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-022	Hyrogen from vessels outlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSL-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSL-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSL-031	Nitrogen to V-25001A vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-032	Nitrogen to V-25001B vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2

EU Type Examination Certificate CML 19ATEX1359X Issue 1

1 Equipment intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU

2 Equipment **SOLDO™ SK and SQ Series Limit Switch Boxes**

3 Manufacturer **Rotork Instruments Italy srl**

4 Address **Via Portico 17**
24050
Orio al Serio (BG)
Italy

5 The equipment is specified in the description of this certificate and the documents to which it refers.

6 CML B.V., Chamber of Commerce No 67386717, Koopvaardijweg 32, 4906CV Oosterhout, The Netherlands, Notified Body Number 2776, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this equipment has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment intended for use in potentially explosive atmospheres given in Annex II to the Directive.

The examination and test results are recorded in the confidential reports listed in Section 12.

7 If an 'X' suffix appears after the certificate number, it indicates that the equipment is subject to conditions of safe use (affecting correct installation or safe use). These are specified in Section 14.

8 This EU Type Examination certificate relates only to the design and construction of the specified equipment or component. Further requirements of Directive 2014/34/EU Article 13 apply to the manufacture of the equipment or component and are separately certified.

9 Compliance with the Essential Health and Safety Requirements, with the exception of those listed in the confidential report, has been demonstrated through compliance with the following documents:

EN IEC 60079-0:2018 EN 60079-1:2014 EN 60079-31:2014

10 The equipment shall be marked with the following:

Ⅱ 2 G D

Ex db IIC T* Gb

Ex tb IIIC T*°C Db

Ta = -55°C to +*°C

**The ambient temperature classes and maximum surface temperature for dust depend upon the ambient temperature ranges. See Table in Section 11.*

11 Description

The SOLDO™ SK and SQ Series Limit Switch Boxes are electromechanical devices used to indicate the position of valves/actuators etc. by means of an electrical signal and an optional visual indicator. The metallic enclosure is constructed from aluminium (SK) or 316 or 316L stainless steel (SQ) and comprises of two enclosure halves secured with 4 x M6 stainless steel fasteners with a minimum property class of 500 MPa. An operating rod passes through each enclosure half for connection to the device being monitored. The rod operates the internal switch/sensor for signalling and passes through to the external indicator (when fitted). There are two threaded entries (M20 or ½" NPT) into the enclosure for cable entry.

The applicable ambient temperature ranges and corresponding Temperature Classes and Maximum Surface Temperatures for Dust are detailed in the table below:

Ambient Temp. Range	T Class	Maximum Surface Temp. for Dust
-55°C to +60°C	T6	T85°C
-55°C to +80°C	T5	T100°C
-55°C to +105°C	T4	T135°C

Rating:

Max. Voltage: 125 Vdc/250 Vac
Max. Current: 10 A
Max. Power: 10 W

Notes:

- Sira 12ATEX1098X is superseded by this certificate.
- The product covered by Issue 0 of this certificate remains identical to that previously covered by Sira 12ATEX1098X.
- Where Sira 12ATEX1098X is specified in other product certification, or other technical specifications, this certificate reference for the product shall be used in its place; updating of the other product certificate or technical specification is not required.

Variation 1

This variation introduced the following changes:

i. Introduction of power dissipation calculation as supporting certification document.

12 Certificate history and evaluation reports

Issue	Date	Associated report	Notes
0	04 Oct 2019	R12654A/00	Initial issue
1	27 Mar 2024	R17518A/00	Introduction of Variation 1

Note: Drawings that describe the equipment or component are listed in the Annex.

13 Conditions of Manufacture

The following conditions are required of the manufacturing process for compliance with the certification.

i. Where the product incorporates certified parts or safety critical components, the manufacturer of the product defined on this certificate shall continually monitor these parts/components for any modifications introduced by the manufacturer(s) of these constituent parts. If the manufacturer of any constituent part introduces any changes which affect the compliance of the certified product that is the subject of this certificate, the manufacturer is required to have this certificate updated.

ii. The power dissipation inside the flameproof enclosure shall not exceed 10 W.

14 Specific Conditions of Use (Special Conditions)

The following conditions relate to safe installation and/or use of the equipment.

i. The equipment is fitted with a non-conducting position indicator which could potentially generate an ignition-capable level of electrostatic charge under certain extreme conditions. Therefore, the equipment shall not be installed in a location where it may be subjected to external conditions (such as high-pressure steam) which might cause a build-up of electrostatic charge on the non-conducting surfaces. Additionally, cleaning of the equipment should be done only with a damp cloth.

ii. The maximum temperature at the cable entry points may exceed 70°C. The user shall refer to the manufacturer's instructions document for guidance in respect of the selection of suitable cabling for the equipment.

iii. Dust layers in excess of 50 mm shall not be allowed to form on the equipment.

iv. The following have a minimum flamepath width (L) and maximum gap (i_c) other than that detailed in EN 60079-1 Table 3 and are detailed below:

Flamepath	**Joint Width (L) mm**	**Max. Gap (i_c) mm**
Cover shaft/Cover	26	0.097
Body Shaft/Body	26	0.097

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR	25-SDV-023	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE

GENERAL	1	Tag Number	Location			25-XV-004		25
	2	Service				HYDROGEN STORAGE TANK V-25001A INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80015		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-015-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close : (12)		Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum		Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-004 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-004 (9, 17) - Soldo SS		25-ZSH-004 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND


ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

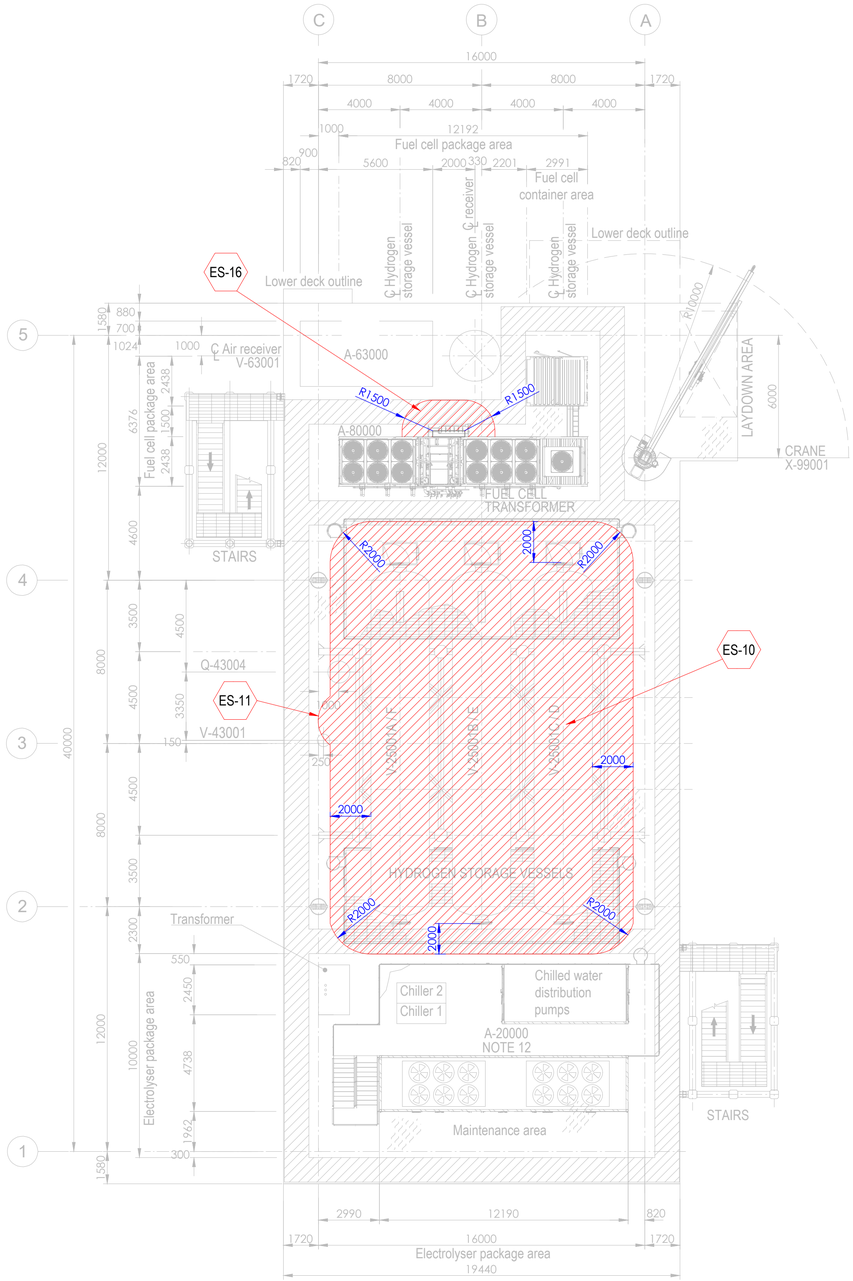


PLAN ON UPPER DECK
EL+30.310 T.O.S.

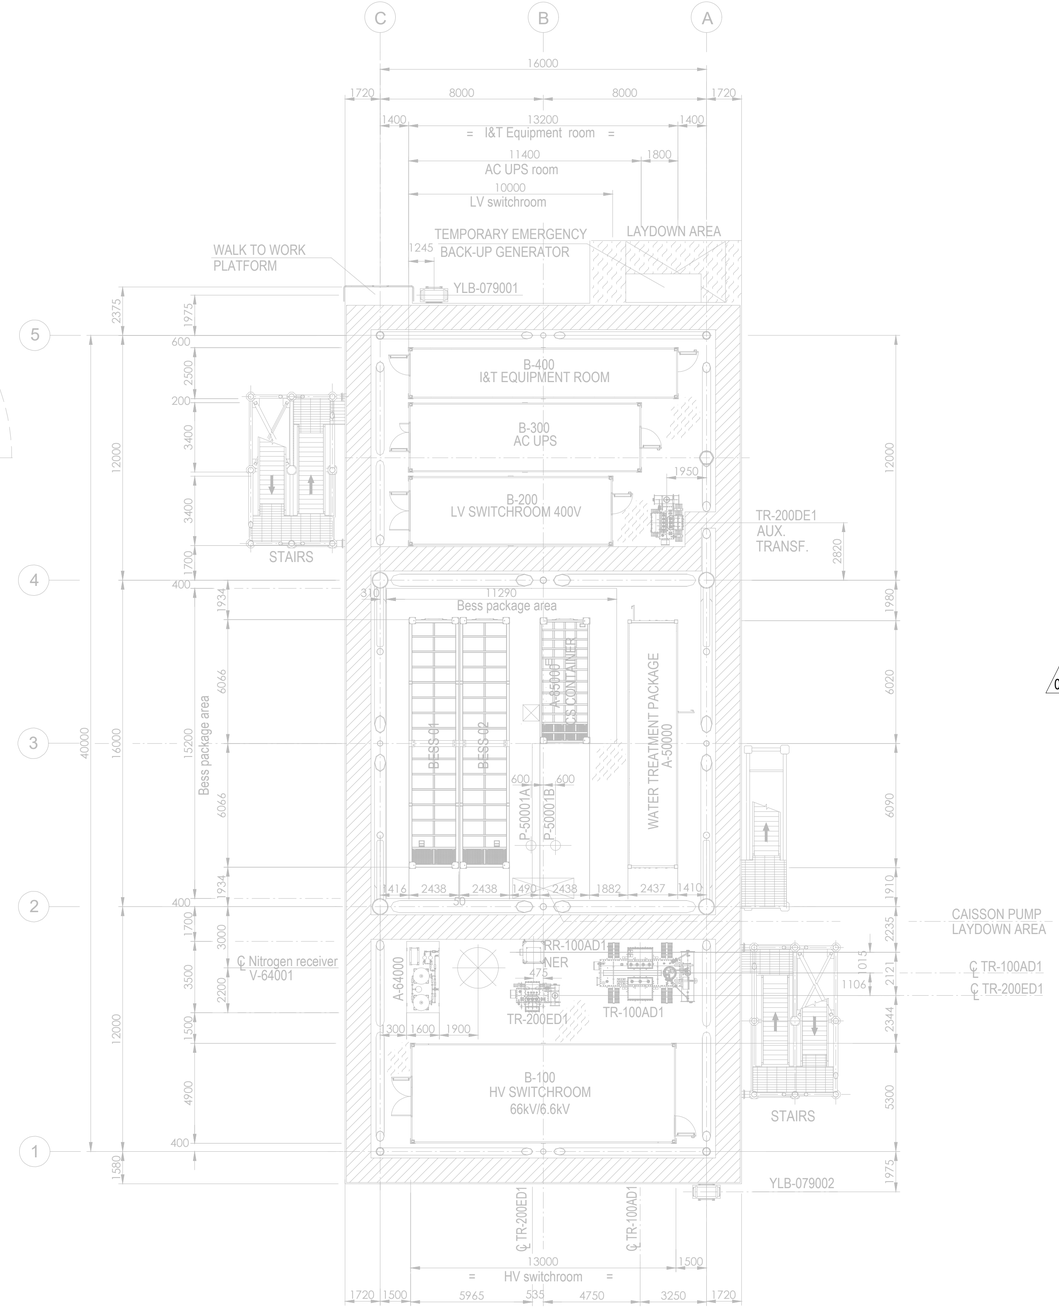

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

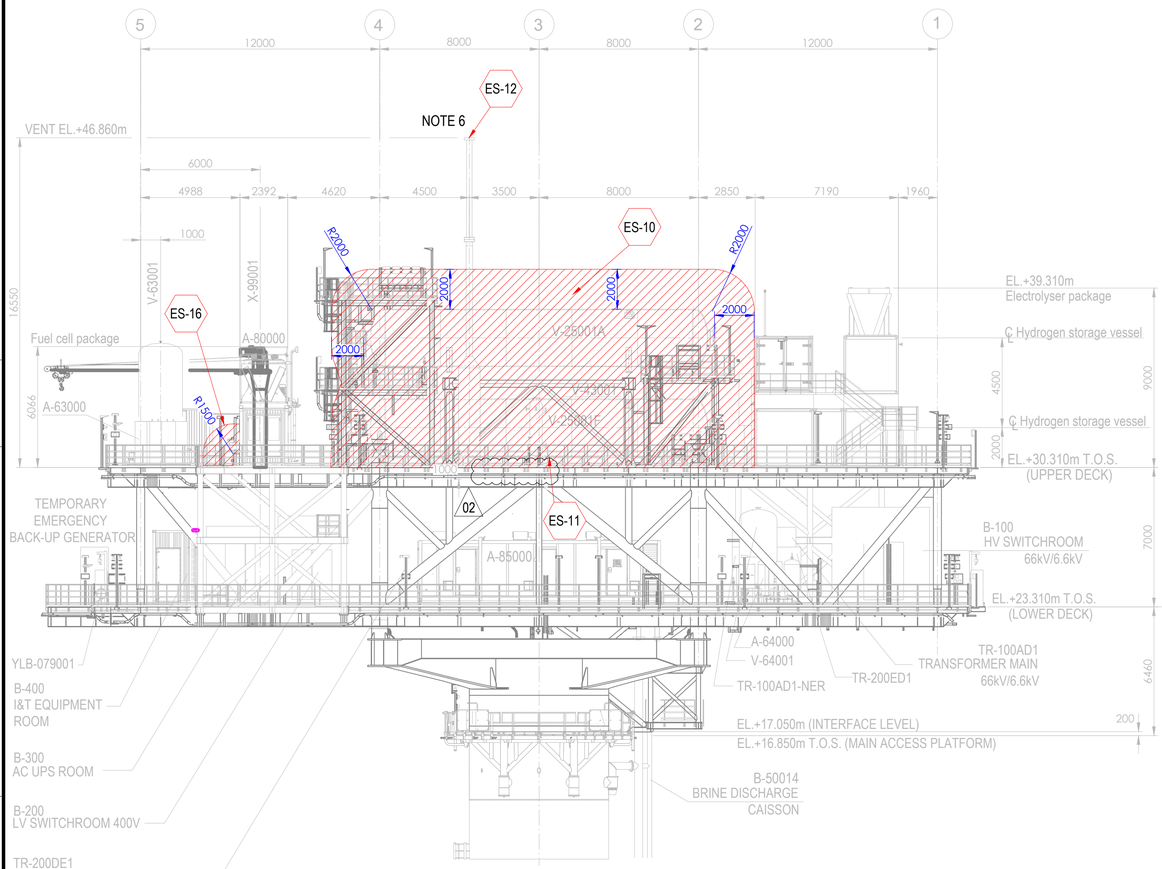



ELEVATION LOOKING EAST

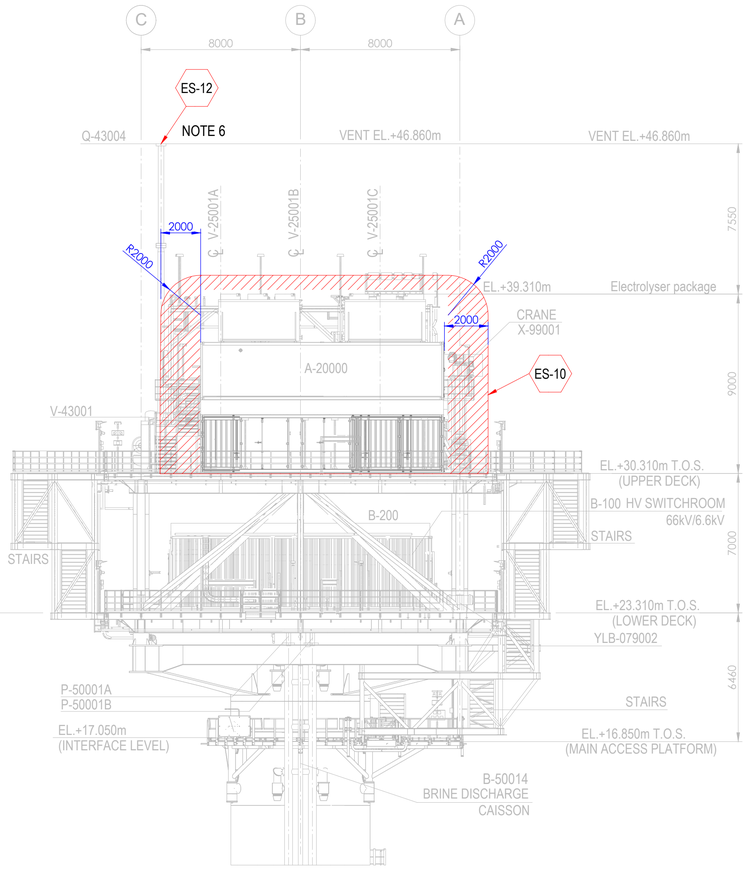

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

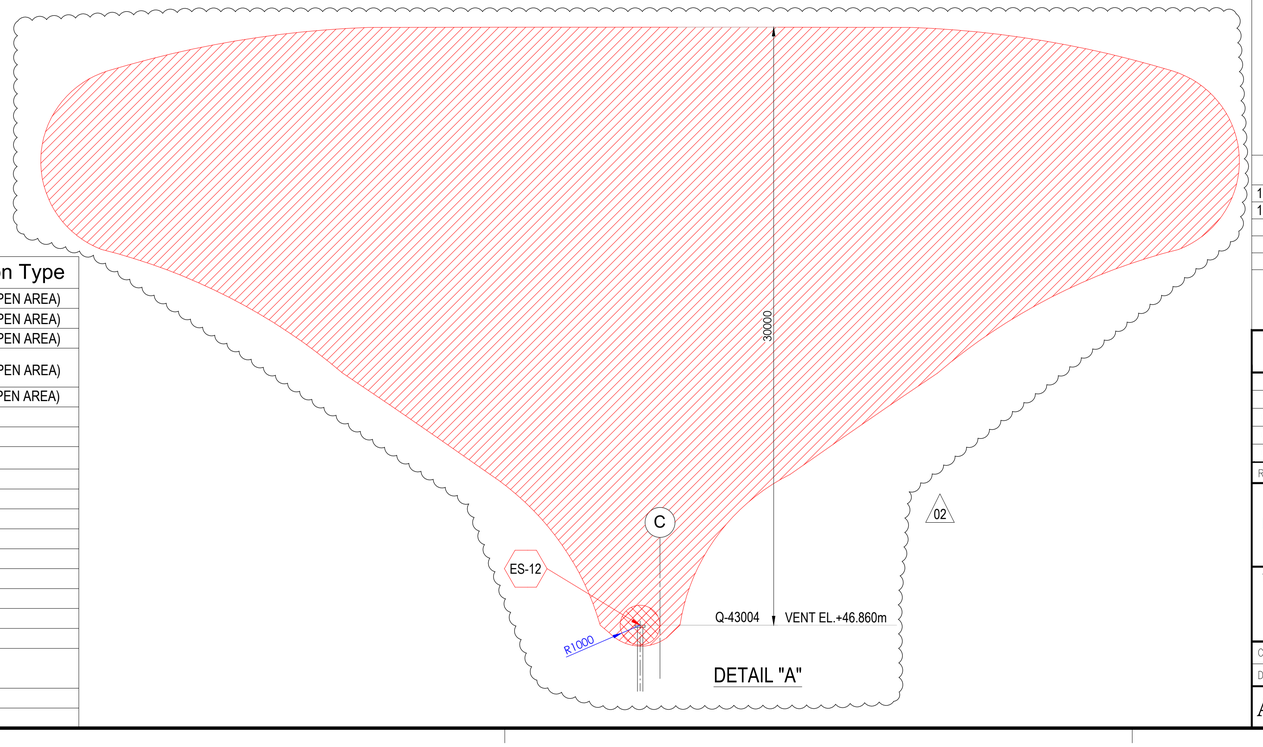



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-ZSHL-008	: Limit Switch Box - Vessel V-25001B Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001729	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		Batch: IT03B0127022			
Manufacturer	SOLDO			**Model**		SQN120E-20X23L7			
Cert No.	CML 19ATEX1359X			**Equipment Ambient Temp.**		-40°C to +80°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66/68

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	OK	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	OK	

ITEM	Tag	25-ZSHL-008	: Limit Switch Box - Vessel V-25001B Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001729	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	OK	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-ZSHL-008	: Limit Switch Box - Vessel V-25001B Hydrogen Inlet		Dwg	123A90-DDL-PR-PID-80016	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001729	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type "nR" only)	x	NA	
71	Breathing operation is satisfactory (type "nR" only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for 'IS' Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-29	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:36:58.116Z	PROVERLIS Digitaly signed by Alessio Polo 2025-01-29T13:06:23.268Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

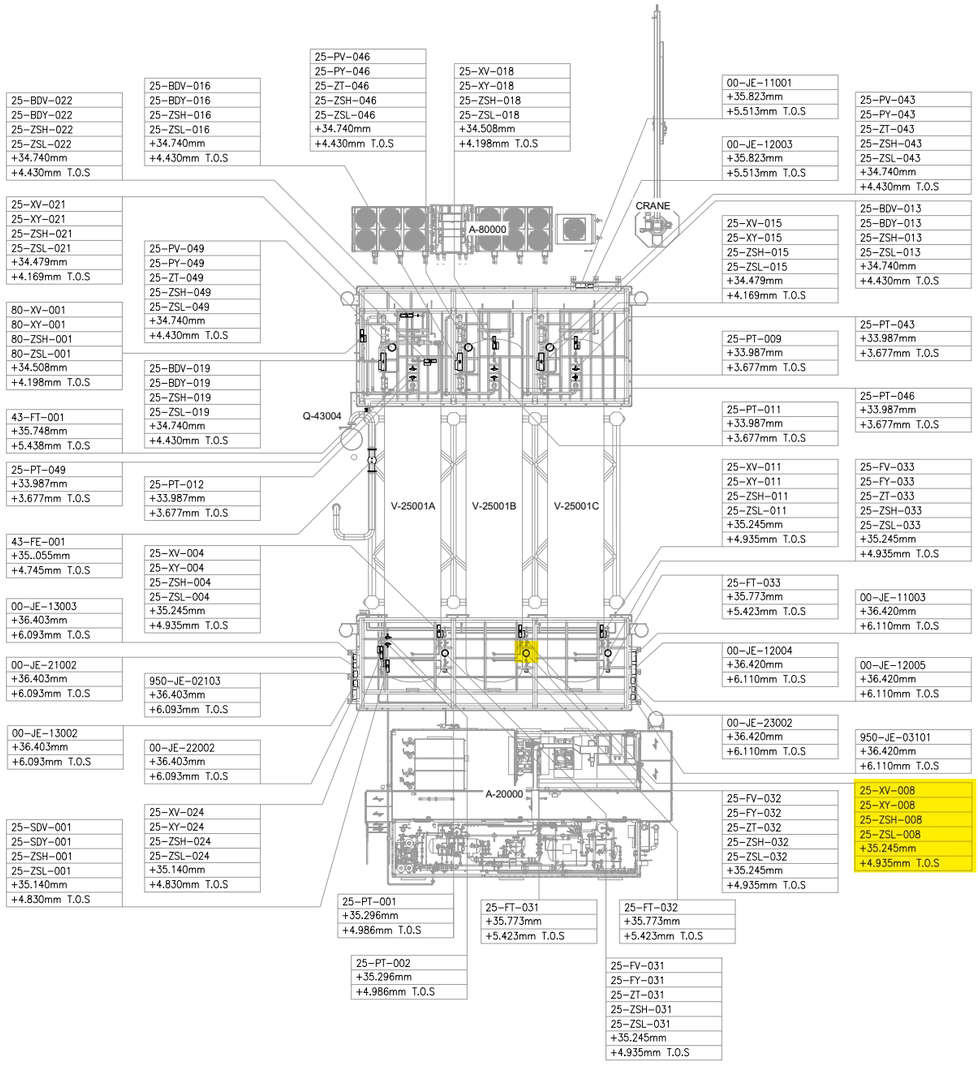

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90–DDL–IN–DL–40081	002	02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 B

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

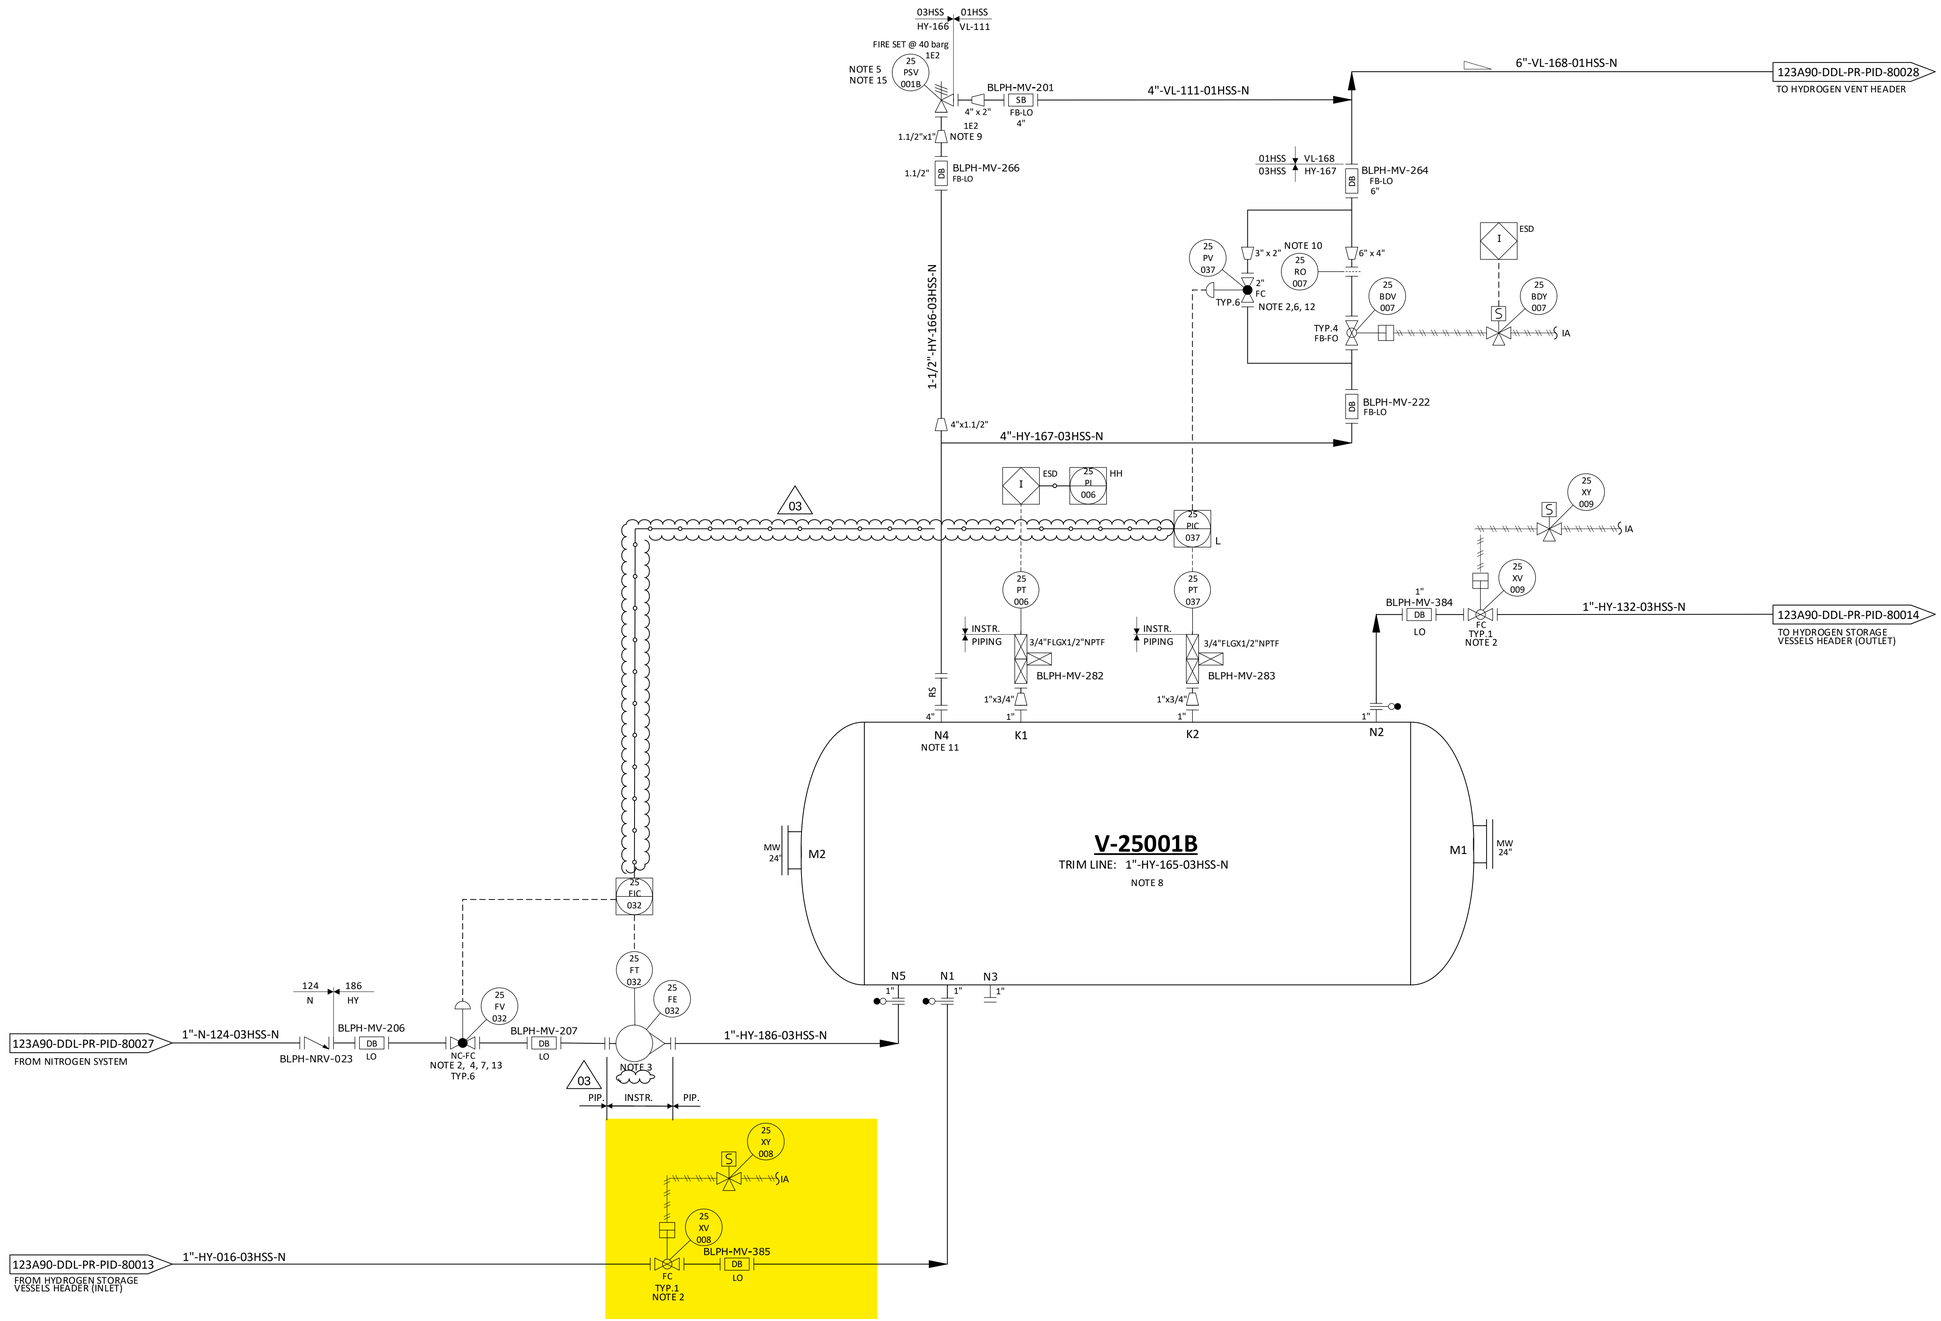

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-032) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. (03)
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-037 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC."PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-037 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. (03)
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-032 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-037 HAS FAILED TO CLOSE.
15. 25-PSV-001B SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL B

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80016	SHEET 001	REV. 03

File Name : FILE_NAME

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-12004	No.	MARSHALLING CABINET B400-PCS-002

<01>

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-004 (1, 2) WH BK → PR1
- 25-ZSH-004 (5, 6) WH BK → PR2
- NOTE-2
- C-25-XV-004/00-JE-12004
- 2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-008 (1, 2) WH BK → PR1
- 25-ZSH-008 (5, 6) WH BK → PR2
- NOTE-2
- C-25-XV-008/00-JE-12004
- 2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-011 (1, 2) WH BK → PR1
- 25-ZSH-011 (5, 6) WH BK → PR2
- NOTE-2
- C-25-XV-011/00-JE-12004
- 2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-014 (1, 2) WH BK → PR1
- 25-ZSH-014 (5, 6) WH BK → PR2
- NOTE-2
- C-25-XV-014/00-JE-12004
- 2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-017 (1, 2) WH BK → PR1
- 25-ZSH-017 (5, 6) WH BK → PR2
- NOTE-2
- C-25-XV-017/00-JE-12004
- 2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-1

1	WH BK	PR1
2		
SH		
3	WH BK	PR2
4		
SH		
5	WH BK	PR3
6		
SH		
7	WH BK	PR4
8		
SH		
9	WH BK	PR5
10		
SH		
11	WH BK	PR6
12		
SH		
13	WH BK	PR7
14		
SH		
15	WH BK	PR8
16		
SH		
17	WH BK	PR9
18		
SH		
19	WH BK	PR10
20		
SH		
SPARE 21	WH BK	PR11
22		
SH		
SPARE 23	WH BK	PR12
24		
SH		
OS		

00-JE-12004_1/B400-PCS-002
12x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-00-JE-12004

PR1	1 WH BK	25-ZSL-004
Shield Bar	2	
PR2	3 WH BK	25-ZSH-004
Shield Bar	4	
PR3	5 WH BK	25-ZSL-008
Shield Bar	6	
PR4	7 WH BK	25-ZSH-008
Shield Bar	8	
PR5	9 WH BK	25-ZSL-011
Shield Bar	10	
PR6	11 WH BK	25-ZSH-011
Shield Bar	12	
PR7	13 WH BK	25-ZSL-014
Shield Bar	14	
PR8	15 WH BK	25-ZSH-014
Shield Bar	16	
PR9	17 WH BK	25-ZSL-017
Shield Bar	18	
PR10	19 WH BK	25-ZSH-017
Shield Bar	20	
PR11	21 WH BK	SPARE
Shield Bar	22	
PR12	23 WH BK	SPARE
	24	

Shield Bar
I.E.

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO


TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-12004-SH.1 OF 2

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 019	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

E33

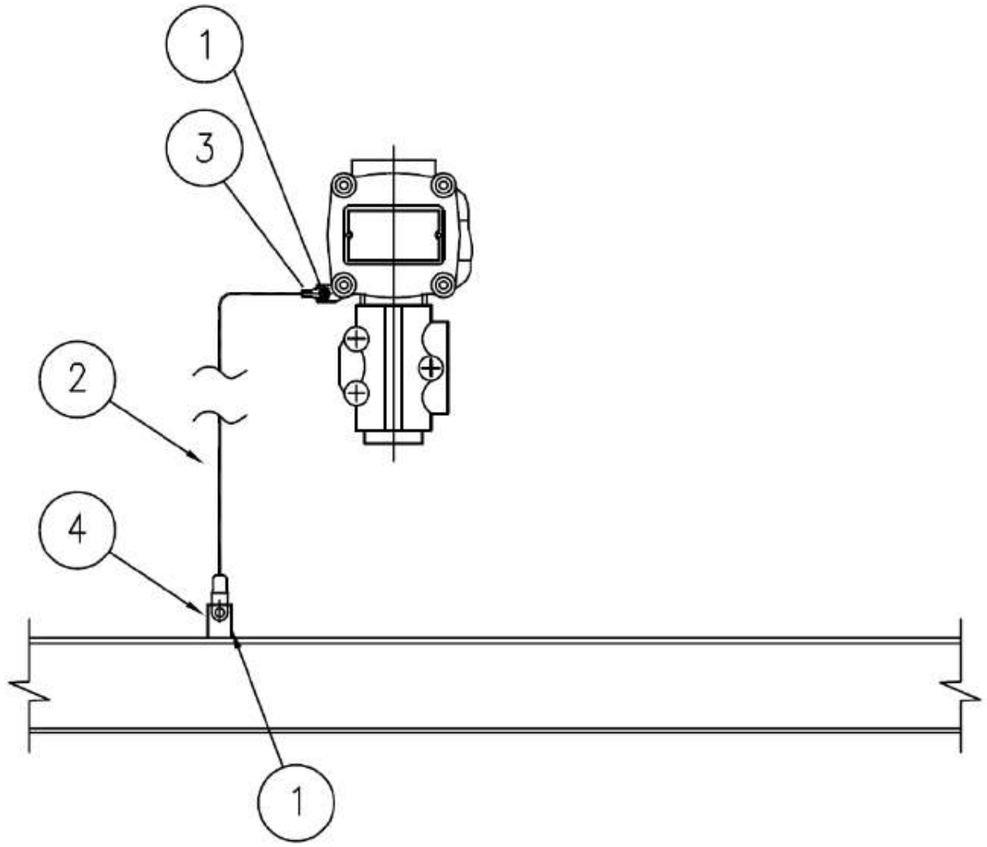

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

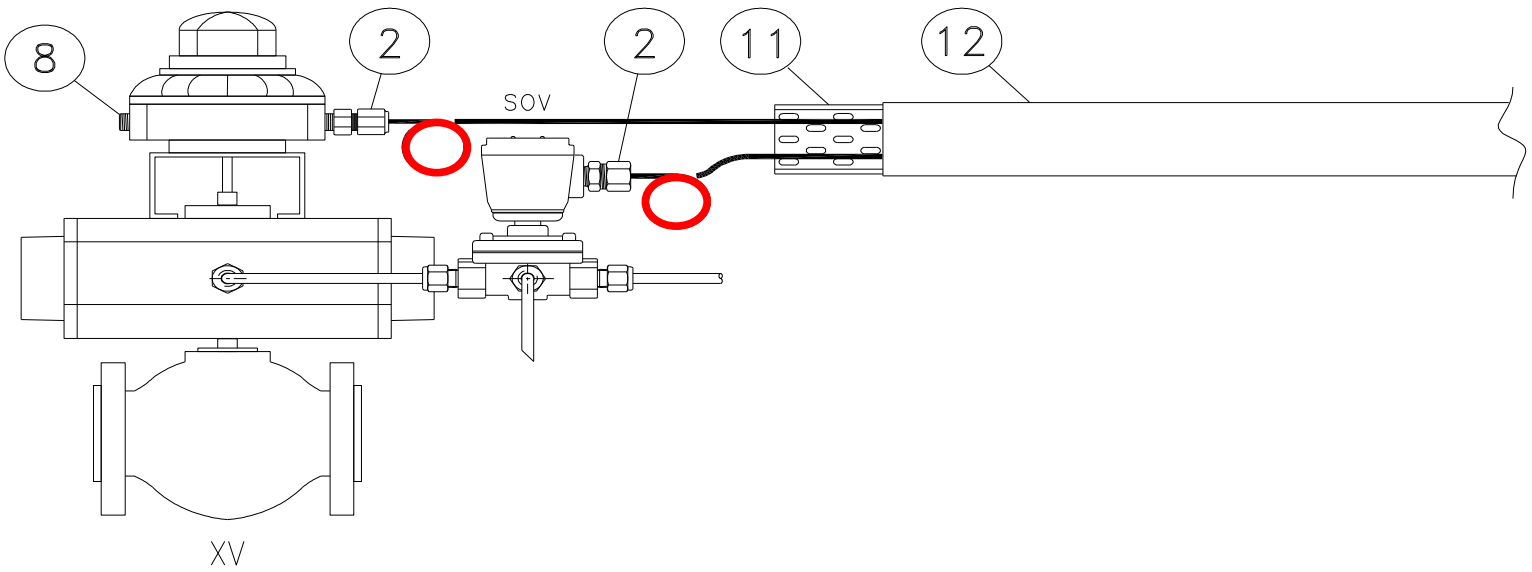

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

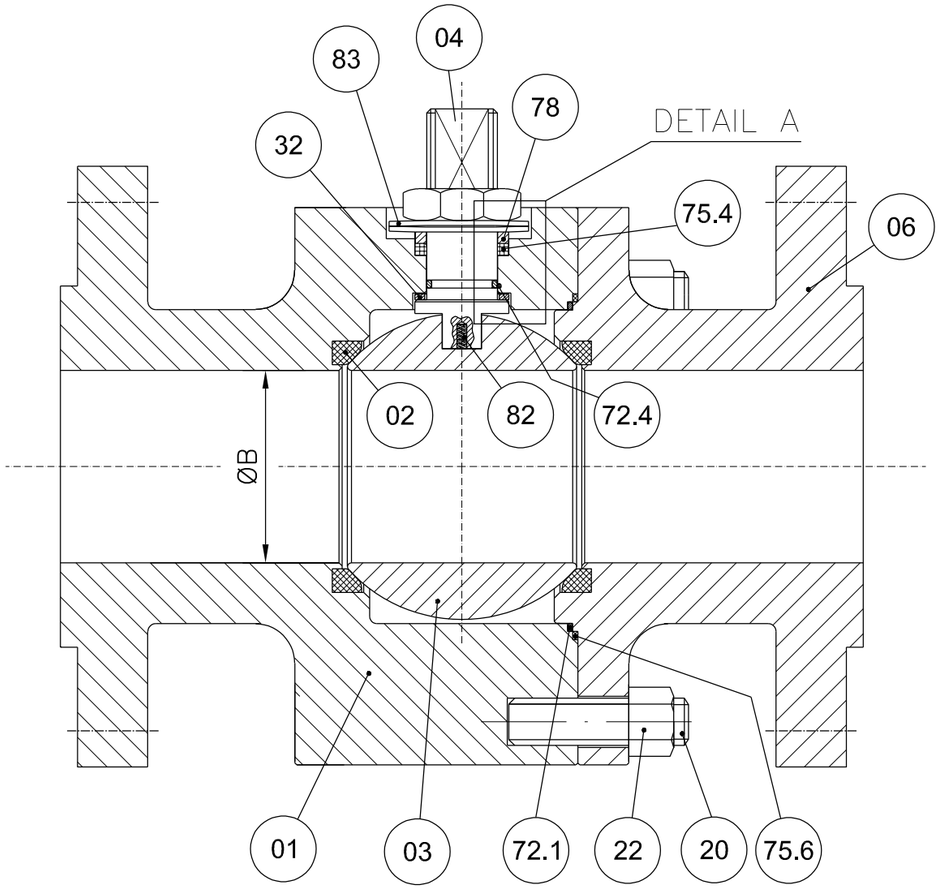

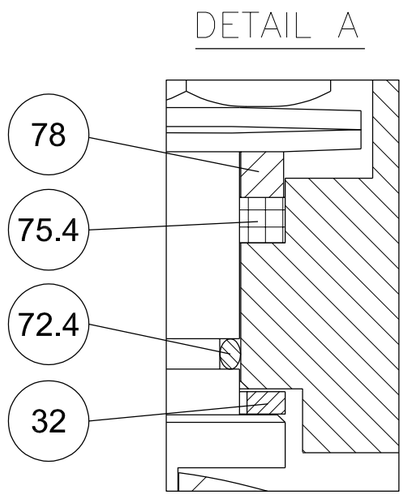


POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: D240062-08 | Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-008	25	
	2	Service				HYDROGEN STORAGE TANK V-25001B INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80016	Zone 2, Gas Group IIC (or IIB+H2), Class T1	
PIPELINE	4	Line Number				1"-HY-016-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm	1" / 3.38 mm	
	6	Line Material	Line Insulation			ASTM A312/TP316/316L	NOT INSUL. (PAINTED) (35)	
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS	GAS	
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29	80	
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close : (12)	Open : (12)	
	17	Operation (seconds)	Actual			Close : 0.3 minimum	Open : -	
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"	FULL BORE	
	22	Body Material	Bonnet Type			ASTM A182 F316/316L	(*)	
	23	Connections	Rating			FLANGED ASME B16.5	#300	
	24	Flange Finish	Gasket Material			RF	Inside the valve (*) (38)	
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)	(*)	
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork	Spring Return	
	31	Model No.	Size			CP/S	035-100A/BA	
	32	Actuator Orientation	Actuator Form			Horizontal	Cylinder	
	33	Ingress Protection	Certification			IP-66	II 2 G Ex h IIC T5 Gb	
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE	CLOSE	
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-008(9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-008 (9, 17) - Soldo SS	25-ZSH-008 (9, 17) - Soldo SS	
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)	NOT REQUIRED	
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20	H	
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-	-	
	48	Check Valve	Mounting			-	-	
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-ZSH-019	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-022	Hyrogen from vessels outlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSH-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-031	Nitrogen to V-25001A vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-032	Nitrogen to V-25001B vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-033	Nitrogen to V-25001C vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-034	Nitrogen to V-25001D vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-036	Nitrogen to V-25001F vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-038	Nitrogen to V-25001E vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSH-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSL-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSL-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSL-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSL-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSL-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSL-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSL-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSL-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSL-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSL-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-ZSL-019	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSL-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSL-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-022	Hyrogen from vessels outlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSL-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSL-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSL-031	Nitrogen to V-25001A vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-032	Nitrogen to V-25001B vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2

EU Type Examination Certificate CML 19ATEX1359X Issue 1

1 Equipment intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU

2 Equipment **SOLDO™ SK and SQ Series Limit Switch Boxes**

3 Manufacturer **Rotork Instruments Italy srl**

4 Address **Via Portico 17**
24050
Orio al Serio (BG)
Italy

5 The equipment is specified in the description of this certificate and the documents to which it refers.

6 CML B.V., Chamber of Commerce No 67386717, Koopvaardijweg 32, 4906CV Oosterhout, The Netherlands, Notified Body Number 2776, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this equipment has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment intended for use in potentially explosive atmospheres given in Annex II to the Directive.

The examination and test results are recorded in the confidential reports listed in Section 12.

7 If an 'X' suffix appears after the certificate number, it indicates that the equipment is subject to conditions of safe use (affecting correct installation or safe use). These are specified in Section 14.

8 This EU Type Examination certificate relates only to the design and construction of the specified equipment or component. Further requirements of Directive 2014/34/EU Article 13 apply to the manufacture of the equipment or component and are separately certified.

9 Compliance with the Essential Health and Safety Requirements, with the exception of those listed in the confidential report, has been demonstrated through compliance with the following documents:

EN IEC 60079-0:2018 EN 60079-1:2014 EN 60079-31:2014

10 The equipment shall be marked with the following:

Ⅱ 2 G D

Ex db IIC T* Gb

Ex tb IIIC T*°C Db

Ta = -55°C to +*°C

**The ambient temperature classes and maximum surface temperature for dust depend upon the ambient temperature ranges. See Table in Section 11.*

11 Description

The SOLDO™ SK and SQ Series Limit Switch Boxes are electromechanical devices used to indicate the position of valves/actuators etc. by means of an electrical signal and an optional visual indicator. The metallic enclosure is constructed from aluminium (SK) or 316 or 316L stainless steel (SQ) and comprises of two enclosure halves secured with 4 x M6 stainless steel fasteners with a minimum property class of 500 MPa. An operating rod passes through each enclosure half for connection to the device being monitored. The rod operates the internal switch/sensor for signalling and passes through to the external indicator (when fitted). There are two threaded entries (M20 or ½" NPT) into the enclosure for cable entry.

The applicable ambient temperature ranges and corresponding Temperature Classes and Maximum Surface Temperatures for Dust are detailed in the table below:

Ambient Temp. Range	T Class	Maximum Surface Temp. for Dust
-55°C to +60°C	T6	T85°C
-55°C to +80°C	T5	T100°C
-55°C to +105°C	T4	T135°C

Rating:

Max. Voltage: 125 Vdc/250 Vac
Max. Current: 10 A
Max. Power: 10 W

Notes:

- Sira 12ATEX1098X is superseded by this certificate.
- The product covered by Issue 0 of this certificate remains identical to that previously covered by Sira 12ATEX1098X.
- Where Sira 12ATEX1098X is specified in other product certification, or other technical specifications, this certificate reference for the product shall be used in its place; updating of the other product certificate or technical specification is not required.

Variation 1

This variation introduced the following changes:

i. Introduction of power dissipation calculation as supporting certification document.

12 Certificate history and evaluation reports

Issue	Date	Associated report	Notes
0	04 Oct 2019	R12654A/00	Initial issue
1	27 Mar 2024	R17518A/00	Introduction of Variation 1

Note: Drawings that describe the equipment or component are listed in the Annex.

13 Conditions of Manufacture

The following conditions are required of the manufacturing process for compliance with the certification.

i. Where the product incorporates certified parts or safety critical components, the manufacturer of the product defined on this certificate shall continually monitor these parts/components for any modifications introduced by the manufacturer(s) of these constituent parts. If the manufacturer of any constituent part introduces any changes which affect the compliance of the certified product that is the subject of this certificate, the manufacturer is required to have this certificate updated.

ii. The power dissipation inside the flameproof enclosure shall not exceed 10 W.

14 Specific Conditions of Use (Special Conditions)

The following conditions relate to safe installation and/or use of the equipment.

i. The equipment is fitted with a non-conducting position indicator which could potentially generate an ignition-capable level of electrostatic charge under certain extreme conditions. Therefore, the equipment shall not be installed in a location where it may be subjected to external conditions (such as high-pressure steam) which might cause a build-up of electrostatic charge on the non-conducting surfaces. Additionally, cleaning of the equipment should be done only with a damp cloth.

ii. The maximum temperature at the cable entry points may exceed 70°C. The user shall refer to the manufacturer's instructions document for guidance in respect of the selection of suitable cabling for the equipment.

iii. Dust layers in excess of 50 mm shall not be allowed to form on the equipment.


iv. The following have a minimum flamepath width (L) and maximum gap (i_c) other than that detailed in EN 60079-1 Table 3 and are detailed below:

Flamepath	**Joint Width (L) mm**	**Max. Gap (i_c) mm**
Cover shaft/Cover	26	0.097
Body Shaft/Body	26	0.097


47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR	25-SDV-023	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

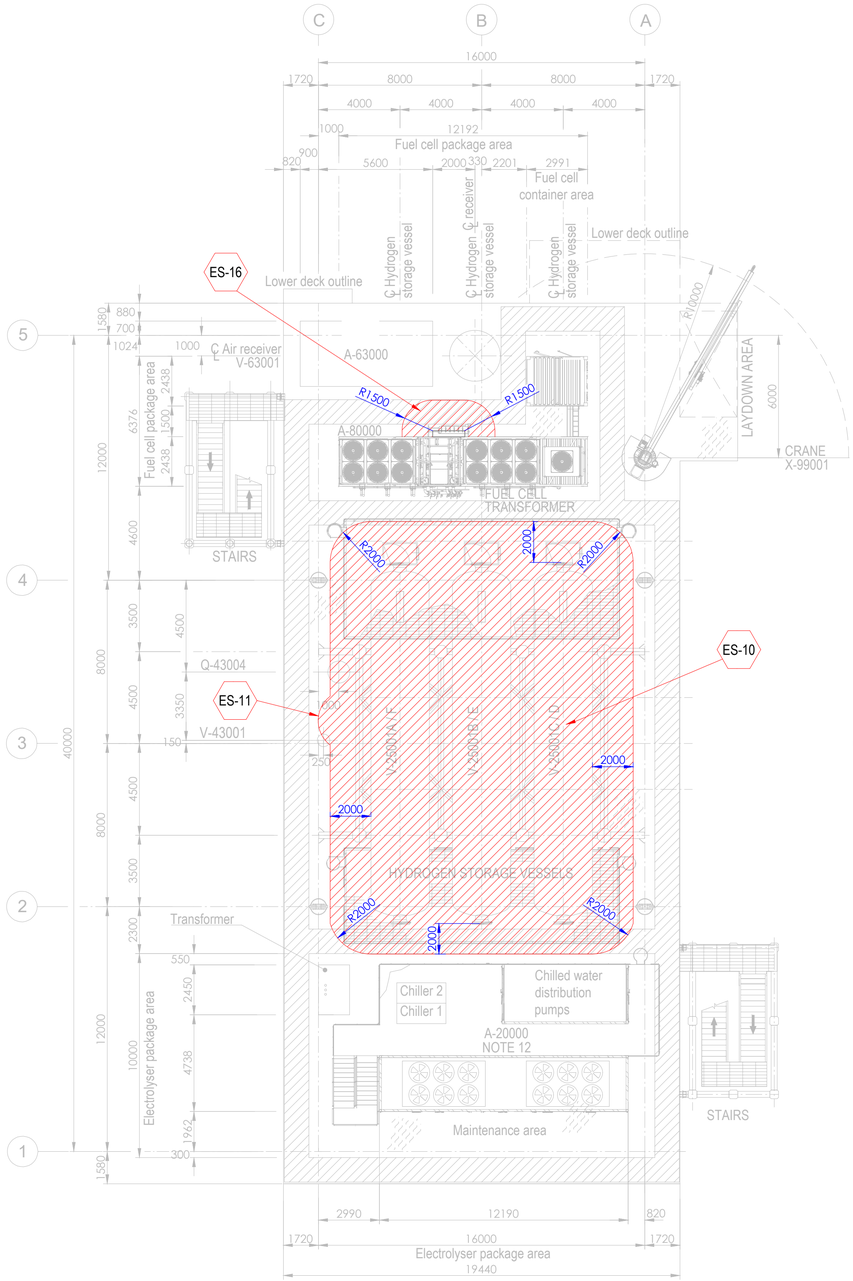


PLAN ON UPPER DECK
EL+30.310 T.O.S.

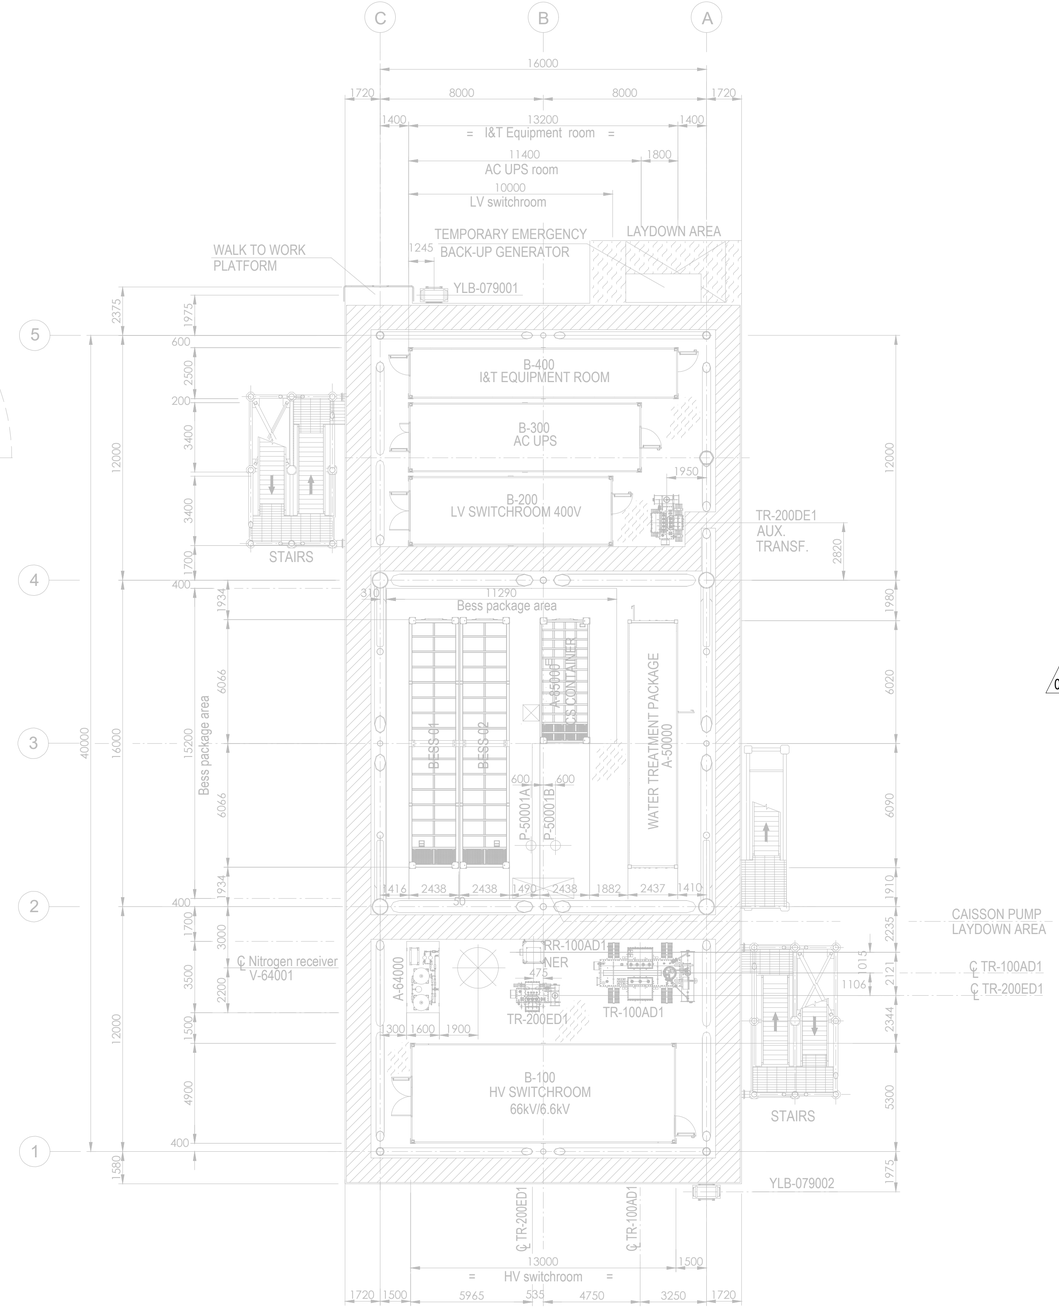

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

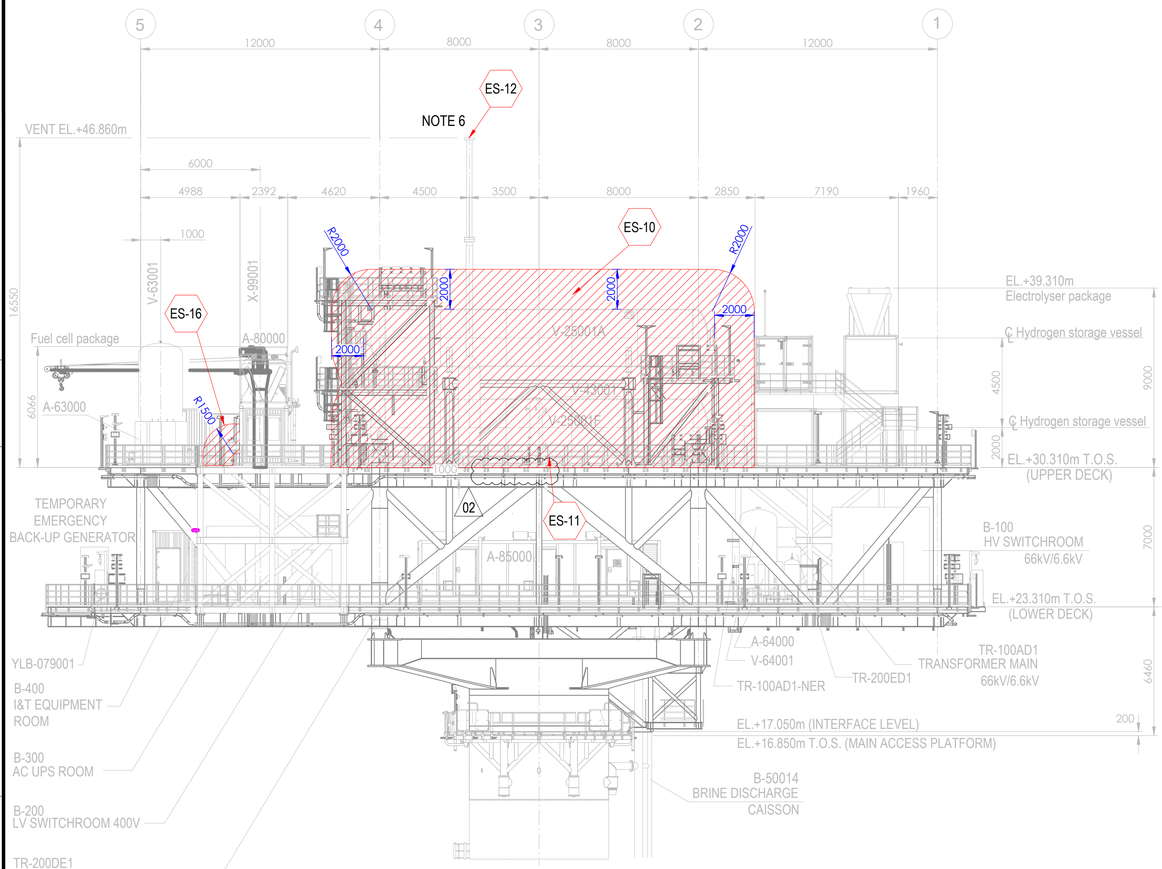



ELEVATION LOOKING EAST

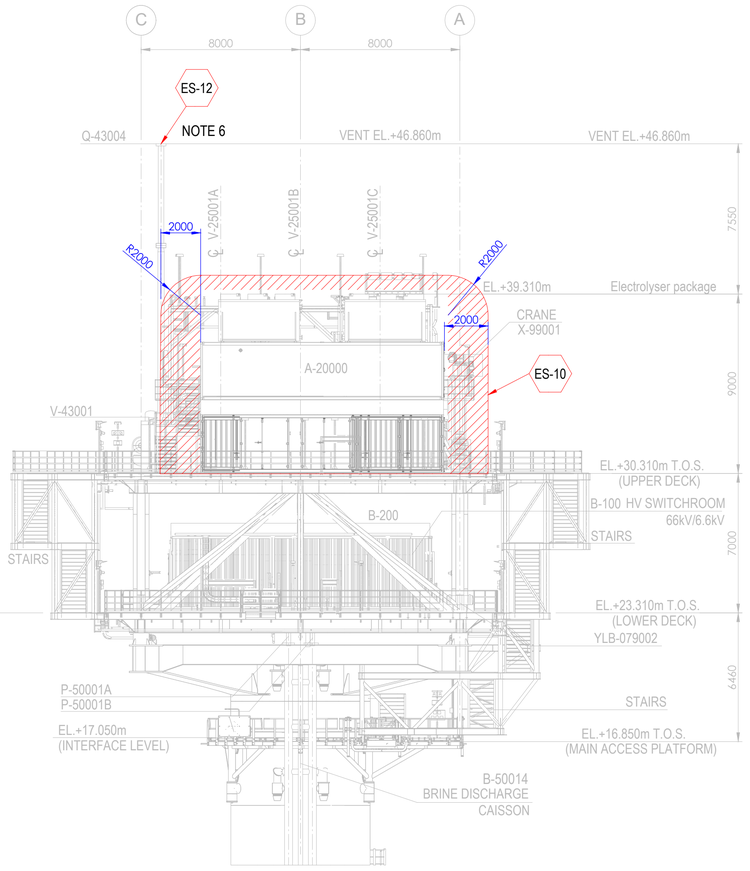

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

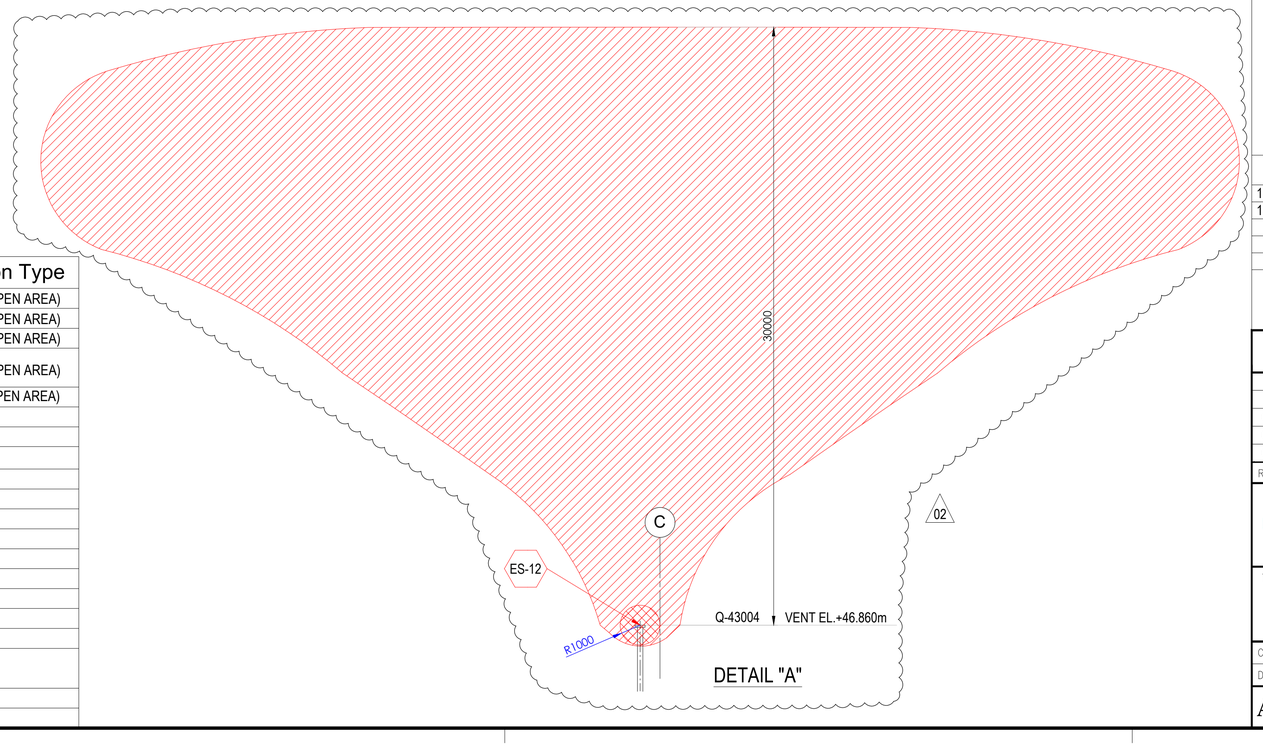



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-ZSHL-011	: Limit Switch Box - Vessel V-25001C Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80017
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001731	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		Batch: IT03B011886			
Manufacturer	SOLDO			**Model**		SQN120E-20X23L7			
Cert No.	CML 19ATEX1359X			**Equipment Ambient Temp.**		-40°C to +80°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66/68

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	OK	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	OK	

ITEM	Tag	25-ZSHL-011	: Limit Switch Box - Vessel V-25001C Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80017
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001731	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	OK	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-ZSHL-011	: Limit Switch Box - Vessel V-25001C Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80017
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001731	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-29	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:37:22.774Z	PROVERLIS Digitaly signed by Alessio Polo 2025-01-29T13:06:05.188Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

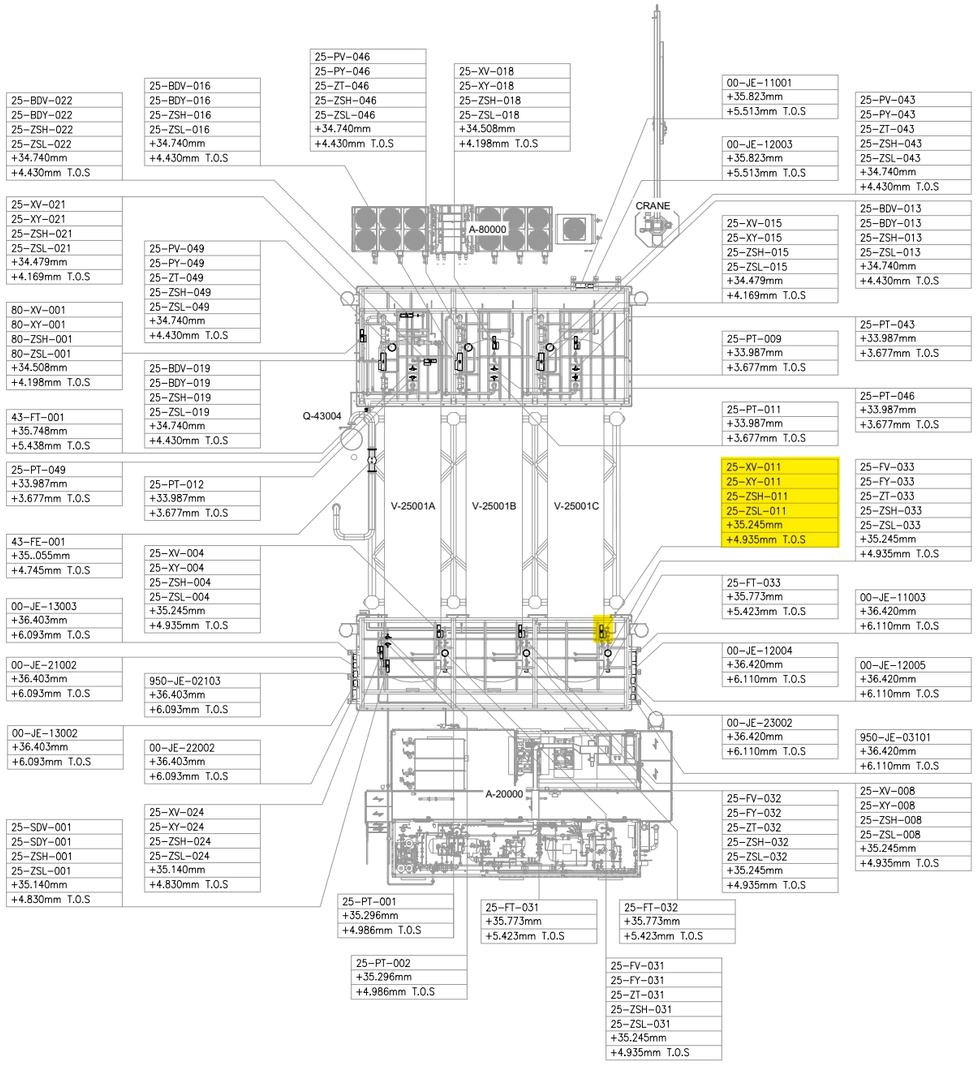

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081
REV.: 2_A | DATE: 07/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING_NO. DRAWING_NO.

REV. REV

V-25001_C

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

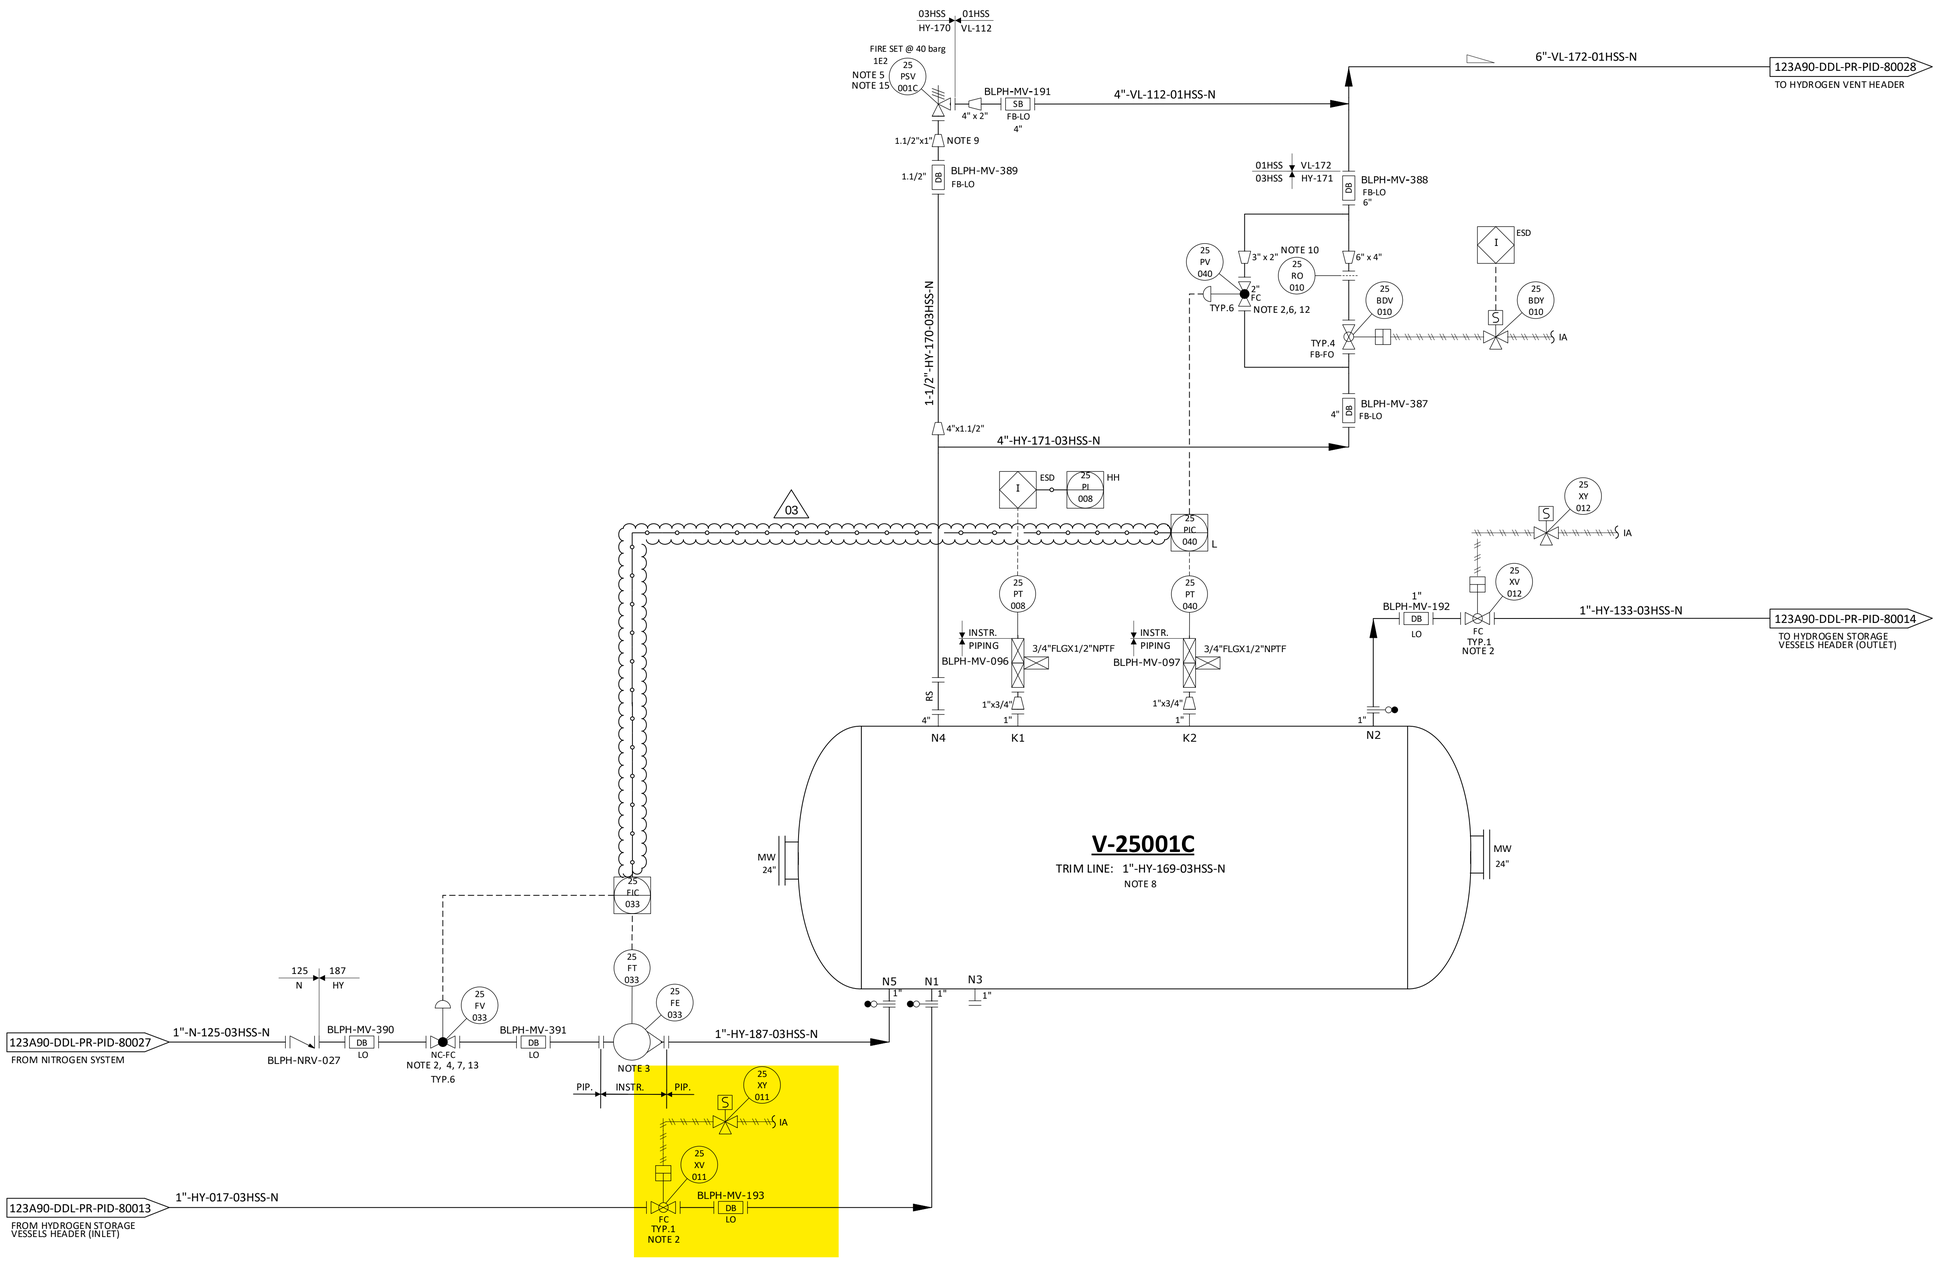

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-033) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-040 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-040 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-033 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-040 HAS FAILED TO CLOSE.
15. 25-PS-V001C SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL C

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE		
A1	DRAWING NO. 123A90-DDL-PR-PID-80017			SHEET 001	REV. 03

File Name = FILE_NAME

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-12004	No.	MARSHALLING CABINET B400-PCS-002

<01>

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-004 (1, 2) WH BK PR1
- 25-ZSH-004 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-004/00-JE-12004
- 2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-008 (1, 2) WH BK PR1
- 25-ZSH-008 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-008/00-JE-12004
- 2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-011 (1, 2) WH BK PR1
- 25-ZSH-011 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-011/00-JE-12004
- 2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-014 (1, 2) WH BK PR1
- 25-ZSH-014 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-014/00-JE-12004
- 2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-017 (1, 2) WH BK PR1
- 25-ZSH-017 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-017/00-JE-12004
- 2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-1

WH BK	1	WH BK	PR1
	2		
	SH		
WH BK	3	WH BK	PR2
	4		
	SH		
WH BK	5	WH BK	PR3
	6		
	SH		
WH BK	7	WH BK	PR4
	8		
	SH		
WH BK	9	WH BK	PR5
	10		
	SH		
WH BK	11	WH BK	PR6
	12		
	SH		
WH BK	13	WH BK	PR7
	14		
	SH		
WH BK	15	WH BK	PR8
	16		
	SH		
WH BK	17	WH BK	PR9
	18		
	SH		
WH BK	19	WH BK	PR10
	20		
	SH		
SPARE	21	WH BK	PR11
	22		
	SH		
SPARE	23	WH BK	PR12
	24		
	SH		
	OS		

00-JE-12004_1/B400-PCS-002
12x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-00-JE-12004

PR1	WH BK	1	25-ZSL-004
Shield Bar		2	
PR2	WH BK	3	25-ZSH-004
Shield Bar		4	
PR3	WH BK	5	25-ZSL-008
Shield Bar		6	
PR4	WH BK	7	25-ZSH-008
Shield Bar		8	
PR5	WH BK	9	25-ZSL-011
Shield Bar		10	
PR6	WH BK	11	25-ZSH-011
Shield Bar		12	
PR7	WH BK	13	25-ZSL-014
Shield Bar		14	
PR8	WH BK	15	25-ZSH-014
Shield Bar		16	
PR9	WH BK	17	25-ZSL-017
Shield Bar		18	
PR10	WH BK	19	25-ZSH-017
Shield Bar		20	
PR11	WH BK	21	SPARE
Shield Bar		22	
PR12	WH BK	23	SPARE
		24	

Shield Bar
I.E.

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO


TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-12004-SH.1 OF 2

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 019	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

E33

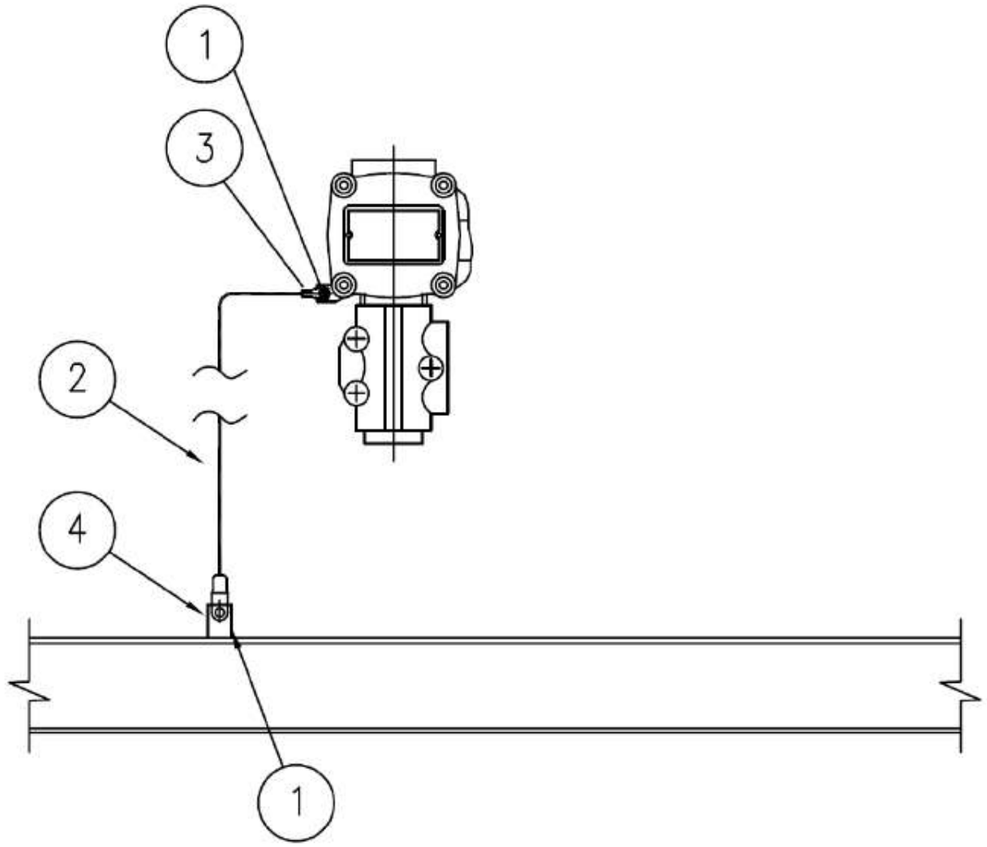

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

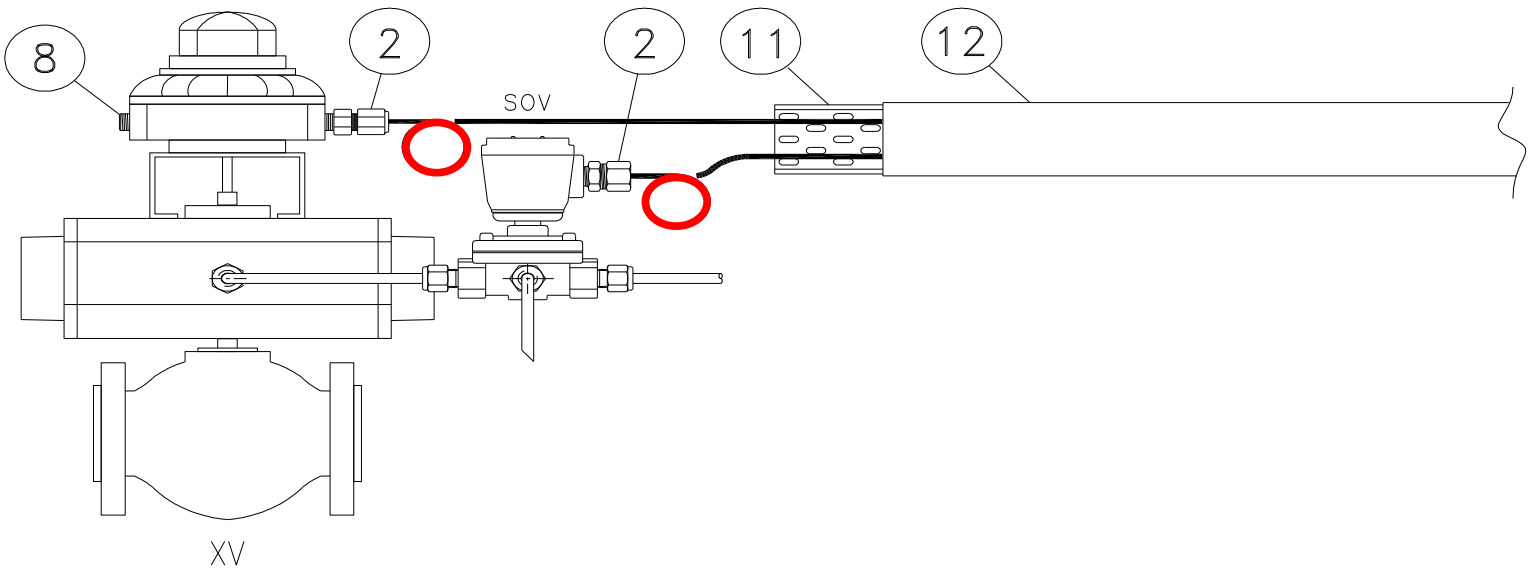

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

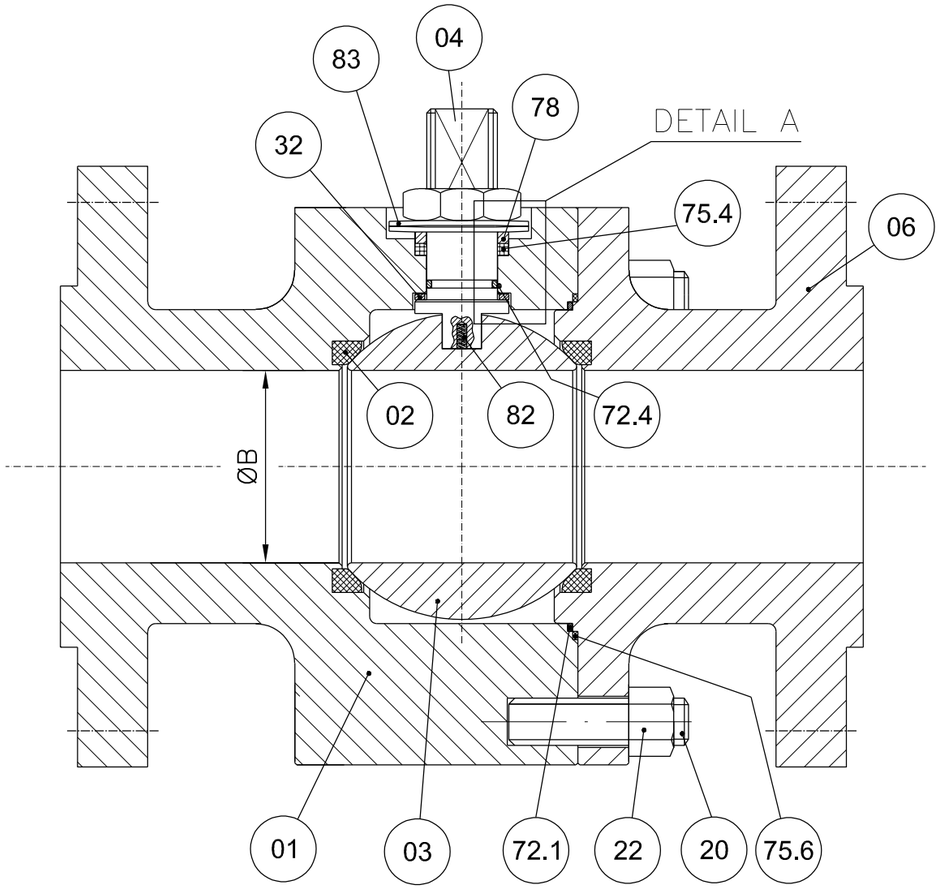




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301



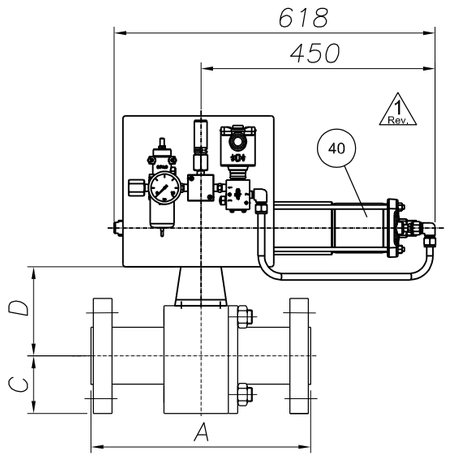

ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DRAWN: S.Madahar — DATE: 26/02/2024
CHK'D: D.Barcella — DATE: 26/02/2024
APPV'D: L.Mora — DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWING NAME: **D240062-08**

Rev.: 2

GENERAL	1	Tag Number		Location		25-XV-011		25
	2	Service				HYDROGEN STORAGE TANK V-25001C INLET		
	3	P&ID Number		Area Classification		123A90-DDL-PR-PID-80017		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-017-03HSS-N		
	5	Line Size and Schedule	Inlet		Outlet	1" / 3.38 mm		1" / 3.38 mm
	6	Line Material		Line Insulation		ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State		Phase		GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure		Full Vacuum	[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature		Minimum	Maxi [°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of		Design		Close :	(12)	Open : (12)
	17	Operation (seconds)		Actual		Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size		Body Form		1"		FULL BORE
	22	Body Material		Bonnet Type		ASTM A182 F316/316L		(*)
	23	Connections		Rating		FLANGED ASME B16.5		#300
	24	Flange Finish		Gasket Material		RF		Inside the valve (*) (38)
	25	Packing		Lubrication & Isolation		A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer		Type		Rotork		Spring Return
	31	Model No.		Size		CP/S		035-100A/BA
	32	Actuator Orientation		Actuator Form		Horizontal		Cylinder
	33	Ingress Protection		Certification		IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply		Min	Max Design	4 barg	10 barg	11 barg
	35	Action on Air Failure		Action on Power Failure		CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-011 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed		Limit Switch Open		25-ZSL-011 (9, 17) - Soldo SS		25-ZSH-011 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set		Handwheel		(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection		Electrical Class		No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity		Fabrication Code		-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve		Model		-		-
	48	Check Valve		Mounting		-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-ZSH-019	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-022	Hyrogen from vessels outlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSH-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-031	Nitrogen to V-25001A vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-032	Nitrogen to V-25001B vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-033	Nitrogen to V-25001C vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-034	Nitrogen to V-25001D vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-036	Nitrogen to V-25001F vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-038	Nitrogen to V-25001E vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSH-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSL-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSL-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSL-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSL-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSL-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSL-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSL-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSL-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSL-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSL-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-ZSL-019	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSL-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSL-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-022	Hyrogen from vessels outlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSL-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSL-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSL-031	Nitrogen to V-25001A vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-032	Nitrogen to V-25001B vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2

EU Type Examination Certificate CML 19ATEX1359X Issue 1

1 Equipment intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU

2 Equipment **SOLDO™ SK and SQ Series Limit Switch Boxes**

3 Manufacturer **Rotork Instruments Italy srl**

4 Address **Via Portico 17**
24050
Orio al Serio (BG)
Italy

5 The equipment is specified in the description of this certificate and the documents to which it refers.

6 CML B.V., Chamber of Commerce No 67386717, Koopvaardijweg 32, 4906CV Oosterhout, The Netherlands, Notified Body Number 2776, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this equipment has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment intended for use in potentially explosive atmospheres given in Annex II to the Directive.

The examination and test results are recorded in the confidential reports listed in Section 12.

7 If an 'X' suffix appears after the certificate number, it indicates that the equipment is subject to conditions of safe use (affecting correct installation or safe use). These are specified in Section 14.

8 This EU Type Examination certificate relates only to the design and construction of the specified equipment or component. Further requirements of Directive 2014/34/EU Article 13 apply to the manufacture of the equipment or component and are separately certified.

9 Compliance with the Essential Health and Safety Requirements, with the exception of those listed in the confidential report, has been demonstrated through compliance with the following documents:

EN IEC 60079-0:2018 EN 60079-1:2014 EN 60079-31:2014

10 The equipment shall be marked with the following:

Ⅱ 2 G D

Ex db IIC T* Gb

Ex tb IIIC T*°C Db

Ta = -55°C to +*°C

**The ambient temperature classes and maximum surface temperature for dust depend upon the ambient temperature ranges. See Table in Section 11.*

11 Description

The SOLDO™ SK and SQ Series Limit Switch Boxes are electromechanical devices used to indicate the position of valves/actuators etc. by means of an electrical signal and an optional visual indicator. The metallic enclosure is constructed from aluminium (SK) or 316 or 316L stainless steel (SQ) and comprises of two enclosure halves secured with 4 x M6 stainless steel fasteners with a minimum property class of 500 MPa. An operating rod passes through each enclosure half for connection to the device being monitored. The rod operates the internal switch/sensor for signalling and passes through to the external indicator (when fitted). There are two threaded entries (M20 or ½" NPT) into the enclosure for cable entry.

The applicable ambient temperature ranges and corresponding Temperature Classes and Maximum Surface Temperatures for Dust are detailed in the table below:

Ambient Temp. Range	T Class	Maximum Surface Temp. for Dust
-55°C to +60°C	T6	T85°C
-55°C to +80°C	T5	T100°C
-55°C to +105°C	T4	T135°C

Rating:

Max. Voltage: 125 Vdc/250 Vac
Max. Current: 10 A
Max. Power: 10 W

Notes:

- Sira 12ATEX1098X is superseded by this certificate.
- The product covered by Issue 0 of this certificate remains identical to that previously covered by Sira 12ATEX1098X.
- Where Sira 12ATEX1098X is specified in other product certification, or other technical specifications, this certificate reference for the product shall be used in its place; updating of the other product certificate or technical specification is not required.

Variation 1

This variation introduced the following changes:

i. Introduction of power dissipation calculation as supporting certification document.

12 Certificate history and evaluation reports

Issue	Date	Associated report	Notes
0	04 Oct 2019	R12654A/00	Initial issue
1	27 Mar 2024	R17518A/00	Introduction of Variation 1

Note: Drawings that describe the equipment or component are listed in the Annex.

13 Conditions of Manufacture

The following conditions are required of the manufacturing process for compliance with the certification.

i. Where the product incorporates certified parts or safety critical components, the manufacturer of the product defined on this certificate shall continually monitor these parts/components for any modifications introduced by the manufacturer(s) of these constituent parts. If the manufacturer of any constituent part introduces any changes which affect the compliance of the certified product that is the subject of this certificate, the manufacturer is required to have this certificate updated.

ii. The power dissipation inside the flameproof enclosure shall not exceed 10 W.

14 Specific Conditions of Use (Special Conditions)

The following conditions relate to safe installation and/or use of the equipment.

i. The equipment is fitted with a non-conducting position indicator which could potentially generate an ignition-capable level of electrostatic charge under certain extreme conditions. Therefore, the equipment shall not be installed in a location where it may be subjected to external conditions (such as high-pressure steam) which might cause a build-up of electrostatic charge on the non-conducting surfaces. Additionally, cleaning of the equipment should be done only with a damp cloth.

ii. The maximum temperature at the cable entry points may exceed 70°C. The user shall refer to the manufacturer's instructions document for guidance in respect of the selection of suitable cabling for the equipment.

iii. Dust layers in excess of 50 mm shall not be allowed to form on the equipment.


iv. The following have a minimum flamepath width (L) and maximum gap (i_c) other than that detailed in EN 60079-1 Table 3 and are detailed below:

Flamepath	**Joint Width (L) mm**	**Max. Gap (i_c) mm**
Cover shaft/Cover	26	0.097
Body Shaft/Body	26	0.097


94	IFR	25-XV-009	floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR	25-XV-011	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR	25-XV-012	SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR	25-XV-014	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR	25-XV-015	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR	25-XV-017	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR	25-XV-018	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

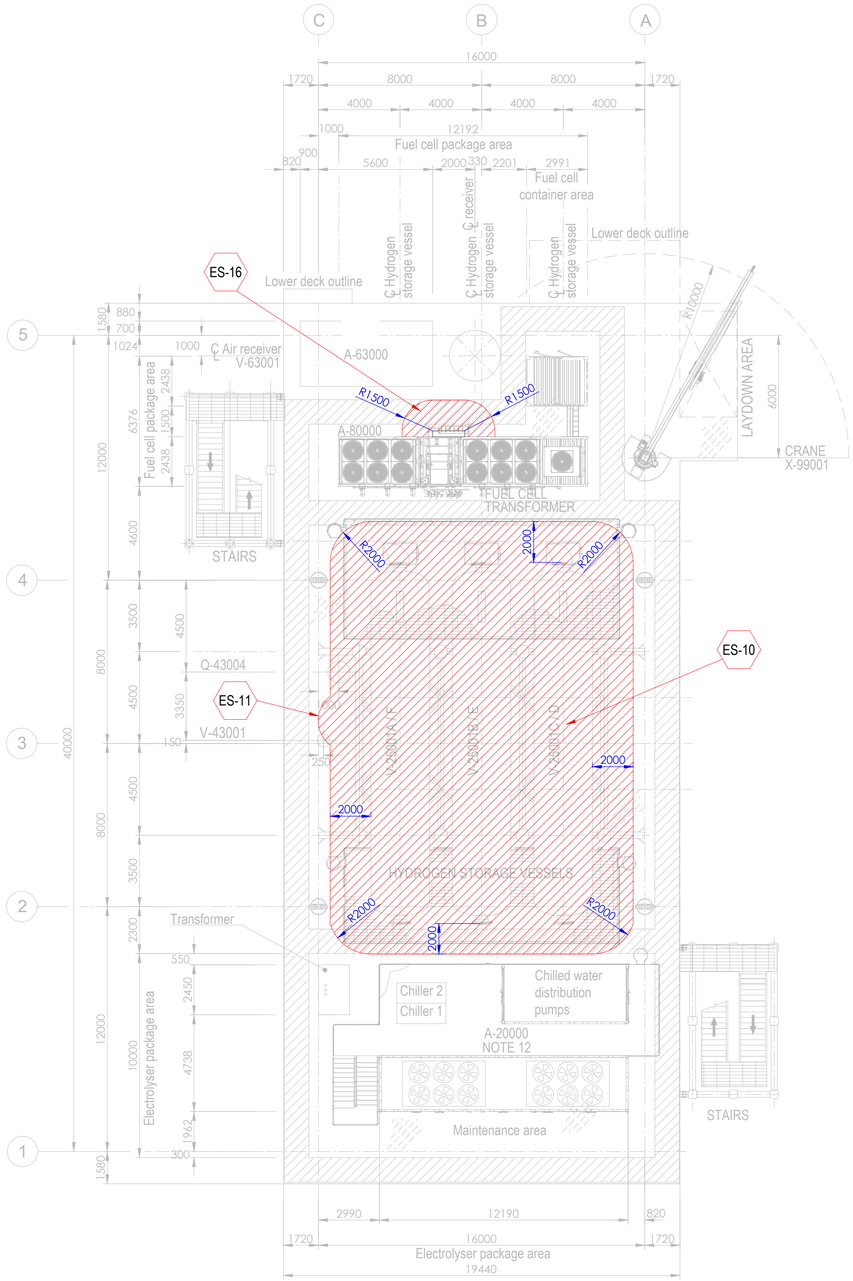


PLAN ON UPPER DECK
EL+30.310 T.O.S.

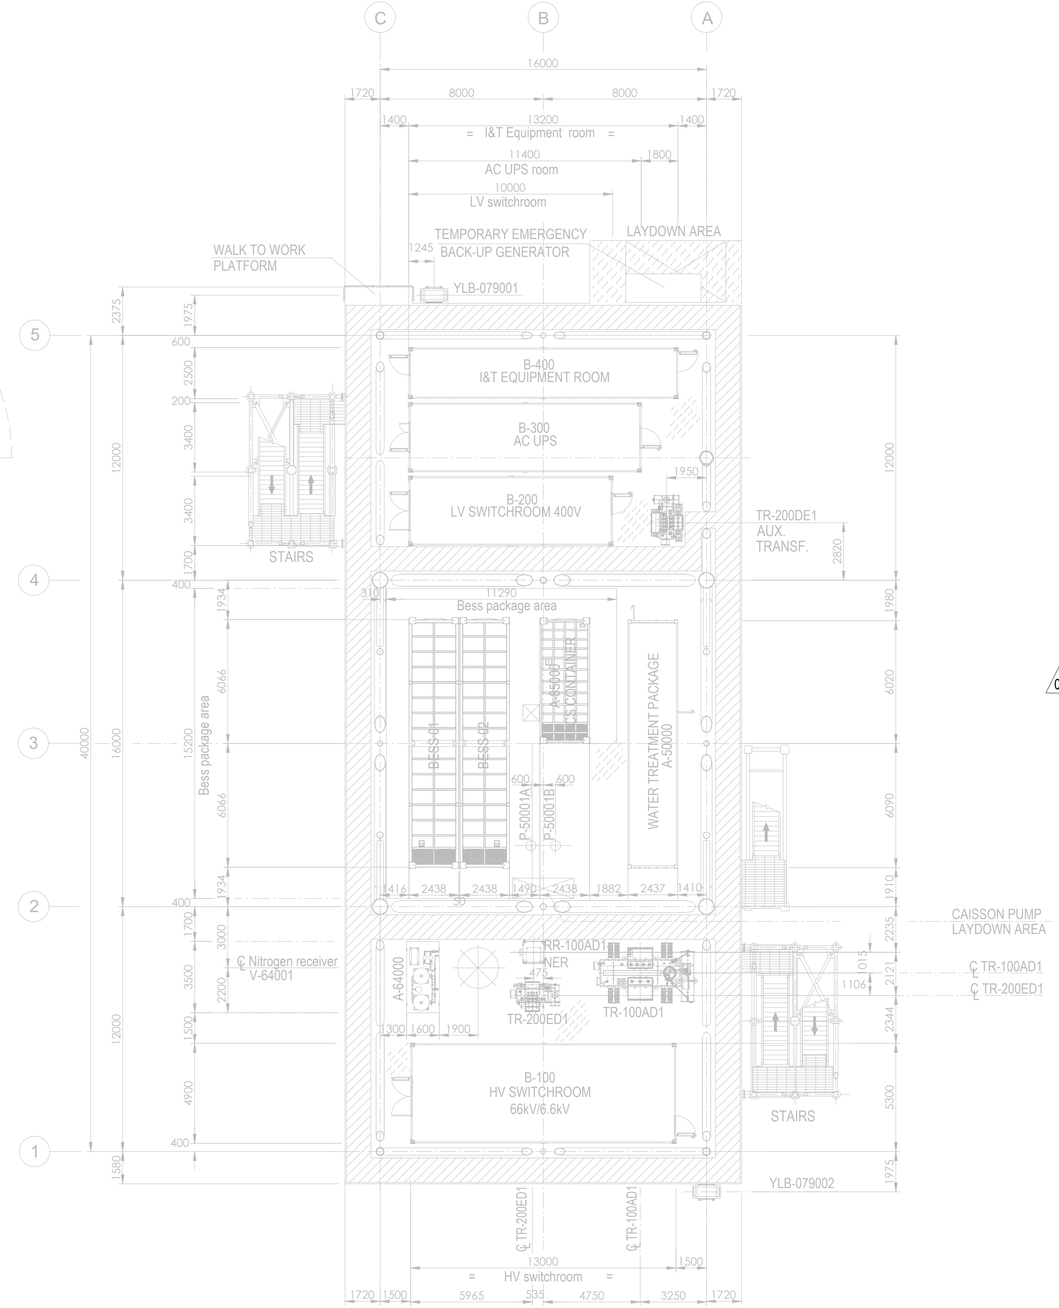

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

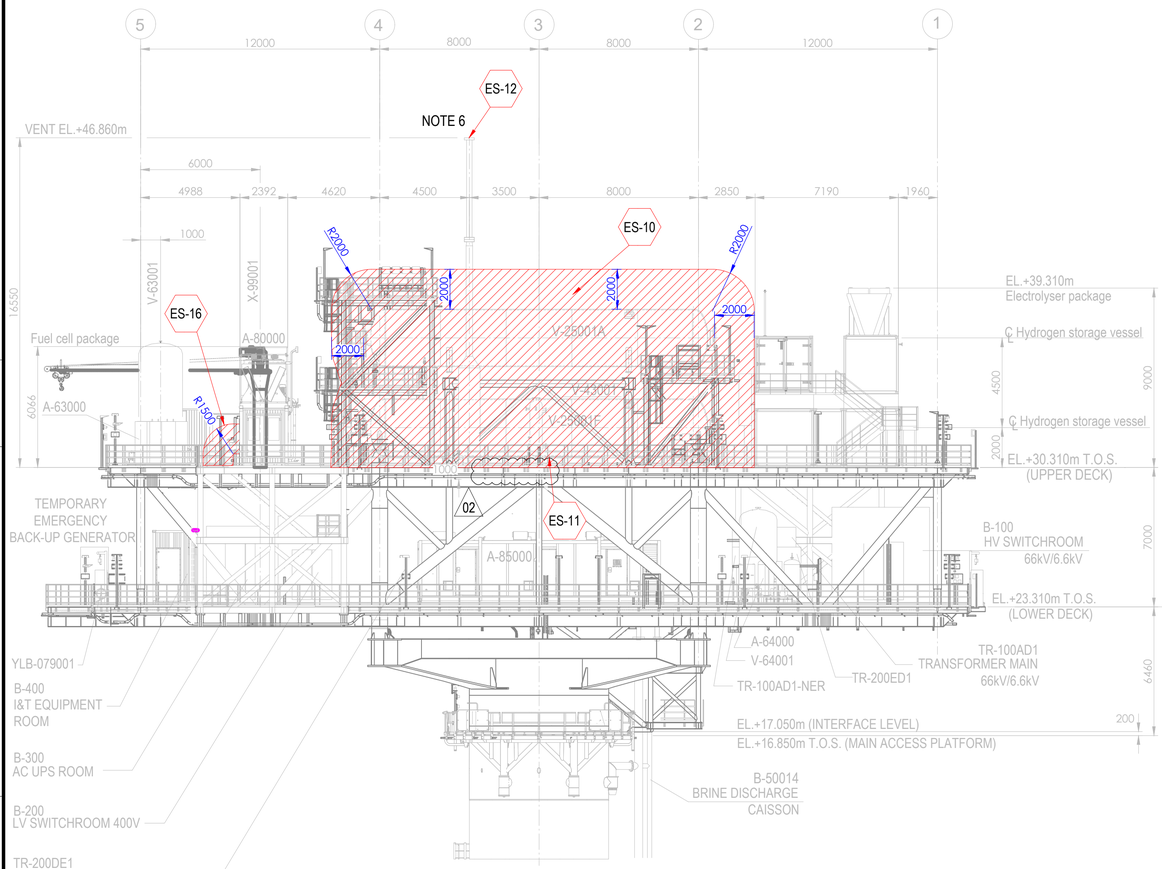



ELEVATION LOOKING EAST

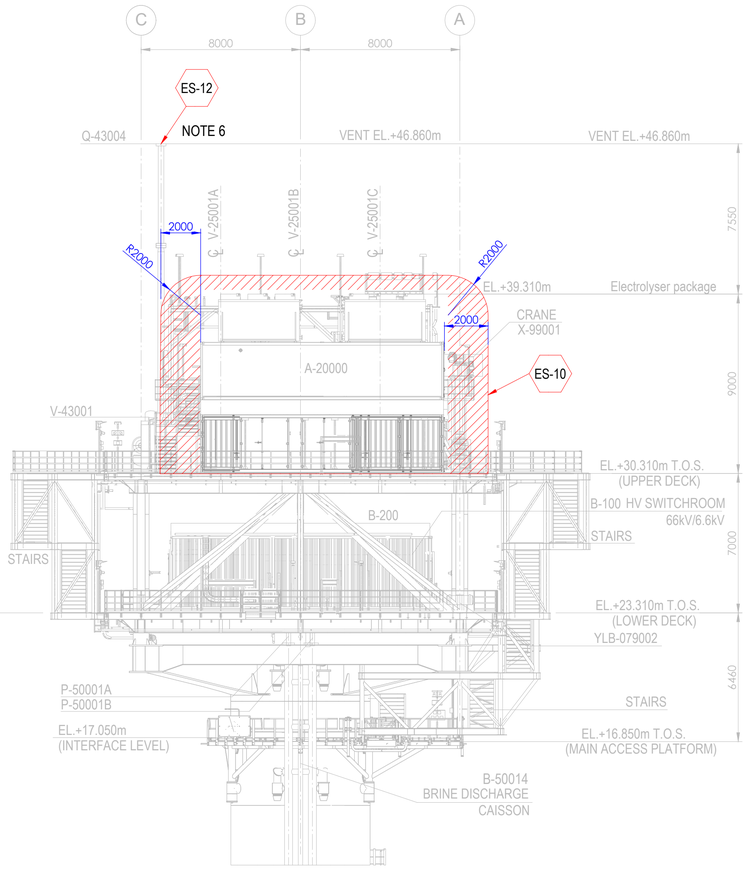

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

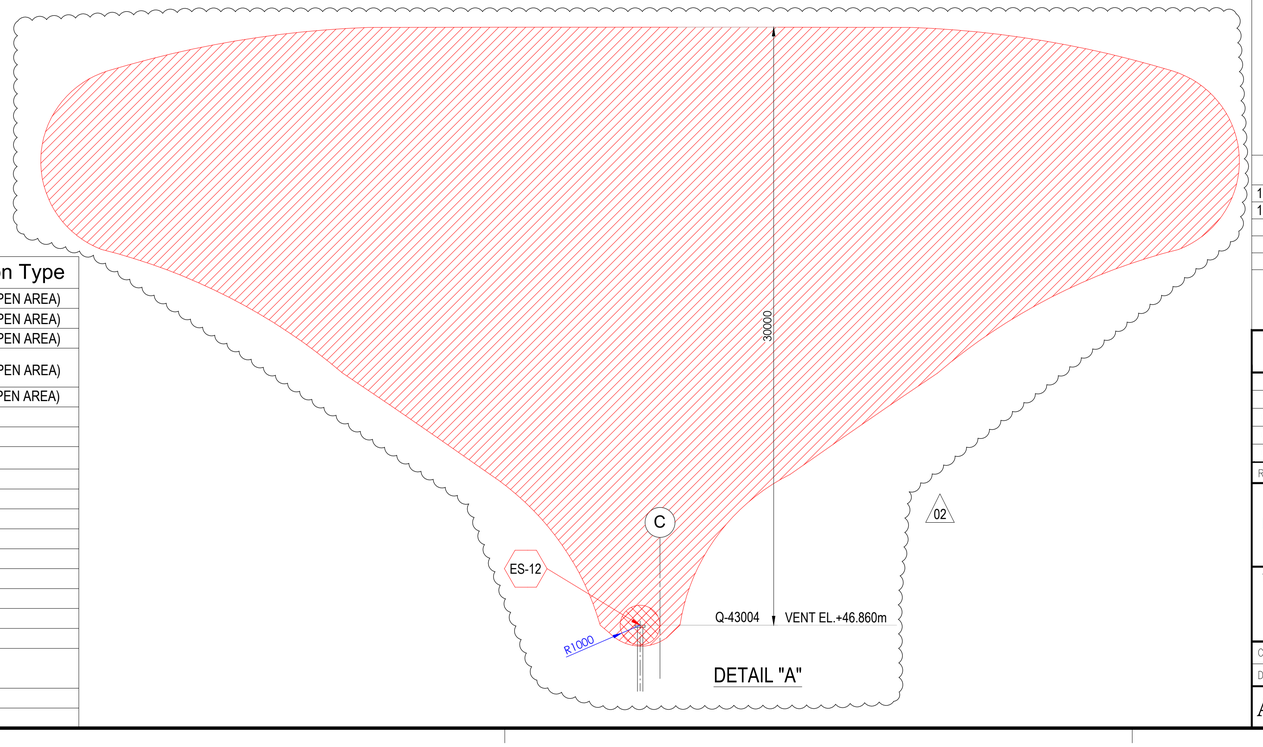



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-ZSHL-014	: Limit Switch Box - Vessel V-25001D Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001733	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		Batch:IT0380116129			
Manufacturer	SOLDO			**Model**		SQN120E-20X23L7			
Cert No.	CML 19ATEX1359X			**Equipment Ambient Temp.**		-40°C to +80°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T5	**IP Rating**	IP66/68

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	OK	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		OK	
	Physical check	x	OK	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	OK	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	OK	

ITEM	Tag	25-ZSHL-014	: Limit Switch Box - Vessel V-25001D Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001733		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	OK	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	OK	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-ZSHL-014	: Limit Switch Box - Vessel V-25001D Hydrogen Inlet		Dwg	123A90-DDL-PR-PID-80016	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001733	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Giovanni Tangianu	
Date	2025-01-29	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:37:44.646Z	PROVERLIS Digitaly signed by Giovanni Tangianu 2025-01-29T12:52:13.484Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

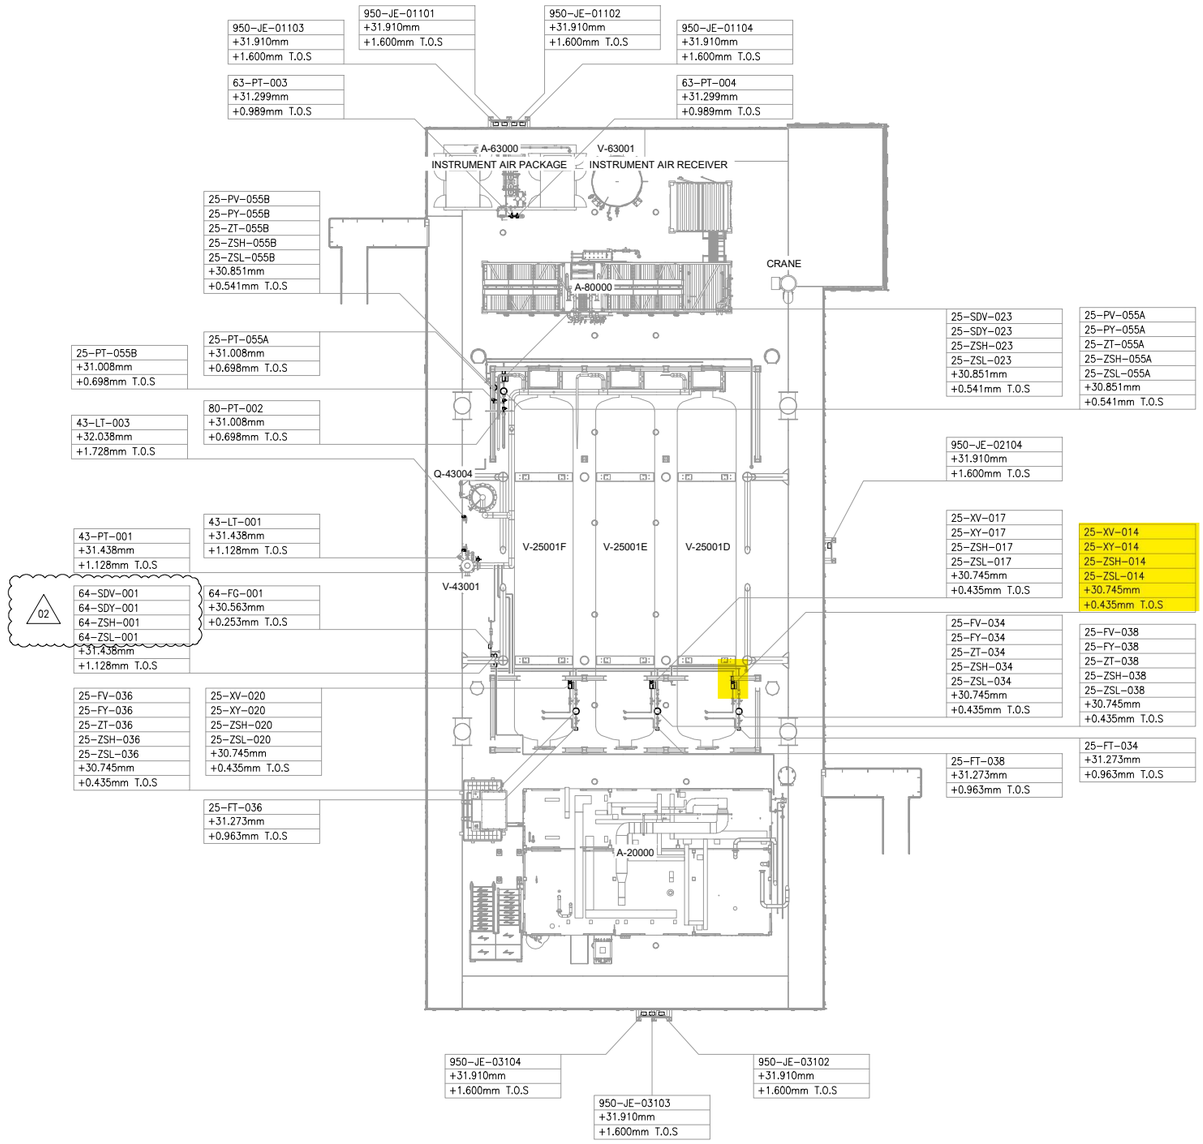


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm



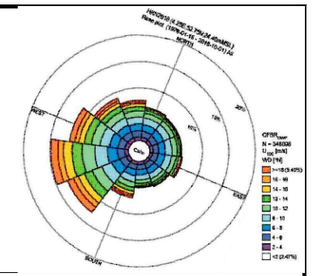

NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001_D

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

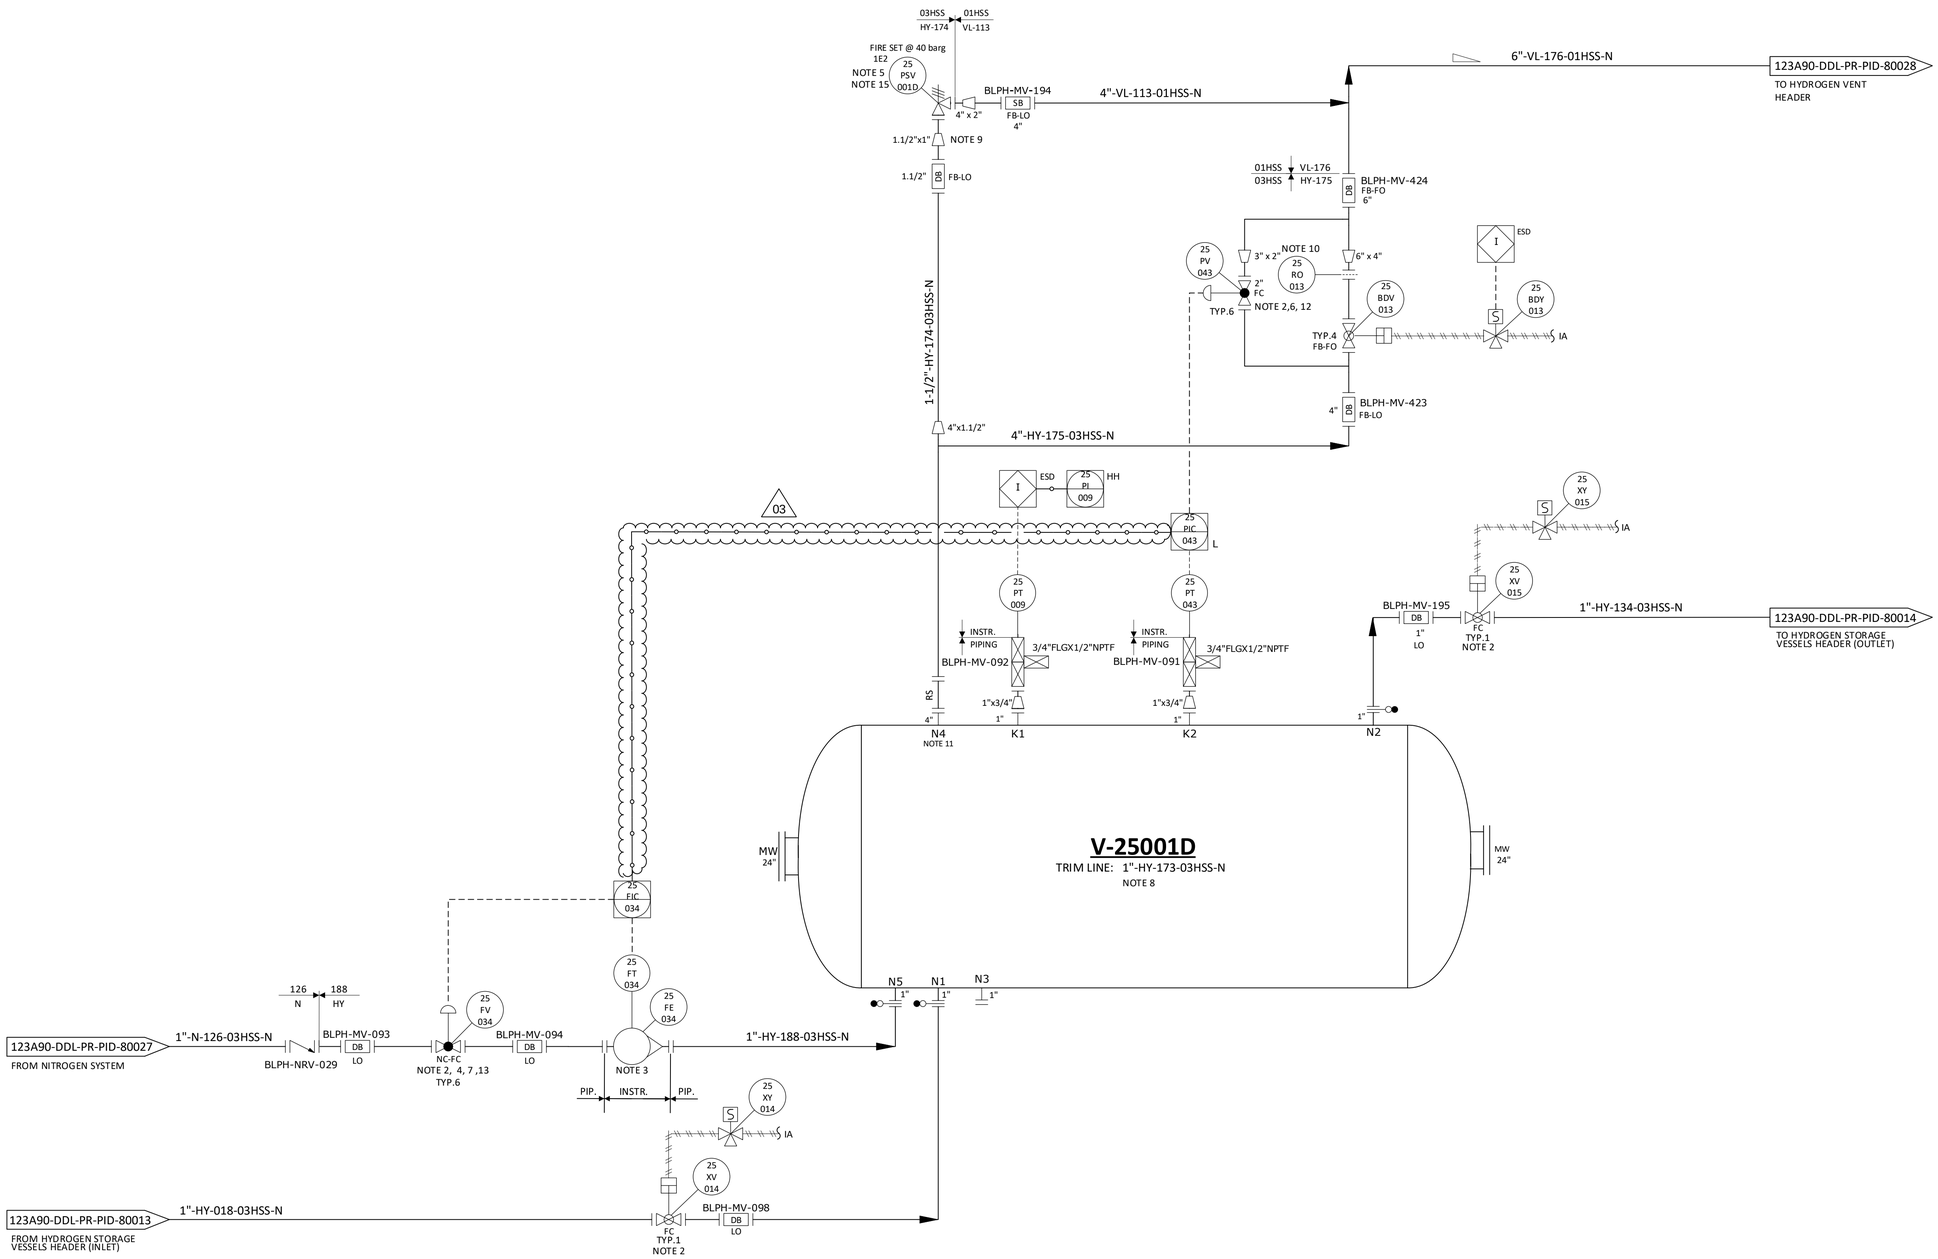

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS. 03
4. NITROGEN CONTROL VALVE (25-FV-034) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE.
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-043 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-043 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-034 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-043 HAS FAILED TO CLOSE.
15. 25-PSV-001D SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL D

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO. 123A90-DDL-PR-PID-80018	SHEET 001	REV. 03

File Name : FILE_NAME

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-12004	No.	MARSHALLING CABINET B400-PCS-002

<01>

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-004 (1, 2) WH BK PR1
- 25-ZSH-004 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-004/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-008 (1, 2) WH BK PR1
- 25-ZSH-008 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-008/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-011 (1, 2) WH BK PR1
- 25-ZSH-011 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-011/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-014 (1, 2) WH BK PR1
- 25-ZSH-014 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-014/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-017 (1, 2) WH BK PR1
- 25-ZSH-017 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-017/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-1

WH BK	1	WH BK	PR1
	2		
	SH		
WH BK	3	WH BK	PR2
	4		
	SH		
WH BK	5	WH BK	PR3
	6		
	SH		
WH BK	7	WH BK	PR4
	8		
	SH		
WH BK	9	WH BK	PR5
	10		
	SH		
WH BK	11	WH BK	PR6
	12		
	SH		
WH BK	13	WH BK	PR7
	14		
	SH		
WH BK	15	WH BK	PR8
	16		
	SH		
WH BK	17	WH BK	PR9
	18		
	SH		
WH BK	19	WH BK	PR10
	20		
	SH		
SPARE	21	WH BK	PR11
	22		
	SH		
SPARE	23	WH BK	PR12
	24		
	SH		
	OS		

00-JE-12004_1/B400-PCS-002
12x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-00-JE-12004

PR1 WH BK	1	25-ZSL-004
Shield Bar	2	
PR2 WH BK	3	25-ZSH-004
Shield Bar	4	
PR3 WH BK	5	25-ZSL-008
Shield Bar	6	
PR4 WH BK	7	25-ZSH-008
Shield Bar	8	
PR5 WH BK	9	25-ZSL-011
Shield Bar	10	
PR6 WH BK	11	25-ZSH-011
Shield Bar	12	
PR7 WH BK	13	25-ZSL-014
Shield Bar	14	
PR8 WH BK	15	25-ZSH-014
Shield Bar	16	
PR9 WH BK	17	25-ZSL-017
Shield Bar	18	
PR10 WH BK	19	25-ZSH-017
Shield Bar	20	
PR11 WH BK	21	SPARE
Shield Bar	22	
PR12 WH BK	23	SPARE
	24	

Shield Bar
I.E.

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO


TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-12004-SH.1 OF 2

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 019	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

E33

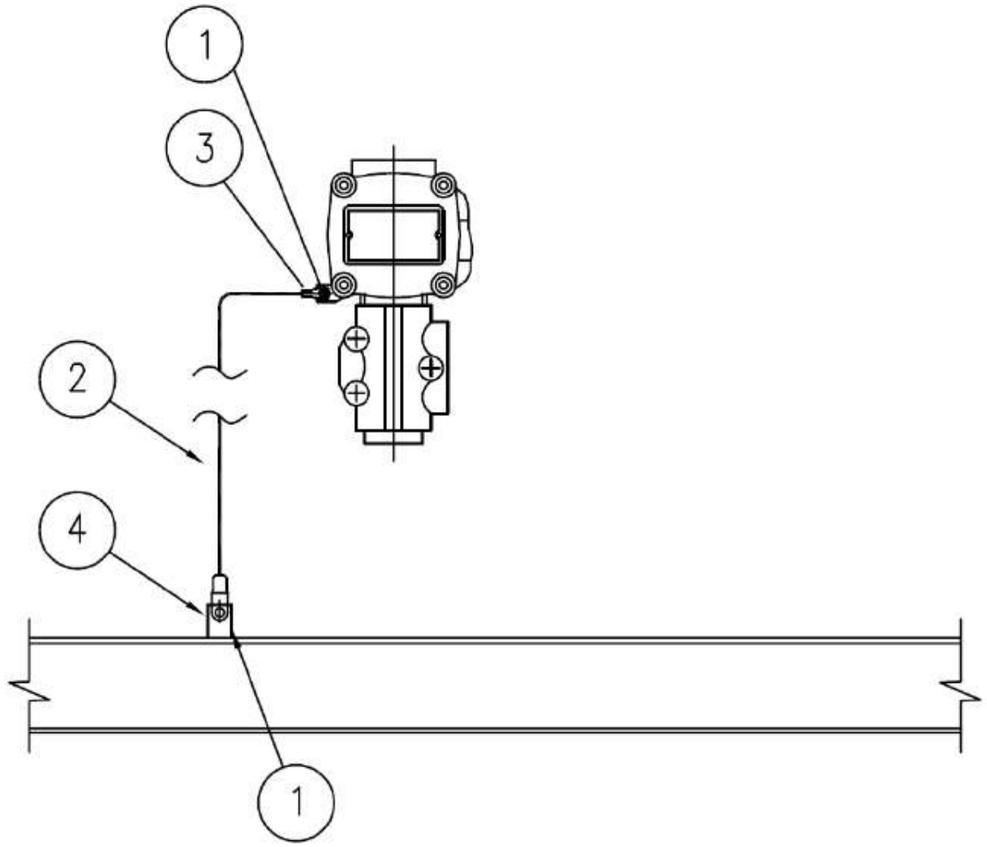

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

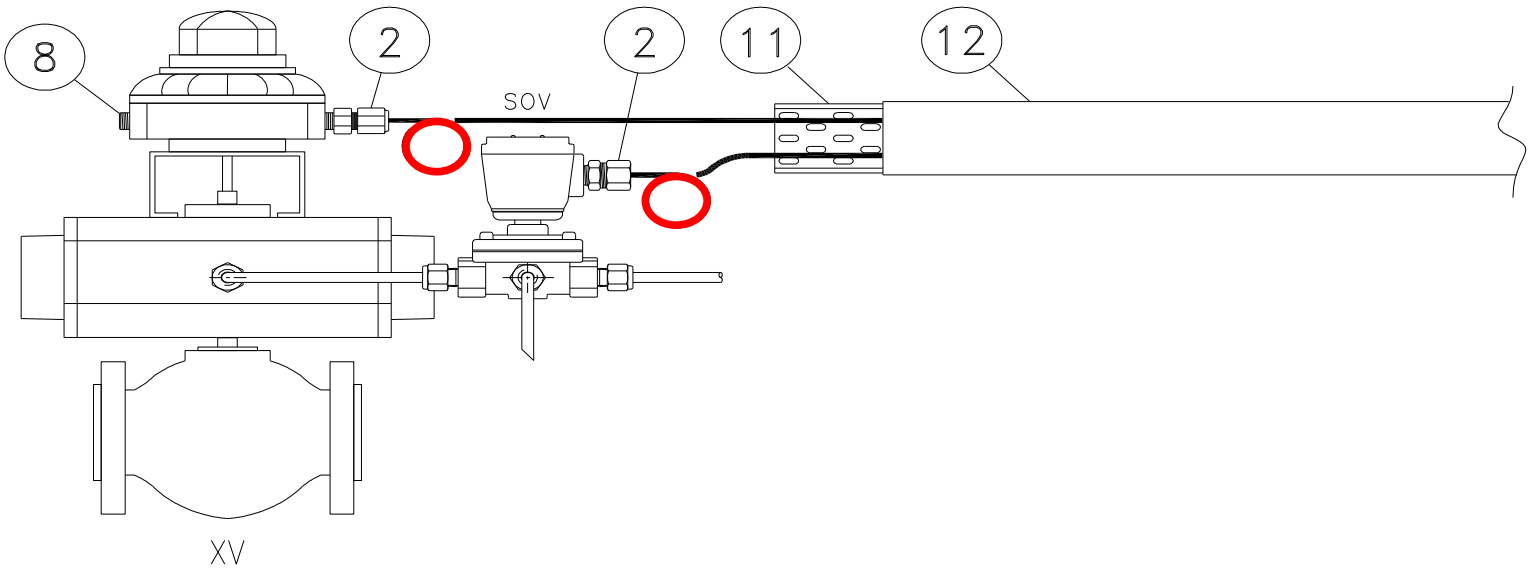

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

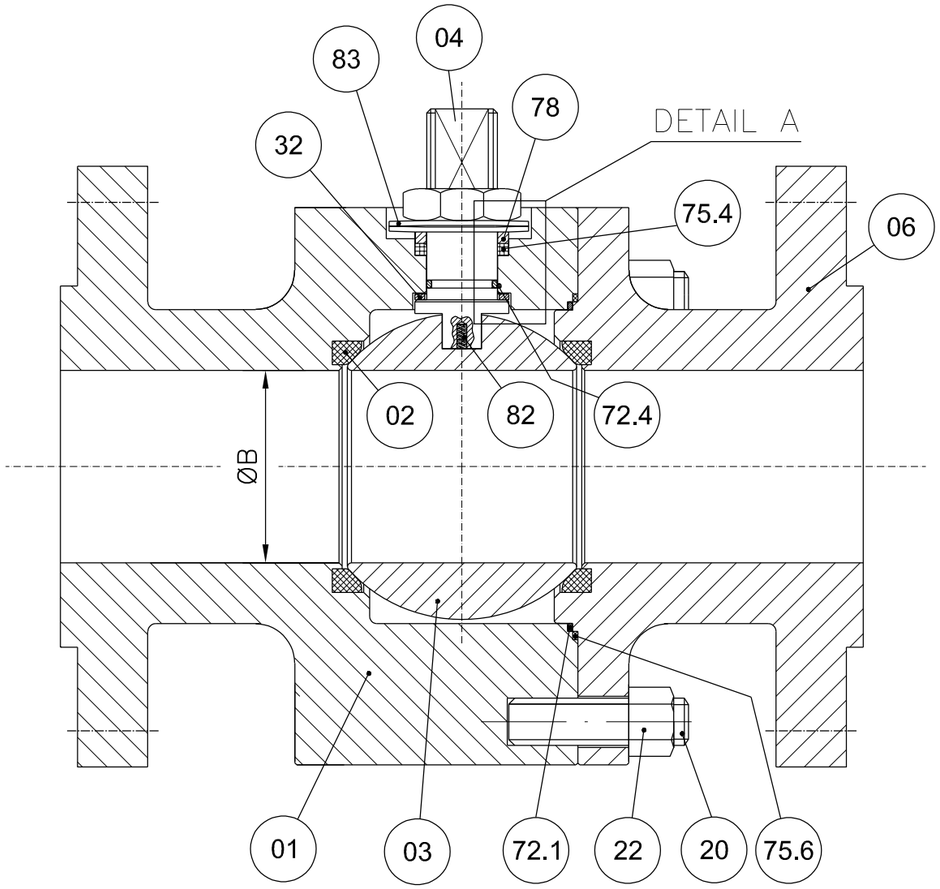




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024
CHK'D: D.Barcella	DATE: 26/02/2024
APPV'D: L.Mora	DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: D240062-08

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-014		25
	2	Service				HYDROGEN STORAGE TANK V-25001D INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80018		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-018-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-014 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-014 (9, 17) - Soldo SS		25-ZSH-014 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-ZSH-019	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-022	Hyrogen from vessels outlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSH-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-031	Nitrogen to V-25001A vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-032	Nitrogen to V-25001B vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-033	Nitrogen to V-25001C vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-034	Nitrogen to V-25001D vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-036	Nitrogen to V-25001F vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-038	Nitrogen to V-25001E vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSH-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSL-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSL-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSL-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSL-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSL-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSL-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSL-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSL-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSL-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSL-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-ZSL-019	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSL-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSL-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-022	Hyrogen from vessels outlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSL-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSL-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSL-031	Nitrogen to V-25001A vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-032	Nitrogen to V-25001B vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2

EU Type Examination Certificate CML 19ATEX1359X Issue 1

1 Equipment intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU

2 Equipment **SOLDO™ SK and SQ Series Limit Switch Boxes**

3 Manufacturer **Rotork Instruments Italy srl**

4 Address **Via Portico 17**
24050
Orio al Serio (BG)
Italy

5 The equipment is specified in the description of this certificate and the documents to which it refers.

6 CML B.V., Chamber of Commerce No 67386717, Koopvaardijweg 32, 4906CV Oosterhout, The Netherlands, Notified Body Number 2776, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this equipment has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment intended for use in potentially explosive atmospheres given in Annex II to the Directive.

The examination and test results are recorded in the confidential reports listed in Section 12.

7 If an 'X' suffix appears after the certificate number, it indicates that the equipment is subject to conditions of safe use (affecting correct installation or safe use). These are specified in Section 14.

8 This EU Type Examination certificate relates only to the design and construction of the specified equipment or component. Further requirements of Directive 2014/34/EU Article 13 apply to the manufacture of the equipment or component and are separately certified.

9 Compliance with the Essential Health and Safety Requirements, with the exception of those listed in the confidential report, has been demonstrated through compliance with the following documents:

EN IEC 60079-0:2018 EN 60079-1:2014 EN 60079-31:2014

10 The equipment shall be marked with the following:

Ⅱ 2 G D

Ex db IIC T* Gb

Ex tb IIIC T*°C Db

Ta = -55°C to +*°C

**The ambient temperature classes and maximum surface temperature for dust depend upon the ambient temperature ranges. See Table in Section 11.*

11 Description

The SOLDO™ SK and SQ Series Limit Switch Boxes are electromechanical devices used to indicate the position of valves/actuators etc. by means of an electrical signal and an optional visual indicator. The metallic enclosure is constructed from aluminium (SK) or 316 or 316L stainless steel (SQ) and comprises of two enclosure halves secured with 4 x M6 stainless steel fasteners with a minimum property class of 500 MPa. An operating rod passes through each enclosure half for connection to the device being monitored. The rod operates the internal switch/sensor for signalling and passes through to the external indicator (when fitted). There are two threaded entries (M20 or ½" NPT) into the enclosure for cable entry.

The applicable ambient temperature ranges and corresponding Temperature Classes and Maximum Surface Temperatures for Dust are detailed in the table below:

Ambient Temp. Range	T Class	Maximum Surface Temp. for Dust
-55°C to +60°C	T6	T85°C
-55°C to +80°C	T5	T100°C
-55°C to +105°C	T4	T135°C

Rating:

Max. Voltage: 125 Vdc/250 Vac
Max. Current: 10 A
Max. Power: 10 W

Notes:

- Sira 12ATEX1098X is superseded by this certificate.
- The product covered by Issue 0 of this certificate remains identical to that previously covered by Sira 12ATEX1098X.
- Where Sira 12ATEX1098X is specified in other product certification, or other technical specifications, this certificate reference for the product shall be used in its place; updating of the other product certificate or technical specification is not required.

Variation 1

This variation introduced the following changes:

i. Introduction of power dissipation calculation as supporting certification document.

12 Certificate history and evaluation reports

Issue	Date	Associated report	Notes
0	04 Oct 2019	R12654A/00	Initial issue
1	27 Mar 2024	R17518A/00	Introduction of Variation 1

Note: Drawings that describe the equipment or component are listed in the Annex.

13 Conditions of Manufacture

The following conditions are required of the manufacturing process for compliance with the certification.

i. Where the product incorporates certified parts or safety critical components, the manufacturer of the product defined on this certificate shall continually monitor these parts/components for any modifications introduced by the manufacturer(s) of these constituent parts. If the manufacturer of any constituent part introduces any changes which affect the compliance of the certified product that is the subject of this certificate, the manufacturer is required to have this certificate updated.

ii. The power dissipation inside the flameproof enclosure shall not exceed 10 W.

14 Specific Conditions of Use (Special Conditions)

The following conditions relate to safe installation and/or use of the equipment.

i. The equipment is fitted with a non-conducting position indicator which could potentially generate an ignition-capable level of electrostatic charge under certain extreme conditions. Therefore, the equipment shall not be installed in a location where it may be subjected to external conditions (such as high-pressure steam) which might cause a build-up of electrostatic charge on the non-conducting surfaces. Additionally, cleaning of the equipment should be done only with a damp cloth.

ii. The maximum temperature at the cable entry points may exceed 70°C. The user shall refer to the manufacturer's instructions document for guidance in respect of the selection of suitable cabling for the equipment.

iii. Dust layers in excess of 50 mm shall not be allowed to form on the equipment.


iv. The following have a minimum flamepath width (L) and maximum gap (i_c) other than that detailed in EN 60079-1 Table 3 and are detailed below:

Flamepath	**Joint Width (L) mm**	**Max. Gap (i_c) mm**
Cover shaft/Cover	26	0.097
Body Shaft/Body	26	0.097


94	IFR	25-XV-009	floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR	25-XV-011	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR	25-XV-012	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR	25-XV-014	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR	25-XV-015	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR	25-XV-017	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR	25-XV-018	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

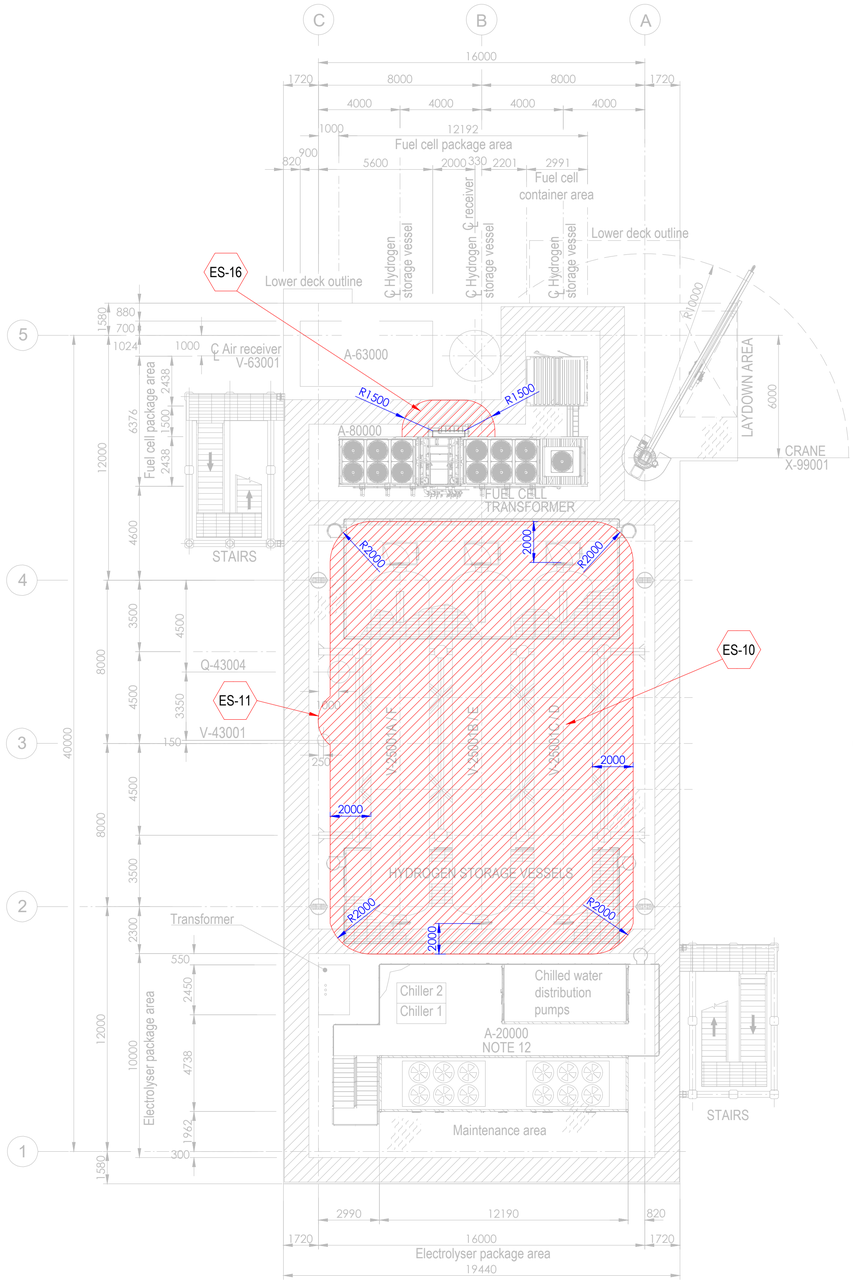


PLAN ON UPPER DECK
EL+30.310 T.O.S.

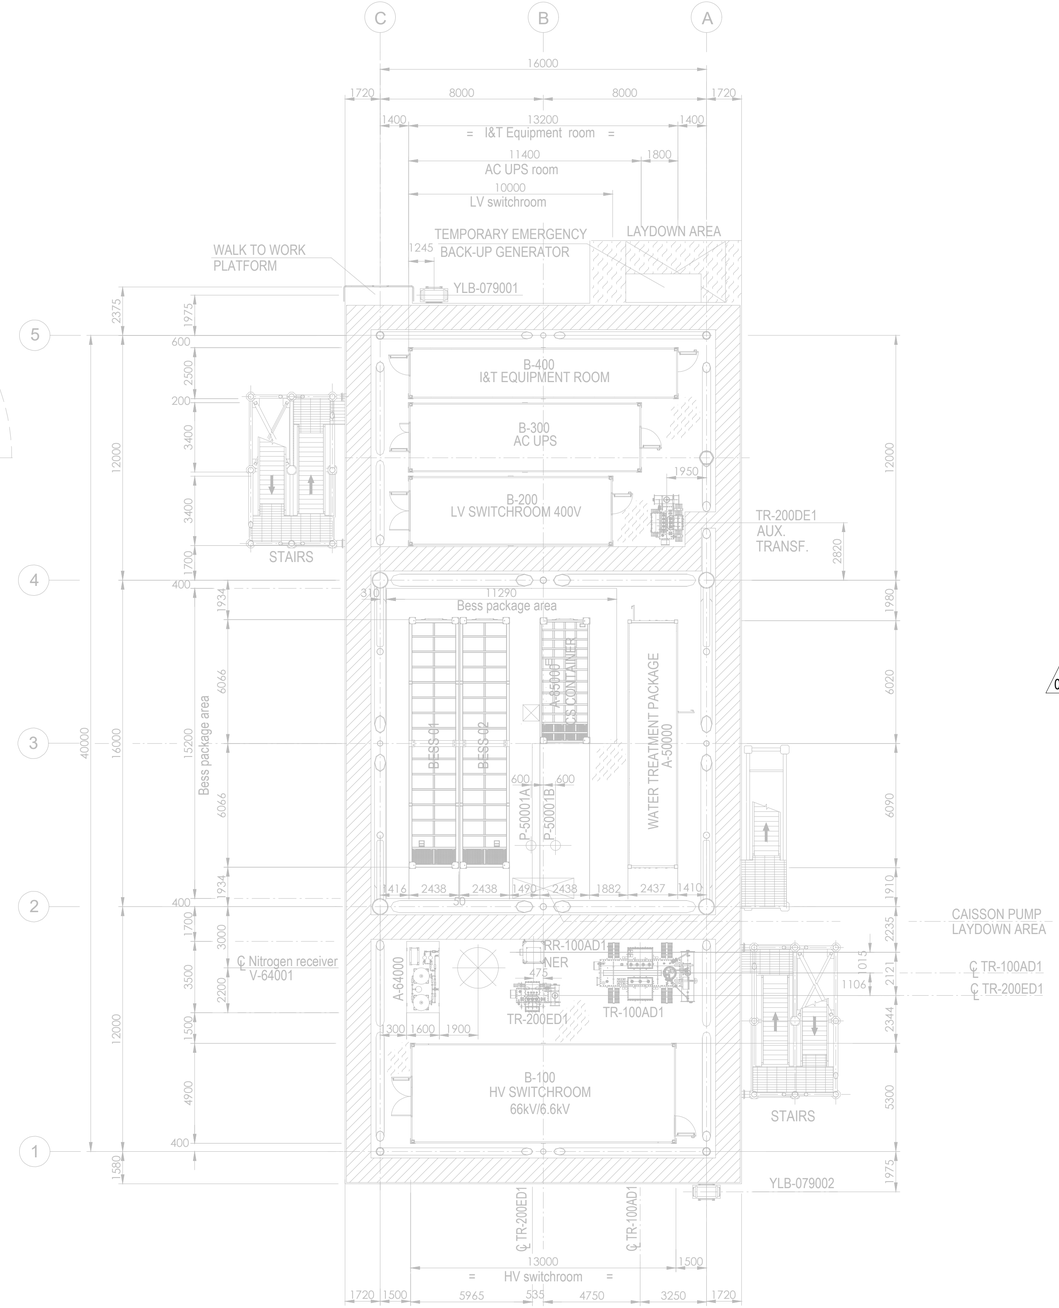

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

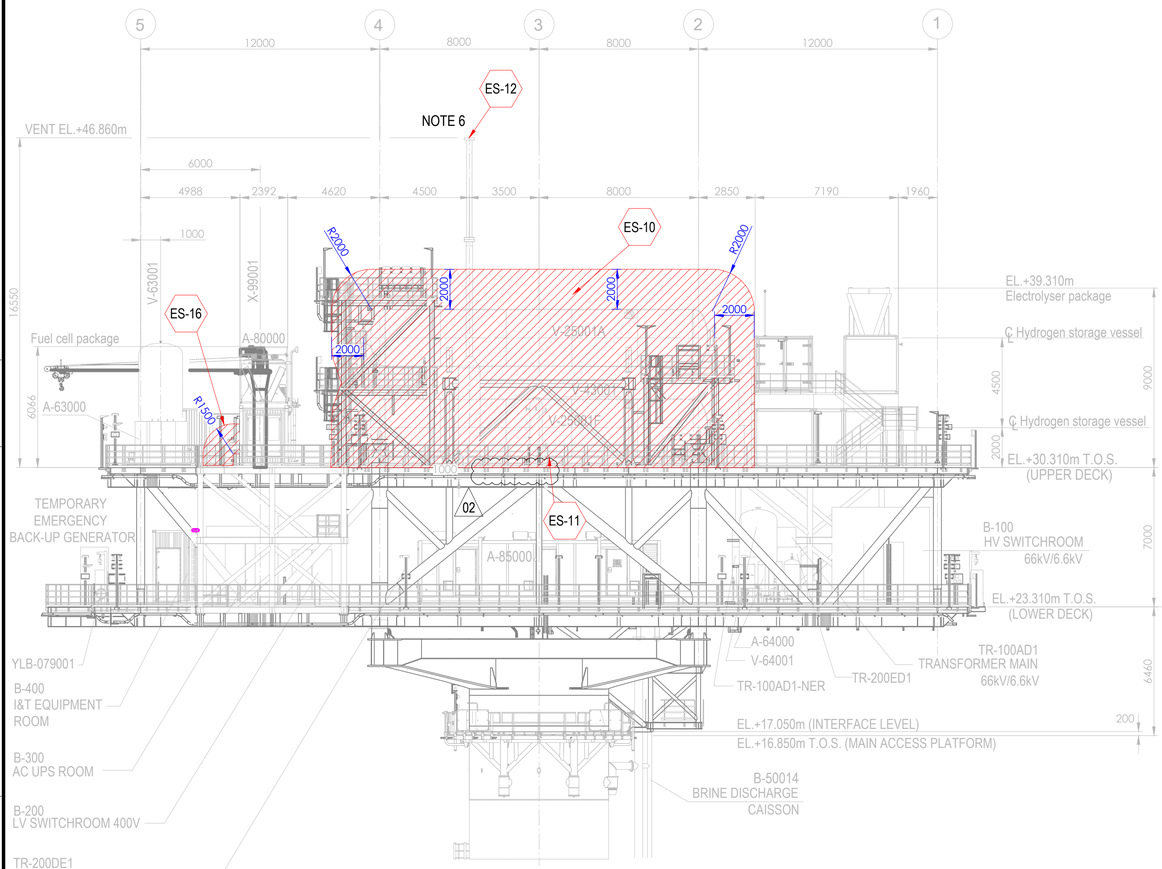



ELEVATION LOOKING EAST

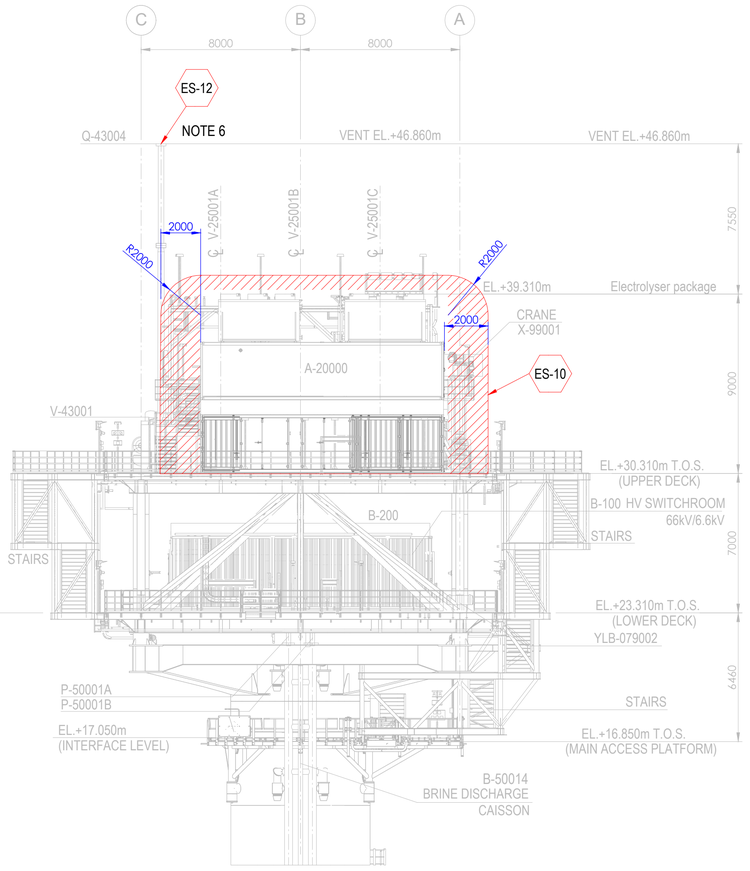

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

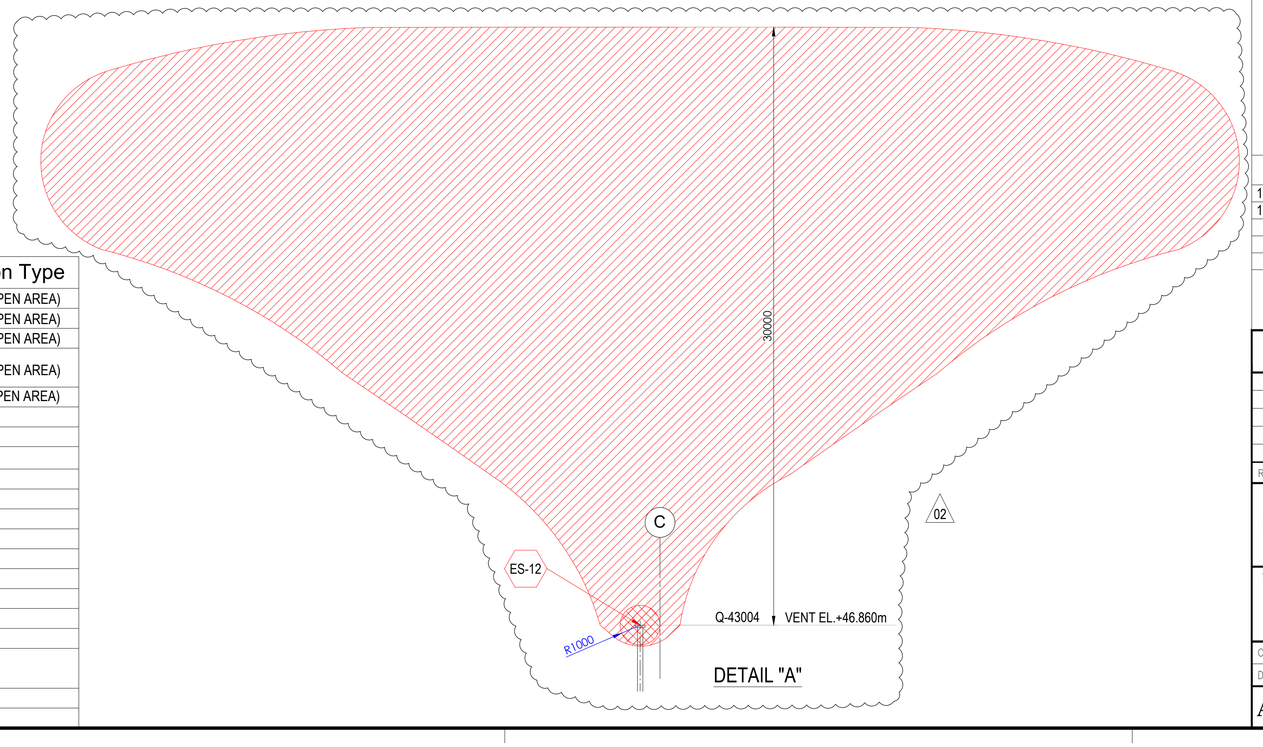



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-ZSHL-017	: Limit Switch Box - Vessel V-25001E Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001735	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		Batch: IT0380128944			
Manufacturer	SOLDO			**Model**		SQN120E-20X23L7			
Cert No.	CML 19ATEX1359X			**Equipment Ambient Temp.**		-40°C to +80°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T5	**IP Rating**	IP66/68

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	OK	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		OK	
	Physical check	x	OK	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	OK	
19	Flameproof components are undamaged	x	OK	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	OK	

ITEM	Tag	25-ZSHL-017	: Limit Switch Box - Vessel V-25001E Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001735		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	OK	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-ZSHL-017	: Limit Switch Box - Vessel V-25001E Hydrogen Inlet		Dwg	123A90-DDL-PR-PID-80016	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001735	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-29	2025-02-05	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:37:58.809Z	PROVERLIS Digitaly signed by Alessio Polo 2025-02-05T16:39:49.591Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

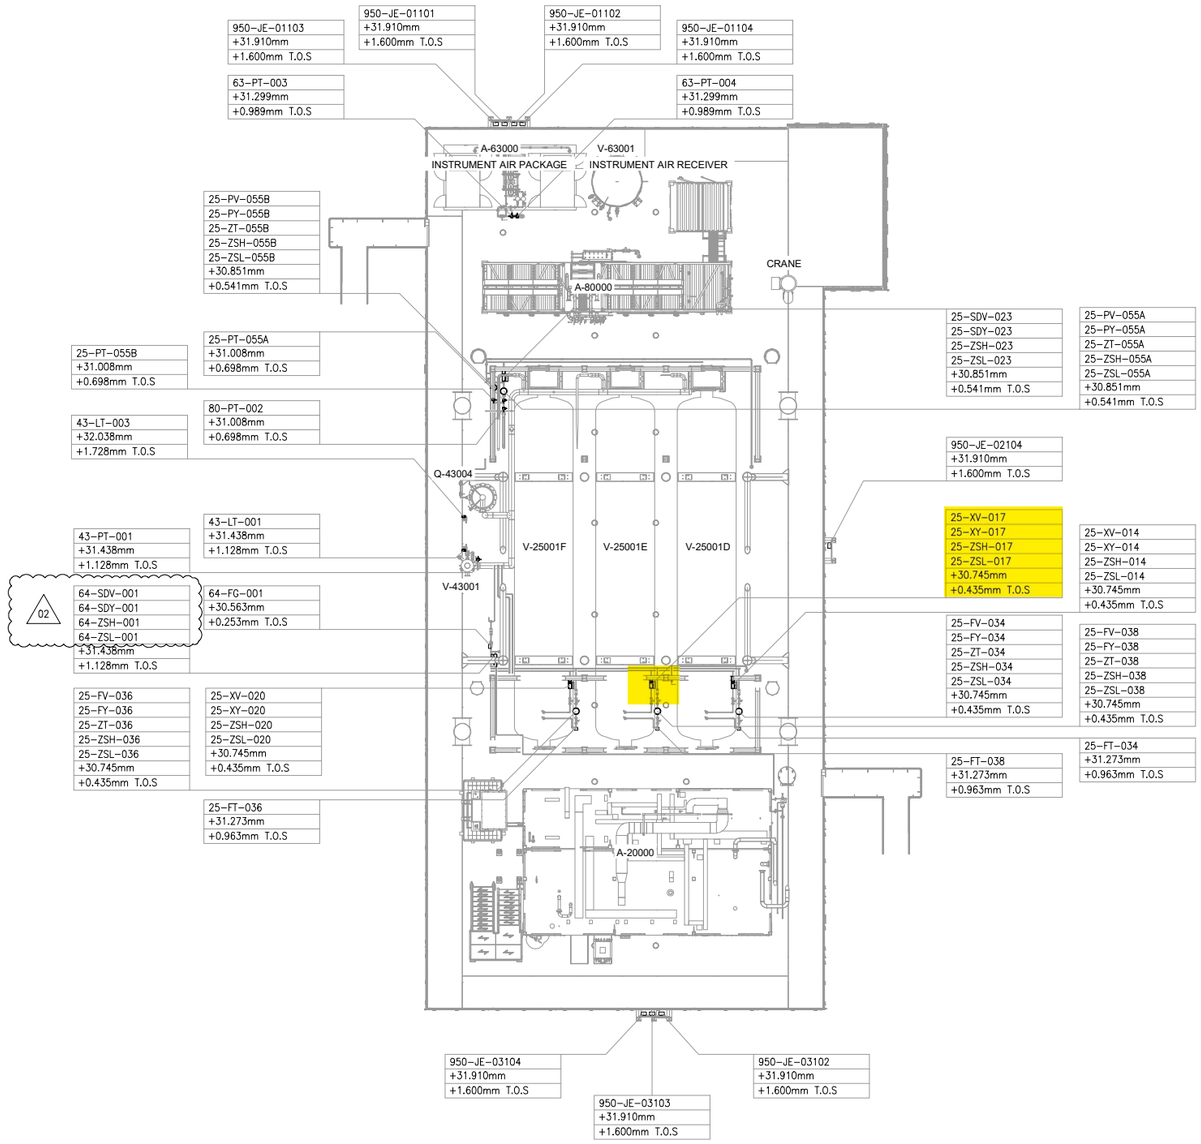


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 E

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

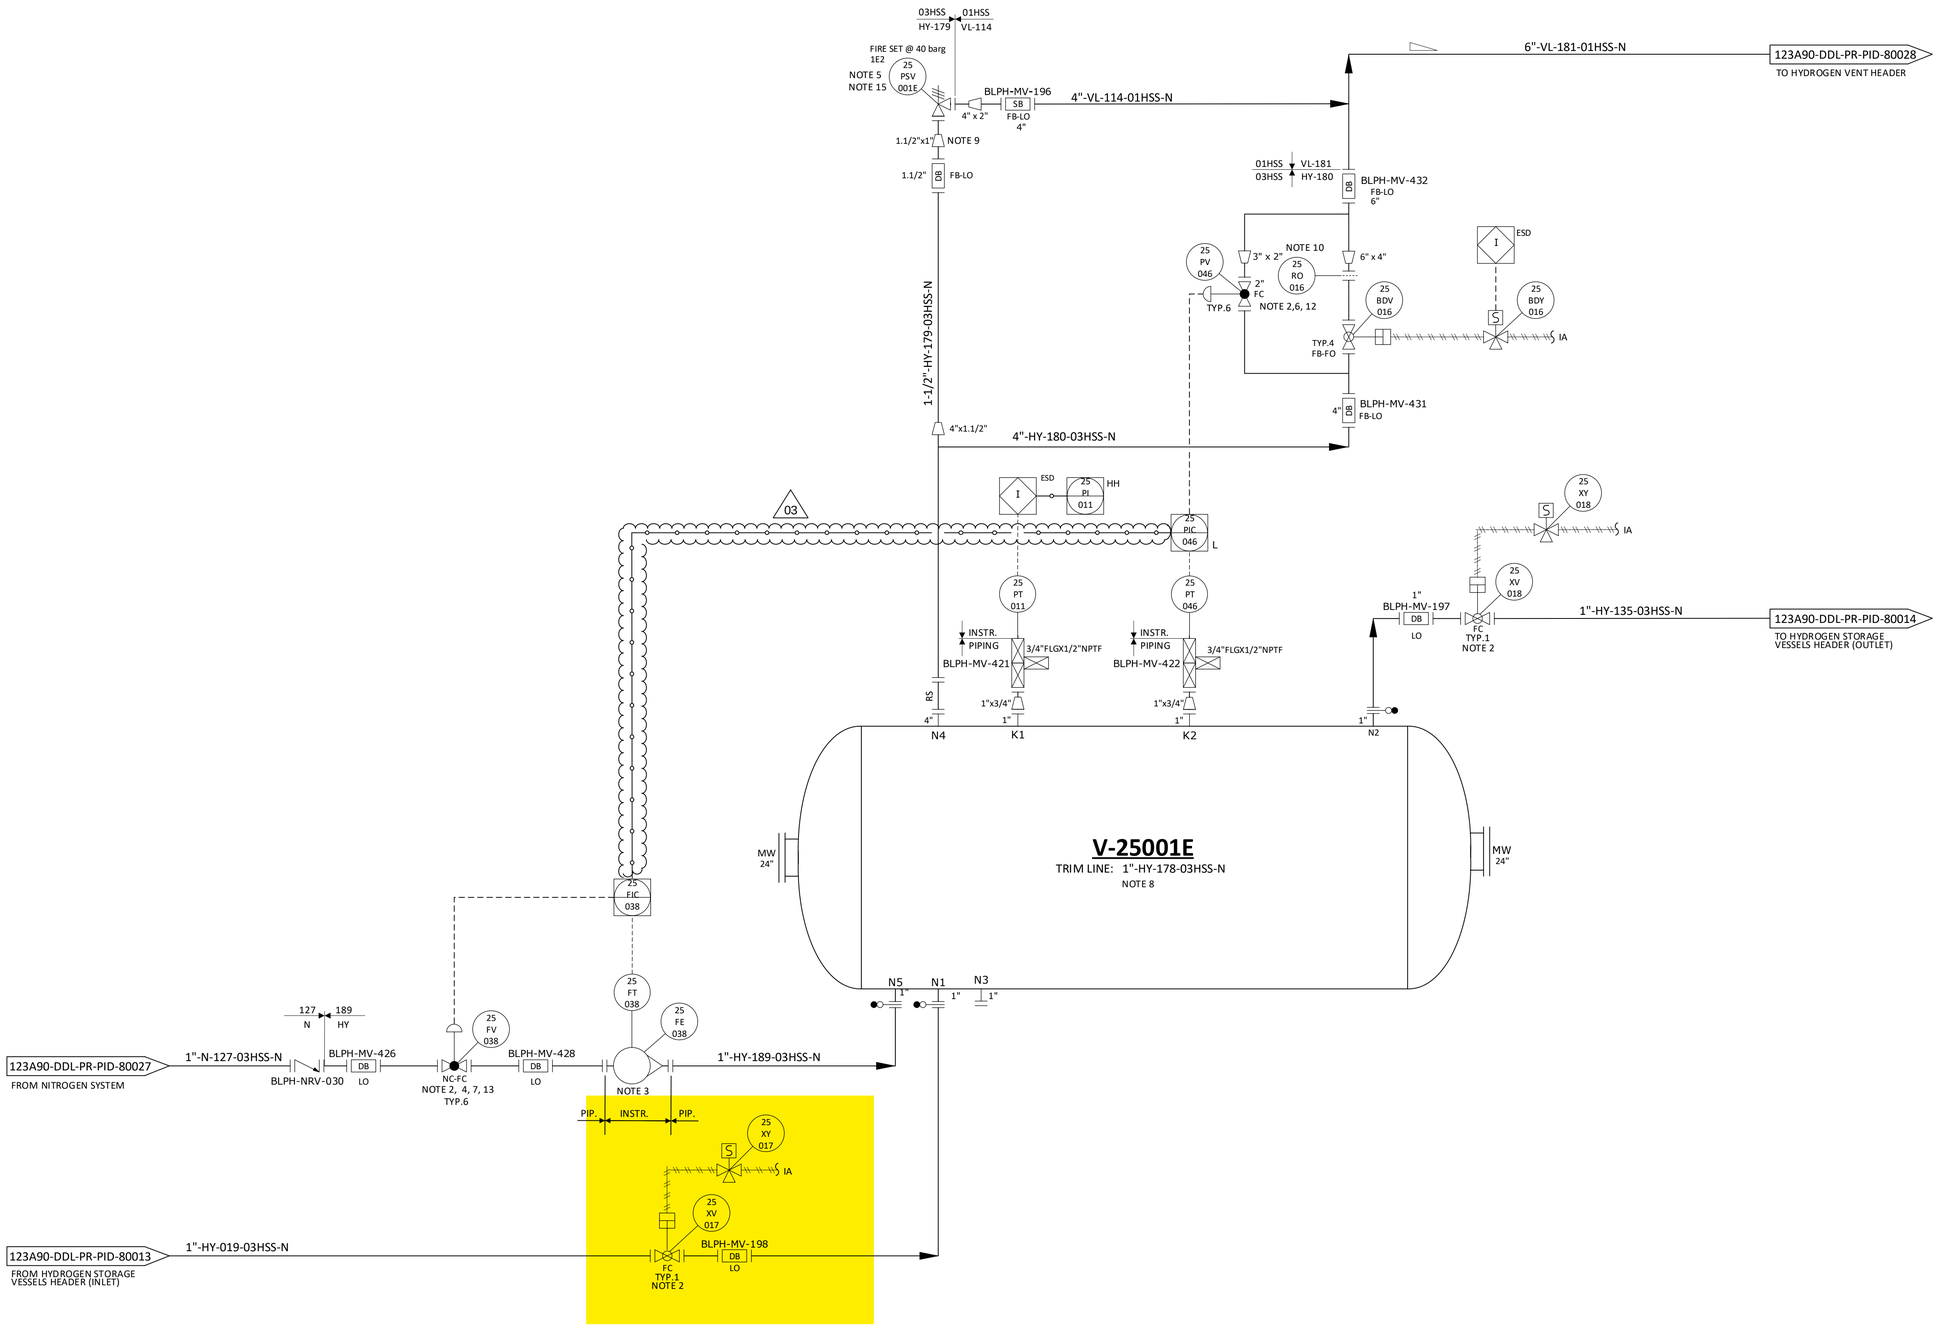

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-038) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-046 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-046 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-038 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-046 HAS FAILED TO CLOSE.
15. 25-PSV-001E SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND


ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL E

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE		
A1	DRAWING NO. 123A90-DDL-PR-PID-80019			SHEET 001	REV. 03

File Name = FILE_NAME

E33

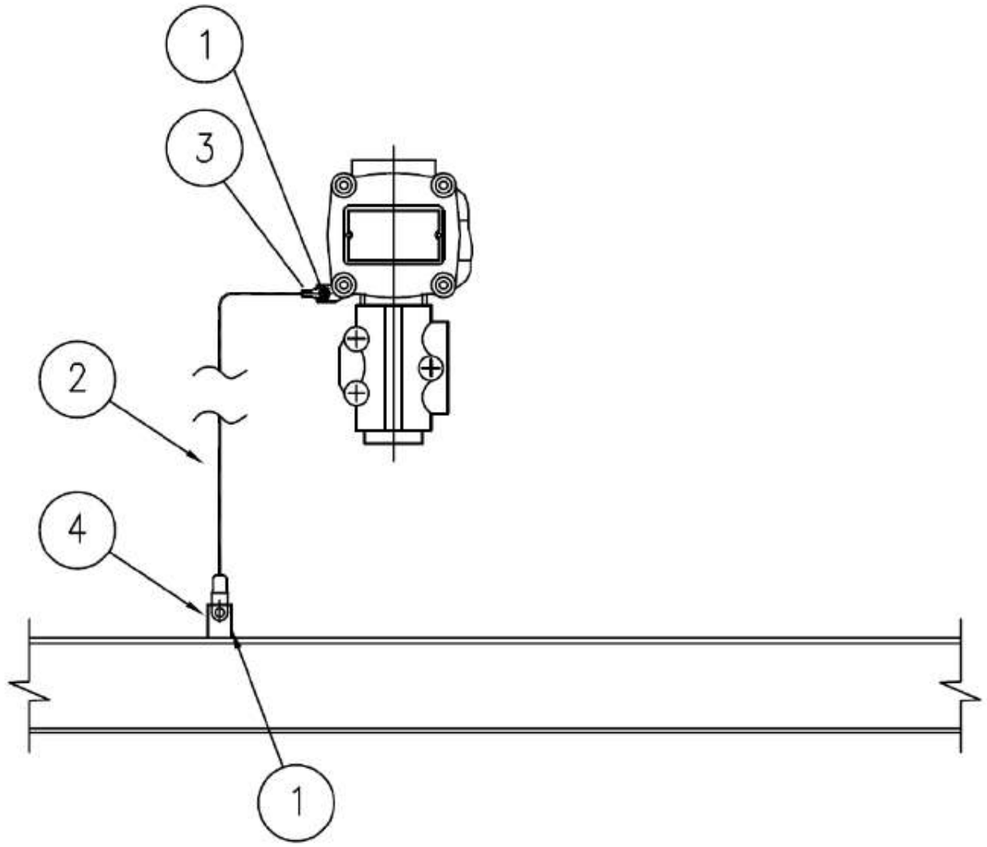

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS

A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-12004	No.	MARSHALLING CABINET B400-PCS-002

<01>

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-004 (1, 2) WH BK PR1
- 25-ZSH-004 (5, 6) WH BK PR2

NOTE-2

C-25-XV-004/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-008 (1, 2) WH BK PR1
- 25-ZSH-008 (5, 6) WH BK PR2

NOTE-2

C-25-XV-008/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-011 (1, 2) WH BK PR1
- 25-ZSH-011 (5, 6) WH BK PR2

NOTE-2

C-25-XV-011/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-014 (1, 2) WH BK PR1
- 25-ZSH-014 (5, 6) WH BK PR2

NOTE-2

C-25-XV-014/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-017 (1, 2) WH BK PR1
- 25-ZSH-017 (5, 6) WH BK PR2

NOTE-2

C-25-XV-017/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-1

WH/BK	1	WH/BK	PR1
	2		
	SH		
WH/BK	3	WH/BK	PR2
	4		
	SH		
WH/BK	5	WH/BK	PR3
	6		
	SH		
WH/BK	7	WH/BK	PR4
	8		
	SH		
WH/BK	9	WH/BK	PR5
	10		
	SH		
WH/BK	11	WH/BK	PR6
	12		
	SH		
WH/BK	13	WH/BK	PR7
	14		
	SH		
WH/BK	15	WH/BK	PR8
	16		
	SH		
WH/BK	17	WH/BK	PR9
	18		
	SH		
WH/BK	19	WH/BK	PR10
	20		
	SH		
SPARE	21	WH/BK	PR11
	22		
	SH		
SPARE	23	WH/BK	PR12
	24		
	SH		
	OS		

00-JE-12004_1/B400-PCS-002
12x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-00-JE-12004

PR1 WH/BK	1	25-ZSL-004
Shield Bar	2	
PR2 WH/BK	3	25-ZSH-004
Shield Bar	4	
PR3 WH/BK	5	25-ZSL-008
Shield Bar	6	
PR4 WH/BK	7	25-ZSH-008
Shield Bar	8	
PR5 WH/BK	9	25-ZSL-011
Shield Bar	10	
PR6 WH/BK	11	25-ZSH-011
Shield Bar	12	
PR7 WH/BK	13	25-ZSL-014
Shield Bar	14	
PR8 WH/BK	15	25-ZSH-014
Shield Bar	16	
PR9 WH/BK	17	25-ZSL-017
Shield Bar	18	
PR10 WH/BK	19	25-ZSH-017
Shield Bar	20	
PR11 WH/BK	21	SPARE
Shield Bar	22	
PR12 WH/BK	23	SPARE
	24	

Shield Bar

I.E.

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_I	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-12004-SH.1 OF 2


CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 019	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

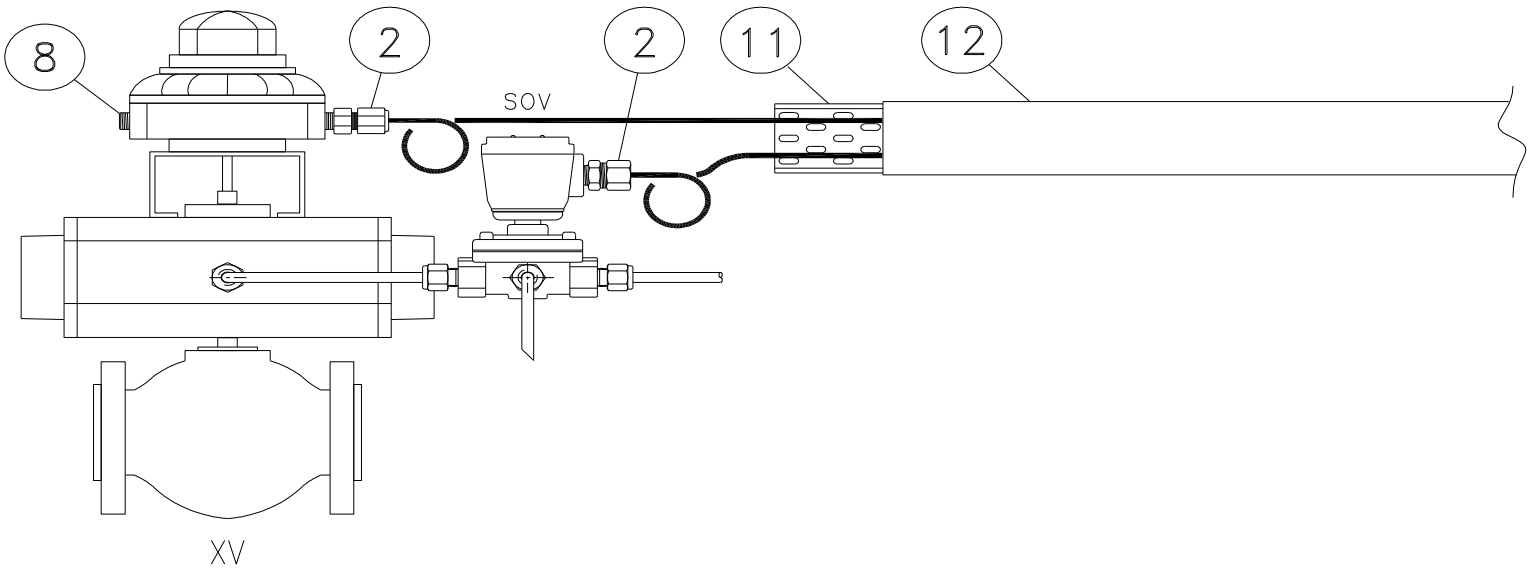

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_B	06/11/24	G.Randi

ROSETTI MARINO SpA


NOTE:

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

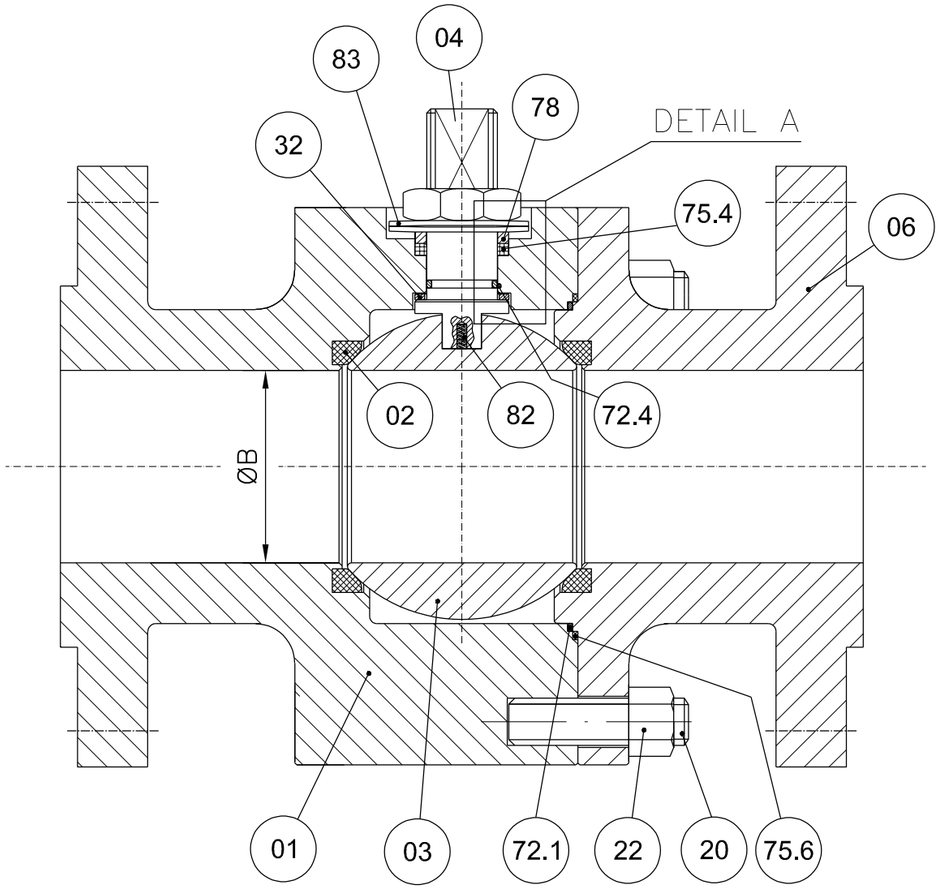


DETAIL A




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: D240062-08 — Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-017		25
	2	Service				HYDROGEN STORAGE TANK V-25001E INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80019		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-019-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-017 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-017 (9, 17) - Soldo SS		25-ZSH-017 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-ZSH-019	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-022	Hyrogen from vessels outlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSH-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-031	Nitrogen to V-25001A vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-032	Nitrogen to V-25001B vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-033	Nitrogen to V-25001C vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-034	Nitrogen to V-25001D vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-036	Nitrogen to V-25001F vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-038	Nitrogen to V-25001E vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSH-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSL-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSL-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSL-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSL-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSL-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSL-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSL-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSL-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSL-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSL-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-ZSL-019	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSL-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSL-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-022	Hyrogen from vessels outlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSL-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSL-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSL-031	Nitrogen to V-25001A vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-032	Nitrogen to V-25001B vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2

94	IFR	25-XV-009	floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR	25-XV-011	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR	25-XV-012	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR	25-XV-014	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR	25-XV-015	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR	25-XV-017	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR	25-XV-018	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

EU Type Examination Certificate CML 19ATEX1359X Issue 1

1 Equipment intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU

2 Equipment **SOLDO™ SK and SQ Series Limit Switch Boxes**

3 Manufacturer **Rotork Instruments Italy srl**

4 Address **Via Portico 17**
24050
Orio al Serio (BG)
Italy

5 The equipment is specified in the description of this certificate and the documents to which it refers.

6 CML B.V., Chamber of Commerce No 67386717, Koopvaardijweg 32, 4906CV Oosterhout, The Netherlands, Notified Body Number 2776, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this equipment has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment intended for use in potentially explosive atmospheres given in Annex II to the Directive.

The examination and test results are recorded in the confidential reports listed in Section 12.

7 If an 'X' suffix appears after the certificate number, it indicates that the equipment is subject to conditions of safe use (affecting correct installation or safe use). These are specified in Section 14.

8 This EU Type Examination certificate relates only to the design and construction of the specified equipment or component. Further requirements of Directive 2014/34/EU Article 13 apply to the manufacture of the equipment or component and are separately certified.

9 Compliance with the Essential Health and Safety Requirements, with the exception of those listed in the confidential report, has been demonstrated through compliance with the following documents:

EN IEC 60079-0:2018 EN 60079-1:2014 EN 60079-31:2014

10 The equipment shall be marked with the following:

Ⅱ 2 G D

Ex db IIC T* Gb

Ex tb IIIC T*°C Db

Ta = -55°C to +*°C

**The ambient temperature classes and maximum surface temperature for dust depend upon the ambient temperature ranges. See Table in Section 11.*

11 Description

The SOLDO™ SK and SQ Series Limit Switch Boxes are electromechanical devices used to indicate the position of valves/actuators etc. by means of an electrical signal and an optional visual indicator. The metallic enclosure is constructed from aluminium (SK) or 316 or 316L stainless steel (SQ) and comprises of two enclosure halves secured with 4 x M6 stainless steel fasteners with a minimum property class of 500 MPa. An operating rod passes through each enclosure half for connection to the device being monitored. The rod operates the internal switch/sensor for signalling and passes through to the external indicator (when fitted). There are two threaded entries (M20 or ½" NPT) into the enclosure for cable entry.

The applicable ambient temperature ranges and corresponding Temperature Classes and Maximum Surface Temperatures for Dust are detailed in the table below:

Ambient Temp. Range	T Class	Maximum Surface Temp. for Dust
-55°C to +60°C	T6	T85°C
-55°C to +80°C	T5	T100°C
-55°C to +105°C	T4	T135°C

Rating:

Max. Voltage: 125 Vdc/250 Vac
Max. Current: 10 A
Max. Power: 10 W

Notes:

- Sira 12ATEX1098X is superseded by this certificate.
- The product covered by Issue 0 of this certificate remains identical to that previously covered by Sira 12ATEX1098X.
- Where Sira 12ATEX1098X is specified in other product certification, or other technical specifications, this certificate reference for the product shall be used in its place; updating of the other product certificate or technical specification is not required.

Variation 1

This variation introduced the following changes:

i. Introduction of power dissipation calculation as supporting certification document.

12 Certificate history and evaluation reports

Issue	Date	Associated report	Notes
0	04 Oct 2019	R12654A/00	Initial issue
1	27 Mar 2024	R17518A/00	Introduction of Variation 1

Note: Drawings that describe the equipment or component are listed in the Annex.

13 Conditions of Manufacture

The following conditions are required of the manufacturing process for compliance with the certification.

i. Where the product incorporates certified parts or safety critical components, the manufacturer of the product defined on this certificate shall continually monitor these parts/components for any modifications introduced by the manufacturer(s) of these constituent parts. If the manufacturer of any constituent part introduces any changes which affect the compliance of the certified product that is the subject of this certificate, the manufacturer is required to have this certificate updated.

ii. The power dissipation inside the flameproof enclosure shall not exceed 10 W.

14 Specific Conditions of Use (Special Conditions)

The following conditions relate to safe installation and/or use of the equipment.

i. The equipment is fitted with a non-conducting position indicator which could potentially generate an ignition-capable level of electrostatic charge under certain extreme conditions. Therefore, the equipment shall not be installed in a location where it may be subjected to external conditions (such as high-pressure steam) which might cause a build-up of electrostatic charge on the non-conducting surfaces. Additionally, cleaning of the equipment should be done only with a damp cloth.

ii. The maximum temperature at the cable entry points may exceed 70°C. The user shall refer to the manufacturer's instructions document for guidance in respect of the selection of suitable cabling for the equipment.


iii. Dust layers in excess of 50 mm shall not be allowed to form on the equipment.

iv. The following have a minimum flamepath width (L) and maximum gap (i_c) other than that detailed in EN 60079-1 Table 3 and are detailed below:


Flamepath	**Joint Width (L) mm**	**Max. Gap (i_c) mm**
Cover shaft/Cover	26	0.097
Body Shaft/Body	26	0.097

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

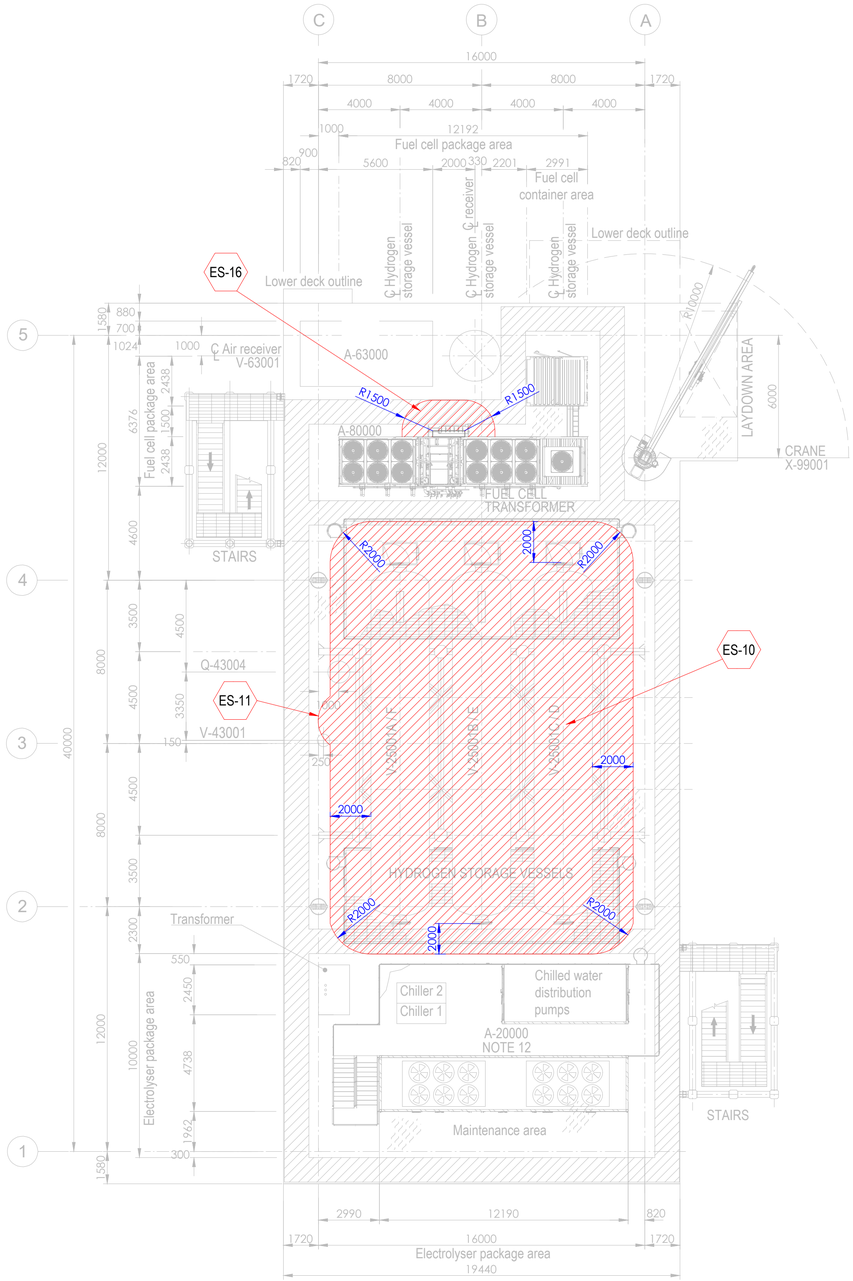


PLAN ON UPPER DECK
EL+30.310 T.O.S.

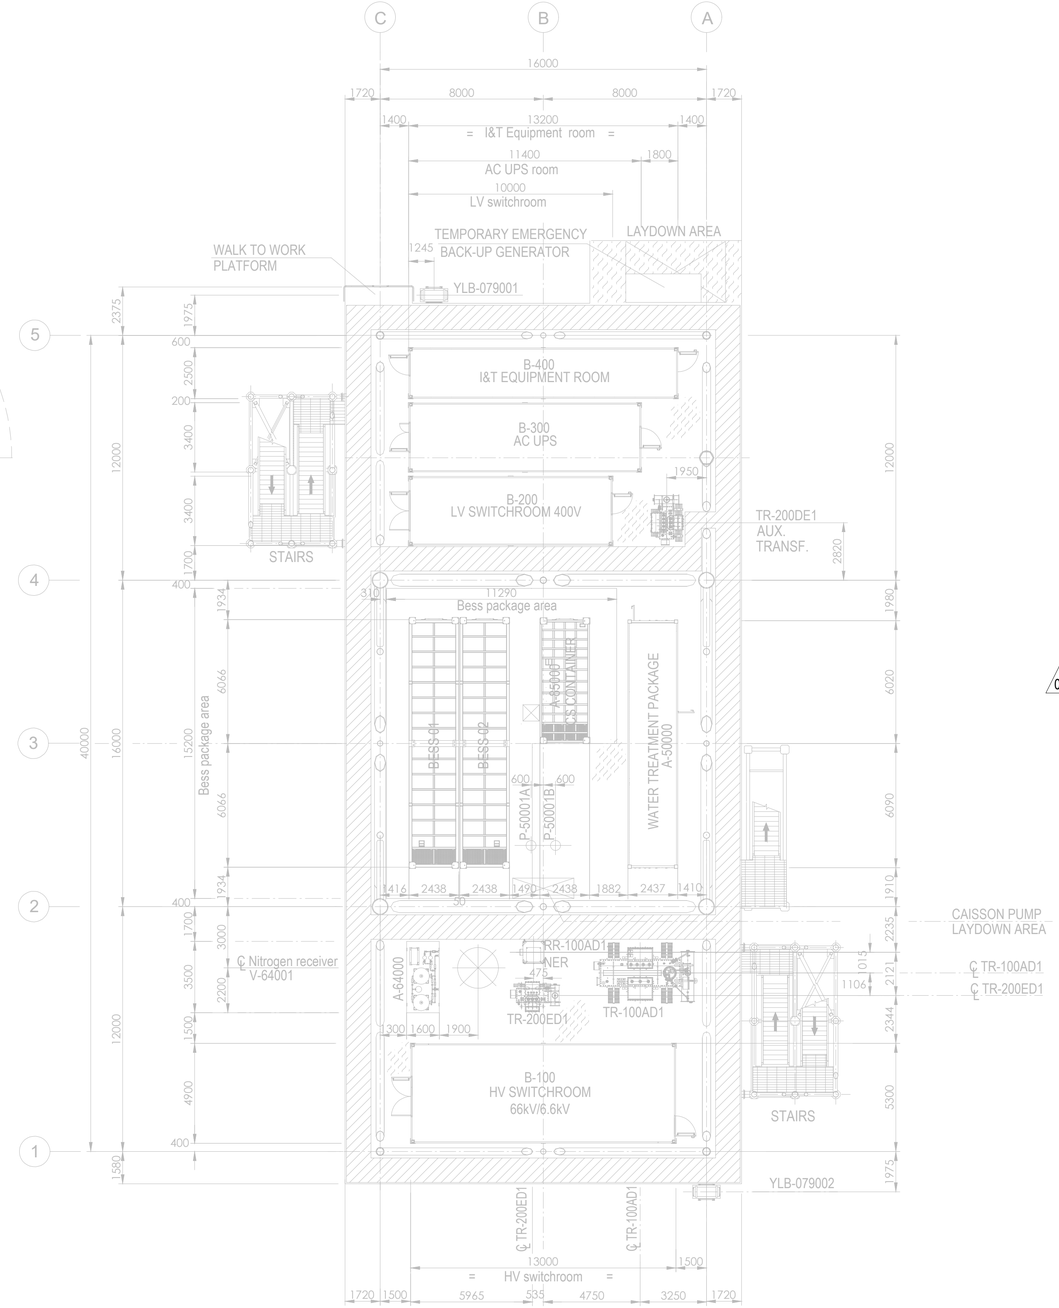

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

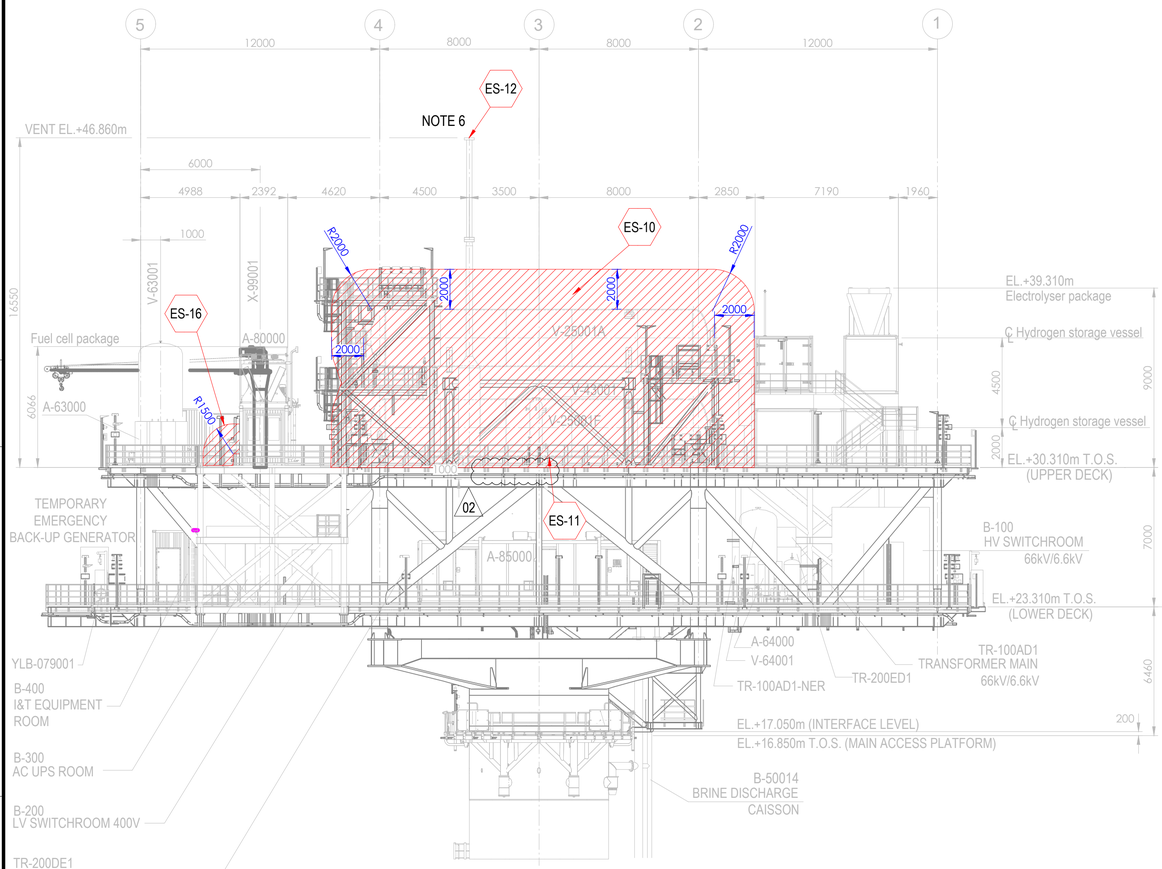



ELEVATION LOOKING EAST

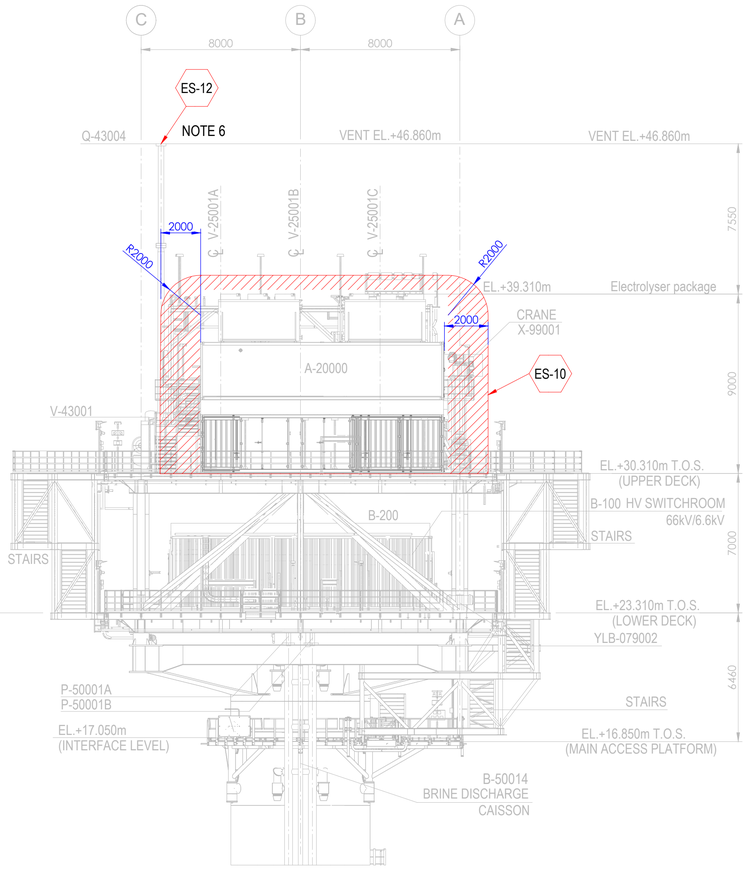

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

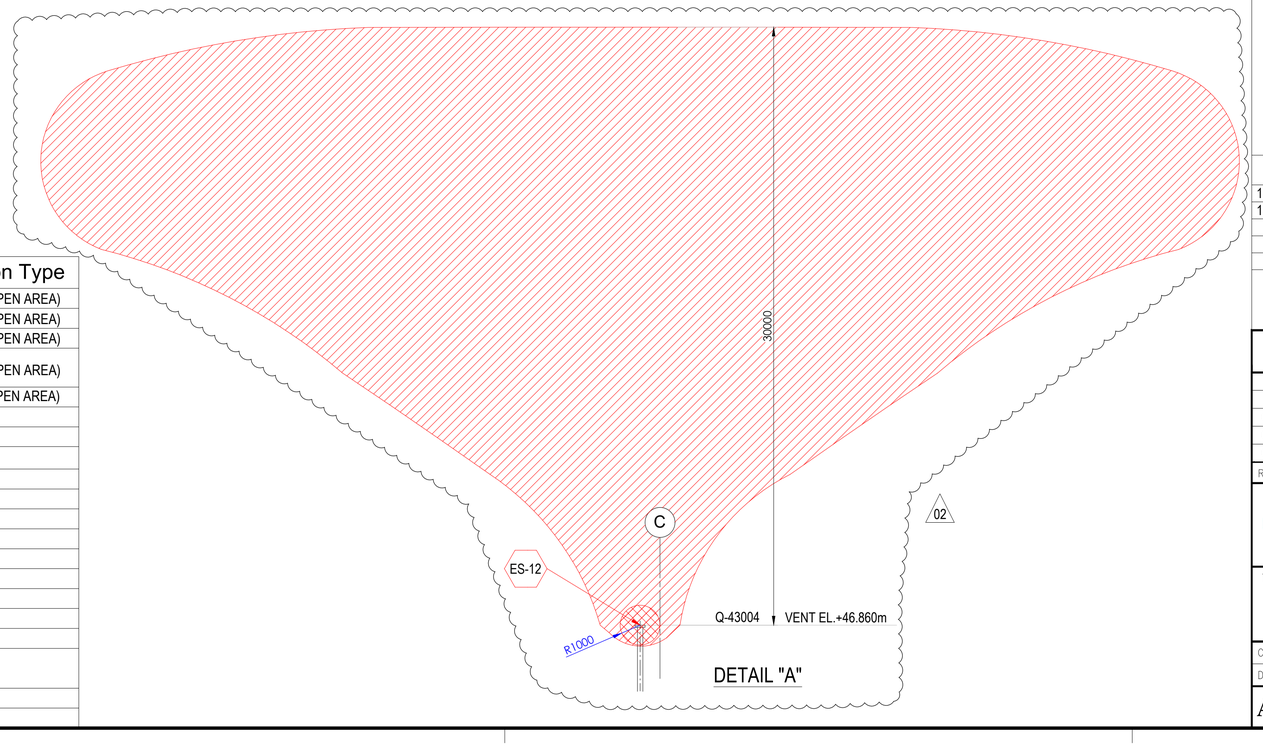



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-ZSHL-020	: Limit Switch Box - Vessel V-25001F Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80020
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001737	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		Batch:IT0380127022			
Manufacturer	SOLDO			**Model**		SQN120E-20X23L7			
Cert No.	CML19ATEX1359X			**Equipment Ambient Temp.**		-40°C to +80°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66/68

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	OK	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		OK	
	Physical check	x	OK	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	OK	
19	Flameproof components are undamaged	x	OK	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	OK	

ITEM	Tag	25-ZSHL-020	: Limit Switch Box - Vessel V-25001F Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80020
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001737		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	OK	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	OK	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-ZSHL-020	: Limit Switch Box - Vessel V-25001F Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80020
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001737	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Giovanni Tangianu	
Date	2025-01-29	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:38:16.874Z	PROVERLIS Digitaly signed by Giovanni Tangianu 2025-01-29T13:26:45.663Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

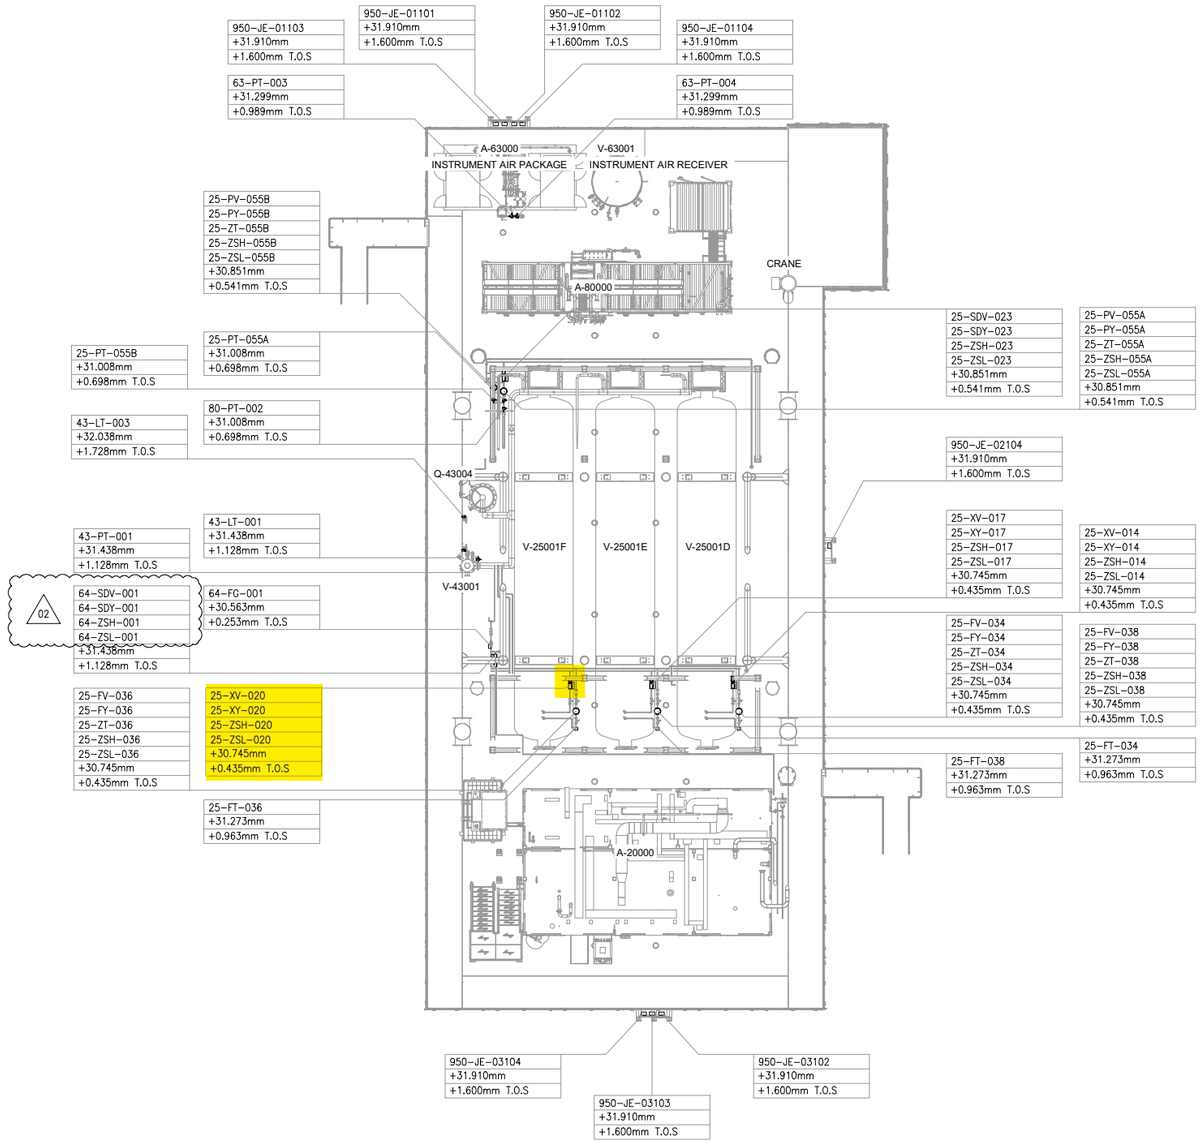


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90-DDL-IN-DL-40081	001	02

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001_F

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

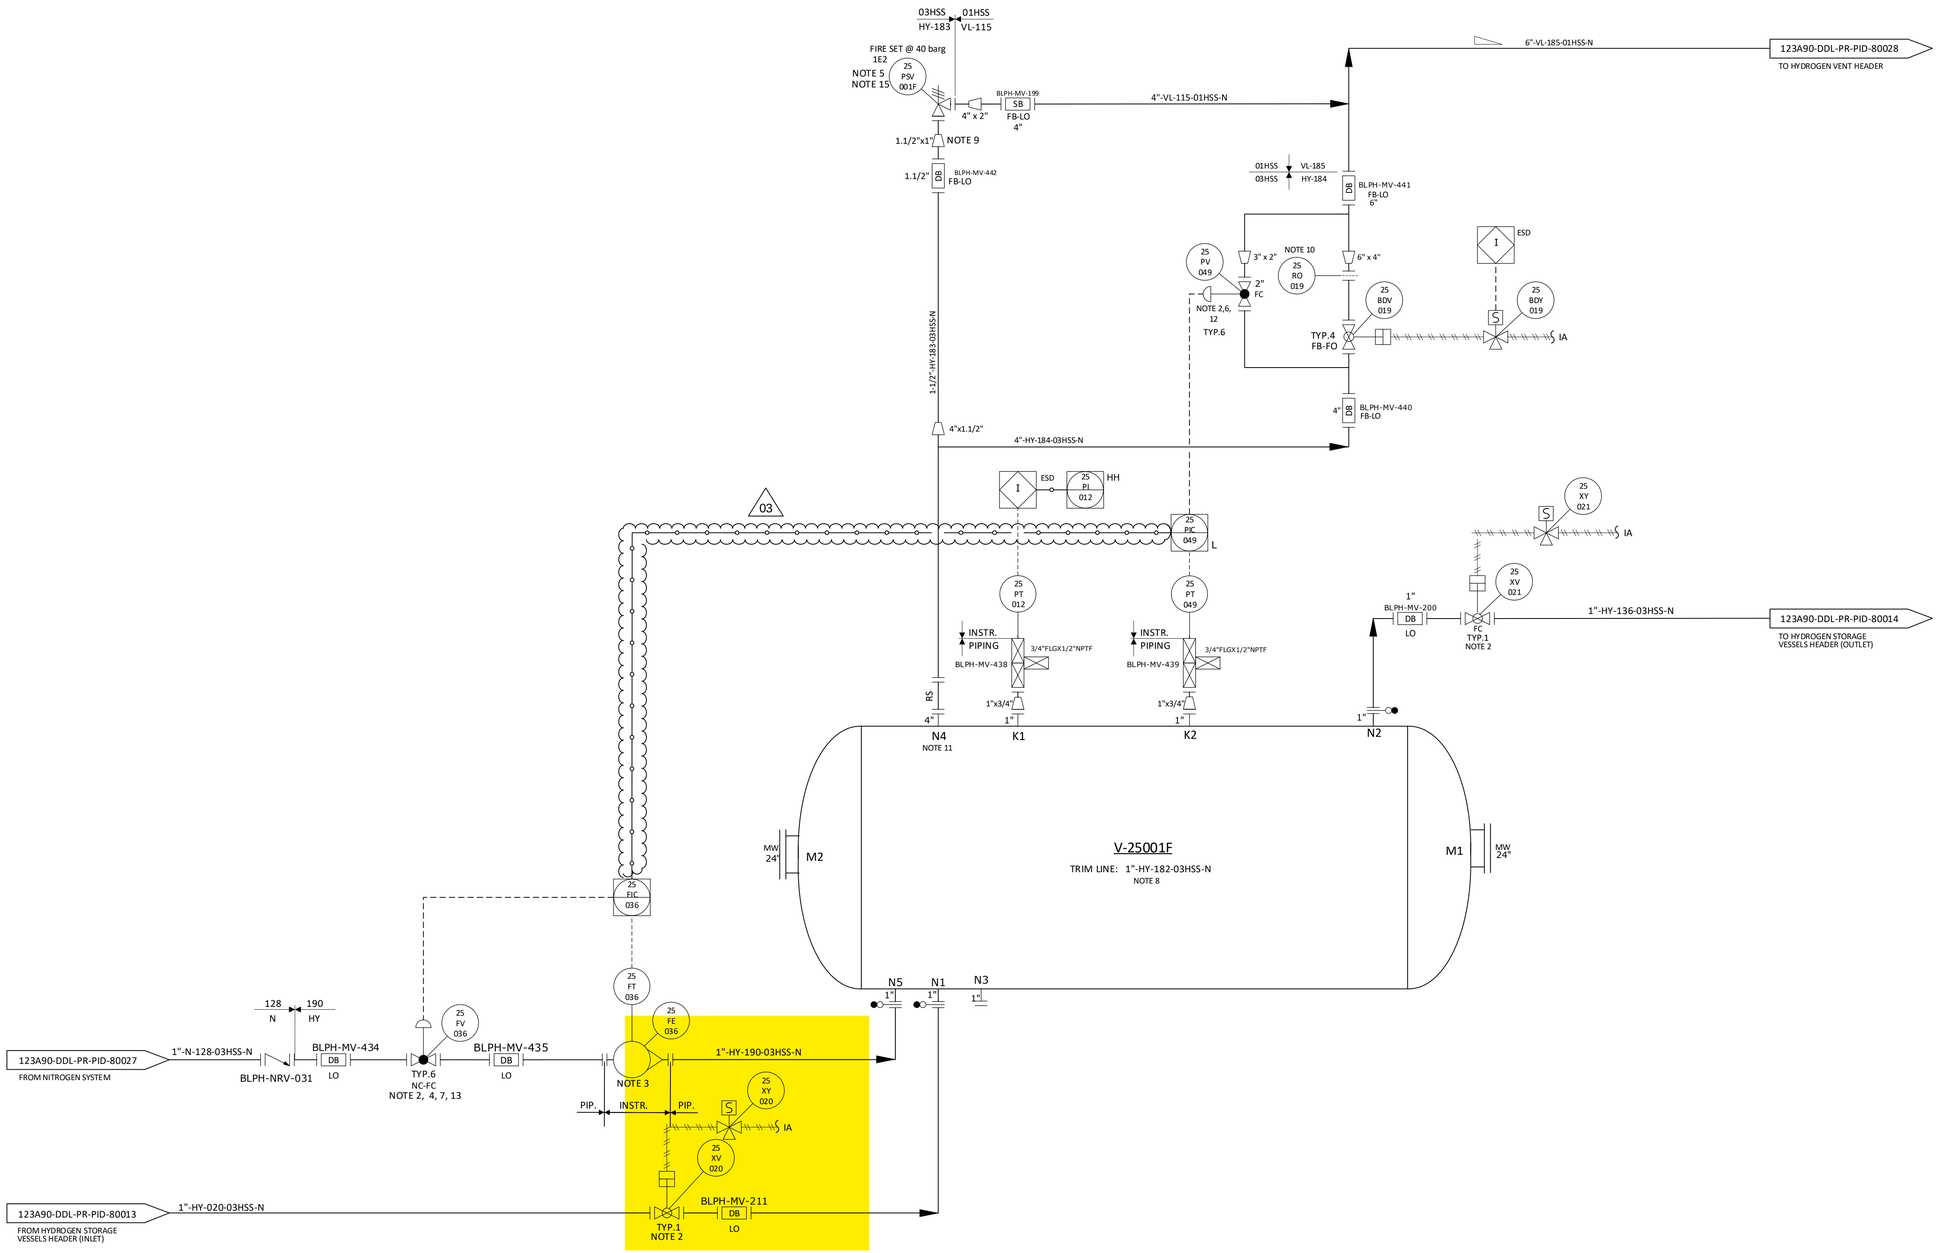

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-036) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-049 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-049 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25FV036 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-049 HAS FAILED TO CLOSE.
15. 25-PSV-001F SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR HAZOP (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL F

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80020		SHEET 001	REV. 03

File Name = FILE_NAME

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-12004	No.	MARSHALLING CABINET B400-PCS-002

<01>

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-020 (1 WH, 2 BK) → PR1
- 25-ZSH-020 (5 WH, 6 BK) → PR2
- NOTE-2

C-25-XV-020/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

CONTROL VALVE LIMIT SWITCHES BOX (EISENBAU)
- 25-ZSL-031 (2 WH, 3 BK) — NOTE-2
- 25-ZSH-031 (5 WH, 6 BK) — NOTE-2

C-25-ZSL-031/00-JE-12004
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

C-25-ZSH-031/00-JE-12004
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

CONTROL VALVE LIMIT SWITCHES BOX (EISENBAU)
- 25-ZSL-032 (2 WH, 3 BK) — NOTE-2
- 25-ZSH-032 (5 WH, 6 BK) — NOTE-2

C-25-ZSL-032/00-JE-12004
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

C-25-ZSH-032/00-JE-12004
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

CONTROL VALVE LIMIT SWITCHES BOX (EISENBAU)
- 25-ZSL-033 (2 WH, 3 BK) — NOTE-2
- 25-ZSH-033 (5 WH, 6 BK) — NOTE-2

C-25-ZSL-033/00-JE-12004
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

C-25-ZSH-033/00-JE-12004
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

CONTROL VALVE LIMIT SWITCHES BOX (EISENBAU)
- 25-ZSL-034 (2 WH, 3 BK) — NOTE-2
- 25-ZSH-034 (5 WH, 6 BK) — NOTE-2

C-25-ZSL-034/00-JE-12004
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

C-25-ZSH-034/00-JE-12004
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

TB-2

WH/BK	25	PR1
	26	
	SH	
WH/BK	27	PR2
	28	
	SH	
WH/BK	29	PR3
	30	
	SH	
WH/BK	31	PR4
	32	
	SH	
WH/BK	33	PR5
	34	
	SH	
WH/BK	35	PR6
	36	
	SH	
WH/BK	37	PR7
	38	
	SH	
WH/BK	39	PR8
	40	
	SH	
WH/BK	41	PR9
	42	
	SH	
WH/BK	43	PR10
	44	
	SH	
SPARE	45	PR11
	46	
	SH	
SPARE	47	PR12
	48	
	SH	
	OS	

00-JE-12004_2/B400-PCS-002
12x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-00-JE-12004

PR1 WH/BK	25	25-ZSL-020
	26	
Shield Bar		
PR2 WH/BK	27	25-ZSH-020
	28	
Shield Bar		
PR3 WH/BK	29	25-ZSL-031
	30	
Shield Bar		
PR4 WH/BK	31	25-ZSH-031
	32	
Shield Bar		
PR5 WH/BK	33	25-ZSL-032
	34	
Shield Bar		
PR6 WH/BK	35	25-ZSH-032
	36	
Shield Bar		
PR7 WH/BK	37	25-ZSL-033
	38	
Shield Bar		
PR8 WH/BK	39	25-ZSH-033
	40	
Shield Bar		
PR9 WH/BK	41	25-ZSL-034
	42	
Shield Bar		
PR10 WH/BK	43	25-ZSH-034
	44	
Shield Bar		
PR11 WH/BK	45	SPARE
	46	
Shield Bar		
PR12 WH/BK	47	SPARE
	48	

Shield Bar — I.E.

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-12004-SH.2 OF 2

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 020	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

E33

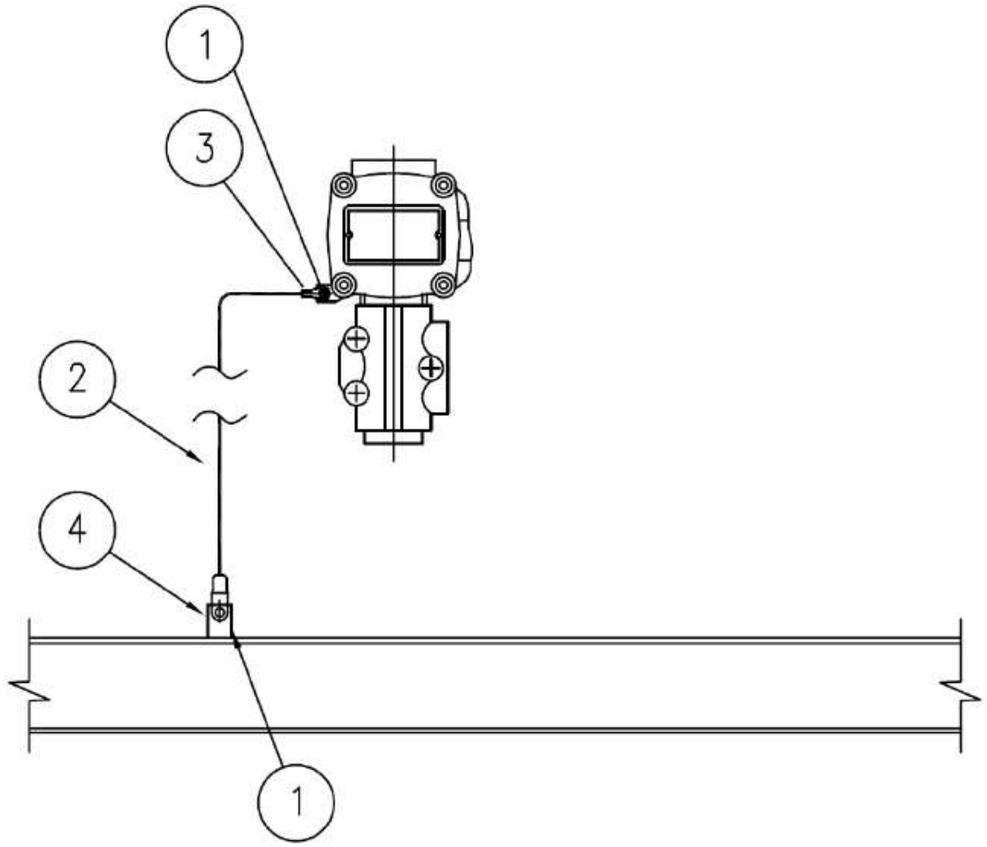

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-EL-DD-20090
REV.: 2_I | DATE: 07/11/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

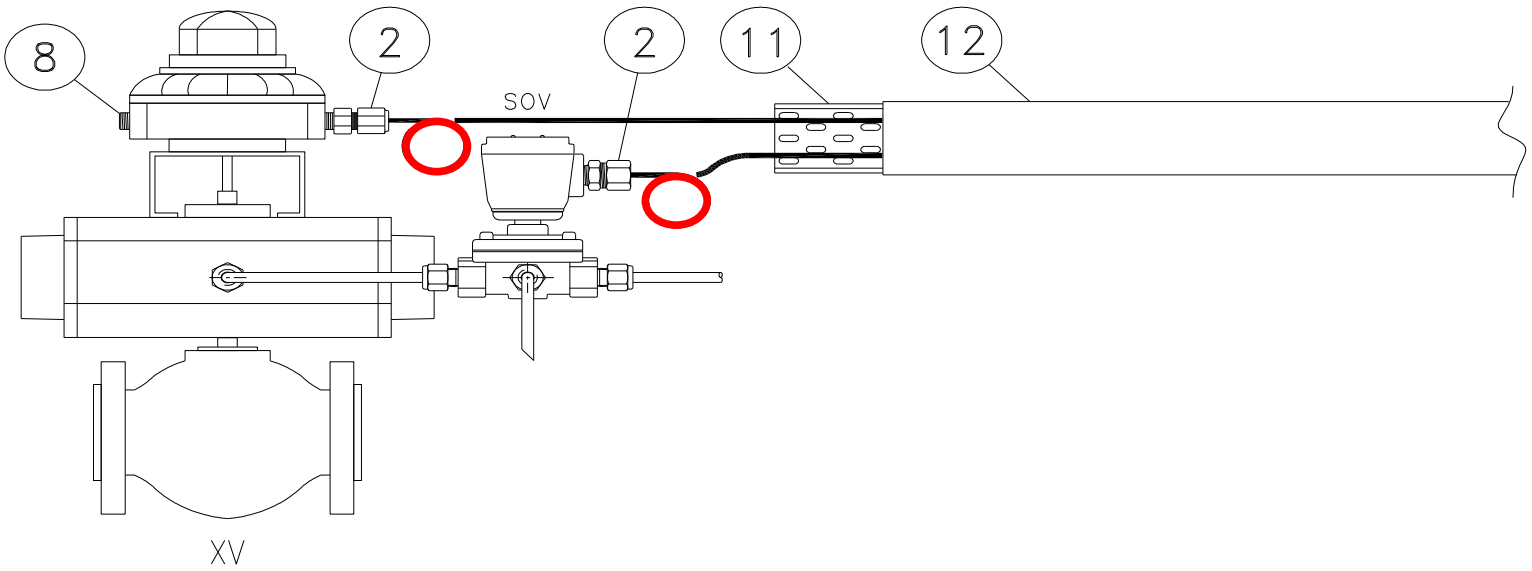

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

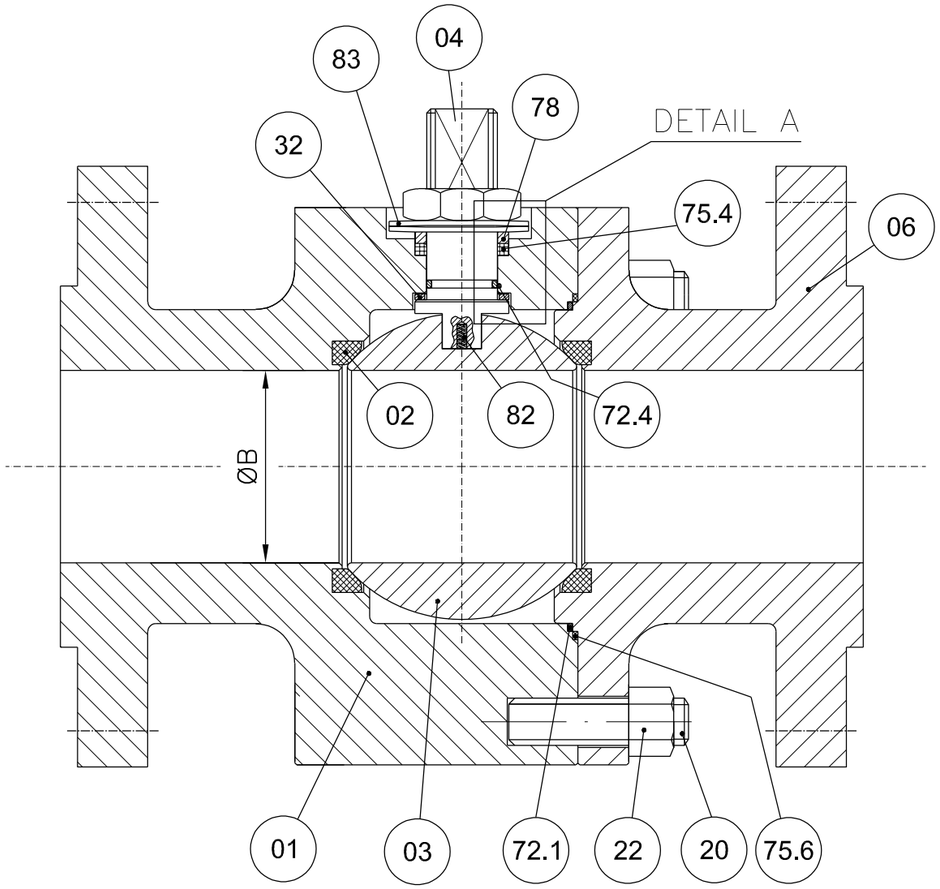




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

1 Rev.

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

1 Rev.

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: **D240062-08** Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-020		25
	2	Service				HYDROGEN STORAGE TANK V-25001F INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80020		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-020-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-020 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-020 (9, 17) - Soldo SS		25-ZSH-020 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

140	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
141	IFR	25-XV-020	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
142	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
143	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620210001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
144	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
145	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
146	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323304	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
147	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
148	IFR	25-XV-021	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
149	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
150	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620220001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
151	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
152	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
153	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323297	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
154	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
155	IFR	25-XV-024	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
156	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
157	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620230001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
158	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
159	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
160	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323291	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
161	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
162	IFR	50-XV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
163	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
164	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620240001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
165	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
166	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
167	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323289	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
168	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
169	IFR	50-XV-002	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
170	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
171	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620250001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
172	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
173	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
174	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323290	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
175	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
176	IFR	50-XV-003	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
177	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
178	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620260001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
179	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
180	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
181	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323299	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
182	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
183	IFR	50-XV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
184	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
185	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620270001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
186	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

EU Type Examination Certificate CML 19ATEX1359X Issue 1

1 Equipment intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU

2 Equipment **SOLDO™ SK and SQ Series Limit Switch Boxes**

3 Manufacturer **Rotork Instruments Italy srl**

4 Address **Via Portico 17**
24050
Orio al Serio (BG)
Italy

5 The equipment is specified in the description of this certificate and the documents to which it refers.

6 CML B.V., Chamber of Commerce No 67386717, Koopvaardijweg 32, 4906CV Oosterhout, The Netherlands, Notified Body Number 2776, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this equipment has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment intended for use in potentially explosive atmospheres given in Annex II to the Directive.

The examination and test results are recorded in the confidential reports listed in Section 12.

7 If an 'X' suffix appears after the certificate number, it indicates that the equipment is subject to conditions of safe use (affecting correct installation or safe use). These are specified in Section 14.

8 This EU Type Examination certificate relates only to the design and construction of the specified equipment or component. Further requirements of Directive 2014/34/EU Article 13 apply to the manufacture of the equipment or component and are separately certified.

9 Compliance with the Essential Health and Safety Requirements, with the exception of those listed in the confidential report, has been demonstrated through compliance with the following documents:

EN IEC 60079-0:2018 EN 60079-1:2014 EN 60079-31:2014

10 The equipment shall be marked with the following:

Ⅱ 2 G D

Ex db IIC T* Gb

Ex tb IIIC T*°C Db

Ta = -55°C to +*°C

**The ambient temperature classes and maximum surface temperature for dust depend upon the ambient temperature ranges. See Table in Section 11.*

11 Description

The SOLDO™ SK and SQ Series Limit Switch Boxes are electromechanical devices used to indicate the position of valves/actuators etc. by means of an electrical signal and an optional visual indicator. The metallic enclosure is constructed from aluminium (SK) or 316 or 316L stainless steel (SQ) and comprises of two enclosure halves secured with 4 x M6 stainless steel fasteners with a minimum property class of 500 MPa. An operating rod passes through each enclosure half for connection to the device being monitored. The rod operates the internal switch/sensor for signalling and passes through to the external indicator (when fitted). There are two threaded entries (M20 or ½" NPT) into the enclosure for cable entry.

The applicable ambient temperature ranges and corresponding Temperature Classes and Maximum Surface Temperatures for Dust are detailed in the table below:

Ambient Temp. Range	T Class	Maximum Surface Temp. for Dust
-55°C to +60°C	T6	T85°C
-55°C to +80°C	T5	T100°C
-55°C to +105°C	T4	T135°C

Rating:

Max. Voltage: 125 Vdc/250 Vac
Max. Current: 10 A
Max. Power: 10 W

Notes:

- Sira 12ATEX1098X is superseded by this certificate.
- The product covered by Issue 0 of this certificate remains identical to that previously covered by Sira 12ATEX1098X.
- Where Sira 12ATEX1098X is specified in other product certification, or other technical specifications, this certificate reference for the product shall be used in its place; updating of the other product certificate or technical specification is not required.

Variation 1

This variation introduced the following changes:

i. Introduction of power dissipation calculation as supporting certification document.

12 Certificate history and evaluation reports

Issue	Date	Associated report	Notes
0	04 Oct 2019	R12654A/00	Initial issue
1	27 Mar 2024	R17518A/00	Introduction of Variation 1

Note: Drawings that describe the equipment or component are listed in the Annex.

13 Conditions of Manufacture

The following conditions are required of the manufacturing process for compliance with the certification.

i. Where the product incorporates certified parts or safety critical components, the manufacturer of the product defined on this certificate shall continually monitor these parts/components for any modifications introduced by the manufacturer(s) of these constituent parts. If the manufacturer of any constituent part introduces any changes which affect the compliance of the certified product that is the subject of this certificate, the manufacturer is required to have this certificate updated.

ii. The power dissipation inside the flameproof enclosure shall not exceed 10 W.

14 Specific Conditions of Use (Special Conditions)

The following conditions relate to safe installation and/or use of the equipment.

i. The equipment is fitted with a non-conducting position indicator which could potentially generate an ignition-capable level of electrostatic charge under certain extreme conditions. Therefore, the equipment shall not be installed in a location where it may be subjected to external conditions (such as high-pressure steam) which might cause a build-up of electrostatic charge on the non-conducting surfaces. Additionally, cleaning of the equipment should be done only with a damp cloth.

ii. The maximum temperature at the cable entry points may exceed 70°C. The user shall refer to the manufacturer's instructions document for guidance in respect of the selection of suitable cabling for the equipment.


iii. Dust layers in excess of 50 mm shall not be allowed to form on the equipment.

iv. The following have a minimum flamepath width (L) and maximum gap (i_c) other than that detailed in EN 60079-1 Table 3 and are detailed below:


Flamepath	**Joint Width (L) mm**	**Max. Gap (i_c) mm**
Cover shaft/Cover	26	0.097
Body Shaft/Body	26	0.097

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

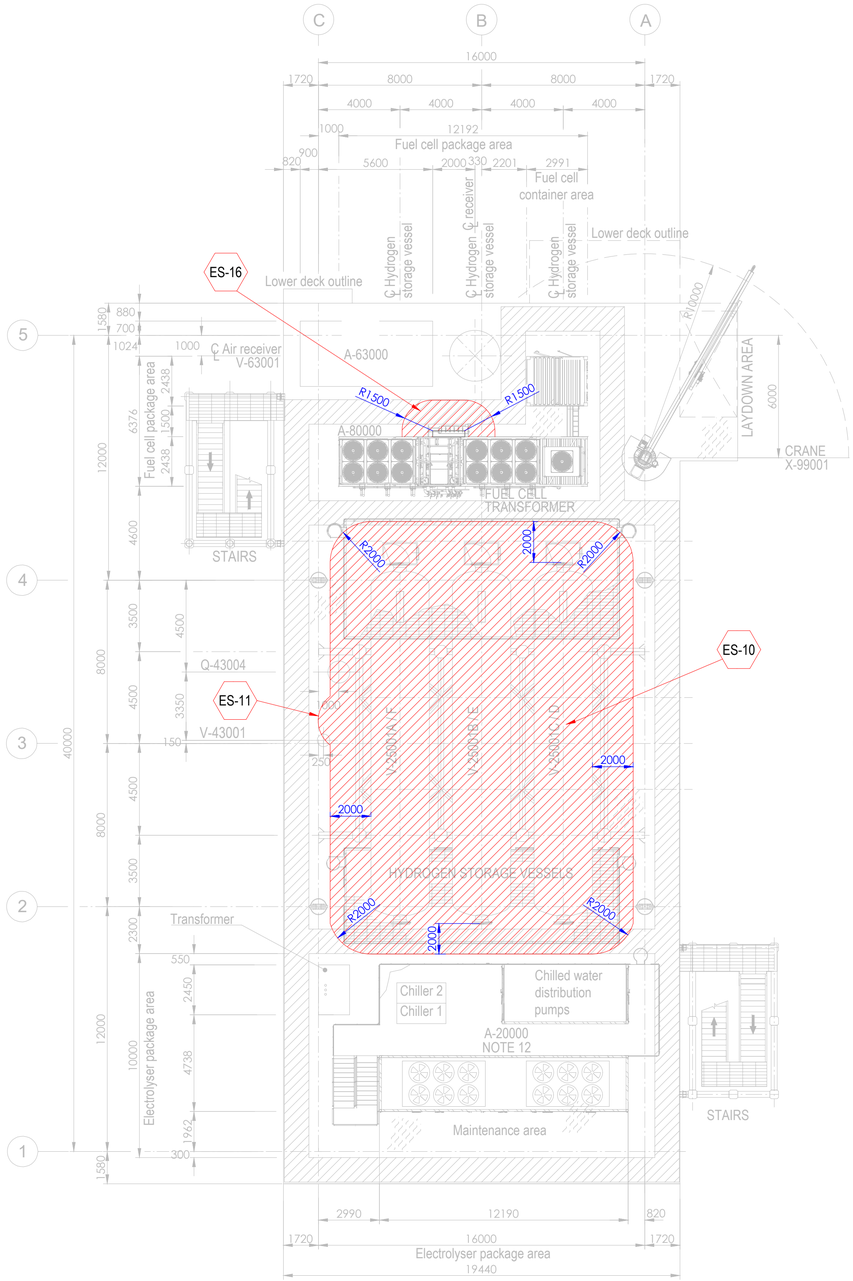


PLAN ON UPPER DECK
EL+30.310 T.O.S.

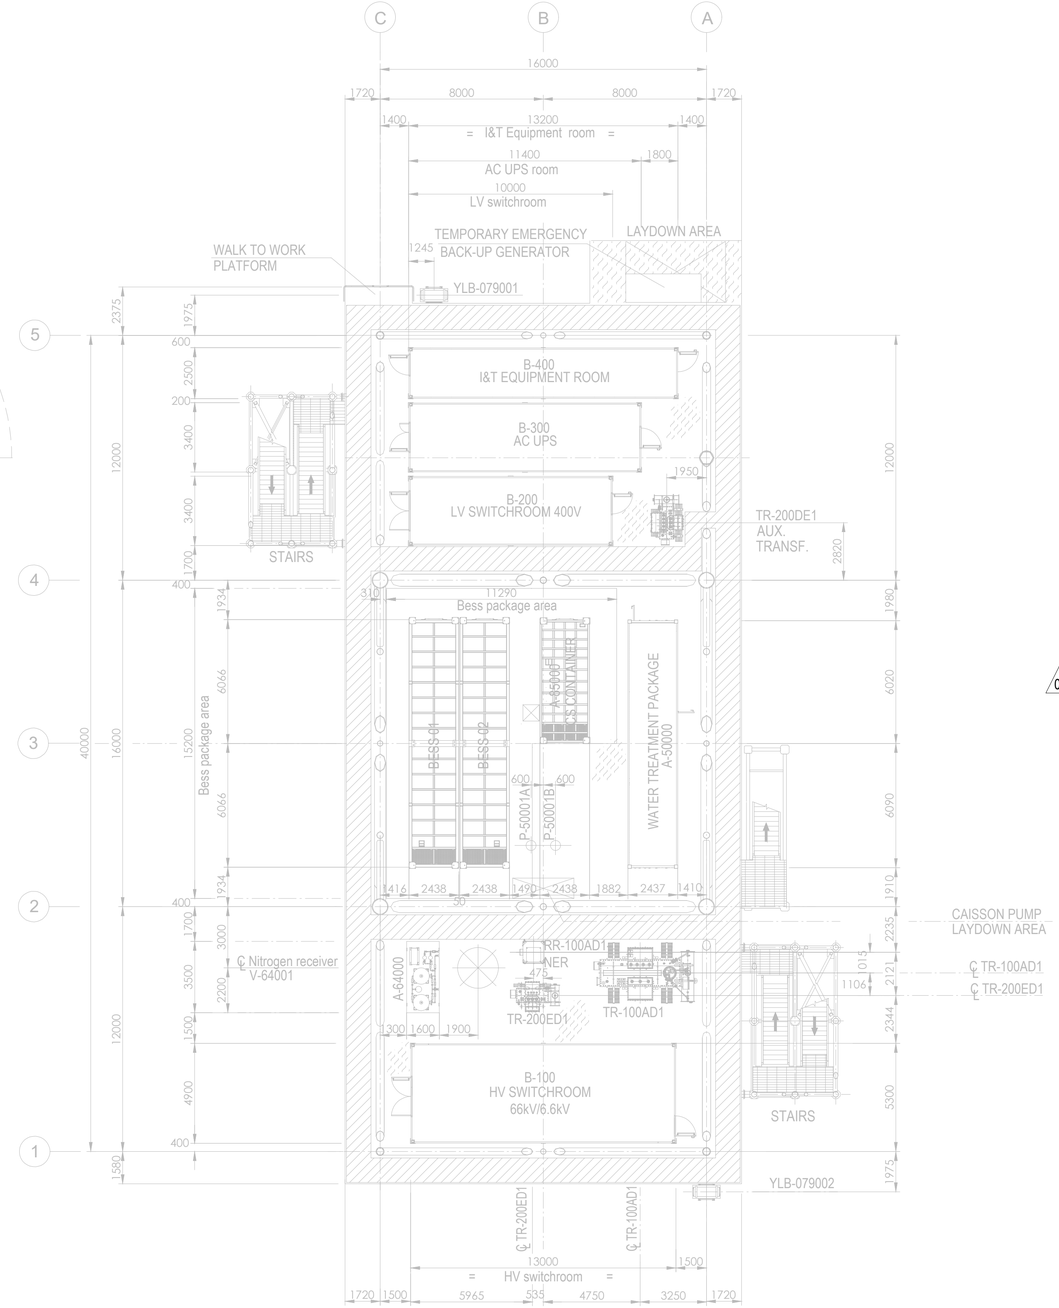

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

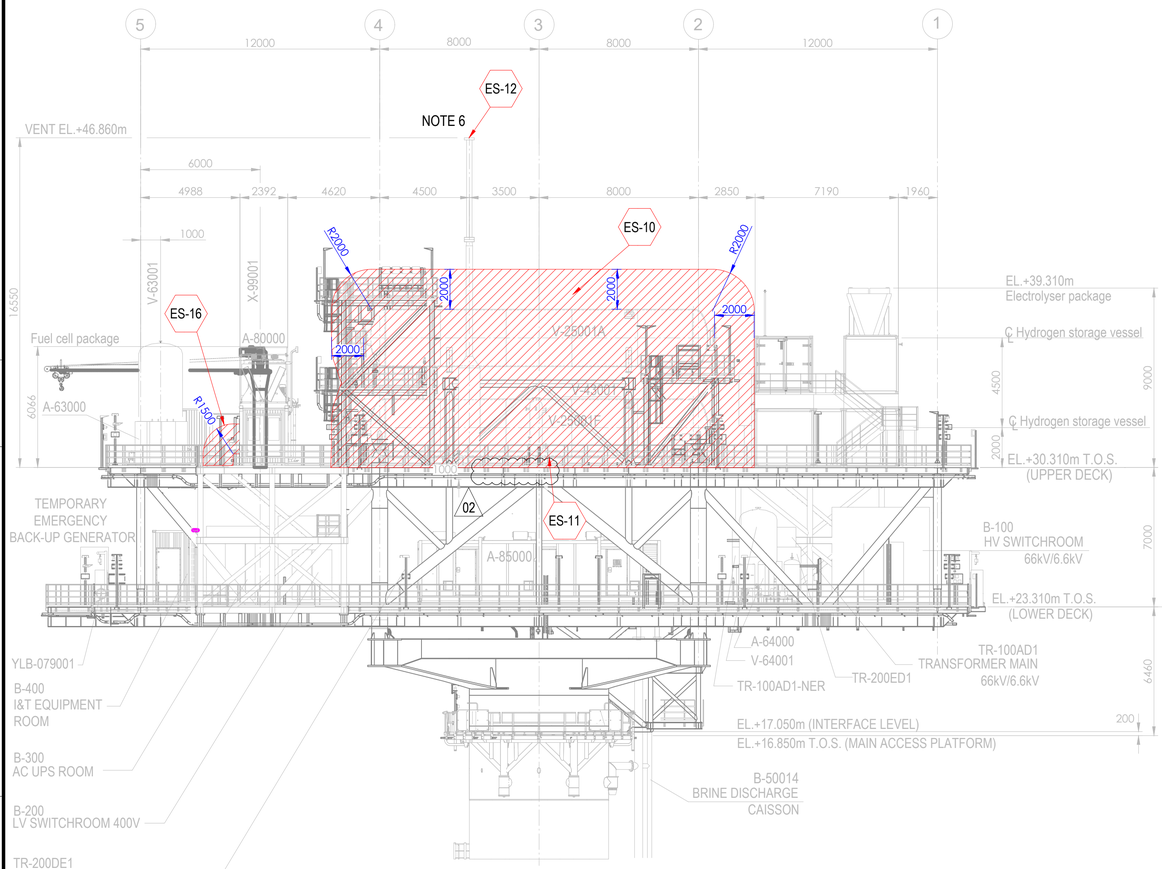



ELEVATION LOOKING EAST

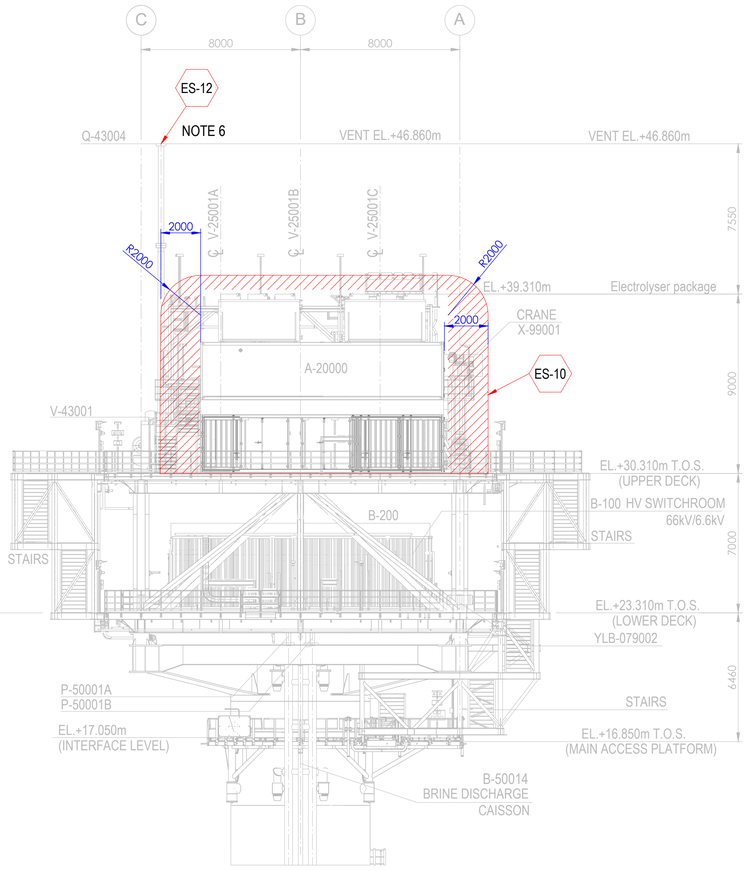

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

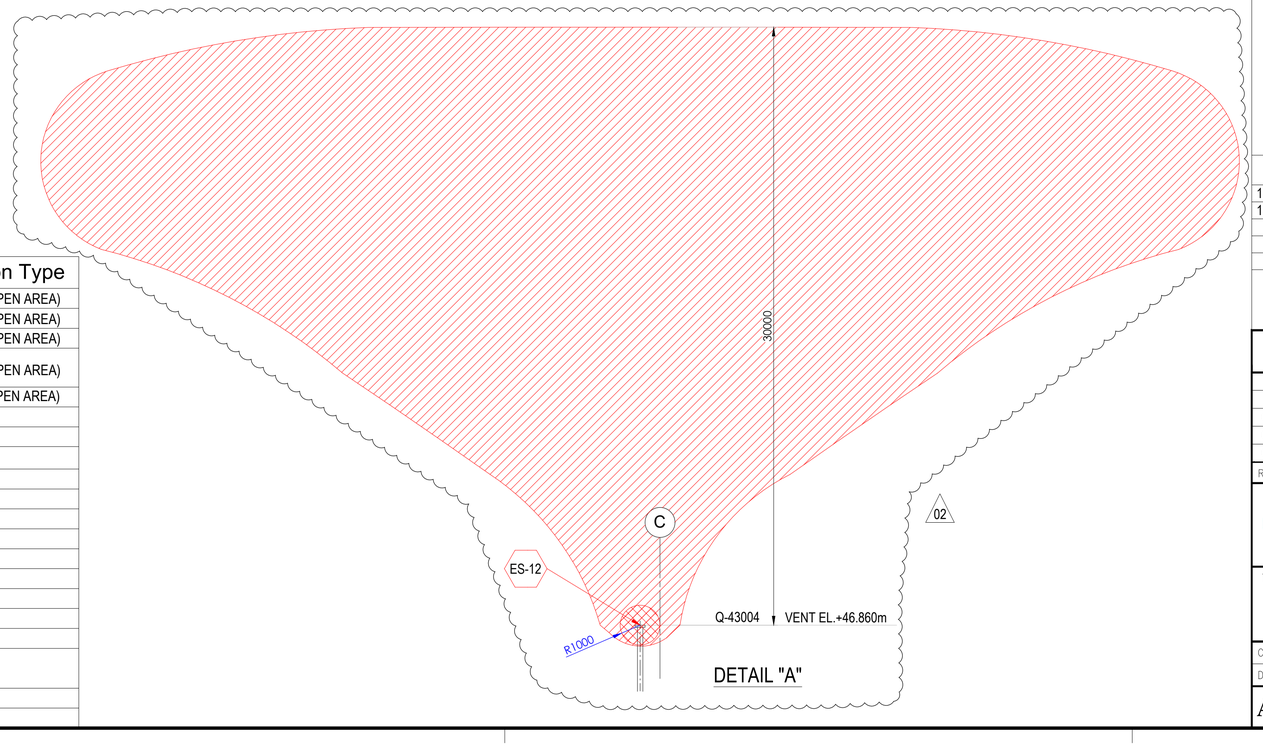



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PCV-001	: Air Set Filter - Hyrogen to Vessels Inlet Header Shut-Down	Dwg	123A90-DDL-PR-PID-80013		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001754	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		FL20524-1050			
Manufacturer	BIFOLD			**Model**		SH05-FR-SR-MD-10-X4			
Cert No.	D.o.C. by Manufacturer			**Equipment Ambient Temp.**		-20 °C to + 40 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		OK	
	Physical check	x	OK	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PCV-001	: Air Set Filter - Hyrogen to Vessels Inlet Header Shut-Down		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001754	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-PCV-001	: Air Set Filter - Hyrogen to Vessels Inlet Header Shut-Down		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001754	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-31	2025-01-31	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-31T09:34:36.825Z	PROVERLIS Digitaly signed by Luca Mussi 2025-01-31T12:38:40.465Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

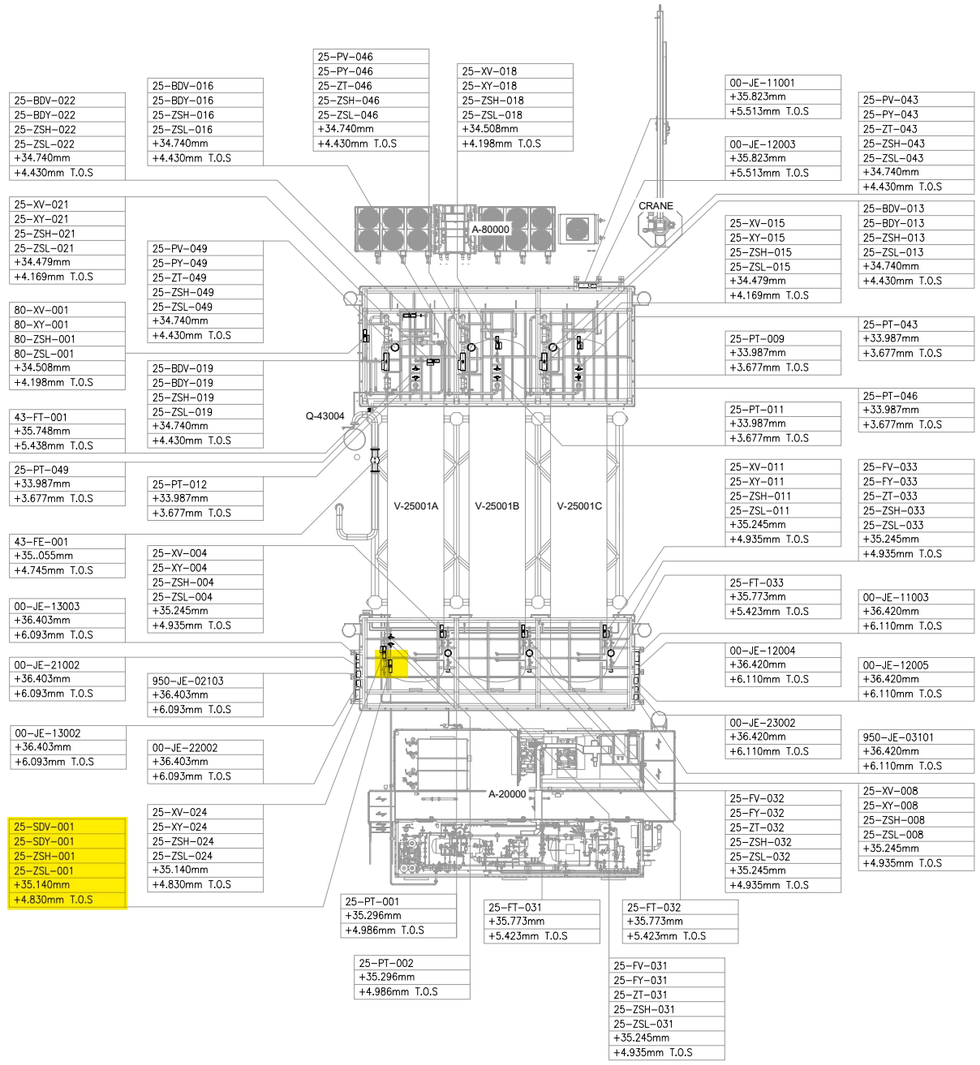

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm

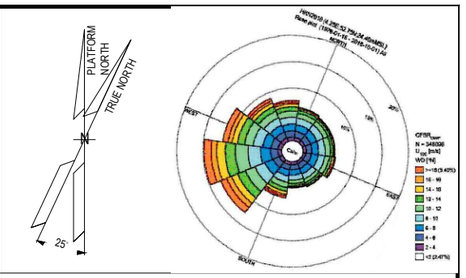

NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90–DDL–IN–DL–40081	002	02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 16 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR SDV/BDV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

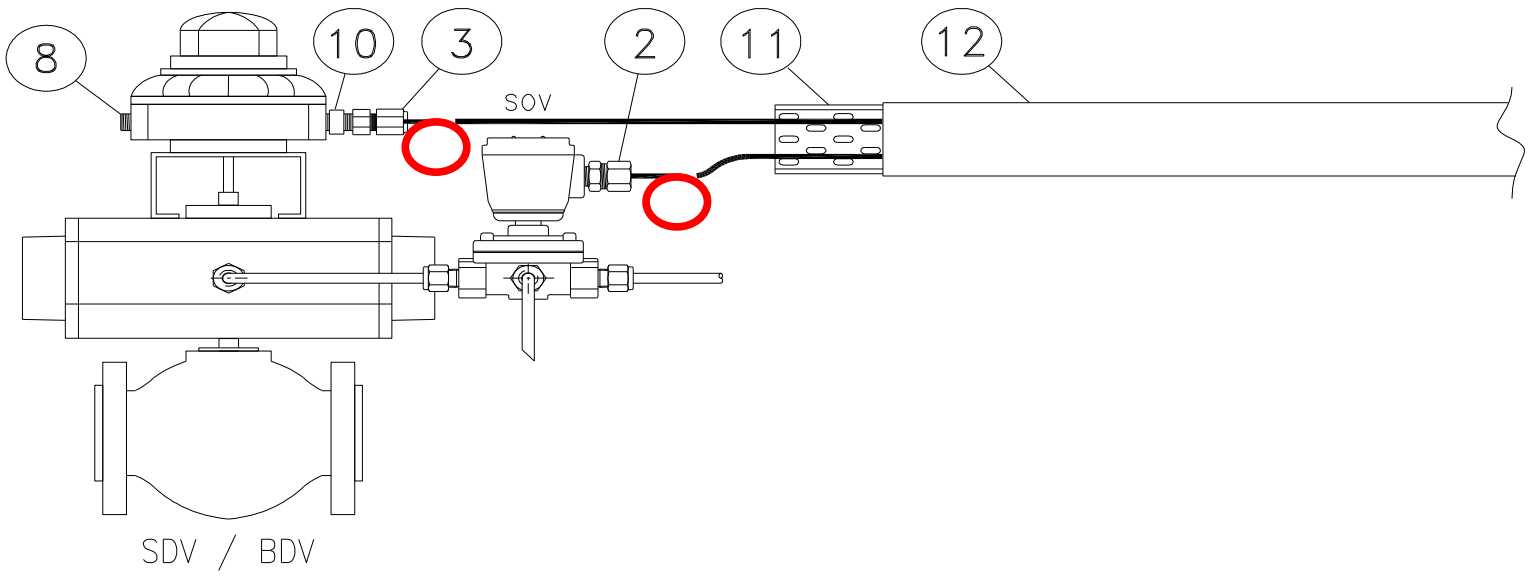

SDV / BDV

INSTRUMENT TAG	
1	25-BDV-005
2	25-BDV-007
3	25-BDV-010
4	25-BDV-013
5	25-BDV-016
6	25-BDV-019
7	25-BDV-022
8	25-SDV-001
9	25-SDV-023
10	64-SDV-001
11	
12	
13	
14	
15	
16	
17	
18	
19	
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
10		Nickel Plated Brass Adaptor Ex-d/e IIC (or IIB + H2) T1	M20 Male x M25 Female	1
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
3		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M25	1
2		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

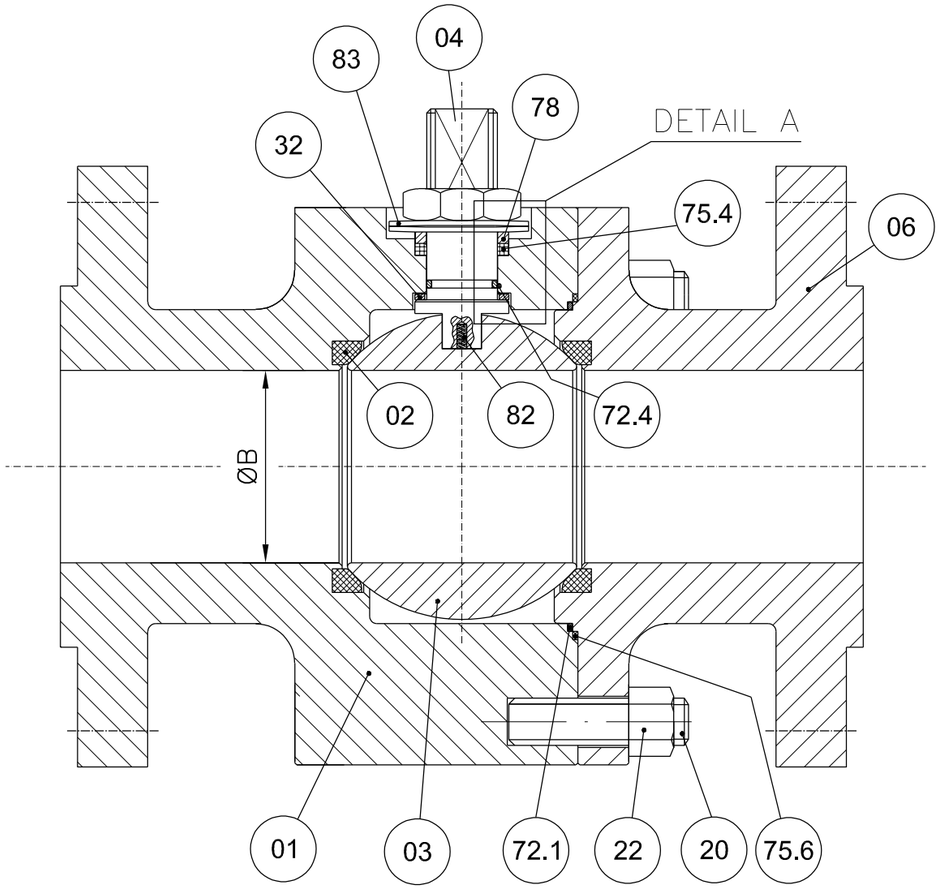




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

GENERAL	1	Tag Number	Location			25-SDV-001		25
	2	Service				HYDROGEN TO STORAGE TANKS		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80013		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-007-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close : (12)		Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum		Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/AA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-SDY-001 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-001 (9, 17) - Soldo SS		25-ZSH-001 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR	25-SDV-023	ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-PSV-055B	Safety Valve	LOWER DECK	1724000740	AST SpA	COITECH	24-03803	SLK	ATEX ZONE 2	Declaration of Conformity By COITECH SLKL-08HA74-015	Coitech EU - Type Examination Certificate	CE Ex - II 2 GD Ex h X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PT-001	Hyrogen to vessels inlet header	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240634	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-002	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240635	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-004	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240636	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PT-006	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240638	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-PT-008	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240640	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-PT-009	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240642	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-PT-011	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240644	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_2
25-PT-012	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240646	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-035	Vessel V-25001A pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240637	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PT-037	Vessel V-25001B pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240639	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-PT-040	Vessel V-25001C pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240641	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-PT-043	Vessel V-25001D pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240643	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-PT-046	Vessel V-25001E pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240645	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_2
25-PT-049	Vessel V-25001F pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240647	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240648	SST76-H-7-K-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PT-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240649	SST76-H-7-K-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PV-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400589	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PV-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400590	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-PV-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400591	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-PV-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400592	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-PV-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400593	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-PV-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400594	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-PV-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400595	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PV-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400596	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PY-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400589	CV-8407	II 2G	ATEX - SN 2400589	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PY-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400590	CV-8407	II 2G	ATEX - SN 2400590	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-PY-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400591	CV-8407	II 2G	ATEX - SN 2400591	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-PY-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400592	CV-8407	II 2G	ATEX - SN 2400592	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-PY-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400593	CV-8407	II 2G	ATEX - SN 2400593	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-PY-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400594	CV-8407	II 2G	ATEX - SN 2400594	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-PY-055A	Hydrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400595	CV-8407	II 2G	ATEX - SN 2400595	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PY-055B	Hydrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400596	CV-8407	II 2G	ATEX - SN 2400596	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SDV-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SDV-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SDY-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SDY-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-SV-031	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-SV-032	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-033	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-SV-034	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-SV-035	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-SV-036	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-037	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2

Document Reference: - D of C Baseefa14ATEX0223DR_01

EU Declaration of Conformity

Manufacturer: Bifold Fluidpower Ltd
Address: Broadgate, Oldham Broadway Business Park,
Chadderton, Oldham
Greater Manchester
OL9 9XA
UK

Tel: +44 (0)161-345-4777
E-mail: sales@bifold.co.uk

Product Type (Object of the Declaration):

Type SH, ASH & SC Filter Regulator

Declaration statement:

On behalf of the above company, I declare that, the *Object of the Declaration* described above is in conformity with the relevant Union harmonisation legislation: Directive 2014/34/EU, with the following limitation;

Limitation on the validity of the Declaration of Conformity:

None

Provisions of the Directive fulfilled by the Equipment:

Group II Category 2 Gb Db Ex c IIC T6

Bifold Technical File Reference:

DF-FP_SH_20140627114952

Technical File lodged with Notified Body:

SGS Fimko Oy 0598 Helsinki, Finland

SGS Baseefa Technical File Reference:

Baseefa14ATEX0223DR

Technical basis for compliance with the Essential Health and Safety Requirements of Directive 2014/34/EU: -

BS EN 13463-1: 2009 – Non-electrical equipment for use in potentially explosive atmospheres. Basic method and requirements
BS EN 13463-5: 2011 – Non-electrical equipment for use in potentially explosive atmospheres. Protection by constructional safety 'c'

(A review against the following harmonised standards, shows no significant changes relevant to this equipment): -


BS EN ISO 80079-36: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Basic method and requirements
BS EN ISO 80079-37: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Non-electrical type of protection constructional safety "c", control of ignition sources "b", liquid immersion "k"

Paul Barrow
Quality Manager

4th November 2020

DRAWING_NO.

REV.

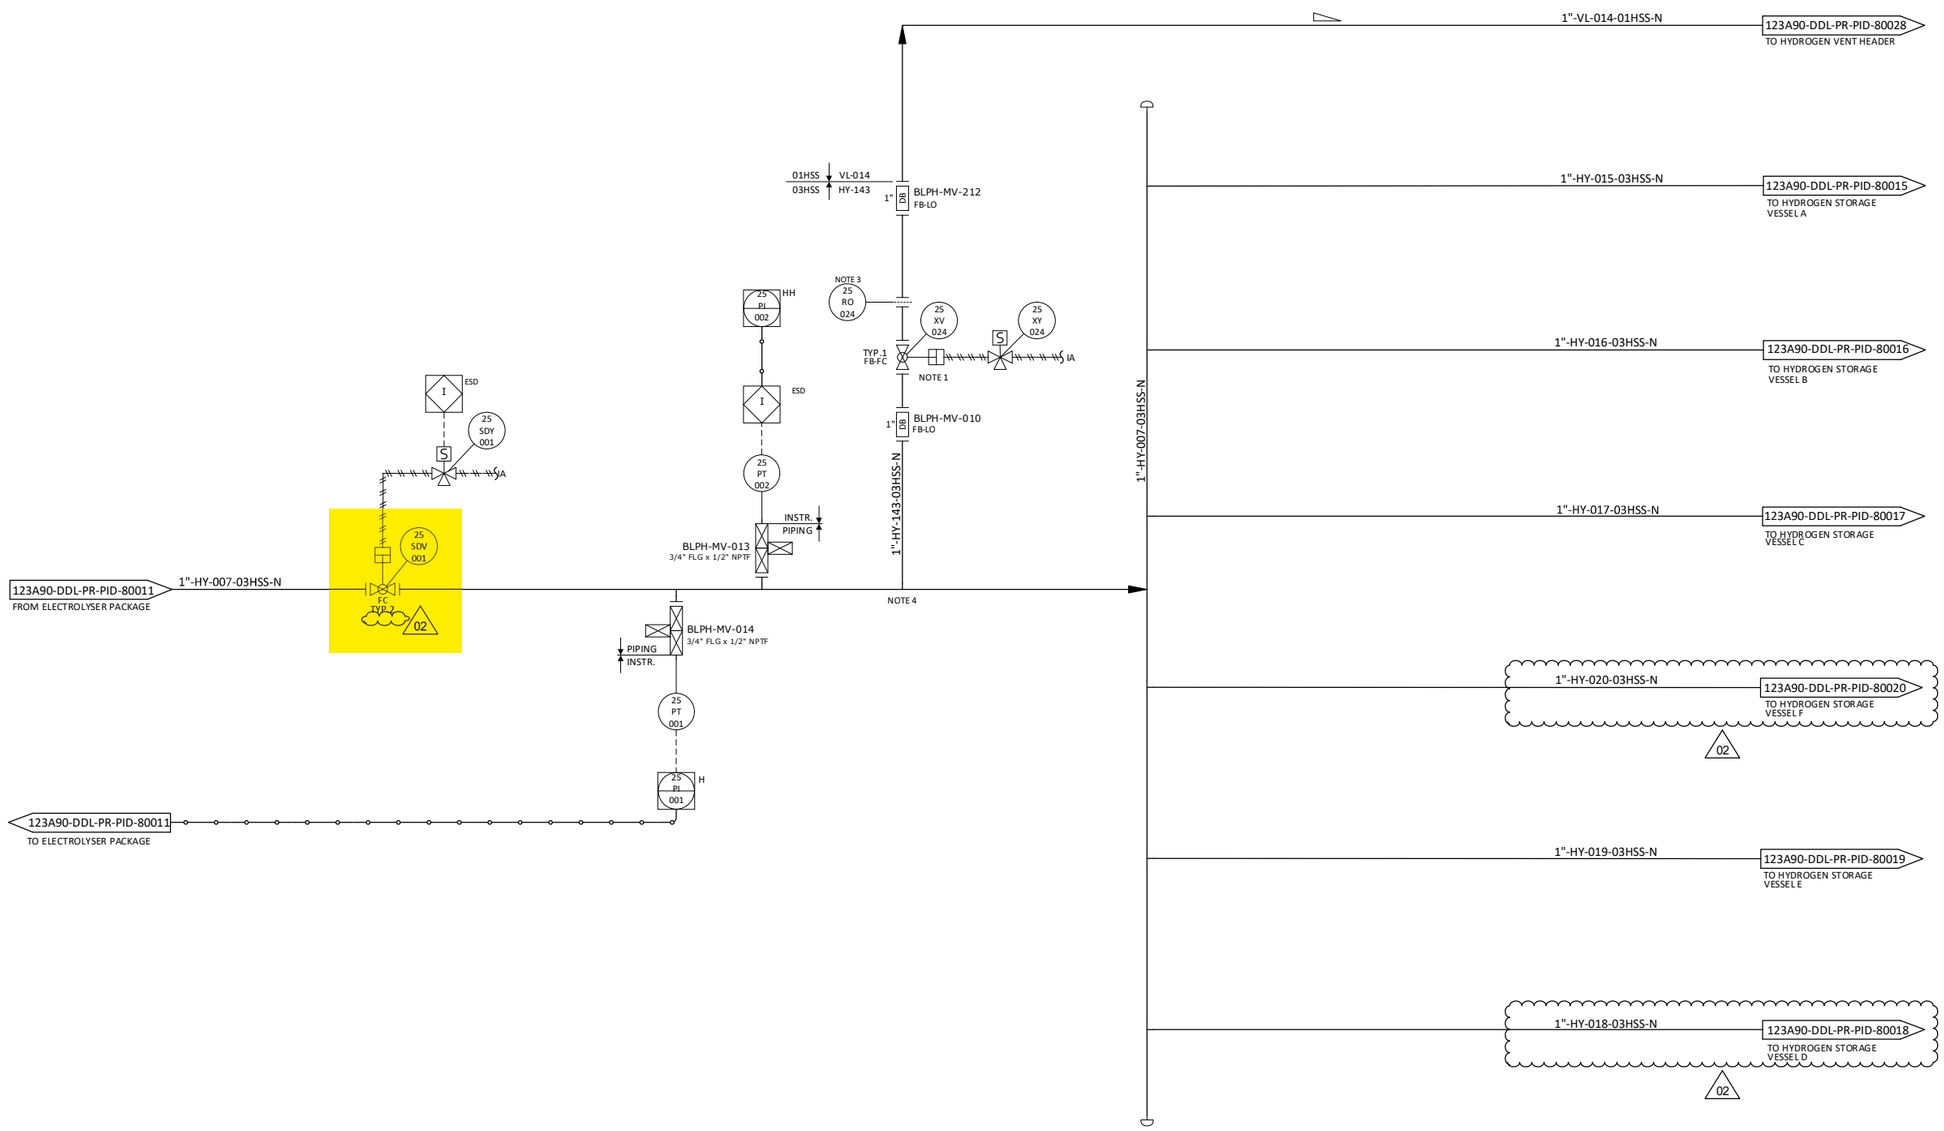

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSELS HEADER (INLET)


CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO.	SHEET	REV.
	123A90-DDL-PR-PID-80013	001	02


File Name : FILE_NAME

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

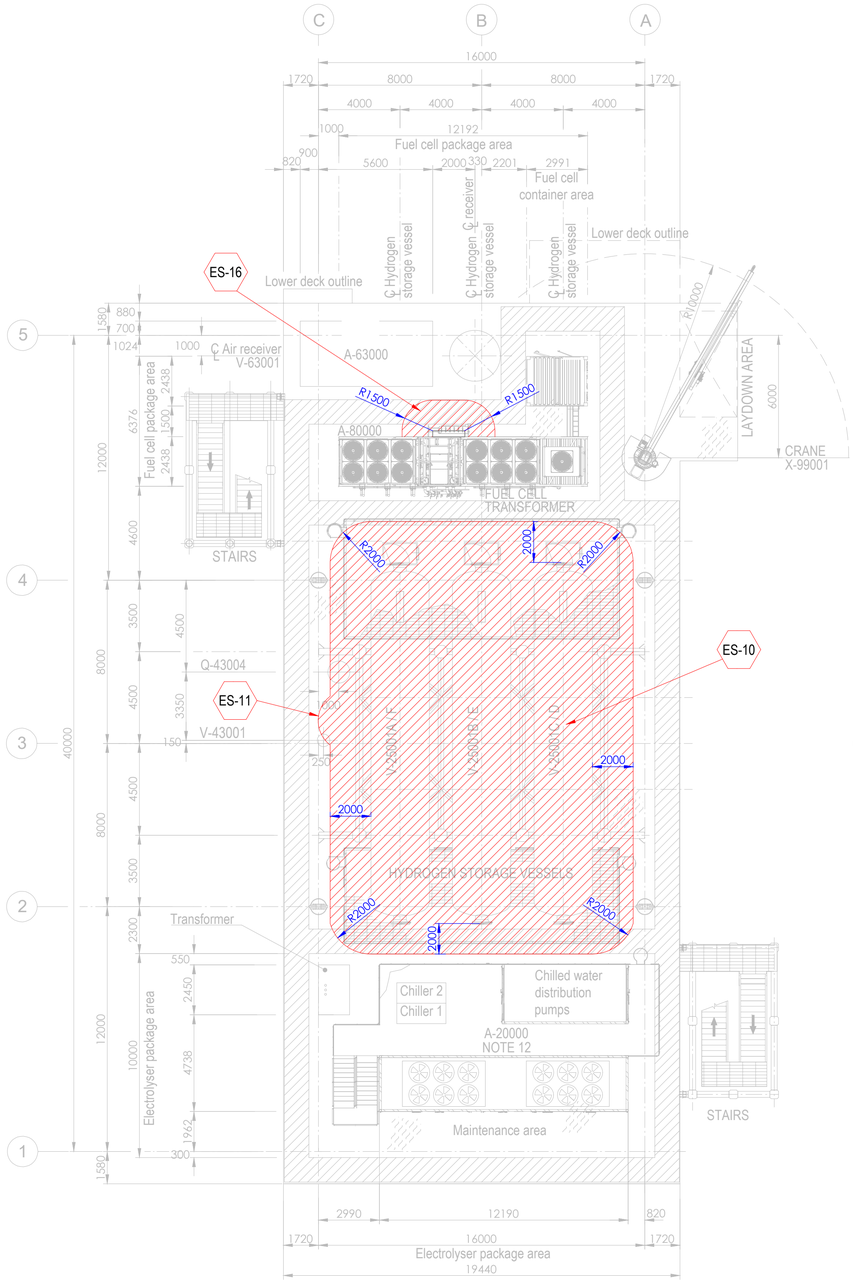


PLAN ON UPPER DECK
EL+30.310 T.O.S.

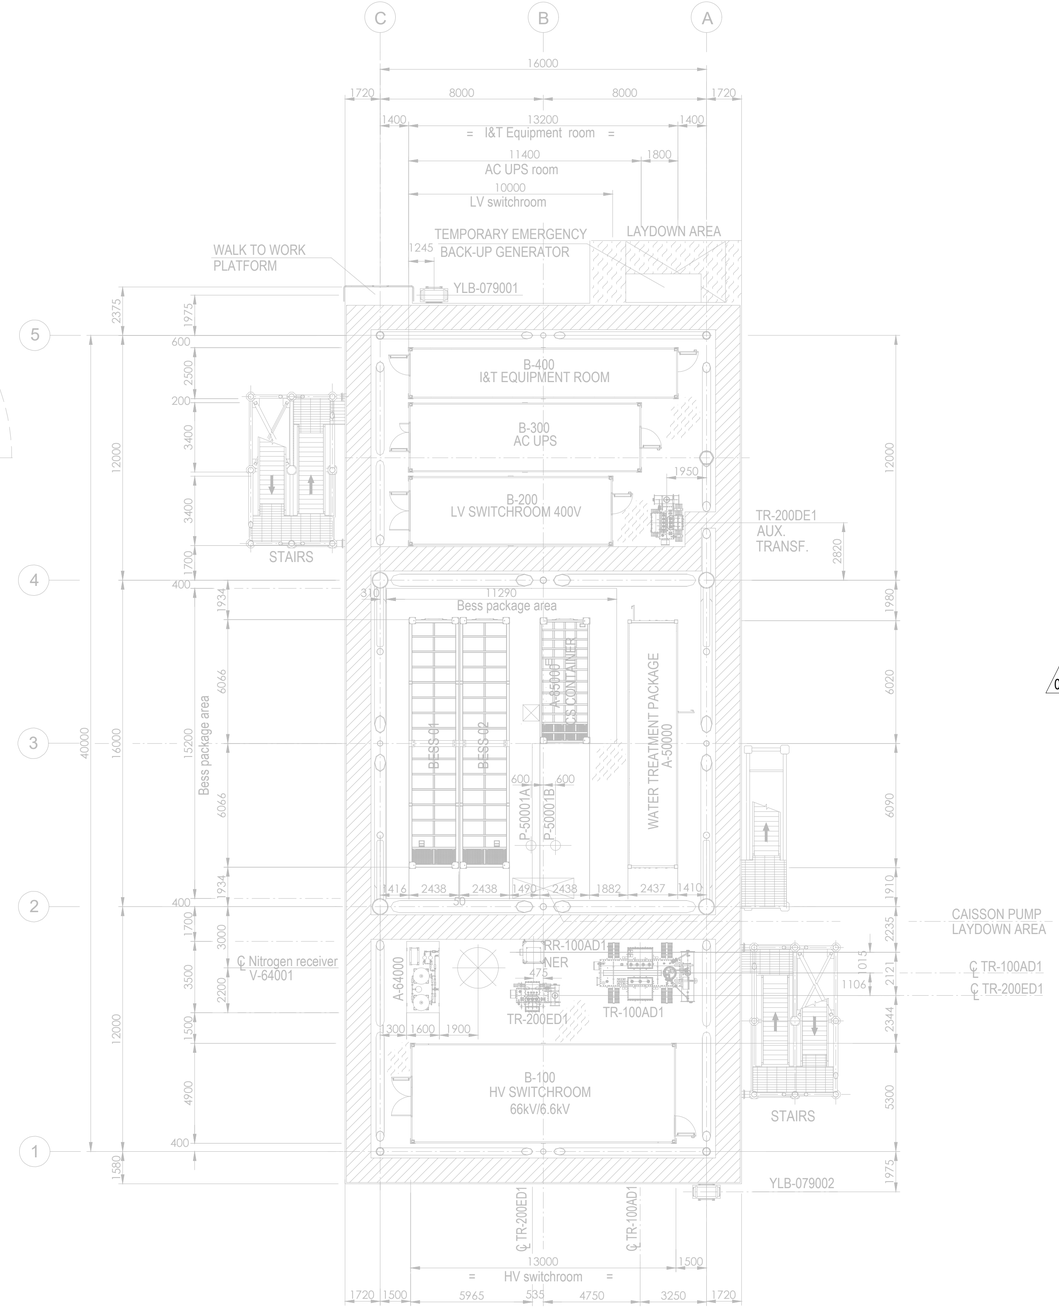

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

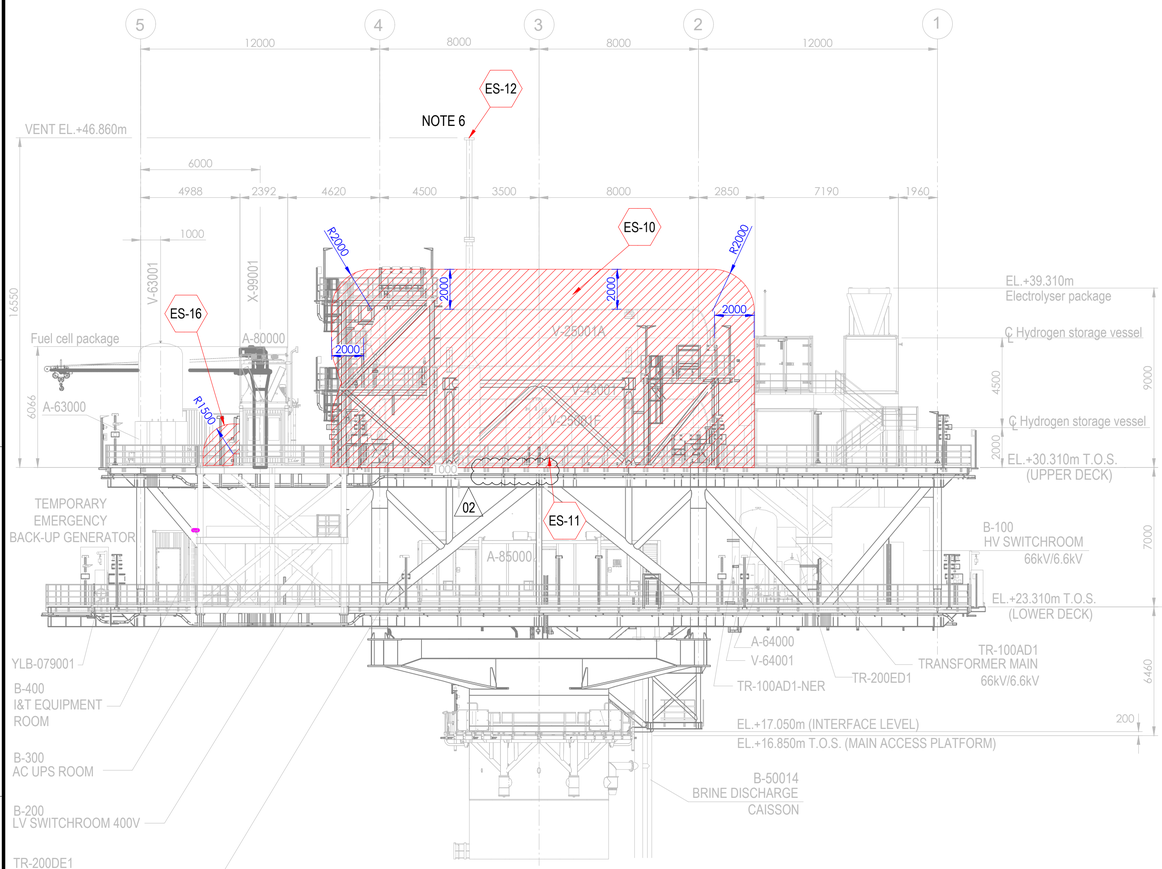



ELEVATION LOOKING EAST

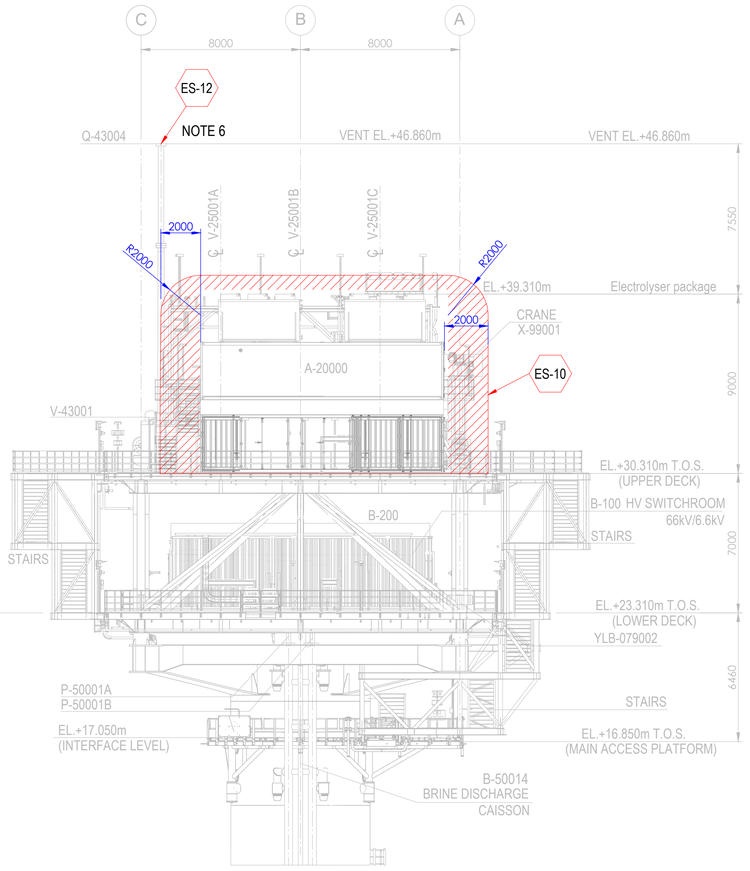

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

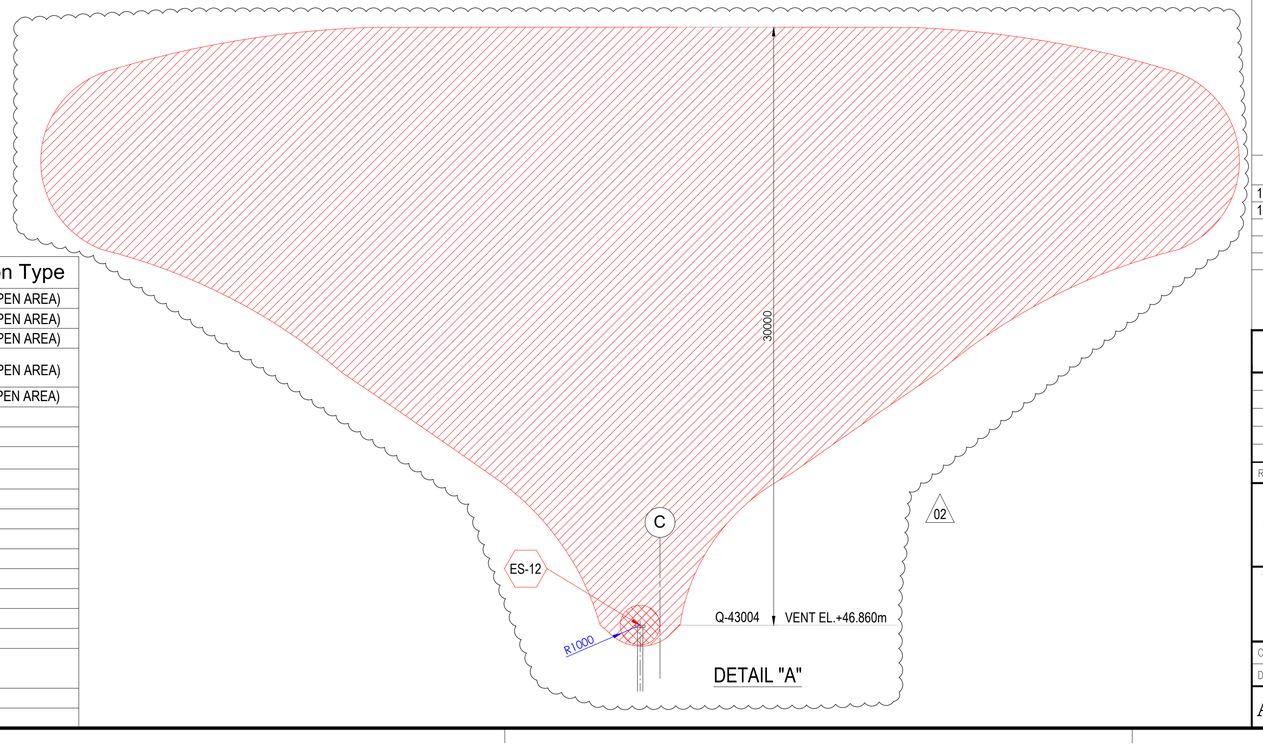



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PCV-004	: Air Set Filter - Vessel V-25001A Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80015
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001755	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**	FL40524-043				
Manufacturer	BIFOLD			**Model**	SH05-FR-SR-MD-10-X4				
Cert No.	D.o.C. by Manufacturer			**Equipment Ambient Temp.**	-20 °C to + 40 °C				
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		OK	
	Physical check	x	OK	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PCV-004	: Air Set Filter - Vessel V-25001A Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80015
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001755		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-PCV-004	: Air Set Filter - Vessel V-25001A Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80015
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001755		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01
							Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-29	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:38:35.134Z	PROVERLIS Digitaly signed by Luca Mussi 2025-01-30T16:09:59.843Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

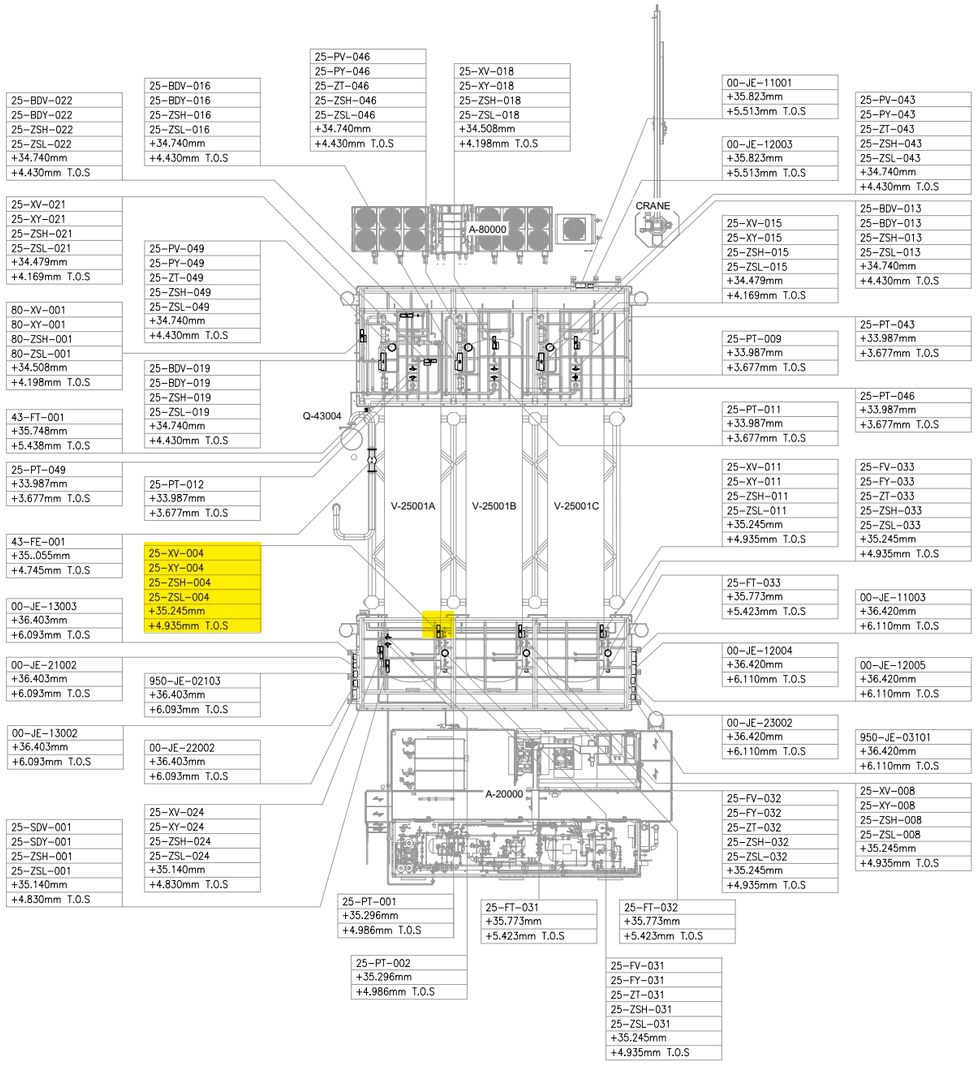

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 A

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg /AMB

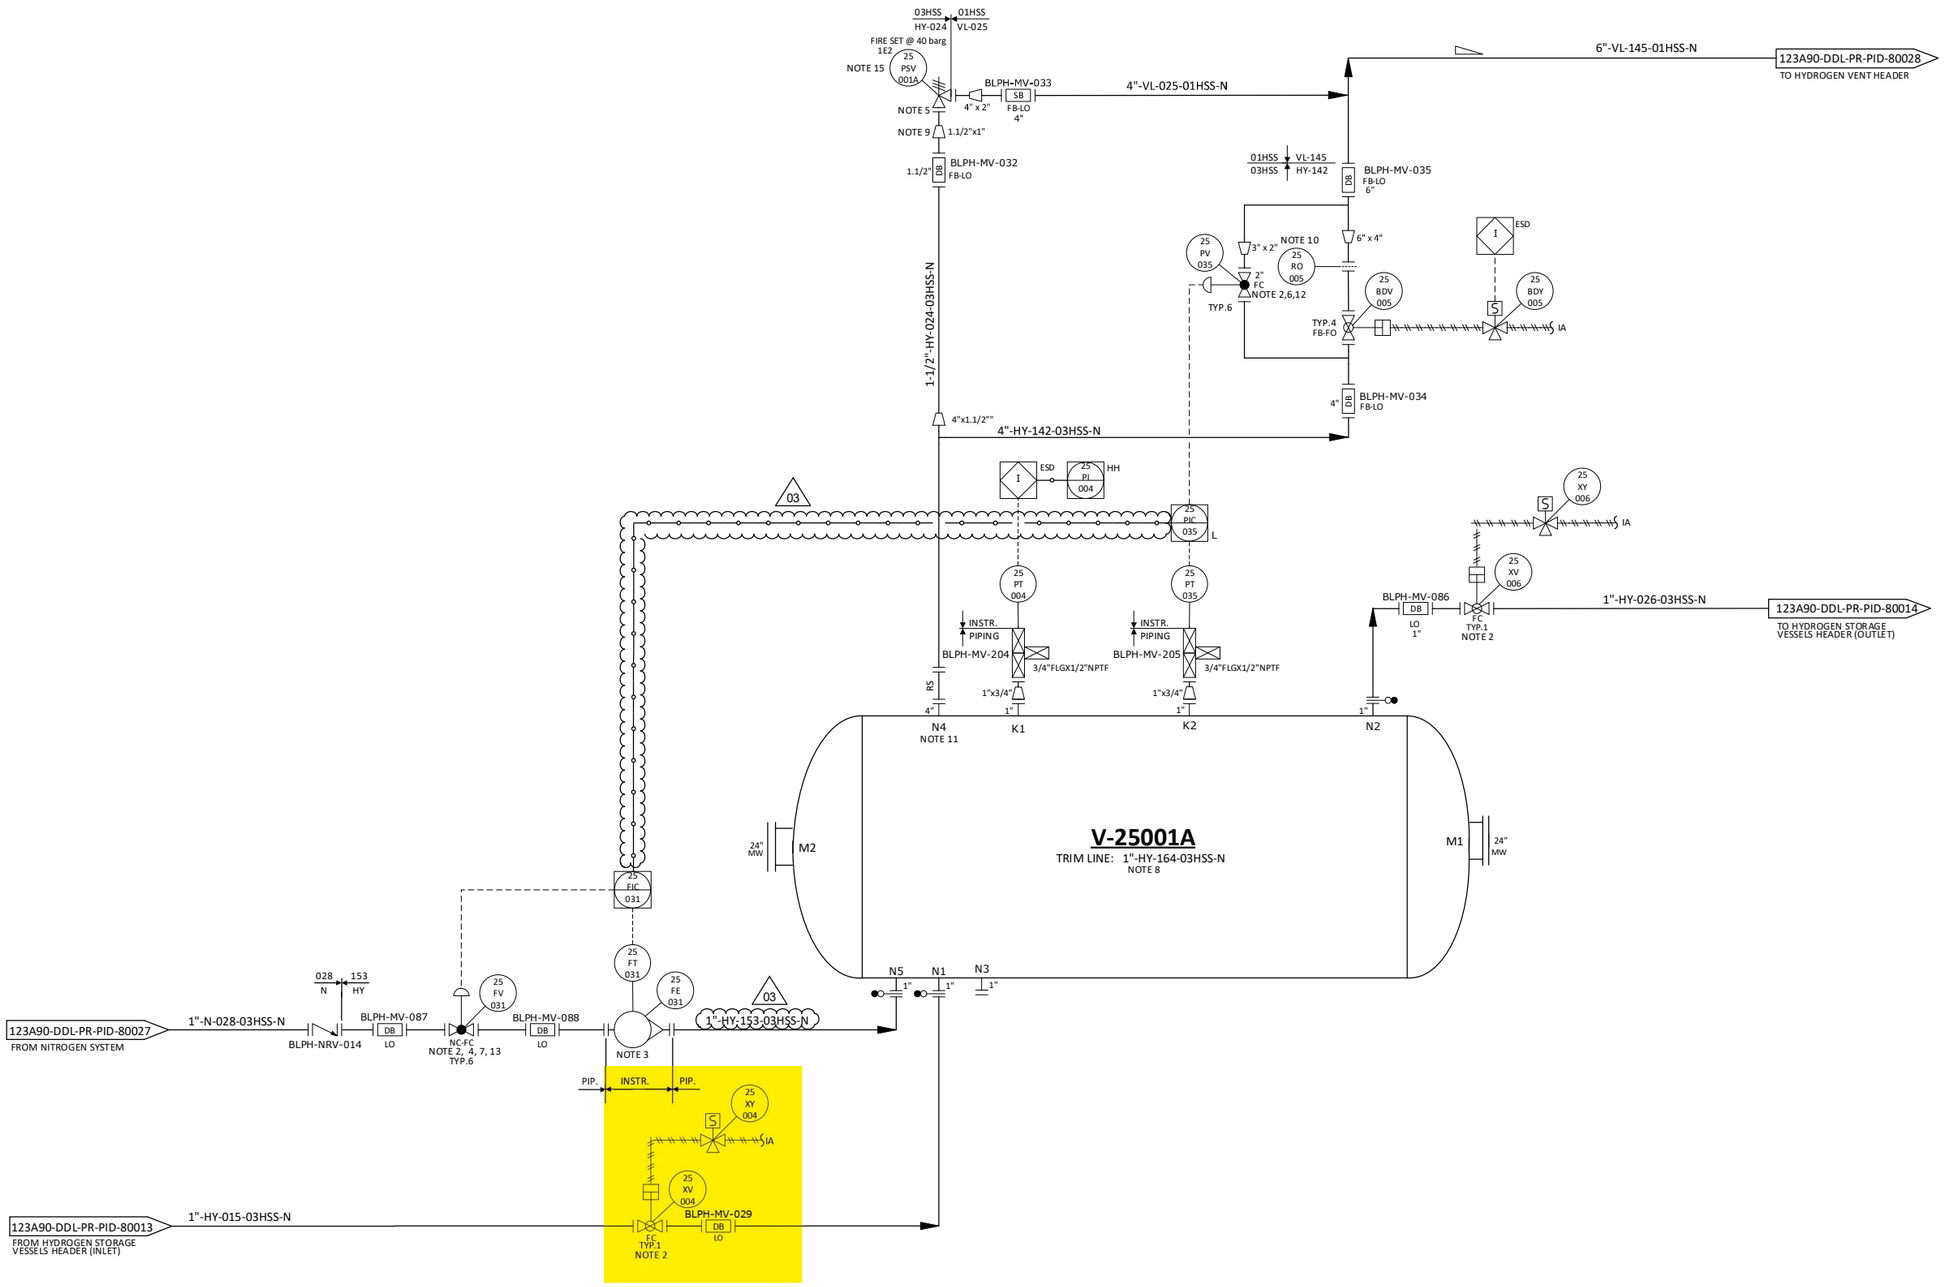

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-031) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-035 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-035 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-031 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-035 HAS FAILED TO CLOSE.
15. 25-PSV-001A SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL A

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80015		SHEET 001	REV. 03

File Name : FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

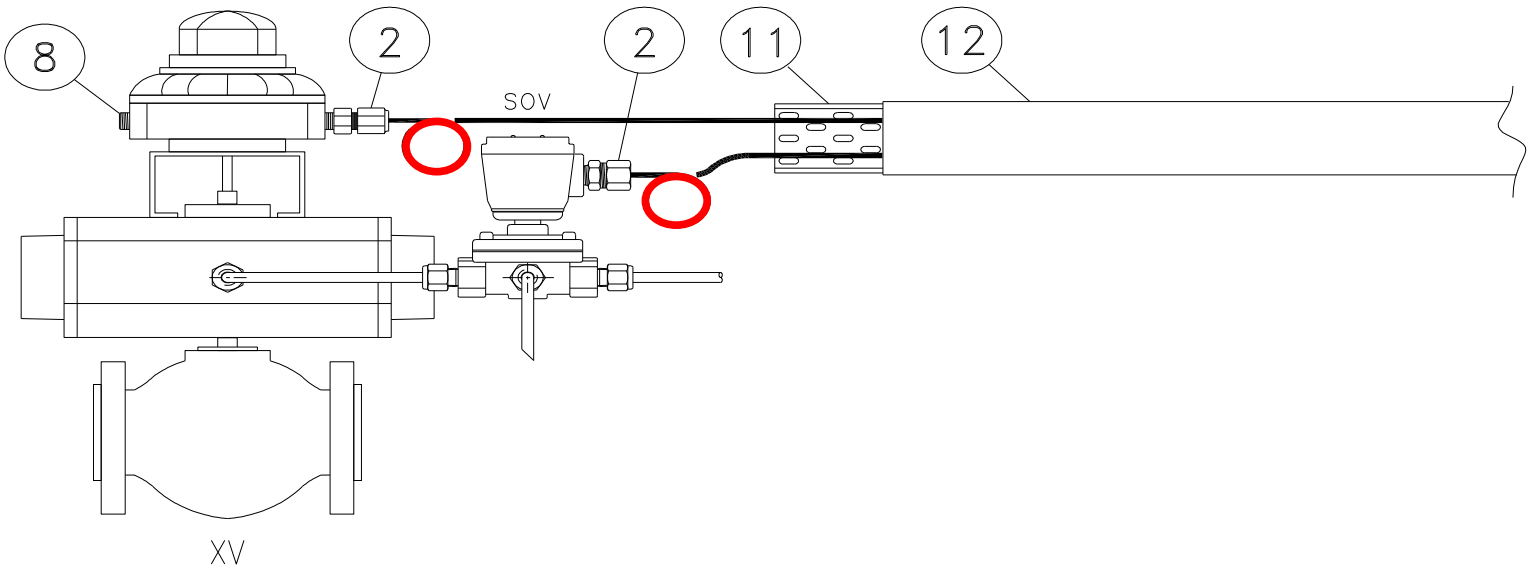

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

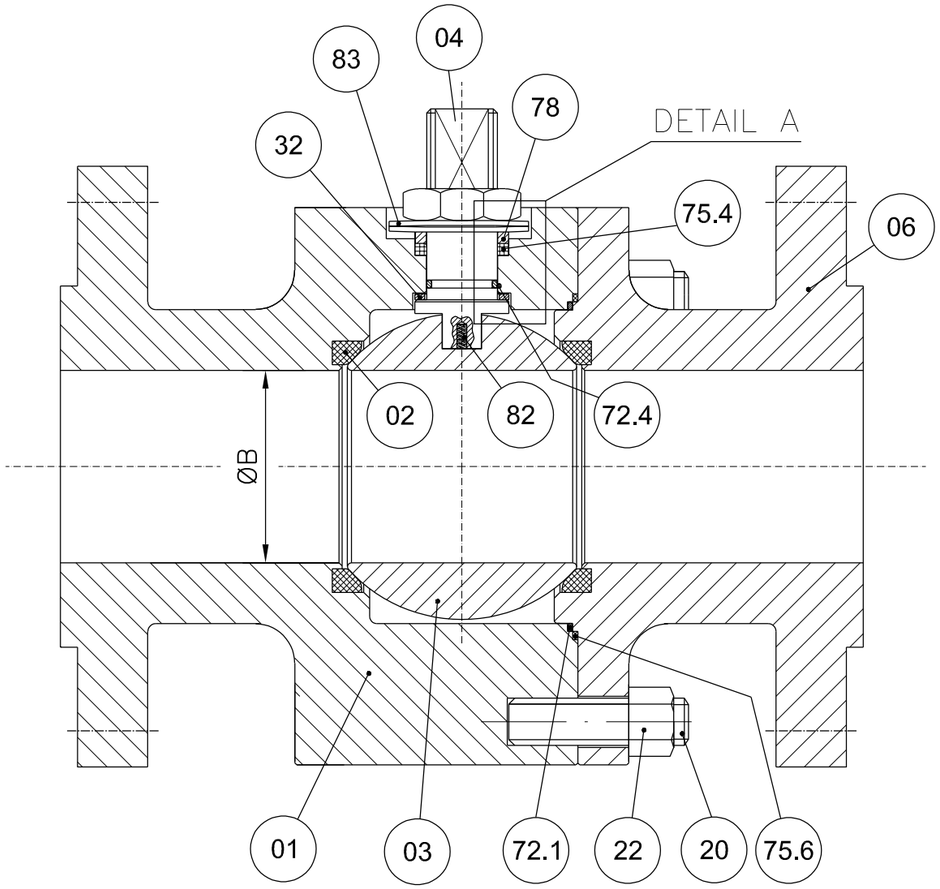

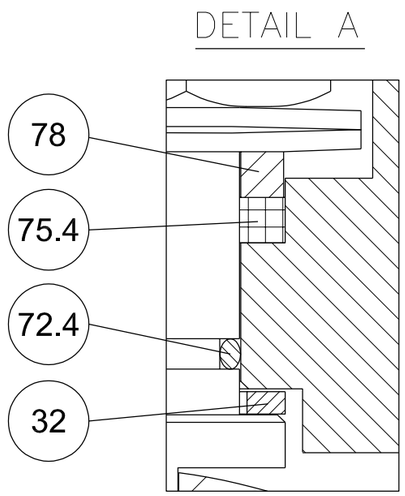


POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-004		25
	2	Service				HYDROGEN STORAGE TANK V-25001A INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80015		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-015-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close : (12)		Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum		Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-004 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-004 (9, 17) - Soldo SS		25-ZSH-004 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR	25-SDV-023	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

Document Reference: - D of C Baseefa14ATEX0223DR_01

EU Declaration of Conformity

Manufacturer: Bifold Fluidpower Ltd
Address: Broadgate, Oldham Broadway Business Park,
Chadderton, Oldham
Greater Manchester
OL9 9XA
UK

Tel: +44 (0)161-345-4777
E-mail: sales@bifold.co.uk

Product Type (Object of the Declaration):

Type SH, ASH & SC Filter Regulator

Declaration statement:

On behalf of the above company, I declare that, the *Object of the Declaration* described above is in conformity with the relevant Union harmonisation legislation: Directive 2014/34/EU, with the following limitation;

Limitation on the validity of the Declaration of Conformity:

None

Provisions of the Directive fulfilled by the Equipment:

Group II Category 2 Gb Db Ex c IIC T6

Bifold Technical File Reference:

DF-FP_SH_20140627114952

Technical File lodged with Notified Body:

SGS Fimko Oy 0598 Helsinki, Finland

SGS Baseefa Technical File Reference:

Baseefa14ATEX0223DR

Technical basis for compliance with the Essential Health and Safety Requirements of Directive 2014/34/EU: -

BS EN 13463-1: 2009 – Non-electrical equipment for use in potentially explosive atmospheres. Basic method and requirements
BS EN 13463-5: 2011 – Non-electrical equipment for use in potentially explosive atmospheres. Protection by constructional safety 'c'

(A review against the following harmonised standards, shows no significant changes relevant to this equipment): -


BS EN ISO 80079-36: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Basic method and requirements
BS EN ISO 80079-37: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Non-electrical type of protection constructional safety "c", control of ignition sources "b", liquid immersion "k"

Paul Barrow
Quality Manager


4th November 2020

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

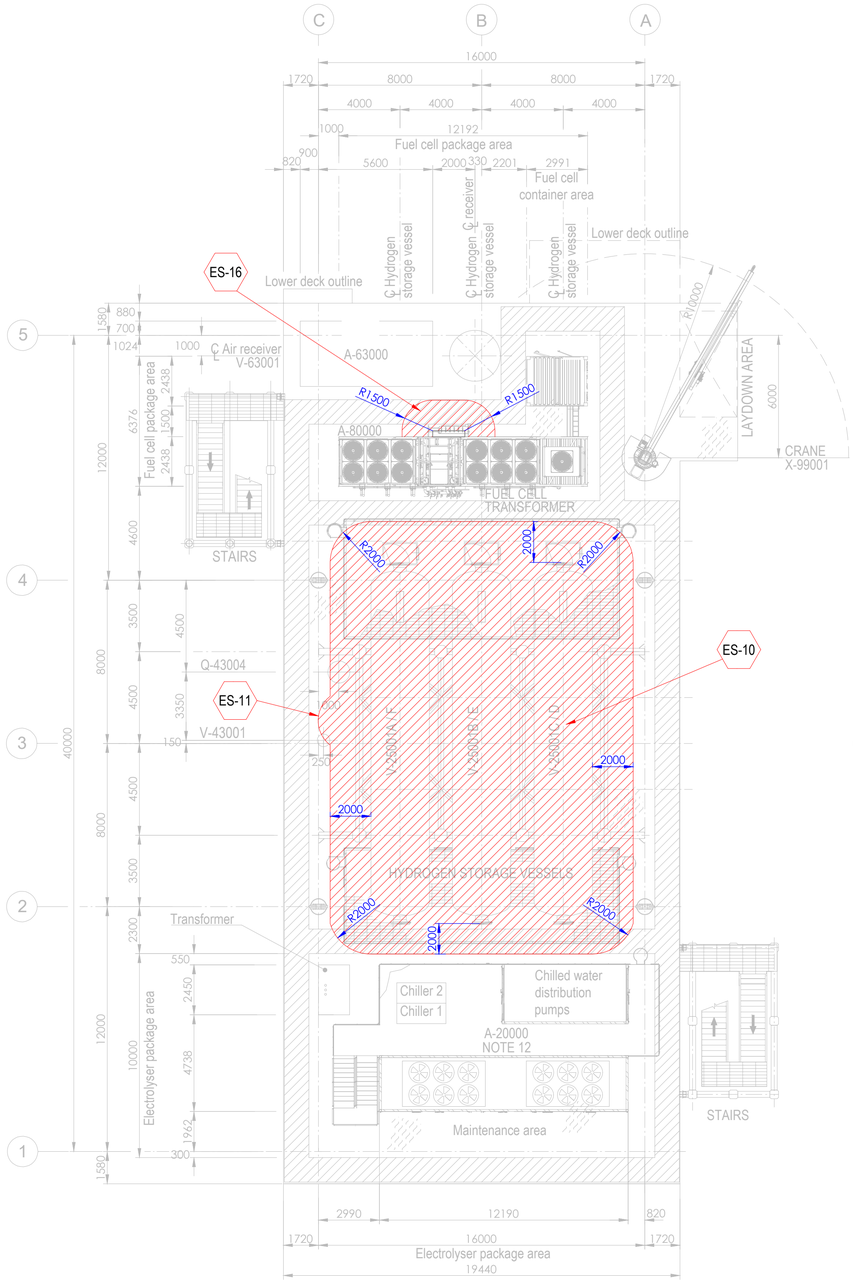


PLAN ON UPPER DECK
EL+30.310 T.O.S.

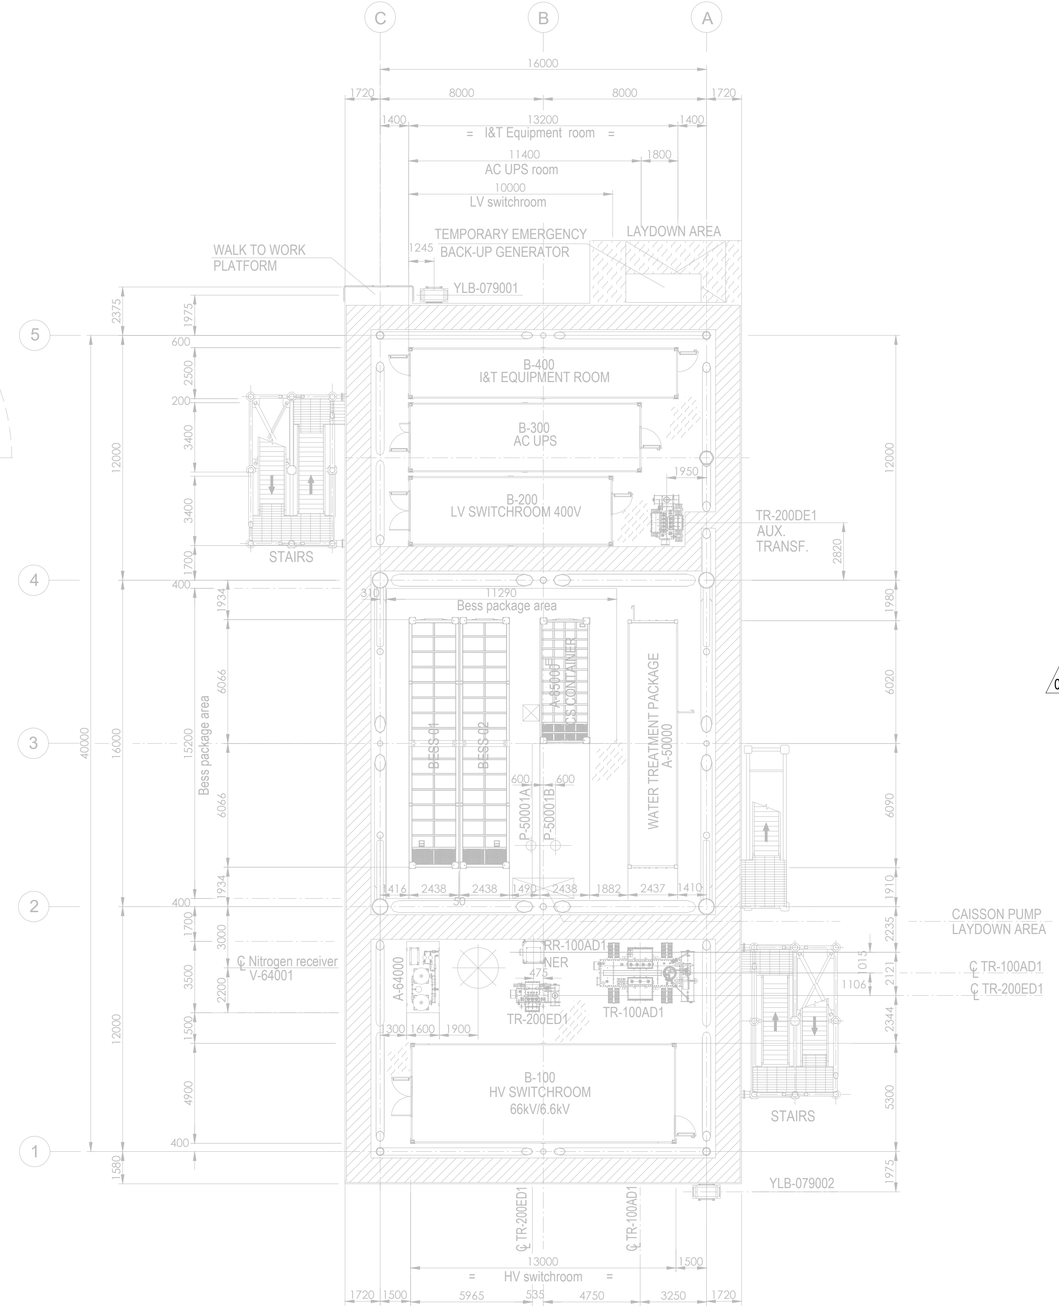

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

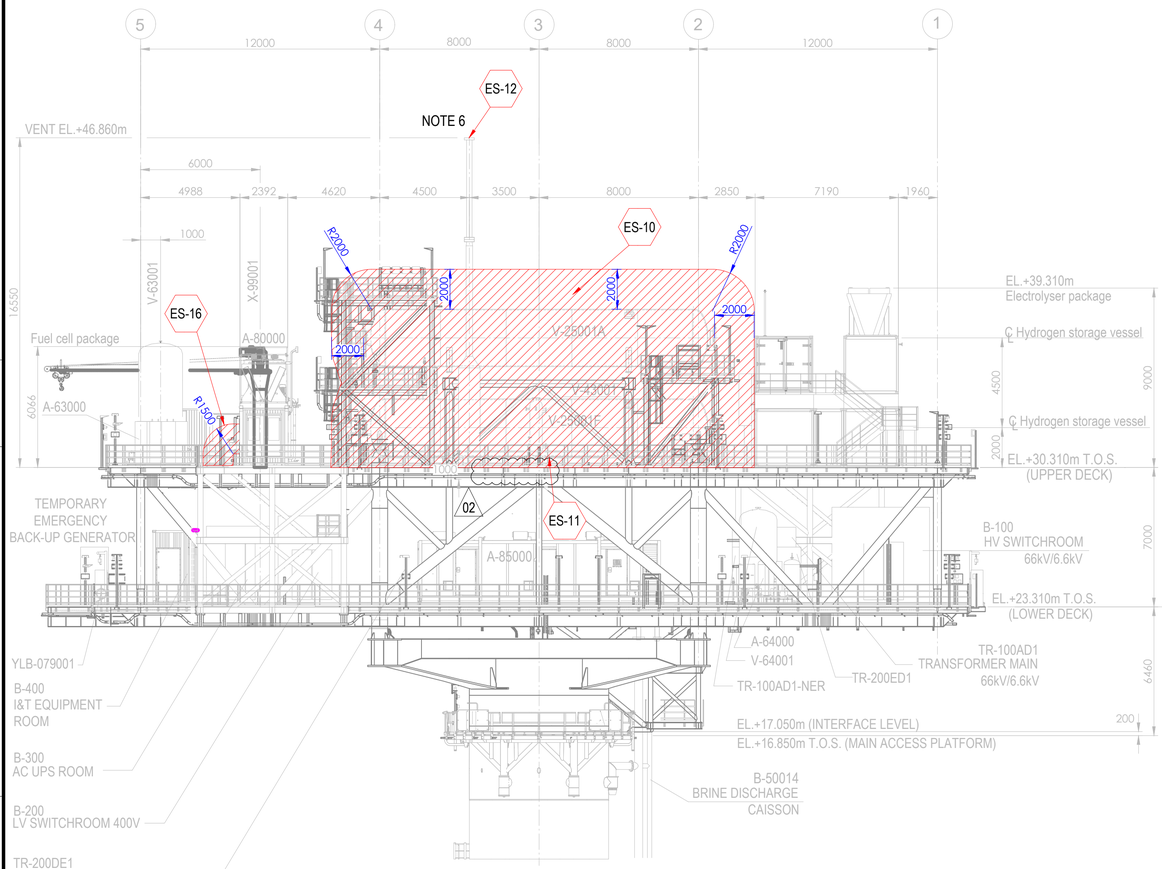



ELEVATION LOOKING EAST

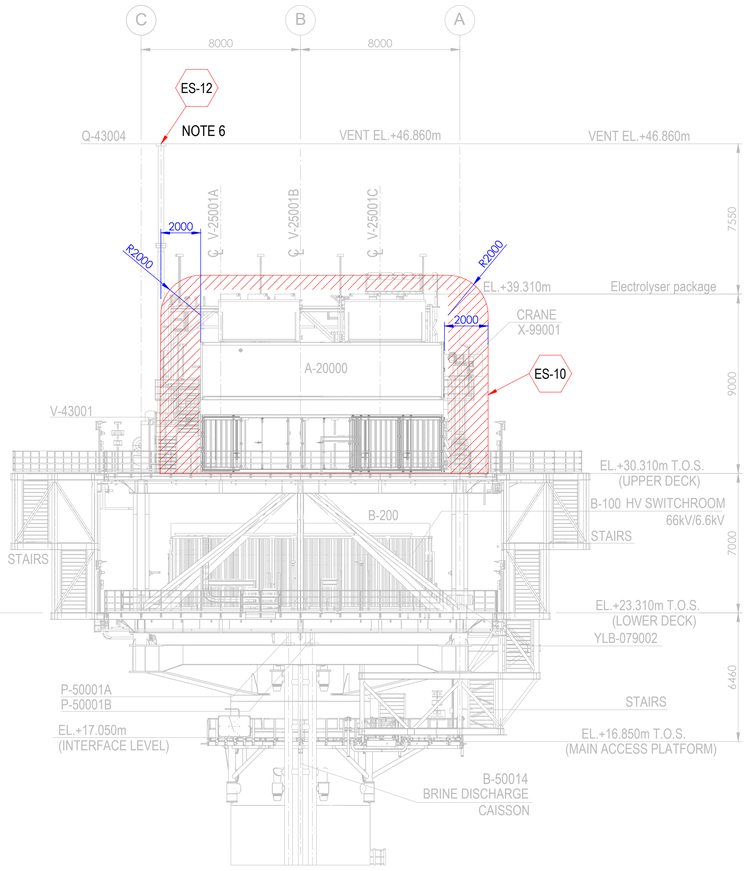

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

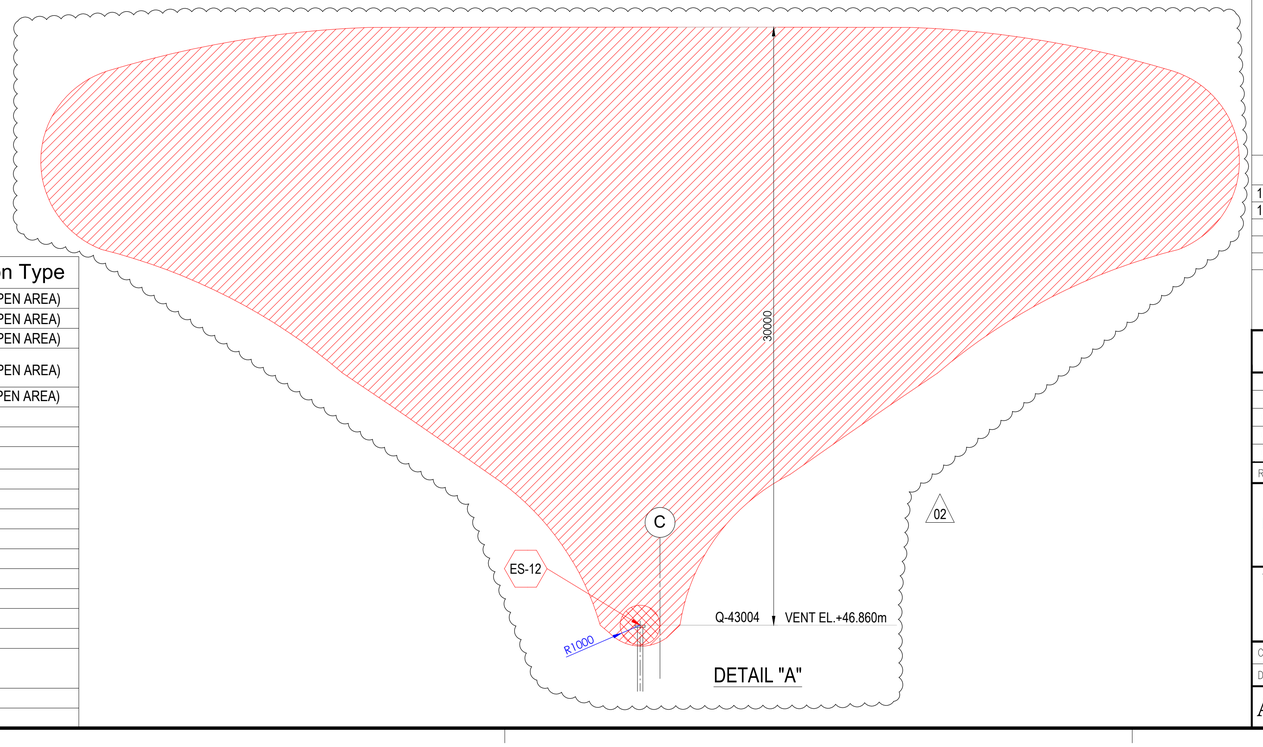



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PCV-008	: Air Set Filter - Vessel V-25001B Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001757	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		FL28524-1849			
Manufacturer	BIFOLD			**Model**		SH05-FR-SR-MD-10-X4			
Cert No.	D.o.C. by Manufacturer			**Equipment Ambient Temp.**		-20°C +40°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex H	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		OK	
	Physical check	x	OK	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PCV-008	: Air Set Filter - Vessel V-25001B Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001757		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-PCV-008	: Air Set Filter - Vessel V-25001B Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001757		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01
							Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-29	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:38:57.687Z	PROVERLIS Digitaly signed by Luca Mussi 2025-01-30T16:12:33.173Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

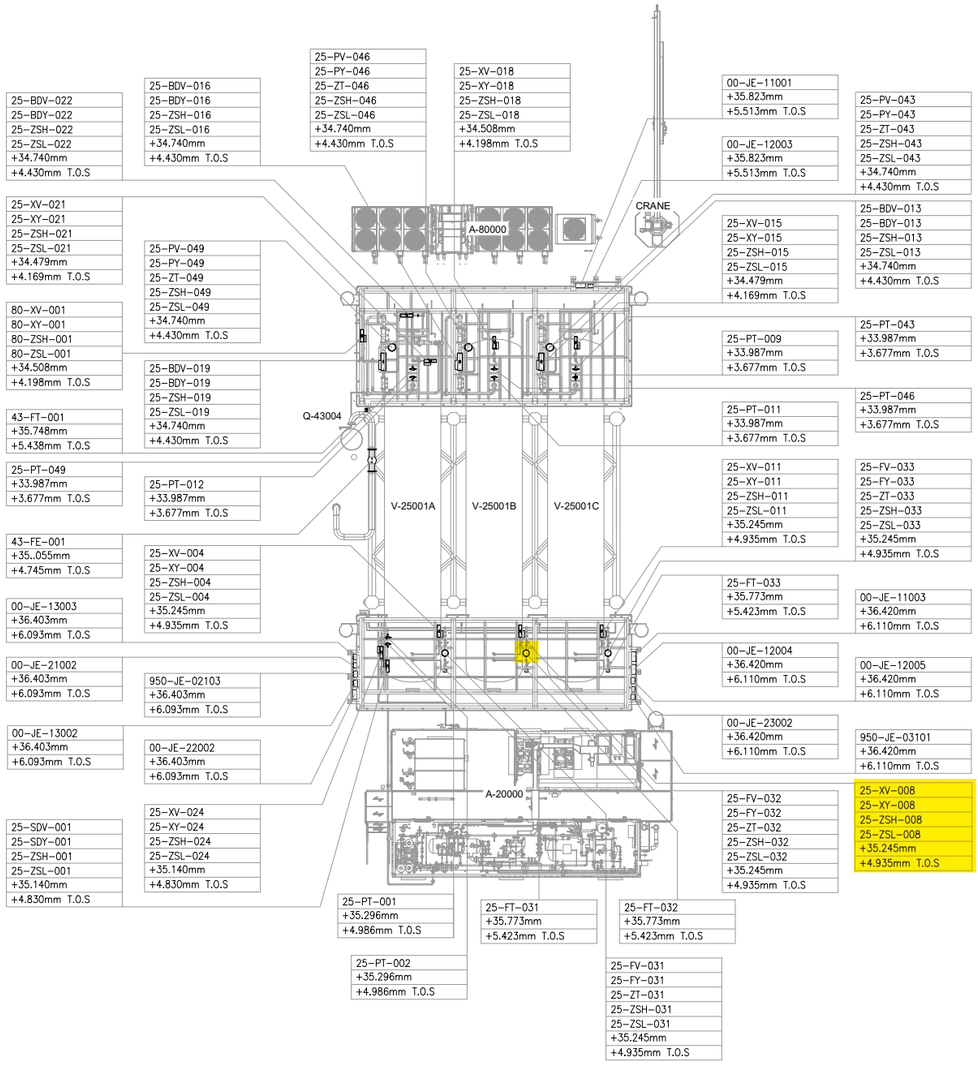

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081
REV.: 2_A | DATE: 07/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90–DDL–IN–DL–40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 B

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

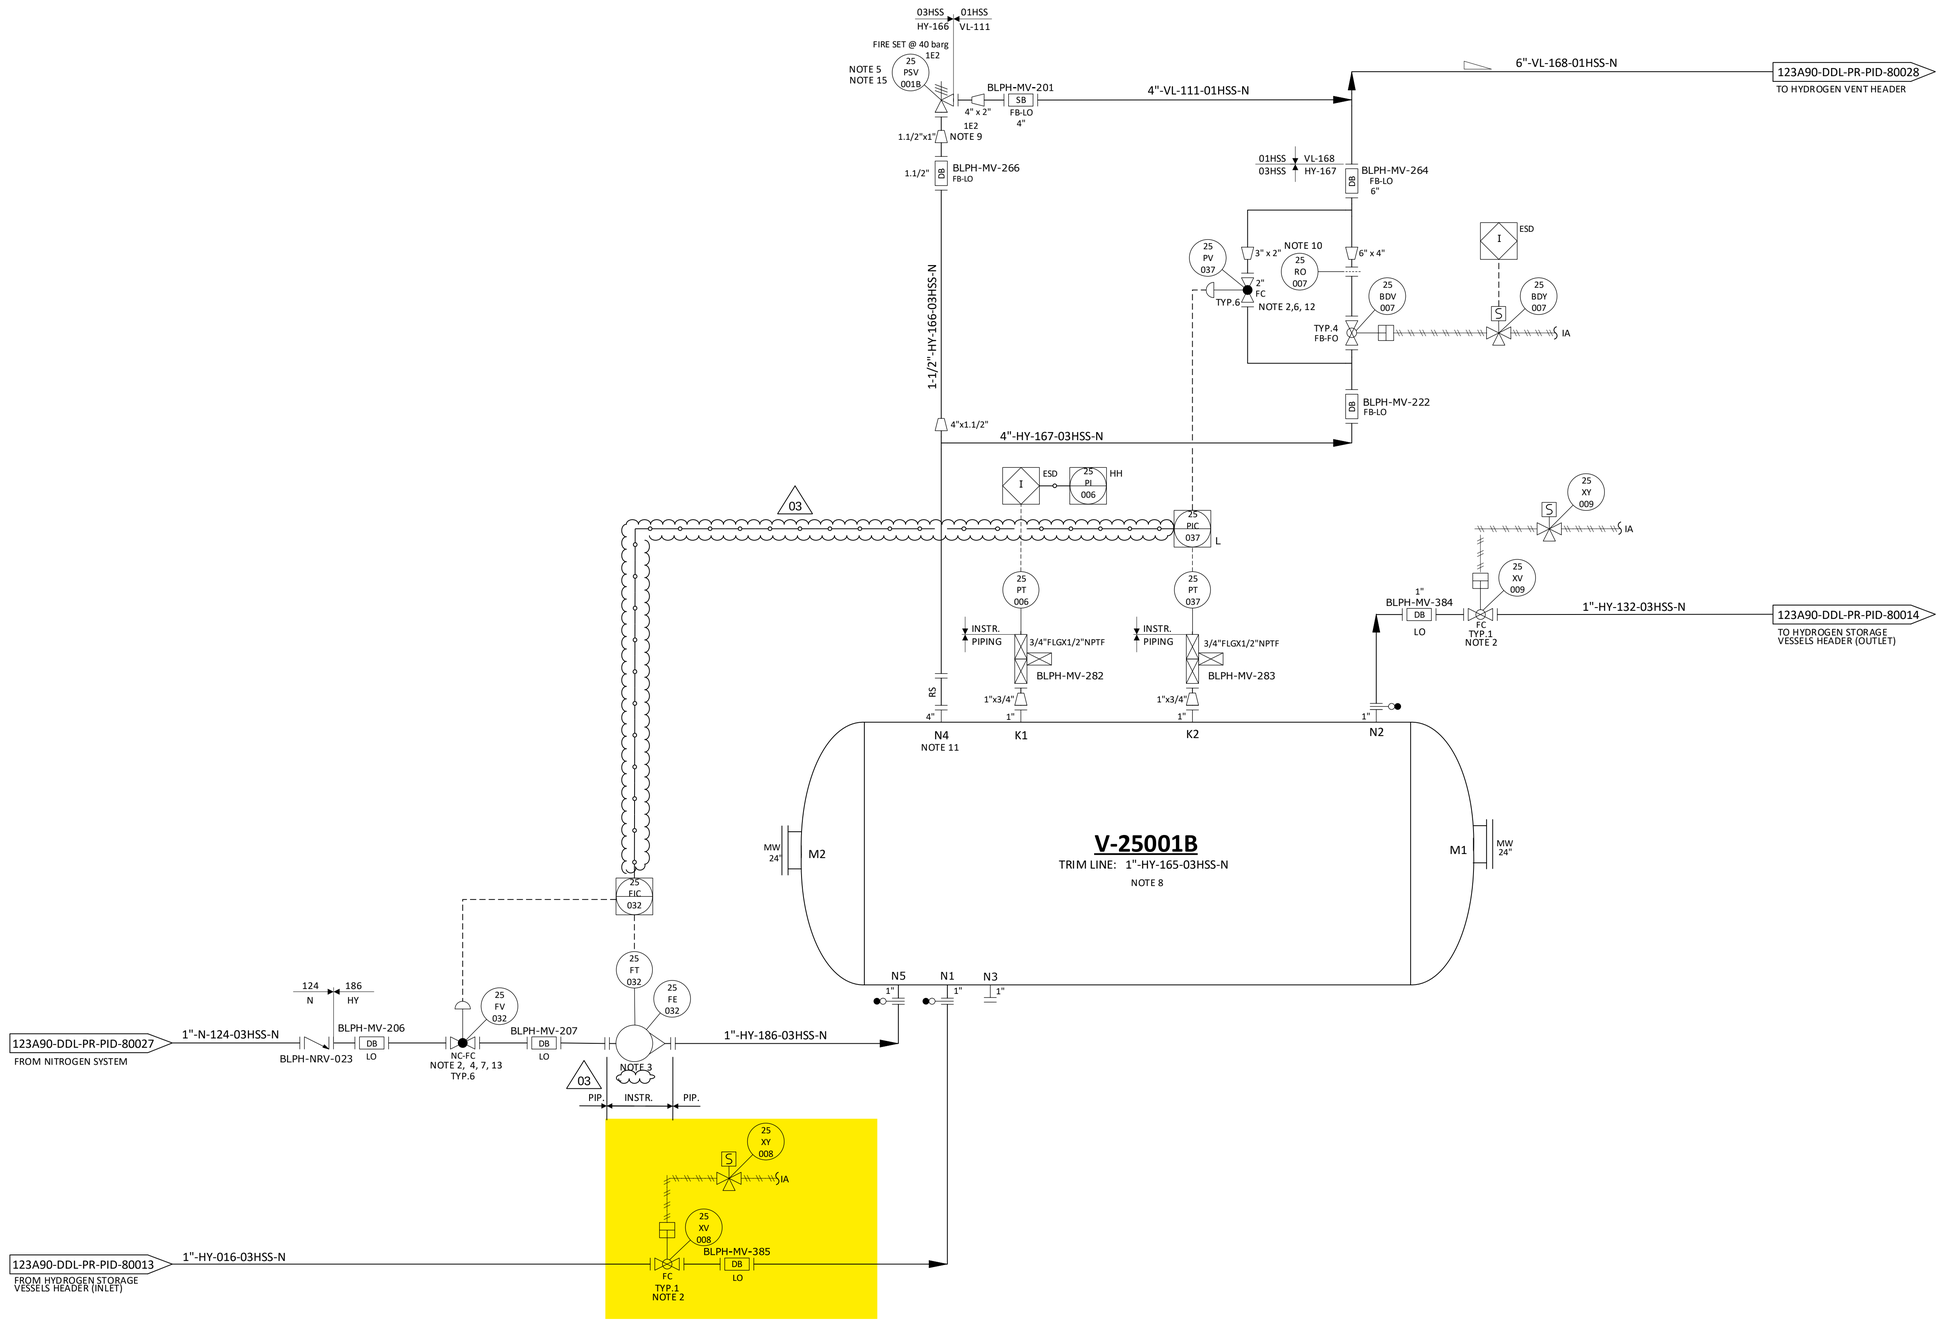

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-032) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. (03)
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-037 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC."PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-037 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. (03)
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-032 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-037 HAS FAILED TO CLOSE.
15. 25-PSV-001B SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL B

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80016	SHEET 001	REV. 03

File Name : FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

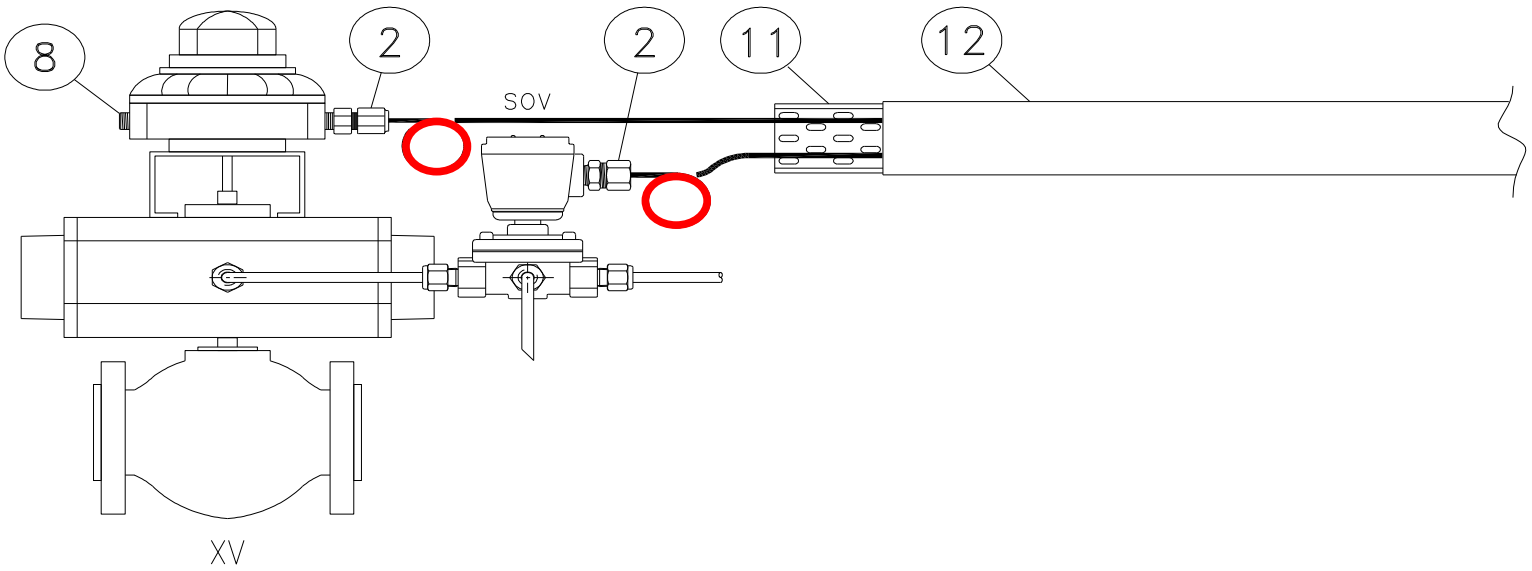

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

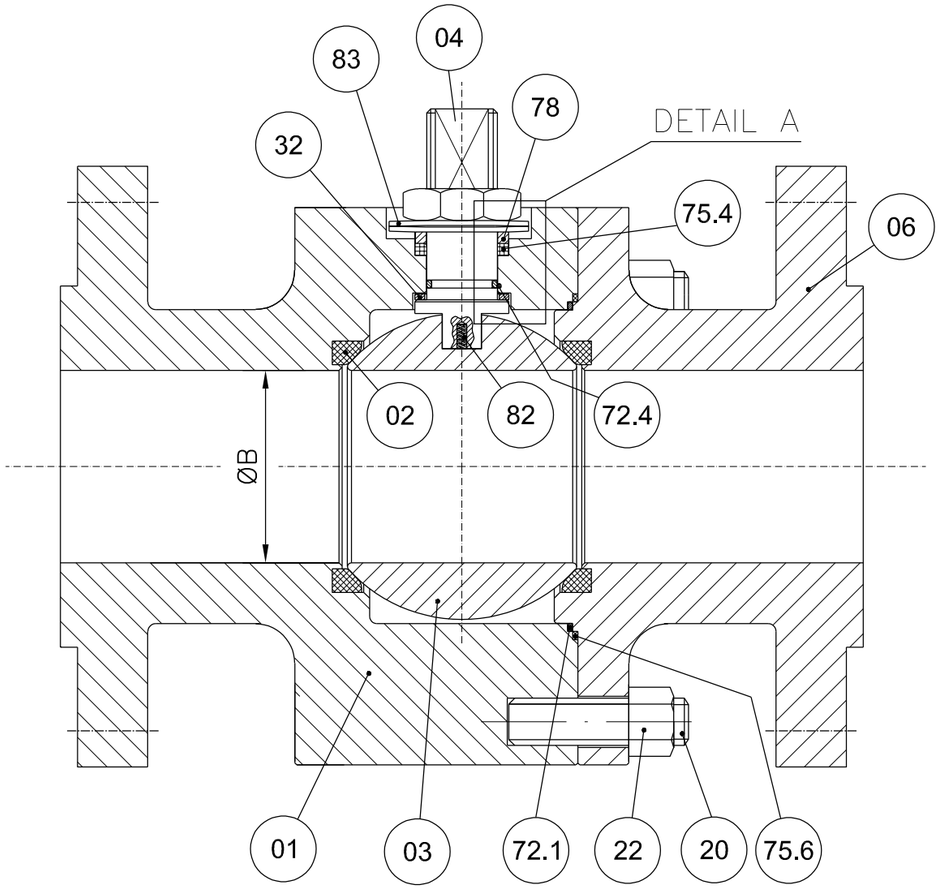




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301



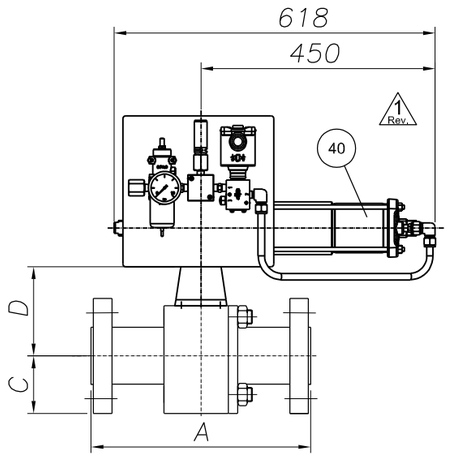

ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

Fluitek Valves

DRAWING NOT IN SCALE

DRAWN: S.Madahar — DATE: 26/02/2024
CHK'D: D.Barcella — DATE: 26/02/2024
APPV'D: L.Mora — DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWING NAME: **D240062-08**

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-008		25
	2	Service				HYDROGEN STORAGE TANK V-25001B INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80016		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-016-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-008(9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-008 (9, 17) - Soldo SS		25-ZSH-008 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR	25-SDV-023	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

Document Reference: - D of C Baseefa14ATEX0223DR_01

EU Declaration of Conformity

Manufacturer: Bifold Fluidpower Ltd
Address: Broadgate, Oldham Broadway Business Park,
Chadderton, Oldham
Greater Manchester
OL9 9XA
UK

Tel: +44 (0)161-345-4777
E-mail: sales@bifold.co.uk

Product Type (Object of the Declaration):

Type SH, ASH & SC Filter Regulator

Declaration statement:

On behalf of the above company, I declare that, the *Object of the Declaration* described above is in conformity with the relevant Union harmonisation legislation: Directive 2014/34/EU, with the following limitation;

Limitation on the validity of the Declaration of Conformity:

None

Provisions of the Directive fulfilled by the Equipment:

Group II Category 2 Gb Db Ex c IIC T6

Bifold Technical File Reference:

DF-FP_SH_20140627114952

Technical File lodged with Notified Body:

SGS Fimko Oy 0598 Helsinki, Finland

SGS Baseefa Technical File Reference:

Baseefa14ATEX0223DR

Technical basis for compliance with the Essential Health and Safety Requirements of Directive 2014/34/EU: -

BS EN 13463-1: 2009 – Non-electrical equipment for use in potentially explosive atmospheres. Basic method and requirements
BS EN 13463-5: 2011 – Non-electrical equipment for use in potentially explosive atmospheres. Protection by constructional safety 'c'

(A review against the following harmonised standards, shows no significant changes relevant to this equipment): -


BS EN ISO 80079-36: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Basic method and requirements
BS EN ISO 80079-37: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Non-electrical type of protection constructional safety "c", control of ignition sources "b", liquid immersion "k"

Paul Barrow
Quality Manager


4th November 2020

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

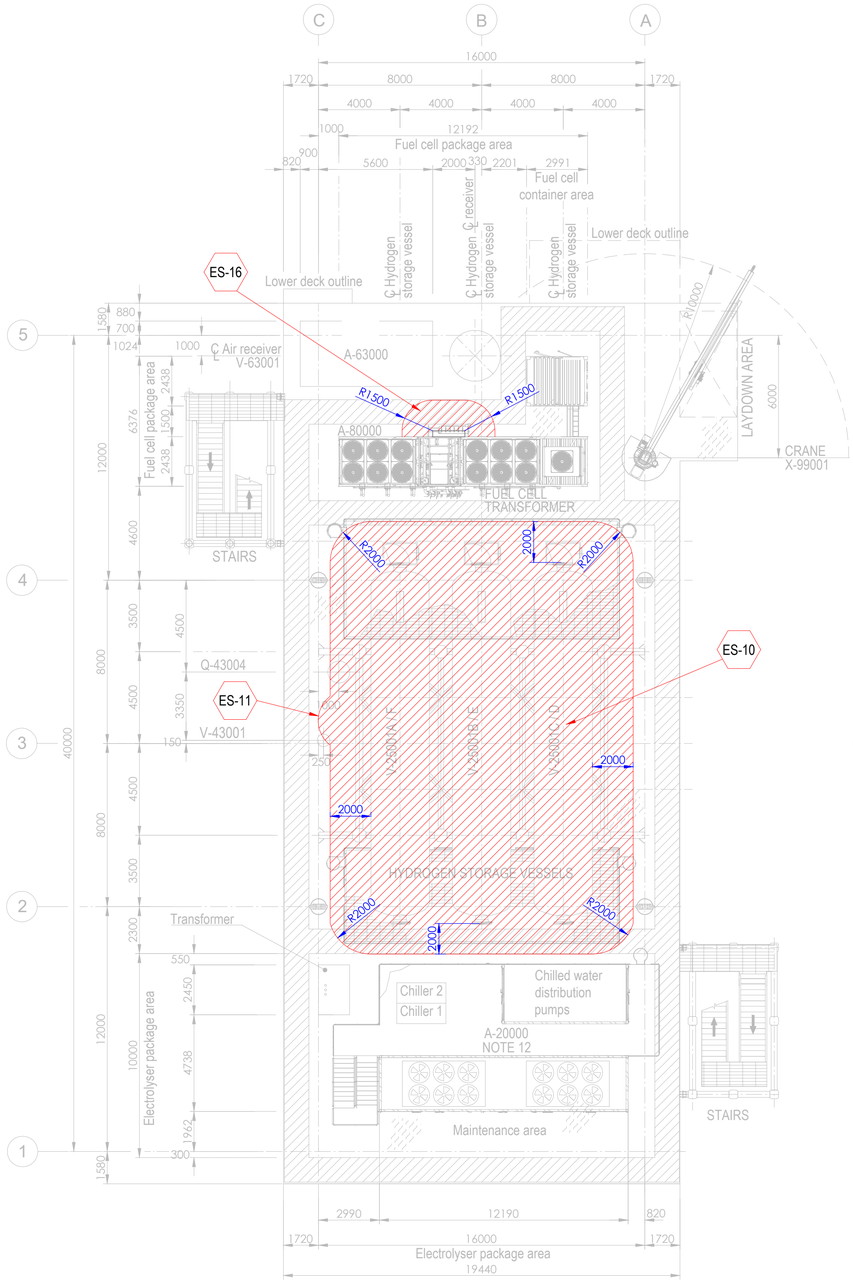


PLAN ON UPPER DECK
EL+30.310 T.O.S.

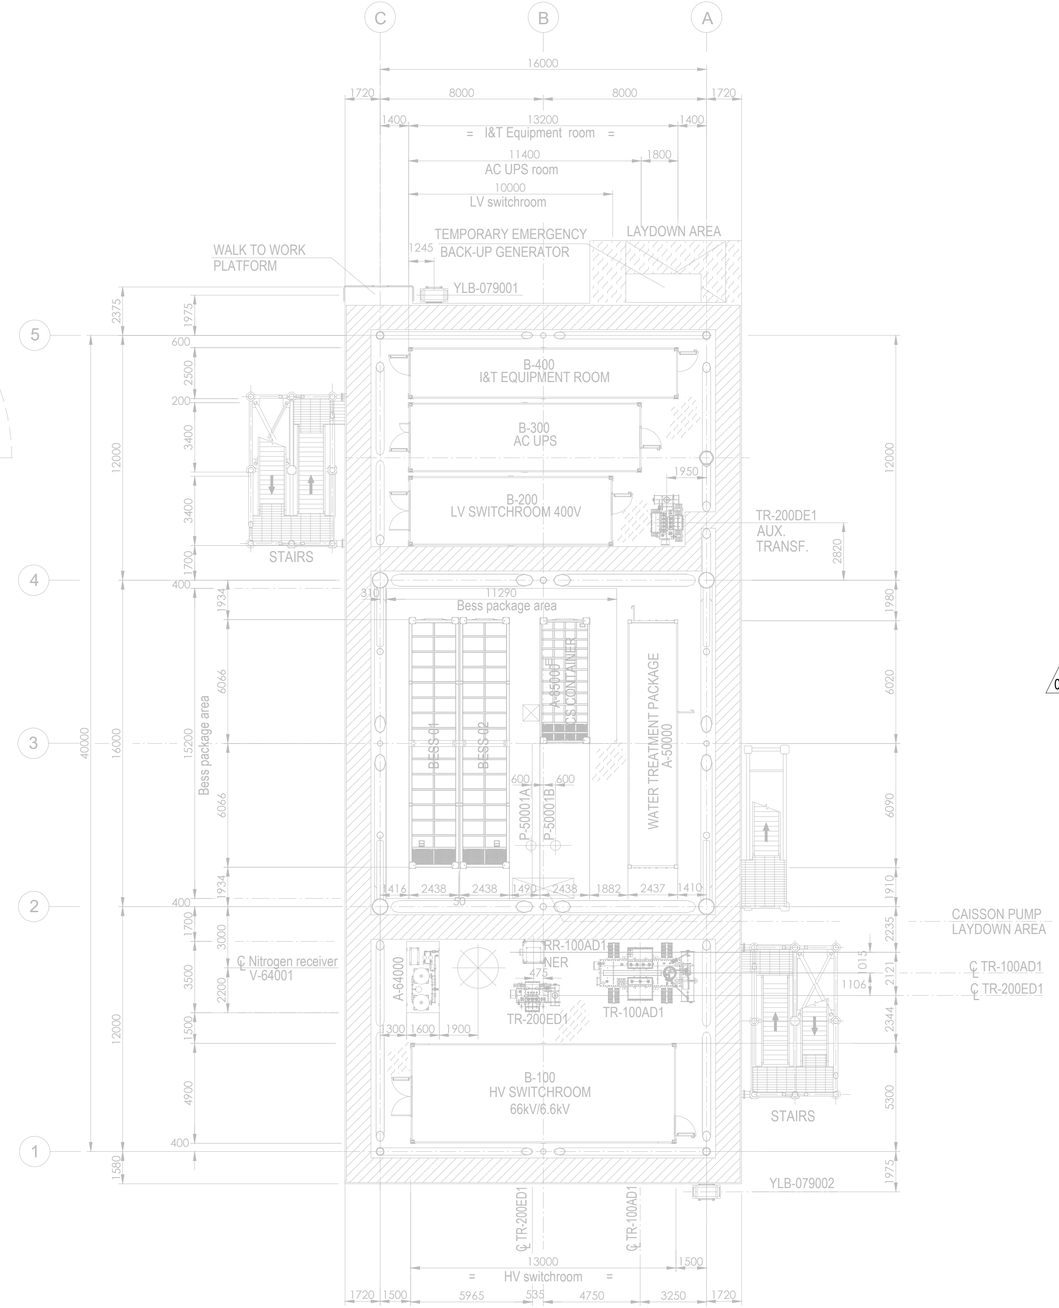

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

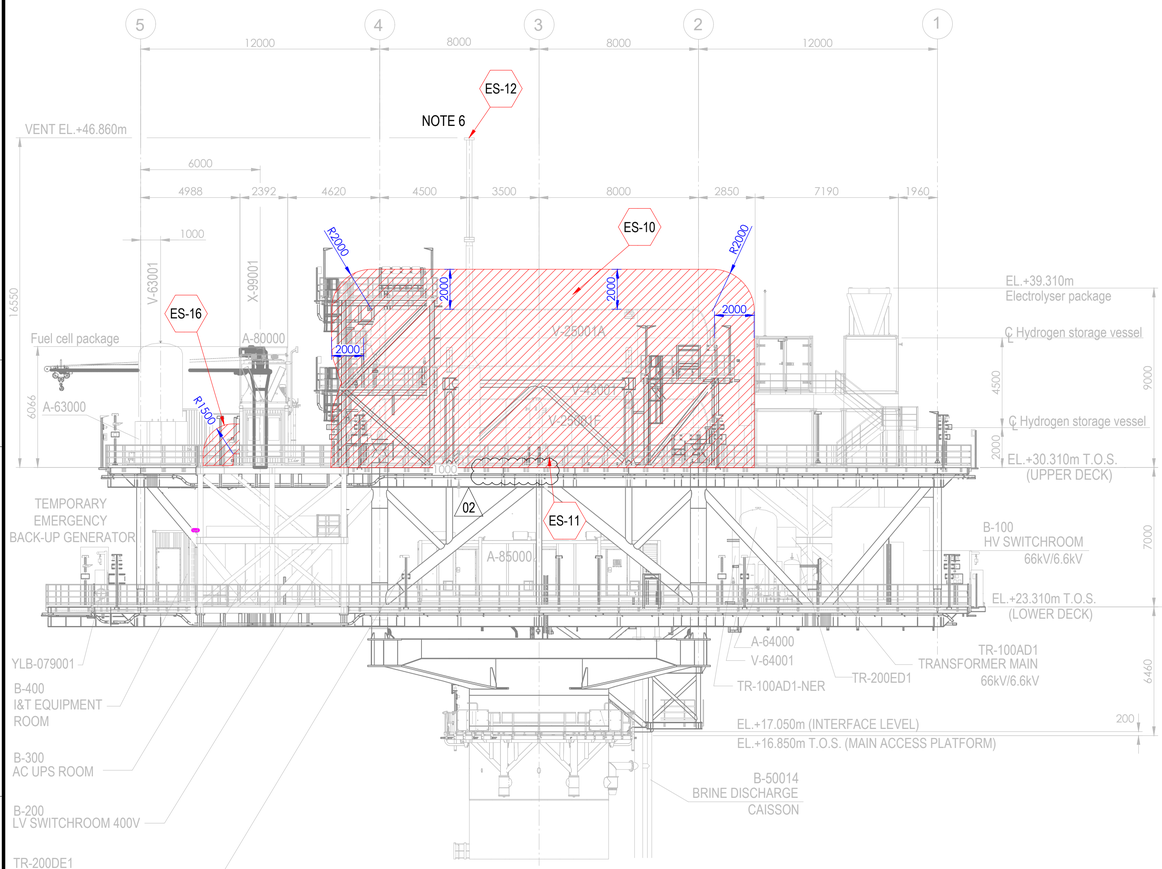



ELEVATION LOOKING EAST

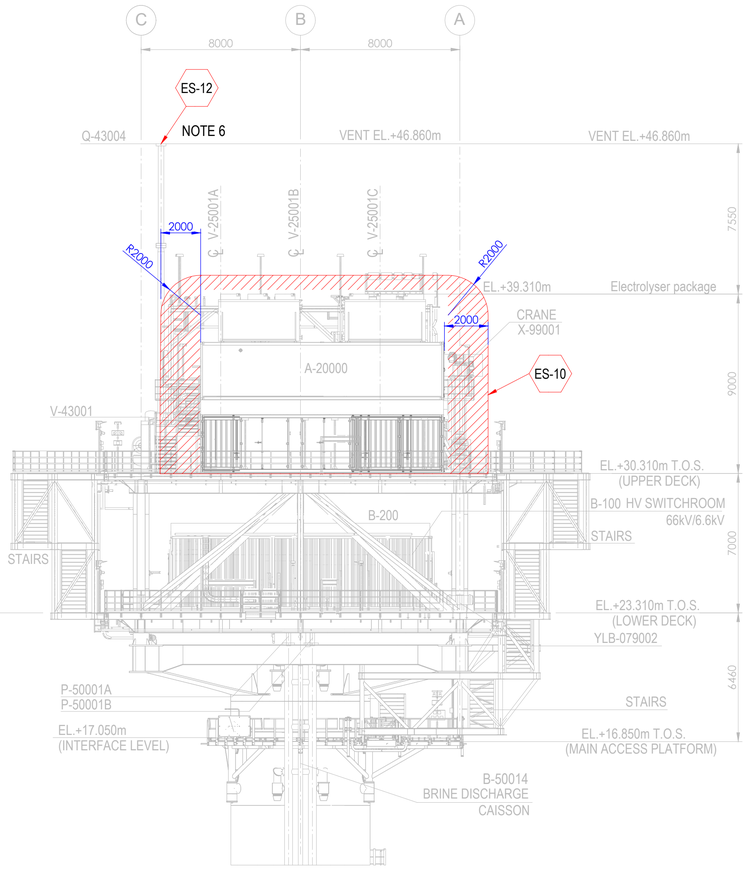

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

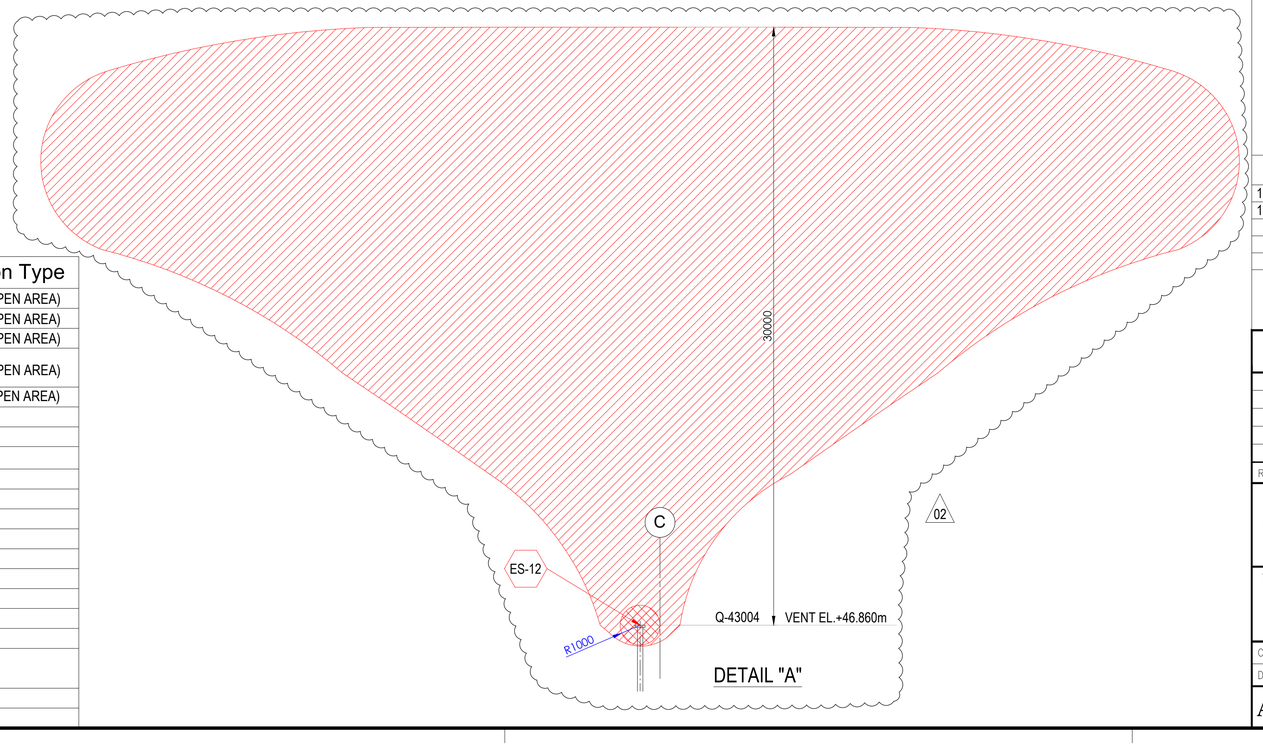



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PCV-011	: Air Set Filter - Vessel V-25001C Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80017
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001759	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		FL20424-0143			
Manufacturer	BIFOLD			**Model**		SH05-FR-SR-MD-10-X4			
Cert No.	D.o.C. by Manufacturer			**Equipment Ambient Temp.**		-20°C +40°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		OK	
	Physical check	x	OK	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PCV-011	: Air Set Filter - Vessel V-25001C Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80017
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001759		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-PCV-011	: Air Set Filter - Vessel V-25001C Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80017
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001759	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type "nR" only)	x	NA	
71	Breathing operation is satisfactory (type "nR" only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for 'IS' Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-29	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:39:18.837Z	PROVERLIS Digitaly signed by Luca Mussi 2025-01-30T16:14:18.432Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

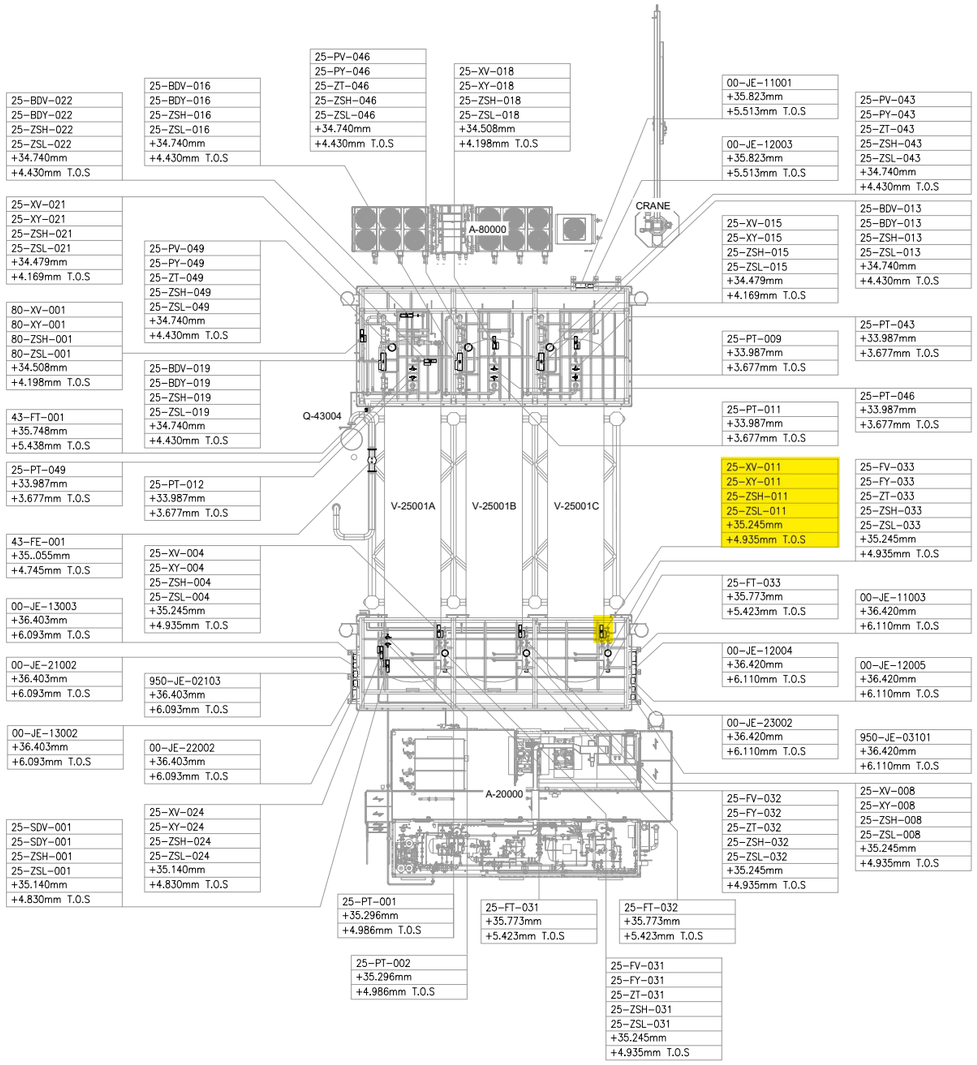

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm

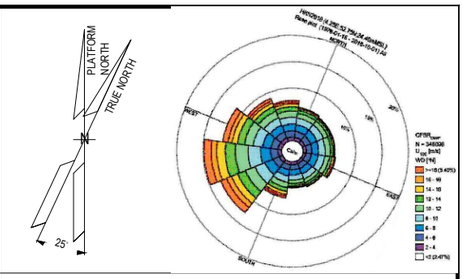

NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING_NO. DRAWING_NO.

REV. REV

V-25001_C

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

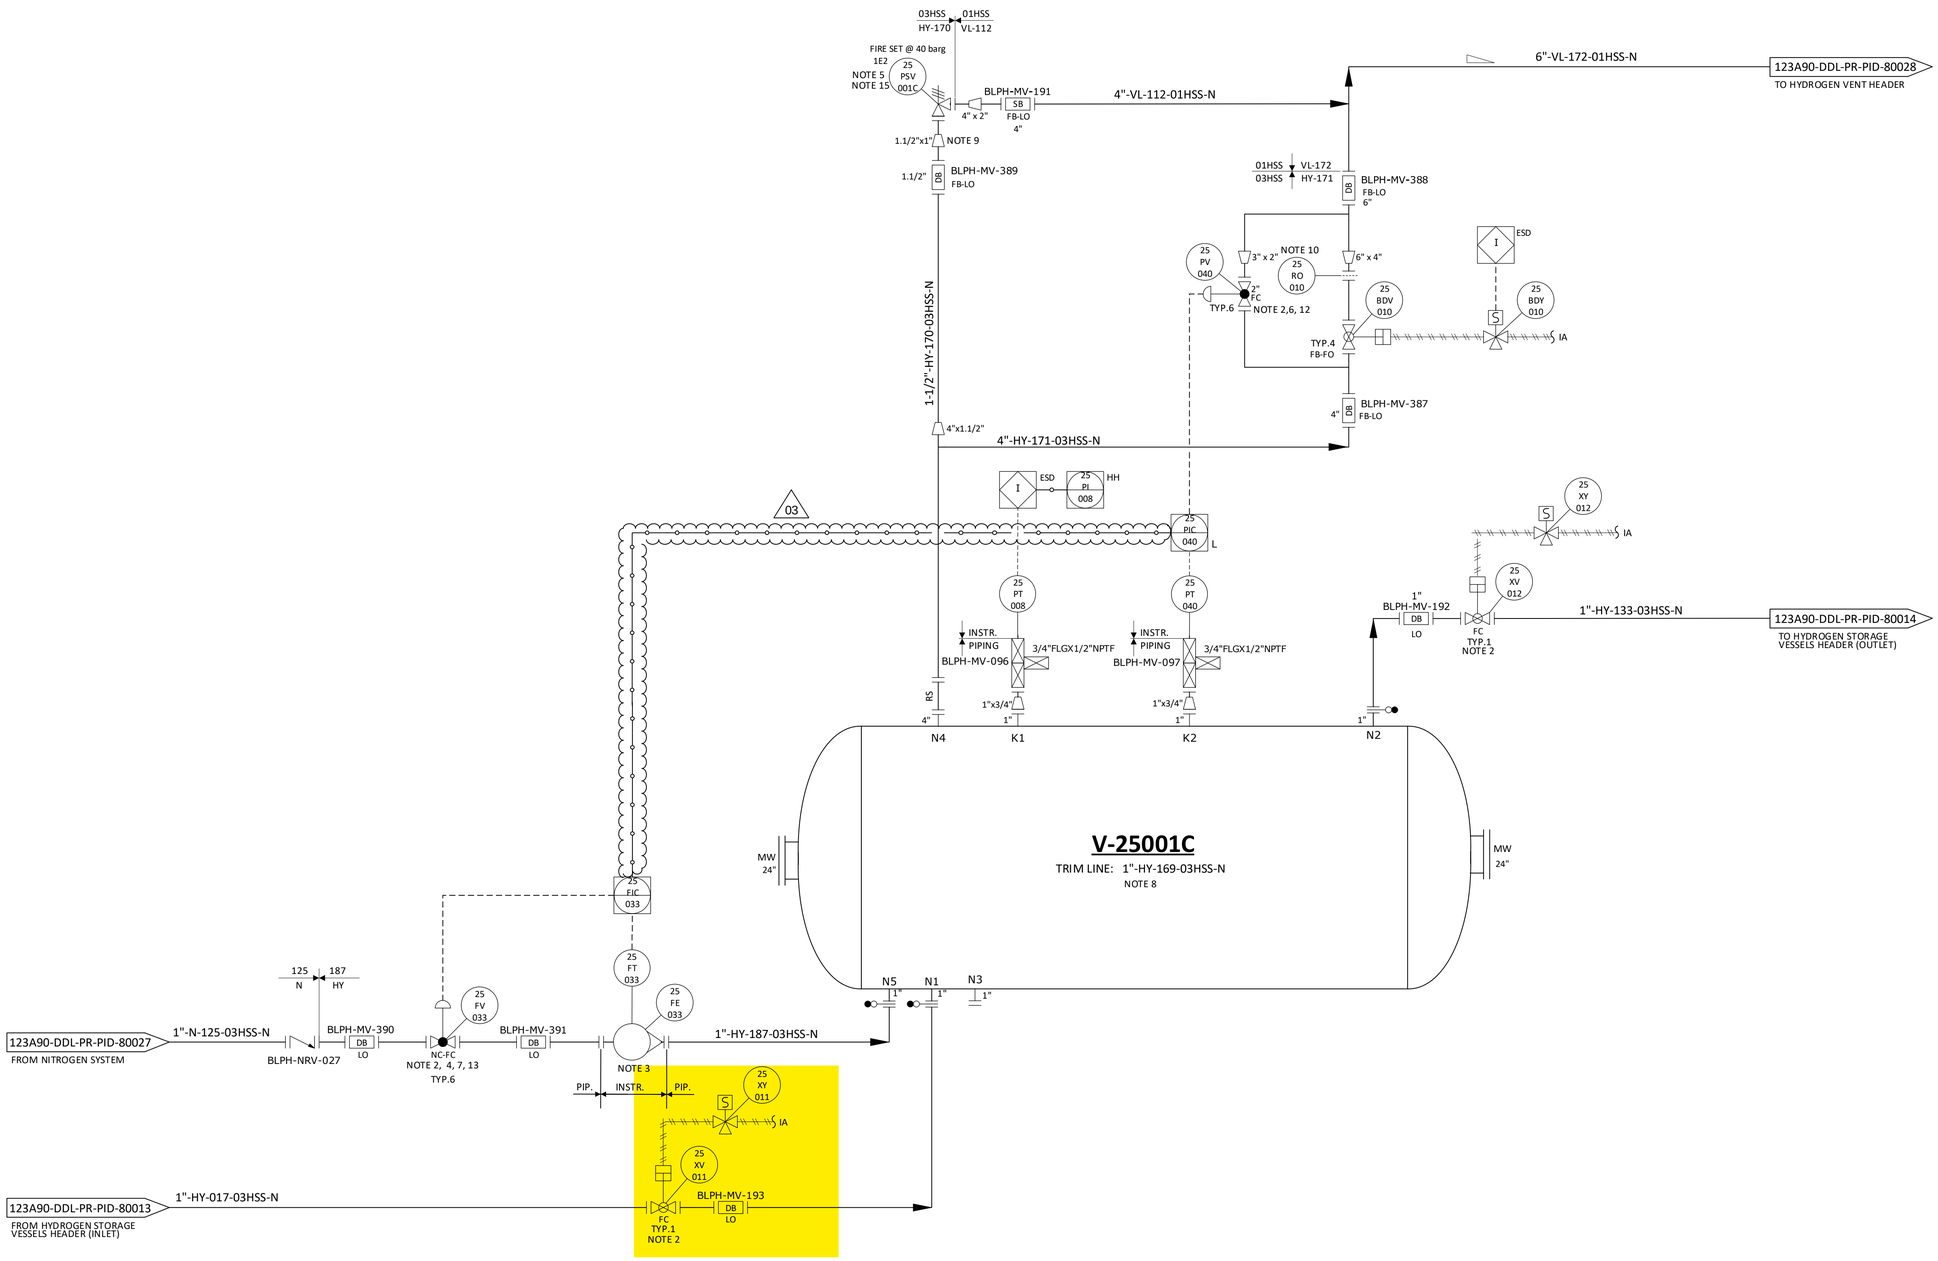

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-033) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-040 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-040 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-033 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-040 HAS FAILED TO CLOSE.
15. 25-PS-V001C SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL C

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE		
A1	DRAWING NO. 123A90-DDL-PR-PID-80017			SHEET 001	REV. 03

File Name = FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

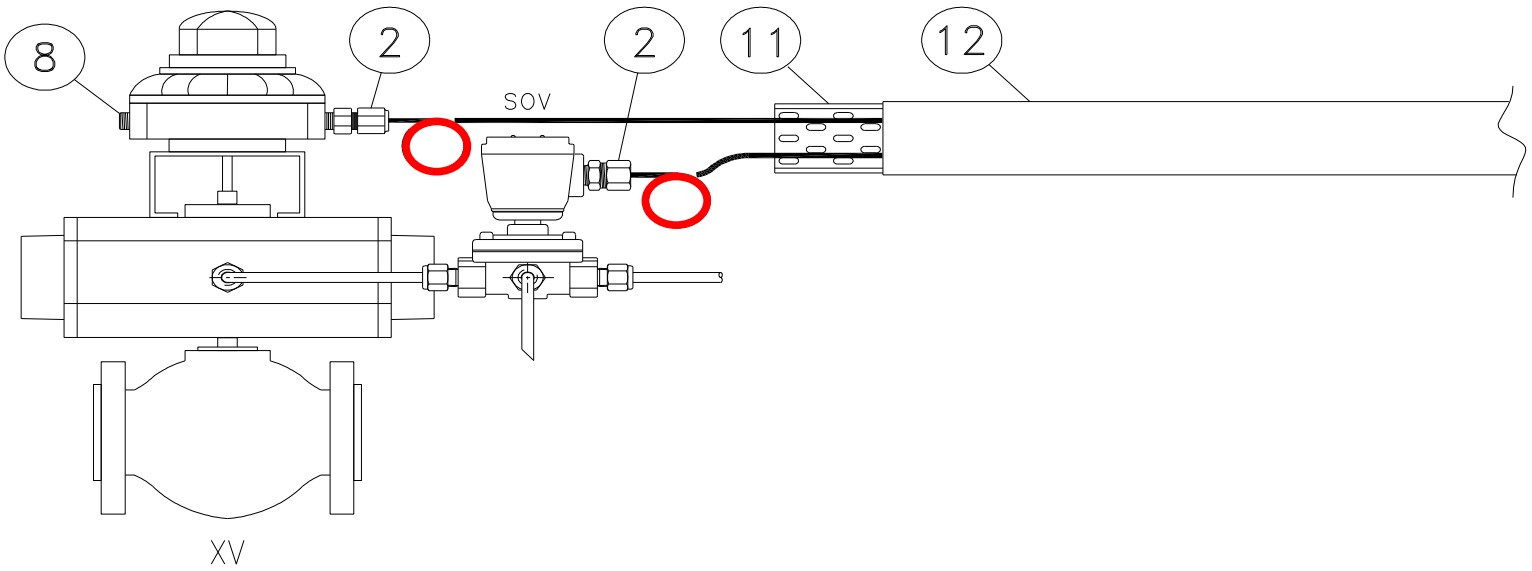

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

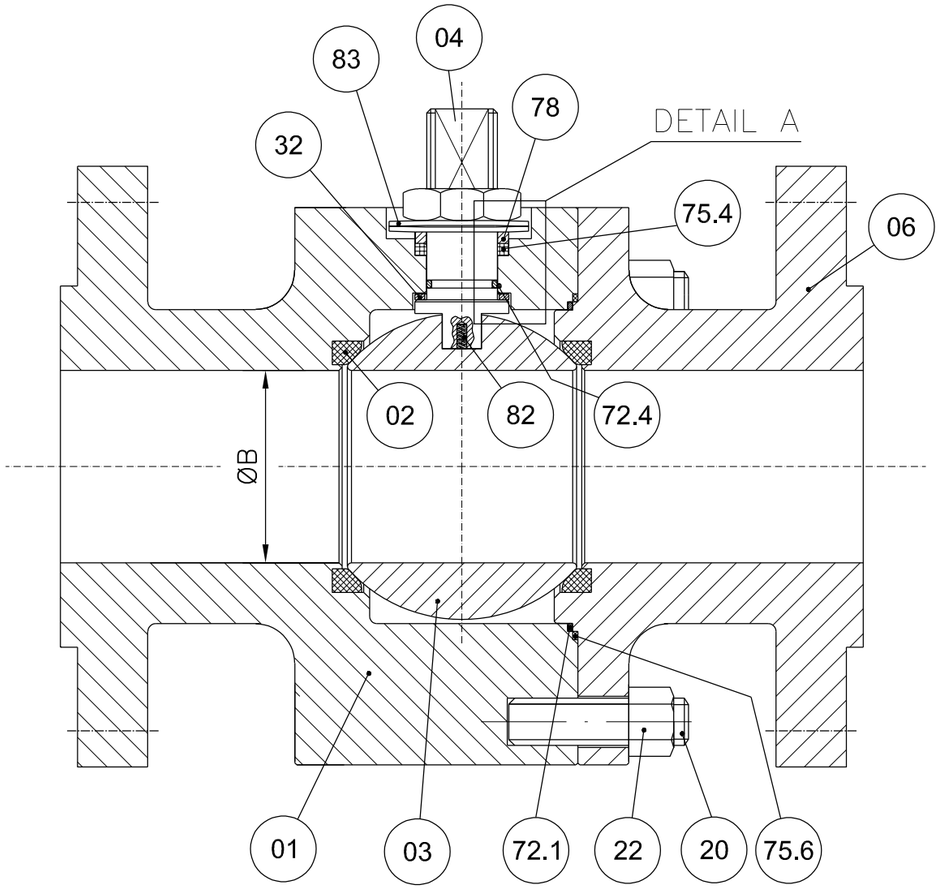




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DRAWN: S.Madahar — DATE: 26/02/2024
CHK'D: D.Barcella — DATE: 26/02/2024
APPV'D: L.Mora — DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWING NAME: **D240062-08**

Rev.: 2

GENERAL	1	Tag Number		Location		25-XV-011		25
	2	Service				HYDROGEN STORAGE TANK V-25001C INLET		
	3	P&ID Number		Area Classification		123A90-DDL-PR-PID-80017		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-017-03HSS-N		
	5	Line Size and Schedule	Inlet		Outlet	1" / 3.38 mm		1" / 3.38 mm
	6	Line Material		Line Insulation		ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State		Phase		GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure		Full Vacuum	[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature		Minimum	Maxi [°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of		Design		Close :	(12)	Open : (12)
	17	Operation (seconds)		Actual		Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size		Body Form		1"		FULL BORE
	22	Body Material		Bonnet Type		ASTM A182 F316/316L		(*)
	23	Connections		Rating		FLANGED ASME B16.5		#300
	24	Flange Finish		Gasket Material		RF		Inside the valve (*) (38)
	25	Packing		Lubrication & Isolation		A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer		Type		Rotork		Spring Return
	31	Model No.		Size		CP/S		035-100A/BA
	32	Actuator Orientation		Actuator Form		Horizontal		Cylinder
	33	Ingress Protection		Certification		IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply		Min	Max Design	4 barg	10 barg	11 barg
	35	Action on Air Failure		Action on Power Failure		CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-011 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed		Limit Switch Open		25-ZSL-011 (9, 17) - Soldo SS		25-ZSH-011 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set		Handwheel		(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection		Electrical Class		No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity		Fabrication Code		-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve		Model		-		-
	48	Check Valve		Mounting		-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

94	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR	25-XV-009	ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR	25-XV-012	FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR	25-XV-014	FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR	25-XV-015	FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR	25-XV-017	FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR	25-XV-018	FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

Document Reference: - D of C Baseefa14ATEX0223DR_01

EU Declaration of Conformity

Manufacturer: Bifold Fluidpower Ltd
Address: Broadgate, Oldham Broadway Business Park,
Chadderton, Oldham
Greater Manchester
OL9 9XA
UK

Tel: +44 (0)161-345-4777
E-mail: sales@bifold.co.uk

Product Type (Object of the Declaration):

Type SH, ASH & SC Filter Regulator

Declaration statement:

On behalf of the above company, I declare that, the *Object of the Declaration* described above is in conformity with the relevant Union harmonisation legislation: Directive 2014/34/EU, with the following limitation;

Limitation on the validity of the Declaration of Conformity:

None

Provisions of the Directive fulfilled by the Equipment:

Group II Category 2 Gb Db Ex c IIC T6

Bifold Technical File Reference:

DF-FP_SH_20140627114952

Technical File lodged with Notified Body:

SGS Fimko Oy 0598 Helsinki, Finland

SGS Baseefa Technical File Reference:

Baseefa14ATEX0223DR

Technical basis for compliance with the Essential Health and Safety Requirements of Directive 2014/34/EU: -

BS EN 13463-1: 2009 – Non-electrical equipment for use in potentially explosive atmospheres. Basic method and requirements
BS EN 13463-5: 2011 – Non-electrical equipment for use in potentially explosive atmospheres. Protection by constructional safety 'c'

(A review against the following harmonised standards, shows no significant changes relevant to this equipment): -


BS EN ISO 80079-36: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Basic method and requirements
BS EN ISO 80079-37: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Non-electrical type of protection constructional safety "c", control of ignition sources "b", liquid immersion "k"

Paul Barrow
Quality Manager


4th November 2020

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

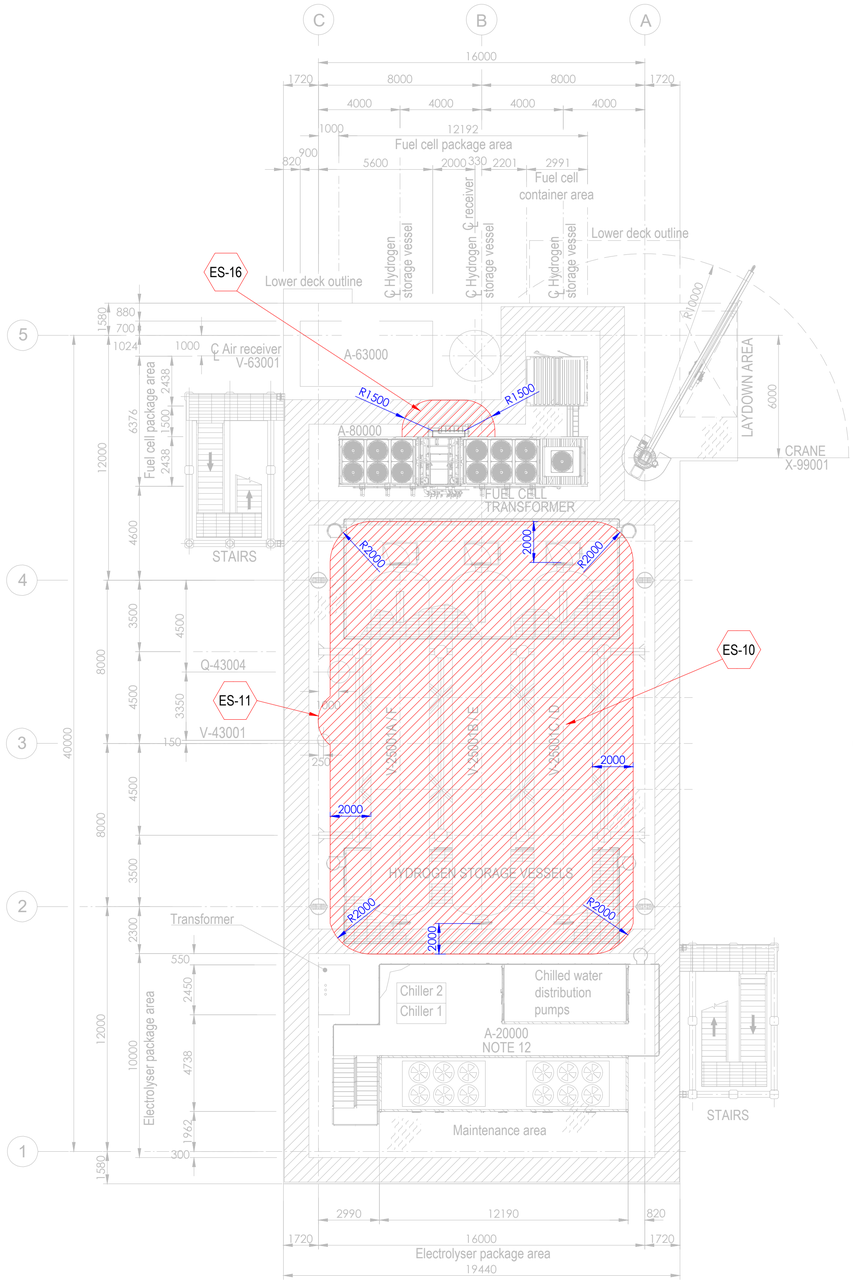


PLAN ON UPPER DECK
EL+30.310 T.O.S.

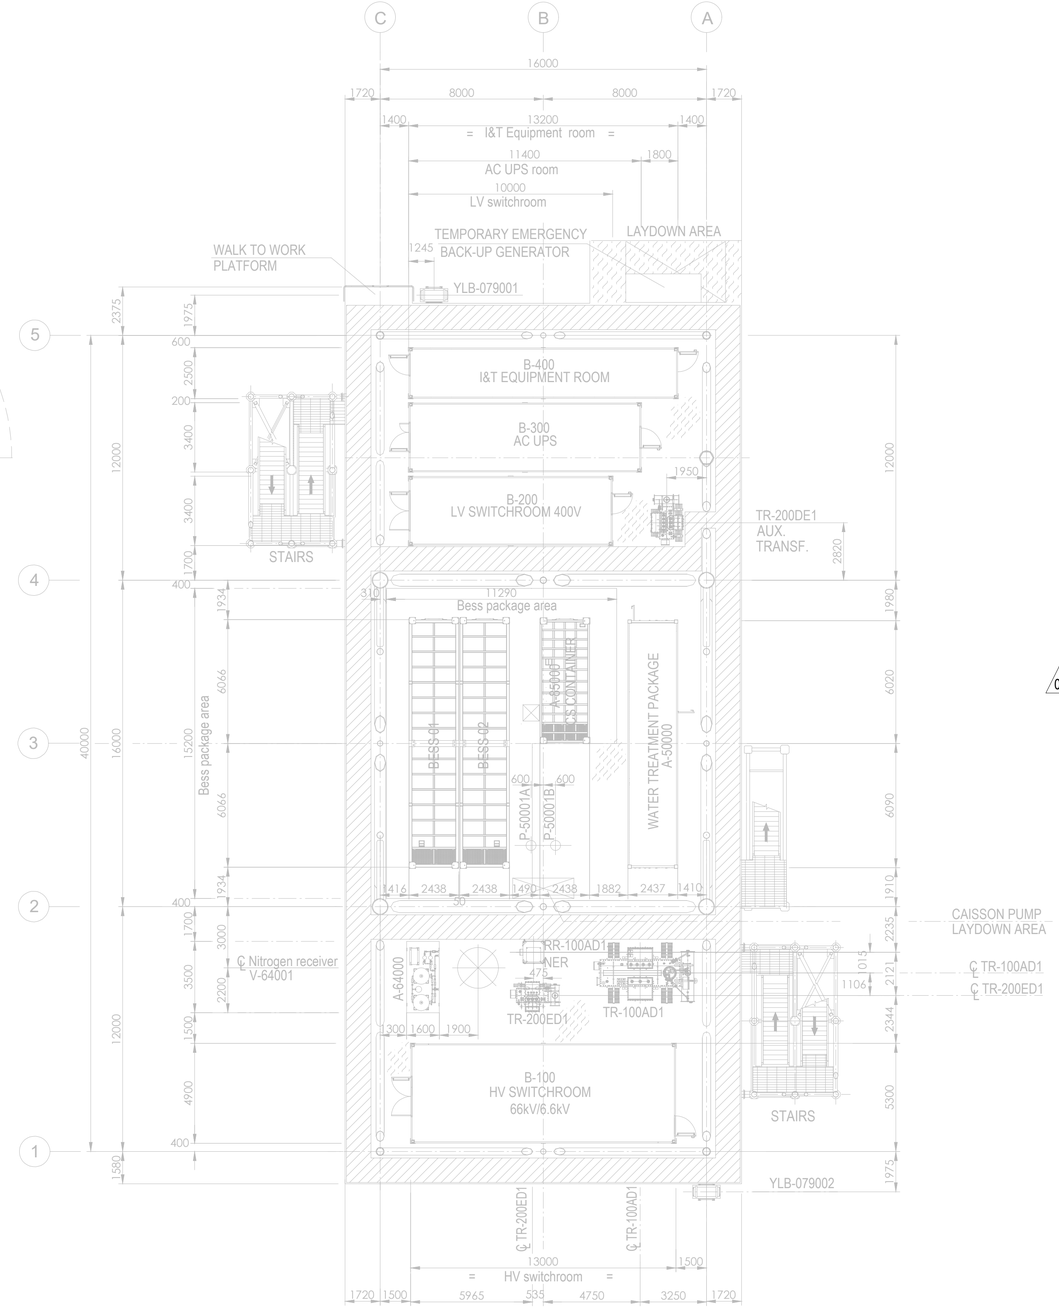

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

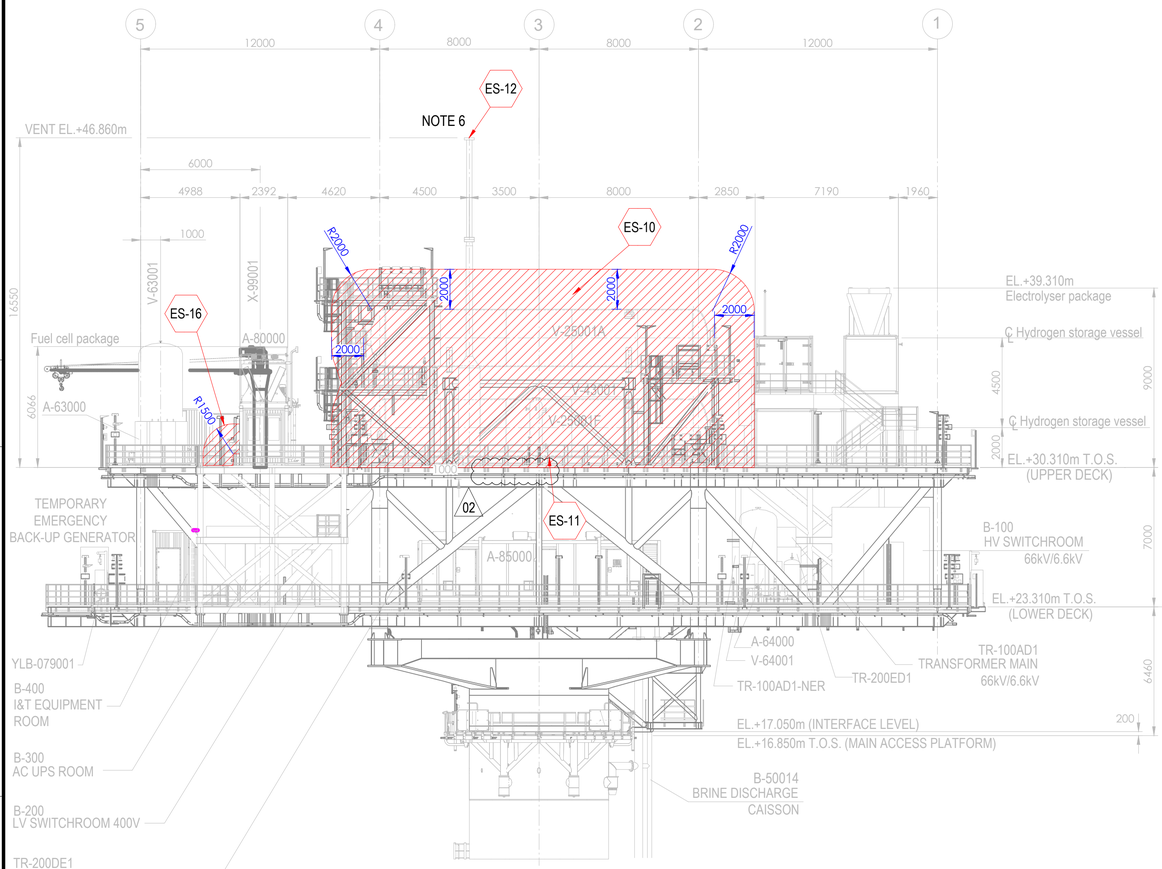



ELEVATION LOOKING EAST

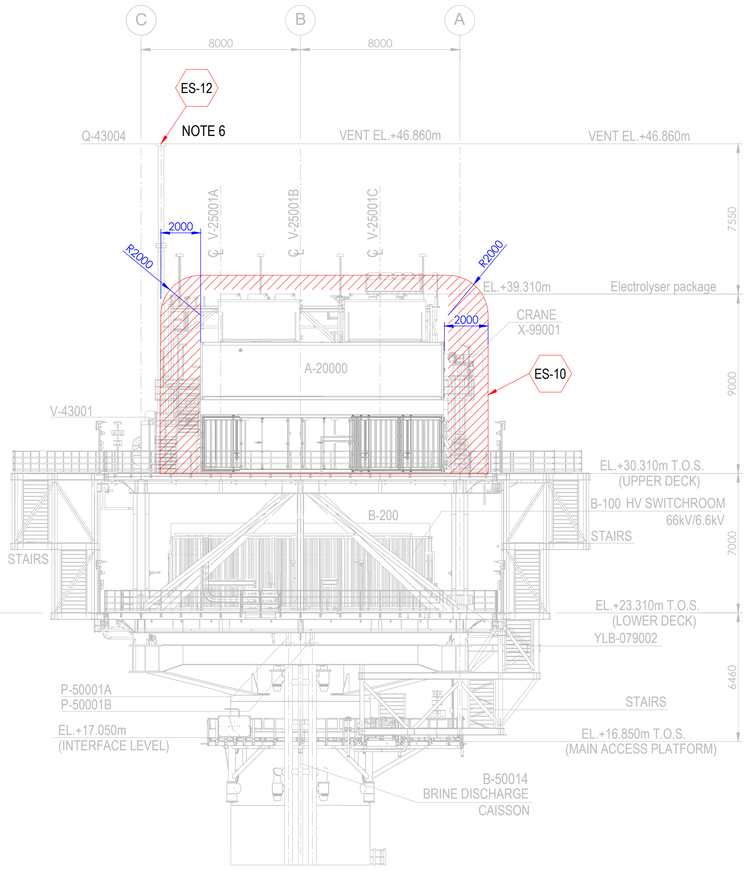

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

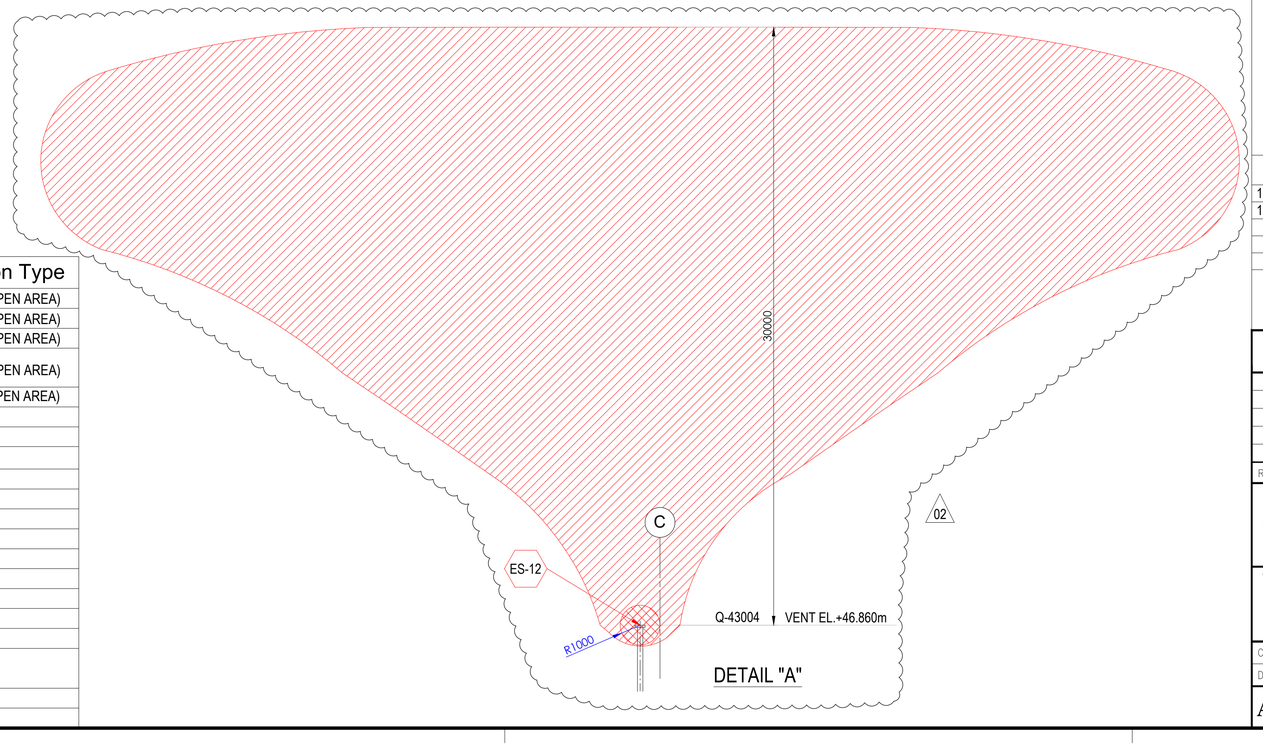



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PCV-014	: Air Set Filter - Vessel V-25001D Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001761	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		FL40524-1497			
Manufacturer	BIFOLD			**Model**		SH05-FR-SR-MD-10-X4			
Cert No.	D.o.C. by Manufacturer			**Equipment Ambient Temp.**		-20°C +40°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		OK	
	Physical check	x	OK	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PCV-014	: Air Set Filter - Vessel V-25001D Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001761		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-PCV-014	: Air Set Filter - Vessel V-25001D Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001761		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type "nR" only)	x	NA	
71	Breathing operation is satisfactory (type "nR" only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for 'IS' Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-29	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:39:32.175Z	PROVERLIS Digitaly signed by Luca Mussi 2025-01-30T16:15:49.482Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

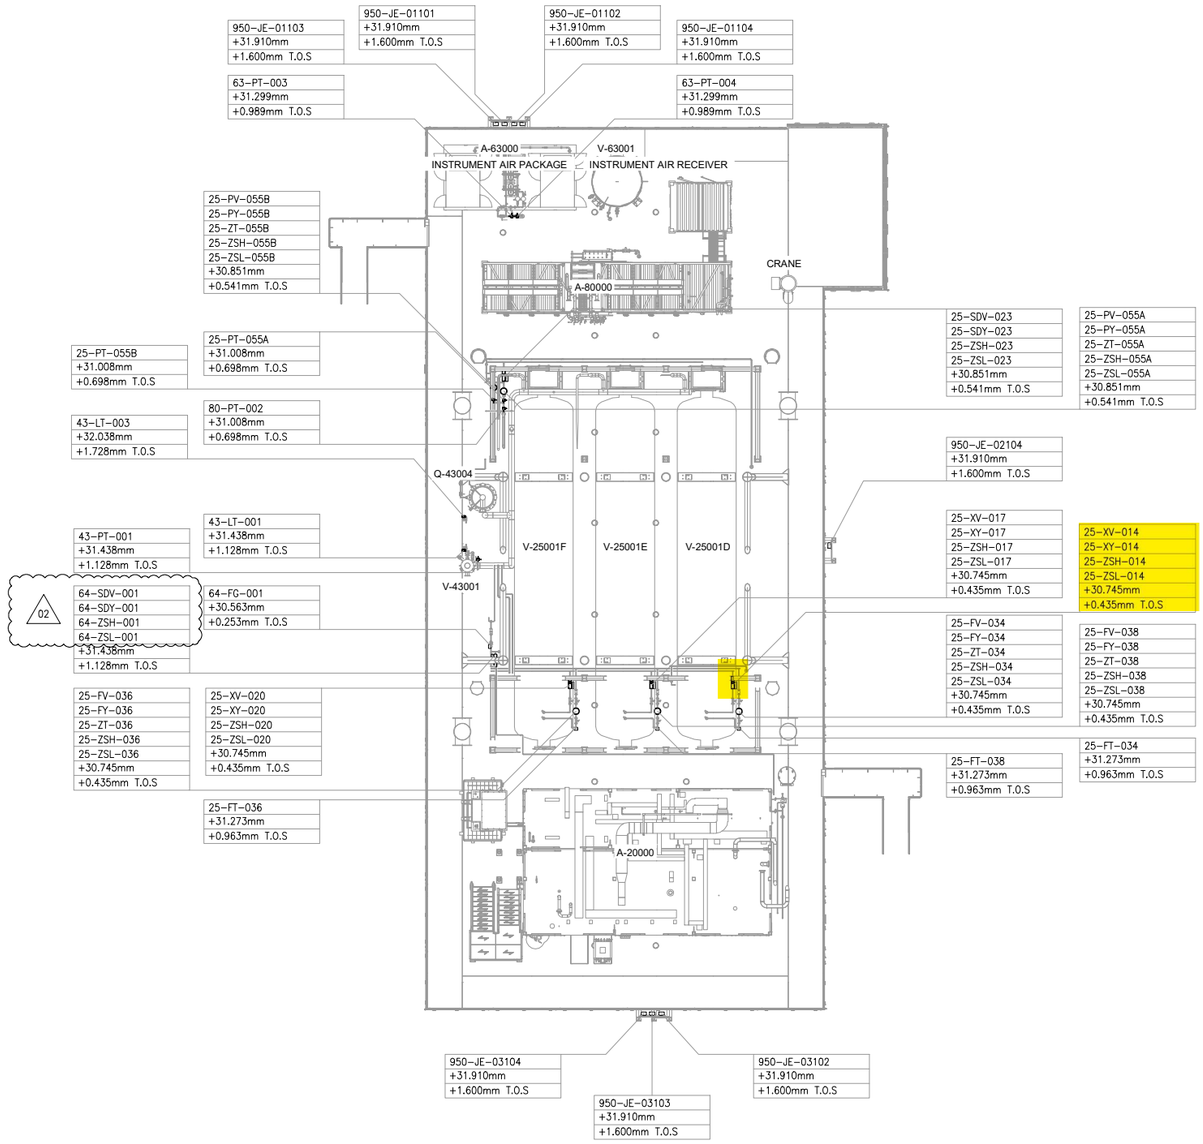


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90–DDL–IN–DL–40081	001	02


File Name : 123A90-DDL-IN-DL-40081 REV01.dwg

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 01

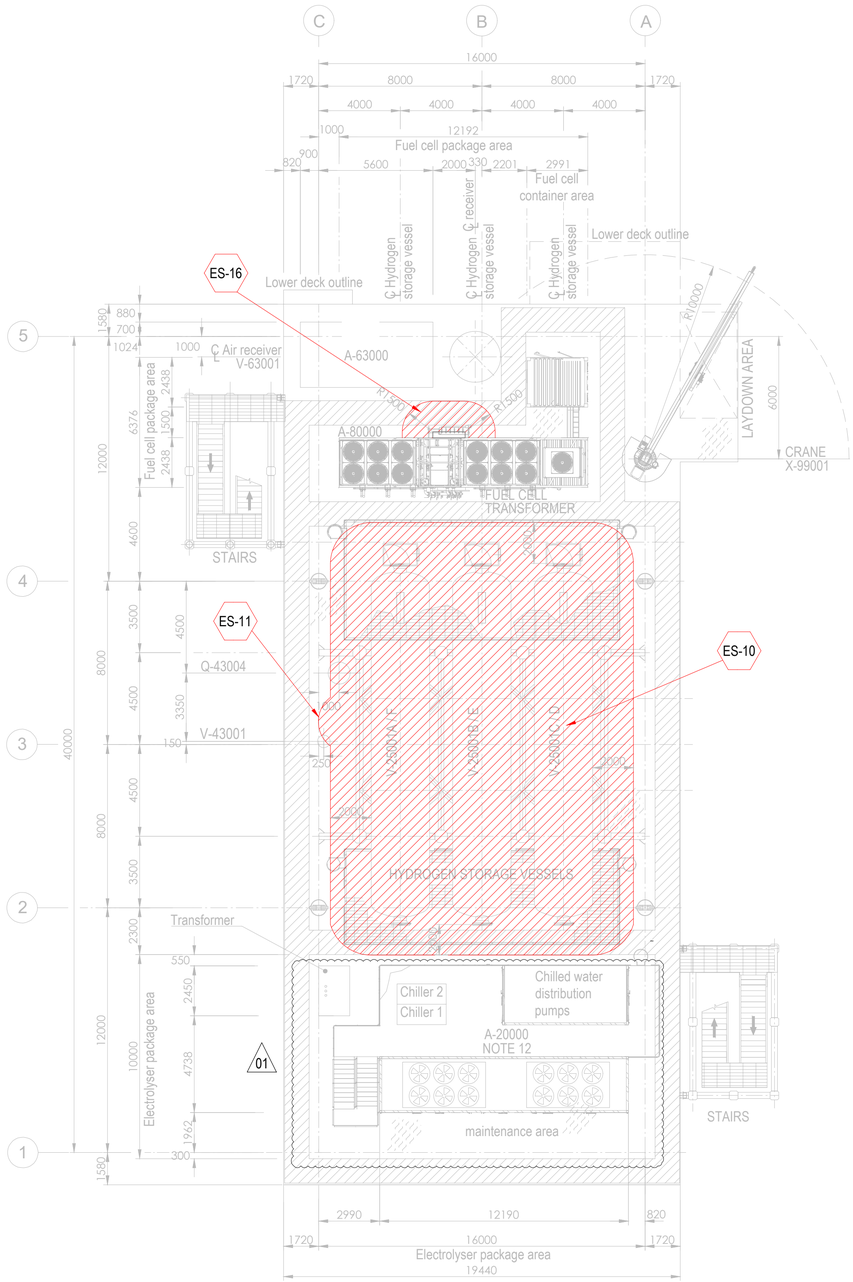


PLAN ON UPPER DECK
EL+30.310 T.O.S.

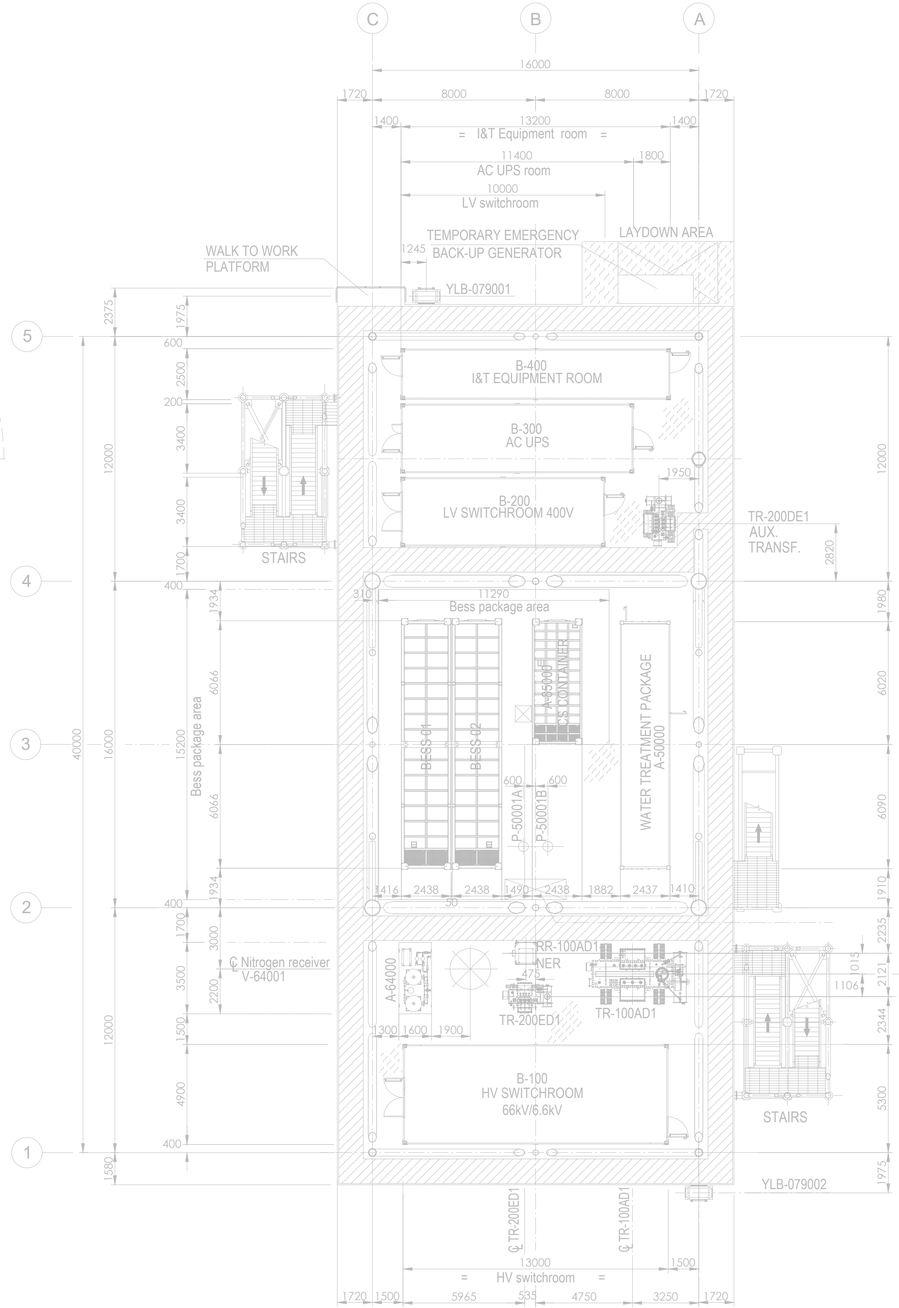

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		

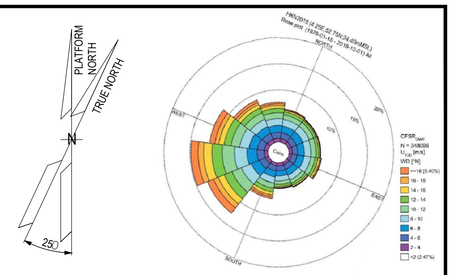

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

01

ZONE 0 | ZONE 1 | ZONE 2 | ES EMISSION SOURCES

01

01

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO


TITLE : BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24
A1	DRAWING NO. 123A90-DDL-SAF-DL-30022	SHEET 001	REV. 01


File Name : 123A90-DDL-SAF-DL-30022 Rev.01

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 01

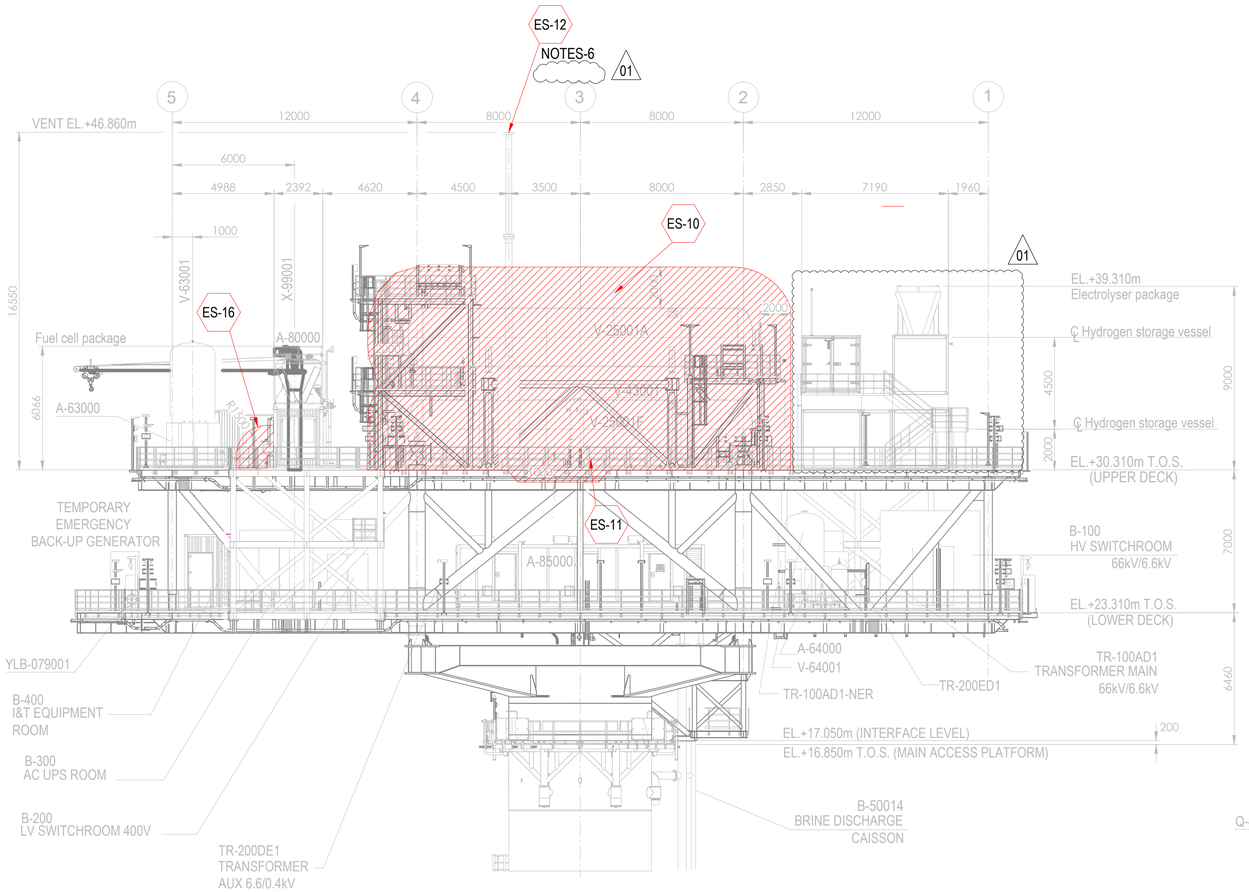


ELEVATION LOOKING EAST

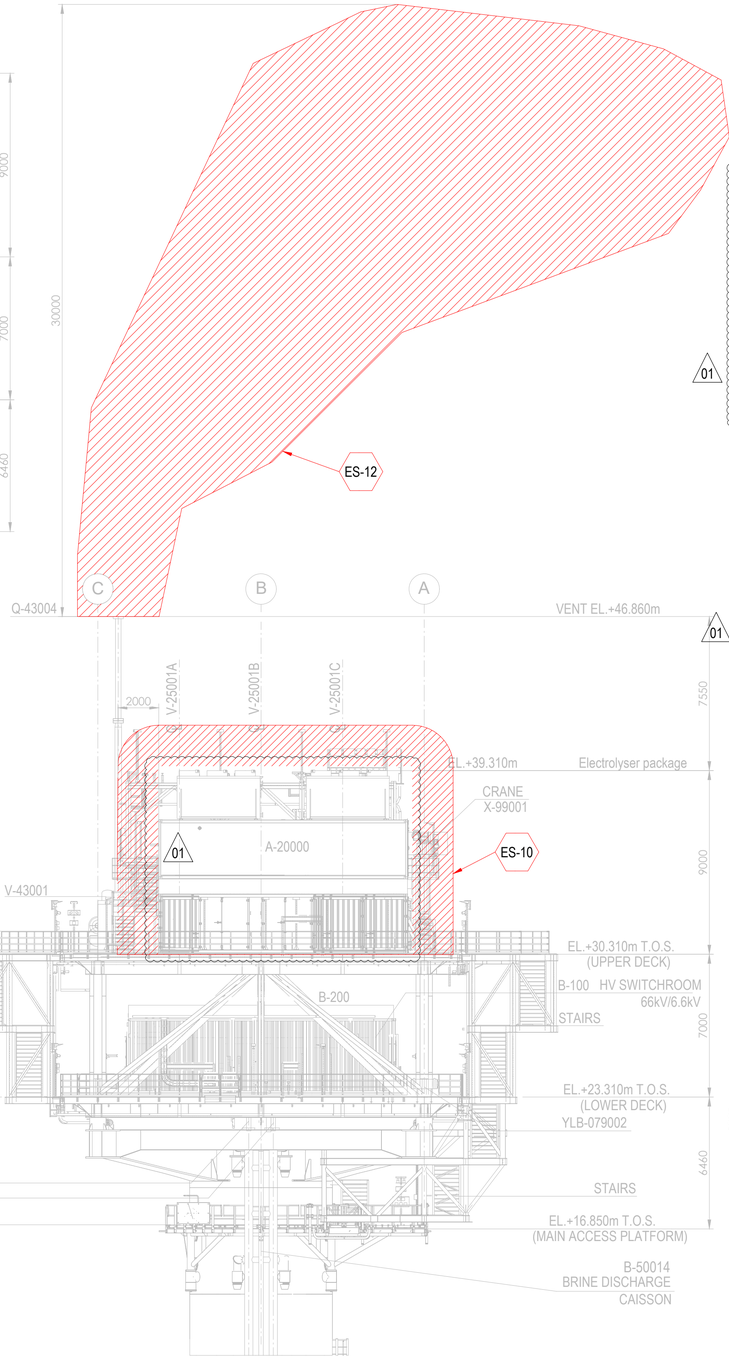

ELEVATION LOOKING NORTH

01

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

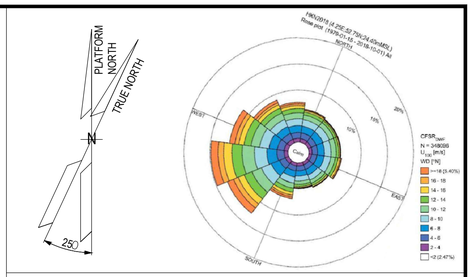

NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. (ES12) IS SHOWN ONLY ON ELEVATION LOOKING NORTH ON THIS LAYOUT
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

01

LEGEND

ZONE 0 | ZONE 1 | ZONE 2 | ES EMISSION SOURCES

01

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND | ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1	DRAWING NO. 123A90-DDL-SAF-DL-30024	SHEET 001	REV. 01

File Name : 123A90-DDL-SAF-DL-30024 Rev.01


DRAWING NO. DRAWING_NO.

REV. REV

V-25001_D

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

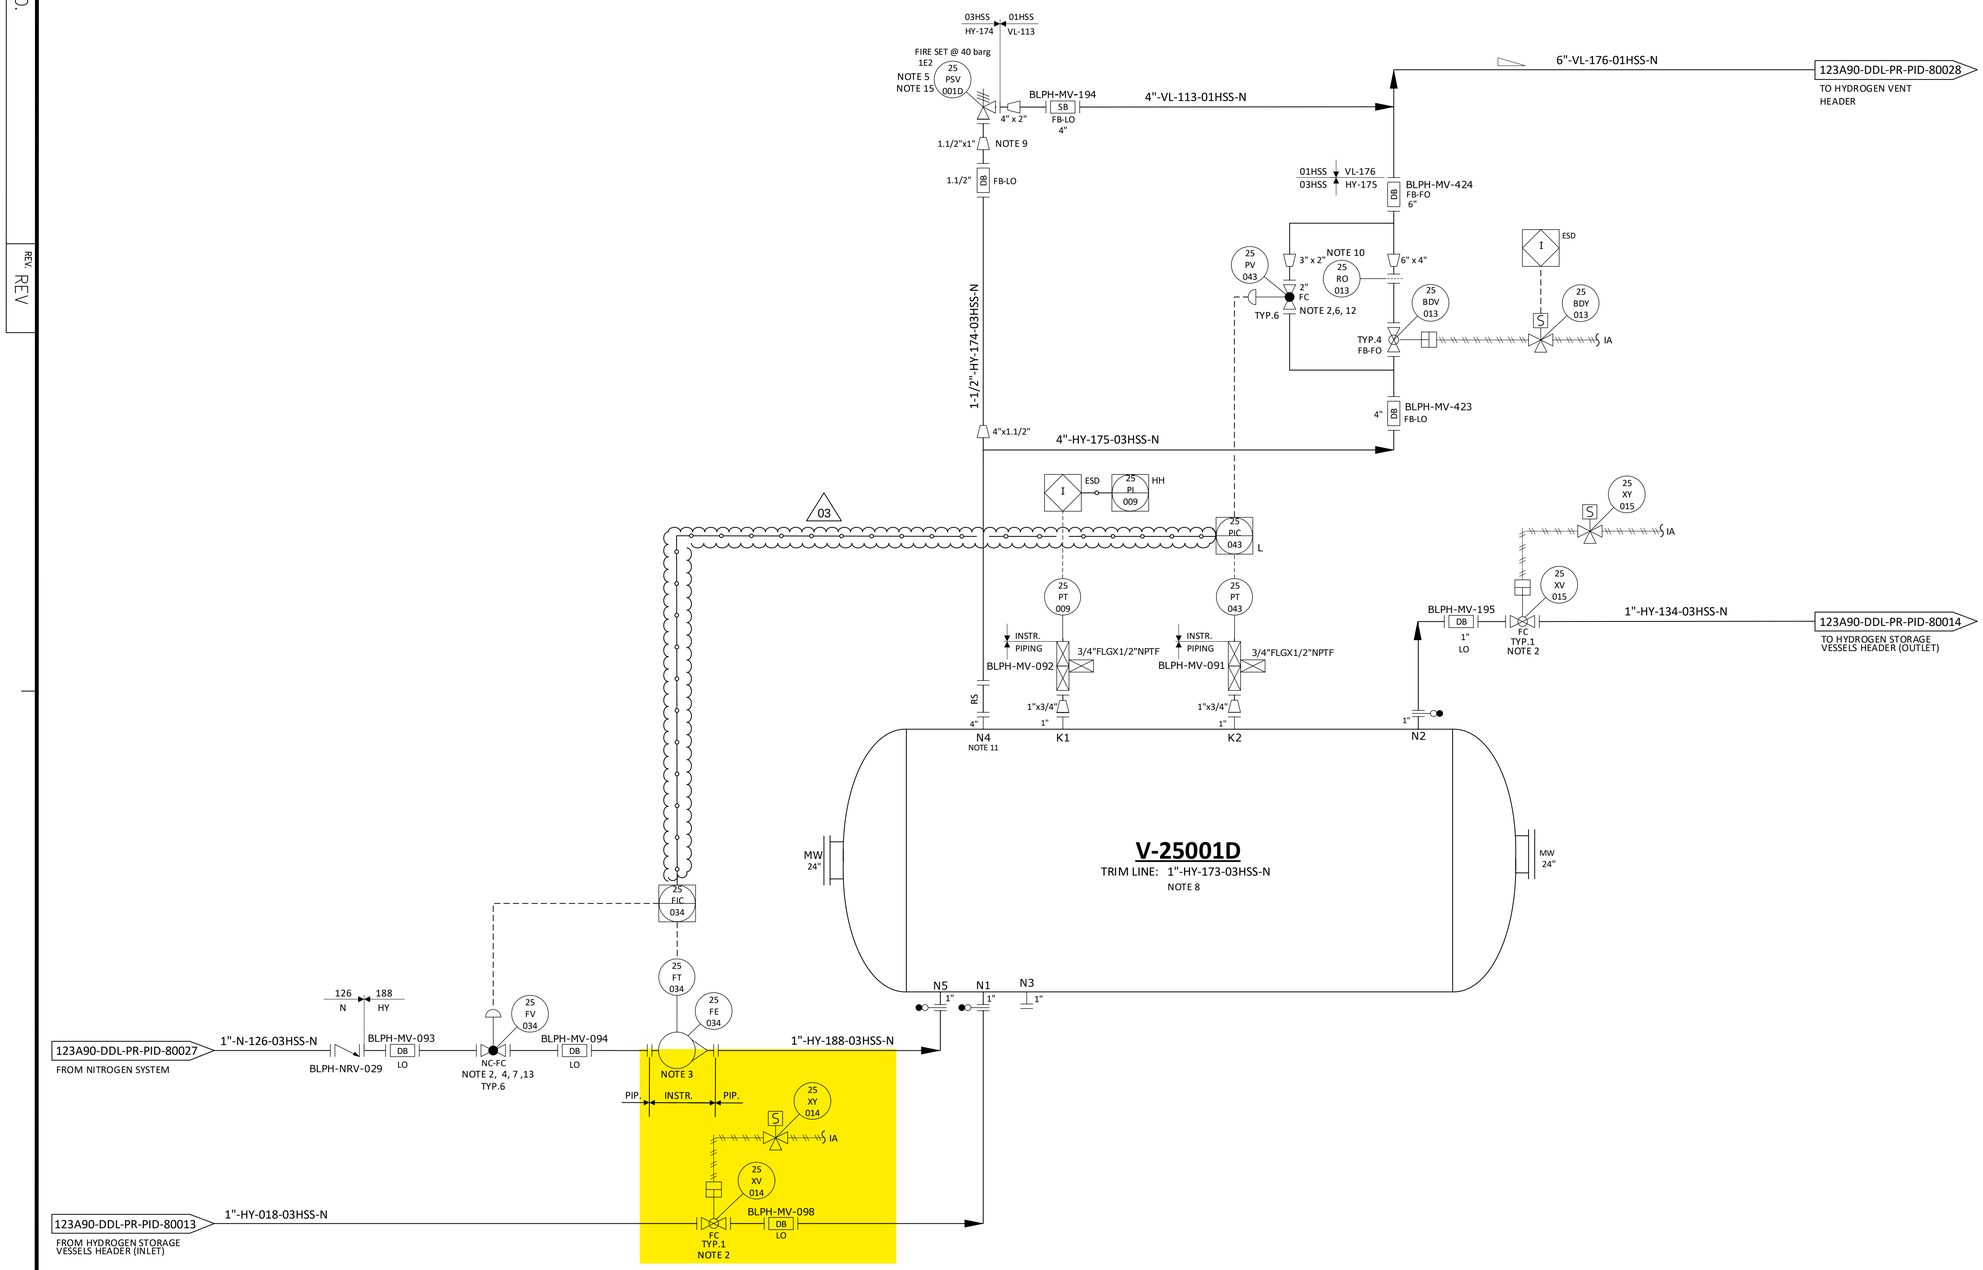

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS. 03
4. NITROGEN CONTROL VALVE (25-FV-034) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE.
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-043 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-043 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-034 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-043 HAS FAILED TO CLOSE.
15. 25-PSV-001D SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL D

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80018		SHEET 001	REV. 03

File Name : FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

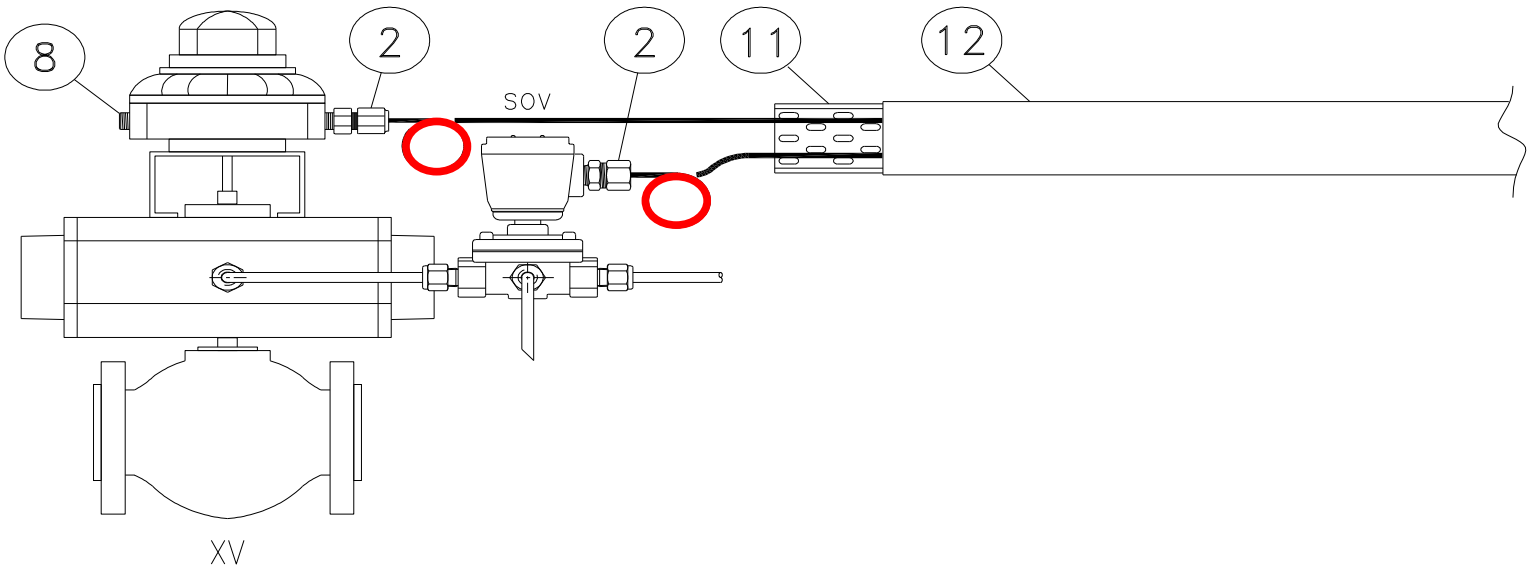

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**

REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi


ROSETTI MARINO SpA

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

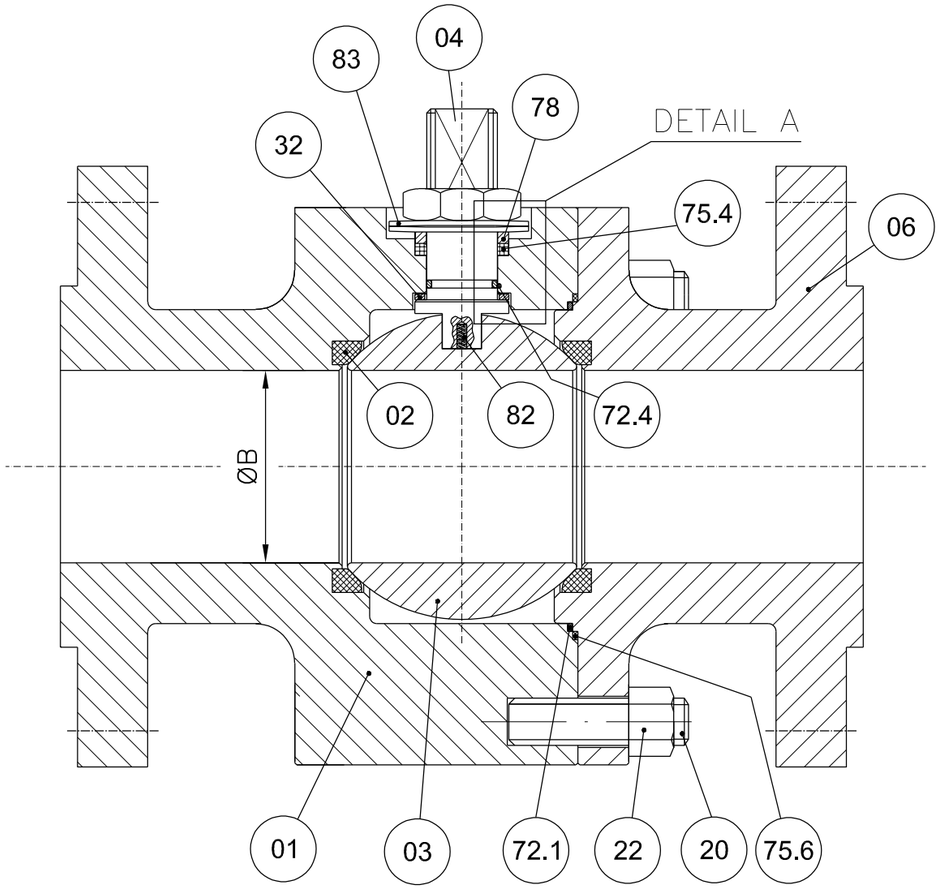


DETAIL A




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024
CHK'D: D.Barcella	DATE: 26/02/2024
APPV'D: L.Mora	DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: D240062-08

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-014	25
	2	Service				HYDROGEN STORAGE TANK V-25001D INLET	
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80018	Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-018-03HSS-N	
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm	1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L	NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN	
	8	Fluid State	Phase			GAS	GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40	
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29	80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40	
	14						
	15						
	16	Speed of	Design			Close : (12)	Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum	Open : -
	18						
	19						
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)	
	21	Body Size	Body Form			1"	FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L	(*)
	23	Connections	Rating			FLANGED ASME B16.5	#300
	24	Flange Finish	Gasket Material			RF	Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)	(*)
	26	Bolting				A193 B8M / A194 Gr. 8M	
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO	
	29	Fire Safe				(2)	
ACTUATOR	30	Manufacturer	Type			Rotork	Spring Return
	31	Model No.	Size			CP/S	035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal	Cylinder
	33	Ingress Protection	Certification			IP-66	II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE	CLOSE
	36	Fireproofing				NOT APPLICABLE	
	37	Solenoid Valve				25-XY-014 (9, 14, 15, 16) - Bifold FP06P	
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-014 (9, 17) - Soldo SS	25-ZSH-014 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED	
	40	Air Set	Handwheel			(*)	NOT REQUIRED
	41	Mounting Position				HORIZONTAL	
	42	Partial Stroke Test Facility				NOT REQUIRED	
	43	Control Type				-	
	44	Electrical Connection	Electrical Class			No. (*) / M20	H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-	
	47	Safety Valve	Model			-	-
	48	Check Valve	Mounting			-	-
PURCHASE	49	Manufacturer				FLUITEK	
	50	Model				FB3	
	51	Purchase Order Number				1724000204	

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

94	IFR	25-XV-009	floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR	25-XV-011	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR	25-XV-012	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR	25-XV-014	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR	25-XV-015	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR	25-XV-017	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR	25-XV-018	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

Document Reference: - D of C Baseefa14ATEX0223DR_01

EU Declaration of Conformity

Manufacturer: Bifold Fluidpower Ltd
Address: Broadgate, Oldham Broadway Business Park,
Chadderton, Oldham
Greater Manchester
OL9 9XA
UK

Tel: +44 (0)161-345-4777
E-mail: sales@bifold.co.uk

Product Type (Object of the Declaration):

Type SH, ASH & SC Filter Regulator

Declaration statement:

On behalf of the above company, I declare that, the *Object of the Declaration* described above is in conformity with the relevant Union harmonisation legislation: Directive 2014/34/EU, with the following limitation;

Limitation on the validity of the Declaration of Conformity:

None

Provisions of the Directive fulfilled by the Equipment:

Group II Category 2 Gb Db Ex c IIC T6

Bifold Technical File Reference:

DF-FP_SH_20140627114952

Technical File lodged with Notified Body:

SGS Fimko Oy 0598 Helsinki, Finland

SGS Baseefa Technical File Reference:

Baseefa14ATEX0223DR

Technical basis for compliance with the Essential Health and Safety Requirements of Directive 2014/34/EU: -

BS EN 13463-1: 2009 – Non-electrical equipment for use in potentially explosive atmospheres. Basic method and requirements
BS EN 13463-5: 2011 – Non-electrical equipment for use in potentially explosive atmospheres. Protection by constructional safety 'c'

(A review against the following harmonised standards, shows no significant changes relevant to this equipment): -

BS EN ISO 80079-36: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Basic method and requirements
BS EN ISO 80079-37: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Non-electrical type of protection constructional safety "c", control of ignition sources "b", liquid immersion "k"

Paul Barrow
Quality Manager

4th November 2020

ITEM	Tag	25-PCV-017	: Air Set Filter - Vessel V-25001E Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10001763	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		FL20524-1951			
Manufacturer	BIFOLD			**Model**		SH05-FR-SR-MD-10-X4			
Cert No.	D.o.C. by Manufacturer			**Equipment Ambient Temp.**		-20 °C to + 40 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		OK	
	Physical check	x	OK	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PCV-017	: Air Set Filter - Vessel V-25001E Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001763		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	25-PCV-017	: Air Set Filter - Vessel V-25001E Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001763	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM (ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-29	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:40:21.030Z	PROVERLIS Digitaly signed by Luca Mussi 2025-01-30T16:20:51.404Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

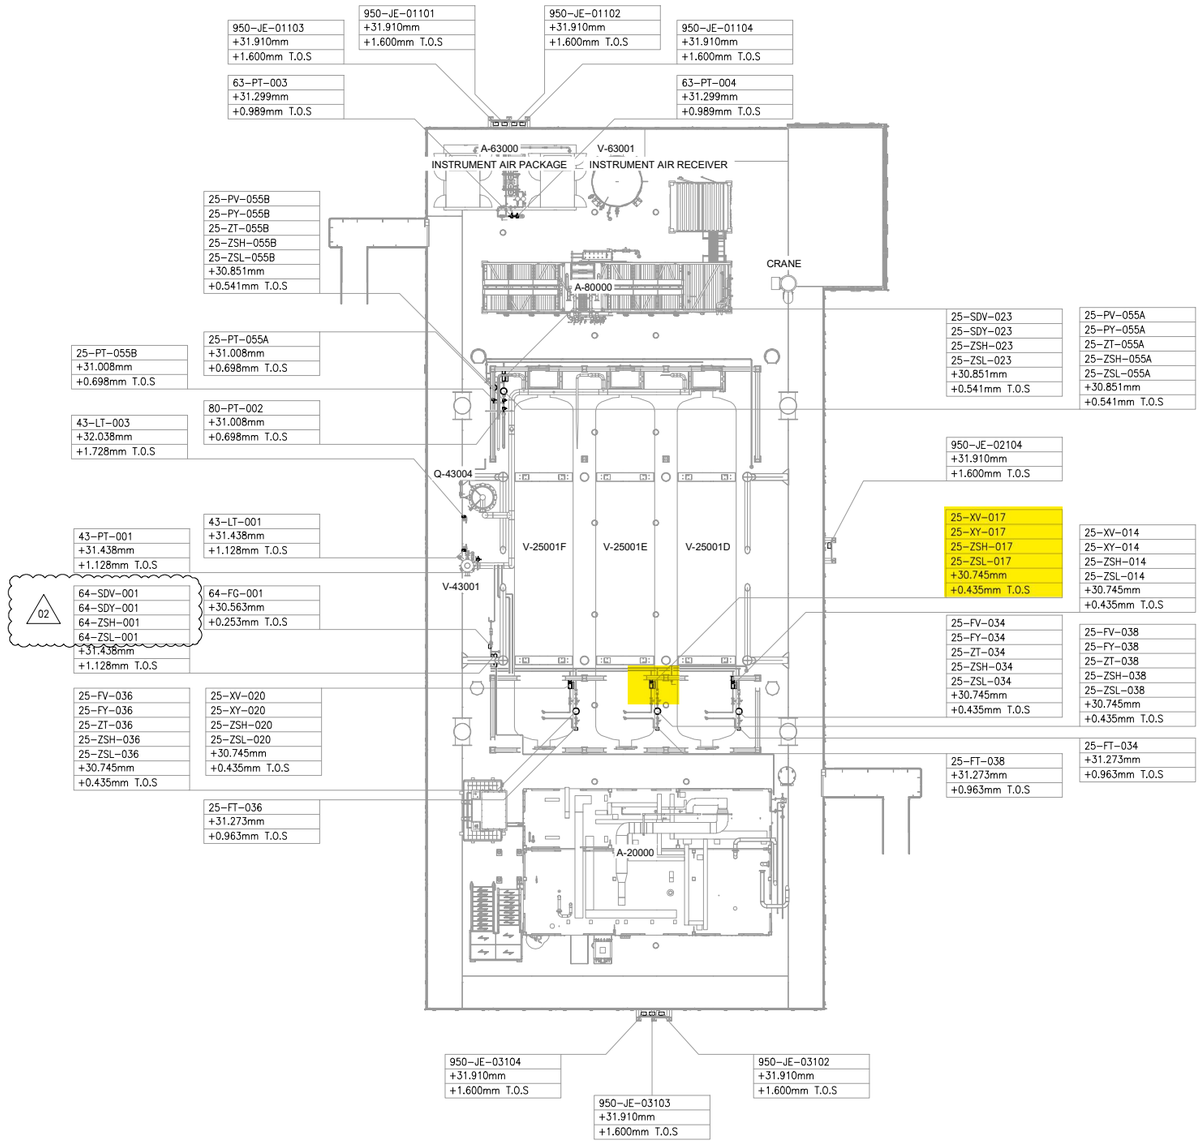


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 E

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

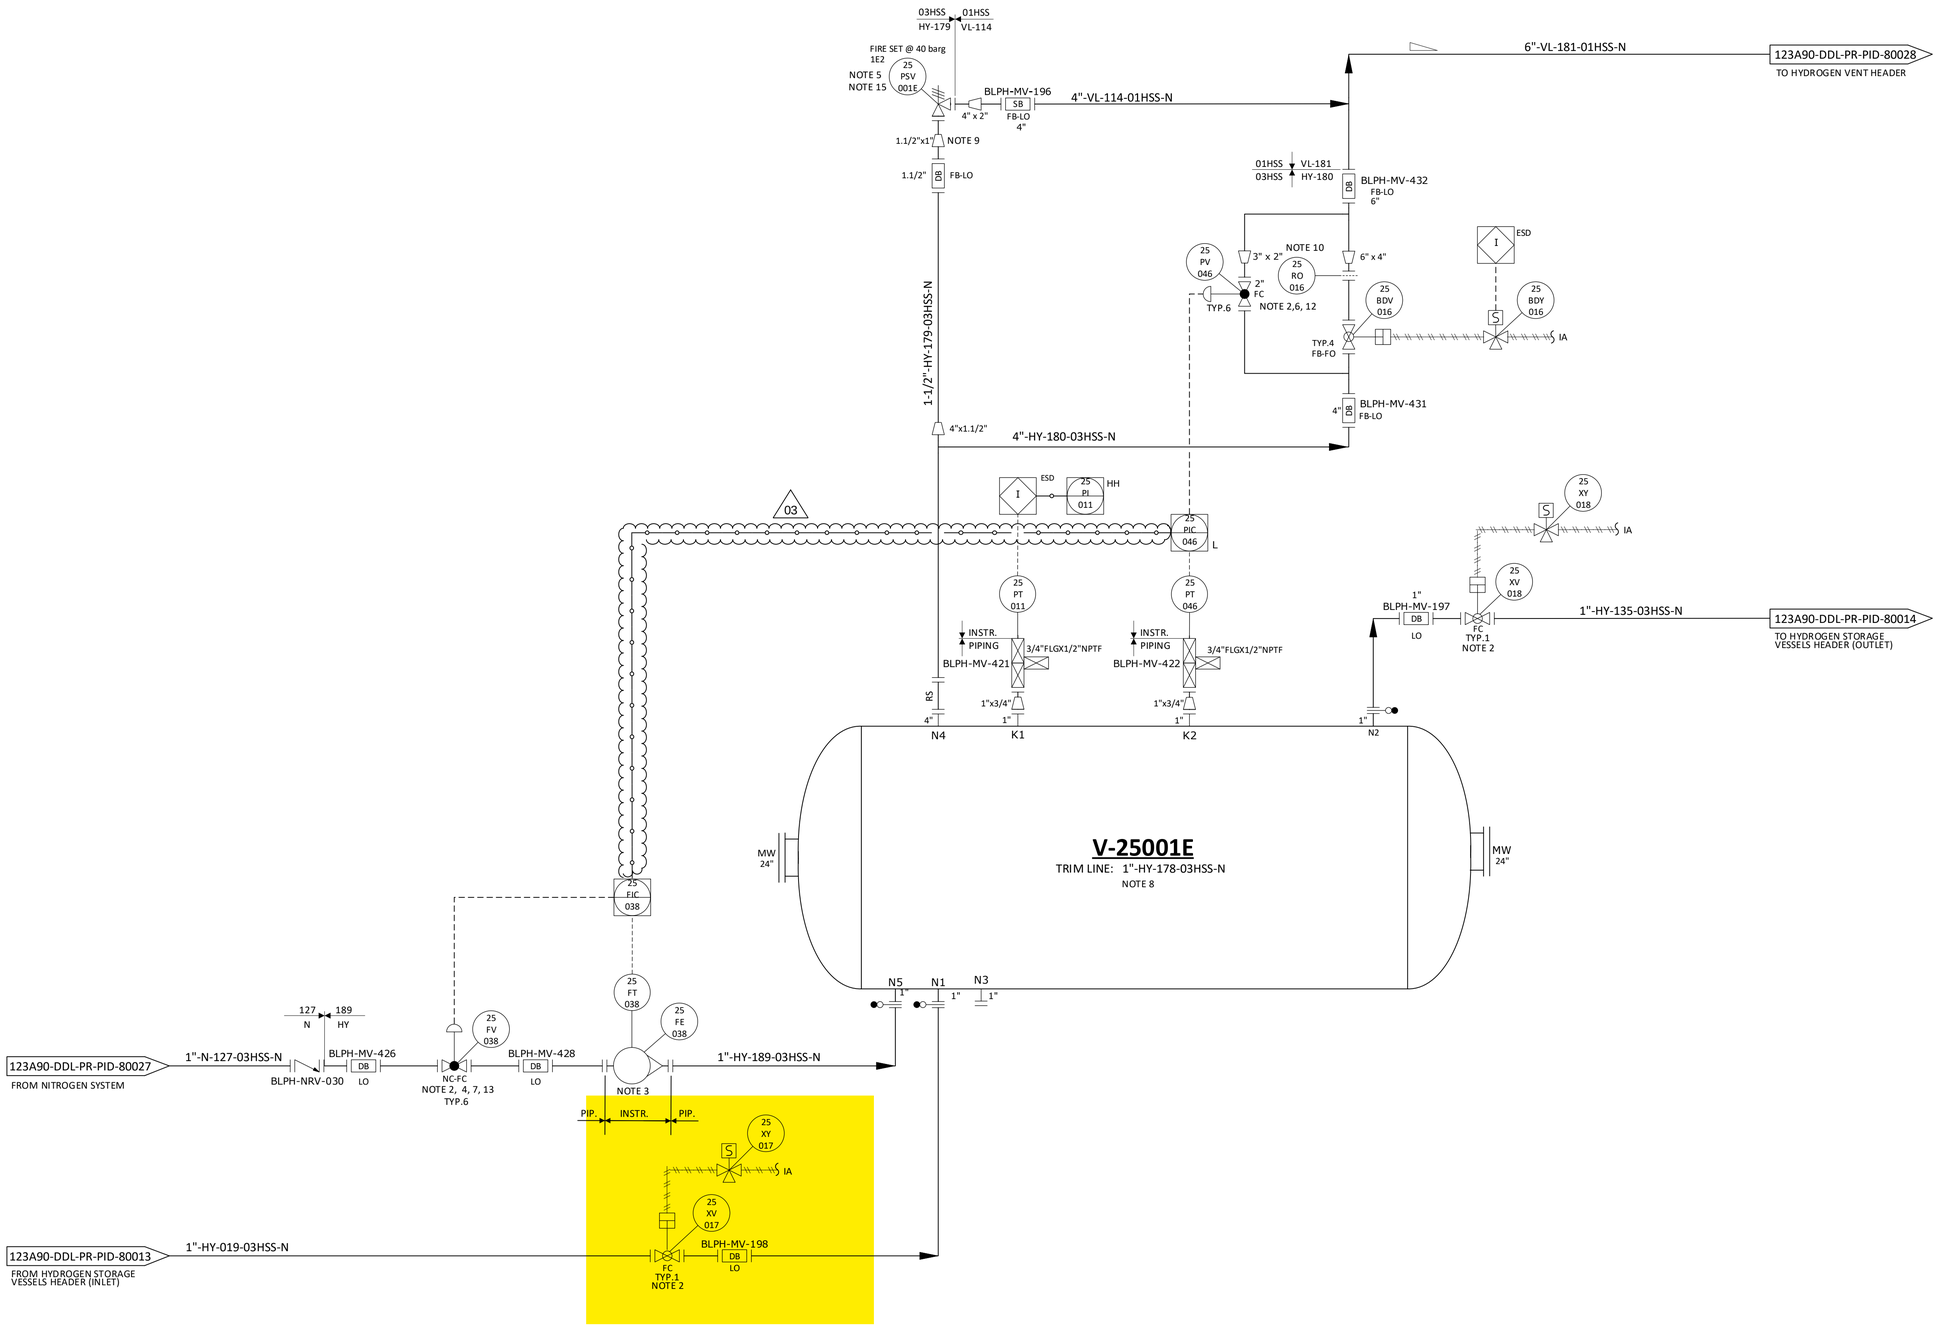

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-038) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-046 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-046 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-038 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-046 HAS FAILED TO CLOSE.
15. 25-PSV-001E SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL E

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE		
A1	DRAWING NO. 123A90-DDL-PR-PID-80019			SHEET 001	REV. 03

File Name = FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

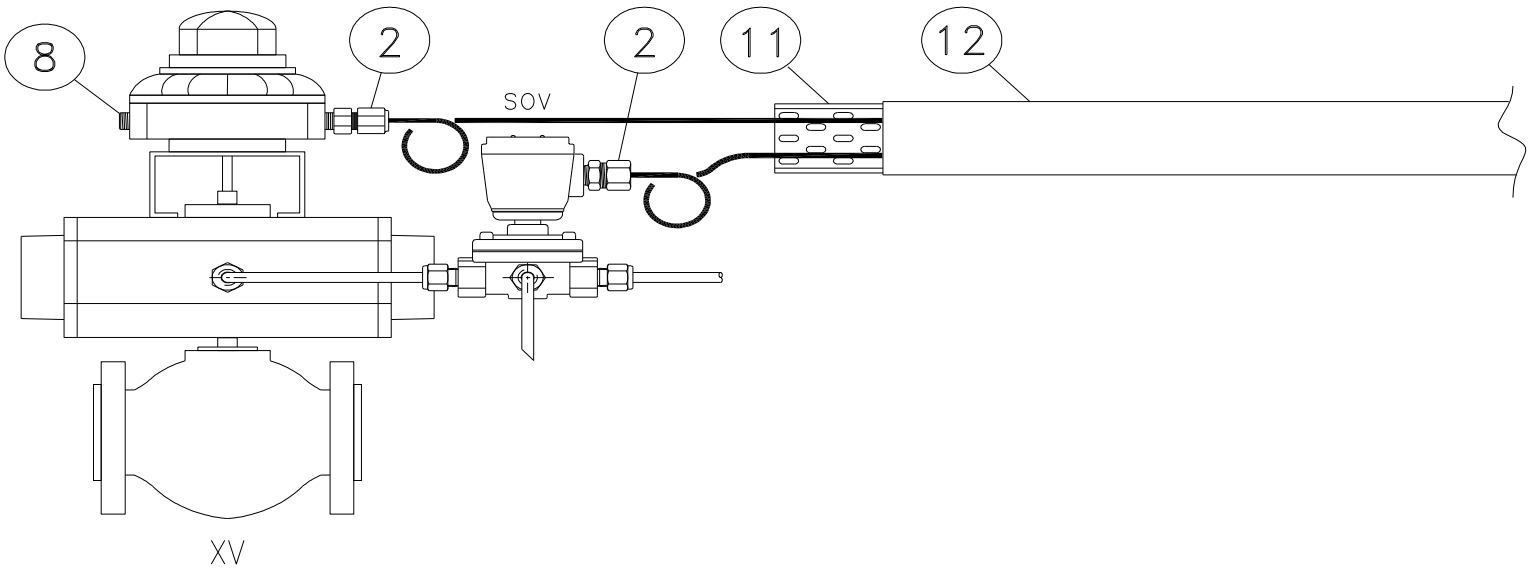

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_B	06/11/24	G.Randi

ROSETTI MARINO SpA


NOTE:

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

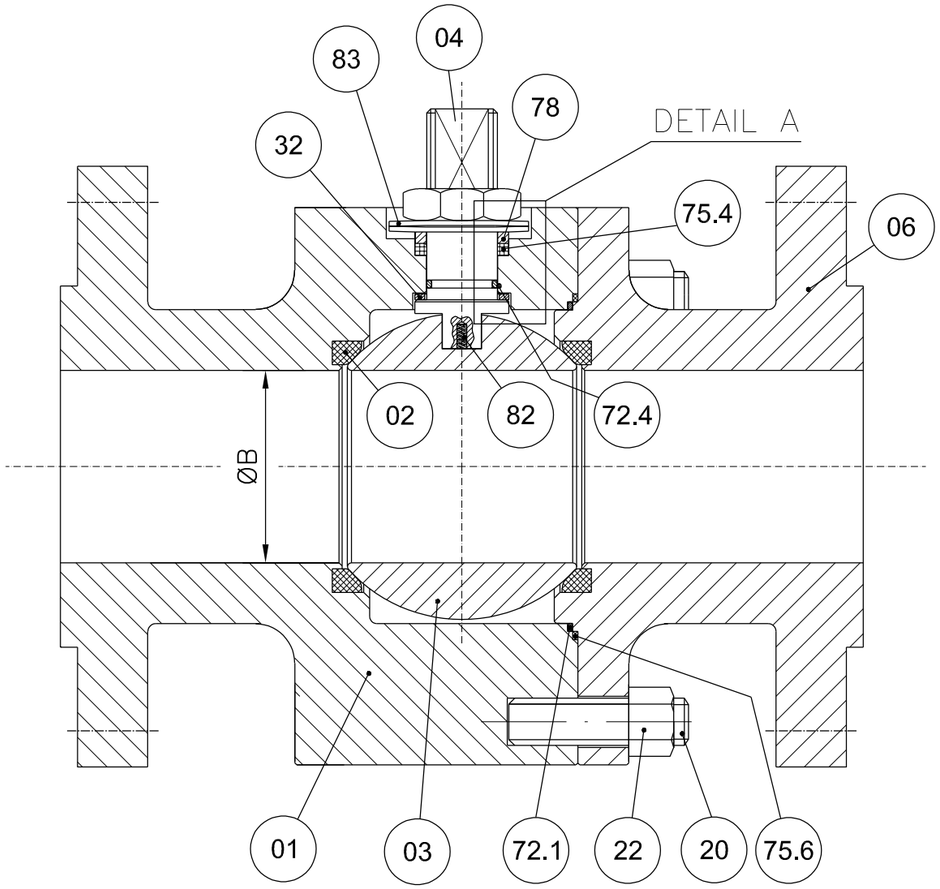


DETAIL A




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: D240062-08 — Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-017		25
	2	Service				HYDROGEN STORAGE TANK V-25001E INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80019		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-019-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-017 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-017 (9, 17) - Soldo SS		25-ZSH-017 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

94	IFR	25-XV-009	floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR	25-XV-011	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR	25-XV-012	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR	25-XV-014	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR	25-XV-015	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR	25-XV-017	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR	25-XV-018	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

Document Reference: - D of C Baseefa14ATEX0223DR_01

EU Declaration of Conformity

Manufacturer: Bifold Fluidpower Ltd
Address: Broadgate, Oldham Broadway Business Park,
Chadderton, Oldham
Greater Manchester
OL9 9XA
UK

Tel: +44 (0)161-345-4777
E-mail: sales@bifold.co.uk

Product Type (Object of the Declaration):

Type SH, ASH & SC Filter Regulator

Declaration statement:

On behalf of the above company, I declare that, the *Object of the Declaration* described above is in conformity with the relevant Union harmonisation legislation: Directive 2014/34/EU, with the following limitation;

Limitation on the validity of the Declaration of Conformity:

None

Provisions of the Directive fulfilled by the Equipment:

Group II Category 2 Gb Db Ex c IIC T6

Bifold Technical File Reference:

DF-FP_SH_20140627114952

Technical File lodged with Notified Body:

SGS Fimko Oy 0598 Helsinki, Finland

SGS Baseefa Technical File Reference:

Baseefa14ATEX0223DR

Technical basis for compliance with the Essential Health and Safety Requirements of Directive 2014/34/EU: -

BS EN 13463-1: 2009 – Non-electrical equipment for use in potentially explosive atmospheres. Basic method and requirements
BS EN 13463-5: 2011 – Non-electrical equipment for use in potentially explosive atmospheres. Protection by constructional safety 'c'

(A review against the following harmonised standards, shows no significant changes relevant to this equipment): -


BS EN ISO 80079-36: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Basic method and requirements
BS EN ISO 80079-37: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Non-electrical type of protection constructional safety "c", control of ignition sources "b", liquid immersion "k"

Paul Barrow
Quality Manager


4th November 2020

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

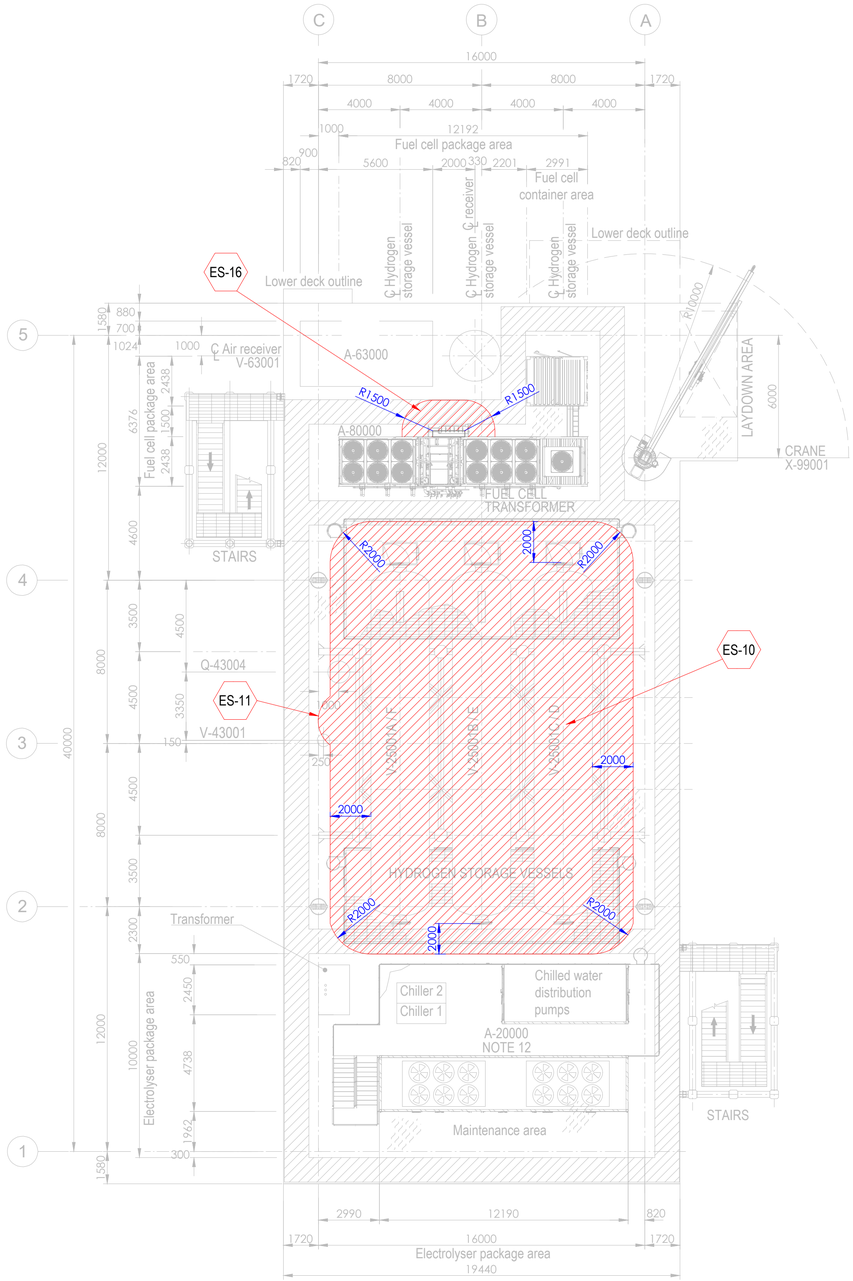


PLAN ON UPPER DECK
EL+30.310 T.O.S.

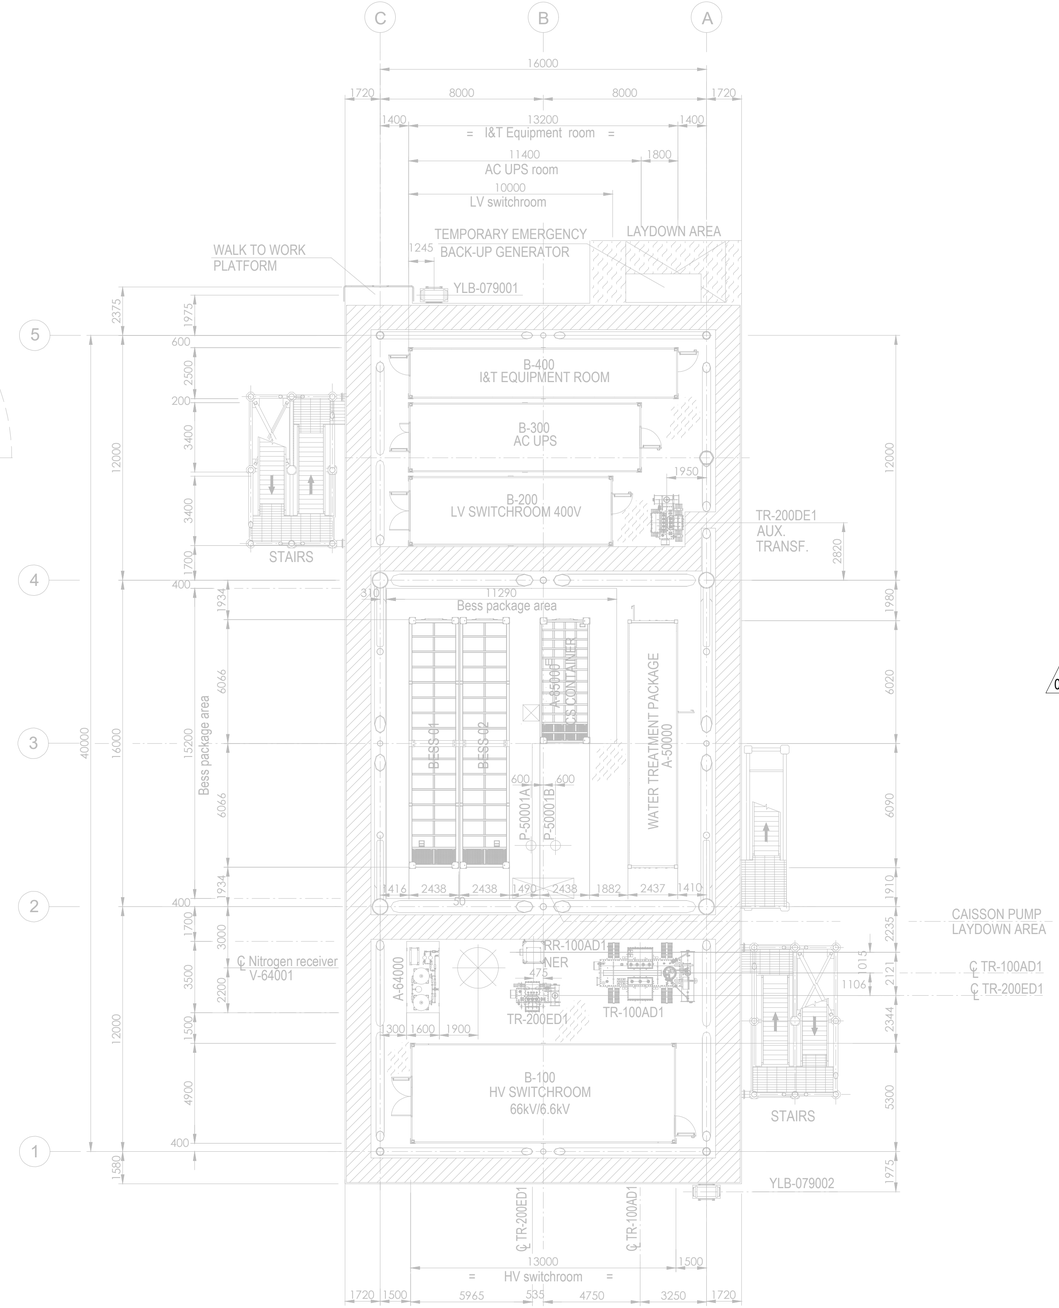

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

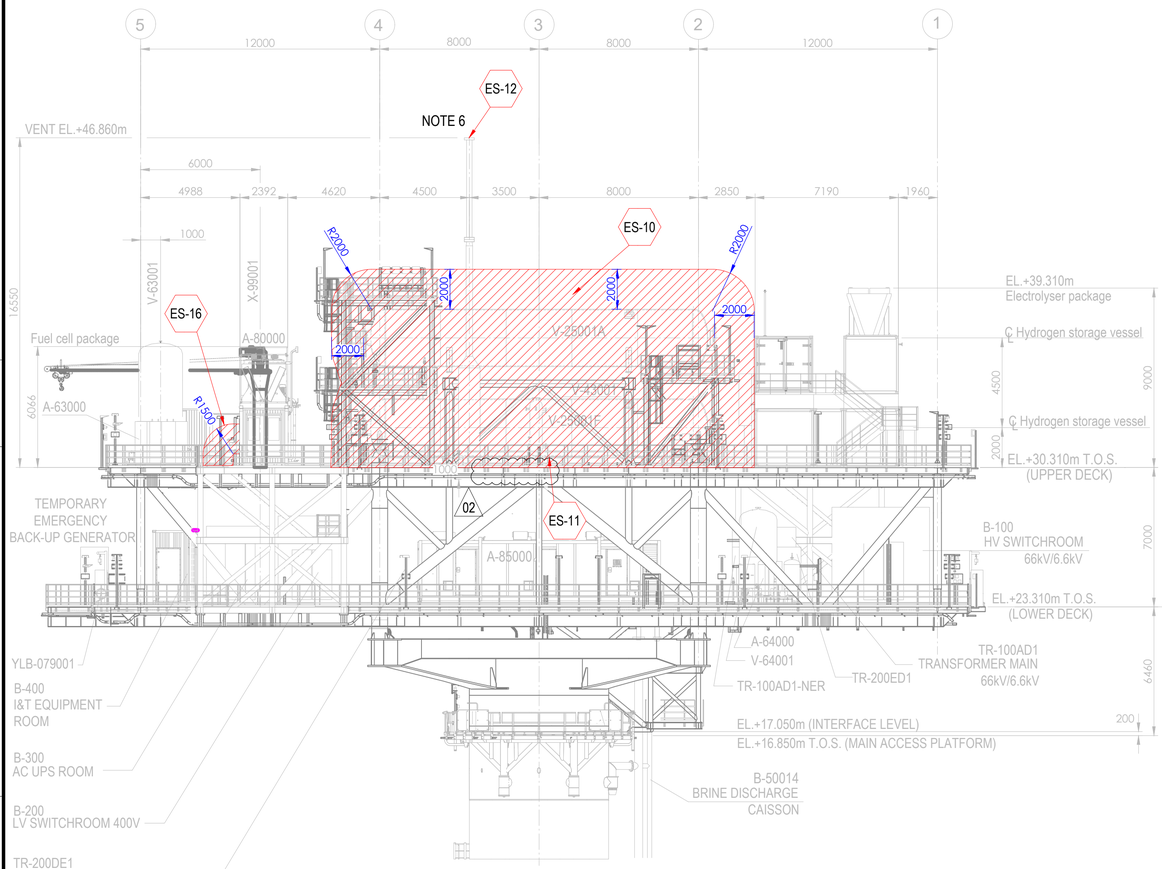



ELEVATION LOOKING EAST

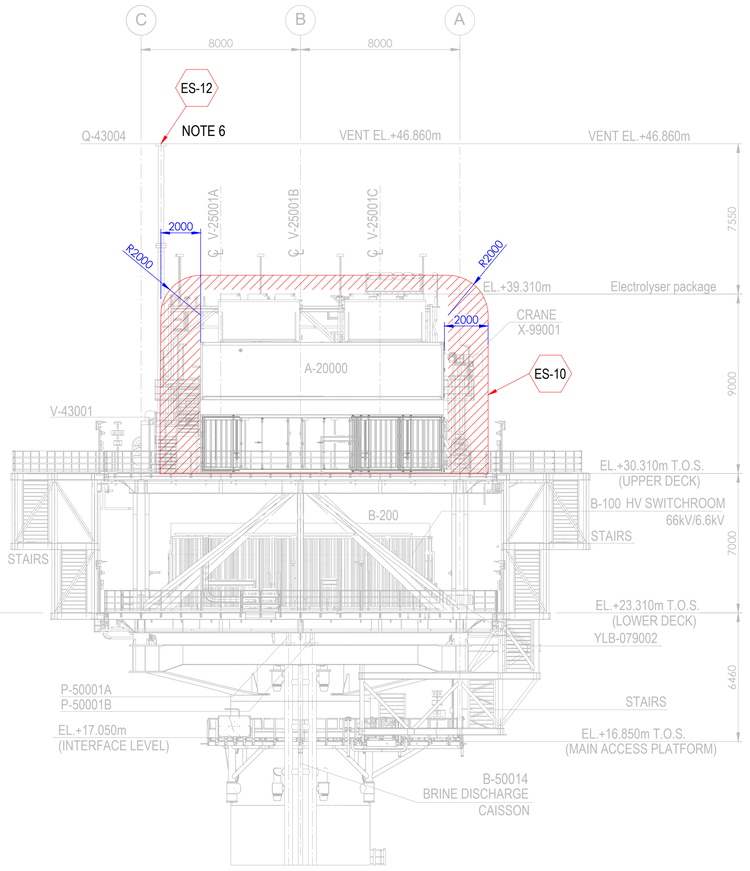

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

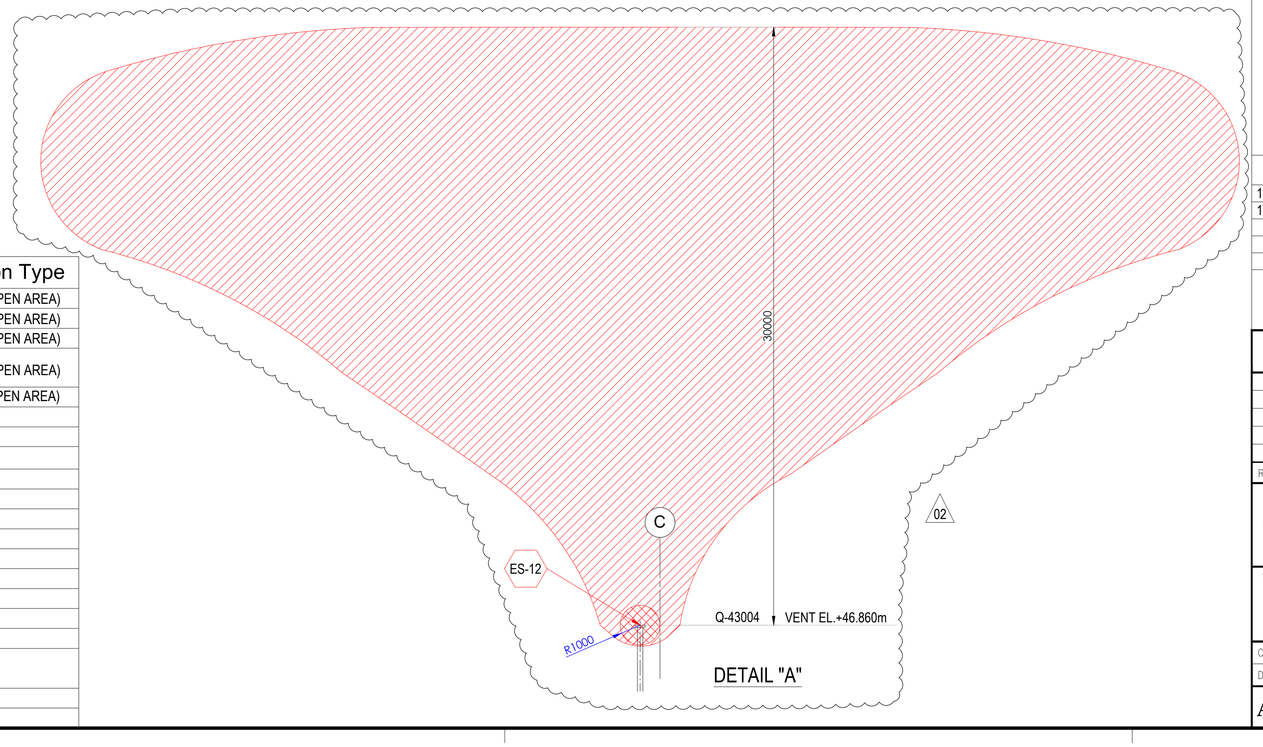



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PCV-020	: Air Set Filter - Vessel V-25001F Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80020		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001765	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		FL40524-1500			
Manufacturer	BIFOLD			**Model**		SH05-FR-SR-MD-10-X4			
Cert No.	D.o.C. by Manufacturer			**Equipment Ambient Temp.**		-20 °C to + 40 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		OK	
	Physical check	x	OK	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PCV-020	: Air Set Filter - Vessel V-25001F Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80020
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001765		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-PCV-020	: Air Set Filter - Vessel V-25001F Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80020
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001765		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01
							Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-29	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:41:03.616Z	PROVERLIS Digitaly signed by Luca Mussi 2025-01-30T16:24:28.277Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

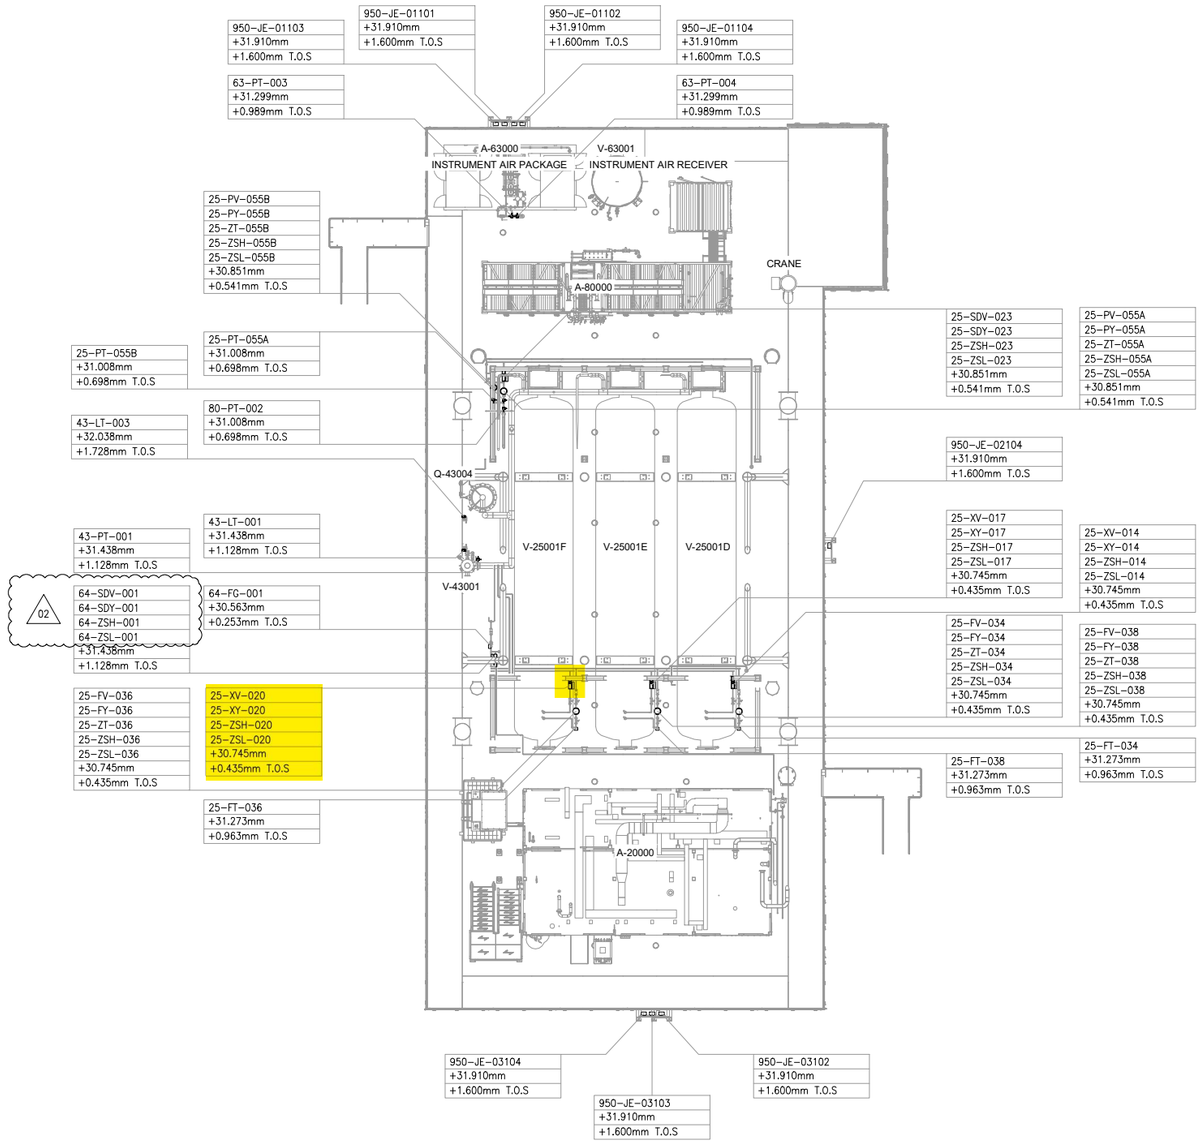


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90-DDL-IN-DL-40081	001	02

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001_F

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

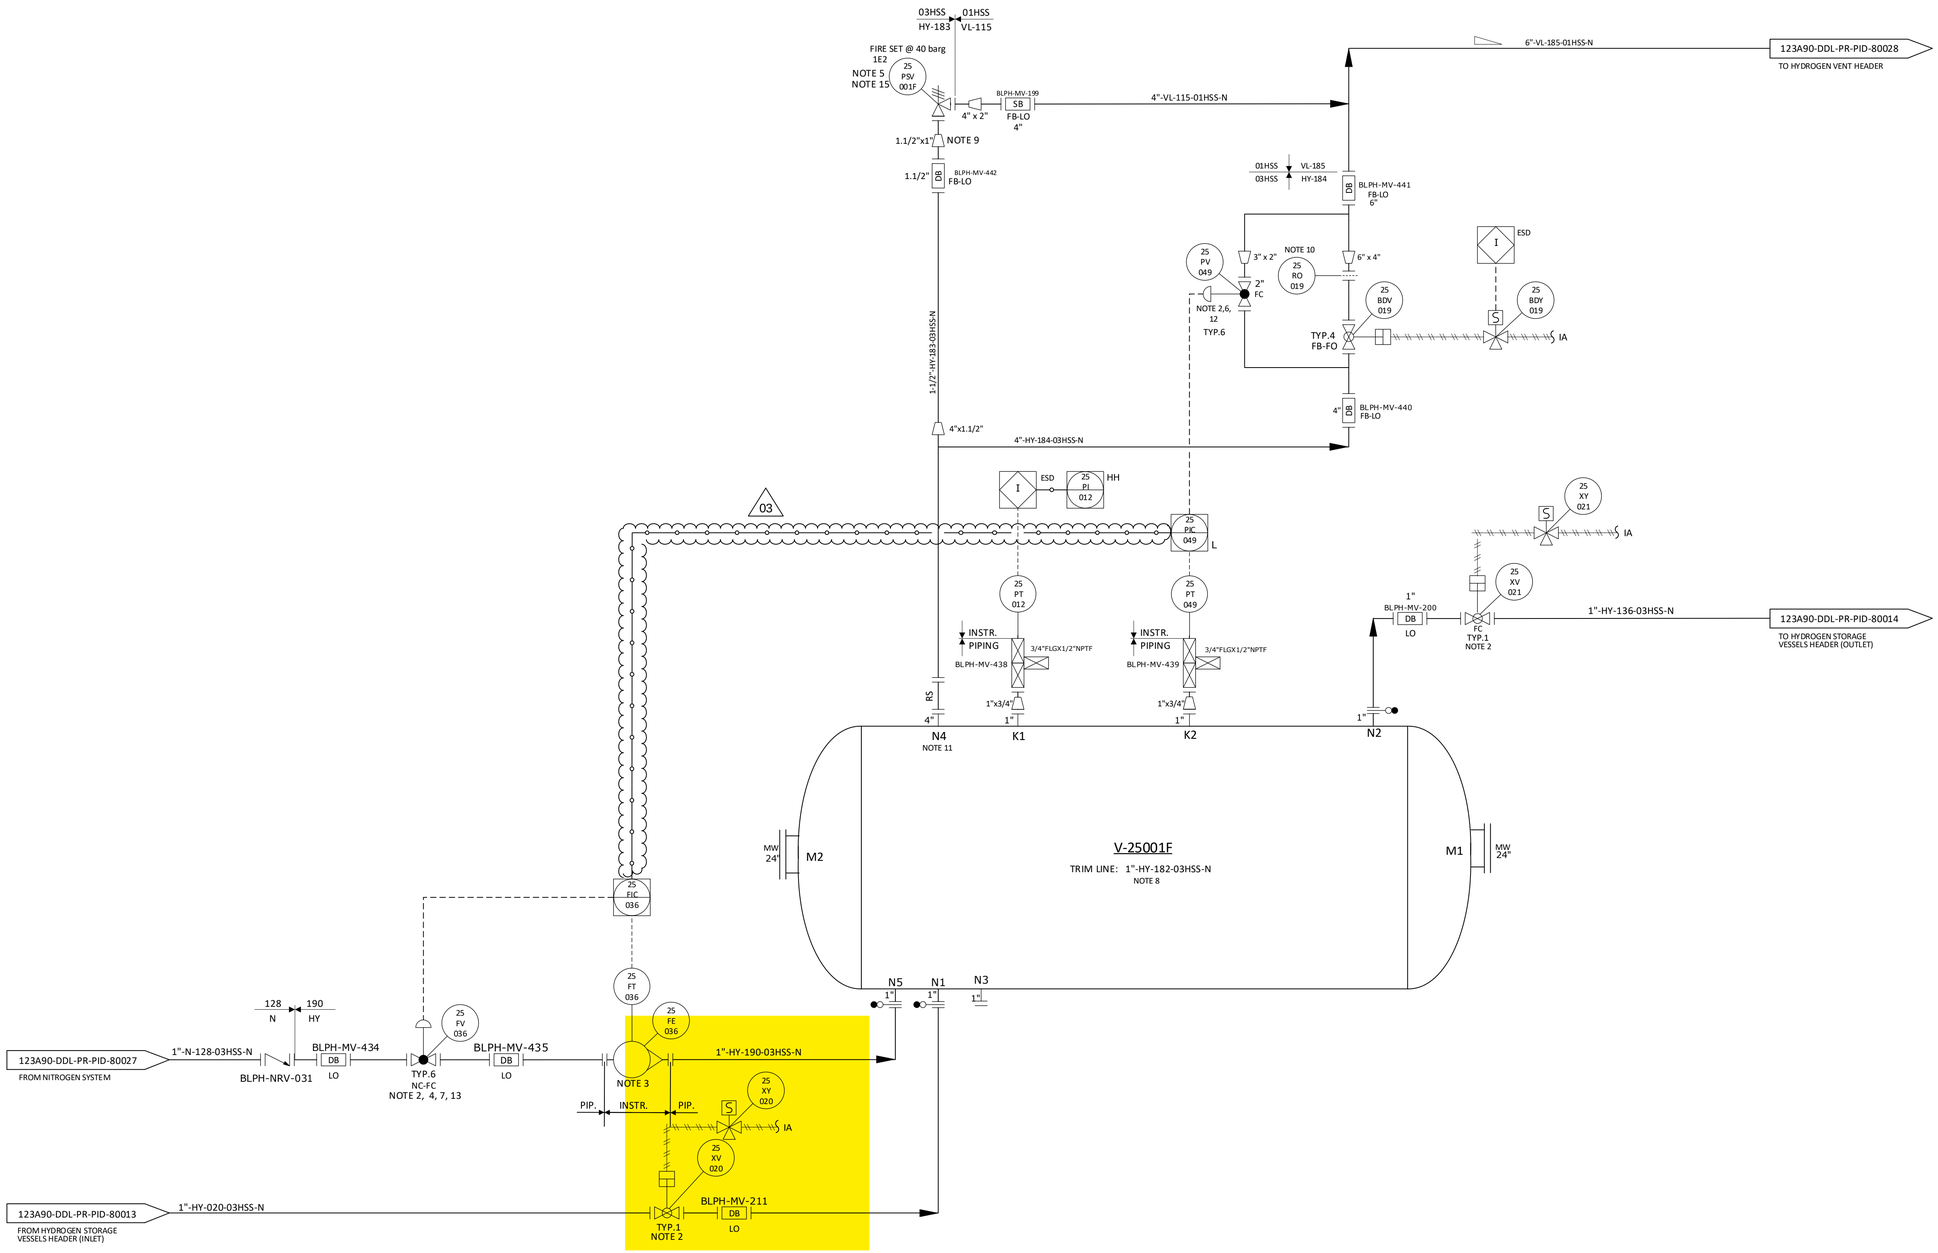

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-036) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-049 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-049 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25FV036 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-049 HAS FAILED TO CLOSE.
15. 25-PSV-001F SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR HAZOP (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL F

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80020		SHEET 001	REV. 03

File Name = FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

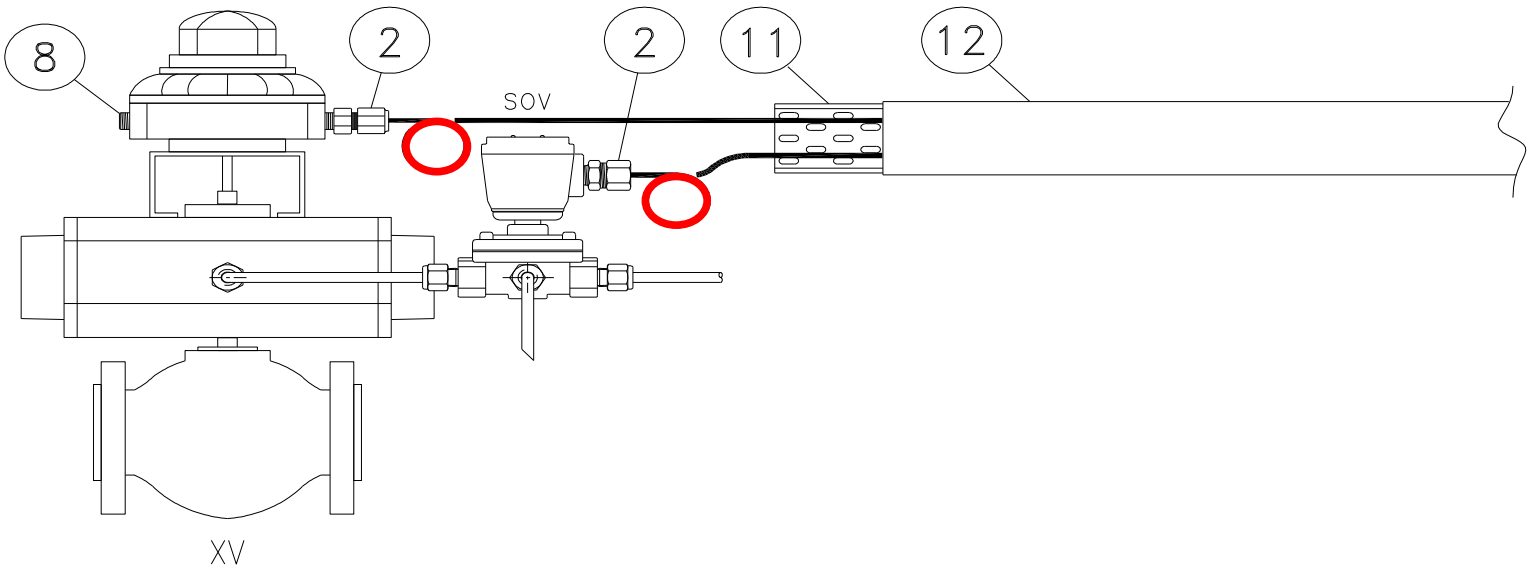

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

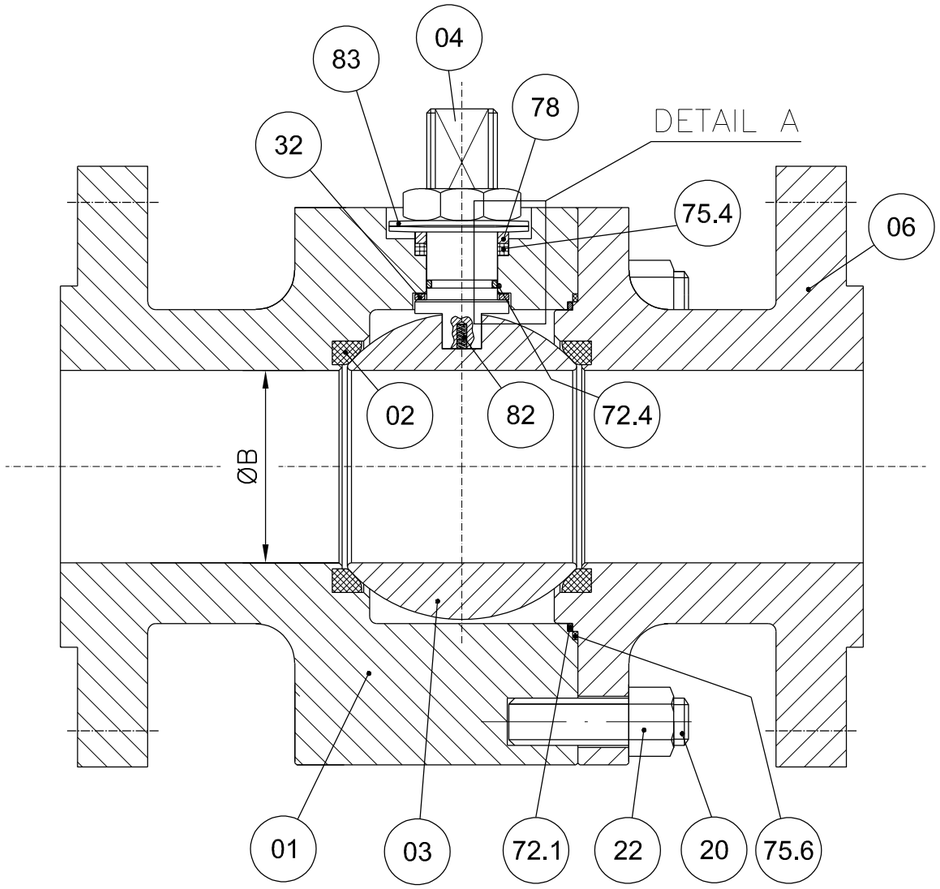




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

1 Rev.

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

1 Rev.

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: **D240062-08** Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-020		25
	2	Service				HYDROGEN STORAGE TANK V-25001F INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80020		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-020-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-020 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-020 (9, 17) - Soldo SS		25-ZSH-020 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

140	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
141	IFR	25-XV-020	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
142	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
143	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620210001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
144	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
145	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
146	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323304	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
147	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
148	IFR	25-XV-021	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
149	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
150	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620220001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
151	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
152	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
153	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323297	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
154	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
155	IFR	25-XV-024	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
156	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
157	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620230001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
158	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
159	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
160	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323291	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
161	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
162	IFR	50-XV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
163	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
164	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620240001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
165	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
166	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
167	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323289	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
168	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
169	IFR	50-XV-002	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
170	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
171	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620250001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
172	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
173	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
174	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323290	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
175	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
176	IFR	50-XV-003	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
177	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
178	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620260001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
179	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
180	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
181	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323299	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
182	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
183	IFR	50-XV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
184	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
185	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620270001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
186	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

Document Reference: - D of C Baseefa14ATEX0223DR_01

EU Declaration of Conformity

Manufacturer: Bifold Fluidpower Ltd
Address: Broadgate, Oldham Broadway Business Park,
Chadderton, Oldham
Greater Manchester
OL9 9XA
UK

Tel: +44 (0)161-345-4777
E-mail: sales@bifold.co.uk

Product Type (Object of the Declaration):

Type SH, ASH & SC Filter Regulator

Declaration statement:

On behalf of the above company, I declare that, the *Object of the Declaration* described above is in conformity with the relevant Union harmonisation legislation: Directive 2014/34/EU, with the following limitation;

Limitation on the validity of the Declaration of Conformity:

None

Provisions of the Directive fulfilled by the Equipment:

Group II Category 2 Gb Db Ex c IIC T6

Bifold Technical File Reference:

DF-FP_SH_20140627114952

Technical File lodged with Notified Body:

SGS Fimko Oy 0598 Helsinki, Finland

SGS Baseefa Technical File Reference:

Baseefa14ATEX0223DR

Technical basis for compliance with the Essential Health and Safety Requirements of Directive 2014/34/EU: -

BS EN 13463-1: 2009 – Non-electrical equipment for use in potentially explosive atmospheres. Basic method and requirements
BS EN 13463-5: 2011 – Non-electrical equipment for use in potentially explosive atmospheres. Protection by constructional safety 'c'

(A review against the following harmonised standards, shows no significant changes relevant to this equipment): -


BS EN ISO 80079-36: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Basic method and requirements
BS EN ISO 80079-37: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Non-electrical type of protection constructional safety "c", control of ignition sources "b", liquid immersion "k"

Paul Barrow
Quality Manager


4th November 2020

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

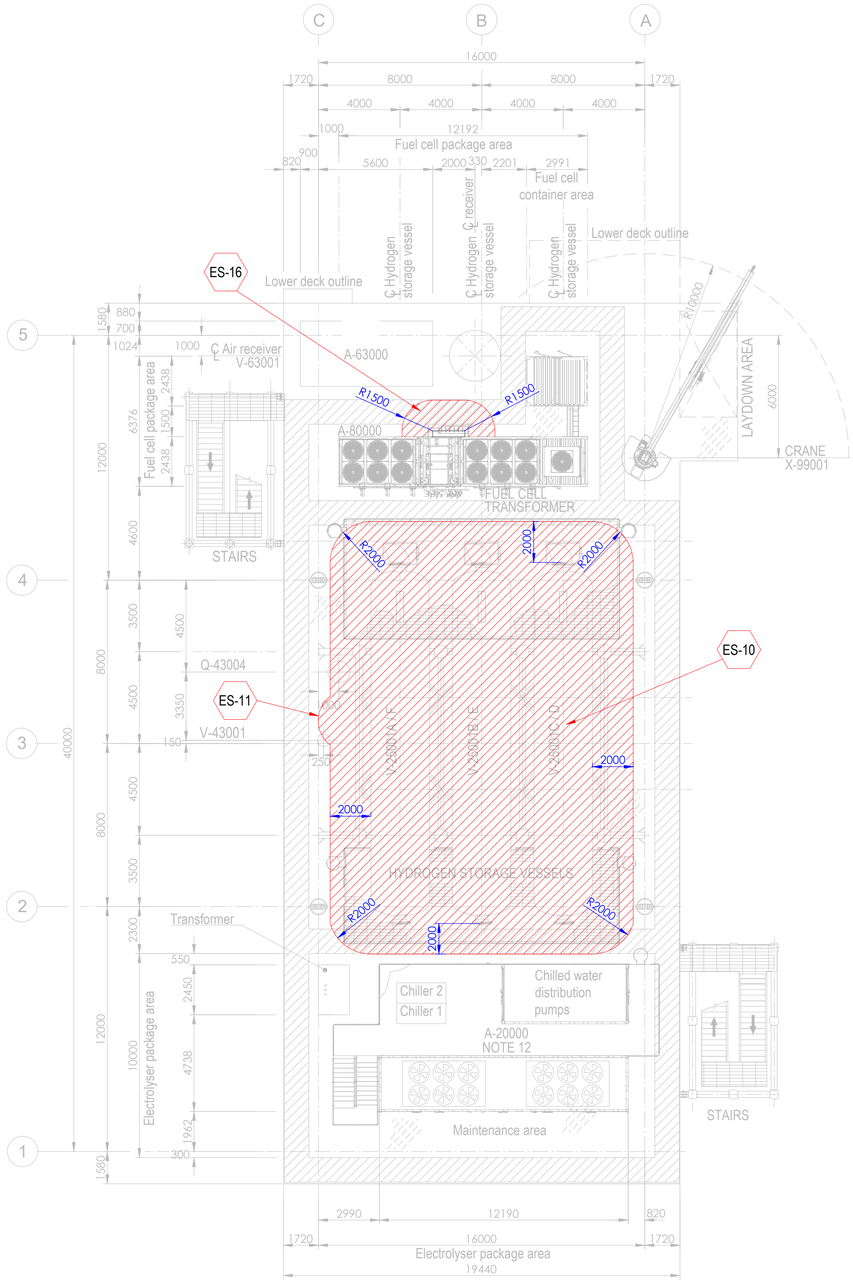


PLAN ON UPPER DECK
EL+30.310 T.O.S.

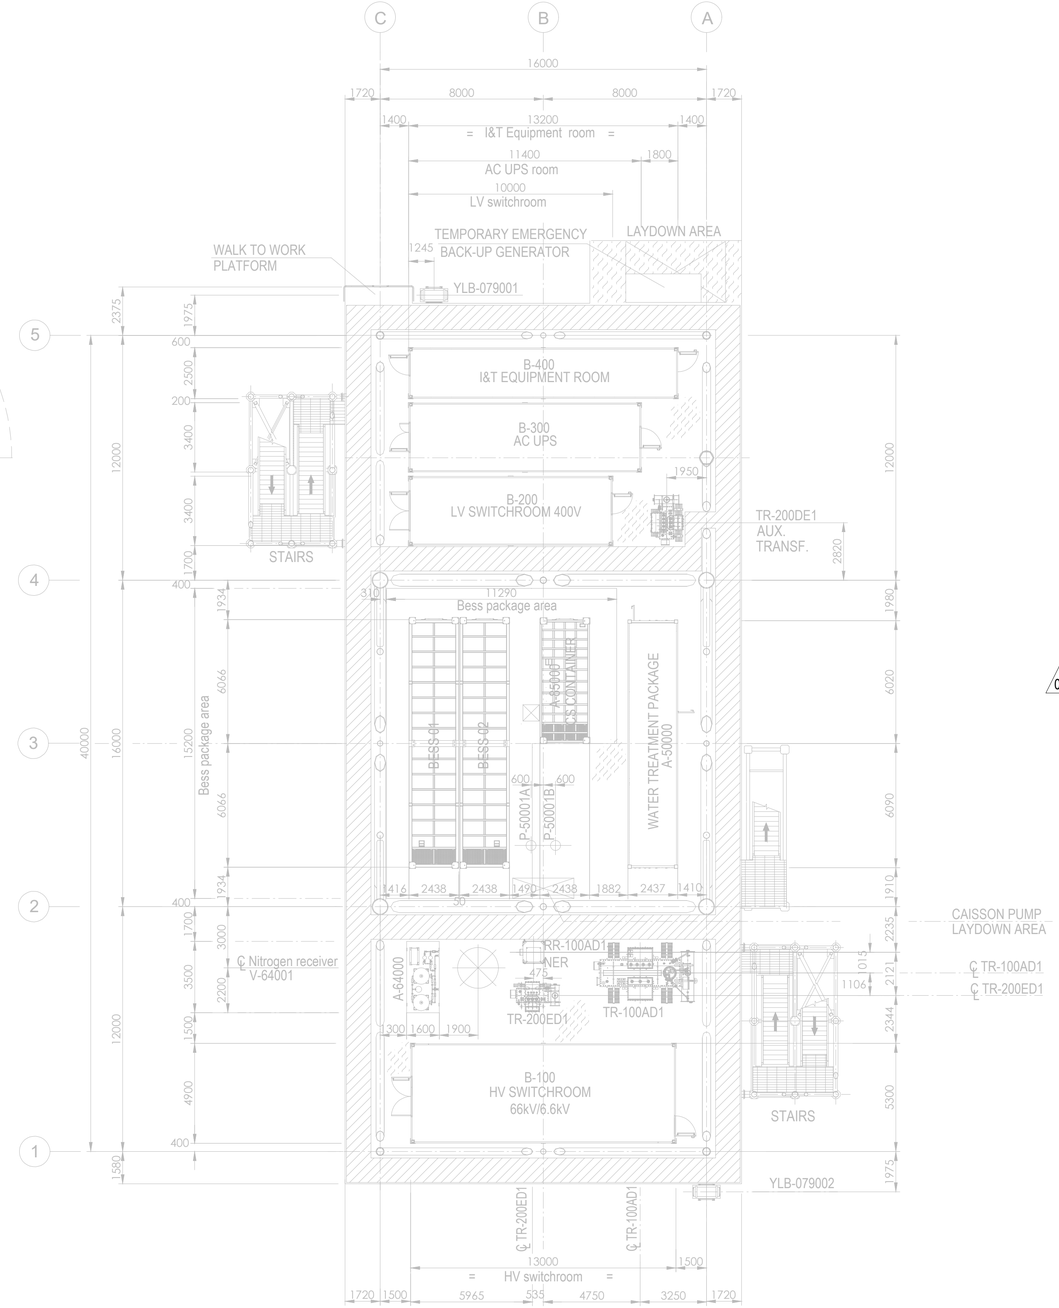

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

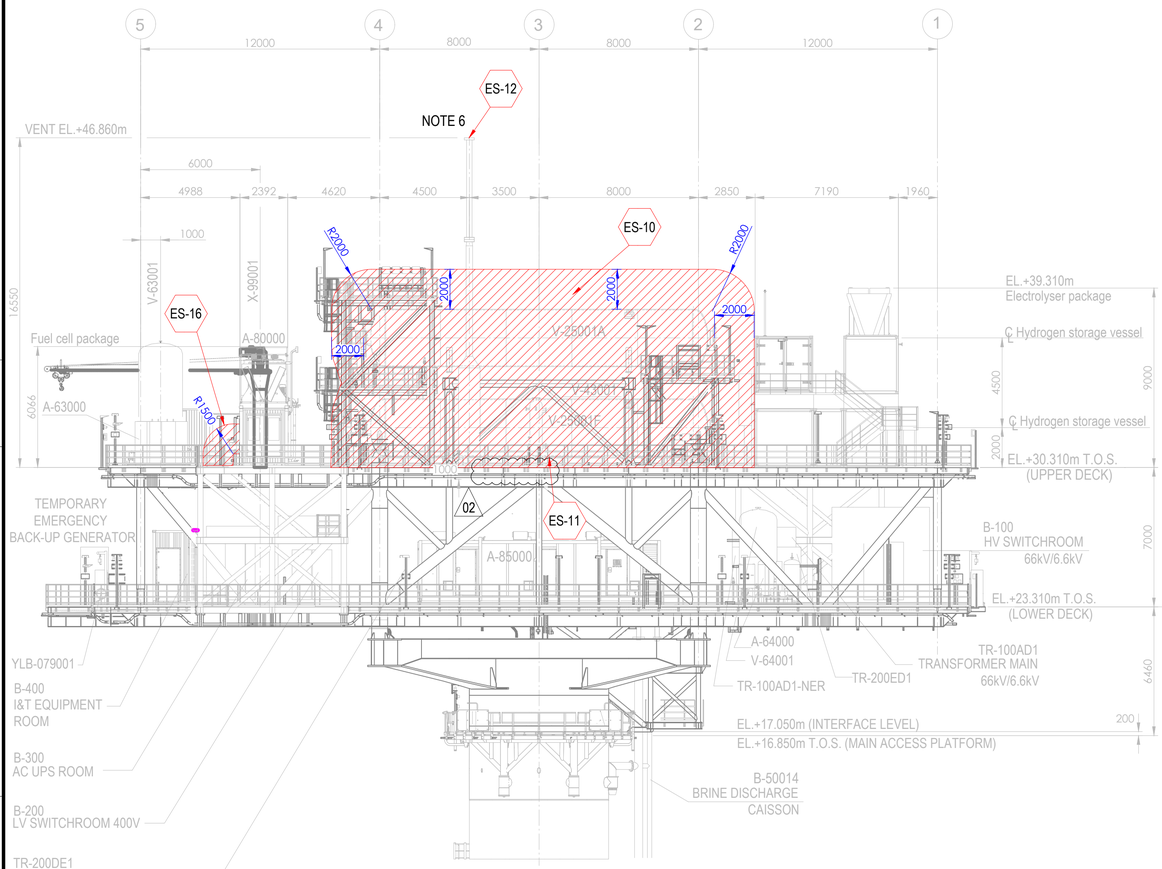



ELEVATION LOOKING EAST

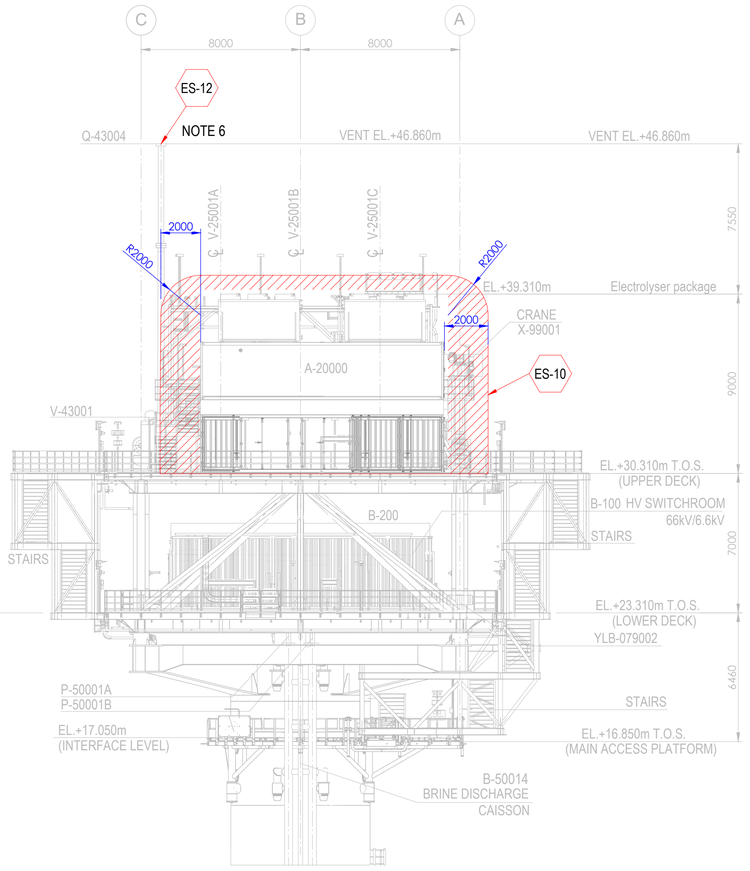

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

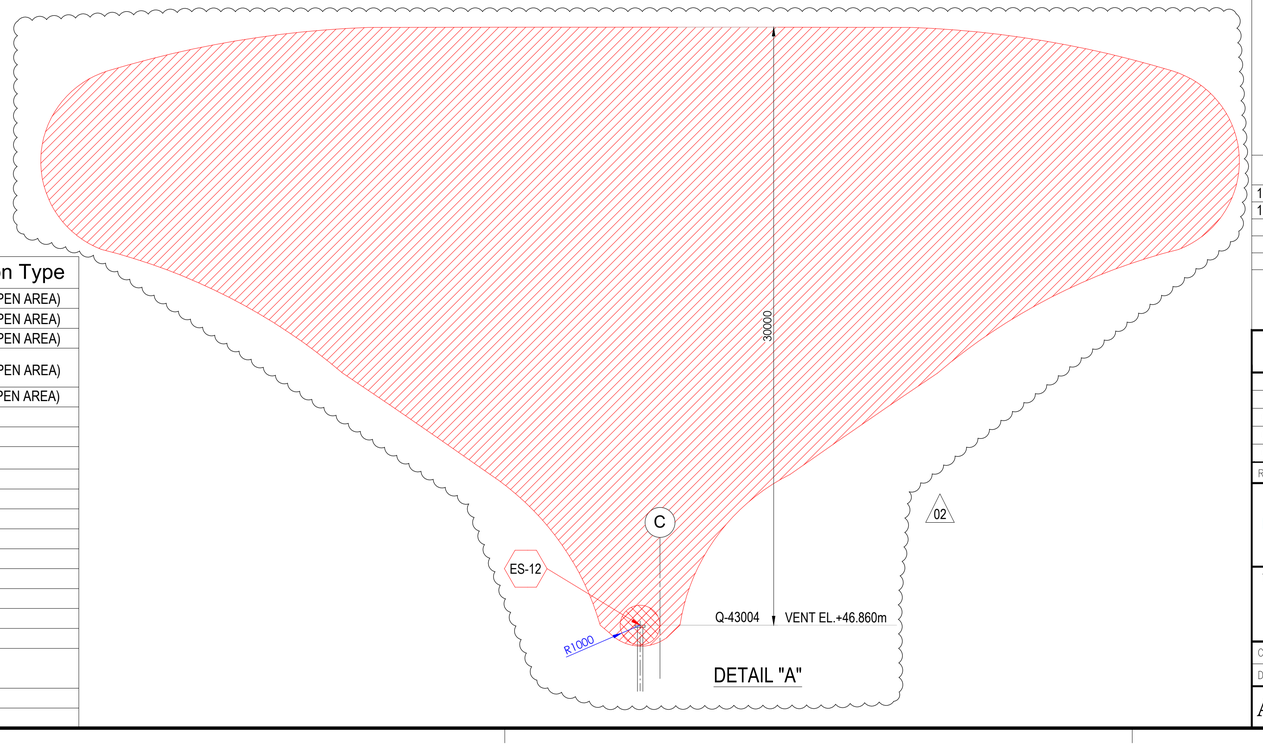



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-XY-024	: Solenoid Valve - Hyrogen to Vessels Inlet Header Vent System	Dwg	123A90-DDL-PR-PID-80013		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10002038	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		FL10424-1554			
Manufacturer	BIFOLD			**Model**		FP06P-77A			
Cert No.	Baseefa10ATEX0026			**Equipment Ambient Temp.**		-60°C to +40°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66/67

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	PL	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	OK	

ITEM	Tag	25-XY-024	: Solenoid Valve - Hyrogen to Vessels Inlet Header Vent System		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10002038	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	OK	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-XY-024	: Solenoid Valve - Hyrogen to Vessels Inlet Header Vent System		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10002038	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

	Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA		
68	Hermetically sealed and enclosed break devices are undamaged	x	NA		
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA		
70	Test port, if fitted, is functional (type “nR” only)	x	NA		
71	Breathing operation is satisfactory (type “nR” only)	x	NA		
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA		
73	The ventilation airflow is not impeded	x	NA		
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA		
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA		
76	Variable voltage/frequency installation complies with documentation	x	NA		
	Extra Ex p checks				
77	Pressurization gas is correct type	x	NA		
78	Actual pressure is within maximum and minimum settings for equipment	x	NA		
79	Timers set as per certification documentation	x	NA		
80	Alarms and trip functions operate correctly as per certification documentation	x	NA		
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA		
82	Automatic electrical protective devices operate within permitted limits	x	NA		
83	Automatic electrical protective devices are set correctly	x	NA		
84	Protective gas inlet temperature is below maximum specified	x	NA		
85	Ducts, pipes and enclosures are in good condition	x	NA		
86	Protective gas is substantially free from contaminants	x	NA		
87	Protective gas pressure and/or flow is adequate	x	NA		
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA		
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA		
90	Specific conditions of use (if applicable) are complied with		NA		
	Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA		
92	Cables are installed in accordance with the documentation	x	NA		
93	Segregation is maintained between IS and non-IS Circuits	x	NA		
94	Cable screens are isolated at one end (field side)	x	NA		
95	Cable screens are earthed in accordance with the documentation	x	NA		
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA		
97	Equipment installed is the one specified in the documentation	x	NA		
98	Ambient temperature range of the apparatus is correct for the installation	x	NA		
99	Service temperature range of the apparatus is correct for the installation	x	NA		
100	Installation is clearly labelled	x	NA		
101	Printed circuit boards are clean and undamaged	x	NA		
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA		
103	Point-to-point connections are all correct	x	NA		
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA		
105	Earth connections maintain the integrity of the type of protection	x	NA		
106	Intrinsically safe circuit earthing is satisfactory	x	NA		
107	Insulation resistance is satisfactory	x	NA		
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA		

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-31	2025-01-31	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-31T09:36:19.432Z	PROVERLIS Digitaly signed by Alessio Polo 2025-01-31T10:39:31.560Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

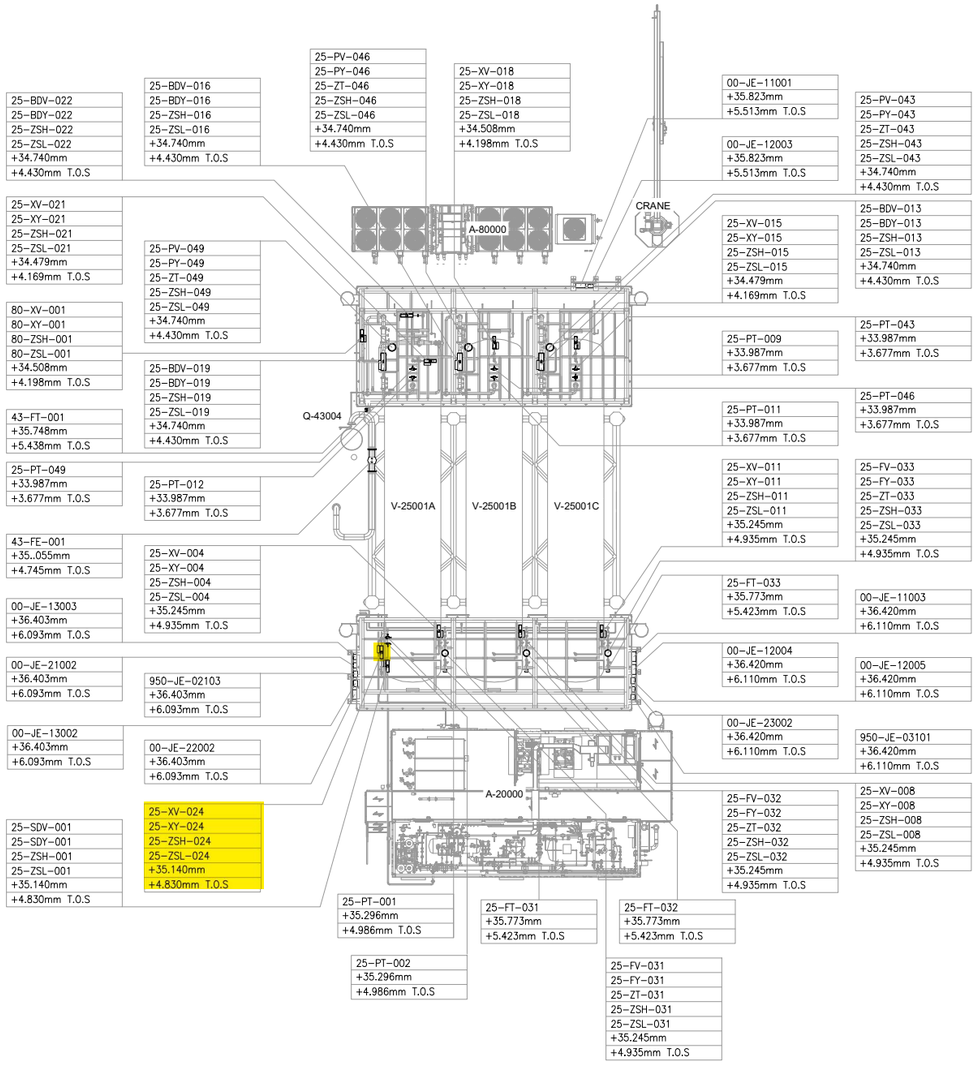

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

	DRAWING NO.	SHEET	REV.
A1	123A90–DDL–IN–DL–40081	002	02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. DRAWING_NO.

REV. REV

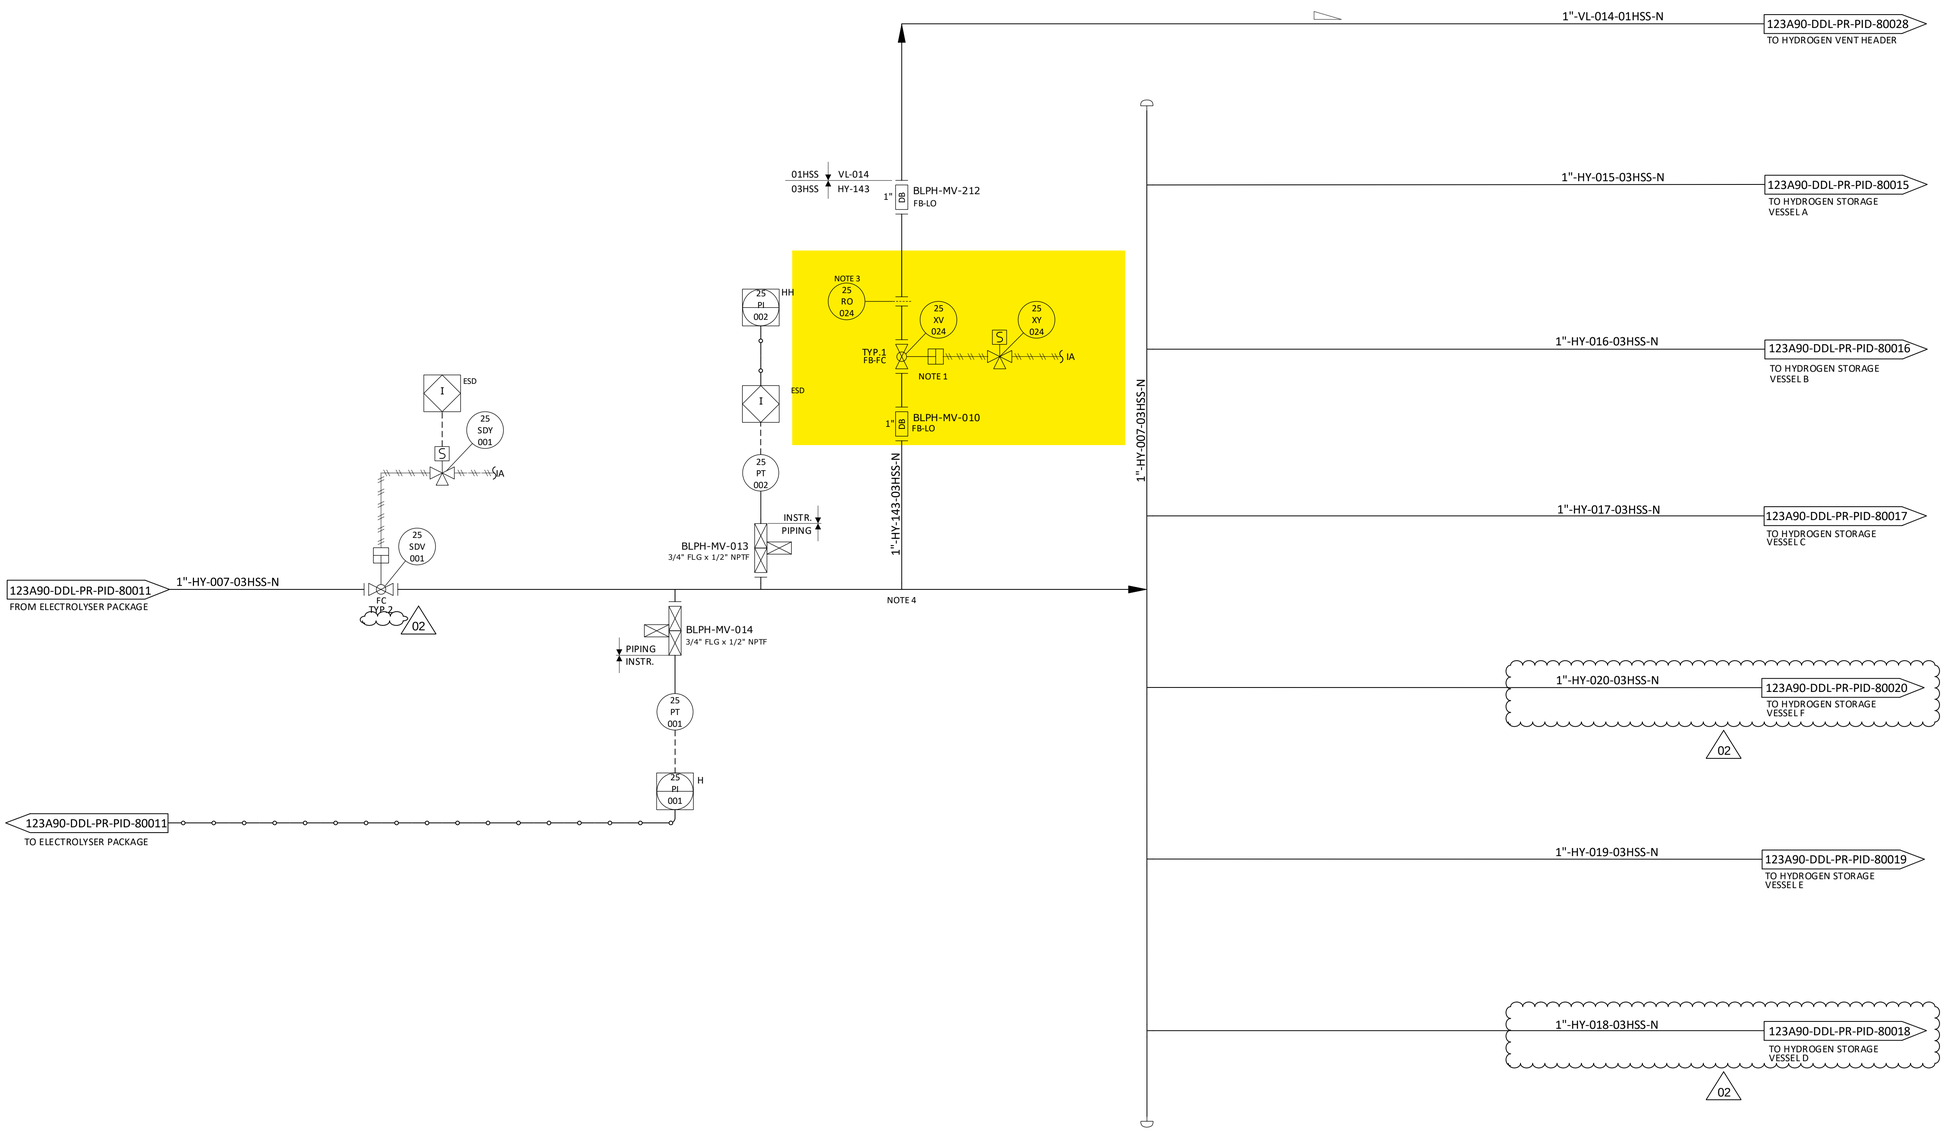

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :

BLPH PIPING AND INSTRUMENTATION DIAGRAM HYDROGEN STORAGE VESSELS HEADER (INLET)

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80013	SHEET 001	REV. 02


File Name : FILE_NAME

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-13002	No.	MARSHALLING CABINET B400-PCS-002

<01>

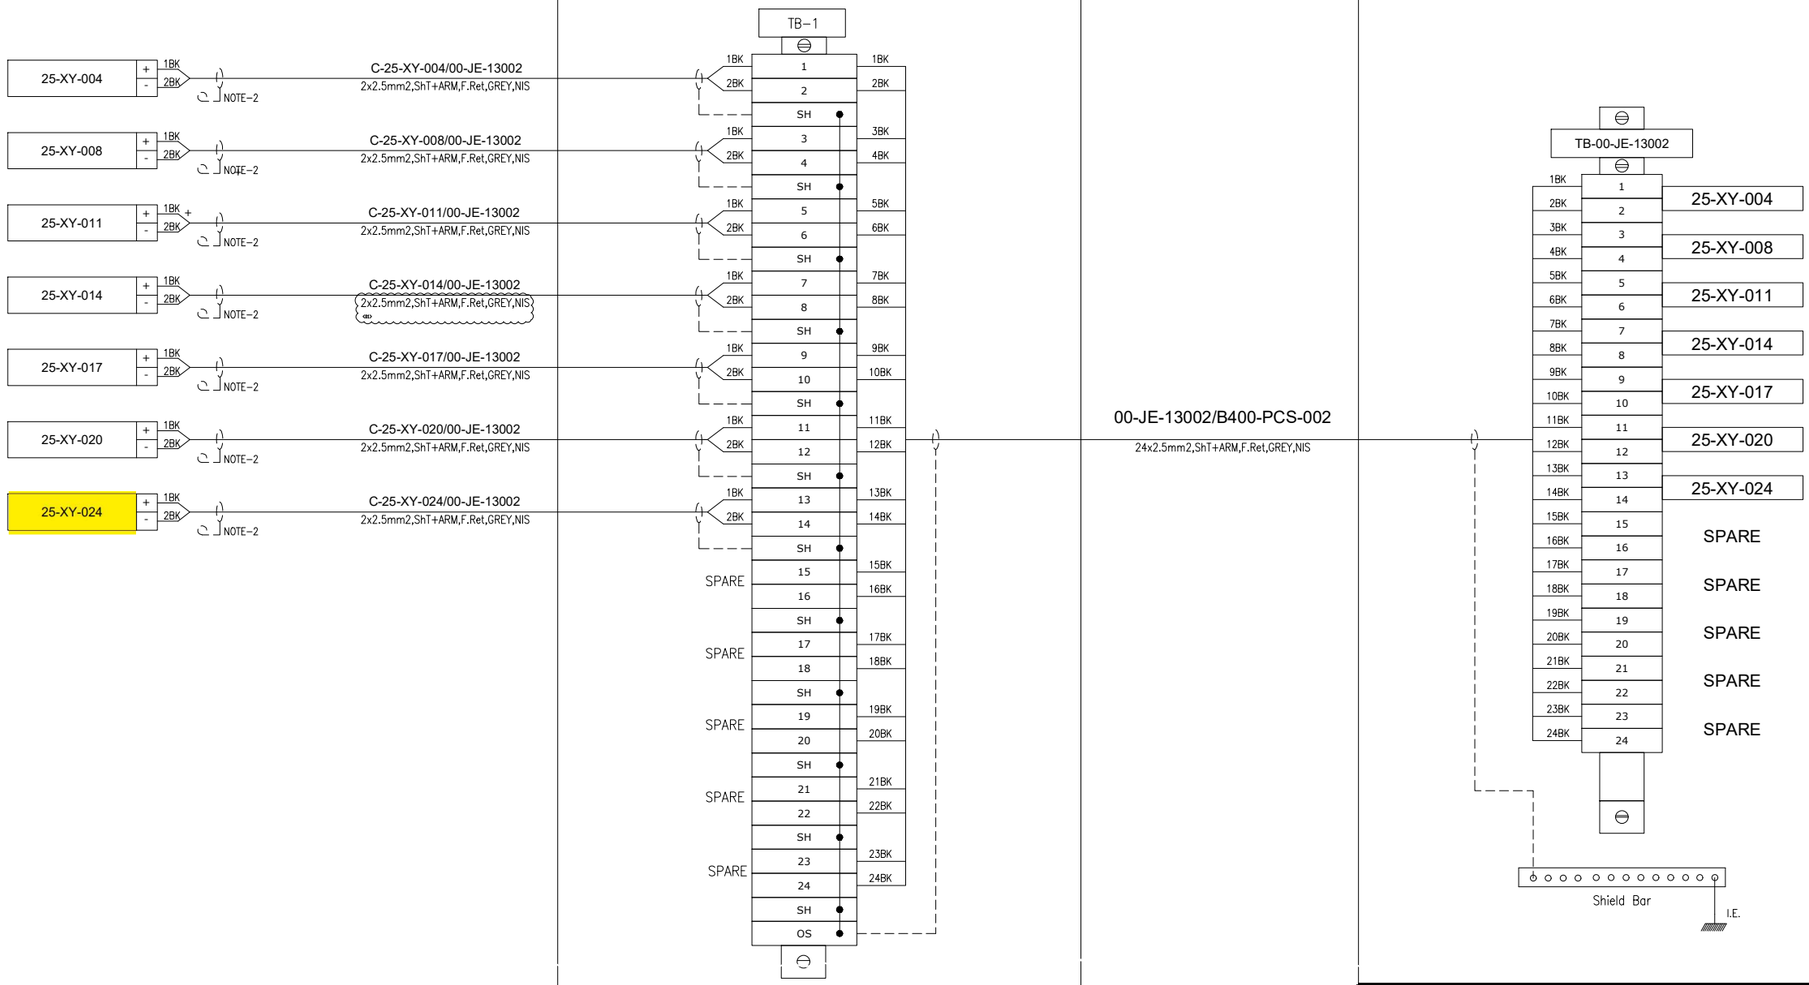

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_I	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-13002

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 029	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

E33

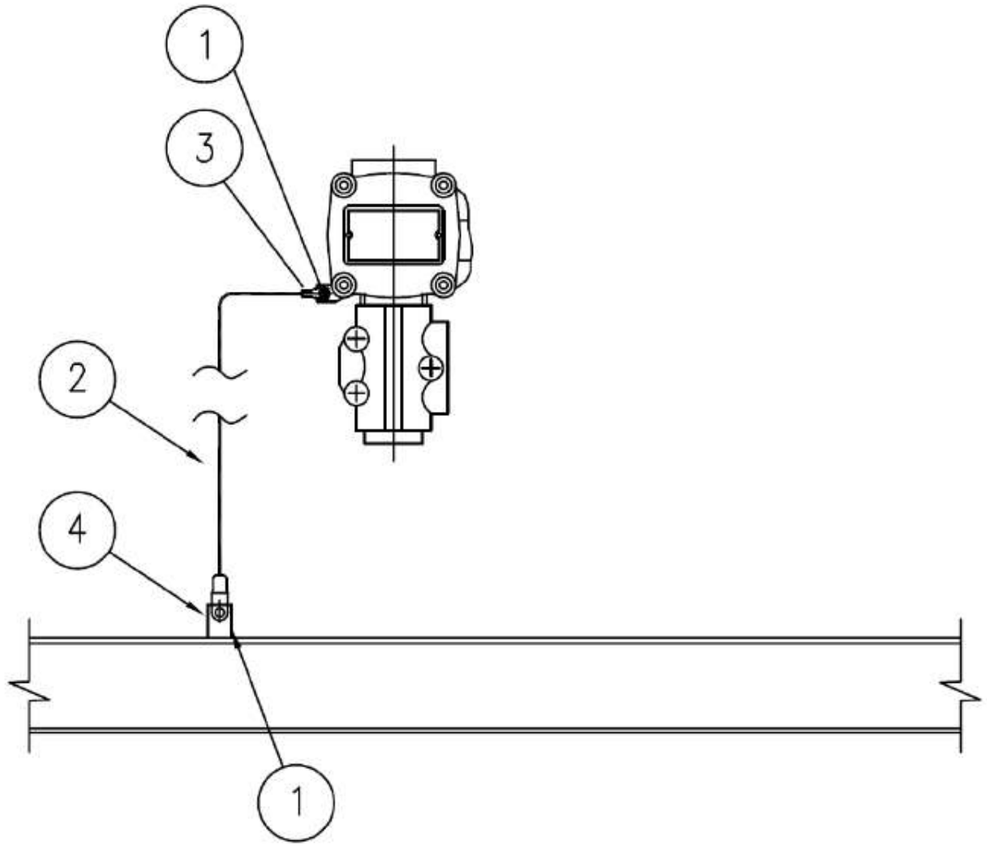

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-EL-DD-20090
REV.: 2_I | DATE: 07/11/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

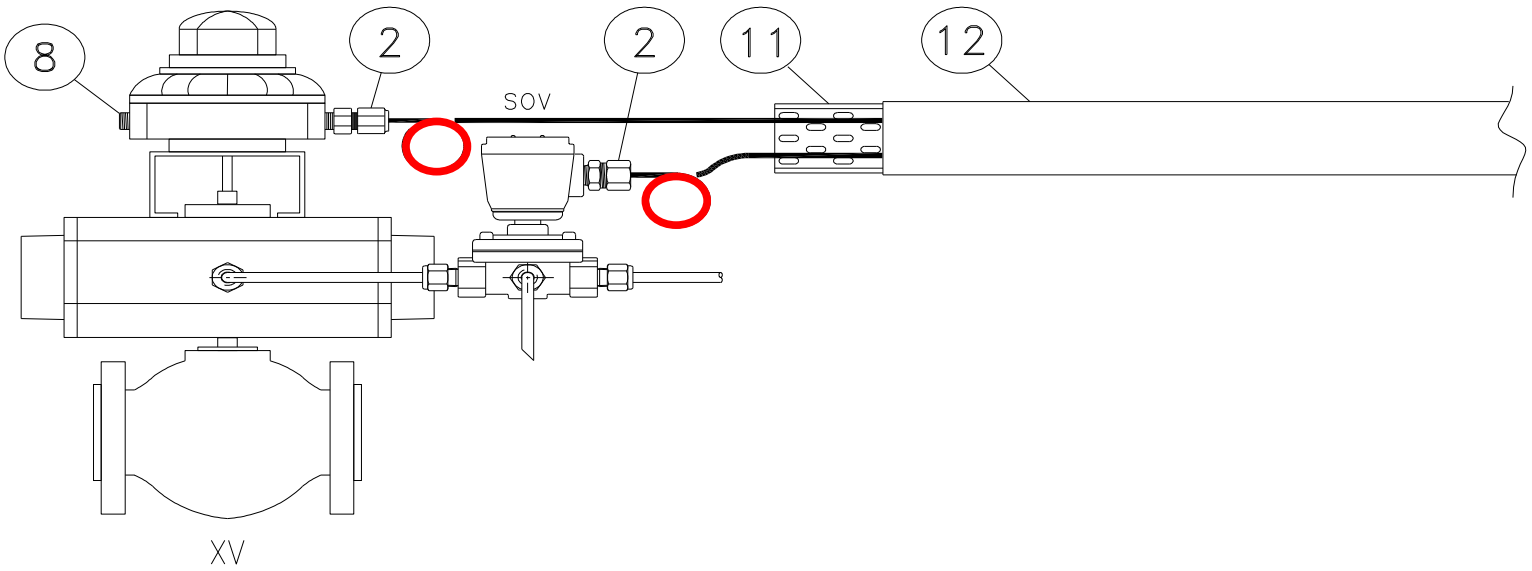

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**

REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi


ROSETTI MARINO SpA

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

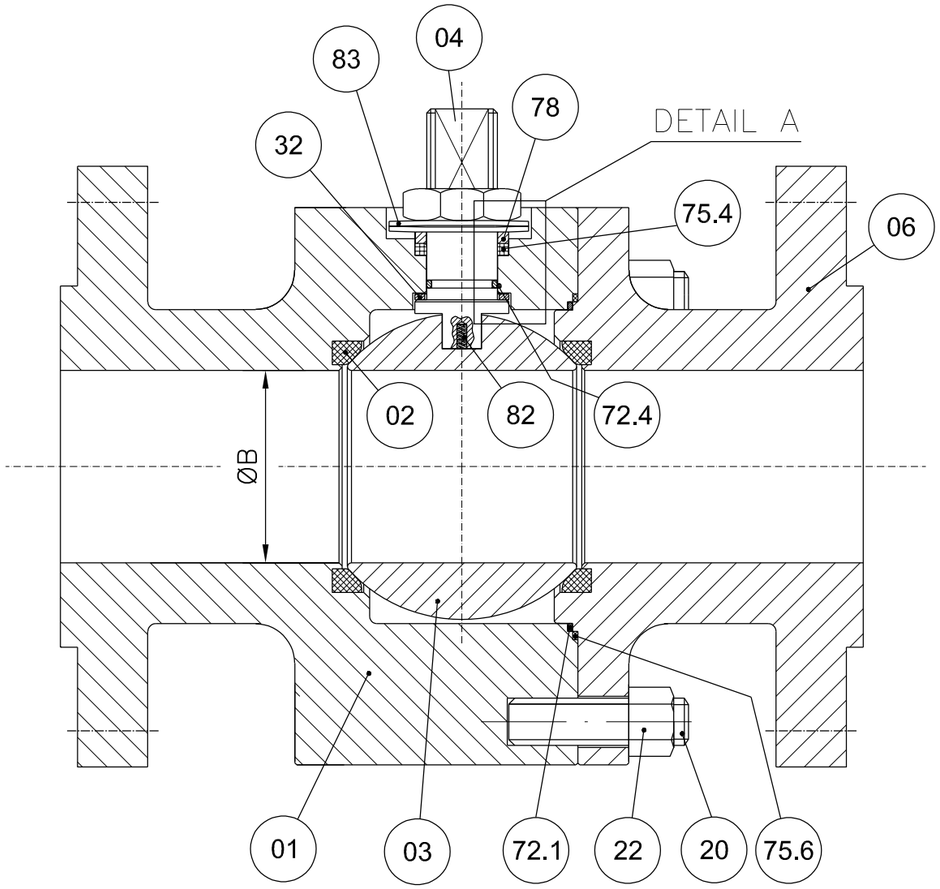


DETAIL A




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-024	25
	2	Service				HYDROGEN TO STORAGE TANKS DEPRESS.	
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80013	Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-143-03HSS-N	
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm	1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L	NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN	
	8	Fluid State	Phase			GAS	GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40	
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29	80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40	
	14						
	15						
	16	Speed of	Design			Close : (12)	Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum	Open : -
	18						
	19						
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)	
	21	Body Size	Body Form			1"	FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L	(*)
	23	Connections	Rating			FLANGED ASME B16.5	#300
	24	Flange Finish	Gasket Material			RF	Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)	(*)
	26	Bolting				A193 B8M / A194 Gr. 8M	
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO	
	29	Fire Safe				(2)	
ACTUATOR	30	Manufacturer	Type			Rotork	Spring Return
	31	Model No.	Size			CP/S	035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal	Cylinder
	33	Ingress Protection	Certification			IP-66	II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE	CLOSE
	36	Fireproofing				NOT APPLICABLE	
	37	Solenoid Valve				25-XY-024 (9, 14, 15, 16) - Bifold FP06P	
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-024 (9, 17) - Soldo SS	25-ZSH-024 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED	
	40	Air Set	Handwheel			(*)	NOT REQUIRED
	41	Mounting Position				HORIZONTAL	
	42	Partial Stroke Test Facility				NOT REQUIRED	
	43	Control Type				-	
	44	Electrical Connection	Electrical Class			No. (*) / M20	H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-	
	47	Safety Valve	Model			-	-
	48	Check Valve	Mounting			-	-
PURCHASE	49	Manufacturer				FLUITEK	
	50	Model				FB3	
	51	Purchase Order Number				1724000204	

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description	Code :	Dwg. No.:	Rev.
03	06/12/24							
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)			
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)			

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

140	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
141	IFR	25-XV-020	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
142	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
143	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620210001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
144	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
145	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
146	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323304	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
147	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
148	IFR	25-XV-021	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
149	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
150	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620220001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
151	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
152	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
153	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323297	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
154	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
155	IFR	25-XV-024	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
156	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
157	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620230001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
158	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
159	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
160	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323291	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
161	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
162	IFR	50-XV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
163	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
164	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620240001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
165	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
166	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
167	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323289	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
168	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
169	IFR	50-XV-002	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
170	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
171	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620250001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
172	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
173	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
174	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323290	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
175	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
176	IFR	50-XV-003	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
177	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
178	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620260001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
179	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
180	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
181	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323299	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
182	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
183	IFR	50-XV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
184	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
185	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620270001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
186	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

1 # EU - TYPE EXAMINATION CERTIFICATE

2 **Equipment or Protective System Intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU**

3 EU - Type Examination Certificate Number: **Baseefa10ATEX0026 – Issue 15**

4 Product: **Type 27 & 77 Solenoid Operator**

5 Manufacturer: **Bifold Fluidpower Limited**

6 Address: **Chadderton, Oldham, Greater Manchester, OL9 9XA, UK**

7 This re-issued certificate extends EU Type Examination Certificate No. **Baseefa10ATEX0026** to apply to product designed and constructed in accordance with the specification set out in the Schedule of the said certificate but having any variations specified in the Schedule attached to this certificate and the documents therein referred to.

8 SGS Fimko Oy, Notified Body number 0598, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this product has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of products intended for use in potentially explosive atmospheres given in Annex II to the Directive.

8.1 The original certificate was issued by SGS Baseefa Ltd (UK Notified Body 1180). It, and any supplements previously issued by SGS Baseefa Ltd have been transferred to the supervision of SGS Fimko Oy (EU Notified Body 0598). The original certificate number is retained.

The examination and test results are recorded in confidential Report No. **See Certificate History**

9 Compliance with the Essential Health and Safety Requirements has been assured by compliance with:

EN IEC 60079-0:2018 **EN 60079-1:2014** **EN 60079-31:2014**

except in respect of those requirements listed at item 18 of the Schedule.

10 If the sign "X" is placed after the certificate number, it indicates that the product is subject to the Specific Conditions of Use specified in the schedule to this certificate.

11 This EU - TYPE EXAMINATION CERTIFICATE relates only to the design and construction of the specified product. Further requirements of the Directive apply to the manufacturing process and supply of this product. These are not covered by this certificate.

12 The marking of the product shall include the following:

Ⓔx II 2GD **Ex db IIC T6 Gb (Tamb -60°C to +40°C)***
Ex tb IIIC T85°C Db (Tamb -60°C to +40°C)* IP66/67
***alternative Temperature class/Ambient combinations may also be marked, see schedule**

SGS Fimko Oy Customer Reference No. **1688** Project File No. **22/0377**

This document is issued by the Company subject to their General Conditions for Certification Services accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx . Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained herein reflects the Company's findings at the time of their intervention only and within the limits of Client's instructions, if any. It does not necessarily indicate that the equipment may be used in particular industries or circumstances. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, schedule included, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

SGS Fimko Oy
Takomotie 8
FI-00380 Helsinki, Finland
Telephone +358 (0)9 696 361
e-mail **sgs.fimko@sgs.com**
web site **www.sgs.fi**
Business ID 0978538-5 Member of the SGS Group (SGA SA)

Mikko Välimäki
Authorised Signatory for SGS Fimko Oy

13 **Schedule**

14 **Certificate Number Baseefa10ATEX0026 – Issue 15**

15 Description of Product

The Type 77 and Type 27 Solenoid Operators are rated at up to 240Vac or dc and have a maximum power dissipation of 14W. The Type 77 Solenoid Operator comprises a stainless steel cylindrical enclosure, whereas the Type 27 comprises an aluminium cylindrical enclosure, both have a spigot cover fitted with a silicone rubber seal.

In addition to the above there is also a two winding alternative designated the 'Pulse-Pulse Solenoid operator' which has a maximum combined coil rating limited to 20.5W.

The base of the enclosure is fitted with an adaptor bush which incorporates venting holes to allow the unit to be fitted onto a valve assembly rated up to a maximum pneumatic pressure of 10 bar. For hydraulic valves and valves with pneumatic pressures greater than 10 bar the top of the valve is provided with additional venting holes.

Internally the unit is fitted with a coil holder, coil and armature onto which is mounted an adjusting rod which forms a cylindrical joint with the adaptor bush and operates the valve when the solenoid is activated.

The cover may be fitted with a pushbutton or a rotary operator which can be used to operate the valve manually either momentarily or permanently.

The cover is secured using four stainless steel socket head cap screws grade of grade A4-70.

The equipment is marked:

Ex db IIC T6 Gb (Tamb -60°C to +40°C)*

Ex tb IIIC T85°C Db (Tamb -60°C to +40°C)* IP66/67

*The following alternative Temperature class/Ambient combinations may also be marked

T5/T100°C (Tamb -60°C to +55°C)

T4/T135°C (Tamb -60°C to +90°C)

An M20 or ½" NPT cable entry hole is provided as specified on the certified drawings for the accommodation of suitable IECEx Equipment (not a Component) certified cable entry device, with or without the interposition of a suitable IECEx Equipment certified (not a Component) flameproof thread adapter.

An M20 cable entry is provided unless the marking 'K85' appears in the Model No. marked on the label, in which case a ½" NPT cable entry hole is provided.

16 Report Number

See Certificate History

17 Specific Conditions of Use

None

18 Essential Health and Safety Requirements

In addition to the Essential Health and Safety Requirements (EHSRs) covered by the standards listed at item 9, the following are considered relevant to this product:

Clause	Subject
1.4.1	External effects
1.4.2	Aggressive substances etc.

19 Drawings and Documents

New drawings submitted for this issue of certificate:

Number	Issue	Date	Description
0-SL0070	0	2022.06.30	TYPE 27 & 77 SOLENOID LABEL - ROTORK BRAND - L240

Current drawings which remain unaffected by this issue:

Number	Issue	Date	Description
0-SC0004	1	09.07.20	Solenoid Lid Options G.A
0-SC0006	0	17.04.09	Latched Energised and Tamperproof Solenoid Options
0-SC0008	1	29.03.11	Override Cover Assembly
0-SC0009	0	12.02.15	Serial Numbers IIB, Type 77
**0-GA0870	0	07.11.17	General Arrangement L209 Variant – Fixed Head Operator
0-SC0003	11	20.09.21	Type 27 and 77 Solenoid Operator
0-SC0007	5	24.11.21	Sol. Operator Pulse-Pulse.
0-SL0056	4	13.01.22	Type 27 & 77 Solenoid housing label Ex d
0-SL0058	5	2022.02.07	Type 27 & 77 Solenoid housing label Ex d
0-SL0068	0	2022.01.17	Label Type 27 and 77 Solenoid Operator

**This drawing is common to this certificate and BAS02ATEX2048, BAS21UKEX0642 and is held with IECEx BAS 10.0008.

20 Certificate History


Certificate No.	Date	Comments
Baseefa10ATEX0026	20 April 2010	The release of the prime certificate. The associated test and assessment against the requirements of EN 60079-0: 2006, EN 60079-1: 2007, EN 61241-0: 2004 and EN 61241-1: 2004 is documented in Test Report No. GB/BAS/ExTR10.0014/00.
Baseefa10ATEX0026/1	7 April 2011	Amendment to the diametral tolerance for the adjusting rod. Omission of drawing 0-SC0001 (previously submitted in error). Alternative design of pushbutton override cover assembly. Minor drawing variations. Documented in Test Report No. GB/BAS/ExTR11.0084/00
Baseefa10ATEX0026/2	8 July 2011	Alternative internal design to form the Pulse-Pulse Solenoid Operator. This unit has two windings with a combined rating of 20.5W. Amended designation for the solenoid housing material. Documented in Test Report No. GB/BAS/ExTR11.0123/00
Baseefa10ATEX0026/3	2 April 2012	Alternative label design incorporating the complete range of temperature class and ambient temperature markings provided for by this certificate. Documented in Test Report No. GB/BAS/ExTR12.0086/00

Certificate No.	Date	Comments
Baseefa10ATEX0026/4	2 December 2013	A re-designation of the Type FP Solenoid Operator, to the Type 77 Solenoid Operator. A satisfactory assessment against the requirements of the updated standards IEC 60079-0: 2011 and IEC 60079-31: 2008 (superseding IEC 61241), complete with a review of the marking. Introduction of an alternative aluminium housing and cover material. Documented in Test Report No. GB/BAS/ExTR13.0291/00
Baseefa10ATEX0026/5	29 July 2014	This issue permits existing information (for example on Schedule Drawings) to be replaced by the revised certificate holders address. No other changes may be made to the certified design. Documented in Test Report No. None.
Baseefa10ATEX0026/6	17 February 2015	Clarification of the Type name. The Type 77 comprises a stainless steel housing and the Type 27 comprises an aluminium housing. To allow the introduction of alternative seal materials. To allow the Type 77 Solenoid Operators having Serial numbers as defined in drawing number 0-SC0009 to be marked with Ex d IIB T6 Gb. Documented in Test Report No. GB/BAS/ExTR14.0317/00
Baseefa10ATEX0026/7	23 June 2016	Minor drawing changes not affecting certification. Documented in Test Report No. GB/BAS/ExTR16.0164/00
Baseefa10ATEX0026/8	16 March 2017	To allow the introduction of an alternative low power circuit. To allow for correction of the Type designation listed on the EU-Type Examination Certificate Baseefa10ATEX0026 To allow for correction of description to include the Pulse Pulse Unit. Documented in Test Report No. GB/BAS/ExTR17.0076/00
Baseefa10ATEX0026/9	20 July 2017	To allow the introduction of an alternative low power circuit. Documented in Test Report No. GB/BAS/ExTR17.0211/00
Baseefa10ATEX0026/10	3 January 2018	To introduce an alternative non-rotational mounting arrangement to attach the adaptor bushing via the coil holder to the enclosure housing. Identification of threaded entry holes on the enclosure wall. Documented in Test Report No. GB/BAS/ExTR17.0274/00
Baseefa10ATEX0026/11	7 March 2018	To introduce alternative terminal plate with a different grounding point design. To introduce optional certification marks in addition to the existing one to be included on to the certification label marking. Documented in Test Report No. GB/BAS/ExTR 18.0041/00
Baseefa10ATEX0026/12	12 July 2019	To assess the Type 27 and 77 Solenoid Operator against the standards EN IEC 60079-0:2018, EN 60079-1:2014 and EN 60079-31:2014 To permit minor drawing changes to the certification label that do not affect certification Documented in Test Report No. GB/BAS/ExTR19.0100/00


Certificate No.	Date	Comments
Baseefa10ATEX0026/13	14 July 2020	To introduce an alternative Detented Manual Over-Ride Lid (alternative spigoted cover), which allows the valve to be operated manually. Documented in Test Report No. GB/BAS/ExTR19.0341/00.
Baseefa10ATEX0026 – issue 14	11 February 2022	This issue of the certificate incorporates previously issued primary & supplementary certificates. To remove drawings 138-10, 138-10-K85, 0-S0252 and 0-S0254 transferring critical details to drawing 0-SC0003 revision 11. To remove drawing 0-SC0001. To add drawing 0-SL0068. To add an alternative encapsulant. To update the nameplate drawings to include UKEX details. Documented in Test Report No. GB/BAS/ExTR21.0158/00
Baseefa10ATEX0026 – issue 15	2 November 2022	This issue of the certificate incorporates previously issued primary & supplementary certificates. To add an alternative marking drawing with a different manufacturer branding. The assessment is documented in test report GB/BAS/ExTR22.0138/00
For drawings applicable to each issue, see original of that issue.		

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

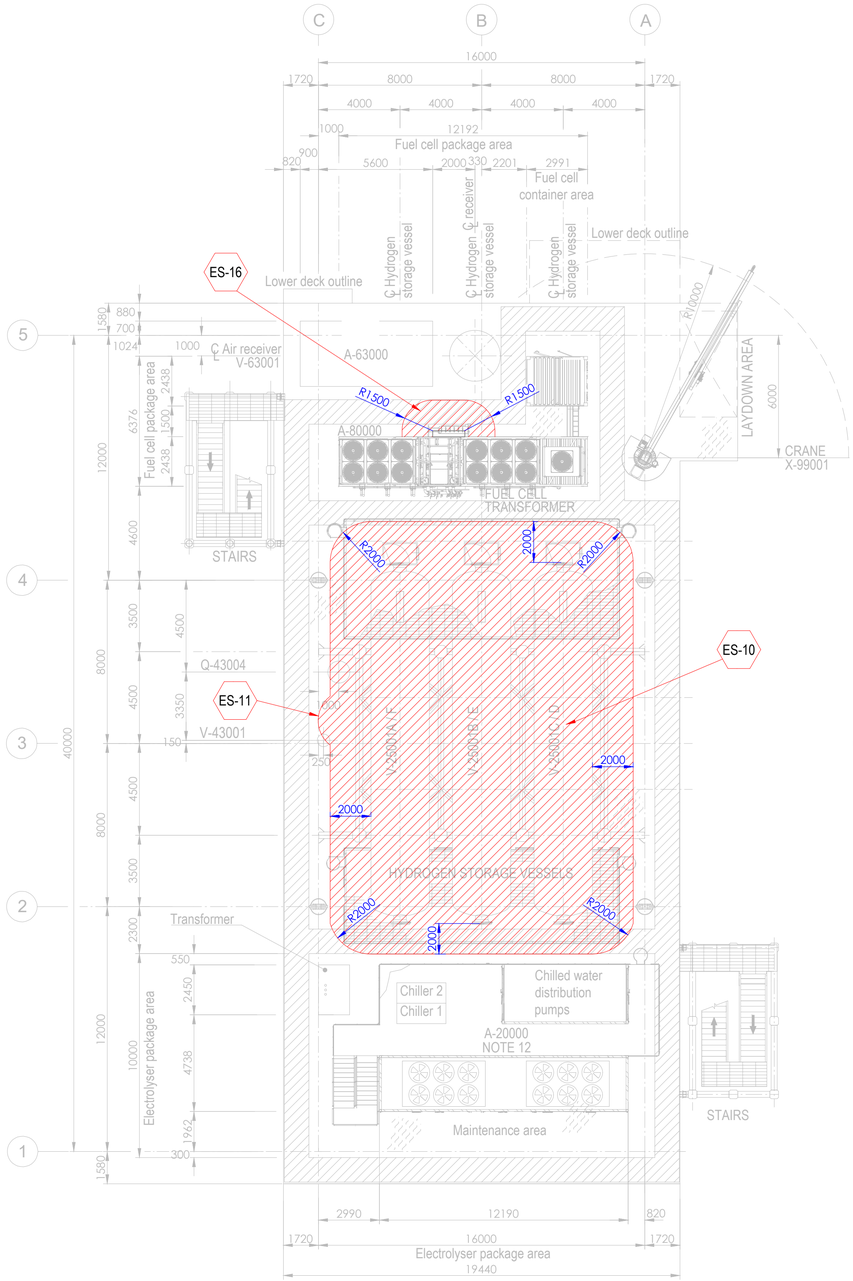


PLAN ON UPPER DECK
EL+30.310 T.O.S.

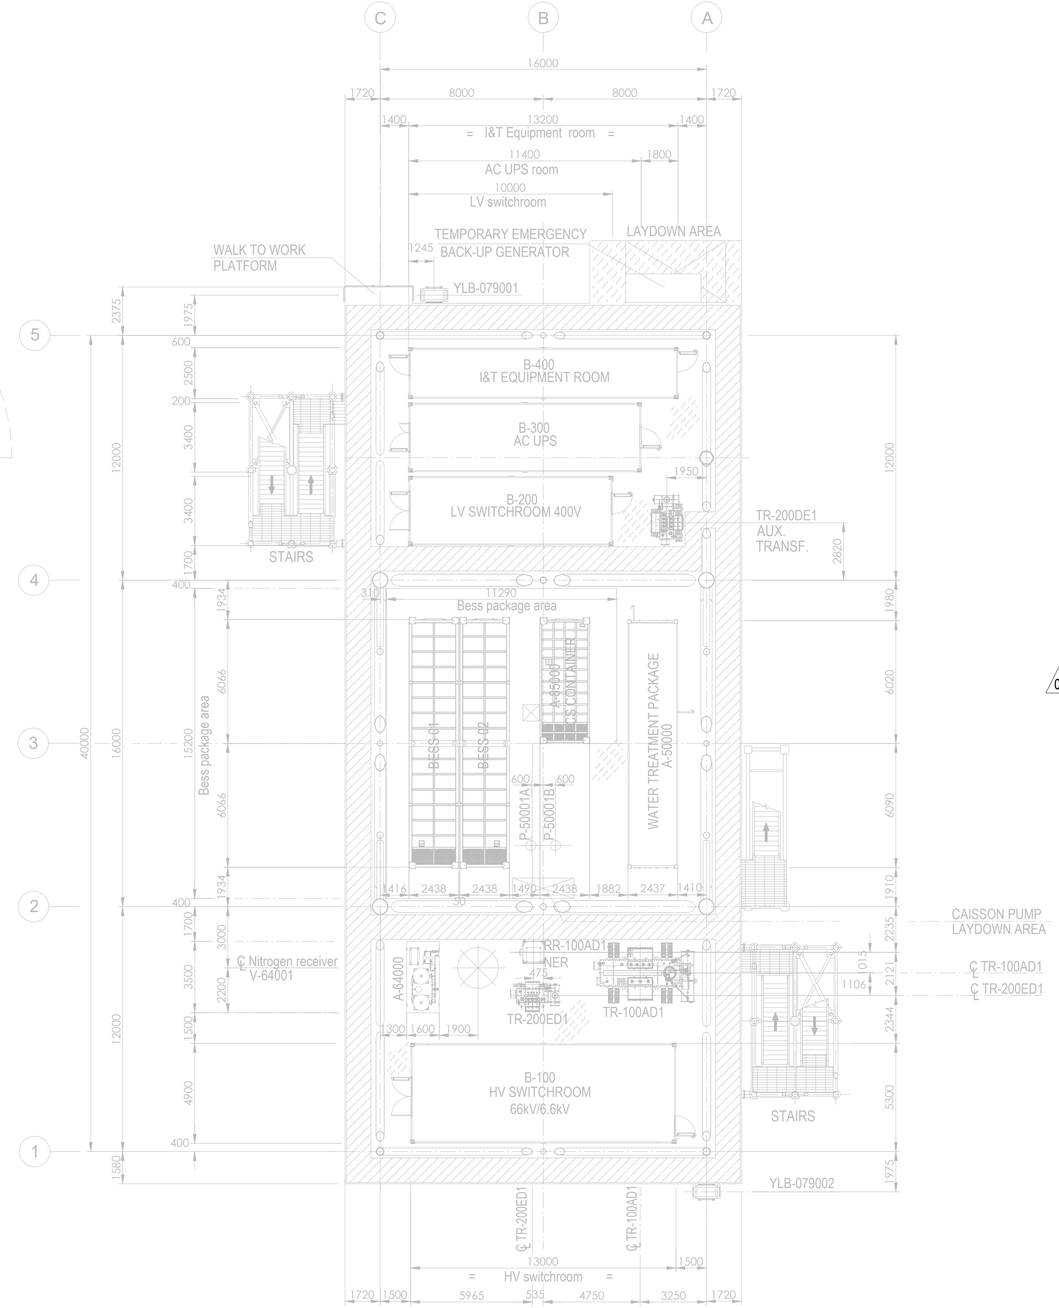

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

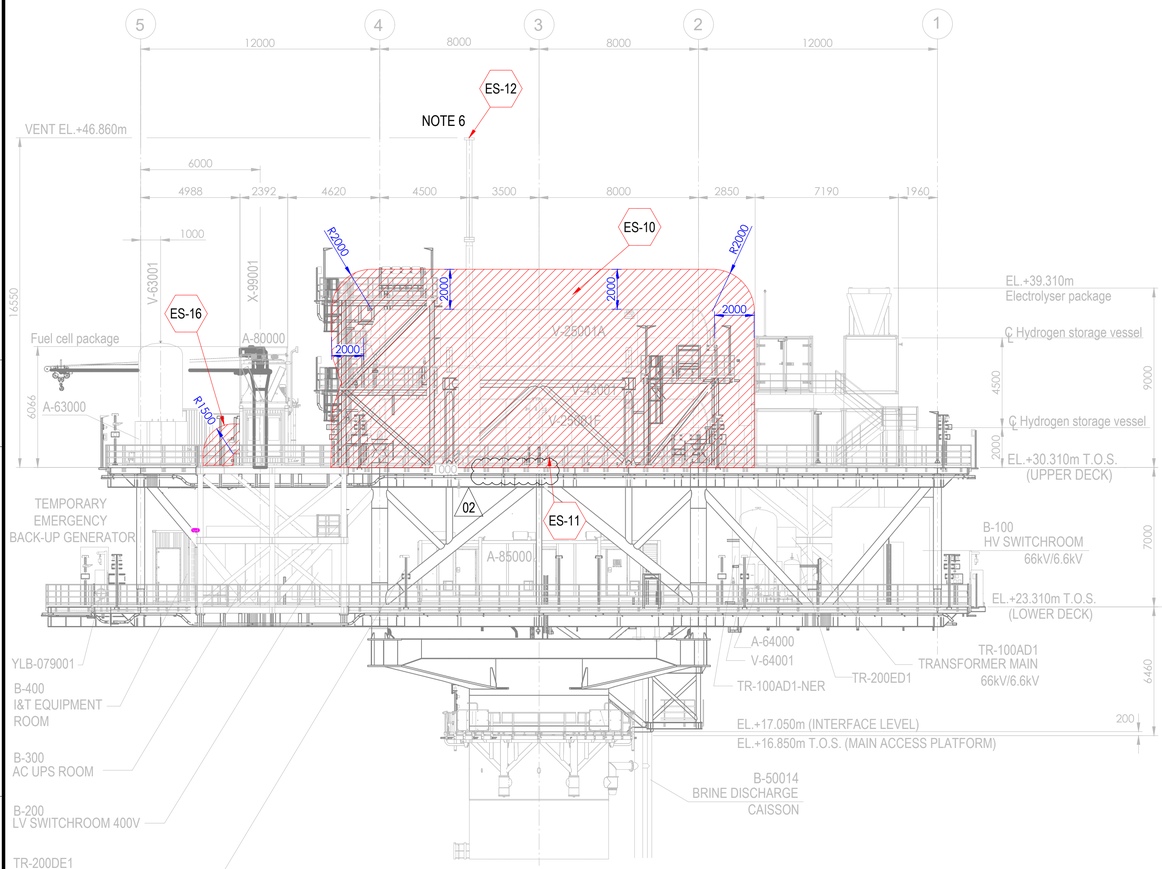



ELEVATION LOOKING EAST

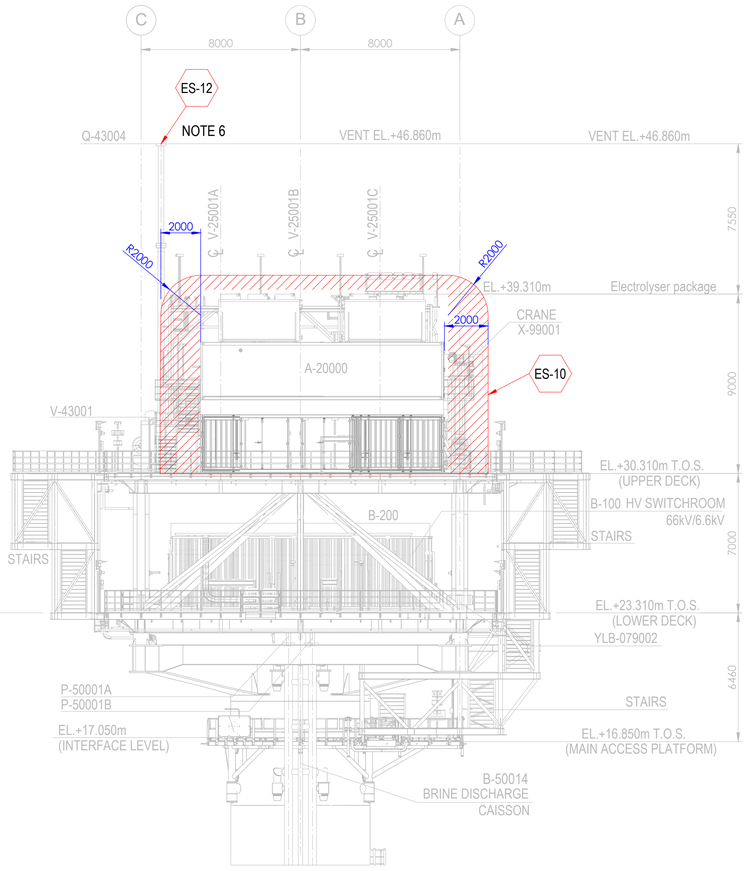

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

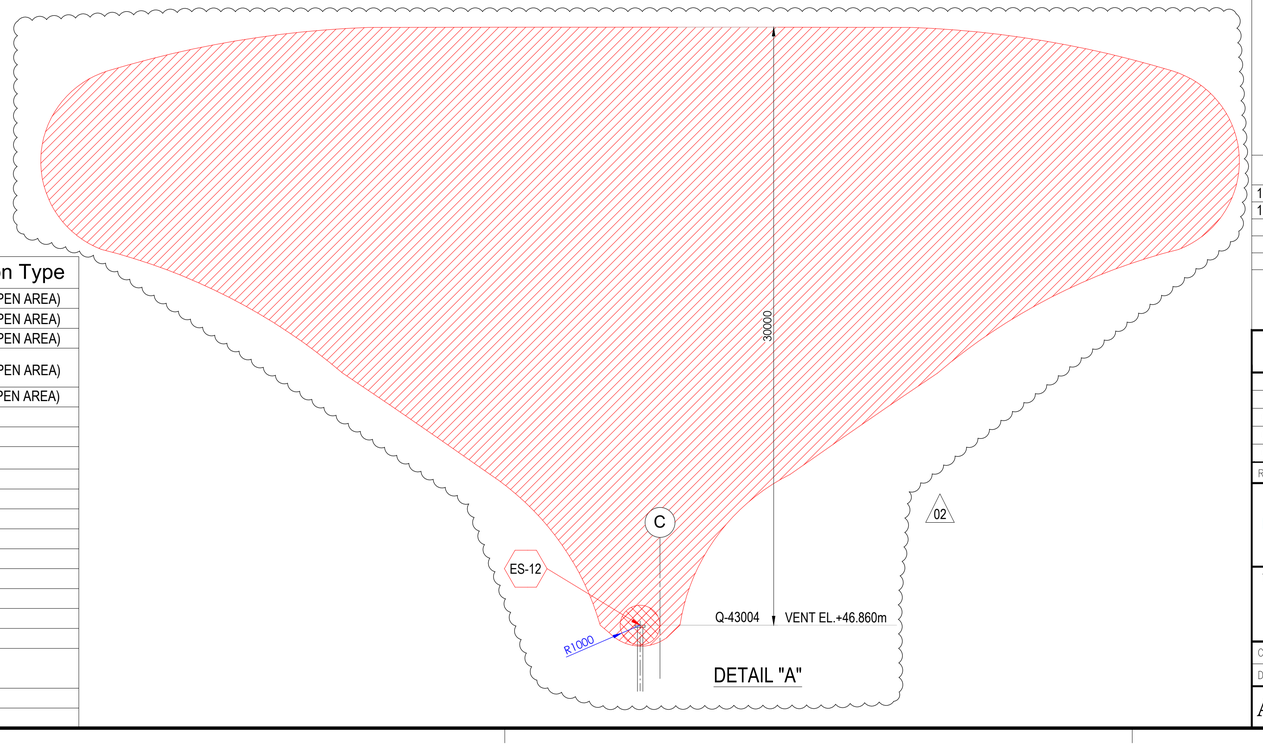



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-ZSHL-024	: Limit Switch Box - Hyrogen to Vessels Inlet Header Vent System	Dwg	123A90-DDL-PR-PID-80013		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10002039	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		Batch: IT03B0116886			
Manufacturer	SOLDO			**Model**		SQN120E-20X23L7			
Cert No.	CML 19ATEX1359X			**Equipment Ambient Temp.**		-40°C to +80°C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex db	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66/68

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	OK	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		OK	
	Physical check	x	OK	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	OK	
13	Condition of enclosure gaskets is satisfactory	x	OK	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	OK	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	OK	
25	There is no obvious damage to the cables	x	OK	
26	Cable glands are the correct type and installed correctly	x	OK	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	OK	

ITEM	Tag	25-ZSHL-024	: Limit Switch Box - Hyrogen to Vessels Inlet Header Vent System			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10002039	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		OK	
	Physical check	x	OK	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	OK	
33	All cable cores are uniquely labeled	x	OK	
34	Cable cores not in use are correctly terminated	x	OK	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	OK	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	OK	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	OK	
52	Flame path are clean and undamaged	x	OK	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-ZSHL-024	: Limit Switch Box - Hyrogen to Vessels Inlet Header Vent System		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10002039	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-30	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-30T10:22:39.445Z	PROVERLIS Digitaly signed by Alessio Polo 2025-01-30T10:59:38.893Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

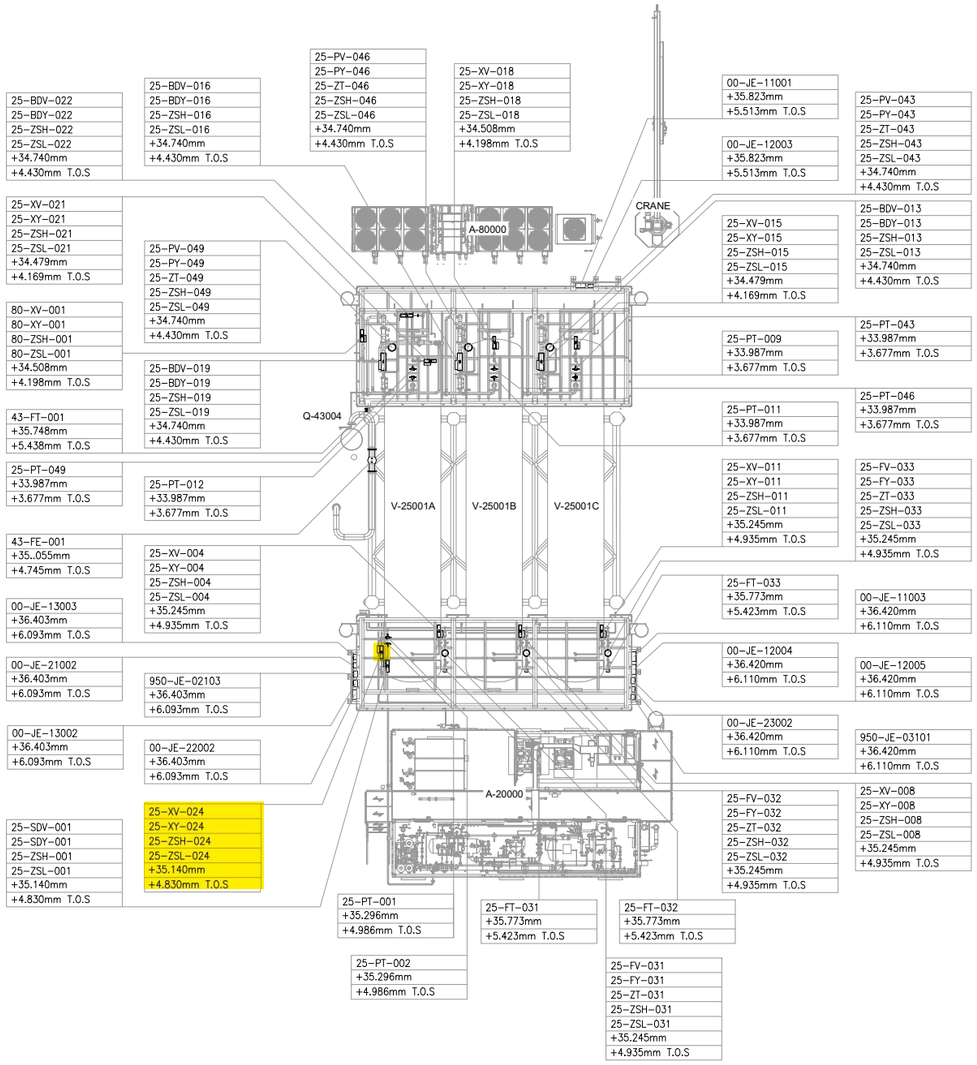

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

	DRAWING NO.	SHEET	REV.
A1	123A90–DDL–IN–DL–40081	002	02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. DRAWING_NO.

REV. REV

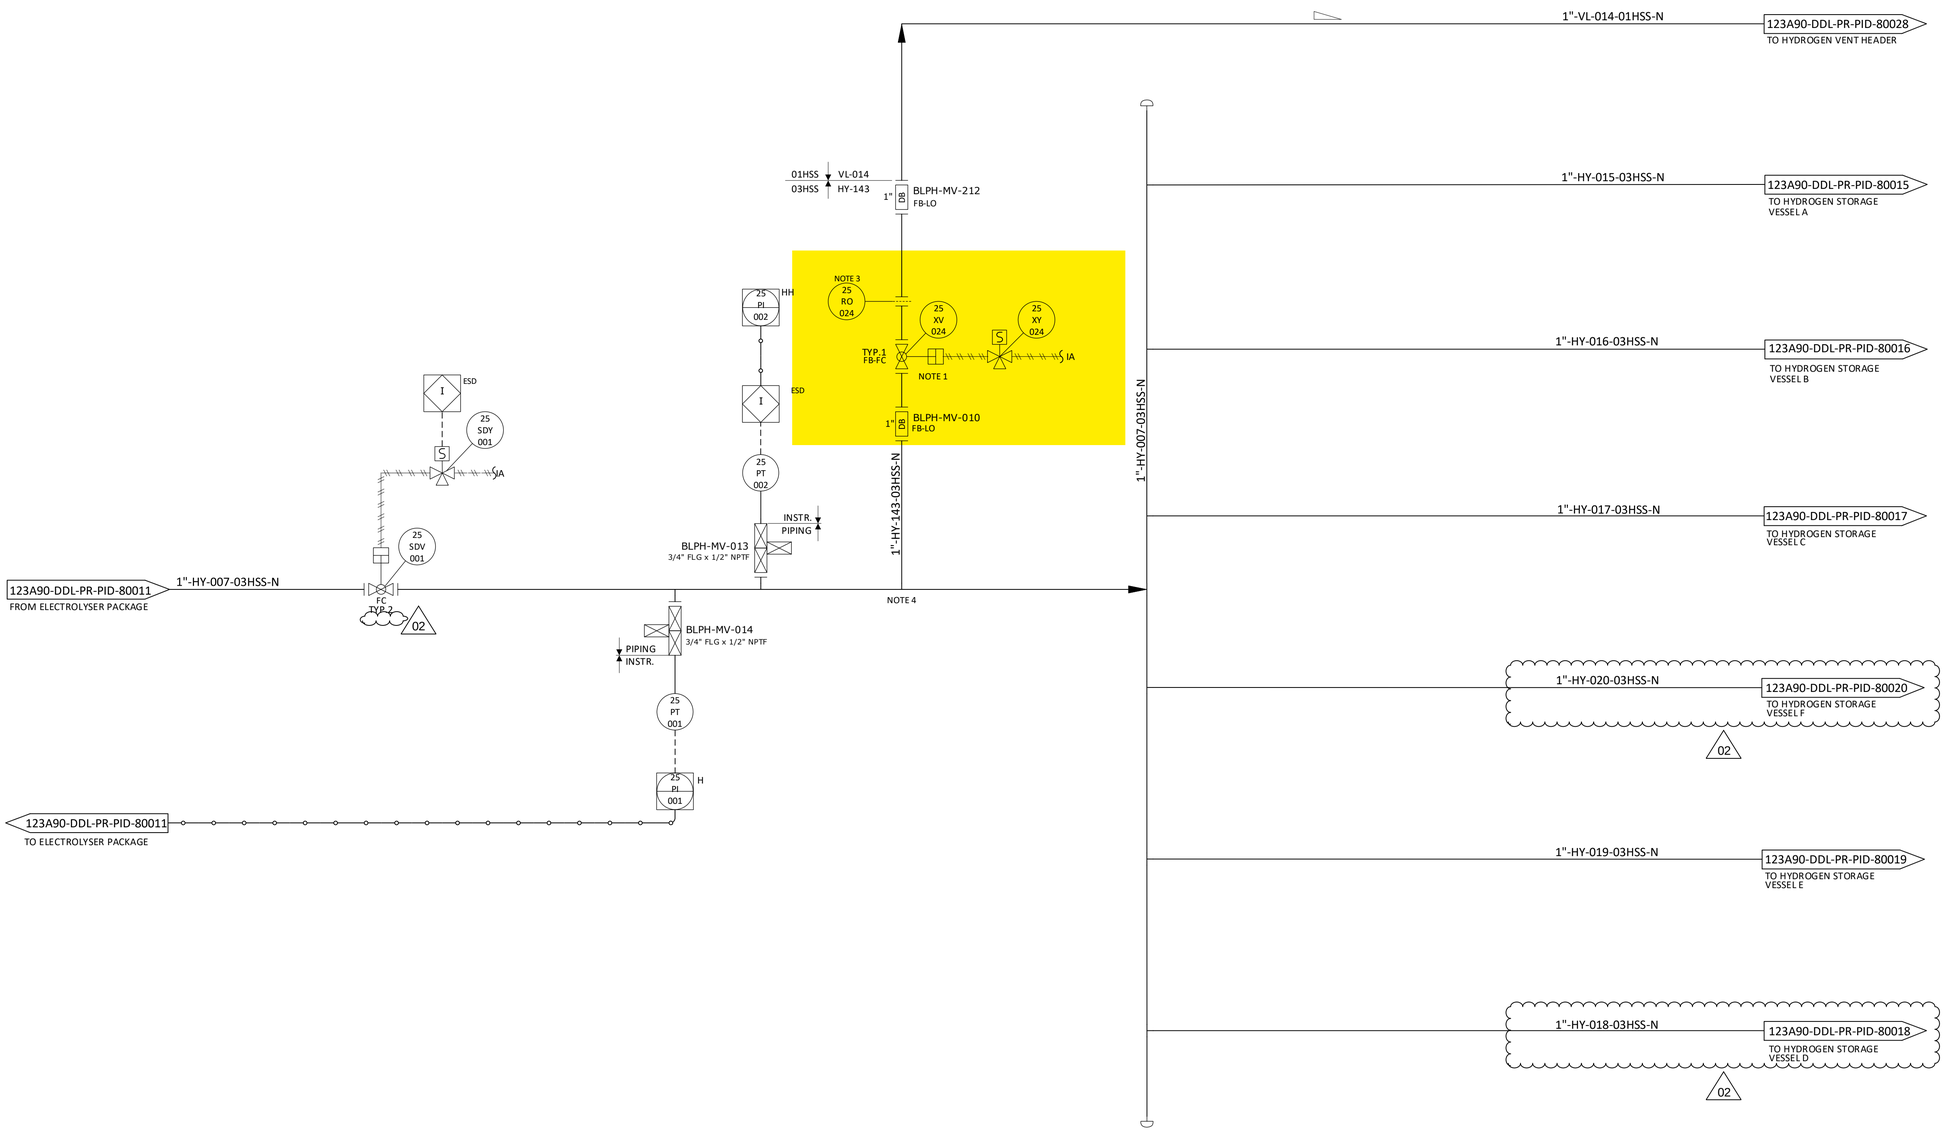

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :

BLPH PIPING AND INSTRUMENTATION DIAGRAM HYDROGEN STORAGE VESSELS HEADER (INLET)

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80013	SHEET 001	REV. 02

File Name : FILE_NAME

E33

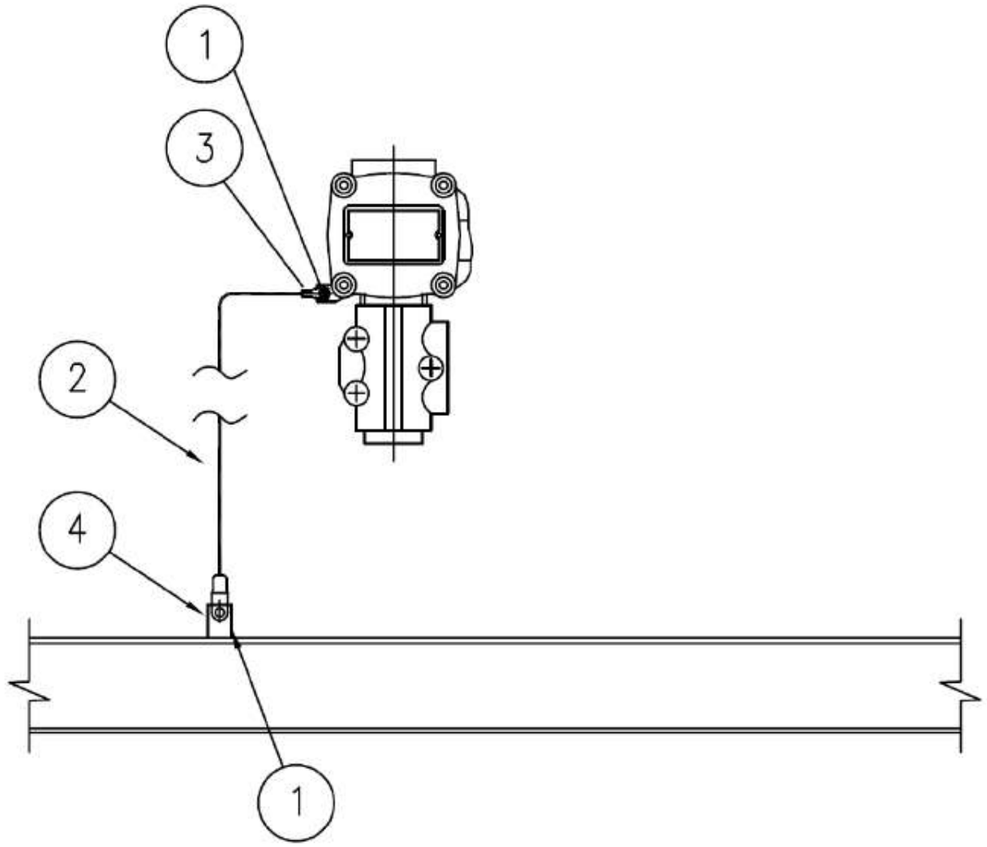

MATERIALS

POS.	Q.TY	DESCRIPTION	NOTES
1	1	A4 STAINLESS STEEL BOLT COMPLETE WITH NUT AND WASHERS	
2	1	Y/G INSULATING COPPER CONDUCTOR - 6mm²	
3	1	COMPRESSION TYPE LUG FOR INSULATING COPPER CONDUCTOR	
4	1	EARTHING BAR / PLATE / THREADED STUD	(1)

NOTE:
1) FOR DETAIL OF EARTHING PLATE, EARTHING BOSS AND THREADED STUD SEE TYP. E11A/C/D/E

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-EL-DD-20090**

REV.:	DATE:	SIGNATURE:
2_I	07/11/24	G.Randi

ROSETTI MARINO SpA

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	26/08/24	GRA	AMA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	10/06/24	SPS	FMA/AMA	FPA/DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	21/11/23	SPS	FMA/AMA	FPA/DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
ELECTRICAL TYPICAL INSTALLATION DETAILS-EARTHING SYSTEM
EARTHING FOR GENERIC INSTRUMENT

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : NTS


A3 | DRAWING NO. 123A90-DDL-EL-DD-20090 | SHEET 027 | REV. 02

F.to UNI A3: 420mmx297mm

File Name : 123A90-DDL-EL-DD-20090 REV.02.DWG

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

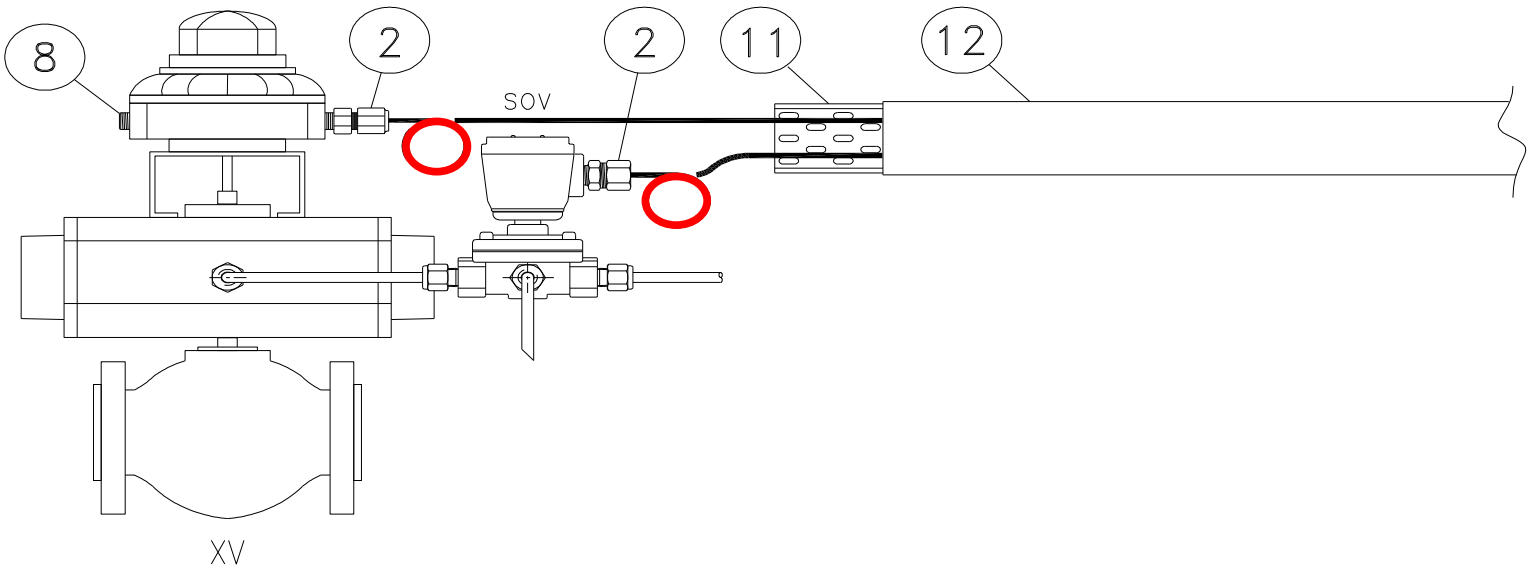

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**

REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy


CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Pneumatic Hook-Ups	Sh. 6 of 6 Date: 08/07/2024 Rev. 01

PNEUMATIC HOOK-UP FOR ON-OFF VALVES

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40078**

REV.:	DATE:	SIGNATURE:
1_B	06/11/24	G.Randi

ROSETTI MARINO SpA

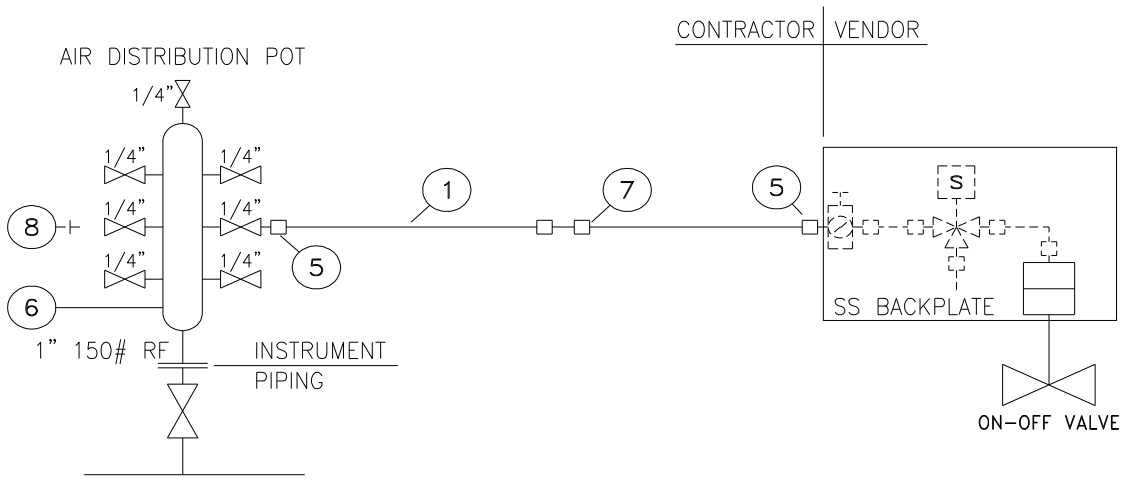


INSTRUMENT TAG	
1	25-BDV-022
2	25-BDV-005
3	25-BDV-007
4	25-BDV-010
5	25-BDV-013
6	25-BDV-016
7	25-BDV-019
8	25-SDV-001
9	25-SDV-023
10	25-XV-004
11	25-XV-006
12	25-XV-008
13	25-XV-009
14	25-XV-011
15	25-XV-012
16	25-XV-014
17	25-XV-015
18	25-XV-017
19	25-XV-018
20	25-XV-020
21	25-XV-021
22	25-XV-024
23	50-XV-001
24	50-XV-002
25	50-XV-003
26	50-XV-004
27	80-XV-001
28	64-SDV-001
29	50-XV-005
30	


NOTE:
(1) For Air Distribution Pot quantities see material take-off on sh. 4

POS.	NORM/STD CODE	DESCRIPTION	SIZE/CONNECTION TYPE	Q.TY
8		SS316 PLUG	1/4" NPT	Note 1
7		SS316 UNION	1/2" O.D. x 1/2" O.D.	N. 1
6		SS316 AIR DISTRIBUTION POT	1" 150#RF - N. 7 1/4" BALL VALVES	Note 1
5		SS316 MALE CONNECTOR	1/4" NPT x 1/2" O.D.	N. 2
1		SS 316L TUBING	1/2" x 0,049"Thk	10 m


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

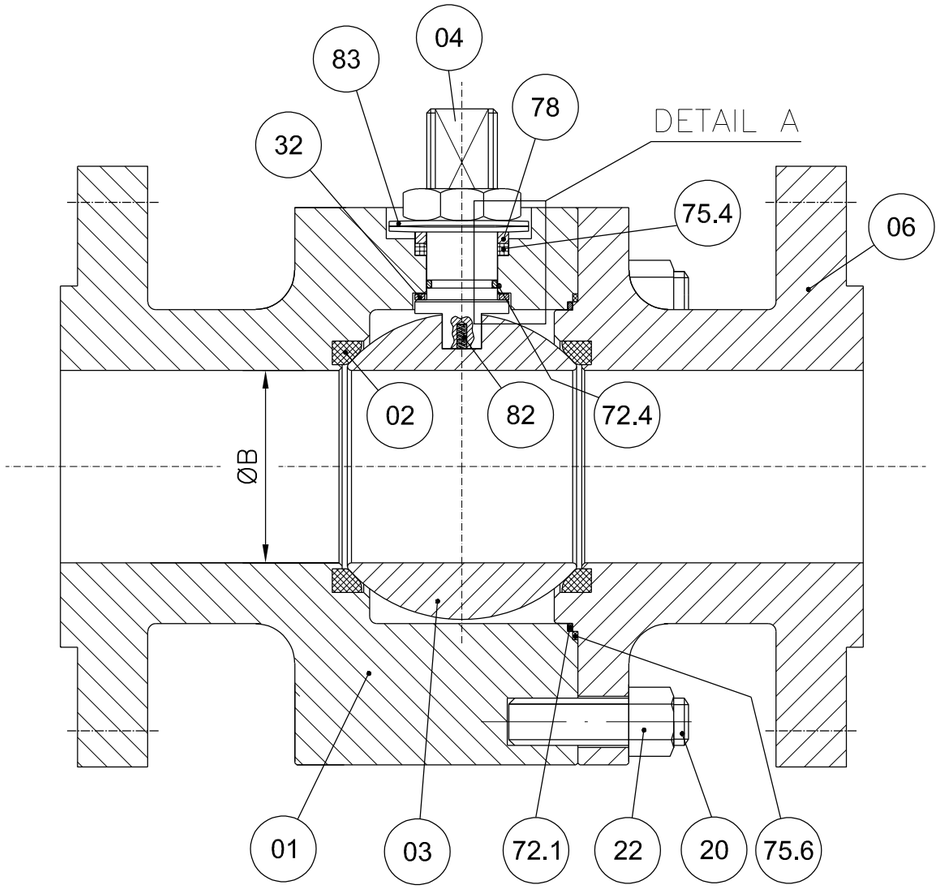


DETAIL A




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-024	25
	2	Service				HYDROGEN TO STORAGE TANKS DEPRESS.	
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80013	Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-143-03HSS-N	
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm	1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L	NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN	
	8	Fluid State	Phase			GAS	GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40	
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29	80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40	
	14						
	15						
	16	Speed of	Design			Close : (12)	Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum	Open : -
	18						
	19						
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)	
	21	Body Size	Body Form			1"	FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L	(*)
	23	Connections	Rating			FLANGED ASME B16.5	#300
	24	Flange Finish	Gasket Material			RF	Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)	(*)
	26	Bolting				A193 B8M / A194 Gr. 8M	
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO	
	29	Fire Safe				(2)	
ACTUATOR	30	Manufacturer	Type			Rotork	Spring Return
	31	Model No.	Size			CP/S	035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal	Cylinder
	33	Ingress Protection	Certification			IP-66	II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE	CLOSE
	36	Fireproofing				NOT APPLICABLE	
	37	Solenoid Valve				25-XY-024 (9, 14, 15, 16) - Bifold FP06P	
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-024 (9, 17) - Soldo SS	25-ZSH-024 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED	
	40	Air Set	Handwheel			(*)	NOT REQUIRED
	41	Mounting Position				HORIZONTAL	
	42	Partial Stroke Test Facility				NOT REQUIRED	
	43	Control Type				-	
	44	Electrical Connection	Electrical Class			No. (*) / M20	H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-	
	47	Safety Valve	Model			-	-
	48	Check Valve	Mounting			-	-
PURCHASE	49	Manufacturer				FLUITEK	
	50	Model				FB3	
	51	Purchase Order Number				1724000204	

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description	Code :	Dwg. No.:	Rev.
03	06/12/24							
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)			
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)			

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

140	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
141	IFR	25-XV-020	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
142	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
143	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620210001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
144	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
145	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
146	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323304	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
147	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
148	IFR	25-XV-021	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
149	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
150	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620220001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
151	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
152	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
153	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323297	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
154	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
155	IFR	25-XV-024	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
156	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
157	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620230001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
158	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
159	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
160	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323291	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
161	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
162	IFR	50-XV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
163	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
164	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620240001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
165	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
166	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
167	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323289	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
168	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
169	IFR	50-XV-002	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
170	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
171	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620250001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
172	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
173	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
174	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323290	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
175	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
176	IFR	50-XV-003	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
177	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
178	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620260001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
179	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
180	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
181	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323299	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
182	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
183	IFR	50-XV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
184	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
185	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620270001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
186	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-ZSH-019	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-022	Hyrogen from vessels outlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSH-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-031	Nitrogen to V-25001A vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-032	Nitrogen to V-25001B vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-033	Nitrogen to V-25001C vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-034	Nitrogen to V-25001D vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-036	Nitrogen to V-25001F vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-038	Nitrogen to V-25001E vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSH-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSH-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSL-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSL-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSL-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSL-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSL-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSL-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSL-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSL-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSL-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSL-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSL-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-ZSL-019	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSL-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-ZSL-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-022	Hyrogen from vessels outlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSL-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-ZSL-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSL-031	Nitrogen to V-25001A vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSL-032	Nitrogen to V-25001B vessel	LOWER DECK	1724000740	AST SpA	EISENBAU	Batch:44219	GUARDABOX - GD SERIES GDSN0LIS2MS290	ATEX ZONE 2	FIDI 20 ATEX 0039X	1724000740-IN-DA-00004	CE Ex - II 2G Ex db IIC T6...T4	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-12005	No.	MARSHALLING CABINET B400-PCS-002

<01>

CONTROL VALVE LIMIT SWITCHES BOX (EISENBAU)

25-ZSL-036 (2 WH, 3 BK) — NOTE-2

25-ZSH-036 (5 WH, 6 BK) — NOTE-2

C-25-ZSL-036/00-JE-12005
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

C-25-ZSH-036/00-JE-12005
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

CONTROL VALVE LIMIT SWITCHES BOX (EISENBAU)

25-ZSL-038 (2 WH, 3 BK) — NOTE-2

25-ZSH-038 (5 WH, 6 BK) — NOTE-2

C-25-ZSL-038/00-JE-12005
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

C-25-ZSH-038/00-JE-12005
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)

25-ZSL-024 (1 WH, 2 BK) — PR1

25-ZSH-024 (5 WH, 6 BK) — PR2

NOTE-2

C-25-XV-024/00-JE-12005
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-1

WH/BK	1	WH/BK	PR1
	2		
	SH		
WH/BK	3	WH/BK	PR2
	4		
	SH		
WH/BK	5	WH/BK	PR3
	6		
	SH		
WH/BK	7	WH/BK	PR4
	8		
	SH		
WH/BK	9	WH/BK	PR5
	10		
	SH		
WH/BK	11	WH/BK	PR6
	12		
	SH		
SPARE	13	WH/BK	PR7
	14		
	SH		
SPARE	15	WH/BK	PR8
	16		
	SH		
SPARE	17	WH/BK	PR9
	18		
	SH		
SPARE	19	WH/BK	PR10
	20		
	SH		
SPARE	21	WH/BK	PR11
	22		
	SH		
SPARE	23	WH/BK	PR12
	24		
	SH		
	OS		

00-JE-12005/B400-PCS-002
12x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-00-JE-12005

PR1 WH/BK	1	25-ZSL-036
Shield Bar	2	
PR2 WH/BK	3	25-ZSH-036
Shield Bar	4	
PR3 WH/BK	5	25-ZSL-038
Shield Bar	6	
PR4 WH/BK	7	25-ZSH-038
Shield Bar	8	
PR5 WH/BK	9	25-ZSL-024
Shield Bar	10	
PR6 WH/BK	11	25-ZSH-024
Shield Bar	12	
PR7 WH/BK	13	SPARE
Shield Bar	14	
PR8 WH/BK	15	SPARE
Shield Bar	16	
PR9 WH/BK	17	SPARE
Shield Bar	18	
PR10 WH/BK	19	SPARE
Shield Bar	20	
PR11 WH/BK	21	SPARE
Shield Bar	22	
PR12 WH/BK	23	SPARE
	24	

Shield Bar — I.E.

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_I	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00–JE–12005

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90–DDL–IN–DG–40015	SHEET 021	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

EU Type Examination Certificate CML 19ATEX1359X Issue 1

1 Equipment intended for use in Potentially Explosive Atmospheres Directive 2014/34/EU

2 Equipment **SOLDO™ SK and SQ Series Limit Switch Boxes**

3 Manufacturer **Rotork Instruments Italy srl**

4 Address **Via Portico 17**
24050
Orio al Serio (BG)
Italy

5 The equipment is specified in the description of this certificate and the documents to which it refers.

6 CML B.V., Chamber of Commerce No 67386717, Koopvaardijweg 32, 4906CV Oosterhout, The Netherlands, Notified Body Number 2776, in accordance with Article 17 of Directive 2014/34/EU of the European Parliament and of the Council, dated 26 February 2014, certifies that this equipment has been found to comply with the Essential Health and Safety Requirements relating to the design and construction of equipment intended for use in potentially explosive atmospheres given in Annex II to the Directive.

The examination and test results are recorded in the confidential reports listed in Section 12.

7 If an 'X' suffix appears after the certificate number, it indicates that the equipment is subject to conditions of safe use (affecting correct installation or safe use). These are specified in Section 14.

8 This EU Type Examination certificate relates only to the design and construction of the specified equipment or component. Further requirements of Directive 2014/34/EU Article 13 apply to the manufacture of the equipment or component and are separately certified.

9 Compliance with the Essential Health and Safety Requirements, with the exception of those listed in the confidential report, has been demonstrated through compliance with the following documents:

EN IEC 60079-0:2018 EN 60079-1:2014 EN 60079-31:2014

10 The equipment shall be marked with the following:

Ⅱ 2 G D

Ex db IIC T* Gb

Ex tb IIIC T*°C Db

Ta = -55°C to +*°C

**The ambient temperature classes and maximum surface temperature for dust depend upon the ambient temperature ranges. See Table in Section 11.*

11 Description

The SOLDO™ SK and SQ Series Limit Switch Boxes are electromechanical devices used to indicate the position of valves/actuators etc. by means of an electrical signal and an optional visual indicator. The metallic enclosure is constructed from aluminium (SK) or 316 or 316L stainless steel (SQ) and comprises of two enclosure halves secured with 4 x M6 stainless steel fasteners with a minimum property class of 500 MPa. An operating rod passes through each enclosure half for connection to the device being monitored. The rod operates the internal switch/sensor for signalling and passes through to the external indicator (when fitted). There are two threaded entries (M20 or ½" NPT) into the enclosure for cable entry.

The applicable ambient temperature ranges and corresponding Temperature Classes and Maximum Surface Temperatures for Dust are detailed in the table below:

Ambient Temp. Range	T Class	Maximum Surface Temp. for Dust
-55°C to +60°C	T6	T85°C
-55°C to +80°C	T5	T100°C
-55°C to +105°C	T4	T135°C

Rating:

Max. Voltage: 125 Vdc/250 Vac
Max. Current: 10 A
Max. Power: 10 W

Notes:

- Sira 12ATEX1098X is superseded by this certificate.
- The product covered by Issue 0 of this certificate remains identical to that previously covered by Sira 12ATEX1098X.
- Where Sira 12ATEX1098X is specified in other product certification, or other technical specifications, this certificate reference for the product shall be used in its place; updating of the other product certificate or technical specification is not required.

Variation 1

This variation introduced the following changes:

i. Introduction of power dissipation calculation as supporting certification document.

12 Certificate history and evaluation reports

Issue	Date	Associated report	Notes
0	04 Oct 2019	R12654A/00	Initial issue
1	27 Mar 2024	R17518A/00	Introduction of Variation 1

Note: Drawings that describe the equipment or component are listed in the Annex.

13 Conditions of Manufacture

The following conditions are required of the manufacturing process for compliance with the certification.

i. Where the product incorporates certified parts or safety critical components, the manufacturer of the product defined on this certificate shall continually monitor these parts/components for any modifications introduced by the manufacturer(s) of these constituent parts. If the manufacturer of any constituent part introduces any changes which affect the compliance of the certified product that is the subject of this certificate, the manufacturer is required to have this certificate updated.

ii. The power dissipation inside the flameproof enclosure shall not exceed 10 W.

14 Specific Conditions of Use (Special Conditions)

The following conditions relate to safe installation and/or use of the equipment.

i. The equipment is fitted with a non-conducting position indicator which could potentially generate an ignition-capable level of electrostatic charge under certain extreme conditions. Therefore, the equipment shall not be installed in a location where it may be subjected to external conditions (such as high-pressure steam) which might cause a build-up of electrostatic charge on the non-conducting surfaces. Additionally, cleaning of the equipment should be done only with a damp cloth.

ii. The maximum temperature at the cable entry points may exceed 70°C. The user shall refer to the manufacturer's instructions document for guidance in respect of the selection of suitable cabling for the equipment.


iii. Dust layers in excess of 50 mm shall not be allowed to form on the equipment.

iv. The following have a minimum flamepath width (L) and maximum gap (i_c) other than that detailed in EN 60079-1 Table 3 and are detailed below:


Flamepath	**Joint Width (L) mm**	**Max. Gap (i_c) mm**
Cover shaft/Cover	26	0.097
Body Shaft/Body	26	0.097

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

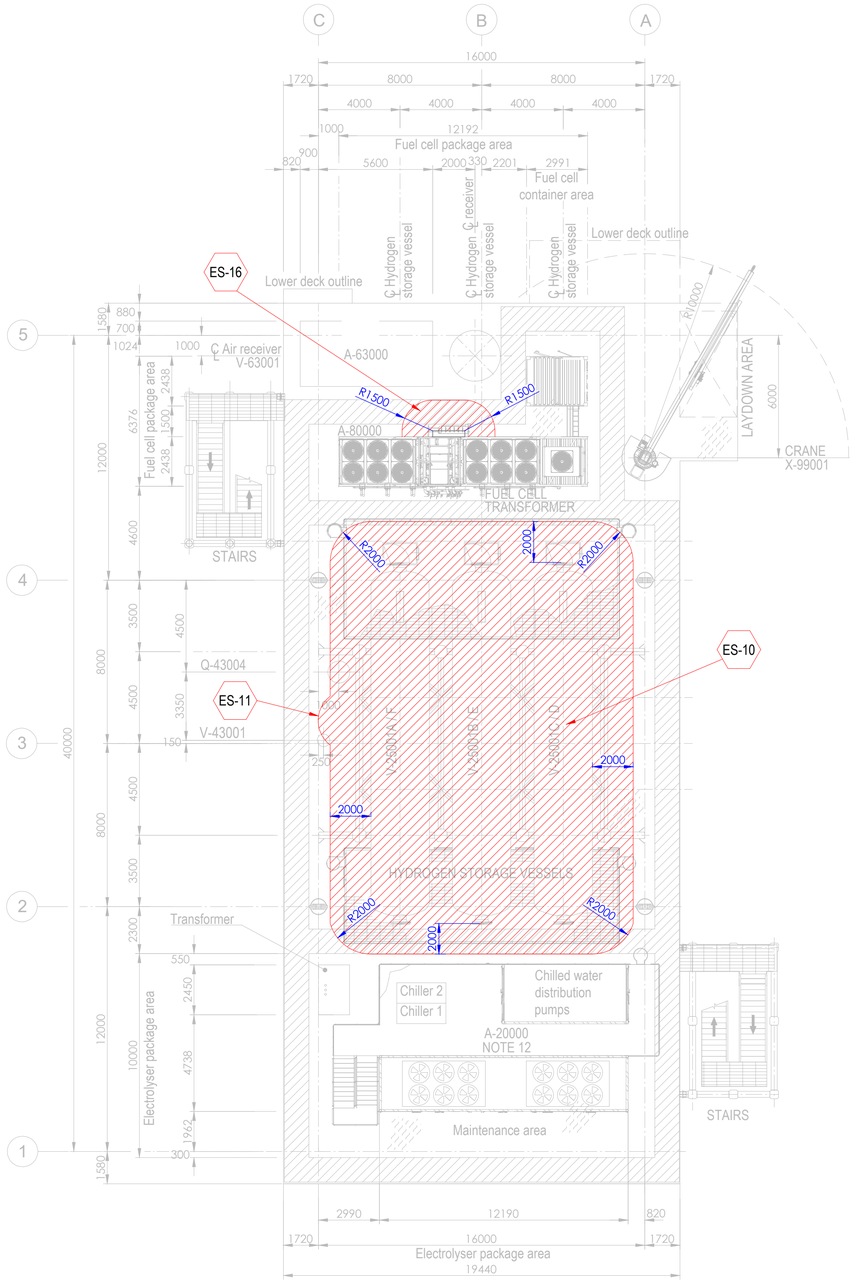


PLAN ON UPPER DECK
EL+30.310 T.O.S.

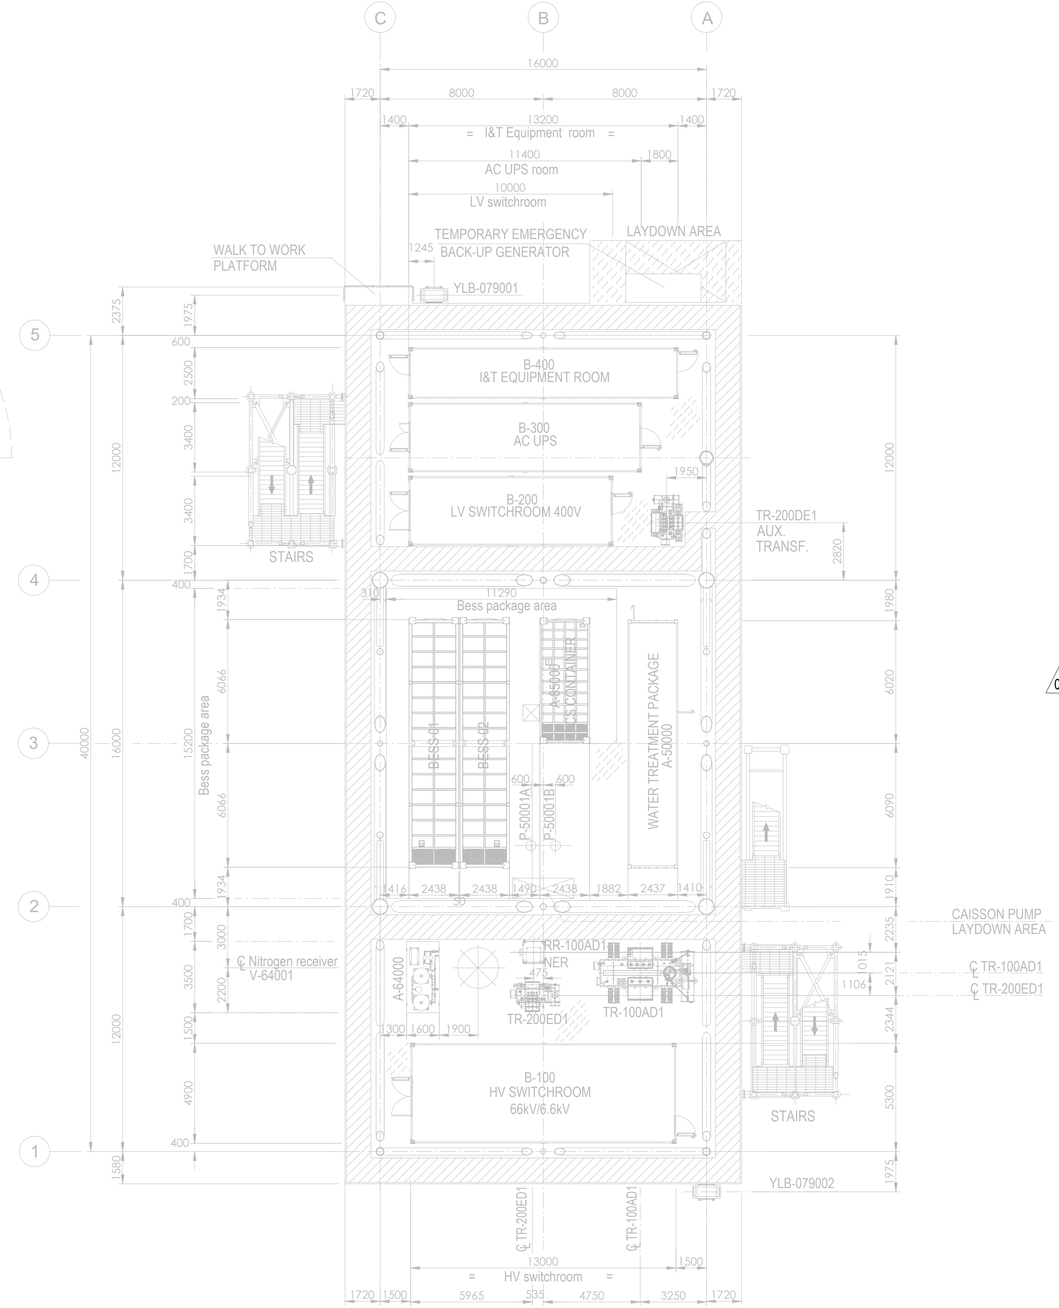

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

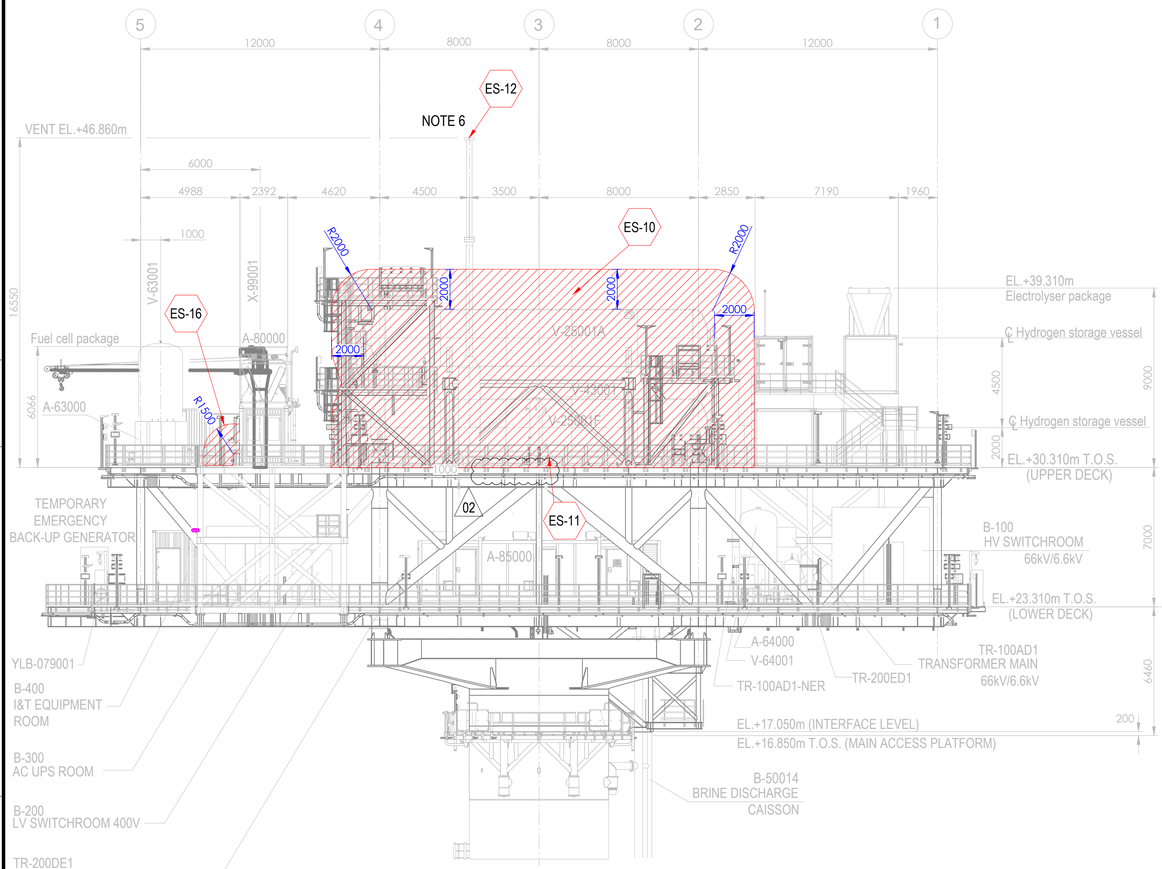



ELEVATION LOOKING EAST

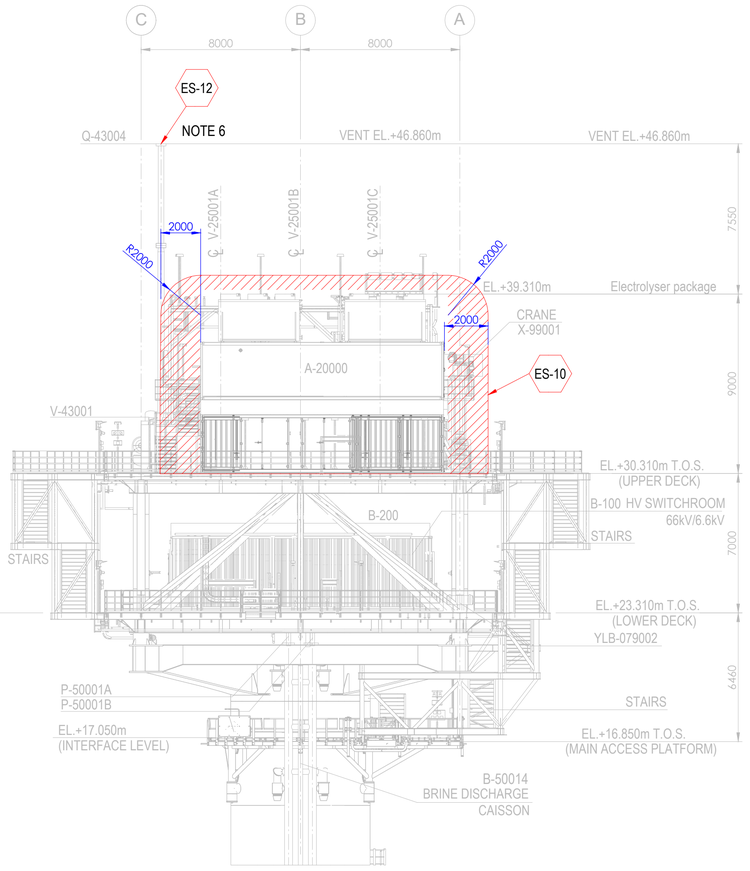

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

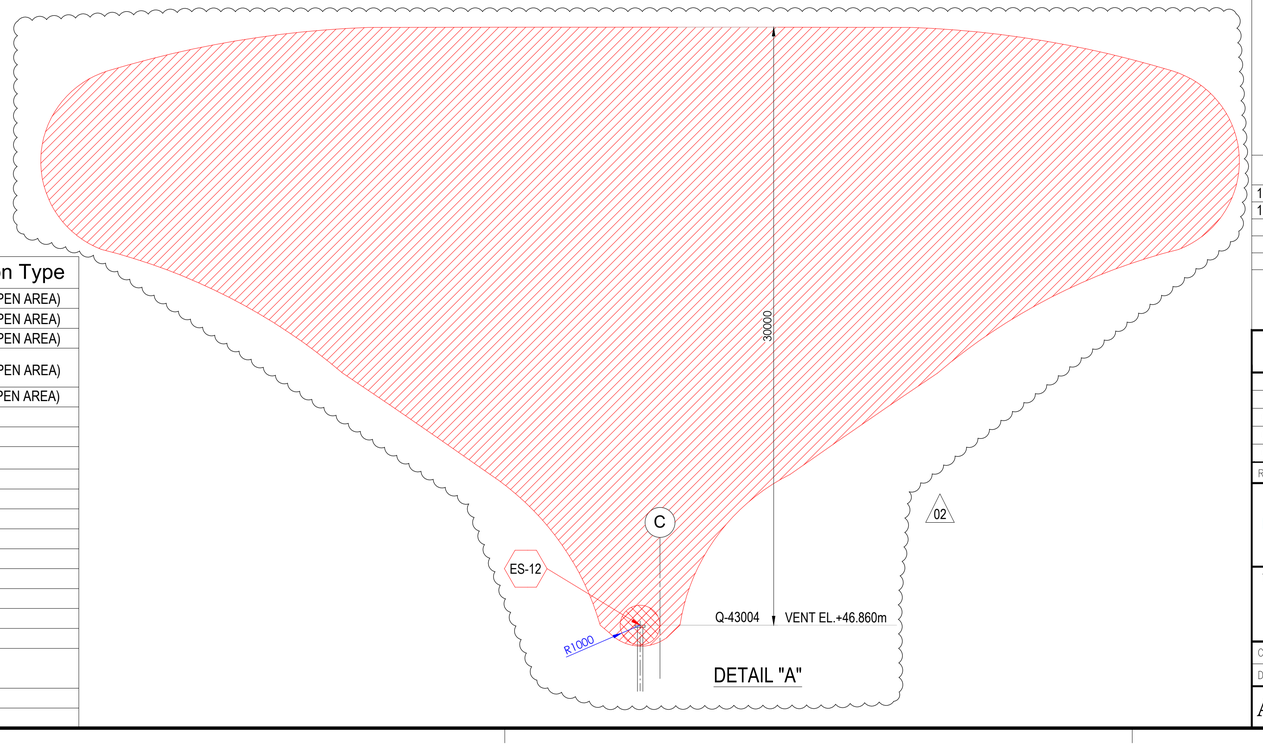



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PCV-024	: Air Set Filter - Nitrogen to Distribution Header Shut-Down	Dwg	123A90-DDL-PR-PID-80027
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10002040	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**	FL20424-0098				
Manufacturer	BIFOLD			**Model**	SH05-FR-SR-MD-10-X4				
Cert No.	D.o.C. by Manufacturer			**Equipment Ambient Temp.**	-20 °C to + 40 °C				
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP66

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		OK	
	Physical check	x	OK	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PCV-024	: Air Set Filter - Nitrogen to Distribution Header Shut-Down			Dwg	123A90-DDL-PR-PID-80027
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10002040		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-PCV-024	: Air Set Filter - Nitrogen to Distribution Header Shut-Down			Dwg	123A90-DDL-PR-PID-80027
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10002040		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-30	2025-01-31	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-30T10:22:52.141Z	PROVERLIS Digitaly signed by Luca Mussi 2025-01-31T12:38:56.794Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

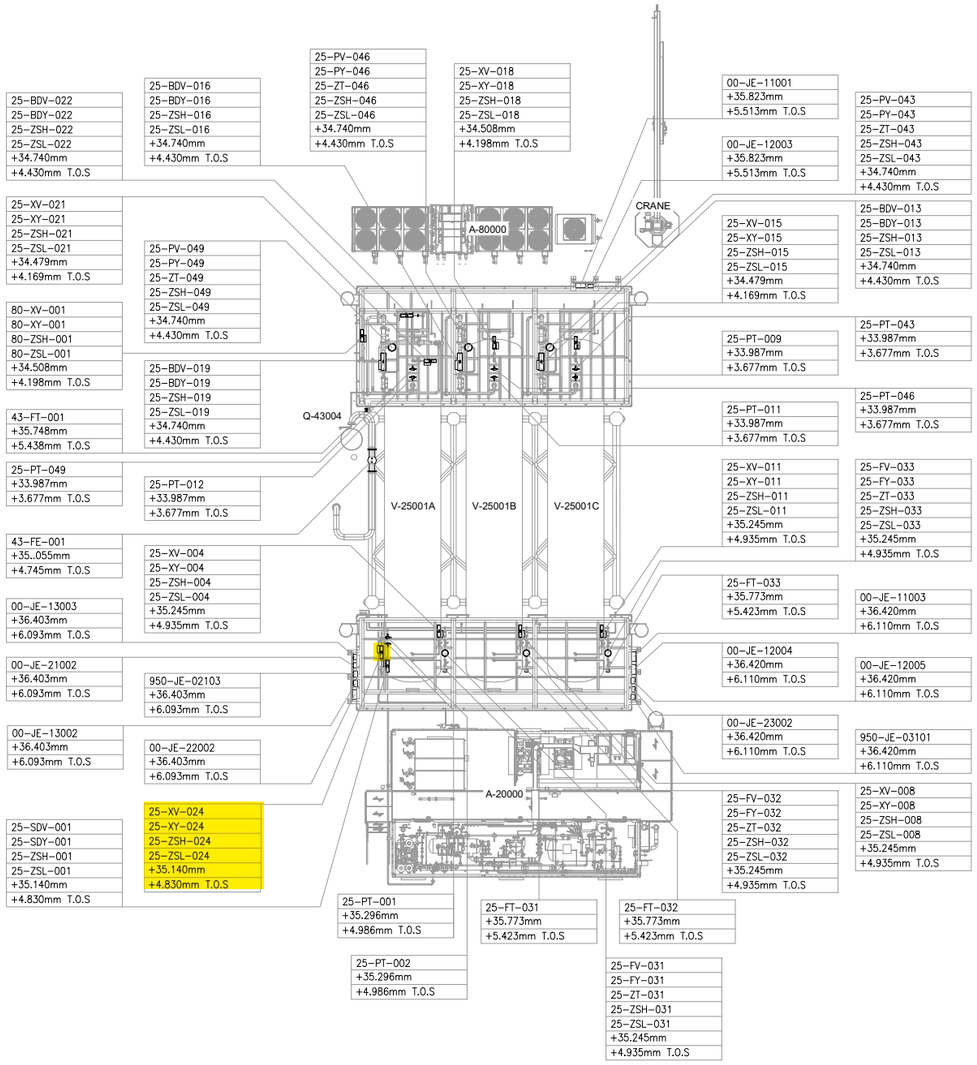

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

	DRAWING NO.	SHEET	REV.
A1	123A90–DDL–IN–DL–40081	002	02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. DRAWING_NO.

REV. REV

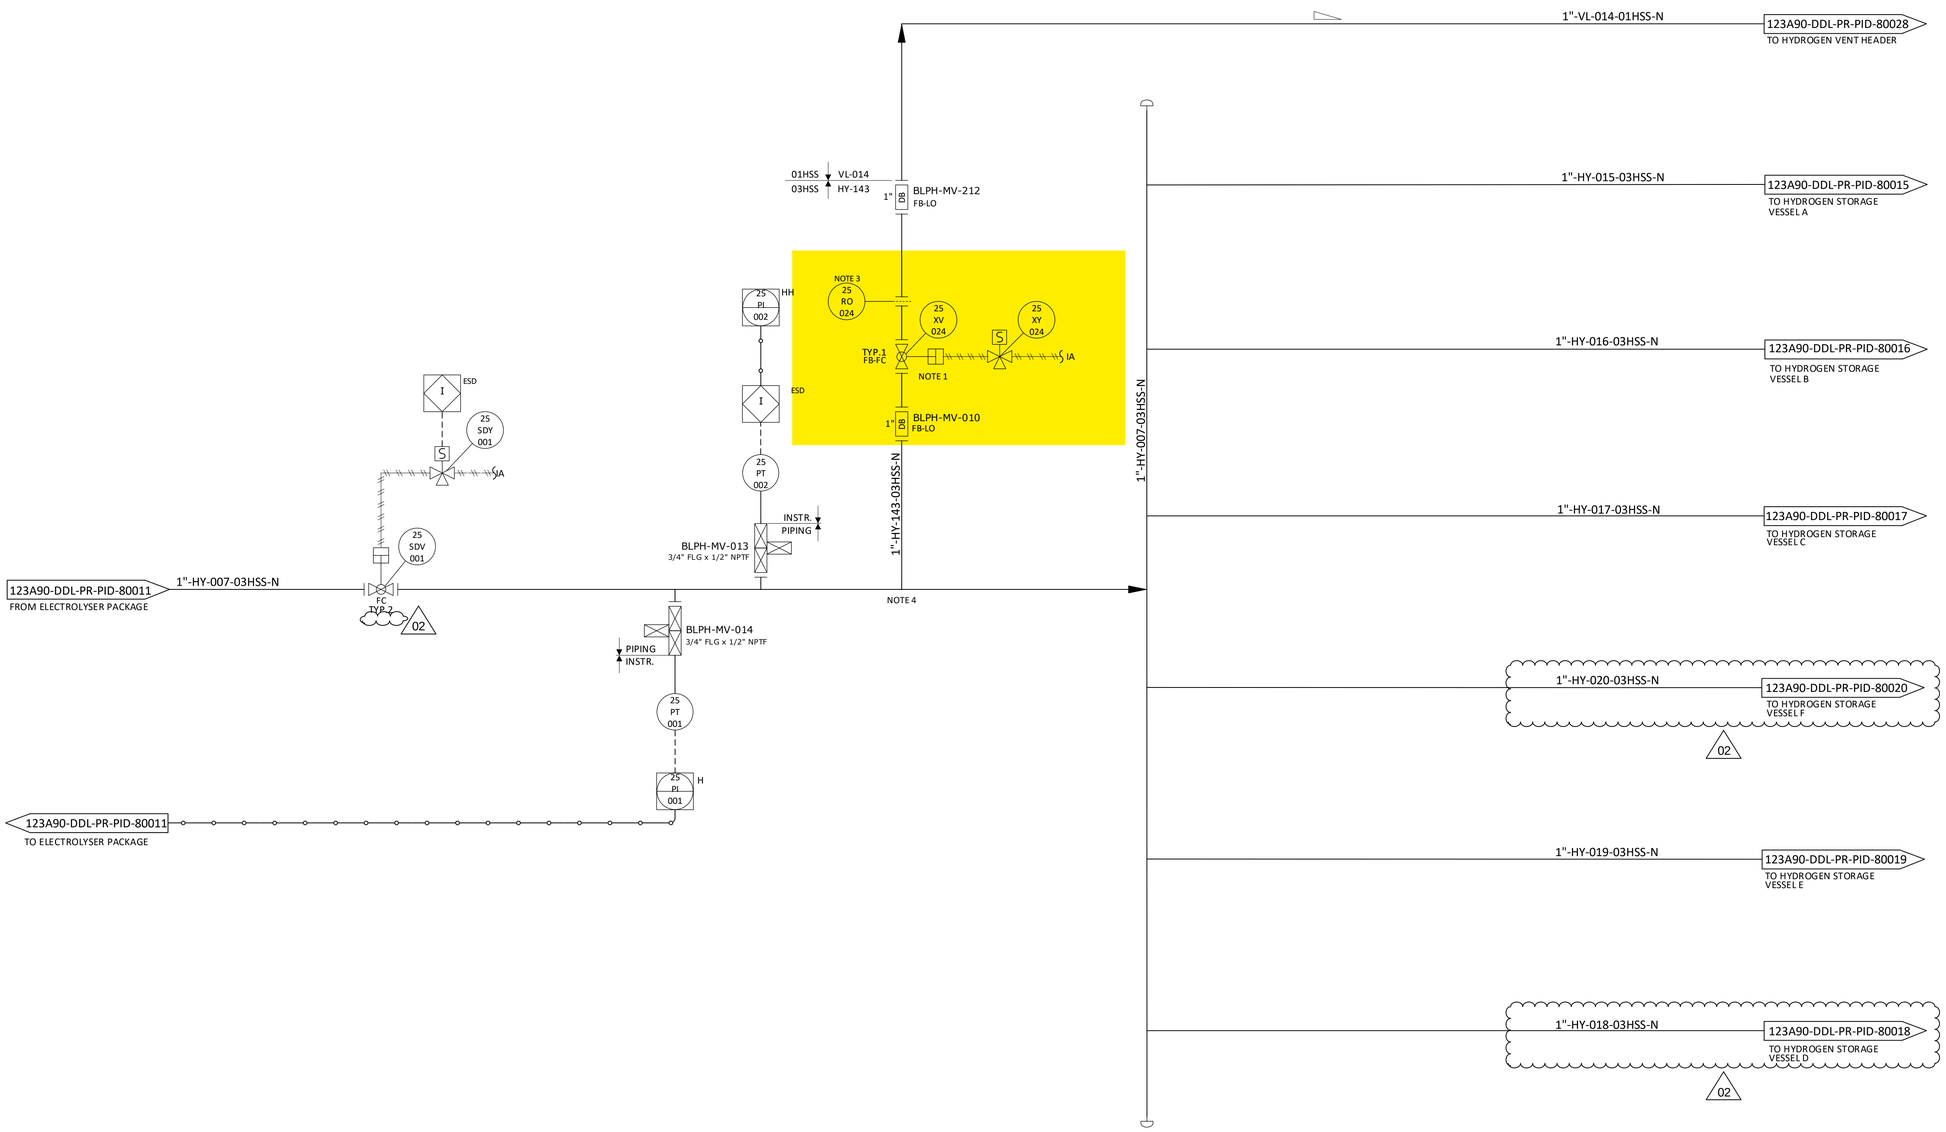

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :


BLPH PIPING AND INSTRUMENTATION DIAGRAM HYDROGEN STORAGE VESSELS HEADER (INLET)

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80013	SHEET 001	REV. 02

File Name : FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

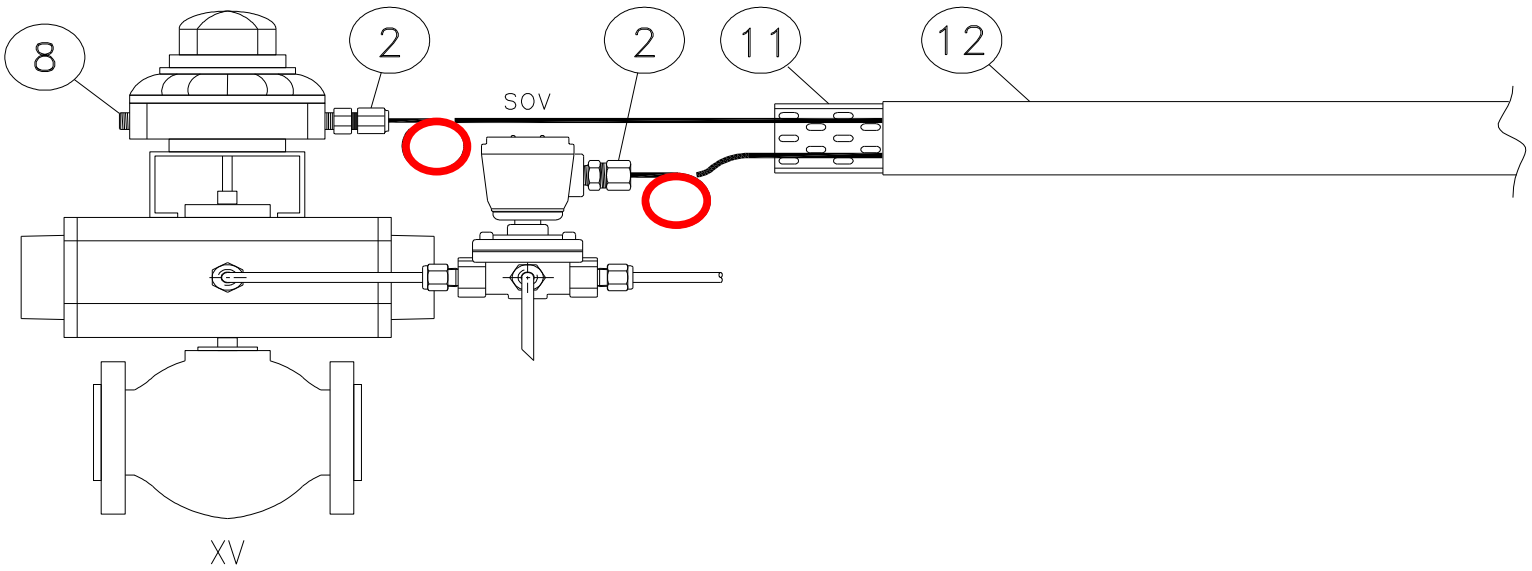

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**

REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi


ROSETTI MARINO SpA

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

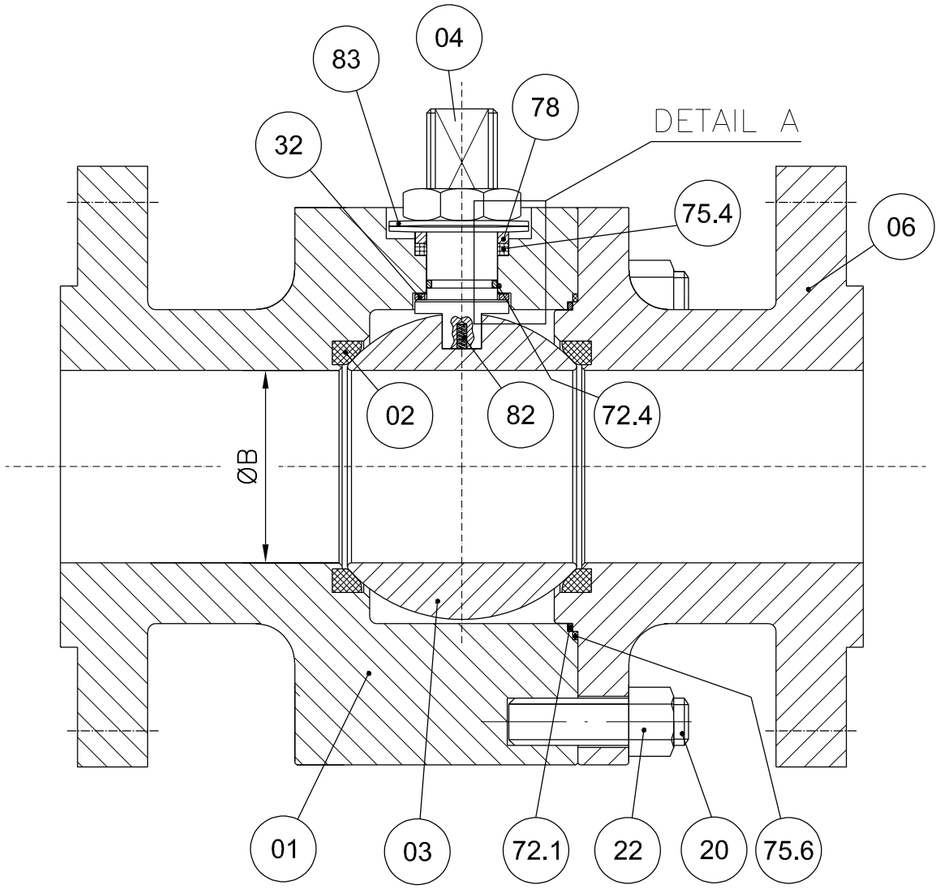


DETAIL A




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-024	25
	2	Service				HYDROGEN TO STORAGE TANKS DEPRESS.	
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80013	Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-143-03HSS-N	
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm	1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L	NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN	
	8	Fluid State	Phase			GAS	GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40	
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29	80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40	
	14						
	15						
	16	Speed of	Design			Close : (12)	Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum	Open : -
	18						
	19						
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)	
	21	Body Size	Body Form			1"	FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L	(*)
	23	Connections	Rating			FLANGED ASME B16.5	#300
	24	Flange Finish	Gasket Material			RF	Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)	(*)
	26	Bolting				A193 B8M / A194 Gr. 8M	
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO	
	29	Fire Safe				(2)	
ACTUATOR	30	Manufacturer	Type			Rotork	Spring Return
	31	Model No.	Size			CP/S	035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal	Cylinder
	33	Ingress Protection	Certification			IP-66	II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE	CLOSE
	36	Fireproofing				NOT APPLICABLE	
	37	Solenoid Valve				25-XY-024 (9, 14, 15, 16) - Bifold FP06P	
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-024 (9, 17) - Soldo SS	25-ZSH-024 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED	
	40	Air Set	Handwheel			(*)	NOT REQUIRED
	41	Mounting Position				HORIZONTAL	
	42	Partial Stroke Test Facility				NOT REQUIRED	
	43	Control Type				-	
	44	Electrical Connection	Electrical Class			No. (*) / M20	H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-	
	47	Safety Valve	Model			-	-
	48	Check Valve	Mounting			-	-
PURCHASE	49	Manufacturer				FLUITEK	
	50	Model				FB3	
	51	Purchase Order Number				1724000204	

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description	Code :	Dwg. No.:	Rev.
03	06/12/24							
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)			
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)			

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

140	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
141	IFR	25-XV-020	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
142	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
143	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620210001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
144	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
145	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
146	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323304	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
147	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
148	IFR	25-XV-021	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
149	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
150	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620220001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
151	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
152	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
153	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323297	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
154	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
155	IFR	25-XV-024	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
156	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
157	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620230001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
158	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
159	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
160	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323291	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
161	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
162	IFR	50-XV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
163	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
164	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620240001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
165	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
166	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
167	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323289	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
168	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
169	IFR	50-XV-002	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
170	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
171	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620250001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
172	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
173	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
174	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323290	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
175	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
176	IFR	50-XV-003	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
177	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
178	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620260001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
179	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
180	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
181	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323299	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
182	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
183	IFR	50-XV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
184	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
185	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620270001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
186	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

Document Reference: - D of C Baseefa14ATEX0223DR_01

EU Declaration of Conformity

Manufacturer: Bifold Fluidpower Ltd
Address: Broadgate, Oldham Broadway Business Park,
Chadderton, Oldham
Greater Manchester
OL9 9XA
UK

Tel: +44 (0)161-345-4777
E-mail: sales@bifold.co.uk

Product Type (Object of the Declaration):

Type SH, ASH & SC Filter Regulator

Declaration statement:

On behalf of the above company, I declare that, the *Object of the Declaration* described above is in conformity with the relevant Union harmonisation legislation: Directive 2014/34/EU, with the following limitation;

Limitation on the validity of the Declaration of Conformity:

None

Provisions of the Directive fulfilled by the Equipment:

Group II Category 2 Gb Db Ex c IIC T6

Bifold Technical File Reference:

DF-FP_SH_20140627114952

Technical File lodged with Notified Body:

SGS Fimko Oy 0598 Helsinki, Finland

SGS Baseefa Technical File Reference:

Baseefa14ATEX0223DR

Technical basis for compliance with the Essential Health and Safety Requirements of Directive 2014/34/EU: -

BS EN 13463-1: 2009 – Non-electrical equipment for use in potentially explosive atmospheres. Basic method and requirements
BS EN 13463-5: 2011 – Non-electrical equipment for use in potentially explosive atmospheres. Protection by constructional safety 'c'

(A review against the following harmonised standards, shows no significant changes relevant to this equipment): -


BS EN ISO 80079-36: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Basic method and requirements
BS EN ISO 80079-37: 2016 – Explosive atmospheres. Non-electrical equipment for explosive atmospheres. Non-electrical type of protection constructional safety "c", control of ignition sources "b", liquid immersion "k"

Paul Barrow
Quality Manager


4th November 2020

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

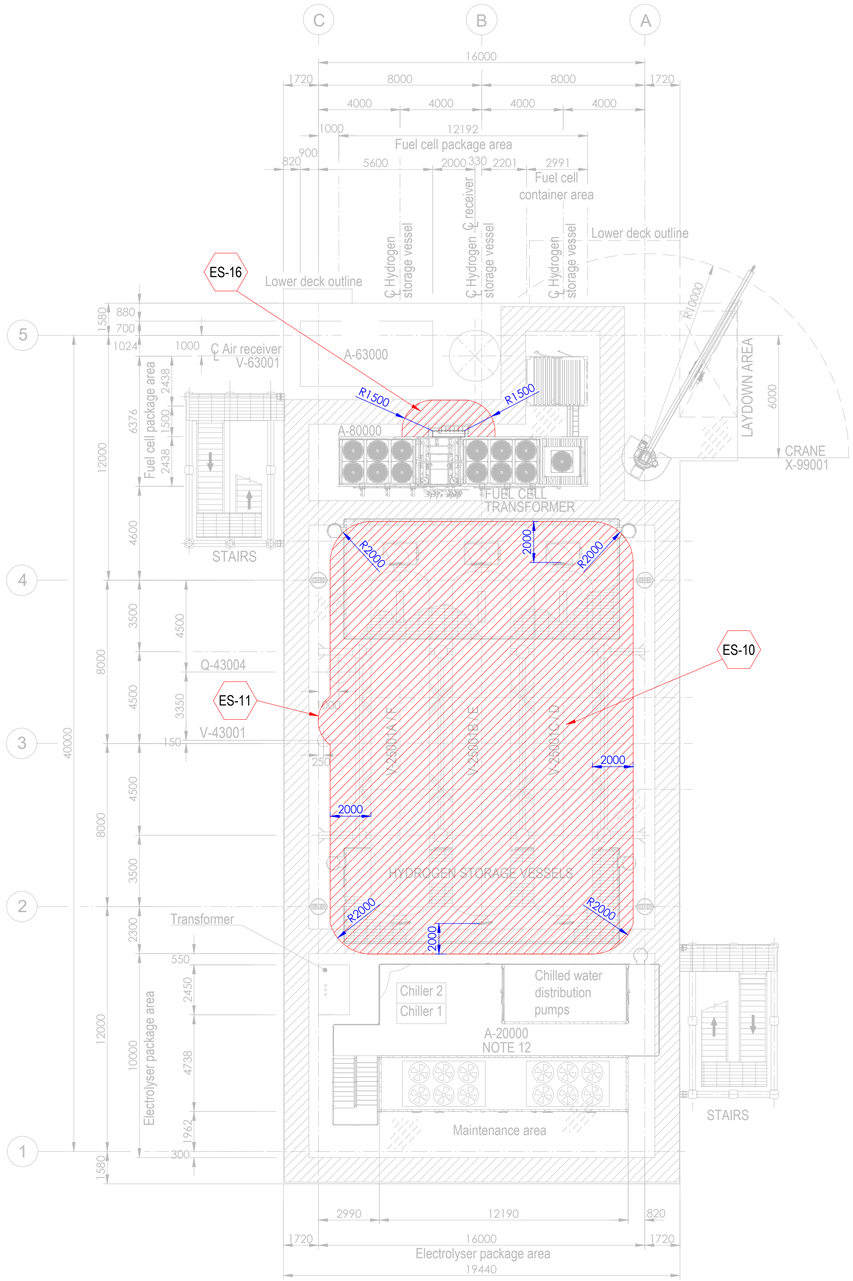


PLAN ON UPPER DECK
EL+30.310 T.O.S.

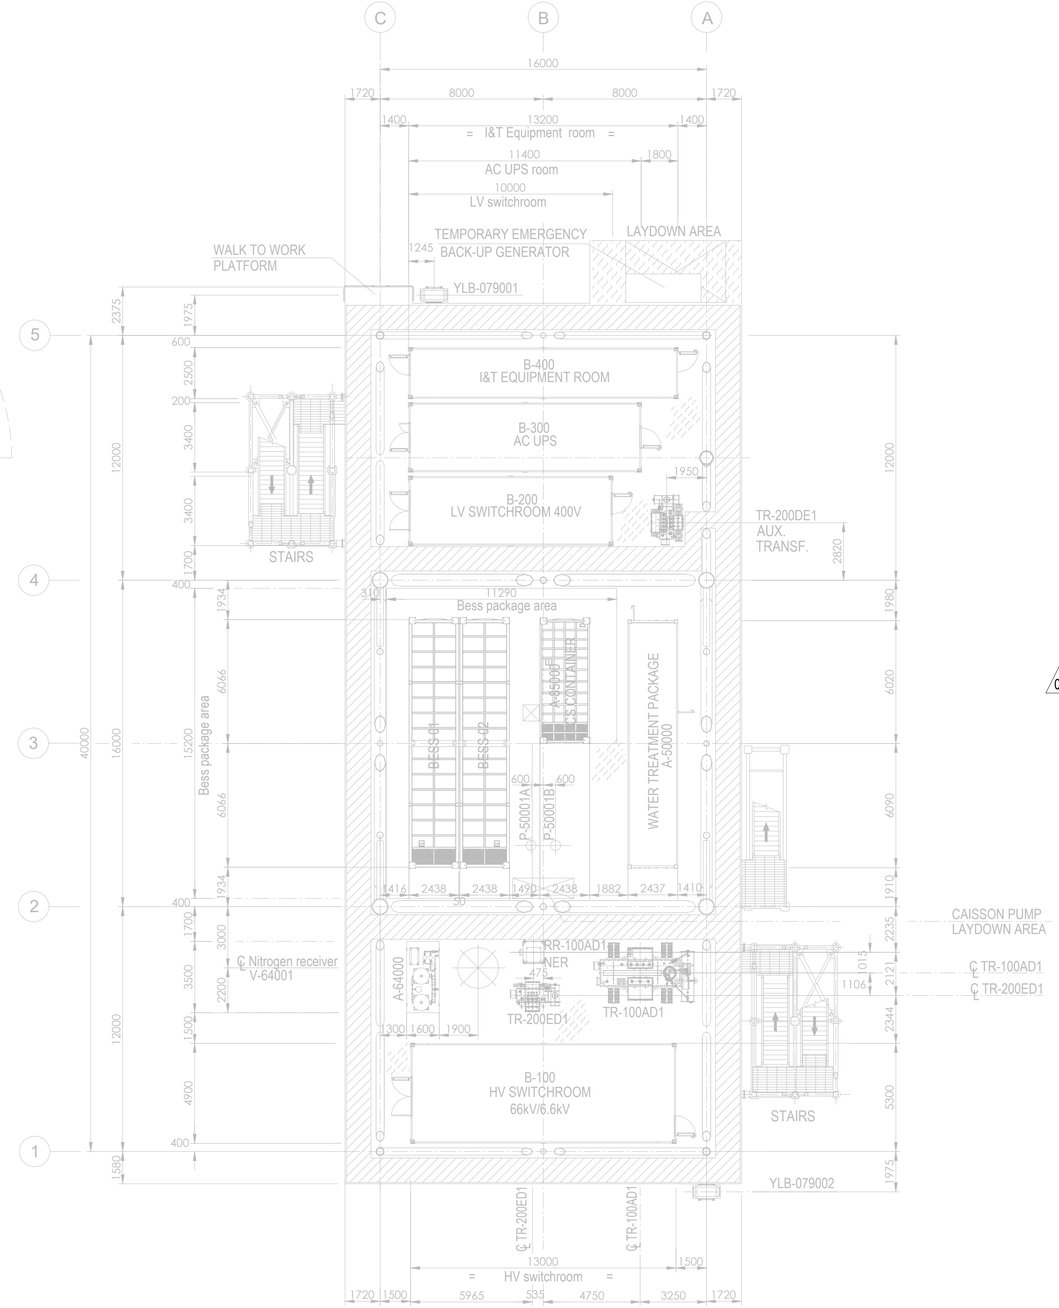

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

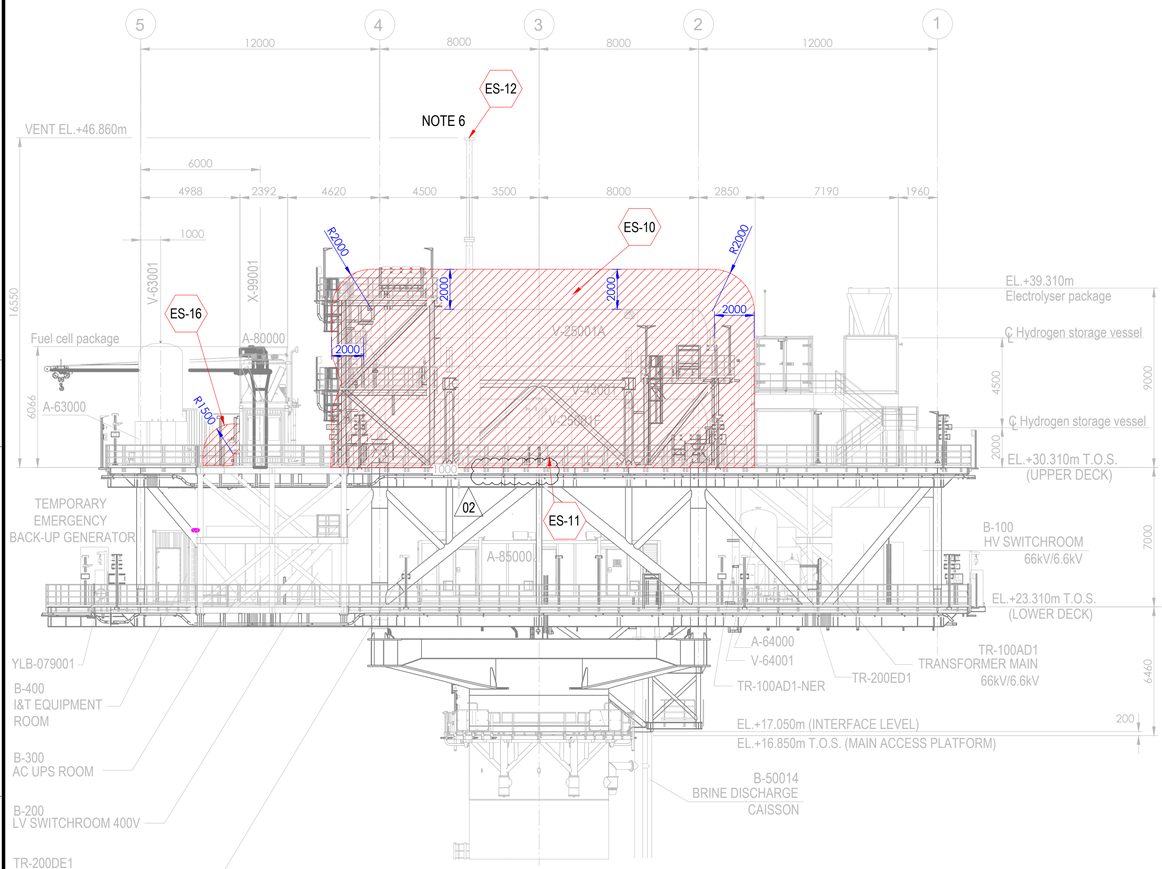



ELEVATION LOOKING EAST

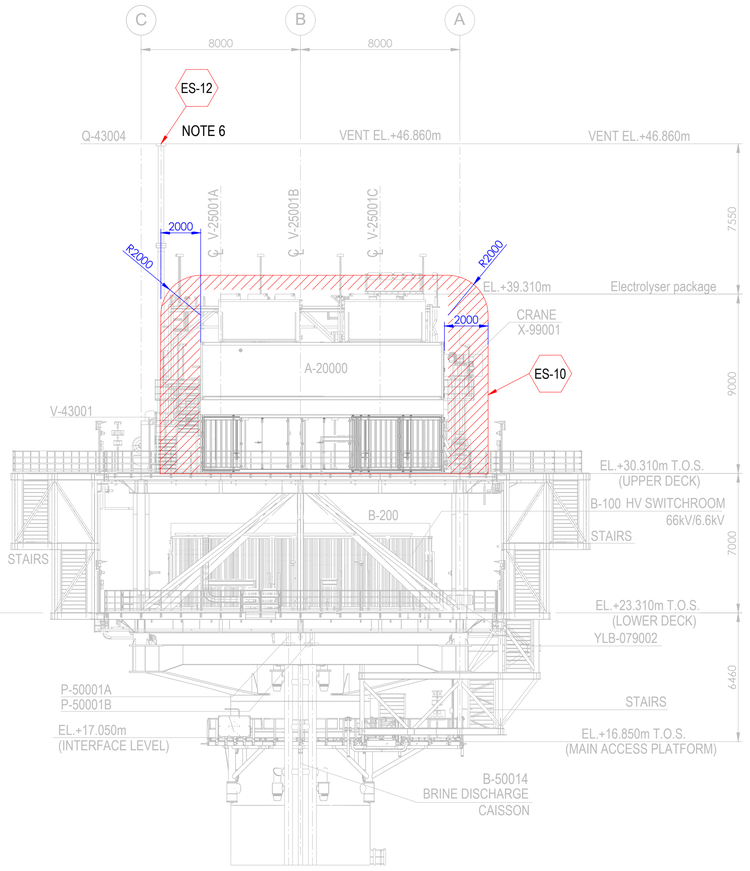

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

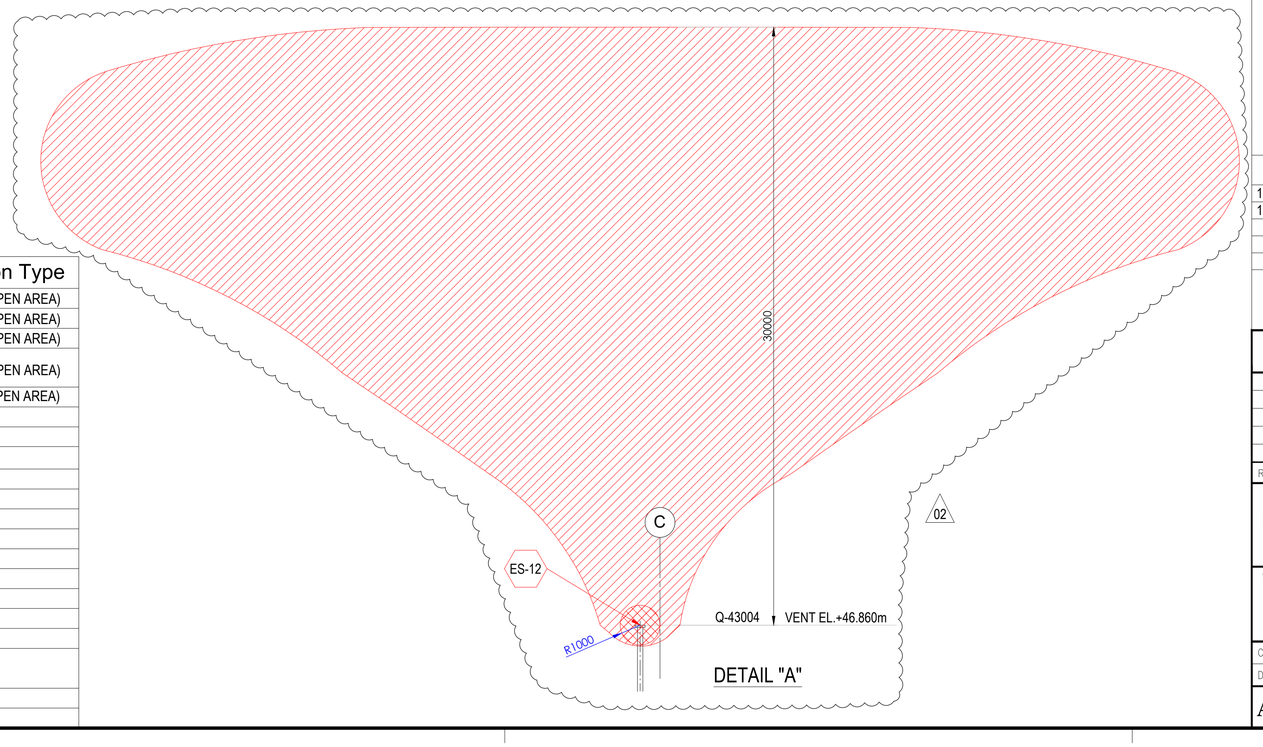



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PG -004	: Air Set Pressure Gauge Filter - Vessel V-25001A Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80015
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10004819	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		PW00DE2EIJB			
Manufacturer	Wika			**Model**		233.50.63			
Cert No.	D.o.C. by Manufacturer reference 11564220			**Equipment Ambient Temp.**		-20 °C to +60 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP65

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PG -004	: Air Set Pressure Gauge Filter - Vessel V-25001A Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80015
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004819	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-PG -004	: Air Set Pressure Gauge Filter - Vessel V-25001A Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80015
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004819	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks					
67	All Terminals are Ex n certified (if required on certificate)	x	NA		
68	Hermetically sealed and enclosed break devices are undamaged	x	NA		
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA		
70	Test port, if fitted, is functional (type “nR” only)	x	NA		
71	Breathing operation is satisfactory (type “nR” only)	x	NA		
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA		
73	The ventilation airflow is not impeded	x	NA		
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA		
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA		
76	Variable voltage/frequency installation complies with documentation	x	NA		
Extra Ex p checks					
77	Pressurization gas is correct type	x	NA		
78	Actual pressure is within maximum and minimum settings for equipment	x	NA		
79	Timers set as per certification documentation	x	NA		
80	Alarms and trip functions operate correctly as per certification documentation	x	NA		
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA		
82	Automatic electrical protective devices operate within permitted limits	x	NA		
83	Automatic electrical protective devices are set correctly	x	NA		
84	Protective gas inlet temperature is below maximum specified	x	NA		
85	Ducts, pipes and enclosures are in good condition	x	NA		
86	Protective gas is substantially free from contaminants	x	NA		
87	Protective gas pressure and/or flow is adequate	x	NA		
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA		
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA		
90	Specific conditions of use (if applicable) are complied with		NA		
Extra Ex i (Intrinsically Safe – IS) checks					
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA		
92	Cables are installed in accordance with the documentation	x	NA		
93	Segregation is maintained between IS and non-IS Circuits	x	NA		
94	Cable screens are isolated at one end (field side)	x	NA		
95	Cable screens are earthed in accordance with the documentation	x	NA		
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA		
97	Equipment installed is the one specified in the documentation	x	NA		
98	Ambient temperature range of the apparatus is correct for the installation	x	NA		
99	Service temperature range of the apparatus is correct for the installation	x	NA		
100	Installation is clearly labelled	x	NA		
101	Printed circuit boards are clean and undamaged	x	NA		
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA		
103	Point-to-point connections are all correct	x	NA		
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA		
105	Earth connections maintain the integrity of the type of protection	x	NA		
106	Intrinsically safe circuit earthing is satisfactory	x	NA		
107	Insulation resistance is satisfactory	x	NA		
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA		

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA

Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	VENDOR ROTORK (PER FLUITEK)	RM (ROSETTI MARINO)	
Name	Stefano Linari	Giovanni Tangianu	
Date	2025-04-24	2025-04-24	
Signature	Digitaly signed by Stefano Linari 2025-04-24T13:19:54.058Z	Digitaly signed by Giovanni Tangianu 2025-04-24T14:58:06.046Z	

ROTORK CONTROLS ITALIA srl
Via Portico 17
24050 Orio Al Serio (BG)

Telefono: 0039 (0)5832221

E-mail: rotork.italia@rotork.com



WIKA Product Pass Italiano

serial number

WIKA

25-xv-004

Type 23X.50

Manometro a molla tubolare 232.50/233.50
Cassa in acciaio inox

Serial number:

PW00DE2EIJB

Item number:

57424821

Manufacturing date:

04/2025



ITEM	Tag	25-PG -004	: Air Set Pressure Gauge Filter - Vessel V-25001A Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80015		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10004819	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		8975GNEL			
Manufacturer	Wika			**Model**		233.50.63			
Cert No.	D.o.C. by Manufacturer, reference 11564220			**Equipment Ambient Temp.**		-20 °C to +60 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP65

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PG -004	: Air Set Pressure Gauge Filter - Vessel V-25001A Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80015
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004819	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-PG -004	: Air Set Pressure Gauge Filter - Vessel V-25001A Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80015
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004819	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks					
67	All Terminals are Ex n certified (if required on certificate)	x	NA		
68	Hermetically sealed and enclosed break devices are undamaged	x	NA		
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA		
70	Test port, if fitted, is functional (type “nR” only)	x	NA		
71	Breathing operation is satisfactory (type “nR” only)	x	NA		
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA		
73	The ventilation airflow is not impeded	x	NA		
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA		
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA		
76	Variable voltage/frequency installation complies with documentation	x	NA		
Extra Ex p checks					
77	Pressurization gas is correct type	x	NA		
78	Actual pressure is within maximum and minimum settings for equipment	x	NA		
79	Timers set as per certification documentation	x	NA		
80	Alarms and trip functions operate correctly as per certification documentation	x	NA		
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA		
82	Automatic electrical protective devices operate within permitted limits	x	NA		
83	Automatic electrical protective devices are set correctly	x	NA		
84	Protective gas inlet temperature is below maximum specified	x	NA		
85	Ducts, pipes and enclosures are in good condition	x	NA		
86	Protective gas is substantially free from contaminants	x	NA		
87	Protective gas pressure and/or flow is adequate	x	NA		
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA		
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA		
90	Specific conditions of use (if applicable) are complied with		NA		
Extra Ex i (Intrinsically Safe – IS) checks					
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA		
92	Cables are installed in accordance with the documentation	x	NA		
93	Segregation is maintained between IS and non-IS Circuits	x	NA		
94	Cable screens are isolated at one end (field side)	x	NA		
95	Cable screens are earthed in accordance with the documentation	x	NA		
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA		
97	Equipment installed is the one specified in the documentation	x	NA		
98	Ambient temperature range of the apparatus is correct for the installation	x	NA		
99	Service temperature range of the apparatus is correct for the installation	x	NA		
100	Installation is clearly labelled	x	NA		
101	Printed circuit boards are clean and undamaged	x	NA		
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA		
103	Point-to-point connections are all correct	x	NA		
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA		
105	Earth connections maintain the integrity of the type of protection	x	NA		
106	Intrinsically safe circuit earthing is satisfactory	x	NA		
107	Insulation resistance is satisfactory	x	NA		
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA		

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-31	2025-02-01	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-31T09:37:47.335Z	PROVERLIS Digitaly signed by Luca Mussi 2025-02-01T12:01:51.776Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

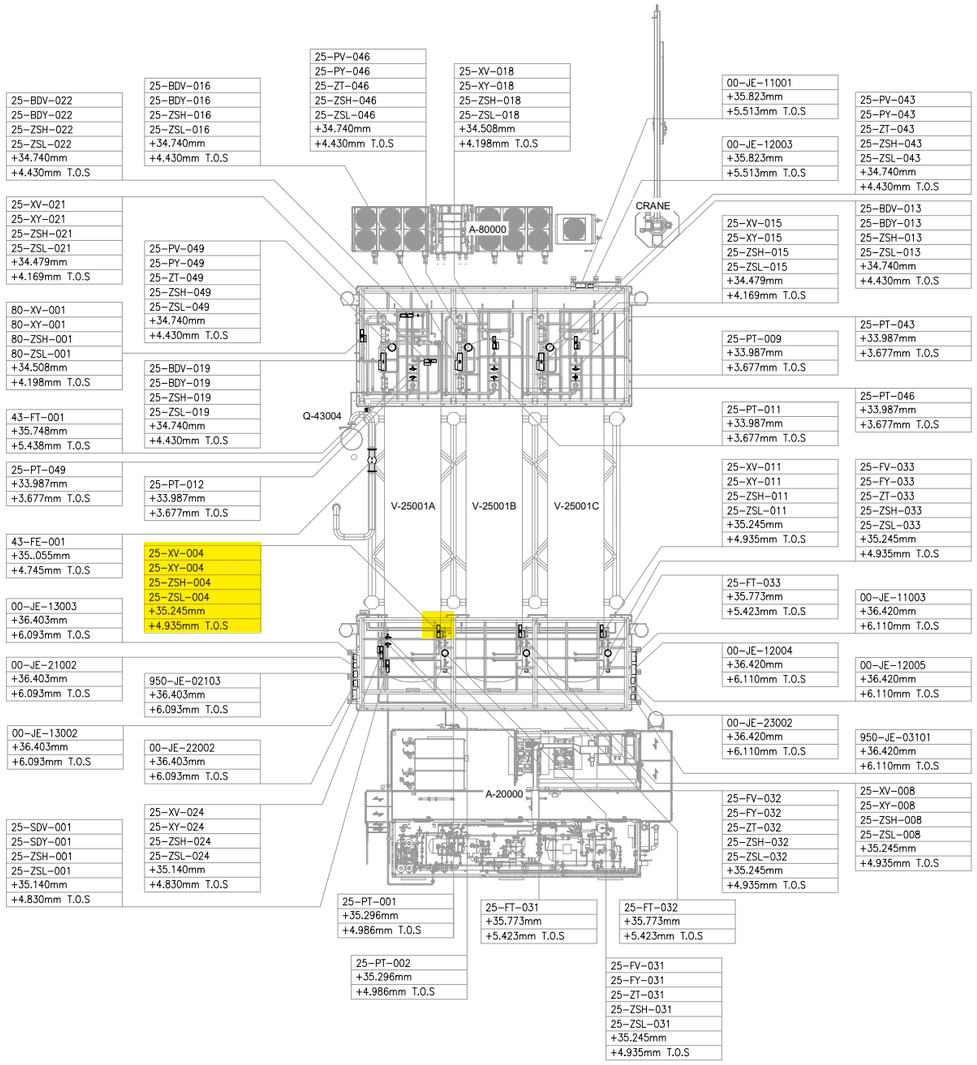

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 A

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg /AMB

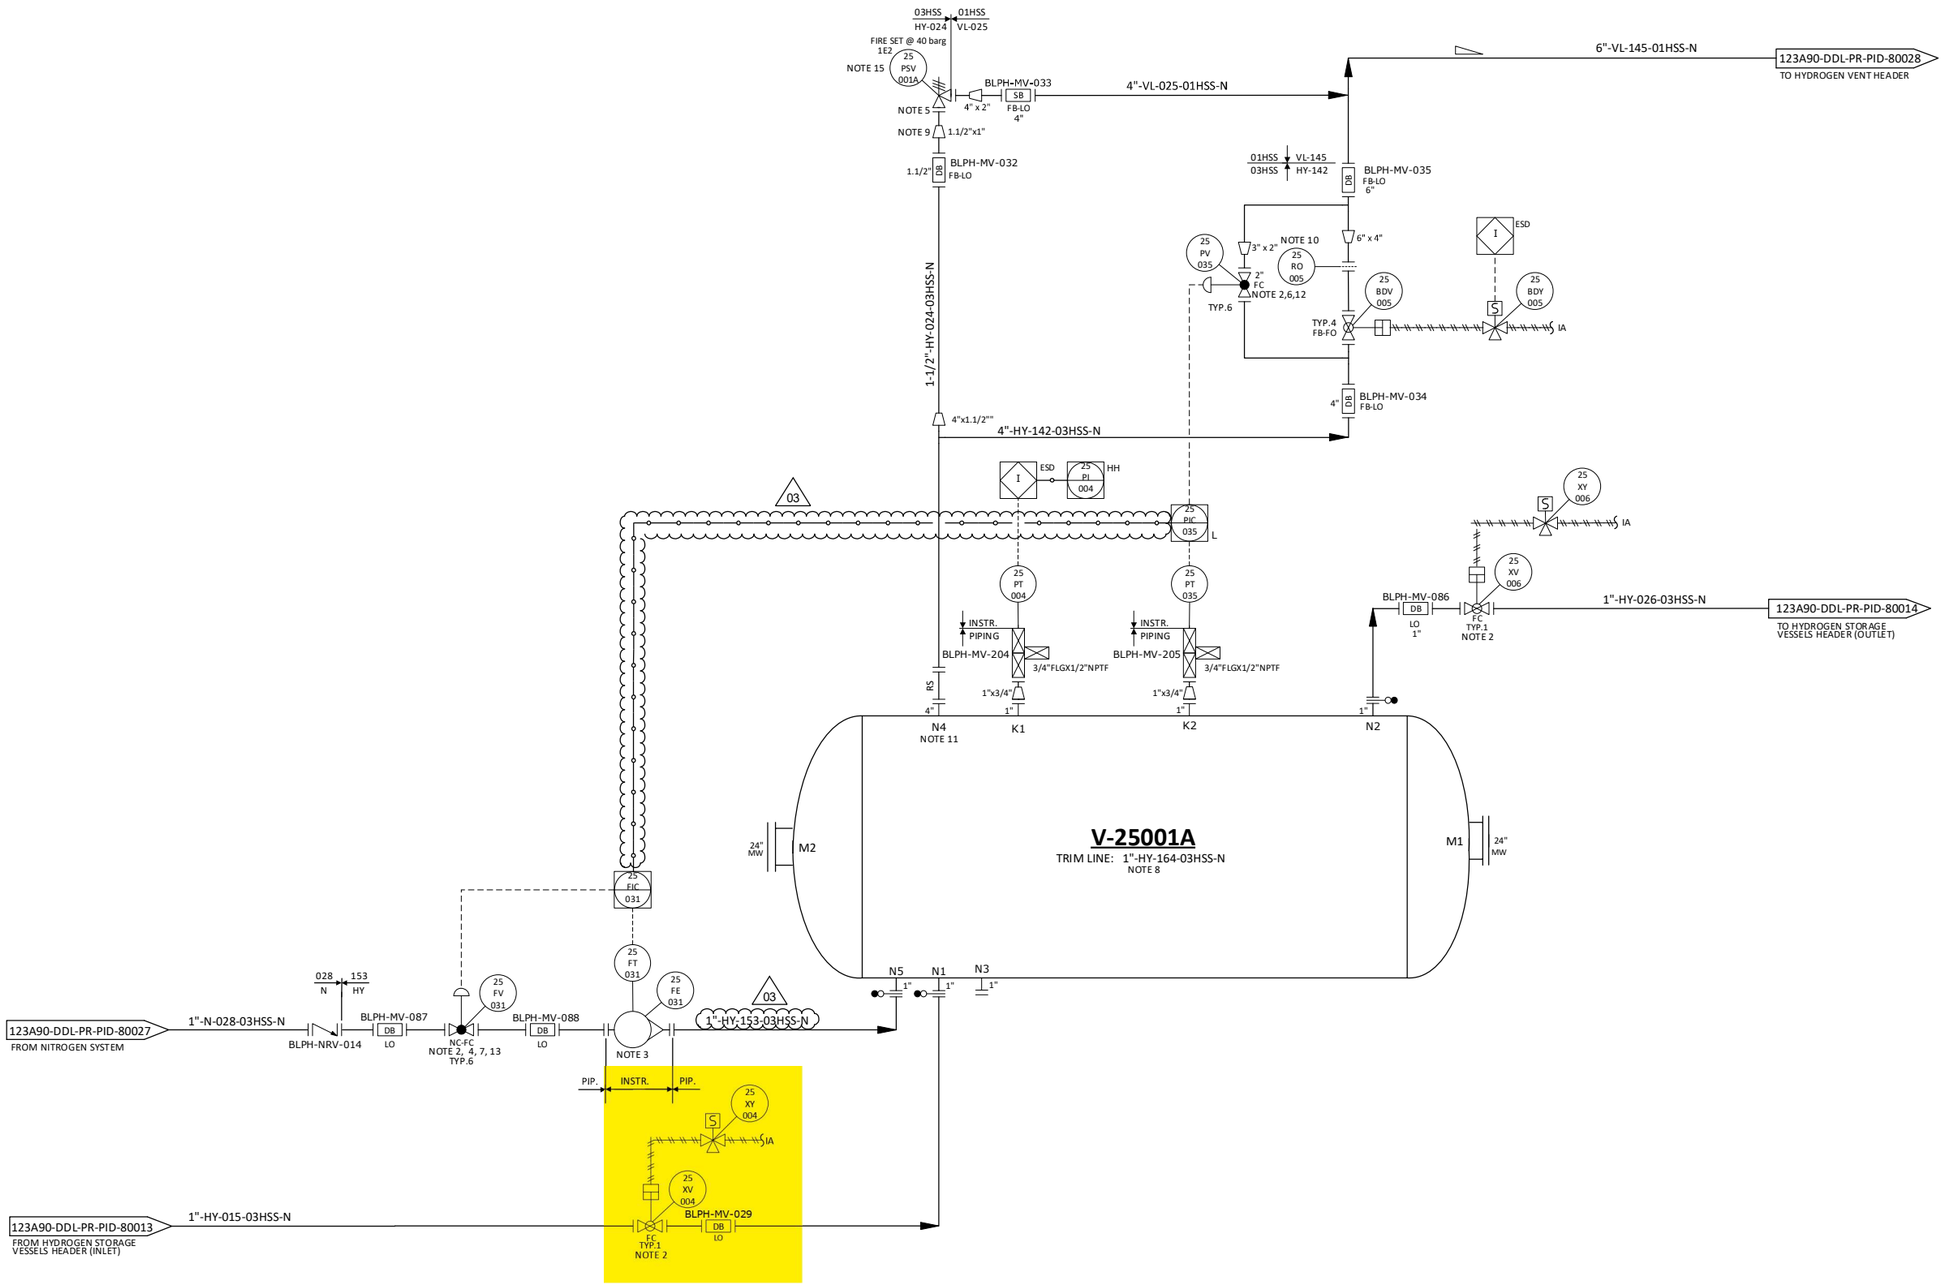

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-031) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-035 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-035 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-031 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-035 HAS FAILED TO CLOSE.
15. 25-PSV-001A SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL A

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80015		SHEET 001	REV. 03

File Name : FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

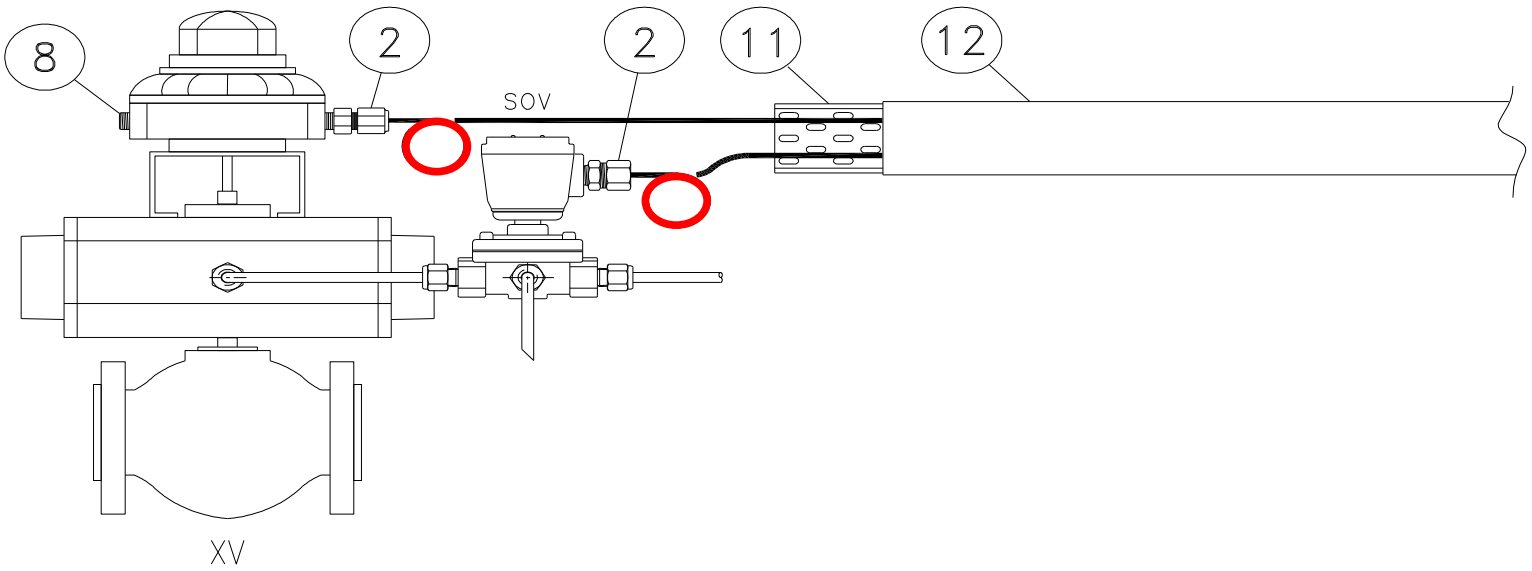

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

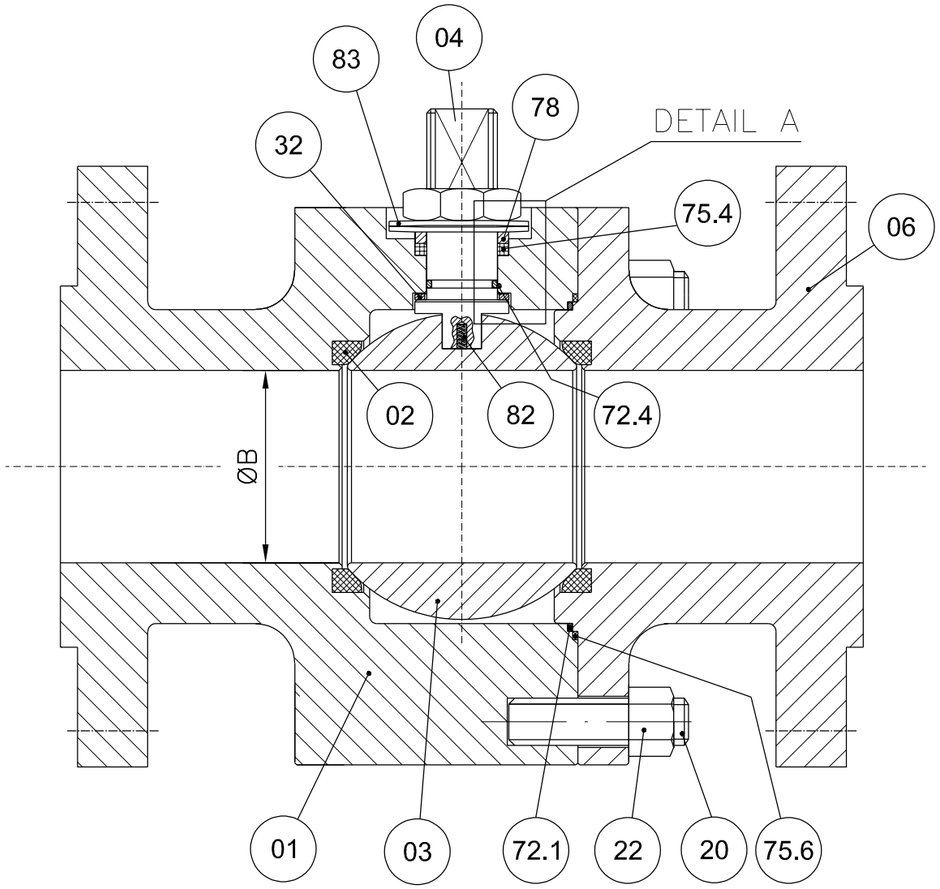

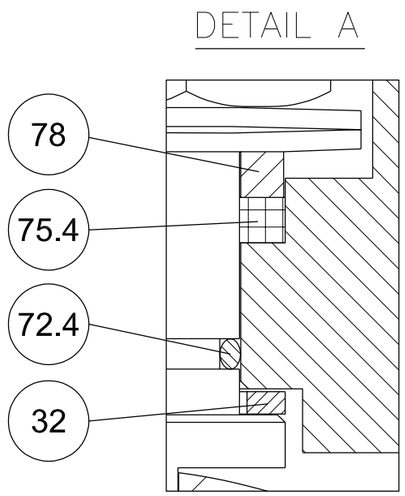


POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR	25-SDV-023	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE

Bourdon tube pressure gauge, stainless steel
For the process industry, standard version
Models 232.50, 233.50, NS 63 [2 ½"], 100 [4"] and 160 [6"]

For further approvals, see page 6

Applications

- For gaseous and liquid aggressive media that are not highly viscous or crystallising, also in aggressive environments
- Chemical and petrochemical industries, oil and gas industry, power engineering and also water and wastewater technology
- Machine building and general plant construction

Special features

- Excellent load cycle stability and shock resistance
- With case filling (model 233.50) for applications with high dynamic pressure loads and vibrations
- Completely from stainless steel
- Scale ranges from 0 … 0.6 to 0 … 1,600 bar or 0 ... 10 to 0 ... 20,000 psi
- QR code on dial links to instrument-specific information



Bourdon tube pressure gauge, model 232.50, NS 100 [4"]

Description

This high-quality Bourdon tube pressure gauge has been designed especially for the process industry.

The use of high-quality stainless steel materials and the robust design are geared to applications in the chemical and process engineering industries. Thus the instrument is suitable for liquid and gaseous media, also in aggressive environments.

Scale ranges of 0 … 0.6 to 0 … 1,600 bar [0 ... 10 to 0 ... 20,000 psi] ensure the measuring ranges required for a wide variety of applications.

WIKA manufactures and qualifies the pressure gauge in accordance with the standards EN 837-1 and ASME B40.100. As a safety function, this instrument has a blow-out device with blow-out plug on the back of the case. In the event of a failure, overpressure can escape there.

The model 233.50 with liquid-filled case is suitable for high dynamic pressure loads and vibrations.

The QR code on the dial allows instrument-specific information such as the serial number, the order number, certificates and other product data to be retrieved from the internet easily and in the long term.

Smart in sensing

Data sheets showing similar products:
Stainless steel, safety version; see data sheet PM 02.04
Bourdon tube pressure gauge with switch contacts; see data sheet PV 22.02
Monel version; see data sheet PM 02.33
Pressure gauge per EN 837-1 with mounted diaphragm seal; see data sheet DS 95.12

Specifications

Basic information	
Standard	■ EN 837-1 ■ ASME B40.100
	For information on the “Selection, installation, handling and operation of pressure gauges”, see technical information IN 00.05.
Further version	■ Oil- and grease-free for oxygen ■ Per NACE [1] MR0175 / ISO 15156, use in H_2S-containing environments in oil and gas production ■ With pre-volume deflagration flame arrester [2] for mounting to zone 0 (EPL Ga); model 910.21; see data sheet AC 91.02 ■ Monel version; models 262 and 263; see data sheet PM 02.33
Nominal size (NS)	■ Ø 63 mm [2 ½"] ■ Ø 100 mm [4"] ■ Ø 160 mm [6"]
Connection location	■ Lower mount (radial) ■ Lower back mount ■ Centre back mount (only for NS 63 [2 ½"])
Window	Laminated safety glass (NS 63 [2 ½"]: Polycarbonate)
Case	
Design	Safety level “S1” per EN 837-1 With blow-out device at case circumference, 12 o'clock (NS 63 [2 ½"]) and on the back of the case (NS 100 [4"] and 160 [6"]) Scale ranges ≤ 0 ... 16 bar [≤ 0 ... 300 psi] with compensating valve to vent and reseal case
Material	■ Stainless steel 1.4301 (304) ■ Stainless steel 1.4571 (316Ti)
Ring	Bayonet ring, stainless steel
Mounting	■ Without ■ Panel mounting flange, stainless steel ■ Panel mounting flange, polished stainless steel ■ Triangular profile ring with mounting bracket, polished stainless steel ■ Surface mounting flange, stainless steel
Case filling (model 233.50)	■ Without ■ Glycerine ■ Glycerine-water mixture for NS 100 [4"] and 160 [6"] with scale range ≤ 0 ... 2.5 bar [≤ 0 ... 40 psi] or for NS 63 [2 ½"] with scale range ≤ 0 ... 4 bar [≤ 0 ... 60 psi] ■ Silicone oil
Movement	■ Stainless steel ■ Stainless steel 1.4404 (316L) ■ everlast® version

1) General information about NACE standards; see data sheet IN 00.21
2) Only for instruments with Ex approval

Measuring element	
Type of measuring element	Bourdon tube, C-type or helical type
Material	Stainless steel 1.4404 (316L)
Leak tightness	■ Helium tested, leakage rate: $< 5 \cdot 10^{-3}$ mbar l/s ■ Helium tested, leakage rate: $< 1 \cdot 10^{-6}$ mbar l/s

Accuracy specifications		
Accuracy class		
NS 63 [2 ½"]	■ EN 837-1	Class 1.6
	■ ASME B40.100	±2 % | ±1 % | ±2 % of measuring span (grade A)
NS 100 [4"], 160 [6"]	■ EN 837-1	Class 1.0
	■ ASME B40.100	±1 % of measuring span (grade 1A)
Temperature error	On deviation from the reference conditions at the measuring system: ≤ ±0.4 % per 10 °C [≤ ±0.4 % per 18 °F] of full scale value	
Reference conditions		
Ambient temperature	+20 °C [+68 °F]	

Scale ranges

bar	
0 ... 0.6 [1]	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160
0 ... 4	0 ... 250
0 ... 6	0 ... 400
0 ... 10	0 ... 600
0 ... 16	0 ... 1,000
0 ... 25	0 ... 1,600

kg/cm²	
0 ... 0.6 [1]	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160
0 ... 4	0 ... 250
0 ... 6	0 ... 400
0 ... 10	0 ... 600
0 ... 16	0 ... 1,000
0 ... 25	0 ... 1,600

kPa	
0 ... 60 [1]	0 ... 4,000
0 ... 100	0 ... 6,000
0 ... 160	0 ... 10,000
0 ... 250	0 ... 16,000
0 ... 400	0 ... 25,000
0 ... 600	0 ... 40,000
0 ... 1,000	0 ... 60,000
0 ... 1,600	0 ... 100,000
0 ... 2,500	0 ... 160,000

MPa	
0 ... 0.06 [1]	0 ... 4
0 ... 0.1	0 ... 6
0 ... 0.16	0 ... 10
0 ... 0.25	0 ... 16
0 ... 0.4	0 ... 25
0 ... 0.6	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160

psi	
0 ... 10 [1]	0 ... 1,000
0 ... 15	0 ... 1,500
0 ... 30	0 ... 2,000
0 ... 60	0 ... 3,000
0 ... 100	0 ... 4,000
0 ... 160	0 ... 5,000
0 ... 200	0 ... 6,000
0 ... 300	0 ... 7,500
0 ... 400	0 ... 10,000
0 ... 600	0 ... 15,000
0 ... 800	0 ... 20,000

1) Not available for NS 63 [2 ½"]

Vacuum and +/- scale ranges

bar	
-0.6 ... 0 [1]	-1 ... +5
-1 ... 0	-1 ... +9
-1 ... +0.6	-1 ... +15
-1 ... +1.5	-1 ... +24
-1 ... +3	

MPa	
-0.06 ... 0 [1]	-0.1 ... +0.5
-0.1 ... 0	-0.1 ... +0.9
-0.1 ... +0.06	-0.1 ... +1.5
-0.1 ... +0.15	-0.1 ... +2.4
-0.1 ... +0.3	

kPa	
-60 ... 0 [1]	-100 ... +500
-100 ... 0	-100 ... +900
-100 ... +60	-100 ... +1,500
-100 ... +150	-100 ... +2,400
-100 ... +300	

psi	
-30 inHg ... 0	-30 inHg ... +100
-30 inHg ... +15	-30 inHg ... +160
-30 inHg ... +30	-30 inHg ... +200
-30 inHg ... +60	-30 inHg ... +300

1) Not available for NS 63 [2 ½"]

Further details on: scale ranges	
Special scale ranges	Other scale ranges on request
Unit	■ bar ■ psi ■ kg/cm² ■ kPa ■ MPa
Increased overload safety	■ Without ■ 2 times ■ 3 times ■ 4 times ■ 5 times
	The possibility of selection depends on scale range and nominal size
Vacuum resistance	■ Without ■ Vacuum-resistant to -1 bar
Dial	
Scale colour	Black
Material	Aluminium
Special scale	■ Without ■ With temperature scale for refrigerant, e.g. for NH_3: R 717
	Other scales or customer-specific dials, e.g. with red mark, circular arcs or circular sectors, on request
Pointer	
Instrument pointer	Aluminium, black
Mark pointer/drag pointer	■ Without ■ Red mark pointer on dial, fixed ■ Red mark pointer on window, adjustable ■ Mark pointer on bayonet ring, adjustable ■ Red drag pointer on window, adjustable
Pointer stop pin	■ Without ■ At zero point (only for NS 63 [2 ½"]) ■ At 6 o'clock (only for NS 100 [4"], 160 [6"])

Process connection		
Standard	■ EN 837-1 ■ ISO 7 ■ ANSI/B1.20.1	
Size		
EN 837-1	■ G ⅛ B, male thread ■ G ¼ B, male thread ■ G ½ B, male thread ■ M12 x 1.5, male thread ■ M20 x 1.5, male thread	
ISO 7	■ R ¼, male thread ■ R ½, male thread	
ANSI/B1.20.1	■ ¼ NPT, male thread ■ ½ NPT, male thread	
Restrictor	■ Without ■ Ø 0.6 mm [0.024"], stainless steel ■ Ø 0.3 mm [0.012"], stainless steel	
Material (wetted)		
Process connection	Stainless steel 1.4404 (316L)	
Bourdon tube	Stainless steel 1.4404 (316L)	

→ Other process connections on request

Operating conditions		
Medium temperature		
Unfilled instruments	-40 ... +200 °C [-40 ... +392 °F]	
Instruments with glycerine filling	-20 ... +100 °C [-4 ... +212 °F]	
Instruments with silicone oil filling	-40 ... +100 °C [-40 ... +212 °F]	
Ambient temperature		
Unfilled instruments or with silicone oil filling	-40 ... +60 °C [-40 ... +140 °F]	
Instruments with glycerine filling	-20 ... +60 °C [-4 ... +140 °F]	
Pressure limitation		
NS 63 [2 ½"]	Steady	3/4 x full scale value
	Fluctuating	2/3 x full scale value
	Short time	Full scale value
NS 100 [4"], 160 [6"]	Steady	Full scale value
	Fluctuating	0.9 x full scale value
	Short time	1.3 x full scale value
Ingress protection per IEC/EN 60529	■ IP65 ■ IP66 (only selectable for scale ranges ≥ 0 ... 20 bar [0 ... 400 psi])	

Approvals

Logo	Description	Region
CE	**EU declaration of conformity** Pressure equipment directive PS > 200 bar, module A, pressure accessory	European Union
UKCA	**UKCA** Pressure equipment (safety) regulations	United Kingdom
-	**CRN** Safety (e.g. electr. safety, overpressure, ...) For full scale value ≤ 1,000 bar	Canada

Optional approvals

Logo	Description	Region
CE Ex	**EU declaration of conformity** ATEX directive Hazardous areas - Ex h Gas II 2G Ex h IIC T6 ... T1 Gb X Dust II 2D Ex h IIIC T85°C ... T450°C Db X	European Union
UKCA	**UKCA** Equipment and protective systems intended for use in potentially explosive atmospheres regulations	United Kingdom
EAC Ex	**EAC** Hazardous areas	Eurasian Economic Community
	Ex Ukraine Hazardous areas	Ukraine
	PAC Kazakhstan Metrology, measurement technology	Kazakhstan
-	**MChS** Permission for commissioning	Kazakhstan
-	**PAC Ukraine** Metrology, measurement technology	Ukraine
	PAC Uzbekistan Metrology, measurement technology	Uzbekistan
-	**PAC China** Metrology, measurement technology	China
	DNV Ships, shipbuilding (e.g. offshore)	International
-	**KBA** [1] Automotive	International
	Hydrogen-powered motor vehicles - (EC) no. 79/2009 and (EU) no. 406/2010	
	Components for motor vehicles using natural gas (CNG/LNG) – UN no. R 110	

1) Not available for all versions

Manufacturer's declaration

Logo	Description
-	Pressure equipment directive (PED) for maximum allowable pressure PS ≤ 200 bar
-	Suitability of wetted materials for drinking water in accordance with the European 4MS initiative
-	Suitability of wetted materials for hydrogen


Certificates (option)

Certificates	
Certificates	■ 2.2 test report per EN 10204 (e.g. state-of-the-art manufacturing, indication accuracy) ■ 3.1 inspection certificate per EN 10204 (e.g. material proof for wetted metal parts, indication accuracy) ■ PCA calibration certificate, traceable and accredited in accordance with ISO/IEC 17025 ■ Calibration certificate by a national accreditation body, traceable and accredited in accordance with ISO/IEC 17025 on request
Recommended calibration interval	1 year (dependent on conditions of use)

→ For approvals and certificates, see website

Dimensions in mm [in]

Lower mount (radial)

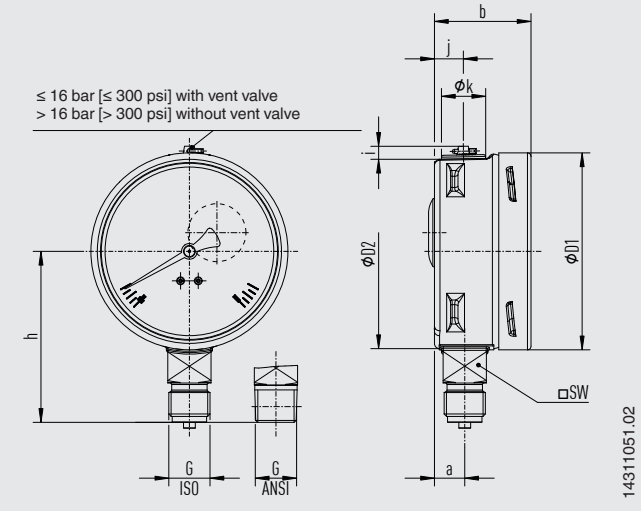

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]
100 [4"]	approx. 0.6 kg [1.32 lbs]	approx. 0.9 kg [1.98 lbs]
160 [6"]	approx. 1.1 kg [2.43 lbs]	approx. 2.0 kg [4.41 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	G ¼ B	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	51 [2.01]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	G ¼ B	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	87 [3.43]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	87 [3.43]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	G ¼ B	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	118 [4.65]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	118 [4.65]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ISO 7


NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	R ¼	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	R ¼	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	86 [3.39]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	R ¼	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	117 [4.60]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	¼ NPT	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	51 [2.01]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	¼ NPT	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	86 [3.39]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	¼ NPT	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	117 [4.60]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

1) Plus 16 mm [0.630 in] with scale range 0 ... 1,600 bar [0 ... 20,000 psi]

Lower back mount

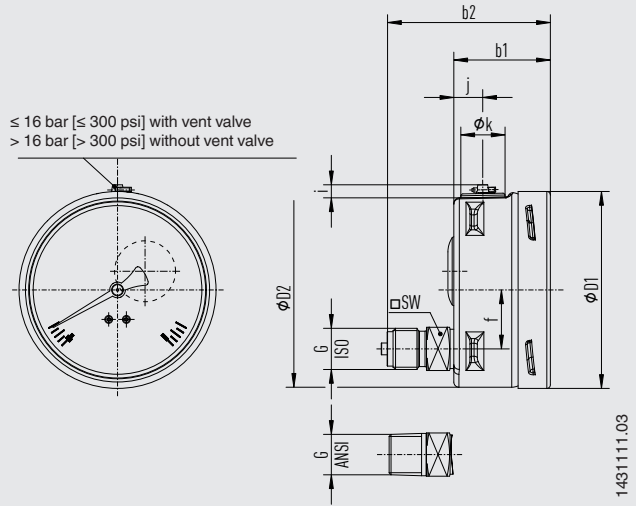

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]
100 [4"]	approx. 0.6 kg [1.32 lbs]	approx. 0.9 kg [1.98 lbs]
160 [6"]	approx. 1.1 kg [2.43 lbs]	approx. 2.0 kg [4.41 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	G ¼ B	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	33 [1.30]	54 [2.13]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	G ¼ B	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	49.5 [1.95]	83 [3.27]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	49.5 [1.95]	83 [3.27]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	G ¼ B	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	51.5 [2.03] 1)	85 [3.24] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	51.5 [2.03] 1)	85 [3.24] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ISO 7


NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	R ¼	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	R ¼	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	49.5 [1.95]	82 [3.23]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	R ¼	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	51.5 [2.03] 1)	84 [3.31] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	¼ NPT	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	50 [1.97]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	33 [1.30]	54 [2.13]	63 [2.48]	62 [2.44]	50 [1.97]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	¼ NPT	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	49.5 [1.95]	82 [3.23]	101 [3.98]	99 [3.90]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	¼ NPT	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	51.5 [2.03] 1)	84 [3.31] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

1) Plus 16 mm [0.630 in] with scale ranges ≥ 0 ... 100 bar [≥ 0 ... 1,500 psi]

NS 63 [2 ½"], centre back mount

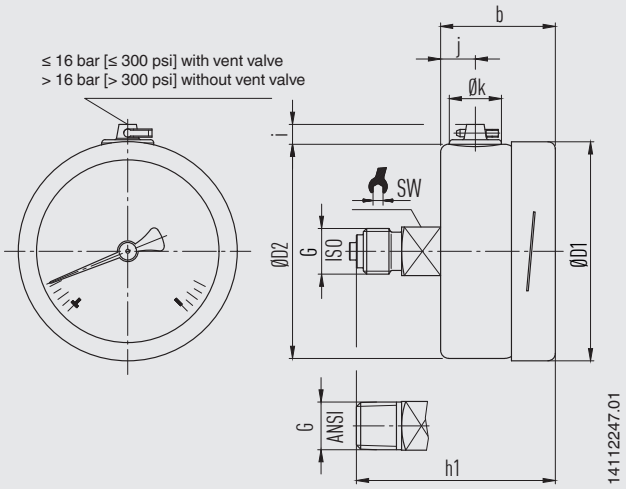

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	G ¼ B	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	54 [2.13]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]

Process connection with thread per ISO 7

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	R ¼	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]


Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	¼ NPT	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	54 [2.13]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]


Accessories

Dimensions in mm [in]

Panel mounting flange

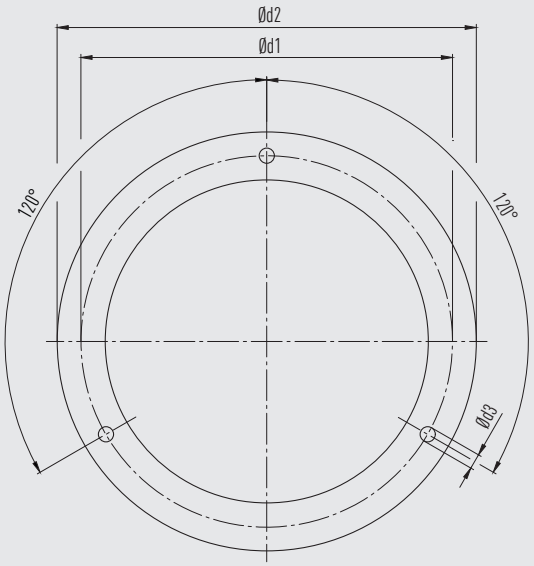


Surface mounting flange

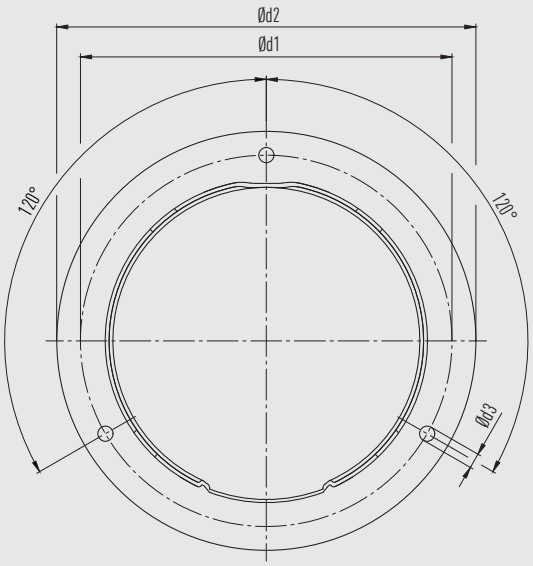


NS	Dimensions in mm [in]			
	Recommended panel cutout	d1	d2	d3
63 [2 ½"]	Ø 67 ±0.3 / Ø 2.6 [Ø 2.64 ±0.01 / Ø 0.10]	75 [2.95]	85 [3.35]	3.6 [0.14]
100 [4"]	Ø 104 ±0.5 / Ø 4.1 [Ø 4.04 ±0.02 / Ø 0.16]	117 [4.60]	132 [5.20]	4.8 [0.19]
160 [6"]	Ø 164 ±0.5 / Ø 6.5 [Ø 6.46 ±0.02 / Ø 0.26]	178 [7.01]	196 [7.72]	5.8 [0.23]

Triangular profile ring

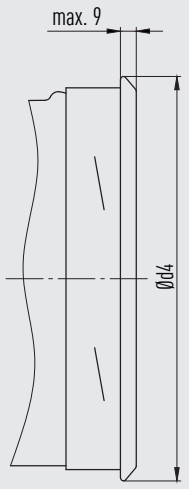

NS	Dimensions in mm [in]	
	Recommended panel cutout	d4
63 [2 ½"]	Ø 64.5 ±0.5 / Ø 2.5 [Ø 2.54 ±0.02 / Ø 0.01]	≤ 69 [2.72]
100 [4"]	Ø 102 ±1.0 / Ø 4.0 [Ø 4.02 ±0.04 / Ø 0.16]	≤ 108 [4.25]
160 [6"]	Ø 162.6 ±1.0 / Ø 6.4 [Ø 6.40 ±0.04 / Ø 0.25]	≤ 168 [6.61]

Accessories and spare parts

Model		Description
	**910.17**	Seals → See data sheet AC 09.08
	**910.15**	Syphons → See data sheet AC 09.06
	**910.13**	Overpressure protector → See data sheet AC 09.04
	**IV10, IV11**	Needle valve and multiport valve → See data sheet AC 09.22
	**IV20, IV21**	Block-and-bleed valve → See data sheet AC 09.19
	**IVM**	Monoflange, process and instrument version → See data sheet AC 09.17
	**BV**	Ball valve, process and instrument version → See data sheet AC 09.28
	**IBF2, IBF3**	Monoblock with flange connection → See data sheet AC 09.25

Ordering information

Model / Nominal size / Scale range / Process connection / Connection location / Options

© 02/1995 WIKA Alexander Wiegand SE & Co. KG, all rights reserved.
The specifications given in this document represent the state of engineering at the time of publishing.
We reserve the right to make modifications to the specifications and materials.
In case of a different interpretation of the translated and the English data sheet, the English wording shall prevail.

WIKA Alexander Wiegand SE & Co. KG
Alexander-Wiegand-Straße 30
63911 Klingenberg/Germany
Tel. +49 9372 132-0
info@wika.de
www.wika.de

EU-Konformitätserklärung
EU Declaration of Conformity

Dokument Nr. / ***Document No.*** **11564220** — **Revision** / ***Issue*** **07**

Wir erklären in alleiniger Verantwortung, dass die mit CE gekennzeichneten Produkte
We declare under our sole responsibility that the CE marked products

Typenbezeichnung / ***Type Designation***

23a.50.063 + option ATEX | **23a.50.1*0 + option ATEX**
26a.50.063 + option ATEX | **26a.50.1*0 + option ATEX**
23a.30.063 + option ATEX | **23a.30.1*0 + option ATEX**
26a.30.063 + option ATEX | **26a.30.1*0 + option ATEX**
23a.53.063 + option ATEX | **23a.53.100 + option ATEX**
23a.54.063 + option ATEX | **23a.54.100 + option ATEX**
23a.36.1*0 + option ATEX
PG23LT.063 + option ATEX | **PG23LT.1*0 + option ATEX**
PG23CP.063 + option ATEX | **PG23CP.100 + option ATEX**
PG28.1*0 + option ATEX
PG23HP-S.1*0 + option ATEX | **PG23HP-P.1*0 + option ATEX**

*** Nominal size**
0 = 100mm
6 = 160mm

a Case filling
2 = Without case filling
3 = With case filling

Beschreibung / ***Description***: **Rohrfederdruckmessgerät** / ***Bourdon Tube Pressure Gauge***

gemäß gültigem Datenblatt / *according to the valid data sheet*: PM 02.02, PM 02.04, PM 02.12, PM 02.15, PM 02.22, PM 02.24, PM 02.32, PM 02.28, PM 02.29

mit den nachfolgenden relevanten Harmonisierungsvorschriften der Union übereinstimmen
are in conformity with the following relevant Union harmonisation legislation

Angewandte harmonisierte Normen oder sonstige technische Spezifikationen:
Applied harmonised standards or other technical specifications:

2014/68/EU	Druckgeräterichtlinie (DGRL) (1) *Pressure Equipment Directive (PED)* (1)	
2014/34/EU	Explosionsschutz (ATEX) (2) *Explosion protection (ATEX)* (2)	
Ex	II 2G Ex h IIC T6 … T1 Gb X II 2D Ex h IIIC T85 °C … T450 °C Db X	EN ISO 80079-36 :2016 EN ISO 80079-37 :2016

(1) PS > 200 bar; Modul A, druckhaltendes Ausrüstungsteil
PS > 200 bar; Module A, pressure accessory

(2) Modul A „interne Fertigungskontrolle“. Die Dokumentation ist hinterlegt unter der Nummer 074/24 bei der Notifizierten Stelle der EU, IBExU Institut für Sicherheitstechnik GmbH (EU ID-Nr. 0637).
Module A “Internal Control of Production”. The Documentation is deposited under registration number 074/24 at Notified Body of EU, IBExU Institut für Sicherheitstechnik GmbH (EU ID 0637). .

Unterzeichnet für und im Namen von / *Signed for and on behalf of*

WIKA Alexander Wiegand SE & Co. KG

Klingenberg, 2024-04-24


Sascha Schnellbacher, Vice President
CoE Gauges, Sensors & Instruments

Mariusz Lubomski, Director of Quality
CoE Gauges, Sensors & Instruments


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

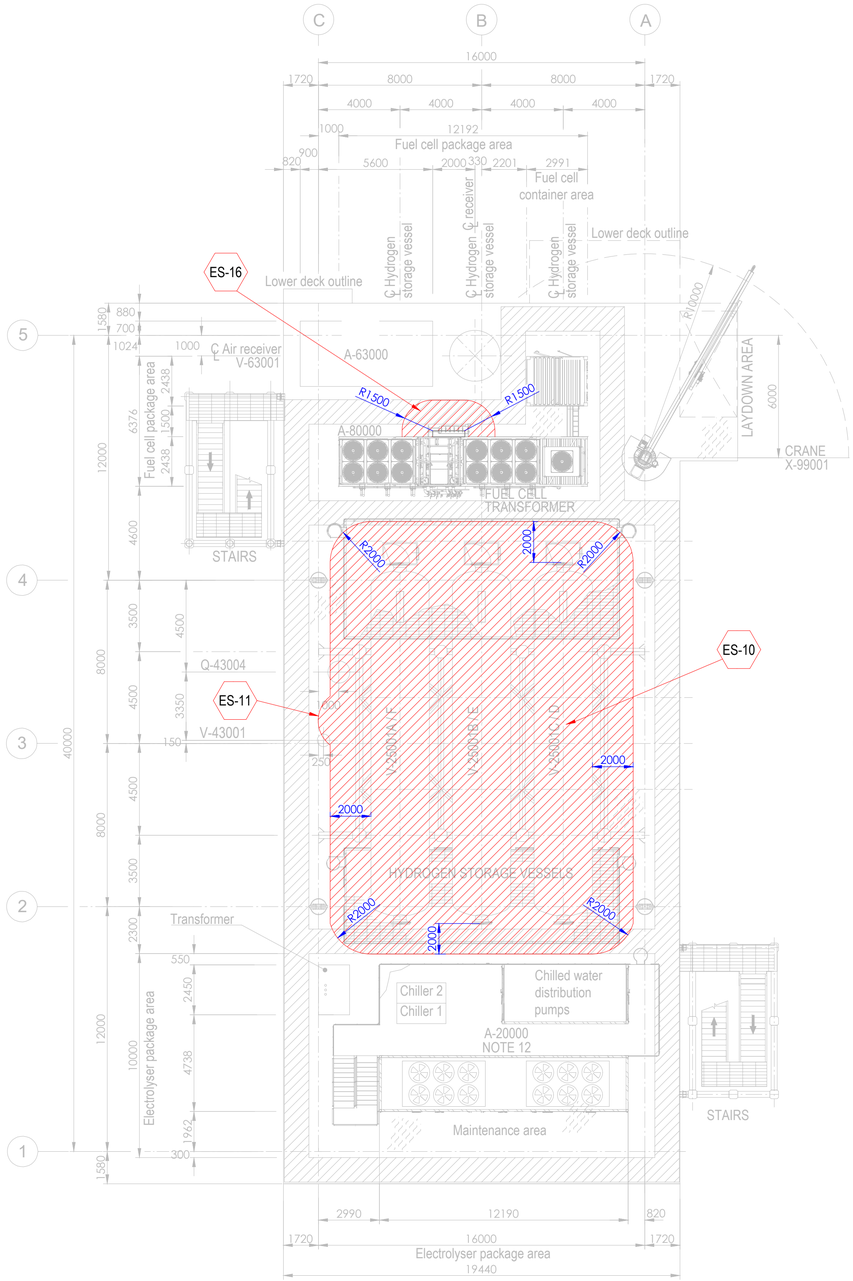


PLAN ON UPPER DECK
EL+30.310 T.O.S.

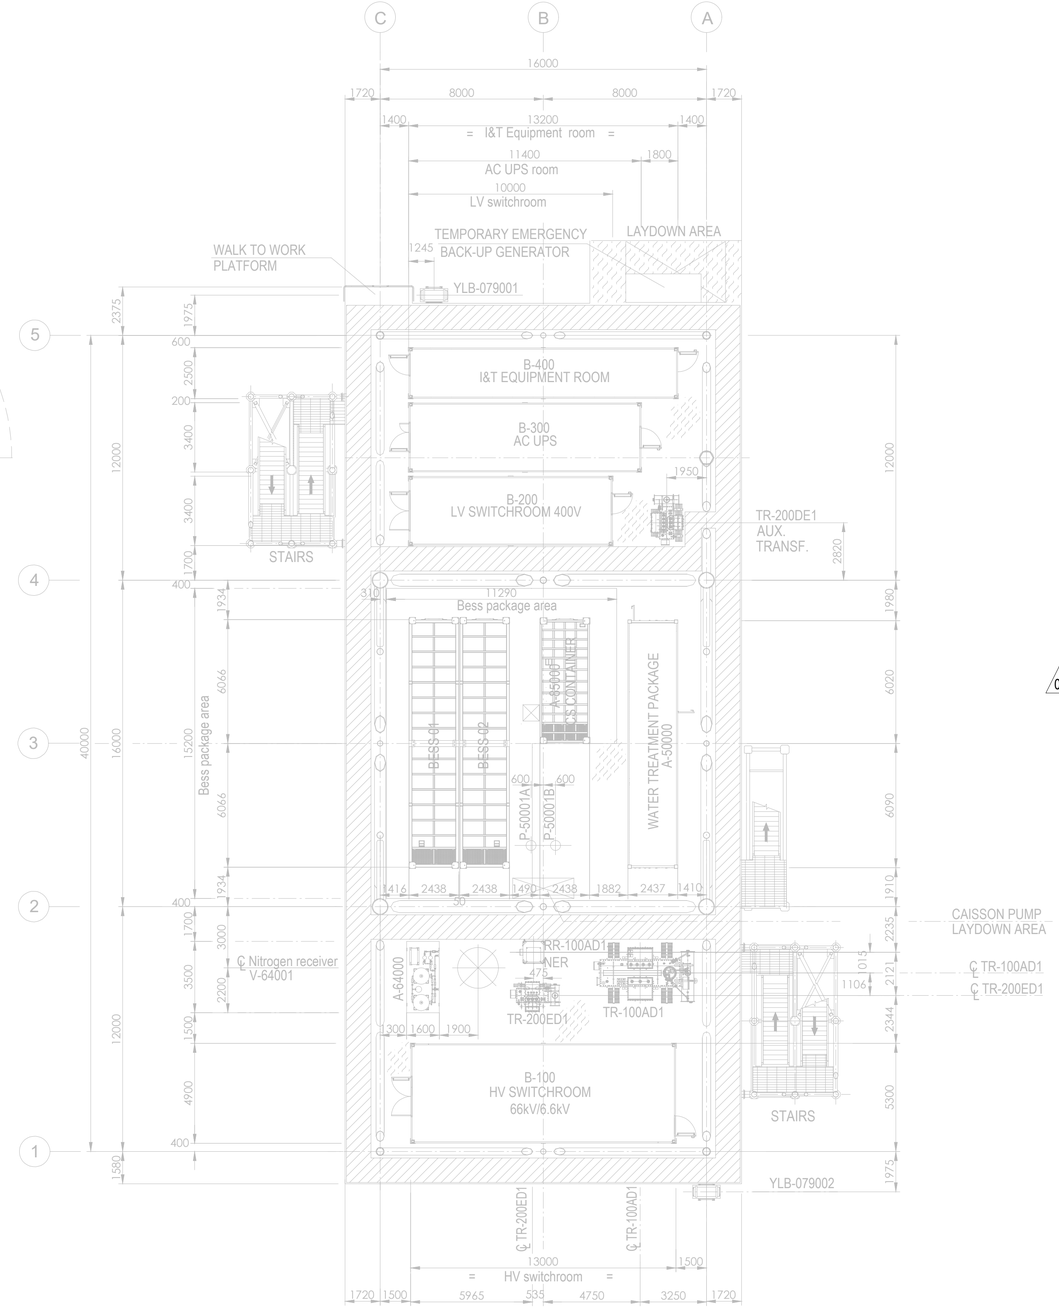

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

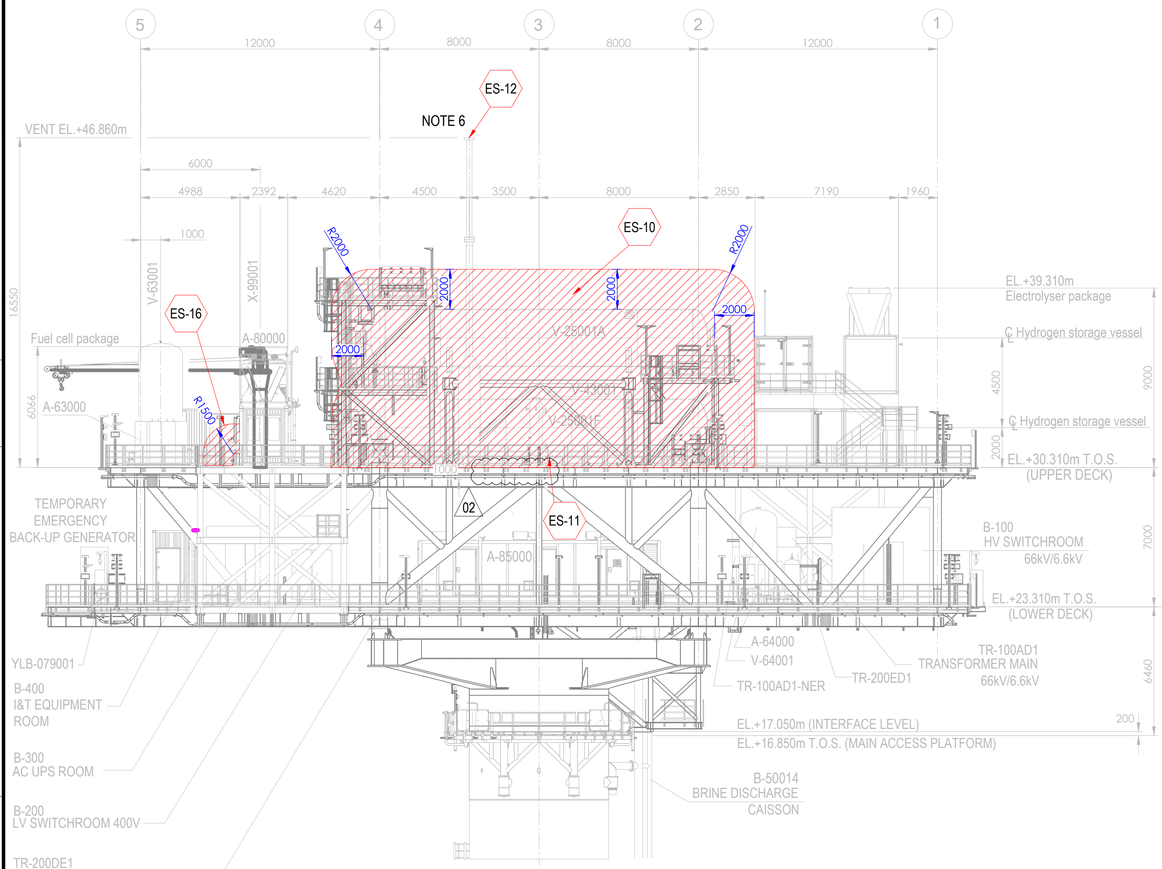



ELEVATION LOOKING EAST

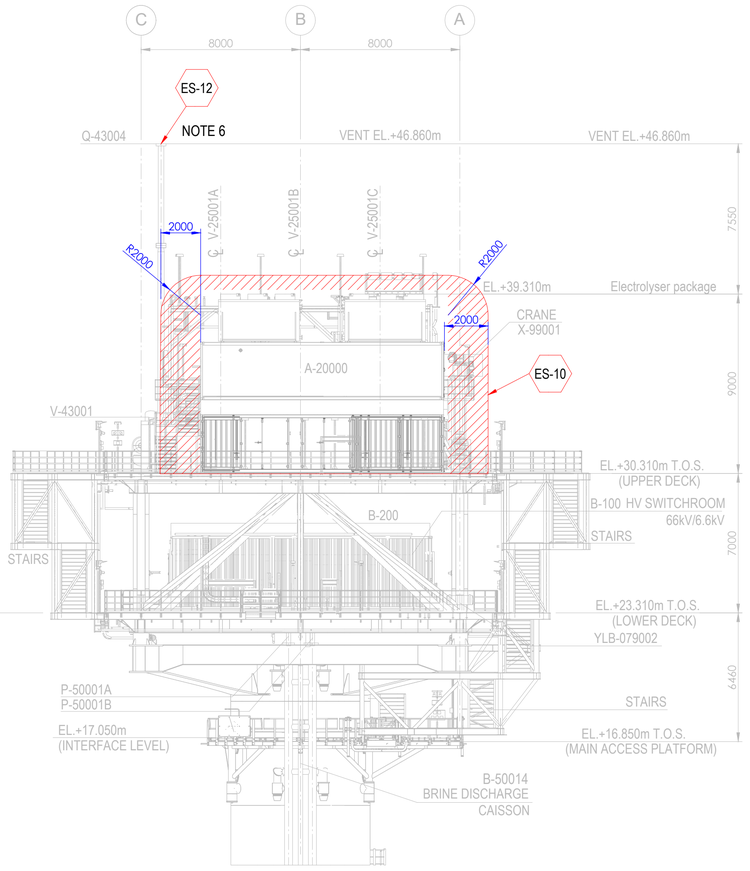

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

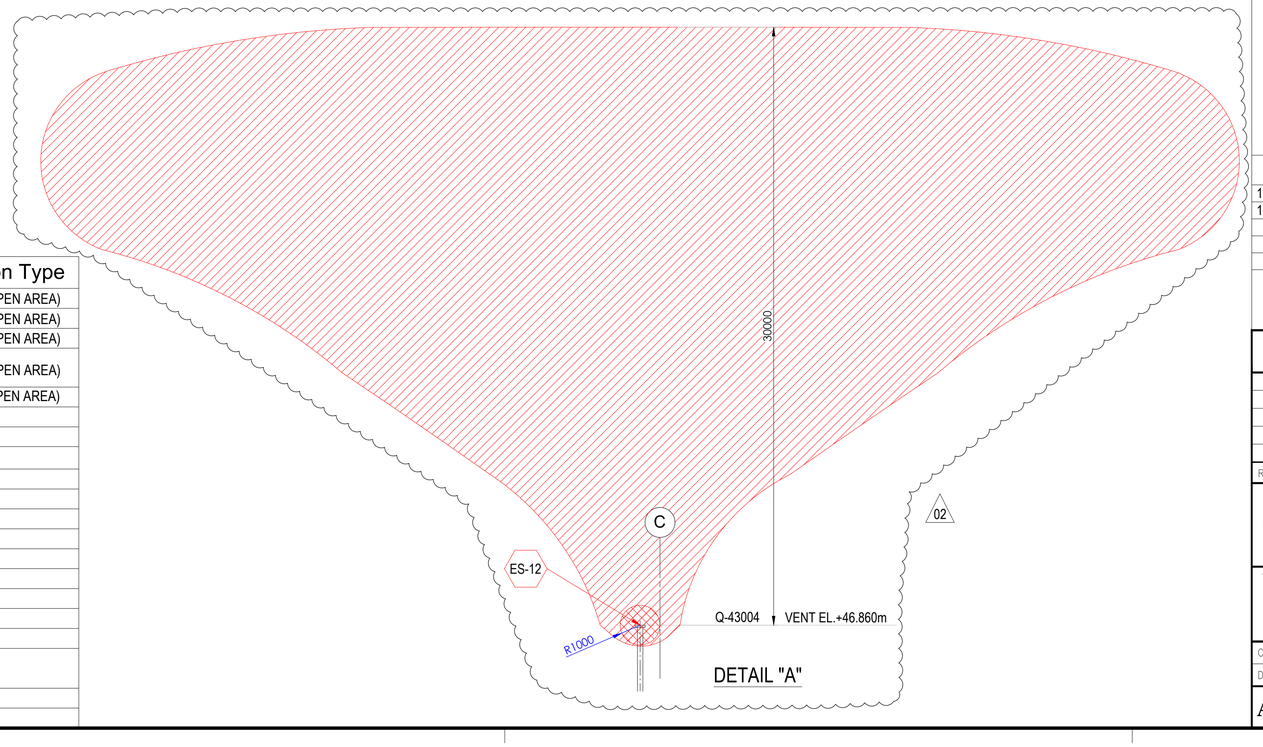



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PG -008	: Air Set Pressure Gauge Filter - Vessel V-25001B Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10004821	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		PW00DE2G630			
Manufacturer	Wika			**Model**		233.50.63			
Cert No.	D.o.C. by Manufacturer reference 11564220			**Equipment Ambient Temp.**		-20 °C to +60 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP65

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PG -008	: Air Set Pressure Gauge Filter - Vessel V-25001B Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004821	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-PG -008	: Air Set Pressure Gauge Filter - Vessel V-25001B Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004821	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks					
67	All Terminals are Ex n certified (if required on certificate)	x	NA		
68	Hermetically sealed and enclosed break devices are undamaged	x	NA		
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA		
70	Test port, if fitted, is functional (type “nR” only)	x	NA		
71	Breathing operation is satisfactory (type “nR” only)	x	NA		
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA		
73	The ventilation airflow is not impeded	x	NA		
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA		
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA		
76	Variable voltage/frequency installation complies with documentation	x	NA		
Extra Ex p checks					
77	Pressurization gas is correct type	x	NA		
78	Actual pressure is within maximum and minimum settings for equipment	x	NA		
79	Timers set as per certification documentation	x	NA		
80	Alarms and trip functions operate correctly as per certification documentation	x	NA		
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA		
82	Automatic electrical protective devices operate within permitted limits	x	NA		
83	Automatic electrical protective devices are set correctly	x	NA		
84	Protective gas inlet temperature is below maximum specified	x	NA		
85	Ducts, pipes and enclosures are in good condition	x	NA		
86	Protective gas is substantially free from contaminants	x	NA		
87	Protective gas pressure and/or flow is adequate	x	NA		
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA		
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA		
90	Specific conditions of use (if applicable) are complied with		NA		
Extra Ex i (Intrinsically Safe – IS) checks					
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA		
92	Cables are installed in accordance with the documentation	x	NA		
93	Segregation is maintained between IS and non-IS Circuits	x	NA		
94	Cable screens are isolated at one end (field side)	x	NA		
95	Cable screens are earthed in accordance with the documentation	x	NA		
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA		
97	Equipment installed is the one specified in the documentation	x	NA		
98	Ambient temperature range of the apparatus is correct for the installation	x	NA		
99	Service temperature range of the apparatus is correct for the installation	x	NA		
100	Installation is clearly labelled	x	NA		
101	Printed circuit boards are clean and undamaged	x	NA		
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA		
103	Point-to-point connections are all correct	x	NA		
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA		
105	Earth connections maintain the integrity of the type of protection	x	NA		
106	Intrinsically safe circuit earthing is satisfactory	x	NA		
107	Insulation resistance is satisfactory	x	NA		
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA		

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA

Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	VENDOR ROTORK (PER FLUITEK)	RM (ROSETTI MARINO)	
Name	Stefano Linari	Giovanni Tangianu	
Date	2025-04-24	2025-04-24	
Signature	Digitaly signed by Stefano Linari 2025-04-24T13:20:20.889Z	Digitaly signed by Giovanni Tangianu 2025-04-24T14:59:01.199Z	

ROTORK CONTROLS ITALIA srl
Via Portico 17
24050 Orio Al Serio (BG)

Telefono: 0039 (0)5832221
E-mail: rotork.italia@rotork.com



WIKA Product Pass Italiano

serial number

WIKA

25-xv-008

Type 23X.50

Manometro a molla tubolare 232.50/233.50
Cassa in acciaio inox

Serial number:
PW00DE2G630

Item number:
57424821

Manufacturing date:
04/2025



ITEM	Tag	25-PG -008	: Air Set Pressure Gauge Filter - Vessel V-25001B Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10004821	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**	8975GNEB				
Manufacturer	Wika			**Model**	233.50.63				
Cert No.	D.o.C. by Manufacturer, reference 11564220			**Equipment Ambient Temp.**	-20 °C to +60 °C				
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP65

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	PL	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PG -008	: Air Set Pressure Gauge Filter - Vessel V-25001B Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004821	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-PG -008	: Air Set Pressure Gauge Filter - Vessel V-25001B Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004821	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

	Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA		
68	Hermetically sealed and enclosed break devices are undamaged	x	NA		
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA		
70	Test port, if fitted, is functional (type “nR” only)	x	NA		
71	Breathing operation is satisfactory (type “nR” only)	x	NA		
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA		
73	The ventilation airflow is not impeded	x	NA		
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA		
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA		
76	Variable voltage/frequency installation complies with documentation	x	NA		
	Extra Ex p checks				
77	Pressurization gas is correct type	x	NA		
78	Actual pressure is within maximum and minimum settings for equipment	x	NA		
79	Timers set as per certification documentation	x	NA		
80	Alarms and trip functions operate correctly as per certification documentation	x	NA		
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA		
82	Automatic electrical protective devices operate within permitted limits	x	NA		
83	Automatic electrical protective devices are set correctly	x	NA		
84	Protective gas inlet temperature is below maximum specified	x	NA		
85	Ducts, pipes and enclosures are in good condition	x	NA		
86	Protective gas is substantially free from contaminants	x	NA		
87	Protective gas pressure and/or flow is adequate	x	NA		
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA		
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA		
90	Specific conditions of use (if applicable) are complied with		NA		
	Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA		
92	Cables are installed in accordance with the documentation	x	NA		
93	Segregation is maintained between IS and non-IS Circuits	x	NA		
94	Cable screens are isolated at one end (field side)	x	NA		
95	Cable screens are earthed in accordance with the documentation	x	NA		
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA		
97	Equipment installed is the one specified in the documentation	x	NA		
98	Ambient temperature range of the apparatus is correct for the installation	x	NA		
99	Service temperature range of the apparatus is correct for the installation	x	NA		
100	Installation is clearly labelled	x	NA		
101	Printed circuit boards are clean and undamaged	x	NA		
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA		
103	Point-to-point connections are all correct	x	NA		
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA		
105	Earth connections maintain the integrity of the type of protection	x	NA		
106	Intrinsically safe circuit earthing is satisfactory	x	NA		
107	Insulation resistance is satisfactory	x	NA		
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA		

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-31	2025-02-01	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-31T09:37:59.617Z	PROVERLIS Digitaly signed by Luca Mussi 2025-02-01T12:02:54.380Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

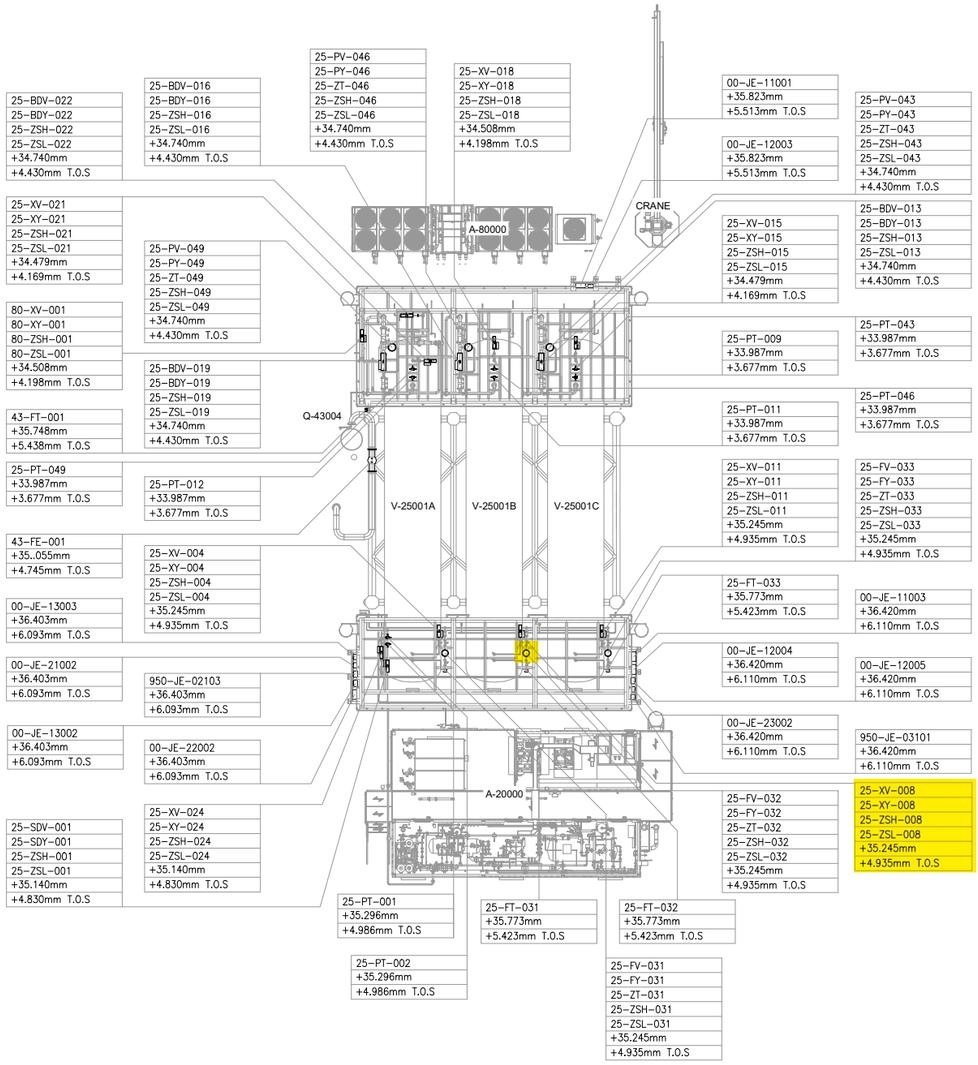

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90–DDL–IN–DL–40081	002	02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 B

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

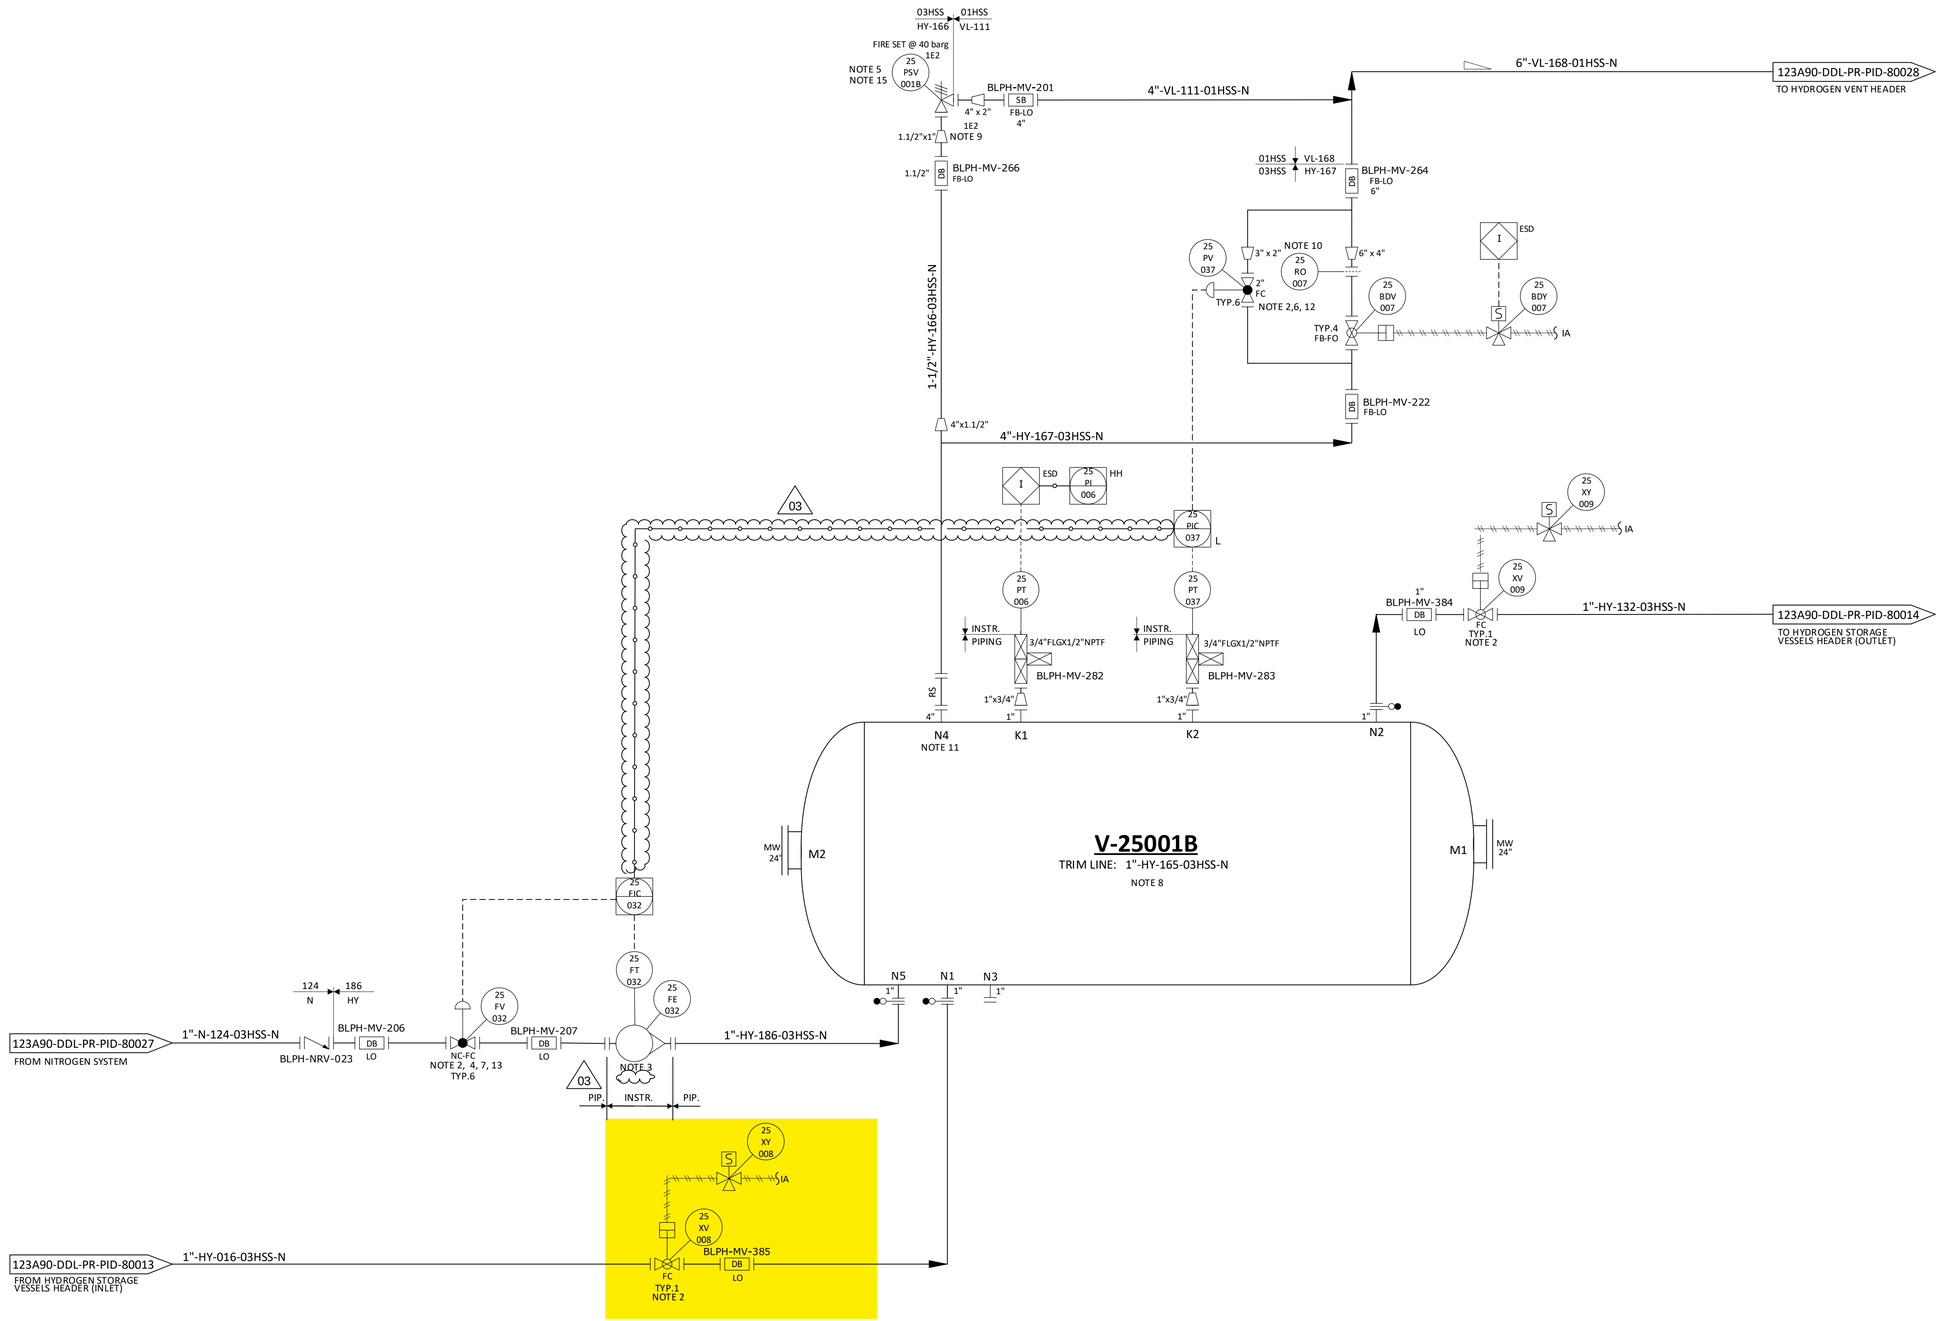

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-032) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. (03)
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-037 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC."PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-037 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. (03)
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-032 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-037 HAS FAILED TO CLOSE.
15. 25-PSV-001B SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL B

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80016	SHEET 001	REV. 03

File Name : FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

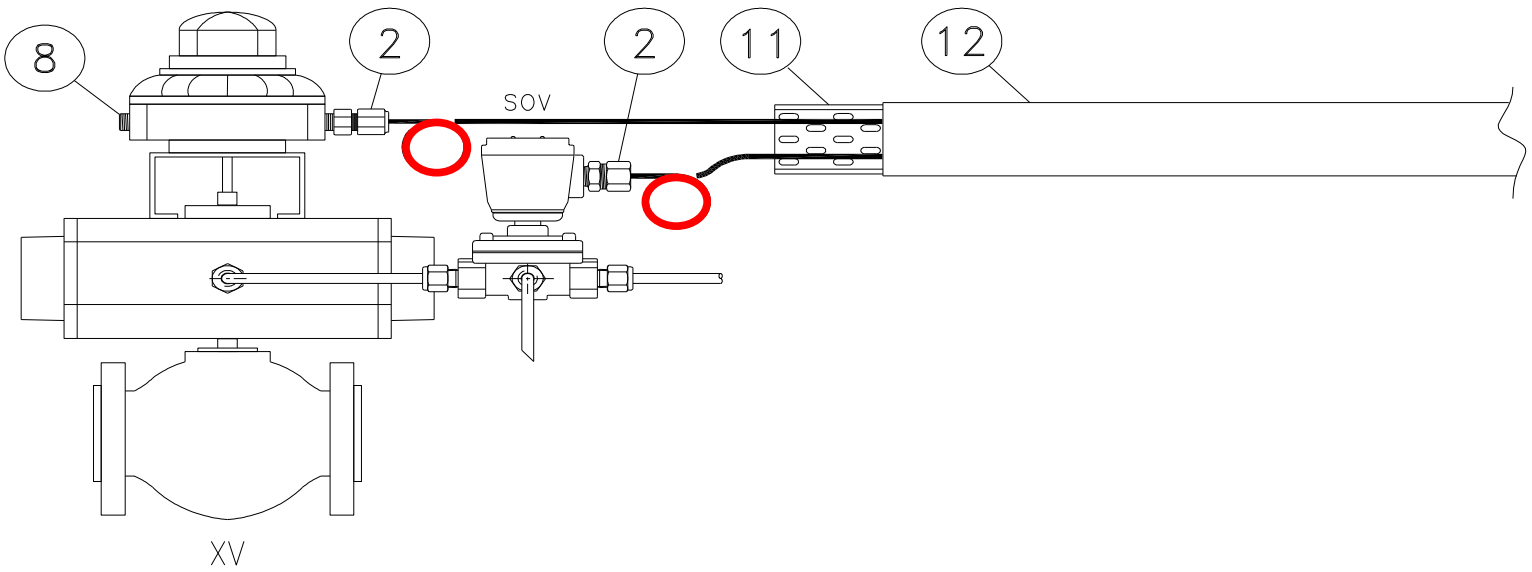

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

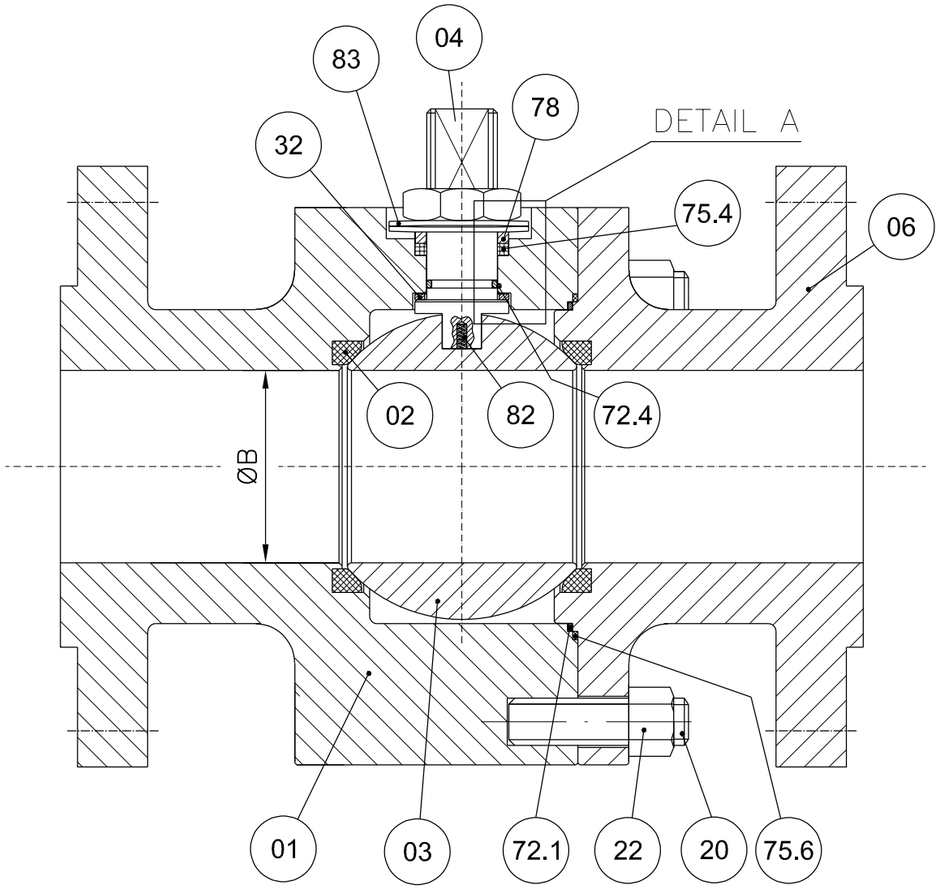

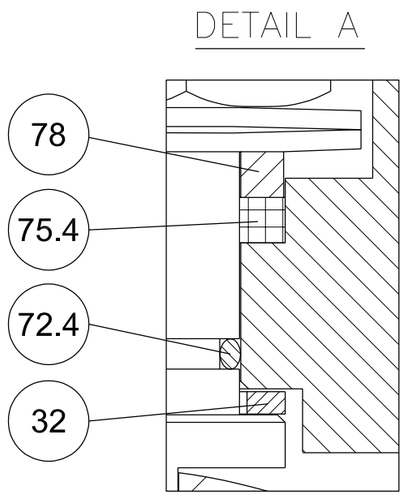


POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: D240062-08 | Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-008	25	
	2	Service				HYDROGEN STORAGE TANK V-25001B INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80016	Zone 2, Gas Group IIC (or IIB+H2), Class T1	
PIPELINE	4	Line Number				1"-HY-016-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm	1" / 3.38 mm	
	6	Line Material	Line Insulation			ASTM A312/TP316/316L	NOT INSUL. (PAINTED) (35)	
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS	GAS	
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29	80	
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close : (12)	Open : (12)	
	17	Operation (seconds)	Actual			Close : 0.3 minimum	Open : -	
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"	FULL BORE	
	22	Body Material	Bonnet Type			ASTM A182 F316/316L	(*)	
	23	Connections	Rating			FLANGED ASME B16.5	#300	
	24	Flange Finish	Gasket Material			RF	Inside the valve (*) (38)	
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)	(*)	
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork	Spring Return	
	31	Model No.	Size			CP/S	035-100A/BA	
	32	Actuator Orientation	Actuator Form			Horizontal	Cylinder	
	33	Ingress Protection	Certification			IP-66	II 2 G Ex h IIC T5 Gb	
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE	CLOSE	
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-008(9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-008 (9, 17) - Soldo SS	25-ZSH-008 (9, 17) - Soldo SS	
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)	NOT REQUIRED	
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20	H	
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-	-	
	48	Check Valve	Mounting			-	-	
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR	25-SDV-023	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE

Bourdon tube pressure gauge, stainless steel
For the process industry, standard version
Models 232.50, 233.50, NS 63 [2 ½"], 100 [4"] and 160 [6"]

For further approvals, see page 6

Applications

- For gaseous and liquid aggressive media that are not highly viscous or crystallising, also in aggressive environments
- Chemical and petrochemical industries, oil and gas industry, power engineering and also water and wastewater technology
- Machine building and general plant construction

Special features

- Excellent load cycle stability and shock resistance
- With case filling (model 233.50) for applications with high dynamic pressure loads and vibrations
- Completely from stainless steel
- Scale ranges from 0 … 0.6 to 0 … 1,600 bar or 0 ... 10 to 0 ... 20,000 psi
- QR code on dial links to instrument-specific information



Bourdon tube pressure gauge, model 232.50, NS 100 [4"]

Description

This high-quality Bourdon tube pressure gauge has been designed especially for the process industry.

The use of high-quality stainless steel materials and the robust design are geared to applications in the chemical and process engineering industries. Thus the instrument is suitable for liquid and gaseous media, also in aggressive environments.

Scale ranges of 0 … 0.6 to 0 … 1,600 bar [0 ... 10 to 0 ... 20,000 psi] ensure the measuring ranges required for a wide variety of applications.

WIKA manufactures and qualifies the pressure gauge in accordance with the standards EN 837-1 and ASME B40.100. As a safety function, this instrument has a blow-out device with blow-out plug on the back of the case. In the event of a failure, overpressure can escape there.

The model 233.50 with liquid-filled case is suitable for high dynamic pressure loads and vibrations.

The QR code on the dial allows instrument-specific information such as the serial number, the order number, certificates and other product data to be retrieved from the internet easily and in the long term.

Smart in sensing

Data sheets showing similar products:
Stainless steel, safety version; see data sheet PM 02.04
Bourdon tube pressure gauge with switch contacts; see data sheet PV 22.02
Monel version; see data sheet PM 02.33
Pressure gauge per EN 837-1 with mounted diaphragm seal; see data sheet DS 95.12

Specifications

Basic information	
Standard	■ EN 837-1 ■ ASME B40.100
	For information on the “Selection, installation, handling and operation of pressure gauges”, see technical information IN 00.05.
Further version	■ Oil- and grease-free for oxygen ■ Per NACE [1] MR0175 / ISO 15156, use in H_2S-containing environments in oil and gas production ■ With pre-volume deflagration flame arrester [2] for mounting to zone 0 (EPL Ga); model 910.21; see data sheet AC 91.02 ■ Monel version; models 262 and 263; see data sheet PM 02.33
Nominal size (NS)	■ Ø 63 mm [2 ½"] ■ Ø 100 mm [4"] ■ Ø 160 mm [6"]
Connection location	■ Lower mount (radial) ■ Lower back mount ■ Centre back mount (only for NS 63 [2 ½"])
Window	Laminated safety glass (NS 63 [2 ½"]: Polycarbonate)
Case	
Design	Safety level “S1” per EN 837-1 With blow-out device at case circumference, 12 o'clock (NS 63 [2 ½"]) and on the back of the case (NS 100 [4"] and 160 [6"]) Scale ranges ≤ 0 ... 16 bar [≤ 0 ... 300 psi] with compensating valve to vent and reseal case
Material	■ Stainless steel 1.4301 (304) ■ Stainless steel 1.4571 (316Ti)
Ring	Bayonet ring, stainless steel
Mounting	■ Without ■ Panel mounting flange, stainless steel ■ Panel mounting flange, polished stainless steel ■ Triangular profile ring with mounting bracket, polished stainless steel ■ Surface mounting flange, stainless steel
Case filling (model 233.50)	■ Without ■ Glycerine ■ Glycerine-water mixture for NS 100 [4"] and 160 [6"] with scale range ≤ 0 ... 2.5 bar [≤ 0 ... 40 psi] or for NS 63 [2 ½"] with scale range ≤ 0 ... 4 bar [≤ 0 ... 60 psi] ■ Silicone oil
Movement	■ Stainless steel ■ Stainless steel 1.4404 (316L) ■ everlast® version

1) General information about NACE standards; see data sheet IN 00.21
2) Only for instruments with Ex approval

Measuring element	
Type of measuring element	Bourdon tube, C-type or helical type
Material	Stainless steel 1.4404 (316L)
Leak tightness	■ Helium tested, leakage rate: $< 5 \cdot 10^{-3}$ mbar l/s ■ Helium tested, leakage rate: $< 1 \cdot 10^{-6}$ mbar l/s

Accuracy specifications		
Accuracy class		
NS 63 [2 ½"]	■ EN 837-1	Class 1.6
	■ ASME B40.100	±2 % | ±1 % | ±2 % of measuring span (grade A)
NS 100 [4"], 160 [6"]	■ EN 837-1	Class 1.0
	■ ASME B40.100	±1 % of measuring span (grade 1A)
Temperature error	On deviation from the reference conditions at the measuring system: ≤ ±0.4 % per 10 °C [≤ ±0.4 % per 18 °F] of full scale value	
Reference conditions		
Ambient temperature	+20 °C [+68 °F]	

Scale ranges

bar	
0 ... 0.6 [1]	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160
0 ... 4	0 ... 250
0 ... 6	0 ... 400
0 ... 10	0 ... 600
0 ... 16	0 ... 1,000
0 ... 25	0 ... 1,600

kg/cm²	
0 ... 0.6 [1]	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160
0 ... 4	0 ... 250
0 ... 6	0 ... 400
0 ... 10	0 ... 600
0 ... 16	0 ... 1,000
0 ... 25	0 ... 1,600

kPa	
0 ... 60 [1]	0 ... 4,000
0 ... 100	0 ... 6,000
0 ... 160	0 ... 10,000
0 ... 250	0 ... 16,000
0 ... 400	0 ... 25,000
0 ... 600	0 ... 40,000
0 ... 1,000	0 ... 60,000
0 ... 1,600	0 ... 100,000
0 ... 2,500	0 ... 160,000

MPa	
0 ... 0.06 [1]	0 ... 4
0 ... 0.1	0 ... 6
0 ... 0.16	0 ... 10
0 ... 0.25	0 ... 16
0 ... 0.4	0 ... 25
0 ... 0.6	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160

psi	
0 ... 10 [1]	0 ... 1,000
0 ... 15	0 ... 1,500
0 ... 30	0 ... 2,000
0 ... 60	0 ... 3,000
0 ... 100	0 ... 4,000
0 ... 160	0 ... 5,000
0 ... 200	0 ... 6,000
0 ... 300	0 ... 7,500
0 ... 400	0 ... 10,000
0 ... 600	0 ... 15,000
0 ... 800	0 ... 20,000

1) Not available for NS 63 [2 ½"]

Vacuum and +/- scale ranges

bar	
-0.6 ... 0 [1]	-1 ... +5
-1 ... 0	-1 ... +9
-1 ... +0.6	-1 ... +15
-1 ... +1.5	-1 ... +24
-1 ... +3	

MPa	
-0.06 ... 0 [1]	-0.1 ... +0.5
-0.1 ... 0	-0.1 ... +0.9
-0.1 ... +0.06	-0.1 ... +1.5
-0.1 ... +0.15	-0.1 ... +2.4
-0.1 ... +0.3	

kPa	
-60 ... 0 [1]	-100 ... +500
-100 ... 0	-100 ... +900
-100 ... +60	-100 ... +1,500
-100 ... +150	-100 ... +2,400
-100 ... +300	

psi	
-30 inHg ... 0	-30 inHg ... +100
-30 inHg ... +15	-30 inHg ... +160
-30 inHg ... +30	-30 inHg ... +200
-30 inHg ... +60	-30 inHg ... +300

1) Not available for NS 63 [2 ½"]

Further details on: scale ranges	
Special scale ranges	Other scale ranges on request
Unit	■ bar ■ psi ■ kg/cm² ■ kPa ■ MPa
Increased overload safety	■ Without ■ 2 times ■ 3 times ■ 4 times ■ 5 times
	The possibility of selection depends on scale range and nominal size
Vacuum resistance	■ Without ■ Vacuum-resistant to -1 bar
Dial	
Scale colour	Black
Material	Aluminium
Special scale	■ Without ■ With temperature scale for refrigerant, e.g. for NH_3: R 717
	Other scales or customer-specific dials, e.g. with red mark, circular arcs or circular sectors, on request
Pointer	
Instrument pointer	Aluminium, black
Mark pointer/drag pointer	■ Without ■ Red mark pointer on dial, fixed ■ Red mark pointer on window, adjustable ■ Mark pointer on bayonet ring, adjustable ■ Red drag pointer on window, adjustable
Pointer stop pin	■ Without ■ At zero point (only for NS 63 [2 ½"]) ■ At 6 o'clock (only for NS 100 [4"], 160 [6"])

Process connection		
Standard	■ EN 837-1 ■ ISO 7 ■ ANSI/B1.20.1	
Size		
EN 837-1	■ G ⅛ B, male thread ■ G ¼ B, male thread ■ G ½ B, male thread ■ M12 x 1.5, male thread ■ M20 x 1.5, male thread	
ISO 7	■ R ¼, male thread ■ R ½, male thread	
ANSI/B1.20.1	■ ¼ NPT, male thread ■ ½ NPT, male thread	
Restrictor	■ Without ■ Ø 0.6 mm [0.024"], stainless steel ■ Ø 0.3 mm [0.012"], stainless steel	
Material (wetted)		
Process connection	Stainless steel 1.4404 (316L)	
Bourdon tube	Stainless steel 1.4404 (316L)	

→ Other process connections on request

Operating conditions		
Medium temperature		
Unfilled instruments	-40 ... +200 °C [-40 ... +392 °F]	
Instruments with glycerine filling	-20 ... +100 °C [-4 ... +212 °F]	
Instruments with silicone oil filling	-40 ... +100 °C [-40 ... +212 °F]	
Ambient temperature		
Unfilled instruments or with silicone oil filling	-40 ... +60 °C [-40 ... +140 °F]	
Instruments with glycerine filling	-20 ... +60 °C [-4 ... +140 °F]	
Pressure limitation		
NS 63 [2 ½"]	Steady	3/4 x full scale value
	Fluctuating	2/3 x full scale value
	Short time	Full scale value
NS 100 [4"], 160 [6"]	Steady	Full scale value
	Fluctuating	0.9 x full scale value
	Short time	1.3 x full scale value
Ingress protection per IEC/EN 60529	■ IP65 ■ IP66 (only selectable for scale ranges ≥ 0 ... 20 bar [0 ... 400 psi])	

Approvals

Logo	Description	Region
CE	**EU declaration of conformity** Pressure equipment directive PS > 200 bar, module A, pressure accessory	European Union
UKCA	**UKCA** Pressure equipment (safety) regulations	United Kingdom
-	**CRN** Safety (e.g. electr. safety, overpressure, ...) For full scale value ≤ 1,000 bar	Canada

Optional approvals

Logo	Description	Region
CE Ex	**EU declaration of conformity** ATEX directive Hazardous areas - Ex h Gas II 2G Ex h IIC T6 ... T1 Gb X Dust II 2D Ex h IIIC T85°C ... T450°C Db X	European Union
UKCA	**UKCA** Equipment and protective systems intended for use in potentially explosive atmospheres regulations	United Kingdom
EAC Ex	**EAC** Hazardous areas	Eurasian Economic Community
	Ex Ukraine Hazardous areas	Ukraine
	PAC Kazakhstan Metrology, measurement technology	Kazakhstan
-	**MChS** Permission for commissioning	Kazakhstan
-	**PAC Ukraine** Metrology, measurement technology	Ukraine
	PAC Uzbekistan Metrology, measurement technology	Uzbekistan
-	**PAC China** Metrology, measurement technology	China
	DNV Ships, shipbuilding (e.g. offshore)	International
-	**KBA** [1] Automotive	International
	Hydrogen-powered motor vehicles - (EC) no. 79/2009 and (EU) no. 406/2010	
	Components for motor vehicles using natural gas (CNG/LNG) – UN no. R 110	

1) Not available for all versions

Manufacturer's declaration

Logo	Description
-	Pressure equipment directive (PED) for maximum allowable pressure PS ≤ 200 bar
-	Suitability of wetted materials for drinking water in accordance with the European 4MS initiative
-	Suitability of wetted materials for hydrogen


Certificates (option)

Certificates	
Certificates	■ 2.2 test report per EN 10204 (e.g. state-of-the-art manufacturing, indication accuracy) ■ 3.1 inspection certificate per EN 10204 (e.g. material proof for wetted metal parts, indication accuracy) ■ PCA calibration certificate, traceable and accredited in accordance with ISO/IEC 17025 ■ Calibration certificate by a national accreditation body, traceable and accredited in accordance with ISO/IEC 17025 on request
Recommended calibration interval	1 year (dependent on conditions of use)

→ For approvals and certificates, see website

Dimensions in mm [in]

Lower mount (radial)

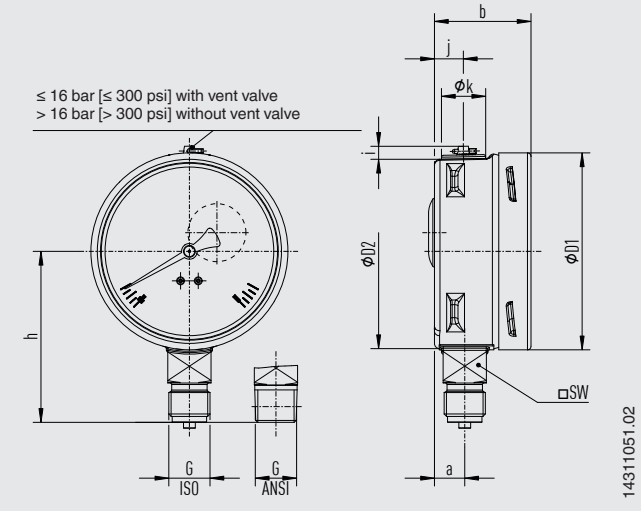

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]
100 [4"]	approx. 0.6 kg [1.32 lbs]	approx. 0.9 kg [1.98 lbs]
160 [6"]	approx. 1.1 kg [2.43 lbs]	approx. 2.0 kg [4.41 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	G ¼ B	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	51 [2.01]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	G ¼ B	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	87 [3.43]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	87 [3.43]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	G ¼ B	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	118 [4.65]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	118 [4.65]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ISO 7


NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	R ¼	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	R ¼	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	86 [3.39]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	R ¼	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	117 [4.60]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	¼ NPT	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	51 [2.01]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	¼ NPT	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	86 [3.39]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	¼ NPT	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	117 [4.60]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

1) Plus 16 mm [0.630 in] with scale range 0 ... 1,600 bar [0 ... 20,000 psi]

Lower back mount

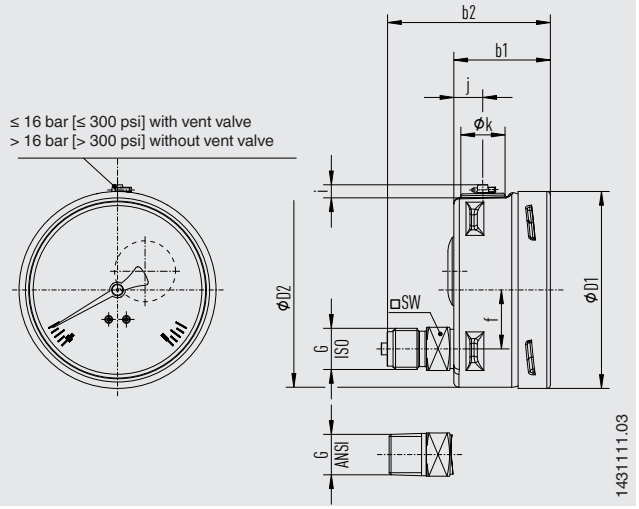

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]
100 [4"]	approx. 0.6 kg [1.32 lbs]	approx. 0.9 kg [1.98 lbs]
160 [6"]	approx. 1.1 kg [2.43 lbs]	approx. 2.0 kg [4.41 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	G ¼ B	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	33 [1.30]	54 [2.13]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	G ¼ B	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	49.5 [1.95]	83 [3.27]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	49.5 [1.95]	83 [3.27]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	G ¼ B	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	51.5 [2.03] 1)	85 [3.24] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	51.5 [2.03] 1)	85 [3.24] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ISO 7


NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	R ¼	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	R ¼	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	49.5 [1.95]	82 [3.23]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	R ¼	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	51.5 [2.03] 1)	84 [3.31] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	¼ NPT	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	50 [1.97]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	33 [1.30]	54 [2.13]	63 [2.48]	62 [2.44]	50 [1.97]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	¼ NPT	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	49.5 [1.95]	82 [3.23]	101 [3.98]	99 [3.90]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	¼ NPT	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	51.5 [2.03] 1)	84 [3.31] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

1) Plus 16 mm [0.630 in] with scale ranges ≥ 0 ... 100 bar [≥ 0 ... 1,500 psi]

NS 63 [2 ½"], centre back mount

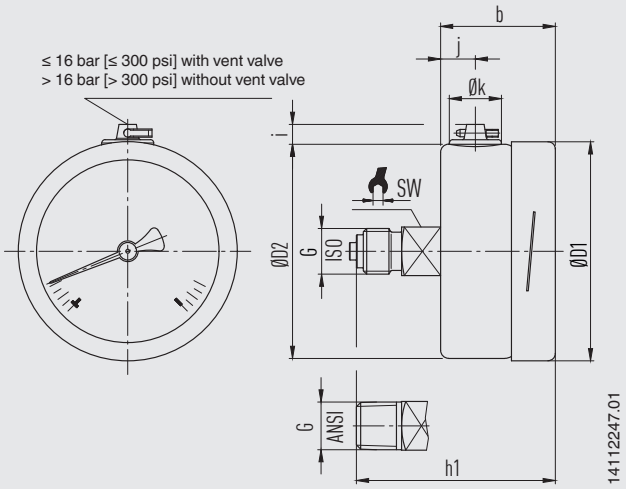

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	G ¼ B	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	54 [2.13]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]

Process connection with thread per ISO 7

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	R ¼	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]


Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	¼ NPT	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	54 [2.13]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]


Accessories

Dimensions in mm [in]

Panel mounting flange

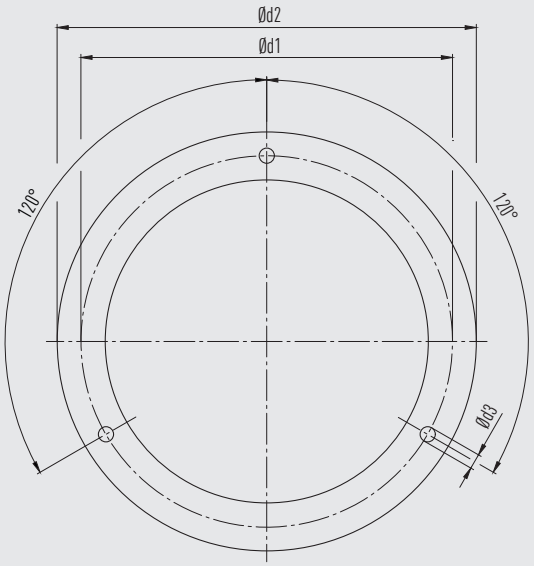


Surface mounting flange

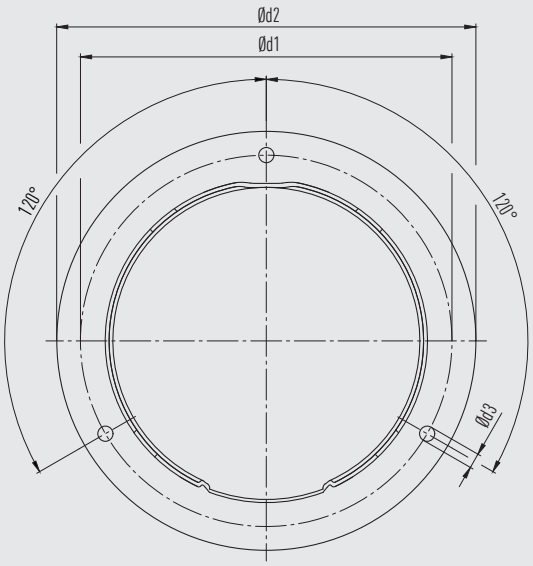


NS	Dimensions in mm [in]			
	Recommended panel cutout	d1	d2	d3
63 [2 ½"]	Ø 67 ±0.3 / Ø 2.6 [Ø 2.64 ±0.01 / Ø 0.10]	75 [2.95]	85 [3.35]	3.6 [0.14]
100 [4"]	Ø 104 ±0.5 / Ø 4.1 [Ø 4.04 ±0.02 / Ø 0.16]	117 [4.60]	132 [5.20]	4.8 [0.19]
160 [6"]	Ø 164 ±0.5 / Ø 6.5 [Ø 6.46 ±0.02 / Ø 0.26]	178 [7.01]	196 [7.72]	5.8 [0.23]

Triangular profile ring

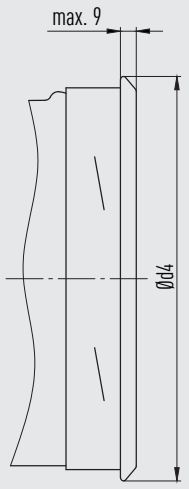

NS	Dimensions in mm [in]	
	Recommended panel cutout	d4
63 [2 ½"]	Ø 64.5 ±0.5 / Ø 2.5 [Ø 2.54 ±0.02 / Ø 0.01]	≤ 69 [2.72]
100 [4"]	Ø 102 ±1.0 / Ø 4.0 [Ø 4.02 ±0.04 / Ø 0.16]	≤ 108 [4.25]
160 [6"]	Ø 162.6 ±1.0 / Ø 6.4 [Ø 6.40 ±0.04 / Ø 0.25]	≤ 168 [6.61]

Accessories and spare parts

Model		Description
	**910.17**	Seals → See data sheet AC 09.08
	**910.15**	Syphons → See data sheet AC 09.06
	**910.13**	Overpressure protector → See data sheet AC 09.04
	**IV10, IV11**	Needle valve and multiport valve → See data sheet AC 09.22
	**IV20, IV21**	Block-and-bleed valve → See data sheet AC 09.19
	**IVM**	Monoflange, process and instrument version → See data sheet AC 09.17
	**BV**	Ball valve, process and instrument version → See data sheet AC 09.28
	**IBF2, IBF3**	Monoblock with flange connection → See data sheet AC 09.25

Ordering information

Model / Nominal size / Scale range / Process connection / Connection location / Options

© 02/1995 WIKA Alexander Wiegand SE & Co. KG, all rights reserved.
The specifications given in this document represent the state of engineering at the time of publishing.
We reserve the right to make modifications to the specifications and materials.
In case of a different interpretation of the translated and the English data sheet, the English wording shall prevail.

WIKA Alexander Wiegand SE & Co. KG
Alexander-Wiegand-Straße 30
63911 Klingenberg/Germany
Tel. +49 9372 132-0
info@wika.de
www.wika.de

EU-Konformitätserklärung
EU Declaration of Conformity

Dokument Nr. / ***Document No.*** **11564220** — **Revision** / ***Issue*** **07**

Wir erklären in alleiniger Verantwortung, dass die mit CE gekennzeichneten Produkte
We declare under our sole responsibility that the CE marked products

Typenbezeichnung / ***Type Designation***

23a.50.063 + option ATEX | **23a.50.1*0 + option ATEX**
26a.50.063 + option ATEX | **26a.50.1*0 + option ATEX**
23a.30.063 + option ATEX | **23a.30.1*0 + option ATEX**
26a.30.063 + option ATEX | **26a.30.1*0 + option ATEX**
23a.53.063 + option ATEX | **23a.53.100 + option ATEX**
23a.54.063 + option ATEX | **23a.54.100 + option ATEX**
23a.36.1*0 + option ATEX
PG23LT.063 + option ATEX | **PG23LT.1*0 + option ATEX**
PG23CP.063 + option ATEX | **PG23CP.100 + option ATEX**
PG28.1*0 + option ATEX
PG23HP-S.1*0 + option ATEX | **PG23HP-P.1*0 + option ATEX**

*** Nominal size**
0 = 100mm
6 = 160mm

a Case filling
2 = Without case filling
3 = With case filling

Beschreibung / ***Description***: **Rohrfederdruckmessgerät** / ***Bourdon Tube Pressure Gauge***

gemäß gültigem Datenblatt / *according to the valid data sheet*: PM 02.02, PM 02.04, PM 02.12, PM 02.15, PM 02.22, PM 02.24, PM 02.32, PM 02.28, PM 02.29

mit den nachfolgenden relevanten Harmonisierungsvorschriften der Union übereinstimmen
are in conformity with the following relevant Union harmonisation legislation

Angewandte harmonisierte Normen oder sonstige technische Spezifikationen:
Applied harmonised standards or other technical specifications:

2014/68/EU	Druckgeräterichtlinie (DGRL) (1) *Pressure Equipment Directive (PED)* (1)	
2014/34/EU	Explosionsschutz (ATEX) (2) *Explosion protection (ATEX)* (2)	
Ex	II 2G Ex h IIC T6 … T1 Gb X II 2D Ex h IIIC T85 °C … T450 °C Db X	EN ISO 80079-36 :2016 EN ISO 80079-37 :2016

(1) PS > 200 bar; Modul A, druckhaltendes Ausrüstungsteil
PS > 200 bar; Module A, pressure accessory

(2) Modul A „interne Fertigungskontrolle“. Die Dokumentation ist hinterlegt unter der Nummer 074/24 bei der Notifizierten Stelle der EU, IBExU Institut für Sicherheitstechnik GmbH (EU ID-Nr. 0637).
Module A “Internal Control of Production”. The Documentation is deposited under registration number 074/24 at Notified Body of EU, IBExU Institut für Sicherheitstechnik GmbH (EU ID 0637). .

Unterzeichnet für und im Namen von / *Signed for and on behalf of*

WIKA Alexander Wiegand SE & Co. KG

Klingenberg, 2024-04-24


Sascha Schnellbacher, Vice President
CoE Gauges, Sensors & Instruments

Mariusz Lubomski, Director of Quality
CoE Gauges, Sensors & Instruments


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

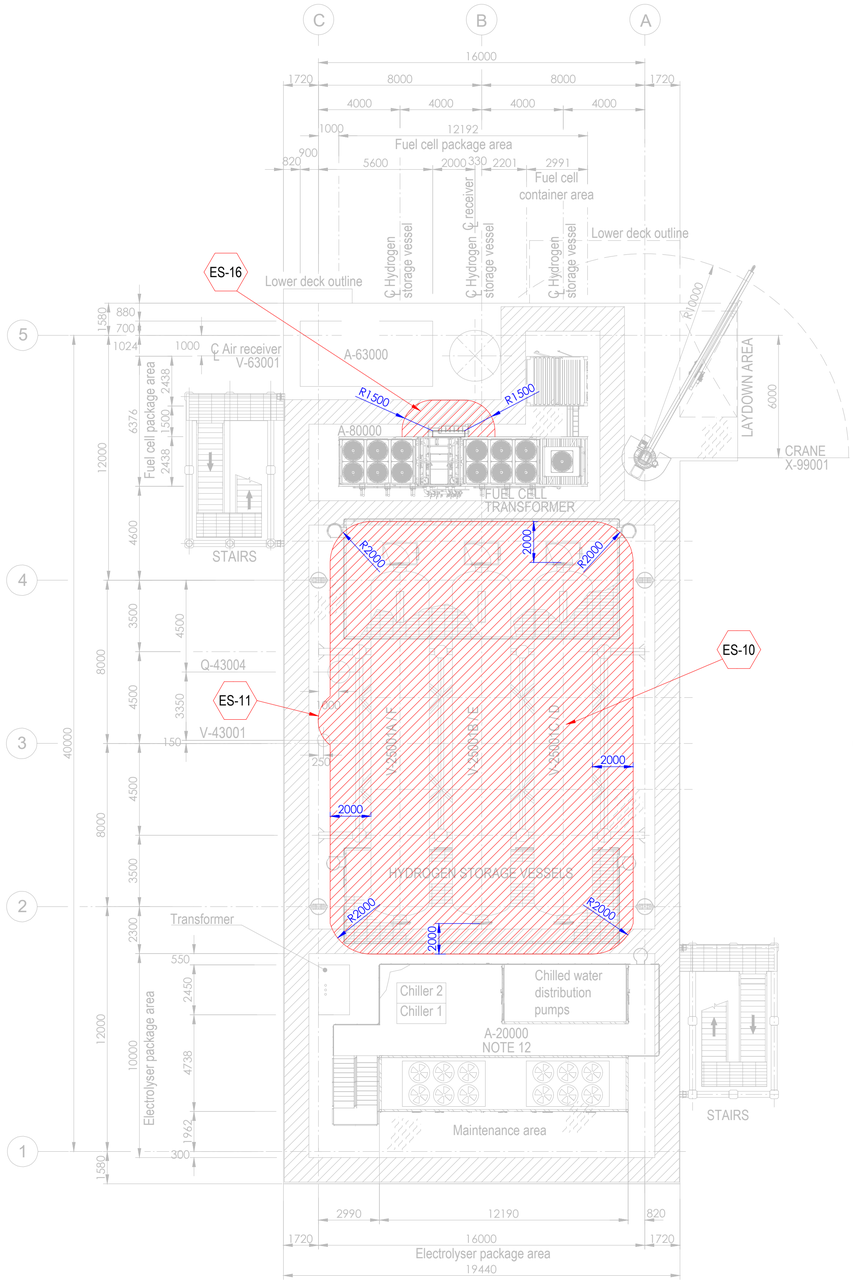


PLAN ON UPPER DECK
EL+30.310 T.O.S.

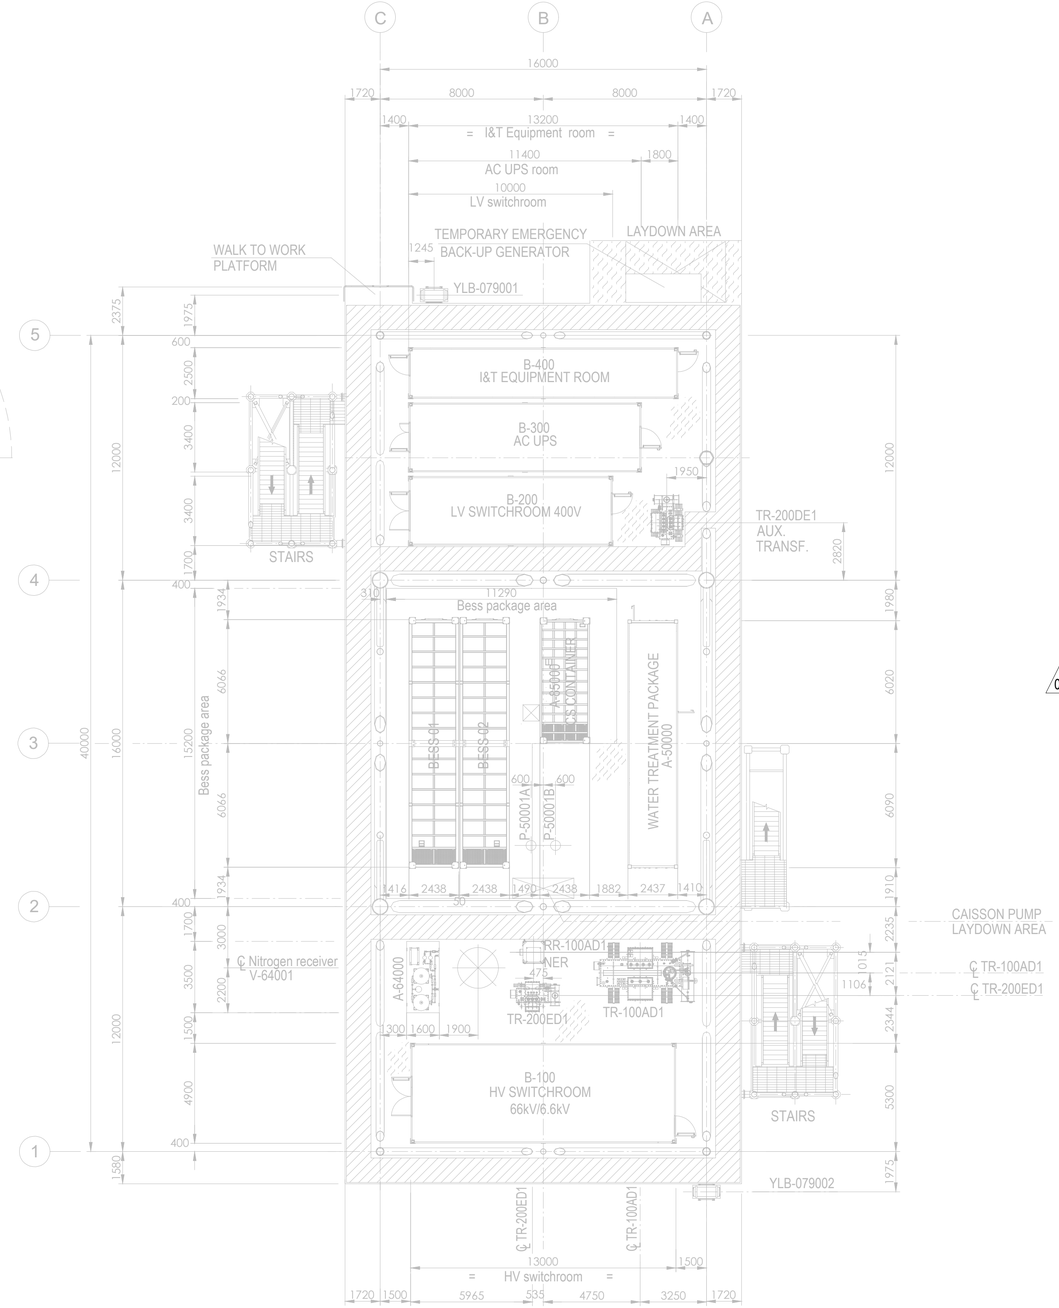

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

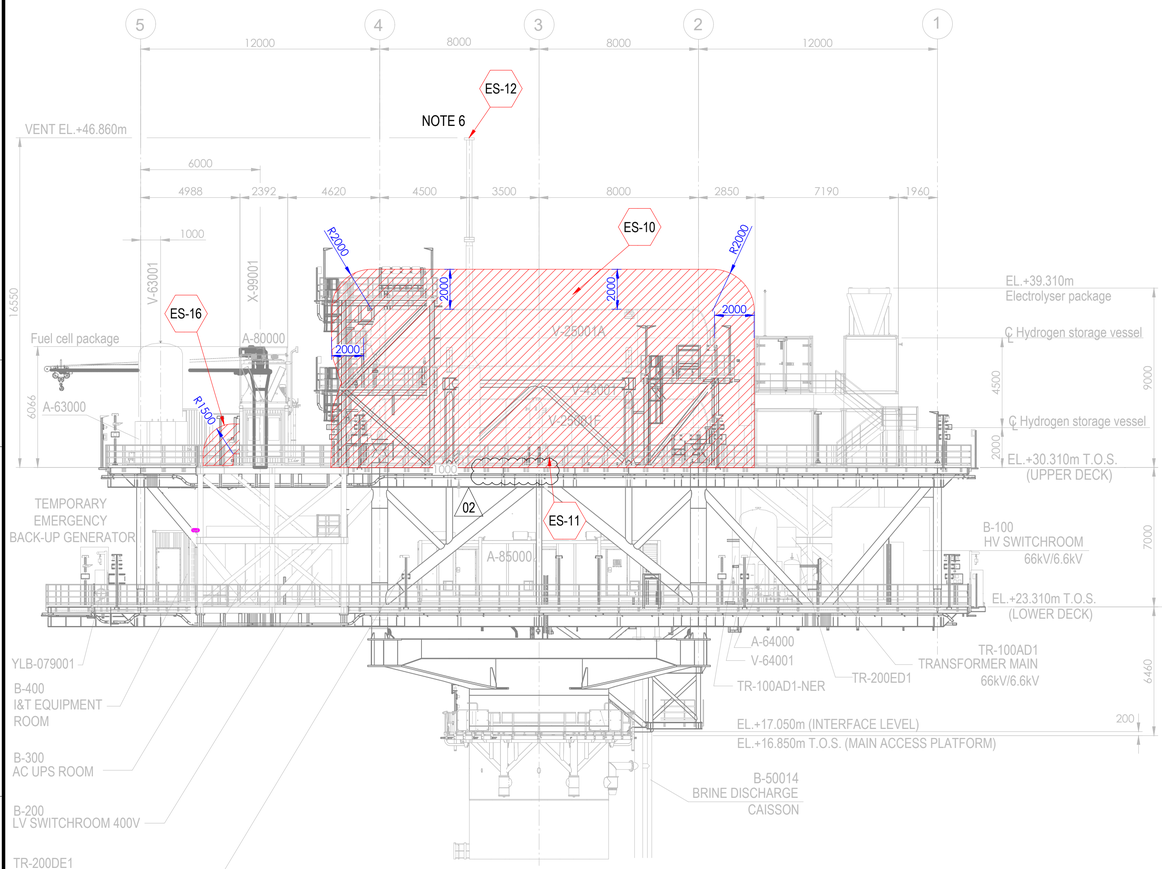



ELEVATION LOOKING EAST

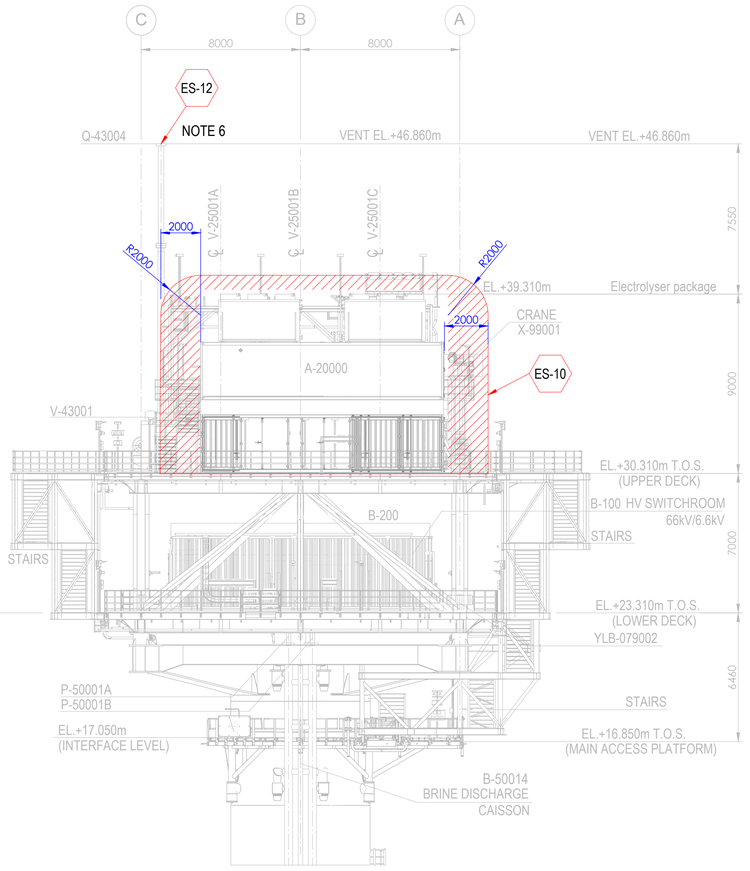

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

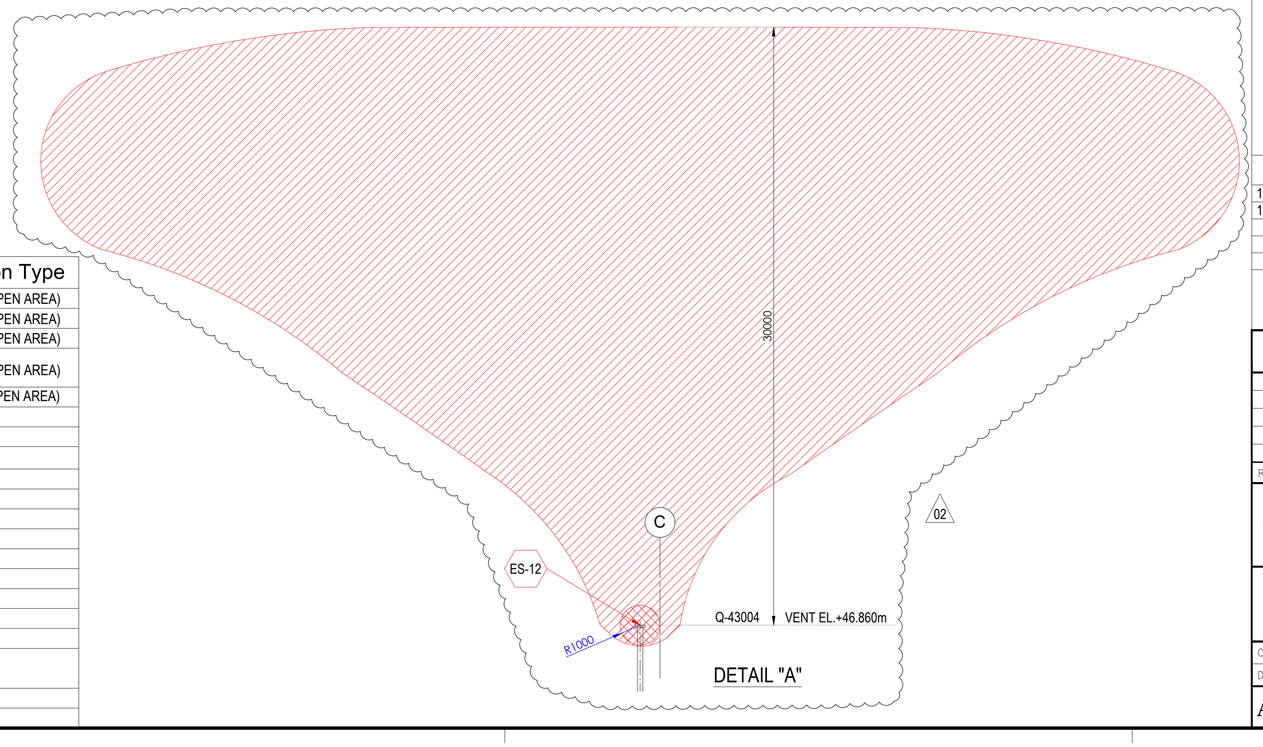



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PG -011	: Air Set Pressure Gauge Filter - Vessel V-25001C Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80017		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10004823	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		PW00DE21M31			
Manufacturer	Wika			**Model**		233.50.63			
Cert No.	D.o.C. by Manufacturer reference 11564220			**Equipment Ambient Temp.**		-20 °C to +60 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP65

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PG -011	: Air Set Pressure Gauge Filter - Vessel V-25001C Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80017
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004823	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-PG -011	: Air Set Pressure Gauge Filter - Vessel V-25001C Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80017
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004823	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA

Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	VENDOR ROTORK (PER FLUITEK)	RM (ROSETTI MARINO)	
Name	Stefano Linari	Giovanni Tangianu	
Date	2025-04-24	2025-04-24	
Signature	PROVERLIS Digitaly signed by Stefano Linari 2025-04-24T13:20:44.621Z	PROVERLIS Digitaly signed by Giovanni Tangianu 2025-04-24T15:18:04.008Z	

ROTORK CONTROLS ITALIA srl
Via Portico 17
24050 Orio Al Serio (BG)

Telefono: 0039 (0)5832221
E-mail: rotork.italia@rotork.com



WIKA Product Pass Italiano

serial number

WIKA

25-xv-011

Type 23X.50

Manometro a molla tubolare 232.50/233.50
Cassa in acciaio inox

Serial number:

PW00DE21M31

Item number:

57424821

Manufacturing date:

04/2025



ITEM	Tag	25-PG -011	: Air Set Pressure Gauge Filter - Vessel V-25001C Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80017		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10004823	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		8975GNEG			
Manufacturer	Wika			**Model**		233.50.63			
Cert No.	D.o.C. by Manufacturer, reference 11564220			**Equipment Ambient Temp.**		-20 °C to +60 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP65

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PG -011	: Air Set Pressure Gauge Filter - Vessel V-25001C Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80017
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004823	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-PG -011	: Air Set Pressure Gauge Filter - Vessel V-25001C Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80017
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004823	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-31	2025-02-01	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-31T09:38:10.527Z	PROVERLIS Digitaly signed by Luca Mussi 2025-02-01T12:04:13.849Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

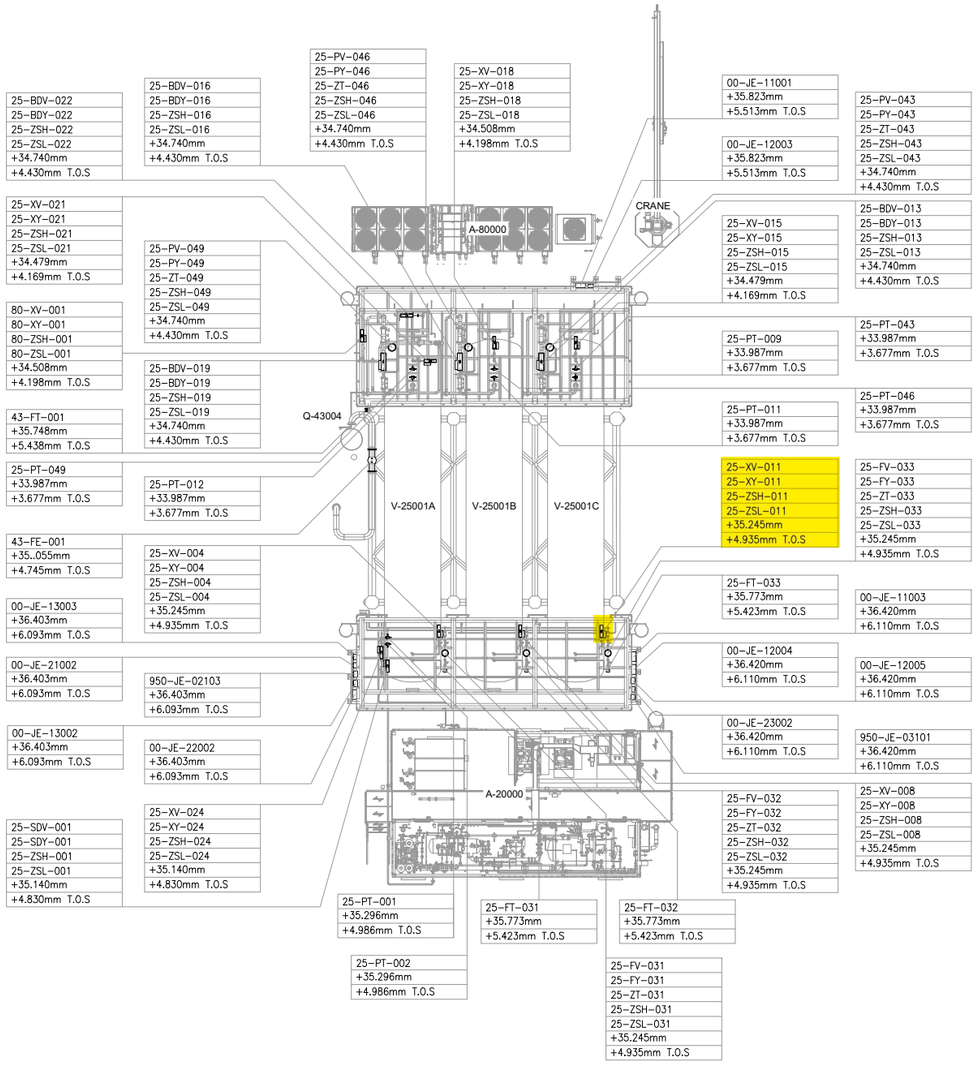

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081
REV.: 2_A | DATE: 07/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING_NO. DRAWING_NO.

REV. REV

V-25001_C

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

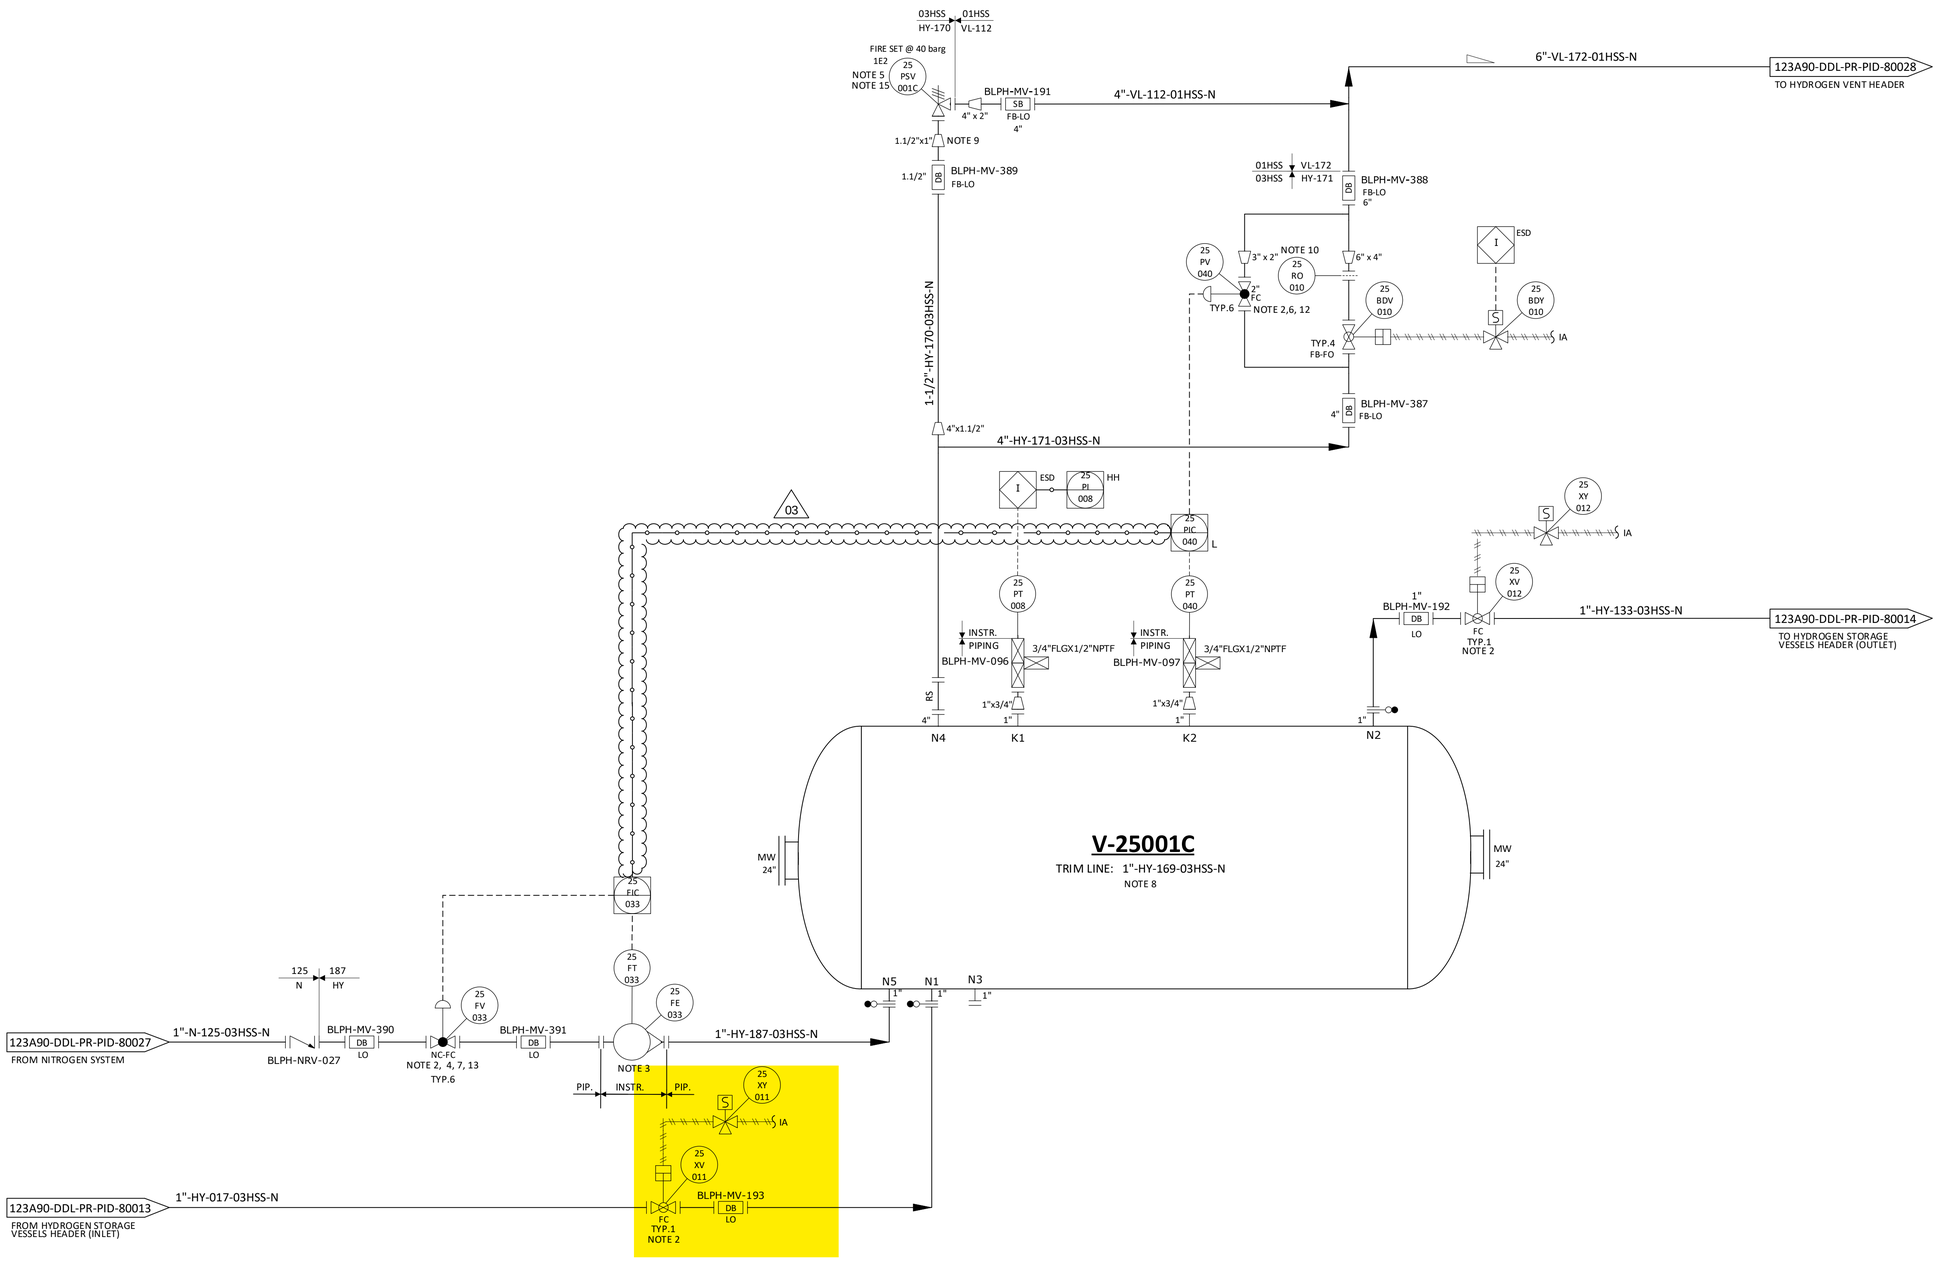

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-033) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-040 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-040 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-033 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-040 HAS FAILED TO CLOSE.
15. 25-PS-V001C SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL C

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE		
A1	DRAWING NO. 123A90-DDL-PR-PID-80017			SHEET 001	REV. 03

File Name = FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

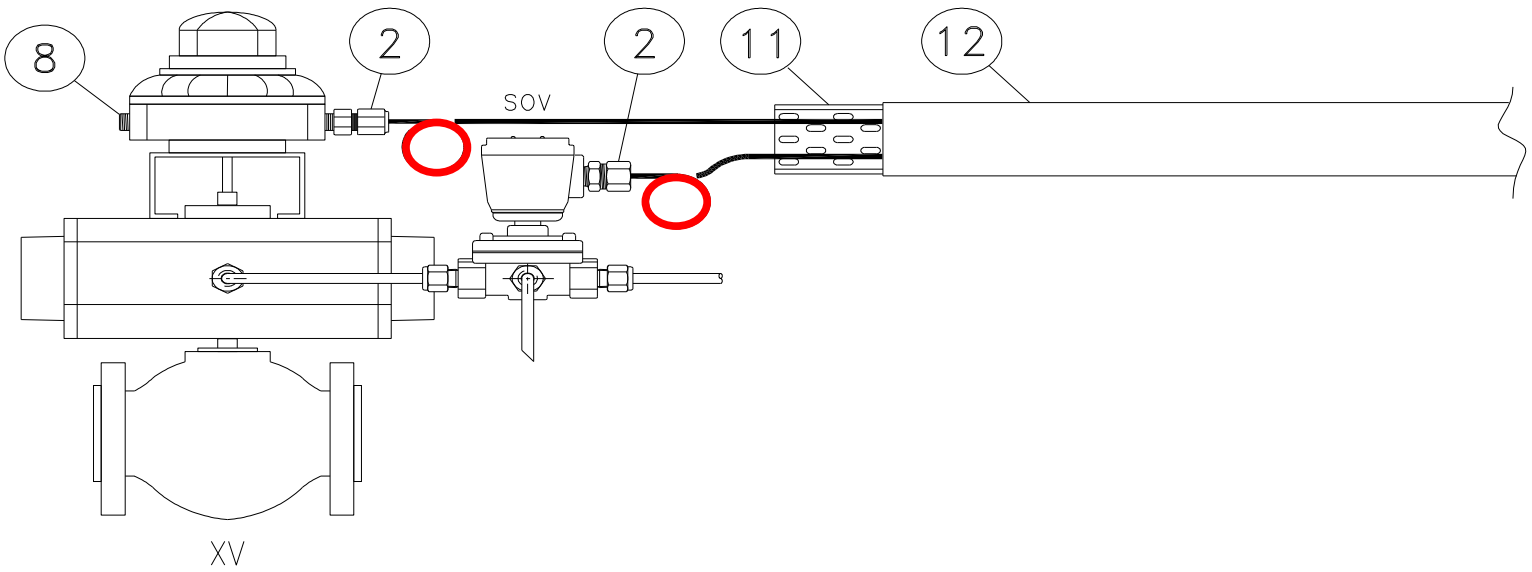

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

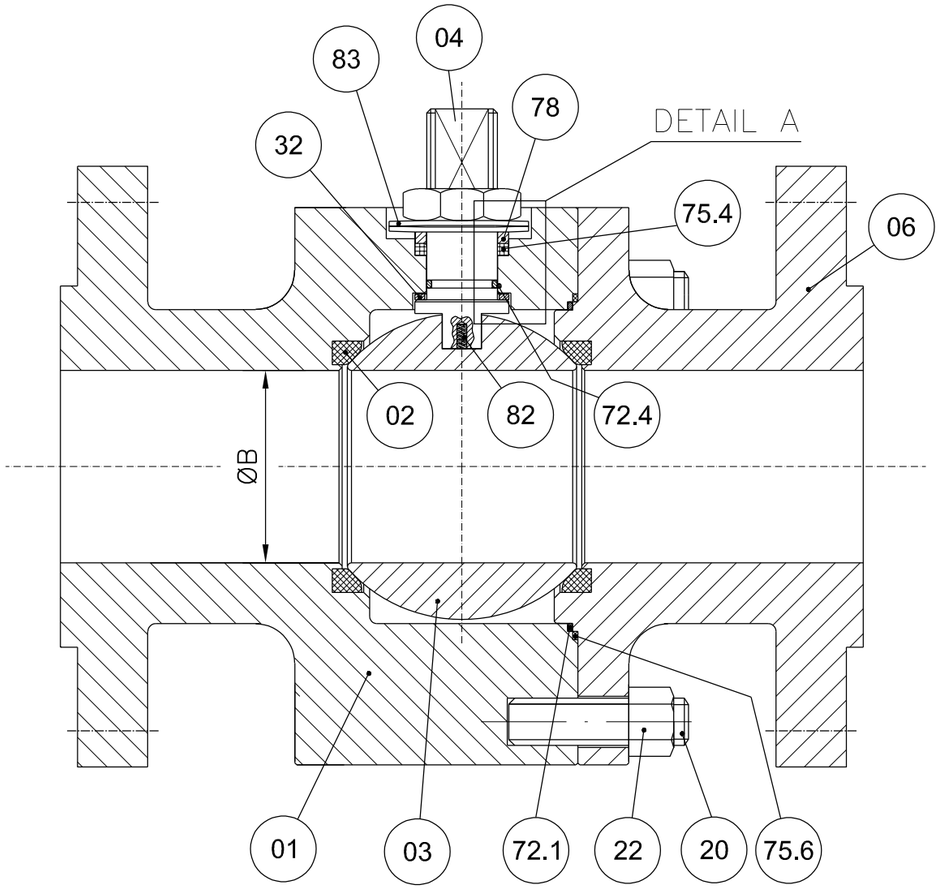




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301



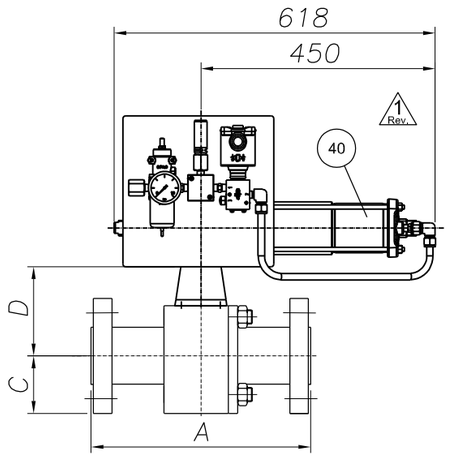

ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DRAWN: S.Madahar — DATE: 26/02/2024
CHK'D: D.Barcella — DATE: 26/02/2024
APPV'D: L.Mora — DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWING NAME: **D240062-08**

Rev.: 2

GENERAL	1	Tag Number		Location		25-XV-011		25
	2	Service				HYDROGEN STORAGE TANK V-25001C INLET		
	3	P&ID Number		Area Classification		123A90-DDL-PR-PID-80017		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-017-03HSS-N		
	5	Line Size and Schedule	Inlet		Outlet	1" / 3.38 mm		1" / 3.38 mm
	6	Line Material		Line Insulation		ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State		Phase		GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure		Full Vacuum	[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature		Minimum	Maxi [°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of		Design		Close :	(12)	Open : (12)
	17	Operation (seconds)		Actual		Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size		Body Form		1"		FULL BORE
	22	Body Material		Bonnet Type		ASTM A182 F316/316L		(*)
	23	Connections		Rating		FLANGED ASME B16.5		#300
	24	Flange Finish		Gasket Material		RF		Inside the valve (*) (38)
	25	Packing		Lubrication & Isolation		A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer		Type		Rotork		Spring Return
	31	Model No.		Size		CP/S		035-100A/BA
	32	Actuator Orientation		Actuator Form		Horizontal		Cylinder
	33	Ingress Protection		Certification		IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply		Min	Max Design	4 barg	10 barg	11 barg
	35	Action on Air Failure		Action on Power Failure		CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-011 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed		Limit Switch Open		25-ZSL-011 (9, 17) - Soldo SS		25-ZSH-011 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set		Handwheel		(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection		Electrical Class		No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity		Fabrication Code		-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve		Model		-		-
	48	Check Valve		Mounting		-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

94	IFR	25-XV-009	floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR	25-XV-011	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR	25-XV-012	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR	25-XV-014	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR	25-XV-015	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR	25-XV-017	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR	25-XV-018	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

Bourdon tube pressure gauge, stainless steel
For the process industry, standard version
Models 232.50, 233.50, NS 63 [2 ½"], 100 [4"] and 160 [6"]

For further approvals, see page 6

Applications

- For gaseous and liquid aggressive media that are not highly viscous or crystallising, also in aggressive environments
- Chemical and petrochemical industries, oil and gas industry, power engineering and also water and wastewater technology
- Machine building and general plant construction

Special features

- Excellent load cycle stability and shock resistance
- With case filling (model 233.50) for applications with high dynamic pressure loads and vibrations
- Completely from stainless steel
- Scale ranges from 0 … 0.6 to 0 … 1,600 bar or 0 ... 10 to 0 ... 20,000 psi
- QR code on dial links to instrument-specific information



Bourdon tube pressure gauge, model 232.50, NS 100 [4"]

Description

This high-quality Bourdon tube pressure gauge has been designed especially for the process industry.

The use of high-quality stainless steel materials and the robust design are geared to applications in the chemical and process engineering industries. Thus the instrument is suitable for liquid and gaseous media, also in aggressive environments.

Scale ranges of 0 … 0.6 to 0 … 1,600 bar [0 ... 10 to 0 ... 20,000 psi] ensure the measuring ranges required for a wide variety of applications.

WIKA manufactures and qualifies the pressure gauge in accordance with the standards EN 837-1 and ASME B40.100. As a safety function, this instrument has a blow-out device with blow-out plug on the back of the case. In the event of a failure, overpressure can escape there.

The model 233.50 with liquid-filled case is suitable for high dynamic pressure loads and vibrations.

The QR code on the dial allows instrument-specific information such as the serial number, the order number, certificates and other product data to be retrieved from the internet easily and in the long term.

Smart in sensing

Data sheets showing similar products:
Stainless steel, safety version; see data sheet PM 02.04
Bourdon tube pressure gauge with switch contacts; see data sheet PV 22.02
Monel version; see data sheet PM 02.33
Pressure gauge per EN 837-1 with mounted diaphragm seal; see data sheet DS 95.12

Specifications

Basic information	
Standard	■ EN 837-1 ■ ASME B40.100
	For information on the “Selection, installation, handling and operation of pressure gauges”, see technical information IN 00.05.
Further version	■ Oil- and grease-free for oxygen ■ Per NACE [1] MR0175 / ISO 15156, use in H_2S-containing environments in oil and gas production ■ With pre-volume deflagration flame arrester [2] for mounting to zone 0 (EPL Ga); model 910.21; see data sheet AC 91.02 ■ Monel version; models 262 and 263; see data sheet PM 02.33
Nominal size (NS)	■ Ø 63 mm [2 ½"] ■ Ø 100 mm [4"] ■ Ø 160 mm [6"]
Connection location	■ Lower mount (radial) ■ Lower back mount ■ Centre back mount (only for NS 63 [2 ½"])
Window	Laminated safety glass (NS 63 [2 ½"]: Polycarbonate)
Case	
Design	Safety level “S1” per EN 837-1 With blow-out device at case circumference, 12 o'clock (NS 63 [2 ½"]) and on the back of the case (NS 100 [4"] and 160 [6"]) Scale ranges ≤ 0 ... 16 bar [≤ 0 ... 300 psi] with compensating valve to vent and reseal case
Material	■ Stainless steel 1.4301 (304) ■ Stainless steel 1.4571 (316Ti)
Ring	Bayonet ring, stainless steel
Mounting	■ Without ■ Panel mounting flange, stainless steel ■ Panel mounting flange, polished stainless steel ■ Triangular profile ring with mounting bracket, polished stainless steel ■ Surface mounting flange, stainless steel
Case filling (model 233.50)	■ Without ■ Glycerine ■ Glycerine-water mixture for NS 100 [4"] and 160 [6"] with scale range ≤ 0 ... 2.5 bar [≤ 0 ... 40 psi] or for NS 63 [2 ½"] with scale range ≤ 0 ... 4 bar [≤ 0 ... 60 psi] ■ Silicone oil
Movement	■ Stainless steel ■ Stainless steel 1.4404 (316L) ■ everlast® version

1) General information about NACE standards; see data sheet IN 00.21
2) Only for instruments with Ex approval

Measuring element	
Type of measuring element	Bourdon tube, C-type or helical type
Material	Stainless steel 1.4404 (316L)
Leak tightness	■ Helium tested, leakage rate: $< 5 \cdot 10^{-3}$ mbar l/s ■ Helium tested, leakage rate: $< 1 \cdot 10^{-6}$ mbar l/s

Accuracy specifications		
Accuracy class		
NS 63 [2 ½"]	■ EN 837-1	Class 1.6
	■ ASME B40.100	±2 % | ±1 % | ±2 % of measuring span (grade A)
NS 100 [4"], 160 [6"]	■ EN 837-1	Class 1.0
	■ ASME B40.100	±1 % of measuring span (grade 1A)
Temperature error	On deviation from the reference conditions at the measuring system: ≤ ±0.4 % per 10 °C [≤ ±0.4 % per 18 °F] of full scale value	
Reference conditions		
Ambient temperature	+20 °C [+68 °F]	

Scale ranges

bar	
0 ... 0.6 [1]	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160
0 ... 4	0 ... 250
0 ... 6	0 ... 400
0 ... 10	0 ... 600
0 ... 16	0 ... 1,000
0 ... 25	0 ... 1,600

kg/cm²	
0 ... 0.6 [1]	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160
0 ... 4	0 ... 250
0 ... 6	0 ... 400
0 ... 10	0 ... 600
0 ... 16	0 ... 1,000
0 ... 25	0 ... 1,600

kPa	
0 ... 60 [1]	0 ... 4,000
0 ... 100	0 ... 6,000
0 ... 160	0 ... 10,000
0 ... 250	0 ... 16,000
0 ... 400	0 ... 25,000
0 ... 600	0 ... 40,000
0 ... 1,000	0 ... 60,000
0 ... 1,600	0 ... 100,000
0 ... 2,500	0 ... 160,000

MPa	
0 ... 0.06 [1]	0 ... 4
0 ... 0.1	0 ... 6
0 ... 0.16	0 ... 10
0 ... 0.25	0 ... 16
0 ... 0.4	0 ... 25
0 ... 0.6	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160

psi	
0 ... 10 [1]	0 ... 1,000
0 ... 15	0 ... 1,500
0 ... 30	0 ... 2,000
0 ... 60	0 ... 3,000
0 ... 100	0 ... 4,000
0 ... 160	0 ... 5,000
0 ... 200	0 ... 6,000
0 ... 300	0 ... 7,500
0 ... 400	0 ... 10,000
0 ... 600	0 ... 15,000
0 ... 800	0 ... 20,000

1) Not available for NS 63 [2 ½"]

Vacuum and +/- scale ranges

bar	
-0.6 ... 0 [1]	-1 ... +5
-1 ... 0	-1 ... +9
-1 ... +0.6	-1 ... +15
-1 ... +1.5	-1 ... +24
-1 ... +3	

MPa	
-0.06 ... 0 [1]	-0.1 ... +0.5
-0.1 ... 0	-0.1 ... +0.9
-0.1 ... +0.06	-0.1 ... +1.5
-0.1 ... +0.15	-0.1 ... +2.4
-0.1 ... +0.3	

kPa	
-60 ... 0 [1]	-100 ... +500
-100 ... 0	-100 ... +900
-100 ... +60	-100 ... +1,500
-100 ... +150	-100 ... +2,400
-100 ... +300	

psi	
-30 inHg ... 0	-30 inHg ... +100
-30 inHg ... +15	-30 inHg ... +160
-30 inHg ... +30	-30 inHg ... +200
-30 inHg ... +60	-30 inHg ... +300

1) Not available for NS 63 [2 ½"]

Further details on: scale ranges	
Special scale ranges	Other scale ranges on request
Unit	■ bar ■ psi ■ kg/cm² ■ kPa ■ MPa
Increased overload safety	■ Without ■ 2 times ■ 3 times ■ 4 times ■ 5 times
	The possibility of selection depends on scale range and nominal size
Vacuum resistance	■ Without ■ Vacuum-resistant to -1 bar
Dial	
Scale colour	Black
Material	Aluminium
Special scale	■ Without ■ With temperature scale for refrigerant, e.g. for NH_3: R 717
	Other scales or customer-specific dials, e.g. with red mark, circular arcs or circular sectors, on request
Pointer	
Instrument pointer	Aluminium, black
Mark pointer/drag pointer	■ Without ■ Red mark pointer on dial, fixed ■ Red mark pointer on window, adjustable ■ Mark pointer on bayonet ring, adjustable ■ Red drag pointer on window, adjustable
Pointer stop pin	■ Without ■ At zero point (only for NS 63 [2 ½"]) ■ At 6 o'clock (only for NS 100 [4"], 160 [6"])

Process connection		
Standard	■ EN 837-1 ■ ISO 7 ■ ANSI/B1.20.1	
Size		
EN 837-1	■ G ⅛ B, male thread ■ G ¼ B, male thread ■ G ½ B, male thread ■ M12 x 1.5, male thread ■ M20 x 1.5, male thread	
ISO 7	■ R ¼, male thread ■ R ½, male thread	
ANSI/B1.20.1	■ ¼ NPT, male thread ■ ½ NPT, male thread	
Restrictor	■ Without ■ Ø 0.6 mm [0.024"], stainless steel ■ Ø 0.3 mm [0.012"], stainless steel	
Material (wetted)		
Process connection	Stainless steel 1.4404 (316L)	
Bourdon tube	Stainless steel 1.4404 (316L)	

→ Other process connections on request

Operating conditions		
Medium temperature		
Unfilled instruments	-40 ... +200 °C [-40 ... +392 °F]	
Instruments with glycerine filling	-20 ... +100 °C [-4 ... +212 °F]	
Instruments with silicone oil filling	-40 ... +100 °C [-40 ... +212 °F]	
Ambient temperature		
Unfilled instruments or with silicone oil filling	-40 ... +60 °C [-40 ... +140 °F]	
Instruments with glycerine filling	-20 ... +60 °C [-4 ... +140 °F]	
Pressure limitation		
NS 63 [2 ½"]	Steady	3/4 x full scale value
	Fluctuating	2/3 x full scale value
	Short time	Full scale value
NS 100 [4"], 160 [6"]	Steady	Full scale value
	Fluctuating	0.9 x full scale value
	Short time	1.3 x full scale value
Ingress protection per IEC/EN 60529	■ IP65 ■ IP66 (only selectable for scale ranges ≥ 0 ... 20 bar [0 ... 400 psi])	

Approvals

Logo	Description	Region
CE	**EU declaration of conformity** Pressure equipment directive PS > 200 bar, module A, pressure accessory	European Union
UKCA	**UKCA** Pressure equipment (safety) regulations	United Kingdom
-	**CRN** Safety (e.g. electr. safety, overpressure, ...) For full scale value ≤ 1,000 bar	Canada

Optional approvals

Logo	Description	Region
CE Ex	**EU declaration of conformity** ATEX directive Hazardous areas - Ex h Gas II 2G Ex h IIC T6 ... T1 Gb X Dust II 2D Ex h IIIC T85°C ... T450°C Db X	European Union
UKCA	**UKCA** Equipment and protective systems intended for use in potentially explosive atmospheres regulations	United Kingdom
EAC Ex	**EAC** Hazardous areas	Eurasian Economic Community
	Ex Ukraine Hazardous areas	Ukraine
	PAC Kazakhstan Metrology, measurement technology	Kazakhstan
-	**MChS** Permission for commissioning	Kazakhstan
-	**PAC Ukraine** Metrology, measurement technology	Ukraine
	PAC Uzbekistan Metrology, measurement technology	Uzbekistan
-	**PAC China** Metrology, measurement technology	China
	DNV Ships, shipbuilding (e.g. offshore)	International
-	**KBA** [1] Automotive	International
	Hydrogen-powered motor vehicles - (EC) no. 79/2009 and (EU) no. 406/2010	
	Components for motor vehicles using natural gas (CNG/LNG) – UN no. R 110	

1) Not available for all versions

Manufacturer's declaration

Logo	Description
-	Pressure equipment directive (PED) for maximum allowable pressure PS ≤ 200 bar
-	Suitability of wetted materials for drinking water in accordance with the European 4MS initiative
-	Suitability of wetted materials for hydrogen


Certificates (option)

Certificates	
Certificates	■ 2.2 test report per EN 10204 (e.g. state-of-the-art manufacturing, indication accuracy) ■ 3.1 inspection certificate per EN 10204 (e.g. material proof for wetted metal parts, indication accuracy) ■ PCA calibration certificate, traceable and accredited in accordance with ISO/IEC 17025 ■ Calibration certificate by a national accreditation body, traceable and accredited in accordance with ISO/IEC 17025 on request
Recommended calibration interval	1 year (dependent on conditions of use)

→ For approvals and certificates, see website

Dimensions in mm [in]

Lower mount (radial)

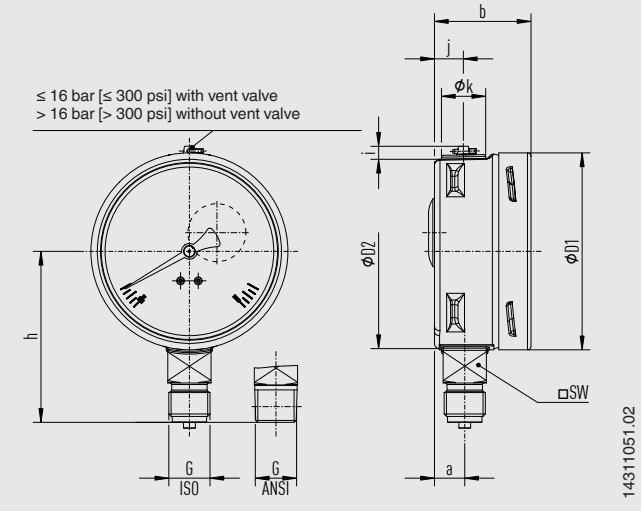

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]
100 [4"]	approx. 0.6 kg [1.32 lbs]	approx. 0.9 kg [1.98 lbs]
160 [6"]	approx. 1.1 kg [2.43 lbs]	approx. 2.0 kg [4.41 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	G ¼ B	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	51 [2.01]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	G ¼ B	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	87 [3.43]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	87 [3.43]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	G ¼ B	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	118 [4.65]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	118 [4.65]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ISO 7


NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	R ¼	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	R ¼	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	86 [3.39]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	R ¼	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	117 [4.60]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	¼ NPT	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	51 [2.01]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	¼ NPT	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	86 [3.39]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	¼ NPT	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	117 [4.60]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

1) Plus 16 mm [0.630 in] with scale range 0 ... 1,600 bar [0 ... 20,000 psi]

Lower back mount

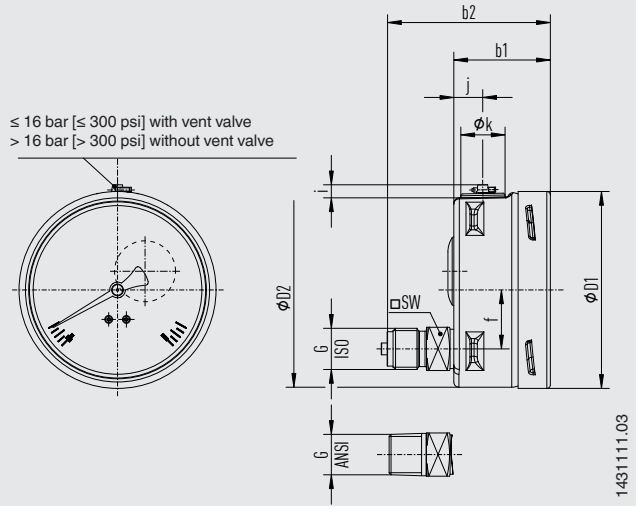

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]
100 [4"]	approx. 0.6 kg [1.32 lbs]	approx. 0.9 kg [1.98 lbs]
160 [6"]	approx. 1.1 kg [2.43 lbs]	approx. 2.0 kg [4.41 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	G ¼ B	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	33 [1.30]	54 [2.13]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	G ¼ B	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	49.5 [1.95]	83 [3.27]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	49.5 [1.95]	83 [3.27]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	G ¼ B	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	51.5 [2.03] 1)	85 [3.24] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	51.5 [2.03] 1)	85 [3.24] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ISO 7


NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	R ¼	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	R ¼	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	49.5 [1.95]	82 [3.23]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	R ¼	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	51.5 [2.03] 1)	84 [3.31] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	¼ NPT	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	50 [1.97]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	33 [1.30]	54 [2.13]	63 [2.48]	62 [2.44]	50 [1.97]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	¼ NPT	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	49.5 [1.95]	82 [3.23]	101 [3.98]	99 [3.90]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	¼ NPT	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	51.5 [2.03] 1)	84 [3.31] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

1) Plus 16 mm [0.630 in] with scale ranges ≥ 0 ... 100 bar [≥ 0 ... 1,500 psi]

NS 63 [2 ½"], centre back mount

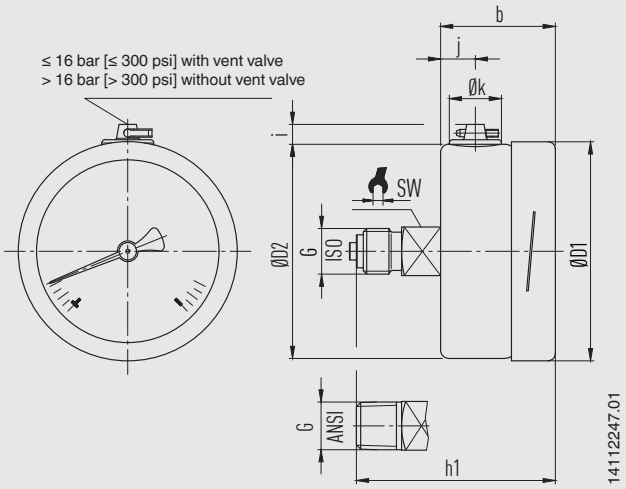

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	G ¼ B	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	54 [2.13]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]

Process connection with thread per ISO 7

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	R ¼	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]


Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	¼ NPT	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	54 [2.13]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]


Accessories

Dimensions in mm [in]

Panel mounting flange

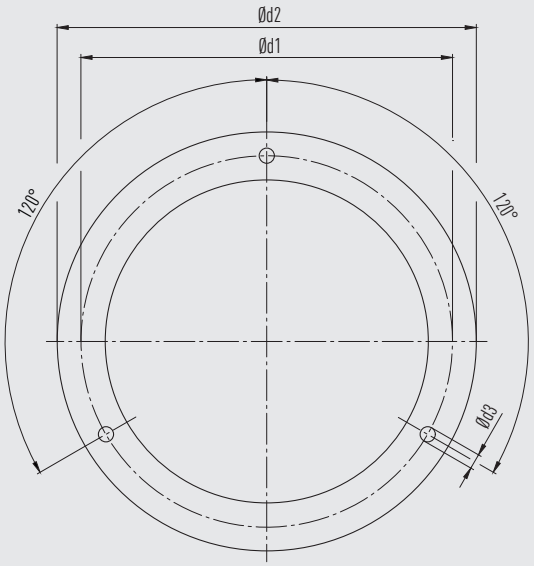


Surface mounting flange

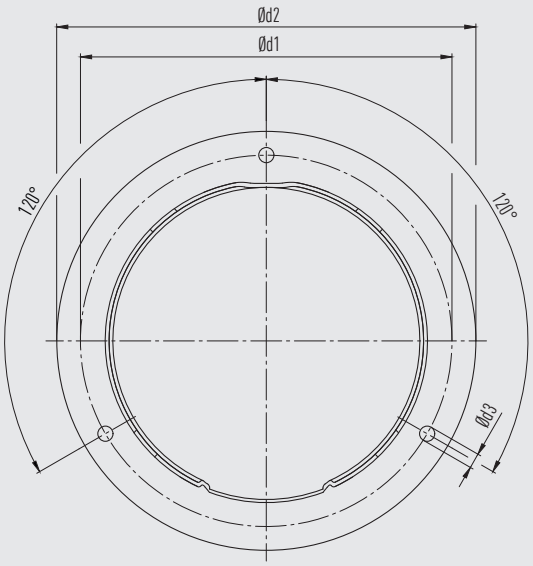


NS	Dimensions in mm [in]			
	Recommended panel cutout	d1	d2	d3
63 [2 ½"]	Ø 67 ±0.3 / Ø 2.6 [Ø 2.64 ±0.01 / Ø 0.10]	75 [2.95]	85 [3.35]	3.6 [0.14]
100 [4"]	Ø 104 ±0.5 / Ø 4.1 [Ø 4.04 ±0.02 / Ø 0.16]	117 [4.60]	132 [5.20]	4.8 [0.19]
160 [6"]	Ø 164 ±0.5 / Ø 6.5 [Ø 6.46 ±0.02 / Ø 0.26]	178 [7.01]	196 [7.72]	5.8 [0.23]

Triangular profile ring

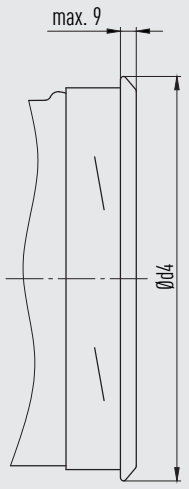

NS	Dimensions in mm [in]	
	Recommended panel cutout	d4
63 [2 ½"]	Ø 64.5 ±0.5 / Ø 2.5 [Ø 2.54 ±0.02 / Ø 0.01]	≤ 69 [2.72]
100 [4"]	Ø 102 ±1.0 / Ø 4.0 [Ø 4.02 ±0.04 / Ø 0.16]	≤ 108 [4.25]
160 [6"]	Ø 162.6 ±1.0 / Ø 6.4 [Ø 6.40 ±0.04 / Ø 0.25]	≤ 168 [6.61]

Accessories and spare parts

Model		Description
	**910.17**	Seals → See data sheet AC 09.08
	**910.15**	Syphons → See data sheet AC 09.06
	**910.13**	Overpressure protector → See data sheet AC 09.04
	**IV10, IV11**	Needle valve and multiport valve → See data sheet AC 09.22
	**IV20, IV21**	Block-and-bleed valve → See data sheet AC 09.19
	**IVM**	Monoflange, process and instrument version → See data sheet AC 09.17
	**BV**	Ball valve, process and instrument version → See data sheet AC 09.28
	**IBF2, IBF3**	Monoblock with flange connection → See data sheet AC 09.25

Ordering information

Model / Nominal size / Scale range / Process connection / Connection location / Options

© 02/1995 WIKA Alexander Wiegand SE & Co. KG, all rights reserved.
The specifications given in this document represent the state of engineering at the time of publishing.
We reserve the right to make modifications to the specifications and materials.
In case of a different interpretation of the translated and the English data sheet, the English wording shall prevail.

WIKA Alexander Wiegand SE & Co. KG
Alexander-Wiegand-Straße 30
63911 Klingenberg/Germany
Tel. +49 9372 132-0
info@wika.de
www.wika.de

EU-Konformitätserklärung
EU Declaration of Conformity

Dokument Nr. / ***Document No.*** **11564220** — **Revision** / ***Issue*** **07**

Wir erklären in alleiniger Verantwortung, dass die mit CE gekennzeichneten Produkte
We declare under our sole responsibility that the CE marked products

Typenbezeichnung / ***Type Designation***

23a.50.063 + option ATEX | **23a.50.1*0 + option ATEX**
26a.50.063 + option ATEX | **26a.50.1*0 + option ATEX**
23a.30.063 + option ATEX | **23a.30.1*0 + option ATEX**
26a.30.063 + option ATEX | **26a.30.1*0 + option ATEX**
23a.53.063 + option ATEX | **23a.53.100 + option ATEX**
23a.54.063 + option ATEX | **23a.54.100 + option ATEX**
23a.36.1*0 + option ATEX
PG23LT.063 + option ATEX | **PG23LT.1*0 + option ATEX**
PG23CP.063 + option ATEX | **PG23CP.100 + option ATEX**
PG28.1*0 + option ATEX
PG23HP-S.1*0 + option ATEX | **PG23HP-P.1*0 + option ATEX**

*** Nominal size**
0 = 100mm
6 = 160mm

a Case filling
2 = Without case filling
3 = With case filling

Beschreibung / ***Description***: **Rohrfederdruckmessgerät** / ***Bourdon Tube Pressure Gauge***

gemäß gültigem Datenblatt / *according to the valid data sheet*: PM 02.02, PM 02.04, PM 02.12, PM 02.15, PM 02.22, PM 02.24, PM 02.32, PM 02.28, PM 02.29

mit den nachfolgenden relevanten Harmonisierungsvorschriften der Union übereinstimmen
are in conformity with the following relevant Union harmonisation legislation

Angewandte harmonisierte Normen oder sonstige technische Spezifikationen:
Applied harmonised standards or other technical specifications:

2014/68/EU	Druckgeräterichtlinie (DGRL) (1) *Pressure Equipment Directive (PED)* (1)	
2014/34/EU	Explosionsschutz (ATEX) (2) *Explosion protection (ATEX)* (2)	
Ex	II 2G Ex h IIC T6 … T1 Gb X II 2D Ex h IIIC T85 °C … T450 °C Db X	EN ISO 80079-36 :2016 EN ISO 80079-37 :2016

(1) PS > 200 bar; Modul A, druckhaltendes Ausrüstungsteil
PS > 200 bar; Module A, pressure accessory

(2) Modul A „interne Fertigungskontrolle“. Die Dokumentation ist hinterlegt unter der Nummer 074/24 bei der Notifizierten Stelle der EU, IBExU Institut für Sicherheitstechnik GmbH (EU ID-Nr. 0637).
Module A “Internal Control of Production”. The Documentation is deposited under registration number 074/24 at Notified Body of EU, IBExU Institut für Sicherheitstechnik GmbH (EU ID 0637). .

Unterzeichnet für und im Namen von / *Signed for and on behalf of*

WIKA Alexander Wiegand SE & Co. KG

Klingenberg, 2024-04-24


Sascha Schnellbacher, Vice President
CoE Gauges, Sensors & Instruments

Mariusz Lubomski, Director of Quality
CoE Gauges, Sensors & Instruments


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

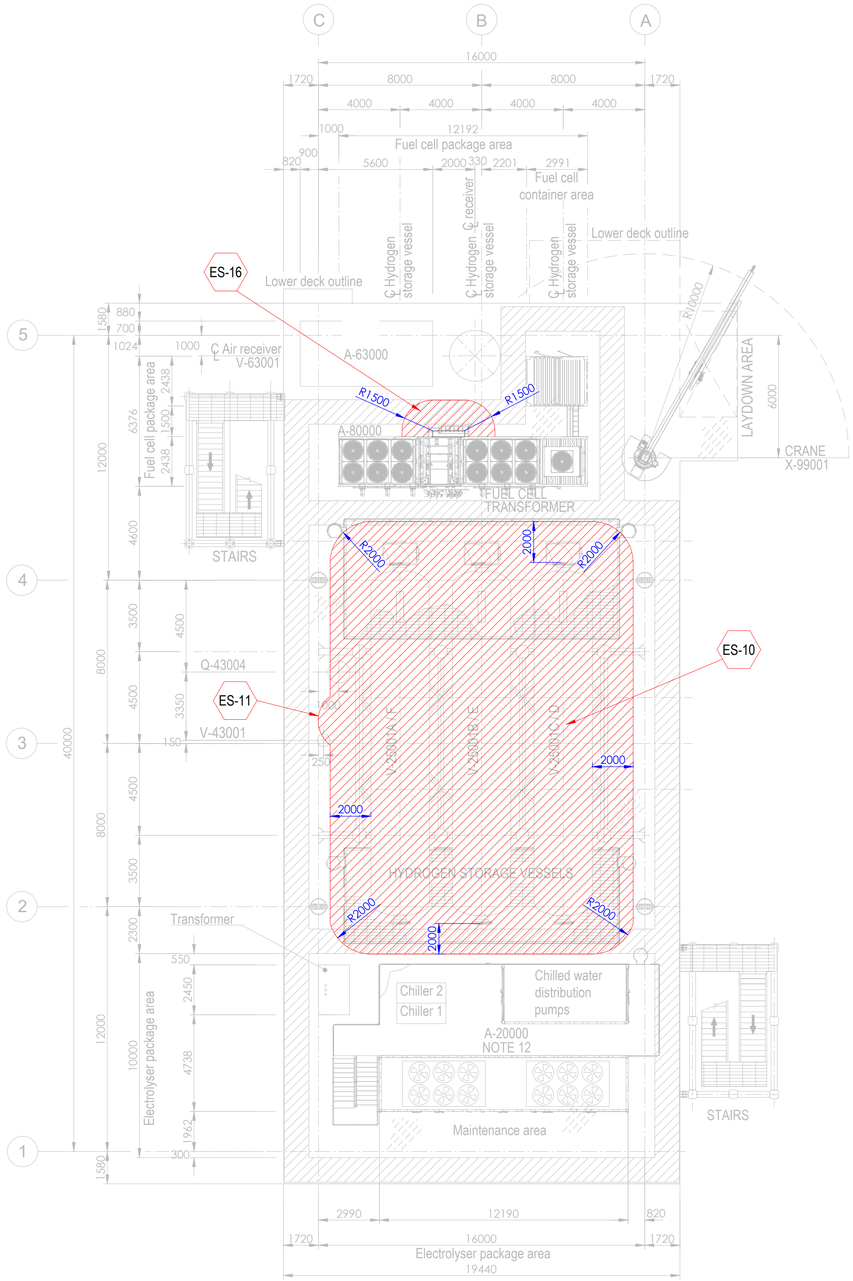


PLAN ON UPPER DECK
EL+30.310 T.O.S.

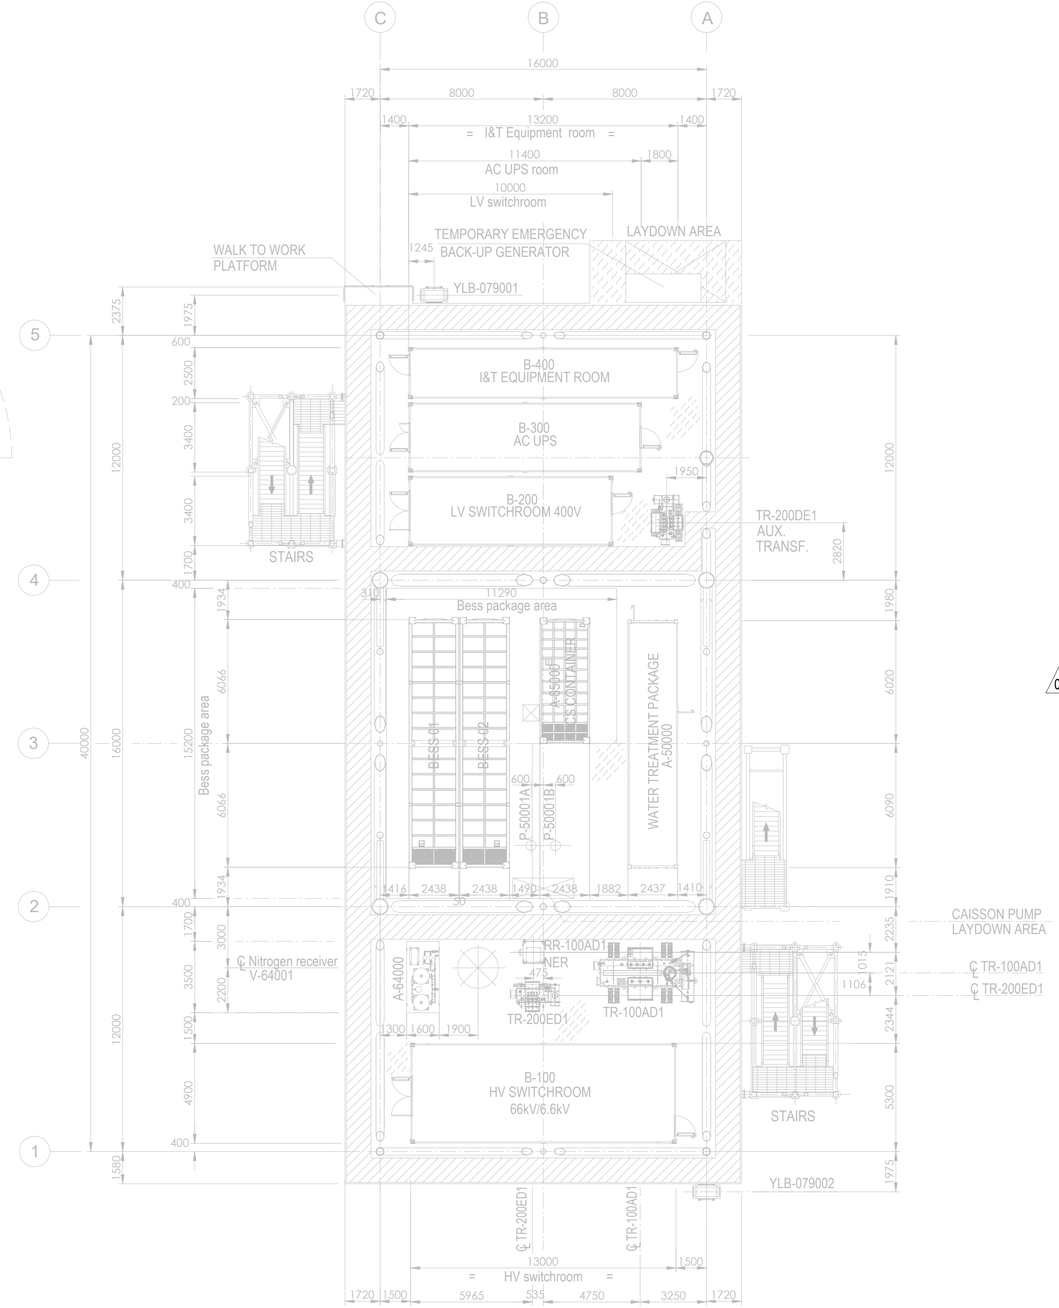

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

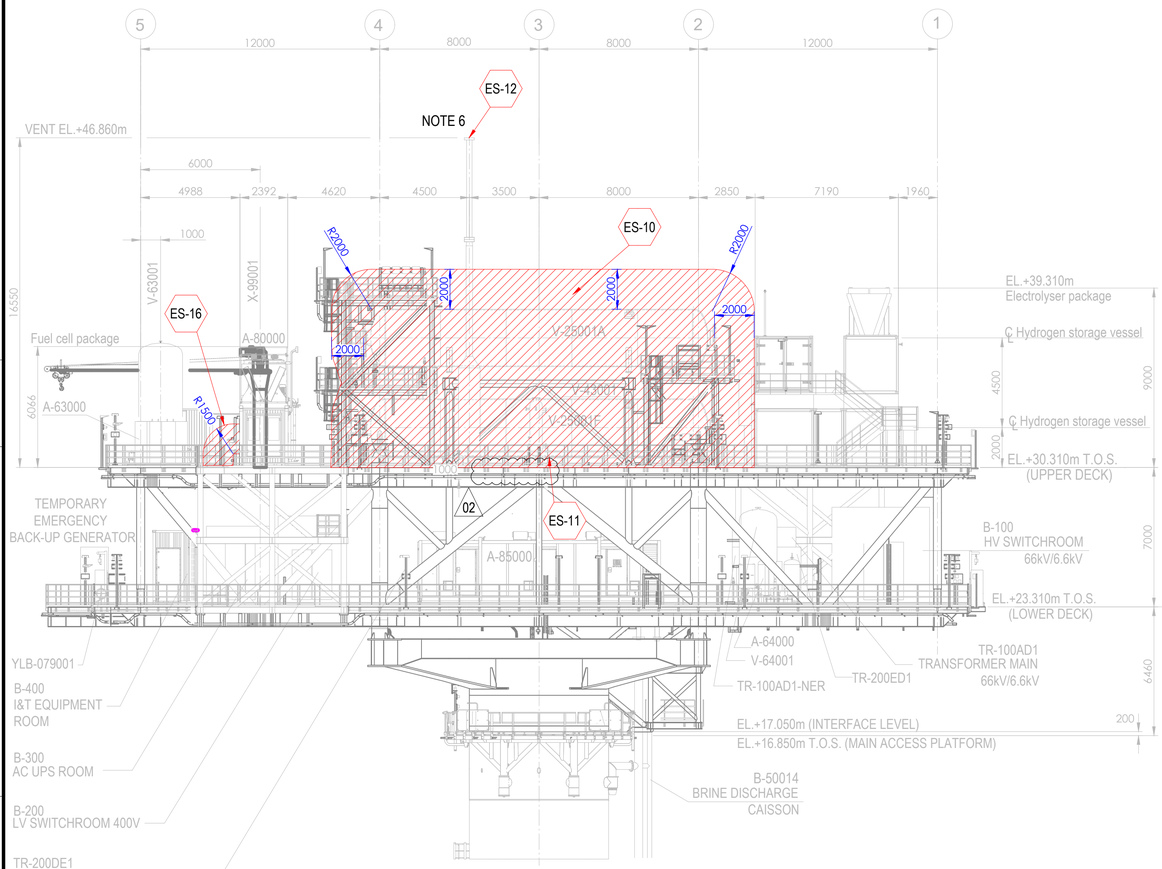



ELEVATION LOOKING EAST

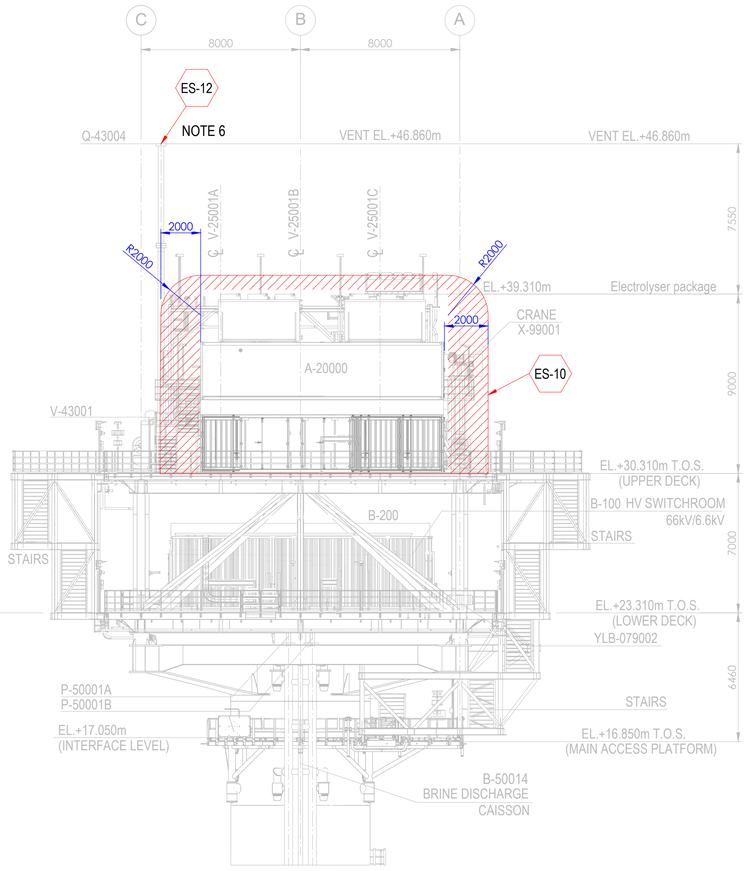

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

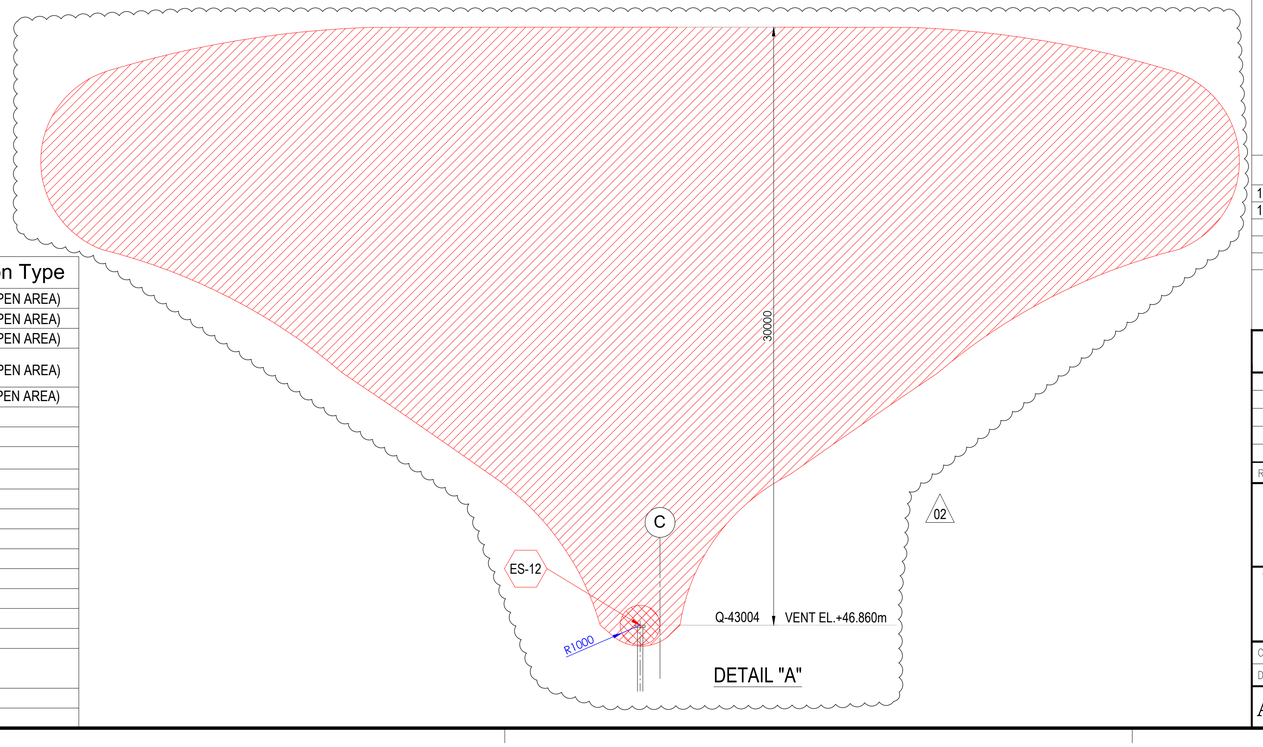



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PG -014	: Air Set Pressure Gauge Filter - Vessel V-25001D Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10004825	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		PW00DE25R3A			
Manufacturer	Wika			**Model**		233.50.63			
Cert No.	D.o.C. by Manufacturer reference 11564220			**Equipment Ambient Temp.**		-20 °C to +60 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP65

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PG -014	: Air Set Pressure Gauge Filter - Vessel V-25001D Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004825	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-PG -014	: Air Set Pressure Gauge Filter - Vessel V-25001D Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004825	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks					
67	All Terminals are Ex n certified (if required on certificate)	x	NA		
68	Hermetically sealed and enclosed break devices are undamaged	x	NA		
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA		
70	Test port, if fitted, is functional (type “nR” only)	x	NA		
71	Breathing operation is satisfactory (type “nR” only)	x	NA		
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA		
73	The ventilation airflow is not impeded	x	NA		
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA		
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA		
76	Variable voltage/frequency installation complies with documentation	x	NA		
Extra Ex p checks					
77	Pressurization gas is correct type	x	NA		
78	Actual pressure is within maximum and minimum settings for equipment	x	NA		
79	Timers set as per certification documentation	x	NA		
80	Alarms and trip functions operate correctly as per certification documentation	x	NA		
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA		
82	Automatic electrical protective devices operate within permitted limits	x	NA		
83	Automatic electrical protective devices are set correctly	x	NA		
84	Protective gas inlet temperature is below maximum specified	x	NA		
85	Ducts, pipes and enclosures are in good condition	x	NA		
86	Protective gas is substantially free from contaminants	x	NA		
87	Protective gas pressure and/or flow is adequate	x	NA		
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA		
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA		
90	Specific conditions of use (if applicable) are complied with		NA		
Extra Ex i (Intrinsically Safe – IS) checks					
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA		
92	Cables are installed in accordance with the documentation	x	NA		
93	Segregation is maintained between IS and non-IS Circuits	x	NA		
94	Cable screens are isolated at one end (field side)	x	NA		
95	Cable screens are earthed in accordance with the documentation	x	NA		
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA		
97	Equipment installed is the one specified in the documentation	x	NA		
98	Ambient temperature range of the apparatus is correct for the installation	x	NA		
99	Service temperature range of the apparatus is correct for the installation	x	NA		
100	Installation is clearly labelled	x	NA		
101	Printed circuit boards are clean and undamaged	x	NA		
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA		
103	Point-to-point connections are all correct	x	NA		
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA		
105	Earth connections maintain the integrity of the type of protection	x	NA		
106	Intrinsically safe circuit earthing is satisfactory	x	NA		
107	Insulation resistance is satisfactory	x	NA		
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA		

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA

Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	VENDOR ROTORK (PER FLUITEK)	RM (ROSETTI MARINO)	
Name	Stefano Linari	Giovanni Tangianu	
Date	2025-04-24	2025-04-24	
Signature	Digitaly signed by Stefano Linari 2025-04-24T13:21:50.688Z	Digitaly signed by Giovanni Tangianu 2025-04-24T15:18:33.535Z	

ROTORK CONTROLS ITALIA srl
Via Portico 17
24050 Orio Al Serio (BG)

Telefono: 0039 (0)5832221

E-mail: rotork.italia@rotork.com



WIKA Product Pass Italiano

serial number

WIKA

25-xv-014

Type 23X.50

Manometro a molla tubolare 232.50/233.50
Cassa in acciaio inox

Serial number:

PW00DE25R3A

Item number:

57424821

Manufacturing date:

04/2025



ITEM	Tag	25-PG -014	: Air Set Pressure Gauge Filter - Vessel V-25001D Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10004825	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**	8975GNEQ				
Manufacturer	Wika			**Model**	233.50.63				
Cert No.	D.o.C. by Manufacturer, reference 11564220			**Equipment Ambient Temp.**	-20 °C to +60 °C				
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP65

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PG -014	: Air Set Pressure Gauge Filter - Vessel V-25001D Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004825	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-PG -014	: Air Set Pressure Gauge Filter - Vessel V-25001D Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004825	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks					
67	All Terminals are Ex n certified (if required on certificate)	x	NA		
68	Hermetically sealed and enclosed break devices are undamaged	x	NA		
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA		
70	Test port, if fitted, is functional (type “nR” only)	x	NA		
71	Breathing operation is satisfactory (type “nR” only)	x	NA		
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA		
73	The ventilation airflow is not impeded	x	NA		
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA		
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA		
76	Variable voltage/frequency installation complies with documentation	x	NA		
Extra Ex p checks					
77	Pressurization gas is correct type	x	NA		
78	Actual pressure is within maximum and minimum settings for equipment	x	NA		
79	Timers set as per certification documentation	x	NA		
80	Alarms and trip functions operate correctly as per certification documentation	x	NA		
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA		
82	Automatic electrical protective devices operate within permitted limits	x	NA		
83	Automatic electrical protective devices are set correctly	x	NA		
84	Protective gas inlet temperature is below maximum specified	x	NA		
85	Ducts, pipes and enclosures are in good condition	x	NA		
86	Protective gas is substantially free from contaminants	x	NA		
87	Protective gas pressure and/or flow is adequate	x	NA		
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA		
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA		
90	Specific conditions of use (if applicable) are complied with		NA		
Extra Ex i (Intrinsically Safe – IS) checks					
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA		
92	Cables are installed in accordance with the documentation	x	NA		
93	Segregation is maintained between IS and non-IS Circuits	x	NA		
94	Cable screens are isolated at one end (field side)	x	NA		
95	Cable screens are earthed in accordance with the documentation	x	NA		
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA		
97	Equipment installed is the one specified in the documentation	x	NA		
98	Ambient temperature range of the apparatus is correct for the installation	x	NA		
99	Service temperature range of the apparatus is correct for the installation	x	NA		
100	Installation is clearly labelled	x	NA		
101	Printed circuit boards are clean and undamaged	x	NA		
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA		
103	Point-to-point connections are all correct	x	NA		
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA		
105	Earth connections maintain the integrity of the type of protection	x	NA		
106	Intrinsically safe circuit earthing is satisfactory	x	NA		
107	Insulation resistance is satisfactory	x	NA		
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA		

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-31	2025-02-01	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-31T09:38:24.883Z	PROVERLIS Digitaly signed by Luca Mussi 2025-02-01T12:04:58.185Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

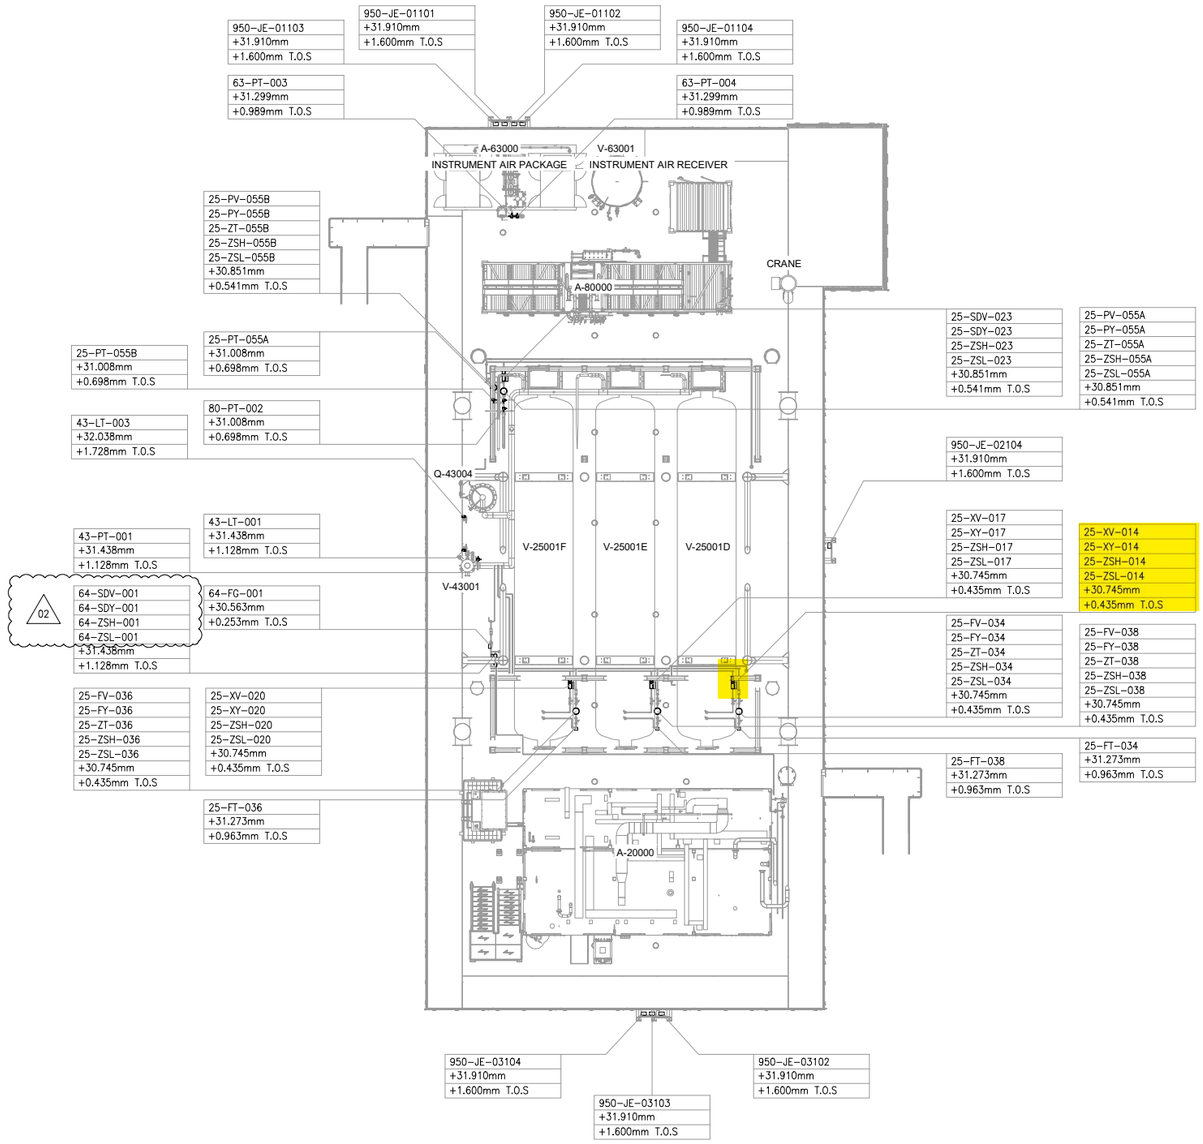


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm



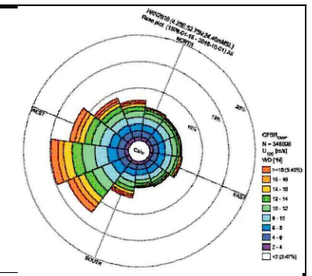

NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001_D

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

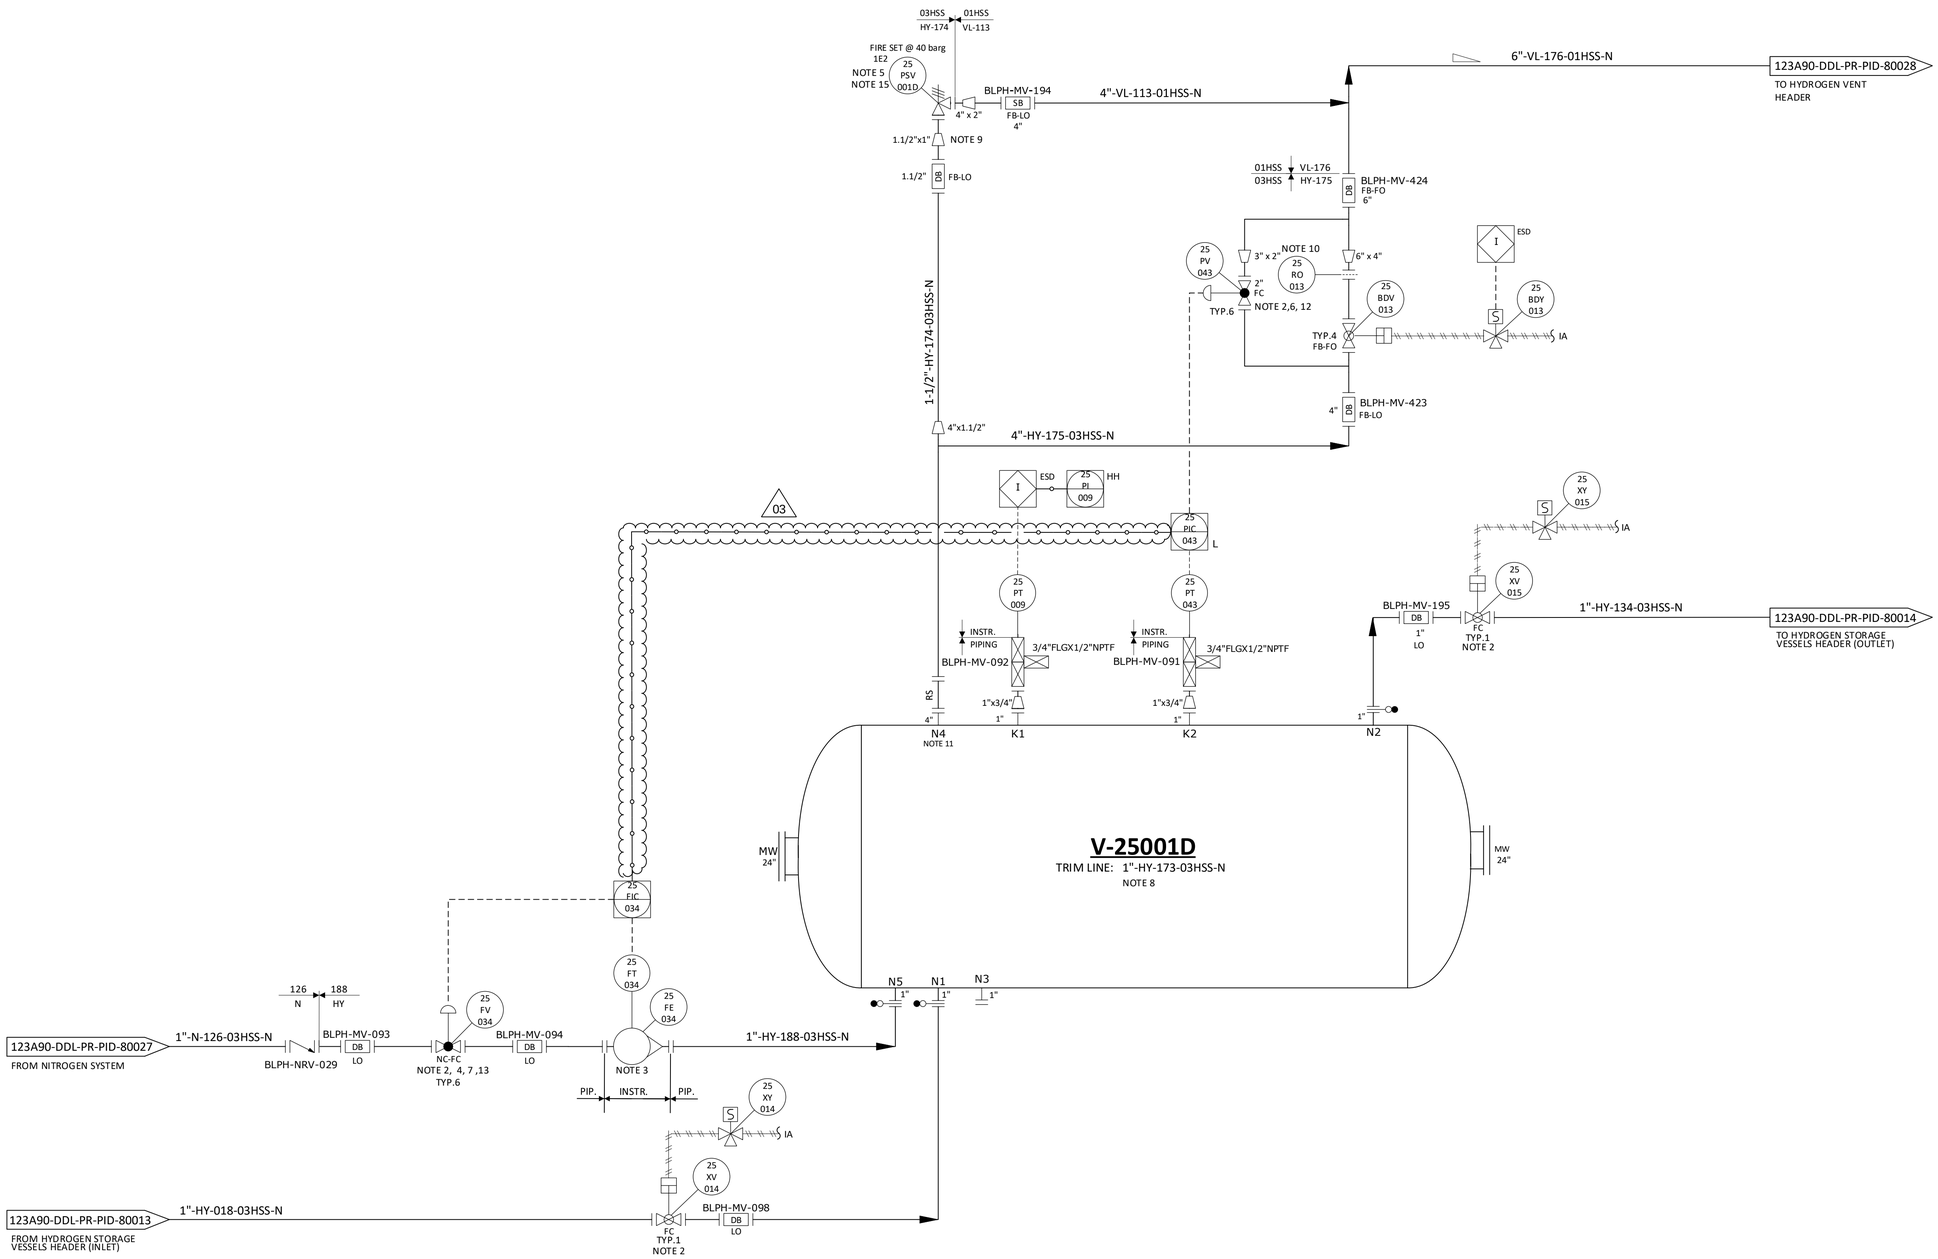

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS. 03
4. NITROGEN CONTROL VALVE (25-FV-034) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE.
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-043 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-043 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-034 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-043 HAS FAILED TO CLOSE.
15. 25-PSV-001D SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL D


CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO. 123A90-DDL-PR-PID-80018	SHEET 001	REV. 03

File Name : FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

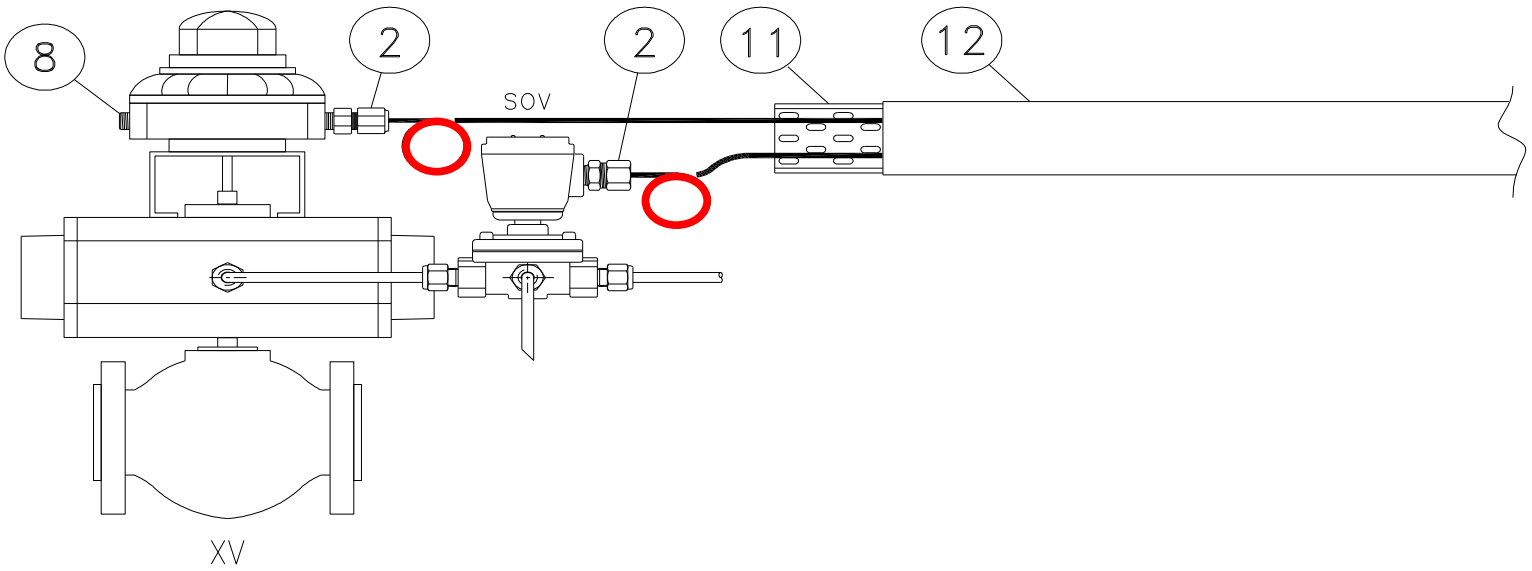

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

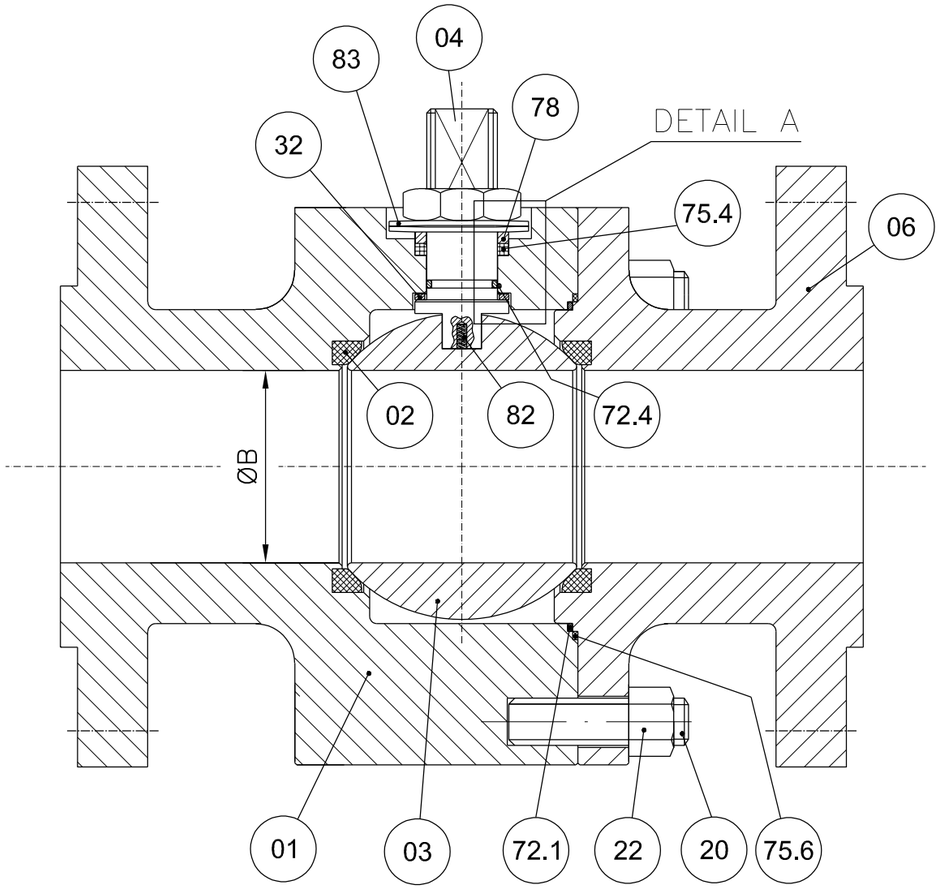




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024
CHK'D: D.Barcella	DATE: 26/02/2024
APPV'D: L.Mora	DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: D240062-08

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-014		25
	2	Service				HYDROGEN STORAGE TANK V-25001D INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80018		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-018-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-014 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-014 (9, 17) - Soldo SS		25-ZSH-014 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

94	IFR	25-XV-009	floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR	25-XV-011	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR	25-XV-012	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR	25-XV-014	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR	25-XV-015	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR	25-XV-017	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR	25-XV-018	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

Bourdon tube pressure gauge, stainless steel
For the process industry, standard version
Models 232.50, 233.50, NS 63 [2 ½"], 100 [4"] and 160 [6"]

For further approvals, see page 6

Applications

- For gaseous and liquid aggressive media that are not highly viscous or crystallising, also in aggressive environments
- Chemical and petrochemical industries, oil and gas industry, power engineering and also water and wastewater technology
- Machine building and general plant construction

Special features

- Excellent load cycle stability and shock resistance
- With case filling (model 233.50) for applications with high dynamic pressure loads and vibrations
- Completely from stainless steel
- Scale ranges from 0 … 0.6 to 0 … 1,600 bar or 0 ... 10 to 0 ... 20,000 psi
- QR code on dial links to instrument-specific information



Bourdon tube pressure gauge, model 232.50, NS 100 [4"]

Description

This high-quality Bourdon tube pressure gauge has been designed especially for the process industry.

The use of high-quality stainless steel materials and the robust design are geared to applications in the chemical and process engineering industries. Thus the instrument is suitable for liquid and gaseous media, also in aggressive environments.

Scale ranges of 0 … 0.6 to 0 … 1,600 bar [0 ... 10 to 0 ... 20,000 psi] ensure the measuring ranges required for a wide variety of applications.

WIKA manufactures and qualifies the pressure gauge in accordance with the standards EN 837-1 and ASME B40.100. As a safety function, this instrument has a blow-out device with blow-out plug on the back of the case. In the event of a failure, overpressure can escape there.

The model 233.50 with liquid-filled case is suitable for high dynamic pressure loads and vibrations.

The QR code on the dial allows instrument-specific information such as the serial number, the order number, certificates and other product data to be retrieved from the internet easily and in the long term.

Smart in sensing

Data sheets showing similar products:
Stainless steel, safety version; see data sheet PM 02.04
Bourdon tube pressure gauge with switch contacts; see data sheet PV 22.02
Monel version; see data sheet PM 02.33
Pressure gauge per EN 837-1 with mounted diaphragm seal; see data sheet DS 95.12

Specifications

Basic information	
Standard	■ EN 837-1 ■ ASME B40.100
	For information on the “Selection, installation, handling and operation of pressure gauges”, see technical information IN 00.05.
Further version	■ Oil- and grease-free for oxygen ■ Per NACE [1] MR0175 / ISO 15156, use in H_2S-containing environments in oil and gas production ■ With pre-volume deflagration flame arrester [2] for mounting to zone 0 (EPL Ga); model 910.21; see data sheet AC 91.02 ■ Monel version; models 262 and 263; see data sheet PM 02.33
Nominal size (NS)	■ Ø 63 mm [2 ½"] ■ Ø 100 mm [4"] ■ Ø 160 mm [6"]
Connection location	■ Lower mount (radial) ■ Lower back mount ■ Centre back mount (only for NS 63 [2 ½"])
Window	Laminated safety glass (NS 63 [2 ½"]: Polycarbonate)
Case	
Design	Safety level “S1” per EN 837-1 With blow-out device at case circumference, 12 o'clock (NS 63 [2 ½"]) and on the back of the case (NS 100 [4"] and 160 [6"]) Scale ranges ≤ 0 ... 16 bar [≤ 0 ... 300 psi] with compensating valve to vent and reseal case
Material	■ Stainless steel 1.4301 (304) ■ Stainless steel 1.4571 (316Ti)
Ring	Bayonet ring, stainless steel
Mounting	■ Without ■ Panel mounting flange, stainless steel ■ Panel mounting flange, polished stainless steel ■ Triangular profile ring with mounting bracket, polished stainless steel ■ Surface mounting flange, stainless steel
Case filling (model 233.50)	■ Without ■ Glycerine ■ Glycerine-water mixture for NS 100 [4"] and 160 [6"] with scale range ≤ 0 ... 2.5 bar [≤ 0 ... 40 psi] or for NS 63 [2 ½"] with scale range ≤ 0 ... 4 bar [≤ 0 ... 60 psi] ■ Silicone oil
Movement	■ Stainless steel ■ Stainless steel 1.4404 (316L) ■ everlast® version

1) General information about NACE standards; see data sheet IN 00.21
2) Only for instruments with Ex approval

Measuring element	
Type of measuring element	Bourdon tube, C-type or helical type
Material	Stainless steel 1.4404 (316L)
Leak tightness	■ Helium tested, leakage rate: $< 5 \cdot 10^{-3}$ mbar l/s ■ Helium tested, leakage rate: $< 1 \cdot 10^{-6}$ mbar l/s

Accuracy specifications		
Accuracy class		
NS 63 [2 ½"]	■ EN 837-1	Class 1.6
	■ ASME B40.100	±2 % | ±1 % | ±2 % of measuring span (grade A)
NS 100 [4"], 160 [6"]	■ EN 837-1	Class 1.0
	■ ASME B40.100	±1 % of measuring span (grade 1A)
Temperature error	On deviation from the reference conditions at the measuring system: ≤ ±0.4 % per 10 °C [≤ ±0.4 % per 18 °F] of full scale value	
Reference conditions		
Ambient temperature	+20 °C [+68 °F]	

Scale ranges

bar	
0 ... 0.6 [1]	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160
0 ... 4	0 ... 250
0 ... 6	0 ... 400
0 ... 10	0 ... 600
0 ... 16	0 ... 1,000
0 ... 25	0 ... 1,600

kg/cm²	
0 ... 0.6 [1]	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160
0 ... 4	0 ... 250
0 ... 6	0 ... 400
0 ... 10	0 ... 600
0 ... 16	0 ... 1,000
0 ... 25	0 ... 1,600

kPa	
0 ... 60 [1]	0 ... 4,000
0 ... 100	0 ... 6,000
0 ... 160	0 ... 10,000
0 ... 250	0 ... 16,000
0 ... 400	0 ... 25,000
0 ... 600	0 ... 40,000
0 ... 1,000	0 ... 60,000
0 ... 1,600	0 ... 100,000
0 ... 2,500	0 ... 160,000

MPa	
0 ... 0.06 [1]	0 ... 4
0 ... 0.1	0 ... 6
0 ... 0.16	0 ... 10
0 ... 0.25	0 ... 16
0 ... 0.4	0 ... 25
0 ... 0.6	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160

psi	
0 ... 10 [1]	0 ... 1,000
0 ... 15	0 ... 1,500
0 ... 30	0 ... 2,000
0 ... 60	0 ... 3,000
0 ... 100	0 ... 4,000
0 ... 160	0 ... 5,000
0 ... 200	0 ... 6,000
0 ... 300	0 ... 7,500
0 ... 400	0 ... 10,000
0 ... 600	0 ... 15,000
0 ... 800	0 ... 20,000

1) Not available for NS 63 [2 ½"]

Vacuum and +/- scale ranges

bar	
-0.6 ... 0 [1]	-1 ... +5
-1 ... 0	-1 ... +9
-1 ... +0.6	-1 ... +15
-1 ... +1.5	-1 ... +24
-1 ... +3	

MPa	
-0.06 ... 0 [1]	-0.1 ... +0.5
-0.1 ... 0	-0.1 ... +0.9
-0.1 ... +0.06	-0.1 ... +1.5
-0.1 ... +0.15	-0.1 ... +2.4
-0.1 ... +0.3	

kPa	
-60 ... 0 [1]	-100 ... +500
-100 ... 0	-100 ... +900
-100 ... +60	-100 ... +1,500
-100 ... +150	-100 ... +2,400
-100 ... +300	

psi	
-30 inHg ... 0	-30 inHg ... +100
-30 inHg ... +15	-30 inHg ... +160
-30 inHg ... +30	-30 inHg ... +200
-30 inHg ... +60	-30 inHg ... +300

1) Not available for NS 63 [2 ½"]

Further details on: scale ranges	
Special scale ranges	Other scale ranges on request
Unit	■ bar ■ psi ■ kg/cm² ■ kPa ■ MPa
Increased overload safety	■ Without ■ 2 times ■ 3 times ■ 4 times ■ 5 times
	The possibility of selection depends on scale range and nominal size
Vacuum resistance	■ Without ■ Vacuum-resistant to -1 bar
Dial	
Scale colour	Black
Material	Aluminium
Special scale	■ Without ■ With temperature scale for refrigerant, e.g. for NH_3: R 717
	Other scales or customer-specific dials, e.g. with red mark, circular arcs or circular sectors, on request
Pointer	
Instrument pointer	Aluminium, black
Mark pointer/drag pointer	■ Without ■ Red mark pointer on dial, fixed ■ Red mark pointer on window, adjustable ■ Mark pointer on bayonet ring, adjustable ■ Red drag pointer on window, adjustable
Pointer stop pin	■ Without ■ At zero point (only for NS 63 [2 ½"]) ■ At 6 o'clock (only for NS 100 [4"], 160 [6"])

Process connection		
Standard	■ EN 837-1 ■ ISO 7 ■ ANSI/B1.20.1	
Size		
EN 837-1	■ G ⅛ B, male thread ■ G ¼ B, male thread ■ G ½ B, male thread ■ M12 x 1.5, male thread ■ M20 x 1.5, male thread	
ISO 7	■ R ¼, male thread ■ R ½, male thread	
ANSI/B1.20.1	■ ¼ NPT, male thread ■ ½ NPT, male thread	
Restrictor	■ Without ■ Ø 0.6 mm [0.024"], stainless steel ■ Ø 0.3 mm [0.012"], stainless steel	
Material (wetted)		
Process connection	Stainless steel 1.4404 (316L)	
Bourdon tube	Stainless steel 1.4404 (316L)	

→ Other process connections on request

Operating conditions		
Medium temperature		
Unfilled instruments	-40 ... +200 °C [-40 ... +392 °F]	
Instruments with glycerine filling	-20 ... +100 °C [-4 ... +212 °F]	
Instruments with silicone oil filling	-40 ... +100 °C [-40 ... +212 °F]	
Ambient temperature		
Unfilled instruments or with silicone oil filling	-40 ... +60 °C [-40 ... +140 °F]	
Instruments with glycerine filling	-20 ... +60 °C [-4 ... +140 °F]	
Pressure limitation		
NS 63 [2 ½"]	Steady	3/4 x full scale value
	Fluctuating	2/3 x full scale value
	Short time	Full scale value
NS 100 [4"], 160 [6"]	Steady	Full scale value
	Fluctuating	0.9 x full scale value
	Short time	1.3 x full scale value
Ingress protection per IEC/EN 60529	■ IP65 ■ IP66 (only selectable for scale ranges ≥ 0 ... 20 bar [0 ... 400 psi])	

Approvals

Logo	Description	Region
CE	**EU declaration of conformity** Pressure equipment directive PS > 200 bar, module A, pressure accessory	European Union
UKCA	**UKCA** Pressure equipment (safety) regulations	United Kingdom
-	**CRN** Safety (e.g. electr. safety, overpressure, ...) For full scale value ≤ 1,000 bar	Canada

Optional approvals

Logo	Description	Region
CE Ex	**EU declaration of conformity** ATEX directive Hazardous areas - Ex h Gas II 2G Ex h IIC T6 ... T1 Gb X Dust II 2D Ex h IIIC T85°C ... T450°C Db X	European Union
UKCA	**UKCA** Equipment and protective systems intended for use in potentially explosive atmospheres regulations	United Kingdom
EAC Ex	**EAC** Hazardous areas	Eurasian Economic Community
	Ex Ukraine Hazardous areas	Ukraine
	PAC Kazakhstan Metrology, measurement technology	Kazakhstan
-	**MChS** Permission for commissioning	Kazakhstan
-	**PAC Ukraine** Metrology, measurement technology	Ukraine
	PAC Uzbekistan Metrology, measurement technology	Uzbekistan
-	**PAC China** Metrology, measurement technology	China
	DNV Ships, shipbuilding (e.g. offshore)	International
-	**KBA** [1] Automotive	International
	Hydrogen-powered motor vehicles - (EC) no. 79/2009 and (EU) no. 406/2010	
	Components for motor vehicles using natural gas (CNG/LNG) – UN no. R 110	

1) Not available for all versions

Manufacturer's declaration

Logo	Description
-	Pressure equipment directive (PED) for maximum allowable pressure PS ≤ 200 bar
-	Suitability of wetted materials for drinking water in accordance with the European 4MS initiative
-	Suitability of wetted materials for hydrogen


Certificates (option)

Certificates	
Certificates	■ 2.2 test report per EN 10204 (e.g. state-of-the-art manufacturing, indication accuracy) ■ 3.1 inspection certificate per EN 10204 (e.g. material proof for wetted metal parts, indication accuracy) ■ PCA calibration certificate, traceable and accredited in accordance with ISO/IEC 17025 ■ Calibration certificate by a national accreditation body, traceable and accredited in accordance with ISO/IEC 17025 on request
Recommended calibration interval	1 year (dependent on conditions of use)

→ For approvals and certificates, see website

Dimensions in mm [in]

Lower mount (radial)

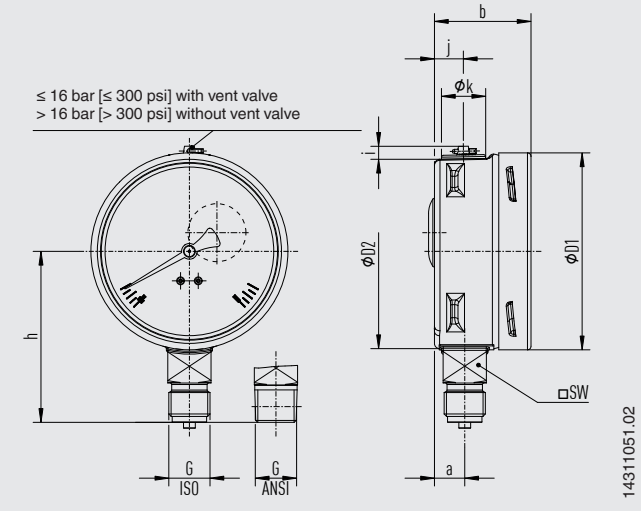

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]
100 [4"]	approx. 0.6 kg [1.32 lbs]	approx. 0.9 kg [1.98 lbs]
160 [6"]	approx. 1.1 kg [2.43 lbs]	approx. 2.0 kg [4.41 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	G ¼ B	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	51 [2.01]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	G ¼ B	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	87 [3.43]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	87 [3.43]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	G ¼ B	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	118 [4.65]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	118 [4.65]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ISO 7


NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	R ¼	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	R ¼	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	86 [3.39]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	R ¼	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	117 [4.60]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	¼ NPT	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	51 [2.01]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	¼ NPT	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	86 [3.39]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	¼ NPT	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	117 [4.60]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

1) Plus 16 mm [0.630 in] with scale range 0 ... 1,600 bar [0 ... 20,000 psi]

Lower back mount

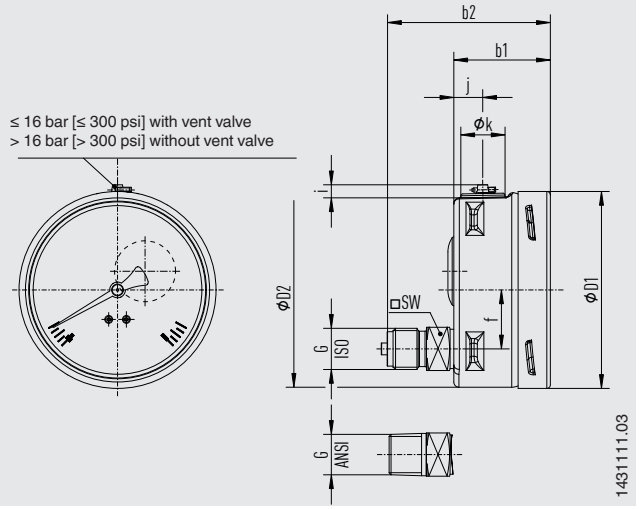

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]
100 [4"]	approx. 0.6 kg [1.32 lbs]	approx. 0.9 kg [1.98 lbs]
160 [6"]	approx. 1.1 kg [2.43 lbs]	approx. 2.0 kg [4.41 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	G ¼ B	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	33 [1.30]	54 [2.13]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	G ¼ B	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	49.5 [1.95]	83 [3.27]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	49.5 [1.95]	83 [3.27]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	G ¼ B	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	51.5 [2.03] 1)	85 [3.24] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	51.5 [2.03] 1)	85 [3.24] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ISO 7


NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	R ¼	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	R ¼	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	49.5 [1.95]	82 [3.23]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	R ¼	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	51.5 [2.03] 1)	84 [3.31] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	¼ NPT	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	50 [1.97]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	33 [1.30]	54 [2.13]	63 [2.48]	62 [2.44]	50 [1.97]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	¼ NPT	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	49.5 [1.95]	82 [3.23]	101 [3.98]	99 [3.90]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	¼ NPT	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	51.5 [2.03] 1)	84 [3.31] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

1) Plus 16 mm [0.630 in] with scale ranges ≥ 0 ... 100 bar [≥ 0 ... 1,500 psi]

NS 63 [2 ½"], centre back mount

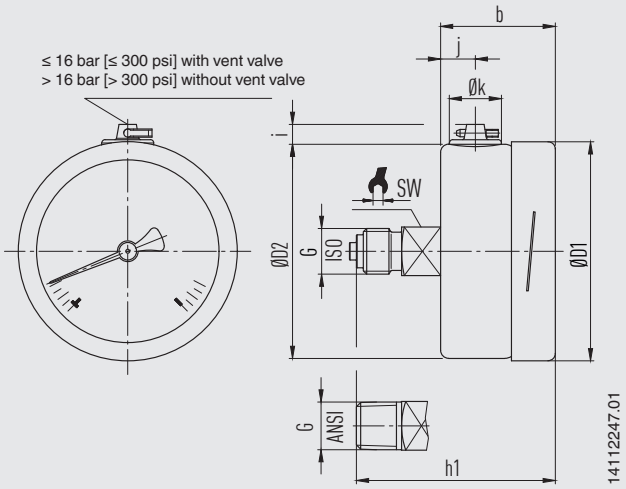

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	G ¼ B	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	54 [2.13]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]

Process connection with thread per ISO 7

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	R ¼	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]


Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	¼ NPT	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	54 [2.13]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]


Accessories

Dimensions in mm [in]

Panel mounting flange

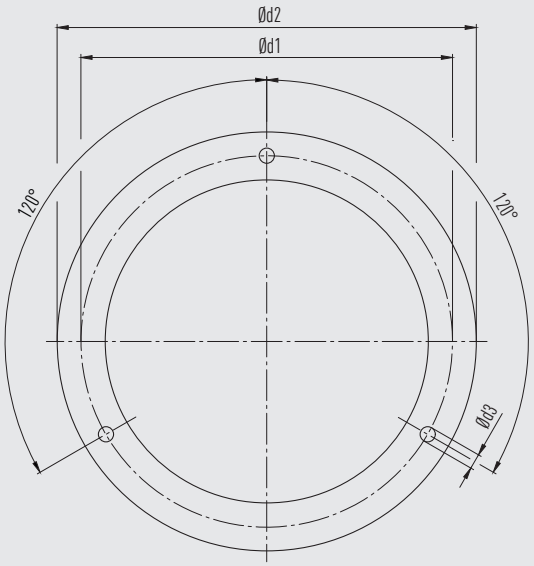


Surface mounting flange

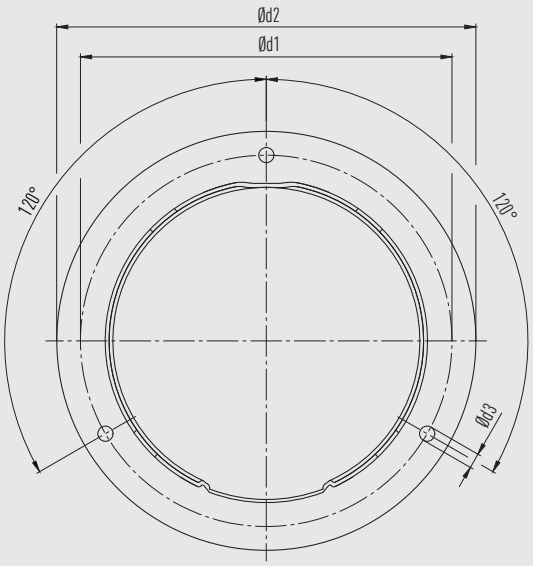


NS	Dimensions in mm [in]			
	Recommended panel cutout	d1	d2	d3
63 [2 ½"]	Ø 67 ±0.3 / Ø 2.6 [Ø 2.64 ±0.01 / Ø 0.10]	75 [2.95]	85 [3.35]	3.6 [0.14]
100 [4"]	Ø 104 ±0.5 / Ø 4.1 [Ø 4.04 ±0.02 / Ø 0.16]	117 [4.60]	132 [5.20]	4.8 [0.19]
160 [6"]	Ø 164 ±0.5 / Ø 6.5 [Ø 6.46 ±0.02 / Ø 0.26]	178 [7.01]	196 [7.72]	5.8 [0.23]

Triangular profile ring

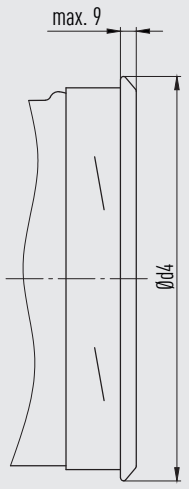

NS	Dimensions in mm [in]	
	Recommended panel cutout	d4
63 [2 ½"]	Ø 64.5 ±0.5 / Ø 2.5 [Ø 2.54 ±0.02 / Ø 0.01]	≤ 69 [2.72]
100 [4"]	Ø 102 ±1.0 / Ø 4.0 [Ø 4.02 ±0.04 / Ø 0.16]	≤ 108 [4.25]
160 [6"]	Ø 162.6 ±1.0 / Ø 6.4 [Ø 6.40 ±0.04 / Ø 0.25]	≤ 168 [6.61]

Accessories and spare parts

Model		Description
	**910.17**	Seals → See data sheet AC 09.08
	**910.15**	Syphons → See data sheet AC 09.06
	**910.13**	Overpressure protector → See data sheet AC 09.04
	**IV10, IV11**	Needle valve and multiport valve → See data sheet AC 09.22
	**IV20, IV21**	Block-and-bleed valve → See data sheet AC 09.19
	**IVM**	Monoflange, process and instrument version → See data sheet AC 09.17
	**BV**	Ball valve, process and instrument version → See data sheet AC 09.28
	**IBF2, IBF3**	Monoblock with flange connection → See data sheet AC 09.25

Ordering information

Model / Nominal size / Scale range / Process connection / Connection location / Options

© 02/1995 WIKA Alexander Wiegand SE & Co. KG, all rights reserved.
The specifications given in this document represent the state of engineering at the time of publishing.
We reserve the right to make modifications to the specifications and materials.
In case of a different interpretation of the translated and the English data sheet, the English wording shall prevail.

WIKA Alexander Wiegand SE & Co. KG
Alexander-Wiegand-Straße 30
63911 Klingenberg/Germany
Tel. +49 9372 132-0
info@wika.de
www.wika.de

EU-Konformitätserklärung
EU Declaration of Conformity

Dokument Nr. / ***Document No.*** **11564220** — **Revision** / ***Issue*** **07**

Wir erklären in alleiniger Verantwortung, dass die mit CE gekennzeichneten Produkte
We declare under our sole responsibility that the CE marked products

Typenbezeichnung / ***Type Designation***

23a.50.063 + option ATEX | **23a.50.1*0 + option ATEX**
26a.50.063 + option ATEX | **26a.50.1*0 + option ATEX**
23a.30.063 + option ATEX | **23a.30.1*0 + option ATEX**
26a.30.063 + option ATEX | **26a.30.1*0 + option ATEX**
23a.53.063 + option ATEX | **23a.53.100 + option ATEX**
23a.54.063 + option ATEX | **23a.54.100 + option ATEX**
23a.36.1*0 + option ATEX
PG23LT.063 + option ATEX | **PG23LT.1*0 + option ATEX**
PG23CP.063 + option ATEX | **PG23CP.100 + option ATEX**
PG28.1*0 + option ATEX
PG23HP-S.1*0 + option ATEX | **PG23HP-P.1*0 + option ATEX**

*** Nominal size**
0 = 100mm
6 = 160mm

a Case filling
2 = Without case filling
3 = With case filling

Beschreibung / ***Description***: **Rohrfederdruckmessgerät** / ***Bourdon Tube Pressure Gauge***

gemäß gültigem Datenblatt / *according to the valid data sheet*: PM 02.02, PM 02.04, PM 02.12, PM 02.15, PM 02.22, PM 02.24, PM 02.32, PM 02.28, PM 02.29

mit den nachfolgenden relevanten Harmonisierungsvorschriften der Union übereinstimmen
are in conformity with the following relevant Union harmonisation legislation

Angewandte harmonisierte Normen oder sonstige technische Spezifikationen:
Applied harmonised standards or other technical specifications:

2014/68/EU	Druckgeräterichtlinie (DGRL) (1) *Pressure Equipment Directive (PED)* (1)	
2014/34/EU	Explosionsschutz (ATEX) (2) *Explosion protection (ATEX)* (2)	
Ex	II 2G Ex h IIC T6 … T1 Gb X II 2D Ex h IIIC T85 °C … T450 °C Db X	EN ISO 80079-36 :2016 EN ISO 80079-37 :2016

(1) PS > 200 bar; Modul A, druckhaltendes Ausrüstungsteil
PS > 200 bar; Module A, pressure accessory

(2) Modul A „interne Fertigungskontrolle“. Die Dokumentation ist hinterlegt unter der Nummer 074/24 bei der Notifizierten Stelle der EU, IBExU Institut für Sicherheitstechnik GmbH (EU ID-Nr. 0637).
Module A “Internal Control of Production”. The Documentation is deposited under registration number 074/24 at Notified Body of EU, IBExU Institut für Sicherheitstechnik GmbH (EU ID 0637). .

Unterzeichnet für und im Namen von / *Signed for and on behalf of*

WIKA Alexander Wiegand SE & Co. KG

Klingenberg, 2024-04-24


Sascha Schnellbacher, Vice President
CoE Gauges, Sensors & Instruments

Mariusz Lubomski, Director of Quality
CoE Gauges, Sensors & Instruments


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

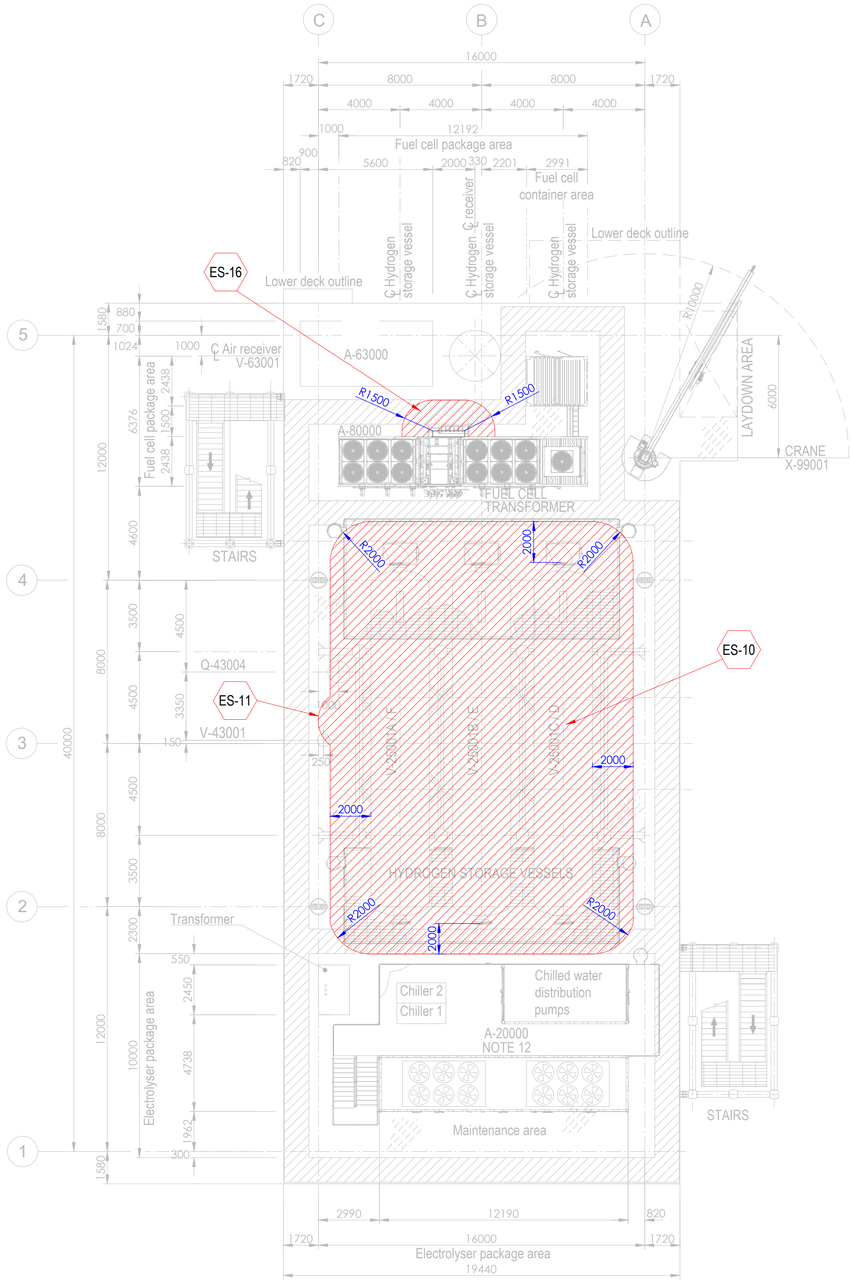


PLAN ON UPPER DECK
EL+30.310 T.O.S.

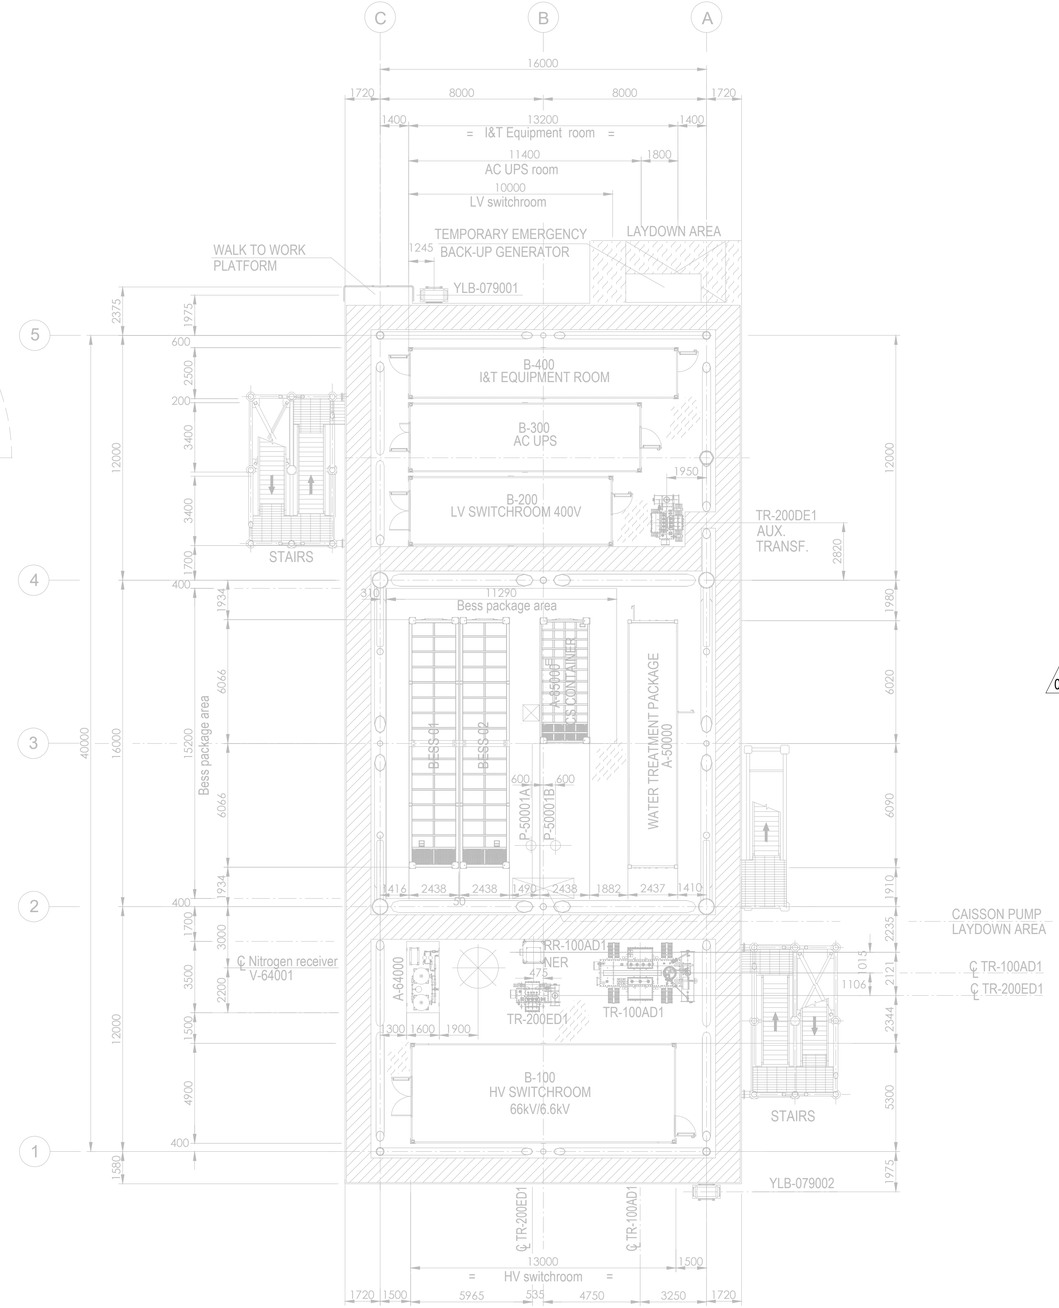

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

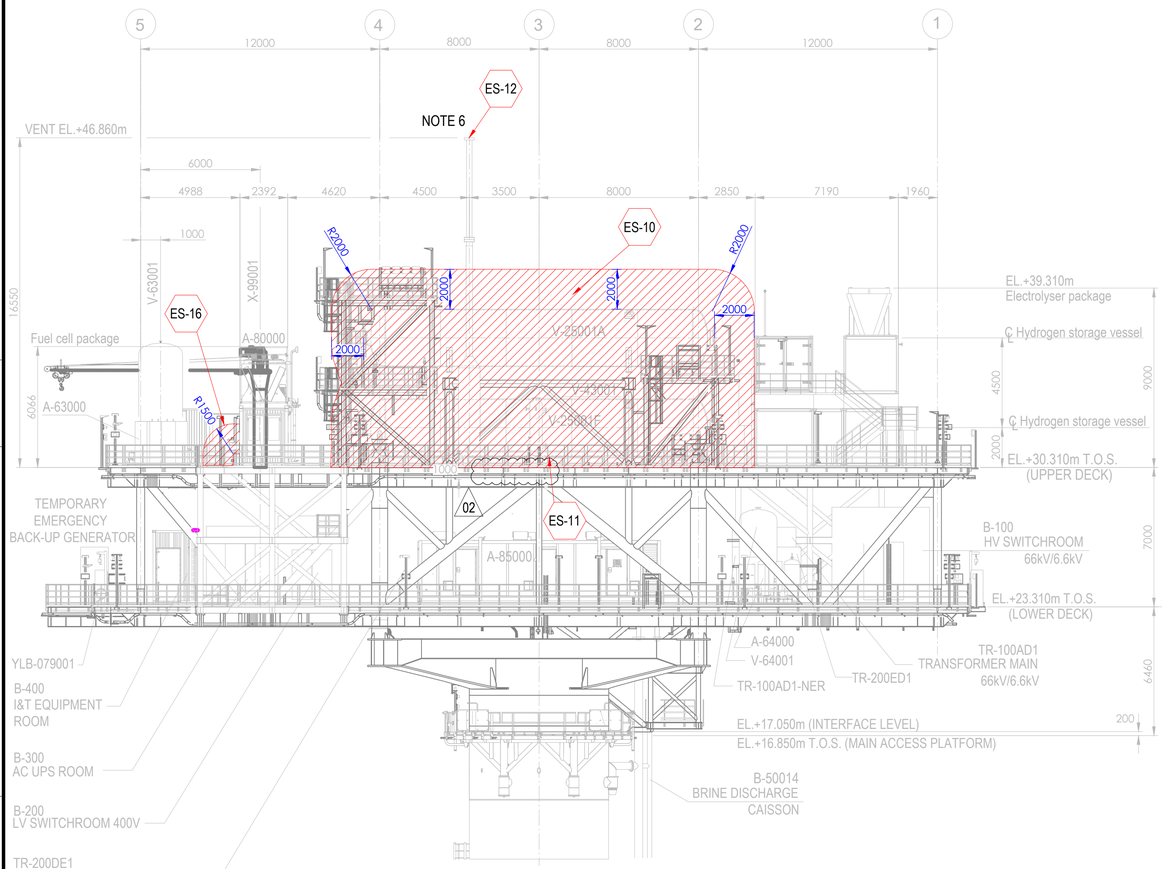



ELEVATION LOOKING EAST

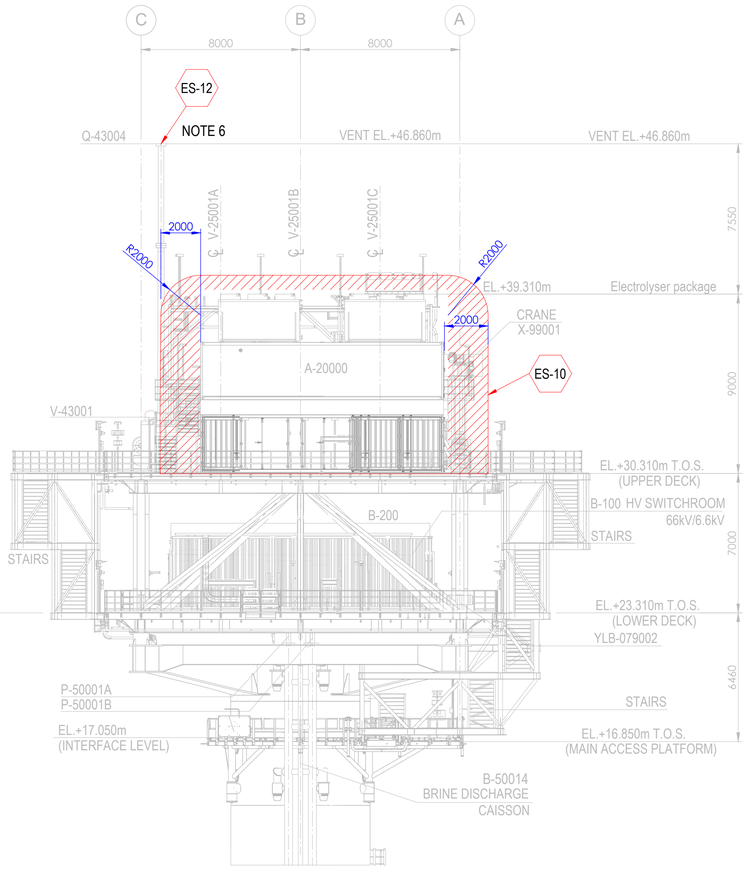

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

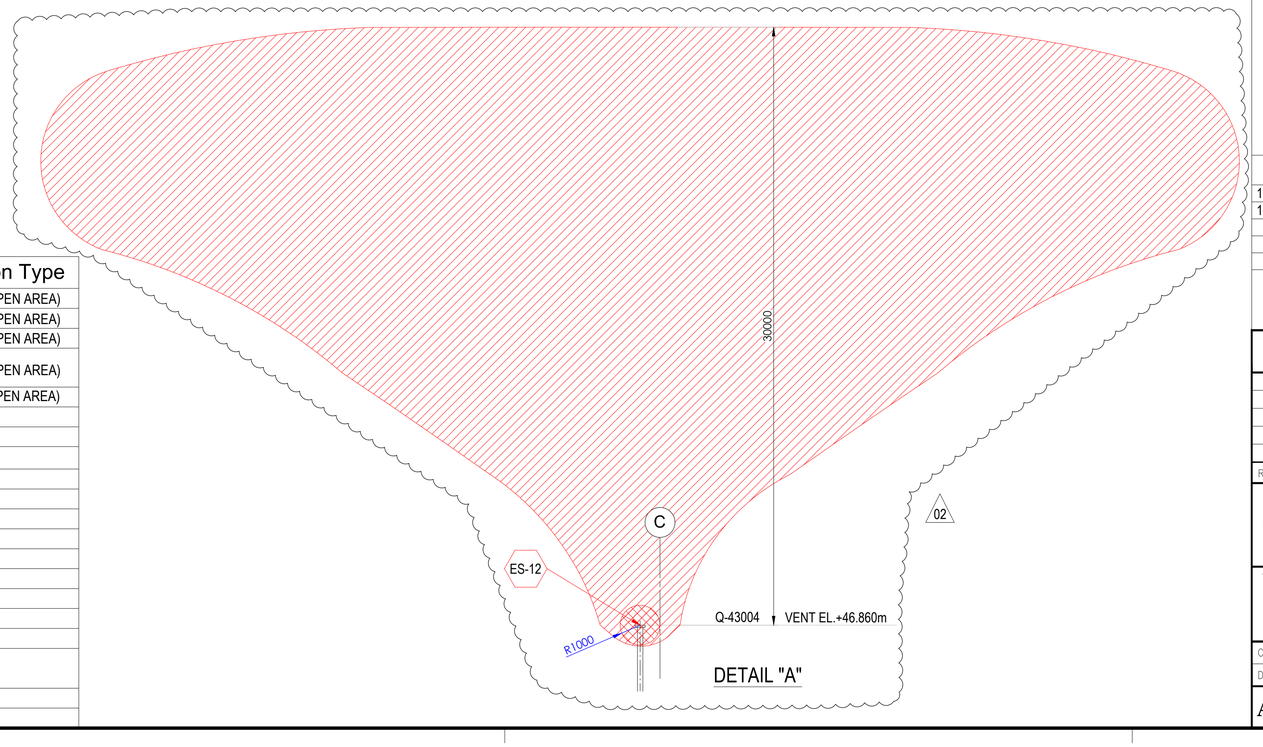



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PG -017	: Air Set Pressure Gauge Filter - Vessel V-25001E Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10004827	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		PW00DE2FPJJ			
Manufacturer	Wika			**Model**		233.50.63			
Cert No.	D.o.C. by Manufacturer reference 11564220			**Equipment Ambient Temp.**		-20 °C to +60 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP65

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PG -017	: Air Set Pressure Gauge Filter - Vessel V-25001E Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004827	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-PG -017	: Air Set Pressure Gauge Filter - Vessel V-25001E Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004827		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks					
67	All Terminals are Ex n certified (if required on certificate)	x	NA		
68	Hermetically sealed and enclosed break devices are undamaged	x	NA		
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA		
70	Test port, if fitted, is functional (type “nR” only)	x	NA		
71	Breathing operation is satisfactory (type “nR” only)	x	NA		
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA		
73	The ventilation airflow is not impeded	x	NA		
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA		
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA		
76	Variable voltage/frequency installation complies with documentation	x	NA		
Extra Ex p checks					
77	Pressurization gas is correct type	x	NA		
78	Actual pressure is within maximum and minimum settings for equipment	x	NA		
79	Timers set as per certification documentation	x	NA		
80	Alarms and trip functions operate correctly as per certification documentation	x	NA		
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA		
82	Automatic electrical protective devices operate within permitted limits	x	NA		
83	Automatic electrical protective devices are set correctly	x	NA		
84	Protective gas inlet temperature is below maximum specified	x	NA		
85	Ducts, pipes and enclosures are in good condition	x	NA		
86	Protective gas is substantially free from contaminants	x	NA		
87	Protective gas pressure and/or flow is adequate	x	NA		
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA		
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA		
90	Specific conditions of use (if applicable) are complied with		NA		
Extra Ex i (Intrinsically Safe – IS) checks					
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA		
92	Cables are installed in accordance with the documentation	x	NA		
93	Segregation is maintained between IS and non-IS Circuits	x	NA		
94	Cable screens are isolated at one end (field side)	x	NA		
95	Cable screens are earthed in accordance with the documentation	x	NA		
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA		
97	Equipment installed is the one specified in the documentation	x	NA		
98	Ambient temperature range of the apparatus is correct for the installation	x	NA		
99	Service temperature range of the apparatus is correct for the installation	x	NA		
100	Installation is clearly labelled	x	NA		
101	Printed circuit boards are clean and undamaged	x	NA		
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA		
103	Point-to-point connections are all correct	x	NA		
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA		
105	Earth connections maintain the integrity of the type of protection	x	NA		
106	Intrinsically safe circuit earthing is satisfactory	x	NA		
107	Insulation resistance is satisfactory	x	NA		
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA		

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA

Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	VENDOR ROTORK (PER FLUITEK)	RM(ROSETTI MARINO)	
Name	Stefano Linari	Giovanni Tangianu	
Date	2025-04-24	2025-04-24	
Signature	Digitaly signed by Stefano Linari 2025-04-24T13:22:13.371Z	Digitaly signed by Giovanni Tangianu 2025-04-24T14:59:44.889Z	

rotork®
Site Services

ROTORK CONTROLS ITALIA srl
Via Portico 17
24050 Orio Al Serio (BG)

Telefono: 0039 (0)5832221
E-mail: rotork.italia@rotork.com

09:23 14° 5G 69%

WIKA

25-xv-017

Type 23X.50
Manometro a molla tubolare 232.50/233.50
Cassa in acciaio inox

Serial number:
PW00DE2FPJJ

Item number:
57424821

Manufacturing date:
04/2025



ITEM	Tag	25-PG -017	: Air Set Pressure Gauge Filter - Vessel V-25001E Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10004827	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK	Discipline: ATEX	Form: CJX01 — Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**	8975GNDV				
Manufacturer	Wika			**Model**	233.50.63				
Cert No.	D.o.C. by Manufacturer, reference 11564220			**Equipment Ambient Temp.**	-20 °C to +60 °C				
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP65

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PG -017	: Air Set Pressure Gauge Filter - Vessel V-25001E Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004827	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	25-PG -017	: Air Set Pressure Gauge Filter - Vessel V-25001E Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004827		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01
							Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-31	2025-02-01	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-31T09:38:44.660Z	PROVERLIS Digitaly signed by Luca Mussi 2025-02-01T12:05:57.393Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

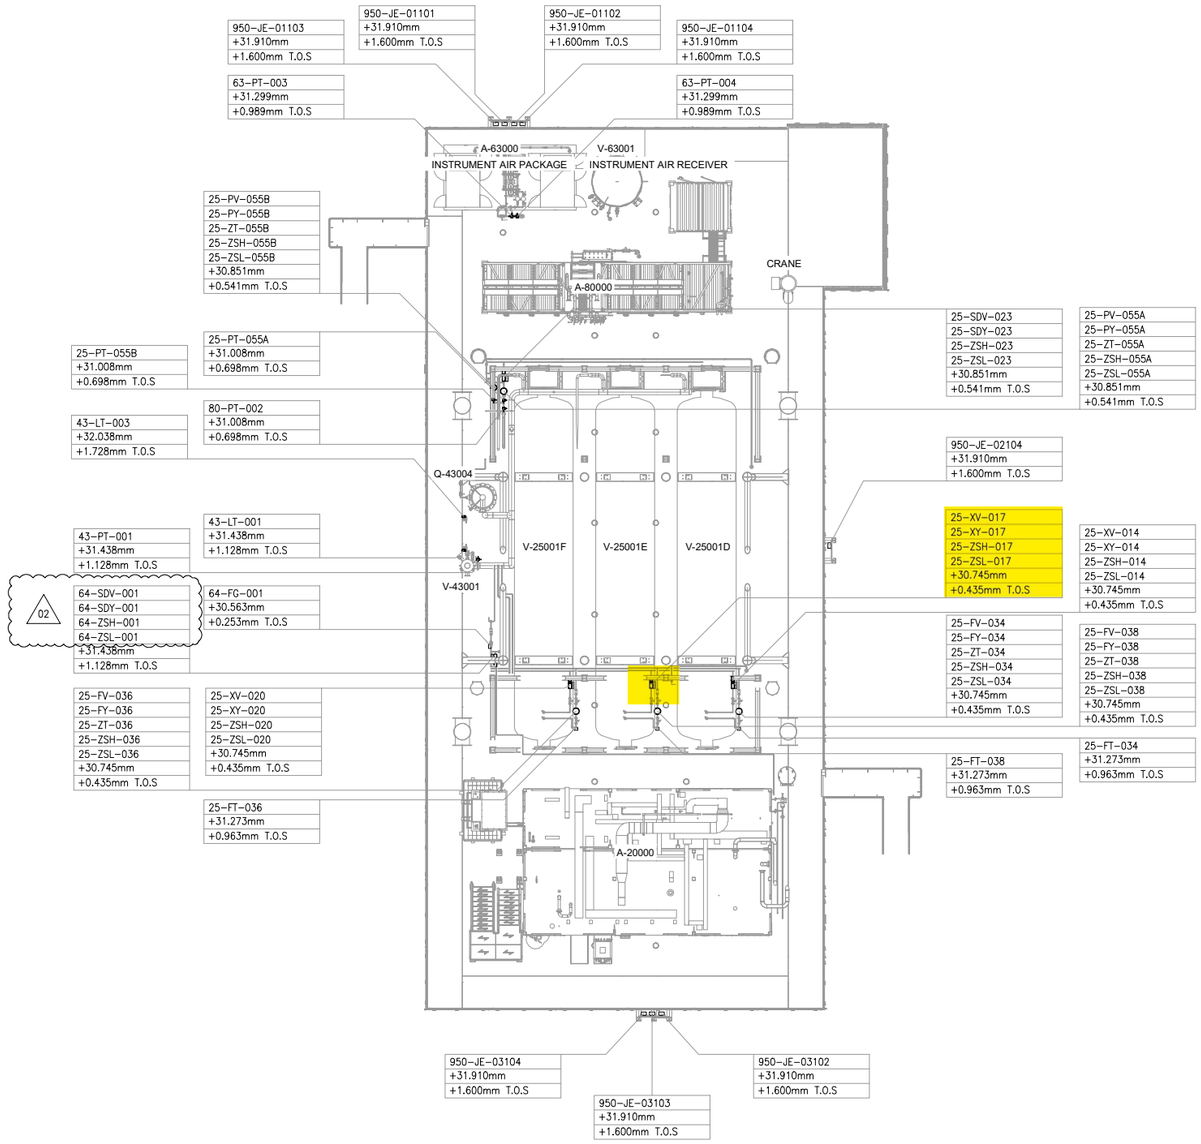


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 E

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

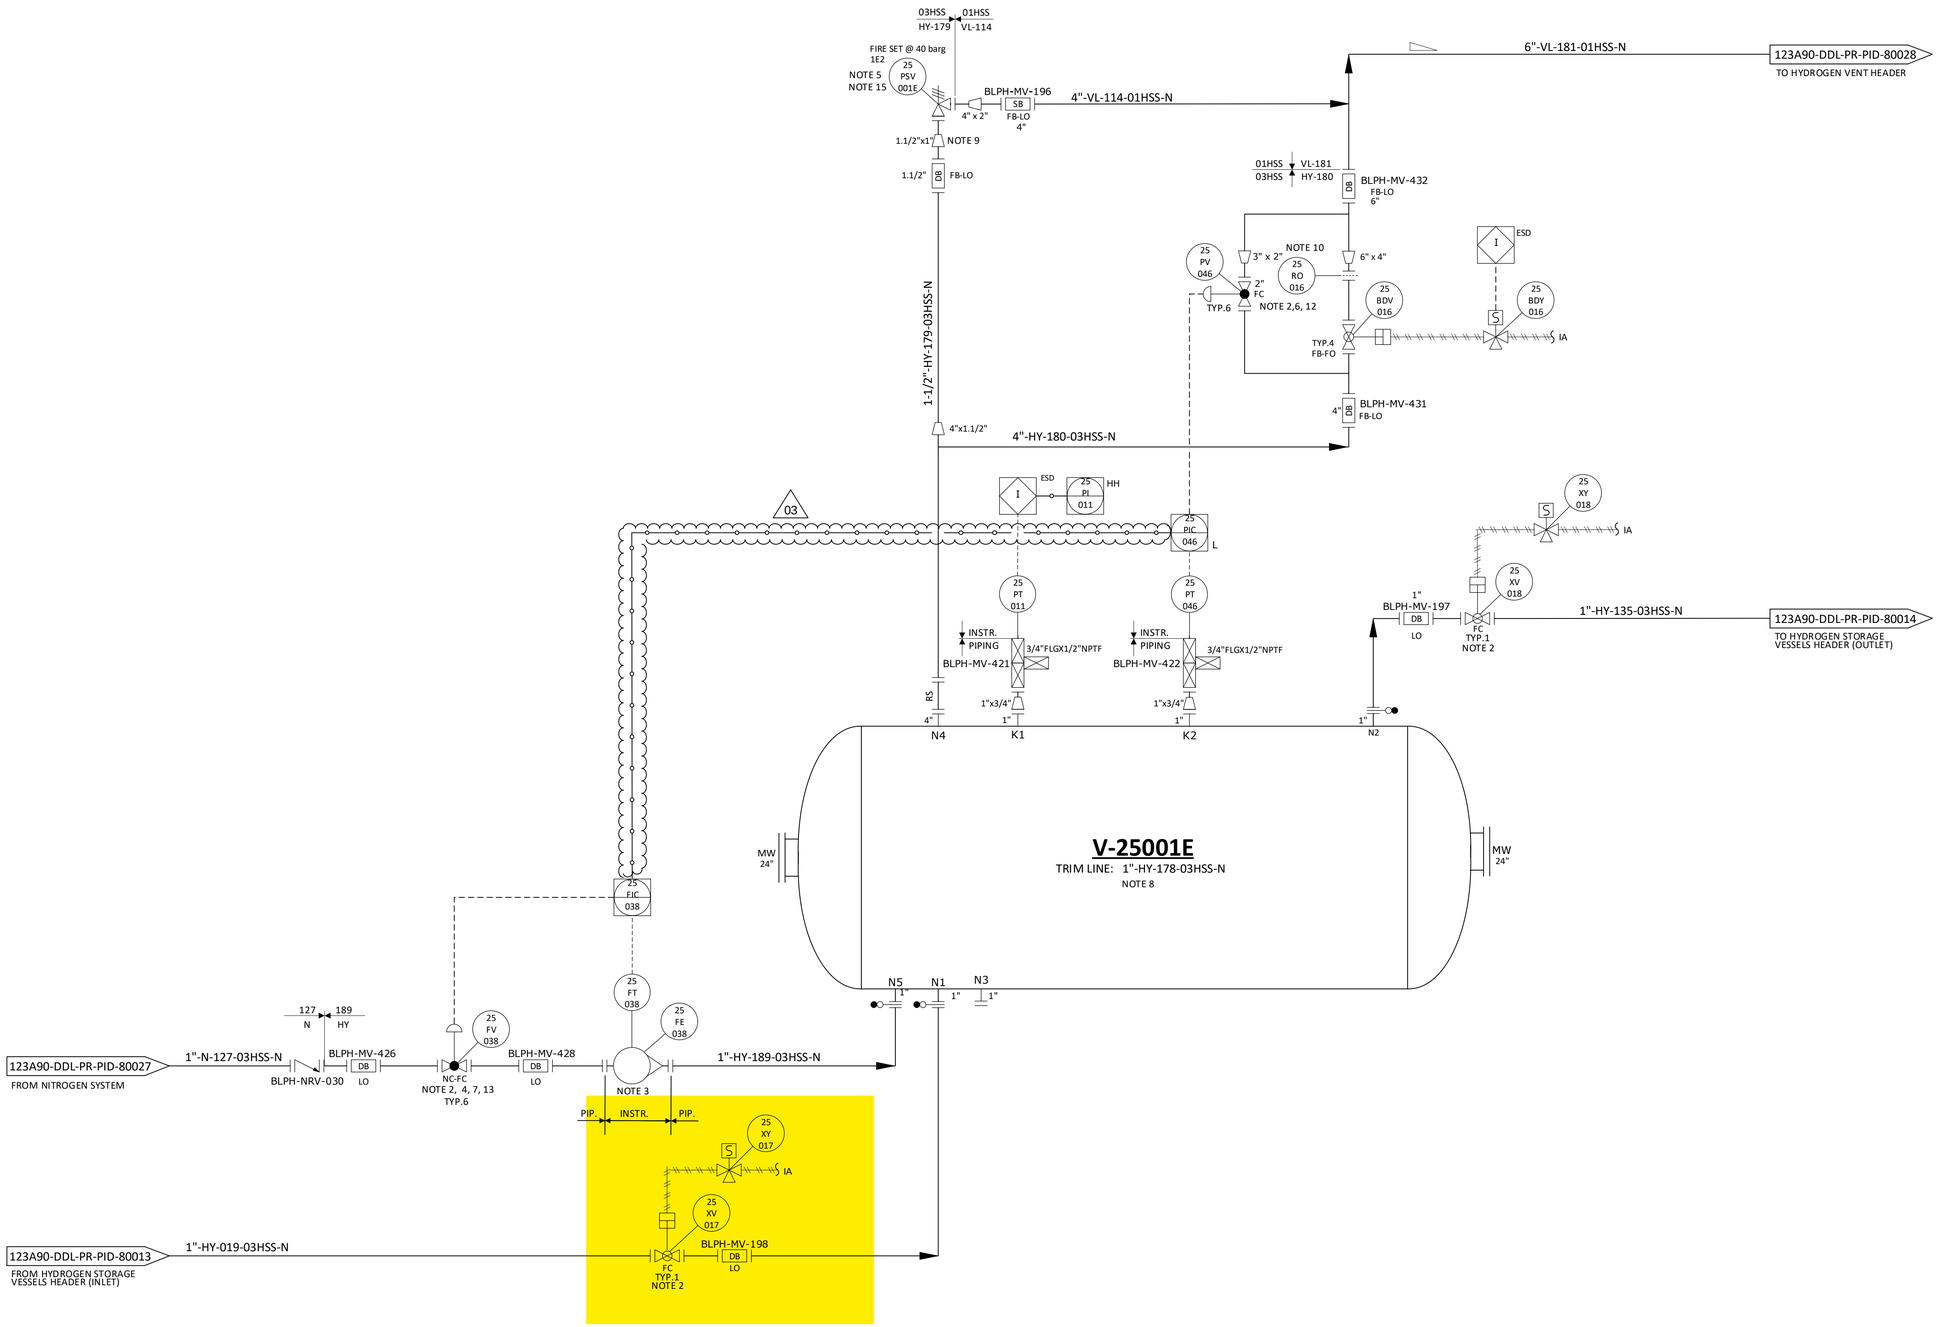

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-038) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-046 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-046 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-038 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-046 HAS FAILED TO CLOSE.
15. 25-PSV-001E SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL E

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE		
A1	DRAWING NO. 123A90-DDL-PR-PID-80019			SHEET 001	REV. 03

File Name = FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

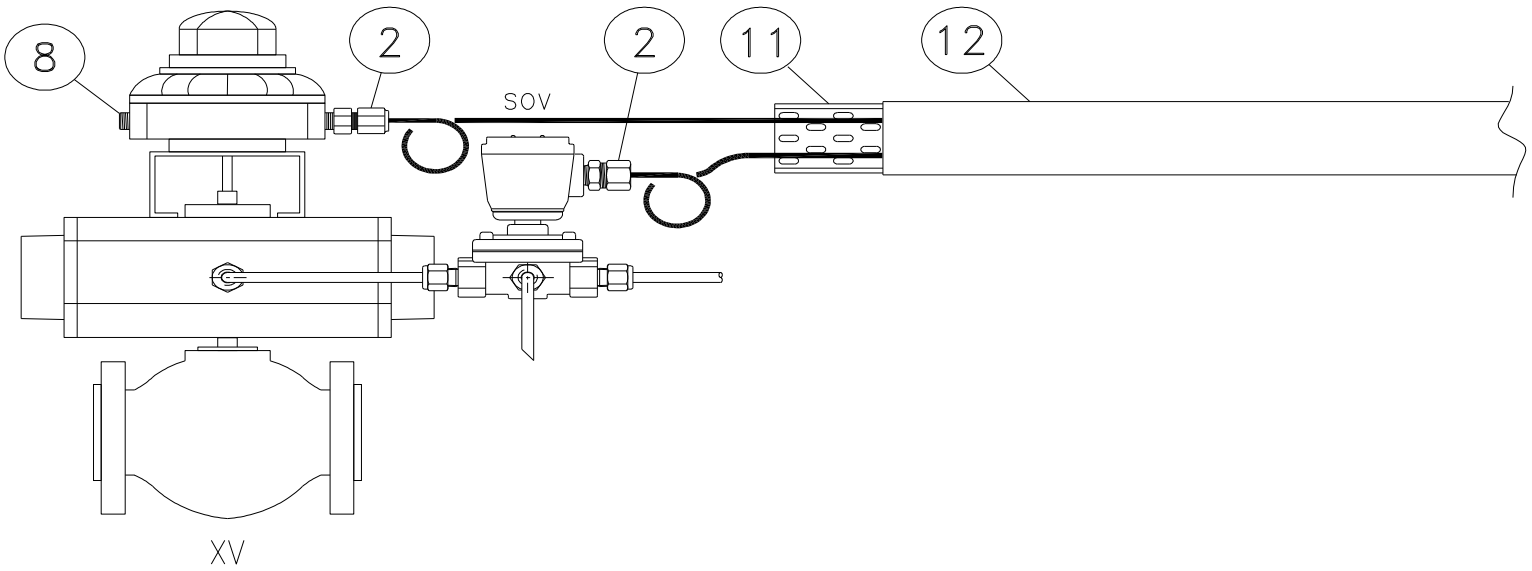

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_B	06/11/24	G.Randi

ROSETTI MARINO SpA


NOTE:

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

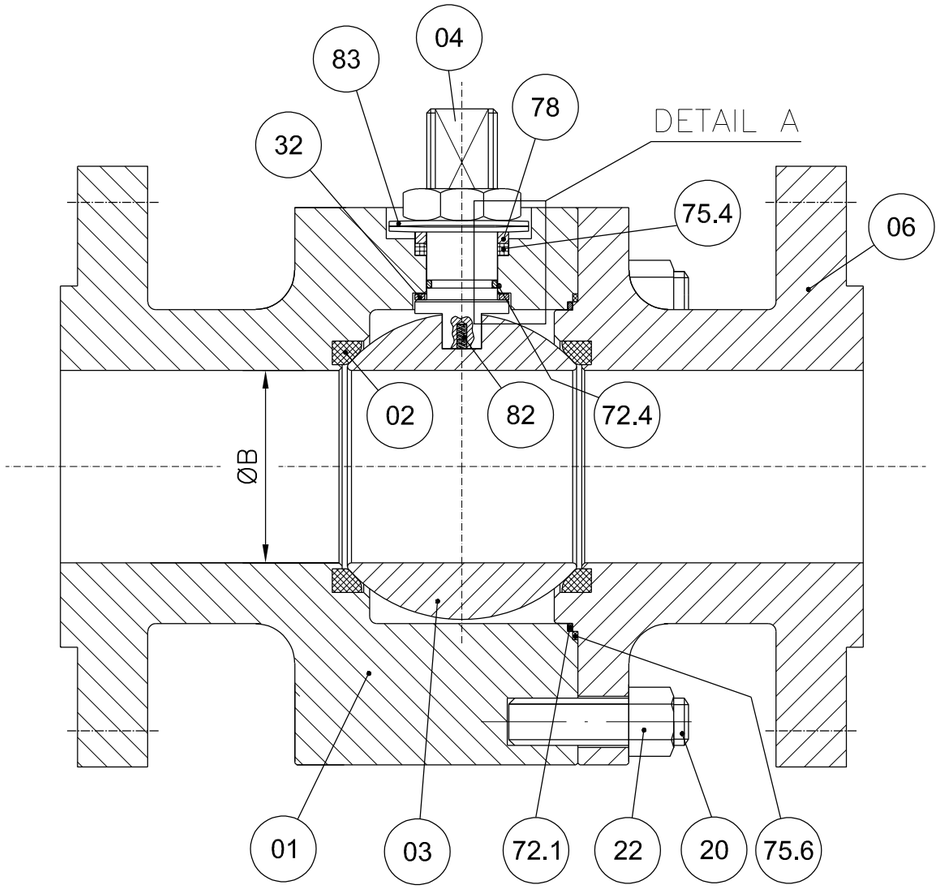


DETAIL A




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: D240062-08 — Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-017		25
	2	Service				HYDROGEN STORAGE TANK V-25001E INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80019		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-019-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-017 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-017 (9, 17) - Soldo SS		25-ZSH-017 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

94	IFR	25-XV-009	floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR	25-XV-011	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR	25-XV-012	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR	25-XV-014	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR	25-XV-015	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR	25-XV-017	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR	25-XV-018	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

Bourdon tube pressure gauge, stainless steel
For the process industry, standard version
Models 232.50, 233.50, NS 63 [2 ½"], 100 [4"] and 160 [6"]

For further approvals, see page 6

Applications

- For gaseous and liquid aggressive media that are not highly viscous or crystallising, also in aggressive environments
- Chemical and petrochemical industries, oil and gas industry, power engineering and also water and wastewater technology
- Machine building and general plant construction

Special features

- Excellent load cycle stability and shock resistance
- With case filling (model 233.50) for applications with high dynamic pressure loads and vibrations
- Completely from stainless steel
- Scale ranges from 0 … 0.6 to 0 … 1,600 bar or 0 ... 10 to 0 ... 20,000 psi
- QR code on dial links to instrument-specific information



Bourdon tube pressure gauge, model 232.50, NS 100 [4"]

Description

This high-quality Bourdon tube pressure gauge has been designed especially for the process industry.

The use of high-quality stainless steel materials and the robust design are geared to applications in the chemical and process engineering industries. Thus the instrument is suitable for liquid and gaseous media, also in aggressive environments.

Scale ranges of 0 … 0.6 to 0 … 1,600 bar [0 ... 10 to 0 ... 20,000 psi] ensure the measuring ranges required for a wide variety of applications.

WIKA manufactures and qualifies the pressure gauge in accordance with the standards EN 837-1 and ASME B40.100. As a safety function, this instrument has a blow-out device with blow-out plug on the back of the case. In the event of a failure, overpressure can escape there.

The model 233.50 with liquid-filled case is suitable for high dynamic pressure loads and vibrations.

The QR code on the dial allows instrument-specific information such as the serial number, the order number, certificates and other product data to be retrieved from the internet easily and in the long term.

Smart in sensing

Data sheets showing similar products:
Stainless steel, safety version; see data sheet PM 02.04
Bourdon tube pressure gauge with switch contacts; see data sheet PV 22.02
Monel version; see data sheet PM 02.33
Pressure gauge per EN 837-1 with mounted diaphragm seal; see data sheet DS 95.12

Specifications

Basic information	
Standard	■ EN 837-1 ■ ASME B40.100
	For information on the “Selection, installation, handling and operation of pressure gauges”, see technical information IN 00.05.
Further version	■ Oil- and grease-free for oxygen ■ Per NACE [1] MR0175 / ISO 15156, use in H_2S-containing environments in oil and gas production ■ With pre-volume deflagration flame arrester [2] for mounting to zone 0 (EPL Ga); model 910.21; see data sheet AC 91.02 ■ Monel version; models 262 and 263; see data sheet PM 02.33
Nominal size (NS)	■ Ø 63 mm [2 ½"] ■ Ø 100 mm [4"] ■ Ø 160 mm [6"]
Connection location	■ Lower mount (radial) ■ Lower back mount ■ Centre back mount (only for NS 63 [2 ½"])
Window	Laminated safety glass (NS 63 [2 ½"]: Polycarbonate)
Case	
Design	Safety level “S1” per EN 837-1 With blow-out device at case circumference, 12 o'clock (NS 63 [2 ½"]) and on the back of the case (NS 100 [4"] and 160 [6"]) Scale ranges ≤ 0 ... 16 bar [≤ 0 ... 300 psi] with compensating valve to vent and reseal case
Material	■ Stainless steel 1.4301 (304) ■ Stainless steel 1.4571 (316Ti)
Ring	Bayonet ring, stainless steel
Mounting	■ Without ■ Panel mounting flange, stainless steel ■ Panel mounting flange, polished stainless steel ■ Triangular profile ring with mounting bracket, polished stainless steel ■ Surface mounting flange, stainless steel
Case filling (model 233.50)	■ Without ■ Glycerine ■ Glycerine-water mixture for NS 100 [4"] and 160 [6"] with scale range ≤ 0 ... 2.5 bar [≤ 0 ... 40 psi] or for NS 63 [2 ½"] with scale range ≤ 0 ... 4 bar [≤ 0 ... 60 psi] ■ Silicone oil
Movement	■ Stainless steel ■ Stainless steel 1.4404 (316L) ■ everlast® version

1) General information about NACE standards; see data sheet IN 00.21
2) Only for instruments with Ex approval

Measuring element	
Type of measuring element	Bourdon tube, C-type or helical type
Material	Stainless steel 1.4404 (316L)
Leak tightness	■ Helium tested, leakage rate: $< 5 \cdot 10^{-3}$ mbar l/s ■ Helium tested, leakage rate: $< 1 \cdot 10^{-6}$ mbar l/s

Accuracy specifications		
Accuracy class		
NS 63 [2 ½"]	■ EN 837-1	Class 1.6
	■ ASME B40.100	±2 % | ±1 % | ±2 % of measuring span (grade A)
NS 100 [4"], 160 [6"]	■ EN 837-1	Class 1.0
	■ ASME B40.100	±1 % of measuring span (grade 1A)
Temperature error	On deviation from the reference conditions at the measuring system: ≤ ±0.4 % per 10 °C [≤ ±0.4 % per 18 °F] of full scale value	
Reference conditions		
Ambient temperature	+20 °C [+68 °F]	

Scale ranges

bar	
0 ... 0.6 [1]	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160
0 ... 4	0 ... 250
0 ... 6	0 ... 400
0 ... 10	0 ... 600
0 ... 16	0 ... 1,000
0 ... 25	0 ... 1,600

kg/cm²	
0 ... 0.6 [1]	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160
0 ... 4	0 ... 250
0 ... 6	0 ... 400
0 ... 10	0 ... 600
0 ... 16	0 ... 1,000
0 ... 25	0 ... 1,600

kPa	
0 ... 60 [1]	0 ... 4,000
0 ... 100	0 ... 6,000
0 ... 160	0 ... 10,000
0 ... 250	0 ... 16,000
0 ... 400	0 ... 25,000
0 ... 600	0 ... 40,000
0 ... 1,000	0 ... 60,000
0 ... 1,600	0 ... 100,000
0 ... 2,500	0 ... 160,000

MPa	
0 ... 0.06 [1]	0 ... 4
0 ... 0.1	0 ... 6
0 ... 0.16	0 ... 10
0 ... 0.25	0 ... 16
0 ... 0.4	0 ... 25
0 ... 0.6	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160

psi	
0 ... 10 [1]	0 ... 1,000
0 ... 15	0 ... 1,500
0 ... 30	0 ... 2,000
0 ... 60	0 ... 3,000
0 ... 100	0 ... 4,000
0 ... 160	0 ... 5,000
0 ... 200	0 ... 6,000
0 ... 300	0 ... 7,500
0 ... 400	0 ... 10,000
0 ... 600	0 ... 15,000
0 ... 800	0 ... 20,000

1) Not available for NS 63 [2 ½"]

Vacuum and +/- scale ranges

bar	
-0.6 ... 0 [1]	-1 ... +5
-1 ... 0	-1 ... +9
-1 ... +0.6	-1 ... +15
-1 ... +1.5	-1 ... +24
-1 ... +3	

MPa	
-0.06 ... 0 [1]	-0.1 ... +0.5
-0.1 ... 0	-0.1 ... +0.9
-0.1 ... +0.06	-0.1 ... +1.5
-0.1 ... +0.15	-0.1 ... +2.4
-0.1 ... +0.3	

kPa	
-60 ... 0 [1]	-100 ... +500
-100 ... 0	-100 ... +900
-100 ... +60	-100 ... +1,500
-100 ... +150	-100 ... +2,400
-100 ... +300	

psi	
-30 inHg ... 0	-30 inHg ... +100
-30 inHg ... +15	-30 inHg ... +160
-30 inHg ... +30	-30 inHg ... +200
-30 inHg ... +60	-30 inHg ... +300

1) Not available for NS 63 [2 ½"]

Further details on: scale ranges	
Special scale ranges	Other scale ranges on request
Unit	■ bar ■ psi ■ kg/cm² ■ kPa ■ MPa
Increased overload safety	■ Without ■ 2 times ■ 3 times ■ 4 times ■ 5 times
	The possibility of selection depends on scale range and nominal size
Vacuum resistance	■ Without ■ Vacuum-resistant to -1 bar
Dial	
Scale colour	Black
Material	Aluminium
Special scale	■ Without ■ With temperature scale for refrigerant, e.g. for NH_3: R 717
	Other scales or customer-specific dials, e.g. with red mark, circular arcs or circular sectors, on request
Pointer	
Instrument pointer	Aluminium, black
Mark pointer/drag pointer	■ Without ■ Red mark pointer on dial, fixed ■ Red mark pointer on window, adjustable ■ Mark pointer on bayonet ring, adjustable ■ Red drag pointer on window, adjustable
Pointer stop pin	■ Without ■ At zero point (only for NS 63 [2 ½"]) ■ At 6 o'clock (only for NS 100 [4"], 160 [6"])

Process connection		
Standard	■ EN 837-1 ■ ISO 7 ■ ANSI/B1.20.1	
Size		
EN 837-1	■ G ⅛ B, male thread ■ G ¼ B, male thread ■ G ½ B, male thread ■ M12 x 1.5, male thread ■ M20 x 1.5, male thread	
ISO 7	■ R ¼, male thread ■ R ½, male thread	
ANSI/B1.20.1	■ ¼ NPT, male thread ■ ½ NPT, male thread	
Restrictor	■ Without ■ Ø 0.6 mm [0.024"], stainless steel ■ Ø 0.3 mm [0.012"], stainless steel	
Material (wetted)		
Process connection	Stainless steel 1.4404 (316L)	
Bourdon tube	Stainless steel 1.4404 (316L)	

→ Other process connections on request

Operating conditions		
Medium temperature		
Unfilled instruments	-40 ... +200 °C [-40 ... +392 °F]	
Instruments with glycerine filling	-20 ... +100 °C [-4 ... +212 °F]	
Instruments with silicone oil filling	-40 ... +100 °C [-40 ... +212 °F]	
Ambient temperature		
Unfilled instruments or with silicone oil filling	-40 ... +60 °C [-40 ... +140 °F]	
Instruments with glycerine filling	-20 ... +60 °C [-4 ... +140 °F]	
Pressure limitation		
NS 63 [2 ½"]	Steady	3/4 x full scale value
	Fluctuating	2/3 x full scale value
	Short time	Full scale value
NS 100 [4"], 160 [6"]	Steady	Full scale value
	Fluctuating	0.9 x full scale value
	Short time	1.3 x full scale value
Ingress protection per IEC/EN 60529	■ IP65 ■ IP66 (only selectable for scale ranges ≥ 0 ... 20 bar [0 ... 400 psi])	

Approvals

Logo	Description	Region
CE	**EU declaration of conformity** Pressure equipment directive PS > 200 bar, module A, pressure accessory	European Union
UKCA	**UKCA** Pressure equipment (safety) regulations	United Kingdom
-	**CRN** Safety (e.g. electr. safety, overpressure, ...) For full scale value ≤ 1,000 bar	Canada

Optional approvals

Logo	Description	Region
CE Ex	**EU declaration of conformity** ATEX directive Hazardous areas - Ex h Gas II 2G Ex h IIC T6 ... T1 Gb X Dust II 2D Ex h IIIC T85°C ... T450°C Db X	European Union
UKCA	**UKCA** Equipment and protective systems intended for use in potentially explosive atmospheres regulations	United Kingdom
EAC Ex	**EAC** Hazardous areas	Eurasian Economic Community
	Ex Ukraine Hazardous areas	Ukraine
	PAC Kazakhstan Metrology, measurement technology	Kazakhstan
-	**MChS** Permission for commissioning	Kazakhstan
-	**PAC Ukraine** Metrology, measurement technology	Ukraine
	PAC Uzbekistan Metrology, measurement technology	Uzbekistan
-	**PAC China** Metrology, measurement technology	China
	DNV Ships, shipbuilding (e.g. offshore)	International
-	**KBA** [1] Automotive	International
	Hydrogen-powered motor vehicles - (EC) no. 79/2009 and (EU) no. 406/2010	
	Components for motor vehicles using natural gas (CNG/LNG) – UN no. R 110	

1) Not available for all versions

Manufacturer's declaration

Logo	Description
-	Pressure equipment directive (PED) for maximum allowable pressure PS ≤ 200 bar
-	Suitability of wetted materials for drinking water in accordance with the European 4MS initiative
-	Suitability of wetted materials for hydrogen


Certificates (option)

Certificates	
Certificates	■ 2.2 test report per EN 10204 (e.g. state-of-the-art manufacturing, indication accuracy) ■ 3.1 inspection certificate per EN 10204 (e.g. material proof for wetted metal parts, indication accuracy) ■ PCA calibration certificate, traceable and accredited in accordance with ISO/IEC 17025 ■ Calibration certificate by a national accreditation body, traceable and accredited in accordance with ISO/IEC 17025 on request
Recommended calibration interval	1 year (dependent on conditions of use)

→ For approvals and certificates, see website

Dimensions in mm [in]

Lower mount (radial)

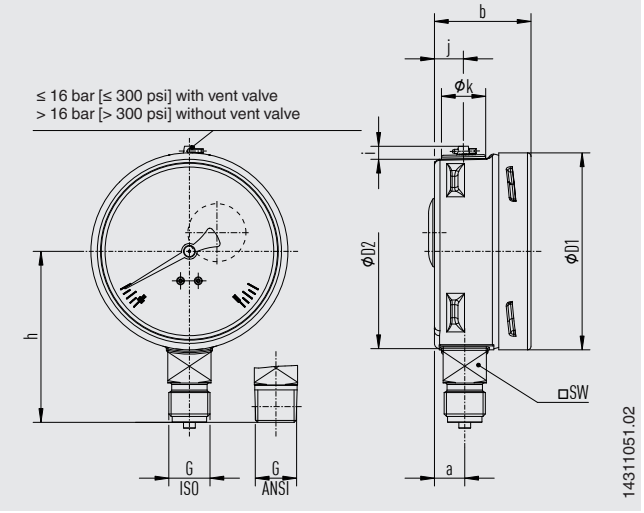

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]
100 [4"]	approx. 0.6 kg [1.32 lbs]	approx. 0.9 kg [1.98 lbs]
160 [6"]	approx. 1.1 kg [2.43 lbs]	approx. 2.0 kg [4.41 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	G ¼ B	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	51 [2.01]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	G ¼ B	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	87 [3.43]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	87 [3.43]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	G ¼ B	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	118 [4.65]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	118 [4.65]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ISO 7


NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	R ¼	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	R ¼	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	86 [3.39]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	R ¼	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	117 [4.60]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	¼ NPT	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	51 [2.01]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	¼ NPT	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	86 [3.39]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	¼ NPT	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	117 [4.60]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

1) Plus 16 mm [0.630 in] with scale range 0 ... 1,600 bar [0 ... 20,000 psi]

Lower back mount

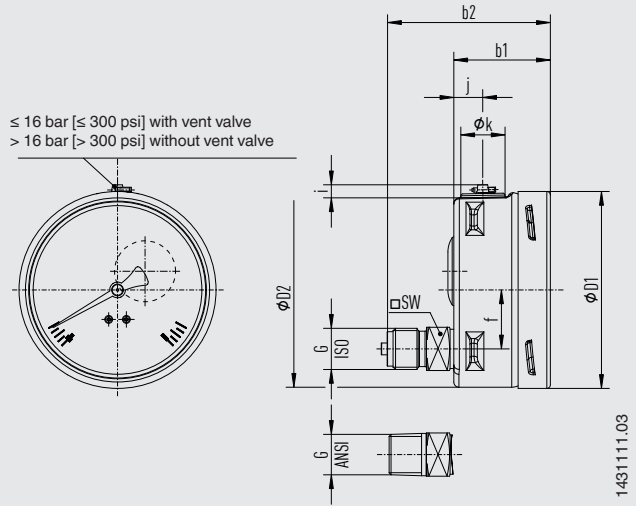

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]
100 [4"]	approx. 0.6 kg [1.32 lbs]	approx. 0.9 kg [1.98 lbs]
160 [6"]	approx. 1.1 kg [2.43 lbs]	approx. 2.0 kg [4.41 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	G ¼ B	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	33 [1.30]	54 [2.13]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	G ¼ B	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	49.5 [1.95]	83 [3.27]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	49.5 [1.95]	83 [3.27]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	G ¼ B	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	51.5 [2.03] 1)	85 [3.24] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	51.5 [2.03] 1)	85 [3.24] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ISO 7


NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	R ¼	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	R ¼	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	49.5 [1.95]	82 [3.23]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	R ¼	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	51.5 [2.03] 1)	84 [3.31] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	¼ NPT	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	50 [1.97]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	33 [1.30]	54 [2.13]	63 [2.48]	62 [2.44]	50 [1.97]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	¼ NPT	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	49.5 [1.95]	82 [3.23]	101 [3.98]	99 [3.90]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	¼ NPT	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	51.5 [2.03] 1)	84 [3.31] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

1) Plus 16 mm [0.630 in] with scale ranges ≥ 0 ... 100 bar [≥ 0 ... 1,500 psi]

NS 63 [2 ½"], centre back mount

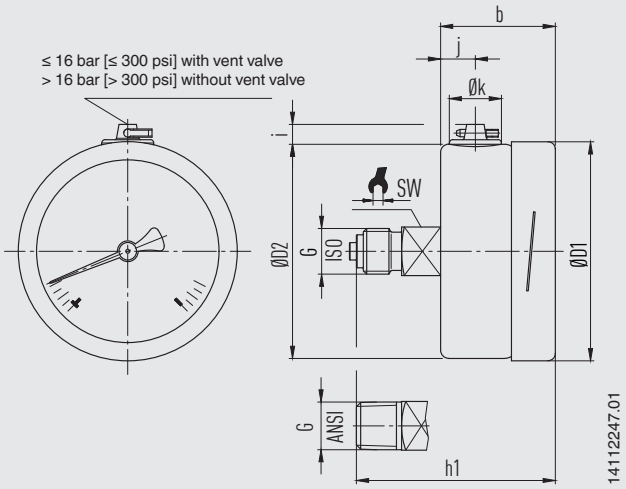

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	G ¼ B	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	54 [2.13]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]

Process connection with thread per ISO 7

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	R ¼	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]


Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	¼ NPT	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	54 [2.13]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]


Accessories

Dimensions in mm [in]

Panel mounting flange

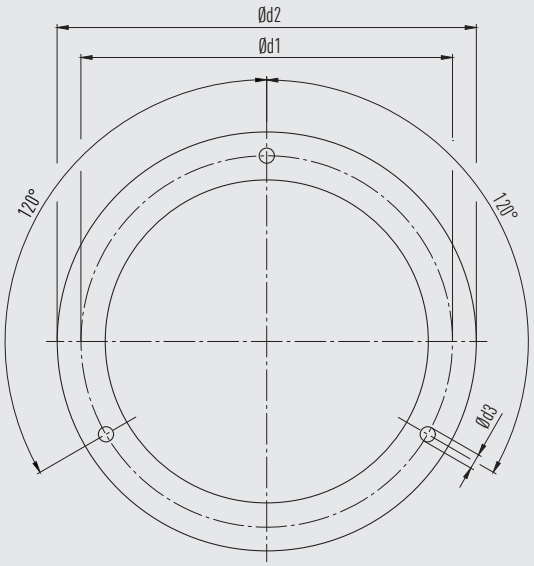


Surface mounting flange

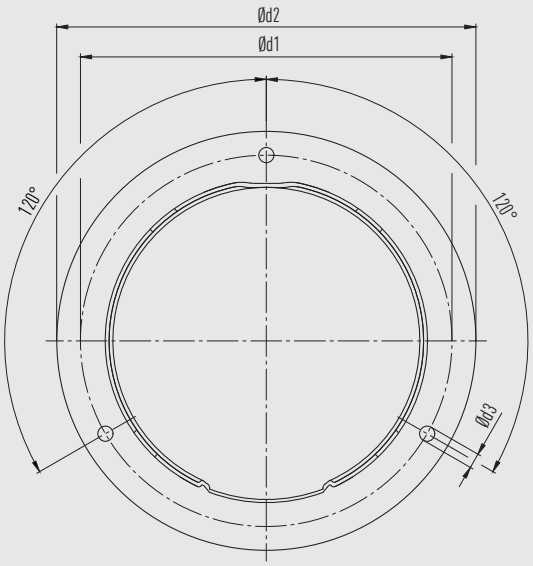


NS	Dimensions in mm [in]			
	Recommended panel cutout	d1	d2	d3
63 [2 ½"]	Ø 67 ±0.3 / Ø 2.6 [Ø 2.64 ±0.01 / Ø 0.10]	75 [2.95]	85 [3.35]	3.6 [0.14]
100 [4"]	Ø 104 ±0.5 / Ø 4.1 [Ø 4.04 ±0.02 / Ø 0.16]	117 [4.60]	132 [5.20]	4.8 [0.19]
160 [6"]	Ø 164 ±0.5 / Ø 6.5 [Ø 6.46 ±0.02 / Ø 0.26]	178 [7.01]	196 [7.72]	5.8 [0.23]

Triangular profile ring

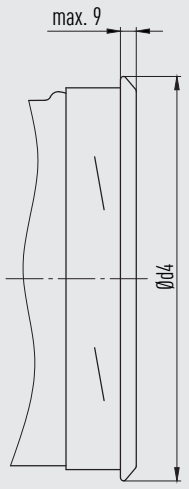

NS	Dimensions in mm [in]	
	Recommended panel cutout	d4
63 [2 ½"]	Ø 64.5 ±0.5 / Ø 2.5 [Ø 2.54 ±0.02 / Ø 0.01]	≤ 69 [2.72]
100 [4"]	Ø 102 ±1.0 / Ø 4.0 [Ø 4.02 ±0.04 / Ø 0.16]	≤ 108 [4.25]
160 [6"]	Ø 162.6 ±1.0 / Ø 6.4 [Ø 6.40 ±0.04 / Ø 0.25]	≤ 168 [6.61]

Accessories and spare parts

Model		Description
	**910.17**	Seals → See data sheet AC 09.08
	**910.15**	Syphons → See data sheet AC 09.06
	**910.13**	Overpressure protector → See data sheet AC 09.04
	**IV10, IV11**	Needle valve and multiport valve → See data sheet AC 09.22
	**IV20, IV21**	Block-and-bleed valve → See data sheet AC 09.19
	**IVM**	Monoflange, process and instrument version → See data sheet AC 09.17
	**BV**	Ball valve, process and instrument version → See data sheet AC 09.28
	**IBF2, IBF3**	Monoblock with flange connection → See data sheet AC 09.25

Ordering information

Model / Nominal size / Scale range / Process connection / Connection location / Options

© 02/1995 WIKA Alexander Wiegand SE & Co. KG, all rights reserved.
The specifications given in this document represent the state of engineering at the time of publishing.
We reserve the right to make modifications to the specifications and materials.
In case of a different interpretation of the translated and the English data sheet, the English wording shall prevail.

WIKA Alexander Wiegand SE & Co. KG
Alexander-Wiegand-Straße 30
63911 Klingenberg/Germany
Tel. +49 9372 132-0
info@wika.de
www.wika.de

EU-Konformitätserklärung
EU Declaration of Conformity

Dokument Nr. / ***Document No.*** **11564220** — **Revision** / ***Issue*** **07**

Wir erklären in alleiniger Verantwortung, dass die mit CE gekennzeichneten Produkte
We declare under our sole responsibility that the CE marked products

Typenbezeichnung / ***Type Designation***

23a.50.063 + option ATEX | **23a.50.1*0 + option ATEX**
26a.50.063 + option ATEX | **26a.50.1*0 + option ATEX**
23a.30.063 + option ATEX | **23a.30.1*0 + option ATEX**
26a.30.063 + option ATEX | **26a.30.1*0 + option ATEX**
23a.53.063 + option ATEX | **23a.53.100 + option ATEX**
23a.54.063 + option ATEX | **23a.54.100 + option ATEX**
23a.36.1*0 + option ATEX
PG23LT.063 + option ATEX | **PG23LT.1*0 + option ATEX**
PG23CP.063 + option ATEX | **PG23CP.100 + option ATEX**
PG28.1*0 + option ATEX
PG23HP-S.1*0 + option ATEX | **PG23HP-P.1*0 + option ATEX**

*** Nominal size**
0 = 100mm
6 = 160mm

a Case filling
2 = Without case filling
3 = With case filling

Beschreibung / ***Description***: **Rohrfederdruckmessgerät** / ***Bourdon Tube Pressure Gauge***

gemäß gültigem Datenblatt / *according to the valid data sheet*: PM 02.02, PM 02.04, PM 02.12, PM 02.15, PM 02.22, PM 02.24, PM 02.32, PM 02.28, PM 02.29

mit den nachfolgenden relevanten Harmonisierungsvorschriften der Union übereinstimmen
are in conformity with the following relevant Union harmonisation legislation

Angewandte harmonisierte Normen oder sonstige technische Spezifikationen:
Applied harmonised standards or other technical specifications:

2014/68/EU	Druckgeräterichtlinie (DGRL) (1) *Pressure Equipment Directive (PED)* (1)	
2014/34/EU	Explosionsschutz (ATEX) (2) *Explosion protection (ATEX)* (2)	
Ex	II 2G Ex h IIC T6 … T1 Gb X II 2D Ex h IIIC T85 °C … T450 °C Db X	EN ISO 80079-36 :2016 EN ISO 80079-37 :2016

(1) PS > 200 bar; Modul A, druckhaltendes Ausrüstungsteil
PS > 200 bar; Module A, pressure accessory

(2) Modul A „interne Fertigungskontrolle“. Die Dokumentation ist hinterlegt unter der Nummer 074/24 bei der Notifizierten Stelle der EU, IBExU Institut für Sicherheitstechnik GmbH (EU ID-Nr. 0637).
Module A “Internal Control of Production”. The Documentation is deposited under registration number 074/24 at Notified Body of EU, IBExU Institut für Sicherheitstechnik GmbH (EU ID 0637). .

Unterzeichnet für und im Namen von / *Signed for and on behalf of*

WIKA Alexander Wiegand SE & Co. KG

Klingenberg, 2024-04-24


Sascha Schnellbacher, Vice President
CoE Gauges, Sensors & Instruments

Mariusz Lubomski, Director of Quality
CoE Gauges, Sensors & Instruments


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

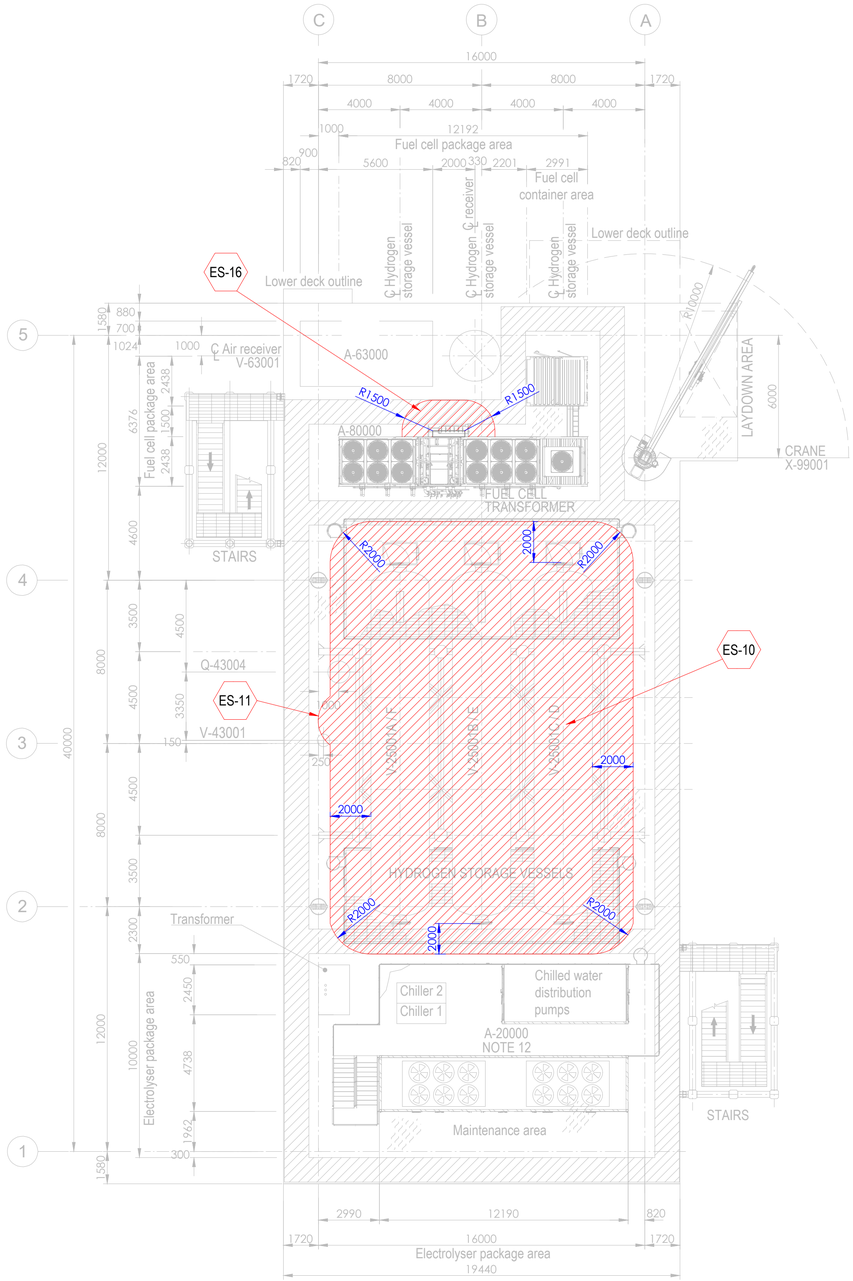


PLAN ON UPPER DECK
EL+30.310 T.O.S.

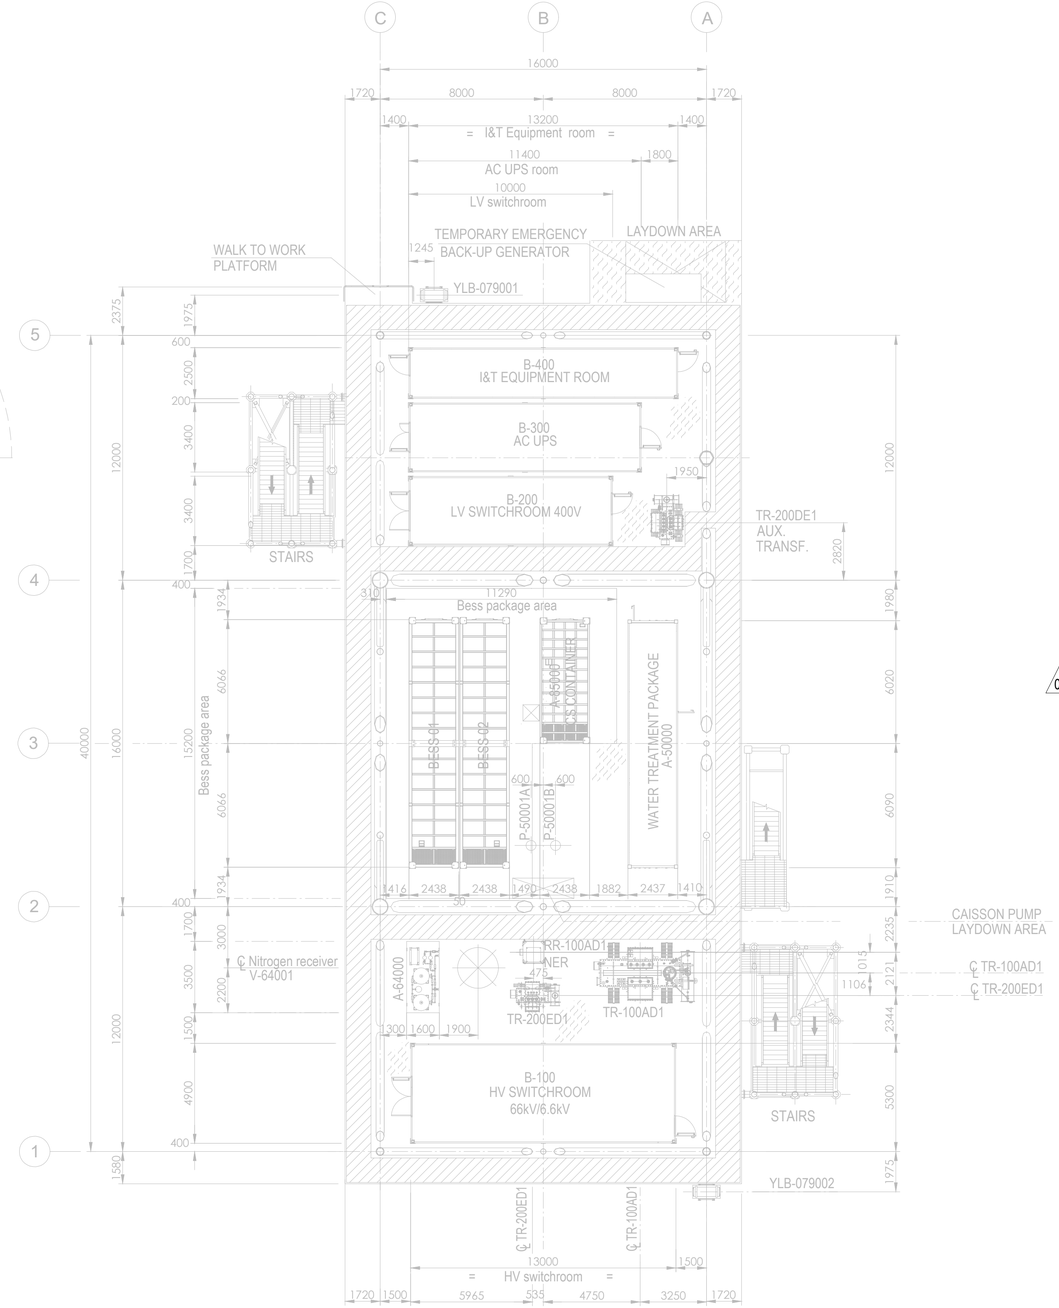

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

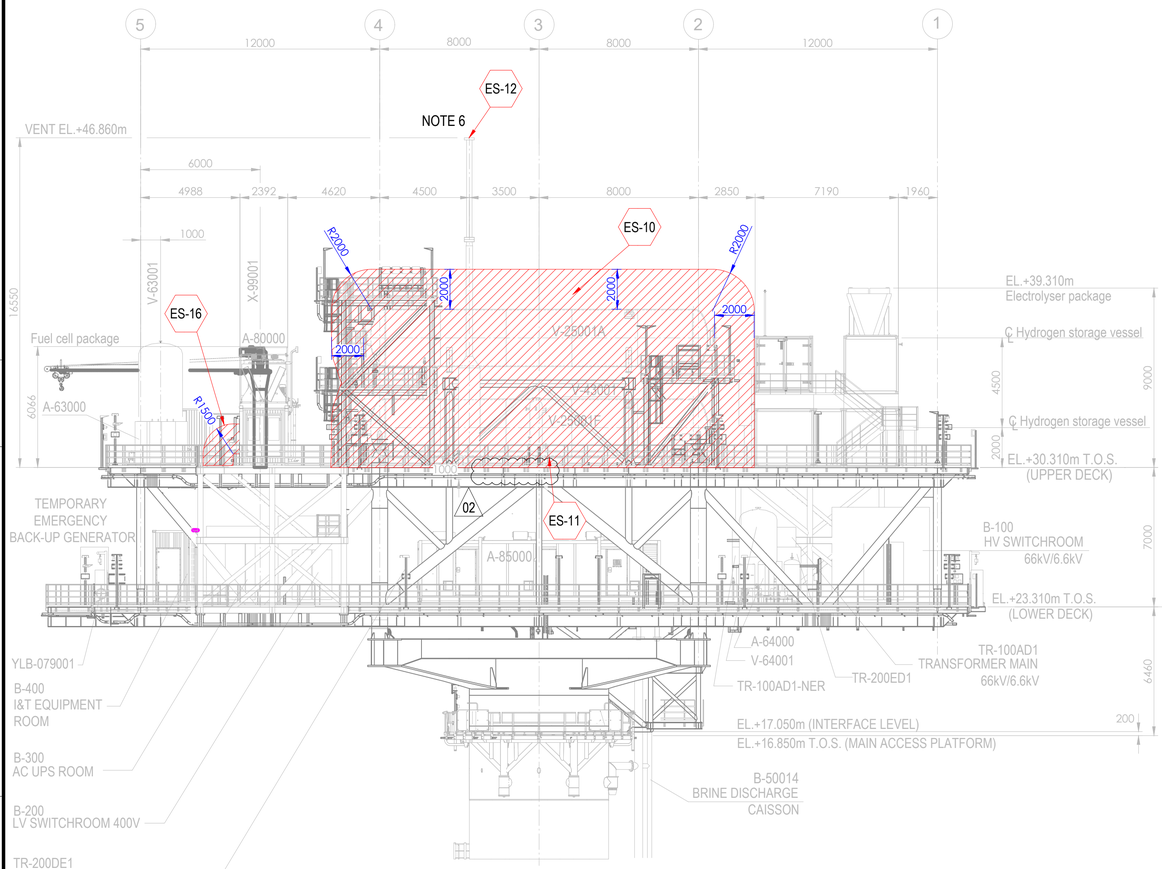



ELEVATION LOOKING EAST

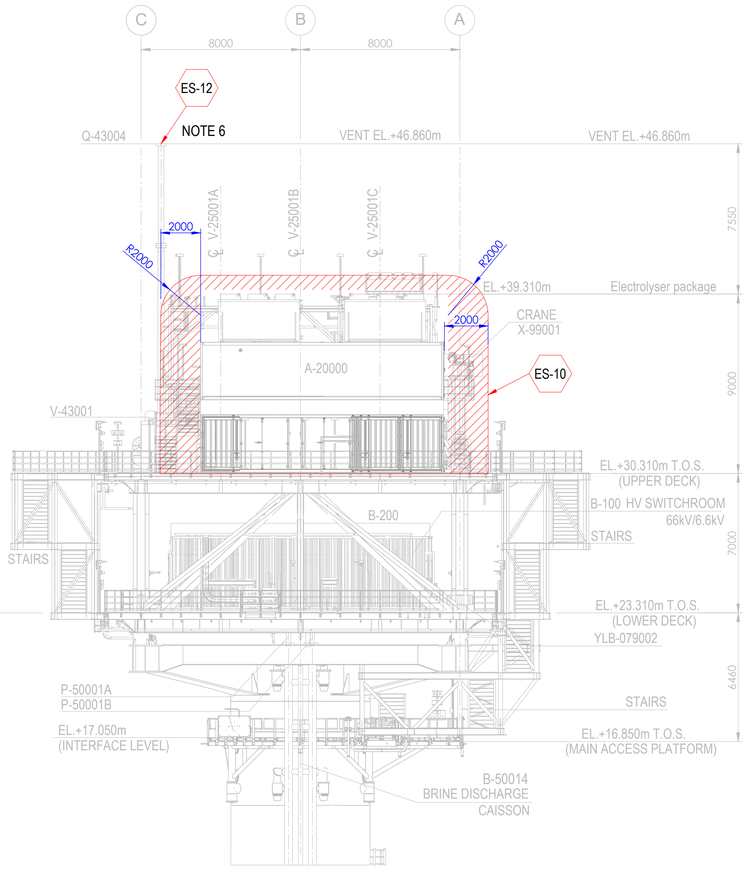

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

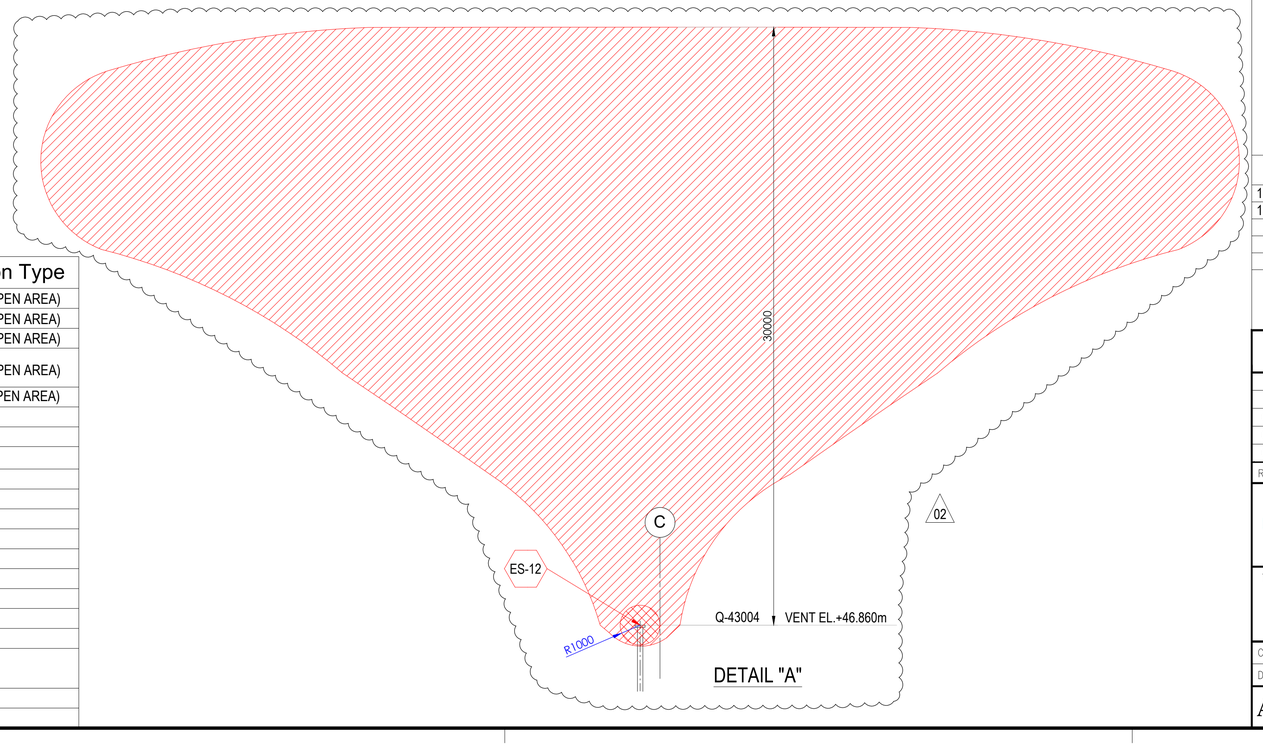



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PG -020	: Air Set Pressure Gauge Filter - Vessel V-25001F Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80020
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10004829	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK	Discipline: ATEX	Form: CJX01 — Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		PW00DE2KV3T			
Manufacturer	Wika			**Model**		233.50.63			
Cert No.	D.o.C. by Manufacturer reference 11564220			**Equipment Ambient Temp.**		-20 °C to +60 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP65

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PG -020	: Air Set Pressure Gauge Filter - Vessel V-25001F Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80020
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004829	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-PG -020	: Air Set Pressure Gauge Filter - Vessel V-25001F Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80020
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004829	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks					
67	All Terminals are Ex n certified (if required on certificate)	x	NA		
68	Hermetically sealed and enclosed break devices are undamaged	x	NA		
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA		
70	Test port, if fitted, is functional (type “nR” only)	x	NA		
71	Breathing operation is satisfactory (type “nR” only)	x	NA		
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA		
73	The ventilation airflow is not impeded	x	NA		
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA		
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA		
76	Variable voltage/frequency installation complies with documentation	x	NA		
Extra Ex p checks					
77	Pressurization gas is correct type	x	NA		
78	Actual pressure is within maximum and minimum settings for equipment	x	NA		
79	Timers set as per certification documentation	x	NA		
80	Alarms and trip functions operate correctly as per certification documentation	x	NA		
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA		
82	Automatic electrical protective devices operate within permitted limits	x	NA		
83	Automatic electrical protective devices are set correctly	x	NA		
84	Protective gas inlet temperature is below maximum specified	x	NA		
85	Ducts, pipes and enclosures are in good condition	x	NA		
86	Protective gas is substantially free from contaminants	x	NA		
87	Protective gas pressure and/or flow is adequate	x	NA		
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA		
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA		
90	Specific conditions of use (if applicable) are complied with		NA		
Extra Ex i (Intrinsically Safe – IS) checks					
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA		
92	Cables are installed in accordance with the documentation	x	NA		
93	Segregation is maintained between IS and non-IS Circuits	x	NA		
94	Cable screens are isolated at one end (field side)	x	NA		
95	Cable screens are earthed in accordance with the documentation	x	NA		
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA		
97	Equipment installed is the one specified in the documentation	x	NA		
98	Ambient temperature range of the apparatus is correct for the installation	x	NA		
99	Service temperature range of the apparatus is correct for the installation	x	NA		
100	Installation is clearly labelled	x	NA		
101	Printed circuit boards are clean and undamaged	x	NA		
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA		
103	Point-to-point connections are all correct	x	NA		
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA		
105	Earth connections maintain the integrity of the type of protection	x	NA		
106	Intrinsically safe circuit earthing is satisfactory	x	NA		
107	Insulation resistance is satisfactory	x	NA		
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA		

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA

Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	VENDOR ROTORK (PER FLUITEK)	RM (ROSETTI MARINO)	
Name	Stefano Linari	Giovanni Tangianu	
Date	2025-04-24	2025-04-24	
Signature	Digitaly signed by Stefano Linari 2025-04-24T13:22:38.875Z	Digitaly signed by Giovanni Tangianu 2025-04-24T15:19:58.936Z	

ROTORK CONTROLS ITALIA srl
Via Portico 17
24050 Orio Al Serio (BG)

Telefono: 0039 (0)5832221

E-mail: rotork.italia@rotork.com



WIKA Product Pass Italiano

serial number

WIKA

25-xv-020

Type 23X.50

Manometro a molla tubolare 232.50/233.50
Cassa in acciaio inox

Serial number:

PW00DE2KV3T

Item number:

57424821

Manufacturing date:

04/2025



ITEM	Tag	25-PG -020	: Air Set Pressure Gauge Filter - Vessel V-25001F Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80020
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10004829	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK	Discipline: ATEX	Form: CJX01 — Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**	8975GNDZ				
Manufacturer	Wika			**Model**	233.50.63				
Cert No.	D.o.C. by Manufacturer, reference 11564220			**Equipment Ambient Temp.**	-20 °C to +60 °C				
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP65

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PG -020	: Air Set Pressure Gauge Filter - Vessel V-25001F Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80020
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004829	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-PG -020	: Air Set Pressure Gauge Filter - Vessel V-25001F Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80020
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004829	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-31	2025-02-01	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-31T09:38:57.915Z	PROVERLIS Digitaly signed by Luca Mussi 2025-02-01T12:59:32.298Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

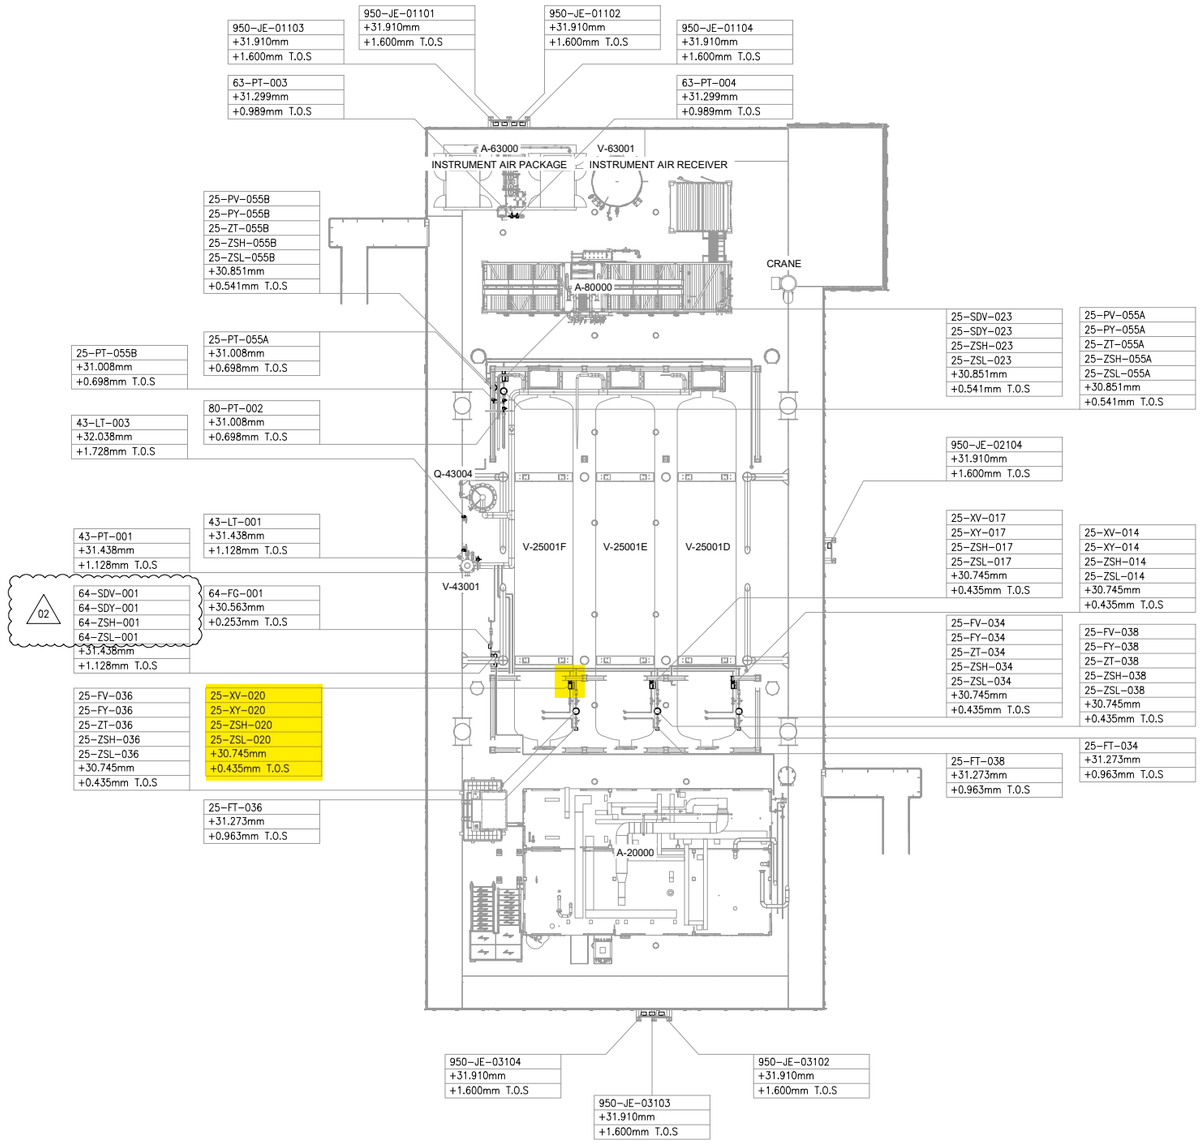


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90-DDL-IN-DL-40081	001	02

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001_F

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

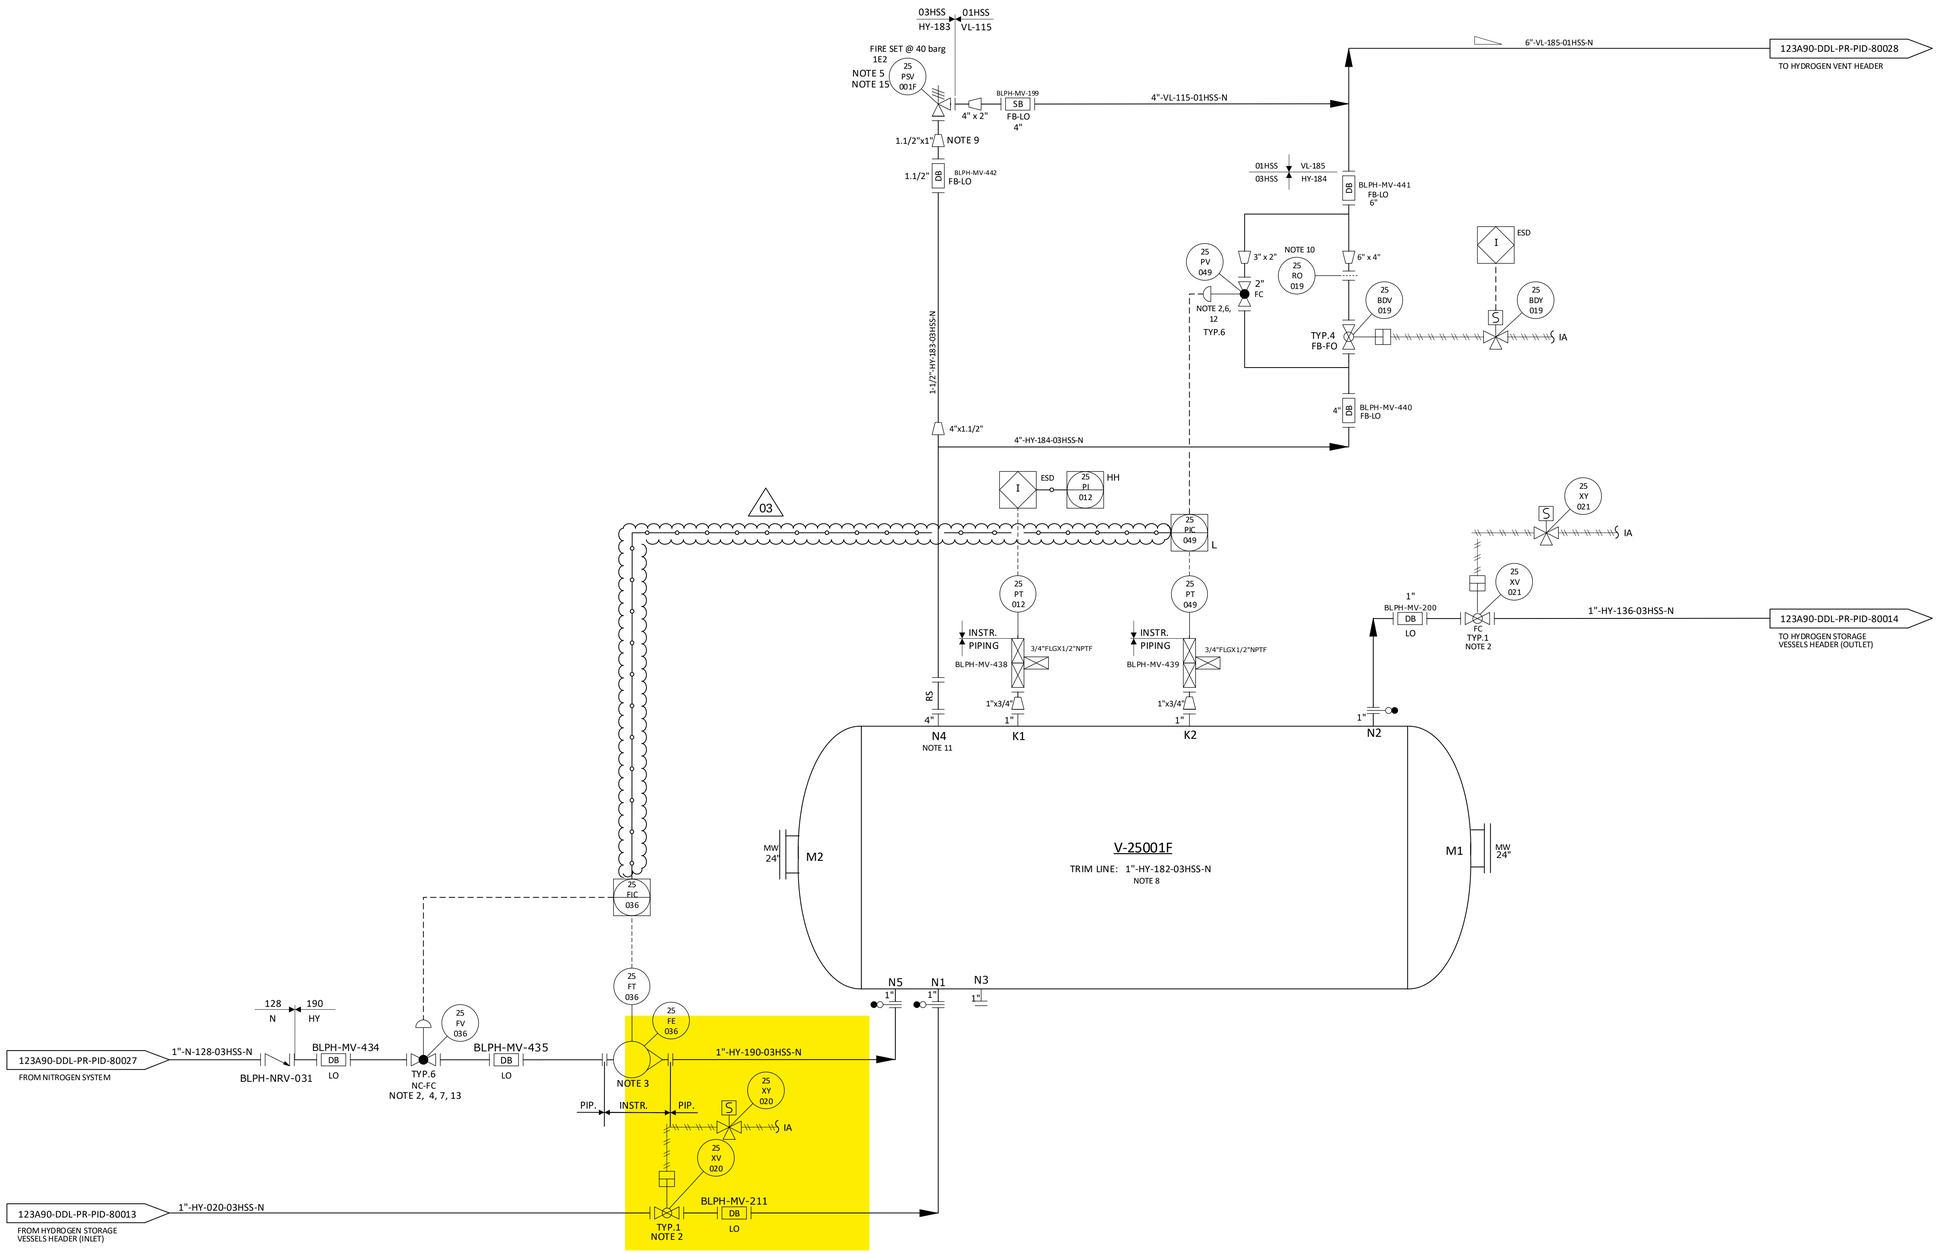

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-036) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-049 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-049 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25FV036 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-049 HAS FAILED TO CLOSE.
15. 25-PSV-001F SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR HAZOP (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL F

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80020		SHEET 001	REV. 03

File Name = FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

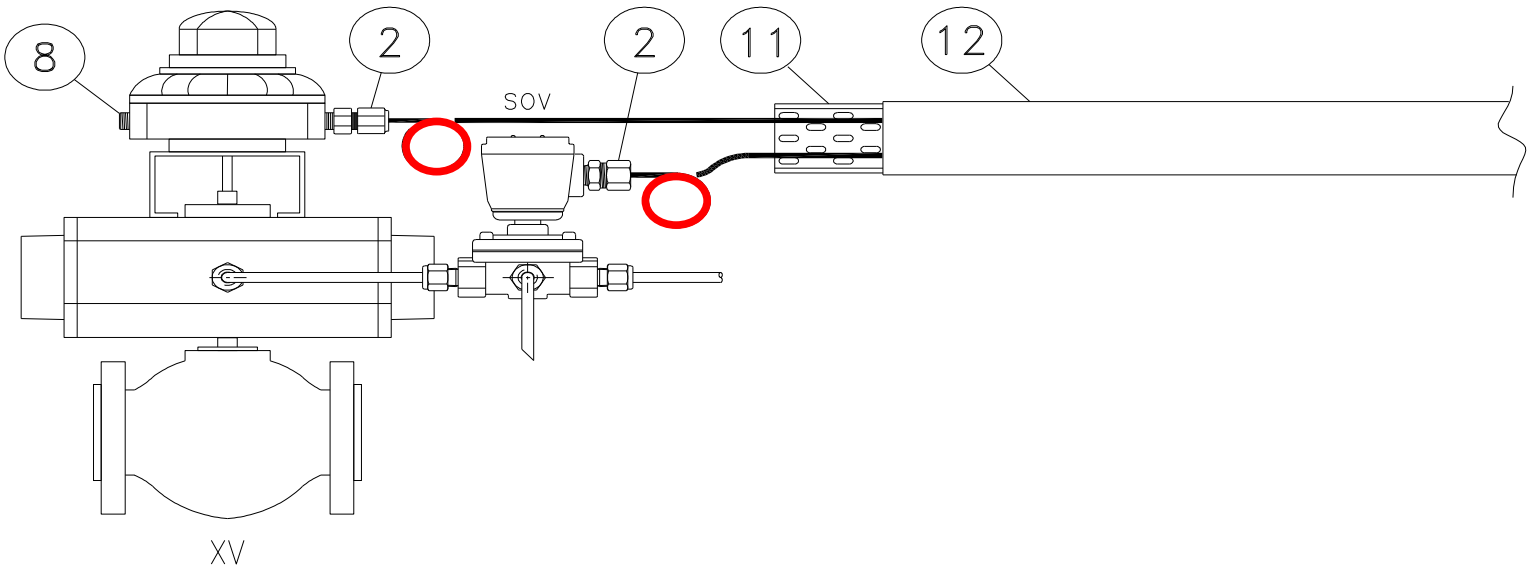

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

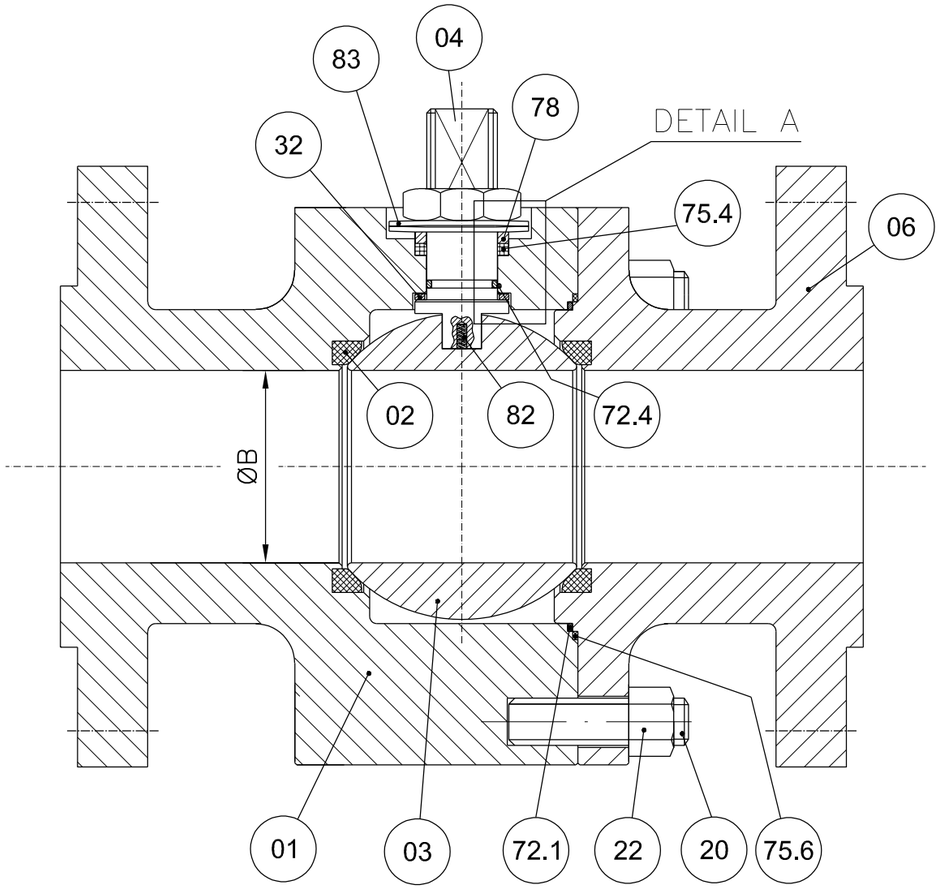




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

1 Rev.

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

1 Rev.

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: **D240062-08** Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-020		25
	2	Service				HYDROGEN STORAGE TANK V-25001F INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80020		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-020-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-020 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-020 (9, 17) - Soldo SS		25-ZSH-020 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

140	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
141	IFR	25-XV-020	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
142	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
143	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620210001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
144	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
145	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
146	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323304	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
147	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
148	IFR	25-XV-021	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
149	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
150	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620220001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
151	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
152	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
153	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323297	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
154	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
155	IFR	25-XV-024	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
156	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
157	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620230001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
158	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
159	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
160	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323291	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
161	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
162	IFR	50-XV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
163	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
164	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620240001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
165	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
166	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
167	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323289	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
168	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
169	IFR	50-XV-002	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
170	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
171	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620250001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
172	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
173	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
174	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323290	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
175	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
176	IFR	50-XV-003	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
177	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
178	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620260001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
179	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
180	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
181	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323299	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
182	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
183	IFR	50-XV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
184	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
185	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620270001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
186	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

Bourdon tube pressure gauge, stainless steel
For the process industry, standard version
Models 232.50, 233.50, NS 63 [2 ½"], 100 [4"] and 160 [6"]

For further approvals, see page 6

Applications

- For gaseous and liquid aggressive media that are not highly viscous or crystallising, also in aggressive environments
- Chemical and petrochemical industries, oil and gas industry, power engineering and also water and wastewater technology
- Machine building and general plant construction

Special features

- Excellent load cycle stability and shock resistance
- With case filling (model 233.50) for applications with high dynamic pressure loads and vibrations
- Completely from stainless steel
- Scale ranges from 0 … 0.6 to 0 … 1,600 bar or 0 ... 10 to 0 ... 20,000 psi
- QR code on dial links to instrument-specific information



Bourdon tube pressure gauge, model 232.50, NS 100 [4"]

Description

This high-quality Bourdon tube pressure gauge has been designed especially for the process industry.

The use of high-quality stainless steel materials and the robust design are geared to applications in the chemical and process engineering industries. Thus the instrument is suitable for liquid and gaseous media, also in aggressive environments.

Scale ranges of 0 … 0.6 to 0 … 1,600 bar [0 ... 10 to 0 ... 20,000 psi] ensure the measuring ranges required for a wide variety of applications.

WIKA manufactures and qualifies the pressure gauge in accordance with the standards EN 837-1 and ASME B40.100. As a safety function, this instrument has a blow-out device with blow-out plug on the back of the case. In the event of a failure, overpressure can escape there.

The model 233.50 with liquid-filled case is suitable for high dynamic pressure loads and vibrations.

The QR code on the dial allows instrument-specific information such as the serial number, the order number, certificates and other product data to be retrieved from the internet easily and in the long term.

Smart in sensing

Data sheets showing similar products:
Stainless steel, safety version; see data sheet PM 02.04
Bourdon tube pressure gauge with switch contacts; see data sheet PV 22.02
Monel version; see data sheet PM 02.33
Pressure gauge per EN 837-1 with mounted diaphragm seal; see data sheet DS 95.12

Specifications

Basic information	
Standard	■ EN 837-1 ■ ASME B40.100
	For information on the “Selection, installation, handling and operation of pressure gauges”, see technical information IN 00.05.
Further version	■ Oil- and grease-free for oxygen ■ Per NACE [1] MR0175 / ISO 15156, use in H_2S-containing environments in oil and gas production ■ With pre-volume deflagration flame arrester [2] for mounting to zone 0 (EPL Ga); model 910.21; see data sheet AC 91.02 ■ Monel version; models 262 and 263; see data sheet PM 02.33
Nominal size (NS)	■ Ø 63 mm [2 ½"] ■ Ø 100 mm [4"] ■ Ø 160 mm [6"]
Connection location	■ Lower mount (radial) ■ Lower back mount ■ Centre back mount (only for NS 63 [2 ½"])
Window	Laminated safety glass (NS 63 [2 ½"]: Polycarbonate)
Case	
Design	Safety level “S1” per EN 837-1 With blow-out device at case circumference, 12 o'clock (NS 63 [2 ½"]) and on the back of the case (NS 100 [4"] and 160 [6"]) Scale ranges ≤ 0 ... 16 bar [≤ 0 ... 300 psi] with compensating valve to vent and reseal case
Material	■ Stainless steel 1.4301 (304) ■ Stainless steel 1.4571 (316Ti)
Ring	Bayonet ring, stainless steel
Mounting	■ Without ■ Panel mounting flange, stainless steel ■ Panel mounting flange, polished stainless steel ■ Triangular profile ring with mounting bracket, polished stainless steel ■ Surface mounting flange, stainless steel
Case filling (model 233.50)	■ Without ■ Glycerine ■ Glycerine-water mixture for NS 100 [4"] and 160 [6"] with scale range ≤ 0 ... 2.5 bar [≤ 0 ... 40 psi] or for NS 63 [2 ½"] with scale range ≤ 0 ... 4 bar [≤ 0 ... 60 psi] ■ Silicone oil
Movement	■ Stainless steel ■ Stainless steel 1.4404 (316L) ■ everlast® version

1) General information about NACE standards; see data sheet IN 00.21
2) Only for instruments with Ex approval

Measuring element	
Type of measuring element	Bourdon tube, C-type or helical type
Material	Stainless steel 1.4404 (316L)
Leak tightness	■ Helium tested, leakage rate: $< 5 \cdot 10^{-3}$ mbar l/s ■ Helium tested, leakage rate: $< 1 \cdot 10^{-6}$ mbar l/s

Accuracy specifications		
Accuracy class		
NS 63 [2 ½"]	■ EN 837-1	Class 1.6
	■ ASME B40.100	±2 % | ±1 % | ±2 % of measuring span (grade A)
NS 100 [4"], 160 [6"]	■ EN 837-1	Class 1.0
	■ ASME B40.100	±1 % of measuring span (grade 1A)
Temperature error	On deviation from the reference conditions at the measuring system: ≤ ±0.4 % per 10 °C [≤ ±0.4 % per 18 °F] of full scale value	
Reference conditions		
Ambient temperature	+20 °C [+68 °F]	

Scale ranges

bar	
0 ... 0.6 [1]	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160
0 ... 4	0 ... 250
0 ... 6	0 ... 400
0 ... 10	0 ... 600
0 ... 16	0 ... 1,000
0 ... 25	0 ... 1,600

kg/cm²	
0 ... 0.6 [1]	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160
0 ... 4	0 ... 250
0 ... 6	0 ... 400
0 ... 10	0 ... 600
0 ... 16	0 ... 1,000
0 ... 25	0 ... 1,600

kPa	
0 ... 60 [1]	0 ... 4,000
0 ... 100	0 ... 6,000
0 ... 160	0 ... 10,000
0 ... 250	0 ... 16,000
0 ... 400	0 ... 25,000
0 ... 600	0 ... 40,000
0 ... 1,000	0 ... 60,000
0 ... 1,600	0 ... 100,000
0 ... 2,500	0 ... 160,000

MPa	
0 ... 0.06 [1]	0 ... 4
0 ... 0.1	0 ... 6
0 ... 0.16	0 ... 10
0 ... 0.25	0 ... 16
0 ... 0.4	0 ... 25
0 ... 0.6	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160

psi	
0 ... 10 [1]	0 ... 1,000
0 ... 15	0 ... 1,500
0 ... 30	0 ... 2,000
0 ... 60	0 ... 3,000
0 ... 100	0 ... 4,000
0 ... 160	0 ... 5,000
0 ... 200	0 ... 6,000
0 ... 300	0 ... 7,500
0 ... 400	0 ... 10,000
0 ... 600	0 ... 15,000
0 ... 800	0 ... 20,000

1) Not available for NS 63 [2 ½"]

Vacuum and +/- scale ranges

bar	
-0.6 ... 0 [1]	-1 ... +5
-1 ... 0	-1 ... +9
-1 ... +0.6	-1 ... +15
-1 ... +1.5	-1 ... +24
-1 ... +3	

MPa	
-0.06 ... 0 [1]	-0.1 ... +0.5
-0.1 ... 0	-0.1 ... +0.9
-0.1 ... +0.06	-0.1 ... +1.5
-0.1 ... +0.15	-0.1 ... +2.4
-0.1 ... +0.3	

kPa	
-60 ... 0 [1]	-100 ... +500
-100 ... 0	-100 ... +900
-100 ... +60	-100 ... +1,500
-100 ... +150	-100 ... +2,400
-100 ... +300	

psi	
-30 inHg ... 0	-30 inHg ... +100
-30 inHg ... +15	-30 inHg ... +160
-30 inHg ... +30	-30 inHg ... +200
-30 inHg ... +60	-30 inHg ... +300

1) Not available for NS 63 [2 ½"]

Further details on: scale ranges	
Special scale ranges	Other scale ranges on request
Unit	■ bar ■ psi ■ kg/cm² ■ kPa ■ MPa
Increased overload safety	■ Without ■ 2 times ■ 3 times ■ 4 times ■ 5 times
	The possibility of selection depends on scale range and nominal size
Vacuum resistance	■ Without ■ Vacuum-resistant to -1 bar
Dial	
Scale colour	Black
Material	Aluminium
Special scale	■ Without ■ With temperature scale for refrigerant, e.g. for NH_3: R 717
	Other scales or customer-specific dials, e.g. with red mark, circular arcs or circular sectors, on request
Pointer	
Instrument pointer	Aluminium, black
Mark pointer/drag pointer	■ Without ■ Red mark pointer on dial, fixed ■ Red mark pointer on window, adjustable ■ Mark pointer on bayonet ring, adjustable ■ Red drag pointer on window, adjustable
Pointer stop pin	■ Without ■ At zero point (only for NS 63 [2 ½"]) ■ At 6 o'clock (only for NS 100 [4"], 160 [6"])

Process connection		
Standard	■ EN 837-1 ■ ISO 7 ■ ANSI/B1.20.1	
Size		
EN 837-1	■ G ⅛ B, male thread ■ G ¼ B, male thread ■ G ½ B, male thread ■ M12 x 1.5, male thread ■ M20 x 1.5, male thread	
ISO 7	■ R ¼, male thread ■ R ½, male thread	
ANSI/B1.20.1	■ ¼ NPT, male thread ■ ½ NPT, male thread	
Restrictor	■ Without ■ Ø 0.6 mm [0.024"], stainless steel ■ Ø 0.3 mm [0.012"], stainless steel	
Material (wetted)		
Process connection	Stainless steel 1.4404 (316L)	
Bourdon tube	Stainless steel 1.4404 (316L)	

→ Other process connections on request

Operating conditions		
Medium temperature		
Unfilled instruments	-40 ... +200 °C [-40 ... +392 °F]	
Instruments with glycerine filling	-20 ... +100 °C [-4 ... +212 °F]	
Instruments with silicone oil filling	-40 ... +100 °C [-40 ... +212 °F]	
Ambient temperature		
Unfilled instruments or with silicone oil filling	-40 ... +60 °C [-40 ... +140 °F]	
Instruments with glycerine filling	-20 ... +60 °C [-4 ... +140 °F]	
Pressure limitation		
NS 63 [2 ½"]	Steady	3/4 x full scale value
	Fluctuating	2/3 x full scale value
	Short time	Full scale value
NS 100 [4"], 160 [6"]	Steady	Full scale value
	Fluctuating	0.9 x full scale value
	Short time	1.3 x full scale value
Ingress protection per IEC/EN 60529	■ IP65 ■ IP66 (only selectable for scale ranges ≥ 0 ... 20 bar [0 ... 400 psi])	

Approvals

Logo	Description	Region
CE	**EU declaration of conformity** Pressure equipment directive PS > 200 bar, module A, pressure accessory	European Union
UKCA	**UKCA** Pressure equipment (safety) regulations	United Kingdom
-	**CRN** Safety (e.g. electr. safety, overpressure, ...) For full scale value ≤ 1,000 bar	Canada

Optional approvals

Logo	Description	Region
CE Ex	**EU declaration of conformity** ATEX directive Hazardous areas - Ex h Gas II 2G Ex h IIC T6 ... T1 Gb X Dust II 2D Ex h IIIC T85°C ... T450°C Db X	European Union
UKCA	**UKCA** Equipment and protective systems intended for use in potentially explosive atmospheres regulations	United Kingdom
EAC Ex	**EAC** Hazardous areas	Eurasian Economic Community
	Ex Ukraine Hazardous areas	Ukraine
	PAC Kazakhstan Metrology, measurement technology	Kazakhstan
-	**MChS** Permission for commissioning	Kazakhstan
-	**PAC Ukraine** Metrology, measurement technology	Ukraine
	PAC Uzbekistan Metrology, measurement technology	Uzbekistan
-	**PAC China** Metrology, measurement technology	China
	DNV Ships, shipbuilding (e.g. offshore)	International
-	**KBA** [1] Automotive	International
	Hydrogen-powered motor vehicles - (EC) no. 79/2009 and (EU) no. 406/2010	
	Components for motor vehicles using natural gas (CNG/LNG) – UN no. R 110	

1) Not available for all versions

Manufacturer's declaration

Logo	Description
-	Pressure equipment directive (PED) for maximum allowable pressure PS ≤ 200 bar
-	Suitability of wetted materials for drinking water in accordance with the European 4MS initiative
-	Suitability of wetted materials for hydrogen


Certificates (option)

Certificates	
Certificates	■ 2.2 test report per EN 10204 (e.g. state-of-the-art manufacturing, indication accuracy) ■ 3.1 inspection certificate per EN 10204 (e.g. material proof for wetted metal parts, indication accuracy) ■ PCA calibration certificate, traceable and accredited in accordance with ISO/IEC 17025 ■ Calibration certificate by a national accreditation body, traceable and accredited in accordance with ISO/IEC 17025 on request
Recommended calibration interval	1 year (dependent on conditions of use)

→ For approvals and certificates, see website

Dimensions in mm [in]

Lower mount (radial)

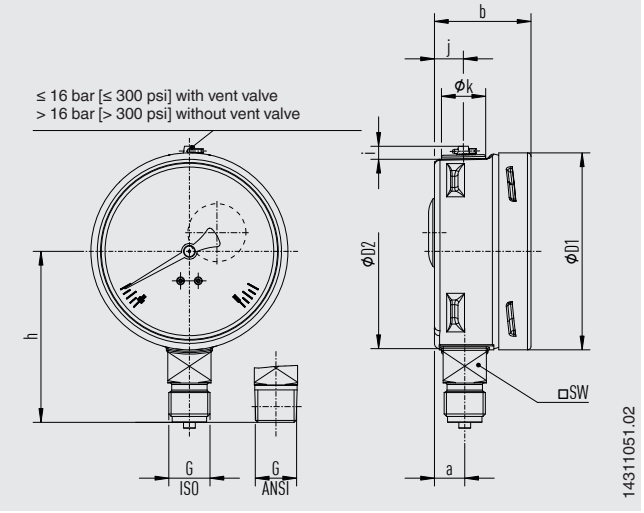

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]
100 [4"]	approx. 0.6 kg [1.32 lbs]	approx. 0.9 kg [1.98 lbs]
160 [6"]	approx. 1.1 kg [2.43 lbs]	approx. 2.0 kg [4.41 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	G ¼ B	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	51 [2.01]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	G ¼ B	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	87 [3.43]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	87 [3.43]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	G ¼ B	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	118 [4.65]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	118 [4.65]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ISO 7


NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	R ¼	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	R ¼	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	86 [3.39]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	R ¼	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	117 [4.60]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	¼ NPT	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	51 [2.01]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	¼ NPT	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	86 [3.39]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	¼ NPT	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	117 [4.60]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

1) Plus 16 mm [0.630 in] with scale range 0 ... 1,600 bar [0 ... 20,000 psi]

Lower back mount

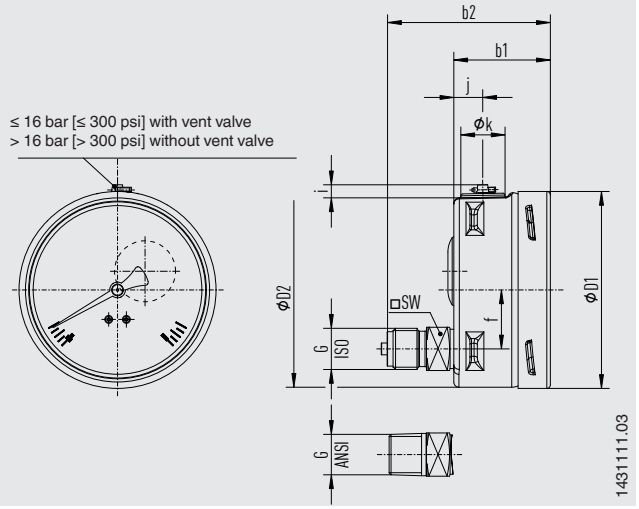

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]
100 [4"]	approx. 0.6 kg [1.32 lbs]	approx. 0.9 kg [1.98 lbs]
160 [6"]	approx. 1.1 kg [2.43 lbs]	approx. 2.0 kg [4.41 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	G ¼ B	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	33 [1.30]	54 [2.13]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	G ¼ B	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	49.5 [1.95]	83 [3.27]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	49.5 [1.95]	83 [3.27]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	G ¼ B	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	51.5 [2.03] 1)	85 [3.24] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	51.5 [2.03] 1)	85 [3.24] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ISO 7


NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	R ¼	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	R ¼	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	49.5 [1.95]	82 [3.23]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	R ¼	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	51.5 [2.03] 1)	84 [3.31] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	¼ NPT	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	50 [1.97]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	33 [1.30]	54 [2.13]	63 [2.48]	62 [2.44]	50 [1.97]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	¼ NPT	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	49.5 [1.95]	82 [3.23]	101 [3.98]	99 [3.90]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	¼ NPT	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	51.5 [2.03] 1)	84 [3.31] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

1) Plus 16 mm [0.630 in] with scale ranges ≥ 0 ... 100 bar [≥ 0 ... 1,500 psi]

NS 63 [2 ½"], centre back mount

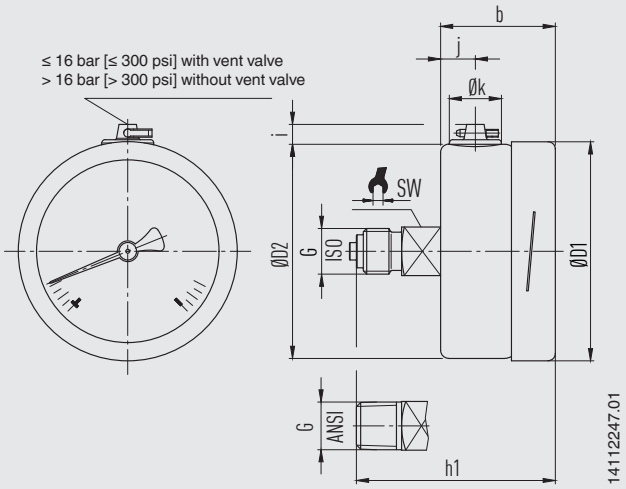

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	G ¼ B	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	54 [2.13]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]

Process connection with thread per ISO 7

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	R ¼	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]


Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	¼ NPT	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	54 [2.13]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]


Accessories

Dimensions in mm [in]

Panel mounting flange

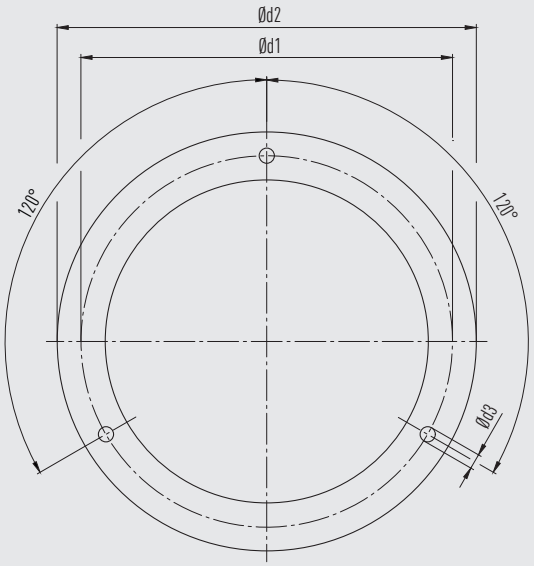


Surface mounting flange

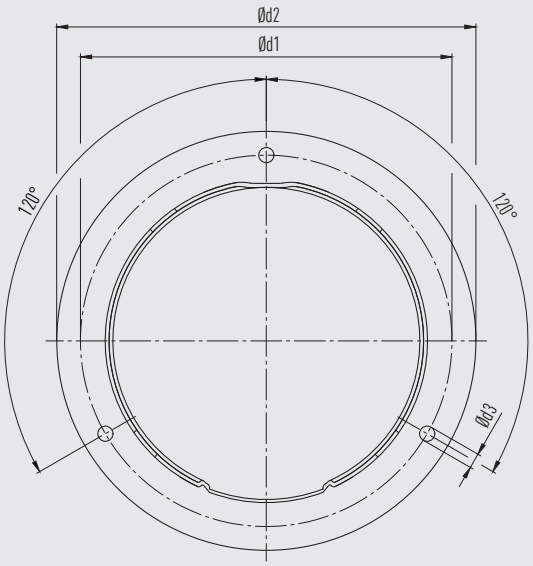


NS	Dimensions in mm [in]			
	Recommended panel cutout	d1	d2	d3
63 [2 ½"]	Ø 67 ±0.3 / Ø 2.6 [Ø 2.64 ±0.01 / Ø 0.10]	75 [2.95]	85 [3.35]	3.6 [0.14]
100 [4"]	Ø 104 ±0.5 / Ø 4.1 [Ø 4.04 ±0.02 / Ø 0.16]	117 [4.60]	132 [5.20]	4.8 [0.19]
160 [6"]	Ø 164 ±0.5 / Ø 6.5 [Ø 6.46 ±0.02 / Ø 0.26]	178 [7.01]	196 [7.72]	5.8 [0.23]

Triangular profile ring

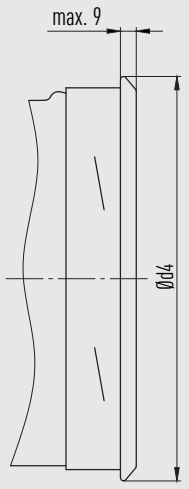

NS	Dimensions in mm [in]	
	Recommended panel cutout	d4
63 [2 ½"]	Ø 64.5 ±0.5 / Ø 2.5 [Ø 2.54 ±0.02 / Ø 0.01]	≤ 69 [2.72]
100 [4"]	Ø 102 ±1.0 / Ø 4.0 [Ø 4.02 ±0.04 / Ø 0.16]	≤ 108 [4.25]
160 [6"]	Ø 162.6 ±1.0 / Ø 6.4 [Ø 6.40 ±0.04 / Ø 0.25]	≤ 168 [6.61]

Accessories and spare parts

Model		Description
	**910.17**	Seals → See data sheet AC 09.08
	**910.15**	Syphons → See data sheet AC 09.06
	**910.13**	Overpressure protector → See data sheet AC 09.04
	**IV10, IV11**	Needle valve and multiport valve → See data sheet AC 09.22
	**IV20, IV21**	Block-and-bleed valve → See data sheet AC 09.19
	**IVM**	Monoflange, process and instrument version → See data sheet AC 09.17
	**BV**	Ball valve, process and instrument version → See data sheet AC 09.28
	**IBF2, IBF3**	Monoblock with flange connection → See data sheet AC 09.25

Ordering information

Model / Nominal size / Scale range / Process connection / Connection location / Options

© 02/1995 WIKA Alexander Wiegand SE & Co. KG, all rights reserved.
The specifications given in this document represent the state of engineering at the time of publishing.
We reserve the right to make modifications to the specifications and materials.
In case of a different interpretation of the translated and the English data sheet, the English wording shall prevail.

WIKA Alexander Wiegand SE & Co. KG
Alexander-Wiegand-Straße 30
63911 Klingenberg/Germany
Tel. +49 9372 132-0
info@wika.de
www.wika.de

EU-Konformitätserklärung
EU Declaration of Conformity

Dokument Nr. / ***Document No.*** **11564220** — **Revision** / ***Issue*** **07**

Wir erklären in alleiniger Verantwortung, dass die mit CE gekennzeichneten Produkte
We declare under our sole responsibility that the CE marked products

Typenbezeichnung / ***Type Designation***

23a.50.063 + option ATEX | **23a.50.1*0 + option ATEX**
26a.50.063 + option ATEX | **26a.50.1*0 + option ATEX**
23a.30.063 + option ATEX | **23a.30.1*0 + option ATEX**
26a.30.063 + option ATEX | **26a.30.1*0 + option ATEX**
23a.53.063 + option ATEX | **23a.53.100 + option ATEX**
23a.54.063 + option ATEX | **23a.54.100 + option ATEX**
23a.36.1*0 + option ATEX
PG23LT.063 + option ATEX | **PG23LT.1*0 + option ATEX**
PG23CP.063 + option ATEX | **PG23CP.100 + option ATEX**
PG28.1*0 + option ATEX
PG23HP-S.1*0 + option ATEX | **PG23HP-P.1*0 + option ATEX**

*** Nominal size**
0 = 100mm
6 = 160mm

a Case filling
2 = Without case filling
3 = With case filling

Beschreibung / ***Description***: **Rohrfederdruckmessgerät** / ***Bourdon Tube Pressure Gauge***

gemäß gültigem Datenblatt / *according to the valid data sheet*: PM 02.02, PM 02.04, PM 02.12, PM 02.15, PM 02.22, PM 02.24, PM 02.32, PM 02.28, PM 02.29

mit den nachfolgenden relevanten Harmonisierungsvorschriften der Union übereinstimmen
are in conformity with the following relevant Union harmonisation legislation

Angewandte harmonisierte Normen oder sonstige technische Spezifikationen:
Applied harmonised standards or other technical specifications:

2014/68/EU	Druckgeräterichtlinie (DGRL) (1) *Pressure Equipment Directive (PED)* (1)	
2014/34/EU	Explosionsschutz (ATEX) (2) *Explosion protection (ATEX)* (2)	
Ex	II 2G Ex h IIC T6 … T1 Gb X II 2D Ex h IIIC T85 °C … T450 °C Db X	EN ISO 80079-36 :2016 EN ISO 80079-37 :2016

(1) PS > 200 bar; Modul A, druckhaltendes Ausrüstungsteil
PS > 200 bar; Module A, pressure accessory

(2) Modul A „interne Fertigungskontrolle“. Die Dokumentation ist hinterlegt unter der Nummer 074/24 bei der Notifizierten Stelle der EU, IBExU Institut für Sicherheitstechnik GmbH (EU ID-Nr. 0637).
Module A “Internal Control of Production”. The Documentation is deposited under registration number 074/24 at Notified Body of EU, IBExU Institut für Sicherheitstechnik GmbH (EU ID 0637). .

Unterzeichnet für und im Namen von / *Signed for and on behalf of*

WIKA Alexander Wiegand SE & Co. KG

Klingenberg, 2024-04-24


Sascha Schnellbacher, Vice President
CoE Gauges, Sensors & Instruments

Mariusz Lubomski, Director of Quality
CoE Gauges, Sensors & Instruments


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

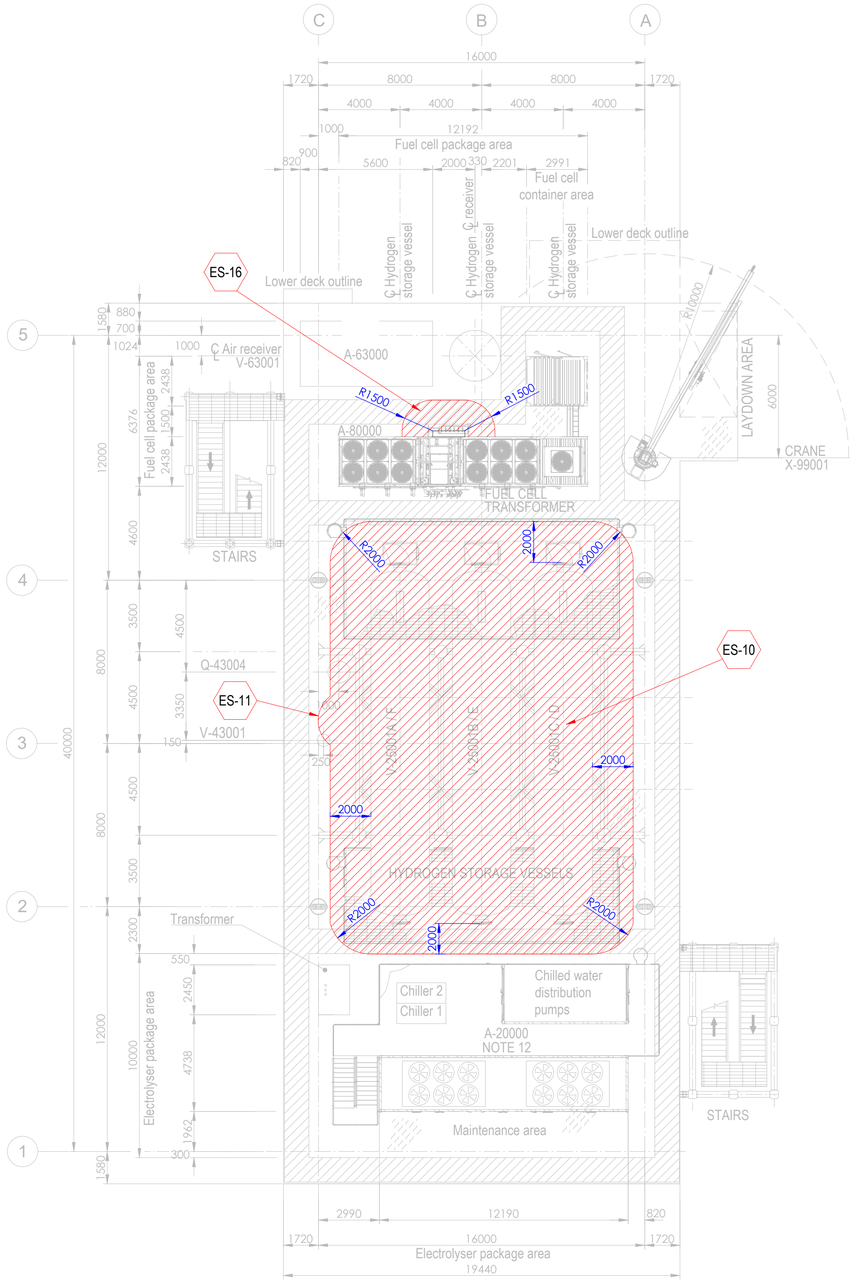


PLAN ON UPPER DECK
EL+30.310 T.O.S.

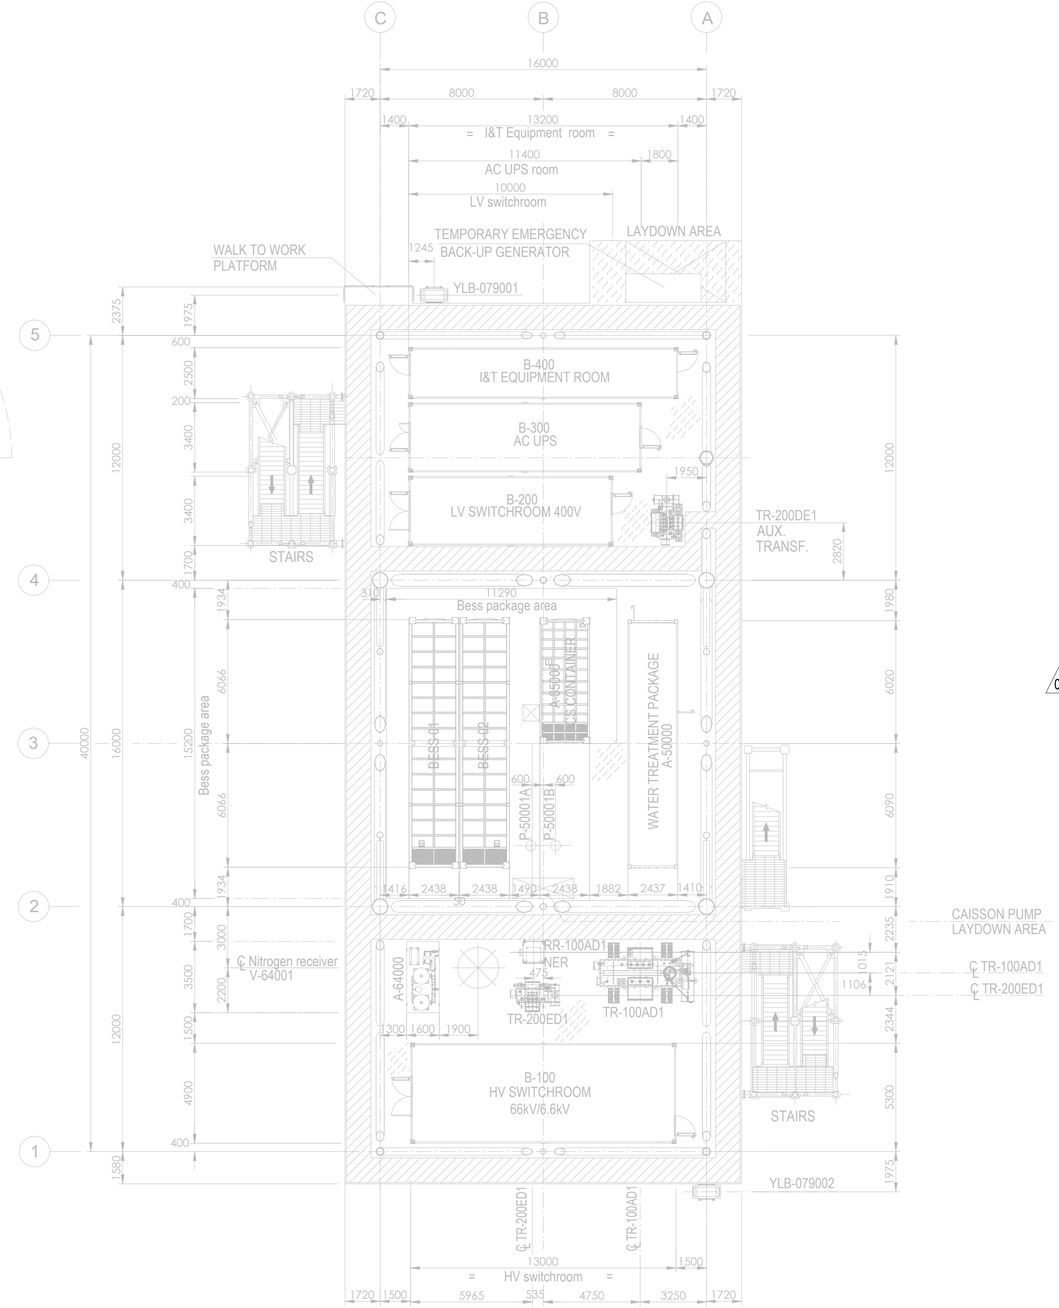

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

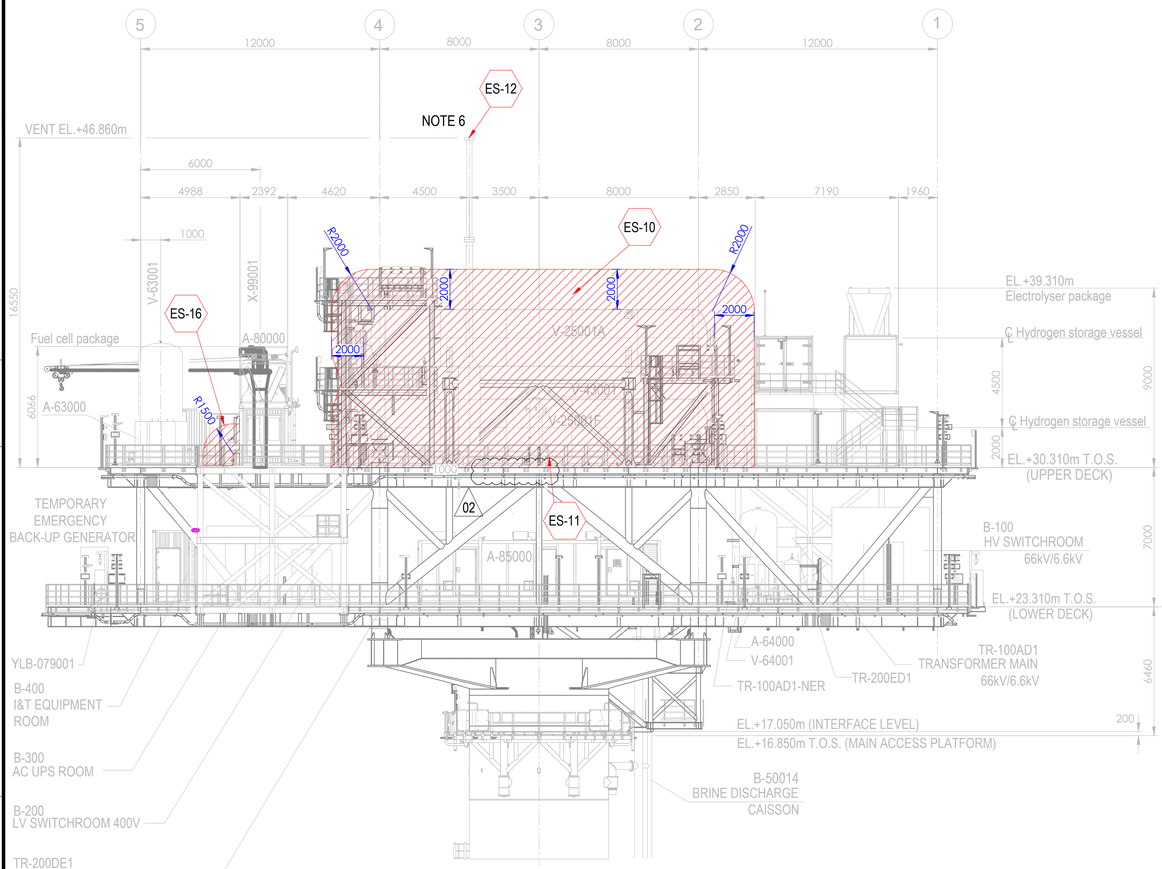



ELEVATION LOOKING EAST

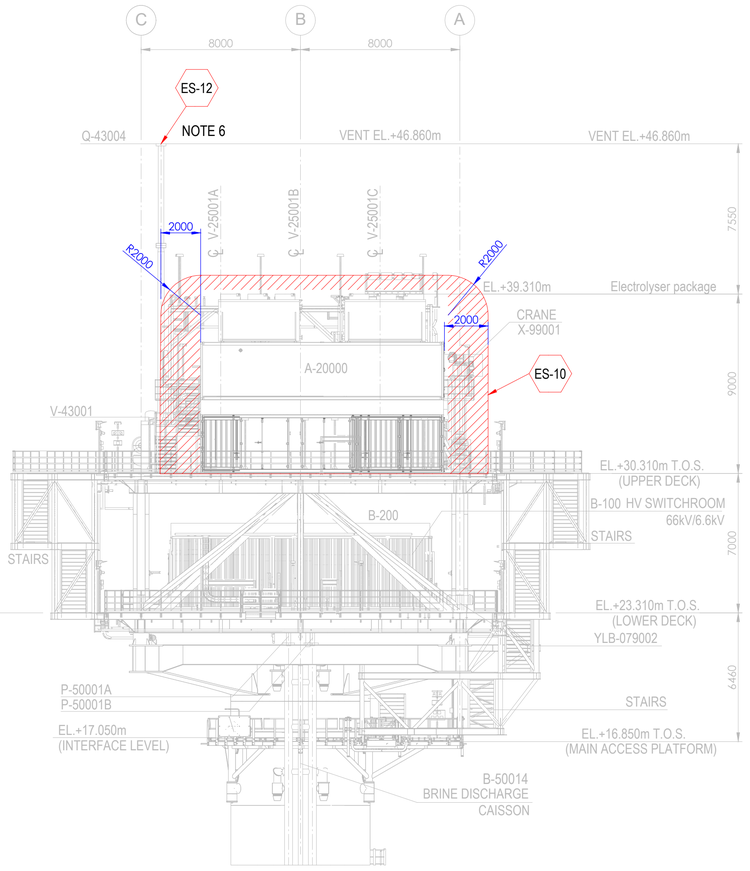

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

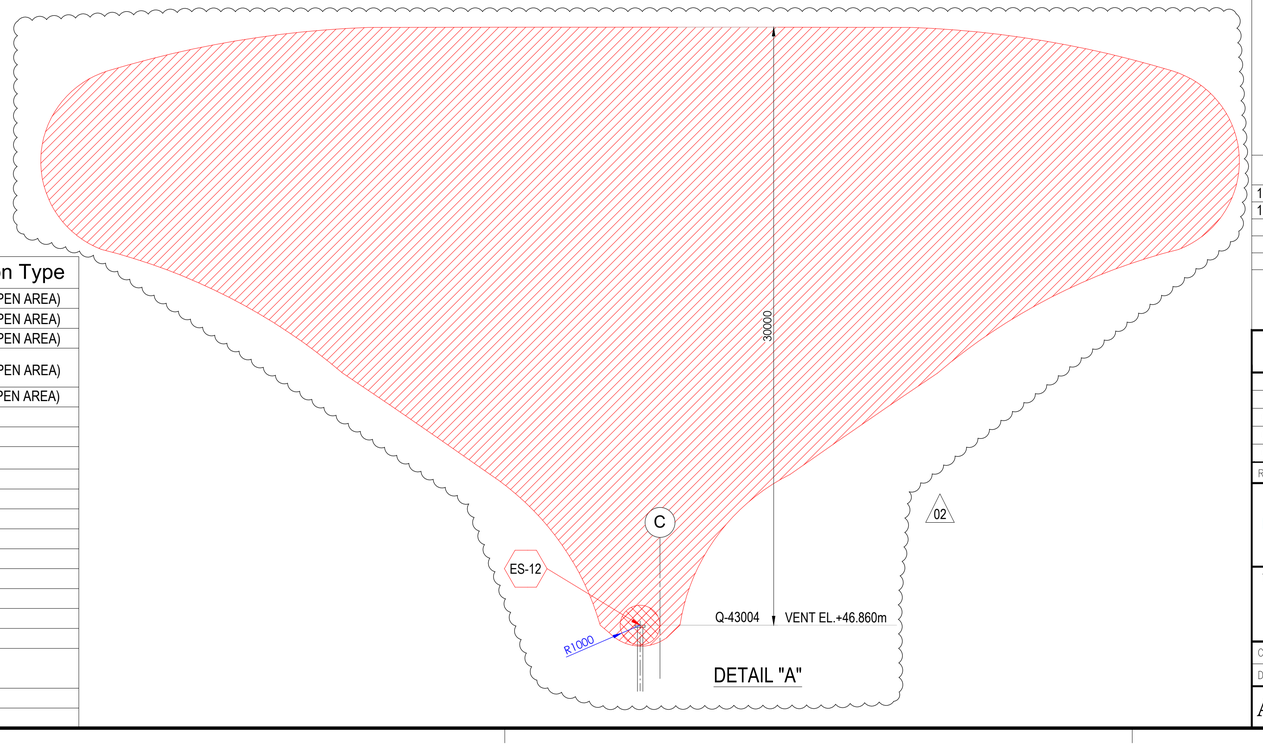



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PG -024	: Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Vent System		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10004831	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		PW00DE2MD3D			
Manufacturer	Wika			**Model**		233.50.63			
Cert No.	D.o.C. by Manufacturer reference 11564220			**Equipment Ambient Temp.**		-20 °C to +60 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP65

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PG -024	: Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Vent System			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004831		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-PG -024	: Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Vent System			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004831	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline ATEX	Form CJX01		Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA

Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	VENDOR ROTORK (PER FLUITEK)	RM(ROSETTI MARINO)	
Name	Stefano Linari	Giovanni Tangianu	
Date	2025-04-24	2025-04-24	
Signature	Digitaly signed by Stefano Linari 2025-04-24T13:23:02.654Z	Digitaly signed by Giovanni Tangianu 2025-04-24T15:00:21.629Z	

ROTORK CONTROLS ITALIA srl
Via Portico 17
24050 Orio Al Serio (BG)

Telefono: 0039 (0)5832221

E-mail: rotork.italia@rotork.com



WIKA Product Pass Italiano

serial number

WIKA

25-xv-024

Type 23X.50

Manometro a molla tubolare 232.50/233.50
Cassa in acciaio inox

Serial number:

PW00DE2MD3D

Item number:

57424821

Manufacturing date:

04/2025



ITEM	Tag	25-PG -024	: Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Vent System		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10004831	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**	8975GNE2				
Manufacturer	Wika			**Model**	233.50.63				
Cert No.	D.o.C. by Manufacturer, reference 11564220			**Equipment Ambient Temp.**	-20 °C to +60 °C				
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP65

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	OK	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PG -024	: Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Vent System			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004831		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	25-PG -024	: Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Vent System			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004831		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 — Hazardous Area Equipment Detailed Inspection

	Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA		
68	Hermetically sealed and enclosed break devices are undamaged	x	NA		
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA		
70	Test port, if fitted, is functional (type “nR” only)	x	NA		
71	Breathing operation is satisfactory (type “nR” only)	x	NA		
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA		
73	The ventilation airflow is not impeded	x	NA		
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA		
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA		
76	Variable voltage/frequency installation complies with documentation	x	NA		
	Extra Ex p checks				
77	Pressurization gas is correct type	x	NA		
78	Actual pressure is within maximum and minimum settings for equipment	x	NA		
79	Timers set as per certification documentation	x	NA		
80	Alarms and trip functions operate correctly as per certification documentation	x	NA		
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA		
82	Automatic electrical protective devices operate within permitted limits	x	NA		
83	Automatic electrical protective devices are set correctly	x	NA		
84	Protective gas inlet temperature is below maximum specified	x	NA		
85	Ducts, pipes and enclosures are in good condition	x	NA		
86	Protective gas is substantially free from contaminants	x	NA		
87	Protective gas pressure and/or flow is adequate	x	NA		
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA		
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA		
90	Specific conditions of use (if applicable) are complied with		NA		
	Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA		
92	Cables are installed in accordance with the documentation	x	NA		
93	Segregation is maintained between IS and non-IS Circuits	x	NA		
94	Cable screens are isolated at one end (field side)	x	NA		
95	Cable screens are earthed in accordance with the documentation	x	NA		
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA		
97	Equipment installed is the one specified in the documentation	x	NA		
98	Ambient temperature range of the apparatus is correct for the installation	x	NA		
99	Service temperature range of the apparatus is correct for the installation	x	NA		
100	Installation is clearly labelled	x	NA		
101	Printed circuit boards are clean and undamaged	x	NA		
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA		
103	Point-to-point connections are all correct	x	NA		
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA		
105	Earth connections maintain the integrity of the type of protection	x	NA		
106	Intrinsically safe circuit earthing is satisfactory	x	NA		
107	Insulation resistance is satisfactory	x	NA		
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA		

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-30	2025-02-01	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-30T10:24:11.787Z	PROVERLIS Digitaly signed by Luca Mussi 2025-02-01T13:02:00.004Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

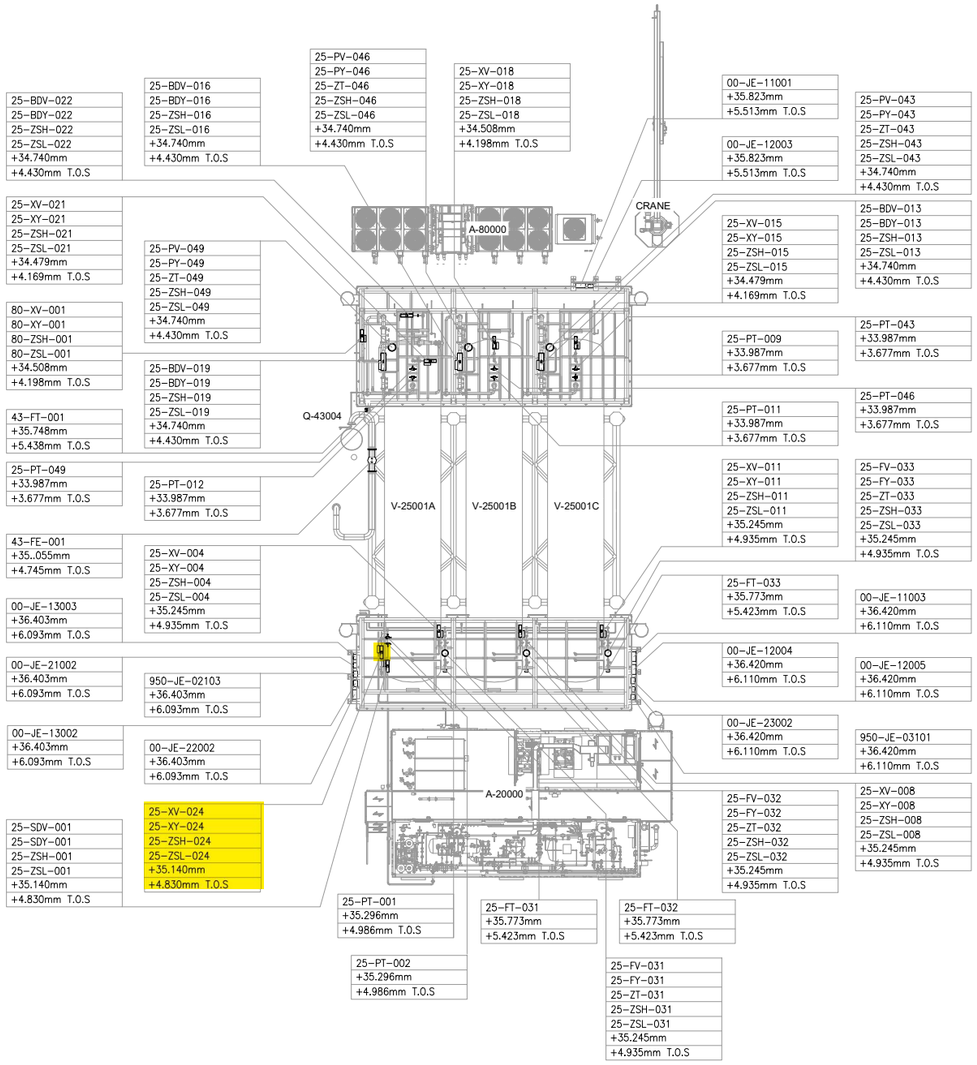

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

	DRAWING NO.	SHEET	REV.
A1	123A90–DDL–IN–DL–40081	002	02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. DRAWING_NO.

REV. REV

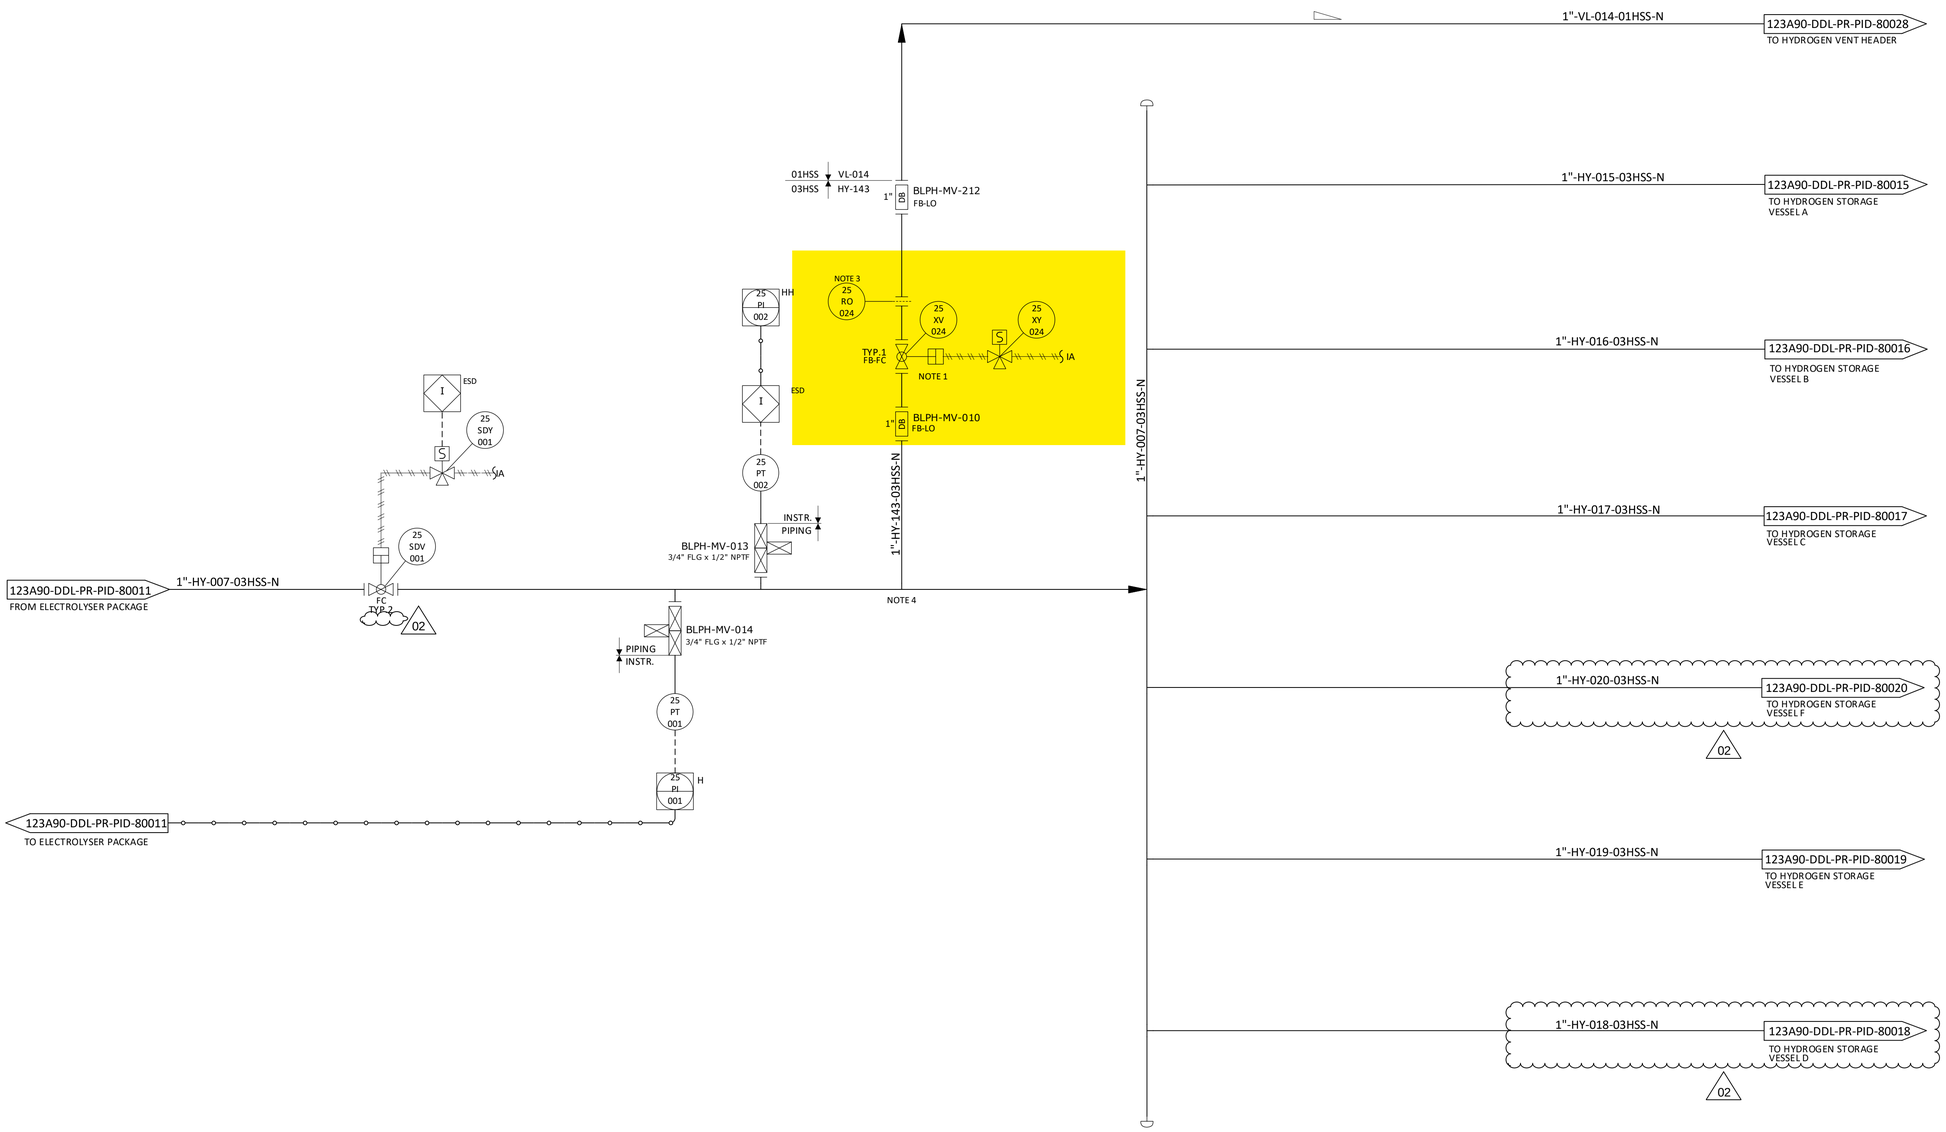

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :


BLPH PIPING AND INSTRUMENTATION DIAGRAM HYDROGEN STORAGE VESSELS HEADER (INLET)

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80013	SHEET 001	REV. 02

File Name : FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

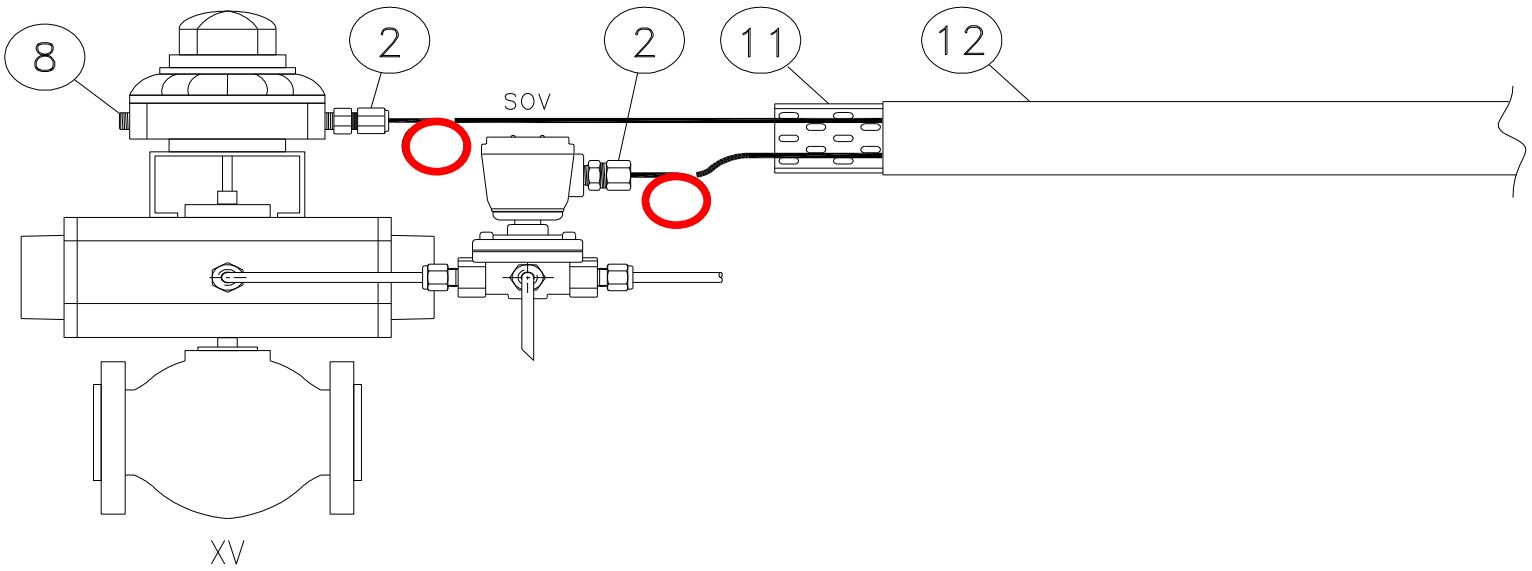

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**

REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi


ROSETTI MARINO SpA

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

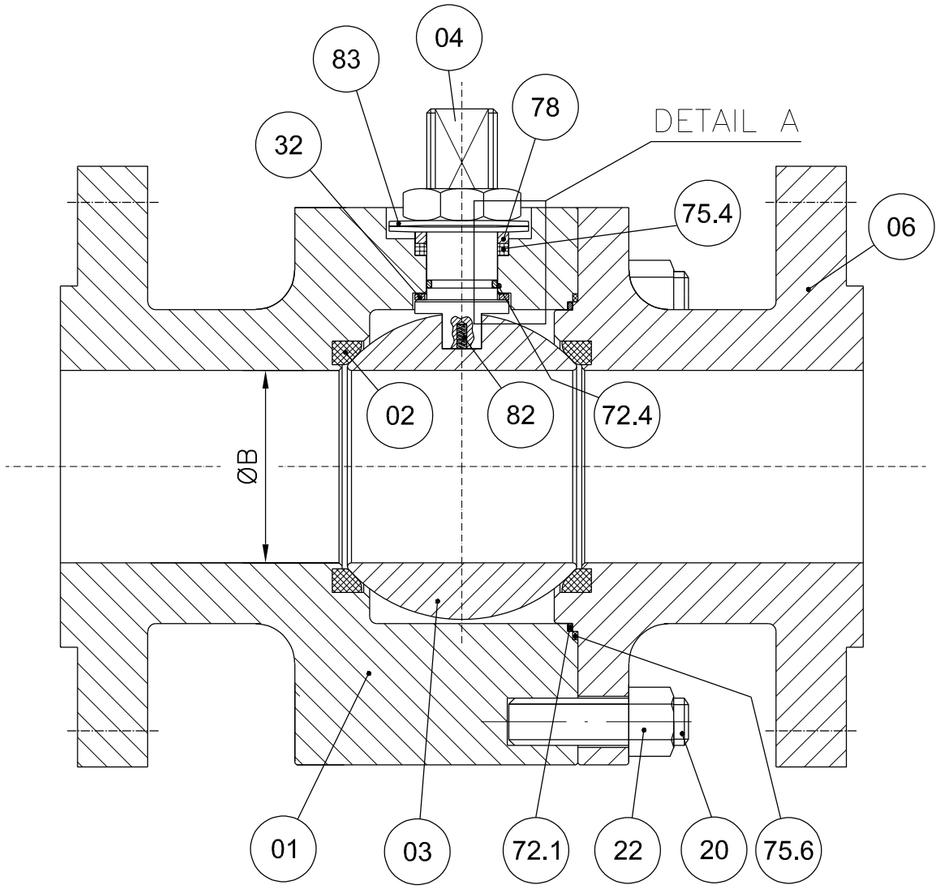


DETAIL A




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-024	25
	2	Service				HYDROGEN TO STORAGE TANKS DEPRESS.	
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80013	Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-143-03HSS-N	
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm	1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L	NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN	
	8	Fluid State	Phase			GAS	GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40	
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29	80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40	
	14						
	15						
	16	Speed of	Design			Close : (12)	Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum	Open : -
	18						
	19						
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)	
	21	Body Size	Body Form			1"	FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L	(*)
	23	Connections	Rating			FLANGED ASME B16.5	#300
	24	Flange Finish	Gasket Material			RF	Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)	(*)
	26	Bolting				A193 B8M / A194 Gr. 8M	
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO	
	29	Fire Safe				(2)	
ACTUATOR	30	Manufacturer	Type			Rotork	Spring Return
	31	Model No.	Size			CP/S	035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal	Cylinder
	33	Ingress Protection	Certification			IP-66	II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE	CLOSE
	36	Fireproofing				NOT APPLICABLE	
	37	Solenoid Valve				25-XY-024 (9, 14, 15, 16) - Bifold FP06P	
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-024 (9, 17) - Soldo SS	25-ZSH-024 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED	
	40	Air Set	Handwheel			(*)	NOT REQUIRED
	41	Mounting Position				HORIZONTAL	
	42	Partial Stroke Test Facility				NOT REQUIRED	
	43	Control Type				-	
	44	Electrical Connection	Electrical Class			No. (*) / M20	H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-	
	47	Safety Valve	Model			-	-
	48	Check Valve	Mounting			-	-
PURCHASE	49	Manufacturer				FLUITEK	
	50	Model				FB3	
	51	Purchase Order Number				1724000204	

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description	Code :	Dwg. No.:	Rev.
03	06/12/24							
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)			
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)			

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

140	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
141	IFR	25-XV-020	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
142	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
143	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620210001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
144	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
145	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
146	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323304	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
147	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
148	IFR	25-XV-021	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
149	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
150	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620220001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
151	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
152	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
153	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323297	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
154	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
155	IFR	25-XV-024	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
156	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
157	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620230001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
158	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
159	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
160	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323291	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
161	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
162	IFR	50-XV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
163	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
164	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620240001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
165	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
166	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
167	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323289	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
168	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
169	IFR	50-XV-002	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
170	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
171	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620250001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
172	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
173	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
174	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323290	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
175	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
176	IFR	50-XV-003	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
177	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
178	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620260001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
179	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
180	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
181	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323299	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
182	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
183	IFR	50-XV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
184	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
185	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620270001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
186	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE

Bourdon tube pressure gauge, stainless steel
For the process industry, standard version
Models 232.50, 233.50, NS 63 [2 ½"], 100 [4"] and 160 [6"]

For further approvals, see page 6

Applications

- For gaseous and liquid aggressive media that are not highly viscous or crystallising, also in aggressive environments
- Chemical and petrochemical industries, oil and gas industry, power engineering and also water and wastewater technology
- Machine building and general plant construction

Special features

- Excellent load cycle stability and shock resistance
- With case filling (model 233.50) for applications with high dynamic pressure loads and vibrations
- Completely from stainless steel
- Scale ranges from 0 … 0.6 to 0 … 1,600 bar or 0 ... 10 to 0 ... 20,000 psi
- QR code on dial links to instrument-specific information



Bourdon tube pressure gauge, model 232.50, NS 100 [4"]

Description

This high-quality Bourdon tube pressure gauge has been designed especially for the process industry.

The use of high-quality stainless steel materials and the robust design are geared to applications in the chemical and process engineering industries. Thus the instrument is suitable for liquid and gaseous media, also in aggressive environments.

Scale ranges of 0 … 0.6 to 0 … 1,600 bar [0 ... 10 to 0 ... 20,000 psi] ensure the measuring ranges required for a wide variety of applications.

WIKA manufactures and qualifies the pressure gauge in accordance with the standards EN 837-1 and ASME B40.100. As a safety function, this instrument has a blow-out device with blow-out plug on the back of the case. In the event of a failure, overpressure can escape there.

The model 233.50 with liquid-filled case is suitable for high dynamic pressure loads and vibrations.

The QR code on the dial allows instrument-specific information such as the serial number, the order number, certificates and other product data to be retrieved from the internet easily and in the long term.

Smart in sensing

Data sheets showing similar products:
Stainless steel, safety version; see data sheet PM 02.04
Bourdon tube pressure gauge with switch contacts; see data sheet PV 22.02
Monel version; see data sheet PM 02.33
Pressure gauge per EN 837-1 with mounted diaphragm seal; see data sheet DS 95.12

Specifications

Basic information	
Standard	■ EN 837-1 ■ ASME B40.100
	For information on the “Selection, installation, handling and operation of pressure gauges”, see technical information IN 00.05.
Further version	■ Oil- and grease-free for oxygen ■ Per NACE [1] MR0175 / ISO 15156, use in H_2S-containing environments in oil and gas production ■ With pre-volume deflagration flame arrester [2] for mounting to zone 0 (EPL Ga); model 910.21; see data sheet AC 91.02 ■ Monel version; models 262 and 263; see data sheet PM 02.33
Nominal size (NS)	■ Ø 63 mm [2 ½"] ■ Ø 100 mm [4"] ■ Ø 160 mm [6"]
Connection location	■ Lower mount (radial) ■ Lower back mount ■ Centre back mount (only for NS 63 [2 ½"])
Window	Laminated safety glass (NS 63 [2 ½"]: Polycarbonate)
Case	
Design	Safety level “S1” per EN 837-1 With blow-out device at case circumference, 12 o'clock (NS 63 [2 ½"]) and on the back of the case (NS 100 [4"] and 160 [6"]) Scale ranges ≤ 0 ... 16 bar [≤ 0 ... 300 psi] with compensating valve to vent and reseal case
Material	■ Stainless steel 1.4301 (304) ■ Stainless steel 1.4571 (316Ti)
Ring	Bayonet ring, stainless steel
Mounting	■ Without ■ Panel mounting flange, stainless steel ■ Panel mounting flange, polished stainless steel ■ Triangular profile ring with mounting bracket, polished stainless steel ■ Surface mounting flange, stainless steel
Case filling (model 233.50)	■ Without ■ Glycerine ■ Glycerine-water mixture for NS 100 [4"] and 160 [6"] with scale range ≤ 0 ... 2.5 bar [≤ 0 ... 40 psi] or for NS 63 [2 ½"] with scale range ≤ 0 ... 4 bar [≤ 0 ... 60 psi] ■ Silicone oil
Movement	■ Stainless steel ■ Stainless steel 1.4404 (316L) ■ everlast® version

1) General information about NACE standards; see data sheet IN 00.21
2) Only for instruments with Ex approval

Measuring element	
Type of measuring element	Bourdon tube, C-type or helical type
Material	Stainless steel 1.4404 (316L)
Leak tightness	■ Helium tested, leakage rate: $< 5 \cdot 10^{-3}$ mbar l/s ■ Helium tested, leakage rate: $< 1 \cdot 10^{-6}$ mbar l/s

Accuracy specifications		
Accuracy class		
NS 63 [2 ½"]	■ EN 837-1	Class 1.6
	■ ASME B40.100	±2 % | ±1 % | ±2 % of measuring span (grade A)
NS 100 [4"], 160 [6"]	■ EN 837-1	Class 1.0
	■ ASME B40.100	±1 % of measuring span (grade 1A)
Temperature error	On deviation from the reference conditions at the measuring system: ≤ ±0.4 % per 10 °C [≤ ±0.4 % per 18 °F] of full scale value	
Reference conditions		
Ambient temperature	+20 °C [+68 °F]	

Scale ranges

bar	
0 ... 0.6 [1]	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160
0 ... 4	0 ... 250
0 ... 6	0 ... 400
0 ... 10	0 ... 600
0 ... 16	0 ... 1,000
0 ... 25	0 ... 1,600

kg/cm²	
0 ... 0.6 [1]	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160
0 ... 4	0 ... 250
0 ... 6	0 ... 400
0 ... 10	0 ... 600
0 ... 16	0 ... 1,000
0 ... 25	0 ... 1,600

kPa	
0 ... 60 [1]	0 ... 4,000
0 ... 100	0 ... 6,000
0 ... 160	0 ... 10,000
0 ... 250	0 ... 16,000
0 ... 400	0 ... 25,000
0 ... 600	0 ... 40,000
0 ... 1,000	0 ... 60,000
0 ... 1,600	0 ... 100,000
0 ... 2,500	0 ... 160,000

MPa	
0 ... 0.06 [1]	0 ... 4
0 ... 0.1	0 ... 6
0 ... 0.16	0 ... 10
0 ... 0.25	0 ... 16
0 ... 0.4	0 ... 25
0 ... 0.6	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160

psi	
0 ... 10 [1]	0 ... 1,000
0 ... 15	0 ... 1,500
0 ... 30	0 ... 2,000
0 ... 60	0 ... 3,000
0 ... 100	0 ... 4,000
0 ... 160	0 ... 5,000
0 ... 200	0 ... 6,000
0 ... 300	0 ... 7,500
0 ... 400	0 ... 10,000
0 ... 600	0 ... 15,000
0 ... 800	0 ... 20,000

1) Not available for NS 63 [2 ½"]

Vacuum and +/- scale ranges

bar	
-0.6 ... 0 [1]	-1 ... +5
-1 ... 0	-1 ... +9
-1 ... +0.6	-1 ... +15
-1 ... +1.5	-1 ... +24
-1 ... +3	

MPa	
-0.06 ... 0 [1]	-0.1 ... +0.5
-0.1 ... 0	-0.1 ... +0.9
-0.1 ... +0.06	-0.1 ... +1.5
-0.1 ... +0.15	-0.1 ... +2.4
-0.1 ... +0.3	

kPa	
-60 ... 0 [1]	-100 ... +500
-100 ... 0	-100 ... +900
-100 ... +60	-100 ... +1,500
-100 ... +150	-100 ... +2,400
-100 ... +300	

psi	
-30 inHg ... 0	-30 inHg ... +100
-30 inHg ... +15	-30 inHg ... +160
-30 inHg ... +30	-30 inHg ... +200
-30 inHg ... +60	-30 inHg ... +300

1) Not available for NS 63 [2 ½"]

Further details on: scale ranges	
Special scale ranges	Other scale ranges on request
Unit	■ bar ■ psi ■ kg/cm² ■ kPa ■ MPa
Increased overload safety	■ Without ■ 2 times ■ 3 times ■ 4 times ■ 5 times
	The possibility of selection depends on scale range and nominal size
Vacuum resistance	■ Without ■ Vacuum-resistant to -1 bar
Dial	
Scale colour	Black
Material	Aluminium
Special scale	■ Without ■ With temperature scale for refrigerant, e.g. for NH_3: R 717
	Other scales or customer-specific dials, e.g. with red mark, circular arcs or circular sectors, on request
Pointer	
Instrument pointer	Aluminium, black
Mark pointer/drag pointer	■ Without ■ Red mark pointer on dial, fixed ■ Red mark pointer on window, adjustable ■ Mark pointer on bayonet ring, adjustable ■ Red drag pointer on window, adjustable
Pointer stop pin	■ Without ■ At zero point (only for NS 63 [2 ½"]) ■ At 6 o'clock (only for NS 100 [4"], 160 [6"])

Process connection		
Standard	■ EN 837-1 ■ ISO 7 ■ ANSI/B1.20.1	
Size		
EN 837-1	■ G ⅛ B, male thread ■ G ¼ B, male thread ■ G ½ B, male thread ■ M12 x 1.5, male thread ■ M20 x 1.5, male thread	
ISO 7	■ R ¼, male thread ■ R ½, male thread	
ANSI/B1.20.1	■ ¼ NPT, male thread ■ ½ NPT, male thread	
Restrictor	■ Without ■ Ø 0.6 mm [0.024"], stainless steel ■ Ø 0.3 mm [0.012"], stainless steel	
Material (wetted)		
Process connection	Stainless steel 1.4404 (316L)	
Bourdon tube	Stainless steel 1.4404 (316L)	

→ Other process connections on request

Operating conditions		
Medium temperature		
Unfilled instruments	-40 ... +200 °C [-40 ... +392 °F]	
Instruments with glycerine filling	-20 ... +100 °C [-4 ... +212 °F]	
Instruments with silicone oil filling	-40 ... +100 °C [-40 ... +212 °F]	
Ambient temperature		
Unfilled instruments or with silicone oil filling	-40 ... +60 °C [-40 ... +140 °F]	
Instruments with glycerine filling	-20 ... +60 °C [-4 ... +140 °F]	
Pressure limitation		
NS 63 [2 ½"]	Steady	3/4 x full scale value
	Fluctuating	2/3 x full scale value
	Short time	Full scale value
NS 100 [4"], 160 [6"]	Steady	Full scale value
	Fluctuating	0.9 x full scale value
	Short time	1.3 x full scale value
Ingress protection per IEC/EN 60529	■ IP65 ■ IP66 (only selectable for scale ranges ≥ 0 ... 20 bar [0 ... 400 psi])	

Approvals

Logo	Description	Region
CE	**EU declaration of conformity** Pressure equipment directive PS > 200 bar, module A, pressure accessory	European Union
UKCA	**UKCA** Pressure equipment (safety) regulations	United Kingdom
-	**CRN** Safety (e.g. electr. safety, overpressure, ...) For full scale value ≤ 1,000 bar	Canada

Optional approvals

Logo	Description	Region
CE Ex	**EU declaration of conformity** ATEX directive Hazardous areas - Ex h Gas II 2G Ex h IIC T6 ... T1 Gb X Dust II 2D Ex h IIIC T85°C ... T450°C Db X	European Union
UKCA	**UKCA** Equipment and protective systems intended for use in potentially explosive atmospheres regulations	United Kingdom
EAC Ex	**EAC** Hazardous areas	Eurasian Economic Community
	Ex Ukraine Hazardous areas	Ukraine
	PAC Kazakhstan Metrology, measurement technology	Kazakhstan
-	**MChS** Permission for commissioning	Kazakhstan
-	**PAC Ukraine** Metrology, measurement technology	Ukraine
	PAC Uzbekistan Metrology, measurement technology	Uzbekistan
-	**PAC China** Metrology, measurement technology	China
	DNV Ships, shipbuilding (e.g. offshore)	International
-	**KBA** [1] Automotive	International
	Hydrogen-powered motor vehicles - (EC) no. 79/2009 and (EU) no. 406/2010	
	Components for motor vehicles using natural gas (CNG/LNG) – UN no. R 110	

1) Not available for all versions

Manufacturer's declaration

Logo	Description
-	Pressure equipment directive (PED) for maximum allowable pressure PS ≤ 200 bar
-	Suitability of wetted materials for drinking water in accordance with the European 4MS initiative
-	Suitability of wetted materials for hydrogen


Certificates (option)

Certificates	
Certificates	■ 2.2 test report per EN 10204 (e.g. state-of-the-art manufacturing, indication accuracy) ■ 3.1 inspection certificate per EN 10204 (e.g. material proof for wetted metal parts, indication accuracy) ■ PCA calibration certificate, traceable and accredited in accordance with ISO/IEC 17025 ■ Calibration certificate by a national accreditation body, traceable and accredited in accordance with ISO/IEC 17025 on request
Recommended calibration interval	1 year (dependent on conditions of use)

→ For approvals and certificates, see website

Dimensions in mm [in]

Lower mount (radial)

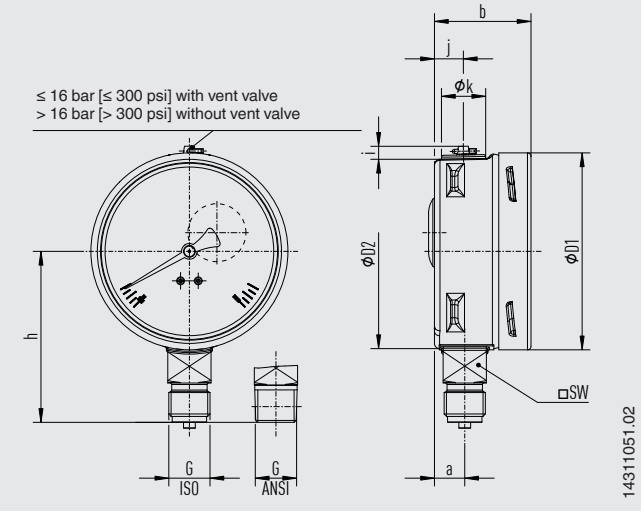

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]
100 [4"]	approx. 0.6 kg [1.32 lbs]	approx. 0.9 kg [1.98 lbs]
160 [6"]	approx. 1.1 kg [2.43 lbs]	approx. 2.0 kg [4.41 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	G ¼ B	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	51 [2.01]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	G ¼ B	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	87 [3.43]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	87 [3.43]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	G ¼ B	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	118 [4.65]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	118 [4.65]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ISO 7


NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	R ¼	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	R ¼	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	86 [3.39]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	R ¼	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	117 [4.60]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	¼ NPT	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	51 [2.01]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	¼ NPT	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	86 [3.39]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	¼ NPT	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	117 [4.60]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

1) Plus 16 mm [0.630 in] with scale range 0 ... 1,600 bar [0 ... 20,000 psi]

Lower back mount

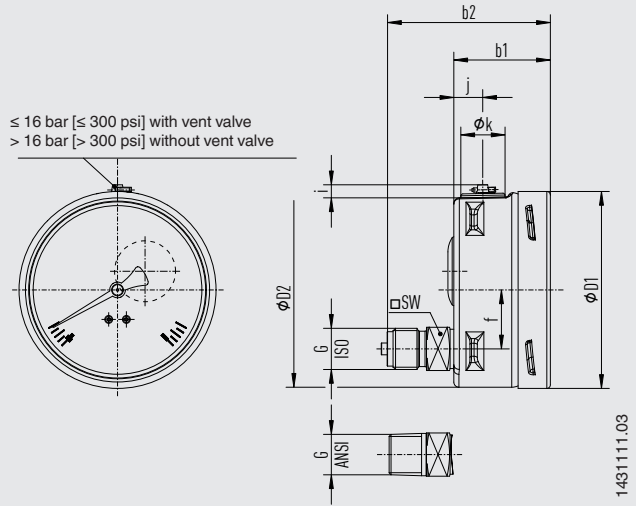

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]
100 [4"]	approx. 0.6 kg [1.32 lbs]	approx. 0.9 kg [1.98 lbs]
160 [6"]	approx. 1.1 kg [2.43 lbs]	approx. 2.0 kg [4.41 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	G ¼ B	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	33 [1.30]	54 [2.13]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	G ¼ B	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	49.5 [1.95]	83 [3.27]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	49.5 [1.95]	83 [3.27]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	G ¼ B	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	51.5 [2.03] 1)	85 [3.24] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	51.5 [2.03] 1)	85 [3.24] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ISO 7


NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	R ¼	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	R ¼	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	49.5 [1.95]	82 [3.23]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	R ¼	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	51.5 [2.03] 1)	84 [3.31] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	¼ NPT	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	50 [1.97]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	33 [1.30]	54 [2.13]	63 [2.48]	62 [2.44]	50 [1.97]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	¼ NPT	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	49.5 [1.95]	82 [3.23]	101 [3.98]	99 [3.90]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	¼ NPT	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	51.5 [2.03] 1)	84 [3.31] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

1) Plus 16 mm [0.630 in] with scale ranges ≥ 0 ... 100 bar [≥ 0 ... 1,500 psi]

NS 63 [2 ½"], centre back mount

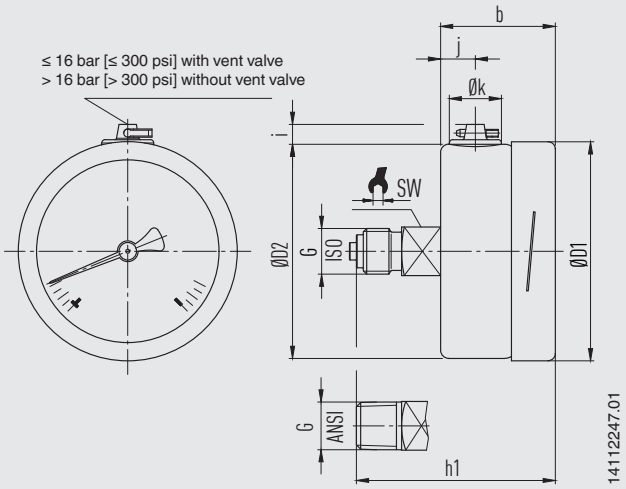

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	G ¼ B	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	54 [2.13]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]

Process connection with thread per ISO 7

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	R ¼	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]


Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	¼ NPT	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	54 [2.13]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]


Accessories

Dimensions in mm [in]

Panel mounting flange

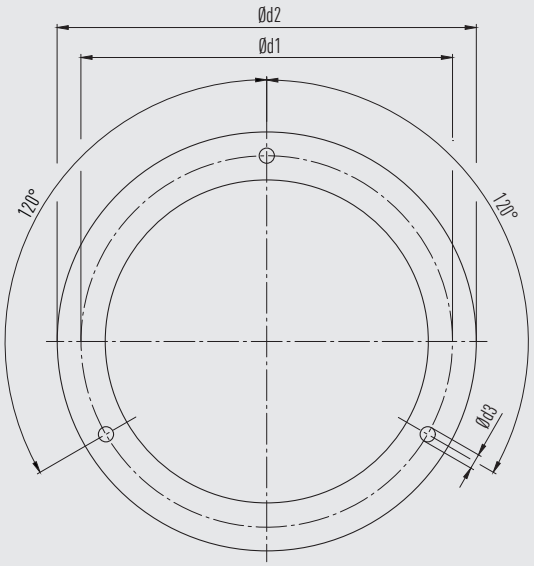


Surface mounting flange

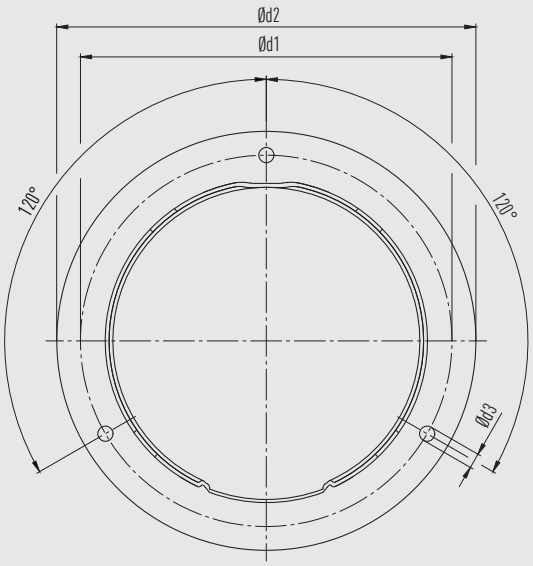


NS	Dimensions in mm [in]			
	Recommended panel cutout	d1	d2	d3
63 [2 ½"]	Ø 67 ±0.3 / Ø 2.6 [Ø 2.64 ±0.01 / Ø 0.10]	75 [2.95]	85 [3.35]	3.6 [0.14]
100 [4"]	Ø 104 ±0.5 / Ø 4.1 [Ø 4.04 ±0.02 / Ø 0.16]	117 [4.60]	132 [5.20]	4.8 [0.19]
160 [6"]	Ø 164 ±0.5 / Ø 6.5 [Ø 6.46 ±0.02 / Ø 0.26]	178 [7.01]	196 [7.72]	5.8 [0.23]

Triangular profile ring

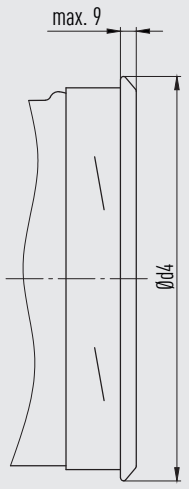

NS	Dimensions in mm [in]	
	Recommended panel cutout	d4
63 [2 ½"]	Ø 64.5 ±0.5 / Ø 2.5 [Ø 2.54 ±0.02 / Ø 0.01]	≤ 69 [2.72]
100 [4"]	Ø 102 ±1.0 / Ø 4.0 [Ø 4.02 ±0.04 / Ø 0.16]	≤ 108 [4.25]
160 [6"]	Ø 162.6 ±1.0 / Ø 6.4 [Ø 6.40 ±0.04 / Ø 0.25]	≤ 168 [6.61]

Accessories and spare parts

Model		Description
	**910.17**	Seals → See data sheet AC 09.08
	**910.15**	Syphons → See data sheet AC 09.06
	**910.13**	Overpressure protector → See data sheet AC 09.04
	**IV10, IV11**	Needle valve and multiport valve → See data sheet AC 09.22
	**IV20, IV21**	Block-and-bleed valve → See data sheet AC 09.19
	**IVM**	Monoflange, process and instrument version → See data sheet AC 09.17
	**BV**	Ball valve, process and instrument version → See data sheet AC 09.28
	**IBF2, IBF3**	Monoblock with flange connection → See data sheet AC 09.25

Ordering information

Model / Nominal size / Scale range / Process connection / Connection location / Options

© 02/1995 WIKA Alexander Wiegand SE & Co. KG, all rights reserved.
The specifications given in this document represent the state of engineering at the time of publishing.
We reserve the right to make modifications to the specifications and materials.
In case of a different interpretation of the translated and the English data sheet, the English wording shall prevail.

WIKA Alexander Wiegand SE & Co. KG
Alexander-Wiegand-Straße 30
63911 Klingenberg/Germany
Tel. +49 9372 132-0
info@wika.de
www.wika.de

EU-Konformitätserklärung
EU Declaration of Conformity

Dokument Nr. / ***Document No.*** **11564220** — **Revision** / ***Issue*** **07**

Wir erklären in alleiniger Verantwortung, dass die mit CE gekennzeichneten Produkte
We declare under our sole responsibility that the CE marked products

Typenbezeichnung / ***Type Designation***

23a.50.063 + option ATEX | **23a.50.1*0 + option ATEX**
26a.50.063 + option ATEX | **26a.50.1*0 + option ATEX**
23a.30.063 + option ATEX | **23a.30.1*0 + option ATEX**
26a.30.063 + option ATEX | **26a.30.1*0 + option ATEX**
23a.53.063 + option ATEX | **23a.53.100 + option ATEX**
23a.54.063 + option ATEX | **23a.54.100 + option ATEX**
23a.36.1*0 + option ATEX
PG23LT.063 + option ATEX | **PG23LT.1*0 + option ATEX**
PG23CP.063 + option ATEX | **PG23CP.100 + option ATEX**
PG28.1*0 + option ATEX
PG23HP-S.1*0 + option ATEX | **PG23HP-P.1*0 + option ATEX**

*** Nominal size**
0 = 100mm
6 = 160mm

a Case filling
2 = Without case filling
3 = With case filling

Beschreibung / ***Description***: **Rohrfederdruckmessgerät** / ***Bourdon Tube Pressure Gauge***

gemäß gültigem Datenblatt / *according to the valid data sheet*: PM 02.02, PM 02.04, PM 02.12, PM 02.15, PM 02.22, PM 02.24, PM 02.32, PM 02.28, PM 02.29

mit den nachfolgenden relevanten Harmonisierungsvorschriften der Union übereinstimmen
are in conformity with the following relevant Union harmonisation legislation

Angewandte harmonisierte Normen oder sonstige technische Spezifikationen:
Applied harmonised standards or other technical specifications:

2014/68/EU	Druckgeräterichtlinie (DGRL) (1) *Pressure Equipment Directive (PED)* (1)	
2014/34/EU	Explosionsschutz (ATEX) (2) *Explosion protection (ATEX)* (2)	
Ex	II 2G Ex h IIC T6 … T1 Gb X II 2D Ex h IIIC T85 °C … T450 °C Db X	EN ISO 80079-36 :2016 EN ISO 80079-37 :2016

(1) PS > 200 bar; Modul A, druckhaltendes Ausrüstungsteil
PS > 200 bar; Module A, pressure accessory

(2) Modul A „interne Fertigungskontrolle“. Die Dokumentation ist hinterlegt unter der Nummer 074/24 bei der Notifizierten Stelle der EU, IBExU Institut für Sicherheitstechnik GmbH (EU ID-Nr. 0637).
Module A “Internal Control of Production”. The Documentation is deposited under registration number 074/24 at Notified Body of EU, IBExU Institut für Sicherheitstechnik GmbH (EU ID 0637). .

Unterzeichnet für und im Namen von / *Signed for and on behalf of*

WIKA Alexander Wiegand SE & Co. KG

Klingenberg, 2024-04-24


Sascha Schnellbacher, Vice President
CoE Gauges, Sensors & Instruments

Mariusz Lubomski, Director of Quality
CoE Gauges, Sensors & Instruments


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

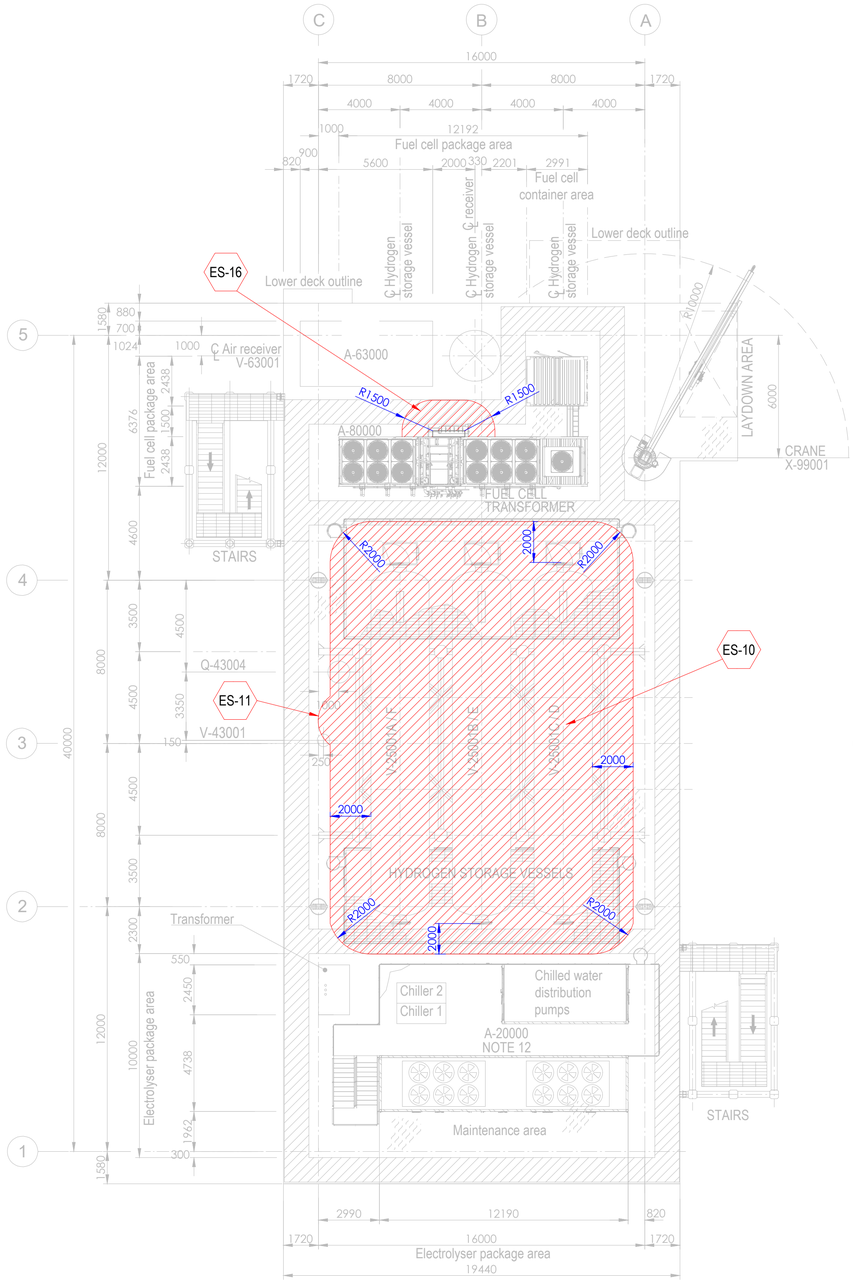


PLAN ON UPPER DECK
EL+30.310 T.O.S.

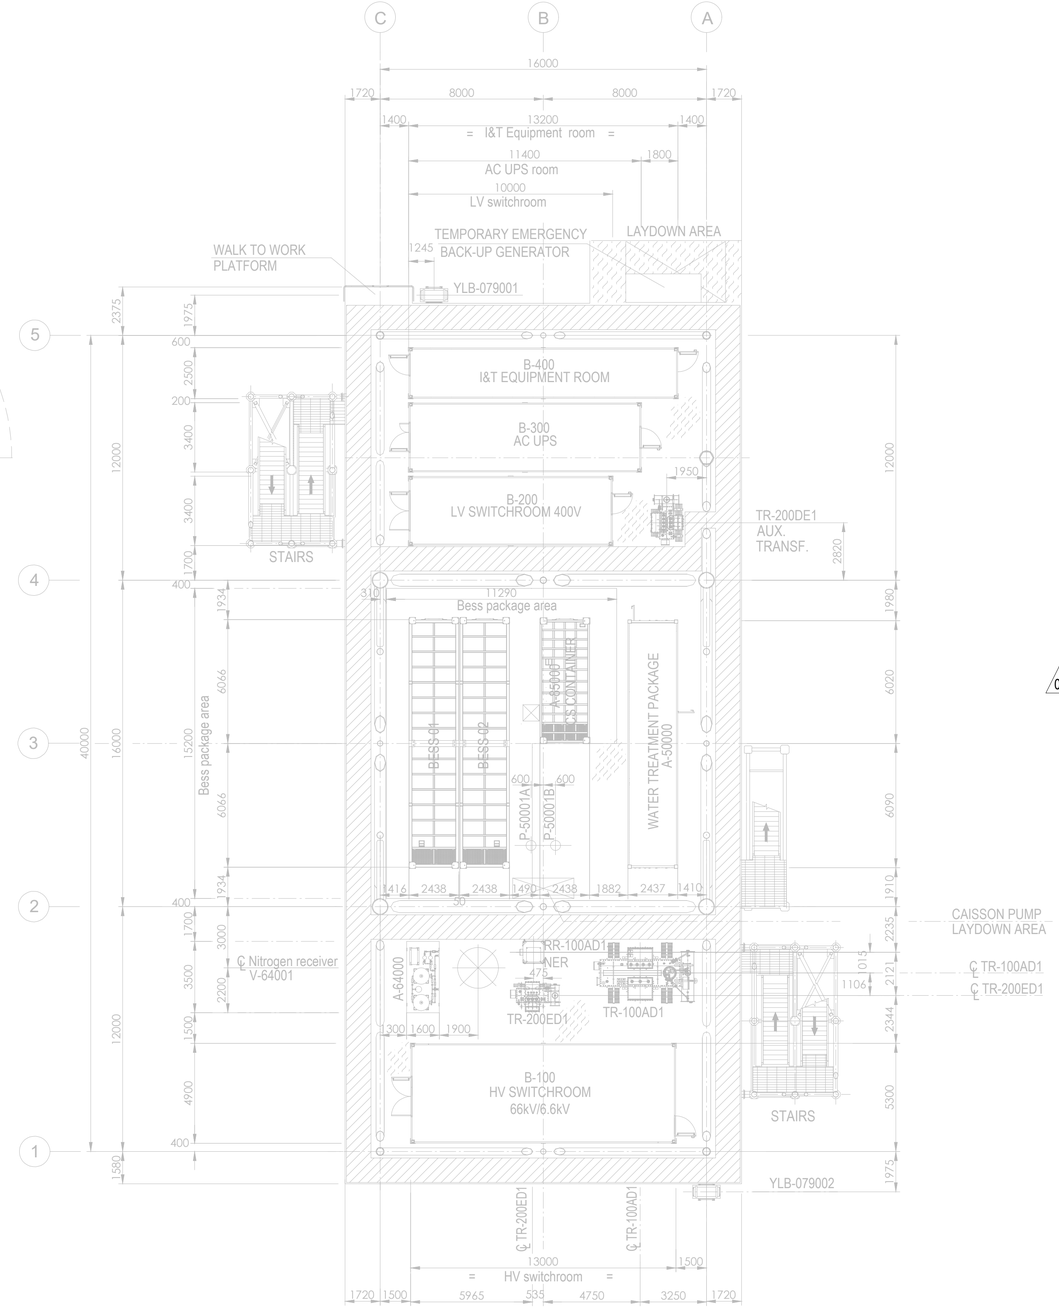

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

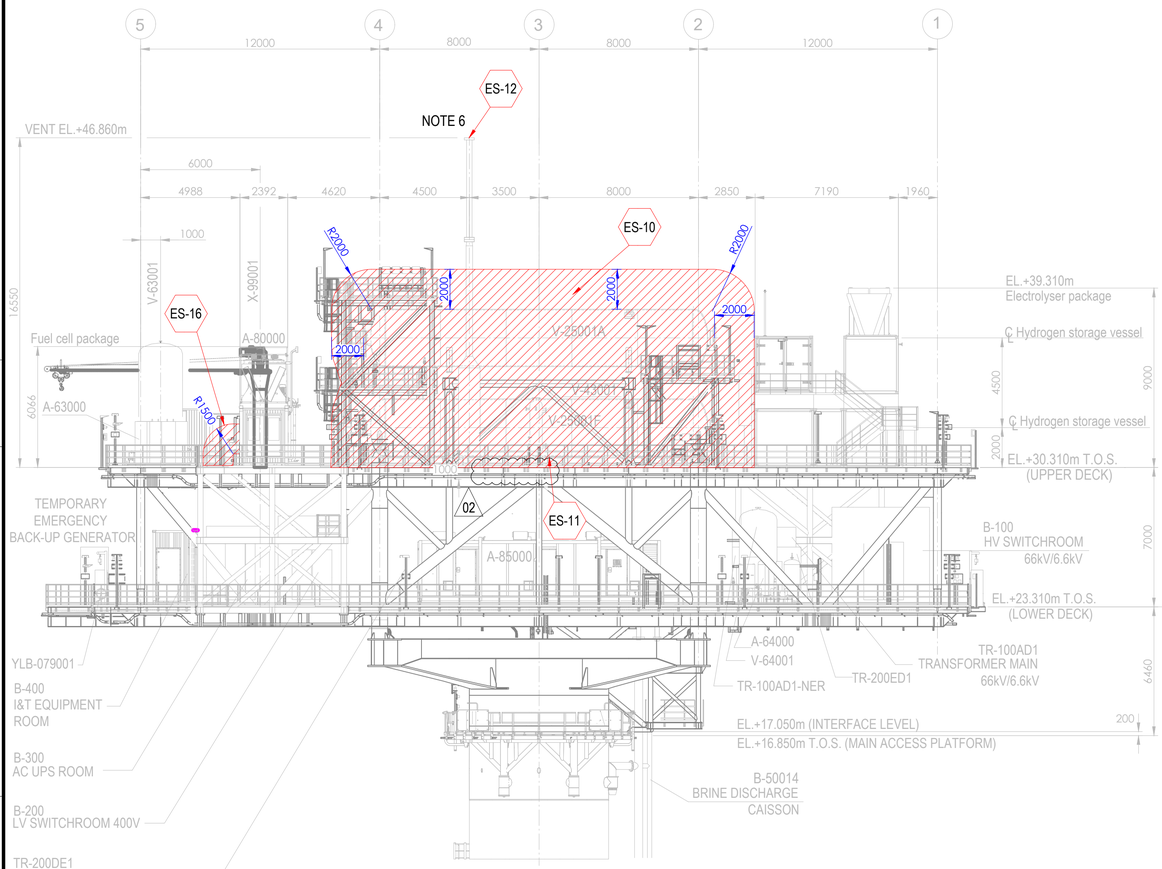



ELEVATION LOOKING EAST

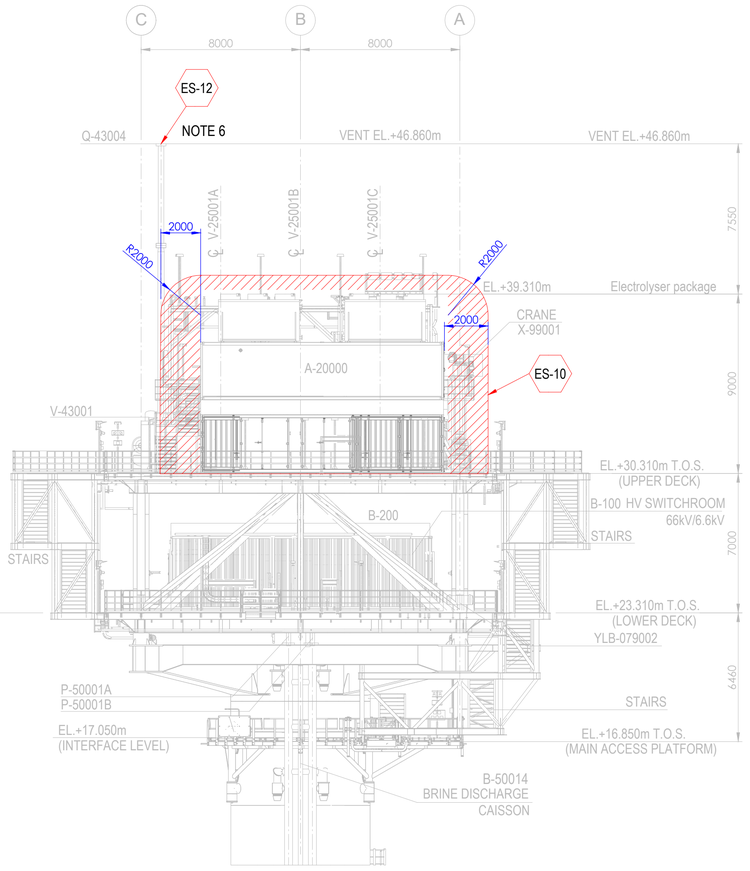

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

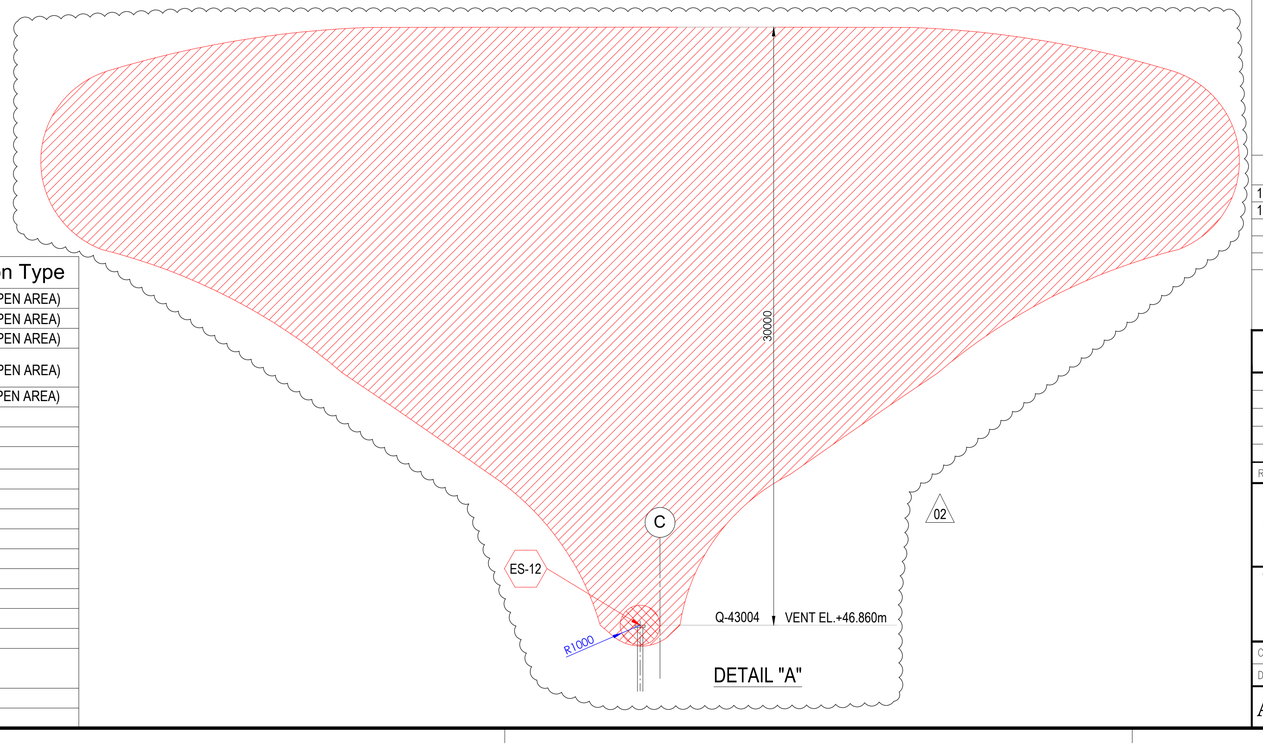



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PSV-004	: Safety Valve - Vessel V-25001A Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80015		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10004833	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		25308837			
Manufacturer	NUOVA GENERAL INSTRUMENTS			**Model**		D10/S			
Cert No.	D.o.C. by Manufacturer			**Equipment Ambient Temp.**		-20 °C to + 40 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	NA

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	NA	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PSV-004	: Safety Valve - Vessel V-25001A Hydrogen Inlet		Dwg	123A90-DDL-PR-PID-80015	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10004833	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-PSV-004	: Safety Valve - Vessel V-25001A Hydrogen Inlet		Dwg	123A90-DDL-PR-PID-80015	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10004833	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-29	2025-02-03	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:43:27.218Z	PROVERLIS Digitaly signed by Luca Mussi 2025-02-03T12:44:10.717Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

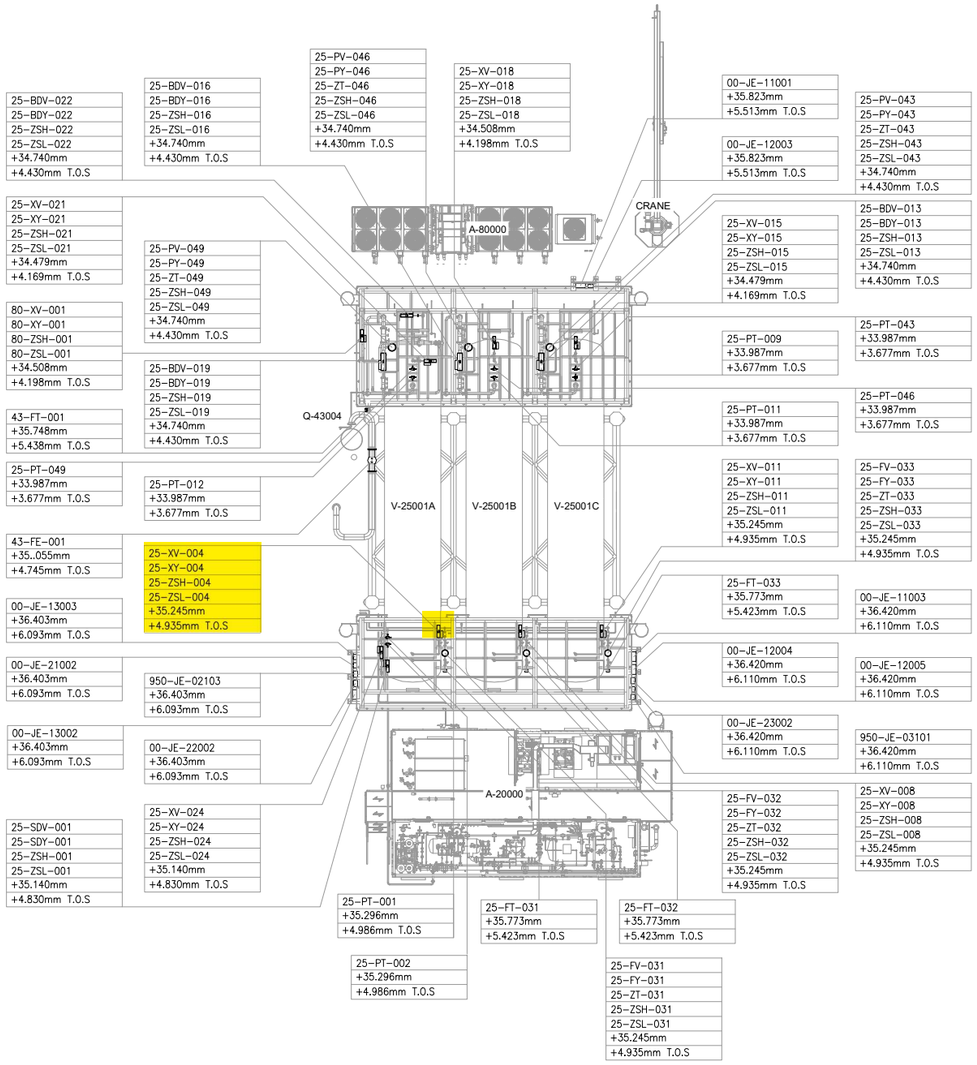

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 A

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg /AMB

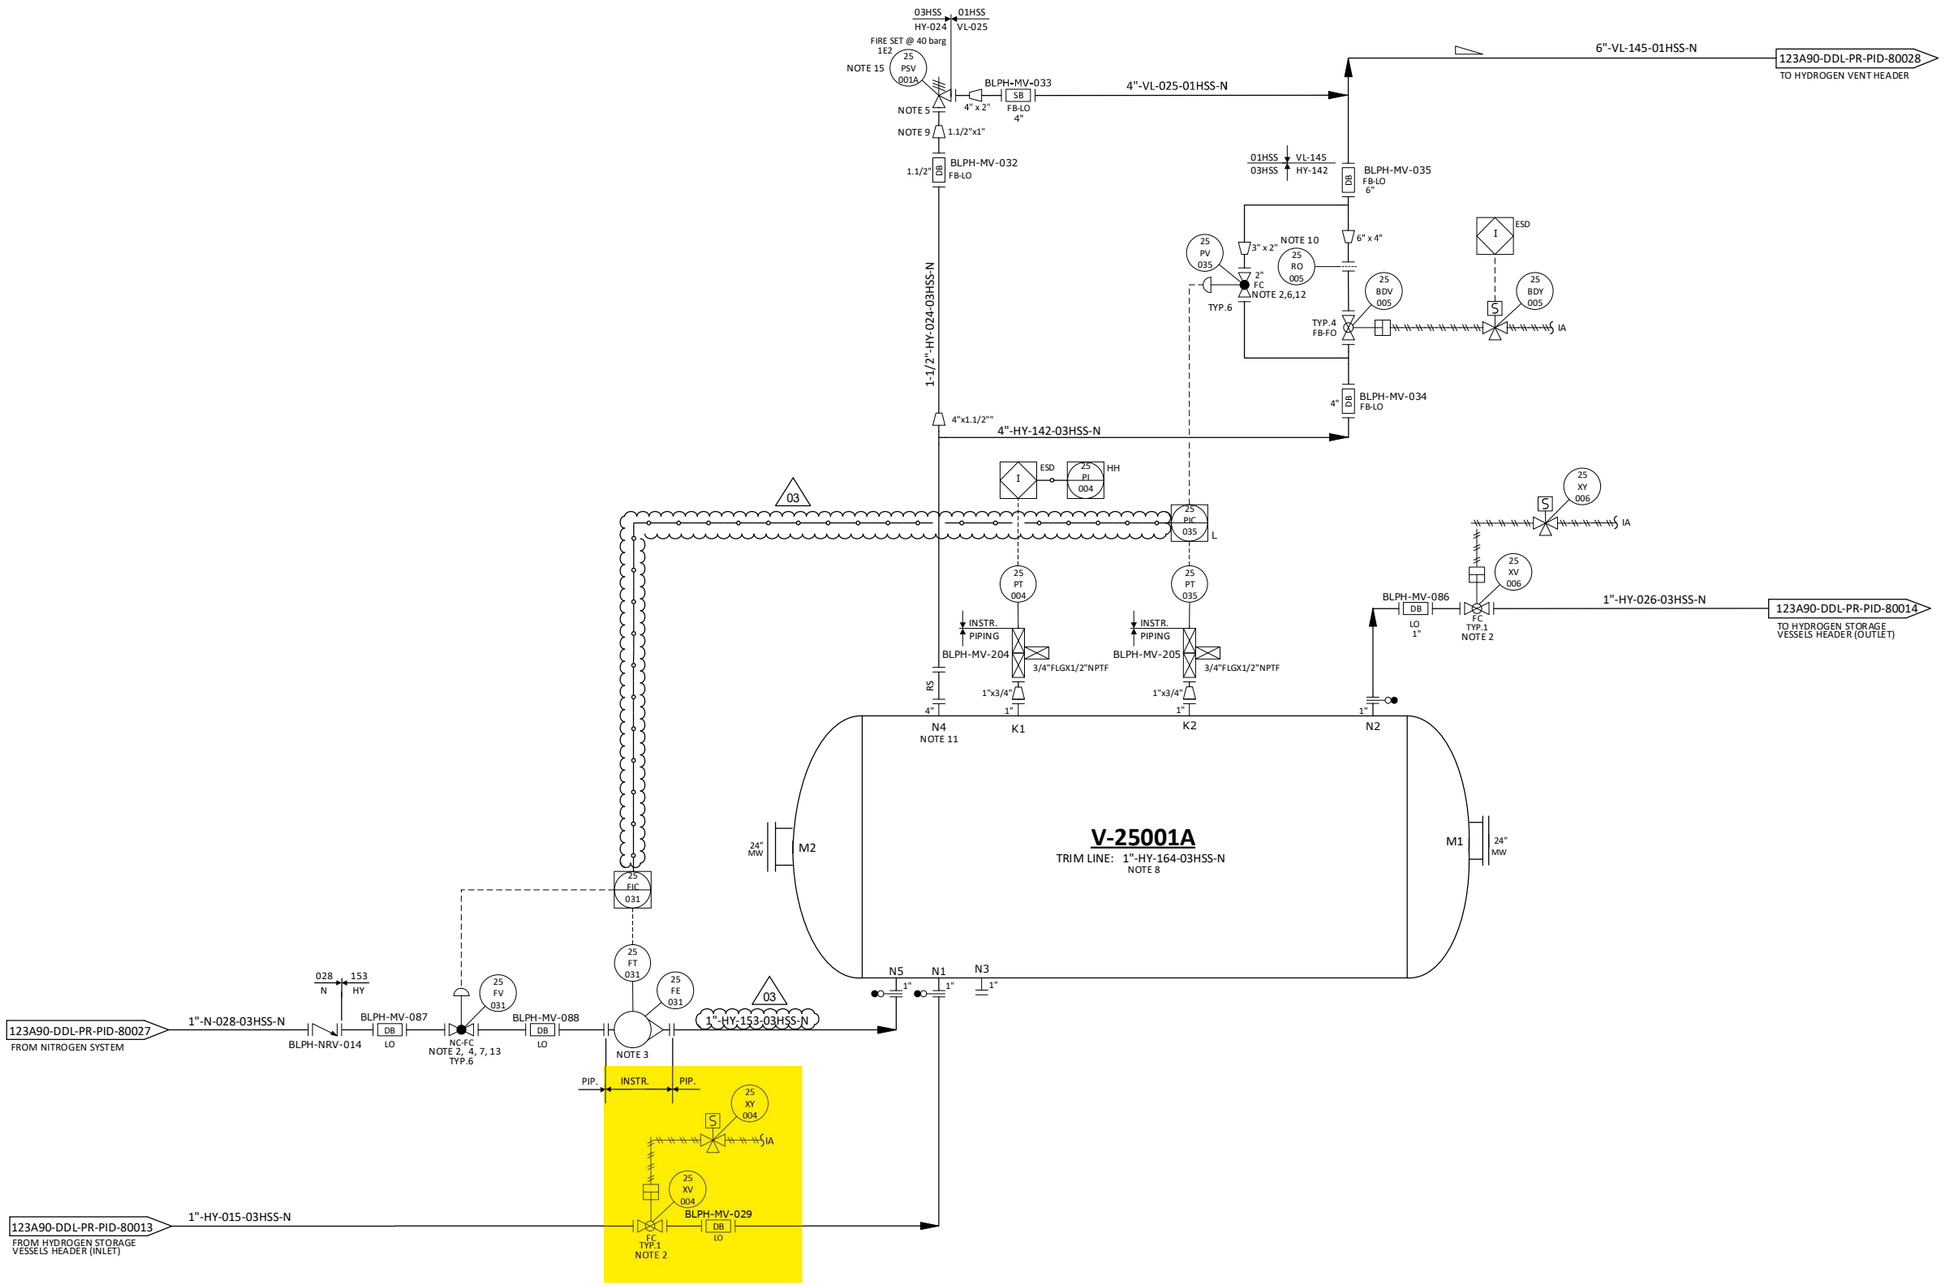

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-031) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-035 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-035 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-031 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-035 HAS FAILED TO CLOSE.
15. 25-PSV-001A SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL A

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80015		SHEET 001	REV. 03

File Name : FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

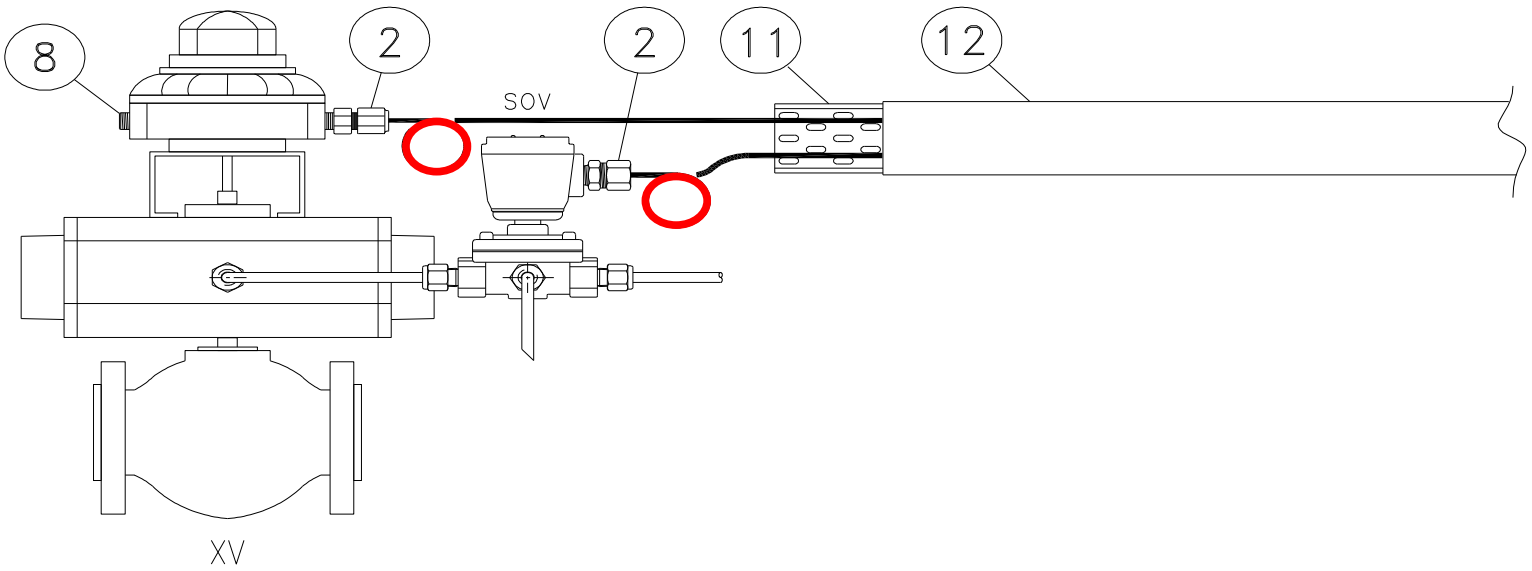

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

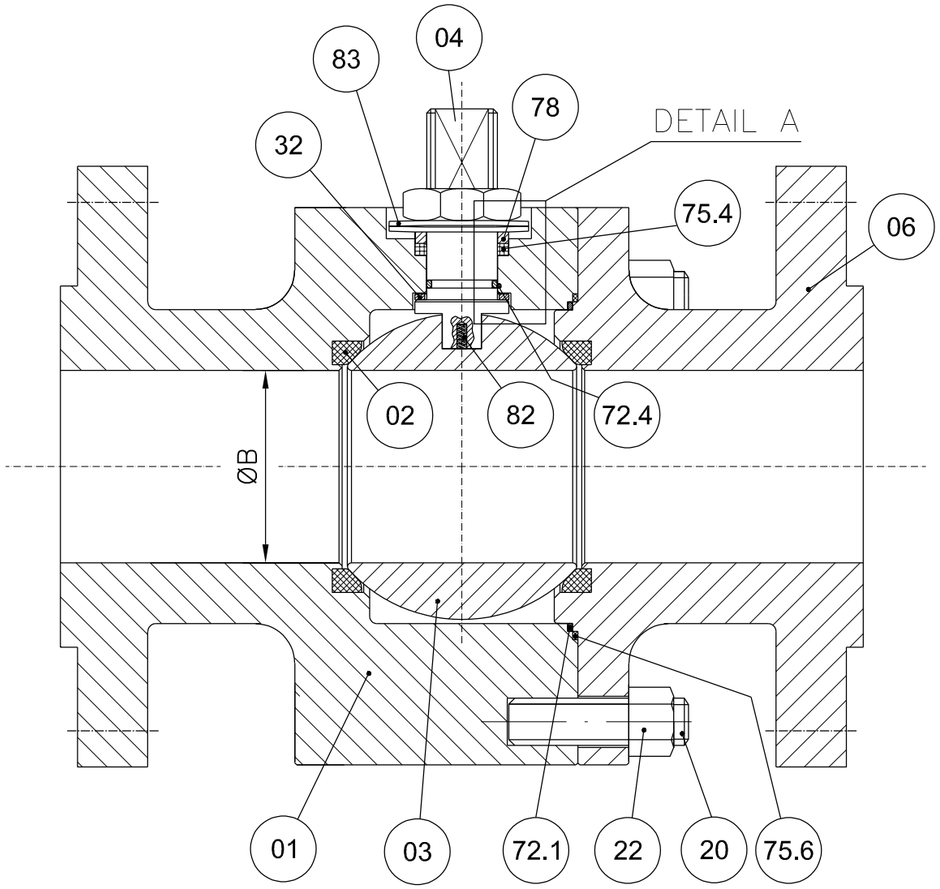

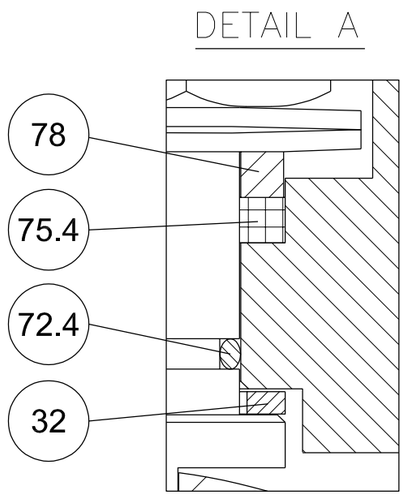


POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.


Rev.: 2

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR	25-SDV-023	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

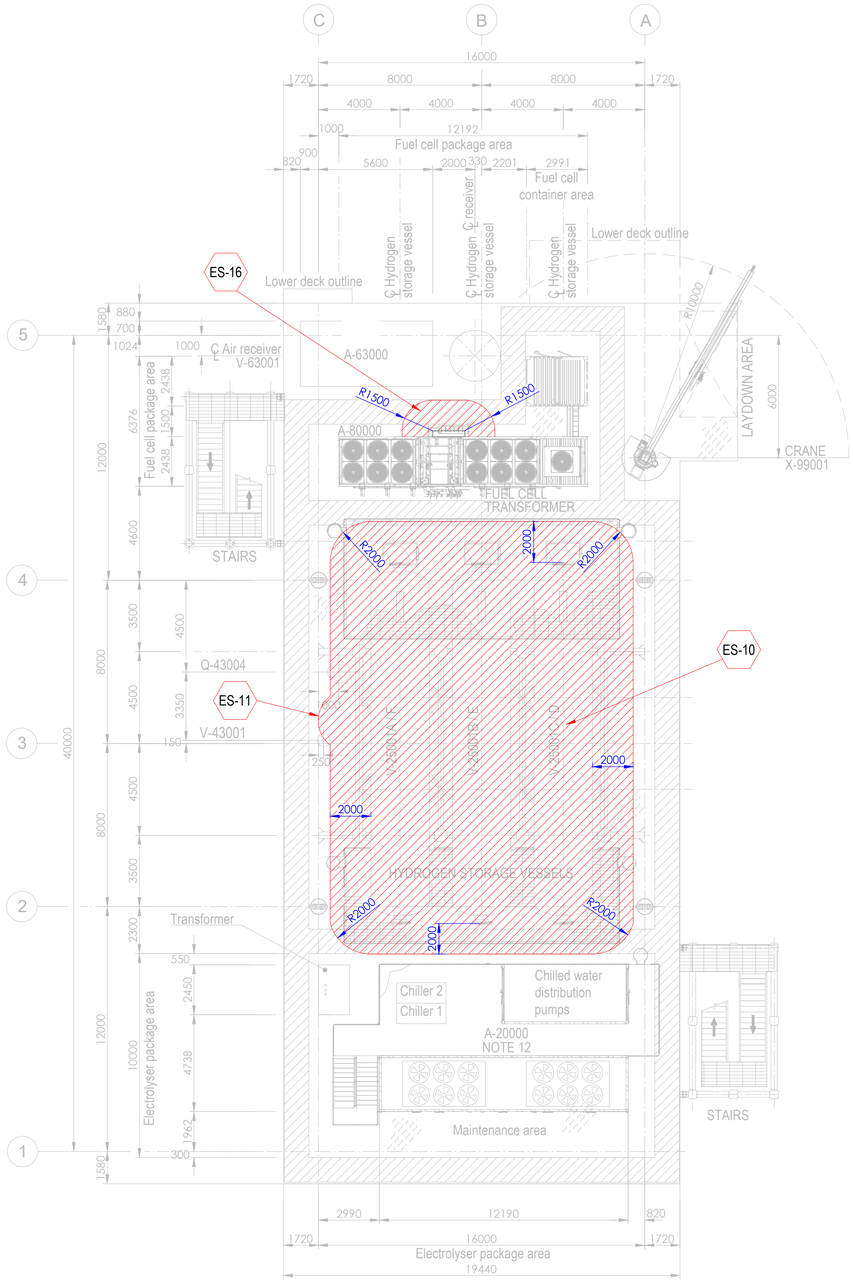


PLAN ON UPPER DECK
EL+30.310 T.O.S.

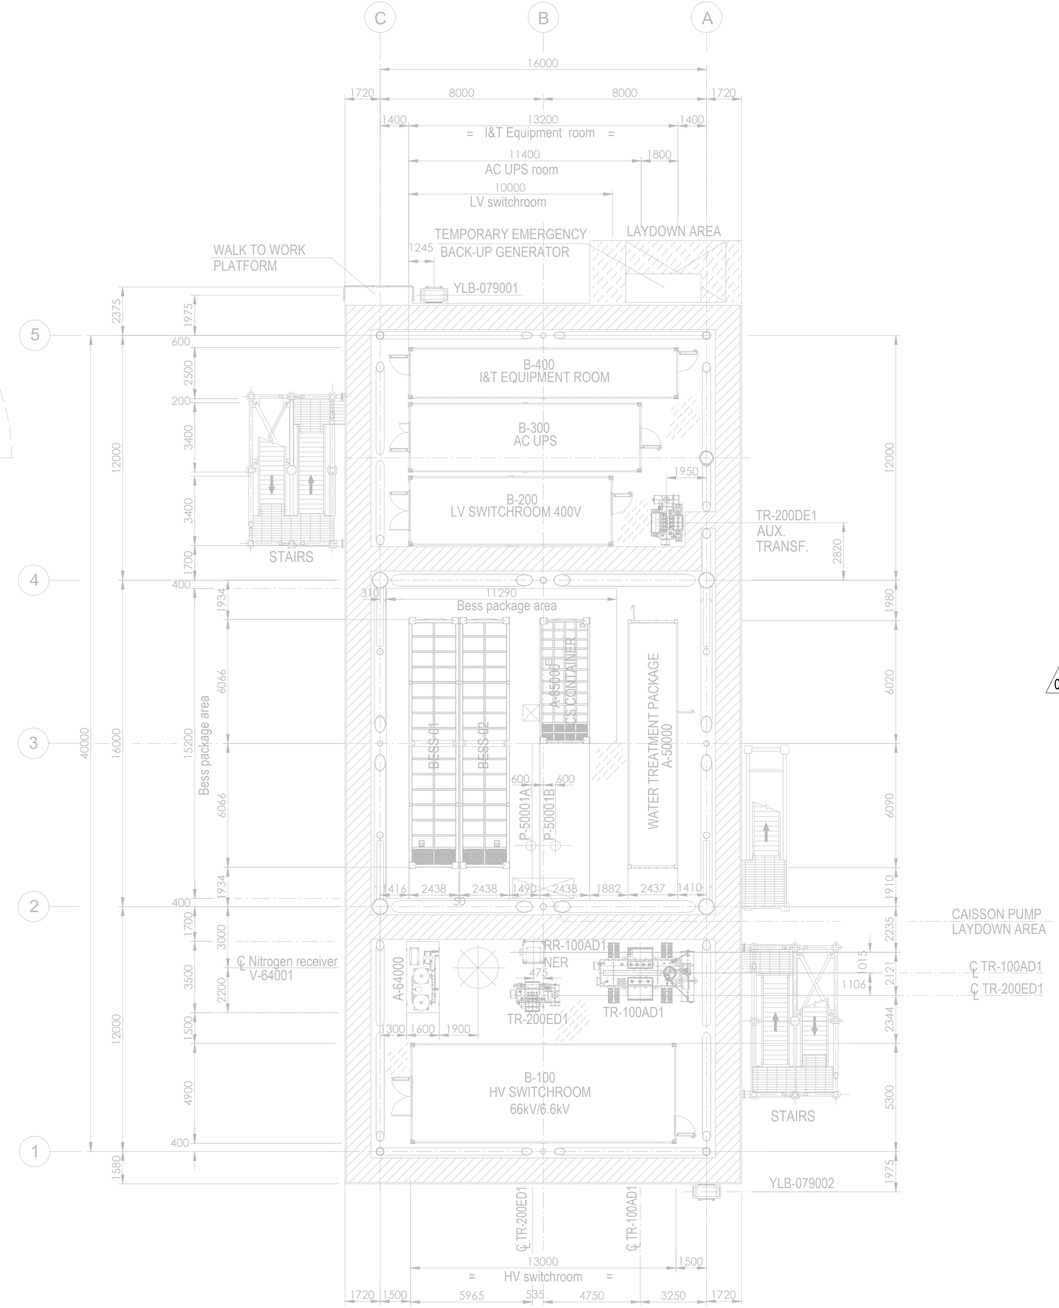

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

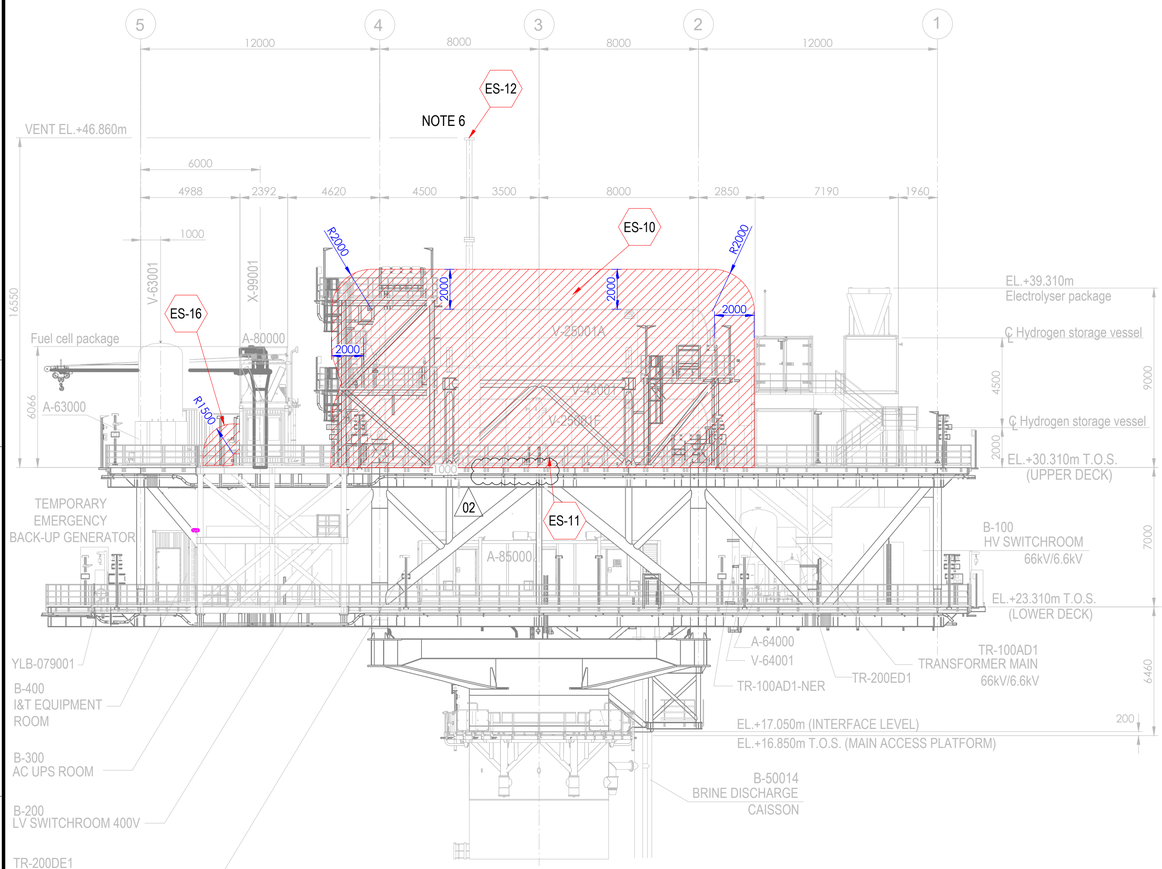



ELEVATION LOOKING EAST

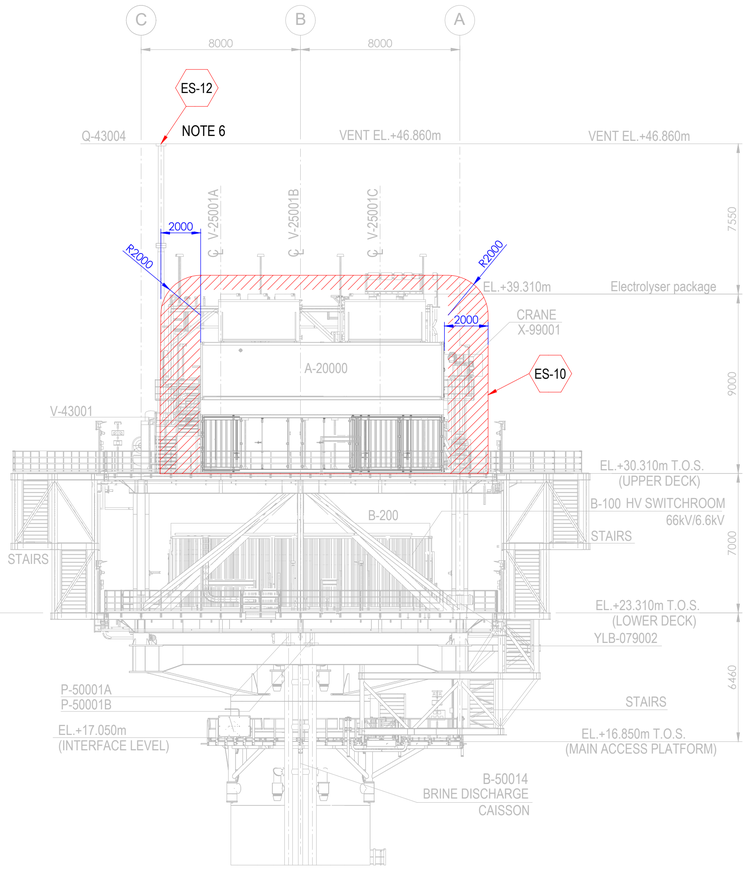

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

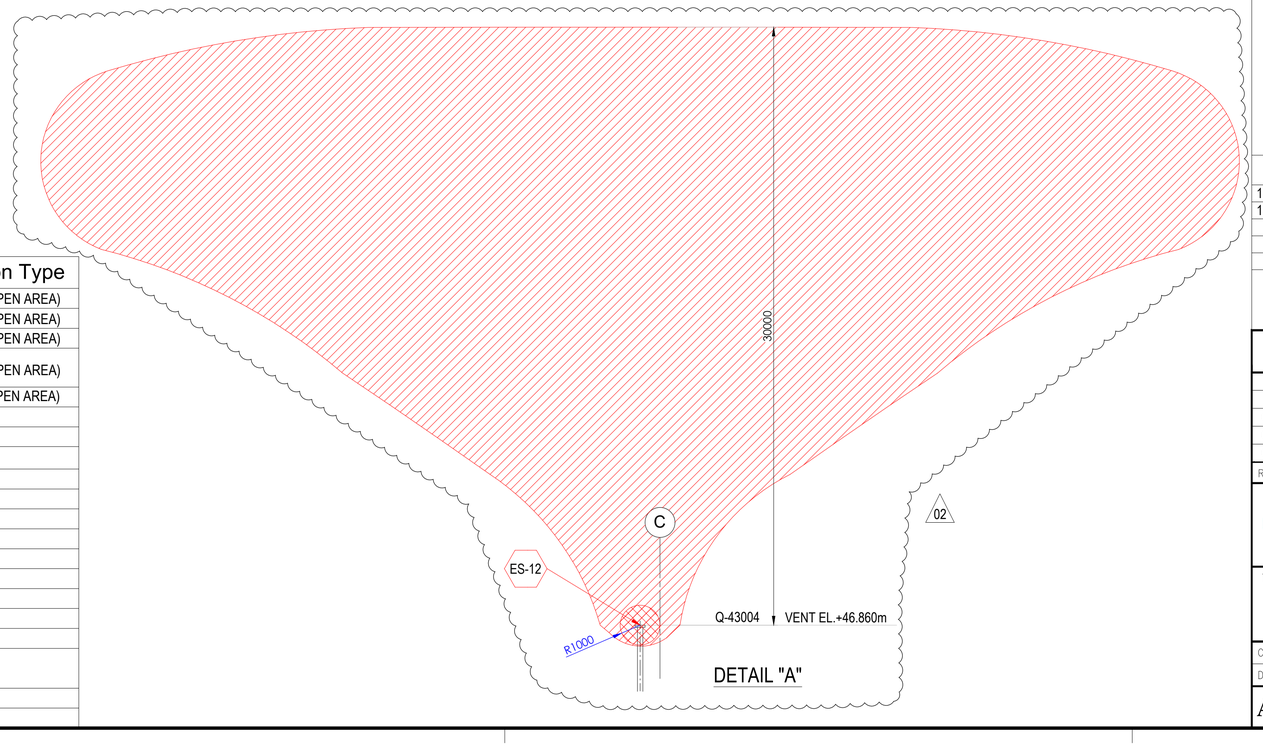



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

Rotork Fluid Systems s.r.l.
Via padre Jacques Hamel, 138 B
55016 Porcari, Lucca
Italy

Tel. +39 0583 2221
Fax. +39 0585 091362
http://www.rotork.com

rotork
Fluid Systems

DECLARATION

Rotork Fluid Systems s.r.l. herewith declares that for the job AF7703, as the supplier of the following equipment:

Product: Safety Relief Valve (PSV)
Type/Model: D10/S INOX
Serial Number(s): 025308828; 025308829; 025308830; 025308831; 025308832; 025308833; 025308834; 025308835; 025308836; 025308837; 025308838; 025308839; 025308840; 025308841; 025308842; 025308843; 025308844; 025308845; 025308846; 025308847; 025308848; 025308849; 025308850; 025308851; 025308852; 025308853; 025308854; 025308855.
Intended Use: Installation in ATEX Zone 2 – Gas Group IIC / IIB + H_2
Category: II 2G
Protection Type: Ex h IIC T6 Gb X (non-electrical equipment)

Hereby declares under its sole responsibility that the above equipment has been purchased in full compliance with the requirements of:

- Directive 2014/34/EU (ATEX)
- Harmonised standards: EN ISO 80079-36:2016 and EN ISO 80079-37:2016
- The relevant essential health and safety requirements as set out in Annex II of Directive 2014/34/EU.

This product is not yet in service and is currently installed but not operational. According to applicable legislation and guidance (including the Blue Guide 2022 and ATEX Guidelines 3rd Edition, July 2023), the CE and ATEX markings can be legitimately applied, even if the equipment has already been installed.
The conformity assessment procedure followed is: Internal production control (Annex VIII – Module A), with the technical documentation deposited with the Notified Body:
Notified Body: TUV SUD Italia – NB N° 0948
Reference: TUV IT 18 ATEX 032 AR
We hereby authorise the application of the ATEX marking in situ, under our responsibility, following the above.
This declaration is issued under the sole responsibility of the supplier.

Lucca, 18/04/2025

On behalf of Rotork Fluid Systems s.r.l.

Lucia Fregoli – Quality Manager

NUOVA GENERAL INSTRUMENTS s.r.l.
LOC. CAMPASSO - 29010 PIANELLO VALTIDONE (PC) Italy - Tel. +39 0523994629 - Fax +39 0523997219
http:// www.nuovageneral.it - E-mail: info@nuovageneral.it - P.IVA 01337040339 - C.F. 01317650065
REA-PC 117793 - Reg. Imp.PC 01317650065 - Capitale Sociale € 100.000,00 i.v.

N. **025308837**

Tipo: (Typ.): **D10/S INOX**

Dis. : **009-0 Rev. 24/10/22**

DICHIARAZIONE DI CONFORMITÁ UE Allegato IV, D. E. 2014/68/UE - Allegato VIII, D.E. 2014/34/UE
DECLARATION OF CONFORMITY EU Annex IV, E. D. 2014/68/EU - Annex VIII, E.D. 2014/34/EU
KONFORMITATSERKLARUNG EU Anlage IV Richtlinie 2014/68/EU - Anlage VIII Richtlinie 2014/34/EU
DECLARATION DE CONFORMITÉ UE Annexe IV D.E. 2014/68/UE - Annex VIII D.E. 2014/34/UE

VALVOLA DI SICUREZZA
SAFETY VALVE
SICHERHEITSVENTIL
SOUPAPE DE SURETE

PROGETTO , COSTRUZIONE E COLLAUDO CONFORME ALLA DIRETTIVA 2014/68/UE - 15/05/14 CATEGORIA IV Modulo H1
DESIG , MANUFACTURE AND TEST ACCORDING TO 2014/68/EU DIRECTIVE - 15/05/14 CLASS IV Module H1
PROJEKT , KONSTRUKTION UND ABNAHMEPRUFUNG GEMAB EG-RICHTLINIE 2014/68/EU - 15/05/14 KATEGORIE IV Formblatt H1
PROJET,FABRICATION ET VERIFICATION CONFORME A LA DIRECTIVE 2014/68/UE-15/05/14 CATEGORIE IV Module H1

Garanzia qualità totale Nr. : **Full quality assurance system Nr. :**
Garantie gesamte Qualität Nr. : **Garantie qualité totale Nr.:**
Module H1 : DGR-0036-QS-1180-24

Norme e spec. utilizzate : (Codes or spec.ref.) : *(Angewandte normen und spezifikationen) :* (Regulements et spec. utilise):
AD-Merkblatt A2 - VdTUV-Merkblatt Sicherheitsventil 100 / Racc."E"1979 / EN80079-36:2016 -37:2016 / ISO4126-1 / AS1271:2003 / EN13648-1 / UNI 10197

Organismo notificato: (Notified body): *(Meldestelle):* (Organisme agree):
TÜV SÜD Industrie Service GmbH
Westendstraße 199
D 80686 Munich
0036


II 2G Ex h IIC T6 Gb X
File : TÜV IT 18 ATEX 032 AR

Questa dichiarazione di conformità è rilasciata sotto la sola responsabilità del produttore. - *This declaration of conformity is issued under the sole responsability of the manufacturer.* - Diese Konformitätserklärung wird unter der alleinigen Verantwortung des Herstellers ausgestellt.
Cette déclaration de conformité est émise sous la seule responsabilité du fabricant.

Fluido - *Fluid* - **Fluide**
G / S / L
Group 1 or 2

- Marchio del costruttore: (Manifacturer's Mark): *(Herstellerzeichen):* **(Marquae du constructeur)**

- Materiali: (Material): *(Material):* **(Matériaux):**

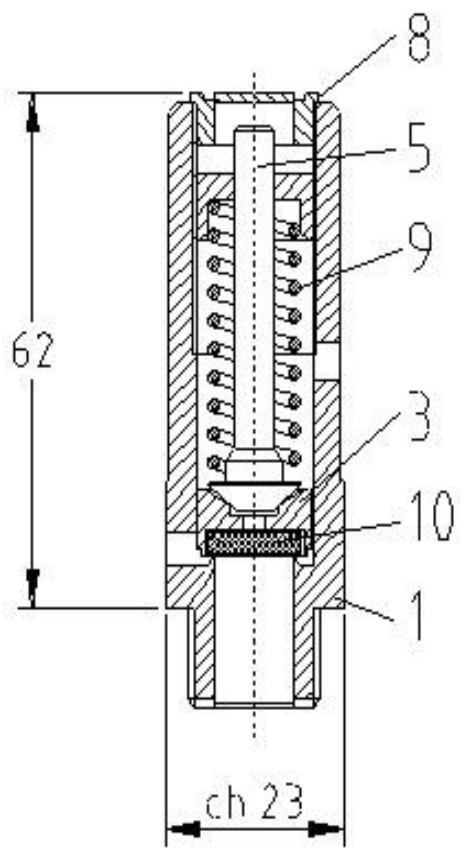

1- UNI EN 10088 1.4404
3- UNI EN 10088 1.4404
5- UNI EN 10088 1.4404
8- UNI EN 10088 1.4404
9- UNI EN 10270-3 1.4310

10 VITON (-20 / +200 °C)

Anno costruzione:
(Year of manufacture):
(Baujahr):
(Annee de fabrication):
2025

- P.N.: **60** *(Nenndruck):*

- h / do: **0,4**

- D.N.: (Nominal Diameter): *(Anschlusgewinde):* **(D.N):**

- Entrata: (In): *(Eintritt):* **(Entre):** **1/2" NPT**

- Uscita: (Out): *(Austritt):* **(Sortie):**

- Diametro orifizio: do (Opening diameter): do *(Innen durchmrsser): do* **(Diametre orifice):do** **10** mm

- Area: (Area): *(Offnung):* **(Surface):** **0,785** cm²

- Alzata: h (Valve Lift): h *(Hub): h* **(Haussement): h** **4** mm

- Limiti di temperatura di esercizio dei materiali utilizzati a pressione atmosferica: (Operating temperature limits for materials used at atmospheric pressure): **-20 / +200 °C** *(Betriebstemperaturgrenze der unter Luftdruck verwendeten Materialien):* **(Limites de température de fonctionnement des matériaux utilisés sous pression atmosphérique):**

- Coefficiente di efflusso : (Flow coefficient.): *(AusfluBziffer.):* **(Coefficient d'écoulement** **Kd 0,86**

- Coefficiente di efflusso ridotto : (Reduced flow coefficient): *(Reduzierte Ausflußziffer):* **(Coefficient d'écoulement réduit** **Kdr = 0,9xKd = 0,77**

- Pressione di taratura: (Setting Pressure): *(Abgleichungssdruck):* **(Pression de tarage):** **4,7** bar g

- Variabilità campo di taratura: (Variability Setting Filed): *(Abgleichungsberelch):* **(Variabilite champ de tarage):** **3,1 - 5** bar g

- Sovrappressione: (Overpressure): *(Uber-Unterdruck):* **(Surpression):** **10%** % della pressione di taratura (% of Setting Pressure) *(% Abgieichungsdruck)* **(% De la pression de tarage)**

- Scarto di chiusura: (Closing variation): *(Unterdruck):* **(Ecart de fermature):** **15%** % della pressione di taratura (% of Setting Pressure) *(% Abgieichungsdruck)* **(% De la pression de tarage)**

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide): **ARIA-AIR-LUFT** Temper. : **0** °C

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** **328,02** kg/h **253,73** Nm³ / h **4228,82** lt/min.

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide):

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** kg/h Nm³ / h lt/min.

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide):

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** kg/h Nm³ / h lt/min.

Si dichiara che la valvola ha subito con buon esito il controllo finale compreso il test di tenuta (90% Pset) e la prova idraulica del corpo a 1,5 x P.N.
We declare that this valve has passed successfully the test, the seat tightness test (90% Pset) and the hydraulic test of the body to 1,5 x P.N.
Hiermit bestätigen wir, dass das Ventil die Abschlusskontrolle einschließlich der Sitzdichtheit (90%Pset) und hydraulischen Gehäuseprüfung mit einem Druck von 1,5 x P.N.
On declare que la soupape a ete soumise avec resultat satisfiant a le control final y-compri l'epreuve d'étanchéité (90% Pset) et l'epreuve hydraulique du corps a 1,5xPN.

EN 10204 3.1 Cod. : **00F16D10SSVNPAX047**

Nr.Ord. : D2500700 REV 1

S.V. Code : 00F16D10SSVNPAX047

Date : 17/04/2025

NUOVA GENERAL INSTRUMENTS SRL
Albertini Patrizia (CEO)

NUOVA GENERAL INSTRUMENTS

	I Descrizione ATEX-UKEX	GB Atex-UKEX Description	D *Beschreibung ATEX-UKEX*	F Description ATEX-UKEX	ES Descripción ATEX-UKEX
	Simbolo rappresentativo per dispositivi certificati ATEX-UKEX	Representative symbol of ATEX-UKEX certified equipment	*Repräsentatives Symbol für ATEX-UKEX zertifizierte Geräte*	Symbole représentatif des équipements certifiés ATEX-UKEX	*Símbolo representativo para dispositivos con certificación ATEX-UKEX*
II	Gruppo dell'apparecchio	Equipment's group	*Gerätegruppe*	Groupe d'appareils	*Grupo de dispositivos*
2	Categoria dell'apparecchio	Equipment's category	*Gerätekategorie*	Catégorie d'appareils	*Categoría de dispositivos*
G	Protezione delle atmosfere esplosive dovute a presenza di GAS, VAPORI E NEBBIE	Protected to explosive atmosphere due to GAS, STEAM and FOG	*Schutz explosionsfähiger Atmosphären durch GAS, DAMPF UND NEBEL*	Protection des atmosphères explosives grâce à la présence de GAZ, VAPEURS ET BROUILLARDS	*Protección de atmósferas explosivas debido a la presencia de GAS, VAPOR Y NIEBLA*
GD	Protezione delle atmosfere esplosive dovute a presenza di GAS, VAPORI, NEBBIE, NUBI e POLVERI	Protected to explosive atmosphere due to GAS, STEAM, FOG and DUST	*Schutz explosionsfähiger Atmosphären durch GAS, DAMPF, NEBEL, WOLKEN und PULVER*	Protection des atmosphères explosives grâce à la présence de GAZ, VAPEURS, BROUILLARDS, NUAGES et POUSSIÈRES	*Protección de atmósferas explosivas debido a la presencia de GAS, VAPORES, NIEBLA, NUBES y POLVO*
Ex h (Type of protection "c" constructional safety)	Indicazione di apparecchiatura non elettrica	Non-electrical equipment indication	*Hinweis auf nichtelektrische Geräte*	Indication des équipements non électriques	*Indicación de equipos no eléctricos*
IIC	Sottodivisione del gruppo di apparecchi	Equipment group subdivision	*Unterteilung der Gerätegruppe*	Subdivision du groupe d'appareils	*Subdivisión del grupo de dispositivos*
T6	Temperatura massima di parete ≤85°C	Maximum surface temperature ≤85°C	*Maximale Oberflächentemperatur ≤85 ° C*	Température maximale de paroi ≤85 ° C	*Temperatura máxima de la pared ≤85 ° C*
Gb	Equipment Protection Level (EPL)	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*
GbDb	Equipment Protection Level (EPL)	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*
X	La massima temperatura superficiale potrebbe essere superiore alla classe di temperatura, si raccomanda come massima temperatura il valore maggiore tra T6 e la max Temperatura ammissibile per la tenuta (V. COC)	The max surface temperature could be higher than the temperature class, it is recommended as max temperature the higher value between T6 and the max Admissible temperature for the seal (V. COC)	*Die max. Oberflächentemperatur kann höher sein als die Temperaturklasse, als max. Temperatur wird der höhere Wert zwischen T6 und der max. zulässigen Temperatur für die Dichtung (V. COC) empfohlen.*	La température de surface maximale peut être supérieure à la classe de température, il est recommandé comme température maximale la valeur la plus élevée entre T6 et la température maximale admissible pour le joint (V. COC)	*La temperatura máxima de la superficie podría ser superior a la clase de temperatura, se recomienda como temperatura máxima el valor más alto entre T6 y la temperatura máxima admisible para el sello (V. COC)*

ITEM	Tag	25-PSV-008	: Safety Valve - Vessel V-25001B Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10004835	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK / Discipline: ATEX / Form: CJX01		Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**	25308840				
Manufacturer	NUOVA GENERAL INSTRUMENTS			**Model**	D10/S				
Cert No.	D.o.C. by Manufacturer			**Equipment Ambient Temp.**	-20 °C to +40 °C				
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	NA

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	NA	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PSV-008	: Safety Valve - Vessel V-25001B Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004835		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-PSV-008	: Safety Valve - Vessel V-25001B Hydrogen Inlet		Dwg	123A90-DDL-PR-PID-80016	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10004835	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-29	2025-02-03	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:43:42.479Z	PROVERLIS Digitaly signed by Luca Mussi 2025-02-03T12:50:38.970Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

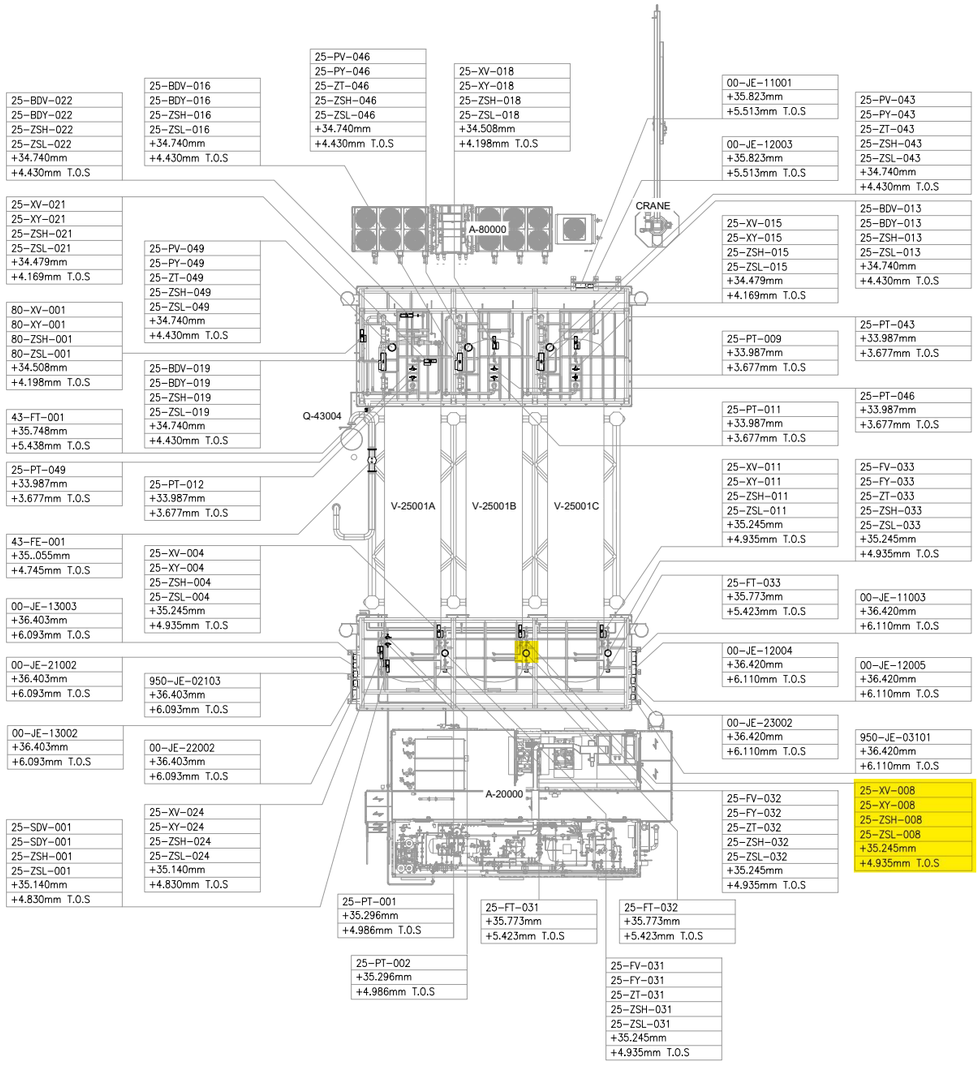

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081
REV.: 2_A | DATE: 07/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90–DDL–IN–DL–40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 B

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

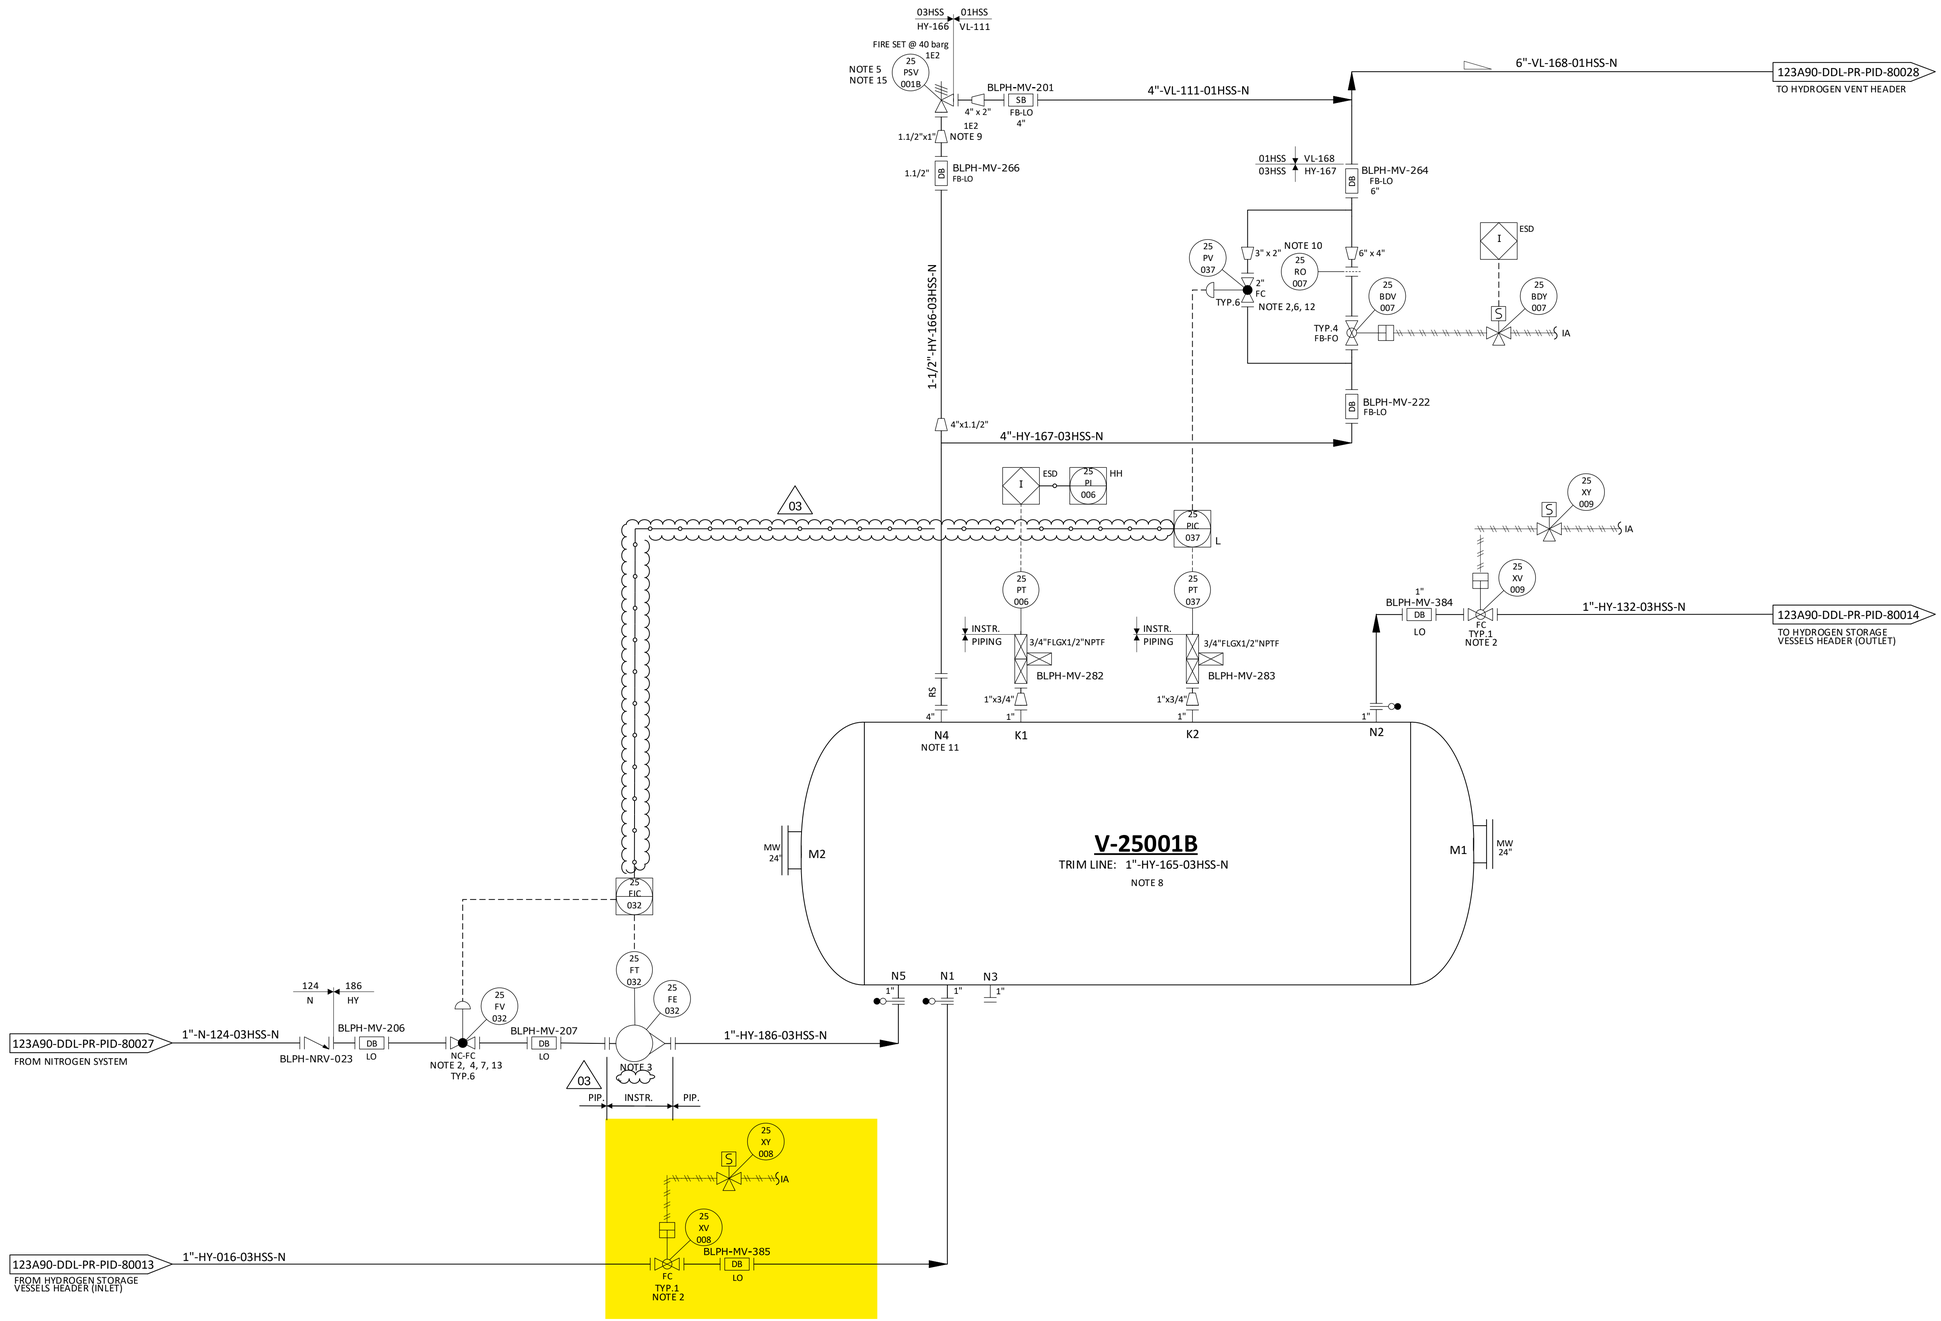

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-032) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. (03)
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-037 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC."PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-037 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. (03)
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-032 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-037 HAS FAILED TO CLOSE.
15. 25-PSV-001B SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL B

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80016	SHEET 001	REV. 03

File Name : FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

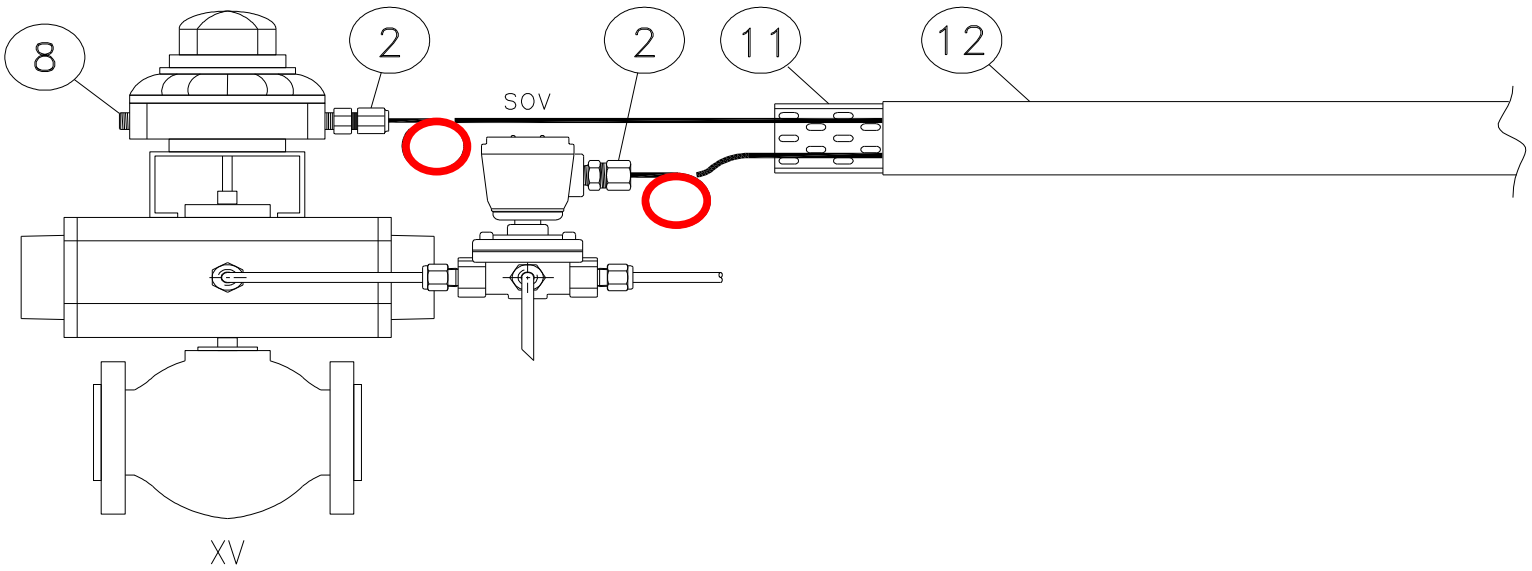

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

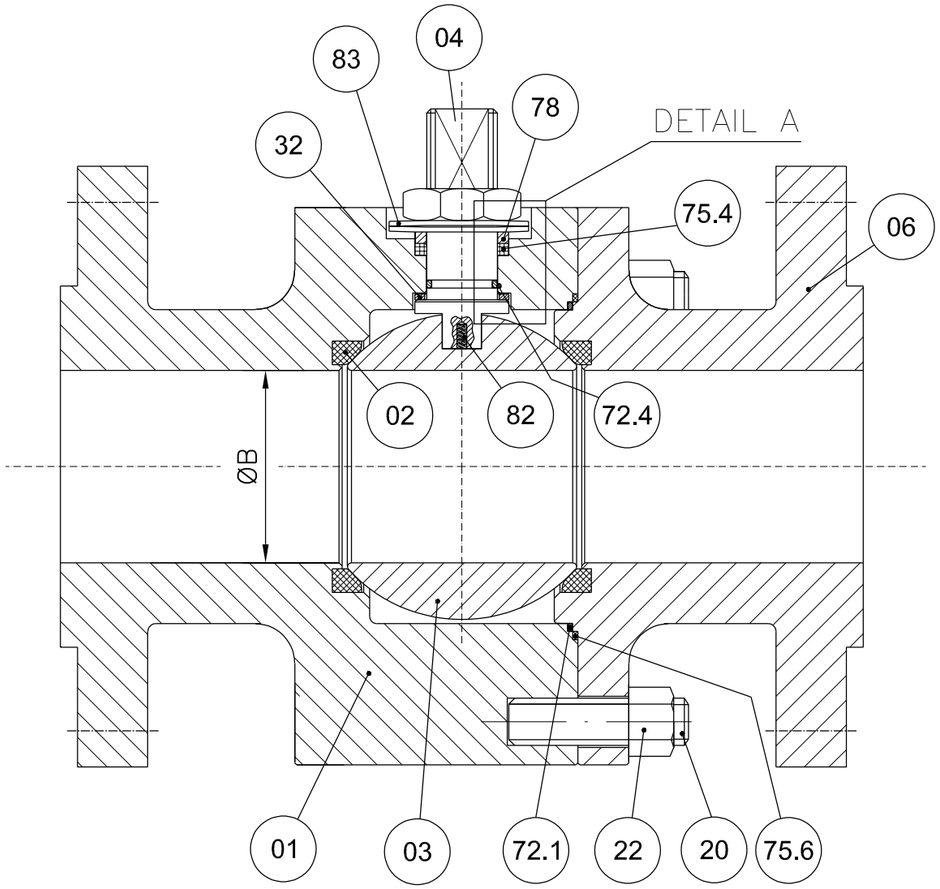




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301



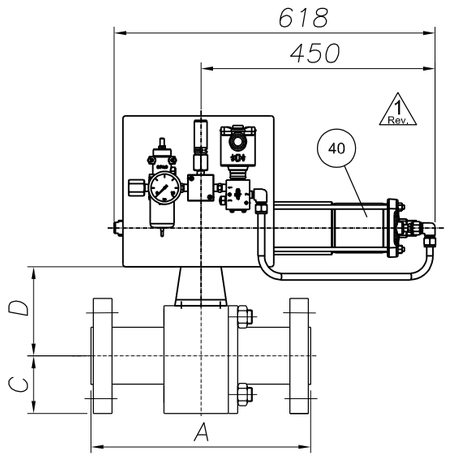

ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

Fluitek Valves

DRAWING NOT IN SCALE

DRAWN: S.Madahar — DATE: 26/02/2024
CHK'D: D.Barcella — DATE: 26/02/2024
APPV'D: L.Mora — DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWING NAME: **D240062-08**

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-008		25
	2	Service				HYDROGEN STORAGE TANK V-25001B INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80016		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-016-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-008(9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-008 (9, 17) - Soldo SS		25-ZSH-008 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR	25-SDV-023	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

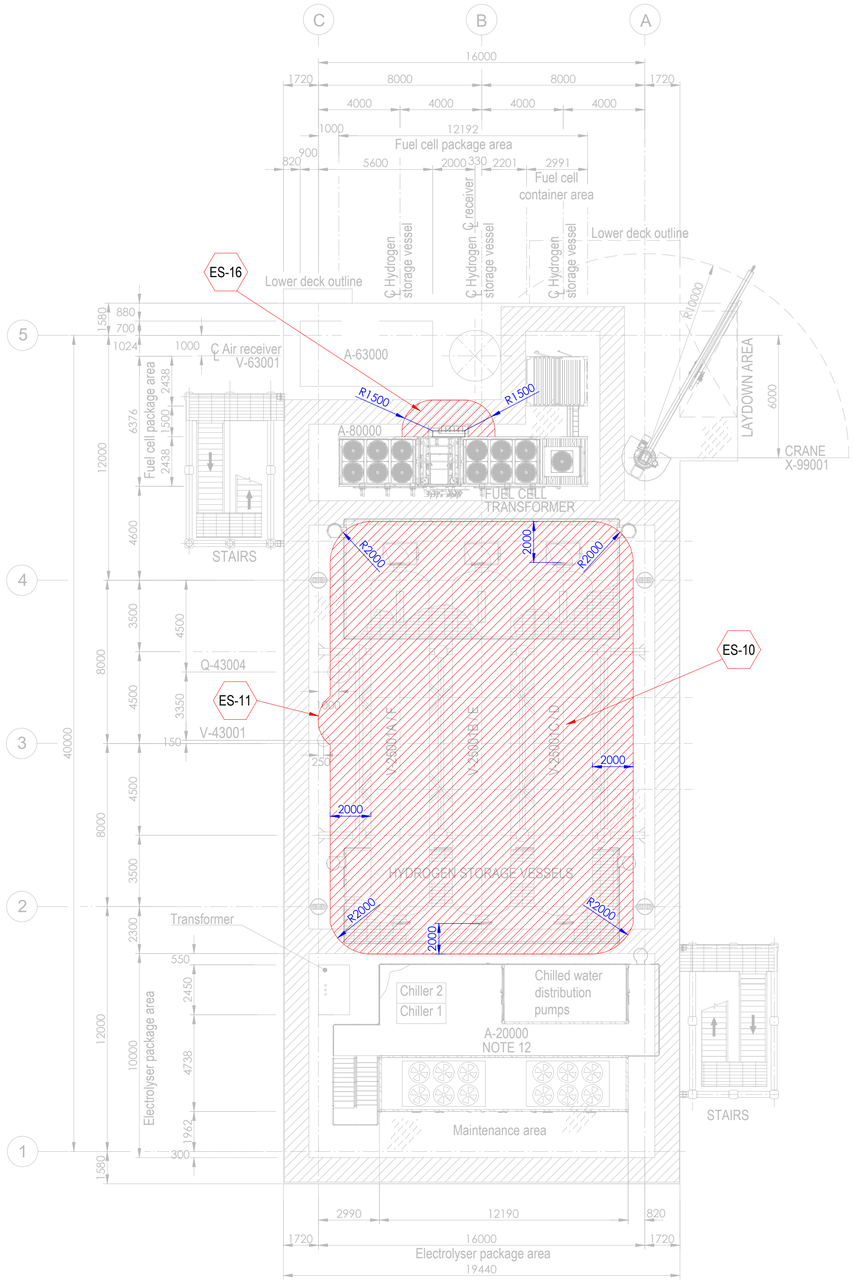


PLAN ON UPPER DECK
EL+30.310 T.O.S.

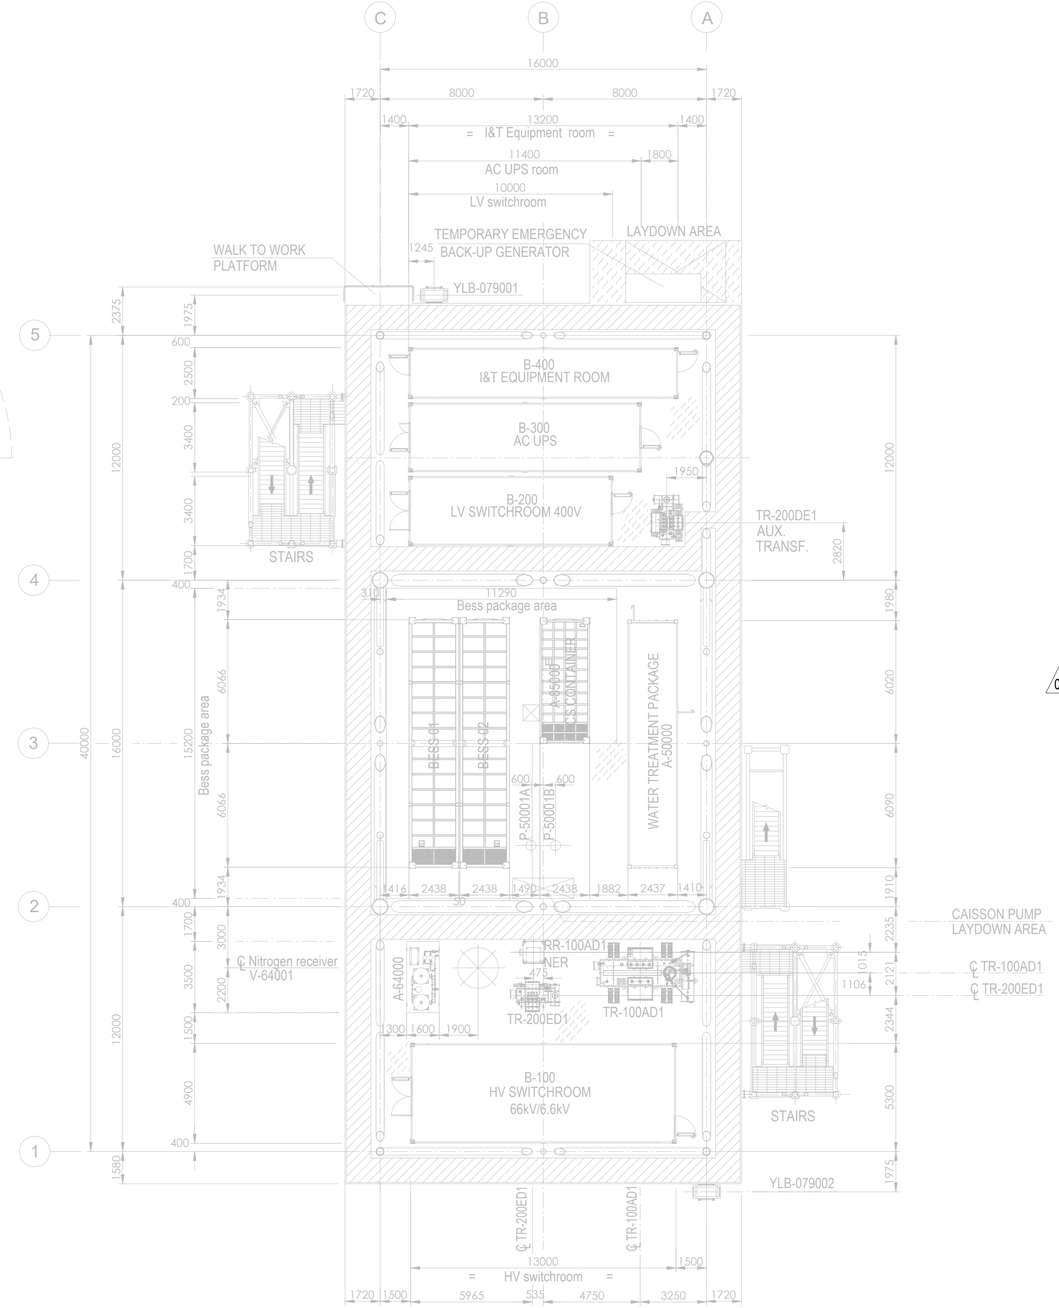

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

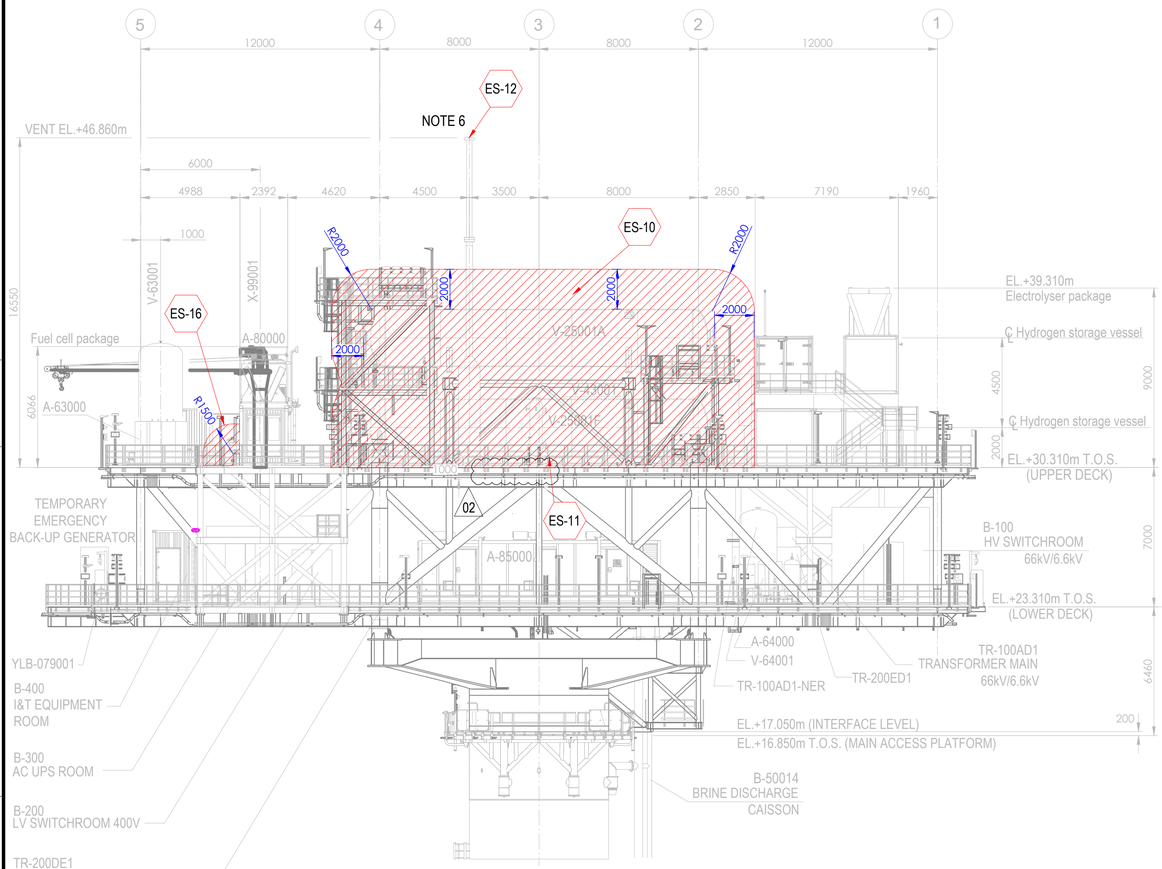



ELEVATION LOOKING EAST

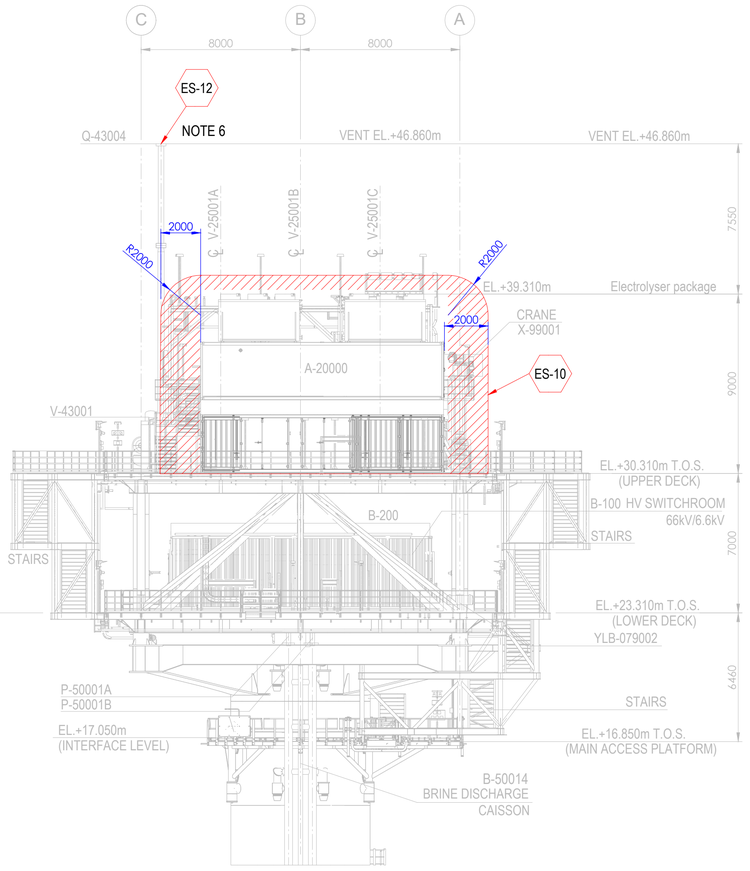

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

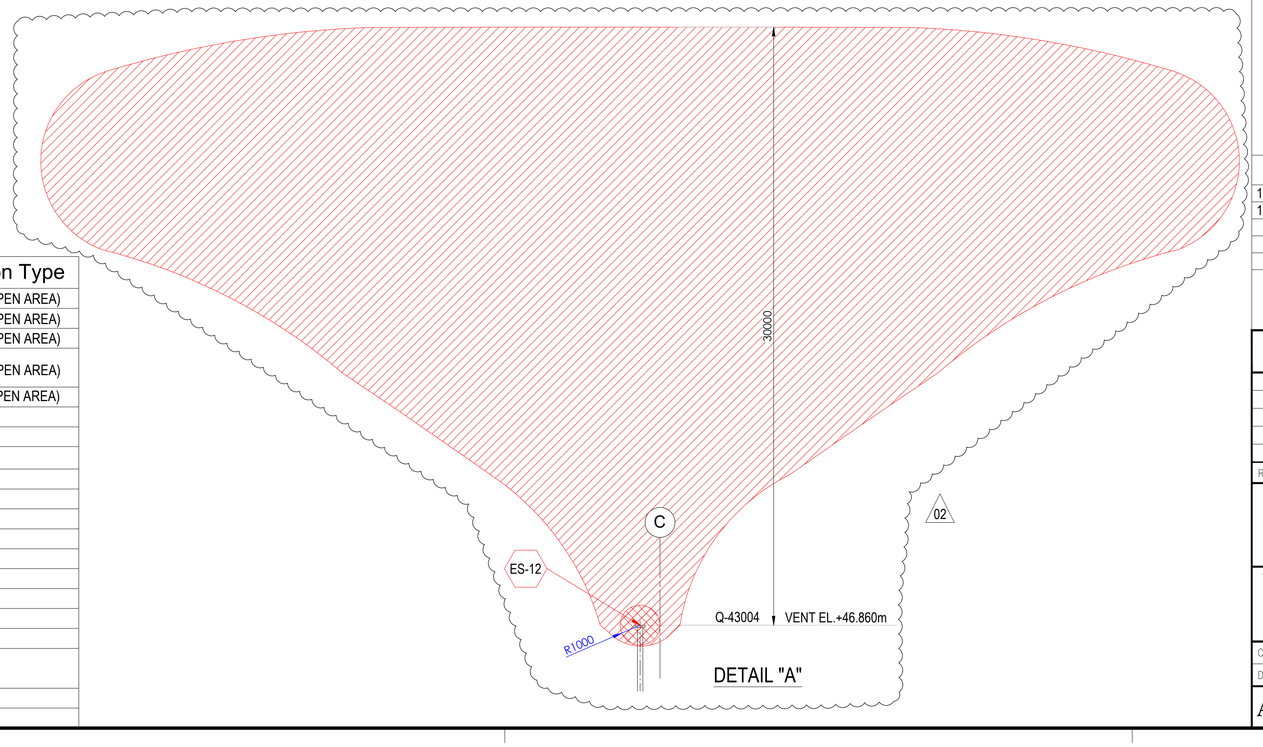



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

Rotork Fluid Systems s.r.l.
Via padre Jacques Hamel, 138 B
55016 Porcari, Lucca
Italy

Tel. +39 0583 2221
Fax. +39 0585 091362
http://www.rotork.com

rotork
Fluid Systems

DECLARATION

Rotork Fluid Systems s.r.l. herewith declares that for the job AF7703, as the supplier of the following equipment:

Product: Safety Relief Valve (PSV)
Type/Model: D10/S INOX
Serial Number(s): 025308828; 025308829; 025308830; 025308831; 025308832; 025308833; 025308834; 025308835; 025308836; 025308837; 025308838; 025308839; 025308840; 025308841; 025308842; 025308843; 025308844; 025308845; 025308846; 025308847; 025308848; 025308849; 025308850; 025308851; 025308852; 025308853; 025308854; 025308855.
Intended Use: Installation in ATEX Zone 2 – Gas Group IIC / IIB + H_2
Category: II 2G
Protection Type: Ex h IIC T6 Gb X (non-electrical equipment)

Hereby declares under its sole responsibility that the above equipment has been purchased in full compliance with the requirements of:

- Directive 2014/34/EU (ATEX)
- Harmonised standards: EN ISO 80079-36:2016 and EN ISO 80079-37:2016
- The relevant essential health and safety requirements as set out in Annex II of Directive 2014/34/EU.

This product is not yet in service and is currently installed but not operational. According to applicable legislation and guidance (including the Blue Guide 2022 and ATEX Guidelines 3rd Edition, July 2023), the CE and ATEX markings can be legitimately applied, even if the equipment has already been installed.
The conformity assessment procedure followed is: Internal production control (Annex VIII – Module A), with the technical documentation deposited with the Notified Body:
Notified Body: TUV SUD Italia – NB N° 0948
Reference: TUV IT 18 ATEX 032 AR
We hereby authorise the application of the ATEX marking in situ, under our responsibility, following the above.
This declaration is issued under the sole responsibility of the supplier.

Lucca, 18/04/2025

On behalf of Rotork Fluid Systems s.r.l.

Lucia Fregoli – Quality Manager

NUOVA GENERAL INSTRUMENTS s.r.l.
LOC. CAMPASSO - 29010 PIANELLO VALTIDONE (PC) Italy - Tel. +39 0523994629 - Fax +39 0523997219
http:// www.nuovageneral.it - E-mail: info@nuovageneral.it - P.IVA 01337040339 - C.F. 01317650065
REA-PC 117793 - Reg. Imp.PC 01317650065 - Capitale Sociale € 100.000,00 i.v.

N. 025308840

Tipo: (Typ.): **D10/S INOX**

Dis. : 009-0 Rev. 24/10/22

DICHIARAZIONE DI CONFORMITÁ UE Allegato IV, D. E. 2014/68/UE - Allegato VIII, D.E. 2014/34/UE
DECLARATION OF CONFORMITY EU Annex IV, E. D. 2014/68/EU - Annex VIII, E.D. 2014/34/EU
KONFORMITATSERKLARUNG EU Anlage IV Richtlinie 2014/68/EU - Anlage VIII Richtlinie 2014/34/EU
DECLARATION DE CONFORMITÉ UE Annexe IV D.E. 2014/68/UE - Annex VIII D.E. 2014/34/UE

VALVOLA DI SICUREZZA
SAFETY VALVE
SICHERHEITSVENTIL
SOUPAPE DE SURETE

PROGETTO , COSTRUZIONE E COLLAUDO CONFORME ALLA DIRETTIVA 2014/68/UE - 15/05/14 CATEGORIA IV Modulo H1
DESIG , MANUFACTURE AND TEST ACCORDING TO 2014/68/EU DIRECTIVE - 15/05/14 CLASS IV Module H1
PROJEKT , KONSTRUKTION UND ABNAHMEPRUFUNG GEMAB EG-RICHTLINIE 2014/68/EU - 15/05/14 KATEGORIE IV Formblatt H1
PROJET,FABRICATION ET VERIFICATION CONFORME A LA DIRECTIVE 2014/68/UE-15/05/14 CATEGORIE IV Module H1

Garanzia qualità totale Nr. : **Full quality assurance system Nr. :**
Garantie gesamte Qualität Nr. : **Garantie qualité totale Nr.:**
Module H1 : DGR-0036-QS-1180-24

Norme e spec. utilizzate : (Codes or spec.ref.) : *(Angewandte normen und spezifikationen) :* (Regulements et spec. utilise):
AD-Merkblatt A2 - VdTUV-Merkblatt Sicherheitsventil 100 / Racc."E"1979 / EN80079-36:2016 -37:2016 / ISO4126-1 / AS1271:2003 / EN13648-1 / UNI 10197

Organismo notificato: (Notified body): *(Meldestelle):* (Organisme agree):
TÜV SÜD Industrie Service GmbH
Westendstraße 199
D 80686 Munich
0036


II 2G Ex h IIC T6 Gb X
File : TÜV IT 18 ATEX 032 AR

Questa dichiarazione di conformità è rilasciata sotto la sola responsabilità del produttore. - *This declaration of conformity is issued under the sole responsability of the manufacturer.* - Diese Konformitätserklärung wird unter der alleinigen Verantwortung des Herstellers ausgestellt.
Cette déclaration de conformité est émise sous la seule responsabilité du fabricant.

Fluido - *Fluid* - **Fluide**
G / S / L
Group 1 or 2

- Marchio del costruttore: (Manifacturer's Mark): *(Herstellerzeichen):* **(Marquae du constructeur)**

- Materiali: (Material): *(Material):* **(Matériaux):**

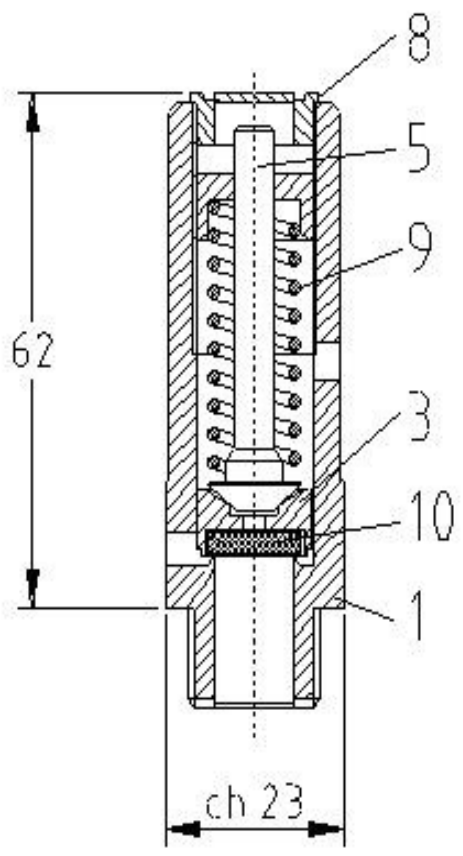

1- UNI EN 10088 1.4404
3- UNI EN 10088 1.4404
5- UNI EN 10088 1.4404
8- UNI EN 10088 1.4404
9- UNI EN 10270-3 1.4310

10 VITON (-20 / +200 °C)

Anno costruzione:
(Year of manufacture):
(Baujahr):
(Annee de fabrication):
2025

- P.N.: **60** *(Nenndruck):*

- h / do: **0,4**

- D.N.: (Nominal Diameter): *(Anschlusgewinde):* **(D.N):**

- Entrata: (In): *(Eintritt):* **1/2" NPT** **(Entre):**

- Uscita: (Out): *(Austritt):* **(Sortie):**

- Diametro orifizio: do (Opening diameter): do *(Innen durchmrsser): do* **(Diametre orifice):do** **10** mm

- Area: (Area): *(Offnung):* **(Surface):** **0,785** cm²

- Alzata: h (Valve Lift): h *(Hub): h* **(Haussement): h** **4** mm

- Limiti di temperatura di esercizio dei materiali utilizzati a pressione atmosferica: (Operating temperature limits for materials used at atmospheric pressure): *(Betriebstemperaturgrenze der unter Luftdruck verwendeten Materialien):* **(Limites de température de fonctionnement des matériaux utilisés sous pression atmosphérique):** **-20 / +200 °C**

- Coefficiente di efflusso : (Flow coefficient.): *(AusfluBziffer.):* **(Coefficient d'écoulement** **Kd 0,86**

- Coefficiente di efflusso ridotto : (Reduced flow coefficient): *(Reduzierte Ausflußziffer):* **(Coefficient d'écoulement réduit** **Kdr = 0,9xKd = 0,77**

- Pressione di taratura: (Setting Pressure): *(Abgleichungssdruck):* **(Pression de tarage):** **4,7** bar g

- Variabilità campo di taratura: (Variability Setting Filed): *(Abgleichungsberelch):* **(Variabilite champ de tarage):** **3,1 - 5** bar g

- Sovrappressione: (Overpressure): *(Uber-Unterdruck):* **(Surpression):** **10%** % della pressione di taratura (% of Setting Pressure) *(% Abgieichungsdruck)* **(% De la pression de tarage)**

- Scarto di chiusura: (Closing variation): *(Unterdruck):* **(Ecart de fermature):** **15%** % della pressione di taratura (% of Setting Pressure) *(% Abgieichungsdruck)* **(% De la pression de tarage)**

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide): **ARIA-AIR-LUFT** Temper. : **0** °C
- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** **328,02** kg/h **253,73** Nm³ / h **4228,82** lt/min.

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide):
- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** kg/h Nm³ / h lt/min.

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide):
- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** kg/h Nm³ / h lt/min.

Si dichiara che la valvola ha subito con buon esito il controllo finale compreso il test di tenuta (90% Pset) e la prova idraulica del corpo a 1,5 x P.N.
We declare that this valve has passed successfully the test, the seat tightness test (90% Pset) and the hydraulic test of the body to 1,5 x P.N.
Hiermit bestätigen wir, dass das Ventil die Abschlusskontrolle einschließlich der Sitzdichtheit (90%Pset) und hydraulischen Gehäuseprüfung mit einem Druck von 1,5 x P.N.
On declare que la soupape a ete soumise avec resultat satisfiant a le control final y-compri l'epreuve d'étanchéité (90% Pset) et l'epreuve hydraulique du corps a 1,5xPN.

EN 10204 3.1 Cod. : **00F16D10SSVNPAX047**

Nr.Ord. : D2500700 REV 1

S.V. Code : 00F16D10SSVNPAX047

Date : 17/04/2025

NUOVA GENERAL INSTRUMENTS SRL
Albertini Patrizia (CEO)

NUOVA GENERAL INSTRUMENTS

	I Descrizione ATEX-UKEX	GB Atex-UKEX Description	D *Beschreibung ATEX-UKEX*	F Description ATEX-UKEX	ES Descripción ATEX-UKEX
	Simbolo rappresentativo per dispositivi certificati ATEX-UKEX	Representative symbol of ATEX-UKEX certified equipment	*Repräsentatives Symbol für ATEX-UKEX zertifizierte Geräte*	Symbole représentatif des équipements certifiés ATEX-UKEX	*Símbolo representativo para dispositivos con certificación ATEX-UKEX*
II	Gruppo dell'apparecchio	Equipment's group	*Gerätegruppe*	Groupe d'appareils	*Grupo de dispositivos*
2	Categoria dell'apparecchio	Equipment's category	*Gerätekategorie*	Catégorie d'appareils	*Categoría de dispositivos*
G	Protezione delle atmosfere esplosive dovute a presenza di GAS, VAPORI E NEBBIE	Protected to explosive atmosphere due to GAS, STEAM and FOG	*Schutz explosionsfähiger Atmosphären durch GAS, DAMPF UND NEBEL*	Protection des atmosphères explosives grâce à la présence de GAZ, VAPEURS ET BROUILLARDS	*Protección de atmósferas explosivas debido a la presencia de GAS, VAPOR Y NIEBLA*
GD	Protezione delle atmosfere esplosive dovute a presenza di GAS, VAPORI, NEBBIE, NUBI e POLVERI	Protected to explosive atmosphere due to GAS, STEAM, FOG and DUST	*Schutz explosionsfähiger Atmosphären durch GAS, DAMPF, NEBEL, WOLKEN und PULVER*	Protection des atmosphères explosives grâce à la présence de GAZ, VAPEURS, BROUILLARDS, NUAGES et POUSSIÈRES	*Protección de atmósferas explosivas debido a la presencia de GAS, VAPORES, NIEBLA, NUBES y POLVO*
Ex h (Type of protection "c" constructional safety)	Indicazione di apparecchiatura non elettrica	Non-electrical equipment indication	*Hinweis auf nichtelektrische Geräte*	Indication des équipements non électriques	*Indicación de equipos no eléctricos*
IIC	Sottodivisione del gruppo di apparecchi	Equipment group subdivision	*Unterteilung der Gerätegruppe*	Subdivision du groupe d'appareils	*Subdivisión del grupo de dispositivos*
T6	Temperatura massima di parete ≤85°C	Maximum surface temperature ≤85°C	*Maximale Oberflächentemperatur ≤85 ° C*	Température maximale de paroi ≤85 ° C	*Temperatura máxima de la pared ≤85 ° C*
Gb	Equipment Protection Level (EPL)	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*
GbDb	Equipment Protection Level (EPL)	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*
X	La massima temperatura superficiale potrebbe essere superiore alla classe di temperatura, si raccomanda come massima temperatura il valore maggiore tra T6 e la max Temperatura ammissibile per la tenuta (V. COC)	The max surface temperature could be higher than the temperature class, it is recommended as max temperature the higher value between T6 and the max Admissible temperature for the seal (V. COC)	*Die max. Oberflächentemperatur kann höher sein als die Temperaturklasse, als max. Temperatur wird der höhere Wert zwischen T6 und der max. zulässigen Temperatur für die Dichtung (V. COC) empfohlen.*	La température de surface maximale peut être supérieure à la classe de température, il est recommandé comme température maximale la valeur la plus élevée entre T6 et la température maximale admissible pour le joint (V. COC)	*La temperatura máxima de la superficie podría ser superior a la clase de temperatura, se recomienda como temperatura máxima el valor más alto entre T6 y la temperatura máxima admisible para el sello (V. COC)*

ITEM	Tag	25-PSV-011	: Safety Valve - Vessel V-25001C Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80017		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10004837	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		25308838			
Manufacturer	NUOVA GENERAL INSTRUMENTS			**Model**		D10/S			
Cert No.	D.o.C. by Manufacturer			**Equipment Ambient Temp.**		-20 °C to +40 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	NA

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	NA	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PSV-011	: Safety Valve - Vessel V-25001C Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80017
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004837		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	25-PSV-011	: Safety Valve - Vessel V-25001C Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80017		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10004837	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type "nR" only)	x	NA	
71	Breathing operation is satisfactory (type "nR" only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for 'IS' Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-29	2025-02-03	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:44:10.867Z	PROVERLIS Digitaly signed by Luca Mussi 2025-02-03T12:49:54.410Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

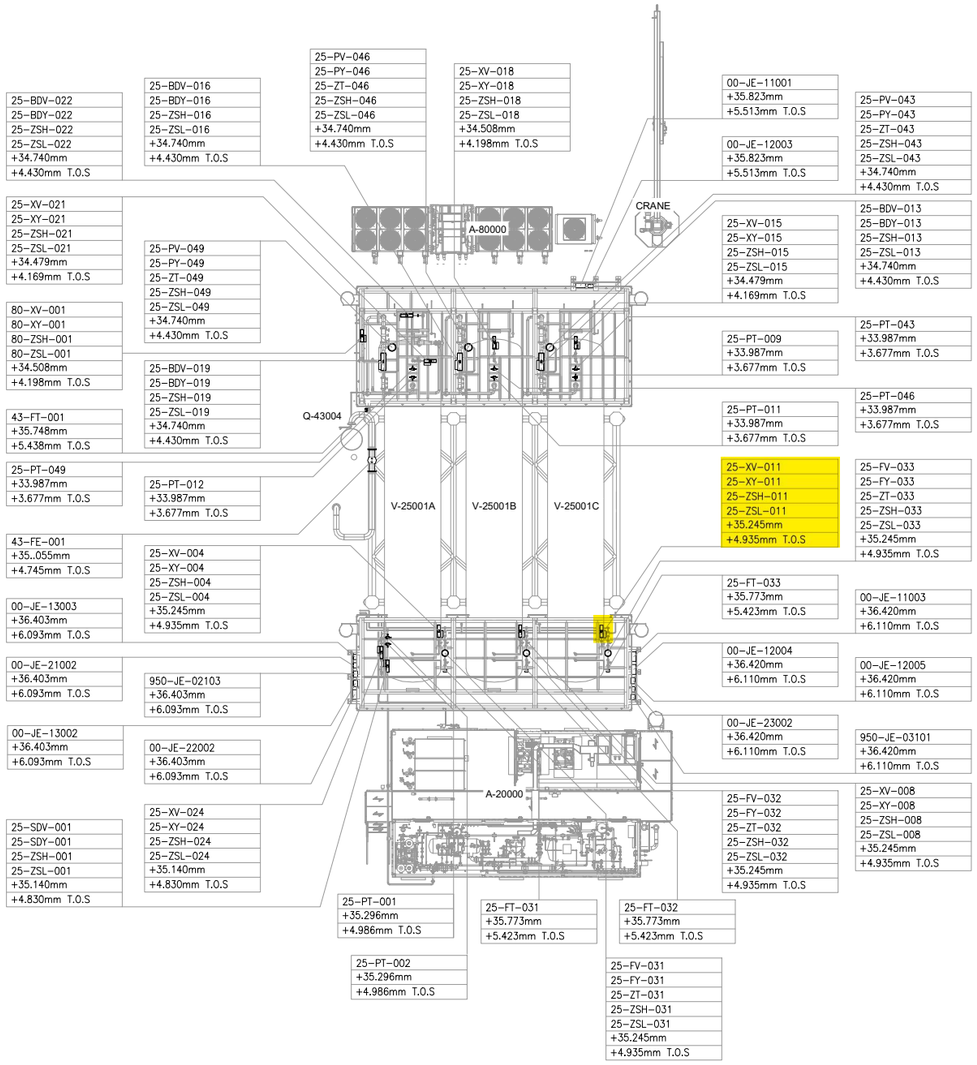

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm

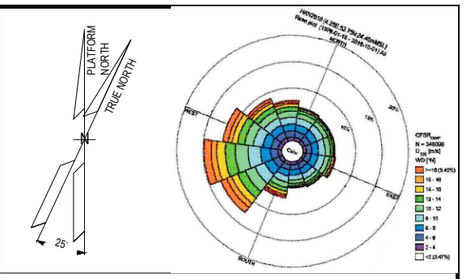

NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING_NO. DRAWING_NO.

REV. REV

V-25001_C

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

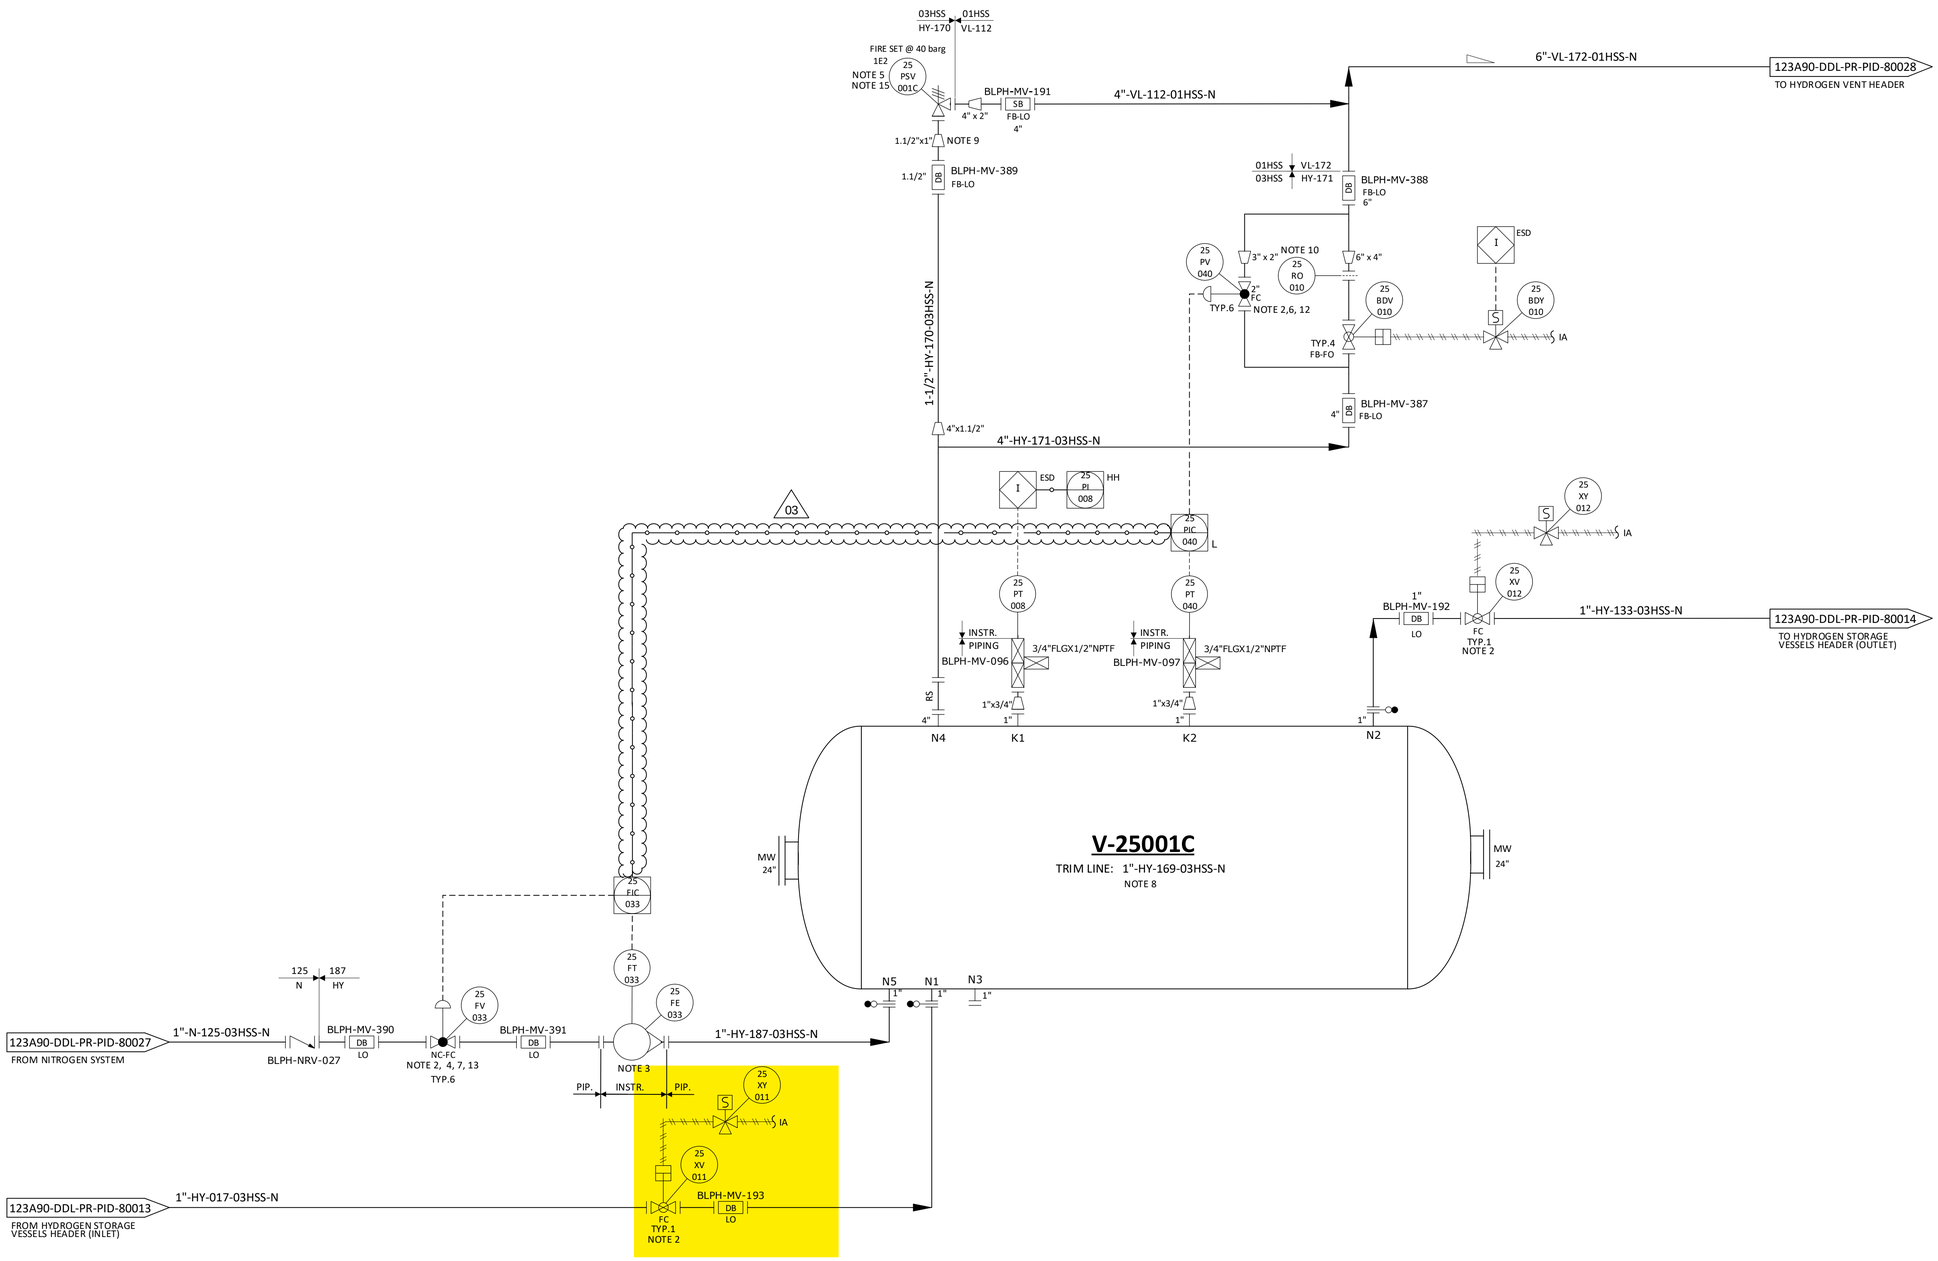

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-033) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-040 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-040 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-033 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-040 HAS FAILED TO CLOSE.
15. 25-PS-V001C SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL C

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE		
A1	DRAWING NO. 123A90-DDL-PR-PID-80017			SHEET 001	REV. 03

File Name = FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

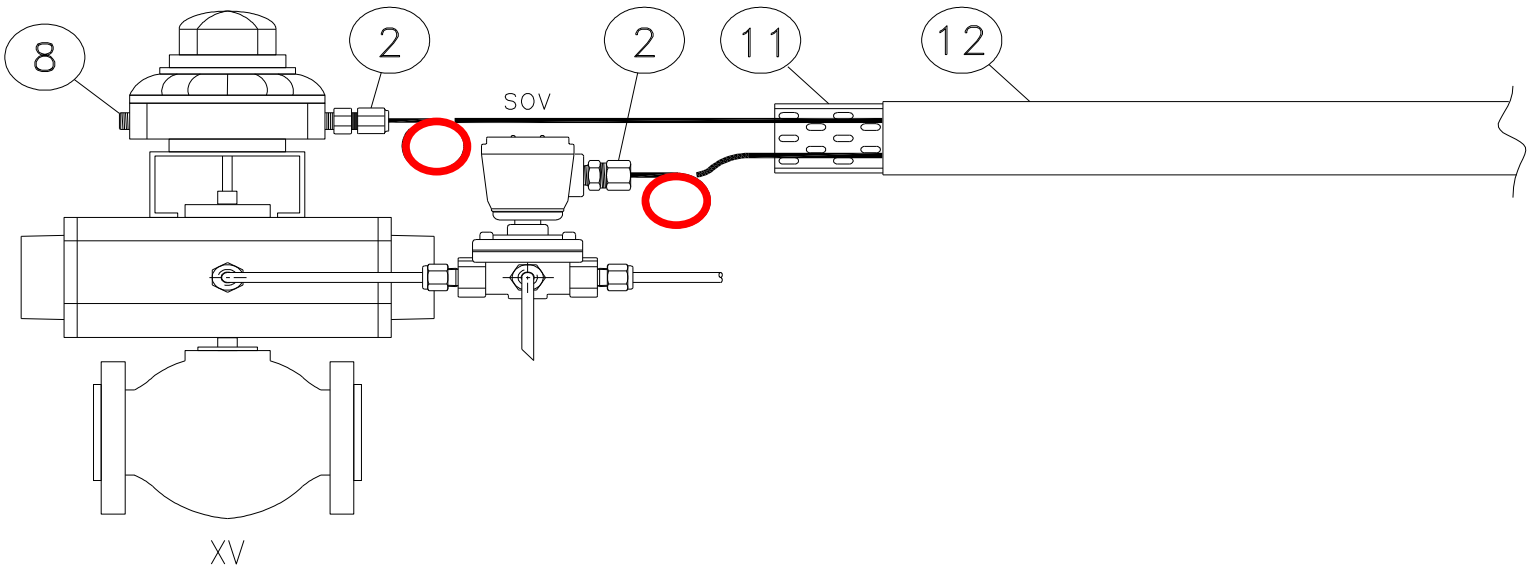

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

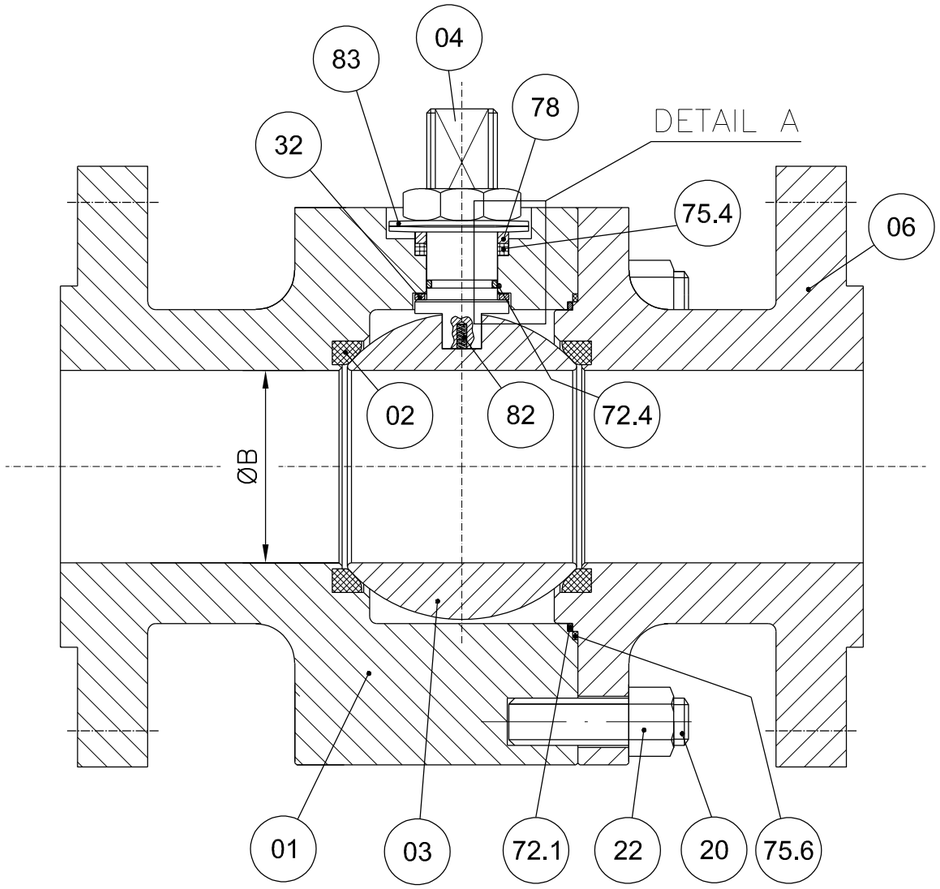




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DRAWN: S.Madahar — DATE: 26/02/2024
CHK'D: D.Barcella — DATE: 26/02/2024
APPV'D: L.Mora — DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWING NAME: **D240062-08**

Rev.: 2

GENERAL	1	Tag Number		Location		25-XV-011		25
	2	Service				HYDROGEN STORAGE TANK V-25001C INLET		
	3	P&ID Number		Area Classification		123A90-DDL-PR-PID-80017		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-017-03HSS-N		
	5	Line Size and Schedule	Inlet		Outlet	1" / 3.38 mm		1" / 3.38 mm
	6	Line Material		Line Insulation		ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State		Phase		GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure		Full Vacuum	[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature		Minimum	Maxi [°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of		Design		Close :	(12)	Open : (12)
	17	Operation (seconds)		Actual		Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size		Body Form		1"		FULL BORE
	22	Body Material		Bonnet Type		ASTM A182 F316/316L		(*)
	23	Connections		Rating		FLANGED ASME B16.5		#300
	24	Flange Finish		Gasket Material		RF		Inside the valve (*) (38)
	25	Packing		Lubrication & Isolation		A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer		Type		Rotork		Spring Return
	31	Model No.		Size		CP/S		035-100A/BA
	32	Actuator Orientation		Actuator Form		Horizontal		Cylinder
	33	Ingress Protection		Certification		IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply		Min	Max Design	4 barg	10 barg	11 barg
	35	Action on Air Failure		Action on Power Failure		CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-011 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed		Limit Switch Open		25-ZSL-011 (9, 17) - Soldo SS		25-ZSH-011 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set		Handwheel		(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection		Electrical Class		No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity		Fabrication Code		-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve		Model		-		-
	48	Check Valve		Mounting		-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

94	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR	25-XV-009	ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR	25-XV-012	FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR	25-XV-014	FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR	25-XV-015	FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR	25-XV-017	FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR	25-XV-018	FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

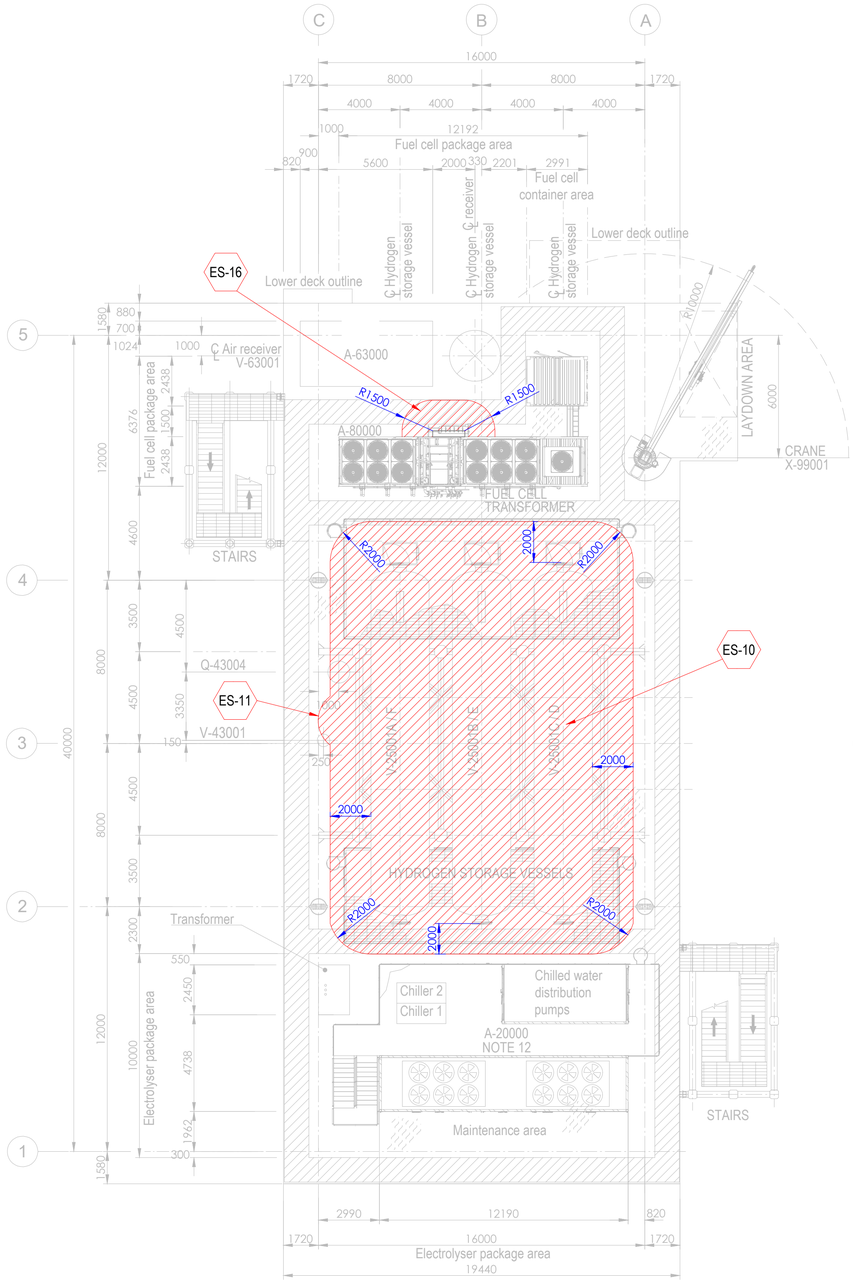


PLAN ON UPPER DECK
EL+30.310 T.O.S.

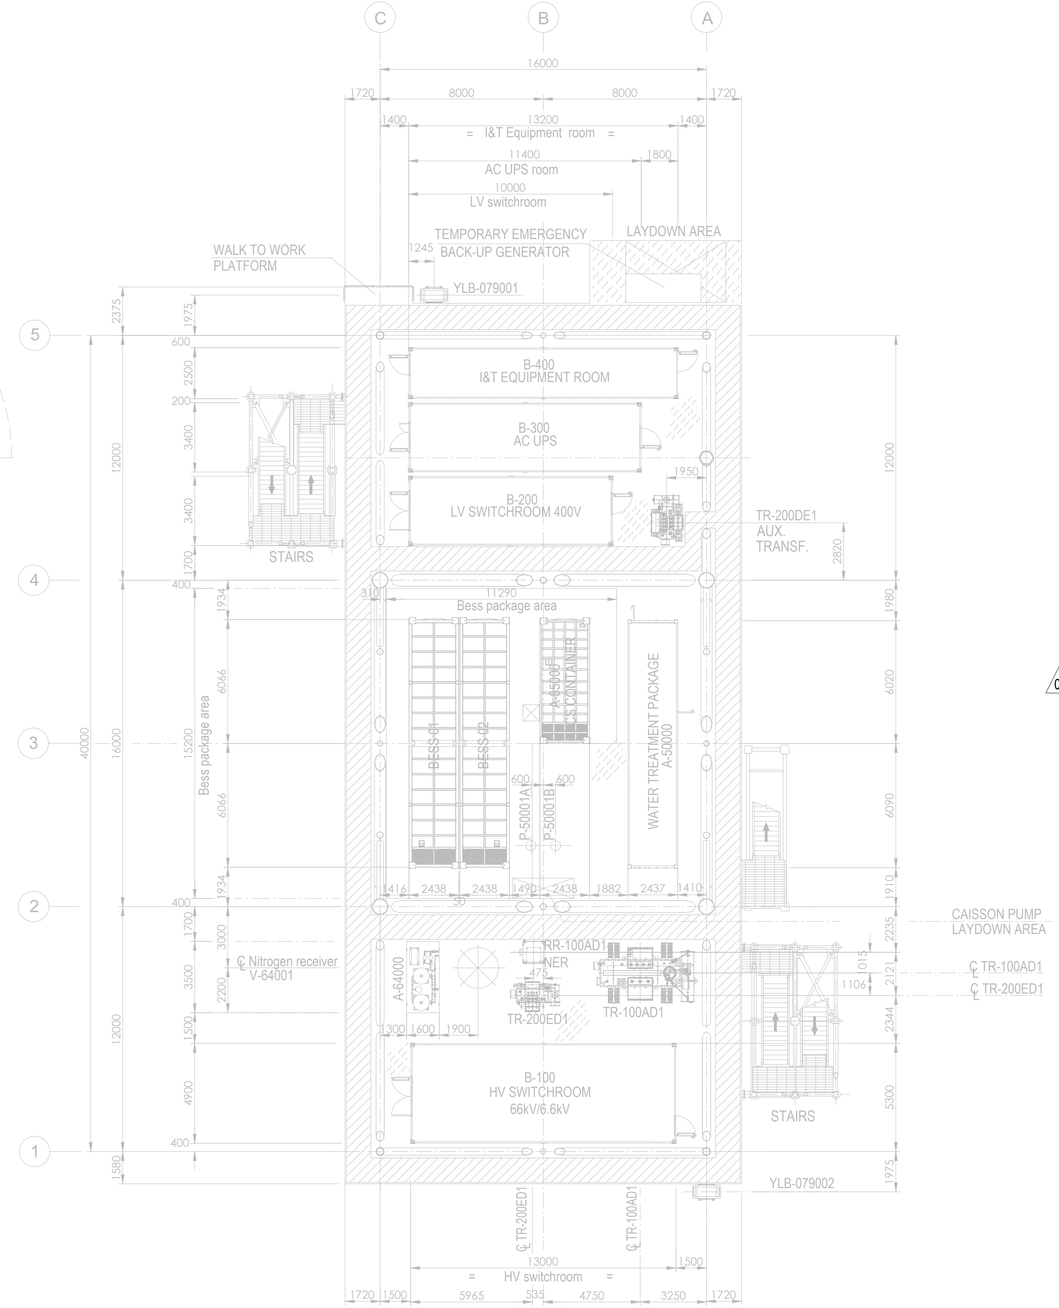

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

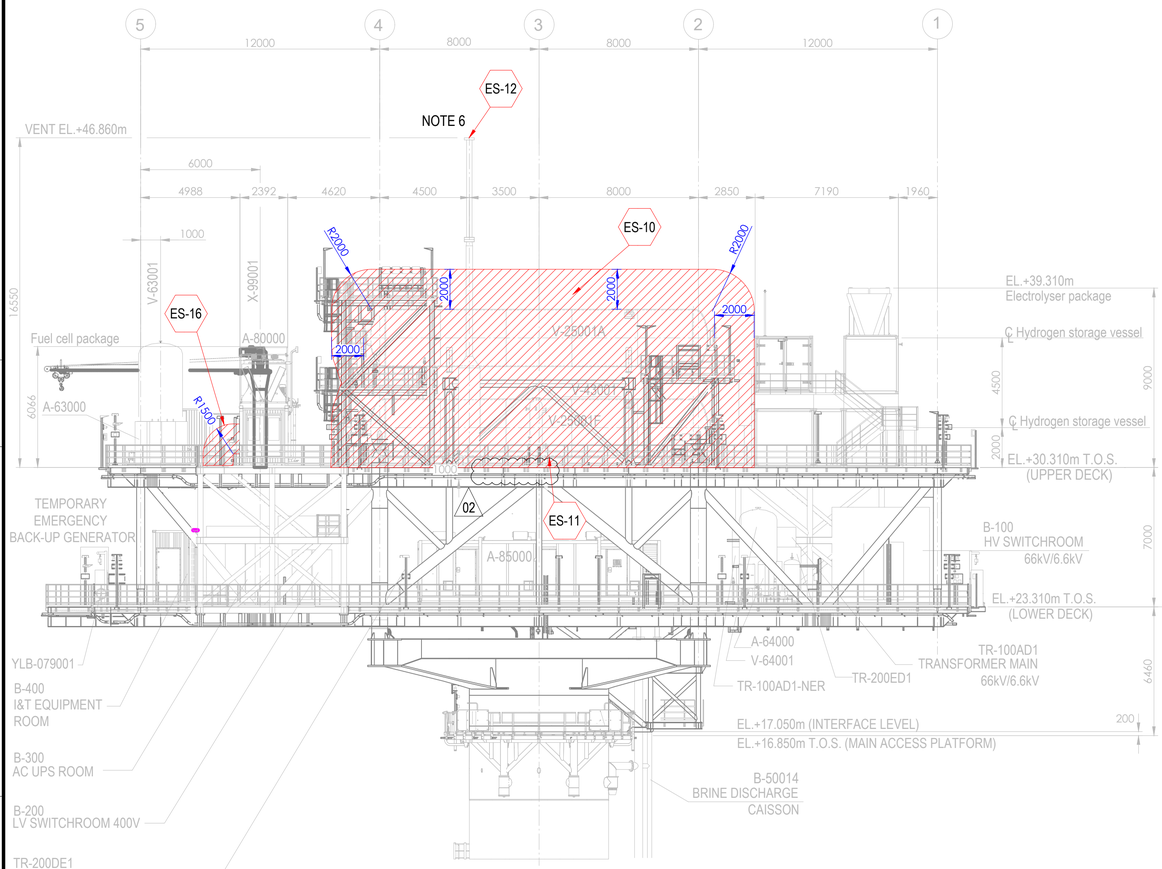



ELEVATION LOOKING EAST

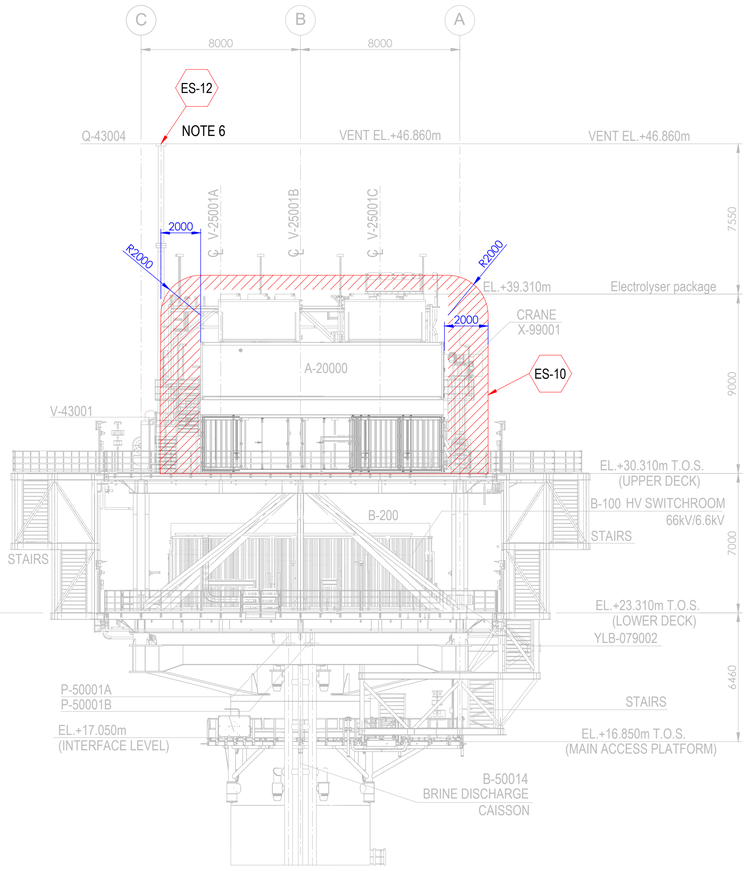

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

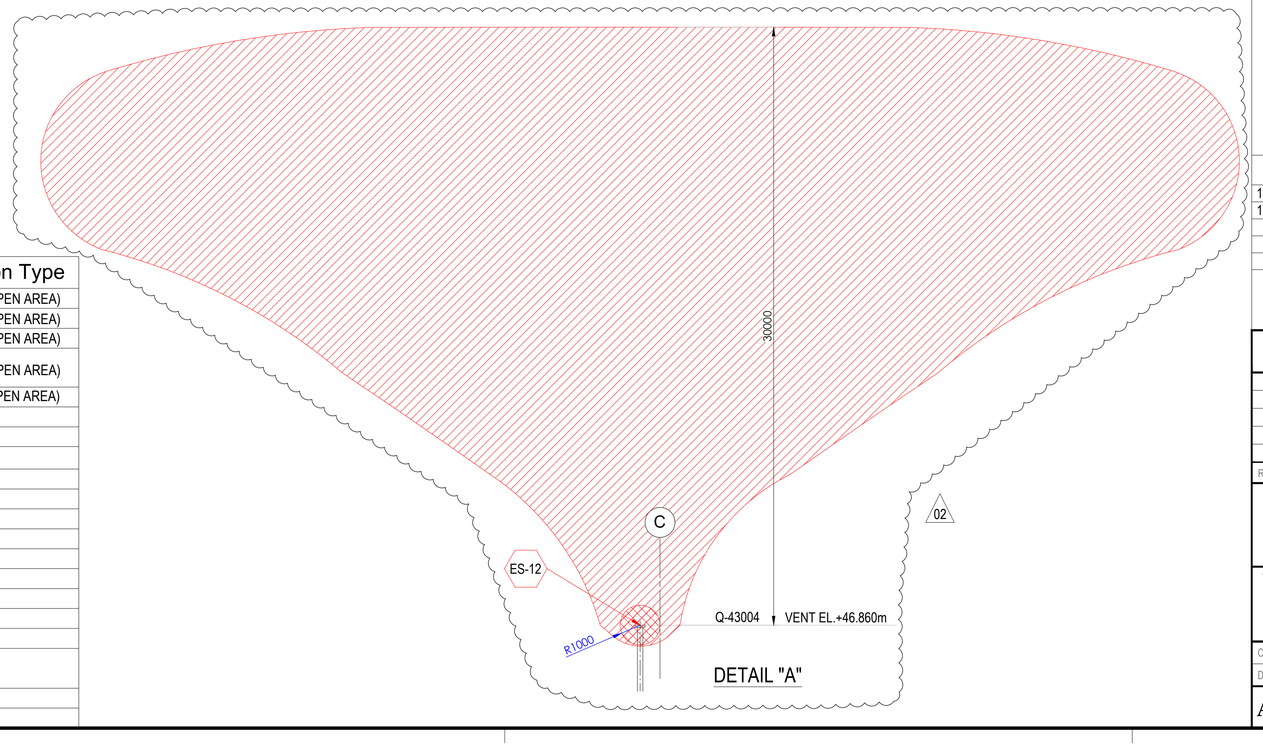



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

Rotork Fluid Systems s.r.l.
Via padre Jacques Hamel, 138 B
55016 Porcari, Lucca
Italy

Tel. +39 0583 2221
Fax. +39 0585 091362
http://www.rotork.com

rotork
Fluid Systems

DECLARATION

Rotork Fluid Systems s.r.l. herewith declares that for the job AF7703, as the supplier of the following equipment:

Product: Safety Relief Valve (PSV)
Type/Model: D10/S INOX
Serial Number(s): 025308828; 025308829; 025308830; 025308831; 025308832; 025308833; 025308834; 025308835; 025308836; 025308837; 025308838; 025308839; 025308840; 025308841; 025308842; 025308843; 025308844; 025308845; 025308846; 025308847; 025308848; 025308849; 025308850; 025308851; 025308852; 025308853; 025308854; 025308855.
Intended Use: Installation in ATEX Zone 2 – Gas Group IIC / IIB + H_2
Category: II 2G
Protection Type: Ex h IIC T6 Gb X (non-electrical equipment)

Hereby declares under its sole responsibility that the above equipment has been purchased in full compliance with the requirements of:

- Directive 2014/34/EU (ATEX)
- Harmonised standards: EN ISO 80079-36:2016 and EN ISO 80079-37:2016
- The relevant essential health and safety requirements as set out in Annex II of Directive 2014/34/EU.

This product is not yet in service and is currently installed but not operational. According to applicable legislation and guidance (including the Blue Guide 2022 and ATEX Guidelines 3rd Edition, July 2023), the CE and ATEX markings can be legitimately applied, even if the equipment has already been installed.
The conformity assessment procedure followed is: Internal production control (Annex VIII – Module A), with the technical documentation deposited with the Notified Body:
Notified Body: TUV SUD Italia – NB N° 0948
Reference: TUV IT 18 ATEX 032 AR
We hereby authorise the application of the ATEX marking in situ, under our responsibility, following the above.
This declaration is issued under the sole responsibility of the supplier.

Lucca, 18/04/2025

On behalf of Rotork Fluid Systems s.r.l.

Lucia Fregoli – Quality Manager

NUOVA GENERAL INSTRUMENTS s.r.l.
LOC. CAMPASSO - 29010 PIANELLO VALTIDONE (PC) Italy - Tel. +39 0523994629 - Fax +39 0523997219
http:// www.nuovageneral.it - E-mail: info@nuovageneral.it - P.IVA 01337040339 - C.F. 01317650065
REA-PC 117793 - Reg. Imp.PC 01317650065 - Capitale Sociale € 100.000,00 i.v.

N. **025308838**

Tipo: (Typ.): **D10/S INOX**

Dis. : **009-0 Rev. 24/10/22**

DICHIARAZIONE DI CONFORMITÁ UE Allegato IV, D. E. 2014/68/UE - Allegato VIII, D.E. 2014/34/UE
DECLARATION OF CONFORMITY EU Annex IV, E. D. 2014/68/EU - Annex VIII, E.D. 2014/34/EU
KONFORMITATSERKLARUNG EU Anlage IV Richtlinie 2014/68/EU - Anlage VIII Richtlinie 2014/34/EU
DECLARATION DE CONFORMITÉ UE Annexe IV D.E. 2014/68/UE - Annex VIII D.E. 2014/34/UE

VALVOLA DI SICUREZZA
SAFETY VALVE
SICHERHEITSVENTIL
SOUPAPE DE SURETE

PROGETTO , COSTRUZIONE E COLLAUDO CONFORME ALLA DIRETTIVA 2014/68/UE - 15/05/14 CATEGORIA IV Modulo H1
DESIG , MANUFACTURE AND TEST ACCORDING TO 2014/68/EU DIRECTIVE - 15/05/14 CLASS IV Module H1
PROJEKT , KONSTRUKTION UND ABNAHMEPRUFUNG GEMAB EG-RICHTLINIE 2014/68/EU - 15/05/14 KATEGORIE IV Formblatt H1
PROJET,FABRICATION ET VERIFICATION CONFORME A LA DIRECTIVE 2014/68/UE-15/05/14 CATEGORIE IV Module H1

Garanzia qualità totale Nr. : **Full quality assurance system Nr. :**
Garantie gesamte Qualität Nr. : **Garantie qualité totale Nr.:**
Module H1 : DGR-0036-QS-1180-24

Norme e spec. utilizzate : (Codes or spec.ref.) : *(Angewandte normen und spezifikationen) :* (Regulements et spec. utilise):
AD-Merkblatt A2 - VdTUV-Merkblatt Sicherheitsventil 100 / Racc."E"1979 / EN80079-36:2016 -37:2016 / ISO4126-1 / AS1271:2003 / EN13648-1 / UNI 10197

Organismo notificato: (Notified body): *(Meldestelle):* (Organisme agree):
TÜV SÜD Industrie Service GmbH
Westendstraße 199
D 80686 Munich
0036


II 2G Ex h IIC T6 Gb X
File : TÜV IT 18 ATEX 032 AR

Questa dichiarazione di conformità è rilasciata sotto la sola responsabilità del produttore. - *This declaration of conformity is issued under the sole responsability of the manufacturer.* - Diese Konformitätserklärung wird unter der alleinigen Verantwortung des Herstellers ausgestellt.
Cette déclaration de conformité est émise sous la seule responsabilité du fabricant.

Fluido - *Fluid* - **Fluide**
G / S / L
Group 1 or 2

- Marchio del costruttore: (Manifacturer's Mark): *(Herstellerzeichen):* **(Marquae du constructeur)**

- Materiali: (Material): *(Material):* **(Matériaux):**

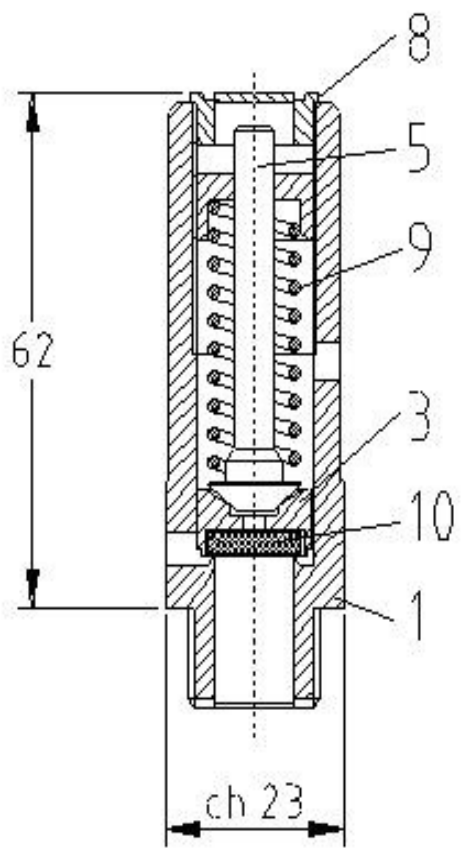

1- UNI EN 10088 1.4404
3- UNI EN 10088 1.4404
5- UNI EN 10088 1.4404
8- UNI EN 10088 1.4404
9- UNI EN 10270-3 1.4310

10 VITON (-20 / +200 °C)

Anno costruzione:
(Year of manufacture):
(Baujahr):
(Annee de fabrication):
2025

- P.N.: **60** *(Nenndruck):*

- h / do: **0,4**

- D.N.: (Nominal Diameter): *(Anschlusgewinde):* **(D.N):**

- Diametro orifizio: do (Opening diameter): do *(Innen durchmrsser): do* **(Diametre orifice):do** **10** mm

- Alzata: h (Valve Lift): h *(Hub): h* **(Haussement): h** **4** mm

- Coefficiente di efflusso : (Flow coefficient.): *(AusfluBziffer.):* **(Coefficient d'écoulement** **Kd 0,86**

- Pressione di taratura: (Setting Pressure): *(Abgleichungssdruck):* **(Pression de tarage):** **4,7** bar g

- Sovrappressione: (Overpressure): *(Uber-Unterdruck):* **(Surpression):** **10%** % della pressione di taratura (% of Setting Pressure) *(% Abgieichungsdruck)* **(% De la pression de tarage)**

- Entrata: (In): *(Eintritt):* **(Entre):** **1/2" NPT**

- Uscita: (Out): *(Austritt):* **(Sortie):**

- Area: (Area): *(Offnung):* **(Surface):** **0,785** cm^2

- Limiti di temperatura di esercizio dei materiali utilizzati a pressione atmosferica: (Operating temperature limits for materials used at atmospheric pressure): **-20 / +200 °C**
(Betriebstemperaturgrenze der unter Luftdruck verwendeten Materialien):
(Limites de température de fonctionnement des matériaux utilisés sous pression atmosphérique):

- Coefficiente di efflusso ridotto : (Reduced flow coefficient): **Kdr = 0,9xKd = 0,77**
(Reduzierte Ausflußziffer):
(Coefficient d'écoulement réduit

- Variabilità campo di taratura: (Variability Setting Filed): **3,1 - 5** bar g
(Abgleichungsberelch):
(Variabilite champ de tarage):

- Scarto di chiusura: (Closing variation): *(Unterdruck):* **(Ecart de fermature):** **15%** % della pressione di taratura (% of Setting Pressure) *(% Abgieichungsdruck)* **(% De la pression de tarage)**

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide): **ARIA-AIR-LUFT** Temper. : **0** °C

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** **328,02** kg/h **253,73** Nm^3 / h **4228,82** lt/min.

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide):

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** kg/h Nm^3 / h lt/min.

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide):

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** kg/h Nm^3 / h lt/min.

Si dichiara che la valvola ha subito con buon esito il controllo finale compreso il test di tenuta (90% Pset) e la prova idraulica del corpo a 1,5 x P.N.
We declare that this valve has passed successfully the test, the seat tightness test (90% Pset) and the hydraulic test of the body to 1,5 x P.N.
Hiermit bestätigen wir, dass das Ventil die Abschlusskontrolle einschließlich der Sitzdichtheit (90%Pset) und hydraulischen Gehäuseprüfung mit einem Druck von 1,5 x P.N.
On declare que la soupape a ete soumise avec resultat satisfiant a le control final y-compri l'epreuve d'étanchéité (90% Pset) et l'epreuve hydraulique du corps a 1,5xPN.

EN 10204 3.1 Cod. : **00F16D10SSVNPAX047**

Nr.Ord. : D2500700 REV 1

S.V. Code : 00F16D10SSVNPAX047

Date : 17/04/2025

NUOVA GENERAL INSTRUMENTS SRL
Albertini Patrizia (CEO)

NUOVA GENERAL INSTRUMENTS

	I Descrizione ATEX-UKEX	GB Atex-UKEX Description	D *Beschreibung ATEX-UKEX*	F Description ATEX-UKEX	ES Descripción ATEX-UKEX
	Simbolo rappresentativo per dispositivi certificati ATEX-UKEX	Representative symbol of ATEX-UKEX certified equipment	*Repräsentatives Symbol für ATEX-UKEX zertifizierte Geräte*	Symbole représentatif des équipements certifiés ATEX-UKEX	*Símbolo representativo para dispositivos con certificación ATEX-UKEX*
II	Gruppo dell'apparecchio	Equipment's group	*Gerätegruppe*	Groupe d'appareils	*Grupo de dispositivos*
2	Categoria dell'apparecchio	Equipment's category	*Gerätekategorie*	Catégorie d'appareils	*Categoría de dispositivos*
G	Protezione delle atmosfere esplosive dovute a presenza di GAS, VAPORI E NEBBIE	Protected to explosive atmosphere due to GAS, STEAM and FOG	*Schutz explosionsfähiger Atmosphären durch GAS, DAMPF UND NEBEL*	Protection des atmosphères explosives grâce à la présence de GAZ, VAPEURS ET BROUILLARDS	*Protección de atmósferas explosivas debido a la presencia de GAS, VAPOR Y NIEBLA*
GD	Protezione delle atmosfere esplosive dovute a presenza di GAS, VAPORI, NEBBIE, NUBI e POLVERI	Protected to explosive atmosphere due to GAS, STEAM, FOG and DUST	*Schutz explosionsfähiger Atmosphären durch GAS, DAMPF, NEBEL, WOLKEN und PULVER*	Protection des atmosphères explosives grâce à la présence de GAZ, VAPEURS, BROUILLARDS, NUAGES et POUSSIÈRES	*Protección de atmósferas explosivas debido a la presencia de GAS, VAPORES, NIEBLA, NUBES y POLVO*
Ex h (Type of protection "c" constructional safety)	Indicazione di apparecchiatura non elettrica	Non-electrical equipment indication	*Hinweis auf nichtelektrische Geräte*	Indication des équipements non électriques	*Indicación de equipos no eléctricos*
IIC	Sottodivisione del gruppo di apparecchi	Equipment group subdivision	*Unterteilung der Gerätegruppe*	Subdivision du groupe d'appareils	*Subdivisión del grupo de dispositivos*
T6	Temperatura massima di parete ≤85°C	Maximum surface temperature ≤85°C	*Maximale Oberflächentemperatur ≤85 ° C*	Température maximale de paroi ≤85 ° C	*Temperatura máxima de la pared ≤85 ° C*
Gb	Equipment Protection Level (EPL)	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*
GbDb	Equipment Protection Level (EPL)	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*
X	La massima temperatura superficiale potrebbe essere superiore alla classe di temperatura, si raccomanda come massima temperatura il valore maggiore tra T6 e la max Temperatura ammissibile per la tenuta (V. COC)	The max surface temperature could be higher than the temperature class, it is recommended as max temperature the higher value between T6 and the max Admissible temperature for the seal (V. COC)	*Die max. Oberflächentemperatur kann höher sein als die Temperaturklasse, als max. Temperatur wird der höhere Wert zwischen T6 und der max. zulässigen Temperatur für die Dichtung (V. COC) empfohlen.*	La température de surface maximale peut être supérieure à la classe de température, il est recommandé comme température maximale la valeur la plus élevée entre T6 et la température maximale admissible pour le joint (V. COC)	*La temperatura máxima de la superficie podría ser superior a la clase de temperatura, se recomienda como temperatura máxima el valor más alto entre T6 y la temperatura máxima admisible para el sello (V. COC)*

ITEM	Tag	25-PSV-014	: Safety Valve - Vessel V-25001D Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10004839	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		25308828			
Manufacturer	NUOVA GENERAL INSTRUMENTS			**Model**		D10/S			
Cert No.	D.o.C. by Manufacturer			**Equipment Ambient Temp.**		-20 °C to +40 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	NA

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	NA	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PSV-014	: Safety Valve - Vessel V-25001D Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004839		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-PSV-014	: Safety Valve - Vessel V-25001D Hydrogen Inlet		Dwg	123A90-DDL-PR-PID-80016	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10004839	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-29	2025-02-03	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:44:30.251Z	PROVERLIS Digitaly signed by Luca Mussi 2025-02-03T12:49:32.265Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

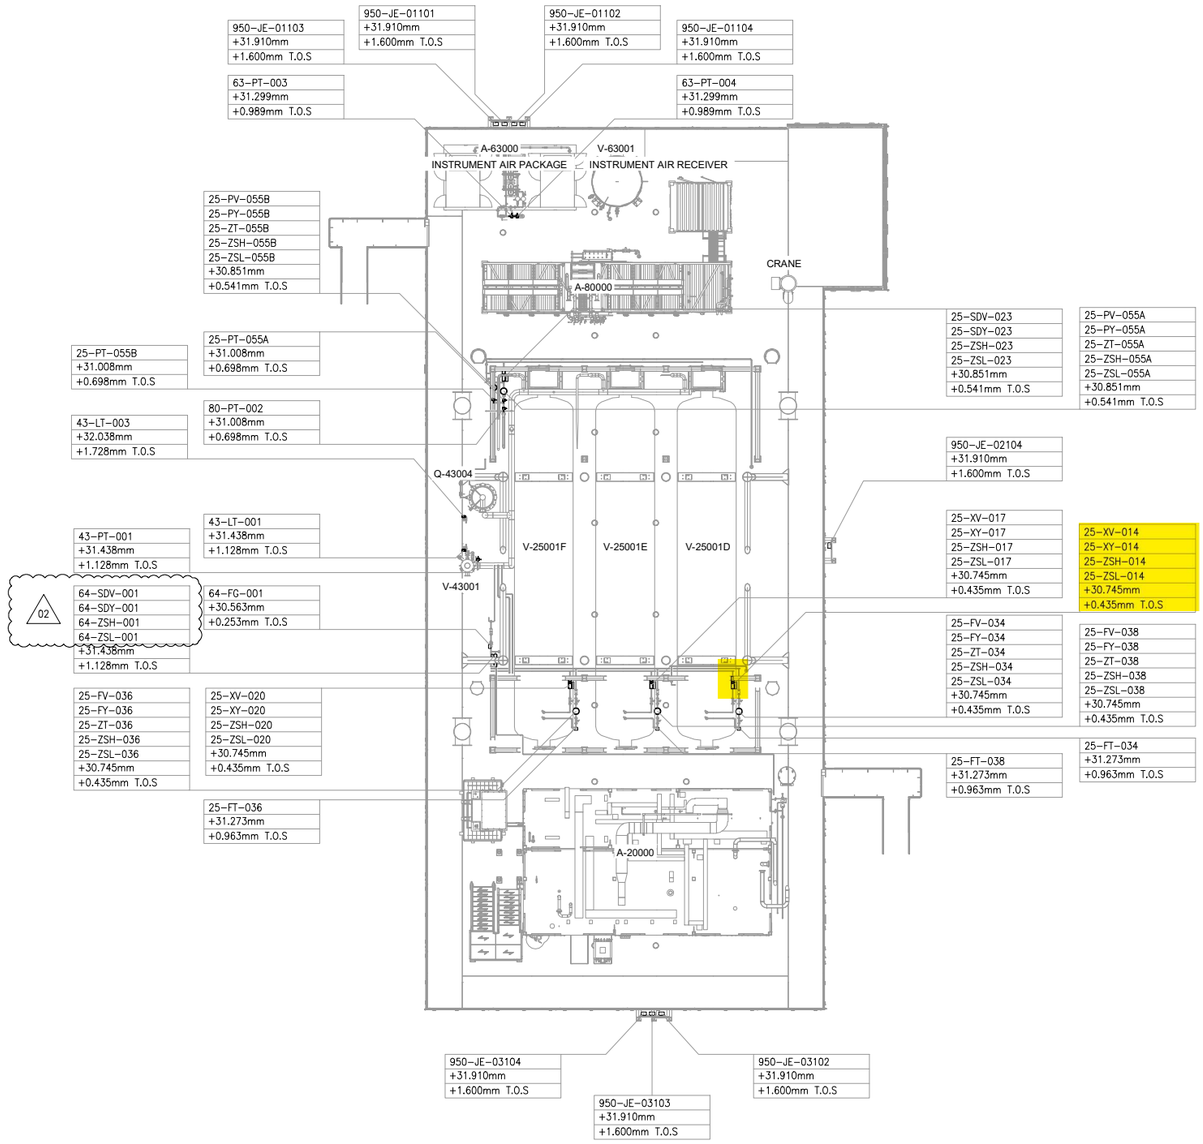


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90–DDL–IN–DL–40081	001	02

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001_D

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

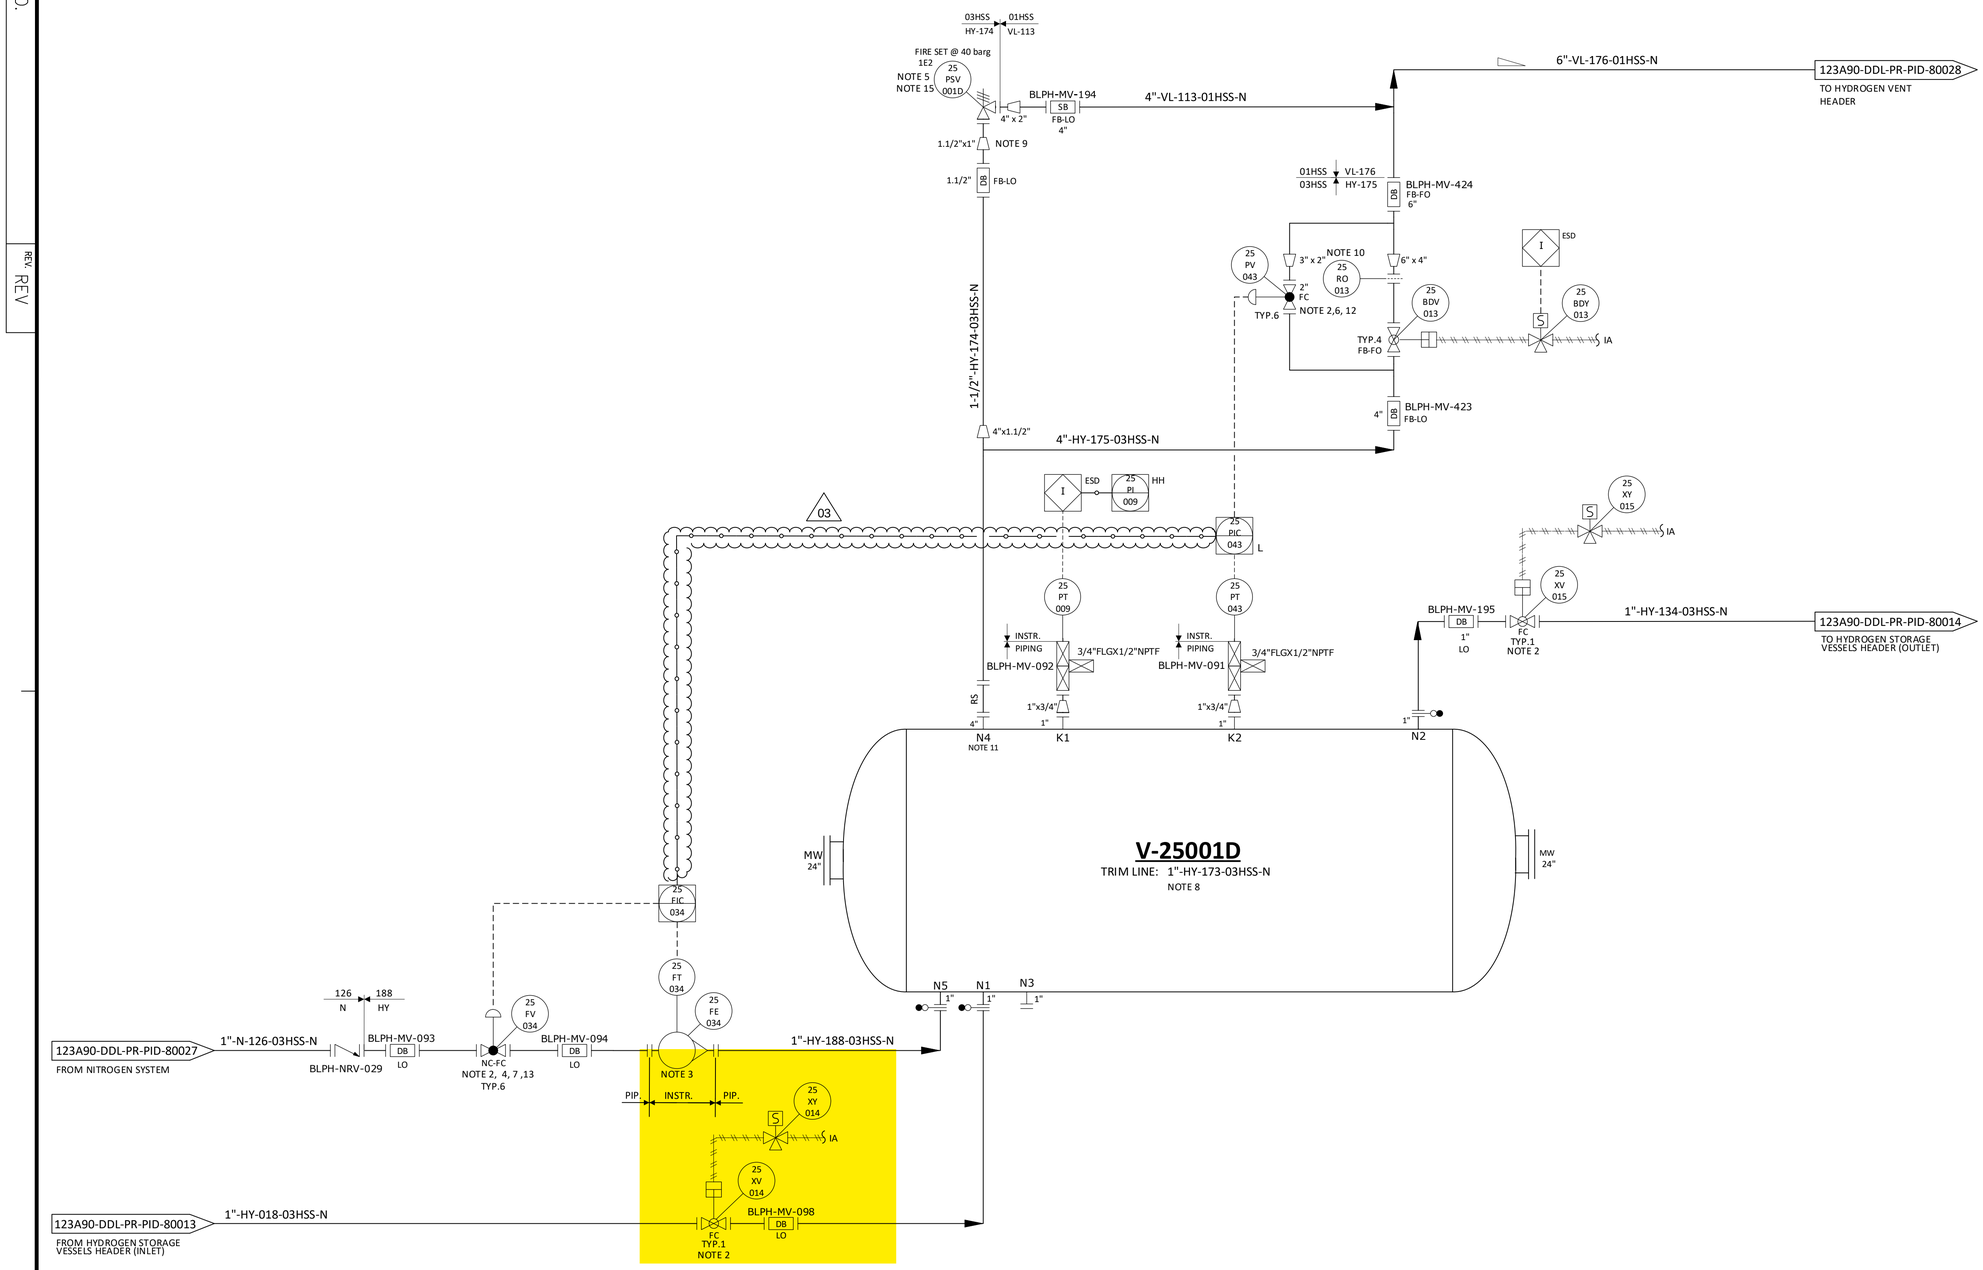

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS. 03
4. NITROGEN CONTROL VALVE (25-FV-034) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE.
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-043 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-043 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-034 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-043 HAS FAILED TO CLOSE.
15. 25-PSV-001D SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL D

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80018		SHEET 001	REV. 03

File Name : FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

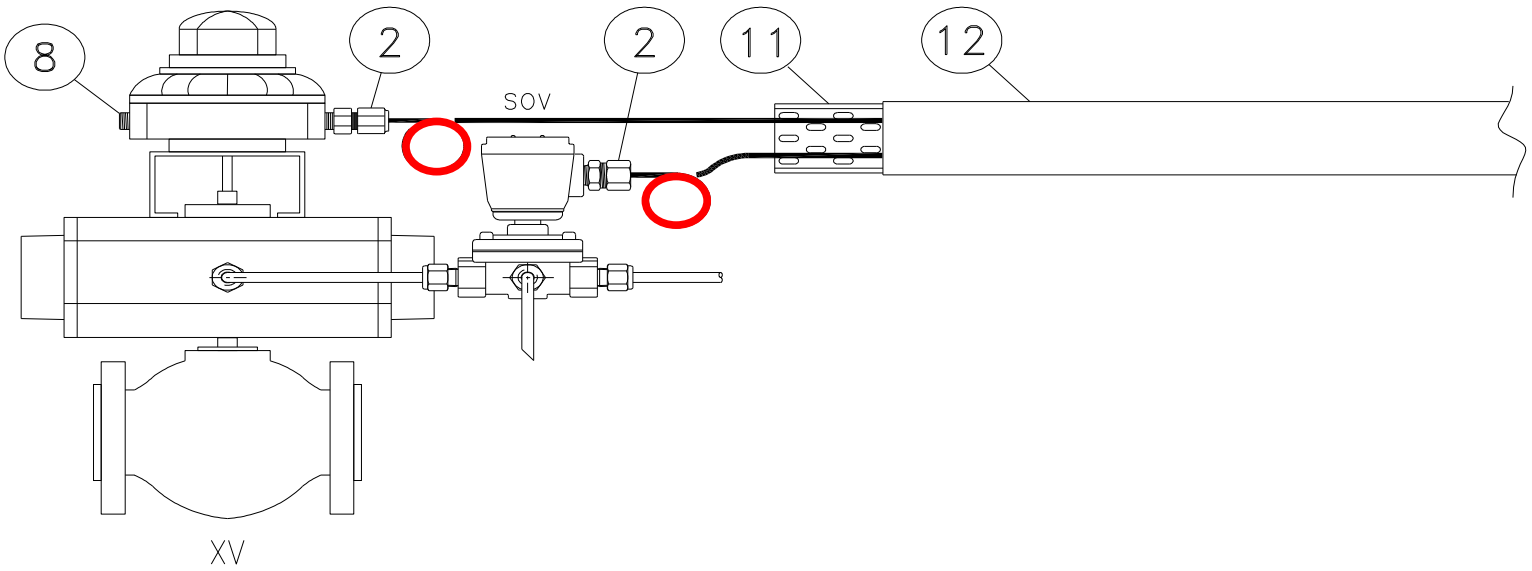

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**

REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi


ROSETTI MARINO SpA

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

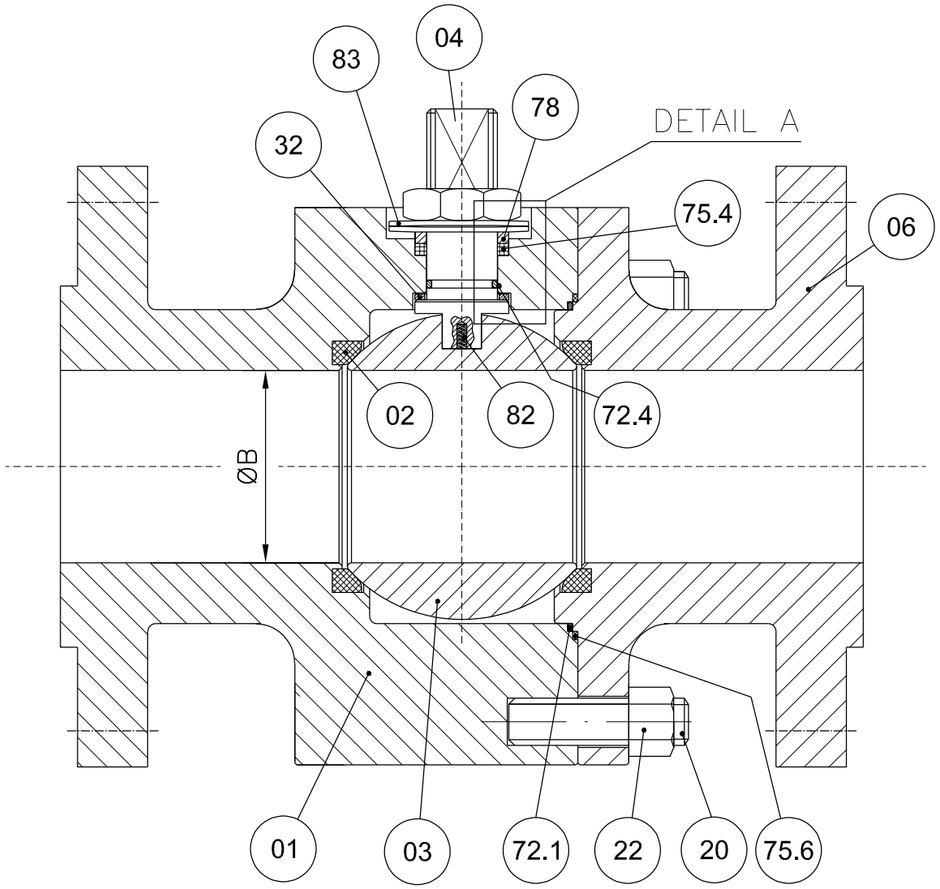


DETAIL A




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024
CHK'D: D.Barcella	DATE: 26/02/2024
APPV'D: L.Mora	DATE: 26/02/2024

SIZE: A3 | SCALE: N.A.

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: D240062-08

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-014	25
	2	Service				HYDROGEN STORAGE TANK V-25001D INLET	
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80018	Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-018-03HSS-N	
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm	1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L	NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN	
	8	Fluid State	Phase			GAS	GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40	
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29	80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40	
	14						
	15						
	16	Speed of	Design			Close : (12)	Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum	Open : -
	18						
	19						
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)	
	21	Body Size	Body Form			1"	FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L	(*)
	23	Connections	Rating			FLANGED ASME B16.5	#300
	24	Flange Finish	Gasket Material			RF	Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)	(*)
	26	Bolting				A193 B8M / A194 Gr. 8M	
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO	
	29	Fire Safe				(2)	
ACTUATOR	30	Manufacturer	Type			Rotork	Spring Return
	31	Model No.	Size			CP/S	035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal	Cylinder
	33	Ingress Protection	Certification			IP-66	II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE	CLOSE
	36	Fireproofing				NOT APPLICABLE	
	37	Solenoid Valve				25-XY-014 (9, 14, 15, 16) - Bifold FP06P	
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-014 (9, 17) - Soldo SS	25-ZSH-014 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED	
	40	Air Set	Handwheel			(*)	NOT REQUIRED
	41	Mounting Position				HORIZONTAL	
	42	Partial Stroke Test Facility				NOT REQUIRED	
	43	Control Type				-	
	44	Electrical Connection	Electrical Class			No. (*) / M20	H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-	
	47	Safety Valve	Model			-	-
	48	Check Valve	Mounting			-	-
PURCHASE	49	Manufacturer				FLUITEK	
	50	Model				FB3	
	51	Purchase Order Number				1724000204	

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

94	IFR	25-XV-009	floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR	25-XV-011	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR	25-XV-012	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR	25-XV-014	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR	25-XV-015	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR	25-XV-017	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR	25-XV-018	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

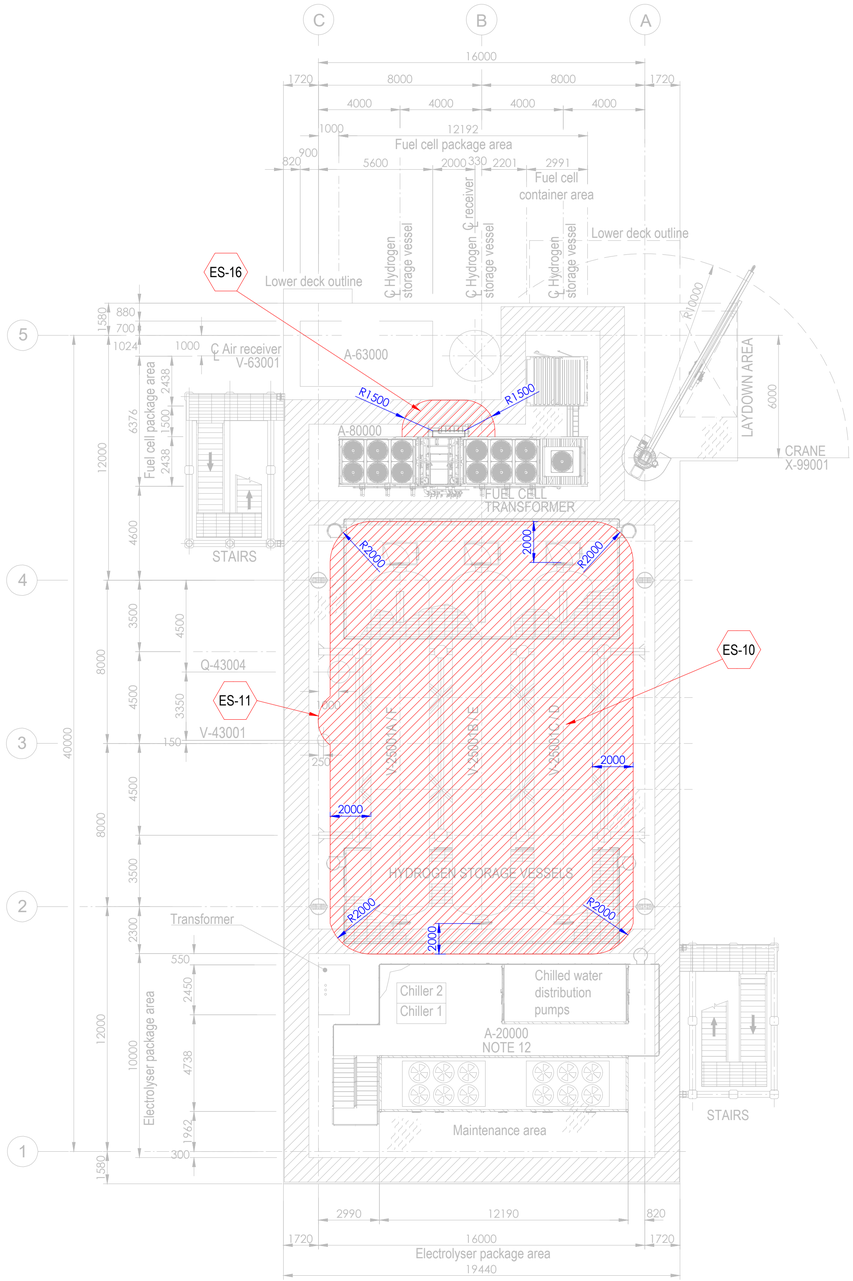


PLAN ON UPPER DECK
EL+30.310 T.O.S.

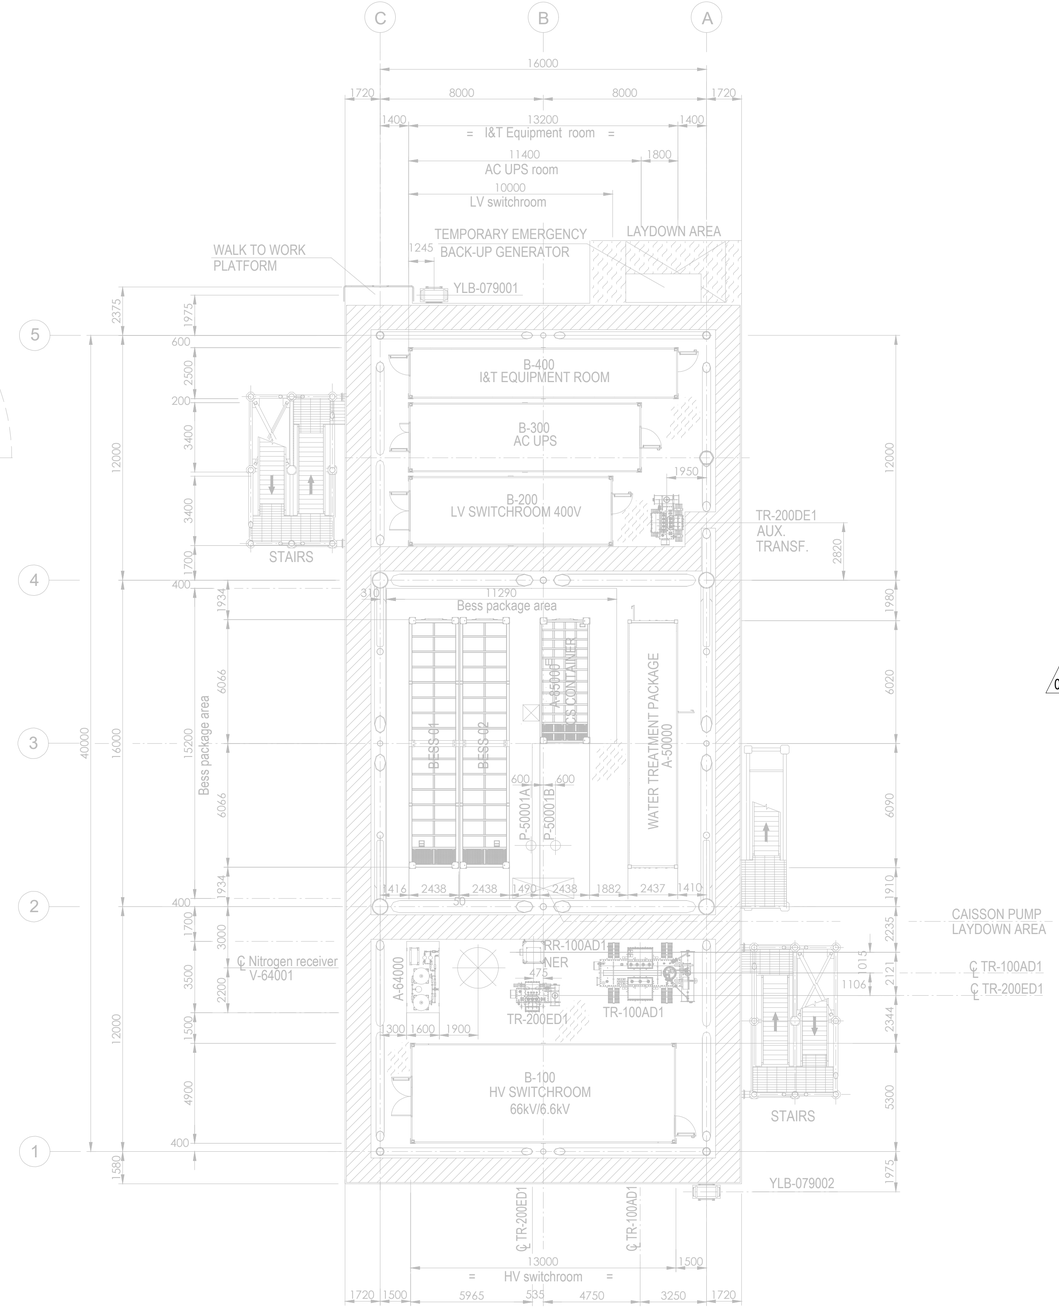

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

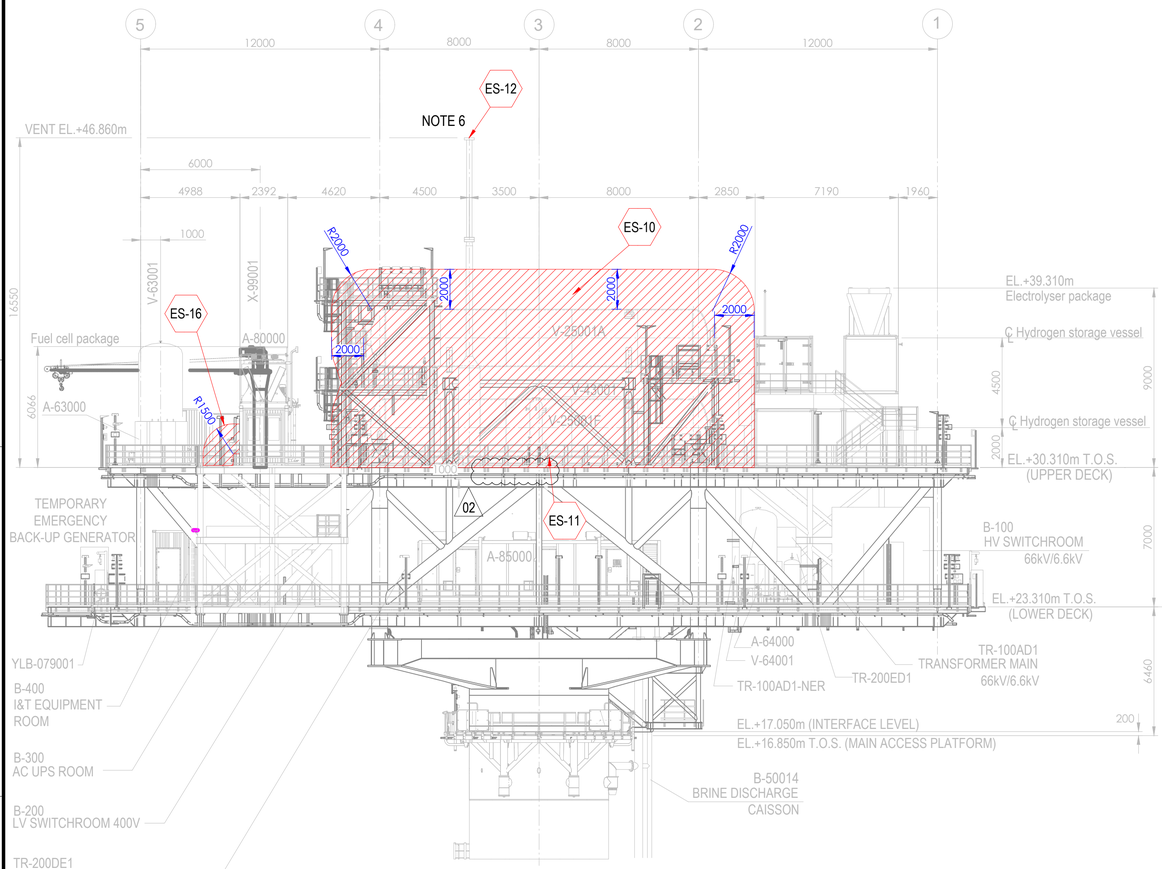



ELEVATION LOOKING EAST

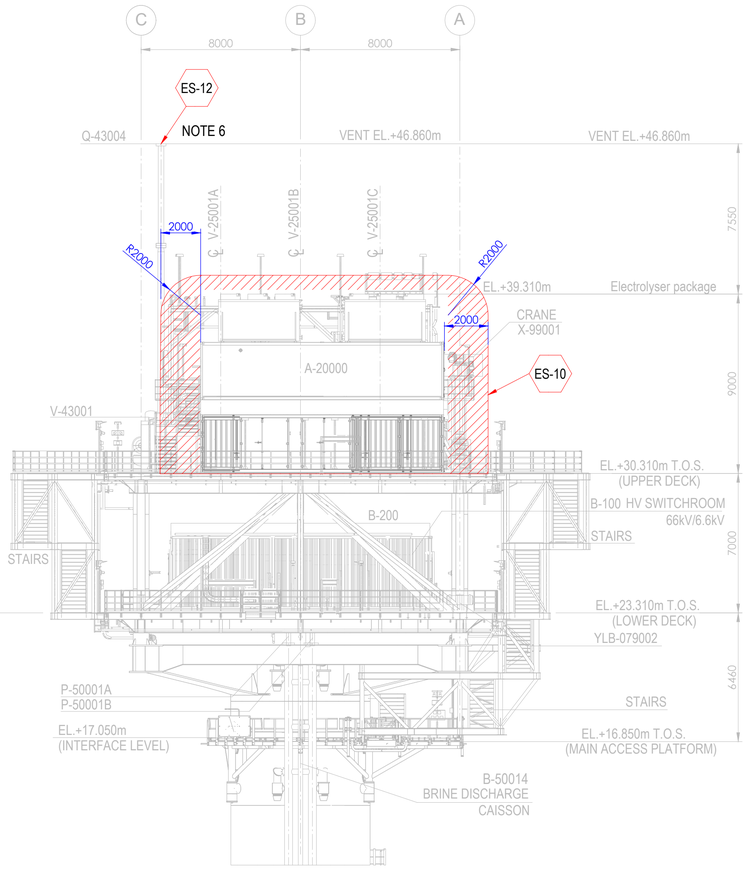

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

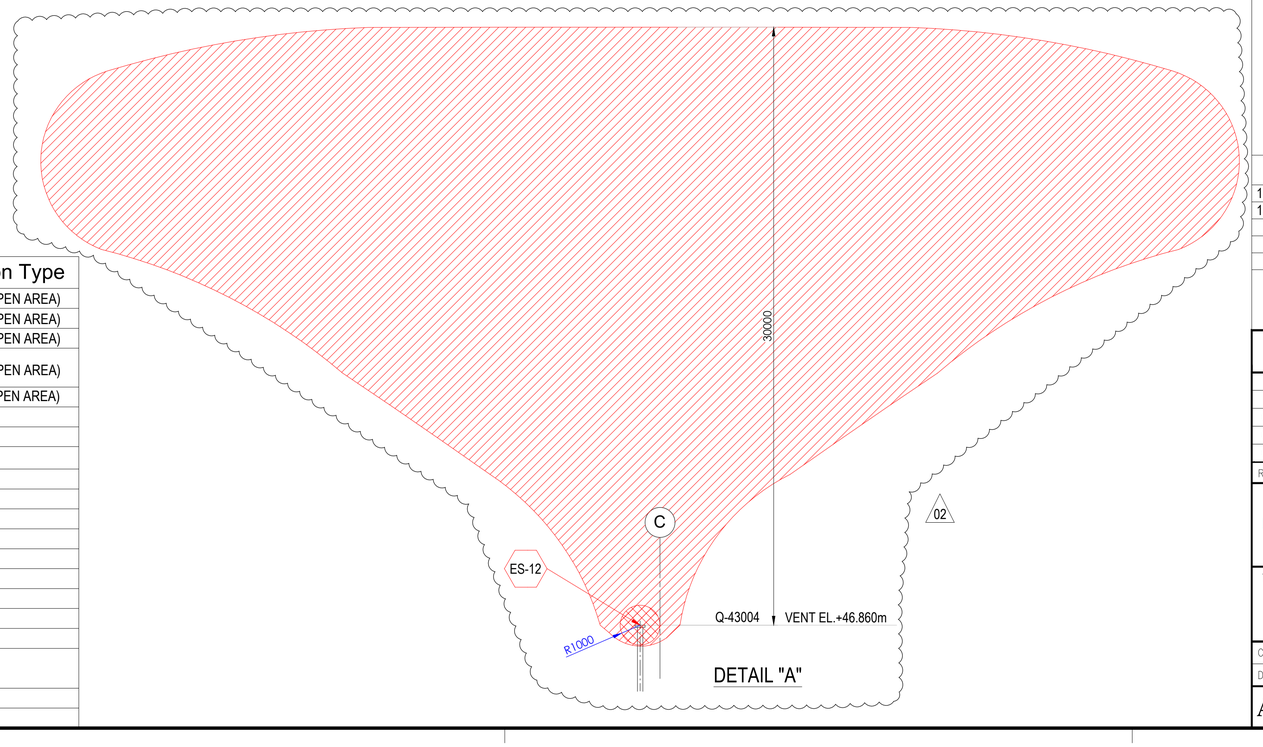



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

Rotork Fluid Systems s.r.l.
Via padre Jacques Hamel, 138 B
55016 Porcari, Lucca
Italy

Tel. +39 0583 2221
Fax. +39 0585 091362
http://www.rotork.com

rotork
Fluid Systems

DECLARATION

Rotork Fluid Systems s.r.l. herewith declares that for the job AF7703, as the supplier of the following equipment:

Product: Safety Relief Valve (PSV)
Type/Model: D10/S INOX
Serial Number(s): 025308828; 025308829; 025308830; 025308831; 025308832; 025308833; 025308834; 025308835; 025308836; 025308837; 025308838; 025308839; 025308840; 025308841; 025308842; 025308843; 025308844; 025308845; 025308846; 025308847; 025308848; 025308849; 025308850; 025308851; 025308852; 025308853; 025308854; 025308855.
Intended Use: Installation in ATEX Zone 2 – Gas Group IIC / IIB + H_2
Category: II 2G
Protection Type: Ex h IIC T6 Gb X (non-electrical equipment)

Hereby declares under its sole responsibility that the above equipment has been purchased in full compliance with the requirements of:

- Directive 2014/34/EU (ATEX)
- Harmonised standards: EN ISO 80079-36:2016 and EN ISO 80079-37:2016
- The relevant essential health and safety requirements as set out in Annex II of Directive 2014/34/EU.

This product is not yet in service and is currently installed but not operational. According to applicable legislation and guidance (including the Blue Guide 2022 and ATEX Guidelines 3rd Edition, July 2023), the CE and ATEX markings can be legitimately applied, even if the equipment has already been installed.
The conformity assessment procedure followed is: Internal production control (Annex VIII – Module A), with the technical documentation deposited with the Notified Body:
Notified Body: TUV SUD Italia – NB N° 0948
Reference: TUV IT 18 ATEX 032 AR
We hereby authorise the application of the ATEX marking in situ, under our responsibility, following the above.
This declaration is issued under the sole responsibility of the supplier.

Lucca, 18/04/2025

On behalf of Rotork Fluid Systems s.r.l.

Lucia Fregoli – Quality Manager

NUOVA GENERAL INSTRUMENTS s.r.l.
LOC. CAMPASSO - 29010 PIANELLO VALTIDONE (PC) Italy - Tel. +39 0523994629 - Fax +39 0523997219
http:// www.nuovageneral.it - E-mail: info@nuovageneral.it - P.IVA 01337040339 - C.F. 01317650065
REA-PC 117793 - Reg. Imp.PC 01317650065 - Capitale Sociale € 100.000,00 i.v.

N. **025308828**

Tipo: (Typ.): **D10/S INOX**

Dis. : **009-0 Rev. 24/10/22**

DICHIARAZIONE DI CONFORMITÁ UE Allegato IV, D. E. 2014/68/UE - Allegato VIII, D.E. 2014/34/UE
DECLARATION OF CONFORMITY EU Annex IV, E. D. 2014/68/EU - Annex VIII, E.D. 2014/34/EU
KONFORMITATSERKLARUNG EU Anlage IV Richtlinie 2014/68/EU - Anlage VIII Richtlinie 2014/34/EU
DECLARATION DE CONFORMITÉ UE Annexe IV D.E. 2014/68/UE - Annex VIII D.E. 2014/34/UE

VALVOLA DI SICUREZZA
SAFETY VALVE
SICHERHEITSVENTIL
SOUPAPE DE SURETE

PROGETTO , COSTRUZIONE E COLLAUDO CONFORME ALLA DIRETTIVA 2014/68/UE - 15/05/14 CATEGORIA IV Modulo H1
DESIG , MANUFACTURE AND TEST ACCORDING TO 2014/68/EU DIRECTIVE - 15/05/14 CLASS IV Module H1
PROJEKT , KONSTRUKTION UND ABNAHMEPRUFUNG GEMAB EG-RICHTLINIE 2014/68/EU - 15/05/14 KATEGORIE IV Formblatt H1
PROJET,FABRICATION ET VERIFICATION CONFORME A LA DIRECTIVE 2014/68/UE-15/05/14 CATEGORIE IV Module H1

Garanzia qualità totale Nr. : **Full quality assurance system Nr. :**
Garantie gesamte Qualität Nr. : **Garantie qualité totale Nr.:**
Module H1 : DGR-0036-QS-1180-24

Norme e spec. utilizzate : (Codes or spec.ref.) : *(Angewandte normen und spezifikationen) :* (Regulements et spec. utilise):
AD-Merkblatt A2 - VdTUV-Merkblatt Sicherheitsventil 100 / Racc."E"1979 / EN80079-36:2016 -37:2016 / ISO4126-1 / AS1271:2003 / EN13648-1 / UNI 10197

Organismo notificato: (Notified body): *(Meldestelle):* (Organisme agree):
TÜV SÜD Industrie Service GmbH
Westendstraße 199
D 80686 Munich
0036


II 2G Ex h IIC T6 Gb X
File : TÜV IT 18 ATEX 032 AR

Questa dichiarazione di conformità è rilasciata sotto la sola responsabilità del produttore. - *This declaration of conformity is issued under the sole responsability of the manufacturer.* - Diese Konformitätserklärung wird unter der alleinigen Verantwortung des Herstellers ausgestellt.
Cette déclaration de conformité est émise sous la seule responsabilité du fabricant.

Fluido - *Fluid* - **Fluide**
G / S / L
Group 1 or 2

- Marchio del costruttore: (Manifacturer's Mark): *(Herstellerzeichen):* **(Marquae du constructeur)**

- Materiali: (Material): *(Material):* **(Matériaux):**

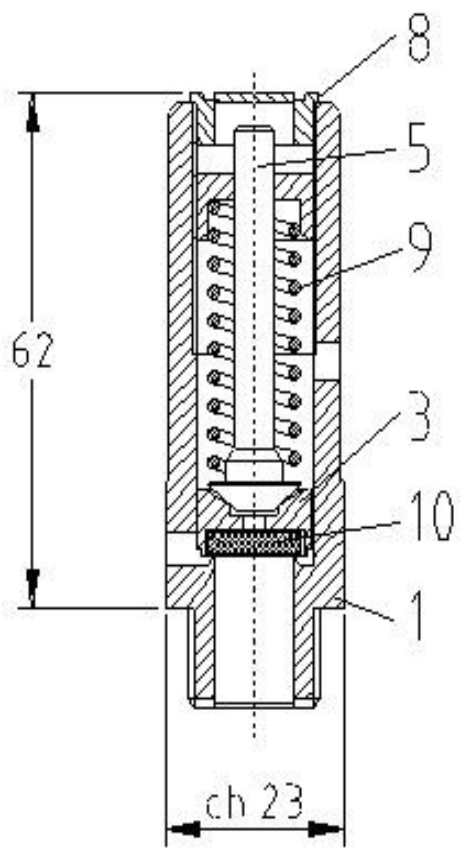

1- UNI EN 10088 1.4404
3- UNI EN 10088 1.4404
5- UNI EN 10088 1.4404
8- UNI EN 10088 1.4404
9- UNI EN 10270-3 1.4310

10 VITON (-20 / +200 °C)

Anno costruzione:
(Year of manufacture):
(Baujahr):
(Annee de fabrication):
2025

- P.N.: **60** *(Nenndruck):*

- h / do: **0,4**

- D.N.: (Nominal Diameter): *(Anschlusgewinde):* **(D.N):**

- Diametro orifizio: do (Opening diameter): do *(Innen durchmrsser): do* **(Diametre orifice):do** **10** mm

- Alzata: h (Valve Lift): h *(Hub): h* **(Haussement): h** **4** mm

- Coefficiente di efflusso : (Flow coefficient.): *(AusfluBziffer.):* **(Coefficient d'écoulement** **Kd 0,86**

- Pressione di taratura: (Setting Pressure): *(Abgleichungssdruck):* **(Pression de tarage):** **4,7** bar g

- Sovrappressione: (Overpressure): *(Uber-Unterdruck):* **(Surpression):** **10%** % della pressione di taratura (% of Setting Pressure) *(% Abgieichungsdruck)* **(% De la pression de tarage)**

- Entrata: (In): *(Eintritt):* **(Entre):** **1/2" NPT**

- Uscita: (Out): *(Austritt):* **(Sortie):**

- Area: (Area): *(Offnung):* **(Surface):** **0,785** cm^2

- Limiti di temperatura di esercizio dei materiali utilizzati a pressione atmosferica: (Operating temperature limits for materials used at atmospheric pressure): **-20 / +200 °C**
(Betriebstemperaturgrenze der unter Luftdruck verwendeten Materialien):
(Limites de température de fonctionnement des matériaux utilisés sous pression atmosphérique):

- Coefficiente di efflusso ridotto : (Reduced flow coefficient): **Kdr = 0,9xKd = 0,77**
(Reduzierte Ausflußziffer):
(Coefficient d'écoulement réduit

- Variabilità campo di taratura: (Variability Setting Filed): **3,1 - 5** bar g
(Abgleichungsberelch):
(Variabilite champ de tarage):

- Scarto di chiusura: (Closing variation): *(Unterdruck):* **(Ecart de fermature):** **15%** % della pressione di taratura (% of Setting Pressure) *(% Abgieichungsdruck)* **(% De la pression de tarage)**

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide): **ARIA-AIR-LUFT** Temper. : **0** °C

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** **328,02** kg/h **253,73** Nm^3 / h **4228,82** lt/min.

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide):

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** kg/h Nm^3 / h lt/min.

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide):

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** kg/h Nm^3 / h lt/min.

Si dichiara che la valvola ha subito con buon esito il controllo finale compreso il test di tenuta (90% Pset) e la prova idraulica del corpo a 1,5 x P.N.
We declare that this valve has passed successfully the test, the seat tightness test (90% Pset) and the hydraulic test of the body to 1,5 x P.N.
Hiermit bestätigen wir, dass das Ventil die Abschlusskontrolle einschließlich der Sitzdichtheit (90%Pset) und hydraulischen Gehäuseprüfung mit einem Druck von 1,5 x P.N.
On declare que la soupape a ete soumise avec resultat satisfiant a le control final y-compri l'epreuve d'étanchéité (90% Pset) et l'epreuve hydraulique du corps a 1,5xPN.

EN 10204 3.1 Cod. : **00F16D10SSVNPAX047**

Nr.Ord. : D2500700 REV 1

S.V. Code : 00F16D10SSVNPAX047

Date : 17/04/2025

NUOVA GENERAL INSTRUMENTS SRL
Albertini Patrizia (CEO)

NUOVA GENERAL INSTRUMENTS

	I Descrizione ATEX-UKEX	GB Atex-UKEX Description	D *Beschreibung ATEX-UKEX*	F Description ATEX-UKEX	ES Descripción ATEX-UKEX
	Simbolo rappresentativo per dispositivi certificati ATEX-UKEX	Representative symbol of ATEX-UKEX certified equipment	*Repräsentatives Symbol für ATEX-UKEX zertifizierte Geräte*	Symbole représentatif des équipements certifiés ATEX-UKEX	*Símbolo representativo para dispositivos con certificación ATEX-UKEX*
II	Gruppo dell'apparecchio	Equipment's group	*Gerätegruppe*	Groupe d'appareils	*Grupo de dispositivos*
2	Categoria dell'apparecchio	Equipment's category	*Gerätekategorie*	Catégorie d'appareils	*Categoría de dispositivos*
G	Protezione delle atmosfere esplosive dovute a presenza di GAS, VAPORI E NEBBIE	Protected to explosive atmosphere due to GAS, STEAM and FOG	*Schutz explosionsfähiger Atmosphären durch GAS, DAMPF UND NEBEL*	Protection des atmosphères explosives grâce à la présence de GAZ, VAPEURS ET BROUILLARDS	*Protección de atmósferas explosivas debido a la presencia de GAS, VAPOR Y NIEBLA*
GD	Protezione delle atmosfere esplosive dovute a presenza di GAS, VAPORI, NEBBIE, NUBI e POLVERI	Protected to explosive atmosphere due to GAS, STEAM, FOG and DUST	*Schutz explosionsfähiger Atmosphären durch GAS, DAMPF, NEBEL, WOLKEN und PULVER*	Protection des atmosphères explosives grâce à la présence de GAZ, VAPEURS, BROUILLARDS, NUAGES et POUSSIÈRES	*Protección de atmósferas explosivas debido a la presencia de GAS, VAPORES, NIEBLA, NUBES y POLVO*
Ex h (Type of protection "c" constructional safety)	Indicazione di apparecchiatura non elettrica	Non-electrical equipment indication	*Hinweis auf nichtelektrische Geräte*	Indication des équipements non électriques	*Indicación de equipos no eléctricos*
IIC	Sottodivisione del gruppo di apparecchi	Equipment group subdivision	*Unterteilung der Gerätegruppe*	Subdivision du groupe d'appareils	*Subdivisión del grupo de dispositivos*
T6	Temperatura massima di parete ≤85°C	Maximum surface temperature ≤85°C	*Maximale Oberflächentemperatur ≤85 ° C*	Température maximale de paroi ≤85 ° C	*Temperatura máxima de la pared ≤85 ° C*
Gb	Equipment Protection Level (EPL)	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*
GbDb	Equipment Protection Level (EPL)	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*
X	La massima temperatura superficiale potrebbe essere superiore alla classe di temperatura, si raccomanda come massima temperatura il valore maggiore tra T6 e la max Temperatura ammissibile per la tenuta (V. COC)	The max surface temperature could be higher than the temperature class, it is recommended as max temperature the higher value between T6 and the max Admissible temperature for the seal (V. COC)	*Die max. Oberflächentemperatur kann höher sein als die Temperaturklasse, als max. Temperatur wird der höhere Wert zwischen T6 und der max. zulässigen Temperatur für die Dichtung (V. COC) empfohlen.*	La température de surface maximale peut être supérieure à la classe de température, il est recommandé comme température maximale la valeur la plus élevée entre T6 et la température maximale admissible pour le joint (V. COC)	*La temperatura máxima de la superficie podría ser superior a la clase de temperatura, se recomienda como temperatura máxima el valor más alto entre T6 y la temperatura máxima admisible para el sello (V. COC)*

ITEM	Tag	25-PSV-017	: Safety Valve - Vessel V-25001E Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10004841	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		25308830			
Manufacturer	NUOVA GENERAL INSTRUMENTS			**Model**		D10/S			
Cert No.	D.o.C. by Manufacturer			**Equipment Ambient Temp.**		-20 °C to +40 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	NA

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	NA	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PSV-017	: Safety Valve - Vessel V-25001E Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80016
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004841		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-PSV-017	: Safety Valve - Vessel V-25001E Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80016		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10004841	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-29	2025-02-03	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:44:51.686Z	PROVERLIS Digitaly signed by Luca Mussi 2025-02-03T12:48:20.342Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

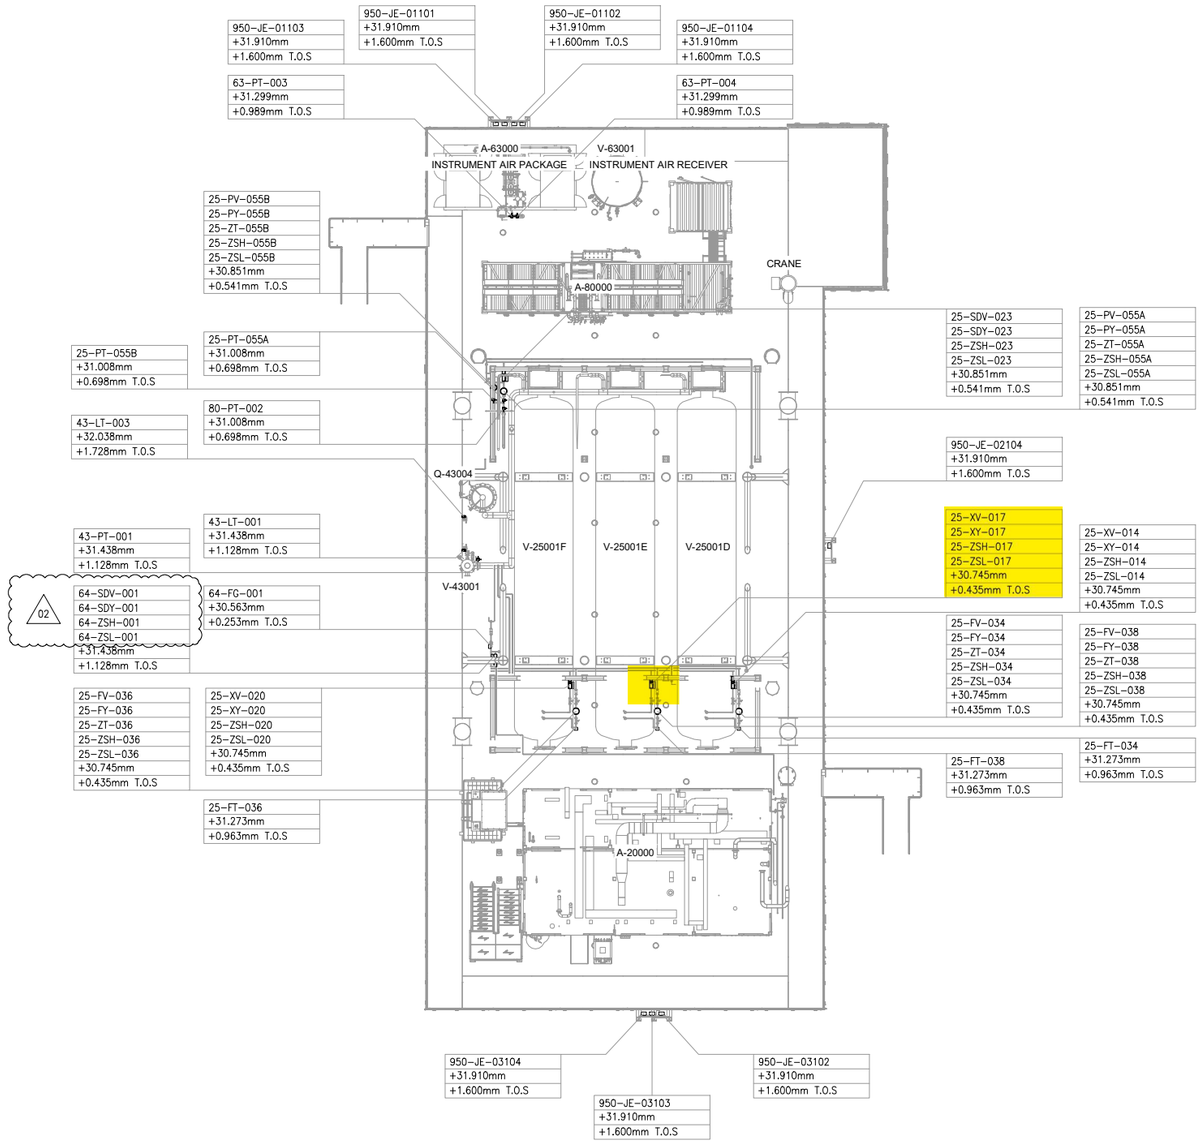


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 E

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

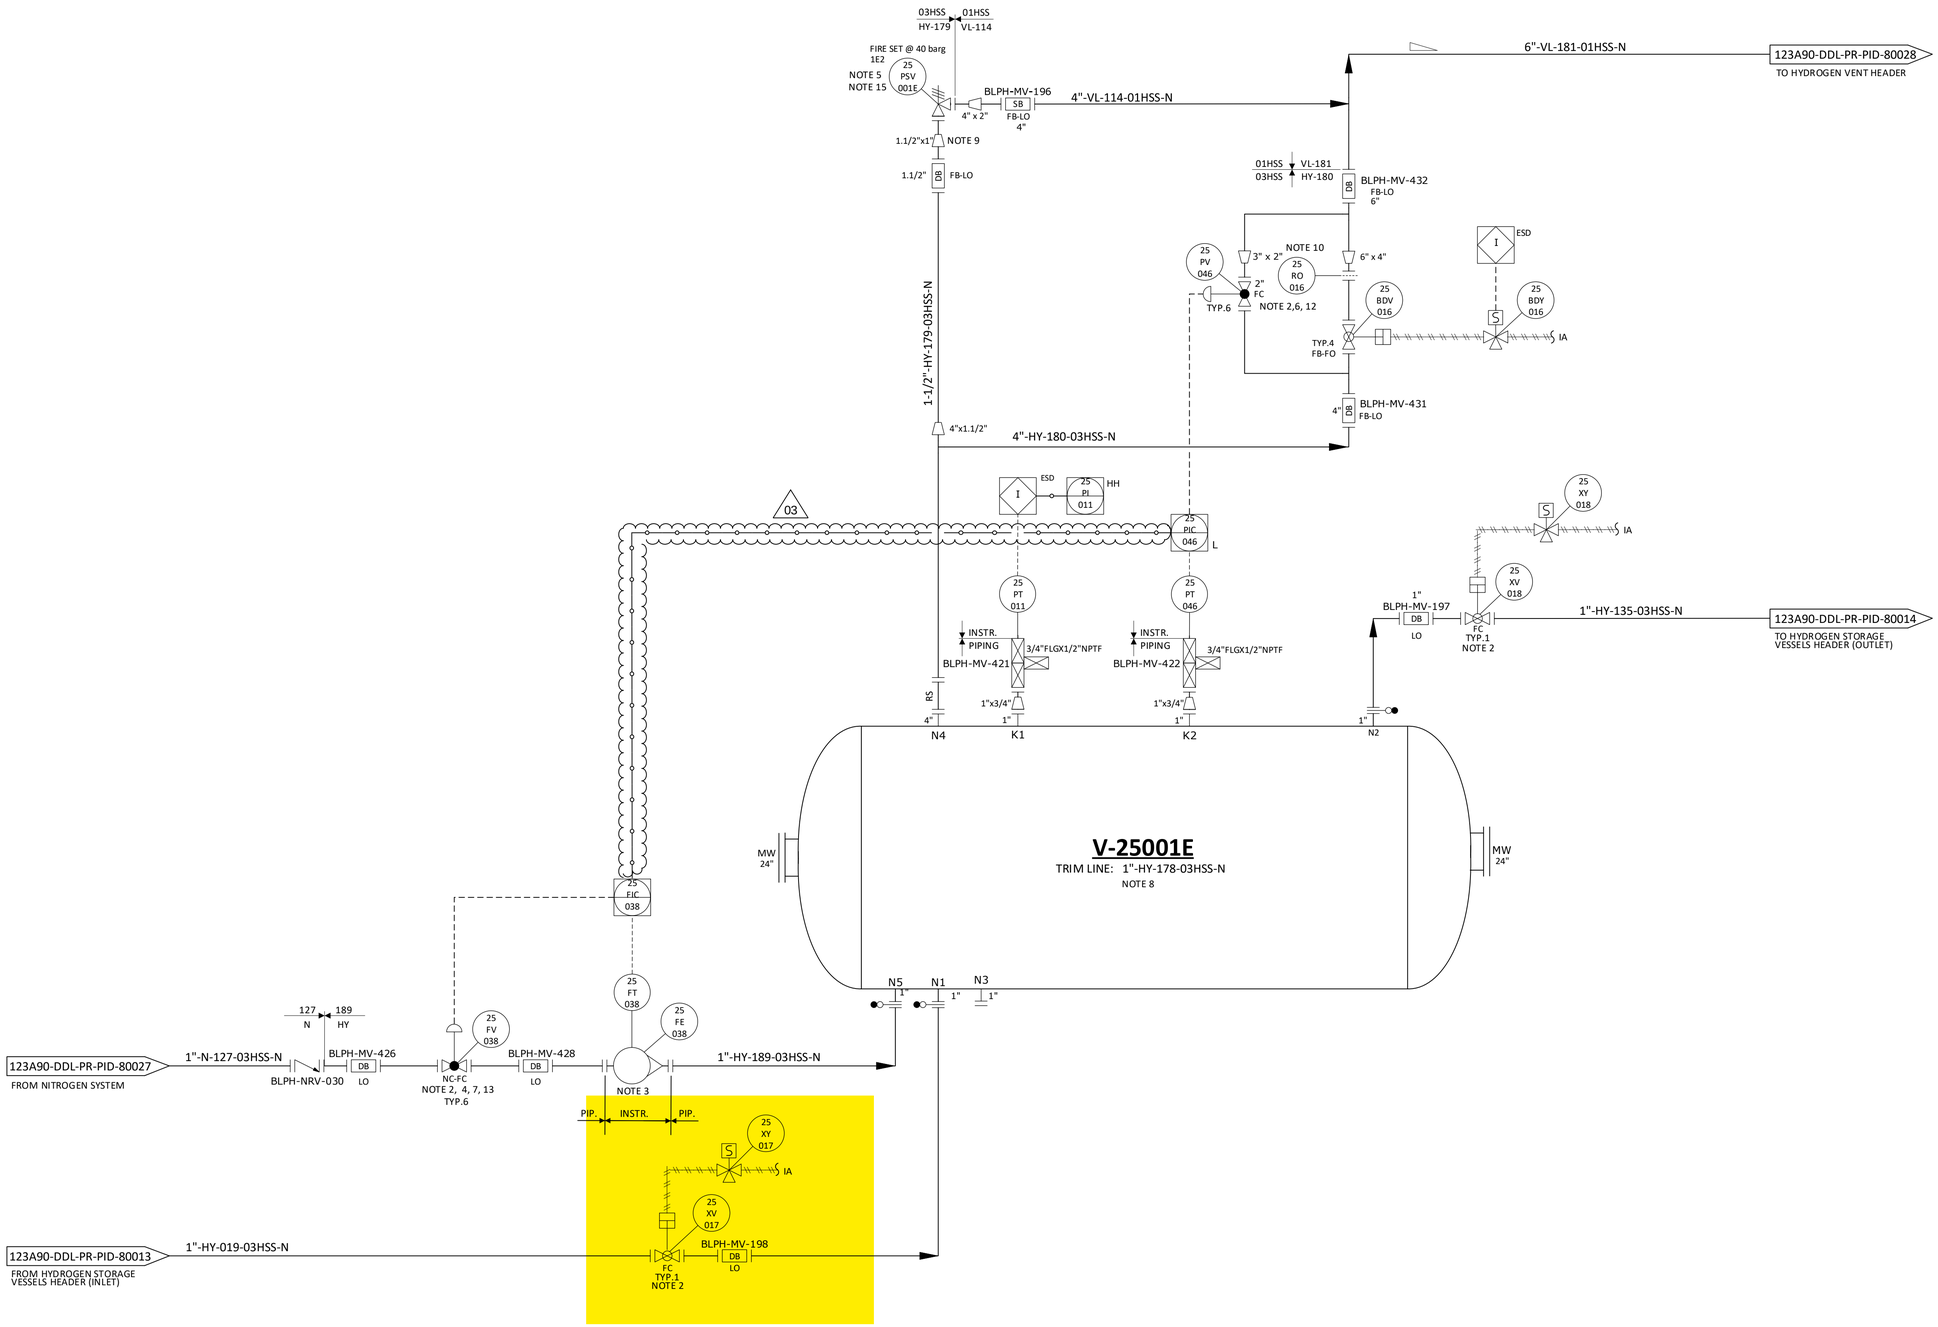

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-038) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-046 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-046 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-038 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-046 HAS FAILED TO CLOSE.
15. 25-PSV-001E SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL E

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE		
A1	DRAWING NO. 123A90-DDL-PR-PID-80019			SHEET 001	REV. 03

File Name = FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

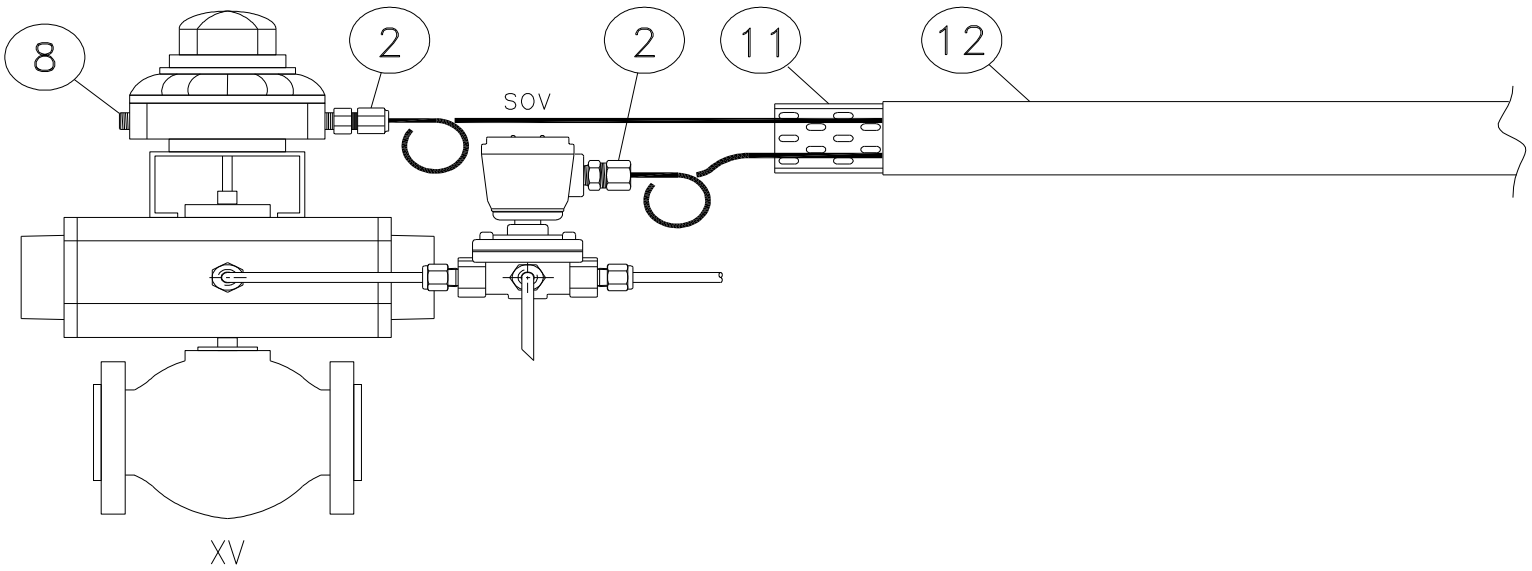

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_B	06/11/24	G.Randi

ROSETTI MARINO SpA


NOTE:

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

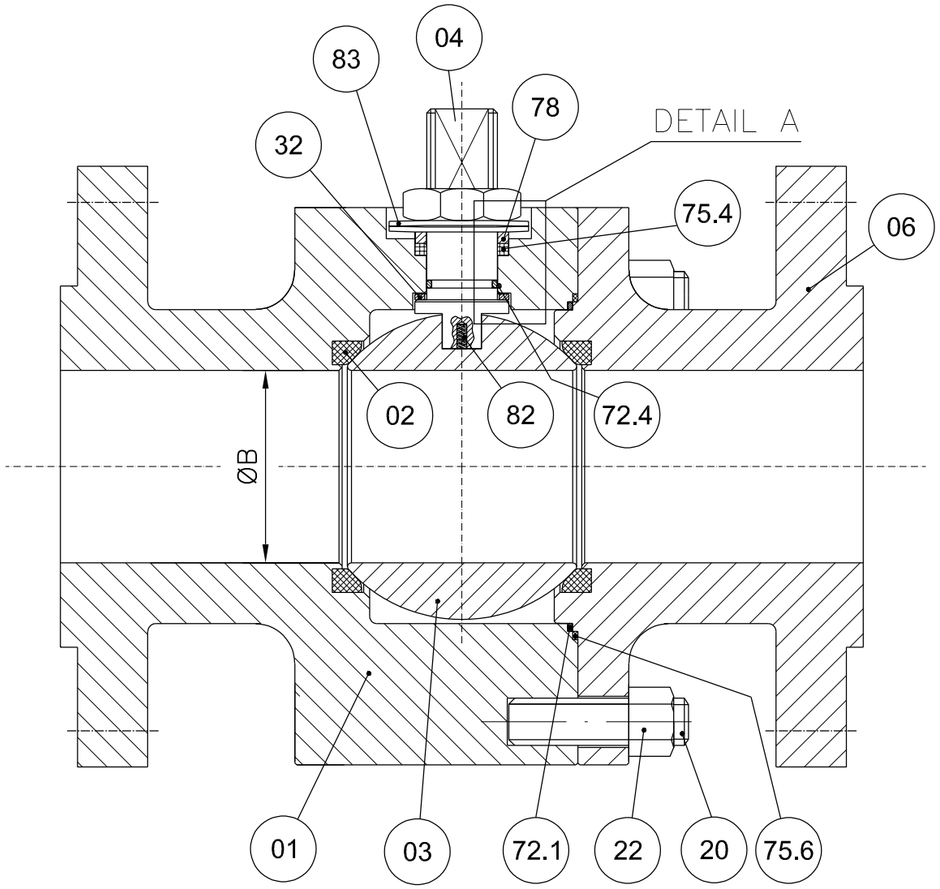


DETAIL A




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: D240062-08 — Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-017		25
	2	Service				HYDROGEN STORAGE TANK V-25001E INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80019		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-019-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-017 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-017 (9, 17) - Soldo SS		25-ZSH-017 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

94	IFR	25-XV-009	floating ball valve	N.A	FLUITEK	1" 300#	2400620140001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
95	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
96	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
97	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323313	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
98	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
99	IFR	25-XV-011	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
100	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
101	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620150001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
102	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
103	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
104	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323306	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
105	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
106	IFR	25-XV-012	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
107	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
108	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620160001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
109	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
110	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
111	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323308	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
112	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
113	IFR	25-XV-014	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
114	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
115	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620170001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
116	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
117	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
118	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323303	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
119	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
120	IFR	25-XV-015	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
121	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
122	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620180001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
123	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
124	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
125	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323288	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
126	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
127	IFR	25-XV-017	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
128	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
129	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620190001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
130	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
131	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
132	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323307	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
133	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
134	IFR	25-XV-018	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
135	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
136	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620200001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
137	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
138	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
139	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323296	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

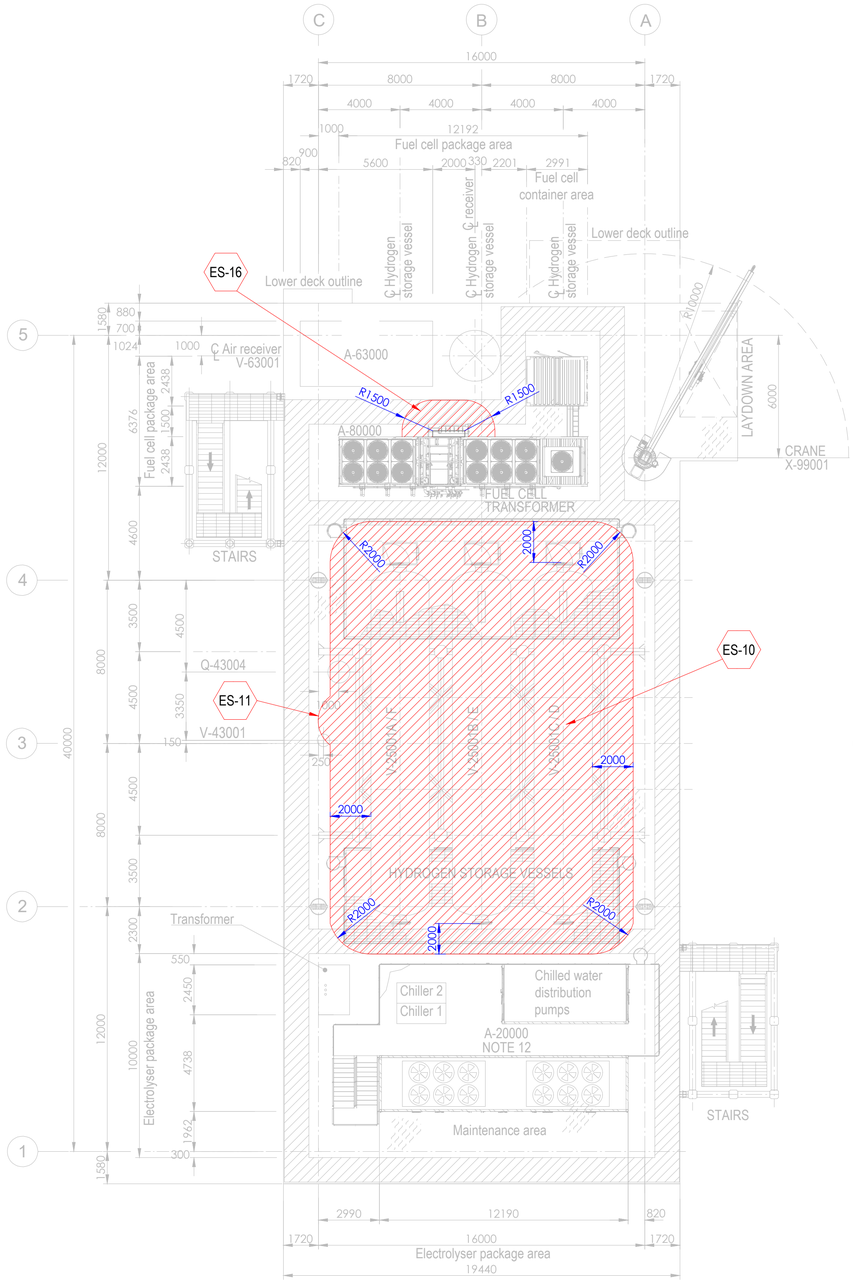


PLAN ON UPPER DECK
EL+30.310 T.O.S.

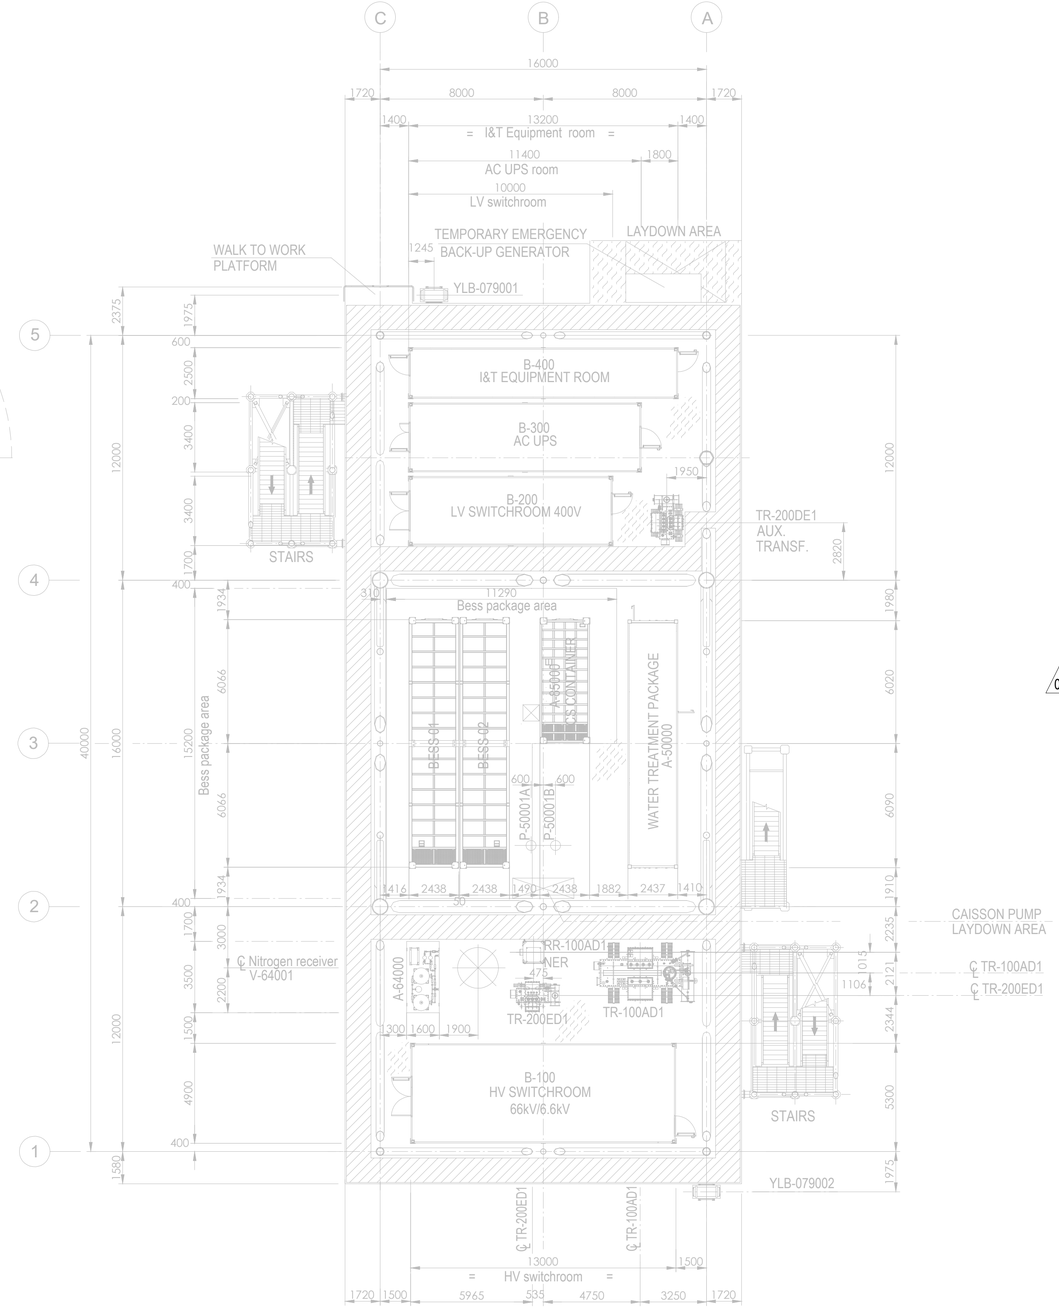

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

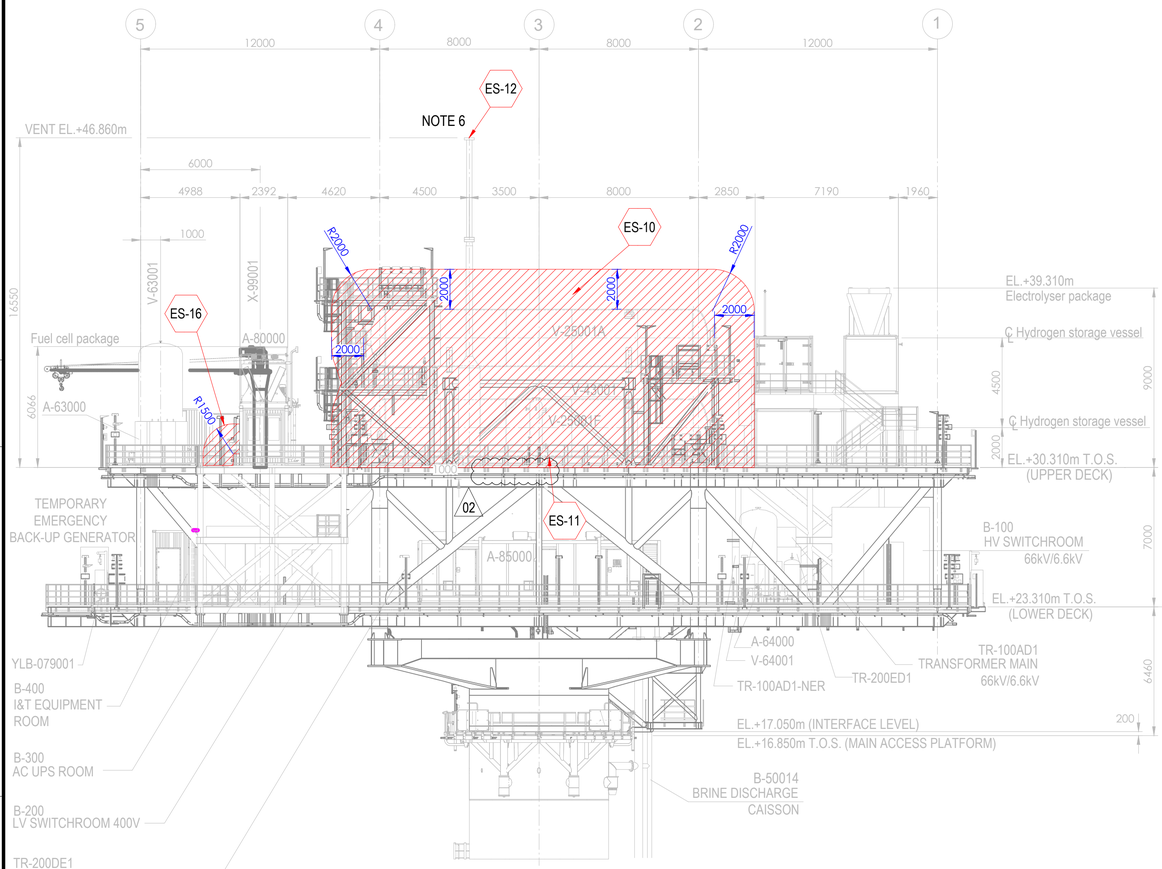



ELEVATION LOOKING EAST

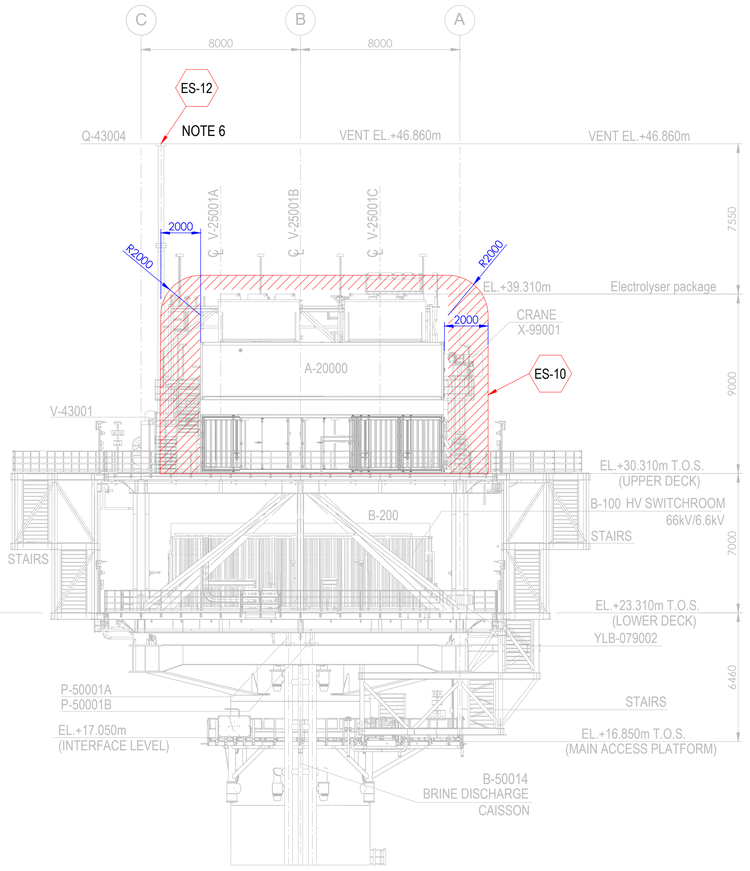

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

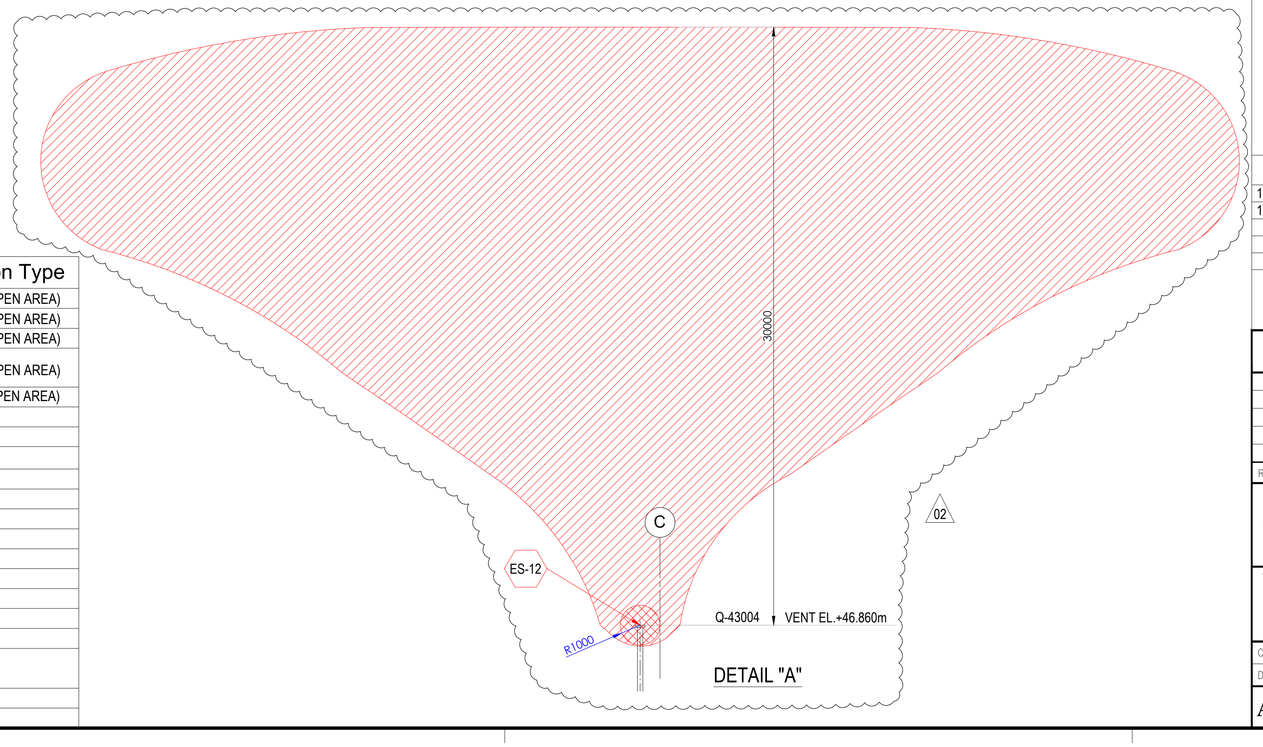



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

Rotork Fluid Systems s.r.l.
Via padre Jacques Hamel, 138 B
55016 Porcari, Lucca
Italy

Tel. +39 0583 2221
Fax. +39 0585 091362
http://www.rotork.com

rotork
Fluid Systems

DECLARATION

Rotork Fluid Systems s.r.l. herewith declares that for the job AF7703, as the supplier of the following equipment:

Product: Safety Relief Valve (PSV)
Type/Model: D10/S INOX
Serial Number(s): 025308828; 025308829; 025308830; 025308831; 025308832; 025308833; 025308834; 025308835; 025308836; 025308837; 025308838; 025308839; 025308840; 025308841; 025308842; 025308843; 025308844; 025308845; 025308846; 025308847; 025308848; 025308849; 025308850; 025308851; 025308852; 025308853; 025308854; 025308855.
Intended Use: Installation in ATEX Zone 2 – Gas Group IIC / IIB + H_2
Category: II 2G
Protection Type: Ex h IIC T6 Gb X (non-electrical equipment)

Hereby declares under its sole responsibility that the above equipment has been purchased in full compliance with the requirements of:

- Directive 2014/34/EU (ATEX)
- Harmonised standards: EN ISO 80079-36:2016 and EN ISO 80079-37:2016
- The relevant essential health and safety requirements as set out in Annex II of Directive 2014/34/EU.

This product is not yet in service and is currently installed but not operational. According to applicable legislation and guidance (including the Blue Guide 2022 and ATEX Guidelines 3rd Edition, July 2023), the CE and ATEX markings can be legitimately applied, even if the equipment has already been installed.
The conformity assessment procedure followed is: Internal production control (Annex VIII – Module A), with the technical documentation deposited with the Notified Body:
Notified Body: TUV SUD Italia – NB N° 0948
Reference: TUV IT 18 ATEX 032 AR
We hereby authorise the application of the ATEX marking in situ, under our responsibility, following the above.
This declaration is issued under the sole responsibility of the supplier.

Lucca, 18/04/2025

On behalf of Rotork Fluid Systems s.r.l.

Lucia Fregoli – Quality Manager

NUOVA GENERAL INSTRUMENTS s.r.l.
LOC. CAMPASSO - 29010 PIANELLO VALTIDONE (PC) Italy - Tel. +39 0523994629 - Fax +39 0523997219
http:// www.nuovageneral.it - E-mail: info@nuovageneral.it - P.IVA 01337040339 - C.F. 01317650065
REA-PC 117793 - Reg. Imp.PC 01317650065 - Capitale Sociale € 100.000,00 i.v.

N. **025308830**

Tipo: (Typ.): **D10/S INOX**

Dis. : **009-0 Rev. 24/10/22**

DICHIARAZIONE DI CONFORMITÁ UE Allegato IV, D. E. 2014/68/UE - Allegato VIII, D.E. 2014/34/UE
DECLARATION OF CONFORMITY EU Annex IV, E. D. 2014/68/EU - Annex VIII, E.D. 2014/34/EU
KONFORMITATSERKLARUNG EU Anlage IV Richtlinie 2014/68/EU - Anlage VIII Richtlinie 2014/34/EU
DECLARATION DE CONFORMITÉ UE Annexe IV D.E. 2014/68/UE - Annex VIII D.E. 2014/34/UE

VALVOLA DI SICUREZZA
SAFETY VALVE
SICHERHEITSVENTIL
SOUPAPE DE SURETE

PROGETTO , COSTRUZIONE E COLLAUDO CONFORME ALLA DIRETTIVA 2014/68/UE - 15/05/14 CATEGORIA IV Modulo H1
DESIG , MANUFACTURE AND TEST ACCORDING TO 2014/68/EU DIRECTIVE - 15/05/14 CLASS IV Module H1
PROJEKT , KONSTRUKTION UND ABNAHMEPRUFUNG GEMAB EG-RICHTLINIE 2014/68/EU - 15/05/14 KATEGORIE IV Formblatt H1
PROJET,FABRICATION ET VERIFICATION CONFORME A LA DIRECTIVE 2014/68/UE-15/05/14 CATEGORIE IV Module H1

Garanzia qualità totale Nr. : **Full quality assurance system Nr. :**
Garantie gesamte Qualität Nr. : **Garantie qualité totale Nr.:**
Module H1 : DGR-0036-QS-1180-24

Norme e spec. utilizzate : (Codes or spec.ref.) : *(Angewandte normen und spezifikationen) :* (Regulements et spec. utilise):
AD-Merkblatt A2 - VdTUV-Merkblatt Sicherheitsventil 100 / Racc."E"1979 / EN80079-36:2016 -37:2016 / ISO4126-1 / AS1271:2003 / EN13648-1 / UNI 10197

Organismo notificato: (Notified body): *(Meldestelle):* (Organisme agree):
TÜV SÜD Industrie Service GmbH
Westendstraße 199
D 80686 Munich
0036


II 2G Ex h IIC T6 Gb X
File : TÜV IT 18 ATEX 032 AR

Questa dichiarazione di conformità è rilasciata sotto la sola responsabilità del produttore. - *This declaration of conformity is issued under the sole responsability of the manufacturer.* - Diese Konformitätserklärung wird unter der alleinigen Verantwortung des Herstellers ausgestellt.
Cette déclaration de conformité est émise sous la seule responsabilité du fabricant.

Fluido - *Fluid* - **Fluide**
G / S / L
Group 1 or 2

- Marchio del costruttore: (Manifacturer's Mark): *(Herstellerzeichen):* **(Marquae du constructeur)**

- Materiali: (Material): *(Material):* **(Matériaux):**

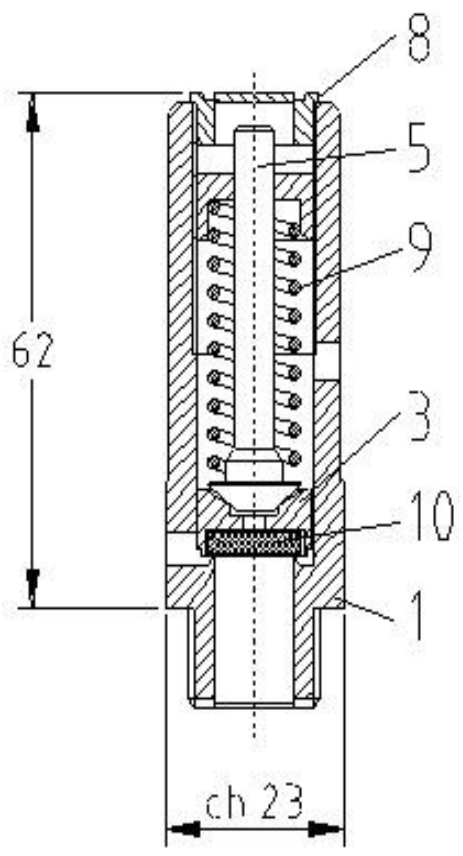

1- UNI EN 10088 1.4404
3- UNI EN 10088 1.4404
5- UNI EN 10088 1.4404
8- UNI EN 10088 1.4404
9- UNI EN 10270-3 1.4310

10 VITON (-20 / +200 °C)

Anno costruzione:
(Year of manufacture):
(Baujahr):
(Annee de fabrication):
2025

- P.N.: **60** *(Nenndruck):*

- h / do: **0,4**

- D.N.: (Nominal Diameter): *(Anschlusgewinde):* **(D.N):**

- Entrata: (In): *(Eintritt):* **1/2" NPT** **(Entre):**

- Uscita: (Out): *(Austritt):* **(Sortie):**

- Diametro orifizio: do (Opening diameter): do *(Innen durchmrsser): do* **(Diametre orifice):do** **10** mm

- Area: (Area): *(Offnung):* **(Surface):** **0,785** cm²

- Alzata: h (Valve Lift): h *(Hub): h* **(Haussement): h** **4** mm

- Limiti di temperatura di esercizio dei materiali utilizzati a pressione atmosferica: (Operating temperature limits for materials used at atmospheric pressure): **-20 / +200 °C** *(Betriebstemperaturgrenze der unter Luftdruck verwendeten Materialien):* **(Limites de température de fonctionnement des matériaux utilisés sous pression atmosphérique):**

- Coefficiente di efflusso : (Flow coefficient.): *(AusfluBziffer.):* **(Coefficient d'écoulement** **Kd 0,86**

- Coefficiente di efflusso ridotto : (Reduced flow coefficient): *(Reduzierte Ausflußziffer):* **(Coefficient d'écoulement réduit** **Kdr = 0,9xKd = 0,77**

- Pressione di taratura: (Setting Pressure): *(Abgleichungssdruck):* **(Pression de tarage):** **4,7** bar g

- Variabilità campo di taratura: (Variability Setting Filed): *(Abgleichungsberelch):* **(Variabilite champ de tarage):** **3,1 - 5** bar g

- Sovrappressione: (Overpressure): *(Uber-Unterdruck):* **(Surpression):** **10%** % della pressione di taratura (% of Setting Pressure) *(% Abgieichungsdruck)* **(% De la pression de tarage)**

- Scarto di chiusura: (Closing variation): *(Unterdruck):* **(Ecart de fermature):** **15%** % della pressione di taratura (% of Setting Pressure) *(% Abgieichungsdruck)* **(% De la pression de tarage)**

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide): **ARIA-AIR-LUFT** Temper. : **0** °C

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** **328,02** kg/h **253,73** Nm³ / h **4228,82** lt/min.

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide):

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** kg/h Nm³ / h lt/min.

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide):

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** kg/h Nm³ / h lt/min.

Si dichiara che la valvola ha subito con buon esito il controllo finale compreso il test di tenuta (90% Pset) e la prova idraulica del corpo a 1,5 x P.N.
We declare that this valve has passed successfully the test, the seat tightness test (90% Pset) and the hydraulic test of the body to 1,5 x P.N.
Hiermit bestätigen wir, dass das Ventil die Abschlusskontrolle einschließlich der Sitzdichtheit (90%Pset) und hydraulischen Gehäuseprüfung mit einem Druck von 1,5 x P.N.
On declare que la soupape a ete soumise avec resultat satisfiant a le control final y-compri l'epreuve d'étanchéité (90% Pset) et l'epreuve hydraulique du corps a 1,5xPN.

EN 10204 3.1 Cod. : **00F16D10SSVNPAX047**

Nr.Ord. : D2500700 REV 1

S.V. Code : 00F16D10SSVNPAX047

Date : 17/04/2025

NUOVA GENERAL INSTRUMENTS SRL
Albertini Patrizia (CEO)

NUOVA GENERAL INSTRUMENTS

	I Descrizione ATEX-UKEX	GB Atex-UKEX Description	D *Beschreibung ATEX-UKEX*	F Description ATEX-UKEX	ES Descripción ATEX-UKEX
	Simbolo rappresentativo per dispositivi certificati ATEX-UKEX	Representative symbol of ATEX-UKEX certified equipment	*Repräsentatives Symbol für ATEX-UKEX zertifizierte Geräte*	Symbole représentatif des équipements certifiés ATEX-UKEX	*Símbolo representativo para dispositivos con certificación ATEX-UKEX*
II	Gruppo dell'apparecchio	Equipment's group	*Gerätegruppe*	Groupe d'appareils	*Grupo de dispositivos*
2	Categoria dell'apparecchio	Equipment's category	*Gerätekategorie*	Catégorie d'appareils	*Categoría de dispositivos*
G	Protezione delle atmosfere esplosive dovute a presenza di GAS, VAPORI E NEBBIE	Protected to explosive atmosphere due to GAS, STEAM and FOG	*Schutz explosionsfähiger Atmosphären durch GAS, DAMPF UND NEBEL*	Protection des atmosphères explosives grâce à la présence de GAZ, VAPEURS ET BROUILLARDS	*Protección de atmósferas explosivas debido a la presencia de GAS, VAPOR Y NIEBLA*
GD	Protezione delle atmosfere esplosive dovute a presenza di GAS, VAPORI, NEBBIE, NUBI e POLVERI	Protected to explosive atmosphere due to GAS, STEAM, FOG and DUST	*Schutz explosionsfähiger Atmosphären durch GAS, DAMPF, NEBEL, WOLKEN und PULVER*	Protection des atmosphères explosives grâce à la présence de GAZ, VAPEURS, BROUILLARDS, NUAGES et POUSSIÈRES	*Protección de atmósferas explosivas debido a la presencia de GAS, VAPORES, NIEBLA, NUBES y POLVO*
Ex h (Type of protection "c" constructional safety)	Indicazione di apparecchiatura non elettrica	Non-electrical equipment indication	*Hinweis auf nichtelektrische Geräte*	Indication des équipements non électriques	*Indicación de equipos no eléctricos*
IIC	Sottodivisione del gruppo di apparecchi	Equipment group subdivision	*Unterteilung der Gerätegruppe*	Subdivision du groupe d'appareils	*Subdivisión del grupo de dispositivos*
T6	Temperatura massima di parete ≤85°C	Maximum surface temperature ≤85°C	*Maximale Oberflächentemperatur ≤85 ° C*	Température maximale de paroi ≤85 ° C	*Temperatura máxima de la pared ≤85 ° C*
Gb	Equipment Protection Level (EPL)	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*
GbDb	Equipment Protection Level (EPL)	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*
X	La massima temperatura superficiale potrebbe essere superiore alla classe di temperatura, si raccomanda come massima temperatura il valore maggiore tra T6 e la max Temperatura ammissibile per la tenuta (V. COC)	The max surface temperature could be higher than the temperature class, it is recommended as max temperature the higher value between T6 and the max Admissible temperature for the seal (V. COC)	*Die max. Oberflächentemperatur kann höher sein als die Temperaturklasse, als max. Temperatur wird der höhere Wert zwischen T6 und der max. zulässigen Temperatur für die Dichtung (V. COC) empfohlen.*	La température de surface maximale peut être supérieure à la classe de température, il est recommandé comme température maximale la valeur la plus élevée entre T6 et la température maximale admissible pour le joint (V. COC)	*La temperatura máxima de la superficie podría ser superior a la clase de temperatura, se recomienda como temperatura máxima el valor más alto entre T6 y la temperatura máxima admisible para el sello (V. COC)*

ITEM	Tag	25-PSV-020	: Safety Valve - Vessel V-25001F Hydrogen Inlet	Dwg	123A90-DDL-PR-PID-80020		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10004843	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		25308853			
Manufacturer	NUOVA GENERAL INSTRUMENTS			**Model**		D10/S			
Cert No.	D.o.C. by Manufacturer			**Equipment Ambient Temp.**		-20 °C to +40 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	NA

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	NA	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PSV-020	: Safety Valve - Vessel V-25001F Hydrogen Inlet			Dwg	123A90-DDL-PR-PID-80020
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004843		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-PSV-020	: Safety Valve - Vessel V-25001F Hydrogen Inlet		Dwg	123A90-DDL-PR-PID-80020	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10004843	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type "nR" only)	x	NA	
71	Breathing operation is satisfactory (type "nR" only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for 'IS' Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-29	2025-02-03	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:45:10.556Z	PROVERLIS Digitaly signed by Luca Mussi 2025-02-03T12:54:24.241Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

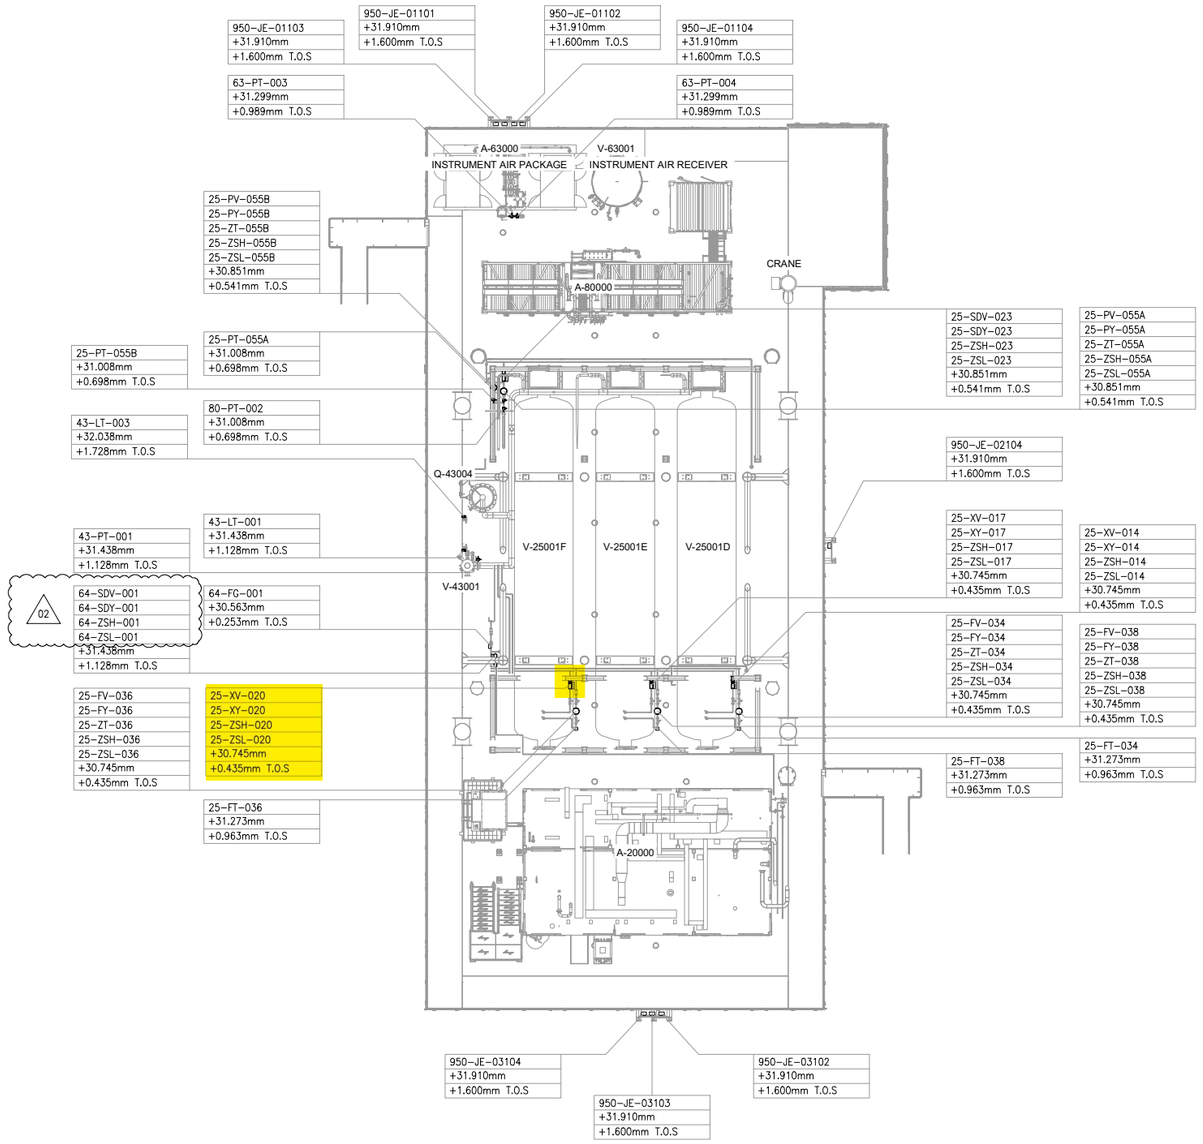


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90-DDL-IN-DL-40081	001	02

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001_F

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

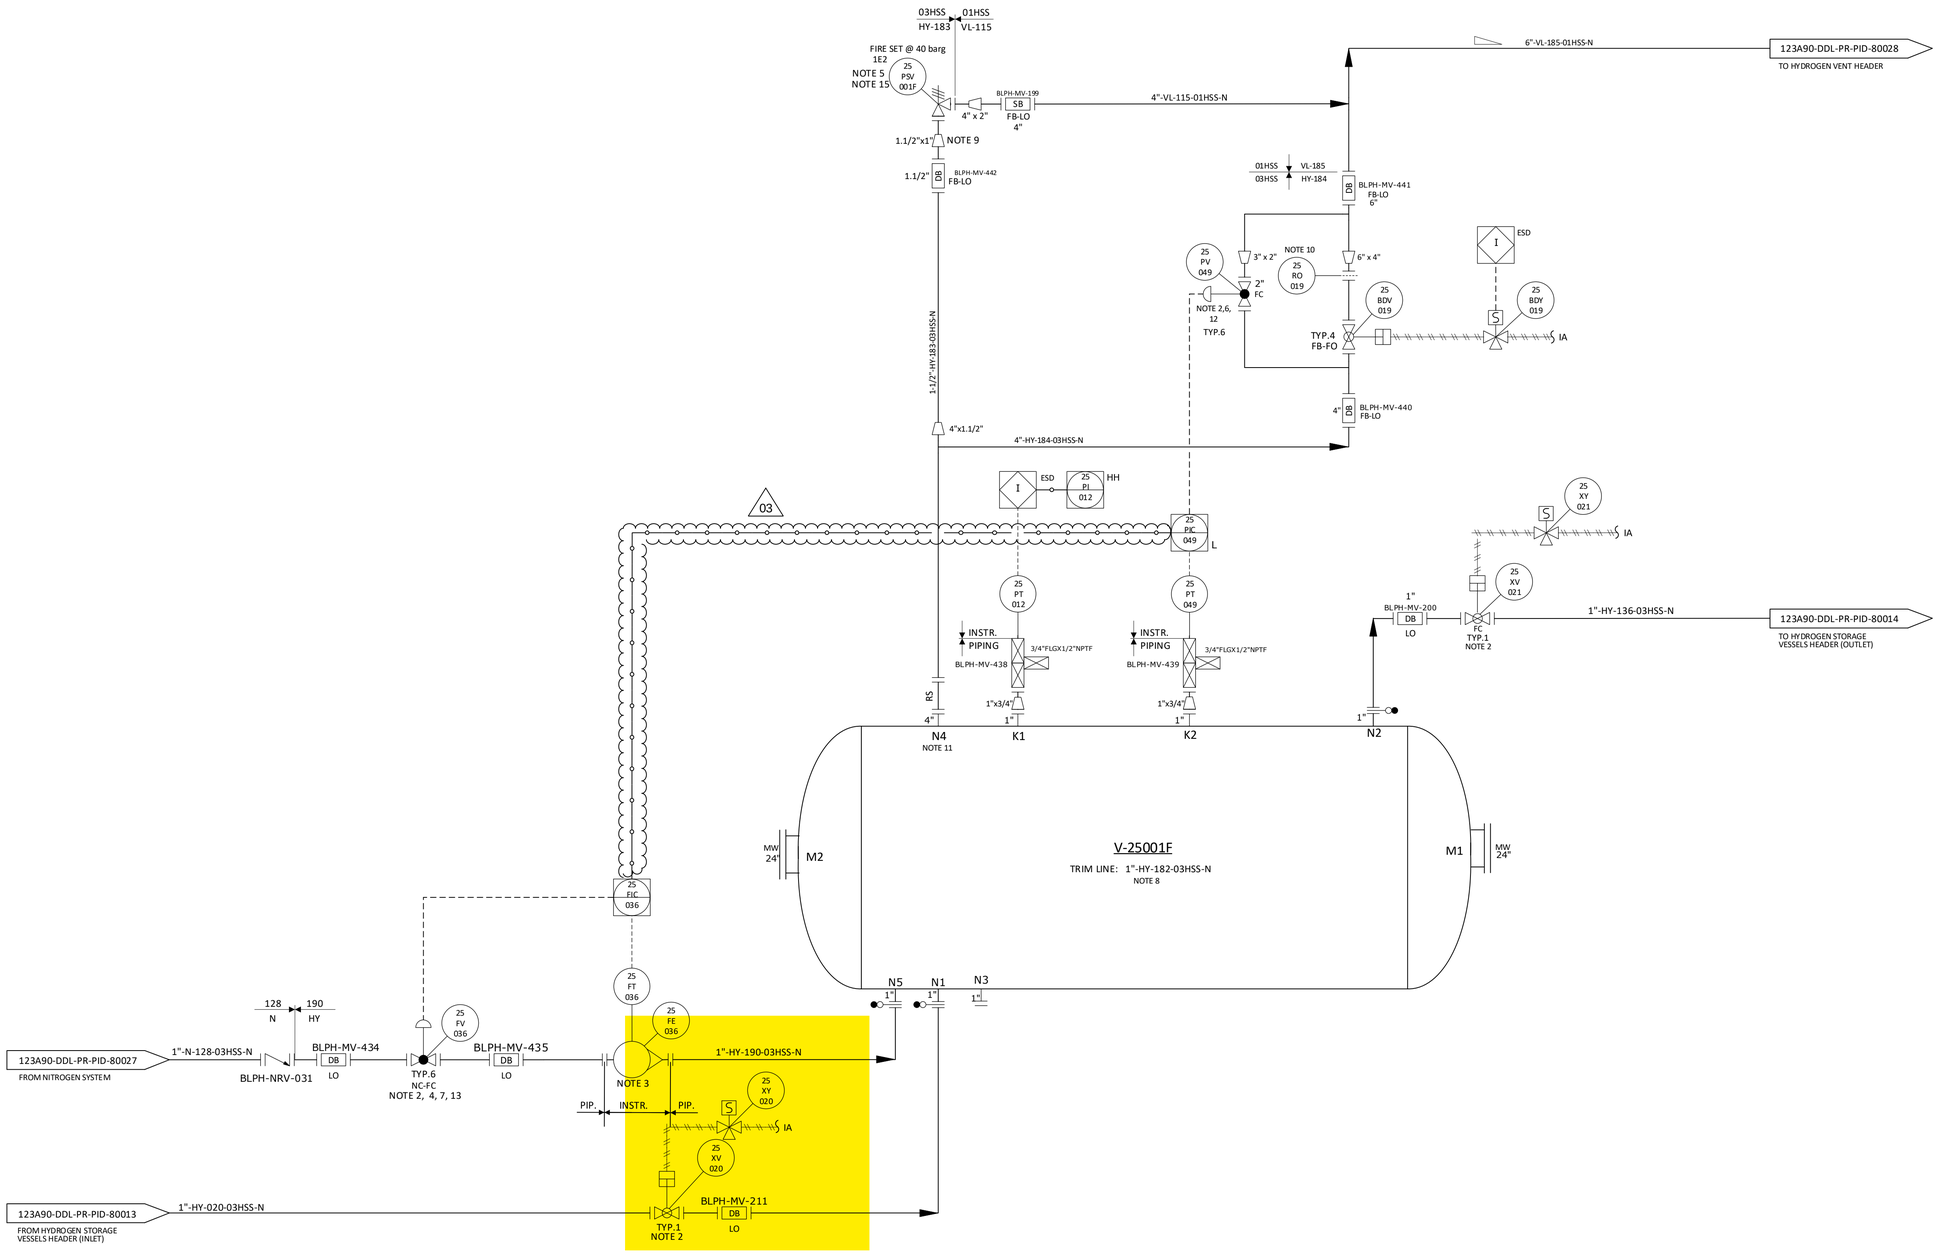

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-036) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-049 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-049 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25FV036 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-049 HAS FAILED TO CLOSE.
15. 25-PSV-001F SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR HAZOP (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL F

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80020		SHEET 001	REV. 03

File Name = FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

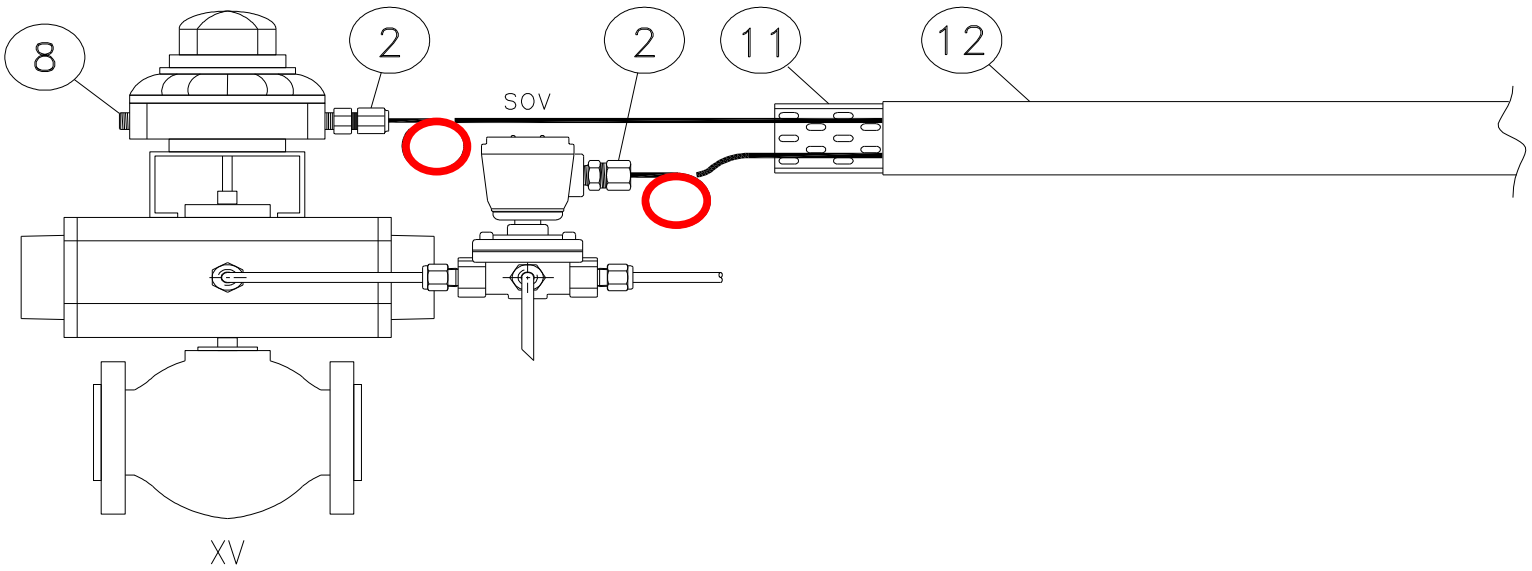

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

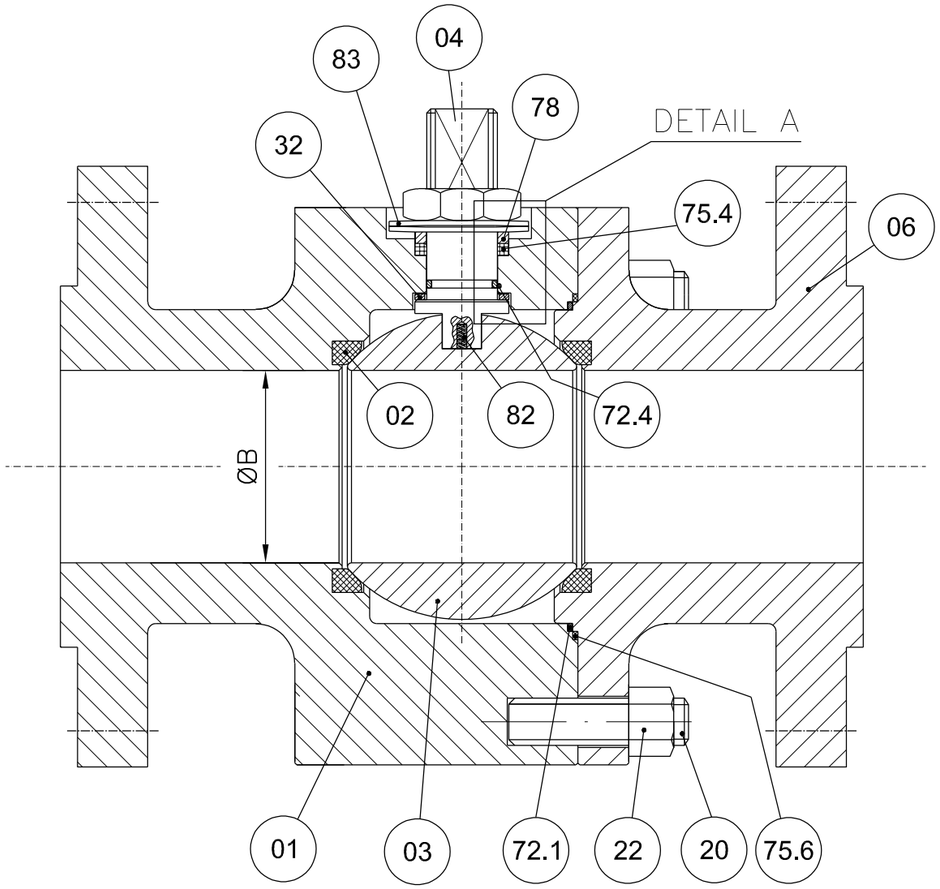




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

1 Rev.

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

1 Rev.

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	ALL RIGHTS OF THIS DRAWING ARE RESERVED.

DRAWING NAME: **D240062-08** Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-020		25
	2	Service				HYDROGEN STORAGE TANK V-25001F INLET		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80020		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-020-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close :	(12)	Open : (12)
	17	Operation (seconds)	Actual			Close :	0.3 minimum	Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-XY-020 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-020 (9, 17) - Soldo SS		25-ZSH-020 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

140	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
141	IFR	25-XV-020	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
142	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
143	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620210001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
144	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
145	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
146	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323304	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
147	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
148	IFR	25-XV-021	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
149	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
150	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620220001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
151	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
152	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
153	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323297	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
154	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
155	IFR	25-XV-024	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
156	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
157	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620230001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
158	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
159	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
160	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323291	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
161	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
162	IFR	50-XV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
163	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
164	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620240001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
165	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
166	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
167	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323289	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
168	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
169	IFR	50-XV-002	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
170	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
171	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620250001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
172	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
173	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
174	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323290	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
175	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
176	IFR	50-XV-003	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
177	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
178	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620260001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
179	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
180	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
181	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323299	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
182	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
183	IFR	50-XV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
184	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
185	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620270001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
186	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

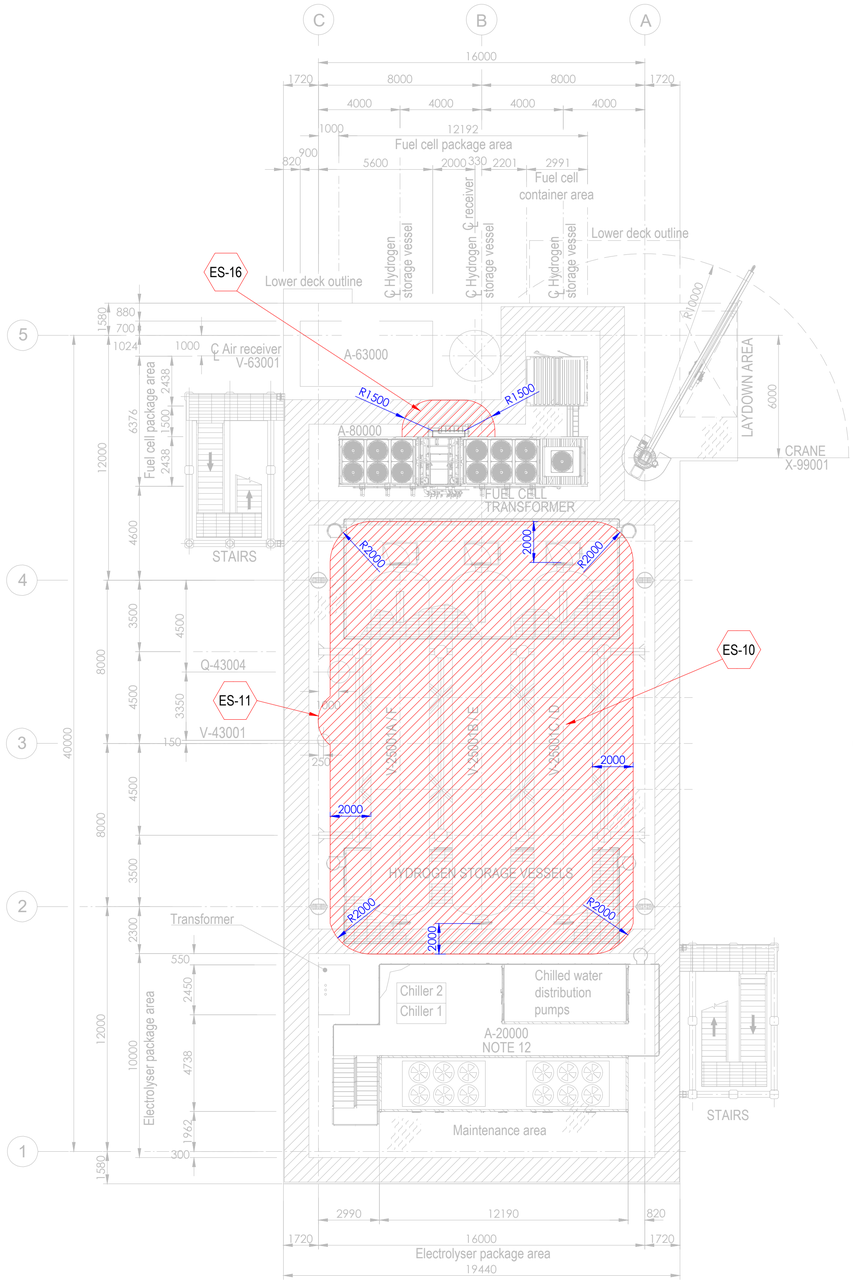


PLAN ON UPPER DECK
EL+30.310 T.O.S.

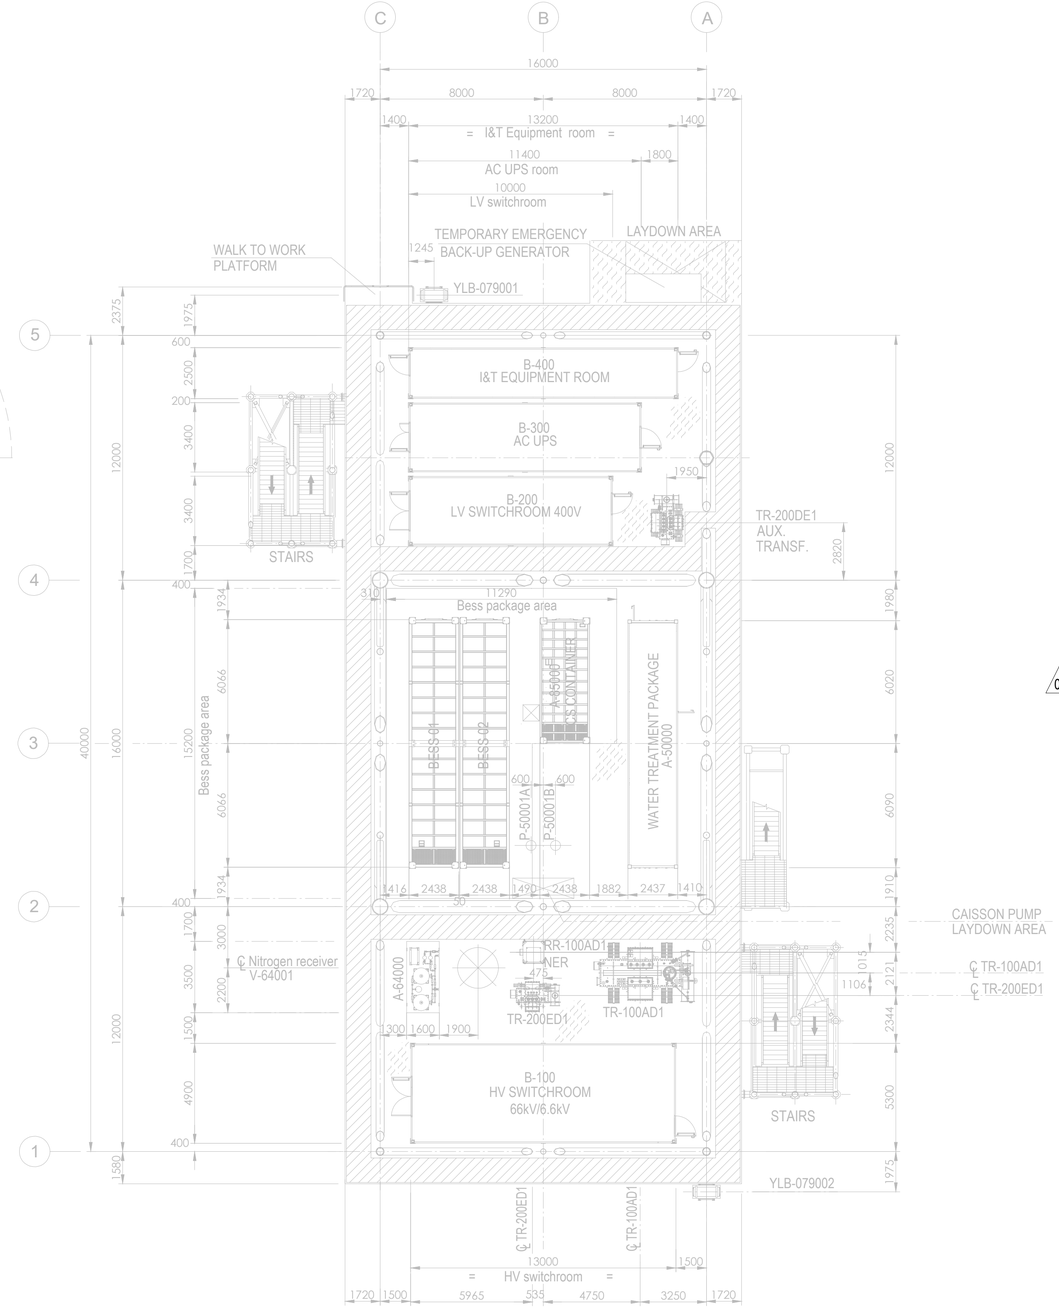

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

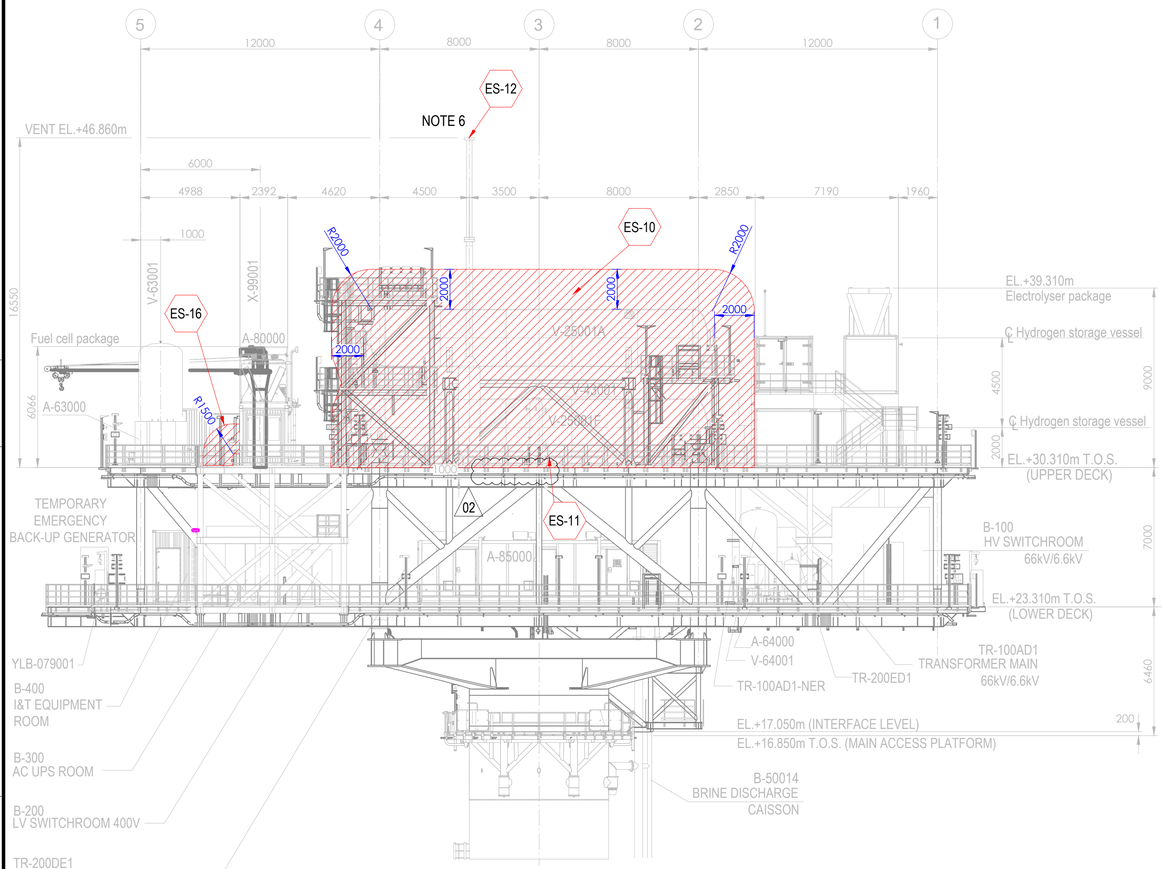



ELEVATION LOOKING EAST

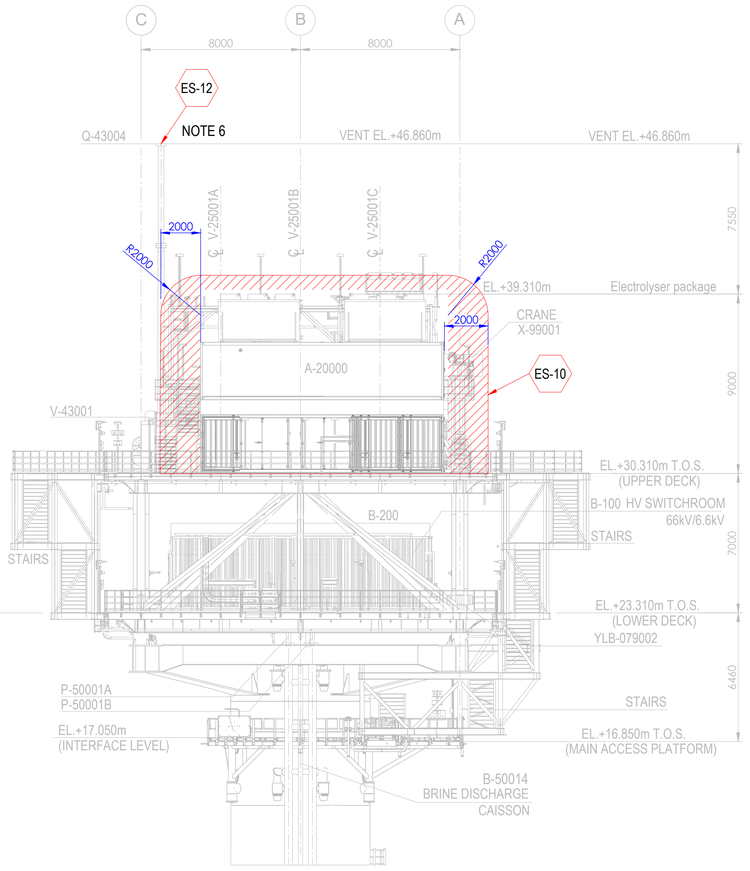

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

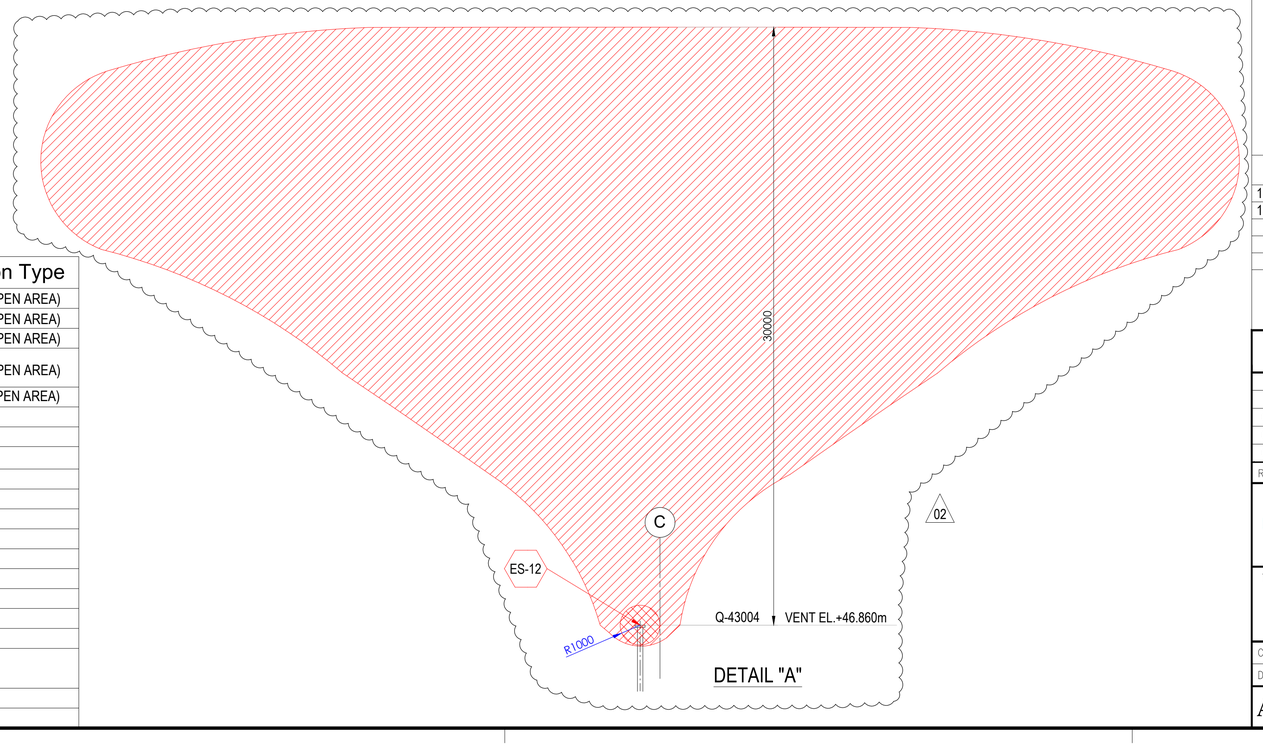



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

Rotork Fluid Systems s.r.l.
Via padre Jacques Hamel, 138 B
55016 Porcari, Lucca
Italy

Tel. +39 0583 2221
Fax. +39 0585 091362
http://www.rotork.com

rotork
Fluid Systems

DECLARATION

Rotork Fluid Systems s.r.l. herewith declares that for the job AF7703, as the supplier of the following equipment:

Product: Safety Relief Valve (PSV)
Type/Model: D10/S INOX
Serial Number(s): 025308828; 025308829; 025308830; 025308831; 025308832; 025308833; 025308834; 025308835; 025308836; 025308837; 025308838; 025308839; 025308840; 025308841; 025308842; 025308843; 025308844; 025308845; 025308846; 025308847; 025308848; 025308849; 025308850; 025308851; 025308852; 025308853; 025308854; 025308855.
Intended Use: Installation in ATEX Zone 2 – Gas Group IIC / IIB + H_2
Category: II 2G
Protection Type: Ex h IIC T6 Gb X (non-electrical equipment)

Hereby declares under its sole responsibility that the above equipment has been purchased in full compliance with the requirements of:

- Directive 2014/34/EU (ATEX)
- Harmonised standards: EN ISO 80079-36:2016 and EN ISO 80079-37:2016
- The relevant essential health and safety requirements as set out in Annex II of Directive 2014/34/EU.

This product is not yet in service and is currently installed but not operational. According to applicable legislation and guidance (including the Blue Guide 2022 and ATEX Guidelines 3rd Edition, July 2023), the CE and ATEX markings can be legitimately applied, even if the equipment has already been installed.
The conformity assessment procedure followed is: Internal production control (Annex VIII – Module A), with the technical documentation deposited with the Notified Body:
Notified Body: TUV SUD Italia – NB N° 0948
Reference: TUV IT 18 ATEX 032 AR
We hereby authorise the application of the ATEX marking in situ, under our responsibility, following the above.
This declaration is issued under the sole responsibility of the supplier.

Lucca, 18/04/2025

On behalf of Rotork Fluid Systems s.r.l.

Lucia Fregoli – Quality Manager

NUOVA GENERAL INSTRUMENTS s.r.l.
LOC. CAMPASSO - 29010 PIANELLO VALTIDONE (PC) Italy - Tel. +39 0523994629 - Fax +39 0523997219
http:// www.nuovageneral.it - E-mail: info@nuovageneral.it - P.IVA 01337040339 - C.F. 01317650065
REA-PC 117793 - Reg. Imp.PC 01317650065 - Capitale Sociale € 100.000,00 i.v.

N. **025308853**

Tipo: (Typ.): **D10/S INOX**

Dis. : **009-0 Rev. 24/10/22**

DICHIARAZIONE DI CONFORMITÁ UE Allegato IV, D. E. 2014/68/UE - Allegato VIII, D.E. 2014/34/UE
DECLARATION OF CONFORMITY EU Annex IV, E. D. 2014/68/EU - Annex VIII, E.D. 2014/34/EU
KONFORMITATSERKLARUNG EU Anlage IV Richtlinie 2014/68/EU - Anlage VIII Richtlinie 2014/34/EU
DECLARATION DE CONFORMITÉ UE Annexe IV D.E. 2014/68/UE - Annex VIII D.E. 2014/34/UE

VALVOLA DI SICUREZZA
SAFETY VALVE
SICHERHEITSVENTIL
SOUPAPE DE SURETE

PROGETTO , COSTRUZIONE E COLLAUDO CONFORME ALLA DIRETTIVA 2014/68/UE - 15/05/14 CATEGORIA IV Modulo H1
DESIG , MANUFACTURE AND TEST ACCORDING TO 2014/68/EU DIRECTIVE - 15/05/14 CLASS IV Module H1
PROJEKT , KONSTRUKTION UND ABNAHMEPRUFUNG GEMAB EG-RICHTLINIE 2014/68/EU - 15/05/14 KATEGORIE IV Formblatt H1
PROJET,FABRICATION ET VERIFICATION CONFORME A LA DIRECTIVE 2014/68/UE-15/05/14 CATEGORIE IV Module H1

Garanzia qualità totale Nr. : **Full quality assurance system Nr. :**
Garantie gesamte Qualität Nr. : **Garantie qualité totale Nr.:**
Module H1 : DGR-0036-QS-1180-24

Norme e spec. utilizzate : (Codes or spec.ref.) : *(Angewandte normen und spezifikationen) :* (Regulements et spec. utilise):
AD-Merkblatt A2 - VdTUV-Merkblatt Sicherheitsventil 100 / Racc."E"1979 / EN80079-36:2016 -37:2016 / ISO4126-1 / AS1271:2003 / EN13648-1 / UNI 10197

Organismo notificato: (Notified body): *(Meldestelle):* (Organisme agree):
TÜV SÜD Industrie Service GmbH
Westendstraße 199
D 80686 Munich
0036


II 2G Ex h IIC T6 Gb X
File : TÜV IT 18 ATEX 032 AR

Questa dichiarazione di conformità è rilasciata sotto la sola responsabilità del produttore. - *This declaration of conformity is issued under the sole responsability of the manufacturer.* - Diese Konformitätserklärung wird unter der alleinigen Verantwortung des Herstellers ausgestellt.
Cette déclaration de conformité est émise sous la seule responsabilité du fabricant.

Fluido - *Fluid* - **Fluide**
G / S / L
Group 1 or 2

- Marchio del costruttore: (Manifacturer's Mark): *(Herstellerzeichen):* **(Marquae du constructeur)**

- Materiali: (Material): *(Material):* **(Matériaux):**

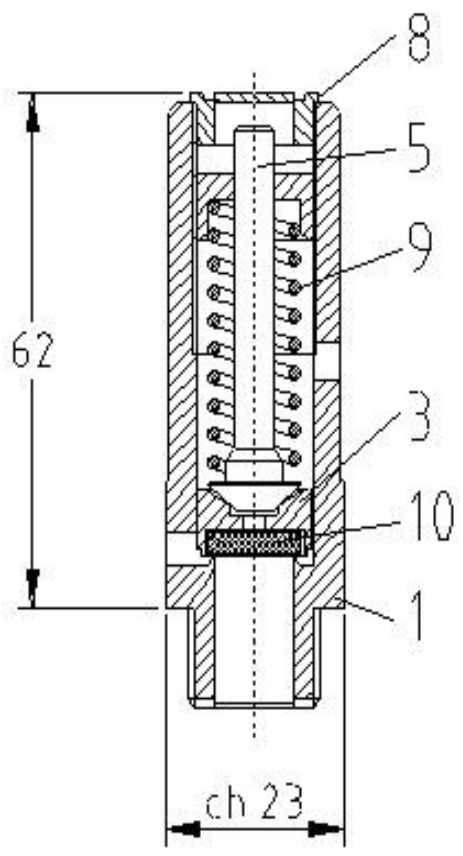

1- UNI EN 10088 1.4404
3- UNI EN 10088 1.4404
5- UNI EN 10088 1.4404
8- UNI EN 10088 1.4404
9- UNI EN 10270-3 1.4310

10 VITON (-20 / +200 °C)

Anno costruzione:
(Year of manufacture):
(Baujahr):
(Annee de fabrication):
2025

- P.N.: **60** *(Nenndruck):*

- h / do: **0,4**

- D.N.: (Nominal Diameter): *(Anschlusgewinde):* **(D.N):**

- Diametro orifizio: do (Opening diameter): do *(Innen durchmrsser): do* **(Diametre orifice):do** **10** mm

- Alzata: h (Valve Lift): h *(Hub): h* **(Haussement): h** **4** mm

- Coefficiente di efflusso : (Flow coefficient.): *(AusfluBziffer.):* **(Coefficient d'écoulement** **Kd 0,86**

- Pressione di taratura: (Setting Pressure): *(Abgleichungssdruck):* **(Pression de tarage):** **4,7** bar g

- Sovrappressione: (Overpressure): *(Uber-Unterdruck):* **(Surpression):** **10%** % della pressione di taratura (% of Setting Pressure) *(% Abgieichungsdruck)* **(% De la pression de tarage)**

- Entrata: (In): *(Eintritt):* **(Entre):** **1/2" NPT**

- Uscita: (Out): *(Austritt):* **(Sortie):**

- Area: (Area): *(Offnung):* **(Surface):** **0,785** cm^2

- Limiti di temperatura di esercizio dei materiali utilizzati a pressione atmosferica: (Operating temperature limits for materials used at atmospheric pressure): **-20 / +200 °C**
(Betriebstemperaturgrenze der unter Luftdruck verwendeten Materialien):
(Limites de température de fonctionnement des matériaux utilisés sous pression atmosphérique):

- Coefficiente di efflusso ridotto : (Reduced flow coefficient): **Kdr = 0,9xKd = 0,77**
(Reduzierte Ausflußziffer):
(Coefficient d'écoulement réduit

- Variabilità campo di taratura: (Variability Setting Filed): **3,1 - 5** bar g
(Abgleichungsberelch):
(Variabilite champ de tarage):

- Scarto di chiusura: (Closing variation): *(Unterdruck):* **(Ecart de fermature):** **15%** % della pressione di taratura (% of Setting Pressure) *(% Abgieichungsdruck)* **(% De la pression de tarage)**

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide): **ARIA-AIR-LUFT** Temper. : **0** °C

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** **328,02** kg/h **253,73** Nm^3 / h **4228,82** lt/min.

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide):

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** kg/h Nm^3 / h lt/min.

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide):

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** kg/h Nm^3 / h lt/min.

Si dichiara che la valvola ha subito con buon esito il controllo finale compreso il test di tenuta (90% Pset) e la prova idraulica del corpo a 1,5 x P.N.
We declare that this valve has passed successfully the test, the seat tightness test (90% Pset) and the hydraulic test of the body to 1,5 x P.N.
Hiermit bestätigen wir, dass das Ventil die Abschlusskontrolle einschließlich der Sitzdichtheit (90%Pset) und hydraulischen Gehäuseprüfung mit einem Druck von 1,5 x P.N.
On declare que la soupape a ete soumise avec resultat satisfiant a le control final y-compri l'epreuve d'étanchéité (90% Pset) et l'epreuve hydraulique du corps a 1,5xPN.

EN 10204 3.1 Cod. : **00F16D10SSVNPAX047**

Nr.Ord. : D2500700 REV 1

S.V. Code : 00F16D10SSVNPAX047

Date : 17/04/2025

NUOVA GENERAL INSTRUMENTS SRL
Albertini Patrizia (CEO)

NUOVA GENERAL INSTRUMENTS

	I Descrizione ATEX-UKEX	GB Atex-UKEX Description	D *Beschreibung ATEX-UKEX*	F Description ATEX-UKEX	ES Descripción ATEX-UKEX
	Simbolo rappresentativo per dispositivi certificati ATEX-UKEX	Representative symbol of ATEX-UKEX certified equipment	*Repräsentatives Symbol für ATEX-UKEX zertifizierte Geräte*	Symbole représentatif des équipements certifiés ATEX-UKEX	*Símbolo representativo para dispositivos con certificación ATEX-UKEX*
II	Gruppo dell'apparecchio	Equipment's group	*Gerätegruppe*	Groupe d'appareils	*Grupo de dispositivos*
2	Categoria dell'apparecchio	Equipment's category	*Gerätekategorie*	Catégorie d'appareils	*Categoría de dispositivos*
G	Protezione delle atmosfere esplosive dovute a presenza di GAS, VAPORI E NEBBIE	Protected to explosive atmosphere due to GAS, STEAM and FOG	*Schutz explosionsfähiger Atmosphären durch GAS, DAMPF UND NEBEL*	Protection des atmosphères explosives grâce à la présence de GAZ, VAPEURS ET BROUILLARDS	*Protección de atmósferas explosivas debido a la presencia de GAS, VAPOR Y NIEBLA*
GD	Protezione delle atmosfere esplosive dovute a presenza di GAS, VAPORI, NEBBIE, NUBI e POLVERI	Protected to explosive atmosphere due to GAS, STEAM, FOG and DUST	*Schutz explosionsfähiger Atmosphären durch GAS, DAMPF, NEBEL, WOLKEN und PULVER*	Protection des atmosphères explosives grâce à la présence de GAZ, VAPEURS, BROUILLARDS, NUAGES et POUSSIÈRES	*Protección de atmósferas explosivas debido a la presencia de GAS, VAPORES, NIEBLA, NUBES y POLVO*
Ex h (Type of protection "c" constructional safety)	Indicazione di apparecchiatura non elettrica	Non-electrical equipment indication	*Hinweis auf nichtelektrische Geräte*	Indication des équipements non électriques	*Indicación de equipos no eléctricos*
IIC	Sottodivisione del gruppo di apparecchi	Equipment group subdivision	*Unterteilung der Gerätegruppe*	Subdivision du groupe d'appareils	*Subdivisión del grupo de dispositivos*
T6	Temperatura massima di parete ≤85°C	Maximum surface temperature ≤85°C	*Maximale Oberflächentemperatur ≤85 ° C*	Température maximale de paroi ≤85 ° C	*Temperatura máxima de la pared ≤85 ° C*
Gb	Equipment Protection Level (EPL)	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*
GbDb	Equipment Protection Level (EPL)	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*
X	La massima temperatura superficiale potrebbe essere superiore alla classe di temperatura, si raccomanda come massima temperatura il valore maggiore tra T6 e la max Temperatura ammissibile per la tenuta (V. COC)	The max surface temperature could be higher than the temperature class, it is recommended as max temperature the higher value between T6 and the max Admissible temperature for the seal (V. COC)	*Die max. Oberflächentemperatur kann höher sein als die Temperaturklasse, als max. Temperatur wird der höhere Wert zwischen T6 und der max. zulässigen Temperatur für die Dichtung (V. COC) empfohlen.*	La température de surface maximale peut être supérieure à la classe de température, il est recommandé comme température maximale la valeur la plus élevée entre T6 et la température maximale admissible pour le joint (V. COC)	*La temperatura máxima de la superficie podría ser superior a la clase de temperatura, se recomienda como temperatura máxima el valor más alto entre T6 y la temperatura máxima admisible para el sello (V. COC)*

ITEM	Tag	25-PSV-024	: Safety Valve - Hyrogen to Vessels Inlet Header Vent System	Dwg	123A90-DDL-PR-PID-80013		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10004845	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01

Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		25308842			
Manufacturer	NUOVA GENERAL INSTRUMENTS			**Model**		D10/S			
Cert No.	D.o.C. by Manufacturer			**Equipment Ambient Temp.**		-20 °C to + 40 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	NA

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	NA	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PSV-024	: Safety Valve - Hyrogen to Vessels Inlet Header Vent System		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10004845	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-PSV-024	: Safety Valve - Hyrogen to Vessels Inlet Header Vent System		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10004845	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
	Authority:	NA	**Cert No:**	NA	**Type:**	


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-30	2025-02-03	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-30T10:24:50.174Z	PROVERLIS Digitaly signed by Luca Mussi 2025-02-03T12:45:47.842Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

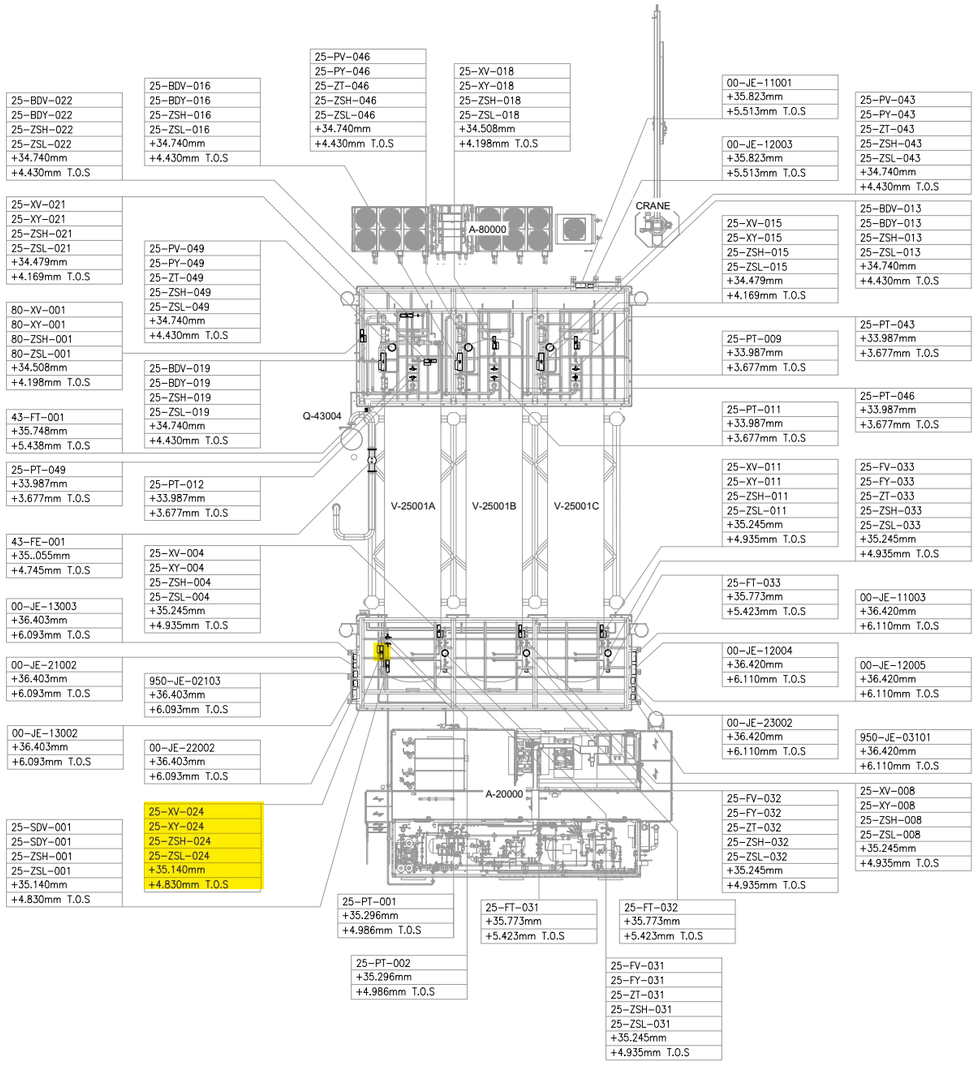

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

	DRAWING NO.	SHEET	REV.
A1	123A90–DDL–IN–DL–40081	002	02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. DRAWING_NO.

REV. REV

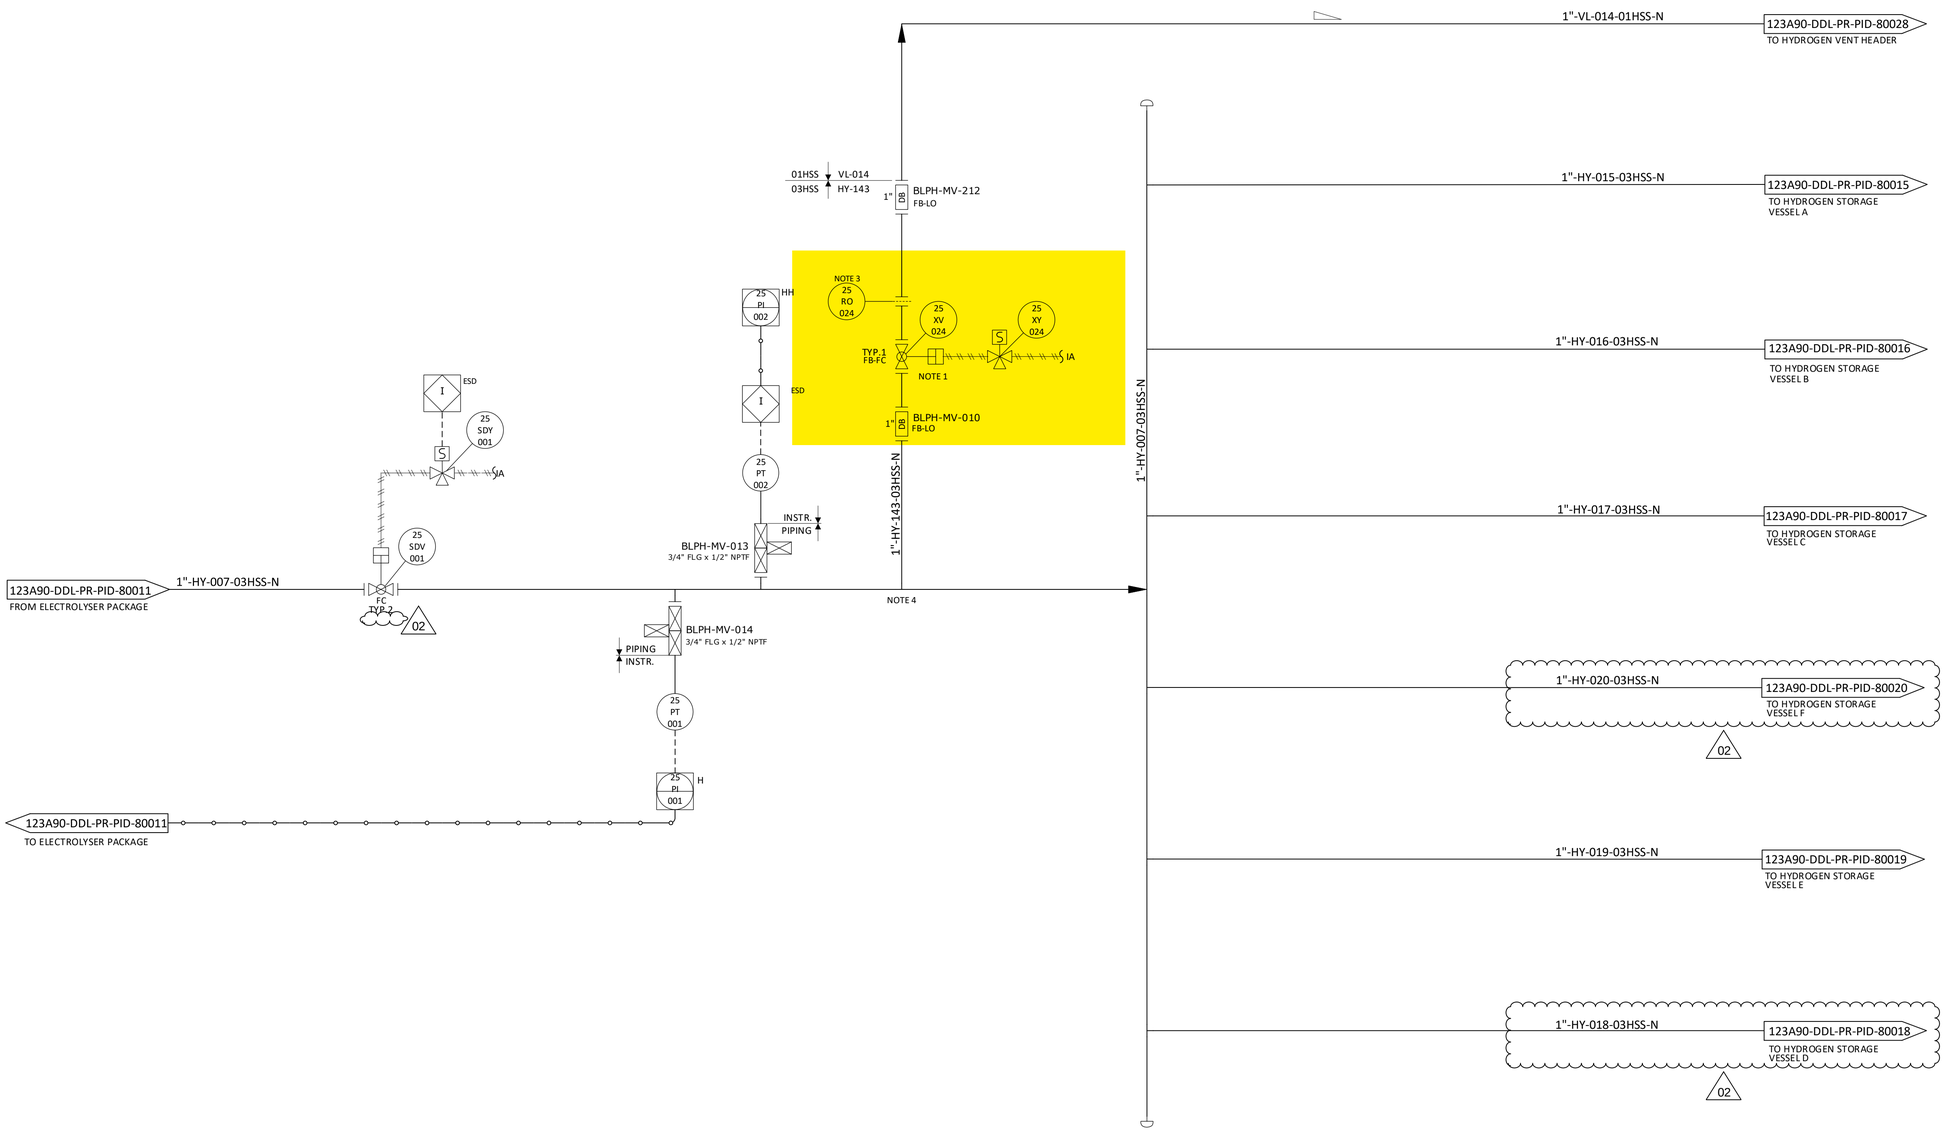

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :


BLPH PIPING AND INSTRUMENTATION DIAGRAM HYDROGEN STORAGE VESSELS HEADER (INLET)

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80013	SHEET 001	REV. 02

File Name : FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 15 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR XV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

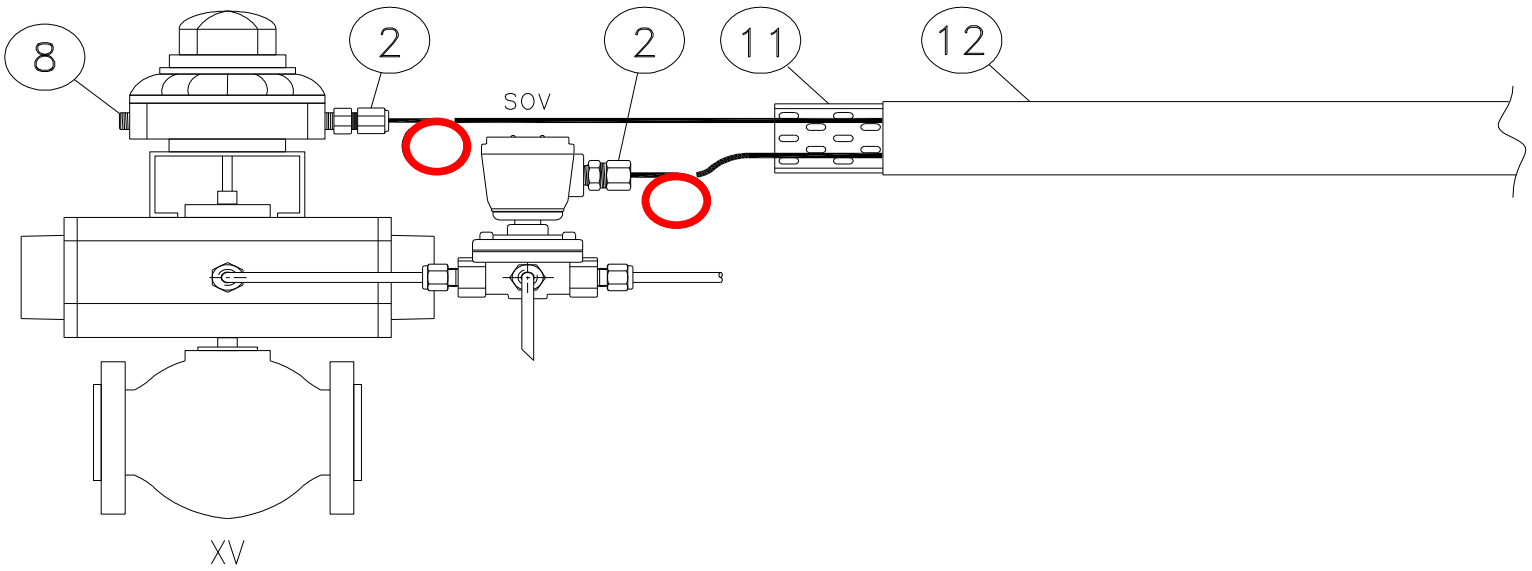

INSTRUMENT TAG	
1	25-XV-004
2	25-XV-006
3	25-XV-008
4	25-XV-009
5	25-XV-011
6	25-XV-012
7	25-XV-014
8	25-XV-015
9	25-XV-017
10	25-XV-018
11	25-XV-020
12	25-XV-021
13	25-XV-024
14	50-XV-001
15	50-XV-002
16	50-XV-003
17	50-XV-004
18	80-XV-001
19	50-XV-005
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**

REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi


ROSETTI MARINO SpA

POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
2		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M20	2


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

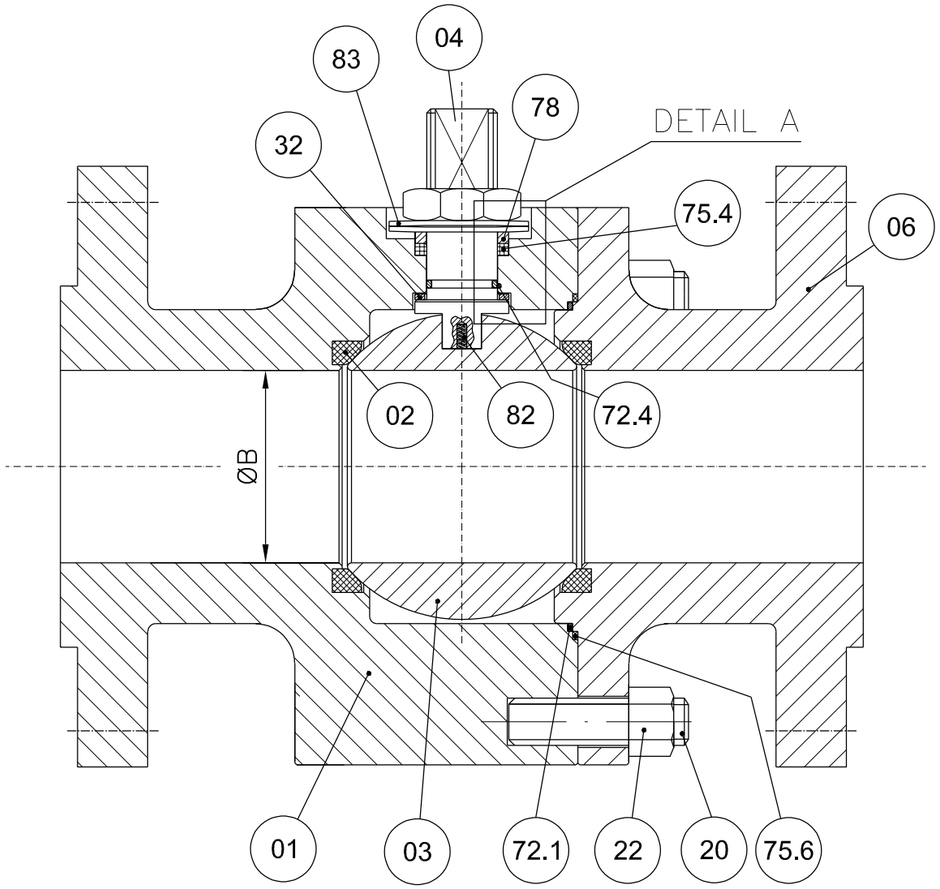


DETAIL A




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 7	34	2 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

2 Rev.

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: **GENERAL ASSEMBLY DRAWING**

VALVE TYPE: **SPLIT BODY FLOATING BALL VALVE**

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

GENERAL	1	Tag Number	Location			25-XV-024	25
	2	Service				HYDROGEN TO STORAGE TANKS DEPRESS.	
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80013	Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-143-03HSS-N	
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm	1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L	NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN	
	8	Fluid State	Phase			GAS	GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40	
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29	80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40	
	14						
	15						
	16	Speed of	Design			Close : (12)	Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum	Open : -
	18						
	19						
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)	
	21	Body Size	Body Form			1"	FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L	(*)
	23	Connections	Rating			FLANGED ASME B16.5	#300
	24	Flange Finish	Gasket Material			RF	Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)	(*)
	26	Bolting				A193 B8M / A194 Gr. 8M	
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO	
	29	Fire Safe				(2)	
ACTUATOR	30	Manufacturer	Type			Rotork	Spring Return
	31	Model No.	Size			CP/S	035-100A/BA
	32	Actuator Orientation	Actuator Form			Horizontal	Cylinder
	33	Ingress Protection	Certification			IP-66	II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE	CLOSE
	36	Fireproofing				NOT APPLICABLE	
	37	Solenoid Valve				25-XY-024 (9, 14, 15, 16) - Bifold FP06P	
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-024 (9, 17) - Soldo SS	25-ZSH-024 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED	
	40	Air Set	Handwheel			(*)	NOT REQUIRED
	41	Mounting Position				HORIZONTAL	
	42	Partial Stroke Test Facility				NOT REQUIRED	
	43	Control Type				-	
	44	Electrical Connection	Electrical Class			No. (*) / M20	H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-	
	47	Safety Valve	Model			-	-
	48	Check Valve	Mounting			-	-
PURCHASE	49	Manufacturer				FLUITEK	
	50	Model				FB3	
	51	Purchase Order Number				1724000204	

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description	Code :	Dwg. No.:	Rev.
03	06/12/24							
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)			
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)			

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

123A90-DDL-IN-DS-40030 Rev.03


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

140	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
141	IFR	25-XV-020	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
142	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
143	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620210001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
144	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
145	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
146	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323304	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
147	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
148	IFR	25-XV-021	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
149	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
150	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620220001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
151	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
152	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
153	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323297	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
154	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
155	IFR	25-XV-024	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
156	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
157	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620230001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
158	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
159	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
160	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323291	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
161	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
162	IFR	50-XV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
163	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
164	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620240001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
165	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402401	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
166	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
167	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323289	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
168	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
169	IFR	50-XV-002	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
170	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
171	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620250001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
172	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402501	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
173	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
174	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323290	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
175	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
176	IFR	50-XV-003	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
177	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
178	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 150#	2400620260001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
179	IFR		ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771402601	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
180	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
181	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323299	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
182	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
183	IFR	50-XV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
184	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
185	IFR		floating ball valve	N.A	FLUITEK	1" 150#	2400620270001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
186	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771402701	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-SV-038	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-040	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-043	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-SV-046	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-049	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SV-055A	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SV-055B	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-XV-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XV-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XV-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XV-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XV-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XV-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-XV-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XV-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XV-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XV-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XV-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XV-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-XY-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-XY-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-XY-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-XY-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-XY-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-XY-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-XY-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-XY-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-XY-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5
25-XY-020	Vessel V-25001F Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-XY-021	Vessel V-25001F Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-XY-024	Hyrogen to vessels inlet header vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-ZSH-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-ZSH-004	Vessel V-25001A Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-005	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-006	Vessel V-25001A Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-ZSH-007	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-008	Vessel V-25001B Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-009	Vessel V-25001B Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-ZSH-010	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-011	Vessel V-25001C Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-ZSH-012	Vessel V-25001C Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-ZSH-013	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-ZSH-014	Vessel V-25001D Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_4
25-ZSH-015	Vessel V-25001D Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_4
25-ZSH-016	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-ZSH-017	Vessel V-25001E Hydrogen inlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-ZSH-018	Vessel V-25001E Hydrogen outlet	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_2 HAZARDOUS-AREA_5

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

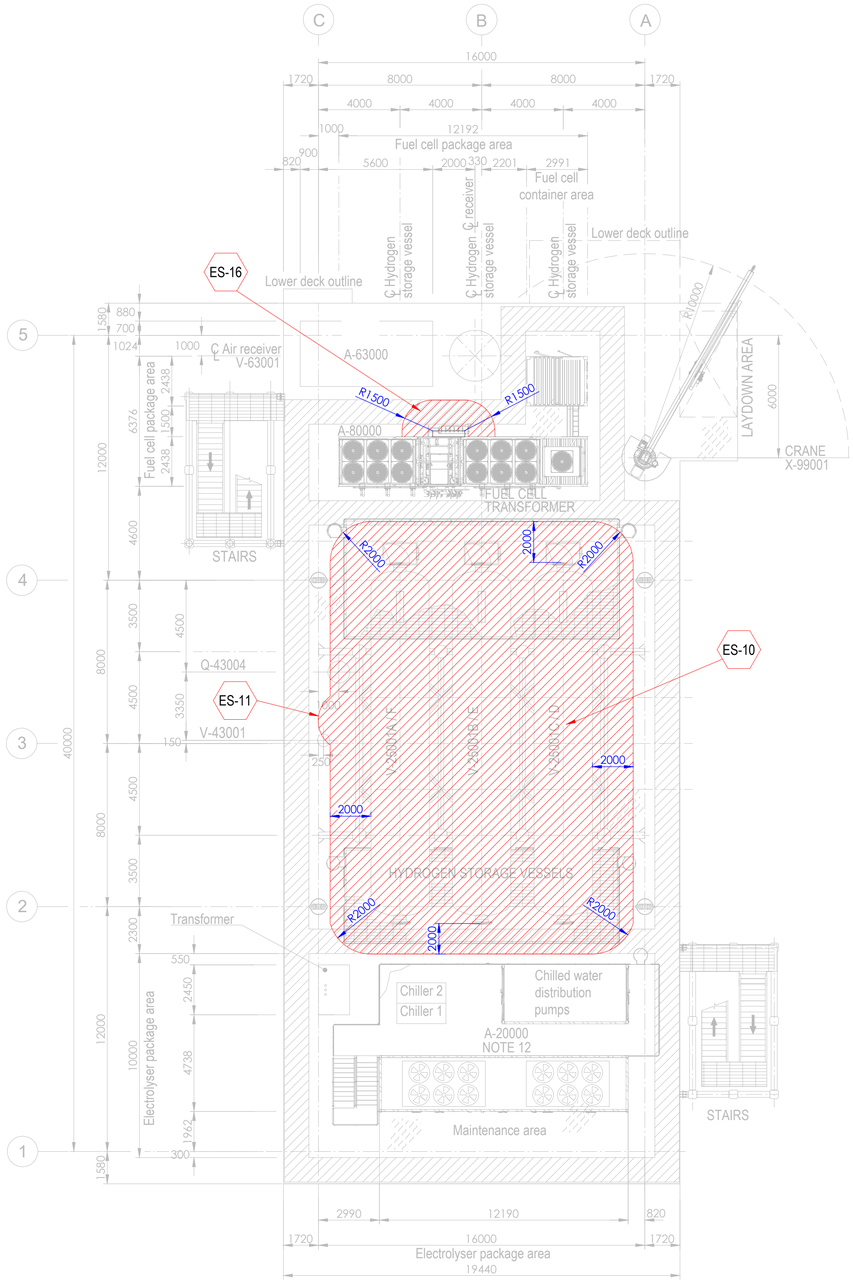


PLAN ON UPPER DECK
EL+30.310 T.O.S.

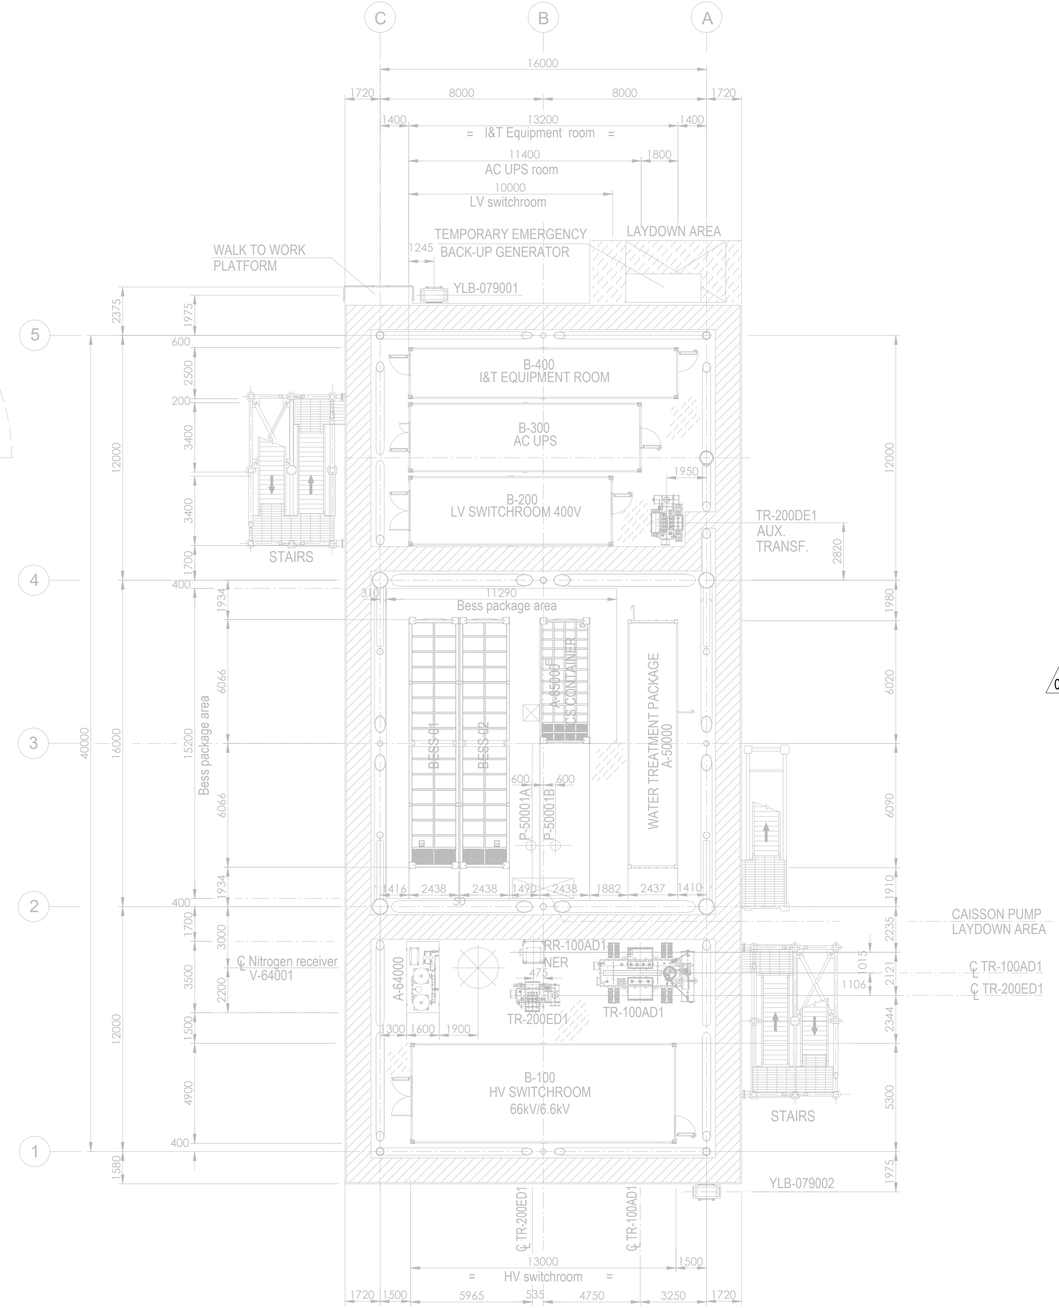

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

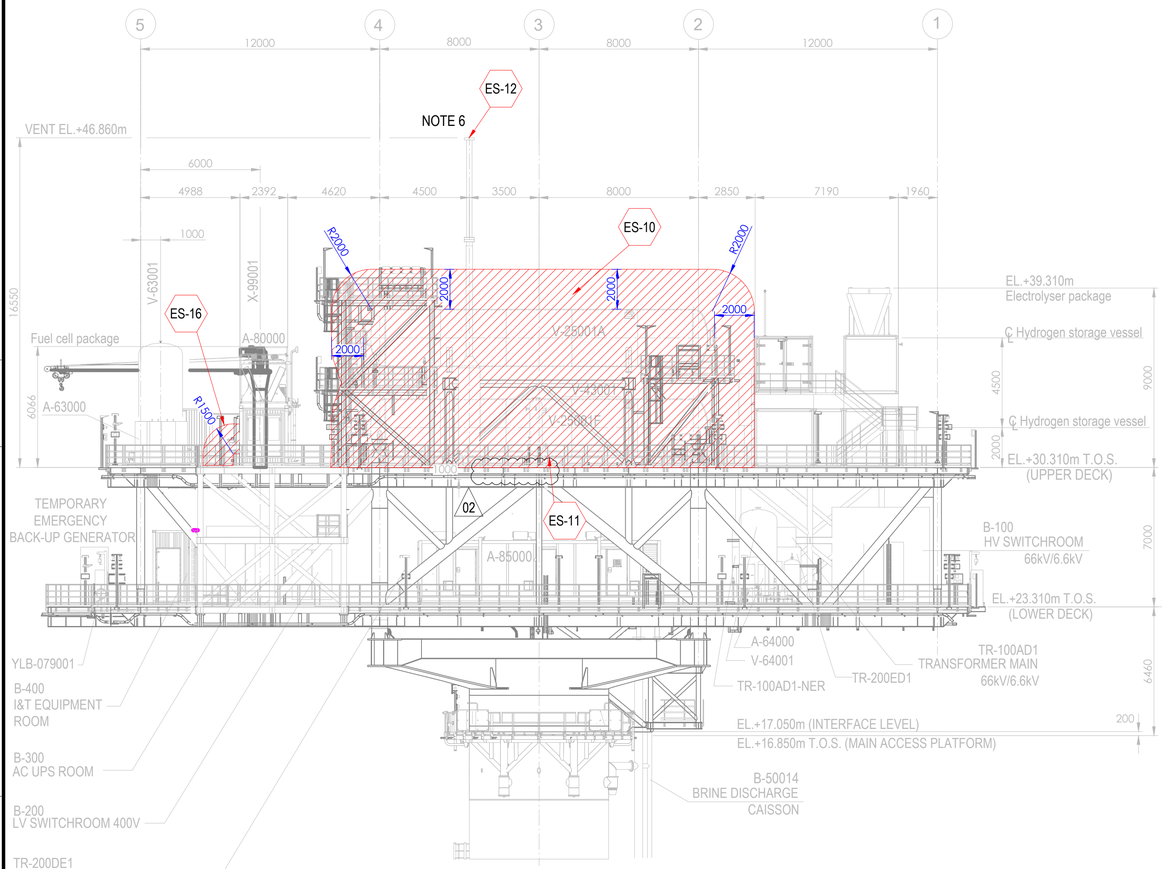



ELEVATION LOOKING EAST

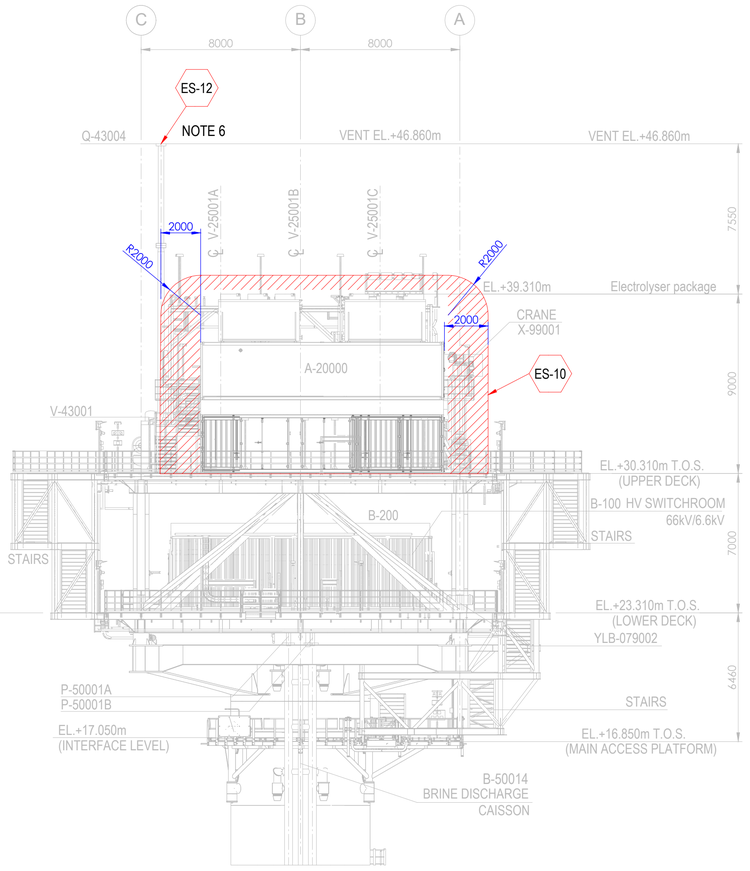

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

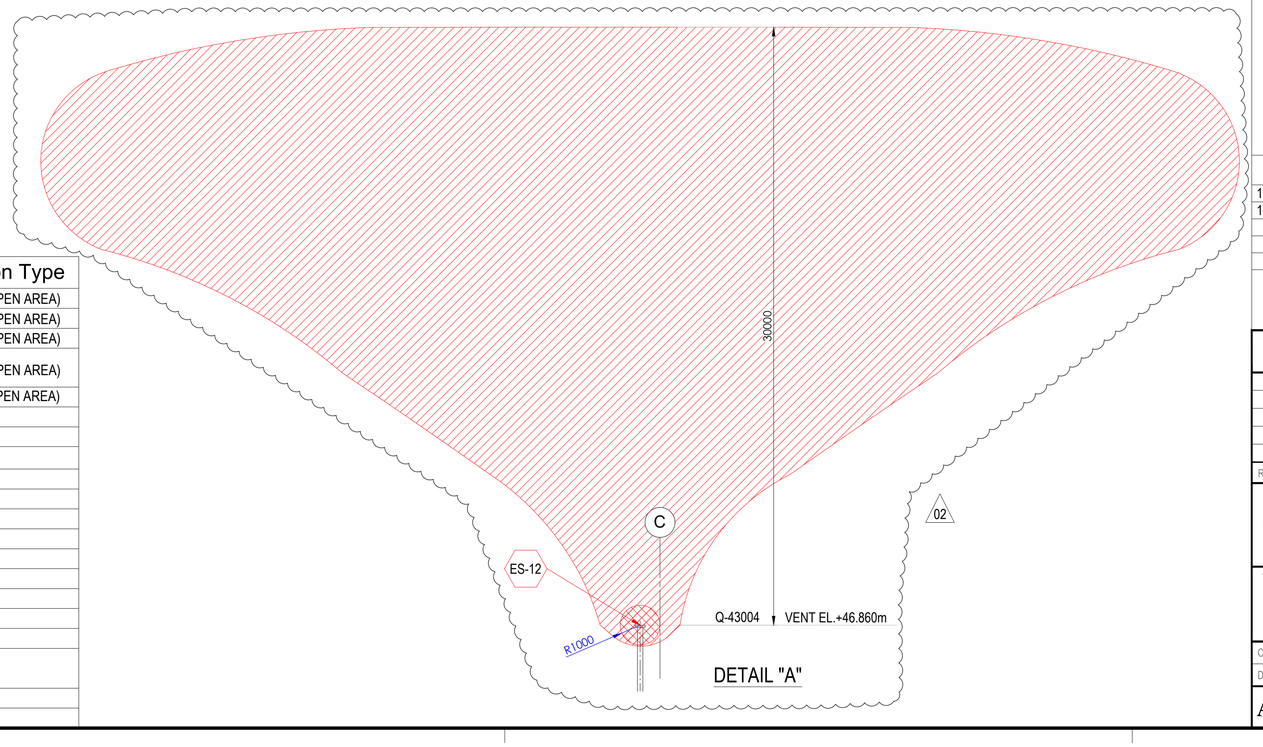



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

Rotork Fluid Systems s.r.l.
Via padre Jacques Hamel, 138 B
55016 Porcari, Lucca
Italy

Tel. +39 0583 2221
Fax. +39 0585 091362
http://www.rotork.com

rotork
Fluid Systems

DECLARATION

Rotork Fluid Systems s.r.l. herewith declares that for the job AF7703, as the supplier of the following equipment:

Product: Safety Relief Valve (PSV)
Type/Model: D10/S INOX
Serial Number(s): 025308828; 025308829; 025308830; 025308831; 025308832; 025308833; 025308834; 025308835; 025308836; 025308837; 025308838; 025308839; 025308840; 025308841; 025308842; 025308843; 025308844; 025308845; 025308846; 025308847; 025308848; 025308849; 025308850; 025308851; 025308852; 025308853; 025308854; 025308855.
Intended Use: Installation in ATEX Zone 2 – Gas Group IIC / IIB + H_2
Category: II 2G
Protection Type: Ex h IIC T6 Gb X (non-electrical equipment)

Hereby declares under its sole responsibility that the above equipment has been purchased in full compliance with the requirements of:

- Directive 2014/34/EU (ATEX)
- Harmonised standards: EN ISO 80079-36:2016 and EN ISO 80079-37:2016
- The relevant essential health and safety requirements as set out in Annex II of Directive 2014/34/EU.

This product is not yet in service and is currently installed but not operational. According to applicable legislation and guidance (including the Blue Guide 2022 and ATEX Guidelines 3rd Edition, July 2023), the CE and ATEX markings can be legitimately applied, even if the equipment has already been installed.
The conformity assessment procedure followed is: Internal production control (Annex VIII – Module A), with the technical documentation deposited with the Notified Body:
Notified Body: TUV SUD Italia – NB N° 0948
Reference: TUV IT 18 ATEX 032 AR
We hereby authorise the application of the ATEX marking in situ, under our responsibility, following the above.
This declaration is issued under the sole responsibility of the supplier.

Lucca, 18/04/2025

On behalf of Rotork Fluid Systems s.r.l.

Lucia Fregoli – Quality Manager

NUOVA GENERAL INSTRUMENTS s.r.l.
LOC. CAMPASSO - 29010 PIANELLO VALTIDONE (PC) Italy - Tel. +39 0523994629 - Fax +39 0523997219
http:// www.nuovageneral.it - E-mail: info@nuovageneral.it - P.IVA 01337040339 - C.F. 01317650065
REA-PC 117793 - Reg. Imp.PC 01317650065 - Capitale Sociale € 100.000,00 i.v.

N. 025308842

Tipo: (Typ.): **D10/S INOX**

Dis. : 009-0 Rev. 24/10/22

DICHIARAZIONE DI CONFORMITÁ UE Allegato IV, D. E. 2014/68/UE - Allegato VIII, D.E. 2014/34/UE
DECLARATION OF CONFORMITY EU Annex IV, E. D. 2014/68/EU - Annex VIII, E.D. 2014/34/EU
KONFORMITATSERKLARUNG EU Anlage IV Richtlinie 2014/68/EU - Anlage VIII Richtlinie 2014/34/EU
DECLARATION DE CONFORMITÉ UE Annexe IV D.E. 2014/68/UE - Annex VIII D.E. 2014/34/UE

VALVOLA DI SICUREZZA
SAFETY VALVE
SICHERHEITSVENTIL
SOUPAPE DE SURETE

PROGETTO , COSTRUZIONE E COLLAUDO CONFORME ALLA DIRETTIVA 2014/68/UE - 15/05/14 CATEGORIA IV Modulo H1
DESIG , MANUFACTURE AND TEST ACCORDING TO 2014/68/EU DIRECTIVE - 15/05/14 CLASS IV Module H1
PROJEKT , KONSTRUKTION UND ABNAHMEPRUFUNG GEMAB EG-RICHTLINIE 2014/68/EU - 15/05/14 KATEGORIE IV Formblatt H1
PROJET,FABRICATION ET VERIFICATION CONFORME A LA DIRECTIVE 2014/68/UE-15/05/14 CATEGORIE IV Module H1

Garanzia qualità totale Nr. : **Full quality assurance system Nr. :**
Garantie gesamte Qualität Nr. : **Garantie qualité totale Nr.:**
Module H1 : DGR-0036-QS-1180-24

Norme e spec. utilizzate : (Codes or spec.ref.) : *(Angewandte normen und spezifikationen) :* (Regulements et spec. utilise):
AD-Merkblatt A2 - VdTUV-Merkblatt Sicherheitsventil 100 / Racc."E"1979 / EN80079-36:2016 -37:2016 / ISO4126-1 / AS1271:2003 / EN13648-1 / UNI 10197

Organismo notificato: (Notified body): *(Meldestelle):* (Organisme agree):
TÜV SÜD Industrie Service GmbH
Westendstraße 199
D 80686 Munich
0036


II 2G Ex h IIC T6 Gb X
File : TÜV IT 18 ATEX 032 AR

Questa dichiarazione di conformità è rilasciata sotto la sola responsabilità del produttore. - *This declaration of conformity is issued under the sole responsability of the manufacturer.* - Diese Konformitätserklärung wird unter der alleinigen Verantwortung des Herstellers ausgestellt.
Cette déclaration de conformité est émise sous la seule responsabilité du fabricant.

Fluido - *Fluid* - **Fluide**
G / S / L
Group 1 or 2

- Marchio del costruttore: (Manifacturer's Mark): *(Herstellerzeichen):* **(Marquae du constructeur)**

- Materiali: (Material): *(Material):* **(Matériaux):**

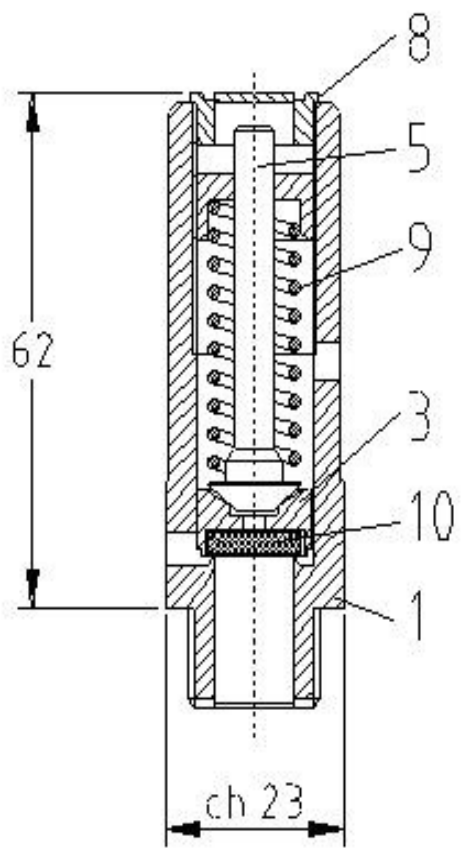

1- UNI EN 10088 1.4404
3- UNI EN 10088 1.4404
5- UNI EN 10088 1.4404
8- UNI EN 10088 1.4404
9- UNI EN 10270-3 1.4310

10 VITON (-20 / +200 °C)

Anno costruzione:
(Year of manufacture):
(Baujahr):
(Annee de fabrication):
2025

- P.N.: **60** *(Nenndruck):*
- h / do: **0,4**
- D.N.: (Nominal Diameter): *(Anschlusgewinde):* **(D.N):**
- Entrata: (In): *(Eintritt):* **1/2" NPT** **(Entre):**
- Uscita: (Out): *(Austritt):* **(Sortie):**
- Diametro orifizio: do (Opening diameter): do *(Innen durchmrsser): do* **(Diametre orifice):do** **10** mm
- Area: (Area): *(Offnung):* **(Surface):** **0,785** cm²
- Alzata: h (Valve Lift): h *(Hub): h* **(Haussement): h** **4** mm
- Limiti di temperatura di esercizio dei materiali utilizzati a pressione atmosferica: (Operating temperature limits for materials used at atmospheric pressure): *(Betriebstemperaturgrenze der unter Luftdruck verwendeten Materialien):* **(Limites de température de fonctionnement des matériaux utilisés sous pression atmosphérique):** **-20 / +200 °C**
- Coefficiente di efflusso : (Flow coefficient.): *(AusfluBziffer.):* **(Coefficient d'écoulement** **Kd 0,86**
- Coefficiente di efflusso ridotto : (Reduced flow coefficient): *(Reduzierte Ausflußziffer):* **(Coefficient d'écoulement réduit** **Kdr = 0,9xKd = 0,77**
- Pressione di taratura: (Setting Pressure): *(Abgleichungssdruck):* **(Pression de tarage):** **4,7** bar g
- Variabilità campo di taratura: (Variability Setting Filed): *(Abgleichungsberelch):* **(Variabilite champ de tarage):** **3,1 - 5** bar g
- Sovrappressione: (Overpressure): *(Uber-Unterdruck):* **(Surpression):** **10%** % della pressione di taratura (% of Setting Pressure) *(% Abgieichungsdruck)* **(% De la pression de tarage)**
- Scarto di chiusura: (Closing variation): *(Unterdruck):* **(Ecart de fermature):** **15%** % della pressione di taratura (% of Setting Pressure) *(% Abgieichungsdruck)* **(% De la pression de tarage)**

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide): **ARIA-AIR-LUFT** Temper. : **0** °C
- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** **328,02** kg/h **253,73** Nm³ / h **4228,82** lt/min.

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide):
- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** kg/h Nm³ / h lt/min.

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide):
- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** kg/h Nm³ / h lt/min.

Si dichiara che la valvola ha subito con buon esito il controllo finale compreso il test di tenuta (90% Pset) e la prova idraulica del corpo a 1,5 x P.N.
We declare that this valve has passed successfully the test, the seat tightness test (90% Pset) and the hydraulic test of the body to 1,5 x P.N.
Hiermit bestätigen wir, dass das Ventil die Abschlusskontrolle einschließlich der Sitzdichtheit (90%Pset) und hydraulischen Gehäuseprüfung mit einem Druck von 1,5 x P.N.
On declare que la soupape a ete soumise avec resultat satisfiant a le control final y-compri l'epreuve d'étanchéité (90% Pset) et l'epreuve hydraulique du corps a 1,5xPN.

EN 10204 3.1 Cod. : **00F16D10SSVNPAX047**

Nr.Ord. : D2500700 REV 1

S.V. Code : 00F16D10SSVNPAX047

Date : 17/04/2025

NUOVA GENERAL INSTRUMENTS SRL
Albertini Patrizia (CEO)

NUOVA GENERAL INSTRUMENTS

	I Descrizione ATEX-UKEX	GB Atex-UKEX Description	D *Beschreibung ATEX-UKEX*	F Description ATEX-UKEX	ES Descripción ATEX-UKEX
	Simbolo rappresentativo per dispositivi certificati ATEX-UKEX	Representative symbol of ATEX-UKEX certified equipment	*Repräsentatives Symbol für ATEX-UKEX zertifizierte Geräte*	Symbole représentatif des équipements certifiés ATEX-UKEX	*Símbolo representativo para dispositivos con certificación ATEX-UKEX*
II	Gruppo dell'apparecchio	Equipment's group	*Gerätegruppe*	Groupe d'appareils	*Grupo de dispositivos*
2	Categoria dell'apparecchio	Equipment's category	*Gerätekategorie*	Catégorie d'appareils	*Categoría de dispositivos*
G	Protezione delle atmosfere esplosive dovute a presenza di GAS, VAPORI E NEBBIE	Protected to explosive atmosphere due to GAS, STEAM and FOG	*Schutz explosionsfähiger Atmosphären durch GAS, DAMPF UND NEBEL*	Protection des atmosphères explosives grâce à la présence de GAZ, VAPEURS ET BROUILLARDS	*Protección de atmósferas explosivas debido a la presencia de GAS, VAPOR Y NIEBLA*
GD	Protezione delle atmosfere esplosive dovute a presenza di GAS, VAPORI, NEBBIE, NUBI e POLVERI	Protected to explosive atmosphere due to GAS, STEAM, FOG and DUST	*Schutz explosionsfähiger Atmosphären durch GAS, DAMPF, NEBEL, WOLKEN und PULVER*	Protection des atmosphères explosives grâce à la présence de GAZ, VAPEURS, BROUILLARDS, NUAGES et POUSSIÈRES	*Protección de atmósferas explosivas debido a la presencia de GAS, VAPORES, NIEBLA, NUBES y POLVO*
Ex h (Type of protection "c" constructional safety)	Indicazione di apparecchiatura non elettrica	Non-electrical equipment indication	*Hinweis auf nichtelektrische Geräte*	Indication des équipements non électriques	*Indicación de equipos no eléctricos*
IIC	Sottodivisione del gruppo di apparecchi	Equipment group subdivision	*Unterteilung der Gerätegruppe*	Subdivision du groupe d'appareils	*Subdivisión del grupo de dispositivos*
T6	Temperatura massima di parete ≤85°C	Maximum surface temperature ≤85°C	*Maximale Oberflächentemperatur ≤85 ° C*	Température maximale de paroi ≤85 ° C	*Temperatura máxima de la pared ≤85 ° C*
Gb	Equipment Protection Level (EPL)	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*
GbDb	Equipment Protection Level (EPL)	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*
X	La massima temperatura superficiale potrebbe essere superiore alla classe di temperatura, si raccomanda come massima temperatura il valore maggiore tra T6 e la max Temperatura ammissibile per la tenuta (V. COC)	The max surface temperature could be higher than the temperature class, it is recommended as max temperature the higher value between T6 and the max Admissible temperature for the seal (V. COC)	*Die max. Oberflächentemperatur kann höher sein als die Temperaturklasse, als max. Temperatur wird der höhere Wert zwischen T6 und der max. zulässigen Temperatur für die Dichtung (V. COC) empfohlen.*	La température de surface maximale peut être supérieure à la classe de température, il est recommandé comme température maximale la valeur la plus élevée entre T6 et la température maximale admissible pour le joint (V. COC)	*La temperatura máxima de la superficie podría ser superior a la clase de temperatura, se recomienda como temperatura máxima el valor más alto entre T6 y la temperatura máxima admisible para el sello (V. COC)*

ITEM	Tag	25-PG-001	: Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Shut-Down			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004846		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		PW00DE2JS3P			
Manufacturer	Wika			**Model**		233.50.63			
Cert No.	D.o.C. by Manufacturer reference 11564220			**Equipment Ambient Temp.**		-20 °C to +60 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP65

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PG-001	: Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Shut-Down			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004846		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ITEM	Tag	25-PG-001	: Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Shut-Down		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10004846	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA

Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	VENDOR ROTORK (PER FLUITEK)	RM(ROSETTI MARINO)	
Name	Stefano Linari	Giovanni Tangianu	
Date	2025-04-24	2025-04-24	
Signature	Digitaly signed by Stefano Linari 2025-04-24T13:23:25.272Z	Digitaly signed by Giovanni Tangianu 2025-04-24T15:01:49.458Z	

ROTORK CONTROLS ITALIA srl
Via Portico 17
24050 Orio Al Serio (BG)

Telefono: 0039 (0)5832221

E-mail: rotork.italia@rotork.com



WIKA Product Pass

Italiano

serial number

WIKA

25-sdv-001

Type 23X.50

Manometro a molla tubolare 232.50/233.50
Cassa in acciaio inox

Serial number:

PW00DE2JS3P

Item number:

57424821

Manufacturing date:

04/2025



ITEM	Tag	25-PG-001	: Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Shut-Down			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004846		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**		8975GNEW			
Manufacturer	Wika			**Model**		233.50.63			
Cert No.	D.o.C. by Manufacturer, reference 11564220			**Equipment Ambient Temp.**		-20 °C to +60 °C			
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	IP65

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state “NA”. Comments are required for ‘Failure’ column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	OK	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	OK	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	OK	
15	Electrical connections are tight	x	OK	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex “e” – Ex “n” – Ex “t”)	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	OK	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PG-001	: Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Shut-Down			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004846		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO PROVERLIS CROSSWIND

ITEM	Tag	25-PG-001	: Air Set Pressure Gauge Filter - Hyrogen to Vessels Inlet Header Shut-Down			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004846		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	ATEX	Form	CJX01 Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-30	2025-02-01	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-30T10:25:00.988Z	PROVERLIS Digitaly signed by Luca Mussi 2025-02-01T13:02:42.088Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

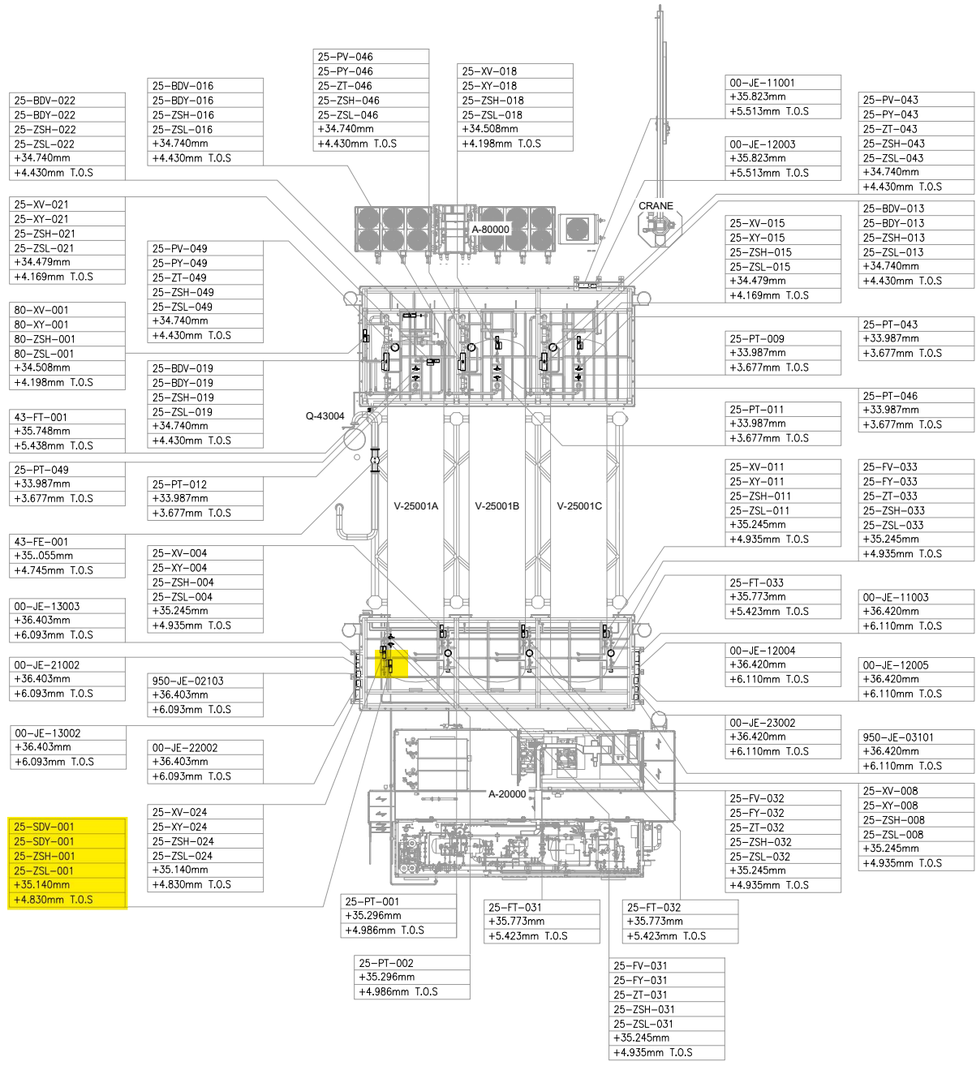

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm

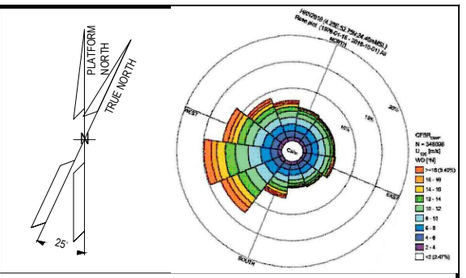

NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90–DDL–IN–DL–40081	002	02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING_NO.

REV.

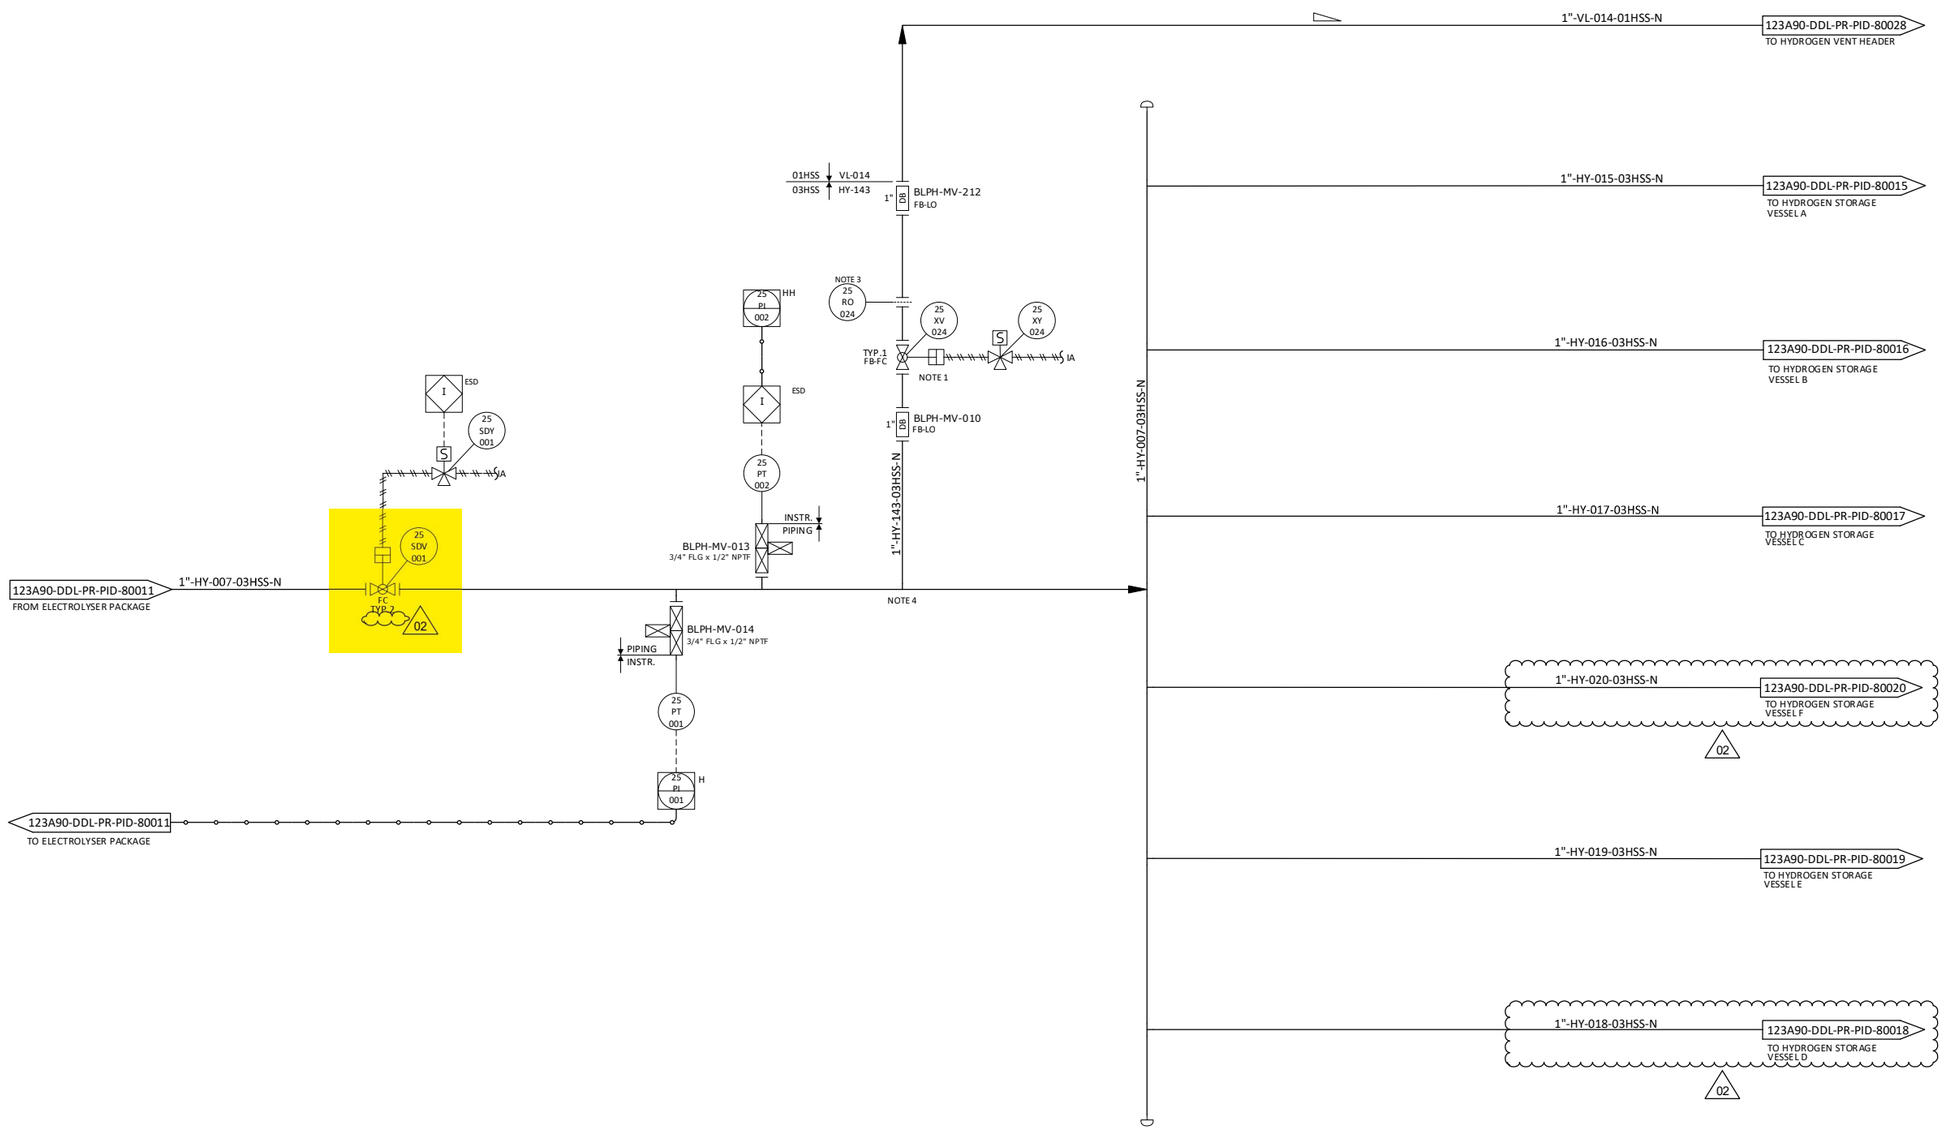

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSELS HEADER (INLET)


CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO.	SHEET	REV.
	123A90-DDL-PR-PID-80013	001	02

File Name : FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 16 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR SDV/BDV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

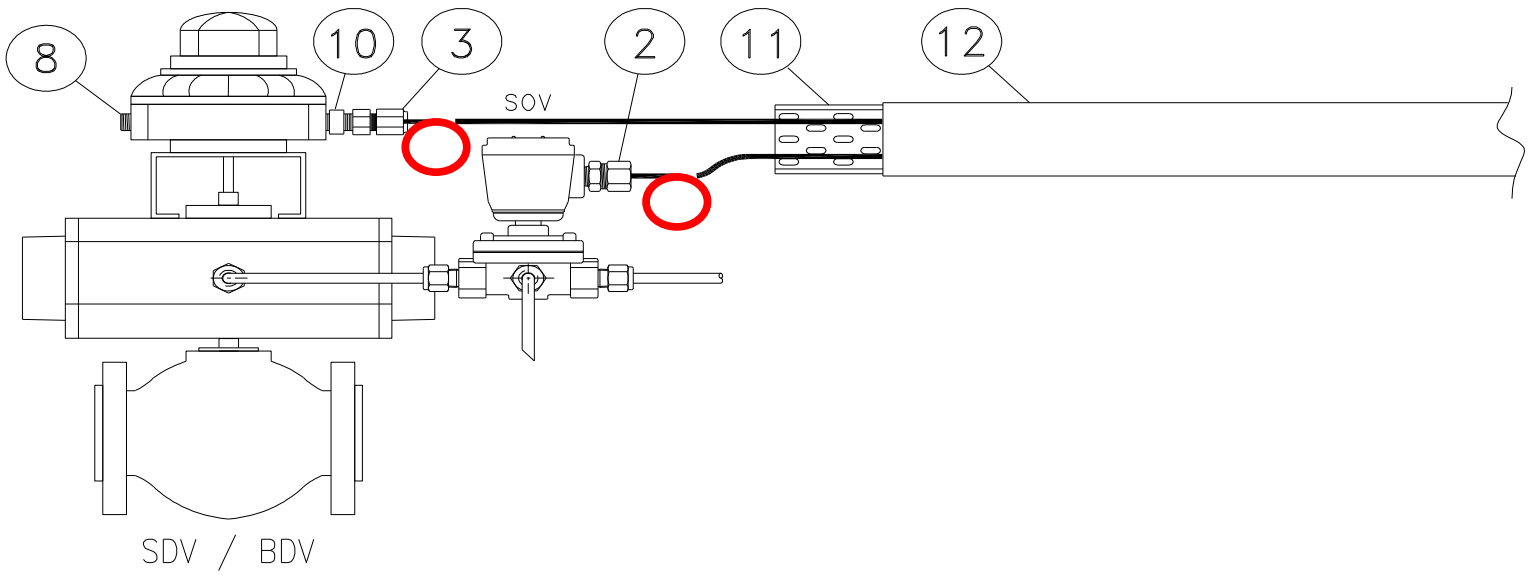

SDV / BDV

INSTRUMENT TAG	
1	25-BDV-005
2	25-BDV-007
3	25-BDV-010
4	25-BDV-013
5	25-BDV-016
6	25-BDV-019
7	25-BDV-022
8	25-SDV-001
9	25-SDV-023
10	64-SDV-001
11	
12	
13	
14	
15	
16	
17	
18	
19	
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
10		Nickel Plated Brass Adaptor Ex-d/e IIC (or IIB + H2) T1	M20 Male x M25 Female	1
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
3		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M25	1
2		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

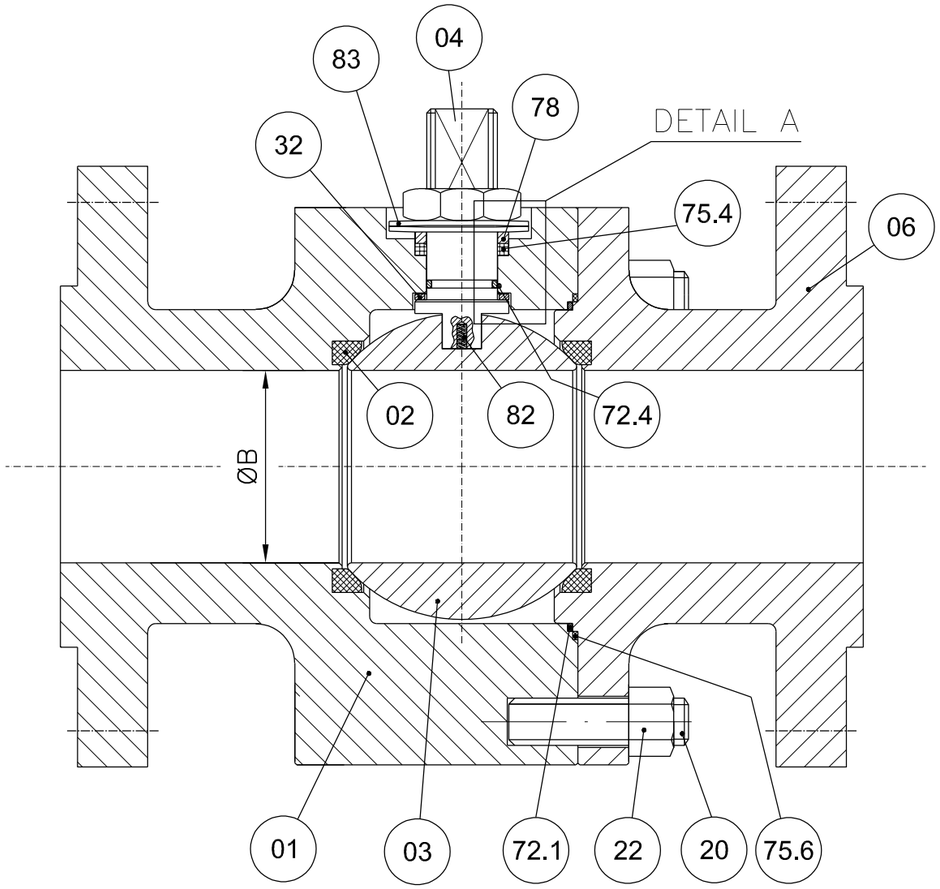




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

GENERAL	1	Tag Number	Location			25-SDV-001		25
	2	Service				HYDROGEN TO STORAGE TANKS		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80013		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-007-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close : (12)		Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum		Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/AA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-SDY-001 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-001 (9, 17) - Soldo SS		25-ZSH-001 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR	25-SDV-023	ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE

Bourdon tube pressure gauge, stainless steel
For the process industry, standard version
Models 232.50, 233.50, NS 63 [2 ½"], 100 [4"] and 160 [6"]

For further approvals, see page 6

Applications

- For gaseous and liquid aggressive media that are not highly viscous or crystallising, also in aggressive environments
- Chemical and petrochemical industries, oil and gas industry, power engineering and also water and wastewater technology
- Machine building and general plant construction

Special features

- Excellent load cycle stability and shock resistance
- With case filling (model 233.50) for applications with high dynamic pressure loads and vibrations
- Completely from stainless steel
- Scale ranges from 0 … 0.6 to 0 … 1,600 bar or 0 ... 10 to 0 ... 20,000 psi
- QR code on dial links to instrument-specific information



Bourdon tube pressure gauge, model 232.50, NS 100 [4"]

Description

This high-quality Bourdon tube pressure gauge has been designed especially for the process industry.

The use of high-quality stainless steel materials and the robust design are geared to applications in the chemical and process engineering industries. Thus the instrument is suitable for liquid and gaseous media, also in aggressive environments.

Scale ranges of 0 … 0.6 to 0 … 1,600 bar [0 ... 10 to 0 ... 20,000 psi] ensure the measuring ranges required for a wide variety of applications.

WIKA manufactures and qualifies the pressure gauge in accordance with the standards EN 837-1 and ASME B40.100. As a safety function, this instrument has a blow-out device with blow-out plug on the back of the case. In the event of a failure, overpressure can escape there.

The model 233.50 with liquid-filled case is suitable for high dynamic pressure loads and vibrations.

The QR code on the dial allows instrument-specific information such as the serial number, the order number, certificates and other product data to be retrieved from the internet easily and in the long term.

Smart in sensing

Data sheets showing similar products:
Stainless steel, safety version; see data sheet PM 02.04
Bourdon tube pressure gauge with switch contacts; see data sheet PV 22.02
Monel version; see data sheet PM 02.33
Pressure gauge per EN 837-1 with mounted diaphragm seal; see data sheet DS 95.12

Specifications

Basic information	
Standard	■ EN 837-1 ■ ASME B40.100
	For information on the “Selection, installation, handling and operation of pressure gauges”, see technical information IN 00.05.
Further version	■ Oil- and grease-free for oxygen ■ Per NACE [1] MR0175 / ISO 15156, use in H_2S-containing environments in oil and gas production ■ With pre-volume deflagration flame arrester [2] for mounting to zone 0 (EPL Ga); model 910.21; see data sheet AC 91.02 ■ Monel version; models 262 and 263; see data sheet PM 02.33
Nominal size (NS)	■ Ø 63 mm [2 ½"] ■ Ø 100 mm [4"] ■ Ø 160 mm [6"]
Connection location	■ Lower mount (radial) ■ Lower back mount ■ Centre back mount (only for NS 63 [2 ½"])
Window	Laminated safety glass (NS 63 [2 ½"]: Polycarbonate)
Case	
Design	Safety level “S1” per EN 837-1 With blow-out device at case circumference, 12 o'clock (NS 63 [2 ½"]) and on the back of the case (NS 100 [4"] and 160 [6"]) Scale ranges ≤ 0 ... 16 bar [≤ 0 ... 300 psi] with compensating valve to vent and reseal case
Material	■ Stainless steel 1.4301 (304) ■ Stainless steel 1.4571 (316Ti)
Ring	Bayonet ring, stainless steel
Mounting	■ Without ■ Panel mounting flange, stainless steel ■ Panel mounting flange, polished stainless steel ■ Triangular profile ring with mounting bracket, polished stainless steel ■ Surface mounting flange, stainless steel
Case filling (model 233.50)	■ Without ■ Glycerine ■ Glycerine-water mixture for NS 100 [4"] and 160 [6"] with scale range ≤ 0 ... 2.5 bar [≤ 0 ... 40 psi] or for NS 63 [2 ½"] with scale range ≤ 0 ... 4 bar [≤ 0 ... 60 psi] ■ Silicone oil
Movement	■ Stainless steel ■ Stainless steel 1.4404 (316L) ■ everlast® version

1) General information about NACE standards; see data sheet IN 00.21
2) Only for instruments with Ex approval

Measuring element	
Type of measuring element	Bourdon tube, C-type or helical type
Material	Stainless steel 1.4404 (316L)
Leak tightness	■ Helium tested, leakage rate: $< 5 \cdot 10^{-3}$ mbar l/s ■ Helium tested, leakage rate: $< 1 \cdot 10^{-6}$ mbar l/s

Accuracy specifications		
Accuracy class		
NS 63 [2 ½"]	■ EN 837-1	Class 1.6
	■ ASME B40.100	±2 % | ±1 % | ±2 % of measuring span (grade A)
NS 100 [4"], 160 [6"]	■ EN 837-1	Class 1.0
	■ ASME B40.100	±1 % of measuring span (grade 1A)
Temperature error	On deviation from the reference conditions at the measuring system: ≤ ±0.4 % per 10 °C [≤ ±0.4 % per 18 °F] of full scale value	
Reference conditions		
Ambient temperature	+20 °C [+68 °F]	

Scale ranges

bar	
0 ... 0.6 [1]	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160
0 ... 4	0 ... 250
0 ... 6	0 ... 400
0 ... 10	0 ... 600
0 ... 16	0 ... 1,000
0 ... 25	0 ... 1,600

kg/cm²	
0 ... 0.6 [1]	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160
0 ... 4	0 ... 250
0 ... 6	0 ... 400
0 ... 10	0 ... 600
0 ... 16	0 ... 1,000
0 ... 25	0 ... 1,600

kPa	
0 ... 60 [1]	0 ... 4,000
0 ... 100	0 ... 6,000
0 ... 160	0 ... 10,000
0 ... 250	0 ... 16,000
0 ... 400	0 ... 25,000
0 ... 600	0 ... 40,000
0 ... 1,000	0 ... 60,000
0 ... 1,600	0 ... 100,000
0 ... 2,500	0 ... 160,000

MPa	
0 ... 0.06 [1]	0 ... 4
0 ... 0.1	0 ... 6
0 ... 0.16	0 ... 10
0 ... 0.25	0 ... 16
0 ... 0.4	0 ... 25
0 ... 0.6	0 ... 40
0 ... 1	0 ... 60
0 ... 1.6	0 ... 100
0 ... 2.5	0 ... 160

psi	
0 ... 10 [1]	0 ... 1,000
0 ... 15	0 ... 1,500
0 ... 30	0 ... 2,000
0 ... 60	0 ... 3,000
0 ... 100	0 ... 4,000
0 ... 160	0 ... 5,000
0 ... 200	0 ... 6,000
0 ... 300	0 ... 7,500
0 ... 400	0 ... 10,000
0 ... 600	0 ... 15,000
0 ... 800	0 ... 20,000

1) Not available for NS 63 [2 ½"]

Vacuum and +/- scale ranges

bar	
-0.6 ... 0 [1]	-1 ... +5
-1 ... 0	-1 ... +9
-1 ... +0.6	-1 ... +15
-1 ... +1.5	-1 ... +24
-1 ... +3	

MPa	
-0.06 ... 0 [1]	-0.1 ... +0.5
-0.1 ... 0	-0.1 ... +0.9
-0.1 ... +0.06	-0.1 ... +1.5
-0.1 ... +0.15	-0.1 ... +2.4
-0.1 ... +0.3	

kPa	
-60 ... 0 [1]	-100 ... +500
-100 ... 0	-100 ... +900
-100 ... +60	-100 ... +1,500
-100 ... +150	-100 ... +2,400
-100 ... +300	

psi	
-30 inHg ... 0	-30 inHg ... +100
-30 inHg ... +15	-30 inHg ... +160
-30 inHg ... +30	-30 inHg ... +200
-30 inHg ... +60	-30 inHg ... +300

1) Not available for NS 63 [2 ½"]

Further details on: scale ranges	
Special scale ranges	Other scale ranges on request
Unit	■ bar ■ psi ■ kg/cm² ■ kPa ■ MPa
Increased overload safety	■ Without ■ 2 times ■ 3 times ■ 4 times ■ 5 times
	The possibility of selection depends on scale range and nominal size
Vacuum resistance	■ Without ■ Vacuum-resistant to -1 bar
Dial	
Scale colour	Black
Material	Aluminium
Special scale	■ Without ■ With temperature scale for refrigerant, e.g. for NH_3: R 717
	Other scales or customer-specific dials, e.g. with red mark, circular arcs or circular sectors, on request
Pointer	
Instrument pointer	Aluminium, black
Mark pointer/drag pointer	■ Without ■ Red mark pointer on dial, fixed ■ Red mark pointer on window, adjustable ■ Mark pointer on bayonet ring, adjustable ■ Red drag pointer on window, adjustable
Pointer stop pin	■ Without ■ At zero point (only for NS 63 [2 ½"]) ■ At 6 o'clock (only for NS 100 [4"], 160 [6"])

Process connection		
Standard	■ EN 837-1 ■ ISO 7 ■ ANSI/B1.20.1	
Size		
EN 837-1	■ G ⅛ B, male thread ■ G ¼ B, male thread ■ G ½ B, male thread ■ M12 x 1.5, male thread ■ M20 x 1.5, male thread	
ISO 7	■ R ¼, male thread ■ R ½, male thread	
ANSI/B1.20.1	■ ¼ NPT, male thread ■ ½ NPT, male thread	
Restrictor	■ Without ■ Ø 0.6 mm [0.024"], stainless steel ■ Ø 0.3 mm [0.012"], stainless steel	
Material (wetted)		
Process connection	Stainless steel 1.4404 (316L)	
Bourdon tube	Stainless steel 1.4404 (316L)	

→ Other process connections on request

Operating conditions		
Medium temperature		
Unfilled instruments	-40 ... +200 °C [-40 ... +392 °F]	
Instruments with glycerine filling	-20 ... +100 °C [-4 ... +212 °F]	
Instruments with silicone oil filling	-40 ... +100 °C [-40 ... +212 °F]	
Ambient temperature		
Unfilled instruments or with silicone oil filling	-40 ... +60 °C [-40 ... +140 °F]	
Instruments with glycerine filling	-20 ... +60 °C [-4 ... +140 °F]	
Pressure limitation		
NS 63 [2 ½"]	Steady	3/4 x full scale value
	Fluctuating	2/3 x full scale value
	Short time	Full scale value
NS 100 [4"], 160 [6"]	Steady	Full scale value
	Fluctuating	0.9 x full scale value
	Short time	1.3 x full scale value
Ingress protection per IEC/EN 60529	■ IP65 ■ IP66 (only selectable for scale ranges ≥ 0 ... 20 bar [0 ... 400 psi])	

Approvals

Logo	Description	Region
CE	**EU declaration of conformity** Pressure equipment directive PS > 200 bar, module A, pressure accessory	European Union
UKCA	**UKCA** Pressure equipment (safety) regulations	United Kingdom
-	**CRN** Safety (e.g. electr. safety, overpressure, ...) For full scale value ≤ 1,000 bar	Canada

Optional approvals

Logo	Description	Region
CE Ex	**EU declaration of conformity** ATEX directive Hazardous areas - Ex h Gas II 2G Ex h IIC T6 ... T1 Gb X Dust II 2D Ex h IIIC T85°C ... T450°C Db X	European Union
UKCA	**UKCA** Equipment and protective systems intended for use in potentially explosive atmospheres regulations	United Kingdom
EAC Ex	**EAC** Hazardous areas	Eurasian Economic Community
	Ex Ukraine Hazardous areas	Ukraine
	PAC Kazakhstan Metrology, measurement technology	Kazakhstan
-	**MChS** Permission for commissioning	Kazakhstan
-	**PAC Ukraine** Metrology, measurement technology	Ukraine
	PAC Uzbekistan Metrology, measurement technology	Uzbekistan
-	**PAC China** Metrology, measurement technology	China
	DNV Ships, shipbuilding (e.g. offshore)	International
-	**KBA** [1] Automotive	International
	Hydrogen-powered motor vehicles - (EC) no. 79/2009 and (EU) no. 406/2010	
	Components for motor vehicles using natural gas (CNG/LNG) – UN no. R 110	

1) Not available for all versions

Manufacturer's declaration

Logo	Description
-	Pressure equipment directive (PED) for maximum allowable pressure PS ≤ 200 bar
-	Suitability of wetted materials for drinking water in accordance with the European 4MS initiative
-	Suitability of wetted materials for hydrogen


Certificates (option)

Certificates	
Certificates	■ 2.2 test report per EN 10204 (e.g. state-of-the-art manufacturing, indication accuracy) ■ 3.1 inspection certificate per EN 10204 (e.g. material proof for wetted metal parts, indication accuracy) ■ PCA calibration certificate, traceable and accredited in accordance with ISO/IEC 17025 ■ Calibration certificate by a national accreditation body, traceable and accredited in accordance with ISO/IEC 17025 on request
Recommended calibration interval	1 year (dependent on conditions of use)

→ For approvals and certificates, see website

Dimensions in mm [in]

Lower mount (radial)

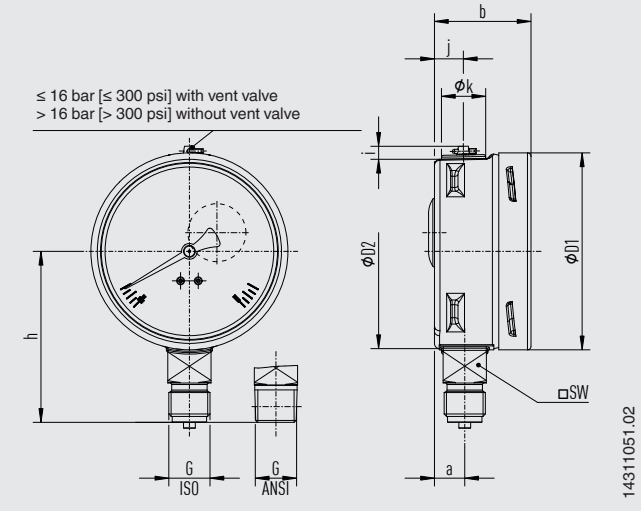

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]
100 [4"]	approx. 0.6 kg [1.32 lbs]	approx. 0.9 kg [1.98 lbs]
160 [6"]	approx. 1.1 kg [2.43 lbs]	approx. 2.0 kg [4.41 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	G ¼ B	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	51 [2.01]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	G ¼ B	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	87 [3.43]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	87 [3.43]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	G ¼ B	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	118 [4.65]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	118 [4.65]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ISO 7


NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	R ¼	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	R ¼	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	86 [3.39]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	R ¼	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	117 [4.60]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]								
		h ±1	a	b	D1	D2	i	j	k	SW
63 [2 ½"]	¼ NPT	54 [2.13]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	51 [2.01]	9.5 [0.37]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	¼ NPT	80 [3.15]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	86 [3.39]	15.5 [0.61]	49.5 [1.95]	101 [3.98]	99 [3.90]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	¼ NPT	111 [4.37]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	117 [4.60]	15.5 [0.61]	51.5 [2.03] 1)	161 [6.34]	159 [6.26]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

1) Plus 16 mm [0.630 in] with scale range 0 ... 1,600 bar [0 ... 20,000 psi]

Lower back mount

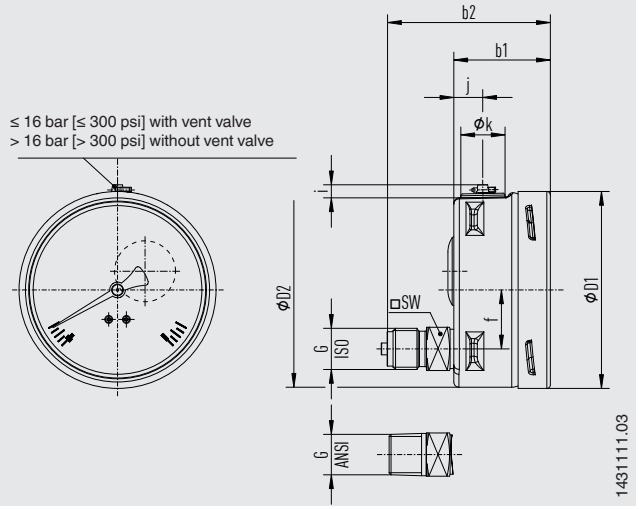

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]
100 [4"]	approx. 0.6 kg [1.32 lbs]	approx. 0.9 kg [1.98 lbs]
160 [6"]	approx. 1.1 kg [2.43 lbs]	approx. 2.0 kg [4.41 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	G ¼ B	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	33 [1.30]	54 [2.13]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	G ¼ B	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	49.5 [1.95]	83 [3.27]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	49.5 [1.95]	83 [3.27]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	G ¼ B	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	G ½ B	51.5 [2.03] 1)	85 [3.24] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M12 x 1.5	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	M20 x 1.5	51.5 [2.03] 1)	85 [3.24] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ISO 7


NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	R ¼	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	18.5 [0.73]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	R ¼	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	49.5 [1.95]	82 [3.23]	101 [3.98]	99 [3.90]	30 [1.181]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	R ¼	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	R ½	51.5 [2.03] 1)	84 [3.31] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]								
		b1	b2 ±1	D1	D2	e	i	j	k	SW
63 [2 ½"]	¼ NPT	33 [1.30]	57 [2.24]	63 [2.48]	62 [2.44]	50 [1.97]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	33 [1.30]	54 [2.13]	63 [2.48]	62 [2.44]	50 [1.97]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
100 [4"]	¼ NPT	49.5 [1.95]	76 [2.99]	101 [3.98]	99 [3.90]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	49.5 [1.95]	82 [3.23]	101 [3.98]	99 [3.90]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
160 [6"]	¼ NPT	51.5 [2.03] 1)	78 [3.07] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]
	½ NPT	51.5 [2.03] 1)	84 [3.31] 1)	161 [6.34]	159 [6.26]	50 [1.97]	6.5 [0.26]	14.5 [0.57]	22.5 [0.89]	22 [0.87]

1) Plus 16 mm [0.630 in] with scale ranges ≥ 0 ... 100 bar [≥ 0 ... 1,500 psi]

NS 63 [2 ½"], centre back mount

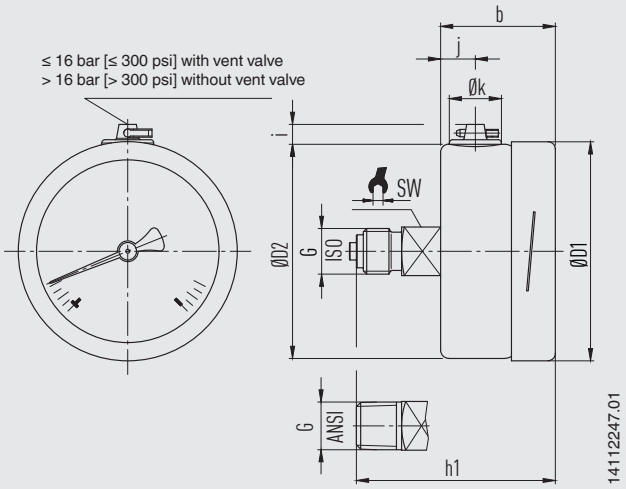

NS	Weight	
	Model 232.50	Model 233.50
63 [2 ½"]	approx. 0.16 kg [0.35 lbs]	approx. 0.20 kg [0.44 lbs]

Process connection with thread per EN 837-1

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	G ¼ B	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	G ⅛ B	54 [2.13]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	M12 x 1.5	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]

Process connection with thread per ISO 7

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	R ¼	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]


Process connection with thread per ANSI/B1.20.1

NS	G	Dimensions in mm [in]							
		h ±1	b	D1	D2	i	j	k	SW
63 [2 ½"]	¼ NPT	57 [2.24]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]
	⅛ NPT	54 [2.13]	33 [1.30]	63 [2.48]	62 [2.44]	6 [0.24]	10 [0.39]	15 [0.59]	14 [0.55]


Accessories

Dimensions in mm [in]

Panel mounting flange

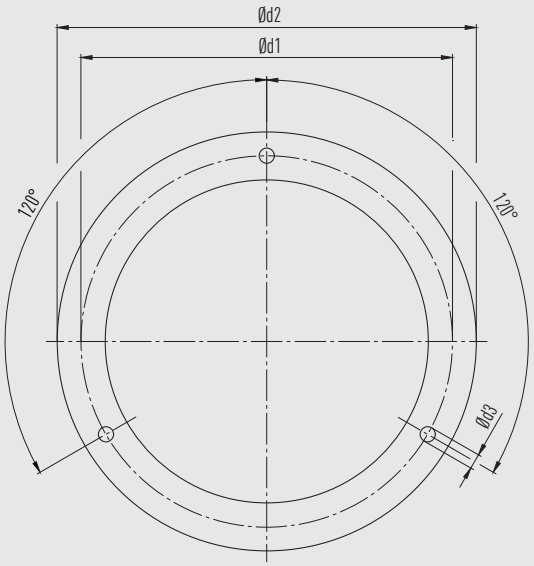


Surface mounting flange

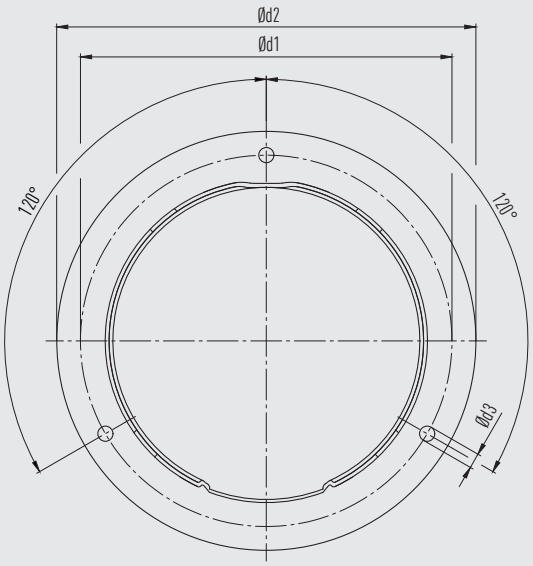


NS	Dimensions in mm [in]			
	Recommended panel cutout	d1	d2	d3
63 [2 ½"]	Ø 67 ±0.3 / Ø 2.6 [Ø 2.64 ±0.01 / Ø 0.10]	75 [2.95]	85 [3.35]	3.6 [0.14]
100 [4"]	Ø 104 ±0.5 / Ø 4.1 [Ø 4.04 ±0.02 / Ø 0.16]	117 [4.60]	132 [5.20]	4.8 [0.19]
160 [6"]	Ø 164 ±0.5 / Ø 6.5 [Ø 6.46 ±0.02 / Ø 0.26]	178 [7.01]	196 [7.72]	5.8 [0.23]

Triangular profile ring

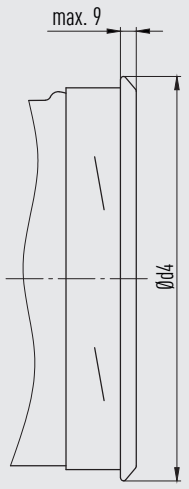

NS	Dimensions in mm [in]	
	Recommended panel cutout	d4
63 [2 ½"]	Ø 64.5 ±0.5 / Ø 2.5 [Ø 2.54 ±0.02 / Ø 0.01]	≤ 69 [2.72]
100 [4"]	Ø 102 ±1.0 / Ø 4.0 [Ø 4.02 ±0.04 / Ø 0.16]	≤ 108 [4.25]
160 [6"]	Ø 162.6 ±1.0 / Ø 6.4 [Ø 6.40 ±0.04 / Ø 0.25]	≤ 168 [6.61]

Accessories and spare parts

Model		Description
	**910.17**	Seals → See data sheet AC 09.08
	**910.15**	Syphons → See data sheet AC 09.06
	**910.13**	Overpressure protector → See data sheet AC 09.04
	**IV10, IV11**	Needle valve and multiport valve → See data sheet AC 09.22
	**IV20, IV21**	Block-and-bleed valve → See data sheet AC 09.19
	**IVM**	Monoflange, process and instrument version → See data sheet AC 09.17
	**BV**	Ball valve, process and instrument version → See data sheet AC 09.28
	**IBF2, IBF3**	Monoblock with flange connection → See data sheet AC 09.25

Ordering information

Model / Nominal size / Scale range / Process connection / Connection location / Options

© 02/1995 WIKA Alexander Wiegand SE & Co. KG, all rights reserved.
The specifications given in this document represent the state of engineering at the time of publishing.
We reserve the right to make modifications to the specifications and materials.
In case of a different interpretation of the translated and the English data sheet, the English wording shall prevail.

WIKA Alexander Wiegand SE & Co. KG
Alexander-Wiegand-Straße 30
63911 Klingenberg/Germany
Tel. +49 9372 132-0
info@wika.de
www.wika.de

EU-Konformitätserklärung
EU Declaration of Conformity

Dokument Nr. / ***Document No.*** **11564220** — **Revision** / ***Issue*** **07**

Wir erklären in alleiniger Verantwortung, dass die mit CE gekennzeichneten Produkte
We declare under our sole responsibility that the CE marked products

Typenbezeichnung / ***Type Designation***

23a.50.063 + option ATEX | **23a.50.1*0 + option ATEX**
26a.50.063 + option ATEX | **26a.50.1*0 + option ATEX**
23a.30.063 + option ATEX | **23a.30.1*0 + option ATEX**
26a.30.063 + option ATEX | **26a.30.1*0 + option ATEX**
23a.53.063 + option ATEX | **23a.53.100 + option ATEX**
23a.54.063 + option ATEX | **23a.54.100 + option ATEX**
23a.36.1*0 + option ATEX
PG23LT.063 + option ATEX | **PG23LT.1*0 + option ATEX**
PG23CP.063 + option ATEX | **PG23CP.100 + option ATEX**
PG28.1*0 + option ATEX
PG23HP-S.1*0 + option ATEX | **PG23HP-P.1*0 + option ATEX**

*** Nominal size**
0 = 100mm
6 = 160mm

a Case filling
2 = Without case filling
3 = With case filling

Beschreibung / ***Description***: **Rohrfederdruckmessgerät** / ***Bourdon Tube Pressure Gauge***

gemäß gültigem Datenblatt / *according to the valid data sheet*: PM 02.02, PM 02.04, PM 02.12, PM 02.15, PM 02.22, PM 02.24, PM 02.32, PM 02.28, PM 02.29

mit den nachfolgenden relevanten Harmonisierungsvorschriften der Union übereinstimmen
are in conformity with the following relevant Union harmonisation legislation

Angewandte harmonisierte Normen oder sonstige technische Spezifikationen:
Applied harmonised standards or other technical specifications:

2014/68/EU	Druckgeräterichtlinie (DGRL) (1) *Pressure Equipment Directive (PED)* (1)	
2014/34/EU	Explosionsschutz (ATEX) (2) *Explosion protection (ATEX)* (2)	
Ex	II 2G Ex h IIC T6 … T1 Gb X II 2D Ex h IIIC T85 °C … T450 °C Db X	EN ISO 80079-36 :2016 EN ISO 80079-37 :2016

(1) PS > 200 bar; Modul A, druckhaltendes Ausrüstungsteil
PS > 200 bar; Module A, pressure accessory

(2) Modul A „interne Fertigungskontrolle“. Die Dokumentation ist hinterlegt unter der Nummer 074/24 bei der Notifizierten Stelle der EU, IBExU Institut für Sicherheitstechnik GmbH (EU ID-Nr. 0637).
Module A “Internal Control of Production”. The Documentation is deposited under registration number 074/24 at Notified Body of EU, IBExU Institut für Sicherheitstechnik GmbH (EU ID 0637). .

Unterzeichnet für und im Namen von / *Signed for and on behalf of*

WIKA Alexander Wiegand SE & Co. KG

Klingenberg, 2024-04-24


Sascha Schnellbacher, Vice President
CoE Gauges, Sensors & Instruments

Mariusz Lubomski, Director of Quality
CoE Gauges, Sensors & Instruments


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-PSV-055B	Safety Valve	LOWER DECK	1724000740	AST SpA	COITECH	24-03803	SLK	ATEX ZONE 2	Declaration of Conformity By COITECH SLKL-08HA74-015	Coitech EU - Type Examination Certificate	CE Ex - II 2 GD Ex h X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PT-001	Hyrogen to vessels inlet header	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240634	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-002	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240635	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-004	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240636	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PT-006	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240638	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-PT-008	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240640	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-PT-009	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240642	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-PT-011	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240644	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_2
25-PT-012	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240646	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-035	Vessel V-25001A pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240637	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PT-037	Vessel V-25001B pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240639	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-PT-040	Vessel V-25001C pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240641	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-PT-043	Vessel V-25001D pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240643	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-PT-046	Vessel V-25001E pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240645	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_2
25-PT-049	Vessel V-25001F pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240647	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240648	SST76-H-7-K-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PT-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240649	SST76-H-7-K-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PV-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400589	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PV-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400590	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-PV-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400591	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-PV-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400592	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-PV-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400593	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-PV-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400594	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-PV-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400595	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PV-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400596	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PY-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400589	CV-8407	II 2G	ATEX - SN 2400589	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PY-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400590	CV-8407	II 2G	ATEX - SN 2400590	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-PY-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400591	CV-8407	II 2G	ATEX - SN 2400591	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-PY-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400592	CV-8407	II 2G	ATEX - SN 2400592	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-PY-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400593	CV-8407	II 2G	ATEX - SN 2400593	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-PY-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400594	CV-8407	II 2G	ATEX - SN 2400594	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-PY-055A	Hydrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400595	CV-8407	II 2G	ATEX - SN 2400595	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PY-055B	Hydrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400596	CV-8407	II 2G	ATEX - SN 2400596	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SDV-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SDV-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SDY-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SDY-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-SV-031	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-SV-032	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-033	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-SV-034	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-SV-035	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-SV-036	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-037	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

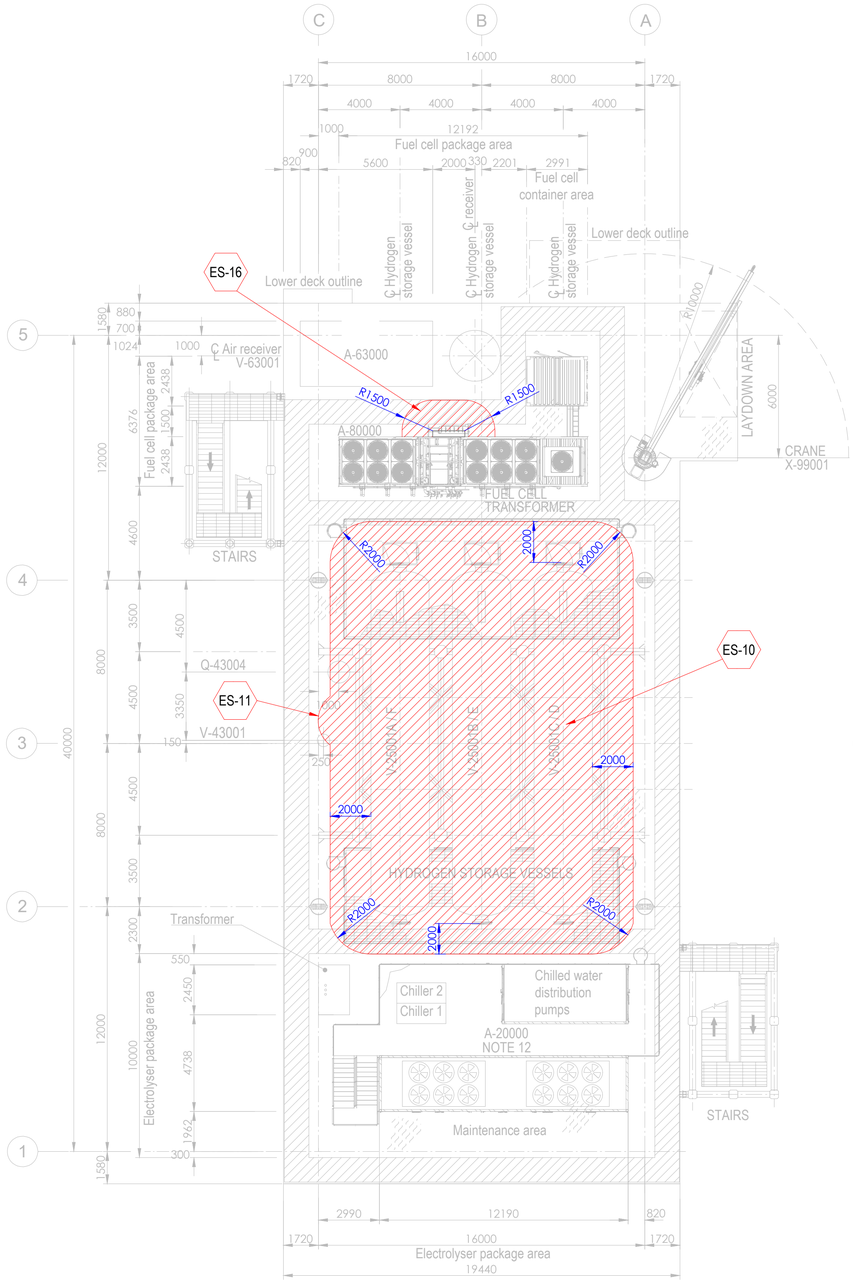


PLAN ON UPPER DECK
EL+30.310 T.O.S.

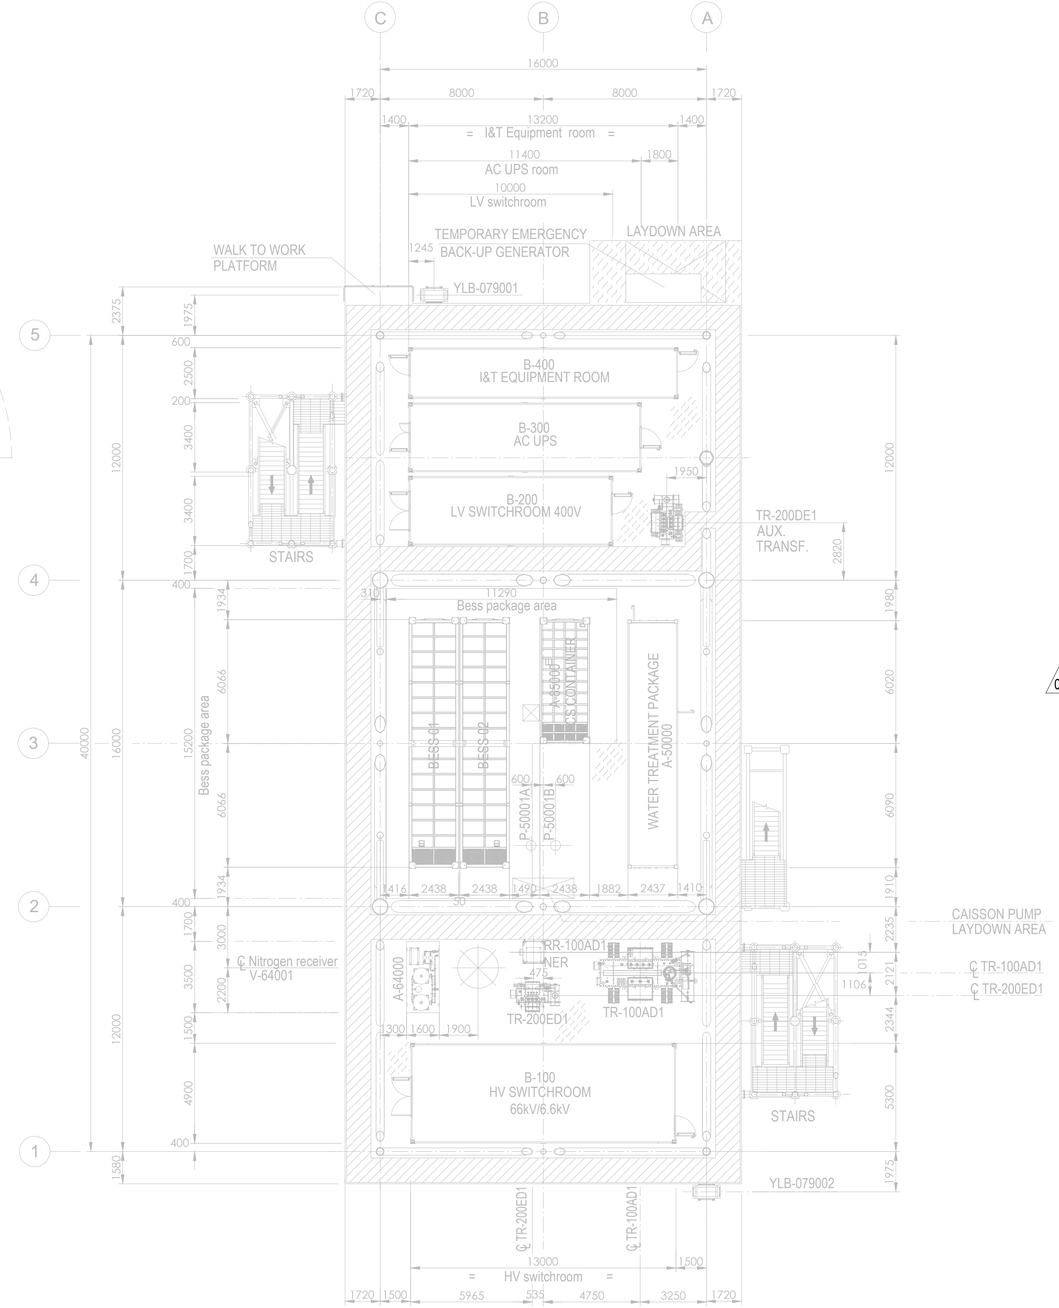

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

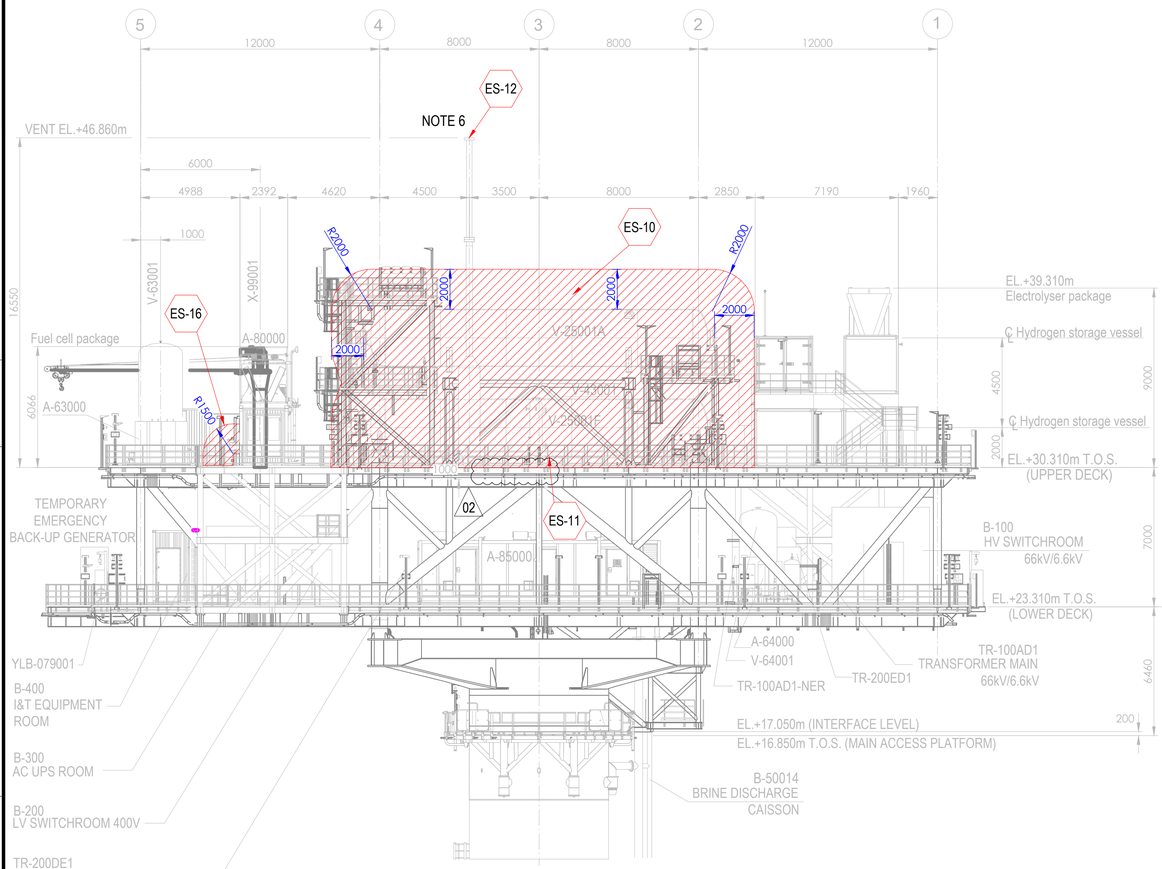



ELEVATION LOOKING EAST

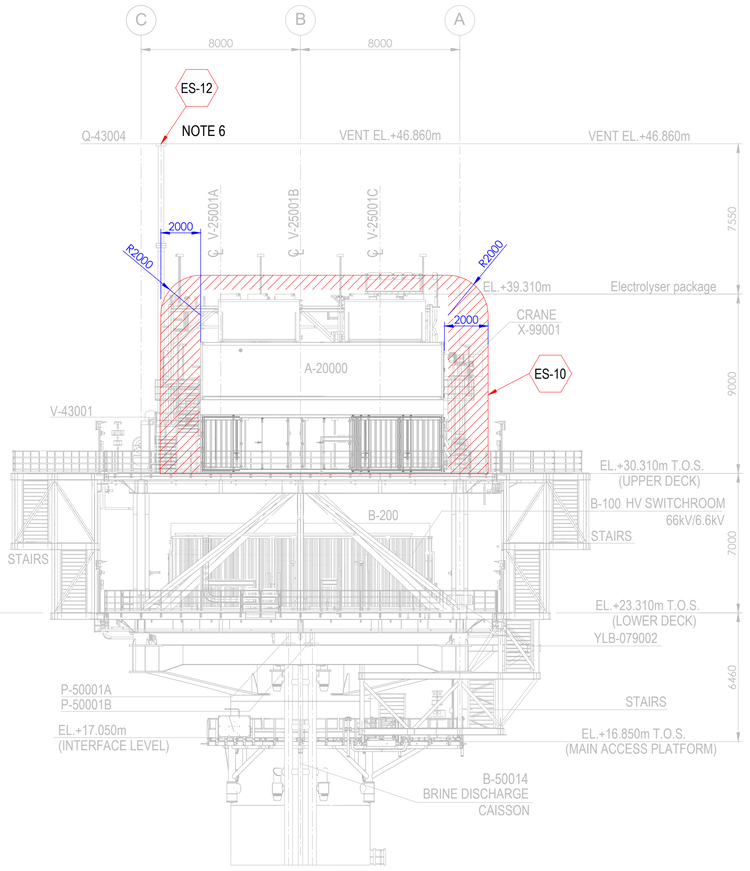

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

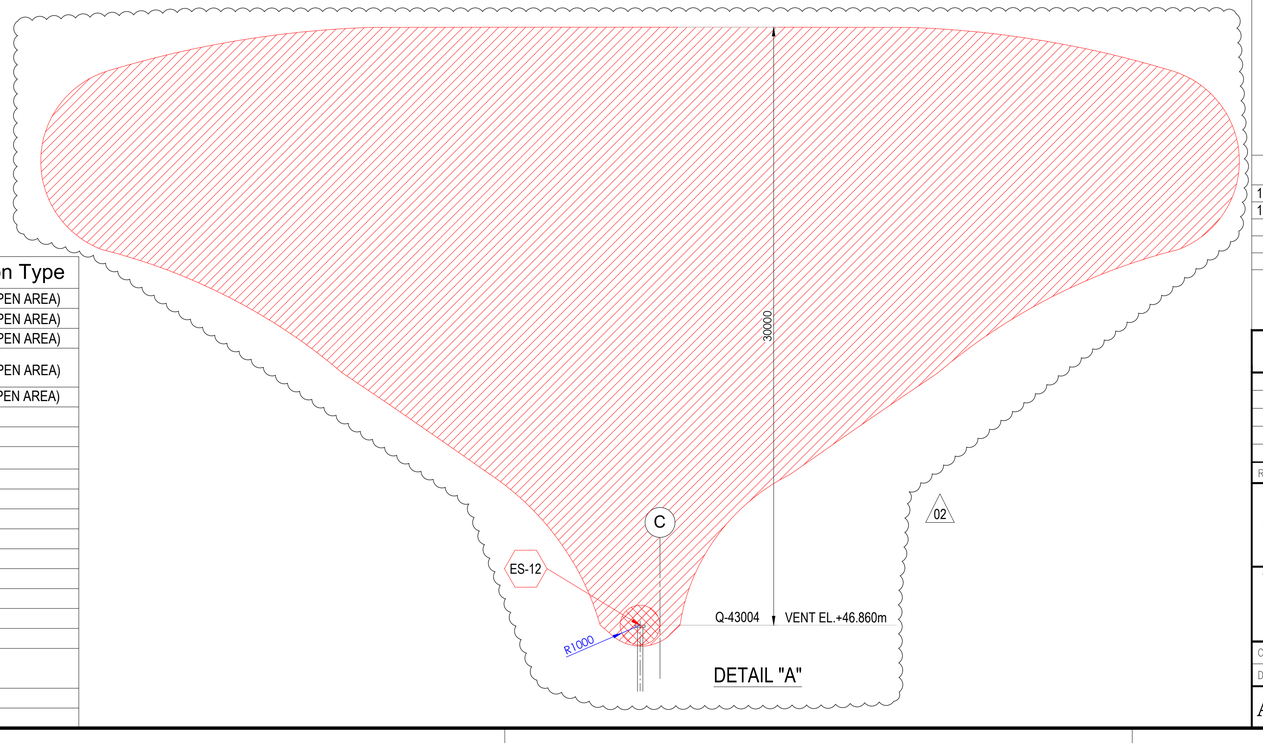



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

ITEM	Tag	25-PSV-001	: Safety Valve - Hyrogen to Vessels Inlet Header Shut-Down	Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD
TASK	code	C10004849	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity: CCK	Discipline: ATEX	Form: CJX01 — Hazardous Area Equipment Detailed Inspection

Schedule Ref. #				**Area Code**					
Area Class Drawing	123A90-DDL-SAF-DL-30022			**Serial No.**	25308855				
Manufacturer	NUOVA GENERAL INSTRUMENTS			**Model**	D10/S				
Cert No.	D.o.C. by Manufacturer			**Equipment Ambient Temp.**	-20 °C to +40 °C				
Area Classification	HAZARDOUS	**Zone**	2	**Gas group**	IIC	**Temp class**	T1		
Equipment Protection Type	Ex h	**EPL**	Gb	**Gas group**	IIC	**Temp class**	T6	**IP Rating**	NA

Detailed Note:

1) Inspection shall only be performed by competent personnel

2) All fields are to be completed. Any non-applicable field shall state "NA". Comments are required for 'Failure' column ONLY.

3) An Inspection Sheet should be completed for EACH individual item of Equipment.

	General Equipment	Detailed	OK/NA/PL	Comments
1	Equipment is appropriate to the EPL / Zone requirements of the area	x	OK	
2	Equipment group is correct	x	OK	
3	Equipment temperature class is correct	x	OK	
4	Degree of IP protection of equipment is appropriate for the level of protection	x	NA	
5	Equipment circuit identification is correct	x	NA	
6	Equipment circuit identification is available	x	NA	
7	Enclosure glass parts and glass-to-metal sealing gaskets and / or compounds are satisfactory	x	NA	
8	There is no damage or unauthorized modifications	x	OK	
9	There is no evidence of unauthorized modifications	x	OK	
10	Bolts, cable entry devices (direct and indirect) & blanking elements are of the correct type, are complete & tight		NA	
	Physical check	x	NA	
11	Threaded covers on enclosures are of the correct type, are tight and secured		NA	
	Physical check	x	NA	
12	Joint surfaces are clean and undamaged and gaskets, if any, are satisfactory and positioned correctly	x	NA	
13	Condition of enclosure gaskets is satisfactory	x	NA	
14	There is no evidence or ingress of water or dust in the enclosure in accordance with the IP rating	x	NA	
15	Electrical connections are tight	x	NA	
16	Bridging links do not reduce creepage / clearance and are allowed	x	NA	
17	Unused terminals are tightened	x	NA	
18	Encapsulated components are undamaged	x	NA	
19	Flameproof components are undamaged	x	NA	
20	Fluorescent lamps are not indicating EOL effects (only for Ex "e" – Ex "n" – Ex "t")	x	NA	
21	HID lamps are not indicating EOL effects	x	NA	
22	Lamp type, rating, pin configuration and position are correct	x	NA	
23	Breathing and drainage devices are satisfactory	x	NA	
24	Type of cable is appropriate	x	NA	
25	There is no obvious damage to the cables	x	NA	
26	Cable glands are the correct type and installed correctly	x	NA	
27	Sealing of trunking, ducts, pipes and or conduits is satisfactory	x	NA	
28	Stopping boxes and cable boxes are corrected filled	x	NA	

ITEM	Tag	25-PSV-001	: Safety Valve - Hyrogen to Vessels Inlet Header Shut-Down		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10004849	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

29	Integrity of conduit system and interface with mixed system maintained	x	NA	
30	Earthing connections, including any supplementary earthing bonding connections are satisfactory (for example connections are tight and conductors are of sufficient cross-section		NA	
	Physical check	x	NA	
31	Automated electric protective devices operate within permitted limits	x	NA	
32	Special conditions (if applicable) have been complied with.	x	NA	
33	All cable cores are uniquely labeled	x	NA	
34	Cable cores not in use are correctly terminated	x	NA	
35	Equipment is adequately protected against corrosion, weather, vibration and other adverse factors	x	OK	
36	No undue accumulation of dust and dirt	x	OK	
37	All equipment housings are clean and dry	x	NA	
38	All moving parts are free and have no mechanical damage	x	NA	
	Applicable for Installation of Heating Systems			
39	Temperature sensors function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
40	Safety cut off devices function according to manufacturer's documents (only applicable for Ex-d e Ex-e)	x	NA	
41	The setting of the safety cut off is sealed (only applicable for Ex-d e Ex-e)	x	NA	
42	Reset of a heating system safety cut off possible with tool only(only applicable for Ex-d e Ex-e)	x	NA	
43	Auto-reset is not possible (only applicable for Ex-d e Ex-e)	x	NA	
44	Reset of a safety cut off under fault conditions is prevented (only applicable for Ex-d e Ex-e)	x	NA	
45	Safety cut off independent from control system (only applicable for Ex-d e Ex-e)	x	NA	
46	Level switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
47	Flow switch is installed and correctly set, if required (only applicable for Ex-d e Ex-e)	x	NA	
	Extra Ex d checks			
48	Obstructions adjacent to flame proof flanged joints are in accordance with IEC 60079-14	x	NA	
49	Ex d conduits seals are fitted to all conduits and satisfactorily sealed	x	NA	
50	Cable glands are of the correct type and installed correctly	x	NA	
51	Adaptors, reducers, stop ends, etc. are all certified Ex d	x	NA	
52	Flame path are clean and undamaged	x	NA	
53	Flange gap dimensions are within tolerances	x	NA	
54	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
55	The ventilation airflow is not impeded	x	NA	
56	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
57	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
58	Variable voltage/frequency installation complies with documentation	x	NA	
	Extra Ex e checks			
59	All Equipment is Ex e certified (including components within enclosure)	x	NA	
60	Power conductors are not bunched together causing possible hot spots	x	NA	
61	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are undamaged, motor foundations have no indentations or cracks	x	NA	
62	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
63	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
64	The ventilation airflow is not impeded	x	NA	
65	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
66	Variable voltage/frequency installation complies with documentation	x	NA	

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	25-PSV-001	: Safety Valve - Hyrogen to Vessels Inlet Header Shut-Down		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10004849	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline ATEX	Form	CJX01	Hazardous Area Equipment Detailed Inspection

Extra Ex n (nR, nL) checks				
67	All Terminals are Ex n certified (if required on certificate)	x	NA	
68	Hermetically sealed and enclosed break devices are undamaged	x	NA	
69	Restricted breathing properties satisfactory (conduct vacuum test)	x	NA	
70	Test port, if fitted, is functional (type “nR” only)	x	NA	
71	Breathing operation is satisfactory (type “nR” only)	x	NA	
72	Motor fans have sufficient clearance to the enclosure and/or covers, cooling systems are	x	NA	
73	The ventilation airflow is not impeded	x	NA	
74	Insulation resistance (IR) of the motor windings is satisfactory	x	NA	
75	Motor protection devices operate within the permitted tE or tA time limits.	x	NA	
76	Variable voltage/frequency installation complies with documentation	x	NA	
Extra Ex p checks				
77	Pressurization gas is correct type	x	NA	
78	Actual pressure is within maximum and minimum settings for equipment	x	NA	
79	Timers set as per certification documentation	x	NA	
80	Alarms and trip functions operate correctly as per certification documentation	x	NA	
81	Fault loop impedance (TN systems) or earthing resistance (IT systems) is satisfactory	x	NA	
82	Automatic electrical protective devices operate within permitted limits	x	NA	
83	Automatic electrical protective devices are set correctly	x	NA	
84	Protective gas inlet temperature is below maximum specified	x	NA	
85	Ducts, pipes and enclosures are in good condition	x	NA	
86	Protective gas is substantially free from contaminants	x	NA	
87	Protective gas pressure and/or flow is adequate	x	NA	
88	Pressure and/or flow indicators, alarms and interlocks function correctly	x	NA	
89	Conditions of spark and particle barriers of ducts for exhausting the gas in hazardous area are satisfactory	x	NA	
90	Specific conditions of use (if applicable) are complied with		NA	
Extra Ex i (Intrinsically Safe – IS) checks				
91	Equipment has adequate circuit identification for ‘IS’ Installation	x	NA	
92	Cables are installed in accordance with the documentation	x	NA	
93	Segregation is maintained between IS and non-IS Circuits	x	NA	
94	Cable screens are isolated at one end (field side)	x	NA	
95	Cable screens are earthed in accordance with the documentation	x	NA	
96	Safety barrier units, relays and other energy limiting devices are of the approved type, installed in	x	NA	
97	Equipment installed is the one specified in the documentation	x	NA	
98	Ambient temperature range of the apparatus is correct for the installation	x	NA	
99	Service temperature range of the apparatus is correct for the installation	x	NA	
100	Installation is clearly labelled	x	NA	
101	Printed circuit boards are clean and undamaged	x	NA	
102	The maximum voltage Um of the associated apparatus is not exceeded	x	NA	
103	Point-to-point connections are all correct	x	NA	
104	Earth continuity is satisfactory (e.g. connections are tight, conductors are of sufficient cross-section)	x	NA	
105	Earth connections maintain the integrity of the type of protection	x	NA	
106	Intrinsically safe circuit earthing is satisfactory	x	NA	
107	Insulation resistance is satisfactory	x	NA	
108	Short-circuit protection of the power supply is in accordance with the documentation	x	NA	

	BARRIER:	**Manufacturer:**	NA	**Model:**	NA		
		Authority:	NA	**Cert No:**	NA	**Type:**	NA


Remarks: Initial inspection should be detailed and carried out before equipment is brought into service as per IEC 60079-17

Please mark only one box as appropriate	
●	**Passed - Complete**
	Failed

Page 3/3	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Luca Mussi	
Date	2025-01-30	2025-02-03	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-30T10:25:15.067Z	PROVERLIS Digitaly signed by Luca Mussi 2025-02-03T12:45:01.321Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

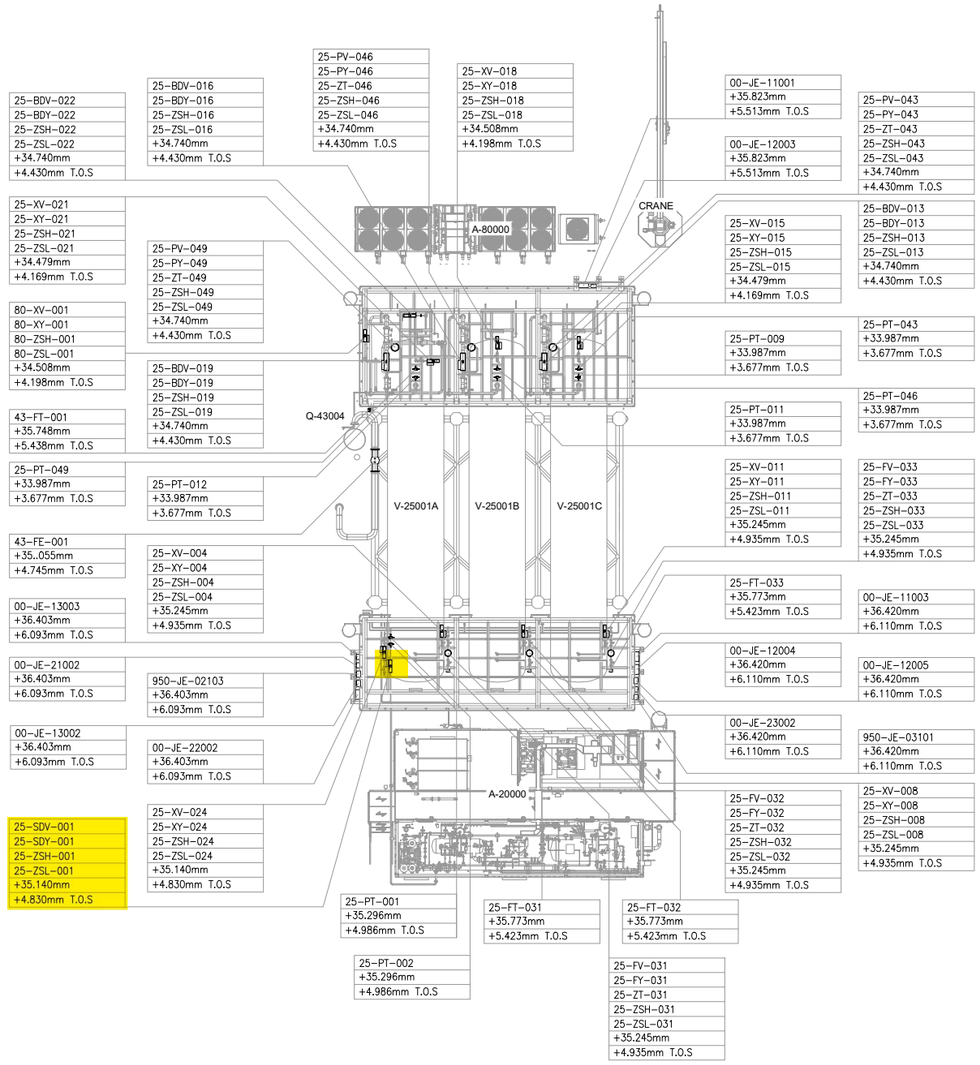

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm

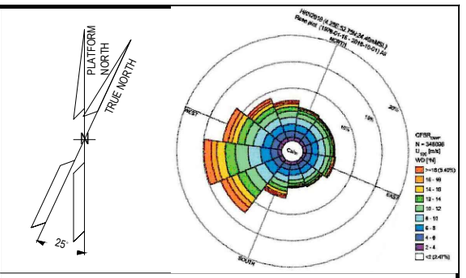

NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90–DDL–IN–DL–40081	002	02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING_NO.

REV.

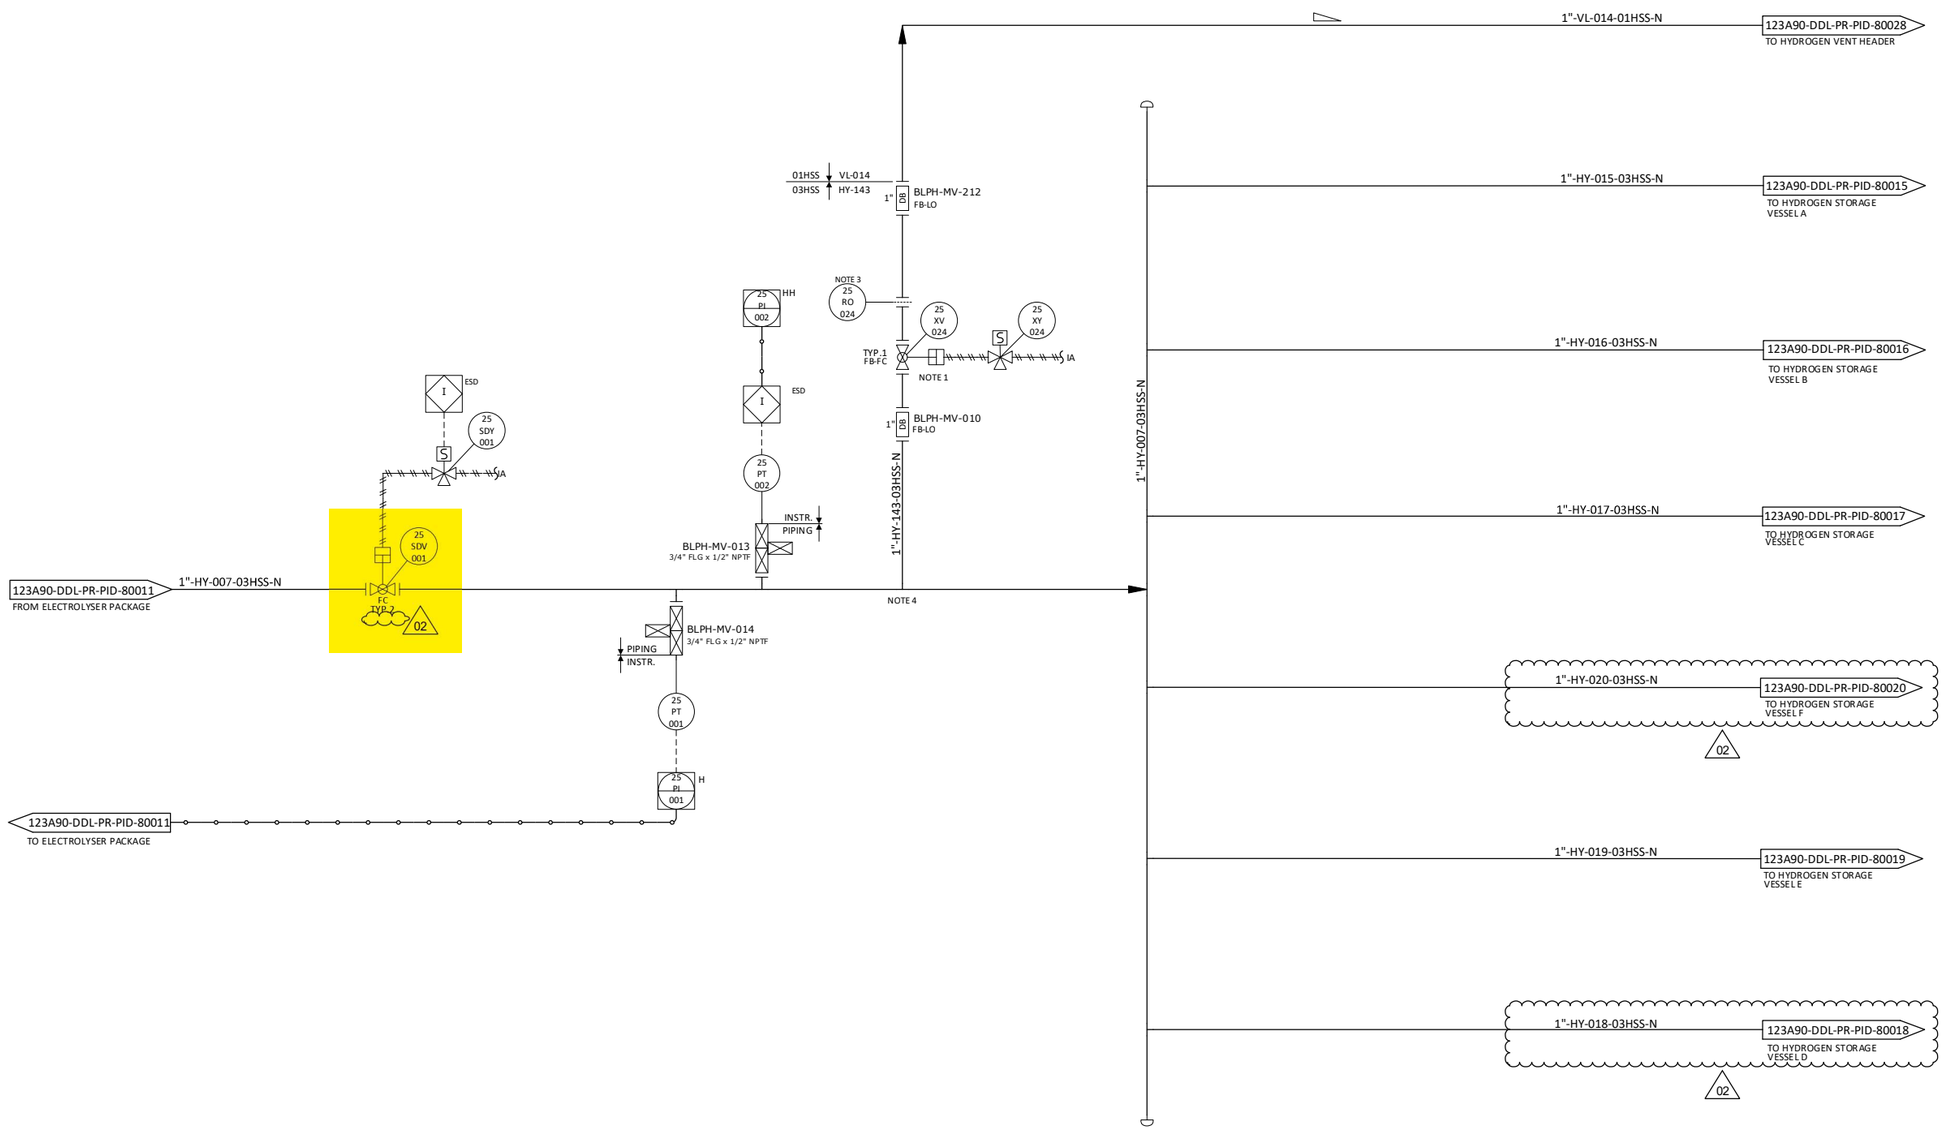

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSELS HEADER (INLET)


CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO.	SHEET	REV.
	123A90-DDL-PR-PID-80013	001	02

File Name : FILE_NAME

CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Electrical Hook-Ups	Sh. 16 of 37 Date: 27/09/2024 Rev. 02

ELECTRICAL HOOK-UP FOR SDV/BDV (N.1 SOLENOID VALVE + 2 LIMIT SWITCH)

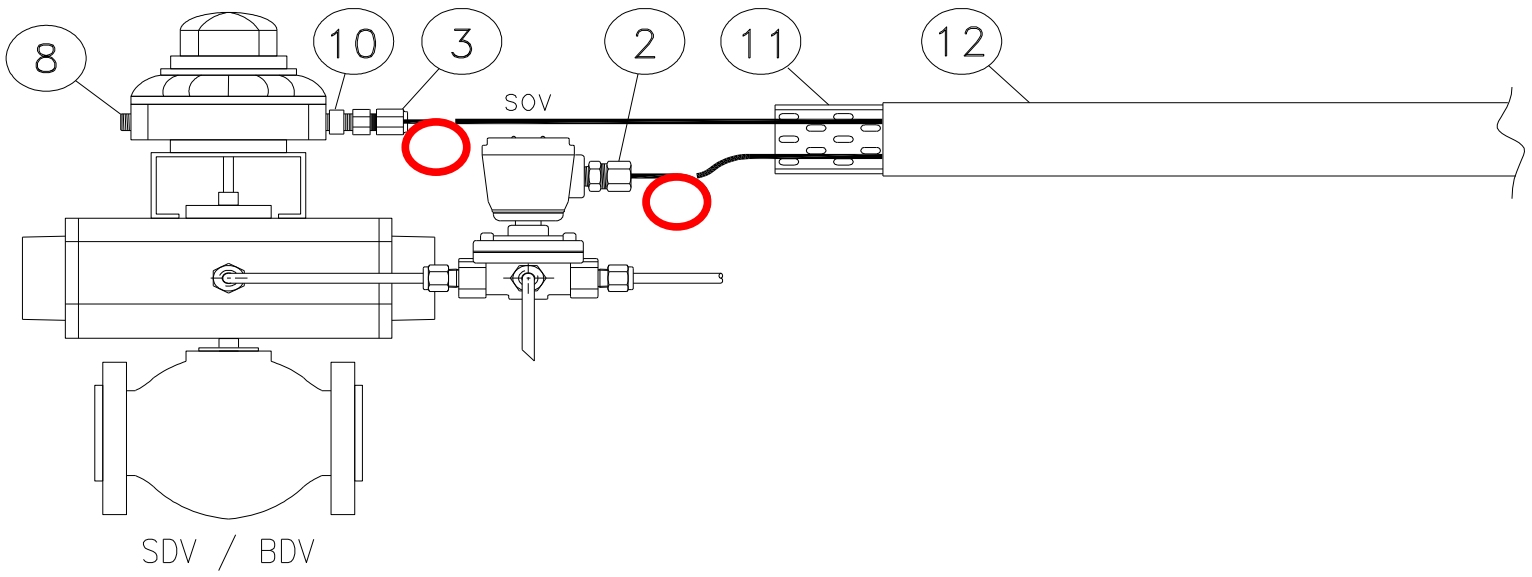

SDV / BDV

INSTRUMENT TAG	
1	25-BDV-005
2	25-BDV-007
3	25-BDV-010
4	25-BDV-013
5	25-BDV-016
6	25-BDV-019
7	25-BDV-022
8	25-SDV-001
9	25-SDV-023
10	64-SDV-001
11	
12	
13	
14	
15	
16	
17	
18	
19	
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	

NOTE:


VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40079**


REV.:	DATE:	SIGNATURE:
2_G	20/12/24	V.Ramponi

ROSETTI MARINO SpA


POS.	NORM/STD CODE	DESCRIPTION	SIZE/ CONNECTION TYPE	Q.TY
12		Cover for cable tray, FRP, Grey Color	50 W x 10 H x 5 THK	3 mt
11		Perforated cable tray, FRP, Grey Color	50 W x 50 H x 5 THK	3 mt
10		Nickel Plated Brass Adaptor Ex-d/e IIC (or IIB + H2) T1	M20 Male x M25 Female	1
8		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1
3		Nickel Plated Brass Double Compression Cable Gland Ex-d/e IIC (or IIB + H2) T1	M25	1
2		Nickel Plated Brass Plug Ex-d/e IIC (or IIB + H2) T1	M20	1


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

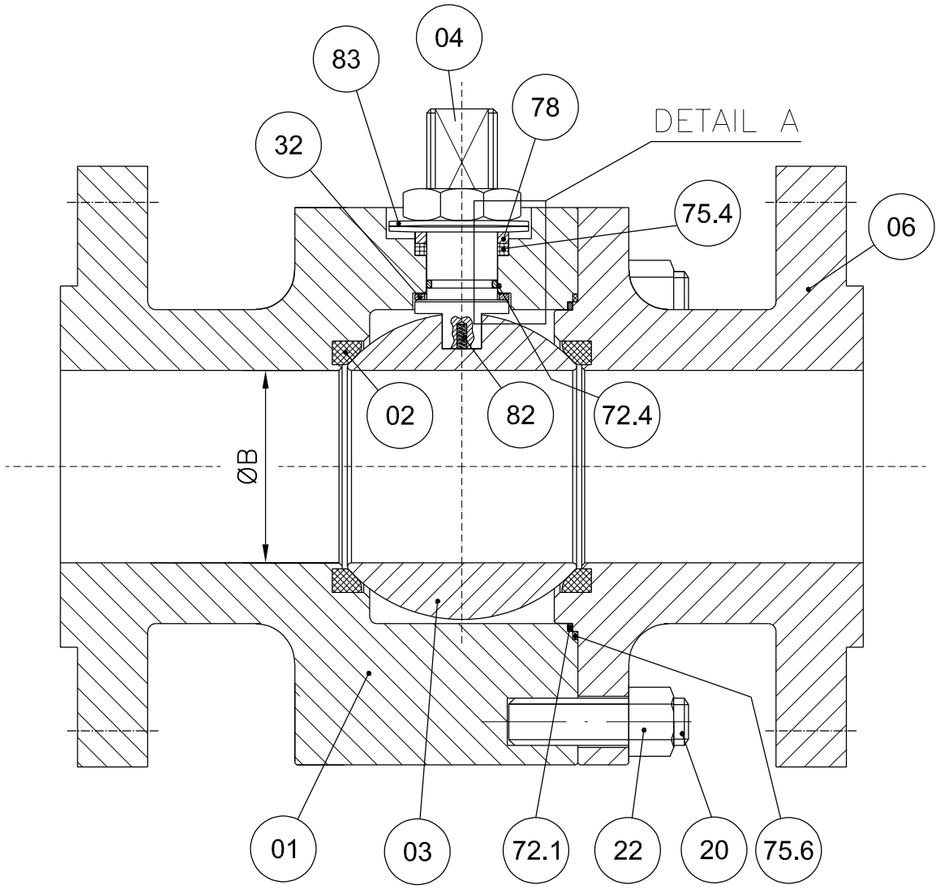




POS.	PART. NAME	MATERIAL
01	BODY	A182 F316/316L
02	SEAT	RPTFE
03	BALL	A182 F316/316L
04	STEM	API 6A CRA UNS N07718
06	CLOSURE	A182 F316/316L
20	STUD	A193 B8M
22	NUT	A194 Gr.8M
32	THRUST BEARING	RPTFE
40	PNEUMATIC ACTUATOR	MFR. STD.
72.1	FLANGE O-RING	VITON GLT/AED
72.4	STEM O-RING	VITON GLT/AED
75.4	STEM GASKET	GRAPHITE
75.6	FLANGE GASKET	GRAPHITE
78	PACKING RING	A479 Tp.316
82	ANTISTATIC DEVICE	INCONEL X750
83	BELLEVILLE WASHER	AISI 301





ANTISTATIC DEVICE



REMARKS:

- Dimensions are in mm
- Design acc. to API 6D
- Face to face acc. to ASME B16.10/API 6D
- Flange connection acc. to ANSI B16.5
- Antistatic device acc. to API 6D

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
08	80	BS03C01RFH	25-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
10	100	BS03C01RFH△	64-SDV-001	1	1"	300	RF	165	25	62	92	124	7	34	41
11	110	BS03C01RFH	25-XV-004	1	1"	300	RF	165	25	62	92	124	7	34	41
12	120	BS03C01RFH	25-XV-006	1	1"	300	RF	165	25	62	92	124	7	34	41
13	130	BS03C01RFH	25-XV-008	1	1"	300	RF	165	25	62	92	124	7	34	41
14	140	BS03C01RFH	25-XV-009	1	1"	300	RF	165	25	62	92	124	7	34	41
15	150	BS03C01RFH	25-XV-011	1	1"	300	RF	165	25	62	92	124	7	34	41
16	160	BS03C01RFH	25-XV-012	1	1"	300	RF	165	25	62	92	124	2 Rev. 7	34	2 Rev. 41

(*): To Be Confirmed

POS:	ITEM:	DATA SHEET:	TAG:	Q.TY:	SIZE:	CLASS:	ENDS:	A	ØB	C	D(*)	ØE	Vlv. WT. (kg):	Act. WT. (kg):	Tot. WT. (kg):
17	170	BS03C01RFH	25-XV-014	1	1"	300	RF	165	25	62	92	124	7	34	41
18	180	BS03C01RFH	25-XV-015	1	1"	300	RF	165	25	62	92	124	7	34	41
19	190	BS03C01RFH	25-XV-017	1	1"	300	RF	165	25	62	92	124	7	34	41
20	200	BS03C01RFH	25-XV-018	1	1"	300	RF	165	25	62	92	124	7	34	41
21	210	BS03C01RFH	25-XV-020	1	1"	300	RF	165	25	62	92	124	7	34	41
22	220	BS03C01RFH	25-XV-021	1	1"	300	RF	165	25	62	92	124	7	34	41
23	230	BS03C01RFH	25-XV-024	1	1"	300	RF	165	25	62	92	124	7	34	41
28	280	BS01C01RFH	80-XV-001	1	1"	150	RF	127	25	54	95	108	6	34	40

CUSTOMER :	ROSETTI MARINO S.p.A.
P.O. N. :	1724000204 123A90A/REV.1
JOB N. :	240062

Rev.	DESCRIPTION	DRAWN	DATE	CHK'D	DATE	APPV'D	DATE
3							
2	ISSUED FOR APPROVAL	S.Madahar	22/04/2024	D.Barcella	22/04/2024	L.Mora	22/04/2024
1	ISSUED FOR APPROVAL	S.Madahar	15/04/2024	D.Barcella	15/04/2024	L.Mora	15/04/2024
0	FIRST ISSUE	S.Madahar	26/02/2024	D.Barcella	26/02/2024	L.Mora	26/02/2024

DRAWING NOT IN SCALE

Fluitek Valves

DESCRIPTION: GENERAL ASSEMBLY DRAWING

VALVE TYPE: SPLIT BODY FLOATING BALL VALVE

DRAWN: S.Madahar	DATE: 26/02/2024	
CHK'D: D.Barcella	DATE: 26/02/2024	
APPV'D: L.Mora	DATE: 26/02/2024	
SIZE: A3	SCALE: N.A.	DRAWING NAME: D240062-08

ALL RIGHTS OF THIS DRAWING ARE RESERVED.

Rev.: 2

GENERAL	1	Tag Number	Location			25-SDV-001		25
	2	Service				HYDROGEN TO STORAGE TANKS		
	3	P&ID Number	Area Classification			123A90-DDL-PR-PID-80013		Zone 2, Gas Group IIC (or IIB+H2), Class T1
PIPELINE	4	Line Number				1"-HY-007-03HSS-N		
	5	Line Size and Schedule	Inlet	Outlet		1" / 3.38 mm		1" / 3.38 mm
	6	Line Material	Line Insulation			ASTM A312/TP316/316L		NOT INSUL. (PAINTED) (35)
PROCESS DATA	7	Fluid				HYDROGEN		
	8	Fluid State	Phase			GAS		GAS
	9	Operating Pressure Norm/Min/Max			[barg]	-	7.5	30
	10	Design Pressure	Full Vacuum		[barg]	40		
	11	Operating Temperature Norm/Min/Max			[°C]	-	5	65
	12	Design Temperature	Minimum	Maxi	[°C]	-29		80
	13	Max. Diff. Pressure for Actuator Size			[bar]	40		
	14							
	15							
	16	Speed of	Design			Close : (12)		Open : (12)
	17	Operation (seconds)	Actual			Close : 0.3 minimum		Open : -
	18							
	19							
VALVE BODY (34)	20	Body Type				BALL VALVE (FLOATING BALL) - SPLIT BODY (BS03C01RFH)		
	21	Body Size	Body Form			1"		FULL BORE
	22	Body Material	Bonnet Type			ASTM A182 F316/316L		(*)
	23	Connections	Rating			FLANGED ASME B16.5		#300
	24	Flange Finish	Gasket Material			RF		Inside the valve (*) (38)
	25	Packing	Lubrication & Isolation			A479 Tp. 316'(33)		(*)
	26	Bolting				A193 B8M / A194 Gr. 8M		
	27	Trim Material	Ball	Stem	Seat	A182 F316 / 316L	API 6A CRA UNS N07718	RPTFE
	28	Leakage Class				(1, 3) TSO		
	29	Fire Safe				(2)		
ACTUATOR	30	Manufacturer	Type			Rotork		Spring Return
	31	Model No.	Size			CP/S		035-100A/AA
	32	Actuator Orientation	Actuator Form			Horizontal		Cylinder
	33	Ingress Protection	Certification			IP-66		II 2 G Ex h IIC T5 Gb
	34	Air Supply	Min	Max	Design	4 barg	10 barg	11 barg
	35	Action on Air Failure	Action on Power Failure			CLOSE		CLOSE
	36	Fireproofing				NOT APPLICABLE		
	37	Solenoid Valve				25-SDY-001 (9, 14, 15, 16) - Bifold FP06P		
	38	Limit Switch Closed	Limit Switch Open			25-ZSL-001 (9, 17) - Soldo SS		25-ZSH-001 (9, 17) - Soldo SS
	39	Elect. Reset Pushbutton (Actuator mounted)				NOT REQUIRED		
	40	Air Set	Handwheel			(*)		NOT REQUIRED
	41	Mounting Position				HORIZONTAL		
	42	Partial Stroke Test Facility				NOT REQUIRED		
	43	Control Type				-		
	44	Electrical Connection	Electrical Class			No. (*) / M20		H
EMERGENCY A/S VESSEL	45	Capacity	Fabrication Code			-	-	-
	46	No of Strokes Per Capacity				-		
	47	Safety Valve	Model			-		-
	48	Check Valve	Mounting			-		-
PURCHASE	49	Manufacturer				FLUITEK		
	50	Model				FB3		
	51	Purchase Order Number				1724000204		

NOTE
(1) N.1 PSV INSTALLED DOWNSTREAM THE AIR FILTER REGULATOR, SIZE 1/4", SS, set 4.7 barg.

No.	Date	By	Chkd	Appr	Description
03	06/12/24	VBA	LCA	DLO	Accepted for Construction (AFC)
02	28/08/24	VBA	LCA	DLO	Accepted for Construction (AFC)
01	20/12/23	VBA	LCA	DLO	Issued for Review (IFR)
00	06/11/23	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

SDV/BDV and Tight Shut-Off XV Valves

CROSSWIND

ROSETTI MARINO

Code : Dwg. No.: 123A90-DDL-IN-DS-40030 Rev.03


This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

47	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
48	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323298	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
49	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
50	IFR	25-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
51	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
52	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620080001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
53	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771400801	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
54	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
55	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323312	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
56	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
57	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
58	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
59	IFR		floating ball valve	N.A	FLUITEK	1-1/2" 300#	2400620090001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
60	IFR	25-SDV-023	ACTUATOR	N.A	RFS	CP/S-035-100A/BA	AF771400901	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
61	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
62	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323300	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
63	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
64	IFR	64-SDV-001	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
65	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
66	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620100001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
67	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401001	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
68	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
69	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323293	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
70	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
71	IFR	25-SDV-004	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
72	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
73	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620110001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
74	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401101	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
75	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
76	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323311	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
77	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
78	IFR	25-XV-006	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
79	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
80	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620120001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
81	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401201	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
82	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
83	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323287	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
84	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
85	IFR	25-XV-008	LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
86	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
87	IFR		floating ball valve	N.A	FLUITEK	1" 300#	2400620130001	Ex db IIC T6 / Ex tb IIIC T85°C Db	TF ATEX/2020	557/Ex-Ab 3221/20	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE
88	IFR		ACTUATOR	N.A	RFS	CP/S-035-080A/AA	AF771401301	II 2 G Ex h IIC T5 Gb X II 2 D Ex h IIIC T5 Db X	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR ACTUATOR	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
89	IFR		FILTER REGULATOR	N.A	BIFOLD	F.R. BIFOLD 1/4" SH06-FR-SR-MD-10-X4	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR F.R.	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
90	IFR		RELIEF	N.A	NGI	D10/S INOX+VITON T.4,7 bar	024323294	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR RELIEF	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
91	IFR		PRESSURE GAUGE	N.A	WIKA	233.50.63	NOT AVAILABLE	NO	123A90-DDL-IN-DS-40030	NOT EXISTING A ATEX CERTIFICATE FOR PRESSURE GAUGE	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	YES	NONE
92	IFR		LIMIT SWITCHES BOX	N.A	SOLDO	FP06P-S1-04-32-NU-V-77A-24D-57	NOT REQUIRED IN PROJECT	Ex II 2GD Ex d IIC T4/T6	123A90-DDL-IN-DS-40030	CML 19ATEX1359X	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	YES
93	IFR		SOLENOID VALVE	N.A	BIFOLD	SQN120E-20X23L7	NOT REQUIRED IN PROJECT	Ex db IIC T6 / Ex tb IIIC T85°C Db	123A90-DDL-IN-DS-40030	Baseefa10ATEX0026	Zone 2, Gas Group IIC	N.A	1724000204	FLUITEK VALVES Srl	N.A	N.A	NO	NONE


Tag Number	Tag Description	Location	P.O.	Vendor	Manufacturer	Serial Number	Model Type Catalogue Number	Installation Zone	ATEX Certificate Number	Reference Document	ATEX Certification Marking	Notes / Comments	Skid / Package	Electrical Equip.	Barrier Calculation Ref.	Special Conditions of Safe Use Applicable	3D Location
25-PSV-055B	Safety Valve	LOWER DECK	1724000740	AST SpA	COITECH	24-03803	SLK	ATEX ZONE 2	Declaration of Conformity By COITECH SLKL-08HA74-015	Coitech EU - Type Examination Certificate	CE Ex - II 2 GD Ex h X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PT-001	Hyrogen to vessels inlet header	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240634	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-002	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240635	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-004	Vessel V-25001A Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240636	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PT-006	Vessel V-25001B Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240638	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-PT-008	Vessel V-25001C Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240640	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-PT-009	Vessel V-25001D Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240642	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-PT-011	Vessel V-25001E Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240644	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_2
25-PT-012	Vessel V-25001F Hydrogen vent system	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240646	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-035	Vessel V-25001A pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240637	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PT-037	Vessel V-25001B pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240639	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_2
25-PT-040	Vessel V-25001C pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240641	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1
25-PT-043	Vessel V-25001D pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240643	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-PT-046	Vessel V-25001E pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240645	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_2
25-PT-049	Vessel V-25001F pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240647	SST76-H-7-L-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6 HAZARDOUS-AREA_3
25-PT-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240648	SST76-H-7-K-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PT-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000979	Terranova Srl	Terranova Srl	SE240649	SST76-H-7-K-2-9-2-1-4 + MAN2-R6		TI17ATEX304X	1724000979-IN-DA-00003 / 1724000979-IN-DS-00004	ATEX Ex II 1/2G Ex db IIC / IIB, T6/T5, Ga/Gb or ATEX Ex II 1/2G Ex ia IIC T6/T5/T4 Ga/Gb	-	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PV-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400589	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PV-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400590	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-PV-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400591	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-PV-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400592	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-PV-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400593	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-PV-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400594	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-PV-055A	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400595	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PV-055B	Hyrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400596	CV-8407		II 2G Ex h IIC T6..T1 Gb X	1724000740-IN-DA-00004	CE Ex - II 2 G Ex h IIC T6...T1 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PY-035	Vessel V-25001A pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400589	CV-8407	II 2G	ATEX - SN 2400589	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-PY-037	Vessel V-25001B pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400590	CV-8407	II 2G	ATEX - SN 2400590	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-PY-040	Vessel V-25001C pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400591	CV-8407	II 2G	ATEX - SN 2400591	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-PY-043	Vessel V-25001D pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400592	CV-8407	II 2G	ATEX - SN 2400592	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_1 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_4
25-PY-046	Vessel V-25001E pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400593	CV-8407	II 2G	ATEX - SN 2400593	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_2 HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-PY-049	Vessel V-25001F pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400594	CV-8407	II 2G	ATEX - SN 2400594	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-PY-055A	Hydrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400595	CV-8407	II 2G	ATEX - SN 2400595	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-PY-055B	Hydrogen from vessels outlet header pressure control	LOWER DECK	1724000740	AST SpA	AST SpA	2400596	CV-8407	II 2G	ATEX - SN 2400596	1724000740-IN-DA-00004	II 2G Ex-d IIC T1	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SDV-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SDV-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N/A	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_6
25-SDY-001	Hyrogen to vessels inlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_3 HAZARDOUS-AREA_6
25-SDY-023	Hyrogen from vessels outlet header shut-down	LOWER DECK	1724000204	RFS	SOLDO	N.A.	FP06P-S1-04-32-NU-V-77A-24D-57	Zone 2, Gas Group IIC	CML 19ATEX1359X	1724000204-IN-DG-00006	Ex II 2GD Ex d IIC T4/T6	N/A	N/A	True	N/A	True	HAZARDOUS-AREA_6
25-SV-031	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2
25-SV-032	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_4 HAZARDOUS-AREA_1 HAZARDOUS-AREA_2
25-SV-033	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4 HAZARDOUS-AREA_1
25-SV-034	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_4
25-SV-035	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3
25-SV-036	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_5 HAZARDOUS-AREA_6
25-SV-037	Air set Filter	LOWER DECK	1724000740	AST SpA	SITECNA	FR08411S00SSNB2 TRACE 24/1638	FR04	ATEX ZONE 2	FR08411S00SSNB2 TRACE 24/1638	Sitecna EU - Type Examination Certificate	CE Ex - 2G Ex h IIC T6/T5 Gb X	N/A	N/A	False	N/A	True	HAZARDOUS-AREA_8 HAZARDOUS-AREA_3 HAZARDOUS-AREA_2

DRAWING NO. 123A90-DDL-SAF-DL-30022

REV. 02

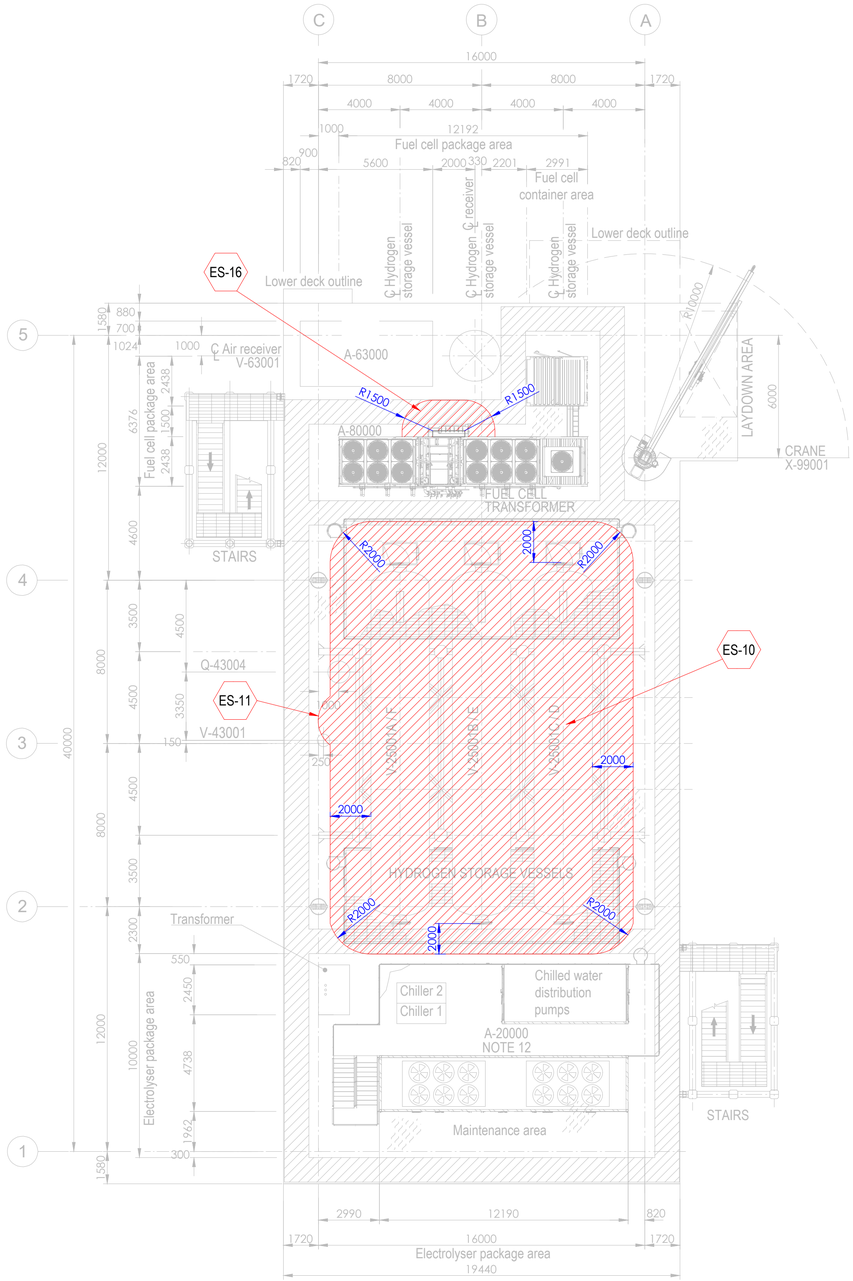


PLAN ON UPPER DECK
EL+30.310 T.O.S.

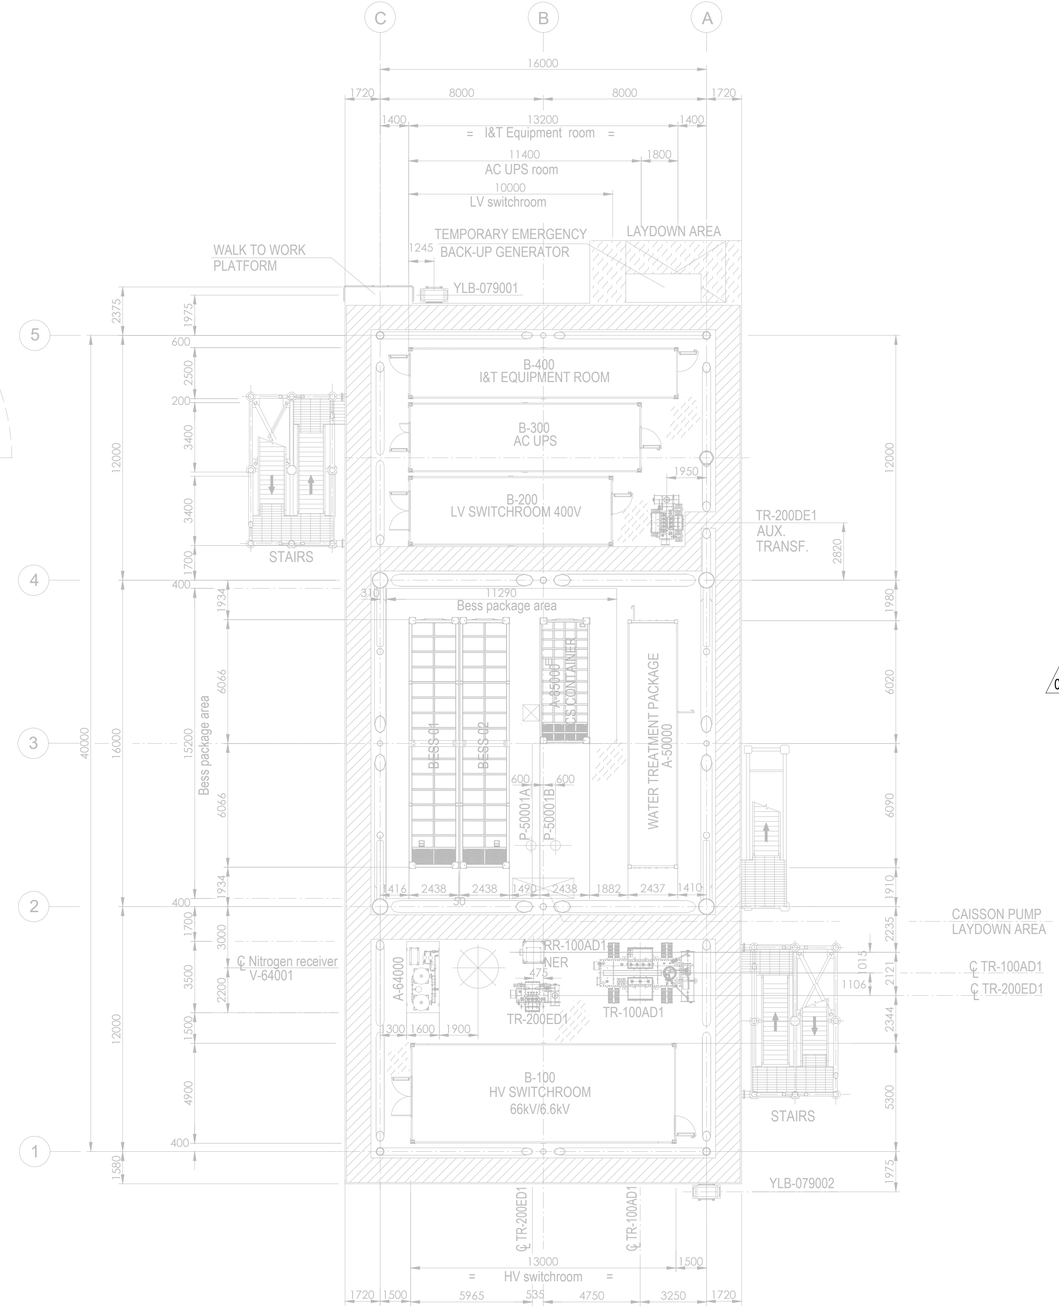

PLAN ON LOWER DECK
EL+23.310 T.O.S.

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	A-50000	WATER TREATMENT PACKAGE		

Tag No.	Equipment Tag	Description	Material	Ventilation Type
12	A-64000	NITROGEN SYSTEM		
13	B-100	HV SWITCHROOM 66kV/6.6kV		
14	B-200	LV SWITCHROOM 400V		
15	B-300	AC UPS EQUIPMENT ROOM		
16	B-400	I&T EQUIPMENT ROOM		
17	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
18	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
19	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
20	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
21	X-99001	CRANE		
22	V-64001	NITROGEN RECEIVER		



NOTES

1. ALL DIMENSIONS IN mm U.N.O.
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17].
6. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
7. IDENTIFIED EMISSION SOURCES DETAIL.

02
8. FOR DETAILS RELATED TO ELECTROLYSER PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING 224J10-DDL-PP-DA-00001 REV 0.
9. FOR DETAILS RELATED TO FUELL CELL PACKAGE INTERNAL ENCLOSURES REFER TO DRAWING K559-2254-CWIWP4202202-B01-001 REV 009".
10. THE N.6 HYDROGEN STORAGE VESSELS ARE NOT CLASSIFIED INTERNALLY SINCE THEY ARE DESIGNED TO CONTAIN HYDROGEN OR NITROGEN FOR THE ENTIRE DURATION OF THE 2 YEARS OF OPERATION.

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-PP-DS-70072	PLOT PLAN - ELEVATION LOOKING NORTH & EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/25	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
LOWER & UPPER DECK


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

	DRAWING NO.	SHEET	REV.
A1	123A90-DDL-SAF-DL-30022	001	02


File Name : 123A90-DDL-SAF-DL-30022 Rev.02

DRAWING NO. 123A90-DDL-SAF-DL-30024

REV. 02

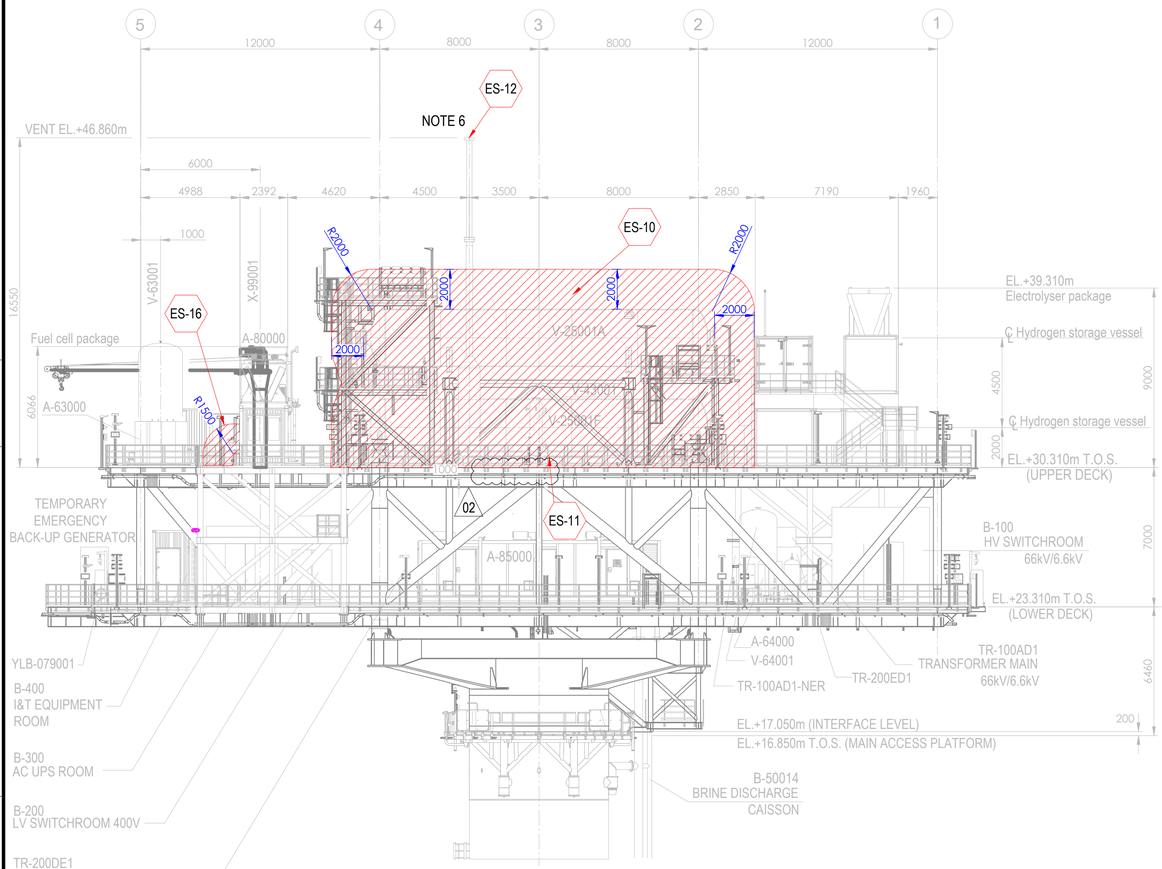



ELEVATION LOOKING EAST

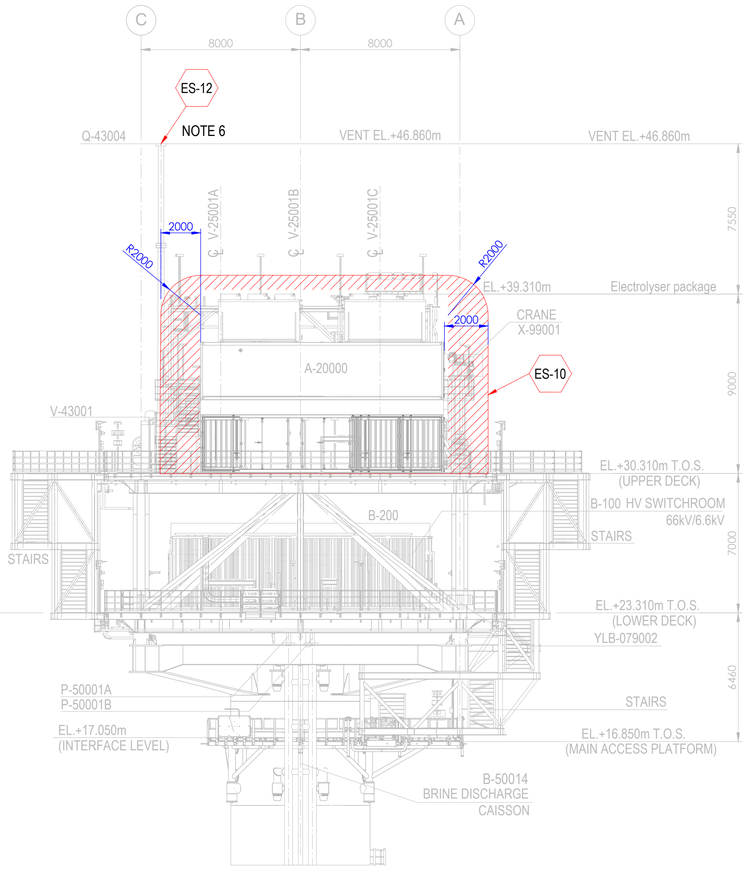

ELEVATION LOOKING NORTH

Tag No.	Equipment Tag	Description	Material	Ventilation Type
01	P-50001 A/B	SEA WATER LIFT PUMPS	SEA WATER	NATURAL (OPEN AREA)
02	Q-43004	HYDROGEN VENT	HYDROGEN	NATURAL (OPEN AREA)
03	V-43001	HYDROGEN VENT KO DRUM	HYDROGEN	NATURAL (OPEN AREA)
04	V-25001 (A/B/C/D/E/F)	HYDROGEN STORAGE VESSELS	HYDROGEN	NATURAL (OPEN AREA)
05	V-63001	INSTRUMENT AIR RECEIVER	INSTRUMENT AIR	NATURAL (OPEN AREA)
06	A-20000	ELECTROLYSER PACKAGE		
07	A-63000	INSTRUMENT AIR PACKAGE		
08	A-80000	FUEL CELL PACKAGE		
09	A-85000	BESS PACKAGE		
10	YLB-079001/2	LIFE RAFTS		
11	B-100	HV SWITCHROOM 66kV/6.6kV		
12	B-200	LV SWITCHROOM 400V		
13	B-300	AC UPS EQUIPMENT ROOM		
14	B-400	I&T EQUIPMENT ROOM		
15	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		
16	TR-100AD1-NER	NEUTRAL EARTHING RESISTOR		
17	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV		
18	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT		
19	X-99001	CRANE		
20	V-64001	NITROGEN RECEIVER		

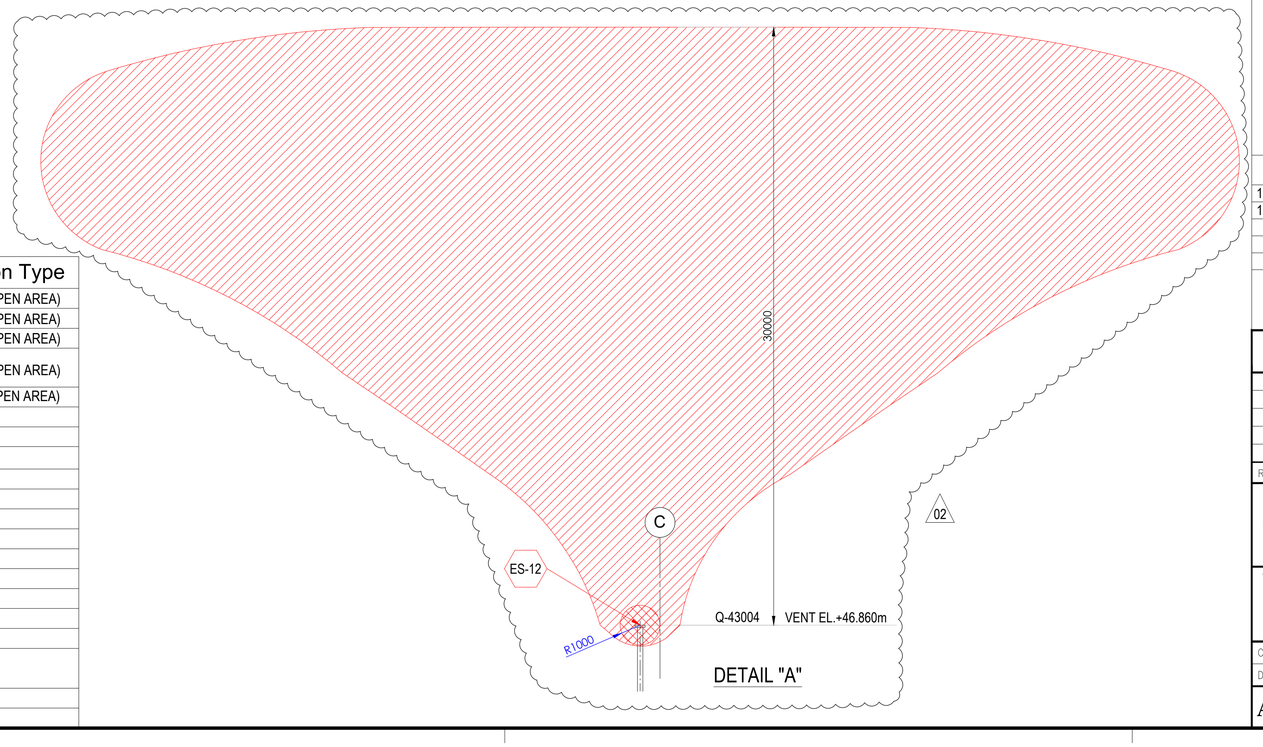



NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. PLATFORM NORTH DIRECTION IS N 25°W.
4. VENT TOP SHALL BE REACHEABLE FOR MAINTENANCE PURPOSE.
5. THE BESS IS CONSIDERED SAFE AREA EXCEPT EXTRACTORES FROM BATTERIES , CURRENTLY NOT SHOWN IN DRAWINGS, SINCE INFORMATION FROM VENDOR IS NOT YET AVAILABLE.[ES17]
6. FOR ES12 PLUME, PLEASE REFER TO THE DETAIL "A" BELOW. (02)
7. THE LOCATION OF EMISSION SOURCES ON THE LAYOUT ARE ONLY INDICATIVE. EMISSION SOURCES CONSIDERED ARE PRESENT WITHIN THE EXTENSION OF HAZARDOUS CLASSIFIED AREAS SHOWN ON THE LAYOUT. THIS IS BECAUSE VALVES AND FLANGES,WHICH ARE CONSIDERED POTENTIAL SOURCES OF RELEASE POINTS FOR FLAMMABLE GAS ARE NOT SHOWN ON CURRENT LAYOUT PROVIDED. THE SAME APPLIES TO THE EMISSION SOURCES FOR CPI'S ITEM.
8. IDENTIFIED EMISSION SOURCES DETAIL

EMISSION SOURCE No.	IDENTIFIED AREAS
ES10	HYDROGEN STORAGE VESSLES
ES11	HYDROGEN VENT KO DRUM
ES12	HYDROGEN VENT
ES16	FUEL CELL

LEGEND

ZONE 0 — ZONE 1

ZONE 2 — ES EMISSION SOURCES

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	15/01/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	27/08/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	08/02/24	MMA	CCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
HAZARDOUS AREA CLASSIFICATION
ELEVATION LOOKING NORTH & EAST

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN M. MAGNI	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 03/07/24

A1 | DRAWING NO. 123A90-DDL-SAF-DL-30024 | SHEET 001 | REV. 02

File Name : 123A90-DDL-SAF-DL-30024 Rev.02

NUOVA GENERAL INSTRUMENTS s.r.l.
LOC. CAMPASSO - 29010 PIANELLO VALTIDONE (PC) Italy - Tel. +39 0523994629 - Fax +39 0523997219
http:// www.nuovageneral.it - E-mail: info@nuovageneral.it - P.IVA 01337040339 - C.F. 01317650065
REA-PC 117793 - Reg. Imp.PC 01317650065 - Capitale Sociale € 100.000,00 i.v.

N. **025308855**

Tipo: (Typ.): **D10/S INOX**

Dis. : **009-0 Rev. 24/10/22**

DICHIARAZIONE DI CONFORMITÁ UE Allegato IV, D. E. 2014/68/UE - Allegato VIII, D.E. 2014/34/UE
DECLARATION OF CONFORMITY EU Annex IV, E. D. 2014/68/EU - Annex VIII, E.D. 2014/34/EU
KONFORMITATSERKLARUNG EU Anlage IV Richtlinie 2014/68/EU - Anlage VIII Richtlinie 2014/34/EU
DECLARATION DE CONFORMITÉ UE Annexe IV D.E. 2014/68/UE - Annex VIII D.E. 2014/34/UE

VALVOLA DI SICUREZZA
SAFETY VALVE
SICHERHEITSVENTIL
SOUPAPE DE SURETE

PROGETTO , COSTRUZIONE E COLLAUDO CONFORME ALLA DIRETTIVA 2014/68/UE - 15/05/14 CATEGORIA IV Modulo H1
DESIG , MANUFACTURE AND TEST ACCORDING TO 2014/68/EU DIRECTIVE - 15/05/14 CLASS IV Module H1
PROJEKT , KONSTRUKTION UND ABNAHMEPRUFUNG GEMAB EG-RICHTLINIE 2014/68/EU - 15/05/14 KATEGORIE IV Formblatt H1
PROJET,FABRICATION ET VERIFICATION CONFORME A LA DIRECTIVE 2014/68/UE-15/05/14 CATEGORIE IV Module H1

Garanzia qualità totale Nr. : **Full quality assurance system Nr. :**
Garantie gesamte Qualität Nr. : **Garantie qualité totale Nr.:**
Module H1 : DGR-0036-QS-1180-24

Norme e spec. utilizzate : (Codes or spec.ref.) : *(Angewandte normen und spezifikationen) :* (Regulements et spec. utilise):
AD-Merkblatt A2 - VdTUV-Merkblatt Sicherheitsventil 100 / Racc."E"1979 / EN80079-36:2016 -37:2016 / ISO4126-1 / AS1271:2003 / EN13648-1 / UNI 10197

Organismo notificato: (Notified body): *(Meldestelle):* (Organisme agree):
TÜV SÜD Industrie Service GmbH
Westendstraße 199
D 80686 Munich
0036


II 2G Ex h IIC T6 Gb X
File : TÜV IT 18 ATEX 032 AR

Questa dichiarazione di conformità è rilasciata sotto la sola responsabilità del produttore. - *This declaration of conformity is issued under the sole responsability of the manufacturer.* - Diese Konformitätserklärung wird unter der alleinigen Verantwortung des Herstellers ausgestellt.
Cette déclaration de conformité est émise sous la seule responsabilité du fabricant.

Fluido - *Fluid* - **Fluide**
G / S / L
Group 1 or 2

- Marchio del costruttore: (Manifacturer's Mark): *(Herstellerzeichen):* **(Marquae du constructeur)**

- Materiali: (Material): *(Material):* **(Matériaux):**

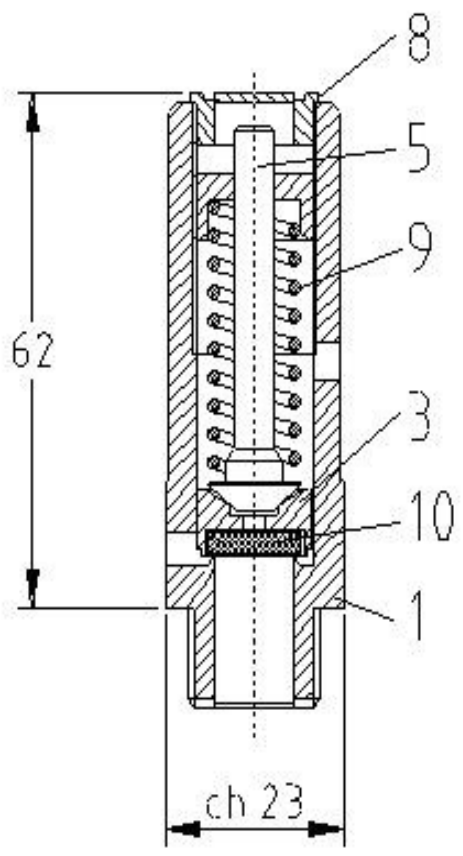

1- UNI EN 10088 1.4404
3- UNI EN 10088 1.4404
5- UNI EN 10088 1.4404
8- UNI EN 10088 1.4404
9- UNI EN 10270-3 1.4310

10 VITON (-20 / +200 °C)

Anno costruzione:
(Year of manufacture):
(Baujahr):
(Annee de fabrication):
2025

- P.N.: **60** *(Nenndruck):*

- h / do: **0,4**

- D.N.: (Nominal Diameter): *(Anschlusgewinde):* **(D.N):**

- Entrata: (In): *(Eintritt):* **(Entre):** **1/2" NPT**

- Uscita: (Out): *(Austritt):* **(Sortie):**

- Diametro orifizio: do (Opening diameter): do *(Innen durchmrsser): do* **(Diametre orifice):do** **10** mm

- Area: (Area): *(Offnung):* **(Surface):** **0,785** cm²

- Alzata: h (Valve Lift): h *(Hub): h* **(Haussement): h** **4** mm

- Limiti di temperatura di esercizio dei materiali utilizzati a pressione atmosferica: (Operating temperature limits for materials used at atmospheric pressure): **-20 / +200 °C** *(Betriebstemperaturgrenze der unter Luftdruck verwendeten Materialien):* **(Limites de température de fonctionnement des matériaux utilisés sous pression atmosphérique):**

- Coefficiente di efflusso : (Flow coefficient.): *(AusfluBziffer.):* **(Coefficient d'écoulement** **Kd 0,86**

- Coefficiente di efflusso ridotto : (Reduced flow coefficient): *(Reduzierte Ausflußziffer):* **(Coefficient d'écoulement réduit** **Kdr = 0,9xKd = 0,77**

- Pressione di taratura: (Setting Pressure): *(Abgleichungssdruck):* **(Pression de tarage):** **4,7** bar g

- Variabilità campo di taratura: (Variability Setting Filed): *(Abgleichungsberelch):* **(Variabilite champ de tarage):** **3,1 - 5** bar g

- Sovrappressione: (Overpressure): *(Uber-Unterdruck):* **(Surpression):** **10%** % della pressione di taratura (% of Setting Pressure) *(% Abgieichungsdruck)* **(% De la pression de tarage)**

- Scarto di chiusura: (Closing variation): *(Unterdruck):* **(Ecart de fermature):** **15%** % della pressione di taratura (% of Setting Pressure) *(% Abgieichungsdruck)* **(% De la pression de tarage)**

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide): **ARIA-AIR-LUFT** Temper. : **0** °C

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** **328,02** kg/h **253,73** Nm³ / h **4228,82** lt/min.

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide):

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** kg/h Nm³ / h lt/min.

TIPO FLUIDO: (FLUID TYPE): *(MEDIUM):* (Type de fluide):

- Scarico in atmosfera: (Discharge in Atmosphere): *(AbfluB gegen Atmosphare):* **(Decharge en atmosphere):** kg/h Nm³ / h lt/min.

Si dichiara che la valvola ha subito con buon esito il controllo finale compreso il test di tenuta (90% Pset) e la prova idraulica del corpo a 1,5 x P.N.
We declare that this valve has passed successfully the test, the seat tightness test (90% Pset) and the hydraulic test of the body to 1,5 x P.N.
Hiermit bestätigen wir, dass das Ventil die Abschlusskontrolle einschließlich der Sitzdichtheit (90%Pset) und hydraulischen Gehäuseprüfung mit einem Druck von 1,5 x P.N.
On declare que la soupape a ete soumise avec resultat satisfiant a le control final y-compri l'epreuve d'étanchéité (90% Pset) et l'epreuve hydraulique du corps a 1,5xPN.

EN 10204 3.1 Cod. : **00F16D10SSVNPAX047**

Nr.Ord. : D2500700 REV 1

S.V. Code : 00F16D10SSVNPAX047

Date : 17/04/2025

NUOVA GENERAL INSTRUMENTS SRL
Albertini Patrizia (CEO)

NUOVA GENERAL INSTRUMENTS

	I Descrizione ATEX-UKEX	GB Atex-UKEX Description	D *Beschreibung ATEX-UKEX*	F Description ATEX-UKEX	ES Descripción ATEX-UKEX
	Simbolo rappresentativo per dispositivi certificati ATEX-UKEX	Representative symbol of ATEX-UKEX certified equipment	*Repräsentatives Symbol für ATEX-UKEX zertifizierte Geräte*	Symbole représentatif des équipements certifiés ATEX-UKEX	*Símbolo representativo para dispositivos con certificación ATEX-UKEX*
II	Gruppo dell'apparecchio	Equipment's group	*Gerätegruppe*	Groupe d'appareils	*Grupo de dispositivos*
2	Categoria dell'apparecchio	Equipment's category	*Gerätekategorie*	Catégorie d'appareils	*Categoría de dispositivos*
G	Protezione delle atmosfere esplosive dovute a presenza di GAS, VAPORI E NEBBIE	Protected to explosive atmosphere due to GAS, STEAM and FOG	*Schutz explosionsfähiger Atmosphären durch GAS, DAMPF UND NEBEL*	Protection des atmosphères explosives grâce à la présence de GAZ, VAPEURS ET BROUILLARDS	*Protección de atmósferas explosivas debido a la presencia de GAS, VAPOR Y NIEBLA*
GD	Protezione delle atmosfere esplosive dovute a presenza di GAS, VAPORI, NEBBIE, NUBI e POLVERI	Protected to explosive atmosphere due to GAS, STEAM, FOG and DUST	*Schutz explosionsfähiger Atmosphären durch GAS, DAMPF, NEBEL, WOLKEN und PULVER*	Protection des atmosphères explosives grâce à la présence de GAZ, VAPEURS, BROUILLARDS, NUAGES et POUSSIÈRES	*Protección de atmósferas explosivas debido a la presencia de GAS, VAPORES, NIEBLA, NUBES y POLVO*
Ex h (Type of protection "c" constructional safety)	Indicazione di apparecchiatura non elettrica	Non-electrical equipment indication	*Hinweis auf nichtelektrische Geräte*	Indication des équipements non électriques	*Indicación de equipos no eléctricos*
IIC	Sottodivisione del gruppo di apparecchi	Equipment group subdivision	*Unterteilung der Gerätegruppe*	Subdivision du groupe d'appareils	*Subdivisión del grupo de dispositivos*
T6	Temperatura massima di parete ≤85°C	Maximum surface temperature ≤85°C	*Maximale Oberflächentemperatur ≤85 ° C*	Température maximale de paroi ≤85 ° C	*Temperatura máxima de la pared ≤85 ° C*
Gb	Equipment Protection Level (EPL)	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*
GbDb	Equipment Protection Level (EPL)	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*	Equipment Protection Level (EPL)	*Equipment Protection Level (EPL)*
X	La massima temperatura superficiale potrebbe essere superiore alla classe di temperatura, si raccomanda come massima temperatura il valore maggiore tra T6 e la max Temperatura ammissibile per la tenuta (V. COC)	The max surface temperature could be higher than the temperature class, it is recommended as max temperature the higher value between T6 and the max Admissible temperature for the seal (V. COC)	*Die max. Oberflächentemperatur kann höher sein als die Temperaturklasse, als max. Temperatur wird der höhere Wert zwischen T6 und der max. zulässigen Temperatur für die Dichtung (V. COC) empfohlen.*	La température de surface maximale peut être supérieure à la classe de température, il est recommandé comme température maximale la valeur la plus élevée entre T6 et la température maximale admissible pour le joint (V. COC)	*La temperatura máxima de la superficie podría ser superior a la clase de temperatura, se recomienda como temperatura máxima el valor más alto entre T6 y la temperatura máxima admisible para el sello (V. COC)*

Rotork Fluid Systems s.r.l.
Via padre Jacques Hamel, 138 B
55016 Porcari, Lucca
Italy

Tel. +39 0583 2221
Fax. +39 0585 091362
http://www.rotork.com

rotork
Fluid Systems

DECLARATION

Rotork Fluid Systems s.r.l. herewith declares that for the job AF7703, as the supplier of the following equipment:

Product: Safety Relief Valve (PSV)
Type/Model: D10/S INOX
Serial Number(s): 025308828; 025308829; 025308830; 025308831; 025308832; 025308833; 025308834; 025308835; 025308836; 025308837; 025308838; 025308839; 025308840; 025308841; 025308842; 025308843; 025308844; 025308845; 025308846; 025308847; 025308848; 025308849; 025308850; 025308851; 025308852; 025308853; 025308854; 025308855.
Intended Use: Installation in ATEX Zone 2 – Gas Group IIC / IIB + H_2
Category: II 2G
Protection Type: Ex h IIC T6 Gb X (non-electrical equipment)

Hereby declares under its sole responsibility that the above equipment has been purchased in full compliance with the requirements of:

- Directive 2014/34/EU (ATEX)
- Harmonised standards: EN ISO 80079-36:2016 and EN ISO 80079-37:2016
- The relevant essential health and safety requirements as set out in Annex II of Directive 2014/34/EU.

This product is not yet in service and is currently installed but not operational. According to applicable legislation and guidance (including the Blue Guide 2022 and ATEX Guidelines 3rd Edition, July 2023), the CE and ATEX markings can be legitimately applied, even if the equipment has already been installed.
The conformity assessment procedure followed is: Internal production control (Annex VIII – Module A), with the technical documentation deposited with the Notified Body:
Notified Body: TUV SUD Italia – NB N° 0948
Reference: TUV IT 18 ATEX 032 AR
We hereby authorise the application of the ATEX marking in situ, under our responsibility, following the above.
This declaration is issued under the sole responsibility of the supplier.

Lucca, 18/04/2025

On behalf of Rotork Fluid Systems s.r.l.

Lucia Fregoli – Quality Manager

Section 6 MECHANICAL COMPLETION STATUS INDEX - INSTRUMENTAL DISCIPLINE

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

STATUS INDEX DETAIL

Filtered on subsystem: 25-07 & process: MC & discipline : I

Instrumental	25-07 Hydrogen Storage Vessels Header (Inlet)						
ITEM		TASK					
Code	Description	Location	Code	Form	Progress	Date	Certificate
25-PT-001	Pressure Transmitter - Hyrogen to Vessels Inlet Header	ONSHORE	C10000922	TJX04	100	2024-10-02	RFC 1
25-PT-002	Pressure Transmitter - Hyrogen to Vessels Inlet Header Shut-Down	ONSHORE	C10000923	TJX04	100	2024-10-11	RFC 1
25-RO-024	Restriction Orifice - Hyrogen to vessels inlet header vent system	ONSHORE	C10001208	CJX11	100	2025-02-07	RFC 1
		ONSHORE	C10001436	TJX11	100	2024-12-19	RFC 1
AV-63001/25-XV-008	Pneumatic Connection Air Supply - 25-XV-008	ONSHORE	C10001942	CJX06	100	2025-02-04	RFC 1
AV-63001/25-XV-011	Pneumatic Connection Air Supply - 25-XV-011	ONSHORE	C10001940	CJX06	100	2025-01-30	RFC 1
AV-63002/25-XV-014	Pneumatic Connection Air Supply - 25-XV-014	ONSHORE	C10001948	CJX06	100	2025-02-04	RFC 1
AV-63002/25-XV-017	Pneumatic Connection Air Supply - 25-XV-017	ONSHORE	C10001946	CJX06	100	2025-02-04	RFC 1
AV-63002/25-XV-020	Pneumatic Connection Air Supply - 25-XV-020	ONSHORE	C10001944	CJX06	100	2025-02-04	RFC 1
AV-63010/25-SDV-001	Pneumatic Connection Air Supply - 25-SDV-001	ONSHORE	C10001973	CJX06	100	2025-01-30	RFC 1
AV-63010/25-XV-004	Pneumatic Connection Air Supply - 25-XV-004	ONSHORE	C10001975	CJX06	100	2025-01-30	RFC 1
AV-63010/25-XV-024	Pneumatic Connection Air Supply - 25-XV-024	ONSHORE	C10001974	CJX06	100	2025-02-04	RFC 1
C-25-PT-001/00-JE-11003	PRESSURE TRANSMITTER / MARSHALLING PCS	ONSHORE	C10000048	CJX10	100	2025-02-08	RFC 1
C-25-PT-002/00-JE-21002	PRESSURE TRANSMITTER / MARSHALLING PCS	ONSHORE	C10000136	CJX10	100	2025-02-08	RFC 1
C-25-SDV-001/00-JE-22002	PROXIMITY SWITCH / MARSHALLING PCS	ONSHORE	C10000154	CJX10	100	2025-01-30	RFC 1
C-25-SDY-001/00-JE-23002	SOLENOID VALVE / MARSHALLING PCS	ONSHORE	C10000176	CJX10	100	2025-02-05	RFC 1
C-25-XV-004/00-JE-12004	PROXIMITY SWITCH / MARSHALLING PCS	ONSHORE	C10000084	CJX10	100	2025-01-29	RFC 1
C-25-XV-008/00-JE-12004	PROXIMITY SWITCH / MARSHALLING PCS	ONSHORE	C10000085	CJX10	100	2025-01-29	RFC 1
C-25-XV-011/00-JE-12004	PROXIMITY SWITCH / MARSHALLING PCS	ONSHORE	C10000086	CJX10	100	2025-01-29	RFC 1
C-25-XV-014/00-JE-12004	PROXIMITY SWITCH / MARSHALLING PCS	ONSHORE	C10000087	CJX10	100	2025-01-29	RFC 1
C-25-XV-017/00-JE-12004	PROXIMITY SWITCH / MARSHALLING PCS	ONSHORE	C10000088	CJX10	100	2025-02-05	RFC 1
C-25-XV-020/00-JE-12004	PROXIMITY SWITCH / MARSHALLING PCS	ONSHORE	C10000089	CJX10	100	2025-01-29	RFC 1
C-25-XV-024/00-JE-12005	PROXIMITY SWITCH / MARSHALLING PCS	ONSHORE	C10000102	CJX10	100	2025-01-30	RFC 1
C-25-XY-004/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	ONSHORE	C10000118	CJX10	100	2025-01-29	RFC 1
C-25-XY-008/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	ONSHORE	C10000119	CJX10	100	2025-01-29	RFC 1
C-25-XY-011/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	ONSHORE	C10000120	CJX10	100	2025-02-05	RFC 1
C-25-XY-014/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	ONSHORE	C10000121	CJX10	100	2025-01-29	RFC 1
C-25-XY-017/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	ONSHORE	C10000122	CJX10	100	2025-01-29	RFC 1
C-25-XY-020/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	ONSHORE	C10000123	CJX10	100	2025-01-29	RFC 1

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

STATUS INDEX DETAIL

Filtered on subsystem: 25-07 & process: MC & discipline : I

Instrumental	25-07 Hydrogen Storage Vessels Header (Inlet)						
ITEM		TASK					
Code	Description	Location	Code	Form	Progress	Date	Certificate
C-25-XY-024/00-JE-13002	SOLENOID VALVE / MARSHALLING PCS	ONSHORE	C10000124	CJX10	100	2025-01-30	RFC 1

ROSETTI MARINO

CROSSWIND

ITEM	Tag	C-25-PT-001/00-JE-11003	: PRESSURE TRANSMITTER / MARSHALLING PCS		Dwg	123A90-DDL-IN-LIS-40091	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10000048	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline Instrumental	Form	CJX10	Multi/Single-Core Instrument Control Cable

CABLE DATA

Type	Cu-XLPE-OS-LSZH-SWB-LSZH	Cores/Size mm²	1X2X0,75 mm2	Color	GREY
From	25-PT-001	To	00-JE-11003		

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	PL
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	PL
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH		>999	MΩ
	CORE to CORE		>999	MΩ
	CORE to SCREEN		>999	MΩ
	CORE to ARMr		>999	MΩ
	SCREEN to EARTH		>999	MΩ
	SCREEN to ARMr		>999	MΩ
CONTINUITY	CORES		0,7	Ω
	SCREEN		0,7	Ω
	EARTH		NA	Ω
	ARMr		0,7	Ω
	TEST VOLTS		500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 Calibration date: N°LAT 042 00768/24 12/10/2024

Comments Nota 5: refer to PL C30000682

Page 1/1	Performed by	☉ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-02-07	2025-02-08	
Signature	Digitaly signed by Michele Tartaglia 2025-02-07T13:23:25.818Z	Digitaly signed by Alessio Polo 2025-02-08T10:25:14.780Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

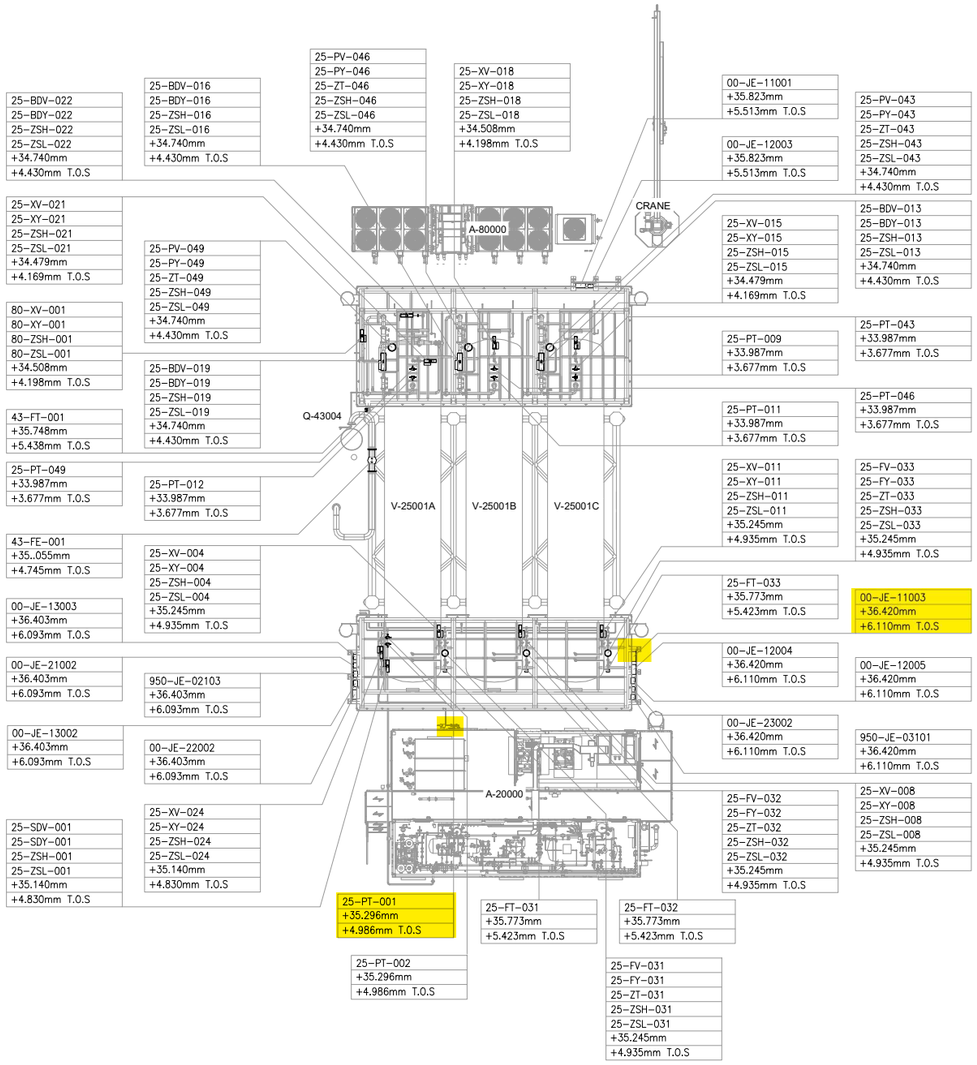

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90–DDL–IN–DL–40081	SHEET 002	REV. 02


File Name : 123A90-DDL-IN-DL-40081 REV02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-11003	No.	MARSHALLING CABINET B400-PCS-002

<01>

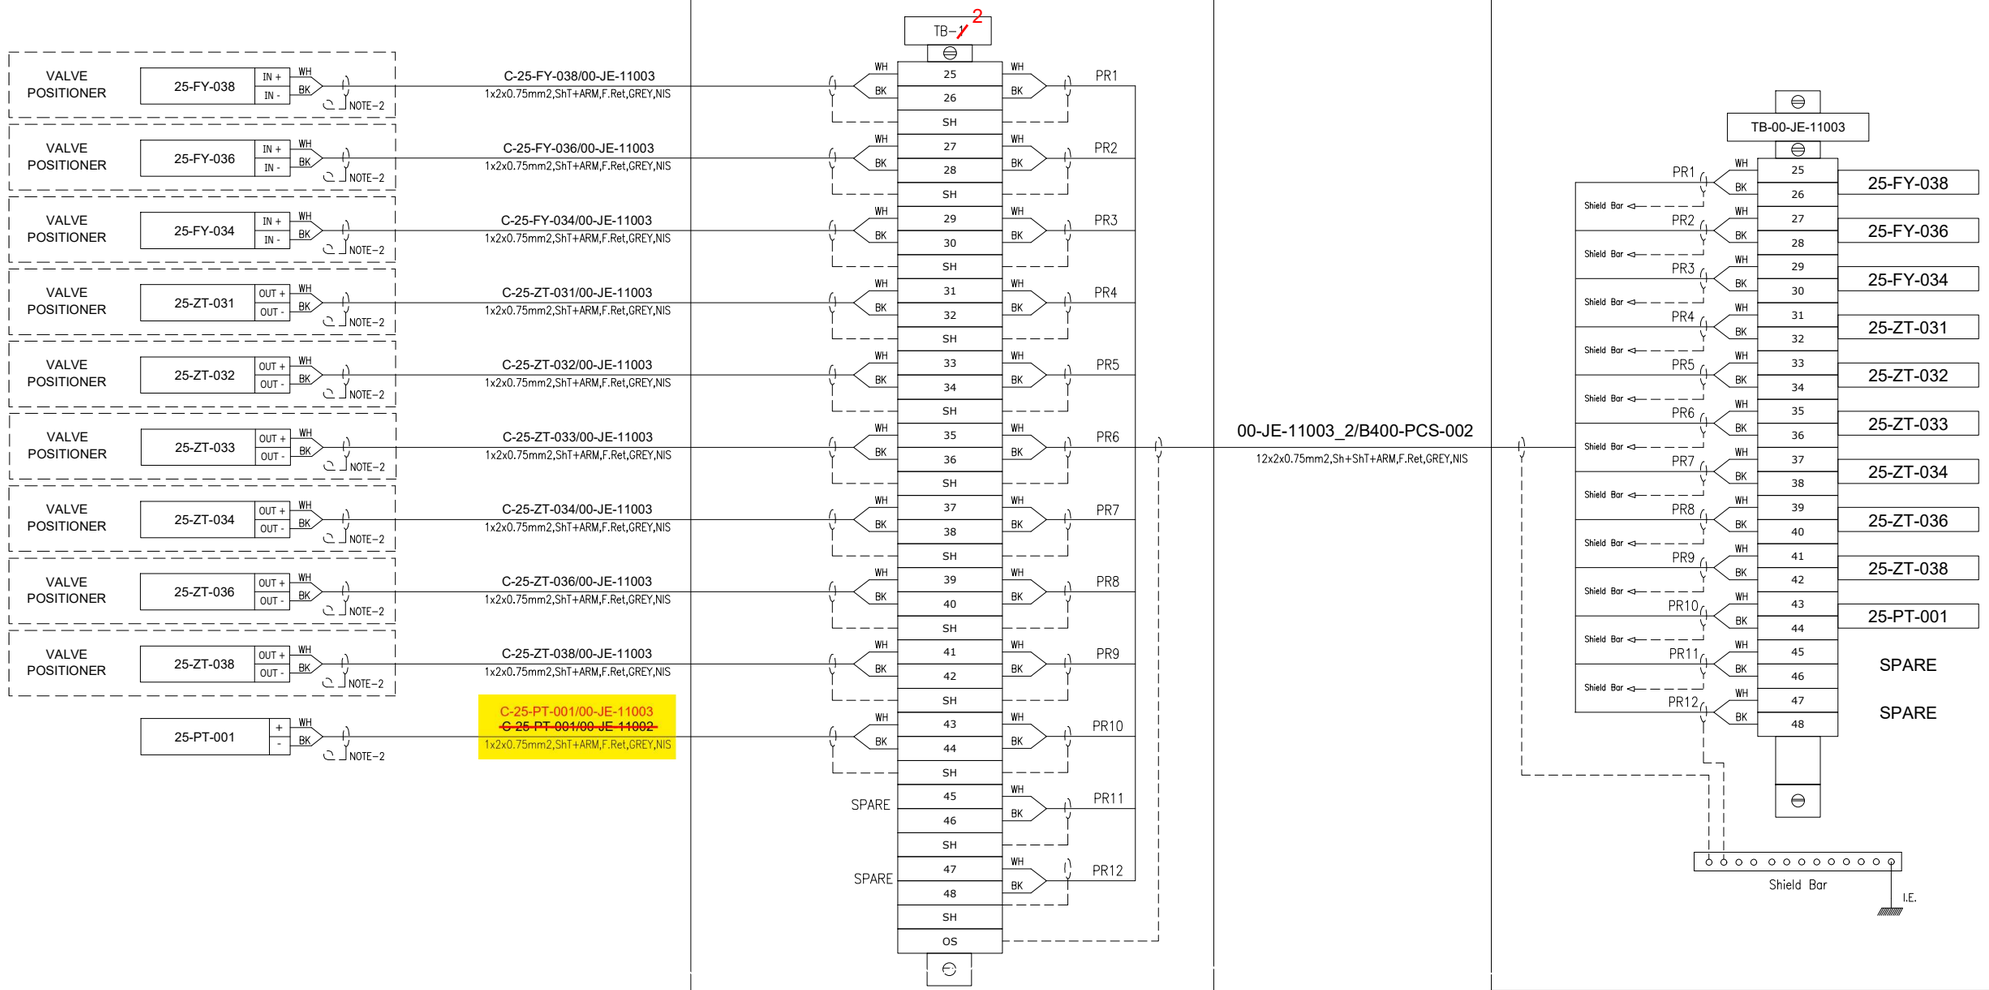

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_I	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00–JE–11003–SH.2 OF 2

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123–A90–DDL–IN–40015	SHEET 008	REV. 01


File Name : 123A90-DDL-IN-DG-40015_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

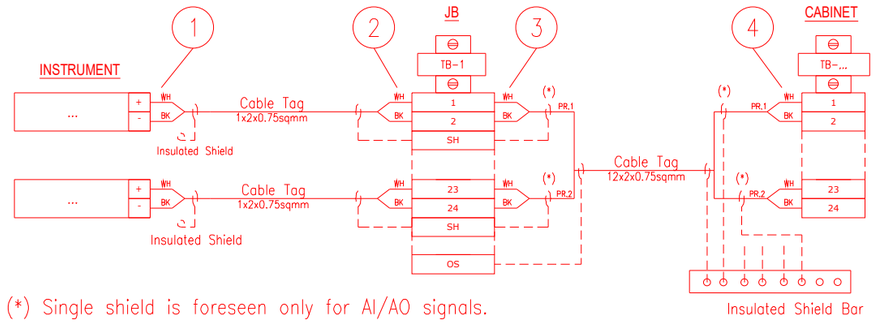

INSTRUMENT CONNECTION STRAIGHT TO CABINET



CABINET CONNECTION TO CABINET



1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_I	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO.	SHEET	REV.
	123A90-DDL-IN-DG-40015	003	01


File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Discipline	Eng Status	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland Standard	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-PT-001/00-JE-11003	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-PT-001	Pressure Transmitter	Upper Deck	00-JE-11003	AI/AO JB to PCS	Upper Deck	SMICV01-1X2X0,75	Cable Cu Cl.2/XLPE/OS/LSZH/SWB/LSZH 150/250V (300V) 1x2x0,75mm² - Grey	M20S	T2_M20S_Double			T2_M20S_Double				U-SEC-16 / U-SEC-14C / U-SEC-14D / U-SEC-14E / U-SEC-14F

FLEI s.r.l.

Cu Cl.2/XLPE/OS/LSZH/SWB/LSZH 150/250 V (300 V)

1X2X0,75 - INSTRUMENT CABLE - Flame Retardant - Not I.S.

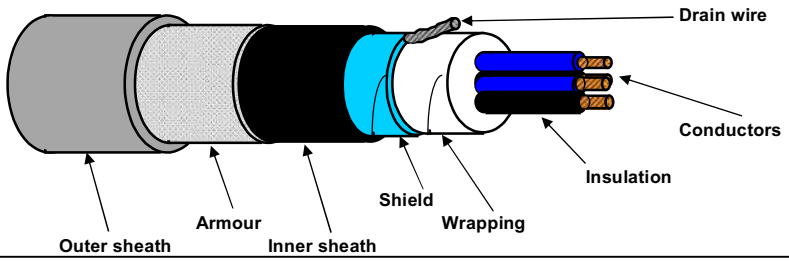

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	XLPE, Nominal Thickness 0,5 mm	
Cores colour code :	**White - Black**	
Pair Assembling :	Not required	
Pair Wrapping:	Not required	
Drain wire :	Not required	
Pair Shield :	Not required	
Shield Insulation :	Not required	
Total Assembling :	13/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,0 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant,	
	Average Thickness 1,1 mm	
Outer sheath color code:	**Grey**	
Outer printing (INKJET) :	**FLEI - 1X2X0,75 SQMM - XLPE/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60332.1.2 - IEC 60332.3.22 -**	
(every 1000 mm)	**Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(6,5 ± 10%) mm	
Over armour diameter :	(7,3 ± 10%) mm	
Outer diameter :	(9,5 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 26 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Mutual Capacitance :	≤ 150 nF/km	
L/R ratio :	≤ 25 µH/Ω	
Inductance :	≤ 0,9 mH/km	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided, lending assent for the treatment, will be used to the sense of the article 13 of of the Regulation (UE) 2016/679, also through outsiders, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	C-25-XV-004/00-JE-12004	: PROXIMITY SWITCH / MARSHALLING PCS		Dwg	123A90-DDL-IN-LIS-40091	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10000084	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline Instrumental	Form	CJX10	Multi/Single-Core Instrument Control Cable

CABLE DATA

Type	Cu-XLPE-IS-OS-LSZH-SWB-LSZH	Cores/Size mm²	2X2X0,75 mm2	Color	GREY
From	25-XV-004	To	00-JE-12004		

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	Note
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH		>999	MΩ
	CORE to CORE		>999	MΩ
	CORE to SCREEN		>999	MΩ
	CORE to ARMr		>999	MΩ
	SCREEN to EARTH		>999	MΩ
	SCREEN to ARMr		>999	MΩ
CONTINUITY	CORES		0,2	Ω
	SCREEN		0,2	Ω
	EARTH		NA	Ω
	ARMr		0,2	Ω
	TEST VOLTS		500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 Calibration date: N°LAT 042 00768/24 12/10/2024

Comments Nota 5: refer to PL C30000682

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-25	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-25T13:24:37.418Z	PROVERLIS Digitaly signed by Alessio Polo 2025-01-29T11:11:43.186Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

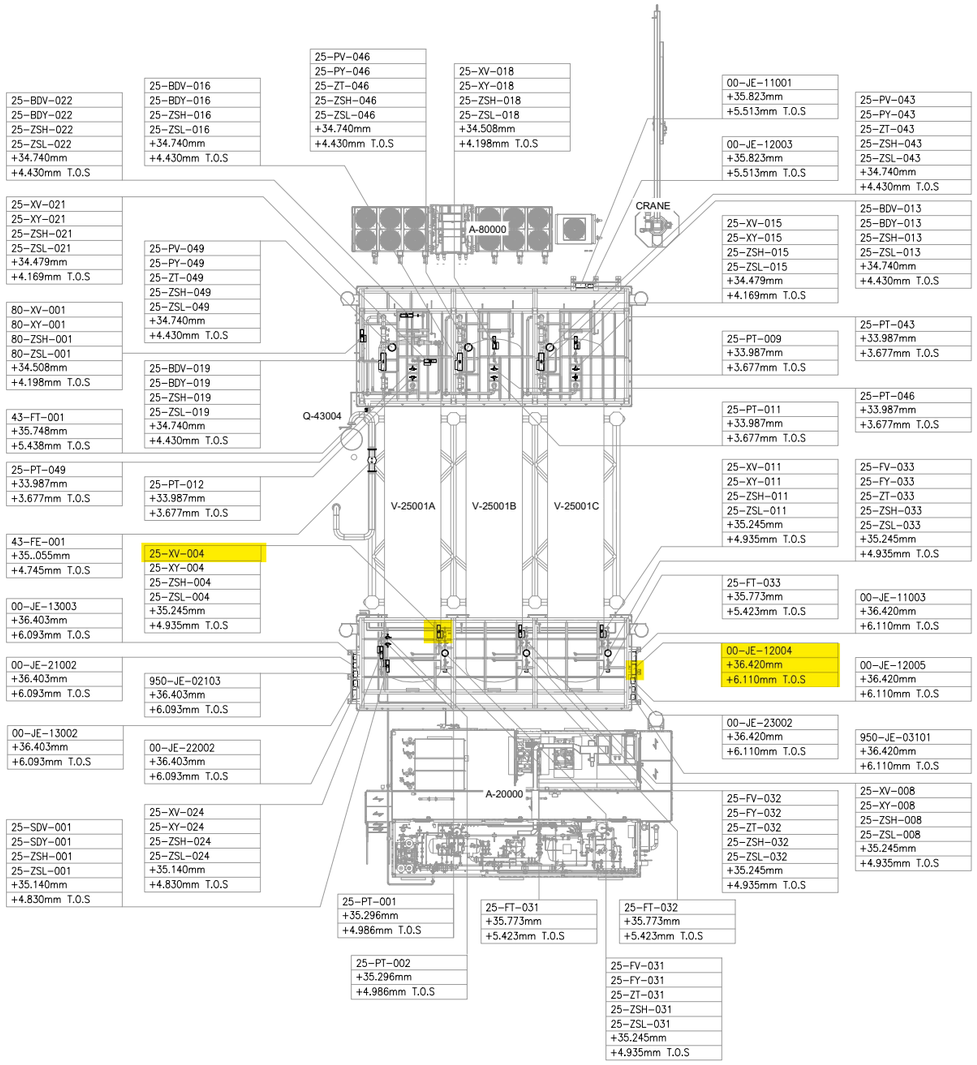

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90–DDL–IN–DL–40081	002	02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-12004	No.	MARSHALLING CABINET B400-PCS-002

<01>

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-004 (1, 2) WH BK PR1
- 25-ZSH-004 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-004/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-008 (1, 2) WH BK PR1
- 25-ZSH-008 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-008/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-011 (1, 2) WH BK PR1
- 25-ZSH-011 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-011/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-014 (1, 2) WH BK PR1
- 25-ZSH-014 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-014/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-017 (1, 2) WH BK PR1
- 25-ZSH-017 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-017/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-1

WH/BK	1	WH/BK	PR1
	2		
	SH		
WH/BK	3	WH/BK	PR2
	4		
	SH		
WH/BK	5	WH/BK	PR3
	6		
	SH		
WH/BK	7	WH/BK	PR4
	8		
	SH		
WH/BK	9	WH/BK	PR5
	10		
	SH		
WH/BK	11	WH/BK	PR6
	12		
	SH		
WH/BK	13	WH/BK	PR7
	14		
	SH		
WH/BK	15	WH/BK	PR8
	16		
	SH		
WH/BK	17	WH/BK	PR9
	18		
	SH		
WH/BK	19	WH/BK	PR10
	20		
	SH		
SPARE	21	WH/BK	PR11
	22		
	SH		
SPARE	23	WH/BK	PR12
	24		
	SH		
	OS		

00-JE-12004_1/B400-PCS-002
12x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-00-JE-12004

PR1 WH/BK	1	25-ZSL-004
Shield Bar	2	
PR2 WH/BK	3	25-ZSH-004
Shield Bar	4	
PR3 WH/BK	5	25-ZSL-008
Shield Bar	6	
PR4 WH/BK	7	25-ZSH-008
Shield Bar	8	
PR5 WH/BK	9	25-ZSL-011
Shield Bar	10	
PR6 WH/BK	11	25-ZSH-011
Shield Bar	12	
PR7 WH/BK	13	25-ZSL-014
Shield Bar	14	
PR8 WH/BK	15	25-ZSH-014
Shield Bar	16	
PR9 WH/BK	17	25-ZSL-017
Shield Bar	18	
PR10 WH/BK	19	25-ZSH-017
Shield Bar	20	
PR11 WH/BK	21	SPARE
Shield Bar	22	
PR12 WH/BK	23	SPARE
	24	

Shield Bar
I.E.

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-12004-SH.1 OF 2

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 019	REV. 01


File Name : 123A90-DDL-IN-DG-40015_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

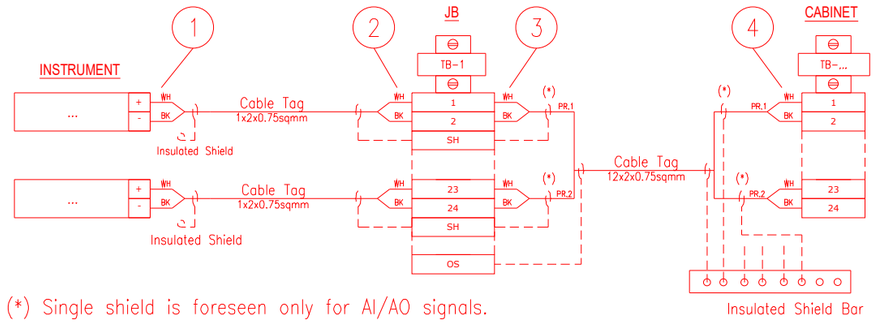

INSTRUMENT CONNECTION STRAIGHT TO CABINET



CABINET CONNECTION TO CABINET



1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 003	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Discipline	Eng Status	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland Standard	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-XV-004/00-JE-12004	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-XV-004	On/Off Valve	Upper Deck	00-JE-12004	DI JB to PCS	Upper Deck	SMICV02-2X2X0,75	Cable Cu Cl.2/XLPE/IS/OS/LSZH/SWB/LSZH 150/250V (300V) 2x2x0,75mm² - Grey	M20	T2_M20_Double			T2_M20_Double				U-SEC-17 / U-SEC-14D / U-SEC-14E / U-SEC-14F

Cu Cl.2/XLPE/IS/OS/LSZH/SWB/LSZH 150/250 V (300 V)

2X2X0,75 - INSTRUMENT CABLE - Flame Retardant - Not I.S.

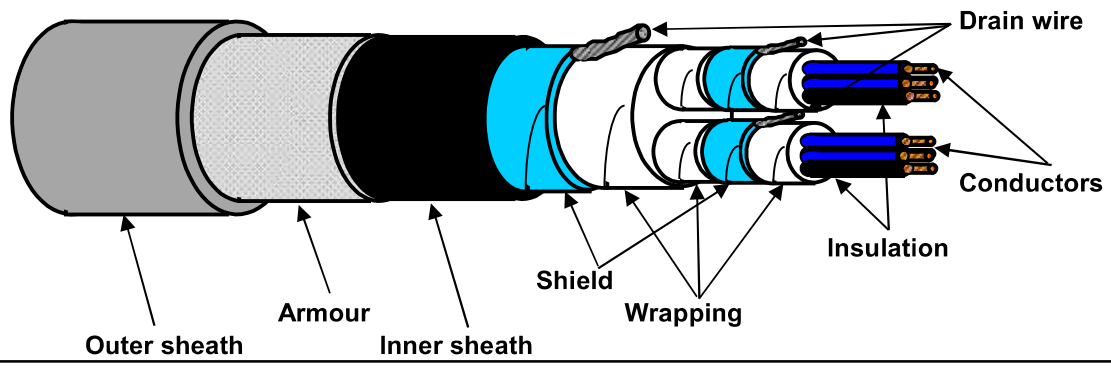

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	XLPE, Nominal Thickness 0,5 mm	
Cores colour code :	**White - Black (each core NUMBERED for PAIR identification)**	
Pair Assembling :	13/1mt	
Pair Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Pair Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Shield Insulation :	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Total Assembling :	7/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,2 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant, Average Thickness 1,3 mm	
Outer sheath color code:	**Grey**	
Outer printing (INKJET) :	**FLEI - 2X2X0,75 SQMM - XLPE/IS/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60332.1.2 - IEC 60332.3.22 -**	
(every 1000 mm)	**Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(11,4 ± 10%) mm	
Over armour diameter :	(12,6 ± 10%) mm	
Outer diameter :	(15,2 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 26 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Mutual Capacitance :	≤ 150 nF/km	
L/R ratio :	≤ 25 µH/Ω	
Inductance :	≤ 0,9 mH/km	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided, lending assent for the treatment, will be used to the sense of the article 13 of of the Regulation (UE) 2016/679, also through outsiders, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	C-25-XV-008/00-JE-12004	: PROXIMITY SWITCH / MARSHALLING PCS	Dwg	123A90-DDL-IN-LIS-40091		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10000085	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX10

Multi/Single-Core Instrument Control Cable

CABLE DATA

Type: Cu-XLPE-IS-OS-LSZH-SWB-LSZH | Cores/Size mm²: 2X2X0,75 mm2 | Color: GREY

From: 25-XV-008 | To: 00-JE-12004

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	Note
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH		>999	MΩ
	CORE to CORE		>999	MΩ
	CORE to SCREEN		>999	MΩ
	CORE to ARMr		>999	MΩ
	SCREEN to EARTH		>999	MΩ
	SCREEN to ARMr		>999	MΩ
CONTINUITY	CORES		0,4	Ω
	SCREEN		0,4	Ω
	EARTH		NA	Ω
	ARMr		0,4	Ω
	TEST VOLTS		500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 | Calibration date: N°LAT 042 00768/24 12/10/2024

Comments: Nota 5: refer to PL C30000682

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-28	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-28T07:44:14.273Z	PROVERLIS Digitaly signed by Alessio Polo 2025-01-29T12:18:49.073Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

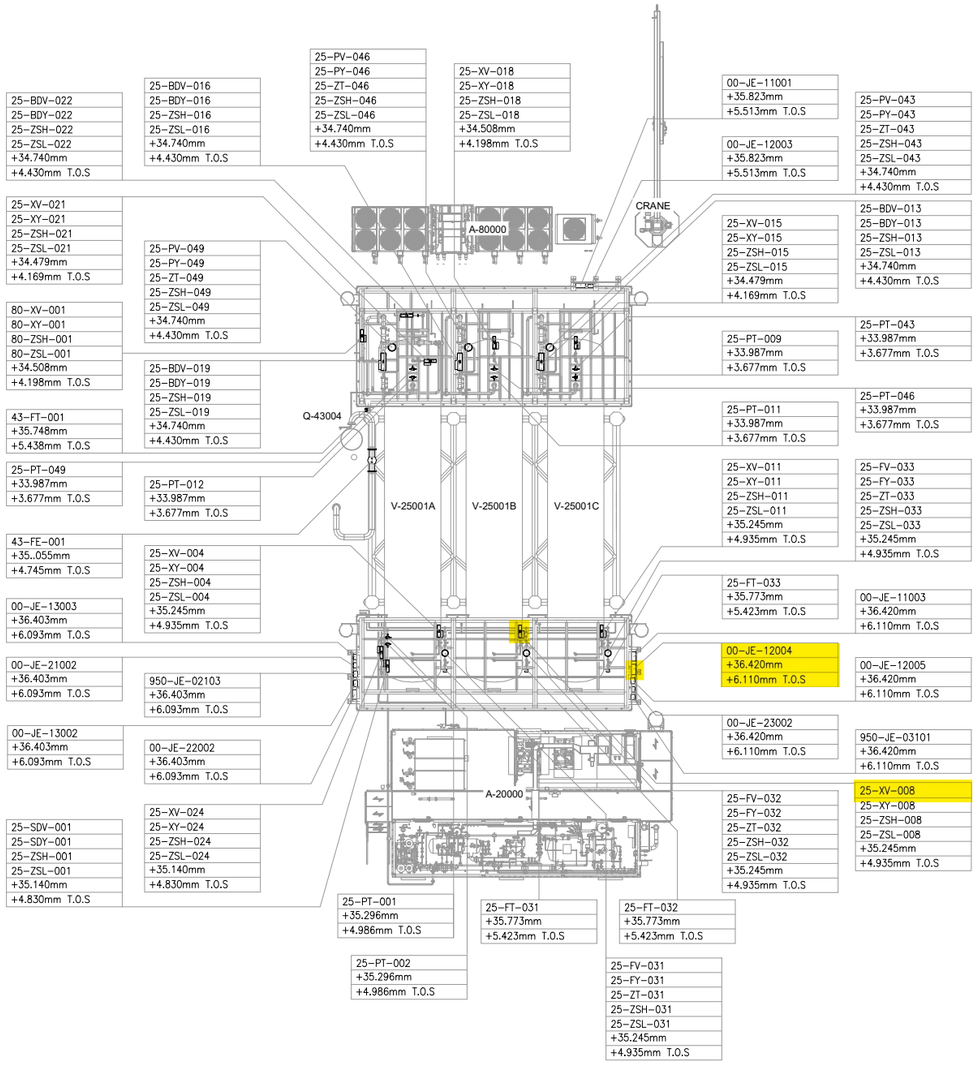

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081
REV.: 2_A | DATE: 07/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90–DDL–IN–DL–40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-12004	No.	MARSHALLING CABINET B400-PCS-002

<01>

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-004 (1, 2) WH BK PR1
- 25-ZSH-004 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-004/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-008 (1, 2) WH BK PR1
- 25-ZSH-008 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-008/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-011 (1, 2) WH BK PR1
- 25-ZSH-011 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-011/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-014 (1, 2) WH BK PR1
- 25-ZSH-014 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-014/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-017 (1, 2) WH BK PR1
- 25-ZSH-017 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-017/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-1

WH BK	1	WH BK	PR1
	2		
	SH		
WH BK	3	WH BK	PR2
	4		
	SH		
WH BK	5	WH BK	PR3
	6		
	SH		
WH BK	7	WH BK	PR4
	8		
	SH		
WH BK	9	WH BK	PR5
	10		
	SH		
WH BK	11	WH BK	PR6
	12		
	SH		
WH BK	13	WH BK	PR7
	14		
	SH		
WH BK	15	WH BK	PR8
	16		
	SH		
WH BK	17	WH BK	PR9
	18		
	SH		
WH BK	19	WH BK	PR10
	20		
	SH		
SPARE	21	WH BK	PR11
	22		
	SH		
SPARE	23	WH BK	PR12
	24		
	SH		
	OS		

00-JE-12004_1/B400-PCS-002
12x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-00-JE-12004

PR1 WH BK	1	25-ZSL-004
Shield Bar	2	
PR2 WH BK	3	25-ZSH-004
Shield Bar	4	
PR3 WH BK	5	25-ZSL-008
Shield Bar	6	
PR4 WH BK	7	25-ZSH-008
Shield Bar	8	
PR5 WH BK	9	25-ZSL-011
Shield Bar	10	
PR6 WH BK	11	25-ZSH-011
Shield Bar	12	
PR7 WH BK	13	25-ZSL-014
Shield Bar	14	
PR8 WH BK	15	25-ZSH-014
Shield Bar	16	
PR9 WH BK	17	25-ZSL-017
Shield Bar	18	
PR10 WH BK	19	25-ZSH-017
Shield Bar	20	
PR11 WH BK	21	SPARE
Shield Bar	22	
PR12 WH BK	23	SPARE
	24	

Shield Bar
I.E.

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-12004-SH.1 OF 2

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 019	REV. 01


File Name : 123A90-DDL-IN-DG-40015_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

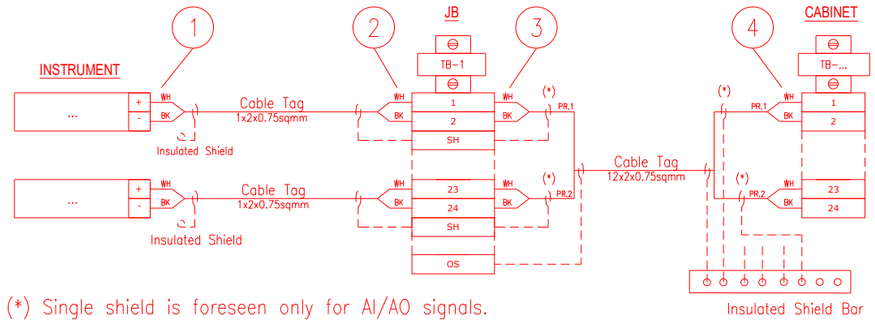

INSTRUMENT CONNECTION STRAIGHT TO CABINET



CABINET CONNECTION TO CABINET



1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 003	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Discipline	Eng Status	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland Standard	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-XV-008/00-JE-12004	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-XV-008	On/Off Valve	Upper Deck	00-JE-12004	DI JB to PCS	Upper Deck	SMICV02-2X2X0,75	Cable Cu Cl.2/XLPE/IS/OS/LSZH/SWB/LSZH 150/250V (300V) 2x2x0,75mm² - Grey	M20	T2_M20_Double			T2_M20_Double				U-SEC-18 / U-SEC-14E / U-SEC-14F

Cu Cl.2/XLPE/IS/OS/LSZH/SWB/LSZH 150/250 V (300 V)

2X2X0,75 - INSTRUMENT CABLE - Flame Retardant - Not I.S.

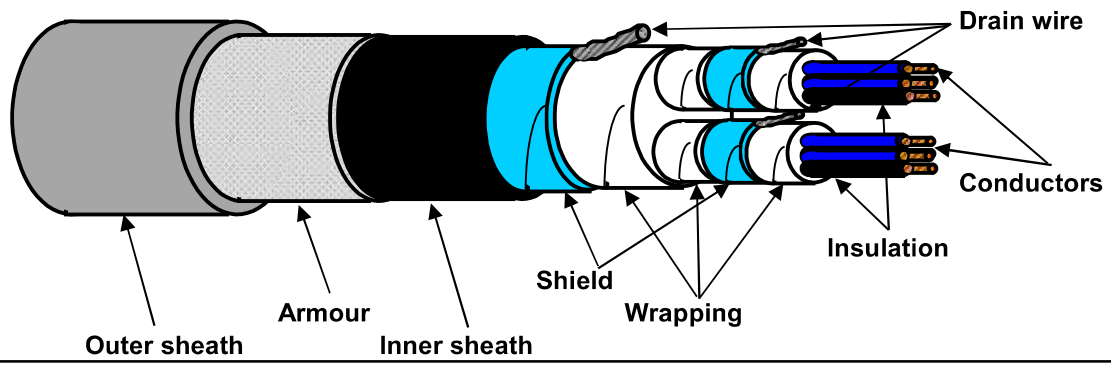

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	XLPE, Nominal Thickness 0,5 mm	
Cores colour code :	**White - Black (each core NUMBERED for PAIR identification)**	
Pair Assembling :	13/1mt	
Pair Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Pair Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Shield Insulation :	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Total Assembling :	7/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,2 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant, Average Thickness 1,3 mm	
Outer sheath color code:	**Grey**	
Outer printing (INKJET) :	**FLEI - 2X2X0,75 SQMM - XLPE/IS/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60332.1.2 - IEC 60332.3.22 -**	
(every 1000 mm)	**Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(11,4 ± 10%) mm	
Over armour diameter :	(12,6 ± 10%) mm	
Outer diameter :	(15,2 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 26 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Mutual Capacitance :	≤ 150 nF/km	
L/R ratio :	≤ 25 µH/Ω	
Inductance :	≤ 0,9 mH/km	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided, lending assent for the treatment, will be used to the sense of the article 13 of of the Regulation (UE) 2016/679, also through outsiders, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	C-25-XV-011/00-JE-12004	: PROXIMITY SWITCH / MARSHALLING PCS		Dwg	123A90-DDL-IN-LIS-40091	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10000086	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline Instrumental	Form	CJX10	Multi/Single-Core Instrument Control Cable

CABLE DATA

Type: Cu-XLPE-IS-OS-LSZH-SWB-LSZH | Cores/Size mm²: 2X2X0,75 mm2 | Color: GREY

From: 25-XV-011 | To: 00-JE-12004

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	Note
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH		>999	MΩ
	CORE to CORE		>999	MΩ
	CORE to SCREEN		>999	MΩ
	CORE to ARMr		>999	MΩ
	SCREEN to EARTH		>999	MΩ
	SCREEN to ARMr		>999	MΩ
CONTINUITY	CORES		0,4	Ω
	SCREEN		0,4	Ω
	EARTH		NA	Ω
	ARMr		0,4	Ω
	TEST VOLTS		500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 | Calibration date: N°LAT 042 00768/24 12/10/2024

Comments: Nota 5: refer to PL C30000682

Page 1/1	Performed by	☉ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-28	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-28T07:45:06.029Z	PROVERLIS Digitaly signed by Alessio Polo 2025-01-29T12:51:11.973Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

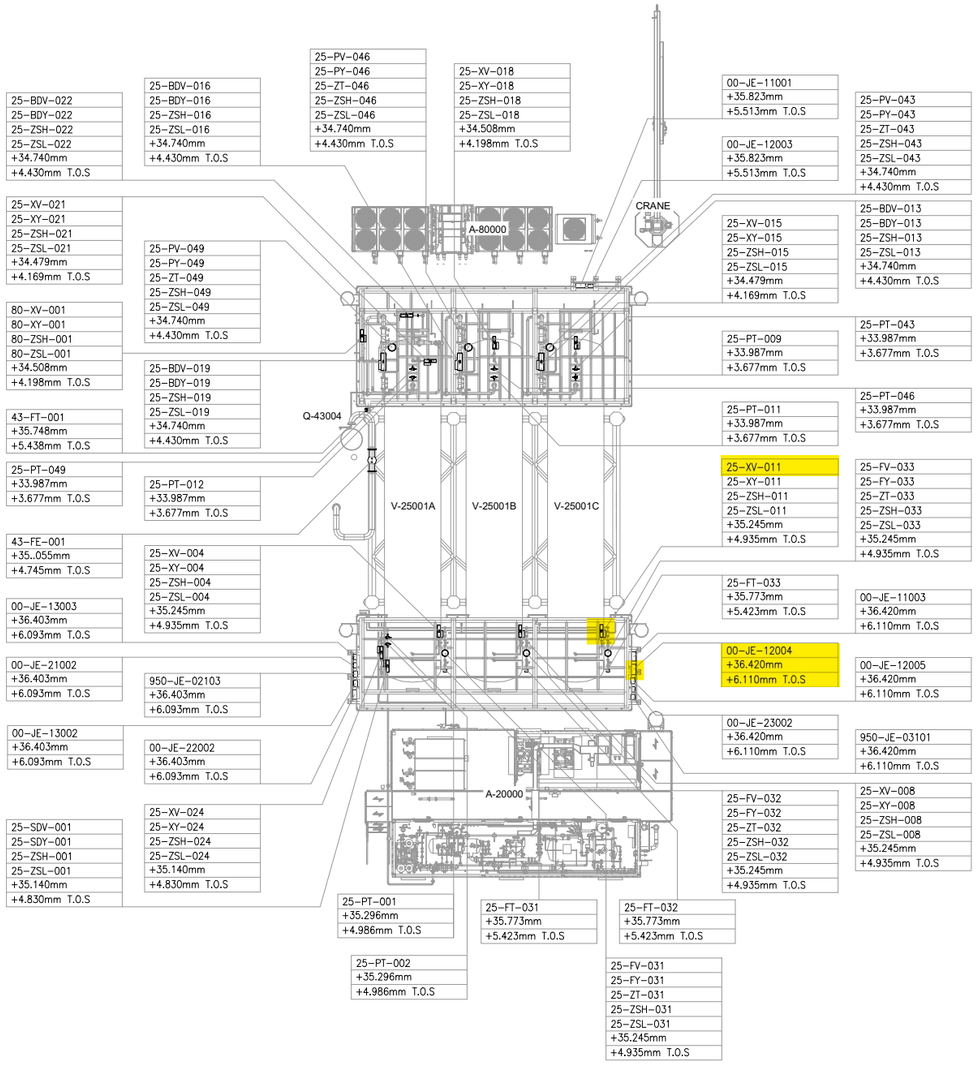

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

	DRAWING NO.	SHEET	REV.
A1	123A90–DDL–IN–DL–40081	002	02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-12004	No.	MARSHALLING CABINET B400-PCS-002

<01>

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-004 (1, 2) WH BK PR1
- 25-ZSH-004 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-004/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-008 (1, 2) WH BK PR1
- 25-ZSH-008 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-008/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-011 (1, 2) WH BK PR1
- 25-ZSH-011 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-011/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-014 (1, 2) WH BK PR1
- 25-ZSH-014 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-014/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-017 (1, 2) WH BK PR1
- 25-ZSH-017 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-017/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-1

WH/BK	1	WH/BK	PR1
	2		
	SH		
WH/BK	3	WH/BK	PR2
	4		
	SH		
WH/BK	5	WH/BK	PR3
	6		
	SH		
WH/BK	7	WH/BK	PR4
	8		
	SH		
WH/BK	9	WH/BK	PR5
	10		
	SH		
WH/BK	11	WH/BK	PR6
	12		
	SH		
WH/BK	13	WH/BK	PR7
	14		
	SH		
WH/BK	15	WH/BK	PR8
	16		
	SH		
WH/BK	17	WH/BK	PR9
	18		
	SH		
WH/BK	19	WH/BK	PR10
	20		
	SH		
SPARE	21	WH/BK	PR11
	22		
	SH		
SPARE	23	WH/BK	PR12
	24		
	SH		
	OS		

00-JE-12004_1/B400-PCS-002
12x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-00-JE-12004

PR1 WH/BK	1	25-ZSL-004
Shield Bar	2	
PR2 WH/BK	3	25-ZSH-004
Shield Bar	4	
PR3 WH/BK	5	25-ZSL-008
Shield Bar	6	
PR4 WH/BK	7	25-ZSH-008
Shield Bar	8	
PR5 WH/BK	9	25-ZSL-011
Shield Bar	10	
PR6 WH/BK	11	25-ZSH-011
Shield Bar	12	
PR7 WH/BK	13	25-ZSL-014
Shield Bar	14	
PR8 WH/BK	15	25-ZSH-014
Shield Bar	16	
PR9 WH/BK	17	25-ZSL-017
Shield Bar	18	
PR10 WH/BK	19	25-ZSH-017
Shield Bar	20	
PR11 WH/BK	21	SPARE
Shield Bar	22	
PR12 WH/BK	23	SPARE
	24	

Shield Bar
I.E.

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-12004-SH.1 OF 2

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 019	REV. 01


File Name : 123A90-DDL-IN-DG-40015_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

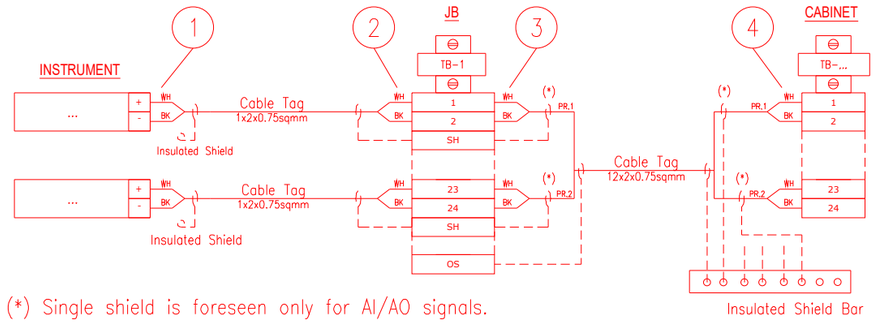

INSTRUMENT CONNECTION STRAIGHT TO CABINET



CABINET CONNECTION TO CABINET



1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 003	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Discipline	Eng Status	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland Standard	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-XV-011/00-JE-12004	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-XV-011	On/Off Valve	Upper Deck	00-JE-12004	DI JB to PCS	Upper Deck	SMICV02-2X2X0,75	Cable Cu Cl.2/XLPE/IS/OS/LSZH/SWB/LSZH 150/250V (300V) 2x2x0,75mm² - Grey	M20	T2_M20_Double			T2_M20_Double				U-SEC-19 / U-SEC-14F

Cu Cl.2/XLPE/IS/OS/LSZH/SWB/LSZH 150/250 V (300 V)

2X2X0,75 - INSTRUMENT CABLE - Flame Retardant - Not I.S.

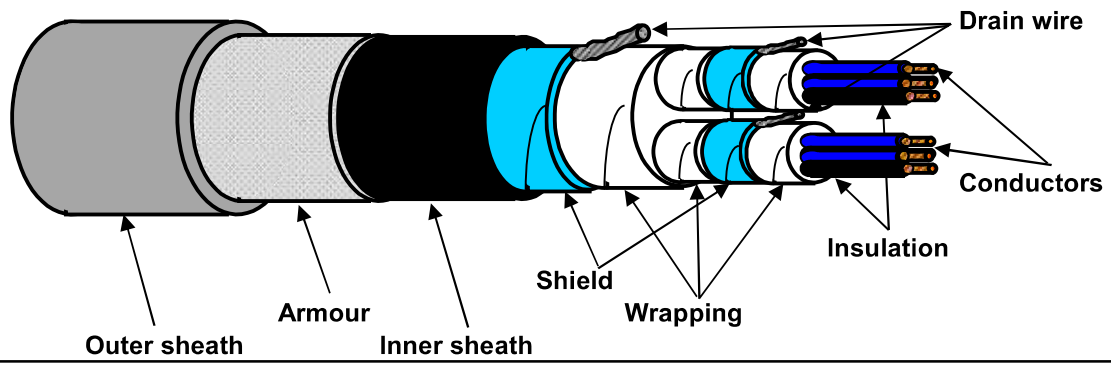

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	XLPE, Nominal Thickness 0,5 mm	
Cores colour code :	**White - Black (each core NUMBERED for PAIR identification)**	
Pair Assembling :	13/1mt	
Pair Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Pair Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Shield Insulation :	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Total Assembling :	7/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,2 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant, Average Thickness 1,3 mm	
Outer sheath color code:	**Grey**	
Outer printing (INKJET) :	**FLEI - 2X2X0,75 SQMM - XLPE/IS/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60332.1.2 - IEC 60332.3.22 -**	
(every 1000 mm)	**Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(11,4 ± 10%) mm	
Over armour diameter :	(12,6 ± 10%) mm	
Outer diameter :	(15,2 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 26 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Mutual Capacitance :	≤ 150 nF/km	
L/R ratio :	≤ 25 µH/Ω	
Inductance :	≤ 0,9 mH/km	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided, lending assent for the treatment, will be used to the sense of the article 13 of of the Regulation (UE) 2016/679, also through outsiders, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	C-25-XV-014/00-JE-12004	: PROXIMITY SWITCH / MARSHALLING PCS		Dwg	123A90-DDL-IN-LIS-40091	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10000087	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline Instrumental	Form	CJX10	Multi/Single-Core Instrument Control Cable

CABLE DATA

Type	Cu-XLPE-IS-OS-LSZH-SWB-LSZH	Cores/Size mm²	2X2X0,75 mm2	Color	GREY
From	25-XV-014	To	00-JE-12004		

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	Note
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH		>999	MΩ
	CORE to CORE		>999	MΩ
	CORE to SCREEN		>999	MΩ
	CORE to ARMr		>999	MΩ
	SCREEN to EARTH		>999	MΩ
	SCREEN to ARMr		>999	MΩ
CONTINUITY	CORES		0,56	Ω
	SCREEN		0,56	Ω
	EARTH		NA	Ω
	ARMr		0,56	Ω
	TEST VOLTS		500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 Calibration date: N°LAT 042 00768/24 12/10/2024

Comments Nota 5: refer to PL C30000682

Page 1/1	Performed by	☉ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Giovanni Tangianu	
Date	2025-01-25	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-25T13:25:00.870Z	PROVERLIS Digitaly signed by Giovanni Tangianu 2025-01-29T12:59:06.196Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

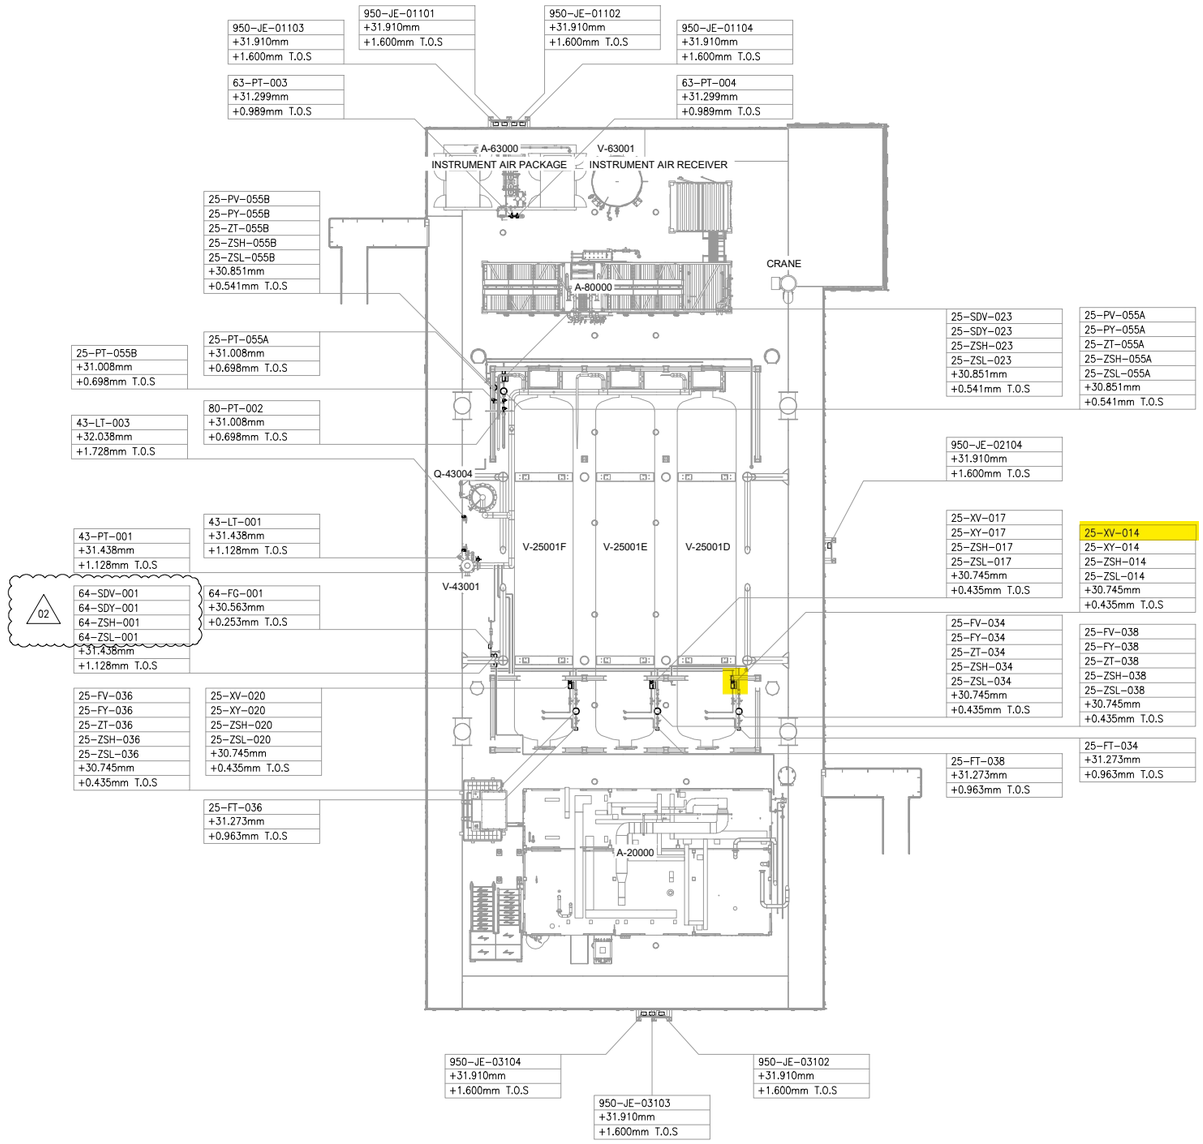


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

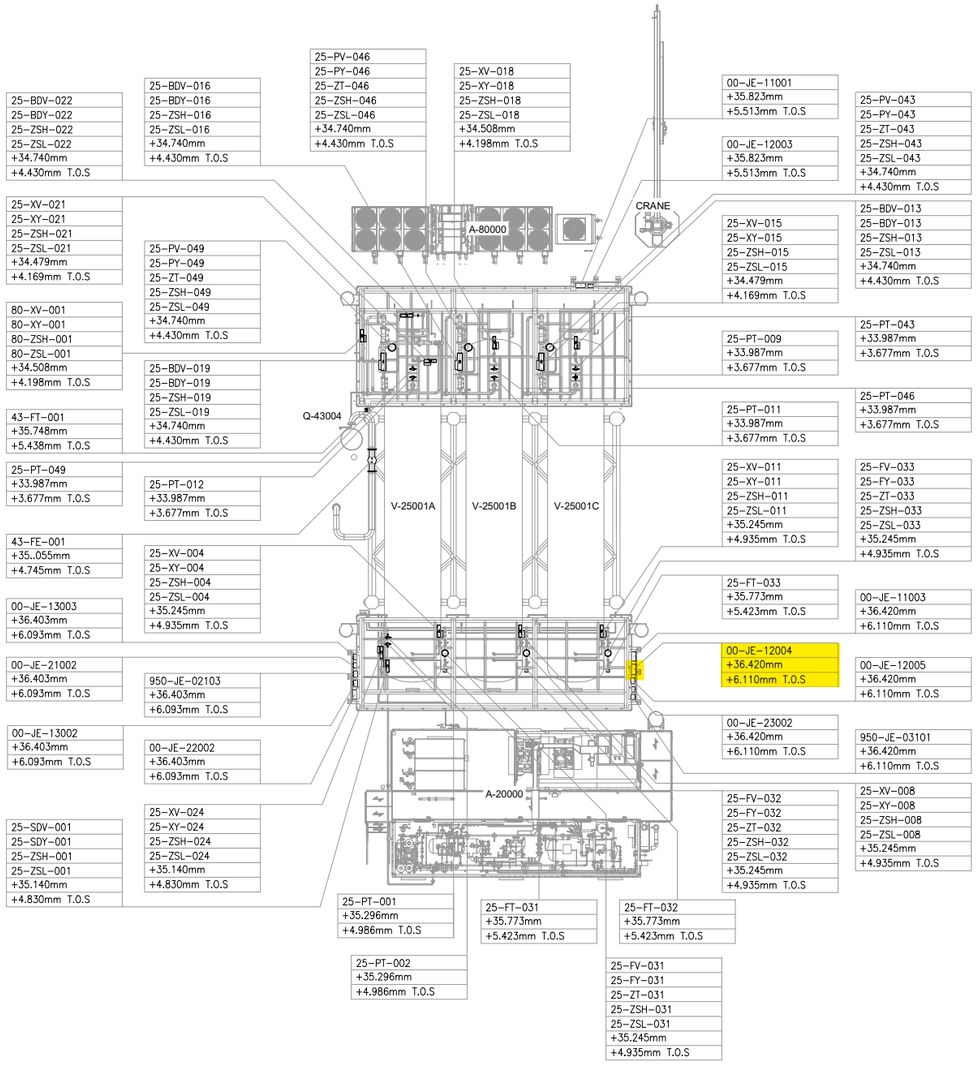

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90–DDL–IN–DL–40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-12004	No.	MARSHALLING CABINET B400-PCS-002

<01>

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-004 (1, 2) WH BK PR1
- 25-ZSH-004 (5, 6) WH BK PR2

NOTE-2

C-25-XV-004/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-008 (1, 2) WH BK PR1
- 25-ZSH-008 (5, 6) WH BK PR2

NOTE-2

C-25-XV-008/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-011 (1, 2) WH BK PR1
- 25-ZSH-011 (5, 6) WH BK PR2

NOTE-2

C-25-XV-011/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-014 (1, 2) WH BK PR1
- 25-ZSH-014 (5, 6) WH BK PR2

NOTE-2

C-25-XV-014/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-017 (1, 2) WH BK PR1
- 25-ZSH-017 (5, 6) WH BK PR2

NOTE-2

C-25-XV-017/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-1

WH BK	1	WH BK	PR1
	2		
	SH		
WH BK	3	WH BK	PR2
	4		
	SH		
WH BK	5	WH BK	PR3
	6		
	SH		
WH BK	7	WH BK	PR4
	8		
	SH		
WH BK	9	WH BK	PR5
	10		
	SH		
WH BK	11	WH BK	PR6
	12		
	SH		
WH BK	13	WH BK	PR7
	14		
	SH		
WH BK	15	WH BK	PR8
	16		
	SH		
WH BK	17	WH BK	PR9
	18		
	SH		
WH BK	19	WH BK	PR10
	20		
	SH		
SPARE	21	WH BK	PR11
	22		
	SH		
SPARE	23	WH BK	PR12
	24		
	SH		
	OS		

00-JE-12004_1/B400-PCS-002
12x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-00-JE-12004

PR1 WH BK	1	25-ZSL-004
Shield Bar	2	
PR2 WH BK	3	25-ZSH-004
Shield Bar	4	
PR3 WH BK	5	25-ZSL-008
Shield Bar	6	
PR4 WH BK	7	25-ZSH-008
Shield Bar	8	
PR5 WH BK	9	25-ZSL-011
Shield Bar	10	
PR6 WH BK	11	25-ZSH-011
Shield Bar	12	
PR7 WH BK	13	25-ZSL-014
Shield Bar	14	
PR8 WH BK	15	25-ZSH-014
Shield Bar	16	
PR9 WH BK	17	25-ZSL-017
Shield Bar	18	
PR10 WH BK	19	25-ZSH-017
Shield Bar	20	
PR11 WH BK	21	SPARE
Shield Bar	22	
PR12 WH BK	23	SPARE
	24	

Shield Bar

I.E.

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-12004-SH.1 OF 2

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 019	REV. 01


File Name : 123A90-DDL-IN-DG-40015_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

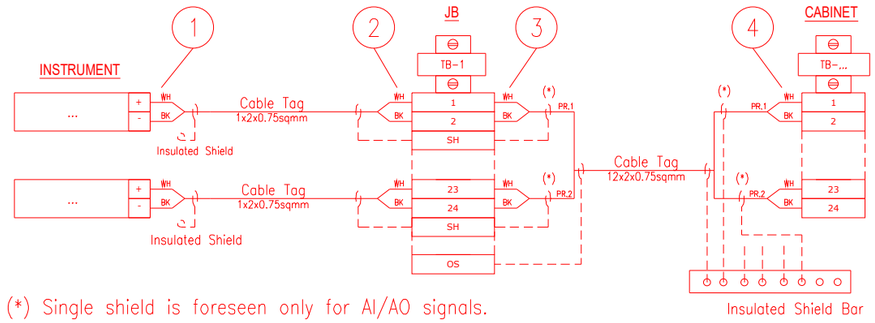

INSTRUMENT CONNECTION STRAIGHT TO CABINET



CABINET CONNECTION TO CABINET



1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 003	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Discipline	Eng Status	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland Standard	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-XV-014/00-JE-12004	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-XV-014	On/Off Valve	Upper Deck	00-JE-12004	DI JB to PCS	Upper Deck	SMICV02-2X2X0,75	Cable Cu Cl.2/XLPE/IS/OS/LSZH/SWB/LSZH 150/250V (300V) 2x2x0,75mm² - Grey	M20	T2_M20_Double			T2_M20_Double				U-SEC-19 / U-SEC-14F

Cu Cl.2/XLPE/IS/OS/LSZH/SWB/LSZH 150/250 V (300 V)

2X2X0,75 - INSTRUMENT CABLE - Flame Retardant - Not I.S.

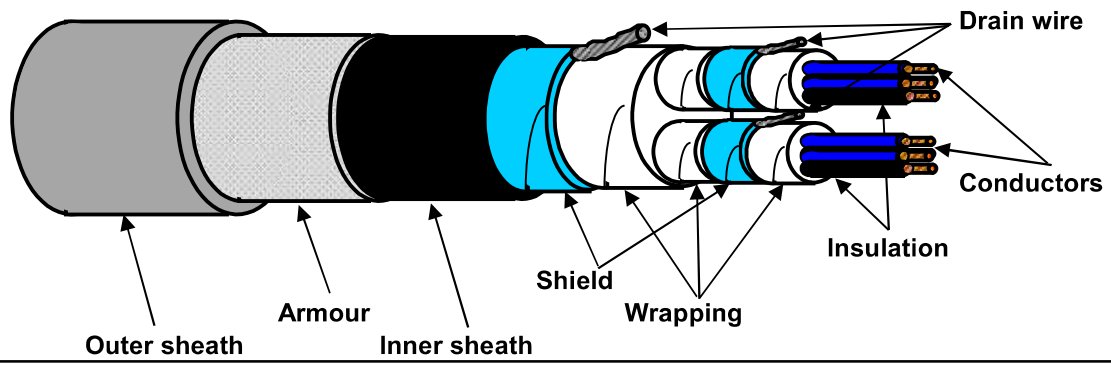

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	XLPE, Nominal Thickness 0,5 mm	
Cores colour code :	**White - Black (each core NUMBERED for PAIR identification)**	
Pair Assembling :	13/1mt	
Pair Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Pair Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Shield Insulation :	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Total Assembling :	7/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,2 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant, Average Thickness 1,3 mm	
Outer sheath color code:	**Grey**	
Outer printing (INKJET) :	**FLEI - 2X2X0,75 SQMM - XLPE/IS/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60332.1.2 - IEC 60332.3.22 -**	
(every 1000 mm)	**Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(11,4 ± 10%) mm	
Over armour diameter :	(12,6 ± 10%) mm	
Outer diameter :	(15,2 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 26 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Mutual Capacitance :	≤ 150 nF/km	
L/R ratio :	≤ 25 µH/Ω	
Inductance :	≤ 0,9 mH/km	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided, lending assent for the treatment, will be used to the sense of the article 13 of of the Regulation (UE) 2016/679, also through outsiders, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	C-25-XV-017/00-JE-12004	: PROXIMITY SWITCH / MARSHALLING PCS		Dwg	123A90-DDL-IN-LIS-40091	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10000088	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline Instrumental	Form	CJX10	Multi/Single-Core Instrument Control Cable

CABLE DATA

Type: Cu-XLPE-IS-OS-LSZH-SWB-LSZH | Cores/Size mm²: 2X2X0,75 mm2 | Color: GREY

From: 25-XV-017 | To: 00-JE-12004

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	Note
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH	>999	MΩ
	CORE to CORE	>999	MΩ
	CORE to SCREEN	>999	MΩ
	CORE to ARMr	>999	MΩ
	SCREEN to EARTH	>999	MΩ
	SCREEN to ARMr	>999	MΩ
CONTINUITY	CORES	0,7	Ω
	SCREEN	0,7	Ω
	EARTH	NA	Ω
	ARMr	0,7	Ω
	TEST VOLTS	500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 | Calibration date: N°LAT 042 00768/24 12/10/2024

Comments: Nota 5: refer to PL C30000682

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-30	2025-02-05	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-30T09:57:39.467Z	PROVERLIS Digitaly signed by Alessio Polo 2025-02-05T16:33:46.628Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

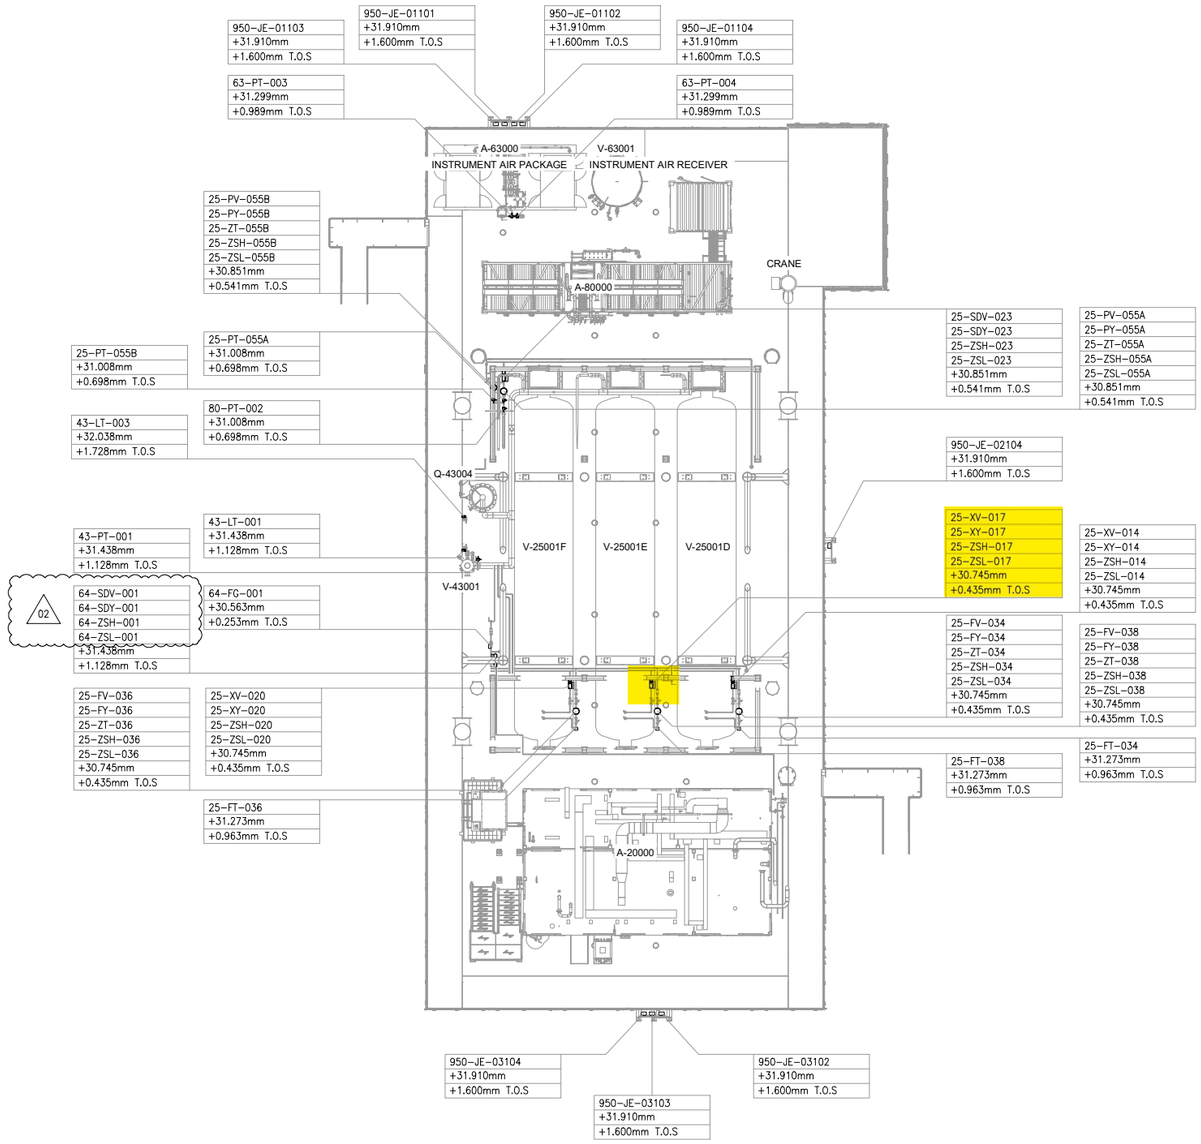


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40081**


REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

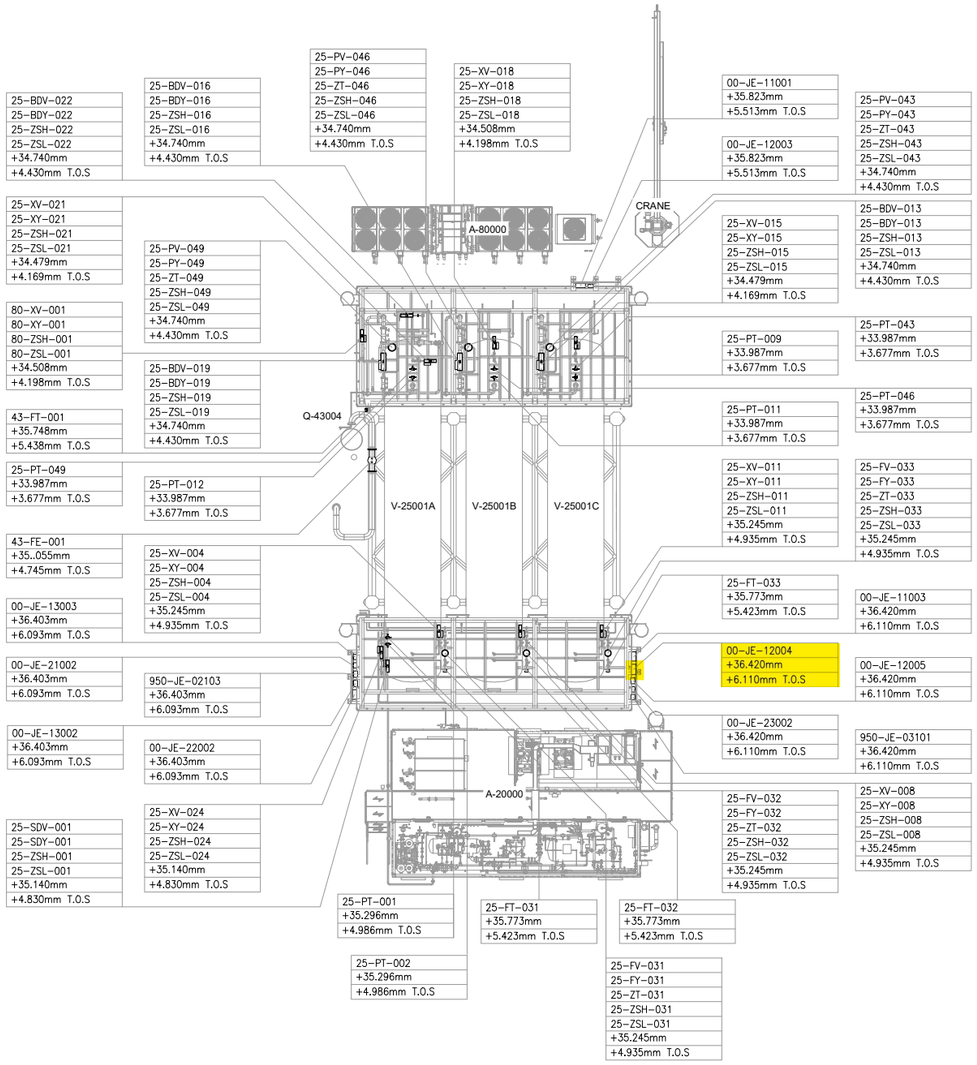

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90–DDL–IN–DL–40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-12004	No.	MARSHALLING CABINET B400-PCS-002

<01>

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-004 (1, 2) WH BK PR1
- 25-ZSH-004 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-004/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS
- TB-1: 1 WH BK PR1; 2 SH; 3 WH BK PR2; 4 SH

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-008 (1, 2) WH BK PR1
- 25-ZSH-008 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-008/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS
- TB-1: 5 WH BK PR3; 6 SH; 7 WH BK PR4; 8 SH

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-011 (1, 2) WH BK PR1
- 25-ZSH-011 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-011/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS
- TB-1: 9 WH BK PR5; 10 SH; 11 WH BK PR6; 12 SH

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-014 (1, 2) WH BK PR1
- 25-ZSH-014 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-014/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS
- TB-1: 13 WH BK PR7; 14 SH; 15 WH BK PR8; 16 SH

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)
- 25-ZSL-017 (1, 2) WH BK PR1
- 25-ZSH-017 (5, 6) WH BK PR2
- NOTE-2
- C-25-XV-017/00-JE-12004
  2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS
- TB-1: 17 WH BK PR9; 18 SH; 19 WH BK PR10; 20 SH; SPARE 21 WH BK PR11; 22 SH; SPARE 23 WH BK PR12; 24 SH; OS

00-JE-12004_1/B400-PCS-002
12x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-00-JE-12004
- PR1 WH BK 1 — 25-ZSL-004
- Shield Bar
- PR2 WH BK 2 — 25-ZSH-004
- Shield Bar
- PR3 WH BK 3 — 25-ZSL-008
- Shield Bar
- PR4 WH BK 4 — 25-ZSH-008
- Shield Bar
- PR5 WH BK 5 — 25-ZSL-011
- Shield Bar
- PR6 WH BK 6 — 25-ZSH-011
- Shield Bar
- PR7 WH BK 7 — 25-ZSL-014
- Shield Bar
- PR8 WH BK 8 — 25-ZSH-014
- Shield Bar
- PR9 WH BK 9 — 25-ZSL-017
- Shield Bar
- PR10 WH BK 10 — 25-ZSH-017
- Shield Bar
- PR11 WH BK 11 — SPARE
- Shield Bar
- PR12 WH BK 12 — SPARE

Shield Bar — I.E.

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_I	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-12004-SH.1 OF 2

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 019	REV. 01


File Name : 123A90-DDL-IN-DG-40015_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

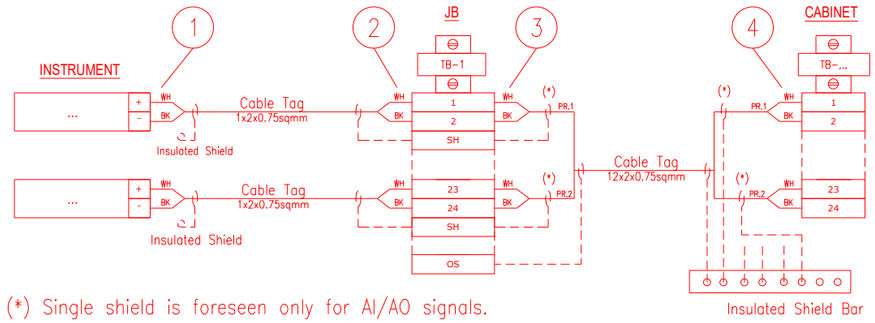

INSTRUMENT CONNECTION STRAIGHT TO CABINET

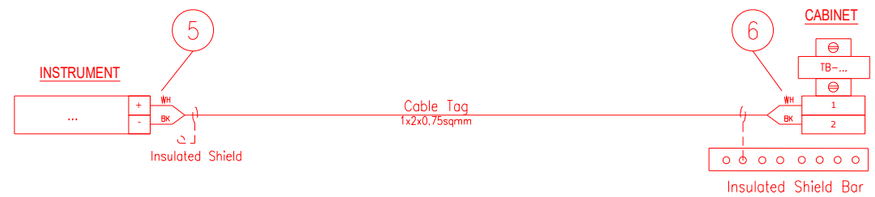

CABINET CONNECTION TO CABINET



1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_I	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


A3	DRAWING NO.	SHEET	REV.
	123A90-DDL-IN-DG-40015	003	01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Discipline	Eng Status	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland Standard	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-XV-017/00-JE-12004	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-XV-017	On/Off Valve	Upper Deck	00-JE-12004	DI JB to PCS	Upper Deck	SMICV02-2X2X0,75	Cable Cu Cl.2/XLPE/IS/OS/LSZH/SWB/LSZH 150/250V (300V) 2x2x0,75mm² - Grey	M20	T2_M20_Double			T2_M20_Double				U-SEC-18 / U-SEC-14E / U-SEC-14F

Cu Cl.2/XLPE/IS/OS/LSZH/SWB/LSZH 150/250 V (300 V)

2X2X0,75 - INSTRUMENT CABLE - Flame Retardant - Not I.S.

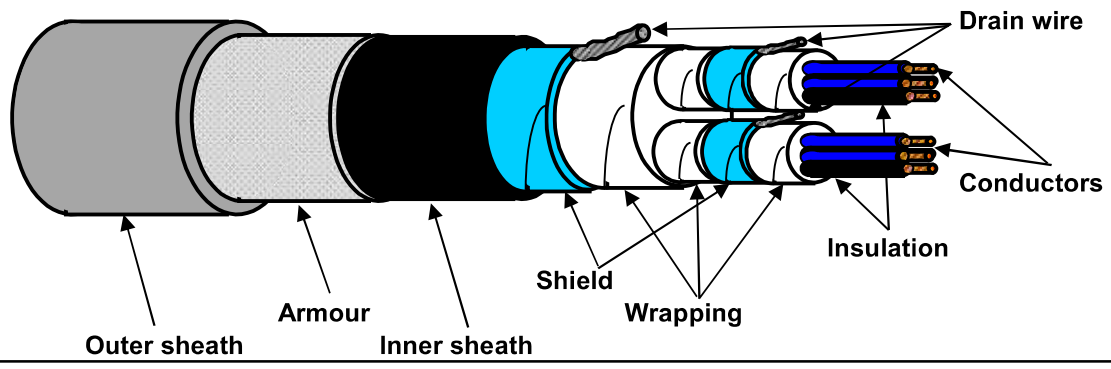

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	XLPE, Nominal Thickness 0,5 mm	
Cores colour code :	**White - Black (each core NUMBERED for PAIR identification)**	
Pair Assembling :	13/1mt	
Pair Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Pair Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Shield Insulation :	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Total Assembling :	7/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,2 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant, Average Thickness 1,3 mm	
Outer sheath color code:	**Grey**	
Outer printing (INKJET) :	**FLEI - 2X2X0,75 SQMM - XLPE/IS/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60332.1.2 - IEC 60332.3.22 -**	
(every 1000 mm)	**Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(11,4 ± 10%) mm	
Over armour diameter :	(12,6 ± 10%) mm	
Outer diameter :	(15,2 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 26 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Mutual Capacitance :	≤ 150 nF/km	
L/R ratio :	≤ 25 µH/Ω	
Inductance :	≤ 0,9 mH/km	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided, lending assent for the treatment, will be used to the sense of the article 13 of of the Regulation (UE) 2016/679, also through outsiders, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	C-25-XV-020/00-JE-12004	: PROXIMITY SWITCH / MARSHALLING PCS		Dwg	123A90-DDL-IN-LIS-40091	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10000089	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline Instrumental	Form	CJX10	Multi/Single-Core Instrument Control Cable

CABLE DATA

Type	Cu-XLPE-IS-OS-LSZH-SWB-LSZH	Cores/Size mm²	2X2X0,75 mm2	Color	GREY
From	25-XV-020		To	00-JE-12004	

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	Note
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH		>999	MΩ
	CORE to CORE		>999	MΩ
	CORE to SCREEN		>999	MΩ
	CORE to ARMr		>999	MΩ
	SCREEN to EARTH		>999	MΩ
	SCREEN to ARMr		>999	MΩ
CONTINUITY	CORES		0,90	Ω
	SCREEN		0,90	Ω
	EARTH		NA	Ω
	ARMr		0,90	Ω
	TEST VOLTS		500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 Calibration date: N°LAT 042 00768/24 12/10/2024

Comments Nota 5: refer to PL C30000682

Page 1/1	Performed by	☉ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Giovanni Tangianu	
Date	2025-01-25	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-25T13:25:33.896Z	PROVERLIS Digitaly signed by Giovanni Tangianu 2025-01-29T13:06:26.186Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

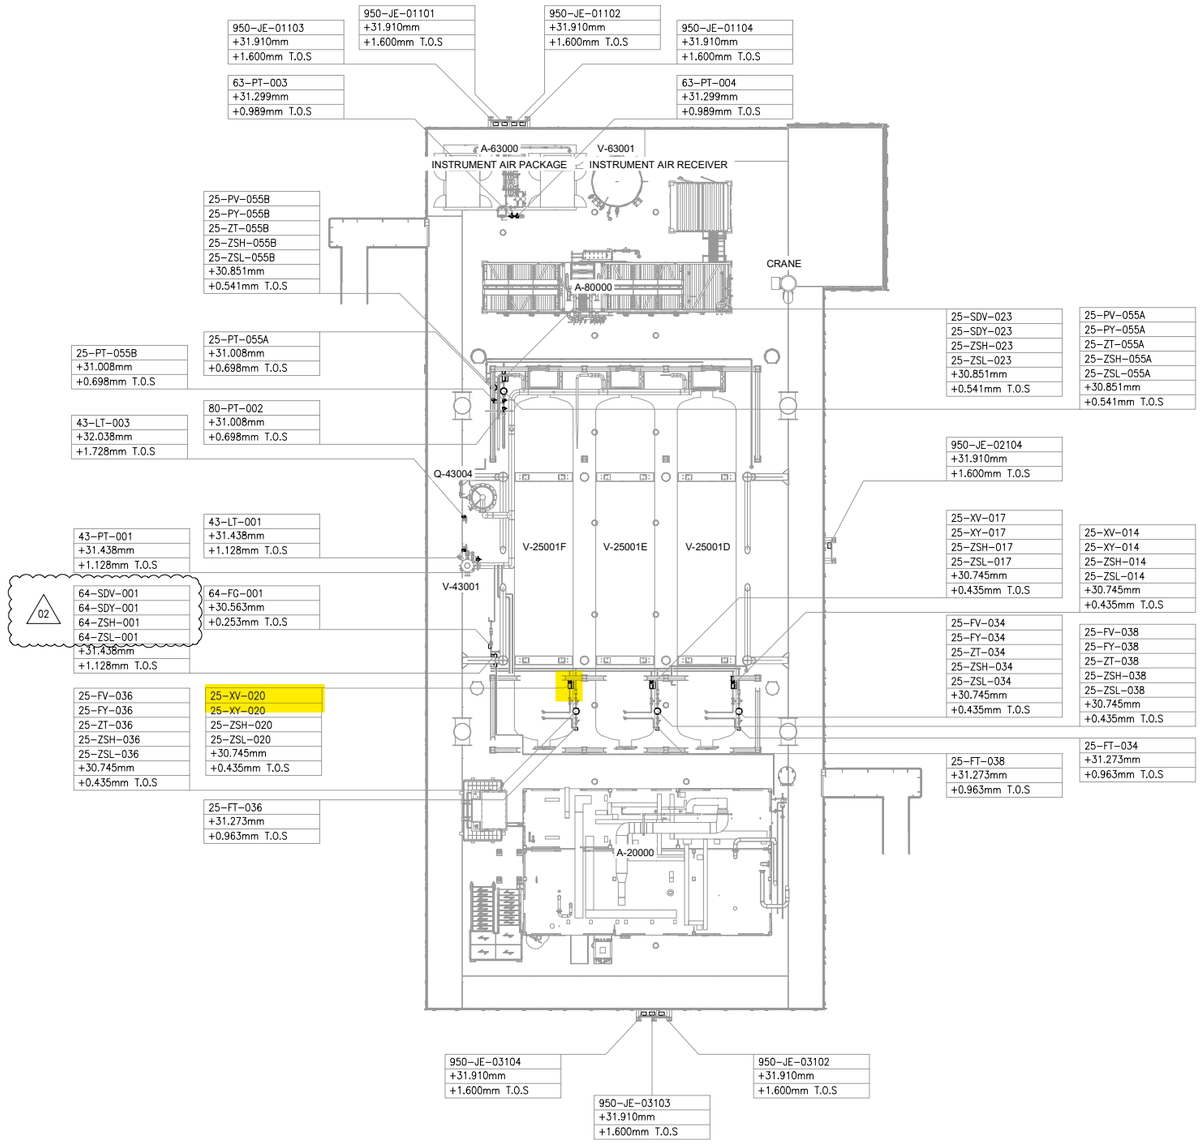


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40081**


REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

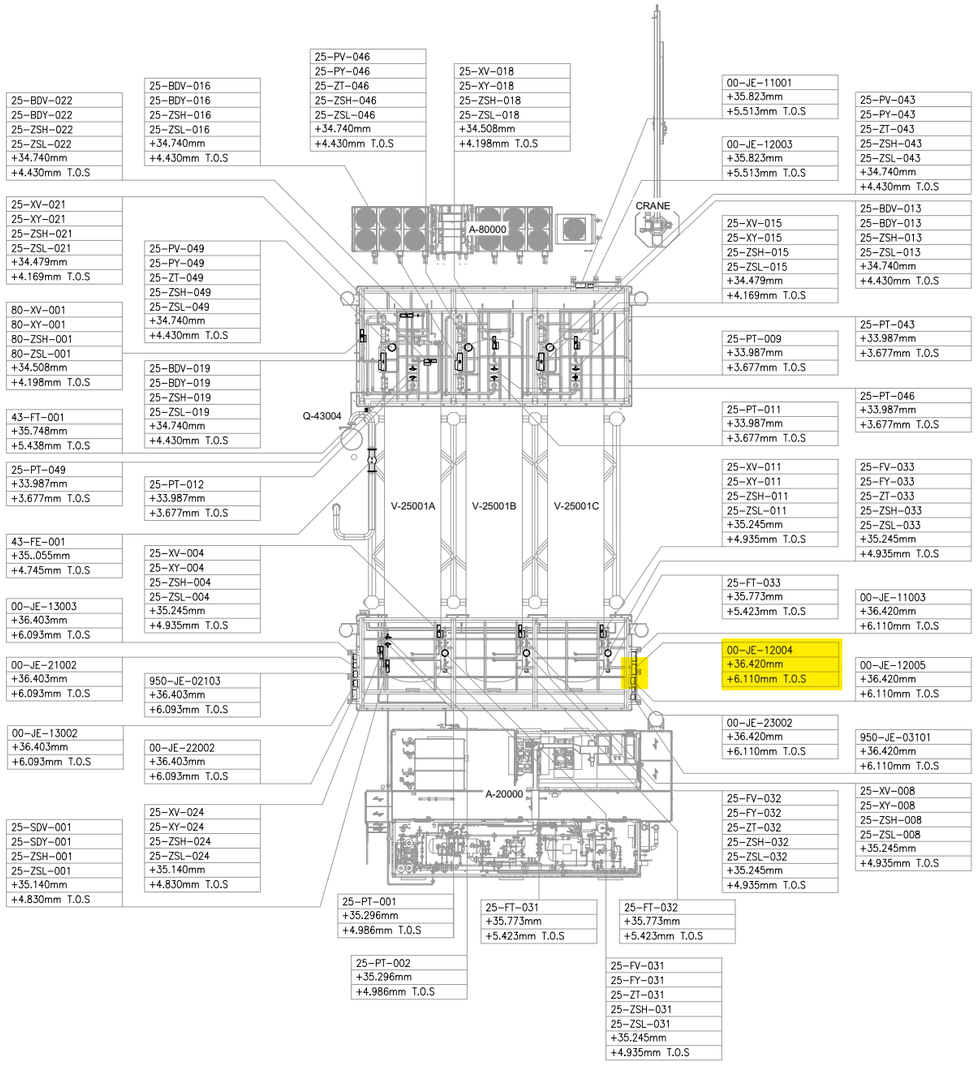

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081
REV.: 2_A | DATE: 07/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE 1:150
DRAWN VBA | CHECKED LCA | APPROVED DLO | DATE 04/10/24
A1 | DRAWING NO. 123A90-DDL-IN-DL-40081 | SHEET 002 | REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-12004	No.	MARSHALLING CABINET B400-PCS-002

<01>

ON-OFF VALVE LIMIT SWITCHES BOX (SOLDO)

25-ZSL-020 (1 WH, 2 BK) PR1

25-ZSH-020 (5 WH, 6 BK) PR2

NOTE-2

C-25-XV-020/00-JE-12004
2x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

CONTROL VALVE LIMIT SWITCHES BOX (EISENBAU)

25-ZSL-031 (2 WH, 3 BK) NOTE-2
C-25-ZSL-031/00-JE-12004
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

25-ZSH-031 (5 WH, 6 BK) NOTE-2
C-25-ZSH-031/00-JE-12004
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

CONTROL VALVE LIMIT SWITCHES BOX (EISENBAU)

25-ZSL-032 (2 WH, 3 BK) NOTE-2
C-25-ZSL-032/00-JE-12004
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

25-ZSH-032 (5 WH, 6 BK) NOTE-2
C-25-ZSH-032/00-JE-12004
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

CONTROL VALVE LIMIT SWITCHES BOX (EISENBAU)

25-ZSL-033 (2 WH, 3 BK) NOTE-2
C-25-ZSL-033/00-JE-12004
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

25-ZSH-033 (5 WH, 6 BK) NOTE-2
C-25-ZSH-033/00-JE-12004
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

CONTROL VALVE LIMIT SWITCHES BOX (EISENBAU)

25-ZSL-034 (2 WH, 3 BK) NOTE-2
C-25-ZSL-034/00-JE-12004
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

25-ZSH-034 (5 WH, 6 BK) NOTE-2
C-25-ZSH-034/00-JE-12004
1x2x0.75mm2,ShT+ARM,F.Ret,GREY,NIS

TB-2

WH/BK	25	PR1
	26	
	SH	
WH/BK	27	PR2
	28	
	SH	
WH/BK	29	PR3
	30	
	SH	
WH/BK	31	PR4
	32	
	SH	
WH/BK	33	PR5
	34	
	SH	
WH/BK	35	PR6
	36	
	SH	
WH/BK	37	PR7
	38	
	SH	
WH/BK	39	PR8
	40	
	SH	
WH/BK	41	PR9
	42	
	SH	
WH/BK	43	PR10
	44	
	SH	
SPARE	45	PR11
	46	
	SH	
SPARE	47	PR12
	48	
	SH	
	OS	

00-JE-12004_2/B400-PCS-002
12x2x0.75mm2,Sh+ShT+ARM,F.Ret,GREY,NIS

TB-00-JE-12004

PR1 WH/BK	25	25-ZSL-020
	26	
Shield Bar		
PR2 WH/BK	27	25-ZSH-020
	28	
Shield Bar		
PR3 WH/BK	29	25-ZSL-031
	30	
Shield Bar		
PR4 WH/BK	31	25-ZSH-031
	32	
Shield Bar		
PR5 WH/BK	33	25-ZSL-032
	34	
Shield Bar		
PR6 WH/BK	35	25-ZSH-032
	36	
Shield Bar		
PR7 WH/BK	37	25-ZSL-033
	38	
Shield Bar		
PR8 WH/BK	39	25-ZSH-033
	40	
Shield Bar		
PR9 WH/BK	41	25-ZSL-034
	42	
Shield Bar		
PR10 WH/BK	43	25-ZSH-034
	44	
Shield Bar		
PR11 WH/BK	45	SPARE
	46	
Shield Bar		
PR12 WH/BK	47	SPARE
	48	

Shield Bar

I.E.

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-12004-SH.2 OF 2

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 020	REV. 01


File Name : 123A90-DDL-IN-DG-40015_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

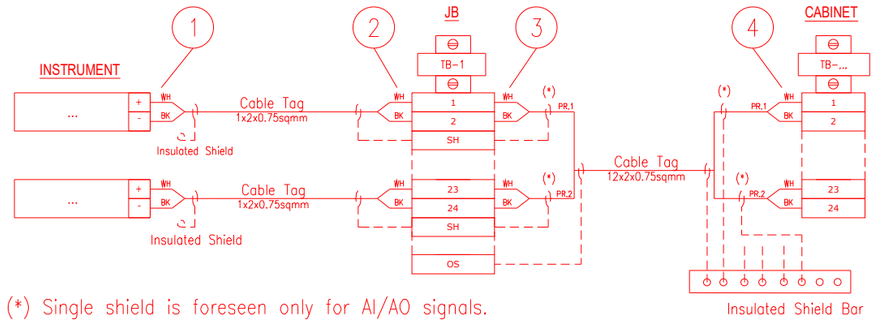

INSTRUMENT CONNECTION STRAIGHT TO CABINET



CABINET CONNECTION TO CABINET



1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 003	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Discipline	Eng Status	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland Standard	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-XV-020/00-JE-12004	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-XV-020	On/Off Valve	Upper Deck	00-JE-12004	DI JB to PCS	Upper Deck	SMICV02-2X2X0,75	Cable Cu Cl.2/XLPE/IS/OS/LSZH/SWB/LSZH 150/250V (300V) 2x2x0,75mm² - Grey	M20	T2_M20_Double			T2_M20_Double				U-SEC-17 / U-SEC-14D / U-SEC-14E

Cu Cl.2/XLPE/IS/OS/LSZH/SWB/LSZH 150/250 V (300 V)

2X2X0,75 - INSTRUMENT CABLE - Flame Retardant - Not I.S.

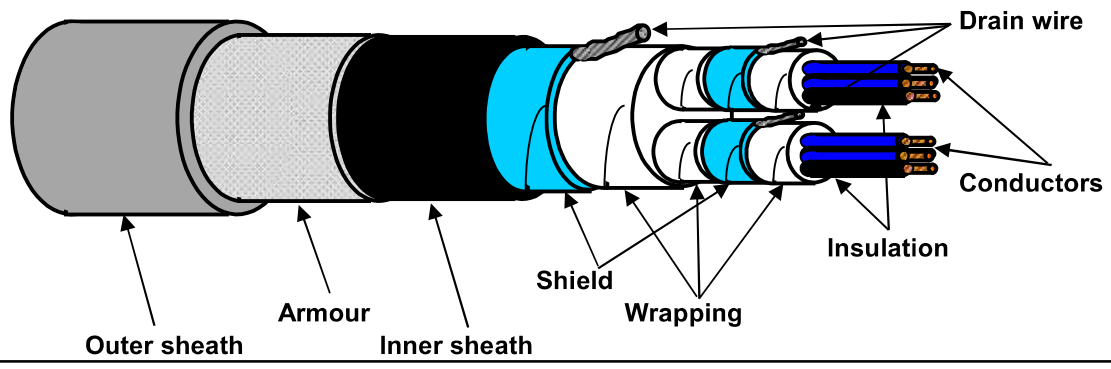

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	XLPE, Nominal Thickness 0,5 mm	
Cores colour code :	**White - Black (each core NUMBERED for PAIR identification)**	
Pair Assembling :	13/1mt	
Pair Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Pair Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Shield Insulation :	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Total Assembling :	7/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,2 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant, Average Thickness 1,3 mm	
Outer sheath color code:	**Grey**	
Outer printing (INKJET) :	**FLEI - 2X2X0,75 SQMM - XLPE/IS/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60332.1.2 - IEC 60332.3.22 -**	
(every 1000 mm)	**Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(11,4 ± 10%) mm	
Over armour diameter :	(12,6 ± 10%) mm	
Outer diameter :	(15,2 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 26 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Mutual Capacitance :	≤ 150 nF/km	
L/R ratio :	≤ 25 µH/Ω	
Inductance :	≤ 0,9 mH/km	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided, lending assent for the treatment, will be used to the sense of the article 13 of of the Regulation (UE) 2016/679, also through outsiders, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ROSETTI MARINO — CROSSWIND

ITEM	Tag	C-25-XV-024/00-JE-12005	: PROXIMITY SWITCH / MARSHALLING PCS	Dwg	123A90-DDL-IN-LIS-40091		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10000102	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX10

Multi/Single-Core Instrument Control Cable

CABLE DATA

Type	Cu-XLPE-IS-OS-LSZH-SWB-LSZH	Cores/Size mm²	2X2X0,75 mm2	Color	GREY
From	25-XV-024	To	00-JE-12005		

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	PL
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH	>999	MΩ
	CORE to CORE	>999	MΩ
	CORE to SCREEN	>999	MΩ
	CORE to ARMr	>999	MΩ
	SCREEN to EARTH	>999	MΩ
	SCREEN to ARMr	>999	MΩ
CONTINUITY	CORES	0,8	Ω
	SCREEN	0,8	Ω
	EARTH	NA	Ω
	ARMr	0,8	Ω
	TEST VOLTS	500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 Calibration date: N°LAT 042 00768/24 12/10/2024

Comments Nota 5: refer to PL C30000682

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-29	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:30:04.997Z	PROVERLIS Digitaly signed by Alessio Polo 2025-01-30T10:08:46.711Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

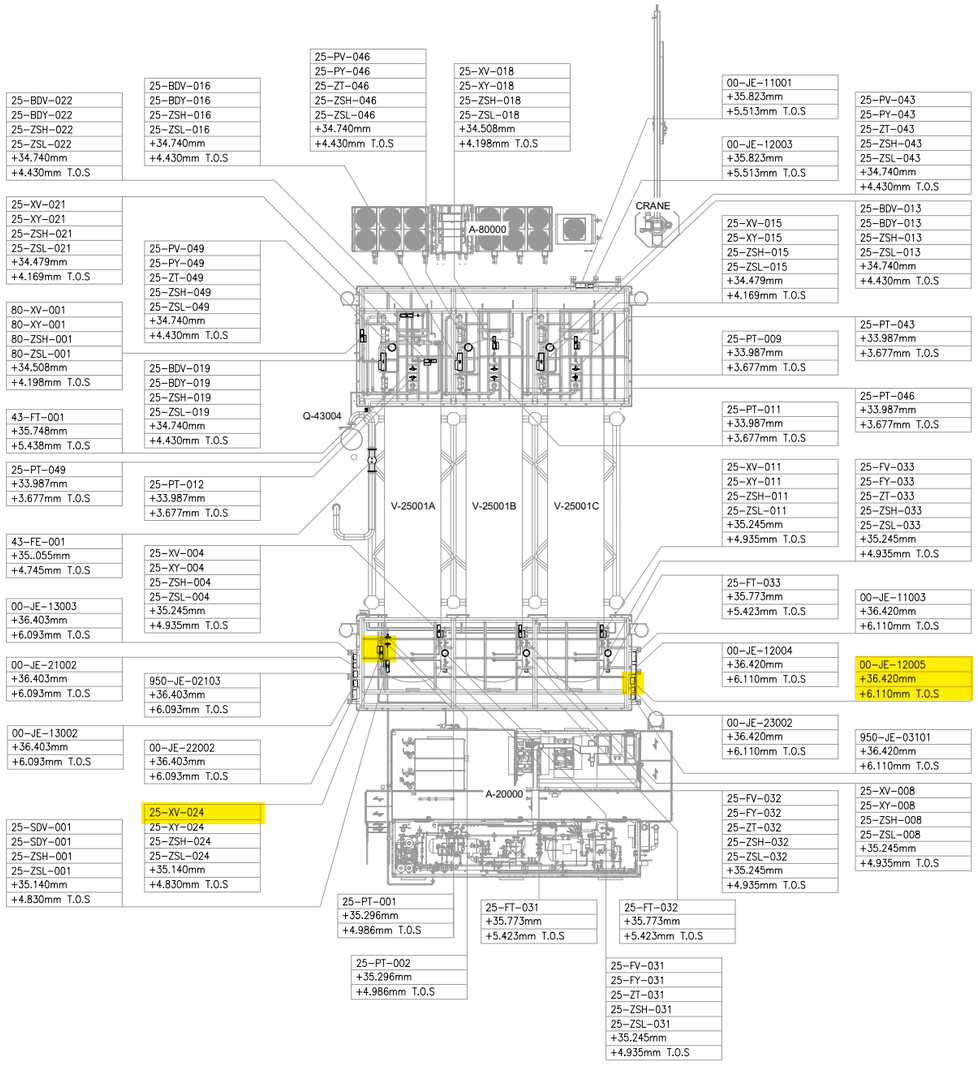

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02


File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-12005	No.	MARSHALLING CABINET B400-PCS-002

<01>

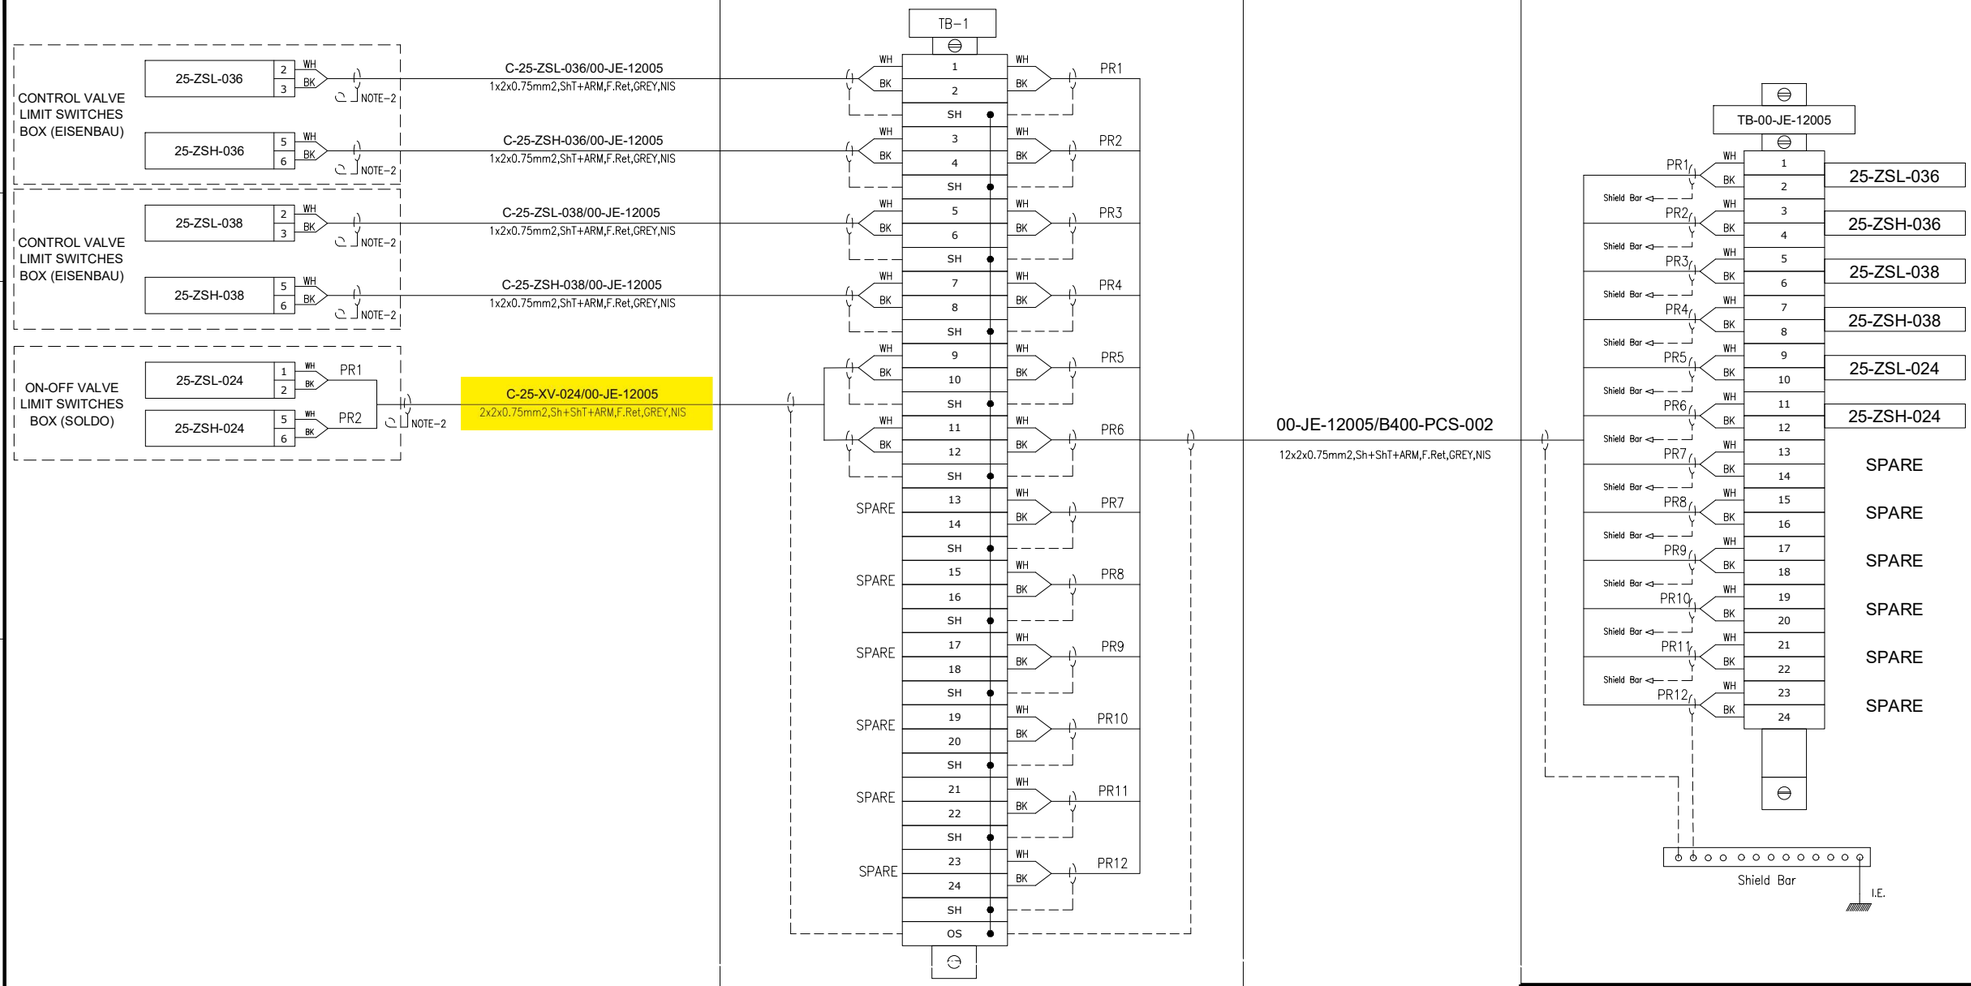

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_I	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00–JE–12005

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90–DDL–IN–DG–40015	SHEET 021	REV. 01


File Name : 123A90-DDL-IN-DG-40015_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

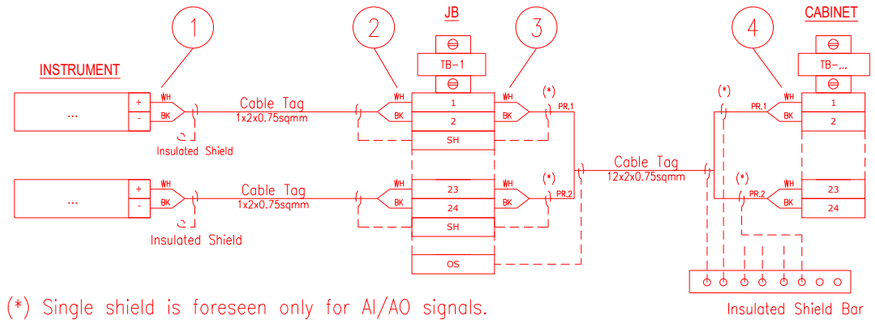

INSTRUMENT CONNECTION STRAIGHT TO CABINET



CABINET CONNECTION TO CABINET



1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_I	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


A3	DRAWING NO.	SHEET	REV.
	123A90-DDL-IN-DG-40015	003	01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Discipline	Eng Status	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland Standard	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-XV-024/00-JE-12005	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-XV-024	On/Off Valve	Upper Deck	00-JE-12005	DI JB to PCS	Upper Deck	SMICV02-2X2X0,75	Cable Cu Cl.2/XLPE/IS/OS/LSZH/SWB/LSZH 150/250V (300V) 2x2x0,75mm² - Grey	M20	T2_M20_Double			T2_M20_Double				U-SEC-16 / U-SEC-14C / U-SEC-14D / U-SEC-14E / U-SEC-14F

Cu Cl.2/XLPE/IS/OS/LSZH/SWB/LSZH 150/250 V (300 V)

2X2X0,75 - INSTRUMENT CABLE - Flame Retardant - Not I.S.

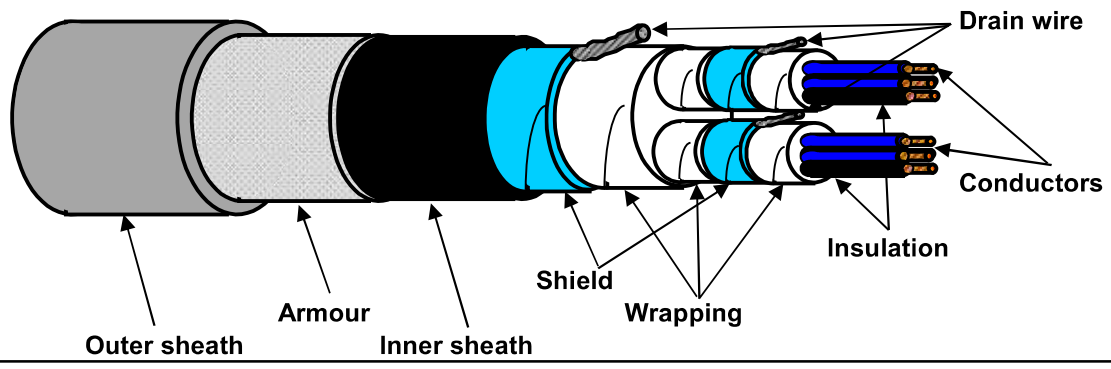

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	XLPE, Nominal Thickness 0,5 mm	
Cores colour code :	**White - Black (each core NUMBERED for PAIR identification)**	
Pair Assembling :	13/1mt	
Pair Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Pair Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Shield Insulation :	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Total Assembling :	7/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,2 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant, Average Thickness 1,3 mm	
Outer sheath color code:	**Grey**	
Outer printing (INKJET) :	**FLEI - 2X2X0,75 SQMM - XLPE/IS/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60332.1.2 - IEC 60332.3.22 -**	
(every 1000 mm)	**Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(11,4 ± 10%) mm	
Over armour diameter :	(12,6 ± 10%) mm	
Outer diameter :	(15,2 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 26 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Mutual Capacitance :	≤ 150 nF/km	
L/R ratio :	≤ 25 µH/Ω	
Inductance :	≤ 0,9 mH/km	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided, lending assent for the treatment, will be used to the sense of the article 13 of of the Regulation (UE) 2016/679, also through outsiders, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ITEM	Tag	C-25-XY-004/00-JE-13002	: SOLENOID VALVE / MARSHALLING PCS	Dwg	123A90-DDL-IN-LIS-40091		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10000118	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX10

Multi/Single-Core Instrument Control Cable

CABLE DATA

Type: Cu-XLPE-OS-LSZH-SWB-LSZH | Cores/Size mm²: 2X2,5 mm2 | Color: GREY

From: 25-XY-004 | To: 00-JE-13002

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	Note
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH	>999	MΩ
	CORE to CORE	>999	MΩ
	CORE to SCREEN	>999	MΩ
	CORE to ARMr	>999	MΩ
	SCREEN to EARTH	>999	MΩ
	SCREEN to ARMr	>999	MΩ
CONTINUITY	CORES	0,2	Ω
	SCREEN	0,2	Ω
	EARTH	NA	Ω
	ARMr	0,2	Ω
	TEST VOLTS	500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 | Calibration date: N°LAT 042 00768/24 12/10/2024

Comments: Nota 5: refer to PL C30000682

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-25	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-25T13:39:21.089Z	PROVERLIS Digitaly signed by Alessio Polo 2025-01-29T11:16:07.530Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

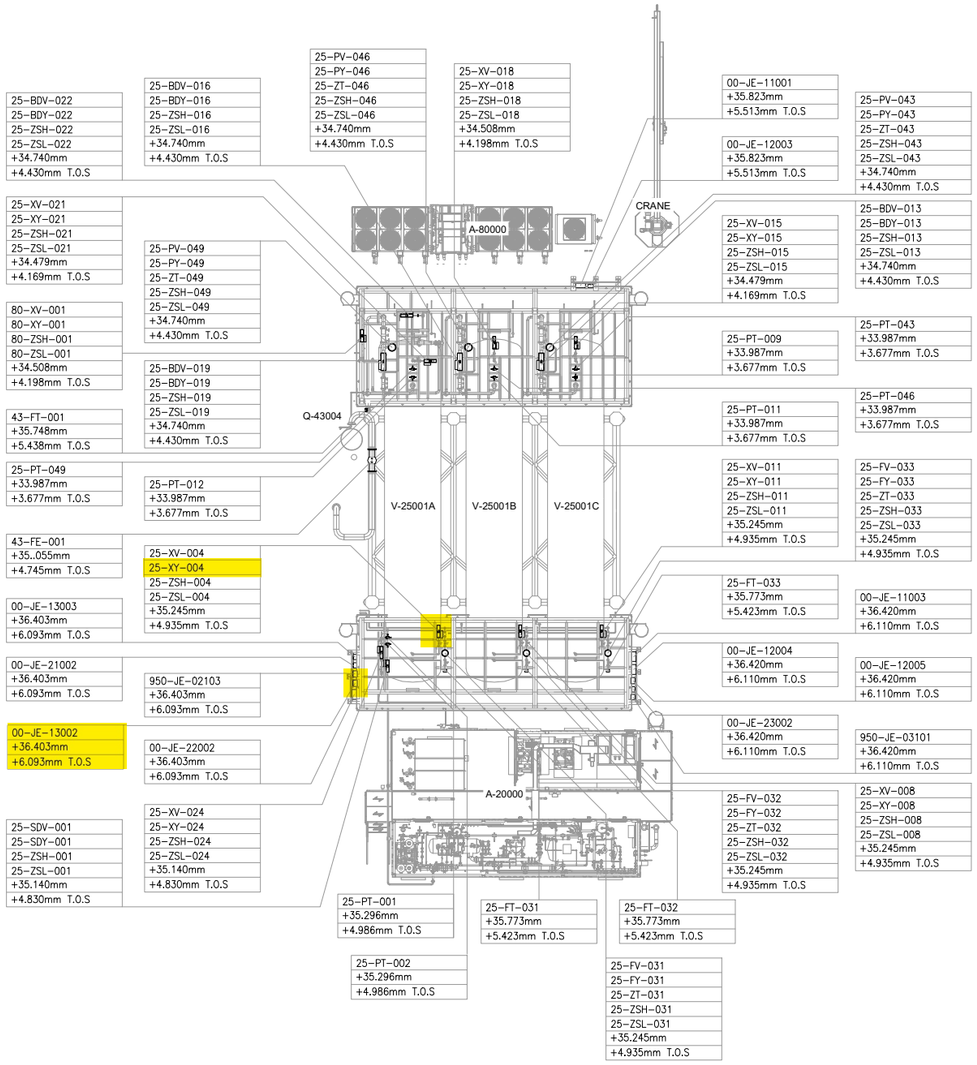

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm

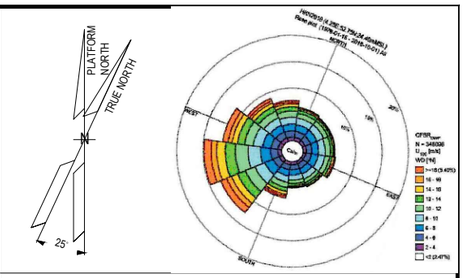

NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90–DDL–IN–DL–40081	SHEET 002	REV. 02


File Name : 123A90-DDL-IN-DL-40081 REV02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-13002	No.	MARSHALLING CABINET B400-PCS-002

<01>

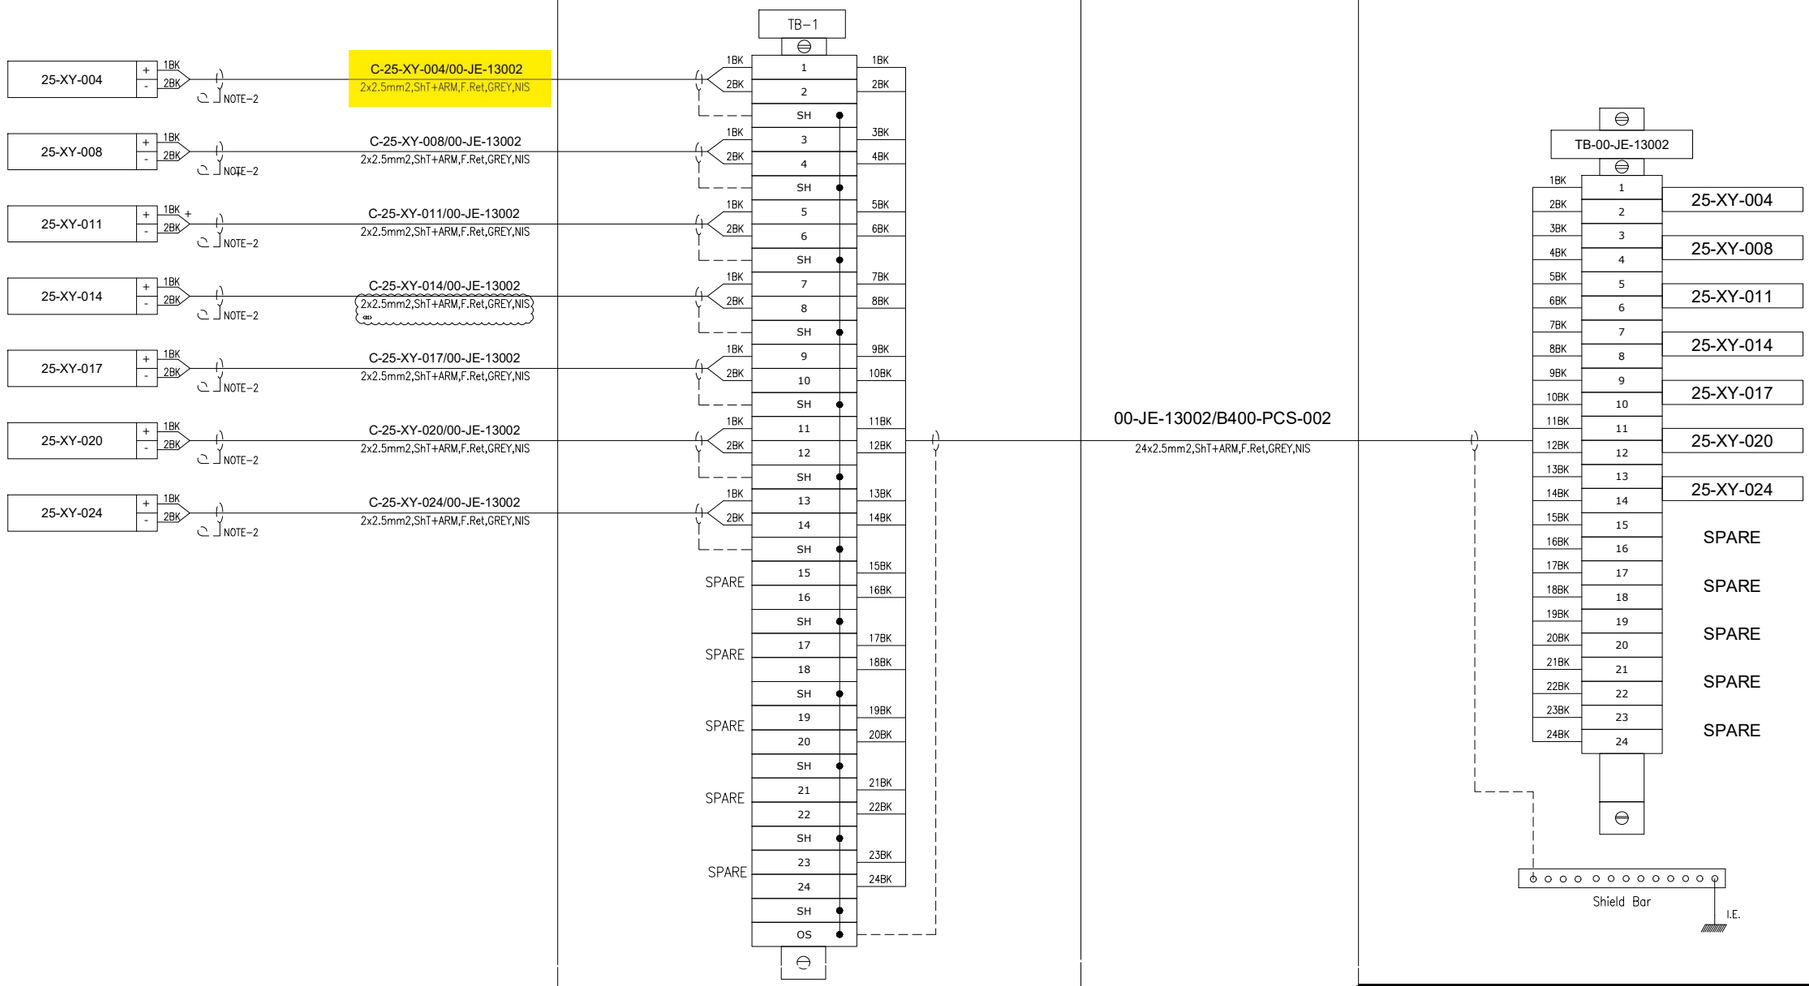

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-13002

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024
A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 029	REV. 01


File Name : 123A90-DDL-IN-DG-40015_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

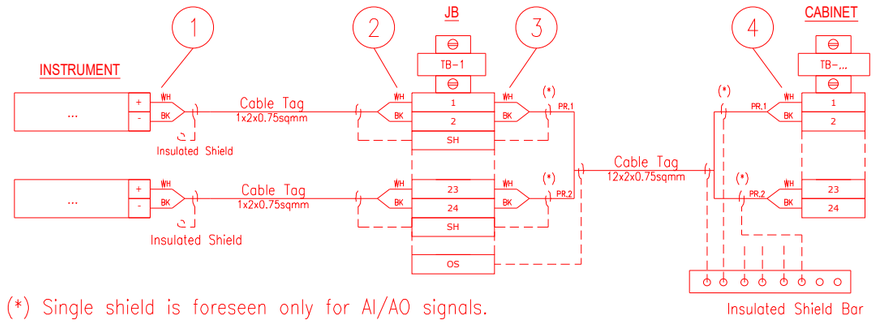

INSTRUMENT CONNECTION STRAIGHT TO CABINET



CABINET CONNECTION TO CABINET



1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 003	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Discipline	Eng Status	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland Standard	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-XY-004/00-JE-13002	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-XY-004	Solenoid Valve	Upper Deck	00-JE-13002	DO JB to PCS	Upper Deck	SMICV05-2X2,5	Cable Cu Cl.2/XLPE/OS/LSZH/SWB/LSZH 150/250V (300V) 2x2,5mm² - Grey	M20	T2_M20_Double			T2_M20_Double				U-SEC-17 / U-SEC-14C / U-SEC-14B / U-SEC-15

Cu Cl.2/XLPE/OS/LSZH/SWB/LSZH 150/250 V (300 V)

2X2,5 - INSTRUMENT CABLE - Flame Retardant - Not I.S.

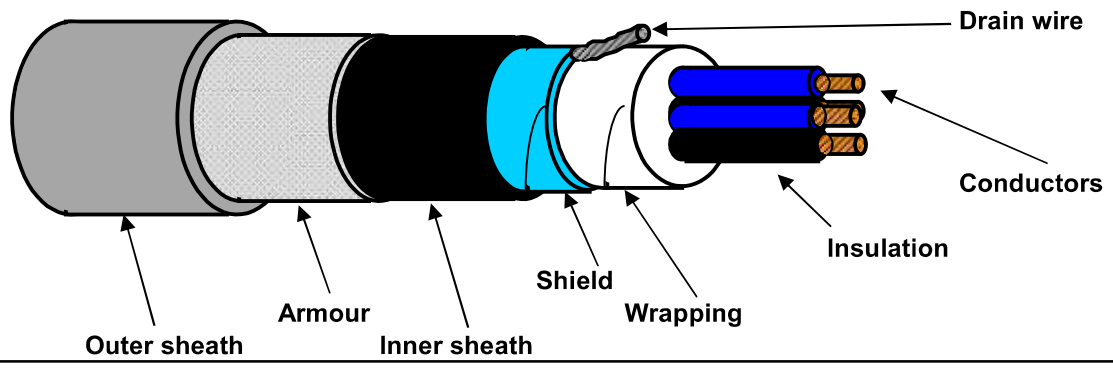

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	XLPE, Nominal Thickness 0,6 mm	
Cores colour code :	**Black NUMBERED (from 1 to 2)**	
Pair Assembling :	Not required	
Pair Wrapping:	Not required	
Drain wire :	Not required	
Pair Shield :	Not required	
Shield Insulation :	Not required	
Total Assembling :	9/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 1,0 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,1 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant, Average Thickness 1,2 mm	
Outer sheath color code:	**Grey**	
Outer printing (INKJET) : (every 1000 mm)	**FLEI - 2X2,5 SQMM - XLPE/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60332.1.2 - IEC 60332.3.22 - Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(8,9 ± 10%) mm	
Over armour diameter :	(9,7 ± 10%) mm	
Outer diameter :	(12,1 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 7,86 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided, lending assent for the treatment, will be used to the sense of the article 13 of of the Regulation (UE) 2016/679, also through outsiders, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ITEM	Tag	C-25-XY-008/00-JE-13002	: SOLENOID VALVE / MARSHALLING PCS	Dwg	123A90-DDL-IN-LIS-40091		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10000119	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX10

Multi/Single-Core Instrument Control Cable

CABLE DATA

Type: Cu-XLPE-OS-LSZH-SWB-LSZH | Cores/Size mm²: 2X2,5 mm2 | Color: GREY

From: 25-XY-008 To: 00-JE-13002

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	Note
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH		>999	MΩ
	CORE to CORE		>999	MΩ
	CORE to SCREEN		>999	MΩ
	CORE to ARMr		>999	MΩ
	SCREEN to EARTH		>999	MΩ
	SCREEN to ARMr		>999	MΩ
CONTINUITY	CORES		0,25	Ω
	SCREEN		0,25	Ω
	EARTH		NA	Ω
	ARMr		0,25	Ω
	TEST VOLTS		500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 Calibration date: N°LAT 042 00768/24 12/10/2024

Comments: Nota 5: refer to PL C30000682

Page 1/1	Performed by	☉ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-28	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-28T07:45:29.625Z	PROVERLIS Digitaly signed by Alessio Polo 2025-01-29T11:17:58.114Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

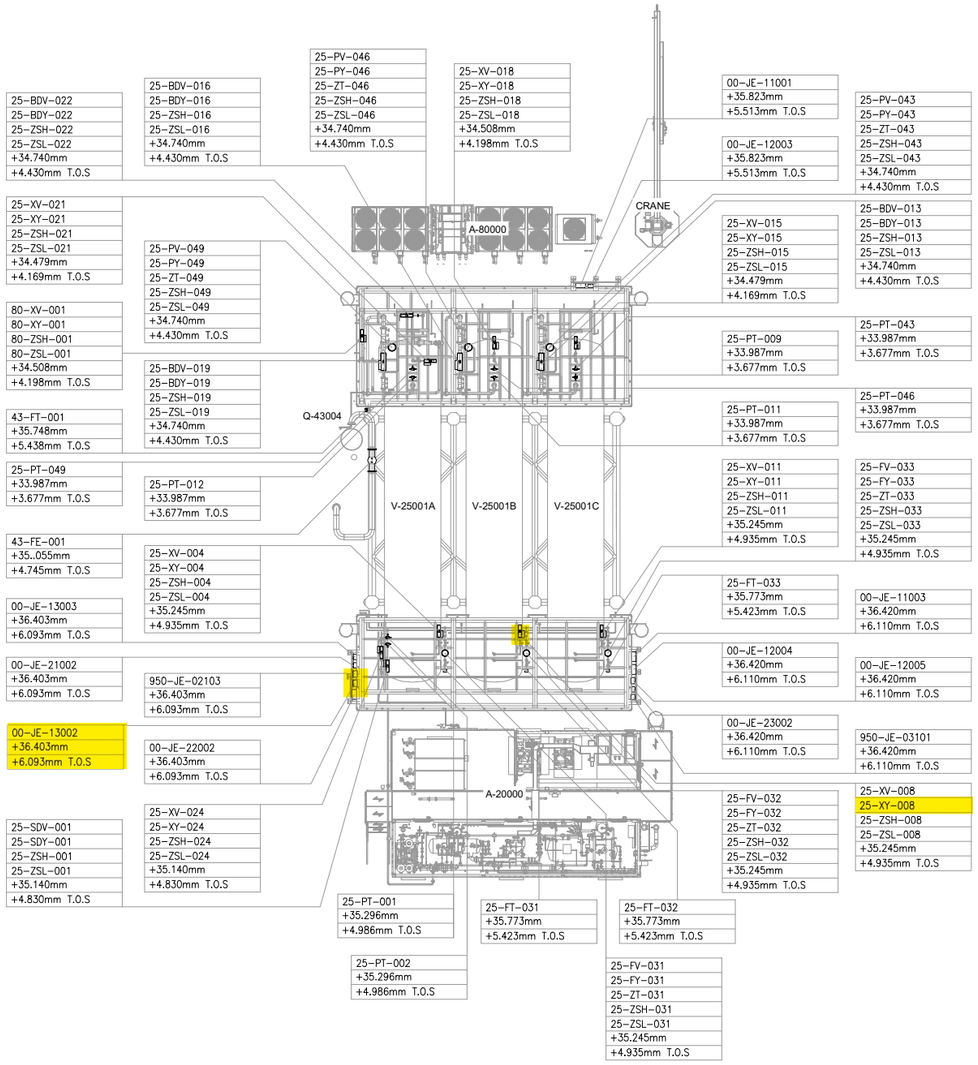

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90–DDL–IN–DL–40081	SHEET 002	REV. 02


File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-13002	No.	MARSHALLING CABINET B400-PCS-002

<01>

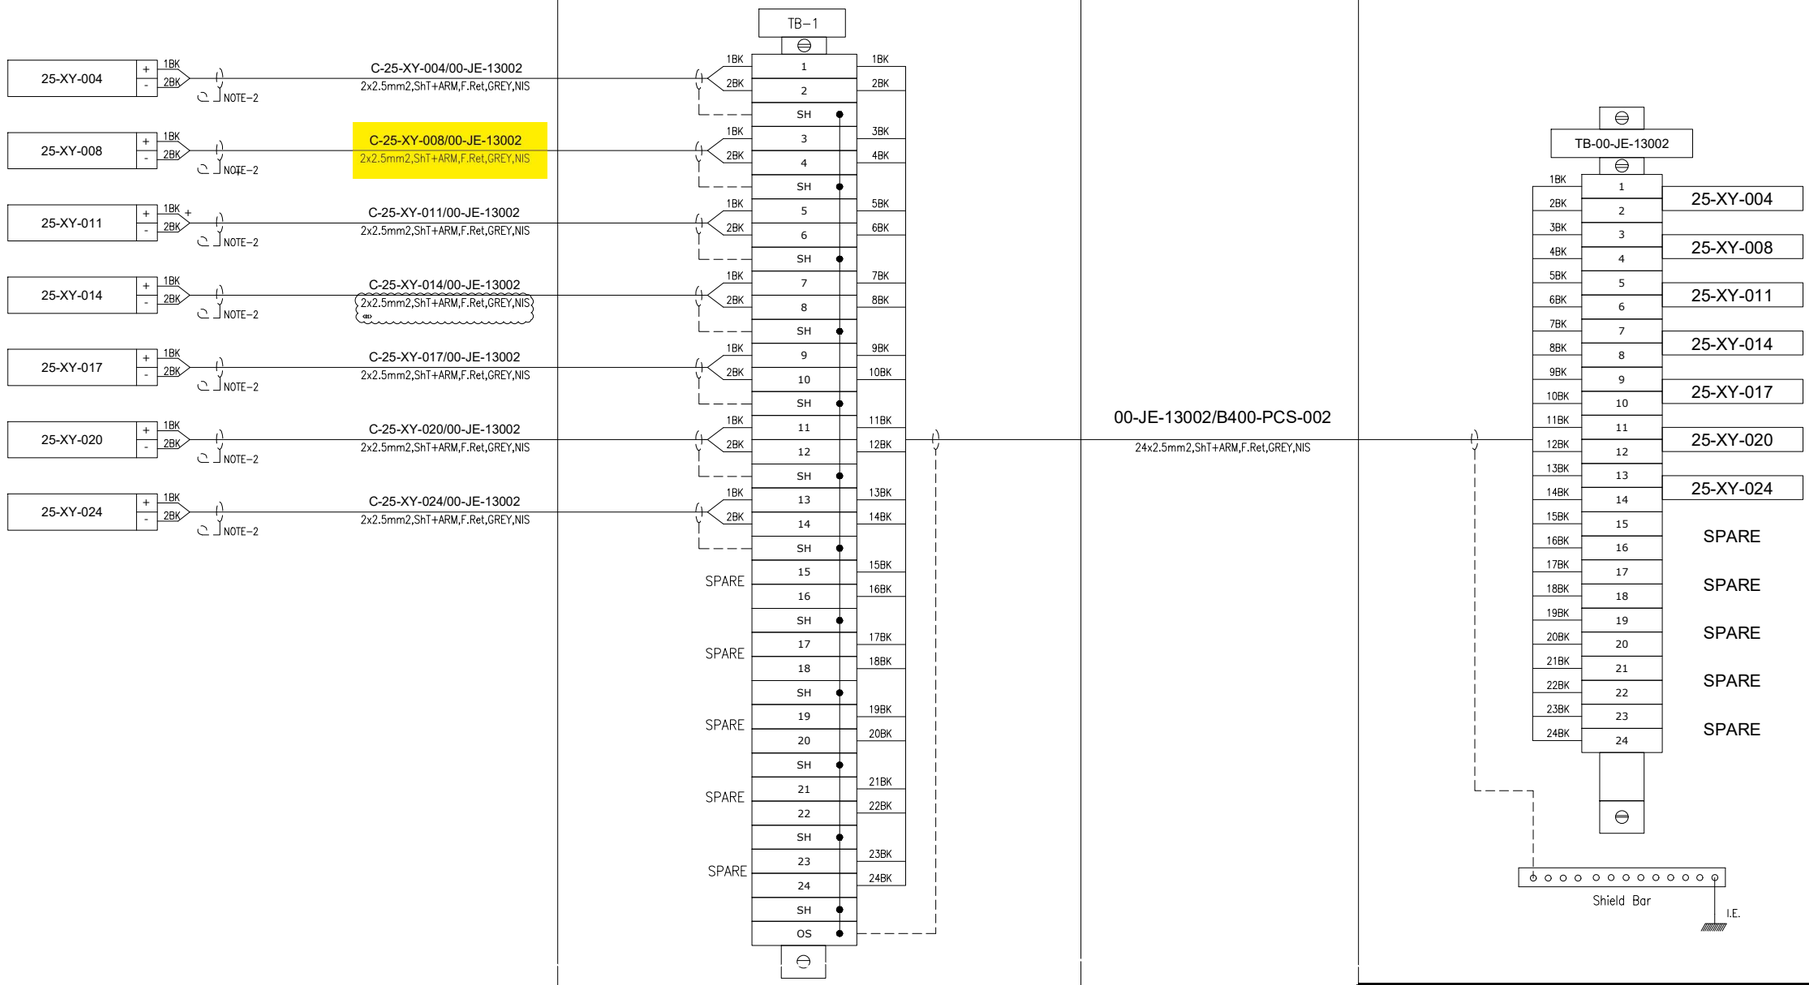

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-13002

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024
A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 029	REV. 01


File Name : 123A90-DDL-IN-DG-40015_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

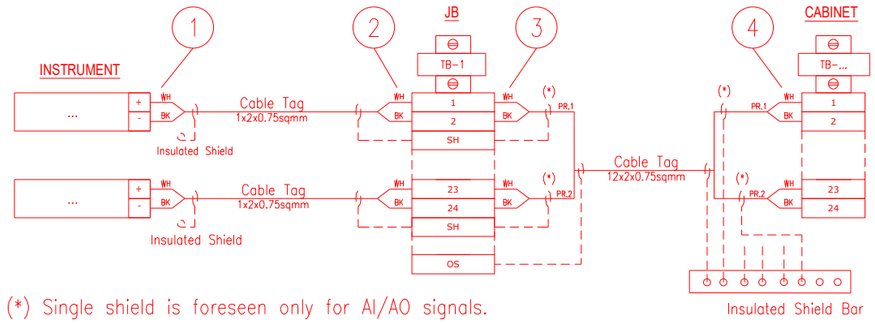

INSTRUMENT CONNECTION STRAIGHT TO CABINET



CABINET CONNECTION TO CABINET



1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 003	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Disciplii	Eng Stat	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland St	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-XY-008/00-JE-13002	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-XY-008	Solenoid Valve	Upper Deck	00-JE-13002	DO JB to PCS	Upper Deck	SMICV05-2X2,5	Cable Cu Cl.2/XLPE/OS/LSZH/SWB/LSZH 150/250V (300V) 2x2,5mm² - Grey	M20	T2_M20_Double			T2_M20_Double				U-SEC-18 / U-SEC-14D / U-SEC-14C / U-SEC-14B / U-SEC-15

Cu Cl.2/XLPE/OS/LSZH/SWB/LSZH 150/250 V (300 V)

2X2,5 - INSTRUMENT CABLE - Flame Retardant - Not I.S.

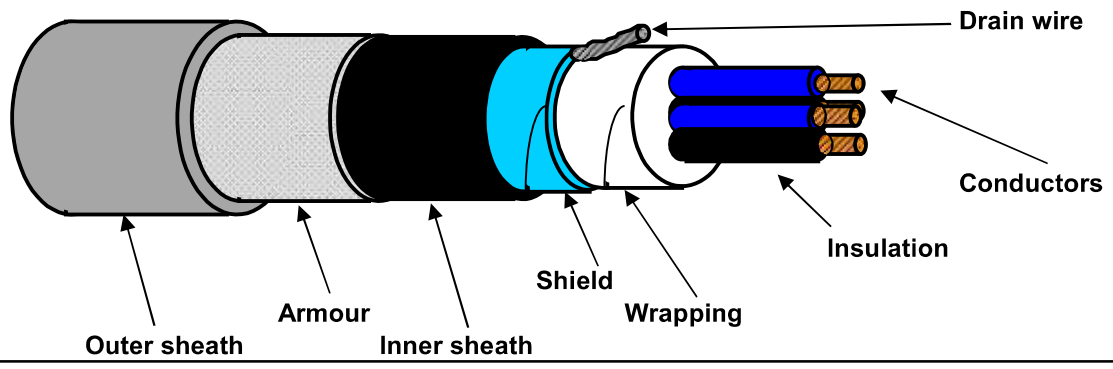

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	XLPE, Nominal Thickness 0,6 mm	
Cores colour code :	**Black NUMBERED (from 1 to 2)**	
Pair Assembling :	Not required	
Pair Wrapping:	Not required	
Drain wire :	Not required	
Pair Shield :	Not required	
Shield Insulation :	Not required	
Total Assembling :	9/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 1,0 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,1 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant, Average Thickness 1,2 mm	
Outer sheath color code:	**Grey**	
Outer printing (INKJET) : (every 1000 mm)	**FLEI - 2X2,5 SQMM - XLPE/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60332.1.2 - IEC 60332.3.22 - Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(8,9 ± 10%) mm	
Over armour diameter :	(9,7 ± 10%) mm	
Outer diameter :	(12,1 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 7,86 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided, lending assent for the treatment, will be used to the sense of the article 13 of of the Regulation (UE) 2016/679, also through outsiders, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ROSETTI MARINO — CROSSWIND

ITEM	Tag	C-25-XY-011/00-JE-13002	: SOLENOID VALVE / MARSHALLING PCS	Dwg	123A90-DDL-IN-LIS-40091		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10000120	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX10 Multi/Single-Core Instrument Control Cable

CABLE DATA

Type: Cu-XLPE-OS-LSZH-SWB-LSZH — Cores/Size mm²: 2X2,5 mm2 — Color: GREY

From: 25-XY-011 — To: 00-JE-13002

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	Note
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH		>999	MΩ
	CORE to CORE		>999	MΩ
	CORE to SCREEN		>999	MΩ
	CORE to ARMr		>999	MΩ
	SCREEN to EARTH		>999	MΩ
	SCREEN to ARMr		>999	MΩ
CONTINUITY	CORES		0,28	Ω
	SCREEN		0,28	Ω
	EARTH		NA	Ω
	ARMr		0,28	Ω
	TEST VOLTS		500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 — Calibration date: N°LAT 042 00768/24 12/10/2024

Comments: Nota 5: refer to PL C30000682

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-30	2025-02-05	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-30T09:57:56.904Z	PROVERLIS Digitaly signed by Alessio Polo 2025-02-05T15:47:16.565Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

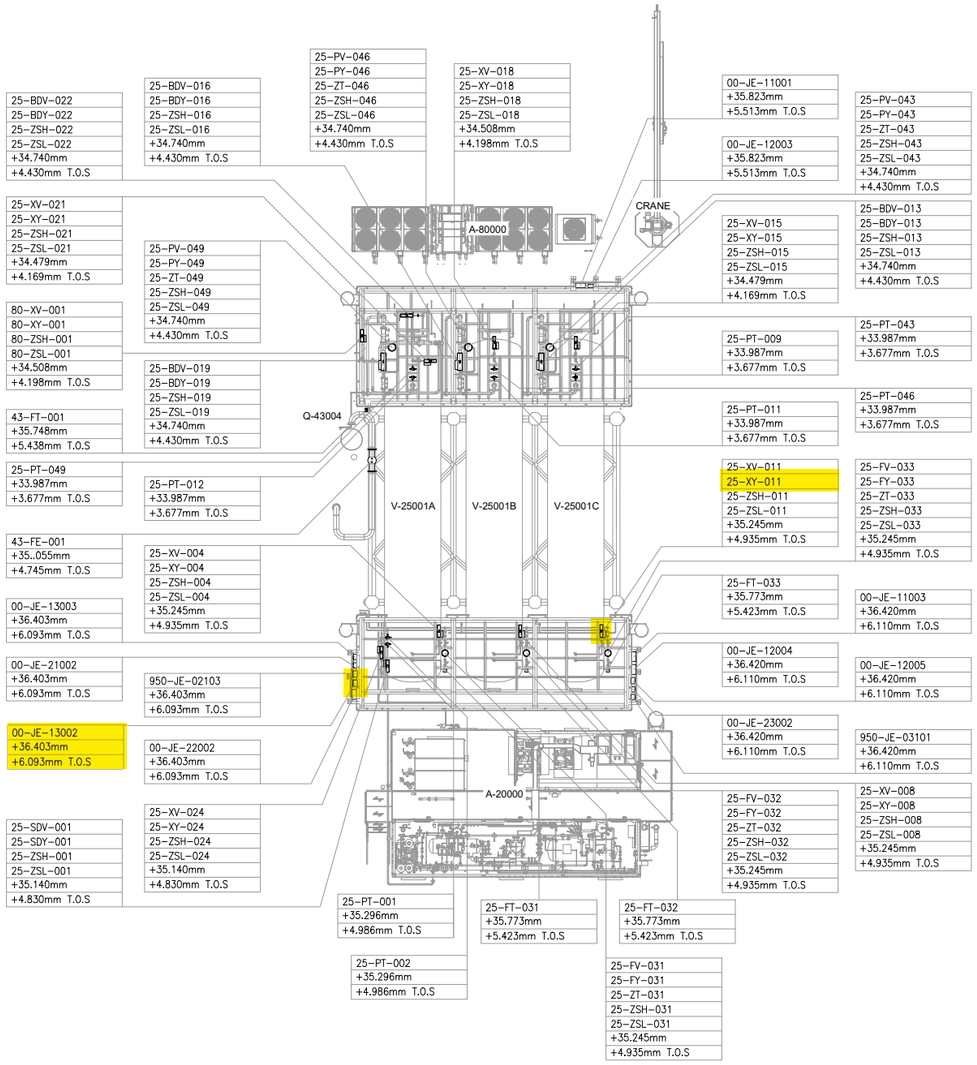

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO.	SHEET	REV.
	123A90–DDL–IN–DL–40081	002	02


File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-13002	No.	MARSHALLING CABINET B400-PCS-002

<01>

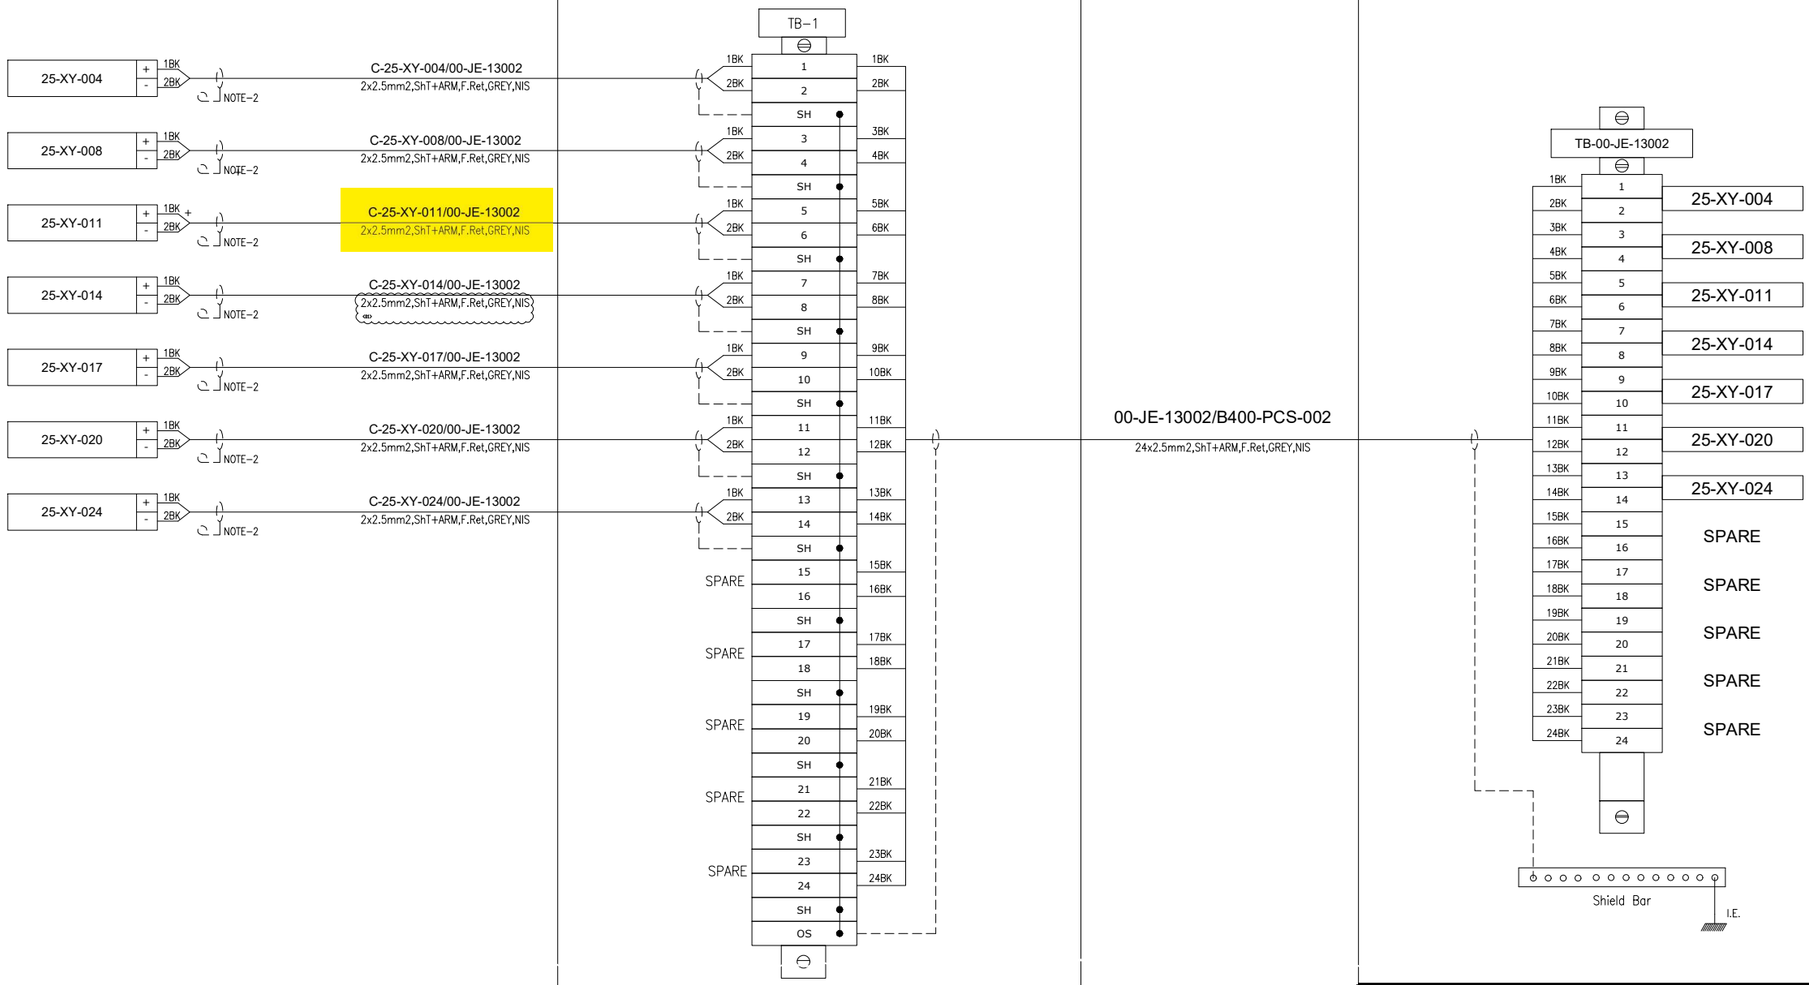

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_I	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-13002

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 029	REV. 01


File Name : 123A90-DDL-IN-DG-40015_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

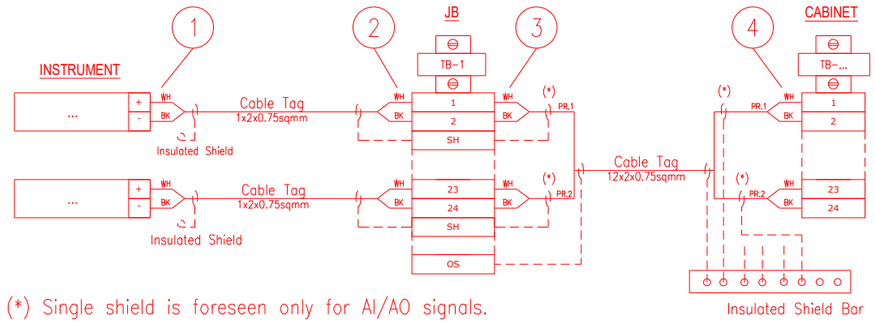

INSTRUMENT CONNECTION STRAIGHT TO CABINET

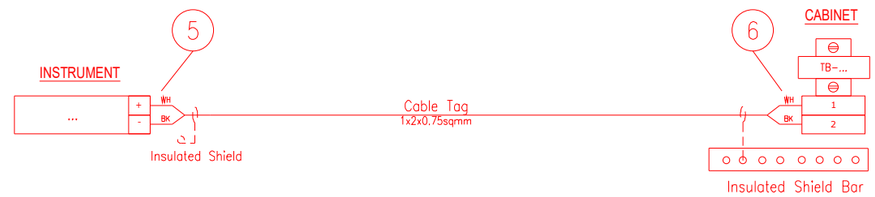

CABINET CONNECTION TO CABINET



1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_I	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


A3	DRAWING NO.	SHEET	REV.
	123A90-DDL-IN-DG-40015	003	01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Disciplii	Eng Stat	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland St	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-XY-011/00-JE-13002	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-XY-011	Solenoid Valve	Upper Deck	00-JE-13002	DO JB to PCS	Upper Deck	SMICV05-2X2,5	Cable Cu Cl.2/XLPE/OS/LSZH/SWB/LSZH 150/250V (300V) 2x2,5mm² - Grey	M20	T2_M20_Double			T2_M20_Double				U-SEC-19 / U-SEC-14E / U-SEC-14D / U-SEC-14C / U-SEC-14B / U-SEC-15

Cu Cl.2/XLPE/OS/LSZH/SWB/LSZH 150/250 V (300 V)

2X2,5 - INSTRUMENT CABLE - Flame Retardant - Not I.S.

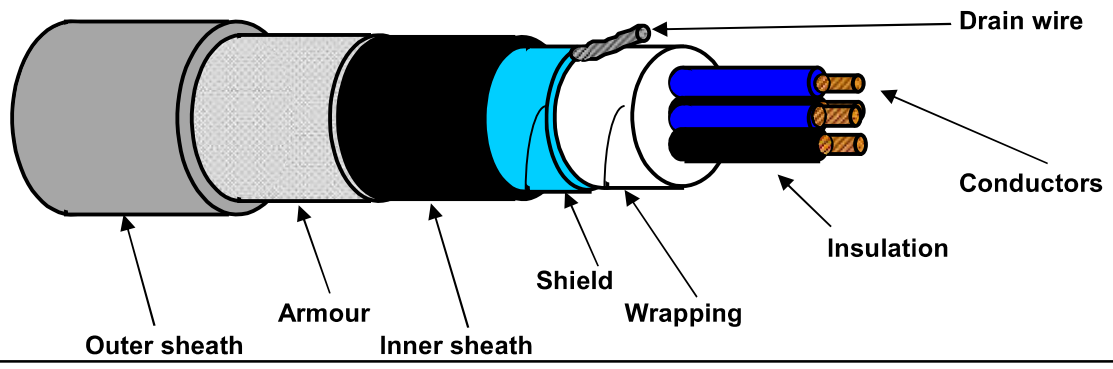

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	XLPE, Nominal Thickness 0,6 mm	
Cores colour code :	**Black NUMBERED (from 1 to 2)**	
Pair Assembling :	Not required	
Pair Wrapping:	Not required	
Drain wire :	Not required	
Pair Shield :	Not required	
Shield Insulation :	Not required	
Total Assembling :	9/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 1,0 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,1 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant, Average Thickness 1,2 mm	
Outer sheath color code:	**Grey**	
Outer printing (INKJET) : (every 1000 mm)	**FLEI - 2X2,5 SQMM - XLPE/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60332.1.2 - IEC 60332.3.22 - Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(8,9 ± 10%) mm	
Over armour diameter :	(9,7 ± 10%) mm	
Outer diameter :	(12,1 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 7,86 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided, lending assent for the treatment, will be used to the sense of the article 13 of of the Regulation (UE) 2016/679, also through outsiders, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ITEM	Tag	C-25-XY-014/00-JE-13002	: SOLENOID VALVE / MARSHALLING PCS	Dwg	123A90-DDL-IN-LIS-40091		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10000121	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX10

Multi/Single-Core Instrument Control Cable

CABLE DATA

Type: Cu-XLPE-OS-LSZH-SWB-LSZH | Cores/Size mm²: 2X2,5 mm2 | Color: GREY

From: 25-XY-014 | To: 00-JE-13002

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	Note
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH	>999	MΩ
	CORE to CORE	>999	MΩ
	CORE to SCREEN	>999	MΩ
	CORE to ARMr	>999	MΩ
	SCREEN to EARTH	>999	MΩ
	SCREEN to ARMr	>999	MΩ
CONTINUITY	CORES	0,40	Ω
	SCREEN	0,40	Ω
	EARTH	NA	Ω
	ARMr	0,40	Ω
	TEST VOLTS	500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 | Calibration date: N°LAT 042 00768/24 12/10/2024

Comments: Nota 5: refer to PL C30000682

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Giovanni Tangianu	
Date	2025-01-25	2025-01-29	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-25T13:39:38.830Z	PROVERLIS Digitaly signed by Giovanni Tangianu 2025-01-29T13:10:48.077Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

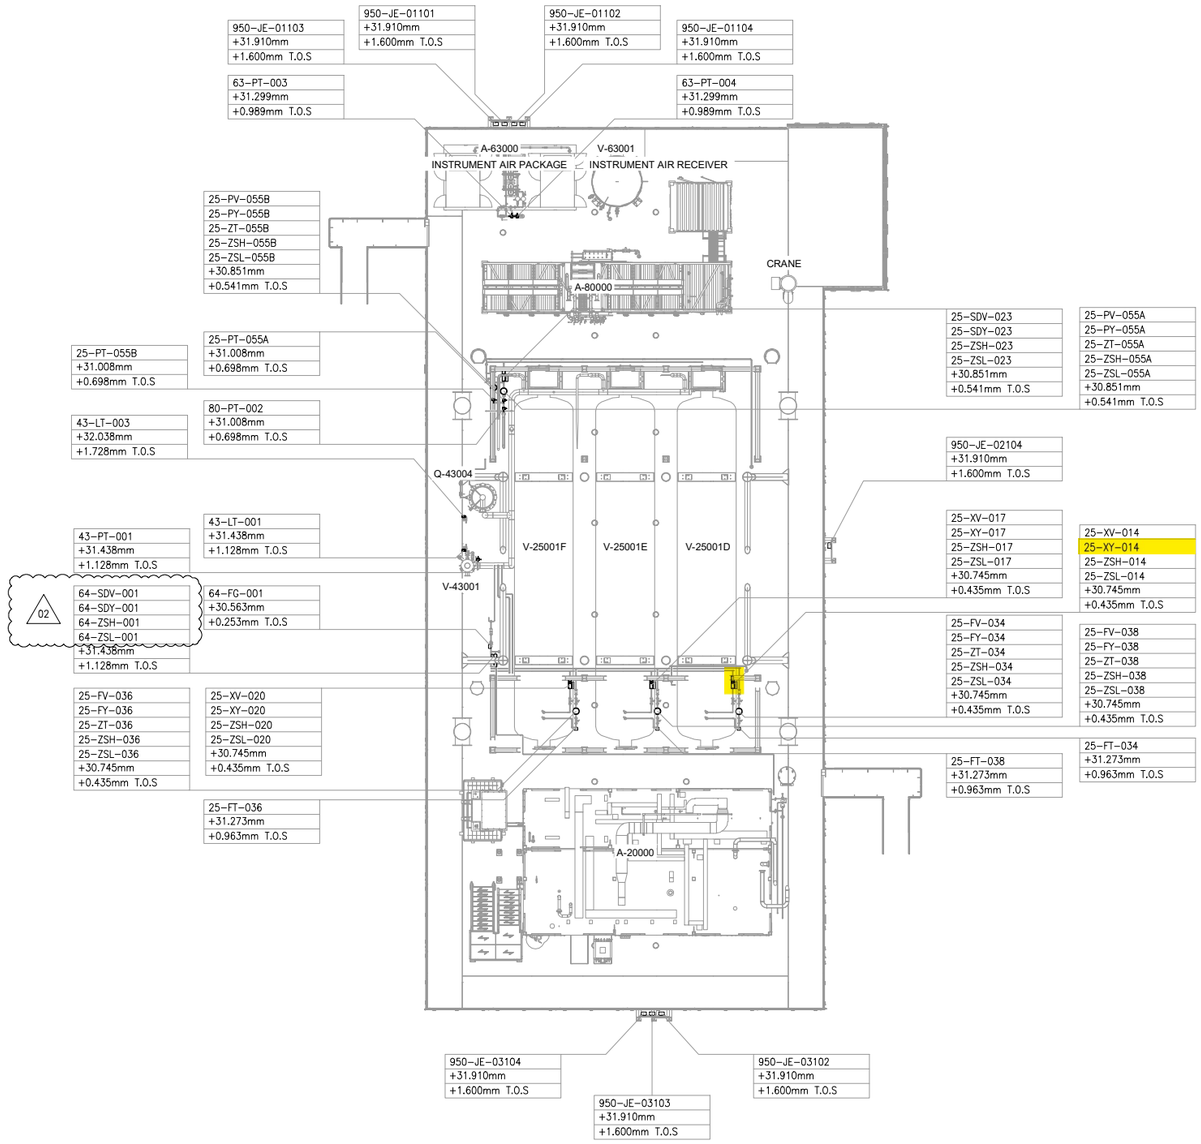


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40081**


REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

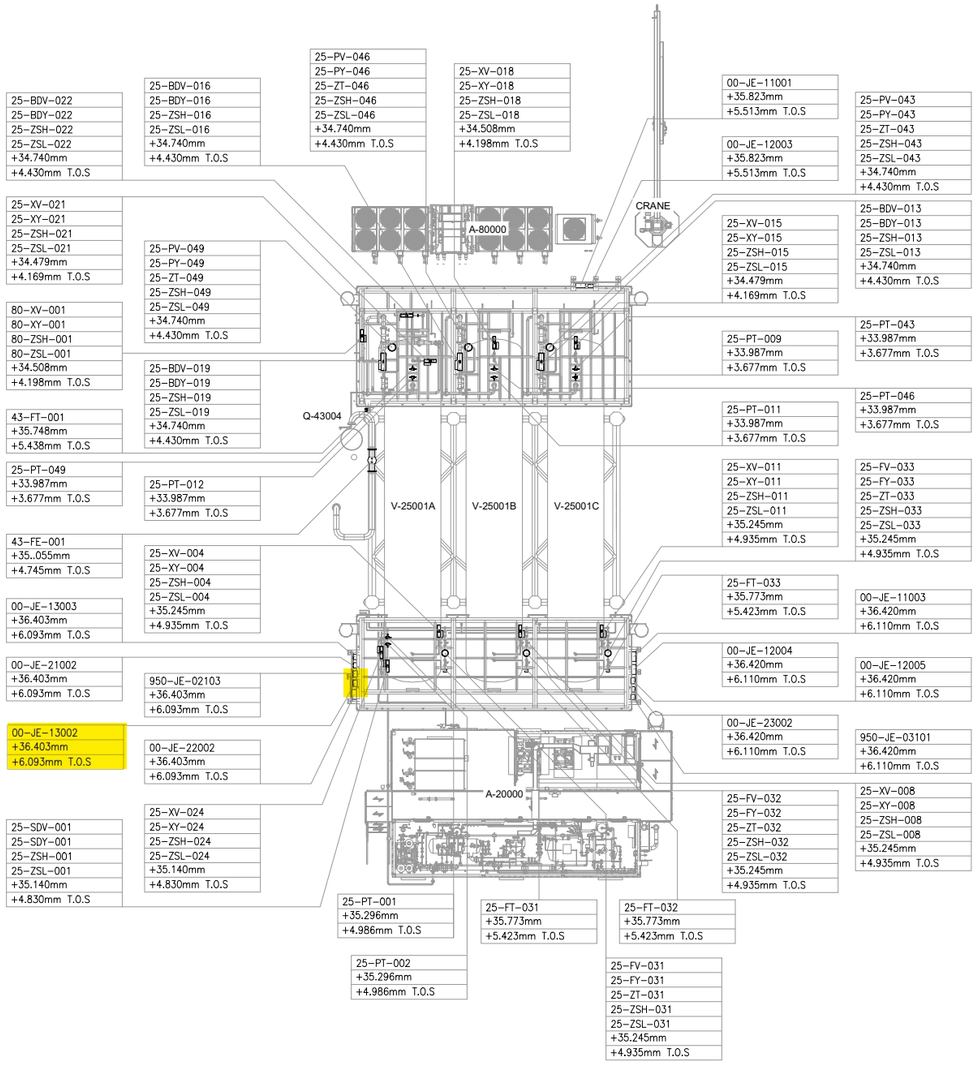

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081
REV.: 2_A | DATE: 07/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02


File Name : 123A90-DDL-IN-DL-40081 REV02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-13002	No.	MARSHALLING CABINET B400-PCS-002

<01>

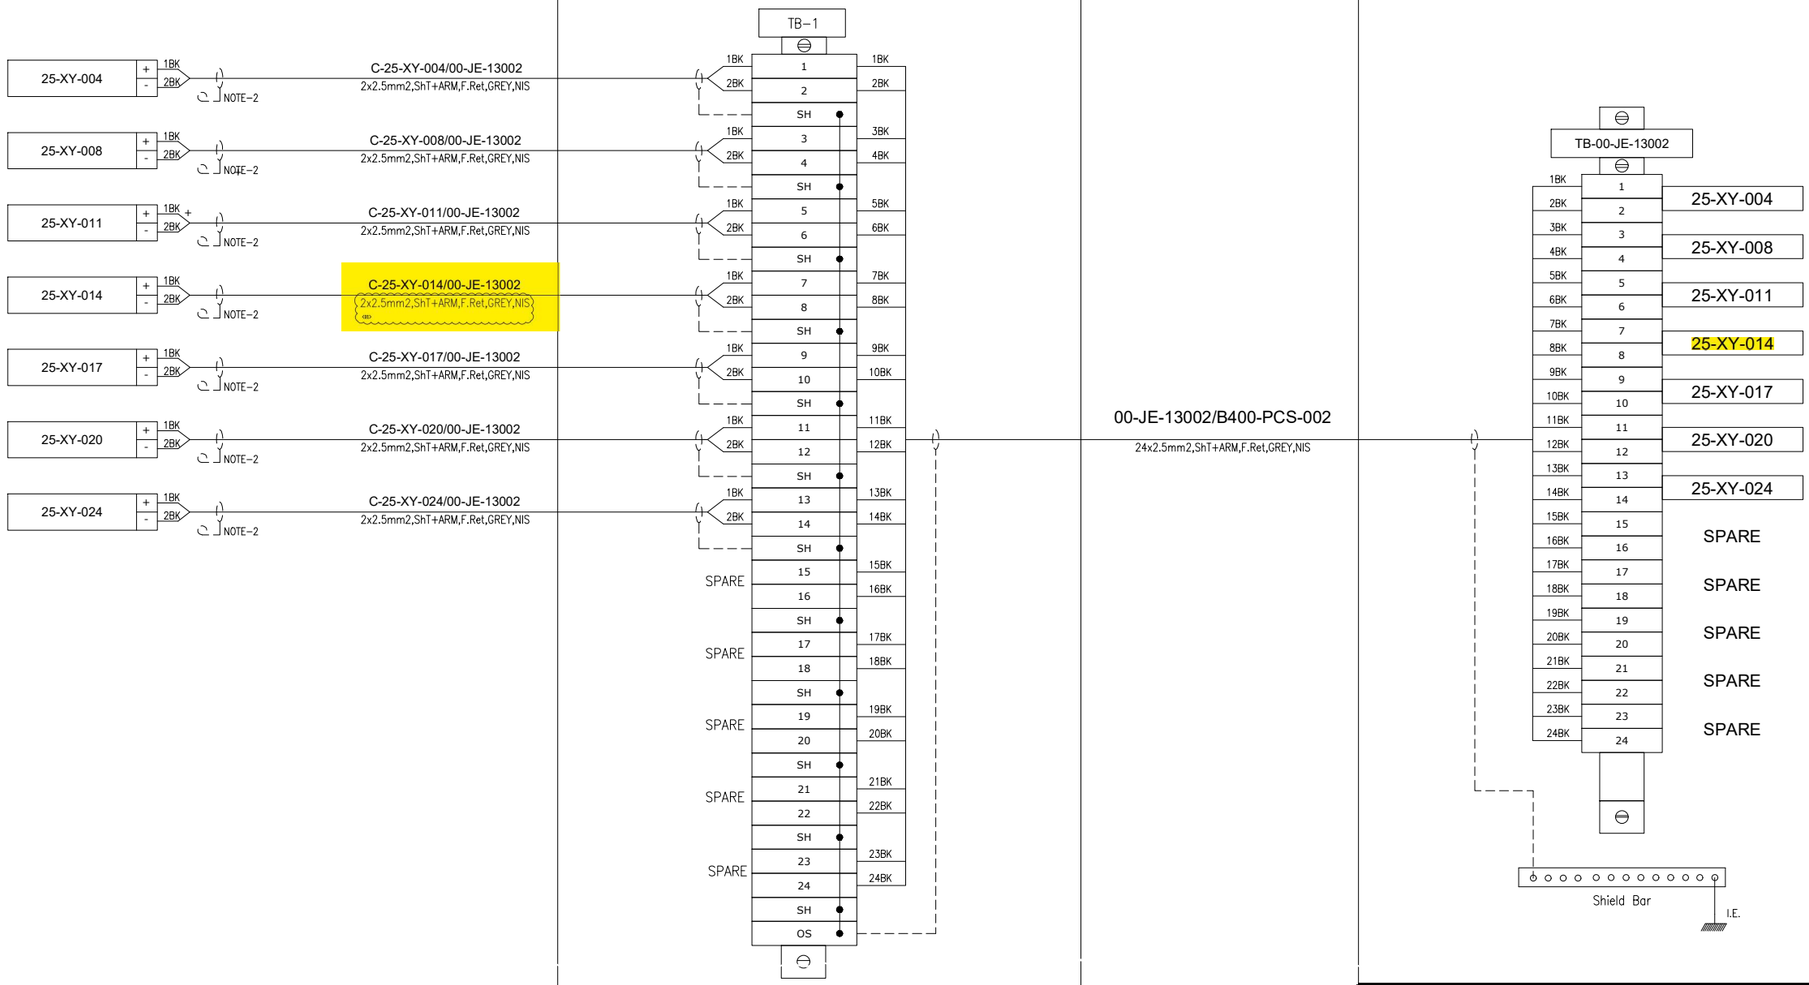

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-13002

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 029	REV. 01


File Name : 123A90-DDL-IN-DG-40015_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

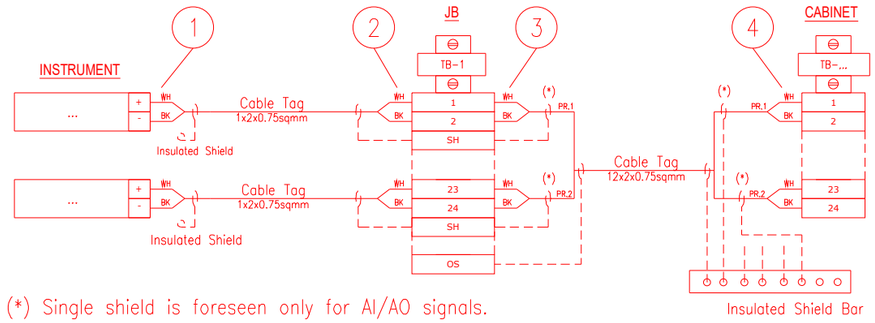

INSTRUMENT CONNECTION STRAIGHT TO CABINET



CABINET CONNECTION TO CABINET



1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 003	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Disciplii	Eng Stat	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland St	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-XY-014/00-JE-13002	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-XY-014	Solenoid Valve	Upper Deck	00-JE-13002	DO JB to PCS	Upper Deck	SMICV05-2X2,5	Cable Cu Cl.2/XLPE/OS/LSZH/SWB/LSZH 150/250V (300V) 2x2,5mm² - Grey	M20	T2_M20_Double			T2_M20_Double				U-SEC-19 / U-SEC-14E / U-SEC-14D / U-SEC-14C / U-SEC-14B / U-SEC-15

Cu Cl.2/XLPE/OS/LSZH/SWB/LSZH 150/250 V (300 V)

2X2,5 - INSTRUMENT CABLE - Flame Retardant - Not I.S.

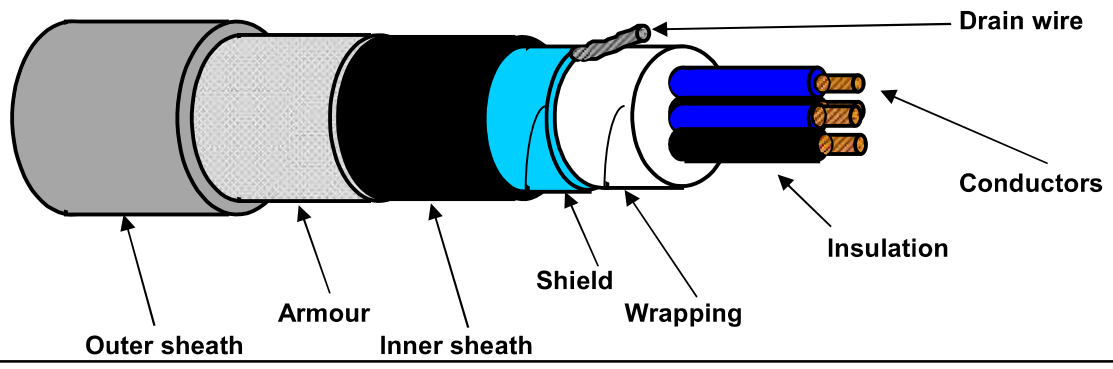

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	XLPE, Nominal Thickness 0,6 mm	
Cores colour code :	**Black NUMBERED (from 1 to 2)**	
Pair Assembling :	Not required	
Pair Wrapping:	Not required	
Drain wire :	Not required	
Pair Shield :	Not required	
Shield Insulation :	Not required	
Total Assembling :	9/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 1,0 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,1 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant, Average Thickness 1,2 mm	
Outer sheath color code:	**Grey**	
Outer printing (INKJET) : (every 1000 mm)	**FLEI - 2X2,5 SQMM - XLPE/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60332.1.2 - IEC 60332.3.22 - Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(8,9 ± 10%) mm	
Over armour diameter :	(9,7 ± 10%) mm	
Outer diameter :	(12,1 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 7,86 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided, lending assent for the treatment, will be used to the sense of the article 13 of of the Regulation (UE) 2016/679, also through outsiders, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ROSETTI MARINO — CROSSWIND

ITEM	Tag	C-25-XY-017/00-JE-13002	: SOLENOID VALVE / MARSHALLING PCS	Dwg	123A90-DDL-IN-LIS-40091		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10000122	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX10

Multi/Single-Core Instrument Control Cable

CABLE DATA

Type	Cu-XLPE-OS-LSZH-SWB-LSZH	Cores/Size mm²	2X2,5 mm2	Color	GREY
From	25-XY-017	To	00-JE-13002		

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	PL
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH		>999	MΩ
	CORE to CORE		>999	MΩ
	CORE to SCREEN		>999	MΩ
	CORE to ARMr		>999	MΩ
	SCREEN to EARTH		>999	MΩ
	SCREEN to ARMr		>999	MΩ
CONTINUITY	CORES		0,30	Ω
	SCREEN		0,30	Ω
	EARTH		NA	Ω
	ARMr		0,30	Ω
	TEST VOLTS		500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 Calibration date: N°LAT 042 00768/24 12/10/2024

Comments Nota 5: refer to PL C30000682

Page 1/1	Performed by	☉ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Giovanni Tangianu	
Date	2025-01-28	2025-01-29	
Signature	Digitaly signed by Michele Tartaglia 2025-01-28T07:45:51.748Z	Digitaly signed by Giovanni Tangianu 2025-01-29T13:13:29.885Z	

DRAWING NO. 123A90-DDL-IN-DL-40081

REV. 01

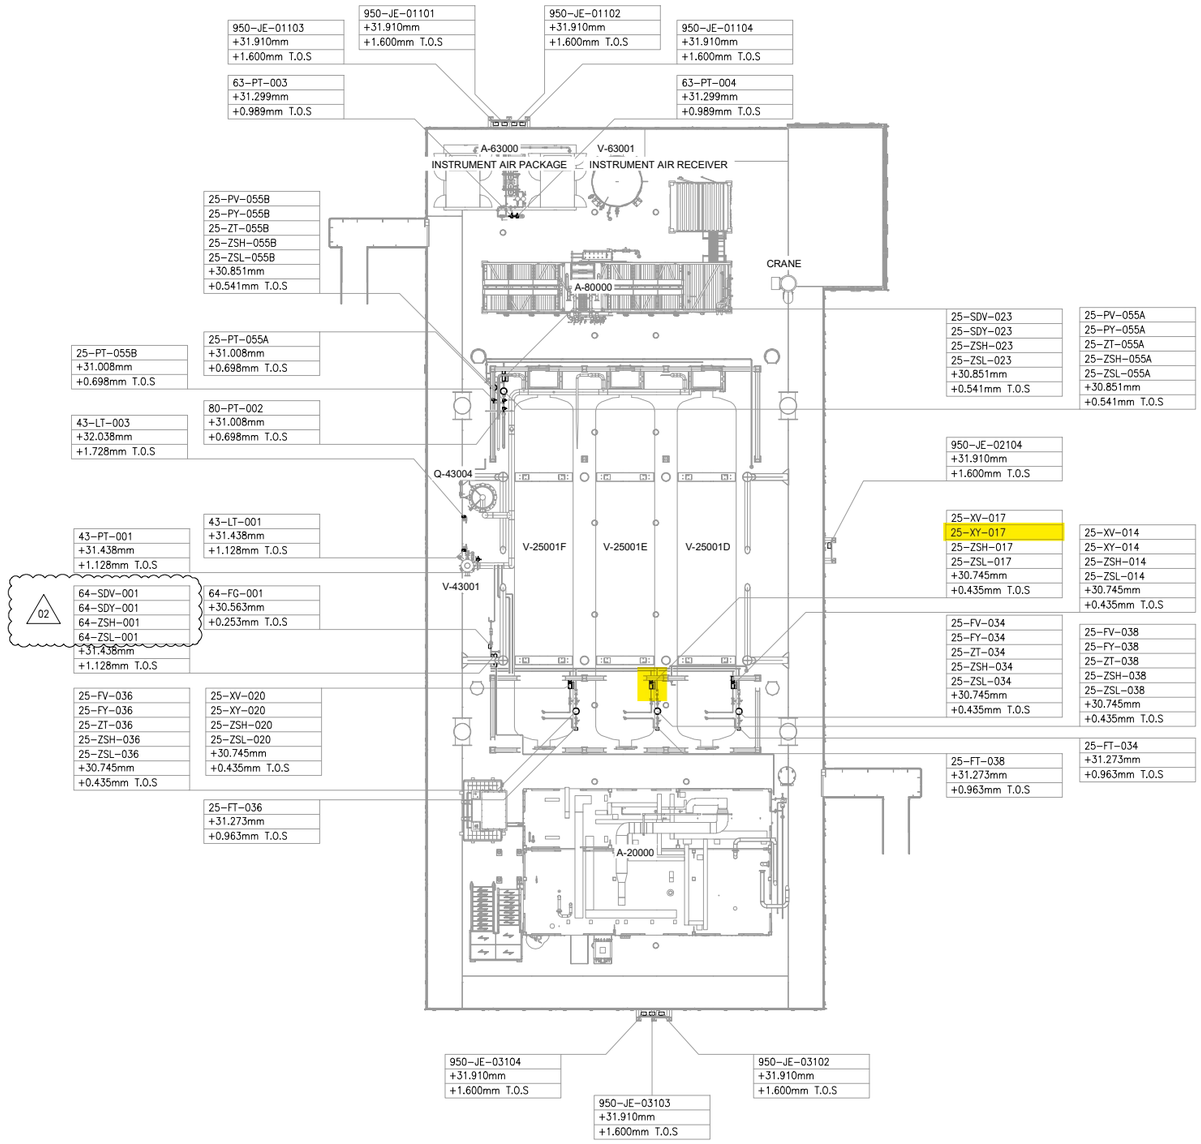


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

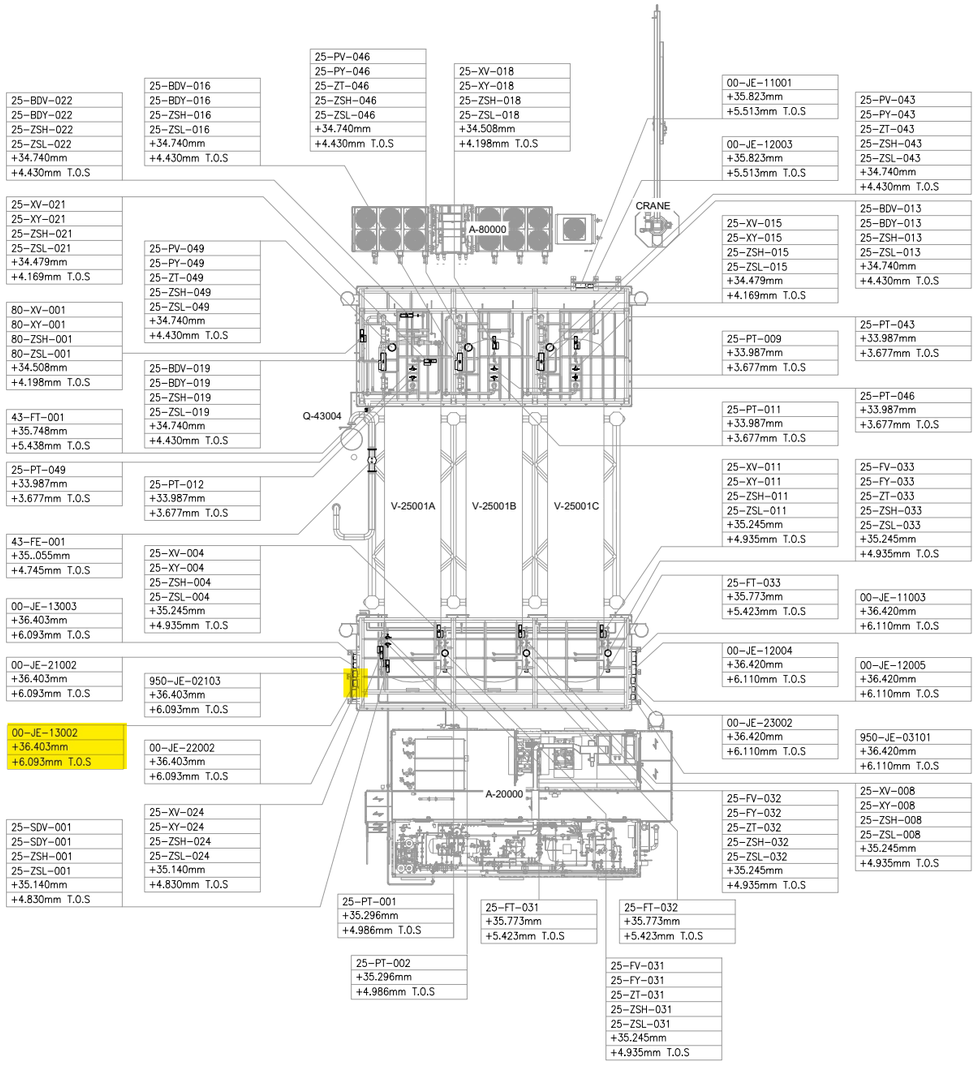

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081
REV.: 2_A | DATE: 07/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02


File Name : 123A90-DDL-IN-DL-40081 REV02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-13002	No.	MARSHALLING CABINET B400-PCS-002

<01>

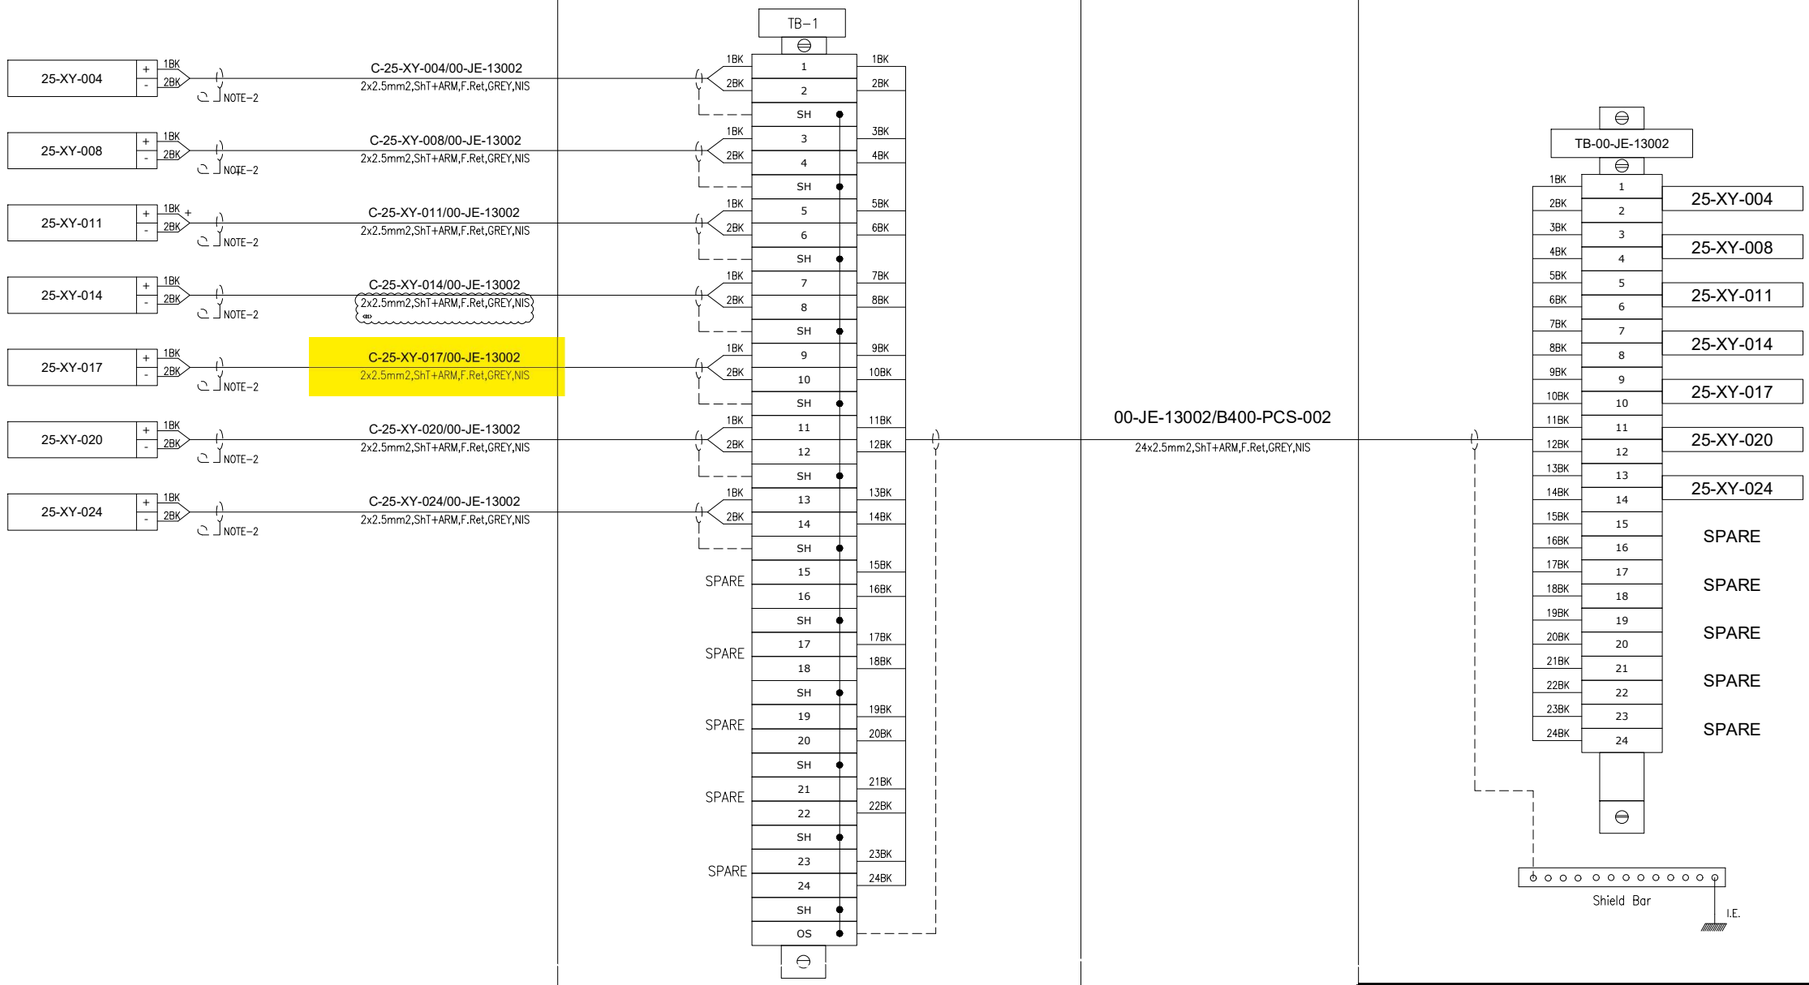

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-13002

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 029	REV. 01


File Name : 123A90-DDL-IN-DG-40015_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

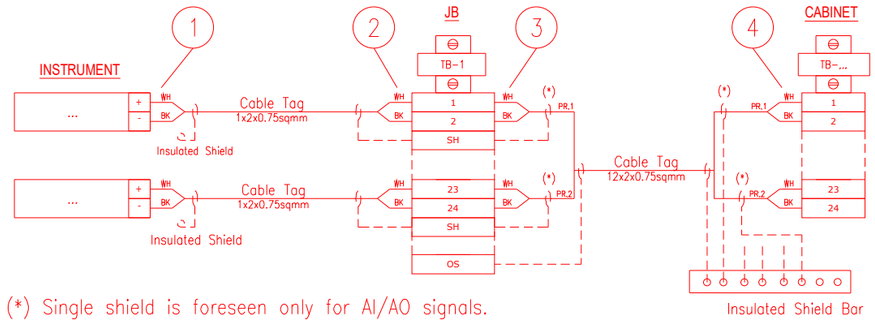

INSTRUMENT CONNECTION STRAIGHT TO CABINET



CABINET CONNECTION TO CABINET



1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 003	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Disciplii	Eng Stat	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland St	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-XY-017/00-JE-13002	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-XY-017	Solenoid Valve	Upper Deck	00-JE-13002	DO JB to PCS	Upper Deck	SMICV05-2X2,5	Cable Cu Cl.2/XLPE/OS/LSZH/SWB/LSZH 150/250V (300V) 2x2,5mm² - Grey	M20	T2_M20_Double			T2_M20_Double				U-SEC-18 / U-SEC-14D / U-SEC-14C / U-SEC-14B / U-SEC-15

Cu Cl.2/XLPE/OS/LSZH/SWB/LSZH 150/250 V (300 V)

2X2,5 - INSTRUMENT CABLE - Flame Retardant - Not I.S.

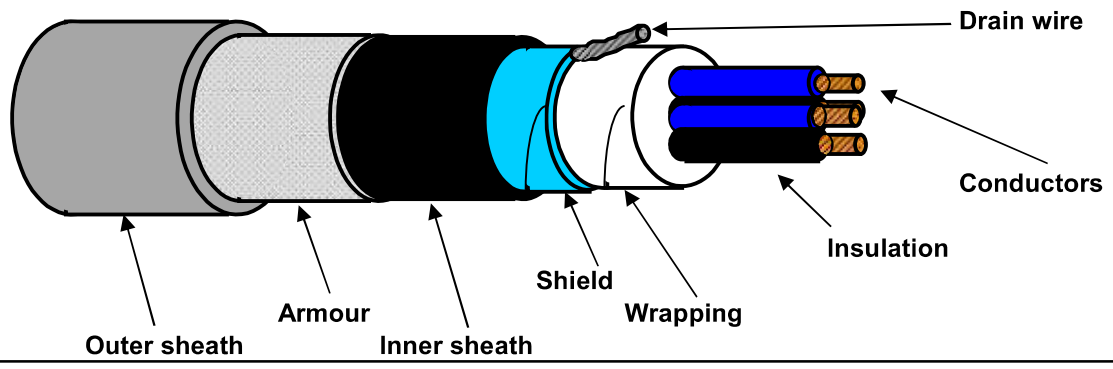

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	XLPE, Nominal Thickness 0,6 mm	
Cores colour code :	**Black NUMBERED (from 1 to 2)**	
Pair Assembling :	Not required	
Pair Wrapping:	Not required	
Drain wire :	Not required	
Pair Shield :	Not required	
Shield Insulation :	Not required	
Total Assembling :	9/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 1,0 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,1 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant, Average Thickness 1,2 mm	
Outer sheath color code:	**Grey**	
Outer printing (INKJET) : (every 1000 mm)	**FLEI - 2X2,5 SQMM - XLPE/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60332.1.2 - IEC 60332.3.22 - Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(8,9 ± 10%) mm	
Over armour diameter :	(9,7 ± 10%) mm	
Outer diameter :	(12,1 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 7,86 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided, lending assent for the treatment, will be used to the sense of the article 13 of of the Regulation (UE) 2016/679, also through outsiders, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ROSETTI MARINO — CROSSWIND

ITEM	Tag	C-25-XY-020/00-JE-13002	: SOLENOID VALVE / MARSHALLING PCS	Dwg	123A90-DDL-IN-LIS-40091		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10000123	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX10

Multi/Single-Core Instrument Control Cable

CABLE DATA

Type: Cu-XLPE-OS-LSZH-SWB-LSZH — Cores/Size mm²: 2X2,5 mm2 — Color: GREY

From: 25-XY-020 — To: 00-JE-13002

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	Note
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH		>999	MΩ
	CORE to CORE		>999	MΩ
	CORE to SCREEN		>999	MΩ
	CORE to ARMr		>999	MΩ
	SCREEN to EARTH		>999	MΩ
	SCREEN to ARMr		>999	MΩ
CONTINUITY	CORES		0,40	Ω
	SCREEN		0,40	Ω
	EARTH		NA	Ω
	ARMr		0,40	Ω
	TEST VOLTS		500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 — Calibration date: N°LAT 042 00768/24 12/10/2024

Comments: Nota 5: refer to PL C30000682

Page 1/1	Performed by	☉ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Giovanni Tangianu	
Date	2025-01-25	2025-01-29	
Signature	Digitaly signed by Michele Tartaglia 2025-01-25T13:40:12.410Z	Digitaly signed by Giovanni Tangianu 2025-01-29T13:20:20.967Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 01

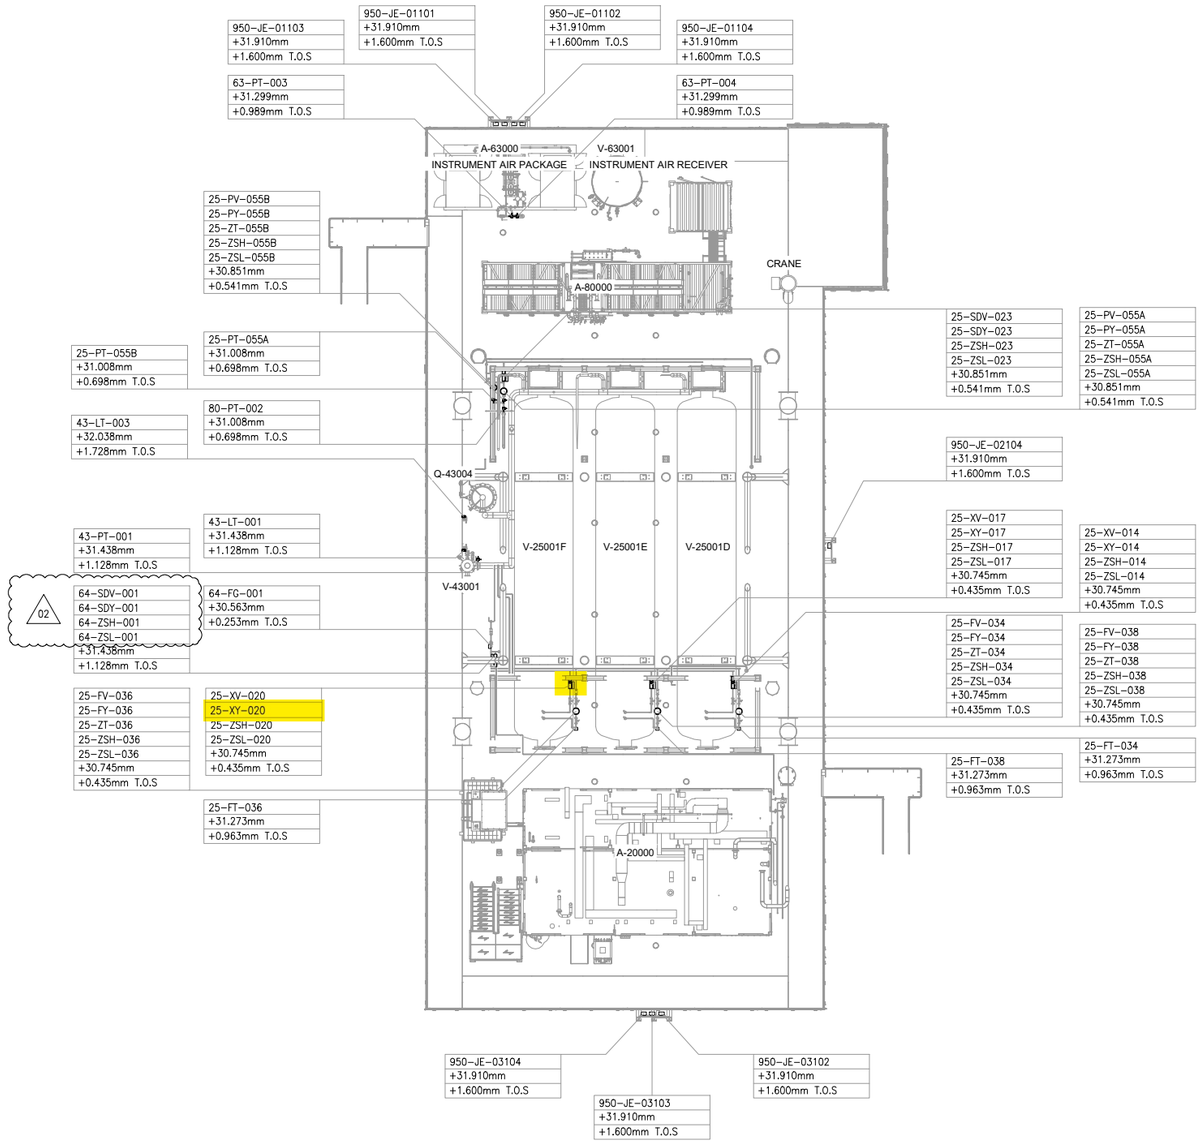


UPPER DECK

SCALE: 1:100

VIEW EL. 29310mm to 33740mm





NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT - LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	26/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 001	REV. 02

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40081**


REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

File Name : 123A90-DDL-IN-DL-40081 REV01.dwg

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

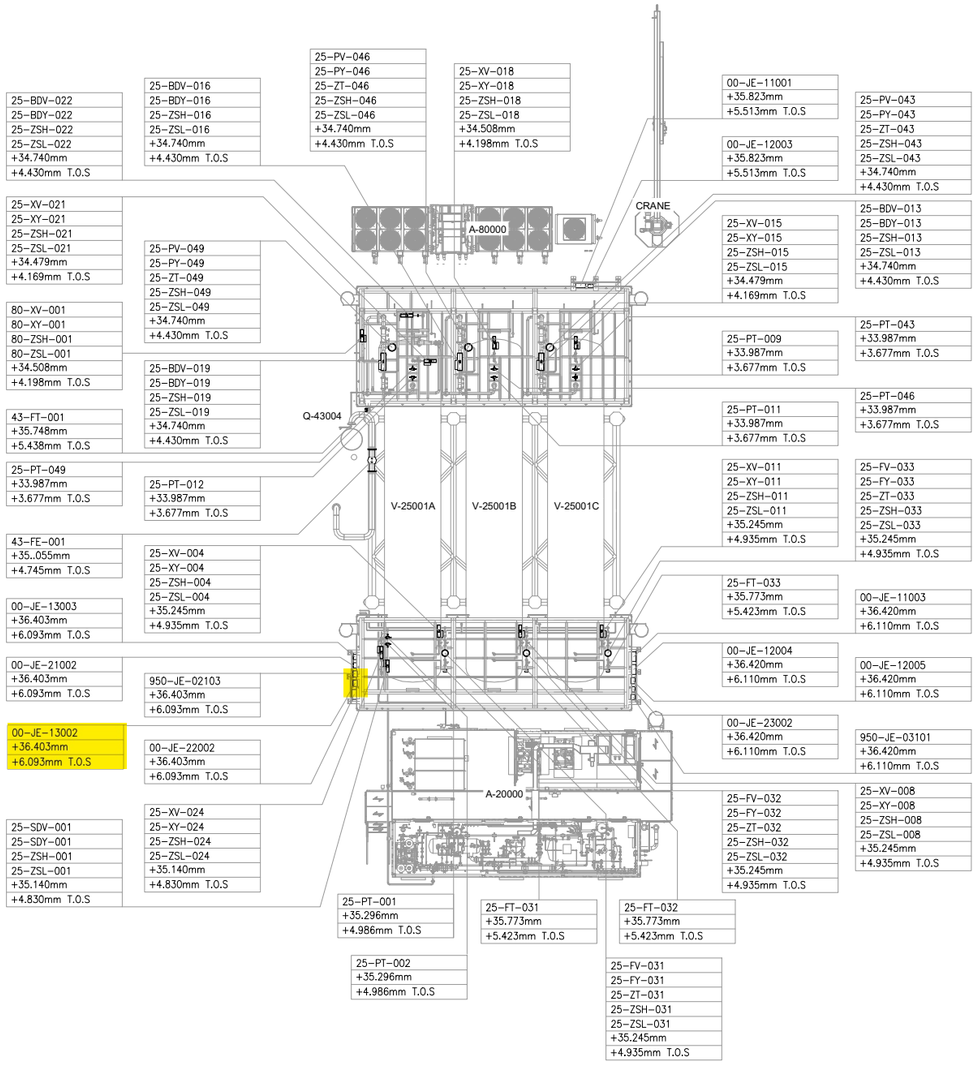

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081
REV.: 2_A | DATE: 07/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-13002	No.	MARSHALLING CABINET B400-PCS-002

<01>

INSTRUMENTS	JUNCTION BOX 00-JE-13002	MULTICABLE No.	MARSHALLING CABINET B400-PCS-002
25-XY-004 (+ 1BK / - 2BK) NOTE-2	C-25-XY-004/00-JE-13002 2x2.5mm2,ShT+ARM,F.Ret,GREY,NIS	00-JE-13002/B400-PCS-002 24x2.5mm2,ShT+ARM,F.Ret,GREY,NIS	TB-00-JE-13002 1 → 25-XY-004
25-XY-008 (+ 1BK / - 2BK) NOTE-2	C-25-XY-008/00-JE-13002 2x2.5mm2,ShT+ARM,F.Ret,GREY,NIS		2 → 25-XY-008
25-XY-011 (+ 1BK / - 2BK) NOTE-2	C-25-XY-011/00-JE-13002 2x2.5mm2,ShT+ARM,F.Ret,GREY,NIS		3 → 25-XY-011
25-XY-014 (+ 1BK / - 2BK) NOTE-2	C-25-XY-014/00-JE-13002 2x2.5mm2,ShT+ARM,F.Ret,GREY,NIS		4 → 25-XY-014
25-XY-017 (+ 1BK / - 2BK) NOTE-2	C-25-XY-017/00-JE-13002 2x2.5mm2,ShT+ARM,F.Ret,GREY,NIS		5 → 25-XY-017
25-XY-020 (+ 1BK / - 2BK) NOTE-2	C-25-XY-020/00-JE-13002 2x2.5mm2,ShT+ARM,F.Ret,GREY,NIS		6 → 25-XY-020
25-XY-024 (+ 1BK / - 2BK) NOTE-2	C-25-XY-024/00-JE-13002 2x2.5mm2,ShT+ARM,F.Ret,GREY,NIS		7 → 25-XY-024
			8 → SPARE
			9 → SPARE
			10 → SPARE
			11 → SPARE
			12 → SPARE
			13 → SPARE
			14 → SPARE
			15 → SPARE
			16 → SPARE
			17 → SPARE
			18 → SPARE
			19 → SPARE
			20 → SPARE
			21 → SPARE
			22 → SPARE
			23 → SPARE
			24 → SPARE
			Shield Bar — I.E.

TB-1: 1BK/2BK, 1, 2, SH, 3BK/4BK, 3, 4, SH, 5BK/6BK, 5, 6, SH, 7BK/8BK, 7, 8, SH, 9BK/10BK, 9, 10, SH, 11BK/12BK, 11, 12, SH, 13BK/14BK, 13, 14, SH, 15BK/16BK, SPARE, 15, 16, SH, 17BK/18BK, SPARE, 17, 18, SH, 19BK/20BK, SPARE, 19, 20, SH, 21BK/22BK, SPARE, 21, 22, SH, 23BK/24BK, SPARE, 23, 24, SH, OS

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-13002

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 029	REV. 01


File Name : 123A90-DDL-IN-DG-40015_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

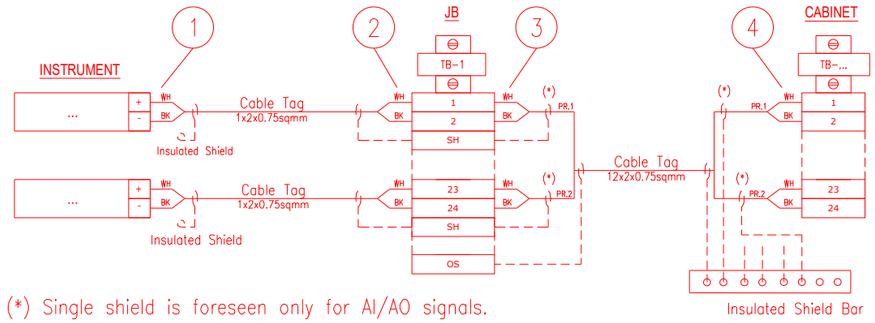

INSTRUMENT CONNECTION STRAIGHT TO CABINET



CABINET CONNECTION TO CABINET



1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_H	24/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 003	REV. 01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Discipline	Eng Status	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland Standard	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-XY-020/00-JE-13002	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-XY-020	Solenoid Valve	Upper Deck	00-JE-13002	DO JB to PCS	Upper Deck	SMICV05-2X2,5	Cable Cu Cl.2/XLPE/OS/LSZH/SWB/LSZH 150/250V (300V) 2x2,5mm² - Grev	M20	T2_M20_Double			T2_M20_Double				U-SEC-17 / U-SEC-14C / U-SEC-14B / U-SEC-15

Cu Cl.2/XLPE/OS/LSZH/SWB/LSZH 150/250 V (300 V)

2X2,5 - INSTRUMENT CABLE - Flame Retardant - Not I.S.

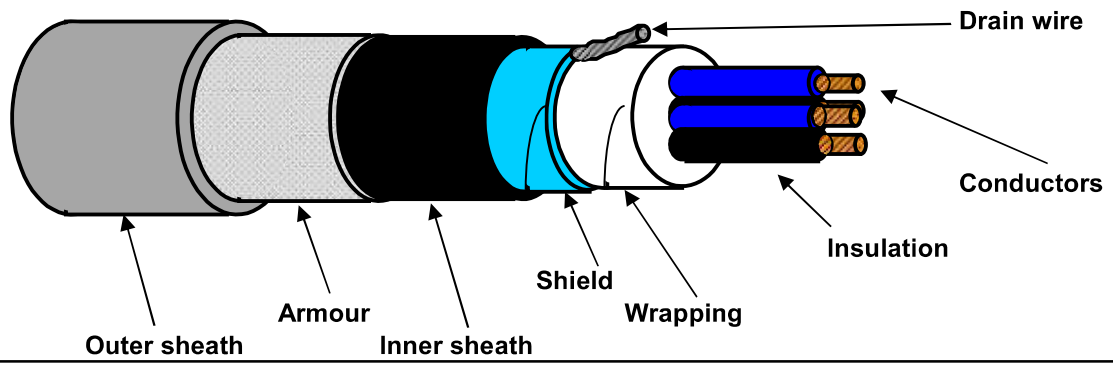

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	XLPE, Nominal Thickness 0,6 mm	
Cores colour code :	**Black NUMBERED (from 1 to 2)**	
Pair Assembling :	Not required	
Pair Wrapping:	Not required	
Drain wire :	Not required	
Pair Shield :	Not required	
Shield Insulation :	Not required	
Total Assembling :	9/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 1,0 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,1 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant, Average Thickness 1,2 mm	
Outer sheath color code:	**Grey**	
Outer printing (INKJET) : (every 1000 mm)	**FLEI - 2X2,5 SQMM - XLPE/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60332.1.2 - IEC 60332.3.22 - Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(8,9 ± 10%) mm	
Over armour diameter :	(9,7 ± 10%) mm	
Outer diameter :	(12,1 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 7,86 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided, lending assent for the treatment, will be used to the sense of the article 13 of of the Regulation (UE) 2016/679, also through outsiders, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ROSETTI MARINO — CROSSWIND

ITEM	Tag	C-25-XY-024/00-JE-13002	: SOLENOID VALVE / MARSHALLING PCS	Dwg	123A90-DDL-IN-LIS-40091		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10000124	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX10 Multi/Single-Core Instrument Control Cable

CABLE DATA

Type	Cu-XLPE-OS-LSZH-SWB-LSZH	Cores/Size mm²	2X2,5 mm2	Color	GREY
From	25-XY-024	To	00-JE-13002		

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	PL
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH	>999	MΩ
	CORE to CORE	>999	MΩ
	CORE to SCREEN	>999	MΩ
	CORE to ARMr	>999	MΩ
	SCREEN to EARTH	>999	MΩ
	SCREEN to ARMr	>999	MΩ
CONTINUITY	CORES	0,12	Ω
	SCREEN	0,12	Ω
	EARTH	NA	Ω
	ARMr	0,12	Ω
	TEST VOLTS	500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 Calibration date: N°LAT 042 00768/24 12/10/2024

Comments Nota 5: refer to PL C30000682

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-29	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-29T07:30:31.262Z	PROVERLIS Digitaly signed by Alessio Polo 2025-01-30T10:13:13.238Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

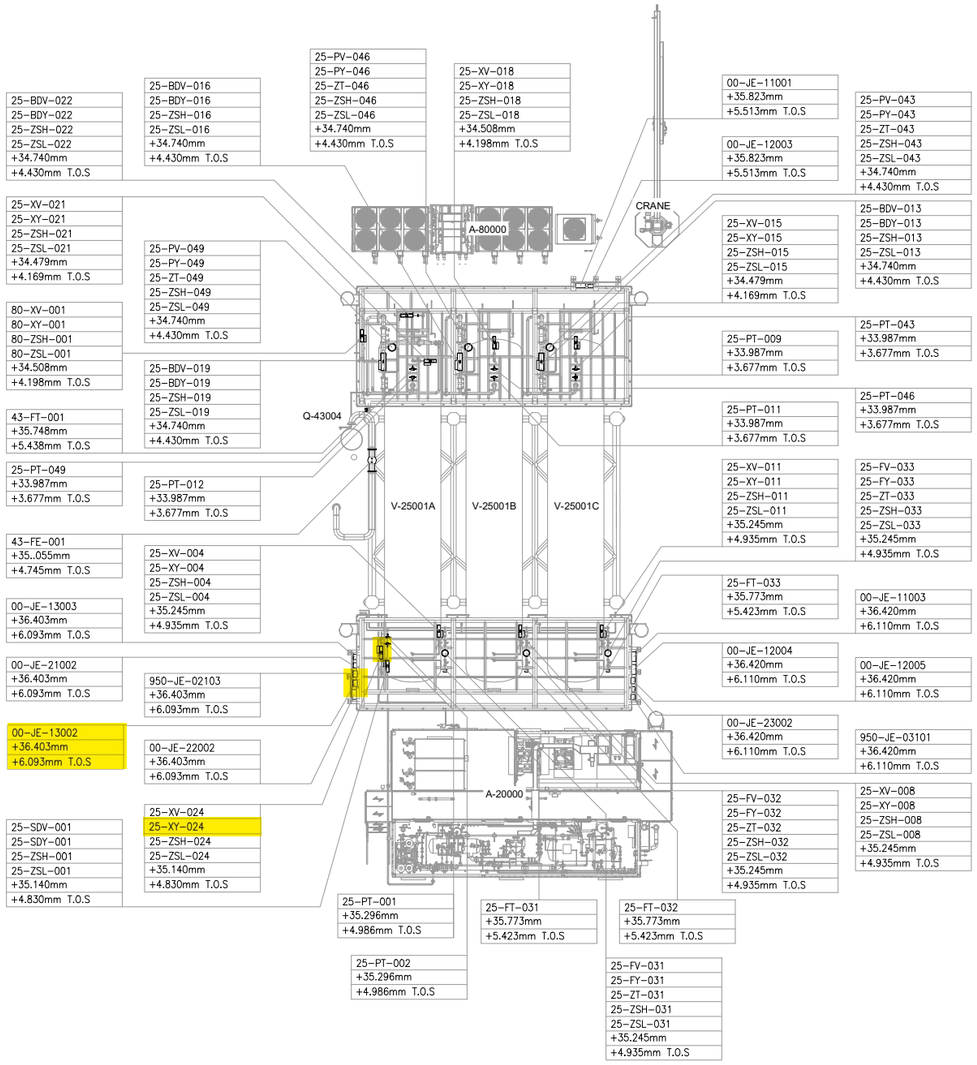

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081
REV.: 2_A | DATE: 07/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02


File Name : 123A90-DDL-IN-DL-40081 REV02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-13002	No.	MARSHALLING CABINET B400-PCS-002

<01>

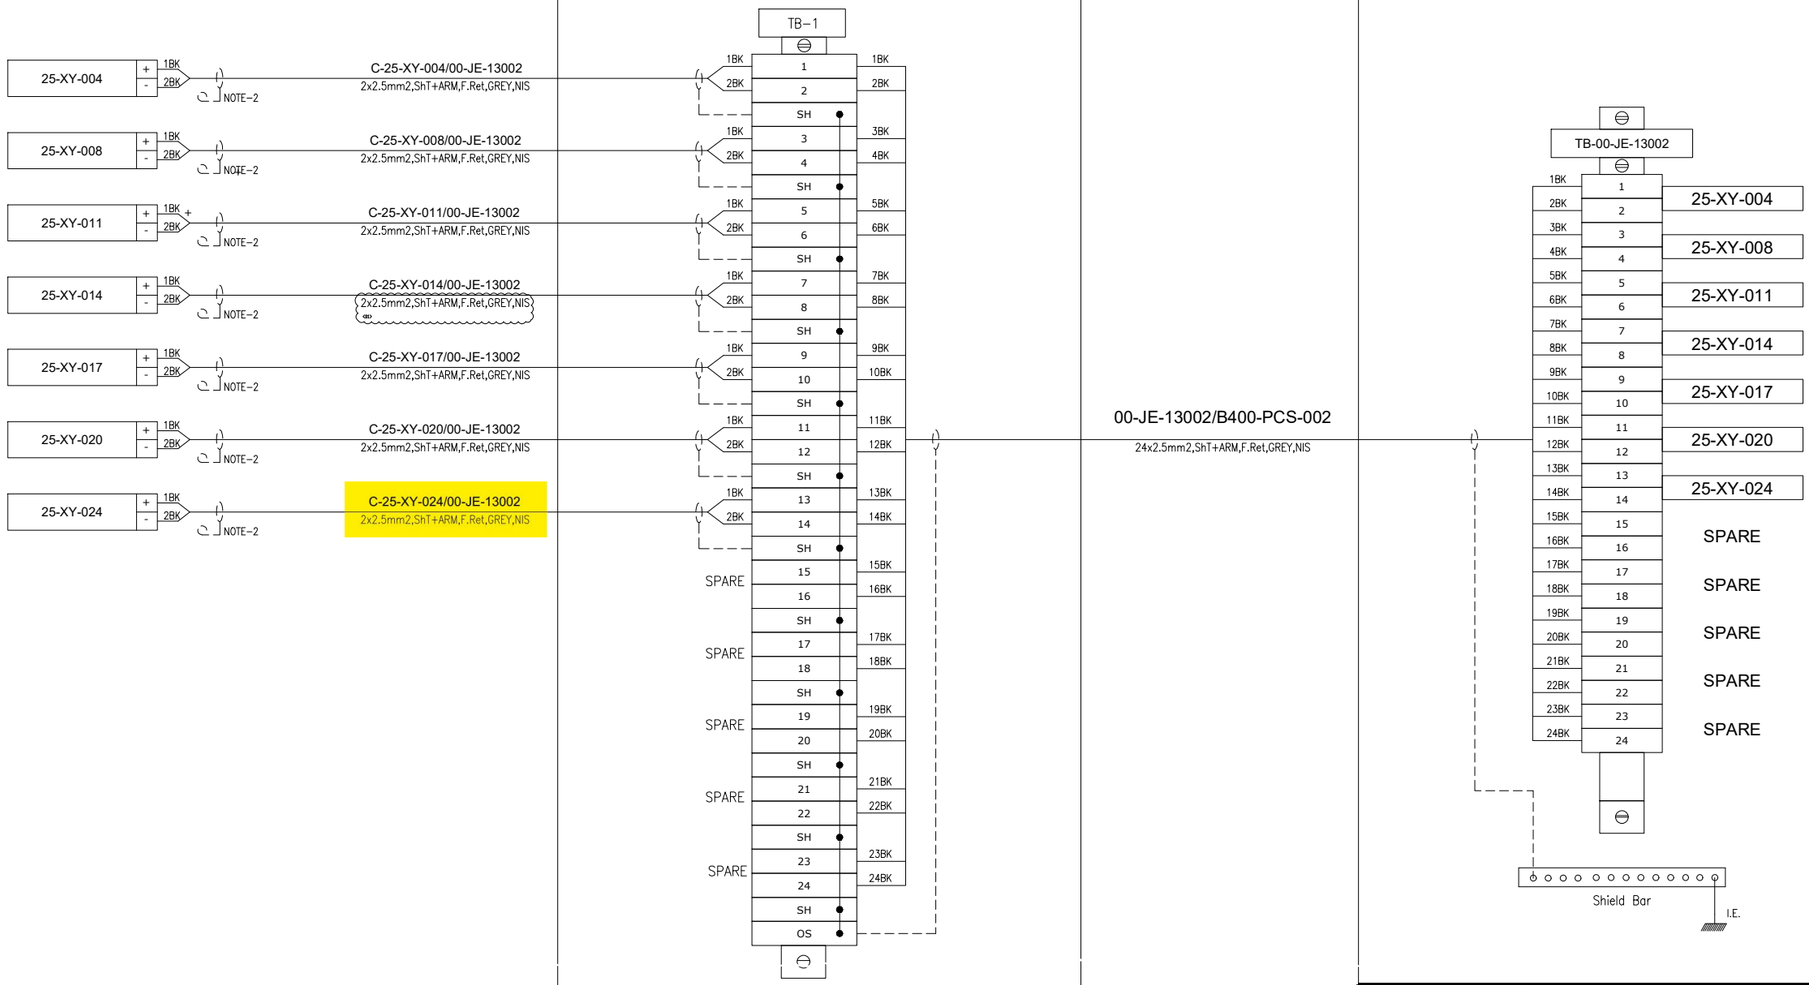

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_I	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
00-JE-13002

CONTRACT NO./TITLE			SCALE 1:1
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024
A3	DRAWING NO. 123A90-DDL-IN-DG-40015	SHEET 029	REV. 01


File Name : 123A90-DDL-IN-DG-40015_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

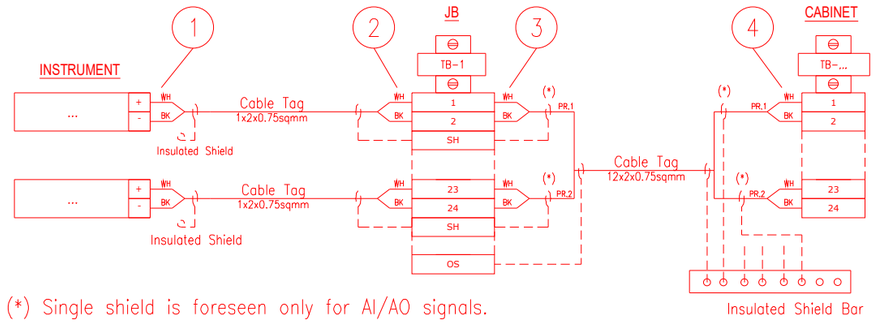

INSTRUMENT CONNECTION STRAIGHT TO CABINET



CABINET CONNECTION TO CABINET



1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40015**

REV.:	DATE:	SIGNATURE:
1_I	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


A3	DRAWING NO.	SHEET	REV.
	123A90-DDL-IN-DG-40015	003	01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Discipline	Eng Status	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland Standard	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-XY-024/00-JE-13002	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-XY-024	Solenoid Valve	Upper Deck	00-JE-13002	DO JB to PCS	Upper Deck	SMICV05-2X2,5	Cable Cu Cl.2/XLPE/OS/LSZH/SWB/LSZH 150/250V (300V) 2x2,5mm² - Grev	M20	T2_M20_Double			T2_M20_Double				U-SEC-16 / U-SEC-14B / U-SEC-15

Cu Cl.2/XLPE/OS/LSZH/SWB/LSZH 150/250 V (300 V)

2X2,5 - INSTRUMENT CABLE - Flame Retardant - Not I.S.

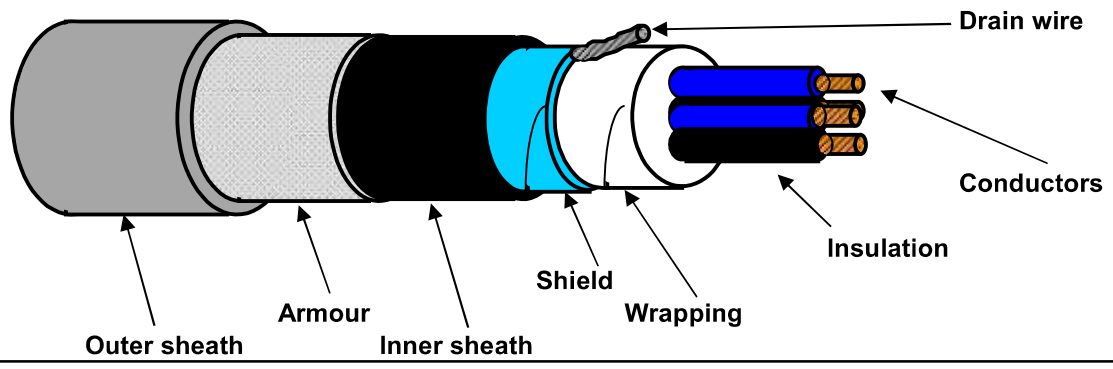

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	XLPE, Nominal Thickness 0,6 mm	
Cores colour code :	**Black NUMBERED (from 1 to 2)**	
Pair Assembling :	Not required	
Pair Wrapping:	Not required	
Drain wire :	Not required	
Pair Shield :	Not required	
Shield Insulation :	Not required	
Total Assembling :	9/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 1,0 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,1 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant, Average Thickness 1,2 mm	
Outer sheath color code:	**Grey**	
Outer printing (INKJET) : (every 1000 mm)	**FLEI - 2X2,5 SQMM - XLPE/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60332.1.2 - IEC 60332.3.22 - Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(8,9 ± 10%) mm	
Over armour diameter :	(9,7 ± 10%) mm	
Outer diameter :	(12,1 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 7,86 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided, lending assent for the treatment, will be used to the sense of the article 13 of of the Regulation (UE) 2016/679, also through outsiders, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	C-25-PT-002/00-JE-21002	: PRESSURE TRANSMITTER / MARSHALLING PCS		Dwg	123A90-DDL-IN-LIS-40091	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10000136	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline Instrumental	Form	CJX10	Multi/Single-Core Instrument Control Cable

CABLE DATA

Type	Cu-MICA-XLPE-OS-LSZH-SWB-LSZH	Cores/Size mm²	1X2X0,75 mm2	Color	ORANGE
From	25-PT-002	To	00-JE-21002		

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	PL
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH		>999	MΩ
	CORE to CORE		>999	MΩ
	CORE to SCREEN		>999	MΩ
	CORE to ARMr		>999	MΩ
	SCREEN to EARTH		>999	MΩ
	SCREEN to ARMr		>999	MΩ
CONTINUITY	CORES		0,4	Ω
	SCREEN		0,4	Ω
	EARTH		NA	Ω
	ARMr		0,4	Ω
	TEST VOLTS		500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 Calibration date: N°LAT 042 00768/24 12/10/2024

Comments Nota 5: refer to PL C30000682

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-02-07	2025-02-08	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-02-07T13:24:26.723Z	PROVERLIS Digitaly signed by Alessio Polo 2025-02-08T09:42:41.585Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

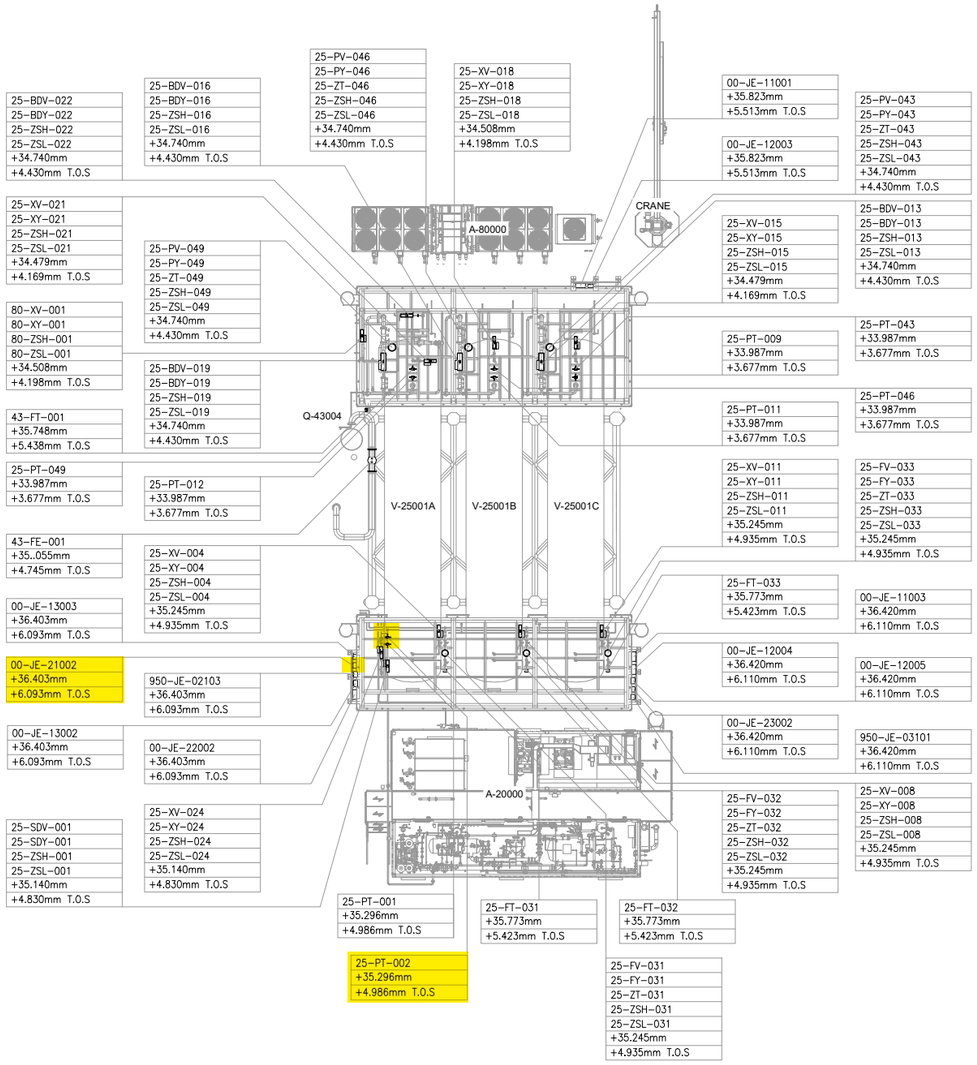

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90–DDL–IN–DL–40081	SHEET 002	REV. 02

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40016

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-21002	No.	MARSHALLING CABINET B400-SIS-001

<01>

25-PT-002 (+ WH, - BK) — NOTE-2
C-25-PT-002/00-JE-21002
1x2x0.75mm2,ShT+ARM,F.Res,ORANGE,NIS

80-PT-002 (+ WH, - BK) — NOTE-2
C-80-PT-002/00-JE-21002
1x2x0.75mm2,ShT+ARM,F.Res,ORANGE,NIS

43-LT-001 (+ WH, - BK)
C-43-LT-001/00-JE-21002
1x2x0.75mm2,ShT+ARM,F.Res,ORANGE,NIS

64-PT-002 (+ WH, - BK) — NOTE-2
C-64-PT-002/00-JE-21002
1x2x0.75mm2,ShT+ARM,F.Res,ORANGE,NIS

TB-1

WH	1	WH	PR1
BK	2	BK	
	SH		
WH	3	WH	PR2
BK	4	BK	
	SH		
WH	5	WH	PR3
BK	6	BK	
	SH		
WH	7	WH	PR4
BK	8	BK	
	SH		
SPARE	9	WH	PR5
	10	BK	
	SH		
SPARE	11	WH	PR6
	12	BK	
	SH		
	OS		

00-JE-21002/B400-SIS-001
6x2x0.75mm2,Sh+ShT+ARM,F.Res,ORANGE,NIS

TB-00-JE-21002

PR1	1	WH	25-PT-002
Shield Bar	2	BK	
PR2	3	WH	80-PT-002
Shield Bar	4	BK	
PR3	5	WH	43-LT-001
Shield Bar	6	BK	
PR4	7	WH	64-PT-002
Shield Bar	8	BK	
PR5	9	WH	SPARE
Shield Bar	10	BK	
PR6	11	WH	SPARE
	12	BK	

Shield Bar — I.E.

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40016**

REV.:	DATE:	SIGNATURE:
1_Q	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND | ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT– SAFETY SYSTEM WIRING DIAGRAMS
00–JE–21002

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

	DRAWING NO.	SHEET	REV.
A3	123A90–DDL–IN–DG–40016	006	01


File Name : 123A90-DDL-IN-DG-40016_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

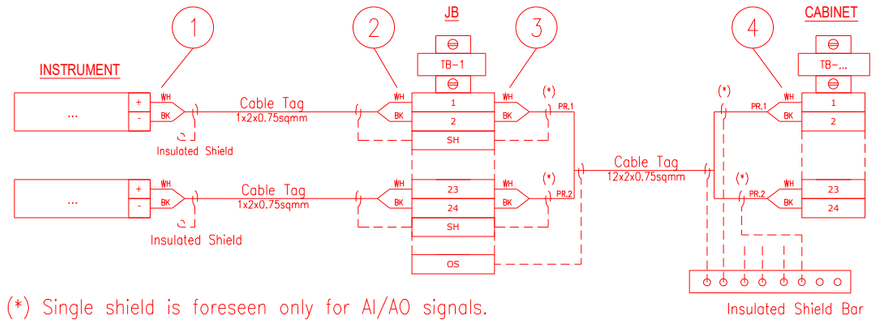

INSTRUMENT CONNECTION STRAIGHT TO CABINET



CABINET CONNECTION TO CABINET

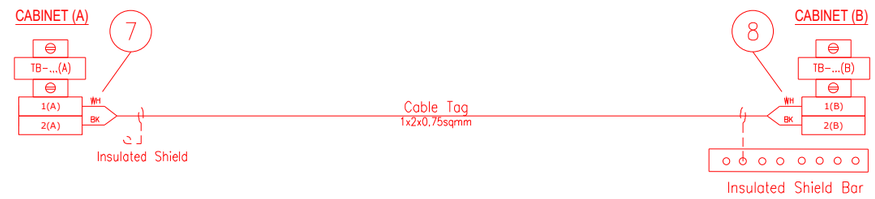

1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40016**

REV.:	DATE:	SIGNATURE:
1_Q	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


A3	DRAWING NO.	SHEET	REV.
	123A90-DDL-IN-DG-40015	003	01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Discipline	Eng Status	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland Standard	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-PT-002/00-JE-21002	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-PT-002	Pressure Transmitter	Upper Deck	00-JE-21002	AI/AO JB to SIS	Upper Deck	SMICV08-1X2X0,75	Cable Cu Cl.2/MGT/XLPE/OS/LSZH/SWB/LSZH 150/250V (300V) 1x2x0,75mm² - Orange	M20S	T2_M20S_Double			T2_M20S_Double				U-SEC-16 / U-SEC-14B / U-SEC-15

Cu Cl.2/MGT/XLPE/OS/LSZH/SWB/LSZH 150/250 V (300 V)

1X2X0,75 - INSTRUMENT CABLE - Fire Resistant - Not I.S.

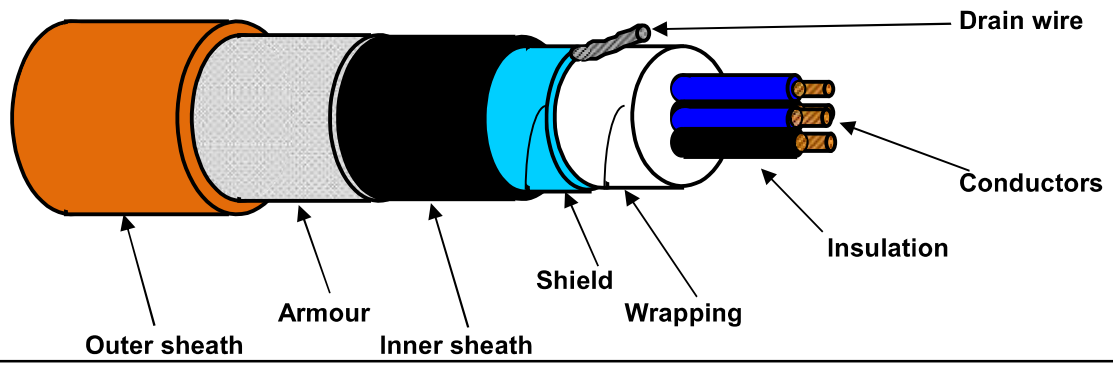

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	Mica/Glass Tape (MGT) plus XLPE, Nominal Thickness 0,5 mm	
Cores colour code :	**White - Black**	
Pair Assembling :	Not required	
Pair Wrapping:	Not required	
Drain wire :	Not required	
Pair Shield :	Not required	
Shield Insulation :	Not required	
Total Assembling :	10/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,1 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant, Average Thickness 1,2 mm	
Outer sheath color code:	**Orange**	
Outer printing (INKJET) :	**FLEI - 1X2X0,75 SQMM - MGT/XLPE/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60331.21 -**	
(every 1000 mm)	**IEC 60332.1.2 - IEC 60332.3.22 - Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(8,5 ± 10%) mm	
Over armour diameter :	(9,3 ± 10%) mm	
Outer diameter :	(11,7 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 26 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Mutual Capacitance :	≤ 150 nF/km	
L/R ratio :	≤ 25 µH/Ω	
Inductance :	≤ 0,9 mH/km	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Fire Resistant test :	**IEC 60331.21**	
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided herein are meant for the transaction will be used in the sense of the article 19 of the Regulation (UE) 2016/679, also by such subjects in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.
All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ROSETTI MARINO — CROSSWIND

ITEM	Tag	C-25-SDV-001/00-JE-22002	: PROXIMITY SWITCH / MARSHALLING PCS	Dwg	123A90-DDL-IN-LIS-40091		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10000154	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX10

Multi/Single-Core Instrument Control Cable

CABLE DATA

Type	Cu-MICA-XLPE-IS-OS-LSZH-SWB-LSZH	Cores/Size mm²	2X2X0,75 mm2	Color	ORANGE
From	25-SDV-001	To	00-JE-22002		

1	Check cable is as specified in project cable schedule.	OK
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	Note
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH	>999	MΩ
	CORE to CORE	>999	MΩ
	CORE to SCREEN	>999	MΩ
	CORE to ARMr	>999	MΩ
	SCREEN to EARTH	>999	MΩ
	SCREEN to ARMr	>999	MΩ
CONTINUITY	CORES	0,4	Ω
	SCREEN	0,4	Ω
	EARTH	NA	Ω
	ARMr	0,4	Ω
	TEST VOLTS	500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 Calibration date: N°LAT 042 00768/24 12/10/2024

Comments Nota 5: refer to PL C30000682

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-25	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-25T13:41:15.926Z	PROVERLIS Digitaly signed by Alessio Polo 2025-01-30T10:18:25.207Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

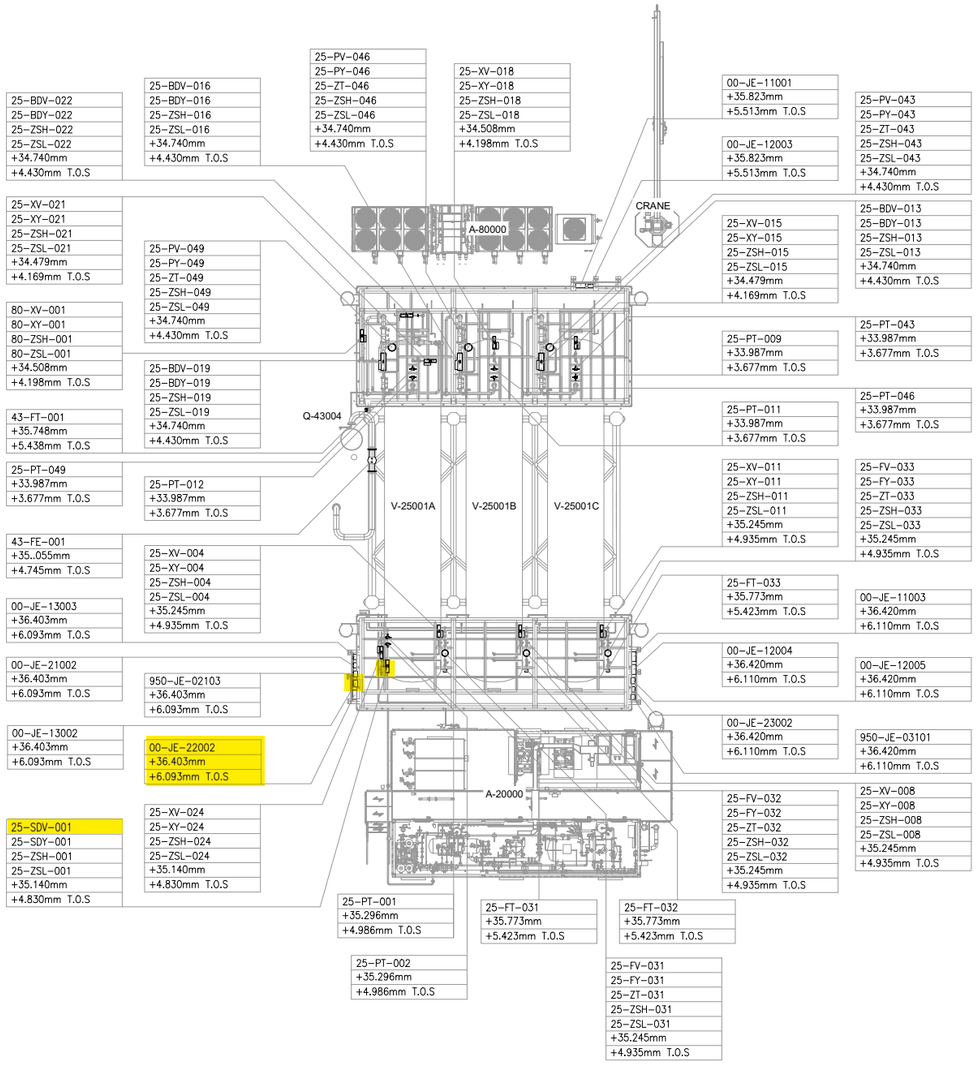

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24

A1	DRAWING NO. 123A90–DDL–IN–DL–40081	SHEET 002	REV. 02

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

File Name : 123A90-DDL-IN-DL-40081 REV02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40016

REV. 01

FIELD

INSTRUMENTS

JUNCTION BOX

00-JE-22002

MULTICABLE

No.

I&T EQUIPMENT ROOM (ITER)

MARSHALLING CABINET

B400-SIS-001

<01>

25-ZSL-001 (2, 1) WH BK PR1
25-ZSH-001 (5, 6) WH BK PR2
NOTE-2
C-25-SDV-001/00-JE-22002
2x2x0.75mm2,Sh+ShT+ARM,F.Res,ORANGE,NIS

25-ZSL-023 (2, 1) WH BK PR1
25-ZSH-023 (5, 6) WH BK PR2
NOTE-2
C-25-SDV-023/00-JE-22002
2x2x0.75mm2,Sh+ShT+ARM,F.Res,ORANGE,NIS

25-ZSL-022 (NO, C) WH BK PR1
25-ZSH-022 (NO, C) WH BK PR2
NOTE-2
C-25-BDV-022/00-JE-22002
2x2x0.75mm2,Sh+ShT+ARM,F.Res,ORANGE,NIS

64-ZSL-001 (2, 1) WH BK PR1
64-ZSH-001 (5, 6) WH BK PR2
NOTE-2
C-64-SDV-001/00-JE-22002
2x2x0.75mm2,Sh+ShT+ARM,F.Res,ORANGE,NIS

950-ASD-03101 (1, 8) WH BK
NOTE-2
C-950-ASD-03101/00-JE-22002
1x2x0.75mm2,ShT+ARM,F.Res,ORANGE,NIS

TB-1

PR1 WH	1		1	WH PR1
PR1 BK	2		2	BK
	SH			
PR2 WH	3		3	WH PR2
PR2 BK	4		4	BK
	SH			
PR1 WH	5		5	WH PR3
PR1 BK	6		6	BK
	SH			
PR2 WH	7		7	WH PR4
PR2 BK	8		8	BK
	SH			
PR1 WH	9		9	WH PR5
PR1 BK	10		10	BK
	SH			
PR2 WH	11		11	WH PR6
PR2 BK	12		12	BK
	SH			
PR1 WH	13		13	WH PR7
PR1 BK	14		14	BK
	SH			
PR2 WH	15		15	WH PR8
PR2 BK	16		16	BK
	SH			
WH	17		17	WH PR9
BK	18		18	BK
	SH			
SPARE	19		19	WH PR10
	20		20	BK
	SH			
SPARE	21		21	WH PR11
	22		22	BK
	SH			
SPARE	23		23	WH PR12
	24		24	BK
	SH			
	OS			

00-JE-22002_1/B400-SIS-001
12x2x0.75mm2,Sh+ShT+ARM,F.Res,ORANGE,NIS

TB-00-JE-22002

PR1 WH	1	25-ZSL-001
PR1 BK	2	
Shield Bar		
PR2 WH	3	25-ZSH-001
PR2 BK	4	
Shield Bar		
PR3 WH	5	25-ZSL-023
PR3 BK	6	
Shield Bar		
PR4 WH	7	25-ZSH-023
PR4 BK	8	
Shield Bar		
PR5 WH	9	25-ZSL-022
PR5 BK	10	
Shield Bar		
PR6 WH	11	25-ZSH-022
PR6 BK	12	
Shield Bar		
PR7 WH	13	64-ZSL-001
PR7 BK	14	
Shield Bar		
PR8 WH	15	64-ZSH-001
PR8 BK	16	
Shield Bar		
PR9 WH	17	950-ASD-03101
PR9 BK	18	
Shield Bar		
PR10 WH	19	SPARE
PR10 BK	20	
Shield Bar		
PR11 WH	21	SPARE
PR11 BK	22	
Shield Bar		
PR12 WH	23	SPARE
PR12 BK	24	

Shield Bar
I.E.

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40016**

REV.:	DATE:	SIGNATURE:
1_Q	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT– SAFETY SYSTEM WIRING DIAGRAMS
00–JE–22002–SH.1 OF 2

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

	DRAWING NO.	SHEET	REV.
A3	123A90–DDL–IN–DG–40016	012	01


File Name : 123A90-DDL-IN-DG-40016_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

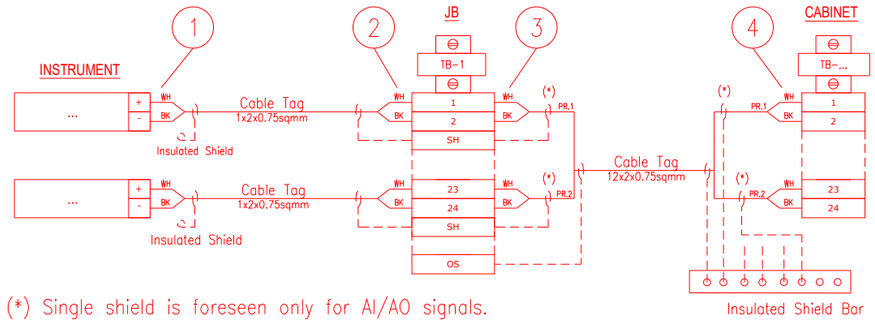

INSTRUMENT CONNECTION STRAIGHT TO CABINET

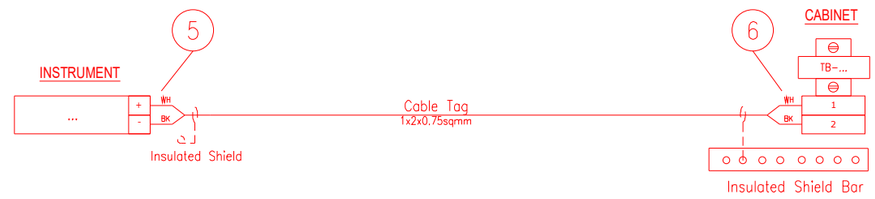

CABINET CONNECTION TO CABINET



1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40016**

REV.:	DATE:	SIGNATURE:
1_O	08/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


	DRAWING NO.	SHEET	REV.
A3	123A90-DDL-IN-DG-40015	003	01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Discipline	Eng Status	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland Standard	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-SDV-001/00-JE-22002	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-SDV-001	On/Off Valve	Upper Deck	00-JE-22002	DI JB to SIS	Upper Deck	SMICV09-2X2X0,75	Cable Cu Cl.2/MGT/XLPE/IS/OS/LSZH/SWB/LSZH 150/250V (300V) 2x2x0,75mm² - Orange	M25	T2_M25_Double	M20	ADAP_M20MxM 25F	T2_M25_Double				U-SEC-16 / U-SEC-14B / U-SEC-15

Cu Cl.2/MGT/XLPE/IS/OS/LSZH/SWB/LSZH 150/250 V (300 V)

2X2X0,75 - INSTRUMENT CABLE - Fire Resistant - Not I.S.

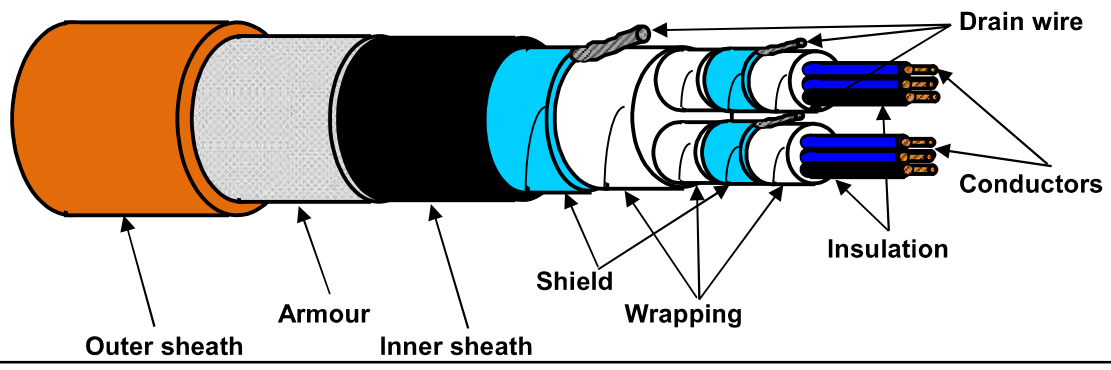

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	Mica/Glass Tape (MGT) plus XLPE, Nominal Thickness 0,5 mm	
Cores colour code :	**White - Black (each core NUMBERED for PAIR identification)**	
Pair Assembling :	10/1mt	
Pair Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Pair Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Shield Insulation :	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Total Assembling :	5/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 0,5 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,3 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant,	
	Average Thickness 1,5 mm	
Outer sheath color code:	**Orange**	
Outer printing (INKJET) :	**FLEI - 2X2X0,75 SQMM - MGT/XLPE/IS/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60331.21 -**	
(every 1000 mm)	**IEC 60332.1.2 - IEC 60332.3.22 - Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(15,1 ± 10%) mm	
Over armour diameter :	(16,3 ± 10%) mm	
Outer diameter :	(19,3 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 26 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Mutual Capacitance :	≤ 150 nF/km	
L/R ratio :	≤ 25 µH/Ω	
Inductance :	≤ 0,9 mH/km	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Fire Resistant test :	**IEC 60331.21**	
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided herein are meant for the transmission will be used in the sense of the article 19 of the Regulation (UE) 2016/679 also to such subjects outside it, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ITEM	Tag	C-25-SDY-001/00-JE-23002	: SOLENOID VALVE / MARSHALLING PCS	Dwg	123A90-DDL-IN-LIS-40091		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10000176	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX10

Multi/Single-Core Instrument Control Cable

CABLE DATA

Type: Cu-MICA-XLPE-OS-LSZH-SWB-LSZH | Cores/Size mm²: 2X2,5 mm2 | Color: ORANGE

From: 25-SDY-001 | To: 00-JE-23002

1	Check cable is as specified in project cable schedule.	PL
2	Check relevant documents are at the latest revision.	OK
3	Check cable is routed in accordance with cable layout drawings.	OK
4	Check cable for any physical damage.	OK
5	Check cable is adequately supported and correctly fixed to rack according to Project specification.	Note
6	Check bending radius is within the specified limits.	OK
7	Check cable is correctly loomed and segregated in accordance with specification.	OK
8	Check cable and core marking are in accordance with specification.	OK
9	Check cable labelling is in accordance with specification.	OK
10	Check that glands, shrouds and earthing are in accordance with specification.	OK
11	Check terminations are in accordance with termination diagram	OK
12	Check gland plate for single core cables is non-ferrous.	NA
13	If required produce Red Line Mark Up for "AS BUILT"	

INSULATION	CORE to EARTH	>999	MΩ
	CORE to CORE	>999	MΩ
	CORE to SCREEN	>999	MΩ
	CORE to ARMr	>999	MΩ
	SCREEN to EARTH	>999	MΩ
	SCREEN to ARMr	>999	MΩ
CONTINUITY	CORES	0,8	Ω
	SCREEN	0,8	Ω
	EARTH	NA	Ω
	ARMr	0,8	Ω
	TEST VOLTS	500	V

TEST ALL CORES AND RECORD LOWEST VALUE

Notes: The lowest value is recorded and must be within project specifications

TESTING INSTRUMENTS USED


TYPE / SERIAL N°: VOLCRAFT 1000V - ET-200 S/N:H240103023 | Calibration date: N°LAT 042 00768/24 12/10/2024

Comments: Nota 5: refer to PL C30000682

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Alessio Polo	
Date	2025-01-30	2025-02-05	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-30T09:59:40.582Z	PROVERLIS Digitaly signed by Alessio Polo 2025-02-05T16:58:06.693Z	

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

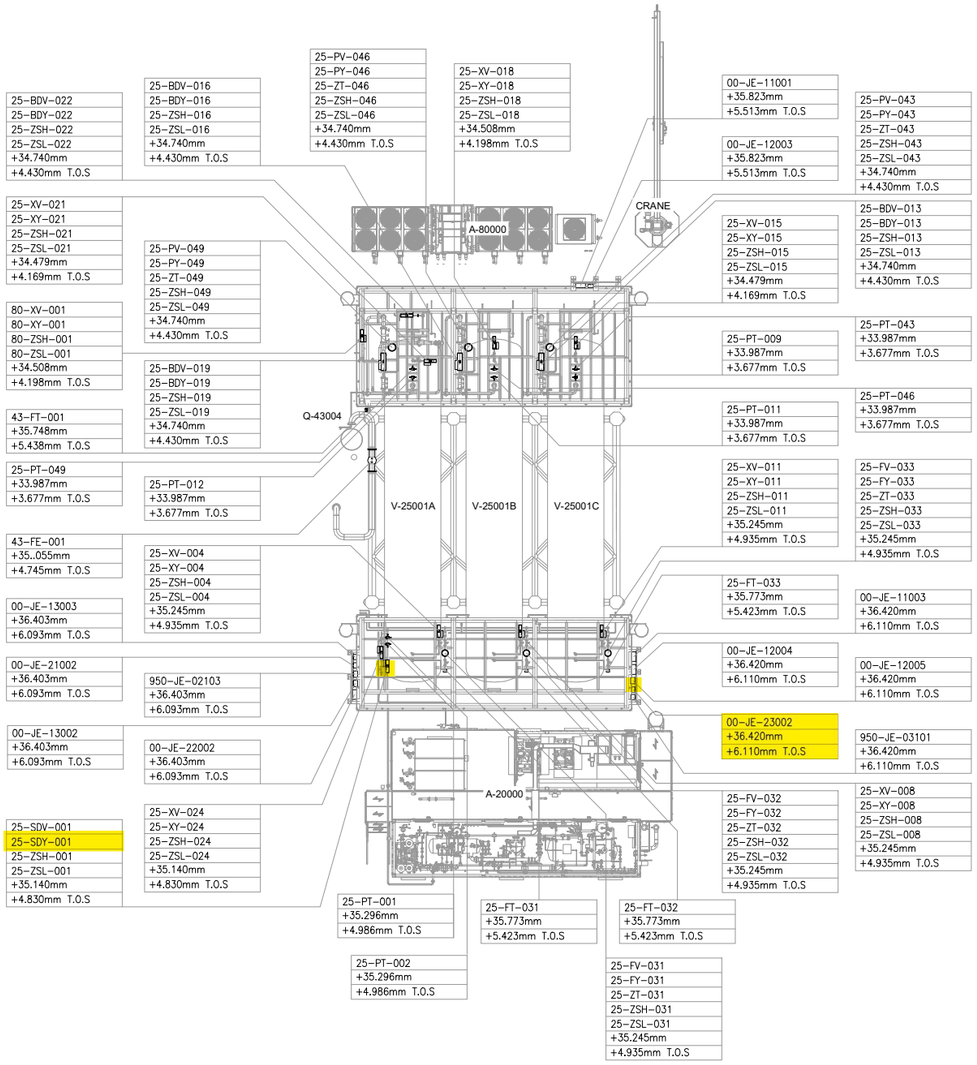

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02


File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. 123A90-DDL-IN-DG-40016

REV. 01

FIELD		MULTICABLE	I&T EQUIPMENT ROOM (ITER)
INSTRUMENTS	JUNCTION BOX 00-JE-23002	No.	MARSHALLING CABINET B400-SIS-001

<01>

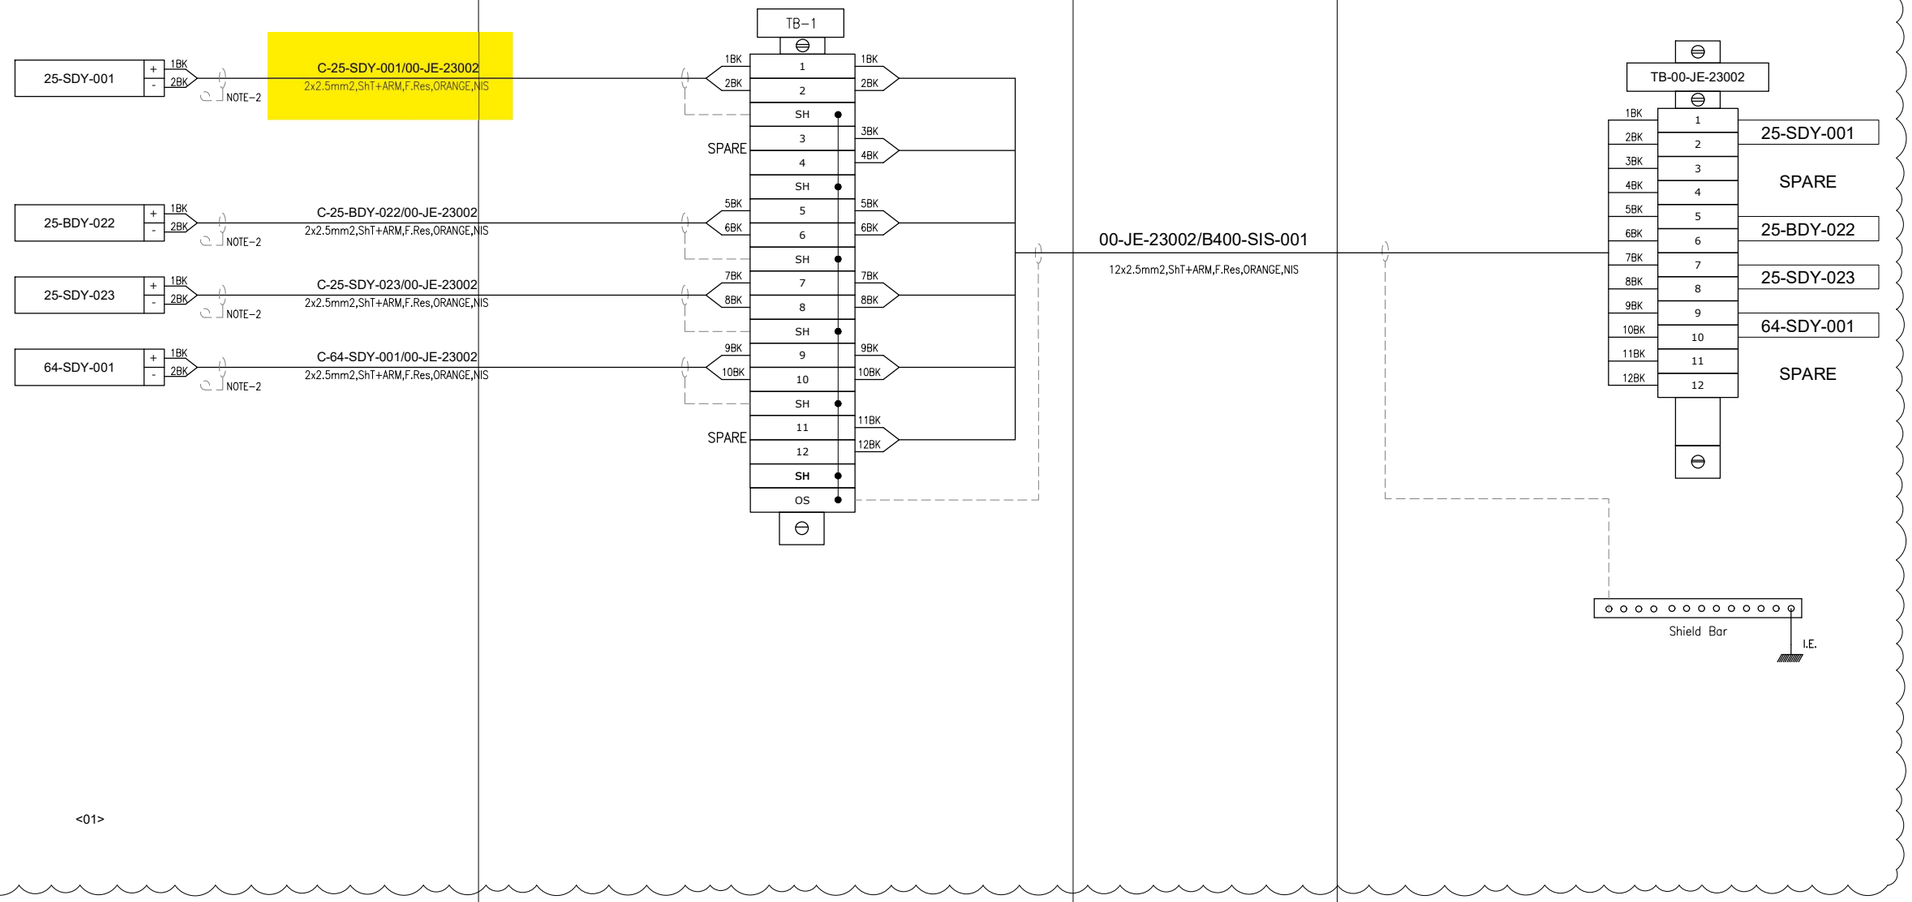

<01>

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40016**

REV.:	DATE:	SIGNATURE:
1_Q	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
I INSTRUMENT– SAFETY SYSTEM WIRING DIAGRAMS
00–JE–23002

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024

A3	DRAWING NO. 123A90–DDL–IN–DG–40016	SHEET 019	REV. 01


File Name : 123A90-DDL-IN-DG-40016_Rev.01

DRAWING NO. 123A90-DDL-IN-DG-40015

REV. 01

NOTES:

1. ALL SPARE ENTRIES SHALL BE PROVIDED WITH CERTIFIED EX PROOF PLUGS.
2. CABLE SCREENS / DRAIN WIRE SHALL BE SECURELY INSULATED AND TIED BACK IN THE INSTRUMENT SIDE AND SHAL BE TERMINATED IN THE MARSHALLING SIDE OF THE PANEL.
3. SPARE PAIRS / TRIADS SHALL BE CONNECTED TO TERMINALS IN JUNCTION BOX AND PANEL / MARSHALLING CABINETS.
4. ALL CABLE SCREENS TO BE TERMINATED AT THE INSTRUMENT EARTH BAR IN THE RESPECTIVE EARTH BARS (IS OR NIS) AS APPLICABLE IN THE MARSHALLING CABINET.
5. SWITCH TAG NAME AND PORT WILL BE DEFINED DURING THE CONSTRUCTION PHASE
6. FOR OPTICAL FIBERS, USE THE FOLLOWING COLOR CODING:
   - 01- RED
   - 02- GREEN
   - 03- BLUE
   - 04- YELLOW
   - 05- GREY
   - 06- PURPLE
   - 07- BROWN
   - 08- ORANGE
   - 09- WHITE
   - 10- PINK
   - 11- BLACK
   - 12- TURQUOISE
7. CAT.6A CABLE SHALL BE TERMINATED MEETING REQUIREMENTS OF STANDARD EIA/TIA 568B:




8. FOR INTRISICALLY SAFE CIRCUIT USE LIGHT BLUE CABLE OR ALTERNATIVELY ORANGE CABLE WITH HEAT SHRINKABLE SLEEVE BLUE AT BOTH END (SEE DOC. 123A90-FDL-IN-DD-40017).

LEGENDS & SYMBOLS:


I.E.	- GREEN ⟶ INSTRUMENT SIGNAL EARTH
P.E.	- GREEN / YELLOW ⟶ P.E. EARTH / BONDING
	- TERMINAL BLOCK (TB)
WH	- WHITE
BK	- BLACK
RD	- RED
S	- SHIELD TERMINAL
OS	- OVERALL SHIELD TERMINAL
O/A Shld	- OVERALL SHIELD
I&O/A Shld	- INDIVIDUAL & OVERALL SHIELD
NIS	- NON INTRINSICALLY SAFE
IS	- INTRINSICALLY SAFE
P.E.	- PLANT EARTH
PCS	- PROCESS CONTROL SYSTEM
ESD	- EMERGENCY SHUTDOWN SYSTEM
SIS	- SAFETY INSTRUMENT SYSTEM
FGS	- FIRE & GAS SYSTEM
MC	- MARSHALLING CABINET
AI	- ANALOGUE INPUT
AO	- ANALOGUE OUTPUT
DI	- DIGITAL INPUT
DO	- DIGITAL OUTPUT
JE	- JUNCTION BOX FOR ELECTRICAL SIGNALS

PHILOSOPHY OF CROSS-FERRULING:


INSTRUMENT CONNECTION THROUGH MARSHALLING JB TO CABINET

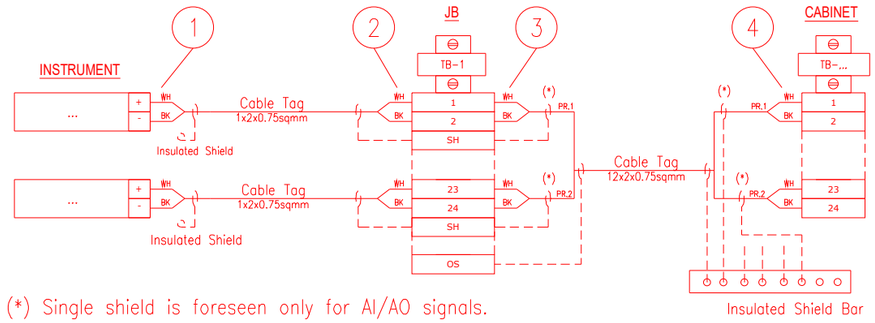

INSTRUMENT CONNECTION STRAIGHT TO CABINET



CABINET CONNECTION TO CABINET

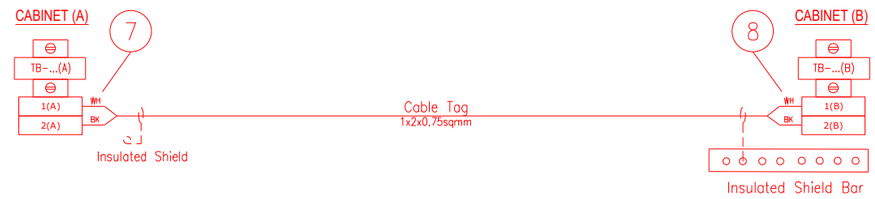

1 - INSTR. TERMINAL NO. OR POLARITY / JB TAG / JB TERMINAL NO.
2 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / JB TERMINAL NO.
3 - JB TERMINAL NO. / JB TERMINAL STRIP / CABINET TERMINAL STRIP / PAIR OR CORE NO.
4 - PAIR OR CORE NO. / JB TAG / JB TERMINAL NO. / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
5 - INSTR. TERMINAL NO. OR POLARITY / CABINET TAG / CABINET TERMINAL STRIP / CABINET TERMINAL NO.
6 - INSTR. TERMINAL NO. OR POLARITY / INSTR. TAG / CABINET TERMINAL STRIP/ CABINET TERMINAL NO.
7 - TERMINAL NO. (A) / TERMINAL STRIP (A) / CABINET TAG (B) / CABINET TERMINAL NO. (B) / PAIR OR CORE NO.
8 - PAIR OR CORE NO. / CABINET TERMINAL NO. (A) / CABINET TAG (A) / TERMINAL STRIP (B) / TERMINAL NO. (B)

NOTES: A - HEAT SHRINKABLE BLACK FOR SHIELD OF NIS INSTRUMENT CABLE.
HEAT SHRINKABLE BLUE FOR SHIELD OF IS INSTRUMENT CABLE.
B - ABOVE DESCRIBED PHILOSOPHY IS INTENDED FOR CONNECTION AS REPRESENTED:
IN CASE OF CONNECTION FROM THE OPPOSITE SIDE, ORDER OF FERULE TAG SHALL BE MIRRORED.
C - SAME TAGGING PHILOSOPHY SHALL APPLIED ALSO TO SHIELDS TERMINATED ON TERMINAL STRIP.

REFERENCE DRAWINGS:

PIPING AND INSTRUMENT DIAGRAM 123A90-DDL-PR-PID-80009
INSTRUMENT INDEX 123A90-DDL-IN-LIS-40088
F&G DETECTORS LAYOUT 123A90-DDL-SAF-DL-30027

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DG-40016**

REV.:	DATE:	SIGNATURE:
1_Q	29/01/25	G.Randi

ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT – PCS WIRING DIAGRAMS
GENERAL NOTES/LEGENDS

CONTRACT NO./TITLE			SCALE N/A
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 23/02/2024


A3	DRAWING NO.	SHEET	REV.
	123A90-DDL-IN-DG-40015	003	01

File Name : 123A90-DDL-IN-DG-40015_Rev.01

Tag Number	Category	Discipline	Eng Status	NativeDoc	Layout	Parent Tag	Main Function	Secondary Function	Area	From Tag	From Main Function	From Area	To Tag	To Main Function	To Area	Material ID	Material Desc.	Gland Standard	From Gland	From Entry	From Fitting	To Gland	To Entry	To Fitting	Routing	Routing Manual
C-25-SDY-001/00-JE-23002	Cable	IN	VFC	123A90-DDL-IN-LIS-40091						25-SDY-001	Solenoid Valve	Upper Deck	00-JE-23002	DO JB to SIS	Upper Deck	SMICV12-2X2,5	Cable Cu Cl.2/MGT/XLPE/OS/LSZH/SWB/LSZH 150/250V (300V) 2x2,5mm² - Orange	M20	T2_M20_Double			T2_M20_Double				U-SEC-16 / U-SEC-14C / U-SEC-14D / U-SEC-14E / U-SEC-14F

Cu Cl.2/MGT/XLPE/OS/LSZH/SWB/LSZH 150/250 V (300 V)

2X2,5 - INSTRUMENT CABLE - Fire Resistant - Not I.S.

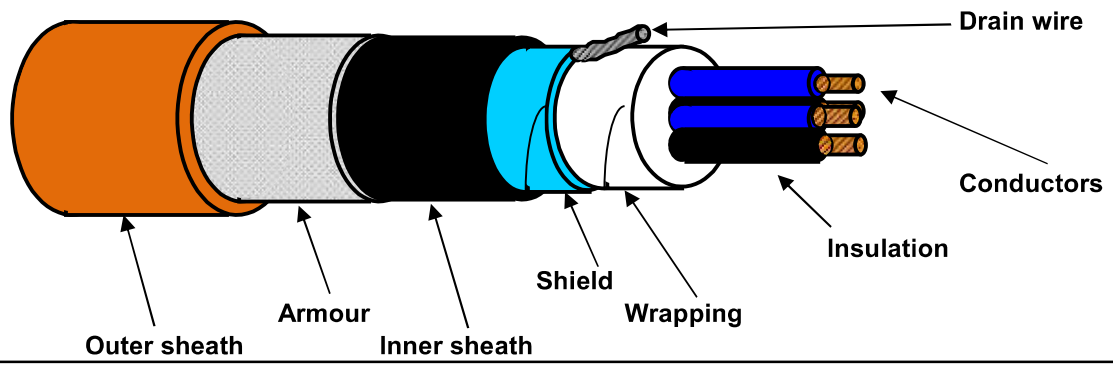

TECHNICAL FEATURES

Conductors :	**7-STRANDED** plain/bare soft annealed copper wires	**IEC 60228 Class 2**
Insulation :	Mica/Glass Tape (MGT) plus XLPE, Nominal Thickness 0,6 mm	
Cores colour code :	**Black NUMBERED (from 1 to 2)**	
Pair Assembling :	Not required	
Pair Wrapping:	Not required	
Drain wire :	Not required	
Pair Shield :	Not required	
Shield Insulation :	Not required	
Total Assembling :	8/1mt	
Overall Wrapping:	by polyester-PET Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Drain wire :	7-Stranded **TINNED** annealed copper drain wire, **size 1,0 sqmm**, in continuous contact with the shield	
Overall Shield :	by Aluminium-**Al** Minimum Thickness 0,008 mm / polyester-**PET** Minimum Thickness 0,010 mm tape helically wound (overlap ≥ 25%)	
Inner sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, Average Thickness 1,1 mm	
Inner sheath color code:	**Black**	
Armour :	Galvanized Steel Wire Braid Armour (coverage ≥ 90%)	
Outer sheath :	Extruded LSZH Thermoplastic Compound (O.I. ≥ 30%), type **SHF1** to IEC 60093.360, moisture/abrasion/UV Resistant,	
	Average Thickness 1,3 mm	
Outer sheath color code:	**Orange**	
Outer printing (INKJET) :	**FLEI - 2X2,5 SQMM - MGT/XLPE/OS/LSZH/SWB/LSZH - 150/250 V - IEC 60331.21 -**	
(every 1000 mm)	**IEC 60332.1.2 - IEC 60332.3.22 - Year of Manufacture - CE + Meter Marking**	
Under armour diameter :	(10,3 ± 10%) mm	
Over armour diameter :	(11,5 ± 10%) mm	
Outer diameter :	(14,1 ± 10%) mm	
Bending radius :	cable outer diameter x 10 (in fixed installation)	
Voltage Test :	1,5 kV a.c. for 5' (Between Cores) / 1,5 kV a.c. for 5' (Between Cores - Shield)	
Conductors DC Resistance :	≤ 7,86 Ω/km (@ 20°C)	
Insulation Resistance :	≥ 1000 MΩ x Km (@ 20°C)	
Applicable Standards		
Design Guidelines :	**IEC 60092.376**	
ON COMPLETE CABLE		
Fire Resistant test :	**IEC 60331.21**	
Flame Retardant test :	IEC 60332.1.2 - IEC 60332.3.22	
Acid Gas generation :	IEC 60754.1/2	
Smoke density/Light Transmittance :	IEC 61034.2 (LT ≥ 60%)	
Hazardous Areas :	IEC 60079.14 par.9.3.2a	
Temperature Range :		
ON INSULATION	(max +90°C) (max continuous operation temperature of conductors)	
	(max +250°C) (max conductors temperature during short-circuit for 5 seconds)	
ON COMPLETE CABLE		
During Operation :	(-20°C up to +90°C) (in fixed installation)	
During installation :	(- 5°C up to +50°C)	
Note :	**To meet the requirements of installation and use in Zone 1 & Zone 2 (IEC 60079-14) and "Gas & Vapour Tight" the cable must be provided with Penetrating Inner sheath together with correct ATEX approved equipment or accessories.**	

Office	Date	Sign	Rev.	Date	Sign
Drawn by :	04/04/2024	Messa			
Checked :	04/04/2024	Spaccasassi			
Approved :	04/04/2024	Cucinotta			

The data provided, lending assent for the treatment, will be used to the sense of the article 13 of of the Regulation (UE) 2016/679, also through outsiders, in order to allow the realization of the fulfilments informatives, administrative, commercial and accounting related to the contractual relationship. Integral copy of the informative could be requested at our offices.

All proprietary rights reserved according to law. This document shall be not reproduced without written permission. FLEI reserves the right to change characteristics and technical data of product shown at any time.

ITEM	Tag	25-PT-001	: Pressure Transmitter - Hyrogen to Vessels Inlet Header		Dwg	123A90-DDL-IN-DS-40039	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10000922	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity STS	Discipline Instrumental	Form	TJX04	Analogue O/P

DATA

VENDOR CALIBRATION MANUAL N° 1724000979-QC-PRO-00005

CALIBRATION/TEST PROCEDURE N° : 123A90-QHSE-PRO-00122

MODEL N° :	SST76_Series	SERIAL N° :	SE240634
DATA SHEET N° :	1724000979-IN-DS-00004	Rev :	3
TEST EQUIPMENT :		SERIAL N° :	

Instruments calibration is not required prior to the installation, as long as Manufacturer's calibration certificate is provided and transportation or storage conditions have not corrupted the instrument.

Manufacturer's calibration certificate is valid, not expired and attached to this check sheet

Following section must be filled only if certificate is not valid or missing

See Attachment

TEST DETAILS
CALIBRATION FIGURES

CALIBRATION POINTS	RISING						FALLING						UNITS
INPUT A													
INPUT B *													
INPUT C *													
OUTPUT													

* NOTE : COMPLETE IF APPLICABLE

TESTED LABEL AFFIXED

DATA SHEET ATTACHED

If required produce Red Line Mark Up for "AS BUILT"

Comments:

	Performed by	☉ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS Impianti	RM (Rosetti Marino)	
Name	Carmelo Bongiovanni	Giovanni Tangianu	
Date	2024-09-17	2024-10-02	
Signature	PROVERLIS Digitaly signed by Carmelo Bongiovanni 2024-09-17T06:35:20.637Z	PROVERLIS Digitaly signed by Giovanni Tangianu 2024-10-02T09:19:45.518Z	

ABR SERVICE S.r.l.
Via Manlio Monti, 40 – 48123 RAVENNA
Tel. +39 0544 685411 info@abrservice.net
C.F. Part. IVA 02764420390

Plant	CROSSWIND	Description	H2 FROM ELECTR.(A-20000) TO H2 STORAGE VESSELS		
Area	N.P.	Loop Tag	25-PI-001	Instrument Tag	25-PT-001
Type of verification	periodic	Calibration range	0,00 ÷ 40,00 bar	Report N°	001
Type of instrument	Pressure meter	Max uncertainty required	± 0,070 % s.r.	Reference procedure data sheet	123A90-PML-QHSE-PRO-00122 Page N°8

UNDER EXAMINATION INSTRUMENT 'S DATA

Tag	Manufacture	Model	S/N
25-PT-001	SPRIANO	SST76	SE240634

USED REFERENCE SAMPLE 'S DATA

Manufacture	Model	S/N	n° of certification and calibration center	uncertainty (u.m.)	Date of issue
BEAMEX	MC5-IS	20177766	0639/MP/2024 _ LAT 150	± 0,001 c.s.	24/04/2024
BEAMEX	EXT600	64024	0639/MP/2024 _ LAT 150	± 0,001 c.s.	24/04/2024

environment temperature at the time of check 25 °C

Value indicated before starting the check 0 bar

CHECK RESULT: *as found*

Verification functionality loop check

Generated value	Expected value	Read value	Error	Error % on s.r.
bar	mA	mA	mA	
0,00	4,00	4,000	+0,000	+0,000
10,00	8,00	8,002	+0,002	+0,013
20,00	12,00	11,998	-0,002	-0,013
30,00	16,00	15,995	-0,005	-0,031
40,00	20,00	19,999	-0,001	-0,006
30,00	16,00	15,996	-0,004	-0,025
20,00	12,00	11,999	-0,001	-0,006
10,00	8,00	8,001	+0,001	+0,006
0,00	4,00	4,000	+0,000	+0,000

max error detected % 0,031

Check: PASSED

Verification activation of blocks/threshold alarms

Alarm signalling	Type of activation	Alarm intervention	Block description	Action type	Block intervention
bar					

Blocks/alarms check:

Corrective action

CHECK RESULT: *as left*

Verification functionality loop check

Generated value	Expected value	Read value	Error	Error % on s.r.
bar	mA	mA	mA	

errore massimo rilevato % 0,00

Check:

Verification activation of blocks/threshold alarms

Alarm signalling	Type of activation	Alarm intervention	Block description	Action type	Block intervention
bar	DESCENT				

Blocks/alarms check:

Value indicated after the check 0 bar

Note:

FINAL OUTCOME OF THE VERIFICATION: *The instrument is SUITABLE*

Verification Date	Verification Expiration	Technical Executor	Viewed	Approved by
20/09/2024	09/2025	PENSO SILVIO		
		signature	*signature*	*signature*

ABR SERVICE srl
Via M. Monti, 40 - 48123 RAVENNA
Tel. 0544 685411
C.F. e P.IVA 02764420390

GENERAL	1	Tag Number			25-PT-001	
	2	Service			H2 FROM ELECTR. (A-20000) TO H2 STORAGE VESSELS	
	3	P&ID Number	Location		123A90-DDL-PR-PID-80013	1"-HY-007-03HSS-N
	4	Function			PRESSURE MEASUREMENT	
	5	Mounting			DIRECT ON-LINE	
	6	Area Classification			ATEX Zone2 - IIC (IIB+H2) T1	
	7	Ambient Temperature			Min: -8.4 °C, Norm: 10.5 °C, Max: +25.0 °C.	
PROCESS CONDITIONS	8	Fluid			HYDROGEN	
	9	Pressure Des.	Oper.	[barg]	40	4(Min.) / 30(Max)
	10	Temperature Des.	Oper.	[°C]	-10 / + 80 °C	5(Min.) / 65(Max.)
	11	Oper. Spec. Gravity	Oper. Viscosity		-	-
	12	Flow Rate	Allowable Temp.		-	-
TRANSMITTER	13	Instrument Range Min.	Max.	[barg]	0	100
	14	Calibration Range Min.	Max.	[barg]	0	40
	15	Elevation	Suppression		-	-
	16	Element Type			Diaphragm	
	17	Element Material			SS AISI 316/316L GOLD PLATED	
	18	Body Material	Body Rating		SS AISI 316/316L	200 bar
	19	Process Connection			1/2” NPT-M	
	20	Wetted O-Rings Material			-	
	21	Fill Fluid			-	
	22	Bolts	Housing		Manifold/Instrument assembly	SS AISI 316/316L
	23	Paint			N/A	
	24	ATEX Certification	Ingress Protection		ATEX Ex II 2G Ex db IIC T5	IP66
	25	Process Connection	Electrical Connection		1/2” NPT-M	2 X M20X1.5
	26	Accuracy			0.07% of Nominal Range	
	27	SIL Certification	PED Certification		-	Required
DIAPHRAGM SEAL	28	Process Connection & Rating			-	
	29	Diaphragm Material	Housing Material		-	-
	30	Fill Fluid	Capillary Material		-	-
	31	Capillary Type	Capillary Length		-	-
	32	Flushing Connection			-	
OPTIONS	33	Integral Meter	Scale		Required	-
	34	Hydrostatic Testing	Cleaning		Required	-
	35	Mounting Brackets	Manifold Model No		Required	MAN2-R6
	36	Lightning Protection	Barrier Manuf./Model		-	-
COMMUNICATION AND SOFTWARE	37	Communication Type	Signal Type		HART 6	4-20mA Loop Powered 24 Vdc
	38	D D Revision	CFF Revision		-	-
	39	Device Tag	Hart Tag		-	-
	40	Internal Diagnostics	Capacitance		-	-
	41	Segment	Device Address		-	-
	42	Device Class	Simulate		-	-
	43	Nominal Current	Operating Voltage		-	-
PURCHASE	44	Manufacturer			TERRANOVA SRL	
	45	Model			SST76-H-7-L-2-9-2-1-4 + MAN2-R6	
	46	Purchase Order Number			4718_OS	

This document undergoes an issuance cycle within EDMS Fusionlive". Its distribution is electronically controlled. Once printed shall be considered as “NOT CONTROLLED” copy

ITEM	Tag	25-PT-002	:	Pressure Transmitter - Hyrogen to Vessels Inlet Header Shut-Down	Dwg	123A90-DDL-IN-DS-40039	
	S/Sys	25-07	:	Hydrogen Storage Vessels Header (Inlet)	Module	UD	
TASK	code	C10000923	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity	STS	Discipline	Instrumental	Form	TJX04	Analogue O/P

DATA

VENDOR CALIBRATION MANUAL N° 1724000979-QC-PRO-0005

CALIBRATION/TEST PROCEDURE N° : 123A90-PML-QHSE-PRO-00122

MODEL N° :	SST76-Series	SERIAL N° :	SE240635
DATA SHEET N° :	1724000979-IN-DS-00004	Rev :	3
TEST EQUIPMENT :		SERIAL N° :	

Instruments calibration is not required prior to the installation, as long as Manufacturer's calibration certificate is provided and transportation or storage conditions have not corrupted the instrument.

Manufacturer's calibration certificate is valid, not expired and attached to this check sheet

Following section must be filled only if certificate is not valid or missing

See Attachment

TEST DETAILS
CALIBRATION FIGURES

CALIBRATION POINTS	RISING						FALLING						UNITS
INPUT A													
INPUT B *													
INPUT C *													
OUTPUT													

* NOTE : COMPLETE IF APPLICABLE

TESTED LABEL AFFIXED

DATA SHEET ATTACHED

If required produce Red Line Mark Up for "AS BUILT"

Comments:

	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS Impianti	RM (ROSETTI MARINO)	
Name	Carmelo Bongiovanni	Giovanni Tangianu	
Date	2024-09-17	2024-10-09	
Signature	PROVERLIS Digitaly signed by Carmelo Bongiovanni 2024-09-17T06:35:47.744Z	Firma Digitale Sicura Giovanni Tangianu 2024-10-09T10:10:26+0200	

ABR SERVICE S.r.l.
Via Manlio Monti, 40 – 48123 RAVENNA
Tel. +39 0544 685411 Info@abrservice.net
C.F. Part. IVA 02764420390

Plant	CROSSWIND	Description	H2 FROM ELECTR.(A-20000) TO H2 STORAGE VESSEL		
Area	N.P.	Loop Tag	25-PI-002	Instrument Tag	25-PT-002
Type of verification	periodic	Calibration range	0,00 ÷ 40,00 bar	Report N°	002
Type of instrument	Pressure meter	Max uncertainty required	± 0,070 % s.r.	Reference procedure data sheet	123A90-PML-QHSE-PRO-00122 Page N°8

UNDER EXAMINATION INSTRUMENT 'S DATA

Tag	Manufacture	Model	S/N
25-PT-002	SPRIANO	SST76	SE240635

USED REFERENCE SAMPLE 'S DATA

Manufacture	Model	S/N	n° of certification and calibration center	uncertainty (u.m.)	Date of issue
BEAMEX	MC5-IS	20177766	0639/MP/2024 _ LAT 150	± 0,001 c.s.	24/04/2024
BEAMEX	EXT600	64024	0639/MP/2024 _ LAT 150	± 0,001 c.s.	24/04/2024

environment temperature at the time of check 25 °C

Value indicated before starting the check 0 bar

CHECK RESULT: as found

Verification functionality loop check

Generated value	Expected value	Read value	Error	Error % on s.r.
bar	mA	mA	mA	
0,00	4,00	4,000	+0,000	+0,000
10,00	8,00	7,998	-0,002	-0,012
20,00	12,00	11,995	-0,005	-0,031
30,00	16,00	15,993	-0,007	-0,044
40,00	20,00	19,996	-0,004	-0,025
30,00	16,00	15,994	-0,006	-0,038
20,00	12,00	11,994	-0,006	-0,038
10,00	8,00	7,999	-0,001	-0,006
0,00	4,00	4,001	+0,001	+0,006
		max error detected %		0,044

Check: PASSED

Verification activation of blocks/threshold alarms

Alarm signalling	Type of activation	Alarm intervention	Block description	Action type	Block intervention
bar					

Blocks/alarms check:

Corrective action

CHECK RESULT: as left

Verification functionality loop check

Generated value	Expected value	Read value	Error	Error % on s.r.
bar	mA	mA	mA	
		errore massimo rilevato %		0,00

Check:

Verification activation of blocks/threshold alarms

Alarm signalling	Type of activation	Alarm intervention	Block description	Action type	Block intervention
bar	DESCENT				

Blocks/alarms check:

Value indicated after the check 0 bar

Note:

FINAL OUTCOME OF THE VERIFICATION: The instrument is SUITABLE

Verification Date	Verification Expiration	Technical Executor	Viewed	Approved by
20/09/2024	09/2025	PENSO SILVIO		
		signature	signature	signature

ABR SERVICE srl
Via M. Monti, 40 - 48123 RAVENNA
Tel. 0544 685411
C.F. e P.IVA 02764420390

GENERAL	1	Tag Number		25-PT-002	
	2	Service		H2 FROM ELECTR. (A-20000) TO H2 STORAGE VESSELS	
	3	P&ID Number	Location	123A90-DDL-PR-PID-80013	1"-HY-007-03HSS-N
	4	Function		PRESSURE MEASUREMENT	
	5	Mounting		DIRECT ON-LINE	
	6	Area Classification		ATEX Zone2 - IIC (IIB+H2) T1	
	7	Ambient Temperature		Min: -8.4 °C, Norm: 10.5 °C, Max: +25.0 °C.	
PROCESS CONDITIONS	8	Fluid		HYDROGEN	
	9	Pressure Des.	Oper. [barg]	40	4(Min.) / 30(Max)
	10	Temperature Des.	Oper. [°C]	-10 / + 80 °C	5(Min.) / 65(Max.)
	11	Oper. Spec. Gravity	Oper. Viscosity	-	-
	12	Flow Rate	Allowable Temp.	-	-
TRANSMITTER	13	Instrument Range Min.	Max. [barg]	0	100
	14	Calibration Range Min.	Max. [barg]	0	40
	15	Elevation	Suppression	-	-
	16	Element Type		Diaphragm	
	17	Element Material		SS AISI 316/316L GOLD PLATED	
	18	Body Material	Body Rating	AISI 316 SS	200 bar
	19	Process Connection		1/2" NPT-M	
	20	Wetted O-Rings Material		-	
	21	Fill Fluid		-	
	22	Bolts	Housing	Manifold/Instrument assembly	SS AISI 316/316L
	23	Paint		N/A	
	24	ATEX Certification	Ingress Protection	ATEX Ex II 2G Ex db IIC T5	IP66
	25	Process Connection	Electrical Connection	1/2" NPT-M	2 X M20X1.5
	26	Accuracy		0.07% of Nominal Range	
	27	SIL Certification	PED Certification	SIL2	Required
DIAPHRAGM SEAL	28	Process Connection & Rating		-	
	29	Diaphragm Material	Housing Material	-	-
	30	Fill Fluid	Capillary Material	-	-
	31	Capillary Type	Capillary Length	-	-
	32	Flushing Connection		-	
OPTIONS	33	Integral Meter	Scale	Required	-
	34	Hydrostatic Testing	Cleaning	Required	-
	35	Mounting Brackets	Manifold Model No	Required	MAN2-R6
	36	Lightning Protection	Barrier Manuf./Model	-	-
COMMUNICATION AND SOFTWARE	37	Communication Type	Signal Type	HART 6	4-20mA Loop Powered 24 Vdc
	38	D D Revision	CFF Revision	-	-
	39	Device Tag	Hart Tag	-	-
	40	Internal Diagnostics	Capacitance	-	-
	41	Segment	Device Address	-	-
	42	Device Class	Simulate	-	-
	43	Nominal Current	Operating Voltage	-	-
PURCHASE	44	Manufacturer		TERRANOVA SRL	
	45	Model		SST76-H-7-L-2-9-2-1-4 + MAN2-R6	
	46	Purchase Order Number		4718_OS	

This document undergoes an issuance cycle within EDMS Fusionlive". Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

ITEM	Tag	25-RO-024	: Restriction Orifice - Hyrogen to vessels inlet header vent system			Dwg	123A90-DDL-PR-PID-80013
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001208		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX11 Orifice Plate


1	Check for mechanical damage.	OK
2	Check installed equipment is suitable and conforms to specification.	OK
3	Check installation conforms to P&ID and hook-up drawing.	OK
4	Check that flow orifice is installed with correct flow direction clearly identified on the tab.	OK
5	Check tag number is stamped or engraved on tab.	OK
6	Check accessibility conforms to specifications, with platforming where necessary.	OK
7	Check calibration certificate/conformity.	OK
8	Check plate flatness and surface finish.	OK
9	If required produce Red Line Mark Up for "AS BUILT"	

Comments:

	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-02-07	2025-02-07	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-02-07T13:12:49.770Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-02-07T15:06:31.891Z	

DRAWING NO. DRAWING_NO.

REV. REV

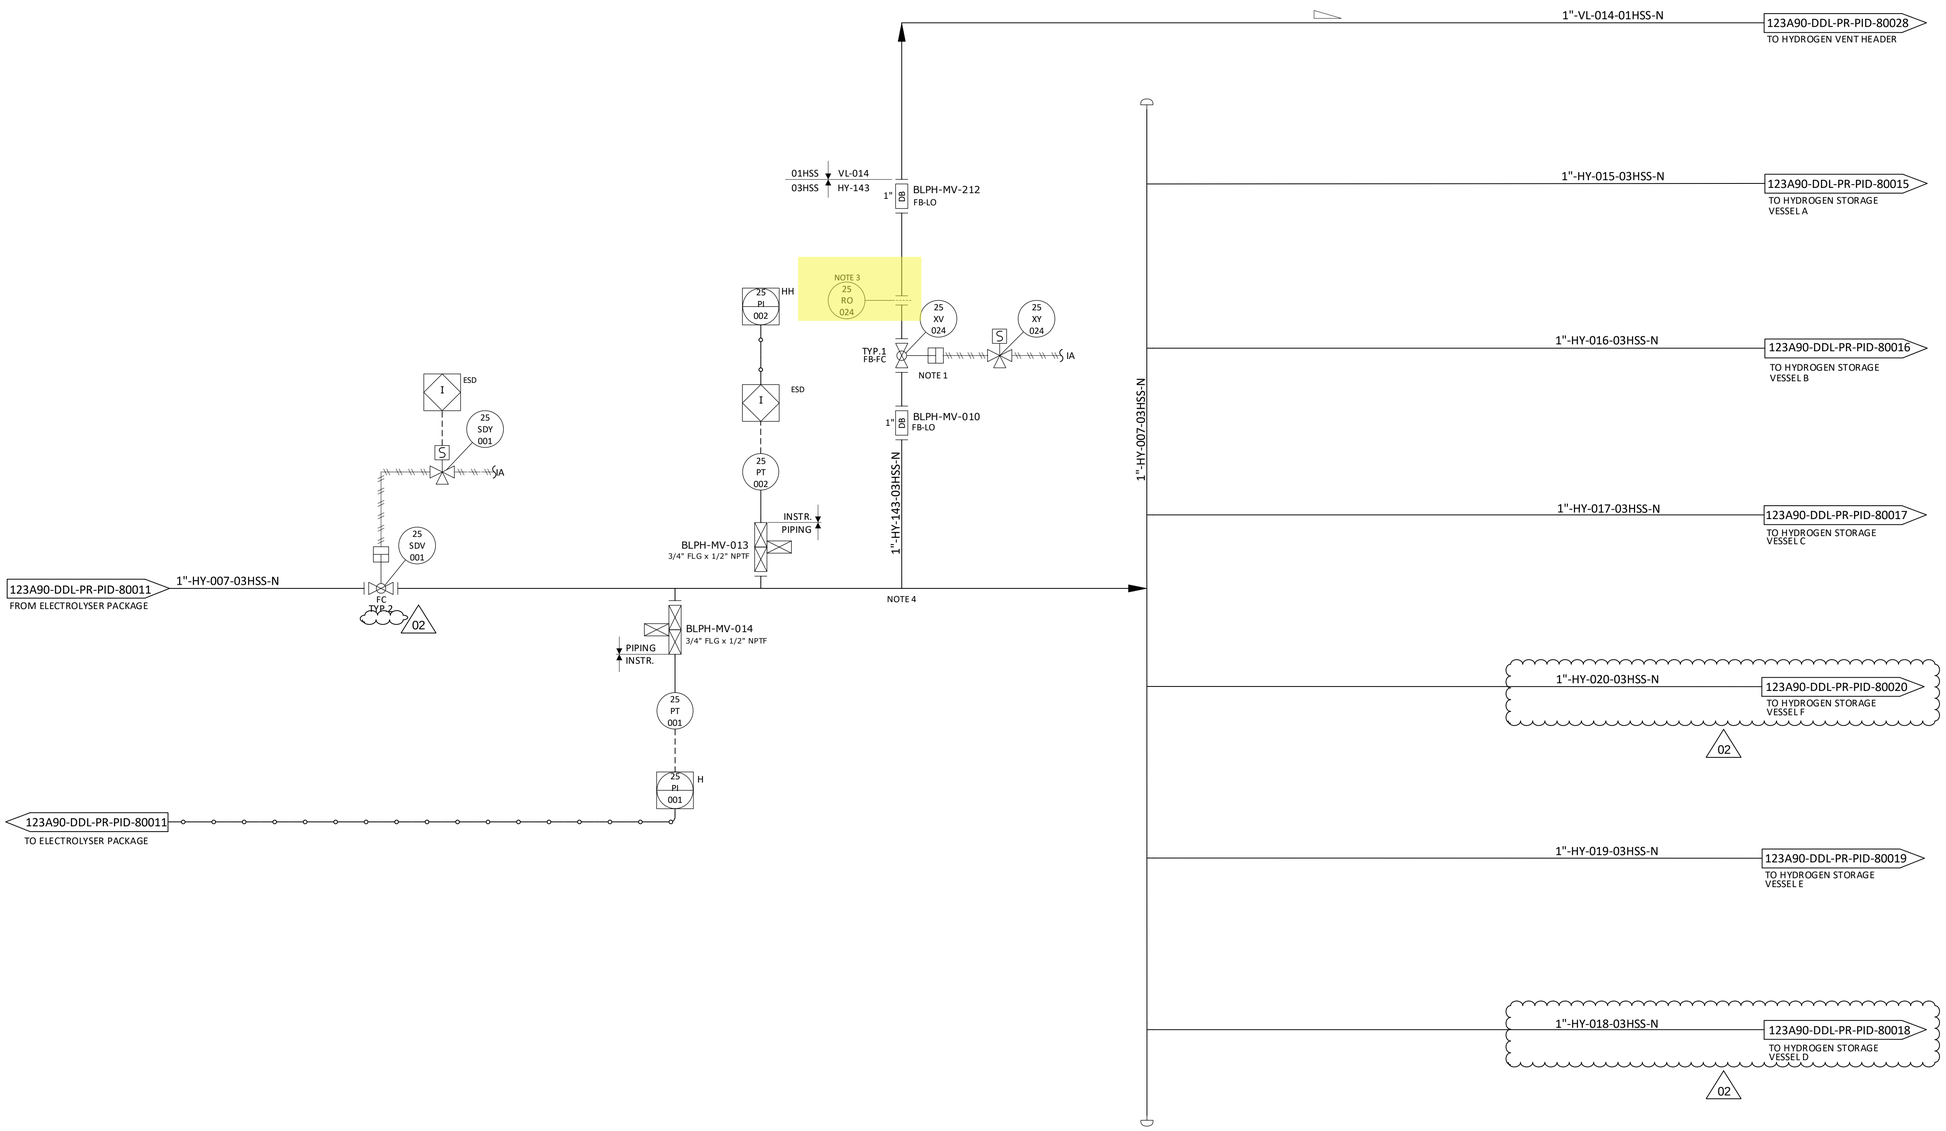

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :

BLPH PIPING AND INSTRUMENTATION DIAGRAM HYDROGEN STORAGE VESSELS HEADER (INLET)

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO. 123A90-DDL-PR-PID-80013	SHEET 001	REV. 02

File Name : FILE_NAME

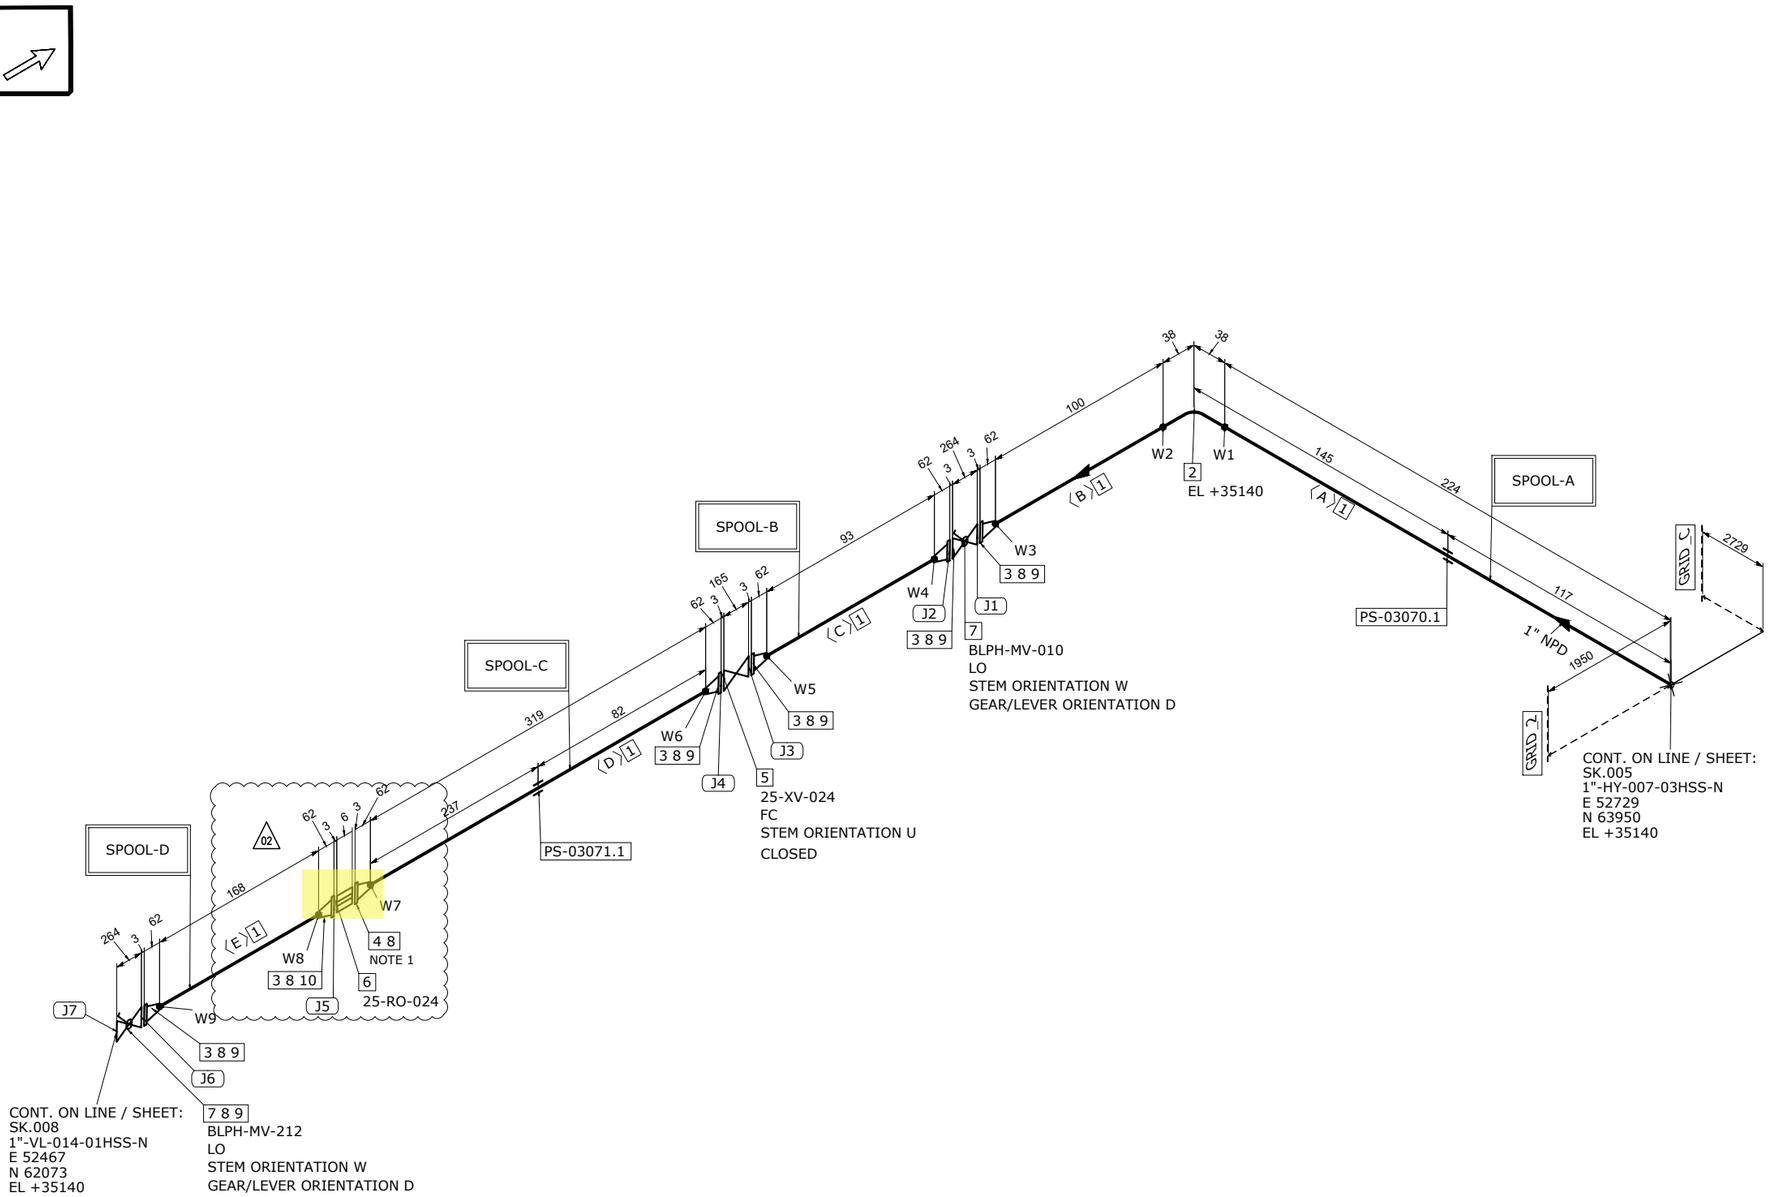

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	0.9M	2.3
2	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
3	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	6	11.0
4	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
5	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
6	1		Restriction Orifice 300#RF	1	1.0
7	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	2	27.0
8	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	8	0.6
9	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	24	5.5
10	5/8	SB20BO04190300	90 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	15.2
ERECTION WEIGHT [kg]	76.1
OVERALL WEIGHT [kg]	91.3

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	224	BEVEL	BEVEL
B	1	100	BEVEL	BEVEL
C	1	93	BEVEL	BEVEL
D	1	319	BEVEL	BEVEL
E	1	168 (02)	BEVEL	BEVEL

SUPPORT LIST

PS-03070.1
PS-03071.1

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	2.8
B	2	3.9
C	2	4.5
D	2	4.1
MONT	0	76.1

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-143-03HSS-N

SK.056

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II			
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS			
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]		
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water	

REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION E/W

MASTER


CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	N/A
DRAWN STAFF SRL	CHECKED RT	APPROVED LM	DATE 17-09-2024
FORMAT A3	DRAWING NO. 123A90-FDL-PP-DI-00056	SHEET / OF 1/1	REV. 02

ITEM	Tag	25-RO-024	: Restriction Orifice - Hyrogen to vessels inlet header vent system		Dwg	123A90-DDL-PR-PID-80013	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001436	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity STS	Discipline Instrumental	Form	TJX11	Orifice Plate

EQUIPMENT DATA

CALCULATION SHEET REF:	1724001690-IN-CA-00005		
DATA SHEET N°:	123A90-DDL-IN-DS-40054		
MATERIAL	AISI 316/316L	SPECIFIED THICKNESS:	6 mm
SPECIFIED OD:	73 mm	MODEL N°:	Restriction orifice - single hole
TEST EQUIPMENT:	Vernier caliper	SPECIFIED ID:	4,26 mm

TEST DETAILS

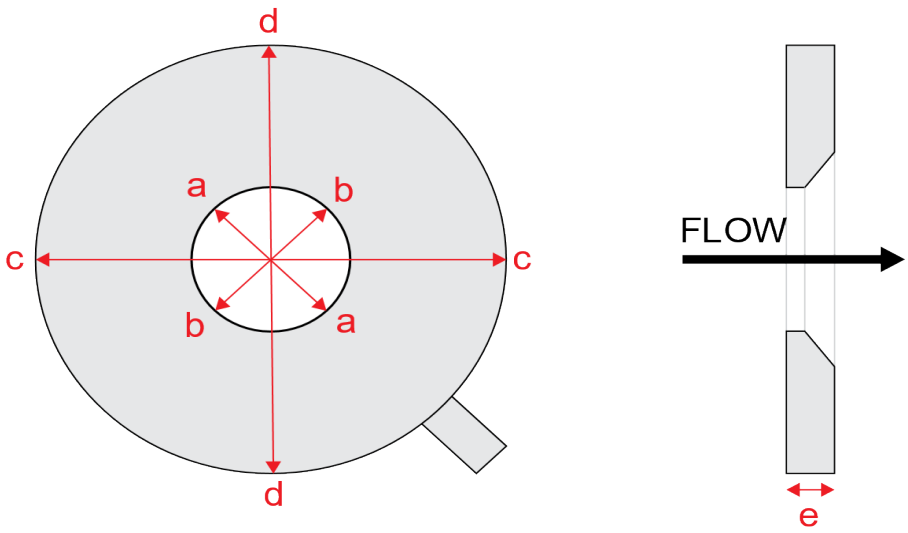

Measured Diameter : **a**	4,3 mm	Measured Diameter : **b**	4,3 mm
Measured Diameter : **c**	74 mm	Measured Diameter : **d**	74 mm
Actual plate thickness : **e**	6 mm	Flow element correctly stamped:	OK
Presence of degasing holes	No	Presence of degasing holes	No
TESTED LABEL AFFIXED	No	DATA SHEET ATTACHED	Yes

If required produce Red Line Mark Up for "AS BUILT"

Comments: Straight hole

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM (ROSETTI MARINO)	
Name	Emanuele Delfino	Kangi Albonetti	
Date	2024-12-18	2024-12-19	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2024-12-18T05:18:00.373Z	PROVERLIS Digitaly signed by Kangi Albonetti 2024-12-19T16:32:52.452Z	

TERRANOVA®

WE DO PROCESS INSTRUMENTATION PRECISELY

SPRIANO Valcom MEC·RELA


Customer:	ROSETTI MARINO	PO	:4791_OS
TAG	:25-RO-024	Doc	:1724001690-IN-CA-00005-01
TAGFluid	:Nitrogen	Sales Order:	/
Fluid Ref.	:MBWR State Equation	Service	:NITROGEN
Pipe	:316 Stainless Steel	Primary	:316 Stainless Steel
Meter	:Orifice:Choked Flow	Taps	:Upstream
Coeff Eq	:Ward-Smith	Calculation	:SIZE
Preparer	:THORAT	Printed	:30/07/2024

---------- Flow ----------		
Flow Rate	30,0000	kg/h
Pipe Reynolds Number	22145,	
---------- Measurements ----------		
Pressure (Upstream pG1)	2,0000	Bar,gage
Pressure (Downstream pG2)	0,5770	Bar,gage
Choking Pressure Ratio pf2/pf1	0,5277	
Barometric	1,0133	Bar,abs
Temperature Flowing	25,0000	degC
---------- Fluid Properties @ dry conditions ----------		
Density Flowing	3,4072	kg/m^3
Specific Gravity, G	0,9672	
Molecular Weight (Mw)	28,0134	
Compressibilty (Zf)	0,9994	
Viscosity	0,0180	cP
Isentropic Exponent(Cp/Cv)	1,4032	
----------Factors----------		
Discharge Coefficient(C)	0,8392	
Pipe Thermal Expansion (FaD)	1,0001	
Critical Flow Function (Ycr)	0,6855	
---------- Design Information ----------		
Pipe Diameter(D)	26,64460	mm@20, degC
Bore Diameter (d)	4,26650	mm@20, degC
Beta	0,16013	@20, degC
Orifice Minimum Thickness (tPE)	4,2665	mm
Pipeline Velocity V	4,39	m/s
Overall Pressure Loss	1,4230	Bar

BORE DIAMETER AND THICKNESS AS DISPLAYED ON THE GAD TABLE

R.W. Miller and Associates, Inc. The FLOW CONSULTANT TM Licensed Software C1987-2012 Version 7.1.0007

ORI ORIFICE PLATES (SINGLE HOLE)

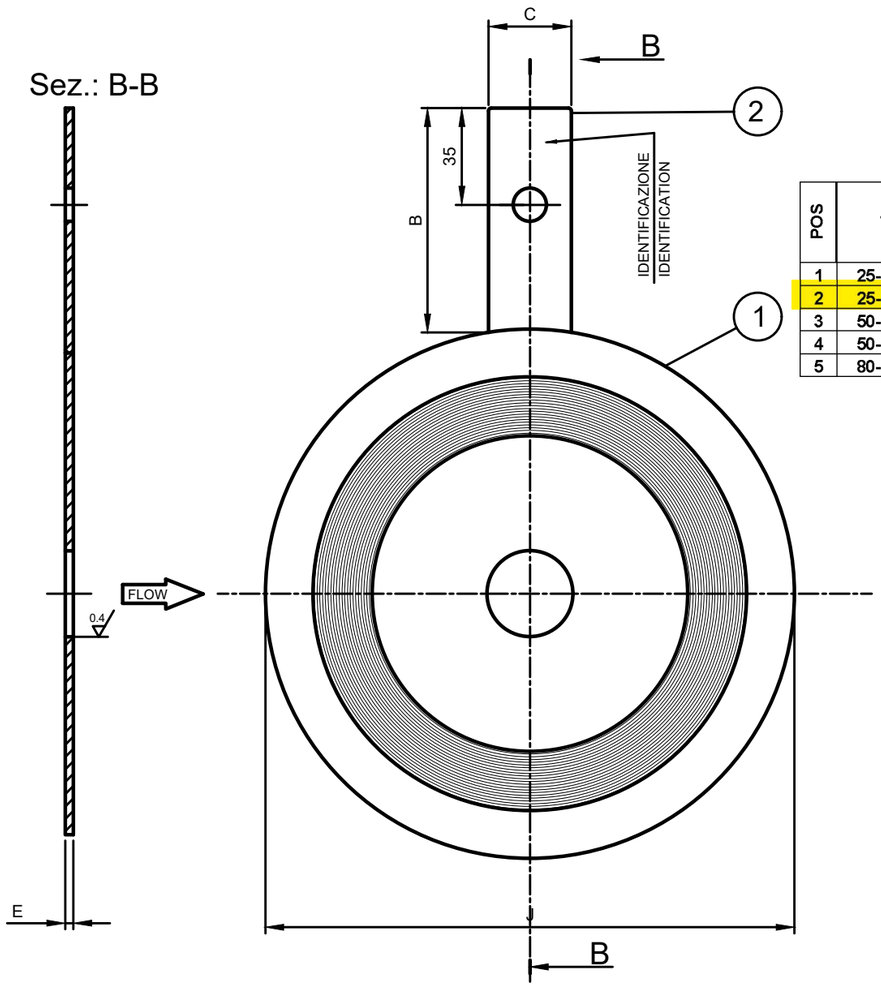

POS	TAG	ND	RATING	SCH	PIPE			RESTRICTION ORIFICE								NOISE LEVEL [Dba]	CAV. NUMBER	NOTE	
					O.D. [mm]	I.D. [mm]	THK [mm]	MTL	n°OF HOLES	d [mm]	d1 [mm]	E [mm]	J [mm]	B [mm]	C [mm]				
1	25-RO-022	1"	300	40S	33,4	26,64	3,38	SS 316/316L	1	5,19	5,19	6	73,0	115	30	86		CRITICAL	THICK PLATE RESTRICTION
2	25-RO-024	1"	300	40S	33,4	26,64	3,38	SS 316/316L	1	4,26	4,26	6	73,0	115	30	65		CRITICAL	THICK PLATE RESTRICTION
3	50-RO-001	1"	150	40S	33,4	26,64	3,38	SS 316/316L	1	0,12	0,12	3	67,0	110	30	65	1,22		
4	50-RO-002	1"	150	40S	33,4	26,64	3,38	SS 316/316L	1	0,12	0,12	3	67,0	110	30	65	1,22		
5	80-RO-001	1"	150	40S	33,4	26,64	3,38	SS 316/316L	1	4,26	4,26	6	67,0	110	30	65		CRITICAL	THICK PLATE RESTRICTION

TAGS 50-RO-001 AND 50-RO-002 KEPT IN HOLD STATUS.

NOTES:
1. FLOW METER REFERENCE CODE: ISO 5167 / MILLER ENGINEERING HANDBOOK
2. MARKING: MARKING DETAIL AS PER CUSTOMER SPECIFICATION (TAG / d / ID / SIZE / RATING / MATERIAL / REF CODE / DIRECTION OF FLOW (as minimum)
3. d, PRESSURE DROP: refer to CALCULATION SHEETS

CERTIFICATES
- Material Certificates 3.1 (EN 10204)
- PMI Test on all Plates
- Visual & Dimensional Test

TERRANOVA
SPRIANO Valcem MEC-RELA
CROSSWIND
ROSETTI MARINO

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	23/10/24	MZ	GA	GO	ACCEPTED FOR CONSTRUCTION (AFC)
00	03/10/24	MZ	GA	GO	ISSUE FOR REVIEW (IFR)

TITLE : BASE LOAD POWER HUB (BLPH)
GENERAL ARRANGEMENT DRAWINGS-RESTRICTION ORIFICE
RESTRICTION ORIFICE (SINGLE HOLE)

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE : 1:2

A3 | DRAWING NO. 1724001690-IN-DA-00003 | SHEET 003 | REV. 01

F.to UNI A3: 420mmx297mm

File Name : 123A90.DDL.XX.XXXXXX Rev. 00

GENERAL	1	Tag Number			25-RO-024			
	2	Service			HYDROGEN FROM ELECTROLYZER (A-20000) TO HYDROGEN VENT HEADER			
	3	P&ID Number			123A90-DDL-PR-PID-80013			
	4	Line Number			1"-HY-143-03HSS-N			
	5	Line Size	Line Schedule		1"		Thk (mm) = 3.38	
	6	Line Material			ASTM A312 Gr.TP316/316L			
	7							
PROCESS CONDITIONS	8	Fluid	State		NITROGEN		GAS	
	9	Design Pressure	Min.	Max.			40 barg	
	10	Design Temperature	Min.	Max.			80	
	11	Base Pressure	Base Temperature					
	12	Critical Pressure						
	13	Permanent Pressure Loss Across Meter						
	14	Entrained Gas / Liquid (% Mass)						
	15				Units			
	16	Flow Operating			kg/h	30 (*)	30	
	17	Upsteam Pressure			barg	2 (*)	8	
	18	Temperature			°C	25 (*)	25	
	19	Density			kg/m^3	3.4 (*)	10.2	
	20	Compressibility Factor			-	1 (*)	1	
	21	Viscosity			cP	0.018 (*)	0.018	
	22	Vapour Pressure						
	23	Specific Heat Ratio Cp/Cv			-	1.4 (*)	1.4	
	24	Molecular Weight			28			
ORIFICE PLATE	25	Type			RESTRICTION ORIFICE CONCENTRIC TYPE (Choked Flow)			
	26	Material			AISI 316/316L			
	27	Thickness			6mm			
	28	Bore Diameter			4.26mm (1)			
	29	Beta Ratio			0.16013			
	30	Drain or Vent Hole			N.A.			
	31	Flow Full Scale			30 Kg/h			
	32	Differential Pressure @ Full scale			2 Barg - 0.5770 Barg = 1.423 Bar			
	33	Choking Pressure Ratio			0.5277			
ORIFICE FLANGES	34	Size			1" (Flanges are Out of scope of Vendor's supply)			
	35	Rating			300#			
	36	Type			Flanged			
	37	Facing			RF			
	38	Flange Material			ASTM A182 Gr.F316/316L			
	39	Gasket Material			(Gaskets are Out of scope of Vendor's supply)			
	40	Taps Type	Quantity		-		-	
	41	Taps Size	Connection		-		-	
	42	Taps Orientation			-			
	43							
	44							
PURCHASE	45	Manufacturer			TECNOMATIC			
	46	Model			-			
	47	Purchase Order Number			1724001690			

Notes:
(1) Downstream Pressure = atm
(*) Sizing case

No.	Date	By	Chkd	Appr	Description
01	06/09/2024	VBA	LCA	DLO	Accepted for Construction (AFC)
00	22/02/2024	VBA	LCA	DLO	Issued for Review (IFR)

INSTRUMENT DATASHEET

Orifice Plate

CROSSWIND

ROSETTI MARINO

Sheet 12 of 15

Code: 314 Doc. No.: 123A90-DDL-IN-DS-40054 Rev 01

ITEM	Tag	AV-63001/25-XV-011	: Pneumatic Connection Air Supply - 25-XV-011		Dwg	123A90-DDL-IN-LIS-40092	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001940	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline Instrumental	Form	CJX06	Tubing Hydraulic

General

1	Drawings (P&ID tube) attached.	OK
2	Isometric drawings (P&ID pipe) attached.	NA
3	Check drawings at last revision.	OK
4	Material certificates for pipe/tube/fittings/flanges/hose and support clamps checked	OK
5	Welders certificates checked	NA
6	Certificate and mark-up drawings for welding WPS and WPQR and material certificates checked	NA
7	Certificates and mark-up drawings for NDT report checked	NA

Check before Flushing and/or Testing

8	Installation complete and in compliance with drawings and specifications.	OK
9	Tubing/Piping tray checked.	NA
10	Hose according to specifications and tightened	NA
11	Flanges - nuts and bolts tightened.	NA
12	Fittings are mounted and tightened.	OK
13	Pipe supports completed and installed as required.	OK
14	Cable ladders, trays, sharp edges protected, cut ends sealed.	NA
15	Maintenance evaluation.	OK

REFER TO FINAL SHEET FOR ACCEPTANCE

ITEM	Tag	AV-63001/25-XV-011	: Pneumatic Connection Air Supply - 25-XV-011			Dwg	123A90-DDL-IN-LIS-40092
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001940		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX06 Tubing Hydraulic

Flushing / Pressure testing

16	Drawings of flushing loops (P&ID tube) attached	NA
17	Equipment & valves bypassed and blinded	OK
18	Calibration certificates attached	OK
19	Type of flushing medium correct	NA
20	Printout from recorder/particle counter	NA
21	Printout from pressure indicator	OK

Final Check

22	Final inspection of pipework.	OK
23	Preservation of tested pipework.	NA
24	System/equipment labelled with: "Hot Oil flushing performed".	NA
25	If required produce Red Line Mark Up for "AS BUILT"	

TEST SPECIFIED USED

TEST FLUID: IA TEST PRESSURE BAR G: 9 TEST DURATION : 12 min

TEST EQUIPMENT: CPG 1500 SERIAL N°: 1A014ILJJIM

HOOK UP DIAGRAM Number: 123A90-DDL-IN-HD-40078

Line FROM	Line TO	Tubing cleaned			Tubing flushed			Diam ID/OD
		Yes	No	N/A	Yes	No	N/A	
AV-63001	25-XV-011	●					●	1/2" OD x Thk. 0,049"

TESTED LABEL AFFIXED DATA SHEET ATTACHED

Comments:

	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM (ROSETTI MARINO)	
Name	Michele Tartaglia	Paolo Schintu	
Date	2025-01-25	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-25T13:56:50.699Z	PROVERLIS Digitaly signed by Paolo Schintu 2025-01-30T14:00:06.691Z	

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	AV-63001/25-XV-011

Instrument

Strumento

Electrical pressure gauge *Misuratore di pressione elettronico*	
Model *Modello*	CPG1500
Serial number *Numero di serie*	1A014ILJJIM
Log temperature *Registrazioni di Temperatura*	Active *Attivo*
Scale range *Campo scala*	(0 ... 1000) bar a
Accuracy *Accuratezza*	0.1 % FS
Tag number *Numero tag*	
Communication *Comunicazione*	Wireless (00:13:43:85:DD:8D)

Measurement conditions

Condizioni di misura

Settings *Impostazioni*	
Mode *Modalità*	Automatic *Automatico*
Interval (ms) *Intervallo (ms)*	15000
Duration (hh:mm:ss) *Durata (hh:mm:ss)*	00:12:07
Start time (hh:mm:ss) *Tempo di avvio (hh:mm:ss)*	11:48:48 pm

Logger protocol

Protocollo di acquisizione elenco dati


ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	123A90-Tubing_3

Measurement results

Risultati della misura

Graphical representation of progression
Rappresentazione grafica dell'andamento

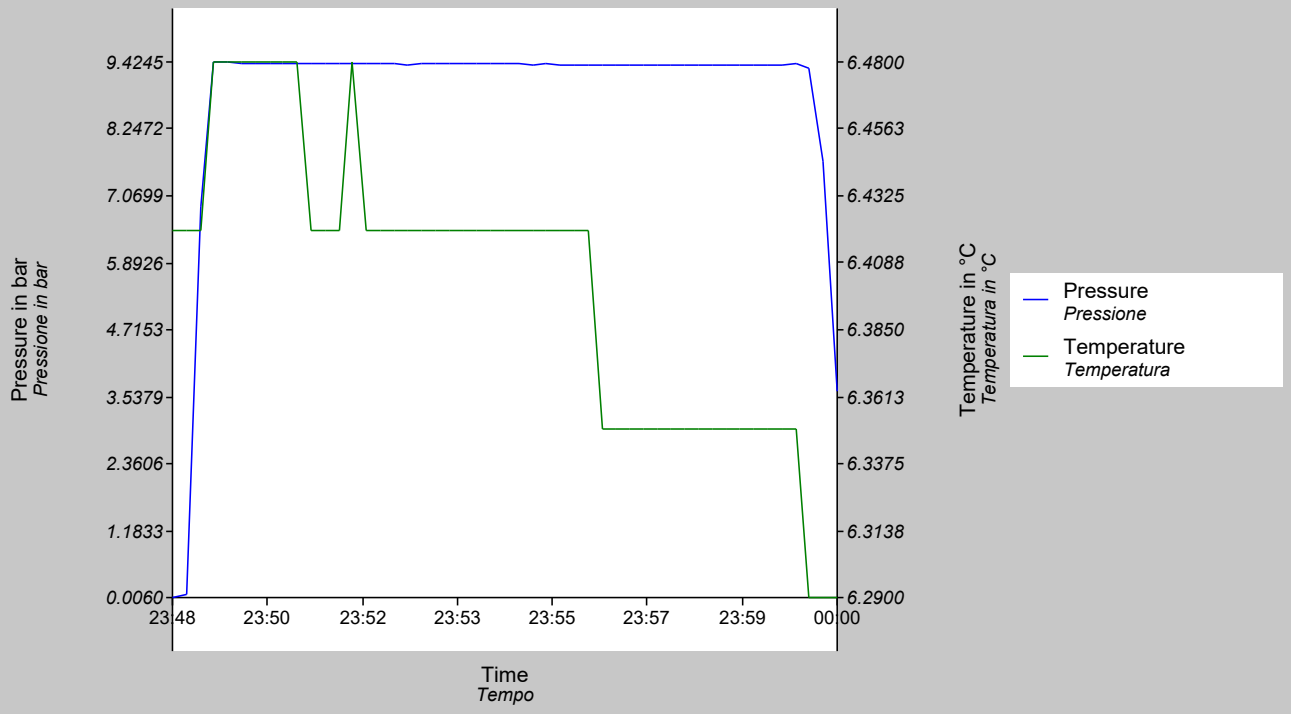

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/24/2025 23:48:48.000	0.0060	6.4200
01/24/2025 23:49:03.000	0.0586	6.4200
01/24/2025 23:49:18.000	6.8624	6.4200
01/24/2025 23:49:33.000	9.4245	6.4800
01/24/2025 23:49:48.000	9.4161	6.4800
01/24/2025 23:50:03.000	9.4006	6.4800
01/24/2025 23:50:18.000	9.4002	6.4800
01/24/2025 23:50:33.000	9.3990	6.4800
01/24/2025 23:50:48.000	9.3980	6.4800
01/24/2025 23:51:03.000	9.3966	6.4800
01/24/2025 23:51:18.000	9.3943	6.4200
01/24/2025 23:51:33.000	9.3904	6.4200
01/24/2025 23:51:48.000	9.3931	6.4200
01/24/2025 23:52:03.000	9.3955	6.4800
01/24/2025 23:52:18.000	9.3908	6.4200
01/24/2025 23:52:33.000	9.3914	6.4200
01/24/2025 23:52:48.000	9.3954	6.4200

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	123A90-Tubing_3


Measurement results


Risultati della misura

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/24/2025 23:53:03.000	9.3819	6.4200
01/24/2025 23:53:18.000	9.3847	6.4200
01/24/2025 23:53:33.000	9.3853	6.4200
01/24/2025 23:53:48.000	9.3860	6.4200
01/24/2025 23:54:03.000	9.3855	6.4200
01/24/2025 23:54:18.000	9.3844	6.4200
01/24/2025 23:54:33.000	9.3867	6.4200
01/24/2025 23:54:48.000	9.3841	6.4200
01/24/2025 23:55:03.000	9.3878	6.4200
01/24/2025 23:55:18.000	9.3815	6.4200
01/24/2025 23:55:33.000	9.3848	6.4200
01/24/2025 23:55:48.000	9.3803	6.4200
01/24/2025 23:56:03.000	9.3816	6.4200
01/24/2025 23:56:18.000	9.3810	6.4200
01/24/2025 23:56:33.000	9.3784	6.3500
01/24/2025 23:56:48.000	9.3807	6.3500
01/24/2025 23:57:03.000	9.3781	6.3500
01/24/2025 23:57:18.000	9.3766	6.3500
01/24/2025 23:57:33.000	9.3748	6.3500
01/24/2025 23:57:48.000	9.3800	6.3500
01/24/2025 23:58:03.000	9.3824	6.3500
01/24/2025 23:58:18.000	9.3821	6.3500
01/24/2025 23:58:33.000	9.3822	6.3500
01/24/2025 23:58:48.000	9.3825	6.3500
01/24/2025 23:59:03.000	9.3767	6.3500
01/24/2025 23:59:18.000	9.3761	6.3500
01/24/2025 23:59:33.000	9.3780	6.3500
01/24/2025 23:59:48.000	9.3716	6.3500
01/25/2025 00:00:03.000	9.3851	6.3500
01/25/2025 00:00:18.000	9.3032	6.2900
01/25/2025 00:00:33.000	7.6884	6.2900
01/25/2025 00:00:48.000	3.6455	6.2900

DRAWING NO. 12390-DDL-IN-DL-40085

REV. 01

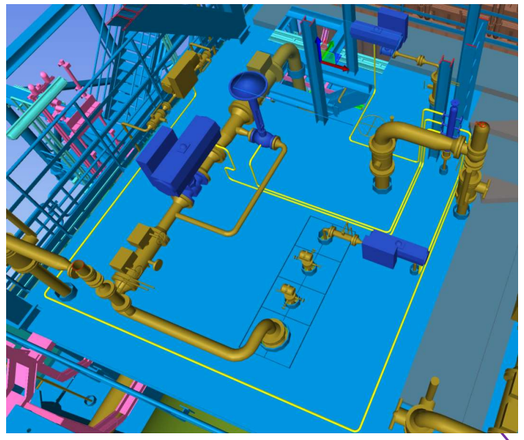

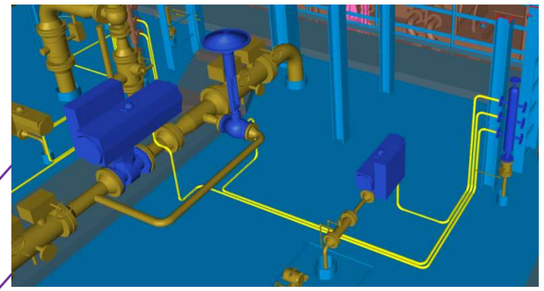

FUEL CELL TRANSFORMER
A-80000

CRANE
X-99001

25-BDV-022
+34.740mm
+4.430mm T.O.S

AV-63006
+35.085mm
+4.775mm T.O.S

80-XV-001
+34.508mm
+4.198mm T.O.S

25-PV-049
+34.740mm
+4.430mm T.O.S

25-BDV-019
+34.740mm
+4.430mm T.O.S

Q-43004
HYDROGEN VENT

25-XV-021
+34.479mm
+4.169mm T.O.S

25-BDV-016
+34.740mm
+4.430mm T.O.S

V-25001A V-25001B V-25001C

HYDROGEN STORAGE VESSELS

REFER SHEET-001

AV-63010
+35.834mm
+5.524mm T.O.S

25-XV-024
+35.140mm
+4.830mm T.O.S

25-SDV-001
+35.140mm
+4.830mm T.O.S

25-XV-004
+35.245mm
+4.935mm T.O.S

25-FV-031
+35.245mm
+4.935mm T.O.S

A-20000
ELECTROLYSER

AV-63012
+35.085mm
+4.775mm T.O.S

AV-63004
+35.085mm
+4.775mm T.O.S

25-XV-015
+34.479mm
+4.169mm T.O.S

25-PV-043
+34.740mm
+4.430mm T.O.S

25-BDV-013
+34.740mm
+4.430mm T.O.S

25-XV-018
+34.508mm
+4.198mm T.O.S

25-PV-046
+34.740mm
+4.430mm T.O.S


25-XV-008
+35.245mm
+4.935mm T.O.S


AV-63001
+35.834mm
+5.524mm T.O.S

25-XV-011
+35.245mm
+4.935mm T.O.S

25-FV-033
+35.245mm
+4.935mm T.O.S

25-FV-032
+35.245mm
+4.935mm T.O.S

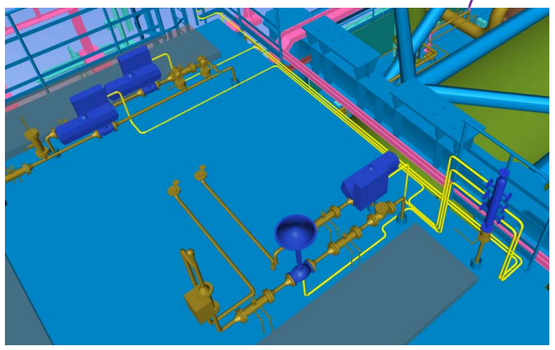

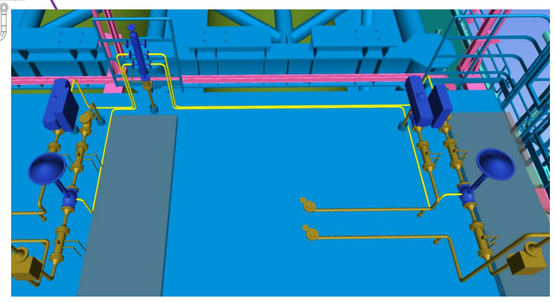

UPPER DECK

SCALE: 1:1

VIEW EL. 33740mm to 36500mm

AV-63001

25-XV-008	25-XV-011
25-FV-032	25-FV-033
SPARE	SPARE

AV-63004

25-BDV-013	SPARE
25-PV-043	SPARE
25-XV-015	SPARE

AV-63006


25-BDV-022	25-BDV-019
25-XV-021	80-XV-001
25-PV-049	SPARE

AV-63010

25-SDV-001	25-FV-031
25-XV-024	64-SDV-001
25-XV-004	SPARE

AV-63012

25-XV-018	SPARE
25-PV-046	SPARE
25-BDV-016	SPARE

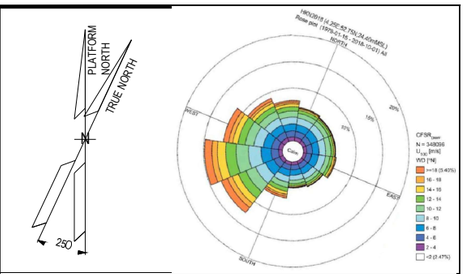

NOTES

1) TUBING ROUTING > 2m IS SHOWN AND IT IS INDICATIVE ONLY.
TUBING ROUTING SHALL BE FINALIZED DURING CONSTRUCTION ACTIVITIES.

LEGEND

- AIR DISTRIBUTION POT
- CONTROL VALVE
- ON-OFF VALVE
- TUBING
- TUBING GOING UP
- TUBING GOING DOWN

HOLDS

REFERENCE DOCUMENTS

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	23/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/02/24	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND | ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40085

REV.:	DATE:	SIGNATURE:
1_C	12/12/24	C.Pilato

ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT TUBING LAYOUT
ELEVATION 30.310 m


CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:100
DRAWN DRAWN_BY	CHECKED CHECKED_BY	APPROVED APPROVED_BY	DATE DD/MM/YY

A1	DRAWING NO. 123A90-DDL-IN-DL-40085	SHEET 002	REV. 01

File Name : 12390-DDL-IN-DL-40085_Rev.01

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

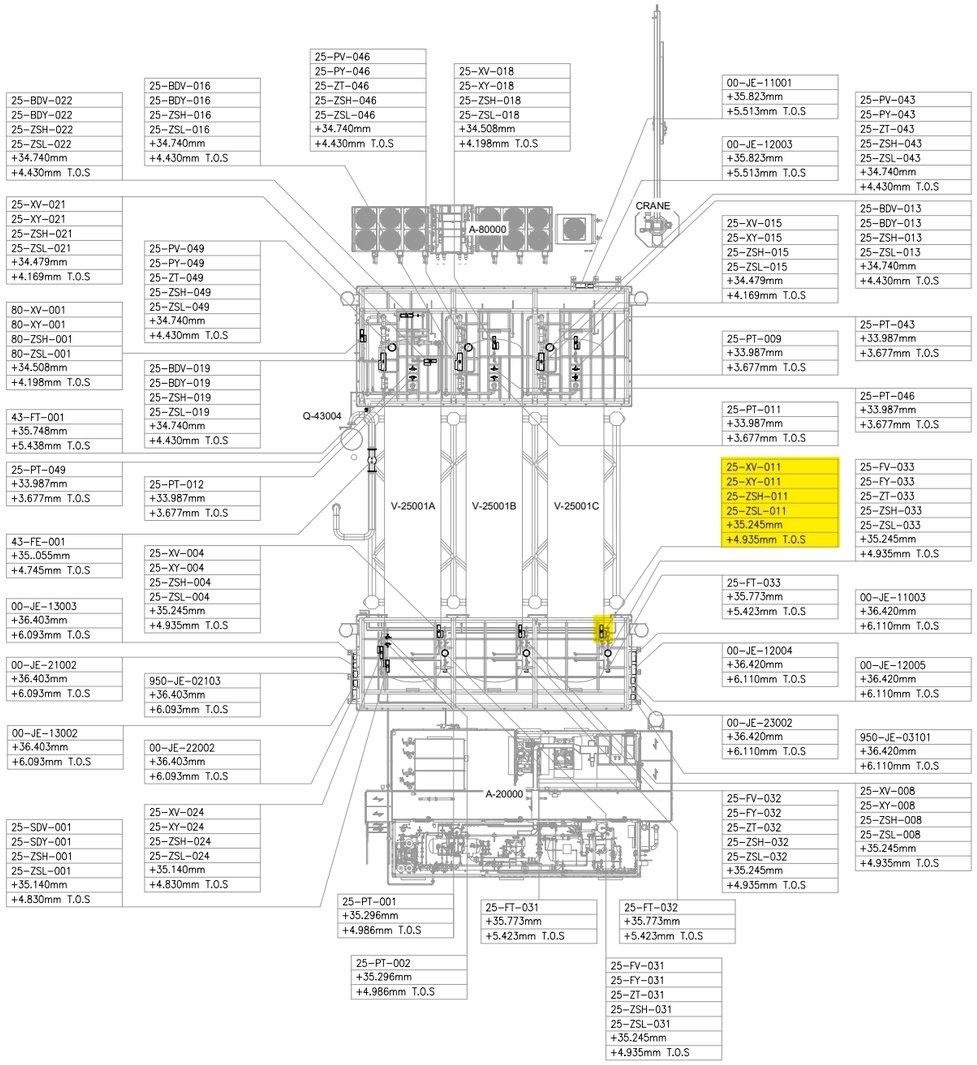

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm

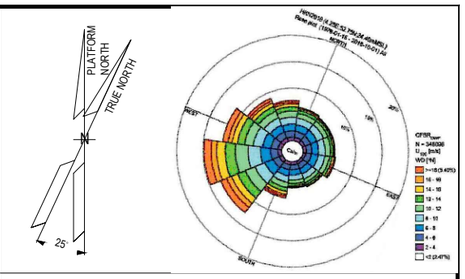

NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DL-40081

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 C

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

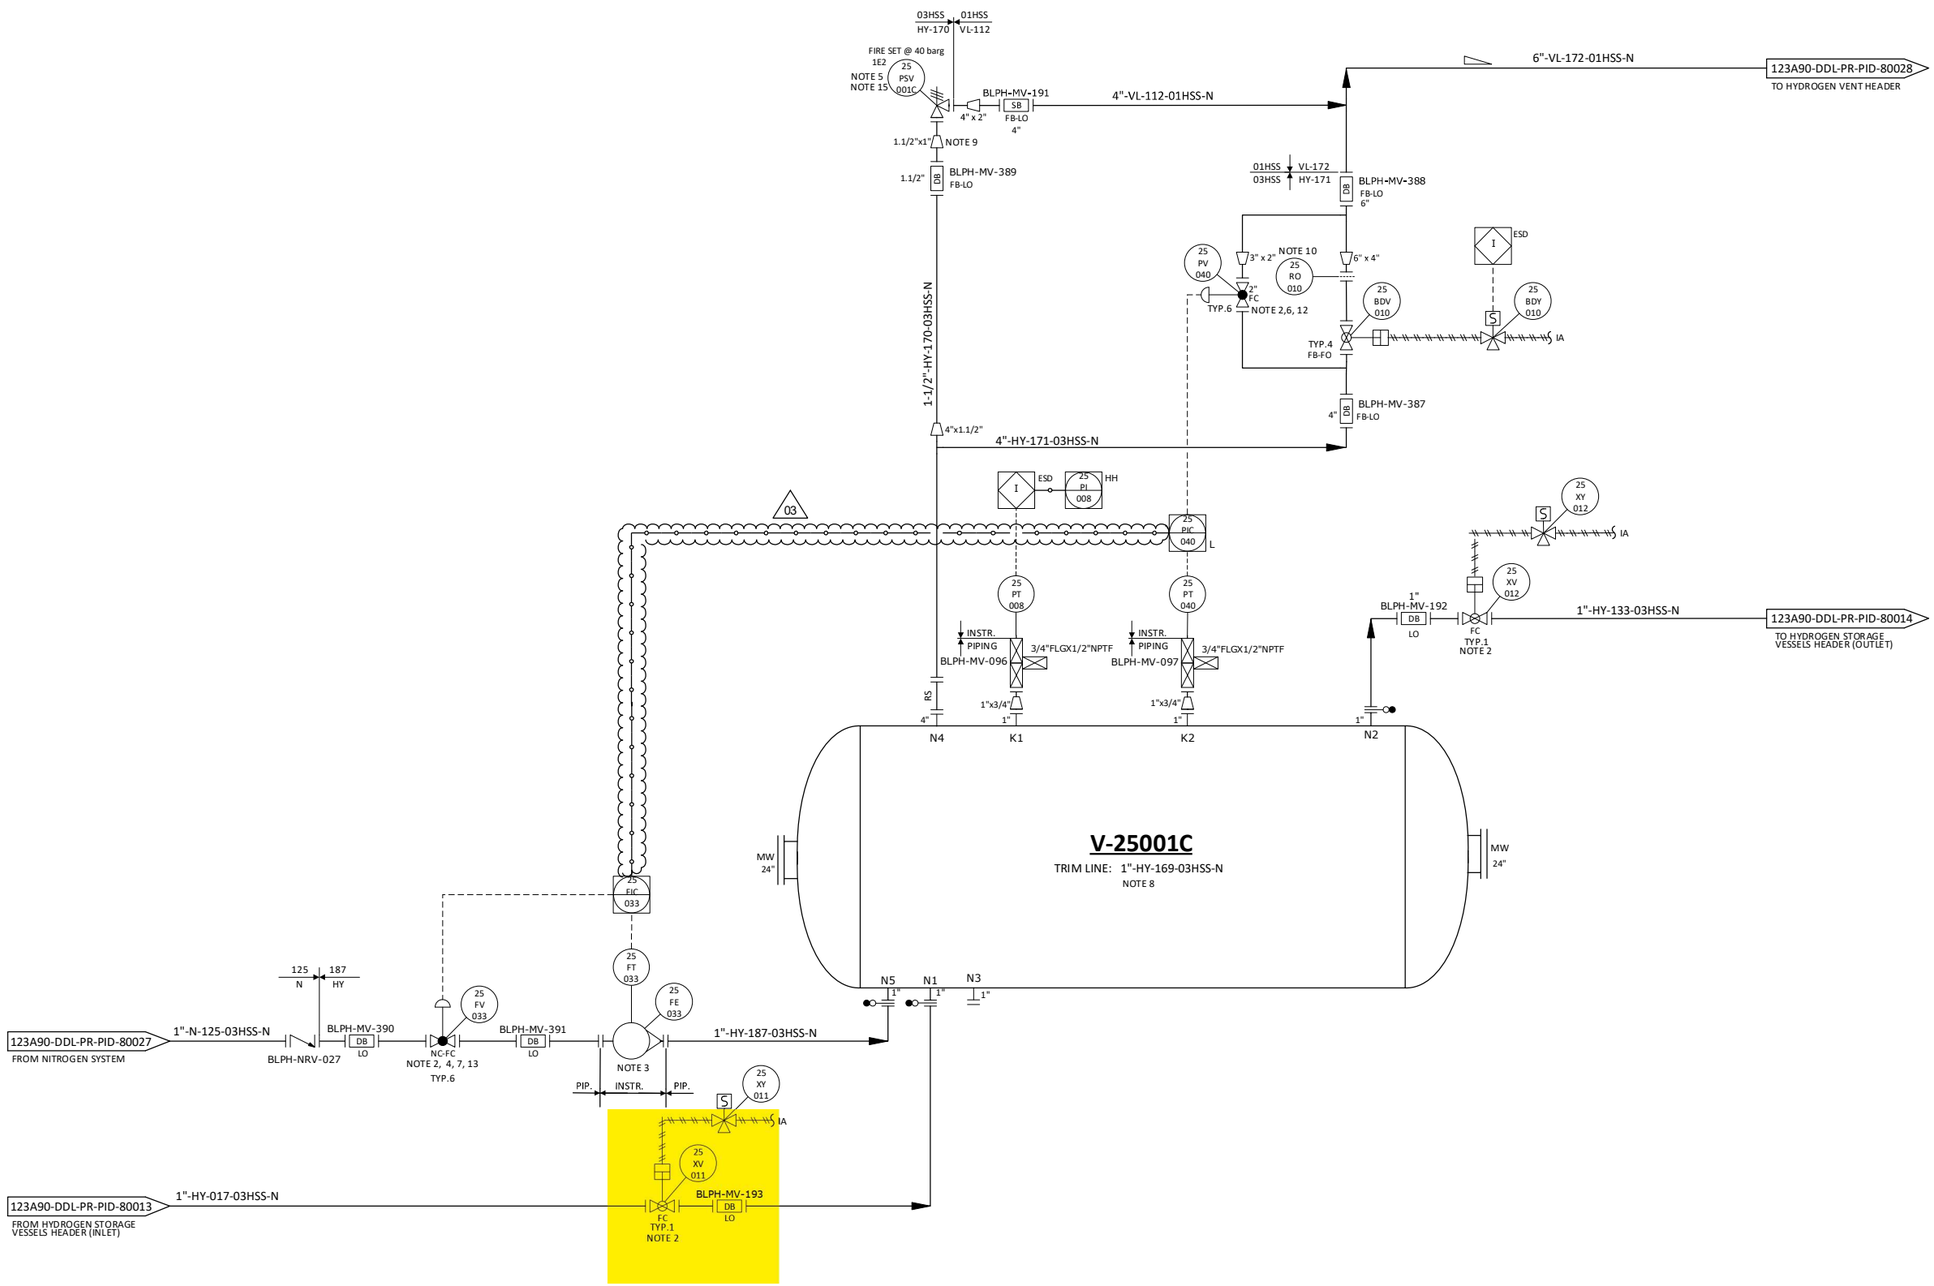

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-PV-033) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-040 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-040 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-033 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-040 HAS FAILED TO CLOSE.
15. 25-PS-V001C SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL C

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80017	SHEET 001	REV. 03

File Name : FILE_NAME


CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Pneumatic Hook-Ups	Sh. 6 of 6 Date: 08/07/2024 Rev. 01

PNEUMATIC HOOK-UP FOR ON-OFF VALVES

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40078**

REV.:	DATE:	SIGNATURE:
1_B	06/11/24	G.Randi

ROSETTI MARINO SpA



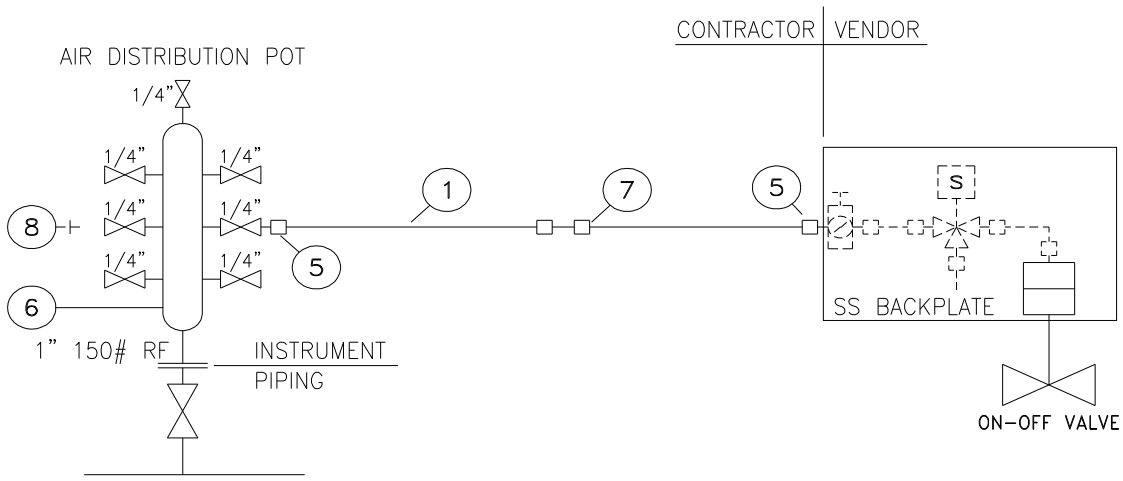


INSTRUMENT TAG	
1	25-BDV-022
2	25-BDV-005
3	25-BDV-007
4	25-BDV-010
5	25-BDV-013
6	25-BDV-016
7	25-BDV-019
8	25-SDV-001
9	25-SDV-023
10	25-XV-004
11	25-XV-006
12	25-XV-008
13	25-XV-009
14	25-XV-011
15	25-XV-012
16	25-XV-014
17	25-XV-015
18	25-XV-017
19	25-XV-018
20	25-XV-020
21	25-XV-021
22	25-XV-024
23	50-XV-001
24	50-XV-002
25	50-XV-003
26	50-XV-004
27	80-XV-001
28	64-SDV-001
29	50-XV-005
30	

NOTE:
(1) For Air Distribution Pot quantities see material take-off on sh. 4

POS.	NORM/STD CODE	DESCRIPTION	SIZE/CONNECTION TYPE	Q.TY
8		SS316 PLUG	1/4" NPT	Note 1
7		SS316 UNION	1/2" O.D. x 1/2" O.D.	N. 1
6		SS316 AIR DISTRIBUTION POT	1" 150#RF - N. 7 1/4" BALL VALVES	Note 1
5		SS316 MALE CONNECTOR	1/4" NPT x 1/2" O.D.	N. 2
1		SS 316L TUBING	1/2" x 0,049"Thk	10 m

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

POS	PICTURE	DESCRIPTION		ITEM ID CODE	TOTAL					
		COMPRESSION FITTING TYPE: **DOUBLE FERRULE** THREADING: ASME B1.20.1 NPT MATERIAL: AISI 316 WORKING PRESSURE AS PER ASME B31.1 TUBING TYPE: ■ INCHES ☐ METRIC			UNIT	Counted	Required			
							Rev. 00	Rev. 01	Rev.	Rev.
1		STRAIGHT MALE CONNECTOR	1/2" NPT-M x 3/8" O.D.		nr.					
2			1/4" NPT-M x 1/2" O.D.		nr.	102	102	102		
3			1/2" NPT-M x 1/2" O.D.		nr.	36	36	-		
4			1/2" NPT-M x 3/4" O.D.		nr.					
5			3/4" NPT-M x 3/4" O.D.		nr.					
6			3/8" NPT-M x 3/8" O.D.		nr.					
7		STRAIGHT FEMALE CONNECTOR	1/2" NPT-F x 3/8" O.D.		nr.					
8			1/4" NPT-F x 1/2" O.D.		nr.					
9			1/2" NPT-F x 1/2" O.D.		nr.					
10			1/2" NPT-F x 3/4" O.D.		nr.					
11		UNION CONNECTOR	1/4" O.D. x 1/4" O.D.		nr.					
12			3/8" O.D. x 3/8" O.D.		nr.					
13			1/2" O.D. x 1/2" O.D.		nr.	49	49	49		
14			3/4" O.D. x 3/4" O.D.		nr.					
15		ELBOW CONNECTOR	1/4" NPT-M x 1/2" O.D.		nr.	27	27	27		
16			1/2" NPT-M x 1/2" O.D.		nr.					
17										
18										
19										
20										
21										
22										
23										
24										
25										
26										
27										
28										
29										
30										
27										
28										
29										
30										
31										
32										
33										
34										

VENDOR / ORDER : **AF SYSTEM / 1724001332**

MATERIAL :

- ☐ ASTM A106 Gr.B
- ■ AISI 316 L
- ☐ UNS S31254

SPECIAL REQUIREMENTS :

- ☐ ...

REMARKS :

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CERTIFICATO DI TARATURA LAT 114 0435-SM-24
Certificate of Calibration

- data di emissione date of issue	2024-09-20
- cliente customer	FAST AUTOMATION SRL VIA DELLA PREVIDENZA SOCIALE, 8 IT-42124 REGGIO EMILIA (RE)
- destinatario receiver	ROSETTI MARINO SPA - YARD PIOMBONI VIA DEL MARCHESATO, 37 IT-48122 MARINA DI RAVENNA (RA)

Si riferisce a
referring to

- oggetto *item*	Misuratore di pressione elettronico Electrical pressure gauge
- costruttore *manufacturer*	WIKA
- modello *model*	CPG1500
- matricola *serial number*	1A014ILJJIM
- data di ricev. oggetto *date of receipt of item*	2024-09-17
- data delle misure *date of measurements*	2024-09-20
- registro di laboratorio *laboratory reference*	0435-SM-24

Il presente certificato di taratura è emesso in base all'accreditamento LAT N. 114 rilasciato in accordo ai decreti attuativi della legge n. 273/1991 che ha istituito il Sistema Nazionale di Taratura (SNT). ACCREDIA attesta le capacità di misura e di taratura, le competenze metrologiche del Centro e la riferibilità delle tarature eseguite ai campioni nazionali ed internazionali delle unità del Sistema Internazionale delle Unità (SI).
Questo certificato non può essere riprodotto in modo parziale, salvo espressa autorizzazione scritta da parte del Centro.

This certificate of calibration is issued in compliance with the accreditation LAT No.114 granted according to decrees connected with Italian law No. 273/1991 which has established the National Calibration System. ACCREDIA attests the calibration and measurement capability, metrological competence of the Centre and the traceability of calibration results to the national and International standards of the International System of Units (SI).
This certificate may not be partially reproduced, except with the prior written permission of the issuing Centre.

I risultati di misura riportati nel presente Certificato sono stati ottenuti applicando le procedure di taratura citate alla pagina seguente, dove sono specificati anche i campioni o gli strumenti che garantiscono la catena di riferibilità del Centro e i rispettivi certificati di taratura in corso di validità. Essi si riferiscono esclusivamente all'oggetto in taratura e sono validi nel momento e nelle condizioni di taratura, salvo diversamente specificato.

The measurement results reported in this Certificate were obtained following the calibration procedures given in the following page, where the reference standards or instruments are indicated which guarantee the traceability chain of the laboratory, and the related calibration certificates in the course of validity are indicated as well. They relate only to the calibrated item and they are valid for the time and conditions of calibration, unless otherwise specified.

Le incertezze di misura dichiarate in questo documento sono state determinate conformemente alla Guida ISO/IEC 98 e al documento EA-4/02. Solitamente sono espresse come incertezza estesa ottenuta moltiplicando l'incertezza tipo per il fattore di copertura *k* corrispondente ad un livello di fiducia di circa il 95 %. Normalmente tale fattore *k* vale 2.

The measurement uncertainties stated in this document have been determined according to the ISO/IEC Guide 98 and to EA-4/02. Usually, they have been estimated as expanded uncertainty obtained multiplying the standard uncertainty by the coverage factor k corresponding to a confidence level of about 95%. Normally, this factor k is 2.

Direzione Tecnica
(Approving Officer)

Enrico Reccagni

Enrico Reccagni

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CARATTERISTICHE DELLO STRUMENTO IN TARATURA/ Properties of devices under calibration

Misuratore di pressione elettronico ***Electrical pressure gauge***	
Tipo *Model*	Misuratore di pressione elettronico Electrical pressure gauge
Numero di matricola *Serial No.*	1A014ILJJIM
Campo di misura *Scale range*	(0 ... 1000) bar g
Accuratezza dichiarata dal costruttore *Accuracy declared by the manufacturer*	0,1 % FS
Risoluzione *Resolution (scale division)*	0,1 bar
Tag. N. *Tag No.*	--

Procedura di taratura e catena di riferibilità
Calibration procedure and traceability chain

La taratura è stata effettuata in accordo alla linea guida DKD-R 6-1 "Taratura di strumenti di pressione" (versione 03/2014) procedura B, per confronto fra i valori dello strumento in taratura con quelli di riferimento dati dal campione di lavoro.

Calibration was carried out according to DKD-R 6-1 "Kalibrierung von Druckmessgeräten" (Ausgabe 03/2014) procedure B, by comparing the measured values of the calibration item with those of the reference or working standard.

I risultati riportati sono stati ottenuti applicando le procedure n° LMO-PT-01 rev.2

The results have been obtained using the procedures n° LMO-PT-01 rev.2

La catena di riferibilità ha inizio dai campioni di riferimento n° PM1-09

The traceability chain starts from the reference standards n° PM1-09

muniti di certificati validi di taratura, rispettivamente n° D21090

with the relevant valid calibration certificates n° D21090

Luogo di taratura
Place of calibration

Laboratorio WIKA ITALIA - Laboratorio di Modugno (BA)
WIKA ITALY Laboratory - Modugno (BA)

Campione di lavoro
Working Standard

Norma di riferimento (RS) Bilancia di pressione ***Reference standard (RS) Dead-weight tester***	
Tipo *Model*	PM1-09
Certificato di taratura *Calibration mark*	D-K-15105/D21090
Campo di misura *Scale range*	(10 ... 2500) bar g
Accuratezza *Accuracy*	0,015 % della lettura + 255 Pa

Operatore
Technichian

Francesco Donatelli

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Condizioni di misura
Measurement conditions

Schema di collegamento *Assembly*	
Fluido utilizzato *Pressure medium*	Sebacate *Sebacate*
Livello di riferimento *Refence height (for reference value)*	Superficie di tenuta DUT *Sealing face DUT*
Posizione di montaggio *Position during calibration*	verticale *vertical*

Note di taratura
Calibration Note

Lo strumento è stato tarato e riconsegnato nelle stesse condizioni in cui è arrivato nel laboratorio, in accordo con il metodo "as found as left" / The device under test (DUT) was calibrated in the same conditions it was arrived in laboratory, according to the method "as found as left".

Condizioni Ambientali
Environmental conditions

Temperatura *Temperature*	(22 ± 1,5)	°C
Pressione atmoferica *Atmospheric pressure*	(1009,3 ± 0,2)	hPa
Umidità relativa *Rel. Humidity*	(50 ± 15)	% UR

I dati meteo sono stati acquisiti tramite stazione meteo WIKA CPU6000-W s/n.1A00VCX6GJ2

Weather data were acquired via the WIKA CPU6000-W weather station s/n.1A00VCX6GJ2

Misure rilevate
Measurement results

Valore di riferimento *Reference value RS* bar	**Letture** *Reading DUT* bar		
	M1	**M2**	**M3**
0,00	0,0	0,0	0,0
99,91	99,9	99,9	99,9
199,82	199,9	199,9	199,9
299,73	299,8	299,8	299,8
399,63	399,7	399,7	399,7
499,53	499,5	499,6	499,6
599,44	599,4	599,4	599,4
699,34	699,3	699,3	699,3
799,25	799,1	799,2	799,1
899,14	899,0	899,1	899,0
999,04	999,0	999,0	999,0

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it


Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Incertezza di misura
Uncertainty of measurement

Valori di riferimento *Reference value RS* bar	Media delle misure *Mean value* bar	Errore *Error* bar	Ripetibilità *Repeatability* bar	Isteresi *Hysteresis* bar	Incertezza di misura *Meas. Uncertainty* bar
0,00	0,0	0,0	0,0	0,0	0,40
99,91	99,9	0,0	0,0	0,0	0,40
199,82	199,9	0,1	0,0	0,0	0,40
299,73	299,8	0,1	0,0	0,0	0,40
399,63	399,7	0,1	0,0	0,0	0,40
499,53	499,6	0,1	0,1	0,1	0,40
599,44	599,4	0,0	0,0	0,0	0,40
699,34	699,3	0,0	0,0	0,0	0,40
799,25	799,2	0,0	0,0	0,1	0,40
899,14	899,1	0,0	0,0	0,1	0,40
999,04	999,0	0,0	0,0	0,0	0,40

Grafico degli errori di misura
Graphical representation of measurement uncertainty

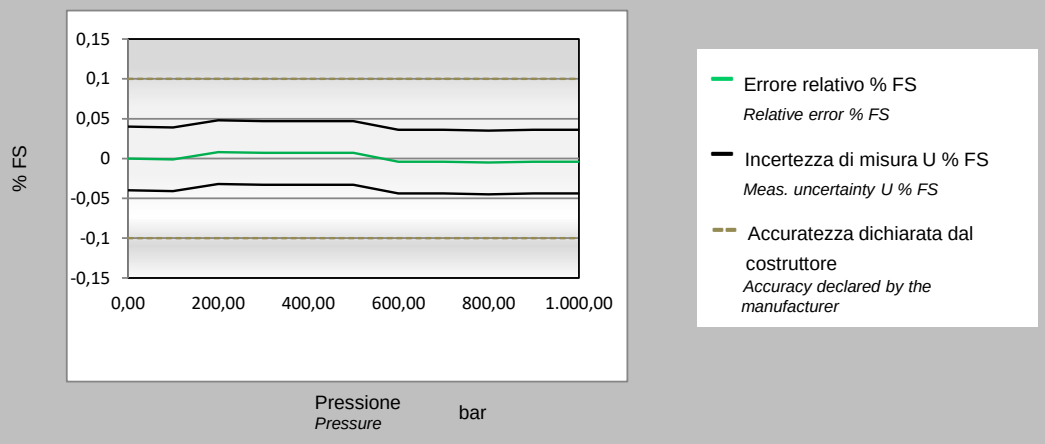

L'incertezza estesa senza correzione del DUT è pari a 0,5 bar
The expanded uncertainty of the DUT without correction is equal to

Questo dato è ottenuto come MAX{Incertezza_di_misura$_i$ + |Errore$_i$|} della tabella precedente
This data is obatined as MAX{Meas._uncertainty$_i$ + |Error$_i$|} of the previous table

Il presente certificato non rappresenta una dichiarazione di conformità a specifica
This certificate is not a statement of compliance

CROSSWIND

HOLLANDSE KUST NOORD WIND PARK Project
Contract No. CW-I-WP4-2023-05

INSTRUMENT TUBING LIST

ROSETTI MARINO

DATA TUBING																	FROM AREA					TO AREA						
POS.	REV	SUPPLY SCOPE	LAINING SCOPE	TAG Tubing	P&ID	MAIN FUNCTION	SERVICE	DESIGN TEMPERATURE(C°)	OPERATING PRESSURE (Barg)	DESIGN PRESSURE (Barg)	TEST PRESSURE (Barg)	FLUID TEST	DIMENSIONS	MATERIAL	REF. DOC.	Q.TY (m)	FIRE PROOFING	HEAT TRACING	MODULE	AREA	FROM ITEM	REF. P&I	DESCRIPTION	MODULE	AREA	TO ITEM	REF. LAYOUT	DESCRIPTION	NOTE
01	04	RM	RM	**AV-63001/25-XV-011**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N_{2} / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-XV-011	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
02	04	RM	RM	**AV-63001/25-FV-033**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-FV-033	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
03	04	RM	RM	**AV-63001/25-XV-008**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-XV-008	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
04	04	RM	RM	**AV-63001/25-FV-032**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-FV-032	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
05	04	RM	RM	**AV-63002/25-XV-020**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-020	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
06	04	RM	RM	**AV-63002/25-FV-036**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**11**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-036	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
07	04	RM	RM	**AV-63002/25-XV-017**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-017	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
08	04	RM	RM	**AV-63002/25-FV-038**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-038	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
09	04	RM	RM	**AV-63002/25-XV-014**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-014	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
10	04	RM	RM	**AV-63002/25-FV-034**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-034	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
11	04	RM	RM	**AV-63003/25-BDV-010**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-BDV-010	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
12	04	RM	RM	**AV-63003/25-PV-040**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-PV-040	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
13	04	RM	RM	**AV-63003/25-XV-012**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-XV-012	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
14	04	RM	RM	**AV-63003/25-XV-009**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**13**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-XV-009	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
15	04	RM	RM	**AV-63004/25-BDV-013**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-BDV-013	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
16	04	RM	RM	**AV-63004/25-PV-043**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-PV-043	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
17	04	RM	RM	**AV-63004/25-XV-015**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-XV-015	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
18	04	RM	RM	**AV-63005/64-PV-031A**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Lower Deck	AV-63005	123A90-DDL-PR-PID-80041	Distribution Pot 5	BLPH	Lower Deck	64-PV-031A	123A90-DDL-IN-DL-40080	Pneumatic Control Valve	Design Pressure set as per downstream PSV
19	04	RM	RM	**AV-63005/64-PV-031B**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**3**	N.A.	N.A.	BLPH	Lower Deck	AV-63005	123A90-DDL-PR-PID-80041	Distribution Pot 5	BLPH	Lower Deck	64-PV-031B	123A90-DDL-IN-DL-40080	Pneumatic Control Valve	Design Pressure set as per downstream PSV
20	04	RM	RM	**AV-63006/25-BDV-022**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-BDV-022	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
21	04	RM	RM	**AV-63006/25-XV-021**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-XV-021	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
22	04	RM	RM	**AV-63006/25-PV-049**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-PV-049	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
23	04	RM	RM	**AV-63006/25-BDV-019**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-BDV-019	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
24	04	RM	RM	**AV-63006/80-XV-001**	123A90-DDL-PR-PID-80012	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	80-XV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
25	04	RM	RM	**AV-63007/25-XV-006**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-XV-006	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
26	04	RM	RM	**AV-63007/25-PV-035**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**11**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-PV-035	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
27	04	RM	RM	**AV-63007/25-BDV-005**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-BDV-005	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
28	04	RM	RM	**AV-63007/25-PV-037**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-PV-037	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
29	04	RM	RM	**AV-63007/25-BDV-007**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-BDV-007	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
30	04	RM	RM	**AV-63008/50-XV-001**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-001	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
31	04	RM	RM	**AV-63008/50-XV-002**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-002	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
32	04	RM	RM	**AV-63008/50-XV-003**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-003	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
33	04	RM	RM	**AV-63008/50-XV-004**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-004	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
33A	04	RM	RM	**AV-63009/50-XV-005**	123A90-DDL-PR-PID-80025	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Lower Deck	AV-63009	123A90-DDL-PR-PID-80041	Distribution Pot 9	BLPH	Lower Deck	50-XV-005	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
34	04	RM	RM	**AV-63010/25-SDV-001**	123A90-DDL-PR-PID-80013	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-SDV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
35	04	RM	RM	**AV-63010/25-XV-024**	123A90-DDL-PR-PID-80013	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-XV-024	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
36	04	RM	RM	**AV-63010/25-XV-004**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-XV-004	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
37	04	RM	RM	**AV-63010/25-FV-031**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-FV-031	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
38	04	RM	RM	**AV-63010/64-SDV-001**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**15**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	64-SDV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
39	04	RM	RM	**AV-63011/25-SDV-023**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-SDV-023	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
40	04	RM	RM	**AV-63011/25-PV-055A**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-PV-055A	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
41	04	RM	RM	**AV-63011/25-PV-055B**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-PV-055B	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
42	04	RM	RM	**AV-63012/25-XV-018**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-XV-018	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
43	04	RM	RM	**AV-63012/25-PV-046**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-PV-046	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
44	04	RM	RM	**AV-63012/25-BDV-016**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-BDV-016	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
~~45~~	03	DELETED	DELETED	~~**BLPH-MV-014/25-PT-001**~~	~~123A90-DDL-PR-PID-80013~~	~~Process Connection~~	~~Hydrogen~~	~~80~~	~~7,5 / 30~~	~~40~~	~~7,5 / 30~~	~~N_{2}~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-014~~	~~123A90-DDL-PR-PID-80013~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25-PT-001~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~46~~	03	DELETED	DELETED	~~**BLPH-MV-013/25-PT-002**~~	~~123A90-DDL-PR-PID-80013~~	~~Process Connection~~	~~Hydrogen~~	~~80~~	~~7,5 / 30~~	~~40~~	~~7,5 / 30~~	~~N_{2}~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-013~~	~~123A90-DDL-PR-PID-80013~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25-PT-002~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~47~~	03	DELETED	DELETED	~~**BLPH-MV-026/25-PT-055A**~~	~~123A90-DDL-PR-PID-80014~~	~~Process Connection~~	~~Hydrogen~~	~~100~~	~~17,2~~	~~19~~	~~17,2~~	~~N_{2}~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-026~~	~~123A90-DDL-PR-PID-80014~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~26-PT-055A~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~48~~	03	DELETED	DELETED	~~**BLPH-MV-213/26-PT-055B**~~	~~123A90-DDL-PR-PID-80014~~	~~Process Connection~~	~~Hydrogen~~	~~100~~	~~3,5 / 6,5~~	~~10~~	~~3,5 / 6,5~~	~~N_{2}~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-213~~	~~123A90-DDL-PR-PID-80014~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~26-PT-055B~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~49~~	03	DELETED	DELETED	~~**BLPH-MV-407/43-PT-001**~~	~~123A90-DDL-PR-PID-80029~~	~~Process Connection~~	~~Hydrogen~~	~~-10 / +80~~	~~ATM~~	~~3,5~~	~~ATM~~	~~N_{2}~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-407~~	~~123A90-DDL-PR-PID-80029~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~43-PT-001~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~50~~	03	DELETED	DELETED	~~**BLPH-MV-411/60-PT-014**~~	~~123A90-DDL-PR-PID-80026~~	~~Process Connection~~	~~Waste Water~~	~~100~~	~~ATM~~	~~17,7~~	~~ATM~~	~~N_{2}~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~YES~~	~~BLPH~~	~~Lower Deck~~	~~BLPH-MV-411~~	~~123A90-DDL-PR-PID-80026~~	~~Manual Valve~~	~~BLPH~~	~~Lower Deck~~	~~60-PT-014~~	~~123A90-DDL-IN-DL-40080~~	~~Pressure Transmitter~~	
~~51~~	03	DELETED	DELETED	~~**BLPH-MV-160/63-PT-003**~~	~~123A90-DDL-PR-PID-80027~~	~~Process Connection~~	~~Instrument Air~~	~~100~~	~~4 / 10~~	~~11~~	~~4 / 10~~	~~N_{2}~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-160~~	~~123A90-DDL-PR-PID-80027~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~63-PT-003~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~52~~	03	DELETED	DELETED	~~**BLPH-MV-151/63-PT-004**~~	~~123A90-DDL-PR-PID-80027~~	~~Process Connection~~	~~Instrument Air~~	~~100~~	~~4 / 10~~	~~11~~	~~4 / 10~~	~~N_{2}~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-151~~	~~123A90-DDL-PR-PID-80027~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~63-PT-004~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
53	04	RM	RM	**BLPH-MV-386/64

ITEM	Tag	AV-63001/25-XV-008	: Pneumatic Connection Air Supply - 25-XV-008		Dwg	123A90-DDL-IN-LIS-40092	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001942	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline Instrumental	Form	CJX06	Tubing Hydraulic

General

1	Drawings (P&ID tube) attached.	OK
2	Isometric drawings (P&ID pipe) attached.	NA
3	Check drawings at last revision.	OK
4	Material certificates for pipe/tube/fittings/flanges/hose and support clamps checked	OK
5	Welders certificates checked	NA
6	Certificate and mark-up drawings for welding WPS and WPQR and material certificates checked	NA
7	Certificates and mark-up drawings for NDT report checked	NA

Check before Flushing and/or Testing

8	Installation complete and in compliance with drawings and specifications.	OK
9	Tubing/Piping tray checked.	NA
10	Hose according to specifications and tightened	NA
11	Flanges - nuts and bolts tightened.	NA
12	Fittings are mounted and tightened.	OK
13	Pipe supports completed and installed as required.	OK
14	Cable ladders, trays, sharp edges protected, cut ends sealed.	NA
15	Maintenance evaluation.	OK

REFER TO FINAL SHEET FOR ACCEPTANCE

ITEM	Tag	AV-63001/25-XV-008	: Pneumatic Connection Air Supply - 25-XV-008			Dwg	123A90-DDL-IN-LIS-40092
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001942		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX06 Tubing Hydraulic

Flushing / Pressure testing

16	Drawings of flushing loops (P&ID tube) attached	NA
17	Equipment & valves bypassed and blinded	OK
18	Calibration certificates attached	OK
19	Type of flushing medium correct	NA
20	Printout from recorder/particle counter	NA
21	Printout from pressure indicator	OK

Final Check

22	Final inspection of pipework.	OK
23	Preservation of tested pipework.	NA
24	System/equipment labelled with: "Hot Oil flushing performed".	NA
25	If required produce Red Line Mark Up for "AS BUILT"	

TEST SPECIFIED USED

TEST FLUID: IA TEST PRESSURE BAR G: 9 TEST DURATION : 12 MIN

TEST EQUIPMENT: CPG 1500 SERIAL N°: 1A014ILJJIM

HOOK UP DIAGRAM Number: 123A90-DDL-IN-HD-40078

Line FROM	Line TO	Tubing cleaned			Tubing flushed			Diam ID/OD
		Yes	No	N/A	Yes	No	N/A	
AV-63001	25-XV-008	●					●	1/2" OD x Thk. 0,049"

TESTED LABEL AFFIXED DATA SHEET ATTACHED

Comments:

	Performed by	☒ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Paolo Schintu	
Date	2025-01-25	2025-02-04	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-25T13:57:15.413Z	PROVERLIS Digitaly signed by Paolo Schintu 2025-02-04T11:36:49.197Z	

Logger protocol

Protocollo di acquisizione elenco dati

	Log no. *N. elenco dati*	AV-63001/25-XV-008

Instrument

Strumento

Electrical pressure gauge *Misuratore di pressione elettronico*	
Model *Modello*	CPG1500
Serial number *Numero di serie*	1A014ILJJIM
Log temperature *Registrazioni di Temperatura*	Active *Attivo*
Scale range *Campo scala*	(0 ... 1000) bar a
Accuracy *Accuratezza*	0.1 % FS
Tag number *Numero tag*	
Communication *Comunicazione*	Wireless (00:13:43:85:DD:8D)

Measurement conditions

Condizioni di misura

Settings *Impostazioni*	
Mode *Modalità*	Automatic *Automatico*
Interval (ms) *Intervallo (ms)*	15000
Duration (hh:mm:ss) *Durata (hh:mm:ss)*	00:12:07
Start time (hh:mm:ss) *Tempo di avvio (hh:mm:ss)*	11:48:48 pm

Logger protocol

Protocollo di acquisizione elenco dati


ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	AV-63001/25-XV-008

Measurement results

Risultati della misura

Graphical representation of progression
Rappresentazione grafica dell'andamento

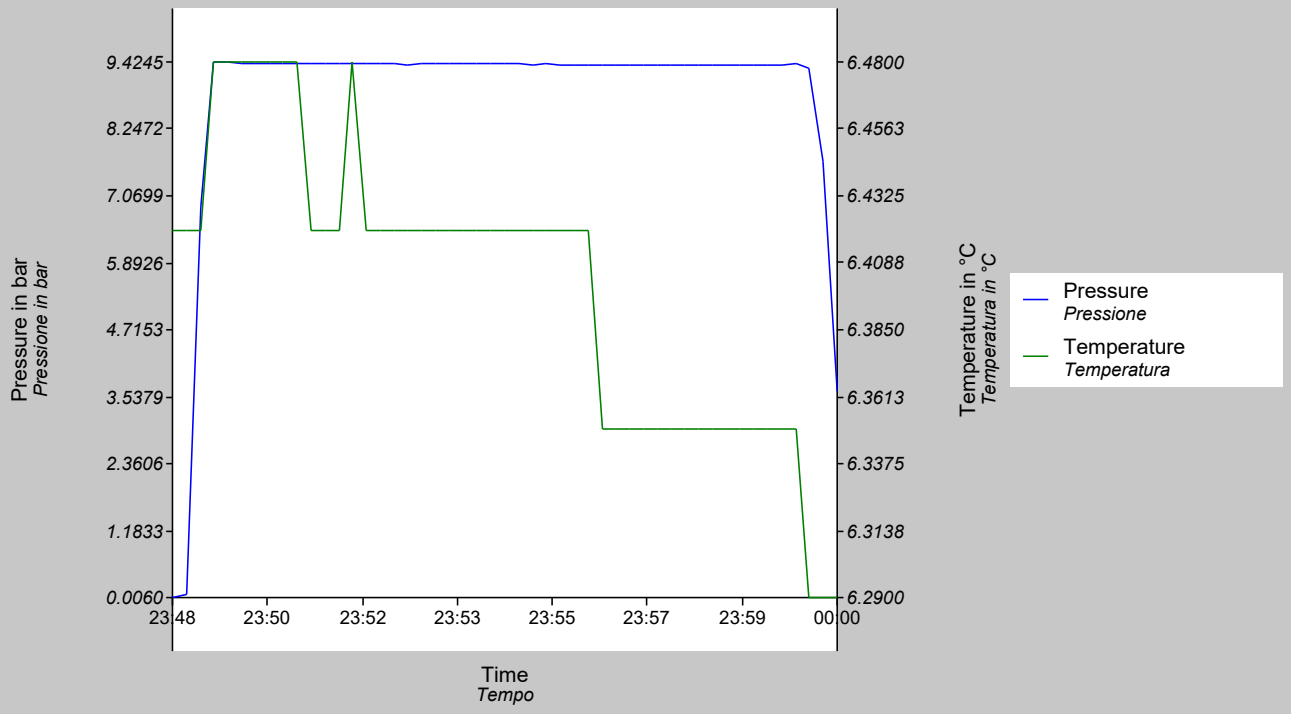

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/24/2025 23:48:48.000	0.0060	6.4200
01/24/2025 23:49:03.000	0.0586	6.4200
01/24/2025 23:49:18.000	6.8624	6.4200
01/24/2025 23:49:33.000	9.4245	6.4800
01/24/2025 23:49:48.000	9.4161	6.4800
01/24/2025 23:50:03.000	9.4006	6.4800
01/24/2025 23:50:18.000	9.4002	6.4800
01/24/2025 23:50:33.000	9.3990	6.4800
01/24/2025 23:50:48.000	9.3980	6.4800
01/24/2025 23:51:03.000	9.3966	6.4800
01/24/2025 23:51:18.000	9.3943	6.4200
01/24/2025 23:51:33.000	9.3904	6.4200
01/24/2025 23:51:48.000	9.3931	6.4200
01/24/2025 23:52:03.000	9.3955	6.4800
01/24/2025 23:52:18.000	9.3908	6.4200
01/24/2025 23:52:33.000	9.3914	6.4200
01/24/2025 23:52:48.000	9.3954	6.4200

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	AV-63001/25-XV-008

Measurement results

Risultati della misura

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/24/2025 23:53:03.000	9.3819	6.4200
01/24/2025 23:53:18.000	9.3847	6.4200
01/24/2025 23:53:33.000	9.3853	6.4200
01/24/2025 23:53:48.000	9.3860	6.4200
01/24/2025 23:54:03.000	9.3855	6.4200
01/24/2025 23:54:18.000	9.3844	6.4200
01/24/2025 23:54:33.000	9.3867	6.4200
01/24/2025 23:54:48.000	9.3841	6.4200
01/24/2025 23:55:03.000	9.3878	6.4200
01/24/2025 23:55:18.000	9.3815	6.4200
01/24/2025 23:55:33.000	9.3848	6.4200
01/24/2025 23:55:48.000	9.3803	6.4200
01/24/2025 23:56:03.000	9.3816	6.4200
01/24/2025 23:56:18.000	9.3810	6.4200
01/24/2025 23:56:33.000	9.3784	6.3500
01/24/2025 23:56:48.000	9.3807	6.3500
01/24/2025 23:57:03.000	9.3781	6.3500
01/24/2025 23:57:18.000	9.3766	6.3500
01/24/2025 23:57:33.000	9.3748	6.3500
01/24/2025 23:57:48.000	9.3800	6.3500
01/24/2025 23:58:03.000	9.3824	6.3500
01/24/2025 23:58:18.000	9.3821	6.3500
01/24/2025 23:58:33.000	9.3822	6.3500
01/24/2025 23:58:48.000	9.3825	6.3500
01/24/2025 23:59:03.000	9.3767	6.3500
01/24/2025 23:59:18.000	9.3761	6.3500
01/24/2025 23:59:33.000	9.3780	6.3500
01/24/2025 23:59:48.000	9.3716	6.3500
01/25/2025 00:00:03.000	9.3851	6.3500
01/25/2025 00:00:18.000	9.3032	6.2900
01/25/2025 00:00:33.000	7.6884	6.2900
01/25/2025 00:00:48.000	3.6455	6.2900

CROSSWIND

HOLLANDSE KUST NOORD WIND PARK Project
Contract No. CW-I-WP4-2023-05

INSTRUMENT TUBING LIST


ROSETTI MARINO


Sh. 4 of 4 REV. 00 01 02 03 04 — X X X X X


				DATA TUBING													FROM AREA					TO AREA							
POS.	REV	SUPPLY SCOPE	LAINING SCOPE	TAG Tubing	P&ID	MAIN FUNCTION	SERVICE	DESIGN TEMPERATURE(C°)	OPERATING PRESSURE (Barg)	DESIGN PRESSURE (Barg)	TEST PRESSURE (Barg)	FLUID TEST	DIMENSIONS	MATERIAL	REF. DOC.	Q.TY (m)	FIRE PROOFING	HEAT TRACING	MODULE	AREA	FROM ITEM	REF. P&I	DESCRIPTION	MODULE	AREA	TO ITEM	REF. LAYOUT	DESCRIPTION	NOTE
01	04	RM	RM	**AV-63001/25-XV-011**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-XV-011	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
02	04	RM	RM	**AV-63001/25-FV-033**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-FV-033	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
03	04	RM	RM	**AV-63001/25-XV-008**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-XV-008	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
04	04	RM	RM	**AV-63001/25-FV-032**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-FV-032	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
05	04	RM	RM	**AV-63002/25-XV-020**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-020	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
06	04	RM	RM	**AV-63002/25-FV-036**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**11**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-036	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
07	04	RM	RM	**AV-63002/25-XV-017**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-017	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
08	04	RM	RM	**AV-63002/25-FV-038**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-038	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
09	04	RM	RM	**AV-63002/25-XV-014**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-014	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
10	04	RM	RM	**AV-63002/25-FV-034**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-034	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
11	04	RM	RM	**AV-63003/25-BDV-010**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-BDV-010	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
12	04	RM	RM	**AV-63003/25-PV-040**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-PV-040	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
13	04	RM	RM	**AV-63003/25-XV-012**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-XV-012	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
14	04	RM	RM	**AV-63003/25-XV-009**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**13**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-XV-009	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
15	04	RM	RM	**AV-63004/25-BDV-013**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-BDV-013	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
16	04	RM	RM	**AV-63004/25-PV-043**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-PV-043	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
17	04	RM	RM	**AV-63004/25-XV-015**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-XV-015	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
18	04	RM	RM	**AV-63005/64-PV-031A**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Lower Deck	AV-63005	123A90-DDL-PR-PID-80041	Distribution Pot 5	BLPH	Lower Deck	64-PV-031A	123A90-DDL-IN-DL-40080	Pneumatic Control Valve	Design Pressure set as per downstream PSV
19	04	RM	RM	**AV-63005/64-PV-031B**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**3**	N.A.	N.A.	BLPH	Lower Deck	AV-63005	123A90-DDL-PR-PID-80041	Distribution Pot 5	BLPH	Lower Deck	64-PV-031B	123A90-DDL-IN-DL-40080	Pneumatic Control Valve	Design Pressure set as per downstream PSV
20	04	RM	RM	**AV-63006/25-BDV-022**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-BDV-022	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
21	04	RM	RM	**AV-63006/25-XV-021**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-XV-021	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
22	04	RM	RM	**AV-63006/25-PV-049**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-PV-049	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
23	04	RM	RM	**AV-63006/25-BDV-019**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-BDV-019	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
24	04	RM	RM	**AV-63006/80-XV-001**	123A90-DDL-PR-PID-80012	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	80-XV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
25	04	RM	RM	**AV-63007/25-XV-006**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-XV-006	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
26	04	RM	RM	**AV-63007/25-PV-035**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**11**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-PV-035	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
27	04	RM	RM	**AV-63007/25-BDV-005**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-BDV-005	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
28	04	RM	RM	**AV-63007/25-PV-037**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-PV-037	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
29	04	RM	RM	**AV-63007/25-BDV-007**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-BDV-007	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
30	04	RM	RM	**AV-63008/50-XV-001**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-001	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
31	04	RM	RM	**AV-63008/50-XV-002**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-002	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
32	04	RM	RM	**AV-63008/50-XV-003**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-003	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
33	04	RM	RM	**AV-63008/50-XV-004**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-004	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
33A	04	RM	RM	**AV-63009/50-XV-005**	123A90-DDL-PR-PID-80025	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Lower Deck	AV-63009	123A90-DDL-PR-PID-80041	Distribution Pot 9	BLPH	Lower Deck	50-XV-005	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
34	04	RM	RM	**AV-63010/25-SDV-001**	123A90-DDL-PR-PID-80013	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-SDV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
35	04	RM	RM	**AV-63010/25-XV-024**	123A90-DDL-PR-PID-80013	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-XV-024	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
36	04	RM	RM	**AV-63010/25-XV-004**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-XV-004	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
37	04	RM	RM	**AV-63010/25-FV-031**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-FV-031	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
38	04	RM	RM	**AV-63010/64-SDV-001**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**15**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	64-SDV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
39	04	RM	RM	**AV-63011/25-SDV-023**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-SDV-023	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
40	04	RM	RM	**AV-63011/25-PV-055A**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-PV-055A	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
41	04	RM	RM	**AV-63011/25-PV-055B**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-PV-055B	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
42	04	RM	RM	**AV-63012/25-XV-018**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-XV-018	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
43	04	RM	RM	**AV-63012/25-PV-046**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-PV-046	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
44	04	RM	RM	**AV-63012/25-BDV-016**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-BDV-016	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
~~45~~	03	DELETED	DELETED	~~**BLPH-MV-014/25-PT-001**~~	~~123A90-DDL-PR-PID-80013~~	~~Process Connection~~	~~Hydrogen~~	~~80~~	~~7,5 / 30~~	~~40~~	~~7,5 / 30~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-014~~	~~123A90-DDL-PR-PID-80013~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25-PT-001~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~46~~	03	DELETED	DELETED	~~**BLPH-MV-013/25-PT-002**~~	~~123A90-DDL-PR-PID-80013~~	~~Process Connection~~	~~Hydrogen~~	~~80~~	~~7,5 / 30~~	~~40~~	~~7,5 / 30~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-013~~	~~123A90-DDL-PR-PID-80013~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~26 PT 002~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~47~~	03	DELETED	DELETED	~~**BLPH-MV-026/26-PT-055A**~~	~~123A90-DDL-PR-PID-80014~~	~~Process Connection~~	~~Hydrogen~~	~~100~~	~~17,7~~	~~10~~	~~17,7~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-026~~	~~123A90-DDL-PR-PID-80014~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~26 PT 055A~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~48~~	03	DELETED	DELETED	~~**BLPH-MV-213/26-PT-055B**~~	~~123A90-DDL-PR-PID-80014~~	~~Process Connection~~	~~Hydrogen~~	~~100~~	~~3,5 / 6,5~~	~~10~~	~~3,5 / 6,5~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-213~~	~~123A90-DDL-PR-PID-80014~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~26-PT-055B~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~49~~	03	DELETED	DELETED	~~**BLPH-MV-407/43-PT-001**~~	~~123A90-DDL-PR-PID-80029~~	~~Process Connection~~	~~Hydrogen~~	~~-10 / +80~~	~~ATM~~	~~3,5~~	~~ATM~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-407~~	~~123A90-DDL-PR-PID-80029~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~43-PT-001~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~50~~	03	DELETED	DELETED	~~**BLPH-MV-411/50-PT-014**~~	~~123A90-DDL-PR-PID-80026~~	~~Process Connection~~	~~Waste Water~~	~~100~~	~~ATM~~	~~17,7~~	~~ATM~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	**0,5**	~~N.A.~~	~~YES~~	~~BLPH~~	~~Lower Deck~~	~~BLPH-MV-411~~	~~123A90-DDL-PR-PID-80026~~	~~Manual Valve~~	~~BLPH~~	~~Lower Deck~~	~~60-PT-014~~	~~123A90-DDL-IN-DL-40080~~	~~Pressure Transmitter~~	
~~51~~	03	DELETED	DELETED	~~**BLPH-MV-150/63-PT-003**~~	~~123A90-DDL-PR-PID-80027~~	~~Process Connection~~	~~Instrument Air~~	~~100~~	~~4 / 10~~	~~11~~	~~4 / 10~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-150~~	~~123A90-DDL-PR-PID-80027~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~63-PT-003~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~52~~	03	DELETED	DELETED	~~**BLPH-MV-151/63-PT-004**~~	~~123A90-DDL-PR-PID-80027~~	~~Process Connection~~	~~Instrument Air~~	~~100~~	~~4 / 10~~	~~11~~	~~4 / 10~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-151~~	~~123A90-DDL-PR-PID-80027~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~63-PT-004~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
53	04	RM	RM	**BLPH-MV-386/64-PT-031A**	123A90-DDL-PR-PID-80027	Process Connection	Nitrogen Gas	100	6	10	11	N2 / Dry Air

DRAWING NO. 123A90-DDL-IN-DL-40085

REV. 01

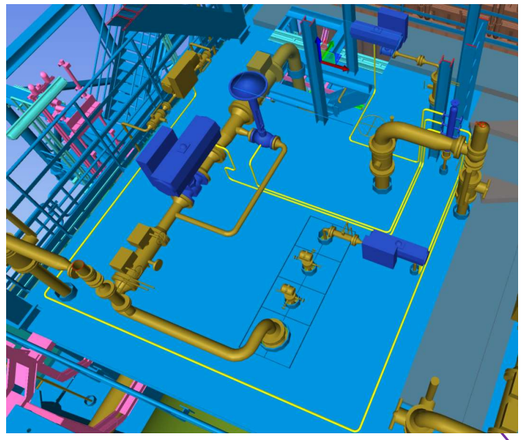

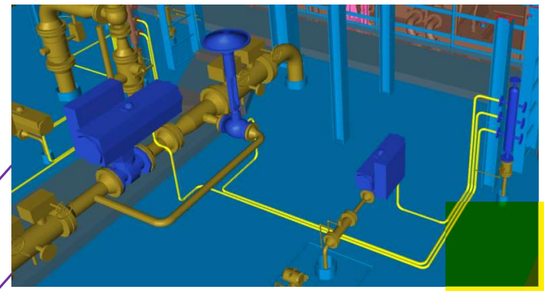

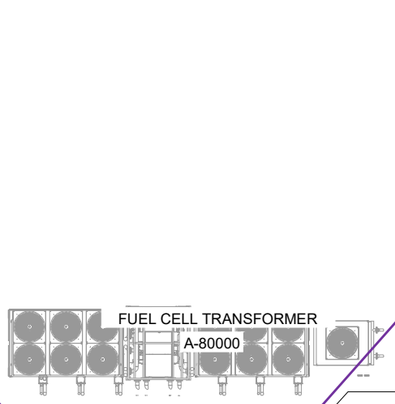

CRANE
X-99001

25-BDV-022
+34.740mm
+4.430mm T.O.S

AV-63006
+35.085mm
+4.775mm T.O.S

80-XV-001
+34.508mm
+4.198mm T.O.S

25-PV-049
+34.740mm
+4.430mm T.O.S

25-BDV-019
+34.740mm
+4.430mm T.O.S

25-XV-021
+34.479mm
+4.169mm T.O.S

25-BDV-016
+34.740mm
+4.430mm T.O.S

Q-43004
HYDROGEN VENT

V-25001A V-25001B V-25001C

HYDROGEN STORAGE VESSELS

REFER SHEET-001

AV-63010
+35.834mm
+5.524mm T.O.S

25-XV-024
+35.140mm
+4.830mm T.O.S

25-SDV-001
+35.140mm
+4.830mm T.O.S

25-XV-004
+35.245mm
+4.935mm T.O.S

25-FV-031
+35.245mm
+4.935mm T.O.S

A-20000
ELECTROLYSER

AV-63012
+35.085mm
+4.775mm T.O.S

AV-63004
+35.085mm
+4.775mm T.O.S

25-XV-015
+34.479mm
+4.169mm T.O.S

25-PV-043
+34.740mm
+4.430mm T.O.S

25-BDV-013
+34.740mm
+4.430mm T.O.S

25-XV-018
+34.508mm
+4.198mm T.O.S

25-PV-046
+34.740mm
+4.430mm T.O.S


25-XV-008
+35.245mm
+4.935mm T.O.S


AV-63001
+35.834mm
+5.524mm T.O.S

25-XV-011
+35.245mm
+4.935mm T.O.S

25-FV-033
+35.245mm
+4.935mm T.O.S

25-FV-032
+35.245mm
+4.935mm T.O.S

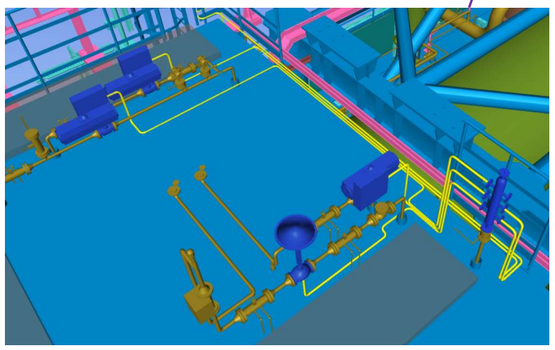

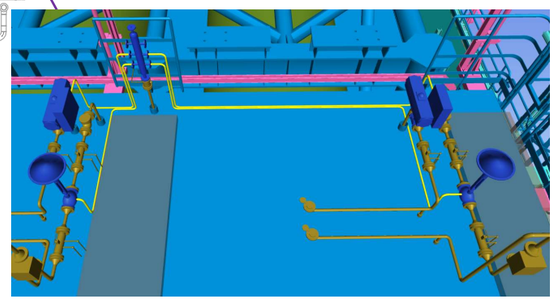


UPPER DECK


SCALE: 1:1

VIEW EL. 33740mm to 36500mm


AV-63001

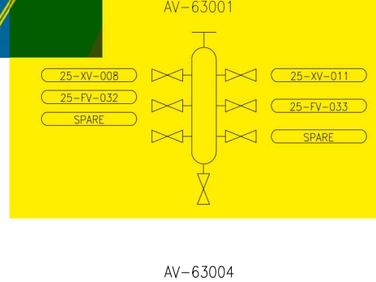


AV-63004

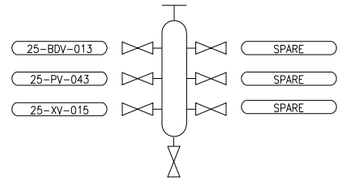


AV-63006

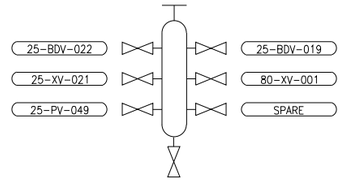


AV-63010

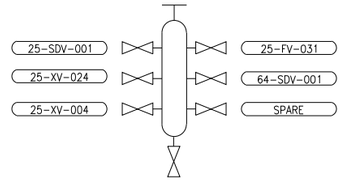

AV-63012

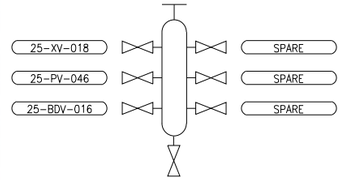

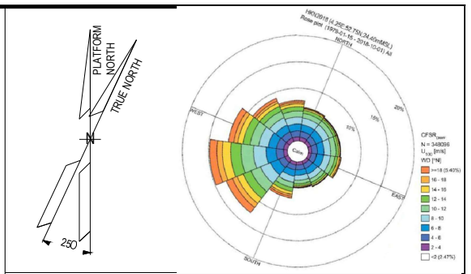

NOTES

1) TUBING ROUTING > 2m IS SHOWN AND IT IS INDICATIVE ONLY.
TUBING ROUTING SHALL BE FINALIZED DURING CONSTRUCTION ACTIVITIES.

LEGEND

- AIR DISTRIBUTION POT
- CONTROL VALVE
- ON-OFF VALVE
- TUBING
- TUBING GOING UP
- TUBING GOING DOWN

HOLDS

REFERENCE DOCUMENTS

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	23/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/02/24	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND | ROSETTI MARINO

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40085**

REV.:	DATE:	SIGNATURE:
1_C	12/12/24	C.Pilato

ROSETTI MARINO SpA

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT TUBING LAYOUT
ELEVATION 30.310 m

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:100
DRAWN DRAWN_BY	CHECKED CHECKED_BY	APPROVED APPROVED_BY	DATE DD/MM/YY

A1	DRAWING NO. 123A90-DDL-IN-DL-40085	SHEET 002	REV. 01

File Name : 12390-DDL-IN-DL-40085_Rev.01


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 B

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

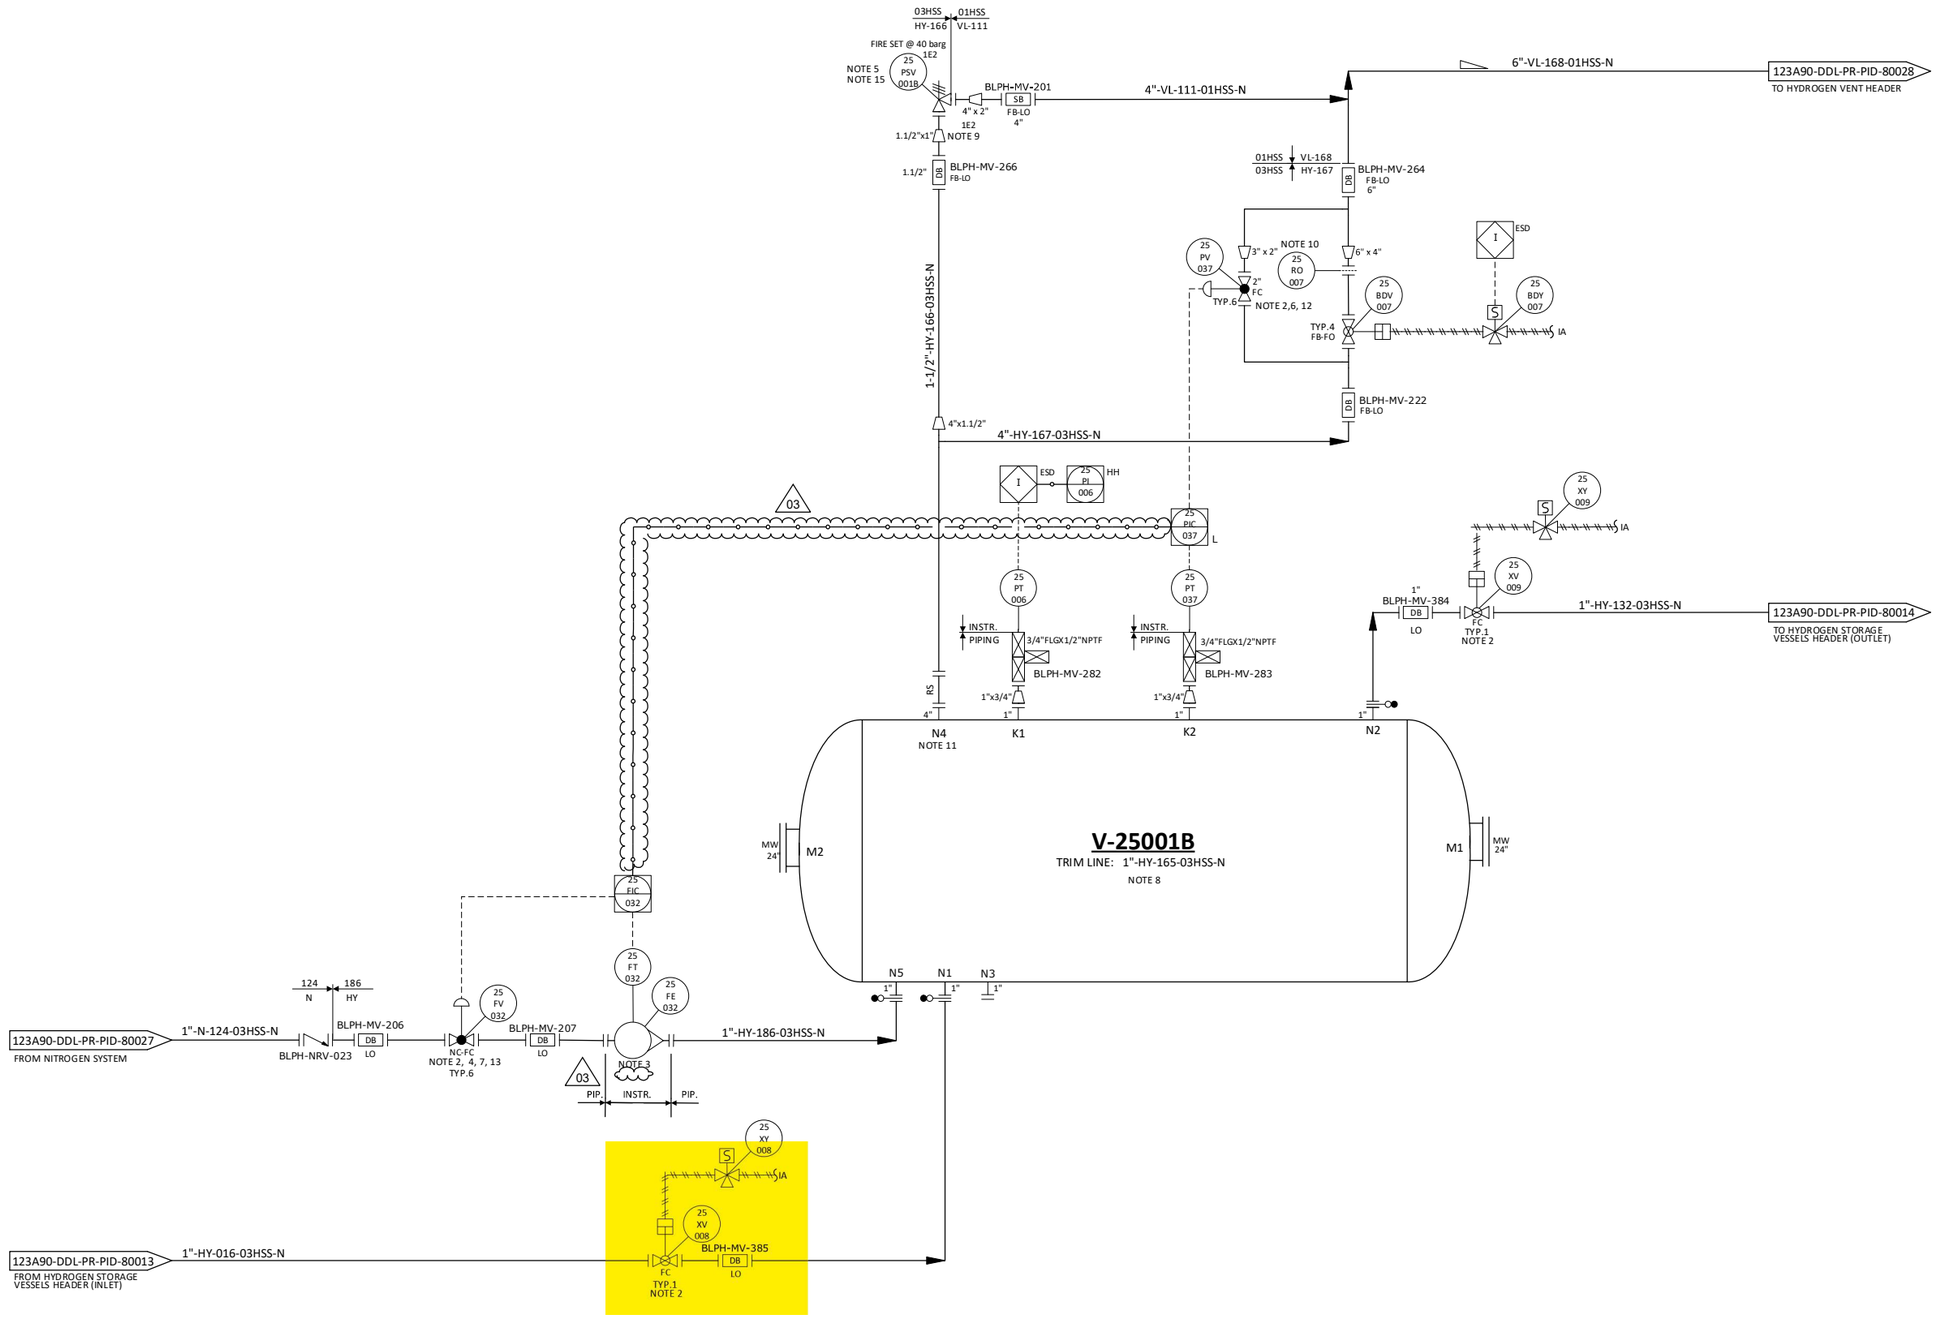

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS. 03
4. NITROGEN CONTROL VALVE (25-FV-032) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE.
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-037 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC."PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-037 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-032 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-037 HAS FAILED TO CLOSE.
15. 25-PSV-001B SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL B

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO. 123A90-DDL-PR-PID-80016	SHEET 001	REV. 03

File Name : FILE_NAME


CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Pneumatic Hook-Ups	Sh. 6 of 6 Date: 08/07/2024 Rev. 01

PNEUMATIC HOOK-UP FOR ON-OFF VALVES

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40078**

REV.:	DATE:	SIGNATURE:
1_B	06/11/24	G.Randi

ROSETTI MARINO SpA



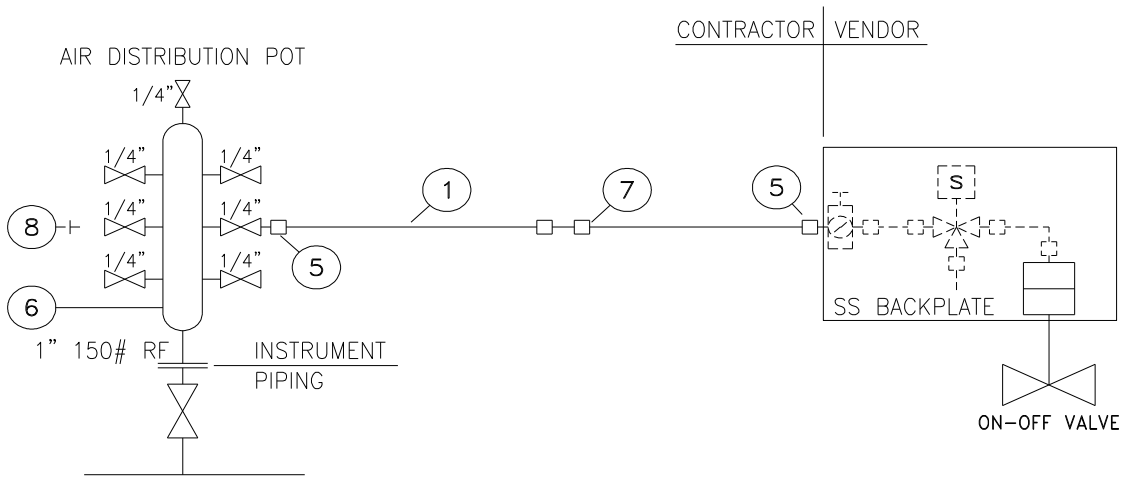


INSTRUMENT TAG	
1	25-BDV-022
2	25-BDV-005
3	25-BDV-007
4	25-BDV-010
5	25-BDV-013
6	25-BDV-016
7	25-BDV-019
8	25-SDV-001
9	25-SDV-023
10	25-XV-004
11	25-XV-006
12	25-XV-008
13	25-XV-009
14	25-XV-011
15	25-XV-012
16	25-XV-014
17	25-XV-015
18	25-XV-017
19	25-XV-018
20	25-XV-020
21	25-XV-021
22	25-XV-024
23	50-XV-001
24	50-XV-002
25	50-XV-003
26	50-XV-004
27	80-XV-001
28	64-SDV-001
29	50-XV-005
30	

NOTE:
(1) For Air Distribution Pot quantities see material take-off on sh. 4

POS.	NORM/STD CODE	DESCRIPTION	SIZE/CONNECTION TYPE	Q.TY
8		SS316 PLUG	1/4" NPT	Note 1
7		SS316 UNION	1/2" O.D. x 1/2" O.D.	N. 1
6		SS316 AIR DISTRIBUTION POT	1" 150#RF - N. 7 1/4" BALL VALVES	Note 1
5		SS316 MALE CONNECTOR	1/4" NPT x 1/2" O.D.	N. 2
1		SS 316L TUBING	1/2" x 0,049"Thk	10 m

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

POS	PICTURE	DESCRIPTION		ITEM ID CODE	TOTAL					
		COMPRESSION FITTING TYPE: **DOUBLE FERRULE** THREADING: ASME B1.20.1 NPT MATERIAL: AISI 316 WORKING PRESSURE AS PER ASME B31.1 TUBING TYPE: ■ INCHES ☐ METRIC			UNIT	Counted	Required			
							Rev. 00	Rev. 01	Rev.	Rev.
1		STRAIGHT MALE CONNECTOR	1/2" NPT-M x 3/8" O.D.		nr.					
2			1/4" NPT-M x 1/2" O.D.		nr.	102	102	102		
3			1/2" NPT-M x 1/2" O.D.		nr.	36	36	-		
4			1/2" NPT-M x 3/4" O.D.		nr.					
5			3/4" NPT-M x 3/4" O.D.		nr.					
6			3/8" NPT-M x 3/8" O.D.		nr.					
7		STRAIGHT FEMALE CONNECTOR	1/2" NPT-F x 3/8" O.D.		nr.					
8			1/4" NPT-F x 1/2" O.D.		nr.					
9			1/2" NPT-F x 1/2" O.D.		nr.					
10			1/2" NPT-F x 3/4" O.D.		nr.					
11		UNION CONNECTOR	1/4" O.D. x 1/4" O.D.		nr.					
12			3/8" O.D. x 3/8" O.D.		nr.					
13			1/2" O.D. x 1/2" O.D.		nr.	49	49	49		
14			3/4" O.D. x 3/4" O.D.		nr.					
15		ELBOW CONNECTOR	1/4" NPT-M x 1/2" O.D.		nr.	27	27	27		
16			1/2" NPT-M x 1/2" O.D.		nr.					
17										
18										
19										
20										
21										
22										
23										
24										
25										
26										
27										
28										
29										
30										
27										
28										
29										
30										
31										
32										
33										
34										

VENDOR / ORDER : **AF SYSTEM / 1724001332**

MATERIAL :

- ☐ ASTM A106 Gr.B
- ■ AISI 316 L
- ☐ UNS S31254

SPECIAL REQUIREMENTS :

- ☐ ...

REMARKS :

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CERTIFICATO DI TARATURA LAT 114 0435-SM-24
Certificate of Calibration

- data di emissione date of issue	2024-09-20
- cliente customer	FAST AUTOMATION SRL VIA DELLA PREVIDENZA SOCIALE, 8 IT-42124 REGGIO EMILIA (RE)
- destinatario receiver	ROSETTI MARINO SPA - YARD PIOMBONI VIA DEL MARCHESATO, 37 IT-48122 MARINA DI RAVENNA (RA)

Si riferisce a
referring to

- oggetto *item*	Misuratore di pressione elettronico Electrical pressure gauge
- costruttore *manufacturer*	WIKA
- modello *model*	CPG1500
- matricola *serial number*	1A014ILJJIM
- data di ricev. oggetto *date of receipt of item*	2024-09-17
- data delle misure *date of measurements*	2024-09-20
- registro di laboratorio *laboratory reference*	0435-SM-24

Il presente certificato di taratura è emesso in base all'accreditamento LAT N. 114 rilasciato in accordo ai decreti attuativi della legge n. 273/1991 che ha istituito il Sistema Nazionale di Taratura (SNT). ACCREDIA attesta le capacità di misura e di taratura, le competenze metrologiche del Centro e la riferibilità delle tarature eseguite ai campioni nazionali ed internazionali delle unità del Sistema Internazionale delle Unità (SI).
Questo certificato non può essere riprodotto in modo parziale, salvo espressa autorizzazione scritta da parte del Centro.

This certificate of calibration is issued in compliance with the accreditation LAT No.114 granted according to decrees connected with Italian law No. 273/1991 which has established the National Calibration System. ACCREDIA attests the calibration and measurement capability, metrological competence of the Centre and the traceability of calibration results to the national and International standards of the International System of Units (SI).
This certificate may not be partially reproduced, except with the prior written permission of the issuing Centre.

I risultati di misura riportati nel presente Certificato sono stati ottenuti applicando le procedure di taratura citate alla pagina seguente, dove sono specificati anche i campioni o gli strumenti che garantiscono la catena di riferibilità del Centro e i rispettivi certificati di taratura in corso di validità. Essi si riferiscono esclusivamente all'oggetto in taratura e sono validi nel momento e nelle condizioni di taratura, salvo diversamente specificato.

The measurement results reported in this Certificate were obtained following the calibration procedures given in the following page, where the reference standards or instruments are indicated which guarantee the traceability chain of the laboratory, and the related calibration certificates in the course of validity are indicated as well. They relate only to the calibrated item and they are valid for the time and conditions of calibration, unless otherwise specified.

Le incertezze di misura dichiarate in questo documento sono state determinate conformemente alla Guida ISO/IEC 98 e al documento EA-4/02. Solitamente sono espresse come incertezza estesa ottenuta moltiplicando l'incertezza tipo per il fattore di copertura *k* corrispondente ad un livello di fiducia di circa il 95 %. Normalmente tale fattore *k* vale 2.

The measurement uncertainties stated in this document have been determined according to the ISO/IEC Guide 98 and to EA-4/02. Usually, they have been estimated as expanded uncertainty obtained multiplying the standard uncertainty by the coverage factor k corresponding to a confidence level of about 95%. Normally, this factor k is 2.

Direzione Tecnica
(Approving Officer)

Enrico Reccagni

Enrico Reccagni

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CARATTERISTICHE DELLO STRUMENTO IN TARATURA/ Properties of devices under calibration

Misuratore di pressione elettronico ***Electrical pressure gauge***	
Tipo *Model*	Misuratore di pressione elettronico Electrical pressure gauge
Numero di matricola *Serial No.*	1A014ILJJIM
Campo di misura *Scale range*	(0 ... 1000) bar g
Accuratezza dichiarata dal costruttore *Accuracy declared by the manufacturer*	0,1 % FS
Risoluzione *Resolution (scale division)*	0,1 bar
Tag. N. *Tag No.*	--

Procedura di taratura e catena di riferibilità
Calibration procedure and traceability chain

La taratura è stata effettuata in accordo alla linea guida DKD-R 6-1 "Taratura di strumenti di pressione" (versione 03/2014) procedura B, per confronto fra i valori dello strumento in taratura con quelli di riferimento dati dal campione di lavoro.

Calibration was carried out according to DKD-R 6-1 "Kalibrierung von Druckmessgeräten" (Ausgabe 03/2014) procedure B, by comparing the measured values of the calibration item with those of the reference or working standard.

I risultati riportati sono stati ottenuti applicando le procedure n° LMO-PT-01 rev.2

The results have been obtained using the procedures n° LMO-PT-01 rev.2

La catena di riferibilità ha inizio dai campioni di riferimento n° PM1-09

The traceability chain starts from the reference standards n° PM1-09

muniti di certificati validi di taratura, rispettivamente n° D21090

with the relevant valid calibration certificates n° D21090

Luogo di taratura
Place of calibration

Laboratorio WIKA ITALIA - Laboratorio di Modugno (BA)
WIKA ITALY Laboratory - Modugno (BA)

Campione di lavoro
Working Standard

Norma di riferimento (RS) Bilancia di pressione ***Reference standard (RS) Dead-weight tester***	
Tipo *Model*	PM1-09
Certificato di taratura *Calibration mark*	D-K-15105/D21090
Campo di misura *Scale range*	(10 ... 2500) bar g
Accuratezza *Accuracy*	0,015 % della lettura + 255 Pa

Operatore
Technichian

Francesco Donatelli

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Condizioni di misura
Measurement conditions

Schema di collegamento *Assembly*	
Fluido utilizzato *Pressure medium*	Sebacate *Sebacate*
Livello di riferimento *Refence height (for reference value)*	Superficie di tenuta DUT *Sealing face DUT*
Posizione di montaggio *Position during calibration*	verticale *vertical*

Note di taratura
Calibration Note

Lo strumento è stato tarato e riconsegnato nelle stesse condizioni in cui è arrivato nel laboratorio, in accordo con il metodo "as found as left" / The device under test (DUT) was calibrated in the same conditions it was arrived in laboratory, according to the method "as found as left".

Condizioni Ambientali
Environmental conditions

Temperatura *Temperature*	(22 ± 1,5)	°C
Pressione atmoferica *Atmospheric pressure*	(1009,3 ± 0,2)	hPa
Umidità relativa *Rel. Humidity*	(50 ± 15)	% UR

I dati meteo sono stati acquisiti tramite stazione meteo WIKA CPU6000-W s/n.1A00VCX6GJ2

Weather data were acquired via the WIKA CPU6000-W weather station s/n.1A00VCX6GJ2

Misure rilevate
Measurement results

Valore di riferimento *Reference value RS* bar	**Letture** *Reading DUT* bar		
	M1	**M2**	**M3**
0,00	0,0	0,0	0,0
99,91	99,9	99,9	99,9
199,82	199,9	199,9	199,9
299,73	299,8	299,8	299,8
399,63	399,7	399,7	399,7
499,53	499,5	499,6	499,6
599,44	599,4	599,4	599,4
699,34	699,3	699,3	699,3
799,25	799,1	799,2	799,1
899,14	899,0	899,1	899,0
999,04	999,0	999,0	999,0

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it


Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Incertezza di misura
Uncertainty of measurement

Valori di riferimento *Reference value RS* bar	Media delle misure *Mean value* bar	Errore *Error* bar	Ripetibilità *Repeatability* bar	Isteresi *Hysteresis* bar	Incertezza di misura *Meas. Uncertainty* bar
0,00	0,0	0,0	0,0	0,0	0,40
99,91	99,9	0,0	0,0	0,0	0,40
199,82	199,9	0,1	0,0	0,0	0,40
299,73	299,8	0,1	0,0	0,0	0,40
399,63	399,7	0,1	0,0	0,0	0,40
499,53	499,6	0,1	0,1	0,1	0,40
599,44	599,4	0,0	0,0	0,0	0,40
699,34	699,3	0,0	0,0	0,0	0,40
799,25	799,2	0,0	0,0	0,1	0,40
899,14	899,1	0,0	0,0	0,1	0,40
999,04	999,0	0,0	0,0	0,0	0,40

Grafico degli errori di misura
Graphical representation of measurement uncertainty

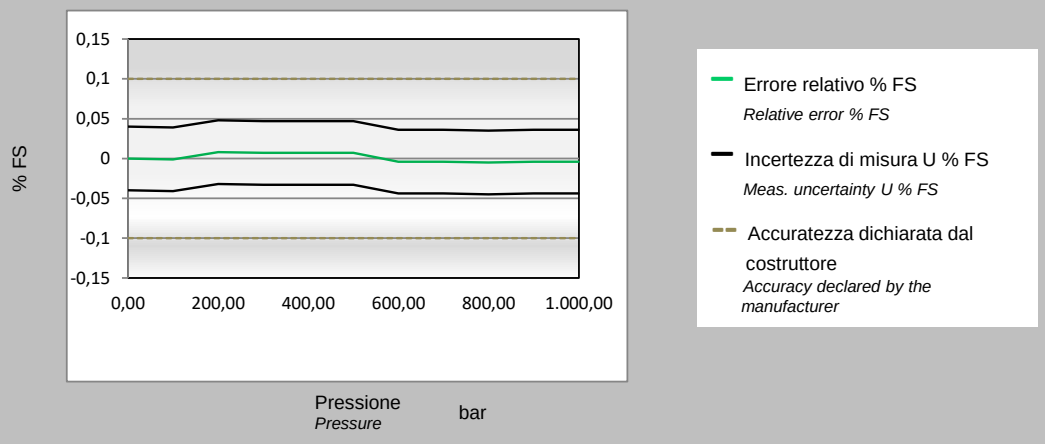

L'incertezza estesa senza correzione del DUT è pari a 0,5 bar
The expanded uncertainty of the DUT without correction is equal to

Questo dato è ottenuto come MAX{Incertezza_di_misura$_i$ + |Errore$_i$|} della tabella precedente
This data is obatined as MAX{Meas._uncertainty$_i$ + |Error$_i$|} of the previous table

Il presente certificato non rappresenta una dichiarazione di conformità a specifica
This certificate is not a statement of compliance

ITEM	Tag	AV-63002/25-XV-020	: Pneumatic Connection Air Supply - 25-XV-020			Dwg	123A90-DDL-IN-LIS-40092
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001944		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX06 Tubing Hydraulic

General

1	Drawings (P&ID tube) attached.	OK
2	Isometric drawings (P&ID pipe) attached.	NA
3	Check drawings at last revision.	OK
4	Material certificates for pipe/tube/fittings/flanges/hose and support clamps checked	OK
5	Welders certificates checked	NA
6	Certificate and mark-up drawings for welding WPS and WPQR and material certificates checked	NA
7	Certificates and mark-up drawings for NDT report checked	NA

Check before Flushing and/or Testing

8	Installation complete and in compliance with drawings and specifications.	OK
9	Tubing/Piping tray checked.	NA
10	Hose according to specifications and tightened	NA
11	Flanges - nuts and bolts tightened.	NA
12	Fittings are mounted and tightened.	OK
13	Pipe supports completed and installed as required.	OK
14	Cable ladders, trays, sharp edges protected, cut ends sealed.	NA
15	Maintenance evaluation.	OK

REFER TO FINAL SHEET FOR ACCEPTANCE

ITEM	Tag	AV-63002/25-XV-020	: Pneumatic Connection Air Supply - 25-XV-020			Dwg	123A90-DDL-IN-LIS-40092
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001944		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX06 Tubing Hydraulic

Flushing / Pressure testing

16	Drawings of flushing loops (P&ID tube) attached	NA
17	Equipment & valves bypassed and blinded	OK
18	Calibration certificates attached	OK
19	Type of flushing medium correct	NA
20	Printout from recorder/particle counter	NA
21	Printout from pressure indicator	OK

Final Check

22	Final inspection of pipework.	OK
23	Preservation of tested pipework.	NA
24	System/equipment labelled with: "Hot Oil flushing performed".	NA
25	If required produce Red Line Mark Up for "AS BUILT"	

TEST SPECIFIED USED

TEST FLUID: IA TEST PRESSURE BAR G: 7.4 TEST DURATION : 12 MIN

TEST EQUIPMENT: CPG 1500 SERIAL N°: 1A014ILJJIM

HOOK UP DIAGRAM Number: 123A90-DDL-IN-HD-40078

Line FROM	Line TO	Tubing cleaned			Tubing flushed			Diam ID/OD
		Yes	No	N/A	Yes	No	N/A	
AV-63002	25-XV-020	●					●	1/2" OD x Thk. 0,049"

TESTED LABEL AFFIXED DATA SHEET ATTACHED

Comments:

	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Paolo Schintu	
Date	2025-01-25	2025-02-04	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-25T13:57:51.006Z	PROVERLIS Digitaly signed by Paolo Schintu 2025-02-04T11:40:08.732Z	

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	AV-63002/25-XV-020

Instrument

Strumento

Electrical pressure gauge *Misuratore di pressione elettronico*	
Model *Modello*	CPG1500
Serial number *Numero di serie*	1A014ILJJIM
Log temperature *Registrazioni di Temperatura*	Active *Attivo*
Scale range *Campo scala*	(0 ... 1000) bar a
Accuracy *Accuratezza*	0.1 % FS
Tag number *Numero tag*	
Communication *Comunicazione*	Wireless (00:13:43:85:DD:8D)

Measurement conditions

Condizioni di misura

Settings *Impostazioni*	
Mode *Modalità*	Automatic *Automatico*
Interval (ms) *Intervallo (ms)*	15000
Duration (hh:mm:ss) *Durata (hh:mm:ss)*	00:12:44
Start time (hh:mm:ss) *Tempo di avvio (hh:mm:ss)*	04:42:17 pm

Logger protocol

Protocollo di acquisizione elenco dati


ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	AV-63002/25-XV-020

Measurement results

Risultati della misura

Graphical representation of progression
Rappresentazione grafica dell'andamento

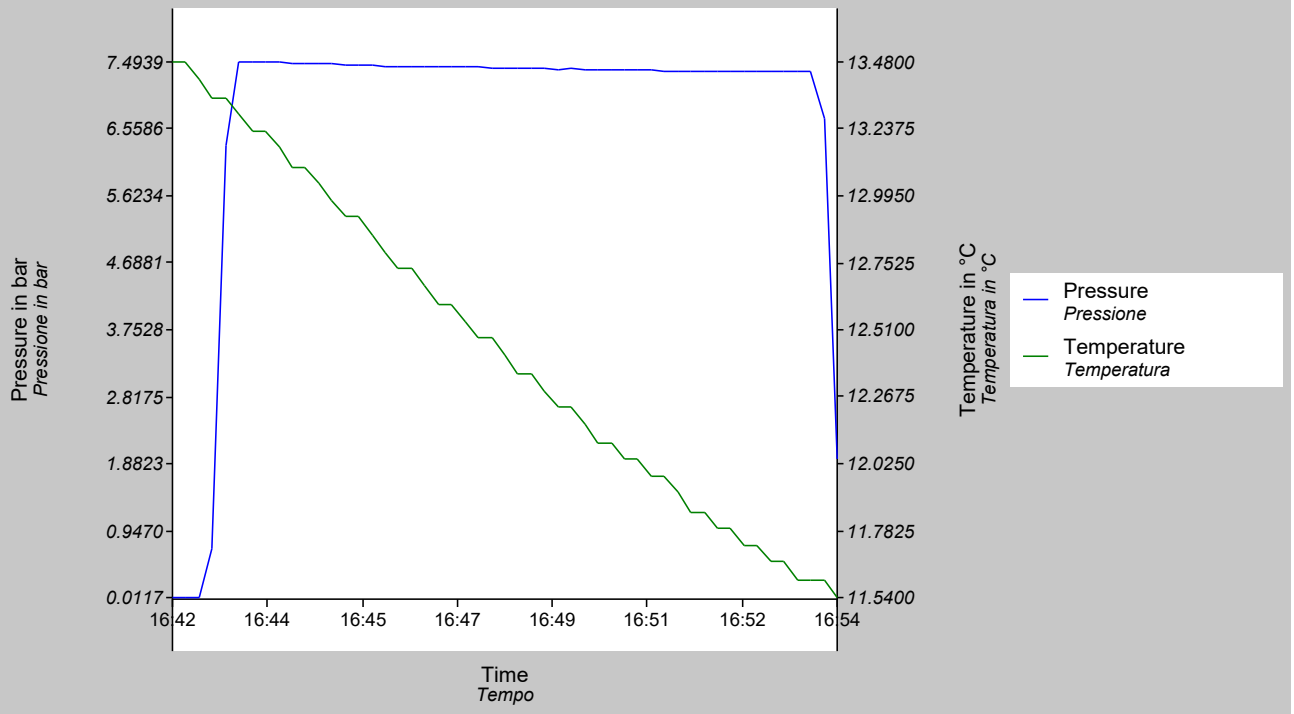

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/31/2025 16:42:17.000	0.0117	13.4800
01/31/2025 16:42:32.000	0.0166	13.4800
01/31/2025 16:42:47.000	0.0149	13.4200
01/31/2025 16:43:02.000	0.6832	13.3500
01/31/2025 16:43:17.000	6.3242	13.3500
01/31/2025 16:43:32.000	7.4883	13.2900
01/31/2025 16:43:47.000	7.4939	13.2300
01/31/2025 16:44:02.000	7.4839	13.2300
01/31/2025 16:44:17.000	7.4842	13.1700
01/31/2025 16:44:32.000	7.4761	13.1000
01/31/2025 16:44:47.000	7.4667	13.1000
01/31/2025 16:45:02.000	7.4671	13.0400
01/31/2025 16:45:17.000	7.4613	12.9800
01/31/2025 16:45:32.000	7.4587	12.9200
01/31/2025 16:45:47.000	7.4497	12.9200
01/31/2025 16:46:02.000	7.4468	12.8500
01/31/2025 16:46:17.000	7.4370	12.7900

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	AV-63002/25-XV-020

Measurement results

Risultati della misura

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/31/2025 16:46:32.000	7.4356	12.7300
01/31/2025 16:46:47.000	7.4341	12.7300
01/31/2025 16:47:02.000	7.4299	12.6700
01/31/2025 16:47:17.000	7.4258	12.6000
01/31/2025 16:47:32.000	7.4191	12.6000
01/31/2025 16:47:47.000	7.4170	12.5400
01/31/2025 16:48:02.000	7.4183	12.4800
01/31/2025 16:48:17.000	7.4117	12.4800
01/31/2025 16:48:32.000	7.4164	12.4200
01/31/2025 16:48:47.000	7.4103	12.3500
01/31/2025 16:49:02.000	7.4020	12.3500
01/31/2025 16:49:17.000	7.4016	12.2900
01/31/2025 16:49:32.000	7.3943	12.2300
01/31/2025 16:49:47.000	7.3963	12.2300
01/31/2025 16:50:02.000	7.3885	12.1700
01/31/2025 16:50:17.000	7.3821	12.1000
01/31/2025 16:50:32.000	7.3886	12.1000
01/31/2025 16:50:47.000	7.3832	12.0400
01/31/2025 16:51:02.000	7.3855	12.0400
01/31/2025 16:51:17.000	7.3764	11.9800
01/31/2025 16:51:32.000	7.3717	11.9800
01/31/2025 16:51:47.000	7.3714	11.9200
01/31/2025 16:52:02.000	7.3684	11.8500
01/31/2025 16:52:17.000	7.3613	11.8500
01/31/2025 16:52:32.000	7.3545	11.7900
01/31/2025 16:52:47.000	7.3614	11.7900
01/31/2025 16:53:02.000	7.3569	11.7300
01/31/2025 16:53:17.000	7.3594	11.7300
01/31/2025 16:53:32.000	7.3554	11.6700
01/31/2025 16:53:47.000	7.3574	11.6700
01/31/2025 16:54:02.000	7.3604	11.6000
01/31/2025 16:54:17.000	7.3614	11.6000
01/31/2025 16:54:32.000	6.7070	11.6000
01/31/2025 16:54:47.000	1.9403	11.5400

CROSSWIND

HOLLANDSE KUST NOORD WIND PARK Project
Contract No. CW-I-WP4-2023-05

INSTRUMENT TUBING LIST


ROSETTI MARINO


Sh. 4 of 4 REV. 00 01 02 03 04 — X X X X X


					DATA TUBING											FROM AREA					TO AREA							
POS.	REV	SUPPLY SCOPE	LAINING SCOPE	TAG Tubing	P&ID	MAIN FUNCTION	SERVICE	DESIGN TEMPERATURE(C°)	OPERATING PRESSURE (Barg)	DESIGN PRESSURE (Barg)	TEST PRESSURE (Barg)	FLUID TEST	DIMENSIONS	MATERIAL	REF. DOC.	Q.TY (m)	FIRE PROOFING	HEAT TRACING	MODULE	AREA	FROM ITEM	REF. P&I	DESCRIPTION	MODULE	AREA	TO ITEM	REF. LAYOUT	DESCRIPTION	NOTE
01	04	RM	RM	**AV-63001/25-XV-011**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-XV-011	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
02	04	RM	RM	**AV-63001/25-FV-033**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-FV-033	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
03	04	RM	RM	**AV-63001/25-XV-008**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-XV-008	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
04	04	RM	RM	**AV-63001/25-FV-032**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-FV-032	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
05	04	RM	RM	**AV-63002/25-XV-020**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-020	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
06	04	RM	RM	**AV-63002/25-FV-036**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**11**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-036	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
07	04	RM	RM	**AV-63002/25-XV-017**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-017	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
08	04	RM	RM	**AV-63002/25-FV-038**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-038	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
09	04	RM	RM	**AV-63002/25-XV-014**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-014	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
10	04	RM	RM	**AV-63002/25-FV-034**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-034	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
11	04	RM	RM	**AV-63003/25-BDV-010**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-BDV-010	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
12	04	RM	RM	**AV-63003/25-PV-040**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-PV-040	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
13	04	RM	RM	**AV-63003/25-XV-012**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-XV-012	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
14	04	RM	RM	**AV-63003/25-XV-009**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**13**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-XV-009	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
15	04	RM	RM	**AV-63004/25-BDV-013**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-BDV-013	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
16	04	RM	RM	**AV-63004/25-PV-043**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-PV-043	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
17	04	RM	RM	**AV-63004/25-XV-015**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-XV-015	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
18	04	RM	RM	**AV-63005/64-PV-031A**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Lower Deck	AV-63005	123A90-DDL-PR-PID-80041	Distribution Pot 5	BLPH	Lower Deck	64-PV-031A	123A90-DDL-IN-DL-40080	Pneumatic Control Valve	Design Pressure set as per downstream PSV
19	04	RM	RM	**AV-63005/64-PV-031B**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**3**	N.A.	N.A.	BLPH	Lower Deck	AV-63005	123A90-DDL-PR-PID-80041	Distribution Pot 5	BLPH	Lower Deck	64-PV-031B	123A90-DDL-IN-DL-40080	Pneumatic Control Valve	Design Pressure set as per downstream PSV
20	04	RM	RM	**AV-63006/25-BDV-022**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-BDV-022	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
21	04	RM	RM	**AV-63006/25-XV-021**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-XV-021	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
22	04	RM	RM	**AV-63006/25-PV-049**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-PV-049	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
23	04	RM	RM	**AV-63006/25-BDV-019**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-BDV-019	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
24	04	RM	RM	**AV-63006/80-XV-001**	123A90-DDL-PR-PID-80012	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	80-XV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
25	04	RM	RM	**AV-63007/25-XV-006**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-XV-006	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
26	04	RM	RM	**AV-63007/25-PV-035**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**11**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-PV-035	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
27	04	RM	RM	**AV-63007/25-BDV-005**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-BDV-005	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
28	04	RM	RM	**AV-63007/25-PV-037**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-PV-037	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
29	04	RM	RM	**AV-63007/25-BDV-007**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-BDV-007	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
30	04	RM	RM	**AV-63008/50-XV-001**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-001	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
31	04	RM	RM	**AV-63008/50-XV-002**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-002	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
32	04	RM	RM	**AV-63008/50-XV-003**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-003	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
33	04	RM	RM	**AV-63008/50-XV-004**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-004	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
33A	04	RM	RM	**AV-63009/50-XV-005**	123A90-DDL-PR-PID-80025	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Lower Deck	AV-63009	123A90-DDL-PR-PID-80041	Distribution Pot 9	BLPH	Lower Deck	50-XV-005	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
34	04	RM	RM	**AV-63010/25-SDV-001**	123A90-DDL-PR-PID-80013	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-SDV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
35	04	RM	RM	**AV-63010/25-XV-024**	123A90-DDL-PR-PID-80013	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-XV-024	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
36	04	RM	RM	**AV-63010/25-XV-004**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-XV-004	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
37	04	RM	RM	**AV-63010/25-FV-031**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-FV-031	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
38	04	RM	RM	**AV-63010/64-SDV-001**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**15**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	64-SDV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
39	04	RM	RM	**AV-63011/25-SDV-023**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-SDV-023	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
40	04	RM	RM	**AV-63011/25-PV-055A**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-PV-055A	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
41	04	RM	RM	**AV-63011/25-PV-055B**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-PV-055B	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
42	04	RM	RM	**AV-63012/25-XV-018**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-XV-018	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
43	04	RM	RM	**AV-63012/25-PV-046**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-PV-046	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
44	04	RM	RM	**AV-63012/25-BDV-016**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-BDV-016	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
~~45~~	03	DELETED	DELETED	~~**BLPH-MV-014/26-PT-001**~~	~~123A90-DDL-PR-PID-80013~~	~~Process Connection~~	~~Hydrogen~~	~~80~~	~~7,5 / 30~~	~~40~~	~~7,5 / 30~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-014~~	~~123A90-DDL-PR-PID-80013~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25-PT-001~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~46~~	03	DELETED	DELETED	~~**BLPH-MV-013/25-PT-002**~~	~~123A90-DDL-PR-PID-80013~~	~~Process Connection~~	~~Hydrogen~~	~~80~~	~~7,5 / 30~~	~~40~~	~~7,5 / 30~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-013~~	~~123A90-DDL-PR-PID-80013~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25-PT-002~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~47~~	03	DELETED	DELETED	~~**BLPH-MV-025/26-PT-055A**~~	~~123A90-DDL-PR-PID-80014~~	~~Process Connection~~	~~Hydrogen~~	~~100~~	~~17,7~~	~~10~~	~~17,7~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-025~~	~~123A90-DDL-PR-PID-80014~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~26-PT-055A~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~48~~	03	DELETED	DELETED	~~**BLPH-MV-213/26-PT-055B**~~	~~123A90-DDL-PR-PID-80014~~	~~Process Connection~~	~~Hydrogen~~	~~100~~	~~3,5 / 6,5~~	~~10~~	~~3,5 / 6,5~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-213~~	~~123A90-DDL-PR-PID-80014~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25-PT-055B~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~49~~	03	DELETED	DELETED	~~**BLPH-MV-407/43-PT-001**~~	~~123A90-DDL-PR-PID-80029~~	~~Process Connection~~	~~Hydrogen~~	~~-10 / +80~~	~~ATM~~	~~3,5~~	~~ATM~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-407~~	~~123A90-DDL-PR-PID-80029~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~43-PT-001~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~50~~	03	DELETED	DELETED	~~**BLPH-MV-411/50-PT-014**~~	~~123A90-DDL-PR-PID-80026~~	~~Process Connection~~	~~Waste Water~~	~~100~~	~~ATM~~	~~17,7~~	~~ATM~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~YES~~	~~BLPH~~	~~Lower Deck~~	~~BLPH-MV-411~~	~~123A90-DDL-PR-PID-80026~~	~~Manual Valve~~	~~BLPH~~	~~Lower Deck~~	~~60-PT-014~~	~~123A90-DDL-IN-DL-40080~~	~~Pressure Transmitter~~	
~~51~~	03	DELETED	DELETED	~~**BLPH-MV-150/63-PT-003**~~	~~123A90-DDL-PR-PID-80027~~	~~Process Connection~~	~~Instrument Air~~	~~100~~	~~4 / 10~~	~~11~~	~~4 / 10~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-150~~	~~123A90-DDL-PR-PID-80027~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~63-PT-003~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~52~~	03	DELETED	DELETED	~~**BLPH-MV-151/63-PT-004**~~	~~123A90-DDL-PR-PID-80027~~	~~Process Connection~~	~~Instrument Air~~	~~100~~	~~4 / 10~~	~~11~~	~~4 / 10~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-151~~	~~123A90-DDL-PR-PID-80027~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~63-PT-004~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
53	04	RM	RM	**BLPH-MV-386/64-PT-031A**	123A90-DDL-PR-PID-80027	Process Connection	Nitrogen Gas	100	6	10	11	N2 / Dry


DRAWING NO. 12390-DDL-IN-DL-40085

REV. 01

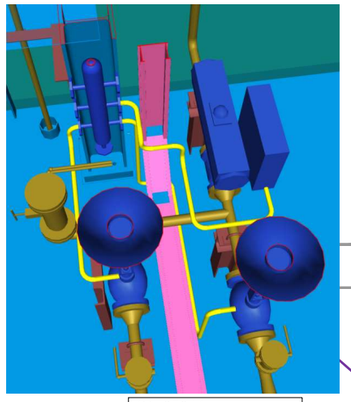

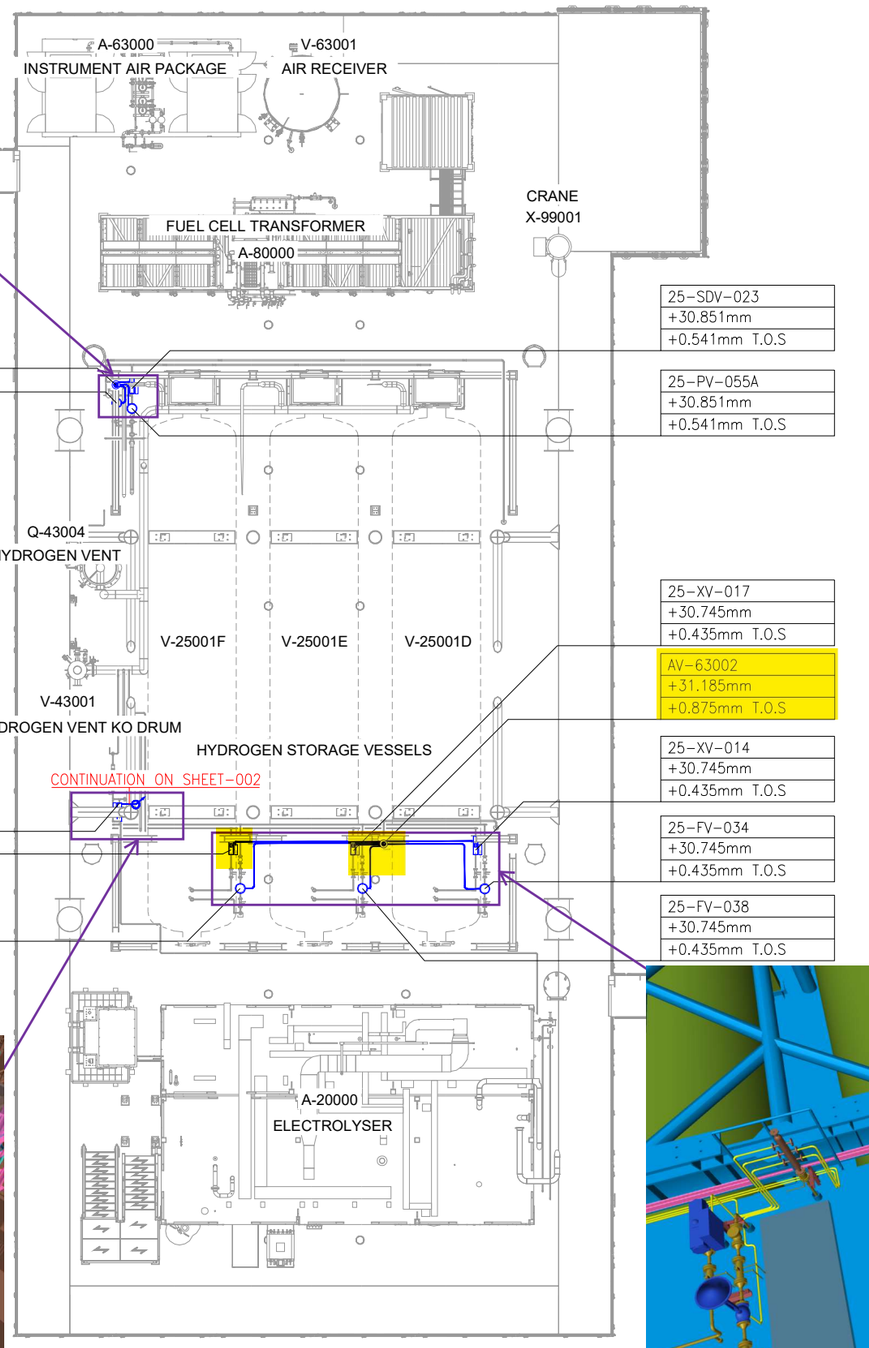

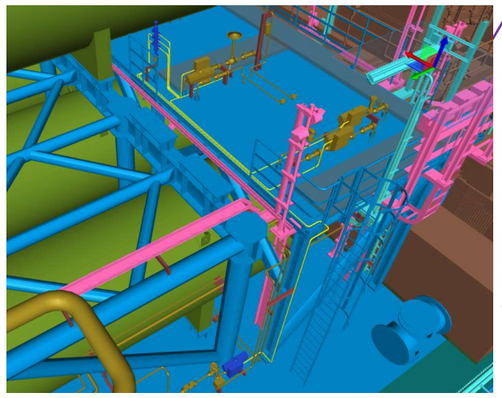

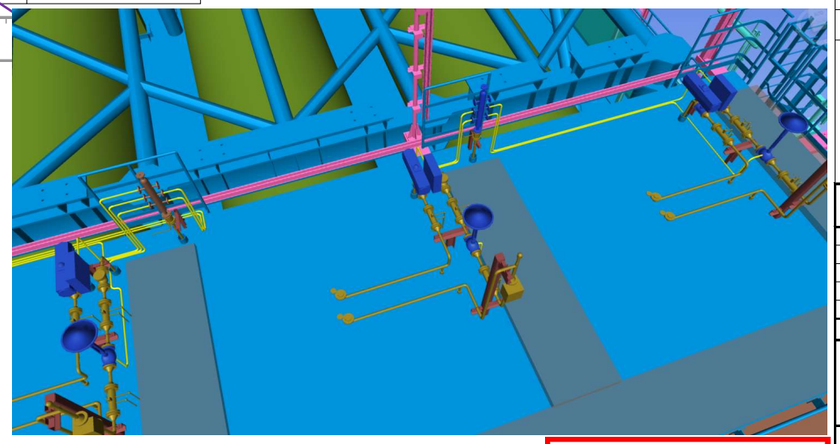



AV-63002

25-XV-020		25-FV-038
25-FV-036		25-XV-014
25-XV-017		25-FV-034

AV-63011

SPARE		25-SDV-023
SPARE		25-PV-055A
SPARE		25-PV-055B



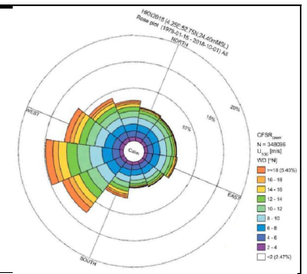

NOTES

1) TUBING ROUTING > 2m IS SHOWN AND IT IS INDICATIVE ONLY.
TUBING ROUTING SHALL BE FINALIZED DURING CONSTRUCTION ACTIVITIES.

LEGEND

- AIR DISTRIBUTION POT
- CONTROL VALVE
- ON-OFF VALVE
- TUBING
- TUBING GOING UP
- TUBING GOING DOWN

HOLDS

REFERENCE DOCUMENTS

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	23/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/02/24	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT TUBING LAYOUT
ELEVATION 30.310 m

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40085**

REV.:	DATE:	SIGNATURE:
1_C	12/12/24	C.Pilato

ROSETTI MARINO SpA

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE 1:100

DRAWN DRAWN_BY | CHECKED CHECKED_BY | APPROVED APPROVED_BY | DATE DD/MM/YY

A1 | DRAWING NO. 123A90-DDL-IN-DL-40085 | SHEET 001 | REV. 01

File Name : 12390-DDL-IN-DL-40085_Rev.01

UPPER DECK

SCALE: 1:1

VIEW EL. 29310mm to 33740mm


DRAWING NO. DRAWING_NO.

REV. REV

V-25001_F

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

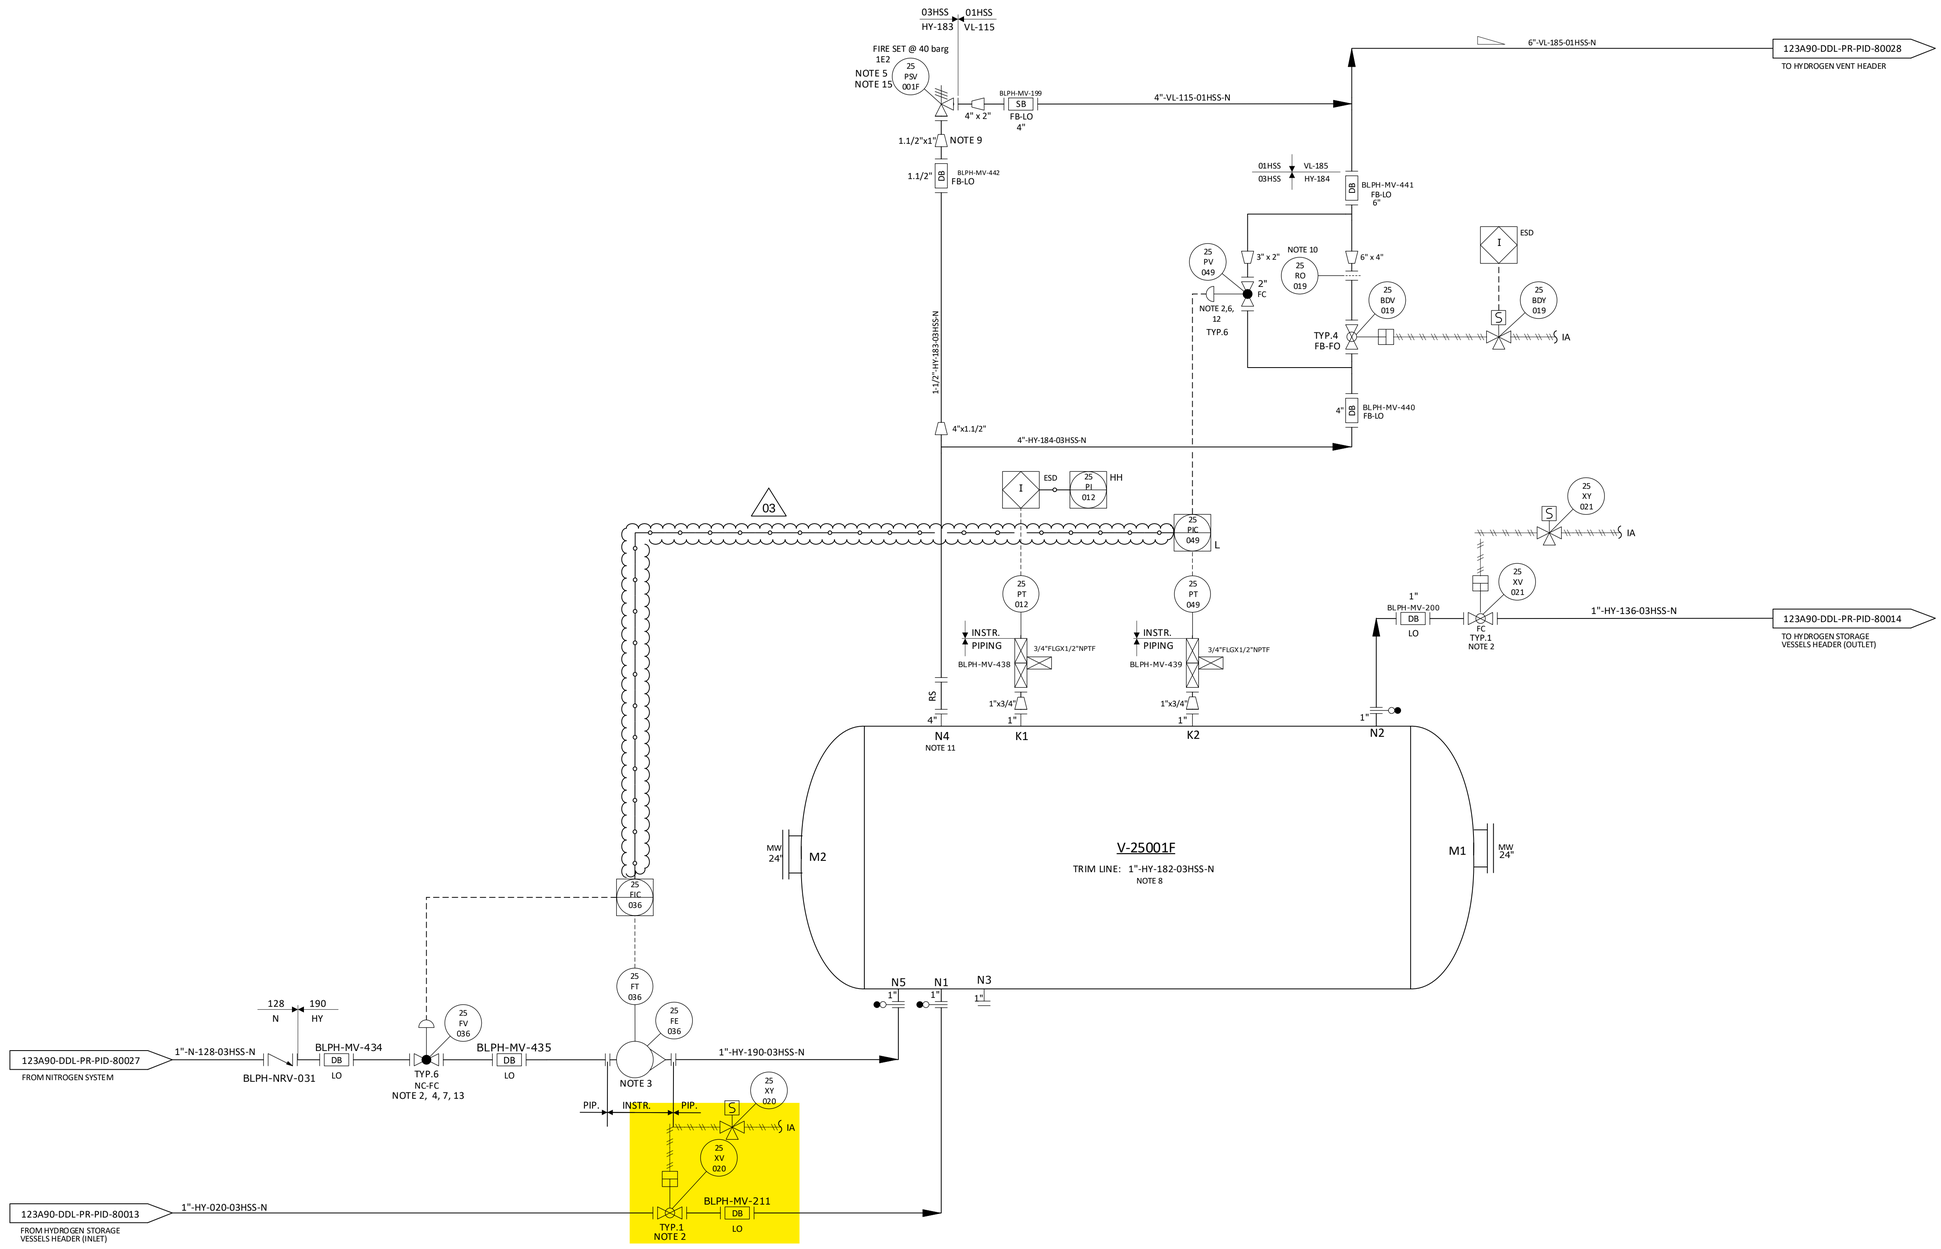

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-036) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-049 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-049 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25FV036 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-049 HAS FAILED TO CLOSE.
15. 25-PSV-001F SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR HAZOP (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL F

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO.	SHEET	REV.
	123A90-DDL-PR-PID-80020	001	03

File Name = FILE_NAME


CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Pneumatic Hook-Ups	Sh. 6 of 6 Date: 08/07/2024 Rev. 01

PNEUMATIC HOOK-UP FOR ON-OFF VALVES

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40078**

REV.:	DATE:	SIGNATURE:
1_B	06/11/24	G.Randi

ROSETTI MARINO SpA



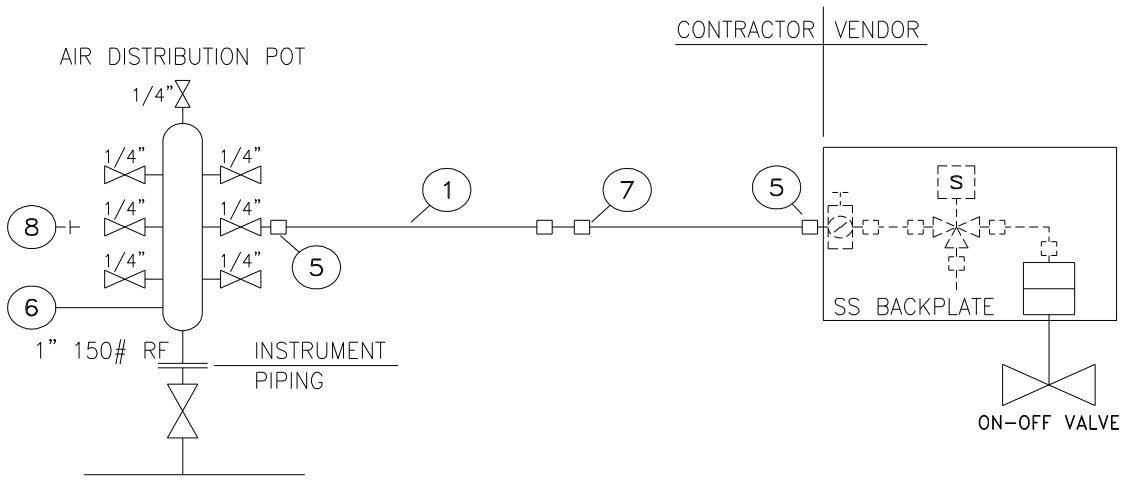


INSTRUMENT TAG	
1	25-BDV-022
2	25-BDV-005
3	25-BDV-007
4	25-BDV-010
5	25-BDV-013
6	25-BDV-016
7	25-BDV-019
8	25-SDV-001
9	25-SDV-023
10	25-XV-004
11	25-XV-006
12	25-XV-008
13	25-XV-009
14	25-XV-011
15	25-XV-012
16	25-XV-014
17	25-XV-015
18	25-XV-017
19	25-XV-018
20	25-XV-020
21	25-XV-021
22	25-XV-024
23	50-XV-001
24	50-XV-002
25	50-XV-003
26	50-XV-004
27	80-XV-001
28	64-SDV-001
29	50-XV-005
30	

NOTE:
(1) For Air Distribution Pot quantities see material take-off on sh. 4

POS.	NORM/STD CODE	DESCRIPTION	SIZE/CONNECTION TYPE	Q.TY
8		SS316 PLUG	1/4" NPT	Note 1
7		SS316 UNION	1/2" O.D. x 1/2" O.D.	N. 1
6		SS316 AIR DISTRIBUTION POT	1" 150#RF - N. 7 1/4" BALL VALVES	Note 1
5		SS316 MALE CONNECTOR	1/4" NPT x 1/2" O.D.	N. 2
1		SS 316L TUBING	1/2" x 0,049"Thk	10 m

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

POS	PICTURE	DESCRIPTION		ITEM ID CODE	TOTAL					
		COMPRESSION FITTING TYPE: **DOUBLE FERRULE** THREADING: ASME B1.20.1 NPT MATERIAL: AISI 316 WORKING PRESSURE AS PER ASME B31.1 TUBING TYPE: ■ INCHES ☐ METRIC			UNIT	Counted	Required			
							Rev. 00	Rev. 01	Rev.	Rev.
1		STRAIGHT MALE CONNECTOR	1/2" NPT-M x 3/8" O.D.		nr.					
2			1/4" NPT-M x 1/2" O.D.		nr.	102	102	102		
3			1/2" NPT-M x 1/2" O.D.		nr.	36	36	-		
4			1/2" NPT-M x 3/4" O.D.		nr.					
5			3/4" NPT-M x 3/4" O.D.		nr.					
6			3/8" NPT-M x 3/8" O.D.		nr.					
7		STRAIGHT FEMALE CONNECTOR	1/2" NPT-F x 3/8" O.D.		nr.					
8			1/4" NPT-F x 1/2" O.D.		nr.					
9			1/2" NPT-F x 1/2" O.D.		nr.					
10			1/2" NPT-F x 3/4" O.D.		nr.					
11		UNION CONNECTOR	1/4" O.D. x 1/4" O.D.		nr.					
12			3/8" O.D. x 3/8" O.D.		nr.					
13			1/2" O.D. x 1/2" O.D.		nr.	49	49	49		
14			3/4" O.D. x 3/4" O.D.		nr.					
15		ELBOW CONNECTOR	1/4" NPT-M x 1/2" O.D.		nr.	27	27	27		
16			1/2" NPT-M x 1/2" O.D.		nr.					
17										
18										
19										
20										
21										
22										
23										
24										
25										
26										
27										
28										
29										
30										
27										
28										
29										
30										
31										
32										
33										
34										

VENDOR / ORDER : **AF SYSTEM / 1724001332**

MATERIAL :

- ☐ ASTM A106 Gr.B
- ■ AISI 316 L
- ☐ UNS S31254

SPECIAL REQUIREMENTS :

- ☐ ...

REMARKS :

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CERTIFICATO DI TARATURA LAT 114 0435-SM-24
Certificate of Calibration

- data di emissione date of issue	2024-09-20
- cliente customer	FAST AUTOMATION SRL VIA DELLA PREVIDENZA SOCIALE, 8 IT-42124 REGGIO EMILIA (RE)
- destinatario receiver	ROSETTI MARINO SPA - YARD PIOMBONI VIA DEL MARCHESATO, 37 IT-48122 MARINA DI RAVENNA (RA)

Si riferisce a
referring to

- oggetto *item*	Misuratore di pressione elettronico Electrical pressure gauge
- costruttore *manufacturer*	WIKA
- modello *model*	CPG1500
- matricola *serial number*	1A014ILJJIM
- data di ricev. oggetto *date of receipt of item*	2024-09-17
- data delle misure *date of measurements*	2024-09-20
- registro di laboratorio *laboratory reference*	0435-SM-24

Il presente certificato di taratura è emesso in base all'accreditamento LAT N. 114 rilasciato in accordo ai decreti attuativi della legge n. 273/1991 che ha istituito il Sistema Nazionale di Taratura (SNT). ACCREDIA attesta le capacità di misura e di taratura, le competenze metrologiche del Centro e la riferibilità delle tarature eseguite ai campioni nazionali ed internazionali delle unità del Sistema Internazionale delle Unità (SI).
Questo certificato non può essere riprodotto in modo parziale, salvo espressa autorizzazione scritta da parte del Centro.

This certificate of calibration is issued in compliance with the accreditation LAT No.114 granted according to decrees connected with Italian law No. 273/1991 which has established the National Calibration System. ACCREDIA attests the calibration and measurement capability, metrological competence of the Centre and the traceability of calibration results to the national and International standards of the International System of Units (SI).
This certificate may not be partially reproduced, except with the prior written permission of the issuing Centre.

I risultati di misura riportati nel presente Certificato sono stati ottenuti applicando le procedure di taratura citate alla pagina seguente, dove sono specificati anche i campioni o gli strumenti che garantiscono la catena di riferibilità del Centro e i rispettivi certificati di taratura in corso di validità. Essi si riferiscono esclusivamente all'oggetto in taratura e sono validi nel momento e nelle condizioni di taratura, salvo diversamente specificato.

The measurement results reported in this Certificate were obtained following the calibration procedures given in the following page, where the reference standards or instruments are indicated which guarantee the traceability chain of the laboratory, and the related calibration certificates in the course of validity are indicated as well. They relate only to the calibrated item and they are valid for the time and conditions of calibration, unless otherwise specified.

Le incertezze di misura dichiarate in questo documento sono state determinate conformemente alla Guida ISO/IEC 98 e al documento EA-4/02. Solitamente sono espresse come incertezza estesa ottenuta moltiplicando l'incertezza tipo per il fattore di copertura *k* corrispondente ad un livello di fiducia di circa il 95 %. Normalmente tale fattore *k* vale 2.

The measurement uncertainties stated in this document have been determined according to the ISO/IEC Guide 98 and to EA-4/02. Usually, they have been estimated as expanded uncertainty obtained multiplying the standard uncertainty by the coverage factor k corresponding to a confidence level of about 95%. Normally, this factor k is 2.

Direzione Tecnica
(Approving Officer)

Enrico Reccagni

Enrico Reccagni

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CARATTERISTICHE DELLO STRUMENTO IN TARATURA/ Properties of devices under calibration

Misuratore di pressione elettronico ***Electrical pressure gauge***	
Tipo *Model*	Misuratore di pressione elettronico Electrical pressure gauge
Numero di matricola *Serial No.*	1A014ILJJIM
Campo di misura *Scale range*	(0 ... 1000) bar g
Accuratezza dichiarata dal costruttore *Accuracy declared by the manufacturer*	0,1 % FS
Risoluzione *Resolution (scale division)*	0,1 bar
Tag. N. *Tag No.*	--

Procedura di taratura e catena di riferibilità
Calibration procedure and traceability chain

La taratura è stata effettuata in accordo alla linea guida DKD-R 6-1 "Taratura di strumenti di pressione" (versione 03/2014) procedura B, per confronto fra i valori dello strumento in taratura con quelli di riferimento dati dal campione di lavoro.

Calibration was carried out according to DKD-R 6-1 "Kalibrierung von Druckmessgeräten" (Ausgabe 03/2014) procedure B, by comparing the measured values of the calibration item with those of the reference or working standard.

I risultati riportati sono stati ottenuti applicando le procedure n° LMO-PT-01 rev.2

The results have been obtained using the procedures n° LMO-PT-01 rev.2

La catena di riferibilità ha inizio dai campioni di riferimento n° PM1-09

The traceability chain starts from the reference standards n° PM1-09

muniti di certificati validi di taratura, rispettivamente n° D21090

with the relevant valid calibration certificates n° D21090

Luogo di taratura
Place of calibration

Laboratorio WIKA ITALIA - Laboratorio di Modugno (BA)
WIKA ITALY Laboratory - Modugno (BA)

Campione di lavoro
Working Standard

Norma di riferimento (RS) Bilancia di pressione ***Reference standard (RS) Dead-weight tester***	
Tipo *Model*	PM1-09
Certificato di taratura *Calibration mark*	D-K-15105/D21090
Campo di misura *Scale range*	(10 ... 2500) bar g
Accuratezza *Accuracy*	0,015 % della lettura + 255 Pa

Operatore
Technichian

Francesco Donatelli

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Condizioni di misura
Measurement conditions

Schema di collegamento *Assembly*	
Fluido utilizzato *Pressure medium*	Sebacate *Sebacate*
Livello di riferimento *Refence height (for reference value)*	Superficie di tenuta DUT *Sealing face DUT*
Posizione di montaggio *Position during calibration*	verticale *vertical*

Note di taratura
Calibration Note

Lo strumento è stato tarato e riconsegnato nelle stesse condizioni in cui è arrivato nel laboratorio, in accordo con il metodo "as found as left" / The device under test (DUT) was calibrated in the same conditions it was arrived in laboratory, according to the method "as found as left".

Condizioni Ambientali
Environmental conditions

Temperatura *Temperature*	(22 ± 1,5)	°C
Pressione atmoferica *Atmospheric pressure*	(1009,3 ± 0,2)	hPa
Umidità relativa *Rel. Humidity*	(50 ± 15)	% UR

I dati meteo sono stati acquisiti tramite stazione meteo WIKA CPU6000-W s/n.1A00VCX6GJ2

Weather data were acquired via the WIKA CPU6000-W weather station s/n.1A00VCX6GJ2

Misure rilevate
Measurement results

Valore di riferimento *Reference value RS* bar	**Letture** *Reading DUT* bar		
	M1	**M2**	**M3**
0,00	0,0	0,0	0,0
99,91	99,9	99,9	99,9
199,82	199,9	199,9	199,9
299,73	299,8	299,8	299,8
399,63	399,7	399,7	399,7
499,53	499,5	499,6	499,6
599,44	599,4	599,4	599,4
699,34	699,3	699,3	699,3
799,25	799,1	799,2	799,1
899,14	899,0	899,1	899,0
999,04	999,0	999,0	999,0

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it


Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Incertezza di misura
Uncertainty of measurement

Valori di riferimento *Reference value RS* bar	Media delle misure *Mean value* bar	Errore *Error* bar	Ripetibilità *Repeatability* bar	Isteresi *Hysteresis* bar	Incertezza di misura *Meas. Uncertainty* bar
0,00	0,0	0,0	0,0	0,0	0,40
99,91	99,9	0,0	0,0	0,0	0,40
199,82	199,9	0,1	0,0	0,0	0,40
299,73	299,8	0,1	0,0	0,0	0,40
399,63	399,7	0,1	0,0	0,0	0,40
499,53	499,6	0,1	0,1	0,1	0,40
599,44	599,4	0,0	0,0	0,0	0,40
699,34	699,3	0,0	0,0	0,0	0,40
799,25	799,2	0,0	0,0	0,1	0,40
899,14	899,1	0,0	0,0	0,1	0,40
999,04	999,0	0,0	0,0	0,0	0,40

Grafico degli errori di misura
Graphical representation of measurement uncertainty

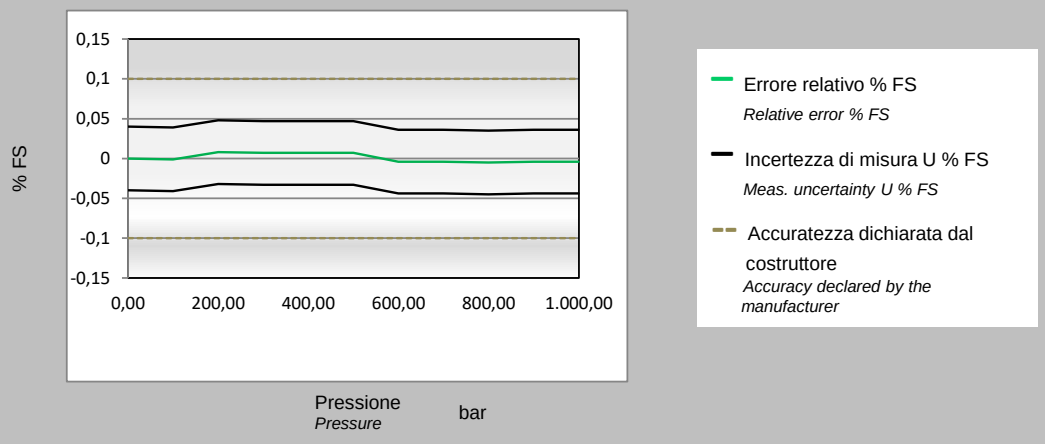

L'incertezza estesa senza correzione del DUT è pari a 0,5 bar
The expanded uncertainty of the DUT without correction is equal to

Questo dato è ottenuto come MAX{Incertezza_di_misura$_i$ + |Errore$_i$|} della tabella precedente
This data is obatined as MAX{Meas._uncertainty$_i$ + |Error$_i$|} of the previous table

Il presente certificato non rappresenta una dichiarazione di conformità a specifica
This certificate is not a statement of compliance

ITEM	Tag	AV-63002/25-XV-017	: Pneumatic Connection Air Supply - 25-XV-017		Dwg	123A90-DDL-IN-LIS-40092	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001946	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline Instrumental	Form	CJX06	Tubing Hydraulic

General

1	Drawings (P&ID tube) attached.	OK
2	Isometric drawings (P&ID pipe) attached.	NA
3	Check drawings at last revision.	OK
4	Material certificates for pipe/tube/fittings/flanges/hose and support clamps checked	OK
5	Welders certificates checked	NA
6	Certificate and mark-up drawings for welding WPS and WPQR and material certificates checked	NA
7	Certificates and mark-up drawings for NDT report checked	NA

Check before Flushing and/or Testing

8	Installation complete and in compliance with drawings and specifications.	OK
9	Tubing/Piping tray checked.	NA
10	Hose according to specifications and tightened	NA
11	Flanges - nuts and bolts tightened.	NA
12	Fittings are mounted and tightened.	OK
13	Pipe supports completed and installed as required.	OK
14	Cable ladders, trays, sharp edges protected, cut ends sealed.	NA
15	Maintenance evaluation.	OK

ITEM	Tag	AV-63002/25-XV-017	: Pneumatic Connection Air Supply - 25-XV-017		Dwg	123A90-DDL-IN-LIS-40092	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001946	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline Instrumental	Form	CJX06	Tubing Hydraulic

Flushing / Pressure testing

16	Drawings of flushing loops (P&ID tube) attached	NA
17	Equipment & valves bypassed and blinded	OK
18	Calibration certificates attached	OK
19	Type of flushing medium correct	NA
20	Printout from recorder/particle counter	NA
21	Printout from pressure indicator	OK

Final Check

22	Final inspection of pipework.	OK
23	Preservation of tested pipework.	NA
24	System/equipment labelled with: "Hot Oil flushing performed".	NA
25	If required produce Red Line Mark Up for "AS BUILT"	

TEST SPECIFIED USED

TEST FLUID: IA TEST PRESSURE BAR G: 7.4 TEST DURATION : 12 MIN

TEST EQUIPMENT: CPG 1500 SERIAL N°: 1A014ILJJIM

HOOK UP DIAGRAM Number: 123A90-DDL-IN-HD-40078

Line FROM	Line TO	Tubing cleaned			Tubing flushed			Diam ID/OD
		Yes	No	N/A	Yes	No	N/A	
AV-63002	25-XV-017	●					●	1/2" OD x Thk. 0,049"

TESTED LABEL AFFIXED DATA SHEET ATTACHED

Comments:

	Performed by	☒ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Paolo Schintu	
Date	2025-01-28	2025-02-04	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-28T07:50:31.144Z	PROVERLIS Digitaly signed by Paolo Schintu 2025-02-04T11:41:27.043Z	

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	AV-63002/25-XV-017

Instrument

Strumento

Electrical pressure gauge *Misuratore di pressione elettronico*	
Model *Modello*	CPG1500
Serial number *Numero di serie*	1A014ILJJIM
Log temperature *Registrazioni di Temperatura*	Active *Attivo*
Scale range *Campo scala*	(0 ... 1000) bar a
Accuracy *Accuratezza*	0.1 % FS
Tag number *Numero tag*	
Communication *Comunicazione*	Wireless (00:13:43:85:DD:8D)

Measurement conditions

Condizioni di misura

Settings *Impostazioni*	
Mode *Modalità*	Automatic *Automatico*
Interval (ms) *Intervallo (ms)*	15000
Duration (hh:mm:ss) *Durata (hh:mm:ss)*	00:12:44
Start time (hh:mm:ss) *Tempo di avvio (hh:mm:ss)*	04:42:17 pm

Logger protocol

Protocollo di acquisizione elenco dati


ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	AV-63002/25-XV-017

Measurement results

Risultati della misura

Graphical representation of progression
Rappresentazione grafica dell'andamento

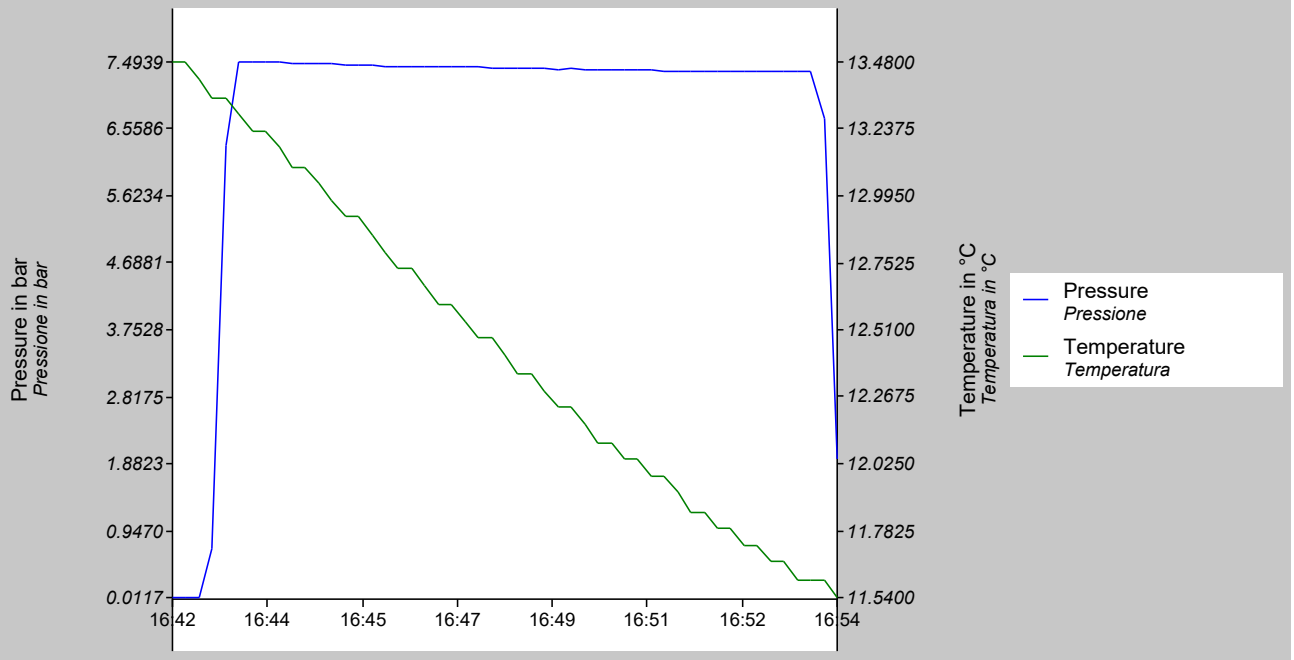

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/31/2025 16:42:17.000	0.0117	13.4800
01/31/2025 16:42:32.000	0.0166	13.4800
01/31/2025 16:42:47.000	0.0149	13.4200
01/31/2025 16:43:02.000	0.6832	13.3500
01/31/2025 16:43:17.000	6.3242	13.3500
01/31/2025 16:43:32.000	7.4883	13.2900
01/31/2025 16:43:47.000	7.4939	13.2300
01/31/2025 16:44:02.000	7.4839	13.2300
01/31/2025 16:44:17.000	7.4842	13.1700
01/31/2025 16:44:32.000	7.4761	13.1000
01/31/2025 16:44:47.000	7.4667	13.1000
01/31/2025 16:45:02.000	7.4671	13.0400
01/31/2025 16:45:17.000	7.4613	12.9800
01/31/2025 16:45:32.000	7.4587	12.9200
01/31/2025 16:45:47.000	7.4497	12.9200
01/31/2025 16:46:02.000	7.4468	12.8500
01/31/2025 16:46:17.000	7.4370	12.7900

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	AV-63002/25-XV-017

Measurement results

Risultati della misura

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/31/2025 16:46:32.000	7.4356	12.7300
01/31/2025 16:46:47.000	7.4341	12.7300
01/31/2025 16:47:02.000	7.4299	12.6700
01/31/2025 16:47:17.000	7.4258	12.6000
01/31/2025 16:47:32.000	7.4191	12.6000
01/31/2025 16:47:47.000	7.4170	12.5400
01/31/2025 16:48:02.000	7.4183	12.4800
01/31/2025 16:48:17.000	7.4117	12.4800
01/31/2025 16:48:32.000	7.4164	12.4200
01/31/2025 16:48:47.000	7.4103	12.3500
01/31/2025 16:49:02.000	7.4020	12.3500
01/31/2025 16:49:17.000	7.4016	12.2900
01/31/2025 16:49:32.000	7.3943	12.2300
01/31/2025 16:49:47.000	7.3963	12.2300
01/31/2025 16:50:02.000	7.3885	12.1700
01/31/2025 16:50:17.000	7.3821	12.1000
01/31/2025 16:50:32.000	7.3886	12.1000
01/31/2025 16:50:47.000	7.3832	12.0400
01/31/2025 16:51:02.000	7.3855	12.0400
01/31/2025 16:51:17.000	7.3764	11.9800
01/31/2025 16:51:32.000	7.3717	11.9800
01/31/2025 16:51:47.000	7.3714	11.9200
01/31/2025 16:52:02.000	7.3684	11.8500
01/31/2025 16:52:17.000	7.3613	11.8500
01/31/2025 16:52:32.000	7.3545	11.7900
01/31/2025 16:52:47.000	7.3614	11.7900
01/31/2025 16:53:02.000	7.3569	11.7300
01/31/2025 16:53:17.000	7.3594	11.7300
01/31/2025 16:53:32.000	7.3554	11.6700
01/31/2025 16:53:47.000	7.3574	11.6700
01/31/2025 16:54:02.000	7.3604	11.6000
01/31/2025 16:54:17.000	7.3614	11.6000
01/31/2025 16:54:32.000	6.7070	11.6000
01/31/2025 16:54:47.000	1.9403	11.5400

CROSSWIND

HOLLANDSE KUST NOORD WIND PARK Project
Contract No. CW-I-WP4-2023-05

INSTRUMENT TUBING LIST


ROSETTI MARINO


Sh. 4 of 4 REV. 00 01 02 03 04
X X X X X


								DATA TUBING									FROM AREA					TO AREA					
POS.	REV	SUPPLY SCOPE	LAINING SCOPE	TAG Tubing	P&ID	MAIN FUNCTION	SERVICE	DESIGN TEMPERATURE(C°)	OPERATING PRESSURE (Barg)	DESIGN PRESSURE (Barg)	TEST PRESSURE (Barg)	FLUID TEST	DIMENSIONS	MATERIAL	REF. DOC.	Q.TY (m)	FIRE PROOFING	HEAT TRACING	MODULE	AREA	FROM ITEM	REF. P&I	DESCRIPTION	MODULE	AREA	TO ITEM	REF. LAYOUT	DESCRIPTION	NOTE
01	04	RM	RM	**AV-63001/25-XV-011**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-XV-011	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
02	04	RM	RM	**AV-63001/25-FV-033**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-FV-033	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
03	04	RM	RM	**AV-63001/25-XV-008**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-XV-008	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
04	04	RM	RM	**AV-63001/25-FV-032**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-FV-032	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
05	04	RM	RM	**AV-63002/25-XV-020**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-020	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
06	04	RM	RM	**AV-63002/25-FV-036**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**11**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-036	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
07	04	RM	RM	**AV-63002/25-XV-017**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-017	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
08	04	RM	RM	**AV-63002/25-FV-038**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-038	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
09	04	RM	RM	**AV-63002/25-XV-014**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-014	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
10	04	RM	RM	**AV-63002/25-FV-034**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-034	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
11	04	RM	RM	**AV-63003/25-BDV-010**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-BDV-010	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
12	04	RM	RM	**AV-63003/25-PV-040**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-PV-040	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
13	04	RM	RM	**AV-63003/25-XV-012**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-XV-012	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
14	04	RM	RM	**AV-63003/25-XV-009**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**13**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-XV-009	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
15	04	RM	RM	**AV-63004/25-BDV-013**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-BDV-013	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
16	04	RM	RM	**AV-63004/25-PV-043**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-PV-043	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
17	04	RM	RM	**AV-63004/25-XV-015**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-XV-015	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
18	04	RM	RM	**AV-63005/64-PV-031A**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Lower Deck	AV-63005	123A90-DDL-PR-PID-80041	Distribution Pot 5	BLPH	Lower Deck	64-PV-031A	123A90-DDL-IN-DL-40080	Pneumatic Control Valve	Design Pressure set as per downstream PSV
19	04	RM	RM	**AV-63005/64-PV-031B**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**3**	N.A.	N.A.	BLPH	Lower Deck	AV-63005	123A90-DDL-PR-PID-80041	Distribution Pot 5	BLPH	Lower Deck	64-PV-031B	123A90-DDL-IN-DL-40080	Pneumatic Control Valve	Design Pressure set as per downstream PSV
20	04	RM	RM	**AV-63006/25-BDV-022**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-BDV-022	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
21	04	RM	RM	**AV-63006/25-XV-021**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-XV-021	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
22	04	RM	RM	**AV-63006/25-PV-049**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-PV-049	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
23	04	RM	RM	**AV-63006/25-BDV-019**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-BDV-019	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
24	04	RM	RM	**AV-63006/80-XV-001**	123A90-DDL-PR-PID-80012	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	80-XV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
25	04	RM	RM	**AV-63007/25-XV-006**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-XV-006	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
26	04	RM	RM	**AV-63007/25-PV-035**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**11**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-PV-035	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
27	04	RM	RM	**AV-63007/25-BDV-005**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-BDV-005	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
28	04	RM	RM	**AV-63007/25-PV-037**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-PV-037	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
29	04	RM	RM	**AV-63007/25-BDV-007**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-BDV-007	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
30	04	RM	RM	**AV-63008/50-XV-001**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-001	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
31	04	RM	RM	**AV-63008/50-XV-002**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-002	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
32	04	RM	RM	**AV-63008/50-XV-003**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-003	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
33	04	RM	RM	**AV-63008/50-XV-004**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-004	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
33A	04	RM	RM	**AV-63009/50-XV-005**	123A90-DDL-PR-PID-80025	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Lower Deck	AV-63009	123A90-DDL-PR-PID-80041	Distribution Pot 9	BLPH	Lower Deck	50-XV-005	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
34	04	RM	RM	**AV-63010/25-SDV-001**	123A90-DDL-PR-PID-80013	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-SDV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
35	04	RM	RM	**AV-63010/25-XV-024**	123A90-DDL-PR-PID-80013	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-XV-024	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
36	04	RM	RM	**AV-63010/25-XV-004**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-XV-004	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
37	04	RM	RM	**AV-63010/25-FV-031**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-FV-031	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
38	04	RM	RM	**AV-63010/64-SDV-001**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**15**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	64-SDV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
39	04	RM	RM	**AV-63011/25-SDV-023**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-SDV-023	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
40	04	RM	RM	**AV-63011/25-PV-055A**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-PV-055A	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
41	04	RM	RM	**AV-63011/25-PV-055B**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-PV-055B	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
42	04	RM	RM	**AV-63012/25-XV-018**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-XV-018	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
43	04	RM	RM	**AV-63012/25-PV-046**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-PV-046	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
44	04	RM	RM	**AV-63012/25-BDV-016**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-BDV-016	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
~~45~~	03	DELETED	DELETED	~~**BLPH-MV-014/25-PT-001**~~	~~123A90-DDL-PR-PID-80013~~	~~Process Connection~~	~~Hydrogen~~	~~80~~	~~7,5 / 30~~	~~40~~	~~7,5 / 30~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-014~~	~~123A90-DDL-PR-PID-80013~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25-PT-001~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~46~~	03	DELETED	DELETED	~~**BLPH-MV-013/25-PT-002**~~	~~123A90-DDL-PR-PID-80013~~	~~Process Connection~~	~~Hydrogen~~	~~80~~	~~7,5 / 30~~	~~40~~	~~7,5 / 30~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-013~~	~~123A90-DDL-PR-PID-80013~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25-PT-002~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~47~~	03	DELETED	DELETED	~~**BLPH-MV-025/26-PT-055A**~~	~~123A90-DDL-PR-PID-80014~~	~~Process Connection~~	~~Hydrogen~~	~~100~~	~~17,7~~	~~10~~	~~17,7~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-025~~	~~123A90-DDL-PR-PID-80014~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~26-PT-055A~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~48~~	03	DELETED	DELETED	~~**BLPH-MV-213/26-PT-055B**~~	~~123A90-DDL-PR-PID-80014~~	~~Process Connection~~	~~Hydrogen~~	~~100~~	~~3,5 / 6,5~~	~~10~~	~~3,5 / 6,5~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-213~~	~~123A90-DDL-PR-PID-80014~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25-PT-055B~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~49~~	03	DELETED	DELETED	~~**BLPH-MV-407/43-PT-001**~~	~~123A90-DDL-PR-PID-80029~~	~~Process Connection~~	~~Hydrogen~~	~~-10 / +80~~	~~ATM~~	~~3,5~~	~~ATM~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-407~~	~~123A90-DDL-PR-PID-80029~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~43-PT-001~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~50~~	03	DELETED	DELETED	~~**BLPH-MV-411/50-PT-014**~~	~~123A90-DDL-PR-PID-80026~~	~~Process Connection~~	~~Waste Water~~	~~100~~	~~ATM~~	~~17,7~~	~~ATM~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~YES~~	~~BLPH~~	~~Lower Deck~~	~~BLPH-MV-411~~	~~123A90-DDL-PR-PID-80026~~	~~Manual Valve~~	~~BLPH~~	~~Lower Deck~~	~~60-PT-014~~	~~123A90-DDL-IN-DL-40080~~	~~Pressure Transmitter~~	
~~51~~	03	DELETED	DELETED	~~**BLPH-MV-150/63-PT-003**~~	~~123A90-DDL-PR-PID-80027~~	~~Process Connection~~	~~Instrument Air~~	~~100~~	~~4 / 10~~	~~11~~	~~4 / 10~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-150~~	~~123A90-DDL-PR-PID-80027~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~63-PT-003~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~52~~	03	DELETED	DELETED	~~**BLPH-MV-151/63-PT-004**~~	~~123A90-DDL-PR-PID-80027~~	~~Process Connection~~	~~Instrument Air~~	~~100~~	~~4 / 10~~	~~11~~	~~4 / 10~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-151~~	~~123A90-DDL-PR-PID-80027~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~63-PT-004~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
53	04	RM	RM	**BLPH-MV-386/64-PT-031A**	123A90-DDL-PR-PID-80027	Process Connection	Nitrogen Gas	100	6	10	11	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL


DRAWING NO. 12390-DDL-IN-DL-40085

REV. 01

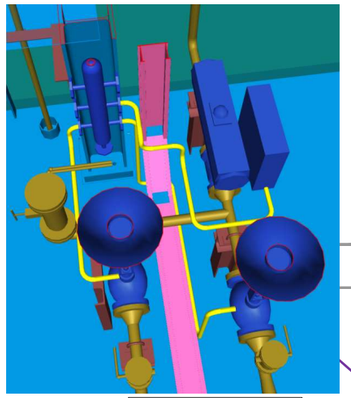

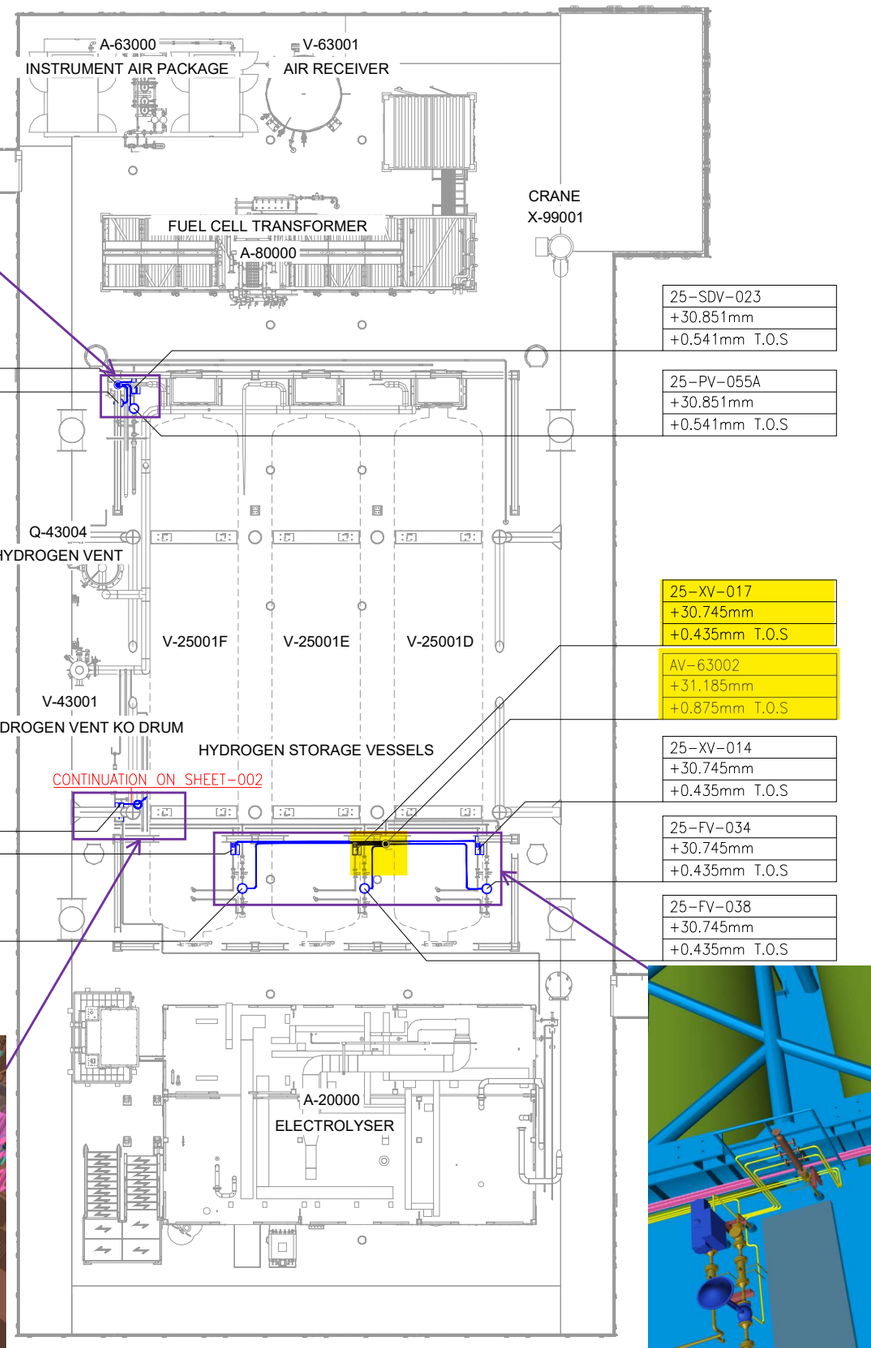

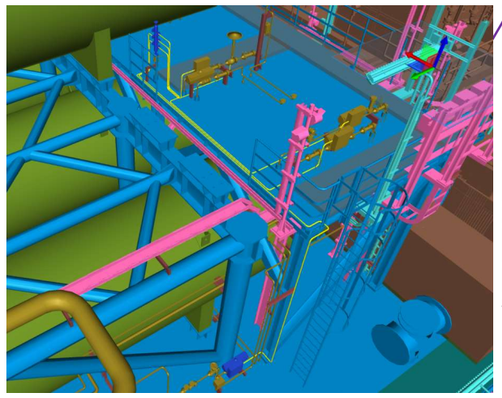

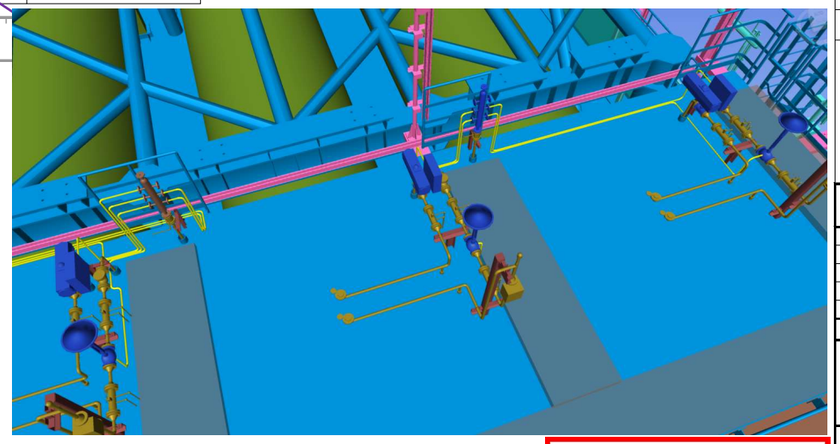



AV-63002

25-XV-020		25-FV-038
25-FV-036		25-XV-014
25-XV-017		25-FV-034

AV-63011

SPARE		25-SDV-023
SPARE		25-PV-055A
SPARE		25-PV-055B



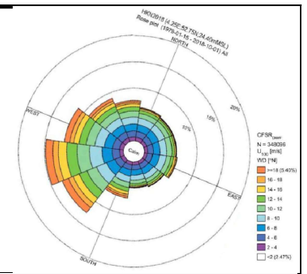

NOTES

1) TUBING ROUTING > 2m IS SHOWN AND IT IS INDICATIVE ONLY.
TUBING ROUTING SHALL BE FINALIZED DURING CONSTRUCTION ACTIVITIES.

LEGEND

- AIR DISTRIBUTION POT
- CONTROL VALVE
- ON-OFF VALVE
- TUBING
- TUBING GOING UP
- TUBING GOING DOWN

HOLDS

REFERENCE DOCUMENTS

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	23/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/02/24	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT TUBING LAYOUT
ELEVATION 30.310 m

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40085**

REV.:	DATE:	SIGNATURE:
1_C	12/12/24	C.Pilato

ROSETTI MARINO SpA

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:100
DRAWN DRAWN_BY	CHECKED CHECKED_BY	APPROVED APPROVED_BY	DATE DD/MM/YY
A1	DRAWING NO. 123A90-DDL-IN-DL-40085	SHEET 001	REV. 01

File Name : 12390-DDL-IN-DL-40085_Rev.01

UPPER DECK
SCALE: 1:1

VIEW EL. 29310mm to 33740mm


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 E

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

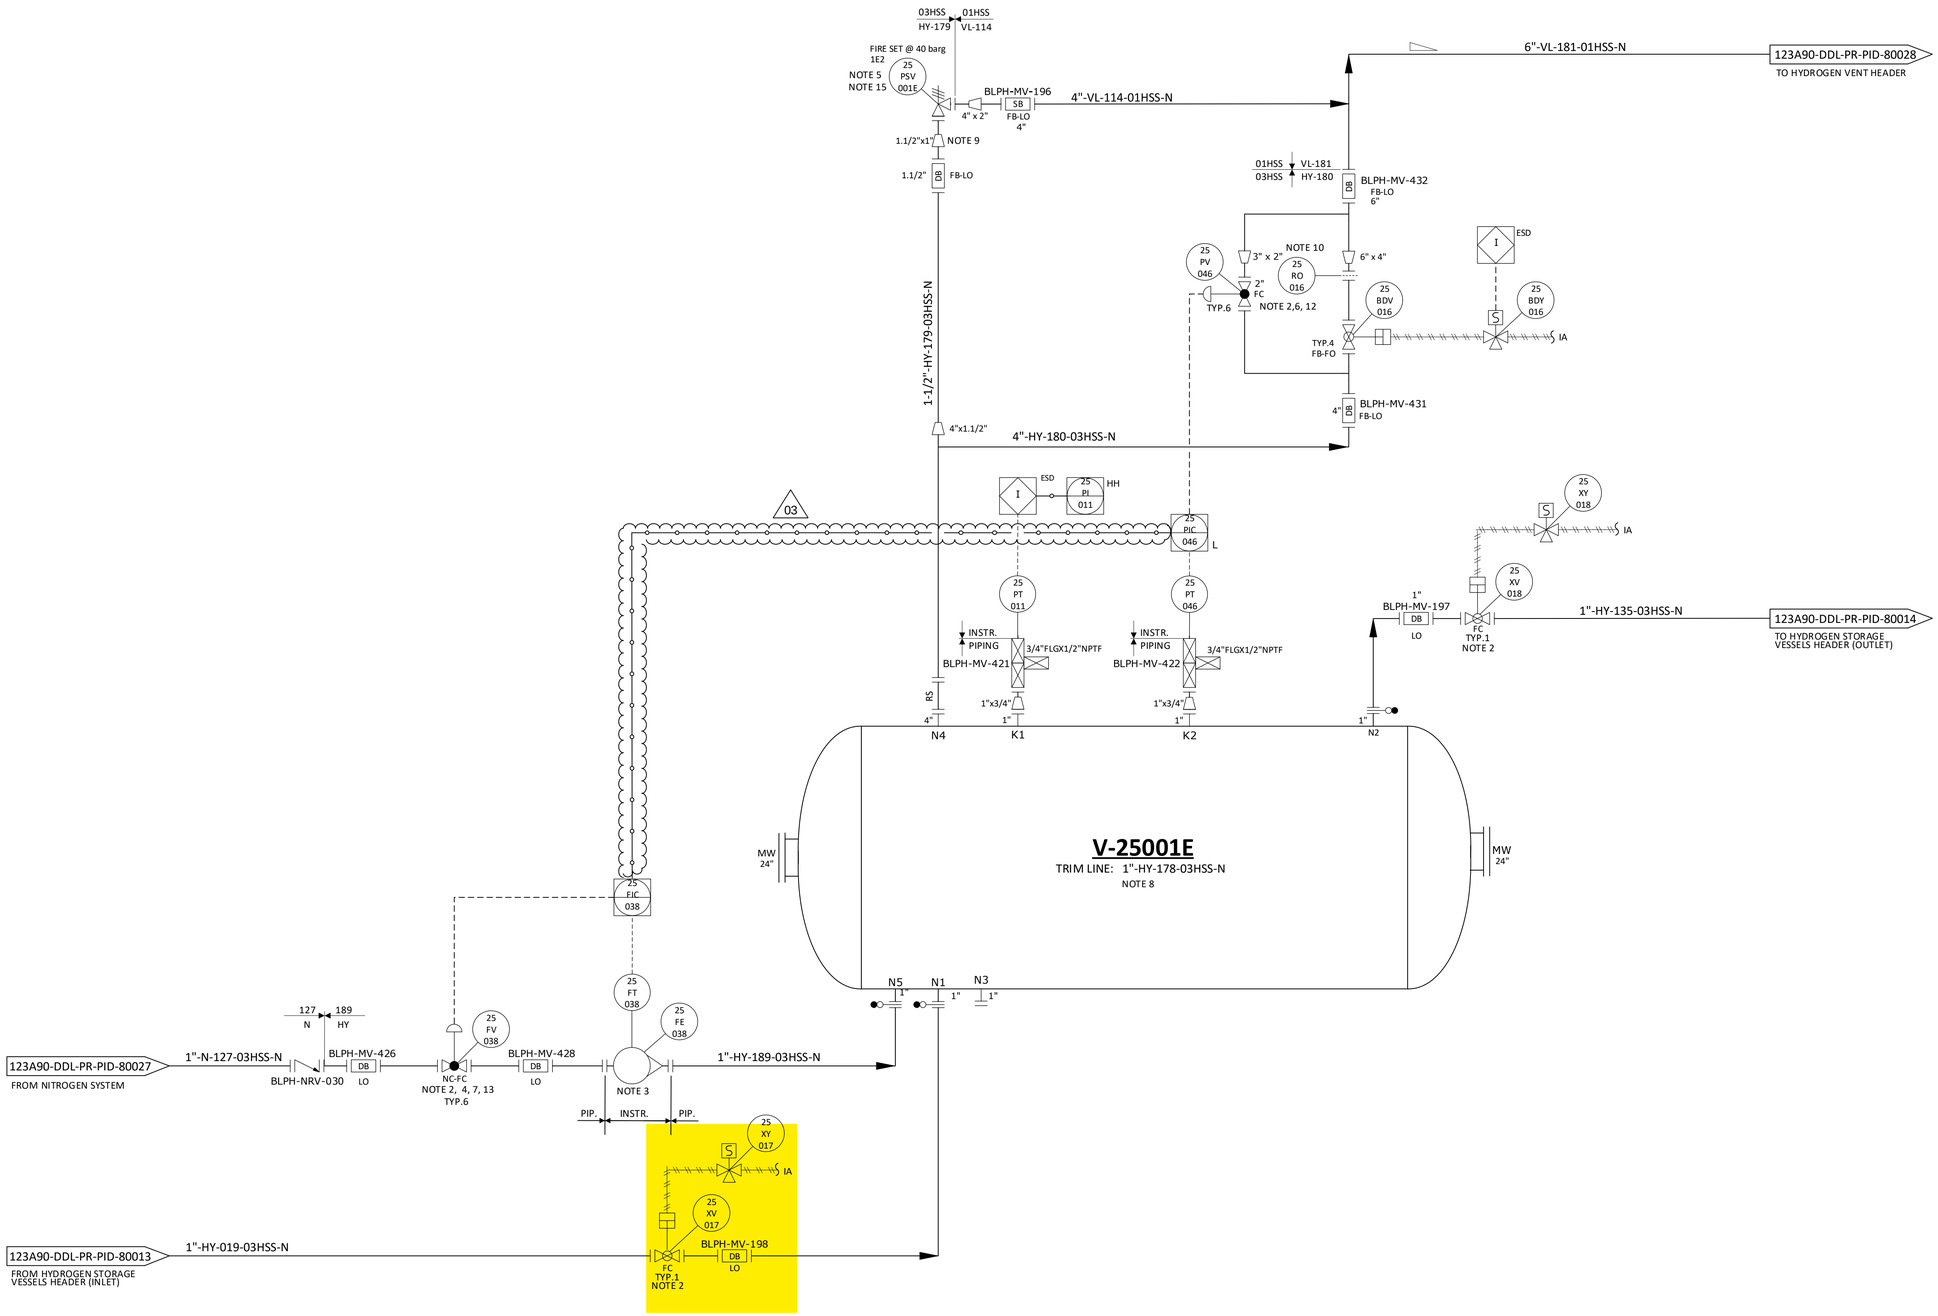

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-038) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-046 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-046 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-038 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-046 HAS FAILED TO CLOSE.
15. 25-PSV-001E SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL E

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE		
A1	DRAWING NO. 123A90-DDL-PR-PID-80019			SHEET 001	REV. 03

File Name = FILE_NAME


CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Pneumatic Hook-Ups	Sh. 6 of 6 Date: 08/07/2024 Rev. 01

PNEUMATIC HOOK-UP FOR ON-OFF VALVES

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40078**

REV.:	DATE:	SIGNATURE:
1_B	06/11/24	G.Randi

ROSETTI MARINO SpA



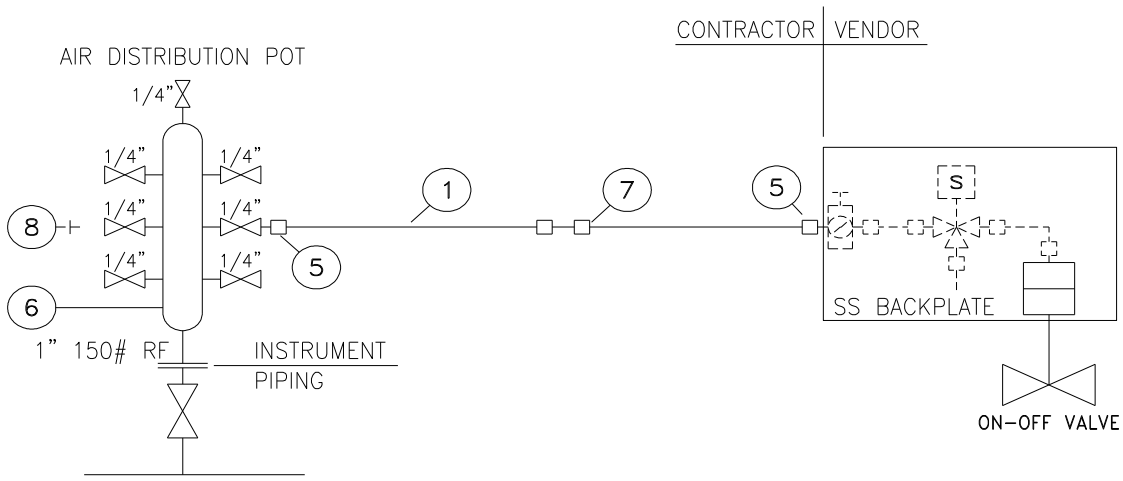


INSTRUMENT TAG	
1	25-BDV-022
2	25-BDV-005
3	25-BDV-007
4	25-BDV-010
5	25-BDV-013
6	25-BDV-016
7	25-BDV-019
8	25-SDV-001
9	25-SDV-023
10	25-XV-004
11	25-XV-006
12	25-XV-008
13	25-XV-009
14	25-XV-011
15	25-XV-012
16	25-XV-014
17	25-XV-015
18	25-XV-017
19	25-XV-018
20	25-XV-020
21	25-XV-021
22	25-XV-024
23	50-XV-001
24	50-XV-002
25	50-XV-003
26	50-XV-004
27	80-XV-001
28	64-SDV-001
29	50-XV-005
30	

NOTE:
(1) For Air Distribution Pot quantities see material take-off on sh. 4

POS.	NORM/STD CODE	DESCRIPTION	SIZE/CONNECTION TYPE	Q.TY
8		SS316 PLUG	1/4" NPT	Note 1
7		SS316 UNION	1/2" O.D. x 1/2" O.D.	N. 1
6		SS316 AIR DISTRIBUTION POT	1" 150#RF - N. 7 1/4" BALL VALVES	Note 1
5		SS316 MALE CONNECTOR	1/4" NPT x 1/2" O.D.	N. 2
1		SS 316L TUBING	1/2" x 0,049"Thk	10 m

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

POS	PICTURE	DESCRIPTION		ITEM ID CODE	TOTAL					
		COMPRESSION FITTING TYPE: **DOUBLE FERRULE** THREADING: ASME B1.20.1 NPT MATERIAL: AISI 316 WORKING PRESSURE AS PER ASME B31.1 TUBING TYPE: ■ INCHES ☐ METRIC			UNIT	Counted	Required			
							Rev. 00	Rev. 01	Rev.	Rev.
1		STRAIGHT MALE CONNECTOR	1/2" NPT-M x 3/8" O.D.		nr.					
2			1/4" NPT-M x 1/2" O.D.		nr.	102	102	102		
3			1/2" NPT-M x 1/2" O.D.		nr.	36	36	-		
4			1/2" NPT-M x 3/4" O.D.		nr.					
5			3/4" NPT-M x 3/4" O.D.		nr.					
6			3/8" NPT-M x 3/8" O.D.		nr.					
7		STRAIGHT FEMALE CONNECTOR	1/2" NPT-F x 3/8" O.D.		nr.					
8			1/4" NPT-F x 1/2" O.D.		nr.					
9			1/2" NPT-F x 1/2" O.D.		nr.					
10			1/2" NPT-F x 3/4" O.D.		nr.					
11		UNION CONNECTOR	1/4" O.D. x 1/4" O.D.		nr.					
12			3/8" O.D. x 3/8" O.D.		nr.					
13			1/2" O.D. x 1/2" O.D.		nr.	49	49	49		
14			3/4" O.D. x 3/4" O.D.		nr.					
15		ELBOW CONNECTOR	1/4" NPT-M x 1/2" O.D.		nr.	27	27	27		
16			1/2" NPT-M x 1/2" O.D.		nr.					
17										
18										
19										
20										
21										
22										
23										
24										
25										
26										
27										
28										
29										
30										
27										
28										
29										
30										
31										
32										
33										
34										

VENDOR / ORDER : **AF SYSTEM / 1724001332**

MATERIAL :

- ☐ ASTM A106 Gr.B
- ■ AISI 316 L
- ☐ UNS S31254

SPECIAL REQUIREMENTS :

- ☐ ...

REMARKS :

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CERTIFICATO DI TARATURA LAT 114 0435-SM-24
Certificate of Calibration

- data di emissione date of issue	2024-09-20
- cliente customer	FAST AUTOMATION SRL VIA DELLA PREVIDENZA SOCIALE, 8 IT-42124 REGGIO EMILIA (RE)
- destinatario receiver	ROSETTI MARINO SPA - YARD PIOMBONI VIA DEL MARCHESATO, 37 IT-48122 MARINA DI RAVENNA (RA)

Si riferisce a
referring to

- oggetto *item*	Misuratore di pressione elettronico Electrical pressure gauge
- costruttore *manufacturer*	WIKA
- modello *model*	CPG1500
- matricola *serial number*	1A014ILJJIM
- data di ricev. oggetto *date of receipt of item*	2024-09-17
- data delle misure *date of measurements*	2024-09-20
- registro di laboratorio *laboratory reference*	0435-SM-24

Il presente certificato di taratura è emesso in base all'accreditamento LAT N. 114 rilasciato in accordo ai decreti attuativi della legge n. 273/1991 che ha istituito il Sistema Nazionale di Taratura (SNT). ACCREDIA attesta le capacità di misura e di taratura, le competenze metrologiche del Centro e la riferibilità delle tarature eseguite ai campioni nazionali ed internazionali delle unità del Sistema Internazionale delle Unità (SI).
Questo certificato non può essere riprodotto in modo parziale, salvo espressa autorizzazione scritta da parte del Centro.

This certificate of calibration is issued in compliance with the accreditation LAT No.114 granted according to decrees connected with Italian law No. 273/1991 which has established the National Calibration System. ACCREDIA attests the calibration and measurement capability, metrological competence of the Centre and the traceability of calibration results to the national and International standards of the International System of Units (SI).
This certificate may not be partially reproduced, except with the prior written permission of the issuing Centre.

I risultati di misura riportati nel presente Certificato sono stati ottenuti applicando le procedure di taratura citate alla pagina seguente, dove sono specificati anche i campioni o gli strumenti che garantiscono la catena di riferibilità del Centro e i rispettivi certificati di taratura in corso di validità. Essi si riferiscono esclusivamente all'oggetto in taratura e sono validi nel momento e nelle condizioni di taratura, salvo diversamente specificato.

The measurement results reported in this Certificate were obtained following the calibration procedures given in the following page, where the reference standards or instruments are indicated which guarantee the traceability chain of the laboratory, and the related calibration certificates in the course of validity are indicated as well. They relate only to the calibrated item and they are valid for the time and conditions of calibration, unless otherwise specified.

Le incertezze di misura dichiarate in questo documento sono state determinate conformemente alla Guida ISO/IEC 98 e al documento EA-4/02. Solitamente sono espresse come incertezza estesa ottenuta moltiplicando l'incertezza tipo per il fattore di copertura *k* corrispondente ad un livello di fiducia di circa il 95 %. Normalmente tale fattore *k* vale 2.

The measurement uncertainties stated in this document have been determined according to the ISO/IEC Guide 98 and to EA-4/02. Usually, they have been estimated as expanded uncertainty obtained multiplying the standard uncertainty by the coverage factor k corresponding to a confidence level of about 95%. Normally, this factor k is 2.

Direzione Tecnica
(Approving Officer)

Enrico Reccagni

Enrico Reccagni

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CARATTERISTICHE DELLO STRUMENTO IN TARATURA/ Properties of devices under calibration

Misuratore di pressione elettronico ***Electrical pressure gauge***	
Tipo *Model*	Misuratore di pressione elettronico Electrical pressure gauge
Numero di matricola *Serial No.*	1A014ILJJIM
Campo di misura *Scale range*	(0 ... 1000) bar g
Accuratezza dichiarata dal costruttore *Accuracy declared by the manufacturer*	0,1 % FS
Risoluzione *Resolution (scale division)*	0,1 bar
Tag. N. *Tag No.*	--

Procedura di taratura e catena di riferibilità
Calibration procedure and traceability chain

La taratura è stata effettuata in accordo alla linea guida DKD-R 6-1 "Taratura di strumenti di pressione" (versione 03/2014) procedura B, per confronto fra i valori dello strumento in taratura con quelli di riferimento dati dal campione di lavoro.

Calibration was carried out according to DKD-R 6-1 "Kalibrierung von Druckmessgeräten" (Ausgabe 03/2014) procedure B, by comparing the measured values of the calibration item with those of the reference or working standard.

I risultati riportati sono stati ottenuti applicando le procedure n° LMO-PT-01 rev.2

The results have been obtained using the procedures n° LMO-PT-01 rev.2

La catena di riferibilità ha inizio dai campioni di riferimento n° PM1-09

The traceability chain starts from the reference standards n° PM1-09

muniti di certificati validi di taratura, rispettivamente n° D21090

with the relevant valid calibration certificates n° D21090

Luogo di taratura
Place of calibration

Laboratorio WIKA ITALIA - Laboratorio di Modugno (BA)
WIKA ITALY Laboratory - Modugno (BA)

Campione di lavoro
Working Standard

Norma di riferimento (RS) Bilancia di pressione ***Reference standard (RS) Dead-weight tester***	
Tipo *Model*	PM1-09
Certificato di taratura *Calibration mark*	D-K-15105/D21090
Campo di misura *Scale range*	(10 ... 2500) bar g
Accuratezza *Accuracy*	0,015 % della lettura + 255 Pa

Operatore
Technichian

Francesco Donatelli

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Condizioni di misura
Measurement conditions

Schema di collegamento *Assembly*	
Fluido utilizzato *Pressure medium*	Sebacate *Sebacate*
Livello di riferimento *Refence height (for reference value)*	Superficie di tenuta DUT *Sealing face DUT*
Posizione di montaggio *Position during calibration*	verticale *vertical*

Note di taratura
Calibration Note

Lo strumento è stato tarato e riconsegnato nelle stesse condizioni in cui è arrivato nel laboratorio, in accordo con il metodo "as found as left" / The device under test (DUT) was calibrated in the same conditions it was arrived in laboratory, according to the method "as found as left".

Condizioni Ambientali
Environmental conditions

Temperatura *Temperature*	(22 ± 1,5)	°C
Pressione atmoferica *Atmospheric pressure*	(1009,3 ± 0,2)	hPa
Umidità relativa *Rel. Humidity*	(50 ± 15)	% UR

I dati meteo sono stati acquisiti tramite stazione meteo WIKA CPU6000-W s/n.1A00VCX6GJ2

Weather data were acquired via the WIKA CPU6000-W weather station s/n.1A00VCX6GJ2

Misure rilevate
Measurement results

Valore di riferimento *Reference value RS* bar	**Letture** *Reading DUT* bar		
	M1	**M2**	**M3**
0,00	0,0	0,0	0,0
99,91	99,9	99,9	99,9
199,82	199,9	199,9	199,9
299,73	299,8	299,8	299,8
399,63	399,7	399,7	399,7
499,53	499,5	499,6	499,6
599,44	599,4	599,4	599,4
699,34	699,3	699,3	699,3
799,25	799,1	799,2	799,1
899,14	899,0	899,1	899,0
999,04	999,0	999,0	999,0

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it


Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Incertezza di misura
Uncertainty of measurement

Valori di riferimento *Reference value RS* bar	Media delle misure *Mean value* bar	Errore *Error* bar	Ripetibilità *Repeatability* bar	Isteresi *Hysteresis* bar	Incertezza di misura *Meas. Uncertainty* bar
0,00	0,0	0,0	0,0	0,0	0,40
99,91	99,9	0,0	0,0	0,0	0,40
199,82	199,9	0,1	0,0	0,0	0,40
299,73	299,8	0,1	0,0	0,0	0,40
399,63	399,7	0,1	0,0	0,0	0,40
499,53	499,6	0,1	0,1	0,1	0,40
599,44	599,4	0,0	0,0	0,0	0,40
699,34	699,3	0,0	0,0	0,0	0,40
799,25	799,2	0,0	0,0	0,1	0,40
899,14	899,1	0,0	0,0	0,1	0,40
999,04	999,0	0,0	0,0	0,0	0,40

Grafico degli errori di misura
Graphical representation of measurement uncertainty

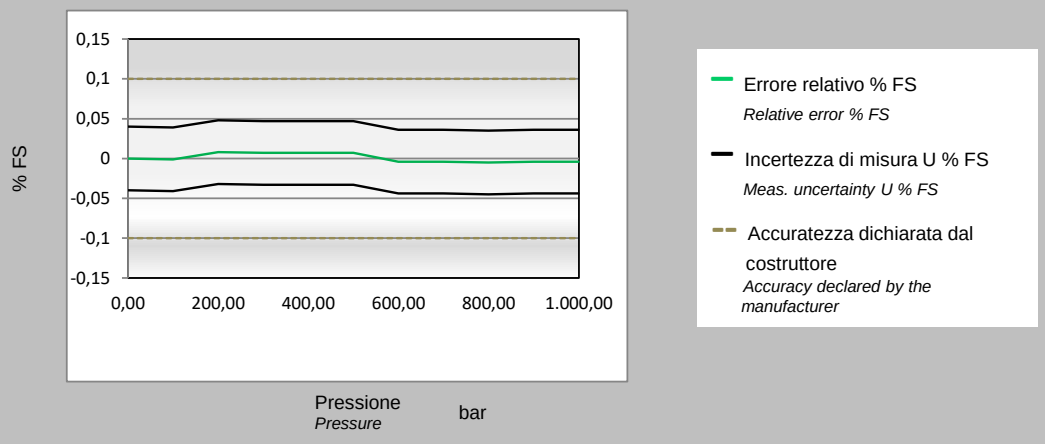

L'incertezza estesa senza correzione del DUT è pari a 0,5 bar
The expanded uncertainty of the DUT without correction is equal to

Questo dato è ottenuto come MAX{Incertezza_di_misura$_i$ + |Errore$_i$|} della tabella precedente
This data is obatined as MAX{Meas._uncertainty$_i$ + |Error$_i$|} of the previous table

Il presente certificato non rappresenta una dichiarazione di conformità a specifica
This certificate is not a statement of compliance

ITEM	Tag	AV-63002/25-XV-014	: Pneumatic Connection Air Supply - 25-XV-014		Dwg	123A90-DDL-IN-LIS-40092	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10001948	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline Instrumental	Form	CJX06	Tubing Hydraulic

General

1	Drawings (P&ID tube) attached.	OK
2	Isometric drawings (P&ID pipe) attached.	NA
3	Check drawings at last revision.	OK
4	Material certificates for pipe/tube/fittings/flanges/hose and support clamps checked	OK
5	Welders certificates checked	NA
6	Certificate and mark-up drawings for welding WPS and WPQR and material certificates checked	NA
7	Certificates and mark-up drawings for NDT report checked	NA

Check before Flushing and/or Testing

8	Installation complete and in compliance with drawings and specifications.	OK
9	Tubing/Piping tray checked.	NA
10	Hose according to specifications and tightened	NA
11	Flanges - nuts and bolts tightened.	NA
12	Fittings are mounted and tightened.	OK
13	Pipe supports completed and installed as required.	OK
14	Cable ladders, trays, sharp edges protected, cut ends sealed.	NA
15	Maintenance evaluation.	OK

REFER TO FINAL SHEET FOR ACCEPTANCE

ITEM	Tag	AV-63002/25-XV-014	: Pneumatic Connection Air Supply - 25-XV-014	Dwg	123A90-DDL-IN-LIS-40092		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001948	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form CJX06	Tubing Hydraulic

Flushing / Pressure testing

16	Drawings of flushing loops (P&ID tube) attached	NA
17	Equipment & valves bypassed and blinded	OK
18	Calibration certificates attached	OK
19	Type of flushing medium correct	NA
20	Printout from recorder/particle counter	NA
21	Printout from pressure indicator	OK

Final Check

22	Final inspection of pipework.	OK
23	Preservation of tested pipework.	NA
24	System/equipment labelled with: "Hot Oil flushing performed".	NA
25	If required produce Red Line Mark Up for "AS BUILT"	

TEST SPECIFIED USED

TEST FLUID: IA TEST PRESSURE BAR G: 7.4 TEST DURATION : 12 MIN

TEST EQUIPMENT: CPG 1500 SERIAL N°: 1A014ILJJIM

HOOK UP DIAGRAM Number: 123A90-DDL-IN-HD-40078

Line FROM	Line TO	Tubing cleaned			Tubing flushed			Diam ID/OD
		Yes	No	N/A	Yes	No	N/A	
AV-63002	25-XV-014	●					●	1/2" OD x Thk. 0,049"

TESTED LABEL AFFIXED DATA SHEET ATTACHED

Comments:

	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Paolo Schintu	
Date	2025-01-24	2025-02-04	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-24T13:09:36.792Z	PROVERLIS Digitaly signed by Paolo Schintu 2025-02-04T11:42:48.426Z	

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	AV-63002/25-XV-014

Instrument

Strumento

Electrical pressure gauge *Misuratore di pressione elettronico*	
Model *Modello*	CPG1500
Serial number *Numero di serie*	1A014ILJJIM
Log temperature *Registrazioni di Temperatura*	Active *Attivo*
Scale range *Campo scala*	(0 ... 1000) bar a
Accuracy *Accuratezza*	0.1 % FS
Tag number *Numero tag*	
Communication *Comunicazione*	Wireless (00:13:43:85:DD:8D)

Measurement conditions

Condizioni di misura

Settings *Impostazioni*	
Mode *Modalità*	Automatic *Automatico*
Interval (ms) *Intervallo (ms)*	15000
Duration (hh:mm:ss) *Durata (hh:mm:ss)*	00:12:44
Start time (hh:mm:ss) *Tempo di avvio (hh:mm:ss)*	04:42:17 pm

Logger protocol

Protocollo di acquisizione elenco dati


ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	AV-63002/25-XV-014

Measurement results

Risultati della misura

Graphical representation of progression
Rappresentazione grafica dell'andamento

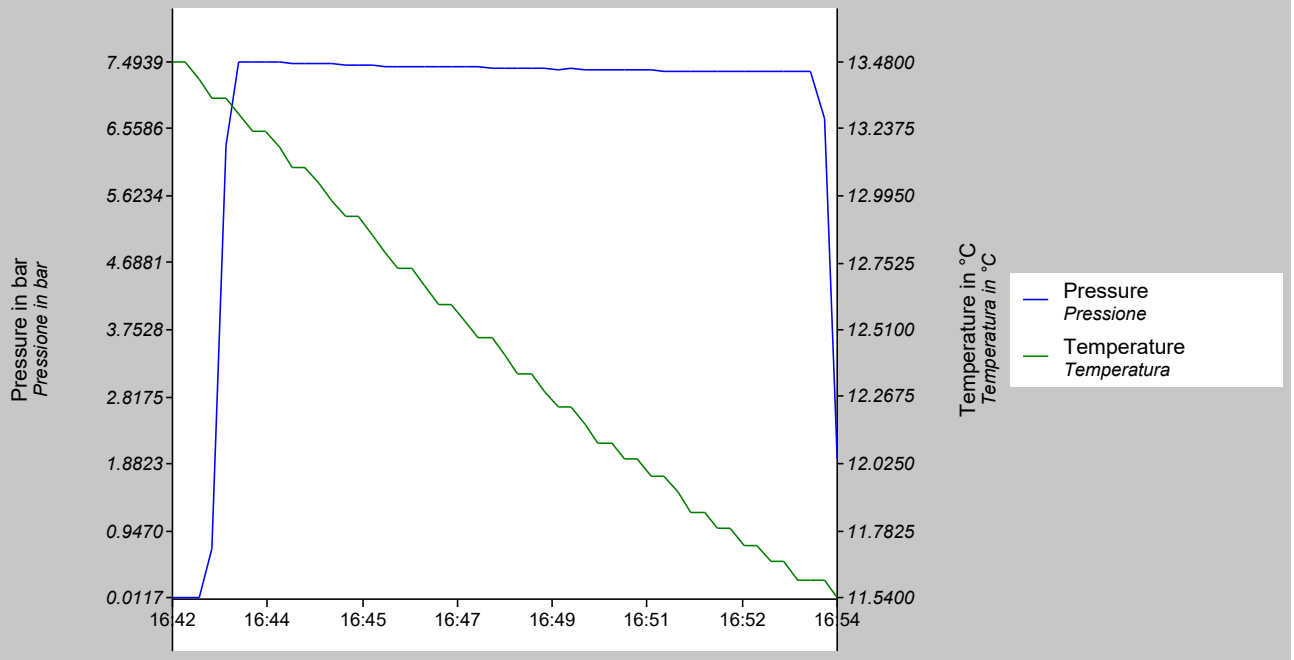

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/31/2025 16:42:17.000	0.0117	13.4800
01/31/2025 16:42:32.000	0.0166	13.4800
01/31/2025 16:42:47.000	0.0149	13.4200
01/31/2025 16:43:02.000	0.6832	13.3500
01/31/2025 16:43:17.000	6.3242	13.3500
01/31/2025 16:43:32.000	7.4883	13.2900
01/31/2025 16:43:47.000	7.4939	13.2300
01/31/2025 16:44:02.000	7.4839	13.2300
01/31/2025 16:44:17.000	7.4842	13.1700
01/31/2025 16:44:32.000	7.4761	13.1000
01/31/2025 16:44:47.000	7.4667	13.1000
01/31/2025 16:45:02.000	7.4671	13.0400
01/31/2025 16:45:17.000	7.4613	12.9800
01/31/2025 16:45:32.000	7.4587	12.9200
01/31/2025 16:45:47.000	7.4497	12.9200
01/31/2025 16:46:02.000	7.4468	12.8500
01/31/2025 16:46:17.000	7.4370	12.7900

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	AV-63002/25-XV-014

Measurement results

Risultati della misura

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/31/2025 16:46:32.000	7.4356	12.7300
01/31/2025 16:46:47.000	7.4341	12.7300
01/31/2025 16:47:02.000	7.4299	12.6700
01/31/2025 16:47:17.000	7.4258	12.6000
01/31/2025 16:47:32.000	7.4191	12.6000
01/31/2025 16:47:47.000	7.4170	12.5400
01/31/2025 16:48:02.000	7.4183	12.4800
01/31/2025 16:48:17.000	7.4117	12.4800
01/31/2025 16:48:32.000	7.4164	12.4200
01/31/2025 16:48:47.000	7.4103	12.3500
01/31/2025 16:49:02.000	7.4020	12.3500
01/31/2025 16:49:17.000	7.4016	12.2900
01/31/2025 16:49:32.000	7.3943	12.2300
01/31/2025 16:49:47.000	7.3963	12.2300
01/31/2025 16:50:02.000	7.3885	12.1700
01/31/2025 16:50:17.000	7.3821	12.1000
01/31/2025 16:50:32.000	7.3886	12.1000
01/31/2025 16:50:47.000	7.3832	12.0400
01/31/2025 16:51:02.000	7.3855	12.0400
01/31/2025 16:51:17.000	7.3764	11.9800
01/31/2025 16:51:32.000	7.3717	11.9800
01/31/2025 16:51:47.000	7.3714	11.9200
01/31/2025 16:52:02.000	7.3684	11.8500
01/31/2025 16:52:17.000	7.3613	11.8500
01/31/2025 16:52:32.000	7.3545	11.7900
01/31/2025 16:52:47.000	7.3614	11.7900
01/31/2025 16:53:02.000	7.3569	11.7300
01/31/2025 16:53:17.000	7.3594	11.7300
01/31/2025 16:53:32.000	7.3554	11.6700
01/31/2025 16:53:47.000	7.3574	11.6700
01/31/2025 16:54:02.000	7.3604	11.6000
01/31/2025 16:54:17.000	7.3614	11.6000
01/31/2025 16:54:32.000	6.7070	11.6000
01/31/2025 16:54:47.000	1.9403	11.5400

CROSSWIND

HOLLANDSE KUST NOORD WIND PARK Project
Contract No. CW-I-WP4-2023-05

INSTRUMENT TUBING LIST


ROSETTI MARINO


Sh. 4 of 4 REV. 00 01 02 03 04 — X X X X X


				DATA TUBING													FROM AREA					TO AREA					
POS.	REV	SUPPLY SCOPE	LAINING SCOPE	TAG Tubing	P&ID	MAIN FUNCTION	SERVICE	DESIGN TEMPERATURE(C°)	OPERATING PRESSURE (Barg)	DESIGN PRESSURE (Barg)	TEST PRESSURE (Barg)	FLUID TEST	DIMENSIONS	MATERIAL	REF. DOC.	Q.TY (m)	FIRE PROOFING	HEAT TRACING	MODULE	AREA	FROM ITEM	REF. P&I	DESCRIPTION	MODULE	AREA	TO ITEM	REF. LAYOUT	DESCRIPTION	NOTE
01	04	RM	RM	**AV-63001/25-XV-011**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N_2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-XV-011	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
02	04	RM	RM	**AV-63001/25-FV-033**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-FV-033	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
03	04	RM	RM	**AV-63001/25-XV-008**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-XV-008	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
04	04	RM	RM	**AV-63001/25-FV-032**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-FV-032	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
05	04	RM	RM	**AV-63002/25-XV-020**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-020	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
06	04	RM	RM	**AV-63002/25-FV-036**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**11**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-036	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
07	04	RM	RM	**AV-63002/25-XV-017**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-017	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
08	04	RM	RM	**AV-63002/25-FV-038**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-038	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
09	04	RM	RM	**AV-63002/25-XV-014**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-014	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
10	04	RM	RM	**AV-63002/25-FV-034**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-034	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
11	04	RM	RM	**AV-63003/25-BDV-010**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-BDV-010	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
12	04	RM	RM	**AV-63003/25-PV-040**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-PV-040	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
13	04	RM	RM	**AV-63003/25-XV-012**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-XV-012	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
14	04	RM	RM	**AV-63003/25-XV-009**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**13**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-XV-009	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
15	04	RM	RM	**AV-63004/25-BDV-013**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-BDV-013	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
16	04	RM	RM	**AV-63004/25-PV-043**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-PV-043	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
17	04	RM	RM	**AV-63004/25-XV-015**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-XV-015	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
18	04	RM	RM	**AV-63005/64-PV-031A**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Lower Deck	AV-63005	123A90-DDL-PR-PID-80041	Distribution Pot 5	BLPH	Lower Deck	64-PV-031A	123A90-DDL-IN-DL-40080	Pneumatic Control Valve	Design Pressure set as per downstream PSV
19	04	RM	RM	**AV-63005/64-PV-031B**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**3**	N.A.	N.A.	BLPH	Lower Deck	AV-63005	123A90-DDL-PR-PID-80041	Distribution Pot 5	BLPH	Lower Deck	64-PV-031B	123A90-DDL-IN-DL-40080	Pneumatic Control Valve	Design Pressure set as per downstream PSV
20	04	RM	RM	**AV-63006/25-BDV-022**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-BDV-022	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
21	04	RM	RM	**AV-63006/25-XV-021**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-XV-021	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
22	04	RM	RM	**AV-63006/25-PV-049**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-PV-049	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
23	04	RM	RM	**AV-63006/25-BDV-019**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-BDV-019	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
24	04	RM	RM	**AV-63006/80-XV-001**	123A90-DDL-PR-PID-80012	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	80-XV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
25	04	RM	RM	**AV-63007/25-XV-006**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-XV-006	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
26	04	RM	RM	**AV-63007/25-PV-035**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**11**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-PV-035	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
27	04	RM	RM	**AV-63007/25-BDV-005**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-BDV-005	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
28	04	RM	RM	**AV-63007/25-PV-037**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-PV-037	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
29	04	RM	RM	**AV-63007/25-BDV-007**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-BDV-007	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
30	04	RM	RM	**AV-63008/50-XV-001**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-001	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
31	04	RM	RM	**AV-63008/50-XV-002**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-002	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
32	04	RM	RM	**AV-63008/50-XV-003**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-003	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
33	04	RM	RM	**AV-63008/50-XV-004**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-004	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
33A	04	RM	RM	**AV-63009/50-XV-005**	123A90-DDL-PR-PID-80025	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Lower Deck	AV-63009	123A90-DDL-PR-PID-80041	Distribution Pot 9	BLPH	Lower Deck	50-XV-005	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
34	04	RM	RM	**AV-63010/25-SDV-001**	123A90-DDL-PR-PID-80013	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-SDV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
35	04	RM	RM	**AV-63010/25-XV-024**	123A90-DDL-PR-PID-80013	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-XV-024	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
36	04	RM	RM	**AV-63010/25-XV-004**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-XV-004	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
37	04	RM	RM	**AV-63010/25-FV-031**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-FV-031	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
38	04	RM	RM	**AV-63010/64-SDV-001**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**15**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	64-SDV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
39	04	RM	RM	**AV-63011/25-SDV-023**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-SDV-023	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
40	04	RM	RM	**AV-63011/25-PV-055A**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-PV-055A	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
41	04	RM	RM	**AV-63011/25-PV-055B**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-PV-055B	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
42	04	RM	RM	**AV-63012/25-XV-018**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-XV-018	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
43	04	RM	RM	**AV-63012/25-PV-046**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-PV-046	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
44	04	RM	RM	**AV-63012/25-BDV-016**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-BDV-016	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
~~45~~	03	DELETED	DELETED	~~**BLPH-MV-014/25-PT-001**~~	~~123A90-DDL-PR-PID-80013~~	~~Process Connection~~	~~Hydrogen~~	~~80~~	~~7,5 / 30~~	~~40~~	~~7,5 / 30~~	~~N_2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-014~~	~~123A90-DDL-PR-PID-80013~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25-PT-001~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~46~~	03	DELETED	DELETED	~~**BLPH-MV-013/25-PT-002**~~	~~123A90-DDL-PR-PID-80013~~	~~Process Connection~~	~~Hydrogen~~	~~80~~	~~7,5 / 30~~	~~40~~	~~7,5 / 30~~	~~N_2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-013~~	~~123A90-DDL-PR-PID-80013~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25-PT-002~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~47~~	03	DELETED	DELETED	~~**BLPH-MV-025/26-PT-055A**~~	~~123A90-DDL-PR-PID-80014~~	~~Process Connection~~	~~Hydrogen~~	~~100~~	~~17,7~~	~~10~~	~~17,7~~	~~N_2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-025~~	~~123A90-DDL-PR-PID-80014~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~26-PT-055A~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~48~~	03	DELETED	DELETED	~~**BLPH-MV-213/26-PT-055B**~~	~~123A90-DDL-PR-PID-80014~~	~~Process Connection~~	~~Hydrogen~~	~~100~~	~~3,5 / 6,5~~	~~10~~	~~3,5 / 6,5~~	~~N_2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-213~~	~~123A90-DDL-PR-PID-80014~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25-PT-055B~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~49~~	03	DELETED	DELETED	~~**BLPH-MV-407/43-PT-001**~~	~~123A90-DDL-PR-PID-80029~~	~~Process Connection~~	~~Hydrogen~~	~~-10 / +80~~	~~ATM~~	~~3,5~~	~~ATM~~	~~N_2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-407~~	~~123A90-DDL-PR-PID-80029~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~43-PT-001~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~50~~	03	DELETED	DELETED	~~**BLPH-MV-411/50-PT-014**~~	~~123A90-DDL-PR-PID-80026~~	~~Process Connection~~	~~Waste Water~~	~~100~~	~~ATM~~	~~17,7~~	~~ATM~~	~~N_2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~YES~~	~~BLPH~~	~~Lower Deck~~	~~BLPH-MV-411~~	~~123A90-DDL-PR-PID-80026~~	~~Manual Valve~~	~~BLPH~~	~~Lower Deck~~	~~60-PT-014~~	~~123A90-DDL-IN-DL-40080~~	~~Pressure Transmitter~~	
~~51~~	03	DELETED	DELETED	~~**BLPH-MV-150/63-PT-003**~~	~~123A90-DDL-PR-PID-80027~~	~~Process Connection~~	~~Instrument Air~~	~~100~~	~~4 / 10~~	~~11~~	~~4 / 10~~	~~N_2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-150~~	~~123A90-DDL-PR-PID-80027~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~63-PT-003~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~52~~	03	DELETED	DELETED	~~**BLPH-MV-151/63-PT-004**~~	~~123A90-DDL-PR-PID-80027~~	~~Process Connection~~	~~Instrument Air~~	~~100~~	~~4 / 10~~	~~11~~	~~4 / 10~~	~~N_2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-151~~	~~123A90-DDL-PR-PID-80027~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~63-PT-004~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
53	04	RM	RM	**BLPH-MV-386/64-PT-031A**	123A90-DDL-PR-PID-80027	Process Connection	Nitrogen Gas	100	6	10	11	N2 / Dry Air


DRAWING NO. 12390-DDL-IN-DL-40085

REV. 01

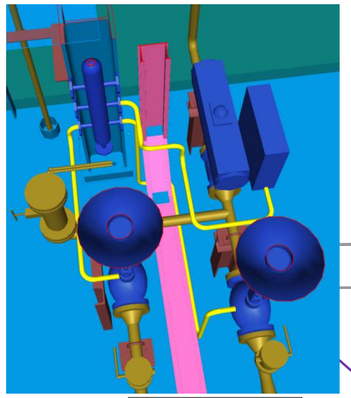

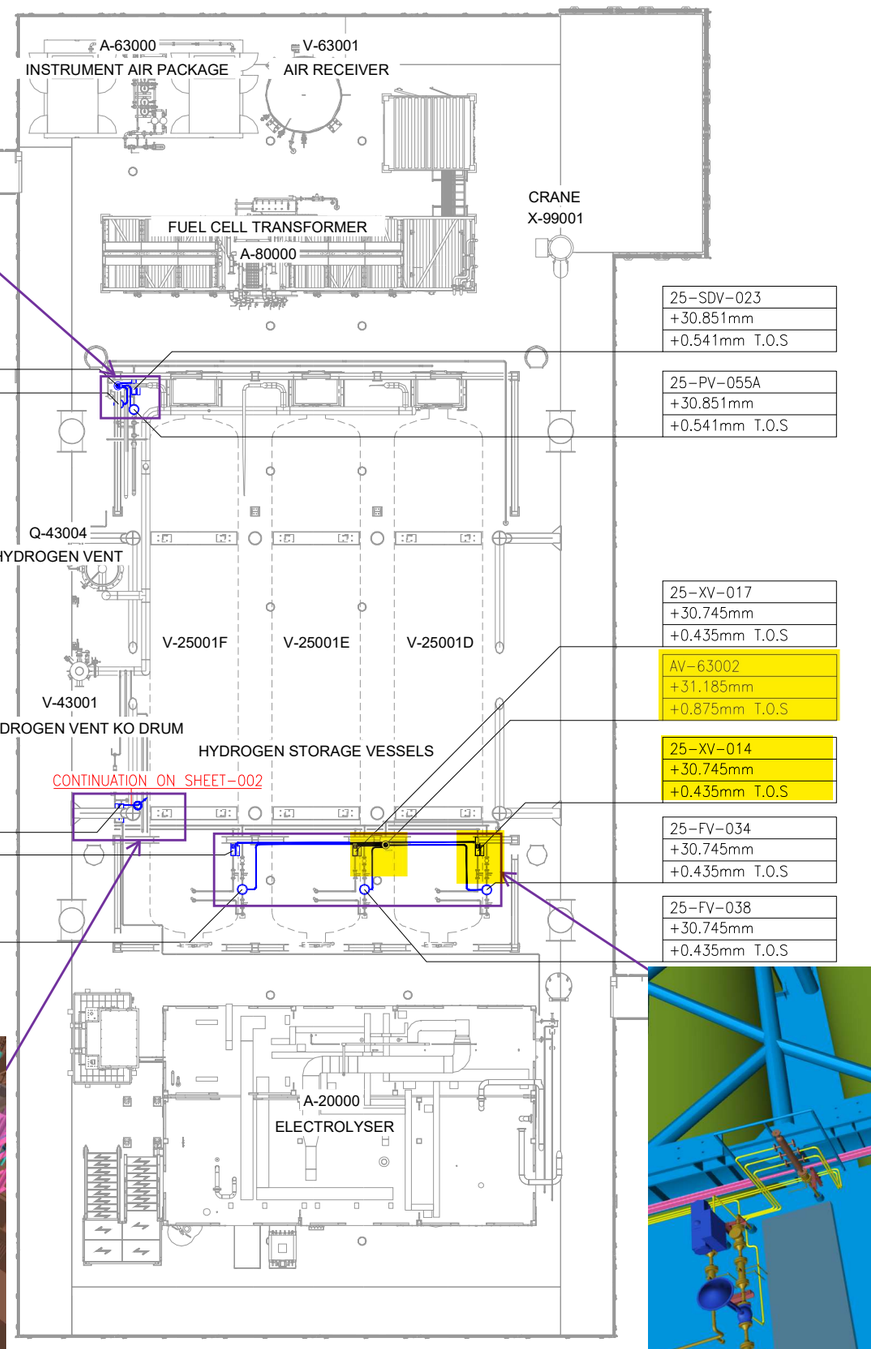

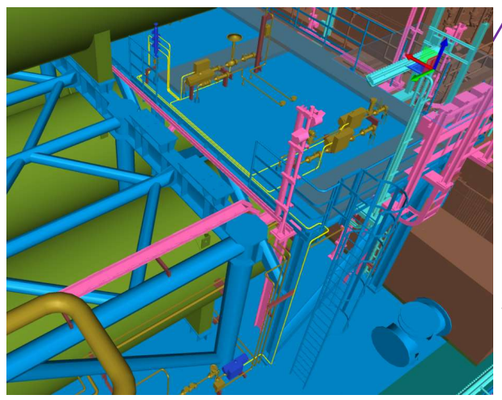

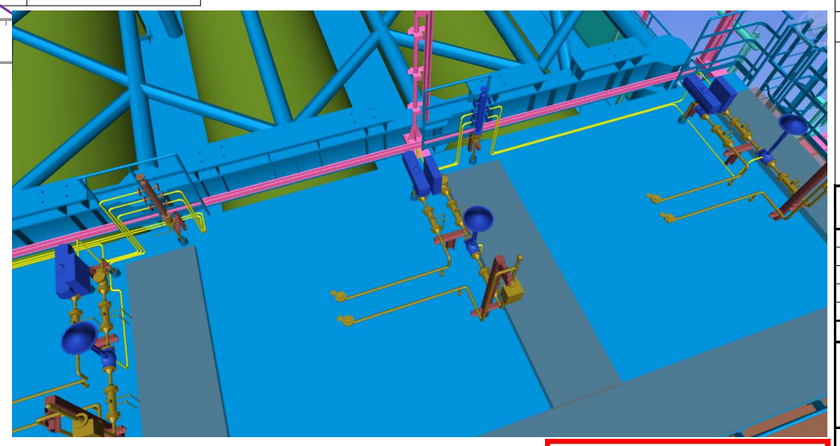


AV-63002

25-XV-020		25-FV-038
25-FV-036		25-XV-014
25-XV-017		25-FV-034

AV-63011

SPARE		25-SDV-023
SPARE		25-PV-055A
SPARE		25-PV-055B

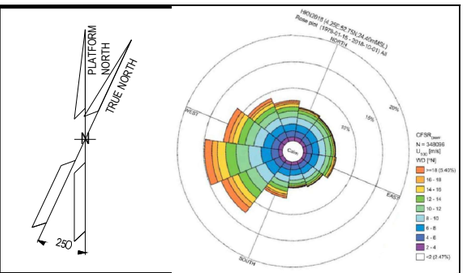

NOTES

1) TUBING ROUTING > 2m IS SHOWN AND IT IS INDICATIVE ONLY.
TUBING ROUTING SHALL BE FINALIZED DURING CONSTRUCTION ACTIVITIES.

LEGEND

- AIR DISTRIBUTION POT
- CONTROL VALVE
- ON-OFF VALVE
- TUBING
- TUBING GOING UP
- TUBING GOING DOWN

HOLDS

REFERENCE DOCUMENTS

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	23/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/02/24	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT TUBING LAYOUT
ELEVATION 30.310 m

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40085**

REV.:	DATE:	SIGNATURE:
1_C	12/12/24	C.Pilato

ROSETTI MARINO SpA

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK | SCALE 1:100

DRAWN DRAWN_BY | CHECKED CHECKED_BY | APPROVED APPROVED_BY | DATE DD/MM/YY

A1 | DRAWING NO. 123A90-DDL-IN-DL-40085 | SHEET 001 | REV. 01

File Name : 12390-DDL-IN-DL-40085_Rev.01

UPPER DECK

SCALE: 1:1

VIEW EL. 29310mm to 33740mm


DRAWING NO. DRAWING_NO.

REV. REV

V-25001_D

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

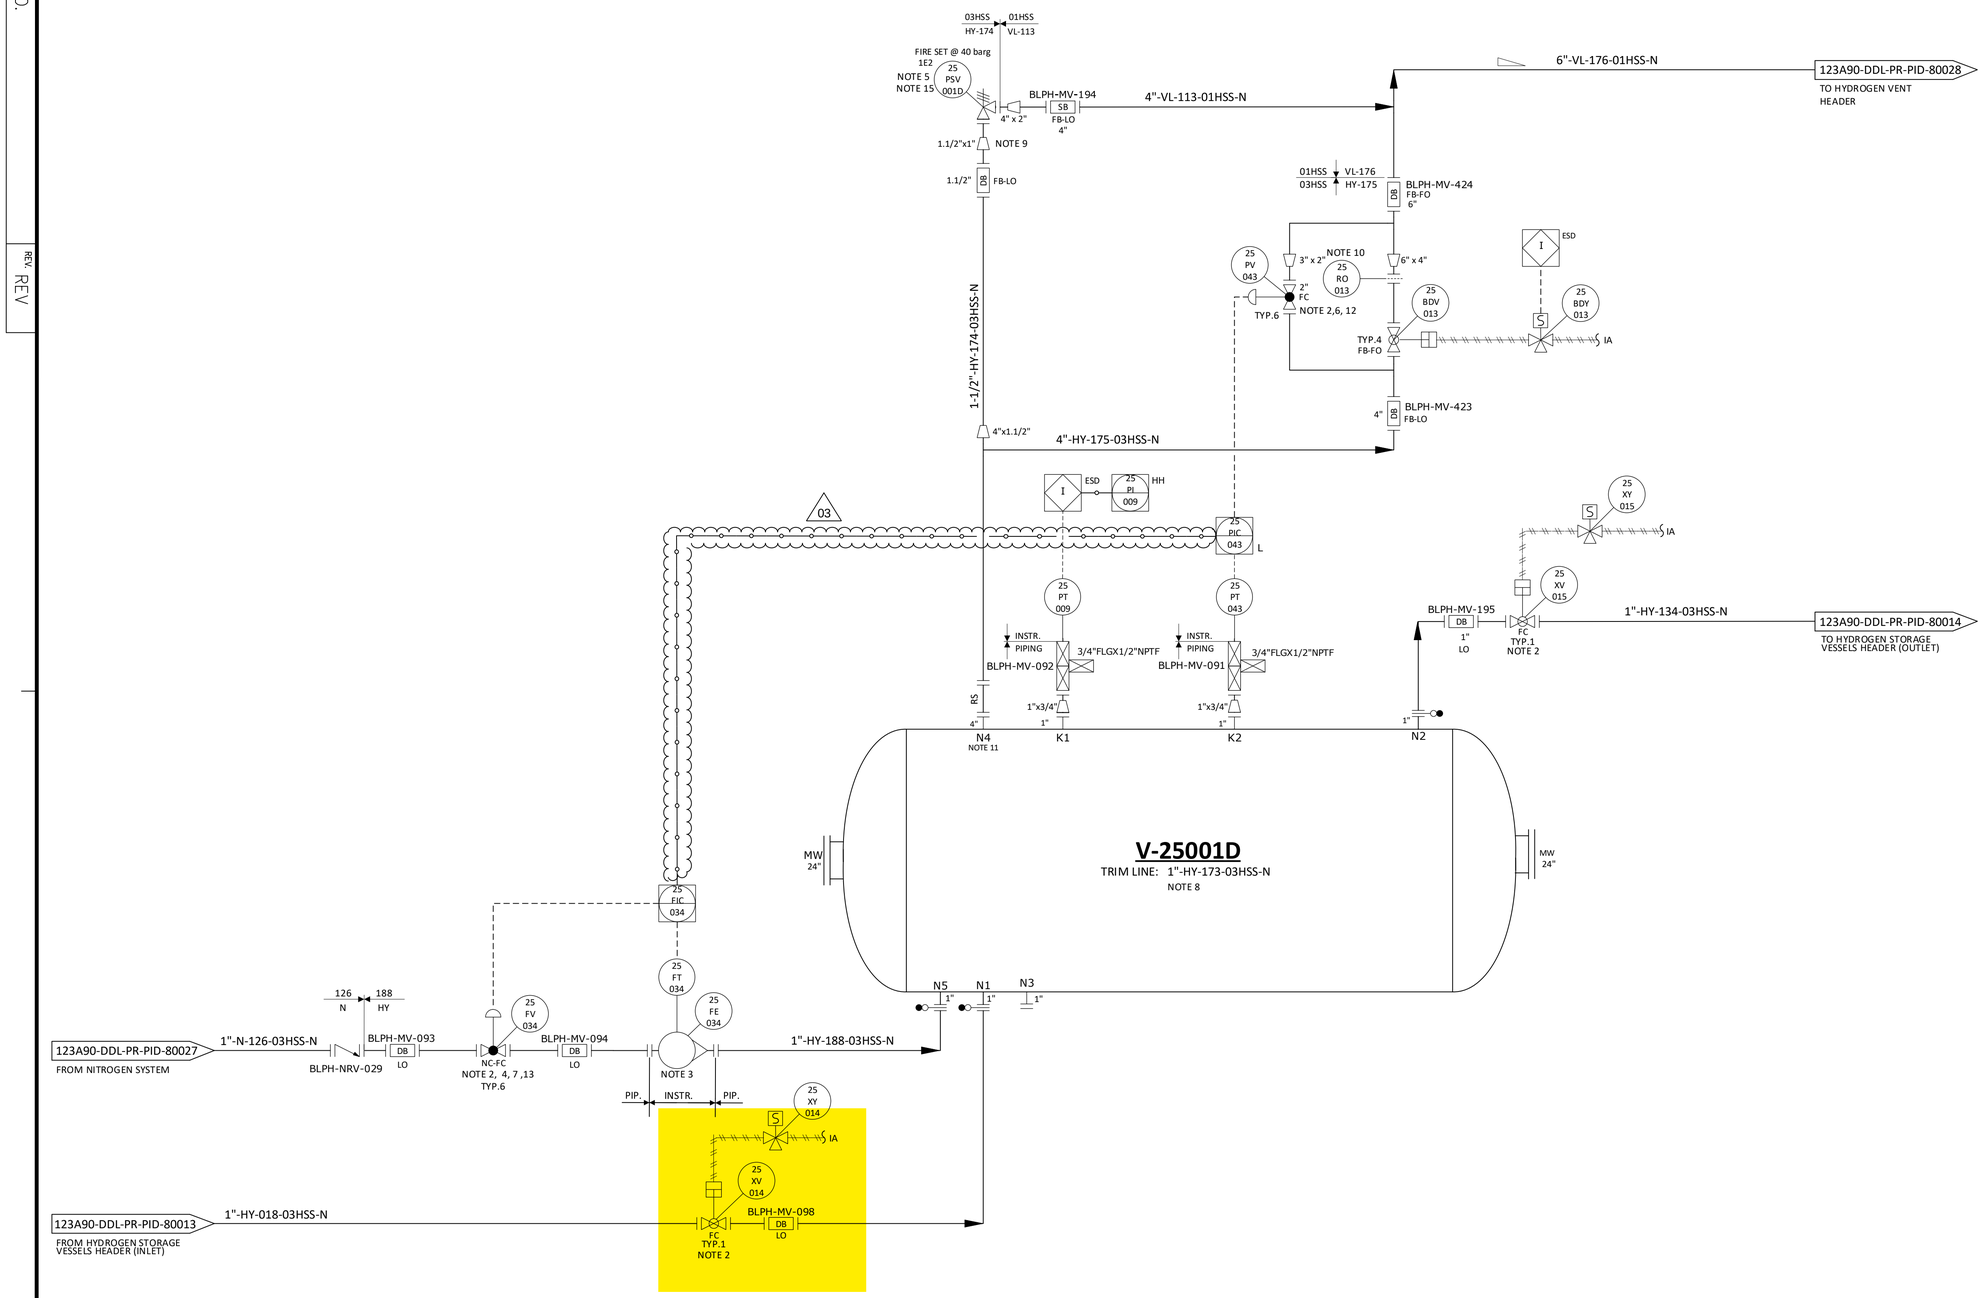

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS. 03
4. NITROGEN CONTROL VALVE (25-FV-034) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE.
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-043 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-043 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-034 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-043 HAS FAILED TO CLOSE.
15. 25-PSV-001D SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL D

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO. 123A90-DDL-PR-PID-80018	SHEET 001	REV. 03

File Name : FILE_NAME


CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Pneumatic Hook-Ups	Sh. 6 of 6 Date: 08/07/2024 Rev. 01

PNEUMATIC HOOK-UP FOR ON-OFF VALVES

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40078**

REV.:	DATE:	SIGNATURE:
1_B	06/11/24	G.Randi

ROSETTI MARINO SpA



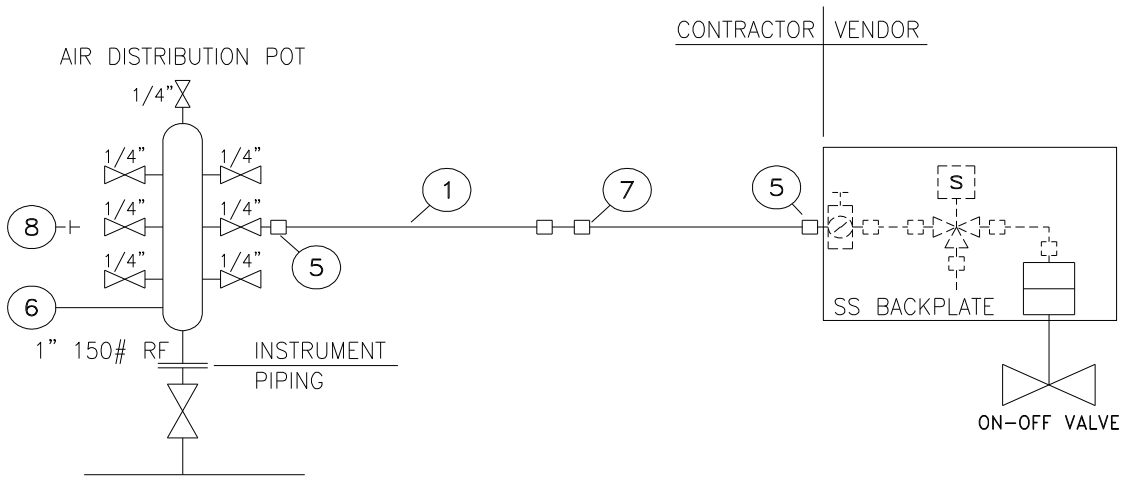


INSTRUMENT TAG	
1	25-BDV-022
2	25-BDV-005
3	25-BDV-007
4	25-BDV-010
5	25-BDV-013
6	25-BDV-016
7	25-BDV-019
8	25-SDV-001
9	25-SDV-023
10	25-XV-004
11	25-XV-006
12	25-XV-008
13	25-XV-009
14	25-XV-011
15	25-XV-012
16	25-XV-014
17	25-XV-015
18	25-XV-017
19	25-XV-018
20	25-XV-020
21	25-XV-021
22	25-XV-024
23	50-XV-001
24	50-XV-002
25	50-XV-003
26	50-XV-004
27	80-XV-001
28	64-SDV-001
29	50-XV-005
30	

NOTE:
(1) For Air Distribution Pot quantities see material take-off on sh. 4

POS.	NORM/STD CODE	DESCRIPTION	SIZE/CONNECTION TYPE	Q.TY
8		SS316 PLUG	1/4" NPT	Note 1
7		SS316 UNION	1/2" O.D. x 1/2" O.D.	N. 1
6		SS316 AIR DISTRIBUTION POT	1" 150#RF - N. 7 1/4" BALL VALVES	Note 1
5		SS316 MALE CONNECTOR	1/4" NPT x 1/2" O.D.	N. 2
1		SS 316L TUBING	1/2" x 0,049"Thk	10 m

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

POS	PICTURE	DESCRIPTION		ITEM ID CODE	TOTAL					
		COMPRESSION FITTING TYPE: **DOUBLE FERRULE** THREADING: ASME B1.20.1 NPT MATERIAL: AISI 316 WORKING PRESSURE AS PER ASME B31.1 TUBING TYPE: ■ INCHES ☐ METRIC			UNIT	Counted	Required			
							Rev. 00	Rev. 01	Rev.	Rev.
1		STRAIGHT MALE CONNECTOR	1/2" NPT-M x 3/8" O.D.		nr.					
2			1/4" NPT-M x 1/2" O.D.		nr.	102	102	102		
3			1/2" NPT-M x 1/2" O.D.		nr.	36	36	-		
4			1/2" NPT-M x 3/4" O.D.		nr.					
5			3/4" NPT-M x 3/4" O.D.		nr.					
6			3/8" NPT-M x 3/8" O.D.		nr.					
7		STRAIGHT FEMALE CONNECTOR	1/2" NPT-F x 3/8" O.D.		nr.					
8			1/4" NPT-F x 1/2" O.D.		nr.					
9			1/2" NPT-F x 1/2" O.D.		nr.					
10			1/2" NPT-F x 3/4" O.D.		nr.					
11		UNION CONNECTOR	1/4" O.D. x 1/4" O.D.		nr.					
12			3/8" O.D. x 3/8" O.D.		nr.					
13			1/2" O.D. x 1/2" O.D.		nr.	49	49	49		
14			3/4" O.D. x 3/4" O.D.		nr.					
15		ELBOW CONNECTOR	1/4" NPT-M x 1/2" O.D.		nr.	27	27	27		
16			1/2" NPT-M x 1/2" O.D.		nr.					
17										
18										
19										
20										
21										
22										
23										
24										
25										
26										
27										
28										
29										
30										
27										
28										
29										
30										
31										
32										
33										
34										

VENDOR / ORDER : **AF SYSTEM / 1724001332**

MATERIAL :

- ☐ ASTM A106 Gr.B
- ■ AISI 316 L
- ☐ UNS S31254

SPECIAL REQUIREMENTS :

- ☐ ...

REMARKS :

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CERTIFICATO DI TARATURA LAT 114 0435-SM-24
Certificate of Calibration

- data di emissione date of issue	2024-09-20
- cliente customer	FAST AUTOMATION SRL VIA DELLA PREVIDENZA SOCIALE, 8 IT-42124 REGGIO EMILIA (RE)
- destinatario receiver	ROSETTI MARINO SPA - YARD PIOMBONI VIA DEL MARCHESATO, 37 IT-48122 MARINA DI RAVENNA (RA)

Si riferisce a
referring to

- oggetto *item*	Misuratore di pressione elettronico Electrical pressure gauge
- costruttore *manufacturer*	WIKA
- modello *model*	CPG1500
- matricola *serial number*	1A014ILJJIM
- data di ricev. oggetto *date of receipt of item*	2024-09-17
- data delle misure *date of measurements*	2024-09-20
- registro di laboratorio *laboratory reference*	0435-SM-24

Il presente certificato di taratura è emesso in base all'accreditamento LAT N. 114 rilasciato in accordo ai decreti attuativi della legge n. 273/1991 che ha istituito il Sistema Nazionale di Taratura (SNT). ACCREDIA attesta le capacità di misura e di taratura, le competenze metrologiche del Centro e la riferibilità delle tarature eseguite ai campioni nazionali ed internazionali delle unità del Sistema Internazionale delle Unità (SI).
Questo certificato non può essere riprodotto in modo parziale, salvo espressa autorizzazione scritta da parte del Centro.

This certificate of calibration is issued in compliance with the accreditation LAT No.114 granted according to decrees connected with Italian law No. 273/1991 which has established the National Calibration System. ACCREDIA attests the calibration and measurement capability, metrological competence of the Centre and the traceability of calibration results to the national and International standards of the International System of Units (SI).
This certificate may not be partially reproduced, except with the prior written permission of the issuing Centre.

I risultati di misura riportati nel presente Certificato sono stati ottenuti applicando le procedure di taratura citate alla pagina seguente, dove sono specificati anche i campioni o gli strumenti che garantiscono la catena di riferibilità del Centro e i rispettivi certificati di taratura in corso di validità. Essi si riferiscono esclusivamente all'oggetto in taratura e sono validi nel momento e nelle condizioni di taratura, salvo diversamente specificato.

The measurement results reported in this Certificate were obtained following the calibration procedures given in the following page, where the reference standards or instruments are indicated which guarantee the traceability chain of the laboratory, and the related calibration certificates in the course of validity are indicated as well. They relate only to the calibrated item and they are valid for the time and conditions of calibration, unless otherwise specified.

Le incertezze di misura dichiarate in questo documento sono state determinate conformemente alla Guida ISO/IEC 98 e al documento EA-4/02. Solitamente sono espresse come incertezza estesa ottenuta moltiplicando l'incertezza tipo per il fattore di copertura *k* corrispondente ad un livello di fiducia di circa il 95 %. Normalmente tale fattore *k* vale 2.

The measurement uncertainties stated in this document have been determined according to the ISO/IEC Guide 98 and to EA-4/02. Usually, they have been estimated as expanded uncertainty obtained multiplying the standard uncertainty by the coverage factor k corresponding to a confidence level of about 95%. Normally, this factor k is 2.

Direzione Tecnica
(Approving Officer)

Enrico Reccagni

Enrico Reccagni

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CARATTERISTICHE DELLO STRUMENTO IN TARATURA/ Properties of devices under calibration

Misuratore di pressione elettronico ***Electrical pressure gauge***	
Tipo *Model*	Misuratore di pressione elettronico Electrical pressure gauge
Numero di matricola *Serial No.*	1A014ILJJIM
Campo di misura *Scale range*	(0 ... 1000) bar g
Accuratezza dichiarata dal costruttore *Accuracy declared by the manufacturer*	0,1 % FS
Risoluzione *Resolution (scale division)*	0,1 bar
Tag. N. *Tag No.*	--

Procedura di taratura e catena di riferibilità
Calibration procedure and traceability chain

La taratura è stata effettuata in accordo alla linea guida DKD-R 6-1 "Taratura di strumenti di pressione" (versione 03/2014) procedura B, per confronto fra i valori dello strumento in taratura con quelli di riferimento dati dal campione di lavoro.

Calibration was carried out according to DKD-R 6-1 "Kalibrierung von Druckmessgeräten" (Ausgabe 03/2014) procedure B, by comparing the measured values of the calibration item with those of the reference or working standard.

I risultati riportati sono stati ottenuti applicando le procedure n° LMO-PT-01 rev.2

The results have been obtained using the procedures n° LMO-PT-01 rev.2

La catena di riferibilità ha inizio dai campioni di riferimento n° PM1-09

The traceability chain starts from the reference standards n° PM1-09

muniti di certificati validi di taratura, rispettivamente n° D21090

with the relevant valid calibration certificates n° D21090

Luogo di taratura
Place of calibration

Laboratorio WIKA ITALIA - Laboratorio di Modugno (BA)
WIKA ITALY Laboratory - Modugno (BA)

Campione di lavoro
Working Standard

Norma di riferimento (RS) Bilancia di pressione ***Reference standard (RS) Dead-weight tester***	
Tipo *Model*	PM1-09
Certificato di taratura *Calibration mark*	D-K-15105/D21090
Campo di misura *Scale range*	(10 ... 2500) bar g
Accuratezza *Accuracy*	0,015 % della lettura + 255 Pa

Operatore
Technichian

Francesco Donatelli

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Condizioni di misura
Measurement conditions

Schema di collegamento *Assembly*	
Fluido utilizzato *Pressure medium*	Sebacate *Sebacate*
Livello di riferimento *Refence height (for reference value)*	Superficie di tenuta DUT *Sealing face DUT*
Posizione di montaggio *Position during calibration*	verticale *vertical*

Note di taratura
Calibration Note

Lo strumento è stato tarato e riconsegnato nelle stesse condizioni in cui è arrivato nel laboratorio, in accordo con il metodo "as found as left" / The device under test (DUT) was calibrated in the same conditions it was arrived in laboratory, according to the method "as found as left".

Condizioni Ambientali
Environmental conditions

Temperatura *Temperature*	(22 ± 1,5)	°C
Pressione atmoferica *Atmospheric pressure*	(1009,3 ± 0,2)	hPa
Umidità relativa *Rel. Humidity*	(50 ± 15)	% UR

I dati meteo sono stati acquisiti tramite stazione meteo WIKA CPU6000-W s/n.1A00VCX6GJ2

Weather data were acquired via the WIKA CPU6000-W weather station s/n.1A00VCX6GJ2

Misure rilevate
Measurement results

Valore di riferimento *Reference value RS* bar	**Letture** *Reading DUT* bar		
	M1	**M2**	**M3**
0,00	0,0	0,0	0,0
99,91	99,9	99,9	99,9
199,82	199,9	199,9	199,9
299,73	299,8	299,8	299,8
399,63	399,7	399,7	399,7
499,53	499,5	499,6	499,6
599,44	599,4	599,4	599,4
699,34	699,3	699,3	699,3
799,25	799,1	799,2	799,1
899,14	899,0	899,1	899,0
999,04	999,0	999,0	999,0

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it


Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Incertezza di misura
Uncertainty of measurement

Valori di riferimento *Reference value RS* bar	Media delle misure *Mean value* bar	Errore *Error* bar	Ripetibilità *Repeatability* bar	Isteresi *Hysteresis* bar	Incertezza di misura *Meas. Uncertainty* bar
0,00	0,0	0,0	0,0	0,0	0,40
99,91	99,9	0,0	0,0	0,0	0,40
199,82	199,9	0,1	0,0	0,0	0,40
299,73	299,8	0,1	0,0	0,0	0,40
399,63	399,7	0,1	0,0	0,0	0,40
499,53	499,6	0,1	0,1	0,1	0,40
599,44	599,4	0,0	0,0	0,0	0,40
699,34	699,3	0,0	0,0	0,0	0,40
799,25	799,2	0,0	0,0	0,1	0,40
899,14	899,1	0,0	0,0	0,1	0,40
999,04	999,0	0,0	0,0	0,0	0,40

Grafico degli errori di misura
Graphical representation of measurement uncertainty

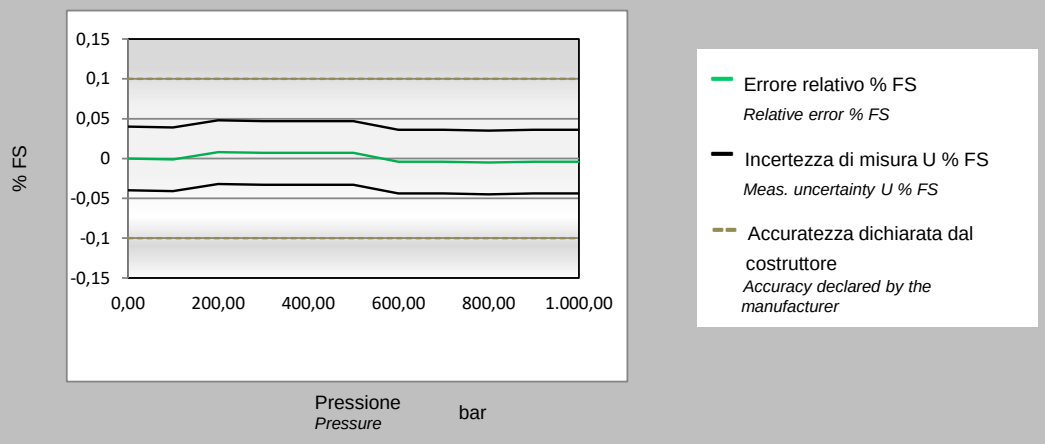

L'incertezza estesa senza correzione del DUT è pari a 0,5 bar
The expanded uncertainty of the DUT without correction is equal to

Questo dato è ottenuto come MAX{Incertezza_di_misura$_i$ + |Errore$_i$|} della tabella precedente
This data is obatined as MAX{Meas._uncertainty$_i$ + |Error$_i$|} of the previous table

Il presente certificato non rappresenta una dichiarazione di conformità a specifica
This certificate is not a statement of compliance

ITEM	Tag	AV-63010/25-SDV-001	: Pneumatic Connection Air Supply - 25-SDV-001			Dwg	123A90-DDL-IN-LIS-40092
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001973		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX06 Tubing Hydraulic

General

1	Drawings (P&ID tube) attached.	OK
2	Isometric drawings (P&ID pipe) attached.	NA
3	Check drawings at last revision.	OK
4	Material certificates for pipe/tube/fittings/flanges/hose and support clamps checked	OK
5	Welders certificates checked	NA
6	Certificate and mark-up drawings for welding WPS and WPQR and material certificates checked	NA
7	Certificates and mark-up drawings for NDT report checked	NA

Check before Flushing and/or Testing

8	Installation complete and in compliance with drawings and specifications.	OK
9	Tubing/Piping tray checked.	NA
10	Hose according to specifications and tightened	NA
11	Flanges - nuts and bolts tightened.	NA
12	Fittings are mounted and tightened.	OK
13	Pipe supports completed and installed as required.	OK
14	Cable ladders, trays, sharp edges protected, cut ends sealed.	NA
15	Maintenance evaluation.	OK

REFER TO FINAL SHEET FOR ACCEPTANCE

ITEM	Tag	AV-63010/25-SDV-001	: Pneumatic Connection Air Supply - 25-SDV-001	Dwg	123A90-DDL-IN-LIS-40092		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001973	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form CJX06	Tubing Hydraulic

Flushing / Pressure testing

16	Drawings of flushing loops (P&ID tube) attached	NA
17	Equipment & valves bypassed and blinded	OK
18	Calibration certificates attached	OK
19	Type of flushing medium correct	NA
20	Printout from recorder/particle counter	NA
21	Printout from pressure indicator	OK

Final Check

22	Final inspection of pipework.	OK
23	Preservation of tested pipework.	NA
24	System/equipment labelled with: "Hot Oil flushing performed".	NA
25	If required produce Red Line Mark Up for "AS BUILT"	

TEST SPECIFIED USED

TEST FLUID: IA TEST PRESSURE BAR G: 9 TEST DURATION : 12min

TEST EQUIPMENT: CPG 1500 SERIAL N°: 1A014ILJJIM

HOOK UP DIAGRAM Number: 123A90-DDL-IN-HD-40078

Line FROM	Line TO	Tubing cleaned			Tubing flushed			Diam ID/OD
		Yes	No	N/A	Yes	No	N/A	
AV-63010	25-SDV-001	●					●	1/2" OD x Thk. 0,049"

TESTED LABEL AFFIXED DATA SHEET ATTACHED

Comments:

	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM (ROSETTI MARINO)	
Name	Michele Tartaglia	Paolo Schintu	
Date	2025-01-24	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-24T13:11:36.913Z	PROVERLIS Digitaly signed by Paolo Schintu 2025-01-30T14:46:30.918Z	

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	AV-63010/25-SDV-001

Instrument

Strumento

Electrical pressure gauge *Misuratore di pressione elettronico*	
Model *Modello*	CPG1500
Serial number *Numero di serie*	1A014ILJJIM
Log temperature *Registrazioni di Temperatura*	Active *Attivo*
Scale range *Campo scala*	(0 ... 1000) bar a
Accuracy *Accuratezza*	0.1 % FS
Tag number *Numero tag*	
Communication *Comunicazione*	Wireless (00:13:43:85:DD:8D)

Measurement conditions

Condizioni di misura

Settings *Impostazioni*	
Mode *Modalità*	Automatic *Automatico*
Interval (ms) *Intervallo (ms)*	15000
Duration (hh:mm:ss) *Durata (hh:mm:ss)*	00:12:36
Start time (hh:mm:ss) *Tempo di avvio (hh:mm:ss)*	10:43:18 pm

Logger protocol

Protocollo di acquisizione elenco dati


ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	123A90-Tubing_2

Measurement results

Risultati della misura

Graphical representation of progression
Rappresentazione grafica dell'andamento

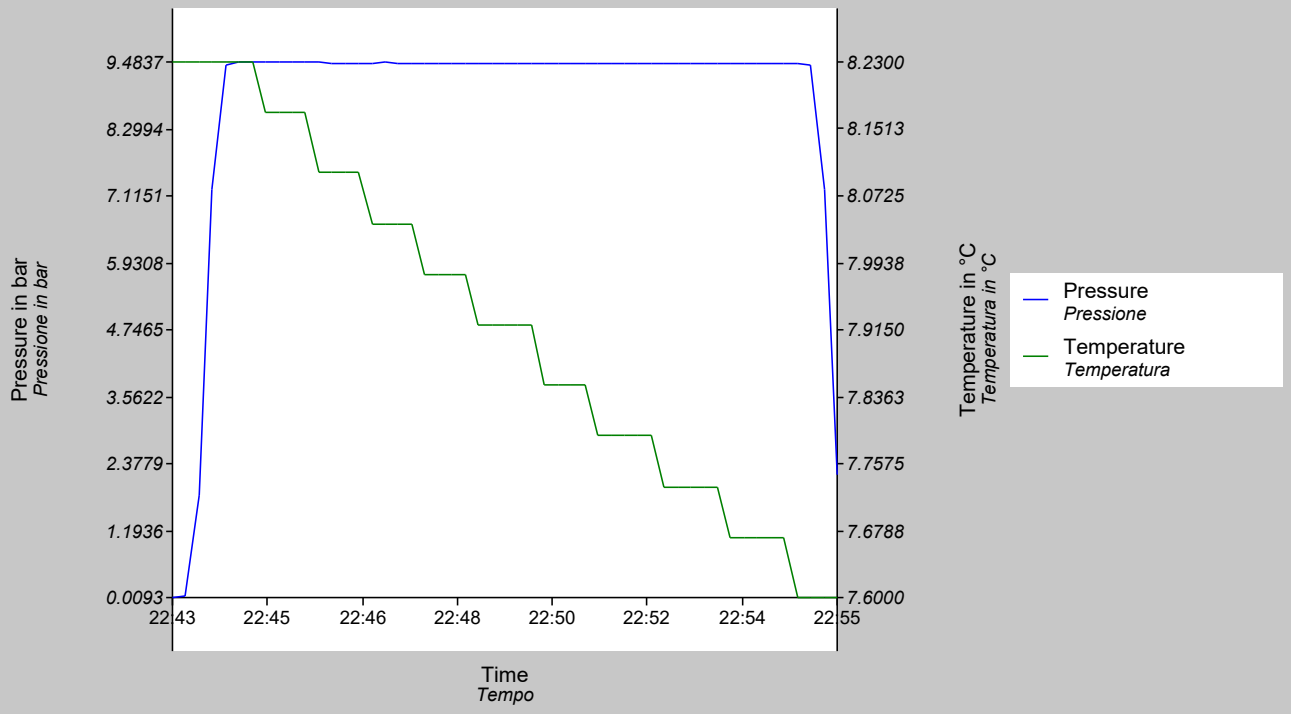

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/24/2025 22:43:18.000	0.0093	8.2300
01/24/2025 22:43:33.000	0.0334	8.2300
01/24/2025 22:43:48.000	1.8084	8.2300
01/24/2025 22:44:03.000	7.2337	8.2300
01/24/2025 22:44:18.000	9.4304	8.2300
01/24/2025 22:44:33.000	9.4833	8.2300
01/24/2025 22:44:48.000	9.4837	8.2300
01/24/2025 22:45:03.000	9.4784	8.1700
01/24/2025 22:45:18.000	9.4777	8.1700
01/24/2025 22:45:33.000	9.4770	8.1700
01/24/2025 22:45:48.000	9.4738	8.1700
01/24/2025 22:46:03.000	9.4699	8.1000
01/24/2025 22:46:18.000	9.4653	8.1000
01/24/2025 22:46:33.000	9.4666	8.1000
01/24/2025 22:46:48.000	9.4675	8.1000
01/24/2025 22:47:03.000	9.4648	8.0400
01/24/2025 22:47:18.000	9.4698	8.0400

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	123A90-Tubing_2


Measurement results


Risultati della misura


Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/24/2025 22:47:33.000	9.4676	8.0400
01/24/2025 22:47:48.000	9.4598	8.0400
01/24/2025 22:48:03.000	9.4667	7.9800
01/24/2025 22:48:18.000	9.4577	7.9800
01/24/2025 22:48:33.000	9.4651	7.9800
01/24/2025 22:48:48.000	9.4574	7.9800
01/24/2025 22:49:03.000	9.4634	7.9200
01/24/2025 22:49:18.000	9.4648	7.9200
01/24/2025 22:49:33.000	9.4595	7.9200
01/24/2025 22:49:48.000	9.4598	7.9200
01/24/2025 22:50:03.000	9.4604	7.9200
01/24/2025 22:50:18.000	9.4570	7.8500
01/24/2025 22:50:33.000	9.4569	7.8500
01/24/2025 22:50:48.000	9.4634	7.8500
01/24/2025 22:51:03.000	9.4587	7.8500
01/24/2025 22:51:18.000	9.4562	7.7900
01/24/2025 22:51:33.000	9.4617	7.7900
01/24/2025 22:51:48.000	9.4550	7.7900
01/24/2025 22:52:03.000	9.4556	7.7900
01/24/2025 22:52:18.000	9.4562	7.7900
01/24/2025 22:52:33.000	9.4611	7.7300
01/24/2025 22:52:48.000	9.4522	7.7300
01/24/2025 22:53:03.000	9.4522	7.7300
01/24/2025 22:53:18.000	9.4546	7.7300
01/24/2025 22:53:33.000	9.4547	7.7300
01/24/2025 22:53:48.000	9.4507	7.6700
01/24/2025 22:54:03.000	9.4519	7.6700
01/24/2025 22:54:18.000	9.4489	7.6700
01/24/2025 22:54:33.000	9.4440	7.6700
01/24/2025 22:54:48.000	9.4444	7.6700
01/24/2025 22:55:03.000	9.4456	7.6000
01/24/2025 22:55:18.000	9.4350	7.6000
01/24/2025 22:55:33.000	7.2298	7.6000
01/24/2025 22:55:48.000	2.1865	7.6000

DRAWING NO. 123A90-DDL-IN-DL-40085

REV. 01

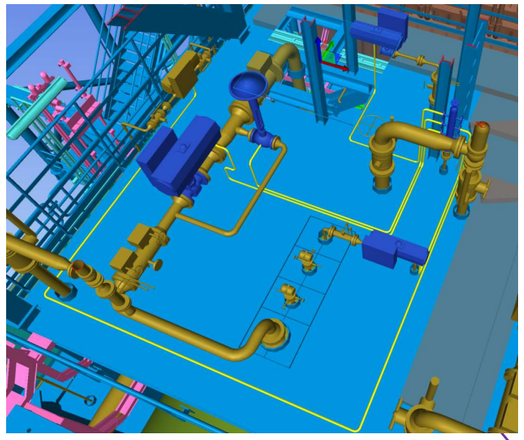

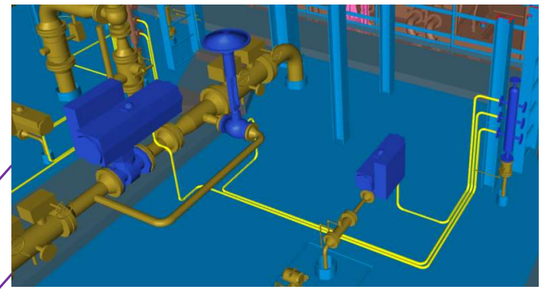



CRANE
X-99001

AV-63012
+35.085mm
+4.775mm T.O.S

AV-63004
+35.085mm
+4.775mm T.O.S

25-BDV-022
+34.740mm
+4.430mm T.O.S

AV-63006
+35.085mm
+4.775mm T.O.S

80-XV-001
+34.508mm
+4.198mm T.O.S

25-XV-015
+34.479mm
+4.169mm T.O.S

25-PV-043
+34.740mm
+4.430mm T.O.S

25-BDV-013
+34.740mm
+4.430mm T.O.S

25-PV-049
+34.740mm
+4.430mm T.O.S

25-BDV-019
+34.740mm
+4.430mm T.O.S

25-XV-018
+34.508mm
+4.198mm T.O.S

Q-43004
HYDROGEN VENT

25-PV-046
+34.740mm
+4.430mm T.O.S

25-XV-021
+34.479mm
+4.169mm T.O.S

25-BDV-016
+34.740mm
+4.430mm T.O.S

V-25001A V-25001B V-25001C

25-XV-008
+35.245mm
+4.935mm T.O.S

AV-63001
+35.834mm
+5.524mm T.O.S

REFER SHEET-001

HYDROGEN STORAGE VESSELS

25-XV-011
+35.245mm
+4.935mm T.O.S

AV-63010
+35.834mm
+5.524mm T.O.S

25-FV-033
+35.245mm
+4.935mm T.O.S

25-XV-024
+35.140mm
+4.830mm T.O.S


25-SDV-001
+35.140mm
+4.830mm T.O.S


25-FV-032
+35.245mm
+4.935mm T.O.S

25-XV-004
+35.245mm
+4.935mm T.O.S

25-FV-031
+35.245mm
+4.935mm T.O.S

A-20000
ELECTROLYSER

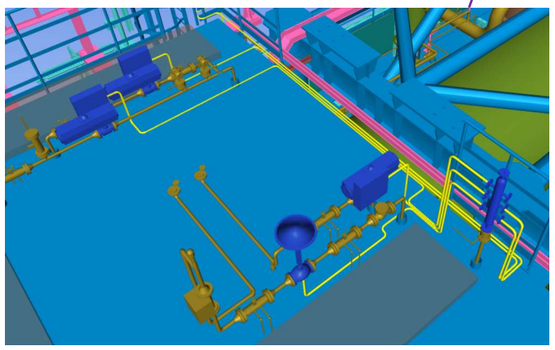

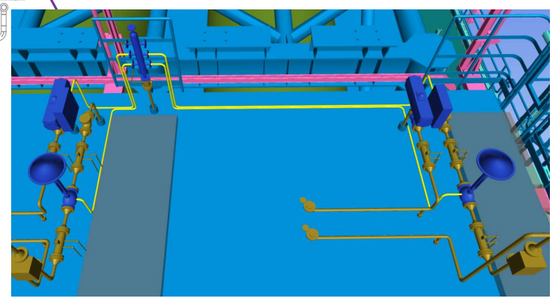


UPPER DECK


SCALE: 1:1

VIEW EL. 33740mm to 36500mm


AV-63001

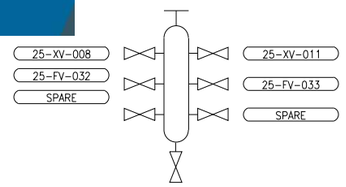


AV-63004

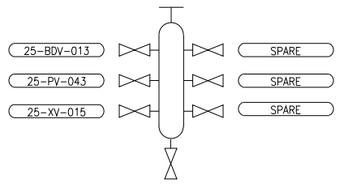


AV-63006

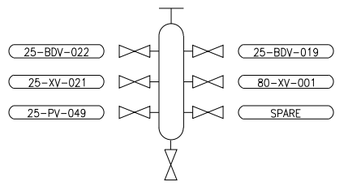



AV-63010

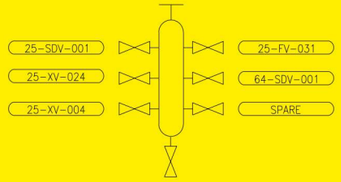

AV-63012

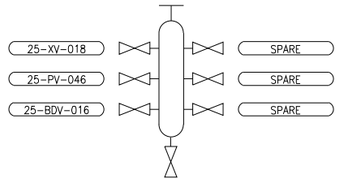



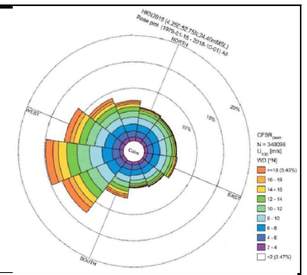

NOTES

1) TUBING ROUTING > 2m IS SHOWN AND IT IS INDICATIVE ONLY.
TUBING ROUTING SHALL BE FINALIZED DURING CONSTRUCTION ACTIVITIES.

LEGEND

- AIR DISTRIBUTION POT
- CONTROL VALVE
- ON-OFF VALVE
- TUBING
- TUBING GOING UP
- TUBING GOING DOWN

HOLDS

REFERENCE DOCUMENTS

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	23/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/02/24	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND | ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT TUBING LAYOUT
ELEVATION 30.310 m

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40085**

REV.:	DATE:	SIGNATURE:
1_C	12/12/24	C.Pilato


ROSETTI MARINO SpA

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:100
DRAWN DRAWN_BY	CHECKED CHECKED_BY	APPROVED APPROVED_BY	DATE DD/MM/YY
A1	DRAWING NO. 123A90-DDL-IN-DL-40085	SHEET 002	REV. 01

File Name : 12390-DDL-IN-DL-40085_Rev.01

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

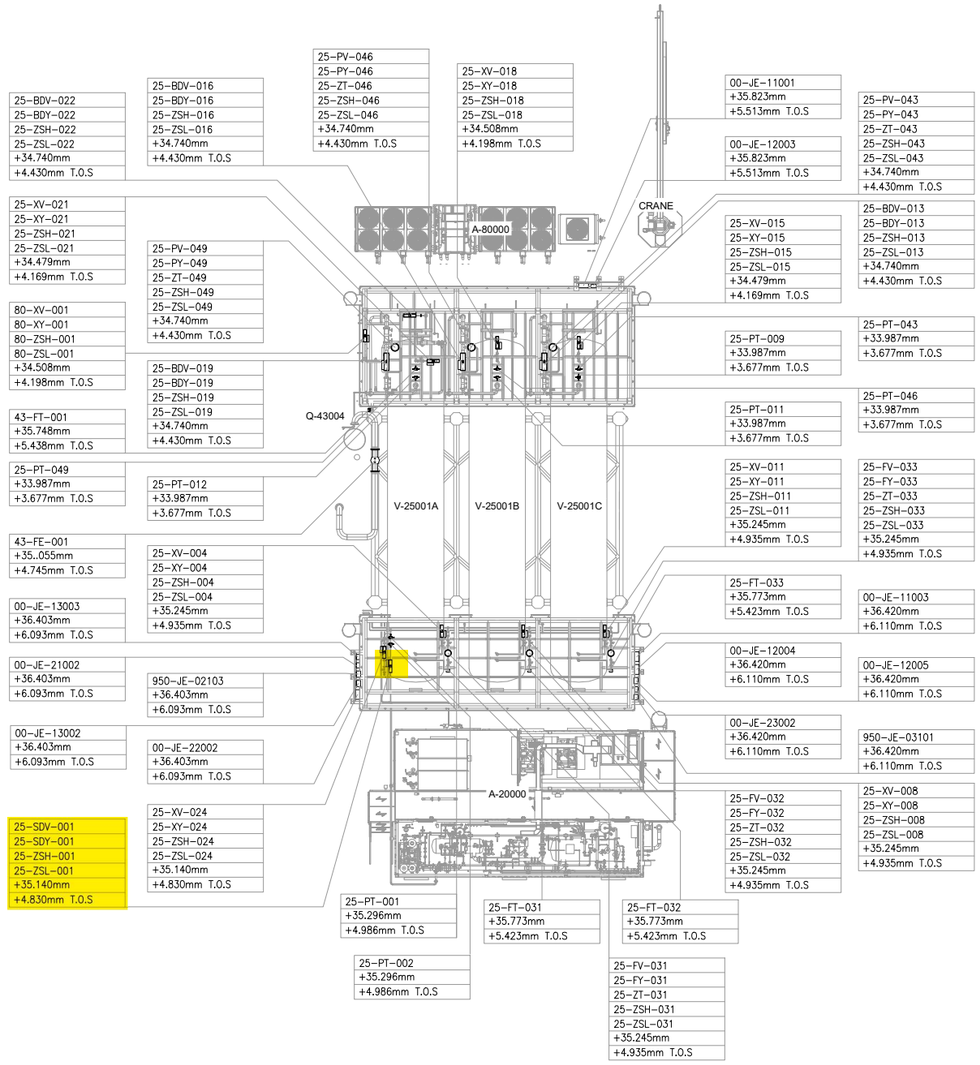

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm



NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :


BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg

DRAWING NO. DRAWING_NO.

REV. REV

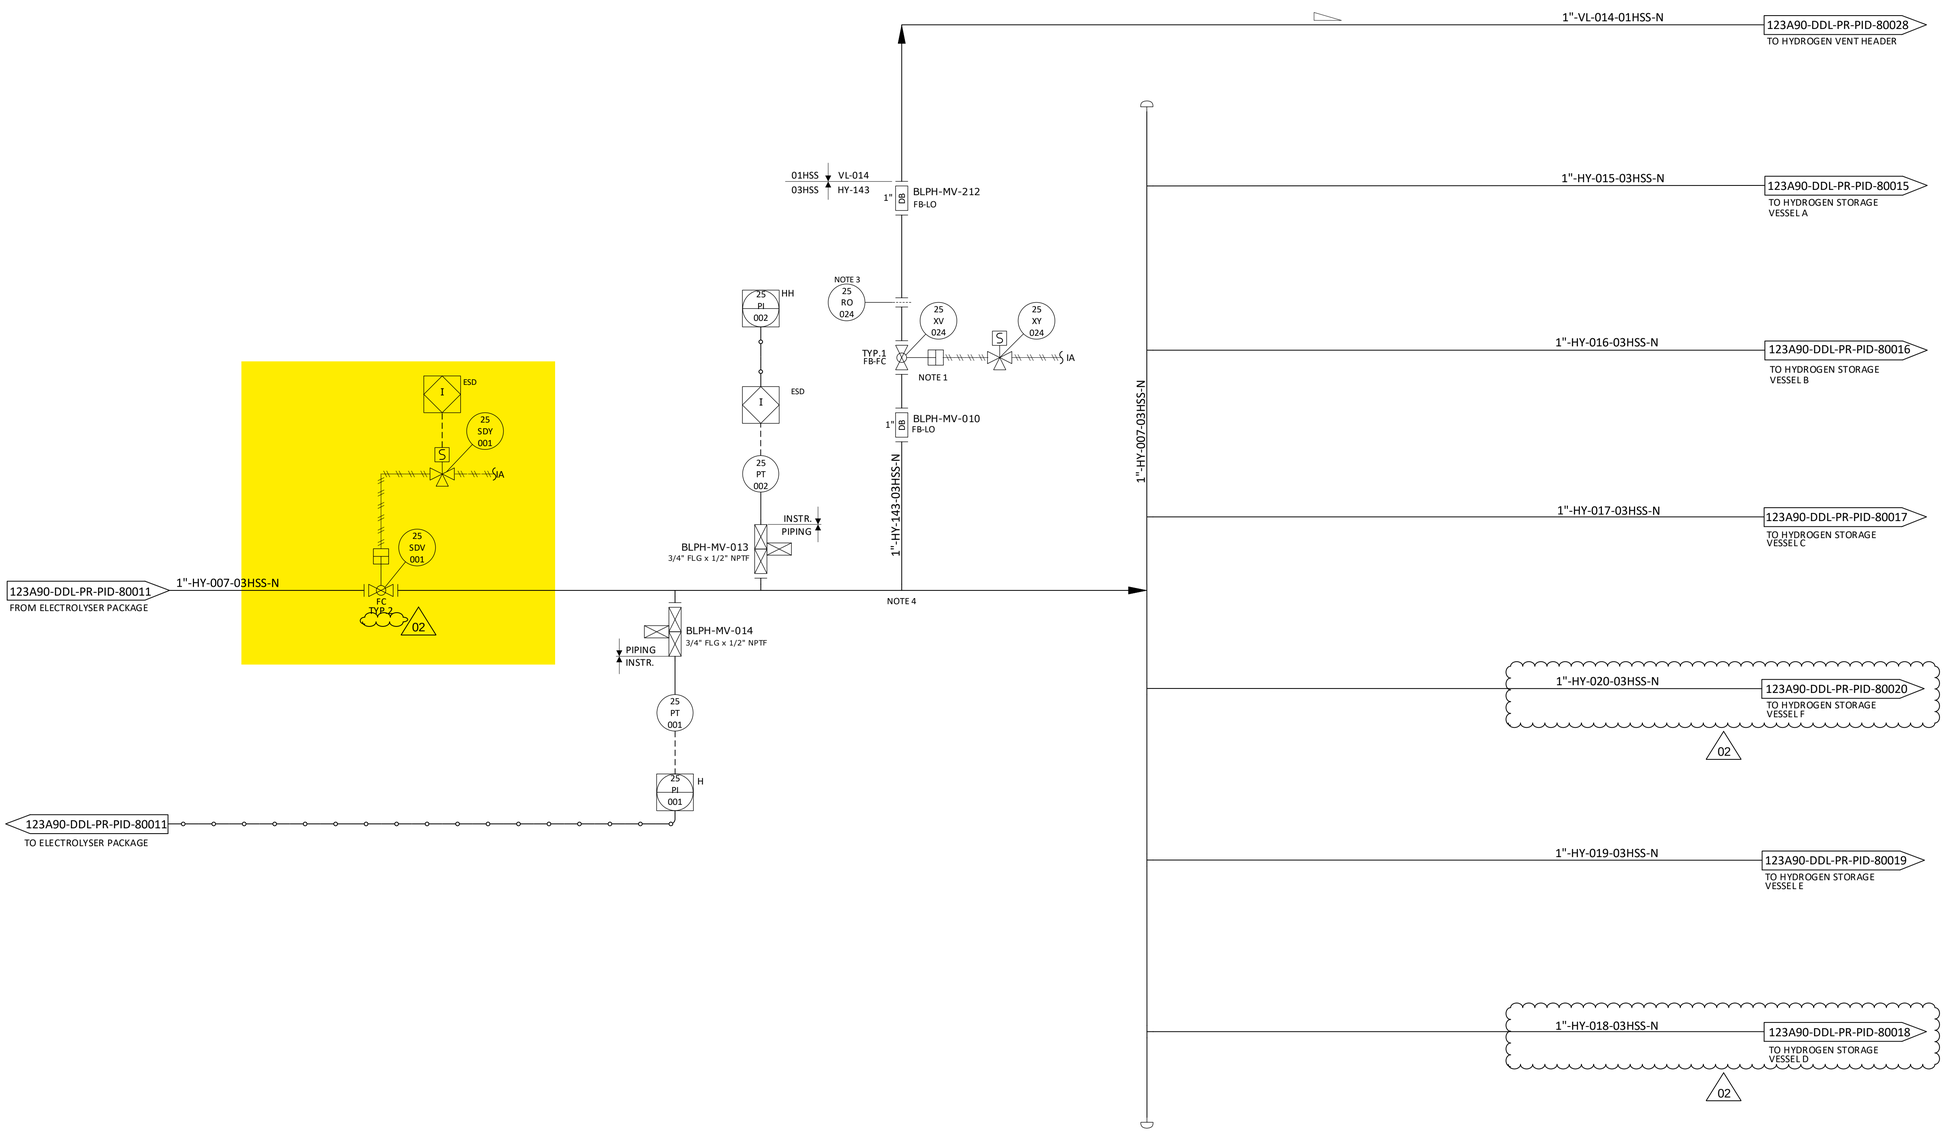

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO




TITLE :

BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSELS HEADER (INLET)

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO. 123A90-DDL-PR-PID-80013	SHEET 001	REV. 02

File Name : FILE_NAME

POS	PICTURE	DESCRIPTION		ITEM ID CODE	TOTAL					
		COMPRESSION FITTING TYPE: **DOUBLE FERRULE** THREADING: ASME B1.20.1 NPT MATERIAL: AISI 316 WORKING PRESSURE AS PER ASME B31.1 TUBING TYPE: ■ INCHES ☐ METRIC			UNIT	Counted	Required			
							Rev. 00	Rev. 01	Rev.	Rev.
1		STRAIGHT MALE CONNECTOR	1/2" NPT-M x 3/8" O.D.		nr.					
2			1/4" NPT-M x 1/2" O.D.		nr.	102	102	102		
3			1/2" NPT-M x 1/2" O.D.		nr.	36	36	-		
4			1/2" NPT-M x 3/4" O.D.		nr.					
5			3/4" NPT-M x 3/4" O.D.		nr.					
6			3/8" NPT-M x 3/8" O.D.		nr.					
7		STRAIGHT FEMALE CONNECTOR	1/2" NPT-F x 3/8" O.D.		nr.					
8			1/4" NPT-F x 1/2" O.D.		nr.					
9			1/2" NPT-F x 1/2" O.D.		nr.					
10			1/2" NPT-F x 3/4" O.D.		nr.					
11		UNION CONNECTOR	1/4" O.D. x 1/4" O.D.		nr.					
12			3/8" O.D. x 3/8" O.D.		nr.					
13			1/2" O.D. x 1/2" O.D.		nr.	49	49	49		
14			3/4" O.D. x 3/4" O.D.		nr.					
15		ELBOW CONNECTOR	1/4" NPT-M x 1/2" O.D.		nr.	27	27	27		
16			1/2" NPT-M x 1/2" O.D.		nr.					
17										
18										
19										
20										
21										
22										
23										
24										
25										
26										
27										
28										
29										
30										
27										
28										
29										
30										
31										
32										
33										
34										

VENDOR / ORDER : **AF SYSTEM / 1724001332**

MATERIAL :

- ☐ ASTM A106 Gr.B
- ■ AISI 316 L
- ☐ UNS S31254

SPECIAL REQUIREMENTS :

- ☐ ...

REMARKS :

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

				DATA TUBING													FROM AREA					TO AREA						
POS.	REV	SUPPLY SCOPE	LAINING SCOPE	TAG Tubing	P&ID	MAIN FUNCTION	SERVICE	DESIGN TEMPERATURE(C°)	OPERATING PRESSURE (Barg)	DESIGN PRESSURE (Barg)	TEST PRESSURE (Barg)	FLUID TEST	DIMENSIONS	MATERIAL	REF. DOC.	Q.TY (m)	FIRE PROOFING	HEAT TRACING	MODULE	AREA	FROM ITEM	REF. P&I	DESCRIPTION	MODULE	AREA	TO ITEM	REF. LAYOUT	DESCRIPTION	NOTE
01	04	RM	RM	**AV-63001/25-XV-011**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-XV-011	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
02	04	RM	RM	**AV-63001/25-FV-033**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-FV-033	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
03	04	RM	RM	**AV-63001/25-XV-008**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-XV-008	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
04	04	RM	RM	**AV-63001/25-FV-032**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-FV-032	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
05	04	RM	RM	**AV-63002/25-XV-020**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-020	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
06	04	RM	RM	**AV-63002/25-FV-036**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**11**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-036	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
07	04	RM	RM	**AV-63002/25-XV-017**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-017	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
08	04	RM	RM	**AV-63002/25-FV-038**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-038	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
09	04	RM	RM	**AV-63002/25-XV-014**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-014	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
10	04	RM	RM	**AV-63002/25-FV-034**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-034	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
11	04	RM	RM	**AV-63003/25-BDV-010**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-BDV-010	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
12	04	RM	RM	**AV-63003/25-PV-040**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-PV-040	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
13	04	RM	RM	**AV-63003/25-XV-012**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-XV-012	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
14	04	RM	RM	**AV-63003/25-XV-009**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**13**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-XV-009	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
15	04	RM	RM	**AV-63004/25-BDV-013**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-BDV-013	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
16	04	RM	RM	**AV-63004/25-PV-043**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-PV-043	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
17	04	RM	RM	**AV-63004/25-XV-015**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-XV-015	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
18	04	RM	RM	**AV-63005/64-PV-031A**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Lower Deck	AV-63005	123A90-DDL-PR-PID-80041	Distribution Pot 5	BLPH	Lower Deck	64-PV-031A	123A90-DDL-IN-DL-40080	Pneumatic Control Valve	Design Pressure set as per downstream PSV
19	04	RM	RM	**AV-63005/64-PV-031B**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**3**	N.A.	N.A.	BLPH	Lower Deck	AV-63005	123A90-DDL-PR-PID-80041	Distribution Pot 5	BLPH	Lower Deck	64-PV-031B	123A90-DDL-IN-DL-40080	Pneumatic Control Valve	Design Pressure set as per downstream PSV
20	04	RM	RM	**AV-63006/25-BDV-022**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-BDV-022	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
21	04	RM	RM	**AV-63006/25-XV-021**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-XV-021	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
22	04	RM	RM	**AV-63006/25-PV-049**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-PV-049	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
23	04	RM	RM	**AV-63006/25-BDV-019**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-BDV-019	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
24	04	RM	RM	**AV-63006/80-XV-001**	123A90-DDL-PR-PID-80012	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	80-XV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
25	04	RM	RM	**AV-63007/25-XV-006**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-XV-006	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
26	04	RM	RM	**AV-63007/25-PV-035**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**11**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-PV-035	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
27	04	RM	RM	**AV-63007/25-BDV-005**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-BDV-005	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
28	04	RM	RM	**AV-63007/25-PV-037**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-PV-037	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
29	04	RM	RM	**AV-63007/25-BDV-007**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-BDV-007	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
30	04	RM	RM	**AV-63008/50-XV-001**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-001	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
31	04	RM	RM	**AV-63008/50-XV-002**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-002	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
32	04	RM	RM	**AV-63008/50-XV-003**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-003	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
33	04	RM	RM	**AV-63008/50-XV-004**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-004	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
33A	04	RM	RM	**AV-63009/50-XV-005**	123A90-DDL-PR-PID-80025	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Lower Deck	AV-63009	123A90-DDL-PR-PID-80041	Distribution Pot 9	BLPH	Lower Deck	50-XV-005	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
34	04	RM	RM	**AV-63010/25-SDV-001**	123A90-DDL-PR-PID-80013	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-SDV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
35	04	RM	RM	**AV-63010/25-XV-024**	123A90-DDL-PR-PID-80013	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-XV-024	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
36	04	RM	RM	**AV-63010/25-XV-004**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-XV-004	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
37	04	RM	RM	**AV-63010/25-FV-031**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-FV-031	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
38	04	RM	RM	**AV-63010/64-SDV-001**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**15**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	64-SDV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
39	04	RM	RM	**AV-63011/25-SDV-023**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-SDV-023	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
40	04	RM	RM	**AV-63011/25-PV-055A**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-PV-055A	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
41	04	RM	RM	**AV-63011/25-PV-055B**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-PV-055B	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
42	04	RM	RM	**AV-63012/25-XV-018**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-XV-018	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
43	04	RM	RM	**AV-63012/25-PV-046**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-PV-046	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
44	04	RM	RM	**AV-63012/25-BDV-016**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-BDV-016	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
~~45~~	03	DELETED	DELETED	~~**BLPH-MV-014/25-PT-001**~~	~~123A90-DDL-PR-PID-80013~~	~~Process Connection~~	~~Hydrogen~~	~~80~~	~~7,5 / 30~~	~~40~~	~~7,5 / 30~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-014~~	~~123A90-DDL-PR-PID-80013~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25-PT-001~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~46~~	03	DELETED	DELETED	~~**BLPH-MV-013/25-PT-002**~~	~~123A90-DDL-PR-PID-80013~~	~~Process Connection~~	~~Hydrogen~~	~~80~~	~~7,5 / 30~~	~~40~~	~~7,5 / 30~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-013~~	~~123A90-DDL-PR-PID-80013~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25-PT-002~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~47~~	03	DELETED	DELETED	~~**BLPH-MV-026/26-PT-066A**~~	~~123A90-DDL-PR-PID-80014~~	~~Process Connection~~	~~Hydrogen~~	~~100~~	~~17,7~~	~~10~~	~~17,7~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-026~~	~~123A90-DDL-PR-PID-80014~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~26-PT-066A~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~48~~	03	DELETED	DELETED	~~**BLPH-MV-213/26-PT-066B**~~	~~123A90-DDL-PR-PID-80014~~	~~Process Connection~~	~~Hydrogen~~	~~100~~	~~3,5 / 6,5~~	~~10~~	~~3,5 / 6,5~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-213~~	~~123A90-DDL-PR-PID-80014~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~26-PT-066B~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~49~~	03	DELETED	DELETED	~~**BLPH-MV-407/43-PT-001**~~	~~123A90-DDL-PR-PID-80029~~	~~Process Connection~~	~~Hydrogen~~	~~-10 / +80~~	~~ATM~~	~~3,5~~	~~ATM~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-407~~	~~123A90-DDL-PR-PID-80029~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~43-PT-001~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~50~~	03	DELETED	DELETED	~~**BLPH-MV-411/60-PT-014**~~	~~123A90-DDL-PR-PID-80026~~	~~Process Connection~~	~~Waste-Water~~	~~100~~	~~ATM~~	~~17,7~~	~~ATM~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~YES~~	~~BLPH~~	~~Lower Deck~~	~~BLPH-MV-411~~	~~123A90-DDL-PR-PID-80026~~	~~Manual Valve~~	~~BLPH~~	~~Lower Deck~~	~~60-PT-014~~	~~123A90-DDL-IN-DL-40080~~	~~Pressure Transmitter~~	
~~51~~	03	DELETED	DELETED	~~**BLPH-MV-160/63-PT-003**~~	~~123A90-DDL-PR-PID-80027~~	~~Process Connection~~	~~Instrument Air~~	~~100~~	~~4 / 10~~	~~11~~	~~4 / 10~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-160~~	~~123A90-DDL-PR-PID-80027~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~63-PT-003~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~52~~	03	DELETED	DELETED	~~**BLPH-MV-151/63-PT-004**~~	~~123A90-DDL-PR-PID-80027~~	~~Process Connection~~	~~Instrument Air~~	~~100~~	~~4 / 10~~	~~11~~	~~4 / 10~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-151~~	~~123A90-DDL-PR-PID-80027~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~63-PT-004~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
53	04	RM	RM	**BLPH-MV-386/64-PT-031A**	123A90-DDL-PR-PID-80027	Process Connection	Nitrogen Gas


CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Pneumatic Hook-Ups	Sh. 6 of 6 Date: 08/07/2024 Rev. 01

PNEUMATIC HOOK-UP FOR ON-OFF VALVES

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40078**

REV.:	DATE:	SIGNATURE:
1_B	06/11/24	G.Randi

ROSETTI MARINO SpA

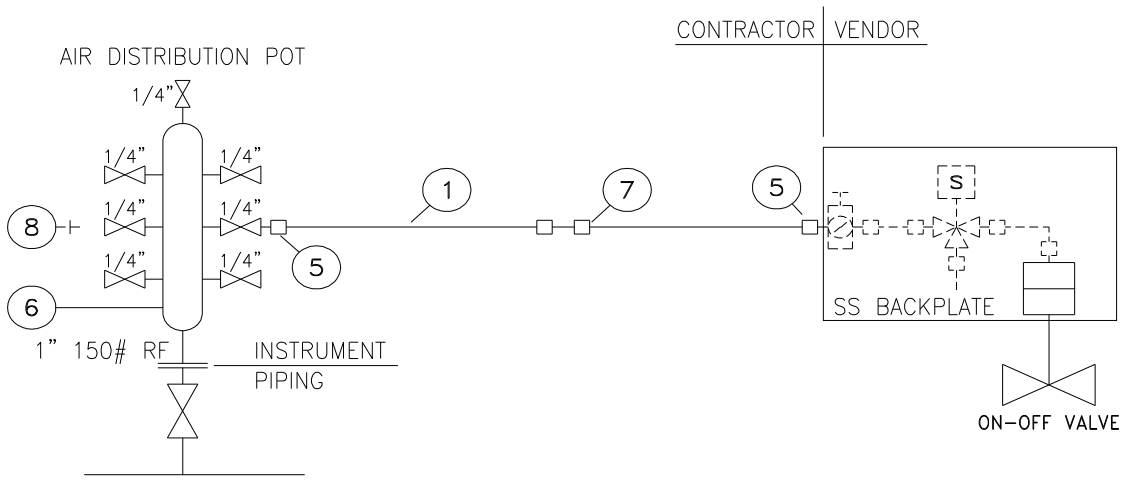

INSTRUMENT TAG	
1	25-BDV-022
2	25-BDV-005
3	25-BDV-007
4	25-BDV-010
5	25-BDV-013
6	25-BDV-016
7	25-BDV-019
8	25-SDV-001
9	25-SDV-023
10	25-XV-004
11	25-XV-006
12	25-XV-008
13	25-XV-009
14	25-XV-011
15	25-XV-012
16	25-XV-014
17	25-XV-015
18	25-XV-017
19	25-XV-018
20	25-XV-020
21	25-XV-021
22	25-XV-024
23	50-XV-001
24	50-XV-002
25	50-XV-003
26	50-XV-004
27	80-XV-001
28	64-SDV-001
29	50-XV-005
30	

NOTE:
(1) For Air Distribution Pot quantities see material take-off on sh. 4

POS.	NORM/STD CODE	DESCRIPTION	SIZE/CONNECTION TYPE	Q.TY
8		SS316 PLUG	1/4" NPT	Note 1
7		SS316 UNION	1/2" O.D. x 1/2" O.D.	N. 1
6		SS316 AIR DISTRIBUTION POT	1" 150#RF - N. 7 1/4" BALL VALVES	Note 1
5		SS316 MALE CONNECTOR	1/4" NPT x 1/2" O.D.	N. 2
1		SS 316L TUBING	1/2" x 0,049"Thk	10 m

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CERTIFICATO DI TARATURA LAT 114 0435-SM-24
Certificate of Calibration

- data di emissione date of issue	2024-09-20
- cliente customer	FAST AUTOMATION SRL VIA DELLA PREVIDENZA SOCIALE, 8 IT-42124 REGGIO EMILIA (RE)
- destinatario receiver	ROSETTI MARINO SPA - YARD PIOMBONI VIA DEL MARCHESATO, 37 IT-48122 MARINA DI RAVENNA (RA)

Si riferisce a
referring to

- oggetto *item*	Misuratore di pressione elettronico Electrical pressure gauge
- costruttore *manufacturer*	WIKA
- modello *model*	CPG1500
- matricola *serial number*	1A014ILJJIM
- data di ricev. oggetto *date of receipt of item*	2024-09-17
- data delle misure *date of measurements*	2024-09-20
- registro di laboratorio *laboratory reference*	0435-SM-24

Il presente certificato di taratura è emesso in base all'accreditamento LAT N. 114 rilasciato in accordo ai decreti attuativi della legge n. 273/1991 che ha istituito il Sistema Nazionale di Taratura (SNT). ACCREDIA attesta le capacità di misura e di taratura, le competenze metrologiche del Centro e la riferibilità delle tarature eseguite ai campioni nazionali ed internazionali delle unità del Sistema Internazionale delle Unità (SI).
Questo certificato non può essere riprodotto in modo parziale, salvo espressa autorizzazione scritta da parte del Centro.

This certificate of calibration is issued in compliance with the accreditation LAT No.114 granted according to decrees connected with Italian law No. 273/1991 which has established the National Calibration System. ACCREDIA attests the calibration and measurement capability, metrological competence of the Centre and the traceability of calibration results to the national and International standards of the International System of Units (SI).
This certificate may not be partially reproduced, except with the prior written permission of the issuing Centre.

I risultati di misura riportati nel presente Certificato sono stati ottenuti applicando le procedure di taratura citate alla pagina seguente, dove sono specificati anche i campioni o gli strumenti che garantiscono la catena di riferibilità del Centro e i rispettivi certificati di taratura in corso di validità. Essi si riferiscono esclusivamente all'oggetto in taratura e sono validi nel momento e nelle condizioni di taratura, salvo diversamente specificato.

The measurement results reported in this Certificate were obtained following the calibration procedures given in the following page, where the reference standards or instruments are indicated which guarantee the traceability chain of the laboratory, and the related calibration certificates in the course of validity are indicated as well. They relate only to the calibrated item and they are valid for the time and conditions of calibration, unless otherwise specified.

Le incertezze di misura dichiarate in questo documento sono state determinate conformemente alla Guida ISO/IEC 98 e al documento EA-4/02. Solitamente sono espresse come incertezza estesa ottenuta moltiplicando l'incertezza tipo per il fattore di copertura *k* corrispondente ad un livello di fiducia di circa il 95 %. Normalmente tale fattore *k* vale 2.

The measurement uncertainties stated in this document have been determined according to the ISO/IEC Guide 98 and to EA-4/02. Usually, they have been estimated as expanded uncertainty obtained multiplying the standard uncertainty by the coverage factor k corresponding to a confidence level of about 95%. Normally, this factor k is 2.

Direzione Tecnica
(Approving Officer)

Enrico Reccagni

Enrico Reccagni

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CARATTERISTICHE DELLO STRUMENTO IN TARATURA/ Properties of devices under calibration

Misuratore di pressione elettronico ***Electrical pressure gauge***	
Tipo *Model*	Misuratore di pressione elettronico Electrical pressure gauge
Numero di matricola *Serial No.*	1A014ILJJIM
Campo di misura *Scale range*	(0 ... 1000) bar g
Accuratezza dichiarata dal costruttore *Accuracy declared by the manufacturer*	0,1 % FS
Risoluzione *Resolution (scale division)*	0,1 bar
Tag. N. *Tag No.*	--

Procedura di taratura e catena di riferibilità
Calibration procedure and traceability chain

La taratura è stata effettuata in accordo alla linea guida DKD-R 6-1 "Taratura di strumenti di pressione" (versione 03/2014) procedura B, per confronto fra i valori dello strumento in taratura con quelli di riferimento dati dal campione di lavoro.

Calibration was carried out according to DKD-R 6-1 "Kalibrierung von Druckmessgeräten" (Ausgabe 03/2014) procedure B, by comparing the measured values of the calibration item with those of the reference or working standard.

I risultati riportati sono stati ottenuti applicando le procedure n° LMO-PT-01 rev.2

The results have been obtained using the procedures n° LMO-PT-01 rev.2

La catena di riferibilità ha inizio dai campioni di riferimento n° PM1-09

The traceability chain starts from the reference standards n° PM1-09

muniti di certificati validi di taratura, rispettivamente n° D21090

with the relevant valid calibration certificates n° D21090

Luogo di taratura
Place of calibration

Laboratorio WIKA ITALIA - Laboratorio di Modugno (BA)
WIKA ITALY Laboratory - Modugno (BA)

Campione di lavoro
Working Standard

Norma di riferimento (RS) Bilancia di pressione ***Reference standard (RS) Dead-weight tester***	
Tipo *Model*	PM1-09
Certificato di taratura *Calibration mark*	D-K-15105/D21090
Campo di misura *Scale range*	(10 ... 2500) bar g
Accuratezza *Accuracy*	0,015 % della lettura + 255 Pa

Operatore
Technichian

Francesco Donatelli

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Condizioni di misura
Measurement conditions

Schema di collegamento *Assembly*	
Fluido utilizzato *Pressure medium*	Sebacate *Sebacate*
Livello di riferimento *Refence height (for reference value)*	Superficie di tenuta DUT *Sealing face DUT*
Posizione di montaggio *Position during calibration*	verticale *vertical*

Note di taratura
Calibration Note

Lo strumento è stato tarato e riconsegnato nelle stesse condizioni in cui è arrivato nel laboratorio, in accordo con il metodo "as found as left" / The device under test (DUT) was calibrated in the same conditions it was arrived in laboratory, according to the method "as found as left".

Condizioni Ambientali
Environmental conditions

Temperatura *Temperature*	(22 ± 1,5)	°C
Pressione atmoferica *Atmospheric pressure*	(1009,3 ± 0,2)	hPa
Umidità relativa *Rel. Humidity*	(50 ± 15)	% UR

I dati meteo sono stati acquisiti tramite stazione meteo WIKA CPU6000-W s/n.1A00VCX6GJ2

Weather data were acquired via the WIKA CPU6000-W weather station s/n.1A00VCX6GJ2

Misure rilevate
Measurement results

Valore di riferimento *Reference value RS* bar	**Letture** *Reading DUT* bar		
	M1	**M2**	**M3**
0,00	0,0	0,0	0,0
99,91	99,9	99,9	99,9
199,82	199,9	199,9	199,9
299,73	299,8	299,8	299,8
399,63	399,7	399,7	399,7
499,53	499,5	499,6	499,6
599,44	599,4	599,4	599,4
699,34	699,3	699,3	699,3
799,25	799,1	799,2	799,1
899,14	899,0	899,1	899,0
999,04	999,0	999,0	999,0

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it


Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Incertezza di misura
Uncertainty of measurement

Valori di riferimento *Reference value RS* bar	Media delle misure *Mean value* bar	Errore *Error* bar	Ripetibilità *Repeatability* bar	Isteresi *Hysteresis* bar	Incertezza di misura *Meas. Uncertainty* bar
0,00	0,0	0,0	0,0	0,0	0,40
99,91	99,9	0,0	0,0	0,0	0,40
199,82	199,9	0,1	0,0	0,0	0,40
299,73	299,8	0,1	0,0	0,0	0,40
399,63	399,7	0,1	0,0	0,0	0,40
499,53	499,6	0,1	0,1	0,1	0,40
599,44	599,4	0,0	0,0	0,0	0,40
699,34	699,3	0,0	0,0	0,0	0,40
799,25	799,2	0,0	0,0	0,1	0,40
899,14	899,1	0,0	0,0	0,1	0,40
999,04	999,0	0,0	0,0	0,0	0,40

Grafico degli errori di misura
Graphical representation of measurement uncertainty

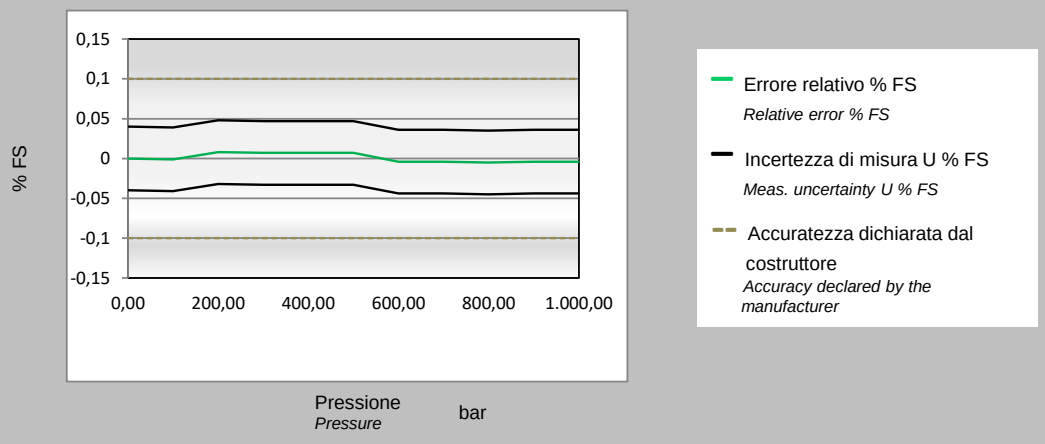

L'incertezza estesa senza correzione del DUT è pari a 0,5 bar
The expanded uncertainty of the DUT without correction is equal to

Questo dato è ottenuto come MAX{Incertezza_di_misura$_i$ + |Errore$_i$|} della tabella precedente
This data is obatined as MAX{Meas._uncertainty$_i$ + |Error$_i$|} of the previous table

Il presente certificato non rappresenta una dichiarazione di conformità a specifica
This certificate is not a statement of compliance

ITEM	Tag	AV-63010/25-XV-024	: Pneumatic Connection Air Supply - 25-XV-024			Dwg	123A90-DDL-IN-LIS-40092
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001974		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX06 Tubing Hydraulic

General

1	Drawings (P&ID tube) attached.	OK
2	Isometric drawings (P&ID pipe) attached.	NA
3	Check drawings at last revision.	OK
4	Material certificates for pipe/tube/fittings/flanges/hose and support clamps checked	OK
5	Welders certificates checked	NA
6	Certificate and mark-up drawings for welding WPS and WPQR and material certificates checked	NA
7	Certificates and mark-up drawings for NDT report checked	NA

Check before Flushing and/or Testing

8	Installation complete and in compliance with drawings and specifications.	OK
9	Tubing/Piping tray checked.	NA
10	Hose according to specifications and tightened	NA
11	Flanges - nuts and bolts tightened.	NA
12	Fittings are mounted and tightened.	OK
13	Pipe supports completed and installed as required.	OK
14	Cable ladders, trays, sharp edges protected, cut ends sealed.	NA
15	Maintenance evaluation.	OK

REFER TO FINAL SHEET FOR ACCEPTANCE

ITEM	Tag	AV-63010/25-XV-024	: Pneumatic Connection Air Supply - 25-XV-024	Dwg	123A90-DDL-IN-LIS-40092		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001974	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form CJX06	Tubing Hydraulic

Flushing / Pressure testing

16	Drawings of flushing loops (P&ID tube) attached	NA
17	Equipment & valves bypassed and blinded	OK
18	Calibration certificates attached	OK
19	Type of flushing medium correct	NA
20	Printout from recorder/particle counter	NA
21	Printout from pressure indicator	OK

Final Check

22	Final inspection of pipework.	OK
23	Preservation of tested pipework.	NA
24	System/equipment labelled with: "Hot Oil flushing performed".	NA
25	If required produce Red Line Mark Up for "AS BUILT"	

TEST SPECIFIED USED

TEST FLUID: IA TEST PRESSURE BAR G: 9.4 TEST DURATION : 12 MIN

TEST EQUIPMENT: CPG 1500 SERIAL N°: 1A014ILJJIM

HOOK UP DIAGRAM Number: 123A90-DDL-IN-HD-40078

Line FROM	Line TO	Tubing cleaned			Tubing flushed			Diam ID/OD
		Yes	No	N/A	Yes	No	N/A	
AV-63010	25-XV-024	●					●	1/2" OD x Thk. 0,049"

TESTED LABEL AFFIXED DATA SHEET ATTACHED

Comments:

	Performed by	☒ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM(ROSETTI MARINO)	
Name	Michele Tartaglia	Paolo Schintu	
Date	2025-01-30	2025-02-04	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-30T10:21:32.986Z	PROVERLIS Digitaly signed by Paolo Schintu 2025-02-04T11:45:13.299Z	

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	AV-63010/25-XV-004

Instrument

Strumento

Electrical pressure gauge *Misuratore di pressione elettronico*	
Model *Modello*	CPG1500
Serial number *Numero di serie*	1A014ILJJIM
Log temperature *Registrazioni di Temperatura*	Active *Attivo*
Scale range *Campo scala*	(0 ... 1000) bar a
Accuracy *Accuratezza*	0.1 % FS
Tag number *Numero tag*	
Communication *Comunicazione*	Wireless (00:13:43:85:DD:8D)

Measurement conditions

Condizioni di misura

Settings *Impostazioni*	
Mode *Modalità*	Automatic *Automatico*
Interval (ms) *Intervallo (ms)*	15000
Duration (hh:mm:ss) *Durata (hh:mm:ss)*	00:12:36
Start time (hh:mm:ss) *Tempo di avvio (hh:mm:ss)*	10:43:18 pm

Logger protocol

Protocollo di acquisizione elenco dati


ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	123A90-Tubing_2

Measurement results

Risultati della misura

Graphical representation of progression
Rappresentazione grafica dell'andamento

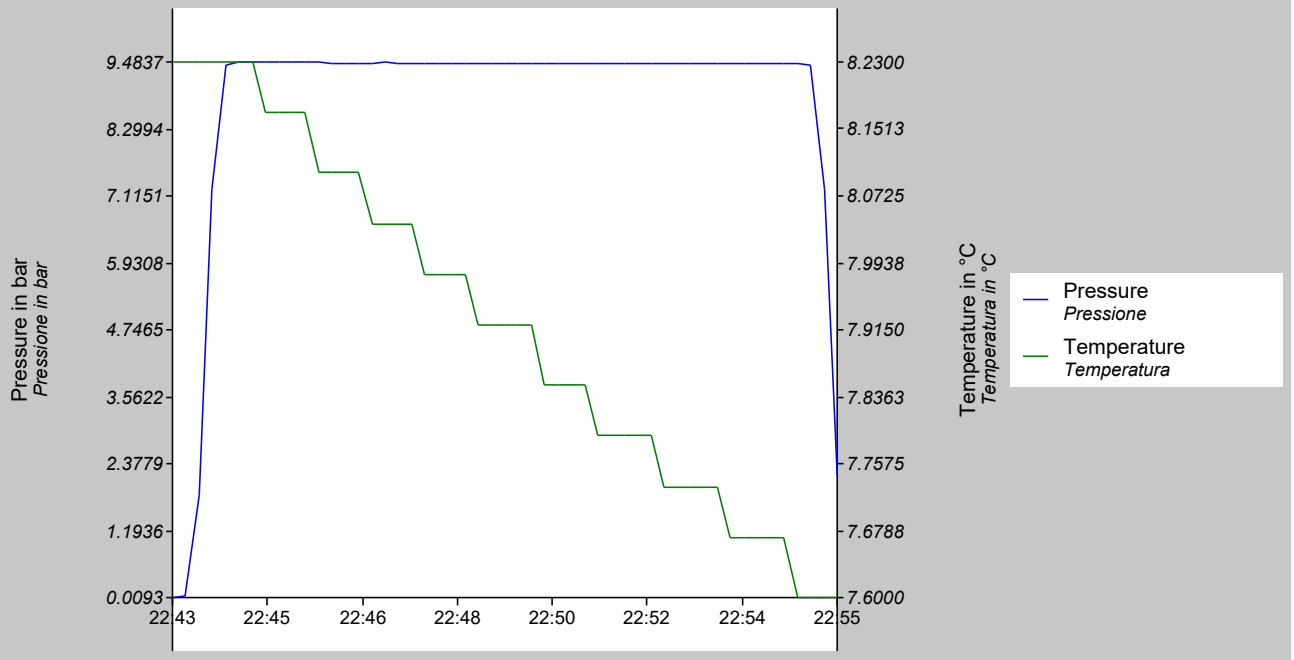

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/24/2025 22:43:18.000	0.0093	8.2300
01/24/2025 22:43:33.000	0.0334	8.2300
01/24/2025 22:43:48.000	1.8084	8.2300
01/24/2025 22:44:03.000	7.2337	8.2300
01/24/2025 22:44:18.000	9.4304	8.2300
01/24/2025 22:44:33.000	9.4833	8.2300
01/24/2025 22:44:48.000	9.4837	8.2300
01/24/2025 22:45:03.000	9.4784	8.1700
01/24/2025 22:45:18.000	9.4777	8.1700
01/24/2025 22:45:33.000	9.4770	8.1700
01/24/2025 22:45:48.000	9.4738	8.1700
01/24/2025 22:46:03.000	9.4699	8.1000
01/24/2025 22:46:18.000	9.4653	8.1000
01/24/2025 22:46:33.000	9.4666	8.1000
01/24/2025 22:46:48.000	9.4675	8.1000
01/24/2025 22:47:03.000	9.4648	8.0400
01/24/2025 22:47:18.000	9.4698	8.0400

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	123A90-Tubing_2

Measurement results

Risultati della misura

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/24/2025 22:47:33.000	9.4676	8.0400
01/24/2025 22:47:48.000	9.4598	8.0400
01/24/2025 22:48:03.000	9.4667	7.9800
01/24/2025 22:48:18.000	9.4577	7.9800
01/24/2025 22:48:33.000	9.4651	7.9800
01/24/2025 22:48:48.000	9.4574	7.9800
01/24/2025 22:49:03.000	9.4634	7.9200
01/24/2025 22:49:18.000	9.4648	7.9200
01/24/2025 22:49:33.000	9.4595	7.9200
01/24/2025 22:49:48.000	9.4598	7.9200
01/24/2025 22:50:03.000	9.4604	7.9200
01/24/2025 22:50:18.000	9.4570	7.8500
01/24/2025 22:50:33.000	9.4569	7.8500
01/24/2025 22:50:48.000	9.4634	7.8500
01/24/2025 22:51:03.000	9.4587	7.8500
01/24/2025 22:51:18.000	9.4562	7.7900
01/24/2025 22:51:33.000	9.4617	7.7900
01/24/2025 22:51:48.000	9.4550	7.7900
01/24/2025 22:52:03.000	9.4556	7.7900
01/24/2025 22:52:18.000	9.4562	7.7900
01/24/2025 22:52:33.000	9.4611	7.7300
01/24/2025 22:52:48.000	9.4522	7.7300
01/24/2025 22:53:03.000	9.4522	7.7300
01/24/2025 22:53:18.000	9.4546	7.7300
01/24/2025 22:53:33.000	9.4547	7.7300
01/24/2025 22:53:48.000	9.4507	7.6700
01/24/2025 22:54:03.000	9.4519	7.6700
01/24/2025 22:54:18.000	9.4489	7.6700
01/24/2025 22:54:33.000	9.4440	7.6700
01/24/2025 22:54:48.000	9.4444	7.6700
01/24/2025 22:55:03.000	9.4456	7.6000
01/24/2025 22:55:18.000	9.4350	7.6000
01/24/2025 22:55:33.000	7.2298	7.6000
01/24/2025 22:55:48.000	2.1865	7.6000

CROSSWIND

HOLLANDSE KUST NOORD WIND PARK Project
Contract No. CW-I-WP4-2023-05

INSTRUMENT TUBING LIST


ROSETTI MARINO


Sh. 4 of 4 REV. 00 01 02 03 04 — X X X X X

				DATA TUBING													FROM AREA					TO AREA							
POS.	REV	SUPPLY SCOPE	LAINING SCOPE	TAG Tubing	P&ID	MAIN FUNCTION	SERVICE	DESIGN TEMPERATURE(C°)	OPERATING PRESSURE (Barg)	DESIGN PRESSURE (Barg)	TEST PRESSURE (Barg)	FLUID TEST	DIMENSIONS	MATERIAL	REF. DOC.	Q.TY (m)	FIRE PROOFING	HEAT TRACING	MODULE	AREA	FROM ITEM	REF. P&I	DESCRIPTION	MODULE	AREA	TO ITEM	REF. LAYOUT	DESCRIPTION	NOTE
01	04	RM	RM	**AV-63001/25-XV-011**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N_2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-XV-011	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
02	04	RM	RM	**AV-63001/25-FV-033**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-FV-033	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
03	04	RM	RM	**AV-63001/25-XV-008**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-XV-008	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
04	04	RM	RM	**AV-63001/25-FV-032**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-FV-032	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
05	04	RM	RM	**AV-63002/25-XV-020**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-020	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
06	04	RM	RM	**AV-63002/25-FV-036**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**11**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-036	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
07	04	RM	RM	**AV-63002/25-XV-017**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-017	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
08	04	RM	RM	**AV-63002/25-FV-038**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-038	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
09	04	RM	RM	**AV-63002/25-XV-014**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-014	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
10	04	RM	RM	**AV-63002/25-FV-034**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-034	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
11	04	RM	RM	**AV-63003/25-BDV-010**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-BDV-010	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
12	04	RM	RM	**AV-63003/25-PV-040**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-PV-040	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
13	04	RM	RM	**AV-63003/25-XV-012**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-XV-012	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
14	04	RM	RM	**AV-63003/25-XV-009**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**13**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-XV-009	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
15	04	RM	RM	**AV-63004/25-BDV-013**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-BDV-013	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
16	04	RM	RM	**AV-63004/25-PV-043**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-PV-043	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
17	04	RM	RM	**AV-63004/25-XV-015**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-XV-015	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
18	04	RM	RM	**AV-63005/64-PV-031A**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Lower Deck	AV-63005	123A90-DDL-PR-PID-80041	Distribution Pot 5	BLPH	Lower Deck	64-PV-031A	123A90-DDL-IN-DL-40080	Pneumatic Control Valve	Design Pressure set as per downstream PSV
19	04	RM	RM	**AV-63005/64-PV-031B**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**3**	N.A.	N.A.	BLPH	Lower Deck	AV-63005	123A90-DDL-PR-PID-80041	Distribution Pot 5	BLPH	Lower Deck	64-PV-031B	123A90-DDL-IN-DL-40080	Pneumatic Control Valve	Design Pressure set as per downstream PSV
20	04	RM	RM	**AV-63006/25-BDV-022**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-BDV-022	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
21	04	RM	RM	**AV-63006/25-XV-021**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-XV-021	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
22	04	RM	RM	**AV-63006/25-PV-049**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-PV-049	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
23	04	RM	RM	**AV-63006/25-BDV-019**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-BDV-019	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
24	04	RM	RM	**AV-63006/80-XV-001**	123A90-DDL-PR-PID-80012	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	80-XV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
25	04	RM	RM	**AV-63007/25-XV-006**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-XV-006	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
26	04	RM	RM	**AV-63007/25-PV-035**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**11**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-PV-035	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
27	04	RM	RM	**AV-63007/25-BDV-005**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-BDV-005	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
28	04	RM	RM	**AV-63007/25-PV-037**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-PV-037	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
29	04	RM	RM	**AV-63007/25-BDV-007**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-BDV-007	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
30	04	RM	RM	**AV-63008/50-XV-001**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-001	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
31	04	RM	RM	**AV-63008/50-XV-002**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-002	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
32	04	RM	RM	**AV-63008/50-XV-003**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-003	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
33	04	RM	RM	**AV-63008/50-XV-004**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-004	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
33A	04	RM	RM	**AV-63009/50-XV-005**	123A90-DDL-PR-PID-80025	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Lower Deck	AV-63009	123A90-DDL-PR-PID-80041	Distribution Pot 9	BLPH	Lower Deck	50-XV-005	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
34	04	RM	RM	**AV-63010/25-SDV-001**	123A90-DDL-PR-PID-80013	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-SDV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
35	04	RM	RM	**AV-63010/25-XV-024**	123A90-DDL-PR-PID-80013	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-XV-024	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
36	04	RM	RM	**AV-63010/25-XV-004**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-XV-004	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
37	04	RM	RM	**AV-63010/25-FV-031**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-FV-031	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
38	04	RM	RM	**AV-63010/64-SDV-001**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**15**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	64-SDV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
39	04	RM	RM	**AV-63011/25-SDV-023**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-SDV-023	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
40	04	RM	RM	**AV-63011/25-PV-055A**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-PV-055A	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
41	04	RM	RM	**AV-63011/25-PV-055B**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-PV-055B	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
42	04	RM	RM	**AV-63012/25-XV-018**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-XV-018	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
43	04	RM	RM	**AV-63012/25-PV-046**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-PV-046	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
44	04	RM	RM	**AV-63012/25-BDV-016**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-BDV-016	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
~~45~~	03	DELETED	DELETED	~~**BLPH-MV-014/26-PT-001**~~	~~123A90-DDL-PR-PID-80013~~	~~Process Connection~~	~~Hydrogen~~	~~80~~	~~7,5 / 30~~	~~40~~	~~7,5 / 30~~	~~N_2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-014~~	~~123A90-DDL-PR-PID-80013~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25-PT-001~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~46~~	03	DELETED	DELETED	~~**BLPH-MV-013/25-PT-002**~~	~~123A90-DDL-PR-PID-80013~~	~~Process Connection~~	~~Hydrogen~~	~~80~~	~~7,5 / 30~~	~~40~~	~~7,5 / 30~~	~~N_2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-013~~	~~123A90-DDL-PR-PID-80013~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25 PT 002~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~47~~	03	DELETED	DELETED	~~**BLPH-MV-025/26-PT-055A**~~	~~123A90-DDL-PR-PID-80014~~	~~Process Connection~~	~~Hydrogen~~	~~100~~	~~17,7~~	~~10~~	~~17,7~~	~~N_2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-025~~	~~123A90-DDL-PR-PID-80014~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~26 PT 055A~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~48~~	03	DELETED	DELETED	~~**BLPH-MV-213/26-PT-055B**~~	~~123A90-DDL-PR-PID-80014~~	~~Process Connection~~	~~Hydrogen~~	~~100~~	~~3,5 / 6,5~~	~~10~~	~~3,5 / 6,5~~	~~N_2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-213~~	~~123A90-DDL-PR-PID-80014~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~25-PT-055B~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~49~~	03	DELETED	DELETED	~~**BLPH-MV-407/43-PT-001**~~	~~123A90-DDL-PR-PID-80029~~	~~Process Connection~~	~~Hydrogen~~	~~-10 / +80~~	~~ATM~~	~~3,5~~	~~ATM~~	~~N_2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-407~~	~~123A90-DDL-PR-PID-80029~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~43-PT-001~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~50~~	03	DELETED	DELETED	~~**BLPH-MV-411/50-PT-014**~~	~~123A90-DDL-PR-PID-80026~~	~~Process Connection~~	~~Waste Water~~	~~100~~	~~ATM~~	~~17,7~~	~~ATM~~	~~N_2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~YES~~	~~BLPH~~	~~Lower Deck~~	~~BLPH-MV-411~~	~~123A90-DDL-PR-PID-80026~~	~~Manual Valve~~	~~BLPH~~	~~Lower Deck~~	~~60-PT-014~~	~~123A90-DDL-IN-DL-40080~~	~~Pressure Transmitter~~	
~~51~~	03	DELETED	DELETED	~~**BLPH-MV-150/63-PT-003**~~	~~123A90-DDL-PR-PID-80027~~	~~Process Connection~~	~~Instrument Air~~	~~100~~	~~4 / 10~~	~~11~~	~~4 / 10~~	~~N_2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-150~~	~~123A90-DDL-PR-PID-80027~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~63-PT-003~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~52~~	03	DELETED	DELETED	~~**BLPH-MV-151/63-PT-004**~~	~~123A90-DDL-PR-PID-80027~~	~~Process Connection~~	~~Instrument Air~~	~~100~~	~~4 / 10~~	~~11~~	~~4 / 10~~	~~N_2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-151~~	~~123A90-DDL-PR-PID-80027~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~63-PT-004~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
53	04	RM	RM	**BLPH-MV-386/64-PT-031A**	123A90-DDL-PR-PID-80027	Process Connection	Nit

DRAWING NO. 12390-DDL-IN-DL-40085

REV. 01

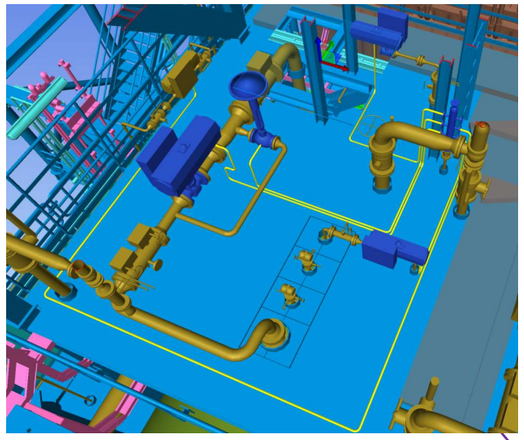

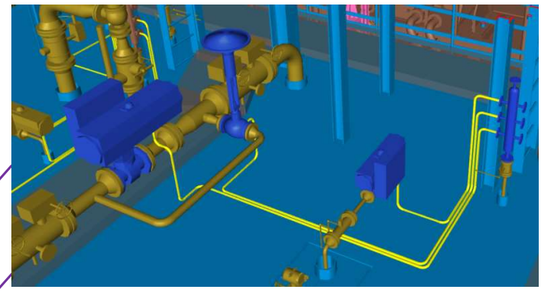

FUEL CELL TRANSFORMER
A-80000

CRANE
X-99001

25-BDV-022
+34.740mm
+4.430mm T.O.S

AV-63006
+35.085mm
+4.775mm T.O.S

80-XV-001
+34.508mm
+4.198mm T.O.S

25-PV-049
+34.740mm
+4.430mm T.O.S

25-BDV-019
+34.740mm
+4.430mm T.O.S

Q-43004
HYDROGEN VENT

25-XV-021
+34.479mm
+4.169mm T.O.S

25-BDV-016
+34.740mm
+4.430mm T.O.S

V-25001A V-25001B V-25001C

REFER SHEET-001

HYDROGEN STORAGE VESSELS

AV-63010
+35.834mm
+5.524mm T.O.S

25-XV-024
+35.140mm
+4.830mm T.O.S

25-SDV-001
+35.140mm
+4.830mm T.O.S

25-XV-004
+35.245mm
+4.935mm T.O.S

25-FV-031
+35.245mm
+4.935mm T.O.S

A-20000
ELECTROLYSER

AV-63012
+35.085mm
+4.775mm T.O.S

AV-63004
+35.085mm
+4.775mm T.O.S

25-XV-015
+34.479mm
+4.169mm T.O.S

25-PV-043
+34.740mm
+4.430mm T.O.S

25-BDV-013
+34.740mm
+4.430mm T.O.S

25-XV-018
+34.508mm
+4.198mm T.O.S

25-PV-046
+34.740mm
+4.430mm T.O.S


25-XV-008
+35.245mm
+4.935mm T.O.S


AV-63001
+35.834mm
+5.524mm T.O.S

25-XV-011
+35.245mm
+4.935mm T.O.S

25-FV-033
+35.245mm
+4.935mm T.O.S

25-FV-032
+35.245mm
+4.935mm T.O.S

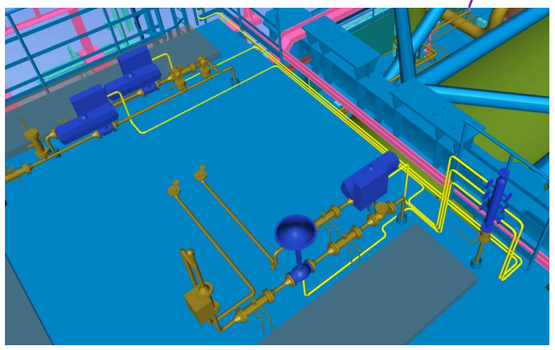

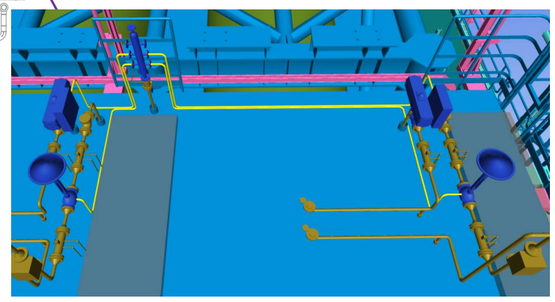


UPPER DECK


SCALE: 1:1

VIEW EL. 33740mm to 36500mm


AV-63001

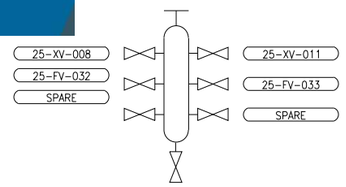


AV-63004

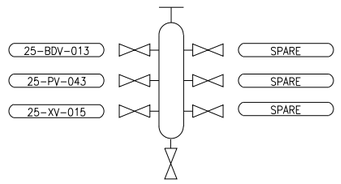


AV-63006

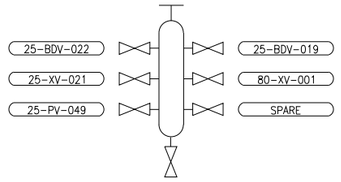



AV-63010

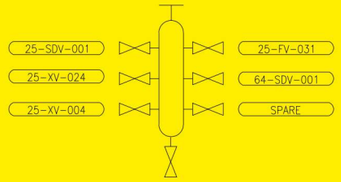

AV-63012

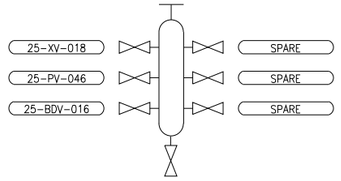



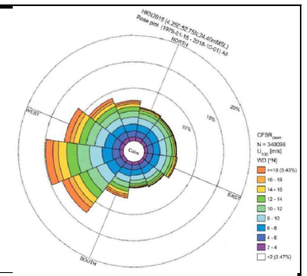

NOTES

1) TUBING ROUTING > 2m IS SHOWN AND IT IS INDICATIVE ONLY.
TUBING ROUTING SHALL BE FINALIZED DURING CONSTRUCTION ACTIVITIES.

LEGEND

- AIR DISTRIBUTION POT
- CONTROL VALVE
- ON-OFF VALVE
- TUBING
- TUBING GOING UP
- TUBING GOING DOWN

HOLDS

REFERENCE DOCUMENTS

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	23/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/02/24	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND | ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT TUBING LAYOUT
ELEVATION 30.310 m

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-DL-40085**

REV.:	DATE:	SIGNATURE:
1_C	12/12/24	C.Pilato


ROSETTI MARINO SpA

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK				SCALE 1:100
DRAWN DRAWN_BY	CHECKED CHECKED_BY	APPROVED APPROVED_BY		DATE DD/MM/YY
A1	DRAWING NO. 123A90-DDL-IN-DL-40085		SHEET 002	REV. 01

File Name : 12390-DDL-IN-DL-40085_Rev.01

DRAWING NO. DRAWING_NO.

REV. REV

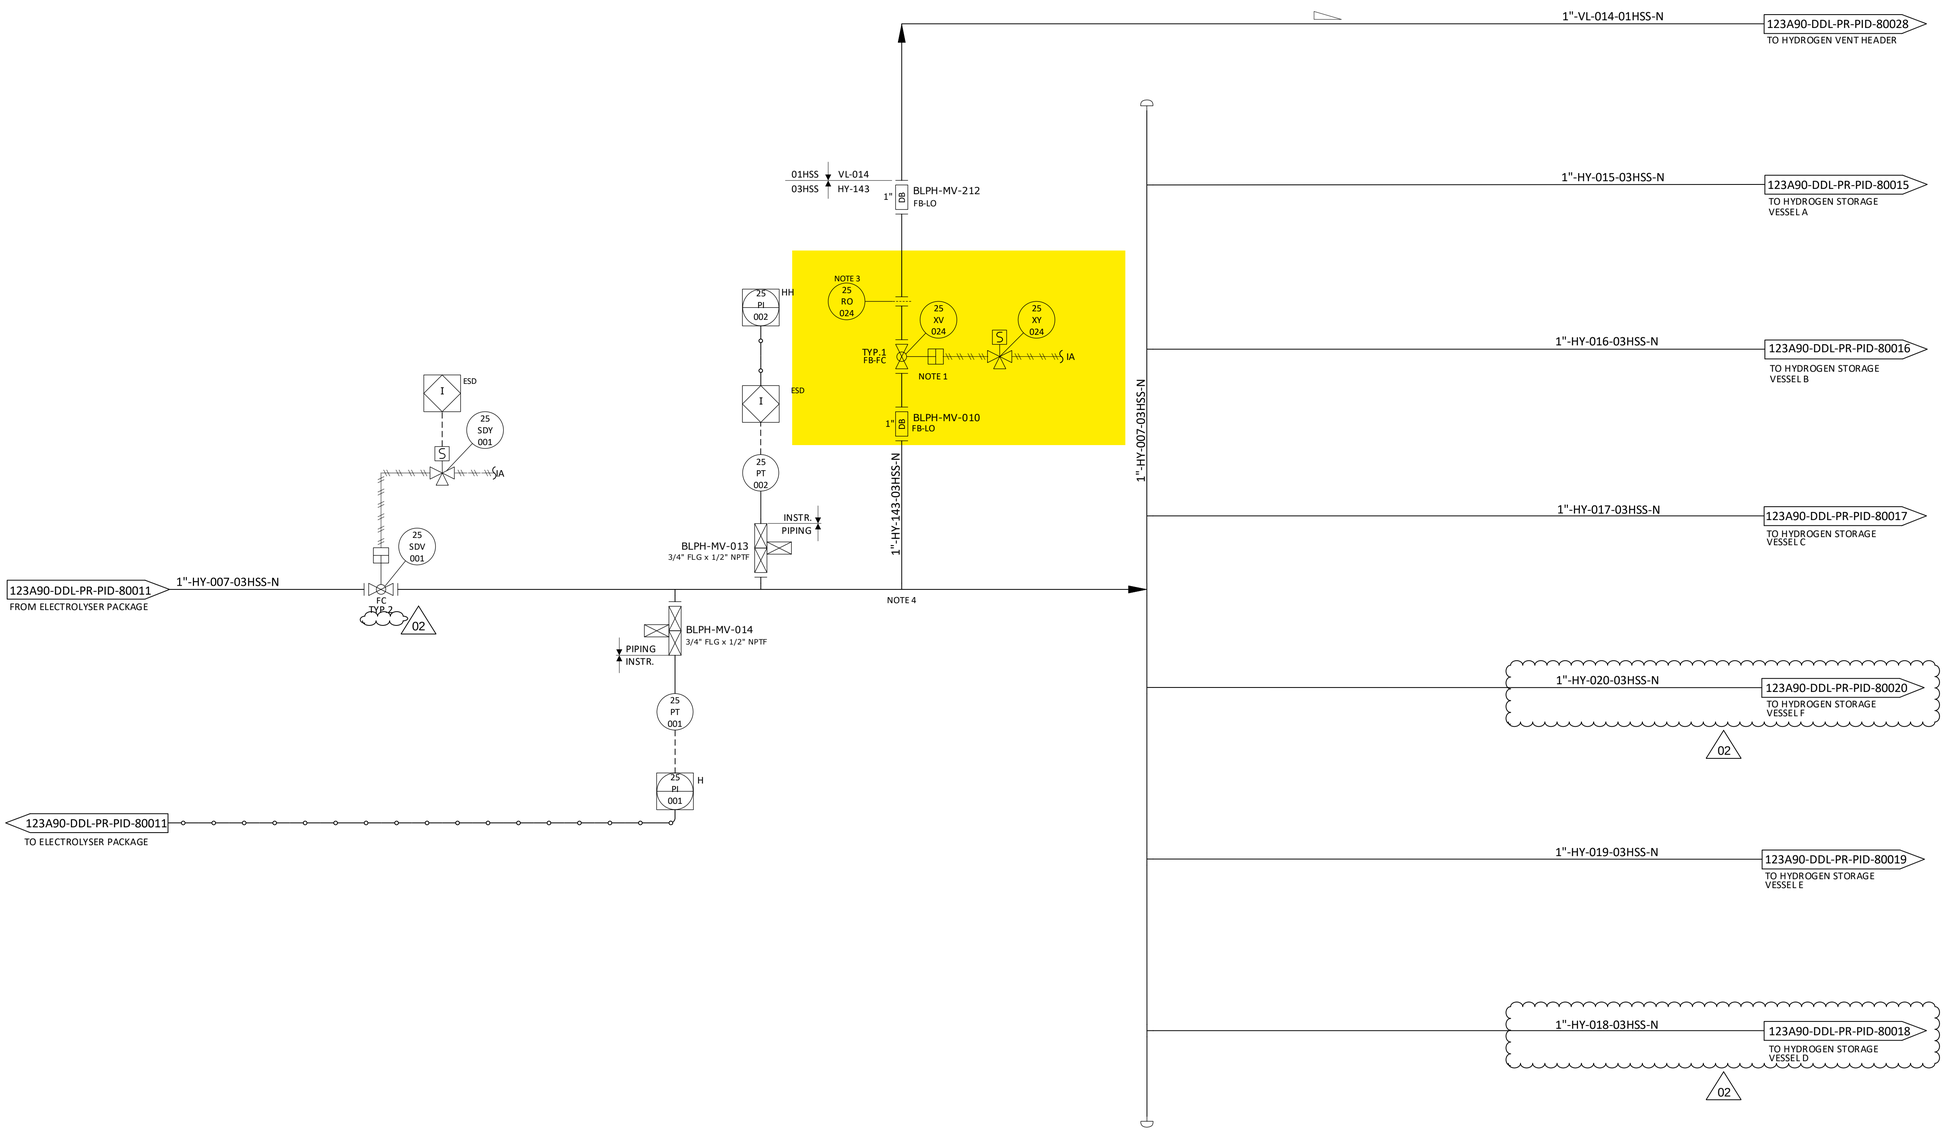

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :

BLPH PIPING AND INSTRUMENTATION DIAGRAM HYDROGEN STORAGE VESSELS HEADER (INLET)

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80013	SHEET 001	REV. 02

File Name : FILE_NAME


CROSSWIND	HOLLANDSE KUST NOORD WIND PARK Project Contract No. CW-I-WP4-2023-05	ROSETTI MARINO
Document Title:	Instrument Pneumatic Hook-Ups	Sh. 6 of 6 Date: 08/07/2024 Rev. 01

PNEUMATIC HOOK-UP FOR ON-OFF VALVES

VALID FOR CONSTRUCTION
FDL DWG: **123A90-FDL-IN-HD-40078**

REV.:	DATE:	SIGNATURE:
1_B	06/11/24	G.Randi

ROSETTI MARINO SpA



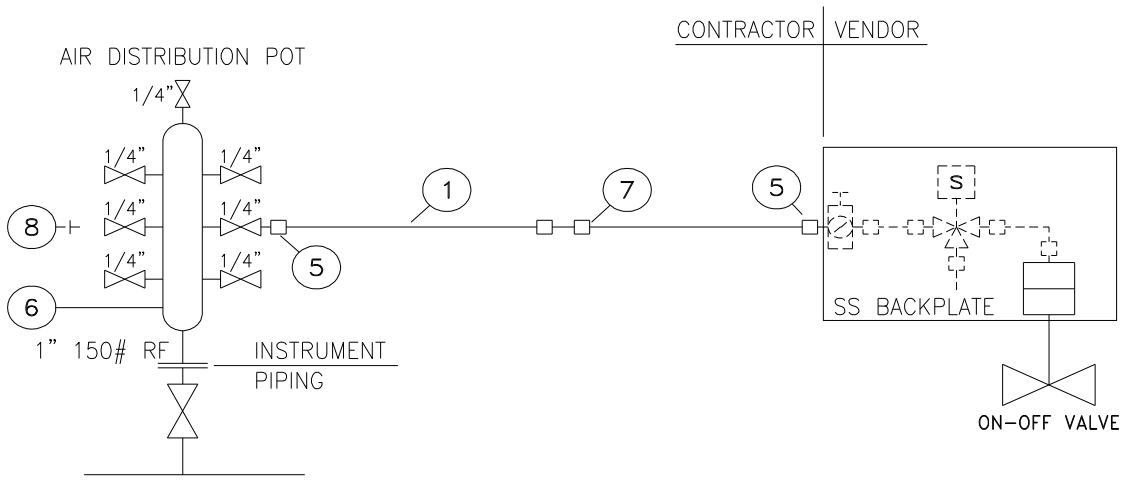


INSTRUMENT TAG	
1	25-BDV-022
2	25-BDV-005
3	25-BDV-007
4	25-BDV-010
5	25-BDV-013
6	25-BDV-016
7	25-BDV-019
8	25-SDV-001
9	25-SDV-023
10	25-XV-004
11	25-XV-006
12	25-XV-008
13	25-XV-009
14	25-XV-011
15	25-XV-012
16	25-XV-014
17	25-XV-015
18	25-XV-017
19	25-XV-018
20	25-XV-020
21	25-XV-021
22	25-XV-024
23	50-XV-001
24	50-XV-002
25	50-XV-003
26	50-XV-004
27	80-XV-001
28	64-SDV-001
29	50-XV-005
30	

NOTE:
(1) For Air Distribution Pot quantities see material take-off on sh. 4

POS.	NORM/STD CODE	DESCRIPTION	SIZE/CONNECTION TYPE	Q.TY
8		SS316 PLUG	1/4" NPT	Note 1
7		SS316 UNION	1/2" O.D. x 1/2" O.D.	N. 1
6		SS316 AIR DISTRIBUTION POT	1" 150#RF - N. 7 1/4" BALL VALVES	Note 1
5		SS316 MALE CONNECTOR	1/4" NPT x 1/2" O.D.	N. 2
1		SS 316L TUBING	1/2" x 0,049"Thk	10 m

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

POS	PICTURE	DESCRIPTION		ITEM ID CODE	TOTAL					
		COMPRESSION FITTING TYPE: **DOUBLE FERRULE** THREADING: ASME B1.20.1 NPT MATERIAL: AISI 316 WORKING PRESSURE AS PER ASME B31.1 TUBING TYPE: ■ INCHES ☐ METRIC			UNIT	Counted	Required			
							Rev. 00	Rev. 01	Rev.	Rev.
1		STRAIGHT MALE CONNECTOR	1/2" NPT-M x 3/8" O.D.		nr.					
2			1/4" NPT-M x 1/2" O.D.		nr.	102	102	102		
3			1/2" NPT-M x 1/2" O.D.		nr.	36	36	-		
4			1/2" NPT-M x 3/4" O.D.		nr.					
5			3/4" NPT-M x 3/4" O.D.		nr.					
6			3/8" NPT-M x 3/8" O.D.		nr.					
7		STRAIGHT FEMALE CONNECTOR	1/2" NPT-F x 3/8" O.D.		nr.					
8			1/4" NPT-F x 1/2" O.D.		nr.					
9			1/2" NPT-F x 1/2" O.D.		nr.					
10			1/2" NPT-F x 3/4" O.D.		nr.					
11		UNION CONNECTOR	1/4" O.D. x 1/4" O.D.		nr.					
12			3/8" O.D. x 3/8" O.D.		nr.					
13			1/2" O.D. x 1/2" O.D.		nr.	49	49	49		
14			3/4" O.D. x 3/4" O.D.		nr.					
15		ELBOW CONNECTOR	1/4" NPT-M x 1/2" O.D.		nr.	27	27	27		
16			1/2" NPT-M x 1/2" O.D.		nr.					
17										
18										
19										
20										
21										
22										
23										
24										
25										
26										
27										
28										
29										
30										
27										
28										
29										
30										
31										
32										
33										
34										

VENDOR / ORDER : **AF SYSTEM / 1724001332**

MATERIAL :

- ☐ ASTM A106 Gr.B
- ■ AISI 316 L
- ☐ UNS S31254

SPECIAL REQUIREMENTS :

- ☐ ...

REMARKS :

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CERTIFICATO DI TARATURA LAT 114 0435-SM-24
Certificate of Calibration

- data di emissione date of issue	2024-09-20
- cliente customer	FAST AUTOMATION SRL VIA DELLA PREVIDENZA SOCIALE, 8 IT-42124 REGGIO EMILIA (RE)
- destinatario receiver	ROSETTI MARINO SPA - YARD PIOMBONI VIA DEL MARCHESATO, 37 IT-48122 MARINA DI RAVENNA (RA)

Si riferisce a
referring to

- oggetto *item*	Misuratore di pressione elettronico Electrical pressure gauge
- costruttore *manufacturer*	WIKA
- modello *model*	CPG1500
- matricola *serial number*	1A014ILJJIM
- data di ricev. oggetto *date of receipt of item*	2024-09-17
- data delle misure *date of measurements*	2024-09-20
- registro di laboratorio *laboratory reference*	0435-SM-24

Il presente certificato di taratura è emesso in base all'accreditamento LAT N. 114 rilasciato in accordo ai decreti attuativi della legge n. 273/1991 che ha istituito il Sistema Nazionale di Taratura (SNT). ACCREDIA attesta le capacità di misura e di taratura, le competenze metrologiche del Centro e la riferibilità delle tarature eseguite ai campioni nazionali ed internazionali delle unità del Sistema Internazionale delle Unità (SI).
Questo certificato non può essere riprodotto in modo parziale, salvo espressa autorizzazione scritta da parte del Centro.

This certificate of calibration is issued in compliance with the accreditation LAT No.114 granted according to decrees connected with Italian law No. 273/1991 which has established the National Calibration System. ACCREDIA attests the calibration and measurement capability, metrological competence of the Centre and the traceability of calibration results to the national and International standards of the International System of Units (SI).
This certificate may not be partially reproduced, except with the prior written permission of the issuing Centre.

I risultati di misura riportati nel presente Certificato sono stati ottenuti applicando le procedure di taratura citate alla pagina seguente, dove sono specificati anche i campioni o gli strumenti che garantiscono la catena di riferibilità del Centro e i rispettivi certificati di taratura in corso di validità. Essi si riferiscono esclusivamente all'oggetto in taratura e sono validi nel momento e nelle condizioni di taratura, salvo diversamente specificato.

The measurement results reported in this Certificate were obtained following the calibration procedures given in the following page, where the reference standards or instruments are indicated which guarantee the traceability chain of the laboratory, and the related calibration certificates in the course of validity are indicated as well. They relate only to the calibrated item and they are valid for the time and conditions of calibration, unless otherwise specified.

Le incertezze di misura dichiarate in questo documento sono state determinate conformemente alla Guida ISO/IEC 98 e al documento EA-4/02. Solitamente sono espresse come incertezza estesa ottenuta moltiplicando l'incertezza tipo per il fattore di copertura *k* corrispondente ad un livello di fiducia di circa il 95 %. Normalmente tale fattore *k* vale 2.

The measurement uncertainties stated in this document have been determined according to the ISO/IEC Guide 98 and to EA-4/02. Usually, they have been estimated as expanded uncertainty obtained multiplying the standard uncertainty by the coverage factor k corresponding to a confidence level of about 95%. Normally, this factor k is 2.

Direzione Tecnica
(Approving Officer)

Enrico Reccagni

Enrico Reccagni

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CARATTERISTICHE DELLO STRUMENTO IN TARATURA/ Properties of devices under calibration

Misuratore di pressione elettronico ***Electrical pressure gauge***	
Tipo *Model*	Misuratore di pressione elettronico Electrical pressure gauge
Numero di matricola *Serial No.*	1A014ILJJIM
Campo di misura *Scale range*	(0 ... 1000) bar g
Accuratezza dichiarata dal costruttore *Accuracy declared by the manufacturer*	0,1 % FS
Risoluzione *Resolution (scale division)*	0,1 bar
Tag. N. *Tag No.*	--

Procedura di taratura e catena di riferibilità
Calibration procedure and traceability chain

La taratura è stata effettuata in accordo alla linea guida DKD-R 6-1 "Taratura di strumenti di pressione" (versione 03/2014) procedura B, per confronto fra i valori dello strumento in taratura con quelli di riferimento dati dal campione di lavoro.

Calibration was carried out according to DKD-R 6-1 "Kalibrierung von Druckmessgeräten" (Ausgabe 03/2014) procedure B, by comparing the measured values of the calibration item with those of the reference or working standard.

I risultati riportati sono stati ottenuti applicando le procedure n° LMO-PT-01 rev.2

The results have been obtained using the procedures n° LMO-PT-01 rev.2

La catena di riferibilità ha inizio dai campioni di riferimento n° PM1-09

The traceability chain starts from the reference standards n° PM1-09

muniti di certificati validi di taratura, rispettivamente n° D21090

with the relevant valid calibration certificates n° D21090

Luogo di taratura
Place of calibration

Laboratorio WIKA ITALIA - Laboratorio di Modugno (BA)
WIKA ITALY Laboratory - Modugno (BA)

Campione di lavoro
Working Standard

Norma di riferimento (RS) Bilancia di pressione ***Reference standard (RS) Dead-weight tester***	
Tipo *Model*	PM1-09
Certificato di taratura *Calibration mark*	D-K-15105/D21090
Campo di misura *Scale range*	(10 ... 2500) bar g
Accuratezza *Accuracy*	0,015 % della lettura + 255 Pa

Operatore
Technichian

Francesco Donatelli

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Condizioni di misura
Measurement conditions

Schema di collegamento *Assembly*	
Fluido utilizzato *Pressure medium*	Sebacate *Sebacate*
Livello di riferimento *Refence height (for reference value)*	Superficie di tenuta DUT *Sealing face DUT*
Posizione di montaggio *Position during calibration*	verticale *vertical*

Note di taratura
Calibration Note

Lo strumento è stato tarato e riconsegnato nelle stesse condizioni in cui è arrivato nel laboratorio, in accordo con il metodo "as found as left" / The device under test (DUT) was calibrated in the same conditions it was arrived in laboratory, according to the method "as found as left".

Condizioni Ambientali
Environmental conditions

Temperatura *Temperature*	(22 ± 1,5)	°C
Pressione atmoferica *Atmospheric pressure*	(1009,3 ± 0,2)	hPa
Umidità relativa *Rel. Humidity*	(50 ± 15)	% UR

I dati meteo sono stati acquisiti tramite stazione meteo WIKA CPU6000-W s/n.1A00VCX6GJ2

Weather data were acquired via the WIKA CPU6000-W weather station s/n.1A00VCX6GJ2

Misure rilevate
Measurement results

Valore di riferimento *Reference value RS* bar	**Letture** *Reading DUT* bar		
	M1	**M2**	**M3**
0,00	0,0	0,0	0,0
99,91	99,9	99,9	99,9
199,82	199,9	199,9	199,9
299,73	299,8	299,8	299,8
399,63	399,7	399,7	399,7
499,53	499,5	499,6	499,6
599,44	599,4	599,4	599,4
699,34	699,3	699,3	699,3
799,25	799,1	799,2	799,1
899,14	899,0	899,1	899,0
999,04	999,0	999,0	999,0

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it


Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Incertezza di misura
Uncertainty of measurement

Valori di riferimento *Reference value RS* bar	Media delle misure *Mean value* bar	Errore *Error* bar	Ripetibilità *Repeatability* bar	Isteresi *Hysteresis* bar	Incertezza di misura *Meas. Uncertainty* bar
0,00	0,0	0,0	0,0	0,0	0,40
99,91	99,9	0,0	0,0	0,0	0,40
199,82	199,9	0,1	0,0	0,0	0,40
299,73	299,8	0,1	0,0	0,0	0,40
399,63	399,7	0,1	0,0	0,0	0,40
499,53	499,6	0,1	0,1	0,1	0,40
599,44	599,4	0,0	0,0	0,0	0,40
699,34	699,3	0,0	0,0	0,0	0,40
799,25	799,2	0,0	0,0	0,1	0,40
899,14	899,1	0,0	0,0	0,1	0,40
999,04	999,0	0,0	0,0	0,0	0,40

Grafico degli errori di misura
Graphical representation of measurement uncertainty

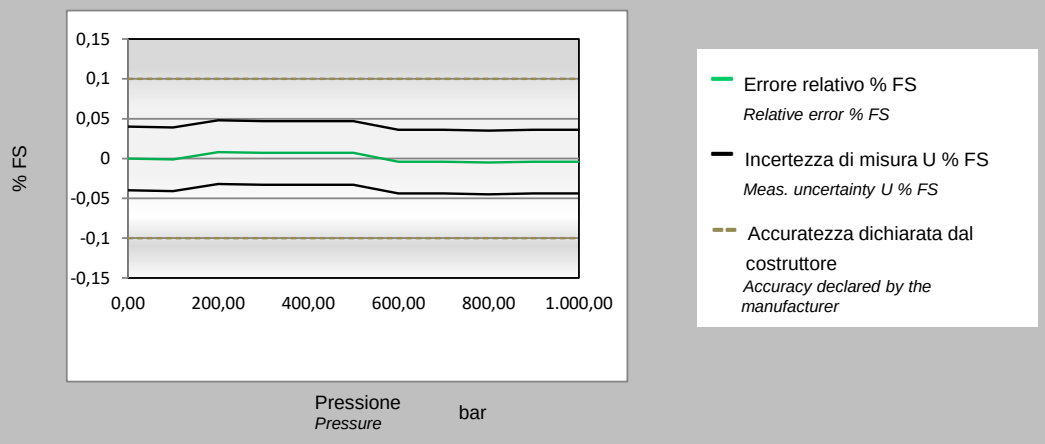

L'incertezza estesa senza correzione del DUT è pari a 0,5 bar
The expanded uncertainty of the DUT without correction is equal to

Questo dato è ottenuto come MAX{Incertezza_di_misura$_i$ + |Errore$_i$|} della tabella precedente
This data is obatined as MAX{Meas._uncertainty$_i$ + |Error$_i$|} of the previous table

Il presente certificato non rappresenta una dichiarazione di conformità a specifica
This certificate is not a statement of compliance

ITEM	Tag	AV-63010/25-XV-004	: Pneumatic Connection Air Supply - 25-XV-004			Dwg	123A90-DDL-IN-LIS-40092
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10001975		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form	CJX06 Tubing Hydraulic

General

1	Drawings (P&ID tube) attached.	OK
2	Isometric drawings (P&ID pipe) attached.	NA
3	Check drawings at last revision.	OK
4	Material certificates for pipe/tube/fittings/flanges/hose and support clamps checked	OK
5	Welders certificates checked	NA
6	Certificate and mark-up drawings for welding WPS and WPQR and material certificates checked	NA
7	Certificates and mark-up drawings for NDT report checked	NA

Check before Flushing and/or Testing

8	Installation complete and in compliance with drawings and specifications.	OK
9	Tubing/Piping tray checked.	NA
10	Hose according to specifications and tightened	NA
11	Flanges - nuts and bolts tightened.	NA
12	Fittings are mounted and tightened.	OK
13	Pipe supports completed and installed as required.	OK
14	Cable ladders, trays, sharp edges protected, cut ends sealed.	NA
15	Maintenance evaluation.	OK

REFER TO FINAL SHEET FOR ACCEPTANCE

ITEM	Tag	AV-63010/25-XV-004	: Pneumatic Connection Air Supply - 25-XV-004	Dwg	123A90-DDL-IN-LIS-40092		
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)	Module	UD		
TASK	code	C10001975	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity CCK	Discipline	Instrumental	Form CJX06	Tubing Hydraulic

Flushing / Pressure testing

16	Drawings of flushing loops (P&ID tube) attached	NA
17	Equipment & valves bypassed and blinded	OK
18	Calibration certificates attached	OK
19	Type of flushing medium correct	NA
20	Printout from recorder/particle counter	NA
21	Printout from pressure indicator	OK

Final Check

22	Final inspection of pipework.	OK
23	Preservation of tested pipework.	NA
24	System/equipment labelled with: "Hot Oil flushing performed".	NA
25	If required produce Red Line Mark Up for "AS BUILT"	

TEST SPECIFIED USED

TEST FLUID: IA TEST PRESSURE BAR G: 9 TEST DURATION : 12 min

TEST EQUIPMENT: CPG 1500 SERIAL N°: 1A014ILJJIM

HOOK UP DIAGRAM Number: 123A90-DDL-IN-HD-40078

Line FROM	Line TO	Tubing cleaned			Tubing flushed			Diam ID/OD
		Yes	No	N/A	Yes	No	N/A	
AV-63010	25-XV-004						●	1/2" OD x Thk. 0,049"

TESTED LABEL AFFIXED DATA SHEET ATTACHED

Comments:

	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	ICS IMPIANTI	RM (ROSETTI MARINO)	
Name	Michele Tartaglia	Paolo Schintu	
Date	2025-01-25	2025-01-30	
Signature	PROVERLIS Digitaly signed by Michele Tartaglia 2025-01-25T13:58:26.509Z	PROVERLIS Digitaly signed by Paolo Schintu 2025-01-30T14:51:58.922Z	

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	AV-63010/25-XV-004

Instrument

Strumento

Electrical pressure gauge *Misuratore di pressione elettronico*	
Model *Modello*	CPG1500
Serial number *Numero di serie*	1A014ILJJIM
Log temperature *Registrazioni di Temperatura*	Active *Attivo*
Scale range *Campo scala*	(0 ... 1000) bar a
Accuracy *Accuratezza*	0.1 % FS
Tag number *Numero tag*	
Communication *Comunicazione*	Wireless (00:13:43:85:DD:8D)

Measurement conditions

Condizioni di misura

Settings *Impostazioni*	
Mode *Modalità*	Automatic *Automatico*
Interval (ms) *Intervallo (ms)*	15000
Duration (hh:mm:ss) *Durata (hh:mm:ss)*	00:12:36
Start time (hh:mm:ss) *Tempo di avvio (hh:mm:ss)*	10:43:18 pm

Logger protocol

Protocollo di acquisizione elenco dati


ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	123A90-Tubing_2

Measurement results

Risultati della misura

Graphical representation of progression
Rappresentazione grafica dell'andamento

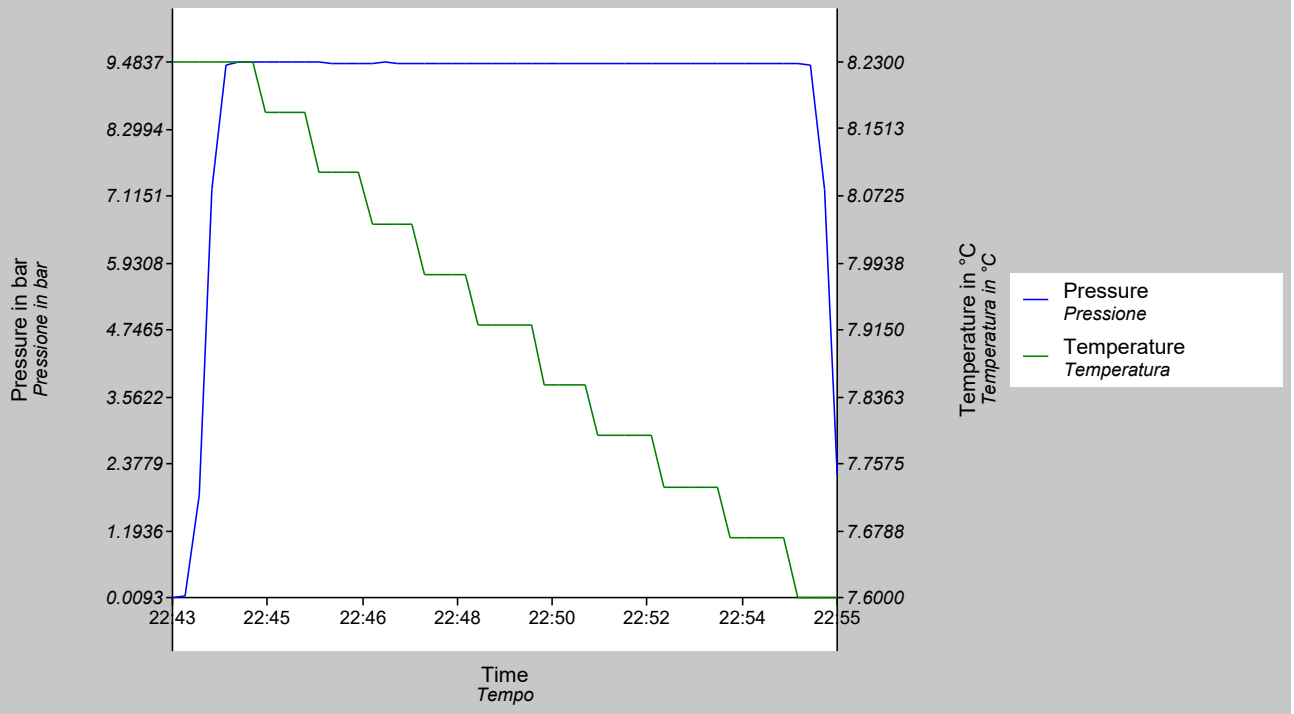

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/24/2025 22:43:18.000	0.0093	8.2300
01/24/2025 22:43:33.000	0.0334	8.2300
01/24/2025 22:43:48.000	1.8084	8.2300
01/24/2025 22:44:03.000	7.2337	8.2300
01/24/2025 22:44:18.000	9.4304	8.2300
01/24/2025 22:44:33.000	9.4833	8.2300
01/24/2025 22:44:48.000	9.4837	8.2300
01/24/2025 22:45:03.000	9.4784	8.1700
01/24/2025 22:45:18.000	9.4777	8.1700
01/24/2025 22:45:33.000	9.4770	8.1700
01/24/2025 22:45:48.000	9.4738	8.1700
01/24/2025 22:46:03.000	9.4699	8.1000
01/24/2025 22:46:18.000	9.4653	8.1000
01/24/2025 22:46:33.000	9.4666	8.1000
01/24/2025 22:46:48.000	9.4675	8.1000
01/24/2025 22:47:03.000	9.4648	8.0400
01/24/2025 22:47:18.000	9.4698	8.0400

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	123A90-Tubing_2


Measurement results

Risultati della misura

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/24/2025 22:47:33.000	9.4676	8.0400
01/24/2025 22:47:48.000	9.4598	8.0400
01/24/2025 22:48:03.000	9.4667	7.9800
01/24/2025 22:48:18.000	9.4577	7.9800
01/24/2025 22:48:33.000	9.4651	7.9800
01/24/2025 22:48:48.000	9.4574	7.9800
01/24/2025 22:49:03.000	9.4634	7.9200
01/24/2025 22:49:18.000	9.4648	7.9200
01/24/2025 22:49:33.000	9.4595	7.9200
01/24/2025 22:49:48.000	9.4598	7.9200
01/24/2025 22:50:03.000	9.4604	7.9200
01/24/2025 22:50:18.000	9.4570	7.8500
01/24/2025 22:50:33.000	9.4569	7.8500
01/24/2025 22:50:48.000	9.4634	7.8500
01/24/2025 22:51:03.000	9.4587	7.8500
01/24/2025 22:51:18.000	9.4562	7.7900
01/24/2025 22:51:33.000	9.4617	7.7900
01/24/2025 22:51:48.000	9.4550	7.7900
01/24/2025 22:52:03.000	9.4556	7.7900
01/24/2025 22:52:18.000	9.4562	7.7900
01/24/2025 22:52:33.000	9.4611	7.7300
01/24/2025 22:52:48.000	9.4522	7.7300
01/24/2025 22:53:03.000	9.4522	7.7300
01/24/2025 22:53:18.000	9.4546	7.7300
01/24/2025 22:53:33.000	9.4547	7.7300
01/24/2025 22:53:48.000	9.4507	7.6700
01/24/2025 22:54:03.000	9.4519	7.6700
01/24/2025 22:54:18.000	9.4489	7.6700
01/24/2025 22:54:33.000	9.4440	7.6700
01/24/2025 22:54:48.000	9.4444	7.6700
01/24/2025 22:55:03.000	9.4456	7.6000
01/24/2025 22:55:18.000	9.4350	7.6000
01/24/2025 22:55:33.000	7.2298	7.6000
01/24/2025 22:55:48.000	2.1865	7.6000

DRAWING NO. 12390-DDL-IN-DL-40085


REV. 01

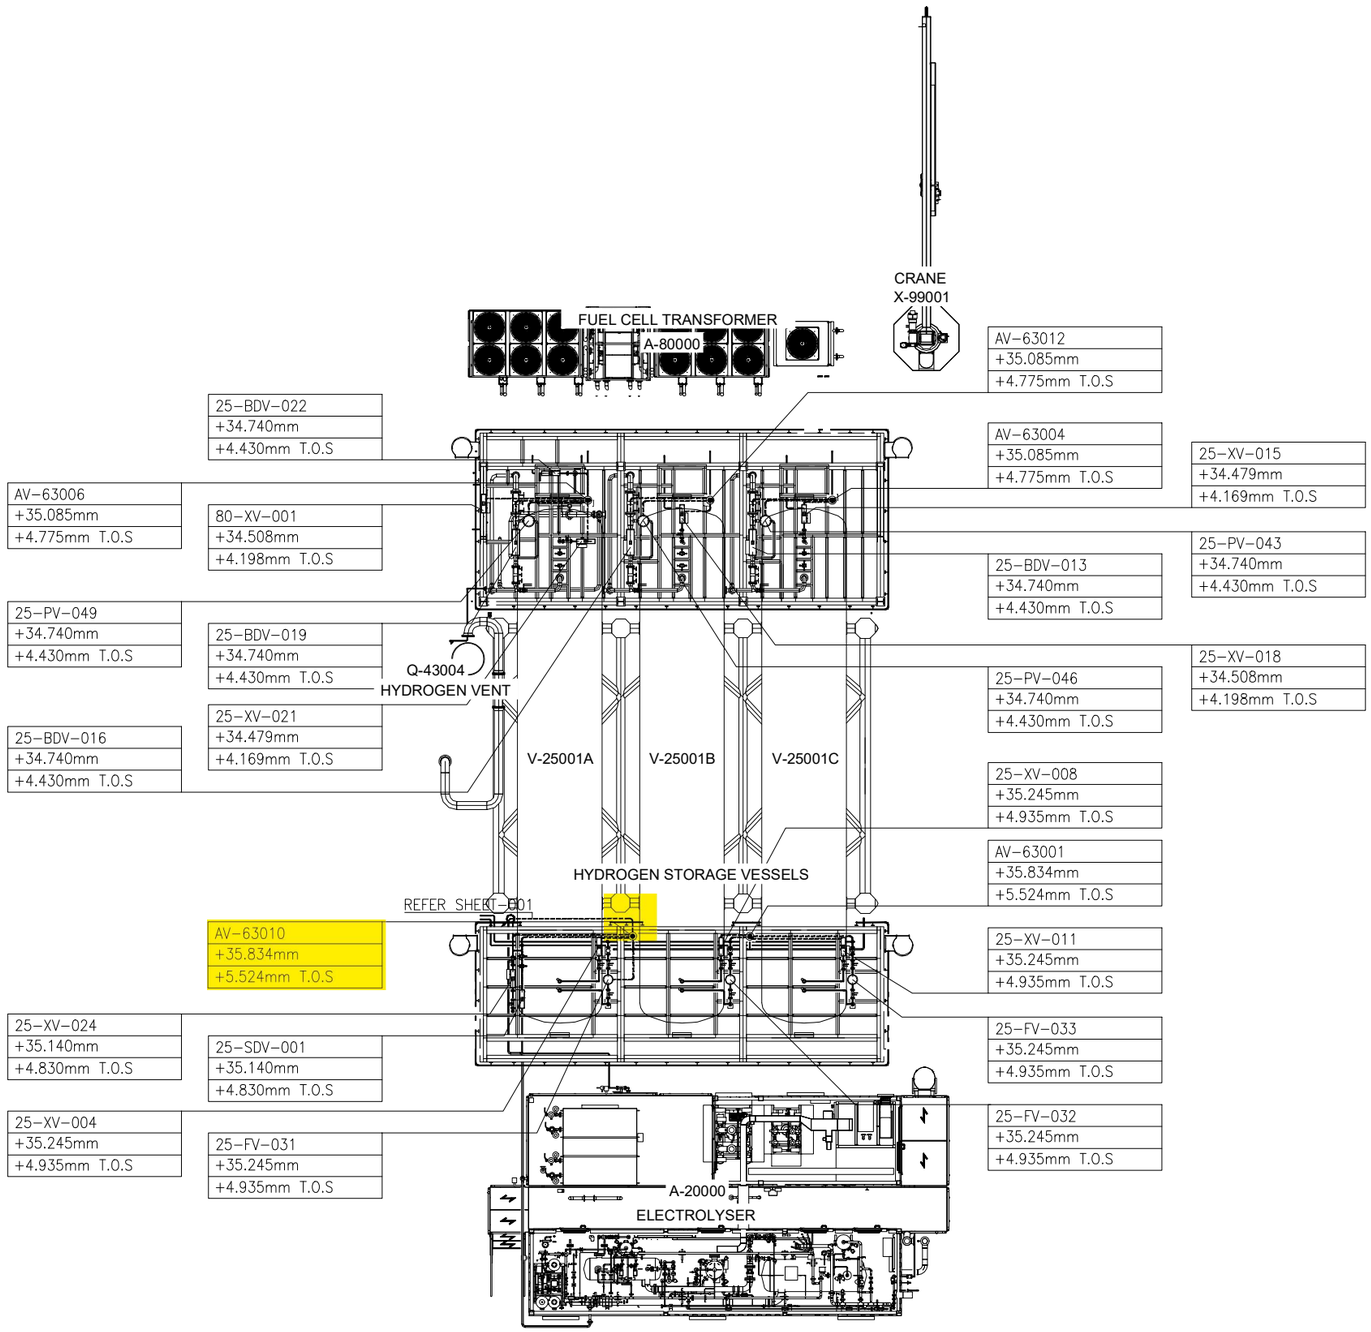



UPPER DECK


SCALE: 1:1


VIEW EL. 33740mm to 36500mm

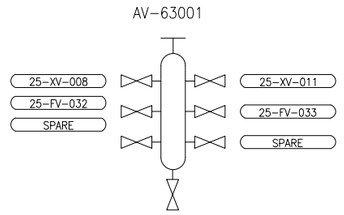


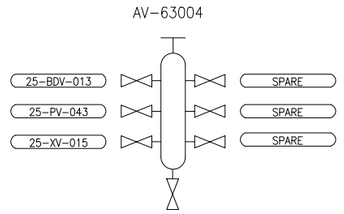


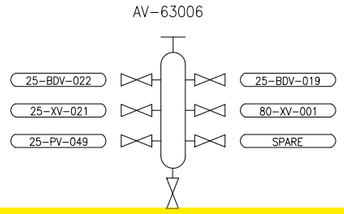

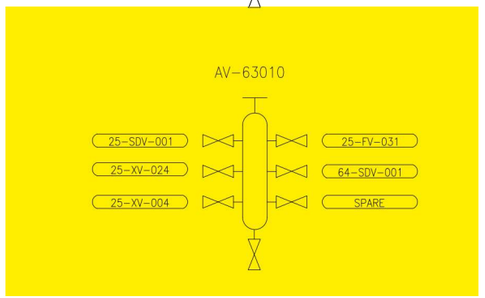

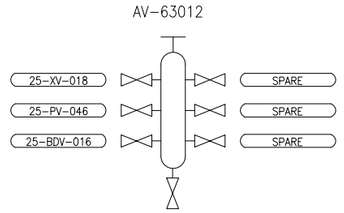



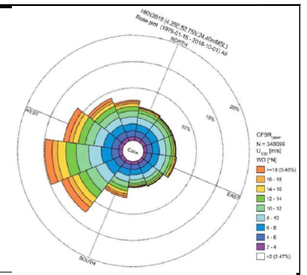

NOTES

1) TUBING ROUTING > 2m IS SHOWN AND IT IS INDICATIVE ONLY.
   TUBING ROUTING SHALL BE FINALIZED DURING CONSTRUCTION ACTIVITIES.

LEGEND

- AIR DISTRIBUTION POT
- CONTROL VALVE
- ON-OFF VALVE
- TUBING
- TUBING GOING UP
- TUBING GOING DOWN

HOLDS

REFERENCE DOCUMENTS

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	23/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/02/24	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND | ROSETTI MARINO


TITLE :
BASE LOAD POWER HUB (BLPH)
INSTRUMENT TUBING LAYOUT
ELEVATION 30.310 m

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1:100
DRAWN DRAWN_BY	CHECKED CHECKED_BY / APPROVED APPROVED_BY	DATE DD/MM/YY
A1	DRAWING NO. 123A90-DDL-IN-DL-40085	SHEET 002 / REV. 01

File Name : 12390-DDL-IN-DL-40085_Rev.01

DRAWING NO. 123A90-DDL-IN-DL-40081


REV. 02

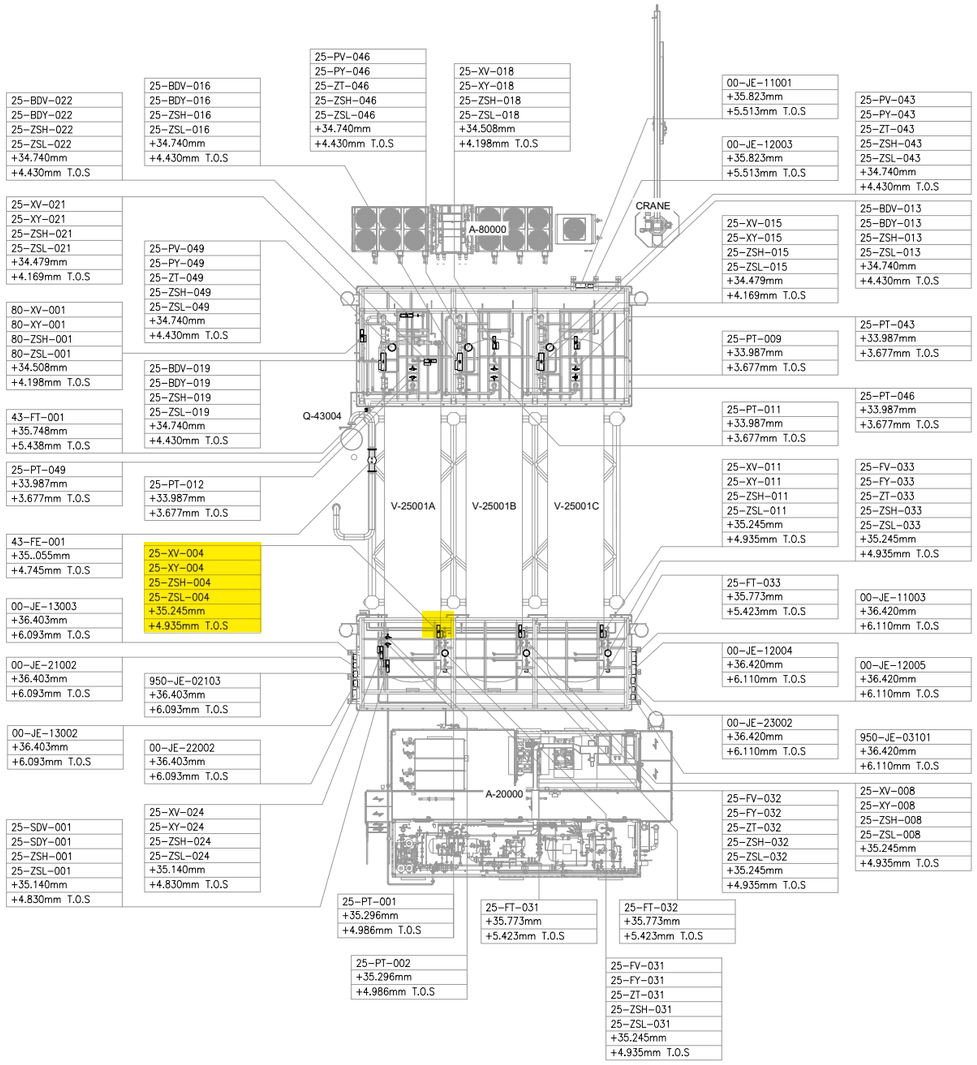

UPPER DECK

SCALE: 1:100

VIEW EL. 33740mm to 36500mm

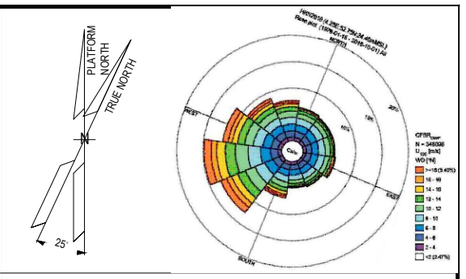

NOTES

1. ALL DIMENSIONS AND ELEVATIONS ARE GIVEN IN mm UNLESS OTHERWISE NOTED.
2. ELEVATIONS REFER TO T.O.S.
3. THIS DRAWING IS VALID ONLY FOR INSTRUMENT LOCATION LAYOUT.

LEGEND

- INSTRUMENT JUNCTION BOX
- ELECTRONIC INSTRUMENT
- CONTROL / ON-OFF VALVE

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DL-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-IN-DL-40080	INSTRUMENT LAYOUT -LOWER DECK
123A90-DDL-IN-LIS-40091	INSTRUMENT CABLE LIST
123A90-DDL-IN-DG-40015	INSTRUMENT-CCS WIRING DIAGRAMS
123A90-DDL-IN-DG-40016	INSTRUMENT-SAFETY SYSTEM WIRING DIAGRAMS
123A90-DDL-IN-DL-40083	INSTRUMENT MAIN CABLES ROUTING-LOWER DECK

INSERT SUBCONTRACTOR / VENDOR LOGO HERE

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	04/10/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	05/08/24	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	22/12/23	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

VALID FOR CONSTRUCTION

FDL DWG: **123A90-FDL-IN-DL-40081**

REV.:	DATE:	SIGNATURE:
2_A	07/10/24	G.Randi

ROSETTI MARINO SpA

TITLE :

BASE LOAD POWER HUB (BLPH)
INSTRUMENT LOCATION LAYOUT–UPPER DECK
TOS EL. 30.310M

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN VBA	CHECKED LCA	APPROVED DLO	DATE 04/10/24
A1	DRAWING NO. 123A90-DDL-IN-DL-40081	SHEET 002	REV. 02

File Name : 123A90-DDL-IN-DL-40081 REV.02.dwg


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 A

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg /AMB

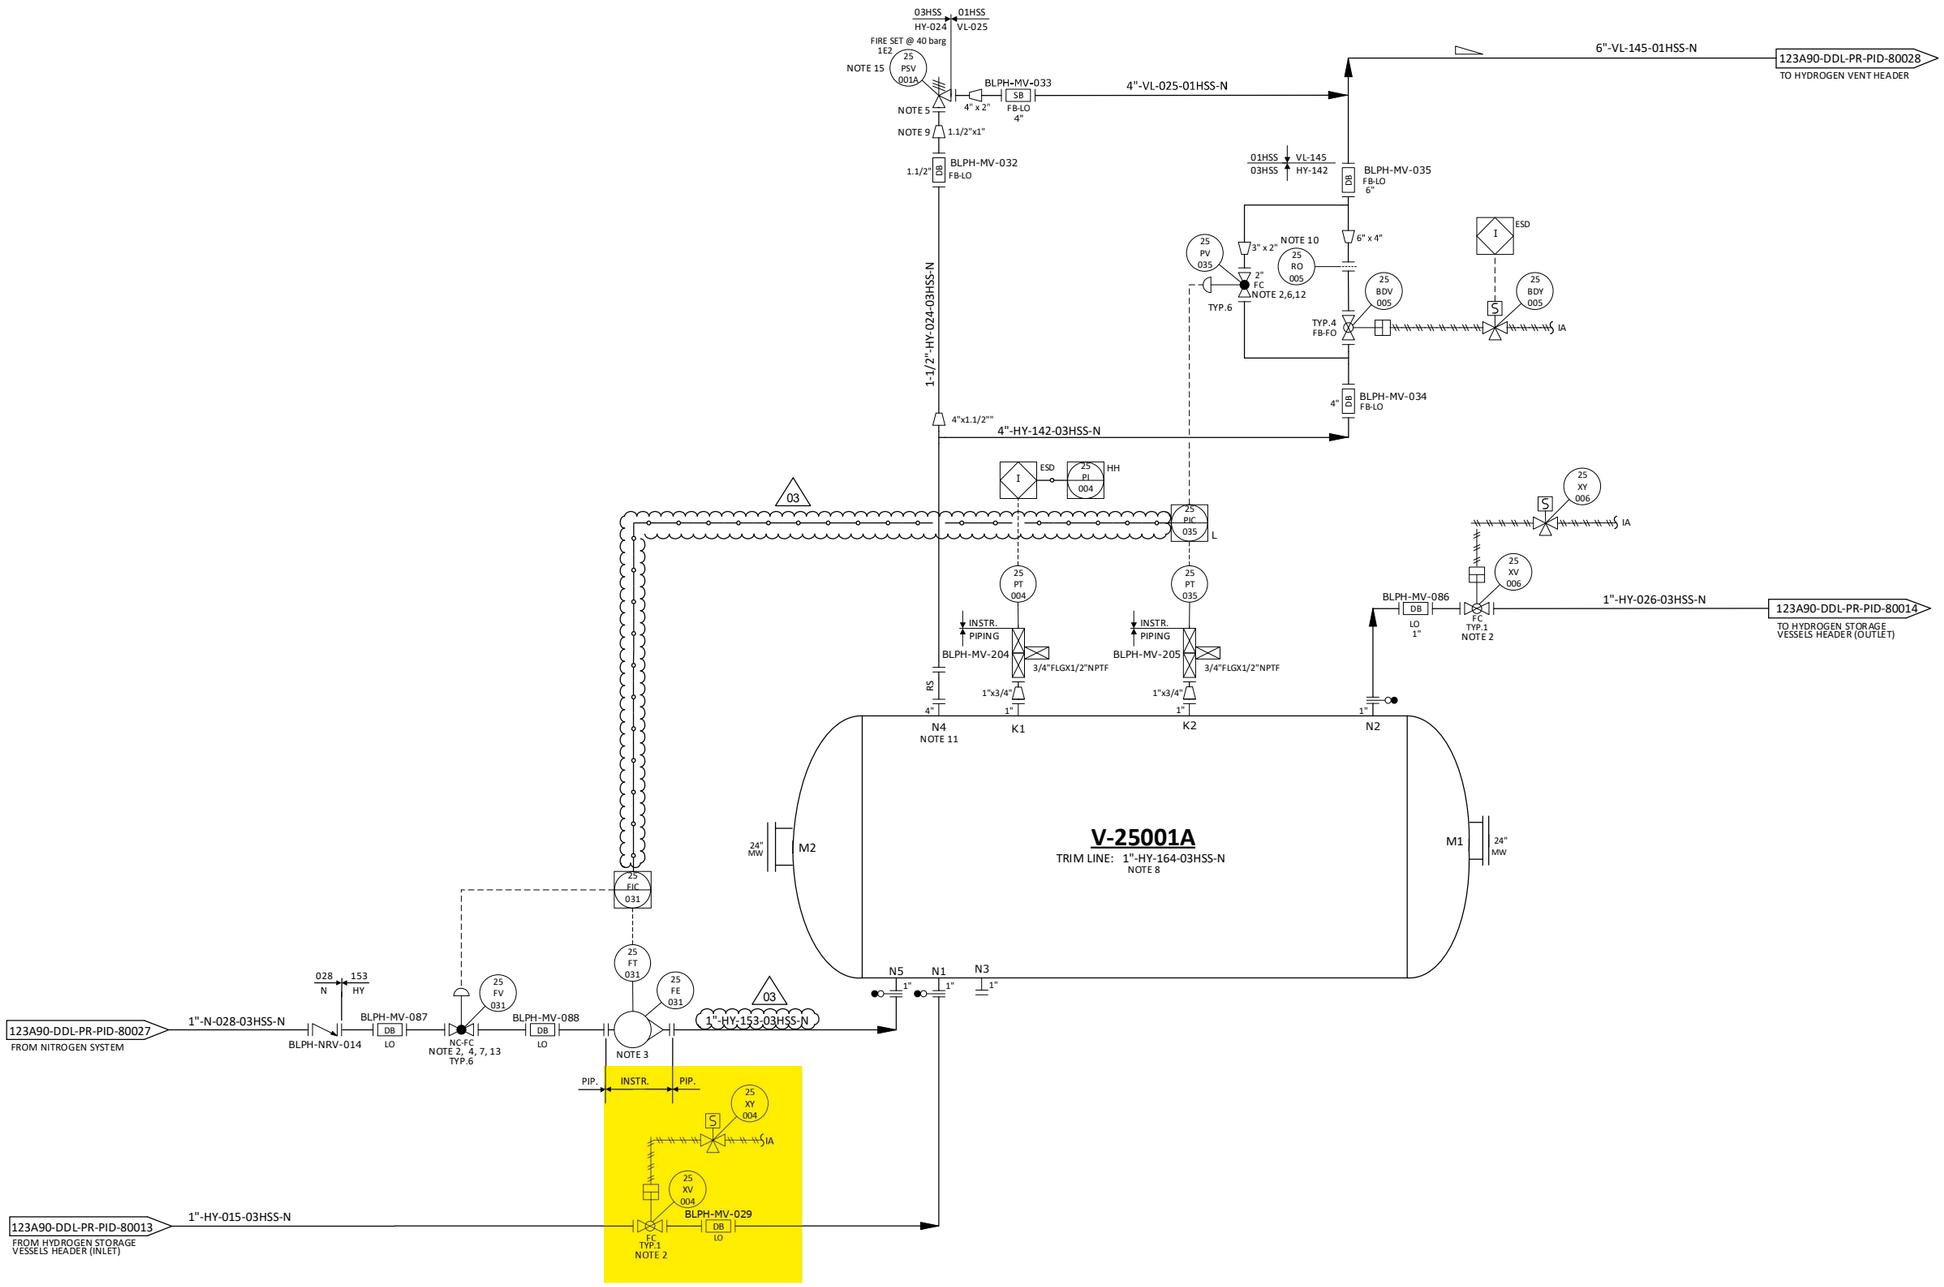

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS. 03
4. NITROGEN CONTROL VALVE (25-FV-031) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE.
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-035 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-035 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-031 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-035 HAS FAILED TO CLOSE.
15. 25-PSV-001A SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)




CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL A

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80015		SHEET 001	REV. 03

File Name : FILE_NAME

POS	PICTURE	DESCRIPTION		ITEM ID CODE	TOTAL					
		COMPRESSION FITTING TYPE: **DOUBLE FERRULE** THREADING: ASME B1.20.1 NPT MATERIAL: AISI 316 WORKING PRESSURE AS PER ASME B31.1 TUBING TYPE: ■ INCHES ☐ METRIC			UNIT	Counted	Required			
							Rev. 00	Rev. 01	Rev.	Rev.
1		STRAIGHT MALE CONNECTOR	1/2" NPT-M x 3/8" O.D.		nr.					
2			1/4" NPT-M x 1/2" O.D.		nr.	102	102	102		
3			1/2" NPT-M x 1/2" O.D.		nr.	36	36	-		
4			1/2" NPT-M x 3/4" O.D.		nr.					
5			3/4" NPT-M x 3/4" O.D.		nr.					
6			3/8" NPT-M x 3/8" O.D.		nr.					
7		STRAIGHT FEMALE CONNECTOR	1/2" NPT-F x 3/8" O.D.		nr.					
8			1/4" NPT-F x 1/2" O.D.		nr.					
9			1/2" NPT-F x 1/2" O.D.		nr.					
10			1/2" NPT-F x 3/4" O.D.		nr.					
11		UNION CONNECTOR	1/4" O.D. x 1/4" O.D.		nr.					
12			3/8" O.D. x 3/8" O.D.		nr.					
13			1/2" O.D. x 1/2" O.D.		nr.	49	49	49		
14			3/4" O.D. x 3/4" O.D.		nr.					
15		ELBOW CONNECTOR	1/4" NPT-M x 1/2" O.D.		nr.	27	27	27		
16			1/2" NPT-M x 1/2" O.D.		nr.					
17										
18										
19										
20										
21										
22										
23										
24										
25										
26										
27										
28										
29										
30										
27										
28										
29										
30										
31										
32										
33										
34										

VENDOR / ORDER : **AF SYSTEM / 1724001332**

MATERIAL :

- ☐ ASTM A106 Gr.B
- ■ AISI 316 L
- ☐ UNS S31254

SPECIAL REQUIREMENTS :

- ☐ ...

REMARKS :

This document undergoes an issuance cycle within EDMS "Fusionlive".
Its distribution is electronically controlled. Once printed shall be considered as "NOT CONTROLLED" copy

CROSSWIND

HOLLANDSE KUST NOORD WIND PARK Project
Contract No. CW-I-WP4-2023-05

INSTRUMENT TUBING LIST

ROSETTI MARINO

Sh. 4 of 4 REV. 00 01 02 03 04
X X X X X

				DATA TUBING													FROM AREA					TO AREA					
POS.	REV	SUPPLY SCOPE	LAINING SCOPE	TAG Tubing	P&ID	MAIN FUNCTION	SERVICE	DESIGN TEMPERATURE(C°)	OPERATING PRESSURE (Barg)	DESIGN PRESSURE (Barg)	TEST PRESSURE (Barg)	FLUID TEST	DIMENSIONS	MATERIAL	REF. DOC.	Q.TY (m)	FIRE PROOFING	HEAT TRACING	MODULE	AREA	FROM ITEM	REF. P&I	DESCRIPTION	MODULE	AREA	TO ITEM	REF. LAYOUT	DESCRIPTION	NOTE
01	04	RM	RM	**AV-63001/25-XV-011**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-XV-011	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
02	04	RM	RM	**AV-63001/25-FV-033**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-FV-033	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
03	04	RM	RM	**AV-63001/25-XV-008**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-XV-008	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
04	04	RM	RM	**AV-63001/25-FV-032**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63001	123A90-DDL-PR-PID-80041	Distribution Pot 1	BLPH	Upper Deck	25-FV-032	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
05	04	RM	RM	**AV-63002/25-XV-020**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-020	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
06	04	RM	RM	**AV-63002/25-FV-036**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**11**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-036	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
07	04	RM	RM	**AV-63002/25-XV-017**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-017	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
08	04	RM	RM	**AV-63002/25-FV-038**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-038	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
09	04	RM	RM	**AV-63002/25-XV-014**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-XV-014	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
10	04	RM	RM	**AV-63002/25-FV-034**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63002	123A90-DDL-PR-PID-80041	Distribution Pot 2	BLPH	Upper Deck	25-FV-034	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
11	04	RM	RM	**AV-63003/25-BDV-010**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-BDV-010	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
12	04	RM	RM	**AV-63003/25-PV-040**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-PV-040	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
13	04	RM	RM	**AV-63003/25-XV-012**	123A90-DDL-PR-PID-80017	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-XV-012	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
14	04	RM	RM	**AV-63003/25-XV-009**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**13**	N.A.	N.A.	BLPH	Upper Deck	AV-63003	123A90-DDL-PR-PID-80041	Distribution Pot 3	BLPH	Upper Deck	25-XV-009	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
15	04	RM	RM	**AV-63004/25-BDV-013**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-BDV-013	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
16	04	RM	RM	**AV-63004/25-PV-043**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-PV-043	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
17	04	RM	RM	**AV-63004/25-XV-015**	123A90-DDL-PR-PID-80018	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63004	123A90-DDL-PR-PID-80041	Distribution Pot 4	BLPH	Upper Deck	25-XV-015	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
18	04	RM	RM	**AV-63005/64-PV-031A**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Lower Deck	AV-63005	123A90-DDL-PR-PID-80041	Distribution Pot 5	BLPH	Lower Deck	64-PV-031A	123A90-DDL-IN-DL-40080	Pneumatic Control Valve	Design Pressure set as per downstream PSV
19	04	RM	RM	**AV-63005/64-PV-031B**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**3**	N.A.	N.A.	BLPH	Lower Deck	AV-63005	123A90-DDL-PR-PID-80041	Distribution Pot 5	BLPH	Lower Deck	64-PV-031B	123A90-DDL-IN-DL-40080	Pneumatic Control Valve	Design Pressure set as per downstream PSV
20	04	RM	RM	**AV-63006/25-BDV-022**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-BDV-022	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
21	04	RM	RM	**AV-63006/25-XV-021**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-XV-021	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
22	04	RM	RM	**AV-63006/25-PV-049**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-PV-049	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
23	04	RM	RM	**AV-63006/25-BDV-019**	123A90-DDL-PR-PID-80020	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	25-BDV-019	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
24	04	RM	RM	**AV-63006/80-XV-001**	123A90-DDL-PR-PID-80012	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63006	123A90-DDL-PR-PID-80041	Distribution Pot 6	BLPH	Upper Deck	80-XV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
25	04	RM	RM	**AV-63007/25-XV-006**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-XV-006	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
26	04	RM	RM	**AV-63007/25-PV-035**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**11**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-PV-035	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
27	04	RM	RM	**AV-63007/25-BDV-005**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-BDV-005	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
28	04	RM	RM	**AV-63007/25-PV-037**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-PV-037	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
29	04	RM	RM	**AV-63007/25-BDV-007**	123A90-DDL-PR-PID-80016	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63007	123A90-DDL-PR-PID-80041	Distribution Pot 7	BLPH	Upper Deck	25-BDV-007	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
30	04	RM	RM	**AV-63008/50-XV-001**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-001	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
31	04	RM	RM	**AV-63008/50-XV-002**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-002	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
32	04	RM	RM	**AV-63008/50-XV-003**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-003	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
33	04	RM	RM	**AV-63008/50-XV-004**	123A90-DDL-PR-PID-80021	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Lower Deck	AV-63008	123A90-DDL-PR-PID-80041	Distribution Pot 8	BLPH	Lower Deck	50-XV-004	123A90-DDL-IN-DL-40080	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
33A	04	RM	RM	**AV-63009/50-XV-005**	123A90-DDL-PR-PID-80025	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Lower Deck	AV-63009	123A90-DDL-PR-PID-80041	Distribution Pot 9	BLPH	Lower Deck	50-XV-005	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
34	04	RM	RM	**AV-63010/25-SDV-001**	123A90-DDL-PR-PID-80013	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**10**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-SDV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
35	04	RM	RM	**AV-63010/25-XV-024**	123A90-DDL-PR-PID-80013	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-XV-024	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
36	04	RM	RM	**AV-63010/25-XV-004**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-XV-004	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
37	04	RM	RM	**AV-63010/25-FV-031**	123A90-DDL-PR-PID-80015	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	25-FV-031	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
38	04	RM	RM	**AV-63010/64-SDV-001**	123A90-DDL-PR-PID-80027	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**15**	N.A.	N.A.	BLPH	Upper Deck	AV-63010	123A90-DDL-PR-PID-80041	Distribution Pot 10	BLPH	Upper Deck	64-SDV-001	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
39	04	RM	RM	**AV-63011/25-SDV-023**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**4**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-SDV-023	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
40	04	RM	RM	**AV-63011/25-PV-055A**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**7**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-PV-055A	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
41	04	RM	RM	**AV-63011/25-PV-055B**	123A90-DDL-PR-PID-80014	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**6**	N.A.	N.A.	BLPH	Upper Deck	AV-63011	123A90-DDL-PR-PID-80041	Distribution Pot 11	BLPH	Upper Deck	25-PV-055B	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
42	04	RM	RM	**AV-63012/25-XV-018**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**5**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-XV-018	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
43	04	RM	RM	**AV-63012/25-PV-046**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	6	6,6	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**8**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-PV-046	123A90-DDL-IN-DL-40081	Pneumatic Control Valve	Design Pressure set as per downstream PSV
44	04	RM	RM	**AV-63012/25-BDV-016**	123A90-DDL-PR-PID-80019	Pneumatic Connection	Air Supply	100	4	4,7	5,17	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90-DDL-IN-HD-40078	**9**	N.A.	N.A.	BLPH	Upper Deck	AV-63012	123A90-DDL-PR-PID-80041	Distribution Pot 12	BLPH	Upper Deck	25-BDV-016	123A90-DDL-IN-DL-40081	Pneumatic On/Off Valve	Design Pressure set as per downstream PSV
~~45~~	03	DELETED	DELETED	~~**BLPH-MV-014/26-PT-001**~~	~~123A90-DDL-PR-PID-80013~~	~~Process Connection~~	~~Hydrogen~~	~~80~~	~~7,5 / 30~~	~~40~~	~~7,5 / 30~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-014~~	~~123A90-DDL-PR-PID-80013~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~26-PT-001~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~46~~	03	DELETED	DELETED	~~**BLPH-MV-013/26-PT-002**~~	~~123A90-DDL-PR-PID-80013~~	~~Process Connection~~	~~Hydrogen~~	~~80~~	~~7,5 / 30~~	~~40~~	~~7,5 / 30~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-013~~	~~123A90-DDL-PR-PID-80013~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~26-PT-002~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~47~~	03	DELETED	DELETED	~~**BLPH-MV-026/26-PT-056A**~~	~~123A90-DDL-PR-PID-80014~~	~~Process Connection~~	~~Hydrogen~~	~~100~~	~~17,7~~	~~10~~	~~17,7~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-026~~	~~123A90-DDL-PR-PID-80014~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~26-PT-056A~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~48~~	03	DELETED	DELETED	~~**BLPH-MV-213/26-PT-056B**~~	~~123A90-DDL-PR-PID-80014~~	~~Process Connection~~	~~Hydrogen~~	~~100~~	~~3,5 / 6,5~~	~~10~~	~~3,5 / 6,5~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-213~~	~~123A90-DDL-PR-PID-80014~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~26-PT-056B~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~49~~	03	DELETED	DELETED	~~**BLPH-MV-407/43-PT-001**~~	~~123A90-DDL-PR-PID-80029~~	~~Process Connection~~	~~Hydrogen~~	~~-10 / +80~~	~~ATM~~	~~3,5~~	~~ATM~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-407~~	~~123A90-DDL-PR-PID-80029~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~43-PT-001~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~50~~	03	DELETED	DELETED	~~**BLPH-MV-411/60-PT-014**~~	~~123A90-DDL-PR-PID-80026~~	~~Process Connection~~	~~Waste Water~~	~~100~~	~~ATM~~	~~17,7~~	~~ATM~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~YES~~	~~BLPH~~	~~Lower Deck~~	~~BLPH-MV-411~~	~~123A90-DDL-PR-PID-80026~~	~~Manual Valve~~	~~BLPH~~	~~Lower Deck~~	~~60-PT-014~~	~~123A90-DDL-IN-DL-40080~~	~~Pressure Transmitter~~	
~~51~~	03	DELETED	DELETED	~~**BLPH-MV-150/63-PT-003**~~	~~123A90-DDL-PR-PID-80027~~	~~Process Connection~~	~~Instrument Air~~	~~100~~	~~4 / 10~~	~~11~~	~~4 / 10~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-150~~	~~123A90-DDL-PR-PID-80027~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~63-PT-003~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
~~52~~	03	DELETED	DELETED	~~**BLPH-MV-151/63-PT-004**~~	~~123A90-DDL-PR-PID-80027~~	~~Process Connection~~	~~Instrument Air~~	~~100~~	~~4 / 10~~	~~11~~	~~4 / 10~~	~~N2~~	~~1/2" OD x Thk. 0,049"~~	~~AISI 316L~~	~~123A90-DDL-IN-HD-40077~~	~~**0,5**~~	~~N.A.~~	~~N.A.~~	~~BLPH~~	~~Upper Deck~~	~~BLPH-MV-151~~	~~123A90-DDL-PR-PID-80027~~	~~Manual Valve~~	~~BLPH~~	~~Upper Deck~~	~~63-PT-004~~	~~123A90-DDL-IN-DL-40081~~	~~Pressure Transmitter~~	
53	04	RM	RM	**BLPH-MV-386/64-PT-031A**	123A90-DDL-PR-PID-80027	Process Connection	Nitrogen Gas	100	6	10	11	N2 / Dry Air	1/2" OD x Thk. 0,049"	AISI 316L	123A90

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CERTIFICATO DI TARATURA LAT 114 0435-SM-24
Certificate of Calibration

- data di emissione date of issue	2024-09-20
- cliente customer	FAST AUTOMATION SRL VIA DELLA PREVIDENZA SOCIALE, 8 IT-42124 REGGIO EMILIA (RE)
- destinatario receiver	ROSETTI MARINO SPA - YARD PIOMBONI VIA DEL MARCHESATO, 37 IT-48122 MARINA DI RAVENNA (RA)

Si riferisce a
referring to

- oggetto *item*	Misuratore di pressione elettronico Electrical pressure gauge
- costruttore *manufacturer*	WIKA
- modello *model*	CPG1500
- matricola *serial number*	1A014ILJJIM
- data di ricev. oggetto *date of receipt of item*	2024-09-17
- data delle misure *date of measurements*	2024-09-20
- registro di laboratorio *laboratory reference*	0435-SM-24

Il presente certificato di taratura è emesso in base all'accreditamento LAT N. 114 rilasciato in accordo ai decreti attuativi della legge n. 273/1991 che ha istituito il Sistema Nazionale di Taratura (SNT). ACCREDIA attesta le capacità di misura e di taratura, le competenze metrologiche del Centro e la riferibilità delle tarature eseguite ai campioni nazionali ed internazionali delle unità del Sistema Internazionale delle Unità (SI).
Questo certificato non può essere riprodotto in modo parziale, salvo espressa autorizzazione scritta da parte del Centro.

This certificate of calibration is issued in compliance with the accreditation LAT No.114 granted according to decrees connected with Italian law No. 273/1991 which has established the National Calibration System. ACCREDIA attests the calibration and measurement capability, metrological competence of the Centre and the traceability of calibration results to the national and International standards of the International System of Units (SI).
This certificate may not be partially reproduced, except with the prior written permission of the issuing Centre.

I risultati di misura riportati nel presente Certificato sono stati ottenuti applicando le procedure di taratura citate alla pagina seguente, dove sono specificati anche i campioni o gli strumenti che garantiscono la catena di riferibilità del Centro e i rispettivi certificati di taratura in corso di validità. Essi si riferiscono esclusivamente all'oggetto in taratura e sono validi nel momento e nelle condizioni di taratura, salvo diversamente specificato.

The measurement results reported in this Certificate were obtained following the calibration procedures given in the following page, where the reference standards or instruments are indicated which guarantee the traceability chain of the laboratory, and the related calibration certificates in the course of validity are indicated as well. They relate only to the calibrated item and they are valid for the time and conditions of calibration, unless otherwise specified.

Le incertezze di misura dichiarate in questo documento sono state determinate conformemente alla Guida ISO/IEC 98 e al documento EA-4/02. Solitamente sono espresse come incertezza estesa ottenuta moltiplicando l'incertezza tipo per il fattore di copertura *k* corrispondente ad un livello di fiducia di circa il 95 %. Normalmente tale fattore *k* vale 2.

The measurement uncertainties stated in this document have been determined according to the ISO/IEC Guide 98 and to EA-4/02. Usually, they have been estimated as expanded uncertainty obtained multiplying the standard uncertainty by the coverage factor k corresponding to a confidence level of about 95%. Normally, this factor k is 2.

Direzione Tecnica
(Approving Officer)

Enrico Reccagni

Enrico Reccagni

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CARATTERISTICHE DELLO STRUMENTO IN TARATURA/ Properties of devices under calibration

Misuratore di pressione elettronico ***Electrical pressure gauge***	
Tipo *Model*	Misuratore di pressione elettronico Electrical pressure gauge
Numero di matricola *Serial No.*	1A014ILJJIM
Campo di misura *Scale range*	(0 ... 1000) bar g
Accuratezza dichiarata dal costruttore *Accuracy declared by the manufacturer*	0,1 % FS
Risoluzione *Resolution (scale division)*	0,1 bar
Tag. N. *Tag No.*	--

Procedura di taratura e catena di riferibilità
Calibration procedure and traceability chain

La taratura è stata effettuata in accordo alla linea guida DKD-R 6-1 "Taratura di strumenti di pressione" (versione 03/2014) procedura B, per confronto fra i valori dello strumento in taratura con quelli di riferimento dati dal campione di lavoro.

Calibration was carried out according to DKD-R 6-1 "Kalibrierung von Druckmessgeräten" (Ausgabe 03/2014) procedure B, by comparing the measured values of the calibration item with those of the reference or working standard.

I risultati riportati sono stati ottenuti applicando le procedure n° LMO-PT-01 rev.2

The results have been obtained using the procedures n° LMO-PT-01 rev.2

La catena di riferibilità ha inizio dai campioni di riferimento n° PM1-09

The traceability chain starts from the reference standards n° PM1-09

muniti di certificati validi di taratura, rispettivamente n° D21090

with the relevant valid calibration certificates n° D21090

Luogo di taratura
Place of calibration

Laboratorio WIKA ITALIA - Laboratorio di Modugno (BA)
WIKA ITALY Laboratory - Modugno (BA)

Campione di lavoro
Working Standard

Norma di riferimento (RS) Bilancia di pressione ***Reference standard (RS) Dead-weight tester***	
Tipo *Model*	PM1-09
Certificato di taratura *Calibration mark*	D-K-15105/D21090
Campo di misura *Scale range*	(10 ... 2500) bar g
Accuratezza *Accuracy*	0,015 % della lettura + 255 Pa

Operatore
Technichian

Francesco Donatelli

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Condizioni di misura
Measurement conditions

Schema di collegamento *Assembly*	
Fluido utilizzato *Pressure medium*	Sebacate *Sebacate*
Livello di riferimento *Refence height (for reference value)*	Superficie di tenuta DUT *Sealing face DUT*
Posizione di montaggio *Position during calibration*	verticale *vertical*

Note di taratura
Calibration Note

Lo strumento è stato tarato e riconsegnato nelle stesse condizioni in cui è arrivato nel laboratorio, in accordo con il metodo "as found as left" / The device under test (DUT) was calibrated in the same conditions it was arrived in laboratory, according to the method "as found as left".

Condizioni Ambientali
Environmental conditions

Temperatura *Temperature*	(22 ± 1,5)	°C
Pressione atmoferica *Atmospheric pressure*	(1009,3 ± 0,2)	hPa
Umidità relativa *Rel. Humidity*	(50 ± 15)	% UR

I dati meteo sono stati acquisiti tramite stazione meteo WIKA CPU6000-W s/n.1A00VCX6GJ2

Weather data were acquired via the WIKA CPU6000-W weather station s/n.1A00VCX6GJ2

Misure rilevate
Measurement results

Valore di riferimento *Reference value RS* bar	**Letture** *Reading DUT* bar		
	M1	**M2**	**M3**
0,00	0,0	0,0	0,0
99,91	99,9	99,9	99,9
199,82	199,9	199,9	199,9
299,73	299,8	299,8	299,8
399,63	399,7	399,7	399,7
499,53	499,5	499,6	499,6
599,44	599,4	599,4	599,4
699,34	699,3	699,3	699,3
799,25	799,1	799,2	799,1
899,14	899,0	899,1	899,0
999,04	999,0	999,0	999,0

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it


Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Incertezza di misura
Uncertainty of measurement

Valori di riferimento *Reference value RS* bar	Media delle misure *Mean value* bar	Errore *Error* bar	Ripetibilità *Repeatability* bar	Isteresi *Hysteresis* bar	Incertezza di misura *Meas. Uncertainty* bar
0,00	0,0	0,0	0,0	0,0	0,40
99,91	99,9	0,0	0,0	0,0	0,40
199,82	199,9	0,1	0,0	0,0	0,40
299,73	299,8	0,1	0,0	0,0	0,40
399,63	399,7	0,1	0,0	0,0	0,40
499,53	499,6	0,1	0,1	0,1	0,40
599,44	599,4	0,0	0,0	0,0	0,40
699,34	699,3	0,0	0,0	0,0	0,40
799,25	799,2	0,0	0,0	0,1	0,40
899,14	899,1	0,0	0,0	0,1	0,40
999,04	999,0	0,0	0,0	0,0	0,40

Grafico degli errori di misura
Graphical representation of measurement uncertainty

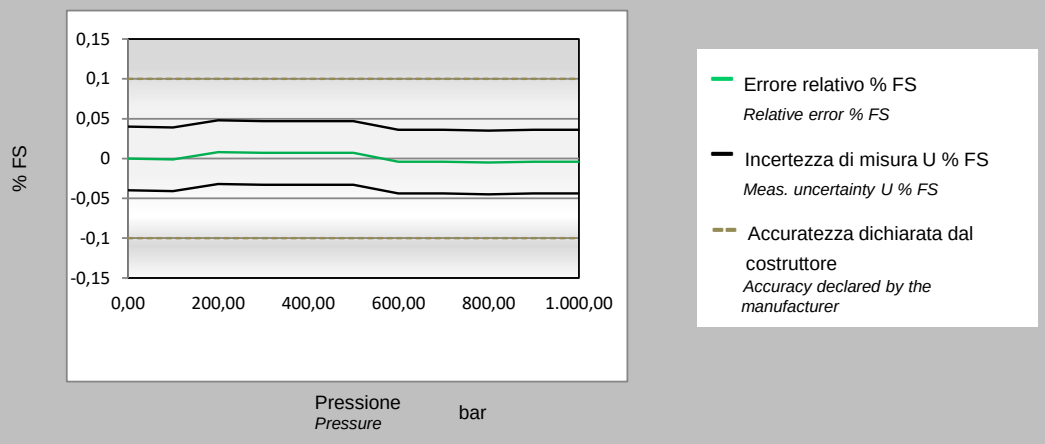

L'incertezza estesa senza correzione del DUT è pari a 0,5 bar
The expanded uncertainty of the DUT without correction is equal to

Questo dato è ottenuto come MAX{Incertezza_di_misura$_i$ + |Errore$_i$|} della tabella precedente
This data is obatined as MAX{Meas._uncertainty$_i$ + |Error$_i$|} of the previous table

Il presente certificato non rappresenta una dichiarazione di conformità a specifica
This certificate is not a statement of compliance

Section 7 MECHANICAL COMPLETION STATUS INDEX - MECHANICAL DISCIPLINE

NOT APPLICABLE

Section 8 MECHANICAL COMPLETION STATUS INDEX - TELECOMMUNICATION DISCIPLINE

NOT APPLICABLE

Section 9 MECHANICAL COMPLETION STATUS INDEX - HVAC DISCIPLINE

NOT APPLICABLE

Section 10 MECHANICAL COMPLETION STATUS INDEX - PIPING DISCIPLINE

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

STATUS INDEX DETAIL

Filtered on subsystem: 25-07 & process: MC & discipline : P

Piping	25-07 Hydrogen Storage Vessels Header (Inlet)						
ITEM		TASK					
Code	Description	Location	Code	Form	Progress	Date	Certificate
005-1-J1	Joint 005-1-J1	ONSHORE	C10004321	TMX27	100	2025-01-23	RFC 1
005-1-J2	Joint 005-1-J2	ONSHORE	C10004322	TMX27	100	2025-01-23	RFC 1
005-1-J3	Joint 005-1-J3	ONSHORE	C10004323	TMX27	100	2025-01-23	RFC 1
005-1-J4	Joint 005-1-J4	ONSHORE	C10004324	TMX27	100	2025-01-23	RFC 1
005-2-J5	Joint 005-2-J5	ONSHORE	C10004325	TMX27	100	2025-01-23	RFC 1
005-2-J6	Joint 005-2-J6	ONSHORE	C10004326	TMX27	100	2025-01-23	RFC 1
005-2-J7	Joint 005-2-J7	ONSHORE	C10004327	TMX27	100	2025-02-03	RFC 1
005-2-J8	Joint 005-2-J8	ONSHORE	C10004328	TMX27	100	2025-02-03	RFC 1
009-1-J1	Joint 009-1-J1	ONSHORE	C10003836	TMX27	100	2025-01-24	RFC 1
009-1-J2	Joint 009-1-J2	ONSHORE	C10003837	TMX27	100	2025-01-24	RFC 1
009-1-J3	Joint 009-1-J3	ONSHORE	C10003838	TMX27	100	2025-01-24	RFC 1
010-1-J1	Joint 010-1-J1	ONSHORE	C10003841	TMX27	100	2025-01-24	RFC 1
010-1-J2	Joint 010-1-J2	ONSHORE	C10003842	TMX27	100	2025-01-24	RFC 1
010-1-J3	Joint 010-1-J3	ONSHORE	C10003843	TMX27	100	2025-01-24	RFC 1
011-1-J1	Joint 011-1-J1	ONSHORE	C10003846	TMX27	100	2025-01-27	RFC 1
011-1-J2	Joint 011-1-J2	ONSHORE	C10003847	TMX27	100	2025-01-27	RFC 1
011-1-J3	Joint 011-1-J3	ONSHORE	C10003848	TMX27	100	2025-01-27	RFC 1
012-1-J1	Joint 012-1-J1	ONSHORE	C10003851	TMX27	100	2025-01-27	RFC 1
012-1-J2	Joint 012-1-J2	ONSHORE	C10003852	TMX27	100	2025-01-27	RFC 1
012-1-J3	Joint 012-1-J3	ONSHORE	C10003853	TMX27	100	2025-01-27	RFC 1
013-1-J1	Joint 013-1-J1	ONSHORE	C10003856	TMX27	100	2025-01-24	RFC 1
013-1-J2	Joint 013-1-J2	ONSHORE	C10003857	TMX27	100	2025-01-24	RFC 1
013-1-J3	Joint 013-1-J3	ONSHORE	C10003858	TMX27	100	2025-01-24	RFC 1
014-1-J1	Joint 014-1-J1	ONSHORE	C10003861	TMX27	100	2025-01-24	RFC 1
014-1-J2	Joint 014-1-J2	ONSHORE	C10003862	TMX27	100	2025-01-27	RFC 1
014-1-J3	Joint 014-1-J3	ONSHORE	C10003863	TMX27	100	2025-01-24	RFC 1
056-1-J1	Joint 056-1-J1	ONSHORE	C10003910	TMX27	100	2025-01-27	RFC 1
056-1-J2	Joint 056-1-J2	ONSHORE	C10003911	TMX27	100	2025-01-27	RFC 1
056-1-J3	Joint 056-1-J3	ONSHORE	C10003912	TMX27	100	2025-01-27	RFC 1

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

STATUS INDEX DETAIL

Filtered on subsystem: 25-07 & process: MC & discipline : P

Piping	25-07 Hydrogen Storage Vessels Header (Inlet)						
ITEM		TASK					
Code	Description	Location	Code	Form	Progress	Date	Certificate
056-1-J4	Joint 056-1-J4	ONSHORE	C10003913	TMX27	100	2025-01-27	RFC 1
056-1-J5	Joint 056-1-J5	ONSHORE	C10003914	TMX27	100	2025-01-29	RFC 1
056-1-J6	Joint 056-1-J6	ONSHORE	C10003915	TMX27	100	2025-01-30	RFC 1
056-1-J7	Joint 056-1-J7	ONSHORE	C10003916	TMX27	100	2025-01-30	RFC 1
25-07-TP-007	Test Pack 25-07-TP-007	ONSHORE	C10003277	CLX02A	100	2025-01-21	RFC 2
		ONSHORE	C10003278	CLX02B	100	2025-01-30	RFC 2
		ONSHORE	C10003279	CXX02	100	2025-02-05	RFC 2
		ONSHORE	C10003280	TMX03	100	2025-01-21	RFC 2
		ONSHORE	C10003281	TMX05	100	2025-01-21	RFC 2
		ONSHORE	C10003284	TPLX05	100	2025-01-21	RFC 2
25-07-TP-068	Test Pack 25-07-TP-068	ONSHORE	C10004793	CLX02A	100	2025-02-06	RFC 2
		ONSHORE	C10004794	CLX02B	100	2025-02-25	RFC 2
		ONSHORE	C10004795	CXX02	100	2025-02-27	RFC 2
		ONSHORE	C10004796	TMX03	100	2025-02-03	RFC 2
		ONSHORE	C10004797	TMX05	100	2025-02-03	RFC 2
		ONSHORE	C10004799	TPLX05	100	2025-02-03	RFC 2

ITEM	Tag	25-07-TP-007	: Test Pack 25-07-TP-007			Dwg	123A90-DDL-PR-PID-80011
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003277		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	CLX02A Pipework Before Test

1	Check for each line of the Test Pack the NDT clearance.	OK
2	Confirm that materials conforms to the line specifications (ref. to the last issued revision of the isometric material table)	OK
3	Check the installation of all pipe – supports are in accordance with the specifications and drawings.	PL
4	Check that pipework at pump and vessel nozzles are free from spring.	PL
5	Check that the pipe flanges have been mounted square to each other. Also that the bolting and gaskets are correct (all TMX27 are complete, if necessary).	Note
6	Check bolt tightening and flange management (excluded battery limit joints).	Note
7	Check that the flow direction of the valves and check – valve is in the correct sense / direction (ball valves to be set at half open).	PL
8	Check that the removed equipment is in accordance with the agreed list of fragile devices. Check valve should be removed or flappers locked.	OK
9	Check that spool pieces or other substitution means have been put in place instead of the removed fragile device.	OK
10	Check the Blind list.	NA
11	Check that all the temporary material to perform the task are conforms to the procedure & suitable pressure rating.	OK
12	If required produce Red Line Mark Up for "AS BUILT".	

Comments: Points 5 and 6 have not been checked due being temporary joints. To be chacked in the After test phase after flange management.
Inspection point n.7 impossible to check due the fact that all the valves are going to be installed only after the pressure test.

	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM (ROSETTI MARINO)	
Name	Emanuele Delfino	Massimo Bruschi	
Date	2025-01-17	2025-01-21	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-17T14:23:52.531Z	PROVERLIS Digitaly signed by Massimo Bruschi 2025-01-21T12:48:30.420Z	

ITEM	Tag	25-07-TP-007	: Test Pack 25-07-TP-007			Dwg	123A90-DDL-PR-PID-80011
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003278		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	CLX02B Pipework After Test

1	Check that the pipework and equipment are drained as per procedure.	OK
2	Check if all temporary equipment (test spades, filters ,spool pieces..etc) have been removed.	OK
3	All plugs installed on vents and drains for test have been removed.	OK
4	Check that all removed devices and valves have been re-installed.	PL
5	Check that the new gaskets have been installed after pipework and equipment reinstallation.	OK
6	All specific blinds and / or spectacle blinds have been correctly installed as per P&ID.	NA
7	Check that the pipework, valves , check valves are undamaged. Also check the ancillaries and any other components.	PL
8	After the (re) installation of a valve check that it operates freely.	OK
9	Check that the flow direction of the valves and check – valve is in correct sense /direction in correct open/closed position as per P&ID.	OK
10	Check all locking device.	OK
11	Check that the valves have been correctly lubricated and that they have the correct spindle packing.	NA
12	Check that all the bolts and fasteners are suitably lubricated inline with the flange management procedure.	OK
13	Check that the bolts have been tightned at opened joints.	OK
14	Check that all golden welds (final tie-ins without hydrotest) have been performed as per procedure.	NA
15	Check for the correct tagging, labeling and colour coding of pipework and equipment (only for bare pipe lines).	NA
16	Check that the pipework and equipment (re) installation conforms to the specifications, drawings and to the P&ID's.	PL
17	If required produce Red Line Mark Up for "AS BUILT".	

Comments:

	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM (ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-28	2025-01-30	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-28T14:47:34.365Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-30T10:23:17.206Z	

ITEM	Tag	25-07-TP-007	: Test Pack 25-07-TP-007			Dwg	123A90-DDL-PR-PID-80011
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003279		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	Piping	Form	CXX02 Painting Line

1	Check that the completed painting is in accordance with the specifications covering quality and thickness.	OK
2	Check that the color coding conforms to the specifications.	PL
3	Check that the fluid direction is correct.	PL
4	Check that line marking is correct.	NA
5	Check that the painting of piping systems and of the equipment is "touched-up" and conforms to the specifications.	PL
6	If required produce Red Line Mark Up for "AS BUILT".	

Comments: 1. Checked the painting report made by Vendor and signed by RM coating Dpt.

	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	IMPRESA DONELLI	RM (ROSETTI MARINO)	
Name	Alex Sanna	Kangi Albonetti	
Date	2025-02-04	2025-02-05	
Signature	PROVERLIS Digitaly signed by Alex Sanna 2025-02-04T12:29:31.168Z	PROVERLIS Digitaly signed by Kangi Albonetti 2025-02-05T09:06:00.081Z	

ROSETTI MARINO — CROSSWIND

ITEM	Tag	25-07-TP-007	: Test Pack 25-07-TP-007		Dwg	123A90-DDL-PR-PID-80011	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10003280	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity PIP	Discipline Piping	Form	TMX03	Cleaning

CLEANING MEDIUM

Air	Water	Steam	Oil	Other	Mechanical
☐	●	☐	☐	☐	☐

Component: NA

Chemical treatment: No — NA | Filtration: No | Screen size: NA

EQUIPMENTS

Equipment **removed**	Yes	Agreed list of removed fragile devices to be attached to this Test Sheet	NA
Excepted removed equipments, pipework installation is conform to the specifications & PID's			OK
Equipment **added**	No	Exhaustive list to be attached (temporary filters, spools…etc)	NA

TEST RESULTS

Test date	21/01/2025	Start time	10:05	End time	10.35
Flow rate	NA	Duration	30 min	Medium T°	NA

Operation Description

Connected the water source to the lowest point of the piping system.
Maintained a high flow rate to help dislodging and carry away debrises.
Flushing flow kept until the water exiting the system was clear and free of visible contaminants. Expelled water inspected for any debris to be noted.

Safety Precautions

Restricting access to the area.

Result and comments

Water has been found clear of solid debris. All contaminants have been expelled.

	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM (ROSETTI MARINO)	
Name	Emanuele Delfino	Massimo Bruschi	
Date	2025-01-20	2025-01-21	
Signature	Digitaly signed by Emanuele Delfino 2025-01-20T05:50:50.577Z	Digitaly signed by Massimo Bruschi 2025-01-21T17:44:25.325Z	

ITEM	Tag	25-07-TP-007	: Test Pack 25-07-TP-007		Dwg	123A90-DDL-PR-PID-80011	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10003281	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity PIP	Discipline Piping	Form	TMX05	Pressure Test

TEST DATA

Reference procedure: 123A90-PML-QHSE-PRO-00092

Design pressure: 40 barg | Max test pressure: 60 barg | Min hold period: 30 min

TEST PREPARATION

Check all equipments used for the test are safe for use under pressure (valide certificate)	Yes
Pressure relief devices are installed and in line and set to correct pressure (calibration certificate)	Yes

Medium

Test medium: WATER

TEST RESULTS

Test date: See attachment | Start time: See attachment | End time: See attachment

Ambient temperature is recorded	NA			Test medium temperature is recorded	Yes
Pressure recorded during test hold period	Min: See attachment	Max: See attachment		Variation: See attachment	
Line has been depressurised to	NA			At maximum of bar/min: See attachment	
Pressure test completed sucessfully and approved	Yes			Temperature and pressure disc chart attached	NA
Instrument calibration certificates attached	Yes			Dead-weight tester log attached	NA
Record of failures and corrective action attached	No			Battery limits of the test attached	Yes

If required produce Red Line Mark Up for "AS BUILT".

Comments:

Page 1/1	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM (ROSETTI MARINO)	
Name	Emanuele Delfino	Massimo Bruschi	
Date	2025-01-20	2025-01-21	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-20T05:51:04.922Z	PROVERLIS Digitaly signed by Massimo Bruschi 2025-01-21T17:47:23.416Z	

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	123A90-25-07-TP-007_2

Instrument

Strumento

Electrical pressure gauge *Misuratore di pressione elettronico*	
Model *Modello*	CPG1500
Serial number *Numero di serie*	1A037FON32E
Log temperature *Registrazioni di Temperatura*	Active *Attivo*
Scale range *Campo scala*	(0 ... 1000) bar a
Accuracy *Accuratezza*	0.1 % FS
Tag number *Numero tag*	
Communication *Comunicazione*	Wireless (00:13:43:C5:19:D5)

Measurement conditions

Condizioni di misura

Settings *Impostazioni*	
Mode *Modalità*	Automatic *Automatico*
Interval (ms) *Intervallo (ms)*	60000
Duration (hh:mm:ss) *Durata (hh:mm:ss)*	00:54:00
Start time (hh:mm:ss) *Tempo di avvio (hh:mm:ss)*	10:37:26 am

Logger protocol

Protocollo di acquisizione elenco dati


ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	123A90-25-07-TP-007_2

Measurement results

Risultati della misura

Graphical representation of progression
Rappresentazione grafica dell'andamento

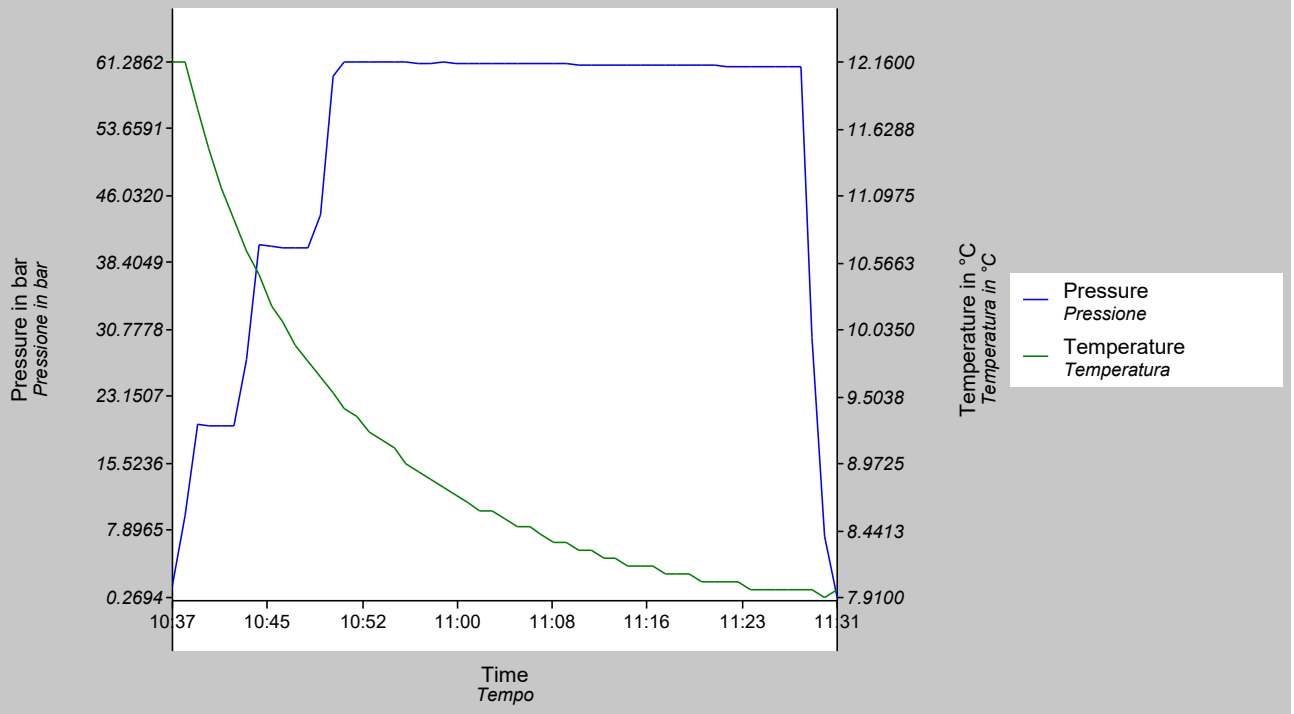

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/21/2025 10:37:26.000	1.6603	12.1600
01/21/2025 10:38:26.000	9.5554	12.1600
01/21/2025 10:39:26.000	19.9291	11.7800
01/21/2025 10:40:26.000	19.8448	11.4700
01/21/2025 10:41:26.000	19.8128	11.1600
01/21/2025 10:42:26.000	19.7970	10.9100
01/21/2025 10:43:26.000	27.3350	10.6600
01/21/2025 10:44:26.000	40.3871	10.4700
01/21/2025 10:45:26.000	40.2319	10.2200
01/21/2025 10:46:26.000	40.1615	10.1000
01/21/2025 10:47:26.000	40.1217	9.9100
01/21/2025 10:48:26.000	40.1196	9.7800
01/21/2025 10:49:26.000	43.9655	9.6600
01/21/2025 10:50:26.000	59.6396	9.5300
01/21/2025 10:51:26.000	61.2862	9.4100
01/21/2025 10:52:26.000	61.2652	9.3500
01/21/2025 10:53:26.000	61.2578	9.2200

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	123A90-25-07-TP-007_2

Measurement results

Risultati della misura

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
01/21/2025 10:54:26.000	61.2477	9.1600
01/21/2025 10:55:26.000	61.2243	9.1000
01/21/2025 10:56:26.000	61.2196	8.9700
01/21/2025 10:57:26.000	61.1961	8.9100
01/21/2025 10:58:26.000	61.1764	8.8500
01/21/2025 10:59:26.000	61.2113	8.7800
01/21/2025 11:00:26.000	61.1946	8.7200
01/21/2025 11:01:26.000	61.1763	8.6600
01/21/2025 11:02:26.000	61.1578	8.6000
01/21/2025 11:03:26.000	61.1417	8.6000
01/21/2025 11:04:26.000	61.1225	8.5300
01/21/2025 11:05:26.000	61.1023	8.4700
01/21/2025 11:06:26.000	61.0820	8.4700
01/21/2025 11:07:26.000	61.0635	8.4100
01/21/2025 11:08:26.000	61.0473	8.3500
01/21/2025 11:09:26.000	61.0287	8.3500
01/21/2025 11:10:26.000	61.0098	8.2800
01/21/2025 11:11:26.000	60.9953	8.2800
01/21/2025 11:12:26.000	60.9782	8.2200
01/21/2025 11:13:26.000	60.9604	8.2200
01/21/2025 11:14:26.000	60.9466	8.1600
01/21/2025 11:15:26.000	60.9290	8.1600
01/21/2025 11:16:26.000	60.9161	8.1600
01/21/2025 11:17:26.000	60.8986	8.1000
01/21/2025 11:18:26.000	60.8800	8.1000
01/21/2025 11:19:26.000	60.8626	8.1000
01/21/2025 11:20:26.000	60.8499	8.0300
01/21/2025 11:21:26.000	60.8381	8.0300
01/21/2025 11:22:26.000	60.8214	8.0300
01/21/2025 11:23:26.000	60.8036	8.0300
01/21/2025 11:24:26.000	60.7941	7.9700
01/21/2025 11:25:26.000	60.7782	7.9700
01/21/2025 11:26:26.000	60.7619	7.9700
01/21/2025 11:27:26.000	60.7470	7.9700
01/21/2025 11:28:26.000	60.7316	7.9700
01/21/2025 11:29:26.000	29.8914	7.9700
01/21/2025 11:30:26.000	7.3249	7.9100
01/21/2025 11:31:26.000	0.2694	7.9700

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CERTIFICATO DI TARATURA LAT 114 0580-SM-24

Certificate of Calibration

- data di emissione date of issue	2024-12-10
- cliente customer	FAST AUTOMATION SRL VIA DELLA PREVIDENZA SOCIALE, 8 IT-42124 REGGIO EMILIA (RE)
- destinatario receiver	ROSETTI MARINO SPA - YARD PIOMBONI VIA DEL MARCHESATO, 37 IT-48122 MARINA DI RAVENNA (RA)

Il presente certificato di taratura è emesso in base all'accreditamento LAT N. 114 rilasciato in accordo ai decreti attuativi della legge n. 273/1991 che ha istituito il Sistema Nazionale di Taratura (SNT). ACCREDIA attesta le capacità di misura e di taratura, le competenze metrologiche del Centro e la riferibilità delle tarature eseguite ai campioni nazionali ed internazionali delle unità del Sistema Internazionale delle Unità (SI).
Questo certificato non può essere riprodotto in modo parziale, salvo espressa autorizzazione scritta da parte del Centro.

Si riferisce a
referring to

- oggetto *item*	Misuratore di pressione elettronico Electrical pressure gauge
- costruttore *manufacturer*	WIKA
- modello *model*	CPG1500
- matricola *serial number*	1A037FON32E
- data di ricev. oggetto *date of receipt of item*	2024-11-29
- data delle misure *date of measurements*	2024-12-10
- registro di laboratorio *laboratory reference*	0580-SM-24

This certificate of calibration is issued in compliance with the accreditation LAT No.114 granted according to decrees connected with Italian law No. 273/1991 which has established the National Calibration System. ACCREDIA attests the calibration and measurement capability, metrological competence of the Centre and the traceability of calibration results to the national and International standards of the International System of Units (SI).
This certificate may not be partially reproduced, except with the prior written permission of the issuing Centre.

I risultati di misura riportati nel presente Certificato sono stati ottenuti applicando le procedure di taratura citate alla pagina seguente, dove sono specificati anche i campioni o gli strumenti che garantiscono la catena di riferibilità del Centro e i rispettivi certificati di taratura in corso di validità. Essi si riferiscono esclusivamente all'oggetto in taratura e sono validi nel momento e nelle condizioni di taratura, salvo diversamente specificato.

The measurement results reported in this Certificate were obtained following the calibration procedures given in the following page, where the reference standards or instruments are indicated which guarantee the traceability chain of the laboratory, and the related calibration certificates in the course of validity are indicated as well. They relate only to the calibrated item and they are valid for the time and conditions of calibration, unless otherwise specified.

Le incertezze di misura dichiarate in questo documento sono state determinate conformemente alla Guida ISO/IEC 98 e al documento EA-4/02. Solitamente sono espresse come incertezza estesa ottenuta moltiplicando l'incertezza tipo per il fattore di copertura k corrispondente ad un livello di fiducia di circa il 95 %. Normalmente tale fattore k vale 2.

The measurement uncertainties stated in this document have been determined according to the ISO/IEC Guide 98 and to EA-4/02. Usually, they have been estimated as expanded uncertainty obtained multiplying the standard uncertainty by the coverage factor k corresponding to a confidence level of about 95%. Normally, this factor k is 2.

Direzione Tecnica
(Approving Officer)

Enrico Reccagni

Enrico Reccagni

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CERTIFICATO DI TARATURA LAT 114 0580-SM-24
Certificate of calibration

CARATTERISTICHE DELLO STRUMENTO IN TARATURA/ Properties of devices under calibration

Misuratore di pressione elettronico *Electrical pressure gauge*	
Tipo *Model*	Misuratore di pressione elettronico Electrical pressure gauge
Numero di matricola *Serial No.*	1A037FON32E
Campo di misura *Scale range*	(0 ... 1000) bar g
Accuratezza dichiarata dal costruttore *Accuracy declared by the manufacturer*	0,1 % FS
Risoluzione *Resolution (scale division)*	0,1 bar
Tag. N. *Tag No.*	--

Procedura di taratura e catena di riferibilità
Calibration procedure and traceability chain

La taratura è stata effettuata in accordo alla linea guida DKD-R 6-1 "Taratura di strumenti di pressione" (versione 03/2014) procedura B, per confronto fra i valori dello strumento in taratura con quelli di riferimento dati dal campione di lavoro.

Calibration was carried out according to DKD-R 6-1 "Kalibrierung von Druckmessgeräten" (Ausgabe 03/2014) procedure B, by comparing the measured values of the calibration item with those of the reference or working standard.

I risultati riportati sono stati ottenuti applicando le procedure n° LMO-PT-01 rev.2

The results have been obtained using the procedures n° LMO-PT-01 rev.2

La catena di riferibilità ha inizio dai campioni di riferimento n° PM1-09

The traceability chain starts from the reference standards n° PM1-09

muniti di certificati validi di taratura, rispettivamente n° D21090

with the relevant valid calibration certificates n° D21090

Luogo di taratura
Place of calibration

Laboratorio WIKA ITALIA - Laboratorio di Modugno (BA)
WIKA ITALY Laboratory - Modugno (BA)

Campione di lavoro
Working Standard

Norma di riferimento (RS) Bilancia di pressione *Reference standard (RS) Dead-weight tester*	
Tipo *Model*	PM1-09
Certificato di taratura *Calibration mark*	D-K-15105/D21090
Campo di misura *Scale range*	(10 ... 2500) bar g
Accuratezza *Accuracy*	0,015 % della lettura + 255 Pa

Operatore
Technichian

Francesco Donatelli

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Condizioni di misura
Measurement conditions

Schema di collegamento *Assembly*	
Fluido utilizzato *Pressure medium*	Sebacate *Sebacate*
Livello di riferimento *Refence height (for reference value)*	Superficie di tenuta DUT *Sealing face DUT*
Posizione di montaggio *Position during calibration*	verticale *vertical*

Note di taratura
Calibration Note

Lo strumento è stato tarato e riconsegnato nelle stesse condizioni in cui è arrivato nel laboratorio, in accordo con il metodo "as found as left" / The device under test (DUT) was calibrated in the same conditions it was arrived in laboratory, according to the method "as found as left".

Condizioni Ambientali
Environmental conditions

Temperatura *Temperature*	(22 ± 1,5)	°C
Pressione atmoferica *Atmospheric pressure*	(1007,5 ± 0,2)	hPa
Umidità relativa *Rel. Humidity*	(50 ± 15)	% UR

I dati meteo sono stati acquisiti tramite stazione meteo WIKA CPU6000-W s/n.1A00VCX6GJ2

Weather data were acquired via the WIKA CPU6000-W weather station s/n.1A00VCX6GJ2

Misure rilevate
Measurement results

Valore di riferimento *Reference value RS* bar	**Letture** *Reading DUT* bar		
	M1	**M2**	**M3**
0,00	0,0	0,0	0,0
99,91	100,0	100,0	100,0
199,82	200,0	200,0	200,0
299,73	299,9	300,0	299,9
399,63	399,8	399,9	399,8
499,53	499,6	499,7	499,7
599,44	599,5	599,6	599,5
699,34	699,3	699,4	699,3
799,24	799,2	799,3	799,2
899,14	899,1	899,1	899,1
999,04	999,0	999,0	999,0

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory


LAT N° 114

CERTIFICATO DI TARATURA LAT 114 0580-SM-24
Certificate of calibration

Incertezza di misura
Uncertainty of measurement

Valori di riferimento *Reference value RS* bar	Media delle misure *Mean value* bar	Errore *Error* bar	Ripetibilità *Repeatability* bar	Isteresi *Hysteresis* bar	Incertezza di misura *Meas. Uncertainty* bar
0,00	0,0	0,0	0,0	0,0	0,40
99,91	100,0	0,1	0,0	0,0	0,40
199,82	200,0	0,2	0,0	0,0	0,40
299,73	300,0	0,3	0,0	0,1	0,40
399,63	399,9	0,3	0,0	0,1	0,40
499,53	499,7	0,2	0,1	0,1	0,40
599,44	599,6	0,2	0,0	0,1	0,40
699,34	699,4	0,1	0,0	0,1	0,40
799,24	799,3	0,1	0,0	0,1	0,40
899,14	899,1	0,0	0,0	0,0	0,40
999,04	999,0	0,0	0,0	0,0	0,40

Grafico degli errori di misura
Graphical representation of measurement uncertainty

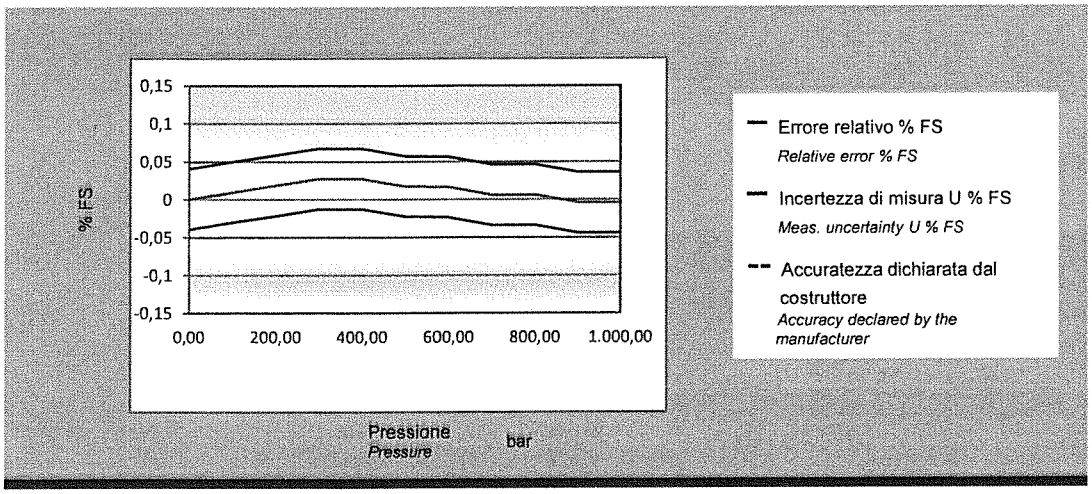

L'incertezza estesa senza correzione del DUT è pari a 0,7 bar
The expanded uncertainty of the DUT without correction is equal to

Questo dato è ottenuto come MAX{Incertezza_di_misura$_i$ + |Errore$_i$|} della tabella precedente
This data is obatined as MAX{Meas._uncertainty$_i$ + |Error$_i$|} of the previous table

Il presente certificato non rappresenta una dichiarazione di conformità a specifica
This certificate is not a statement of compliance

Base Load Power Hub (BLPH)

TEST PACK

N°25-07-TP-007
SUB-SYSTEM N° 25-07

System	25
Sub-System	25-07
Test Pressure	60 barg
Test Fluid	WATER
Test Duration	30 min

Rev.	Date	Prepared by	Checked by
0	27/09/2024	J.Q.	L.M.

List of Contents

1. COLOURED MARKED P&IDs
2. PIPING TEST 3D CIRCUIT
3. MATERIAL LIST FOR TEST
4. EXTRACT OF LINE LIST
5. ISOMETRIC RED-MARKED DRAWINGS & EXTRACT OF ISO LIST
6. EXTRACT OF SUPPORT LIST AND DETAILS
7. WELDING REGISTER & MATERIAL TRACEABILITY RECORD
8. PIPING & VESSEL PRE-COMMISSIONING CONFORMITY CHECKS & TESTS:
   - 8.1 CLX02A - Pipework Before test
   - 8.2 CLX02B - Pipework After Test
   - 8.3 CXX01 - Thermal insulation – NOT APPLICABLE
   - 8.4 CXX02 – Painting Line
   - 8.5 TMX03 – Cleaning
   - 8.6 TMX05 – Pressure test
   - 8.7 TMX25 – Gross Air Leak Test
   - 8.8 TMX27 – Bolt Tensioning / Torquing
   - 8.9 TPLX05 - Drying

1. COLOURED MARKED P&IDs


DRAWING NO. DRAWING_NO.

REV. REV

A-20000

ELECTROLYSER PACKAGE

DUTY: 2.5MW
DESIGN PRESSURE: 40 barg
DESIGN TEMPERATURE: 80 °C
H2 GENERATING CAPACITY: 500 Nm³/h

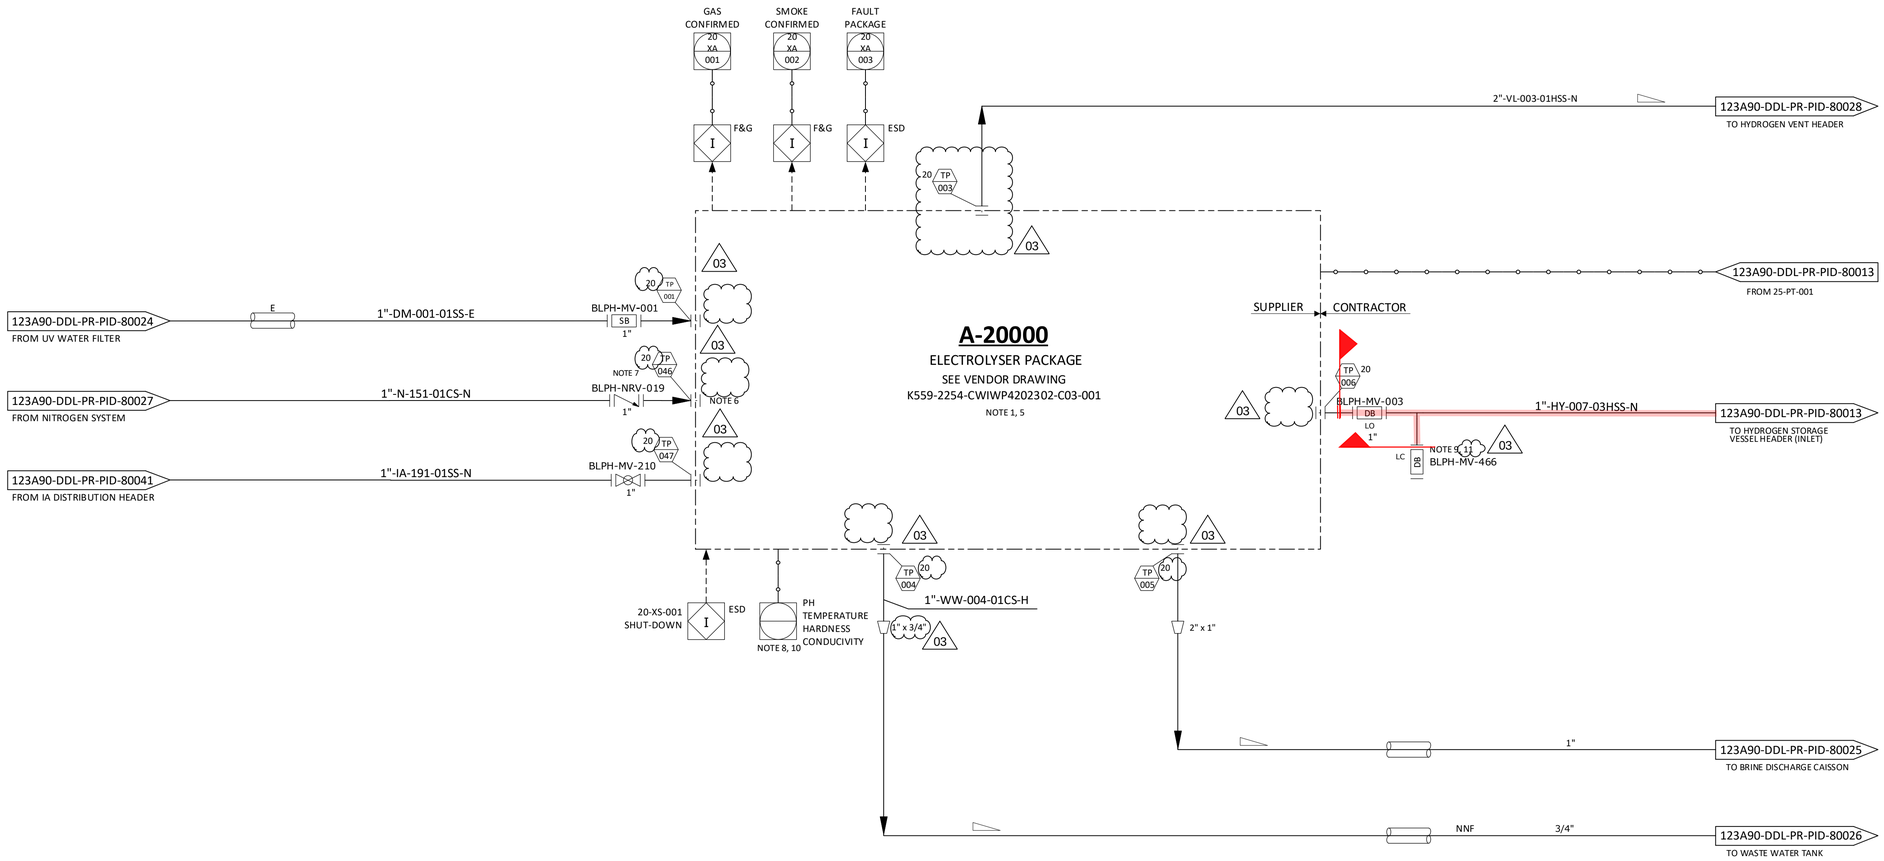

25-07-TP-007
60.00 barg

NOTES

1. PACKAGE SUPPLIED WITH POWER FROM THE BLPH ELECTRICAL SYSTEM.
2. DELETED.
3. DELETED.
4. DELETED.
5. ELECTROLYSER PACKAGE INCLUDES AN OXYGEN VENT LINE WHICH IS IN THE SCOPE OF SUPPLY OF THE ELECTROLYSER PACKAGE UP TO THE ATMOSPHERE. NO PHYSICAL INTERFACE IS PRESENT BETWEEN ELECTROLYSER PACKAGE AND CONTRACTOR ON THIS LINE.
6. AN ISOLATION VALVE DOWNSTREAM THE CHECK VALVE NRV-019 IS PROVIDED WITHIN THE PACKAGE A-20000.
7. CHECK VALVE NRV-019 TO BE INSTALLED AS CLOSE AS POSSIBLE TO THE ELECTROLYSER PACKAGE A-20000.
8. SERIAL COMMUNICATION WITH CONTROL SYSTEM.
9. NITROGEN PURGING CONNECTION TO BE LOCATED AS CLOSE AS POSSIBLE TO MANUAL VALVE BLPH-MV-003.
10. PH, TEMPERATURE, HARDNESS AND CONDUCTIVITY SHALL BE SENT FROM CONTROL SYSTEM TO ELECTROLISER UCP IN ADDITION TO THE OTHER SOFTWARE SIGNALS. 03
11. MANUAL VALVE BLPH-MV-466 TO BE CONNECTED WITH MANUAL VALVE BLPH-MV-275 (INSTALLED ON NITROGEN GENERATION PACKAGE EXIT LINE) BY MEAN ON A FLEXIBLE HOSE DURING COMMISSIONING PHASE FOR PURGING OPERATION.

HOLDS

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
ELECTROLYSER PACKAGE


CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO. 123A90-DDL-PR-PID-80011	SHEET 001	REV. 03

File Name : FILE_NAME

DRAWING NO. DRAWING_NO.

REV. REV

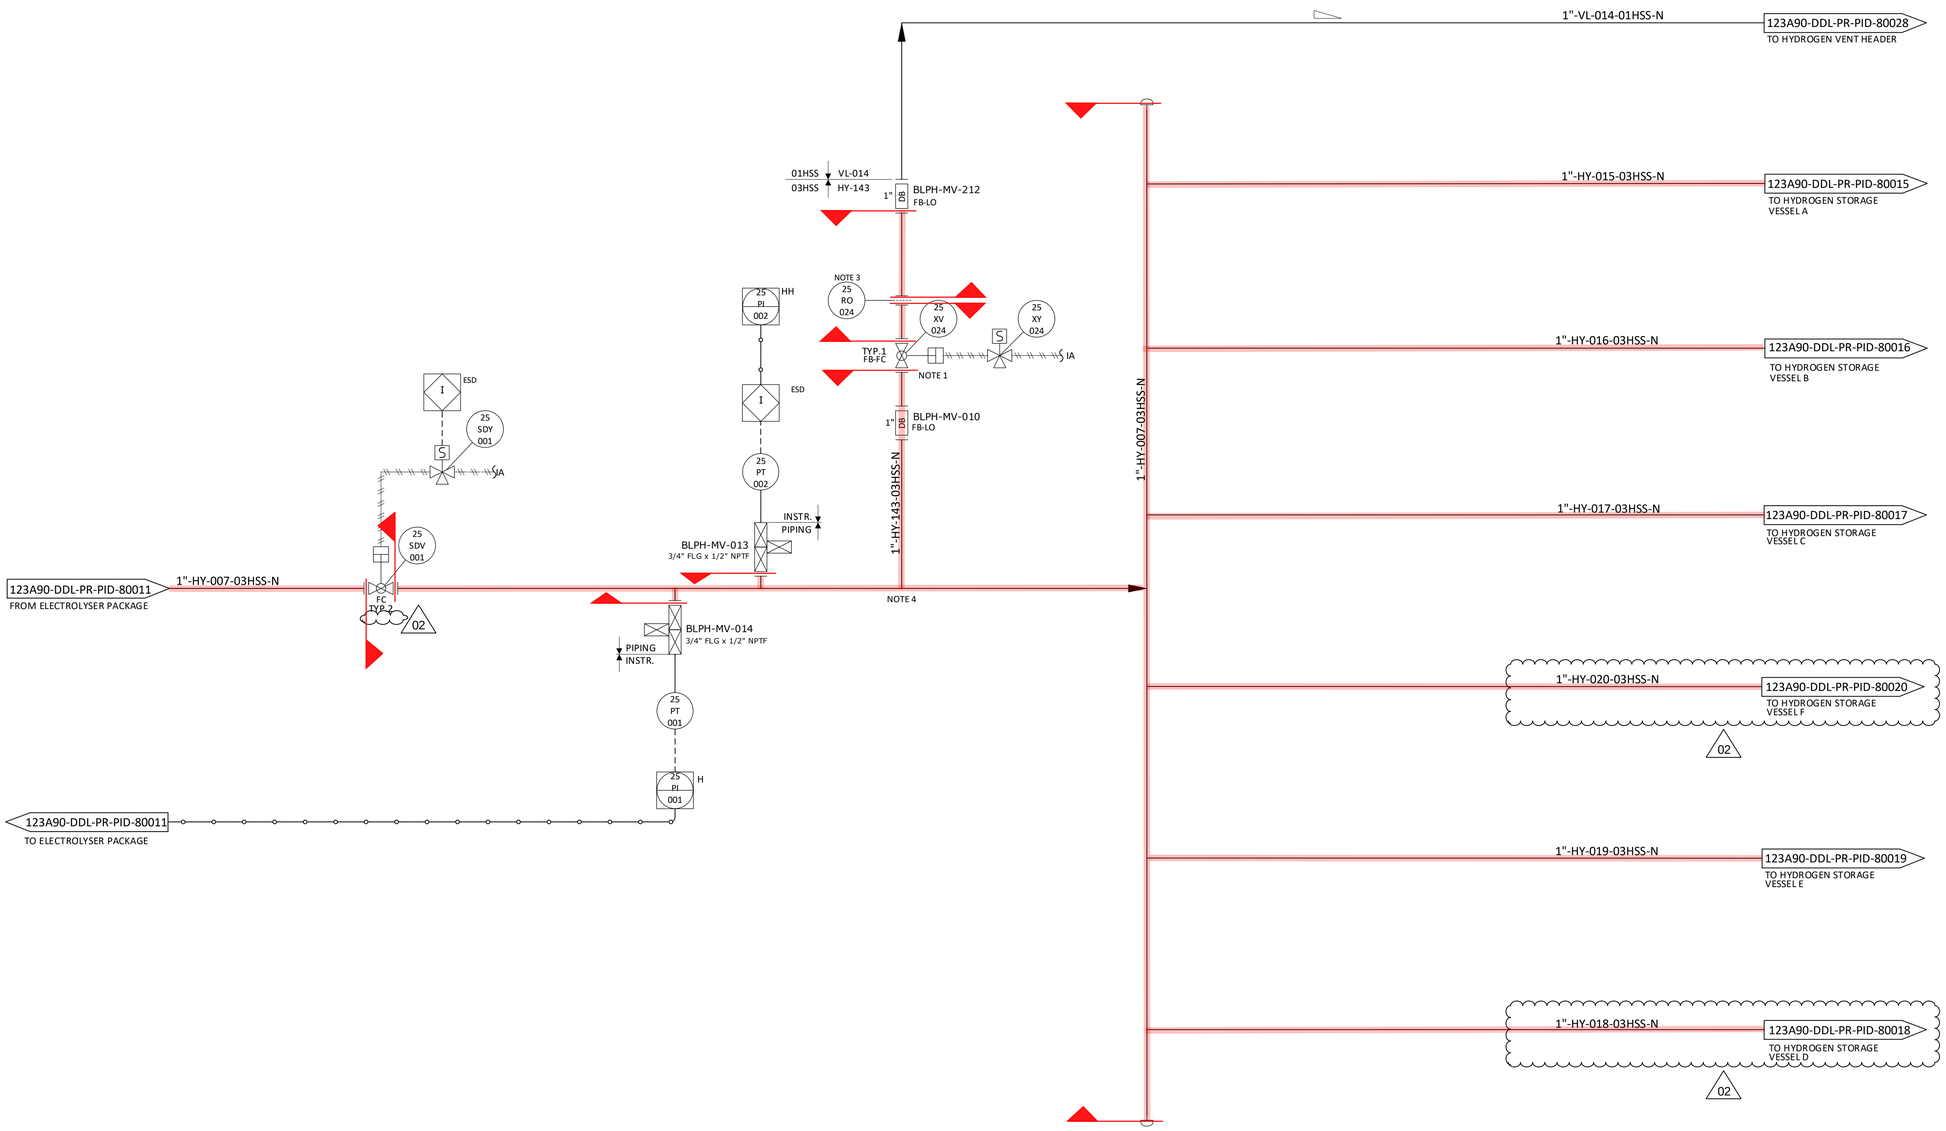

25-07-TP-007
60.00 barg

NOTES

1. TIGHT SHUT OFF XV.
2. DELETED. 02
3. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
4. PIPING CONNECTION TO 25-XV-003 SHALL BE AS CLOSE TO THE MANIFOLD AS POSSIBLE, TO ENSURE COMPLETE PURGING OF FEED LINE.

HOLDS

1. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSELS HEADER (INLET)

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO. 123A90-DDL-PR-PID-80013	SHEET 001	REV. 02

File Name : FILE_NAME


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 A

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg /AMB

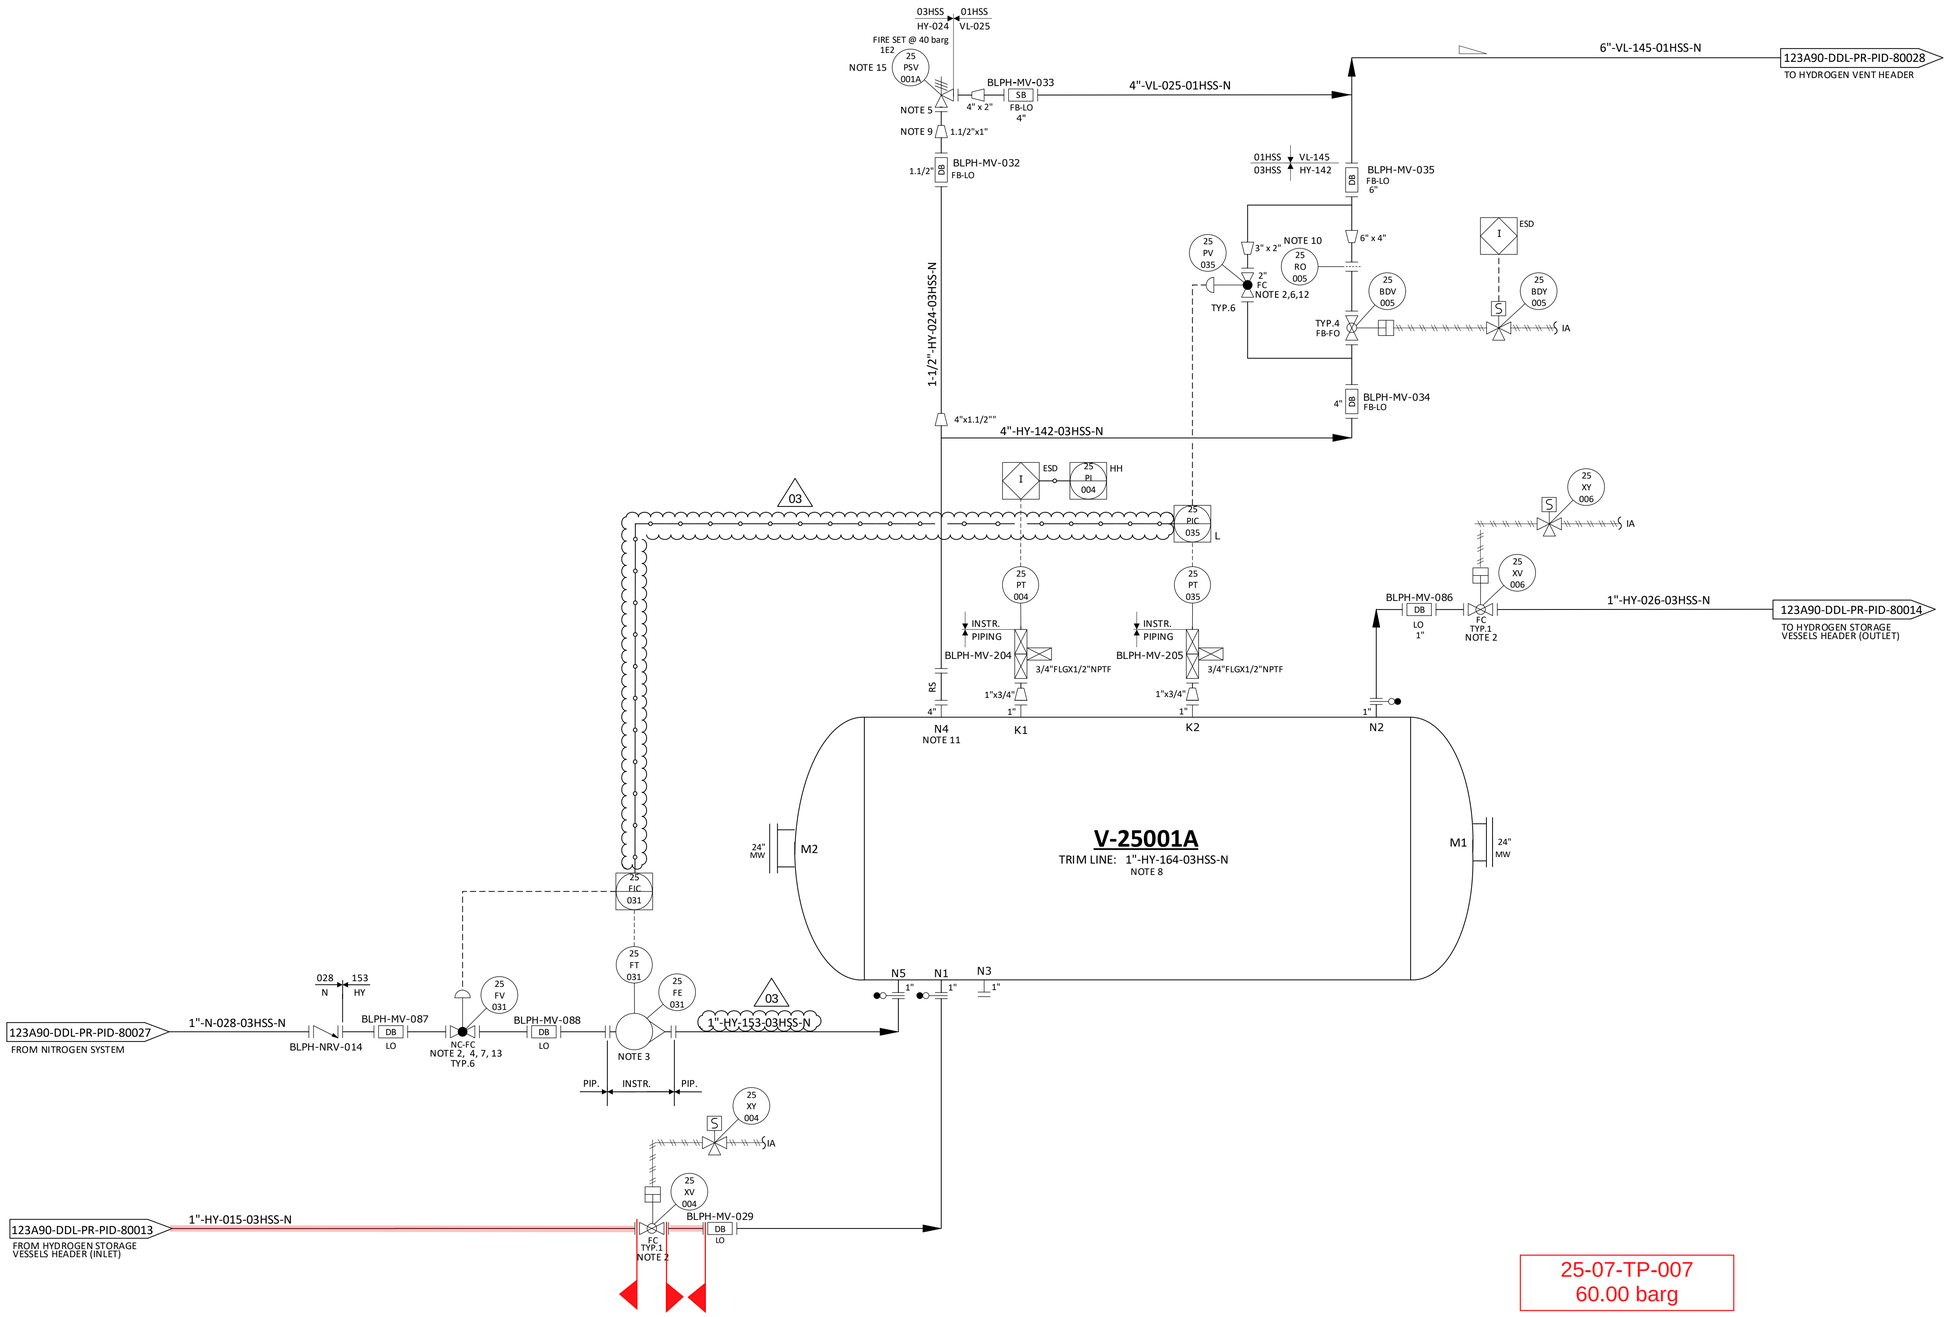

25-07-TP-007
60.00 barg

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-031) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-035 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-035 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-031 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-035 HAS FAILED TO CLOSE.
15. 25-PSV-001A SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL A

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80015		SHEET 001	REV. 03

File Name = FILE_NAME


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 B

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

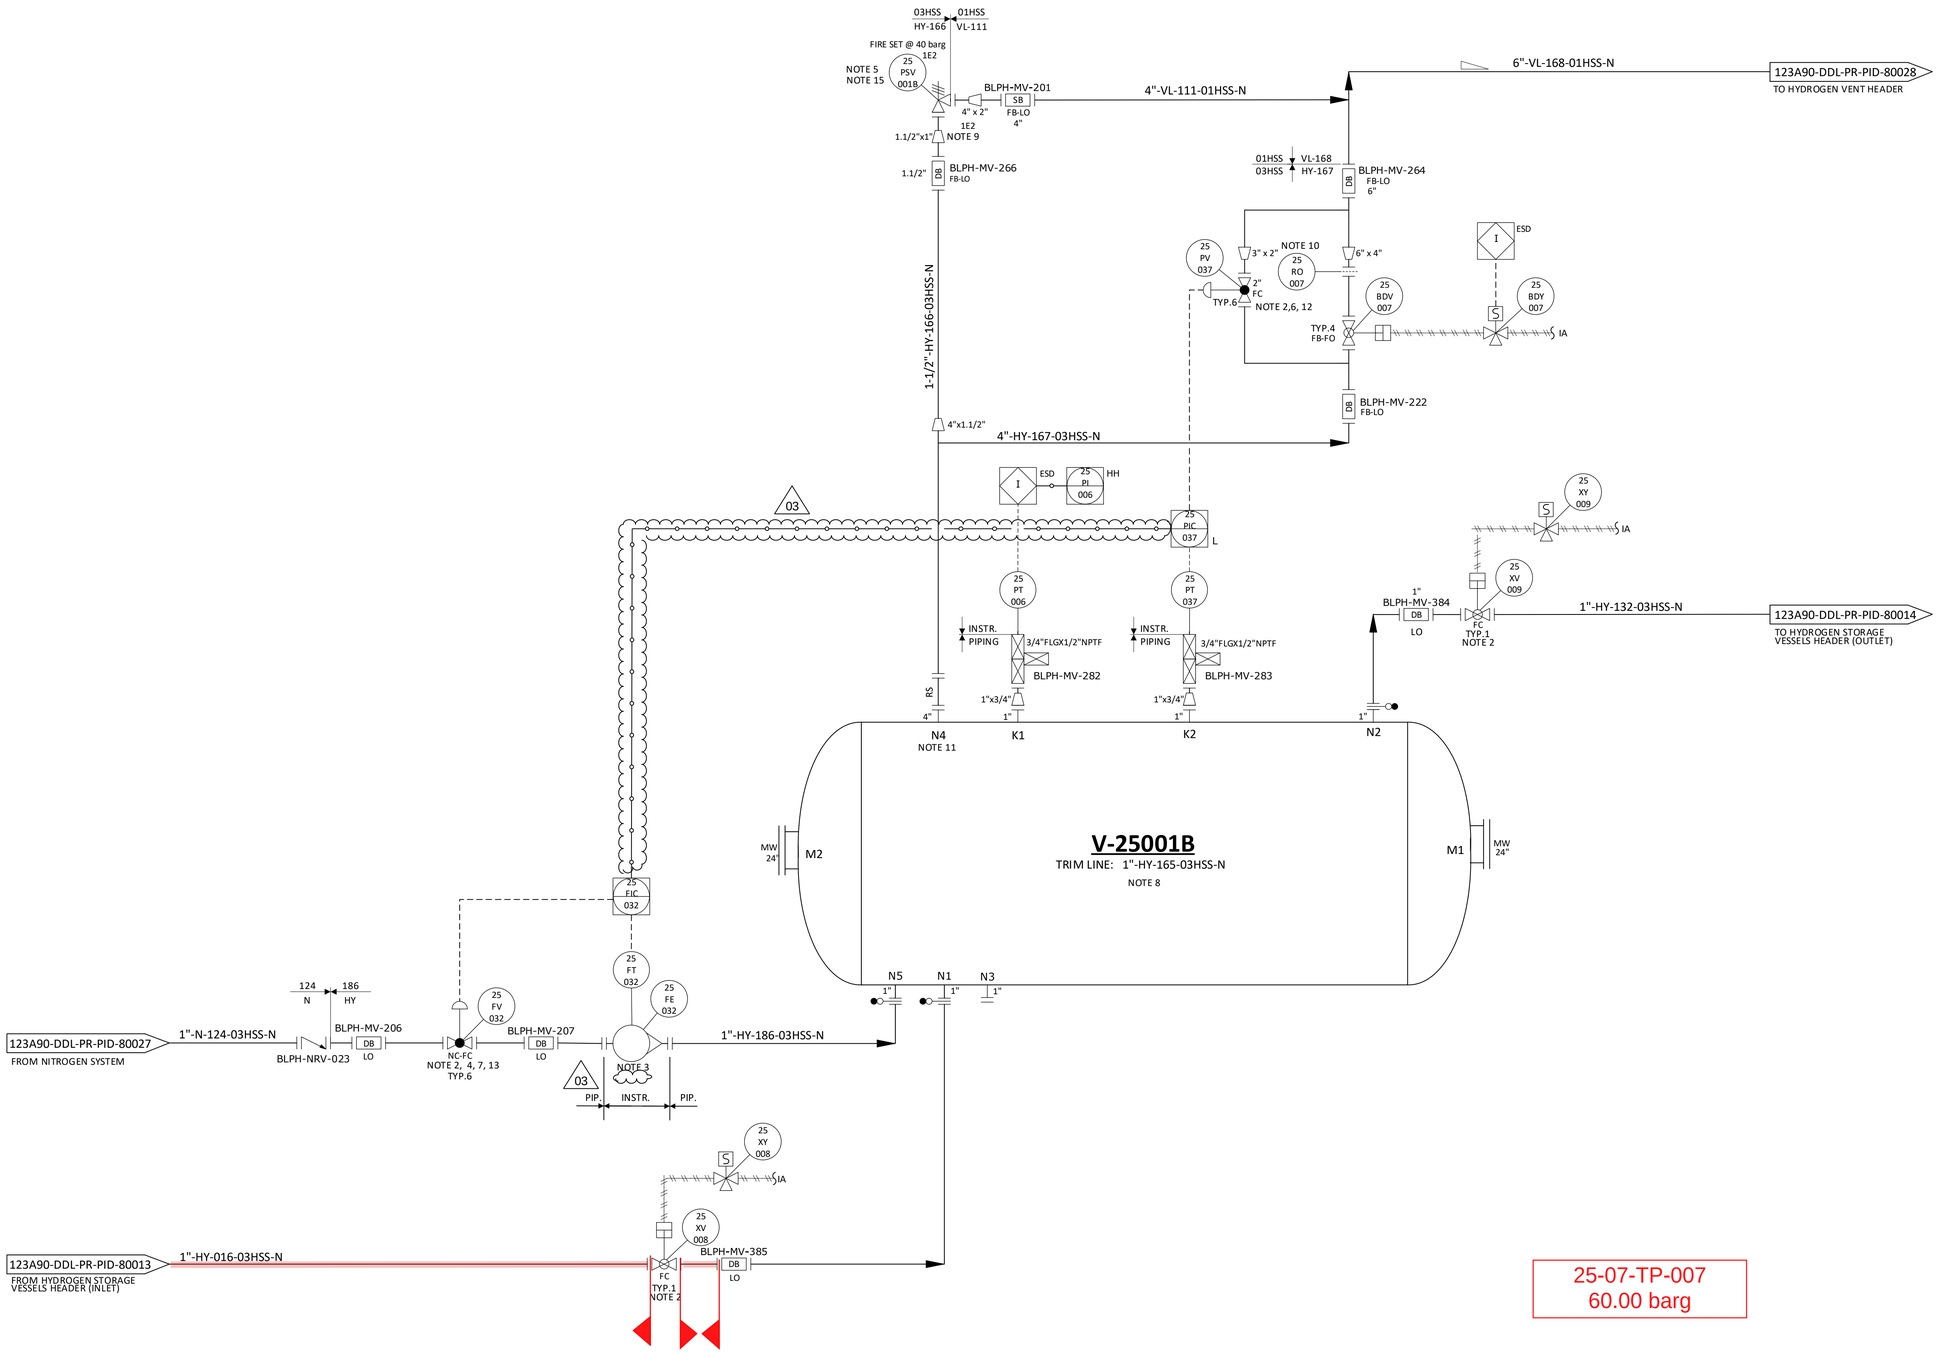

25-07-TP-007
60.00 barg

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-032) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. (03)
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT "DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-037 BEING OPENED OUTSIDE OR A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC."PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-037 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. (03)
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-032 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-037 HAS FAILED TO CLOSE.
15. 25-PSV-001B SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL B

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80016		SHEET 001 / REV. 03

File Name : FILE_NAME


DRAWING_NO. DRAWING_NO.

REV. REV

V-25001_C

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

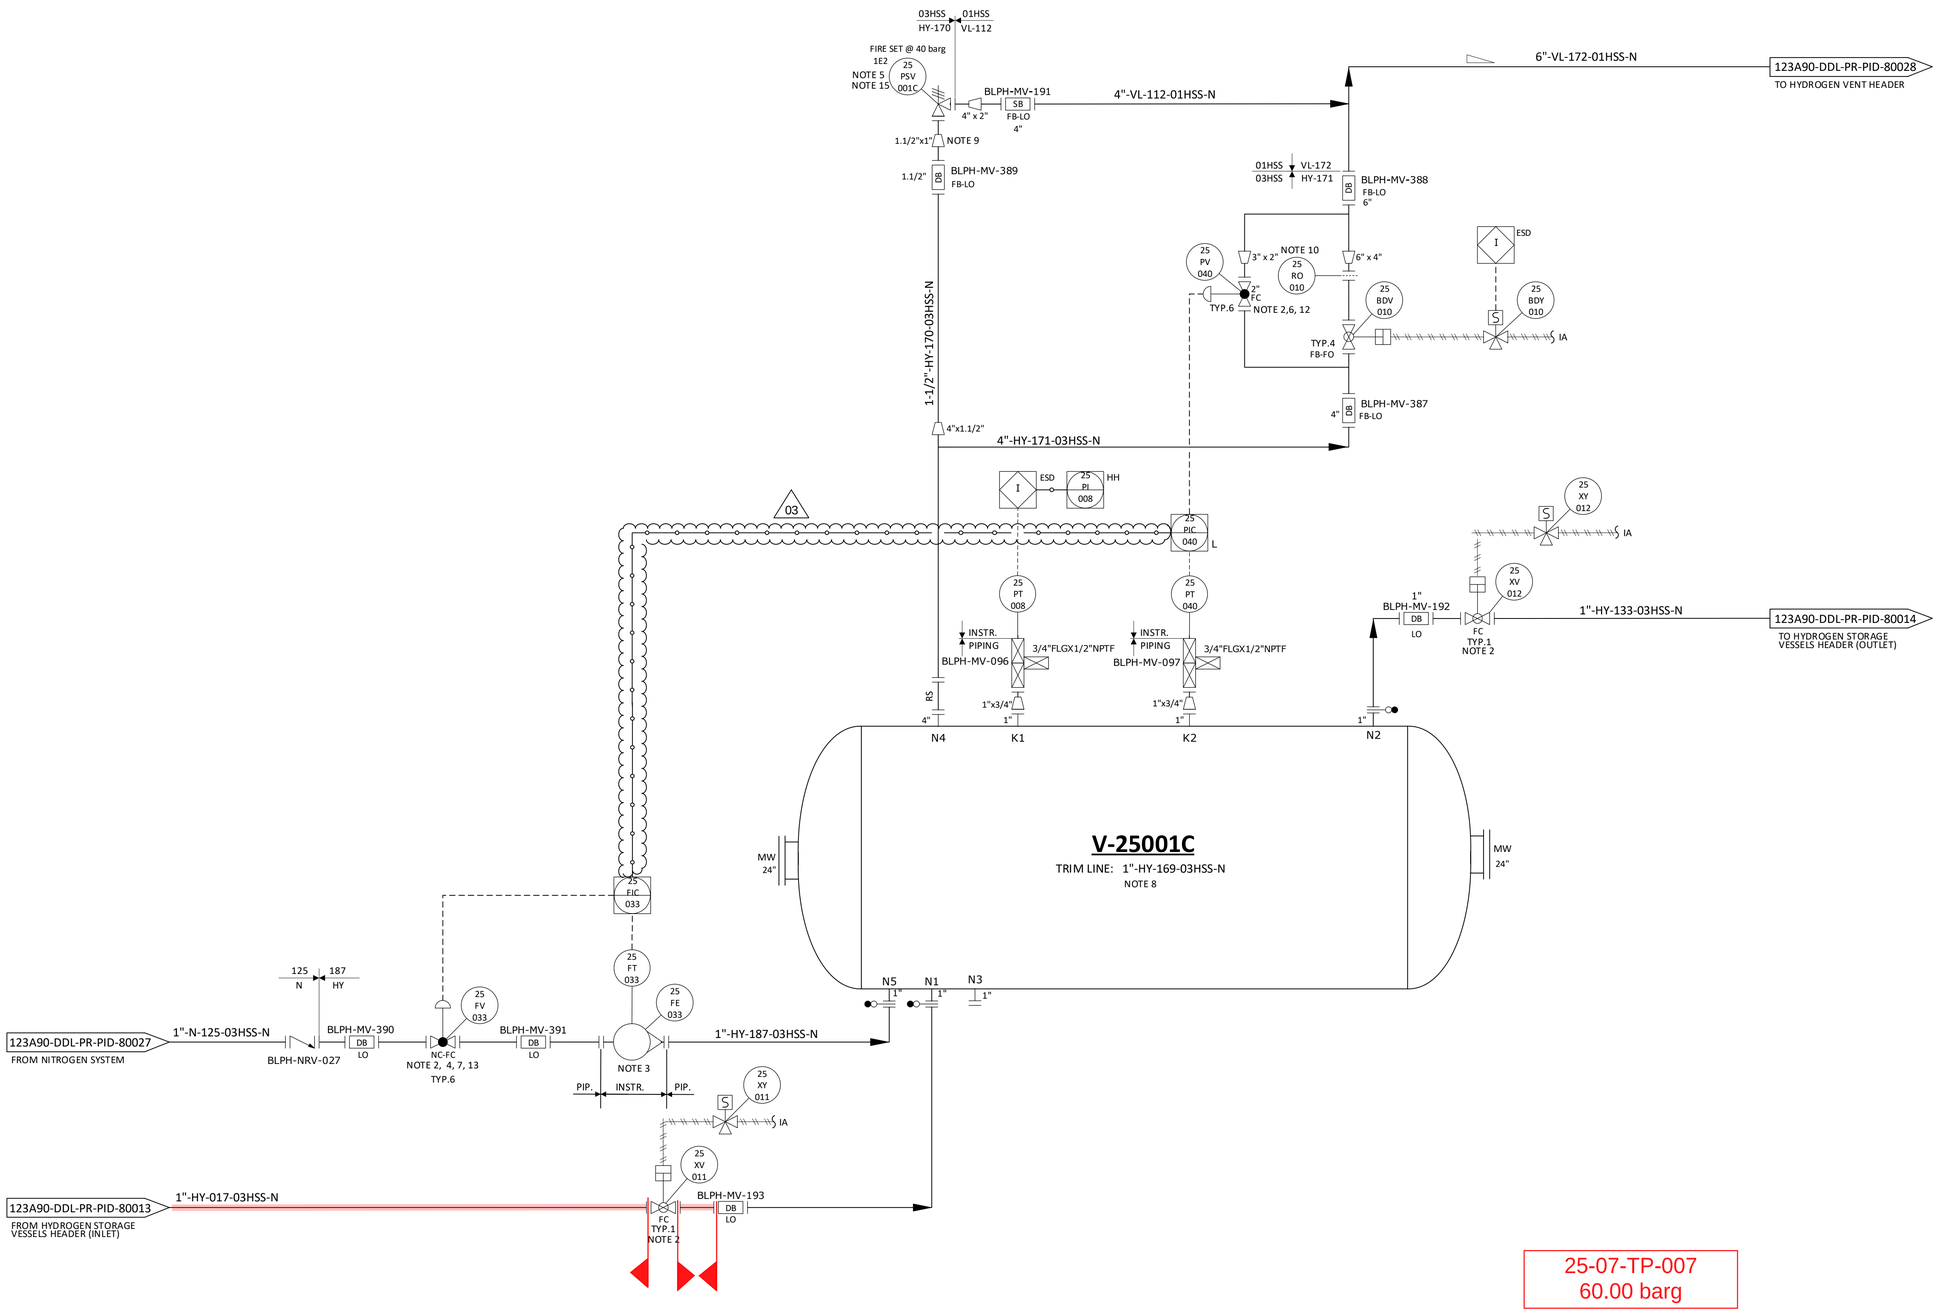

25-07-TP-007
60.00 barg

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-033) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-040 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-040 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-033 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-040 HAS FAILED TO CLOSE.
15. 25-PS-V001C SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL C

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE		
A1	DRAWING NO. 123A90-DDL-PR-PID-80017			SHEET 001	REV. 03

File Name = FILE_NAME


DRAWING NO. DRAWING_NO.

REV. REV

V-25001_D

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

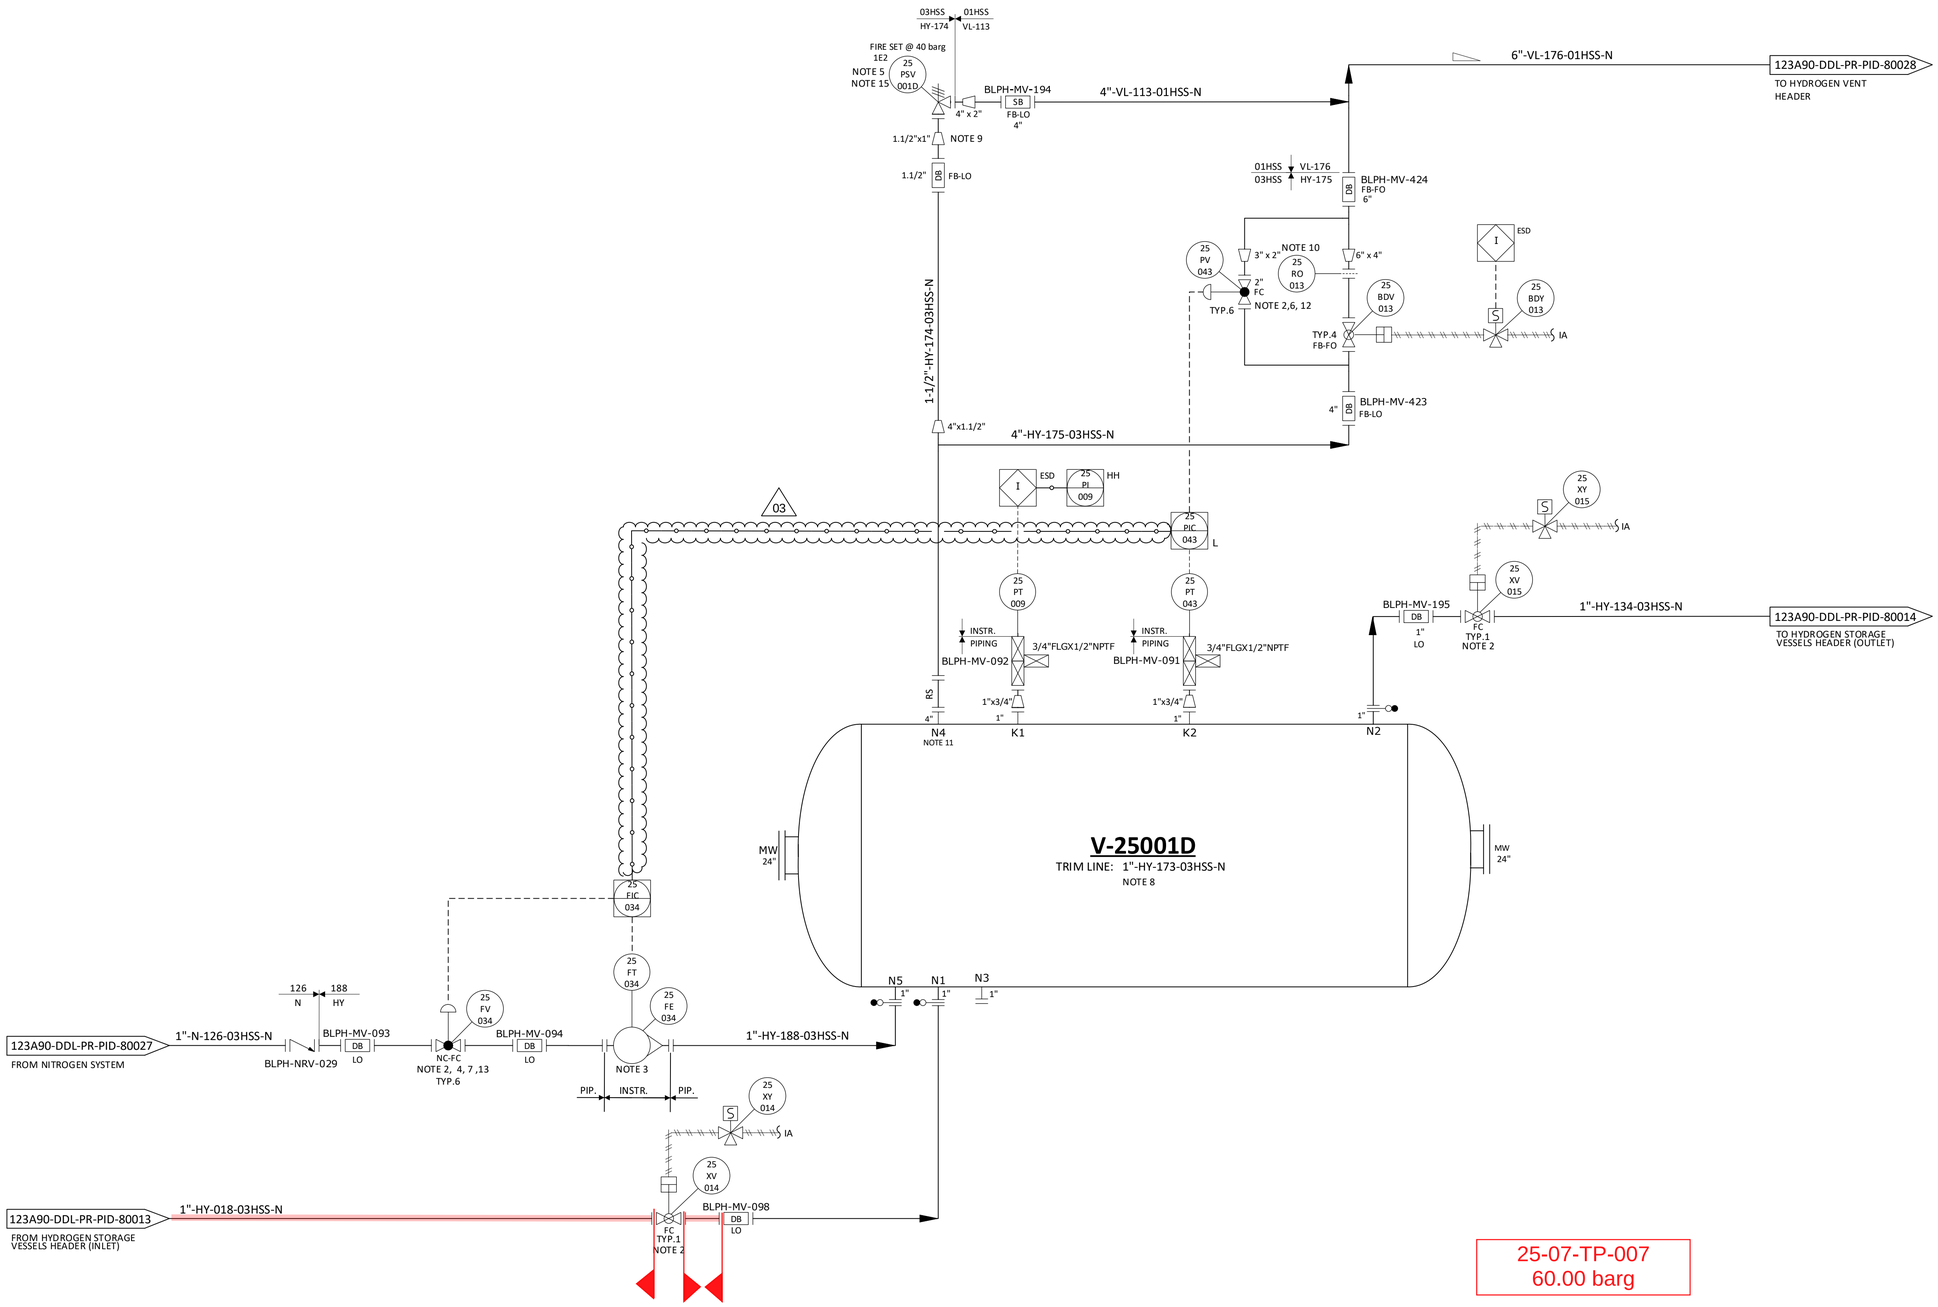

25-07-TP-007
60.00 barg

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS. 03
4. NITROGEN CONTROL VALVE (25-FV-034) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE.
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-043 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-043 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-034 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-043 HAS FAILED TO CLOSE.
15. 25-PSV-001D SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL D

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO. 123A90-DDL-PR-PID-80018	SHEET 001	REV. 03

File Name : FILE_NAME


DRAWING NO. DRAWING_NO.

REV. REV

V-25001 E

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

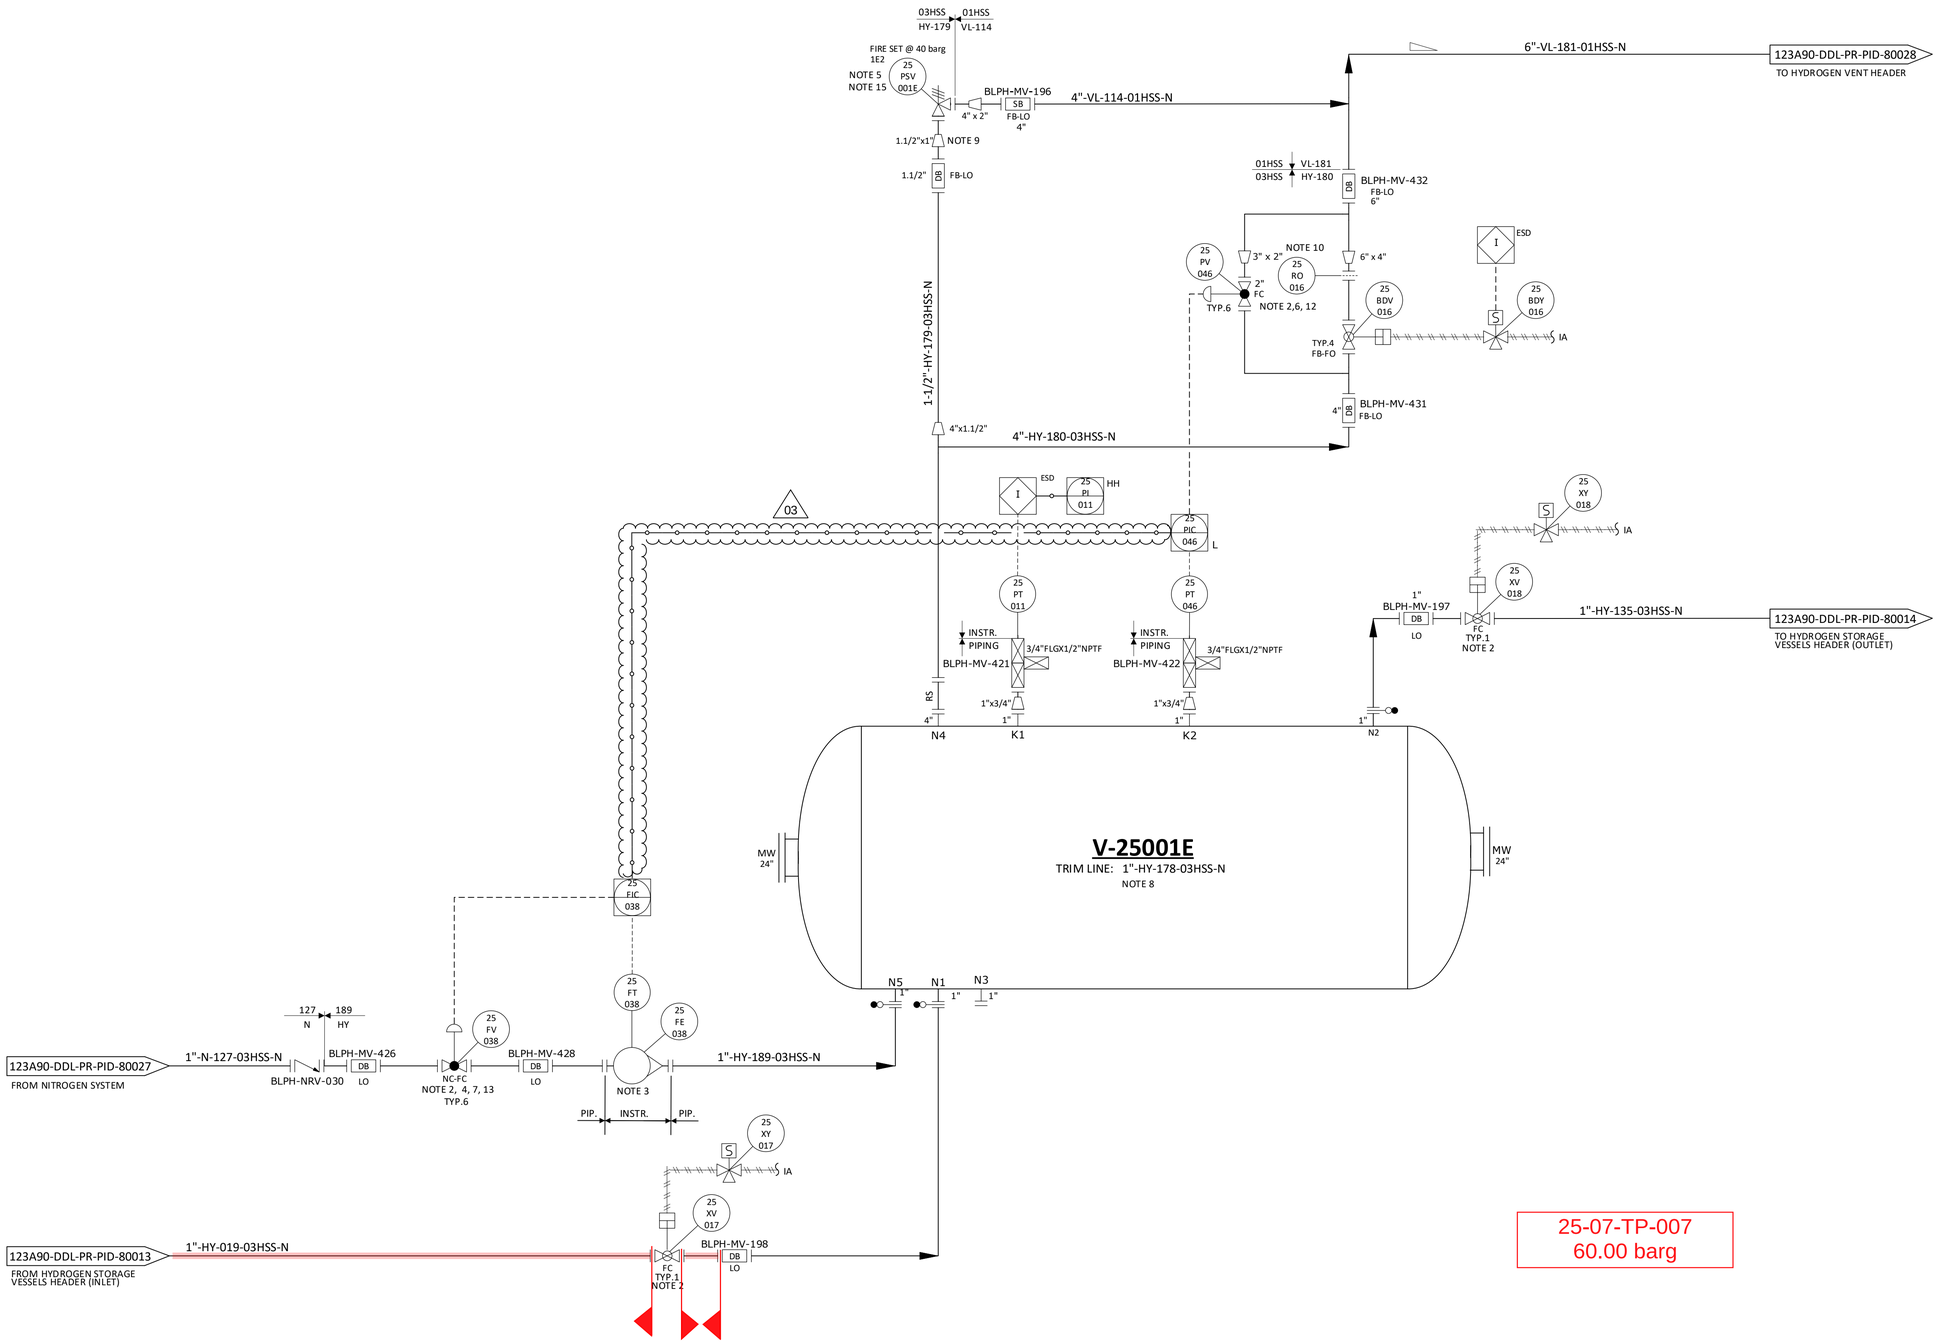

25-07-TP-007
60.00 barg

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-038) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-046 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-046 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25-FV-038 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-046 HAS FAILED TO CLOSE.
15. 25-PSV-001E SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL E

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE	
A1	DRAWING NO. 123A90-DDL-PR-PID-80019		SHEET 001	REV. 03

File Name : FILE_NAME


DRAWING NO. DRAWING_NO.

REV. REV

V-25001_F

HYDROGEN STORAGE VESSEL

SIZE : 2800 mm (ID) X 15500 mm (L T/T)
DESIGN P/T : 40 barg / -10 / 80 °C
MATERIAL : CARBON STEEL
OPERATING P/T : 30 barg / AMB

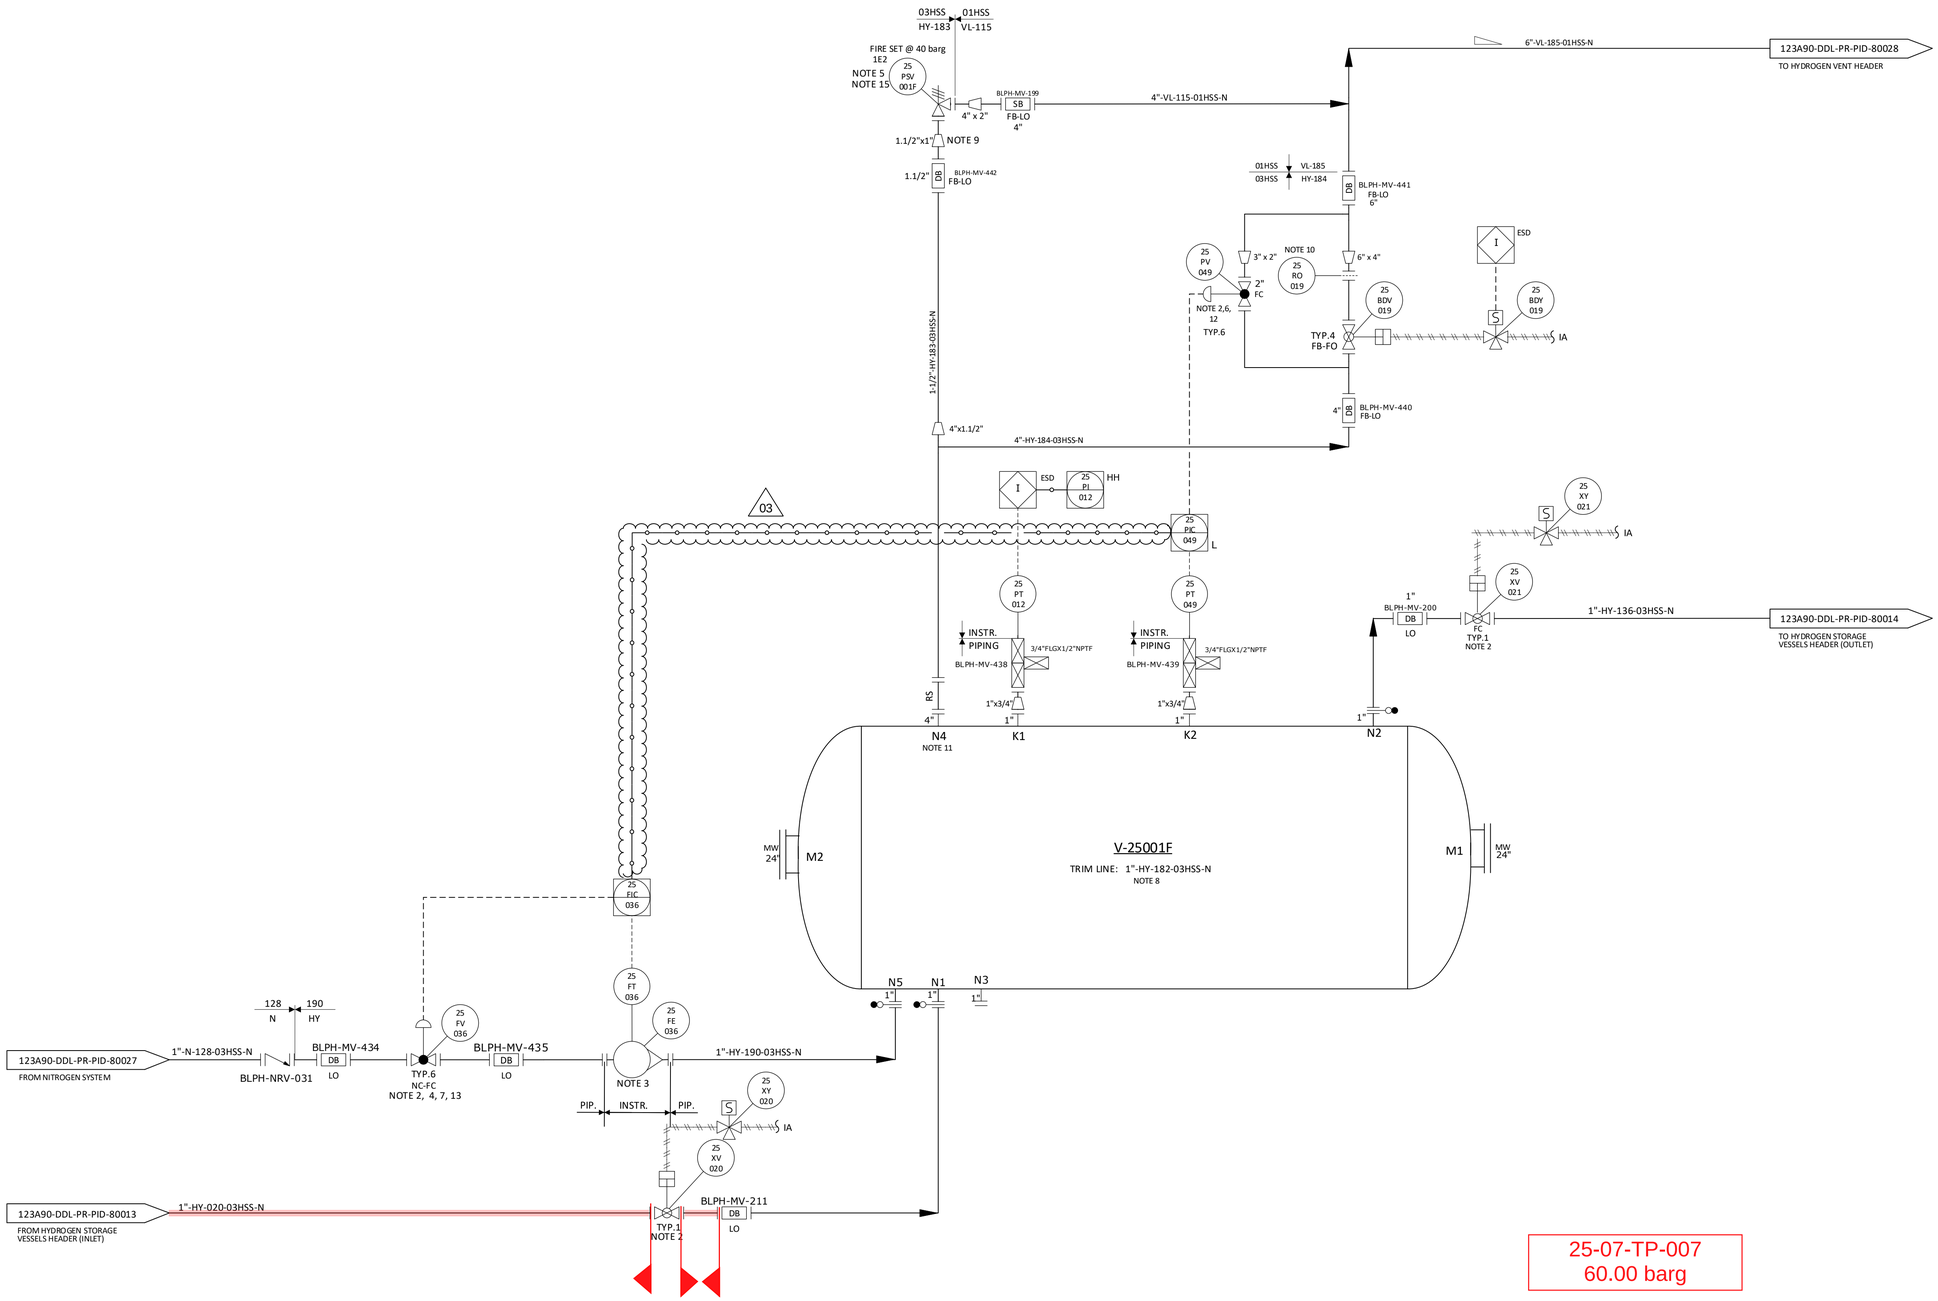

25-07-TP-007
60.00 barg

NOTES

1. DELETED.
2. TIGHT SHUT OFF VALVE.
3. VARIABLE AREA FLOWMETER TO BE INSTALLED VERTICALLY WITH DIRECTION OF FLOW UPWARDS.
4. NITROGEN CONTROL VALVE (25-FV-036) CAN NOT OPEN UNTIL THE PRESSURE WITHIN THE VESSEL IS BELOW THE NITROGEN SUPPLY PRESSURE. 03
5. ONE COMMON UNINSTALLED SPARE PSV FOR ALL VESSELS.
6. FOR PULSE PRESSURE PURGING OF VESSEL WITH HYDROGEN.
7. FOR FLOW PURGING OF VESSEL WITH NITROGEN.
8. FOR DESCRIPTION AND SPECIFICATION OF VESSEL NOZZLE, REFERENCE SHALL BE MADE TO THE TECHNICAL DATA SHEET FOR H2 STORAGE, DOC. N. "123A90-DDL-MAC-DS-50027".
9. REDUCERS TO BE INSTALLED AS CLOSE TO PSV AS POSSIBLE.
10. FOR ORIFICE DIAMETER REFERENCE SHALL BE MADE TO "RELIEF, VENT AND BLOWDOWN REPORT" DOC. N. "123A90-DDL-PR-RE-80030".
11. NOZZLE N4 TO BE INSTALLED AT MINIMUM DISTANCE FROM TANGENT LINE OF THE VESSEL (ON THE OPPOSITE SIDE OF N5 NOZZLE).
12. SOFTWARE INTERLOCK TO PREVENT 25-PV-049 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION AND PROCESS START-UP CHARGING MODE (SEE DOC. "PROCESS CONTROL LOGICS DESCRIPTION" N. 123A90-DDL-IN-RE-40095). CONTROL VALVE 25-PV-049 IS USED ONLY IN CASE OF VESSEL PURGING OR PROCESS START-UP CHARGING MODES. 03
13. SOFTWARE INTERLOCK TO PREVENT 25FV036 BEING OPENED OUTSIDE OF A PURGE CYCLE OPERATION.
14. A TIMER ALARM ON THE H2 PRESSURIZATION SECTION OF THE PURGE CYCLE IN THE CONTROL LOGIC IS PROVIDED TO DETERMINE IF THE PURGE VALVE 25-PV-049 HAS FAILED TO CLOSE.
15. 25-PSV-001F SIZED FOR FIRE.

HOLDS

1. DELETED.
2. DELETED.
3. DELETED.
4. DELETED.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR HAZOP (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND

ROSETTI MARINO


TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
HYDROGEN STORAGE VESSEL F

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE

A1	DRAWING NO.	SHEET	REV.
	123A90-DDL-PR-PID-80020	001	03

File Name : FILE_NAME

2. HYDROSTATIC TEST 3D CIRCUIT

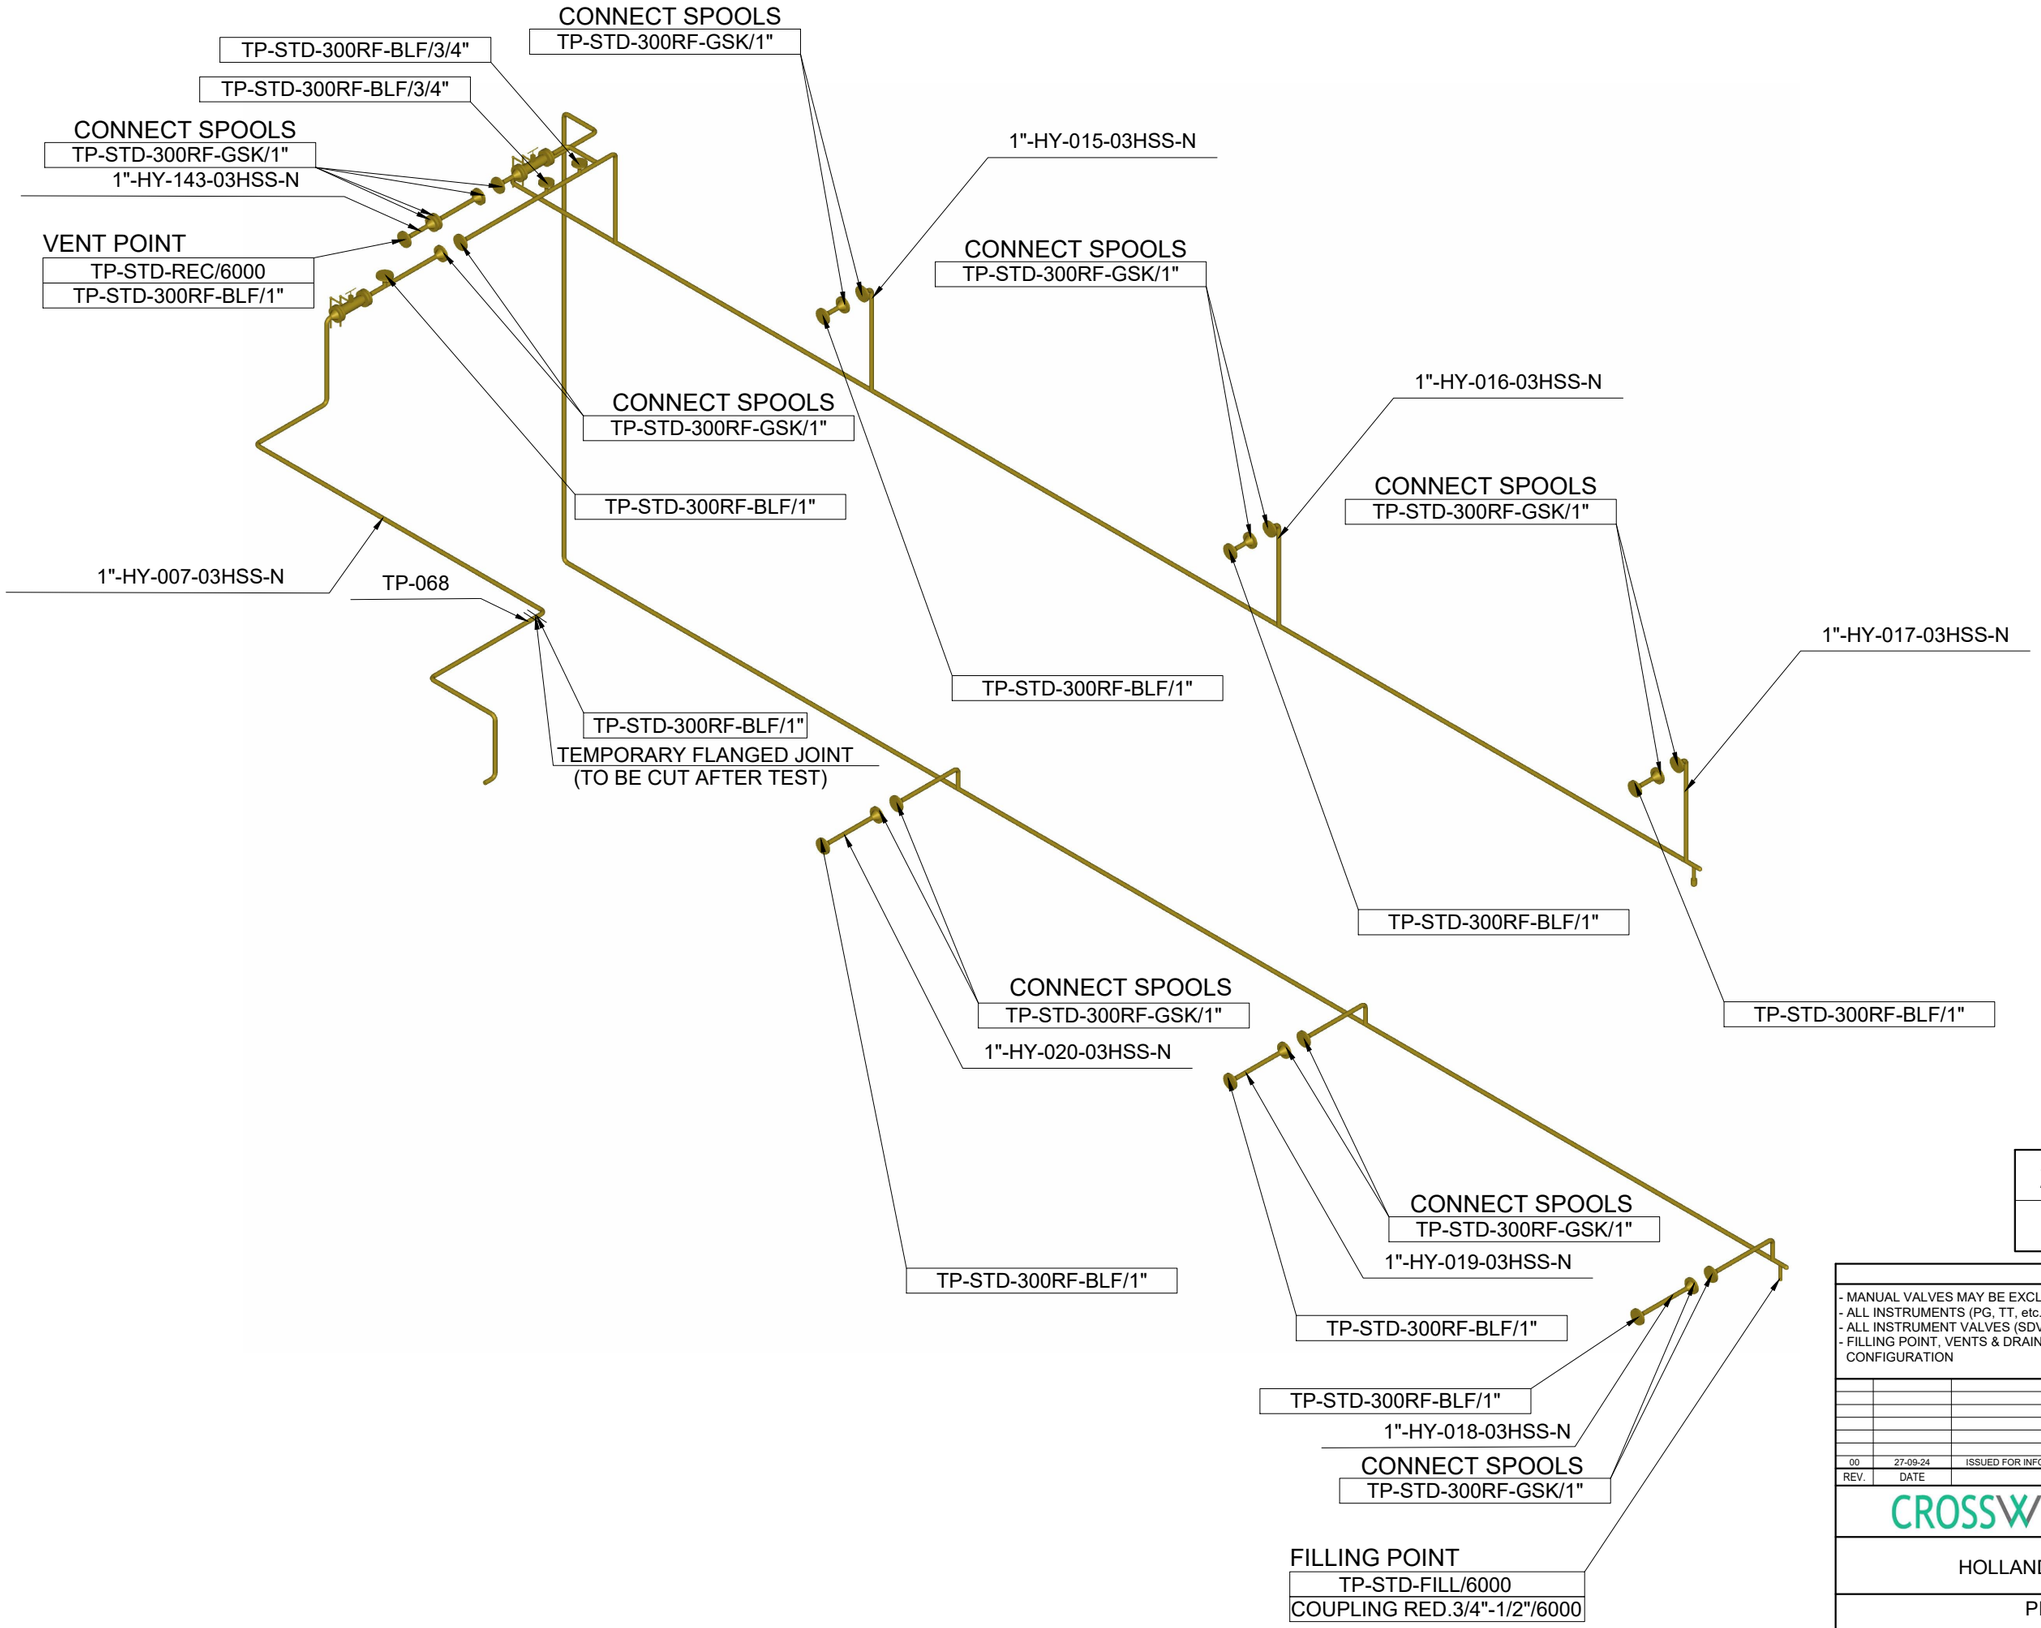

25-07-TP-007

60 barg

NOTES

- MANUAL VALVES MAY BE EXCLUDED FROM THE TEST
- ALL INSTRUMENTS (PG, TT, etc.) SHALL BE EXCLUDED FROM THE TEST
- ALL INSTRUMENT VALVES (SDV, PCV, etc.) SHALL BE EXCLUDED FROM THE TEST
- FILLING POINT, VENTS & DRAINS SHALL BE DEFINED ON SITE AS FOR REAL TEST CIRCUIT CONFIGURATION

REV.	DATE	DESCRIPTION	DRN	CHKD	APPD
00	27-09-24	ISSUED FOR INFORMATION	J.Q.	T.L.	L.M.

CROSSWIND

ROSETTI MARINO

HOLLANDSE KUST NOORD WIND PARK

PIPING TEST 3D CIRCUIT
25-07-TP-007

FORMAT	SCALE	DRAWING N.	REV.	SHEET
A3	NTS	N/A	00	1 OF 1

3. MATERIAL LIST FOR TEST


CROSSWIND / ROSETTI MARINO	CONTRACTOR	JOB :	123A90
	Rosetti Marino SpA		
	PROJECT	DATE :	20/09/2024
	Base Load Power Hub (BLPH)		
	TITLE	REV. :	00
	MATERIAL LIST FOR HYDROSTATIC TEST		

TEST REF.	TYPICAL ITEM CODE	ROSETTI CODE	ROSETTI DESCRIPTION	Q.TY X SINGLE STD	Q.TY STD X TP	Q.ty x TP	NOTES
ALL TEST	TP-STD-FILL/6000	1EQP252	Ball Valve THRD-F NPT ø1/2" 7250 psi 316L	5	1	5	
ALL TEST	TP-STD-FILL/6000	N100SS02660H00	Nipple L=100mm TBE ø1/2" Thk.4,78mm ASTM A312 Gr.TP316/316L	7	1	7	
ALL TEST	TP-STD-FILL/6000	TEEFSS00060H00	Tee THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	3	1	3	
ALL TEST	TP-STD-FILL/6000	1MECH069	Adapter THRD-M NPT x BSPP ø1/2" 400 bar ASTM A182 Gr.F316/316L	2	1	2	
ALL TEST	TP-STD-REC/6000	1EQP252	Ball Valve THRD-F NPT ø1/2" 7250 psi 316L	4	1	4	
ALL TEST	TP-STD-REC/6000	N100SS02660H00	Nipple L=100mm TBE ø1/2" Thk.4,78mm ASTM A312 Gr.TP316/316L	9	1	9	
ALL TEST	TP-STD-REC/6000	TEEFSS00060H00	Tee THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	2	1	2	
ALL TEST	TP-STD-REC/6000	CAPFSS00200H00	Cap Forged THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	1	1	1	
ALL TEST	TP-STD-REC/6000	CPL0SS00240H00	Coupling THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	1	1	1	
ALL TEST	TP-STD-REC/6000	E900SS00340H00	90 Deg Elbow THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	1	1	1	
ALL TEST	TP-STD-PLGNPT/1/2"	PLGHSS00090H00	Plug Hex. Head THRD-M NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	1	1	1	
TP-007	TP-STD-300RF-BLF/3/4"	FLBHCS01563Q0H	Flange Blind c/w NPT Hole ø3/4"x1/2" 300LB RF ASTM/ASME A/SA105	1	2	2	
TP-007	TP-STD-300RF-BLF/3/4"	GSW0GK11203Q00	Gasket Spiral Wound Thk. 3.2 mm ø3/4" 300LB RF AISI 316 + GRAPHITE c/w INNER RING	1	2	2	
TP-007	TP-STD-300RF-BLF/3/4"	SB20BO00680300	Stud Bolt + 2 Heavy Nuts 5/8" L=100MM ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	2	8	
TP-007	TP-STD-300RF-BLF/1"	FLBHCS0018010H	Flange Blind c/w NPT Hole ø1"x1/2" 300LB RF ASTM/ASME A/SA105	1	9	9	
TP-007	TP-STD-300RF-BLF/1"	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ø1" 300LB RF AISI 316 + GRAPHITE c/w INNER RING	1	9	9	
TP-007	TP-STD-300RF-BLF/1"	SB20BO00680300	Stud Bolt + 2 Heavy Nuts 5/8" L=100MM ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	9	36	
TP-007	TP-STD-300RF-GSK/1"	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ø1" 300LB RF AISI 316 + GRAPHITE c/w INNER RING	1	9	9	
TP-007	TP-STD-300RF-GSK/1"	SB20BO00680300	Stud Bolt + 2 Heavy Nuts 5/8" L=100MM ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	9	36	


TP-STD-300RF | 300 RF | STANDARD FOR BLIND POINT

TP-STD-300RF-BLF/Dn
TP-STD-300RF-GSK/Dn

MATERIAL LIST			
STD	**POS.**	**DESCRIPTION**	**Q.TY**
TP-STD-300RF-___/1/2"	8	Flange Blind c/w NPT Hole ø1/2"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø1/2" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 1/2" L=65 MM	4
TP-STD-300RF-___/3/4"	8	Flange Blind c/w NPT Hole ø3/4"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø3/4" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 5/8" L=75 MM	4
TP-STD-300RF-___/1"	8	Flange Blind c/w NPT Hole ø1"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø1" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 5/8" L=80 MM	4
TP-STD-300RF-___/1.1/4"	8	Flange Blind c/w NPT Hole ø1.1/4"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø1.1/4" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 5/8" L=90 MM	4
TP-STD-300RF-___/1.1/2"	8	Flange Blind c/w NPT Hole ø1.1/2"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø1.1/2" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 3/4" L=95 MM	4
TP-STD-300RF-___/2"	8	Flange Blind c/w NPT Hole ø2"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø2" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 5/8" L=90 MM	8
TP-STD-300RF-___/2.1/2"	8	Flange Blind c/w NPT Hole ø2.1/2"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø2.1/2" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 3/4" L=105 MM	8
TP-STD-300RF-___/3"	8	Flange Blind c/w NPT Hole ø3"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø3" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 3/4" L=110 MM	8
TP-STD-300RF-___/4"	8	Flange Blind c/w NPT Hole ø4"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø4" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 3/4" L=115 MM	8
TP-STD-300RF-___/6"	8	Flange Blind c/w NPT Hole ø6"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø6" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 3/4" L=125 MM	12
TP-STD-300RF-___/8"	8	Flange Blind c/w NPT Hole ø8"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø8" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 7/8" L=145 MM	12
TP-STD-300RF-___/10"	8	Flange Blind c/w NPT Hole ø10"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø10" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 1" L=160 MM	16
TP-STD-300RF-___/12"	8	Flange Blind c/w NPT Hole ø12"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø12" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 1.1/8" L=175 MM	16
TP-STD-300RF-___/14"	8	Flange Blind c/w NPT Hole ø14"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø14" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 1.1/8" L=180 MM	20
TP-STD-300RF-___/16"	8	Flange Blind c/w NPT Hole ø16"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø16" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 1.1/4" L=195 MM	20
TP-STD-300RF-___/18"	8	Flange Blind c/w NPT Hole ø18"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø18" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 1.1/4" L=200 MM	24
TP-STD-300RF-___/20"	8	Flange Blind c/w NPT Hole ø20"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø20" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 1.1/4" L=210 MM	24
TP-STD-300RF-___/24"	8	Flange Blind c/w NPT Hole ø24"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø24" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 1.1/2" L=235 MM	24

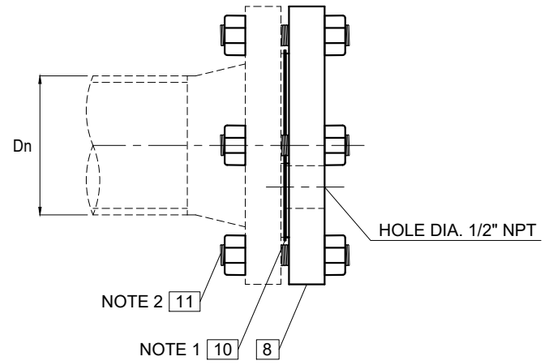

TP-STD-300RF-BLF/Dn
BLIND FLANGE

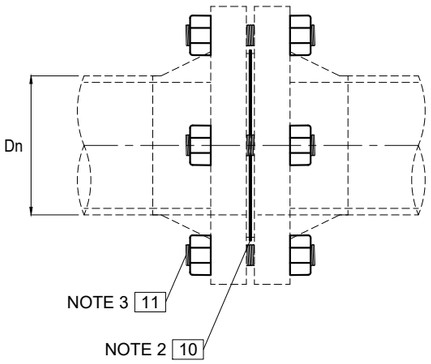

TP-STD-300RF-GSK/Dn
GASKET ONLY

NOTES

1. GASKET MATERIAL AS PER PIPING CLASS
2. STUD BOLTS AND NUTS MATERIAL AS PER TEST MTO


REV.	DATE	DESCRIPTION	DRN	CHKD	APPD
00	06-09-24	ISSUED FOR INFORMATION	J.Q.	T.L.	L.M.

ROSETTI MARINO

PIPING TEST STANDARD DRAWING
TP-STD-300RF
TP-STD-300RF-BLF/Dn
TP-STD-300RF-GSK/Dn

FORMAT	SCALE	DRAWING N.	REV.	SHEET
A3	NTS	TP_STD_300RF	00	1 OF 1

STD NAME	RATING	DESCRIPTION
TP-STD-FILL	3000 / 6000 / 9000	STANDARD FOR FILLING POINT
TP-STD-FILL/RATING		

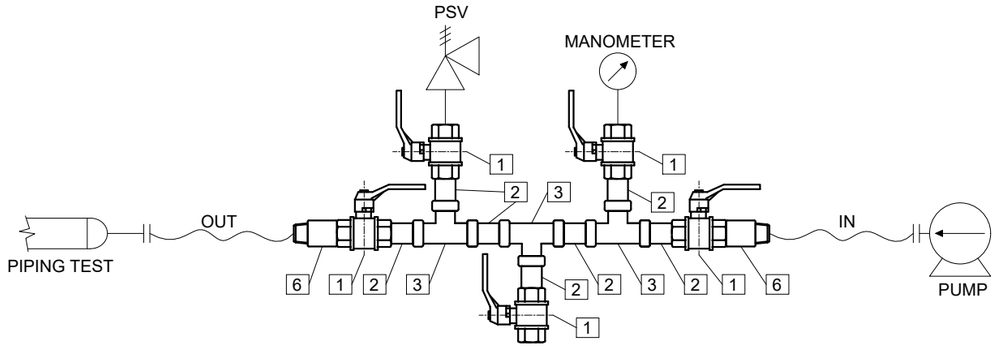

TP-STD-FILL/RATING

FILLING POINT 3000/6000/9000

MATERIAL LIST

STD	POS.	DESCRIPTION	Q.TY
TP-STD-FILL/3000	1	Ball Valve THRD-F NPT ø1/2" 7250 psi 316L	5
	2	Nipple L=100mm TBE ø1/2" Thk.3.73mm ASTM A312 Gr.TP316/316L	7
	3	Tee Forged THRD-F NPT ø1/2" 3000# ASTM A182 Gr.F316/316L	3
	6	Adapter THRD-M NPT x BSPP ø1/2" 400 bar ASTM A182 Gr.F316/316L	2
TP-STD-FILL/6000	1	Ball Valve THRD-F NPT ø1/2" 7250 psi 316L	5
	2	Nipple L=100mm TBE ø1/2" Thk.4,78mm ASTM A312 Gr.TP316/316L	7
	3	Tee THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	3
	6	Adapter THRD-M NPT x BSPP ø1/2" 400 bar ASTM A182 Gr.F316/316L	2
TP-STD-FILL/9000	1	Ball Valve THRD-F NPT ø1/2" 7250 psi 316L	5
	2	Nipple L=100mm TBE ø1/2" Thk.7,47mm ASTM A312 Gr.TP316/316L	7
	3	Tee Forged THRD-F NPT ø1/2" 9000# ASTM A182 Gr.F316/316L	3
	6	Adapter THRD-M NPT x BSPP ø1/2" 523 bar 304SS	2

NOTES

REV.	DATE	DESCRIPTION	DRN	CHKD	APPD
00	06-09-24	ISSUED FOR INFORMATION	J.Q.	T.L.	L.M.

ROSETTI MARINO

PIPING TEST STANDARD DRAWING


TP-STD-FILL

TP-STD-FILL/RATING

FORMAT	SCALE	DRAWING N.	REV.	SHEET
A3	NTS	TP_STD_FILL	00	1 OF 1

STD NAME	RATING	DESCRIPTION
TP-STD-REC	3000 / 6000 / 9000	STANDARD FOR RECORDING POINT

TP-STD-REC/RATING

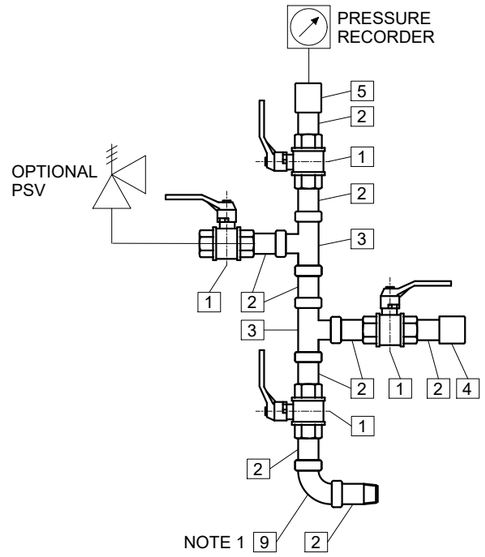

TP-STD-REC/RATING
RECORDING POINT 3000/6000/9000

MATERIAL LIST

STD	POS.	DESCRIPTION	Q.TY
TP-STD-REC/3000	1	Ball Valve THRD-F NPT ø1/2" 7250 psi 316L	4
	2	Nipple L=100mm TBE ø1/2" Thk.3.73mm ASTM A312 Gr.TP316/316L	9
	3	Tee Forged THRD-F NPT ø1/2" 3000# ASTM A182 Gr.F316/316L	2
	4	Cap Forged THRD-F NPT ø1/2" 3000# ASTM A182 Gr.F316/316L	1
	5	Coupling THRD-F NPT ø1/2" 3000# ASTM A182 Gr.F316/316L	1
	9	90 Deg Elbow THRD-F NPT ø1/2" 3000# ASTM A182 Gr.F316/316L	1
TP-STD-REC/6000	1	Ball Valve THRD-F NPT ø1/2" 7250 psi 316L	4
	2	Nipple L=100mm TBE ø1/2" Thk.4,78mm ASTM A312 Gr.TP316/316L	9
	3	Tee THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	2
	4	Cap Forged THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	1
	5	Coupling THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	1
	9	90 Deg Elbow THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	1
TP-STD-REC/9000	1	Ball Valve THRD-F NPT ø1/2" 7250 psi 316L	4
	2	Nipple L=100mm TBE ø1/2" Thk.7,47mm ASTM A312 Gr.TP316/316L	9
	3	Tee Forged THRD-F NPT ø1/2" 9000# ASTM A182 Gr.F316/316L	2
	4	Cap Forged THRD-F NPT ø1/2" 9000# ASTM A182 Gr.F316/316L	1
	5	Coupling THRD-F NPT ø1/2" 9000# ASTM A182 Gr.F316/316L	1
	9	90 Deg Elbow THRD-F NPT ø1/2" 9000# ASTM A182 Gr.F316/316L	1

NOTES

1. 90 DEG ELBOW SHALL BE INSTALLED WHERE APPLICABLE ONLY

REV.	DATE	DESCRIPTION	DRN	CHKD	APPD
00	06-09-24	ISSUED FOR INFORMATION	J.Q.	T.L.	L.M.

ROSETTI MARINO

PIPING TEST STANDARD DRAWING
TP-STD-REC
TP-STD-REC/RATING

FORMAT	SCALE	DRAWING N.	REV.	SHEET
A3	NTS	TP_STD_REC	00	1 OF 1

4. EXTRACT OF LINE LIST

Isometric N°	Short Line N°	Sequential Number	Size [in]	Piping Class	Insulation Type	Pipe Wall Thicknes [mm]	Pipe Schedule	Tracing	Line Number	PID Number	Design Pressure [barg]	Commissioning System Code	Commissioning SubSystem Code	Test Pack N°	Test Fluid	Test Pressure [barg]	Fluid Service	Class Base Material	Line INF/SUP/TL	Ped Category	Painting System	Line Base Ral
5	HY-007	007	1	03HSS	N	3,38	40S	N/A	1"-HY-007-03HSS-N	123A90-DDL-PR-PID-80011	40,00	25	25-07	TP-007/TP-068	Water	60.00	Hydrogen	Stainless Steel	INF	II	6A	RAL 9002
56	HY-143	143	1	03HSS	N	3,38	40S	N/A	1"-HY-143-03HSS-N	123A90-DDL-PR-PID-80013	40,00	25	25-07	TP-007	Water	60.00	Hydrogen	Stainless Steel	INF	II	6A	RAL 9002
9	HY-015	015	1	03HSS	N	3,38	40S	N/A	1"-HY-015-03HSS-N	123A90-DDL-PR-PID-80013	40,00	25	25-01 / 25-07	TP-007/TP-008	Water	60.00	Hydrogen	Stainless Steel	INF	II	6A	RAL 9002
10	HY-016	016	1	03HSS	N	3,38	40S	N/A	1"-HY-016-03HSS-N	123A90-DDL-PR-PID-80016	40,00	25	25-02 / 25-07	TP-007/TP-009	Water	60.00	Hydrogen	Stainless Steel	INF	II	6A	RAL 9002
11	HY-017	017	1	03HSS	N	3,38	40S	N/A	1"-HY-017-03HSS-N	123A90-DDL-PR-PID-80013	40,00	25	25-03 / 25-07	TP-007/TP-010	Water	60.00	Hydrogen	Stainless Steel	INF	II	6A	RAL 9002
12	HY-018	018	1	03HSS	N	3,38	40S	N/A	1"-HY-018-03HSS-N	123A90-DDL-PR-PID-80018	40,00	25	25-04 / 25-07	TP-007/TP-011	Water	60.00	Hydrogen	Stainless Steel	INF	II	6A	RAL 9002
13	HY-019	019	1	03HSS	N	3,38	40S	N/A	1"-HY-019-03HSS-N	123A90-DDL-PR-PID-80019	40,00	25	25-05 / 25-07	TP-007/TP-012	Water	60.00	Hydrogen	Stainless Steel	INF	II	6A	RAL 9002
14	HY-020	020	1	03HSS	N	3,38	40S	N/A	1"-HY-020-03HSS-N	123A90-DDL-PR-PID-80013	40,00	25	25-06 / 25-07	TP-007/TP-013	Water	60.00	Hydrogen	Stainless Steel	INF	II	6A	RAL 9002

5. ISOMETRIC RED MARKED DRAWING & EXTRACT OF ISO LIST

CROSSWIND

ROSETTI MARINO

PROJECT

BASE LOAD POWER HUB (BLPH)

JOB: **123A90**


DOCUMENT NR: **123A90-FDL-ST-LIS-00001** REV.: **08**

TITLE

SHOP DRAWING ISOMETRIC LIST

DATE: **04/12/2024**

POS.	DOCUMENT NR	ROSETTI SKETCH NR	SHEET	DOCUMENT TITLE	Rev. 00	Rev. 01	Rev. 02	Rev. 03	Rev. 04	Rev. 05	Rev. 06	Rev. 07	Rev. 08	Rev. 09	Rev. 10	Mark-up Rev.	Mark-up Data	LAST REV	LIST REV	NOTES	TEST PACK NR
7	123A90-FDL-PP-DI-00005-01	**005**	01	SHOP DRAWING ISOMETRIC - LINE NR 1"-HY-007-03HSS-N	03/09/2024	04/12/2024												**01**	**08**		**TP-007/TP-068**
8	123A90-FDL-PP-DI-00005-02	**005**	02	SHOP DRAWING ISOMETRIC - LINE NR 1"-HY-007-03HSS-N	03/09/2024	17/09/2024												**01**	**05**		**TP-007**
9	123A90-FDL-PP-DI-00005-03	**005**	03	SHOP DRAWING ISOMETRIC - LINE NR 1"-HY-007-03HSS-N	03/09/2024	17/09/2024												**01**	**05**		**TP-007**
13	123A90-FDL-PP-DI-00009-01	**009**	01	SHOP DRAWING ISOMETRIC - LINE NR 1"-HY-015-03HSS-N	30/07/2024	03/09/2024	17/09/2024											**02**	**05**		**TP-007/TP-008**
14	123A90-FDL-PP-DI-00010-01	**010**	01	SHOP DRAWING ISOMETRIC - LINE NR 1"-HY-016-03HSS-N	30/07/2024	03/09/2024	17/09/2024											**02**	**05**		**TP-007/TP-009**
15	123A90-FDL-PP-DI-00011-01	**011**	01	SHOP DRAWING ISOMETRIC - LINE NR 1"-HY-017-03HSS-N	30/07/2024	03/09/2024	17/09/2024											**02**	**05**		**TP-007/TP-010**
16	123A90-FDL-PP-DI-00012-01	**012**	01	SHOP DRAWING ISOMETRIC - LINE NR 1"-HY-018-03HSS-N	30/07/2024	03/09/2024	17/09/2024											**02**	**05**		**TP-007/TP-011**
17	123A90-FDL-PP-DI-00013-01	**013**	01	SHOP DRAWING ISOMETRIC - LINE NR 1"-HY-019-03HSS-N	30/07/2024	03/09/2024	17/09/2024											**02**	**05**		**TP-007/TP-012**
18	123A90-FDL-PP-DI-00014-01	**014**	01	SHOP DRAWING ISOMETRIC - LINE NR 1"-HY-020-03HSS-N	30/07/2024	03/09/2024	17/09/2024											**02**	**05**		**TP-007/TP-013**
77	123A90-FDL-PP-DI-00056-01	**056**	01	SHOP DRAWING ISOMETRIC - LINE NR 1"-HY-143-03HSS-N	30/07/2024	03/09/2024	17/09/2024											**02**	**05**		**TP-007**

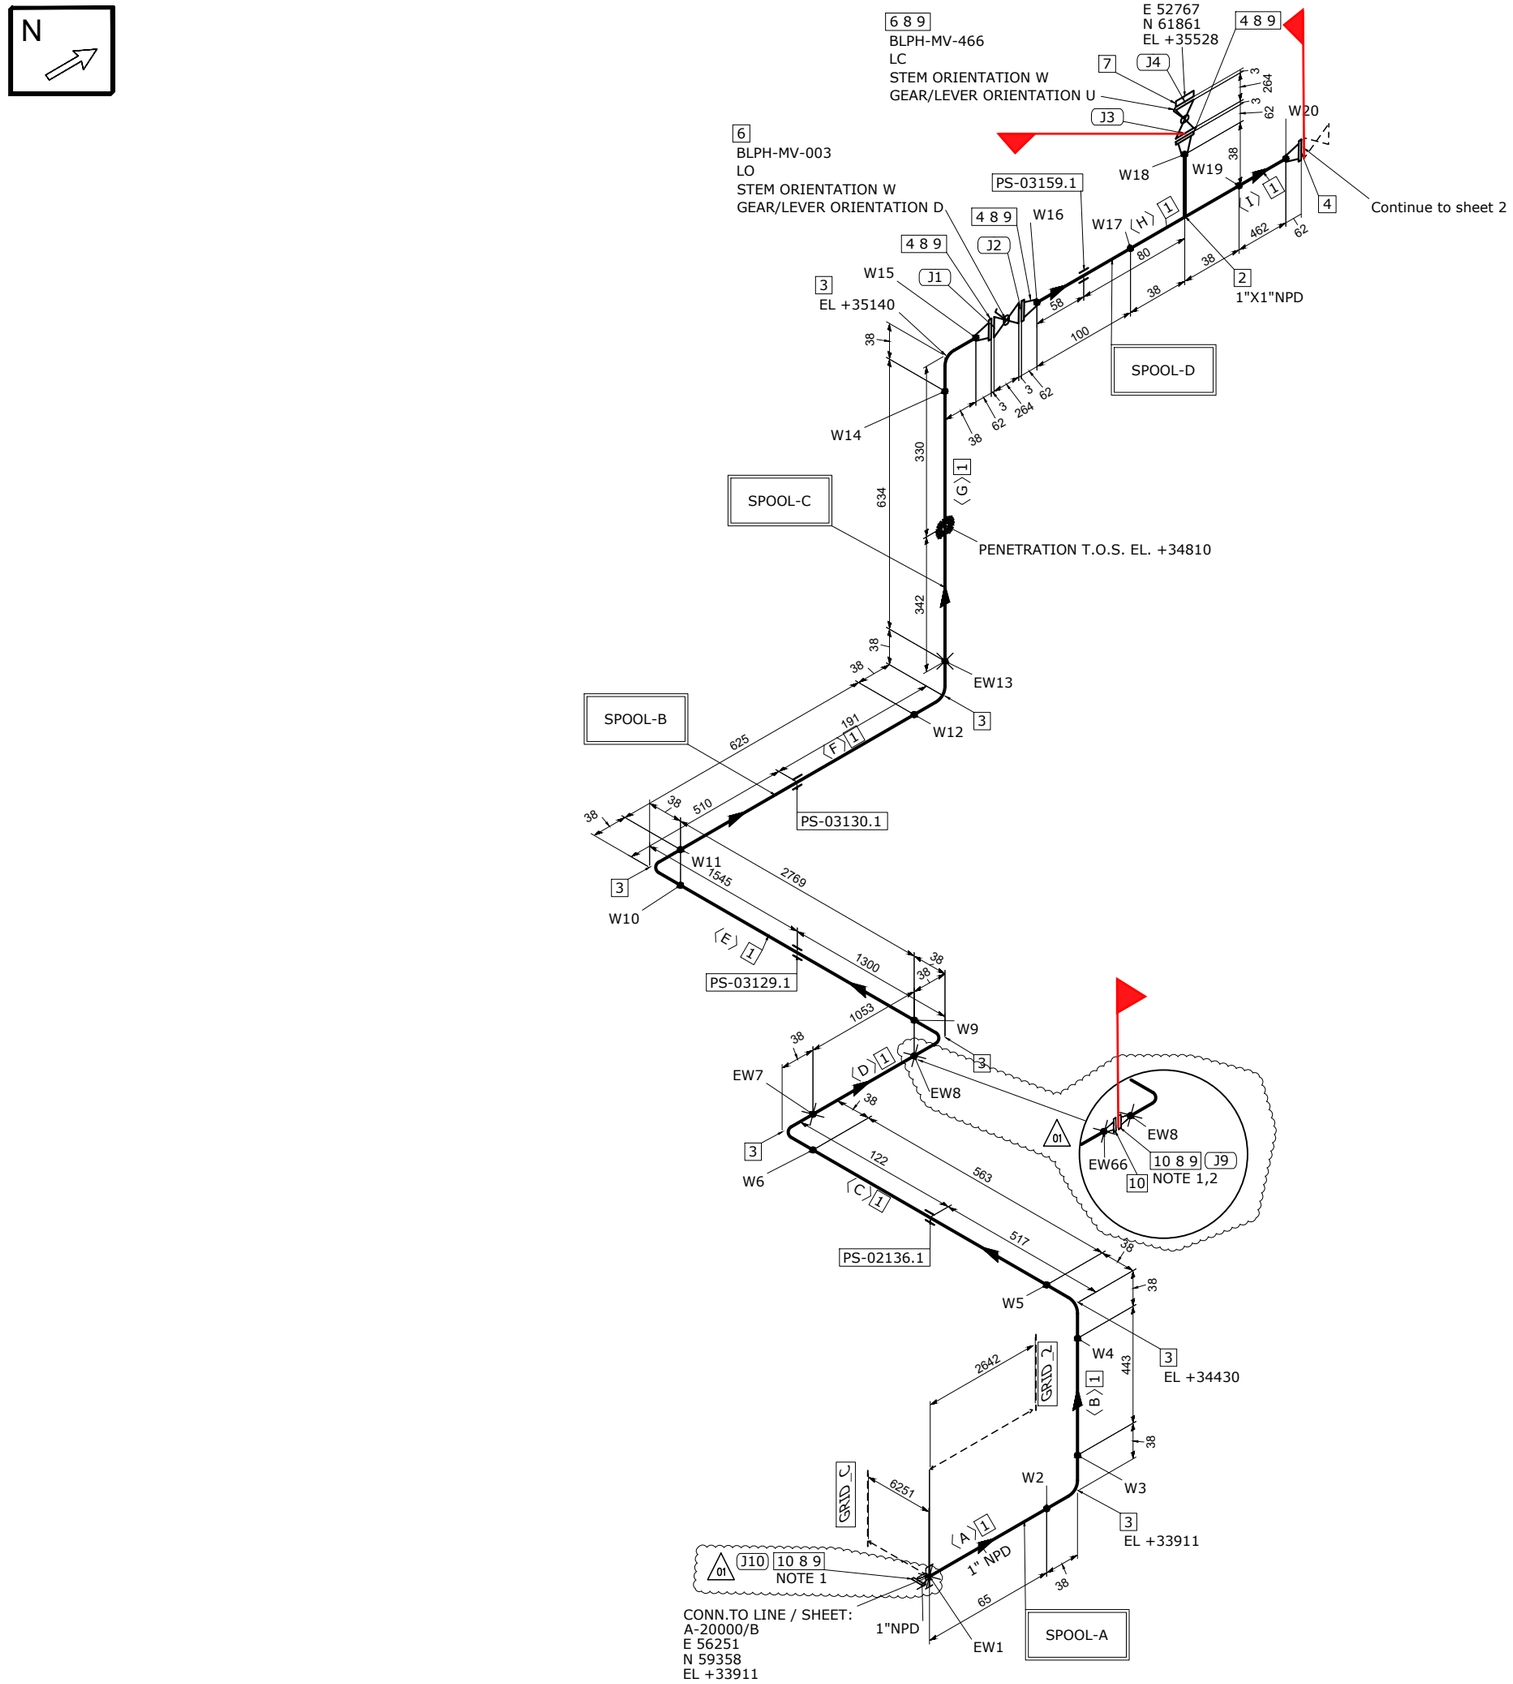

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	6.7M	17.1
2	1X1	TEE0SS00550100	Tee ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	7	1.0
4	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
6	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	2	27.0
7	1	FLB0SS01830100	Flange Blind ASME B16.5 300LB RF FRG ASTM A182 Gr.F316/316L	1	1.8
8	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	6	0.6
9	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	24	5.6
01 10	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	3	5.5

FABRICATION WEIGHT [kg]	25.7
ERECTION WEIGHT [kg]	40.5
OVERALL WEIGHT [kg]	66.2

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
EW1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
EW7	1	BW
01 EW8	1	BW
W9	1	BW
W10	1	BW
W11	1	BW
W12	1	BW
EW13	1	BW
W14	1	BW
W15	1	BW
W16	1	BW
W17	1	BW
W18	1	BW
W19	1	BW
W20	1	BW
01 EW66	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	65	SQ.CUT	BEVEL
B	1	443	BEVEL	BEVEL
C	1	563	BEVEL	BEVEL
D	1	1053	BEVEL	BEVEL
E	1	2769	BEVEL	BEVEL
F	1	625	BEVEL	BEVEL
G	1	634	BEVEL	BEVEL
H	1	100	BEVEL	BEVEL
I	1	462	BEVEL	BEVEL

SUPPORT LIST

PS-02136.1
PS-03129.1
PS-03130.1
PS-03159.1

SPOOL	WELD [inches]	WEIGHT [kg]
A	5	3.1
B	01 4	11.7
C	2	3.6
D	5	7.3
	01	
MONT	5	40.5

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	04-12-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	03-09-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-007-03HSS-N
SK.005

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A

DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 03-09-2024

FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00005 | SHEET / OF: 1/3 | REV.: 01

25-07-TP-007

MASTER

LINE DATA


NDT INSPECTION CATEGORY	1			PED CATEGORY	II			
PAINTING	SYSTEM 6A	BASE RAL RAL-9002		FLUID PHASE	Gas			
INSULATION	TYPE N	THICKNESS [mm]		DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]		
HEAT TRACING	N/A			TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water	

REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80011
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1) TEMPORARY FLANGE FOR HYDROTEST, TO BE CUT AFTER TEST (01)
2) PIPE 1<D> REMAIN 1053mm

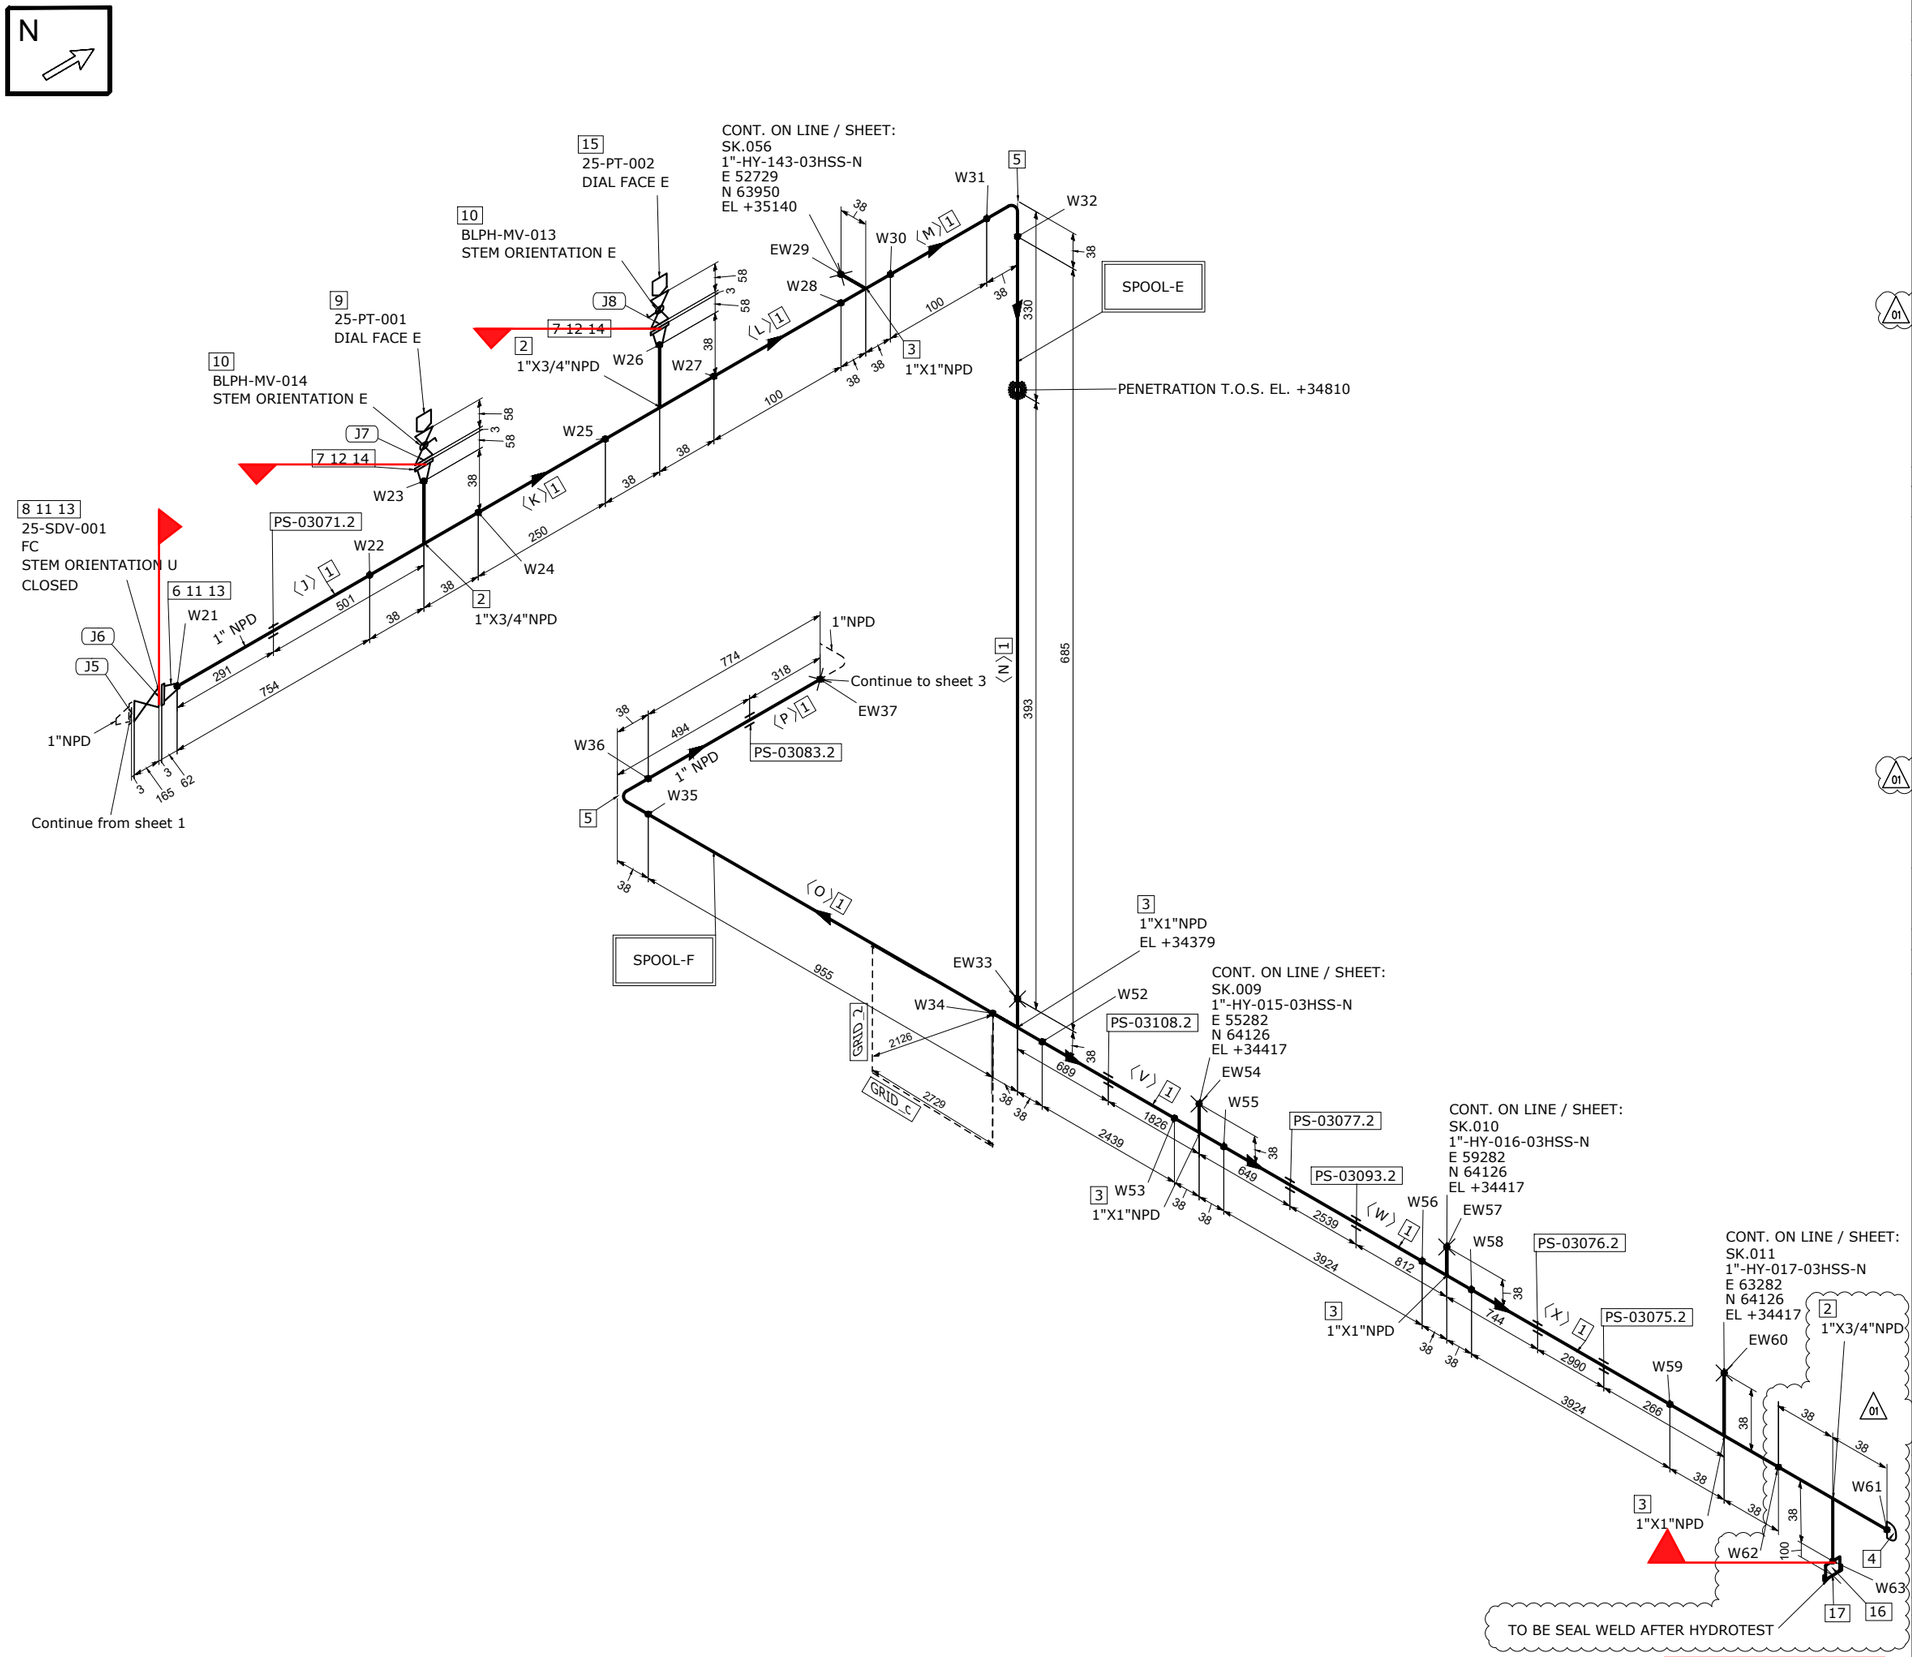

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	13.9M	35.3
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	3	1.0
3	1X1	TEE0SS00550100	Tee ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	5	1.7
4	1	CAP0SS01030100	Cap ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
5	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	2	0.3
6	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8
7	3/4	FLW0SS01033Q00	Flange WN ASME B16.5 300LB RF 2,87 FRG ASTM A182 Gr.F316/316L	2	2.8
01 16	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1/2		Pressure Transmitter - Online	1	0.0
10	3/4X1/2	VLBMNN00013Q0H	Monoflange Double Block & Bleed Valve API 6D FLG x THRD-F NPT 300LB RF MD03C02YH	2	11.6
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	2	0.1
12	3/4	GSW0GK11203Q00	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	2	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	8	1.8
14	5/8	SB20BO07540300	75 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	8	1.8
15	1/2		Pressure Transmitter - Online	1	0.0
01 17	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2

FABRICATION WEIGHT [kg]	43.2
ERECTION WEIGHT [kg]	56.6
OVERALL WEIGHT [kg]	99.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W21	1	BW
W22	1	BW
W23	3/4	BW
W24	1	BW
W25	1	BW
W26	3/4	BW
W27	1	BW
W28	1	BW
EW29	1	BW
W30	1	BW
W31	1	BW
W32	1	BW
EW33	1	BW
W34	1	BW
W35	1	BW
W36	1	BW
EW37	1	BW
W52	1	BW
W53	1	BW
EW54	1	BW
W55	1	BW
W56	1	BW
EW57	1	BW
W58	1	BW
W59	1	BW
EW60	1	BW
W61	1	BW
W62	1	BW
W63	3/4	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
J	1	754	BEVEL	BEVEL
K	1	250	BEVEL	BEVEL
L	1	100	BEVEL	BEVEL
M	1	100	BEVEL	BEVEL
N	1	685	BEVEL	BEVEL
O	1	956	BEVEL	BEVEL
P	1	774	BEVEL	BEVEL
V	1	2439	BEVEL	BEVEL
W	1	3924	BEVEL	BEVEL
X	1	3924	BEVEL	BEVEL

SUPPORT LIST

PS-03071.2
PS-03083.2
PS-03108.2
PS-03077.2
PS-03093.2
PS-03076.2
PS-03075.2

SPOOL	WELD [inches]	WEIGHT [kg]
E	10.5	10.6
F	11.75	32.6
MONT	6	56.6

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	03-09-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-007-03HSS-N

SK.005

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK

SCALE: N/A

DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024

FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00005 | SHEET / OF: 2/3 | REV.: 01


LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II			
PAINTING	SYSTEM 6A	BASE RAL RAL-9002	FLUID PHASE	Gas			
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]		
HEAT TRACING	N/A		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water	

REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80011
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

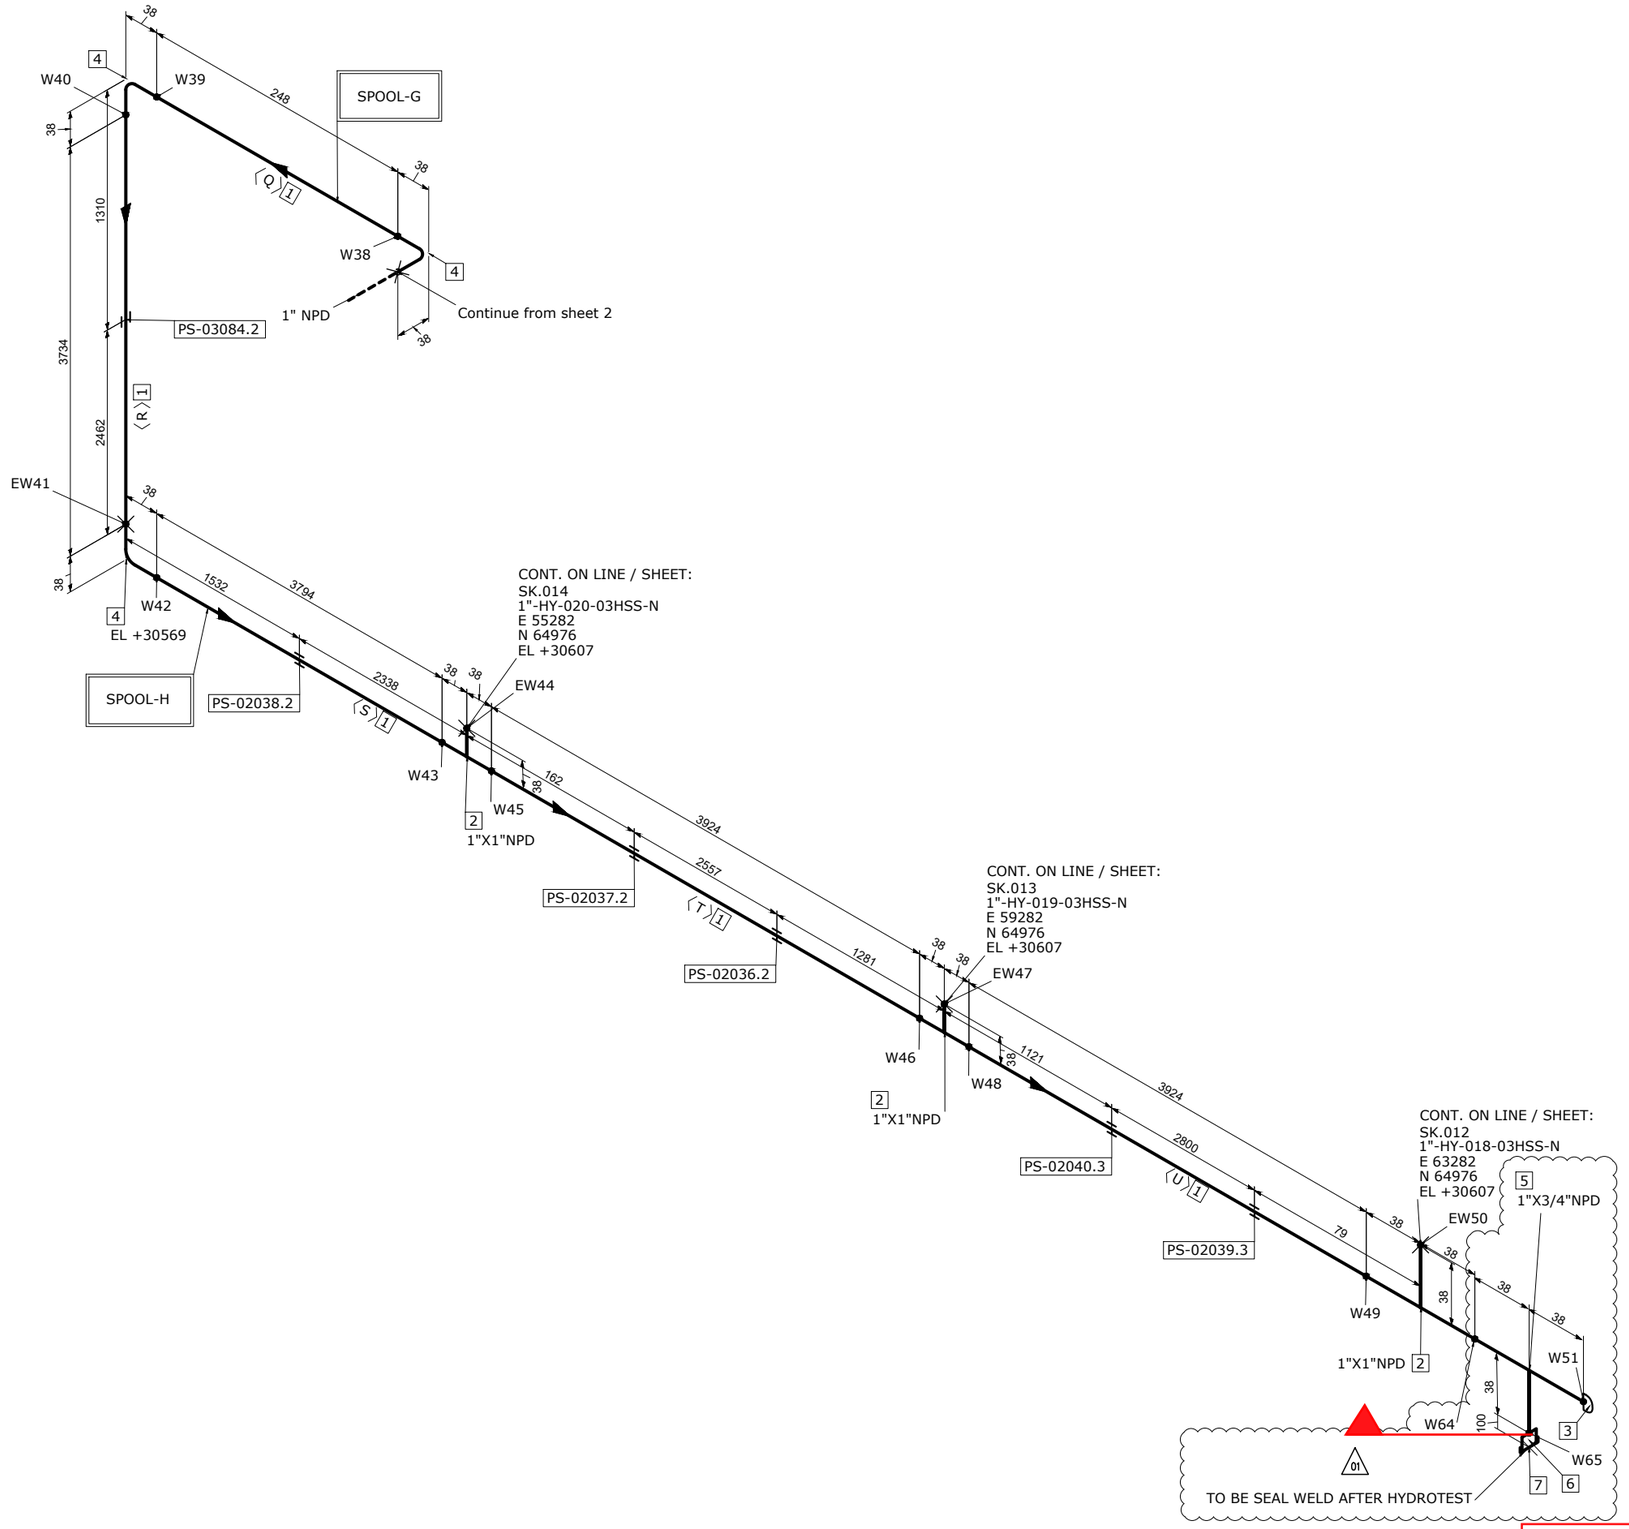

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	15.6M	39.7
2	1X1	TEE0SS00550100	Tee ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	3	1.0
3	1	CAP0SS01030100	Cap ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	3	0.4
01 5	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.4
6	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
01 7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2

FABRICATION WEIGHT [kg]		41.8
ERECTION WEIGHT [kg]	01	0.2
OVERALL WEIGHT [kg]		42.0

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W38	1	BW
W39	1	BW
W40	1	BW
EW41	1	BW
W42	1	BW
W43	1	BW
EW44	1	BW
W45	1	BW
W46	1	BW
EW47	1	BW
W48	1	BW
W49	1	BW
EW50	1	BW
W51	1	BW
01 W64	1	BW
W65	3/4	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
Q	1	248	BEVEL	BEVEL
R	1	3734	BEVEL	BEVEL
S	1	3794	BEVEL	BEVEL
T	1	3924	BEVEL	BEVEL
U	1	3924	BEVEL	BEVEL

SUPPORT LIST

PS-03084.2
PS-02038.2
PS-02037.2
PS-02036.2
PS-02040.3
PS-02039.3

SPOOL	WELD [inches]	WEIGHT [kg]
G	3	10.4
H	8.75	31.4
01		
MONT	4	0.2

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	03-09-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-007-03HSS-N

SK.005

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A
DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024
FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00005 | SHEET / OF: 3/3 | REV.: 01

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II			
PAINTING	SYSTEM 6A	BASE RAL RAL-9002	FLUID PHASE	Gas			
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]		
HEAT TRACING	N/A		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water	


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80011
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029


NOTES

25-07-TP-007

MASTER

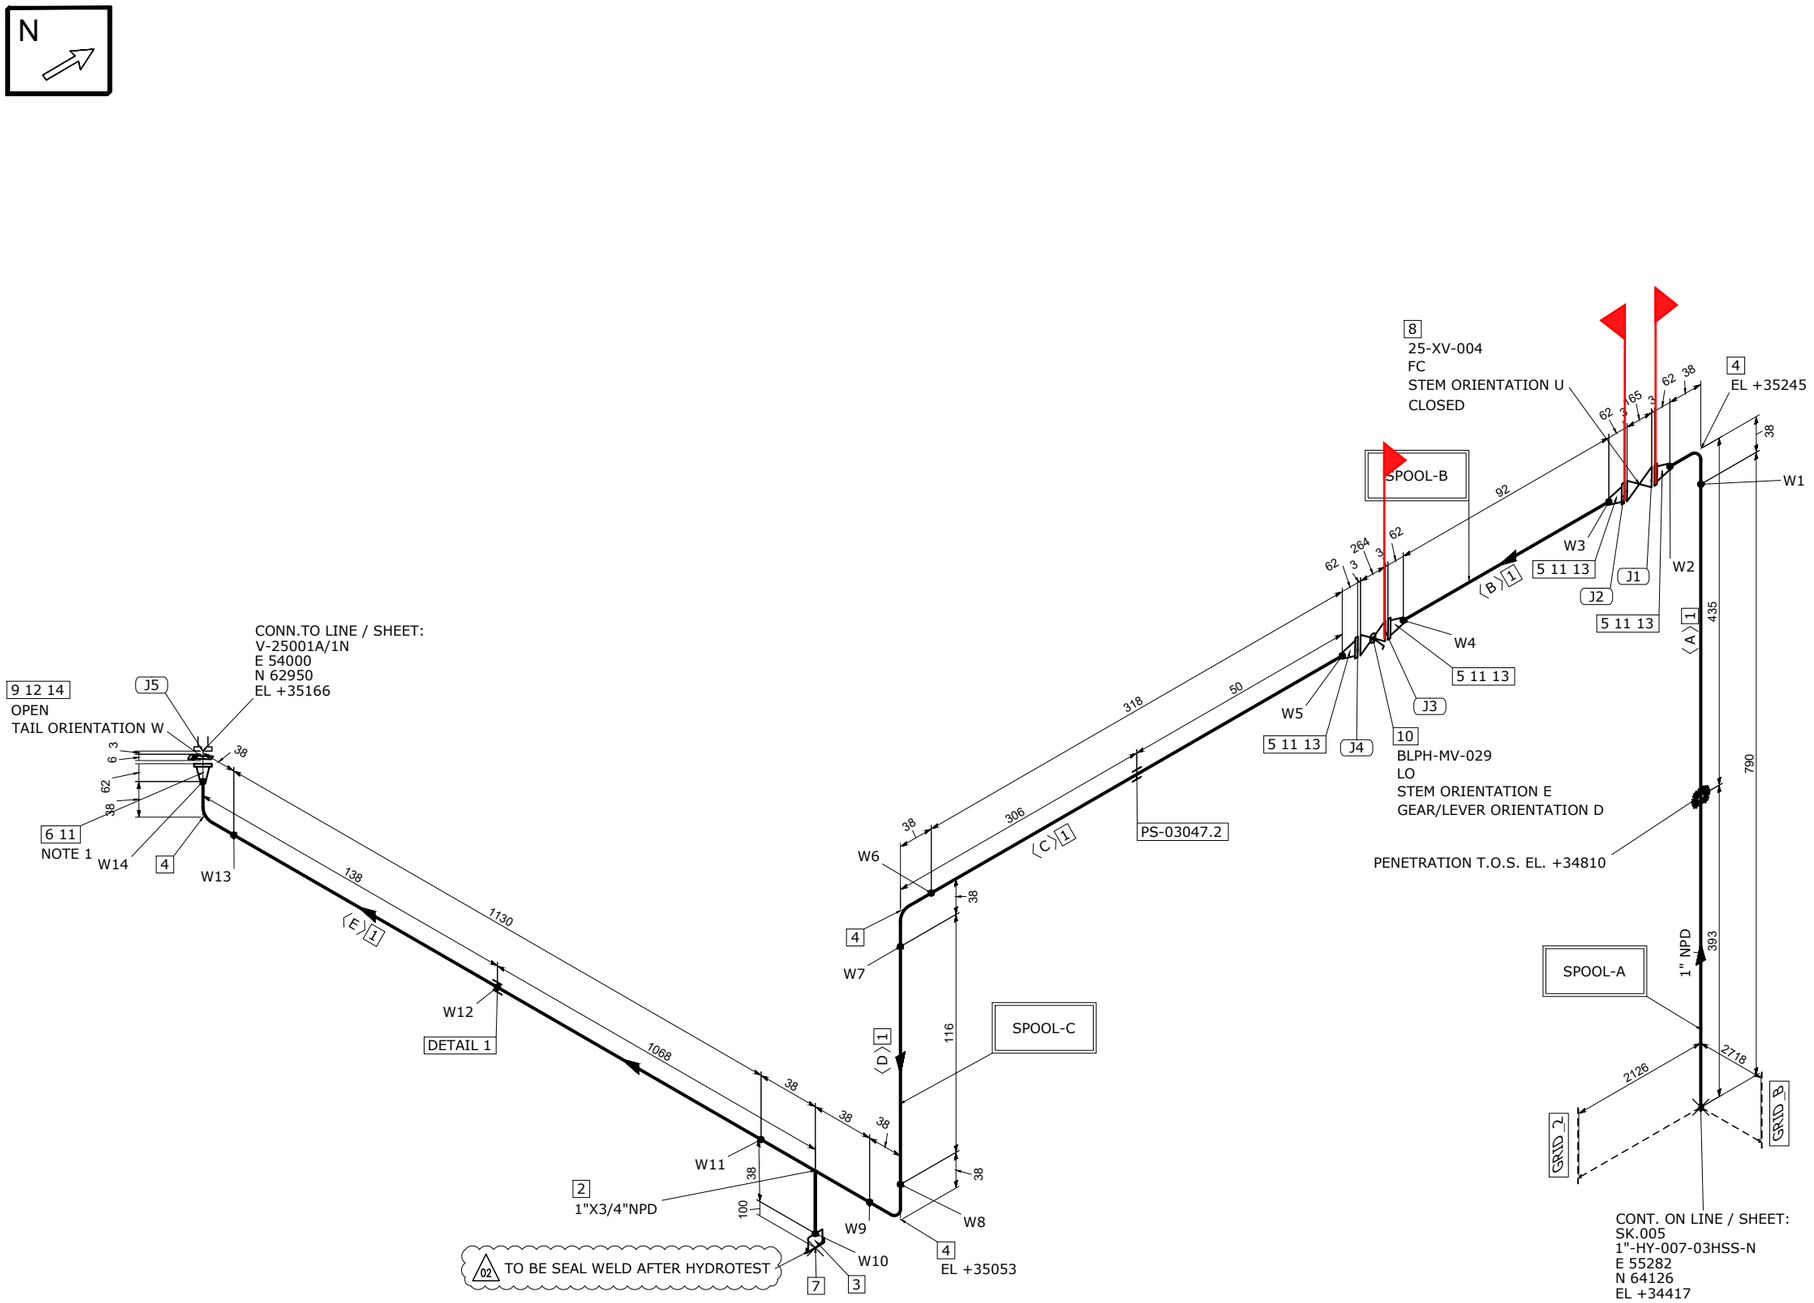

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.4M	6.2
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.4
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.2

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	3/4	BW
W11	1	BW
W12		FW
W13	1	BW
W14	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	790	BEVEL	BEVEL
B	1	92	BEVEL	BEVEL
C	1	318	BEVEL	BEVEL
D	1	116	BEVEL	BEVEL
E	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-03047.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	2	4.0
B	2	3.9
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

25-07-TP-007

MASTER

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-015-03HSS-N


SK.009

LINE DATA									
NDT INSPECTION CATEGORY	1		PED CATEGORY	II					
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS					
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]				
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water			


REFERENCE DOCUMENTS	
P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES
1.JACKSCREWS POSITION N/S

CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE	N/A
DRAWN	STAFF SRL
CHECKED	RT
APPROVED	LM
DATE	17-09-2024
FORMAT	A3
DRAWING NO.	123A90-FDL-PP-DI-00009
SHEET / OF	1/1
REV.	02

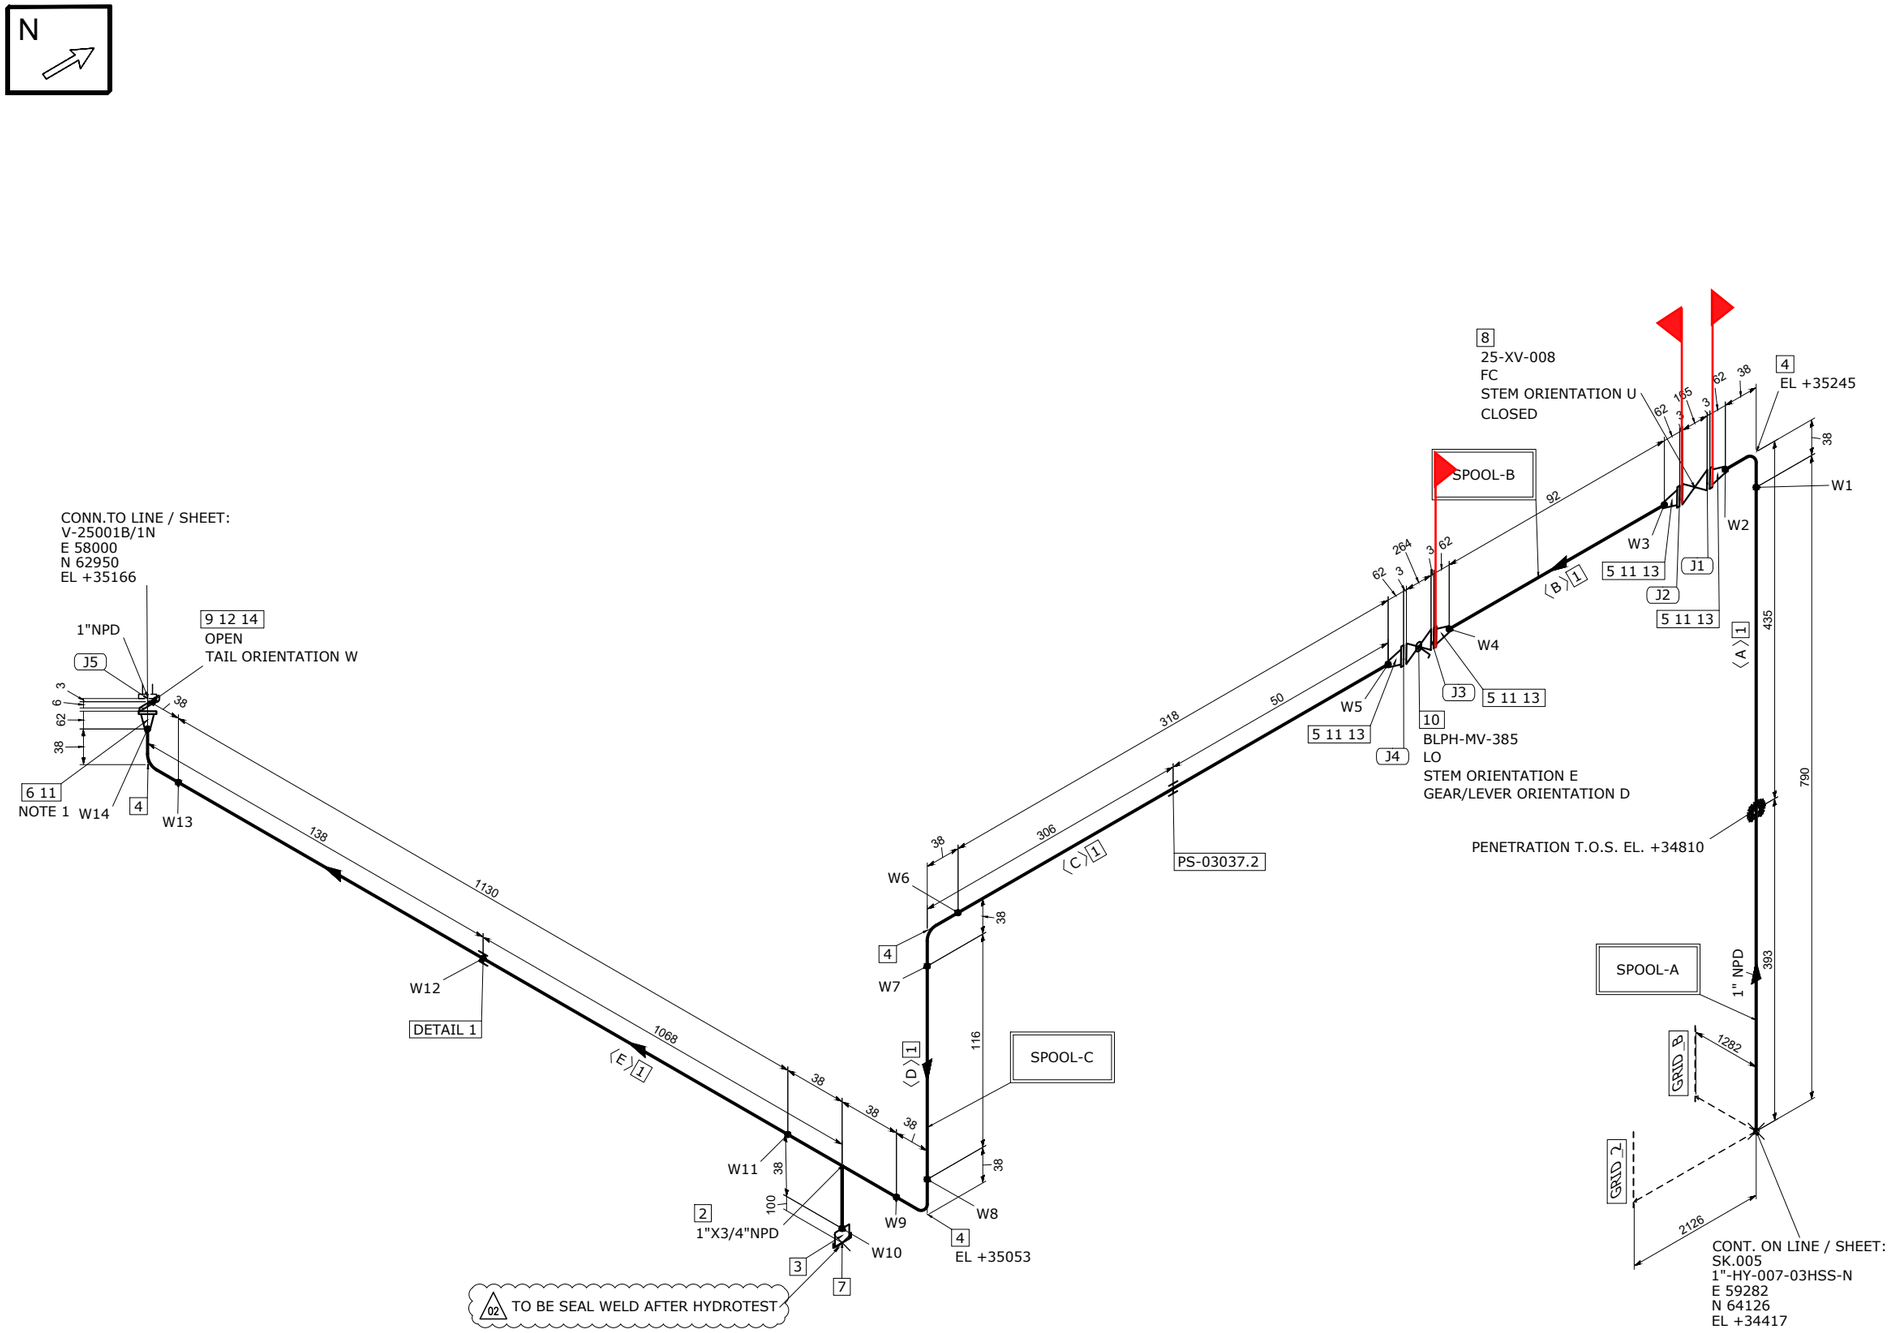

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.4M	6.2
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.4
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	3/4	BW
W11	1	BW
W12		FW
W13	1	BW
W14	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	790	BEVEL	BEVEL
B	1	92	BEVEL	BEVEL
C	1	318	BEVEL	BEVEL
D	1	116	BEVEL	BEVEL
E	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-03037.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	2	4.0
B	2	3.9
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-016-03HSS-N

SK.010

LINE DATA								
NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		


REFERENCE DOCUMENTS	
P&ID	123A90-DDL-PR-PID-80016
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES
1.JACKSCREWS POSITION N/S


25-07-TP-007

MASTER

CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE	N/A
DRAWN	STAFF SRL
CHECKED	RT
APPROVED	LM
DATE	17-09-2024
FORMAT	A3
DRAWING NO.	123A90-FDL-PP-DI-00010
SHEET / OF	1/1
REV.	02

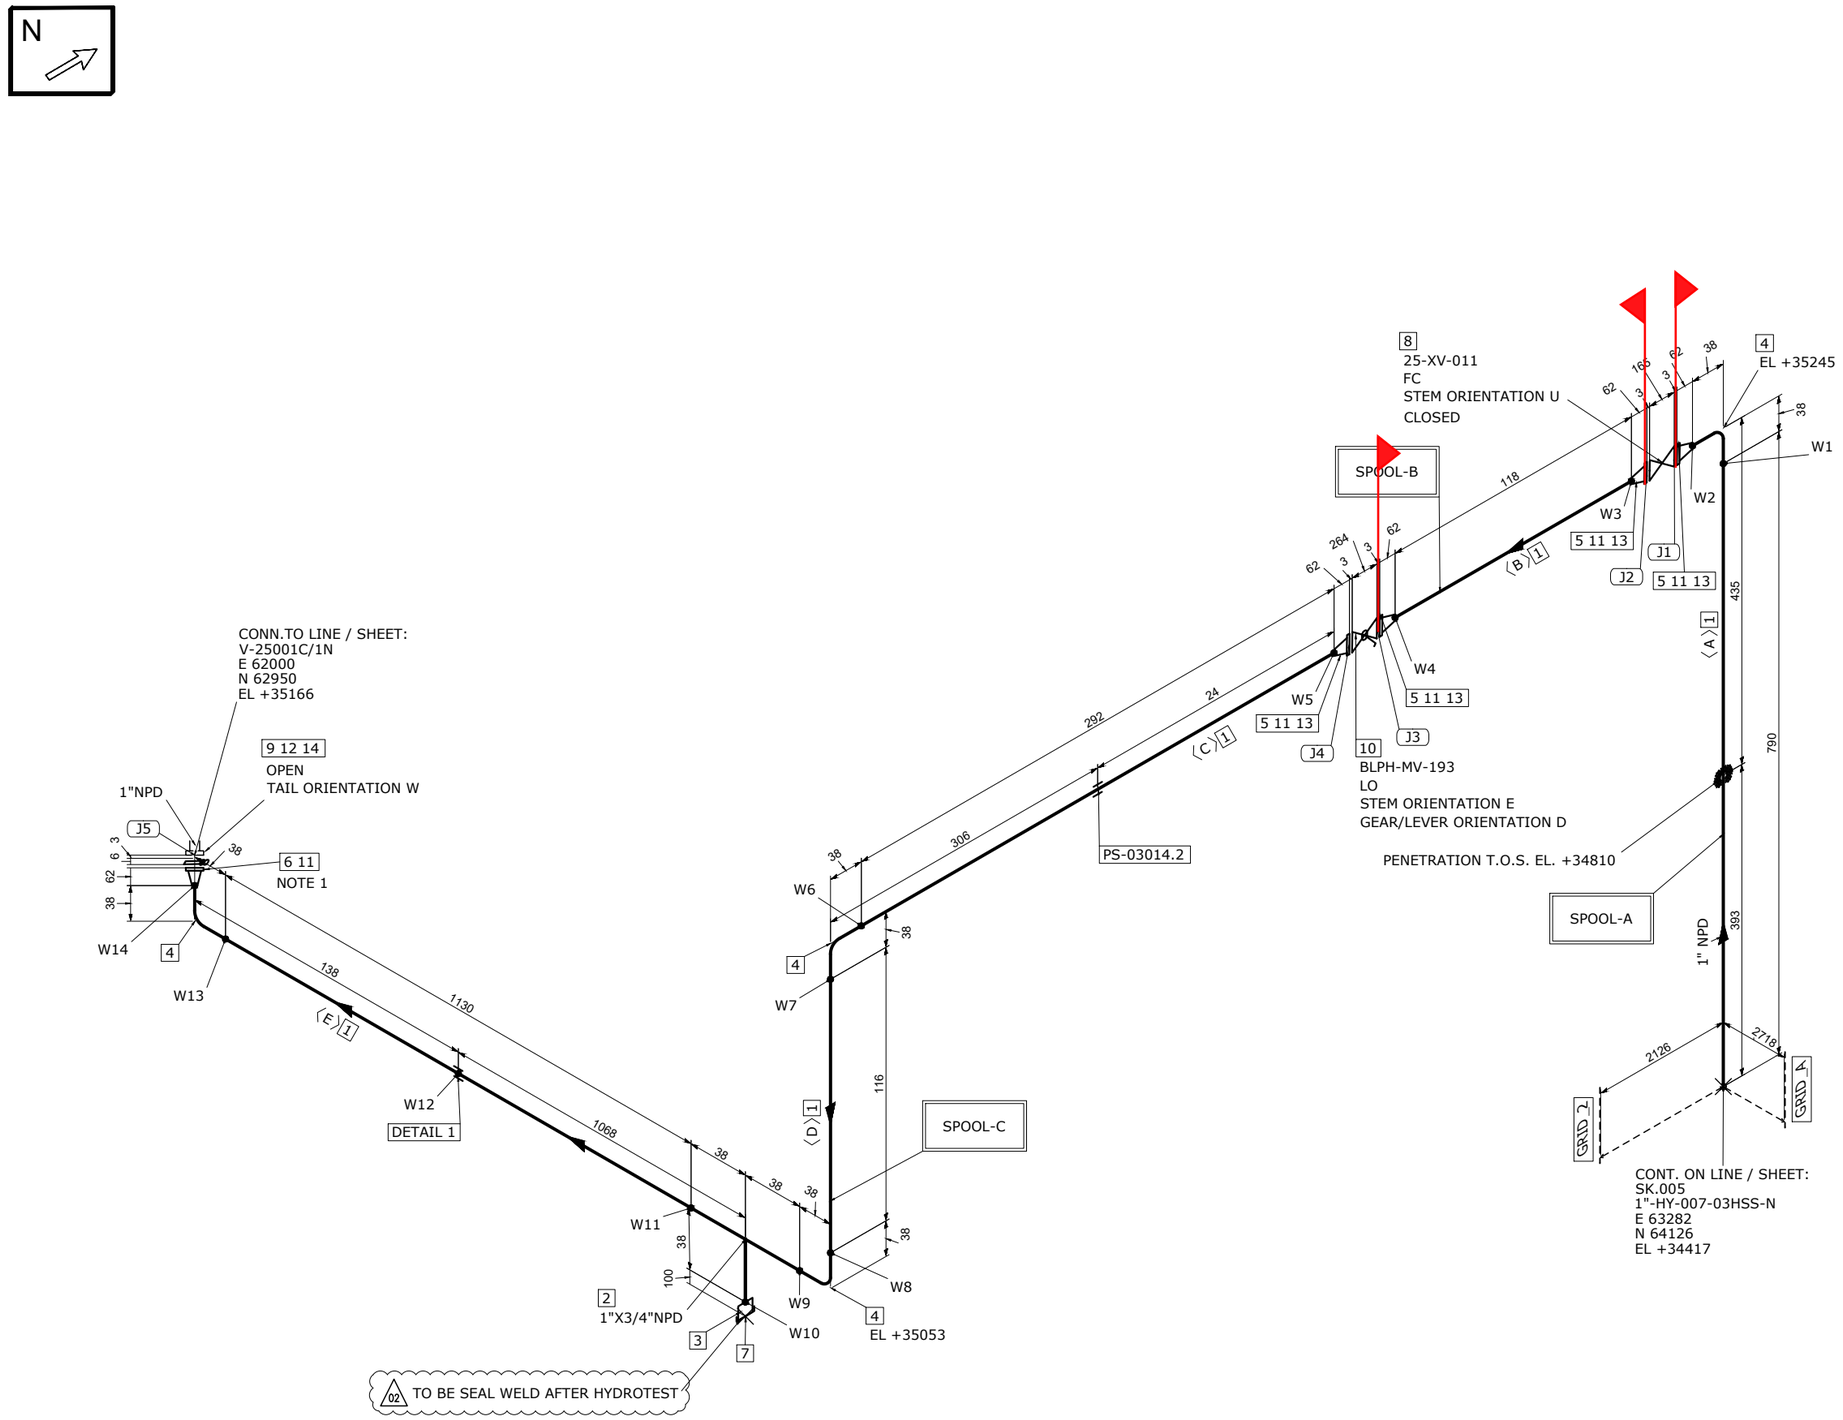

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.4M	6.2
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.4
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	3/4	BW
W11	1	BW
W12		FW
W13	1	BW
W14	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	790	BEVEL	BEVEL
B	1	118	BEVEL	BEVEL
C	1	292	BEVEL	BEVEL
D	1	116	BEVEL	BEVEL
E	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-03014.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	2	4.0
B	2	4.0
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-017-03HSS-N

SK.011

LINE DATA								
NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		

REFERENCE DOCUMENTS	
P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029


NOTES

1.JACKSCREWS POSITION N/S


25-07-TP-007

MASTER

CONTRACT NO / TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE	N/A
DRAWN	STAFF SRL
CHECKED	RT
APPROVED	LM
DATE	17-09-2024
FORMAT	A3
DRAWING NO.	123A90-FDL-PP-DI-00011
SHEET / OF	1/1
REV.	02

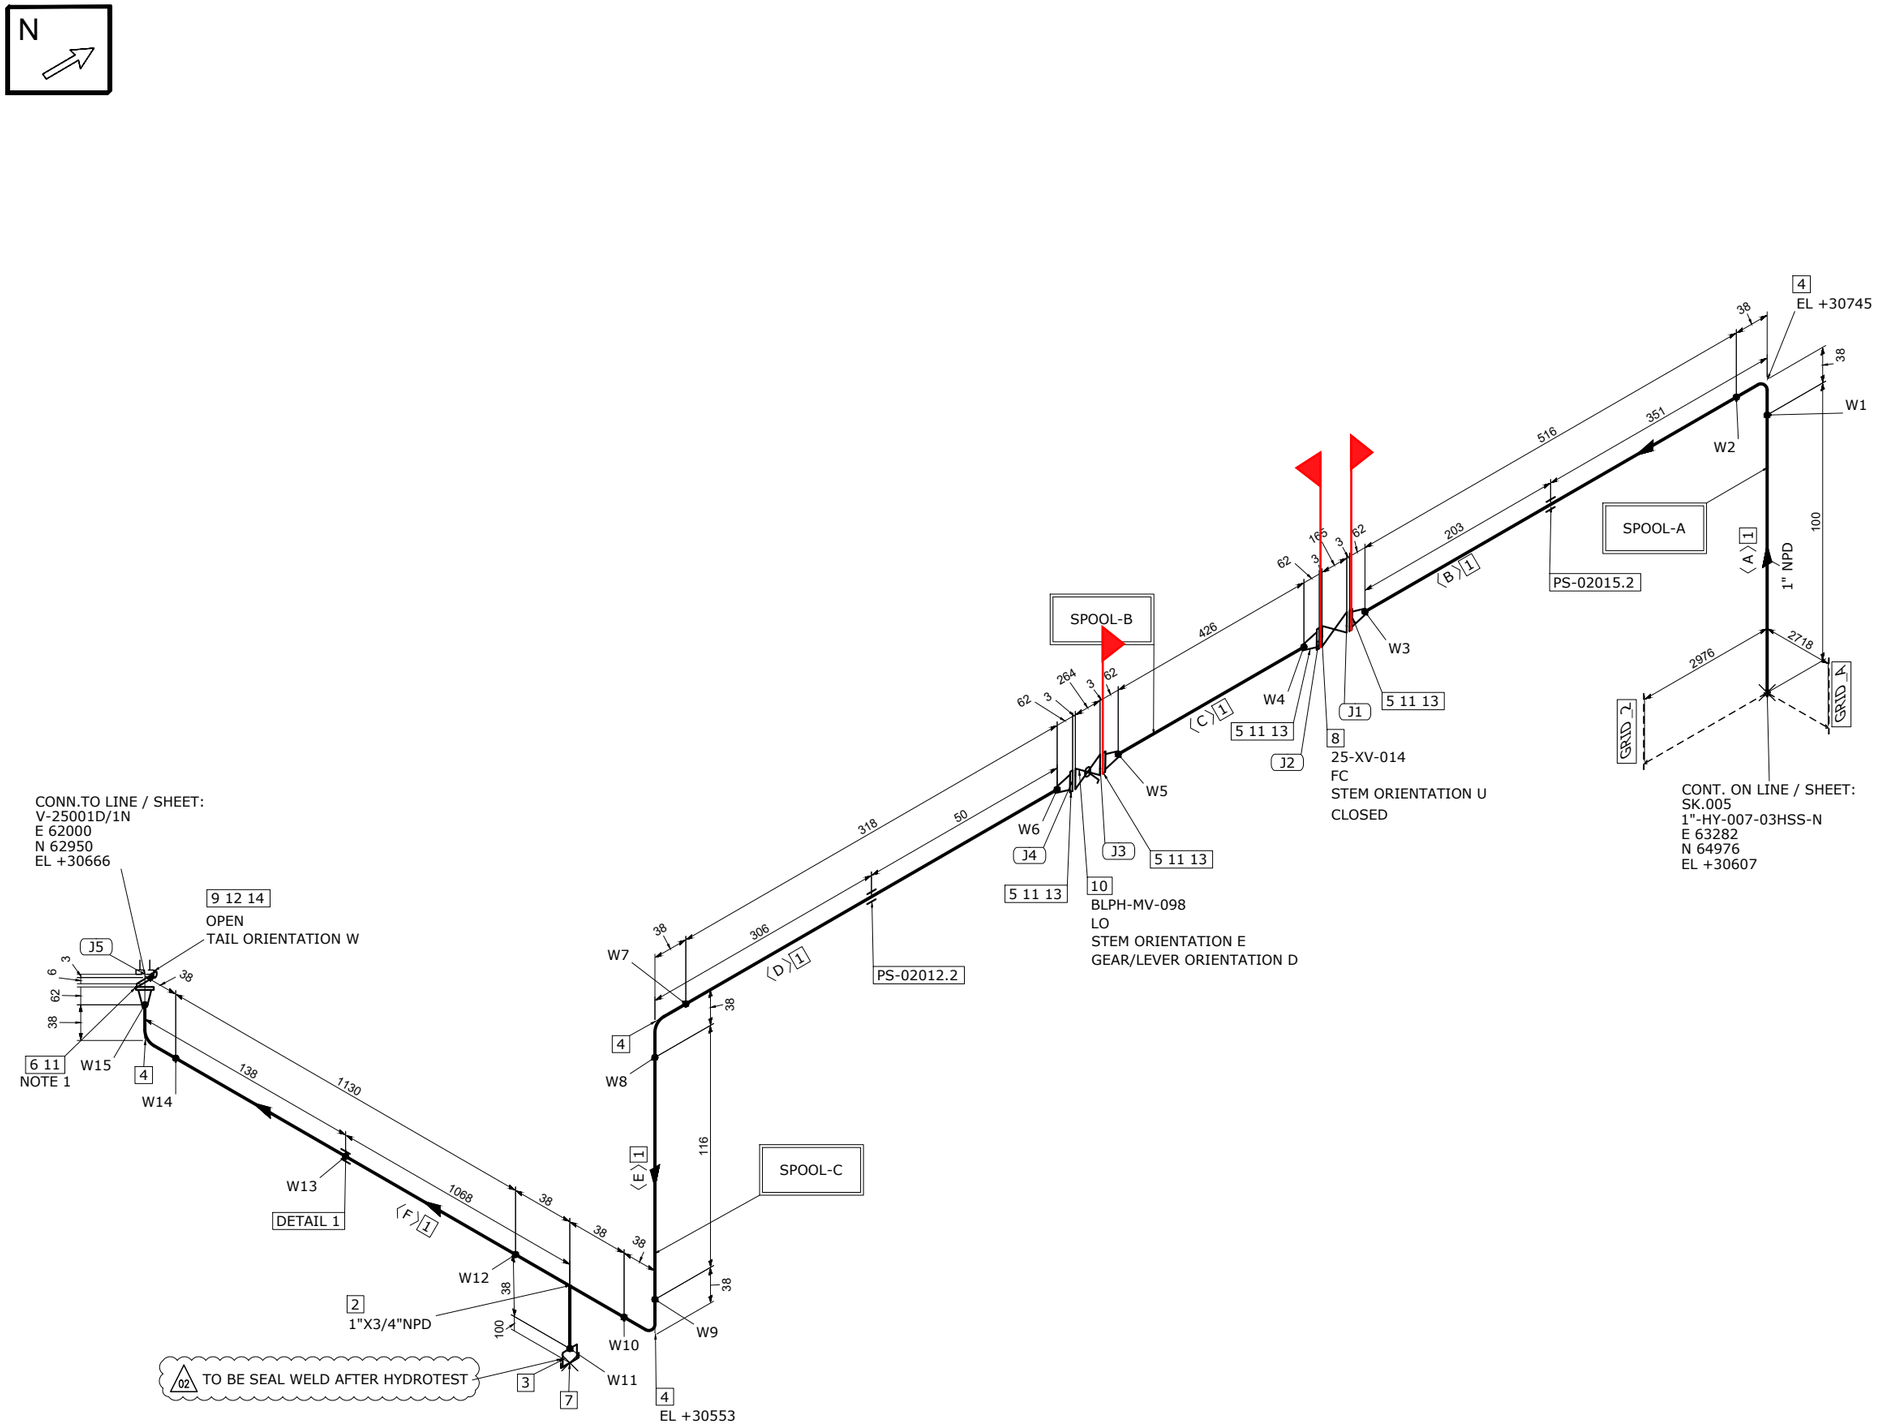

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.6M	6.6
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.8
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	3/4	BW
W12	1	BW
W13		FW
W14	1	BW
W15	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	100	BEVEL	BEVEL
B	1	516	BEVEL	BEVEL
C	1	426	BEVEL	BEVEL
D	1	318	BEVEL	BEVEL
E	1	116	BEVEL	BEVEL
F	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-02015.2
PS-02012.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	3.5
B	2	4.7
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-018-03HSS-N

SK.012

25-07-TP-007

MASTER

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II			
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS			
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]		
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water	


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80018
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029


NOTES

1.JACKSCREWS POSITION N/S

CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	N/A
DRAWN STAFF SRL	CHECKED RT	APPROVED LM	DATE 17-09-2024
FORMAT A3	DRAWING NO. 123A90-FDL-PP-DI-00012	SHEET / OF 1/1	REV. 02

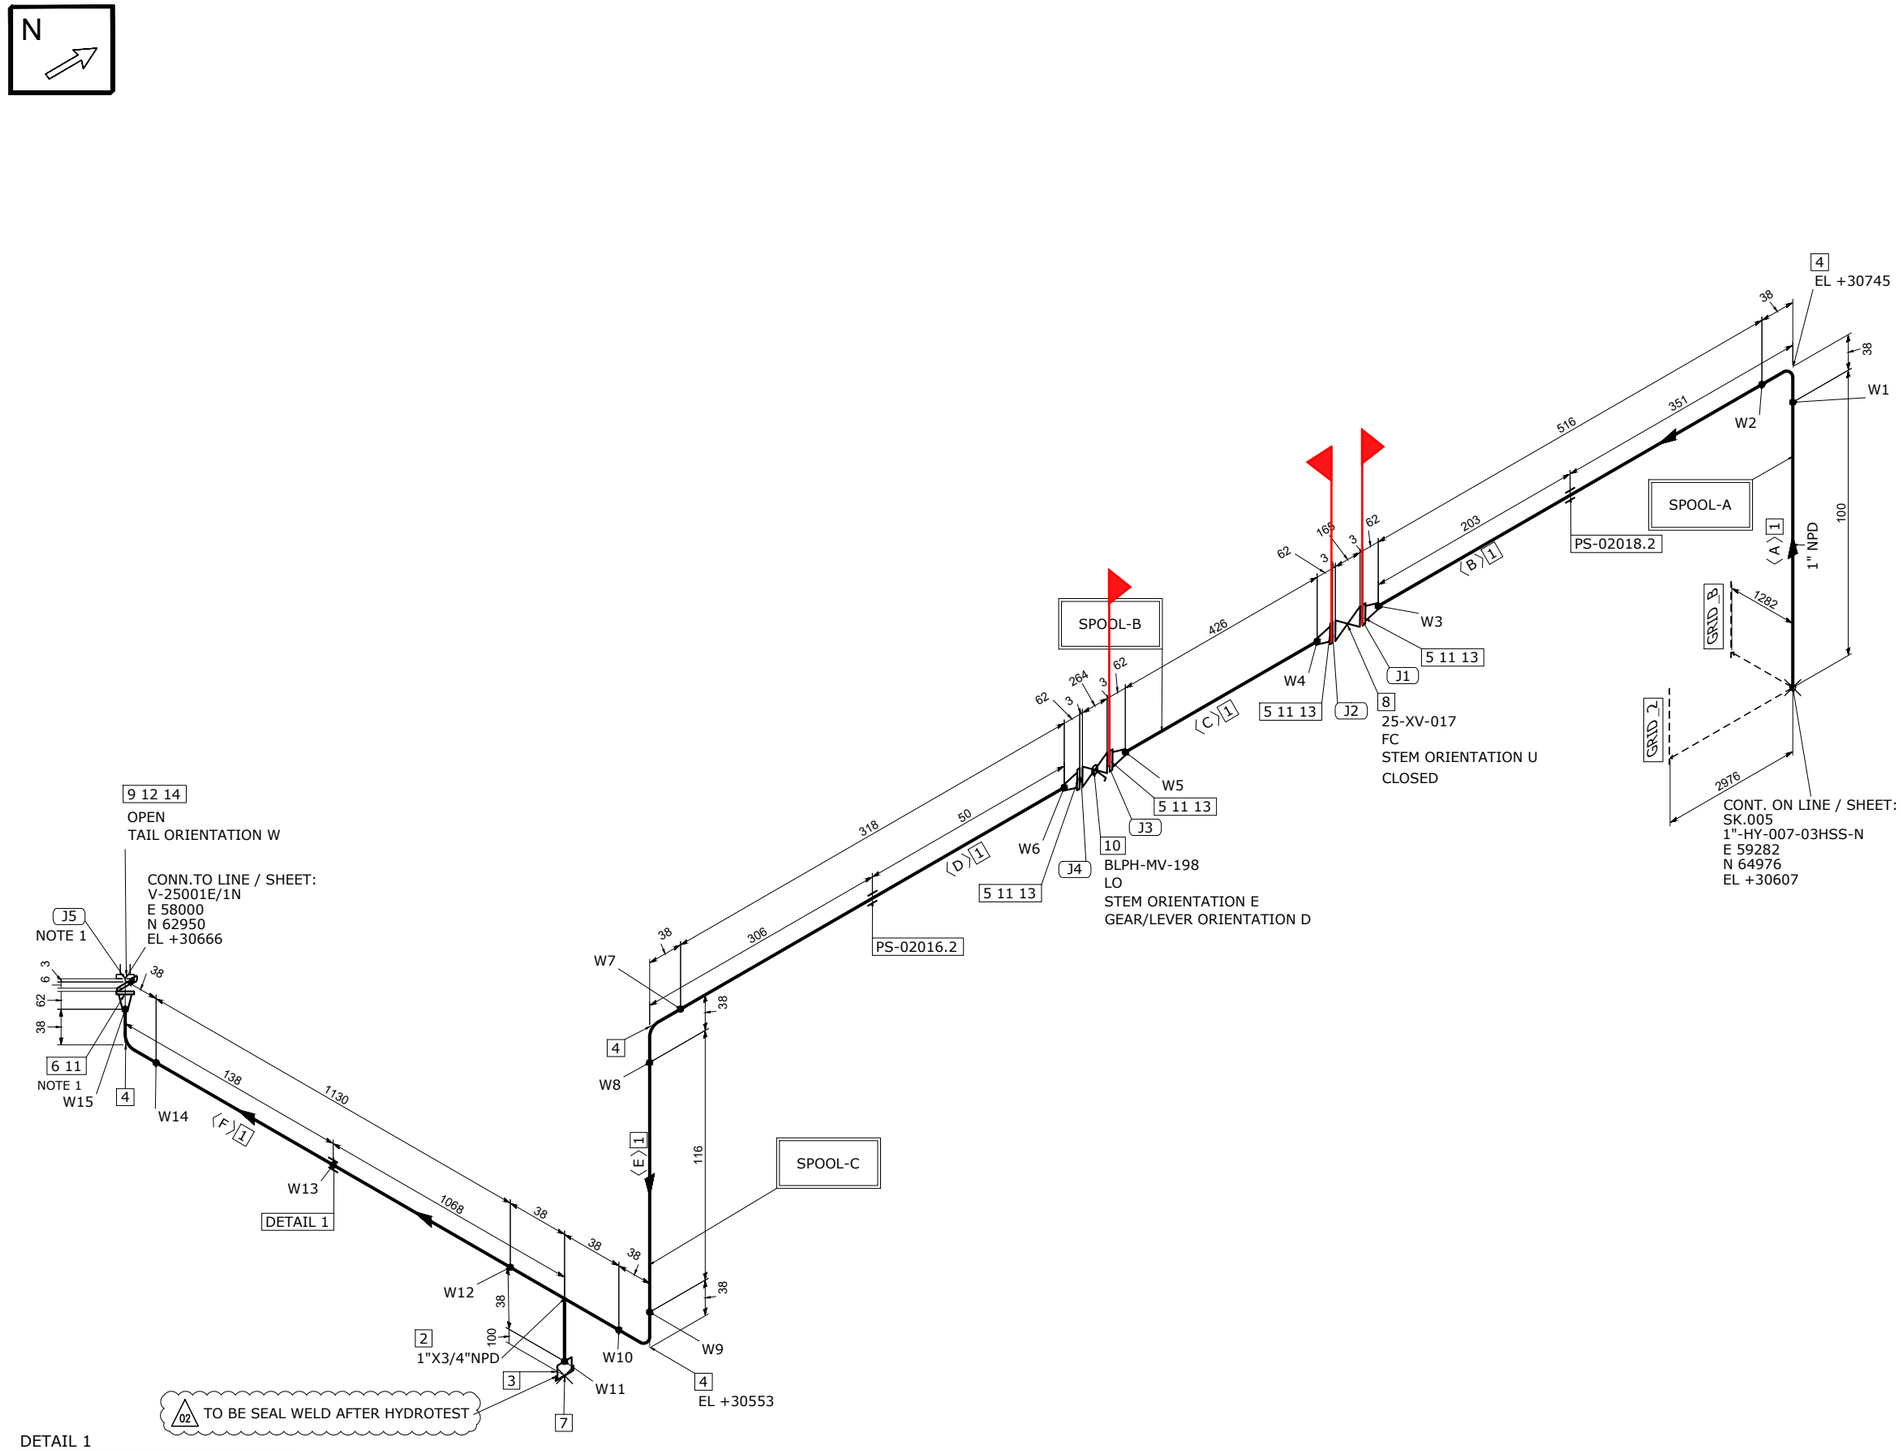

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.6M	6.6
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.8
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	3/4	BW
W12	1	BW
W13		FW
W14	1	BW
W15	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	100	BEVEL	BEVEL
B	1	516	BEVEL	BEVEL
C	1	426	BEVEL	BEVEL
D	1	318	BEVEL	BEVEL
E	1	116	BEVEL	BEVEL
F	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-02018.2
PS-02016.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	3.5
B	2	4.7
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-019-03HSS-N

SK.013

25-07-TP-007


MASTER

LINE DATA								
NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		


REFERENCE DOCUMENTS	
P&ID	123A90-DDL-PR-PID-80019
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES
1.JACKSCREWS POSITION N/S

CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	N/A
DRAWN STAFF SRL	CHECKED RT	APPROVED LM	DATE	17-09-2024
FORMAT A3	DRAWING NO. 123A90-FDL-PP-DI-00013		SHEET / OF	1/1
			REV.	02

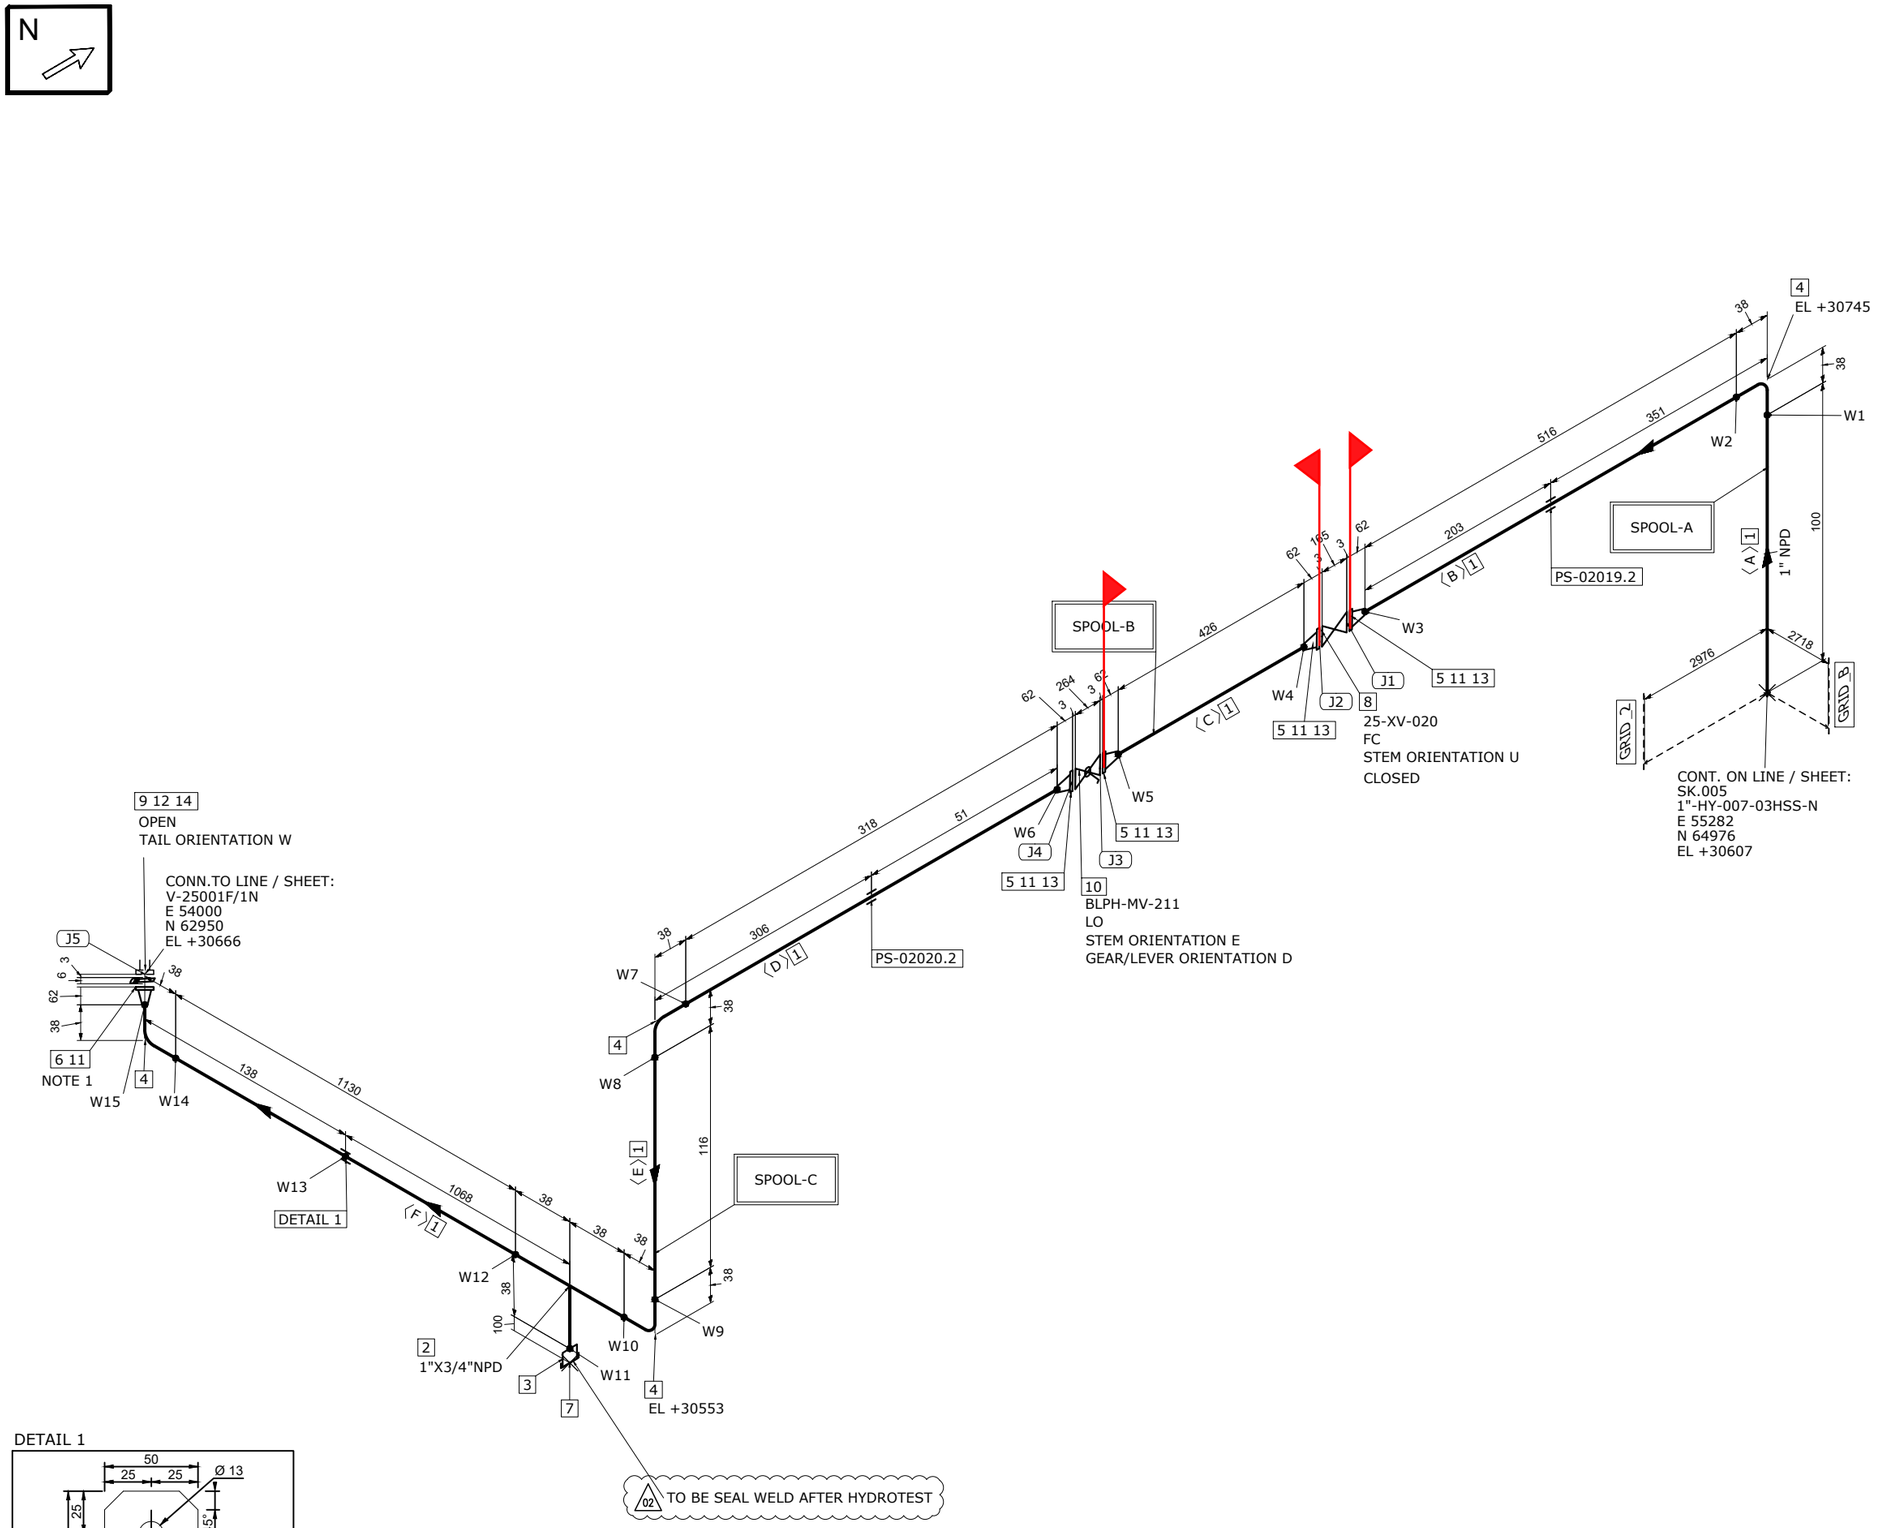

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.6M	6.6
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.8
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	3/4	BW
W12	1	BW
W13		FW
W14	1	BW
W15	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	100	BEVEL	BEVEL
B	1	516	BEVEL	BEVEL
C	1	426	BEVEL	BEVEL
D	1	318	BEVEL	BEVEL
E	1	116	BEVEL	BEVEL
F	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-02019.2
PS-02020.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	3.5
B	2	4.7
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-020-03HSS-N
SK.014

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A
DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM
DATE: 17-09-2024
FORMAT: A3
DRAWING NO.: 123A90-FDL-PP-DI-00014
SHEET / OF: 1/1
REV.: 02

25-07-TP-007

MASTER

LINE DATA


NDT INSPECTION CATEGORY	1			PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002		FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]		DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--			TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		

REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION N/S

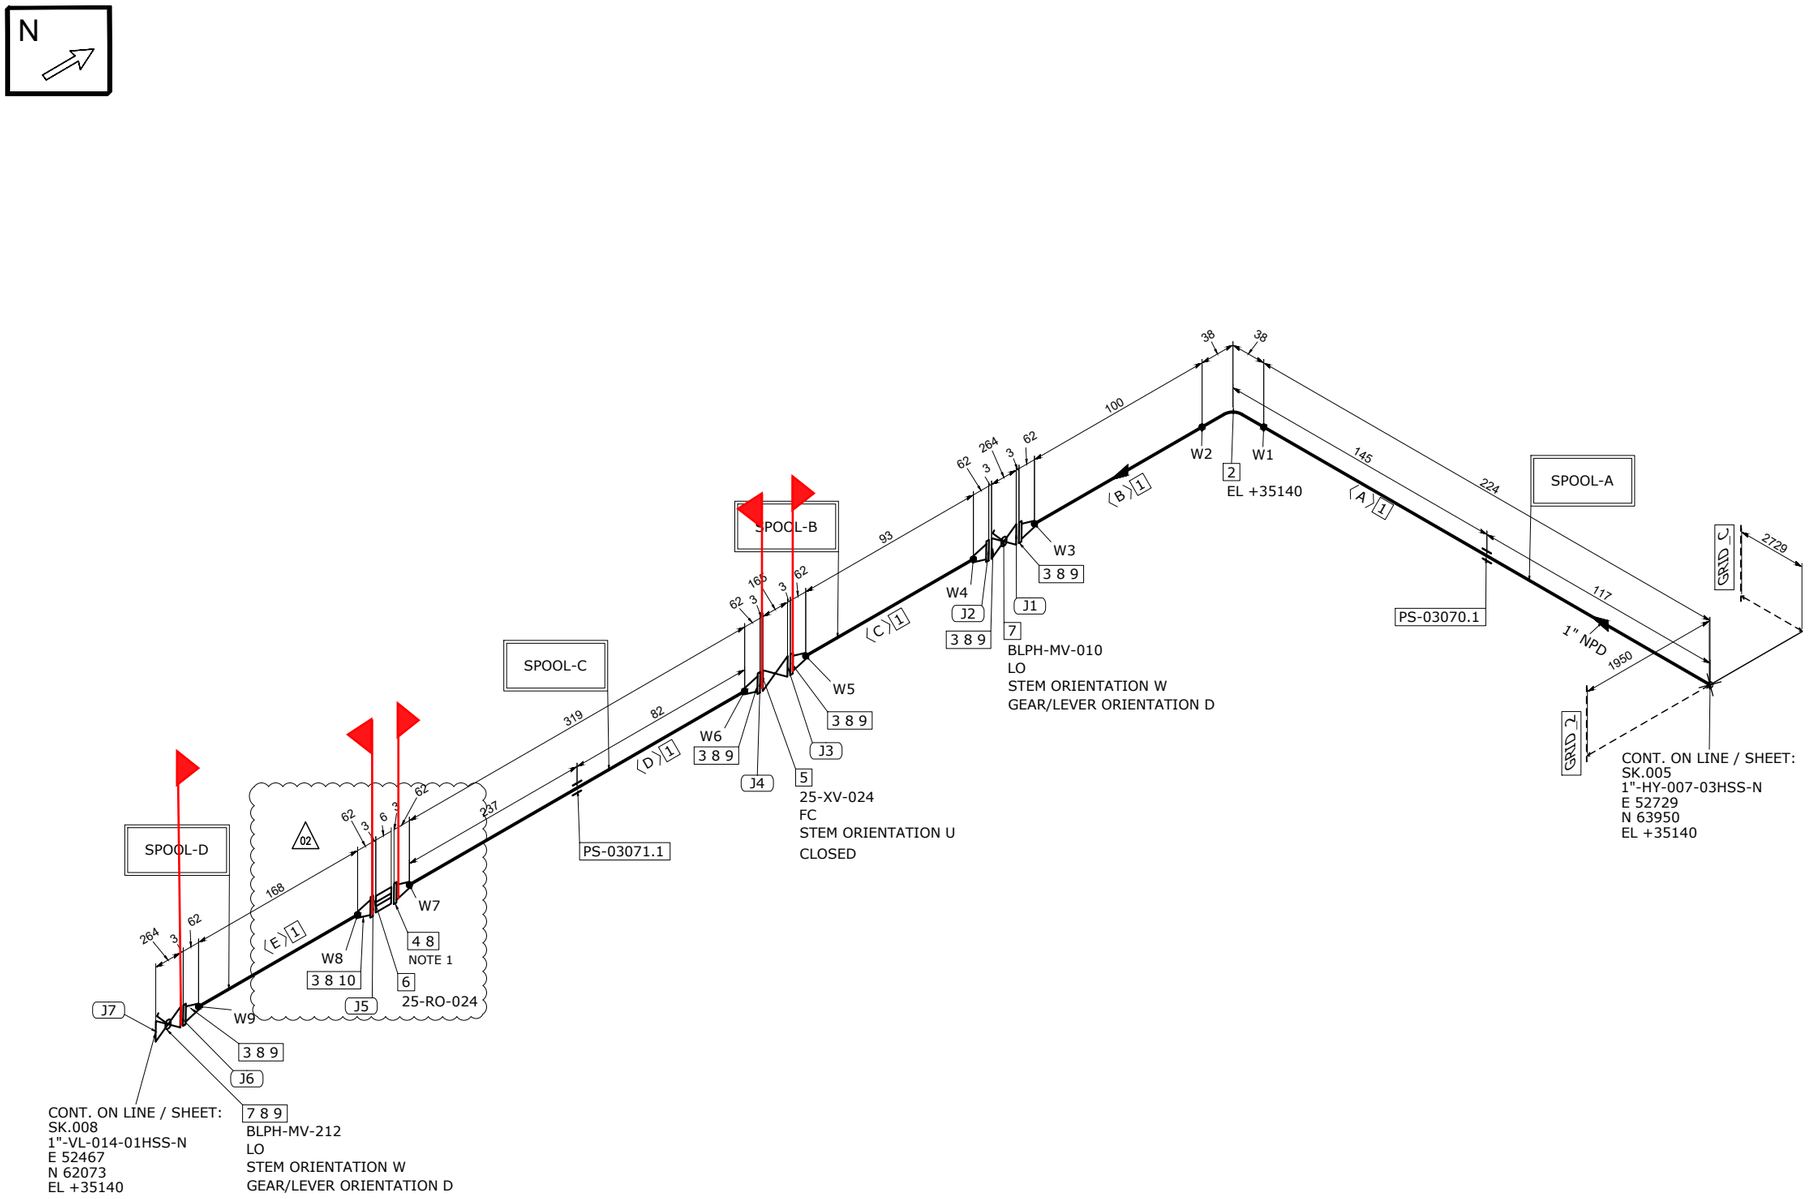

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	0.9M	2.3
2	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
3	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	6	11.0
4	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
5	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
6	1		Restriction Orifice 300#RF	1	1.0
7	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	2	27.0
8	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	8	0.6
9	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	24	5.5
10	5/8	SB20BO04190300	90 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	15.2
ERECTION WEIGHT [kg]	76.1
OVERALL WEIGHT [kg]	91.3

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	224	BEVEL	BEVEL
B	1	100	BEVEL	BEVEL
C	1	93	BEVEL	BEVEL
D	1	319	BEVEL	BEVEL
E	1	168 (02)	BEVEL	BEVEL

SUPPORT LIST

PS-03070.1
PS-03071.1

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	2.8
B	2	3.9
C	2	4.5
D	2	4.1
MONT	0	76.1

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-143-03HSS-N

SK.056

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK

SCALE: N/A

DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024

FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00056 | SHEET / OF: 1/1 | REV.: 02

25-07-TP-007

MASTER

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II			
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS			
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]		
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water	

REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029


NOTES

1.JACKSCREWS POSITION E/W


6. EXTRACT OF SUPPORT LIST & DETAILS

SUPPORT LIST


SUPPORT	SUFFIX	SERVICE	DECK IDENTIFICATION	SUB ASSEMBLY	LINE	SUPPORTS STANDARD	NDT CATEGORY	QUANTITY	TOT. WEIGTH (KG)	PAINTING SURFACE (SQM)	REV	DATE	STATUS	NOTES	Test Pack N°
PS-02015	B2	PIP	UPPER DECK		1"-HY-018-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-02018	B2	PIP	UPPER DECK		1"-HY-019-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-02019	B2	PIP	UPPER DECK		1"-HY-020-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-02036	B2	PIP	UPPER DECK		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-02037	B2	PIP	UPPER DECK		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-02038	B2	PIP	UPPER DECK		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-02039	B3	PIP	UPPER DECK		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-02040	B3	PIP	UPPER DECK		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-03070	B1	PIP	PAU		1"-HY-143-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-03071	B1	PIP	PAU		1"-HY-143-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-03074	B2	PIP	PAU		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-03075	B2	PIP	PAU		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-03076	B2	PIP	PAU		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-03077	B2	PIP	PAU		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-03083	B2	PIP	PAU		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-03084	B2	PIP	PAU		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-03093	B2	PIP	PAU		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-03108	B2	PIP	PAU		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-03126	B1				1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-03129	B1	PIP	PAU		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-03130	B1	PIP	PAU		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007
PS-03158	B1	PIP	PAU		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-007

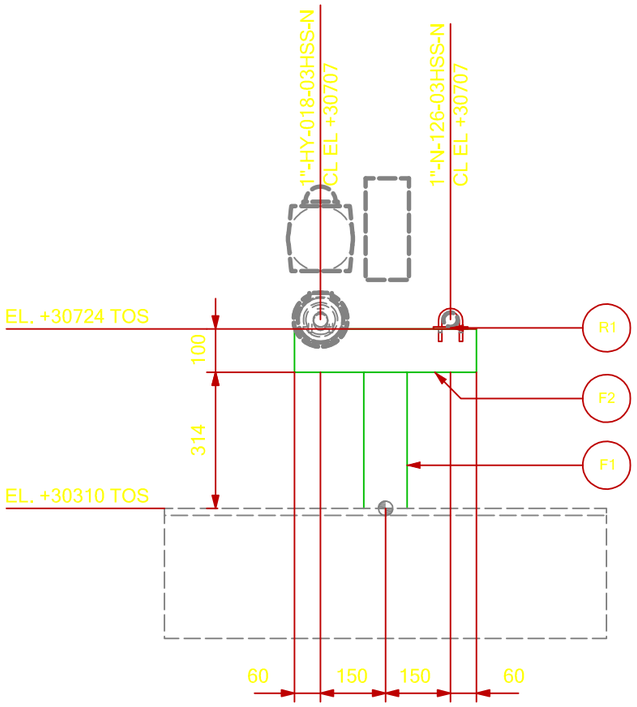


VIEW LOOKING NORTH

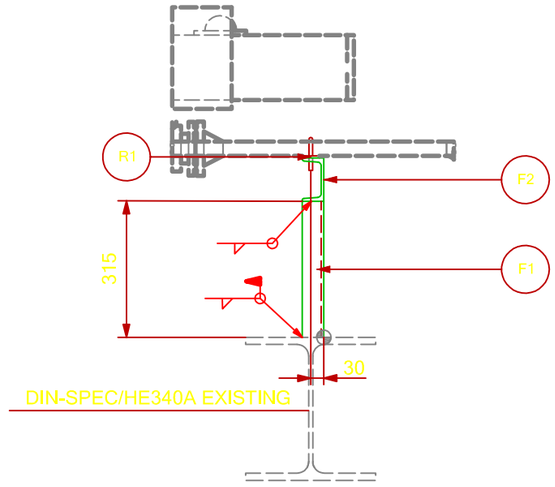

VIEW LOOKING WEST

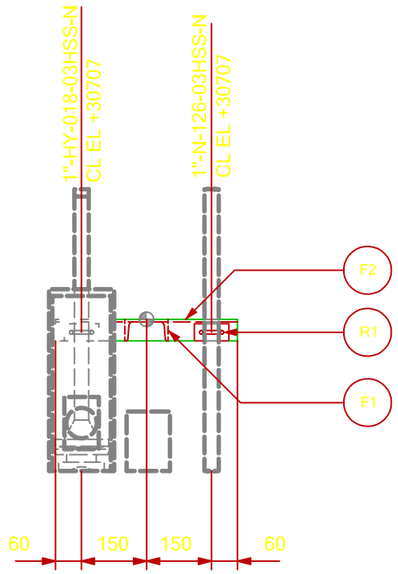


PLAN VIEW

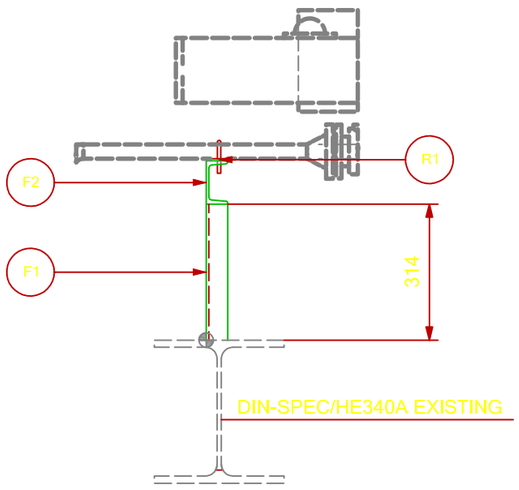


VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1"	-	-	2	-	0,29	-
F1	BEAM	UPN100	Carbon Steel	313	1	10,57	3,31	0,119
F2	BEAM	UPN100	Carbon Steel	420	1	10,57	4,44	0,159
						TOTAL	8,3	0,28

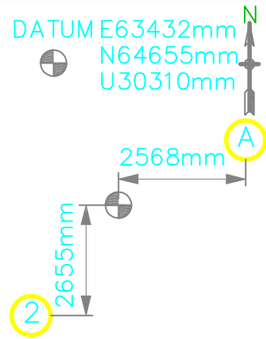

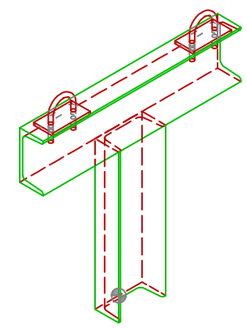

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND


ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-02015

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 10
DRAWN	CHECKED	APPROVED	DATE 19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1 / REV. 00


File Name :

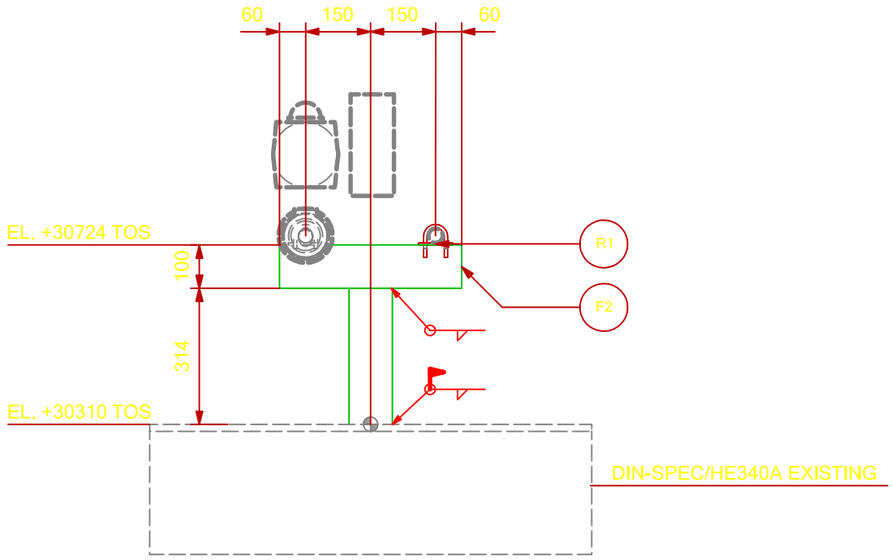


VIEW LOOKING NORTH

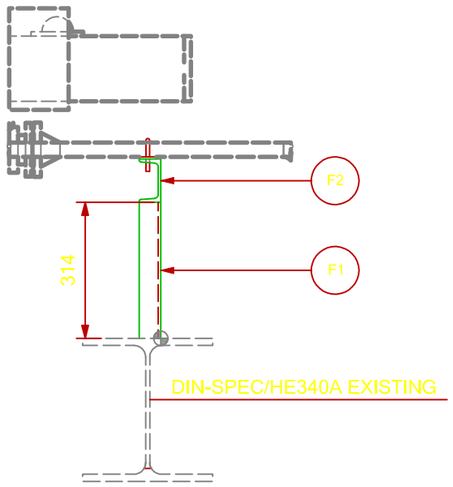

VIEW LOOKING WEST

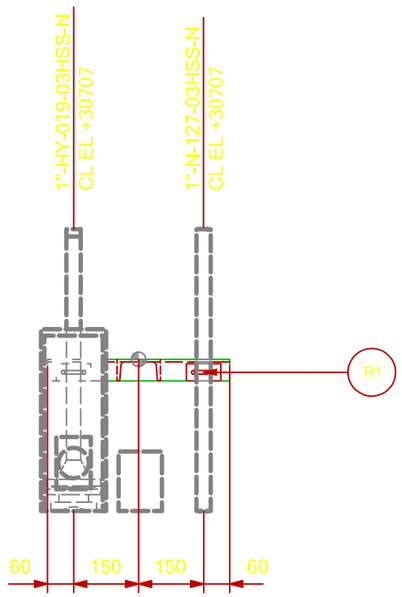


PLAN VIEW

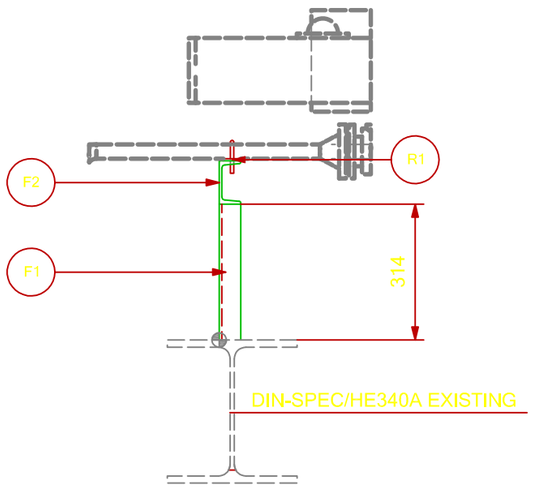


VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1"	-	-	2	-	0,29	-
F1	BEAM	UPN100	Carbon Steel	314	1	10,57	3,31	0,119
F2	BEAM	UPN100	Carbon Steel	420	1	10,57	4,44	0,159
						TOTAL	8,3	0,28

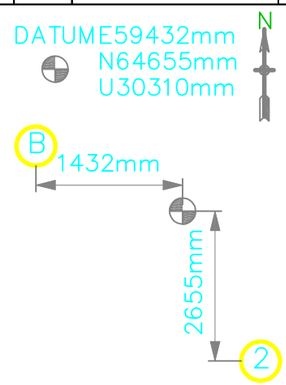

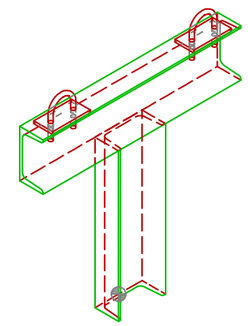

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND


ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-02018

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 10
DRAWN	CHECKED	APPROVED	DATE 19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1 / REV. 00


File Name :

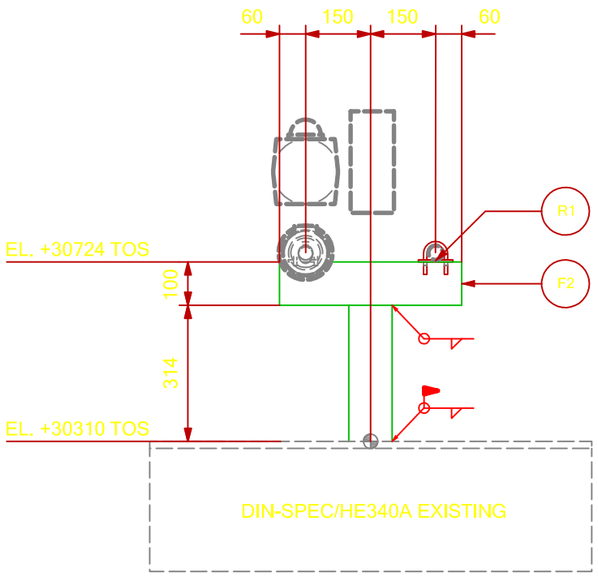


VIEW LOOKING NORTH

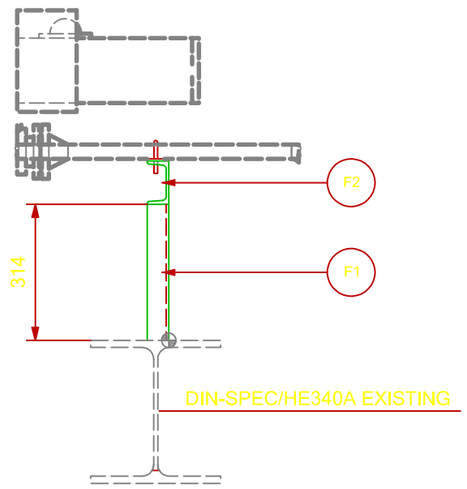

VIEW LOOKING WEST

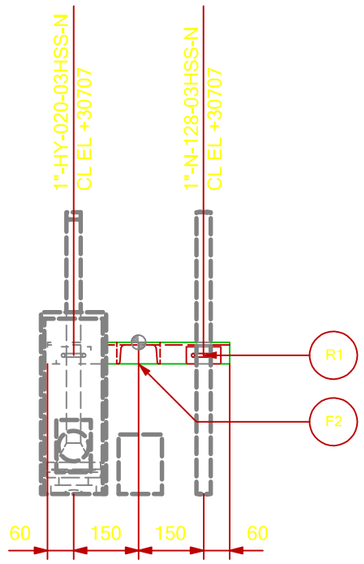


PLAN VIEW

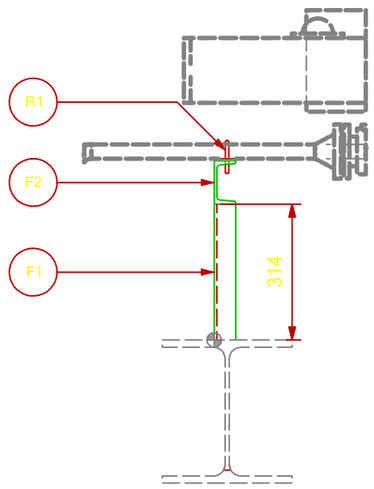


VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1"	-	-	2	-	0,29	-
F1	BEAM	UPN100	Carbon Steel	314	1	10,57	3,31	0,119
F2	BEAM	UPN100	Carbon Steel	420	1	10,57	4,44	0,159
						TOTAL	8,3	0,28

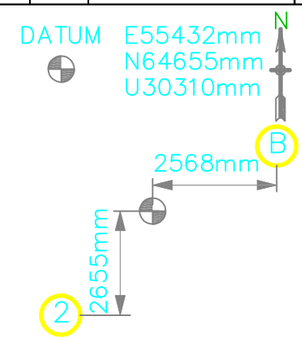

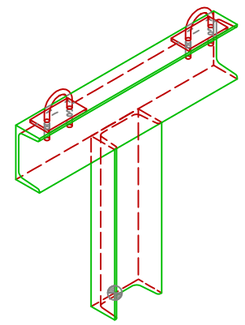

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND


ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-02019

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 10
DRAWN	CHECKED	APPROVED	DATE 19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1 / REV. 00

File Name :

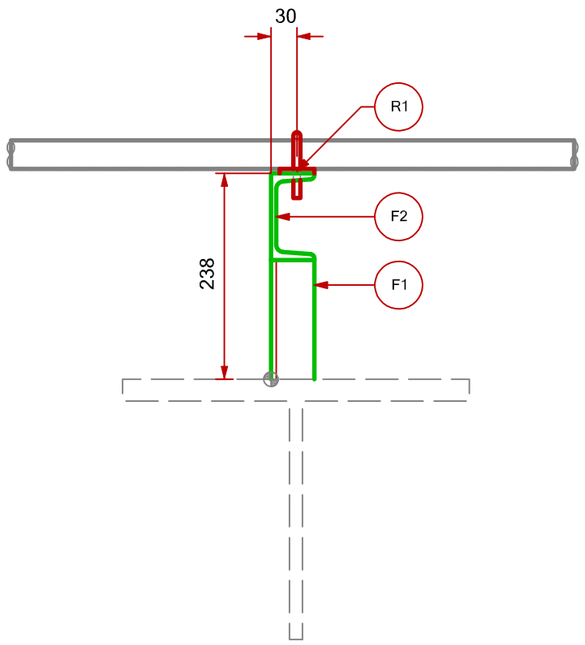


VIEW LOOKING NORTH

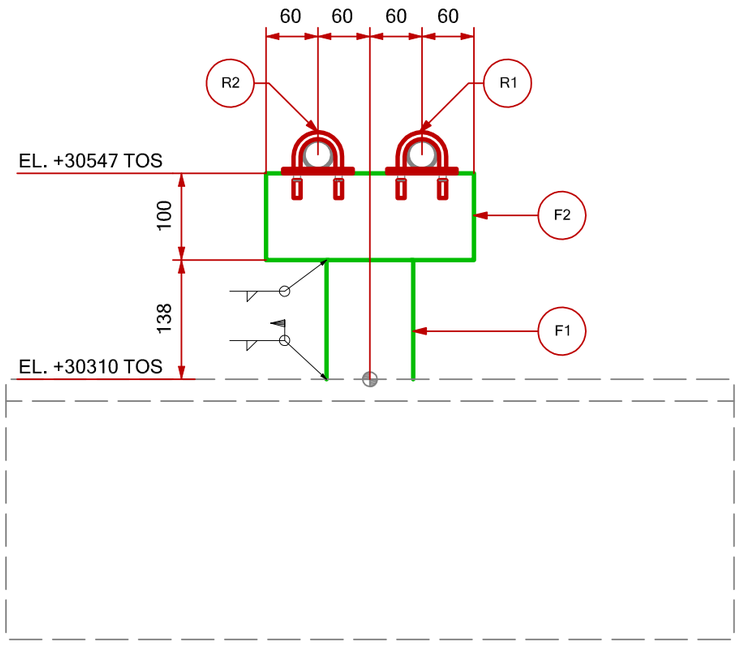



VIEW LOOKING WEST

SUPPORT MATERIAL LIST


POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1"	-	-	2	-	0.29	-
F1	BEAM	UPN100	Carbon Steel	138	1	10.57	1.45	0.054
F2	BEAM	UPN100	Carbon Steel	240	1	10.57	2.54	0.092
						TOTAL	4.6	0.15

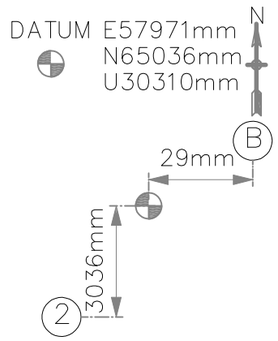

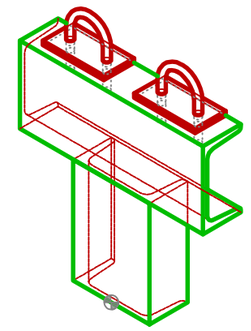

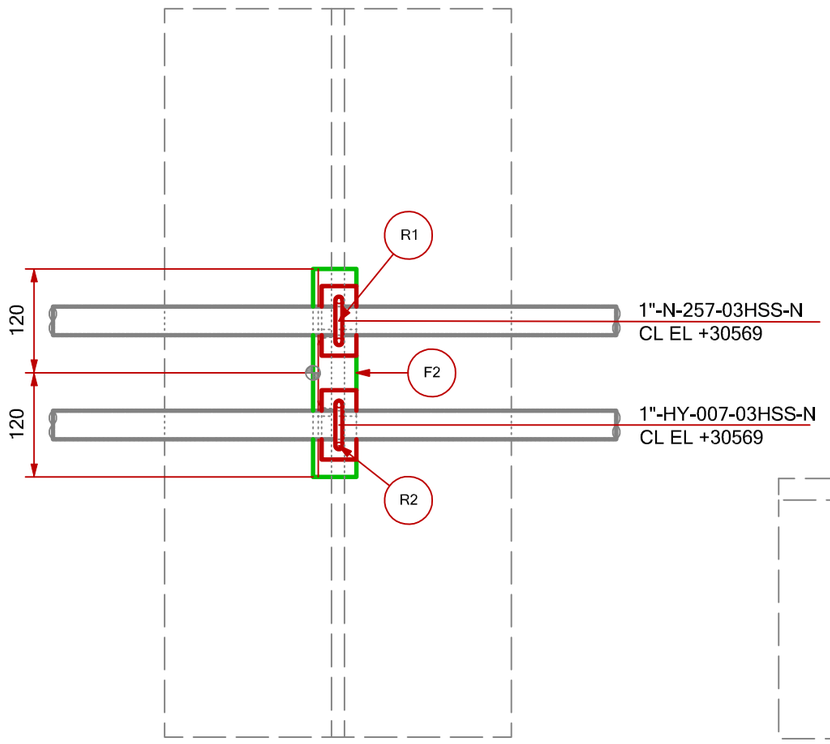

PLAN VIEW

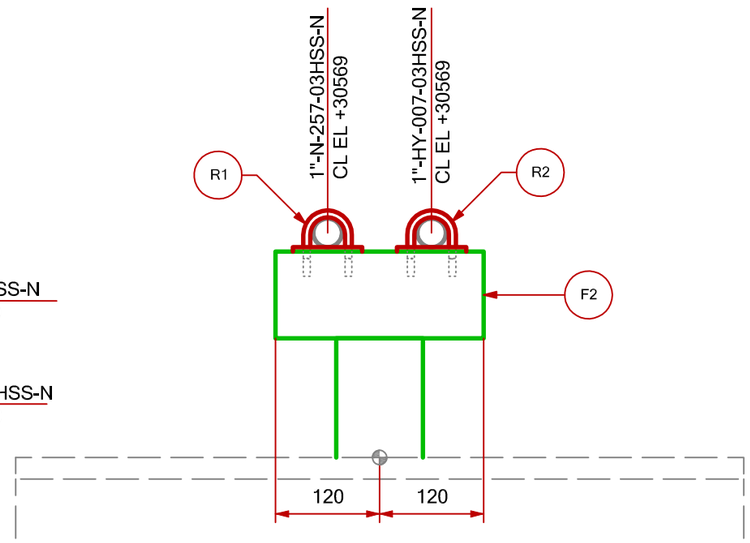

VIEW LOOKING EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND


ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-02036

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 5
DRAWN	CHECKED	APPROVED	DATE 19/08/24
	DRAWING NO. 123A90-DDL-PP-DD-72000	SHEET 1 of 1	REV. 00


File Name :

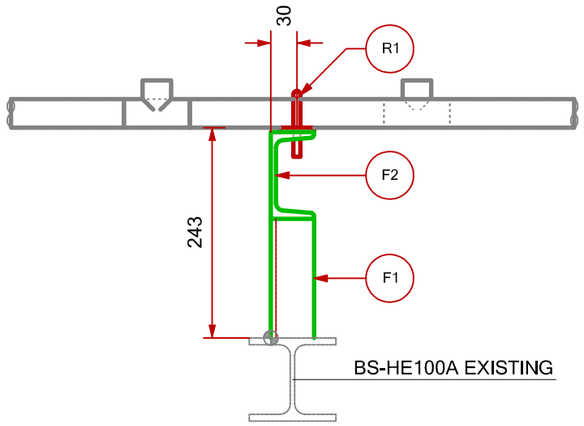


VIEW LOOKING NORTH

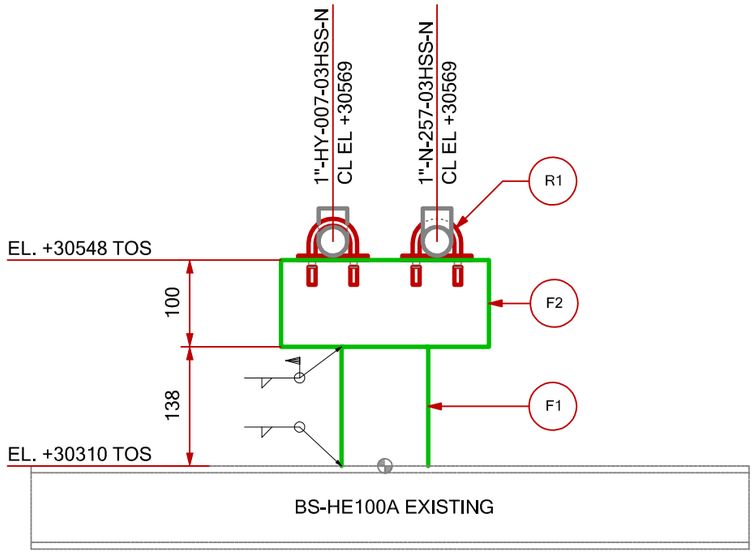

VIEW LOOKING WEST

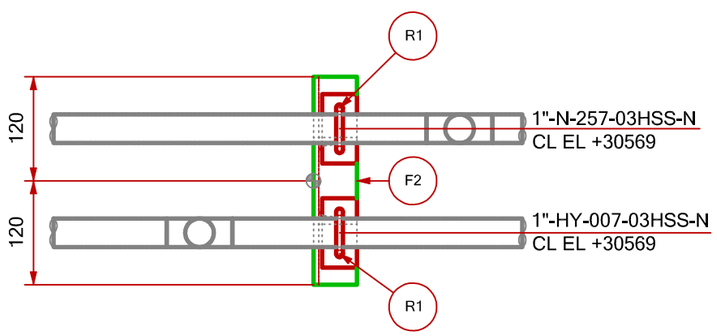


PLAN VIEW

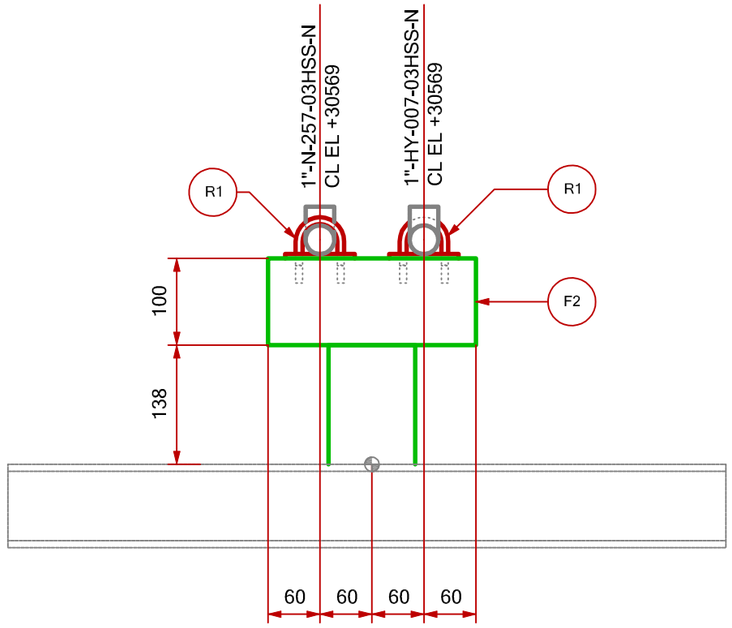


VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1"	-	-	2	-	0.29	-
F1	BEAM	UPN100	Carbon Steel	138	1	10.57	1.45	0.054
F2	BEAM	UPN100	Carbon Steel	240	1	10.57	2.54	0.092
						TOTAL	4.6	0.15

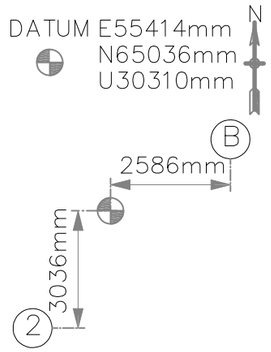

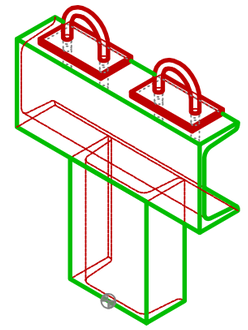

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
Support Drawings


PS-02037

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 5
DRAWN	CHECKED	APPROVED	DATE 19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1 / REV. 00


File Name :

SUPPORT MATERIAL LIST


POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1"	-	-	2	-	0.29	-
F1	BEAM	UPN100	Carbon Steel	138	1	10.57	1.45	0.054
F2	BEAM	UPN100	Carbon Steel	240	1	10.57	2.54	0.092
						TOTAL	4.6	0.15

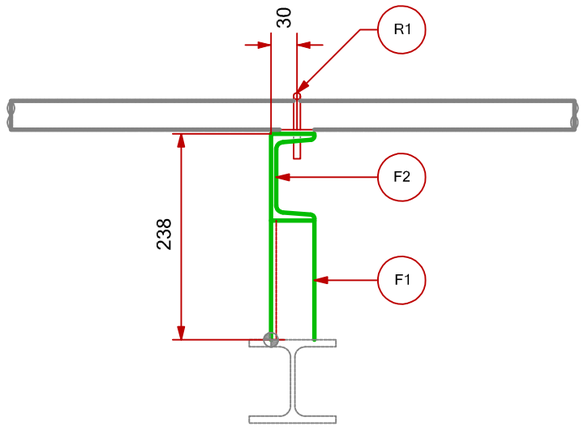



VIEW LOOKING NORTH

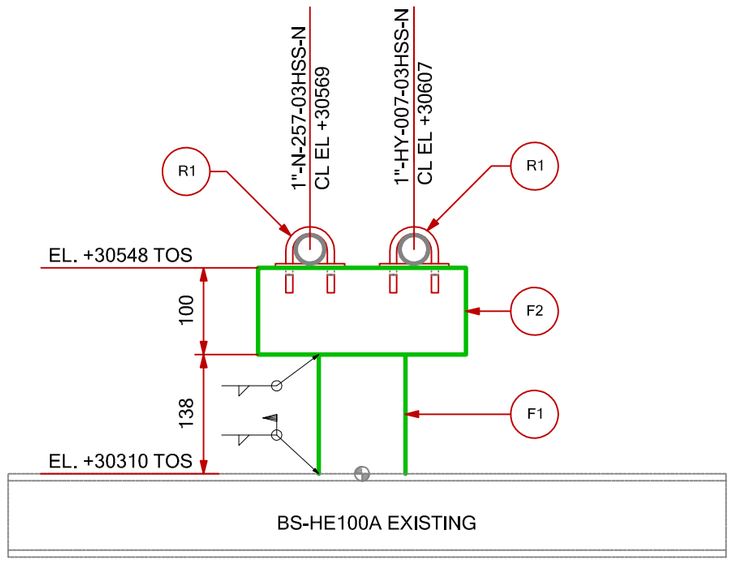


VIEW LOOKING WEST

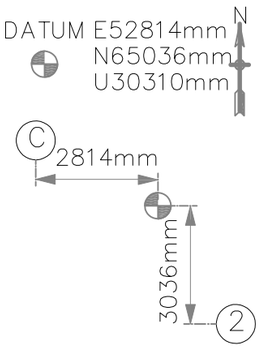

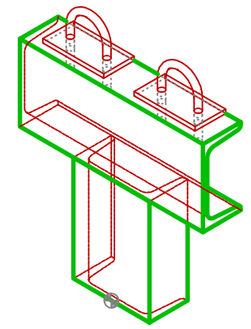

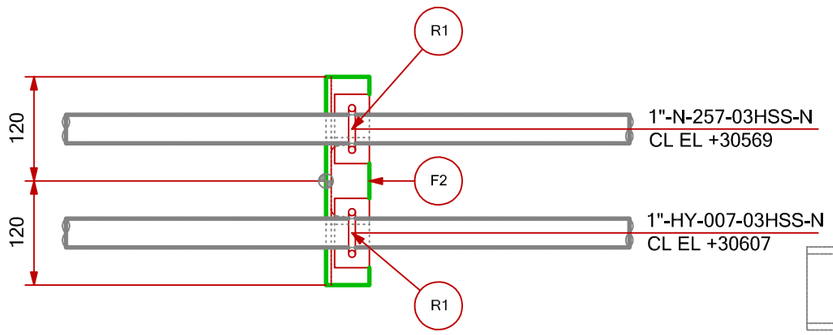

PLAN VIEW

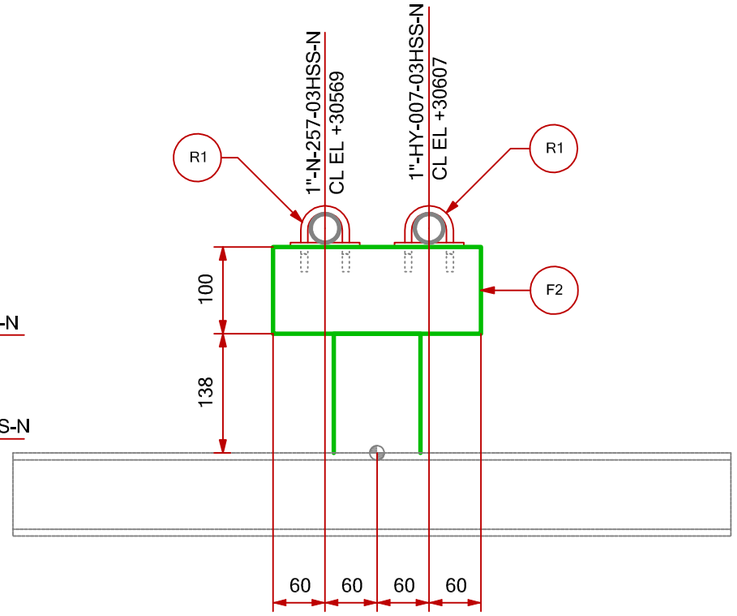

VIEW LOOKING EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND


ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-02038

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 5
DRAWN	CHECKED	APPROVED	DATE 19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1 / REV. 00


File Name :

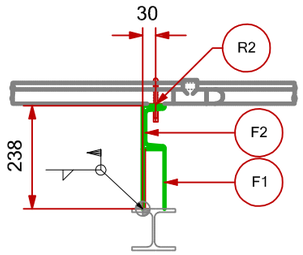


VIEW LOOKING NORTH

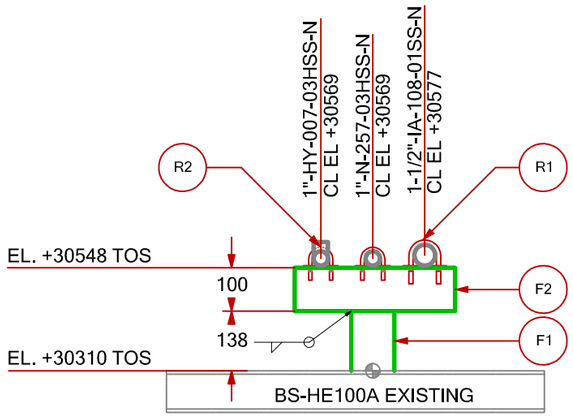

VIEW LOOKING WEST

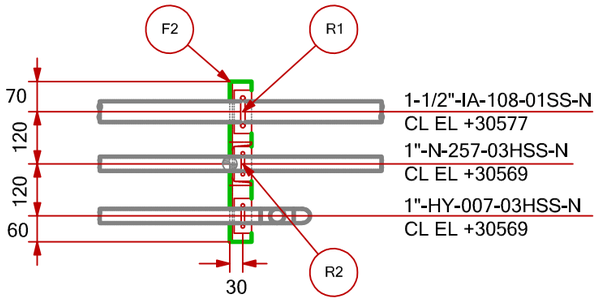


PLAN VIEW

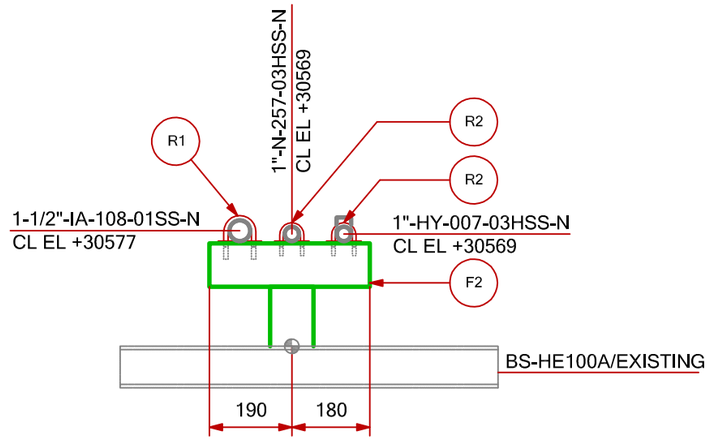


VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1 1/2"	-	-	1	-	0.49	-
R2	STD	S-211-1"	-	-	2	-	0.29	-
F1	BEAM	UPN100	Carbon Steel	138	1	10.57	1.45	0.054
F2	BEAM	UPN100	Carbon Steel	370	1	10.57	3.91	0.140
						TOTAL	6.4	0.19

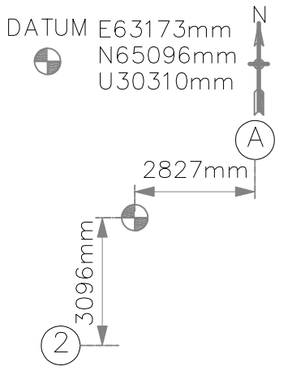

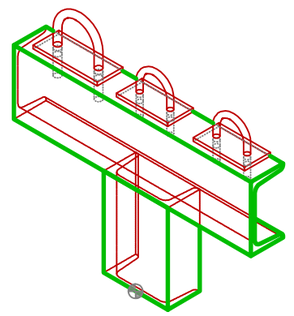

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND


ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-02039

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	1 : 10
DRAWN	CHECKED	APPROVED		DATE	19/08/24
	DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1	REV. 00

File Name :

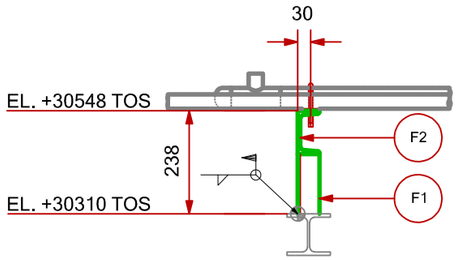


VIEW LOOKING NORTH

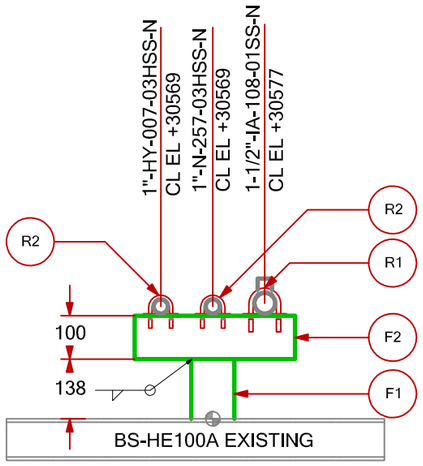



VIEW LOOKING WEST

SUPPORT MATERIAL LIST


POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1 1/2"	-	-	1	-	0.49	-
R2	STD	S-211-1"	-	-	2	-	0.29	-
F1	BEAM	UPN100	Carbon Steel	138	1	10.57	1.45	0.054
F2	BEAM	UPN100	Carbon Steel	370	1	10.57	3.91	0.140
						TOTAL	6.4	0.19

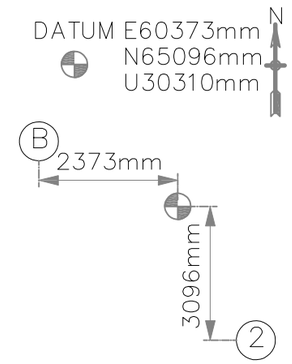

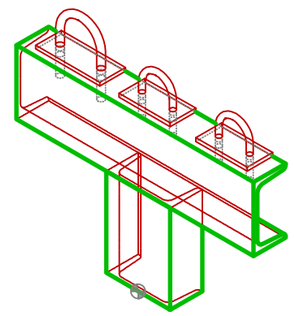

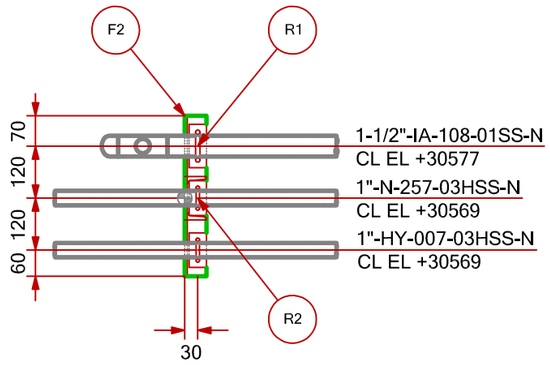

PLAN VIEW

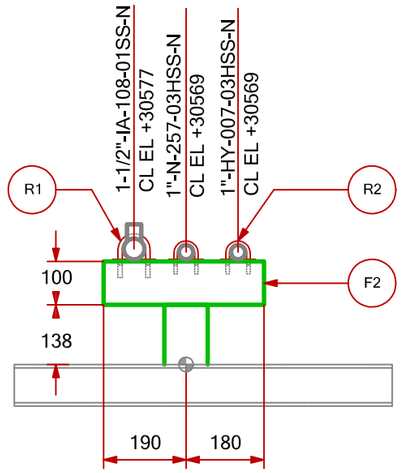

VIEW LOOKING EAST

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND

ROSETTI MARINO


TITLE :

BASE LOAD POWER HUB (BLPH)
Support Drawings


PS-02040

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	1 : 10
DRAWN	CHECKED / APPROVED	DATE	19/08/24
DRAWING NO.	123A90-DDL-PP-DD-72000	SHEET	1 of 1
		REV.	00


File Name :

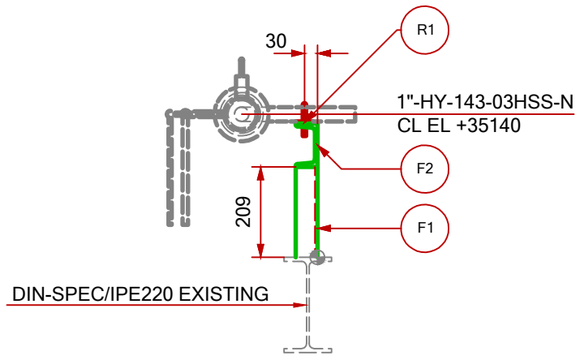


VIEW LOOKING NORTH

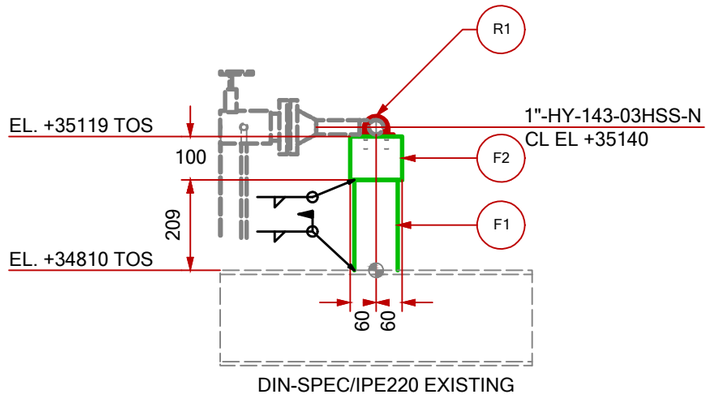

VIEW LOOKING WEST

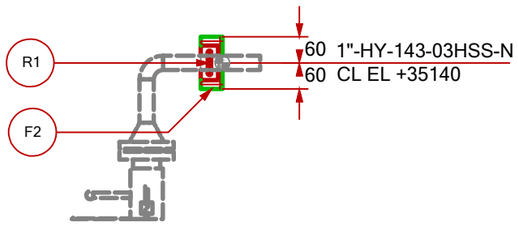


PLAN VIEW

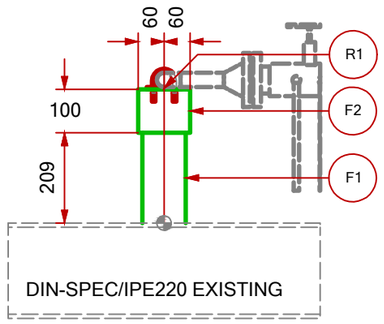

VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1"	-	-	1	-	0.29	-
F1	BEAM	UPN100	Carbon Steel	209	1	10.57	2.20	0.080
F2	BEAM	UPN100	Carbon Steel	120	1	10.57	1.27	0.047
						TOTAL	3.8	0.13

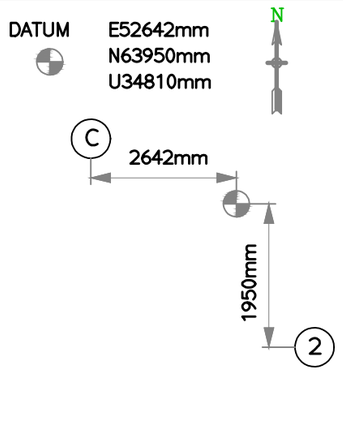

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND


ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-03070

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 10
DRAWN	CHECKED	APPROVED	DATE 19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1 / REV. 00


File Name :

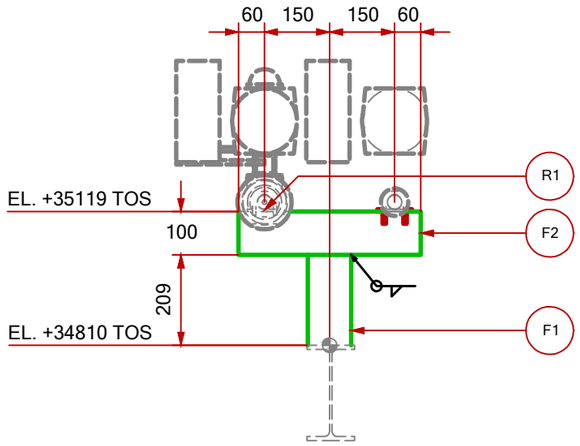


VIEW LOOKING NORTH

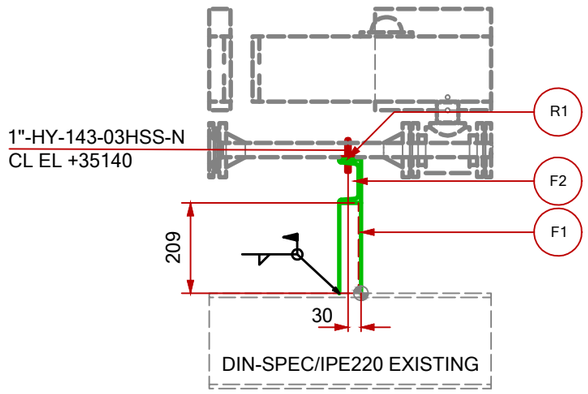

VIEW LOOKING WEST

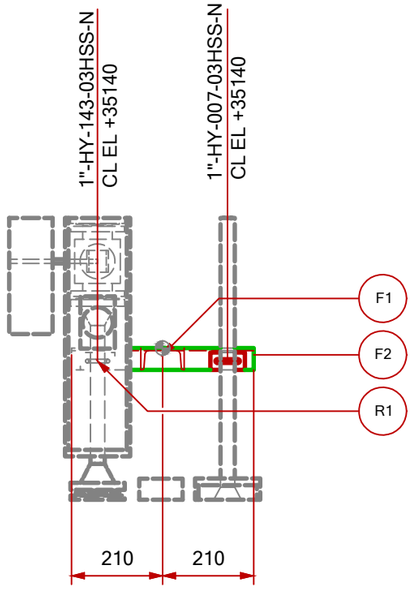


PLAN VIEW

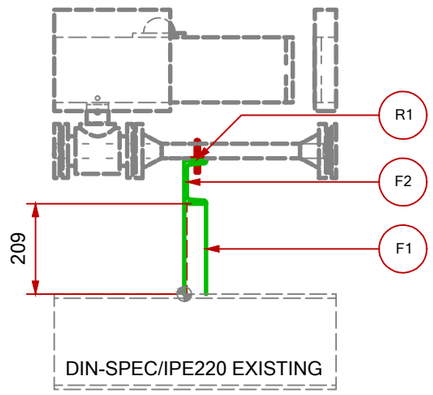


VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1"	-	-	2	-	0.29	-
F1	BEAM	UPN100	Carbon Steel	208	1	10.57	2.20	0.080
F2	BEAM	UPN100	Carbon Steel	420	1	10.57	4.44	0.159
						TOTAL	7.2	0.24

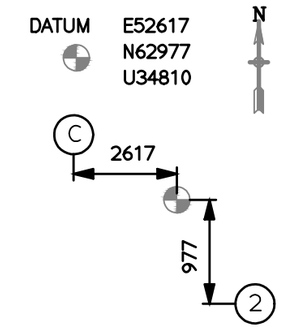

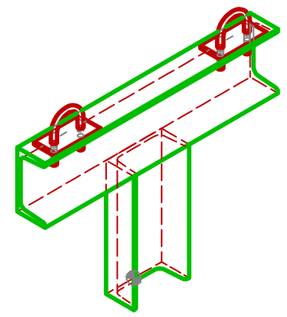

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND


ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-03071

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 10
DRAWN	CHECKED	APPROVED	DATE 19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1 / REV. 00


File Name :

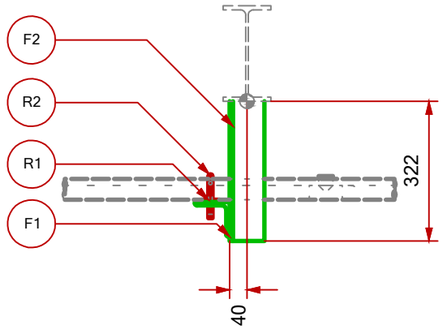


VIEW LOOKING NORTH

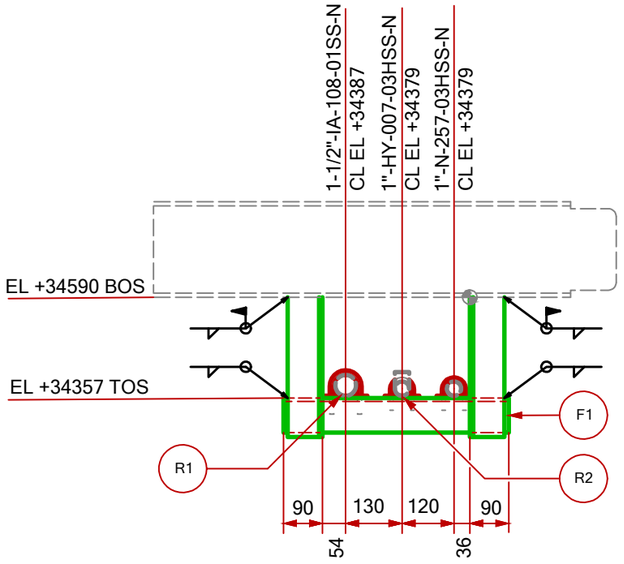

VIEW LOOKING WEST

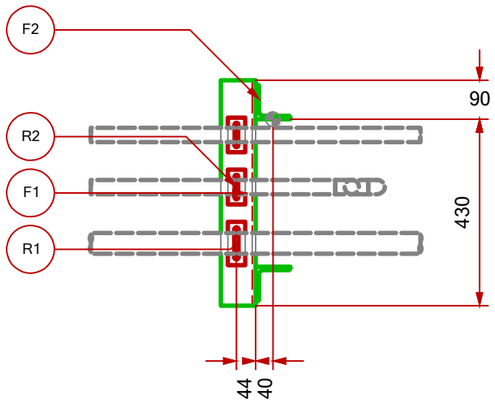


PLAN VIEW

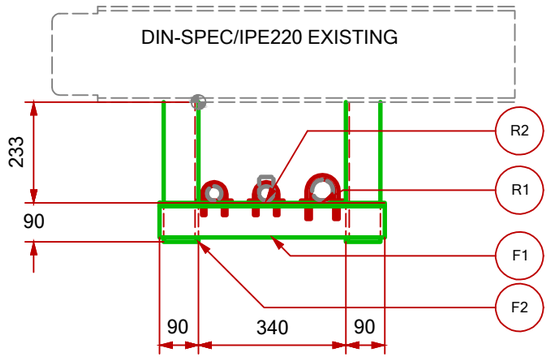

VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1 1/2"	-	-	1	-	0.49	-
R2	STD	S-211-1"	-	-	2	-	0.29	-
F1	BEAM	L80x80x8	Carbon Steel	520	1	9.63	5.01	0.164
F2	BEAM	L80x80x8	Carbon Steel	322	2	9.63	6.22	0.206
						TOTAL	12.3	0.37

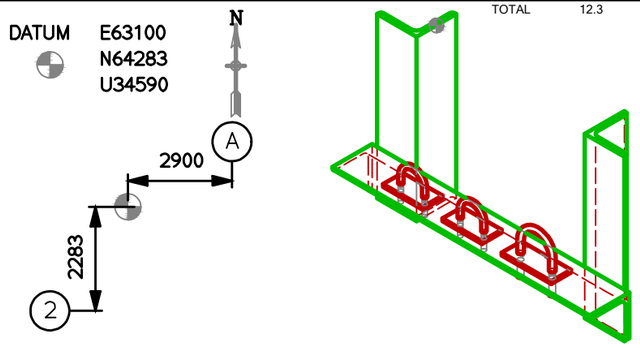

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND


ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-03075

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 10
DRAWN	CHECKED	APPROVED	DATE 19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1 / REV. 00


File Name :

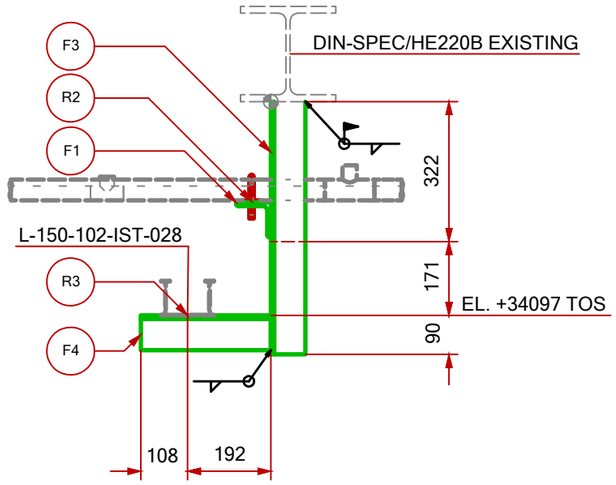


VIEW LOOKING NORTH

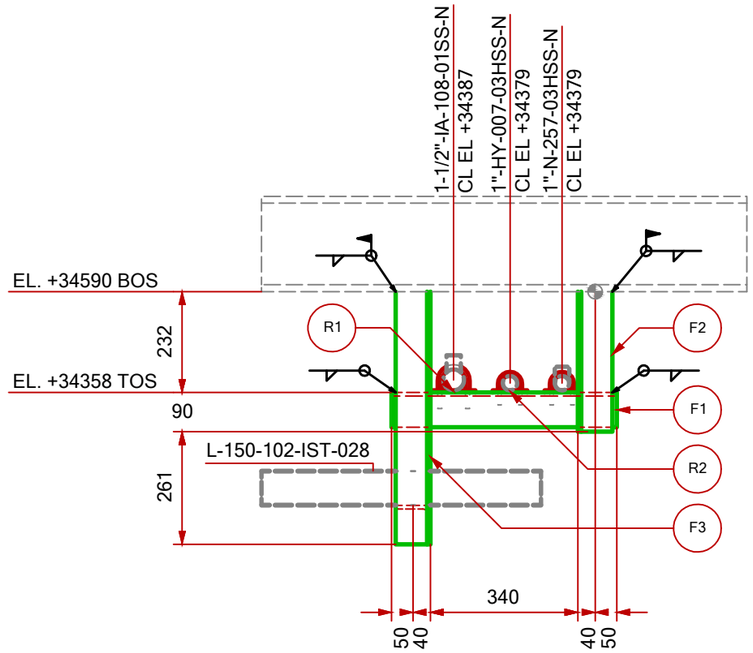

VIEW LOOKING WEST

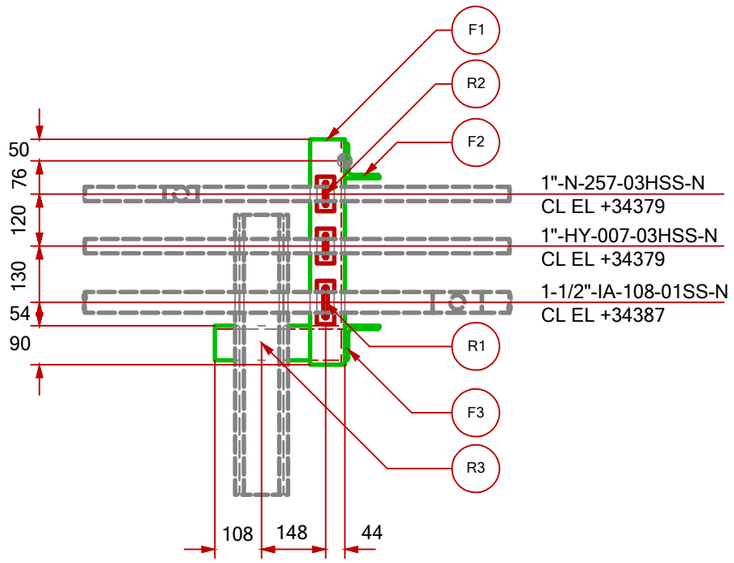


PLAN VIEW

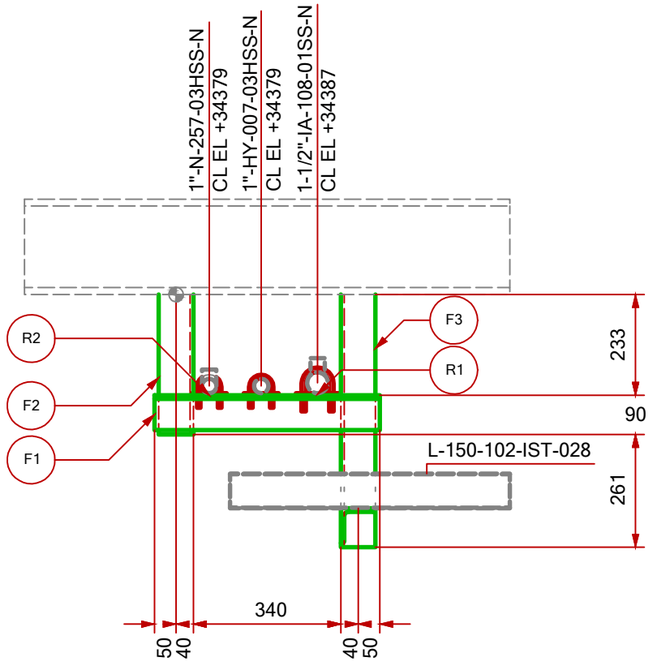


VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1 1/2"	-	-	1	-	0.49	-
R2	STD	S-211-1"	-	-	2	-	0.29	-
R3	STD	RACK SUPPORT	-	-	1	-	0.00	-
F1	BEAM	L80x80x8	Carbon Steel	520	1	9.63	5.01	0.164
F2	BEAM	L80x80x8	Carbon Steel	322	1	9.63	3.11	0.103
F3	BEAM	L80x80x8	Carbon Steel	583	1	9.63	5.62	0.184
F4	BEAM	L80x80x8	Carbon Steel	300	1	9.63	2.89	0.096
						TOTAL	17.7	0.55

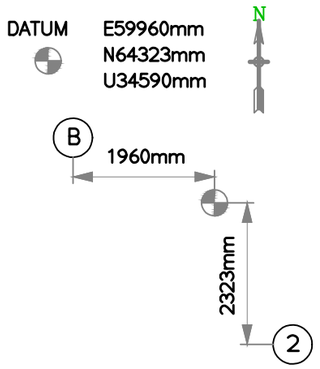

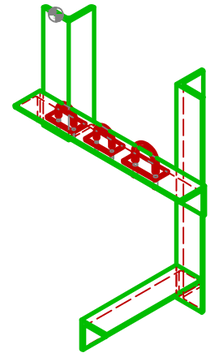

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND


ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-03076

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 10
DRAWN	CHECKED	APPROVED	DATE 19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1 / REV. 00


File Name :

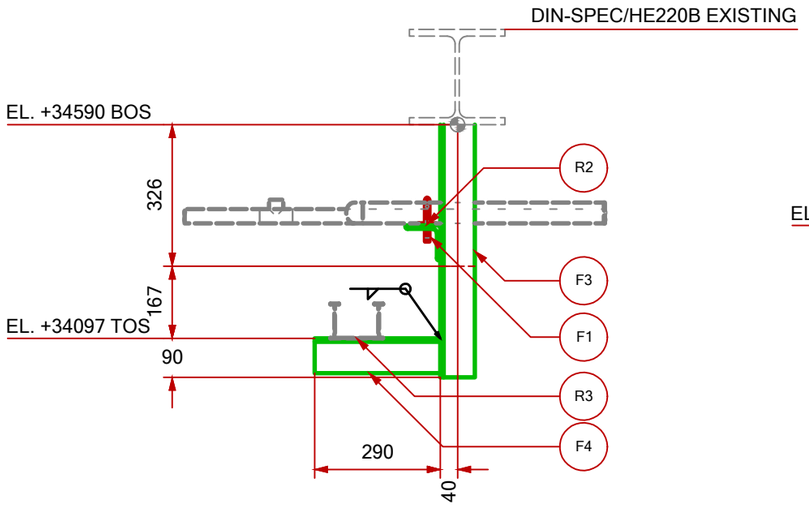


VIEW LOOKING NORTH

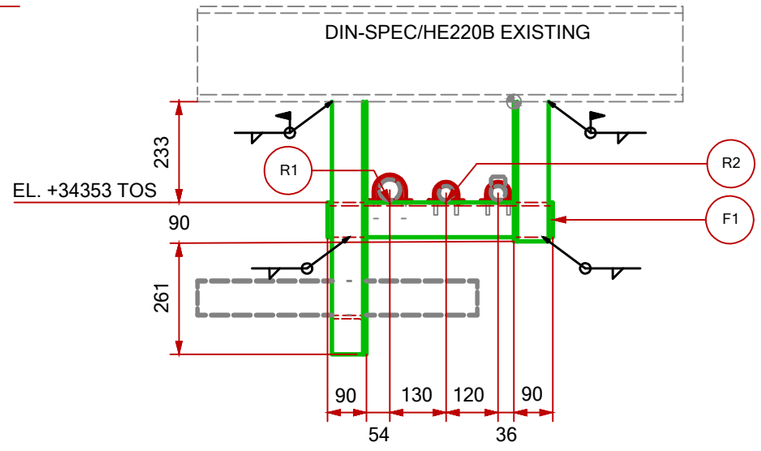

VIEW LOOKING WEST

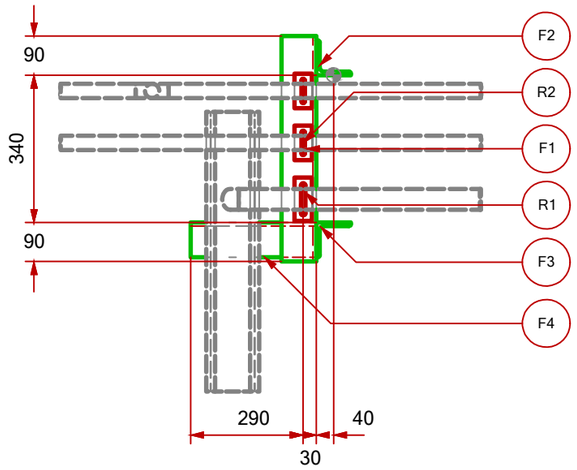

PLAN VIEW

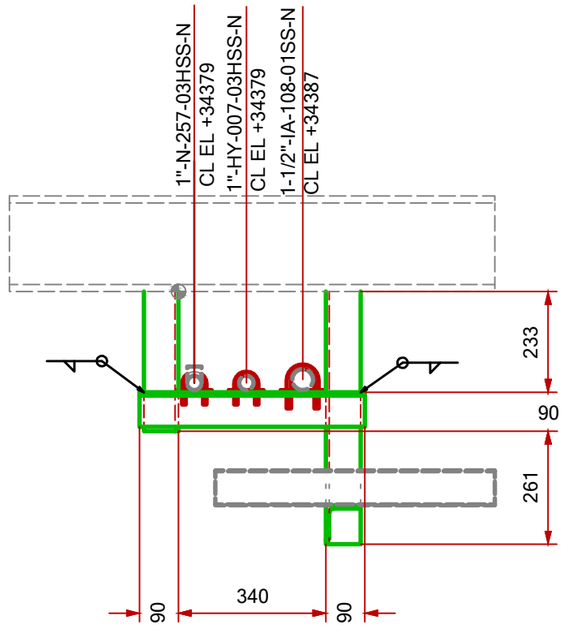



VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1 1/2"	-	-	1	-	0.49	-
R2	STD	S-211-1"	-	-	2	-	0.29	-
R3	STD	RACK SUPPORT	-	-	1	-	0.00	-
F1	BEAM	L80x80x8	Carbon Steel	520	1	9.63	5.01	0.164
F2	BEAM	L80x80x8	Carbon Steel	326	1	9.63	3.14	0.104
F3	BEAM	L80x80x8	Carbon Steel	583	1	9.63	5.62	0.184
F4	BEAM	L80x80x8	Carbon Steel	290	1	9.63	2.79	0.093
						TOTAL	17.6	0.54

DATUM
E56001
N64283
U34590

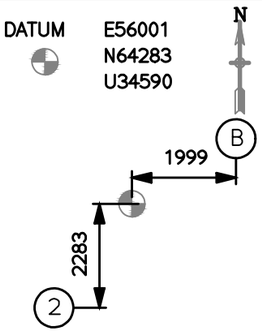

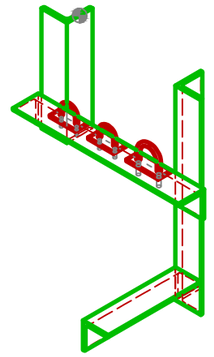

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND


ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-03077

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 10
DRAWN	CHECKED	APPROVED	DATE 19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1 / REV. 00


File Name :

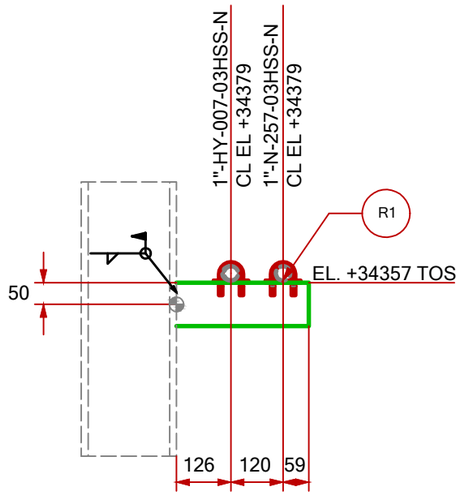


VIEW LOOKING NORTH

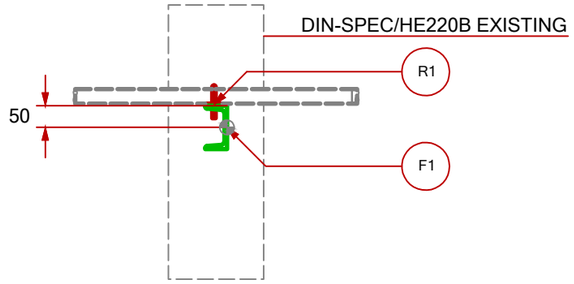

VIEW LOOKING WEST

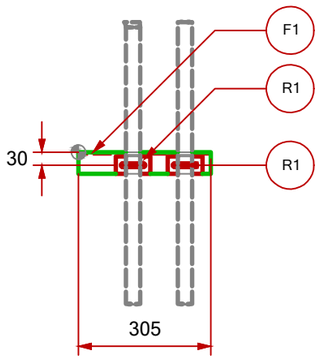


PLAN VIEW

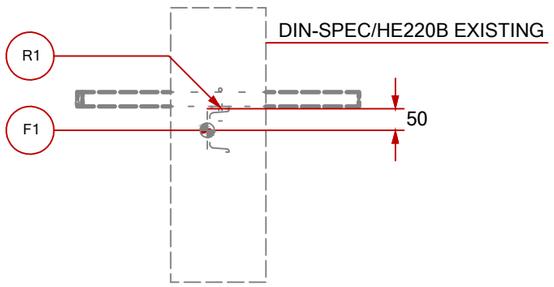


VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1"	-	-	2	-	0.29	-
F1	BEAM	UPN100	Carbon Steel	305	1	10.57	3.22	0.116
						TOTAL	3.8	0.12

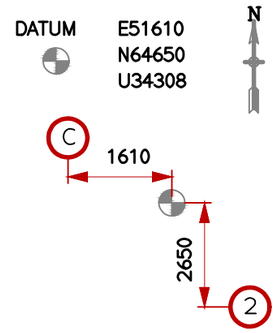

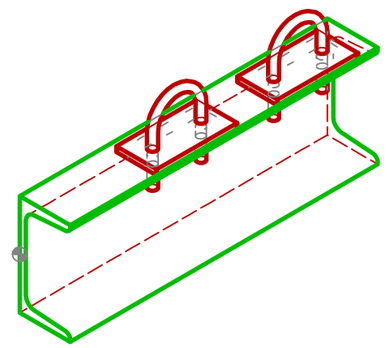

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND


ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-03083

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 10
DRAWN	CHECKED	APPROVED	DATE 19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1 / REV. 00


File Name :

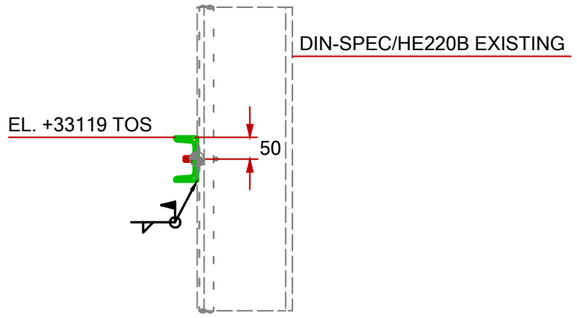


VIEW LOOKING NORTH

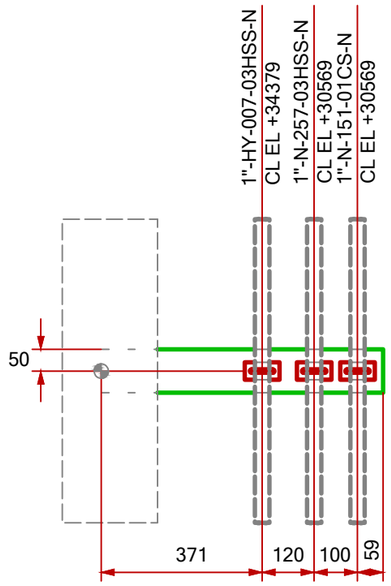

VIEW LOOKING WEST

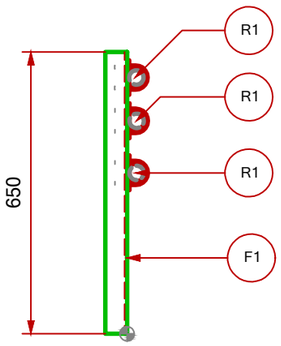


PLAN VIEW

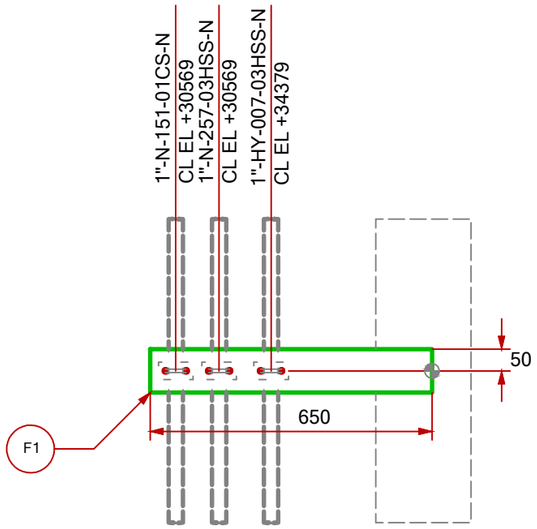

VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1"	-	-	3	-	0.29	-
F1	BEAM	UPN100	Carbon Steel	650	1	10.57	6.87	0.244
						TOTAL	7.7	0.24

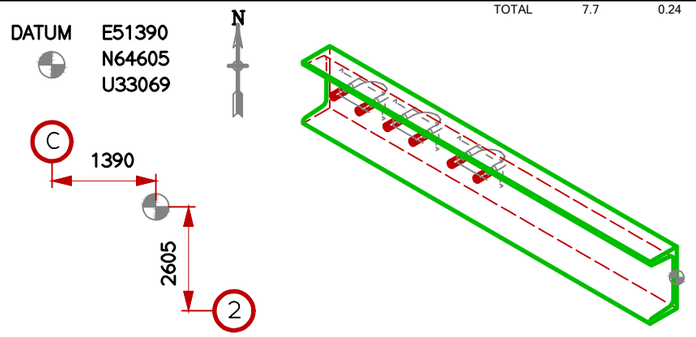

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND


ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-03084

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	1 : 10
DRAWN	CHECKED	APPROVED	DATE	19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1	REV. 00


File Name :

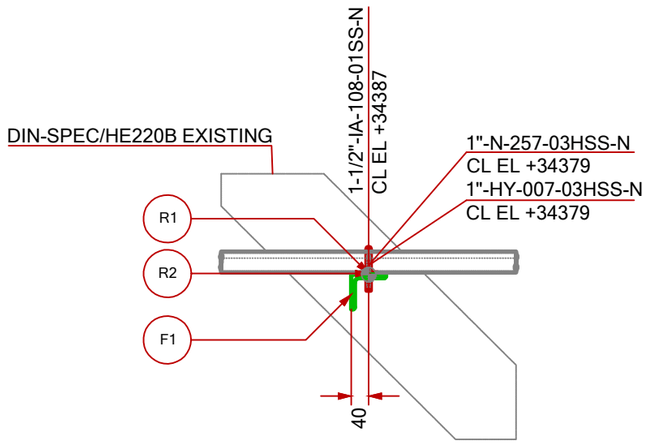


VIEW LOOKING NORTH

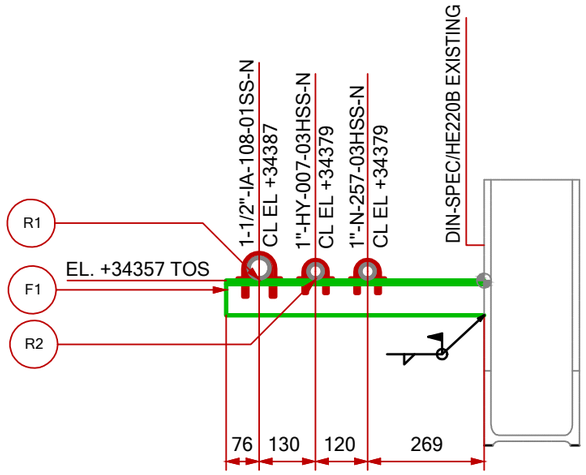

VIEW LOOKING WEST

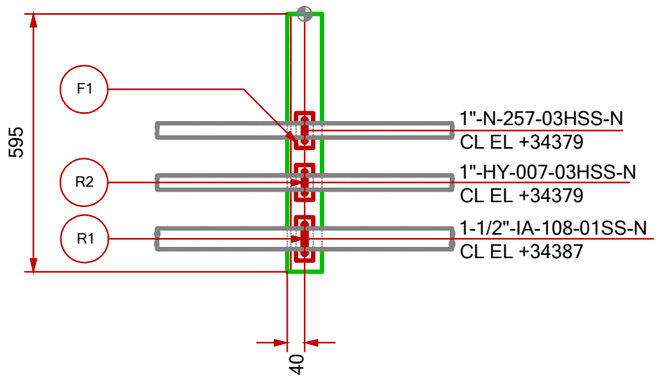


PLAN VIEW

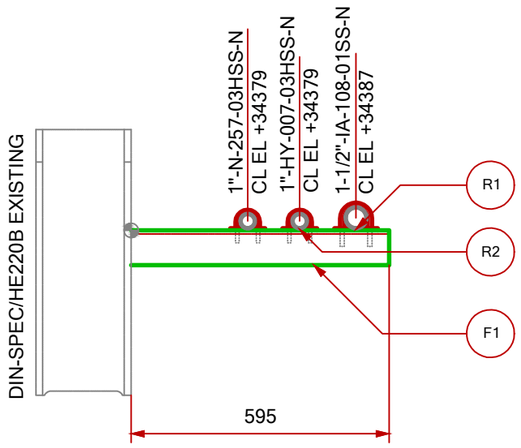

VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1 1/2"	-	-	1	-	0.49	-
R2	STD	S-211-1"	-	-	2	-	0.29	-
F1	BEAM	L80x80x8	Carbon Steel	595	1	9.63	5.73	0.188
						TOTAL	6.8	0.19

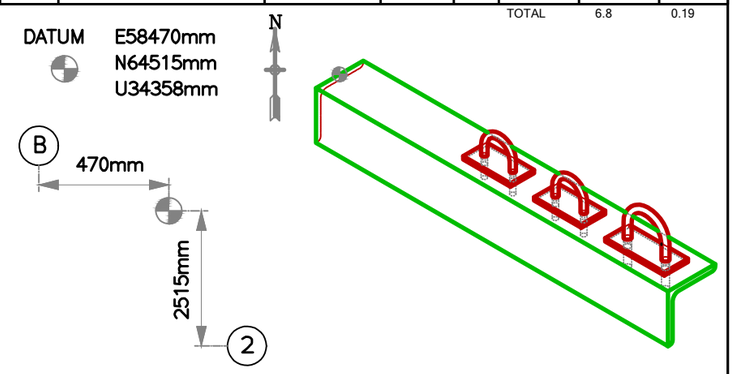

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND


ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-03093

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 10
DRAWN	CHECKED	APPROVED	DATE 19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1 / REV. 00


File Name :

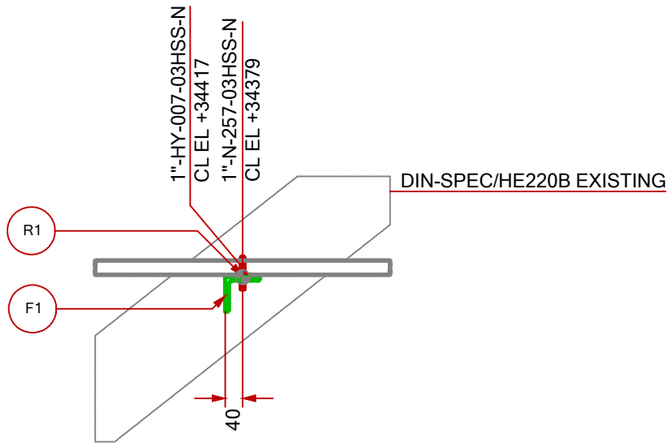


VIEW LOOKING NORTH

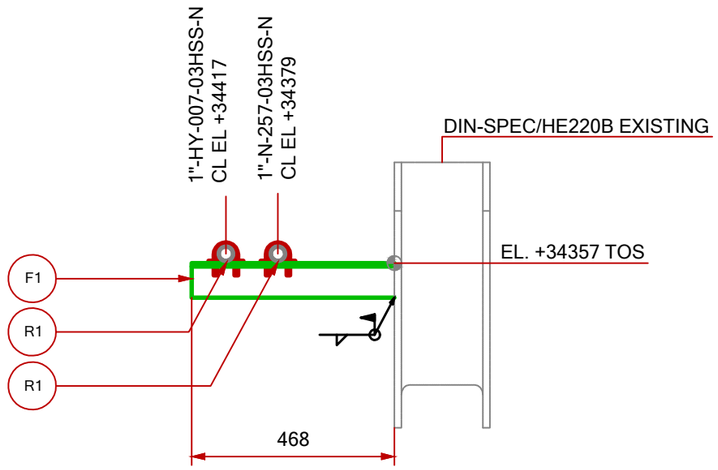

VIEW LOOKING WEST

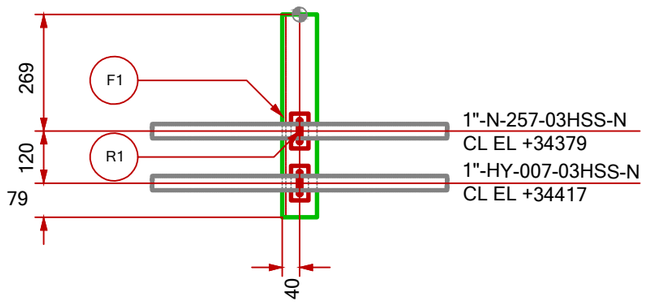


PLAN VIEW

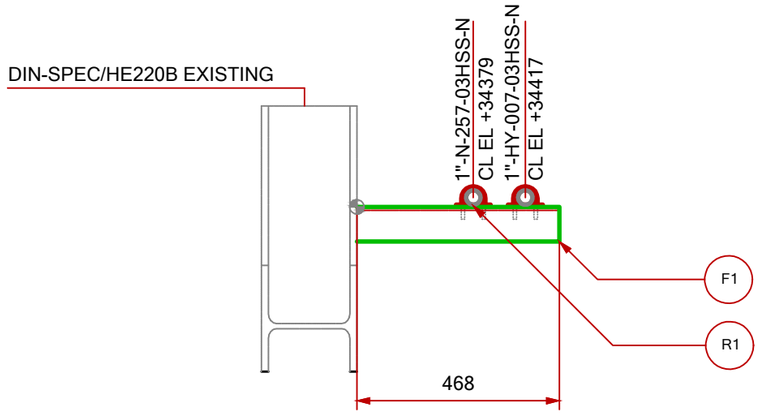

VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1"	-	-	2	-	0.29	-
F1	BEAM	L80x80x8	Carbon Steel	468	1	9.63	4.50	0.148
						TOTAL	5.1	0.15

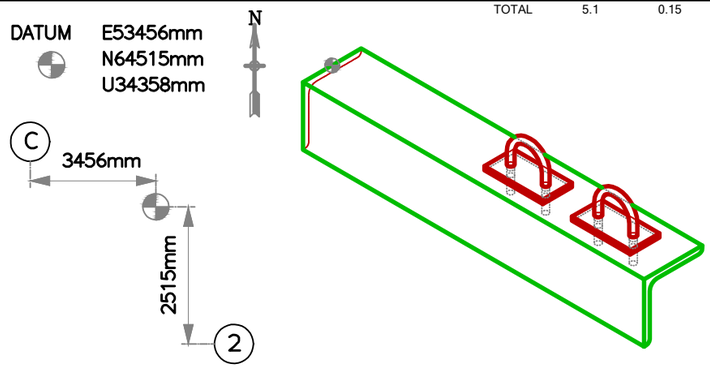

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND


ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-03108

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1 : 10
DRAWN	CHECKED	APPROVED		DATE 19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1	REV. 00


File Name :

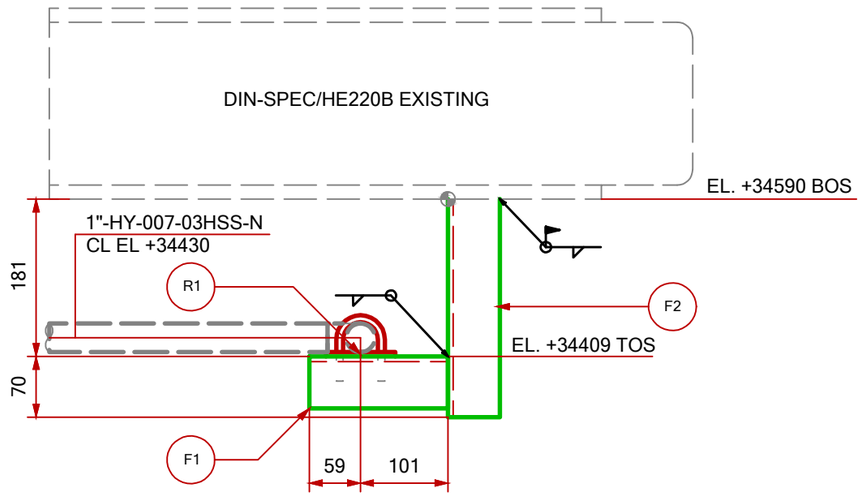


VIEW LOOKING NORTH

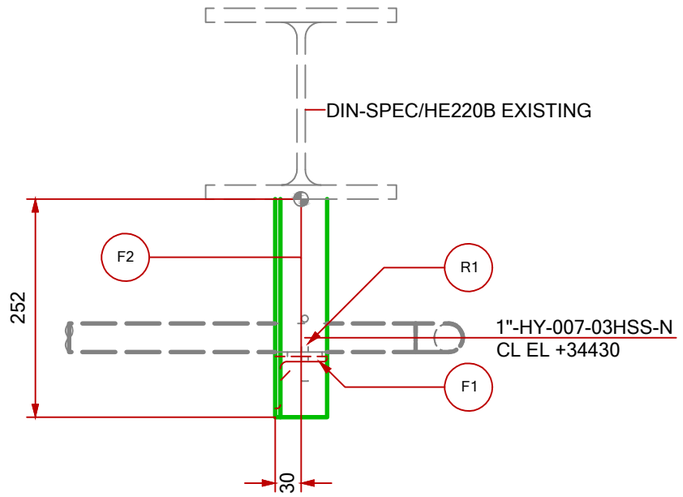

VIEW LOOKING WEST

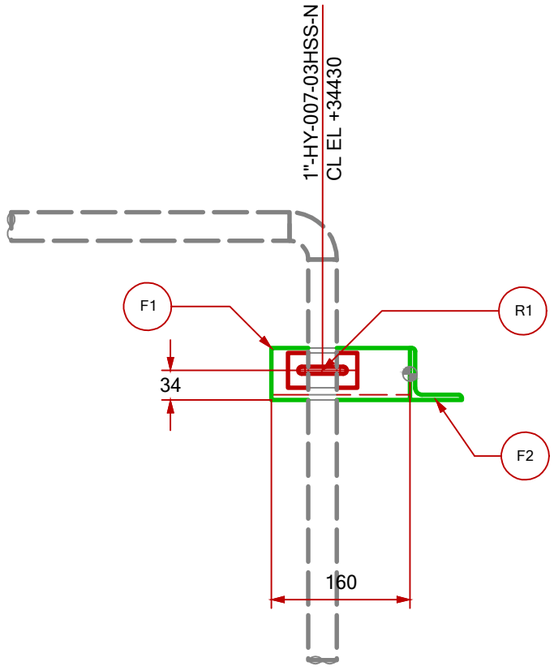


PLAN VIEW

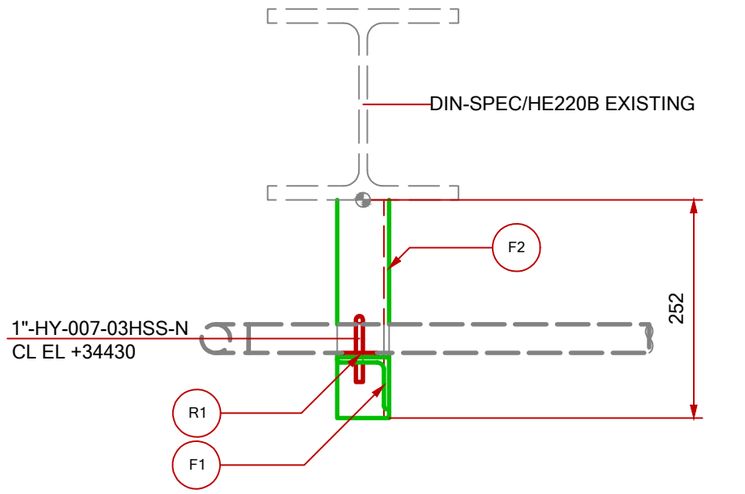


VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1"	-	-	1	-	0.27	-
F1	BEAM	L60x60x6	Carbon Steel	160	1	5.42	0.87	0.039
F2	BEAM	L60x60x6	Carbon Steel	252	1	5.42	1.36	0.060
						TOTAL	2.5	0.10

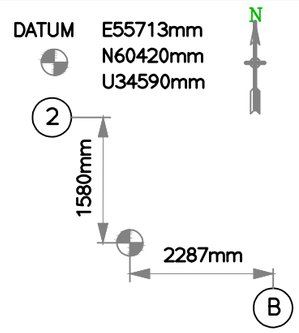

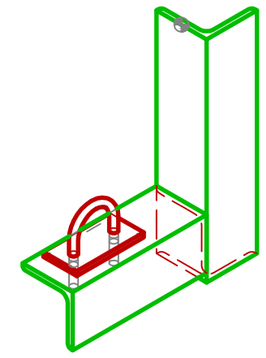

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND

ROSETTI MARINO


TITLE :

BASE LOAD POWER HUB (BLPH)
Support Drawings


PS-03128

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 5
DRAWN	CHECKED	APPROVED	DATE 19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1 / REV. 00


File Name :

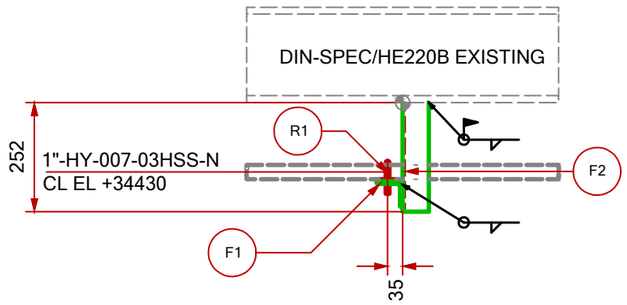


VIEW LOOKING NORTH

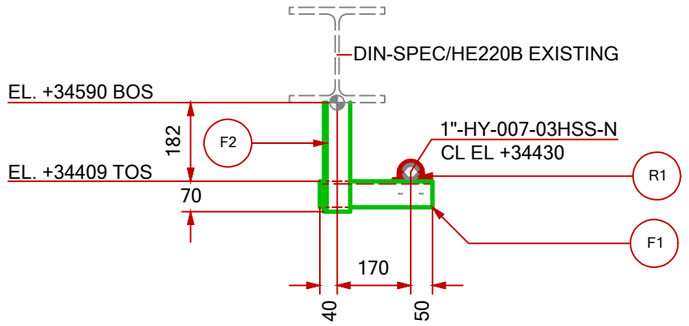

VIEW LOOKING WEST

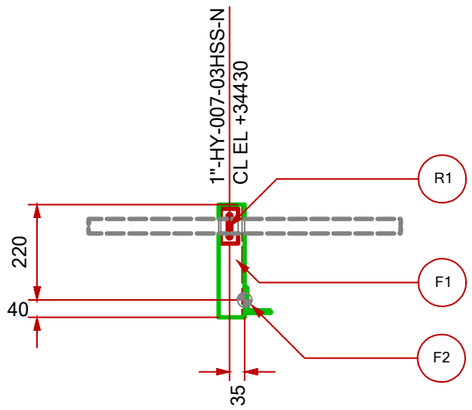


PLAN VIEW

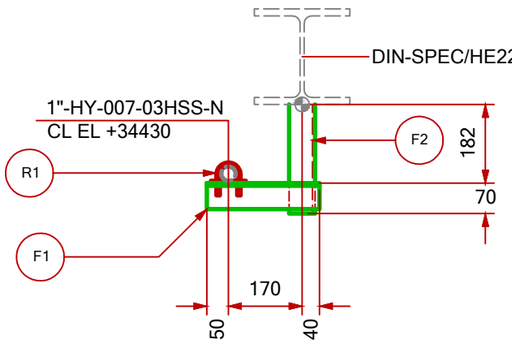


VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1"	-	-	1	-	0.27	-
F1	BEAM	L60x60x6	Carbon Steel	260	1	5.42	1.41	0.062
F2	BEAM	L60x60x6	Carbon Steel	252	1	5.42	1.36	0.060
						TOTAL	3.0	0.12

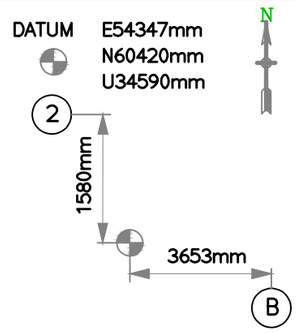

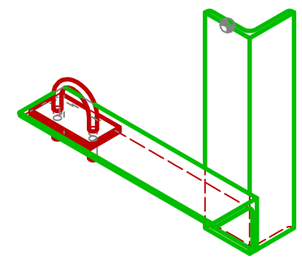

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND

ROSETTI MARINO


TITLE :

BASE LOAD POWER HUB (BLPH)
Support Drawings


PS-03129

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 10
DRAWN	CHECKED	APPROVED	DATE 19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1 / REV. 00


File Name :

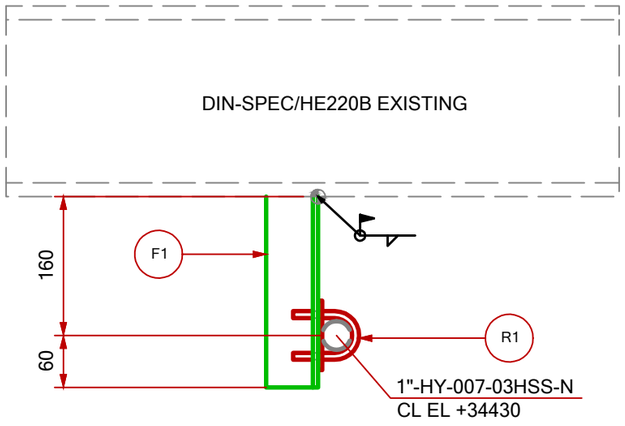


VIEW LOOKING NORTH

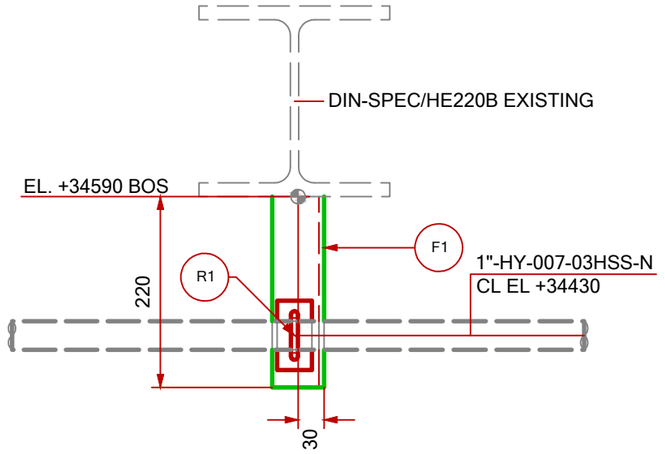

VIEW LOOKING WEST

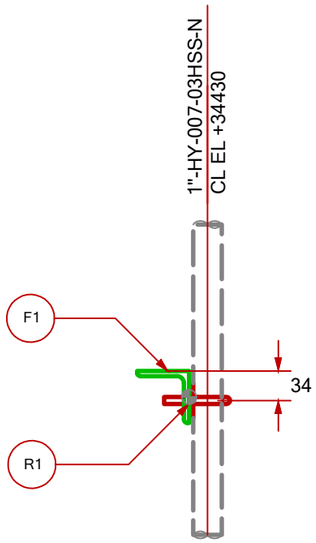


PLAN VIEW

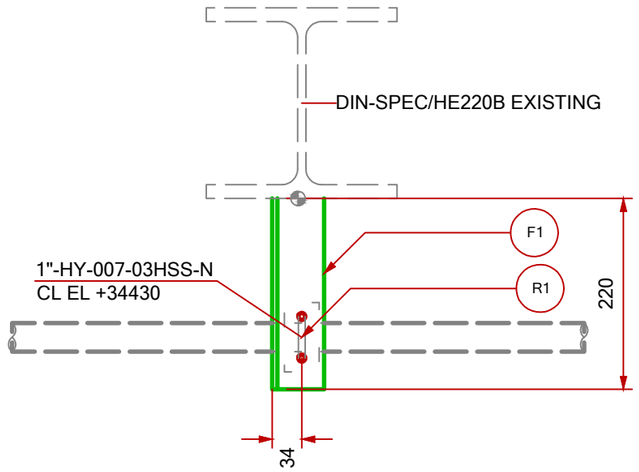


VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1"	-	-	1	-	0.27	-
F1	BEAM	L60x60x6	Carbon Steel	220	1	5.42	1.19	0.053
						TOTAL	1.5	0.05

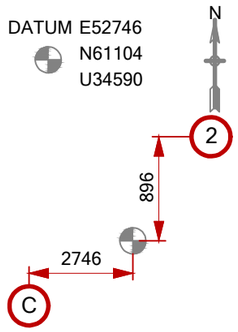

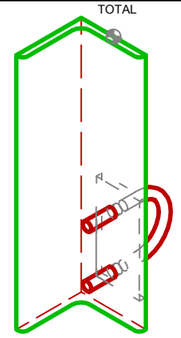

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND


ROSETTI MARINO

TITLE :


BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-03130

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	1 : 5
DRAWN	CHECKED	APPROVED	DATE	19/08/24
	DRAWING NO. 123A90-DDL-PP-DD-72000		SHEET	1 of 1
			REV.	00


File Name :

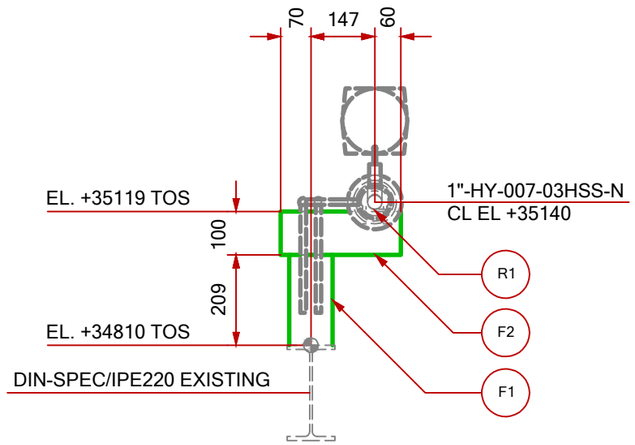


VIEW LOOKING NORTH

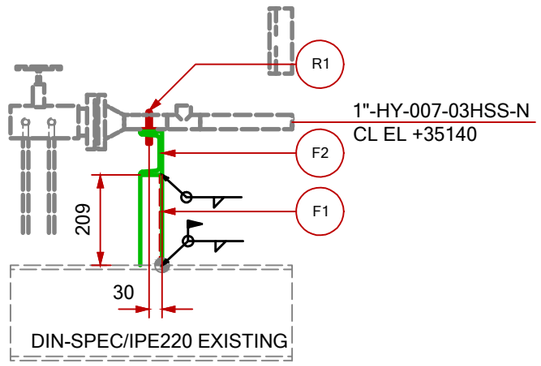

VIEW LOOKING WEST

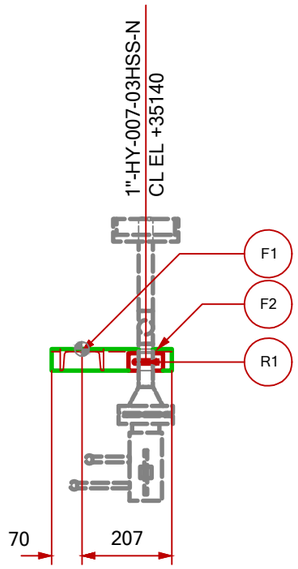


PLAN VIEW

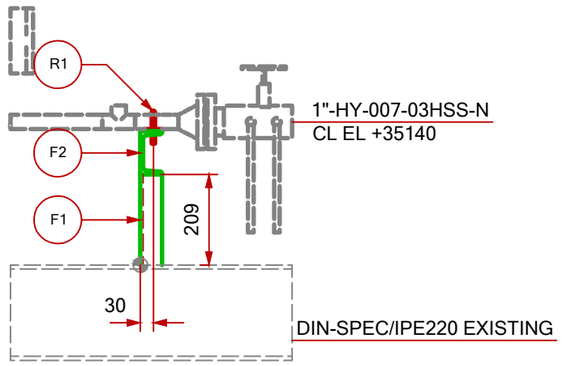


VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1"	-	-	1	-	0.29	-
F1	BEAM	UPN100	Carbon Steel	208	1	10.57	2.20	0.080
F2	BEAM	UPN100	Carbon Steel	277	1	10.57	2.93	0.106
						TOTAL	5.4	0.19

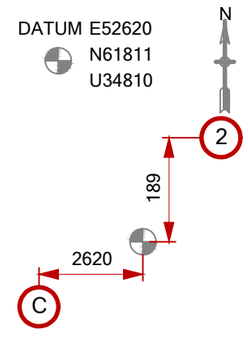

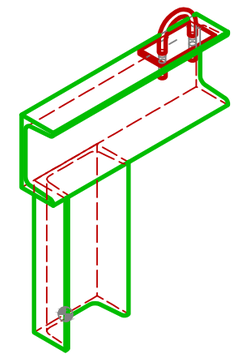

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-03159

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 10
DRAWN	CHECKED	APPROVED	DATE 19/08/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1 / REV. 00

File Name :

ROSETTI MARINO

STANDARD SPECIFICATION
PIPE SUPPORT DETAIL STANDARD

Document Number: STD–PP–DD–0001


Revision: 0

Date: –

CAVALLOTTI GALVANIZZATI DI GUIDA PER TUBAZIONI IN C.S S.S. E ALLOY
GALVANIZED U–BOLTS GUIDE FOR C.S. S.S. AND ALLOY PIPES (NON GRIP)

S–211

Example of designation : STD – PIPE ND"
(S–211 – 10")

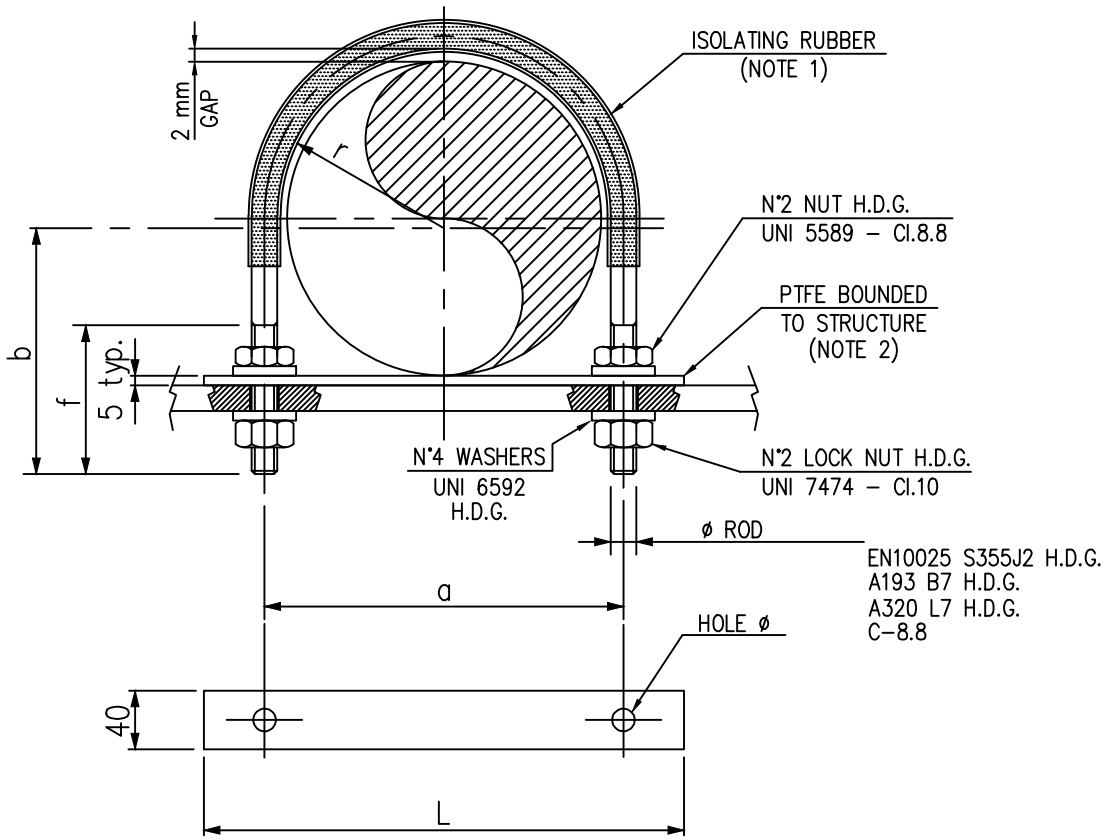

SIZE ND	ROD DIA	r	a	b	f	L	HOLE ø	DEV	DEV. RUBBER	WEIGHT Kg
½"	M8	14	36	55	52	65	10	167	62	0.16
3/4"	M8	17	42	55	52	70	10	176	75	0.16
1"	M8	20	48	60	55	80	10	196	90	0.18
1½"	M10	27	64	70	65	100	12	240	120	0.32
2"	M10	33	76	80	70	110	12	280	150	0.35
3"	M12	48	108	100	80	150	14	370	210	0.60
4"	M12	60	132	110	80	180	14	430	260	0.67
6"	M16	87	190	150	100	250	18	600	380	1.39
8"	M16	113	242	170	100	300	18	720	500	1.60
10"	M16	140	296	200	100	350	18	865	650	1.86
12"	M20	165	350	240	120	420	22	1030	750	3.31
14"	M20	181	382	260	120	450	22	1120	840	3.55
16"	M24	207	438	290	130	520	26	1270	1000	5.76
18"	M24	232	488	320	130	570	26	1410	1100	6.28
20"	M30	257	544	360	160	640	32	1570	1200	11.02
24"	M30	308	646	410	160	750	32	1830	1450	12.52

NOTES:

1) HEAT SHRINK TUBE TYPE FLAME RETARDANT, WITH RATIO 2:1
2) MULTIPLE SHEETS OF PTFE CAN BE ADDED IN ORDER TO ENSURE THE CORRECT ELEVATION AND SLOPE OF THE LINES.

Revision Number	Date	Description	DRAW	CHKD.	APPR.
00	–	ISSUED FOR REVIEW	SLO	GMA	MCO

Documento di proprietà aziendale.La Società tutelerà i propri diritti a termine di legge.This document is Company property. The Company lawfulliy reserves all rights.

7. WELDING REGISTER & MATERIAL TRACEABILITY RECORD

Welding Register

Job	123A90	BASE LOAD POWER HUB (BLPH)			
From Discipline	PP	Piping			
To Discipline	PP	Piping			
Drawings		**From**	5	**To**	5
Sheet		**From**	1	**To**	1
Marks		**From**		**To**	
Location		**From**		**To**	
Material		**From**		**To**	
Welds Execution		**From**		**To**	
Welds Acceptance		**From**		**To**	
Report Date		**From**		**To**	
Prefabrication	All				
Welding Status	All				
ITEM					
ADDITIONAL PARAMETERS	**LINE**	**From**		**To**	
	SPOOL	**From**		**To**	
		From		**To**	

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Cont.	Accept. Date	Spool
1/5/1/_		**01**	**16-01-2025**	**143**	**AX 453**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**C1A**	**GTAW**	**BW**		
03HSS	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable					17-01-2025			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00		100 %											
2/5/1/_		**01**	**04-10-2024**	**29**	**AZ36**							**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**14-10-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		12					eptable					07-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000334	4	Acceptable					14-10-2024			
3/5/1/_		**01**	**11-10-2024**	**40**	**AZ36**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**22-10-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	RGARDINIT	100 %	OK		Acceptable					14-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000510	4	Acceptable					22-10-2024			
4/5/1/_		**01**	**04-10-2024**	**29**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**14-10-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					07-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000337	4	Acceptable					14-10-2024			
5/5/1/_		**01**	**11-10-2024**	**40**	**AZ36**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**22-10-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	RGARDINIT	100 %	OK		Acceptable					14-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000509	4	Acceptable					22-10-2024			
6/5/1/_		**01**	**04-10-2024**	**29**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**14-10-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					07-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000336	4	Acceptable					14-10-2024			
7/5/1/_		**01**	**30-12-2024**	**111**	**AX416**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**C1A**	**GTAW**	**BW**	**02-01-2025**	
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable					31-12-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	001110	4	Acceptable					02-01-2025			
8/5/1/_		**01**	**03-10-2024**	**27-111**	**AZ53**			**FWN**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**C1A**	**GTAW**	**BW**	**08-01-2025**	
					AX416	**After Cutting**													
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					04-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000241	4	Acceptable					07-10-2024			
Cut 30-12-2024		VIS	C 1 DTA	After Cutting		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable C1A		GTAW			31-12-2024			
		RT	C 1 DTA	After Cutting		IDL-QCI-RT 0036 00	PR	100 %	001115	4	Repeat					03-01-2025			
		RT	DRF	After Film Repeat		IDL-QCI-RT 0036 00	PR	100 %	001128	2	Acceptable					08-01-2025			
9/5/1/_		**01**	**11-10-2024**	**40**	**AZ36**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**22-10-2024**	**B**

Spool A not involved in TP007

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Conn	Accept. Date	Spool
9/5/1/_		**01**	**11-10-2024**	**40**	**AZ36**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**22-10-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	RGARDINIT	100 %	OK		Acceptable				14-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000511	4	Acceptable				22-10-2024				
10/5/1/_		**01**	**11-10-2024**	**40**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**22-10-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	RGARDINIT	100 %	OK		Acceptable				14-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000589	4	Acceptable				22-10-2024				
11/5/1/_		**01**	**04-10-2024**	**29**	**AZ36**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**14-10-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				07-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000335	4	Acceptable				14-10-2024				
12/5/1/_		**01**	**04-10-2024**	**29**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**14-10-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				07-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000333	4	Acceptable				14-10-2024				
13/5/1/_		**01**	**02-12-2024**	**60**	**AX416**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**D1A**	**GTAW**	**BW**	**12-12-2024**	
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable				03-12-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	001054	4	Acceptable				12-12-2024				
14/5/1/_		**01**	**09-10-2024**	**35**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**16-10-2024**	**C**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				10-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000397	4	Acceptable				16-10-2024				
15/5/1/_		**01**	**03-10-2024**	**27**	**AZ53**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**16-10-2024**	**C**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000398	4	Acceptable				16-10-2024				
16/5/1/_		**01**	**03-10-2024**	**27**	**AZ53**			**FWN**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**07-10-2024**	**D**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000242	4	Acceptable				07-10-2024				
17/5/1/_		**01**	**09-10-2024**	**35**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**16-10-2024**	**D**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				10-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000399	4	Acceptable				16-10-2024				

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Cont.	Accept. Date	Spool
17/5/1/_		**01**	**09-10-2024**	**35**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**16-10-2024**	**D**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000400	4	Acceptable				16-10-2024				
19/5/1/_		**01**	**09-10-2024**	**35**	**AZ36**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**16-10-2024**	**D**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				10-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000401	4	Acceptable				16-10-2024				
20/5/1/_		**01**	**03-10-2024**	**27**	**AZ53**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**07-10-2024**	**D**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000243	4	Acceptable				07-10-2024				
66/5/1/_		**01**	**30-12-2024**	**111**	**AX416**			**FWN**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**C1A**	**GTAW**	**BW**	**02-01-2025**	
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable				31-12-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	001111	4	Acceptable				02-01-2025				

Totals per DWG	**5**	**Prefabrication**	**1,60 m**	**16 Nr. Welds**	**16,00 inch**
		Erection	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**2,10 m**	**21 Nr. Welds**	**21,00 inch**
		Accepted	**2,00 m**	**20 Nr. Welds**	**20,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Discipline		**Prefabrication**	**1,60 m**	**16 Nr. Welds**	**16,00 inch**
		Erection	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**2,10 m**	**21 Nr. Welds**	**21,00 inch**
		Accepted	**2,00 m**	**20 Nr. Welds**	**20,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Project		**Prefabrication**	**1,60 m**	**16 Nr. Welds**	**16,00 inch**
		Erection	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**2,10 m**	**21 Nr. Welds**	**21,00 inch**
		Accepted	**2,00 m**	**20 Nr. Welds**	**20,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**

Cliente/Contractor	**CROSSWIND**	Preparato da/Prepared by	Controllato da/Checked by	Approvato da/Approved by
SubContrattista/SubContractor	**ROSETTIMARINO/GROUPOFCOMPANY**	Nome/Name: Antonio Galesi	Nome/Name:	Nome/Name:
Progetto/Project	**Hollandse Kust Noord Wind Park Project**			
Commessa/Job	**123A90 - Piping**			
Disciplina/Discipline	**PIPING**			
TitoloDocumento/DocumentTitle	**Material Traceability Report**	StatoDocumento/Document Status:		Data/Date: 21/01/2025
RosettiDoc.Num.	**123A90MTR001**			

Sketch no.	Rev.	sheet	Spool	Piping Class	pos.	Q.ty (n° - m)	Description	Heat/Serial Number	PurchaseOrder	Pos. Order	Mat. Certificate	Weld Ref.	Note
5	01	1	B	03HSS	3	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W8-W9	
5	01	1	B	03HSS	3	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W10-W11	
5	01	1	B	03HSS	3	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W12	
5	01	1	B	03HSS	1D	1,053	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	1	B	03HSS	1E	2,769	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	1	B	03HSS	1F	0,625	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	1	C	03HSS	3	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W14-W15	
5	01	1	C	03HSS	4	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DJ346	1724000839	01010	12/230039622/57/REV-00	W15	
5	01	1	C	03HSS	1G	0,634	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	1	D	03HSS	2	1	Tee BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	66A-SWJ011	1724000839	00480	T202318000110	W17-W18-W19	
5	01	1	D	03HSS	4	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DJ346	1724000839	01010	12/230039622/57/REV-00	W16	
5	01	1	D	03HSS	4	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DJ346	1724000839	01010	12/230039622/57/REV-00	W18	
5	01	1	D	03HSS	4	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DJ346	1724000839	01010	12/230039622/57/REV-00	W19	
5	01	1	D	03HSS	1H	0,1	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	1	D	03HSS	1I	0,462	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		

Rosetti Marino S.p.A.

Welding Register

Job	123A90	BASE LOAD POWER HUB (BLPH)			
From Discipline	PP	Piping			
To Discipline	PP	Piping			
Drawings		**From**	5	**To**	5
Sheet		**From**	2	**To**	2
Marks		**From**		**To**	
Location		**From**		**To**	
Material		**From**		**To**	
Welds Execution		**From**		**To**	
Welds Acceptance		**From**		**To**	
Report Date		**From**		**To**	
Prefabrication	All				
Welding Status	All				
	ITEM				
ADDITIONAL PARAMETERS	**LINE**	**From**		**To**	
	SPOOL	**From**		**To**	
		From		**To**	

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Cont.	Accept. Date	Spool
21/5/2/_		**01**	**03-10-2024**	**27**	**AZ53**			**FWN**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**07-10-2024**	**E**
03HSS	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000244	4	Acceptable				07-10-2024				
22/5/2/_		**01**	**11-10-2024**	**40**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**22-10-2024**	**E**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	RGARDINIT	100 %	OK		Acceptable				14-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000512	4	Acceptable				22-10-2024				
23/5/2/_		**01**	**03-10-2024**	**27**	**AZ53**			**TEE**	**0,75 in**	**2,87 mm**	**V**	**0,083 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**15-10-2024**	**E**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000360	4	Acceptable				15-10-2024				
24/5/2/_		**01**	**11-10-2024**	**40**	**AZ36**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**22-10-2024**	**E**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	RGARDINIT	100 %	OK		Acceptable				14-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000513	4	Acceptable				22-10-2024				
25/5/2/_		**01**	**11-10-2024**	**40**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**22-10-2024**	**E**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	RGARDINIT	100 %	OK		Acceptable				14-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000514	4	Acceptable				22-10-2024				
26/5/2/_		**01**	**03-10-2024**	**27**	**AZ53**			**TEE**	**0,75 in**	**2,87 mm**	**V**	**0,083 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**15-10-2024**	**E**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000361	4	Acceptable				15-10-2024				
27/5/2/_		**01**	**14-10-2024**	**41**	**AZ35**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**22-10-2024**	**E**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				15-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000517	4	Acceptable				22-10-2024				
28/5/2/_		**01**	**04-10-2024**	**29**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**22-10-2024**	**E**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				07-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000364	4	Repeat				15-10-2024				
		RT	DRF	After Film Repeat		IDL-QCI-RT 0036 00	AA	100 %	000516	4	Acceptable				22-10-2024				
29/5/2/_		**01**	**30-11-2024**	**58**	**AX416**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**D1A**	**GTAW**	**BW**	**06-12-2024**	
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable				30-11-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	001035	4	Acceptable				06-12-2024				

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Cons.	Accept. Date	Spool
29/5/2/_		**01**	**30-11-2024**	**58**	**AX416**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**D1A**	**GTAW**	**BW**	**06-12-2024**	
30/5/2/_		**01**	**04-10-2024**	**29**	**AZ36**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**15-10-2024**	**E**
	1	VIS	FTP	FIT-UP and on weld	123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK			Acceptable				07-10-2024				
		RT	FIN	Weld Completion	IDL-QCI-RT 0036 00	AA	100 %	000365	4		Acceptable				15-10-2024				
31/5/2/_		**01**	**04-10-2024**	**29**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**15-10-2024**	**E**
	1	VIS	FTP	FIT-UP and on weld	123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK			Acceptable				07-10-2024				
		RT	FIN	Weld Completion	IDL-QCI-RT 0036 00	AA	100 %	000366	4		Acceptable				15-10-2024				
32/5/2/_		**01**	**11-10-2024**	**40**	**AZ36**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**22-10-2024**	**E**
	1	VIS	FTP	FIT-UP and on weld	123A90-PML-QHSE-PRO-00103 Rev 00	RGARDINIT	100 %	OK			Acceptable				14-10-2024				
		RT	FIN	Weld Completion	IDL-QCI-RT 0036 00	AA	100 %	000515	4		Acceptable				22-10-2024				
33/5/2/_		**01**	**29-11-2024**	**59**	**AX416**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**D1A**	**GTAW**	**BW**	**12-12-2024**	
	1	VIS	FTP	FIT-UP and on weld	123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK			Acceptable				30-11-2024				
		RT	FIN	Weld Completion	IDL-QCI-RT 0036 00	AA	100 %	001036	4		Repeat				06-12-2024				
		RT	DRF	After Film Repeat	IDL-QCI-RT 0036 00	AA	100 %	001055	1		Acceptable				12-12-2024				
34/5/2/_		**01**	**03-10-2024**	**27**	**AZ53**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**07-10-2024**	**F**
	1	VIS	FTP	FIT-UP and on weld	123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK			Acceptable				04-10-2024				
		RT	FIN	Weld Completion	IDL-QCI-RT 0036 00	AA	100 %	000245	4		Acceptable				07-10-2024				
35/5/2/_		**01**	**11-10-2024**	**40**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**16-10-2024**	**F**
	1	VIS	FTP	FIT-UP and on weld	123A90-PML-QHSE-PRO-00103 Rev 00	RGARDINIT	100 %	OK			Acceptable				14-10-2024				
		RT	FIN	Weld Completion	IDL-QCI-RT 0036 00	AA	100 %	000383	4		Acceptable				16-10-2024				
36/5/2/_		**01**	**03-10-2024**	**27**	**AZ53**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**07-10-2024**	**F**
	1	VIS	FTP	FIT-UP and on weld	123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK			Acceptable				04-10-2024				
		RT	FIN	Weld Completion	IDL-QCI-RT 0036 00	AA	100 %	000237	4		Acceptable				07-10-2024				
37/5/2/_		**01**	**15-11-2024**	**32**	**AX416**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**D1A**	**GTAW**	**BW**	**25-11-2024**	
	1	VIS	FTP	FIT-UP and on weld	123A90-PML-QHSE-PRO-00103 Rev 00	IARRIGONIT	100 %	OK			Acceptable				16-11-2024				
		RT	FIN	Weld Completion	IDL-QCI-RT 0036 00	AA	100 %	001018	4		Acceptable				25-11-2024				
52/5/2/_		**01**	**11-10-2024**	**40**	**AZ36**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**16-10-2024**	**F**

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number		Rev.	Prod. Date	Prod. Sheet	Welders			Item type	Dimension	Thickness	Bevel	Weld Length	P/M	Material	WPS	Techn. Weld.	Type Cons	Accept. Date	Spool
Class	Insp. Category	Cont.	Examination phase			Work Instructions	Oper.	Exam. %	N. Rep	Films n.	Result	WPS Rip.	Techn. Weld.		Defect length	CND date	NOTE		
52/5/2/_		**01**	**11-10-2024**	**40**	**AZ36**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**16-10-2024**	**F**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	RGARDINIT	100 %	OK		Acceptable					14-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000384	4	Acceptable					16-10-2024			
53/5/2/_		**01**	**03-10-2024**	**27**	**AZ53**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**07-10-2024**	**F**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					04-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000238	4	Acceptable					07-10-2024			
54/5/2/_		**01**	**30-11-2024**	**58**	**AX416**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**D1A**	**GTAW**	**BW**	**06-12-2024**	
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable					30-11-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	001037	4	Acceptable					06-12-2024			
55/5/2/_		**01**	**16-10-2024**	**45**	**AZ36**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**21-10-2024**	**F**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					18-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000476	4	Acceptable					21-10-2024			
56/5/2/_		**01**	**03-10-2024**	**27**	**AZ53**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**15-10-2024**	**F**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					04-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000367	4	Acceptable					15-10-2024			
57/5/2/_		**01**	**02-12-2024**	**60**	**AX416**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**D1A**	**GTAW**	**BW**	**12-12-2024**	
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable					03-12-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	001056	4	Acceptable					12-12-2024			
58/5/2/_		**01**	**16-10-2024**	**45**	**AZ36**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**21-10-2024**	**F**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					18-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000477	4	Acceptable					21-10-2024			
59/5/2/_		**01**	**03-10-2024**	**27**	**AZ53**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**15-10-2024**	**F**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					04-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000368	4	Acceptable					15-10-2024			
60/5/2/_		**01**	**16-01-2025**	**141**	**AX 453**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**C1A**	**GTAW**	**BW**	**17-01-2025**	
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable					17-01-2025			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	001167	4	Acceptable					17-01-2025			

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Cons.	Accept. Date	Spool
60/5/2/_		**01**	**16-01-2025**	**141**	**AX 453**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**C1A**	**GTAW**	**BW**	**17-01-2025**	
61/5/2/_		**01**	**04-10-2024**	**29**	**AZ36**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**15-10-2024**	**F**
	1	VIS	FTP	FIT-UP and on weld	123A90-PML-QHSE-PRO-00103 Rev 00		SSANTUCCI	100 %	OK		Acceptable					07-10-2024			
		RT	FIN	Weld Completion	IDL-QCI-RT 0036 00		AA	100 %	000369	4	Acceptable					15-10-2024			
62/5/2/_		**01**	**07-10-2024**	**31**	**AZ35**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**15-10-2024**	**F**
	1	VIS	FTP	FIT-UP and on weld	123A90-PML-QHSE-PRO-00103 Rev 00		SSANTUCCI	100 %	OK		Acceptable					08-10-2024			
		RT	FIN	Weld Completion	IDL-QCI-RT 0036 00		AA	100 %	000370	4	Acceptable					15-10-2024			
63/5/2/_		**01**	**04-10-2024**	**29**	**AZ36**			**TEE**	**0,75 in**	**2,87 mm**	**V**	**0,083 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**15-10-2024**	**F**
	1	VIS	FTP	FIT-UP and on weld	123A90-PML-QHSE-PRO-00103 Rev 00		SSANTUCCI	100 %	OK		Acceptable					07-10-2024			
		RT	FIN	Weld Completion	IDL-QCI-RT 0036 00		AA	100 %	000362	4	Acceptable					15-10-2024			

Totals per DWG	**5**	**Prefabrication**	**2,24 m**	**23 Nr. Welds**	**22,25 inch**
		Erection	**0,60 m**	**6 Nr. Welds**	**6,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**2,84 m**	**29 Nr. Welds**	**28,25 inch**
		Accepted	**2,84 m**	**29 Nr. Welds**	**28,25 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Discipline		**Prefabrication**	**2,24 m**	**23 Nr. Welds**	**22,25 inch**
		Erection	**0,60 m**	**6 Nr. Welds**	**6,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**2,84 m**	**29 Nr. Welds**	**28,25 inch**
		Accepted	**2,84 m**	**29 Nr. Welds**	**28,25 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Project		**Prefabrication**	**2,24 m**	**23 Nr. Welds**	**22,25 inch**
		Erection	**0,60 m**	**6 Nr. Welds**	**6,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**2,84 m**	**29 Nr. Welds**	**28,25 inch**
		Accepted	**2,84 m**	**29 Nr. Welds**	**28,25 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**

Cliente/Contractor	**CROSSWIND**	Preparato da/Prepared by	Controllato da/Checked by	Approvato da/Approved by
SubContrattista/SubContractor	**ROSETTIMARINO/GROUPOFCOMPANY**	Nome/Name: Antonio Galesi	Nome/Name:	Nome/Name:
Progetto/Project	**Hollandse Kust Noord Wind Park Project**			
Commessa/Job	**123A90 - Piping**			
Disciplina/Discipline	**PIPING**			
TitoloDocumento/DocumentTitle	**Material Traceability Report**	StatoDocumento/Document Status:		Data/Date: 21/01/2025
RosettiDoc.Num.	**123A90MTR001**			

Sketch no.	Rev.	sheet	Spool	Piping Class	pos.	Q.ty (n° - m)	Description	Heat/Serial Number	PurchaseOrder	Pos. Order	Mat. Certificate	Weld Ref.	Note
5	01	2	E	03HSS	2	1	Tee Reducing BW ›1"x3/4" Thk.3.38mmx2.87mm ASTM A403 Gr.WP316/316L	1067621	1724000839	00560	1067621	W22-W23-W24	
5	01	2	E	03HSS	2	1	Tee Reducing BW ›1"x3/4" Thk.3.38mmx2.87mm ASTM A403 Gr.WP316/316L	1067621	1724000839	00560	1067621	W25-W26-W27	
5	01	2	E	03HSS	3	1	Tee BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	66A-SWJ011	1724000839	00480	T202318000110	W28-W30	
5	01	2	E	03HSS	5	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W31-W32	
5	01	2	E	03HSS	6	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DJ346	1724000839	01010	12/230039622/57/REV-00	W21	
5	01	2	E	03HSS	7	1	Flange WN ›3/4" Thk.2.87mm 300LB RF ASTM A182 Gr.F316/316L	A-5735	1724000839	00990	GLECO/J-1391-18	W23	
5	01	2	E	03HSS	7	1	Flange WN ›3/4" Thk.2.87mm 300LB RF ASTM A182 Gr.F316/316L	A-5735	1724000839	00990	GLECO/J-1391-18	W26	
5	01	2	E	03HSS	1J	0,754	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	2	E	03HSS	1K	0,25	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	2	E	03HSS	1L	0,1	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	2	E	03HSS	1M	0,1	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	2	E	03HSS	1N	0,685	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	2	F	03HSS	2	1	Tee Reducing BW ›1"x3/4" Thk.3.38mmx2.87mm ASTM A403 Gr.WP316/316L	1067621	1724000839	00560	1067621	W61-W62-W63	
5	01	2	F	03HSS	3	1	Tee BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	66A-SWJ011	1724000839	00480	T202318000110	W34-W52	
5	01	2	F	03HSS	3	1	Tee BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	66A-SWJ011	1724000839	00480	T202318000110	W53-W55	
5	01	2	F	03HSS	3	1	Tee BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	66A-SWJ011	1724000839	00480	T202318000110	W56-W58	
5	01	2	F	03HSS	3	1	Tee BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	66A-SWJ011	1724000839	00480	T202318000110	W59-W62	
5	01	2	F	03HSS	4	1	Cap BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	519724	1724000839	00190	519724	W61	
5	01	2	F	03HSS	5	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W35-W36	
5	01	2	F	03HSS	16	1	Nipple L=100mm TOE ›3/4" Thk.2,87mm ASTM A312 Gr.TP316/316L	SZ8	1724001267	00260	002978	W63	
5	01	2	F	03HSS	1O	0,956	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	2	F	03HSS	1P	0,774	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	2	F	03HSS	1V	2,439	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	2	F	03HSS	1W	3,924	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	2	F	03HSS	1X	3,924	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		

Rosetti Marino S.p.A.

Welding Register

Job	123A90	BASE LOAD POWER HUB (BLPH)			
From Discipline	PP	Piping			
To Discipline	PP	Piping			
Drawings		**From**	5	**To**	5
Sheet		**From**	3	**To**	3
Marks		**From**		**To**	
Location		**From**		**To**	
Material		**From**		**To**	
Welds Execution		**From**		**To**	
Welds Acceptance		**From**		**To**	
Report Date		**From**		**To**	
Prefabrication	All				
Welding Status	All				
ITEM					
ADDITIONAL PARAMETERS	**LINE**	**From**		**To**	
	SPOOL	**From**		**To**	
		From		**To**	

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Cons.	Accept. Date	Spool
38/5/3/_		**01**	**04-10-2024**	**29**	**AZ36**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**14-10-2024**	**G**
03HSS	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				07-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000332	4	Acceptable				14-10-2024				
39/5/3/_		**01**	**04-10-2024**	**29**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**14-10-2024**	**G**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				07-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000331	4	Acceptable				14-10-2024				
40/5/3/_		**01**	**11-10-2024**	**40-8**	**AZ36**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**06-12-2024**	**G**
					AX416	**After Cutting**													
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	RGARDINIT	100 %	OK		Acceptable				14-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000518	4	Acceptable				22-10-2024				
Cut 25-11-2024		VIS	C 1 DTA	After Cutting		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable D1A		GTAW		25-11-2024				
		RT	C 1 DTA	After Cutting		IDL-QCI-RT 0036 00	AA	100 %	001038	4	Acceptable				06-12-2024				
41/5/3/_		**01**	**15-11-2024**	**32**	**AX416**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**D1A**	**GTAW**	**BW**	**25-11-2024**	
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	IARRIGONIT	100 %	OK		Acceptable				16-11-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	001019	4	Acceptable				25-11-2024				
42/5/3/_		**01**	**03-10-2024**	**27**	**AZ53**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**14-10-2024**	**H**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000350	4	Acceptable				14-10-2024				
43/5/3/_		**01**	**03-10-2024**	**27**	**AZ53**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**07-10-2024**	**H**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000239	4	Acceptable				07-10-2024				
44/5/3/_		**01**	**03-12-2024**	**62**	**AX416**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**D1A**	**GTAW**	**BW**	**06-12-2024**	
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable				03-12-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	001039	4	Acceptable				06-12-2024				
45/5/3/_		**01**	**16-10-2024**	**45**	**AZ36**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**21-10-2024**	**H**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				18-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000478	4	Acceptable				21-10-2024				
46/5/3/_		**01**	**03-10-2024**	**27**	**AZ53**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**15-10-2024**	**H**

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Cons	Accept. Date	Spool
46/5/3/_		**01**	**03-10-2024**	**27**	**AZ53**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**15-10-2024**	**H**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					04-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000373	4	Acceptable					15-10-2024			
47/5/3/_		**01**	**16-01-2025**	**140**	**AX 453**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**C1A**	**GTAW**	**BW**	**17-01-2025**	
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable					17-01-2025			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	001168	4	Acceptable					17-01-2025			
48/5/3/_		**01**	**16-10-2024**	**45**	**AZ36**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**21-10-2024**	**H**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					18-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000479	4	Acceptable					21-10-2024			
49/5/3/_		**01**	**03-10-2024**	**27**	**AZ53**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**07-10-2024**	**H**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					04-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000240	4	Acceptable					07-10-2024			
50/5/3/_		**01**	**02-12-2024**	**61**	**AX416**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**D1A**	**GTAW**	**BW**	**06-12-2024**	
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable					03-12-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	001040	4	Acceptable					06-12-2024			
51/5/3/_		**01**	**07-10-2024**	**31**	**AZ35**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**15-10-2024**	**H**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					08-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000371	4	Acceptable					15-10-2024			
64/5/3/_		**01**	**07-10-2024**	**31**	**AZ35**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**15-10-2024**	**H**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					08-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000372	4	Acceptable					15-10-2024			
65/5/3/_		**01**	**04-10-2024**	**29**	**AZ36**			**TEE**	**0,75 in**	**2,87 mm**	**V**	**0,083 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**15-10-2024**	**H**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					07-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000363	4	Acceptable					15-10-2024			

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number		Rev.	Prod. Date	Prod. Sheet	Welders		Item type	Dimension	Thickness	Bevel	Weld Length	P/M	Material	WPS	Techn. Weld.	Type Conn	Accept. Date	Spool
Class	Insp. Category	Cont.	Examination phase		Work Instructions	Oper.	Exam. %	N. Rep	Films n.	Result	WPS Rip.	Techn. Weld.	Defect length	CND date	NOTE			
65/5/3/_		01	04-10-2024	29	AZ36		TEE	0,75 in	2,87 mm	V	0,083 m	P	S.S.	C1A	GTAW	BW	15-10-2024	H

Totals per DWG	**5**	**Prefabrication**	**1,18 m**	**12 Nr. Welds**	**11,75 inch**
		Erection	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**1,58 m**	**16 Nr. Welds**	**15,75 inch**
		Accepted	**1,58 m**	**16 Nr. Welds**	**15,75 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Discipline		**Prefabrication**	**1,18 m**	**12 Nr. Welds**	**11,75 inch**
		Erection	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**1,58 m**	**16 Nr. Welds**	**15,75 inch**
		Accepted	**1,58 m**	**16 Nr. Welds**	**15,75 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Project		**Prefabrication**	**1,18 m**	**12 Nr. Welds**	**11,75 inch**
		Erection	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**1,58 m**	**16 Nr. Welds**	**15,75 inch**
		Accepted	**1,58 m**	**16 Nr. Welds**	**15,75 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**

Cliente/Contractor	**CROSSWIND**	Preparato da/Prepared by	Controllato da/Checked by	Approvato da/Approved by
SubContrattista/SubContractor	**ROSETTIMARINO/GROUPOFCOMPANY**	Nome/Name: Antonio Galesi	Nome/Name:	Nome/Name:
Progetto/Project	**Hollandse Kust Noord Wind Park Project**			
Commessa/Job	**123A90 - Piping**			
Disciplina/Discipline	**PIPING**			
TitoloDocumento/DocumentTitle	**Material Traceability Report**	StatoDocumento/Document Status:		Data/Date: 21/01/2025
RosettiDoc.Num.	**123A90MTR001**			

Sketch no.	Rev.	sheet	Spool	Piping Class	pos.	Q.ty (n° - m)	Description	Heat/Serial Number	PurchaseOrder	Pos. Order	Mat. Certificate	Weld Ref.	Note
5	01	3	G	03HSS	4	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W38	
5	01	3	G	03HSS	4	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W39-W40	
5	01	3	G	03HSS	1Q	0,248	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	3	G	03HSS	1R	3,734	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	3	H	03HSS	2	1	Tee BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	66A-SWJ011	1724000839	00480	T202318000110	W43-W45	
5	01	3	H	03HSS	2	1	Tee BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	66A-SWJ011	1724000839	00480	T202318000110	W46-W48	
5	01	3	H	03HSS	2	1	Tee BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	66A-SWJ011	1724000839	00480	T202318000110	W49-W64	
5	01	3	H	03HSS	3	1	Cap BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	519724	1724000839	00190	519724	W51	
5	01	3	H	03HSS	4	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W42	
5	01	3	H	03HSS	5	1	Tee Reducing BW ›1"x3/4" Thk.3.38mmx2.87mm ASTM A403 Gr.WP316/316L	1067621	1724000839	00560	1067621	W51-W64-W65	
5	01	3	H	03HSS	6	1	Nipple L=100mm TOE ›3/4" Thk.2,87mm ASTM A312 Gr.TP316/316L	SZ8	1724001267	00260	002978	W65	
5	01	3	H	03HSS	1S	3,794	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	3	H	03HSS	1T	3,924	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	3	H	03HSS	1U	3,924	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		

Rosetti Marino S.p.A.

Welding Register

Job	123A90	BASE LOAD POWER HUB (BLPH)			
From Discipline	PP	Piping			
To Discipline	PP	Piping			
Drawings		**From**	9	**To**	9
Sheet		**From**	0	**To**	0
Marks		**From**		**To**	
Location		**From**		**To**	
Material		**From**		**To**	
Welds Execution		**From**		**To**	
Welds Acceptance		**From**		**To**	
Report Date		**From**		**To**	
Prefabrication	All				
Welding Status	All				
ITEM					
ADDITIONAL PARAMETERS	**LINE**	**From**		**To**	
	SPOOL	**From**	A	**To**	B
		From		**To**	

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Cont.	Accept. Date	Spool
1/9/1/_		**02**	**04-11-2024**	**62**	**AZ39**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**06-11-2024**	**A**
03HSS	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				05-11-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000821	4	Acceptable				06-11-2024				
2/9/1/_		**02**	**24-10-2024**	**53**	**AZ39**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**06-11-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				25-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000822	4	Acceptable				06-11-2024				
3/9/1/_		**02**	**28-10-2024**	**56**	**AZ39**			**FWN**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**02-11-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				29-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000738	4	Acceptable				02-11-2024				
4/9/1/_		**02**	**28-10-2024**	**56-69**	**AZ39**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**10-11-2024**	**B**
					AZ36	**After Cutting**													
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				29-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000739	4	Cut				02-11-2024				
Cut 05-11-2024		VIS	C 1 DTA	After Cutting		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable C1A				GTAW			07-11-2024	
		RT	C 1 DTA	After Cutting		IDL-QCI-RT 0036 00	AA	100 %	000890	4	Acceptable				10-11-2024				

Totals per DWG	**9**	**Prefabrication**	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Accepted	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Discipline		**Prefabrication**	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Accepted	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Project		**Prefabrication**	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Accepted	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**

CROSSWIND / ROSETTI MARINO	Cliente/Contractor	**CROSSWIND**	Preparato da/Prepared by	Controllato da/Checked by	Approvato da/Approved by
	SubContrattista/SubContractor	**ROSETTIMARINO/GROUPOFCOMPANY**	Nome/Name: Antonio Galesi	Nome/Name:	Nome/Name:
	Progetto/Project	**Hollandse Kust Noord Wind Park Project**			
	Commessa/Job	**123A90 - Piping**			
	Disciplina/Discipline	**PIPING**			
	TitoloDocumento/DocumentTitle	**Material Traceability Report**	StatoDocumento/Document Status:		Data/Date: 21/01/2025
	RosettiDoc.Num.	**123A90MTR001**			

Sketch no.	Rev.	sheet	Spool	Piping Class	pos.	Q.ty (n° - m)	Description	Heat/Serial Number	PurchaseOrder	Pos. Order	Mat. Certificate	Weld Ref.	Note
9	02	1	A	03HSS	4	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	1519623	1724000839	00270	1519623	W1-W2	
9	02	1	A	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W2	
9	02	1	A	03HSS	1A	0,79	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
9	02	1	B	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W3	
9	02	1	B	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W4	
9	02	1	B	03HSS	1B	0,092	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		

Rosetti Marino S.p.A.

Welding Register

Job	123A90	BASE LOAD POWER HUB (BLPH)			
From Discipline	PP	Piping			
To Discipline	PP	Piping			
Drawings		**From**	10	**To**	10
Sheet		**From**	0	**To**	0
Marks		**From**		**To**	
Location		**From**		**To**	
Material		**From**		**To**	
Welds Execution		**From**		**To**	
Welds Acceptance		**From**		**To**	
Report Date		**From**		**To**	
Prefabrication	All				
Welding Status	All				
ITEM					
ADDITIONAL PARAMETERS	**LINE**	**From**		**To**	
	SPOOL	**From**	A	**To**	B
		From		**To**	

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Cons.	Accept. Date	Spool
1/10/1/_		**02**	**04-11-2024**	**62**	**AZ39**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**06-11-2024**	**A**
03HSS	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				05-11-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000824	4	Acceptable				06-11-2024				
2/10/1/_		**02**	**24-10-2024**	**53**	**AZ39**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**06-11-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				25-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000823	4	Acceptable				06-11-2024				
3/10/1/_		**02**	**28-10-2024**	**56**	**AZ39**			**FWN**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**02-11-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				29-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000740	4	Acceptable				02-11-2024				
4/10/1/_		**02**	**28-10-2024**	**56**	**AZ39**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**02-11-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				29-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000741	4	Acceptable				02-11-2024				

Totals per DWG	**10**	**Prefabrication**	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Accepted	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Discipline		**Prefabrication**	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Accepted	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Project		**Prefabrication**	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Accepted	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**

Cliente/Contractor	**CROSSWIND**	Preparato da/Prepared by	Controllato da/Checked by	Approvato da/Approved by
SubContrattista/SubContractor	**ROSETTIMARINO/GROUPOFCOMPANY**	Nome/Name:	Nome/Name:	Nome/Name:
Progetto/Project	**Hollandse Kust Noord Wind Park Project**			
Commessa/Job	**123A90 - Piping**			
Disciplina/Discipline	**PIPING**	Antonio Galesi		
TitoloDocumento/DocumentTitle	**Material Traceability Report**	StatoDocumento/Document Status:		Data/Date:
RosettiDoc.Num.	**123A90MTR001**			21/01/2025

Sketch no.	Rev.	sheet	Spool	Piping Class	pos.	Q.ty (n° - m)	Description	Heat/Serial Number	PurchaseOrder	Pos. Order	Mat. Certificate	Weld Ref.	Note
10	02	1	A	03HSS	4	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	1519623	1724000839	00270	1519623	W1-W2	
10	02	1	A	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W2	
10	02	1	A	03HSS	1A	0,79	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
10	02	1	B	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W3	
10	02	1	B	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W4	
10	02	1	B	03HSS	1B	0,092	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		

Rosetti Marino S.p.A.

Welding Register

Job	123A90	BASE LOAD POWER HUB (BLPH)			
From Discipline	PP	Piping			
To Discipline	PP	Piping			
Drawings		**From**	11	**To**	11
Sheet		**From**	0	**To**	0
Marks		**From**		**To**	
Location		**From**		**To**	
Material		**From**		**To**	
Welds Execution		**From**		**To**	
Welds Acceptance		**From**		**To**	
Report Date		**From**		**To**	
Prefabrication	All				
Welding Status	All				
ITEM					
ADDITIONAL PARAMETERS	**LINE**	**From**		**To**	
	SPOOL	**From**	A	**To**	B
		From		**To**	

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Cons	Accept. Date	Spool
1/11/1/_		**02**	**04-11-2024**	**62**	**AZ39**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**11-11-2024**	**A**
03HSS	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				05-11-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000949	4	Acceptable				11-11-2024				
2/11/1/_		**02**	**24-10-2024**	**53**	**AZ39**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**06-11-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				25-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000826	4	Acceptable				06-11-2024				
3/11/1/_		**02**	**28-10-2024**	**56**	**AZ39**			**FWN**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**02-11-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				29-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000742	4	Acceptable				02-11-2024				
4/11/1/_		**02**	**28-10-2024**	**56**	**AZ39**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**02-11-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				29-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000743	4	Acceptable				02-11-2024				

Totals per DWG	**11**	**Prefabrication**	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Accepted	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Discipline		**Prefabrication**	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Accepted	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Project		**Prefabrication**	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Accepted	**0,40 m**	**4 Nr. Welds**	**4,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**

Cliente/Contractor	**CROSSWIND**	Preparato da/Prepared by	Controllato da/Checked by	Approvato da/Approved by
SubContrattista/SubContractor	**ROSETTIMARINO/GROUPOFCOMPANY**	Nome/Name:	Nome/Name:	Nome/Name:
Progetto/Project	**Hollandse Kust Noord Wind Park Project**			
Commessa/Job	**123A90 - Piping**			
Disciplina/Discipline	**PIPING**	Antonio Galesi		
TitoloDocumento/DocumentTitle	**Material Traceability Report**	StatoDocumento/Document Status:		Data/Date:
RosettiDoc.Num.	**123A90MTR001**			21/01/2025

Sketch no.	Rev.	sheet	Spool	Piping Class	pos.	Q.ty (n° - m)	Description	Heat/Serial Number	PurchaseOrder	Pos. Order	Mat. Certificate	Weld Ref.	Note
11	02	1	A	03HSS	4	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	1519623	1724000839	00270	1519623	W1-W2	
11	02	1	A	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W2	
11	02	1	A	03HSS	1A	0,79	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
11	02	1	B	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W3	
11	02	1	B	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W4	
11	02	1	B	03HSS	1B	0,118	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		

Rosetti Marino S.p.A.

Welding Register

Job	123A90	BASE LOAD POWER HUB (BLPH)			
From Discipline	PP	Piping			
To Discipline	PP	Piping			
Drawings		**From**	12	**To**	12
Sheet		**From**	0	**To**	0
Marks		**From**		**To**	
Location		**From**		**To**	
Material		**From**		**To**	
Welds Execution		**From**		**To**	
Welds Acceptance		**From**		**To**	
Report Date		**From**		**To**	
Prefabrication	All				
Welding Status	All				
ITEM					
ADDITIONAL PARAMETERS	**LINE**	**From**		**To**	
	SPOOL	**From**	A	**To**	B
		From		**To**	

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Cont.	Accept. Date	Spool
1/12/1/_		**02**	**04-11-2024**	**67**	**AZ39**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**06-11-2024**	**A**
03HSS	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				06-11-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000830	4	Acceptable				06-11-2024				
2/12/1/_		**02**	**28-10-2024**	**56**	**AZ36**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**30-10-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				29-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000707	4	Acceptable				30-10-2024				
3/12/1/_		**02**	**28-10-2024**	**56**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**30-10-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				29-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000708	4	Acceptable				30-10-2024				
4/12/1/_		**02**	**30-10-2024**	**59**	**AZ36**			**FWN**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**09-11-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-11-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000847	4	Acceptable				09-11-2024				
5/12/1/_		**02**	**30-10-2024**	**59**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**09-11-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-11-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000848	4	Acceptable				09-11-2024				

Totals per DWG	**12**	**Prefabrication**	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Accepted	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Discipline		**Prefabrication**	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Accepted	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Project		**Prefabrication**	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Accepted	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**

Cliente/Contractor	**CROSSWIND**	Preparato da/Prepared by	Controllato da/Checked by	Approvato da/Approved by
SubContrattista/SubContractor	**ROSETTIMARINO/GROUPOFCOMPANY**	Nome/Name: Antonio Galesi	Nome/Name:	Nome/Name:
Progetto/Project	**Hollandse Kust Noord Wind Park Project**			
Commessa/Job	**123A90 - Piping**			
Disciplina/Discipline	**PIPING**			
TitoloDocumento/DocumentTitle	**Material Traceability Report**	StatoDocumento/Document Status:		Data/Date: 21/01/2025
RosettiDoc.Num.	**123A90MTR001**			

Sketch no.	Rev.	sheet	Spool	Piping Class	pos.	Q.ty (n° - m)	Description	Heat/Serial Number	PurchaseOrder	Pos. Order	Mat. Certificate	Weld Ref.	Note
12	02	1	A	03HSS	4	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	1519623	1724000839	00270	1519623	W1-W2	
12	02	1	A	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W3	
12	02	1	A	03HSS	1A	0,1	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
12	02	1	A	03HSS	1B	0,516	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
12	02	1	B	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W4	
12	02	1	B	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W5	
12	02	1	B	03HSS	1C	0,426	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		

Welding Register

Job	123A90	BASE LOAD POWER HUB (BLPH)			
From Discipline	PP	Piping			
To Discipline	PP	Piping			
Drawings		**From**	13	**To**	13
Sheet		**From**	0	**To**	0
Marks		**From**		**To**	
Location		**From**		**To**	
Material		**From**		**To**	
Welds Execution		**From**		**To**	
Welds Acceptance		**From**		**To**	
Report Date		**From**		**To**	
Prefabrication	All				
Welding Status	All				
ITEM					
ADDITIONAL PARAMETERS	**LINE**	**From**		**To**	
	SPOOL	**From**	A	**To**	B
		From		**To**	

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders / Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material	WPS / Defect length	Techn. Weld. / CND date	Type Conn / NOTE	Accept. Date	Spool
1/13/1/_		**02**	**04-11-2024**	**62-30**	**AZ36**		**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**17-01-2025**	**A**
					AX 453	**After Cutting**												
03HSS	1	VIS	FTP	FIT-UP and on weld	123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 % OK			Acceptable					05-11-2024			
		RT	FIN	Weld Completion	IDL-QCI-RT 0036 00	AA	100 % 000950	4		Acceptable					11-11-2024			
Cut 16-01-2025		VIS	C 1 DTA	After Cutting	123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 % OK			Acceptable C1A		GTAW			17-01-2025			
		RT	C 1 DTA	After Cutting	IDL-QCI-RT 0036 00	PR	100 % 001169	4		Acceptable					17-01-2025			
2/13/1/_		**02**	**28-10-2024**	**56**	**AZ36**		**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**30-10-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld	123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 % OK			Acceptable					29-10-2024			
		RT	FIN	Weld Completion	IDL-QCI-RT 0036 00	PR	100 % 000713	4		Acceptable					30-10-2024			
3/13/1/_		**02**	**28-10-2024**	**56**	**AZ36**		**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**30-10-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld	123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 % OK			Acceptable					29-10-2024			
		RT	FIN	Weld Completion	IDL-QCI-RT 0036 00	PR	100 % 000714	4		Acceptable					30-10-2024			
4/13/1/_		**02**	**30-10-2024**	**59**	**AZ36**		**FWN**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**09-11-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld	123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 % OK			Acceptable					04-11-2024			
		RT	FIN	Weld Completion	IDL-QCI-RT 0036 00	AA	100 % 000849	4		Acceptable					09-11-2024			
5/13/1/_		**02**	**30-10-2024**	**59**	**AZ36**		**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**09-11-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld	123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 % OK			Acceptable					04-11-2024			
		RT	FIN	Weld Completion	IDL-QCI-RT 0036 00	AA	100 % 000850	4		Acceptable					09-11-2024			

Totals per DWG	**13**	**Prefabrication**	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Accepted	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Discipline		**Prefabrication**	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Accepted	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number		Rev.	Prod. Date	Prod. Sheet	Welders		Item type	Dimension	Thickness	Bevel	Weld Length	P/M	Material	WPS	Techn. Weld.	Type Conn	Accept. Date	Spool
Class	Insp. Category	Cont.	Examination phase		Work Instructions	Oper.	Exam. %	N. Rep	Films n.	Result	WPS Rip.	Techn. Weld.		Defect length	CND date	NOTE		
5/13/1/_		**02**	**30-10-2024**	**59**	**AZ36**		**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**09-11-2024**	**B**

Totals by Project			
Prefabrication	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Performed	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
Accepted	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**

CROSSWIND / ROSETTI MARINO	Cliente/Contractor: CROSSWIND	Preparato da/Prepared by	Controllato da/Checked by
	SubContrattista/SubContractor: ROSETTIMARINO/GROUPOFCOMPANY	Nome/Name: Antonio Galesi	Nome/Name:
	Progetto/Project: Hollandse Kust Noord Wind Park Project		Approvato da/Approved by
	Commessa/Job: 123A90 - Piping		Nome/Name:
	Disciplina/Discipline: PIPING		
	TitoloDocumento/DocumentTitle: Material Traceability Report	StatoDocumento/Document Status:	Data/Date: 21/01/2025
	RosettiDoc.Num.: 123A90MTR001		

Sketch no.	Rev.	sheet	Spool	Piping Class	pos.	Q.ty (n° - m)	Description	Heat/Serial Number	PurchaseOrder	Pos. Order	Mat. Certificate	Weld Ref.	Note
13	02	1	A	03HSS	4	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W1-W2	
13	02	1	A	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W3	
13	02	1	A	03HSS	1A	0,1	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
13	02	1	A	03HSS	1B	0,516	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
13	02	1	B	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W4	
13	02	1	B	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W5	
13	02	1	B	03HSS	1C	0,426	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		

Rosetti Marino S.p.A.

Welding Register

Job	123A90	BASE LOAD POWER HUB (BLPH)			
From Discipline	PP	Piping			
To Discipline	PP	Piping			
Drawings		**From**	14	**To**	14
Sheet		**From**	0	**To**	0
Marks		**From**		**To**	
Location		**From**		**To**	
Material		**From**		**To**	
Welds Execution		**From**		**To**	
Welds Acceptance		**From**		**To**	
Report Date		**From**		**To**	
Prefabrication	All				
Welding Status	All				
ITEM					
ADDITIONAL PARAMETERS	**LINE**	**From**		**To**	
	SPOOL	**From**	A	**To**	B
		From		**To**	

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Cont.	Accept. Date	Spool
1/14/1/_		**02**	**29-10-2024**	**58**	**AZ39**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**03-11-2024**	**A**
03HSS	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				30-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000794	4	Acceptable				03-11-2024				
2/14/1/_		**02**	**30-10-2024**	**59**	**AZ36**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**10-11-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-11-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000899	4	Acceptable				10-11-2024				
3/14/1/_		**02**	**29-10-2024**	**58**	**AZ39**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**03-11-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				30-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000795	4	Acceptable				03-11-2024				
4/14/1/_		**02**	**29-10-2024**	**58**	**AZ39**			**FWN**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**09-11-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				30-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000851	4	Acceptable				09-11-2024				
5/14/1/_		**02**	**29-10-2024**	**58**	**AZ39**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**09-11-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				30-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000852	4	Acceptable				09-11-2024				

Totals per DWG	**14**	**Prefabrication**	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Accepted	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Discipline		**Prefabrication**	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Accepted	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Project		**Prefabrication**	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Accepted	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**

Cliente/Contractor	**CROSSWIND**	Preparato da/Prepared by	Controllato da/Checked by	Approvato da/Approved by
SubContrattista/SubContractor	**ROSETTIMARINO/GROUPOFCOMPANY**	Nome/Name: Antonio Galesi	Nome/Name:	Nome/Name:
Progetto/Project	**Hollandse Kust Noord Wind Park Project**			
Commessa/Job	**123A90 - Piping**			
Disciplina/Discipline	**PIPING**			
TitoloDocumento/DocumentTitle	**Material Traceability Report**	StatoDocumento/Document Status:		Data/Date: 21/01/2025
RosettiDoc.Num.	**123A90MTR001**			

Sketch no.	Rev.	sheet	Spool	Piping Class	pos.	Q.ty (n° - m)	Description	Heat/Serial Number	PurchaseOrder	Pos. Order	Mat. Certificate	Weld Ref.	Note
14	02	1	A	03HSS	4	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W1-W2	
14	02	1	A	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W3	
14	02	1	A	03HSS	1A	0,1	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
14	02	1	A	03HSS	1B	0,516	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
14	02	1	B	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W4	
14	02	1	B	03HSS	5	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W5	
14	02	1	B	03HSS	1C	0,426	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		

Rosetti Marino S.p.A.

Welding Register

Job	123A90	BASE LOAD POWER HUB (BLPH)			
From Discipline	PP	Piping			
To Discipline	PP	Piping			
Drawings		**From**	56	**To**	56
Sheet		**From**	0	**To**	0
Marks		**From**		**To**	
Location		**From**		**To**	
Material		**From**		**To**	
Welds Execution		**From**		**To**	
Welds Acceptance		**From**		**To**	
Report Date		**From**		**To**	
Prefabrication	All				
Welding Status	All				
ITEM					
ADDITIONAL PARAMETERS	**LINE**	**From**		**To**	
	SPOOL	**From**		**To**	
		From		**To**	

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Conn	Accept. Date	Spool
1/56/1/_		**02**	**21-10-2024**	**49**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**28-10-2024**	**A**
03HSS	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				22-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000629	4	Acceptable				28-10-2024				
2/56/1/_		**02**	**21-10-2024**	**49**	**AZ36**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**28-10-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				22-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000630	4	Acceptable				28-10-2024				
3/56/1/_		**02**	**21-10-2024**	**49**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**28-10-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				22-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000631	4	Acceptable				28-10-2024				
4/56/1/_		**02**	**29-10-2024**	**58**	**AZ36**			**FWN**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**10-11-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				30-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000909	4	Acceptable				10-11-2024				
5/56/1/_		**02**	**29-10-2024**	**58**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**10-11-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				30-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000910	4	Acceptable				10-11-2024				
6/56/1/_		**02**	**30-10-2024**	**59**	**AZ36**			**FWN**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**09-11-2024**	**C**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-11-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000865	4	Acceptable				09-11-2024				
7/56/1/_		**02**	**30-10-2024**	**59**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**09-11-2024**	**C**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-11-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000866	4	Acceptable				09-11-2024				
8/56/1/_		**02**	**30-10-2024**	**59**	**AZ36**			**FWN**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**09-11-2024**	**D**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-11-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000867	4	Acceptable				09-11-2024				
9/56/1/_		**02**	**30-10-2024**	**59**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**09-11-2024**	**D**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-11-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000868	4	Acceptable				09-11-2024				

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number	Rev.	Prod. Date	Prod. Sheet	Welders	Item type	Dimension	Thickness	Bevel	Weld Length	P/M	Material	WPS	Techn. Weld.	Type Conn	Accept. Date	Spool
Class	Insp. Category	Cont.	Examination phase	Work Instructions	Oper.	Exam. %	N. Rep	Films n.	Result	WPS Rip.	Techn. Weld.	Defect length	CND date	NOTE		
9/56/1/_		**02**	**30-10-2024**	**59**	**AZ36**	**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**09-11-2024**	**D**

Totals per DWG	**56**	**Prefabrication**	**0,90 m**	**9 Nr. Welds**	**9,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,90 m**	**9 Nr. Welds**	**9,00 inch**
		Accepted	**0,90 m**	**9 Nr. Welds**	**9,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Discipline		**Prefabrication**	**0,90 m**	**9 Nr. Welds**	**9,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,90 m**	**9 Nr. Welds**	**9,00 inch**
		Accepted	**0,90 m**	**9 Nr. Welds**	**9,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Project		**Prefabrication**	**0,90 m**	**9 Nr. Welds**	**9,00 inch**
		Erection	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**0,90 m**	**9 Nr. Welds**	**9,00 inch**
		Accepted	**0,90 m**	**9 Nr. Welds**	**9,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**

Cliente/Contractor	**CROSSWIND**	Preparato da/Prepared by	Controllato da/Checked by	Approvato da/Approved by
SubContrattista/SubContractor	**ROSETTIMARINO/GROUPOFCOMPANY**	Nome/Name:	Nome/Name:	Nome/Name:
Progetto/Project	**Hollandse Kust Noord Wind Park Project**			
Commessa/Job	**123A90 - Piping**			
Disciplina/Discipline	**PIPING**	Antonio Galesi		
TitoloDocumento/DocumentTitle	**Material Traceability Report**	StatoDocumento/Document Status:		Data/Date:
RosettiDoc.Num.	**123A90MTR001**			21/01/2025

Sketch no.	Rev.	sheet	Spool	Piping Class	pos.	Q.ty (n° - m)	Description	Heat/Serial Number	PurchaseOrder	Pos. Order	Mat. Certificate	Weld Ref.	Note
56	02	1	A	03HSS	2	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W1-W2	
56	02	1	A	03HSS	3	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W3	
56	02	1	A	03HSS	1A	0,224	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
56	02	1	A	03HSS	1B	0,1	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
56	02	1	B	03HSS	3	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W4	
56	02	1	B	03HSS	3	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W5	
56	02	1	B	03HSS	1C	0,093	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
56	02	1	C	03HSS	3	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W6	
56	02	1	C	03HSS	4	1	Flange WN For Jackscrews ›1" Thk.3,38mm 300LB RF ASTM A182 Gr.F316/316L	S-27133	1724001267	00160	IND.21.6268/QM/U	W7	
56	02	1	C	03HSS	1D	0,319	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
56	02	1	D	03HSS	3	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W8	
56	02	1	D	03HSS	3	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DL364	1724000839	01010	12/230044598/27/REV-00	W9	
56	02	1	D	03HSS	1E	0,168	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		

8. PIPING & VESSEL PRE-COMMISSIONING CONFORMITY CHECKS & TESTS:

8.1 CLX02A - Pipework Before test

8.2 CLX02B - Pipework After Test

8.3 CXX01 - Thermal insulation – NOT APPLICABLE

8.4 CXX02 – Painting Line

8.5 TMX03 – Cleaning

8.6 TMX05 – Pressure test

8.7 TMX25 – Gross Air Leak Test

8.8 TMX27 – Bolt Tensioning / Torquing

8.9 TPLX05 - Drying

ITEM	Tag	25-07-TP-007	: Test Pack 25-07-TP-007			Dwg	123A90-DDL-PR-PID-80011
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003284		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity STS	Discipline	Piping	Form	TPLX05 Drying


1	Drying out method :	Drying with dry air.
2	Operation description :	Dried the system using a flow of dry air, ensuring all drains/vents (when present) were open to facilitate the removal of moisture. Continued the drying until no moisture remained in the system, particularly in areas that were difficult to reach. After drying, inlet and outlet points were closed with covers.
3	Temporary means :	Blind flanges and plugs, if necessary, to isolate inlet and outlet points during process. Covers to close all openings after the drying.
4	Dew point (obtain after soaking and nitrogen purging):	NA
5	Valve body cavity, branches, etc.. Have been drained form residual water	●
	Attachments	
6	Procedures	
7	Sketches and drawings	
8	Pressure records	
9	Records of failures	
10	SAFETY PRECAUTIONS:	Restricting access to the area.
11	REMARKS:	None.

Page 1/1	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM (ROSETTI MARINO)	
Name	Emanuele Delfino	Massimo Bruschi	
Date	2025-01-21	2025-01-21	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-21T08:18:12.625Z	PROVERLIS Digitaly signed by Massimo Bruschi 2025-01-21T17:45:57.463Z	

ITEM	Tag	009-1-J1	: Joint 009-1-J1			Dwg	123A90-FDL-PP-DI-00009-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003836		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 — Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	T064079 / RA00598
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes


4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-24	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:51:05.413Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-24T08:19:59.318Z	

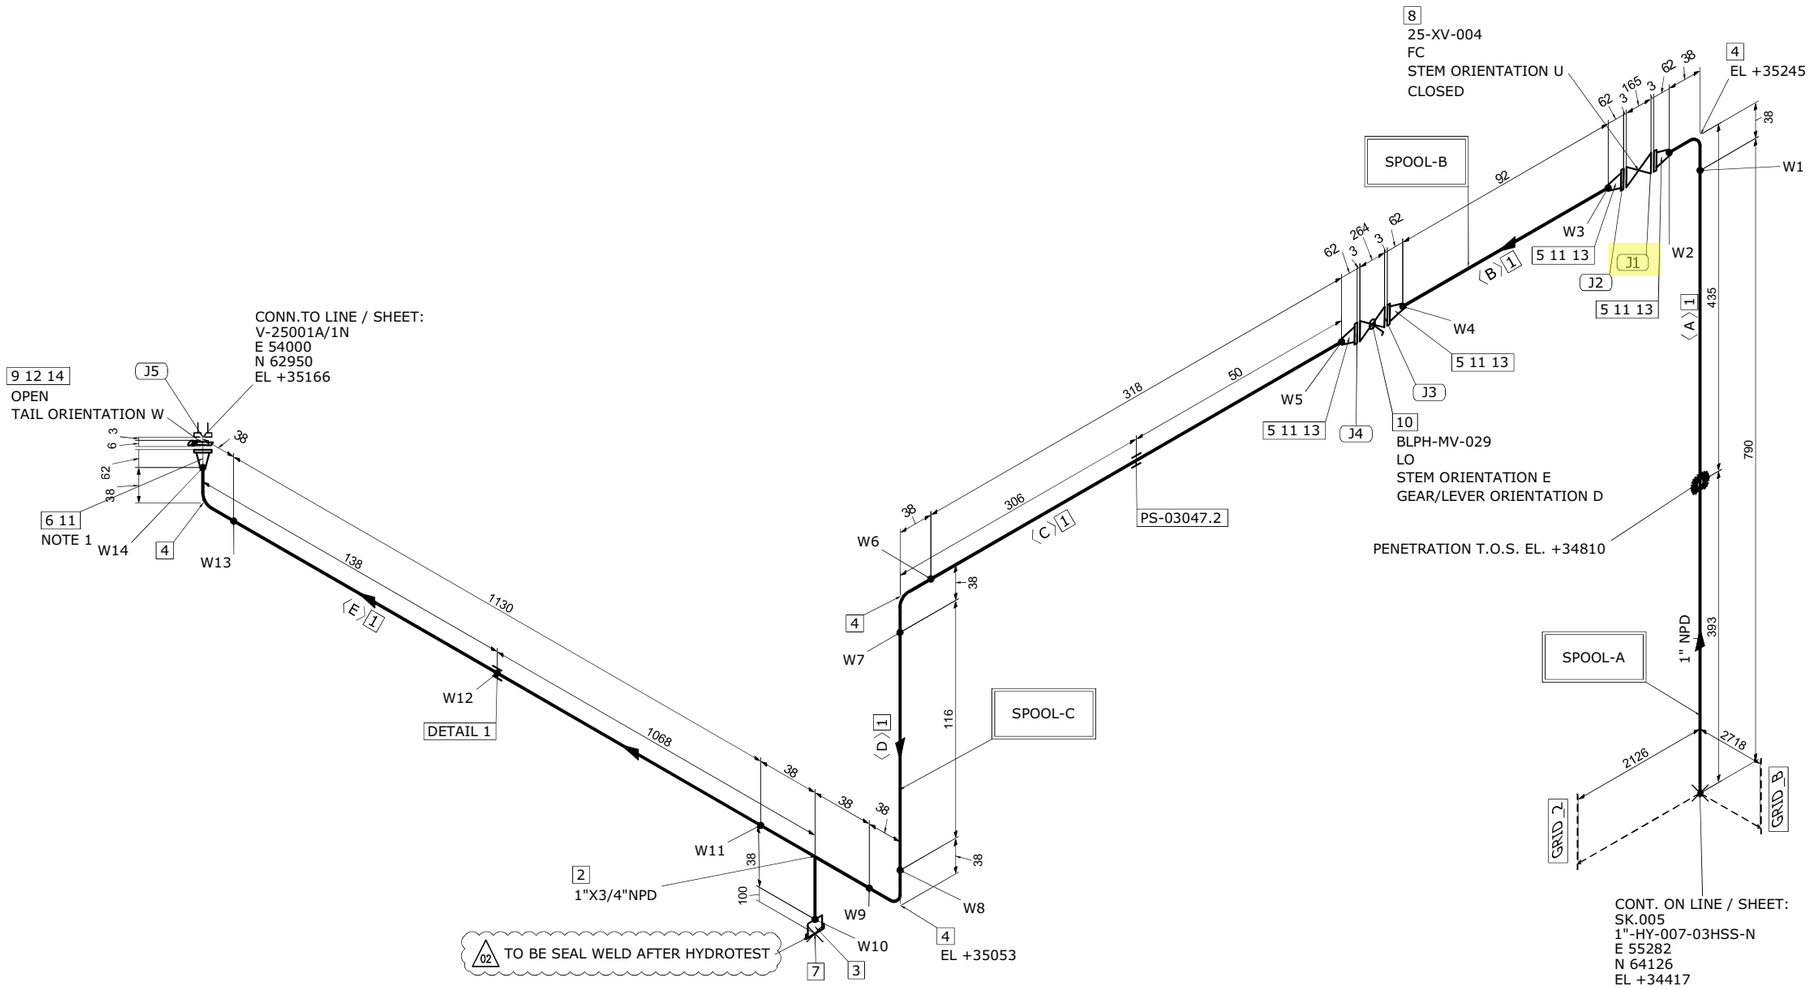

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.4M	6.2
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.4
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.2

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	3/4	BW
W11	1	BW
W12		FW
W13	1	BW
W14	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	790	BEVEL	BEVEL
B	1	92	BEVEL	BEVEL
C	1	318	BEVEL	BEVEL
D	1	116	BEVEL	BEVEL
E	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-03047.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	2	4.0
B	2	3.9
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-015-03HSS-N

SK.009


LINE DATA								
NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		

REFERENCE DOCUMENTS	
P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES
1.JACKSCREWS POSITION N/S

MASTER


CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE	N/A
DRAWN	STAFF SRL
CHECKED	RT
APPROVED	LM
DATE	17-09-2024
FORMAT	A3
DRAWING NO.	123A90-FDL-PP-DI-00009
SHEET / OF	1/1
REV.	02

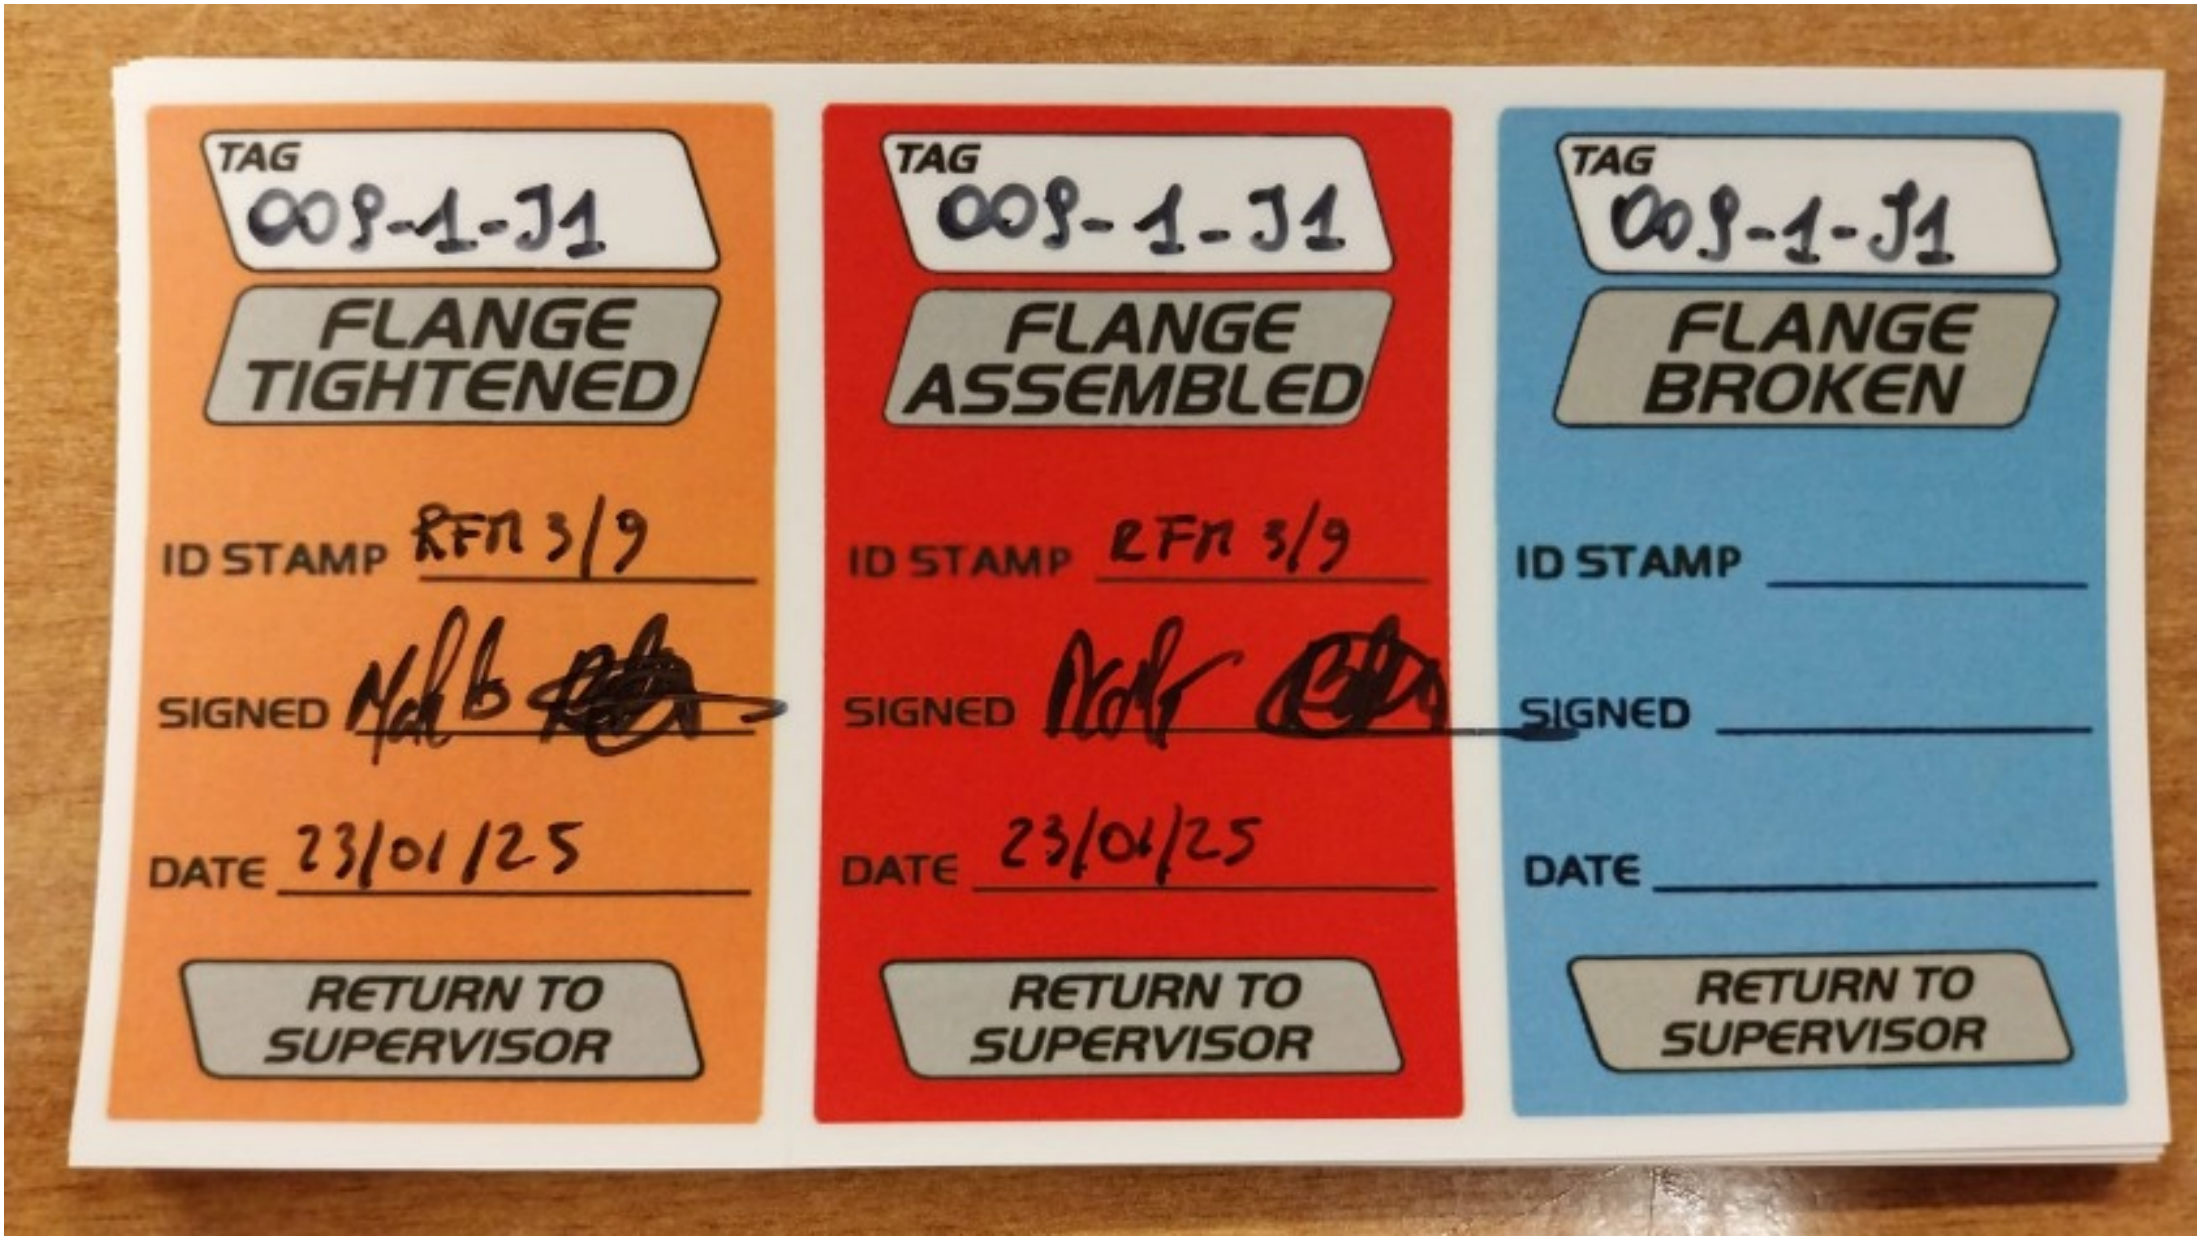
TAG
008-1-J1
FLANGE TIGHTENED
ID STAMP RFN 3/9
SIGNED
DATE 23/01/25
RETURN TO SUPERVISOR
TAG
008-1-J1
FLANGE ASSEMBLED
ID STAMP RFN 3/9
SIGNED
DATE 23/01/25
RETURN TO SUPERVISOR
TAG
008-1-J1
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	009-1-J2	: Joint 009-1-J2		Dwg	123A90-FDL-PP-DI-00009-01	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10003837	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity PIP	Discipline Piping	Form	TMX27	Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	T064079 / RA00598
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes


4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-24	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:51:21.569Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-24T08:20:28.738Z	

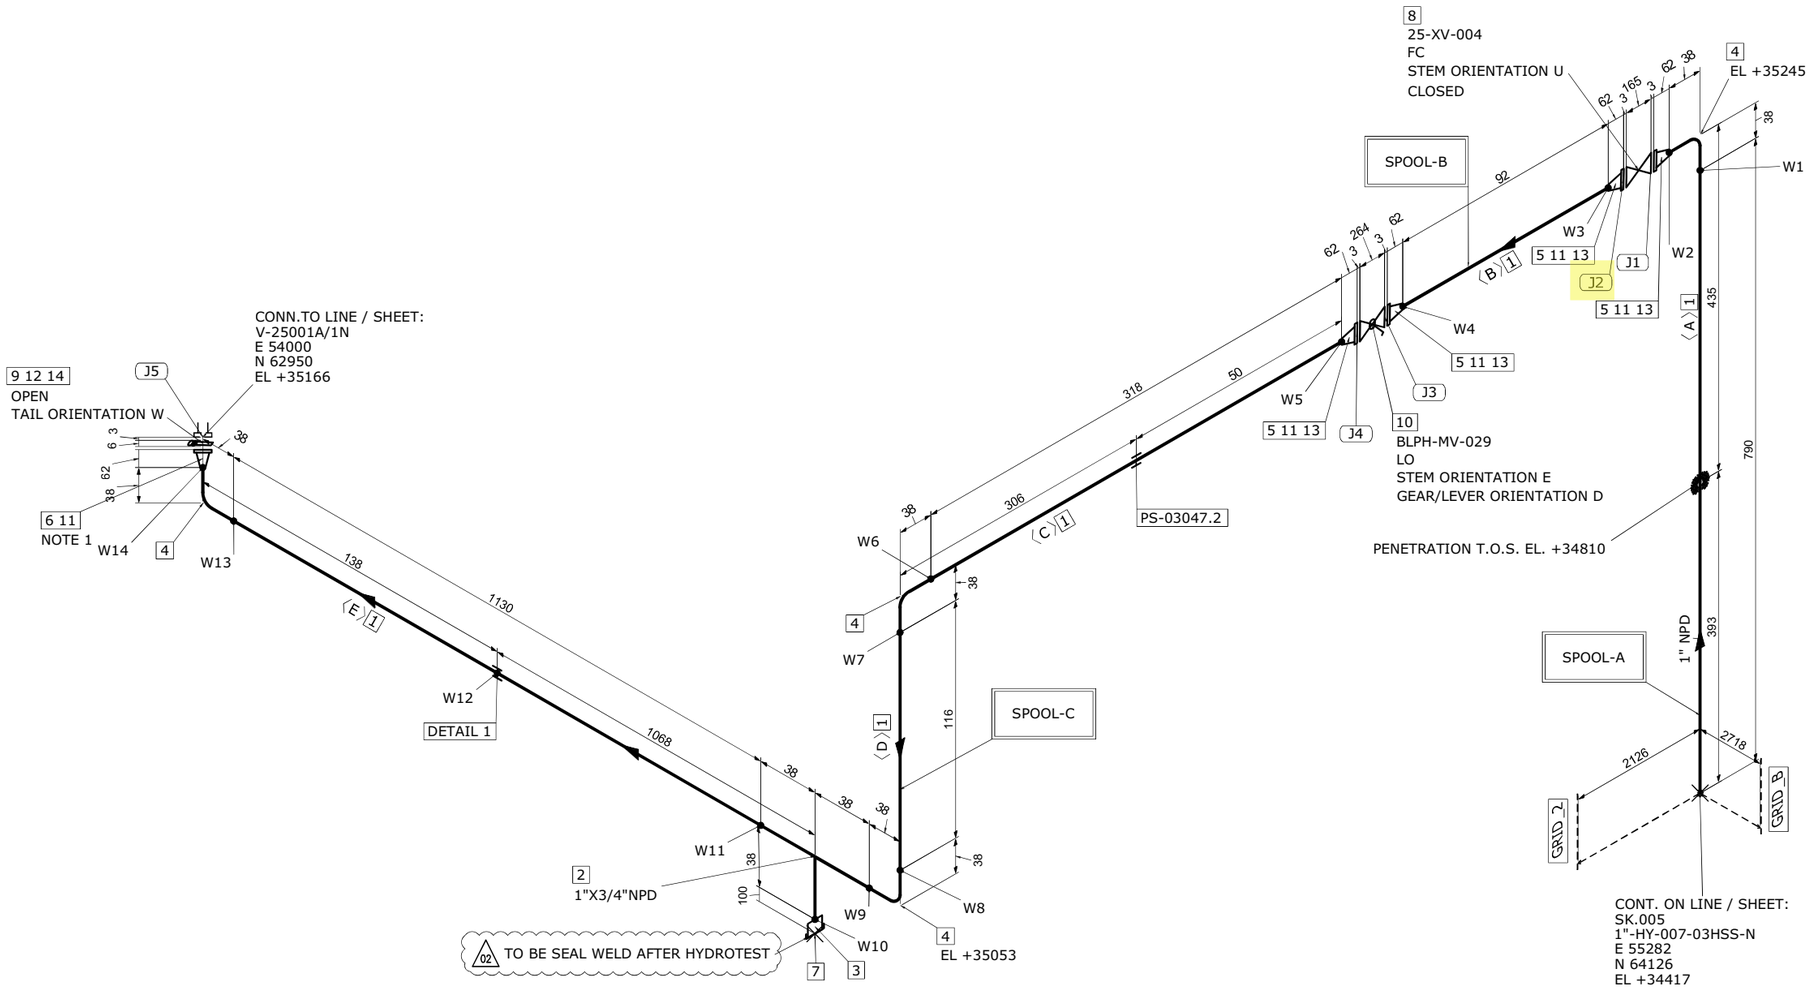

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.4M	6.2
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.4
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.2

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	3/4	BW
W11	1	BW
W12		FW
W13	1	BW
W14	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	790	BEVEL	BEVEL
B	1	92	BEVEL	BEVEL
C	1	318	BEVEL	BEVEL
D	1	116	BEVEL	BEVEL
E	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-03047.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	2	4.0
B	2	3.9
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-015-03HSS-N

SK.009


LINE DATA								
NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		

REFERENCE DOCUMENTS	
P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES
1.JACKSCREWS POSITION N/S

MASTER


CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE	N/A
DRAWN	STAFF SRL
CHECKED	RT
APPROVED	LM
DATE	17-09-2024
FORMAT	A3
DRAWING NO.	123A90-FDL-PP-DI-00009
SHEET / OF	1/1
REV.	02

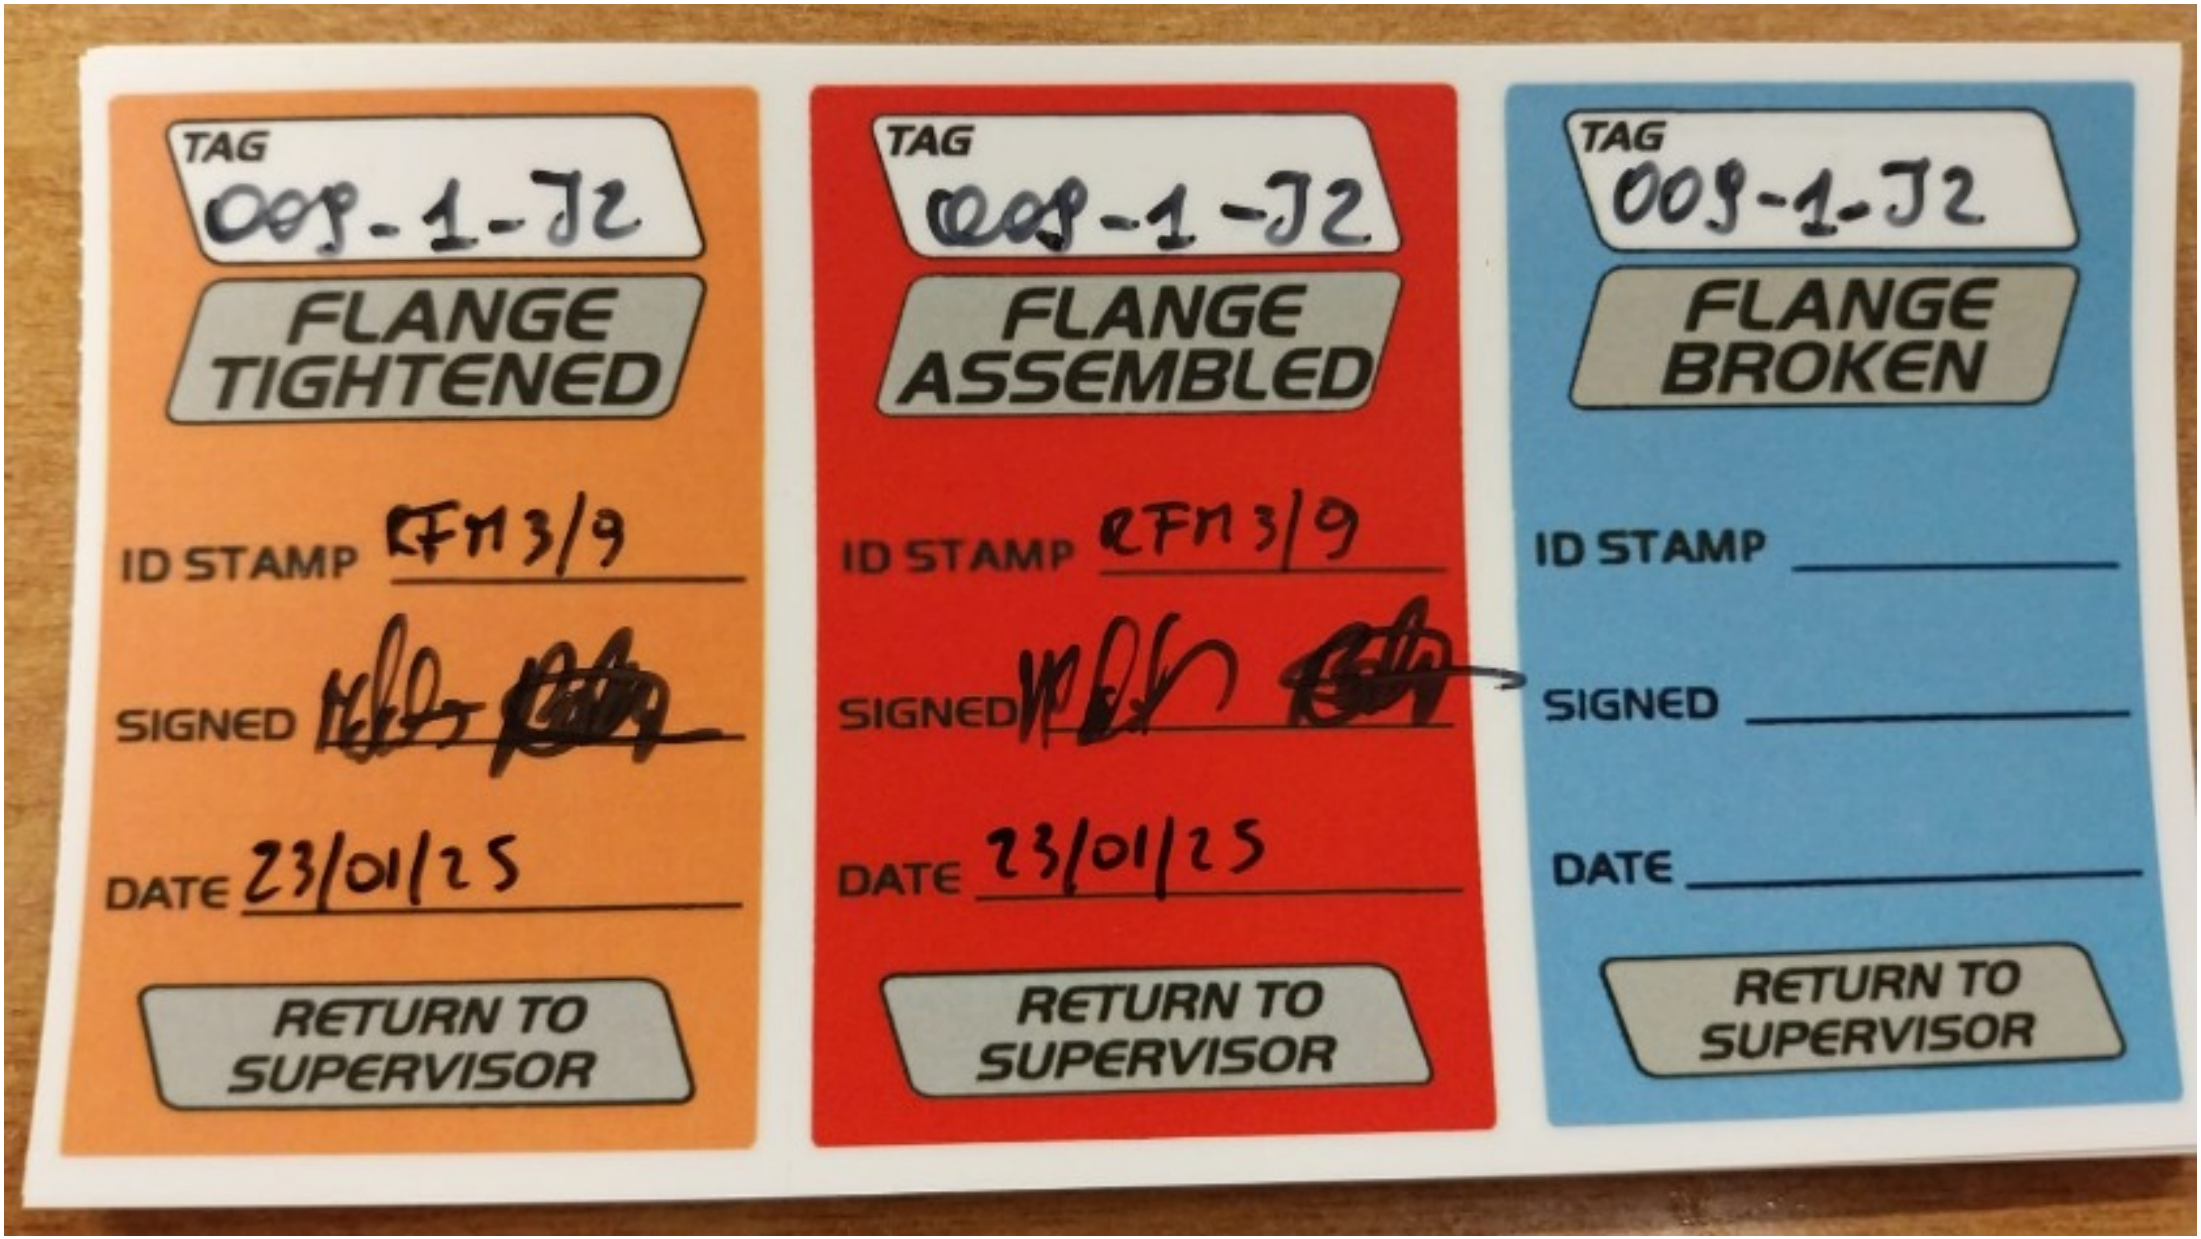
TAG
009-1-J2
FLANGE TIGHTENED
ID STAMP RFN 3/9
SIGNED
DATE 23/01/25
RETURN TO SUPERVISOR
TAG
009-1-J2
FLANGE ASSEMBLED
ID STAMP RFN 3/9
SIGNED
DATE 23/01/25
RETURN TO SUPERVISOR
TAG
009-1-J2
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	009-1-J3	: Joint 009-1-J3			Dwg	123A90-FDL-PP-DI-00009-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003838		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	T064079 / RA00598
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes


4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-24	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:51:32.185Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-24T08:20:49.687Z	

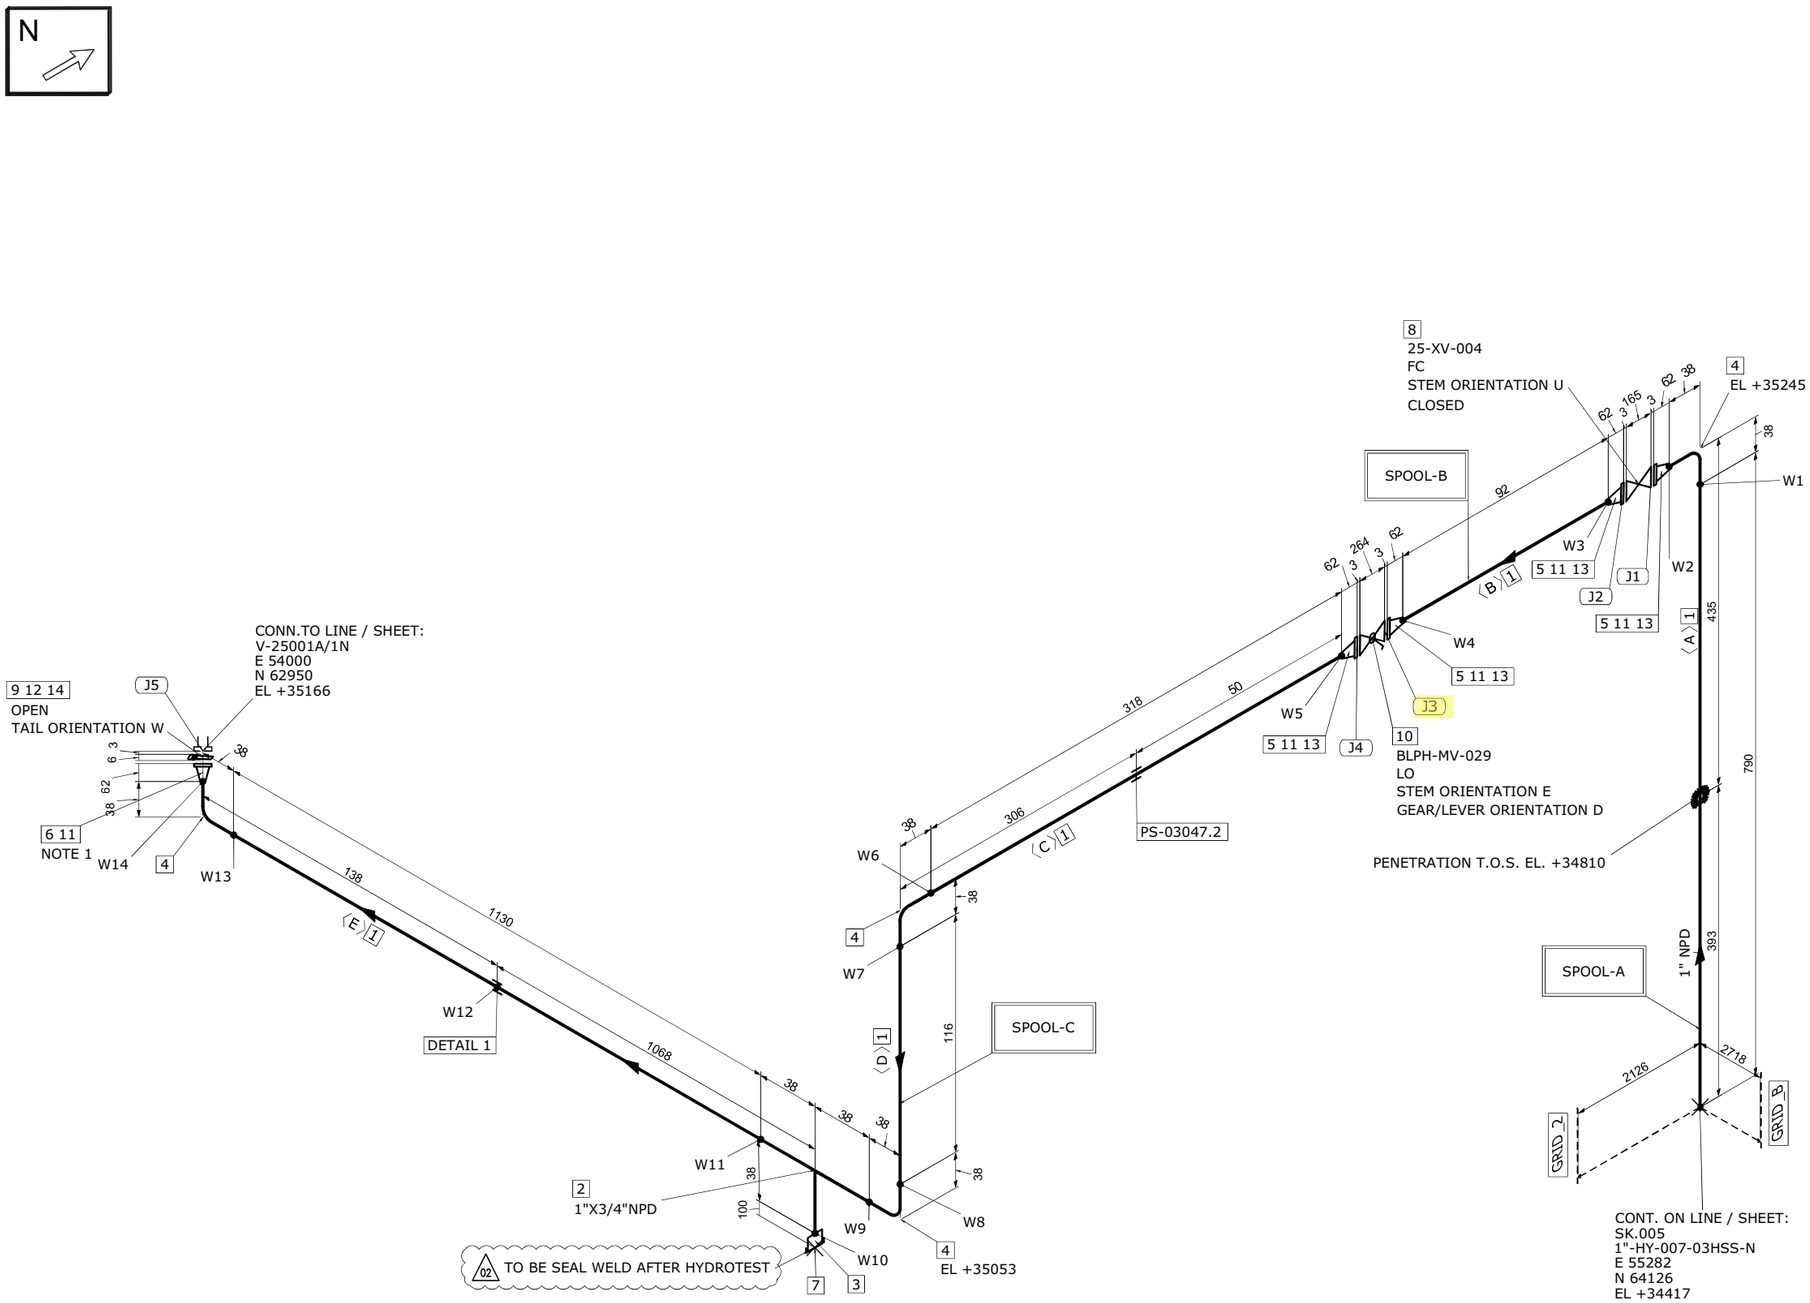

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.4M	6.2
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.4
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.2

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	3/4	BW
W11	1	BW
W12		FW
W13	1	BW
W14	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	790	BEVEL	BEVEL
B	1	92	BEVEL	BEVEL
C	1	318	BEVEL	BEVEL
D	1	116	BEVEL	BEVEL
E	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-03047.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	2	4.0
B	2	3.9
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-015-03HSS-N

SK.009


LINE DATA								
NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		

REFERENCE DOCUMENTS	
P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES
1.JACKSCREWS POSITION N/S

MASTER


CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE	N/A
DRAWN	STAFF SRL
CHECKED	RT
APPROVED	LM
DATE	17-09-2024
FORMAT	A3
DRAWING NO.	123A90-FDL-PP-DI-00009
SHEET / OF	1/1
REV.	02

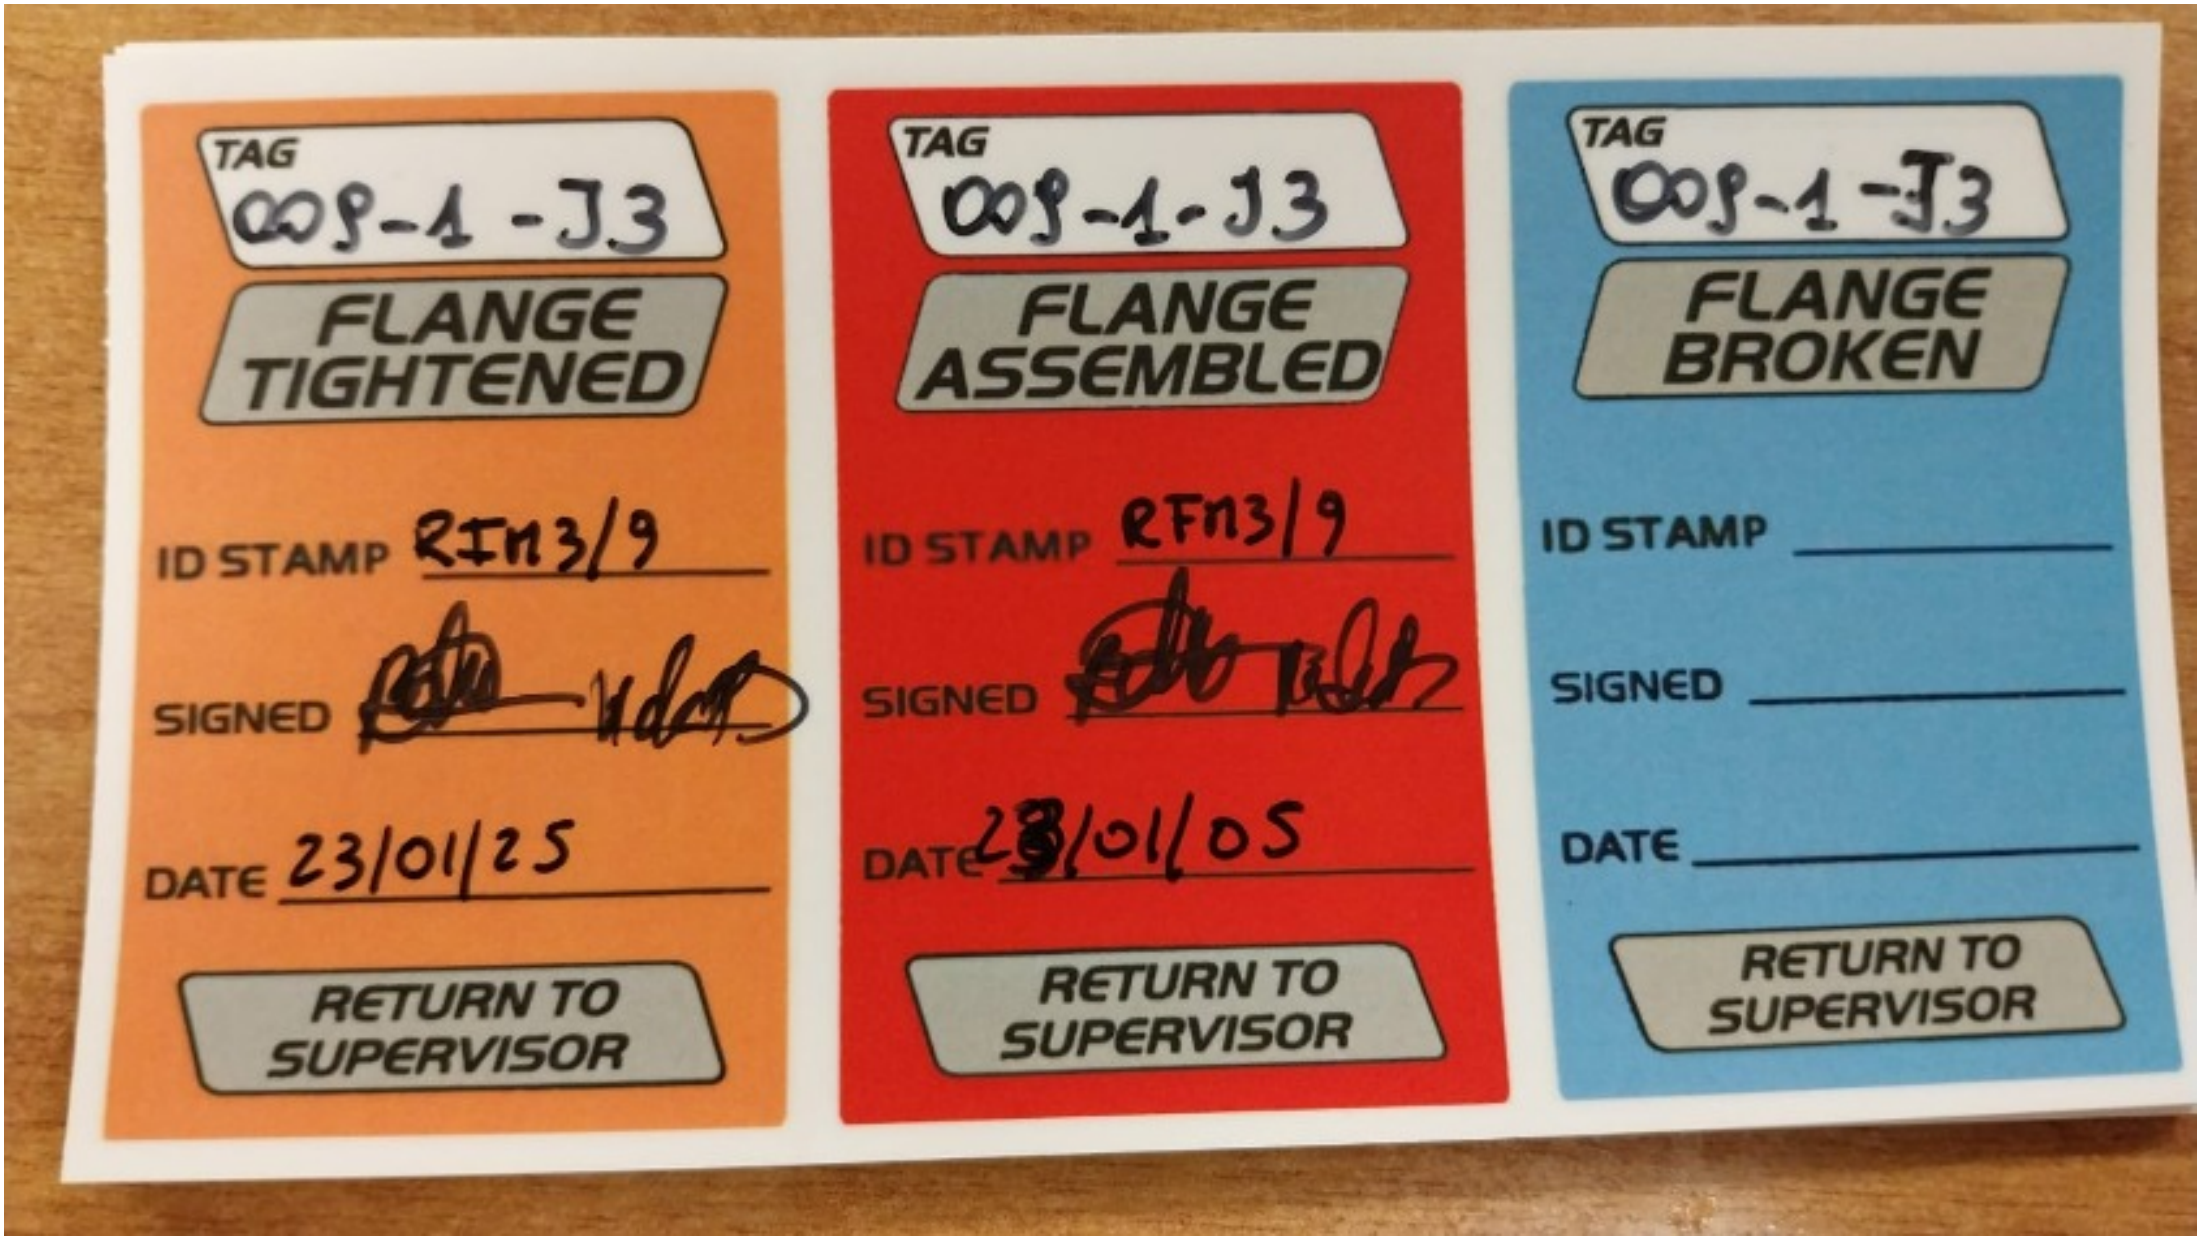
TAG
009-1-J3
FLANGE TIGHTENED
ID STAMP RFN3/9
SIGNED
DATE 23/01/25
RETURN TO SUPERVISOR
TAG
009-1-J3
FLANGE ASSEMBLED
ID STAMP RFN3/9
SIGNED
DATE 23/01/05
RETURN TO SUPERVISOR
TAG
009-1-J3
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	010-1-J1	: Joint 010-1-J1			Dwg	123A90-FDL-PP-DI-00010-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003841		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	V030390 / RD00261
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes


4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-24	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:51:45.295Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-24T14:06:07.399Z	

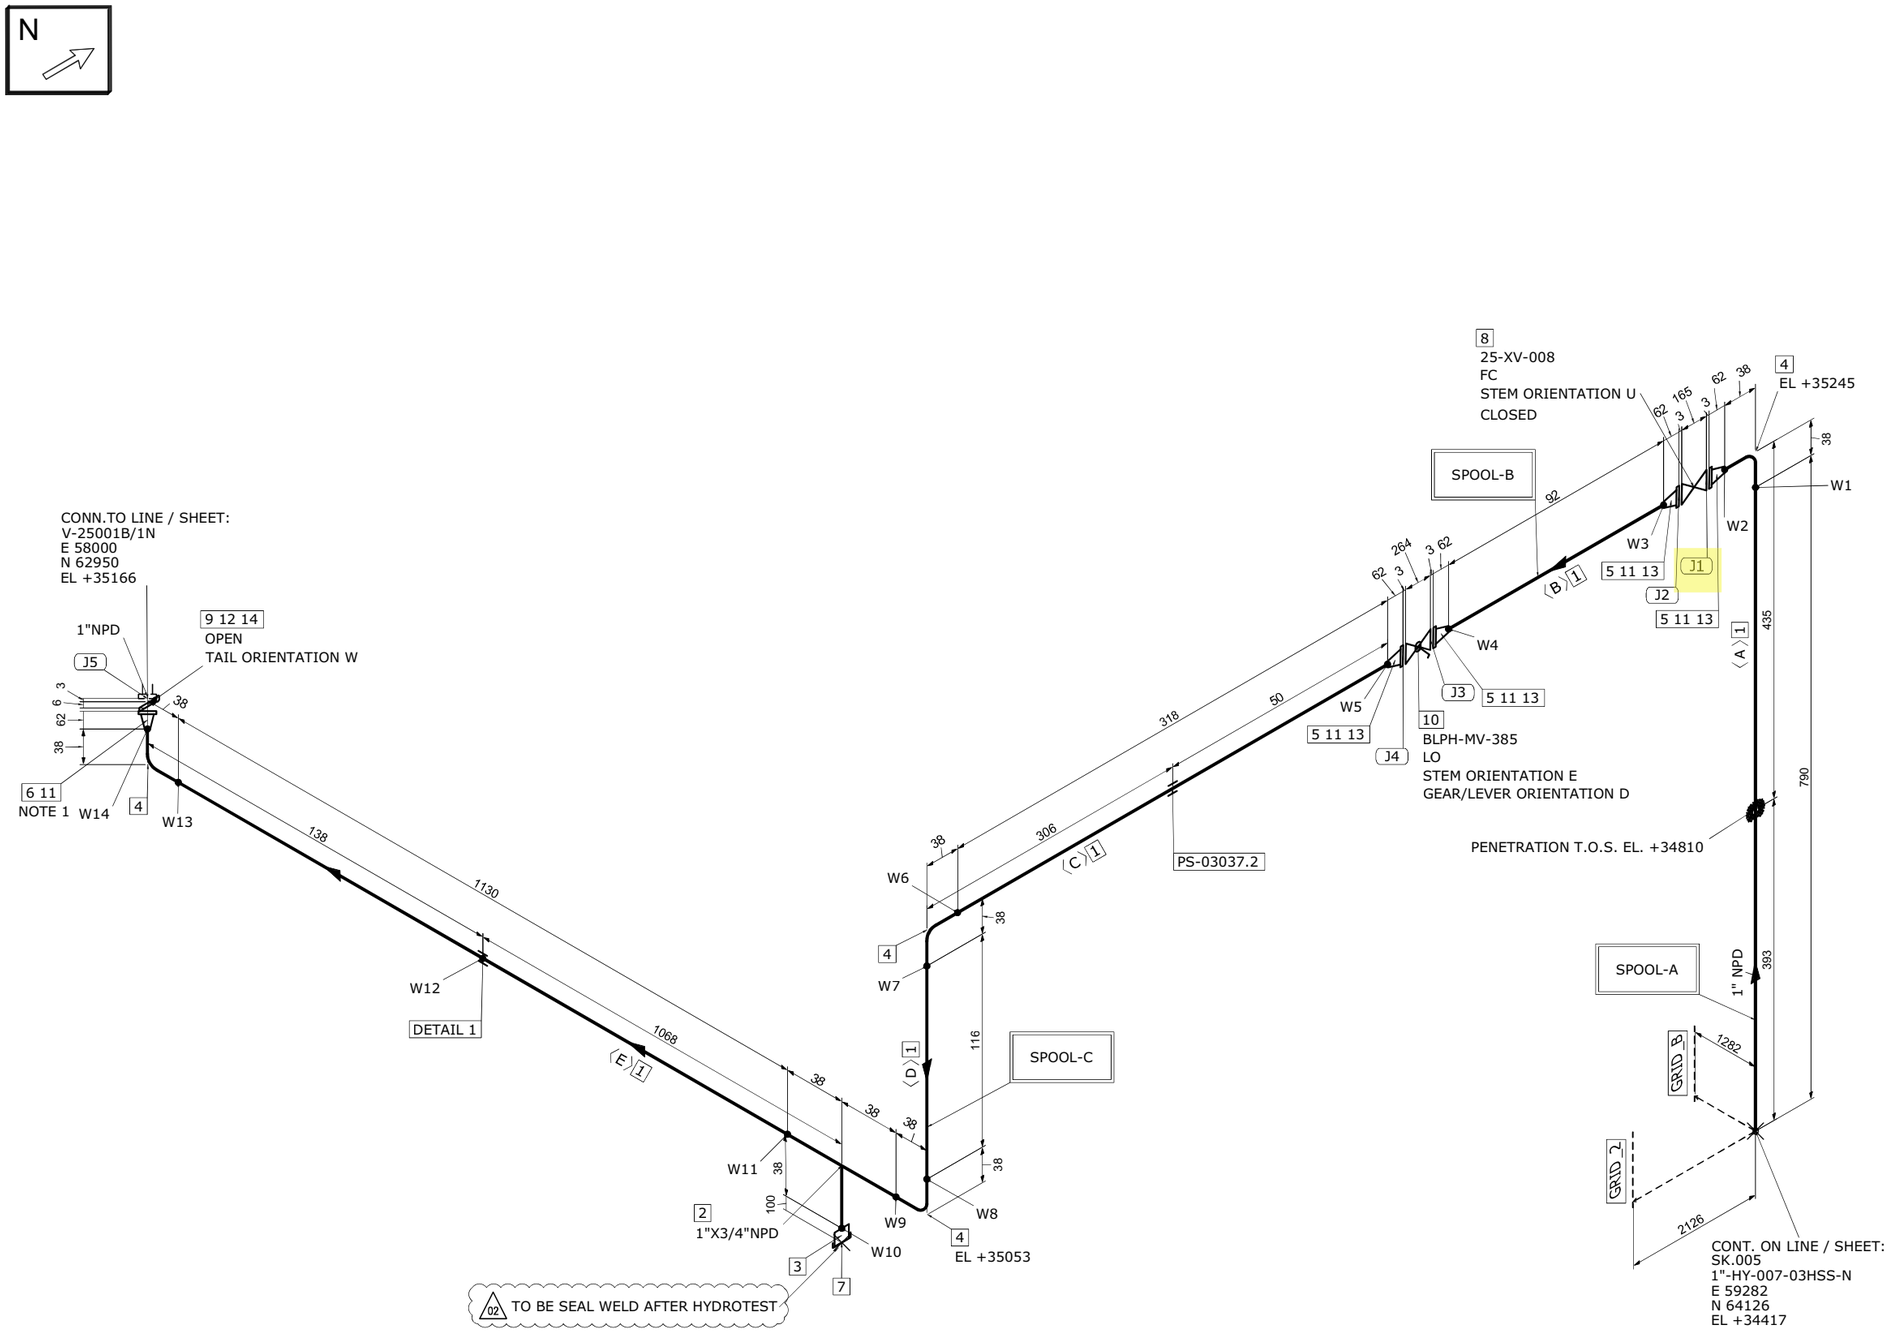

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.4M	6.2
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.4
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	3/4	BW
W11	1	BW
W12		FW
W13	1	BW
W14	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	790	BEVEL	BEVEL
B	1	92	BEVEL	BEVEL
C	1	318	BEVEL	BEVEL
D	1	116	BEVEL	BEVEL
E	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-03037.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	2	4.0
B	2	3.9
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-016-03HSS-N

SK.010

NDT INSPECTION CATEGORY	1	PED CATEGORY	II	P&ID	123A90-DDL-PR-PID-80016
PAINTING	SYSTEM 6A / BASE RAL RAL 9002	FLUID PHASE	GAS	ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
INSULATION	TYPE N / THICKNESS [mm]	DESIGN	PRESS. 40 [barg] / TEMP. -29 / 80 [°C]	PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
HEAT TRACING	--	TEST	PRESS. 60 [barg] / TEMP. AMB / MEDIUM Water	PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES
1.JACKSCREWS POSITION N/S

MASTER

CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE	N/A
DRAWN	STAFF SRL
CHECKED	RT
APPROVED	LM
DATE	17-09-2024
FORMAT	A3
DRAWING NO.	123A90-FDL-PP-DI-00010
SHEET / OF	1/1
REV.	02

TAG 010-1-J1

FLANGE TIGHTENED

ID STAMP RFN 2/6

SIGNED

DATE 24/01/25

RETURN TO SUPERVISOR

TAG 010-1-J1

FLANGE ASSEMBLED

ID STAMP RFN 2/6

SIGNED

DATE 24/01/25

RETURN TO SUPERVISOR

TAG 010-1-J1

FLANGE BROKEN

ID STAMP

SIGNED

DATE


RETURN TO SUPERVISOR

ROSETTI MARINO | CROSSWIND

ITEM	Tag	010-1-J2	: Joint 010-1-J2			Dwg	123A90-FDL-PP-DI-00010-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003842		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 — Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	V030390 / RD00261
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes


4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO(	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-24	
Signature	Digitaly signed by Emanuele Delfino 2025-01-23T05:51:58.423Z	Digitaly signed by Andrea Mancini 2025-01-24T14:06:35.507Z	

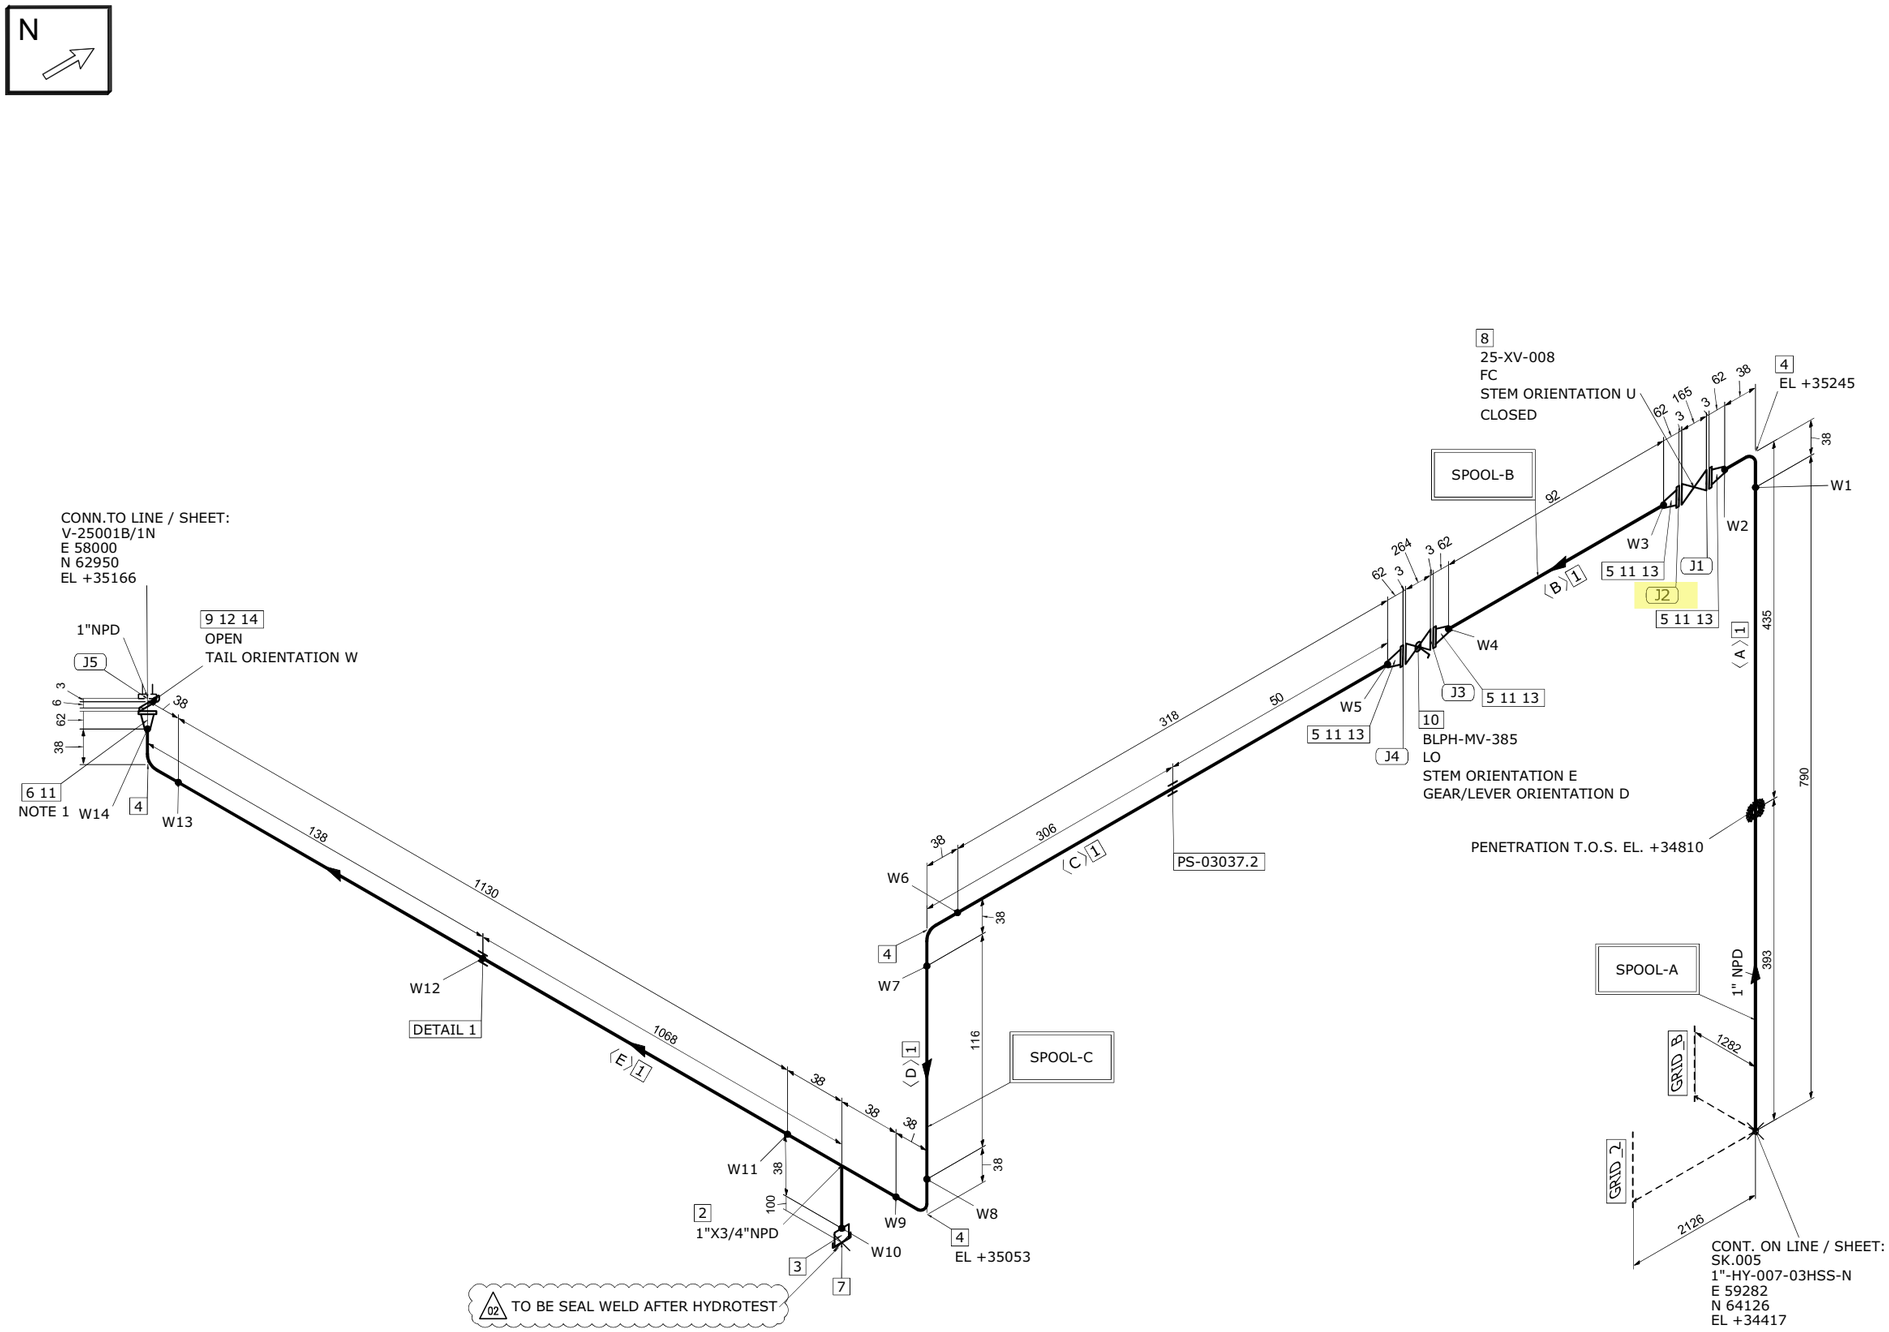

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.4M	6.2
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.4
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	3/4	BW
W11	1	BW
W12		FW
W13	1	BW
W14	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	790	BEVEL	BEVEL
B	1	92	BEVEL	BEVEL
C	1	318	BEVEL	BEVEL
D	1	116	BEVEL	BEVEL
E	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-03037.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	2	4.0
B	2	3.9
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-016-03HSS-N

SK.010

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK

SCALE: N/A

DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024

FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00010 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II			
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS			
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]		
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water	

REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80016
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION N/S


MASTER


TAG
010-1-J2
FLANGE TIGHTENED
ID STAMP RFN 2/6
SIGNED
DATE 24/01/25
RETURN TO SUPERVISOR
TAG
010-1-J2
FLANGE ASSEMBLED
ID STAMP RFN 2/6
SIGNED
DATE 24/01/25
RETURN TO SUPERVISOR
TAG
010-1-J2
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	010-1-J3	: Joint 010-1-J3			Dwg	123A90-FDL-PP-DI-00010-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003843	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form TMX27	Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	V030390 / RD00261
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes


4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-24	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:52:10.542Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-24T14:07:19.421Z	

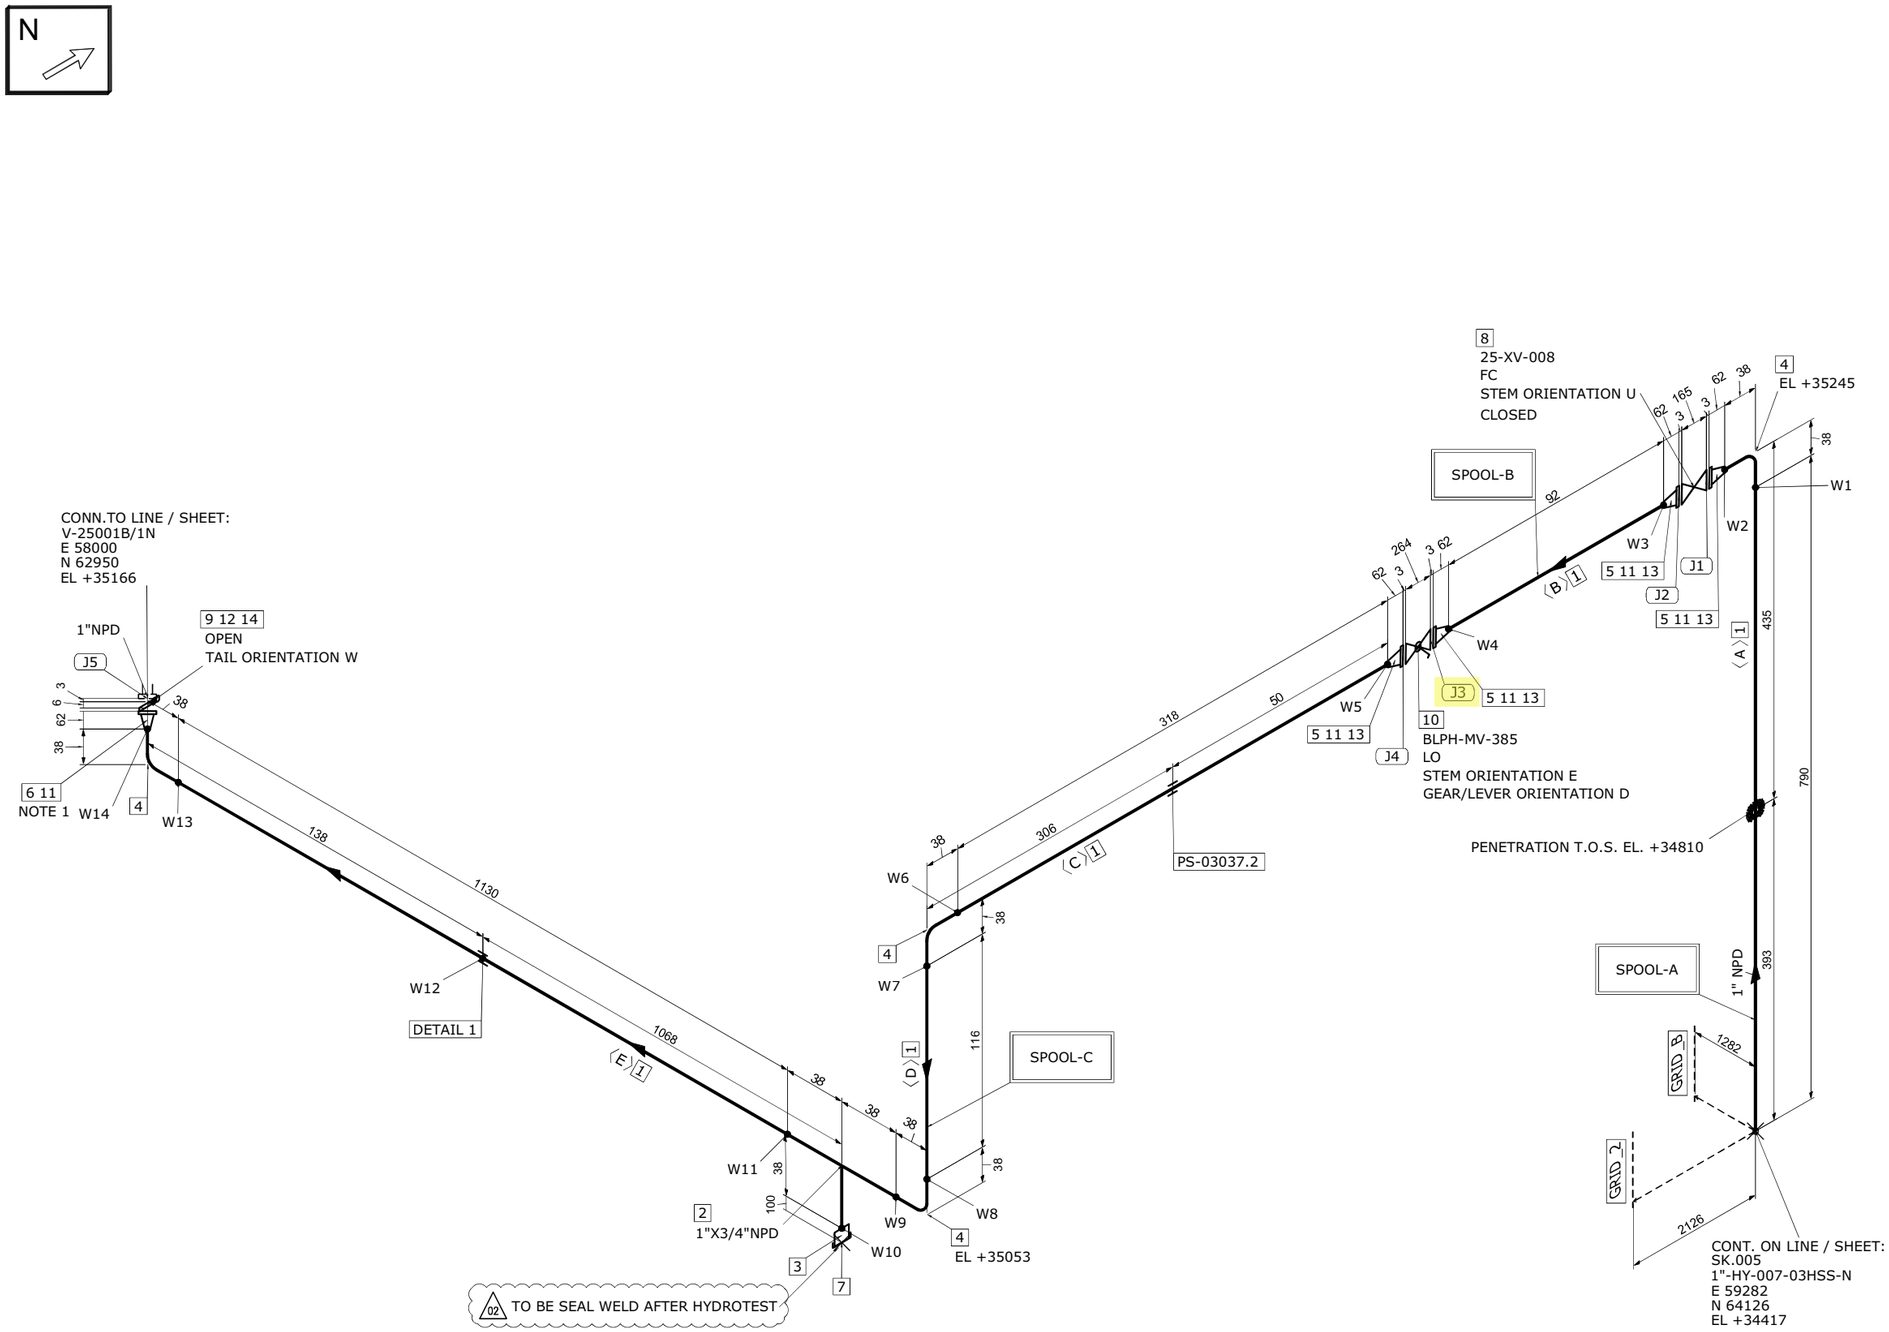

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.4M	6.2
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.4
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	3/4	BW
W11	1	BW
W12		FW
W13	1	BW
W14	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	790	BEVEL	BEVEL
B	1	92	BEVEL	BEVEL
C	1	318	BEVEL	BEVEL
D	1	116	BEVEL	BEVEL
E	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-03037.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	2	4.0
B	2	3.9
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-016-03HSS-N

SK.010

CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	N/A
DRAWN	STAFF SRL	CHECKED	RT	APPROVED	LM
DATE	17-09-2024				
FORMAT	A3	DRAWING NO.	123A90-FDL-PP-DI-00010	SHEET / OF	1/1
REV.	02				

LINE DATA

NDT INSPECTION CATEGORY	1			PED CATEGORY	II			
PAINTING	SYSTEM 6A	BASE RAL RAL 9002		FLUID PHASE	GAS			
INSULATION	TYPE N	THICKNESS [mm]		DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]		
HEAT TRACING	--			TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water	


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80016
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION N/S


MASTER

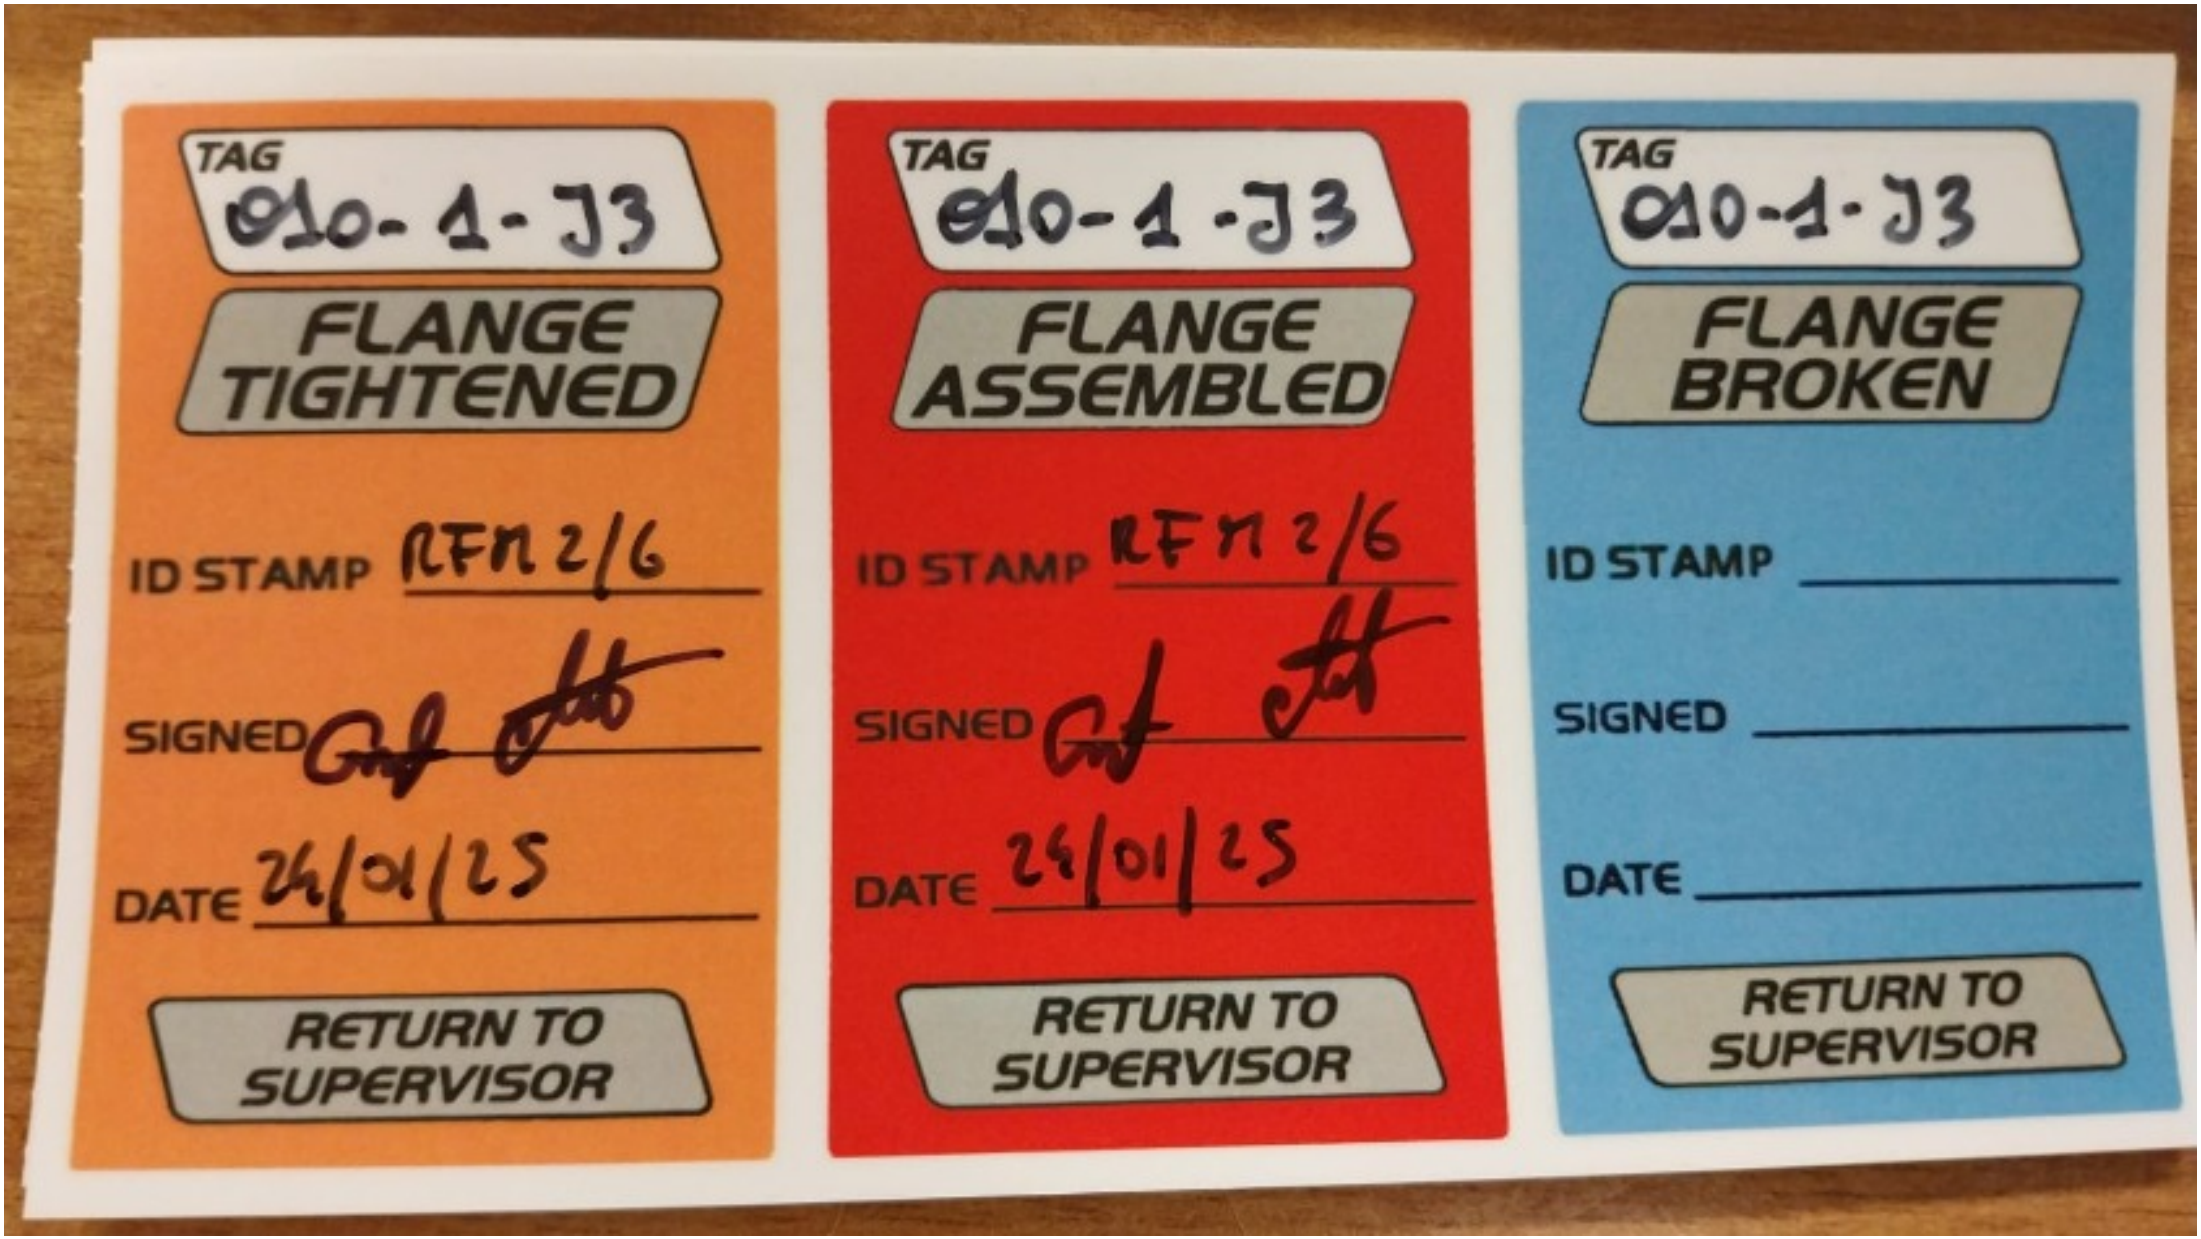
TAG
010-1-J3
FLANGE TIGHTENED
ID STAMP RFM 2/6
SIGNED
DATE 24/01/25
RETURN TO SUPERVISOR
TAG
010-1-J3
FLANGE ASSEMBLED
ID STAMP RFM 2/6
SIGNED
DATE 24/01/25
RETURN TO SUPERVISOR
TAG
010-1-J3
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	011-1-J1	: Joint 011-1-J1			Dwg	123A90-FDL-PP-DI-00011-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003846		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	T064079 / RA00598
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes


4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☒ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-27	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:52:21.219Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-27T08:35:08.545Z	

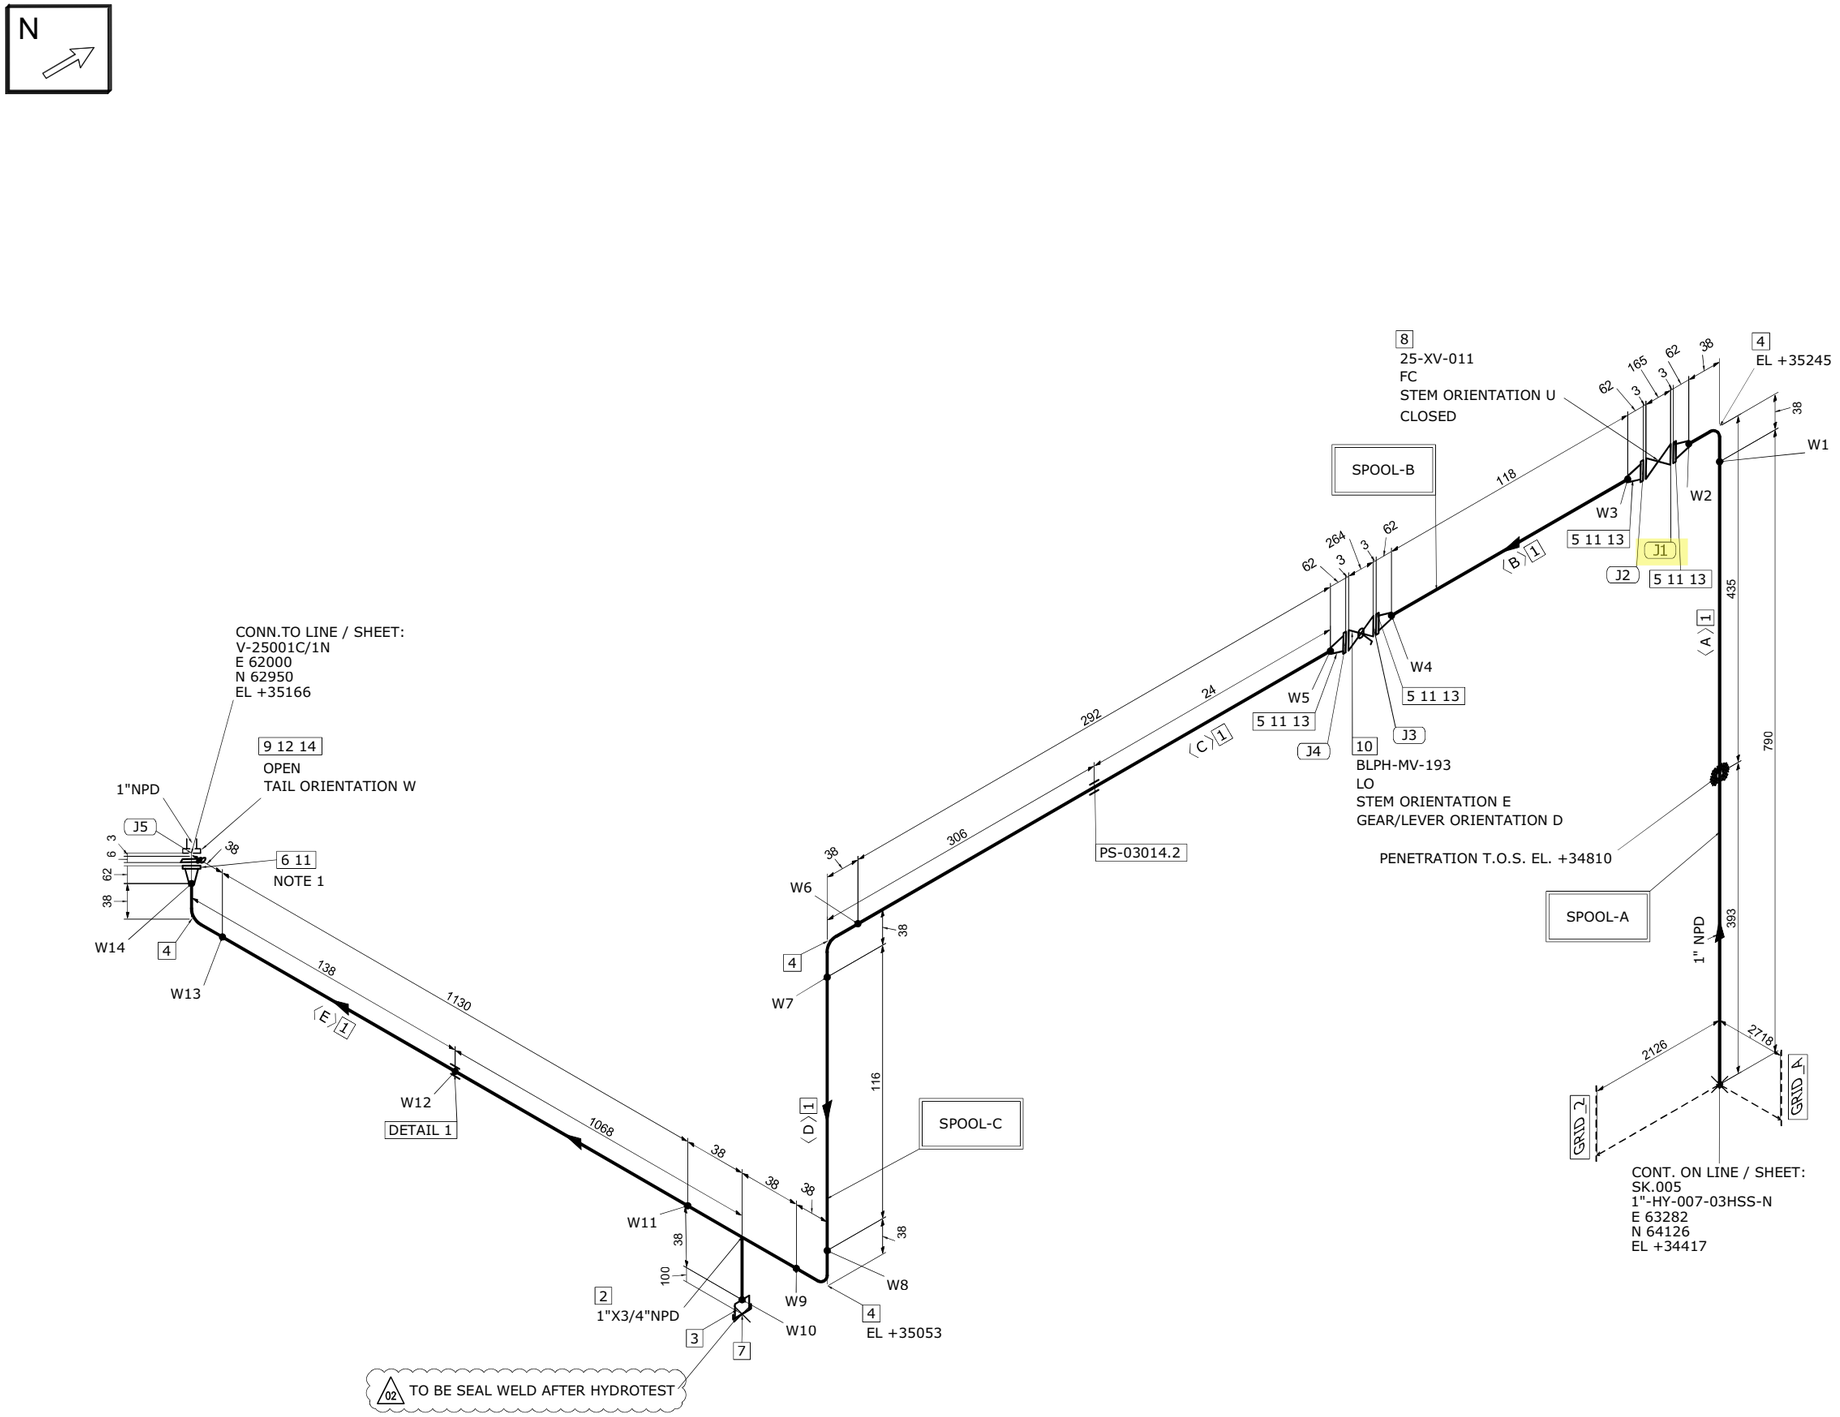

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.4M	6.2
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.4
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	3/4	BW
W11	1	BW
W12		FW
W13	1	BW
W14	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	790	BEVEL	BEVEL
B	1	118	BEVEL	BEVEL
C	1	292	BEVEL	BEVEL
D	1	116	BEVEL	BEVEL
E	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-03014.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	2	4.0
B	2	4.0
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-017-03HSS-N

SK.011


LINE DATA								
NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		

REFERENCE DOCUMENTS	
P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES
1.JACKSCREWS POSITION N/S

MASTER


CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	N/A
DRAWN STAFF SRL	CHECKED RT	APPROVED LM	DATE 17-09-2024
FORMAT A3	DRAWING NO. 123A90-FDL-PP-DI-00011	SHEET / OF 1/1	REV. 02

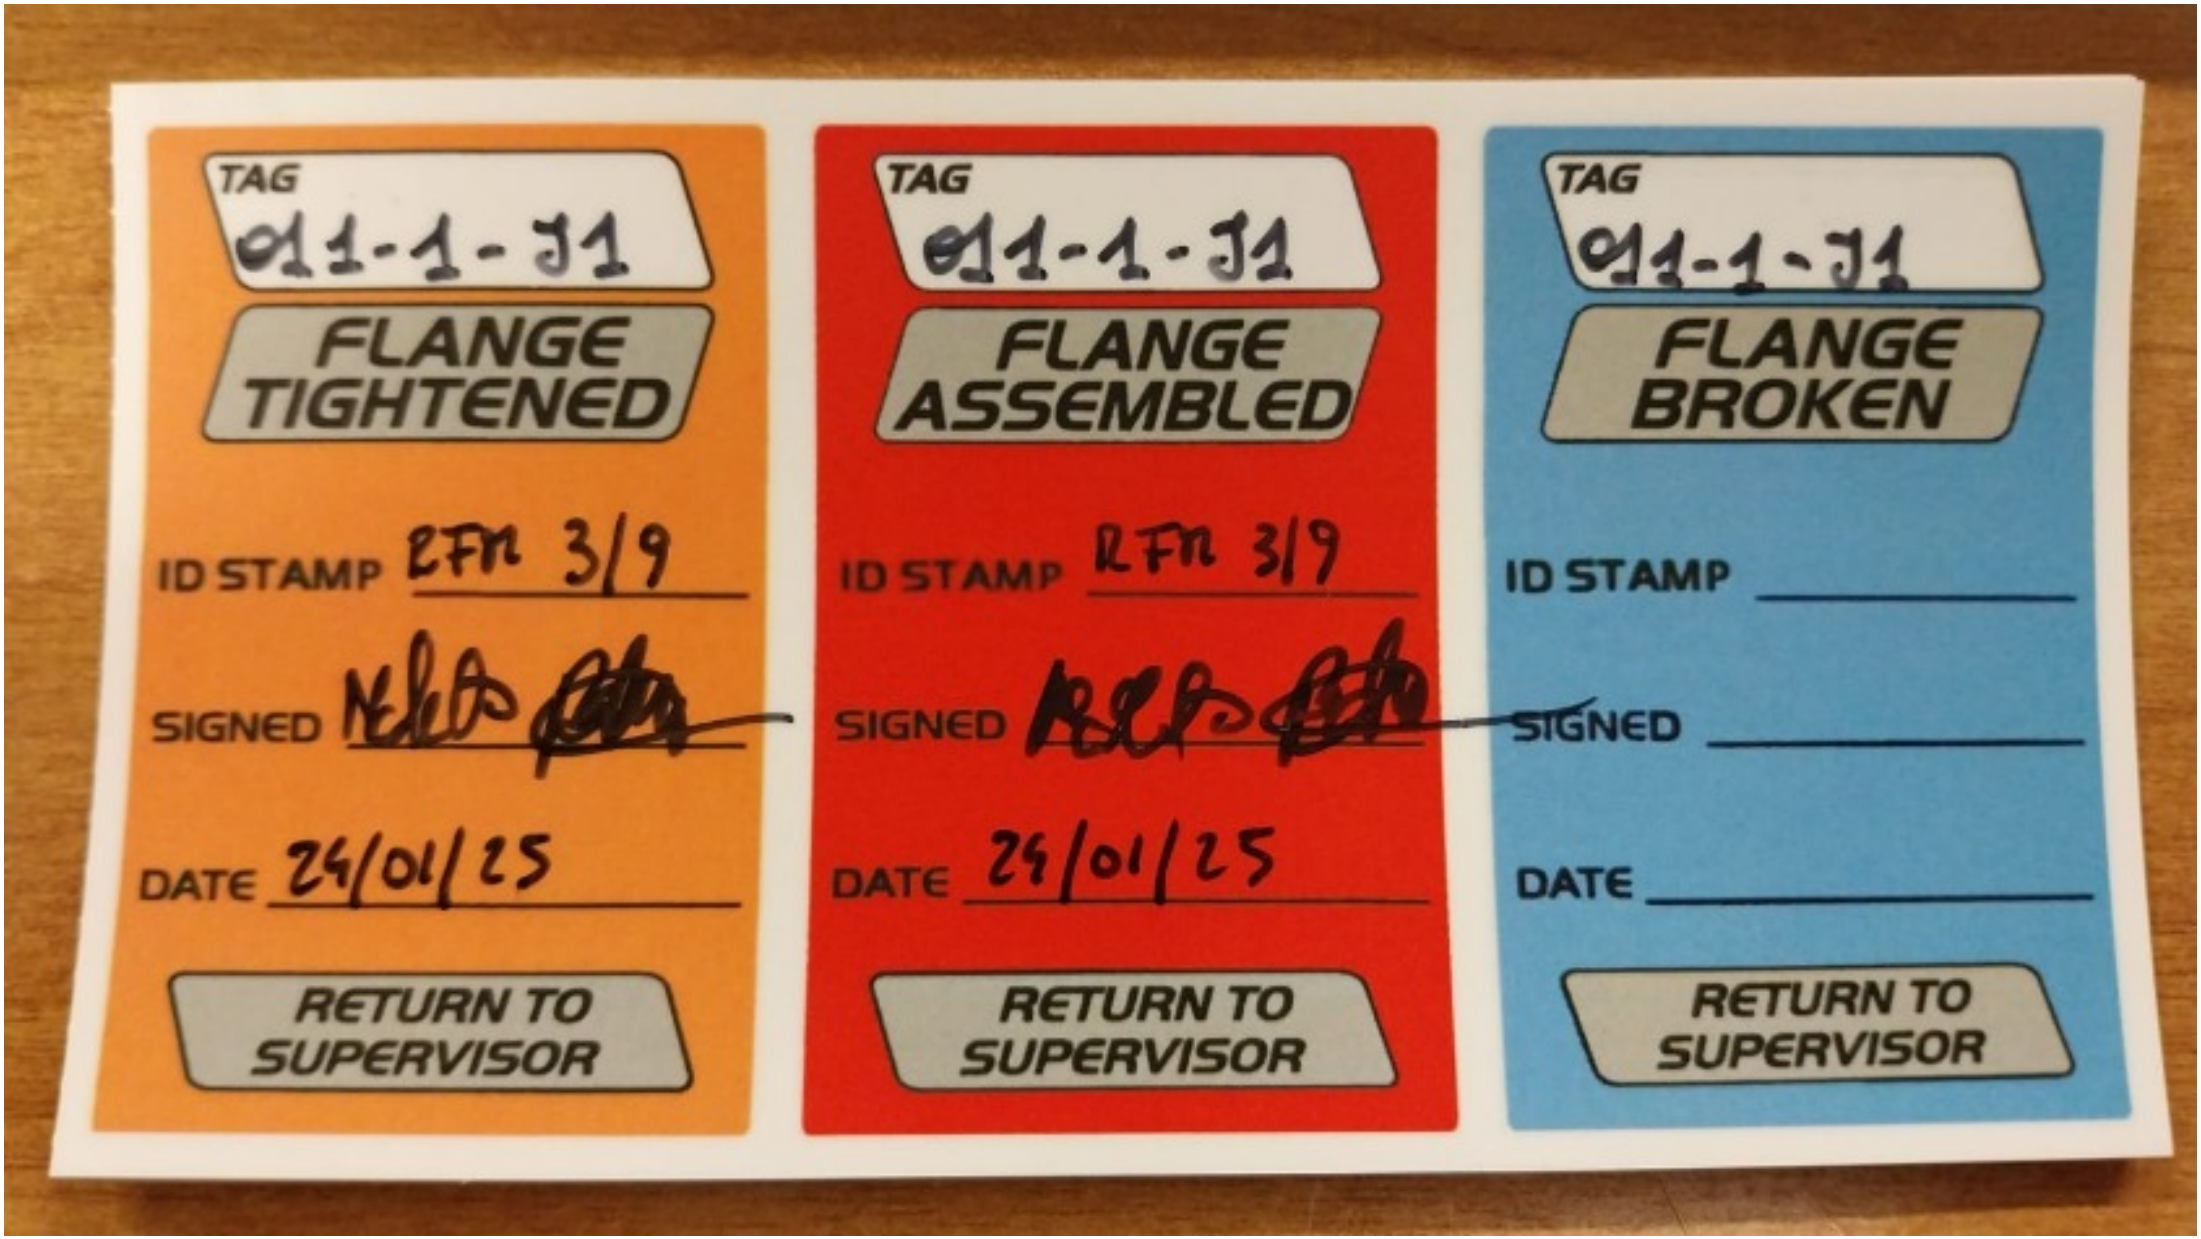
TAG
01-1-J1
FLANGE TIGHTENED
ID STAMP RFN 3/9
SIGNED
DATE 24/01/25
RETURN TO SUPERVISOR
TAG
01-1-J1
FLANGE ASSEMBLED
ID STAMP RFN 3/9
SIGNED
DATE 24/01/25
RETURN TO SUPERVISOR
TAG
01-1-J1
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	011-1-J2	: Joint 011-1-J2			Dwg	123A90-FDL-PP-DI-00011-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003847		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	T064079 / RA00598
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes


4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-27	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:52:32.375Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-27T08:35:48.602Z	

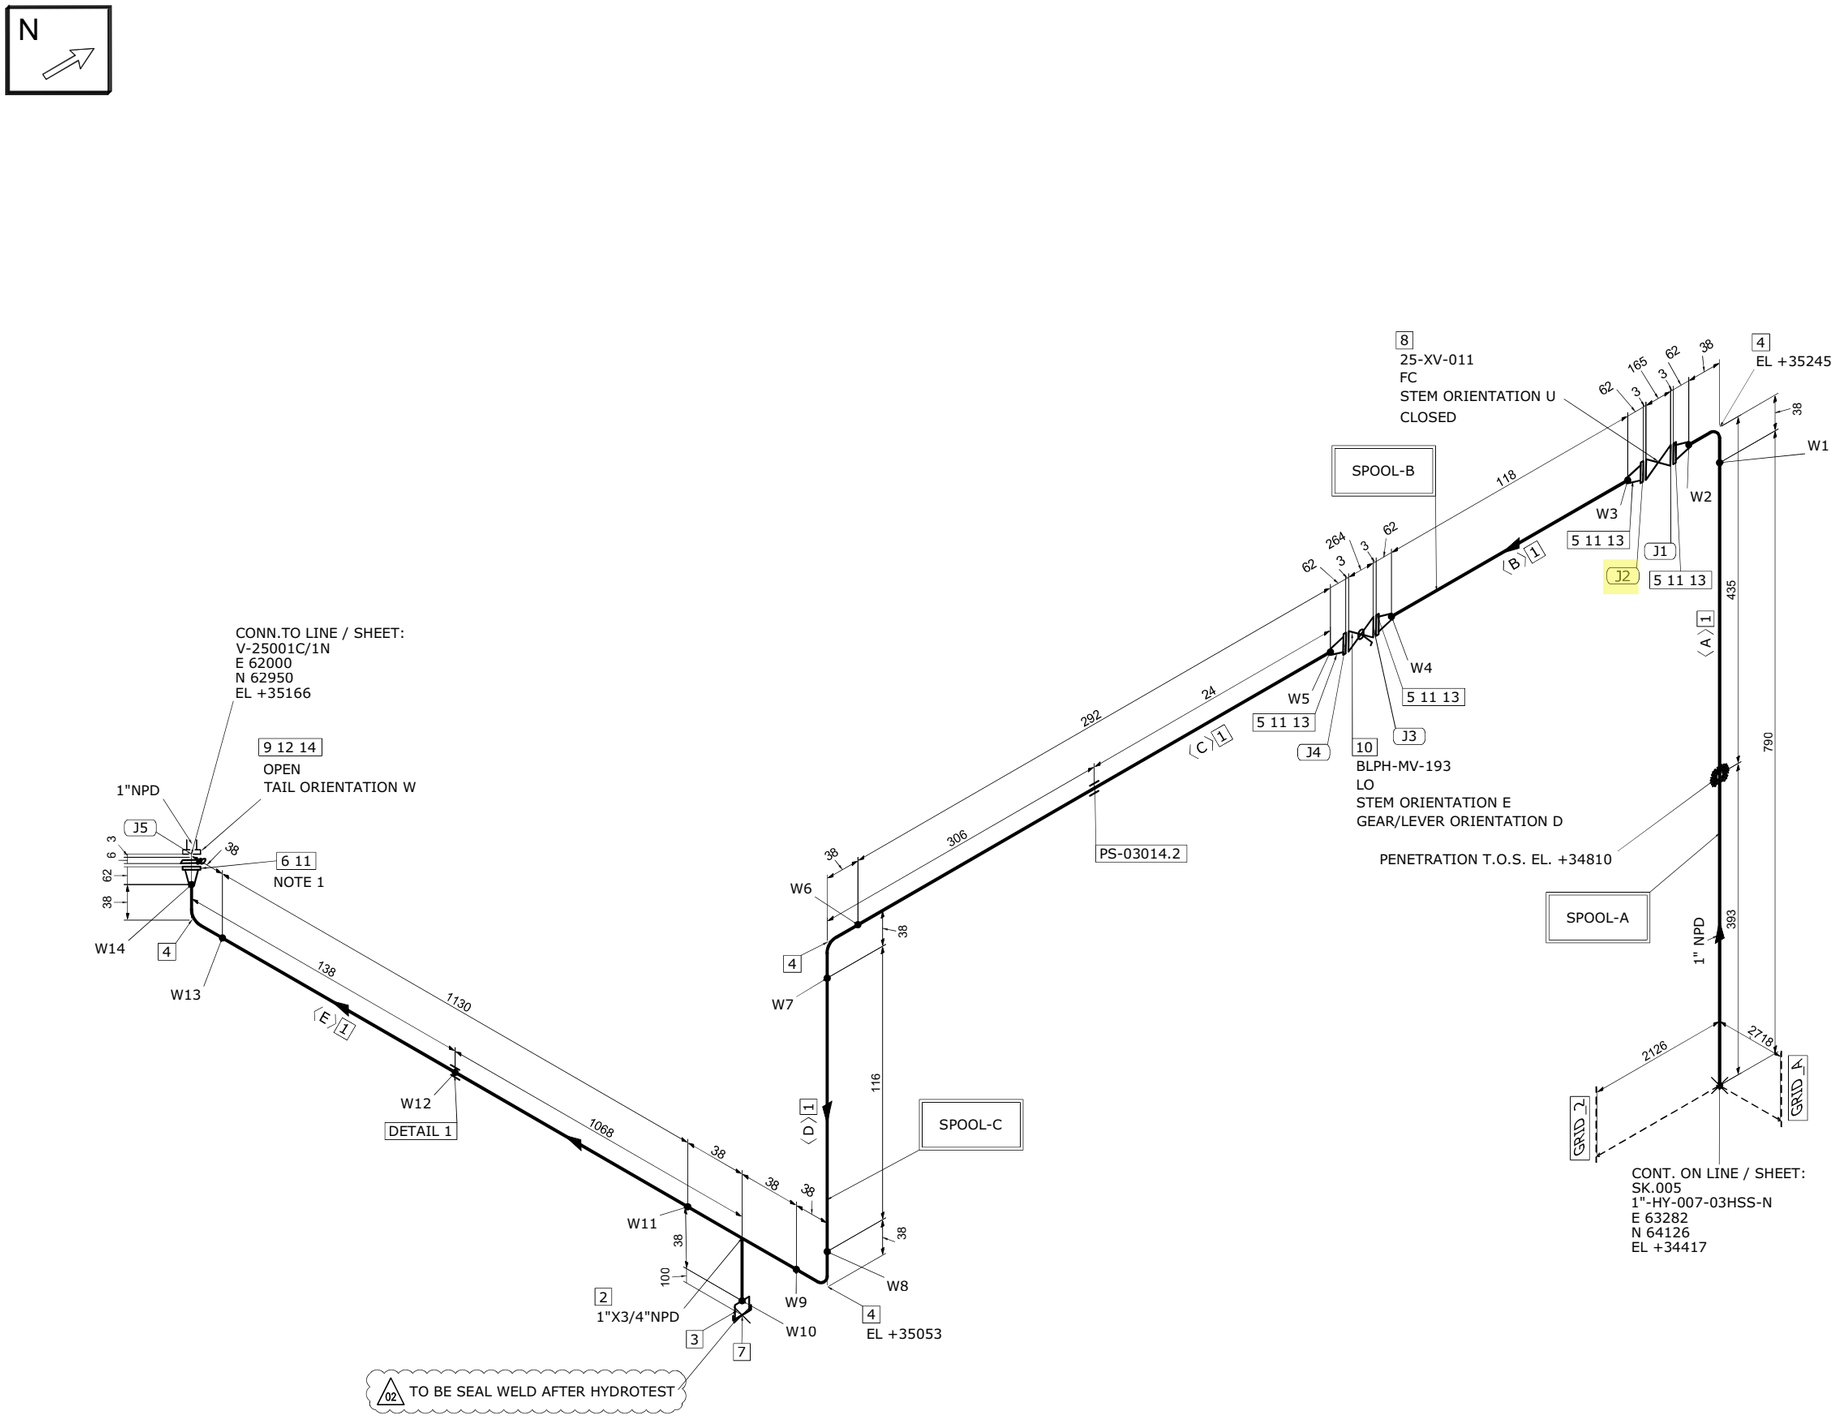

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.4M	6.2
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.4
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	3/4	BW
W11	1	BW
W12		FW
W13	1	BW
W14	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	790	BEVEL	BEVEL
B	1	118	BEVEL	BEVEL
C	1	292	BEVEL	BEVEL
D	1	116	BEVEL	BEVEL
E	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-03014.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	2	4.0
B	2	4.0
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-017-03HSS-N

SK.011

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		

REFERENCE DOCUMENTS


P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION N/S

MASTER


CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	N/A
DRAWN STAFF SRL	CHECKED RT	APPROVED LM	DATE 17-09-2024
FORMAT A3	DRAWING NO. 123A90-FDL-PP-DI-00011	SHEET / OF 1/1	REV. 02

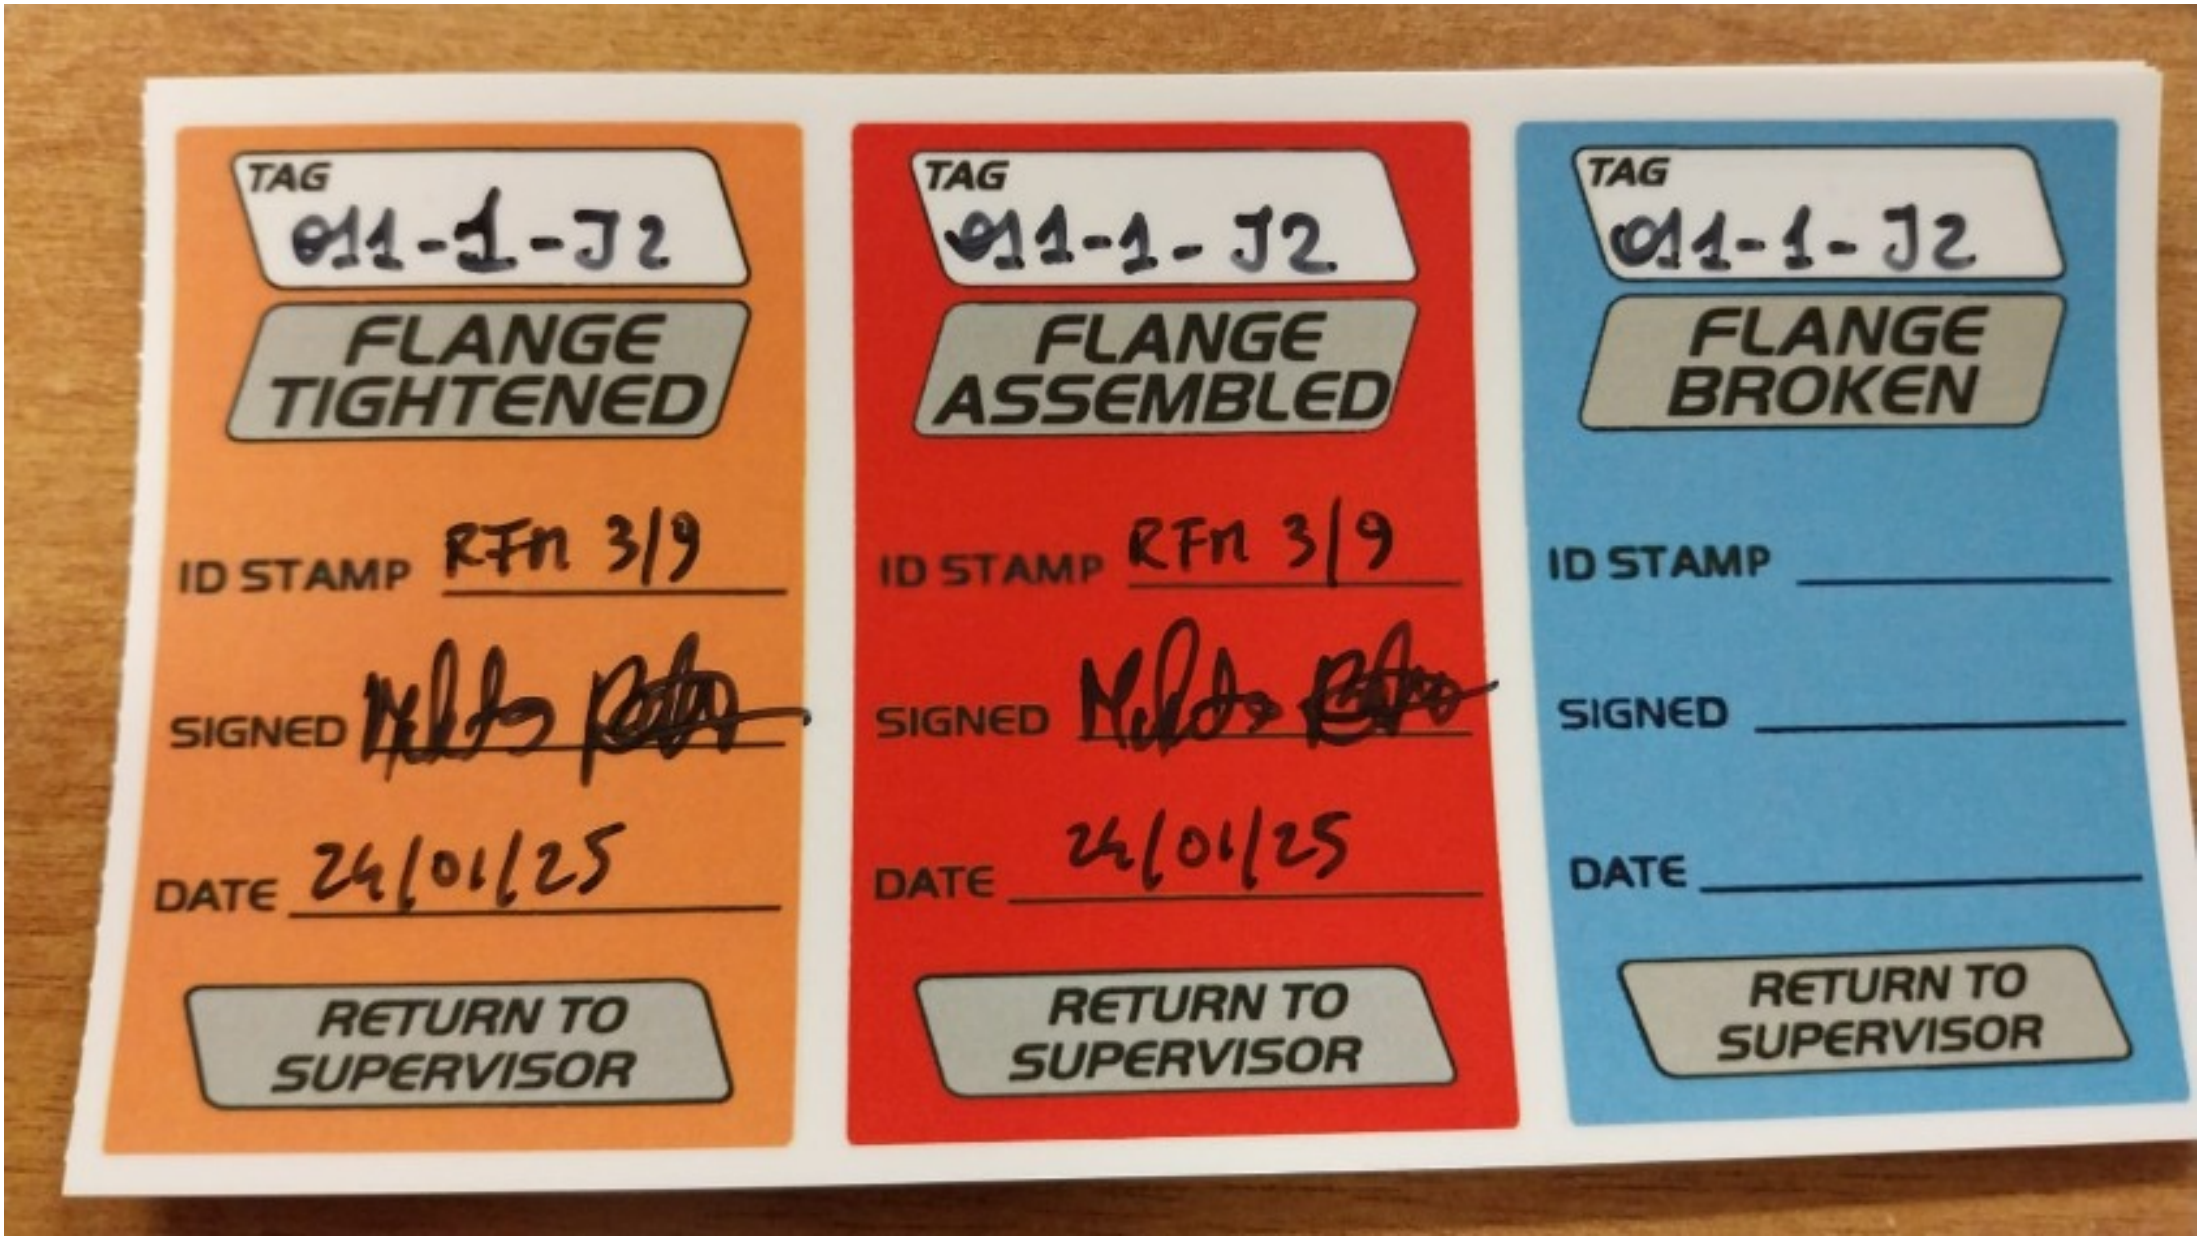
TAG
011-1-J2
FLANGE TIGHTENED
ID STAMP RFn 3/9
SIGNED
DATE 24/01/25
RETURN TO SUPERVISOR
TAG
011-1-J2
FLANGE ASSEMBLED
ID STAMP RFn 3/9
SIGNED
DATE 24/01/25
RETURN TO SUPERVISOR
TAG
011-1-J2
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	011-1-J3	: Joint 011-1-J3			Dwg	123A90-FDL-PP-DI-00011-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003848		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27		Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG




Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	T064079 / RA00598
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8


1	**Clear Bore Inspection:** Pipe and Valve clear of debris/contamination.	Yes
2	**Flange Face Check:** Both flanges clean and free from damage.	Yes
3	**Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique.	Yes
4	**Alignment:** Check alignment according to code.	Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-27	
Signature	Digitaly signed by Emanuele Delfino 2025-01-23T05:52:44.775Z	Digitaly signed by Andrea Mancini 2025-01-27T08:36:31.533Z	

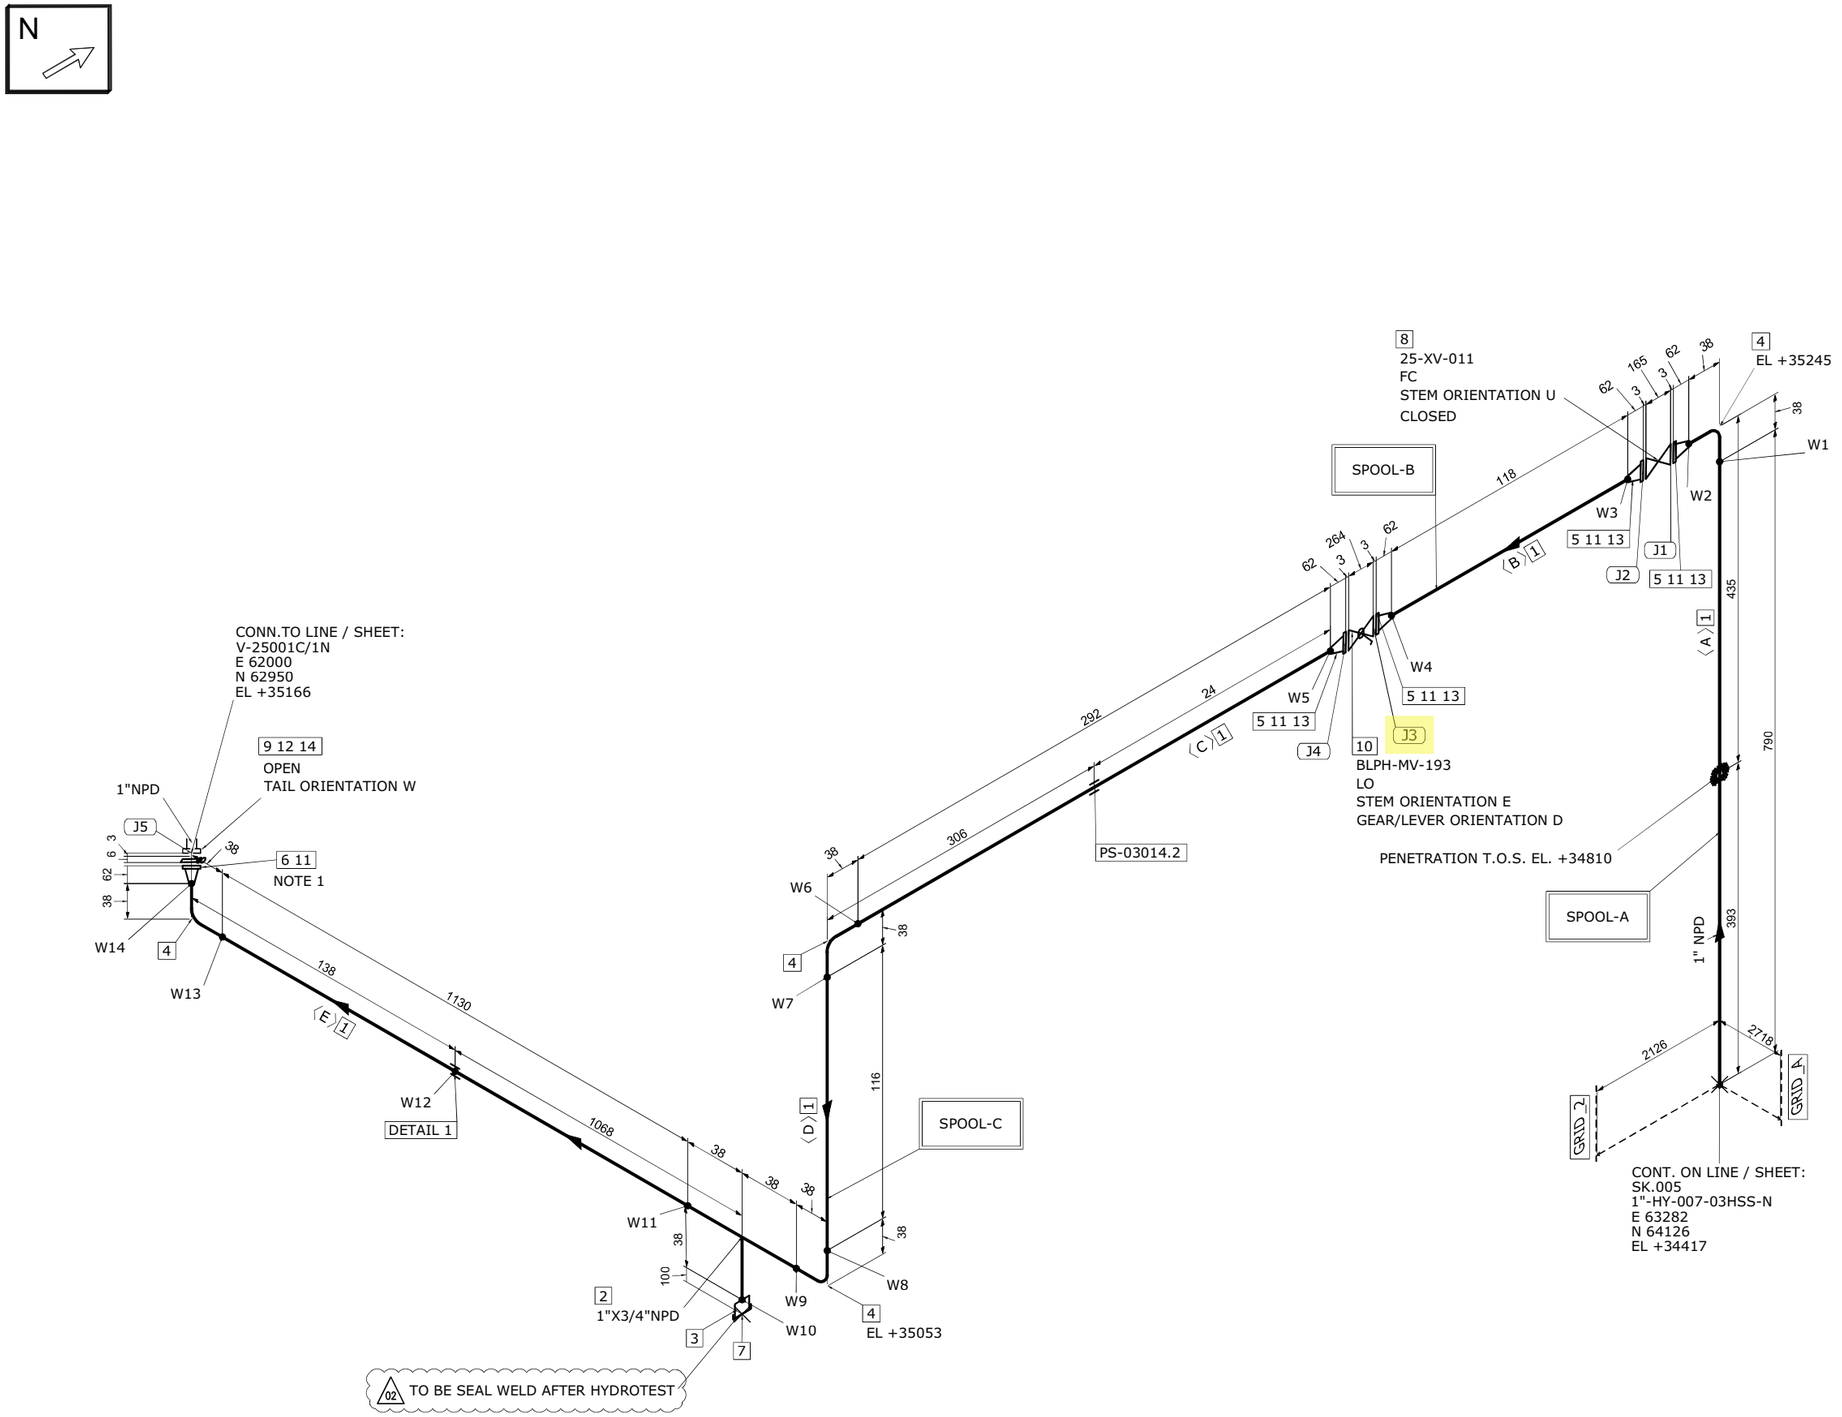

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.4M	6.2
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.4
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	3/4	BW
W11	1	BW
W12		FW
W13	1	BW
W14	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	790	BEVEL	BEVEL
B	1	118	BEVEL	BEVEL
C	1	292	BEVEL	BEVEL
D	1	116	BEVEL	BEVEL
E	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-03014.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	2	4.0
B	2	4.0
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-017-03HSS-N

SK.011

LINE DATA									
NDT INSPECTION CATEGORY	1		PED CATEGORY	II					
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS					
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40	[barg]	TEMP. -29 / 80	[°C]		
HEAT TRACING	--		TEST	PRESS. 60	[barg]	TEMP. AMB	MEDIUM Water		

REFERENCE DOCUMENTS	
P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES
1.JACKSCREWS POSITION N/S

MASTER

CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	N/A
DRAWN STAFF SRL	CHECKED RT	APPROVED LM	DATE 17-09-2024
FORMAT A3	DRAWING NO. 123A90-FDL-PP-DI-00011	SHEET / OF 1/1	REV. 02

TAG
d11-1-J3

FLANGE TIGHTENED

ID STAMP RFn 3/9

SIGNED

DATE 24/01/25

RETURN TO SUPERVISOR

TAG
d11-1-J3

FLANGE ASSEMBLED

ID STAMP RFn 3/9

SIGNED

DATE 24/01/25

RETURN TO SUPERVISOR

TAG
d11-1-J3

FLANGE BROKEN

ID STAMP

SIGNED


DATE

RETURN TO SUPERVISOR

ITEM	Tag	012-1-J1	: Joint 012-1-J1		Dwg	123A90-FDL-PP-DI-00012-01	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10003851	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity PIP	Discipline Piping	Form	TMX27	Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	V030390 / RD00261
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes


4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-27	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:52:58.255Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-27T16:01:48.878Z	

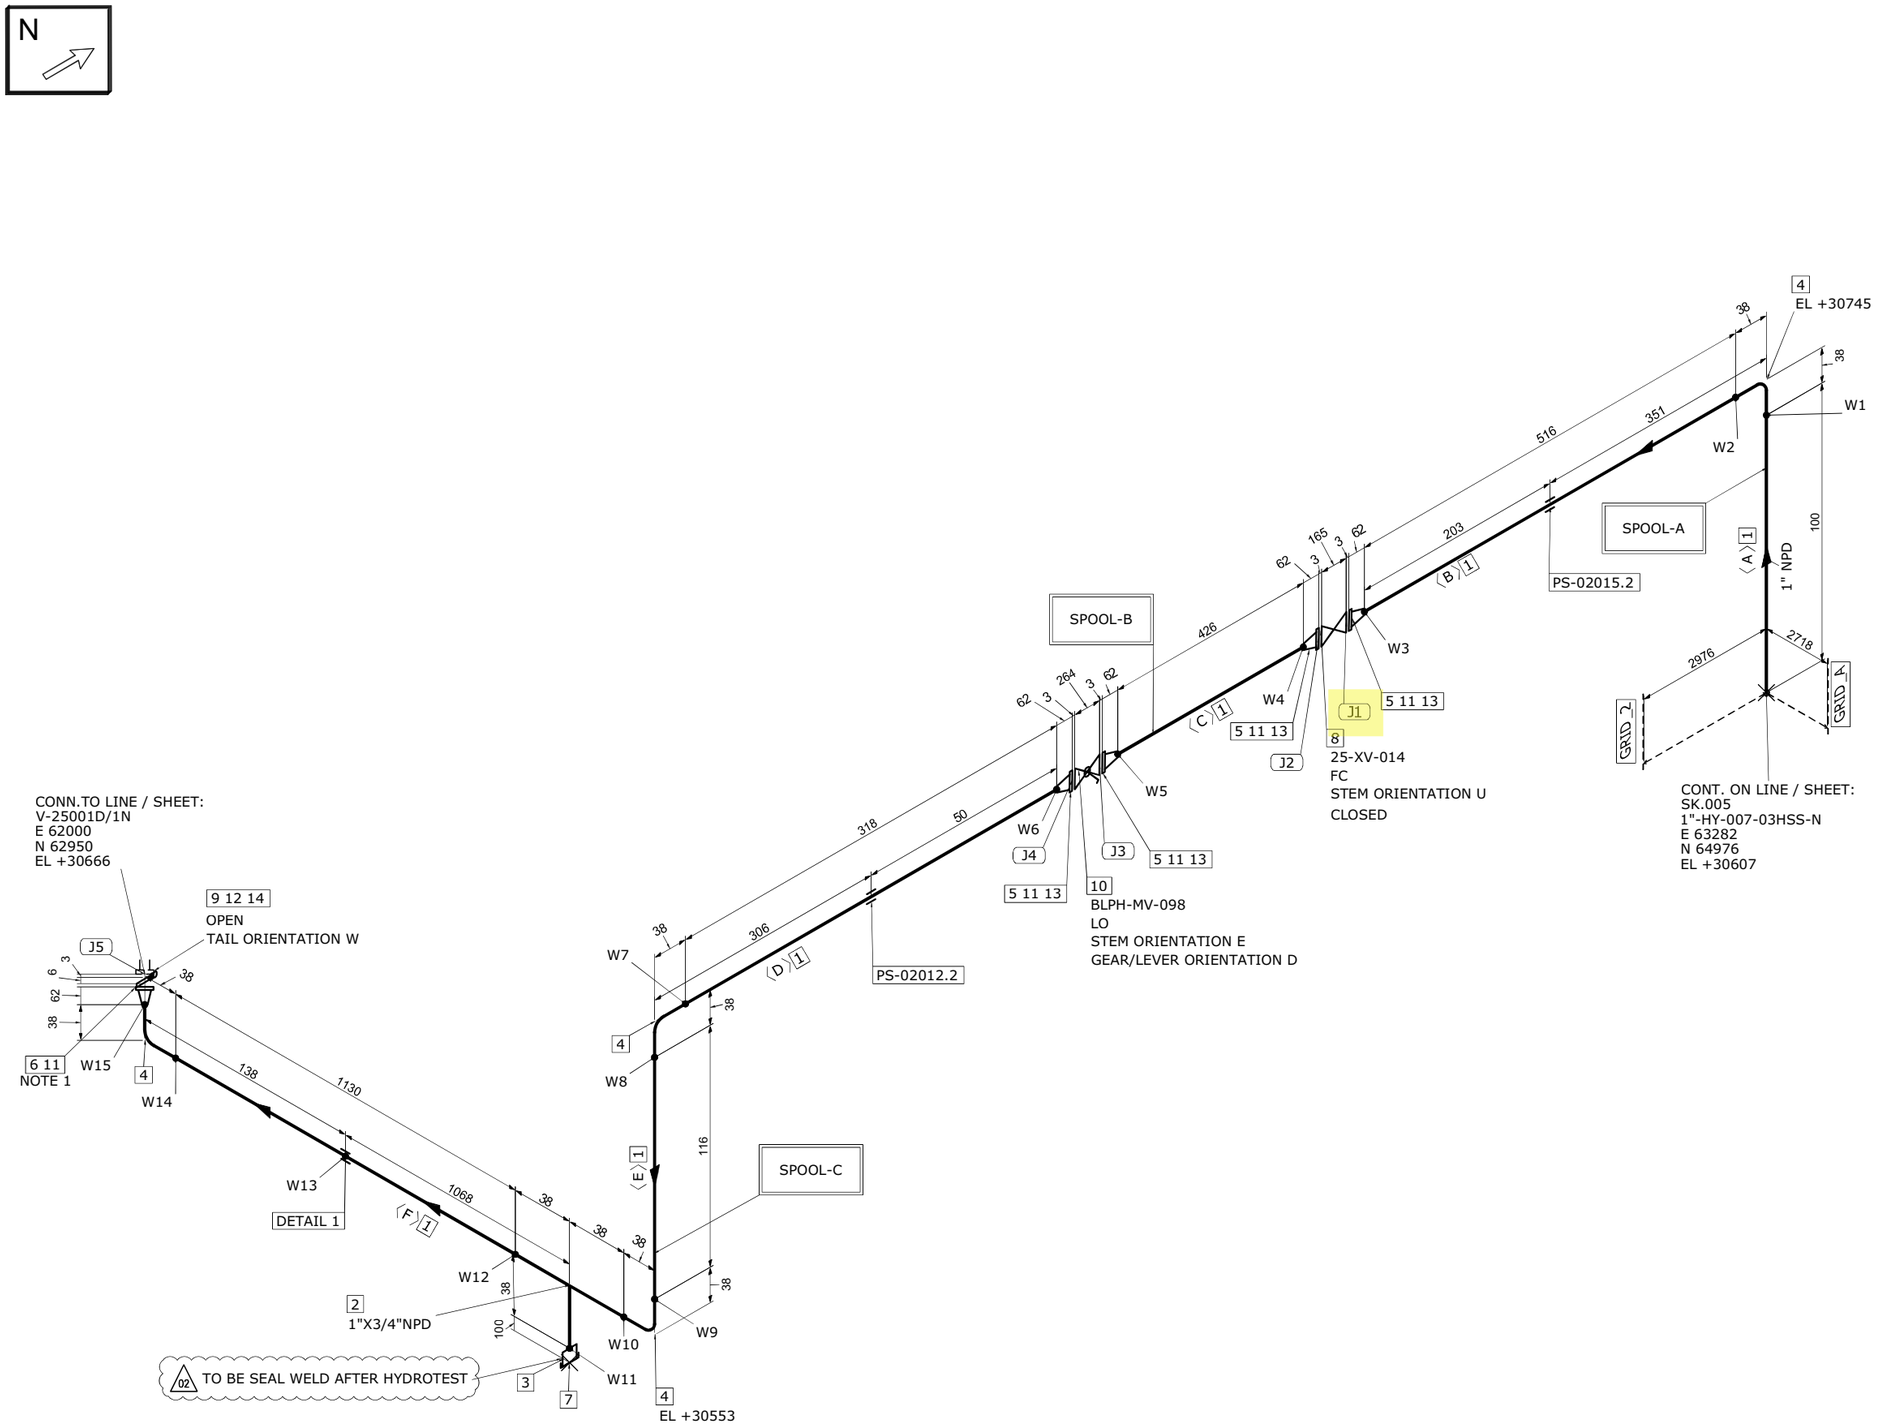

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.6M	6.6
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.8
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	3/4	BW
W12	1	BW
W13		FW
W14	1	BW
W15	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	100	BEVEL	BEVEL
B	1	516	BEVEL	BEVEL
C	1	426	BEVEL	BEVEL
D	1	318	BEVEL	BEVEL
E	1	116	BEVEL	BEVEL
F	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-02015.2
PS-02012.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	3.5
B	2	4.7
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-018-03HSS-N

SK.012

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK

SCALE: N/A

DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024

FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00012 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1			PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002		FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]		DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--			TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80018
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION N/S


MASTER

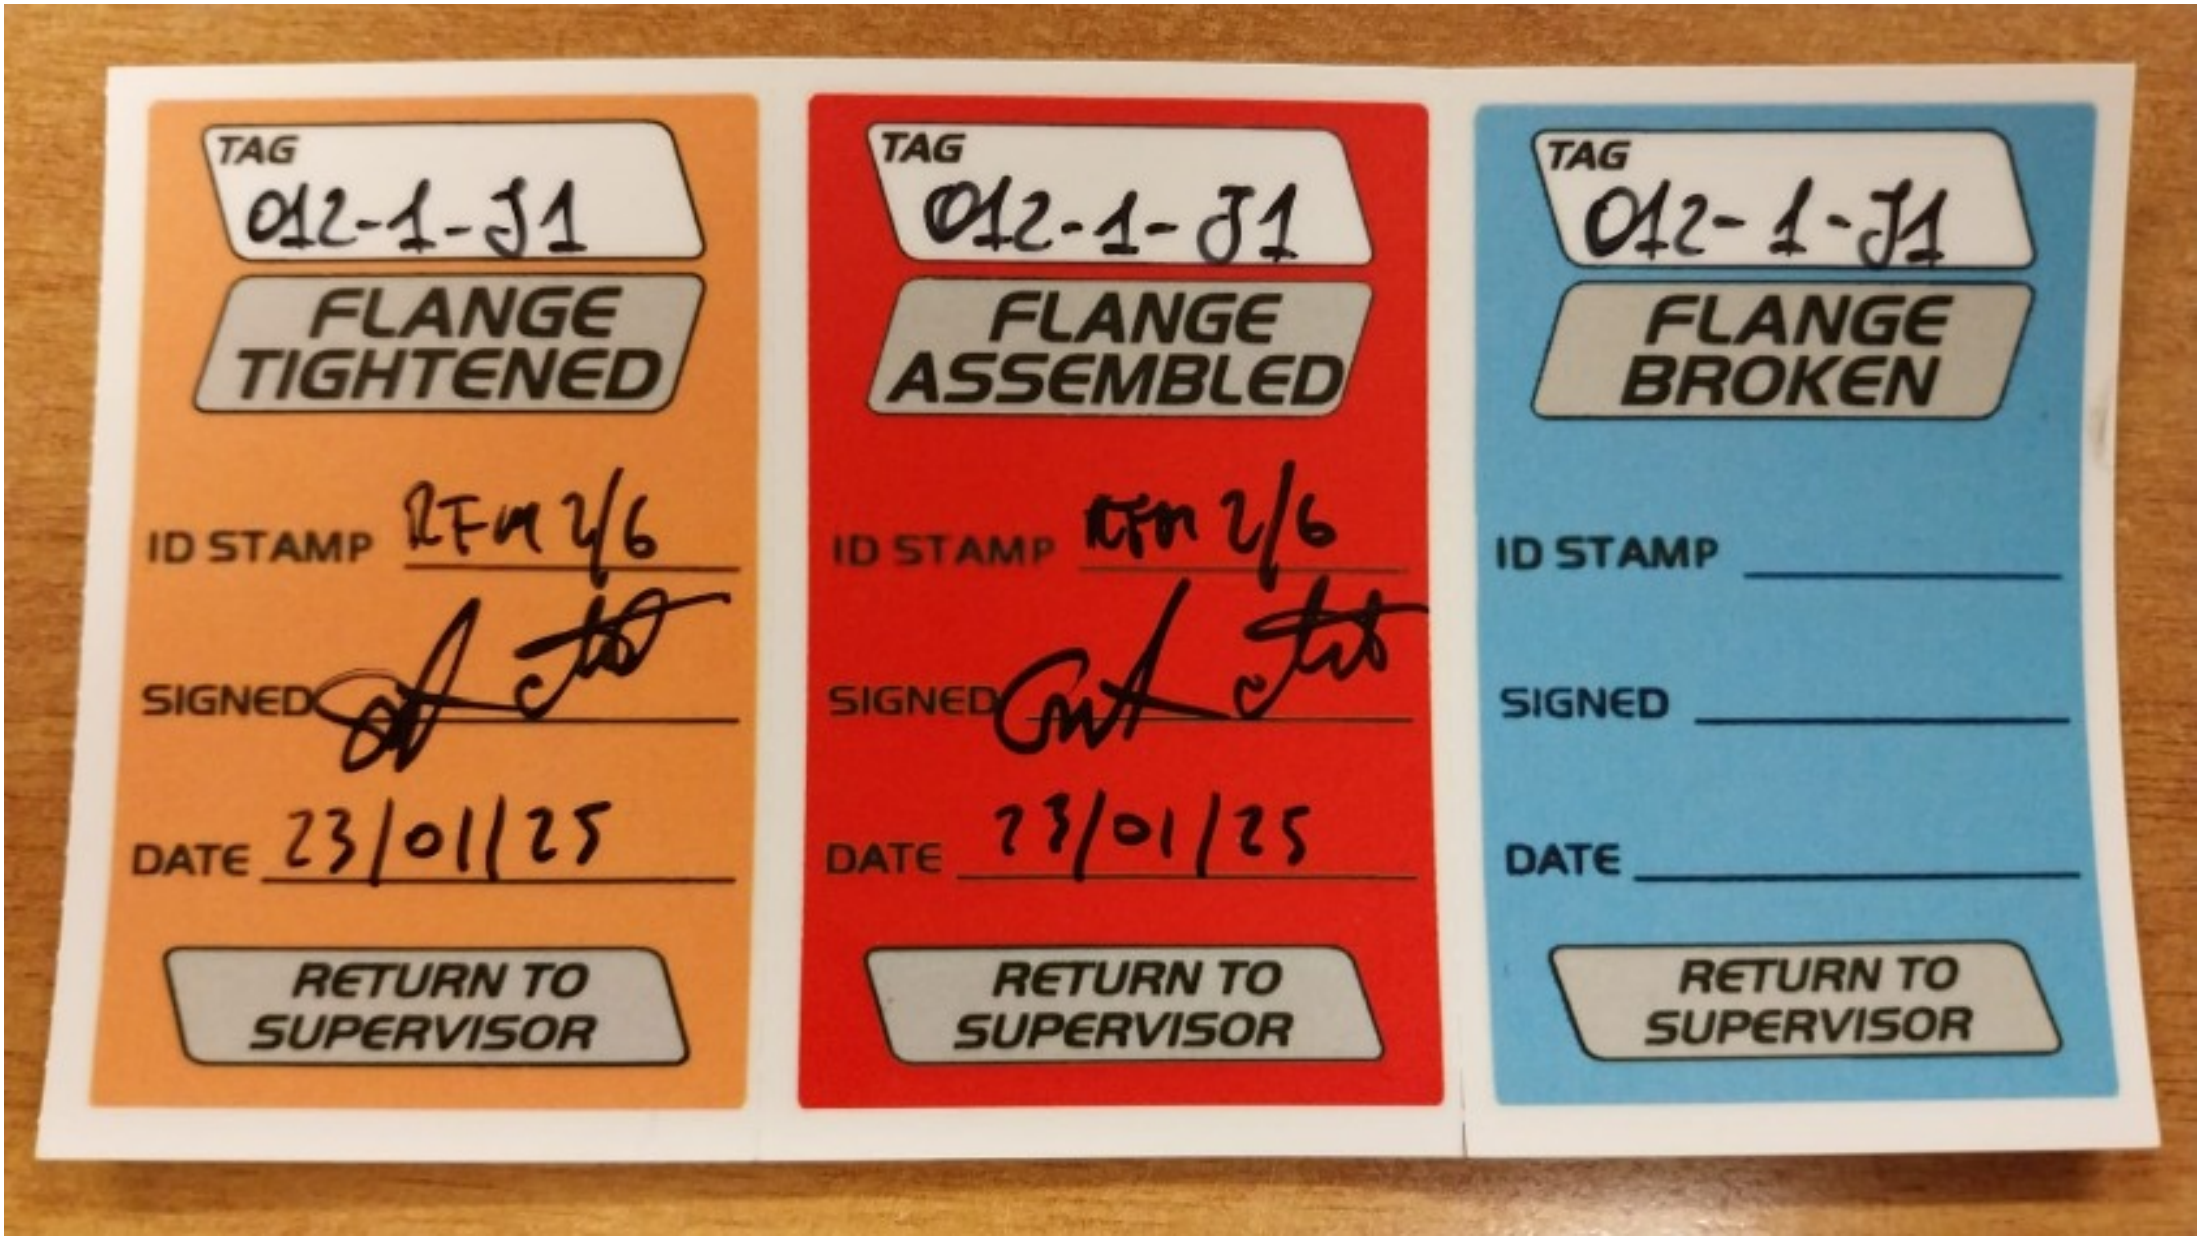
TAG
012-1-J1
FLANGE TIGHTENED
ID STAMP RFM 2/6
SIGNED
DATE 23/01/25
RETURN TO SUPERVISOR
TAG
012-1-J1
FLANGE ASSEMBLED
ID STAMP RFM 2/6
SIGNED
DATE 23/01/25
RETURN TO SUPERVISOR
TAG
012-1-J1
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	012-1-J2	: Joint 012-1-J2			Dwg	123A90-FDL-PP-DI-00012-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003852		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	V030390 / RD00261
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes


4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-27	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:53:09.887Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-27T15:03:24.475Z	

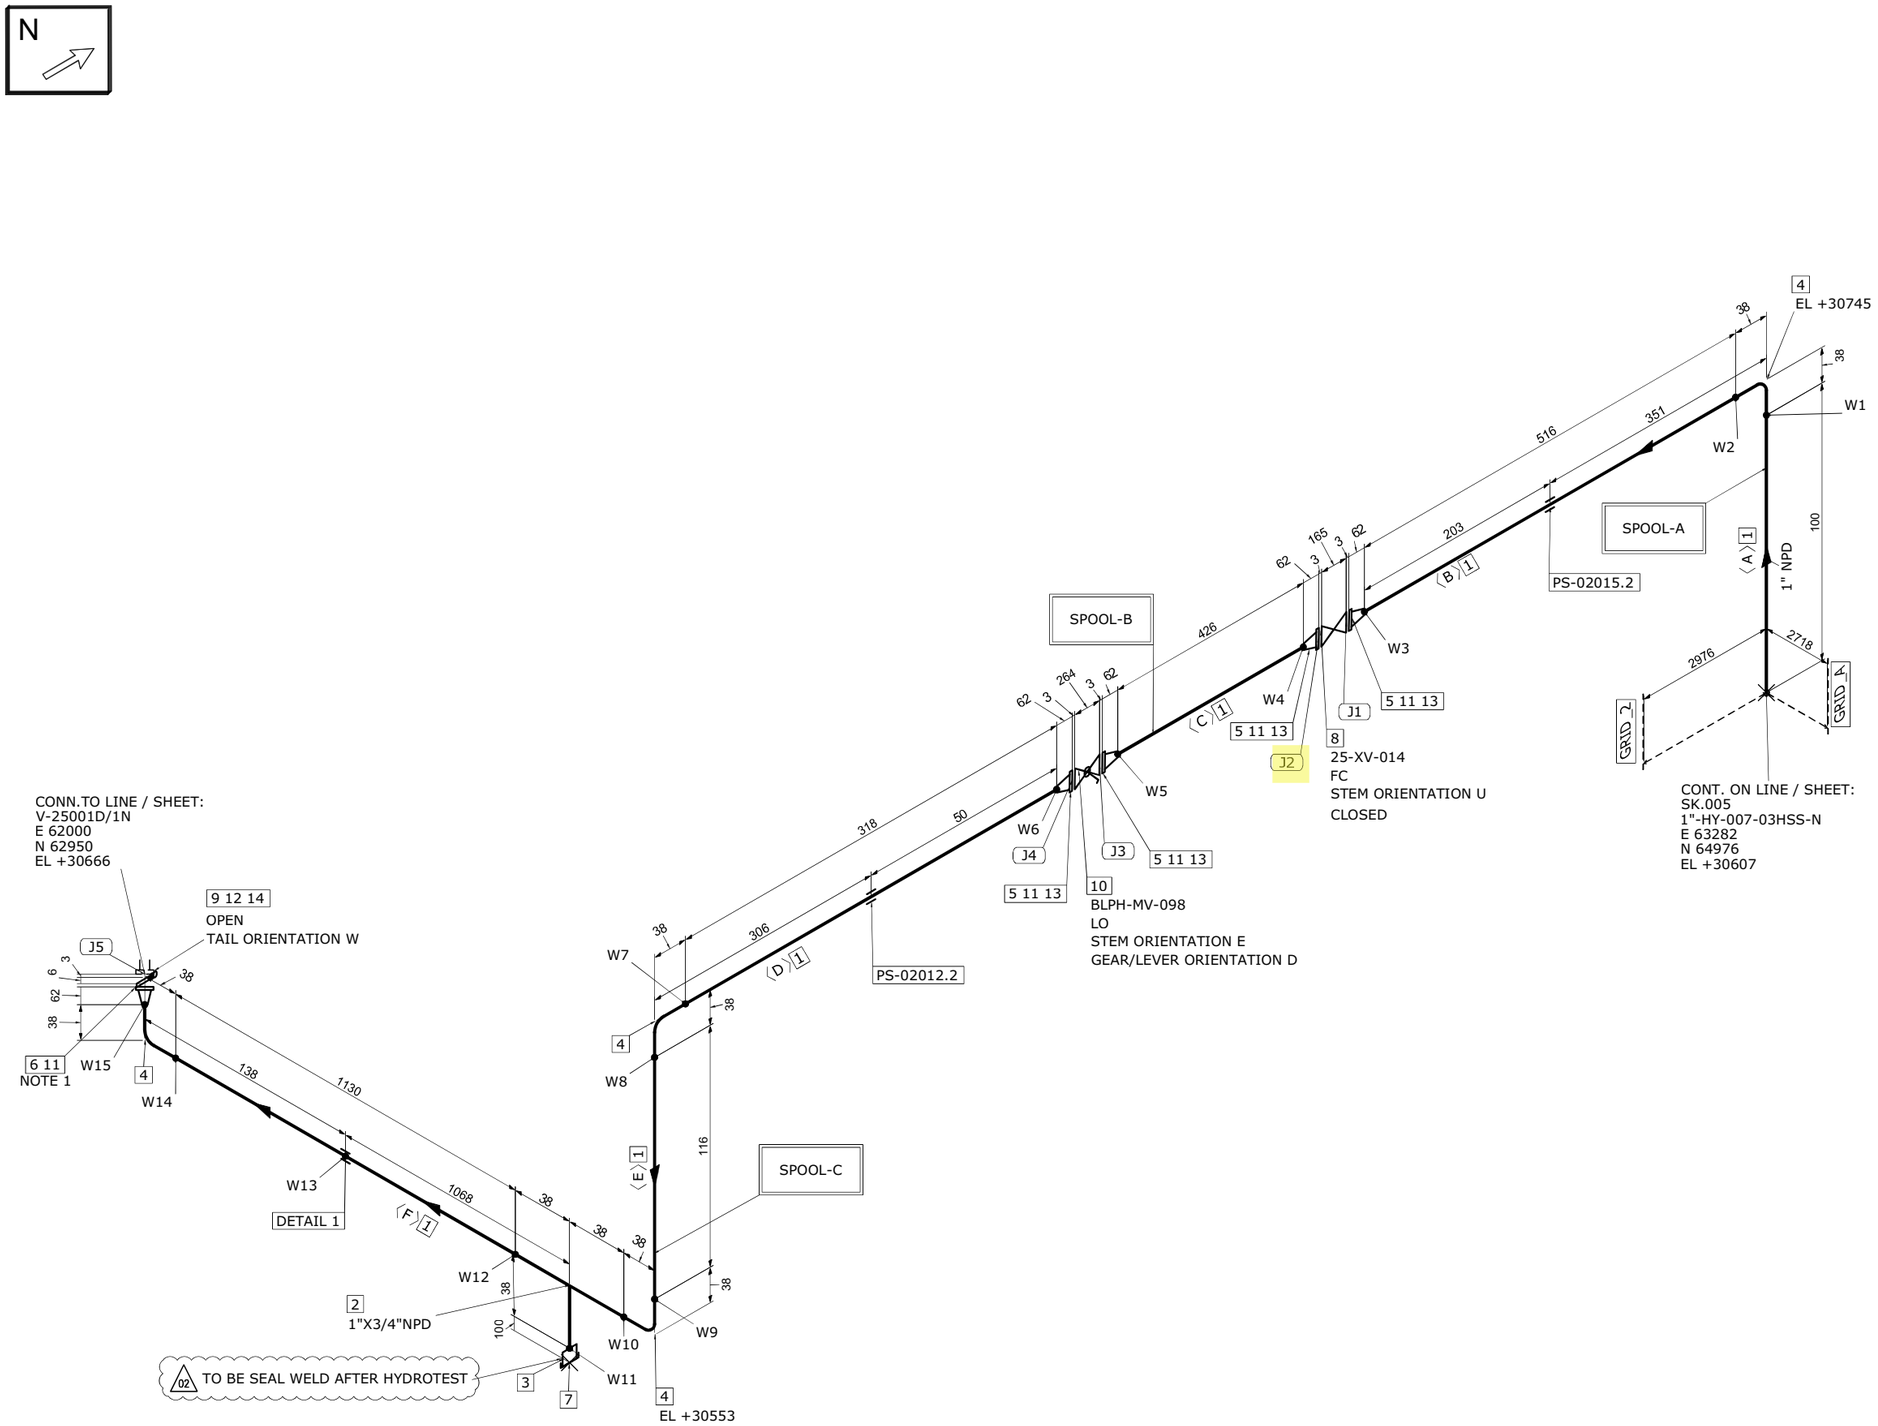

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.6M	6.6
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.8
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	3/4	BW
W12	1	BW
W13		FW
W14	1	BW
W15	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	100	BEVEL	BEVEL
B	1	516	BEVEL	BEVEL
C	1	426	BEVEL	BEVEL
D	1	318	BEVEL	BEVEL
E	1	116	BEVEL	BEVEL
F	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-02015.2
PS-02012.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	3.5
B	2	4.7
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-018-03HSS-N

SK.012

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK

SCALE: N/A

DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024

FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00012 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1			PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002		FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]		DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--			TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		

REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80018
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION N/S

MASTER



TAG
012-1-J2
FLANGE TIGHTENED
ID STAMP
SIGNED
DATE 22/01/2025
RETURN TO SUPERVISOR
TAG
012-1-J2
FLANGE ASSEMBLED
ID STAMP
SIGNED
DATE 22/01/2025
RETURN TO SUPERVISOR
TAG
012-1-J2
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ROSETTI MARINO — CROSSWIND

ITEM	Tag	012-1-J3	: Joint 012-1-J3			Dwg	123A90-FDL-PP-DI-00012-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003853		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 — Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Stick to design the concerned flange

Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	V030390 / RD00261
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes


4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-27	
Signature	Digitaly signed by Emanuele Delfino 2025-01-23T05:53:20.893Z	Digitaly signed by Andrea Mancini 2025-01-27T15:03:36.756Z	

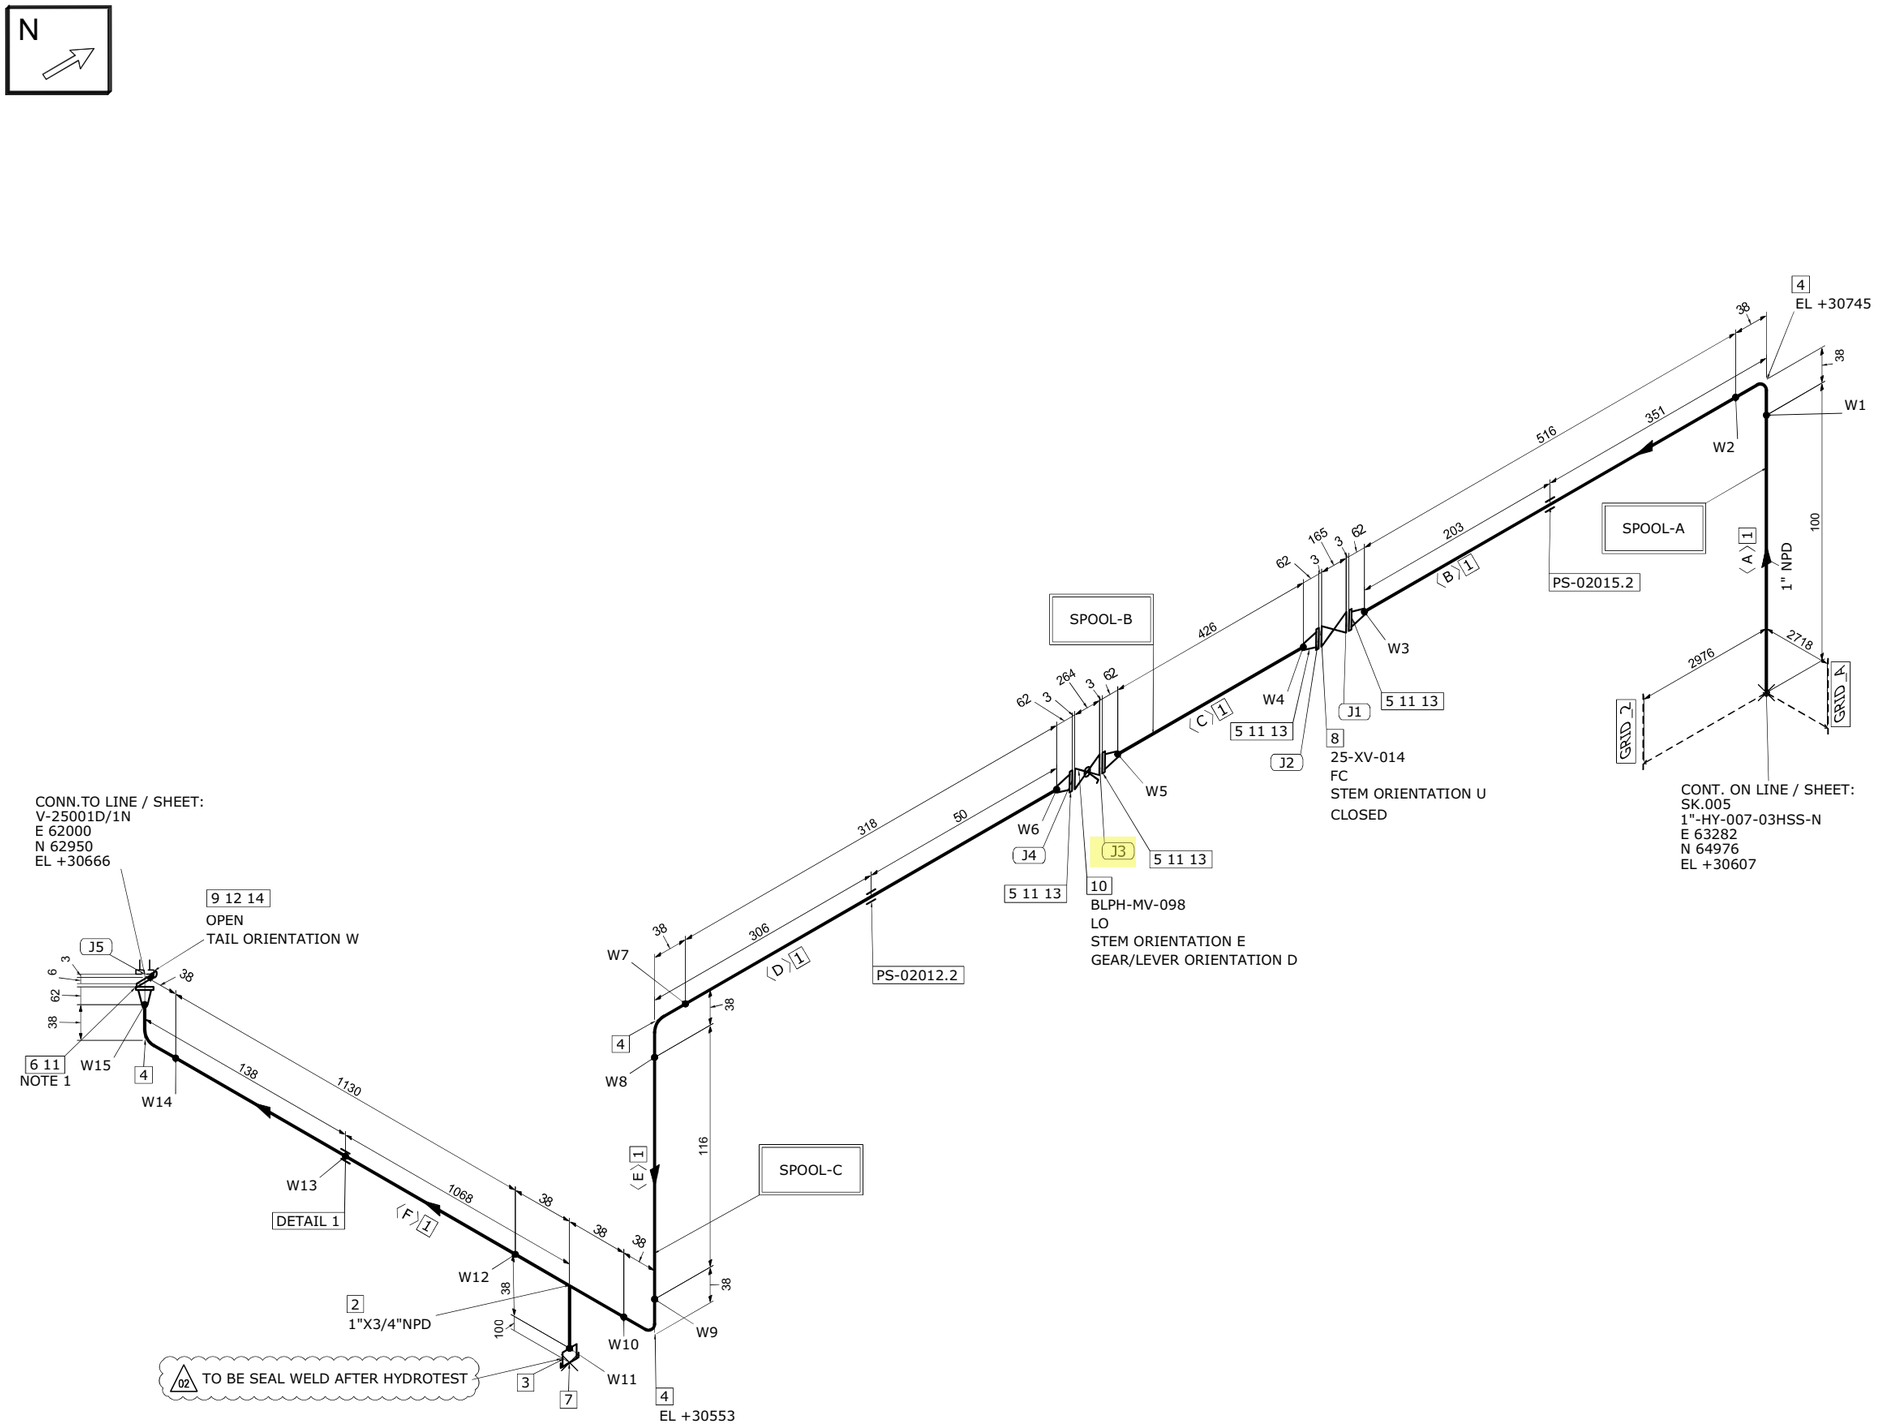

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.6M	6.6
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.8
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	3/4	BW
W12	1	BW
W13		FW
W14	1	BW
W15	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	100	BEVEL	BEVEL
B	1	516	BEVEL	BEVEL
C	1	426	BEVEL	BEVEL
D	1	318	BEVEL	BEVEL
E	1	116	BEVEL	BEVEL
F	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-02015.2
PS-02012.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	3.5
B	2	4.7
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-018-03HSS-N

SK.012

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A
DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024
FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00012 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80018
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION N/S


MASTER

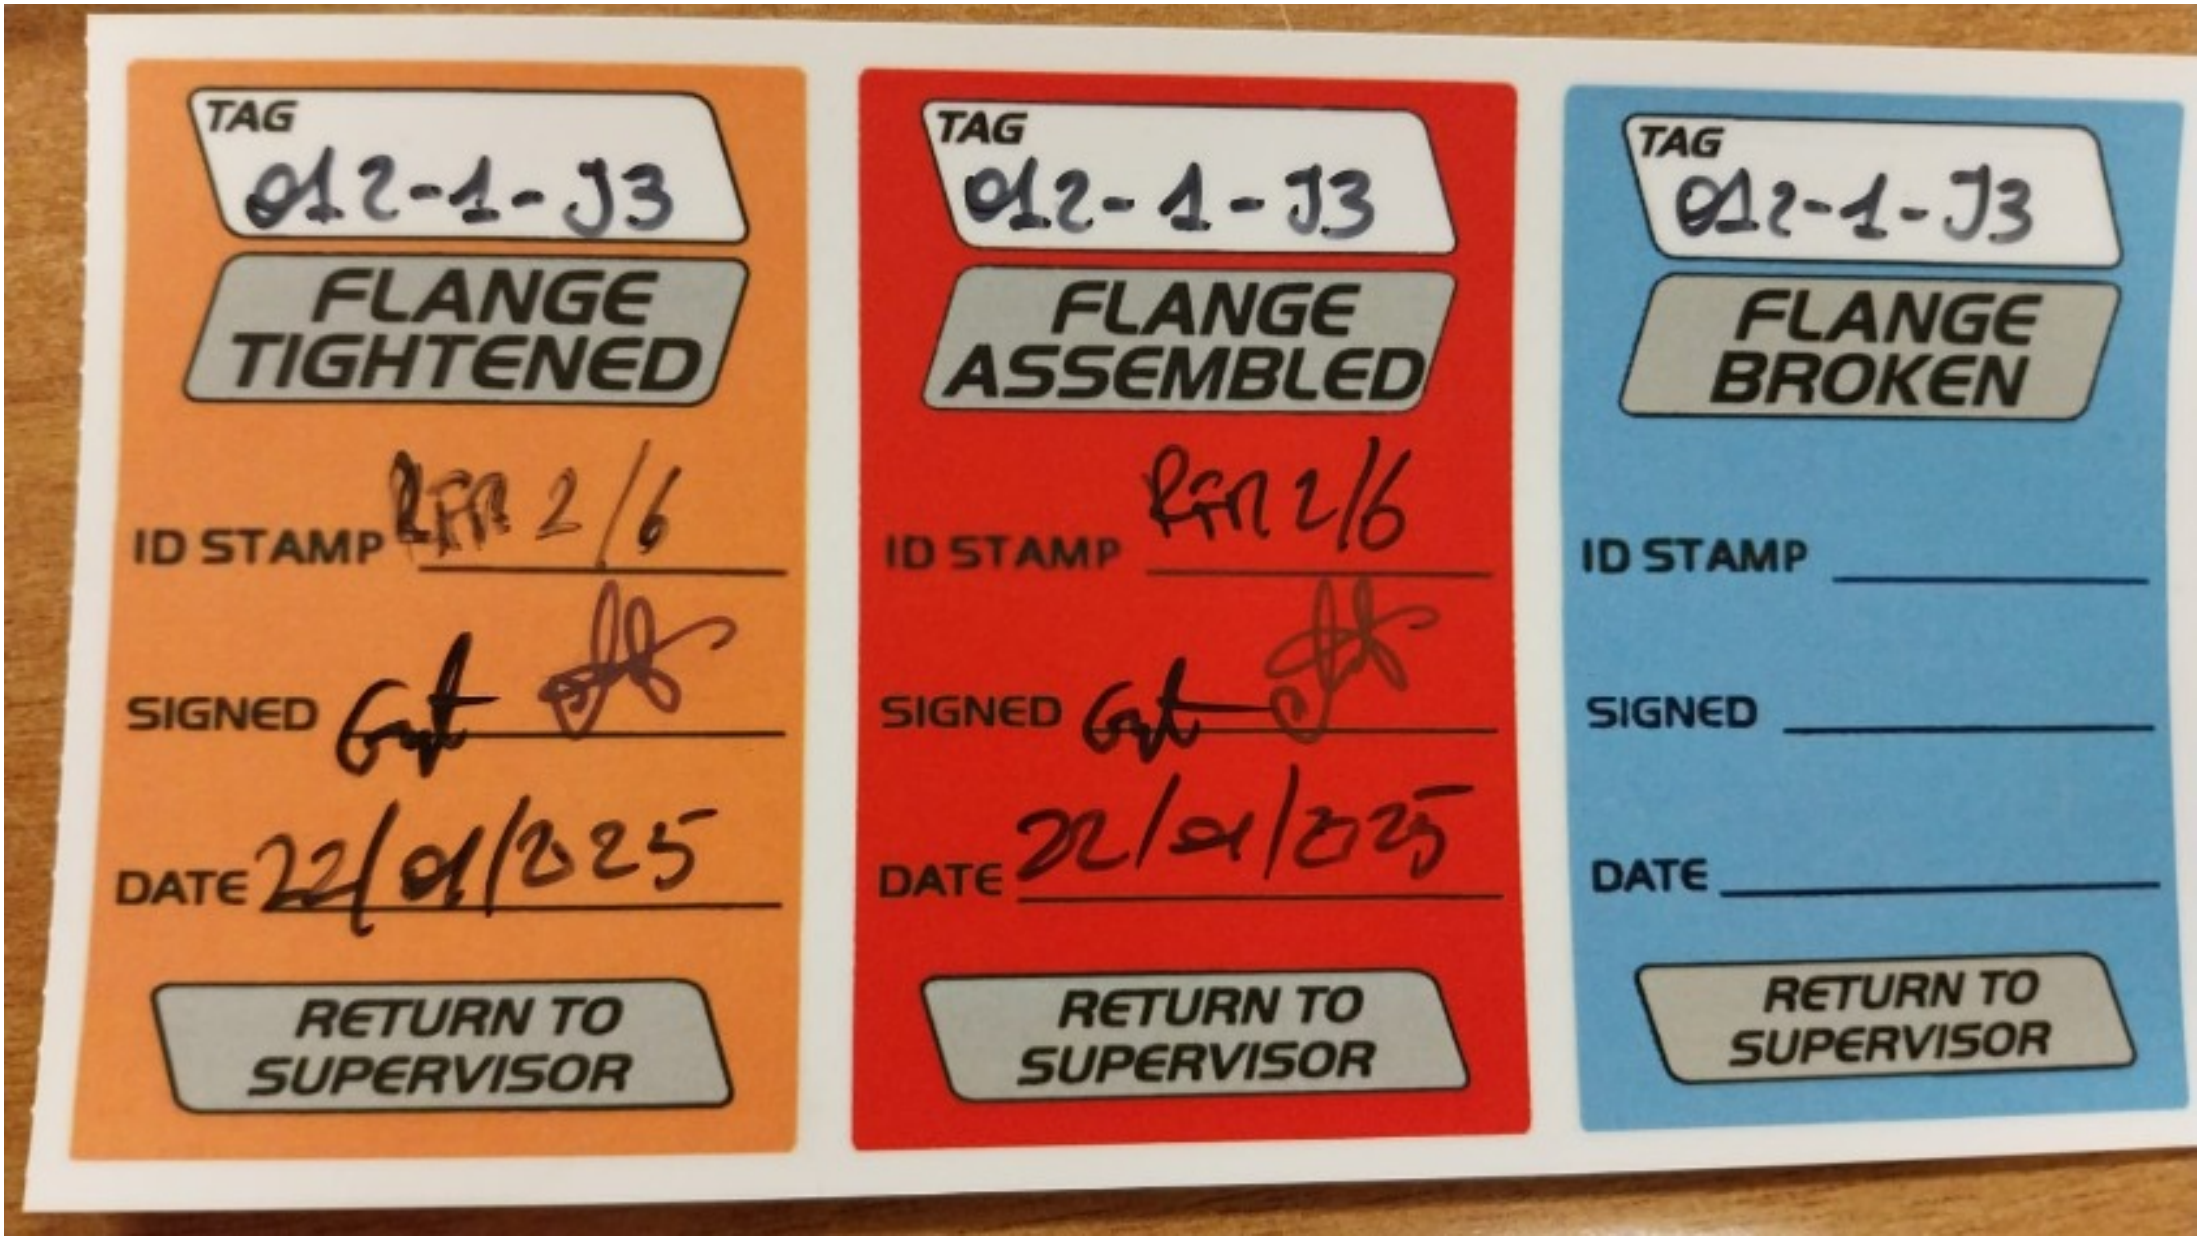
TAG
012-1-J3
FLANGE TIGHTENED
ID STAMP RFA 2/6
SIGNED
DATE 22/01/2025
RETURN TO SUPERVISOR
TAG
012-1-J3
FLANGE ASSEMBLED
ID STAMP RFA 2/6
SIGNED
DATE 22/01/2025
RETURN TO SUPERVISOR
TAG
012-1-J3
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	013-1-J1	: Joint 013-1-J1			Dwg	123A90-FDL-PP-DI-00013-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003856		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	V030390 / RD00261
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes


4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-24	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:53:30.829Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-24T08:21:05.705Z	

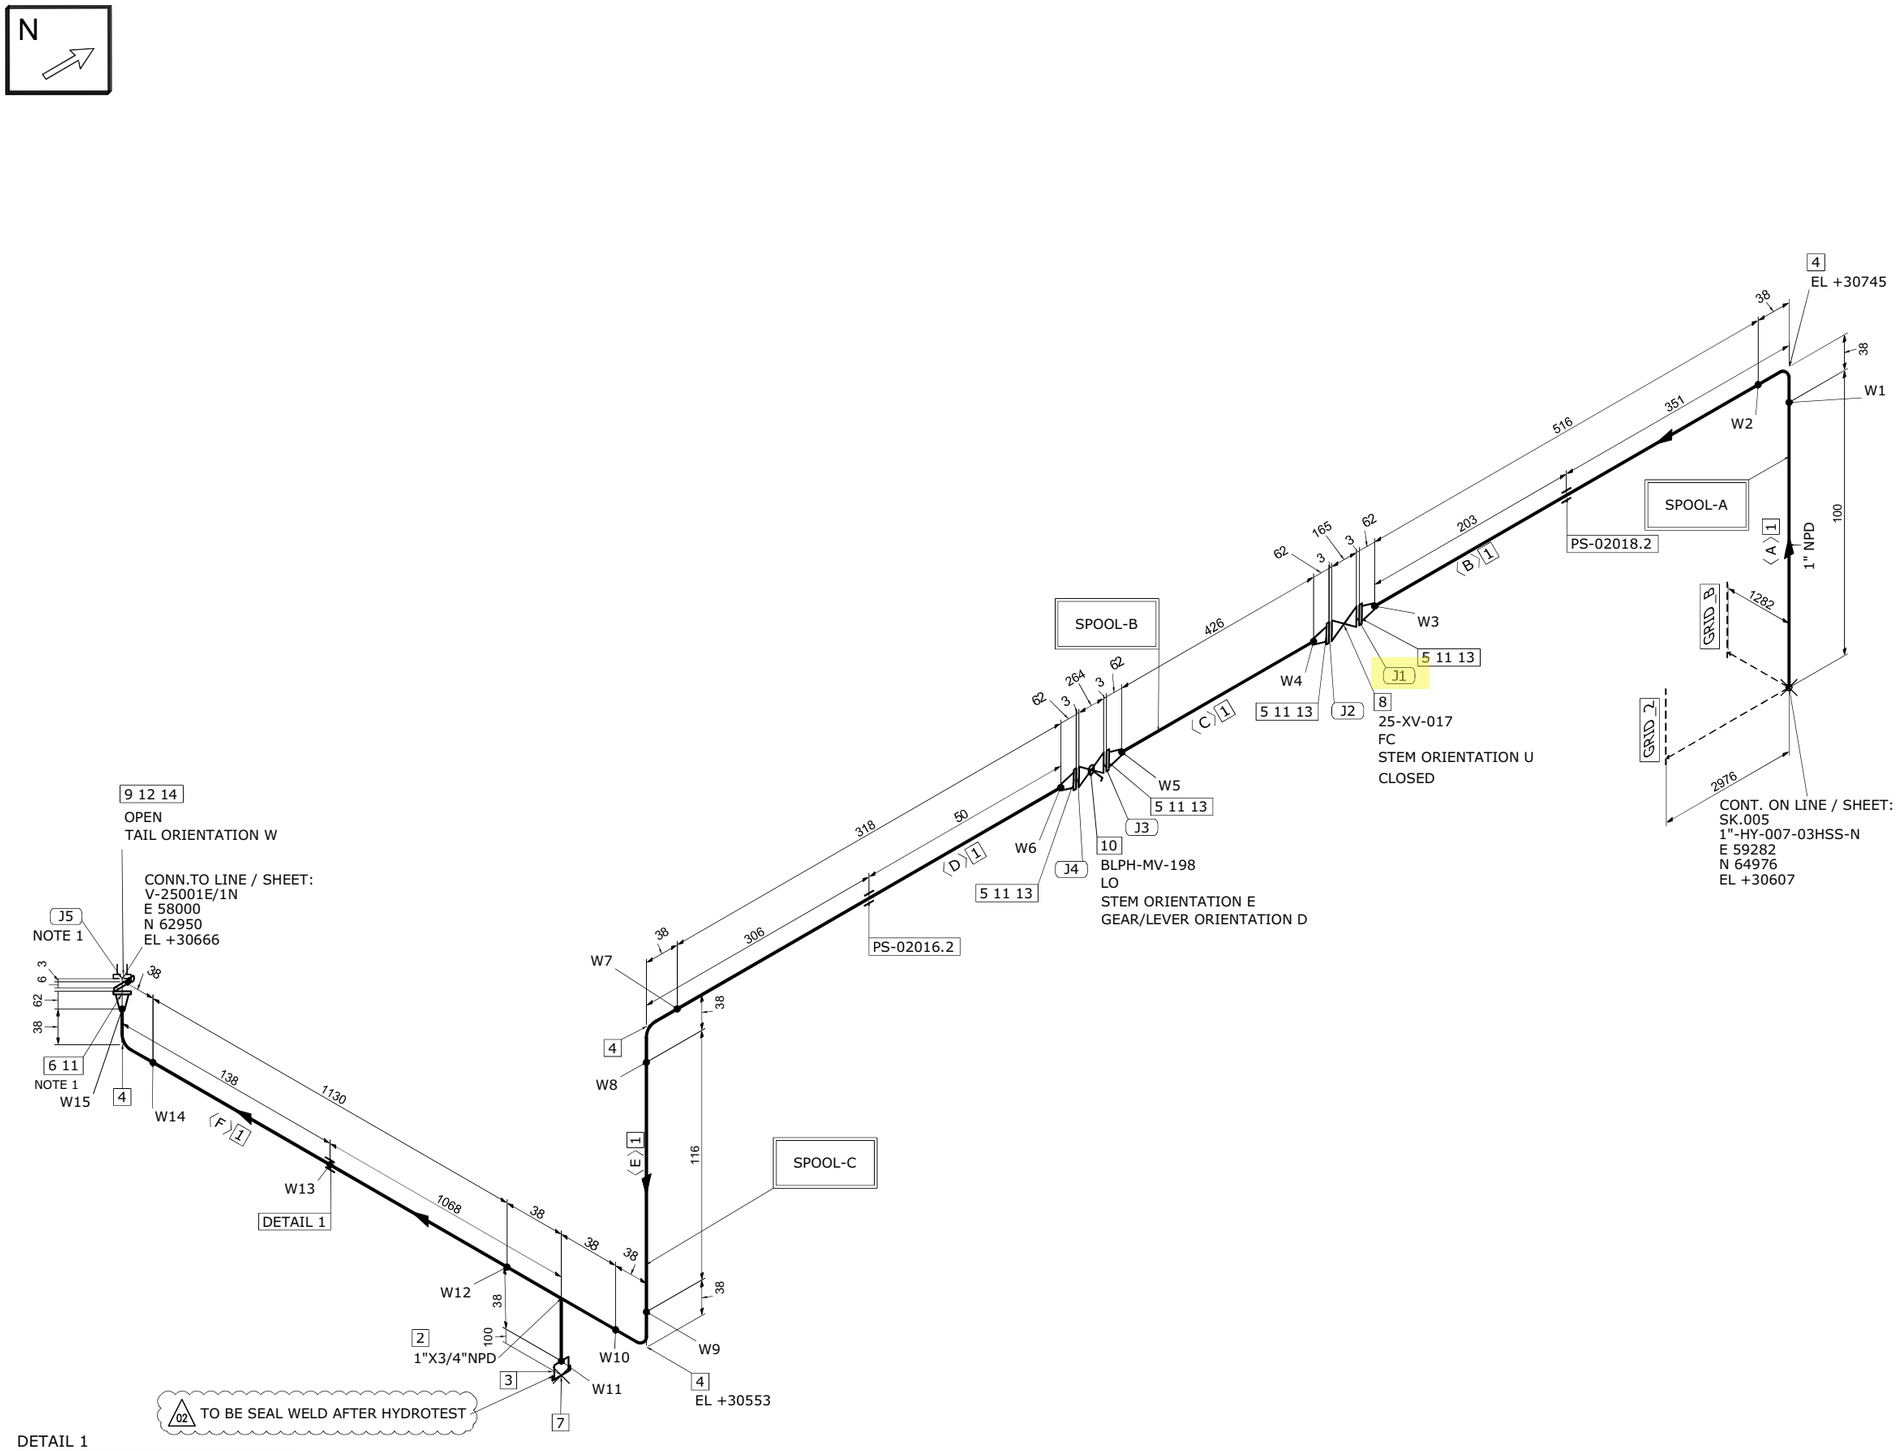

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.6M	6.6
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.8
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	3/4	BW
W12	1	BW
W13		FW
W14	1	BW
W15	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	100	BEVEL	BEVEL
B	1	516	BEVEL	BEVEL
C	1	426	BEVEL	BEVEL
D	1	318	BEVEL	BEVEL
E	1	116	BEVEL	BEVEL
F	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-02018.2
PS-02016.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	3.5
B	2	4.7
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-019-03HSS-N

SK.013

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A
DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024
FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00013 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1			PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002		FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS	[mm]	DESIGN	PRESS. 40	[barg]	TEMP. -29 / 80	[°C]	
HEAT TRACING	--			TEST	PRESS. 60	[barg]	TEMP. AMB	MEDIUM Water	

REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80019
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION N/S

MASTER

TAG 013-1-J1

FLANGE TIGHTENED

ID STAMP CFM 2/6

SIGNED

DATE 23/01/25

RETURN TO SUPERVISOR

TAG 013-1-J1

FLANGE ASSEMBLED

ID STAMP RFM 2/6

SIGNED

DATE 23/01/23

RETURN TO SUPERVISOR

TAG 013-1-J1

FLANGE BROKEN

ID STAMP

SIGNED


DATE

RETURN TO SUPERVISOR

ITEM	Tag	013-1-J2	: Joint 013-1-J2			Dwg	123A90-FDL-PP-DI-00013-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003857		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG




Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	V030390 / RD00261
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8


1	**Clear Bore Inspection:** Pipe and Valve clear of debris/contamination.	Yes
2	**Flange Face Check:** Both flanges clean and free from damage.	Yes
3	**Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique.	Yes
4	**Alignment:** Check alignment according to code.	Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-24	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:53:42.694Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-24T08:21:19.188Z	

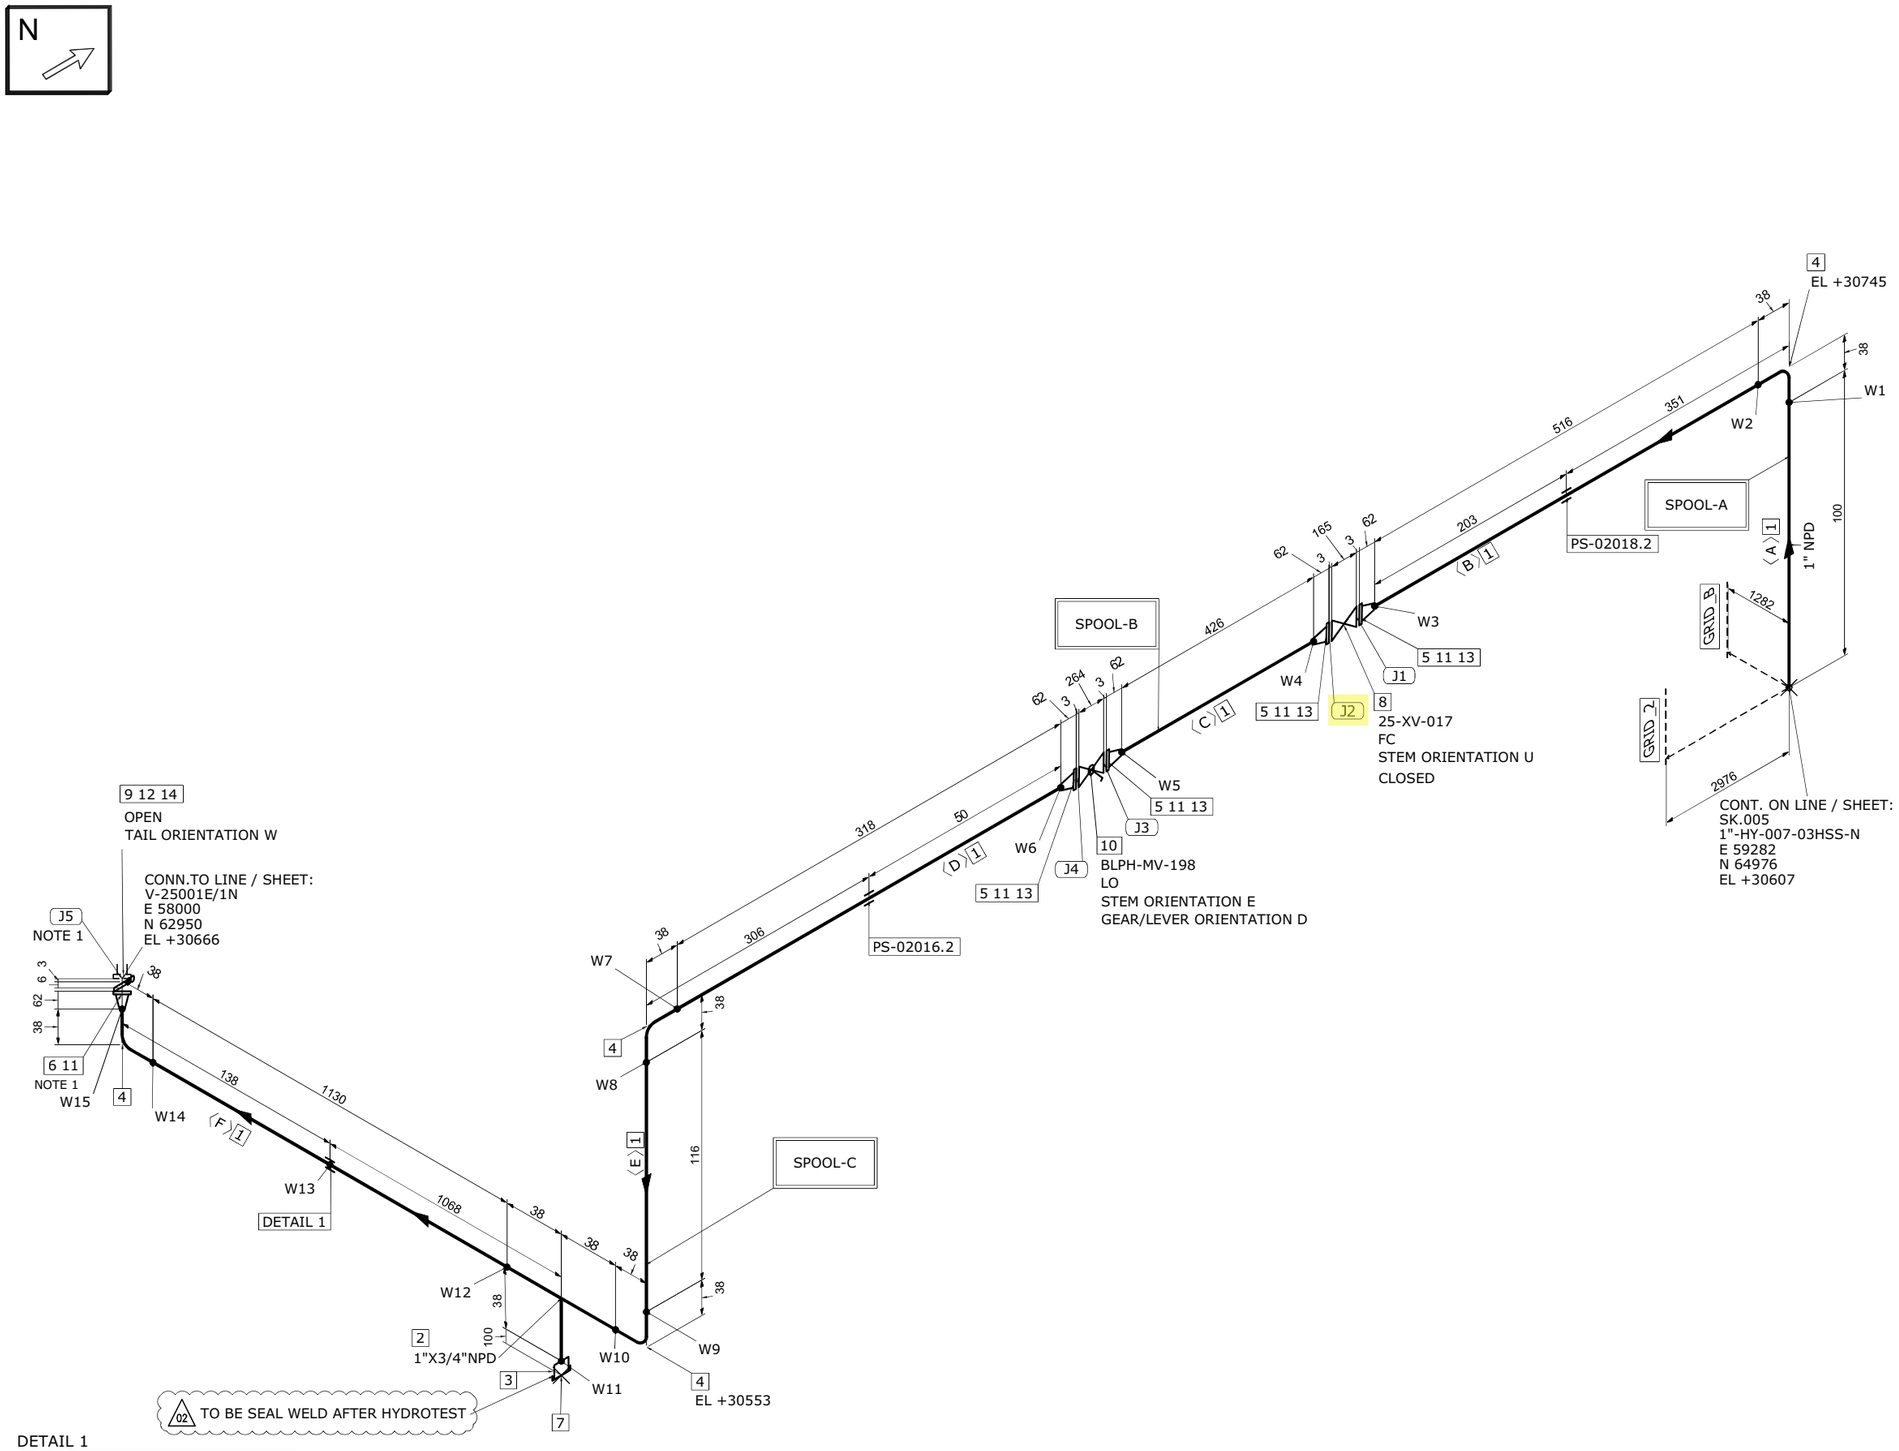

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.6M	6.6
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.8
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	3/4	BW
W12	1	BW
W13		FW
W14	1	BW
W15	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	100	BEVEL	BEVEL
B	1	516	BEVEL	BEVEL
C	1	426	BEVEL	BEVEL
D	1	318	BEVEL	BEVEL
E	1	116	BEVEL	BEVEL
F	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-02018.2
PS-02016.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	3.5
B	2	4.7
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-019-03HSS-N

SK.013

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A
DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024
FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00013 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1			PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002		FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]		DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--			TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80019
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION N/S


MASTER

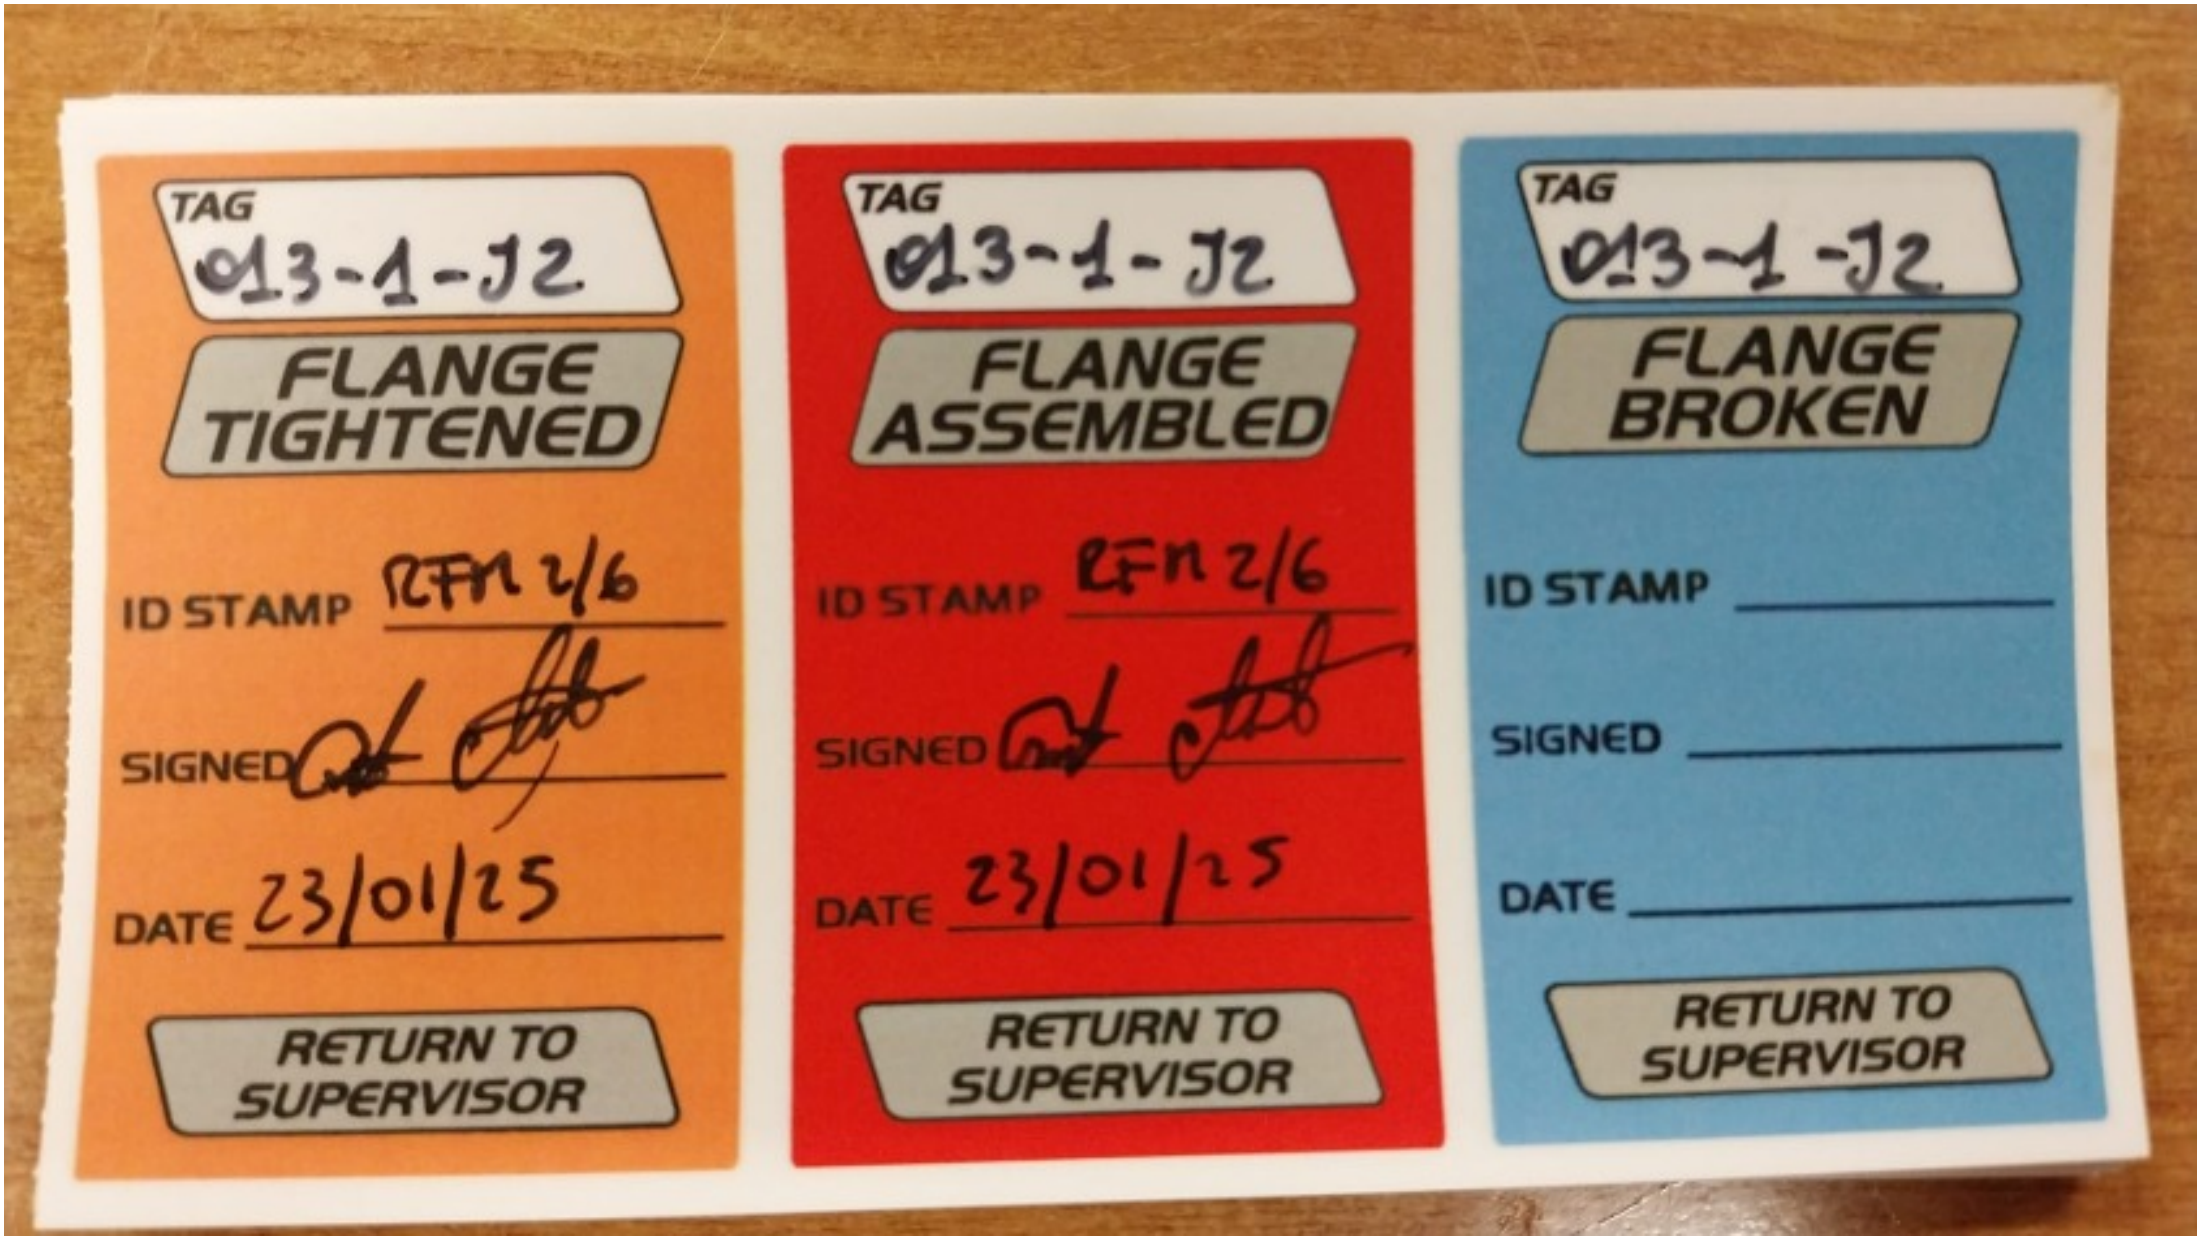
TAG
013-1-J2
FLANGE TIGHTENED
ID STAMP RFN 2/6
SIGNED
DATE 23/01/25
RETURN TO SUPERVISOR
TAG
013-1-J2
FLANGE ASSEMBLED
ID STAMP RFN 2/6
SIGNED
DATE 23/01/25
RETURN TO SUPERVISOR
TAG
013-1-J2
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	013-1-J3	: Joint 013-1-J3			Dwg	123A90-FDL-PP-DI-00013-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003858		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 — Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	V030390 / RD00261
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes


4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company		RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-24	
Signature	Digitaly signed by Emanuele Delfino 2025-01-23T05:53:54.110Z	Digitaly signed by Andrea Mancini 2025-01-24T08:21:31.998Z	

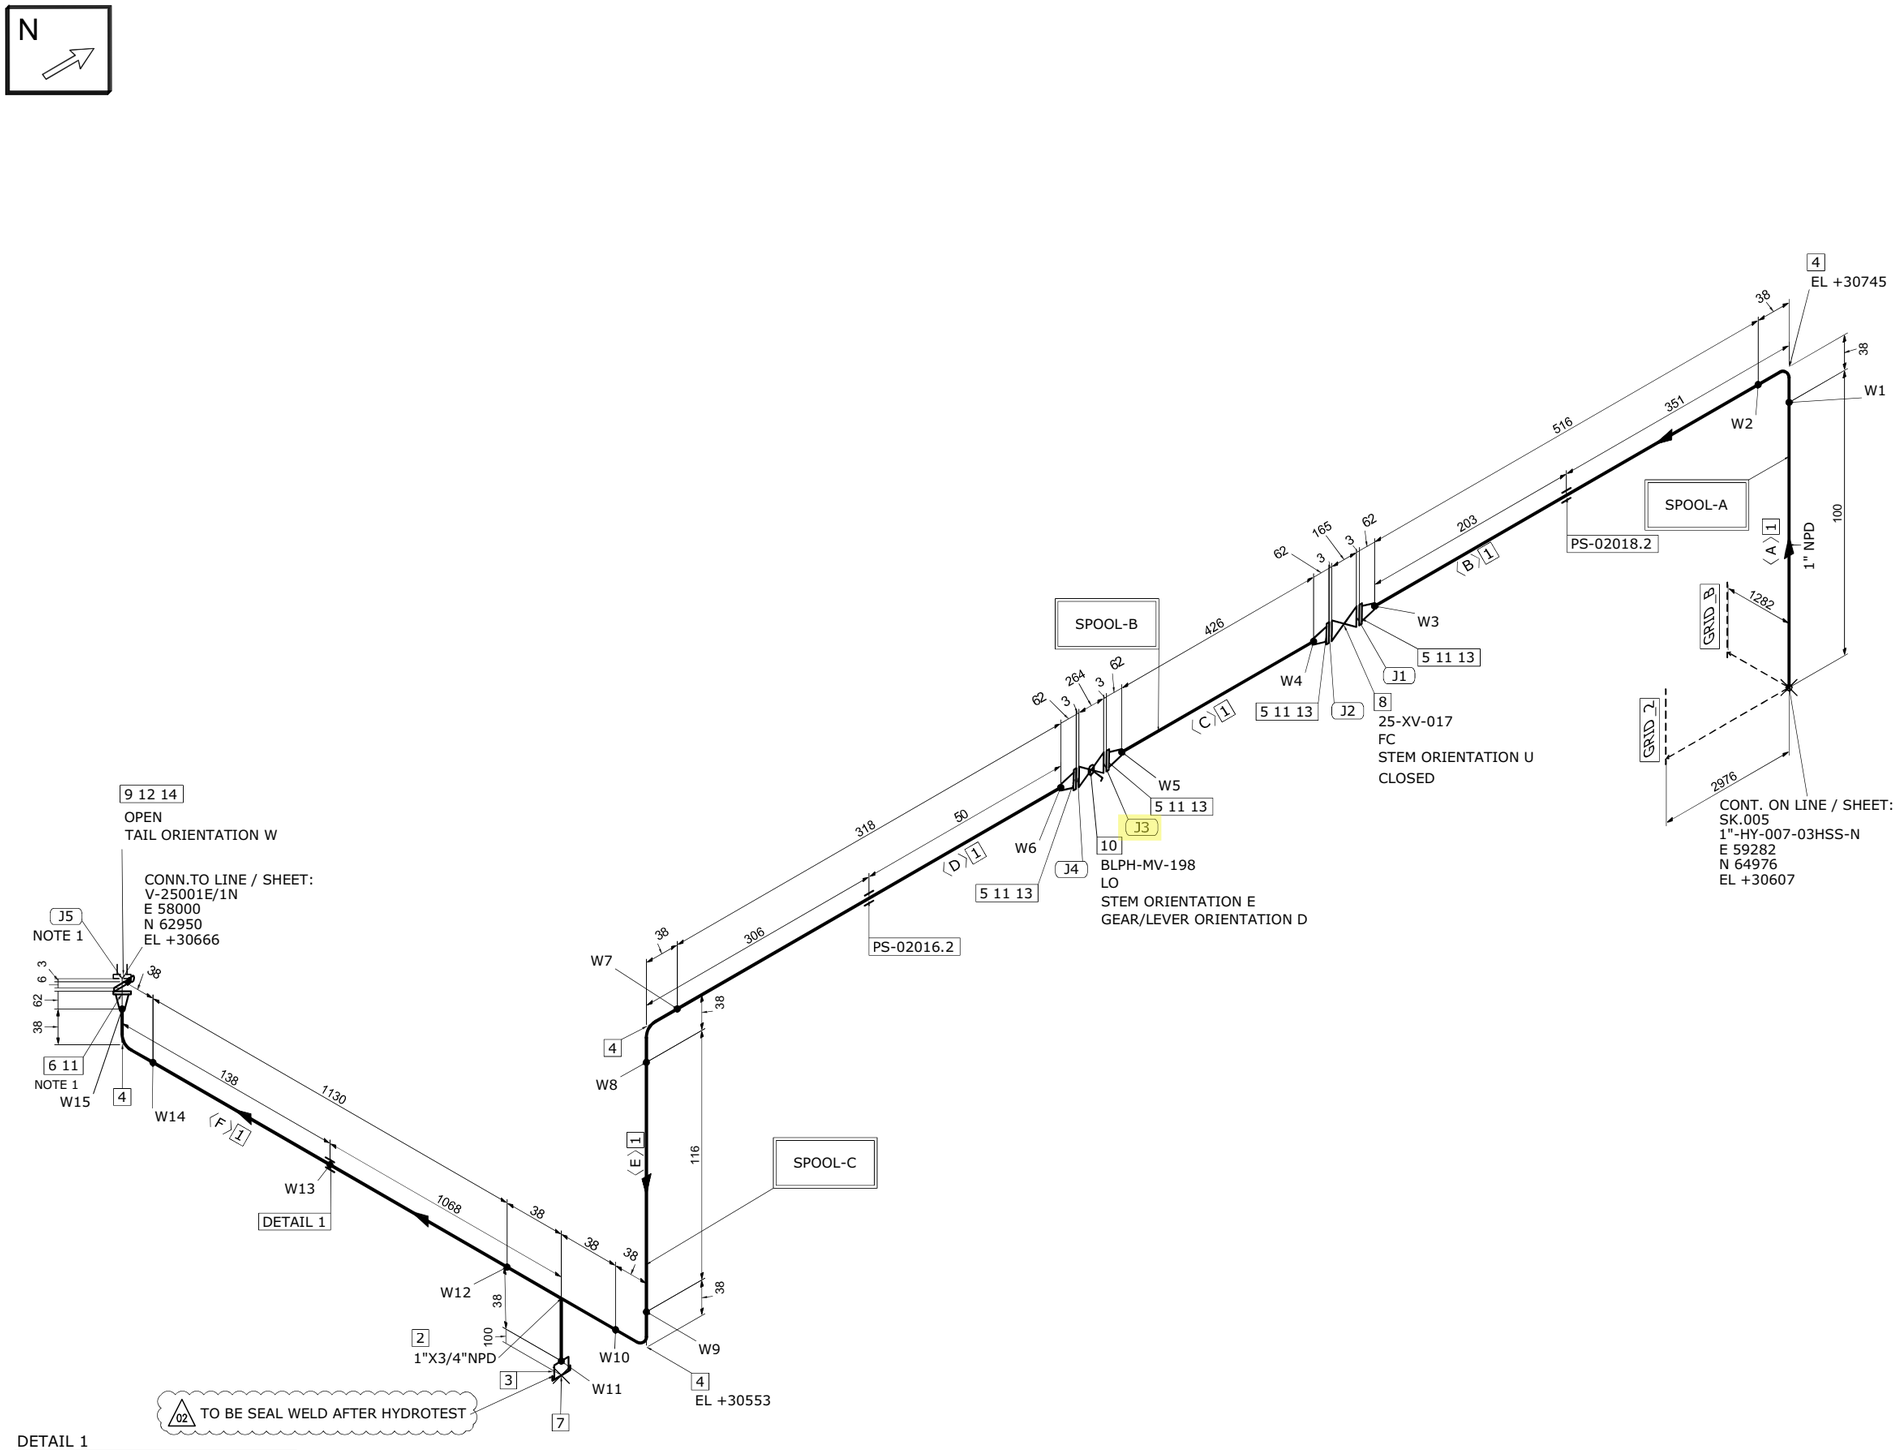

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.6M	6.6
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.8
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	3/4	BW
W12	1	BW
W13		FW
W14	1	BW
W15	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	100	BEVEL	BEVEL
B	1	516	BEVEL	BEVEL
C	1	426	BEVEL	BEVEL
D	1	318	BEVEL	BEVEL
E	1	116	BEVEL	BEVEL
F	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-02018.2
PS-02016.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	3.5
B	2	4.7
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-019-03HSS-N

SK.013

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A
DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024
FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00013 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1			PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002		FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]		DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--			TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80019
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION N/S


MASTER

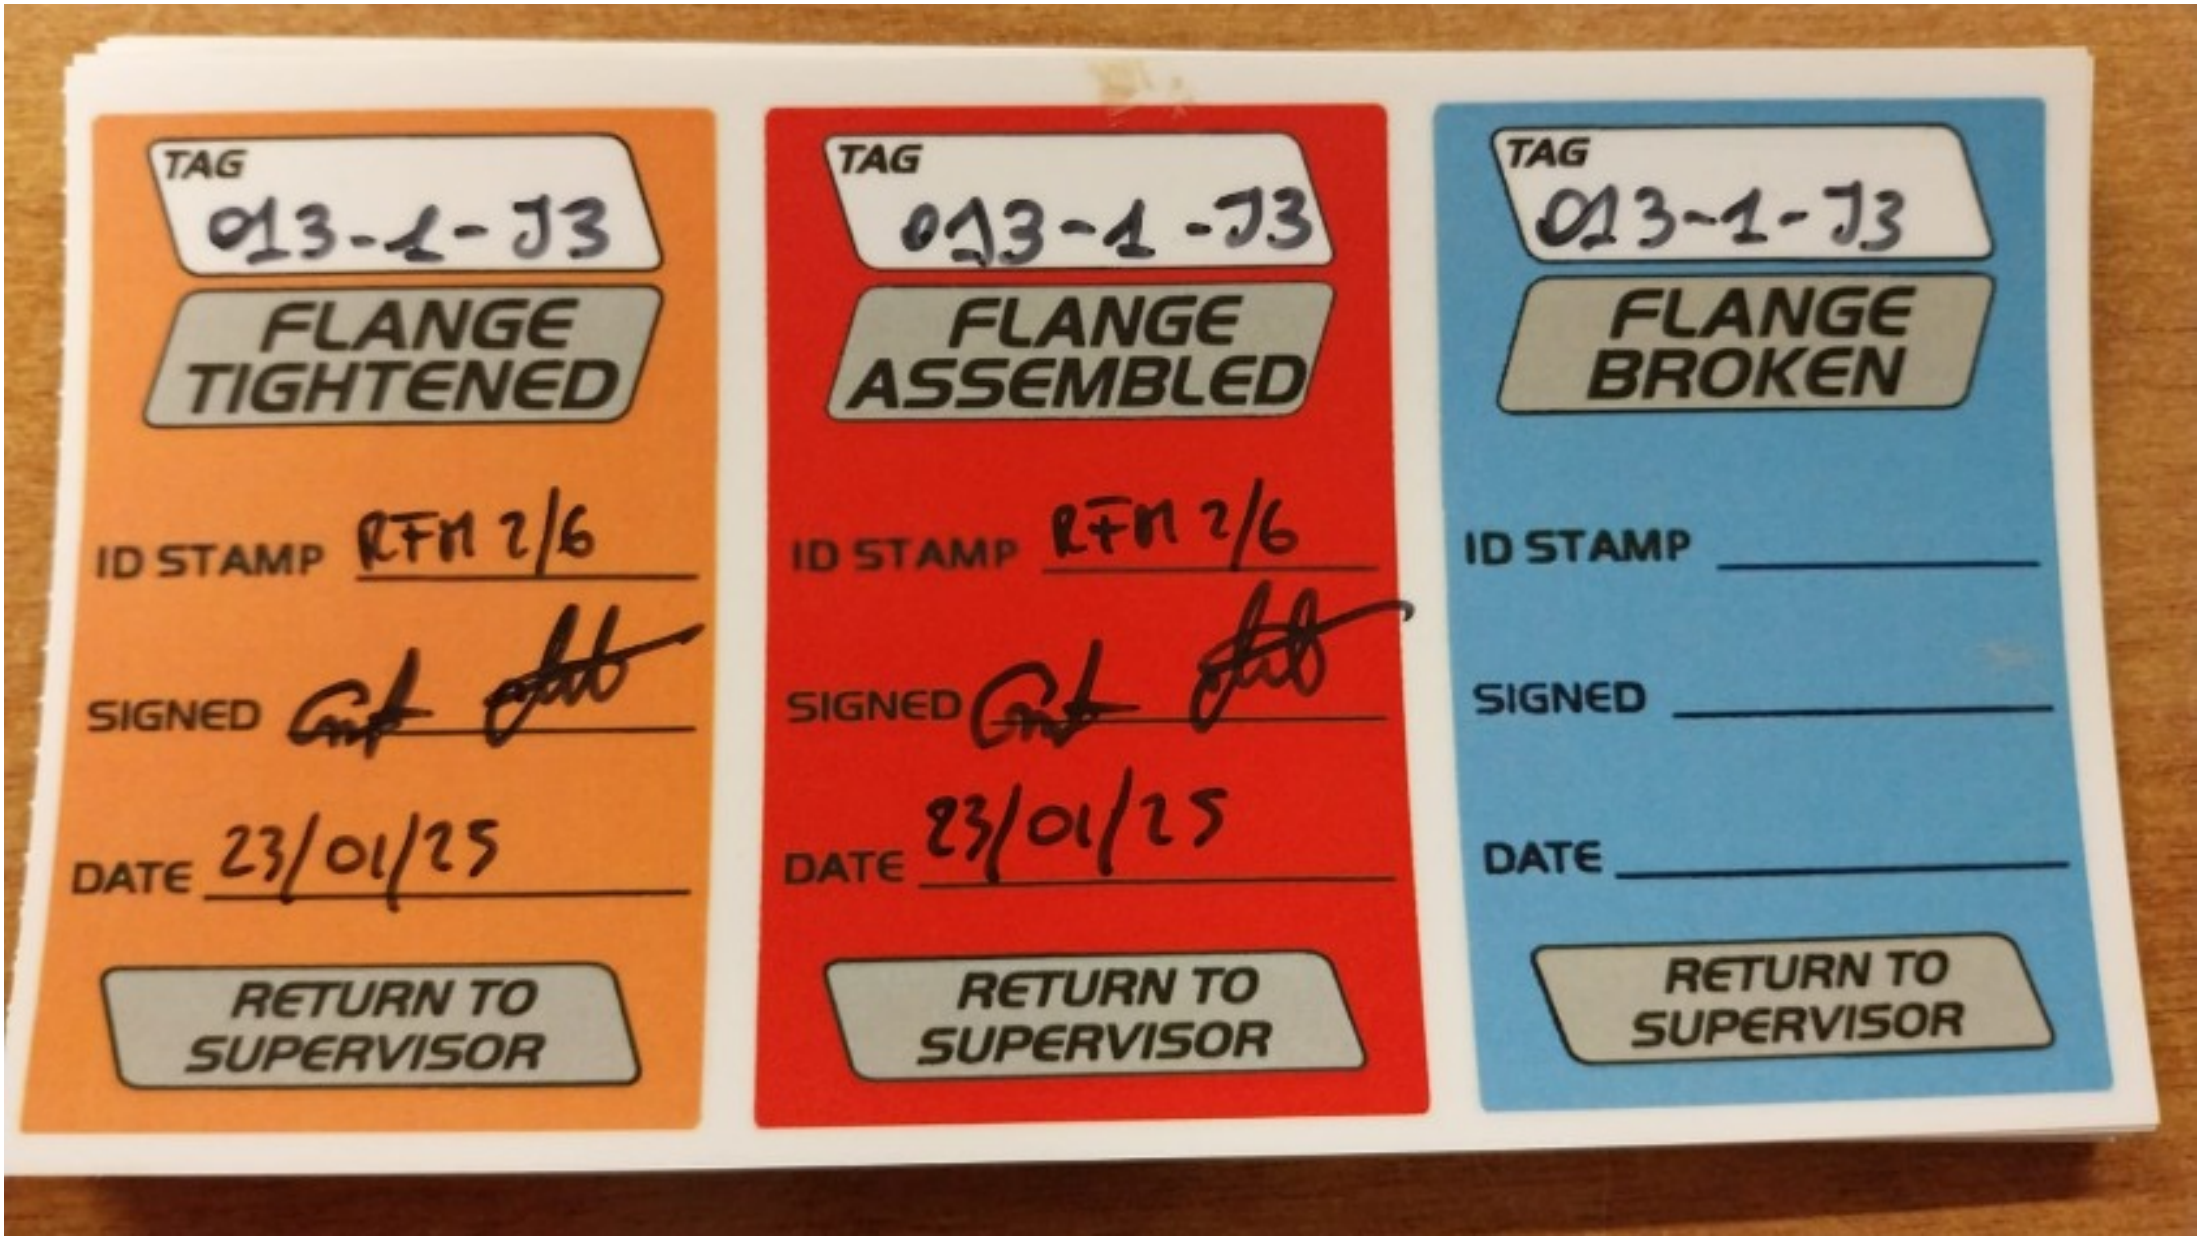
TAG
013-1-J3
FLANGE TIGHTENED
ID STAMP RFN 2/6
SIGNED
DATE 23/01/25
RETURN TO SUPERVISOR
TAG
013-1-J3
FLANGE ASSEMBLED
ID STAMP RFN 2/6
SIGNED
DATE 23/01/25
RETURN TO SUPERVISOR
TAG
013-1-J3
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	014-1-J1	: Joint 014-1-J1			Dwg	123A90-FDL-PP-DI-00014-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003861		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 — Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	T064079 / RA00598
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes


4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-24	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:54:07.358Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-24T14:07:49.237Z	

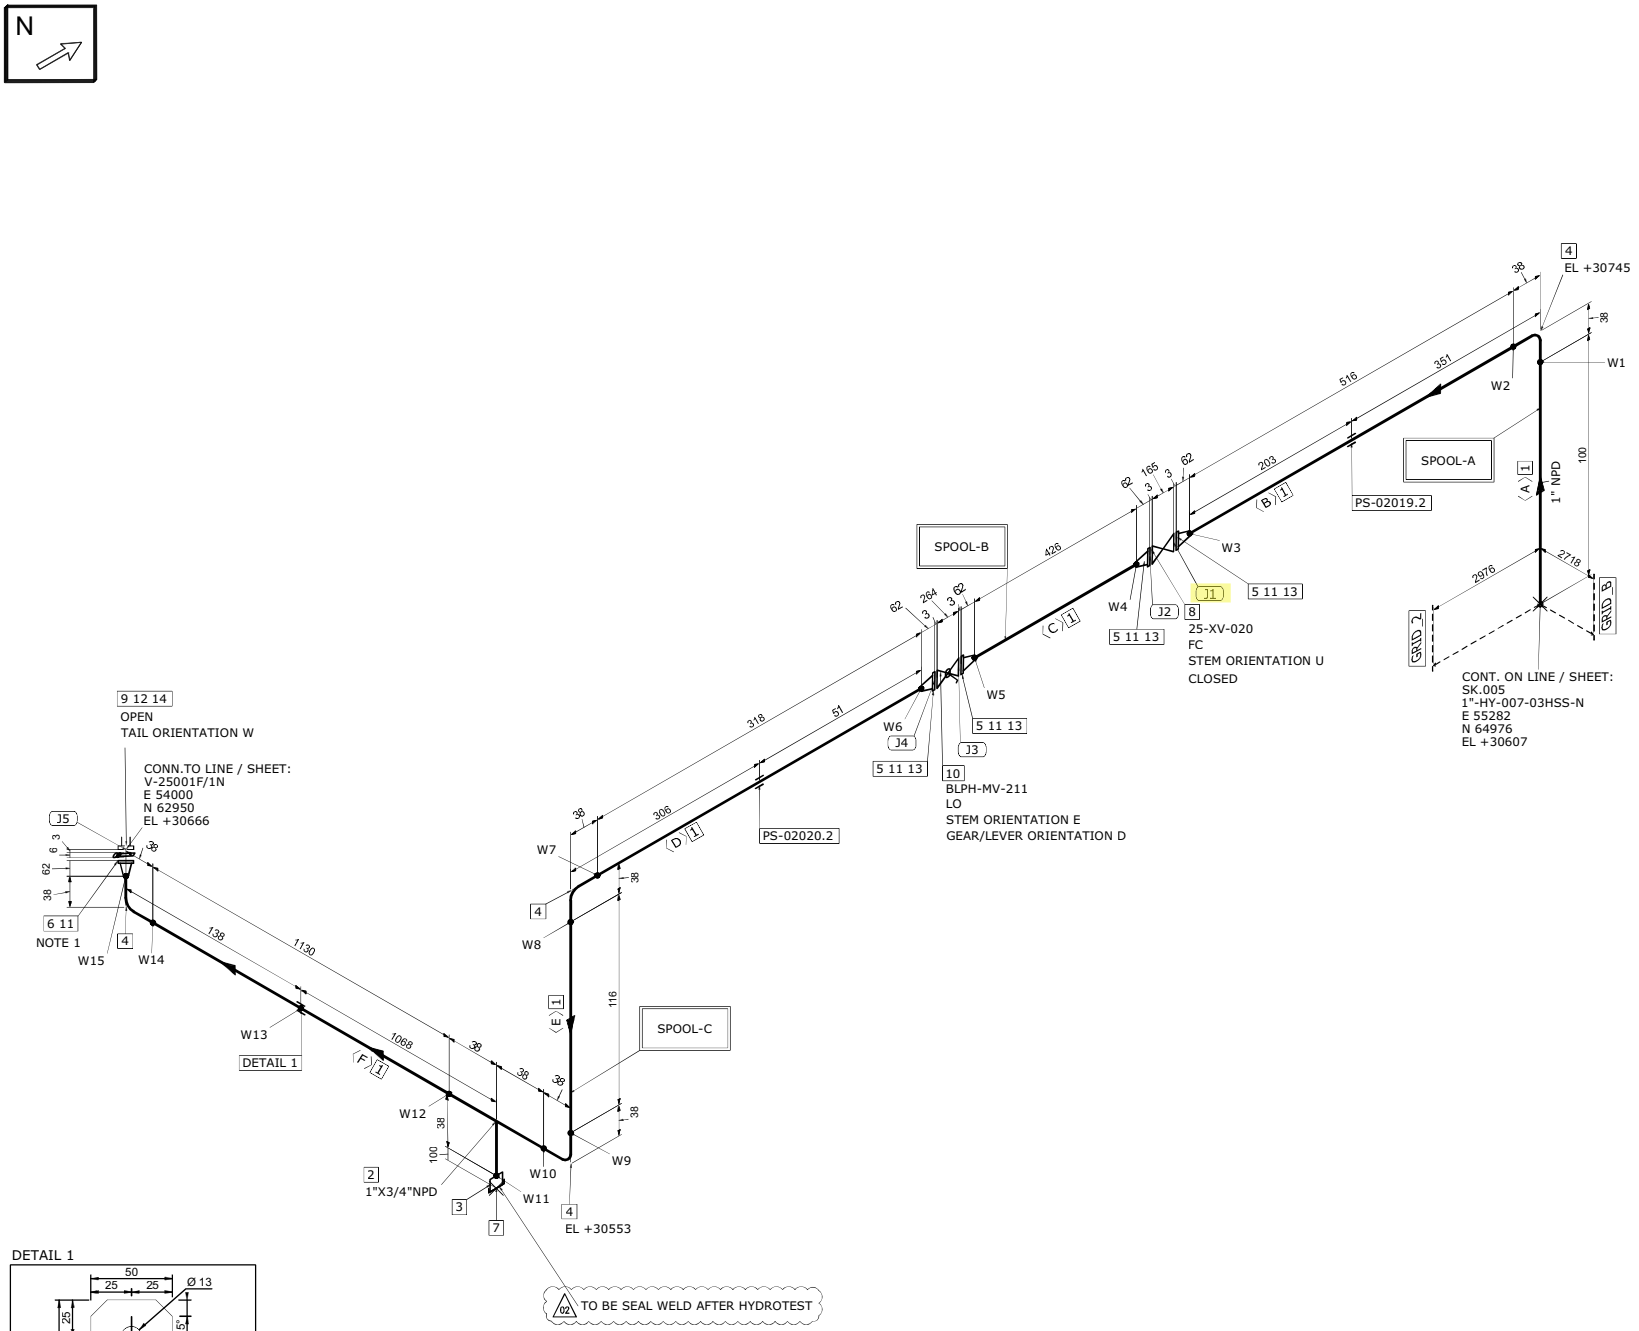

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.6M	6.6
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.8
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	3/4	BW
W12	1	BW
W13		FW
W14	1	BW
W15	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	100	BEVEL	BEVEL
B	1	516	BEVEL	BEVEL
C	1	426	BEVEL	BEVEL
D	1	318	BEVEL	BEVEL
E	1	116	BEVEL	BEVEL
F	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-02019.2
PS-02020.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	3.5
B	2	4.7
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-020-03HSS-N

SK.014

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A
DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024
FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00014 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1	PED CATEGORY	II
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE: GAS
INSULATION	TYPE N	THICKNESS [mm]	DESIGN: PRESS. 40 [barg] TEMP. -29 / 80 [°C]
HEAT TRACING	--		TEST: PRESS. 60 [barg] TEMP. AMB MEDIUM Water


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION N/S


MASTER

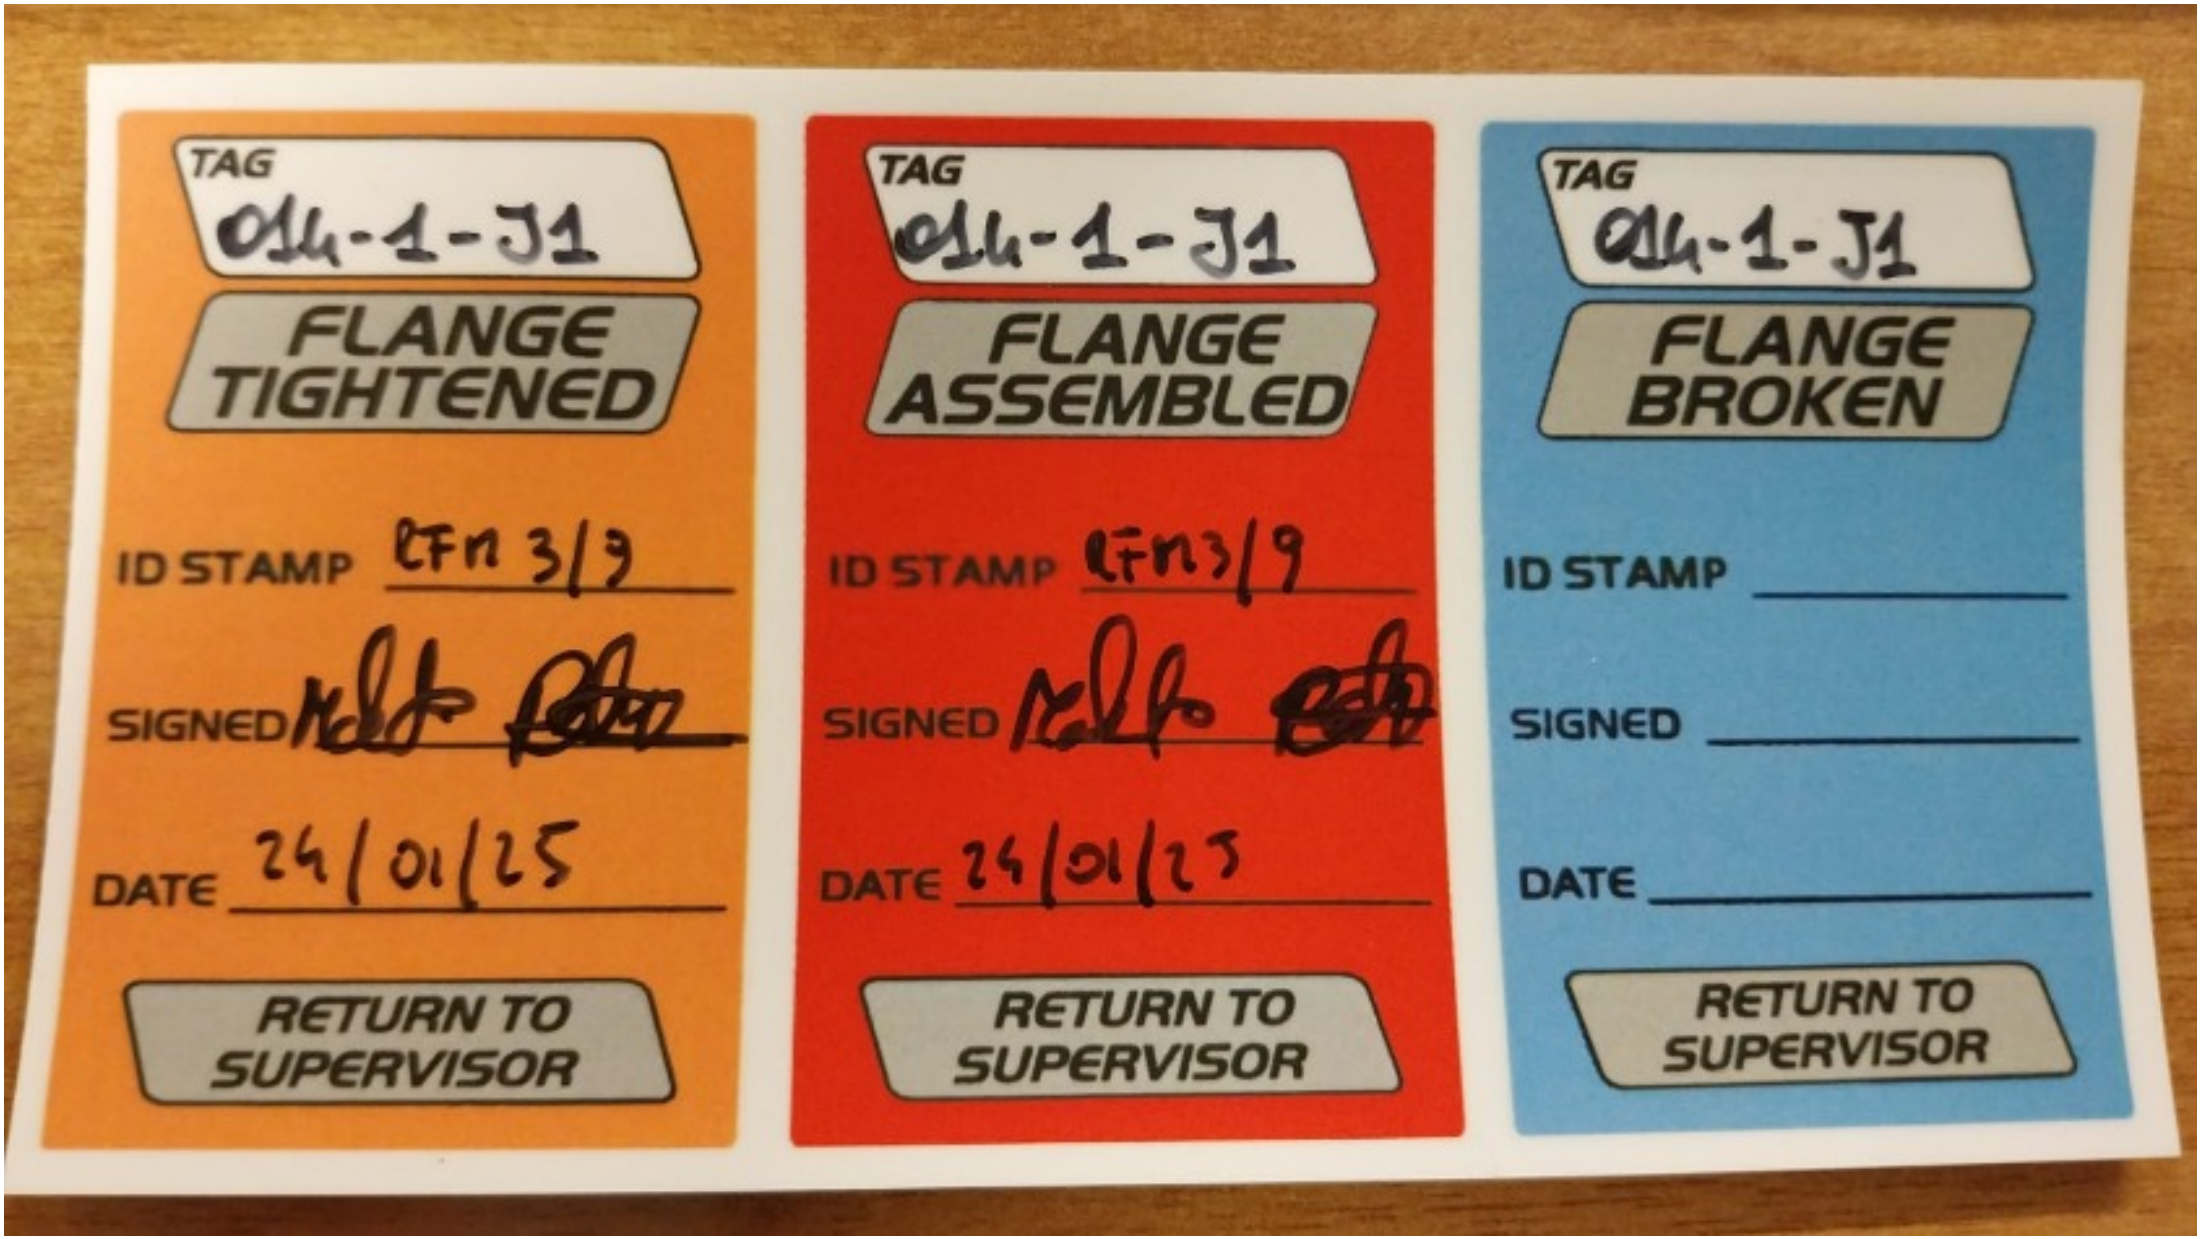
TAG
014-1-J1
FLANGE TIGHTENED
ID STAMP EFN 3/9
SIGNED
DATE 24/01/25
RETURN TO SUPERVISOR
TAG
014-1-J1
FLANGE ASSEMBLED
ID STAMP EFN3/9
SIGNED
DATE 24/01/25
RETURN TO SUPERVISOR
TAG
014-1-J1
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	014-1-J2	: Joint 014-1-J2			Dwg	123A90-FDL-PP-DI-00014-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003862		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	T064079 / RA00598
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes


4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-27	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:54:21.109Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-27T15:04:39.158Z	

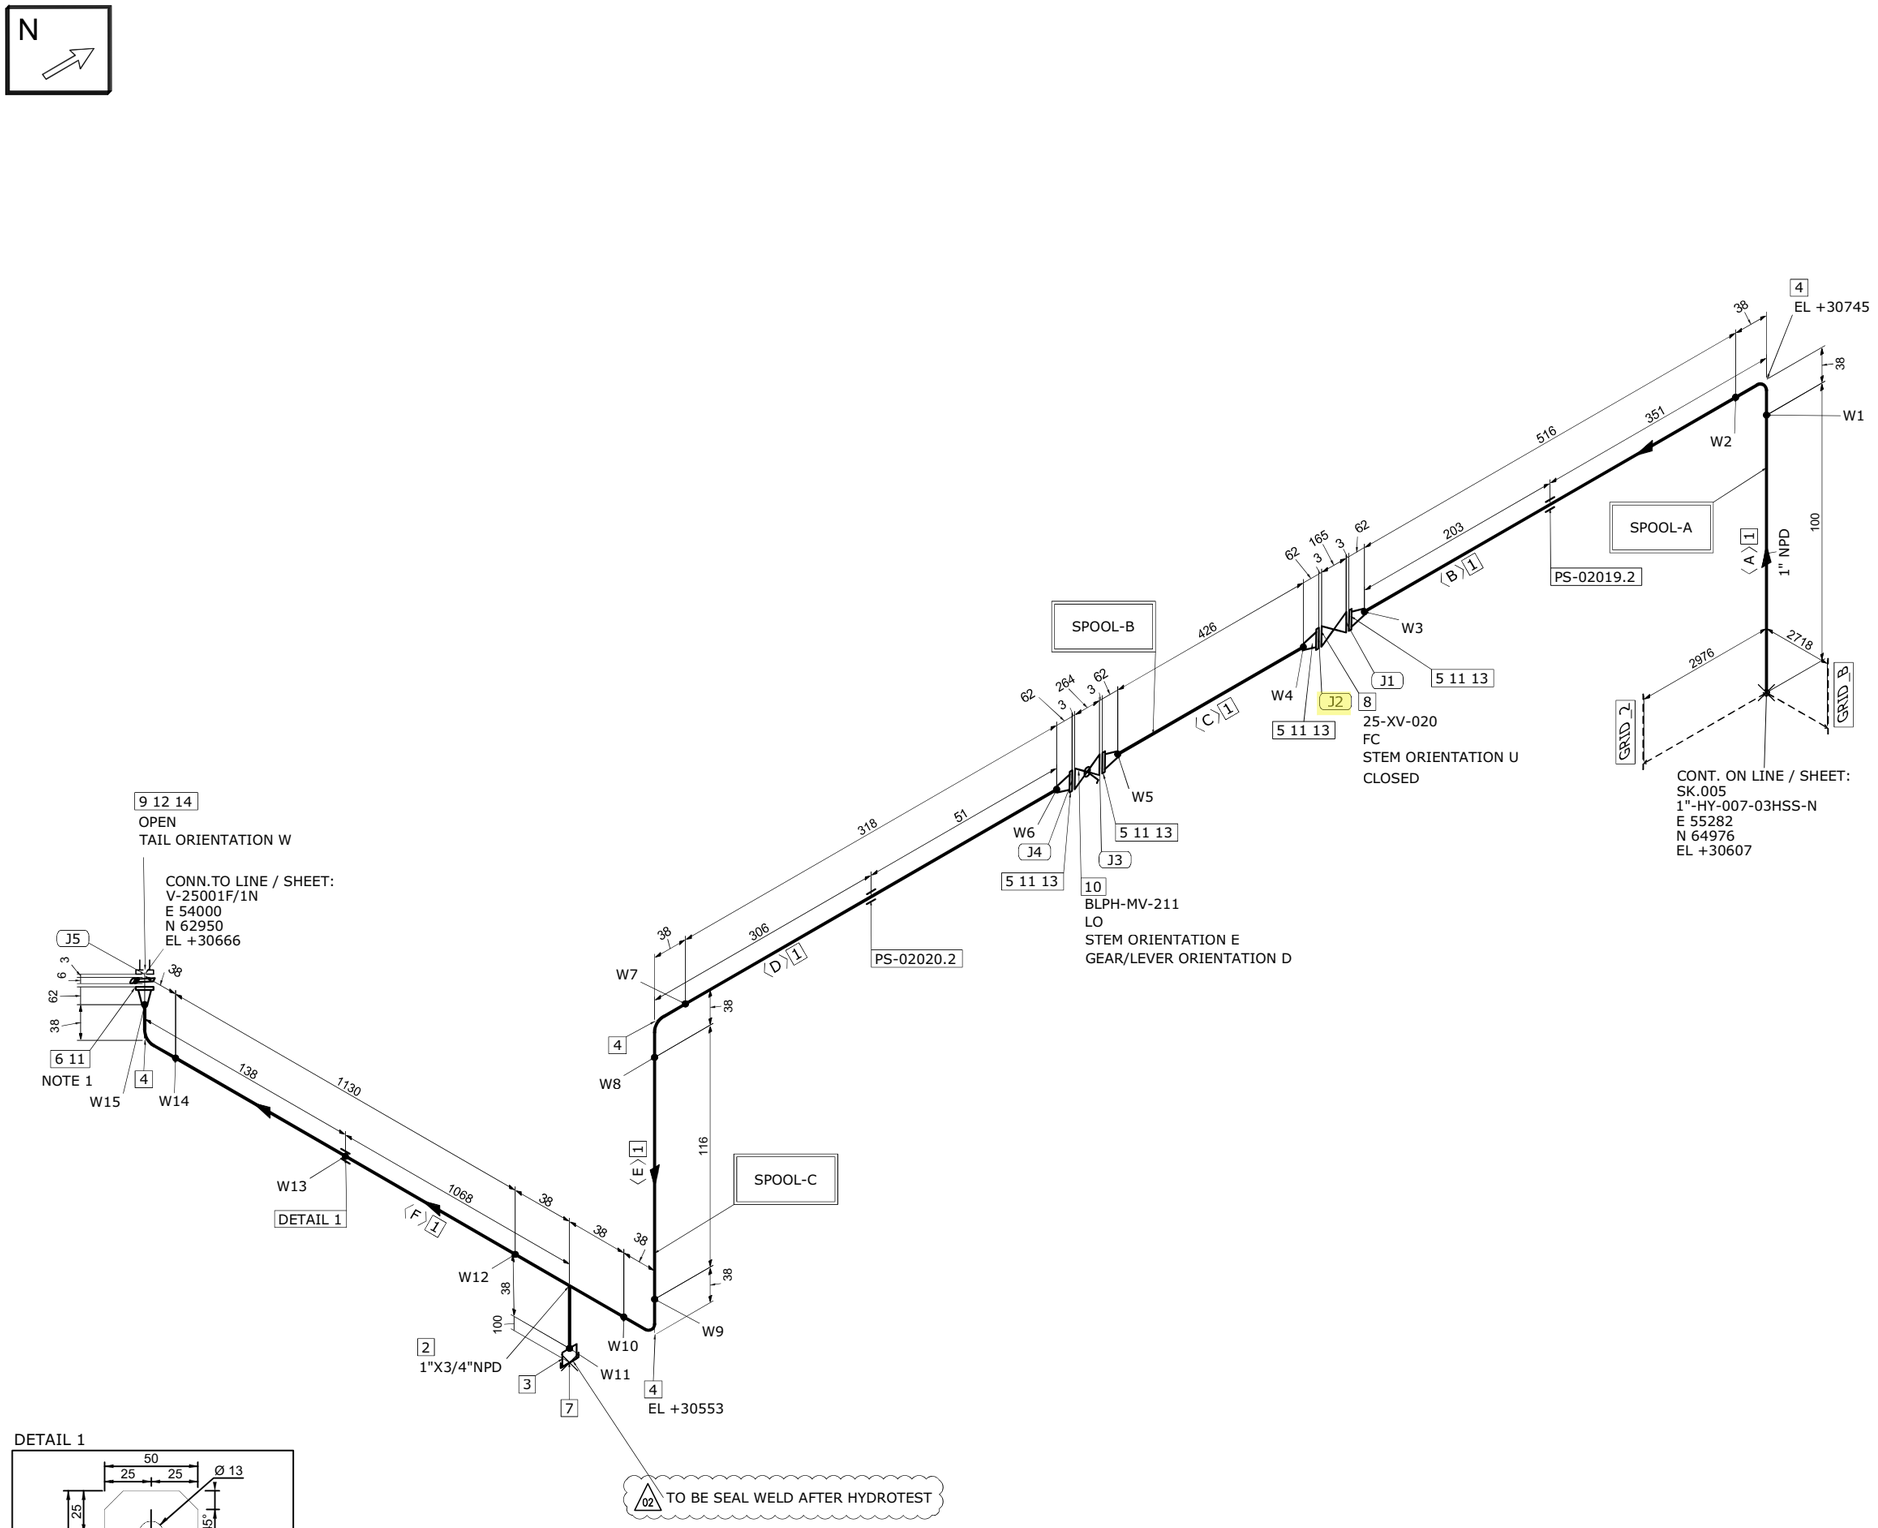

DETAIL 1



EARTHING PLATE
DIMENSIONS: 75 x 50 x 5 thk. HOLE Ø13
MATERIAL: 316L STAINLESS STEEL
ORIENTATION: UP UNLESS OTHERWISE NOTED

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.6M	6.6
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.8
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	3/4	BW
W12	1	BW
W13		FW
W14	1	BW
W15	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	100	BEVEL	BEVEL
B	1	516	BEVEL	BEVEL
C	1	426	BEVEL	BEVEL
D	1	318	BEVEL	BEVEL
E	1	116	BEVEL	BEVEL
F	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-02019.2
PS-02020.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	3.5
B	2	4.7
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-020-03HSS-N
SK.014

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A
DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024
FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00014 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION N/S


MASTER

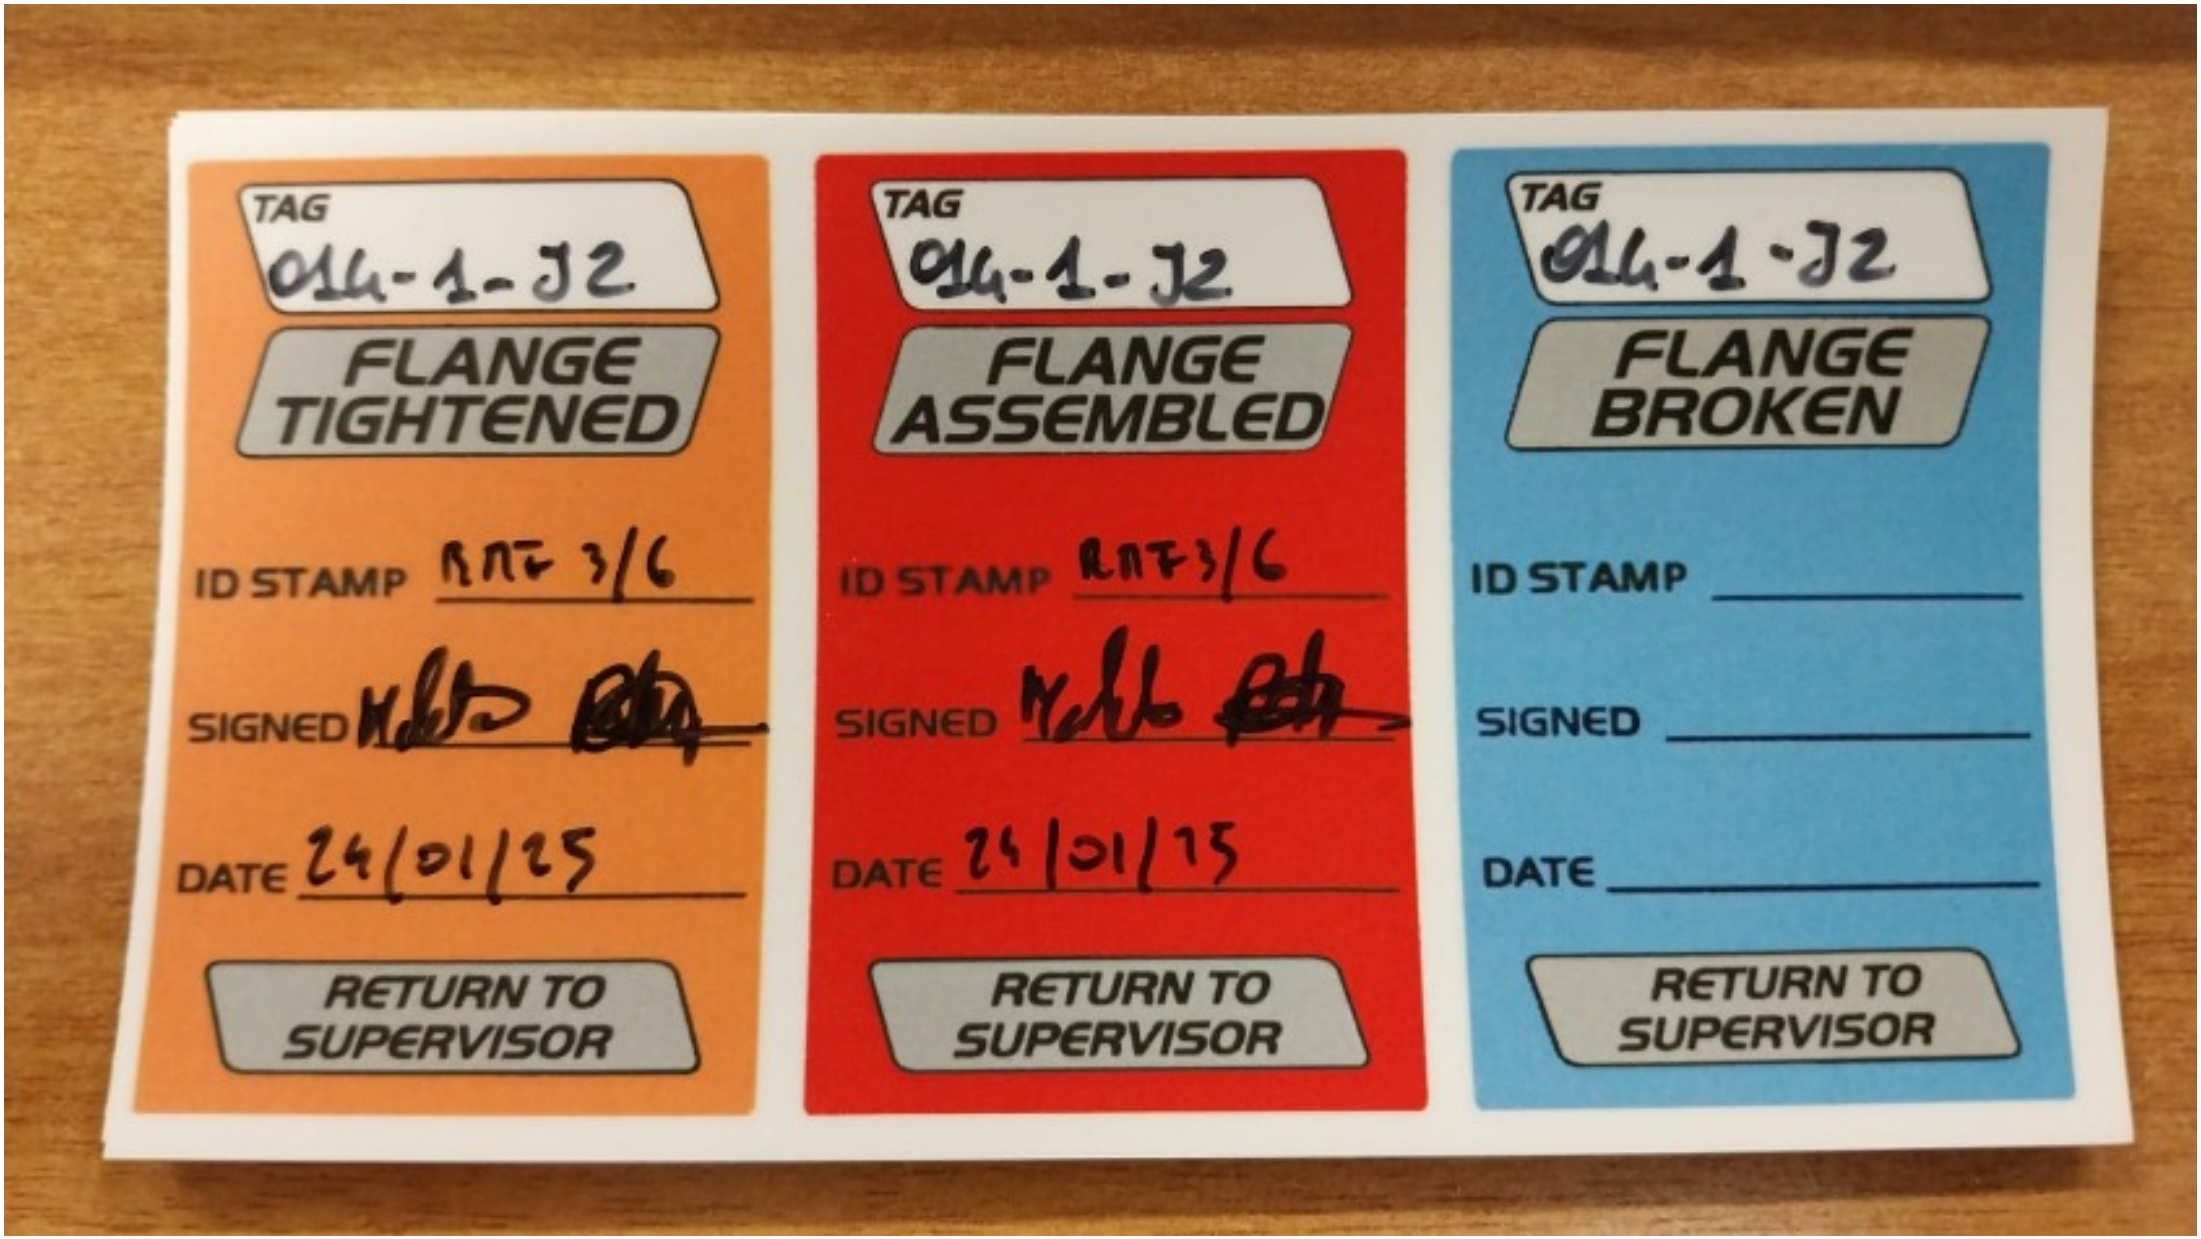
TAG
014-1-J2
FLANGE TIGHTENED
ID STAMP RTF 3/6
SIGNED
DATE 24/01/25
RETURN TO SUPERVISOR
TAG
014-1-J2
FLANGE ASSEMBLED
ID STAMP RTF3/6
SIGNED
DATE 24/01/25
RETURN TO SUPERVISOR
TAG
014-1-J2
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	014-1-J3	: Joint 014-1-J3			Dwg	123A90-FDL-PP-DI-00014-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003863		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27		Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	T064079 / RA00598
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes

4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-24	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:54:32.405Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-24T14:09:24.349Z	

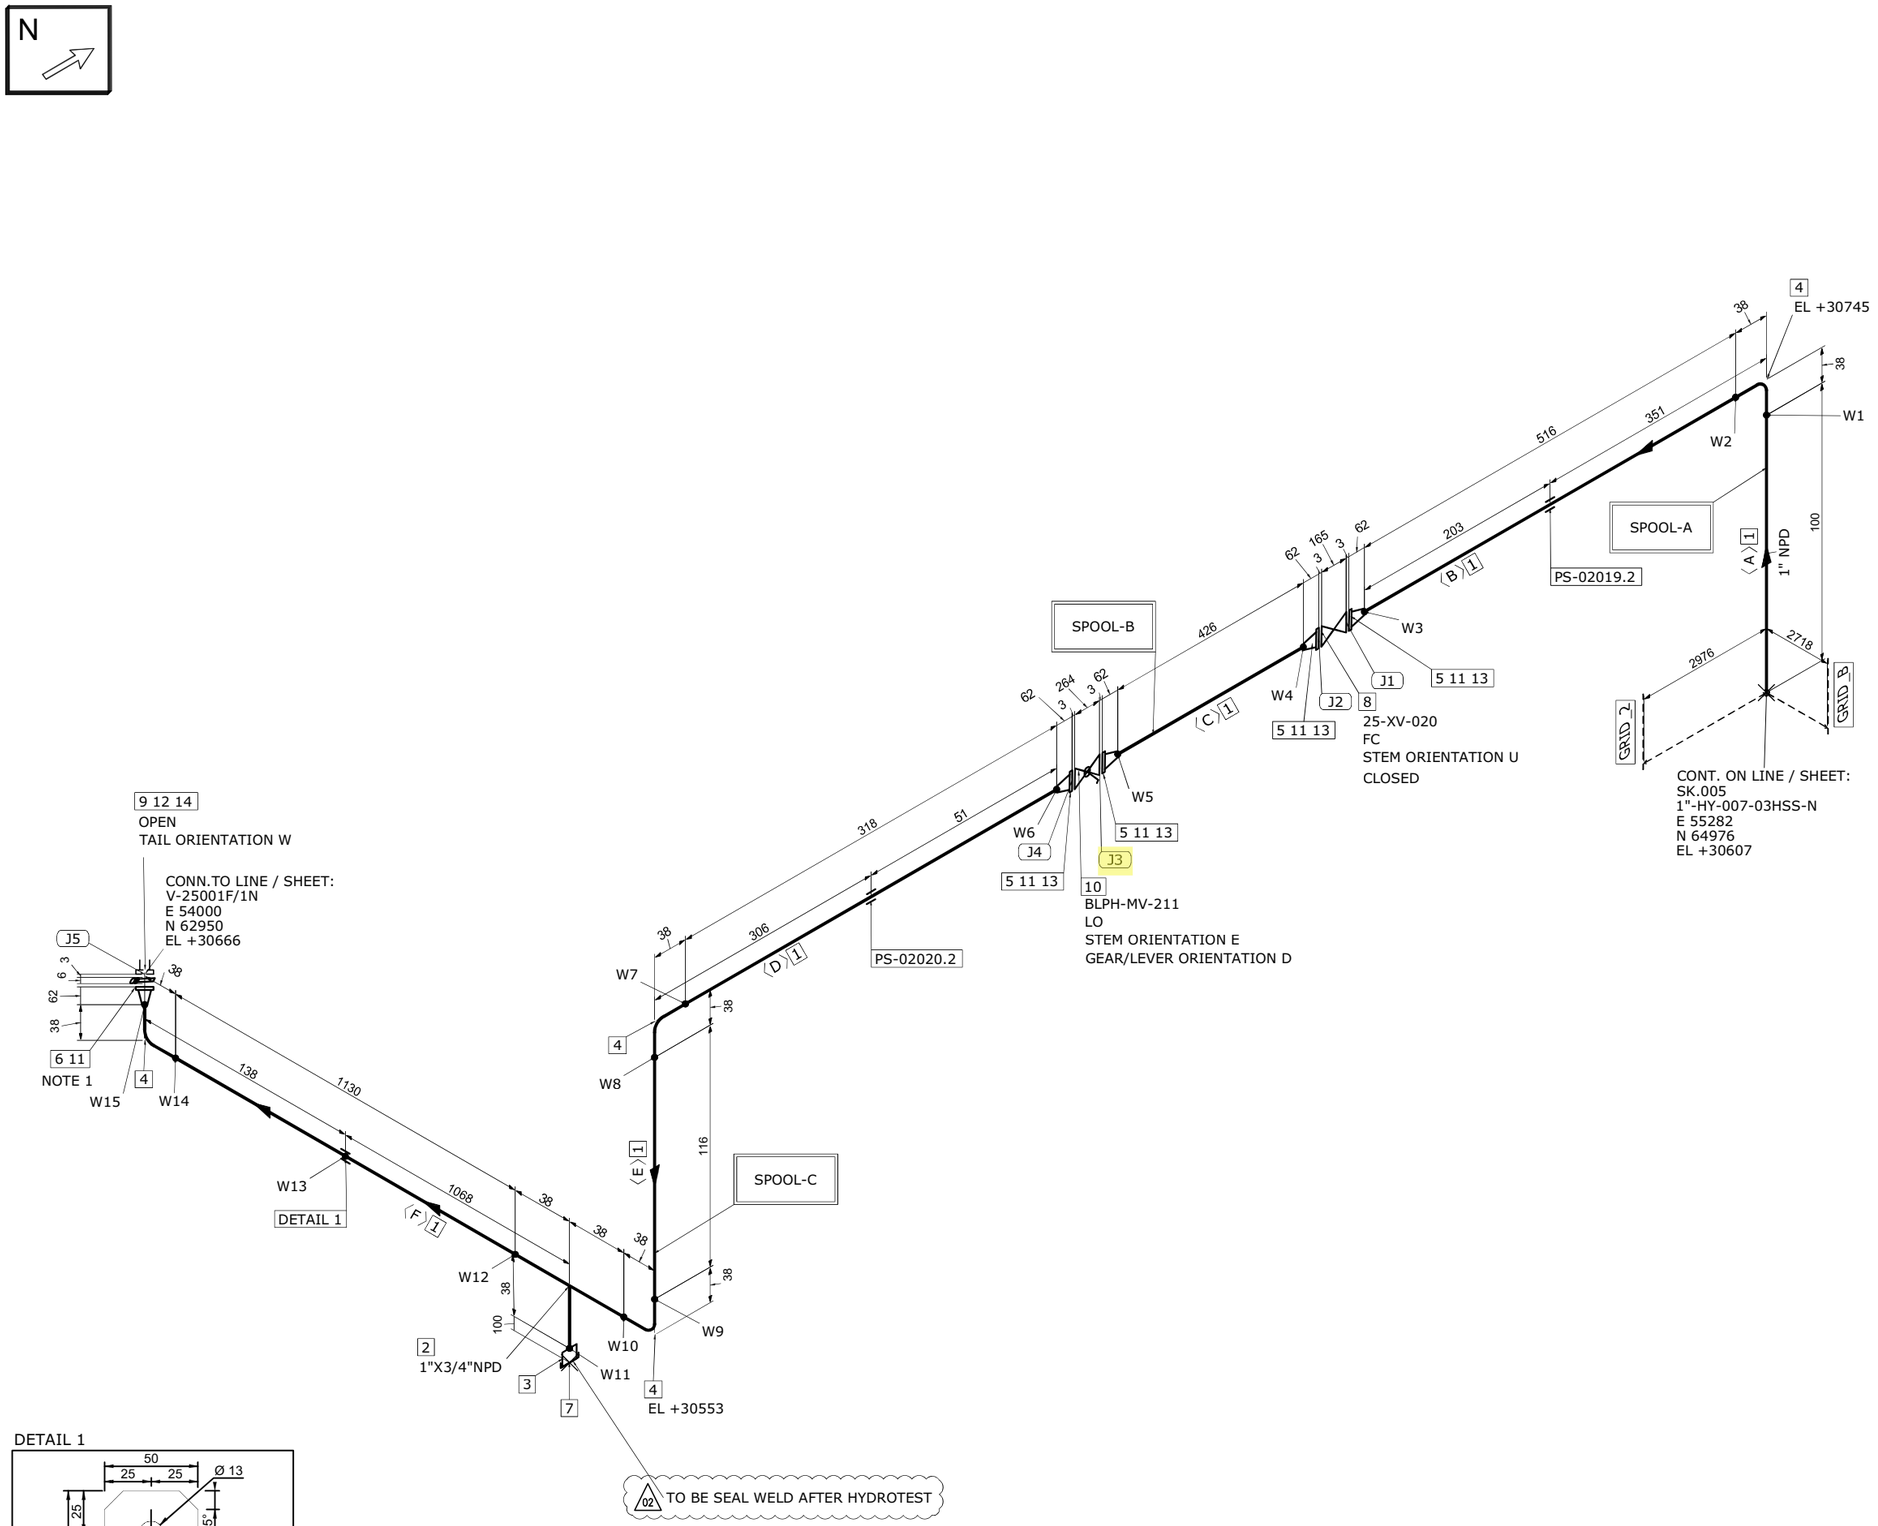

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	2.6M	6.6
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2
4	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	4	0.6
5	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3
6	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
7	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1	BSPESS01580100	Spectacle Blinds ASME B16.48 THRU BOLTED 300LB RF FPL ASTM A240 Gr.TP316/316L	1	0.5
10	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	1	13.5
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	5	0.4
12	1	SPIKNN01420100	Insulation Kit Ends as per ASME B16.5 300LB RF	1	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7
14	5/8	SB20BO04200300	105 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	16.8
ERECTION WEIGHT [kg]	60.4
OVERALL WEIGHT [kg]	76.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	3/4	BW
W12	1	BW
W13		FW
W14	1	BW
W15	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	100	BEVEL	BEVEL
B	1	516	BEVEL	BEVEL
C	1	426	BEVEL	BEVEL
D	1	318	BEVEL	BEVEL
E	1	116	BEVEL	BEVEL
F	1	1130	BEVEL	BEVEL

SUPPORT LIST

PS-02019.2
PS-02020.2

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	3.5
B	2	4.7
C	8.75	8.5
MONT	0	60.4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-020-03HSS-N

SK.014

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A
DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024
FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00014 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION N/S


MASTER

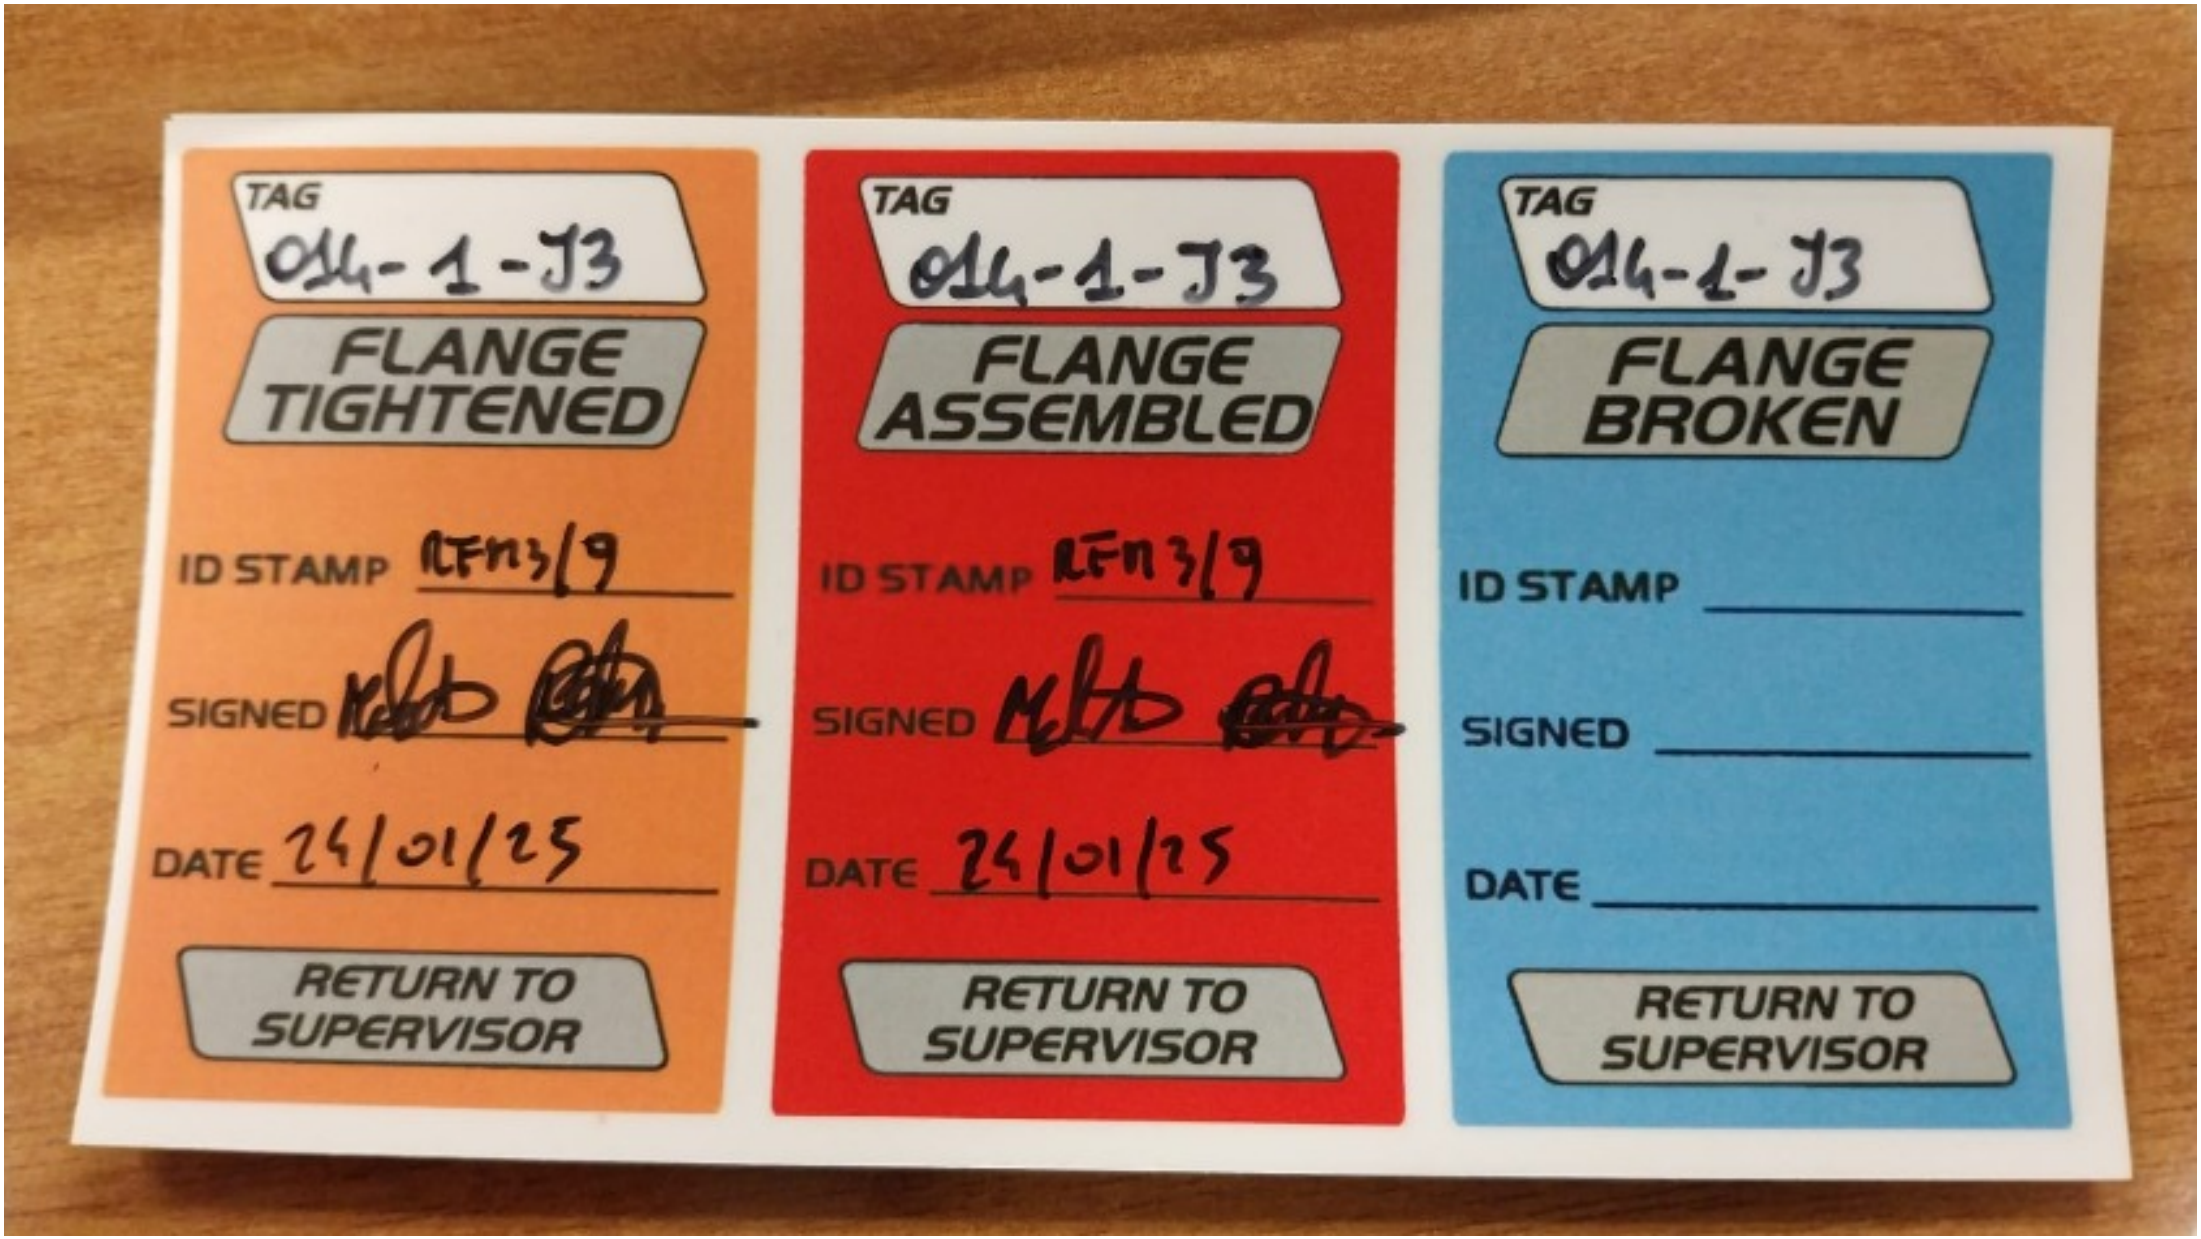
TAG
014-1-J3
FLANGE TIGHTENED
ID STAMP RFN3/9
SIGNED
DATE 24/01/25
RETURN TO SUPERVISOR
TAG
014-1-J3
FLANGE ASSEMBLED
ID STAMP RFN3/9
SIGNED
DATE 24/01/25
RETURN TO SUPERVISOR
TAG
014-1-J3
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	056-1-J1	: Joint 056-1-J1			Dwg	123A90-FDL-PP-DI-00056-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003910		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27		Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type 300LB

Flange Size 1"

Gasket Type Gasket Spiral Wound Thk. 3.2 mm

Bolt tensioning/Torquing value 158.8

Lubricant Yes

Lubricant Type MOLYKOTE 1000 PASTE

Used tools Torque wrench T064079 / RA00598

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	159	48	95	158.8
2	48	159	48	95	158.8
3	48	159	48	95	158.8
4	48	159	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes

4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Lorenzo Novaga	
Date	2025-01-23	2025-01-27	
Signature	Digitaly signed by Emanuele Delfino 2025-01-23T05:54:45.151Z	Digitaly signed by Lorenzo Novaga 2025-01-27T08:19:57.341Z	

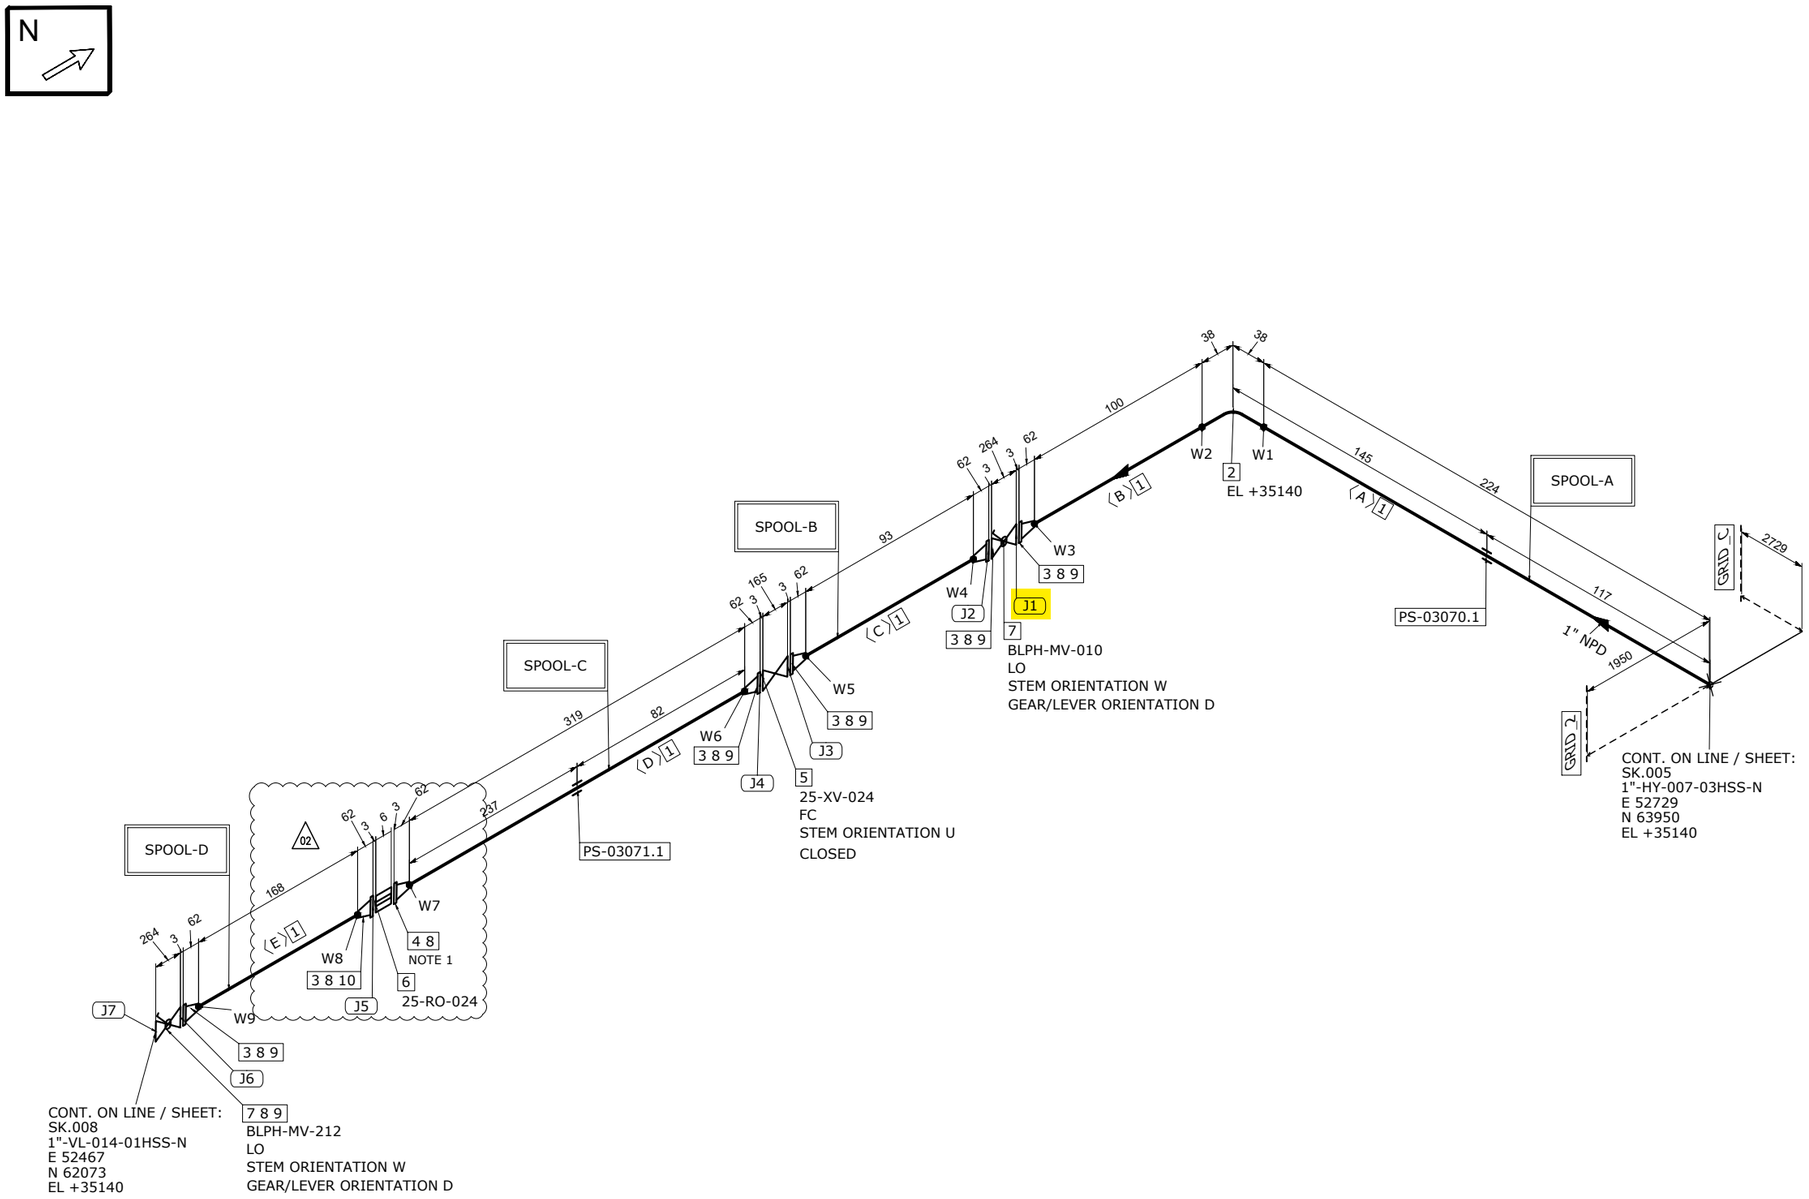

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	0.9M	2.3
2	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
3	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	6	11.0
4	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
5	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
6	1		Restriction Orifice 300#RF	1	1.0
7	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	2	27.0
8	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	8	0.6
9	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	24	5.5
10	5/8	SB20BO04190300	90 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	15.2
ERECTION WEIGHT [kg]	76.1
OVERALL WEIGHT [kg]	91.3

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	224	BEVEL	BEVEL
B	1	100	BEVEL	BEVEL
C	1	93	BEVEL	BEVEL
D	1	319	BEVEL	BEVEL
E	1	168 (02)	BEVEL	BEVEL

SUPPORT LIST

PS-03070.1
PS-03071.1

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	2.8
B	2	3.9
C	2	4.5
D	2	4,1
MONT	0	76.1

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-143-03HSS-N

SK.056

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK

SCALE: N/A

DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024

FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00056 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40	[barg]	TEMP. -29 / 80	[°C]	
HEAT TRACING	--		TEST	PRESS. 60	[barg]	TEMP. AMB	MEDIUM Water	


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION E/W


MASTER

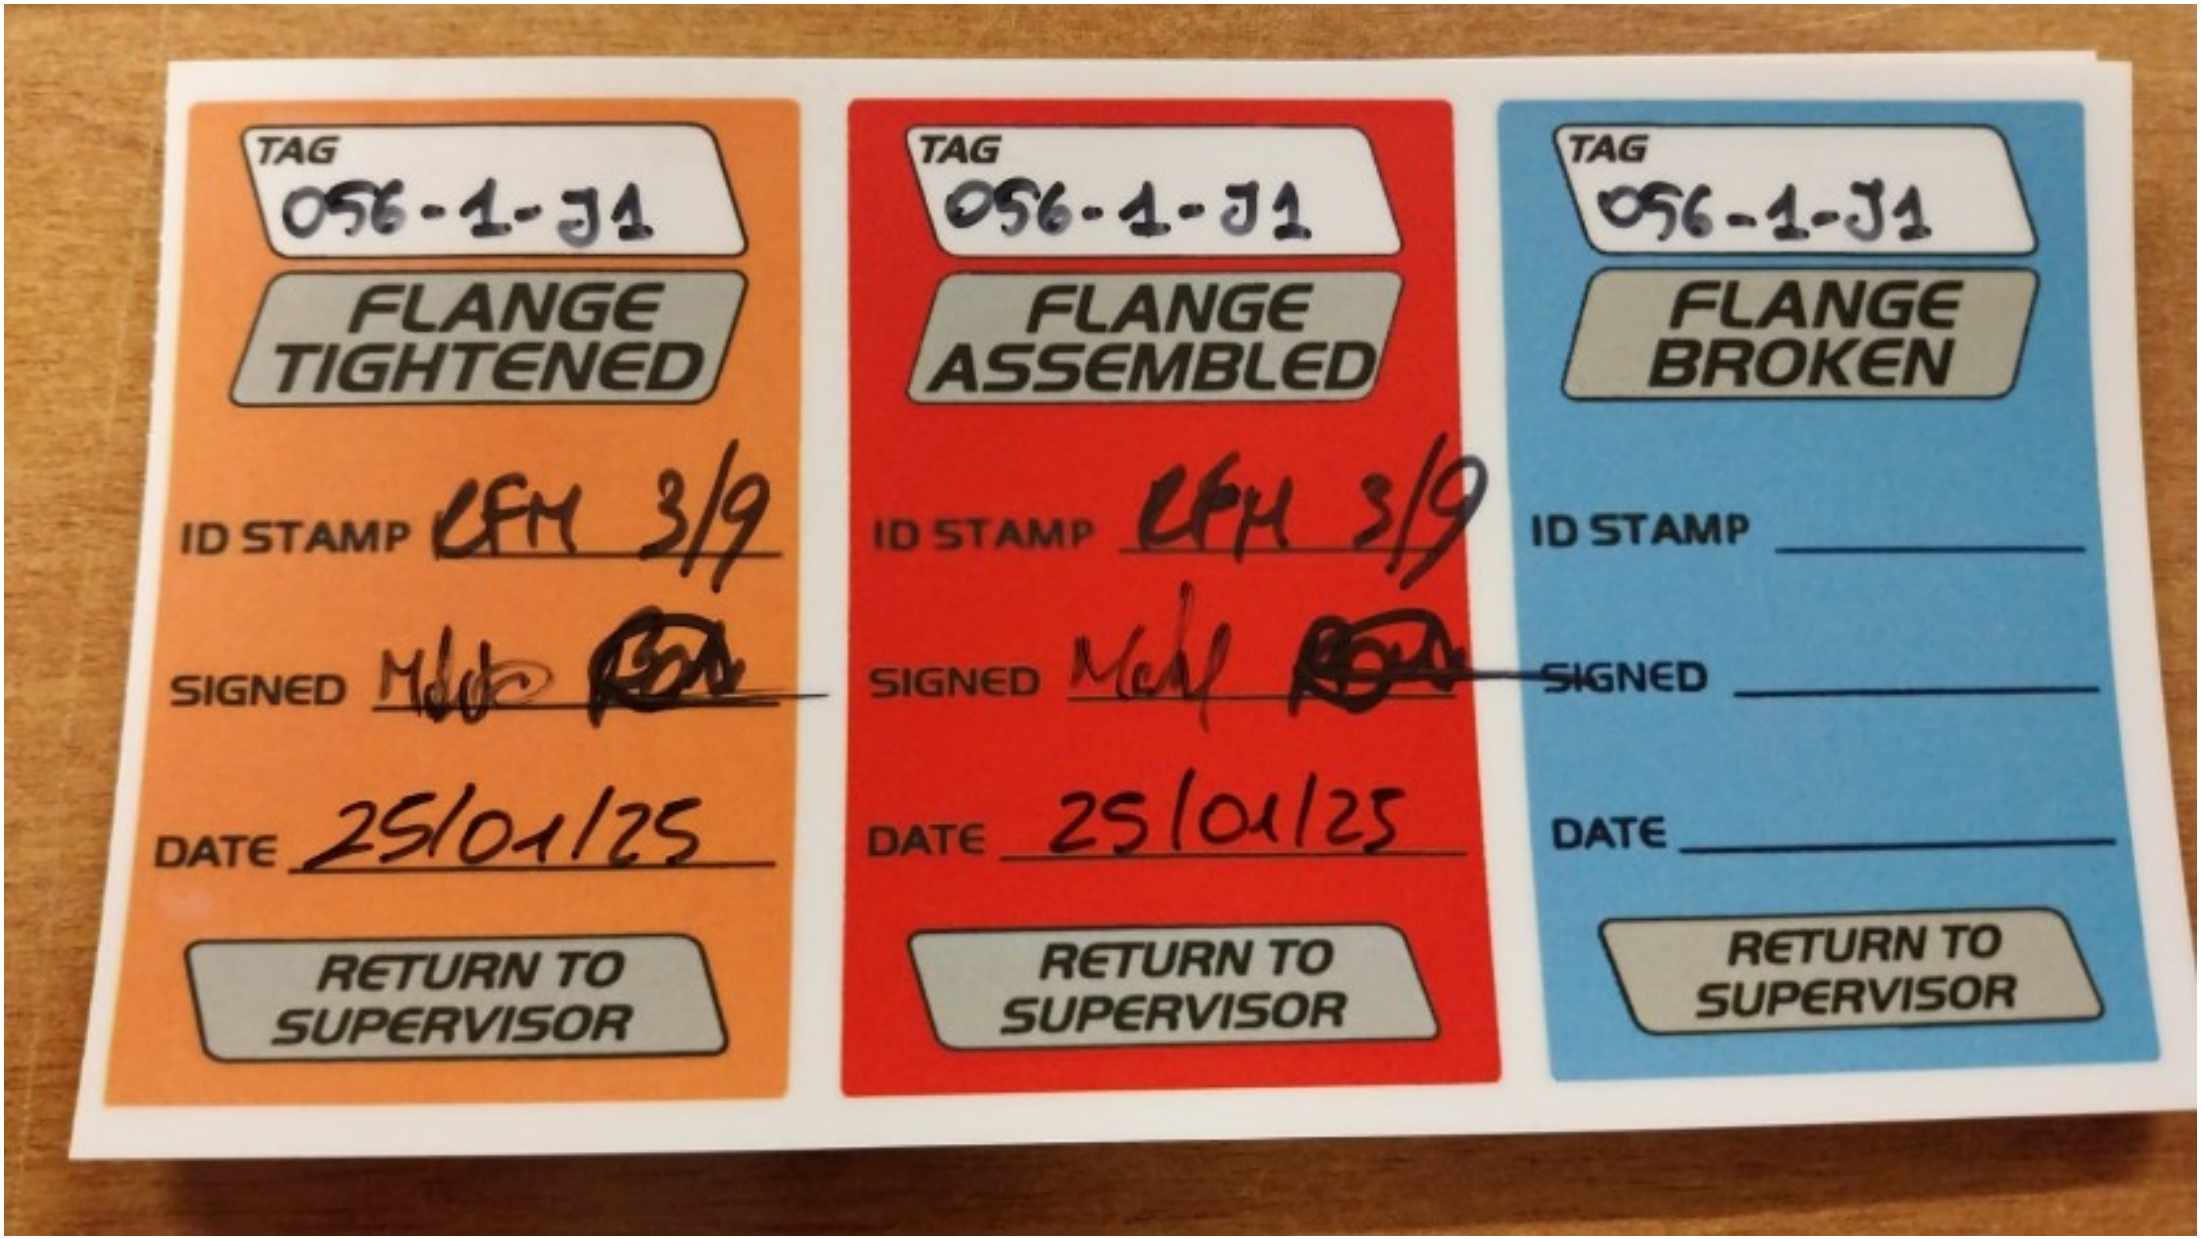
TAG
056-1-J1
FLANGE TIGHTENED
ID STAMP LFM 3/9
SIGNED
DATE 25/01/25
RETURN TO SUPERVISOR
TAG
056-1-J1
FLANGE ASSEMBLED
ID STAMP LFM 3/9
SIGNED
DATE 25/01/25
RETURN TO SUPERVISOR
TAG
056-1-J1
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	056-1-J2	: Joint 056-1-J2			Dwg	123A90-FDL-PP-DI-00056-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003911		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27		Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type 300LB

Flange Size 1"

Gasket Type Gasket Spiral Wound Thk. 3.2 mm

Bolt tensioning/Torquing value 158.8

Lubricant Yes

Lubricant Type MOLYKOTE 1000 PASTE

Used tools Torque wrench T064079 / RA00598

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	159	48	95	158.8
2	48	159	48	95	158.8
3	48	159	48	95	158.8
4	48	159	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes

4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Lorenzo Novaga	
Date	2025-01-23	2025-01-27	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:54:55.540Z	PROVERLIS Digitaly signed by Lorenzo Novaga 2025-01-27T08:20:14.362Z	

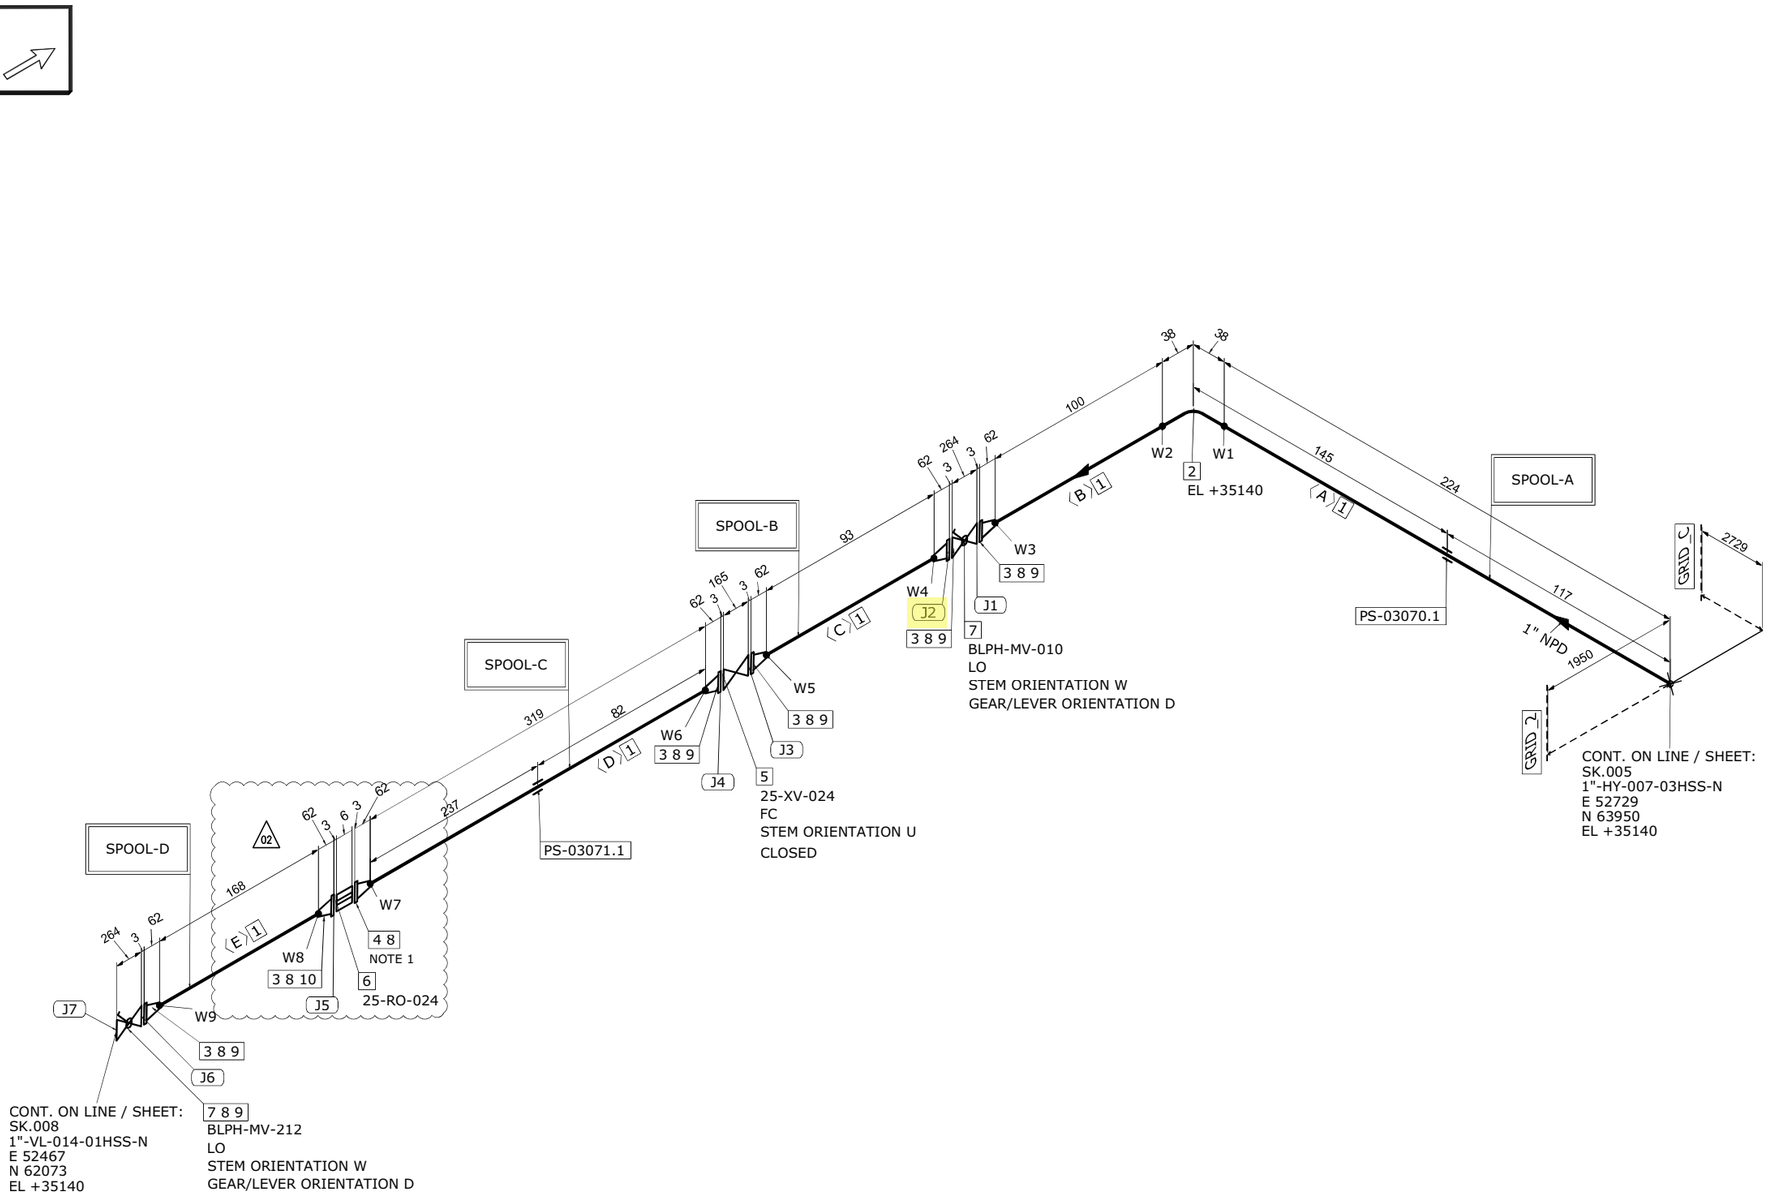

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	0.9M	2.3
2	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
3	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	6	11.0
4	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
5	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
6	1		Restriction Orifice 300#RF	1	1.0
7	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	2	27.0
8	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	8	0.6
9	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	24	5.5
10	5/8	SB20BO04190300	90 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	15.2
ERECTION WEIGHT [kg]	76.1
OVERALL WEIGHT [kg]	91.3

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	224	BEVEL	BEVEL
B	1	100	BEVEL	BEVEL
C	1	93	BEVEL	BEVEL
D	1	319	BEVEL	BEVEL
E	1	168 (02)	BEVEL	BEVEL

SUPPORT LIST

PS-03070.1
PS-03071.1

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	2.8
B	2	3.9
C	2	4.5
D	2	4.1
MONT	0	76.1

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-143-03HSS-N

SK.056

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK

SCALE: N/A

DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024

FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00056 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II					
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS					
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]				
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water			


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION E/W


MASTER

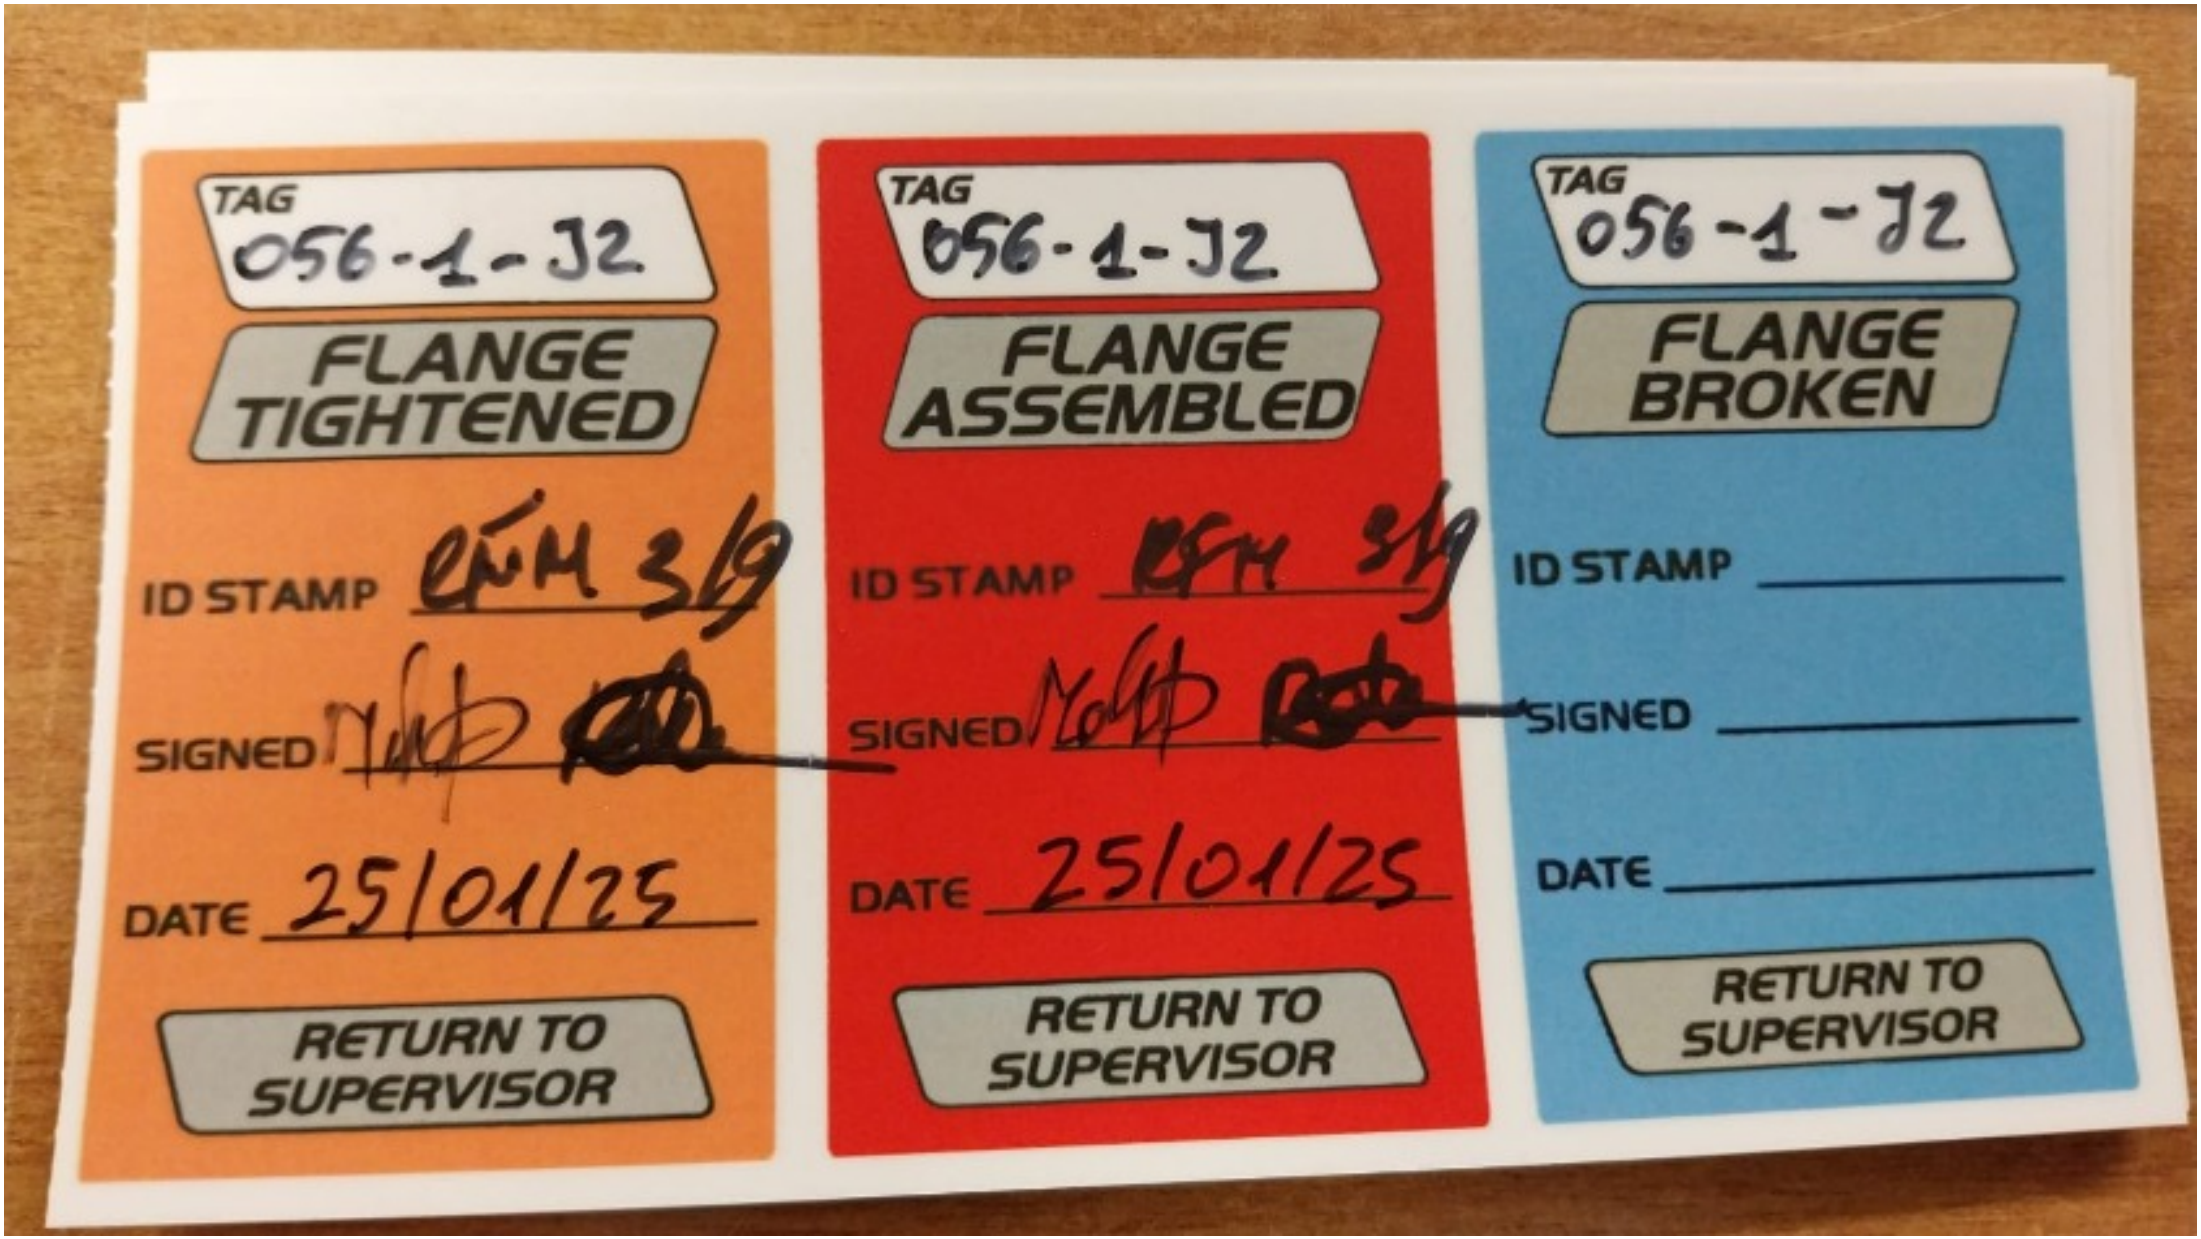
TAG
056-1-J2
FLANGE TIGHTENED
ID STAMP
SIGNED
DATE 25/01/25
RETURN TO SUPERVISOR
TAG
056-1-J2
FLANGE ASSEMBLED
ID STAMP
SIGNED
DATE 25/01/25
RETURN TO SUPERVISOR
TAG
056-1-J2
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	056-1-J3	: Joint 056-1-J3			Dwg	123A90-FDL-PP-DI-00056-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003912		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27		Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	Torque wrench T064079 / RA00598
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	159	48	95	158.8
2	48	159	48	95	158.8
3	48	159	48	95	158.8
4	48	159	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes

4 **Alignment:** Check alignment according to code.

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Lorenzo Novaga	
Date	2025-01-23	2025-01-27	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:55:09.694Z	PROVERLIS Digitaly signed by Lorenzo Novaga 2025-01-27T08:20:33.882Z	

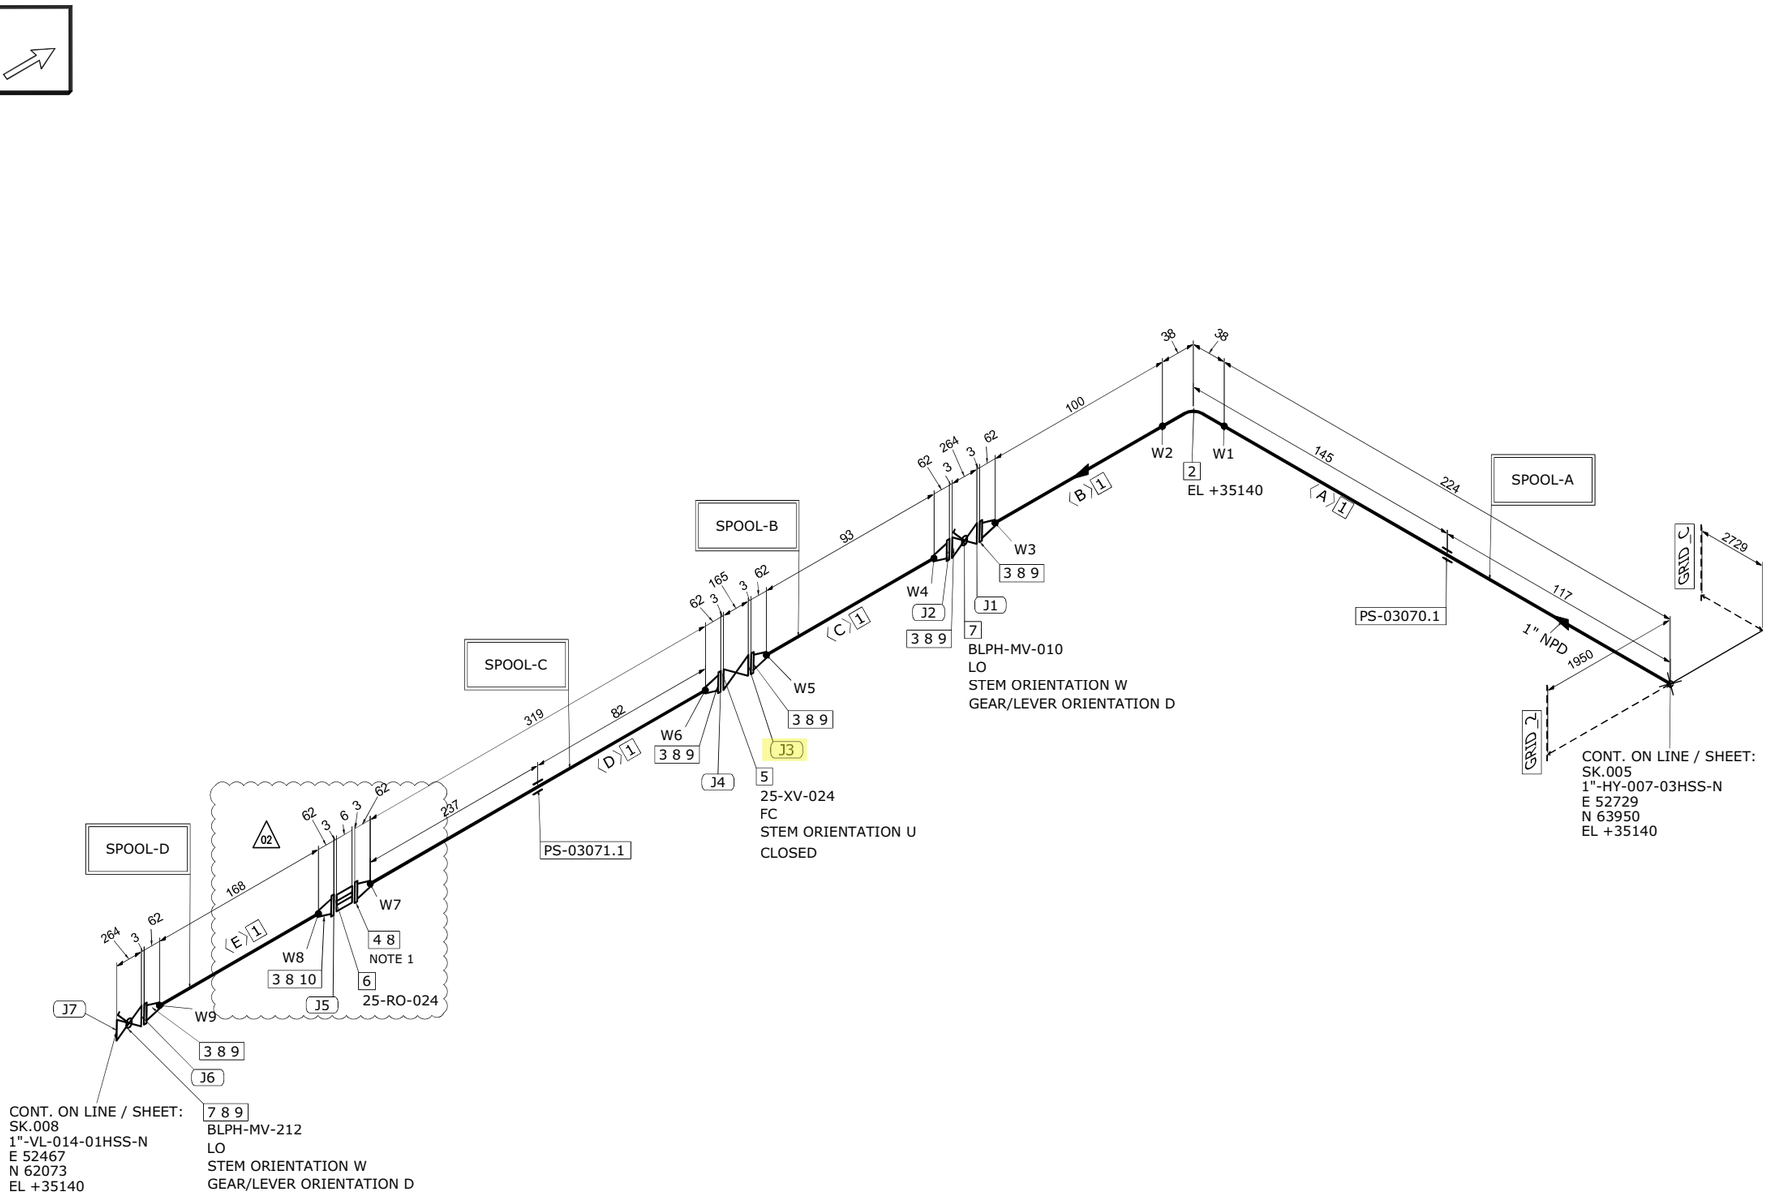

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	0.9M	2.3
2	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
3	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	6	11.0
4	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
5	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
6	1		Restriction Orifice 300#RF	1	1.0
7	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	2	27.0
8	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	8	0.6
9	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	24	5.5
10	5/8	SB20BO04190300	90 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	15.2
ERECTION WEIGHT [kg]	76.1
OVERALL WEIGHT [kg]	91.3

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	224	BEVEL	BEVEL
B	1	100	BEVEL	BEVEL
C	1	93	BEVEL	BEVEL
D	1	319	BEVEL	BEVEL
E	1	168 (02)	BEVEL	BEVEL

SUPPORT LIST

PS-03070.1
PS-03071.1

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	2.8
B	2	3.9
C	2	4.5
D	2	4.1
MONT	0	76.1

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-143-03HSS-N

SK.056

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK

SCALE: N/A

DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024

FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00056 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II					
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS					
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]				
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water			


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION E/W


MASTER

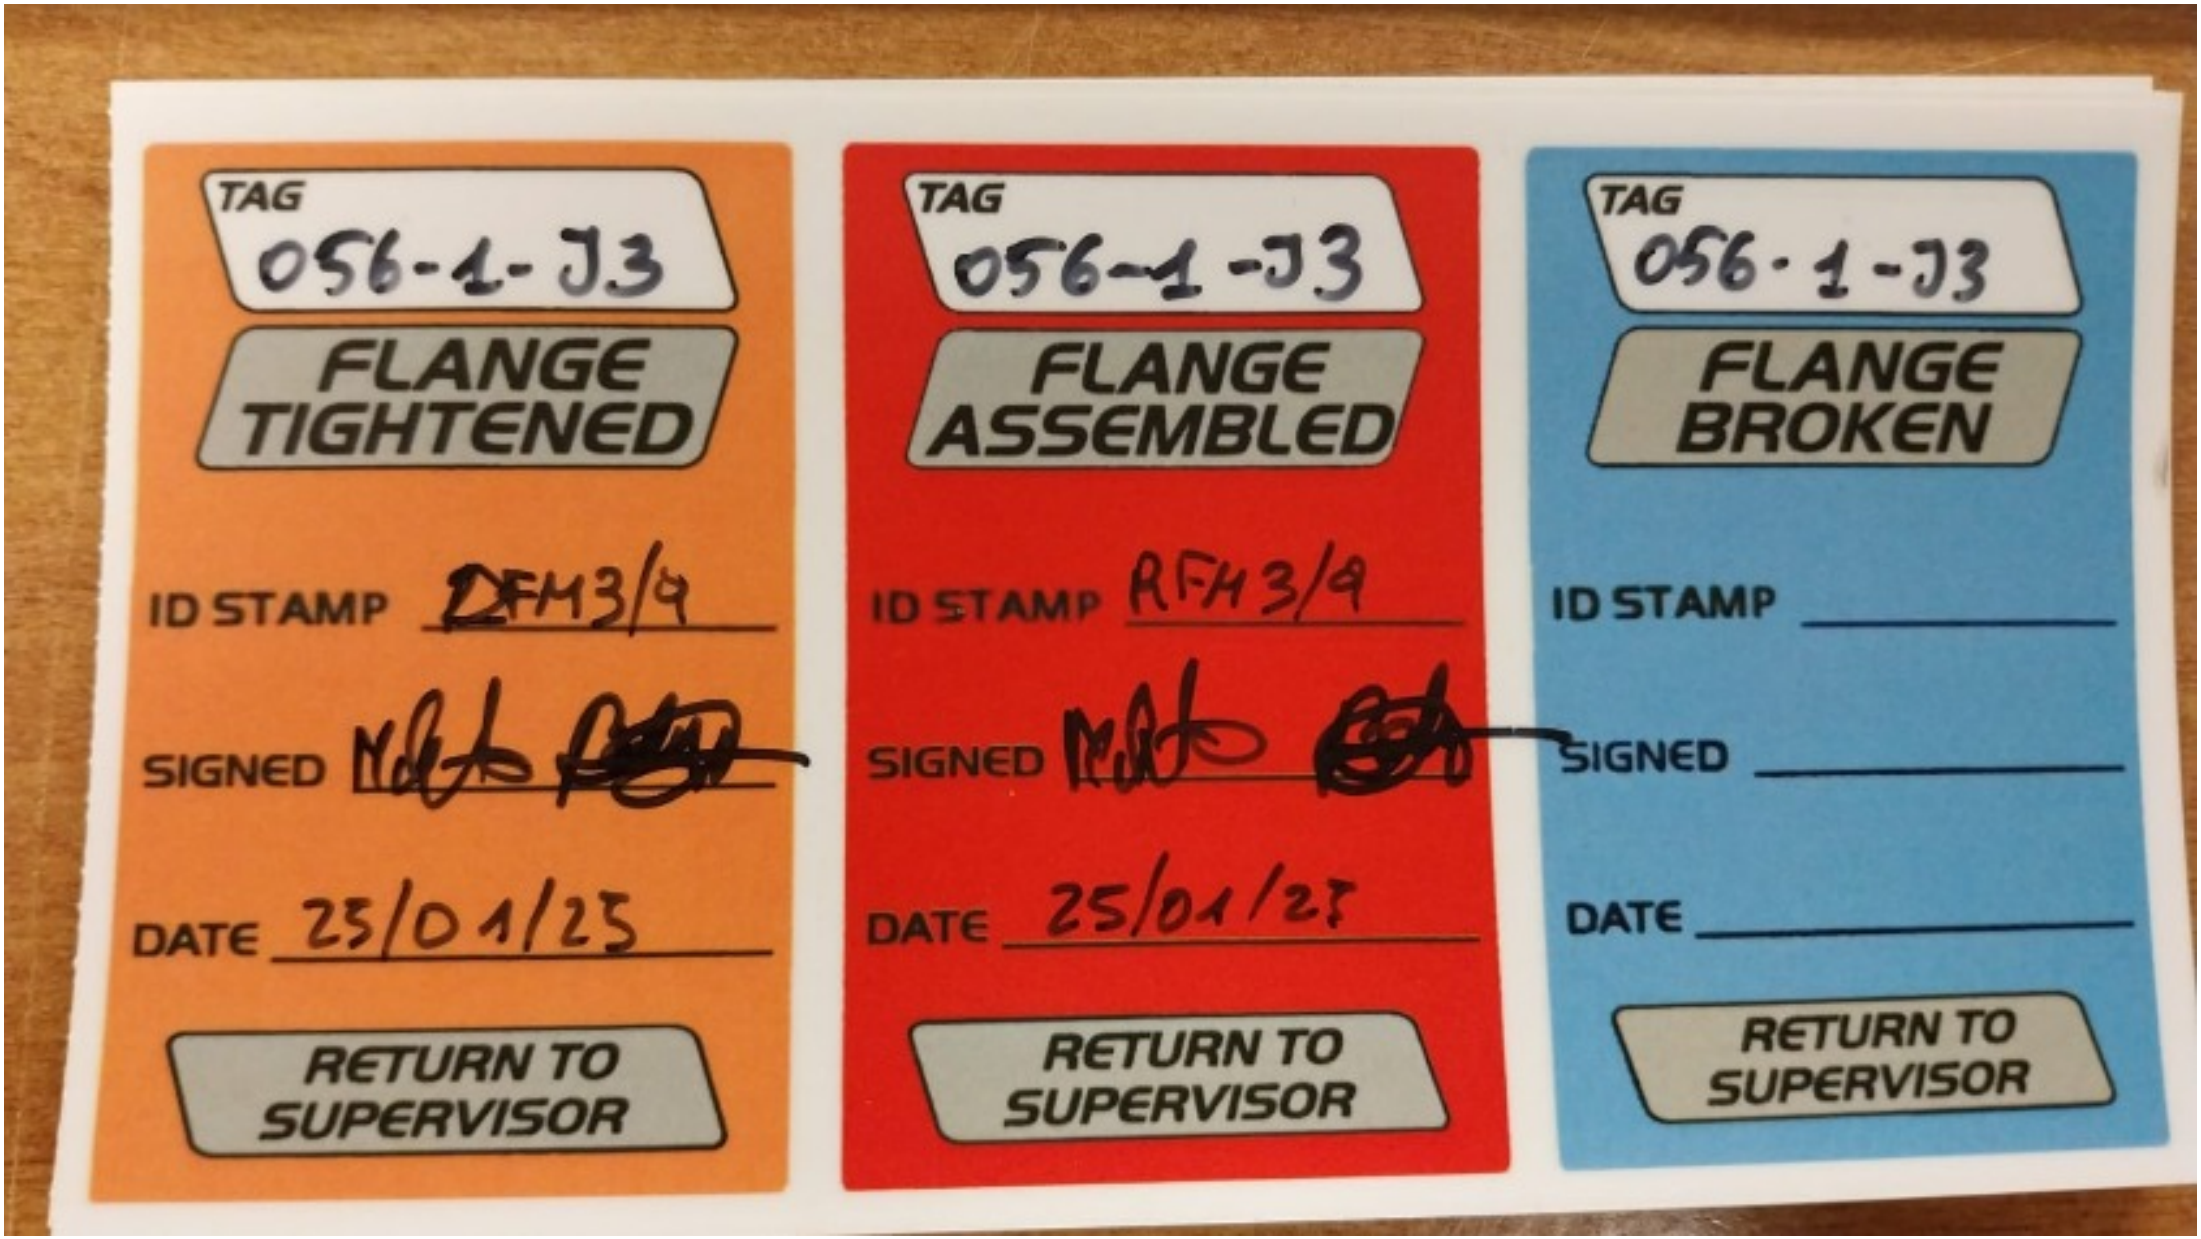
TAG
056-1-J3
FLANGE TIGHTENED
ID STAMP RFH3/9
SIGNED
DATE 25/01/23
RETURN TO SUPERVISOR
TAG
056-1-J3
FLANGE ASSEMBLED
ID STAMP RFH3/9
SIGNED
DATE 25/01/23
RETURN TO SUPERVISOR
TAG
056-1-J3
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	056-1-J4	: Joint 056-1-J4			Dwg	123A90-FDL-PP-DI-00056-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003913		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27		Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type 300LB

Flange Size 1"

Gasket Type Gasket Spiral Wound Thk. 3.2 mm

Bolt tensioning/Torquing value 158.8

Lubricant Yes

Lubricant Type MOLYKOTE 1000 PASTE

Used tools Torque wrench T064079 / RA00598

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	159	48	95	158.8
2	48	159	48	95	158.8
3	48	159	48	95	158.8
4	48	159	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes

4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Lorenzo Novaga	
Date	2025-01-23	2025-01-27	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:55:27.061Z	PROVERLIS Digitaly signed by Lorenzo Novaga 2025-01-27T08:20:52.564Z	

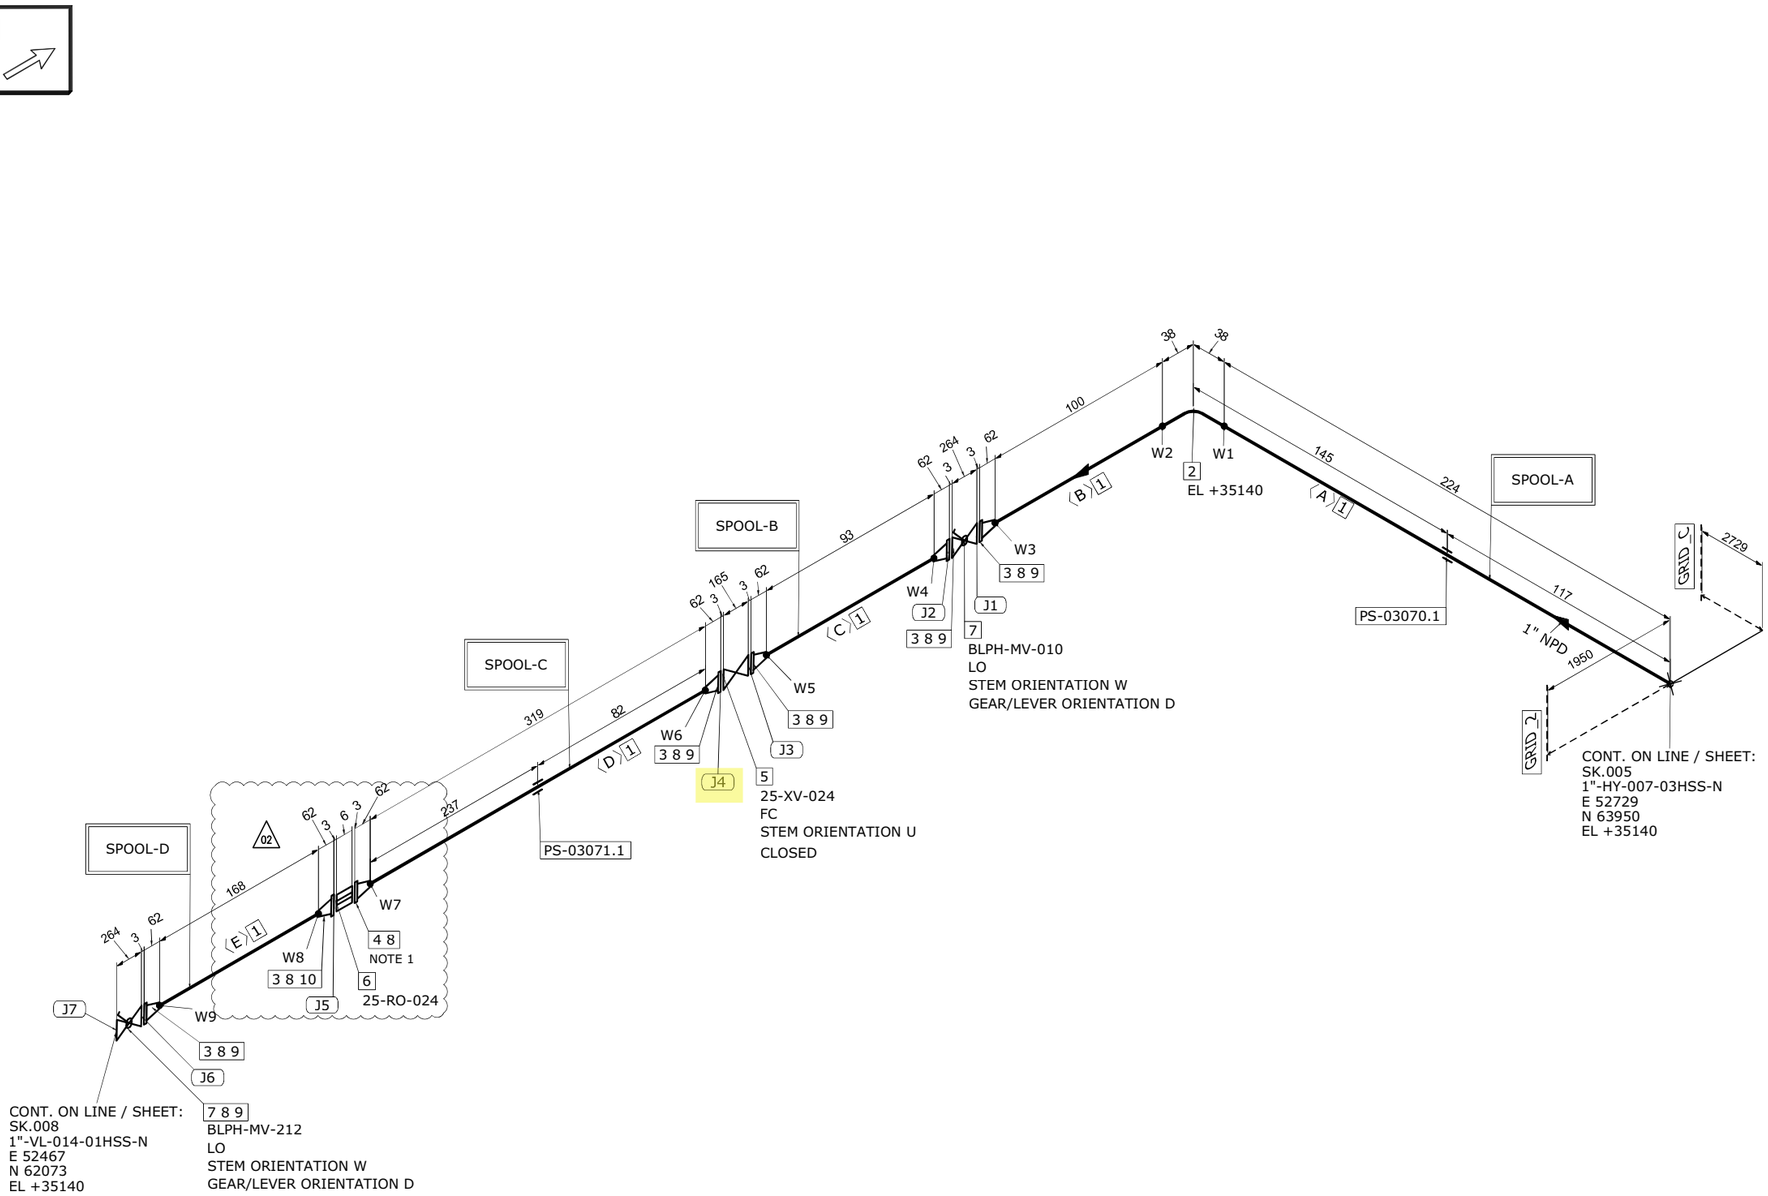

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	0.9M	2.3
2	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
3	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	6	11.0
4	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
5	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
6	1		Restriction Orifice 300#RF	1	1.0
7	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	2	27.0
8	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	8	0.6
9	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	24	5.5
10	5/8	SB20BO04190300	90 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	15.2
ERECTION WEIGHT [kg]	76.1
OVERALL WEIGHT [kg]	91.3

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	224	BEVEL	BEVEL
B	1	100	BEVEL	BEVEL
C	1	93	BEVEL	BEVEL
D	1	319	BEVEL	BEVEL
E	1	168 (02)	BEVEL	BEVEL

SUPPORT LIST

PS-03070.1
PS-03071.1

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	2.8
B	2	3.9
C	2	4.5
D	2	4.1
MONT	0	76.1

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-143-03HSS-N

SK.056

CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE	N/A
DRAWN	STAFF SRL	CHECKED	RT	APPROVED	LM
FORMAT	A3	DRAWING NO.	123A90-FDL-PP-DI-00056	SHEET / OF	1/1
				DATE	17-09-2024
				REV.	02

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II					
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS					
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]				
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water			


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION E/W


MASTER

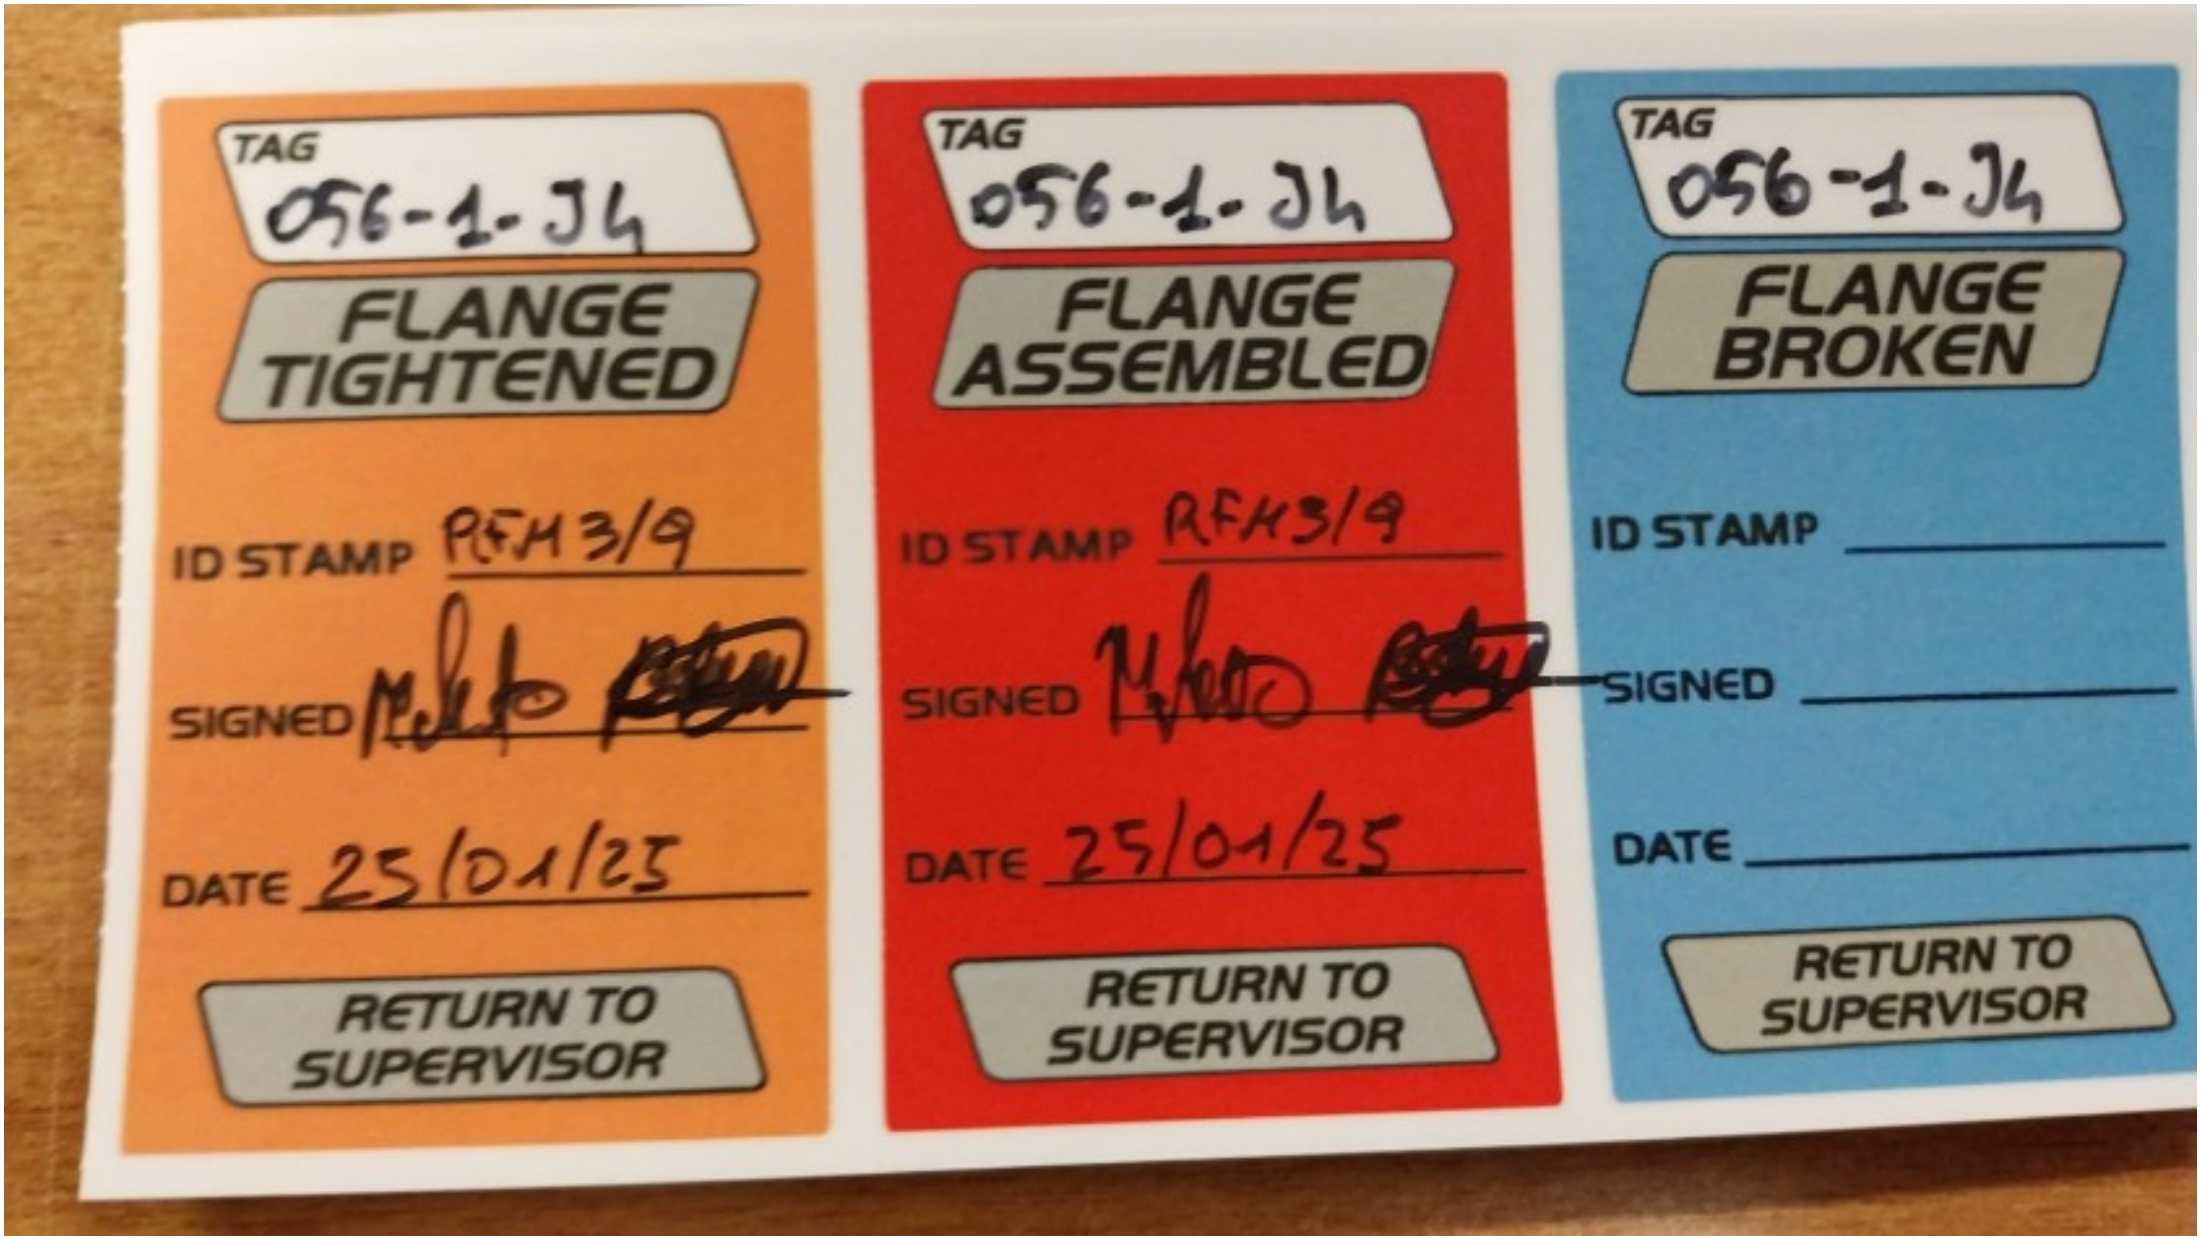
TAG
056-1-JH
FLANGE TIGHTENED
ID STAMP RFH 3/9
SIGNED
DATE 25/01/25
RETURN TO SUPERVISOR
TAG
056-1-JH
FLANGE ASSEMBLED
ID STAMP RFH 3/9
SIGNED
DATE 25/01/25
RETURN TO SUPERVISOR
TAG
056-1-JH
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	056-1-J5	: Joint 056-1-J5			Dwg	123A90-FDL-PP-DI-00056-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003914		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27		Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	T064079 / RA00598
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes

4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-29	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:55:37.103Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-29T15:48:05.836Z	

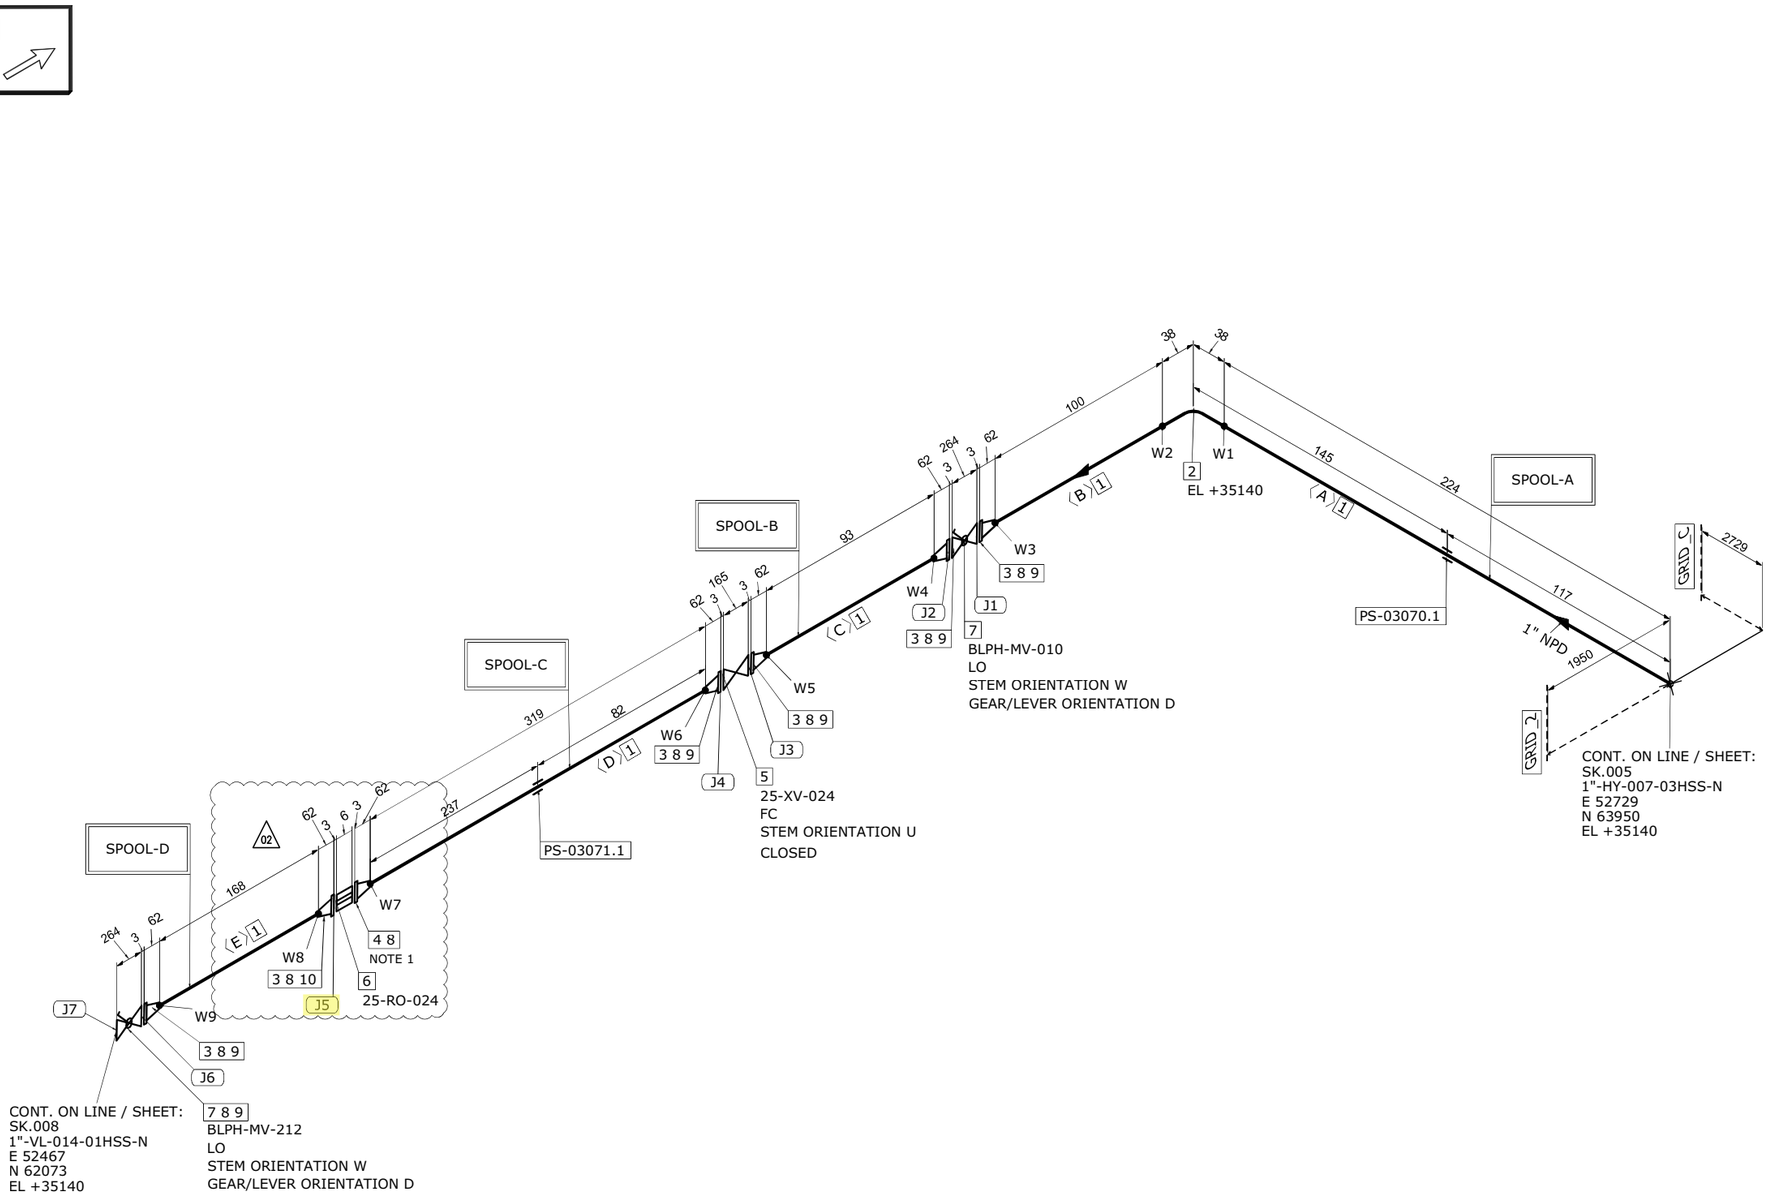

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	0.9M	2.3
2	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
3	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	6	11.0
4	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
5	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
6	1		Restriction Orifice 300#RF	1	1.0
7	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	2	27.0
8	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	8	0.6
9	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	24	5.5
10	5/8	SB20BO04190300	90 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	15.2
ERECTION WEIGHT [kg]	76.1
OVERALL WEIGHT [kg]	91.3

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	224	BEVEL	BEVEL
B	1	100	BEVEL	BEVEL
C	1	93	BEVEL	BEVEL
D	1	319	BEVEL	BEVEL
E	1	168 (02)	BEVEL	BEVEL

SUPPORT LIST

PS-03070.1
PS-03071.1

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	2.8
B	2	3.9
C	2	4.5
D	2	4.1
MONT	0	76.1

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-143-03HSS-N

SK.056

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK

SCALE: N/A

DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024

FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00056 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION E/W

MASTER

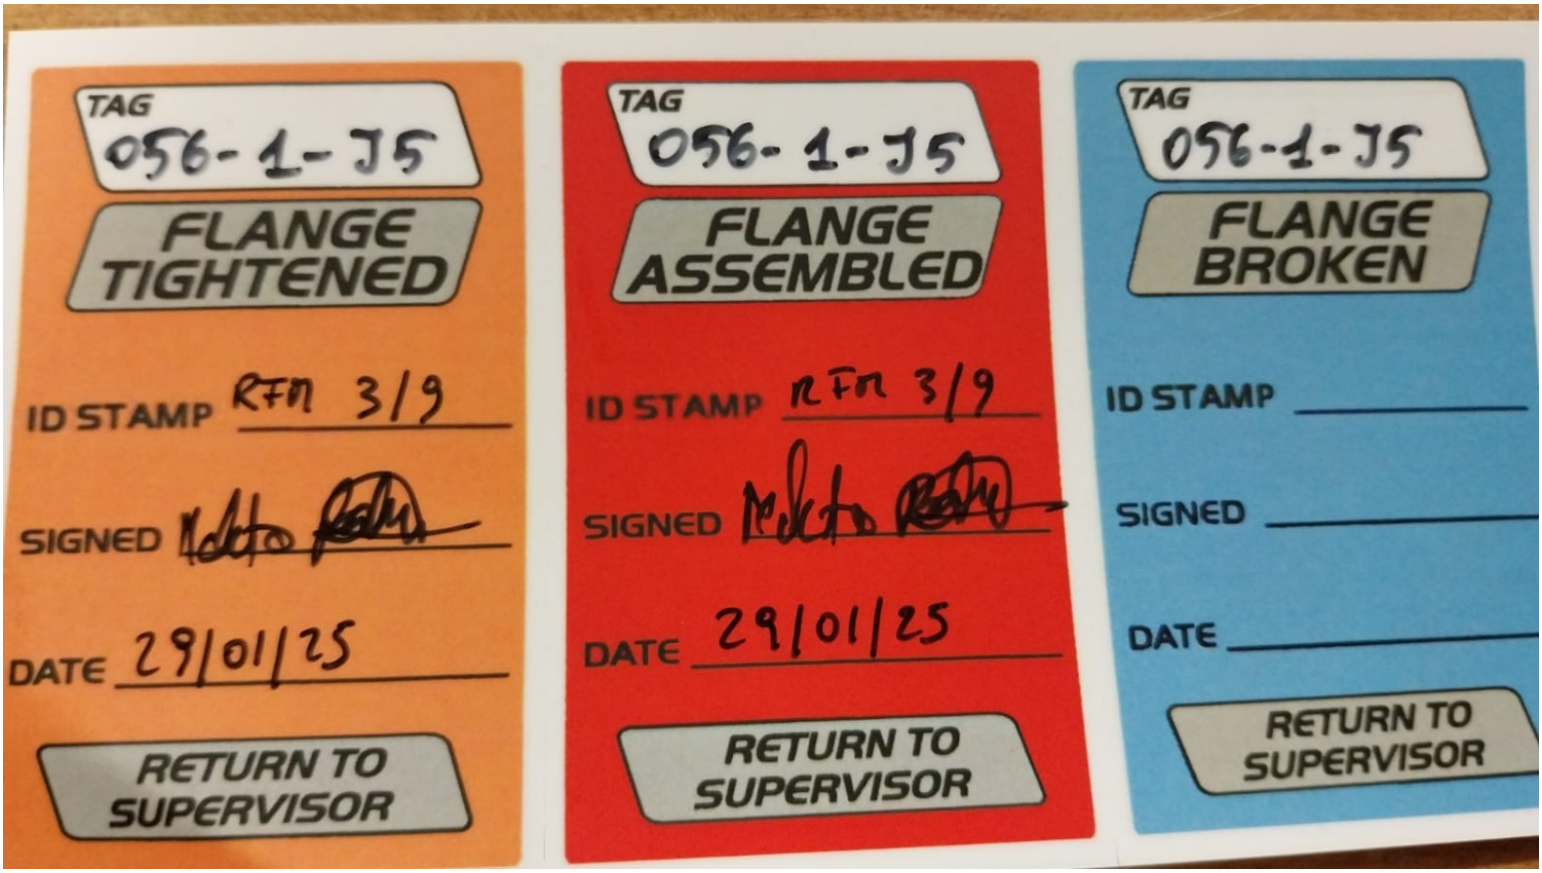

TAG
056-1-J5
FLANGE TIGHTENED
ID STAMP RFM 3/9
SIGNED
DATE 29/01/25
RETURN TO SUPERVISOR
TAG
056-1-J5
FLANGE ASSEMBLED
ID STAMP RFM 3/9
SIGNED
DATE 29/01/25
RETURN TO SUPERVISOR
TAG
056-1-J5
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ROSETTI MARINO — CROSSWIND

ITEM	Tag	056-1-J6	: Joint 056-1-J6			Dwg	123A90-FDL-PP-DI-00056-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003915	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 — Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Stick to design the concerned flange

Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	T064079 / RA00598
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes

4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-30	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:55:48.101Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-30T10:18:54.686Z	

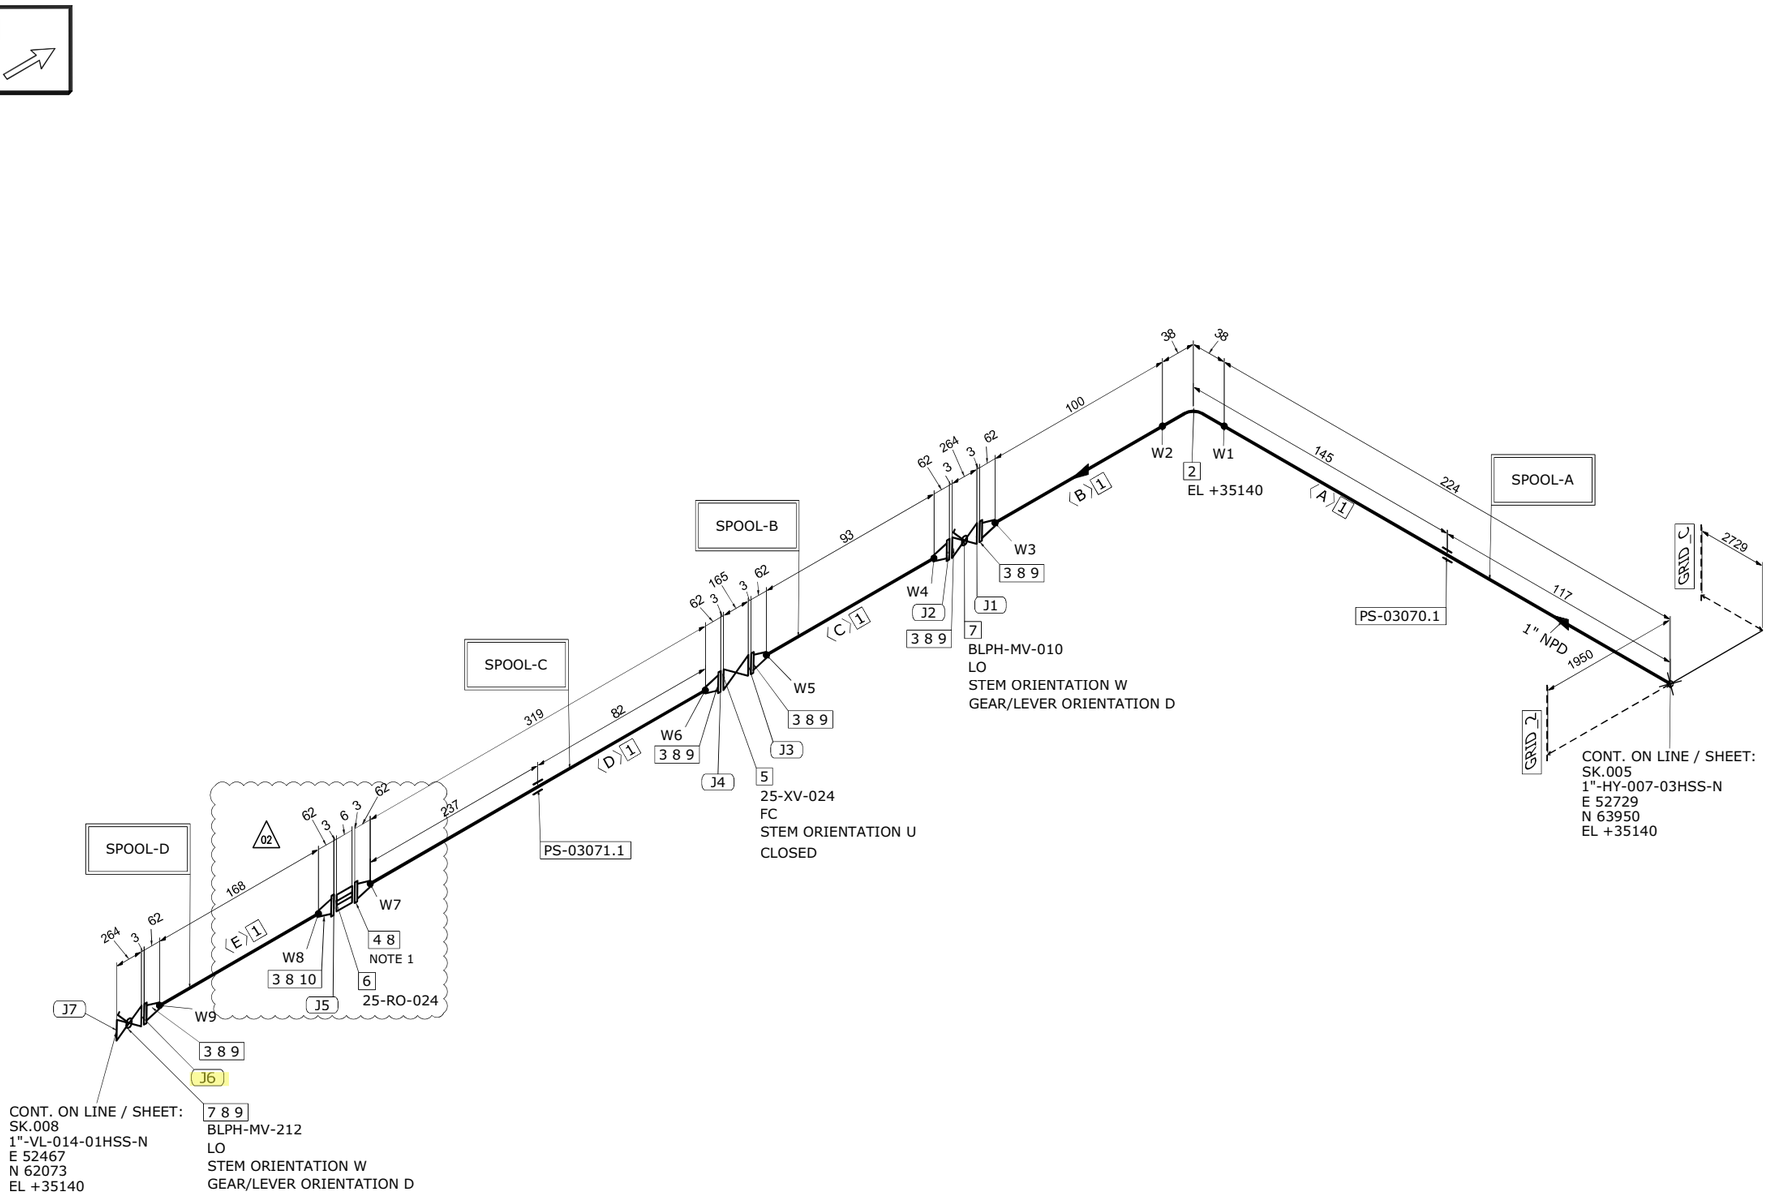

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	0.9M	2.3
2	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
3	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	6	11.0
4	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
5	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
6	1		Restriction Orifice 300#RF	1	1.0
7	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	2	27.0
8	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	8	0.6
9	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	24	5.5
10	5/8	SB20BO04190300	90 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	15.2
ERECTION WEIGHT [kg]	76.1
OVERALL WEIGHT [kg]	91.3

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	224	BEVEL	BEVEL
B	1	100	BEVEL	BEVEL
C	1	93	BEVEL	BEVEL
D	1	319	BEVEL	BEVEL
E	1	168 (02)	BEVEL	BEVEL

SUPPORT LIST

PS-03070.1
PS-03071.1

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	2.8
B	2	3.9
C	2	4.5
D	2	4.1
MONT	0	76.1

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-143-03HSS-N

SK.056

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK

SCALE: N/A

DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024

FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00056 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		

REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION E/W

MASTER

TAG 056-1-J6

FLANGE TIGHTENED

ID STAMP RFH 3/9

SIGNED [signature]

DATE 30/01/23

RETURN TO SUPERVISOR

TAG 056-1-J6

FLANGE ASSEMBLED

ID STAMP RFH 3/9

SIGNED [signature]

DATE 30/01/23

RETURN TO SUPERVISOR

TAG 056-1-J6

FLANGE BROKEN

ID STAMP _____

SIGNED _____


DATE _____

RETURN TO SUPERVISOR

ITEM	Tag	056-1-J7	: Joint 056-1-J7			Dwg	123A90-FDL-PP-DI-00056-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10003916		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27		Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	T064079 / RA00598
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes

4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☒ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Andrea Mancini	
Date	2025-01-23	2025-01-30	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:56:01.388Z	PROVERLIS Digitaly signed by Andrea Mancini 2025-01-30T10:19:12.494Z	

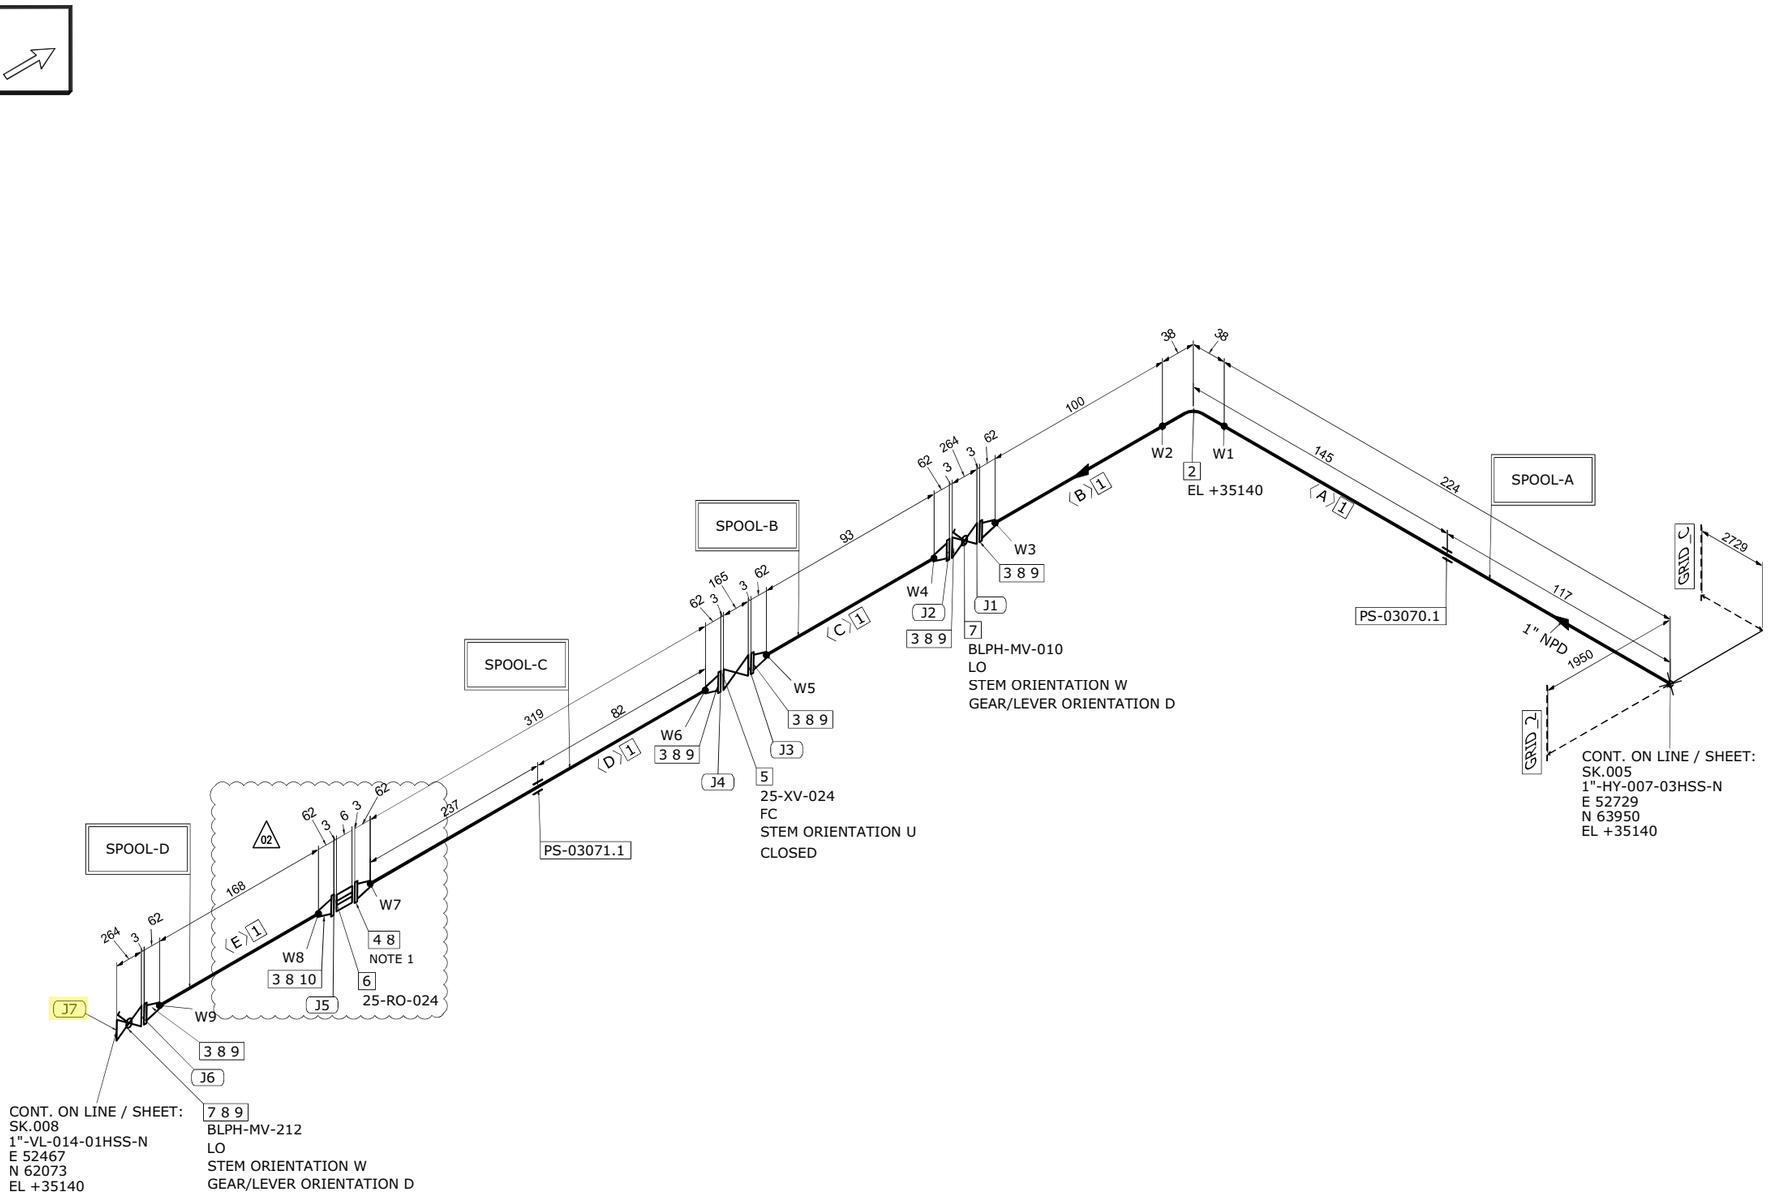

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	0.9M	2.3
2	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
3	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	6	11.0
4	1	FLWDSS00770100	Flange WN For Jackscrews ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
5	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
6	1		Restriction Orifice 300#RF	1	1.0
7	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	2	27.0
8	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	8	0.6
9	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	24	5.5
10	5/8	SB20BO04190300	90 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	1.0

FABRICATION WEIGHT [kg]	15.2
ERECTION WEIGHT [kg]	76.1
OVERALL WEIGHT [kg]	91.3

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
W7	1	BW
W8	1	BW
W9	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	224	BEVEL	BEVEL
B	1	100	BEVEL	BEVEL
C	1	93	BEVEL	BEVEL
D	1	319	BEVEL	BEVEL
E	1	168 (02)	BEVEL	BEVEL

SUPPORT LIST

PS-03070.1
PS-03071.1

SPOOL	WELD [inches]	WEIGHT [kg]
A	3	2.8
B	2	3.9
C	2	4.5
D	2	4.1
MONT	0	76.1

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
02	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
01	03-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	30-07-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-143-03HSS-N

SK.056

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK

SCALE: N/A

DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024

FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00056 | SHEET / OF: 1/1 | REV.: 02

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL 9002	FLUID PHASE	GAS				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	--		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80013
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1.JACKSCREWS POSITION E/W


MASTER

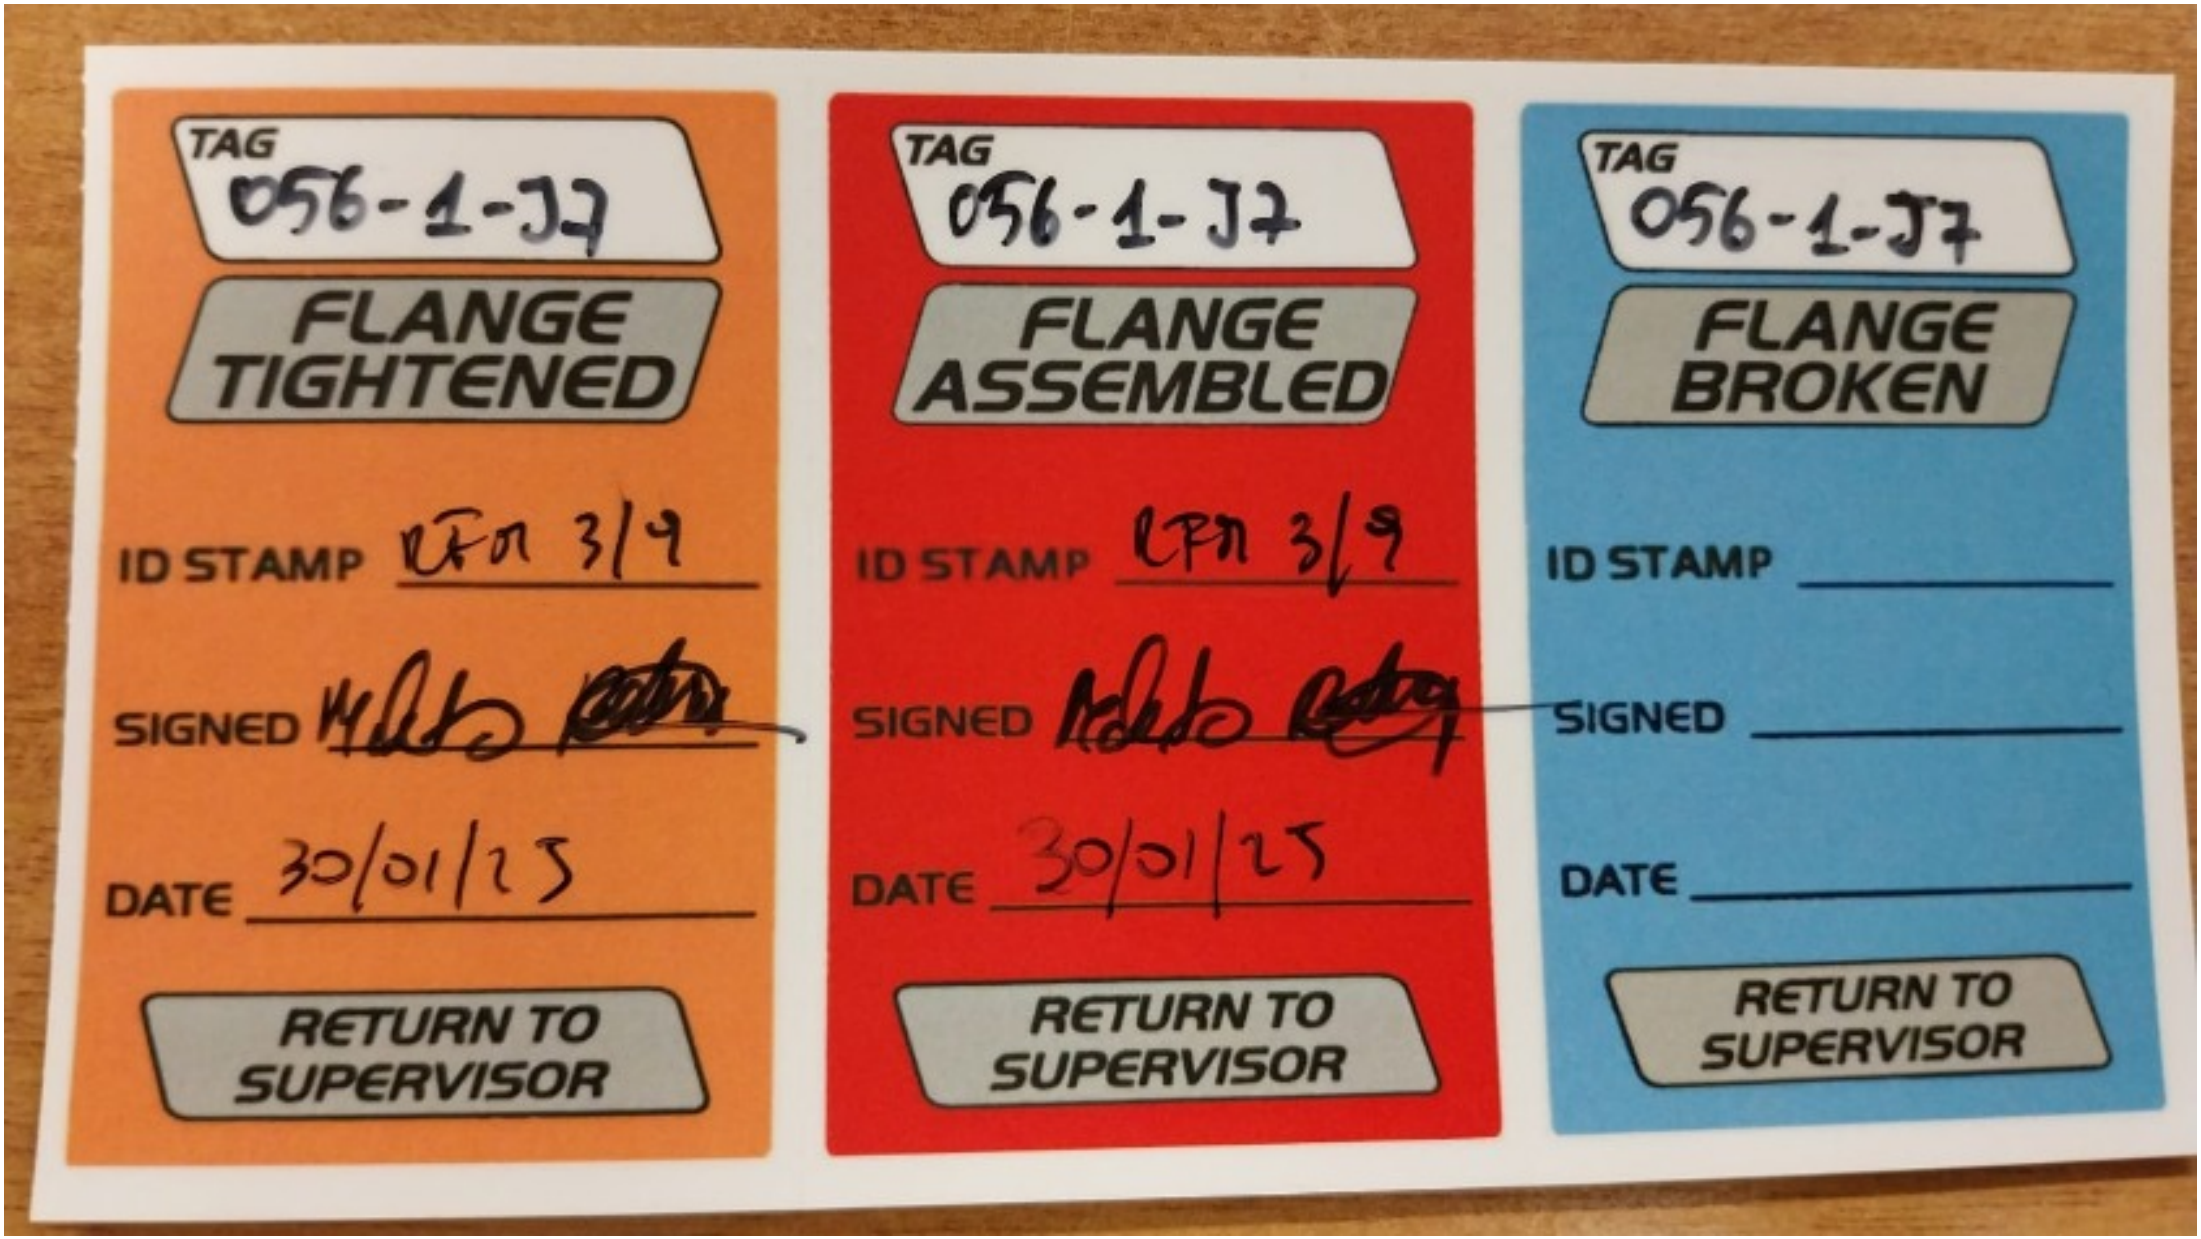
TAG
056-1-J7
FLANGE TIGHTENED
ID STAMP
SIGNED
DATE
30/01/25
RETURN TO SUPERVISOR
TAG
056-1-J7
FLANGE ASSEMBLED
ID STAMP
SIGNED
DATE
30/01/25
RETURN TO SUPERVISOR
TAG
056-1-J7
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	005-1-J1	: Joint 005-1-J1			Dwg	123A90-FDL-PP-DI-00005-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004321		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27		Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type 300LB

Flange Size 1"

Gasket Type Gasket Spiral Wound Thk. 3.2 mm

Bolt tensioning/Torquing value 158.8

Lubricant Yes

Lubricant Type MOLYKOTE 1000 PASTE

Used tools Torque wrench V030390 / RD00261

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	159	48	95	158.8
2	48	159	48	95	158.8
3	48	159	48	95	158.8
4	48	159	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes

4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Lorenzo Novaga	
Date	2025-01-23	2025-01-23	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:58:36.274Z	PROVERLIS Digitaly signed by Lorenzo Novaga 2025-01-23T10:02:42.653Z	

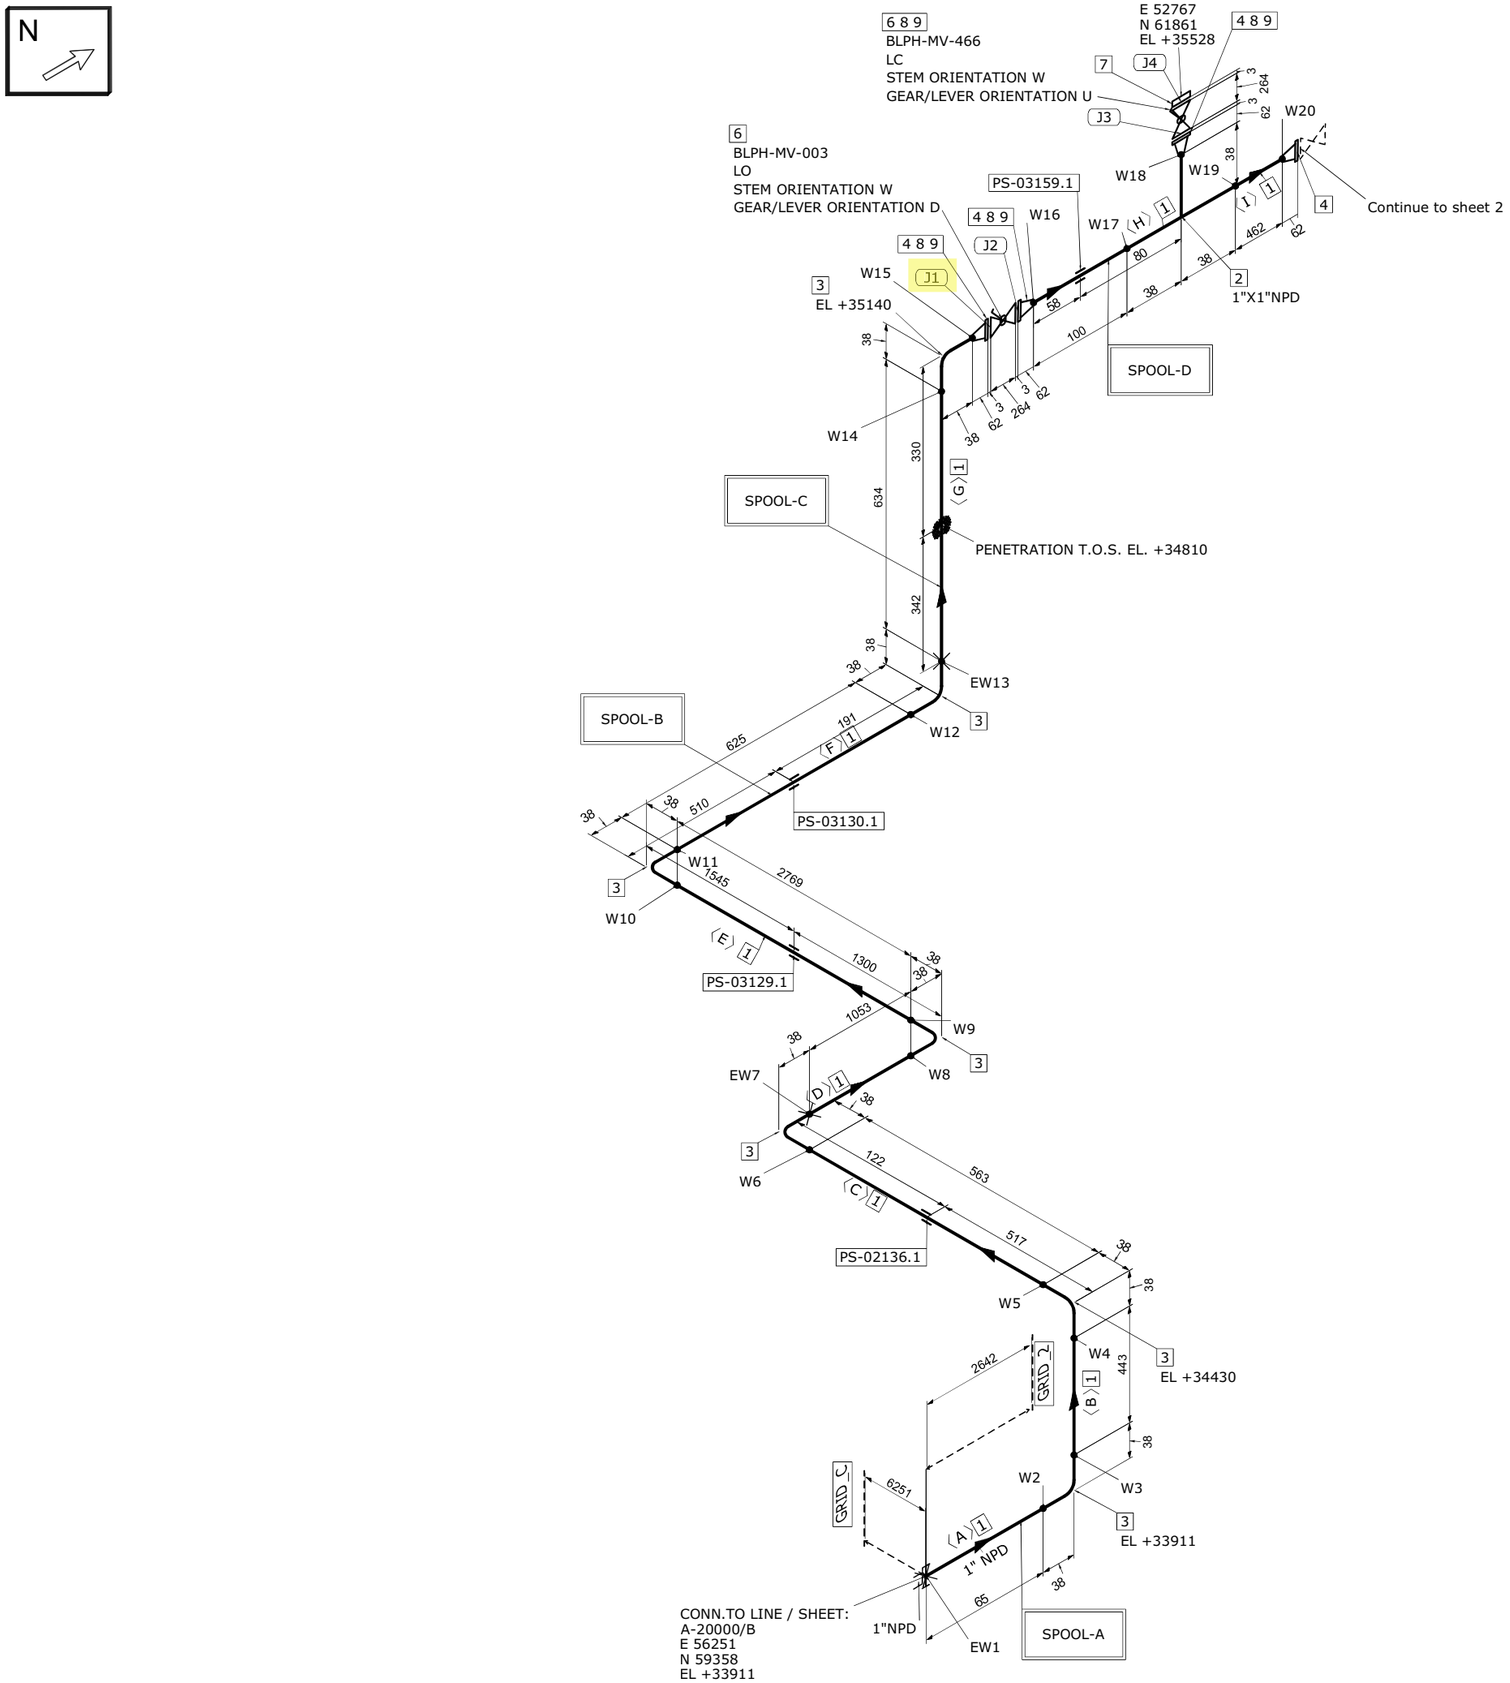

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	6.7M	17.1
2	1X1	TEE0SS00550100	Tee ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	7	1.0
4	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
6	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	2	27.0
7	1	FLB0SS01830100	Flange Blind ASME B16.5 300LB RF FRG ASTM A182 Gr.F316/316L	1	1.8
8	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	4	0.3
9	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7

FABRICATION WEIGHT [kg]	25.7
ERECTION WEIGHT [kg]	32.8
OVERALL WEIGHT [kg]	58.5

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
EW1	1	SW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
EW7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	1	BW
W12	1	BW
EW13	1	BW
W14	1	BW
W15	1	BW
W16	1	BW
W17	1	BW
W18	1	BW
W19	1	BW
W20	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	65	SQ.CUT	BEVEL
B	1	443	BEVEL	BEVEL
C	1	563	BEVEL	BEVEL
D	1	1053	BEVEL	BEVEL
E	1	2769	BEVEL	BEVEL
F	1	625	BEVEL	BEVEL
G	1	634	BEVEL	BEVEL
H	1	100	BEVEL	BEVEL
I	1	462	BEVEL	BEVEL

SUPPORT LIST

PS-02136.1
PS-03129.1
PS-03130.1
PS-03159.1

SPOOL	WELD [inches]	WEIGHT [kg]
A	5	3.1
B	5	11.7
C	2	3.6
D	5	7.3
MONT	3	32.8

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	03-09-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL-9002	FLUID PHASE	Gas				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	N/A		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		

REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80011
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

MASTER


CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-007-03HSS-N

SK.005


CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	N/A
DRAWN	STAFF SRL	CHECKED RT	APPROVED LM	DATE 03-09-2024
FORMAT A3	DRAWING NO. 123A90-FDL-PP-DI-00005		SHEET / OF 1/3	REV. 00

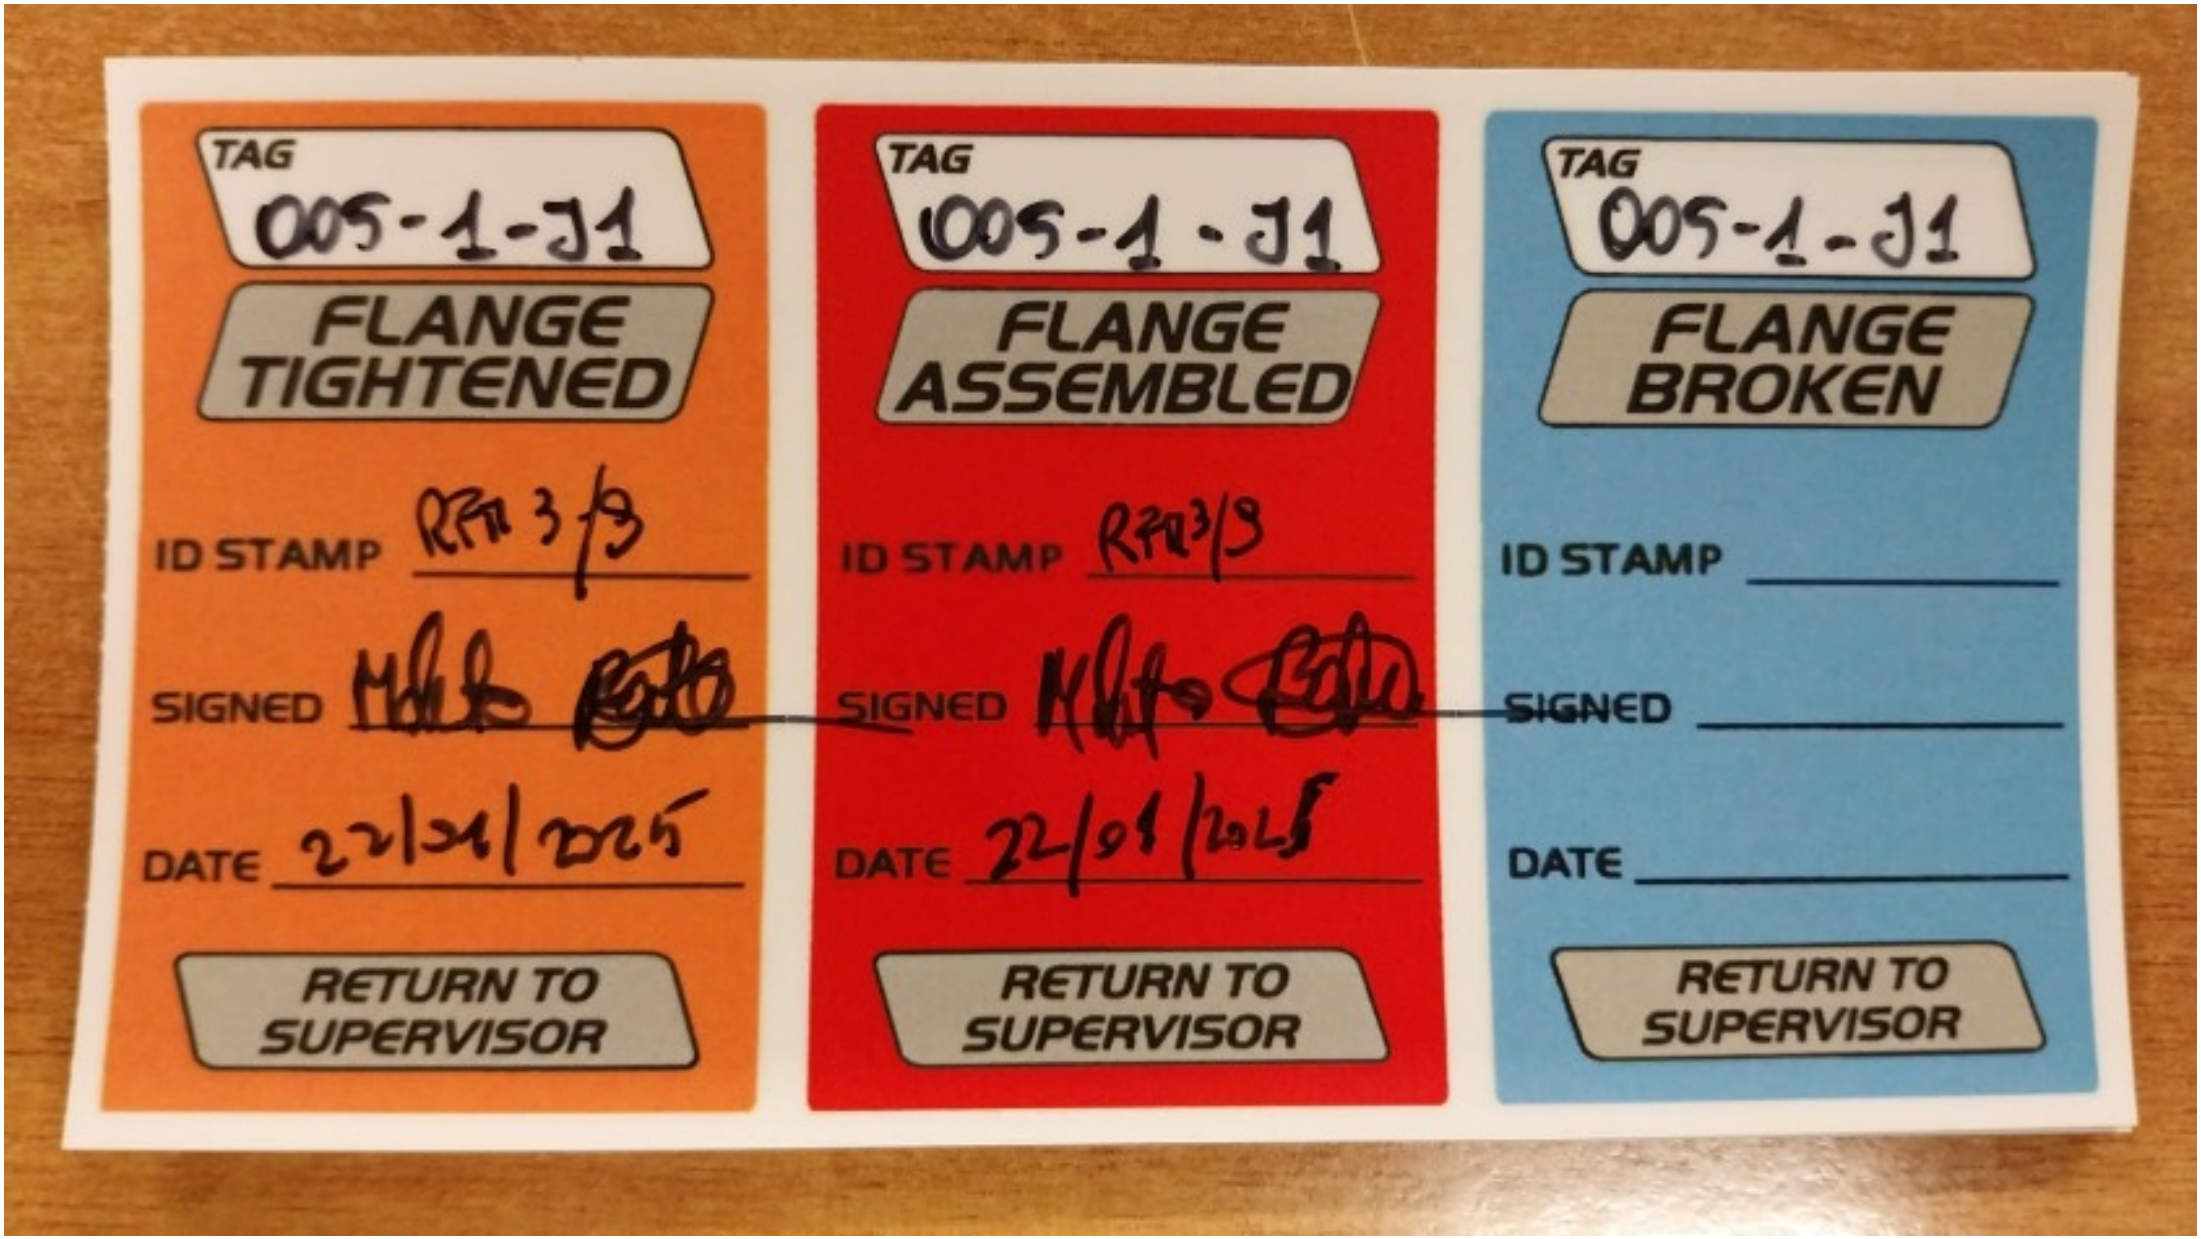
TAG
005-1-J1
FLANGE TIGHTENED
ID STAMP RPA 3/3
SIGNED
DATE 22/01/2025
RETURN TO SUPERVISOR
TAG
005-1-J1
FLANGE ASSEMBLED
ID STAMP RPA 3/3
SIGNED
DATE 22/01/2025
RETURN TO SUPERVISOR
TAG
005-1-J1
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	005-1-J2	: Joint 005-1-J2			Dwg	123A90-FDL-PP-DI-00005-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004322		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27		Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	Torque wrench V030390 / RD00261
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	159	48	95	158.8
2	48	159	48	95	158.8
3	48	159	48	95	158.8
4	48	159	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes

4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM (ROSETTI MARINO)	
Name	Emanuele Delfino	Lorenzo Novaga	
Date	2025-01-23	2025-01-23	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:58:49.716Z	PROVERLIS Digitaly signed by Lorenzo Novaga 2025-01-23T10:02:32.597Z	

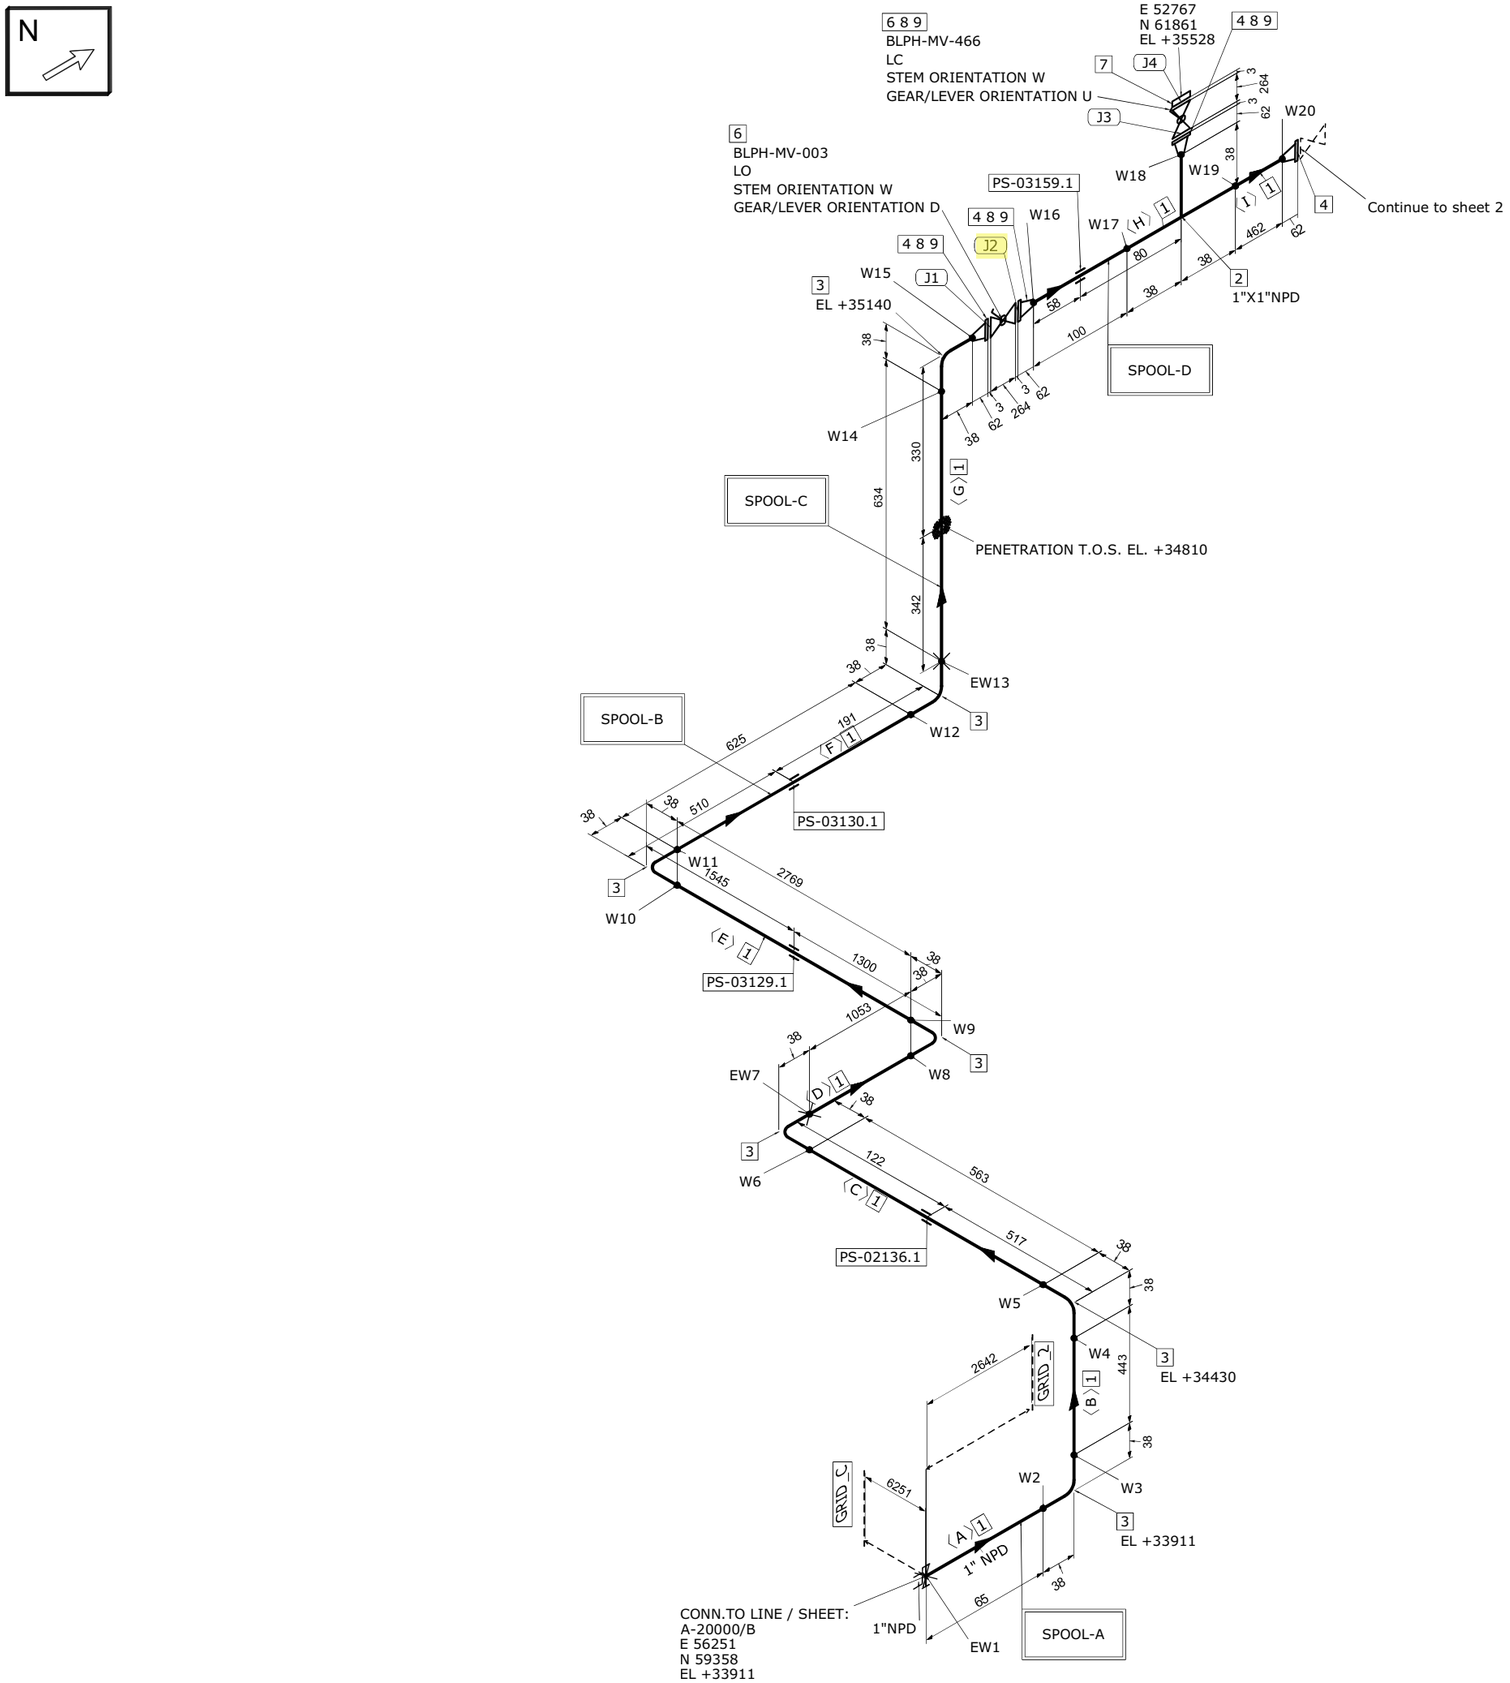

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	6.7M	17.1
2	1X1	TEE0SS00550100	Tee ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	7	1.0
4	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
6	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	2	27.0
7	1	FLB0SS01830100	Flange Blind ASME B16.5 300LB RF FRG ASTM A182 Gr.F316/316L	1	1.8
8	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	4	0.3
9	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7

FABRICATION WEIGHT [kg]	25.7
ERECTION WEIGHT [kg]	32.8
OVERALL WEIGHT [kg]	58.5

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
EW1	1	SW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
EW7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	1	BW
W12	1	BW
EW13	1	BW
W14	1	BW
W15	1	BW
W16	1	BW
W17	1	BW
W18	1	BW
W19	1	BW
W20	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	65	SQ.CUT	BEVEL
B	1	443	BEVEL	BEVEL
C	1	563	BEVEL	BEVEL
D	1	1053	BEVEL	BEVEL
E	1	2769	BEVEL	BEVEL
F	1	625	BEVEL	BEVEL
G	1	634	BEVEL	BEVEL
H	1	100	BEVEL	BEVEL
I	1	462	BEVEL	BEVEL

SUPPORT LIST

PS-02136.1
PS-03129.1
PS-03130.1
PS-03159.1

SPOOL	WELD [inches]	WEIGHT [kg]
A	5	3.1
B	5	11.7
C	2	3.6
D	5	7.3
MONT	3	32.8

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	03-09-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-007-03HSS-N

SK.005

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II			
PAINTING	SYSTEM 6A	BASE RAL RAL-9002	FLUID PHASE	Gas			
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]		
HEAT TRACING	N/A		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water	


REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80011
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

MASTER


CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	N/A
DRAWN STAFF SRL	CHECKED RT	APPROVED LM	DATE	03-09-2024
FORMAT A3	DRAWING NO. 123A90-FDL-PP-DI-00005		SHEET / OF 1/3	REV. 00

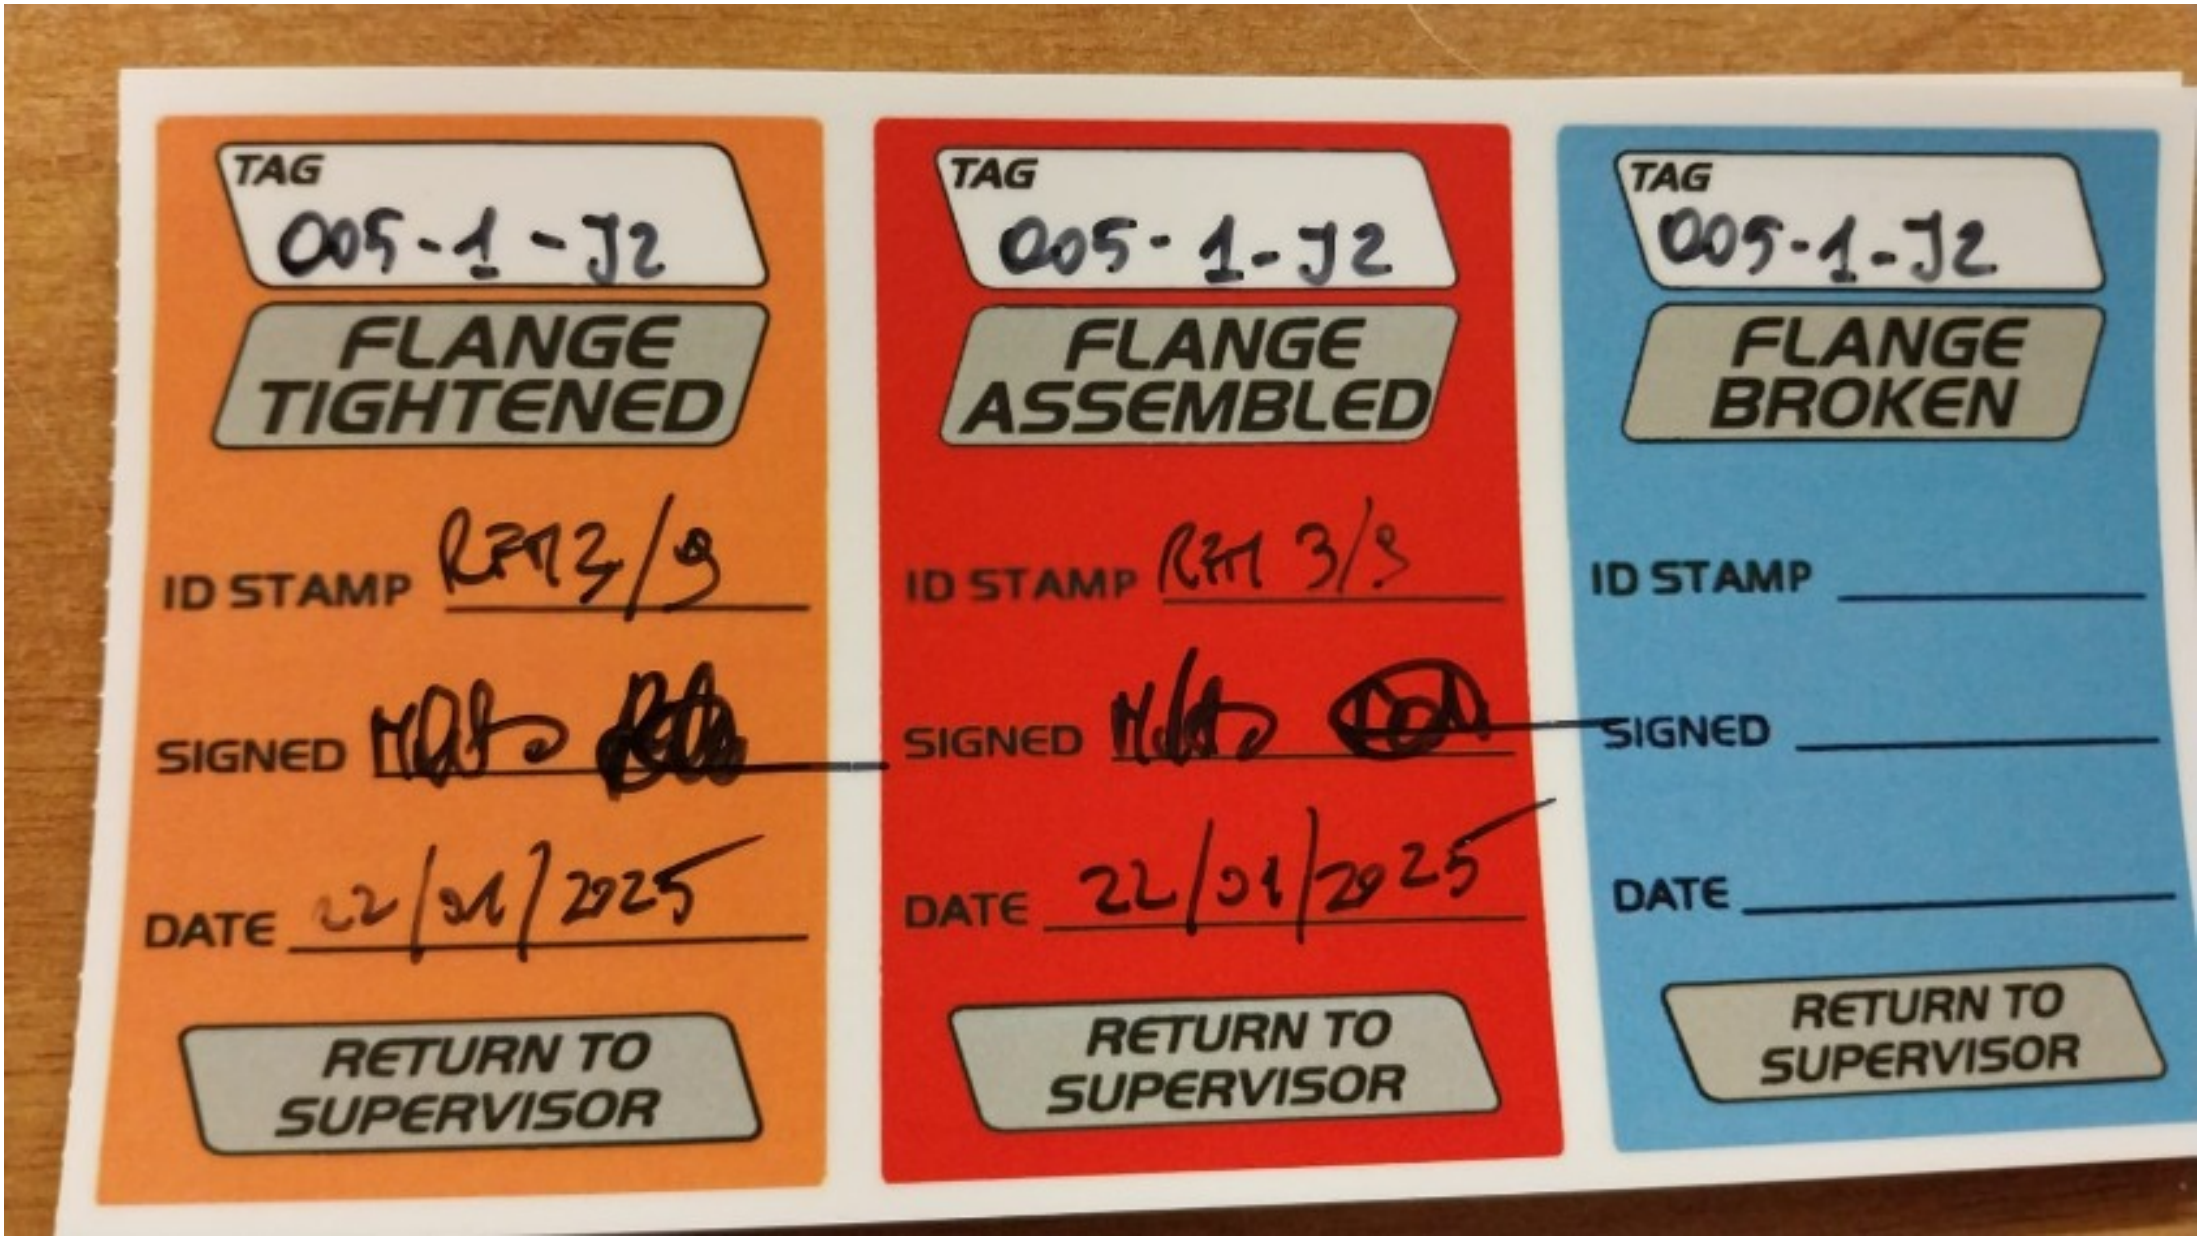
TAG
005-1-J2
FLANGE TIGHTENED
ID STAMP RM3/9
SIGNED
DATE 22/01/2025
RETURN TO SUPERVISOR
TAG
005-1-J2
FLANGE ASSEMBLED
ID STAMP RM 3/9
SIGNED
DATE 22/01/2025
RETURN TO SUPERVISOR
TAG
005-1-J2
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	005-1-J3	: Joint 005-1-J3			Dwg	123A90-FDL-PP-DI-00005-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004323	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27		Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG




Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	Torque wrench V030390 / RD00261
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	159	48	95	158.8
2	48	159	48	95	158.8
3	48	159	48	95	158.8
4	48	159	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1	**Clear Bore Inspection:** Pipe and Valve clear of debris/contamination.	Yes
2	**Flange Face Check:** Both flanges clean and free from damage.	Yes
3	**Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique.	Yes
4	**Alignment:** Check alignment according to code.	Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Lorenzo Novaga	
Date	2025-01-23	2025-01-23	
Signature	Digitaly signed by Emanuele Delfino 2025-01-23T05:59:03.180Z	Digitaly signed by Lorenzo Novaga 2025-01-23T10:02:19.262Z	

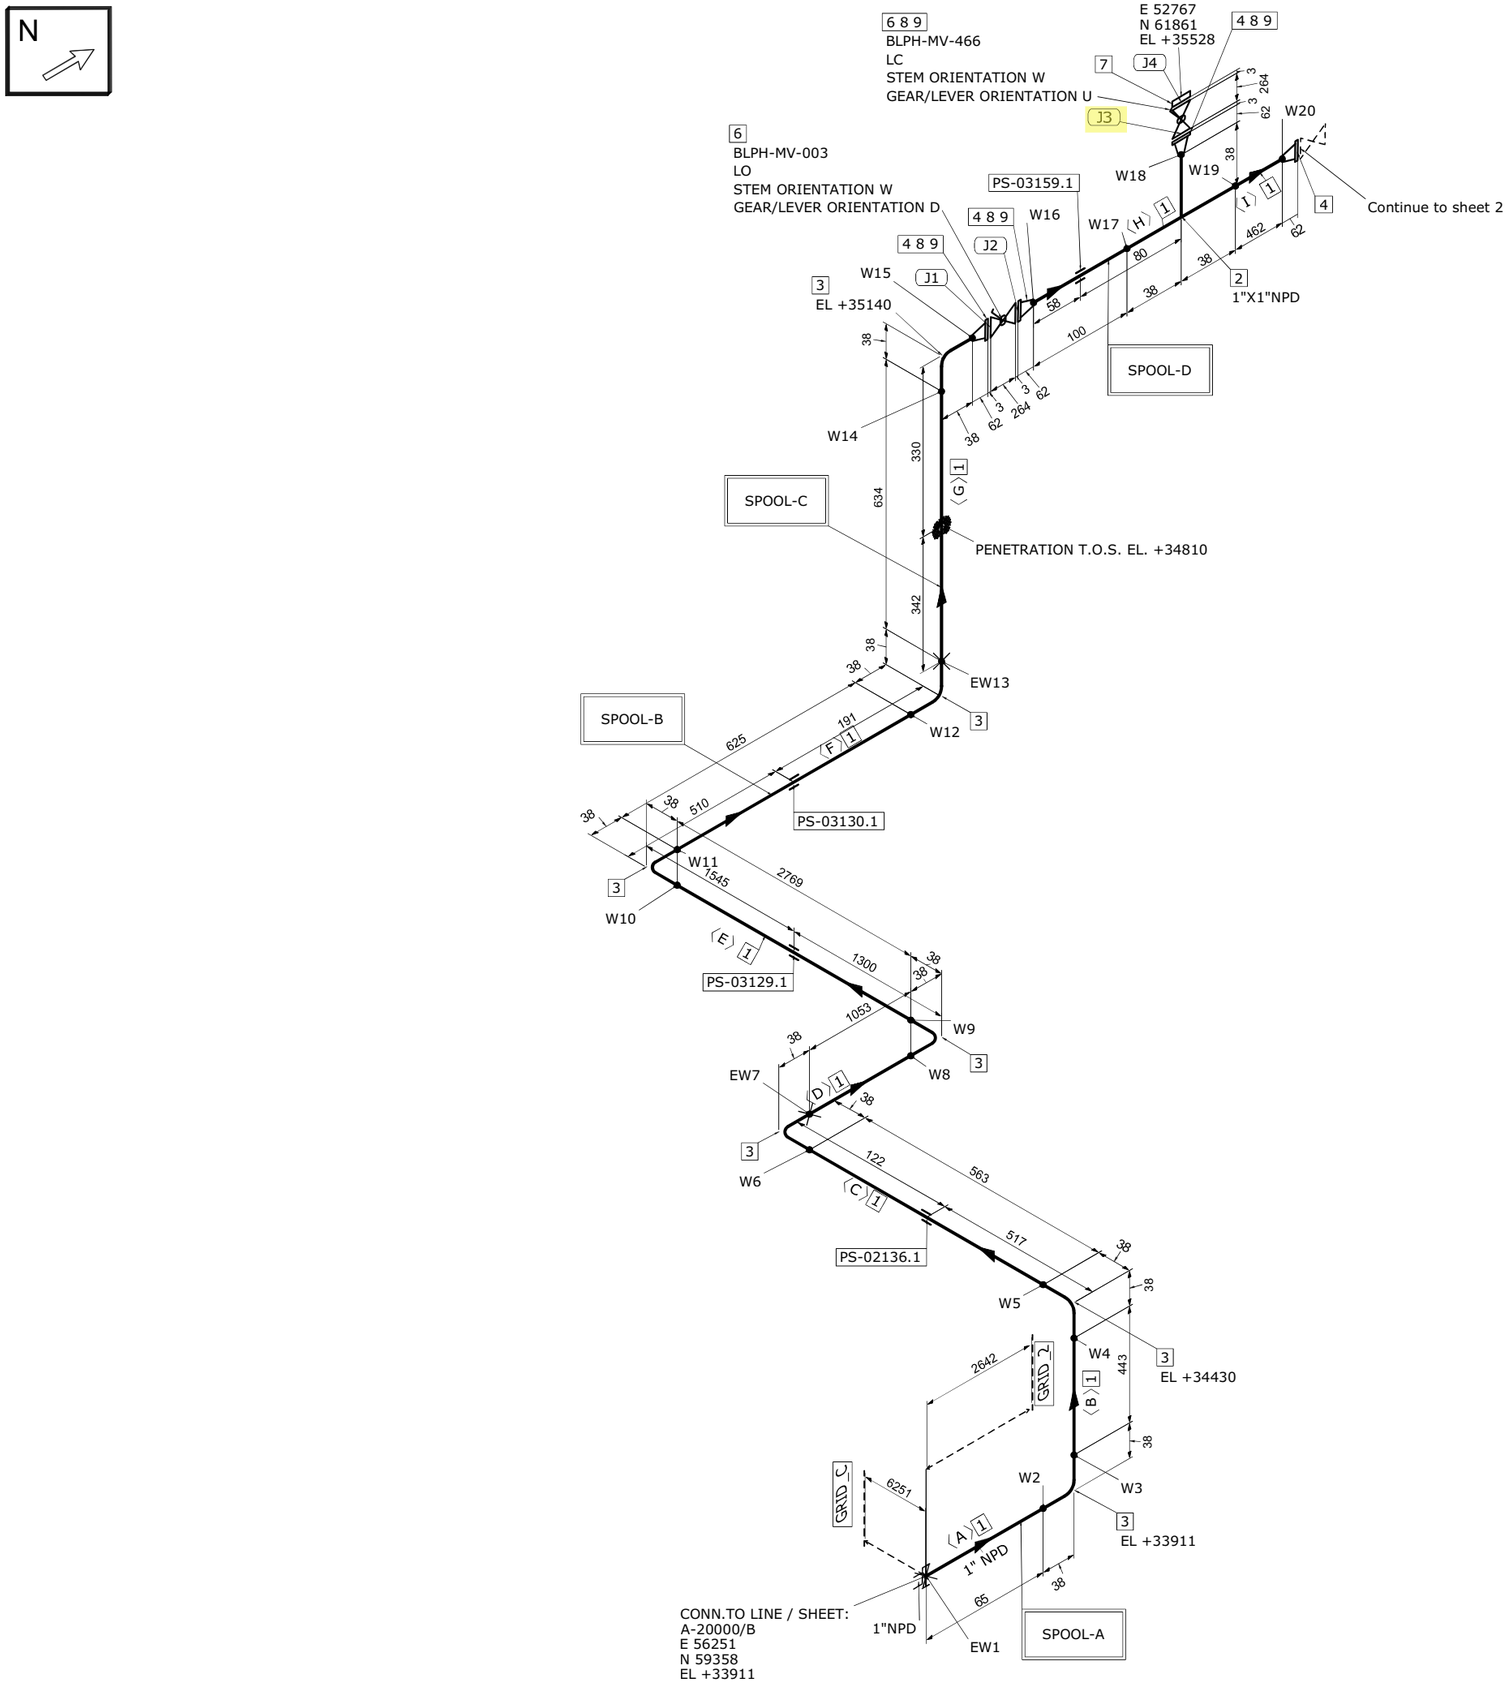

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	6.7M	17.1
2	1X1	TEE0SS00550100	Tee ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	7	1.0
4	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
6	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	2	27.0
7	1	FLB0SS01830100	Flange Blind ASME B16.5 300LB RF FRG ASTM A182 Gr.F316/316L	1	1.8
8	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	4	0.3
9	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7

FABRICATION WEIGHT [kg]	25.7
ERECTION WEIGHT [kg]	32.8
OVERALL WEIGHT [kg]	58.5

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
EW1	1	SW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
EW7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	1	BW
W12	1	BW
EW13	1	BW
W14	1	BW
W15	1	BW
W16	1	BW
W17	1	BW
W18	1	BW
W19	1	BW
W20	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	65	SQ.CUT	BEVEL
B	1	443	BEVEL	BEVEL
C	1	563	BEVEL	BEVEL
D	1	1053	BEVEL	BEVEL
E	1	2769	BEVEL	BEVEL
F	1	625	BEVEL	BEVEL
G	1	634	BEVEL	BEVEL
H	1	100	BEVEL	BEVEL
I	1	462	BEVEL	BEVEL

SUPPORT LIST

PS-02136.1
PS-03129.1
PS-03130.1
PS-03159.1

SPOOL	WELD [inches]	WEIGHT [kg]
A	5	3.1
B	5	11.7
C	2	3.6
D	5	7.3
MONT	3	32.8

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	03-09-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-007-03HSS-N

SK.005

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II			
PAINTING	SYSTEM 6A	BASE RAL RAL-9002	FLUID PHASE	Gas			
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]		
HEAT TRACING	N/A		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water	

REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80011
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

MASTER


CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE	N/A
DRAWN STAFF SRL	CHECKED RT	APPROVED LM	DATE	03-09-2024
FORMAT A3	DRAWING NO. 123A90-FDL-PP-DI-00005		SHEET / OF 1/3	REV. 00


TAG
005-1-J3
FLANGE TIGHTENED
ID STAMP RFB 3/9
SIGNED
DATE 22/01/2025
RETURN TO SUPERVISOR
TAG
005-1-J3
FLANGE ASSEMBLED
ID STAMP RFB/3/9
SIGNED
DATE 22/01/2025
RETURN TO SUPERVISOR
TAG
005-1-J3
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	005-1-J4	: Joint 005-1-J4			Dwg	123A90-FDL-PP-DI-00005-01
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004324	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form TMX27	Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type 300LB

Flange Size 1"

Gasket Type Gasket Spiral Wound Thk. 3.2 mm

Bolt tensioning/Torquing value 158.8

Lubricant Yes

Lubricant Type MOLYKOTE 1000 PASTE

Used tools Torque wrench V030390 / RD00261

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	159	48	95	158.8
2	48	159	48	95	158.8
3	48	159	48	95	158.8
4	48	159	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes

4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Lorenzo Novaga	
Date	2025-01-23	2025-01-23	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:59:15.426Z	PROVERLIS Digitaly signed by Lorenzo Novaga 2025-01-23T10:02:13.765Z	

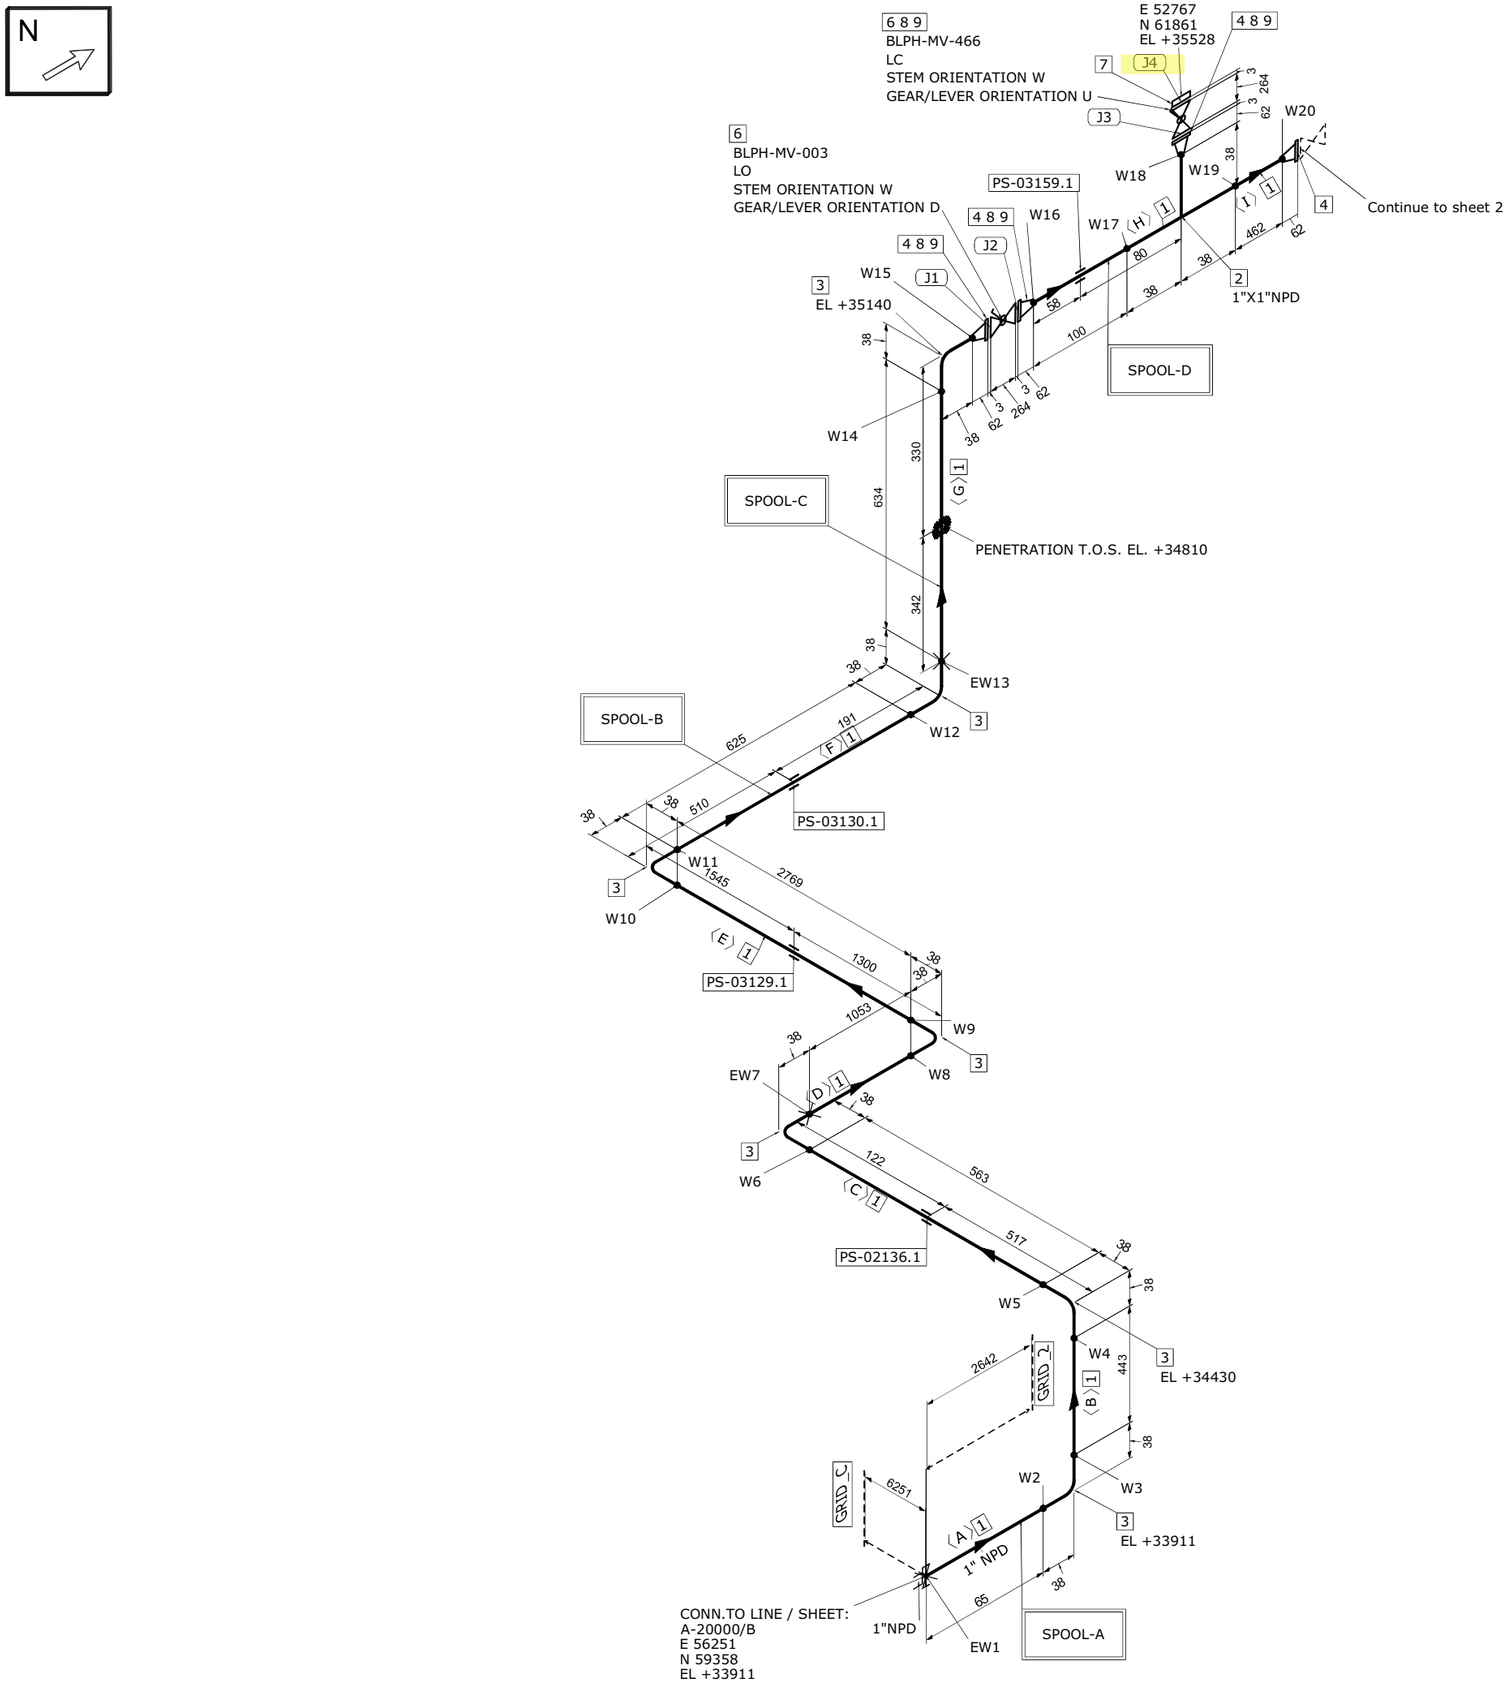

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	6.7M	17.1
2	1X1	TEE0SS00550100	Tee ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	7	1.0
4	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
6	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	2	27.0
7	1	FLB0SS01830100	Flange Blind ASME B16.5 300LB RF FRG ASTM A182 Gr.F316/316L	1	1.8
8	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	4	0.3
9	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	16	3.7

FABRICATION WEIGHT [kg]	25.7
ERECTION WEIGHT [kg]	32.8
OVERALL WEIGHT [kg]	58.5

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
EW1	1	SW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
EW7	1	BW
W8	1	BW
W9	1	BW
W10	1	BW
W11	1	BW
W12	1	BW
EW13	1	BW
W14	1	BW
W15	1	BW
W16	1	BW
W17	1	BW
W18	1	BW
W19	1	BW
W20	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	65	SQ.CUT	BEVEL
B	1	443	BEVEL	BEVEL
C	1	563	BEVEL	BEVEL
D	1	1053	BEVEL	BEVEL
E	1	2769	BEVEL	BEVEL
F	1	625	BEVEL	BEVEL
G	1	634	BEVEL	BEVEL
H	1	100	BEVEL	BEVEL
I	1	462	BEVEL	BEVEL

SUPPORT LIST

PS-02136.1
PS-03129.1
PS-03130.1
PS-03159.1

SPOOL	WELD [inches]	WEIGHT [kg]
A	5	3.1
B	5	11.7
C	2	3.6
D	5	7.3
MONT	3	32.8

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	03-09-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

LINE DATA

NDT INSPECTION CATEGORY	1		PED CATEGORY	II				
PAINTING	SYSTEM 6A	BASE RAL RAL-9002	FLUID PHASE	Gas				
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]			
HEAT TRACING	N/A		TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water		

REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80011
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

MASTER

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-007-03HSS-N

SK.005

CONTRACT NO./ TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE	N/A
DRAWN	STAFF SRL
CHECKED	RT
APPROVED	LM
DATE	03-09-2024
FORMAT	A3
DRAWING NO.	123A90-FDL-PP-DI-00005
SHEET / OF	1/3
REV.	00



TAG
005-1-J4
FLANGE TIGHTENED
ID STAMP RGR 3/3
SIGNED
DATE 22/01/2025
RETURN TO SUPERVISOR
TAG
005-1-J4
FLANGE ASSEMBLED
ID STAMP RGR 3/3
SIGNED
DATE 22/01/2025
RETURN TO SUPERVISOR
TAG
005-1-J4
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR


TAG
005 - 1 - J4
FLANGE TIGHTENED
ID STAMP RFH2
SIGNED
DATE 05/03/25
RETURN TO SUPERVISOR
TAG
005 - 1 - J4
FLANGE ASSEMBLED
ID STAMP RFH2
SIGNED
DATE 05/03/25
RETURN TO SUPERVISOR
TAG
005 - 1 - J4
FLANGE BROKEN
ID STAMP RFH2
SIGNED
DATE 05/03/25
RETURN TO SUPERVISOR

ITEM	Tag	005-2-J5	: Joint 005-2-J5			Dwg	123A90-FDL-PP-DI-00005-02
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004325	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	Torque wrench V030390 / RD00261
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	159	48	95	158.8
2	48	159	48	95	158.8
3	48	159	48	95	158.8
4	48	159	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes

4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Lorenzo Novaga	
Date	2025-01-23	2025-01-23	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:59:26.219Z	PROVERLIS Digitaly signed by Lorenzo Novaga 2025-01-23T10:02:00.576Z	

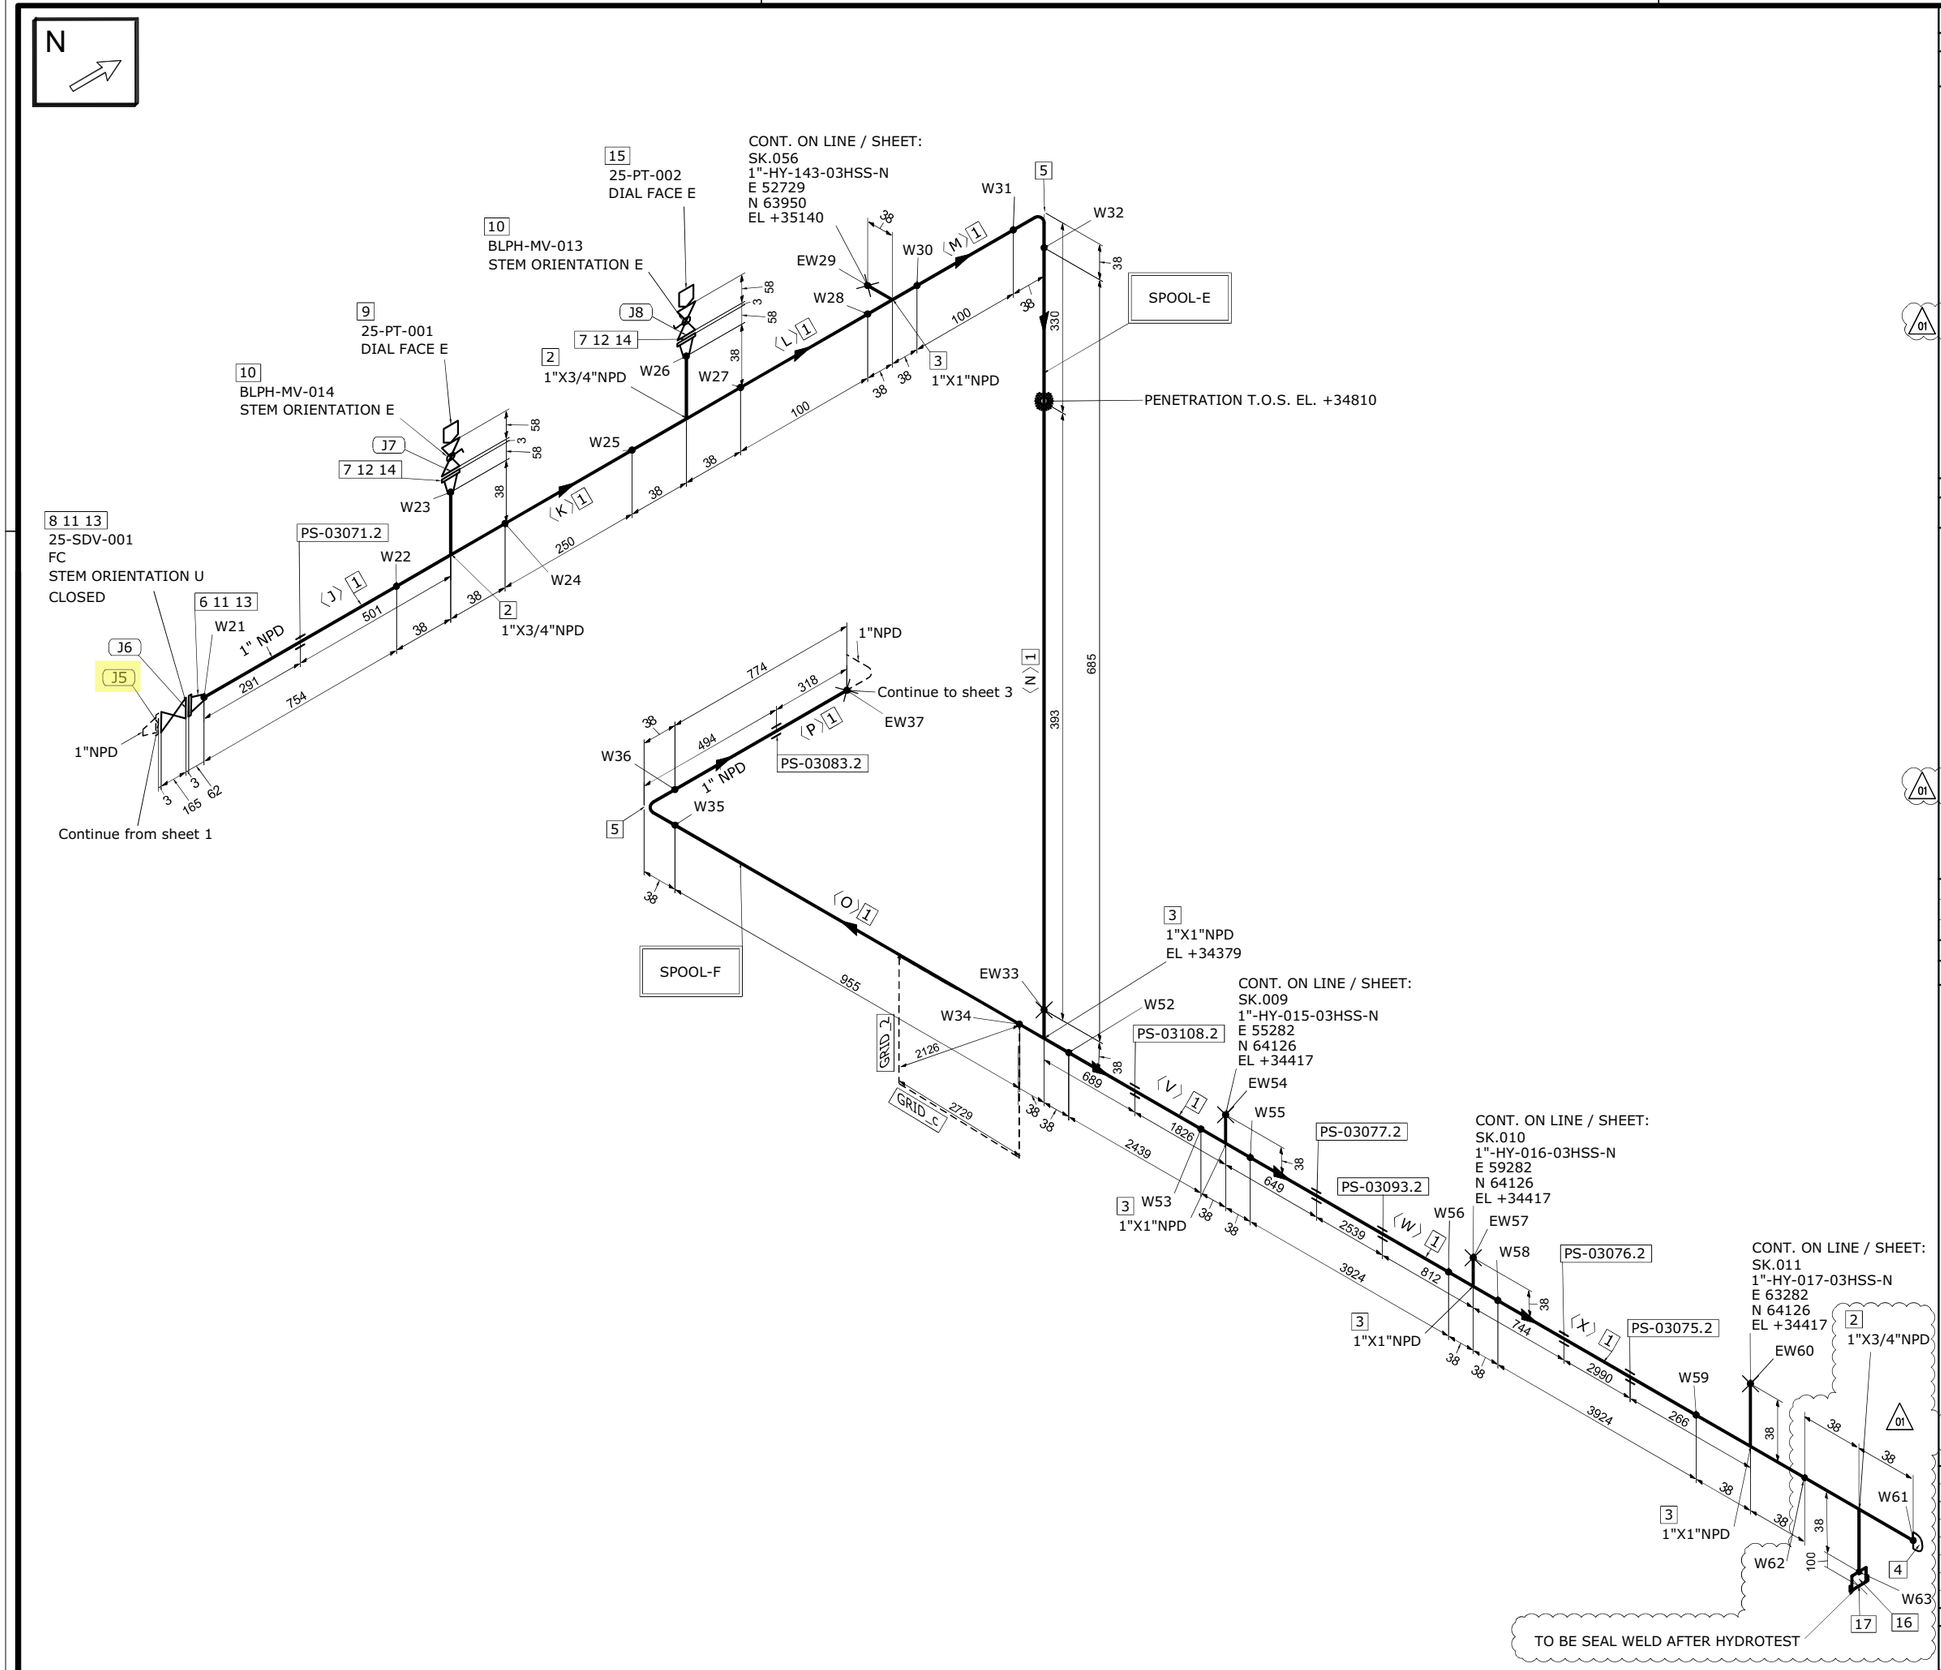

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	13.9M	35.3
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	3 (01)	1.0
3	1X1	TEE0SS00550100	Tee ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	5	1.7
4	1	CAP0SS01030100	Cap ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
5	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	2	0.3
6	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8
7	3/4	FLW0SS01033Q00	Flange WN ASME B16.5 300LB RF 2,87 FRG ASTM A182 Gr.F316/316L	2	2.8
(01) 16	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1/2		Pressure Transmitter - Online	1	0.0
10	3/4X1/2	VLBMNN00013Q0H	Monoflange Double Block & Bleed Valve API 6D FLG x THRD-F NPT 300LB RF MD03C02YH	2	11.6
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	2	0.1
12	3/4	GSW0GK11203Q00	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	2	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	8	1.8
14	5/8	SB20BO07540300	75 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	8	1.8
15	1/2		Pressure Transmitter - Online	1	0.0
(01) 17	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2

FABRICATION WEIGHT [kg]	43.2
ERECTION WEIGHT [kg]	(01) 56.6
OVERALL WEIGHT [kg]	99.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W21	1	BW
W22	1	BW
W23	3/4	BW
W24	1	BW
W25	1	BW
W26	3/4	BW
W27	1	BW
W28	1	BW
EW29	1	BW
W30	1	BW
W31	1	BW
W32	1	BW
EW33	1	BW
W34	1	BW
W35	1	BW
W36	1	BW
EW37	1	BW
W52	1	BW
W53	1	BW
EW54	1	BW
W55	1	BW
W56	1	BW
EW57	1	BW
W58	1	BW
W59	1	BW
EW60	1	BW
W61	1	BW
W62	1	BW
W63	3/4	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
J	1	754	BEVEL	BEVEL
K	1	250	BEVEL	BEVEL
L	1	100	BEVEL	BEVEL
M	1	100	BEVEL	BEVEL
N	1	685	BEVEL	BEVEL
O	1	956	BEVEL	BEVEL
P	1	774	BEVEL	BEVEL
V	1	2439	BEVEL	BEVEL
W	1	3924	BEVEL	BEVEL
X	1	3924	BEVEL	BEVEL

SUPPORT LIST

PS-03071.2
PS-03083.2
PS-03108.2
PS-03077.2
PS-03093.2
PS-03076.2
PS-03075.2

SPOOL	WELD [inches]	WEIGHT [kg]
E	10.5	10.6
F	11.75	32.6
		(01)
MONT	6	56.6

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	03-09-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-007-03HSS-N

SK.005

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A
DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024
FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00005 | SHEET / OF: 2/3 | REV.: 01

LINE DATA


NDT INSPECTION CATEGORY	1	PED CATEGORY	II		
PAINTING	SYSTEM 6A	BASE RAL RAL-9002	FLUID PHASE	Gas	
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]
HEAT TRACING	N/A		TEST	PRESS. 60 [barg]	TEMP. AMB MEDIUM Water

REFERENCE DOCUMENTS

P&ID	123A90-FDL-PR-PID-80011
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES


MASTER

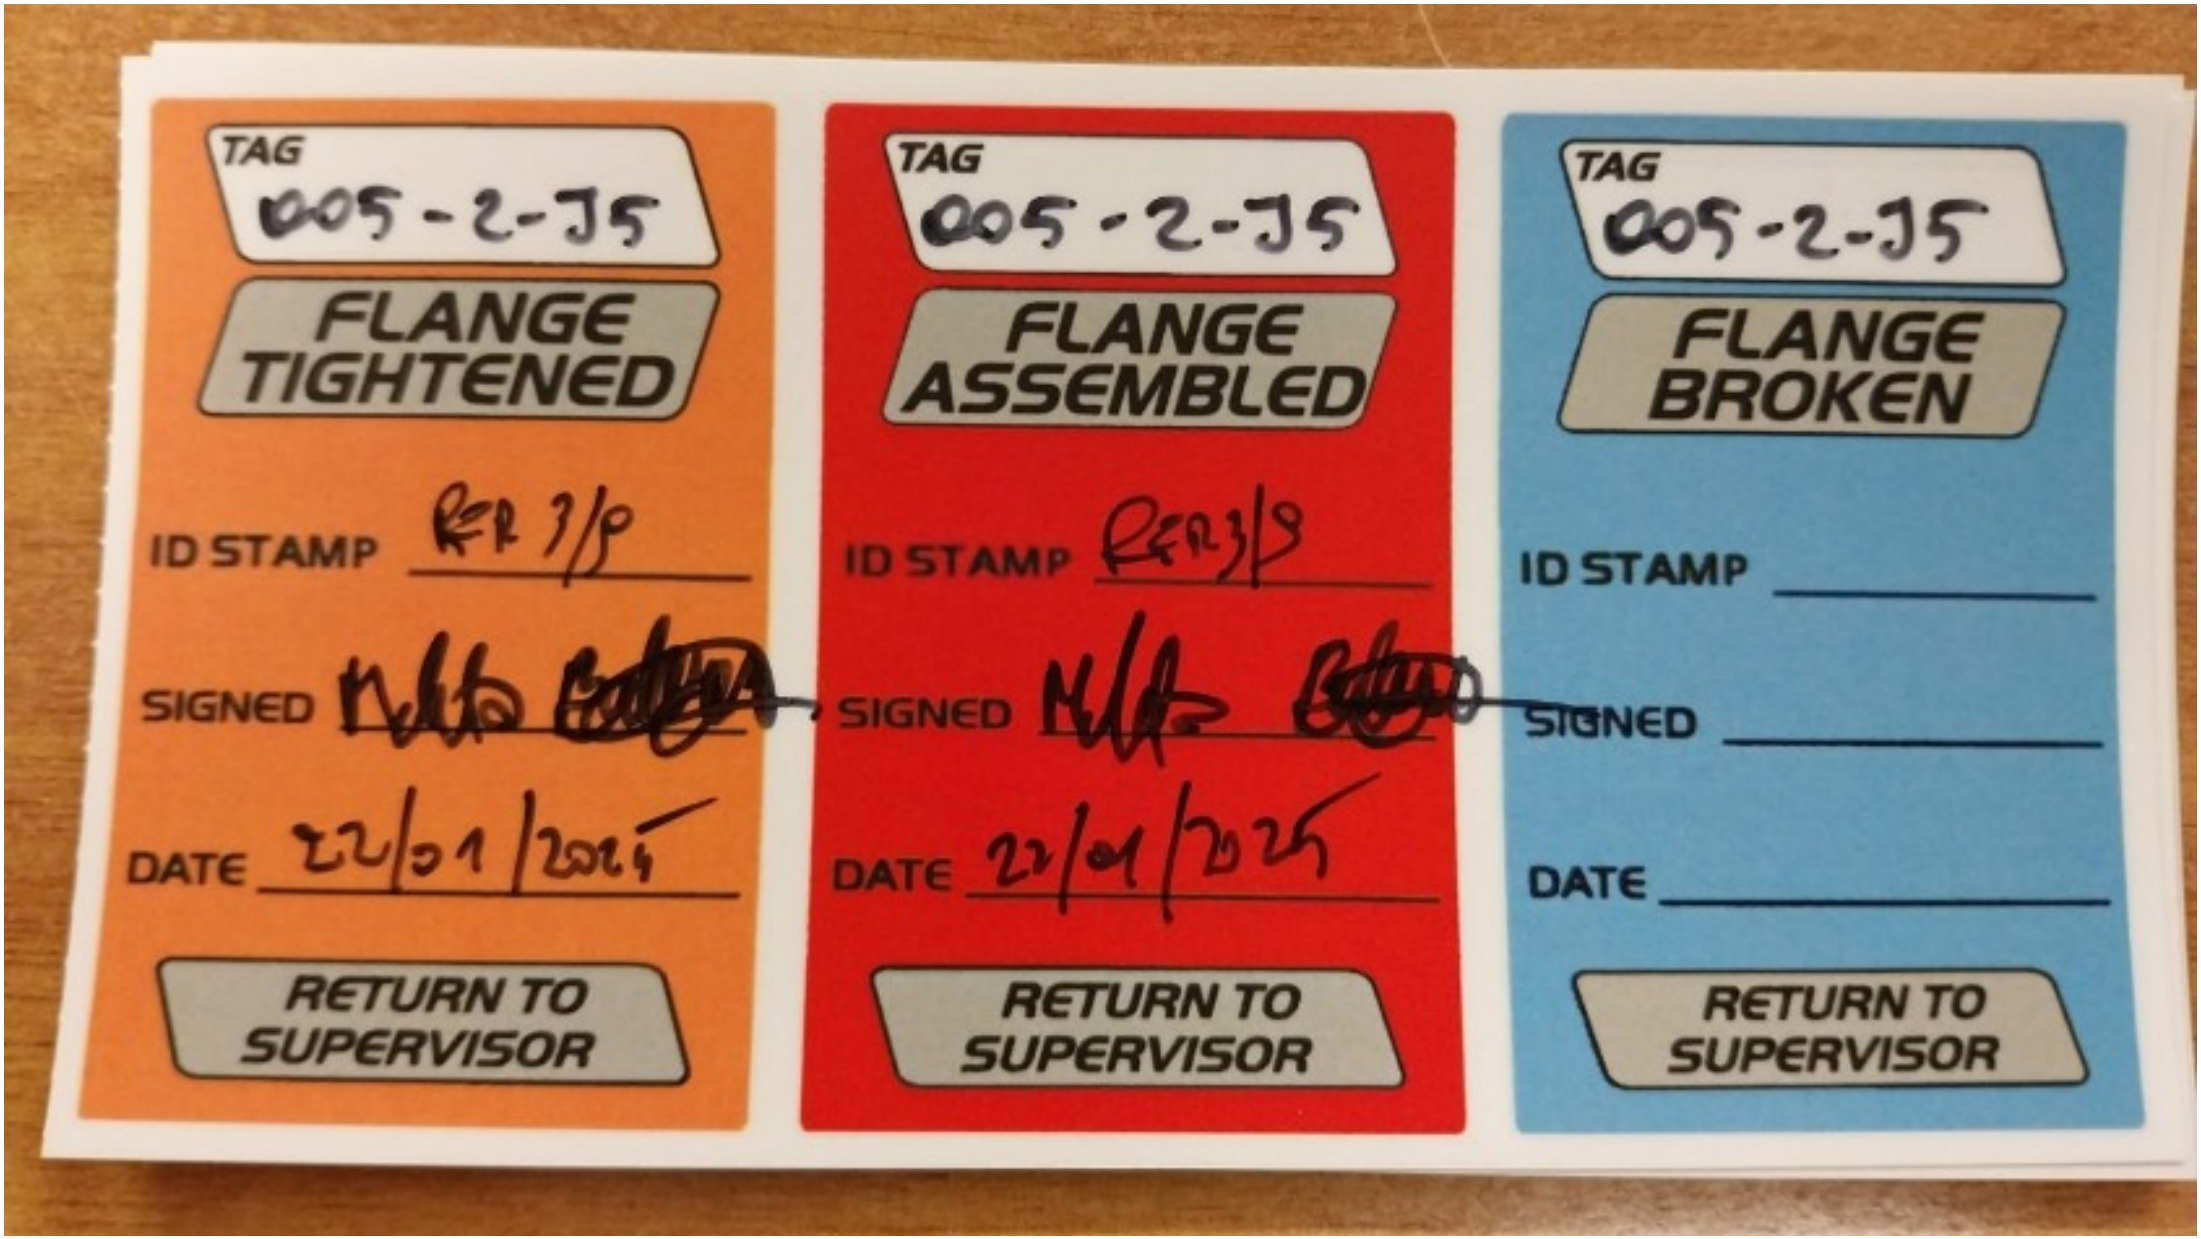
TAG
005-2-J5
FLANGE TIGHTENED
ID STAMP RER 3/5
SIGNED
DATE 22/01/2025
RETURN TO SUPERVISOR
TAG
005-2-J5
FLANGE ASSEMBLED
ID STAMP RER3/5
SIGNED
DATE 22/01/2025
RETURN TO SUPERVISOR
TAG
005-2-J5
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	005-2-J6	: Joint 005-2-J6			Dwg	123A90-FDL-PP-DI-00005-02
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004326	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	1"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	Torque wrench V030390 / RD00261
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	159	48	95	158.8
2	48	159	48	95	158.8
3	48	159	48	95	158.8
4	48	159	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes

4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Lorenzo Novaga	
Date	2025-01-23	2025-01-23	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T05:59:37.450Z	PROVERLIS Digitaly signed by Lorenzo Novaga 2025-01-23T10:01:52.372Z	

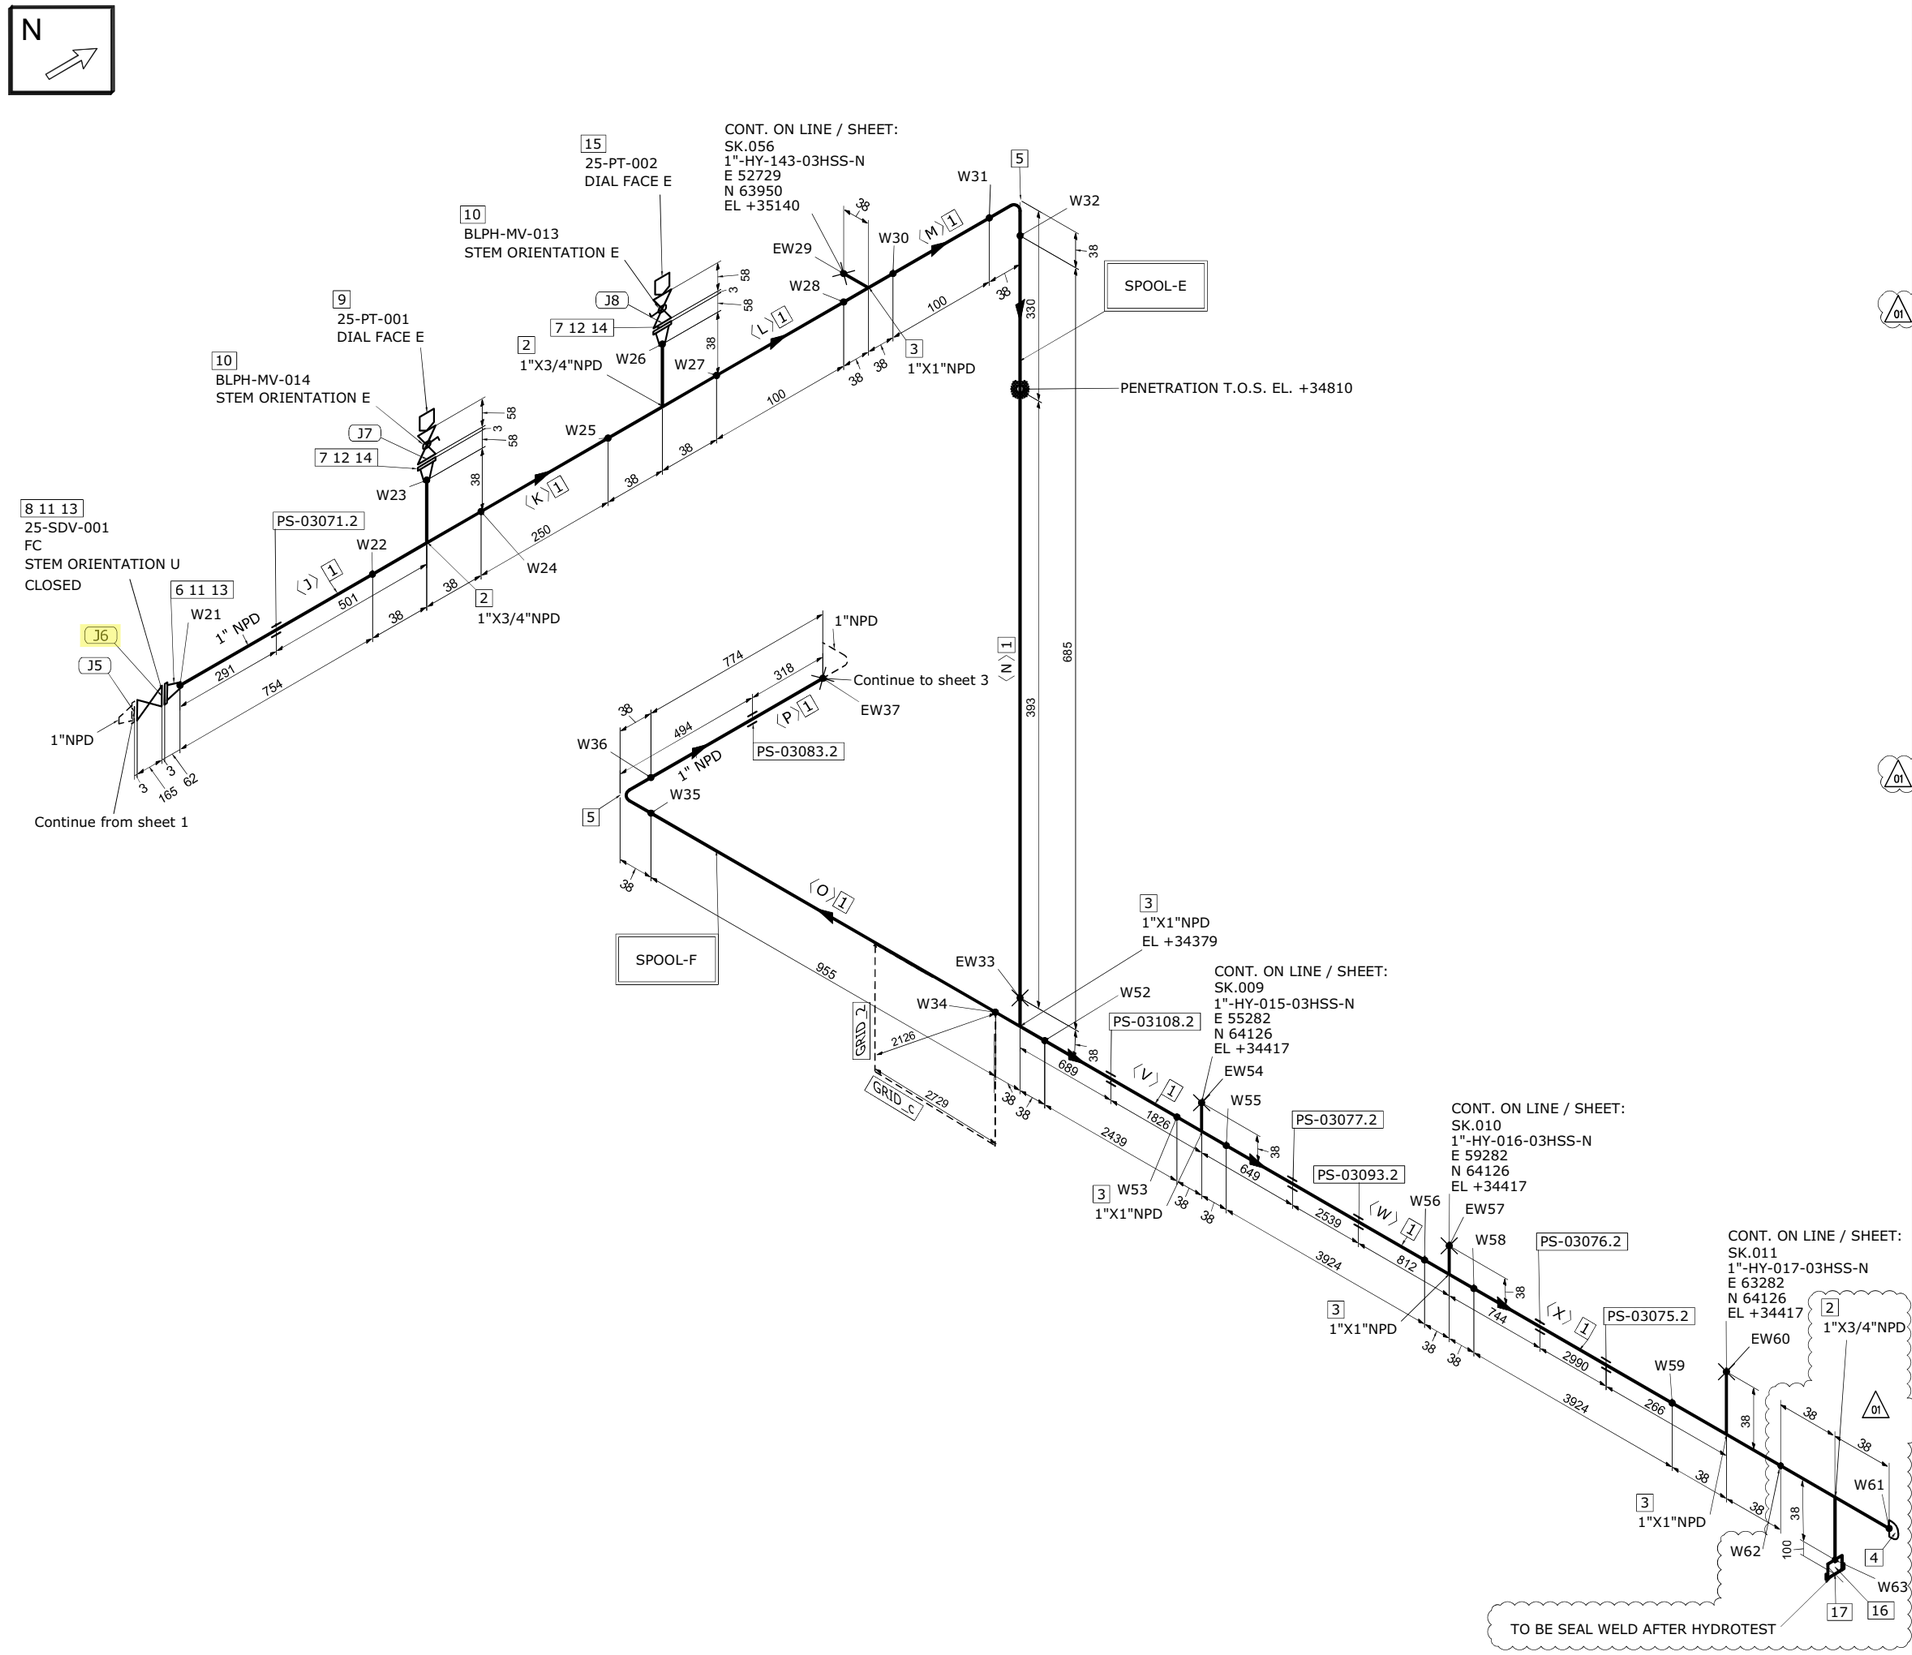

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	13.9M	35.3
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	3	1.0
3	1X1	TEE0SS00550100	Tee ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	5	1.7
4	1	CAP0SS01030100	Cap ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
5	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	2	0.3
6	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8
7	3/4	FLW0SS01033Q00	Flange WN ASME B16.5 300LB RF 2,87 FRG ASTM A182 Gr.F316/316L	2	2.8
01 16	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1/2		Pressure Transmitter - Online	1	0.0
10	3/4X1/2	VLBMNN00013Q0H	Monoflange Double Block & Bleed Valve API 6D FLG x THRD-F NPT 300LB RF MD03C02YH	2	11.6
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	2	0.1
12	3/4	GSW0GK11203Q00	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	2	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	8	1.8
14	5/8	SB20BO07540300	75 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	8	1.8
15	1/2		Pressure Transmitter - Online	1	0.0
01 17	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2

FABRICATION WEIGHT [kg]	43.2
ERECTION WEIGHT [kg]	56.6
OVERALL WEIGHT [kg]	99.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W21	1	BW
W22	1	BW
W23	3/4	BW
W24	1	BW
W25	1	BW
W26	3/4	BW
W27	1	BW
W28	1	BW
EW29	1	BW
W30	1	BW
W31	1	BW
W32	1	BW
EW33	1	BW
W34	1	BW
W35	1	BW
W36	1	BW
EW37	1	BW
W52	1	BW
W53	1	BW
EW54	1	BW
W55	1	BW
W56	1	BW
EW57	1	BW
W58	1	BW
W59	1	BW
EW60	1	BW
W61	1	BW
W62	1	BW
W63	3/4	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
J	1	754	BEVEL	BEVEL
K	1	250	BEVEL	BEVEL
L	1	100	BEVEL	BEVEL
M	1	100	BEVEL	BEVEL
N	1	685	BEVEL	BEVEL
O	1	956	BEVEL	BEVEL
P	1	774	BEVEL	BEVEL
V	1	2439	BEVEL	BEVEL
W	1	3924	BEVEL	BEVEL
X	1	3924	BEVEL	BEVEL

SUPPORT LIST

PS-03071.2
PS-03083.2
PS-03108.2
PS-03077.2
PS-03093.2
PS-03076.2
PS-03075.2

SPOOL	WELD [inches]	WEIGHT [kg]
E	10.5	10.6
F	11.75	32.6
MONT	6	56.6

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	03-09-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-007-03HSS-N

SK.005

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A
DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024
FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00005 | SHEET / OF: 2/3 | REV.: 01

LINE DATA


NDT INSPECTION CATEGORY	1	PED CATEGORY	II		
PAINTING	SYSTEM 6A	BASE RAL RAL-9002	FLUID PHASE	Gas	
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]
HEAT TRACING	N/A		TEST	PRESS. 60 [barg]	TEMP. AMB MEDIUM Water

REFERENCE DOCUMENTS

P&ID	123A90-FDL-PR-PID-80011
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES


MASTER

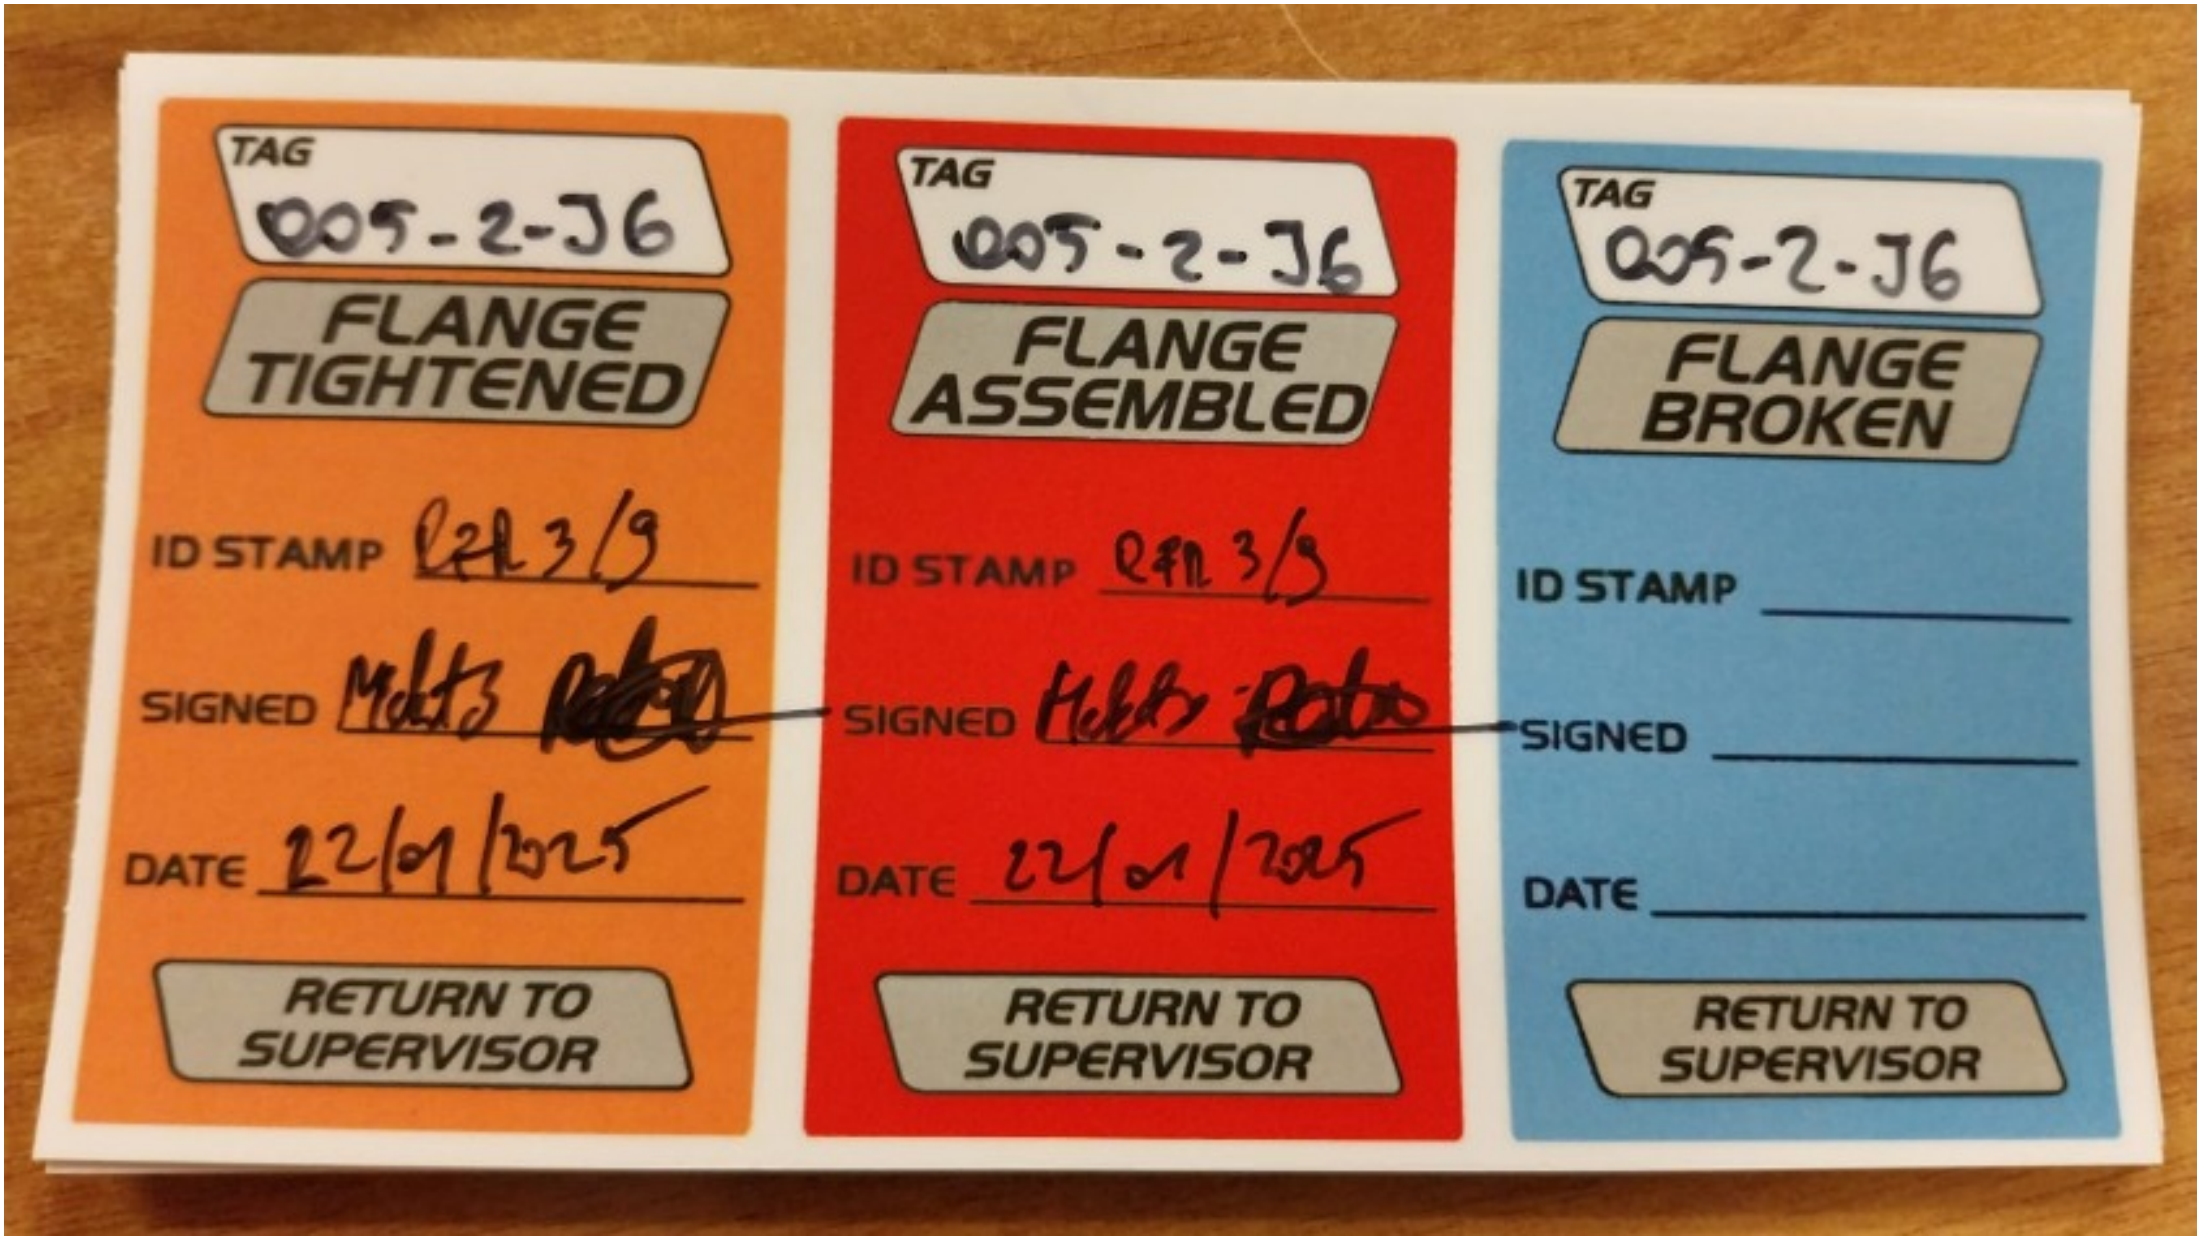
TAG
005-2-J6
FLANGE TIGHTENED
ID STAMP
SIGNED
DATE 22/01/2025
RETURN TO SUPERVISOR
TAG
005-2-J6
FLANGE ASSEMBLED
ID STAMP
SIGNED
DATE 22/01/2025
RETURN TO SUPERVISOR
TAG
005-2-J6
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR

ITEM	Tag	005-2-J7	: Joint 005-2-J7			Dwg	123A90-FDL-PP-DI-00005-02
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004327		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27		Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	3/4"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	Torque wrench T064079 / RA00598
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes

4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Massimo Bruschi	
Date	2025-01-23	2025-02-03	
Signature	Digitaly signed by Emanuele Delfino 2025-01-23T05:59:51.137Z	Digitaly signed by Massimo Bruschi 2025-02-03T16:41:21.905Z	

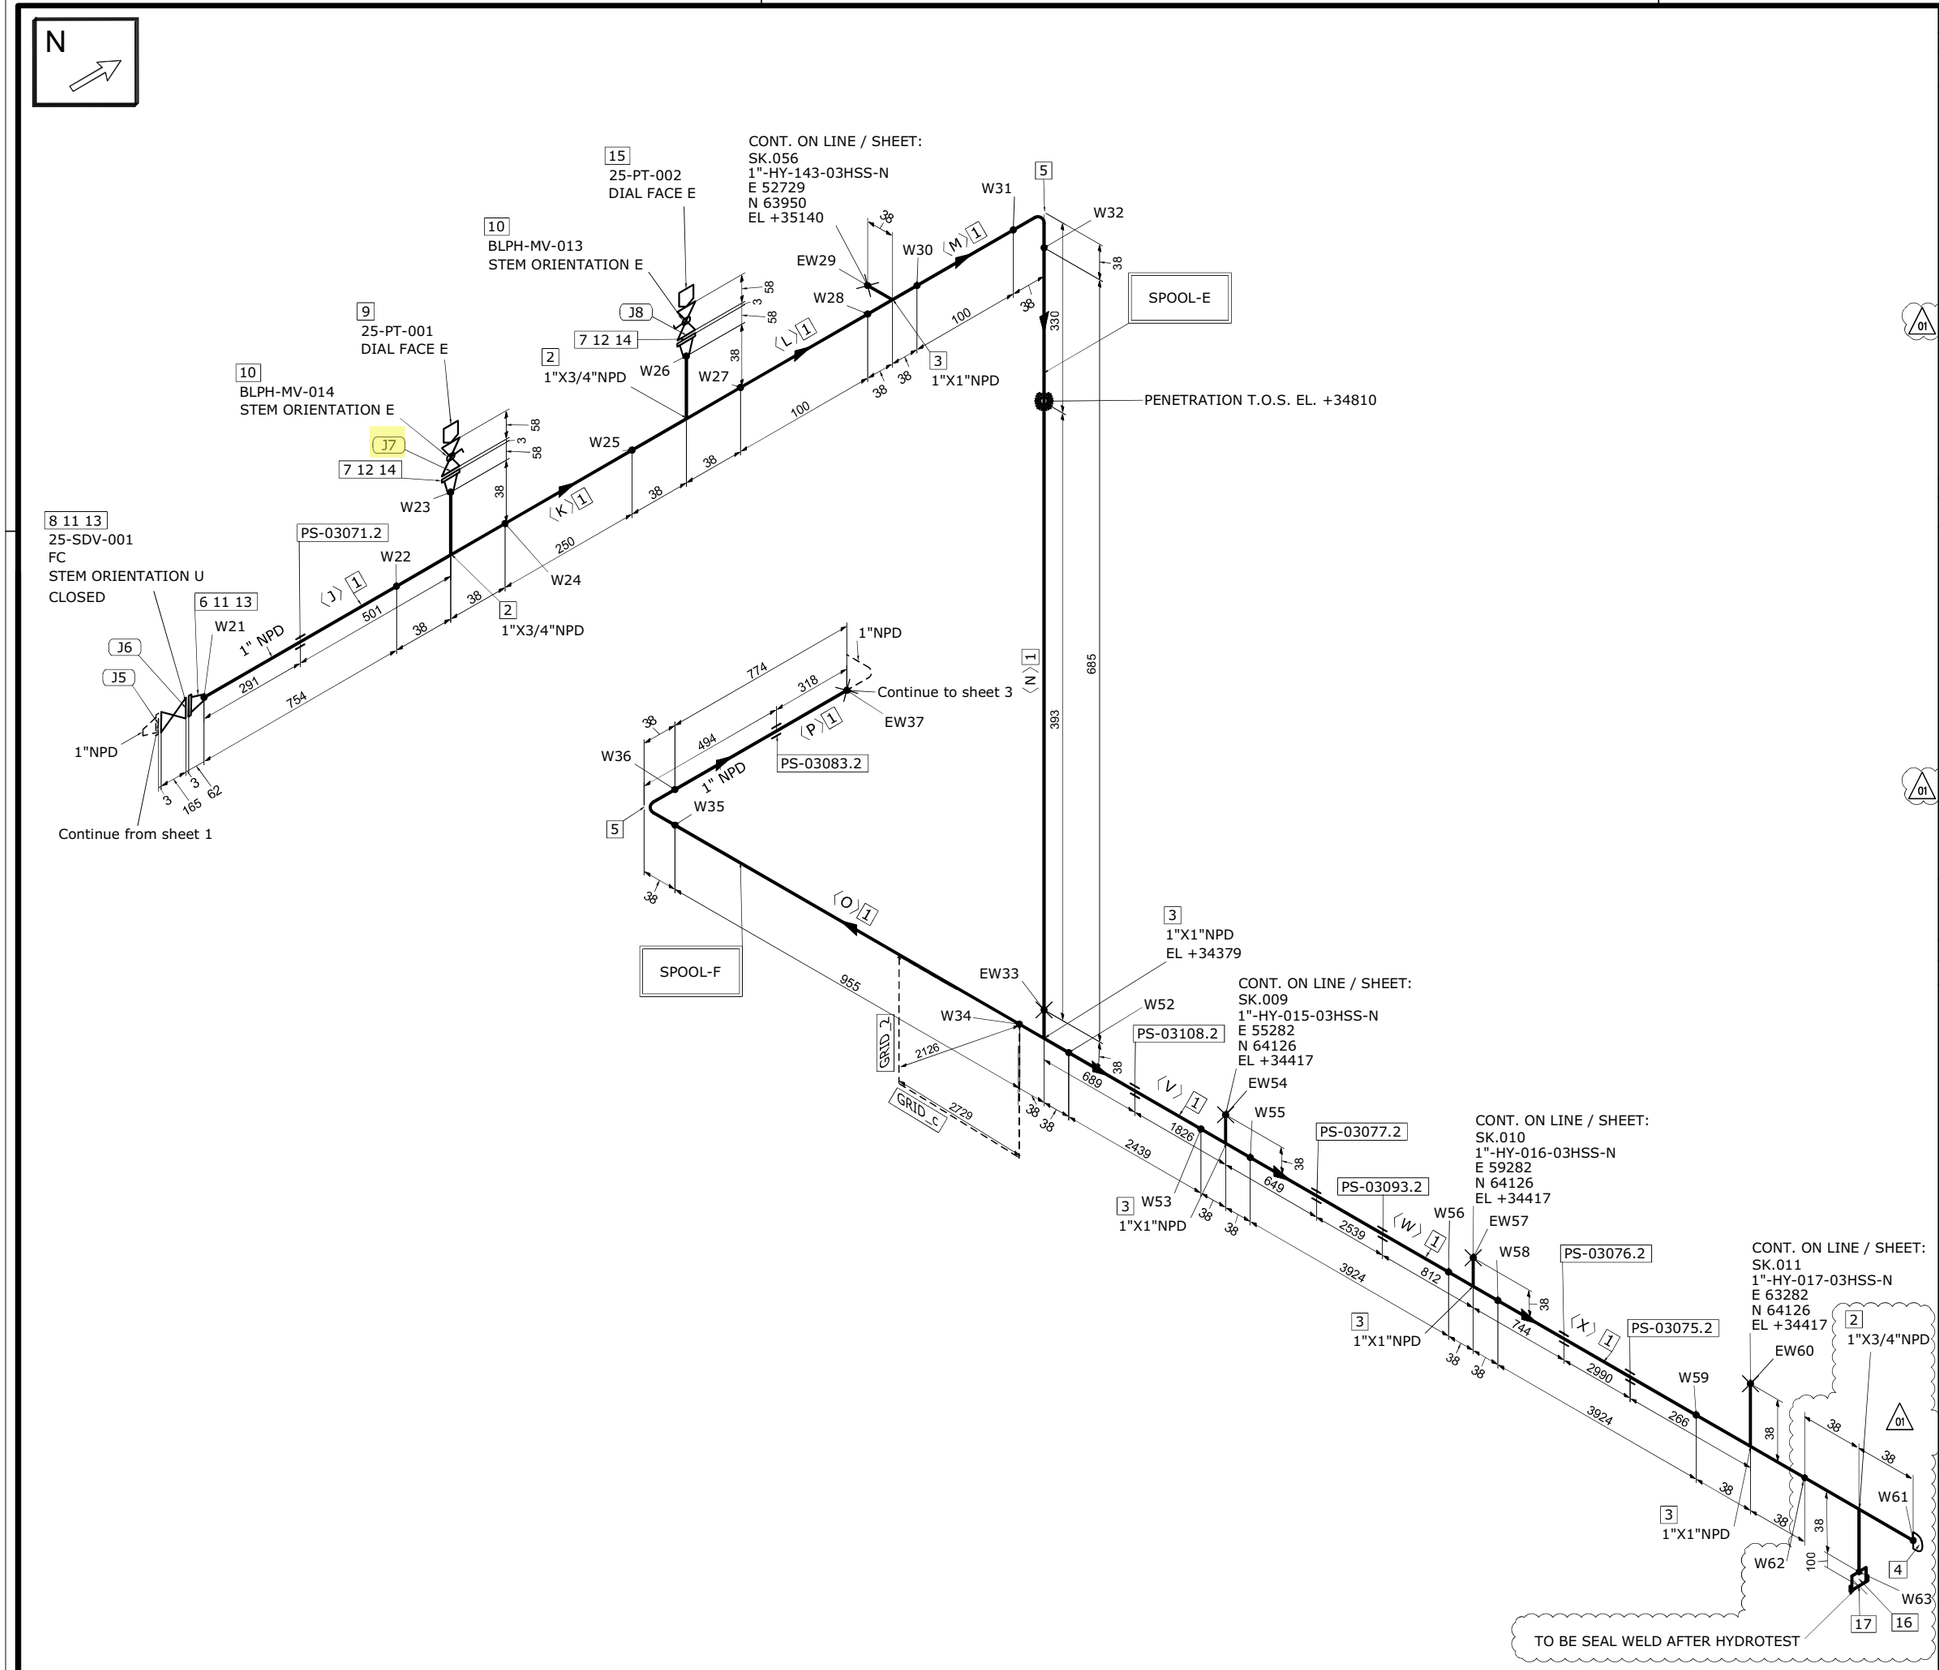

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	13.9M	35.3
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	3	1.0
3	1X1	TEE0SS00550100	Tee ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	5	1.7
4	1	CAP0SS01030100	Cap ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
5	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	2	0.3
6	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8
7	3/4	FLW0SS01033Q00	Flange WN ASME B16.5 300LB RF 2,87 FRG ASTM A182 Gr.F316/316L	2	2.8
01 16	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1/2		Pressure Transmitter - Online	1	0.0
10	3/4X1/2	VLBMNN00013Q0H	Monoflange Double Block & Bleed Valve API 6D FLG x THRD-F NPT 300LB RF MD03C02YH	2	11.6
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	2	0.1
12	3/4	GSW0GK11203Q00	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	2	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	8	1.8
14	5/8	SB20BO07540300	75 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	8	1.8
15	1/2		Pressure Transmitter - Online	1	0.0
01 17	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2

FABRICATION WEIGHT [kg]	43.2
ERECTION WEIGHT [kg]	56.6
OVERALL WEIGHT [kg]	99.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W21	1	BW
W22	1	BW
W23	3/4	BW
W24	1	BW
W25	1	BW
W26	3/4	BW
W27	1	BW
W28	1	BW
EW29	1	BW
W30	1	BW
W31	1	BW
W32	1	BW
EW33	1	BW
W34	1	BW
W35	1	BW
W36	1	BW
EW37	1	BW
W52	1	BW
W53	1	BW
EW54	1	BW
W55	1	BW
W56	1	BW
EW57	1	BW
W58	1	BW
W59	1	BW
EW60	1	BW
W61	1	BW
W62	1	BW
W63	3/4	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
J	1	754	BEVEL	BEVEL
K	1	250	BEVEL	BEVEL
L	1	100	BEVEL	BEVEL
M	1	100	BEVEL	BEVEL
N	1	685	BEVEL	BEVEL
O	1	956	BEVEL	BEVEL
P	1	774	BEVEL	BEVEL
V	1	2439	BEVEL	BEVEL
W	1	3924	BEVEL	BEVEL
X	1	3924	BEVEL	BEVEL

SUPPORT LIST

PS-03071.2
PS-03083.2
PS-03108.2
PS-03077.2
PS-03093.2
PS-03076.2
PS-03075.2

SPOOL	WELD [inches]	WEIGHT [kg]
E	10.5	10.6
F	11.75	32.6
MONT	6	56.6

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	03-09-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-007-03HSS-N

SK.005

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A
DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024
FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00005 | SHEET / OF: 2/3 | REV.: 01

LINE DATA


NDT INSPECTION CATEGORY	1	PED CATEGORY	II		
PAINTING	SYSTEM 6A	BASE RAL RAL-9002	FLUID PHASE	Gas	
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]
HEAT TRACING	N/A		TEST	PRESS. 60 [barg]	TEMP. AMB MEDIUM Water

REFERENCE DOCUMENTS

P&ID	123A90-FDL-PR-PID-80011
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

MASTER

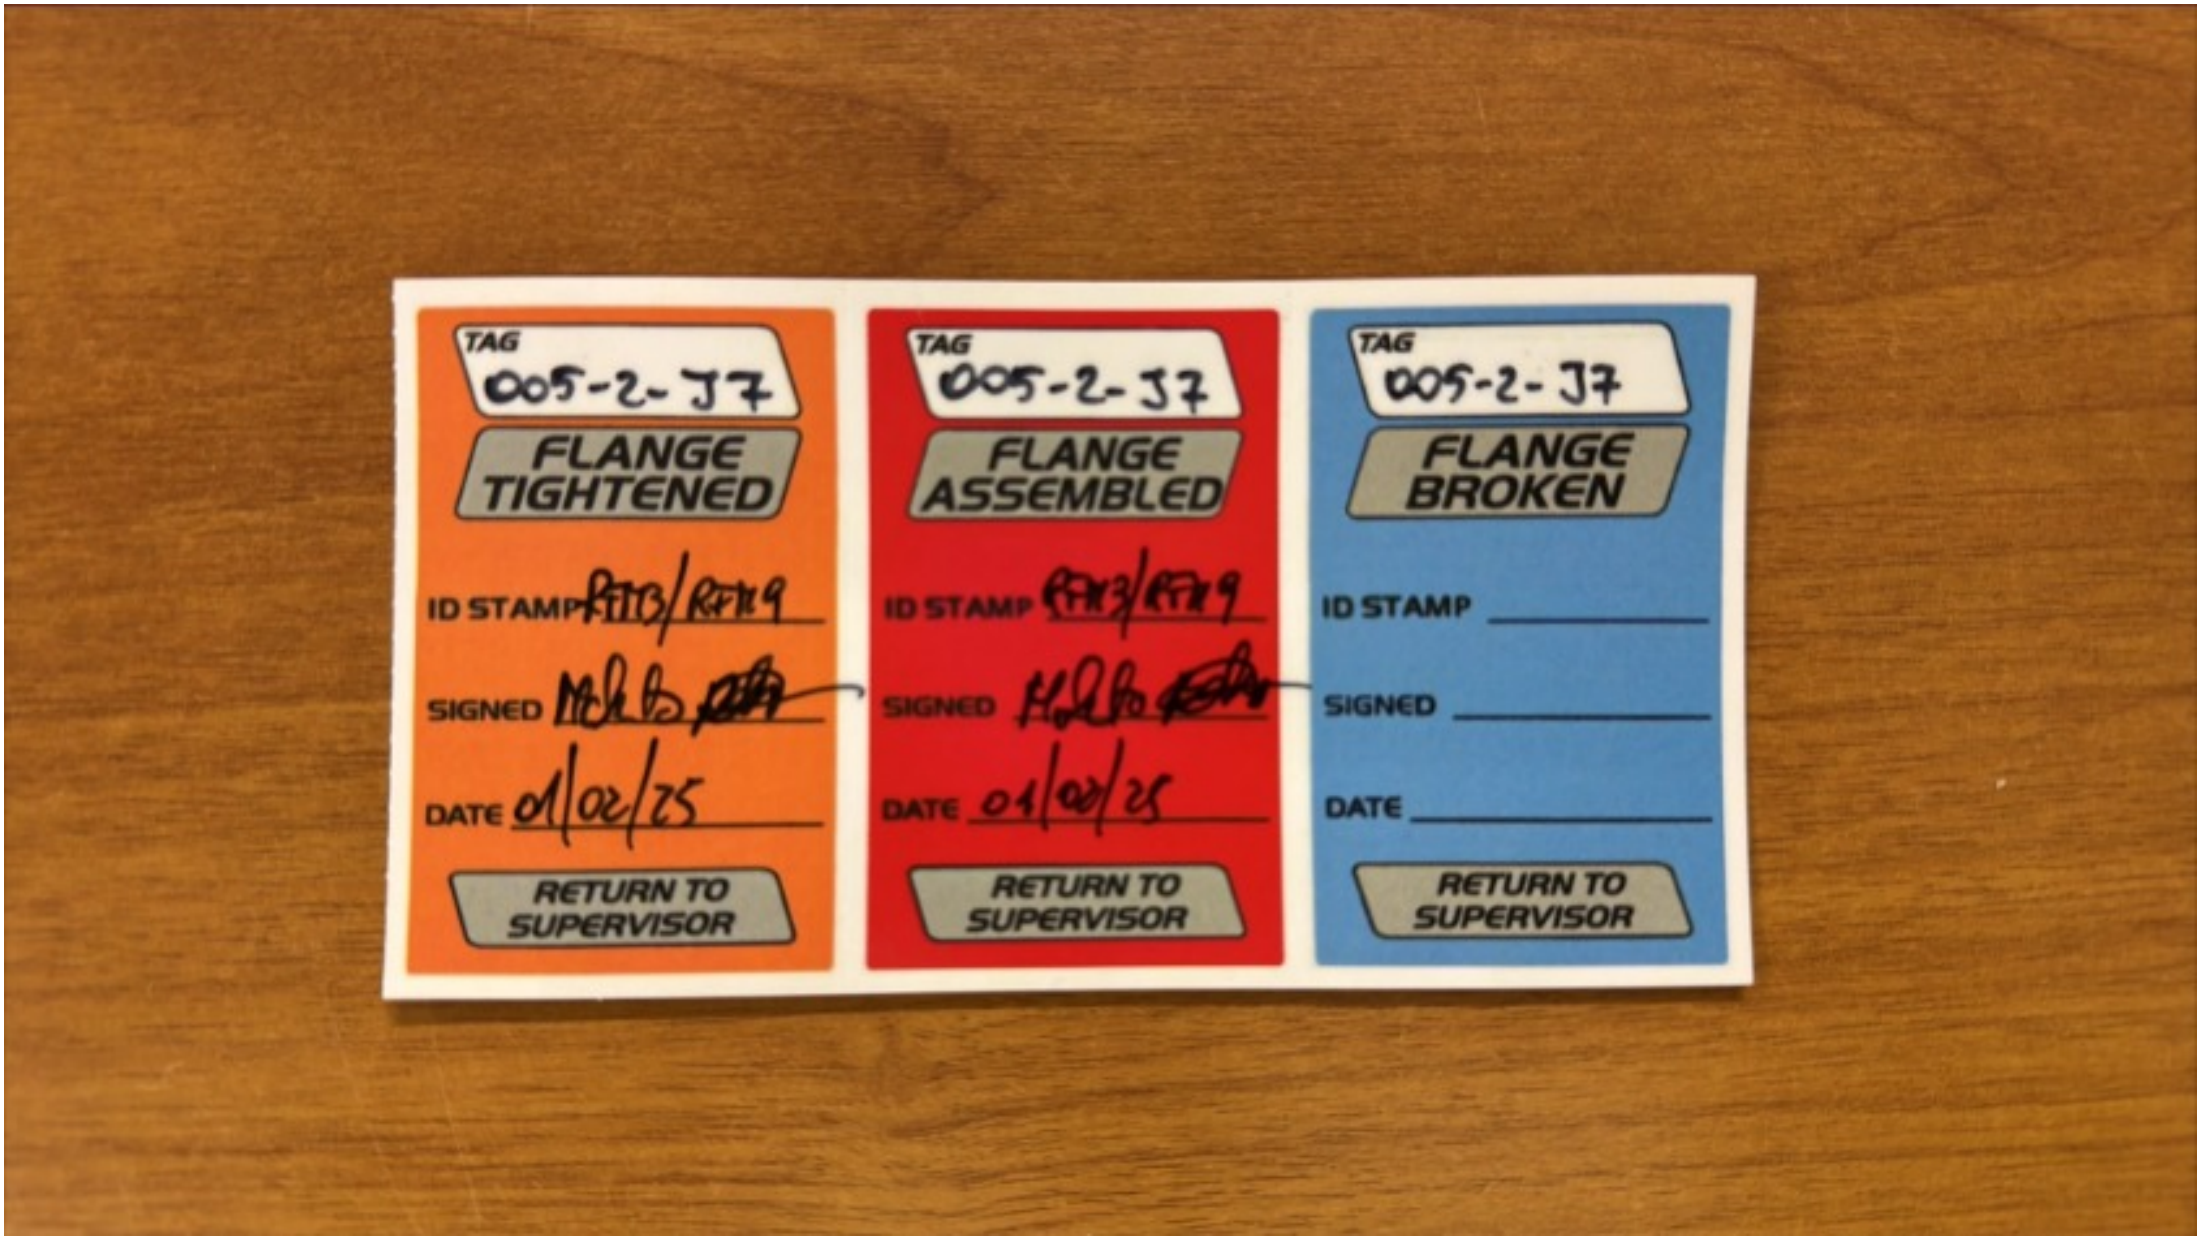

TAG
005-2-J7
FLANGE TIGHTENED
ID STAMP RFH3/RFH9
SIGNED
DATE 01/02/25
RETURN TO SUPERVISOR
TAG
005-2-J7
FLANGE ASSEMBLED
ID STAMP RFH3/RFH9
SIGNED
DATE 01/02/25
RETURN TO SUPERVISOR
TAG
005-2-J7
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR


TAG
005 - 2 - J7
FLANGE TIGHTENED
ID STAMP RTH2
SIGNED
DATE 05/03/25
RETURN TO SUPERVISOR
TAG
005 - 2 - J7
FLANGE ASSEMBLED
ID STAMP RTH2
SIGNED
DATE 05/03/25
RETURN TO SUPERVISOR
TAG
005 - 2 - J7
FLANGE BROKEN
ID STAMP RTH2
SIGNED
DATE 05/03/25
RETURN TO SUPERVISOR

ITEM	Tag	005-2-J8	: Joint 005-2-J8			Dwg	123A90-FDL-PP-DI-00005-02
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004328	Location	Onshore Activities		User	Rosetti Marino Quality Control
FORM	Process	MC	Activity PIP	Discipline	Piping	Form	TMX27 Bolt tensioning / torquing

Test Pack N.: TP-007

EQUIPMENT TAG



Flange Type	300LB	**Lubricant**	Yes
Flange Size	3/4"	**Lubricant Type**	MOLYKOTE 1000 PASTE
Gasket Type	Gasket Spiral Wound Thk. 3.2 mm	**Used tools**	Torque wrench T064079 / RA00598
Bolt tensioning/Torquing value	158.8		

			Torque (Design Value)		
Sequence	Pre tension/torque	Final tension/torque	30%	60%	100%
1	48	160	48	95	158.8
2	48	160	48	95	158.8
3	48	160	48	95	158.8
4	48	160	48	95	158.8
5			48	95	158.8
6			48	95	158.8
7			48	95	158.8
8			48	95	158.8
9			48	95	158.8
10			48	95	158.8
11			48	95	158.8
12			48	95	158.8
13			48	95	158.8
14			48	95	158.8
15			48	95	158.8
16			48	95	158.8
17			48	95	158.8
18			48	95	158.8
19			48	95	158.8
20			48	95	158.8

1 **Clear Bore Inspection:** Pipe and Valve clear of debris/contamination. Yes


2 **Flange Face Check:** Both flanges clean and free from damage. Yes

3 **Gaskets and Bolts:** Gaskets and Bolts checked for correctness to specification, any damage and for correct length technique. Yes

4 **Alignment:** Check alignment according to code. Yes

Comments:

Page 1/1	Performed by	☑ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM(ROSETTI MARINO)	
Name	Emanuele Delfino	Massimo Bruschi	
Date	2025-01-23	2025-02-03	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-23T06:00:02.195Z	PROVERLIS Digitaly signed by Massimo Bruschi 2025-02-03T16:41:31.048Z	

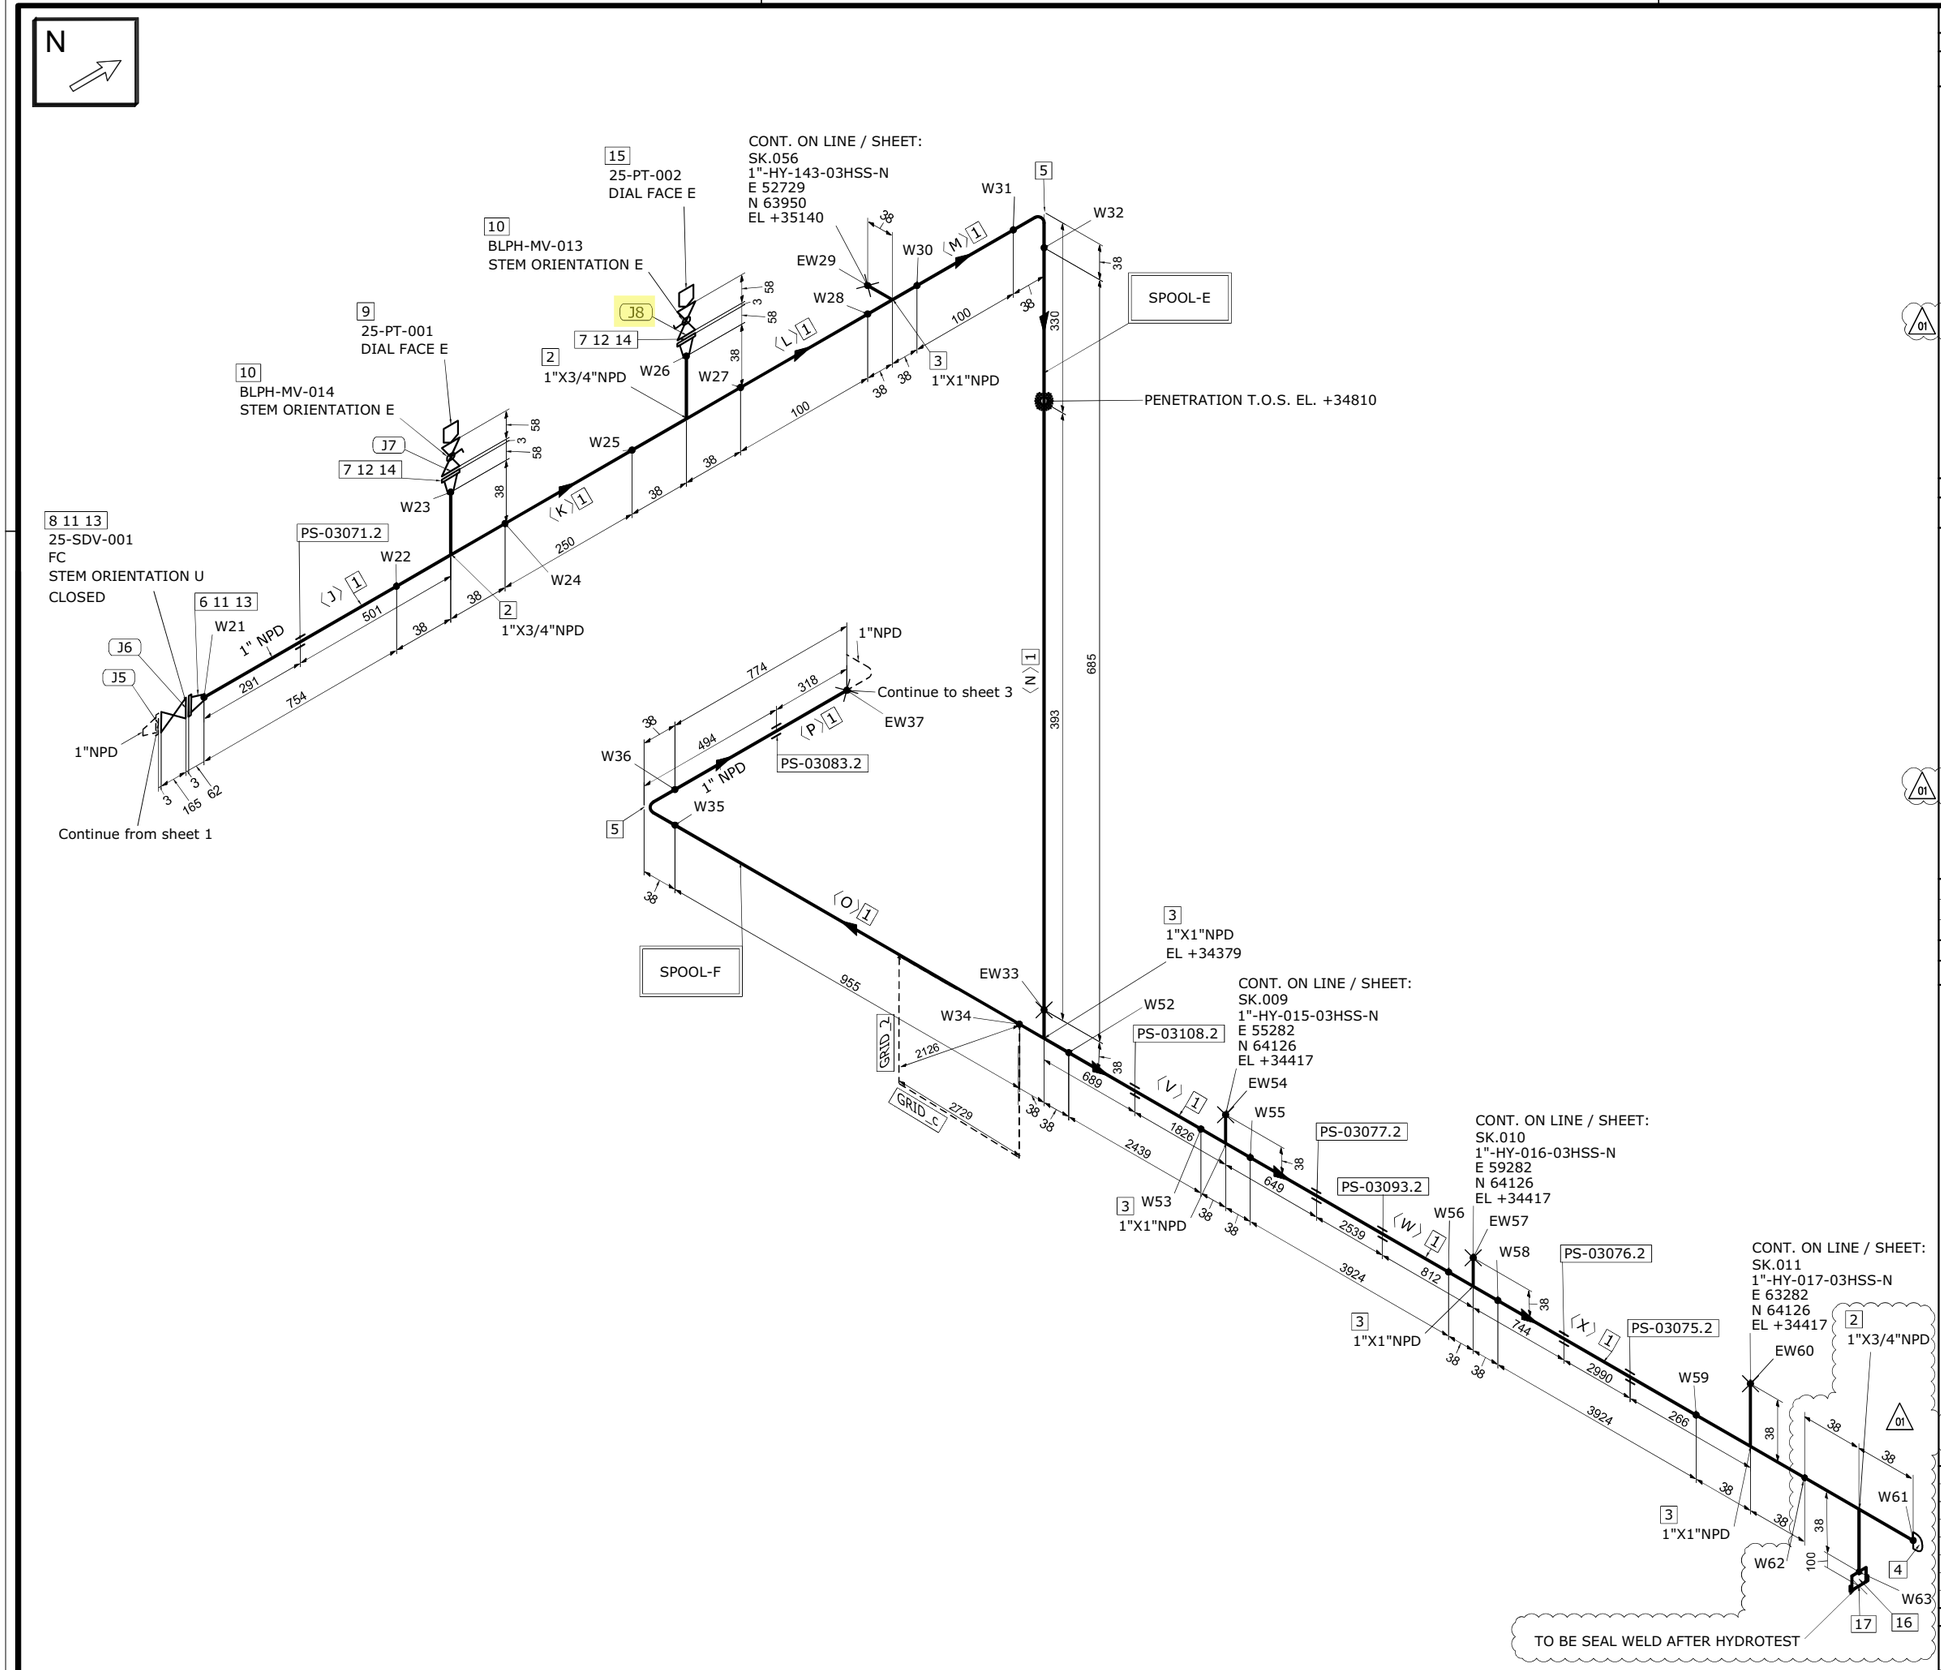

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	13.9M	35.3
2	1X3/4	TER0SS0171013Q	Tee Reducing ASME B16.9 BW 3,38x2,87 WRS ASTM A403 Gr.WP316/316L	3	1.0
3	1X1	TEE0SS00550100	Tee ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	5	1.7
4	1	CAP0SS01030100	Cap ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.1
5	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	2	0.3
6	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	1	1.8
7	3/4	FLW0SS01033Q00	Flange WN ASME B16.5 300LB RF 2,87 FRG ASTM A182 Gr.F316/316L	2	2.8
01 16	3/4	N100SS02653Q00	Nipple L=100mm ASME B36.19M THRD-M NPT x PE 2,87 SML ASTM A312 Gr.TP316/316L	1	0.2

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
8	1		ON/OFF Ball Actuator Valve - 300#RF Flanged	1	41.0
9	1/2		Pressure Transmitter - Online	1	0.0
10	3/4X1/2	VLBMNN00013Q0H	Monoflange Double Block & Bleed Valve API 6D FLG x THRD-F NPT 300LB RF MD03C02YH	2	11.6
11	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	2	0.1
12	3/4	GSW0GK11203Q00	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	2	0.1
13	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	8	1.8
14	5/8	SB20BO07540300	75 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	8	1.8
15	1/2		Pressure Transmitter - Online	1	0.0
01 17	3/4	CAPFSS00023Q00	Cap Forged ASME B16.11 THRD-F NPT 3000# FRG ASTM A182 Gr.F316/316L	1	0.2

FABRICATION WEIGHT [kg]	43.2
ERECTION WEIGHT [kg]	56.6
OVERALL WEIGHT [kg]	99.8

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
W21	1	BW
W22	1	BW
W23	3/4	BW
W24	1	BW
W25	1	BW
W26	3/4	BW
W27	1	BW
W28	1	BW
EW29	1	BW
W30	1	BW
W31	1	BW
W32	1	BW
EW33	1	BW
W34	1	BW
W35	1	BW
W36	1	BW
EW37	1	BW
W52	1	BW
W53	1	BW
EW54	1	BW
W55	1	BW
W56	1	BW
EW57	1	BW
W58	1	BW
W59	1	BW
EW60	1	BW
W61	1	BW
W62	1	BW
W63	3/4	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
J	1	754	BEVEL	BEVEL
K	1	250	BEVEL	BEVEL
L	1	100	BEVEL	BEVEL
M	1	100	BEVEL	BEVEL
N	1	685	BEVEL	BEVEL
O	1	956	BEVEL	BEVEL
P	1	774	BEVEL	BEVEL
V	1	2439	BEVEL	BEVEL
W	1	3924	BEVEL	BEVEL
X	1	3924	BEVEL	BEVEL

SUPPORT LIST

PS-03071.2
PS-03083.2
PS-03108.2
PS-03077.2
PS-03093.2
PS-03076.2
PS-03075.2

SPOOL	WELD [inches]	WEIGHT [kg]
E	10.5	10.6
F	11.75	32.6
MONT	6	56.6

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	17-09-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	03-09-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE
SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-007-03HSS-N

SK.005

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A
DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM | DATE: 17-09-2024
FORMAT: A3 | DRAWING NO.: 123A90-FDL-PP-DI-00005 | SHEET / OF: 2/3 | REV.: 01

LINE DATA


NDT INSPECTION CATEGORY	1	PED CATEGORY	II		
PAINTING	SYSTEM 6A	BASE RAL RAL-9002	FLUID PHASE	Gas	
INSULATION	TYPE N	THICKNESS [mm]	DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]
HEAT TRACING	N/A		TEST	PRESS. 60 [barg]	TEMP. AMB MEDIUM Water

REFERENCE DOCUMENTS

P&ID	123A90-FDL-PR-PID-80011
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

MASTER

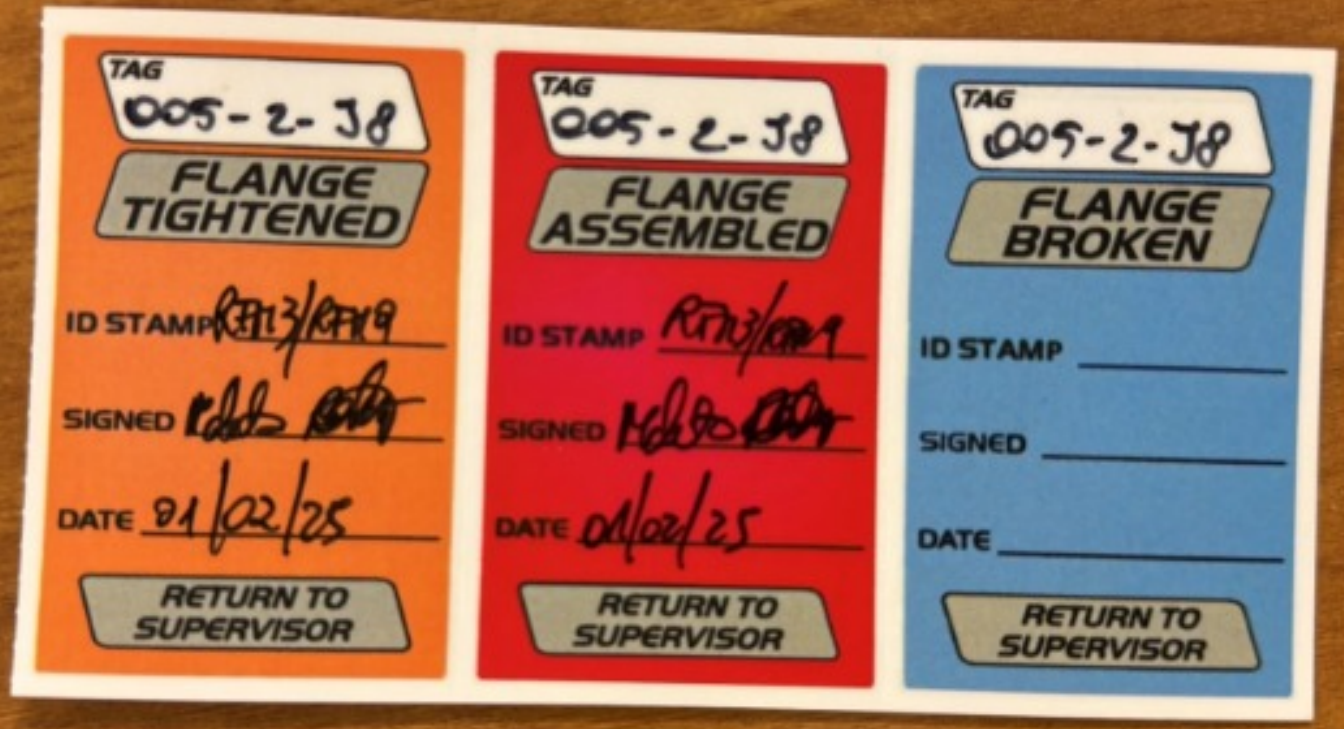
TAG
005-2-J8
FLANGE TIGHTENED
ID STAMP
SIGNED
DATE 01/02/25
RETURN TO SUPERVISOR
TAG
005-2-J8
FLANGE ASSEMBLED
ID STAMP
SIGNED
DATE 01/02/25
RETURN TO SUPERVISOR
TAG
005-2-J8
FLANGE BROKEN
ID STAMP
SIGNED
DATE
RETURN TO SUPERVISOR


TAG
005 - 2 - J8
FLANGE TIGHTENED
ID STAMP RFM2
SIGNED
DATE 05/03/25
RETURN TO SUPERVISOR
TAG
005 - 2 - J8
FLANGE ASSEMBLED
ID STAMP RFM2
SIGNED
DATE 05/03/25
RETURN TO SUPERVISOR
TAG
005 - 2 - J8
FLANGE BROKEN
ID STAMP RFM2
SIGNED
DATE 05/03/25
RETURN TO SUPERVISOR

ITEM	Tag	25-07-TP-068	: Test Pack 25-07-TP-068		Dwg	123A90-DDL-PR-PID-80011	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10004793	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity PIP	Discipline Piping	Form	CLX02A	Pipework Before Test

1	Check for each line of the Test Pack the NDT clearance.	OK
2	Confirm that materials conforms to the line specifications (ref. to the last issued revision of the isometric material table)	OK
3	Check the installation of all pipe – supports are in accordance with the specifications and drawings.	PL
4	Check that pipework at pump and vessel nozzles are free from spring.	NA
5	Check that the pipe flanges have been mounted square to each other. Also that the bolting and gaskets are correct (all TMX27 are complete, if necessary).	NA
6	Check bolt tightening and flange management (excluded battery limit joints).	NA
7	Check that the flow direction of the valves and check – valve is in the correct sense / direction (ball valves to be set at half open).	NA
8	Check that the removed equipment is in accordance with the agreed list of fragile devices. Check valve should be removed or flappers locked.	NA
9	Check that spool pieces or other substitution means have been put in place instead of the removed fragile device.	OK
10	Check the Blind list.	OK
11	Check that all the temporary material to perform the task are conforms to the procedure & suitable pressure rating.	OK
12	If required produce Red Line Mark Up for "AS BUILT".	

Comments:

	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM (ROSETTI MARINO)	
Name	Emanuele Delfino	Lorenzo Novaga	
Date	2025-01-24	2025-02-06	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-24T07:11:44.840Z	PROVERLIS Digitaly signed by Lorenzo Novaga 2025-02-06T16:12:19.791Z	

ITEM	Tag	25-07-TP-068	: Test Pack 25-07-TP-068		Dwg	123A90-DDL-PR-PID-80011	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10004794	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity PIP	Discipline Piping	Form	CLX02B	Pipework After Test

1	Check that the pipework and equipment are drained as per procedure.	OK
2	Check if all temporary equipment (test spades, filters ,spool pieces..etc) have been removed.	OK
3	All plugs installed on vents and drains for test have been removed.	OK
4	Check that all removed devices and valves have been re-installed.	NA
5	Check that the new gaskets have been installed after pipework and equipment reinstallation.	NA
6	All specific blinds and / or spectacle blinds have been correctly installed as per P&ID.	NA
7	Check that the pipework, valves , check valves are undamaged. Also check the ancillaries and any other components.	NA
8	After the (re) installation of a valve check that it operates freely.	NA
9	Check that the flow direction of the valves and check – valve is in correct sense /direction in correct open/closed position as per P&ID.	NA
10	Check all locking device.	NA
11	Check that the valves have been correctly lubricated and that they have the correct spindle packing.	NA
12	Check that all the bolts and fasteners are suitably lubricated inline with the flange management procedure.	NA
13	Check that the bolts have been tightned at opened joints.	NA
14	Check that all golden welds (final tie-ins without hydrotest) have been performed as per procedure.	OK
15	Check for the correct tagging, labeling and colour coding of pipework and equipment (only for bare pipe lines).	NA
16	Check that the pipework and equipment (re) installation conforms to the specifications, drawings and to the P&ID's.	PL
17	If required produce Red Line Mark Up for "AS BUILT".	

Comments:

	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM (ROSETTI MARINO)	
Name	Emanuele Delfino	Lorenzo Novaga	
Date	2025-02-07	2025-02-25	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-02-07T13:26:36.087Z	PROVERLIS Digitaly signed by Lorenzo Novaga 2025-02-25T07:44:47.465Z	

ITEM	Tag	25-07-TP-068	: Test Pack 25-07-TP-068			Dwg	123A90-DDL-PR-PID-80011
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004795		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity CCK	Discipline	Piping	Form	CXX02 Painting Line

1	Check that the completed painting is in accordance with the specifications covering quality and thickness.	OK
2	Check that the color coding conforms to the specifications.	PL
3	Check that the fluid direction is correct.	PL
4	Check that line marking is correct.	NA
5	Check that the painting of piping systems and of the equipment is "touched-up" and conforms to the specifications.	OK
6	If required produce Red Line Mark Up for "AS BUILT".	

Comments: 1. Checked the painting report made by Vendor and signed by RM coating Dpt.

	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	IMPRESA DONELLI	RM (Rosetti Marino)	
Name	Alex Sanna	Kangi Albonetti	
Date	2025-02-11	2025-02-27	
Signature	PROVERLIS Digitaly signed by Alex Sanna 2025-02-11T07:37:54.575Z	PROVERLIS Digitaly signed by Kangi Albonetti 2025-02-27T15:43:26.046Z	

ITEM	Tag	25-07-TP-068	: Test Pack 25-07-TP-068		Dwg	123A90-DDL-PR-PID-80011	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10004796	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity PIP	Discipline Piping	Form	TMX03	Cleaning

CLEANING MEDIUM

Air		Water	●	Steam		Oil		Other		Mechanical	

Component	NA					
Chemical treatment	No	NA	Filtration	No	Screen size	NA

EQUIPMENTS

Equipment **removed**	Yes	Agreed list of removed fragile devices to be attached to this Test Sheet	NA
Excepted removed equipments, pipework installation is conform to the specifications & PID's			OK
Equipment **added**	No	Exhaustive list to be attached (temporary filters, spools…etc)	NA

TEST RESULTS

Test date	01/02/2025	Start time	09:00	End time	09:05
Flow rate	NA	Duration	5 min	Medium T°	NA

Operation Description

Connected the water source to the lowest point of the piping system.
Maintained a high flow rate to help dislodging and carry away debrises.
Flushing flow kept until the water exiting the system was clear and free of visible contaminants. Expelled water inspected for any debris to be noted.

Safety Precautions

Restricting access to the area.

Result and comments

Water has been found clear of solid debris. All contaminants have been expelled.

	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM (ROSETTI MARINO)	
Name	Emanuele Delfino	Lorenzo Novaga	
Date	2025-01-31	2025-02-03	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-31T14:25:12.811Z	PROVERLIS Digitaly signed by Lorenzo Novaga 2025-02-03T08:59:50.810Z	

ROSETTI MARINO | CROSSWIND

ITEM	Tag	25-07-TP-068	: Test Pack 25-07-TP-068		Dwg	123A90-DDL-PR-PID-80011	
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)		Module	UD	
TASK	code	C10004797	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	MC	Activity PIP	Discipline Piping	Form	TMX05	Pressure Test

TEST DATA

Reference procedure	12390-PML-QHSE-PRO-00092				
Design pressure	40 barg	Max test pressure	60 barg	Min hold period	30 min

TEST PREPARATION

Check all equipments used for the test are safe for use under pressure (valide certificate)	Yes
Pressure relief devices are installed and in line and set to correct pressure (calibration certificate)	Yes

Medium

Test medium	WATER

TEST RESULTS

Test date	See attachment	Start time	See attachment	End time	See attachment
Ambient temperature is recorded	NA			Test medium temperature is recorded	Yes
Pressure recorded during test hold period	Min See attachment	Max See attachment		Variation	See attachment
Line has been depressurised to	NA			At maximum of bar/min	See attachment
Pressure test completed sucessfully and approved	Yes			Temperature and pressure disc chart attached	NA
Instrument calibration certificates attached	Yes			Dead-weight tester log attached	NA
Record of failures and corrective action attached	No			Battery limits of the test attached	Yes
If required produce Red Line Mark Up for "AS BUILT".					

Comments:

Page 1/1	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM (ROSETTI MARINO)	
Name	Emanuele Delfino	Lorenzo Novaga	
Date	2025-01-31	2025-02-03	
Signature	Digitaly signed by Emanuele Delfino 2025-01-31T14:25:27.581Z	Digitaly signed by Lorenzo Novaga 2025-02-03T09:00:59.627Z	

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	123A90-25-07-TP-068

Instrument

Strumento

Electrical pressure gauge *Misuratore di pressione elettronico*	
Model *Modello*	CPG1500
Serial number *Numero di serie*	1A014ILNH2N
Log temperature *Registrazioni di Temperatura*	Active *Attivo*
Scale range *Campo scala*	(0 ... 1000) bar a
Accuracy *Accuratezza*	0.1 % FS
Tag number *Numero tag*	
Communication *Comunicazione*	Wireless (00:13:43:85:E0:AF)

Measurement conditions

Condizioni di misura

Settings *Impostazioni*	
Mode *Modalità*	Automatic *Automatico*
Interval (ms) *Intervallo (ms)*	60000
Duration (hh:mm:ss) *Durata (hh:mm:ss)*	01:17:31
Start time (hh:mm:ss) *Tempo di avvio (hh:mm:ss)*	09:07:29 am

Logger protocol

Protocollo di acquisizione elenco dati


ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	123A90-25-07-TP-068

Measurement results

Risultati della misura

Graphical representation of progression
Rappresentazione grafica dell'andamento

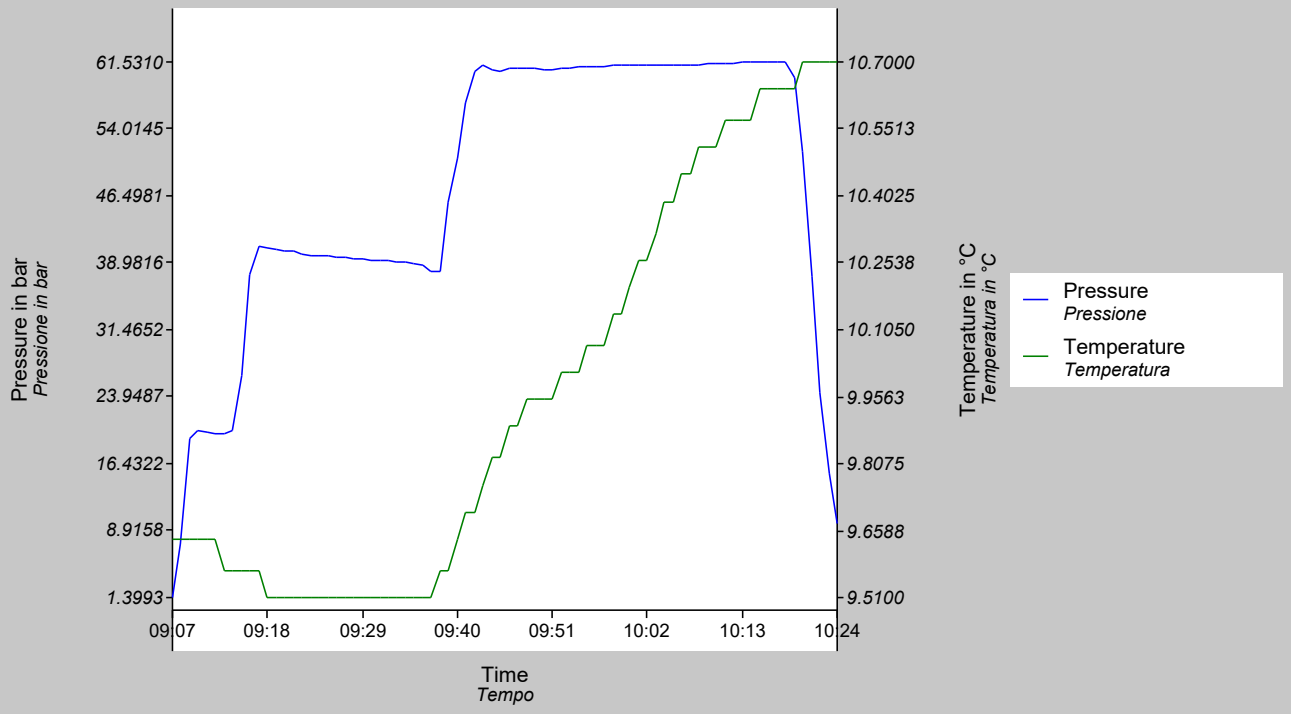

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
02/01/2025 09:07:29.000	1.3993	9.6400
02/01/2025 09:08:29.000	7.4088	9.6400
02/01/2025 09:09:29.000	19.1804	9.6400
02/01/2025 09:10:29.000	20.0775	9.6400
02/01/2025 09:11:29.000	19.9672	9.6400
02/01/2025 09:12:29.000	19.8693	9.6400
02/01/2025 09:13:29.000	19.7670	9.5700
02/01/2025 09:14:29.000	20.1466	9.5700
02/01/2025 09:15:29.000	26.3238	9.5700
02/01/2025 09:16:29.000	37.6800	9.5700
02/01/2025 09:17:29.000	40.8315	9.5700
02/01/2025 09:18:29.000	40.6362	9.5100
02/01/2025 09:19:29.000	40.4998	9.5100
02/01/2025 09:20:29.000	40.3838	9.5100
02/01/2025 09:21:29.000	40.2241	9.5100
02/01/2025 09:22:29.000	39.9938	9.5100
02/01/2025 09:23:29.000	39.8612	9.5100

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	123A90-25-07-TP-068

Measurement results

Risultati della misura

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
02/01/2025 09:24:29.000	39.7658	9.5100
02/01/2025 09:25:29.000	39.6916	9.5100
02/01/2025 09:26:29.000	39.6109	9.5100
02/01/2025 09:27:29.000	39.5232	9.5100
02/01/2025 09:28:29.000	39.4458	9.5100
02/01/2025 09:29:29.000	39.3725	9.5100
02/01/2025 09:30:29.000	39.3012	9.5100
02/01/2025 09:31:29.000	39.2394	9.5100
02/01/2025 09:32:29.000	39.1779	9.5100
02/01/2025 09:33:29.000	39.1159	9.5100
02/01/2025 09:34:29.000	39.0542	9.5100
02/01/2025 09:35:29.000	38.8984	9.5100
02/01/2025 09:36:29.000	38.7069	9.5100
02/01/2025 09:37:29.000	37.9948	9.5100
02/01/2025 09:38:29.000	38.0965	9.5700
02/01/2025 09:39:29.000	45.7485	9.5700
02/01/2025 09:40:29.000	50.6936	9.6400
02/01/2025 09:41:29.000	56.9500	9.7000
02/01/2025 09:42:29.000	60.4796	9.7000
02/01/2025 09:43:29.000	61.0938	9.7600
02/01/2025 09:44:29.000	60.6669	9.8200
02/01/2025 09:45:29.000	60.4980	9.8200
02/01/2025 09:46:29.000	60.7364	9.8900
02/01/2025 09:47:29.000	60.7855	9.8900
02/01/2025 09:48:29.000	60.7853	9.9500
02/01/2025 09:49:29.000	60.7654	9.9500
02/01/2025 09:50:29.000	60.6429	9.9500
02/01/2025 09:51:29.000	60.6079	9.9500
02/01/2025 09:52:29.000	60.8222	10.0100
02/01/2025 09:53:29.000	60.9082	10.0100
02/01/2025 09:54:29.000	60.9637	10.0100
02/01/2025 09:55:29.000	61.0027	10.0700
02/01/2025 09:56:29.000	61.0340	10.0700
02/01/2025 09:57:29.000	61.0631	10.0700
02/01/2025 09:58:29.000	61.0923	10.1400
02/01/2025 09:59:29.000	61.1017	10.1400
02/01/2025 10:00:29.000	61.1195	10.2000
02/01/2025 10:01:29.000	61.1499	10.2600
02/01/2025 10:02:29.000	61.1743	10.2600
02/01/2025 10:03:29.000	61.1952	10.3200
02/01/2025 10:04:29.000	61.2133	10.3900
02/01/2025 10:05:29.000	61.1953	10.3900
02/01/2025 10:06:29.000	61.2184	10.4500
02/01/2025 10:07:29.000	61.2289	10.4500
02/01/2025 10:08:29.000	61.2638	10.5100
02/01/2025 10:09:29.000	61.2998	10.5100
02/01/2025 10:10:29.000	61.3444	10.5100
02/01/2025 10:11:29.000	61.3789	10.5700
02/01/2025 10:12:29.000	61.4227	10.5700

Logger protocol

Protocollo di acquisizione elenco dati

ROSETTI MARINO
Group of Companies

Log no. *N. elenco dati*	123A90-25-07-TP-068

Measurement results

Risultati della misura

Timestamp *Data e ora*	Measured value *Valore misurato* bar	Measured value *Valore misurato* °C
02/01/2025 10:13:29.000	61.4642	10.5700
02/01/2025 10:14:29.000	61.4890	10.5700
02/01/2025 10:15:29.000	61.5233	10.6400
02/01/2025 10:16:29.000	61.5310	10.6400
02/01/2025 10:17:29.000	61.5192	10.6400
02/01/2025 10:18:29.000	61.4986	10.6400
02/01/2025 10:19:29.000	59.8470	10.6400
02/01/2025 10:20:29.000	51.4884	10.7000
02/01/2025 10:21:29.000	37.4018	10.7000
02/01/2025 10:22:29.000	24.4715	10.7000
02/01/2025 10:23:29.000	15.4061	10.7000
02/01/2025 10:24:29.000	9.7522	10.7000

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CERTIFICATO DI TARATURA LAT 114 0514-SM-24

Certificate of Calibration

- data di emissione date of issue	2024-10-31
- cliente customer	FAST AUTOMATION SRL VIA DELLA PREVIDENZA SOCIALE, 8 IT-42124 REGGIO EMILIA (RE)
- destinatario receiver	ROSETTI MARINO SPA - YARD PIOMBONI VIA DEL MARCHESATO, 37 IT-48122 MARINA DI RAVENNA (RA)

Il presente certificato di taratura è emesso in base all'accreditamento LAT N. 114 rilasciato in accordo ai decreti attuativi della legge n. 273/1991 che ha istituito il Sistema Nazionale di Taratura (SNT). ACCREDIA attesta le capacità di misura e di taratura, le competenze metrologiche del Centro e la riferibilità delle tarature eseguite ai campioni nazionali ed internazionali delle unità del Sistema Internazionale delle Unità (SI).
Questo certificato non può essere riprodotto in modo parziale, salvo espressa autorizzazione scritta da parte del Centro.

Si riferisce a
referring to

- oggetto *item*	Misuratore di pressione elettronico Electrical pressure gauge
- costruttore *manufacturer*	WIKA
- modello *model*	CPG1500
- matricola *serial number*	1A014ILNH2N
- data di ricev. oggetto *date of receipt of item*	2024-10-24
- data delle misure *date of measurements*	2024-10-31
- registro di laboratorio *laboratory reference*	0514-SM-24

This certificate of calibration is issued in compliance with the accreditation LAT No.114 granted according to decrees connected with Italian law No. 273/1991 which has established the National Calibration System. ACCREDIA attests the calibration and measurement capability, metrological competence of the Centre and the traceability of calibration results to the national and International standards of the International System of Units (SI).
This certificate may not be partially reproduced, except with the prior written permission of the issuing Centre.

I risultati di misura riportati nel presente Certificato sono stati ottenuti applicando le procedure di taratura citate alla pagina seguente, dove sono specificati anche i campioni o gli strumenti che garantiscono la catena di riferibilità del Centro e i rispettivi certificati di taratura in corso di validità. Essi si riferiscono esclusivamente all'oggetto in taratura e sono validi nel momento e nelle condizioni di taratura, salvo diversamente specificato.

The measurement results reported in this Certificate were obtained following the calibration procedures given in the following page, where the reference standards or instruments are indicated which guarantee the traceability chain of the laboratory, and the related calibration certificates in the course of validity are indicated as well. They relate only to the calibrated item and they are valid for the time and conditions of calibration, unless otherwise specified.

Le incertezze di misura dichiarate in questo documento sono state determinate conformemente alla Guida ISO/IEC 98 e al documento EA-4/02. Solitamente sono espresse come incertezza estesa ottenuta moltiplicando l'incertezza tipo per il fattore di copertura *k* corrispondente ad un livello di fiducia di circa il 95 %. Normalmente tale fattore *k* vale 2.

The measurement uncertainties stated in this document have been determined according to the ISO/IEC Guide 98 and to EA-4/02. Usually, they have been estimated as expanded uncertainty obtained multiplying the standard uncertainty by the coverage factor k corresponding to a confidence level of about 95%. Normally, this factor k is 2.

Direzione Tecnica
(Approving Officer)

Enrico Reccagni

Enrico Reccagni

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

CARATTERISTICHE DELLO STRUMENTO IN TARATURA/ Properties of devices under calibration

Misuratore di pressione elettronico *Electrical pressure gauge*	
Tipo *Model*	Misuratore di pressione elettronico Electrical pressure gauge
Numero di matricola *Serial No.*	1A014ILNH2N
Campo di misura *Scale range*	(0 ... 1000) bar g
Accuratezza dichiarata dal costruttore *Accuracy declared by the manufacturer*	0,1 % FS
Risoluzione *Resolution (scale division)*	0,1 bar
Tag. N. *Tag No.*	--

Procedura di taratura e catena di riferibilità
Calibration procedure and traceability chain

La taratura è stata effettuata in accordo alla linea guida DKD-R 6-1 "Taratura di strumenti di pressione" (versione 03/2014) procedura B, per confronto fra i valori dello strumento in taratura con quelli di riferimento dati dal campione di lavoro.

Calibration was carried out according to DKD-R 6-1 "Kalibrierung von Druckmessgeräten" (Ausgabe 03/2014) procedure B, by comparing the measured values of the calibration item with those of the reference or working standard.

I risultati riportati sono stati ottenuti applicando le procedure n° LMO-PT-01 rev.2

The results have been obtained using the procedures n° LMO-PT-01 rev.2

La catena di riferibilità ha inizio dai campioni di riferimento n° PM1-09

The traceability chain starts from the reference standards n° PM1-09

muniti di certificati validi di taratura, rispettivamente n° D21090

with the relevant valid calibration certificates n° D21090

Luogo di taratura
Place of calibration

Laboratorio WIKA ITALIA - Laboratorio di Modugno (BA)
WIKA ITALY Laboratory - Modugno (BA)

Campione di lavoro
Working Standard

Norma di riferimento (RS) Bilancia di pressione *Reference standard (RS) Dead-weight tester*	
Tipo *Model*	PM1-09
Certificato di taratura *Calibration mark*	D-K-15105/D21090
Campo di misura *Scale range*	(10 ... 2500) bar g
Accuratezza *Accuracy*	0,015 % della lettura + 255 Pa

Operatore
Technichian

Francesco Donatelli

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it

Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Condizioni di misura
Measurement conditions

Schema di collegamento *Assembly*	
Fluido utilizzato	Sebacate
Pressure medium	*Sebacate*
Livello di riferimento	Superficie di tenuta DUT
Refence height (for reference value)	*Sealing face DUT*
Posizione di montaggio	verticale
Position during calibration	*vertical*

Note di taratura
Calibration Note

Lo strumento è stato tarato e riconsegnato nelle stesse condizioni in cui è arrivato nel laboratorio, in accordo con il metodo "as found as left" / The device under test (DUT) was calibrated in the same conditions it was arrived in laboratory, according to the method "as found as left".

Condizioni Ambientali
Environmental conditions

Temperatura *Temperature*	(22 ± 1,5)	°C
Pressione atmoferica *Atmospheric pressure*	(1016,6 ± 0,2)	hPa
Umidità relativa *Rel. Humidity*	(50 ± 15)	% UR

I dati meteo sono stati acquisiti tramite stazione meteo WIKA CPU6000-W s/n.1A00VCX6GJ2

Weather data were acquired via the WIKA CPU6000-W weather station s/n.1A00VCX6GJ2

Misure rilevate
Measurement results

Valore di riferimento *Reference value RS* bar	**Letture** *Reading DUT* bar		
	M1	**M2**	**M3**
0,00	0,0	0,0	0,0
99,91	99,9	100,0	99,9
199,82	199,9	199,9	199,9
299,72	299,8	299,9	299,8
399,63	399,7	399,8	399,7
499,53	499,6	499,6	499,6
599,43	599,5	599,5	599,5
699,33	699,3	699,4	699,4
799,24	799,2	799,2	799,2
899,13	899,1	899,1	899,1
999,03	999,0	999,0	999,0

WIKA Italia S.r.l. & C. s.a.s.
Viale dell'Artigianato,
I Traversa, n. 8
70026 - Modugno (BA) • Italy
www.wika.it


Centro di Taratura LAT N°114
Calibration Centre
Laboratorio Accreditato di Taratura
Accredited Calibration Laboratory

LAT N° 114

Incertezza di misura
Uncertainty of measurement

Valori di riferimento *Reference value RS* bar	Media delle misure *Mean value* bar	Errore *Error* bar	Ripetibilità *Repeatability* bar	Isteresi *Hysteresis* bar	Incertezza di misura *Meas. Uncertainty* bar
0,00	0,0	0,0	0,0	0,0	0,40
99,91	100,0	0,1	0,0	0,1	0,40
199,82	199,9	0,1	0,0	0,0	0,40
299,72	299,9	0,2	0,0	0,1	0,40
399,63	399,8	0,2	0,0	0,1	0,40
499,53	499,6	0,1	0,0	0,0	0,40
599,43	599,5	0,1	0,0	0,0	0,40
699,33	699,4	0,1	0,1	0,1	0,40
799,24	799,2	0,0	0,0	0,0	0,40
899,13	899,1	0,0	0,0	0,0	0,40
999,03	999,0	0,0	0,0	0,0	0,40

Grafico degli errori di misura
Graphical representation of measurement uncertainty

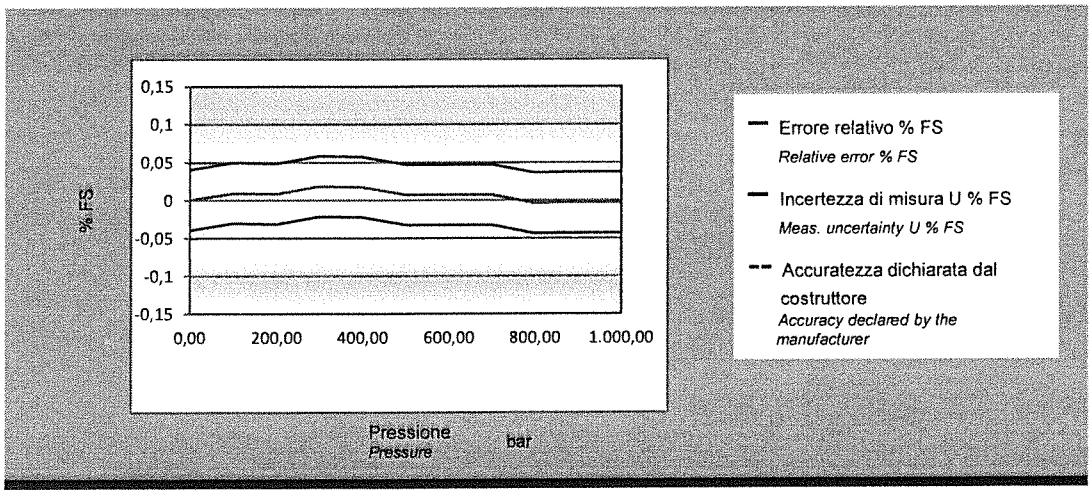

L'incertezza estesa senza correzione del DUT è pari a 0,6 bar
The expanded uncertainty of the DUT without correction is equal to

Questo dato è ottenuto come MAX{Incertezza_di_misura$_i$ + |Errore$_i$|} della tabella precedente
This data is obatined as MAX{Meas._uncertainty$_i$ + |Error$_i$|} of the previous table

Il presente certificato non rappresenta una dichiarazione di conformità a specifica
This certificate is not a statement of compliance

Base Load Power Hub (BLPH)

TEST PACK

N°25-07-TP-068
SUB-SYSTEM N° 25-07

System	25
Sub-System	25-07
Test Pressure	60 barg
Test Fluid	WATER
Test Duration	30 min

Rev.	Date	Prepared by	Checked by
0	27/09/2024	J.Q.	L.M.

List of Contents


1. COLOURED MARKED P&IDs
2. PIPING TEST 3D CIRCUIT
3. MATERIAL LIST FOR TEST
4. EXTRACT OF LINE LIST
5. ISOMETRIC RED-MARKED DRAWINGS & EXTRACT OF ISO LIST
6. EXTRACT OF SUPPORT LIST AND DETAILS
7. WELDING REGISTER & MATERIAL TRACEABILITY RECORD
8. PIPING & VESSEL PRE-COMMISSIONING CONFORMITY CHECKS & TESTS:
   - 8.1 CLX02A - Pipework Before test
   - 8.2 CLX02B - Pipework After Test
   - 8.3 CXX01 - Thermal insulation – NOT APPLICABLE
   - 8.4 CXX02 – Painting Line
   - 8.5 TMX03 – Cleaning
   - 8.6 TMX05 – Pressure test
   - 8.7 TMX25 – Gross Air Leak Test
   - 8.8 TMX27 – Bolt Tensioning / Torquing
   - 8.9 TPLX05 - Drying

1. COLOURED MARKED P&IDs

DRAWING NO. DRAWING_NO.

REV. REV

A-20000
ELECTROLYSER PACKAGE
DUTY: 2.5MW
DESIGN PRESSURE: 40 barg
DESIGN TEMPERATURE: 80 °C
H2 GENERATING CAPACITY: 500 Nm³/h

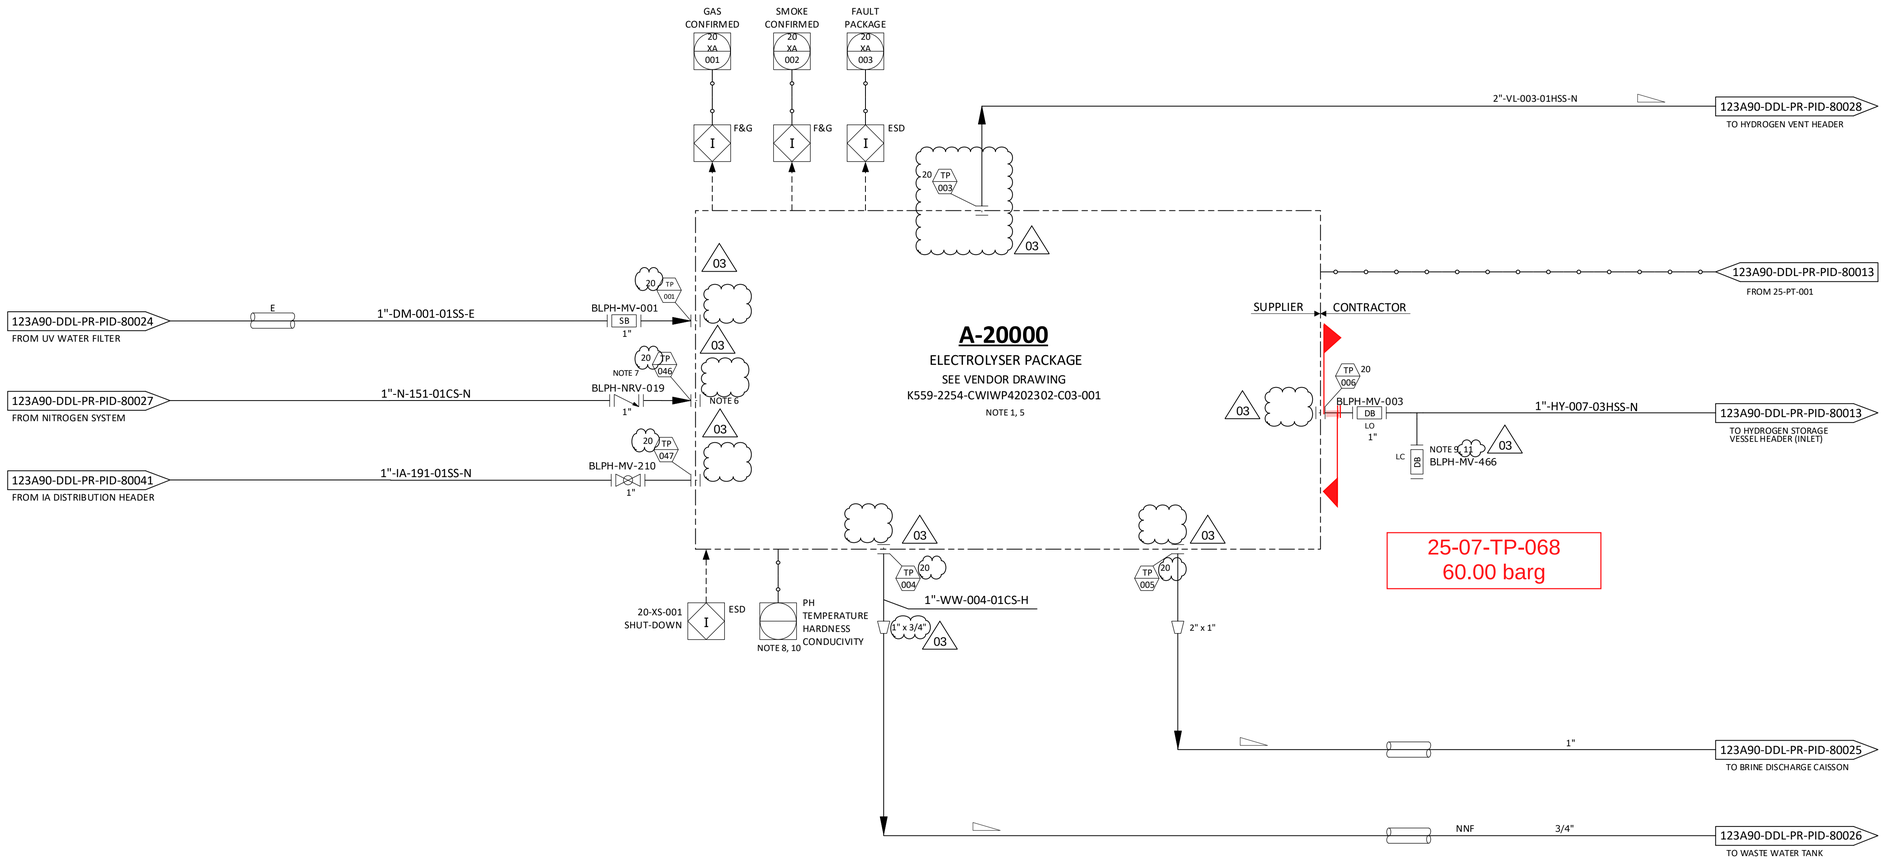

NOTES

1. PACKAGE SUPPLIED WITH POWER FROM THE BLPH ELECTRICAL SYSTEM.
2. DELETED.
3. DELETED.
4. DELETED.
5. ELECTROLYSER PACKAGE INCLUDES AN OXYGEN VENT LINE WHICH IS IN THE SCOPE OF SUPPLY OF THE ELECTROLYSER PACKAGE UP TO THE ATMOSPHERE. NO PHYSICAL INTERFACE IS PRESENT BETWEEN ELECTROLYSER PACKAGE AND CONTRACTOR ON THIS LINE.
6. AN ISOLATION VALVE DOWNSTREAM THE CHECK VALVE NRV-019 IS PROVIDED WITHIN THE PACKAGE A-20000.
7. CHECK VALVE NRV-019 TO BE INSTALLED AS CLOSE AS POSSIBLE TO THE ELECTROLYSER PACKAGE A-20000.
8. SERIAL COMMUNICATION WITH CONTROL SYSTEM.
9. NITROGEN PURGING CONNECTION TO BE LOCATED AS CLOSE AS POSSIBLE TO MANUAL VALVE BLPH-MV-003.
10. PH, TEMPERATURE, HARDNESS AND CONDUCTIVITY SHALL BE SENT FROM CONTROL SYSTEM TO ELECTROLISER UCP IN ADDITION TO THE OTHER SOFTWARE SIGNALS. 03
11. MANUAL VALVE BLPH-MV-466 TO BE CONNECTED WITH MANUAL VALVE BLPH-MV-275 (INSTALLED ON NITROGEN GENERATION PACKAGE EXIT LINE) BY MEAN ON A FLEXIBLE HOSE DURING COMMISSIONING PHASE FOR PURGING OPERATION.

HOLDS

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
03	09/09/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
02	12/06/2024	CIM	RZI	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
01	15/02/2024	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)
00	20/10/2023	CIM	RZI	DLO	ISSUE FOR ACCEPTANCE (IFA)

CROSSWIND


ROSETTI MARINO

TITLE :
BLPH PIPING AND INSTRUMENTATION DIAGRAM
ELECTROLYSER PACKAGE

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK	SCALE	NTS
DRAWN	CHECKED	APPROVED	DATE
A1	DRAWING NO. 123A90-DDL-PR-PID-80011	SHEET 001	REV. 03

File Name : FILE_NAME

2. HYDROSTATIC TEST 3D CIRCUIT

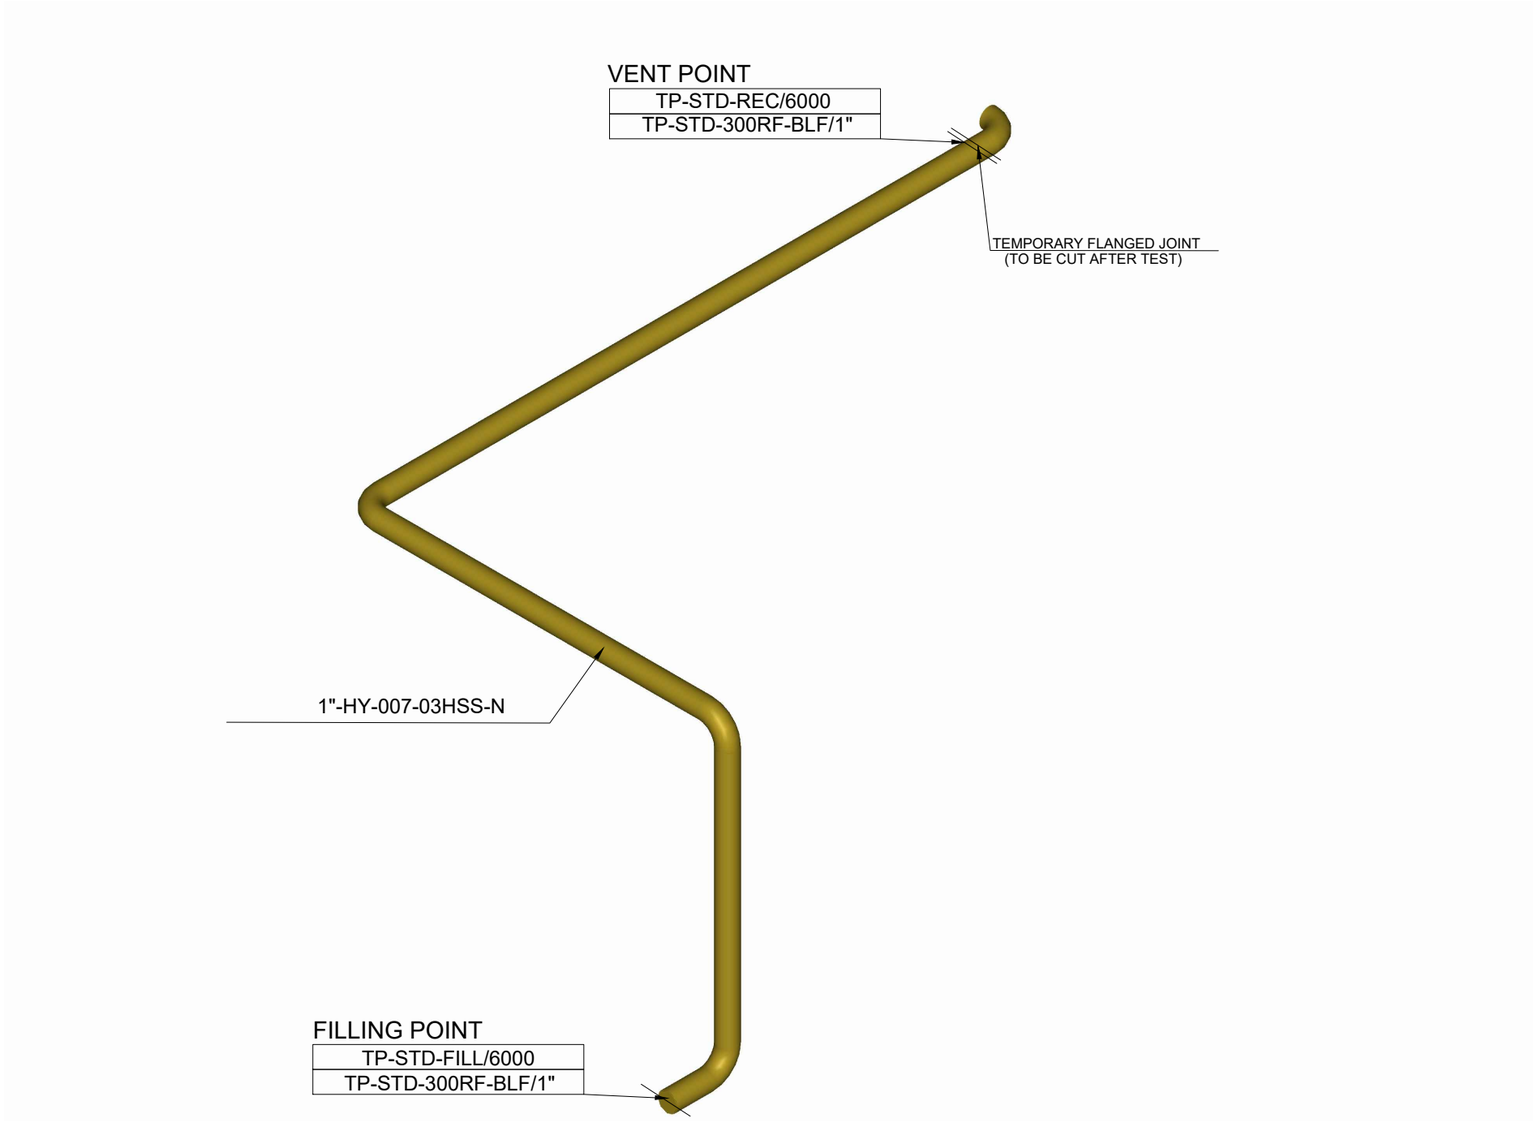

25-07-TP-068

60 barg

NOTES

- MANUAL VALVES MAY BE EXCLUDED FROM THE TEST
- ALL INSTRUMENTS (PG, TT, etc.) SHALL BE EXCLUDED FROM THE TEST
- ALL INSTRUMENT VALVES (SDV, PCV, etc.) SHALL BE EXCLUDED FROM THE TEST
- FILLING POINT, VENTS & DRAINS SHALL BE DEFINED ON SITE AS FOR REAL TEST CIRCUIT CONFIGURATION

REV.	DATE	DESCRIPTION	DRN	CHKD	APPD
00	27-09-24	ISSUED FOR INFORMATION	J.Q.	T.L.	L.M.

CROSSWIND

ROSETTI MARINO

HOLLANDSE KUST NOORD WIND PARK

PIPING TEST 3D CIRCUIT
25-07-TP-068

FORMAT	SCALE	DRAWING N.	REV.	SHEET
A3	NTS	N/A	00	1 OF 1

3. MATERIAL LIST FOR TEST


CROSSWIND / ROSETTI MARINO	CONTRACTOR: Rosetti Marino SpA	JOB :	123A90
	PROJECT: Base Load Power Hub (BLPH)	DATE :	20/09/2024
	TITLE: MATERIAL LIST FOR HYDROSTATIC TEST	REV. :	00

TEST REF.	TYPICAL ITEM CODE	ROSETTI CODE	ROSETTI DESCRIPTION	Q.TY X SINGLE STD	Q.TY STD X TP	Q.ty x TP	NOTES
ALL TEST	TP-STD-FILL/6000	1EQP252	Ball Valve THRD-F NPT ø1/2" 7250 psi 316L	5	1	5	
ALL TEST	TP-STD-FILL/6000	N100SS02660H00	Nipple L=100mm TBE ø1/2" Thk.4,78mm ASTM A312 Gr.TP316/316L	7	1	7	
ALL TEST	TP-STD-FILL/6000	TEEFSS00060H00	Tee THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	3	1	3	
ALL TEST	TP-STD-FILL/6000	1MECH069	Adapter THRD-M NPT x BSPP ø1/2" 400 bar ASTM A182 Gr.F316/316L	2	1	2	
ALL TEST	TP-STD-REC/6000	1EQP252	Ball Valve THRD-F NPT ø1/2" 7250 psi 316L	4	1	4	
ALL TEST	TP-STD-REC/6000	N100SS02660H00	Nipple L=100mm TBE ø1/2" Thk.4,78mm ASTM A312 Gr.TP316/316L	9	1	9	
ALL TEST	TP-STD-REC/6000	TEEFSS00060H00	Tee THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	2	1	2	
ALL TEST	TP-STD-REC/6000	CAPFSS00200H00	Cap Forged THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	1	1	1	
ALL TEST	TP-STD-REC/6000	CPL0SS00240H00	Coupling THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	1	1	1	
ALL TEST	TP-STD-REC/6000	E900SS00340H00	90 Deg Elbow THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	1	1	1	
ALL TEST	TP-STD-PLGNPT/1/2"	PLGHSS00090H00	Plug Hex. Head THRD-M NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	1	1	1	
TP-068	TP-STD-300RF-BLF/1"	FLBHCS0018010H	Flange Blind c/w NPT Hole ø1"x1/2" 300LB RF ASTM/ASME A/SA105	1	2	2	
TP-068	TP-STD-300RF-BLF/1"	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ø1" 300LB RF AISI 316 + GRAPHITE c/w INNER RING	1	2	2	
TP-068	TP-STD-300RF-BLF/1"	SB20BO00680300	Stud Bolt + 2 Heavy Nuts 5/8" L=100MM ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	4	2	8	


TP-STD-300RF | 300 RF | STANDARD FOR BLIND POINT

TP-STD-300RF-BLF/Dn
TP-STD-300RF-GSK/Dn

MATERIAL LIST			
STD	**POS.**	**DESCRIPTION**	**Q.TY**
TP-STD-300RF-___/1/2"	8	Flange Blind c/w NPT Hole ø1/2"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø1/2" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 1/2" L=65 MM	4
TP-STD-300RF-___/3/4"	8	Flange Blind c/w NPT Hole ø3/4"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø3/4" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 5/8" L=75 MM	4
TP-STD-300RF-___/1"	8	Flange Blind c/w NPT Hole ø1"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø1" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 5/8" L=80 MM	4
TP-STD-300RF-___/1.1/4"	8	Flange Blind c/w NPT Hole ø1.1/4"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø1.1/4" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 5/8" L=90 MM	4
TP-STD-300RF-___/1.1/2"	8	Flange Blind c/w NPT Hole ø1.1/2"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø1.1/2" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 3/4" L=95 MM	4
TP-STD-300RF-___/2"	8	Flange Blind c/w NPT Hole ø2"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø2" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 5/8" L=90 MM	8
TP-STD-300RF-___/2.1/2"	8	Flange Blind c/w NPT Hole ø2.1/2"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø2.1/2" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 3/4" L=105 MM	8
TP-STD-300RF-___/3"	8	Flange Blind c/w NPT Hole ø3"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø3" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 3/4" L=110 MM	8
TP-STD-300RF-___/4"	8	Flange Blind c/w NPT Hole ø4"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø4" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 3/4" L=115 MM	8
TP-STD-300RF-___/6"	8	Flange Blind c/w NPT Hole ø6"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø6" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 3/4" L=125 MM	12
TP-STD-300RF-___/8"	8	Flange Blind c/w NPT Hole ø8"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø8" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 7/8" L=145 MM	12
TP-STD-300RF-___/10"	8	Flange Blind c/w NPT Hole ø10"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø10" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 1" L=160 MM	16
TP-STD-300RF-___/12"	8	Flange Blind c/w NPT Hole ø12"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø12" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 1.1/8" L=175 MM	16
TP-STD-300RF-___/14"	8	Flange Blind c/w NPT Hole ø14"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø14" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 1.1/8" L=180 MM	20
TP-STD-300RF-___/16"	8	Flange Blind c/w NPT Hole ø16"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø16" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 1.1/4" L=195 MM	20
TP-STD-300RF-___/18"	8	Flange Blind c/w NPT Hole ø18"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø18" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 1.1/4" L=200 MM	24
TP-STD-300RF-___/20"	8	Flange Blind c/w NPT Hole ø20"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø20" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 1.1/4" L=210 MM	24
TP-STD-300RF-___/24"	8	Flange Blind c/w NPT Hole ø24"x1/2" 300LB RF ASTM/ASME A/SA105	1
	10	Gasket ø24" 300LB RF	1
	11	Stud Bolt + 2 Heavy Nuts 1.1/2" L=235 MM	24

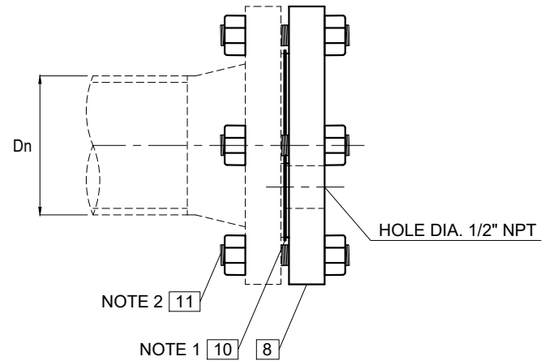

TP-STD-300RF-BLF/Dn
BLIND FLANGE

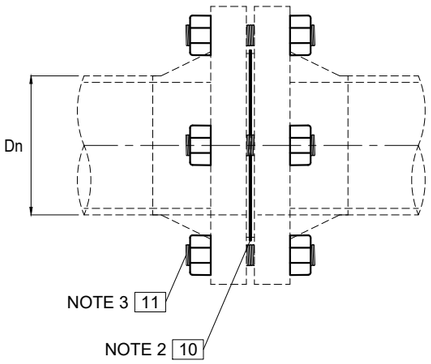

TP-STD-300RF-GSK/Dn
GASKET ONLY

NOTES

1. GASKET MATERIAL AS PER PIPING CLASS
2. STUD BOLTS AND NUTS MATERIAL AS PER TEST MTO


REV.	DATE	DESCRIPTION	DRN	CHKD	APPD
00	06-09-24	ISSUED FOR INFORMATION	J.Q.	T.L.	L.M.

ROSETTI MARINO

PIPING TEST STANDARD DRAWING
TP-STD-300RF
TP-STD-300RF-BLF/Dn
TP-STD-300RF-GSK/Dn

FORMAT	SCALE	DRAWING N.	REV.	SHEET
A3	NTS	TP_STD_300RF	00	1 OF 1

STD NAME	RATING	DESCRIPTION
TP-STD-FILL	3000 / 6000 / 9000	STANDARD FOR FILLING POINT
TP-STD-FILL/RATING		

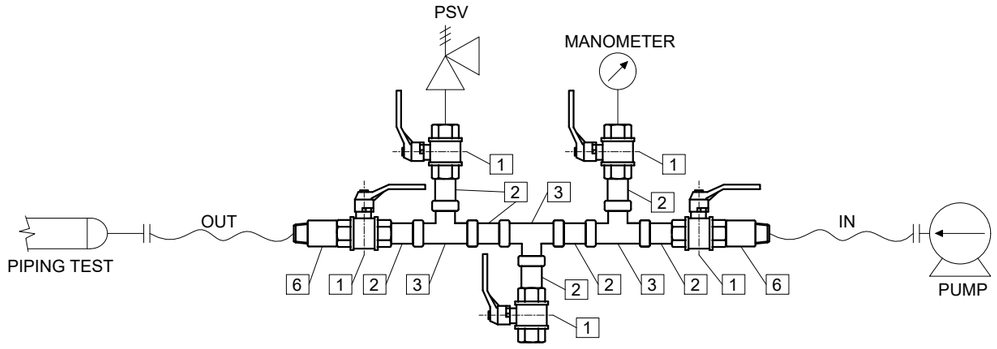

TP-STD-FILL/RATING

FILLING POINT 3000/6000/9000

MATERIAL LIST

STD	POS.	DESCRIPTION	Q.TY
TP-STD-FILL/3000	1	Ball Valve THRD-F NPT ø1/2" 7250 psi 316L	5
	2	Nipple L=100mm TBE ø1/2" Thk.3.73mm ASTM A312 Gr.TP316/316L	7
	3	Tee Forged THRD-F NPT ø1/2" 3000# ASTM A182 Gr.F316/316L	3
	6	Adapter THRD-M NPT x BSPP ø1/2" 400 bar ASTM A182 Gr.F316/316L	2
TP-STD-FILL/6000	1	Ball Valve THRD-F NPT ø1/2" 7250 psi 316L	5
	2	Nipple L=100mm TBE ø1/2" Thk.4,78mm ASTM A312 Gr.TP316/316L	7
	3	Tee THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	3
	6	Adapter THRD-M NPT x BSPP ø1/2" 400 bar ASTM A182 Gr.F316/316L	2
TP-STD-FILL/9000	1	Ball Valve THRD-F NPT ø1/2" 7250 psi 316L	5
	2	Nipple L=100mm TBE ø1/2" Thk.7,47mm ASTM A312 Gr.TP316/316L	7
	3	Tee Forged THRD-F NPT ø1/2" 9000# ASTM A182 Gr.F316/316L	3
	6	Adapter THRD-M NPT x BSPP ø1/2" 523 bar 304SS	2

NOTES

REV.	DATE	DESCRIPTION	DRN	CHKD	APPD
00	06-09-24	ISSUED FOR INFORMATION	J.Q.	T.L.	L.M.

ROSETTI MARINO

PIPING TEST STANDARD DRAWING


TP-STD-FILL

TP-STD-FILL/RATING

FORMAT	SCALE	DRAWING N.	REV.	SHEET
A3	NTS	TP_STD_FILL	00	1 OF 1

STD NAME	RATING	DESCRIPTION
TP-STD-REC	3000 / 6000 / 9000	STANDARD FOR RECORDING POINT

TP-STD-REC/RATING

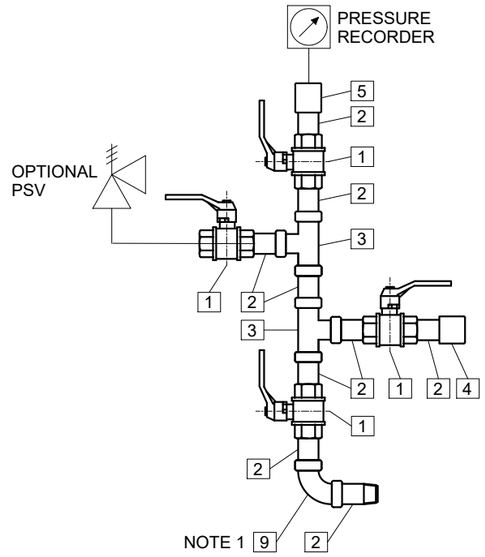

TP-STD-REC/RATING
RECORDING POINT 3000/6000/9000

MATERIAL LIST

STD	POS.	DESCRIPTION	Q.TY
TP-STD-REC/3000	1	Ball Valve THRD-F NPT ø1/2" 7250 psi 316L	4
	2	Nipple L=100mm TBE ø1/2" Thk.3.73mm ASTM A312 Gr.TP316/316L	9
	3	Tee Forged THRD-F NPT ø1/2" 3000# ASTM A182 Gr.F316/316L	2
	4	Cap Forged THRD-F NPT ø1/2" 3000# ASTM A182 Gr.F316/316L	1
	5	Coupling THRD-F NPT ø1/2" 3000# ASTM A182 Gr.F316/316L	1
	9	90 Deg Elbow THRD-F NPT ø1/2" 3000# ASTM A182 Gr.F316/316L	1
TP-STD-REC/6000	1	Ball Valve THRD-F NPT ø1/2" 7250 psi 316L	4
	2	Nipple L=100mm TBE ø1/2" Thk.4,78mm ASTM A312 Gr.TP316/316L	9
	3	Tee THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	2
	4	Cap Forged THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	1
	5	Coupling THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	1
	9	90 Deg Elbow THRD-F NPT ø1/2" 6000# ASTM A182 Gr.F316/316L	1
TP-STD-REC/9000	1	Ball Valve THRD-F NPT ø1/2" 7250 psi 316L	4
	2	Nipple L=100mm TBE ø1/2" Thk.7,47mm ASTM A312 Gr.TP316/316L	9
	3	Tee Forged THRD-F NPT ø1/2" 9000# ASTM A182 Gr.F316/316L	2
	4	Cap Forged THRD-F NPT ø1/2" 9000# ASTM A182 Gr.F316/316L	1
	5	Coupling THRD-F NPT ø1/2" 9000# ASTM A182 Gr.F316/316L	1
	9	90 Deg Elbow THRD-F NPT ø1/2" 9000# ASTM A182 Gr.F316/316L	1

NOTES

1. 90 DEG ELBOW SHALL BE INSTALLED WHERE APPLICABLE ONLY

REV.	DATE	DESCRIPTION	DRN	CHKD	APPD
00	06-09-24	ISSUED FOR INFORMATION	J.Q.	T.L.	L.M.

ROSETTI MARINO

PIPING TEST STANDARD DRAWING
TP-STD-REC
TP-STD-REC/RATING

FORMAT	SCALE	DRAWING N.	REV.	SHEET
A3	NTS	TP_STD_REC	00	1 OF 1

4. EXTRACT OF LINE LIST

Isometric N°	Short Line N°	Sequential Number	Size [in]	Piping Class	Insulation Type	Pipe Wall Thicknes [mm]	Pipe Schedule	Tracing	Line Number	PID Number	Design Pressure [barg]	Commissioning System Code	Commissioning SubSystem Code	Test Pack N°	Test Fluid	Test Pressure [barg]	Fluid Service	Class Base Material	Line INF/SUP/TL	Ped Category	Painting System	Line Base Ral
5	HY-007	007	1	03HSS	N	3,38	40S	N/A	1"-HY-007-03HSS-N	123A90-DDL-PR-PID-80011	40,00	25	25-07	TP-007/TP-068	Water	60.00	Hydrogen	Stainless Steel	INF	II	6A	RAL 9002

5. ISOMETRIC RED MARKED DRAWING & EXTRACT OF ISO LIST

CROSSWIND

ROSETTI MARINO

PROJECT

BASE LOAD POWER HUB (BLPH)

JOB **123A90**

DOCUMENT NR **123A90-FDL-ST-LIS-00001**


REV. **08**

TITLE

SHOP DRAWING ISOMETRIC LIST

DATE **04/12/2024**

POS.	DOCUMENT NR	ROSETTI SKETCH NR	SHEET	DOCUMENT TITLE	Rev. 00	Rev. 01	Rev. 02	Rev. 03	Rev. 04	Rev. 05	Rev. 06	Rev. 07	Rev. 08	Rev. 09	Rev. 10	Mark-up Rev.	Mark-up Data	LAST REV	LIST REV	NOTES	TEST PACK NR
7	123A90-FDL-PP-DI-00005-01	**005**	01	SHOP DRAWING ISOMETRIC - LINE NR 1"-HY-007-03HSS-N	03/09/2024	04/12/2024												**01**	**08**		**TP-007/TP-068**

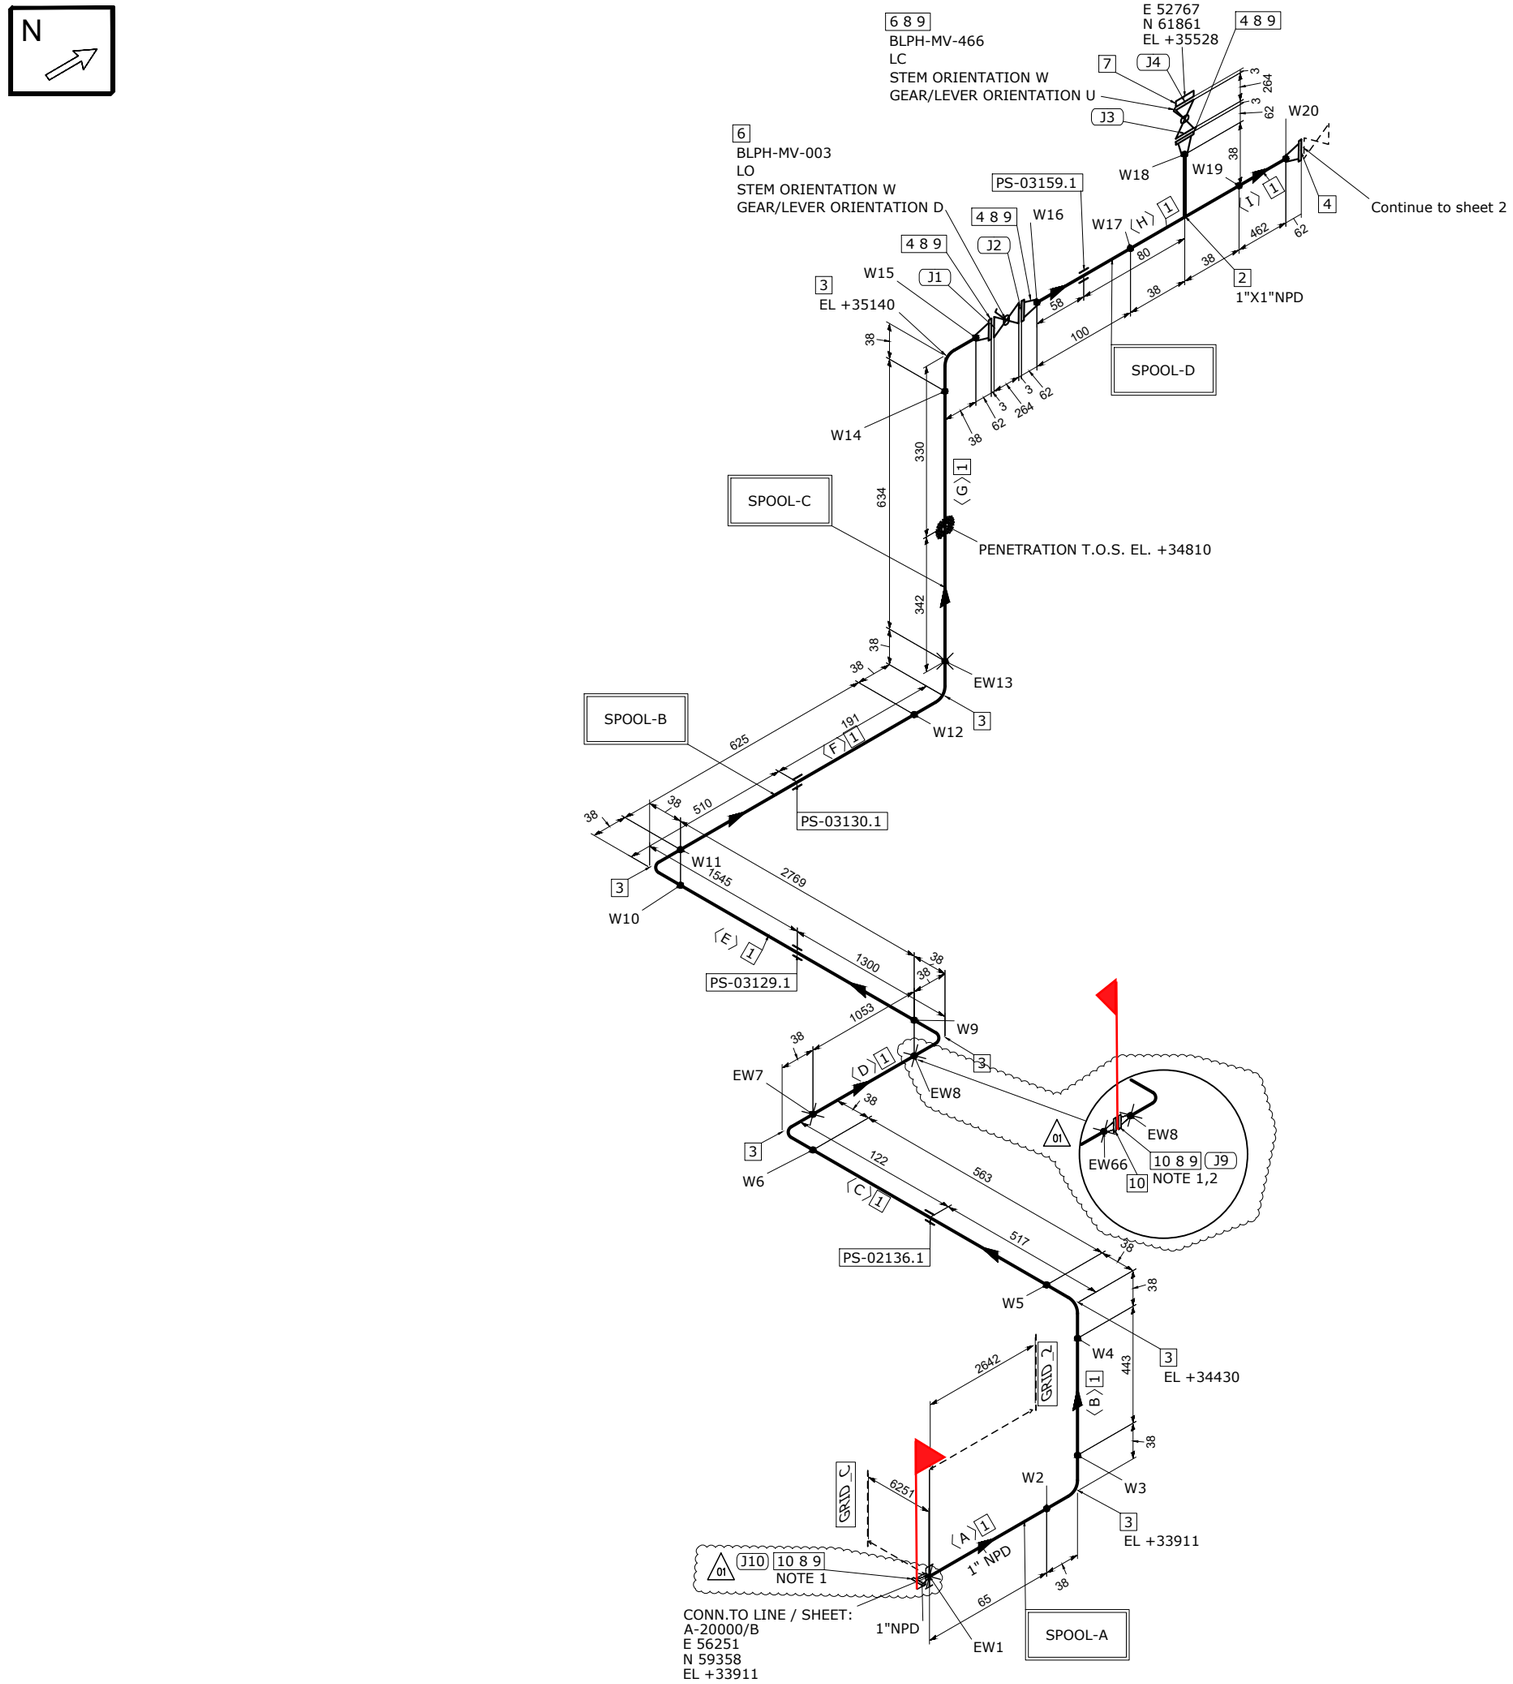

MATERIAL LIST

FABRICATION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
1	1	PIPESS00480100	Pipe ASME B36.19M PE 3,38 SML ASTM A312 Gr.TP316/316L	6.7M	17.1
2	1X1	TEE0SS00550100	Tee ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	1	0.3
3	1	E90RSS00670100	90 Deg Elbow Long Radius ASME B16.9 BW 3,38 WRS ASTM A403 Gr.WP316/316L	7	1.0
4	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	4	7.3

ERECTION

POS.	SIZE	SAP CODE	DESCRIPTION	Q.TY	WEIGHT [kg]
6	1	VLBBNN07190100	Double Block & Bleed Valve API 6D FLG 300LB RF DA03C01RFH	2	27.0
7	1	FLB0SS01830100	Flange Blind ASME B16.5 300LB RF FRG ASTM A182 Gr.F316/316L	1	1.8
8	1	GSW0GK11210100	Gasket Spiral Wound Thk. 3.2 mm ASME B16.20 300LB RF GSK AISI 316 + GRAPHITE c/w INNER RING	6	0.6
9	5/8	SB20BO01870300	80 Stud Bolt + 2 Heavy Nuts ASME B1.1 ASTM A193 Gr.B7 - A194 Gr.2H Hot dip galvanized	24	5.6
01 10	1	FLW0SS03270100	Flange WN ASME B16.5 300LB RF 3,38 FRG ASTM A182 Gr.F316/316L	3	5.5

FABRICATION WEIGHT [kg]	25.7
ERECTION WEIGHT [kg]	40.5
OVERALL WEIGHT [kg]	66.2

WELD SUMMARY

WELD No.	SIZE [inches]	TYPE
EW1	1	BW
W2	1	BW
W3	1	BW
W4	1	BW
W5	1	BW
W6	1	BW
EW7	1	BW
01 EW8	1	BW
W9	1	BW
W10	1	BW
W11	1	BW
W12	1	BW
EW13	1	BW
W14	1	BW
W15	1	BW
W16	1	BW
W17	1	BW
W18	1	BW
W19	1	BW
W20	1	BW
01 EW66	1	BW

CUTTING LIST

PIECE No.	SIZE [inches]	LENGTH [mm]	END PREP.1	END PREP.2
A	1	65	SQ.CUT	BEVEL
B	1	443	BEVEL	BEVEL
C	1	563	BEVEL	BEVEL
D	1	1053	BEVEL	BEVEL
E	1	2769	BEVEL	BEVEL
F	1	625	BEVEL	BEVEL
G	1	634	BEVEL	BEVEL
H	1	100	BEVEL	BEVEL
I	1	462	BEVEL	BEVEL

SUPPORT LIST

PS-02136.1
PS-03129.1
PS-03130.1
PS-03159.1

SPOOL	WELD [inches]	WEIGHT [kg]
A	5	3.1
B	01 4	11.7
C	2	3.6
D	5	7.3
	01	
MONT	5	40.5

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	04-12-2024	STAFF SRL	RT	LM	REVISED WHERE INDICATED
00	03-09-2024	STAFF SRL	RT	LM	ISSUED FOR CONSTRUCTION

CROSSWIND

ROSETTI MARINO

TITLE: SHOP DRAWING ISOMETRIC
LINE NR. 1"-HY-007-03HSS-N
SK.005

CONTRACT NO./ TITLE: CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK
SCALE: N/A
DRAWN: STAFF SRL | CHECKED: RT | APPROVED: LM
DATE: 03-09-2024
FORMAT: A3
DRAWING NO.: 123A90-FDL-PP-DI-00005
SHEET / OF: 1/3
REV.: 01

LINE DATA

NDT INSPECTION CATEGORY	1			PED CATEGORY	II			
PAINTING	SYSTEM 6A	BASE RAL RAL-9002		FLUID PHASE	Gas			
INSULATION	TYPE N	THICKNESS [mm]		DESIGN	PRESS. 40 [barg]	TEMP. -29 / 80 [°C]		
HEAT TRACING	N/A			TEST	PRESS. 60 [barg]	TEMP. AMB	MEDIUM Water	

REFERENCE DOCUMENTS

P&ID	123A90-DDL-PR-PID-80011
ISOMETRIC SHOP DWG LIST	123A90-FDL-PP-LIS-00001
PIPING SUPPORT BOOK	123A90-DDL-PP-DD-72000
PIPING MATERIAL CLASS	123A90-DDL-PP-SP-70029

NOTES

1) TEMPORARY FLANGE FOR HYDROTEST, TO BE CUT AFTER TEST 01
2) PIPE 1<D> REMAIN 1053mm


25-07-TP-068

MASTER


6. EXTRACT OF SUPPORT LIST & DETAILS

SUPPORT LIST


SUPPORT	SUFFIX	SERVICE	DECK IDENTIFICATION	SUB ASSEMBLY	LINE	SUPPORTS / STANDARD	NDT CATEGORY	QUANTITY	TOT. WEIGTH (KG)	PAINTING SURFACE (SQM)	REV	DATE	STATUS	NOTES	Test Pack N°
PS-02135	B1	PIP	UPPER DECK		1"-HY-007-03HSS-N	S-211 - 1"		1	0,286	0,000	01	04/11/2024	AFC		TP-068

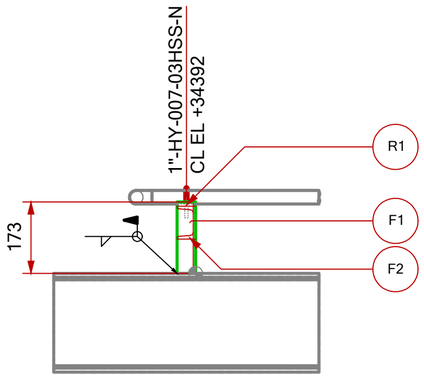


VIEW LOOKING NORTH

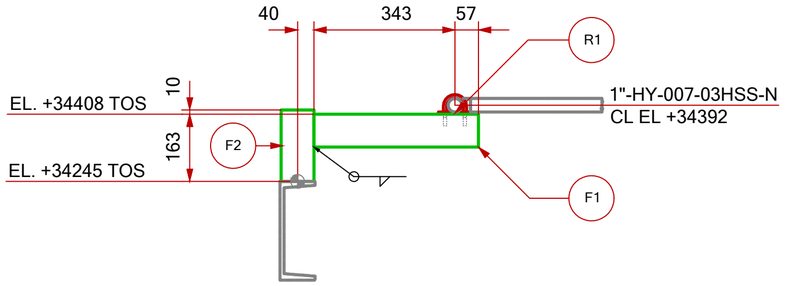

VIEW LOOKING WEST

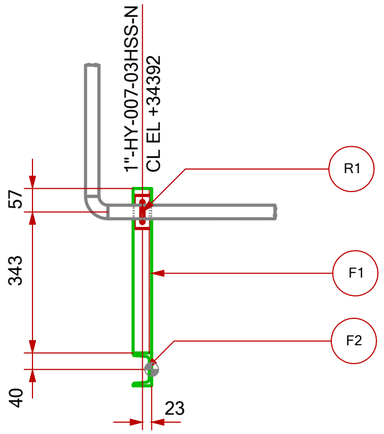


PLAN VIEW

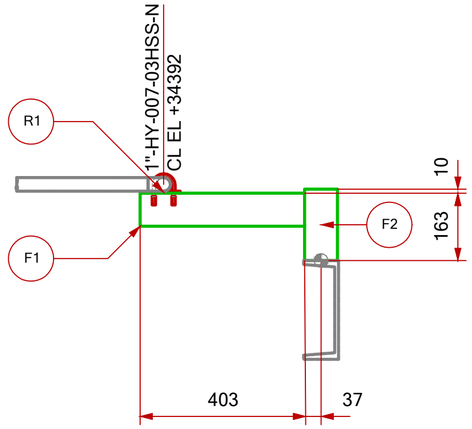

VIEW LOOKING EAST

SUPPORT MATERIAL LIST

POS.	TYPE	DESCRIPTION	MATERIAL	LENGHT (mm)	Q.TY (n°)	UNIT WEIGHT (Kg/mt)	TOTAL WEIGHT (Kg)	PAINT SURF. (m2)
R1	STD	S-211-1"	-	-	1	-	0.29	-
F1	BEAM	UPN80	Carbon Steel	400	1	8.66	3.47	0.127
F2	BEAM	UPN80	Carbon Steel	173	1	8.66	1.50	0.057
						TOTAL	5.3	0.18

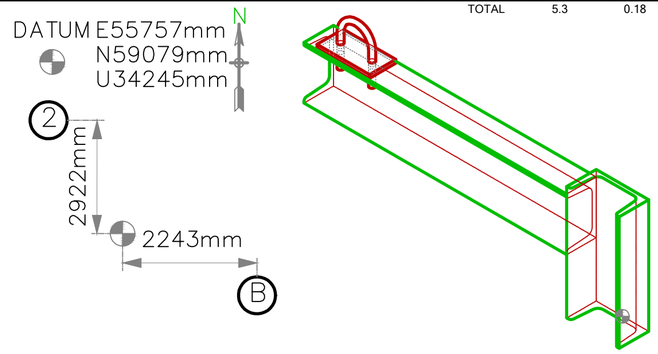

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	04/11/24	MMA	SLO	DLO	ACCEPTED FOR CONSTRUCTION
00	19/08/24	MMA	SLO	DLO	ISSUE FOR REVIEW

CROSSWIND

ROSETTI MARINO

TITLE :

BASE LOAD POWER HUB (BLPH)
Support Drawings
PS-02136

CONTRACT NO./TITLE	CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK		SCALE 1 : 10
DRAWN	CHECKED	APPROVED	DATE 04/11/24
DRAWING NO. 123A90-DDL-PP-DD-72000			SHEET 1 of 1 / REV. 01

File Name :

ROSETTI MARINO

STANDARD SPECIFICATION
PIPE SUPPORT DETAIL STANDARD

Document Number: STD–PP–DD–0001


Revision: 0

Date: –

CAVALLOTTI GALVANIZZATI DI GUIDA PER TUBAZIONI IN C.S S.S. E ALLOY
GALVANIZED U–BOLTS GUIDE FOR C.S. S.S. AND ALLOY PIPES (NON GRIP)

S–211

Example of designation : STD – PIPE ND"
(S–211 – 10")

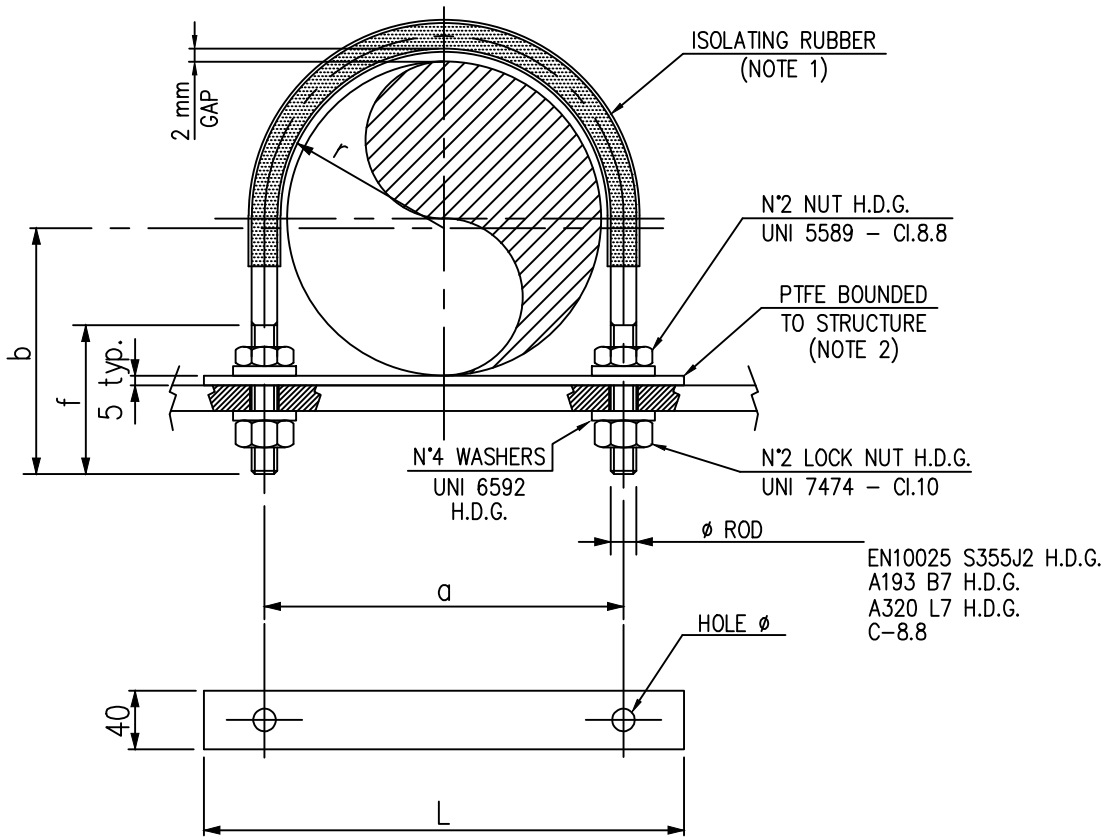

SIZE ND	ROD DIA	r	a	b	f	L	HOLE ø	DEV	DEV. RUBBER	WEIGHT Kg
½"	M8	14	36	55	52	65	10	167	62	0.16
3/4"	M8	17	42	55	52	70	10	176	75	0.16
1"	M8	20	48	60	55	80	10	196	90	0.18
1½"	M10	27	64	70	65	100	12	240	120	0.32
2"	M10	33	76	80	70	110	12	280	150	0.35
3"	M12	48	108	100	80	150	14	370	210	0.60
4"	M12	60	132	110	80	180	14	430	260	0.67
6"	M16	87	190	150	100	250	18	600	380	1.39
8"	M16	113	242	170	100	300	18	720	500	1.60
10"	M16	140	296	200	100	350	18	865	650	1.86
12"	M20	165	350	240	120	420	22	1030	750	3.31
14"	M20	181	382	260	120	450	22	1120	840	3.55
16"	M24	207	438	290	130	520	26	1270	1000	5.76
18"	M24	232	488	320	130	570	26	1410	1100	6.28
20"	M30	257	544	360	160	640	32	1570	1200	11.02
24"	M30	308	646	410	160	750	32	1830	1450	12.52

NOTES:

1) HEAT SHRINK TUBE TYPE FLAME RETARDANT, WITH RATIO 2:1
2) MULTIPLE SHEETS OF PTFE CAN BE ADDED IN ORDER TO ENSURE THE CORRECT ELEVATION AND SLOPE OF THE LINES.

Revision Number	Date	Description	DRAW	CHKD.	APPR.
00	–	ISSUED FOR REVIEW	SLO	GMA	MCO

Documento di proprietà aziendale.La Società tutelerà i propri diritti a termine di legge.This document is Company property. The Company lawfulliy reserves all rights.

7. WELDING REGISTER & MATERIAL TRACEABILITY RECORD

Welding Register

Job	123A90	BASE LOAD POWER HUB (BLPH)			
From Discipline	PP	Piping			
To Discipline	PP	Piping			
Drawings		**From**	5	**To**	5
Sheet		**From**	1	**To**	1
Marks		**From**		**To**	
Location		**From**		**To**	
Material		**From**		**To**	
Welds Execution		**From**		**To**	
Welds Acceptance		**From**		**To**	
Report Date		**From**		**To**	
Prefabrication	All				
Welding Status	All				
ITEM					
ADDITIONAL PARAMETERS	**LINE**	**From**		**To**	
	SPOOL	**From**		**To**	
		From		**To**	

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Cont.	Accept. Date	Spool
1/5/1/_		**01**	**16-01-2025**	**143**	**AX 453**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**C1A**	**GTAW**	**BW**	**21-01-2025**	
03HSS	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable					17-01-2025			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	001188	4	Acceptable					21-01-2025			
2/5/1/_		**01**	**04-10-2024**	**29**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**14-10-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					07-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000334	4	Acceptable					14-10-2024			
3/5/1/_		**01**	**11-10-2024**	**40**	**AZ36**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**22-10-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	RGARDINIT	100 %	OK		Acceptable					14-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000510	4	Acceptable					22-10-2024			
4/5/1/_		**01**	**04-10-2024**	**29**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**14-10-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					07-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000337	4	Acceptable					14-10-2024			
5/5/1/_		**01**	**11-10-2024**	**40**	**AZ36**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**22-10-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	RGARDINIT	100 %	OK		Acceptable					14-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000509	4	Acceptable					22-10-2024			
6/5/1/_		**01**	**04-10-2024**	**29**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**14-10-2024**	**A**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					07-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000336	4	Acceptable					14-10-2024			
7/5/1/_		**01**	**30-12-2024**	**111**	**AX416**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**C1A**	**GTAW**	**BW**	**02-01-2025**	
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable					31-12-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	001110	4	Acceptable					02-01-2025			
8/5/1/_		**01**	**03-10-2024**	**27-111**	**AZ53**			**FWN**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**C1A**	**GTAW**	**BW**	**08-01-2025**	
					AX416	**After Cutting**													
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					04-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000241	4	Acceptable					07-10-2024			
Cut 30-12-2024 Prod sh.111 AX416		VIS	C1 DTA	After Cutting		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable C1A		GTAW			31-12-2024			
		RT	C1 DTA	After Cutting		IDL-QCI-RT 0036 00	PR	100 %	001115	4	Repeat					03-01-2025			
		RT	DRF	After Film Repeat		IDL-QCI-RT 0036 00	PR	100 %	001128	2	Acceptable					08-01-2025			
9/5/1/_		**01**	**11-10-2024**	**40**	**AZ36**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**22-10-2024**	**B**

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Cont.	Accept. Date	Spool
9/5/1/_		**01**	**11-10-2024**	**40**	**AZ36**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**22-10-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	RGARDINIT	100 %	OK		Acceptable					14-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000511	4	Acceptable					22-10-2024			
10/5/1/_		**01**	**11-10-2024**	**40**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**22-10-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	RGARDINIT	100 %	OK		Acceptable					14-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000589	4	Acceptable					22-10-2024			
11/5/1/_		**01**	**04-10-2024**	**29**	**AZ36**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**14-10-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					07-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000335	4	Acceptable					14-10-2024			
12/5/1/_		**01**	**04-10-2024**	**29**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**14-10-2024**	**B**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					07-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	000333	4	Acceptable					14-10-2024			
13/5/1/_		**01**	**02-12-2024**	**60**	**AX416**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**D1A**	**GTAW**	**BW**	**12-12-2024**	
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable					03-12-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	001054	4	Acceptable					12-12-2024			
14/5/1/_		**01**	**09-10-2024**	**35**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**16-10-2024**	**C**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					10-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000397	4	Acceptable					16-10-2024			
15/5/1/_		**01**	**03-10-2024**	**27**	**AZ53**			**ELB**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**16-10-2024**	**C**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					04-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000398	4	Acceptable					16-10-2024			
16/5/1/_		**01**	**03-10-2024**	**27**	**AZ53**			**FWN**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**07-10-2024**	**D**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					04-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000242	4	Acceptable					07-10-2024			
17/5/1/_		**01**	**09-10-2024**	**35**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**16-10-2024**	**D**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable					10-10-2024			
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000399	4	Acceptable					16-10-2024			

Rosetti Marino S.p.A.

Welding Register

Job 123A90 BASE LOAD POWER HUB (BLPH)
Client CRWIND CROSSWIND
Discipline PP Piping

Order Number CW-I-WP4-2023-05
ITEM

Weld Number / Class	Insp. Category	Rev. / Cont.	Prod. Date / Examination phase	Prod. Sheet	Welders	Work Instructions	Oper.	Item type / Exam. %	Dimension / N. Rep	Thickness / Films n.	Bevel / Result	Weld Length / WPS Rip.	P/M / Techn. Weld.	Material / Defect length	WPS / CND date	Techn. Weld. / NOTE	Type Cont.	Accept. Date	Spool
17/5/1/_		**01**	**09-10-2024**	**35**	**AZ36**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**16-10-2024**	**D**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000400	4	Acceptable				16-10-2024				
19/5/1/_		**01**	**09-10-2024**	**35**	**AZ36**			**TEE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**16-10-2024**	**D**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				10-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000401	4	Acceptable				16-10-2024				
20/5/1/_		**01**	**03-10-2024**	**27**	**AZ53**			**PIPE**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**P**	**S.S.**	**C1A**	**GTAW**	**BW**	**07-10-2024**	**D**
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	SSANTUCCI	100 %	OK		Acceptable				04-10-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	AA	100 %	000243	4	Acceptable				07-10-2024				
66/5/1/_		**01**	**30-12-2024**	**111**	**AX416**			**FWN**	**1,00 in**	**3,38 mm**	**V**	**0,104 m**	**M**	**S.S.**	**C1A**	**GTAW**	**BW**	**02-01-2025**	
	1	VIS	FTP	FIT-UP and on weld		123A90-PML-QHSE-PRO-00103 Rev 00	LCOSCA	100 %	OK		Acceptable				31-12-2024				
		RT	FIN	Weld Completion		IDL-QCI-RT 0036 00	PR	100 %	001111	4	Acceptable				02-01-2025				

Totals per DWG	**5**	**Prefabrication**	**1,60 m**	**16 Nr. Welds**	**16,00 inch**
		Erection	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**2,10 m**	**21 Nr. Welds**	**21,00 inch**
		Accepted	**2,10 m**	**21 Nr. Welds**	**21,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Discipline		**Prefabrication**	**1,60 m**	**16 Nr. Welds**	**16,00 inch**
		Erection	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**2,10 m**	**21 Nr. Welds**	**21,00 inch**
		Accepted	**2,10 m**	**21 Nr. Welds**	**21,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
Totals by Project		**Prefabrication**	**1,60 m**	**16 Nr. Welds**	**16,00 inch**
		Erection	**0,50 m**	**5 Nr. Welds**	**5,00 inch**
		Offshore	**0,00 m**	**0 Nr. Welds**	**0,00 inch**
		Performed	**2,10 m**	**21 Nr. Welds**	**21,00 inch**
		Accepted	**2,10 m**	**21 Nr. Welds**	**21,00 inch**
		Repaired	**0,00 m**	**0 Nr. Welds**	**0,00 inch**

Cliente/Contractor	**CROSSWIND**	Preparato da/Prepared by	Controllato da/Checked by	Approvato da/Approved by
SubContrattista/SubContractor	**ROSETTIMARINO/GROUPOFCOMPANY**	Nome/Name:	Nome/Name:	Nome/Name:
Progetto/Project	**Hollandse Kust Noord Wind Park Project**			
Commessa/Job	**123A90 - Piping**			
Disciplina/Discipline	**PIPING**	Antonio Galesi		
TitoloDocumento/DocumentTitle	**Material Traceability Report**	StatoDocumento/Document Status:		Data/Date:
RosettiDoc.Num.	**123A90MTR001**			25/01/2025

Sketch no.	Rev.	sheet	Spool	Piping Class	pos.	Q.ty (n° - m)	Description	Heat/Serial Number	PurchaseOrder	Pos. Order	Mat. Certificate	Weld Ref.	Note
5	01	1	A	03HSS	3	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W2-W3	
5	01	1	A	03HSS	3	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W4-W5	
5	01	1	A	03HSS	3	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W6	
5	01	1	A	03HSS	1A	0,065	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	1	A	03HSS	1B	0,443	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	1	A	03HSS	1C	0,563	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	1	B	03HSS	3	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W8-W9	
5	01	1	B	03HSS	3	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W10-W11	
5	01	1	B	03HSS	3	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W12	
5	01	1	B	03HSS	1D	1,053	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	1	B	03HSS	1E	2,769	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	1	B	03HSS	1F	0,625	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	1	C	03HSS	3	1	90 Deg Elbow Long Radius BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	M230689	1724000839	00270	MCP2401-00015-52	W14-W15	
5	01	1	C	03HSS	4	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DJ346	1724000839	01010	12/230039622/57/REV-00	W15	
5	01	1	C	03HSS	1G	0,634	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	1	D	03HSS	2	1	Tee BW ›1" Thk.3.38mm ASTM A403 Gr.WP316/316L	66A-SWJ011	1724000839	00480	T202318000110	W17-W18-W19	
5	01	1	D	03HSS	4	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DJ346	1724000839	01010	12/230039622/57/REV-00	W16	
5	01	1	D	03HSS	4	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DJ346	1724000839	01010	12/230039622/57/REV-00	W18	
5	01	1	D	03HSS	4	1	Flange WN ›1" Thk.3.38mm 300LB RF ASTM A182 Gr.F316/316L	DJ346	1724000839	01010	12/230039622/57/REV-00	W19	
5	01	1	D	03HSS	1H	0,1	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		
5	01	1	D	03HSS	1I	0,462	Pipe 33.4mm(1") thk.3.38mm ASTM A312 Gr.TP316/316L	235689	1724000839	00050	WSSL/SP-316L/0923/1223		

8. PIPING & VESSEL PRE-COMMISSIONING CONFORMITY CHECKS & TESTS:

8.1 CLX02A - Pipework Before test

8.2 CLX02B - Pipework After Test

8.3 CXX01 - Thermal insulation – NOT APPLICABLE

8.4 CXX02 – Painting Line

8.5 TMX03 – Cleaning

8.6 TMX05 – Pressure test

8.7 TMX25 – Gross Air Leak Test

8.8 TMX27 – Bolt Tensioning / Torquing

8.9 TPLX05 - Drying

ITEM	Tag	25-07-TP-068	: Test Pack 25-07-TP-068			Dwg	123A90-DDL-PR-PID-80011
	S/Sys	25-07	: Hydrogen Storage Vessels Header (Inlet)			Module	UD
TASK	code	C10004799		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	MC	Activity STS	Discipline	Piping	Form	TPLX05 Drying

1	Drying out method :	Drying with dry air.
2	Operation description :	Dried the system using a flow of dry air, ensuring all drains/vents (when present) were open to facilitate the removal of moisture. Continued the drying until no moisture remained in the system, particularly in areas that were difficult to reach. After drying, inlet and outlet points were closed with covers.
3	Temporary means :	Blind flanges and plugs, if necessary, to isolate inlet and outlet points during process. Covers to close all openings after the drying.
4	Dew point (obtain after soaking and nitrogen purging):	NA
5	Valve body cavity, branches, etc.. Have been drained form residual water	●
	Attachments	
6	Procedures	
7	Sketches and drawings	
8	Pressure records	
9	Records of failures	
10	SAFETY PRECAUTIONS:	Restricting access to the area.
11	REMARKS:	None

Page 1/1	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RODEO	RM (ROSETTI MARINO)	
Name	Emanuele Delfino	Lorenzo Novaga	
Date	2025-01-31	2025-02-03	
Signature	PROVERLIS Digitaly signed by Emanuele Delfino 2025-01-31T14:25:40.827Z	PROVERLIS Digitaly signed by Lorenzo Novaga 2025-02-03T09:34:53.711Z	

Section 11 MECHANICAL COMPLETION INDEX - SAFETY DISCIPLINE

NOT APPLICABLE

Section 12 FAT / VENDOR REPORTS

NOT APPLICABLE

Section 13 MECHANICAL COMPLETION CHANGES / MARK-UPS

NOT APPLICABLE