
CROSSWIND

ROSETTI MARINO

PROVERUS

PROJECT **123A90 - HOLLANDSE KUST NOORD WIND PARK**
BLPH Project

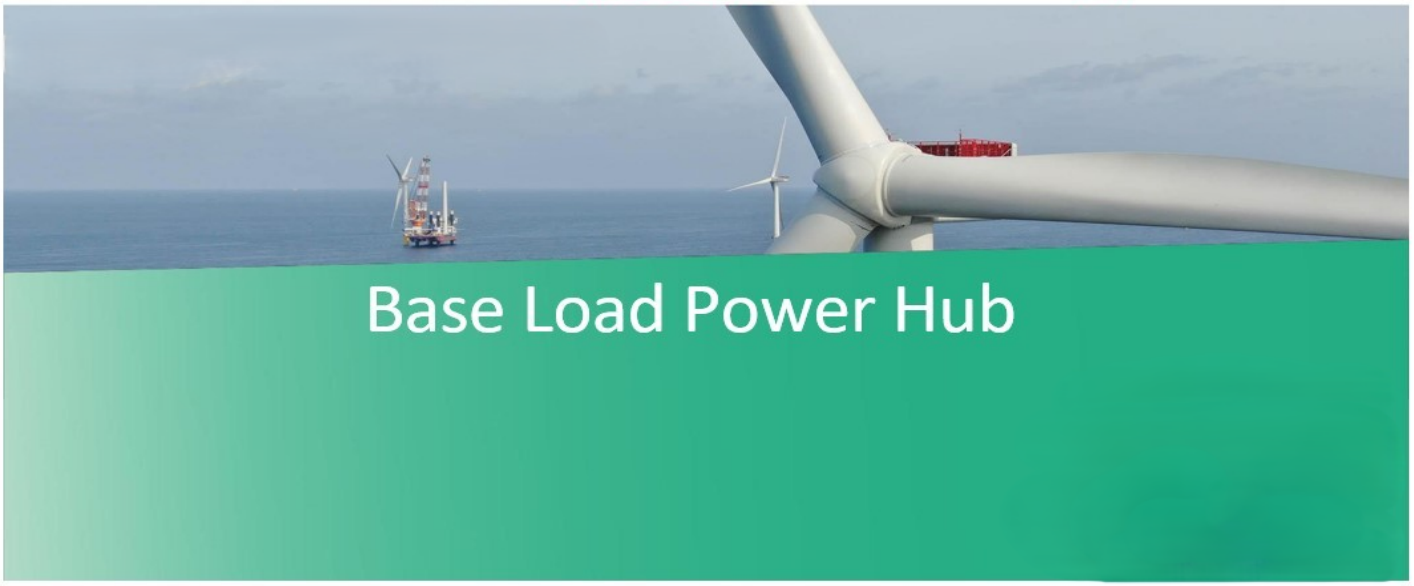

COMMISSIONING DOSSIER (ONSHORE)

SYSTEM	70 Safety and Facility Systems
SUBSYSTEM	70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

CROSSWIND

123A90 - HOLLANDSE KUST NOORD WIND PARK
BLPH Project

COMMISSIONING DOSSIER INDEX

ROSETTI MARINO

Sub System N°:	70-17	**Tick as appropriate**	ONSHORE	OK
Description:	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)		OFFSHORE	


1. *SUB-SYSTEM DEFINITION*	OK
1.1 Sub-System Description / Boundary Limit Drawings	
2. *READY FOR OPERATION CERTIFICATE*	OK
2.1 Achievement Of Ready for Operation Certificate (RFO)	
2.2 Exception Punch Lists (per discipline)	
2.3 “As-Commissioned” P&ID’s / SLD’s / D&ID’s / C&E’s	
3. *CONSOLIDATED PUNCH LISTS*	OK
3.1 Cleared and Residual Items (sorted by discipline)	
4. *FUNCTIONAL TESTS SHEETS*	OK
4.1 Electrical functional test sheets index	
4.2 Electrical “As-Commissioned” interconnection diagrams	
4.3 Instrumentation Functional Test Sheets Index	
4.4 Instrumentation “As-Commissioned” interconnection diagrams	
4.5 Telecommunication Functional Test Sheets Index	
4.6 Telecommunication “As-Commissioned” I.C.D. / TSLD’s	
5. *SITE / OPERATIONAL:*	OK
5.1 Operational Test Procedure	
5.2 Operational Test Certificates	
6. *PIPING AND VESSEL PREPARATION*	NA
6.1 Final Mechanical / Vessel Inspection Checks Index	
6.2 Leak Test / Drying / Inerting Test Sheets Index	
6.3 Chemical Loading & First Fill records Index	
6.4 Chemical Cleaning Reports and Records Index	
6.5 Lubrication Schedule	
7. *VENDORS*	OK
7.1 Vendor Package Summary Index	
7.2 SAT Procedure with associated punch list and reference (Front Page)	
7.3 Vendor Spares & Special Tools lists references	
7.4 Vendor Data / Operations / Maintenance Manuals References	
8. *LIST OF MODIFICATIONS*	NA
8.1 List of changes initiated during the WORKSITE Commissioning phase pertaining to the relevant Sub-System will be incorporated in this section with relevant references (with location and position of blinds/spades, isolation LO & LC valves, list of electrical isolation status, and remaining inhibits and overrides)	
9. *SUPPORTING DOCUMENTS*	NA
9.1 Other supporting documents (as applicable)	

	Contractor Commissioning Site Leader	Company Commissioning Site Leader
Name	Anthony Iveson	Martin Taylor
Date	2025-07-10	2025-07-10
Signature	PROVERLIS Digitaly signed by Anthony Iveson 2025-07-10T06:34:37.143Z	PROVERLIS Digitaly signed by Martin Taylor 2025-07-10T07:11:55.221Z

Section 1 SUB-SYSTEM DEFINITION

DRAWING NO. 123A90-DDL-PP-DL-30027

REV. 01

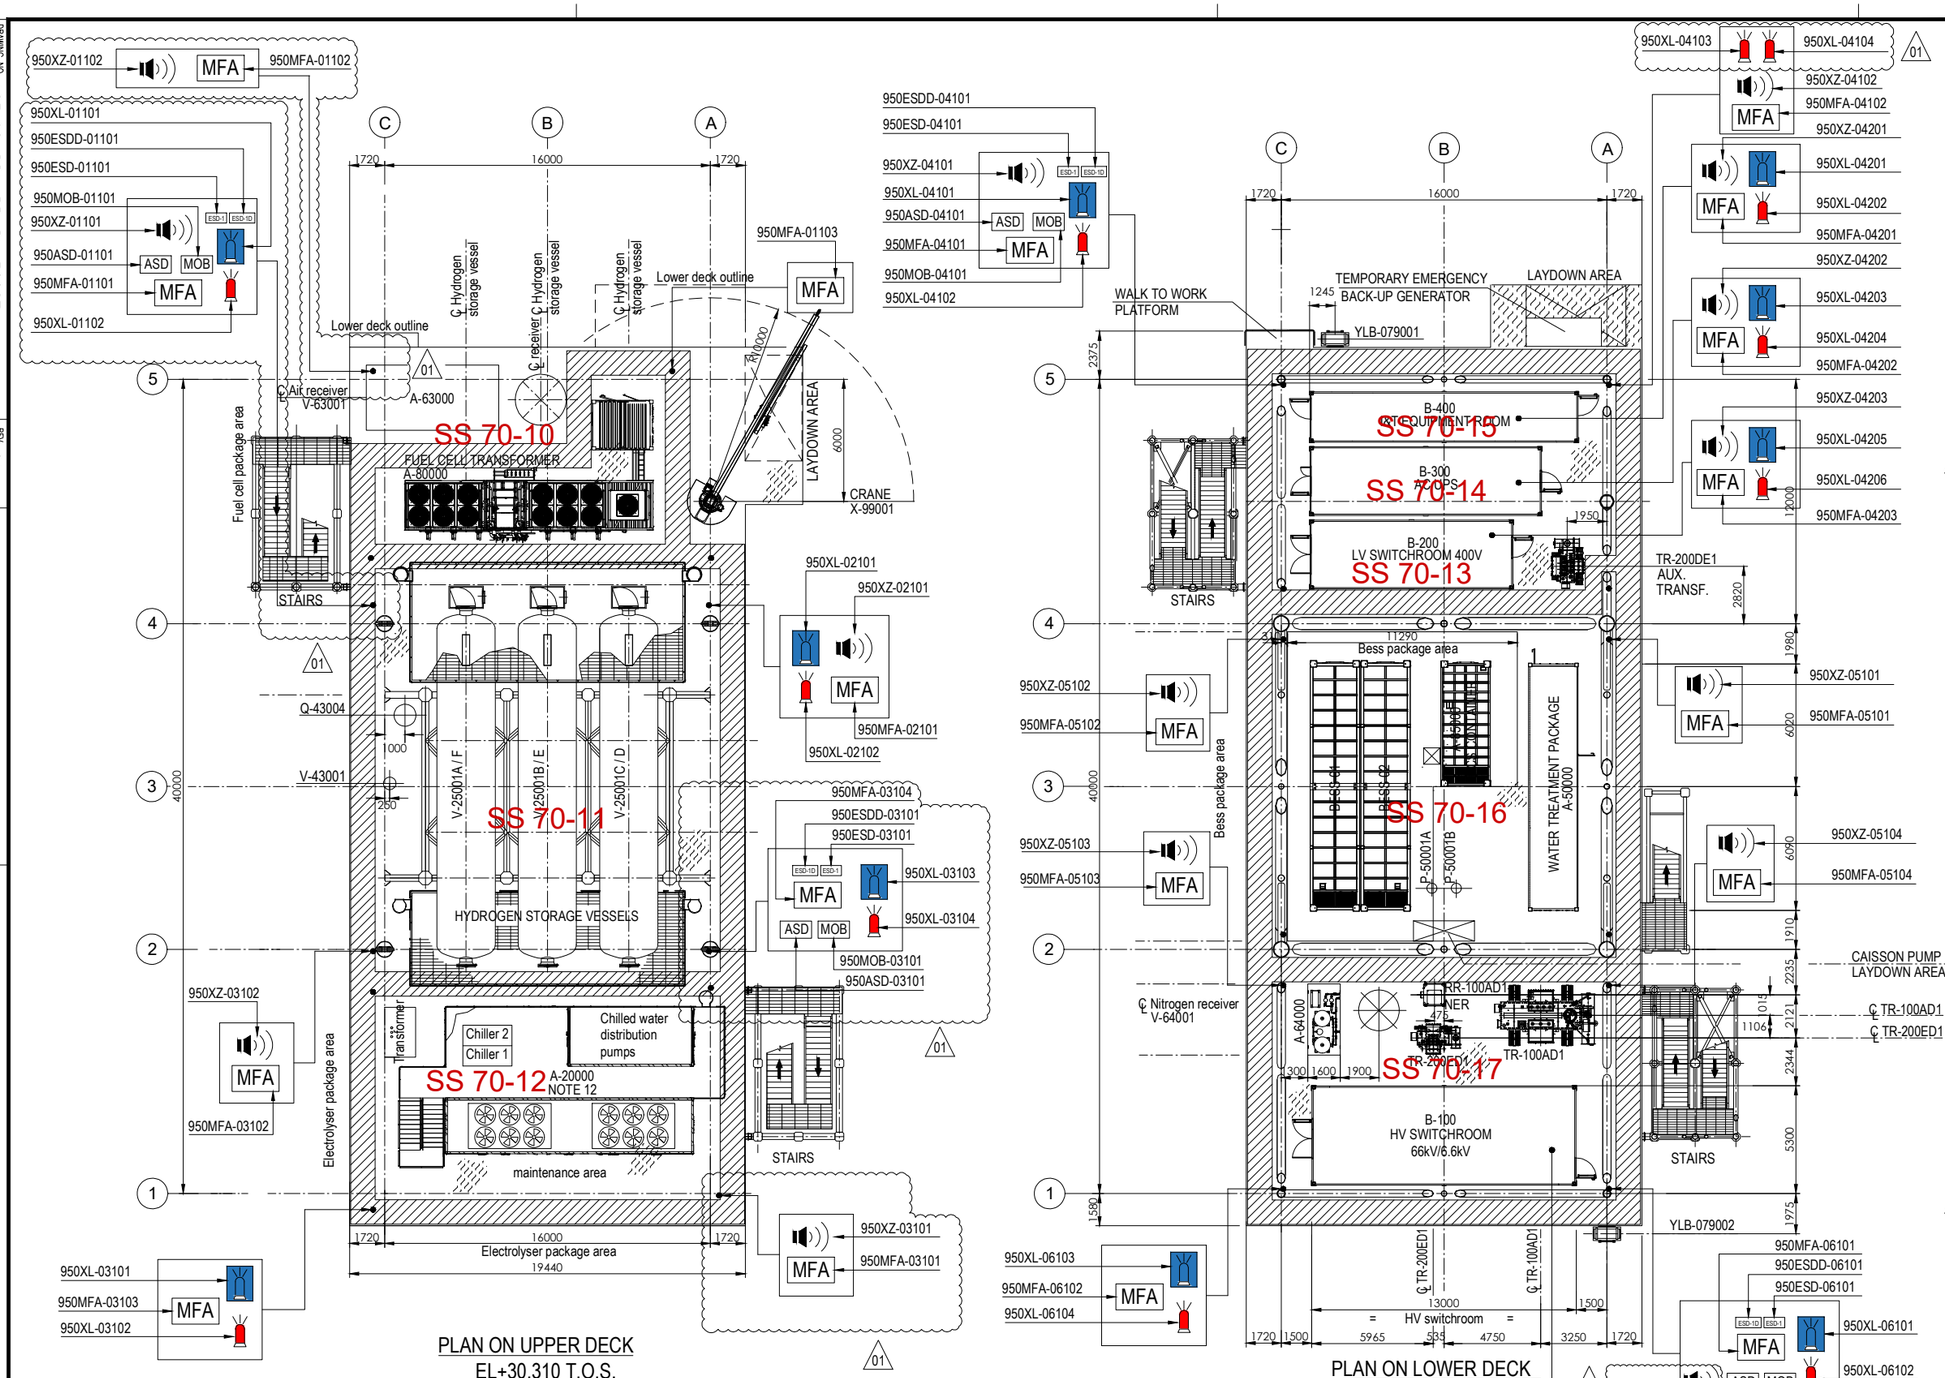

NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. VENDOR TO DEFINE AND SUPPLY ALL FIRE & GAS DETECTORS TO BE USED IN FUEL CELL, ELECTROLYSER AND BESS. TO BE IN COMPLIANCE WITH PROJECT REQUIREMENTS. THESE WILL BE SHOWN IN THE NEXT REVISON OF THE DOCUMENT.
4. PERSONNEL EXPECTED TO USE HANDHELD HYDROGEN AND LOW OXYGEN DETECTORS WHEN WORKING IN CONFINED SPACES ENTRY.
01. 5. DETAIL LOCATION IS SHOWN IN THE 3D MODEL.

ELEVATION

1. ALL BUTTONS ARE 1.5M TOP
2. SOUNDERS AND BEACON ARE 2.4/2.5M

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
01 123A90-DDL-SAF-RE-30020	FERA REPORT

EQUIPMENT LIST

TAG NUMBER	DESCRIPTION	TAG NUMBER	DESCRIPTION
A-20000	ELECTROLYSER	TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV
A-63000	INSTRUMENT AIR PACKAGE	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV
A-80000	FUEL CELL	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT
A-85000	BESS	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR
A-50000	WATER TREATMENT PACKAGE	V-63001	AIR RECEIVER
P-50001A/B	SEAWATER LIFT PUMPS	V-64001	NITROGEN RECEIVER
Q-43004	HYDROGEN VENT	X-99001	CRANE
A-64000	NITROGEN SYSTEM		
V-25001A-F	HYDROGEN STORAGE VESSELS		
V-43001	HYDROGEN VENT KO DRUM		
YLB-079001/2	LIFE RAFTS		
B-100	HV/MV SWITCHROOM 66kV/6.6kV		
B-200	LV SWITCHROOM 400V		
B-300	AC UPS EQUIPMENT ROOM		
B-400	I&T EQUIPMENT ROOM		

SYMBOL	DESCRIPTION	QTY.	SYMBOL	DESCRIPTION	QTY.
	SOUNDER (XZ)	11		FIRE BEACON (XL)	8
MOB	MAN OVER BOARD (MOB)	4		FLAMMABLE GAS RELEASE BEACON (XL)	8
ASD	ABANDON SHUTDOWN (ASD)	4	ESD-1	ESD-1 PUSH BUTTON (ESD)	4
MFA	MANUAL FIRE ALARM (MFA)	16	ESD-1D	ESD-1D PUSH BUTTON (ESDD)	4

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	10/07/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	12/02/24	MMA	CCA	DLO	ISSUE FOR APPROVAL (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :


F & G DETECTORS LAYOUT - LOWER & UPPER DECK

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 10/07/24
A1	DRAWING NO. 123A90-DDL-SAF-DL-30027	SHEET 002	REV. 01


File Name : 123A90-DDL-SAF-DL-30027 Rev.01

DRAWING NO. 123A90-DDL-PP-DL-30027


REV. 00

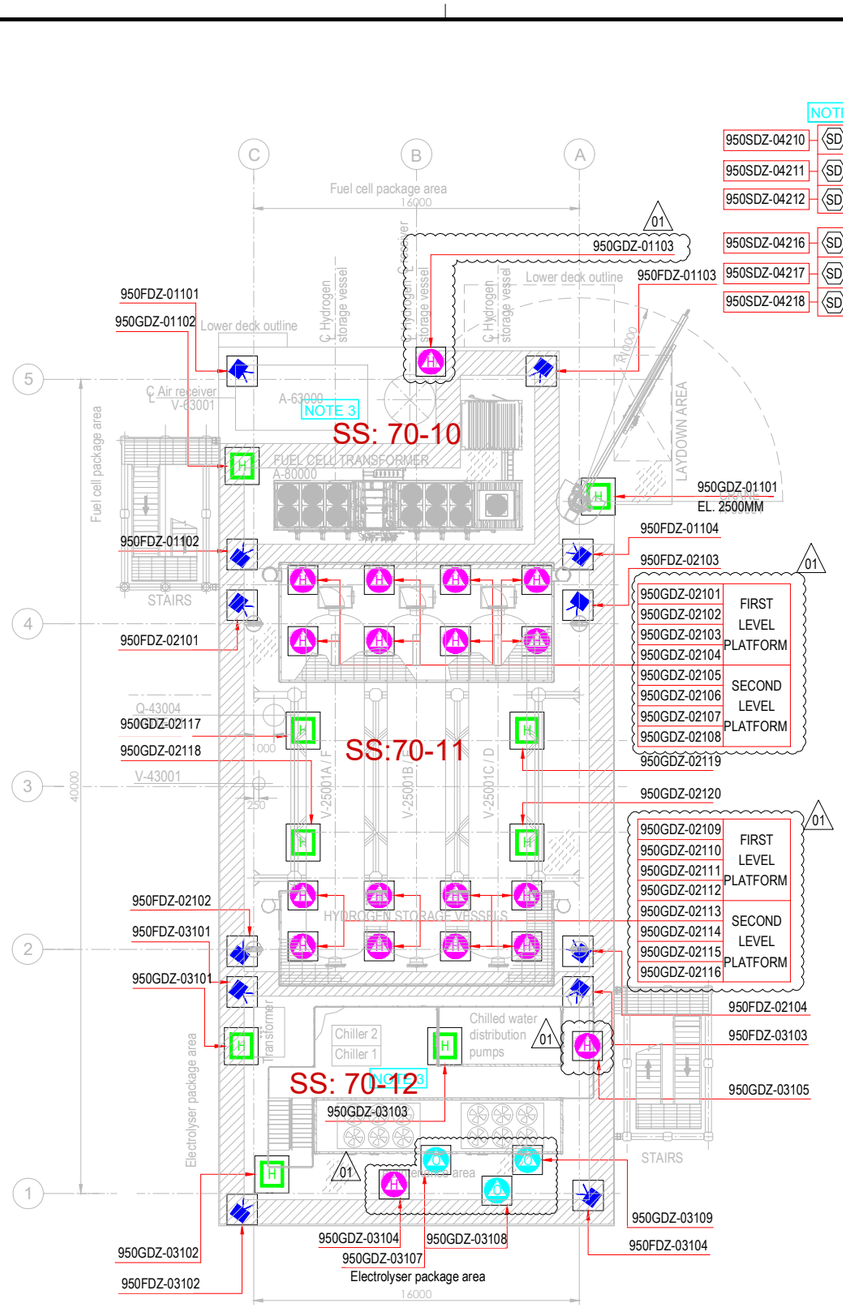

PLAN ON UPPER DECK
EL+30.310 T.O.S.

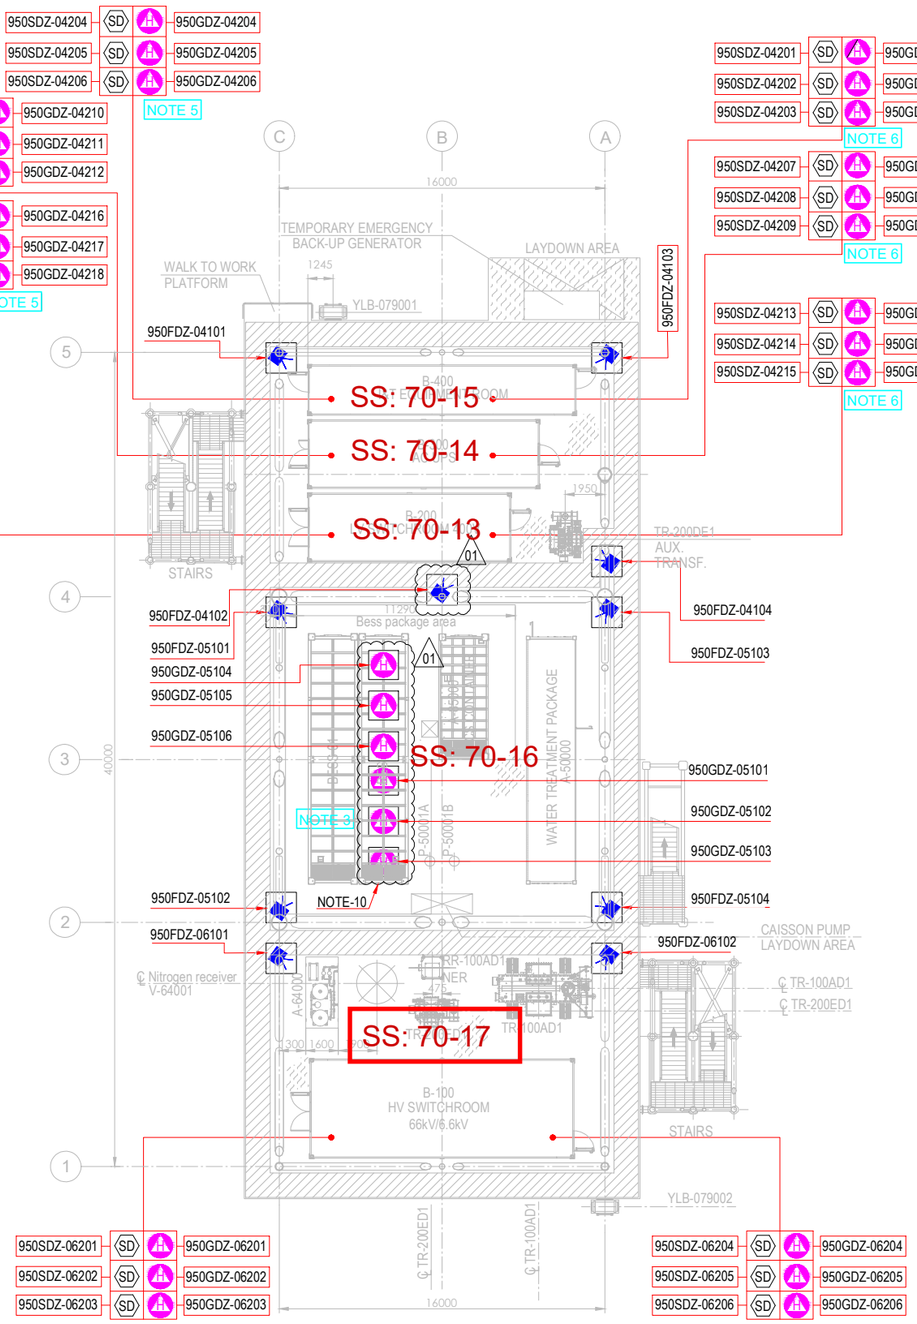

PLAN ON LOWER DECK
EL+23.310 T.O.S.

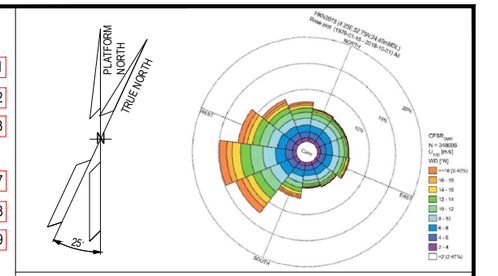

NOTES

1. ALL DIMENSIONS IN mm U.N.O
2. ALL ELEVATIONS IN METERS.
3. VENDOR TO DEFINE AND SUPPLY ALL FIRE & GAS DETECTORS TO BE USED IN FUEL CELL, ELECTROLYSER AND BESS. TO BE IN COMPLIANCE WITH PROJECT REQUIREMENTS. THESE WILL BE SHOWN IN THE NEXT REVISON OF THE DOCUMENT.
4. PERSONNEL EXPECTED TO USE HANDHELD HYDROGEN AND LOW OXYGEN DETECTORS WHEN WORKING IN CONFINED SPACES ENTRY.
5. F&G LAYOUTS FOR I&T EQUIPMENT ROOM, AC UPS, LV SWITCH ROOM AND HV/MV SWITCHROOM CONTAINERS LOCATED AT DOOR ENTRANCE OF EACH ROOM (2003) AND START ABANDON. (01)
6. SMOKE DETECTORS (2003) AND POINT SOURCE HYDROGEN DETECTORS (2003) TO BE PROVIDED AROUND HVAC INLET AREAS AND UPON CONFIRMED DETECTION CLOSE DAMPERS TO ROOMS.
7. ULTRASONIC H2 DETECTORS TO BE LOCATED ON VALVE ACCESS PLATFORMS FOR H2 STORAGE VESSELS.
8. POINT SOURCE H2 DETECTORS TO BE LOCATED ON VALVE ACCESS PLATFORM FOR H2 STORAGE VESSELS.
9. EXACT LOCATION OF F&G DETECTORS AND DEVICES IS SHOWN IN THE 3D MODEL. (01)
10. LOCATION OF THE 6 SENSOR (950GDZ-05101/102/103/104/105/106) AT CEALING ABOVE BESS ROOF, TO AVOID GAS ACCUMULATION AT POCKETS

ELEVATION

FDZ = 2.0m El.
GDZ = 2.5m El. INSIDE THE COTAINER
SDZ = 2.0m El.

HOLDS

REFERENCE DOCUMENTS

123A90-DDL-PP-DS-70070	PLOT PLAN - LOWER & UPPER DECK
123A90-DDL-PP-DS-70071	PLOT PLAN - BELOW LOWER DECK
123A90-DDL-SAF-RE-30020	FERA REPORT (01)

EQUIPMENT LIST

TAG NUMBER	DESCRIPTION	TAG NUMBER	DESCRIPTION
A-20000	ELECTROLYSER	TR-200DE1	TRANSFORMER AUX. 6.6kV/0.4kV
A-63000	INSTRUMENT AIR PACKAGE	TR-200ED1	SOLAR TRANSFORMER PV FARM EQUIPMENT
A-80000	FUEL CELL	RR-100AD1-NER	NEUTRAL EARTHING RESISTOR
A-85000	BESS	V-63001	AIR RECEIVER
A-50000	WATER TREATMENT PACKAGE	V-64001	NITROGEN RECEIVER
P-50001A/B	SEAWATER LIFT PUMPS	X-99001	CRANE
Q-43004	HYDROGEN VENT		
A-64000	NITROGEN SYSTEM		
V-25001A-F	HYDROGEN STORAGE VESSELS		
V-43001	HYDROGEN VENT KO DRUM		
YLB-079001/2	LIFE RAFTS		
B-100	HV/MV SWITCHROOM 66kV/6.6kV		
B-200	LV SWITCHROOM 400V		
B-300	AC UPS EQUIPMENT ROOM		
B-400	I&T EQUIPMENT ROOM		
TR-100AD1	TRANSFORMER MAIN 66kV/6.6kV		

SYMBOL	DESCRIPTION	QTY.
	UV-IR FLAME DETECTOR (FDZ)	22 (01)
	POINT SOURCE HYDROGEN DETECTOR (GDZ)	46 (01)
SD	SMOKE DETECTOR (SDZ)	24
	POINT SOURCE OXYGEN DETECTOR (GDZ)	3
H	ULTRA SONIC HYDROGEN DETECTOR (GDZ)	9 (01)

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	10/07/24	MMA	CCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	12/02/24	MMA	CCA	DLO	ISSUE FOR APPROVAL (IFA)

CROSSWIND

ROSETTI MARINO

TITLE :

F & G DETECTORS LAYOUT - LOWER & UPPER DECK

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:150
DRAWN	CHECKED C. CARACCIOLO	APPROVED D. LO STERZO	DATE 10/07/24
A1	DRAWING NO. 123A90-DDL-SAF-DL-30027	SHEET 001	REV. 01

File Name : 123A90-DDL-SAF-DL-30027 Rev.01

Section 2 READY FOR OPERATION

Section 2.1 Achievement Of Ready for Operation Certificate (RFO)

ROSETTI MARINO

123A90 - HOLLANDSE KUST NOORD WIND PARK
BLPH Project

CROSSWIND

Ready For Operation (RFO) Certificate

COMPLETE	●	PARTIAL	

Revision:	5		Issued on:	2025-07-09	
System:	70	/	Safety and Facility Systems		
SubSystem:	70-17	/	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)		

We hereby confirm that all Mechanical Completion (MC) and Pre-Commissioning/Commissioning (Pre-Comm./Comm.) activities for the above-mentioned System/Sub-System have been successfully completed in accordance with project specifications, relevant standards and contractual requirements. The System/Sub-System has been tested and verified to ensure readiness for operation. Issuance of this Certificate shall not release CONTRACTOR from any of his obligations, responsibilities or liabilities under the CONTRACT.

Mechanical Completion: All required MC activities have been completed and approved
Pre-Commissioning & Commissioning: All required Pre-Comm. and Comm. activities and OTPs have been completed and approved (Status Index attached)
Punch List: All Punch items categorized as A and B have been cleared (PL report attached)
Documentation: As-built documentation and Commissioning dossier has been completed, reviewed and approved

PUNCH LIST	PENDING POINTS
Note: All Category "A" and "B" Items must be cleared prior to issuance of the Ready For Operation (RFO) Certificate	B '0

REMARKS:

	CONTRACTOR Commissioning Manager	**COMPANY** Commissioning Lead
Name	Anthony Iveson	Martin Taylor
Date	2025-07-09	2025-07-09
Signature	PROVERLIS Digitaly signed by Anthony Iveson 2025-07-09T13:35:06.771Z	PROVERLIS Digitaly signed by Martin Taylor 2025-07-09T13:35:38.585Z

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

STATUS INDEX DETAIL

Filtered on subsystem: 70-17 & process: COMM

Instrumental	70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)						
ITEM		TASK					
Code	Description	Location	Code	Form	Progress	Date	Certificate
77-HY-001	B-100 Fire Damper AHU1 Inlet Air	ONSHORE	C10003776	FJ01D	100	2025-07-09	RFO 5
77-HY-002	B-100 Fire Damper AHU2 Inlet Air	ONSHORE	C10003778	FJ01D	100	2025-03-11	RFO 5
77-HY-003	B-100 Fire Damper Exhaust Air	ONSHORE	C10003780	FJ01D	100	2025-03-11	RFO 5
77-ZSL-001	B-100 Fire Damper AHU1 Inlet Air	ONSHORE	C10003777	FJ01D	100	2025-05-22	RFO 5
77-ZSL-002	B-100 Fire Damper AHU2 Inlet Air	ONSHORE	C10003779	FJ01D	100	2025-03-11	RFO 5
77-ZSL-003	B-100 Fire Damper Exhaust Air	ONSHORE	C10003781	FJ01D	100	2025-03-11	RFO 5
950-FDZ-06101	Flame Detector - FZ-06 B-100 Area	ONSHORE	C10003134	FJ04F	100	2025-01-11	RFO 5
950-FDZ-06102	Flame Detector - FZ-06 B-100 Area	ONSHORE	C10004856	FJ04F	100	2025-01-30	RFO 5
950-GDZ-06201	H2 GD FZ-06 B-100 HVAC Air Intake	ONSHORE	C10003078	FJ04G	100	2025-01-11	RFO 5
950-GDZ-06202	H2 GD FZ-06 B-100 HVAC Air Intake	ONSHORE	C10003077	FJ04G	100	2025-01-11	RFO 5
950-GDZ-06203	H2 GD FZ-06 B-100 HVAC Air Intake	ONSHORE	C10003076	FJ04G	100	2025-02-11	RFO 5
950-GDZ-06204	H2 GD FZ-06 B-100 Ambient	ONSHORE	C10003075	FJ04G	100	2025-01-17	RFO 5
950-GDZ-06205	H2 GD FZ-06 B-100 Ambient	ONSHORE	C10003074	FJ04G	100	2025-01-11	RFO 5
950-GDZ-06206	H2 GD FZ-06 B-100 Ambient	ONSHORE	C10003073	FJ04G	100	2025-01-11	RFO 5
950-MFA-06101	FZ-06 MFA Activation	ONSHORE	C10004432	FJ04PB_FGS	100	2025-01-11	RFO 5
950-MFA-06102	FZ-06 MFA Activation	ONSHORE	C10004433	FJ04PB_FGS	100	2025-01-11	RFO 5
950-MFA-06201	FZ-06 MFA Activation - B-100 Indoor	ONSHORE	C10004434	FJ04PB_FGS	100	2025-01-11	RFO 5
950-SDZ-06201	Smoke Detector - FZ-06 B-100 HVAC Air Intake	ONSHORE	C10003054	FJ04S	100	2025-01-28	RFO 5
950-SDZ-06202	Smoke Detector - FZ-06 B-100 HVAC Air Intake	ONSHORE	C10003053	FJ04S	100	2025-01-28	RFO 5
950-SDZ-06203	Smoke Detector - FZ-06 B-100 HVAC Air Intake	ONSHORE	C10003052	FJ04S	100	2025-01-28	RFO 5
950-SDZ-06204	Smoke Detector - FZ-06 B-100 Ambient	ONSHORE	C10003051	FJ04S	100	2025-01-28	RFO 5
950-SDZ-06205	Smoke Detector - FZ-06 B-100 Ambient	ONSHORE	C10003050	FJ04S	100	2025-01-28	RFO 5
950-SDZ-06206	Smoke Detector - FZ-06 B-100 Ambient	ONSHORE	C10003049	FJ04S	100	2025-01-28	RFO 5
950-XL-06101	FZ-06 Gas Beacon Activation	ONSHORE	C10004452	FJ04FB	100	2025-01-11	RFO 5
950-XL-06102	FZ-06 Fire Beacon Activation	ONSHORE	C10004453	FJ04FB	100	2025-01-11	RFO 5
950-XL-06103	FZ-06 Gas Beacon Activation	ONSHORE	C10004454	FJ04FB	100	2025-01-11	RFO 5
950-XL-06104	FZ-06 Fire Beacon Activation	ONSHORE	C10004455	FJ04FB	100	2025-01-11	RFO 5
950-XL-06201	FZ-06 Gas Beacon Act. - B-100 Indoor	ONSHORE	C10004456	FJ04FB	100	2025-01-11	RFO 5
950-XL-06202	FZ-06 Fire Beacon Act. - B-100 Indoor	ONSHORE	C10004457	FJ04FB	100	2025-01-11	RFO 5

Project CROSSWIND

STATUS INDEX DETAIL

Filtered on subsystem: 70-17 & process: COMM

Instrumental	70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)						
ITEM		TASK					
Code	Description	Location	Code	Form	Progress	Date	Certificate
950-XZ-06101	FZ-06 Sounder Activation	ONSHORE	C10004473	FJ04MS	100	2025-02-11	RFO 5
950-XZ-06201	FZ-06 Sounder Act. - B-100 Indoor	ONSHORE	C10004474	FJ04MS	100	2025-02-11	RFO 5

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 70 Safety and Facility Systems

SUBSYSTEM 70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30000998	A	C-950-MFA-061 01/950-JE-0610 2	Cable is damage internal the cable gland side (950-JE-06102), and side (950-MFA-06101)the cable was overtightened . See attached photo.	.		Gtangianu 2024-11-28	2024-12-07	Ecarotenuto 2024-12-07	2024-12-07
C30001020	A	950-MFA-06102 C10001070	Missing one bolt on the cover instrument. (950-MFA-06102) see attached photo.	.		Gtangianu 2024-11-28	2024-12-07	Ecarotenuto 2024-12-07	2024-12-07
C30001323	A	C-950-XZ-06201 /950-JE-06203 C10000351	That cable gland are not closed in accordance with specification. side C-950-XZ-06201	.		APolo 2024-12-04	2024-12-11	Ecarotenuto 2024-12-11	2024-12-11
C30000564	B	C-950-SDZ-062 01/950-JE-0620 4	Nylon sheet is missing on mechanical support of secondary cable trays.	.		APolo 2024-11-18	2025-02-13	AAndreani 2025-02-13	2025-02-13
C30000565	B	C-950-SDZ-062 01/950-JE-0620 4	Plastic cable ties to be replaced on external routing.	.		APolo 2024-11-18	2024-12-23	Ecarotenuto 2024-12-23	2024-12-23
C30000566	B	C-950-SDZ-062 01/950-JE-0620 4	Missing tag SS project on the cable near the instrument.	.		APolo 2024-11-18	2024-12-23	Ecarotenuto 2024-12-23	2024-12-23
C30000567	B	C-950-SDZ-062 02/950-JE-0620 4	Missing interposing nylon plate between dissimilar conducting materials	.		APolo 2024-11-18	2025-02-21	APolo 2025-02-21	2025-02-21
C30000568	B	C-950-SDZ-062 02/950-JE-0620 4	The Plastic ties , on external routing cable , to be replaced with stainless steel. .	.		APolo 2024-11-18	2024-12-23	Ecarotenuto 2024-12-23	2024-12-23
C30000569	B	C-950-SDZ-062 02/950-JE-0620 4	Missing cable tag SS project, near the instrument	.		APolo 2024-11-18	2024-12-23	Ecarotenuto 2024-12-23	2024-12-23

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 70 Safety and Facility Systems

SUBSYSTEM 70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30000570	B	C-950-SDZ-06203/950-JE-06204	Missing interposing nylon plate between dissimilar conducting materials	.		APolo 2024-11-18	2025-02-21	APolo 2025-02-21	2025-02-21
C30000571	B	C-950-SDZ-06203/950-JE-06204	The plastic fixing ties , on external routing cable , to be replaced with stainless steel	.		APolo 2024-11-18	2024-12-23	Ecarotenuto 2024-12-23	2024-12-23
C30000572	B	C-950-SDZ-06203/950-JE-06204	Missing cable tag SS project, near the instrument	.		APolo 2024-11-18	2024-12-23	Ecarotenuto 2024-12-23	2024-12-23
C30000692	B	950-SDZ-06206 C10001101	the earth cable is not fixed to the instrument	.		APolo 2024-11-21	2024-12-30	Gtangianu 2024-12-30	2024-12-30
C30000978	B	950-XZ-06101 C10001142	earthing cable need to be fixed.	.		Gtangianu 2024-11-27	2025-01-20	APolo 2025-01-20	2025-01-20
C30000979	B	C-950-XZ-06101/950-JE-06103 C10000343	Identification tag wires missing side the (XZ-06101).	.		Gtangianu 2024-11-27	2025-02-24	JKrizanic 2025-02-24	2025-02-24
C30000980	B	C-950-XZ-06101/950-JE-06103 C10000343	Missing cable tag all along the route.	.		Gtangianu 2024-11-27	2025-01-29	APolo 2025-01-29	2025-01-29
C30000981	B	C-950-XZ-06101/950-JE-06103 C10000343	Cable (C-950-XZ-06101/950-JE-06103) needs to be better dressed on all routing . See attached photo.	.		Gtangianu 2024-11-27	2025-01-20	APolo 2025-01-20	2025-01-20
C30000994	B	C-950-XL-06102/950-JE-06103 C10000345	Missing cable tag all along the route.	.		Gtangianu 2024-11-28	2025-01-29	APolo 2025-01-29	2025-01-29

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 70 Safety and Facility Systems
SUBSYSTEM 70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30000995	B	C-950-XL-06102 /950-JE-06103 C10000345	cable need to be arranged better under the instrument (950-XL-06102)	.		Gtangianu 2024-11-28	2025-01-20	APolo 2025-01-20	2025-01-20
C30000996	B	C-950-XL-06101 /950-JE-06103 C10000344	Missing cable tags on all routing. (C-950-XL-06101/950-JE-06103).	.		Gtangianu 2024-11-28	2025-01-29	APolo 2025-01-29	2025-01-29
C30000997	B	950-XL-06101 C10001120	Earthing cable need to be fix. (950-XL-06101).	.		Gtangianu 2024-11-28	2025-01-20	APolo 2025-01-20	2025-01-20
C30000999	B	C-950-MFA-061 01/950-JE-0610 2	Missing cable tags on all routing.	.		Gtangianu 2024-11-28	2025-01-29	APolo 2025-01-29	2025-01-29
C30001004	B	C-950-MFA-061 02/950-JE-0610 2	The cable is too long under the instrument (950-MFA-06102). See attached photo.	.		Gtangianu 2024-11-28	2025-01-20	APolo 2025-01-20	2025-01-20
C30001018	B	950-MFA-06102 C10001070	The instrument has paint damage . See attached photo.	.		Gtangianu 2024-11-28	2025-04-04	Gtangianu 2025-04-04	2025-04-04
C30001019	B	C-950-MFA-061 02/950-JE-0610 2	Missing cable tags on all routing.	.		Gtangianu 2024-11-28	2025-01-29	APolo 2025-01-29	2025-01-29
C30001104	B	C-950-MFA-062 01/B400-FGS-0 03	the philosophy of cross-ferruling are wrong side instr. C-950-MFA-06201 . (see document 123A90-DDL-IN-DG-40016 sh.3)	..		APolo 2024-12-02	2025-02-24	JKrizanic 2025-02-24	2025-02-24
C30001105	B	C-950-MFA-062 01/B400-FGS-0 03	the cables tag. is wrong side instr. C-950-MFA-06201 . (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-02	2025-03-01	AAndreani 2025-03-01	2025-03-01

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 70 Safety and Facility Systems

SUBSYSTEM 70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30001106	B	C-950-MFA-06201/B400-FGS-003	Missing the cross-ferruling (Cores) . Pannel side B400-FGS-003 . (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-02	2025-02-26	JKrizanic 2025-02-26	2025-02-26
C30001107	B	C-950-MFA-06201/B400-FGS-003	Missing cable tag , cabinet input B400-FGS-003.	.		APolo 2024-12-02	2025-02-26	APolo 2025-02-26	2025-02-26
C30001108	B	C-950-MFA-06201/B400-FGS-003	The copper conductor of the cable armor must be individually connected to the earthing bar-side B400-FGS-003. See 123A90-DDL-EL-DD-20090.	.		APolo 2024-12-02	2025-02-04	APolo 2025-02-04	2025-02-04
C30001109	B	C-950-MFA-06201/B400-FGS-003	Double shield connected to one terminal on shield bar. this point is valid also for cabinet side B400-FGS-003.	.		APolo 2024-12-02	2025-02-27	AAndreani 2025-02-27	2025-02-27
C30001199	B	950-FDZ-06101 C10000989	The tag tie is made of plastic. To be replaced in AISI	.		APolo 2024-12-03	2025-01-21	APolo 2025-01-21	2025-01-21
C30001200	B	950-FDZ-06102 C10002417	The tag tie is made of plastic. To be replaced in AISI	.		APolo 2024-12-03	2025-01-20	APolo 2025-01-20	2025-01-20
C30001201	B	950-XL-06103 C10001122	the support is not well secured against vibration. another support needs to be added	.		APolo 2024-12-03	2025-03-07	Gtangianu 2025-03-07	2025-03-07
C30001202	B	950-XL-06104 C10001123	the support is not well secured against vibration. another support needs to be added	.		APolo 2024-12-03	2025-03-07	Gtangianu 2025-03-07	2025-03-07
C30001203	B	C-950-FDZ-06101/950-JE-06101	Missing the cross-ferruling (Cores) . Inst. C-950-FDZ-06101 / JB 950-JE-06101 . (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-03	2025-02-24	JKrizanic 2025-02-24	2025-02-24

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 70 Safety and Facility Systems

SUBSYSTEM 70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30001204	B	C-950-FDZ-06101/950-JE-06101	Missing cable tag SS project, near the JB 950-JE-06101	.		APolo 2024-12-03	2024-12-27	Ecarotenuto 2024-12-27	2024-12-27
C30001205	B	C-950-FDZ-06102/950-JE-06101	Missing cable tag SS , near the JB 950-JE-06101	.		APolo 2024-12-03	2024-12-27	Ecarotenuto 2024-12-27	2024-12-27
C30001206	B	C-950-FDZ-06102/950-JE-06101	Missing the cross-ferruling (Cores) . INST. C-950-FDZ-06102 / JB 950-JE-06101 . (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-03	2025-04-08	Gtangianu 2025-04-08	2025-04-08
C30001207	B	950-XL-06201 C10001124	The protection cage of the instrument is damaged (it is not fixed)	.		APolo 2024-12-03	2025-03-25	Gtangianu 2025-03-25	2025-03-25
C30001208	B	C-950-XL-06201/950-JE-06203 C10000352	The protective cap (shield) is damage . exposed copper	.		APolo 2024-12-03	2025-04-08	Gtangianu 2025-04-08	2025-04-08
C30001209	B	C-950-XL-06201/950-JE-06203 C10000352	the philosophy of cross-ferruling are wrong inst.C-950-XL-06201/ jb 950-JE-06203 . (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-03	2025-04-08	Gtangianu 2025-04-08	2025-04-08
C30001213	B	C-950-XL-06103/950-JE-06103 C10000346	Missing the cross-ferruling (Cores + Shields) . JB 950-JE-06103 . (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-03	2025-03-01	JKrizanic 2025-03-01	2025-03-01
C30001214	B	C-950-XL-06104/950-JE-06103 C10000347	Missing the cross-ferruling (Cores + Shields) . JB 950-JE-06103 . (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-03	2025-02-26	JKrizanic 2025-02-26	2025-02-26
C30001215	B	C-950-XZ-06201/950-JE-06203 C10000351	the philosophy of cross-ferruling are wrong J.B. side 950-JE-06203 / INST.C-950-XZ-06201 (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-03	2025-02-24	JKrizanic 2025-02-24	2025-02-24

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 70 Safety and Facility Systems

SUBSYSTEM 70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30001309	B	950-GDZ-06201 C10001046	The earthing cable passes inside the unistrut and behind the instrument. It should be dressed outside unistrut and fixed with SS cable ties.	.		AAndreani 2024-12-04	2025-01-20	APolo 2025-01-20	2025-01-20
C30001310	B	950-GDZ-06201 C10001046	Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but	.		AAndreani 2024-12-04	2025-02-03	GBertuccelli 2025-02-03	2025-02-03
C30001314	B	950-GDZ-06202 C10001047	The earthing cable passes inside the unistrut and behind the instrument. It should be dressed outside unistrut and fixed with SS cable ties.	.		AAndreani 2024-12-04	2025-01-20	APolo 2025-01-20	2025-01-20
C30001315	B	950-GDZ-06202 C10001047	Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but	.		AAndreani 2024-12-04	2025-02-03	GBertuccelli 2025-02-03	2025-02-03
C30001321	B	950-GDZ-06203 C10001048	Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but	.		AAndreani 2024-12-04	2025-02-03	GBertuccelli 2025-02-03	2025-02-03
C30001322	B	950-GDZ-06204 C10001049	Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but	.		AAndreani 2024-12-04	2025-02-27	AAndreani 2025-02-27	2025-02-27
C30001324	B	C-950-XZ-06201 /950-JE-06203 C10000351	Wrong cores identification tag. side C-950-XZ-06201 / 950-JE-06203 . (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-04	2025-02-24	JKrizanic 2025-02-24	2025-02-24
C30001325	B	C-950-GDZ-062 01/950-JE-0620 1	Cable is entering the instrument cable gland downwards while it should be upwards	.		AAndreani 2024-12-04	2025-01-20	APolo 2025-01-20	2025-01-20
C30001326	B	C-950-GDZ-062 01/950-JE-0620 1	Core tag is wrong for cable on both instrument and JB sides	.		AAndreani 2024-12-04	2025-02-26	JKrizanic 2025-02-26	2025-02-26

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 70 Safety and Facility Systems

SUBSYSTEM 70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30001341	B	C-950-GDZ-06202/950-JE-06201	Core tag is missing for cable On both instrument and JB sides	.		AAndreani 2024-12-05	2025-04-08	Gtangianu 2025-04-08	2025-04-08
C30001342	B	C-950-GDZ-06202/950-JE-06201	Cable is entering the instrument cable gland downwards while it should be upwards	.		AAndreani 2024-12-05	2025-01-20	APolo 2025-01-20	2025-01-20
C30001345	B	C-950-GDZ-06203/950-JE-06201	Core tag is missing for cable On both instrument and JB sides	.		AAndreani 2024-12-05	2025-02-26	JKrizanic 2025-02-26	2025-02-26
C30001346	B	C-950-GDZ-06203/950-JE-06201	Cable is entering the instrument cable gland downwards while it should be upwards	.		AAndreani 2024-12-05	2025-01-20	APolo 2025-01-20	2025-01-20
C30001348	B	C-950-GDZ-06203/950-JE-06201	The cable termination is not installed in accordance with Electrical Typical Installation Details. see 123A90-DDL-EL-DD-20090 sh.8 / 29	.		AAndreani 2024-12-05	2025-01-23	AAndreani 2025-01-23	2025-01-23
C30001352	B	C-950-GDZ-06204/950-JE-06201	Core tag is missing for cable on JB sides	.		AAndreani 2024-12-05	2024-12-16	Gtangianu 2024-12-16	2024-12-16
C30001542	B	C-950-GDZ-06205/950-JE-06201	Core tag is missing for cable on JB sides	.		AAndreani 2024-12-07	2025-02-20	JKrizanic 2025-02-20	2025-02-20
C30001543	B	C-950-GDZ-06206/950-JE-06201	Core tag is missing for cable on JB sides	.		AAndreani 2024-12-07	2025-02-20	JKrizanic 2025-02-20	2025-02-20
C30001544	B	950-GDZ-06206 C10001051	Protective cap is missing	.		AAndreani 2024-12-07	2025-02-28	AAndreani 2025-02-28	2025-02-28

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 70 Safety and Facility Systems

SUBSYSTEM 70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30001545	B	950-GDZ-06205 C10001050	Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but	.		AAndreani 2024-12-07	2025-01-20	APolo 2025-01-20	2025-01-20
C30001546	B	950-GDZ-06206 C10001051	Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but	.		AAndreani 2024-12-07	2025-01-20	APolo 2025-01-20	2025-01-20
C30001622	B	C-950-XL-06202 /950-JE-06203 C10000353	Missing core identification tag by JB side	.		Pschintu 2024-12-10	2025-02-20	JKrizanic 2025-02-20	2025-02-20
C30004323	B	77-HY-001	Fire damper B-100 doesn't work.		Fire damper replaced and working.	GDelmissier 2025-04-15	GDelmissier 2025-05-06	GDelmissier 2025-05-06	2025-05-06
C30004381	B	77-HY-001	With reference to punch PL30004323, a temporary actuator was installed to continue commissioning activities.	Replace the temporary actuator with the originally specified actuator.	fire damper replaced and working	GDelmissier 2025-05-12	GDelmissier 2025-07-03	GDelmissier 2025-07-03	2025-07-03

Section 2.2 Exception Punch Lists (per discipline)

Project CROSSWIND

PUNCH LIST REPORT

NO DATA AVAILABLE

Section 2.3 “As-Commissioned” P&ID's / SLD's / D&ID's / C&E's

DRAWING NO. 123490-1724000049-HV-PID-00039


REV. 04


ITEM	HVAC-PRESSURISING FAN
DESCRIPTION	HVAC UNIT
MAKER	FRIGOTERMICA srl
MODEL	4112-DMPD-400
SUPPLY AIR FLOW	389 l/s
COOLING COIL CAPACITY	N.A.
HEATING COIL CAPACITY	10 kW
TENSIONE	400 V - 50 Hz - 3 Ph+N
EXECUTION	SAFE AREA
REFRIGERANT	N.A.

LEGEND

	MOTORISED DAMPER WITH SPRING RETURN	F1	AIR FILTER "G4"		MOTORISED FIRE DAMPER WITH SPRING RETURN
	REGULATION DAMPER	F2	BAG FILTER "F8"		EVAPORATING COIL
	OVERPRESSURE DAMPER		CONDENSING COIL		
PDSH	DIFFERENTIAL PRESSURE SWITCH HIGH PRESSURE		CONDENSING FAN		
PDSL	DIFFERENTIAL PRESSURE SWITCH LOW PRESSURE		HEATING COIL	R	LIQUID RECEIVER
TT	TEMPERATURE TRASMITTER		SUPPLY FAN	HT	MOISTURE TRASMITTER
HPB	EMERGENCY PUSH BUTTON		GLOBE VALVE	PTH	HIG PRESSURE TRASDUCER
OH	COMPRESSOR OIL HEATER		DRYER FILTER	TP	COMPRESSOR THERMIC PROTECTION
SV	SOLENOID VALVE		SIGHT GLASS	TSH	HIGH TEMPERATURE SECURITY THERMOSTATE
	REFRIGERANT COMPRESSOR		THERMOSTATIC VALVE	PSH	HIGH PRESSURE SWITCH
	PRESSURE RELIEF DAMPER		PRESSURE RELIEF VALVE	PSL	LOW PRESSURE SWITCH
HSS-77-XXX	ELECTRICAL HEATER	TSH	VERY HIGH TEMPERATURE SECURITY THERMOSTATE	PC	CONDENSING PRESSURE SWITCH
		PDT	DIFFERENTIAL PRESSURE SWITCH FOR FILTER		SPACE HEATER
				PT	DIFFERENTIAL PRESSURE TRANSMITTER
				HHC-77-XXX	HEATING CABLE

REV 03

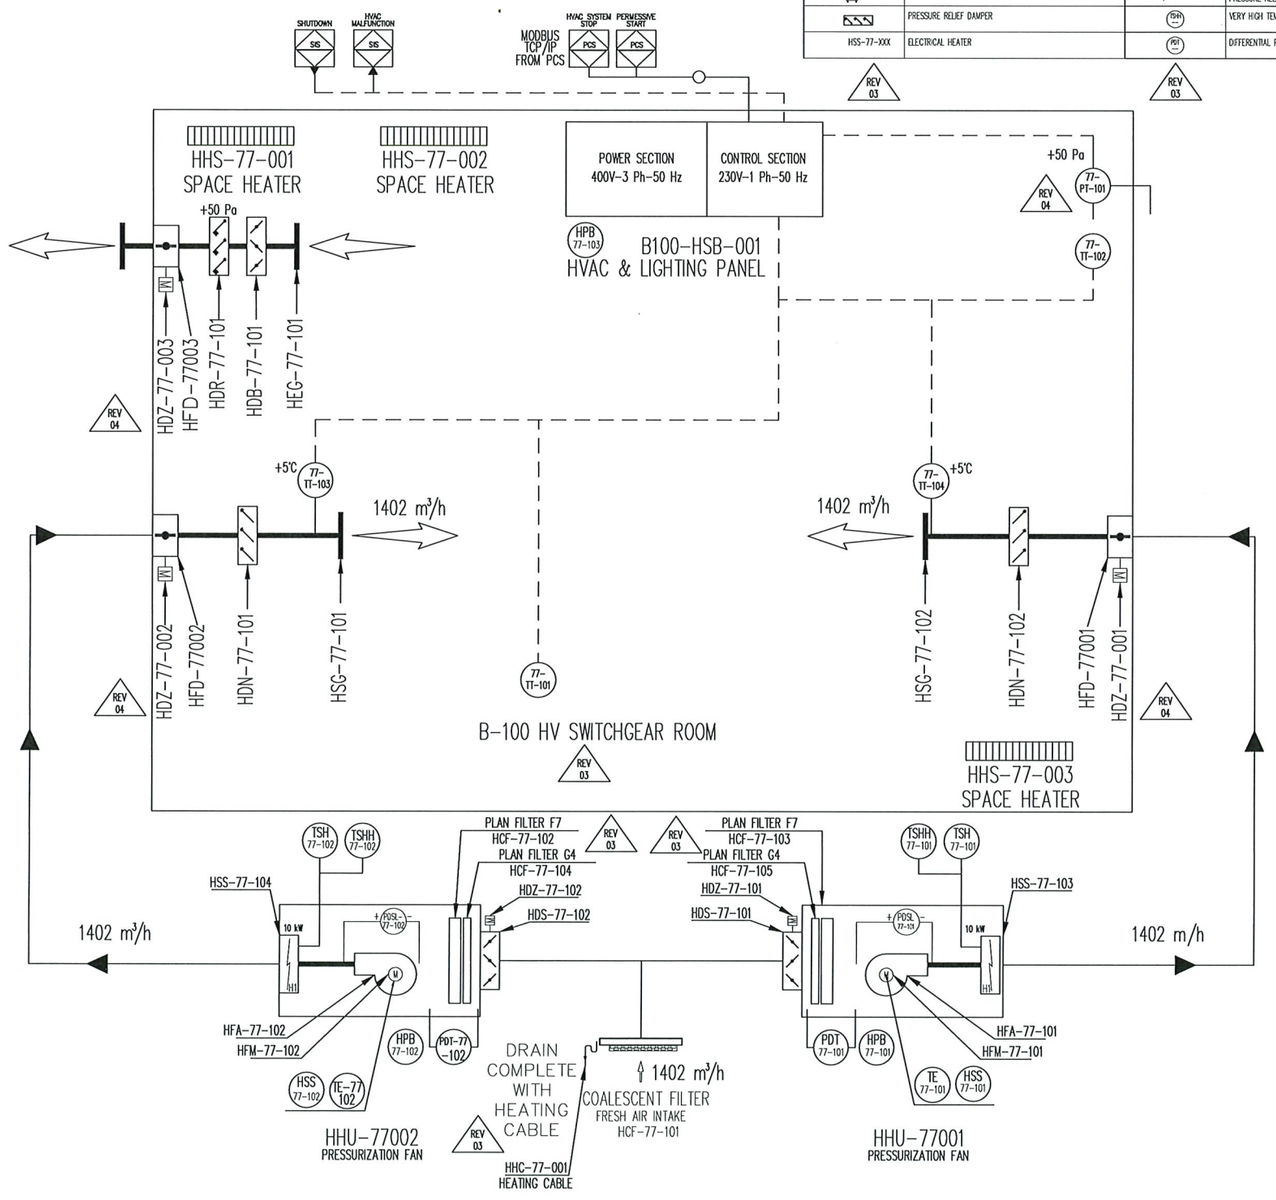

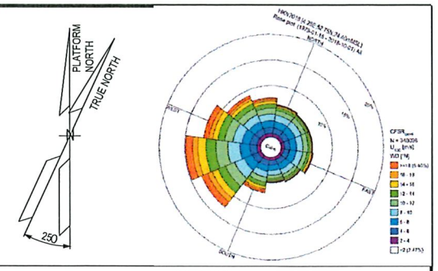

NOTES

LEGEND

HOLDS

OUTDOOR DESIGN CONDITIONS

Safe Area
Min. design DB Temp: -8.4°C with RH 100 %
Max. design DB Temp: +25°C with RH 90 %

Module B100 HV Switchroom REV 03

Safe Area
Indoor min. design temperature: +5°C with RH 30 ÷ 70%
Indor max. design temperature: +35°C with RH 30 ÷ 70%
Min. ACH: 6

NOTES:

- HVAC POWER CABINET will energize what above shown.
- HVAC CONTROL CABINET will control all what above shown.
- HVAC POWER CABINET will energize light and socket.
- Outside drainage system shall be provided of heatng coble with anti-freeze funcion to avoid ice inside pipes when outside temeprature reaches values close to 0°C.
- Outdoor air ductworks in stainless steel AISI 316

AS COMMISSIONED 12-05-2025 GIANDOMENICO DE MASSIS

ALEXSISTEMI S.r.l.

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
04	06/02/24	S.Z.	S.S.	M.C.	ISSUE FOR INFORMATION (IFI)
03	03/12/24	S.Z.	S.S.	M.C.	ISSUE FOR INFORMATION (IFI)
02	29/10/24	S.Z.	S.S.	M.C.	ISSUE FOR INFORMATION (IFI)
01	09/07/24	S.Z.	S.S.	M.C.	ISSUE FOR INFORMATION (IFI)
00	10/06/24	S.Z.	S.S.	M.C.	ISSUE FOR INFORMATION (IFI)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
B-100 HV SWITCH ROOM
P&ID HVAC System

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1_:_1
DRAWN G.M.	CHECKED A.O.	APPROVED A.C.	DATE 19/12/24
A1	DRAWING NO. 1724000049-HV-PID-00039	SHEET 003	REV. 04

File Name : 123490-1724000049-HV-PID-00039

Section 3 CONSOLIDATED PUNCH LISTS

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 70 Safety and Facility Systems

SUBSYSTEM 70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30000998	A	C-950-MFA-061 01/950-JE-0610 2	Cable is damage internal the cable gland side (950-JE-06102), and side (950-MFA-06101)the cable was overtightened . See attached photo.	.		Gtangianu 2024-11-28	2024-12-07	Ecarotenuto 2024-12-07	2024-12-07
C30001020	A	950-MFA-06102 C10001070	Missing one bolt on the cover instrument. (950-MFA-06102) see attached photo.	.		Gtangianu 2024-11-28	2024-12-07	Ecarotenuto 2024-12-07	2024-12-07
C30001323	A	C-950-XZ-06201 /950-JE-06203 C10000351	That cable gland are not closed in accordance with specification. side C-950-XZ-06201	.		APolo 2024-12-04	2024-12-11	Ecarotenuto 2024-12-11	2024-12-11
C30000564	B	C-950-SDZ-062 01/950-JE-0620 4	Nylon sheet is missing on mechanical support of secondary cable trays.	.		APolo 2024-11-18	2025-02-13	AAndreani 2025-02-13	2025-02-13
C30000565	B	C-950-SDZ-062 01/950-JE-0620 4	Plastic cable ties to be replaced on external routing.	.		APolo 2024-11-18	2024-12-23	Ecarotenuto 2024-12-23	2024-12-23
C30000566	B	C-950-SDZ-062 01/950-JE-0620 4	Missing tag SS project on the cable near the instrument.	.		APolo 2024-11-18	2024-12-23	Ecarotenuto 2024-12-23	2024-12-23
C30000567	B	C-950-SDZ-062 02/950-JE-0620 4	Missing interposing nylon plate between dissimilar conducting materials	.		APolo 2024-11-18	2025-02-21	APolo 2025-02-21	2025-02-21
C30000568	B	C-950-SDZ-062 02/950-JE-0620 4	The Plastic ties , on external routing cable , to be replaced with stainless steel. .	.		APolo 2024-11-18	2024-12-23	Ecarotenuto 2024-12-23	2024-12-23
C30000569	B	C-950-SDZ-062 02/950-JE-0620 4	Missing cable tag SS project, near the instrument	.		APolo 2024-11-18	2024-12-23	Ecarotenuto 2024-12-23	2024-12-23

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 70 Safety and Facility Systems

SUBSYSTEM 70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30000570	B	C-950-SDZ-06203/950-JE-06204	Missing interposing nylon plate between dissimilar conducting materials	.		APolo 2024-11-18	2025-02-21	APolo 2025-02-21	2025-02-21
C30000571	B	C-950-SDZ-06203/950-JE-06204	The plastic fixing ties , on external routing cable , to be replaced with stainless steel	.		APolo 2024-11-18	2024-12-23	Ecarotenuto 2024-12-23	2024-12-23
C30000572	B	C-950-SDZ-06203/950-JE-06204	Missing cable tag SS project, near the instrument	.		APolo 2024-11-18	2024-12-23	Ecarotenuto 2024-12-23	2024-12-23
C30000692	B	950-SDZ-06206 C10001101	the earth cable is not fixed to the instrument	.		APolo 2024-11-21	2024-12-30	Gtangianu 2024-12-30	2024-12-30
C30000978	B	950-XZ-06101 C10001142	earthing cable need to be fixed.	.		Gtangianu 2024-11-27	2025-01-20	APolo 2025-01-20	2025-01-20
C30000979	B	C-950-XZ-06101/950-JE-06103 C10000343	Identification tag wires missing side the (XZ-06101).	.		Gtangianu 2024-11-27	2025-02-24	JKrizanic 2025-02-24	2025-02-24
C30000980	B	C-950-XZ-06101/950-JE-06103 C10000343	Missing cable tag all along the route.	.		Gtangianu 2024-11-27	2025-01-29	APolo 2025-01-29	2025-01-29
C30000981	B	C-950-XZ-06101/950-JE-06103 C10000343	Cable (C-950-XZ-06101/950-JE-06103) needs to be better dressed on all routing . See attached photo.	.		Gtangianu 2024-11-27	2025-01-20	APolo 2025-01-20	2025-01-20
C30000994	B	C-950-XL-06102/950-JE-06103 C10000345	Missing cable tag all along the route.	.		Gtangianu 2024-11-28	2025-01-29	APolo 2025-01-29	2025-01-29

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 70 Safety and Facility Systems
SUBSYSTEM 70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30000995	B	C-950-XL-06102 /950-JE-06103 C10000345	cable need to be arranged better under the instrument (950-XL-06102)	.		Gtangianu 2024-11-28	2025-01-20	APolo 2025-01-20	2025-01-20
C30000996	B	C-950-XL-06101 /950-JE-06103 C10000344	Missing cable tags on all routing. (C-950-XL-06101/950-JE-06103).	.		Gtangianu 2024-11-28	2025-01-29	APolo 2025-01-29	2025-01-29
C30000997	B	950-XL-06101 C10001120	Earthing cable need to be fix. (950-XL-06101).	.		Gtangianu 2024-11-28	2025-01-20	APolo 2025-01-20	2025-01-20
C30000999	B	C-950-MFA-061 01/950-JE-0610 2	Missing cable tags on all routing.	.		Gtangianu 2024-11-28	2025-01-29	APolo 2025-01-29	2025-01-29
C30001004	B	C-950-MFA-061 02/950-JE-0610 2	The cable is too long under the instrument (950-MFA-06102). See attached photo.	.		Gtangianu 2024-11-28	2025-01-20	APolo 2025-01-20	2025-01-20
C30001018	B	950-MFA-06102 C10001070	The instrument has paint damage . See attached photo.	.		Gtangianu 2024-11-28	2025-04-04	Gtangianu 2025-04-04	2025-04-04
C30001019	B	C-950-MFA-061 02/950-JE-0610 2	Missing cable tags on all routing.	.		Gtangianu 2024-11-28	2025-01-29	APolo 2025-01-29	2025-01-29
C30001104	B	C-950-MFA-062 01/B400-FGS-0 03	the philosophy of cross-ferruling are wrong side instr. C-950-MFA-06201 . (see document 123A90-DDL-IN-DG-40016 sh.3)	..		APolo 2024-12-02	2025-02-24	JKrizanic 2025-02-24	2025-02-24
C30001105	B	C-950-MFA-062 01/B400-FGS-0 03	the cables tag. is wrong side instr. C-950-MFA-06201 . (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-02	2025-03-01	AAndreani 2025-03-01	2025-03-01

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 70 Safety and Facility Systems

SUBSYSTEM 70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30001106	B	C-950-MFA-06201/B400-FGS-003	Missing the cross-ferruling (Cores) . Pannel side B400-FGS-003 . (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-02	2025-02-26	JKrizanic 2025-02-26	2025-02-26
C30001107	B	C-950-MFA-06201/B400-FGS-003	Missing cable tag , cabinet input B400-FGS-003.	.		APolo 2024-12-02	2025-02-26	APolo 2025-02-26	2025-02-26
C30001108	B	C-950-MFA-06201/B400-FGS-003	The copper conductor of the cable armor must be individually connected to the earthing bar-side B400-FGS-003. See 123A90-DDL-EL-DD-20090.	.		APolo 2024-12-02	2025-02-04	APolo 2025-02-04	2025-02-04
C30001109	B	C-950-MFA-06201/B400-FGS-003	Double shield connected to one terminal on shield bar. this point is valid also for cabinet side B400-FGS-003.	.		APolo 2024-12-02	2025-02-27	AAndreani 2025-02-27	2025-02-27
C30001199	B	950-FDZ-06101 C10000989	The tag tie is made of plastic. To be replaced in AISI	.		APolo 2024-12-03	2025-01-21	APolo 2025-01-21	2025-01-21
C30001200	B	950-FDZ-06102 C10002417	The tag tie is made of plastic. To be replaced in AISI	.		APolo 2024-12-03	2025-01-20	APolo 2025-01-20	2025-01-20
C30001201	B	950-XL-06103 C10001122	the support is not well secured against vibration. another support needs to be added	.		APolo 2024-12-03	2025-03-07	Gtangianu 2025-03-07	2025-03-07
C30001202	B	950-XL-06104 C10001123	the support is not well secured against vibration. another support needs to be added	.		APolo 2024-12-03	2025-03-07	Gtangianu 2025-03-07	2025-03-07
C30001203	B	C-950-FDZ-06101/950-JE-06101	Missing the cross-ferruling (Cores) . Inst. C-950-FDZ-06101 / JB 950-JE-06101 . (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-03	2025-02-24	JKrizanic 2025-02-24	2025-02-24

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 70 Safety and Facility Systems

SUBSYSTEM 70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30001204	B	C-950-FDZ-06101/950-JE-06101	Missing cable tag SS project, near the JB 950-JE-06101	.		APolo 2024-12-03	2024-12-27	Ecarotenuto 2024-12-27	2024-12-27
C30001205	B	C-950-FDZ-06102/950-JE-06101	Missing cable tag SS , near the JB 950-JE-06101	.		APolo 2024-12-03	2024-12-27	Ecarotenuto 2024-12-27	2024-12-27
C30001206	B	C-950-FDZ-06102/950-JE-06101	Missing the cross-ferruling (Cores) . INST. C-950-FDZ-06102 / JB 950-JE-06101 . (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-03	2025-04-08	Gtangianu 2025-04-08	2025-04-08
C30001207	B	950-XL-06201 C10001124	The protection cage of the instrument is damaged (it is not fixed)	.		APolo 2024-12-03	2025-03-25	Gtangianu 2025-03-25	2025-03-25
C30001208	B	C-950-XL-06201/950-JE-06203 C10000352	The protective cap (shield) is damage . exposed copper	.		APolo 2024-12-03	2025-04-08	Gtangianu 2025-04-08	2025-04-08
C30001209	B	C-950-XL-06201/950-JE-06203 C10000352	the philosophy of cross-ferruling are wrong inst.C-950-XL-06201/ jb 950-JE-06203 . (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-03	2025-04-08	Gtangianu 2025-04-08	2025-04-08
C30001213	B	C-950-XL-06103/950-JE-06103 C10000346	Missing the cross-ferruling (Cores + Shields) . JB 950-JE-06103 . (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-03	2025-03-01	JKrizanic 2025-03-01	2025-03-01
C30001214	B	C-950-XL-06104/950-JE-06103 C10000347	Missing the cross-ferruling (Cores + Shields) . JB 950-JE-06103 . (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-03	2025-02-26	JKrizanic 2025-02-26	2025-02-26
C30001215	B	C-950-XZ-06201/950-JE-06203 C10000351	the philosophy of cross-ferruling are wrong J.B. side 950-JE-06203 / INST.C-950-XZ-06201 (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-03	2025-02-24	JKrizanic 2025-02-24	2025-02-24

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 70 Safety and Facility Systems

SUBSYSTEM 70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30001309	B	950-GDZ-06201 C10001046	The earthing cable passes inside the unistrut and behind the instrument. It should be dressed outside unistrut and fixed with SS cable ties.	.		AAndreani 2024-12-04	2025-01-20	APolo 2025-01-20	2025-01-20
C30001310	B	950-GDZ-06201 C10001046	Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but	.		AAndreani 2024-12-04	2025-02-03	GBertuccelli 2025-02-03	2025-02-03
C30001314	B	950-GDZ-06202 C10001047	The earthing cable passes inside the unistrut and behind the instrument. It should be dressed outside unistrut and fixed with SS cable ties.	.		AAndreani 2024-12-04	2025-01-20	APolo 2025-01-20	2025-01-20
C30001315	B	950-GDZ-06202 C10001047	Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but	.		AAndreani 2024-12-04	2025-02-03	GBertuccelli 2025-02-03	2025-02-03
C30001321	B	950-GDZ-06203 C10001048	Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but	.		AAndreani 2024-12-04	2025-02-03	GBertuccelli 2025-02-03	2025-02-03
C30001322	B	950-GDZ-06204 C10001049	Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but	.		AAndreani 2024-12-04	2025-02-27	AAndreani 2025-02-27	2025-02-27
C30001324	B	C-950-XZ-06201 /950-JE-06203 C10000351	Wrong cores identification tag. side C-950-XZ-06201 / 950-JE-06203 . (see document 123A90-DDL-IN-DG-40016 sh.3)	.		APolo 2024-12-04	2025-02-24	JKrizanic 2025-02-24	2025-02-24
C30001325	B	C-950-GDZ-062 01/950-JE-0620 1	Cable is entering the instrument cable gland downwards while it should be upwards	.		AAndreani 2024-12-04	2025-01-20	APolo 2025-01-20	2025-01-20
C30001326	B	C-950-GDZ-062 01/950-JE-0620 1	Core tag is wrong for cable on both instrument and JB sides	.		AAndreani 2024-12-04	2025-02-26	JKrizanic 2025-02-26	2025-02-26

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 70 Safety and Facility Systems

SUBSYSTEM 70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30001341	B	C-950-GDZ-06202/950-JE-06201	Core tag is missing for cable On both instrument and JB sides	.		AAndreani 2024-12-05	2025-04-08	Gtangianu 2025-04-08	2025-04-08
C30001342	B	C-950-GDZ-06202/950-JE-06201	Cable is entering the instrument cable gland downwards while it should be upwards	.		AAndreani 2024-12-05	2025-01-20	APolo 2025-01-20	2025-01-20
C30001345	B	C-950-GDZ-06203/950-JE-06201	Core tag is missing for cable On both instrument and JB sides	.		AAndreani 2024-12-05	2025-02-26	JKrizanic 2025-02-26	2025-02-26
C30001346	B	C-950-GDZ-06203/950-JE-06201	Cable is entering the instrument cable gland downwards while it should be upwards	.		AAndreani 2024-12-05	2025-01-20	APolo 2025-01-20	2025-01-20
C30001348	B	C-950-GDZ-06203/950-JE-06201	The cable termination is not installed in accordance with Electrical Typical Installation Details. see 123A90-DDL-EL-DD-20090 sh.8 / 29	.		AAndreani 2024-12-05	2025-01-23	AAndreani 2025-01-23	2025-01-23
C30001352	B	C-950-GDZ-06204/950-JE-06201	Core tag is missing for cable on JB sides	.		AAndreani 2024-12-05	2024-12-16	Gtangianu 2024-12-16	2024-12-16
C30001542	B	C-950-GDZ-06205/950-JE-06201	Core tag is missing for cable on JB sides	.		AAndreani 2024-12-07	2025-02-20	JKrizanic 2025-02-20	2025-02-20
C30001543	B	C-950-GDZ-06206/950-JE-06201	Core tag is missing for cable on JB sides	.		AAndreani 2024-12-07	2025-02-20	JKrizanic 2025-02-20	2025-02-20
C30001544	B	950-GDZ-06206 C10001051	Protective cap is missing	.		AAndreani 2024-12-07	2025-02-28	AAndreani 2025-02-28	2025-02-28

Project CROSSWIND

PUNCH LIST REPORT

SYSTEM 70 Safety and Facility Systems

SUBSYSTEM 70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

Instrumental

CODE	CAT	ITEM	DEFECT DESCRIPTION	CORRECTIVE ACTION	PERFORMED ACTION	ISSUED	CARRIED	CHECKED	APPROVED
C30001545	B	950-GDZ-06205 C10001050	Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but	.		AAndreani 2024-12-07	2025-01-20	APolo 2025-01-20	2025-01-20
C30001546	B	950-GDZ-06206 C10001051	Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but	.		AAndreani 2024-12-07	2025-01-20	APolo 2025-01-20	2025-01-20
C30001622	B	C-950-XL-06202 /950-JE-06203 C10000353	Missing core identification tag by JB side	.		Pschintu 2024-12-10	2025-02-20	JKrizanic 2025-02-20	2025-02-20
C30004323	B	77-HY-001	Fire damper B-100 doesn't work.		Fire damper replaced and working.	GDelmissier 2025-04-15	GDelmissier 2025-05-06	GDelmissier 2025-05-06	2025-05-06
C30004381	B	77-HY-001	With reference to punch PL30004323, a temporary actuator was installed to continue commissioning activities.	Replace the temporary actuator with the originally specified actuator.	fire damper replaced and working	GDelmissier 2025-05-12	GDelmissier 2025-07-03	GDelmissier 2025-07-03	2025-07-03

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001321

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001048	1.4 Discipline	Instrumental
1.2 Item	950-GDZ-06203	H2 GD FZ-06 B-100 HVAC Air Intake	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but in plastic)

Name: Andrea Andreani

Date: 2024-12-04

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-04
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

Done

Name: Gabriele Bertuccelli

Date: 2025-02-03

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001322

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001049	1.4 Discipline	Instrumental
1.2 Item	950-GDZ-06204	H2 GD FZ-06 B-100 Ambient	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but in plastic)

Name: Andrea Andreani

Date: 2024-12-04

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-04
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-27

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001323

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000351	1.4 Discipline	Instrumental
1.2 Item	C-950-XZ-06201/950-JE-06203	SOUNDER / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

That cable gland are not closed in accordance with specification.
side C-950-XZ-06201

Name: Alessio Polo
Date: 2024-12-04
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	A PL A	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-04
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:

5 - CLEARANCE CHECK

done

Name: Eleonora Carotenuto
Date: 2024-12-11
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:



ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001324

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000351	1.4 Discipline	Instrumental
1.2 Item	C-950-XZ-06201/950-JE-06203	SOUNDER / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Wrong cores identification tag. side C-950-XZ-06201 / 950-JE-06203 . (see document 123A90-DDL-IN-DG-40016 sh.3)

Name: Alessio Polo
Date: 2024-12-04
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-04
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:


5 - CLEARANCE CHECK


DONE

Name: Josip Krizanic
Date: 2025-02-24
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:

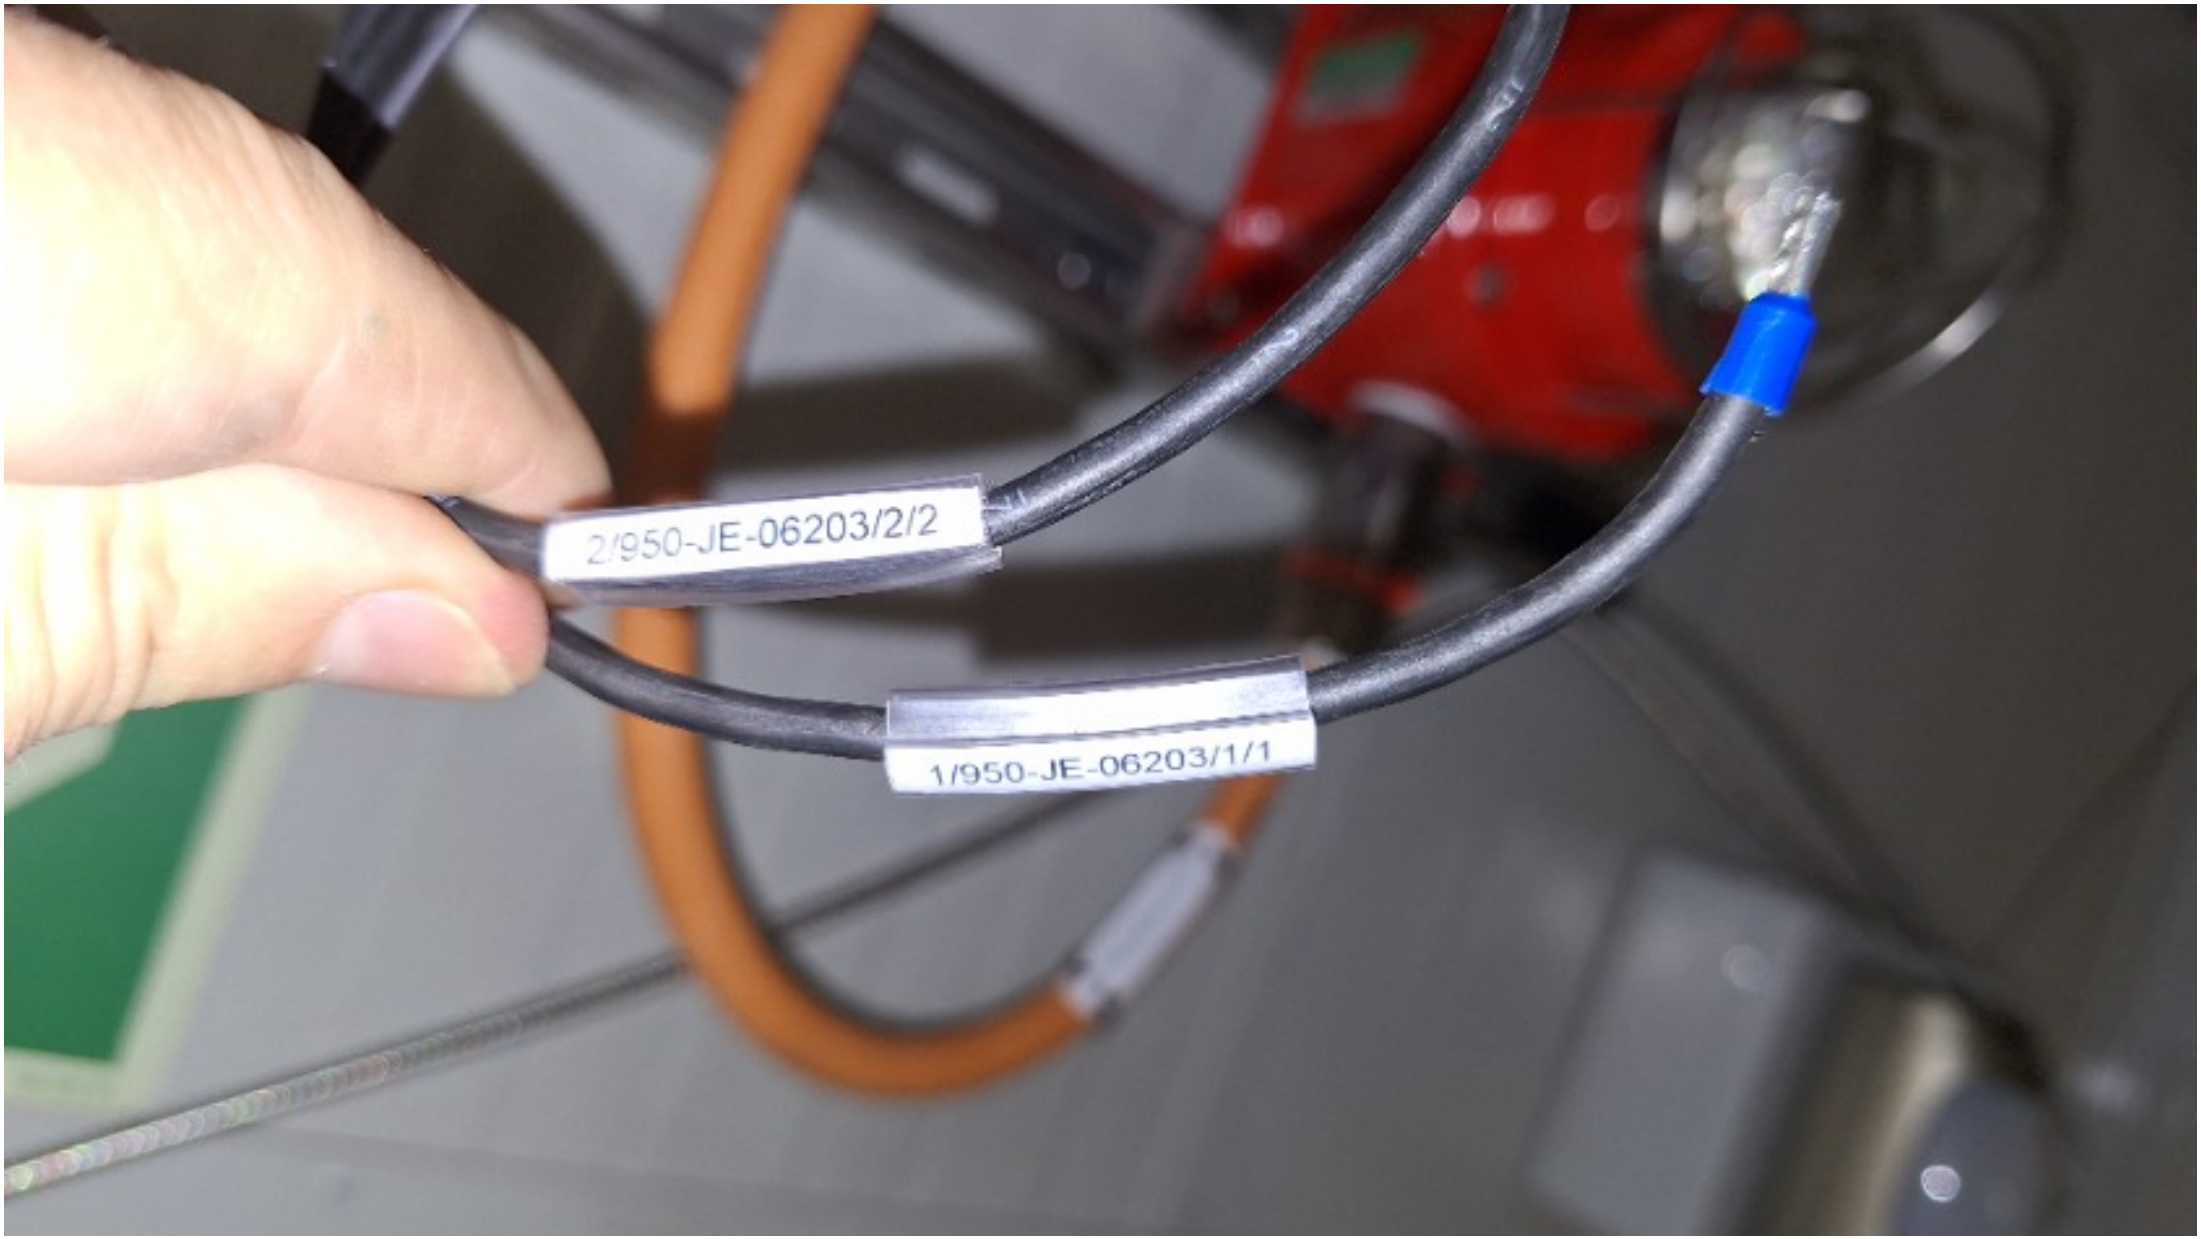
2/950-JE-06203/2/2
1/950-JE-06203/1/1

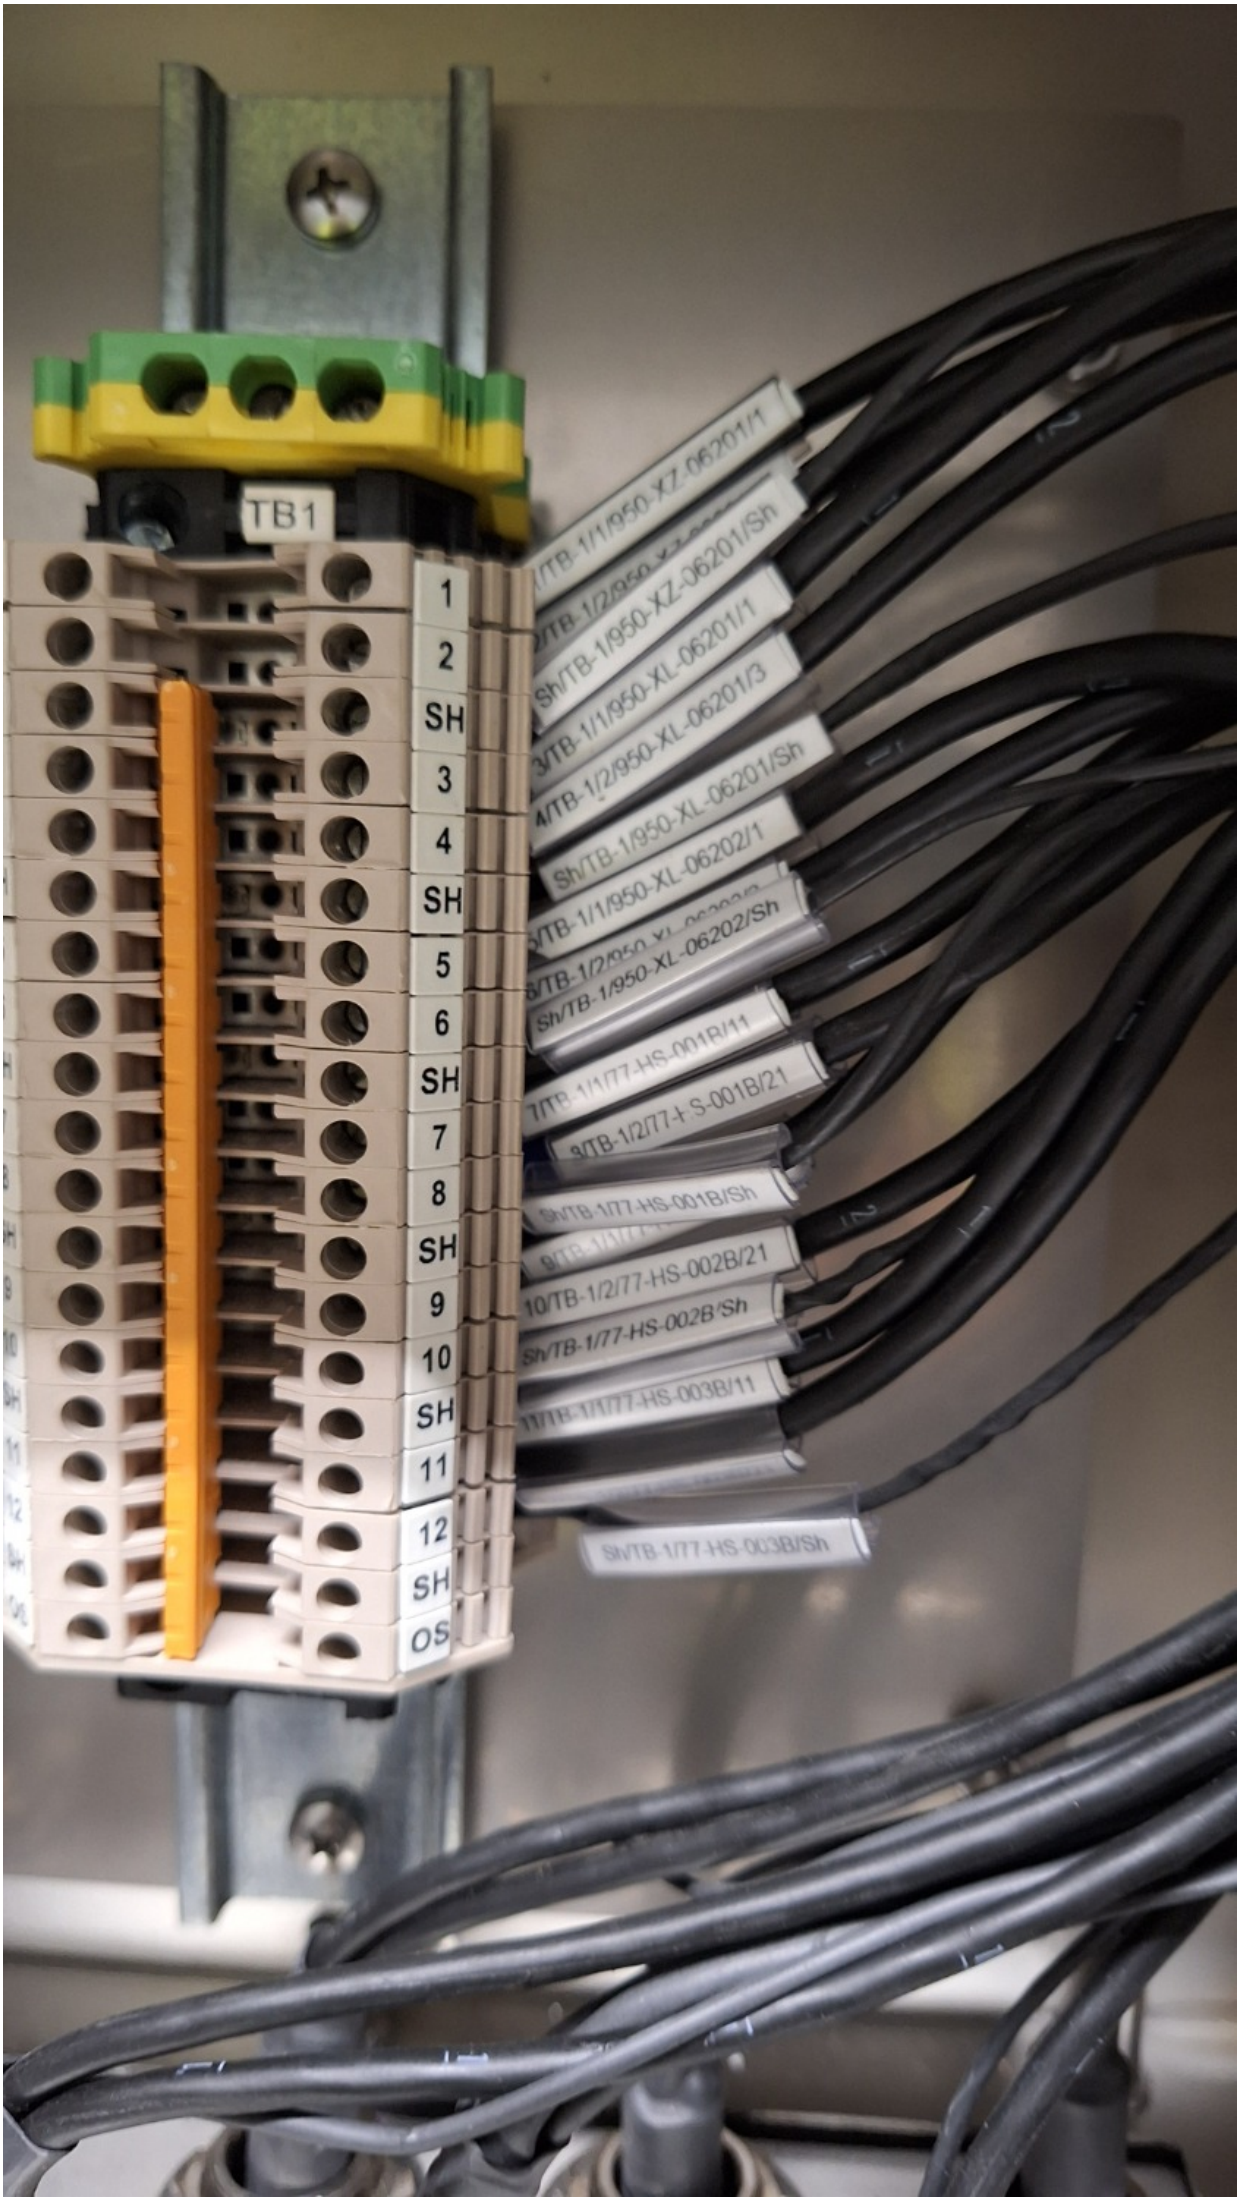
TB1
1
2
SH
3
4
SH
5
6
SH
7
8
SH
9
10
SH
11
12
SH
OS
Sh/TB-1/77-HS-003B/Sh

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001325

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000246	1.4 Discipline	Instrumental
1.2 Item	C-950-GDZ-06201/950-JE-06201	GAS DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Cable is entering the instrument cable gland downwards while it should be upwards

Name: Andrea Andreani
Date: 2024-12-04
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-04
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo
Date: 2025-01-20
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001326

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000246	1.4 Discipline	Instrumental
1.2 Item	C-950-GDZ-06201/950-JE-06201	GAS DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Core tag is wrong for cable on both instrument and JB sides

Name: Andrea Andreani

Date: 2024-12-04

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-04
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Josip Krizanic

Date: 2025-02-26

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001341

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000247	1.4 Discipline	Instrumental
1.2 Item	C-950-GDZ-06202/950-JE-06201	GAS DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Core tag is missing for cable On both instrument and JB sides

Name: Andrea Andreani

Date: 2024-12-05

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-05
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

Installed.

Name: Giovanni Tangianu

Date: 2025-04-08

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001342

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000247	1.4 Discipline	Instrumental
1.2 Item	C-950-GDZ-06202/950-JE-06201	GAS DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Cable is entering the instrument cable gland downwards while it should be upwards

Name: Andrea Andreani
Date: 2024-12-05
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-05
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo
Date: 2025-01-20
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001345

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000248	1.4 Discipline	Instrumental
1.2 Item	C-950-GDZ-06203/950-JE-06201	GAS DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Core tag is missing for cable On both instrument and JB sides

Name: Andrea Andreani

Date: 2024-12-05

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-05
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Josip Krizanic

Date: 2025-02-26

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001346

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000248	1.4 Discipline	Instrumental
1.2 Item	C-950-GDZ-06203/950-JE-06201	GAS DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Cable is entering the instrument cable gland downwards while it should be upwards

Name: Andrea Andreani

Date: 2024-12-05

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-05
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-01-20

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001348

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000248	1.4 Discipline	Instrumental
1.2 Item	C-950-GDZ-06203/950-JE-06201	GAS DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

The cable termination is not installed in accordance with Electrical Typical Installation Details. see 123A90-DDL-EL-DD-20090 sh.8 / 29

the cable is damaged by cold flow 950-GDZ-06203 side

Name: Andrea Andreani
Date: 2024-12-05
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-05
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date: 2025-01-23
Signature:

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani
Date: 2025-01-23
Signature:

6- CLEARANCE APPROVAL

Name:
Date: 2025-01-23
Signature:



ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001352

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000249	1.4 Discipline	Instrumental
1.2 Item	C-950-GDZ-06204/950-JE-06201	GAS DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Core tag is missing for cable on JB sides

Name: Andrea Andreani

Date: 2024-12-05

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-05
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

Installed.

Name: Giovanni Tangianu

Date: 2024-12-16

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001542

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000250	1.4 Discipline	Instrumental
1.2 Item	C-950-GDZ-06205/950-JE-06201	GAS DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Core tag is missing for cable on JB sides

Name: Andrea Andreani

Date: 2024-12-07

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-07
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Josip Krizanic

Date: 2025-02-20

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001543

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000251	1.4 Discipline	Instrumental
1.2 Item	C-950-GDZ-06206/950-JE-06201	GAS DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Core tag is missing for cable on JB sides

Name: Andrea Andreani

Date: 2024-12-07

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-07
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Josip Krizanic

Date: 2025-02-20

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001544

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001051	1.4 Discipline	Instrumental
1.2 Item	950-GDZ-06206	H2 GD FZ-06 B-100 Ambient	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Protective cap is missing

Name: Andrea Andreani

Date: 2024-12-07

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-07
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-28

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001545

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001050	1.4 Discipline	Instrumental
1.2 Item	950-GDZ-06205	H2 GD FZ-06 B-100 Ambient	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but in plastic)

Name: Andrea Andreani

Date: 2024-12-07

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-07
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-01-20

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001546

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001051	1.4 Discipline	Instrumental
1.2 Item	950-GDZ-06206	H2 GD FZ-06 B-100 Ambient	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but in plastic)

Name: Andrea Andreani

Date: 2024-12-07

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-07
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-01-20

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001622

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000353	1.4 Discipline	Instrumental
1.2 Item	C-950-XL-06202/950-JE-06203	BEACON / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing core identification tag by JB side

Name: Paolo Schintu

Date: 2024-12-10

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Paolo Schintu
3.4 Activity code	MC Mechanical Completion	Date	2024-12-10
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Josip Krizanic

Date: 2025-02-20

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30004323

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task		1.4 Discipline	Instrumental
1.2 Item	77-HY-001		B-100 Fire Damper AHU1 Inlet Air
1.3 Subsystem	70-17		F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

2 - OBSERVATION

Fire damper B-100 doesn't work.

Name

Date

Signature

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giandonato Delmissier
3.4 Activity code	COMM Commissioning	Date	2025-04-15
3.5 Action by	COMM Commissioning	Signature	--- Proverlis --- Duplicata issued from database information Signature is on original form

4 - PERFORMED ACTION

Fire damper replaced and working.

Name Giandonato Delmissier

Date 2025-05-06

Signature

5 - CLEARANCE CHECK

done

Name Giandonato Delmissier

Date 2025-05-06

Signature

6- CLEARANCE APPROVAL

Name

Date 2025-05-07

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30004381

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task		1.4 Discipline	Instrumental
1.2 Item	77-HY-001		B-100 Fire Damper AHU1 Inlet Air
1.3 Subsystem	70-17		F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

2 - OBSERVATION

With reference to punch PL30004323, a temporary actuator was installed to continue commissioning activities.

Name

Date

Signature

3 - DEFECT ASSESSMENT

3.1 Corrective action proposal: Replace the temporary actuator with the originally specified actuator.

3.2 Material required

3.3 Priority	B PL B	Name	Giandonato Delmissier
3.4 Activity code	COMM Commissioning	Date	2025-05-12
3.5 Action by	COMM Commissioning	Signature	--- Proverlis --- Duplicata issued from database information Signature is on original form

4 - PERFORMED ACTION

fire damper replaced and working

Name: Giandonato Delmissier

Date: 2025-07-03

Signature

5 - CLEARANCE CHECK

DONE

Name: Giandonato Delmissier

Date: 2025-07-03

Signature

6- CLEARANCE APPROVAL

Name

Date: 2025-07-08

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000981

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000343	1.4 Discipline	Instrumental
1.2 Item	C-950-XZ-06101/950-JE-06103	SOUNDER / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Cable (C-950-XZ-06101/950-JE-06103) needs to be better dressed on all routing . See attached photo.

Name: Giovanni Tangianu

Date: 2024-11-27

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2024-11-27
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name

Date

Signature

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-01-20

Signature

6- CLEARANCE APPROVAL

Name

Date

Signature

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000994

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000345	1.4 Discipline	Instrumental
1.2 Item	C-950-XL-06102/950-JE-06103	BEACON / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing cable tag all along the route.

Name: Giovanni Tangianu

Date: 2024-11-28

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2024-11-28
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-01-29

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000995

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000345	1.4 Discipline	Instrumental
1.2 Item	C-950-XL-06102/950-JE-06103	BEACON / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

cable need to be arranged better under the instrument (950-XL-06102)

Name: Giovanni Tangianu

Date: 2024-11-28

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2024-11-28
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-01-20

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000996

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000344	1.4 Discipline	Instrumental
1.2 Item	C-950-XL-06101/950-JE-06103	BEACON / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing cable tags on all routing.
(C-950-XL-06101/950-JE-06103).

Name: Giovanni Tangianu
Date: 2024-11-28
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2024-11-28
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo
Date: 2025-01-29
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000997

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001120	1.4 Discipline	Instrumental
1.2 Item	950-XL-06101	FZ-06 Gas Beacon Activation	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Earthing cable need to be fix. (950-XL-06101).

Name: Giovanni Tangianu

Date: 2024-11-28

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2024-11-28
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-01-20

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000998

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000307	1.4 Discipline	Instrumental
1.2 Item	C-950-MFA-06101/950-JE-06102	MANUAL FIRE ALARM / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Cable is damage internal the cable gland side (950-JE-06102), and side (950-MFA-06101)the cable was overtightened . See attached photo.

Name: Giovanni Tangianu

Date: 2024-11-28

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	A PL A	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2024-11-28
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

done

Name: Eleonora Carotenuto

Date: 2024-12-07

Signature:


6- CLEARANCE APPROVAL

Name:

Date:

Signature:


A4-70
A4-70
A4-70
EC 60332-3-22 - 2024 - CE

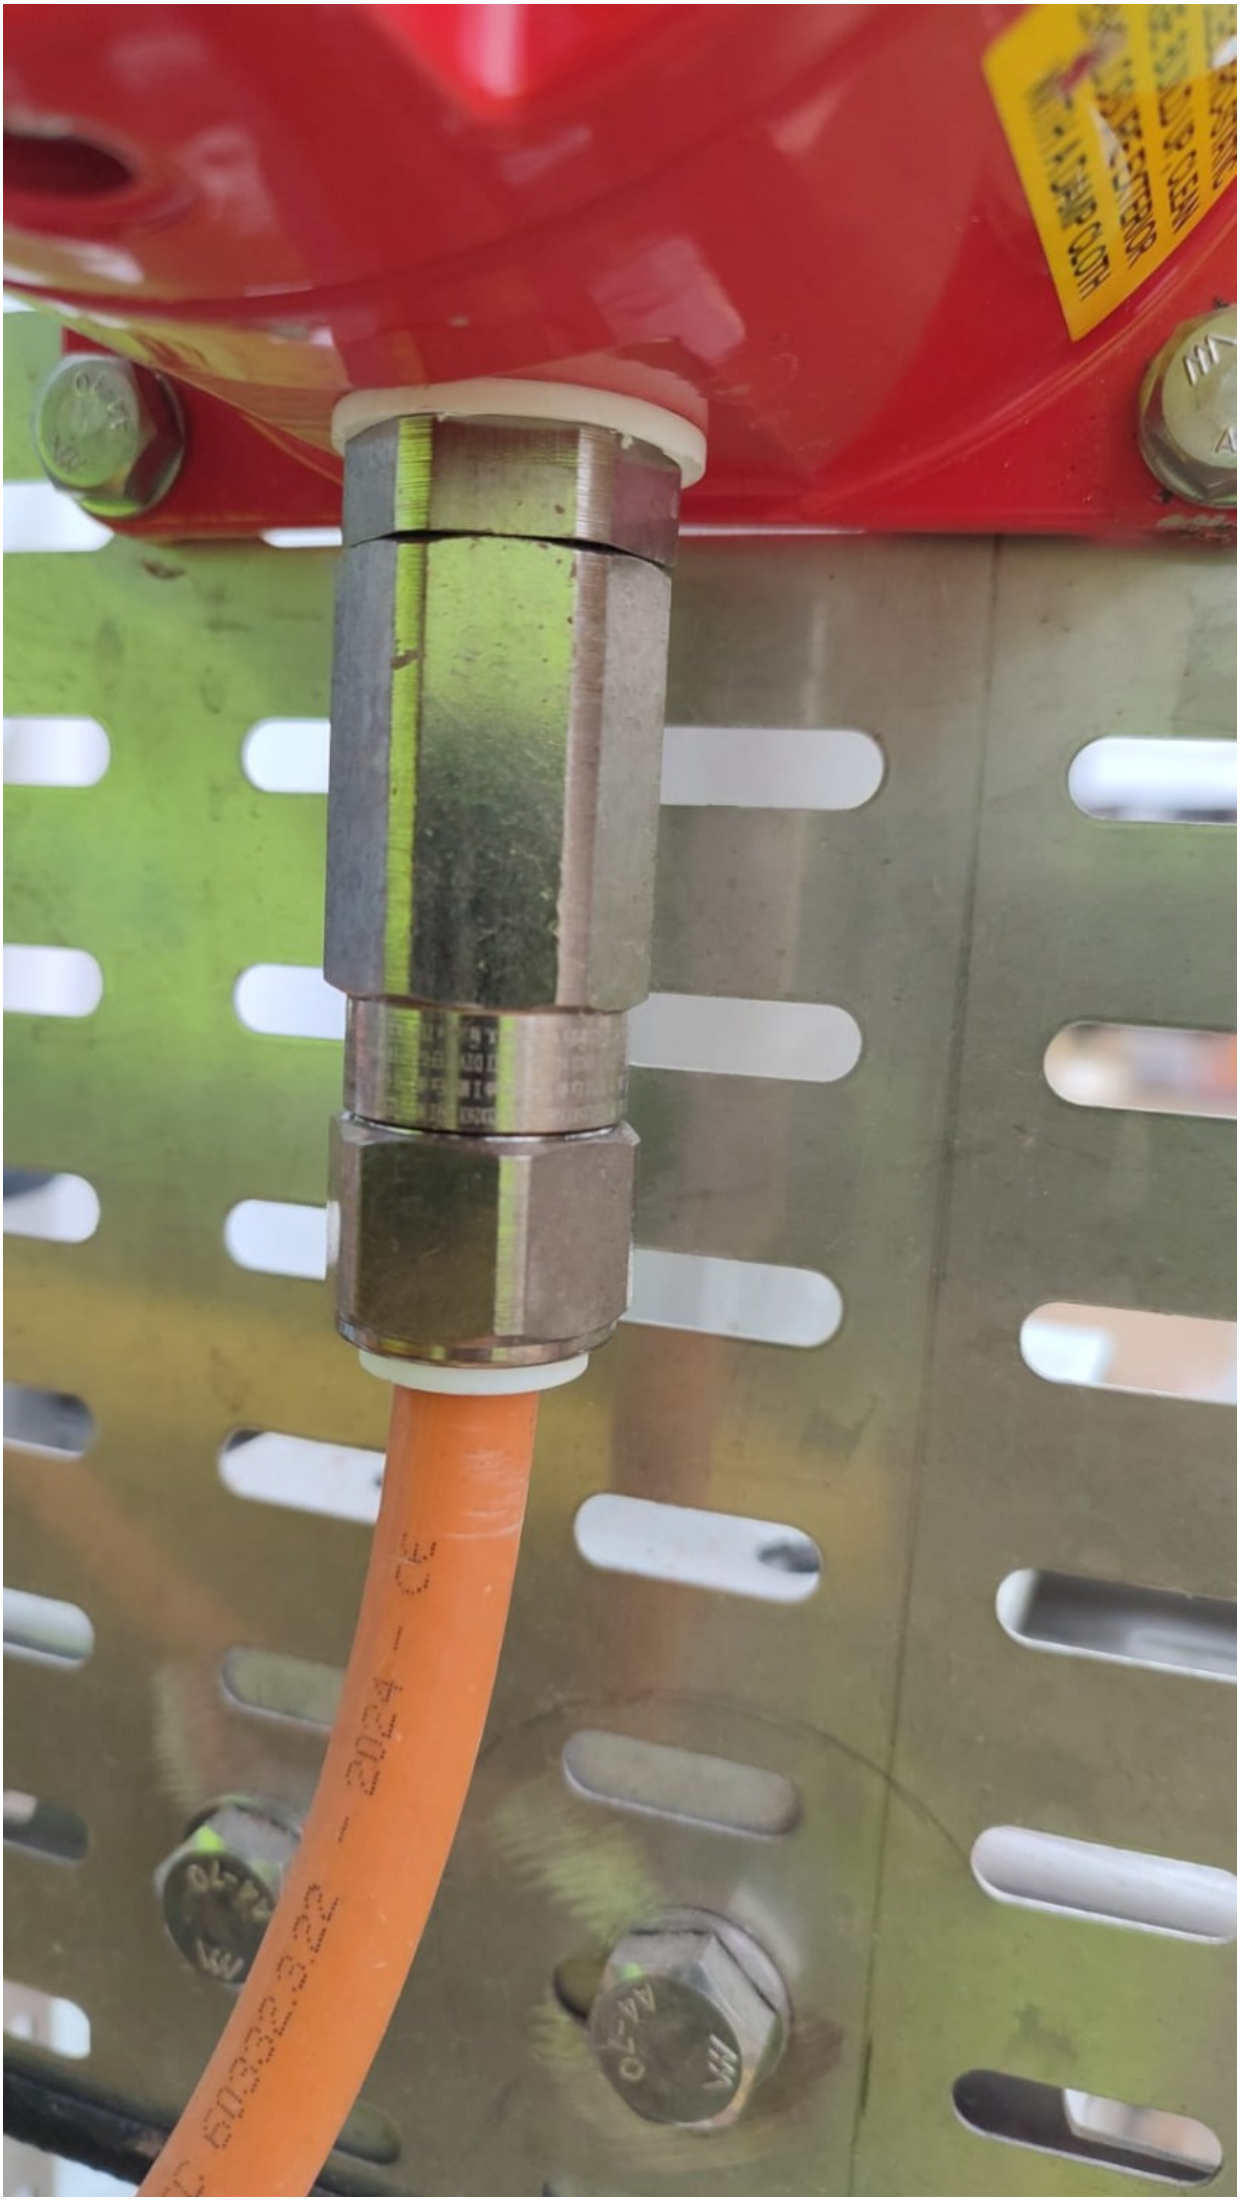



ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000999

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000307	1.4 Discipline	Instrumental
1.2 Item	C-950-MFA-06101/950-JE-06102	MANUAL FIRE ALARM / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing cable tags on all routing.

Name: Giovanni Tangianu

Date: 2024-11-28

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2024-11-28
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-01-29

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001004

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000308	1.4 Discipline	Instrumental
1.2 Item	C-950-MFA-06102/950-JE-06102	MANUAL FIRE ALARM / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

The cable is too long under the instrument (950-MFA-06102). See attached photo.

Name: Giovanni Tangianu

Date: 2024-11-28

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2024-11-28
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-01-20

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:


WARNING
-350-MEA-06102-2E-06102

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001018

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001070	1.4 Discipline	Instrumental
1.2 Item	950-MFA-06102	FZ-06 MFA Activation	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

The instrument has paint damage . See attached photo.

Name: Giovanni Tangianu

Date: 2024-11-28

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2024-11-28
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

-paint has been restored.

Name: Giovanni Tangianu

Date: 2025-04-04

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:


SERIES RESISTOR
E.O.L. RESISTOR
SERIES DIODE FITTED
E.O.L DIODE FITTED

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001019

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000308	1.4 Discipline	Instrumental
1.2 Item	C-950-MFA-06102/950-JE-06102	MANUAL FIRE ALARM / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing cable tags on all routing.

Name: Giovanni Tangianu

Date: 2024-11-28

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2024-11-28
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-01-29

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001020

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001070	1.4 Discipline	Instrumental
1.2 Item	950-MFA-06102	FZ-06 MFA Activation	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing one bolt on the cover instrument. (950-MFA-06102) see attached photo.

Name: Giovanni Tangianu
Date: 2024-11-28
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	A PL A	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2024-11-28
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:


5 - CLEARANCE CHECK

done

Name: Eleonora Carotenuto
Date: 2024-12-07
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:

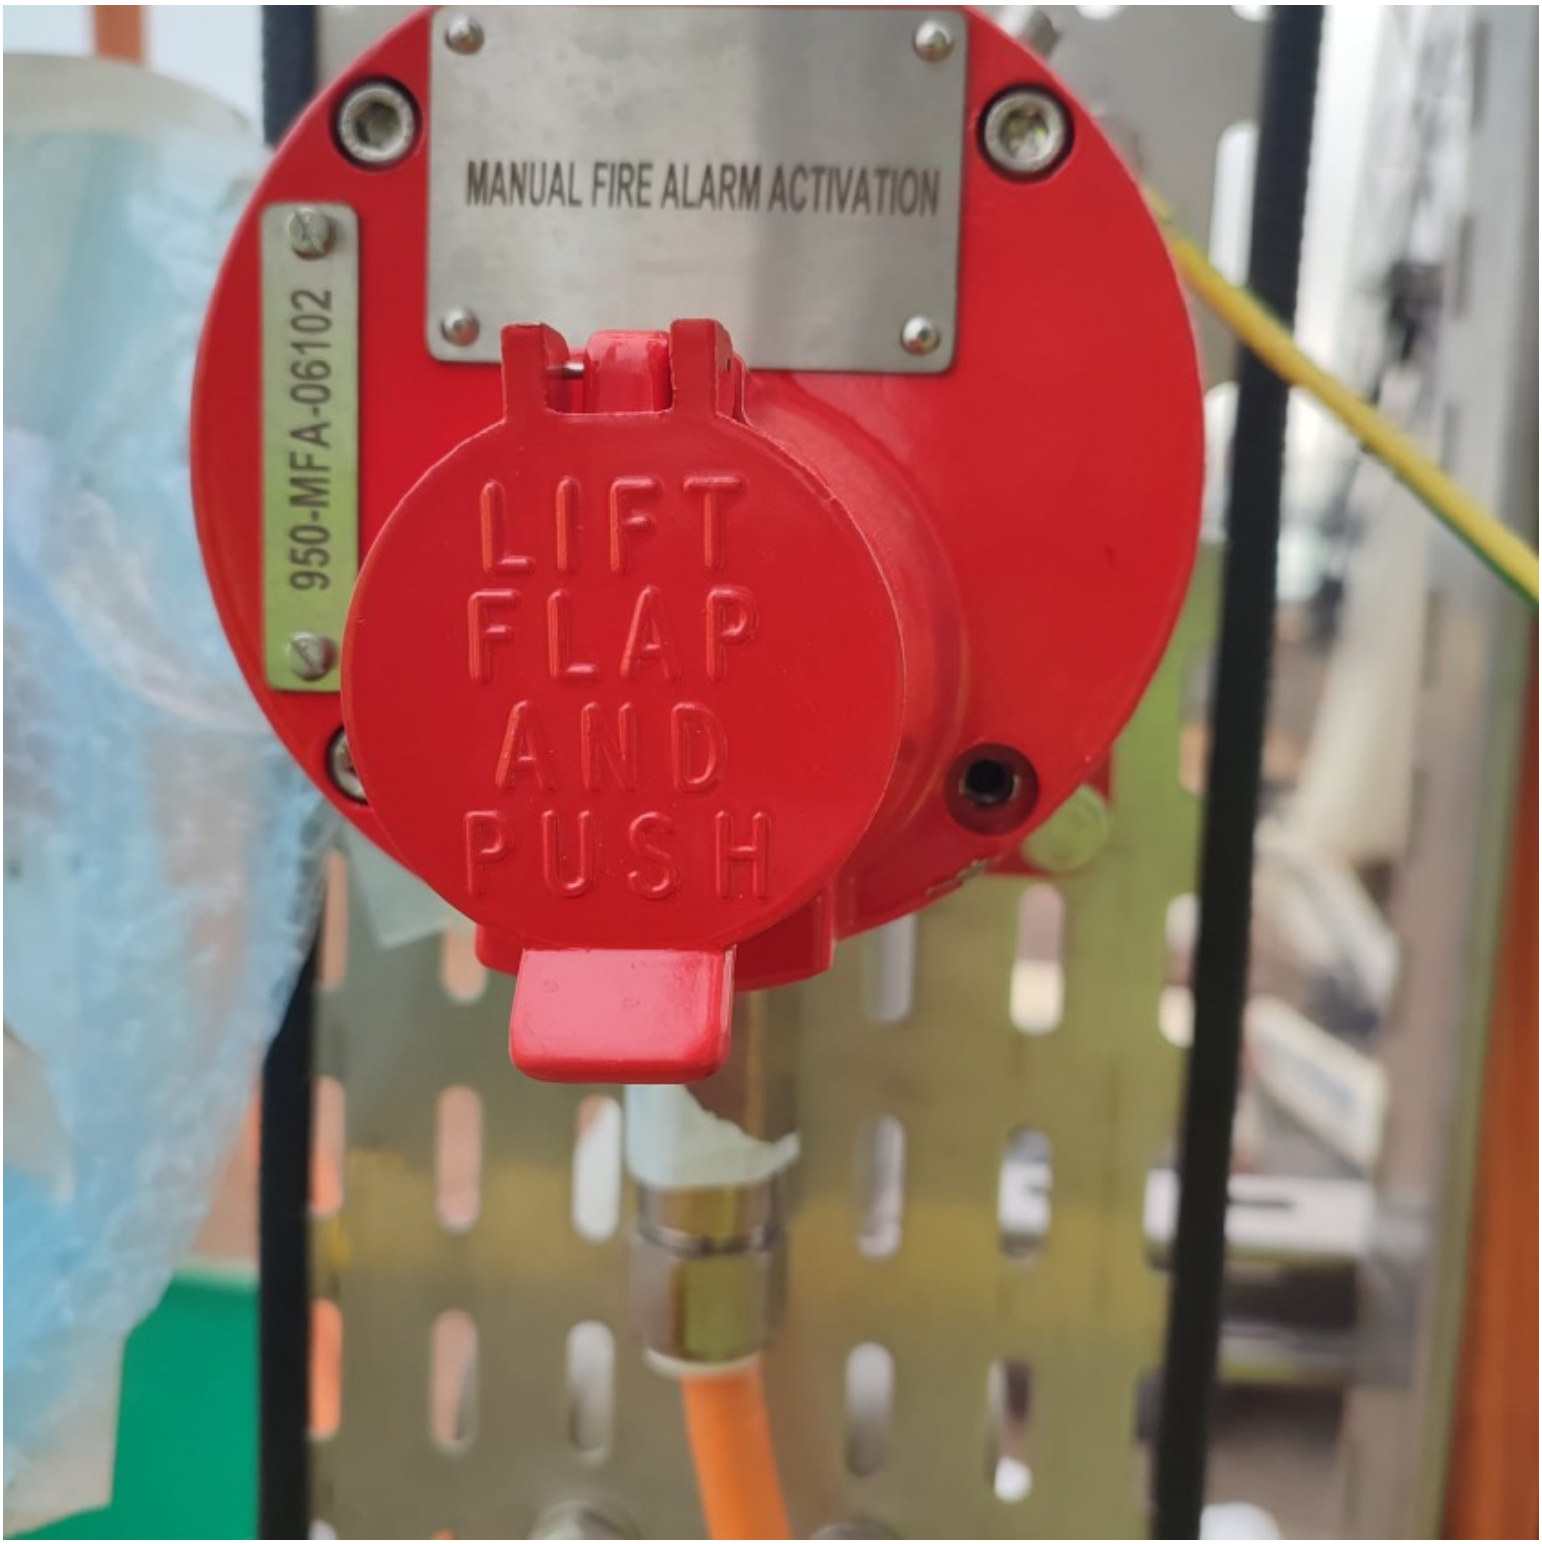
MANUAL FIRE ALARM ACTIVATION
950-MFA-06102
LIFT
FLAP
AND
PUSH

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001104

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000398	1.4 Discipline	Instrumental
1.2 Item	C-950-MFA-06201/B400-FGS-003	MANUAL FIRE ALARM / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

the philosophy of cross-ferruling are wrong side instr. C-950-MFA-06201 . (see document 123A90-DDL-IN-DG-40016 sh.3)

Name: Alessio Polo
Date: 2024-12-02
Signature:

3 - DEFECT ASSESSMENT

..

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-02
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:


5 - CLEARANCE CHECK

DONE

Name: Josip Krizanic
Date: 2025-02-24
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:

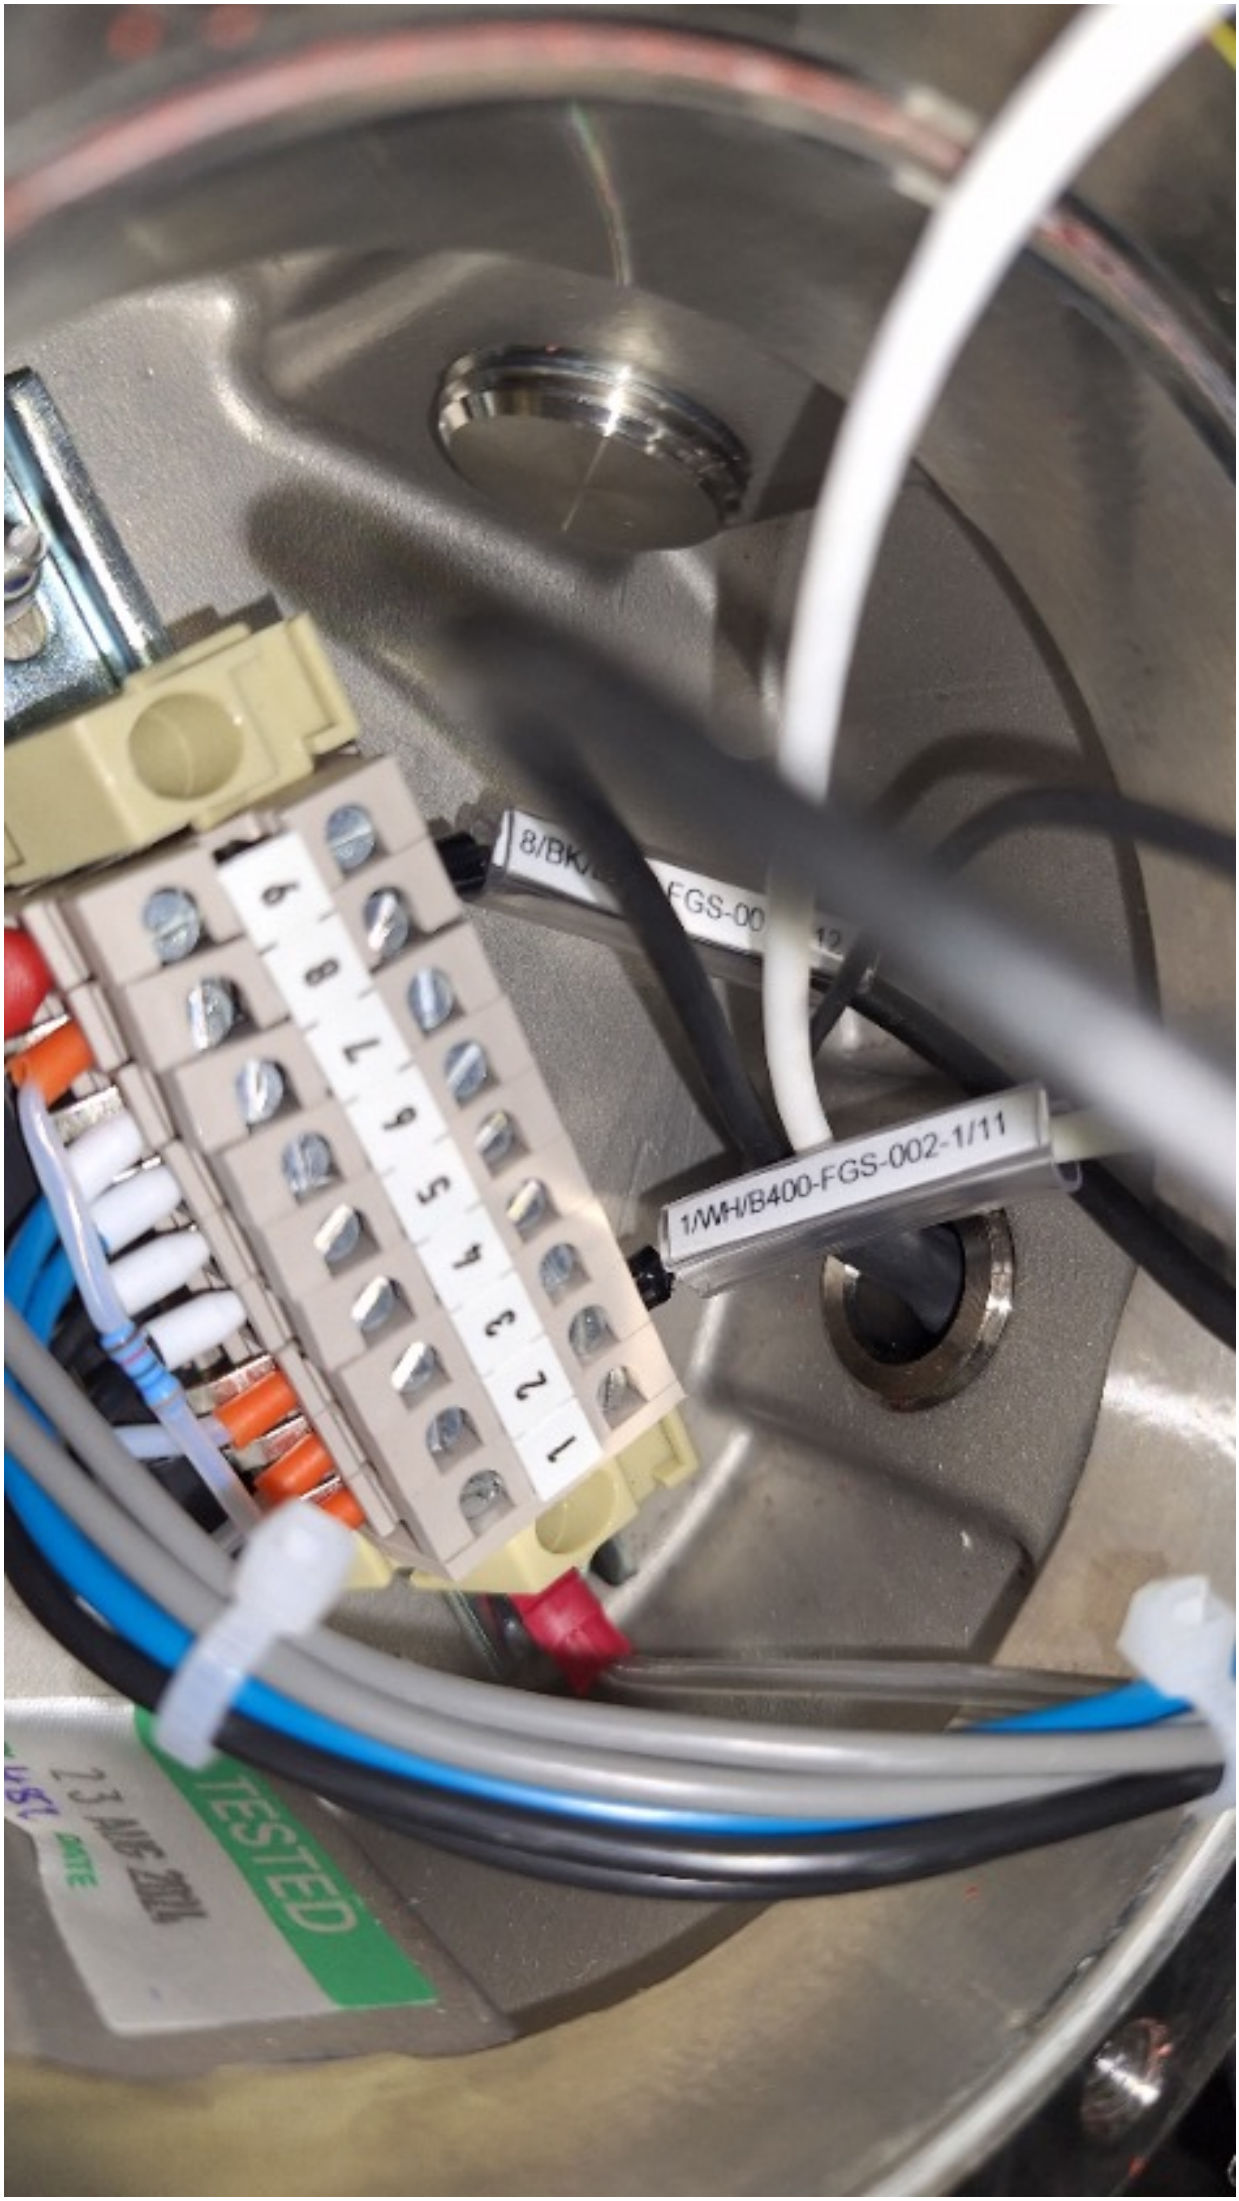
1/WH/B400-FGS-002-1/11
TESTED
13 AUG 2014

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001105

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000398	1.4 Discipline	Instrumental
1.2 Item	C-950-MFA-06201/B400-FGS-003	MANUAL FIRE ALARM / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

the cables tag. is wrong side instr. C-950-MFA-06201 . (see document 123A90-DDL-IN-DG-40016 sh.3)

Name: Alessio Polo

Date: 2024-12-02

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-02
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-28

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:


C-950-MFA-06201/B400-FGS-002

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001106

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000398	1.4 Discipline	Instrumental
1.2 Item	C-950-MFA-06201/B400-FGS-003	MANUAL FIRE ALARM / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing the cross-ferruling (Cores) . Pannel side B400-FGS-003 . (see document 123A90-DDL-IN-DG-40016 sh.3)

Name: Alessio Polo
Date: 2024-12-02
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-02
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:

5 - CLEARANCE CHECK

DONE

Name: Josip Krizanic
Date: 2025-02-26
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:


1
2
3
4
5
6
7
8
9
10
11
12
13

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001107

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000398	1.4 Discipline	Instrumental
1.2 Item	C-950-MFA-06201/B400-FGS-003	MANUAL FIRE ALARM / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing cable tag , cabinet input B400-FGS-003.

Name: Alessio Polo

Date: 2024-12-02

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-02
3.5 Action by	PRE-COMM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-02-26

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:



ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001108

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000398	1.4 Discipline	Instrumental
1.2 Item	C-950-MFA-06201/B400-FGS-003	MANUAL FIRE ALARM / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

The copper conductor of the cable armor must be individually connected to the earthing bar-side B400-FGS-003. See 123A90-DDL-EL-DD-20090.

Name: Alessio Polo
Date: 2024-12-02
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-02
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo
Date: 2025-02-04
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:



ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001109

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000398	1.4 Discipline	Instrumental
1.2 Item	C-950-MFA-06201/B400-FGS-003	MANUAL FIRE ALARM / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Double shield connected to one terminal on shield bar. this point is valid also for cabinet side B400-FGS-003.

Name: Alessio Polo

Date: 2024-12-02

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-02
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-27

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

TB-77-HS-001
TB-77-HS-002
TB-77-ZSL
TB-20-UCP-001
TB-50-LP-002
PR1/320PLC/TB-P320PLC/01
PR1/320PLC/TB-P320PLC/02

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001199

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000989	1.4 Discipline	Instrumental
1.2 Item	950-FDZ-06101	Flame Detector - FZ-06 B-100 Area	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

The tag tie is made of plastic. To be replaced in AISI

Name: Alessio Polo

Date: 2024-12-03

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-03
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-01-21

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001200

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10002417	1.4 Discipline	Instrumental
1.2 Item	950-FDZ-06102	Flame Detector - FZ-06 B-100 Area	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

The tag tie is made of plastic. To be replaced in AISI

Name: Alessio Polo

Date: 2024-12-03

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-03
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-01-20

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001201

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001122	1.4 Discipline	Instrumental
1.2 Item	950-XL-06103	FZ-06 Gas Beacon Activation	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

the support is not well secured against vibration. another support needs to be added

Name: Alessio Polo
Date: 2024-12-03
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-03
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:

5 - CLEARANCE CHECK

Installation carried out as per typical 123A90-DDL-EL-DD-20091 and 123A90-DDL-IN-DD-40017 drawing. Eng states that no additional support is needed.

Name: Giovanni Tangianu
Date: 2025-03-07
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:

ROSETTI MARINO CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001202

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001123	1.4 Discipline	Instrumental
1.2 Item	950-XL-06104	FZ-06 Fire Beacon Activation	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

the support is not well secured against vibration. another support needs to be added

Name: Alessio Polo

Date: 2024-12-03

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-03
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

Installation carried out as per typical 123A90-DDL-EL-DD-20091 and 123A90-DDL-IN-DD-40017 drawing. Eng states that no additional support is needed.

Name: Giovanni Tangianu

Date: 2025-03-07

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001203

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000244	1.4 Discipline	Instrumental
1.2 Item	C-950-FDZ-06101/950-JE-06101	FLAME DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing the cross-ferruling (Cores) . Inst. C-950-FDZ-06101 / JB 950-JE-06101 . (see document 123A90-DDL-IN-DG-40016 sh.3)

Name: Alessio Polo
Date: 2024-12-03
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-03
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:


5 - CLEARANCE CHECK

DONE

Name: Josip Krizanic
Date: 2025-02-24
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:

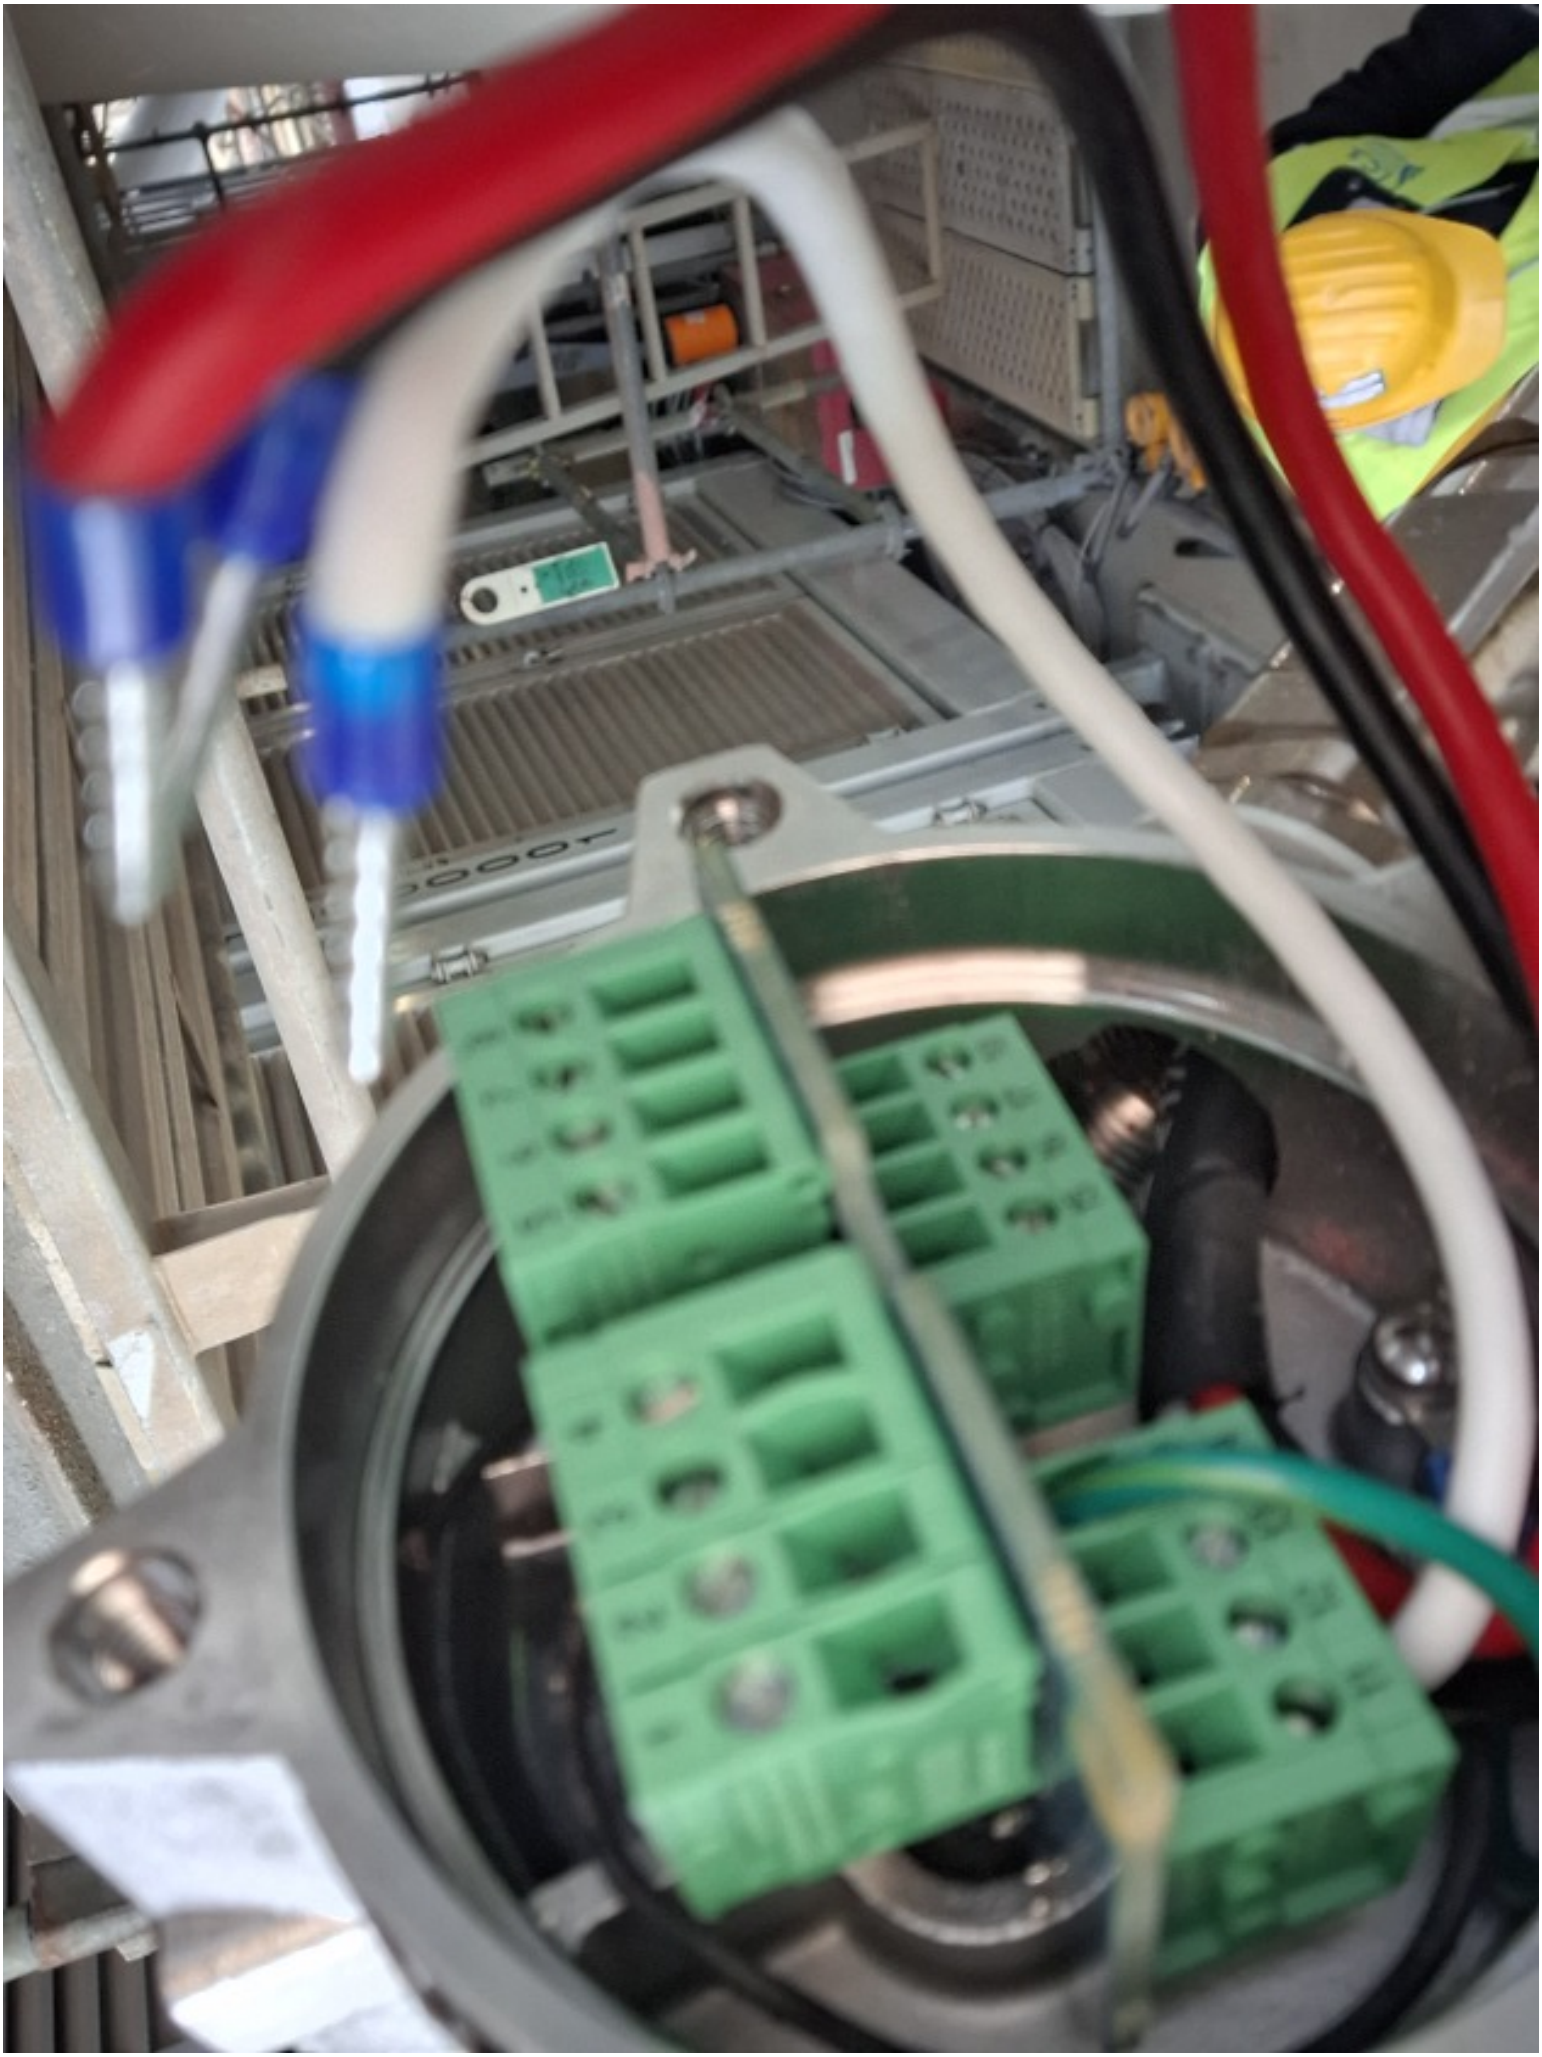

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001204

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000244	1.4 Discipline	Instrumental
1.2 Item	C-950-FDZ-06101/950-JE-06101	FLAME DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing cable tag SS project, near the JB 950-JE-06101

Name: Alessio Polo

Date: 2024-12-03

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-03
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Eleonora Carotenuto

Date: 2024-12-27

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001205

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10002422	1.4 Discipline	Instrumental
1.2 Item	C-950-FDZ-06102/950-JE-06101	FLAME DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing cable tag SS , near the JB 950-JE-06101

Name: Alessio Polo

Date: 2024-12-03

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-03
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Eleonora Carotenuto

Date: 2024-12-27

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001206

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10002422	1.4 Discipline	Instrumental
1.2 Item	C-950-FDZ-06102/950-JE-06101	FLAME DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing the cross-ferruling (Cores) . INST. C-950-FDZ-06102 / JB 950-JE-06101 . (see document 123A90-DDL-IN-DG-40016 sh.3)

Name: Alessio Polo
Date: 2024-12-03
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-03
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:


5 - CLEARANCE CHECK

Installed.

Name: Giovanni Tangianu
Date: 2025-04-08
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:

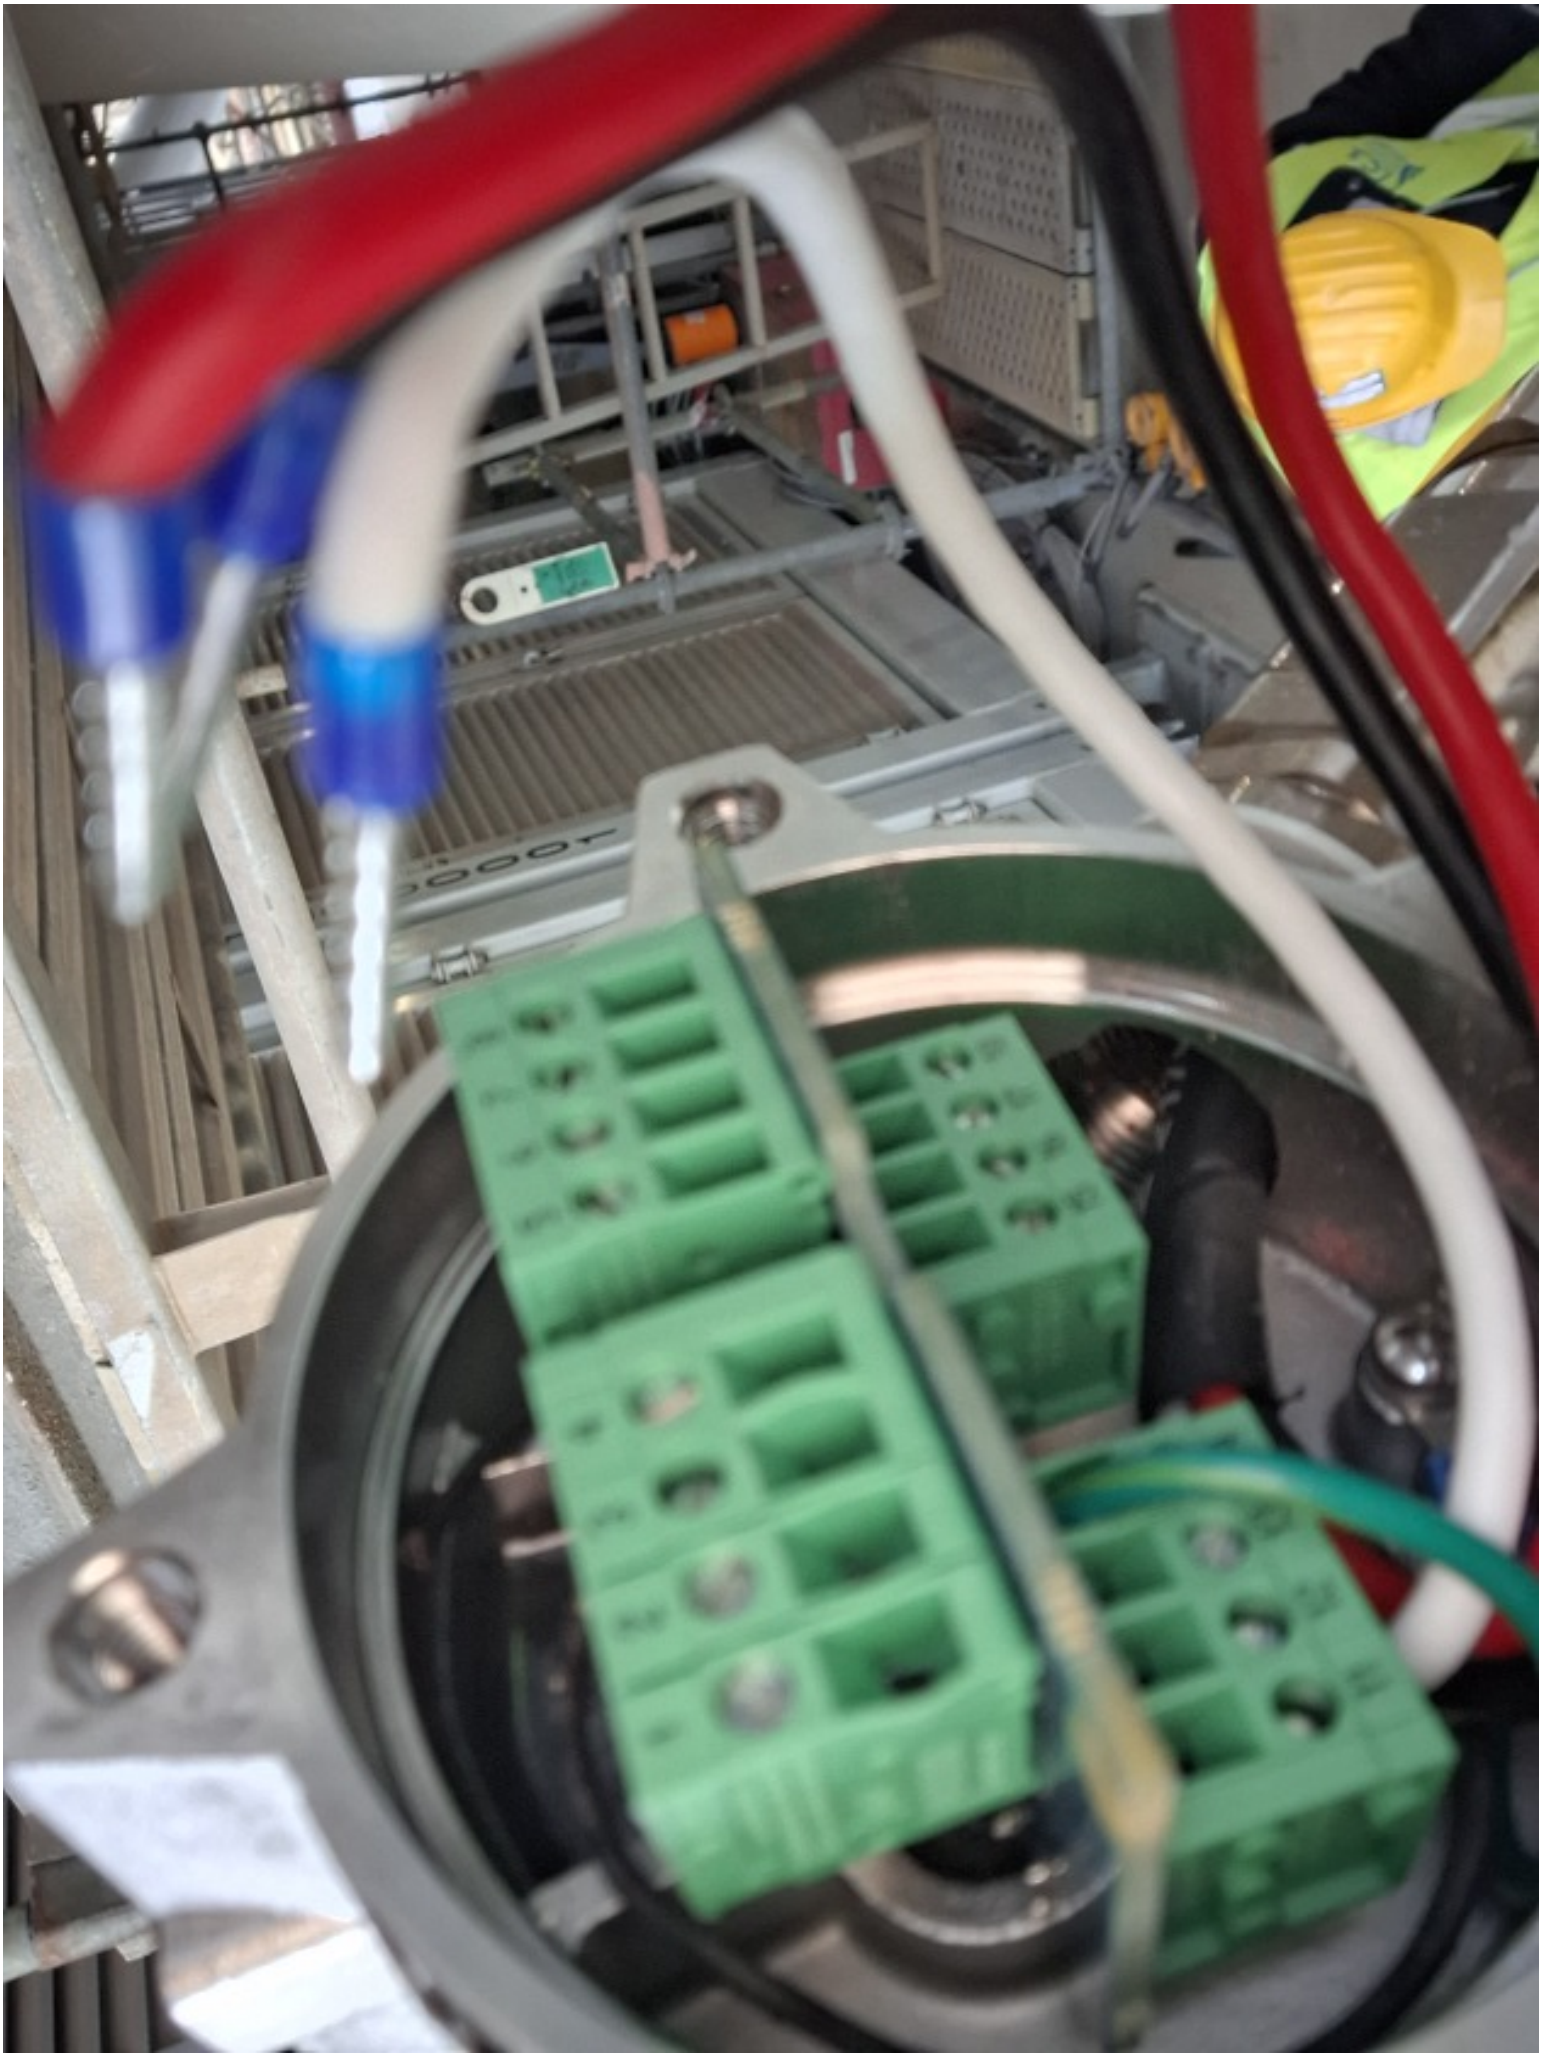

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001207

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001124	1.4 Discipline	Instrumental
1.2 Item	950-XL-06201	FZ-06 Gas Beacon Act. - B-100 Indoor	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

The protection cage of the instrument is damaged (it is not fixed)

Name: Alessio Polo

Date: 2024-12-03

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-03
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

INSTALLED.

Name: Giovanni Tangianu

Date: 2025-03-25

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:





ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001208

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000352	1.4 Discipline	Instrumental
1.2 Item	C-950-XL-06201/950-JE-06203	BEACON / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

The protective cap (shield) is damage . exposed copper

Name: Alessio Polo

Date: 2024-12-03

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-03
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

done.

Name: Giovanni Tangianu

Date: 2025-04-08


Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

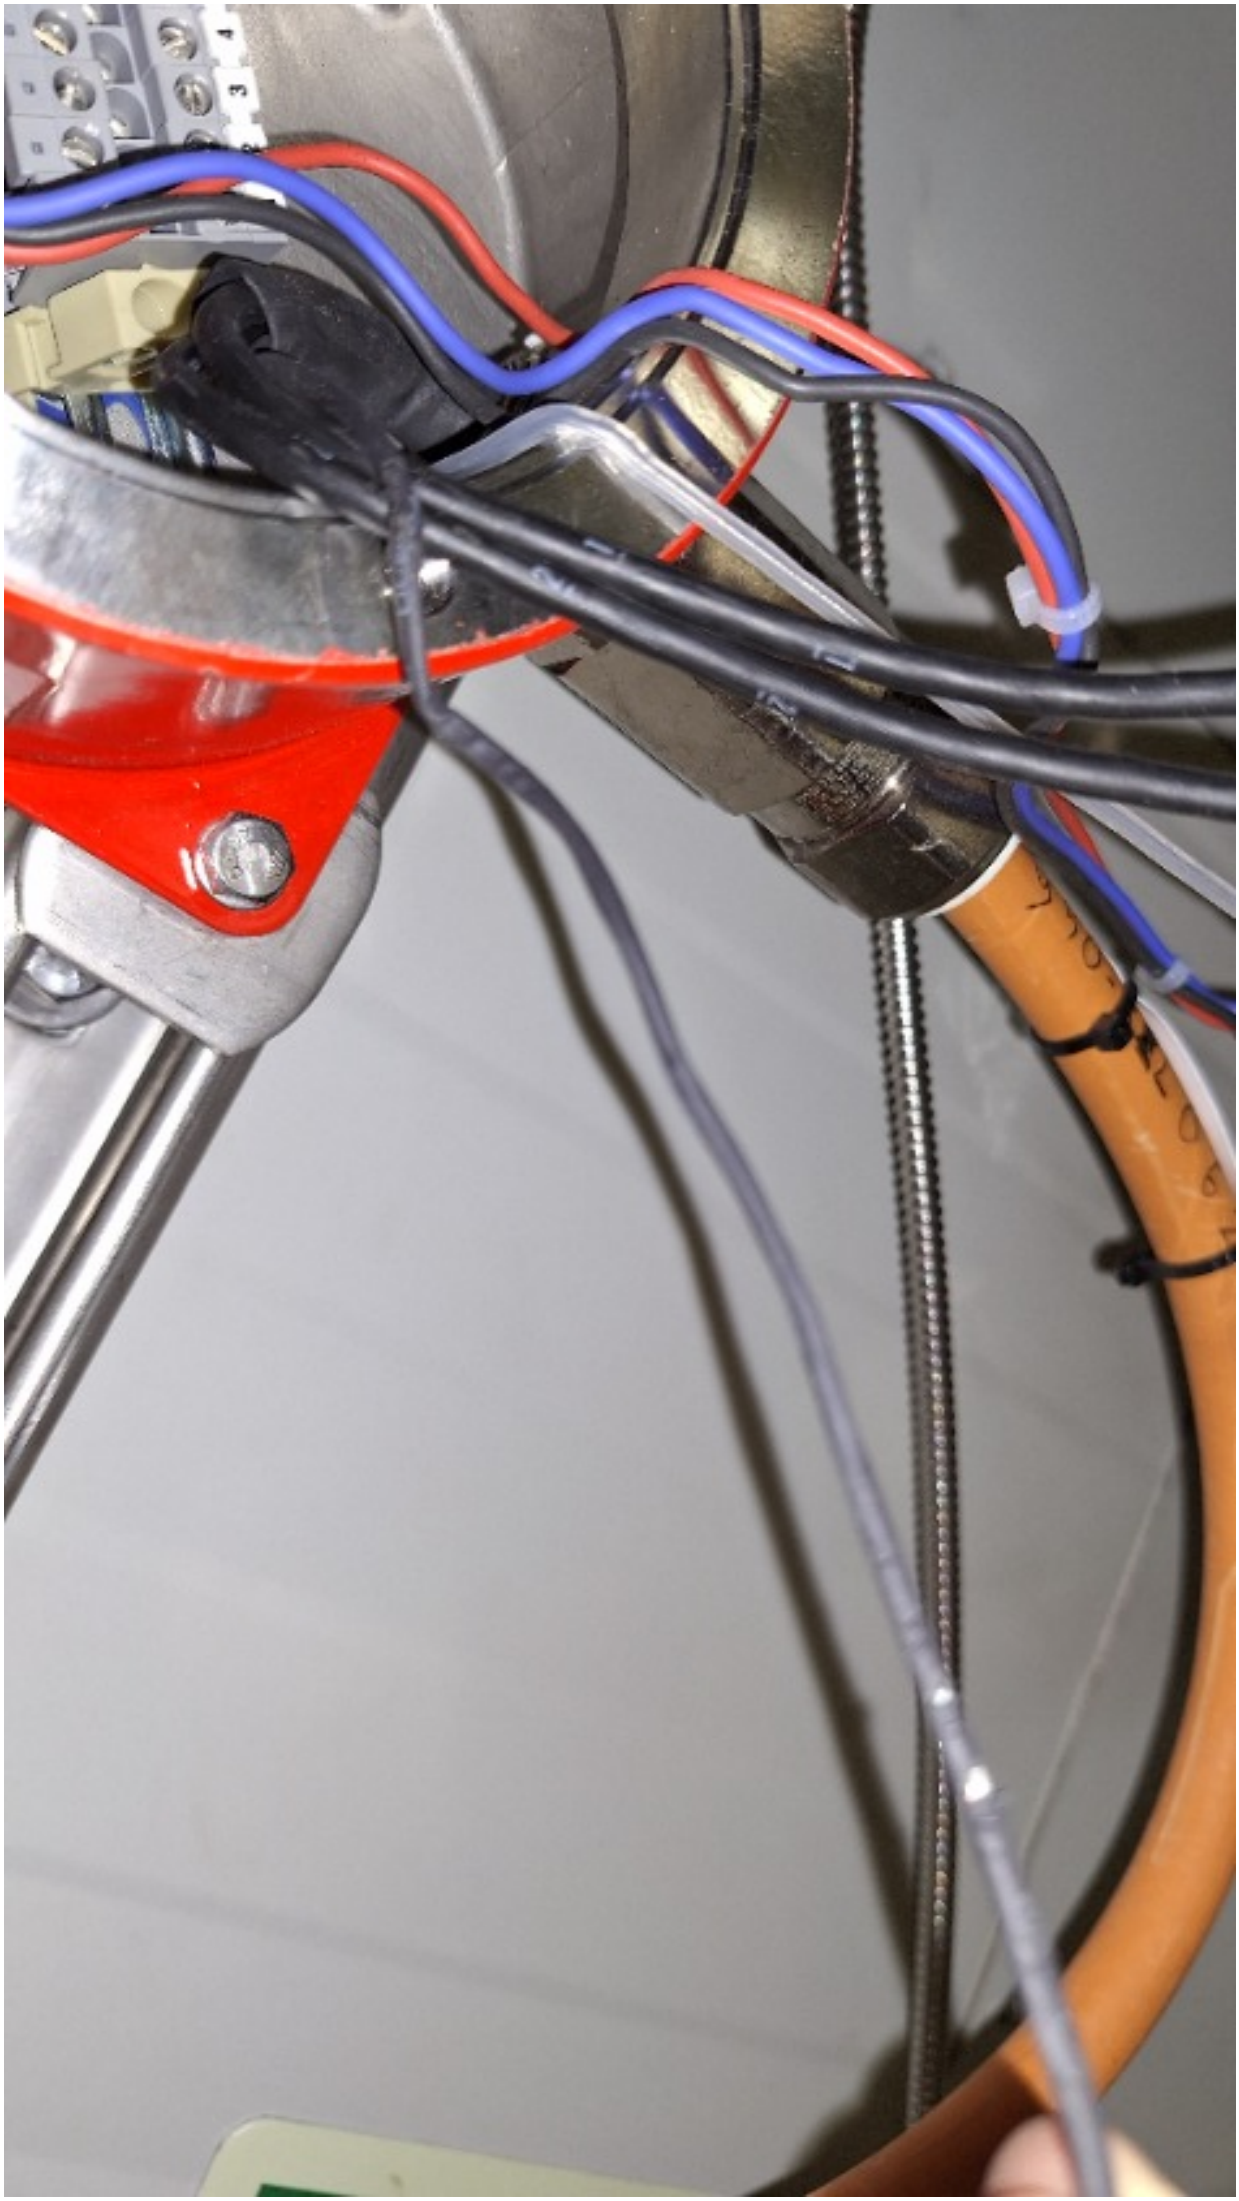

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001209

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000352	1.4 Discipline	Instrumental
1.2 Item	C-950-XL-06201/950-JE-06203	BEACON / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

the philosophy of cross-ferruling are wrong inst.C-950-XL-06201/ jb 950-JE-06203 . (see document 123A90-DDL-IN-DG-40016 sh.3)

Name: Alessio Polo
Date: 2024-12-03
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-03
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:


5 - CLEARANCE CHECK


Installed.

Name: Giovanni Tangianu
Date: 2025-04-08
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:

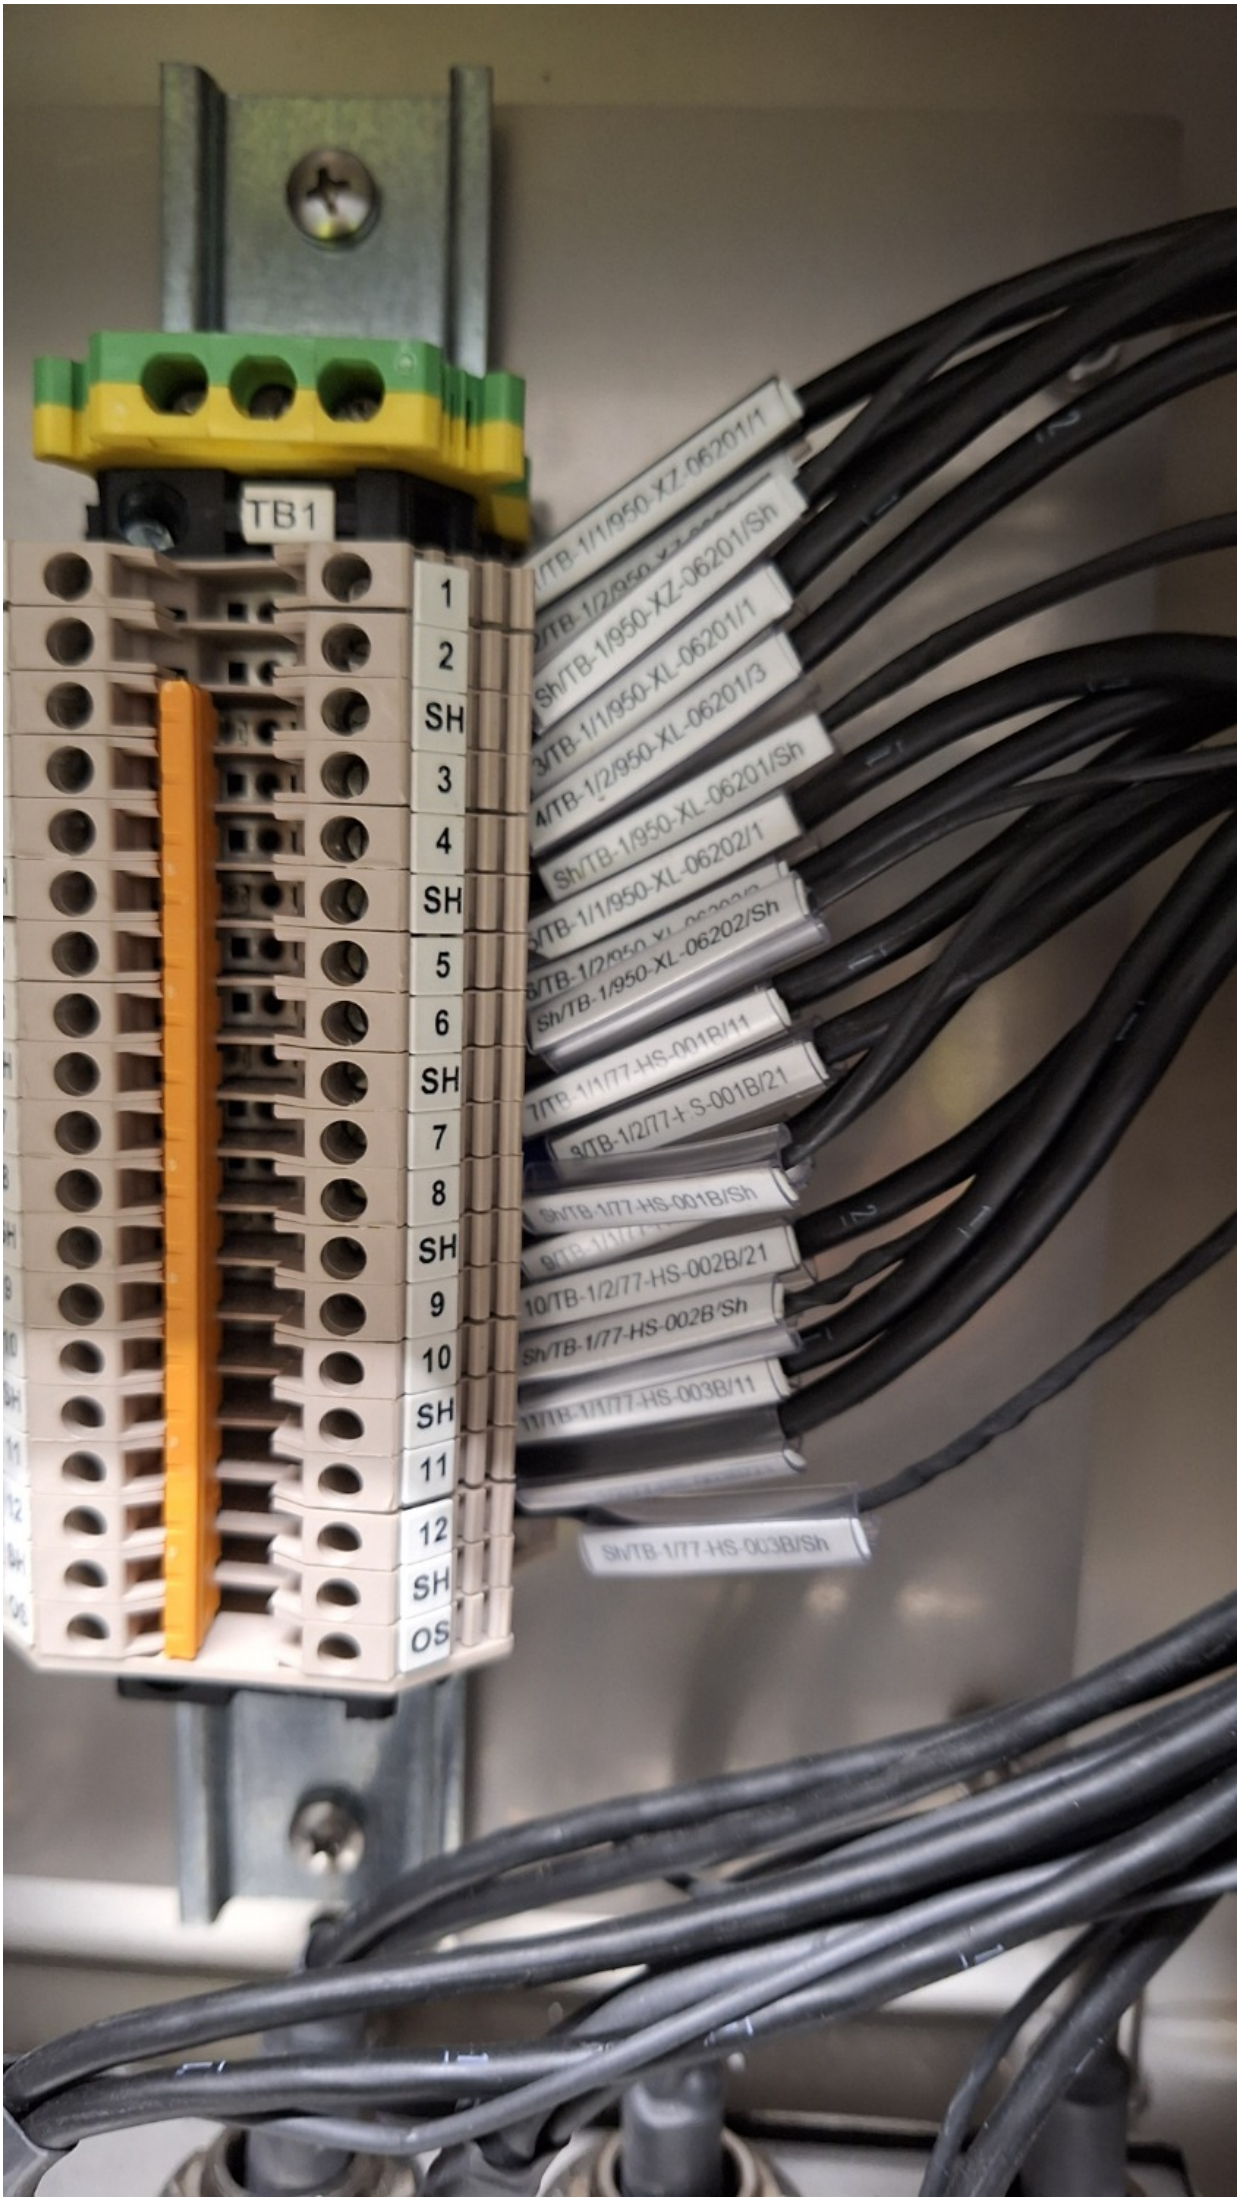
TB1
1
2
SH
3
4
SH
5
6
SH
7
8
SH
9
10
SH
11
12
SH
OS
Sh/TB-1/77-HS-003B/Sh

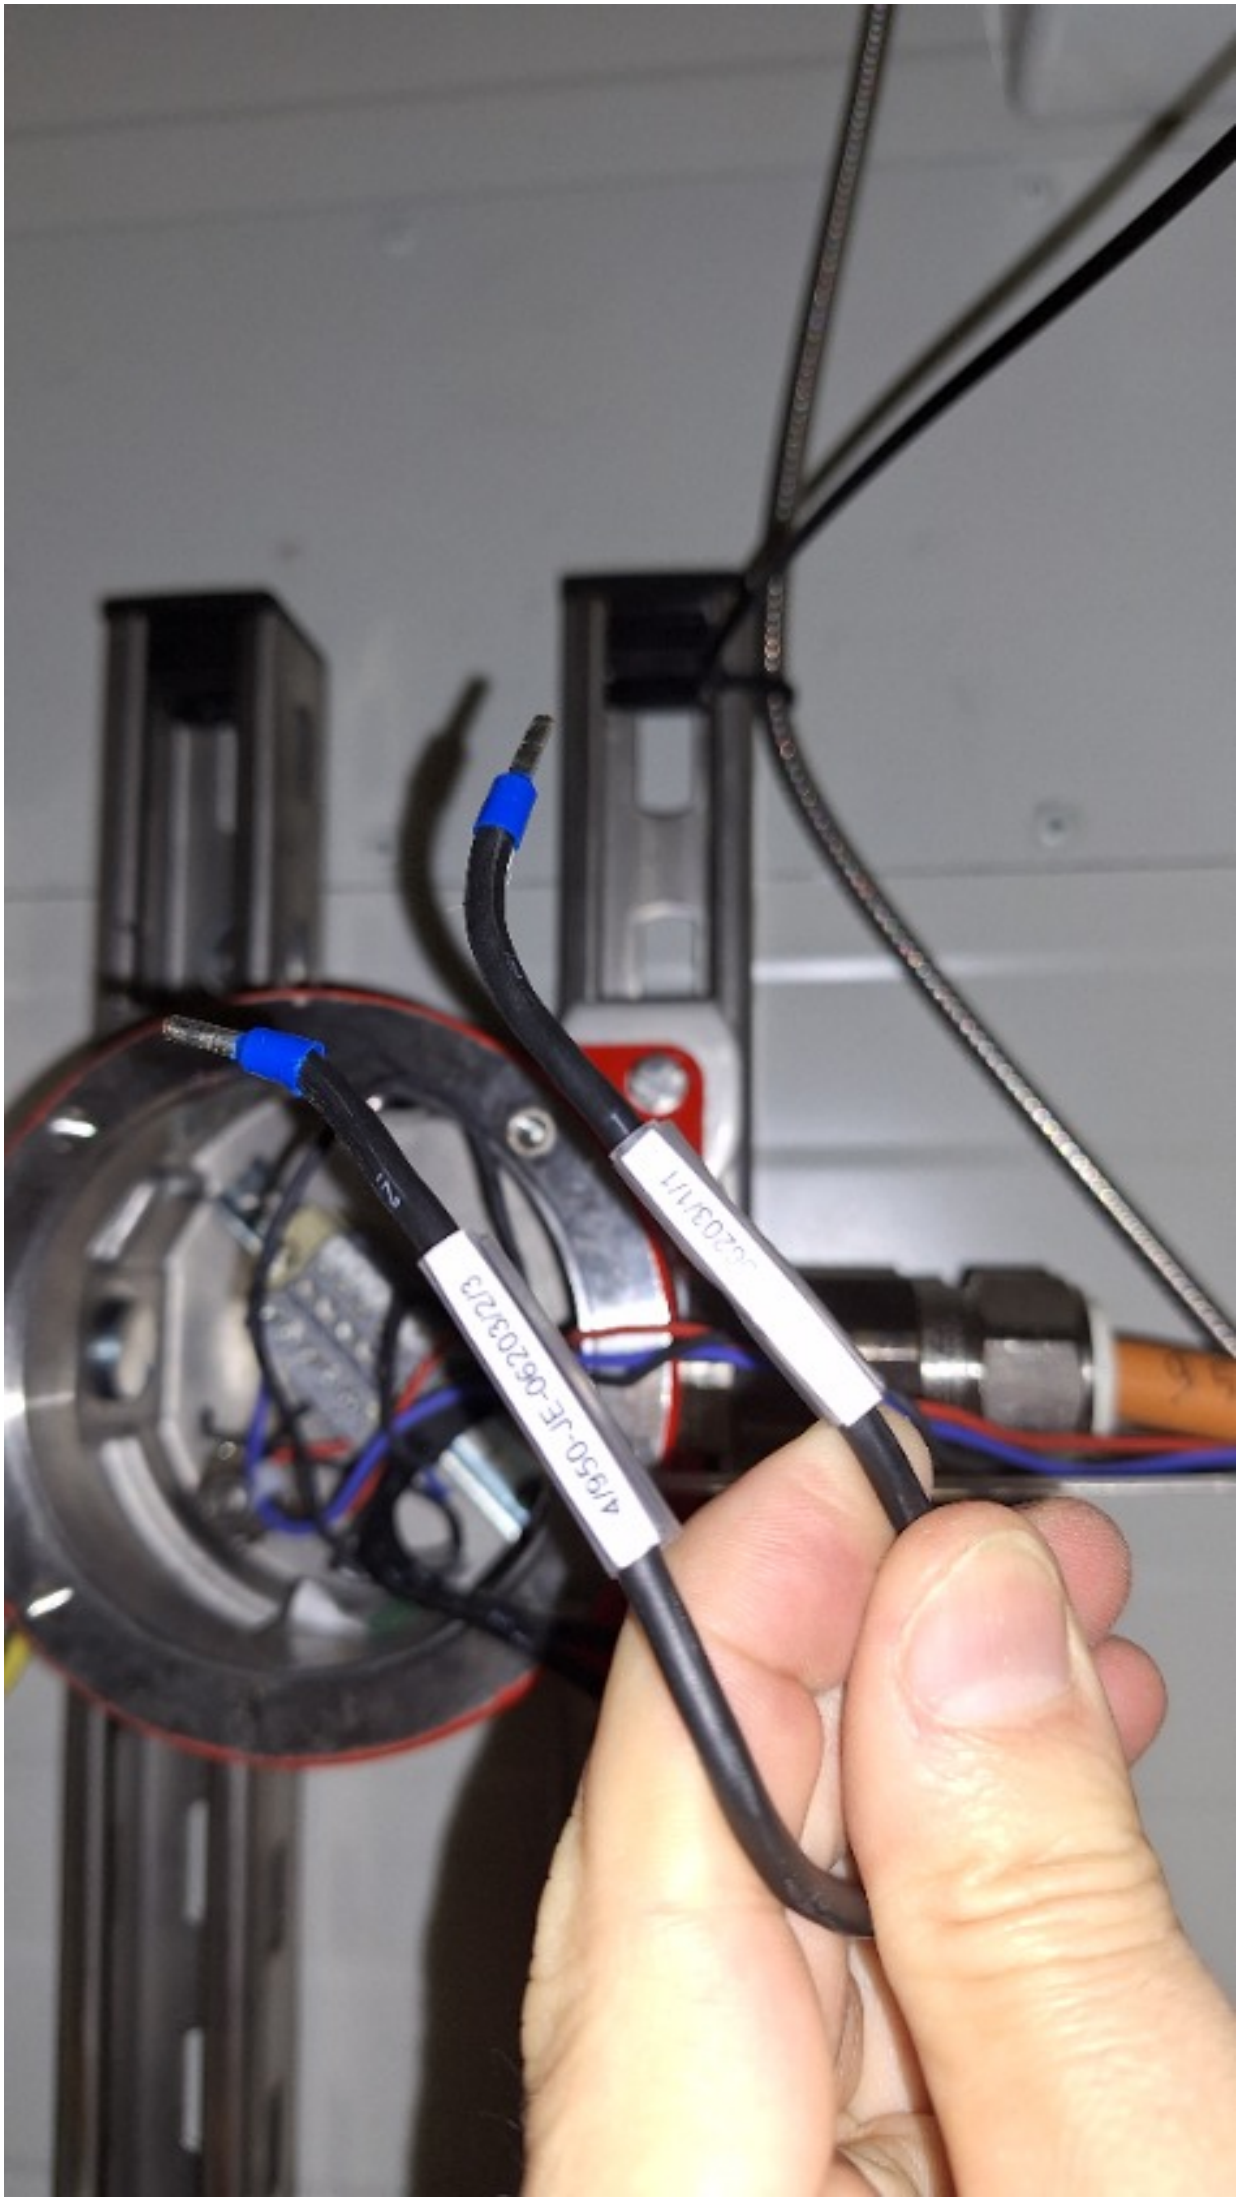
A1950-JE-062032/2
A1950-JE-062032/1

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001213

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000346	1.4 Discipline	Instrumental
1.2 Item	C-950-XL-06103/950-JE-06103	BEACON / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing the cross-ferruling (Cores + Shields) . JB 950-JE-06103 . (see document 123A90-DDL-IN-DG-40016 sh.3)

Name: Alessio Polo
Date: 2024-12-03
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-03
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:


5 - CLEARANCE CHECK

DONE

Name: Josip Krizanic
Date: 2025-03-01
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:

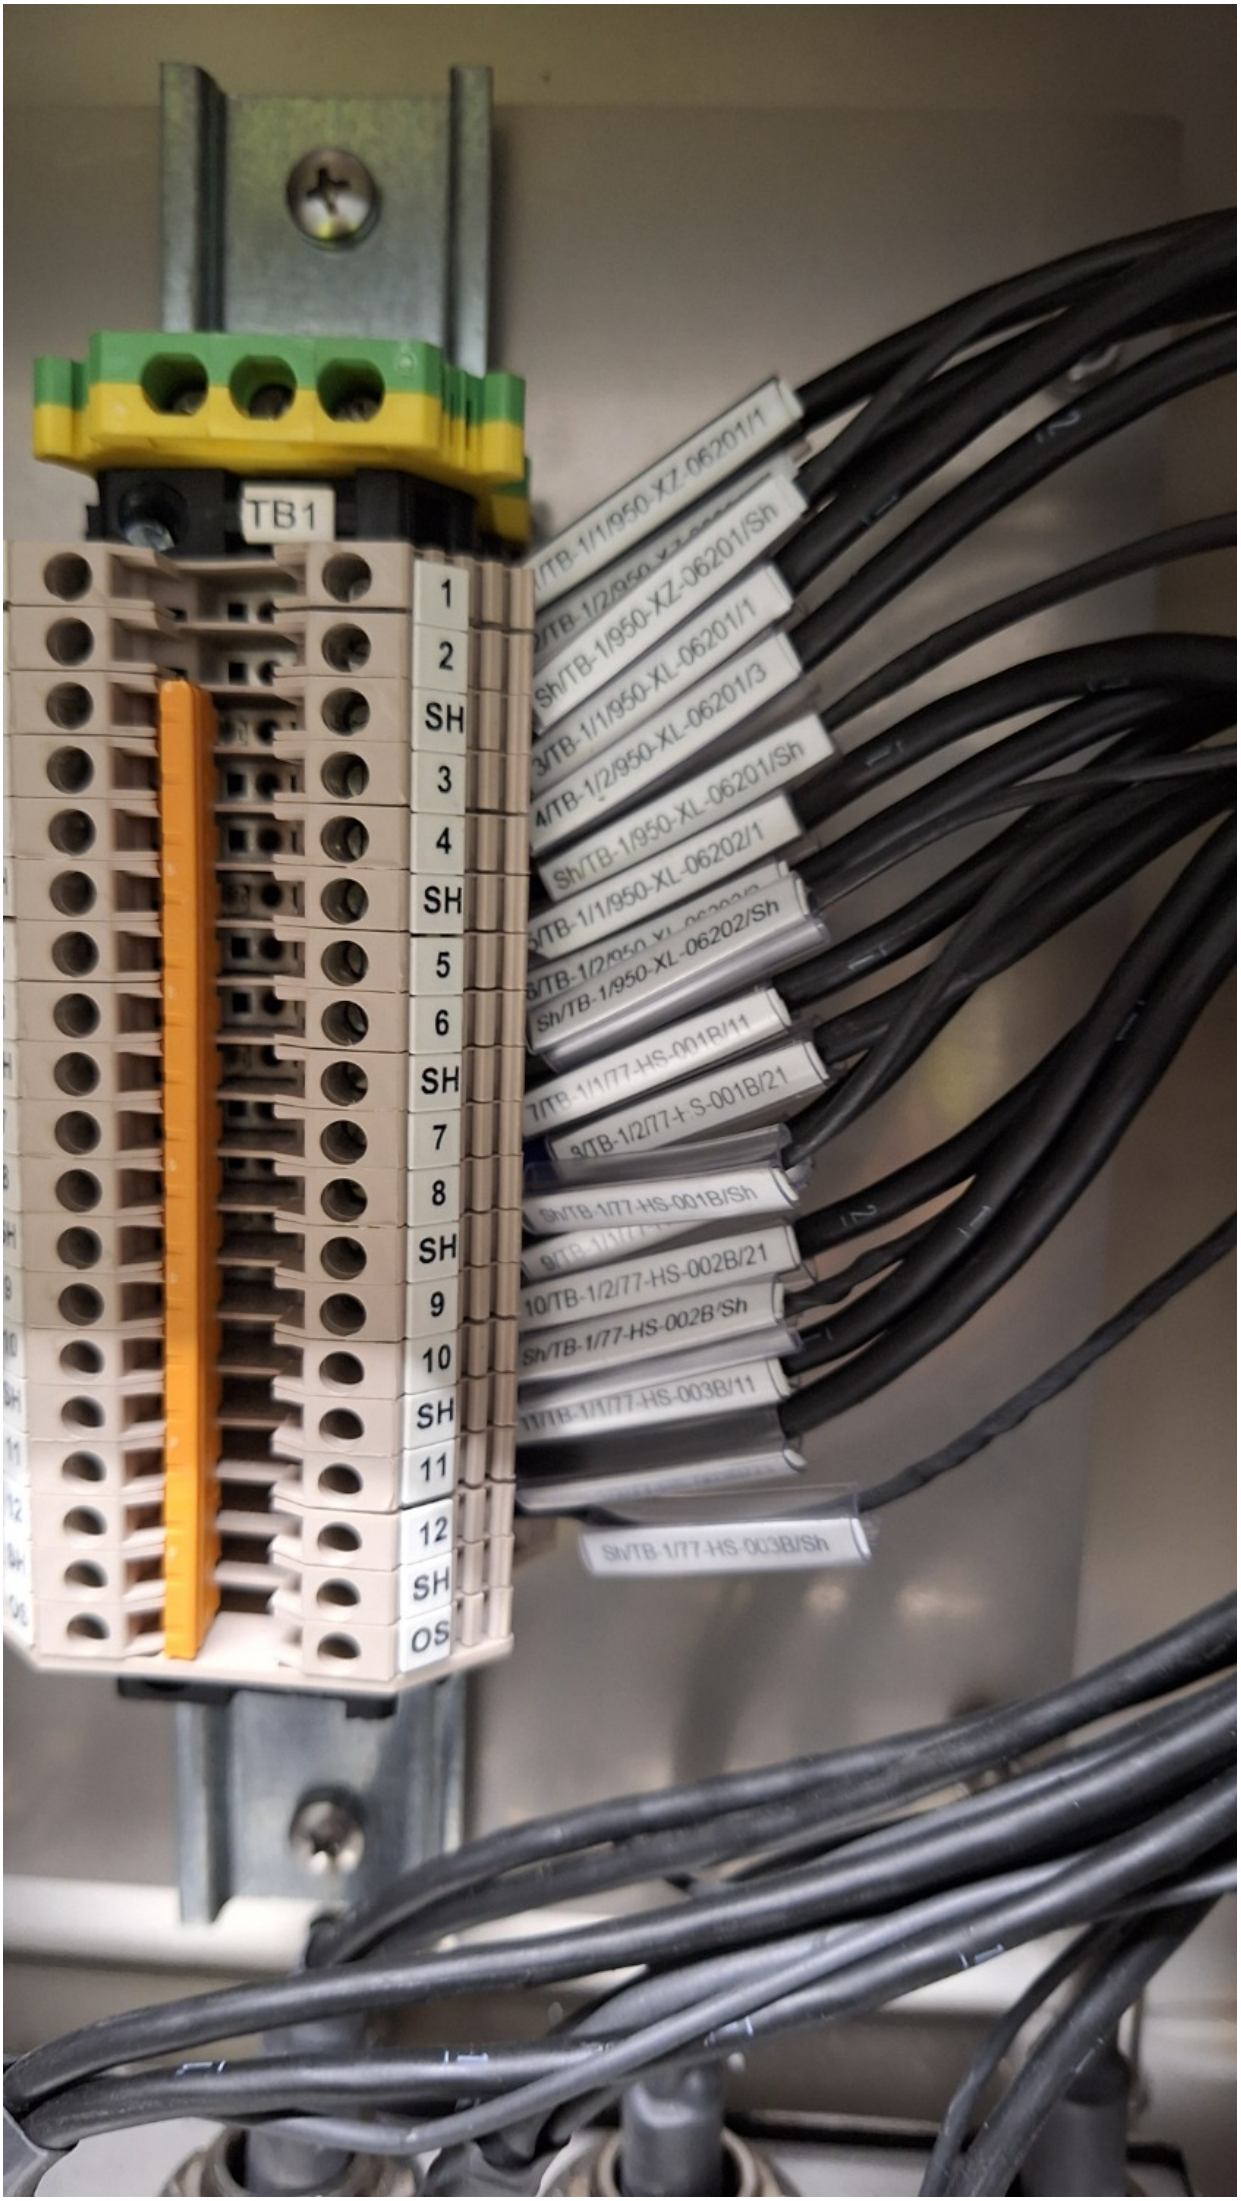
TB1
1
2
SH
3
4
SH
5
6
SH
7
8
SH
9
10
SH
11
12
SH
OS
Sh/TB-1/77-HS-003B/Sh

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001214

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000347	1.4 Discipline	Instrumental
1.2 Item	C-950-XL-06104/950-JE-06103	BEACON / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing the cross-ferruling (Cores + Shields) . JB 950-JE-06103 . (see document 123A90-DDL-IN-DG-40016 sh.3)

Name: Alessio Polo
Date: 2024-12-03
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-03
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:

5 - CLEARANCE CHECK

DONE

Name: Josip Krizanic
Date: 2025-02-26
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:


TB1
1
2
SH
3
4
SH
5
6
SH
7
8
SH
9
10
SH
11
12
SH
OS
1/950-XZ-06101/1
2/950-XZ-06101/2
Sh/950-XZ-06101/Sh
4/950-XL-06101/3
Sh/950-XZ-06102/Sh
5/950-XL-06101/1
Sh/950-XL-06101/Sh
Sh/950-XL-06103/Sh
8/950-XL-06102/3
Sh/950-XL-06102/Sh

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001215

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000351	1.4 Discipline	Instrumental
1.2 Item	C-950-XZ-06201/950-JE-06203	SOUNDER / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

the philosophy of cross-ferruling are wrong J.B. side 950-JE-06203 / INST.C-950-XZ-06201 (see document 123A90-DDL-IN-DG-40016 sh.3)

Name: Alessio Polo
Date: 2024-12-03
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-12-03
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:


5 - CLEARANCE CHECK


DONE

Name: Josip Krizanic
Date: 2025-02-24
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:

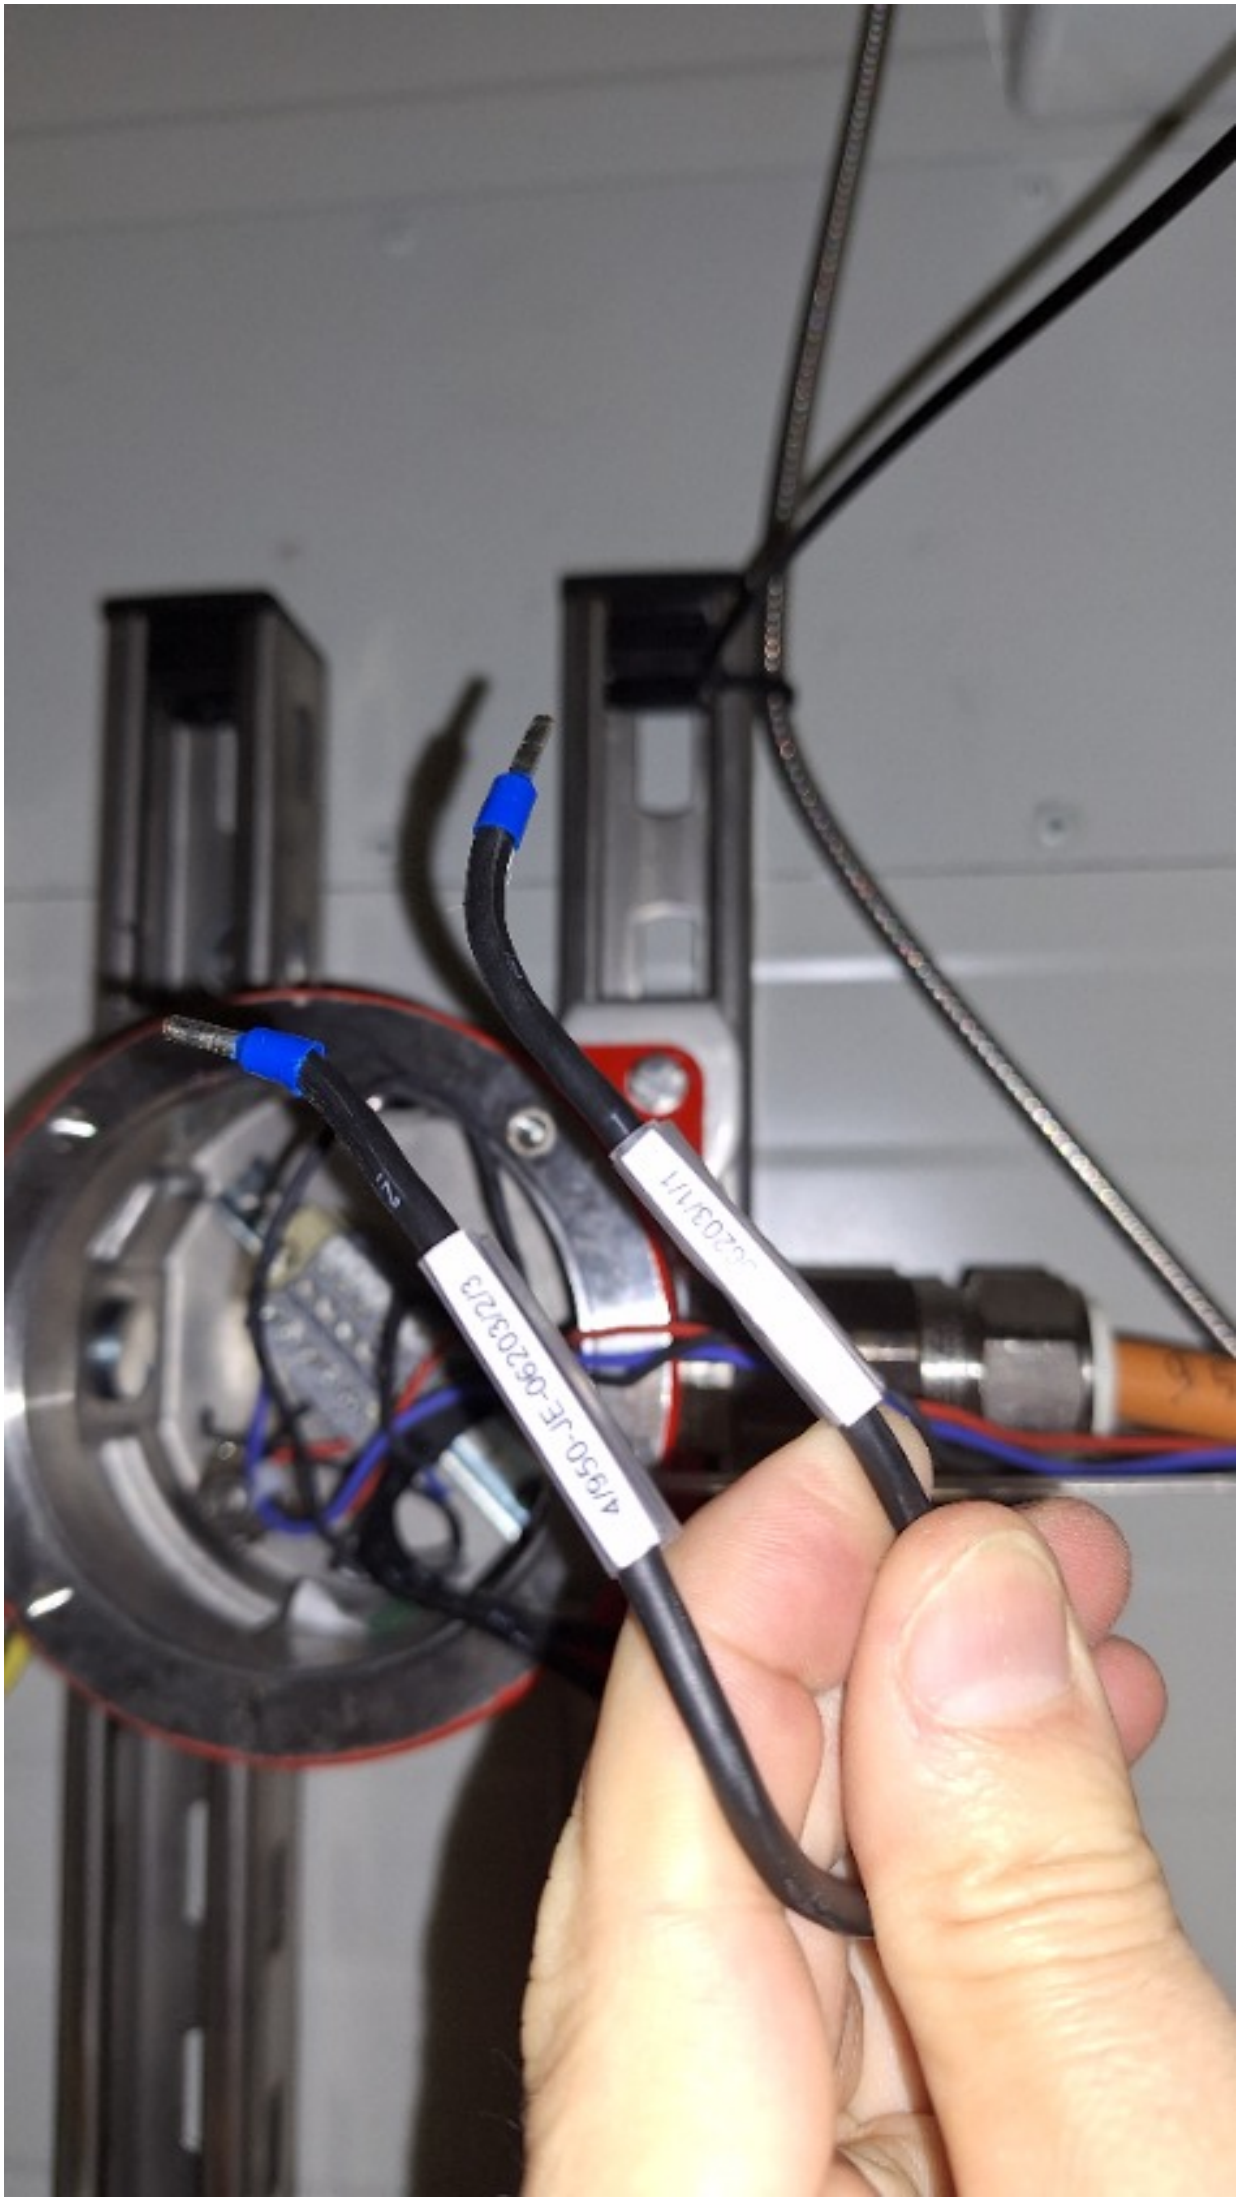
A1950-JE-062032/2
A1950-JE-062032/1

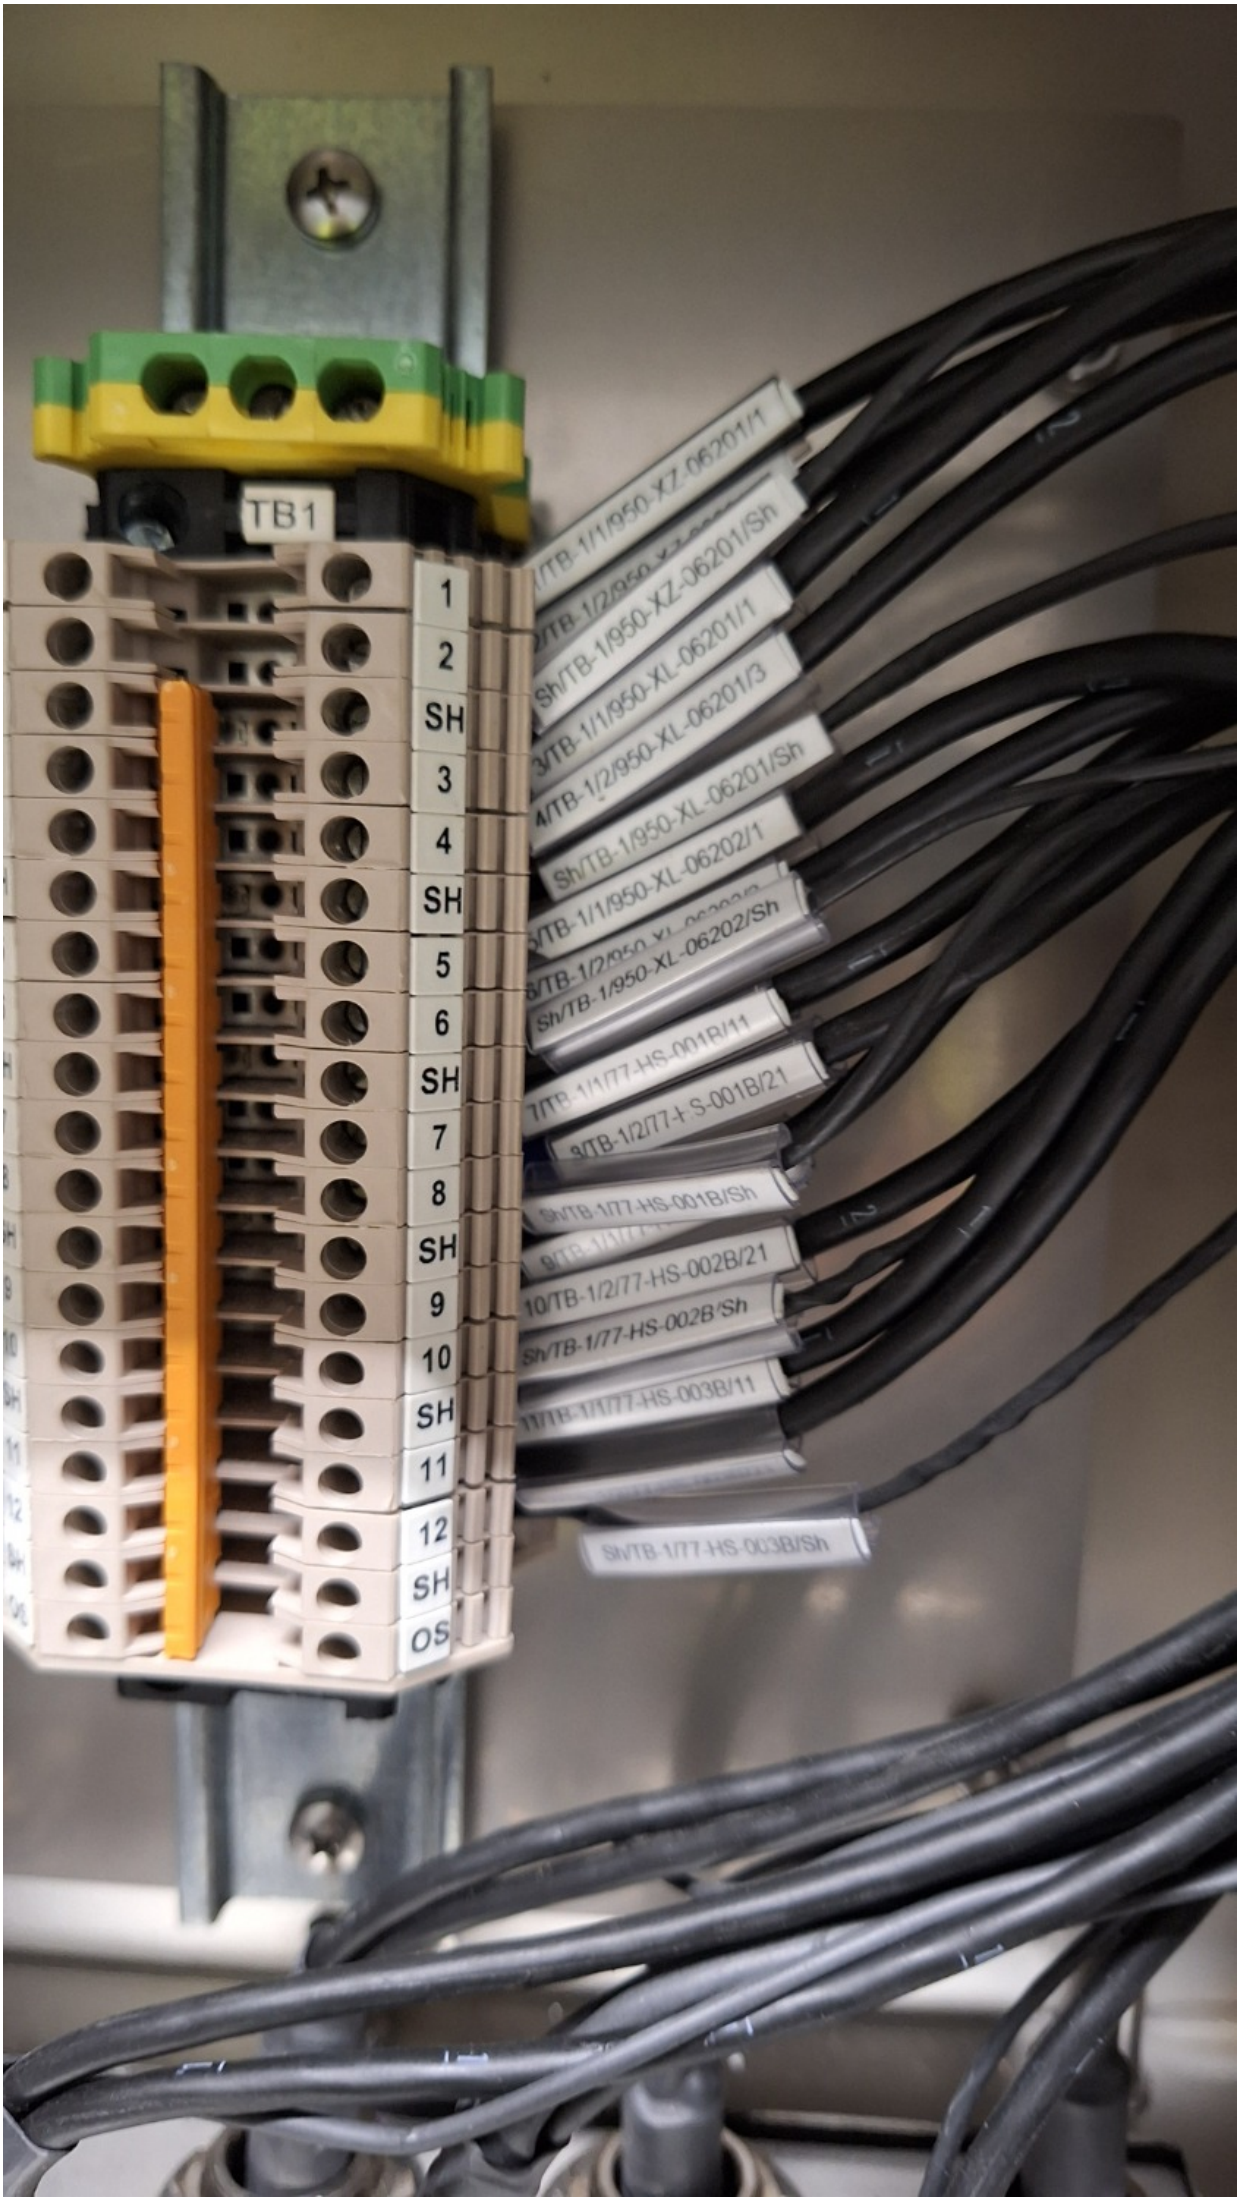
TB1
1
2
SH
3
4
SH
5
6
SH
7
8
SH
9
10
SH
11
12
SH
OS
Sh/TB-1/77-HS-003B/Sh

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001309

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001046	1.4 Discipline	Instrumental
1.2 Item	950-GDZ-06201	H2 GD FZ-06 B-100 HVAC Air Intake	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

The earthing cable passes inside the unistrut and behind the instrument.
It should be dressed outside unistrut and fixed with SS cable ties.

Name: Andrea Andreani
Date: 2024-12-04
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-04
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo
Date: 2025-01-20
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001310

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001046	1.4 Discipline	Instrumental
1.2 Item	950-GDZ-06201	H2 GD FZ-06 B-100 HVAC Air Intake	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but in plastic)

Name: Andrea Andreani

Date: 2024-12-04

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-04
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

Done

Name: Gabriele Bertuccelli

Date: 2025-02-03

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001314

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001047	1.4 Discipline	Instrumental
1.2 Item	950-GDZ-06202	H2 GD FZ-06 B-100 HVAC Air Intake	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

The earthing cable passes inside the unistrut and behind the instrument.
It should be dressed outside unistrut and fixed with SS cable ties.

Name: Andrea Andreani
Date: 2024-12-04
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-04
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo
Date: 2025-01-20
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30001315

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001047	1.4 Discipline	Instrumental
1.2 Item	950-GDZ-06202	H2 GD FZ-06 B-100 HVAC Air Intake	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Installation is not as per 123A90-FDL-IN-HD-40079 rev 2 sheet 34 pos. 8 (plug is not Nickel Plated Brass Ex-D/e IIC T1 but in plastic)

Name: Andrea Andreani

Date: 2024-12-04

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Andrea Andreani
3.4 Activity code	MC Mechanical Completion	Date	2024-12-04
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

Done

Name: Gabriele Bertuccelli

Date: 2025-02-03

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000564

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000276	1.4 Discipline	Instrumental
1.2 Item	C-950-SDZ-06201/950-JE-06204	SMOKE DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Nylon sheet is missing on mechanical support of secondary cable trays.

Name: Alessio Polo

Date: 2024-11-18

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-11-18
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Andrea Andreani

Date: 2025-02-13

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000565

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000276	1.4 Discipline	Instrumental
1.2 Item	C-950-SDZ-06201/950-JE-06204	SMOKE DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Plastic cable ties to be replaced on external routing.

Name: Alessio Polo

Date: 2024-11-18

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-11-18
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Eleonora Carotenuto

Date: 2024-12-23

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:



ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000566

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000276	1.4 Discipline	Instrumental
1.2 Item	C-950-SDZ-06201/950-JE-06204	SMOKE DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing tag SS project on the cable near the instrument.

Name: Alessio Polo

Date: 2024-11-18

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-11-18
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Eleonora Carotenuto

Date: 2024-12-23

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000567

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000277	1.4 Discipline	Instrumental
1.2 Item	C-950-SDZ-06202/950-JE-06204	SMOKE DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing interposing nylon plate between dissimilar conducting materials

Name: Alessio Polo

Date: 2024-11-18

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-11-18
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

Done.

Name: Alessio Polo

Date: 2025-02-21

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:



ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000568

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000277	1.4 Discipline	Instrumental
1.2 Item	C-950-SDZ-06202/950-JE-06204	SMOKE DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

The Plastic ties , on external routing cable , to be replaced with stainless steel. .

Name: Alessio Polo

Date: 2024-11-18

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-11-18
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Eleonora Carotenuto

Date: 2024-12-23

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:



ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000569

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000277	1.4 Discipline	Instrumental
1.2 Item	C-950-SDZ-06202/950-JE-06204	SMOKE DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing cable tag SS project, near the instrument

Name: Alessio Polo

Date: 2024-11-18

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-11-18
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Eleonora Carotenuto

Date: 2024-12-23

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000570

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000278	1.4 Discipline	Instrumental
1.2 Item	C-950-SDZ-06203/950-JE-06204	SMOKE DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing interposing nylon plate between dissimilar conducting materials

Name: Alessio Polo

Date: 2024-11-18

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-11-18
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-02-21


Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

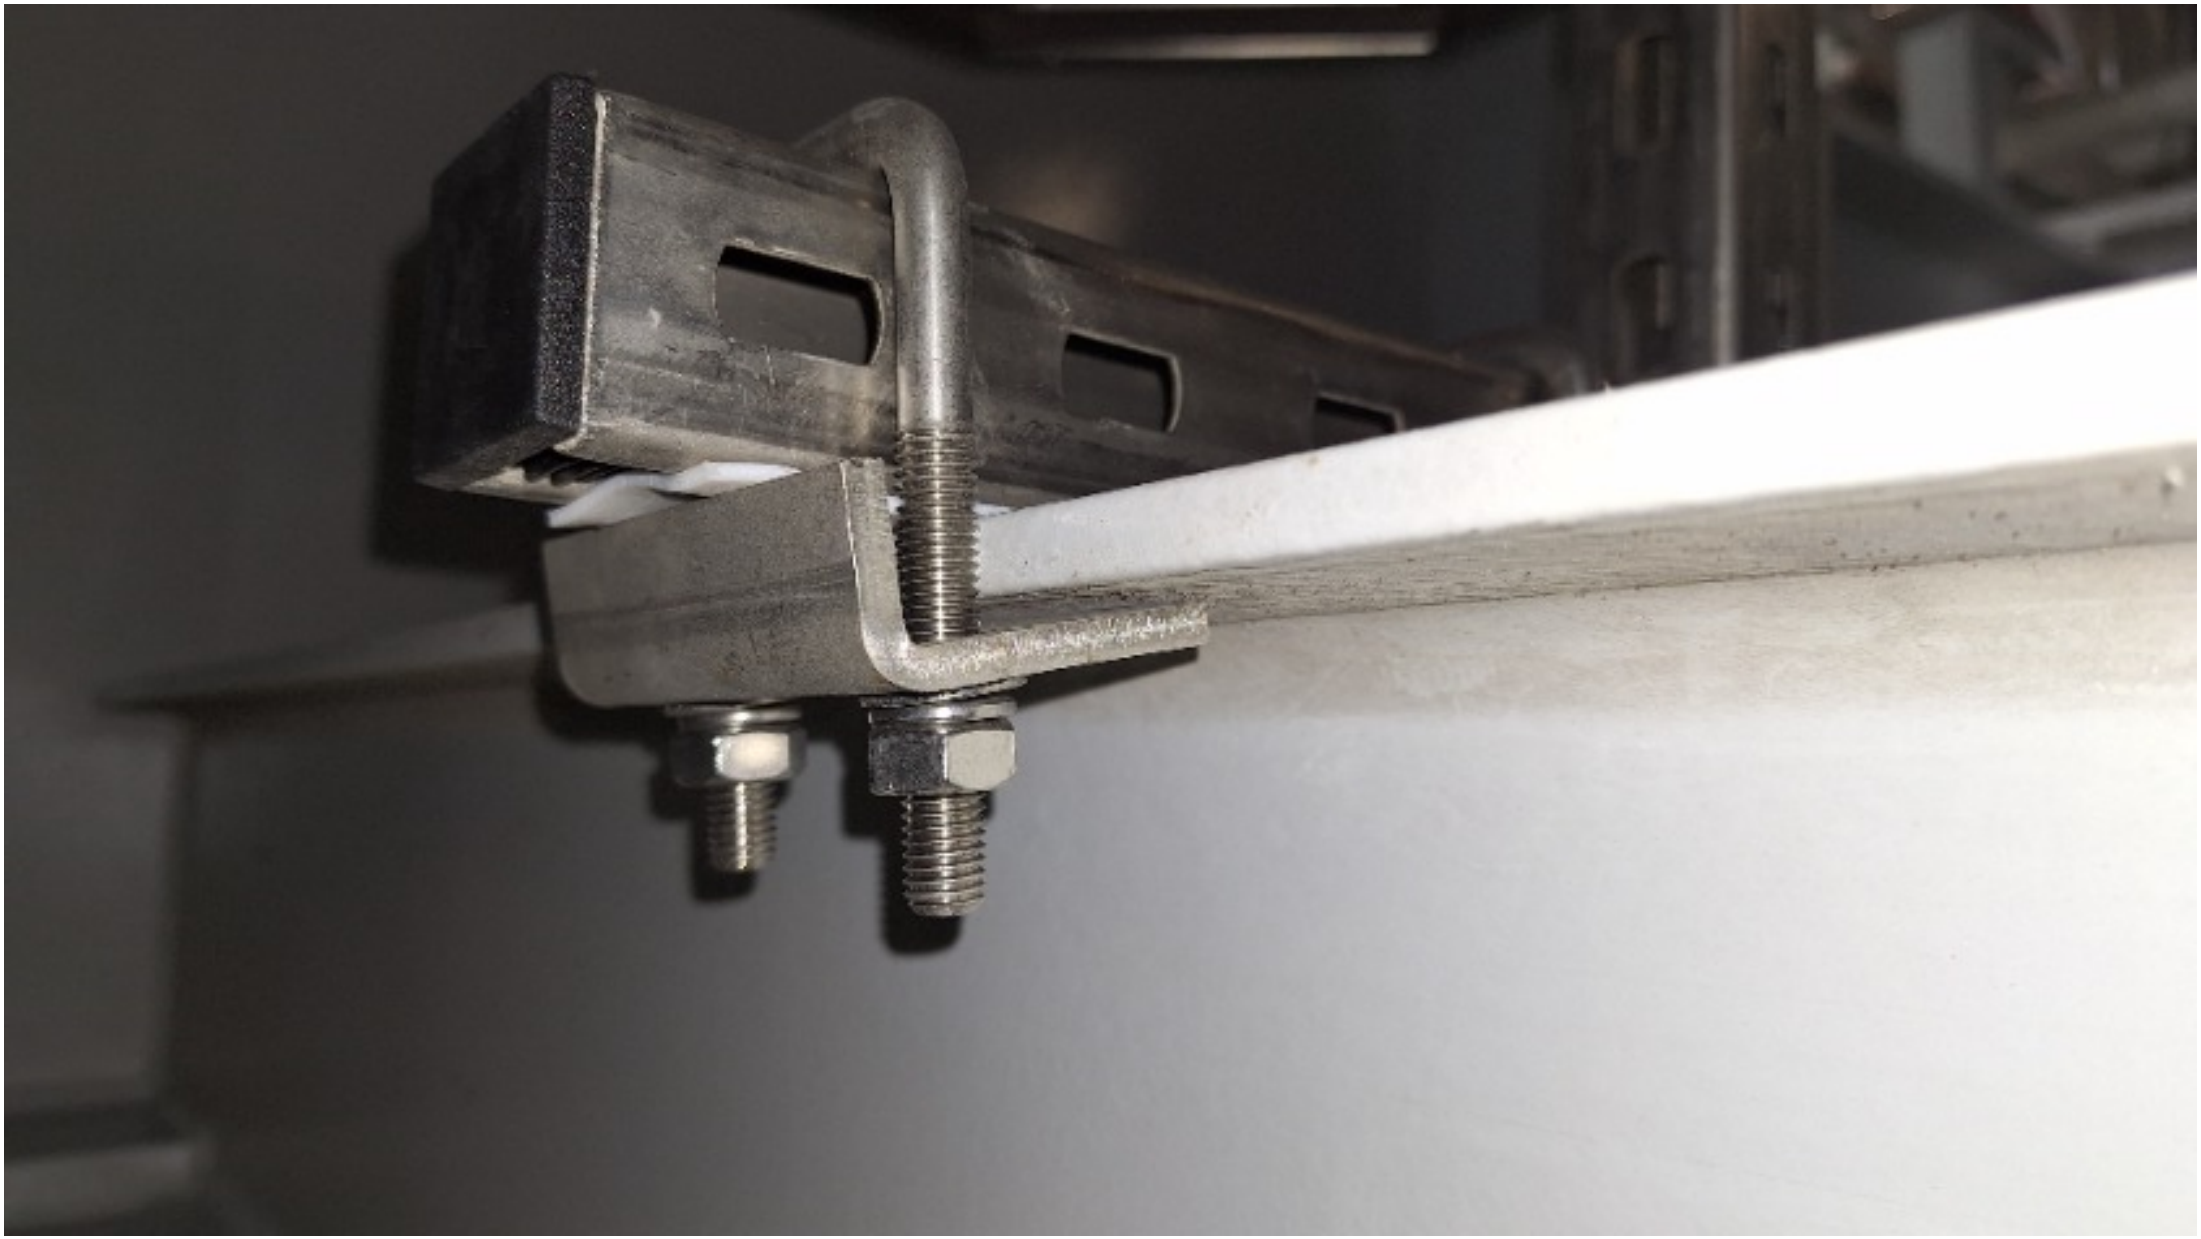

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000571

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000278	1.4 Discipline	Instrumental
1.2 Item	C-950-SDZ-06203/950-JE-06204	SMOKE DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

The plastic fixing ties , on external routing cable , to be replaced with stainless steel

Name: Alessio Polo
Date: 2024-11-18
Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-11-18
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:
Date:
Signature:

5 - CLEARANCE CHECK

DONE

Name: Eleonora Carotenuto
Date: 2024-12-23
Signature:

6- CLEARANCE APPROVAL

Name:
Date:
Signature:



ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000572

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000278	1.4 Discipline	Instrumental
1.2 Item	C-950-SDZ-06203/950-JE-06204	SMOKE DETECTOR / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing cable tag SS project, near the instrument

Name: Alessio Polo

Date: 2024-11-18

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-11-18
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Eleonora Carotenuto

Date: 2024-12-23

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000692

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001101	1.4 Discipline	Instrumental
1.2 Item	950-SDZ-06206		Smoke Detector - FZ-06 B-100 Ambient
1.3 Subsystem	70-17		F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)

2 - OBSERVATION

the earth cable is not fixed to the instrument

Name: Alessio Polo

Date: 2024-11-21

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Alessio Polo
3.4 Activity code	MC Mechanical Completion	Date	2024-11-21
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

Done.

Name: Giovanni Tangianu

Date: 2024-12-30

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:


MUREX

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000978

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10001142	1.4 Discipline	Instrumental
1.2 Item	950-XZ-06101	FZ-06 Sounder Activation	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

earthing cable need to be fixed.

Name: Giovanni Tangianu

Date: 2024-11-27

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2024-11-27
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-01-20

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:



ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000979

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000343	1.4 Discipline	Instrumental
1.2 Item	C-950-XZ-06101/950-JE-06103	SOUNDER / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Identification tag wires missing side the (XZ-06101).

Name: Giovanni Tangianu

Date: 2024-11-27

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2024-11-27
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Josip Krizanic

Date: 2025-02-24

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

ROSETTI MARINO
CROSSWIND

PUNCH ITEM ENTRY / CLEARANCE FORM

C30000980

PROVERLIS

1 -ELEMENT IDENTIFICATION

1.1 Task	C10000343	1.4 Discipline	Instrumental
1.2 Item	C-950-XZ-06101/950-JE-06103	SOUNDER / MARSHALLING PCS	
1.3 Subsystem	70-17	F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	

2 - OBSERVATION

Missing cable tag all along the route.

Name: Giovanni Tangianu

Date: 2024-11-27

Signature:

3 - DEFECT ASSESSMENT

.

3.1 Corrective action proposal

3.2 Material required

3.3 Priority	B PL B	Name	Giovanni Tangianu
3.4 Activity code	MC Mechanical Completion	Date	2024-11-27
3.5 Action by	RM_CONSTR RM	Signature	

4 - PERFORMED ACTION

Name:

Date:

Signature:

5 - CLEARANCE CHECK

DONE

Name: Alessio Polo

Date: 2025-01-29

Signature:

6- CLEARANCE APPROVAL

Name:

Date:

Signature:

Section 4 FUNCTIONAL TESTS SHEETS

Section 4.1 Electrical functional test sheets index

NOT APPLICABLE

Section 4.2 Electrical
“As-Commissioned” interconnection diagrams

NOT APPLICABLE

Section 4.3 Instrumentation functional test sheets index

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

STATUS INDEX DETAIL

Filtered on subsystem: 70-17 & discipline : I

Instrumental	70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)						
ITEM		TASK					
Code	Description	Location	Code	Form	Progress	Date	Certificate
77-HY-001	B-100 Fire Damper AHU1 Inlet Air	ONSHORE	C10003776	FJ01D	100	2025-07-09	RFO 5
77-HY-002	B-100 Fire Damper AHU2 Inlet Air	ONSHORE	C10003778	FJ01D	100	2025-03-11	RFO 5
77-HY-003	B-100 Fire Damper Exhaust Air	ONSHORE	C10003780	FJ01D	100	2025-03-11	RFO 5
77-ZSL-001	B-100 Fire Damper AHU1 Inlet Air	ONSHORE	C10003777	FJ01D	100	2025-05-22	RFO 5
77-ZSL-002	B-100 Fire Damper AHU2 Inlet Air	ONSHORE	C10003779	FJ01D	100	2025-03-11	RFO 5
77-ZSL-003	B-100 Fire Damper Exhaust Air	ONSHORE	C10003781	FJ01D	100	2025-03-11	RFO 5
950-FDZ-06101	Flame Detector - FZ-06 B-100 Area	ONSHORE	C10003134	FJ04F	100	2025-01-11	RFO 5
950-FDZ-06102	Flame Detector - FZ-06 B-100 Area	ONSHORE	C10004856	FJ04F	100	2025-01-30	RFO 5
950-GDZ-06201	H2 GD FZ-06 B-100 HVAC Air Intake	ONSHORE	C10003078	FJ04G	100	2025-01-11	RFO 5
950-GDZ-06202	H2 GD FZ-06 B-100 HVAC Air Intake	ONSHORE	C10003077	FJ04G	100	2025-01-11	RFO 5
950-GDZ-06203	H2 GD FZ-06 B-100 HVAC Air Intake	ONSHORE	C10003076	FJ04G	100	2025-02-11	RFO 5
950-GDZ-06204	H2 GD FZ-06 B-100 Ambient	ONSHORE	C10003075	FJ04G	100	2025-01-17	RFO 5
950-GDZ-06205	H2 GD FZ-06 B-100 Ambient	ONSHORE	C10003074	FJ04G	100	2025-01-11	RFO 5
950-GDZ-06206	H2 GD FZ-06 B-100 Ambient	ONSHORE	C10003073	FJ04G	100	2025-01-11	RFO 5
950-MFA-06101	FZ-06 MFA Activation	ONSHORE	C10004432	FJ04PB_FGS	100	2025-01-11	RFO 5
950-MFA-06102	FZ-06 MFA Activation	ONSHORE	C10004433	FJ04PB_FGS	100	2025-01-11	RFO 5
950-MFA-06201	FZ-06 MFA Activation - B-100 Indoor	ONSHORE	C10004434	FJ04PB_FGS	100	2025-01-11	RFO 5
950-SDZ-06201	Smoke Detector - FZ-06 B-100 HVAC Air Intake	ONSHORE	C10003054	FJ04S	100	2025-01-28	RFO 5
950-SDZ-06202	Smoke Detector - FZ-06 B-100 HVAC Air Intake	ONSHORE	C10003053	FJ04S	100	2025-01-28	RFO 5
950-SDZ-06203	Smoke Detector - FZ-06 B-100 HVAC Air Intake	ONSHORE	C10003052	FJ04S	100	2025-01-28	RFO 5
950-SDZ-06204	Smoke Detector - FZ-06 B-100 Ambient	ONSHORE	C10003051	FJ04S	100	2025-01-28	RFO 5
950-SDZ-06205	Smoke Detector - FZ-06 B-100 Ambient	ONSHORE	C10003050	FJ04S	100	2025-01-28	RFO 5
950-SDZ-06206	Smoke Detector - FZ-06 B-100 Ambient	ONSHORE	C10003049	FJ04S	100	2025-01-28	RFO 5
950-XL-06101	FZ-06 Gas Beacon Activation	ONSHORE	C10004452	FJ04FB	100	2025-01-11	RFO 5
950-XL-06102	FZ-06 Fire Beacon Activation	ONSHORE	C10004453	FJ04FB	100	2025-01-11	RFO 5
950-XL-06103	FZ-06 Gas Beacon Activation	ONSHORE	C10004454	FJ04FB	100	2025-01-11	RFO 5
950-XL-06104	FZ-06 Fire Beacon Activation	ONSHORE	C10004455	FJ04FB	100	2025-01-11	RFO 5
950-XL-06201	FZ-06 Gas Beacon Act. - B-100 Indoor	ONSHORE	C10004456	FJ04FB	100	2025-01-11	RFO 5
950-XL-06202	FZ-06 Fire Beacon Act. - B-100 Indoor	ONSHORE	C10004457	FJ04FB	100	2025-01-11	RFO 5

CROSSWIND

ROSETTI MARINO

Project CROSSWIND

STATUS INDEX DETAIL

Filtered on subsystem: 70-17 & discipline : I

Instrumental	70-17 F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)						
ITEM		TASK					
Code	Description	Location	Code	Form	Progress	Date	Certificate
950-XZ-06101	FZ-06 Sounder Activation	ONSHORE	C10004473	FJ04MS	100	2025-02-11	RFO 5
950-XZ-06201	FZ-06 Sounder Act. - B-100 Indoor	ONSHORE	C10004474	FJ04MS	100	2025-02-11	RFO 5

ROSETTI MARINO | CROSSWIND

ITEM	Tag	950-SDZ-06206	: Smoke Detector - FZ-06 B-100 Ambient	Dwg	123A90-DDL-SAF-DL-30027		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module	LD_B-100		
TASK	code	C10003049	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	COMM	Activity FTS	Discipline	Instrumental	Form FJ04S	Smoke Detection

LOOP DATA

Loop TAG	950-SDZ-06206			TSLD	123A90-DDL-IN-DG-40014 SHEET 292 REV. 1_A		
IO Type	Input Yes	Output Yes		Energy by transmitter	NA	Energy by system	Yes
Marshalling	B400-FGS-001	Terminal 08A-08B		Slot 05	Rack 01	Chanel 08	

LOOP TEST

1	Check earth isolation of the loop							OK
2	Connect loop to terminal							OK
3	Confirm Process Scale	Unit %		Min 0 %		Max 34 %		OK

LOOP RANGE		**0%**	**25%**	**50%**	**75%**	**100%**
4	Physical value applied for test	Unit					
5	Control System Display	Unit					

LOOP SERVICE

		Value	Trip	Gen Alarm	DCS Alarm	SOE	DCS display	
6	Threshold 1	34 %	NA	Yes	Yes	NA	OK	OK
7	Threshold 2							
8	Threshold 3							
9	Threshold 4							
10	Checking of line monitoring		Yes	Yes	Yes	NA	OK	OK
11	Checking of Maintenance Inhibition		No	No	No	No	OK	OK
12	Associated safety Level / bar		ESD-1D					OK
13	Associated outputs							

TESTING & MEASUREMENT INSTRUMENT USED

Type	Serial N.	Calibration Certificate	Validity
ELECTRIC CALIBRATOR FLUKE 725	4498694	7717/24	10/07/2025
SOLO A10S SMOKE AEROSOL	SOLO A10S-001		

LOOP DOCUMENTATION


14	Loop diagram is marked up and attached to this test sheet	OK
15	Cause and effect chart is highlighted accordingly	
16	Any defect is recorded for punch list issuance	OK


Comments:

Page 1/1	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM	RM COMM	CW
Name	Mohammed Barghouti	Giandonato Delmissier	John Mackillop
Date	2025-01-22	2025-01-22	2025-01-28
Signature	Digitaly signed by Mohammed Barghouti 2025-01-22T06:05:08.569Z	Digitaly signed by Giandonato Delmissier 2025-01-22T07:17:42.923Z	Digitaly signed by John Mackillop 2025-01-28T19:38:00.046Z

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 01

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

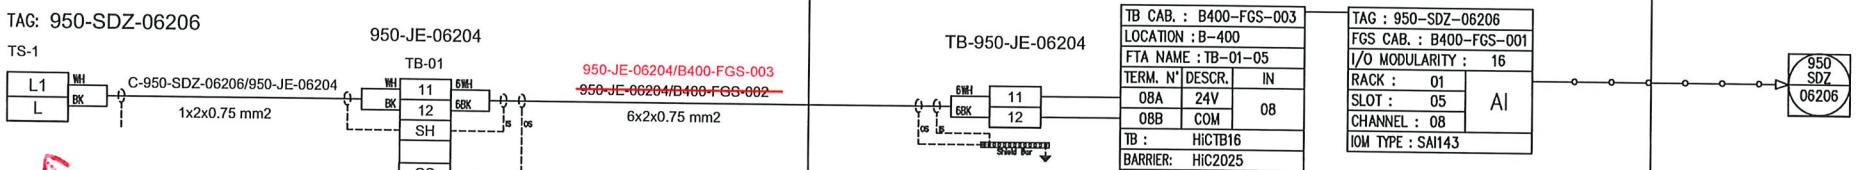

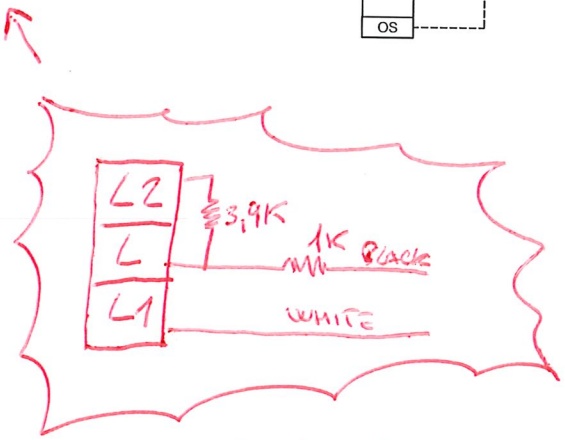

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	06/12/2024	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV: 1_A | DATE: 20/12/24 | SIGNATURE: C.Pilato
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSTRUMENT LOOP DIAGRAM
950-SDZ-06206
FZ-06 SMOKE DETECT. IN B-100 HV/MV SWGR ROOM

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 292	REV. 01

File Name : 123A90-DDL-IN-DG-40014_REV.01



solo™
detectortesters

*A **single** testing system.*
*A **complete** range of testing tools.*





detectortesters
testing technology from No Climb

solo™ detectortesters

A complete range of test and maintenance equipment for smoke, heat and CO detectors.

Testing equipment must be proven to be safe for the engineer and the system, it needs to be cost-effective, versatile, portable, approved by all detector manufacturers and in compliance with international codes and standards.

The Solo range meets all of these requirements.

SMOKE DETECTOR TESTING



SIGNALING UL LISTED Fire Alarm Equipment 77TL Smoke Detector Accessory

Solo 330 Aerosol Dispenser

Codes and standards require functional tests to introduce (simulated) smoke through the detector vents and into the sensing chamber. The Solo 330 dispenser is the most popular device for achieving this, benefiting as it does, from a cup big enough for the great majority of detectors but still small enough not to be obstructive and unwieldy.

- UL Listed
- Approved by leading detector manufacturers
- Dispenser and patented diaphragm contain particles – conserves test gas / smoke
- Strong – to withstand rigours of daily use
- Spring-loaded mechanism – for effective, economic aerosol delivery
- Clear cup – enables view of the detector LED while testing
- Universal – suits most detectors
- Designed for use at height and at angles
- Interchangeable with all other tools on Solo poles
- Lifetime Warranty



Solo 330 for use with **Solo A3** & **C3** Aerosols

Solo 332 is available for larger diameter detectors.

Solo 332
Aerosol Dispenser



> "...the testing system is high quality and is very well liked by our technicians and customers alike. The use of this product helps TSS fulfill its goal as the premiere fire alarm company in NYC"
>
> John Bonanno
> **TSS Integrated Systems**

DETECTOR TESTING AEROSOLS

Solo A10S Smoke Aerosol
Non-Flammable Solution

The new HFC-Free smoke aerosol for the functional testing of smoke detectors. Like all Solo products, Solo A10S is approved by leading detector manufacturers and offers the reliability and quality expected by the industry.

- **Simple** to use
- **Fast** activation – via Solo 330 dispenser
- **Rapid** clearing
- **Compatible** with leading detector brands



Choosing the right aerosol

Chemicals used in detector test equipment need to be compatible with the plastics from which the detectors are manufactured. Not all test aerosols offer this compatibility which can lead to problems such as stress cracking in detectors, residue build up, damage to components and harm to the environment. Solo aerosols are the most thoroughly researched solutions – approved by leading detector manufacturers, third parties and fire engineers.

- **UL & ULC Certified**
- **Approved** by world leading detector manufacturers
- **Non-flammable** (same as Solo A3)
- **HFC-Free** – fully compliant with latest regulations: Protecting the global environment
- **Silicone Free** – prevents detector contamination: Protecting the local environment

Solo A10S is available in the standard 250ml can.




Ordering information	Product Code:
Solo A10S 250ml	SOLO A10S-001
Sold in multiples of 12	

detectortesters

www.solo-tester.com


TELESCOPIC ACCESS POLES

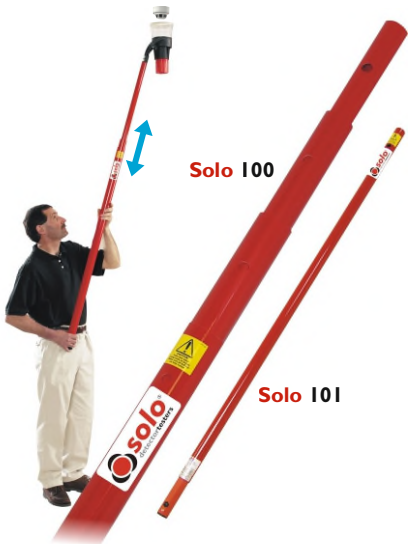

Solo 100/101/108 Telescopic Access Poles

The core element of the Solo range is the telescopic and extension access poles which are extremely lightweight and quickly extend to provide access to detectors up to 9 metres*.

- Light – easy to use at height, on-site, day after day
- Non-whip – even at height
- Certified non-conductive – protecting both the engineer and overhead live equipment from inadvertent shorts
- Available in one, two or four telescopic sections
- Lifetime Warranty

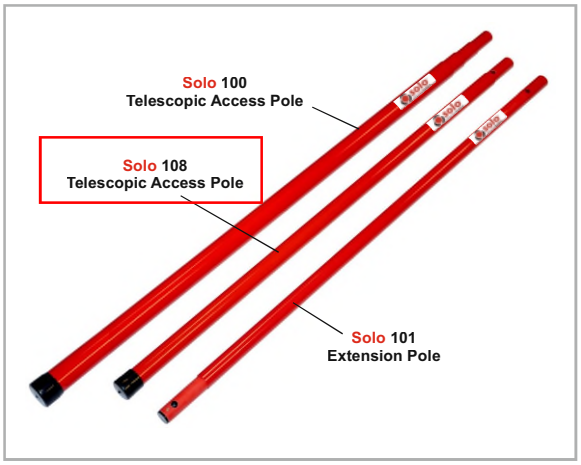

*See Product Selector for details on height guide.

MR601TEx INTRINSICALLY SAFE ENHANCED OPTICAL SMOKE DETECTOR

PRODUCT APPLICATION AND DESIGN INFORMATION

1. INTRODUCTION

The MR601TEx Intrinsically Safe High Performance Optical Smoke Detector forms part of the M600Ex series of plug in detectors for ceiling mounting. The detector plugs into the 5BEx 5" Universal IS Base and is intended for two-wire operation on the majority of the control equipment currently manufactured by the company. The Intrinsically Safe High Performance Optical detector is available in one sensitivity setting only.

2. INTRINSIC SAFETY

The detectors are for use in potentially explosive gas and dust atmospheres (zone 0 gas, zone 20 dust).

The detectors are designed to comply with EN/IEC 60079-0:2006, EN/IEC 60079-11:2007 and EN/IEC61241-11:2006 for Intrinsically Safe apparatus. They are certified:

ATEX code:	**II 1 GD** CE 1180
Certificate:	**BAS01ATEX1134X**
Gas/Dust code:	**Ex ia IIC T5** **Ex iaD 20 T100°C**
IECEx Certificate:	**IECEx BAS 07.0056X**

These detectors are designed and manufactured to protect against other hazards as defined in paragraph 1.2.7 of Annex II of the ATEX Directive 94/9/EC.

2.1 DETECTOR USE

It is recommended that the detector is used in conjunction with a suitable isolator or shunt diode safety barrier in a certified Intrinsically Safe system, ie, System 620.

2.2 SPECIAL CONDITIONS OF SAFE USE

The apparatus has a plastic enclosure which constitutes a potential electrostatic hazard. The enclosure must be cleaned only with a damp cloth.

3. OPERATING PRINCIPLE

The MR601TEx operates by sensing the optical scatter from smoke particles generated in a fire. While the optical scatter detector can give good detection performance for the majority of fires, some fast burning fires produce little visible smoke and some produce very black smoke, neither of which are easily detected by the optical scatter detector. (Such fires are represented in EN54-7 by Polyurethane and Heptane type fires respectively). These fires do, however, produce high heat outputs with an associated rise in air temperature.

The detector has been designed to offer improved detection of such fires, by detecting the rapid rate-of-rise of air temperature and under these conditions, increasing the smoke detection sensitivity. This gives an earlier detection of such fires and a broader detection capability than a standard detector.

The MR601TEx detector has two sensing systems as follows:

- An optical chamber with associated electronics to measure the presence of smoke by light scatter.
- A thermistor with its associated electronics to detect the presence of hot air draughts or high temperatures.

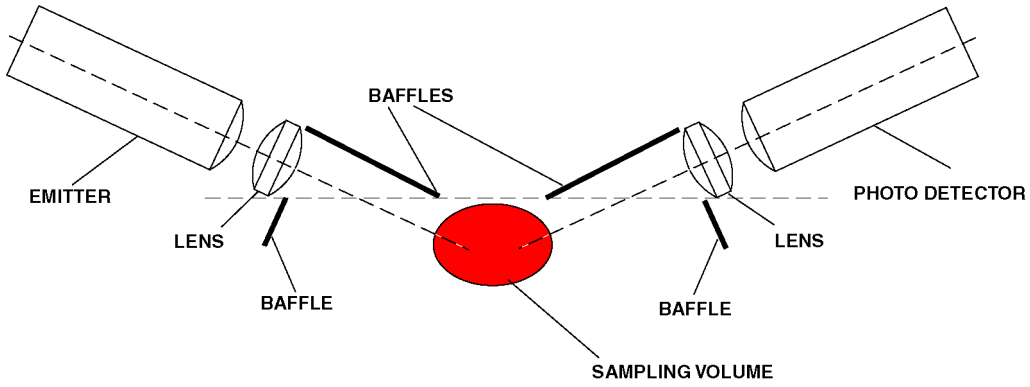


Fig. 1 Optical System Schematic

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

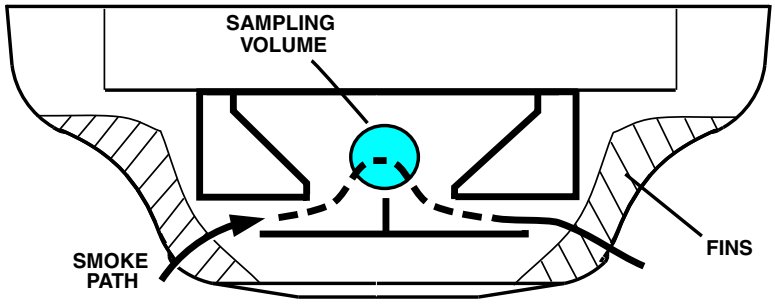


Fig. 2 Measuring Chamber Showing Smoke Flow Path

3.1 OPTICAL SYSTEM

The MR601TEx detects visible particles produced in fires by using the light scattering properties of the particles. The detector uses the optical arrangement shown diagrammatically in Fig. 1.

The optical system consists of an infra-red emitter and receiver, with a lens in front of each, so arranged that their optical axes cross in the sampling volume. The emitter, with its lens, produces a narrow beam of light which is prevented from reaching the receiver by the baffles. When smoke is present in the sampling volume a proportion of the light is scattered, some of which reaches the receiver. For a given type of smoke, the light reaching the photodetector is proportional to the smoke density. The amplified output from the sensor can be used to activate an alarm circuit at a predetermined threshold.

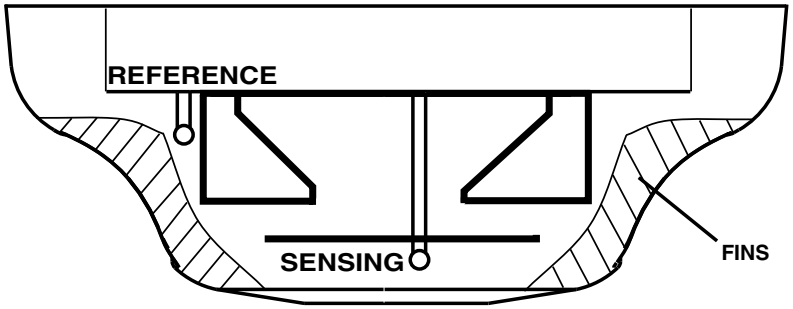


Fig. 3 Thermal Measuring System

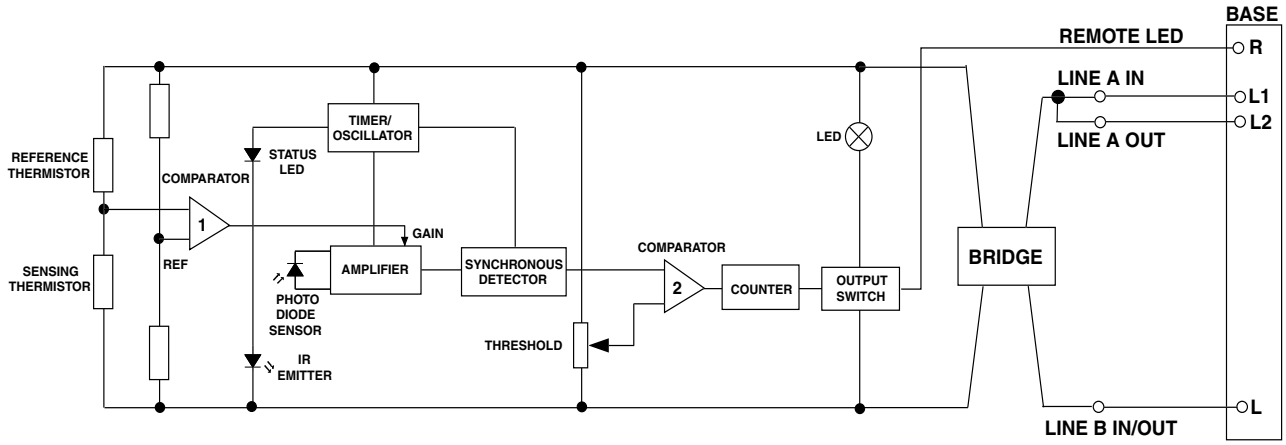


Fig. 4 Block Schematic of Detector

3.2 FEATURES OF MEASURING CHAMBER

The MR601TEx uses vertical chevrons to exclude ambient light.

Smoke incident on the detector is channelled into the detector by the outer cover fins (Fig. 2) and passes through the vertical chevrons. The smoke is deflected into the optical chamber and through the sampling volume before passing out the other side of the detector.

The emitter (Fig. 1) is a GaAlAs solid state type operating in the near infra-red (880nm peak), while the detector is a matched silicon photodiode. These devices, together with their associated lenses, are held in place by the chamber mouldings. The design of the optical system is such that the presence of small insects such as thrips, should not cause false alarms.

3.3 THERMAL MEASURING SYSTEM

Refer to Fig. 3.

This is designed to detect the presence of horizontally moving hot air draughts moving across the ceiling which occur in a fast burning fire.

The measuring system consists of two fast responding negative temperature thermistors. A sensing thermistor is located above the labyrinth under the cover in the airstream and will detect any sudden changes in the air temperature or draughts of hot air moving across the ceiling. The second thermistor is located out of the airflow within the smoke labyrinth and has a longer time constant and is used as a temperature reference to compare the sensing thermistor against. At a given temperature differential between the two thermistors, the comparator will switch and increase the gain of the amplifier, thereby increasing the sensitivity of the sensor. Fins located on the top of the labyrinth are designed to increase air turbulence and the efficiency of the sensing thermistor.

3.4 CIRCUIT OPERATIONS

A simplified block schematic of the detector is given in Fig. 4.

The emitter is subjected to a pulse stream only every 10s in order to reduce the quiescent current. The pulse signal received by the photodiode is fed to a high-gain amplifier. If smoke is present, the pulse signal received varies in proportion to the smoke density.

The amplifier output is fed via an integrator, the output of which is compared to a preset threshold level. Sophisticated synchronous detection techniques are used to reduce the effects of noise and spurious transients.

The gain of the front end amplifier is controlled by the thermistor bridge circuit. When the temperature differential between the two thermistors exceeds a certain value, the amplifier gain increases. Under these conditions the High Performance Optical detector is more sensitive to the presence of smoke and is said to be in 'Enhanced Mode'.

When the detector is in the 'Enhanced Mode', the detector will only alarm if a smoke signal is present. The presence of rising temperature alone cannot cause an alarm.

If the signal amplitude exceeds a threshold level, then the emitter samples the smoke every two seconds. The sample period remains at two seconds if the signal is above the threshold. When the counter has counted three consecutive pulses above the threshold, the output stage is latched into the alarm condition. If however, the amplitude of the second or third pulse is below the threshold, then the pulse period reverts to 10 seconds and the counter resets. The switching of the output stage lights the alarm LED and provides drive for the remote LED indicator.

The critical front end of the circuit is run off a 12V regulator to make it independent of supply voltage.

The detector is polarity conscious.

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

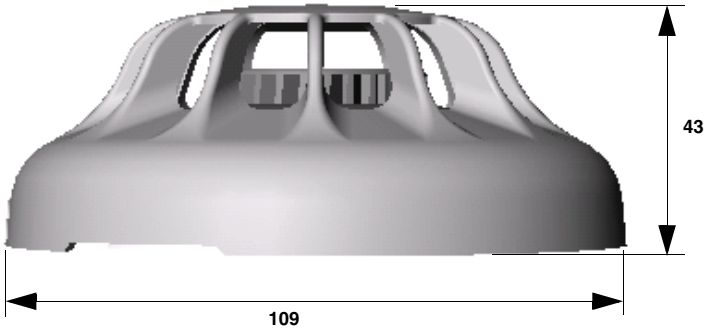


Fig. 5 Overall Dimensions of MR601TEx

3.5 WIRING

Loop cabling is connected to base terminals as follows:

L	-VE
L1	+VE IN
L2	+VE OUT
R	Remote LED Drive

4. MECHANICAL CONSTRUCTION

The major components of the detector are:

- Body Assembly
- Printed Circuit
- Optical Chamber
- Optical Chamber Cover
- Thermistor
- Light Pipe
- Outer Cover

4.1 ASSEMBLY

The body assembly consists of a plastic moulding which has four embedded detector contacts which align with contacts in the 5BEx base. The moulding incorporates securing features to retain the detector in the base.

The PCB is soldered to the body contacts. These contacts act as a mechanical fixture during assembly and provide electrical contact between the contacts and the PCB. The PCB is then potted.

The chamber cover is clipped to the body over the optical chamber ensuring the thermistor protrudes through the cover. The light pipe is slotted into the chamber cover. Finally, the outer cover is clipped to the body.



Fig. 6 MR601TEx Enhanced Optical Smoke Detector with 5BEx 5" Base

4.2 TEST AND FINAL ASSEMBLY

The detectors are fully functionally tested and their sensitivities set in a smoke tunnel to ensure correct calibration. The sealing ring and labels are then fitted to complete detector assembly.

5. TECHNICAL SPECIFICATION

5.1 MECHANICAL

Dimensions

The dimensions of the MR601TEx detector are shown in Fig. 5.

Materials

Body and cover:	FR110 'BAYBLEND' Fire Resistant

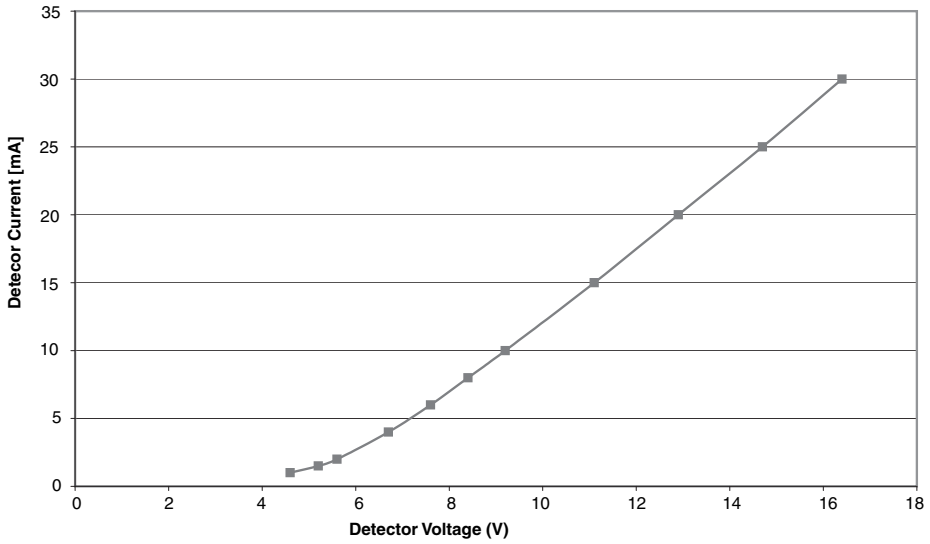


Fig. 7 Alarm Load Presented to the Controller

Weight

Detector:	0.128kg
Detector + base:	0.174kg

5.2 ENVIRONMENTAL

Operating Temperature:	-20°C to +70°C (please see note below).
Storage Temperature:	-25°C to +80°C

Note:

1) ***The operating temperatures quoted exceed the ATEX Certification limits.***
2) *Operation below 0°C is not recommended unless steps are taken to eliminate condensation and hence ice formation on the detector.*

Relative Humidity:	95% non-condensing
Shock:) Vibration:) Impact:) Corrosion:)	To EN54-7

5.3 ELECTROMAGNETIC COMPATIBILITY

The detector complies with the following:

Product family standard EN50130-4 in respect of Conducted Disturbances, Radiated Immunity, Electrostatic Discharge, Fast Transients and Slow High Energy

EN 61000-6-3 for Emissions

5.4 ELECTRICAL CHARACTERISTICS

The alarm load presented to the controller is shown in Fig. 7.

The following characteristics shown in Table 1 are taken at 25°C with a supply voltage of 20V unless otherwise specified.

Characteristics	Min.	Typ.	Max.	Unit
Operating Voltage (d.c.)	16	20	28	V
Average Quiescent Current	90		110	µA
Switch-on-Surge			130	µA
Stabilisation Time			60	sec
Alarm Current	See Fig. 6			mA
Holding Voltage			5	V
Holding Current			1	mA
Reset Time		2	5	sec
Remote LED Drive	Remote LED via 3.4k			

Table. 1 Electrical Characteristics

Intrinsic Safety Rating:

Maximum Voltage for safety (U_i):	28V
Maximum Current for Safety (I_i):	93mA
Maximum Power Input (P_i):	650mW
Equivalent Inductance (L_i):	0
Equivalent Capacitance (C_i):	0

5.5 PERFORMANCE CHARACTERISTICS

The fundamental parameter used to define the sensitivity of an optical smoke detector is the level of smoke which will just produce an alarm under 'ideal' conditions. This parameter, known as the response threshold value, is normally measured in a smoke tunnel and is defined in terms of the obscuration produced by the smoke over a one metre path. The response threshold value is normally given in dB/m, (or % per m).

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

Interpretation of response threshold value is somewhat complicated by the fact that the measurement is given in terms of obscuration, whereas the detector works by scattering from the smoke particles. The response threshold (m) value will therefore, depend on the colour of the smoke. Black smokes give less scattering than light smokes for given values of obscuration as shown in Fig. 8.

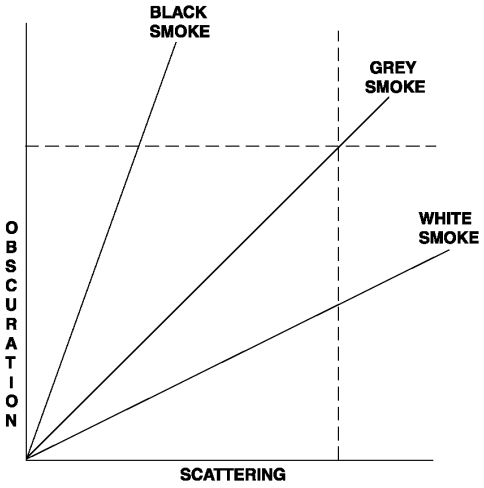


Fig. 8 Response Threshold vs Smoke Colour

Sensitivities are invariably specified for 'grey' smokes as produced by typical smouldering fires. Values for the MR601TEx are given below.

5.5.1 RESPONSE TO RATE OF CHANGE OF TEMPERATURE

The detector will not be enhanced by slow rates of change of temperature, or by cold air draughts moving across the ceiling creating negative rates of change of temperature. The detector is designed to detect sudden horizontal draughts of hot air produced by fast burning fires. The enhancement switching point has been set to allow the detection of TF1 type fires.

Normal response threshold = 0.19 dB/m, 2.7%/m typical.

Enhanced mode threshold = 0.08 dB/m, 1.1%/m typical.

5.6 RESPONSE TO FIRE TESTS

The response of an optical scatter detector to a fire will depend to a large extent on the colour of the smoke produced in the fire. However, other factors such as the detector smoke entry characteristics, the development of the fire and the thermal lift produced by the fire are important. In order to evaluate the response under realistic conditions, detectors are subjected to test fires which cover a range of fire types. These tests are defined in EN54 Pt 7. The MR601TEx passes the following Fire Tests:

TF1	open cellulosic (wood-flaming)
TF2	smouldering pyrolysis
TF3	glowing smouldering (cotton)
TF4	open plastics (polyurethane foam)
TF5	liquid (n-heptane)

Table 2: Response to Fire Tests

Note: TF2 to TF5 are mandatory test fires required to meet EN54 Pt 7.

The MR601TEx is designed to respond to the mandatory tests TF2 to TF5 as required by BS5445 Pt 7. The MR601TEx gives an earlier response to TF5 fires than the MR601 due to its thermal circuit detecting the heat generated by this test of fire and the MR601TEx being 'enhanced'. For the same reason the MR601TEx will detect test fire TF1 (open wood cellulosic flaming fire) which is not normally detected by optical smoke detectors - demonstrating the detectors broader detection capability.

The MR601TEx does not respond to TF6 liquid (methylated spirit) which although having a rapidly rising temperature, does not generate any optical scattering. This shows that the High Performance Optical detector will not respond to hot air draughts without the presence of smoke.

6. INSTALLATION RECOMMENDATIONS

It is not recommended that the MR601TEx be installed in areas where it is likely to be regularly enhanced, since in this condition the detector is extra sensitive and there is a possibility of unwanted alarms from low ambient smoke levels.

The MR601TEx is designed to become enhanced by detecting a rapid temperature rise (>10°C) in air moving horizontally across the ceiling. Siting sensors in positions where air is being blown through the detector should therefore, be particularly avoided, eg, close to ceiling ducts or ceiling mounted industrial heaters; or areas of forced ventilation, such as ducts and under floor voids of computer suites.

Also, not recommended are areas open to the outdoors, such as cargo handling bays, or areas where the detector may become contaminated.

The MR601TEx is not recommended for use in applications where a heater jacket is required.

The MR601TEx is primarily aimed at benign environments.

7. CPD INFORMATION

CE

0832

Tyco Safety Products
Dunhams Lane
Letchworth SG6 1BE
UK

06

0832-CPD-0248

EN 54-7: 2000 + A1: 2002

Conventional Intrinsically Safe high performance photoelectric smoke detector with heat enhancement for use in fire detection and alarm systems in buildings

MR601TEx

Application & Design	01B-04-D12
Installation Instructions	01B-04-I3
Service Instructions	01B-04-S2

8. DETECTOR IDENTIFICATION

The detector is identified by the logo label, as shown in Fig. 9.

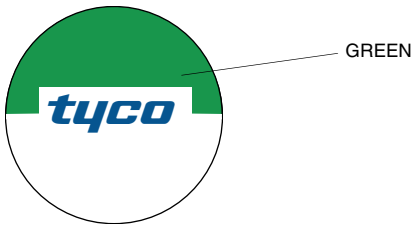


Fig. 9 Detector identification

9. ORDERING INFORMATION

MR601TEx Intrinsically Safe Enhanced Optical Smoke Detector:	516.054.011.Y
5BEx 5" Universal IS Base:	517.050.023

JM/jm

5th May 2010

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	950-SDZ-06205	: Smoke Detector - FZ-06 B-100 Ambient	Dwg	123A90-DDL-SAF-DL-30027		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module	LD_B-100		
TASK	code	C10003050	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	COMM	Activity FTS	Discipline	Instrumental	Form FJ04S	Smoke Detection

LOOP DATA

Loop TAG	950-SDZ-06205			TSLD	123A90-DDL-IN-DG-40014 SHEET 291 REV. 1_A		
IO Type	Input Yes	Output Yes		Energy by transmitter	NA	Energy by system	Yes
Marshalling	B400-FDZ-001	Terminal 08A-08B		Slot 03	Rack 01	Chanel 08	

LOOP TEST

1	Check earth isolation of the loop			OK
2	Connect loop to terminal			OK
3	Confirm Process Scale	Unit %	Min 0 % / Max 34 %	OK

LOOP RANGE		0%	25%	50%	75%	100%	
4	Physical value applied for test	Unit					
5	Control System Display	Unit					

LOOP SERVICE

		Value	Trip	Gen Alarm	DCS Alarm	SOE	DCS display	
6	Threshold 1	34 %	NA	Yes	Yes	NA	OK	OK
7	Threshold 2							
8	Threshold 3							
9	Threshold 4							
10	Checking of line monitoring		Yes	Yes	Yes	NA	OK	OK
11	Checking of Maintenance Inhibition		No	No	No	No	OK	OK
12	Associated safety Level / bar		ESD-1D					OK
13	Associated outputs							

TESTING & MEASUREMENT INSTRUMENT USED

Type	Serial N.	Calibration Certificate	Validity
ELECTRIC CALIBRATOR FLUKE 725	4498694	7717/24	10/07/2025
SOLO A10S SMOKE AEROSOL	SOLO A10S-001		

LOOP DOCUMENTATION


14	Loop diagram is marked up and attached to this test sheet	OK
15	Cause and effect chart is highlighted accordingly	
16	Any defect is recorded for punch list issuance	OK


Comments:

Page 1/1	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM	RM COMM	CW
Name	Mohammed Barghouti	Giandonato Delmissier	John Mackillop
Date	2025-01-22	2025-01-22	2025-01-28
Signature	PROVERLIS Digitaly signed by Mohammed Barghouti 2025-01-22T06:05:55.258Z	PROVERLIS Digitaly signed by Giandonato Delmissier 2025-01-22T07:19:10.030Z	PROVERLIS Digitaly signed by John Mackillop 2025-01-28T19:38:21.789Z

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 01

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

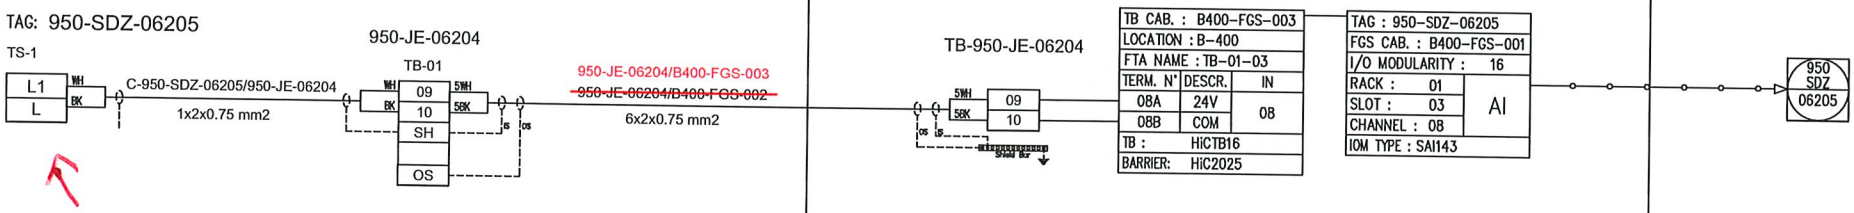

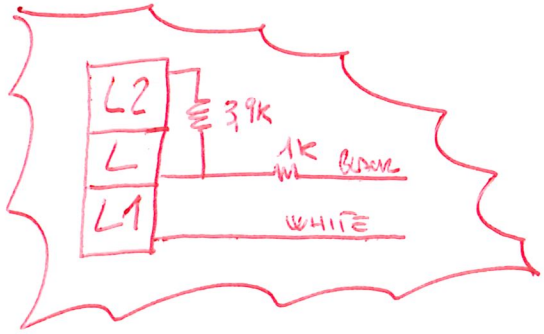

14/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	06/12/2024	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV: 1_A | DATE: 20/12/24 | SIGNATURE: C.Pilato
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSTRUMENT LOOP DIAGRAM
950-SDZ-06205
FZ-06 SMOKE DETECT. IN B-100 HV/MV SWGR ROOM

CONTRACT NO./TITLE CONTRACT_NO. | SCALE 1:1
DRAWN: VBA | CHECKED: LCA | APPROVED: DLO | DATE 23/10/2024
A3 | DRAWING NO. 123A90-DDL-IN-DG-40014 | SHEET 291 | REV. 01

File Name : 123A90-DDL-IN-DG-40014_REV.01



solo™
detectortesters

*A **single** testing system.*
*A **complete** range of testing tools.*





detectortesters
testing technology from No Climb

solo™ detectortesters

A complete range of test and maintenance equipment for smoke, heat and CO detectors.

Testing equipment must be proven to be safe for the engineer and the system, it needs to be cost-effective, versatile, portable, approved by all detector manufacturers and in compliance with international codes and standards.

The Solo range meets all of these requirements.

SMOKE DETECTOR TESTING



SIGNALING UL LISTED Fire Alarm Equipment 77TL Smoke Detector Accessory

Solo 330 Aerosol Dispenser

Codes and standards require functional tests to introduce (simulated) smoke through the detector vents and into the sensing chamber. The Solo 330 dispenser is the most popular device for achieving this, benefiting as it does, from a cup big enough for the great majority of detectors but still small enough not to be obstructive and unwieldy.

- UL Listed
- Approved by leading detector manufacturers
- Dispenser and patented diaphragm contain particles – conserves test gas / smoke
- Strong – to withstand rigours of daily use
- Spring-loaded mechanism – for effective, economic aerosol delivery
- Clear cup – enables view of the detector LED while testing
- Universal – suits most detectors
- Designed for use at height and at angles
- Interchangeable with all other tools on Solo poles
- Lifetime Warranty



Solo 330 for use with **Solo A3** & **C3** Aerosols

Solo 332 is available for larger diameter detectors.

Solo 332
Aerosol Dispenser



> "...the testing system is high quality and is very well liked by our technicians and customers alike. The use of this product helps TSS fulfill its goal as the premiere fire alarm company in NYC"
>
> John Bonanno
> **TSS Integrated Systems**

DETECTOR TESTING AEROSOLS

Solo A10S Smoke Aerosol
Non-Flammable Solution

The new HFC-Free smoke aerosol for the functional testing of smoke detectors. Like all Solo products, Solo A10S is approved by leading detector manufacturers and offers the reliability and quality expected by the industry.

- **Simple** to use
- **Fast** activation – via Solo 330 dispenser
- **Rapid** clearing
- **Compatible** with leading detector brands



Choosing the right aerosol

Chemicals used in detector test equipment need to be compatible with the plastics from which the detectors are manufactured. Not all test aerosols offer this compatibility which can lead to problems such as stress cracking in detectors, residue build up, damage to components and harm to the environment. Solo aerosols are the most thoroughly researched solutions – approved by leading detector manufacturers, third parties and fire engineers.

- **UL & ULC Certified**
- **Approved** by world leading detector manufacturers
- **Non-flammable** (same as Solo A3)
- **HFC-Free** – fully compliant with latest regulations: Protecting the global environment
- **Silicone Free** – prevents detector contamination: Protecting the local environment

Solo A10S is available in the standard 250ml can.




Ordering information	Product Code:
Solo A10S 250ml	SOLO A10S-001
Sold in multiples of 12	

detectortesters

www.solo-tester.com


TELESCOPIC ACCESS POLES

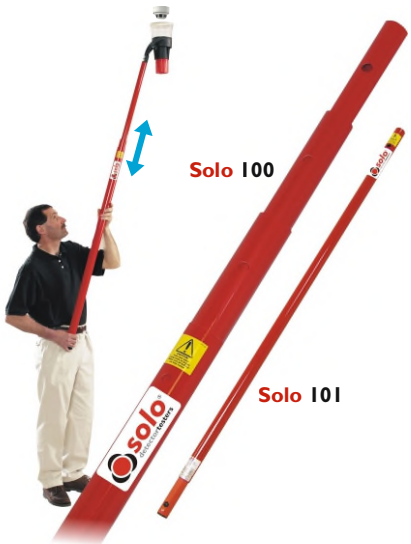

Solo 100/101/108 Telescopic Access Poles

The core element of the Solo range is the telescopic and extension access poles which are extremely lightweight and quickly extend to provide access to detectors up to 9 metres*.

- Light – easy to use at height, on-site, day after day
- Non-whip – even at height
- Certified non-conductive – protecting both the engineer and overhead live equipment from inadvertent shorts
- Available in one, two or four telescopic sections
- Lifetime Warranty

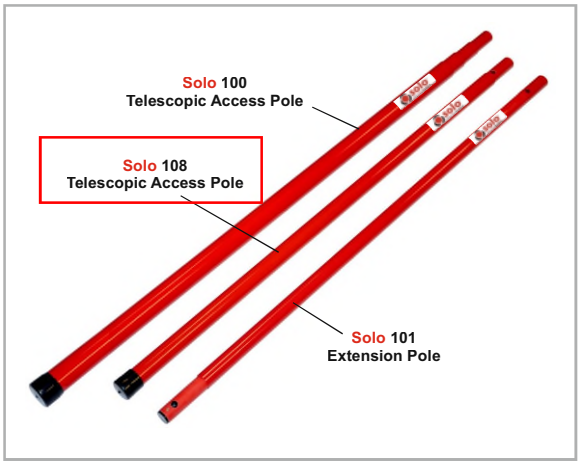

*See Product Selector for details on height guide.

MR601TEx INTRINSICALLY SAFE ENHANCED OPTICAL SMOKE DETECTOR

PRODUCT APPLICATION AND DESIGN INFORMATION

1. INTRODUCTION

The MR601TEx Intrinsically Safe High Performance Optical Smoke Detector forms part of the M600Ex series of plug in detectors for ceiling mounting. The detector plugs into the 5BEx 5" Universal IS Base and is intended for two-wire operation on the majority of the control equipment currently manufactured by the company. The Intrinsically Safe High Performance Optical detector is available in one sensitivity setting only.

2. INTRINSIC SAFETY

The detectors are for use in potentially explosive gas and dust atmospheres (zone 0 gas, zone 20 dust).

The detectors are designed to comply with EN/IEC 60079-0:2006, EN/IEC 60079-11:2007 and EN/IEC61241-11:2006 for Intrinsically Safe apparatus. They are certified:

ATEX code:	**II 1 GD** CE 1180
Certificate:	**BAS01ATEX1134X**
Gas/Dust code:	**Ex ia IIC T5** **Ex iaD 20 T100°C**
IECEx Certificate:	**IECEx BAS 07.0056X**

These detectors are designed and manufactured to protect against other hazards as defined in paragraph 1.2.7 of Annex II of the ATEX Directive 94/9/EC.

2.1 DETECTOR USE

It is recommended that the detector is used in conjunction with a suitable isolator or shunt diode safety barrier in a certified Intrinsically Safe system, ie, System 620.

2.2 SPECIAL CONDITIONS OF SAFE USE

The apparatus has a plastic enclosure which constitutes a potential electrostatic hazard. The enclosure must be cleaned only with a damp cloth.

3. OPERATING PRINCIPLE

The MR601TEx operates by sensing the optical scatter from smoke particles generated in a fire. While the optical scatter detector can give good detection performance for the majority of fires, some fast burning fires produce little visible smoke and some produce very black smoke, neither of which are easily detected by the optical scatter detector. (Such fires are represented in EN54-7 by Polyurethane and Heptane type fires respectively). These fires do, however, produce high heat outputs with an associated rise in air temperature.

The detector has been designed to offer improved detection of such fires, by detecting the rapid rate-of-rise of air temperature and under these conditions, increasing the smoke detection sensitivity. This gives an earlier detection of such fires and a broader detection capability than a standard detector.

The MR601TEx detector has two sensing systems as follows:

- An optical chamber with associated electronics to measure the presence of smoke by light scatter.
- A thermistor with its associated electronics to detect the presence of hot air draughts or high temperatures.

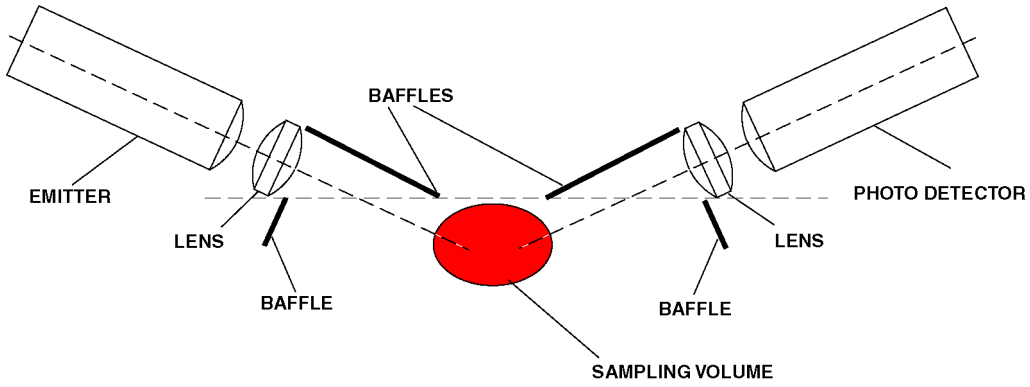


Fig. 1 Optical System Schematic

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

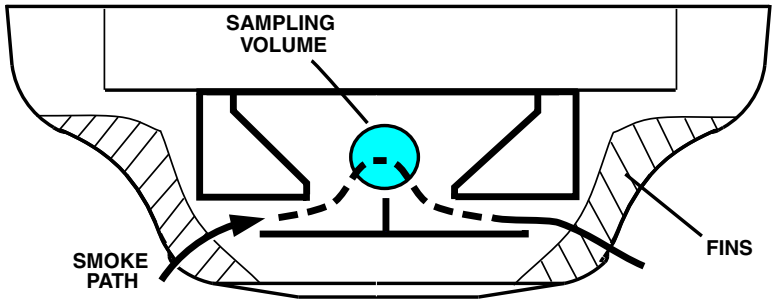


Fig. 2 Measuring Chamber Showing Smoke Flow Path

3.1 OPTICAL SYSTEM

The MR601TEx detects visible particles produced in fires by using the light scattering properties of the particles. The detector uses the optical arrangement shown diagrammatically in Fig. 1.

The optical system consists of an infra-red emitter and receiver, with a lens in front of each, so arranged that their optical axes cross in the sampling volume. The emitter, with its lens, produces a narrow beam of light which is prevented from reaching the receiver by the baffles. When smoke is present in the sampling volume a proportion of the light is scattered, some of which reaches the receiver. For a given type of smoke, the light reaching the photodetector is proportional to the smoke density. The amplified output from the sensor can be used to activate an alarm circuit at a predetermined threshold.

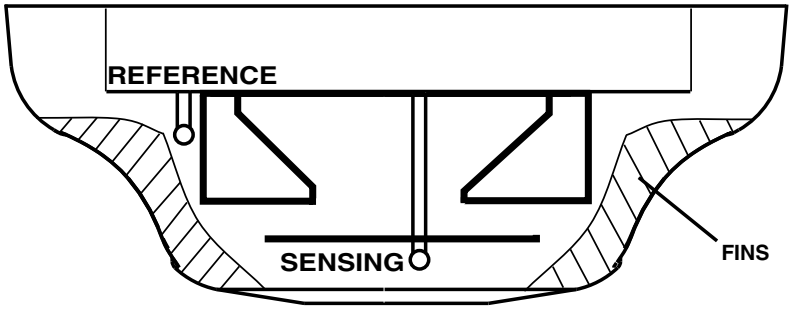


Fig. 3 Thermal Measuring System

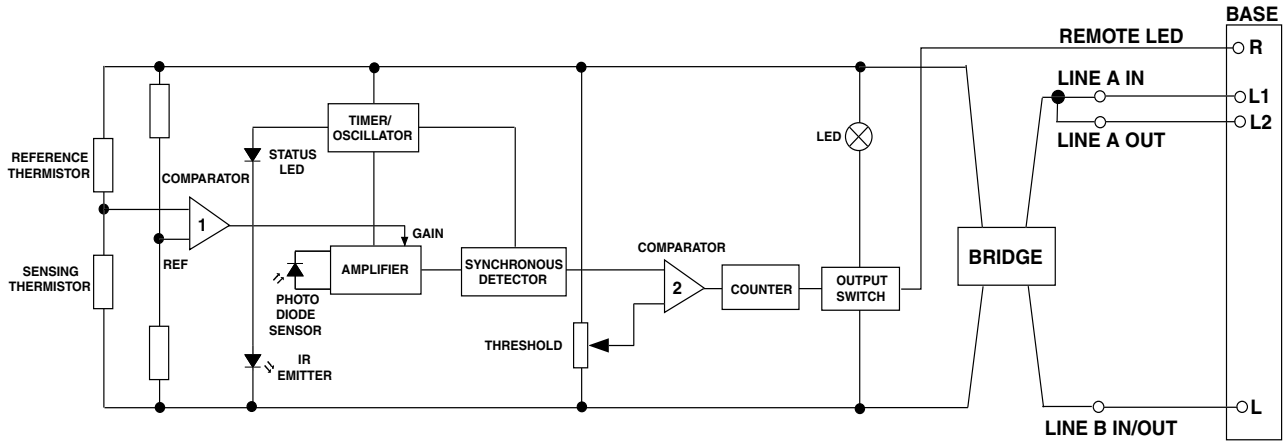


Fig. 4 Block Schematic of Detector

3.2 FEATURES OF MEASURING CHAMBER

The MR601TEx uses vertical chevrons to exclude ambient light.

Smoke incident on the detector is channelled into the detector by the outer cover fins (Fig. 2) and passes through the vertical chevrons. The smoke is deflected into the optical chamber and through the sampling volume before passing out the other side of the detector.

The emitter (Fig. 1) is a GaAlAs solid state type operating in the near infra-red (880nm peak), while the detector is a matched silicon photodiode. These devices, together with their associated lenses, are held in place by the chamber mouldings. The design of the optical system is such that the presence of small insects such as thrips, should not cause false alarms.

3.3 THERMAL MEASURING SYSTEM

Refer to Fig. 3.

This is designed to detect the presence of horizontally moving hot air draughts moving across the ceiling which occur in a fast burning fire.

The measuring system consists of two fast responding negative temperature thermistors. A sensing thermistor is located above the labyrinth under the cover in the airstream and will detect any sudden changes in the air temperature or draughts of hot air moving across the ceiling. The second thermistor is located out of the airflow within the smoke labyrinth and has a longer time constant and is used as a temperature reference to compare the sensing thermistor against. At a given temperature differential between the two thermistors, the comparator will switch and increase the gain of the amplifier, thereby increasing the sensitivity of the sensor. Fins located on the top of the labyrinth are designed to increase air turbulence and the efficiency of the sensing thermistor.

3.4 CIRCUIT OPERATIONS

A simplified block schematic of the detector is given in Fig. 4.

The emitter is subjected to a pulse stream only every 10s in order to reduce the quiescent current. The pulse signal received by the photodiode is fed to a high-gain amplifier. If smoke is present, the pulse signal received varies in proportion to the smoke density.

The amplifier output is fed via an integrator, the output of which is compared to a preset threshold level. Sophisticated synchronous detection techniques are used to reduce the effects of noise and spurious transients.

The gain of the front end amplifier is controlled by the thermistor bridge circuit. When the temperature differential between the two thermistors exceeds a certain value, the amplifier gain increases. Under these conditions the High Performance Optical detector is more sensitive to the presence of smoke and is said to be in 'Enhanced Mode'.

When the detector is in the 'Enhanced Mode', the detector will only alarm if a smoke signal is present. The presence of rising temperature alone cannot cause an alarm.

If the signal amplitude exceeds a threshold level, then the emitter samples the smoke every two seconds. The sample period remains at two seconds if the signal is above the threshold. When the counter has counted three consecutive pulses above the threshold, the output stage is latched into the alarm condition. If however, the amplitude of the second or third pulse is below the threshold, then the pulse period reverts to 10 seconds and the counter resets. The switching of the output stage lights the alarm LED and provides drive for the remote LED indicator.

The critical front end of the circuit is run off a 12V regulator to make it independent of supply voltage.

The detector is polarity conscious.

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

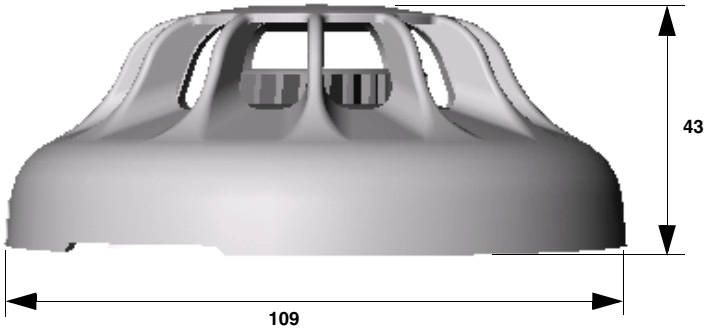


Fig. 5 Overall Dimensions of MR601TEx

3.5 WIRING

Loop cabling is connected to base terminals as follows:

L	-VE
L1	+VE IN
L2	+VE OUT
R	Remote LED Drive

4. MECHANICAL CONSTRUCTION

The major components of the detector are:

- Body Assembly
- Printed Circuit
- Optical Chamber
- Optical Chamber Cover
- Thermistor
- Light Pipe
- Outer Cover

4.1 ASSEMBLY

The body assembly consists of a plastic moulding which has four embedded detector contacts which align with contacts in the 5BEx base. The moulding incorporates securing features to retain the detector in the base.

The PCB is soldered to the body contacts. These contacts act as a mechanical fixture during assembly and provide electrical contact between the contacts and the PCB. The PCB is then potted.

The chamber cover is clipped to the body over the optical chamber ensuring the thermistor protrudes through the cover. The light pipe is slotted into the chamber cover. Finally, the outer cover is clipped to the body.



Fig. 6 MR601TEx Enhanced Optical Smoke Detector with 5BEx 5" Base

4.2 TEST AND FINAL ASSEMBLY

The detectors are fully functionally tested and their sensitivities set in a smoke tunnel to ensure correct calibration. The sealing ring and labels are then fitted to complete detector assembly.

5. TECHNICAL SPECIFICATION

5.1 MECHANICAL

Dimensions

The dimensions of the MR601TEx detector are shown in Fig. 5.

Materials

Body and cover:	FR110 'BAYBLEND' Fire Resistant

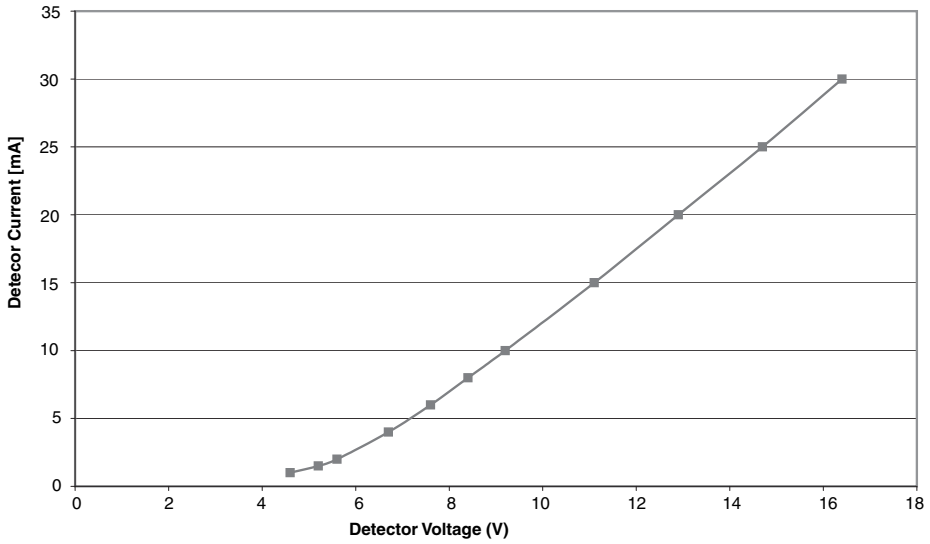


Fig. 7 Alarm Load Presented to the Controller

Weight

Detector:	0.128kg
Detector + base:	0.174kg

5.2 ENVIRONMENTAL

Operating Temperature:	-20°C to +70°C (please see note below).
Storage Temperature:	-25°C to +80°C

Note:

1) ***The operating temperatures quoted exceed the ATEX Certification limits.***
2) *Operation below 0°C is not recommended unless steps are taken to eliminate condensation and hence ice formation on the detector.*

Relative Humidity:	95% non-condensing
Shock:) Vibration:) Impact:) Corrosion:)	To EN54-7

5.3 ELECTROMAGNETIC COMPATIBILITY

The detector complies with the following:

Product family standard EN50130-4 in respect of Conducted Disturbances, Radiated Immunity, Electrostatic Discharge, Fast Transients and Slow High Energy

EN 61000-6-3 for Emissions

5.4 ELECTRICAL CHARACTERISTICS

The alarm load presented to the controller is shown in Fig. 7.

The following characteristics shown in Table 1 are taken at 25°C with a supply voltage of 20V unless otherwise specified.

Characteristics	Min.	Typ.	Max.	Unit
Operating Voltage (d.c.)	16	20	28	V
Average Quiescent Current	90		110	µA
Switch-on-Surge			130	µA
Stabilisation Time			60	sec
Alarm Current	See Fig. 6			mA
Holding Voltage			5	V
Holding Current			1	mA
Reset Time		2	5	sec
Remote LED Drive	Remote LED via 3.4k			

Table. 1 Electrical Characteristics

Intrinsic Safety Rating:

Maximum Voltage for safety (U_i):	28V
Maximum Current for Safety (I_i):	93mA
Maximum Power Input (P_i):	650mW
Equivalent Inductance (L_i):	0
Equivalent Capacitance (C_i):	0

5.5 PERFORMANCE CHARACTERISTICS

The fundamental parameter used to define the sensitivity of an optical smoke detector is the level of smoke which will just produce an alarm under 'ideal' conditions. This parameter, known as the response threshold value, is normally measured in a smoke tunnel and is defined in terms of the obscuration produced by the smoke over a one metre path. The response threshold value is normally given in dB/m, (or % per m).

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

Interpretation of response threshold value is somewhat complicated by the fact that the measurement is given in terms of obscuration, whereas the detector works by scattering from the smoke particles. The response threshold (m) value will therefore, depend on the colour of the smoke. Black smokes give less scattering than light smokes for given values of obscuration as shown in Fig. 8.

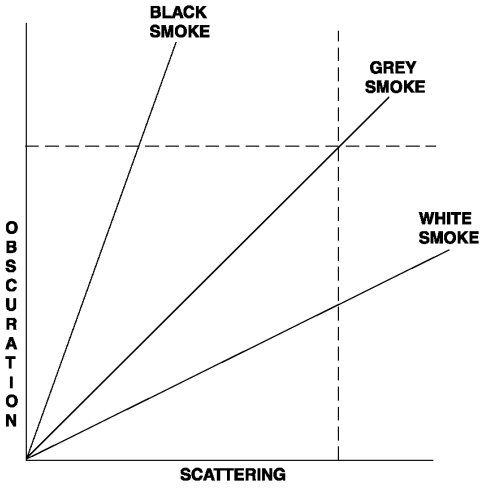


Fig. 8 Response Threshold vs Smoke Colour

Sensitivities are invariably specified for 'grey' smokes as produced by typical smouldering fires. Values for the MR601TEx are given below.

5.5.1 RESPONSE TO RATE OF CHANGE OF TEMPERATURE

The detector will not be enhanced by slow rates of change of temperature, or by cold air draughts moving across the ceiling creating negative rates of change of temperature. The detector is designed to detect sudden horizontal draughts of hot air produced by fast burning fires. The enhancement switching point has been set to allow the detection of TF1 type fires.

Normal response threshold = 0.19 dB/m, 2.7%/m typical.

Enhanced mode threshold = 0.08 dB/m, 1.1%/m typical.

5.6 RESPONSE TO FIRE TESTS

The response of an optical scatter detector to a fire will depend to a large extent on the colour of the smoke produced in the fire. However, other factors such as the detector smoke entry characteristics, the development of the fire and the thermal lift produced by the fire are important. In order to evaluate the response under realistic conditions, detectors are subjected to test fires which cover a range of fire types. These tests are defined in EN54 Pt 7. The MR601TEx passes the following Fire Tests:

TF1	open cellulosic (wood-flaming)
TF2	smouldering pyrolysis
TF3	glowing smouldering (cotton)
TF4	open plastics (polyurethane foam)
TF5	liquid (n-heptane)

Table 2: Response to Fire Tests

Note: TF2 to TF5 are mandatory test fires required to meet EN54 Pt 7.

The MR601TEx is designed to respond to the mandatory tests TF2 to TF5 as required by BS5445 Pt 7. The MR601TEx gives an earlier response to TF5 fires than the MR601 due to its thermal circuit detecting the heat generated by this test of fire and the MR601TEx being 'enhanced'. For the same reason the MR601TEx will detect test fire TF1 (open wood cellulosic flaming fire) which is not normally detected by optical smoke detectors - demonstrating the detectors broader detection capability.

The MR601TEx does not respond to TF6 liquid (methylated spirit) which although having a rapidly rising temperature, does not generate any optical scattering. This shows that the High Performance Optical detector will not respond to hot air draughts without the presence of smoke.

6. INSTALLATION RECOMMENDATIONS

It is not recommended that the MR601TEx be installed in areas where it is likely to be regularly enhanced, since in this condition the detector is extra sensitive and there is a possibility of unwanted alarms from low ambient smoke levels.

The MR601TEx is designed to become enhanced by detecting a rapid temperature rise (>10°C) in air moving horizontally across the ceiling. Siting sensors in positions where air is being blown through the detector should therefore, be particularly avoided, eg, close to ceiling ducts or ceiling mounted industrial heaters; or areas of forced ventilation, such as ducts and under floor voids of computer suites.

Also, not recommended are areas open to the outdoors, such as cargo handling bays, or areas where the detector may become contaminated.

The MR601TEx is not recommended for use in applications where a heater jacket is required.

The MR601TEx is primarily aimed at benign environments.

7. CPD INFORMATION

CE

0832

Tyco Safety Products
Dunhams Lane
Letchworth SG6 1BE
UK

06

0832-CPD-0248

EN 54-7: 2000 + A1: 2002

Conventional Intrinsically Safe high performance photoelectric smoke detector with heat enhancement for use in fire detection and alarm systems in buildings

MR601TEx

Application & Design	01B-04-D12
Installation Instructions	01B-04-I3
Service Instructions	01B-04-S2

8. DETECTOR IDENTIFICATION

The detector is identified by the logo label, as shown in Fig. 9.

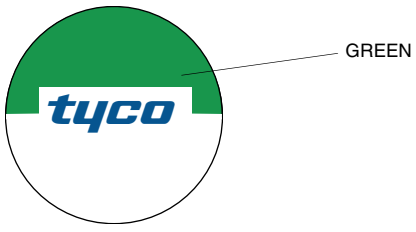


Fig. 9 Detector identification

9. ORDERING INFORMATION

MR601TEx Intrinsically Safe Enhanced Optical Smoke Detector:	516.054.011.Y
5BEx 5" Universal IS Base:	517.050.023

JM/jm

5th May 2010

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

ROSETTI MARINO — CROSSWIND

ITEM	Tag	950-SDZ-06204	: Smoke Detector - FZ-06 B-100 Ambient	Dwg	123A90-DDL-SAF-DL-30027		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module	LD_B-100		
TASK	code	C10003051	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	COMM	Activity FTS	Discipline	Instrumental	Form FJ04S	Smoke Detection

LOOP DATA

Loop TAG	950-SDZ-06204			TSLD	123A90-DDL-IN-DG-40014 SHEET 290 REV. 1_A		
IO Type	Input Yes	Output Yes		Energy by transmitter	NA	Energy by system	Yes
Marshalling	B400-FGS-001	Terminal 08A-08B		Slot 01	Rack 01	Chanel 08	

LOOP TEST

1	Check earth isolation of the loop			OK
2	Connect loop to terminal			OK
3	Confirm Process Scale	Unit %	Min 0 % / Max 34 %	OK

LOOP RANGE		0%	25%	50%	75%	100%	
4	Physical value applied for test	Unit					
5	Control System Display	Unit					

LOOP SERVICE

		Value	Trip	Gen Alarm	DCS Alarm	SOE	DCS display	
6	Threshold 1	34 %	NA	Yes	Yes	NA	OK	OK
7	Threshold 2							
8	Threshold 3							
9	Threshold 4							
10	Checking of line monitoring		Yes	Yes	Yes	NA	OK	OK
11	Checking of Maintenance Inhibition		No	No	No	No	OK	OK
12	Associated safety Level / bar		ESD-1D					OK
13	Associated outputs							

TESTING & MEASUREMENT INSTRUMENT USED

Type	Serial N.	Calibration Certificate	Validity
ELECTRIC CALIBRATOR FLUKE 725	4498694	7717/24	10/07/2025
SOLO A10S SMOKE AEROSOL	SOLO A10S-001		

LOOP DOCUMENTATION


14	Loop diagram is marked up and attached to this test sheet	OK
15	Cause and effect chart is highlighted accordingly	
16	Any defect is recorded for punch list issuance	OK

Comments:

Page 1/1	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM	RM COMM	CW
Name	Mohammed Barghouti	Giandonato Delmissier	John Mackillop
Date	2025-01-22	2025-01-22	2025-01-28
Signature	Digitaly signed by Mohammed Barghouti 2025-01-22T06:06:12.341Z	Digitaly signed by Giandonato Delmissier 2025-01-22T07:19:49.634Z	Digitaly signed by John Mackillop 2025-01-28T19:38:44.536Z

DRAWING No. 123A90-DDL-IN-DG-40014 REV. 01

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

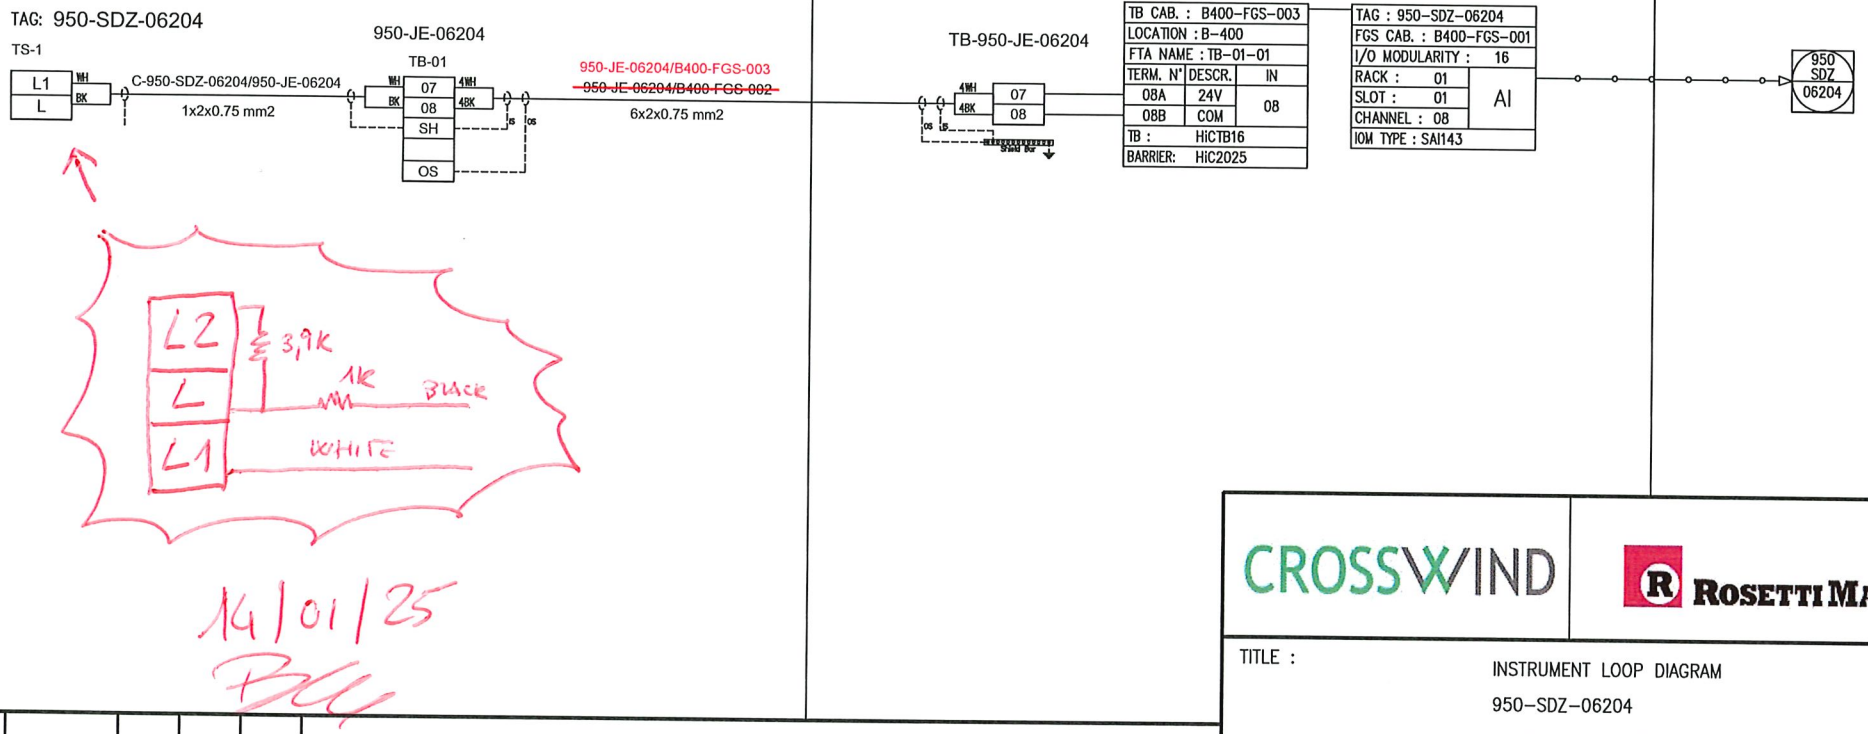

14/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	06/12/2024	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 1_A | DATE: 20/12/24 | SIGNATURE: C.Pilato
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSTRUMENT LOOP DIAGRAM
950-SDZ-06204
FZ-06 SMOKE DETECT. IN B-100 HV/MV SWGR ROOM

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024
A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 290	REV. 01

File Name : 123A90-DDL-IN-DG-40014_REV.01



solo™
detectortesters

*A **single** testing system.*
*A **complete** range of testing tools.*





detectortesters
testing technology from No Climb

solo™ detectortesters

A complete range of test and maintenance equipment for smoke, heat and CO detectors.

Testing equipment must be proven to be safe for the engineer and the system, it needs to be cost-effective, versatile, portable, approved by all detector manufacturers and in compliance with international codes and standards.

The Solo range meets all of these requirements.

SMOKE DETECTOR TESTING



SIGNALING UL LISTED Fire Alarm Equipment 77TL Smoke Detector Accessory

Solo 330 Aerosol Dispenser

Codes and standards require functional tests to introduce (simulated) smoke through the detector vents and into the sensing chamber. The Solo 330 dispenser is the most popular device for achieving this, benefiting as it does, from a cup big enough for the great majority of detectors but still small enough not to be obstructive and unwieldy.

- UL Listed
- Approved by leading detector manufacturers
- Dispenser and patented diaphragm contain particles – conserves test gas / smoke
- Strong – to withstand rigours of daily use
- Spring-loaded mechanism – for effective, economic aerosol delivery
- Clear cup – enables view of the detector LED while testing
- Universal – suits most detectors
- Designed for use at height and at angles
- Interchangeable with all other tools on Solo poles
- Lifetime Warranty



Solo 330 for use with **Solo A3** & **C3** Aerosols

Solo 332 is available for larger diameter detectors.

Solo 332
Aerosol Dispenser



> "...the testing system is high quality and is very well liked by our technicians and customers alike. The use of this product helps TSS fulfill its goal as the premiere fire alarm company in NYC"
>
> John Bonanno
> **TSS Integrated Systems**

DETECTOR TESTING AEROSOLS

Solo A10S Smoke Aerosol
Non-Flammable Solution

The new HFC-Free smoke aerosol for the functional testing of smoke detectors. Like all Solo products, Solo A10S is approved by leading detector manufacturers and offers the reliability and quality expected by the industry.

- **Simple** to use
- **Fast** activation – via Solo 330 dispenser
- **Rapid** clearing
- **Compatible** with leading detector brands



Choosing the right aerosol

Chemicals used in detector test equipment need to be compatible with the plastics from which the detectors are manufactured. Not all test aerosols offer this compatibility which can lead to problems such as stress cracking in detectors, residue build up, damage to components and harm to the environment. Solo aerosols are the most thoroughly researched solutions – approved by leading detector manufacturers, third parties and fire engineers.

- **UL & ULC Certified**
- **Approved** by world leading detector manufacturers
- **Non-flammable** (same as Solo A3)
- **HFC-Free** – fully compliant with latest regulations: Protecting the global environment
- **Silicone Free** – prevents detector contamination: Protecting the local environment

Solo A10S is available in the standard 250ml can.




Ordering information	Product Code:
Solo A10S 250ml	SOLO A10S-001
Sold in multiples of 12	

detectortesters

www.solo-tester.com


TELESCOPIC ACCESS POLES

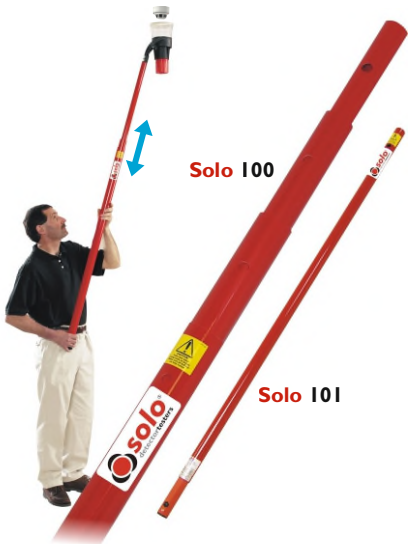

Solo 100/101/108 Telescopic Access Poles

The core element of the Solo range is the telescopic and extension access poles which are extremely lightweight and quickly extend to provide access to detectors up to 9 metres*.

- Light – easy to use at height, on-site, day after day
- Non-whip – even at height
- Certified non-conductive – protecting both the engineer and overhead live equipment from inadvertent shorts
- Available in one, two or four telescopic sections
- Lifetime Warranty

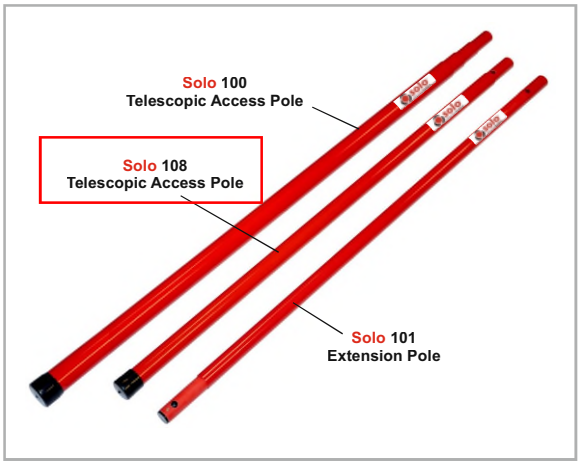

*See Product Selector for details on height guide.

MR601TEx INTRINSICALLY SAFE ENHANCED OPTICAL SMOKE DETECTOR

PRODUCT APPLICATION AND DESIGN INFORMATION

1. INTRODUCTION

The MR601TEx Intrinsically Safe High Performance Optical Smoke Detector forms part of the M600Ex series of plug in detectors for ceiling mounting. The detector plugs into the 5BEx 5" Universal IS Base and is intended for two-wire operation on the majority of the control equipment currently manufactured by the company. The Intrinsically Safe High Performance Optical detector is available in one sensitivity setting only.

2. INTRINSIC SAFETY

The detectors are for use in potentially explosive gas and dust atmospheres (zone 0 gas, zone 20 dust).

The detectors are designed to comply with EN/IEC 60079-0:2006, EN/IEC 60079-11:2007 and EN/IEC61241-11:2006 for Intrinsically Safe apparatus. They are certified:

ATEX code:	**II 1 GD** CE 1180
Certificate:	**BAS01ATEX1134X**
Gas/Dust code:	**Ex ia IIC T5** **Ex iaD 20 T100°C**
IECEx Certificate:	**IECEx BAS 07.0056X**

These detectors are designed and manufactured to protect against other hazards as defined in paragraph 1.2.7 of Annex II of the ATEX Directive 94/9/EC.

2.1 DETECTOR USE

It is recommended that the detector is used in conjunction with a suitable isolator or shunt diode safety barrier in a certified Intrinsically Safe system, ie, System 620.

2.2 SPECIAL CONDITIONS OF SAFE USE

The apparatus has a plastic enclosure which constitutes a potential electrostatic hazard. The enclosure must be cleaned only with a damp cloth.

3. OPERATING PRINCIPLE

The MR601TEx operates by sensing the optical scatter from smoke particles generated in a fire. While the optical scatter detector can give good detection performance for the majority of fires, some fast burning fires produce little visible smoke and some produce very black smoke, neither of which are easily detected by the optical scatter detector. (Such fires are represented in EN54-7 by Polyurethane and Heptane type fires respectively). These fires do, however, produce high heat outputs with an associated rise in air temperature.

The detector has been designed to offer improved detection of such fires, by detecting the rapid rate-of-rise of air temperature and under these conditions, increasing the smoke detection sensitivity. This gives an earlier detection of such fires and a broader detection capability than a standard detector.

The MR601TEx detector has two sensing systems as follows:

- An optical chamber with associated electronics to measure the presence of smoke by light scatter.
- A thermistor with its associated electronics to detect the presence of hot air draughts or high temperatures.

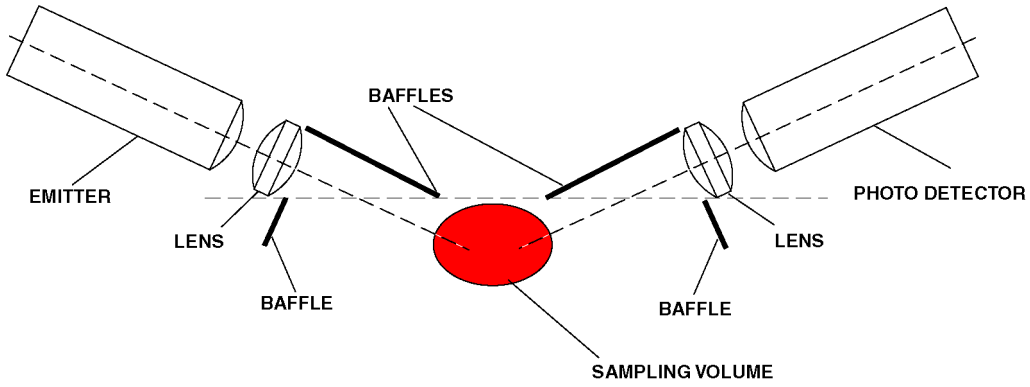


Fig. 1 Optical System Schematic

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

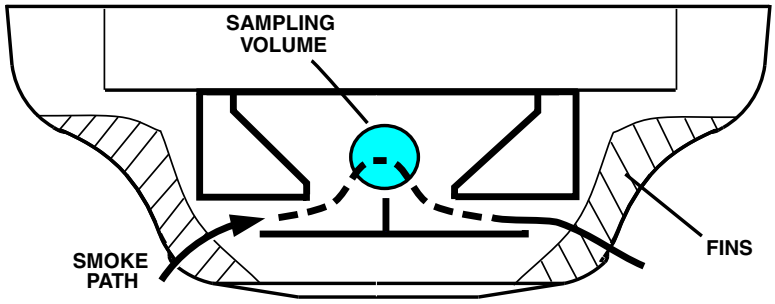


Fig. 2 Measuring Chamber Showing Smoke Flow Path

3.1 OPTICAL SYSTEM

The MR601TEx detects visible particles produced in fires by using the light scattering properties of the particles. The detector uses the optical arrangement shown diagrammatically in Fig. 1.

The optical system consists of an infra-red emitter and receiver, with a lens in front of each, so arranged that their optical axes cross in the sampling volume. The emitter, with its lens, produces a narrow beam of light which is prevented from reaching the receiver by the baffles. When smoke is present in the sampling volume a proportion of the light is scattered, some of which reaches the receiver. For a given type of smoke, the light reaching the photodetector is proportional to the smoke density. The amplified output from the sensor can be used to activate an alarm circuit at a predetermined threshold.

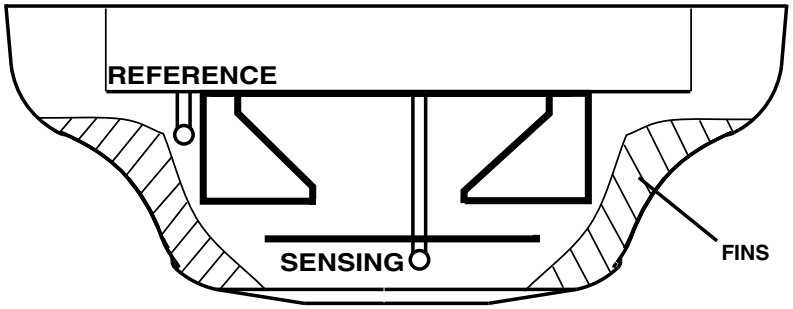


Fig. 3 Thermal Measuring System

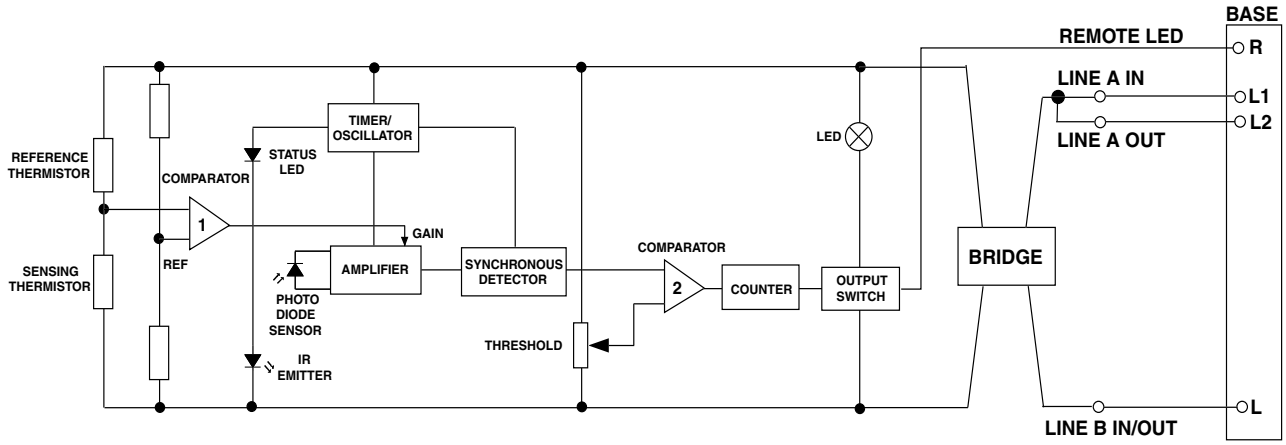


Fig. 4 Block Schematic of Detector

3.2 FEATURES OF MEASURING CHAMBER

The MR601TEx uses vertical chevrons to exclude ambient light.

Smoke incident on the detector is channelled into the detector by the outer cover fins (Fig. 2) and passes through the vertical chevrons. The smoke is deflected into the optical chamber and through the sampling volume before passing out the other side of the detector.

The emitter (Fig. 1) is a GaAlAs solid state type operating in the near infra-red (880nm peak), while the detector is a matched silicon photodiode. These devices, together with their associated lenses, are held in place by the chamber mouldings. The design of the optical system is such that the presence of small insects such as thrips, should not cause false alarms.

3.3 THERMAL MEASURING SYSTEM

Refer to Fig. 3.

This is designed to detect the presence of horizontally moving hot air draughts moving across the ceiling which occur in a fast burning fire.

The measuring system consists of two fast responding negative temperature thermistors. A sensing thermistor is located above the labyrinth under the cover in the airstream and will detect any sudden changes in the air temperature or draughts of hot air moving across the ceiling. The second thermistor is located out of the airflow within the smoke labyrinth and has a longer time constant and is used as a temperature reference to compare the sensing thermistor against. At a given temperature differential between the two thermistors, the comparator will switch and increase the gain of the amplifier, thereby increasing the sensitivity of the sensor. Fins located on the top of the labyrinth are designed to increase air turbulence and the efficiency of the sensing thermistor.

3.4 CIRCUIT OPERATIONS

A simplified block schematic of the detector is given in Fig. 4.

The emitter is subjected to a pulse stream only every 10s in order to reduce the quiescent current. The pulse signal received by the photodiode is fed to a high-gain amplifier. If smoke is present, the pulse signal received varies in proportion to the smoke density.

The amplifier output is fed via an integrator, the output of which is compared to a preset threshold level. Sophisticated synchronous detection techniques are used to reduce the effects of noise and spurious transients.

The gain of the front end amplifier is controlled by the thermistor bridge circuit. When the temperature differential between the two thermistors exceeds a certain value, the amplifier gain increases. Under these conditions the High Performance Optical detector is more sensitive to the presence of smoke and is said to be in 'Enhanced Mode'.

When the detector is in the 'Enhanced Mode', the detector will only alarm if a smoke signal is present. The presence of rising temperature alone cannot cause an alarm.

If the signal amplitude exceeds a threshold level, then the emitter samples the smoke every two seconds. The sample period remains at two seconds if the signal is above the threshold. When the counter has counted three consecutive pulses above the threshold, the output stage is latched into the alarm condition. If however, the amplitude of the second or third pulse is below the threshold, then the pulse period reverts to 10 seconds and the counter resets. The switching of the output stage lights the alarm LED and provides drive for the remote LED indicator.

The critical front end of the circuit is run off a 12V regulator to make it independent of supply voltage.

The detector is polarity conscious.

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

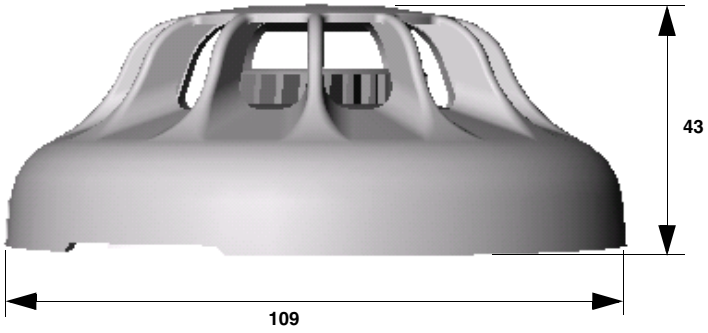


Fig. 5 Overall Dimensions of MR601TEx

3.5 WIRING

Loop cabling is connected to base terminals as follows:

L	-VE
L1	+VE IN
L2	+VE OUT
R	Remote LED Drive

4. MECHANICAL CONSTRUCTION

The major components of the detector are:

- Body Assembly
- Printed Circuit
- Optical Chamber
- Optical Chamber Cover
- Thermistor
- Light Pipe
- Outer Cover

4.1 ASSEMBLY

The body assembly consists of a plastic moulding which has four embedded detector contacts which align with contacts in the 5BEx base. The moulding incorporates securing features to retain the detector in the base.

The PCB is soldered to the body contacts. These contacts act as a mechanical fixture during assembly and provide electrical contact between the contacts and the PCB. The PCB is then potted.

The chamber cover is clipped to the body over the optical chamber ensuring the thermistor protrudes through the cover. The light pipe is slotted into the chamber cover. Finally, the outer cover is clipped to the body.



Fig. 6 MR601TEx Enhanced Optical Smoke Detector with 5BEx 5" Base

4.2 TEST AND FINAL ASSEMBLY

The detectors are fully functionally tested and their sensitivities set in a smoke tunnel to ensure correct calibration. The sealing ring and labels are then fitted to complete detector assembly.

5. TECHNICAL SPECIFICATION

5.1 MECHANICAL

Dimensions

The dimensions of the MR601TEx detector are shown in Fig. 5.

Materials

Body and cover:	FR110 'BAYBLEND' Fire Resistant

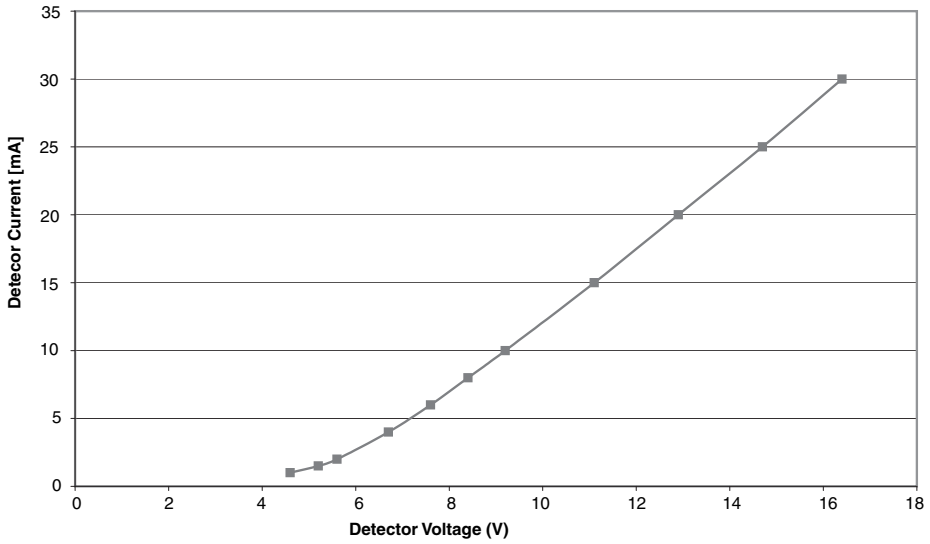


Fig. 7 Alarm Load Presented to the Controller

Weight

Detector:	0.128kg
Detector + base:	0.174kg

5.2 ENVIRONMENTAL

Operating Temperature:	-20°C to +70°C (please see note below).
Storage Temperature:	-25°C to +80°C

Note:

1) ***The operating temperatures quoted exceed the ATEX Certification limits.***
2) *Operation below 0°C is not recommended unless steps are taken to eliminate condensation and hence ice formation on the detector.*

Relative Humidity:	95% non-condensing
Shock:) Vibration:) Impact:) Corrosion:)	To EN54-7

5.3 ELECTROMAGNETIC COMPATIBILITY

The detector complies with the following:

Product family standard EN50130-4 in respect of Conducted Disturbances, Radiated Immunity, Electrostatic Discharge, Fast Transients and Slow High Energy

EN 61000-6-3 for Emissions

5.4 ELECTRICAL CHARACTERISTICS

The alarm load presented to the controller is shown in Fig. 7.

The following characteristics shown in Table 1 are taken at 25°C with a supply voltage of 20V unless otherwise specified.

Characteristics	Min.	Typ.	Max.	Unit
Operating Voltage (d.c.)	16	20	28	V
Average Quiescent Current	90		110	µA
Switch-on-Surge			130	µA
Stabilisation Time			60	sec
Alarm Current	See Fig. 6			mA
Holding Voltage			5	V
Holding Current			1	mA
Reset Time		2	5	sec
Remote LED Drive	Remote LED via 3.4k			

Table. 1 Electrical Characteristics

Intrinsic Safety Rating:

Maximum Voltage for safety (U_i):	28V
Maximum Current for Safety (I_i):	93mA
Maximum Power Input (P_i):	650mW
Equivalent Inductance (L_i):	0
Equivalent Capacitance (C_i):	0

5.5 PERFORMANCE CHARACTERISTICS

The fundamental parameter used to define the sensitivity of an optical smoke detector is the level of smoke which will just produce an alarm under 'ideal' conditions. This parameter, known as the response threshold value, is normally measured in a smoke tunnel and is defined in terms of the obscuration produced by the smoke over a one metre path. The response threshold value is normally given in dB/m, (or % per m).

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

Interpretation of response threshold value is somewhat complicated by the fact that the measurement is given in terms of obscuration, whereas the detector works by scattering from the smoke particles. The response threshold (m) value will therefore, depend on the colour of the smoke. Black smokes give less scattering than light smokes for given values of obscuration as shown in Fig. 8.

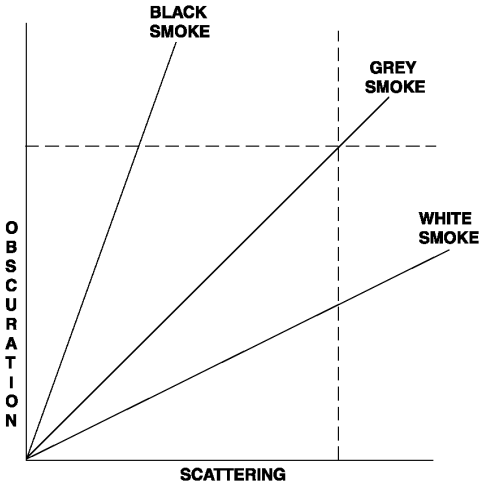


Fig. 8 Response Threshold vs Smoke Colour

Sensitivities are invariably specified for 'grey' smokes as produced by typical smouldering fires. Values for the MR601TEx are given below.

5.5.1 RESPONSE TO RATE OF CHANGE OF TEMPERATURE

The detector will not be enhanced by slow rates of change of temperature, or by cold air draughts moving across the ceiling creating negative rates of change of temperature. The detector is designed to detect sudden horizontal draughts of hot air produced by fast burning fires. The enhancement switching point has been set to allow the detection of TF1 type fires.

Normal response threshold = 0.19 dB/m, 2.7%/m typical.

Enhanced mode threshold = 0.08 dB/m, 1.1%/m typical.

5.6 RESPONSE TO FIRE TESTS

The response of an optical scatter detector to a fire will depend to a large extent on the colour of the smoke produced in the fire. However, other factors such as the detector smoke entry characteristics, the development of the fire and the thermal lift produced by the fire are important. In order to evaluate the response under realistic conditions, detectors are subjected to test fires which cover a range of fire types. These tests are defined in EN54 Pt 7. The MR601TEx passes the following Fire Tests:

TF1	open cellulosic (wood-flaming)
TF2	smouldering pyrolysis
TF3	glowing smouldering (cotton)
TF4	open plastics (polyurethane foam)
TF5	liquid (n-heptane)

Table 2: Response to Fire Tests

Note: TF2 to TF5 are mandatory test fires required to meet EN54 Pt 7.

The MR601TEx is designed to respond to the mandatory tests TF2 to TF5 as required by BS5445 Pt 7. The MR601TEx gives an earlier response to TF5 fires than the MR601 due to its thermal circuit detecting the heat generated by this test of fire and the MR601TEx being 'enhanced'. For the same reason the MR601TEx will detect test fire TF1 (open wood cellulosic flaming fire) which is not normally detected by optical smoke detectors - demonstrating the detectors broader detection capability.

The MR601TEx does not respond to TF6 liquid (methylated spirit) which although having a rapidly rising temperature, does not generate any optical scattering. This shows that the High Performance Optical detector will not respond to hot air draughts without the presence of smoke.

6. INSTALLATION RECOMMENDATIONS

It is not recommended that the MR601TEx be installed in areas where it is likely to be regularly enhanced, since in this condition the detector is extra sensitive and there is a possibility of unwanted alarms from low ambient smoke levels.

The MR601TEx is designed to become enhanced by detecting a rapid temperature rise (>10°C) in air moving horizontally across the ceiling. Siting sensors in positions where air is being blown through the detector should therefore, be particularly avoided, eg, close to ceiling ducts or ceiling mounted industrial heaters; or areas of forced ventilation, such as ducts and under floor voids of computer suites.

Also, not recommended are areas open to the outdoors, such as cargo handling bays, or areas where the detector may become contaminated.

The MR601TEx is not recommended for use in applications where a heater jacket is required.

The MR601TEx is primarily aimed at benign environments.

7. CPD INFORMATION

CE

0832

Tyco Safety Products
Dunhams Lane
Letchworth SG6 1BE
UK

06

0832-CPD-0248

EN 54-7: 2000 + A1: 2002

Conventional Intrinsically Safe high performance photoelectric smoke detector with heat enhancement for use in fire detection and alarm systems in buildings

MR601TEx

Application & Design	01B-04-D12
Installation Instructions	01B-04-I3
Service Instructions	01B-04-S2

8. DETECTOR IDENTIFICATION

The detector is identified by the logo label, as shown in Fig. 9.

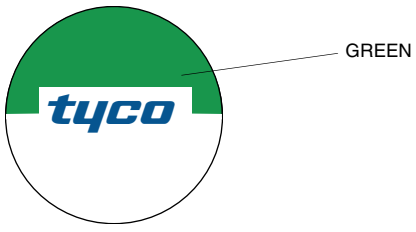


Fig. 9 Detector identification

9. ORDERING INFORMATION

MR601TEx Intrinsically Safe Enhanced Optical Smoke Detector:	516.054.011.Y
5BEx 5" Universal IS Base:	517.050.023

JM/jm

5th May 2010

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	950-SDZ-06203	: Smoke Detector - FZ-06 B-100 HVAC Air Intake	Dwg	123A90-DDL-SAF-DL-30027		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module	LD_B-100_Ext		
TASK	code	C10003052	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	COMM	Activity FTS	Discipline	Instrumental	Form FJ04S	Smoke Detection

LOOP DATA

Loop TAG	950-SDZ-06206			TSLD	123A90-DDL-IN-DG-40014 SHEET 289 REV. 1_A		
IO Type	Input Yes	Output Yes		Energy by transmitter	NA	Energy by system	Yes
Marshalling	B400-FGS-001	Terminal 08A-08B		Slot 05	Rack 01	Chanel 07	

LOOP TEST

1	Check earth isolation of the loop				OK
2	Connect loop to terminal				OK
3	Confirm Process Scale	Unit %	Min 0 %	Max 34 %	OK

LOOP RANGE		0%	25%	50%	75%	100%	
4	Physical value applied for test	Unit					
5	Control System Display	Unit					

LOOP SERVICE

		Value	Trip	Gen Alarm	DCS Alarm	SOE	DCS display	
6	Threshold 1	34 %	NA	Yes	Yes	NA	OK	OK
7	Threshold 2							
8	Threshold 3							
9	Threshold 4							
10	Checking of line monitoring		Yes	Yes	Yes	NA	OK	OK
11	Checking of Maintenance Inhibition		No	No	No	No	OK	OK
12	Associated safety Level / bar		ESD-1D					OK
13	Associated outputs							

TESTING & MEASUREMENT INSTRUMENT USED

Type	Serial N.	Calibration Certificate	Validity
ELECTRIC CALIBRATOR FLUKE 725	4498694	7717/24	10/07/2025
SOLO A10S SMOKE AEROSOL	SOLO A10S-001		

LOOP DOCUMENTATION


14	Loop diagram is marked up and attached to this test sheet	OK
15	Cause and effect chart is highlighted accordingly	
16	Any defect is recorded for punch list issuance	OK


Comments:

	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM	RM COMM	CW
Name	Mohammed Barghouti	Giandonato Delmissier	John Mackillop
Date	2025-01-22	2025-01-22	2025-01-28
Signature	PROVERLIS Digitaly signed by Mohammed Barghouti 2025-01-22T06:06:27.679Z	PROVERLIS Digitaly signed by Giandonato Delmissier 2025-01-22T07:21:41.114Z	PROVERLIS Digitaly signed by John Mackillop 2025-01-28T19:39:06.560Z

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 01

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

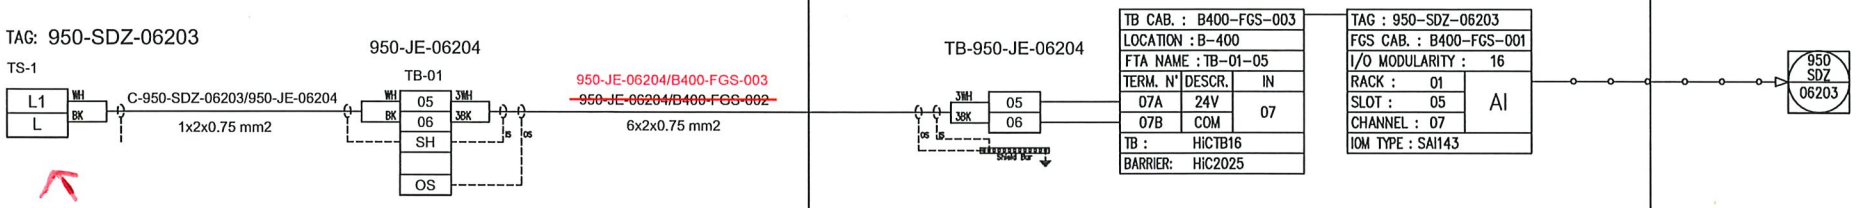

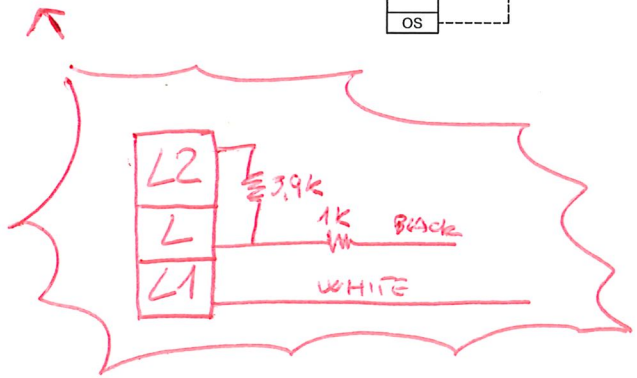

14/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	06/12/2024	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV: 1_A | DATE: 20/12/24 | SIGNATURE: C.Pilato
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSTRUMENT LOOP DIAGRAM
950-SDZ-06203
FZ-06 SMOKE DETECT. IN B-100 HVAC AIR INTAKE

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 289	REV. 01

File Name : 123A90-DDL-IN-DG-40014_REV.01



solo™
detectortesters

*A **single** testing system.*
*A **complete** range of testing tools.*





detectortesters
testing technology from No Climb

solo™ detectortesters

A complete range of test and maintenance equipment for smoke, heat and CO detectors.

Testing equipment must be proven to be safe for the engineer and the system, it needs to be cost-effective, versatile, portable, approved by all detector manufacturers and in compliance with international codes and standards.

The Solo range meets all of these requirements.

SMOKE DETECTOR TESTING



SIGNALING UL LISTED Fire Alarm Equipment 77TL Smoke Detector Accessory

Solo 330 Aerosol Dispenser

Codes and standards require functional tests to introduce (simulated) smoke through the detector vents and into the sensing chamber. The Solo 330 dispenser is the most popular device for achieving this, benefiting as it does, from a cup big enough for the great majority of detectors but still small enough not to be obstructive and unwieldy.

- UL Listed
- Approved by leading detector manufacturers
- Dispenser and patented diaphragm contain particles – conserves test gas / smoke
- Strong – to withstand rigours of daily use
- Spring-loaded mechanism – for effective, economic aerosol delivery
- Clear cup – enables view of the detector LED while testing
- Universal – suits most detectors
- Designed for use at height and at angles
- Interchangeable with all other tools on Solo poles
- Lifetime Warranty



Solo 330 for use with **Solo A3** & **C3** Aerosols

Solo 332 is available for larger diameter detectors.

Solo 332
Aerosol Dispenser



> "...the testing system is high quality and is very well liked by our technicians and customers alike. The use of this product helps TSS fulfill its goal as the premiere fire alarm company in NYC"
>
> John Bonanno
> **TSS Integrated Systems**

DETECTOR TESTING AEROSOLS

Solo A10S Smoke Aerosol
Non-Flammable Solution

The new HFC-Free smoke aerosol for the functional testing of smoke detectors. Like all Solo products, Solo A10S is approved by leading detector manufacturers and offers the reliability and quality expected by the industry.

- **Simple** to use
- **Fast** activation – via Solo 330 dispenser
- **Rapid** clearing
- **Compatible** with leading detector brands



Choosing the right aerosol

Chemicals used in detector test equipment need to be compatible with the plastics from which the detectors are manufactured. Not all test aerosols offer this compatibility which can lead to problems such as stress cracking in detectors, residue build up, damage to components and harm to the environment. Solo aerosols are the most thoroughly researched solutions – approved by leading detector manufacturers, third parties and fire engineers.

- **UL & ULC Certified**
- **Approved** by world leading detector manufacturers
- **Non-flammable** (same as Solo A3)
- **HFC-Free** – fully compliant with latest regulations: Protecting the global environment
- **Silicone Free** – prevents detector contamination: Protecting the local environment

Solo A10S is available in the standard 250ml can.




Ordering information	Product Code:
Solo A10S 250ml	SOLO A10S-001
Sold in multiples of 12	

detectortesters

www.solo-tester.com


TELESCOPIC ACCESS POLES

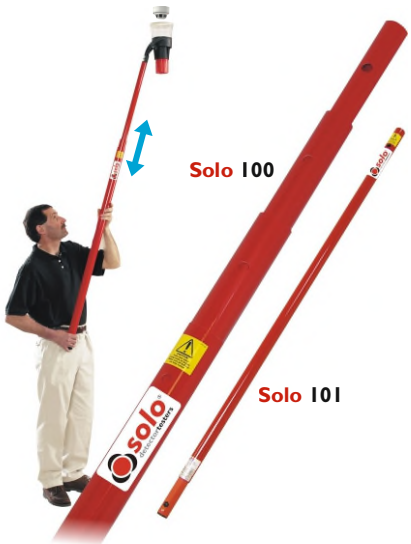

Solo 100/101/108 Telescopic Access Poles

The core element of the Solo range is the telescopic and extension access poles which are extremely lightweight and quickly extend to provide access to detectors up to 9 metres*.

- Light – easy to use at height, on-site, day after day
- Non-whip – even at height
- Certified non-conductive – protecting both the engineer and overhead live equipment from inadvertent shorts
- Available in one, two or four telescopic sections
- Lifetime Warranty

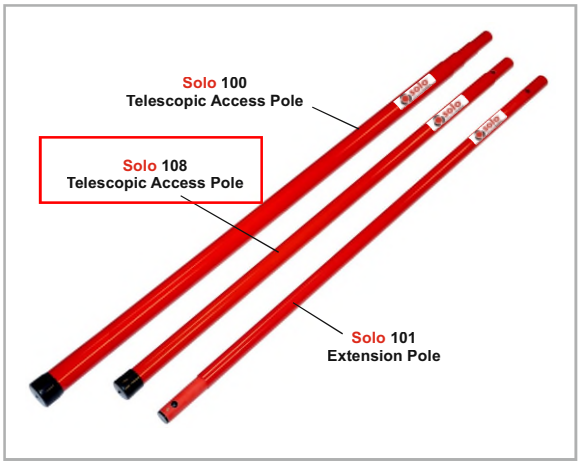

*See Product Selector for details on height guide.

MR601TEx INTRINSICALLY SAFE ENHANCED OPTICAL SMOKE DETECTOR

PRODUCT APPLICATION AND DESIGN INFORMATION

1. INTRODUCTION

The MR601TEx Intrinsically Safe High Performance Optical Smoke Detector forms part of the M600Ex series of plug in detectors for ceiling mounting. The detector plugs into the 5BEx 5" Universal IS Base and is intended for two-wire operation on the majority of the control equipment currently manufactured by the company. The Intrinsically Safe High Performance Optical detector is available in one sensitivity setting only.

2. INTRINSIC SAFETY

The detectors are for use in potentially explosive gas and dust atmospheres (zone 0 gas, zone 20 dust).

The detectors are designed to comply with EN/IEC 60079-0:2006, EN/IEC 60079-11:2007 and EN/IEC61241-11:2006 for Intrinsically Safe apparatus. They are certified:

ATEX code:	**II 1 GD** CE 1180
Certificate:	**BAS01ATEX1134X**
Gas/Dust code:	**Ex ia IIC T5** **Ex iaD 20 T100°C**
IECEx Certificate:	**IECEx BAS 07.0056X**

These detectors are designed and manufactured to protect against other hazards as defined in paragraph 1.2.7 of Annex II of the ATEX Directive 94/9/EC.

2.1 DETECTOR USE

It is recommended that the detector is used in conjunction with a suitable isolator or shunt diode safety barrier in a certified Intrinsically Safe system, ie, System 620.

2.2 SPECIAL CONDITIONS OF SAFE USE

The apparatus has a plastic enclosure which constitutes a potential electrostatic hazard. The enclosure must be cleaned only with a damp cloth.

3. OPERATING PRINCIPLE

The MR601TEx operates by sensing the optical scatter from smoke particles generated in a fire. While the optical scatter detector can give good detection performance for the majority of fires, some fast burning fires produce little visible smoke and some produce very black smoke, neither of which are easily detected by the optical scatter detector. (Such fires are represented in EN54-7 by Polyurethane and Heptane type fires respectively). These fires do, however, produce high heat outputs with an associated rise in air temperature.

The detector has been designed to offer improved detection of such fires, by detecting the rapid rate-of-rise of air temperature and under these conditions, increasing the smoke detection sensitivity. This gives an earlier detection of such fires and a broader detection capability than a standard detector.

The MR601TEx detector has two sensing systems as follows:

- An optical chamber with associated electronics to measure the presence of smoke by light scatter.
- A thermistor with its associated electronics to detect the presence of hot air draughts or high temperatures.

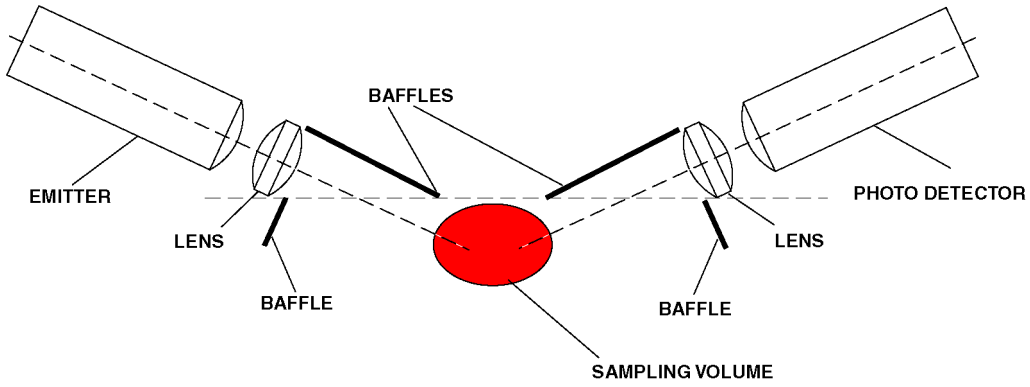


Fig. 1 Optical System Schematic

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

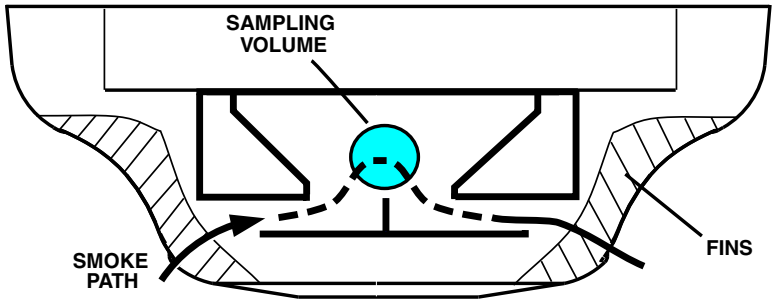


Fig. 2 Measuring Chamber Showing Smoke Flow Path

3.1 OPTICAL SYSTEM

The MR601TEx detects visible particles produced in fires by using the light scattering properties of the particles. The detector uses the optical arrangement shown diagrammatically in Fig. 1.

The optical system consists of an infra-red emitter and receiver, with a lens in front of each, so arranged that their optical axes cross in the sampling volume. The emitter, with its lens, produces a narrow beam of light which is prevented from reaching the receiver by the baffles. When smoke is present in the sampling volume a proportion of the light is scattered, some of which reaches the receiver. For a given type of smoke, the light reaching the photodetector is proportional to the smoke density. The amplified output from the sensor can be used to activate an alarm circuit at a predetermined threshold.

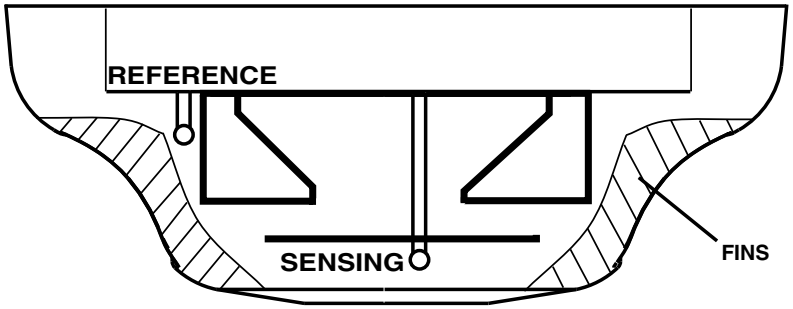


Fig. 3 Thermal Measuring System

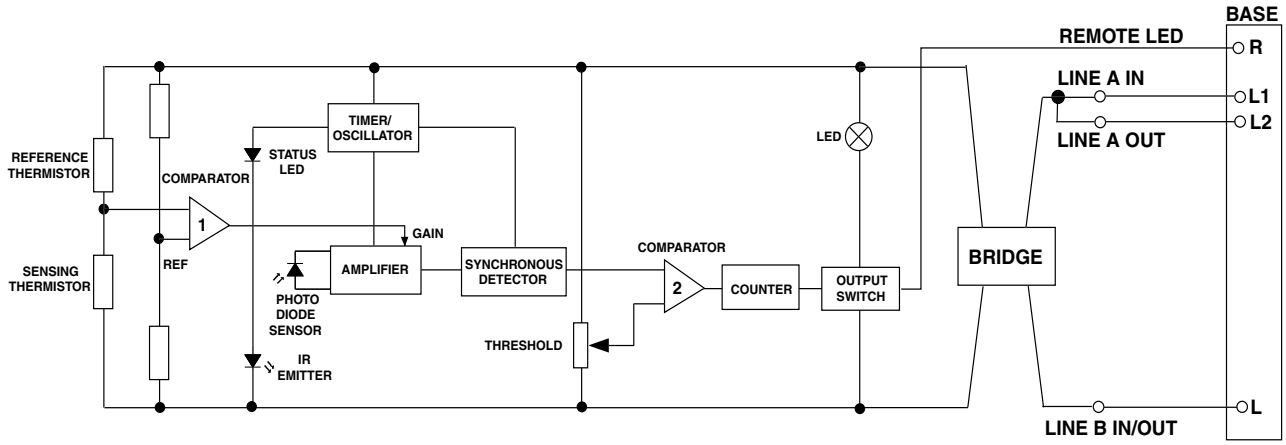


Fig. 4 Block Schematic of Detector

3.2 FEATURES OF MEASURING CHAMBER

The MR601TEx uses vertical chevrons to exclude ambient light.

Smoke incident on the detector is channelled into the detector by the outer cover fins (Fig. 2) and passes through the vertical chevrons. The smoke is deflected into the optical chamber and through the sampling volume before passing out the other side of the detector.

The emitter (Fig. 1) is a GaAlAs solid state type operating in the near infra-red (880nm peak), while the detector is a matched silicon photodiode. These devices, together with their associated lenses, are held in place by the chamber mouldings. The design of the optical system is such that the presence of small insects such as thrips, should not cause false alarms.

3.3 THERMAL MEASURING SYSTEM

Refer to Fig. 3.

This is designed to detect the presence of horizontally moving hot air draughts moving across the ceiling which occur in a fast burning fire.

The measuring system consists of two fast responding negative temperature thermistors. A sensing thermistor is located above the labyrinth under the cover in the airstream and will detect any sudden changes in the air temperature or draughts of hot air moving across the ceiling. The second thermistor is located out of the airflow within the smoke labyrinth and has a longer time constant and is used as a temperature reference to compare the sensing thermistor against. At a given temperature differential between the two thermistors, the comparator will switch and increase the gain of the amplifier, thereby increasing the sensitivity of the sensor. Fins located on the top of the labyrinth are designed to increase air turbulence and the efficiency of the sensing thermistor.

3.4 CIRCUIT OPERATIONS

A simplified block schematic of the detector is given in Fig. 4.

The emitter is subjected to a pulse stream only every 10s in order to reduce the quiescent current. The pulse signal received by the photodiode is fed to a high-gain amplifier. If smoke is present, the pulse signal received varies in proportion to the smoke density.

The amplifier output is fed via an integrator, the output of which is compared to a preset threshold level. Sophisticated synchronous detection techniques are used to reduce the effects of noise and spurious transients.

The gain of the front end amplifier is controlled by the thermistor bridge circuit. When the temperature differential between the two thermistors exceeds a certain value, the amplifier gain increases. Under these conditions the High Performance Optical detector is more sensitive to the presence of smoke and is said to be in 'Enhanced Mode'.

When the detector is in the 'Enhanced Mode', the detector will only alarm if a smoke signal is present. The presence of rising temperature alone cannot cause an alarm.

If the signal amplitude exceeds a threshold level, then the emitter samples the smoke every two seconds. The sample period remains at two seconds if the signal is above the threshold. When the counter has counted three consecutive pulses above the threshold, the output stage is latched into the alarm condition. If however, the amplitude of the second or third pulse is below the threshold, then the pulse period reverts to 10 seconds and the counter resets. The switching of the output stage lights the alarm LED and provides drive for the remote LED indicator.

The critical front end of the circuit is run off a 12V regulator to make it independent of supply voltage.

The detector is polarity conscious.

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

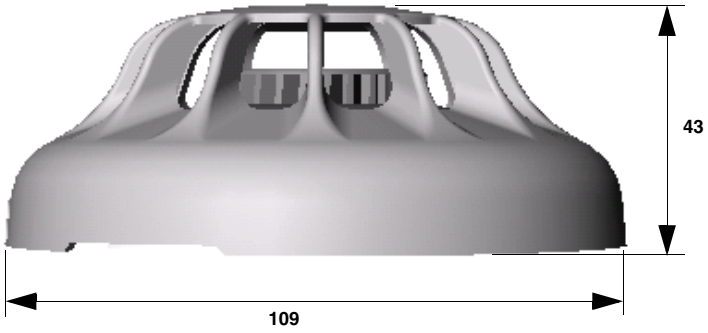


Fig. 5 Overall Dimensions of MR601TEx

3.5 WIRING

Loop cabling is connected to base terminals as follows:

L	-VE
L1	+VE IN
L2	+VE OUT
R	Remote LED Drive

4. MECHANICAL CONSTRUCTION

The major components of the detector are:

- Body Assembly
- Printed Circuit
- Optical Chamber
- Optical Chamber Cover
- Thermistor
- Light Pipe
- Outer Cover

4.1 ASSEMBLY

The body assembly consists of a plastic moulding which has four embedded detector contacts which align with contacts in the 5BEx base. The moulding incorporates securing features to retain the detector in the base.

The PCB is soldered to the body contacts. These contacts act as a mechanical fixture during assembly and provide electrical contact between the contacts and the PCB. The PCB is then potted.

The chamber cover is clipped to the body over the optical chamber ensuring the thermistor protrudes through the cover. The light pipe is slotted into the chamber cover. Finally, the outer cover is clipped to the body.



Fig. 6 MR601TEx Enhanced Optical Smoke Detector with 5BEx 5" Base

4.2 TEST AND FINAL ASSEMBLY

The detectors are fully functionally tested and their sensitivities set in a smoke tunnel to ensure correct calibration. The sealing ring and labels are then fitted to complete detector assembly.

5. TECHNICAL SPECIFICATION

5.1 MECHANICAL

Dimensions

The dimensions of the MR601TEx detector are shown in Fig. 5.

Materials

Body and cover:	FR110 'BAYBLEND' Fire Resistant

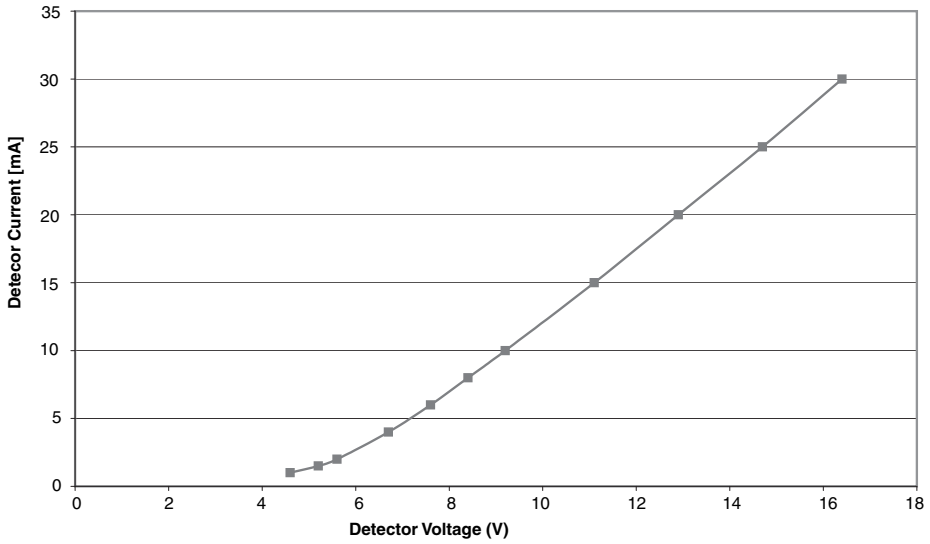


Fig. 7 Alarm Load Presented to the Controller

Weight

Detector:	0.128kg
Detector + base:	0.174kg

5.2 ENVIRONMENTAL

Operating Temperature:	-20°C to +70°C (please see note below).
Storage Temperature:	-25°C to +80°C

Note:

1) ***The operating temperatures quoted exceed the ATEX Certification limits.***
2) *Operation below 0°C is not recommended unless steps are taken to eliminate condensation and hence ice formation on the detector.*

Relative Humidity:	95% non-condensing
Shock:) Vibration:) Impact:) Corrosion:)	To EN54-7

5.3 ELECTROMAGNETIC COMPATIBILITY

The detector complies with the following:

Product family standard EN50130-4 in respect of Conducted Disturbances, Radiated Immunity, Electrostatic Discharge, Fast Transients and Slow High Energy

EN 61000-6-3 for Emissions

5.4 ELECTRICAL CHARACTERISTICS

The alarm load presented to the controller is shown in Fig. 7.

The following characteristics shown in Table 1 are taken at 25°C with a supply voltage of 20V unless otherwise specified.

Characteristics	Min.	Typ.	Max.	Unit
Operating Voltage (d.c.)	16	20	28	V
Average Quiescent Current	90		110	µA
Switch-on-Surge			130	µA
Stabilisation Time			60	sec
Alarm Current	See Fig. 6			mA
Holding Voltage			5	V
Holding Current			1	mA
Reset Time		2	5	sec
Remote LED Drive	Remote LED via 3.4k			

Table. 1 Electrical Characteristics

Intrinsic Safety Rating:

Maximum Voltage for safety (U_i):	28V
Maximum Current for Safety (I_i):	93mA
Maximum Power Input (P_i):	650mW
Equivalent Inductance (L_i):	0
Equivalent Capacitance (C_i):	0

5.5 PERFORMANCE CHARACTERISTICS

The fundamental parameter used to define the sensitivity of an optical smoke detector is the level of smoke which will just produce an alarm under 'ideal' conditions. This parameter, known as the response threshold value, is normally measured in a smoke tunnel and is defined in terms of the obscuration produced by the smoke over a one metre path. The response threshold value is normally given in dB/m, (or % per m).

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

Interpretation of response threshold value is somewhat complicated by the fact that the measurement is given in terms of obscuration, whereas the detector works by scattering from the smoke particles. The response threshold (m) value will therefore, depend on the colour of the smoke. Black smokes give less scattering than light smokes for given values of obscuration as shown in Fig. 8.

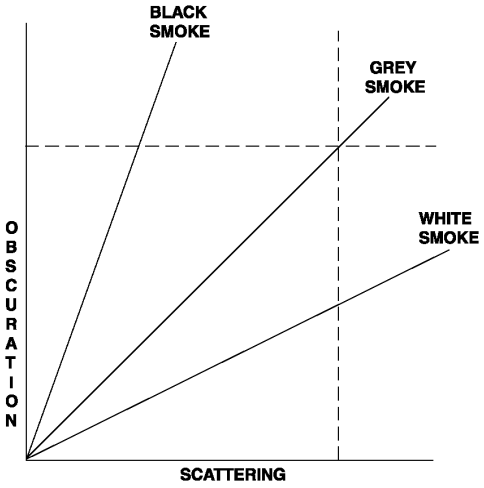


Fig. 8 Response Threshold vs Smoke Colour

Sensitivities are invariably specified for 'grey' smokes as produced by typical smouldering fires. Values for the MR601TEx are given below.

5.5.1 RESPONSE TO RATE OF CHANGE OF TEMPERATURE

The detector will not be enhanced by slow rates of change of temperature, or by cold air draughts moving across the ceiling creating negative rates of change of temperature. The detector is designed to detect sudden horizontal draughts of hot air produced by fast burning fires. The enhancement switching point has been set to allow the detection of TF1 type fires.

Normal response threshold = 0.19 dB/m, 2.7%/m typical.

Enhanced mode threshold = 0.08 dB/m, 1.1%/m typical.

5.6 RESPONSE TO FIRE TESTS

The response of an optical scatter detector to a fire will depend to a large extent on the colour of the smoke produced in the fire. However, other factors such as the detector smoke entry characteristics, the development of the fire and the thermal lift produced by the fire are important. In order to evaluate the response under realistic conditions, detectors are subjected to test fires which cover a range of fire types. These tests are defined in EN54 Pt 7. The MR601TEx passes the following Fire Tests:

TF1	open cellulosic (wood-flaming)
TF2	smouldering pyrolysis
TF3	glowing smouldering (cotton)
TF4	open plastics (polyurethane foam)
TF5	liquid (n-heptane)

Table 2: Response to Fire Tests

Note: TF2 to TF5 are mandatory test fires required to meet EN54 Pt 7.

The MR601TEx is designed to respond to the mandatory tests TF2 to TF5 as required by BS5445 Pt 7. The MR601TEx gives an earlier response to TF5 fires than the MR601 due to its thermal circuit detecting the heat generated by this test of fire and the MR601TEx being 'enhanced'. For the same reason the MR601TEx will detect test fire TF1 (open wood cellulosic flaming fire) which is not normally detected by optical smoke detectors - demonstrating the detectors broader detection capability.

The MR601TEx does not respond to TF6 liquid (methylated spirit) which although having a rapidly rising temperature, does not generate any optical scattering. This shows that the High Performance Optical detector will not respond to hot air draughts without the presence of smoke.

6. INSTALLATION RECOMMENDATIONS

It is not recommended that the MR601TEx be installed in areas where it is likely to be regularly enhanced, since in this condition the detector is extra sensitive and there is a possibility of unwanted alarms from low ambient smoke levels.

The MR601TEx is designed to become enhanced by detecting a rapid temperature rise (>10°C) in air moving horizontally across the ceiling. Siting sensors in positions where air is being blown through the detector should therefore, be particularly avoided, eg, close to ceiling ducts or ceiling mounted industrial heaters; or areas of forced ventilation, such as ducts and under floor voids of computer suites.

Also, not recommended are areas open to the outdoors, such as cargo handling bays, or areas where the detector may become contaminated.

The MR601TEx is not recommended for use in applications where a heater jacket is required.

The MR601TEx is primarily aimed at benign environments.

7. CPD INFORMATION

CE

0832

Tyco Safety Products
Dunhams Lane
Letchworth SG6 1BE
UK

06

0832-CPD-0248

EN 54-7: 2000 + A1: 2002

Conventional Intrinsically Safe high performance photoelectric smoke detector with heat enhancement for use in fire detection and alarm systems in buildings

MR601TEx

Application & Design	01B-04-D12
Installation Instructions	01B-04-I3
Service Instructions	01B-04-S2

8. DETECTOR IDENTIFICATION

The detector is identified by the logo label, as shown in Fig. 9.

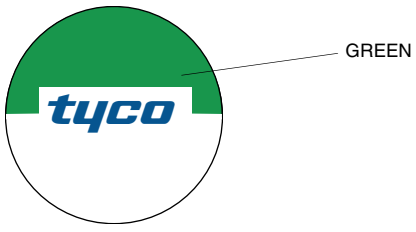


Fig. 9 Detector identification

9. ORDERING INFORMATION

MR601TEx Intrinsically Safe Enhanced Optical Smoke Detector:	516.054.011.Y
5BEx 5" Universal IS Base:	517.050.023

JM/jm

5th May 2010

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

ROSETTI MARINO | CROSSWIND

ITEM	Tag	950-SDZ-06202	: Smoke Detector - FZ-06 B-100 HVAC Air Intake	Dwg	123A90-DDL-SAF-DL-30027		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module	LD_B-100_Ext		
TASK	code	C10003053	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	COMM	Activity FTS	Discipline	Instrumental	Form FJ04S	Smoke Detection

LOOP DATA

Loop TAG	950-SDZ-06202			TSLD	123A90-DDL-IN-DG-40014 SHEET 288 REV. 1_A		
IO Type	Input Yes	Output Yes		Energy by transmitter	NA	Energy by system	Yes
Marshalling	B400-FGS-001	Terminal 07A-07B		Slot 03	Rack 01	Chanel 07	

LOOP TEST

1	Check earth isolation of the loop			OK
2	Connect loop to terminal			
3	Confirm Process Scale	Unit %	Min 0 % / Max 34 %	OK

LOOP RANGE		0%	25%	50%	75%	100%	
4	Physical value applied for test	Unit -					
5	Control System Display	Unit					

LOOP SERVICE

		Value	Trip	Gen Alarm	DCS Alarm	SOE	DCS display	
6	Threshold 1	34 %	NA	Yes	Yes	NA	OK	OK
7	Threshold 2							
8	Threshold 3							
9	Threshold 4							
10	Checking of line monitoring		Yes	Yes	Yes	NA	OK	OK
11	Checking of Maintenance Inhibition		No	No	No	No	OK	OK
12	Associated safety Level / bar		ESD-1D					OK
13	Associated outputs							

TESTING & MEASUREMENT INSTRUMENT USED

Type	Serial N.	Calibration Certificate	Validity
ELECTRIC CALIBRATOR FLUKE 725	4498694	7717/24	10/07/2025
SOLO A10S SMOKE AEROSOL	SOLO A10S-001		

LOOP DOCUMENTATION


14	Loop diagram is marked up and attached to this test sheet	OK
15	Cause and effect chart is highlighted accordingly	
16	Any defect is recorded for punch list issuance	OK


Comments:

Page 1/1	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM	RM COMM	CW
Name	Mohammed Barghouti	Giandonato Delmissier	John Mackillop
Date	2025-01-22	2025-01-22	2025-01-28
Signature	Digitaly signed by Mohammed Barghouti 2025-01-22T06:06:39.013Z	Digitaly signed by Giandonato Delmissier 2025-01-22T07:22:43.852Z	Digitaly signed by John Mackillop 2025-01-28T19:39:25.124Z

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 01

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

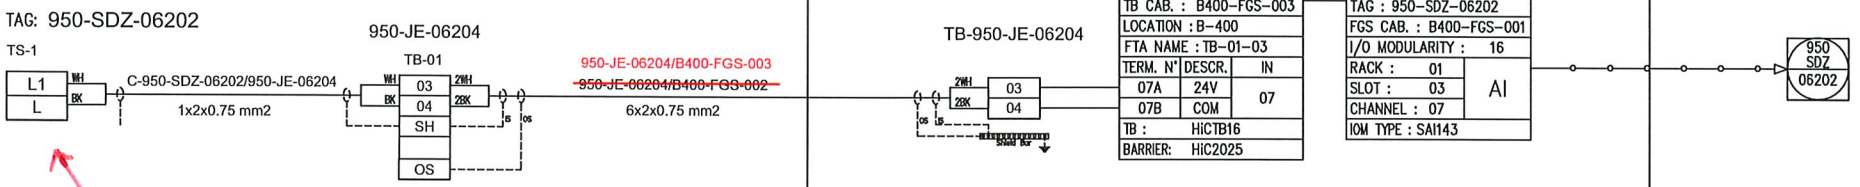

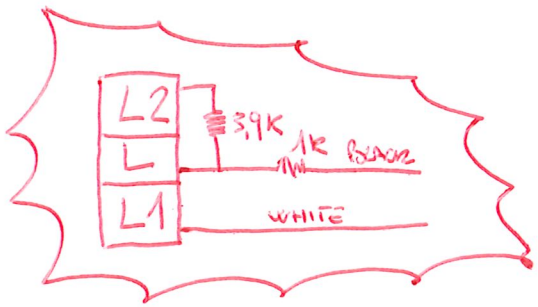

14/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	06/12/2024	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV: 1_A | DATE: 20/12/24 | SIGNATURE: C.Pilato
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSTRUMENT LOOP DIAGRAM
950-SDZ-06202
FZ-06 SMOKE DETECT. IN B-100 HVAC AIR INTAKE

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024
A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 288	REV. 01

File Name : 123A90-DDL-IN-DG-40014_REV.01



solo™
detectortesters

*A **single** testing system.*
*A **complete** range of testing tools.*





detectortesters
testing technology from No Climb

solo™ detectortesters

A complete range of test and maintenance equipment for smoke, heat and CO detectors.

Testing equipment must be proven to be safe for the engineer and the system, it needs to be cost-effective, versatile, portable, approved by all detector manufacturers and in compliance with international codes and standards.

The Solo range meets all of these requirements.

SMOKE DETECTOR TESTING



SIGNALING UL LISTED Fire Alarm Equipment 77TL Smoke Detector Accessory

Solo 330 Aerosol Dispenser

Codes and standards require functional tests to introduce (simulated) smoke through the detector vents and into the sensing chamber. The Solo 330 dispenser is the most popular device for achieving this, benefiting as it does, from a cup big enough for the great majority of detectors but still small enough not to be obstructive and unwieldy.

- UL Listed
- Approved by leading detector manufacturers
- Dispenser and patented diaphragm contain particles – conserves test gas / smoke
- Strong – to withstand rigours of daily use
- Spring-loaded mechanism – for effective, economic aerosol delivery
- Clear cup – enables view of the detector LED while testing
- Universal – suits most detectors
- Designed for use at height and at angles
- Interchangeable with all other tools on Solo poles
- Lifetime Warranty



Solo 330 for use with **Solo A3** & **C3** Aerosols

Solo 332 is available for larger diameter detectors.

Solo 332
Aerosol Dispenser



> "...the testing system is high quality and is very well liked by our technicians and customers alike. The use of this product helps TSS fulfill its goal as the premiere fire alarm company in NYC"
>
> John Bonanno
> **TSS Integrated Systems**

DETECTOR TESTING AEROSOLS

Solo A10S Smoke Aerosol
Non-Flammable Solution

The new HFC-Free smoke aerosol for the functional testing of smoke detectors. Like all Solo products, Solo A10S is approved by leading detector manufacturers and offers the reliability and quality expected by the industry.

- **Simple** to use
- **Fast** activation – via Solo 330 dispenser
- **Rapid** clearing
- **Compatible** with leading detector brands



Choosing the right aerosol

Chemicals used in detector test equipment need to be compatible with the plastics from which the detectors are manufactured. Not all test aerosols offer this compatibility which can lead to problems such as stress cracking in detectors, residue build up, damage to components and harm to the environment. Solo aerosols are the most thoroughly researched solutions – approved by leading detector manufacturers, third parties and fire engineers.

- **UL & ULC Certified**
- **Approved** by world leading detector manufacturers
- **Non-flammable** (same as Solo A3)
- **HFC-Free** – fully compliant with latest regulations: Protecting the global environment
- **Silicone Free** – prevents detector contamination: Protecting the local environment

Solo A10S is available in the standard 250ml can.




Ordering information	Product Code:
Solo A10S 250ml	SOLO A10S-001
Sold in multiples of 12	

detectortesters

www.solo-tester.com


TELESCOPIC ACCESS POLES

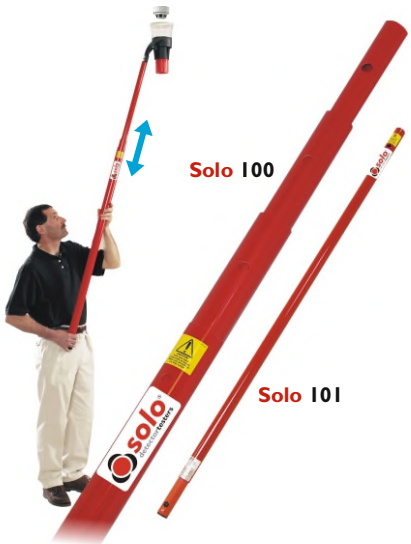

Solo 100/101/108 Telescopic Access Poles

The core element of the Solo range is the telescopic and extension access poles which are extremely lightweight and quickly extend to provide access to detectors up to 9 metres*.

- Light – easy to use at height, on-site, day after day
- Non-whip – even at height
- Certified non-conductive – protecting both the engineer and overhead live equipment from inadvertent shorts
- Available in one, two or four telescopic sections
- Lifetime Warranty

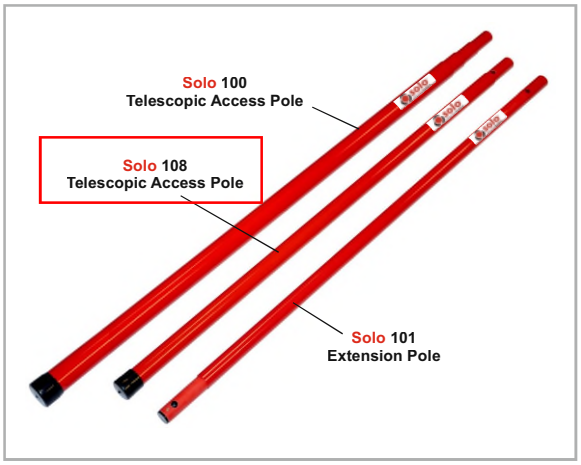

*See Product Selector for details on height guide.

MR601TEx INTRINSICALLY SAFE ENHANCED OPTICAL SMOKE DETECTOR

PRODUCT APPLICATION AND DESIGN INFORMATION

1. INTRODUCTION

The MR601TEx Intrinsically Safe High Performance Optical Smoke Detector forms part of the M600Ex series of plug in detectors for ceiling mounting. The detector plugs into the 5BEx 5" Universal IS Base and is intended for two-wire operation on the majority of the control equipment currently manufactured by the company. The Intrinsically Safe High Performance Optical detector is available in one sensitivity setting only.

2. INTRINSIC SAFETY

The detectors are for use in potentially explosive gas and dust atmospheres (zone 0 gas, zone 20 dust).

The detectors are designed to comply with EN/IEC 60079-0:2006, EN/IEC 60079-11:2007 and EN/IEC61241-11:2006 for Intrinsically Safe apparatus. They are certified:

ATEX code:	**II 1 GD** CE 1180
Certificate:	**BAS01ATEX1134X**
Gas/Dust code:	**Ex ia IIC T5** **Ex iaD 20 T100°C**
IECEx Certificate:	**IECEx BAS 07.0056X**

These detectors are designed and manufactured to protect against other hazards as defined in paragraph 1.2.7 of Annex II of the ATEX Directive 94/9/EC.

2.1 DETECTOR USE

It is recommended that the detector is used in conjunction with a suitable isolator or shunt diode safety barrier in a certified Intrinsically Safe system, ie, System 620.

2.2 SPECIAL CONDITIONS OF SAFE USE

The apparatus has a plastic enclosure which constitutes a potential electrostatic hazard. The enclosure must be cleaned only with a damp cloth.

3. OPERATING PRINCIPLE

The MR601TEx operates by sensing the optical scatter from smoke particles generated in a fire. While the optical scatter detector can give good detection performance for the majority of fires, some fast burning fires produce little visible smoke and some produce very black smoke, neither of which are easily detected by the optical scatter detector. (Such fires are represented in EN54-7 by Polyurethane and Heptane type fires respectively). These fires do, however, produce high heat outputs with an associated rise in air temperature.

The detector has been designed to offer improved detection of such fires, by detecting the rapid rate-of-rise of air temperature and under these conditions, increasing the smoke detection sensitivity. This gives an earlier detection of such fires and a broader detection capability than a standard detector.

The MR601TEx detector has two sensing systems as follows:

- An optical chamber with associated electronics to measure the presence of smoke by light scatter.
- A thermistor with its associated electronics to detect the presence of hot air draughts or high temperatures.

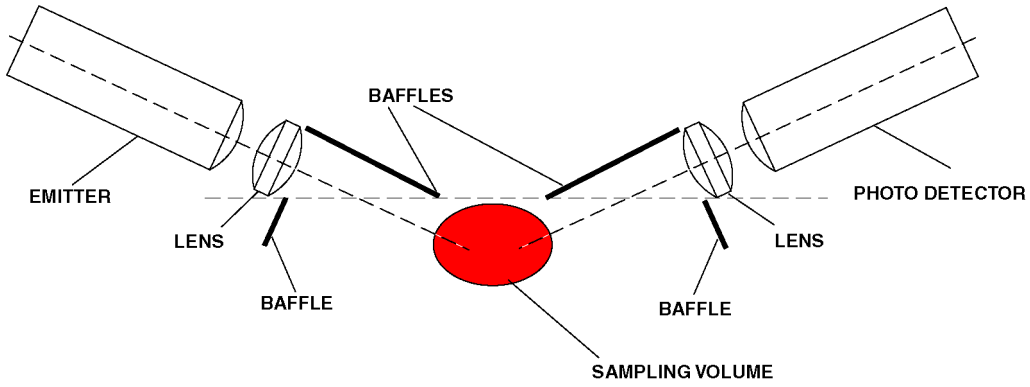


Fig. 1 Optical System Schematic

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

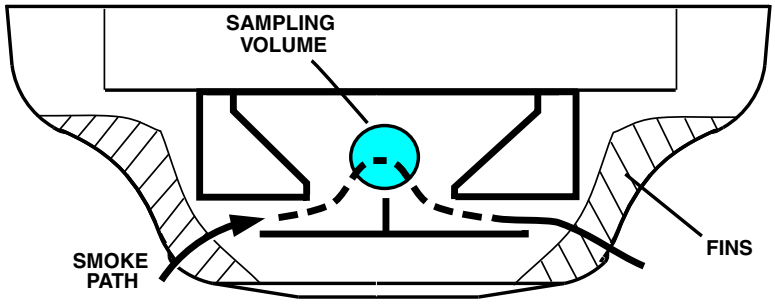


Fig. 2 Measuring Chamber Showing Smoke Flow Path

3.1 OPTICAL SYSTEM

The MR601TEx detects visible particles produced in fires by using the light scattering properties of the particles. The detector uses the optical arrangement shown diagrammatically in Fig. 1.

The optical system consists of an infra-red emitter and receiver, with a lens in front of each, so arranged that their optical axes cross in the sampling volume. The emitter, with its lens, produces a narrow beam of light which is prevented from reaching the receiver by the baffles. When smoke is present in the sampling volume a proportion of the light is scattered, some of which reaches the receiver. For a given type of smoke, the light reaching the photodetector is proportional to the smoke density. The amplified output from the sensor can be used to activate an alarm circuit at a predetermined threshold.

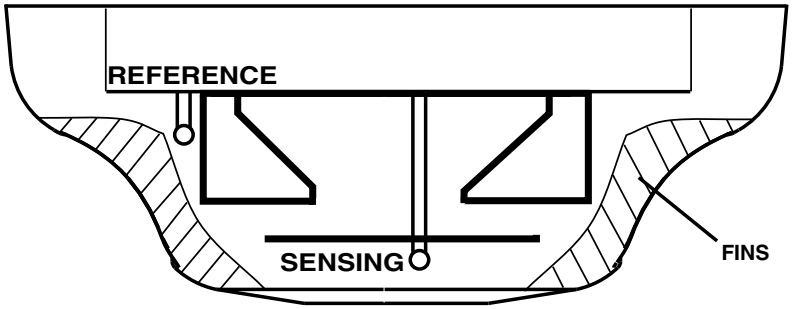


Fig. 3 Thermal Measuring System

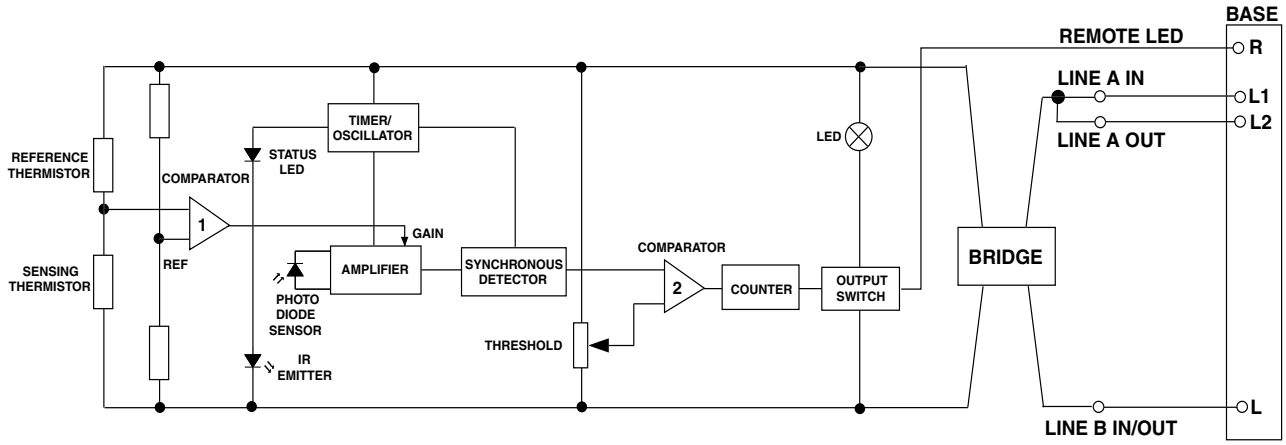


Fig. 4 Block Schematic of Detector

3.2 FEATURES OF MEASURING CHAMBER

The MR601TEx uses vertical chevrons to exclude ambient light.

Smoke incident on the detector is channelled into the detector by the outer cover fins (Fig. 2) and passes through the vertical chevrons. The smoke is deflected into the optical chamber and through the sampling volume before passing out the other side of the detector.

The emitter (Fig. 1) is a GaAlAs solid state type operating in the near infra-red (880nm peak), while the detector is a matched silicon photodiode. These devices, together with their associated lenses, are held in place by the chamber mouldings. The design of the optical system is such that the presence of small insects such as thrips, should not cause false alarms.

3.3 THERMAL MEASURING SYSTEM

Refer to Fig. 3.

This is designed to detect the presence of horizontally moving hot air draughts moving across the ceiling which occur in a fast burning fire.

The measuring system consists of two fast responding negative temperature thermistors. A sensing thermistor is located above the labyrinth under the cover in the airstream and will detect any sudden changes in the air temperature or draughts of hot air moving across the ceiling. The second thermistor is located out of the airflow within the smoke labyrinth and has a longer time constant and is used as a temperature reference to compare the sensing thermistor against. At a given temperature differential between the two thermistors, the comparator will switch and increase the gain of the amplifier, thereby increasing the sensitivity of the sensor. Fins located on the top of the labyrinth are designed to increase air turbulence and the efficiency of the sensing thermistor.

3.4 CIRCUIT OPERATIONS

A simplified block schematic of the detector is given in Fig. 4.

The emitter is subjected to a pulse stream only every 10s in order to reduce the quiescent current. The pulse signal received by the photodiode is fed to a high-gain amplifier. If smoke is present, the pulse signal received varies in proportion to the smoke density.

The amplifier output is fed via an integrator, the output of which is compared to a preset threshold level. Sophisticated synchronous detection techniques are used to reduce the effects of noise and spurious transients.

The gain of the front end amplifier is controlled by the thermistor bridge circuit. When the temperature differential between the two thermistors exceeds a certain value, the amplifier gain increases. Under these conditions the High Performance Optical detector is more sensitive to the presence of smoke and is said to be in 'Enhanced Mode'.

When the detector is in the 'Enhanced Mode', the detector will only alarm if a smoke signal is present. The presence of rising temperature alone cannot cause an alarm.

If the signal amplitude exceeds a threshold level, then the emitter samples the smoke every two seconds. The sample period remains at two seconds if the signal is above the threshold. When the counter has counted three consecutive pulses above the threshold, the output stage is latched into the alarm condition. If however, the amplitude of the second or third pulse is below the threshold, then the pulse period reverts to 10 seconds and the counter resets. The switching of the output stage lights the alarm LED and provides drive for the remote LED indicator.

The critical front end of the circuit is run off a 12V regulator to make it independent of supply voltage.

The detector is polarity conscious.

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

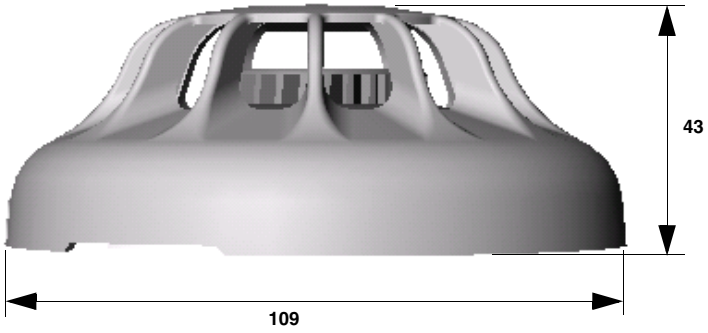


Fig. 5 Overall Dimensions of MR601TEx

3.5 WIRING

Loop cabling is connected to base terminals as follows:

L	-VE
L1	+VE IN
L2	+VE OUT
R	Remote LED Drive

4. MECHANICAL CONSTRUCTION

The major components of the detector are:

- Body Assembly
- Printed Circuit
- Optical Chamber
- Optical Chamber Cover
- Thermistor
- Light Pipe
- Outer Cover

4.1 ASSEMBLY

The body assembly consists of a plastic moulding which has four embedded detector contacts which align with contacts in the 5BEx base. The moulding incorporates securing features to retain the detector in the base.

The PCB is soldered to the body contacts. These contacts act as a mechanical fixture during assembly and provide electrical contact between the contacts and the PCB. The PCB is then potted.

The chamber cover is clipped to the body over the optical chamber ensuring the thermistor protrudes through the cover. The light pipe is slotted into the chamber cover. Finally, the outer cover is clipped to the body.



Fig. 6 MR601TEx Enhanced Optical Smoke Detector with 5BEx 5" Base

4.2 TEST AND FINAL ASSEMBLY

The detectors are fully functionally tested and their sensitivities set in a smoke tunnel to ensure correct calibration. The sealing ring and labels are then fitted to complete detector assembly.

5. TECHNICAL SPECIFICATION

5.1 MECHANICAL

Dimensions

The dimensions of the MR601TEx detector are shown in Fig. 5.

Materials

Body and cover:	FR110 'BAYBLEND' Fire Resistant

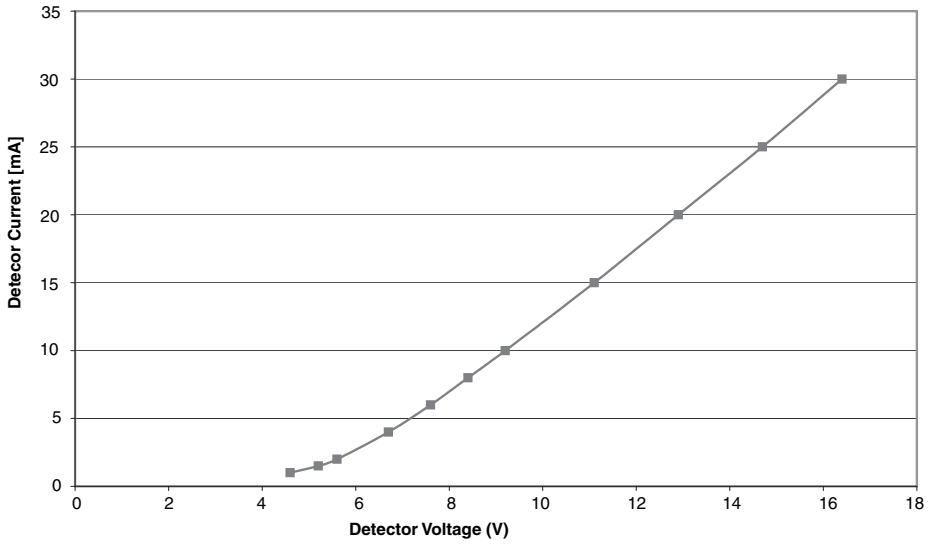


Fig. 7 Alarm Load Presented to the Controller

Weight

Detector:	0.128kg
Detector + base:	0.174kg

5.2 ENVIRONMENTAL

Operating Temperature:	-20°C to +70°C (please see note below).
Storage Temperature:	-25°C to +80°C

Note:

1) ***The operating temperatures quoted exceed the ATEX Certification limits.***
2) *Operation below 0°C is not recommended unless steps are taken to eliminate condensation and hence ice formation on the detector.*

Relative Humidity:	95% non-condensing
Shock:) Vibration:) Impact:) Corrosion:)	To EN54-7

5.3 ELECTROMAGNETIC COMPATIBILITY

The detector complies with the following:

Product family standard EN50130-4 in respect of Conducted Disturbances, Radiated Immunity, Electrostatic Discharge, Fast Transients and Slow High Energy

EN 61000-6-3 for Emissions

5.4 ELECTRICAL CHARACTERISTICS

The alarm load presented to the controller is shown in Fig. 7.

The following characteristics shown in Table 1 are taken at 25°C with a supply voltage of 20V unless otherwise specified.

Characteristics	Min.	Typ.	Max.	Unit
Operating Voltage (d.c.)	16	20	28	V
Average Quiescent Current	90		110	µA
Switch-on-Surge			130	µA
Stabilisation Time			60	sec
Alarm Current	See Fig. 6			mA
Holding Voltage			5	V
Holding Current			1	mA
Reset Time		2	5	sec
Remote LED Drive	Remote LED via 3.4k			

Table. 1 Electrical Characteristics

Intrinsic Safety Rating:

Maximum Voltage for safety (U_i):	28V
Maximum Current for Safety (I_i):	93mA
Maximum Power Input (P_i):	650mW
Equivalent Inductance (L_i):	0
Equivalent Capacitance (C_i):	0

5.5 PERFORMANCE CHARACTERISTICS

The fundamental parameter used to define the sensitivity of an optical smoke detector is the level of smoke which will just produce an alarm under 'ideal' conditions. This parameter, known as the response threshold value, is normally measured in a smoke tunnel and is defined in terms of the obscuration produced by the smoke over a one metre path. The response threshold value is normally given in dB/m, (or % per m).

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

Interpretation of response threshold value is somewhat complicated by the fact that the measurement is given in terms of obscuration, whereas the detector works by scattering from the smoke particles. The response threshold (m) value will therefore, depend on the colour of the smoke. Black smokes give less scattering than light smokes for given values of obscuration as shown in Fig. 8.

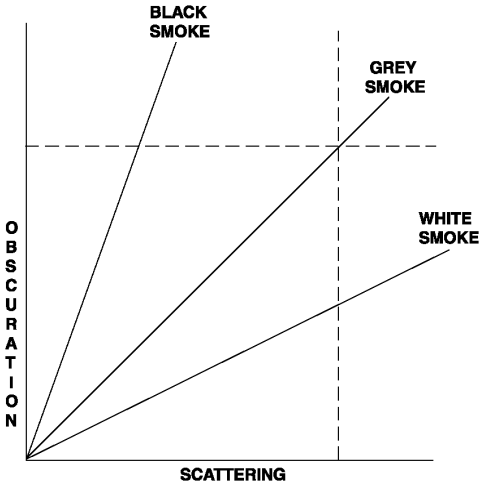


Fig. 8 Response Threshold vs Smoke Colour

Sensitivities are invariably specified for 'grey' smokes as produced by typical smouldering fires. Values for the MR601TEx are given below.

5.5.1 RESPONSE TO RATE OF CHANGE OF TEMPERATURE

The detector will not be enhanced by slow rates of change of temperature, or by cold air draughts moving across the ceiling creating negative rates of change of temperature. The detector is designed to detect sudden horizontal draughts of hot air produced by fast burning fires. The enhancement switching point has been set to allow the detection of TF1 type fires.

Normal response threshold = 0.19 dB/m, 2.7%/m typical.

Enhanced mode threshold = 0.08 dB/m, 1.1%/m typical.

5.6 RESPONSE TO FIRE TESTS

The response of an optical scatter detector to a fire will depend to a large extent on the colour of the smoke produced in the fire. However, other factors such as the detector smoke entry characteristics, the development of the fire and the thermal lift produced by the fire are important. In order to evaluate the response under realistic conditions, detectors are subjected to test fires which cover a range of fire types. These tests are defined in EN54 Pt 7. The MR601TEx passes the following Fire Tests:

TF1	open cellulosic (wood-flaming)
TF2	smouldering pyrolysis
TF3	glowing smouldering (cotton)
TF4	open plastics (polyurethane foam)
TF5	liquid (n-heptane)

Table 2: Response to Fire Tests

Note: TF2 to TF5 are mandatory test fires required to meet EN54 Pt 7.

The MR601TEx is designed to respond to the mandatory tests TF2 to TF5 as required by BS5445 Pt 7. The MR601TEx gives an earlier response to TF5 fires than the MR601 due to its thermal circuit detecting the heat generated by this test of fire and the MR601TEx being 'enhanced'. For the same reason the MR601TEx will detect test fire TF1 (open wood cellulosic flaming fire) which is not normally detected by optical smoke detectors - demonstrating the detectors broader detection capability.

The MR601TEx does not respond to TF6 liquid (methylated spirit) which although having a rapidly rising temperature, does not generate any optical scattering. This shows that the High Performance Optical detector will not respond to hot air draughts without the presence of smoke.

6. INSTALLATION RECOMMENDATIONS

It is not recommended that the MR601TEx be installed in areas where it is likely to be regularly enhanced, since in this condition the detector is extra sensitive and there is a possibility of unwanted alarms from low ambient smoke levels.

The MR601TEx is designed to become enhanced by detecting a rapid temperature rise (>10°C) in air moving horizontally across the ceiling. Siting sensors in positions where air is being blown through the detector should therefore, be particularly avoided, eg, close to ceiling ducts or ceiling mounted industrial heaters; or areas of forced ventilation, such as ducts and under floor voids of computer suites.

Also, not recommended are areas open to the outdoors, such as cargo handling bays, or areas where the detector may become contaminated.

The MR601TEx is not recommended for use in applications where a heater jacket is required.

The MR601TEx is primarily aimed at benign environments.

7. CPD INFORMATION

CE

0832

Tyco Safety Products
Dunhams Lane
Letchworth SG6 1BE
UK

06

0832-CPD-0248

EN 54-7: 2000 + A1: 2002

Conventional Intrinsically Safe high performance photoelectric smoke detector with heat enhancement for use in fire detection and alarm systems in buildings

MR601TEx

Application & Design	01B-04-D12
Installation Instructions	01B-04-I3
Service Instructions	01B-04-S2

8. DETECTOR IDENTIFICATION

The detector is identified by the logo label, as shown in Fig. 9.

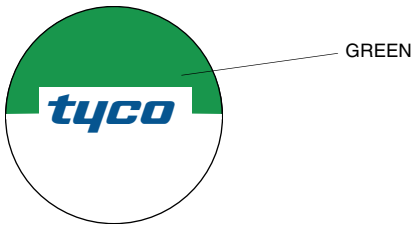


Fig. 9 Detector identification

9. ORDERING INFORMATION

MR601TEx Intrinsically Safe Enhanced Optical Smoke Detector:	516.054.011.Y
5BEx 5" Universal IS Base:	517.050.023

JM/jm

5th May 2010

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	950-SDZ-06201	: Smoke Detector - FZ-06 B-100 HVAC Air Intake	Dwg	123A90-DDL-SAF-DL-30027		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module	LD_B-100_Ext		
TASK	code	C10003054	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	COMM	Activity FTS	Discipline	Instrumental	Form FJ04S	Smoke Detection

LOOP DATA

Loop TAG	950-SDZ-06201			TSLD	123A90-DDL-IN-DG-40014 SHEET 287 REV. 1_A		
IO Type	Input Yes	Output Yes		Energy by transmitter	NA	Energy by system	Yes
Marshalling	B400-FGS-001	Terminal 07A-07B		Slot 01	Rack 01	Chanel 07	

LOOP TEST

1	Check earth isolation of the loop			OK
2	Connect loop to terminal			OK
3	Confirm Process Scale	Unit %	Min 0 % / Max 34 %	OK

LOOP RANGE		0%	25%	50%	75%	100%	
4	Physical value applied for test	Unit					
5	Control System Display	Unit					

LOOP SERVICE

		Value	Trip	Gen Alarm	DCS Alarm	SOE	DCS display	
6	Threshold 1	34 %	NA	Yes	Yes	NA	OK	OK
7	Threshold 2							
8	Threshold 3							
9	Threshold 4							
10	Checking of line monitoring		Yes	Yes	Yes	NA	OK	OK
11	Checking of Maintenance Inhibition		No	No	No	No	OK	OK
12	Associated safety Level / bar		ESD-1D					OK
13	Associated outputs							

TESTING & MEASUREMENT INSTRUMENT USED

Type	Serial N.	Calibration Certificate	Validity
ELECTRIC CALIBRATOR FLUKE 725	4498694	7717/24	10/07/2025
SOLO A10S SMOKE AEROSOL	SOLO A10S-001		

LOOP DOCUMENTATION


14	Loop diagram is marked up and attached to this test sheet	OK
15	Cause and effect chart is highlighted accordingly	
16	Any defect is recorded for punch list issuance	OK


Comments:

Page 1/1	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM	RM COMM	CW
Name	Mohammed Barghouti	Giandonato Delmissier	John Mackillop
Date	2025-01-22	2025-01-22	2025-01-28
Signature	PROVERLIS Digitaly signed by Mohammed Barghouti 2025-01-22T06:06:51.413Z	PROVERLIS Digitaly signed by Giandonato Delmissier 2025-01-22T07:23:22.003Z	PROVERLIS Digitaly signed by John Mackillop 2025-01-28T19:39:49.204Z

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 01

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

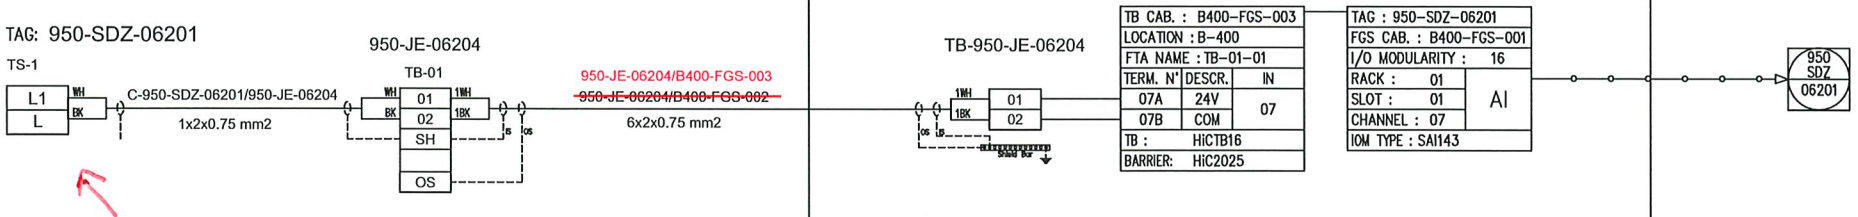

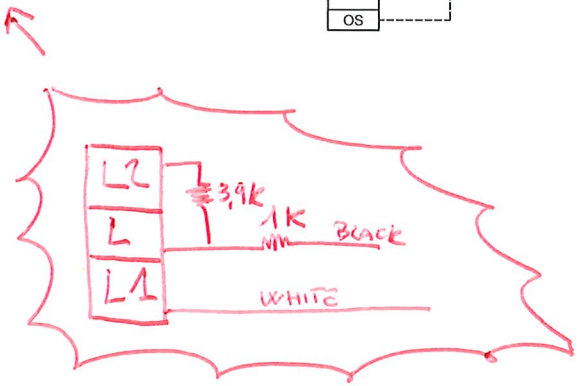

14/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	06/12/2024	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV: 1_A | DATE: 20/12/24 | SIGNATURE: C.Pilato
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSTRUMENT LOOP DIAGRAM
950-SDZ-06201
FZ-06 SMOKE DETECT. IN B-100 HVAC AIR INTAKE

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024

A3	DRAWING NO.	SHEET	REV.
	123A90-DDL-IN-DG-40014	287	01

File Name : 123A90-DDL-IN-DG-40014_REV.01



solo™
detectortesters

*A **single** testing system.*
*A **complete** range of testing tools.*





detectortesters
testing technology from No Climb

solo™ detectortesters

A complete range of test and maintenance equipment for smoke, heat and CO detectors.

Testing equipment must be proven to be safe for the engineer and the system, it needs to be cost-effective, versatile, portable, approved by all detector manufacturers and in compliance with international codes and standards.

The Solo range meets all of these requirements.

SMOKE DETECTOR TESTING



SIGNALING UL LISTED Fire Alarm Equipment 77TL Smoke Detector Accessory

Solo 330 Aerosol Dispenser

Codes and standards require functional tests to introduce (simulated) smoke through the detector vents and into the sensing chamber. The Solo 330 dispenser is the most popular device for achieving this, benefiting as it does, from a cup big enough for the great majority of detectors but still small enough not to be obstructive and unwieldy.

- UL Listed
- Approved by leading detector manufacturers
- Dispenser and patented diaphragm contain particles – conserves test gas / smoke
- Strong – to withstand rigours of daily use
- Spring-loaded mechanism – for effective, economic aerosol delivery
- Clear cup – enables view of the detector LED while testing
- Universal – suits most detectors
- Designed for use at height and at angles
- Interchangeable with all other tools on Solo poles
- Lifetime Warranty



Solo 330 for use with **Solo A3** & **C3** Aerosols

Solo 332 is available for larger diameter detectors.

Solo 332
Aerosol Dispenser



> "...the testing system is high quality and is very well liked by our technicians and customers alike. The use of this product helps TSS fulfill its goal as the premiere fire alarm company in NYC"
>
> John Bonanno
> **TSS Integrated Systems**

DETECTOR TESTING AEROSOLS

Solo A10S Smoke Aerosol
Non-Flammable Solution

The new HFC-Free smoke aerosol for the functional testing of smoke detectors. Like all Solo products, Solo A10S is approved by leading detector manufacturers and offers the reliability and quality expected by the industry.

- **Simple** to use
- **Fast** activation – via Solo 330 dispenser
- **Rapid** clearing
- **Compatible** with leading detector brands



Choosing the right aerosol

Chemicals used in detector test equipment need to be compatible with the plastics from which the detectors are manufactured. Not all test aerosols offer this compatibility which can lead to problems such as stress cracking in detectors, residue build up, damage to components and harm to the environment. Solo aerosols are the most thoroughly researched solutions – approved by leading detector manufacturers, third parties and fire engineers.

- **UL & ULC Certified**
- **Approved** by world leading detector manufacturers
- **Non-flammable** (same as Solo A3)
- **HFC-Free** – fully compliant with latest regulations: Protecting the global environment
- **Silicone Free** – prevents detector contamination: Protecting the local environment

Solo A10S is available in the standard 250ml can.




Ordering information	Product Code:
Solo A10S 250ml	SOLO A10S-001
Sold in multiples of 12	

detectortesters

www.solo-tester.com


TELESCOPIC ACCESS POLES

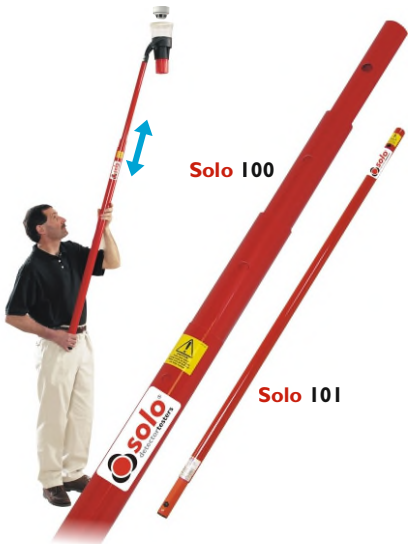

Solo 100/101/108 Telescopic Access Poles

The core element of the Solo range is the telescopic and extension access poles which are extremely lightweight and quickly extend to provide access to detectors up to 9 metres*.

- Light – easy to use at height, on-site, day after day
- Non-whip – even at height
- Certified non-conductive – protecting both the engineer and overhead live equipment from inadvertent shorts
- Available in one, two or four telescopic sections
- Lifetime Warranty

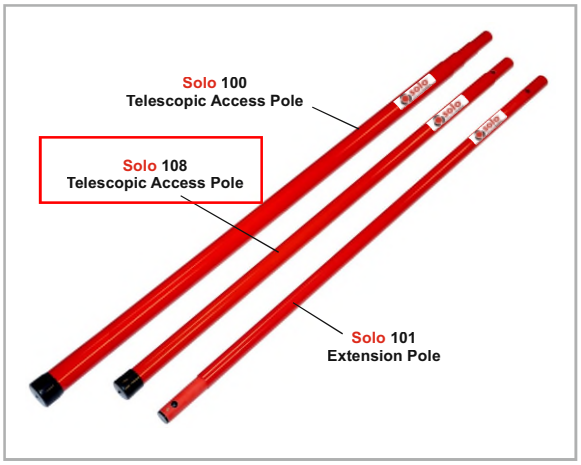

*See Product Selector for details on height guide.

MR601TEx INTRINSICALLY SAFE ENHANCED OPTICAL SMOKE DETECTOR

PRODUCT APPLICATION AND DESIGN INFORMATION

1. INTRODUCTION

The MR601TEx Intrinsically Safe High Performance Optical Smoke Detector forms part of the M600Ex series of plug in detectors for ceiling mounting. The detector plugs into the 5BEx 5" Universal IS Base and is intended for two-wire operation on the majority of the control equipment currently manufactured by the company. The Intrinsically Safe High Performance Optical detector is available in one sensitivity setting only.

2. INTRINSIC SAFETY

The detectors are for use in potentially explosive gas and dust atmospheres (zone 0 gas, zone 20 dust).

The detectors are designed to comply with EN/IEC 60079-0:2006, EN/IEC 60079-11:2007 and EN/IEC61241-11:2006 for Intrinsically Safe apparatus. They are certified:

ATEX code:	**II 1 GD** CE 1180
Certificate:	**BAS01ATEX1134X**
Gas/Dust code:	**Ex ia IIC T5** **Ex iaD 20 T100°C**
IECEx Certificate:	**IECEx BAS 07.0056X**

These detectors are designed and manufactured to protect against other hazards as defined in paragraph 1.2.7 of Annex II of the ATEX Directive 94/9/EC.

2.1 DETECTOR USE

It is recommended that the detector is used in conjunction with a suitable isolator or shunt diode safety barrier in a certified Intrinsically Safe system, ie, System 620.

2.2 SPECIAL CONDITIONS OF SAFE USE

The apparatus has a plastic enclosure which constitutes a potential electrostatic hazard. The enclosure must be cleaned only with a damp cloth.

3. OPERATING PRINCIPLE

The MR601TEx operates by sensing the optical scatter from smoke particles generated in a fire. While the optical scatter detector can give good detection performance for the majority of fires, some fast burning fires produce little visible smoke and some produce very black smoke, neither of which are easily detected by the optical scatter detector. (Such fires are represented in EN54-7 by Polyurethane and Heptane type fires respectively). These fires do, however, produce high heat outputs with an associated rise in air temperature.

The detector has been designed to offer improved detection of such fires, by detecting the rapid rate-of-rise of air temperature and under these conditions, increasing the smoke detection sensitivity. This gives an earlier detection of such fires and a broader detection capability than a standard detector.

The MR601TEx detector has two sensing systems as follows:

- An optical chamber with associated electronics to measure the presence of smoke by light scatter.
- A thermistor with its associated electronics to detect the presence of hot air draughts or high temperatures.

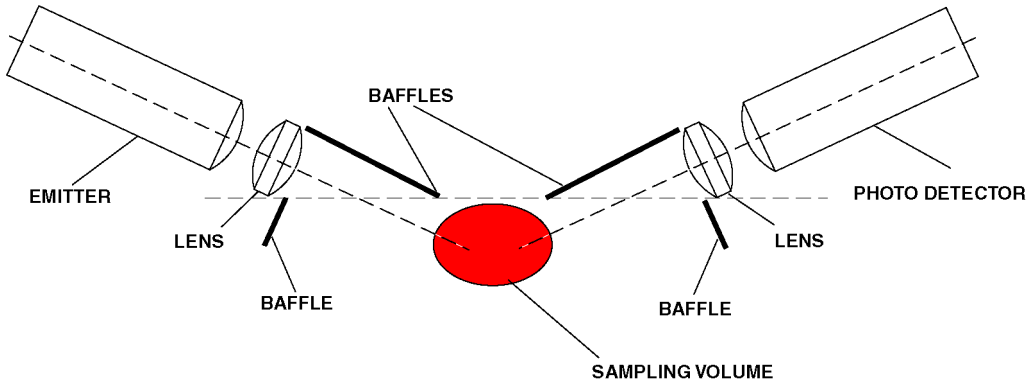


Fig. 1 Optical System Schematic

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

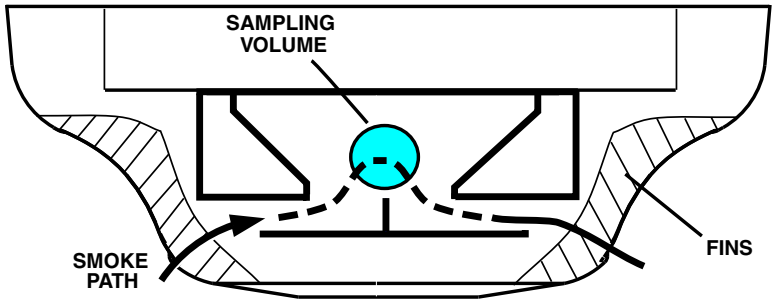


Fig. 2 Measuring Chamber Showing Smoke Flow Path

3.1 OPTICAL SYSTEM

The MR601TEx detects visible particles produced in fires by using the light scattering properties of the particles. The detector uses the optical arrangement shown diagrammatically in Fig. 1.

The optical system consists of an infra-red emitter and receiver, with a lens in front of each, so arranged that their optical axes cross in the sampling volume. The emitter, with its lens, produces a narrow beam of light which is prevented from reaching the receiver by the baffles. When smoke is present in the sampling volume a proportion of the light is scattered, some of which reaches the receiver. For a given type of smoke, the light reaching the photodetector is proportional to the smoke density. The amplified output from the sensor can be used to activate an alarm circuit at a predetermined threshold.

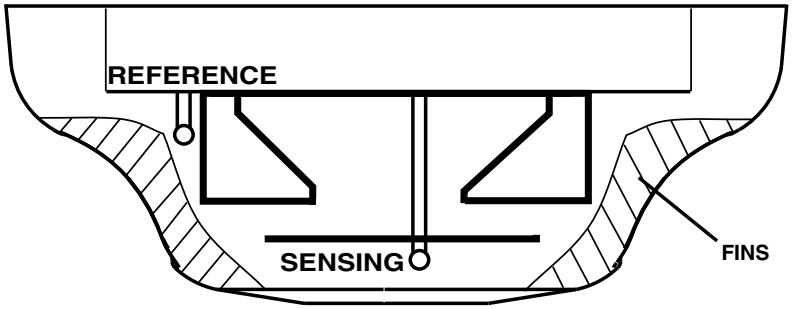


Fig. 3 Thermal Measuring System

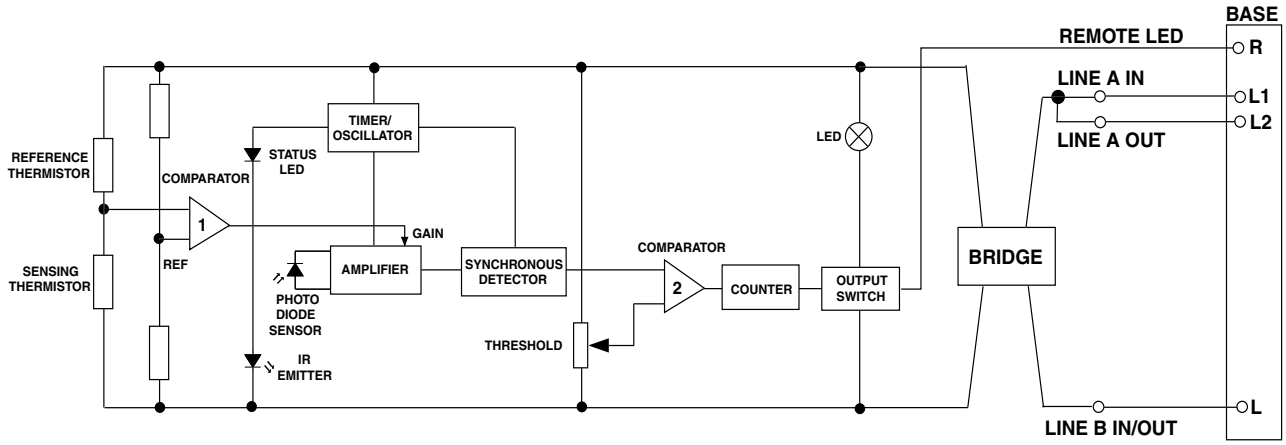


Fig. 4 Block Schematic of Detector

3.2 FEATURES OF MEASURING CHAMBER

The MR601TEx uses vertical chevrons to exclude ambient light.

Smoke incident on the detector is channelled into the detector by the outer cover fins (Fig. 2) and passes through the vertical chevrons. The smoke is deflected into the optical chamber and through the sampling volume before passing out the other side of the detector.

The emitter (Fig. 1) is a GaAlAs solid state type operating in the near infra-red (880nm peak), while the detector is a matched silicon photodiode. These devices, together with their associated lenses, are held in place by the chamber mouldings. The design of the optical system is such that the presence of small insects such as thrips, should not cause false alarms.

3.3 THERMAL MEASURING SYSTEM

Refer to Fig. 3.

This is designed to detect the presence of horizontally moving hot air draughts moving across the ceiling which occur in a fast burning fire.

The measuring system consists of two fast responding negative temperature thermistors. A sensing thermistor is located above the labyrinth under the cover in the airstream and will detect any sudden changes in the air temperature or draughts of hot air moving across the ceiling. The second thermistor is located out of the airflow within the smoke labyrinth and has a longer time constant and is used as a temperature reference to compare the sensing thermistor against. At a given temperature differential between the two thermistors, the comparator will switch and increase the gain of the amplifier, thereby increasing the sensitivity of the sensor. Fins located on the top of the labyrinth are designed to increase air turbulence and the efficiency of the sensing thermistor.

3.4 CIRCUIT OPERATIONS

A simplified block schematic of the detector is given in Fig. 4.

The emitter is subjected to a pulse stream only every 10s in order to reduce the quiescent current. The pulse signal received by the photodiode is fed to a high-gain amplifier. If smoke is present, the pulse signal received varies in proportion to the smoke density.

The amplifier output is fed via an integrator, the output of which is compared to a preset threshold level. Sophisticated synchronous detection techniques are used to reduce the effects of noise and spurious transients.

The gain of the front end amplifier is controlled by the thermistor bridge circuit. When the temperature differential between the two thermistors exceeds a certain value, the amplifier gain increases. Under these conditions the High Performance Optical detector is more sensitive to the presence of smoke and is said to be in 'Enhanced Mode'.

When the detector is in the 'Enhanced Mode', the detector will only alarm if a smoke signal is present. The presence of rising temperature alone cannot cause an alarm.

If the signal amplitude exceeds a threshold level, then the emitter samples the smoke every two seconds. The sample period remains at two seconds if the signal is above the threshold. When the counter has counted three consecutive pulses above the threshold, the output stage is latched into the alarm condition. If however, the amplitude of the second or third pulse is below the threshold, then the pulse period reverts to 10 seconds and the counter resets. The switching of the output stage lights the alarm LED and provides drive for the remote LED indicator.

The critical front end of the circuit is run off a 12V regulator to make it independent of supply voltage.

The detector is polarity conscious.

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

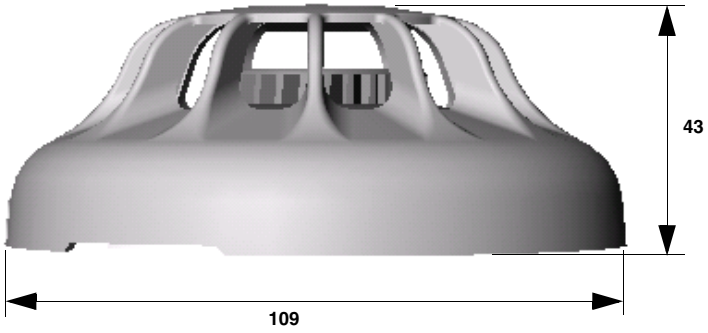


Fig. 5 Overall Dimensions of MR601TEx

3.5 WIRING

Loop cabling is connected to base terminals as follows:

L	-VE
L1	+VE IN
L2	+VE OUT
R	Remote LED Drive

4. MECHANICAL CONSTRUCTION

The major components of the detector are:

- Body Assembly
- Printed Circuit
- Optical Chamber
- Optical Chamber Cover
- Thermistor
- Light Pipe
- Outer Cover

4.1 ASSEMBLY

The body assembly consists of a plastic moulding which has four embedded detector contacts which align with contacts in the 5BEx base. The moulding incorporates securing features to retain the detector in the base.

The PCB is soldered to the body contacts. These contacts act as a mechanical fixture during assembly and provide electrical contact between the contacts and the PCB. The PCB is then potted.

The chamber cover is clipped to the body over the optical chamber ensuring the thermistor protrudes through the cover. The light pipe is slotted into the chamber cover. Finally, the outer cover is clipped to the body.



Fig. 6 MR601TEx Enhanced Optical Smoke Detector with 5BEx 5" Base

4.2 TEST AND FINAL ASSEMBLY

The detectors are fully functionally tested and their sensitivities set in a smoke tunnel to ensure correct calibration. The sealing ring and labels are then fitted to complete detector assembly.

5. TECHNICAL SPECIFICATION

5.1 MECHANICAL

Dimensions

The dimensions of the MR601TEx detector are shown in Fig. 5.

Materials

Body and cover:	FR110 'BAYBLEND' Fire Resistant

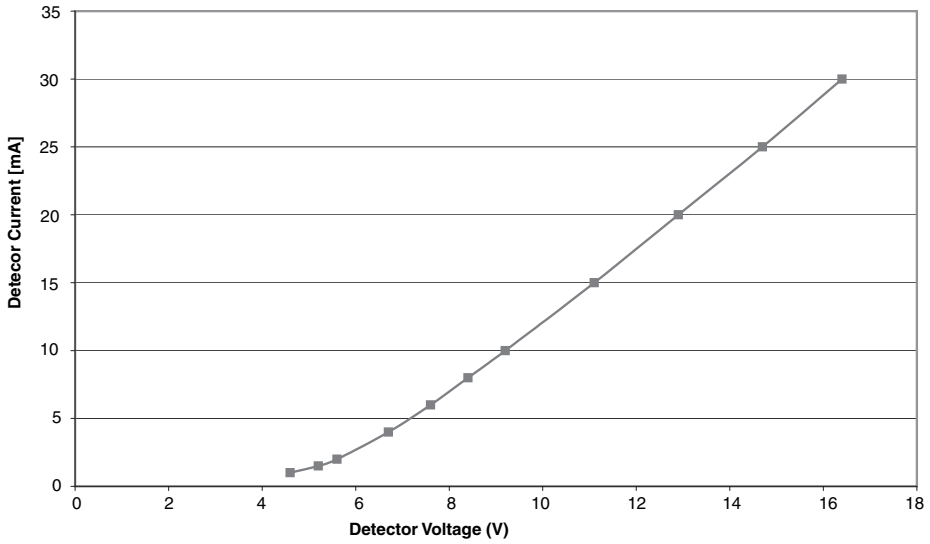


Fig. 7 Alarm Load Presented to the Controller

Weight

Detector:	0.128kg
Detector + base:	0.174kg

5.2 ENVIRONMENTAL

Operating Temperature:	-20°C to +70°C (please see note below).
Storage Temperature:	-25°C to +80°C

Note:

1) ***The operating temperatures quoted exceed the ATEX Certification limits.***
2) *Operation below 0°C is not recommended unless steps are taken to eliminate condensation and hence ice formation on the detector.*

Relative Humidity:	95% non-condensing
Shock:) Vibration:) Impact:) Corrosion:)	To EN54-7

5.3 ELECTROMAGNETIC COMPATIBILITY

The detector complies with the following:

Product family standard EN50130-4 in respect of Conducted Disturbances, Radiated Immunity, Electrostatic Discharge, Fast Transients and Slow High Energy

EN 61000-6-3 for Emissions

5.4 ELECTRICAL CHARACTERISTICS

The alarm load presented to the controller is shown in Fig. 7.

The following characteristics shown in Table 1 are taken at 25°C with a supply voltage of 20V unless otherwise specified.

Characteristics	Min.	Typ.	Max.	Unit
Operating Voltage (d.c.)	16	20	28	V
Average Quiescent Current	90		110	µA
Switch-on-Surge			130	µA
Stabilisation Time			60	sec
Alarm Current	See Fig. 6			mA
Holding Voltage			5	V
Holding Current			1	mA
Reset Time		2	5	sec
Remote LED Drive	Remote LED via 3.4k			

Table. 1 Electrical Characteristics

Intrinsic Safety Rating:

Maximum Voltage for safety (U_i):	28V
Maximum Current for Safety (I_i):	93mA
Maximum Power Input (P_i):	650mW
Equivalent Inductance (L_i):	0
Equivalent Capacitance (C_i):	0

5.5 PERFORMANCE CHARACTERISTICS

The fundamental parameter used to define the sensitivity of an optical smoke detector is the level of smoke which will just produce an alarm under 'ideal' conditions. This parameter, known as the response threshold value, is normally measured in a smoke tunnel and is defined in terms of the obscuration produced by the smoke over a one metre path. The response threshold value is normally given in dB/m, (or % per m).

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

Interpretation of response threshold value is somewhat complicated by the fact that the measurement is given in terms of obscuration, whereas the detector works by scattering from the smoke particles. The response threshold (m) value will therefore, depend on the colour of the smoke. Black smokes give less scattering than light smokes for given values of obscuration as shown in Fig. 8.

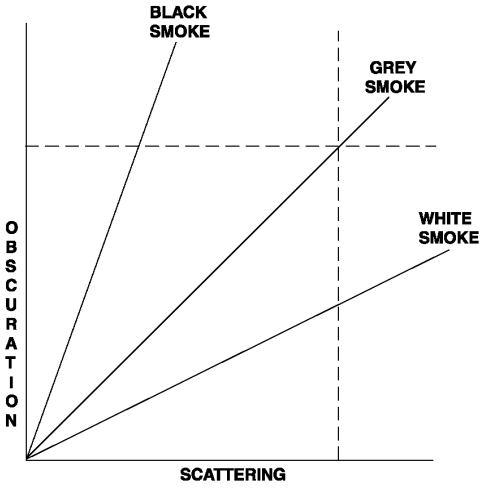


Fig. 8 Response Threshold vs Smoke Colour

Sensitivities are invariably specified for 'grey' smokes as produced by typical smouldering fires. Values for the MR601TEx are given below.

5.5.1 RESPONSE TO RATE OF CHANGE OF TEMPERATURE

The detector will not be enhanced by slow rates of change of temperature, or by cold air draughts moving across the ceiling creating negative rates of change of temperature. The detector is designed to detect sudden horizontal draughts of hot air produced by fast burning fires. The enhancement switching point has been set to allow the detection of TF1 type fires.

Normal response threshold = 0.19 dB/m, 2.7%/m typical.

Enhanced mode threshold = 0.08 dB/m, 1.1%/m typical.

5.6 RESPONSE TO FIRE TESTS

The response of an optical scatter detector to a fire will depend to a large extent on the colour of the smoke produced in the fire. However, other factors such as the detector smoke entry characteristics, the development of the fire and the thermal lift produced by the fire are important. In order to evaluate the response under realistic conditions, detectors are subjected to test fires which cover a range of fire types. These tests are defined in EN54 Pt 7. The MR601TEx passes the following Fire Tests:

TF1	open cellulosic (wood-flaming)
TF2	smouldering pyrolysis
TF3	glowing smouldering (cotton)
TF4	open plastics (polyurethane foam)
TF5	liquid (n-heptane)

Table 2: Response to Fire Tests

Note: TF2 to TF5 are mandatory test fires required to meet EN54 Pt 7.

The MR601TEx is designed to respond to the mandatory tests TF2 to TF5 as required by BS5445 Pt 7. The MR601TEx gives an earlier response to TF5 fires than the MR601 due to its thermal circuit detecting the heat generated by this test of fire and the MR601TEx being 'enhanced'. For the same reason the MR601TEx will detect test fire TF1 (open wood cellulosic flaming fire) which is not normally detected by optical smoke detectors - demonstrating the detectors broader detection capability.

The MR601TEx does not respond to TF6 liquid (methylated spirit) which although having a rapidly rising temperature, does not generate any optical scattering. This shows that the High Performance Optical detector will not respond to hot air draughts without the presence of smoke.

6. INSTALLATION RECOMMENDATIONS

It is not recommended that the MR601TEx be installed in areas where it is likely to be regularly enhanced, since in this condition the detector is extra sensitive and there is a possibility of unwanted alarms from low ambient smoke levels.

The MR601TEx is designed to become enhanced by detecting a rapid temperature rise (>10°C) in air moving horizontally across the ceiling. Siting sensors in positions where air is being blown through the detector should therefore, be particularly avoided, eg, close to ceiling ducts or ceiling mounted industrial heaters; or areas of forced ventilation, such as ducts and under floor voids of computer suites.

Also, not recommended are areas open to the outdoors, such as cargo handling bays, or areas where the detector may become contaminated.

The MR601TEx is not recommended for use in applications where a heater jacket is required.

The MR601TEx is primarily aimed at benign environments.

7. CPD INFORMATION

CE

0832

Tyco Safety Products
Dunhams Lane
Letchworth SG6 1BE
UK

06

0832-CPD-0248

EN 54-7: 2000 + A1: 2002

Conventional Intrinsically Safe high performance photoelectric smoke detector with heat enhancement for use in fire detection and alarm systems in buildings

MR601TEx

Application & Design	01B-04-D12
Installation Instructions	01B-04-I3
Service Instructions	01B-04-S2

8. DETECTOR IDENTIFICATION

The detector is identified by the logo label, as shown in Fig. 9.

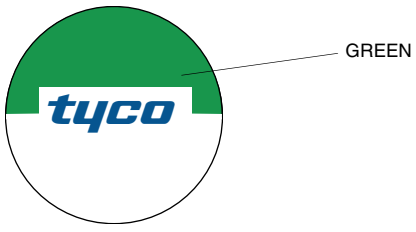


Fig. 9 Detector identification

9. ORDERING INFORMATION

MR601TEx Intrinsically Safe Enhanced Optical Smoke Detector:	516.054.011.Y
5BEx 5" Universal IS Base:	517.050.023

JM/jm

5th May 2010

© 2010 Tyco Safety Products

Registered Company: Thorn Security Ltd. Registered Office: Dunhams Lane Letchworth Garden City Hertfordshire SG6 1BE

ITEM	Tag	950-GDZ-06206	: H2 GD FZ-06 B-100 Ambient		Dwg	123A90-DDL-SAF-DL-30027	
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)		Module	LD_B-100	
TASK	code	C10003073	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity FTS	Discipline Instrumental	Form	FJ04G	Gas Detection

Loop Tag: 950-GDZ-06206 TDSL rev.: 0_A

Cabinet: B400-FGS-001 Rack: 05 Slot: 01 Channel: 07

Gas Detection Type: TEXS GTL (Infrared open path gas transmitter): GT (gas transmitter): XTR 0510

Thresholds: Gas Alarm - H 5 % Gas Confirmed - HH 10 %

Scale and Unit: 0-100 % LEL

Calibration checking (following bottle at disposal):

Physical value on transmitter:	0 %	5%	10%
ICSS Display:	0 %	5%	10%

Checking of Dirty Optical ●

Checking of Invalidity ●

Checking of Maintenance Inhibition ●

Comments:

Page 1/1	Performed by	● WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM	RM COMM.	Crosswind
Name	Alejandro Sasia	Giandonato Delmissier	John Mackillop
Date	2025-01-10	2025-01-10	2025-01-11
Signature	PROVERLIS Digitaly signed by Alejandro Sasia 2025-01-10T12:03:40.513Z	PROVERLIS Digitaly signed by Giandonato Delmissier 2025-01-10T15:26:27.227Z	PROVERLIS Digitaly signed by John Mackillop 2025-01-11T09:10:09.930Z

Dräger Polytron® 8200 CAT
Detection of flammable gases and vapors

The Dräger Polytron® 8200 CAT is an advanced explosion-proof transmitter for the detection of combustible gases in the lower explosion limit (LEL). It uses a catalytic bead DrägerSensor® Ex that will detect most flammable gases and vapors. In addition to a 3-wire 4 to 20-mA analog output with relays it also offers HART®, Modbus and Fieldbus protocols, making it compatible with most control systems.



Dräger. Technology for Life®

Benefits

Fast and stable – the DrägerSensor® Ex

The built-in DrägerSensor® Ex is based on the proven catalytic bead measuring principle. It has excellent long-term stability with outstanding poison resistance. And this is the reason for its durability. Due to the novel gas inlet opening, the sensor responds to gas in only a few seconds. This allows you to react immediately with countermeasures and prevent the development of a flammable atmosphere.

Easy device management via digital communication

The Dräger Polytron 8200 is equipped with digital interfaces allowing for quick and easy remote interrogation of the transmitter's state. Integration with existing asset management systems such as PACTware™ is possible via DTM. In addition to the common HART® communication system, the fieldbus interfaces PROFIBUS® PA, FOUNDATION fieldbus™ H1, and Modbus RTU are also available.

Same design, same operating principle

The Dräger Polytron 8200 belongs to the Polytron 8000 series. All transmitters in this series have the same design and user interface. This allows for uniform operation with reduced training and maintenance requirements. The large graphic backlit display shows status information clearly and in an easy to use format. The measured gas concentration, selected gas type, and measuring unit are displayed during normal operation. Colored LEDs (green, yellow and red) provide additional alarm and status information.

The Polytron 8200 is operated by means of a magnetic wand over contact surfaces.

Three relays for controlling external equipment

Upon request, the Dräger Polytron 8200 can also be supplied with three integrated relays. This enables you to use it as an independent gas detection system with two arbitrarily adjustable concentration alarms and one fault alarm. Audible alarms, signal lights or similar devices can thus be controlled locally without an additional cable between the transmitter and central controller.

Safe, robust housing for every application

Polytron 8200 features a Class I, Div. 1 rated explosion proof enclosure made from aluminium or stainless steel, making it suitable for a wide range of environmental conditions.

Make the impossible possible with the remote sensor

A remote explosion proof junction allows installation of the sensor up to 350' away from the transmitter in difficult to access areas. A permanently attached remote calibration adapter allows for remote bump testing or calibration from the Polytron display by using permanently attached tubing that takes the calibration gas to the sensor.

Technical Data

Dräger Polytron® 8200 CAT			
Type	Explosion proof / flameproof enclosed transmitter (“d”)		
Gases	Flammable gases and vapors		
Measuring ranges	DQ	0 to 100 % LEL	
	LC	0 to 10 % LEL	
Display	Backlit graphic LCD; 3 Status LEDs (green/yellow/red)		
Performance Characteristics	Accuracy/repeatability	Zero	≤ 1 % LEL
		Span	≤ 1 % LEL
		Long-term drift	≤ 3 % LEL after 6 months
	Response time	T50	< 7 seconds (methane)
		T90	< 13 seconds (methane)
Electrical data	Signal output analog	Normal operation	4 to 20 mA, 3- or 4-wire, sink or source
		Maintenance	Constant 3.4 mA (adjustable)
		Fault	< 1.2 mA
	Signal output digital	HART® w/ 3- or 4-wire, PROFIBUS® PA, FOUNDATION fieldbus™ H1 and Modbus RTU w/ 5-wires	
	Power supply	10 to 30 V DC	
	Power consumption (max.)	DQ w/o relay, non-remote	105 mA at 24 V
		DQ w/ relay, remote	145 mA at 24 V
	Relay specification (option)	2 alarm relays and 1 fault relay, SPDT 5 A @ 230 VAC, 5 A @ 30 VDC	
Environmental conditions (see sensor data sheet)	Temperature	-40 to 80 °C (-40 to 176 °F) without relay -40 to 70 °C (-40 to 158 °F) with relay- -50 to 85 °C (-122 to 185 °F) remote sensor	
	Pressure	23.6 to 38.4 inch Hg / 800 to 1,200 mbar	
	Humidity	5 to 95% r. h., non-condensing	
Housing	Transmitter housing	Epoxy coated copper-free aluminium or stainless steel SS316 L	
	Sensor housing	Stainless steel 303	
	Enclosure protection type	NEMA 4X & 7, IP65/66/67	
	Cable entry point	3/4" NPT threaded holes or M20 cable gland	
	Dimensions (H x W x D)	11.0" x 5.9" x 5.1" / 280 x 150 x 130 mm	
	Weight, approx.	Aluminium	4.9 lbs / 2.2 kg
		SS316 L	8.8 lbs / 4.0 kg
Approvals*	UL & CSA	Class I, Div 1, Groups A, B, C, D;	
		Class II, Div 1, Groups E, F, G;	
		Class I, Zone 1, Group IIC;	
		T-Code T6/T4	
	IECEx	Ex db IIC T6/T4 Gb, -40 ≤ Ta ≤ +40/+70 °C;	
	ATEX	II 2G Ex db IIC T6/T4 Gb, -40 ≤ Ta ≤ +40/+70 °C;	
	CE markings	ATEX (Directive 2014/34/EU)	
		Electromagnetic Compatibility (Directive 2014/30/EU)	
		Low Voltage (Directive 2014/35/EU)	
	Shipping approvals (for DQ sensor only)	DNV GL, ABS, LR, CCS, RMRS	
	MED approval (for DQ sensor only)	Certificate No. MEDB0000411	

Technical Data

	DEKRA Performance approval (for DQ sensor only)	Certificate No. BVS 13 ATEX G 001 X
	SIL 2 certified by TUEV Sued	Certificate No. Z10 053474 0023

* All docking station versions are only ATEX/IECEx approved

Ordering Information

Dräger Polytron® 8200 CAT	Approval Code	Order Number
Dräger Polytron® 8200 CAT DQ d A 4-20/HART®	XTR 0410	83 44 439
Dräger Polytron® 8200 CAT DQ d A 4-20/HART® relay	XTR 0411	83 44 440
Dräger Polytron® 8200 CAT DQ d S 4-20/HART®	XTR 0510	83 44 448
Dräger Polytron® 8200 CAT DQ d S 4-20/HART® relay	XTR 0511	83 44 449
Dräger Polytron® 8xx0 Kit (Custom configuration e. g. LC sensor or bus communication)		83 44 800

Accessories		Order Number
Magnetic wand		45 44 101
Pipe mount bracket		45 44 198
Aluminum junction box for remote sensor ‘d’		45 44 099
Stainless steel junction box for remote sensor ‘d’		45 44 098
Duct mount kit		68 12 725
IR Connection Kit Polytron® 5000/8000		45 44 197
PolySoft licence (1 year)		83 28 600
PolySoft licence (subscription)		83 28 601
Splash guard		68 12 510
Weather protection kit Dräger Polytron® 5/6/8xxx		37 02 198
Gassing adapter	PE, w/o tubing	68 06 978
	PE incl. tubing	46 09 314
Calibration adapter Viton®		68 10 536
Process adapter (Stainless steel) for DQ		68 12 470
Process adapter (Stainless steel) for LC		68 12 465

HART® is a registered trademark of the HART Communication Foundation.
FOUNDATION fieldbus™ is a registered trademark of the Fieldbus Foundation™.
PROFIBUS® is a registered trademark of PROFIBUS and PROFINET International (PI).
PACTware™ is a registered trademark of Pepperl+Fuchs GmbH.
Viton® is a registered trademark of the DuPont company.
Windows® is a registered trademark of Microsoft Corporation.

Dräger Nederland B.V.
Marine & Offshore
Beurtschipperstraat 1
NL-3194 DK Hoogvliet-RT
Telephone :+31(0)10-2952710
Web: www.draeger-mo.nl
E-mail: service-mo.sd.nl@draeger.com

Calibration Certificate: Gas Detector Polytron 8200 H2

Certificaat: Gas Detector Polytron 8200 H2

Date *Datum*	Validity [months] *Geldigheid [maanden]*	Vessel / Installation *Scheepsnaam / Installatie*	Certificate No *Certificaat Nr*
28-06-2024	**12**	**Base Load Power Hub (BLPH)**	**PR.23.034.0 - CS-24002463**

The gas detectors are inspected and calibrated as described in this certificate. The used calibration gasses are traceable according to (inter)national standards.
De gasdetectoren zijn geïnspecteerd en gekalibreerd zoals beschreven in dit certificaat. De gebruikte kalibratiegassen zijn traceerbaar vorlgens de (inter)nationale standaards..

950-GDZ-06203	Dräger	Dräger: Polytron 8200	ARTB-1639	FC4576993	N/A	N/A	New Delivery
950-GDZ-06204	Dräger	Dräger: Polytron 8200	ARTB-1637	FC4576994	N/A	N/A	New Delivery
950-GDZ-06205	Dräger	Dräger: Polytron 8200	ARTB-0204	FC4576995	N/A	N/A	New Delivery
950-GDZ-06206	Dräger	Dräger: Polytron 8200	ARSD-0466	FC4576996	N/A	N/A	New Delivery
950-GDZ-03104	Dräger	Dräger: Polytron 8200	ARTB-1624	FC4576997	N/A	N/A	New Delivery
950-GDZ-03105	Dräger	Dräger: Polytron 8200	ARTB-1630	FC4576998	N/A	N/A	New Delivery
950-GDZ-01103	Dräger	Dräger: Polytron 8200	ARTB-0194	FC4576999	N/A	N/A	New Delivery
xxx-xxx-xxxxx	Dräger	Dräger: Polytron 8200	ARTB-0185	FC4577000	N/A	N/A	New Delivery

Sensor type	Zero gas	Calibration setting
EC	H2	Detection range 0-100% LEL H2


DRÄGER MARINE & OFFSHORE
SIGNED BY: K. VAN UDISSEL

PO# : 123A90

Signed by: .....

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 00

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

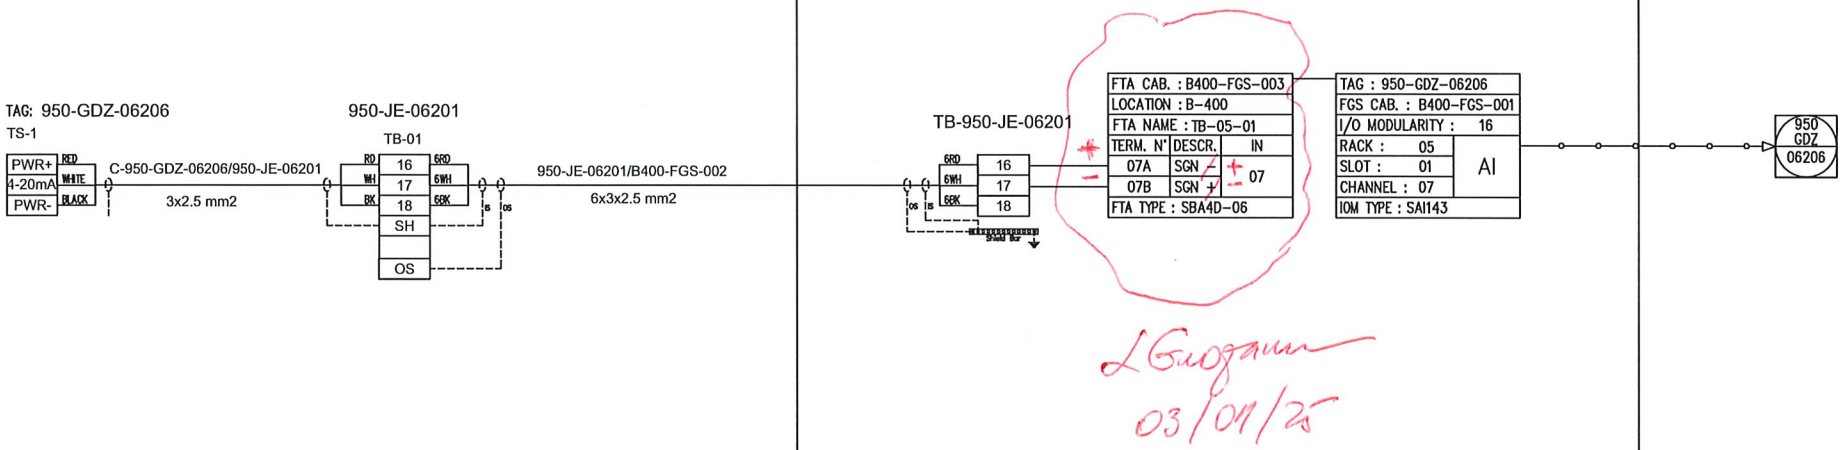

L Giugiaro
03/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 0_A | DATE: 23/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSRUMENT LOOP DIAGRAM
950-GDZ-06206
FZ-06 H2 DETECT. IN B-100 HV/MV SWGR ROOM

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 265	REV. 00

File Name : 123A90-DDL-IN-DG-40014_REV.00

ITEM	Tag	950-GDZ-06205	: H2 GD FZ-06 B-100 Ambient		Dwg	123A90-DDL-SAF-DL-30027
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)		Module	LD_B-100
TASK	code	C10003074	Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	PRE-COMM	Activity FTS	Discipline Instrumental	Form	FJ04G Gas Detection

Loop Tag: 950-GDZ-06205 TDSL rev.: 123A90-FDL-IN-DG-40014 rev.0_a

Cabinet: B400-FGS-001 Rack: 04 Slot: 03 Channel: 7

Gas Detection Type: TEXS GTL (Infrared open path gas transmitter): GT (gas transmitter): XTR 0510

Thresholds: Gas Alarm - H 5 % Gas Confirmed - HH 10 %

Scale and Unit: 0/100 % LEL H2

Calibration checking (following bottle at disposal):

Physical value on transmitter:	0 %	5 %	10 %
ICSS Display:	0 %	5 %	10 %

Checking of Dirty Optical ●

Checking of Invalidity ●

Checking of Maintenance Inhibition ●

Comments:

	Performed by	● WITNESS ☐ REVIEW	● WITNESS ☐ REVIEW
Company	RM COMM	RM COMM	CW
Name	Laurentiu Grozavu	Giandonato Delmissier	John Mackillop
Date	2025-01-10	2025-01-10	2025-01-11
Signature	PROVERLIS Digitaly signed by Laurentiu Grozavu 2025-01-10T12:42:00.683Z	PROVERLIS Digitaly signed by Giandonato Delmissier 2025-01-10T15:27:06.549Z	PROVERLIS Digitaly signed by John Mackillop 2025-01-11T09:21:32.659Z

Dräger Polytron® 8200 CAT
Detection of flammable gases and vapors

The Dräger Polytron® 8200 CAT is an advanced explosion-proof transmitter for the detection of combustible gases in the lower explosion limit (LEL). It uses a catalytic bead DrägerSensor® Ex that will detect most flammable gases and vapors. In addition to a 3-wire 4 to 20-mA analog output with relays it also offers HART®, Modbus and Fieldbus protocols, making it compatible with most control systems.



Dräger. Technology for Life®

Benefits

Fast and stable – the DrägerSensor® Ex

The built-in DrägerSensor® Ex is based on the proven catalytic bead measuring principle. It has excellent long-term stability with outstanding poison resistance. And this is the reason for its durability. Due to the novel gas inlet opening, the sensor responds to gas in only a few seconds. This allows you to react immediately with countermeasures and prevent the development of a flammable atmosphere.

Easy device management via digital communication

The Dräger Polytron 8200 is equipped with digital interfaces allowing for quick and easy remote interrogation of the transmitter's state. Integration with existing asset management systems such as PACTware™ is possible via DTM. In addition to the common HART® communication system, the fieldbus interfaces PROFIBUS® PA, FOUNDATION fieldbus™ H1, and Modbus RTU are also available.

Same design, same operating principle

The Dräger Polytron 8200 belongs to the Polytron 8000 series. All transmitters in this series have the same design and user interface. This allows for uniform operation with reduced training and maintenance requirements. The large graphic backlit display shows status information clearly and in an easy to use format. The measured gas concentration, selected gas type, and measuring unit are displayed during normal operation. Colored LEDs (green, yellow and red) provide additional alarm and status information.

The Polytron 8200 is operated by means of a magnetic wand over contact surfaces.

Three relays for controlling external equipment

Upon request, the Dräger Polytron 8200 can also be supplied with three integrated relays. This enables you to use it as an independent gas detection system with two arbitrarily adjustable concentration alarms and one fault alarm. Audible alarms, signal lights or similar devices can thus be controlled locally without an additional cable between the transmitter and central controller.

Safe, robust housing for every application

Polytron 8200 features a Class I, Div. 1 rated explosion proof enclosure made from aluminium or stainless steel, making it suitable for a wide range of environmental conditions.

Make the impossible possible with the remote sensor

A remote explosion proof junction allows installation of the sensor up to 350' away from the transmitter in difficult to access areas. A permanently attached remote calibration adapter allows for remote bump testing or calibration from the Polytron display by using permanently attached tubing that takes the calibration gas to the sensor.

Technical Data

Dräger Polytron® 8200 CAT			
Type	Explosion proof / flameproof enclosed transmitter (“d”)		
Gases	Flammable gases and vapors		
Measuring ranges	DQ	0 to 100 % LEL	
	LC	0 to 10 % LEL	
Display	Backlit graphic LCD; 3 Status LEDs (green/yellow/red)		
Performance Characteristics	Accuracy/repeatability	Zero	≤ 1 % LEL
		Span	≤ 1 % LEL
		Long-term drift	≤ 3 % LEL after 6 months
	Response time	T50	< 7 seconds (methane)
		T90	< 13 seconds (methane)
Electrical data	Signal output analog	Normal operation	4 to 20 mA, 3- or 4-wire, sink or source
		Maintenance	Constant 3.4 mA (adjustable)
		Fault	< 1.2 mA
	Signal output digital	HART® w/ 3- or 4-wire, PROFIBUS® PA, FOUNDATION fieldbus™ H1 and Modbus RTU w/ 5-wires	
	Power supply	10 to 30 V DC	
	Power consumption (max.)	DQ w/o relay, non-remote	105 mA at 24 V
		DQ w/ relay, remote	145 mA at 24 V
	Relay specification (option)	2 alarm relays and 1 fault relay, SPDT 5 A @ 230 VAC, 5 A @ 30 VDC	
Environmental conditions (see sensor data sheet)	Temperature	-40 to 80 °C (-40 to 176 °F) without relay -40 to 70 °C (-40 to 158 °F) with relay- -50 to 85 °C (-122 to 185 °F) remote sensor	
	Pressure	23.6 to 38.4 inch Hg / 800 to 1,200 mbar	
	Humidity	5 to 95% r. h., non-condensing	
Housing	Transmitter housing	Epoxy coated copper-free aluminium or stainless steel SS316 L	
	Sensor housing	Stainless steel 303	
	Enclosure protection type	NEMA 4X & 7, IP65/66/67	
	Cable entry point	3/4" NPT threaded holes or M20 cable gland	
	Dimensions (H x W x D)	11.0" x 5.9" x 5.1" / 280 x 150 x 130 mm	
	Weight, approx.	Aluminium	4.9 lbs / 2.2 kg
		SS316 L	8.8 lbs / 4.0 kg
Approvals*	UL & CSA	Class I, Div 1, Groups A, B, C, D;	
		Class II, Div 1, Groups E, F, G;	
		Class I, Zone 1, Group IIC;	
		T-Code T6/T4	
	IECEx	Ex db IIC T6/T4 Gb, -40 ≤ Ta ≤ +40/+70 °C;	
	ATEX	II 2G Ex db IIC T6/T4 Gb, -40 ≤ Ta ≤ +40/+70 °C;	
	CE markings	ATEX (Directive 2014/34/EU)	
		Electromagnetic Compatibility (Directive 2014/30/EU)	
		Low Voltage (Directive 2014/35/EU)	
	Shipping approvals (for DQ sensor only)	DNV GL, ABS, LR, CCS, RMRS	
	MED approval (for DQ sensor only)	Certificate No. MEDB0000411	

Technical Data

	DEKRA Performance approval (for DQ sensor only)	Certificate No. BVS 13 ATEX G 001 X
	SIL 2 certified by TUEV Sued	Certificate No. Z10 053474 0023

* All docking station versions are only ATEX/IECEx approved

Ordering Information

Dräger Polytron® 8200 CAT	Approval Code	Order Number
Dräger Polytron® 8200 CAT DQ d A 4-20/HART®	XTR 0410	83 44 439
Dräger Polytron® 8200 CAT DQ d A 4-20/HART® relay	XTR 0411	83 44 440
Dräger Polytron® 8200 CAT DQ d S 4-20/HART®	XTR 0510	83 44 448
Dräger Polytron® 8200 CAT DQ d S 4-20/HART® relay	XTR 0511	83 44 449
Dräger Polytron® 8xx0 Kit (Custom configuration e. g. LC sensor or bus communication)		83 44 800

Accessories		Order Number
Magnetic wand		45 44 101
Pipe mount bracket		45 44 198
Aluminum junction box for remote sensor ‘d’		45 44 099
Stainless steel junction box for remote sensor ‘d’		45 44 098
Duct mount kit		68 12 725
IR Connection Kit Polytron® 5000/8000		45 44 197
PolySoft licence (1 year)		83 28 600
PolySoft licence (subscription)		83 28 601
Splash guard		68 12 510
Weather protection kit Dräger Polytron® 5/6/8xxx		37 02 198
Gassing adapter	PE, w/o tubing	68 06 978
	PE incl. tubing	46 09 314
Calibration adapter Viton®		68 10 536
Process adapter (Stainless steel) for DQ		68 12 470
Process adapter (Stainless steel) for LC		68 12 465

HART® is a registered trademark of the HART Communication Foundation.
FOUNDATION fieldbus™ is a registered trademark of the Fieldbus Foundation™.
PROFIBUS® is a registered trademark of PROFIBUS and PROFINET International (PI).
PACTware™ is a registered trademark of Pepperl+Fuchs GmbH.
Viton® is a registered trademark of the DuPont company.
Windows® is a registered trademark of Microsoft Corporation.

Dräger Nederland B.V.
Marine & Offshore
Beurtschipperstraat 1
NL-3194 DK Hoogvliet-RT
Telephone :+31(0)10-2952710
Web: www.draeger-mo.nl
E-mail: service-mo.sd.nl@draeger.com

Calibration Certificate: Gas Detector Polytron 8200 H2

Certificaat: Gas Detector Polytron 8200 H2

Date *Datum*	Validity [months] *Geldigheid [maanden]*	Vessel / Installation *Scheepsnaam / Installatie*	Certificate No *Certificaat Nr*
28-06-2024	**12**	**Base Load Power Hub (BLPH)**	**PR.23.034.0 - CS-24002463**

The gas detectors are inspected and calibrated as described in this certificate. The used calibration gasses are traceable according to (inter)national standards.
De gasdetectoren zijn geïnspecteerd en gekalibreerd zoals beschreven in dit certificaat. De gebruikte kalibratiegassen zijn traceerbaar vorlgens de (inter)nationale standaards..

950-GDZ-06203	Dräger	Dräger: Polytron 8200	ARTB-1639	FC4576993	N/A	N/A	New Delivery
950-GDZ-06204	Dräger	Dräger: Polytron 8200	ARTB-1637	FC4576994	N/A	N/A	New Delivery
950-GDZ-06205	Dräger	Dräger: Polytron 8200	ARTB-0204	FC4576995	N/A	N/A	New Delivery
950-GDZ-06206	Dräger	Dräger: Polytron 8200	ARSD-0466	FC4576996	N/A	N/A	New Delivery
950-GDZ-03104	Dräger	Dräger: Polytron 8200	ARTB-1624	FC4576997	N/A	N/A	New Delivery
950-GDZ-03105	Dräger	Dräger: Polytron 8200	ARTB-1630	FC4576998	N/A	N/A	New Delivery
950-GDZ-01103	Dräger	Dräger: Polytron 8200	ARTB-0194	FC4576999	N/A	N/A	New Delivery
xxx-xxx-xxxxx	Dräger	Dräger: Polytron 8200	ARTB-0185	FC4577000	N/A	N/A	New Delivery

Sensor type	Zero gas	Calibration setting
EC	H2	Detection range 0-100% LEL H2


DRÄGER MARINE & OFFSHORE
SIGNED BY: K. VAN UDISSEL

PO# : 123A90

Signed by: .....

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 00

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

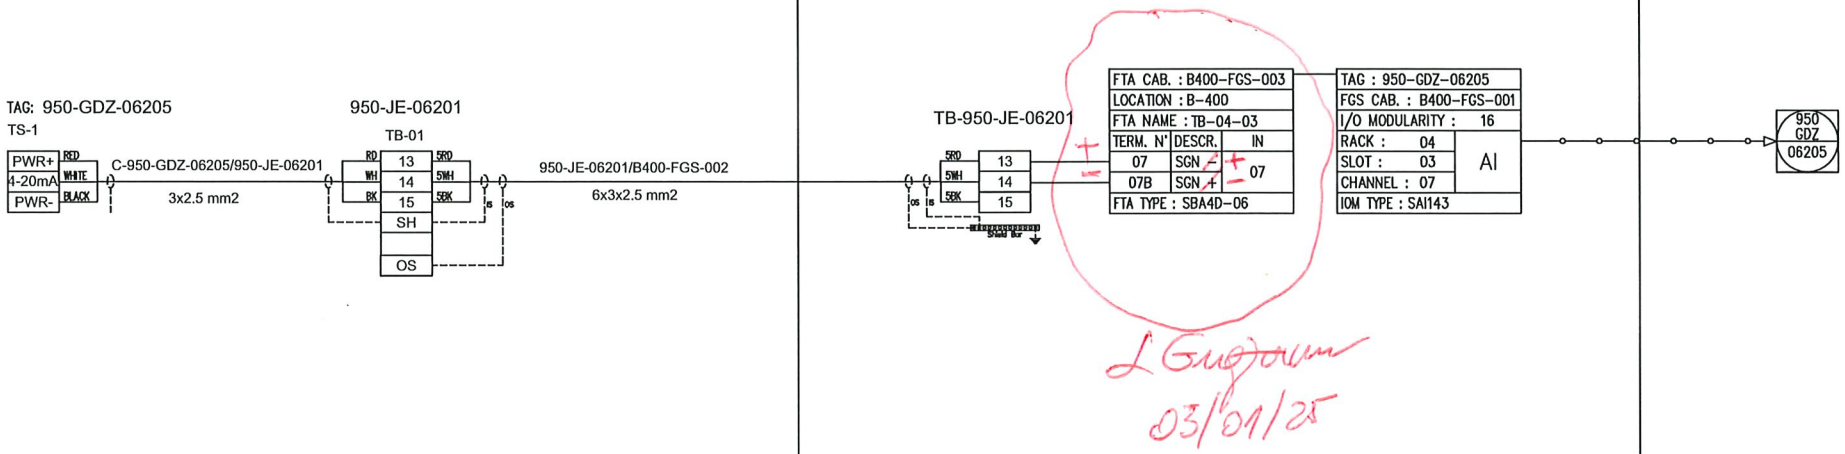

L Giordano
03/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 0_A | DATE: 23/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSRUMENT LOOP DIAGRAM
950-GDZ-06205
FZ-06 H2 DETECT. IN B-100 HV/MV SWGR ROOM

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024
A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 264	REV. 00

File Name : 123A90-DDL-IN-DG-40014_REV.00

ITEM	Tag	950-GDZ-06204	: H2 GD FZ-06 B-100 Ambient		Dwg	123A90-DDL-SAF-DL-30027	
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)		Module	LD_B-100	
TASK	code	C10003075	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity FTS	Discipline Instrumental	Form	FJ04G	Gas Detection

Loop Tag: 950-FGZ-6204 TDSL rev.: 0_A

Cabinet: B400-FGS-001 Rack: 04 Slot: 01 Channel: 07

Gas Detection Type: TEXS GTL (Infrared open path gas transmitter): GT (gas transmitter): XTR 0510

Thresholds: Gas Alarm - H 5 % Gas Confirmed - HH 10 %

Scale and Unit: 0-100 % LEL

Calibration checking (following bottle at disposal):

Physical value on transmitter:	0 %	5 %	10 %
ICSS Display:	0 %	5 %	10 %

Checking of Dirty Optical ●

Checking of Invalidity ●

Checking of Maintenance Inhibition ●

Comments:

	Performed by	● WITNESS ☐ REVIEW	● WITNESS ☐ REVIEW
Company	RM COM	RM COMM	CW
Name	Alejandro Sasia	Giandonato Delmissier	John Mackillop
Date	2025-01-10	2025-01-10	2025-01-17
Signature	PROVERLIS Digitaly signed by Alejandro Sasia 2025-01-10T09:27:46.031Z	PROVERLIS Digitaly signed by Giandonato Delmissier 2025-01-10T15:27:30.788Z	PROVERLIS Digitaly signed by John Mackillop 2025-01-17T12:40:35.446Z

Dräger Polytron® 8200 CAT
Detection of flammable gases and vapors

The Dräger Polytron® 8200 CAT is an advanced explosion-proof transmitter for the detection of combustible gases in the lower explosion limit (LEL). It uses a catalytic bead DrägerSensor® Ex that will detect most flammable gases and vapors. In addition to a 3-wire 4 to 20-mA analog output with relays it also offers HART®, Modbus and Fieldbus protocols, making it compatible with most control systems.



Dräger. Technology for Life®

Benefits

Fast and stable – the DrägerSensor® Ex

The built-in DrägerSensor® Ex is based on the proven catalytic bead measuring principle. It has excellent long-term stability with outstanding poison resistance. And this is the reason for its durability. Due to the novel gas inlet opening, the sensor responds to gas in only a few seconds. This allows you to react immediately with countermeasures and prevent the development of a flammable atmosphere.

Easy device management via digital communication

The Dräger Polytron 8200 is equipped with digital interfaces allowing for quick and easy remote interrogation of the transmitter's state. Integration with existing asset management systems such as PACTware™ is possible via DTM. In addition to the common HART® communication system, the fieldbus interfaces PROFIBUS® PA, FOUNDATION fieldbus™ H1, and Modbus RTU are also available.

Same design, same operating principle

The Dräger Polytron 8200 belongs to the Polytron 8000 series. All transmitters in this series have the same design and user interface. This allows for uniform operation with reduced training and maintenance requirements. The large graphic backlit display shows status information clearly and in an easy to use format. The measured gas concentration, selected gas type, and measuring unit are displayed during normal operation. Colored LEDs (green, yellow and red) provide additional alarm and status information.

The Polytron 8200 is operated by means of a magnetic wand over contact surfaces.

Three relays for controlling external equipment

Upon request, the Dräger Polytron 8200 can also be supplied with three integrated relays. This enables you to use it as an independent gas detection system with two arbitrarily adjustable concentration alarms and one fault alarm. Audible alarms, signal lights or similar devices can thus be controlled locally without an additional cable between the transmitter and central controller.

Safe, robust housing for every application

Polytron 8200 features a Class I, Div. 1 rated explosion proof enclosure made from aluminium or stainless steel, making it suitable for a wide range of environmental conditions.

Make the impossible possible with the remote sensor

A remote explosion proof junction allows installation of the sensor up to 350' away from the transmitter in difficult to access areas. A permanently attached remote calibration adapter allows for remote bump testing or calibration from the Polytron display by using permanently attached tubing that takes the calibration gas to the sensor.

Technical Data

Dräger Polytron® 8200 CAT			
Type	Explosion proof / flameproof enclosed transmitter (“d”)		
Gases	Flammable gases and vapors		
Measuring ranges	DQ	0 to 100 % LEL	
	LC	0 to 10 % LEL	
Display	Backlit graphic LCD; 3 Status LEDs (green/yellow/red)		
Performance Characteristics	Accuracy/repeatability	Zero	≤ 1 % LEL
		Span	≤ 1 % LEL
		Long-term drift	≤ 3 % LEL after 6 months
	Response time	T50	< 7 seconds (methane)
		T90	< 13 seconds (methane)
Electrical data	Signal output analog	Normal operation	4 to 20 mA, 3- or 4-wire, sink or source
		Maintenance	Constant 3.4 mA (adjustable)
		Fault	< 1.2 mA
	Signal output digital	HART® w/ 3- or 4-wire, PROFIBUS® PA, FOUNDATION fieldbus™ H1 and Modbus RTU w/ 5-wires	
	Power supply	10 to 30 V DC	
	Power consumption (max.)	DQ w/o relay, non-remote	105 mA at 24 V
		DQ w/ relay, remote	145 mA at 24 V
	Relay specification (option)	2 alarm relays and 1 fault relay, SPDT 5 A @ 230 VAC, 5 A @ 30 VDC	
Environmental conditions (see sensor data sheet)	Temperature	-40 to 80 °C (-40 to 176 °F) without relay -40 to 70 °C (-40 to 158 °F) with relay- -50 to 85 °C (-122 to 185 °F) remote sensor	
	Pressure	23.6 to 38.4 inch Hg / 800 to 1,200 mbar	
	Humidity	5 to 95% r. h., non-condensing	
Housing	Transmitter housing	Epoxy coated copper-free aluminium or stainless steel SS316 L	
	Sensor housing	Stainless steel 303	
	Enclosure protection type	NEMA 4X & 7, IP65/66/67	
	Cable entry point	3/4" NPT threaded holes or M20 cable gland	
	Dimensions (H x W x D)	11.0" x 5.9" x 5.1" / 280 x 150 x 130 mm	
	Weight, approx.	Aluminium	4.9 lbs / 2.2 kg
		SS316 L	8.8 lbs / 4.0 kg
Approvals*	UL & CSA	Class I, Div 1, Groups A, B, C, D;	
		Class II, Div 1, Groups E, F, G;	
		Class I, Zone 1, Group IIC;	
		T-Code T6/T4	
	IECEx	Ex db IIC T6/T4 Gb, -40 ≤ Ta ≤ +40/+70 °C;	
	ATEX	II 2G Ex db IIC T6/T4 Gb, -40 ≤ Ta ≤ +40/+70 °C;	
	CE markings	ATEX (Directive 2014/34/EU)	
		Electromagnetic Compatibility (Directive 2014/30/EU)	
		Low Voltage (Directive 2014/35/EU)	
	Shipping approvals (for DQ sensor only)	DNV GL, ABS, LR, CCS, RMRS	
	MED approval (for DQ sensor only)	Certificate No. MEDB0000411	

Technical Data

	DEKRA Performance approval (for DQ sensor only)	Certificate No. BVS 13 ATEX G 001 X
	SIL 2 certified by TUEV Sued	Certificate No. Z10 053474 0023

* All docking station versions are only ATEX/IECEx approved

Ordering Information

Dräger Polytron® 8200 CAT	Approval Code	Order Number
Dräger Polytron® 8200 CAT DQ d A 4-20/HART®	XTR 0410	83 44 439
Dräger Polytron® 8200 CAT DQ d A 4-20/HART® relay	XTR 0411	83 44 440
Dräger Polytron® 8200 CAT DQ d S 4-20/HART®	XTR 0510	83 44 448
Dräger Polytron® 8200 CAT DQ d S 4-20/HART® relay	XTR 0511	83 44 449
Dräger Polytron® 8xx0 Kit (Custom configuration e. g. LC sensor or bus communication)		83 44 800

Accessories		Order Number
Magnetic wand		45 44 101
Pipe mount bracket		45 44 198
Aluminum junction box for remote sensor ‘d’		45 44 099
Stainless steel junction box for remote sensor ‘d’		45 44 098
Duct mount kit		68 12 725
IR Connection Kit Polytron® 5000/8000		45 44 197
PolySoft licence (1 year)		83 28 600
PolySoft licence (subscription)		83 28 601
Splash guard		68 12 510
Weather protection kit Dräger Polytron® 5/6/8xxx		37 02 198
Gassing adapter	PE, w/o tubing	68 06 978
	PE incl. tubing	46 09 314
Calibration adapter Viton®		68 10 536
Process adapter (Stainless steel) for DQ		68 12 470
Process adapter (Stainless steel) for LC		68 12 465

HART® is a registered trademark of the HART Communication Foundation.
FOUNDATION fieldbus™ is a registered trademark of the Fieldbus Foundation™.
PROFIBUS® is a registered trademark of PROFIBUS and PROFINET International (PI).
PACTware™ is a registered trademark of Pepperl+Fuchs GmbH.
Viton® is a registered trademark of the DuPont company.
Windows® is a registered trademark of Microsoft Corporation.

Dräger Polytron® 8200 CAT
Detection of flammable gases and vapors

The Dräger Polytron® 8200 CAT is an advanced explosion-proof transmitter for the detection of combustible gases in the lower explosion limit (LEL). It uses a catalytic bead DrägerSensor® Ex that will detect most flammable gases and vapors. In addition to a 3-wire 4 to 20-mA analog output with relays it also offers HART®, Modbus and Fieldbus protocols, making it compatible with most control systems.



Dräger. Technology for Life®

Benefits

Fast and stable – the DrägerSensor® Ex

The built-in DrägerSensor® Ex is based on the proven catalytic bead measuring principle. It has excellent long-term stability with outstanding poison resistance. And this is the reason for its durability. Due to the novel gas inlet opening, the sensor responds to gas in only a few seconds. This allows you to react immediately with countermeasures and prevent the development of a flammable atmosphere.

Easy device management via digital communication

The Dräger Polytron 8200 is equipped with digital interfaces allowing for quick and easy remote interrogation of the transmitter's state. Integration with existing asset management systems such as PACTware™ is possible via DTM. In addition to the common HART® communication system, the fieldbus interfaces PROFIBUS® PA, FOUNDATION fieldbus™ H1, and Modbus RTU are also available.

Same design, same operating principle

The Dräger Polytron 8200 belongs to the Polytron 8000 series. All transmitters in this series have the same design and user interface. This allows for uniform operation with reduced training and maintenance requirements. The large graphic backlit display shows status information clearly and in an easy to use format. The measured gas concentration, selected gas type, and measuring unit are displayed during normal operation. Colored LEDs (green, yellow and red) provide additional alarm and status information.

The Polytron 8200 is operated by means of a magnetic wand over contact surfaces.

Three relays for controlling external equipment

Upon request, the Dräger Polytron 8200 can also be supplied with three integrated relays. This enables you to use it as an independent gas detection system with two arbitrarily adjustable concentration alarms and one fault alarm. Audible alarms, signal lights or similar devices can thus be controlled locally without an additional cable between the transmitter and central controller.

Safe, robust housing for every application

Polytron 8200 features a Class I, Div. 1 rated explosion proof enclosure made from aluminium or stainless steel, making it suitable for a wide range of environmental conditions.

Make the impossible possible with the remote sensor

A remote explosion proof junction allows installation of the sensor up to 350' away from the transmitter in difficult to access areas. A permanently attached remote calibration adapter allows for remote bump testing or calibration from the Polytron display by using permanently attached tubing that takes the calibration gas to the sensor.

Technical Data

Dräger Polytron® 8200 CAT			
Type	Explosion proof / flameproof enclosed transmitter (“d”)		
Gases	Flammable gases and vapors		
Measuring ranges	DQ	0 to 100 % LEL	
	LC	0 to 10 % LEL	
Display	Backlit graphic LCD; 3 Status LEDs (green/yellow/red)		
Performance Characteristics	Accuracy/repeatability	Zero	≤ 1 % LEL
		Span	≤ 1 % LEL
		Long-term drift	≤ 3 % LEL after 6 months
	Response time	T50	< 7 seconds (methane)
		T90	< 13 seconds (methane)
Electrical data	Signal output analog	Normal operation	4 to 20 mA, 3- or 4-wire, sink or source
		Maintenance	Constant 3.4 mA (adjustable)
		Fault	< 1.2 mA
	Signal output digital	HART® w/ 3- or 4-wire, PROFIBUS® PA, FOUNDATION fieldbus™ H1 and Modbus RTU w/ 5-wires	
	Power supply	10 to 30 V DC	
	Power consumption (max.)	DQ w/o relay, non-remote	105 mA at 24 V
		DQ w/ relay, remote	145 mA at 24 V
	Relay specification (option)	2 alarm relays and 1 fault relay, SPDT 5 A @ 230 VAC, 5 A @ 30 VDC	
Environmental conditions (see sensor data sheet)	Temperature	-40 to 80 °C (-40 to 176 °F) without relay -40 to 70 °C (-40 to 158 °F) with relay- -50 to 85 °C (-122 to 185 °F) remote sensor	
	Pressure	23.6 to 38.4 inch Hg / 800 to 1,200 mbar	
	Humidity	5 to 95% r. h., non-condensing	
Housing	Transmitter housing	Epoxy coated copper-free aluminium or stainless steel SS316 L	
	Sensor housing	Stainless steel 303	
	Enclosure protection type	NEMA 4X & 7, IP65/66/67	
	Cable entry point	3/4" NPT threaded holes or M20 cable gland	
	Dimensions (H x W x D)	11.0" x 5.9" x 5.1" / 280 x 150 x 130 mm	
	Weight, approx.	Aluminium	4.9 lbs / 2.2 kg
		SS316 L	8.8 lbs / 4.0 kg
Approvals*	UL & CSA	Class I, Div 1, Groups A, B, C, D;	
		Class II, Div 1, Groups E, F, G;	
		Class I, Zone 1, Group IIC;	
		T-Code T6/T4	
	IECEx	Ex db IIC T6/T4 Gb, -40 ≤ Ta ≤ +40/+70 °C;	
	ATEX	II 2G Ex db IIC T6/T4 Gb, -40 ≤ Ta ≤ +40/+70 °C;	
	CE markings	ATEX (Directive 2014/34/EU)	
		Electromagnetic Compatibility (Directive 2014/30/EU)	
		Low Voltage (Directive 2014/35/EU)	
	Shipping approvals (for DQ sensor only)	DNV GL, ABS, LR, CCS, RMRS	
	MED approval (for DQ sensor only)	Certificate No. MEDB0000411	

Technical Data

	DEKRA Performance approval (for DQ sensor only)	Certificate No. BVS 13 ATEX G 001 X
	SIL 2 certified by TUEV Sued	Certificate No. Z10 053474 0023

* All docking station versions are only ATEX/IECEx approved

Ordering Information

Dräger Polytron® 8200 CAT	Approval Code	Order Number
Dräger Polytron® 8200 CAT DQ d A 4-20/HART®	XTR 0410	83 44 439
Dräger Polytron® 8200 CAT DQ d A 4-20/HART® relay	XTR 0411	83 44 440
Dräger Polytron® 8200 CAT DQ d S 4-20/HART®	XTR 0510	83 44 448
Dräger Polytron® 8200 CAT DQ d S 4-20/HART® relay	XTR 0511	83 44 449
Dräger Polytron® 8xx0 Kit (Custom configuration e. g. LC sensor or bus communication)		83 44 800

Accessories		Order Number
Magnetic wand		45 44 101
Pipe mount bracket		45 44 198
Aluminum junction box for remote sensor ‘d’		45 44 099
Stainless steel junction box for remote sensor ‘d’		45 44 098
Duct mount kit		68 12 725
IR Connection Kit Polytron® 5000/8000		45 44 197
PolySoft licence (1 year)		83 28 600
PolySoft licence (subscription)		83 28 601
Splash guard		68 12 510
Weather protection kit Dräger Polytron® 5/6/8xxx		37 02 198
Gassing adapter	PE, w/o tubing	68 06 978
	PE incl. tubing	46 09 314
Calibration adapter Viton®		68 10 536
Process adapter (Stainless steel) for DQ		68 12 470
Process adapter (Stainless steel) for LC		68 12 465

HART® is a registered trademark of the HART Communication Foundation.
FOUNDATION fieldbus™ is a registered trademark of the Fieldbus Foundation™.
PROFIBUS® is a registered trademark of PROFIBUS and PROFINET International (PI).
PACTware™ is a registered trademark of Pepperl+Fuchs GmbH.
Viton® is a registered trademark of the DuPont company.
Windows® is a registered trademark of Microsoft Corporation.

Dräger Nederland B.V.
Marine & Offshore
Beurtschipperstraat 1
NL-3194 DK Hoogvliet-RT
Telephone :+31(0)10-2952710
Web: www.draeger-mo.nl
E-mail: service-mo.sd.nl@draeger.com

Calibration Certificate: Gas Detector Polytron 8200 H2

Certificaat: Gas Detector Polytron 8200 H2

Date *Datum*	Validity [months] *Geldigheid [maanden]*	Vessel / Installation *Scheepsnaam / Installatie*	Certificate No *Certificaat Nr*
28-06-2024	**12**	**Base Load Power Hub (BLPH)**	**PR.23.034.0 - CS-24002463**

The gas detectors are inspected and calibrated as described in this certificate. The used calibration gasses are traceable according to (inter)national standards.
De gasdetectoren zijn geïnspecteerd en gekalibreerd zoals beschreven in dit certificaat. De gebruikte kalibratiegassen zijn traceerbaar vorlgens de (inter)nationale standaards..

950-GDZ-06203	Dräger	Dräger: Polytron 8200	ARTB-1639	FC4576993	N/A	N/A	New Delivery
950-GDZ-06204	Dräger	Dräger: Polytron 8200	ARTB-1637	FC4576994	N/A	N/A	New Delivery
950-GDZ-06205	Dräger	Dräger: Polytron 8200	ARTB-0204	FC4576995	N/A	N/A	New Delivery
950-GDZ-06206	Dräger	Dräger: Polytron 8200	ARSD-0466	FC4576996	N/A	N/A	New Delivery
950-GDZ-03104	Dräger	Dräger: Polytron 8200	ARTB-1624	FC4576997	N/A	N/A	New Delivery
950-GDZ-03105	Dräger	Dräger: Polytron 8200	ARTB-1630	FC4576998	N/A	N/A	New Delivery
950-GDZ-01103	Dräger	Dräger: Polytron 8200	ARTB-0194	FC4576999	N/A	N/A	New Delivery
xxx-xxx-xxxxx	Dräger	Dräger: Polytron 8200	ARTB-0185	FC4577000	N/A	N/A	New Delivery

Sensor type	Zero gas	Calibration setting
EC	H2	Detection range 0-100% LEL H2


DRÄGER MARINE & OFFSHORE
SIGNED BY: K. VAN UDISSEL

PO# : 123A90

Signed by: .....

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 00

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

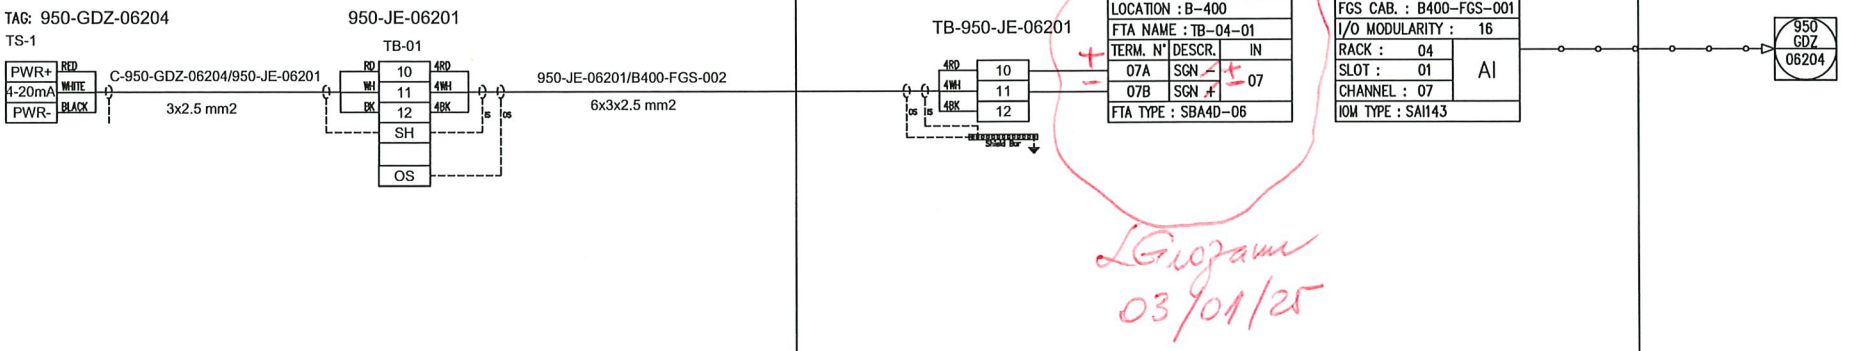

L.Grazzini
03/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 0_A | DATE: 23/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSRUMENT LOOP DIAGRAM
950-GDZ-06204
FZ-06 H2 DETECT. IN B-100 HV/MV SWGR ROOM

CONTRACT NO./TITLE CONTRACT_NO. | SCALE 1:1
DRAWN: VBA | CHECKED: LCA | APPROVED: DLO | DATE 23/10/2024

A3 | DRAWING NO. 123A90-DDL-IN-DG-40014 | SHEET 263 | REV. 00

File Name : 123A90-DDL-IN-DG-40014_REV.00

ITEM	Tag	950-GDZ-06203	: H2 GD FZ-06 B-100 HVAC Air Intake	Dwg	123A90-DDL-SAF-DL-30027		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module	LD_B-100_Ext		
TASK	code	C10003076	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity FTS	Discipline	Instrumental	Form FJ04G	Gas Detection

Loop Tag: 950-GDZ-06203 TDSL rev.: 123A90-FDL-IN-DG-40014 rev 1_A

Cabinet: B400-FGS-001 Rack: 05 Slot: 01 Channel: 06

Gas Detection Type: TEXS GTL (Infrared open path gas transmitter): GT (gas transmitter): XTR 0510

Thresholds: Gas Alarm - H 5 % Gas Confirmed - HH 10 %

Scale and Unit: 0-100 % LEL H2

Calibration checking (following bottle at disposal):

Physical value on transmitter:	0 %	5 %	10 %
ICSS Display:	0 %	5 %	10 %

Checking of Dirty Optical ●

Checking of Invalidity ●

Checking of Maintenance Inhibition ●

Comments:

	Performed by	● WITNESS ☐ REVIEW	● WITNESS ☐ REVIEW
Company	RM COMM	RM COMM	CW
Name	Laurentiu Grozavu	Giandonato Delmissier	John Mackillop
Date	2025-02-08	2025-02-08	2025-02-11
Signature	Digitaly signed by Laurentiu Grozavu 2025-02-08T07:10:55.646Z	Digitaly signed by Giandonato Delmissier 2025-02-08T10:46:01.271Z	Digitaly signed by John Mackillop 2025-02-11T05:21:48.698Z

Dräger Polytron® 8200 CAT
Detection of flammable gases and vapors

The Dräger Polytron® 8200 CAT is an advanced explosion-proof transmitter for the detection of combustible gases in the lower explosion limit (LEL). It uses a catalytic bead DrägerSensor® Ex that will detect most flammable gases and vapors. In addition to a 3-wire 4 to 20-mA analog output with relays it also offers HART®, Modbus and Fieldbus protocols, making it compatible with most control systems.



Dräger. Technology for Life®

Benefits

Fast and stable – the DrägerSensor® Ex

The built-in DrägerSensor® Ex is based on the proven catalytic bead measuring principle. It has excellent long-term stability with outstanding poison resistance. And this is the reason for its durability. Due to the novel gas inlet opening, the sensor responds to gas in only a few seconds. This allows you to react immediately with countermeasures and prevent the development of a flammable atmosphere.

Easy device management via digital communication

The Dräger Polytron 8200 is equipped with digital interfaces allowing for quick and easy remote interrogation of the transmitter's state. Integration with existing asset management systems such as PACTware™ is possible via DTM. In addition to the common HART® communication system, the fieldbus interfaces PROFIBUS® PA, FOUNDATION fieldbus™ H1, and Modbus RTU are also available.

Same design, same operating principle

The Dräger Polytron 8200 belongs to the Polytron 8000 series. All transmitters in this series have the same design and user interface. This allows for uniform operation with reduced training and maintenance requirements. The large graphic backlit display shows status information clearly and in an easy to use format. The measured gas concentration, selected gas type, and measuring unit are displayed during normal operation. Colored LEDs (green, yellow and red) provide additional alarm and status information.

The Polytron 8200 is operated by means of a magnetic wand over contact surfaces.

Three relays for controlling external equipment

Upon request, the Dräger Polytron 8200 can also be supplied with three integrated relays. This enables you to use it as an independent gas detection system with two arbitrarily adjustable concentration alarms and one fault alarm. Audible alarms, signal lights or similar devices can thus be controlled locally without an additional cable between the transmitter and central controller.

Safe, robust housing for every application

Polytron 8200 features a Class I, Div. 1 rated explosion proof enclosure made from aluminium or stainless steel, making it suitable for a wide range of environmental conditions.

Make the impossible possible with the remote sensor

A remote explosion proof junction allows installation of the sensor up to 350' away from the transmitter in difficult to access areas. A permanently attached remote calibration adapter allows for remote bump testing or calibration from the Polytron display by using permanently attached tubing that takes the calibration gas to the sensor.

Technical Data

Dräger Polytron® 8200 CAT			
Type	Explosion proof / flameproof enclosed transmitter (“d”)		
Gases	Flammable gases and vapors		
Measuring ranges	DQ	0 to 100 % LEL	
	LC	0 to 10 % LEL	
Display	Backlit graphic LCD; 3 Status LEDs (green/yellow/red)		
Performance Characteristics	Accuracy/repeatability	Zero	≤ 1 % LEL
		Span	≤ 1 % LEL
		Long-term drift	≤ 3 % LEL after 6 months
	Response time	T50	< 7 seconds (methane)
		T90	< 13 seconds (methane)
Electrical data	Signal output analog	Normal operation	4 to 20 mA, 3- or 4-wire, sink or source
		Maintenance	Constant 3.4 mA (adjustable)
		Fault	< 1.2 mA
	Signal output digital	HART® w/ 3- or 4-wire, PROFIBUS® PA, FOUNDATION fieldbus™ H1 and Modbus RTU w/ 5-wires	
	Power supply	10 to 30 V DC	
	Power consumption (max.)	DQ w/o relay, non-remote	105 mA at 24 V
		DQ w/ relay, remote	145 mA at 24 V
	Relay specification (option)	2 alarm relays and 1 fault relay, SPDT 5 A @ 230 VAC, 5 A @ 30 VDC	
Environmental conditions (see sensor data sheet)	Temperature	-40 to 80 °C (-40 to 176 °F) without relay -40 to 70 °C (-40 to 158 °F) with relay- -50 to 85 °C (-122 to 185 °F) remote sensor	
	Pressure	23.6 to 38.4 inch Hg / 800 to 1,200 mbar	
	Humidity	5 to 95% r. h., non-condensing	
Housing	Transmitter housing	Epoxy coated copper-free aluminium or stainless steel SS316 L	
	Sensor housing	Stainless steel 303	
	Enclosure protection type	NEMA 4X & 7, IP65/66/67	
	Cable entry point	3/4" NPT threaded holes or M20 cable gland	
	Dimensions (H x W x D)	11.0" x 5.9" x 5.1" / 280 x 150 x 130 mm	
	Weight, approx.	Aluminium	4.9 lbs / 2.2 kg
		SS316 L	8.8 lbs / 4.0 kg
Approvals*	UL & CSA	Class I, Div 1, Groups A, B, C, D;	
		Class II, Div 1, Groups E, F, G;	
		Class I, Zone 1, Group IIC;	
		T-Code T6/T4	
	IECEx	Ex db IIC T6/T4 Gb, -40 ≤ Ta ≤ +40/+70 °C;	
	ATEX	II 2G Ex db IIC T6/T4 Gb, -40 ≤ Ta ≤ +40/+70 °C;	
	CE markings	ATEX (Directive 2014/34/EU)	
		Electromagnetic Compatibility (Directive 2014/30/EU)	
		Low Voltage (Directive 2014/35/EU)	
	Shipping approvals (for DQ sensor only)	DNV GL, ABS, LR, CCS, RMRS	
	MED approval (for DQ sensor only)	Certificate No. MEDB0000411	

Technical Data

	DEKRA Performance approval (for DQ sensor only)	Certificate No. BVS 13 ATEX G 001 X
	SIL 2 certified by TUEV Sued	Certificate No. Z10 053474 0023

* All docking station versions are only ATEX/IECEx approved

Ordering Information

Dräger Polytron® 8200 CAT	Approval Code	Order Number
Dräger Polytron® 8200 CAT DQ d A 4-20/HART®	XTR 0410	83 44 439
Dräger Polytron® 8200 CAT DQ d A 4-20/HART® relay	XTR 0411	83 44 440
Dräger Polytron® 8200 CAT DQ d S 4-20/HART®	XTR 0510	83 44 448
Dräger Polytron® 8200 CAT DQ d S 4-20/HART® relay	XTR 0511	83 44 449
Dräger Polytron® 8xx0 Kit (Custom configuration e. g. LC sensor or bus communication)		83 44 800

Accessories		Order Number
Magnetic wand		45 44 101
Pipe mount bracket		45 44 198
Aluminum junction box for remote sensor ‘d’		45 44 099
Stainless steel junction box for remote sensor ‘d’		45 44 098
Duct mount kit		68 12 725
IR Connection Kit Polytron® 5000/8000		45 44 197
PolySoft licence (1 year)		83 28 600
PolySoft licence (subscription)		83 28 601
Splash guard		68 12 510
Weather protection kit Dräger Polytron® 5/6/8xxx		37 02 198
Gassing adapter	PE, w/o tubing	68 06 978
	PE incl. tubing	46 09 314
Calibration adapter Viton®		68 10 536
Process adapter (Stainless steel) for DQ		68 12 470
Process adapter (Stainless steel) for LC		68 12 465

HART® is a registered trademark of the HART Communication Foundation.
FOUNDATION fieldbus™ is a registered trademark of the Fieldbus Foundation™.
PROFIBUS® is a registered trademark of PROFIBUS and PROFINET International (PI).
PACTware™ is a registered trademark of Pepperl+Fuchs GmbH.
Viton® is a registered trademark of the DuPont company.
Windows® is a registered trademark of Microsoft Corporation.

Dräger Nederland B.V.
Marine & Offshore
Beurtschipperstraat 1
NL-3194 DK Hoogvliet-RT
Telephone :+31(0)10-2952710
Web: www.draeger-mo.nl
E-mail: service-mo.sd.nl@draeger.com

Calibration Certificate: Gas Detector Polytron 8200 H2

Certificaat: Gas Detector Polytron 8200 H2

Date *Datum*	Validity [months] *Geldigheid [maanden]*	Vessel / Installation *Scheepsnaam / Installatie*	Certificate No *Certificaat Nr*
28-06-2024	**12**	**Base Load Power Hub (BLPH)**	**PR.23.034.0 - CS-24002463**

The gas detectors are inspected and calibrated as described in this certificate. The used calibration gasses are traceable according to (inter)national standards.
De gasdetectoren zijn geïnspecteerd en gekalibreerd zoals beschreven in dit certificaat. De gebruikte kalibratiegassen zijn traceerbaar vorlgens de (inter)nationale standaards..

950-GDZ-06203	Dräger	Dräger: Polytron 8200	ARTB-1639	FC4576993	N/A	N/A	New Delivery
950-GDZ-06204	Dräger	Dräger: Polytron 8200	ARTB-1637	FC4576994	N/A	N/A	New Delivery
950-GDZ-06205	Dräger	Dräger: Polytron 8200	ARTB-0204	FC4576995	N/A	N/A	New Delivery
950-GDZ-06206	Dräger	Dräger: Polytron 8200	ARSD-0466	FC4576996	N/A	N/A	New Delivery
950-GDZ-03104	Dräger	Dräger: Polytron 8200	ARTB-1624	FC4576997	N/A	N/A	New Delivery
950-GDZ-03105	Dräger	Dräger: Polytron 8200	ARTB-1630	FC4576998	N/A	N/A	New Delivery
950-GDZ-01103	Dräger	Dräger: Polytron 8200	ARTB-0194	FC4576999	N/A	N/A	New Delivery
xxx-xxx-xxxxx	Dräger	Dräger: Polytron 8200	ARTB-0185	FC4577000	N/A	N/A	New Delivery

Sensor type	Zero gas	Calibration setting
EC	H2	Detection range 0-100% LEL H2


DRÄGER MARINE & OFFSHORE
SIGNED BY: K. VAN UDISSEL

PO# : 123A90

Signed by: .....

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 01

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

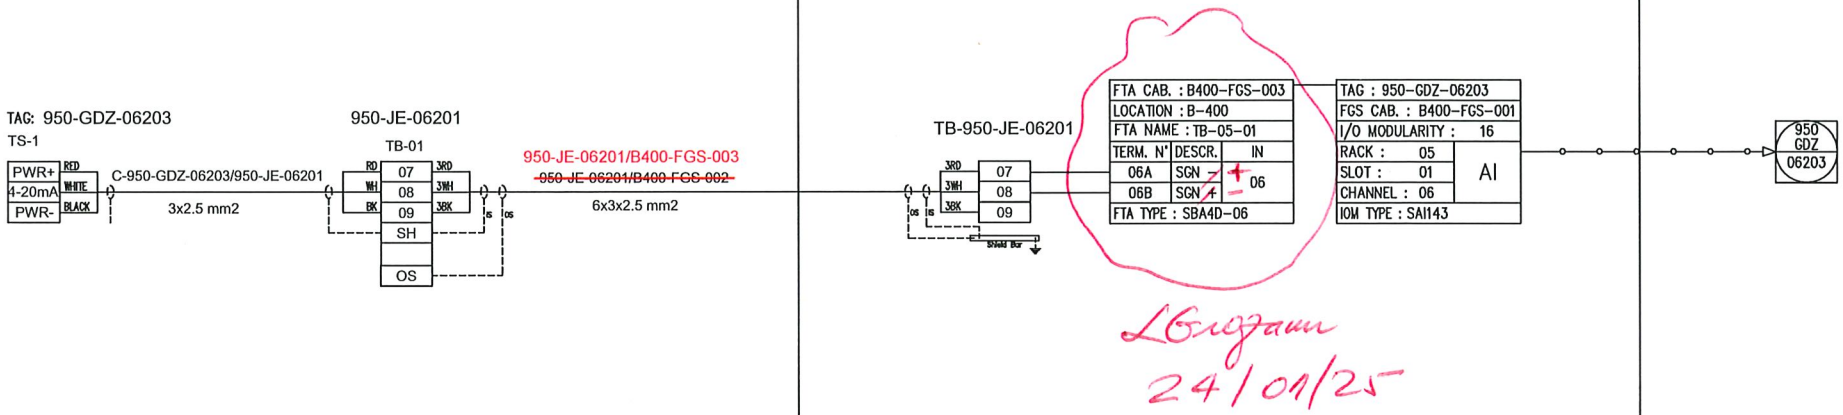

L Grigoraw
24/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	06/12/2024	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV: 1_A | DATE: 20/12/24 | SIGNATURE: C.Pilato
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSTRUMENT LOOP DIAGRAM
950-GDZ-06203
FZ-06 H2 DETECT. IN B-100 HVAC AIR INTAKE

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024

A3	DRAWING NO.	SHEET	REV.
	123A90-DDL-IN-DG-40014	262	01

File Name : 123A90-DDL-IN-DG-40014_REV.01

ITEM	Tag	950-GDZ-06202	: H2 GD FZ-06 B-100 HVAC Air Intake	Dwg	123A90-DDL-SAF-DL-30027		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module	LD_B-100_Ext		
TASK	code	C10003077	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity	FTS	Discipline	Instrumental	Form	FJ04G	Gas Detection

Loop Tag: 950-GDZ-06202 TDSL rev.: 0_A

Cabinet: B400-FGS-001 Rack: 04 Slot: 03 Channel: 06

Gas Detection Type: TEXS GTL (Infrared open path gas transmitter): GT (gas transmitter): XTR 0510

Thresholds: Gas Alarm - H 5 % Gas Confirmed - HH 10 %

Scale and Unit: 0-100 %

Calibration checking (following bottle at disposal):

Physical value on transmitter:	0 %	5 %	10 %
ICSS Display:	0 %	5 %	10 %

Checking of Dirty Optical ●

Checking of Invalidity ●

Checking of Maintenance Inhibition ●

Comments:

	Performed by	● WITNESS ☐ REVIEW	● WITNESS ☐ REVIEW
Company	RM	RM COMM	cw
Name	Alejandro Sasia	Giandonato Delmissier	John Mackillop
Date	2025-01-10	2025-01-10	2025-01-11
Signature	PROVERLIS Digitaly signed by Alejandro Sasia 2025-01-10T12:05:54.503Z	PROVERLIS Digitaly signed by Giandonato Delmissier 2025-01-10T15:28:09.369Z	PROVERLIS Digitaly signed by John Mackillop 2025-01-11T09:23:18.002Z

Dräger Polytron® 8200 CAT
Detection of flammable gases and vapors

The Dräger Polytron® 8200 CAT is an advanced explosion-proof transmitter for the detection of combustible gases in the lower explosion limit (LEL). It uses a catalytic bead DrägerSensor® Ex that will detect most flammable gases and vapors. In addition to a 3-wire 4 to 20-mA analog output with relays it also offers HART®, Modbus and Fieldbus protocols, making it compatible with most control systems.



Dräger. Technology for Life®

Benefits

Fast and stable – the DrägerSensor® Ex

The built-in DrägerSensor® Ex is based on the proven catalytic bead measuring principle. It has excellent long-term stability with outstanding poison resistance. And this is the reason for its durability. Due to the novel gas inlet opening, the sensor responds to gas in only a few seconds. This allows you to react immediately with countermeasures and prevent the development of a flammable atmosphere.

Easy device management via digital communication

The Dräger Polytron 8200 is equipped with digital interfaces allowing for quick and easy remote interrogation of the transmitter's state. Integration with existing asset management systems such as PACTware™ is possible via DTM. In addition to the common HART® communication system, the fieldbus interfaces PROFIBUS® PA, FOUNDATION fieldbus™ H1, and Modbus RTU are also available.

Same design, same operating principle

The Dräger Polytron 8200 belongs to the Polytron 8000 series. All transmitters in this series have the same design and user interface. This allows for uniform operation with reduced training and maintenance requirements. The large graphic backlit display shows status information clearly and in an easy to use format. The measured gas concentration, selected gas type, and measuring unit are displayed during normal operation. Colored LEDs (green, yellow and red) provide additional alarm and status information.

The Polytron 8200 is operated by means of a magnetic wand over contact surfaces.

Three relays for controlling external equipment

Upon request, the Dräger Polytron 8200 can also be supplied with three integrated relays. This enables you to use it as an independent gas detection system with two arbitrarily adjustable concentration alarms and one fault alarm. Audible alarms, signal lights or similar devices can thus be controlled locally without an additional cable between the transmitter and central controller.

Safe, robust housing for every application

Polytron 8200 features a Class I, Div. 1 rated explosion proof enclosure made from aluminium or stainless steel, making it suitable for a wide range of environmental conditions.

Make the impossible possible with the remote sensor

A remote explosion proof junction allows installation of the sensor up to 350' away from the transmitter in difficult to access areas. A permanently attached remote calibration adapter allows for remote bump testing or calibration from the Polytron display by using permanently attached tubing that takes the calibration gas to the sensor.

Technical Data

Dräger Polytron® 8200 CAT			
Type	Explosion proof / flameproof enclosed transmitter (“d”)		
Gases	Flammable gases and vapors		
Measuring ranges	DQ	0 to 100 % LEL	
	LC	0 to 10 % LEL	
Display	Backlit graphic LCD; 3 Status LEDs (green/yellow/red)		
Performance Characteristics	Accuracy/repeatability	Zero	≤ 1 % LEL
		Span	≤ 1 % LEL
		Long-term drift	≤ 3 % LEL after 6 months
	Response time	T50	< 7 seconds (methane)
		T90	< 13 seconds (methane)
Electrical data	Signal output analog	Normal operation	4 to 20 mA, 3- or 4-wire, sink or source
		Maintenance	Constant 3.4 mA (adjustable)
		Fault	< 1.2 mA
	Signal output digital	HART® w/ 3- or 4-wire, PROFIBUS® PA, FOUNDATION fieldbus™ H1 and Modbus RTU w/ 5-wires	
	Power supply	10 to 30 V DC	
	Power consumption (max.)	DQ w/o relay, non-remote	105 mA at 24 V
		DQ w/ relay, remote	145 mA at 24 V
	Relay specification (option)	2 alarm relays and 1 fault relay, SPDT 5 A @ 230 VAC, 5 A @ 30 VDC	
Environmental conditions (see sensor data sheet)	Temperature	-40 to 80 °C (-40 to 176 °F) without relay -40 to 70 °C (-40 to 158 °F) with relay- -50 to 85 °C (-122 to 185 °F) remote sensor	
	Pressure	23.6 to 38.4 inch Hg / 800 to 1,200 mbar	
	Humidity	5 to 95% r. h., non-condensing	
Housing	Transmitter housing	Epoxy coated copper-free aluminium or stainless steel SS316 L	
	Sensor housing	Stainless steel 303	
	Enclosure protection type	NEMA 4X & 7, IP65/66/67	
	Cable entry point	3/4" NPT threaded holes or M20 cable gland	
	Dimensions (H x W x D)	11.0" x 5.9" x 5.1" / 280 x 150 x 130 mm	
	Weight, approx.	Aluminium	4.9 lbs / 2.2 kg
		SS316 L	8.8 lbs / 4.0 kg
Approvals*	UL & CSA	Class I, Div 1, Groups A, B, C, D;	
		Class II, Div 1, Groups E, F, G;	
		Class I, Zone 1, Group IIC;	
		T-Code T6/T4	
	IECEx	Ex db IIC T6/T4 Gb, -40 ≤ Ta ≤ +40/+70 °C;	
	ATEX	II 2G Ex db IIC T6/T4 Gb, -40 ≤ Ta ≤ +40/+70 °C;	
	CE markings	ATEX (Directive 2014/34/EU)	
		Electromagnetic Compatibility (Directive 2014/30/EU)	
		Low Voltage (Directive 2014/35/EU)	
	Shipping approvals (for DQ sensor only)	DNV GL, ABS, LR, CCS, RMRS	
	MED approval (for DQ sensor only)	Certificate No. MEDB0000411	

Technical Data

	DEKRA Performance approval (for DQ sensor only)	Certificate No. BVS 13 ATEX G 001 X
	SIL 2 certified by TUEV Sued	Certificate No. Z10 053474 0023

* All docking station versions are only ATEX/IECEx approved

Ordering Information

Dräger Polytron® 8200 CAT	Approval Code	Order Number
Dräger Polytron® 8200 CAT DQ d A 4-20/HART®	XTR 0410	83 44 439
Dräger Polytron® 8200 CAT DQ d A 4-20/HART® relay	XTR 0411	83 44 440
Dräger Polytron® 8200 CAT DQ d S 4-20/HART®	XTR 0510	83 44 448
Dräger Polytron® 8200 CAT DQ d S 4-20/HART® relay	XTR 0511	83 44 449
Dräger Polytron® 8xx0 Kit (Custom configuration e. g. LC sensor or bus communication)		83 44 800

Accessories		Order Number
Magnetic wand		45 44 101
Pipe mount bracket		45 44 198
Aluminum junction box for remote sensor ‘d’		45 44 099
Stainless steel junction box for remote sensor ‘d’		45 44 098
Duct mount kit		68 12 725
IR Connection Kit Polytron® 5000/8000		45 44 197
PolySoft licence (1 year)		83 28 600
PolySoft licence (subscription)		83 28 601
Splash guard		68 12 510
Weather protection kit Dräger Polytron® 5/6/8xxx		37 02 198
Gassing adapter	PE, w/o tubing	68 06 978
	PE incl. tubing	46 09 314
Calibration adapter Viton®		68 10 536
Process adapter (Stainless steel) for DQ		68 12 470
Process adapter (Stainless steel) for LC		68 12 465

HART® is a registered trademark of the HART Communication Foundation.
FOUNDATION fieldbus™ is a registered trademark of the Fieldbus Foundation™.
PROFIBUS® is a registered trademark of PROFIBUS and PROFINET International (PI).
PACTware™ is a registered trademark of Pepperl+Fuchs GmbH.
Viton® is a registered trademark of the DuPont company.
Windows® is a registered trademark of Microsoft Corporation.

Dräger Nederland B.V.
Marine & Offshore
Beurtschipperstraat 1
NL-3194 DK Hoogvliet-RT
Telephone :+31(0)10-2952710
Web: www.draeger-mo.nl
E-mail: service-mo.sd.nl@draeger.com

Calibration Certificate: Gas Detector Polytron 8200 H2

Certificaat: Gas Detector Polytron 8200 H2

Date *Datum*	Validity [months] *Geldigheid [maanden]*	Vessel / Installation *Scheepsnaam / Installatie*	Certificate No *Certificaat Nr*
28-06-2024	**12**	**Base Load Power Hub (BLPH)**	**PR.23.034.0 - CS-24002463**

The gas detectors are inspected and calibrated as described in this certificate. The used calibration gasses are traceable according to (inter)national standards.
De gasdetectoren zijn geïnspecteerd en gekalibreerd zoals beschreven in dit certificaat. De gebruikte kalibratiegassen zijn traceerbaar vorlgens de (inter)nationale standaards..

950-GDZ-04216	Dräger	Dräger: Polytron 8200	ARTB-1614	FC4576982	N/A	N/A	New Delivery
950-GDZ-04217	Dräger	Dräger: Polytron 8200	ARTB-1610	FC4576983	N/A	N/A	New Delivery
950-GDZ-04218	Dräger	Dräger: Polytron 8200	ARTC-2199	FC4576984	N/A	N/A	New Delivery
950-GDZ-05101	Dräger	Dräger: Polytron 8200	ARTB-1626	FC4576985	N/A	N/A	New Delivery
950-GDZ-05102	Dräger	Dräger: Polytron 8200	ARTB-1623	FC4576986	N/A	N/A	New Delivery
950-GDZ-05103	Dräger	Dräger: Polytron 8200	ARTB-1622	FC4576987	N/A	N/A	New Delivery
950-GDZ-05104	Dräger	Dräger: Polytron 8200	ARSD-0457	FC4576988	N/A	N/A	New Delivery
950-GDZ-05105	Dräger	Dräger: Polytron 8200	ARTB-1612	FC4576989	N/A	N/A	New Delivery
950-GDZ-05106	Dräger	Dräger: Polytron 8200	ARTB-1617	FC4576990	N/A	N/A	New Delivery
950-GDZ-06201	Dräger	Dräger: Polytron 8200	ARTB-1634	FC4576991	N/A	N/A	New Delivery
950-GDZ-06202	Dräger	Dräger: Polytron 8200	ARTB-1629	FC4576992	N/A	N/A	New Delivery


DRÄGER MARINE & OFFSHORE
SIGNED BY: K. VAN UDISSEL

PO# : 123A90

Signed by: .....

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 00

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

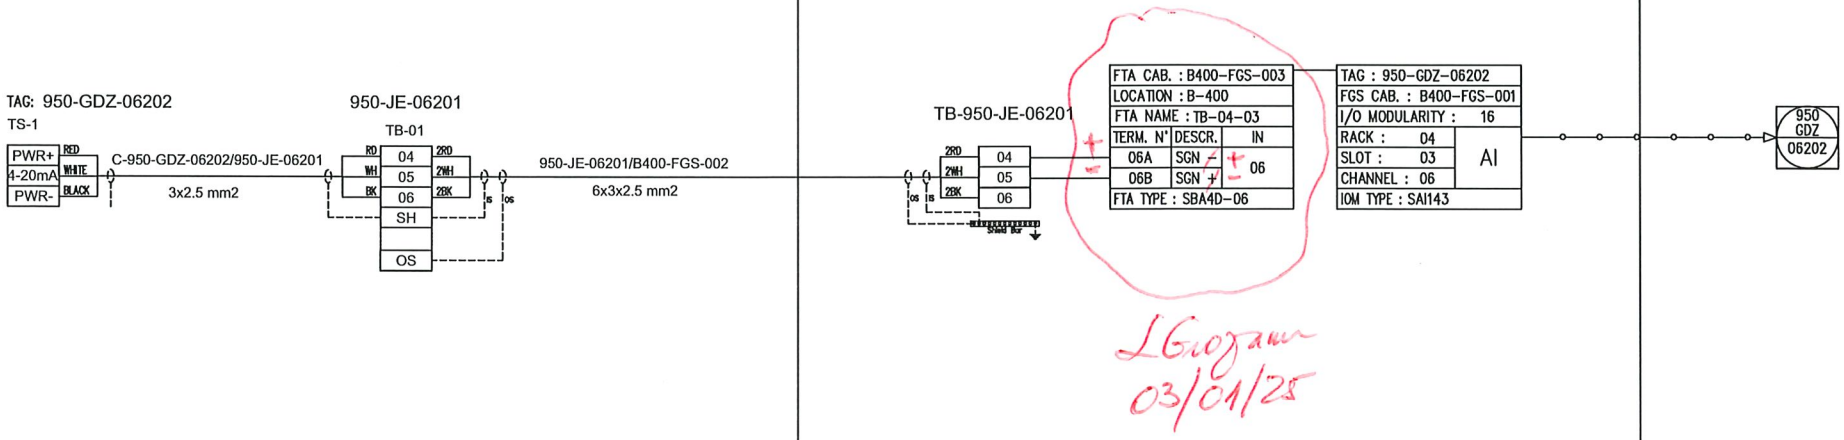

L Grozam
03/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 0_A | DATE: 23/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSRUMENT LOOP DIAGRAM
950-GDZ-06202
FZ-06 H2 DETECT. IN B-100 HVAC AIR INTAKE

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024
A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 261	REV. 00

File Name : 123A90-DDL-IN-DG-40014_REV.00

ITEM	Tag	950-GDZ-06201	: H2 GD FZ-06 B-100 HVAC Air Intake	Dwg	123A90-DDL-SAF-DL-30027
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module	LD_B-100_Ext
TASK	code	C10003078	Location: Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	PRE-COMM	Activity: FTS	Discipline: Instrumental	Form: FJ04G		Gas Detection

Loop Tag: 950-GDZ-06201 TDSL rev.: 0_A

Cabinet: B400-FGS-001 Rack: 04 Slot: 01 Channel: 06

Gas Detection Type: TEXS GTL (Infrared open path gas transmitter): GT (gas transmitter): XTR 0510

Thresholds: Gas Alarm - H 5 % Gas Confirmed - HH 10 %

Scale and Unit: 0-100 % LEL

Calibration checking (following bottle at disposal):

Physical value on transmitter:	0 %	5 %	10 %
ICSS Display:	0 %	5 %	10 %

Checking of Dirty Optical ●

Checking of Invalidity ●

Checking of Maintenance Inhibition ●

Comments:

	Performed by	● WITNESS ☐ REVIEW	● WITNESS ☐ REVIEW
Company	RM	RM COMM	cw
Name	Alejandro Sasia	Giandonato Delmissier	John Mackillop
Date	2025-01-10	2025-01-10	2025-01-11
Signature	Digitaly signed by Alejandro Sasia 2025-01-10T15:31:11.469Z	Digitaly signed by Giandonato Delmissier 2025-01-10T15:32:30.467Z	Digitaly signed by John Mackillop 2025-01-11T09:23:44.538Z

Dräger Polytron® 8200 CAT
Detection of flammable gases and vapors

The Dräger Polytron® 8200 CAT is an advanced explosion-proof transmitter for the detection of combustible gases in the lower explosion limit (LEL). It uses a catalytic bead DrägerSensor® Ex that will detect most flammable gases and vapors. In addition to a 3-wire 4 to 20-mA analog output with relays it also offers HART®, Modbus and Fieldbus protocols, making it compatible with most control systems.



Dräger. Technology for Life®

Benefits

Fast and stable – the DrägerSensor® Ex

The built-in DrägerSensor® Ex is based on the proven catalytic bead measuring principle. It has excellent long-term stability with outstanding poison resistance. And this is the reason for its durability. Due to the novel gas inlet opening, the sensor responds to gas in only a few seconds. This allows you to react immediately with countermeasures and prevent the development of a flammable atmosphere.

Easy device management via digital communication

The Dräger Polytron 8200 is equipped with digital interfaces allowing for quick and easy remote interrogation of the transmitter's state. Integration with existing asset management systems such as PACTware™ is possible via DTM. In addition to the common HART® communication system, the fieldbus interfaces PROFIBUS® PA, FOUNDATION fieldbus™ H1, and Modbus RTU are also available.

Same design, same operating principle

The Dräger Polytron 8200 belongs to the Polytron 8000 series. All transmitters in this series have the same design and user interface. This allows for uniform operation with reduced training and maintenance requirements. The large graphic backlit display shows status information clearly and in an easy to use format. The measured gas concentration, selected gas type, and measuring unit are displayed during normal operation. Colored LEDs (green, yellow and red) provide additional alarm and status information.

The Polytron 8200 is operated by means of a magnetic wand over contact surfaces.

Three relays for controlling external equipment

Upon request, the Dräger Polytron 8200 can also be supplied with three integrated relays. This enables you to use it as an independent gas detection system with two arbitrarily adjustable concentration alarms and one fault alarm. Audible alarms, signal lights or similar devices can thus be controlled locally without an additional cable between the transmitter and central controller.

Safe, robust housing for every application

Polytron 8200 features a Class I, Div. 1 rated explosion proof enclosure made from aluminium or stainless steel, making it suitable for a wide range of environmental conditions.

Make the impossible possible with the remote sensor

A remote explosion proof junction allows installation of the sensor up to 350' away from the transmitter in difficult to access areas. A permanently attached remote calibration adapter allows for remote bump testing or calibration from the Polytron display by using permanently attached tubing that takes the calibration gas to the sensor.

Technical Data

Dräger Polytron® 8200 CAT			
Type	Explosion proof / flameproof enclosed transmitter (“d”)		
Gases	Flammable gases and vapors		
Measuring ranges	DQ	0 to 100 % LEL	
	LC	0 to 10 % LEL	
Display	Backlit graphic LCD; 3 Status LEDs (green/yellow/red)		
Performance Characteristics	Accuracy/repeatability	Zero	≤ 1 % LEL
		Span	≤ 1 % LEL
		Long-term drift	≤ 3 % LEL after 6 months
	Response time	T50	< 7 seconds (methane)
		T90	< 13 seconds (methane)
Electrical data	Signal output analog	Normal operation	4 to 20 mA, 3- or 4-wire, sink or source
		Maintenance	Constant 3.4 mA (adjustable)
		Fault	< 1.2 mA
	Signal output digital	HART® w/ 3- or 4-wire, PROFIBUS® PA, FOUNDATION fieldbus™ H1 and Modbus RTU w/ 5-wires	
	Power supply	10 to 30 V DC	
	Power consumption (max.)	DQ w/o relay, non-remote	105 mA at 24 V
		DQ w/ relay, remote	145 mA at 24 V
	Relay specification (option)	2 alarm relays and 1 fault relay, SPDT 5 A @ 230 VAC, 5 A @ 30 VDC	
Environmental conditions (see sensor data sheet)	Temperature	-40 to 80 °C (-40 to 176 °F) without relay -40 to 70 °C (-40 to 158 °F) with relay- -50 to 85 °C (-122 to 185 °F) remote sensor	
	Pressure	23.6 to 38.4 inch Hg / 800 to 1,200 mbar	
	Humidity	5 to 95% r. h., non-condensing	
Housing	Transmitter housing	Epoxy coated copper-free aluminium or stainless steel SS316 L	
	Sensor housing	Stainless steel 303	
	Enclosure protection type	NEMA 4X & 7, IP65/66/67	
	Cable entry point	3/4" NPT threaded holes or M20 cable gland	
	Dimensions (H x W x D)	11.0" x 5.9" x 5.1" / 280 x 150 x 130 mm	
	Weight, approx.	Aluminium	4.9 lbs / 2.2 kg
		SS316 L	8.8 lbs / 4.0 kg
Approvals*	UL & CSA	Class I, Div 1, Groups A, B, C, D;	
		Class II, Div 1, Groups E, F, G;	
		Class I, Zone 1, Group IIC;	
		T-Code T6/T4	
	IECEx	Ex db IIC T6/T4 Gb, -40 ≤ Ta ≤ +40/+70 °C;	
	ATEX	II 2G Ex db IIC T6/T4 Gb, -40 ≤ Ta ≤ +40/+70 °C;	
	CE markings	ATEX (Directive 2014/34/EU)	
		Electromagnetic Compatibility (Directive 2014/30/EU)	
		Low Voltage (Directive 2014/35/EU)	
	Shipping approvals (for DQ sensor only)	DNV GL, ABS, LR, CCS, RMRS	
	MED approval (for DQ sensor only)	Certificate No. MEDB0000411	

Technical Data

	DEKRA Performance approval (for DQ sensor only)	Certificate No. BVS 13 ATEX G 001 X
	SIL 2 certified by TUEV Sued	Certificate No. Z10 053474 0023

* All docking station versions are only ATEX/IECEx approved

Ordering Information

Dräger Polytron® 8200 CAT	Approval Code	Order Number
Dräger Polytron® 8200 CAT DQ d A 4-20/HART®	XTR 0410	83 44 439
Dräger Polytron® 8200 CAT DQ d A 4-20/HART® relay	XTR 0411	83 44 440
Dräger Polytron® 8200 CAT DQ d S 4-20/HART®	XTR 0510	83 44 448
Dräger Polytron® 8200 CAT DQ d S 4-20/HART® relay	XTR 0511	83 44 449
Dräger Polytron® 8xx0 Kit (Custom configuration e. g. LC sensor or bus communication)		83 44 800

Accessories		Order Number
Magnetic wand		45 44 101
Pipe mount bracket		45 44 198
Aluminum junction box for remote sensor ‘d’		45 44 099
Stainless steel junction box for remote sensor ‘d’		45 44 098
Duct mount kit		68 12 725
IR Connection Kit Polytron® 5000/8000		45 44 197
PolySoft licence (1 year)		83 28 600
PolySoft licence (subscription)		83 28 601
Splash guard		68 12 510
Weather protection kit Dräger Polytron® 5/6/8xxx		37 02 198
Gassing adapter	PE, w/o tubing	68 06 978
	PE incl. tubing	46 09 314
Calibration adapter Viton®		68 10 536
Process adapter (Stainless steel) for DQ		68 12 470
Process adapter (Stainless steel) for LC		68 12 465

HART® is a registered trademark of the HART Communication Foundation.
FOUNDATION fieldbus™ is a registered trademark of the Fieldbus Foundation™.
PROFIBUS® is a registered trademark of PROFIBUS and PROFINET International (PI).
PACTware™ is a registered trademark of Pepperl+Fuchs GmbH.
Viton® is a registered trademark of the DuPont company.
Windows® is a registered trademark of Microsoft Corporation.

Dräger Nederland B.V.
Marine & Offshore
Beurtschipperstraat 1
NL-3194 DK Hoogvliet-RT
Telephone :+31(0)10-2952710
Web: www.draeger-mo.nl
E-mail: service-mo.sd.nl@draeger.com

Calibration Certificate: Gas Detector Polytron 8200 H2

Certificaat: Gas Detector Polytron 8200 H2

Date *Datum*	Validity [months] *Geldigheid [maanden]*	Vessel / Installation *Scheepsnaam / Installatie*	Certificate No *Certificaat Nr*
28-06-2024	**12**	**Base Load Power Hub (BLPH)**	**PR.23.034.0 - CS-24002463**

The gas detectors are inspected and calibrated as described in this certificate. The used calibration gasses are traceable according to (inter)national standards.
De gasdetectoren zijn geïnspecteerd en gekalibreerd zoals beschreven in dit certificaat. De gebruikte kalibratiegassen zijn traceerbaar vorlgens de (inter)nationale standaards..

950-GDZ-04216	Dräger	Dräger: Polytron 8200	ARTB-1614	FC4576982	N/A	N/A	New Delivery
950-GDZ-04217	Dräger	Dräger: Polytron 8200	ARTB-1610	FC4576983	N/A	N/A	New Delivery
950-GDZ-04218	Dräger	Dräger: Polytron 8200	ARTC-2199	FC4576984	N/A	N/A	New Delivery
950-GDZ-05101	Dräger	Dräger: Polytron 8200	ARTB-1626	FC4576985	N/A	N/A	New Delivery
950-GDZ-05102	Dräger	Dräger: Polytron 8200	ARTB-1623	FC4576986	N/A	N/A	New Delivery
950-GDZ-05103	Dräger	Dräger: Polytron 8200	ARTB-1622	FC4576987	N/A	N/A	New Delivery
950-GDZ-05104	Dräger	Dräger: Polytron 8200	ARSD-0457	FC4576988	N/A	N/A	New Delivery
950-GDZ-05105	Dräger	Dräger: Polytron 8200	ARTB-1612	FC4576989	N/A	N/A	New Delivery
950-GDZ-05106	Dräger	Dräger: Polytron 8200	ARTB-1617	FC4576990	N/A	N/A	New Delivery
950-GDZ-06201	Dräger	Dräger: Polytron 8200	ARTB-1634	FC4576991	N/A	N/A	New Delivery
950-GDZ-06202	Dräger	Dräger: Polytron 8200	ARTB-1629	FC4576992	N/A	N/A	New Delivery


PO# : 123A90

Signed by: .....

DRÄGER MARINE & OFFSHORE
SIGNED BY: K. VAN DISSEL

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 00

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

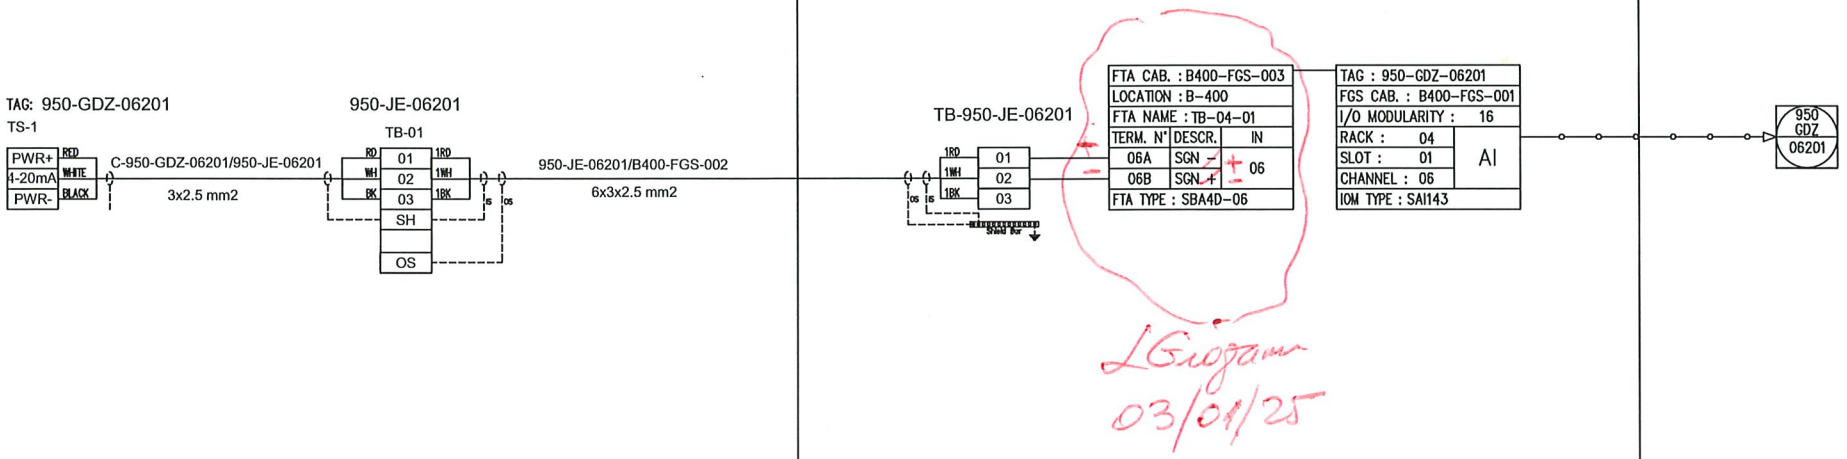

LGiugiaro
03/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 0_A | DATE: 23/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSRUMENT LOOP DIAGRAM
950-GDZ-06201
FZ-06 H2 DETECT. IN B-100 HVAC AIR INTAKE

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 260	REV. 00

File Name : 123A90-DDL-IN-DG-40014_REV.00

ITEM	Tag	950-FDZ-06101	: Flame Detector - FZ-06 B-100 Area	Dwg	123A90-DDL-SAF-DL-30027		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module	LD		
TASK	code	C10003134	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity	FTS	Discipline	Instrumental	Form	FJ04F	Fire Detection

Loop Tag:	950-FDZ-06101			TDSL rev.:	123A90-FDL-IN-DG-40014 rev. 0_a		
Cabinet:	B400-FGS-001	Rack:	04	Slot:	03	Channel:	10
Output Signal:	mA						

Threshold: Fire Alarm - H [ ] Fire Alarm - HH [20mA]

Checking of Dirty optical [●]

Checking of invalidity [●]

Checking of Maintenance inhibition [ ]

TESTING & MEASUREMENT INSTRUMENT USED

Type	Serial N.	Calibration Certificate	Validity
FLS-FSIM-UV-IR	1544		

Comments:

	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM COMM	RM COMM	cw
Name	Laurentiu Grozavu	Giandonato Delmissier	John Mackillop
Date	2025-01-10	2025-01-10	2025-01-11
Signature	Digitaly signed by Laurentiu Grozavu 2025-01-10T13:46:30.981Z	Digitaly signed by Giandonato Delmissier 2025-01-10T15:29:16.438Z	Digitaly signed by John Mackillop 2025-01-11T09:24:09.673Z

FlameSpec
UV-IR
UV-IR Flame Detector



The FlameSpec UV-IR will detect fires and explosions extremely quickly, thereby allowing mitigation steps to be initiated more rapidly to limit event escalation.

Introduction

The FlameSpec-UV-IR flame detector provides ultra-fast response, high performance and reliable detection of a large variety of fires including hydrocarbon fires (visible and non-visible), as well as hydrogen and methane/hydrogen mixed fires. The detector addresses slow growing fires as well as fast eruptions of fire using improved UV-IR technology. The detector operates in all weather and light conditions.

Key Benefits

- High immunity to false alarm
- High sensitivity – up to 100 ft. (30m) for a 1 ft^2 (0.1m^2) n-heptane pan fire.
- Hydrocarbon and non-hydrocarbon flame detection.
- Ultra-fast detection mode detection within 5 milliseconds for fireballs or explosions
- High speed (<0.5s) model [X5] available for compliance with NFPA 33.
- Four sensitivity levels.
- Universal outputs, 3 and 4 wire, 4-20 mA sink / source, Fire, Auxiliary and Fault Relays. RS485 port using Modbus RTU.
- Event logger – alarms, faults and other relevant events are logged to non-volatile memory
- Built-in-Test (BIT) – Automatic and manual self-test of window cleanliness and overall detector operation.
- Dirty optics warning for preventive maintenance needs.
- HART® 7, for configuration & maintenance - option available.
- Window heater to avoid condensation and icing.
- Stainless steel tilt mount with horizontal and vertical adjustment.
- Functional safety - SIL 2 capable - option available.
- Detect high UV (sparks and arcs) or IR levels via auxiliary relay and 4-20mA.

Fire and Gas Detection Technologies Inc. | 4222 E. La Palma Ave. Anaheim, CA 92807 USA
Tel: (+1) 714-671-8500 | support@fg-detection.com
Version: F110V0010.08 • May 2023

FlameSpec UV-IR

UV-IR Flame Detector

Model: FLS-UV-IR

Response Characteristics

Fuel	Size	Sensitivity	Distance ft. (m)	Avrg Resp.Time (s)
N-Heptane	1 x 1 ft.	Extreme	98 (30)	2.0
N-Heptane	1 x 1 ft.	High	75 (23)	1.7
N-Heptane	1 x 1 ft.	Medium	49 (15)	1.0
N-Heptane	1 x 1 ft.	Low	16 (5)	1.0
Gasoline	2 x 2 ft.	Extreme	197 (60)	3.3
Gasoline	1 x 1 ft.	Extreme	98 (30)	1.8
Gasoline	1 x 1 ft.	Medium	49 (15)	1.3
Methane	32-in Plume	Extreme	59 (18)	1.4
Methane	32-in Plume	Medium	30 (9)	0.9
LPG	32-in Plume	Extreme	75 (23)	1.2
LPG	32-in Plume	High	56 (17)	1.6
LPG	32-in Plume	Medium	33 (10)	1.2
LPG	32-in Plume	Low	13 (4)	1.2
Diesel	1 x 1 ft.	Extreme	75 (23)	2.6
Diesel	1 x 1 ft.	Medium	36 (11)	1.2
JP5	1 x 1 ft.	Extreme	75 (23)	3.3
JP5	1 x 1 ft.	High	56 (17)	1.8
JP5	1 x 1 ft.	Medium	36 (11)	1.2
JP5	1 x 1 ft.	Low	16 (5)	1.2
Kerosene	1 x 1 ft.	Extreme	75 (23)	1.8
Kerosene	1 x 1 ft.	Medium	36 (11)	0.9
Methanol	1 x 1 ft.	Extreme	52 (16)	0.8
Methanol	1 x 1 ft.	High	43 (13)	3.2
Methanol	1 x 1 ft.	Medium	30 (9)	1.3
Methanol	1 x 1 ft.	Low	10 (3)	2.7
Ethanol	1 x 1 ft.	Extreme	62 (19)	4.1
Ethanol	1 x 1 ft.	Medium	31 (9.5)	2.9
Isopropanol	1 x 1 ft.	Extreme	75 (23)	2.2
Isopropanol	1 x 1 ft.	Medium	36 (11)	0.8
Polypropylene	1 x 1 ft.	Extreme	49 (15)	1.4
Polypropylene	1 x 1 ft.	Medium	23 (7)	0.9
Hydrogen	32-in Plume	Extreme	66 (20)	6.4
Hydrogen	32-in Plume	Medium	33 (10)	1.0
Syngas (30%CH_4:70%H_2)	32-in Plume	Extreme	59 (18)	3.2
Syngas (30%CH_4:70%H_2)	32-in Plume	Medium	33 (10)	1.2

FlameSpec UV-IR

UV-IR Flame Detector

Model: FLS-UV-IR

Immunity to False Alarm

False Alarm Source	Modulated		Unmodulated	
	Distance ft. (m)	Response	Distance ft. (m)	Response
Sunlight, Direct, Reflected		No Alarm		No Alarm
Incandescent frosted glass light, 300W	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Fluorescent, 70W (3x23.3W)	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Electric arc	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Arc welding	10.0 (3.0)	No Alarm	10.0 (3.0)	No Alarm
Radiation heater, 2000W	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Halogen lamp (500W) non-shielded	7.0 (2.0)	No Alarm	7.0 (2.0)	No Alarm
Halogen lamp (1000W)	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Mercury vapor lamp 160Wx3	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Exhausts	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Projector led	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Solenoid bell	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
soldering iron	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Electric Drill	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm

FlameSpec UV-IR

UV-IR Flame Detector

Model: FLS-UV-IR

FIRE DETECTION	**Detection time and distance**	5ms for fast burst of explosion 1s for 1 ft² (0.1m²) n-heptane pan fire at 0–50 ft. (0–15m) < 2s for 1 ft² (0.1m²) n-heptane pan fire at 50–100 ft. (15–30m)
	Sensitivity Range	4 sensitivity ranges: Extreme, High, Medium, Low
	Field of view (IR detection)	90° Horizontal, 80° Vertical
	Time Delay	0-30 seconds
	Built in Test	Automatic and Manual
ELECTRICAL SPECIFICATIONS	**Operating Voltage**	24 VDC nominal (18-32 VDC)
	Current Consumption	Standby: 120mA 180mA all systems in operation (including window heater)
	Electrical Entries	2x cable and conduit entries 3/4" NPT(F) or M25x1.5
	Wiring	14-17 AWG (2.5–1.0 mm²)
OUTPUTS	**Relays**	SPST volt-free contacts rated 2A at 30 VDC 3 relays: Alarm & Auxiliary – normally open; Fault – normally closed
	0-20mA (stepped) current output	3 wire and 4 wire (isolated) configurations (sink and source) HART® rev 7.0 (option available)
	Indication	Tri-color LED (Green, Yellow, Red)
	Modbus	RTU compatible on RS-485
MECHANICAL SPECIFICATIONS	**Size**	5.51 x 3.54 × 3.54" (140×90×90mm)
	Weight	Detector (Stainless Steel 316): 6.6 lbs. (3.0 kg) Tilt mount (Stainless Steel 316): 3.3 lbs. (1.5 kg)
ENVIRONMENTAL SPECIFICATIONS	**Temperature Range**	Operating: -67°F to +185°F (-55°C to +85°C) Storage: -67°F to +185°F (-55°C to +85°C)
	Humidity	Up to 99% (RH), non-condensing
	Ingress Protection	IP66 & 68 (2m, 24hr); NEMA 4X & 6P
APPROVALS	**ATEX**	ATEX: II 2 G D Ex db IIC T5 Gb or Ex db eb IIC T5 Gb and Ex tb IIIC T95°C Db -55°C<Ta<75°C Ex db IIC T4 Gb or Ex db eb IIC T4 Gb and Ex tb IIIC T105°C Db -55°C<Ta<85°C
	IECEx, INMETRO & PESO	Ex db IIC T5 Gb -50°C≤Ta≤75°C Ex db IIC T4 Gb -50°C≤Ta≤85°C
	FMus & FMc	Class I, Div. 1, Groups B, C & D; T4 Class I, Zone 1, AEx/Ex db IIC T4 Gb T4 -50°C≤Ta≤85°C T5 -50°C≤Ta≤75°C
	EAC CU TR	1Ex d IIC T5 Gb or 1Ex de IIC T5 Gb and Ex tb IIIC T95°C Db -55°C≤Ta≤75°C 1Ex d IIC T4 Gb or 1Ex de IIC T4 Gb and Ex tb IIIC T105°C Db -55°C≤Ta≤85°C
	Performance	ANSI FM 3260 EN 54-10
	Functional safety	Certified SIL2 capable per IEC 61508:2010 High & Low demand (option available)

ACCESSORIES	**Tilt mount, model FLS-TMO-S01**	**High vibration mounting bracket, model FLS-MIL-S01**
	Weather cover, model FLS-WCO-S01	**Flame simulator, model FLS-FSIM-UV-IR-KIT**
	2" & 3" pole mount adapter, model FLS-PMA-S23	**Airshield, model FLS-ASD-S01**
	Duct mount with window, model FLS-DMW-S01	**Duct mount for airshield, model FLS-DMX-S01**
WARRANTY	**5 years**	

FlameSpec
FLS-FSIM
Flame Simulator Family



The FlameSpec Flame Simulator range provides fast and convenient detector verification in the field.

Introduction

Flame simulators are often used by industry to perform detector testing during commissioning and periodic system testing. FlameSpec simulators differ from many competing products because they test the active sensors and detection algorithms of the devices without using "bypass" techniques to trick the detector into responding.

The FSIM range is lightweight, simple to use and has a modern ergonomic design. Suitable for use in hazardous areas, the FSIM-IR3 has an extended trigger distance of up to 30 feet (10 meters) from the detector.

Three FSIM models are available, depending on the FlameSpec Detector to be tested, IR3, IR3-H2 and UV-IR.

Key Benefits

- Tests the active sensors and detection algorithms, without using "bypass" techniques.
  - No tricks, detector performance assured.
- Works from distance up to 30 feet (10 meters).
  - Reduces the need for scaffolding.
- Hazardous area use approved.
  - Hot work permits not needed required.
- Lightweight and simple to use.
  - More than 1,000 activations between charges.
- Includes carrying strap, protective storage case, battery charger and operating instructions.
- Easy to transport & supplied with everything needed.
- Complementary to FlameSpec Detector inbuilt test features.
  - Enables full end to end (loop) system test.

Fire and Gas Detection Technologies Inc. | 4222 E. La Palma Ave., Anaheim, CA 92807
Tel: (+1) 714-671-8500 | support@fg-detection.com
Version: F300V0010.04 • Oct 2023

FlameSpec-FLS-FSIM


Flame Simulator Family

	Simulator Kits Part Nos	FLS-FSIM-IR3-KIT	FLS-FSIM-IR3-H2-KIT	FLS-FSIM-UV-IR-KIT
	Detector type	FLS-IR3[1] FLS-IR3-HD[1]	FLS-IR3-H2 FLS-IR3-H2-HD	FLS-UV-IR FLS-UV-IR-HD
OPERATION DISTANCES	**Detector Sensitivity**	ft. m	ft. m	ft. m
	Extreme	30 9.0	30 9.0	42.5 13.0
	High	20 6.0	20 6.0	26 8.0
	Medium	10 3.0	10 3.0	20 6.0
	Low	3.3[2] 1.0[2]	3.3[2] 1.0[2]	6.6 2.0
ELECTRICAL SPECIFICATIONS	**Operating Voltage nominal, V**	3.7	3.7	3.7
	Number of activations between charging	~1000	~1000	~50
	Battery Capacity, mAh	>3000	>3000	>3000
	Charging time, hours	up to 3	up to 3	up to 3
	Indication	3 Color LED (Green, Yellow, Red)		
	All Simulator Models			
MECHANICAL SPECIFICATIONS	**Size**	3.9 x 3.9 x 7.8" (100 x 100 x 200mm)		
	Weight	3.96 lbs. (1.8 kg)		
	Simulator Enclosure Material	Painted Aluminum LM25		
ENVIRONMENTAL SPECIFICATIONS	**Ingress Protection**	IP65 (NEMA 4X)		
	Humidity	up to 99% (RH), non-condensing		
	Operating temperature	Min: −4°F (−20°C) Max: +122°F (+50°C)		
APPROVALS	**Explosion proof**	ATEX Ex II 2 G Ex db ib op is IIC T6 Gb Ex II 2 D Ex tb ib op is IIIC T85°C Db -20°C<Ta<+50°C		
ACCESSORIES included in kits	**Carrying Case**	FLS-FSIM-CASE		
	Carrying Strap	FLS-FSIM-STRAP		
	Cover Tool	FLS-FSIM-TOOL		
	Allen Key	FLS-FSIM-ALLEN		
	Battery Charger	FLS-FSIM-CHRGR		
WARRANTY	**3 Years**			

[1]not CO2L variant
[2]with collimator removed

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 00

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

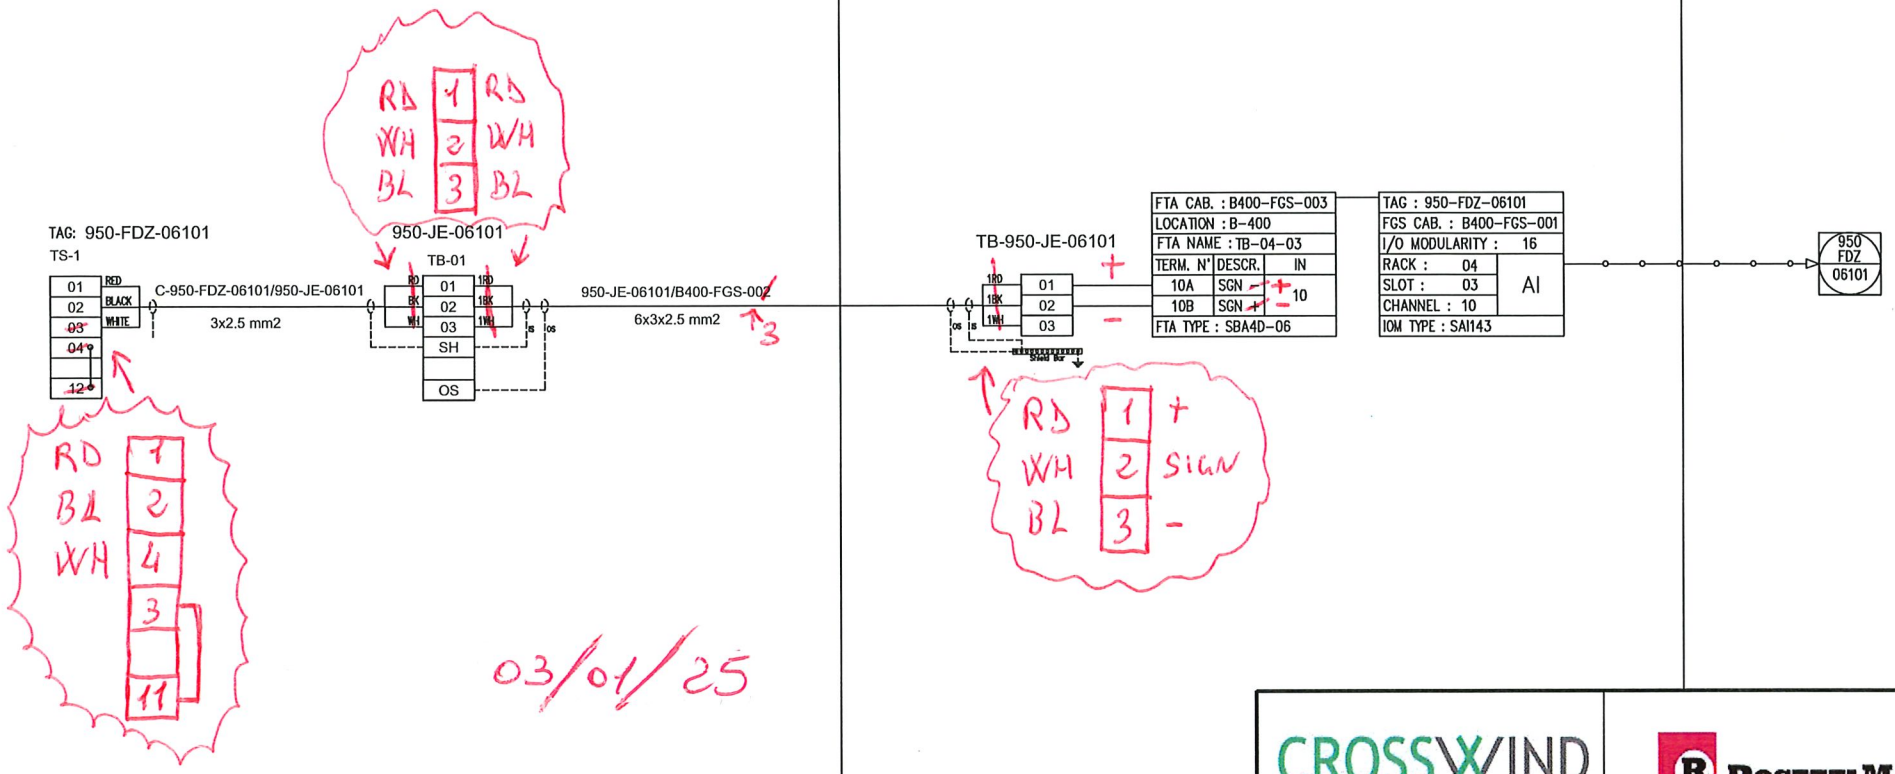

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 0_A | DATE: 23/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSRUMENT LOOP DIAGRAM
950-FDZ-06101
FZ-06 FLAME DETECT. IN B-100/TRANSFORMER AREA

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 197	REV. 00

File Name : 123A90-DDL-IN-DG-40014_REV.00

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	77-HY-001	: B-100 Fire Damper AHU1 Inlet Air		Dwg	123A90-DDL-IN-LIS-40089	
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)		Module		
TASK	code	C10003776	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	COMM	Activity FTS	Discipline Instrumental	Form	FJ01D	Digital Loop

LOOP DATA

Loop TAG	77-HY-001				TSLD	123A90-FDL-IN-DG-40014 rev.1-A			
IO Type	Input	No	Output	Yes	Energy by transmitter	No	Energy by system	Yes	
Marshalling	B400-FGS-001	Terminal	09A/09B		Slot	07	Rack	05	Chanel 09

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	Yes	Alarm/trip	No	OK
4	De-Energise Loop (open loop) and record status	Normal	Yes	Alarm/trip	No	OK
5	Record Fail Safe position	Open	NA	Closed	NA	NA

LOOP SERVICE

		Action	Alarm / Control			Display	
		Trip	GA	DCS	SOE	DCS	
6	Loop energized	No	Yes	Yes	Yes	OK	OK
7	Loop not energized	No	Yes	Yes	Yes	OK	OK
8	Checking of line monitoring	NA	NA	NA	NA	NA	NA
9	Checking of Maintenance Inhibition	Yes	Yes	Yes	Yes	OK	OK
10	Associated safety Level / bar						NA
11	Associated outputs						NA

LOOP DOCUMENTATION

12	Loop diagram is marked up and attached to this test sheet	OK
13	Cause and effect chart is highlighted accordingly	OK
14	Any defect is recorded for punch list issuance	NA

TESTING & MEASUREMENT INSTRUMENT USED

Type	Serial N.	Calibration Certificate	Validity
MULTIMETER FLUKE	AW1/018 17140769	7715/24	10/07/2025

Comments:

	Performed by	WITNESS ☑ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM COMM		
Name	Laurentiu Grozavu	Anthony Iveson	Martin Taylor
Date	2025-07-08	2025-07-09	2025-07-09

PROVERLIS Digitaly signed by Laurentiu Grozavu 2025-07-08T13:17:14.045Z


PROVERLIS Digitaly signed by Anthony Iveson 2025-07-09T09:47:02.221Z

PROVERLIS Digitaly signed by Martin Taylor 2025-07-09T13:13:18.220Z

Signature			

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 01

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

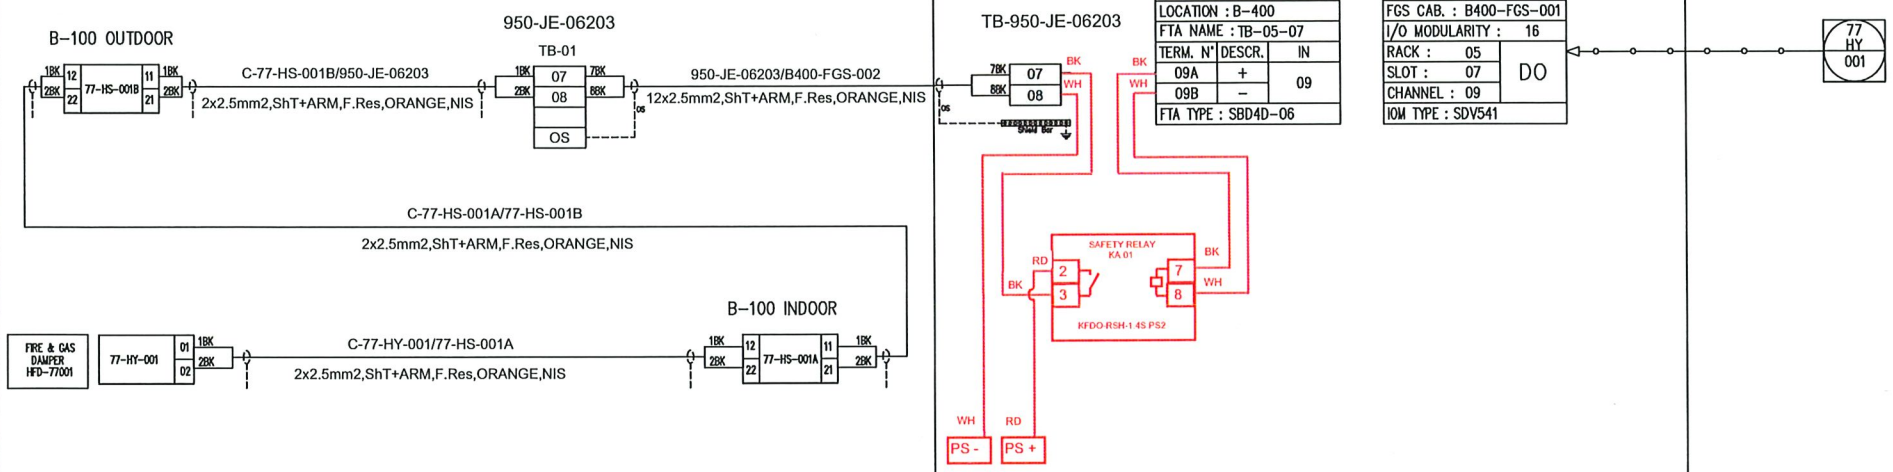

AS COMMISSIONING MARK UP
LAURENTIU GROZAVU
12/05/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	06/12/2024	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV: 1_A | DATE: 20/12/24 | SIGNATURE: C.Pilato
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSTRUMENT LOOP DIAGRAM
77–HY–001
B–100 FIRE DAMPER AHU1 INLET AIR

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024


A3	DRAWING NO. 123A90–DDL–IN–DG–40014	SHEET 356	REV. 01

File Name : 123A90-DDL-IN-DG-40014_REV.01

Electrical actuator
SCHISCHEK

Description		On-off 3-pos., spring-return, 2 micro switches, IP66
Torque		15Nm
Power		24...240VAC/DC (at rest 5W)
Angle of rotation		95°
Running time	(M)	3s / 15s / 30s / 60s / 120s
		3s / 10s
Dimensions (LxWxH)		210x95x80mm
Shaft		square 12x12mm

..Pro-TT




Safety temperature trigger
Thermal fuse
(Available for 72-95°C)

Model	InMax 15-BF	RedMax 15-BF	ExMax 15-BF
			
Zone	SAFE AREA	ATEX AREA ZONE 2, 22 GAS + DUST	ATEX AREA ZONE 1, 2, 21, 22 GAS + DUST

ELECTRICAL INSTALLATION

For 3-pos variation: add orange connection (a and b on 3 and 4)
For standard wiring: Spring return in 10s
For additional wiring on terminal 5: Spring return in 3s

On-off / 3 pos. - spring return + tripping circuit

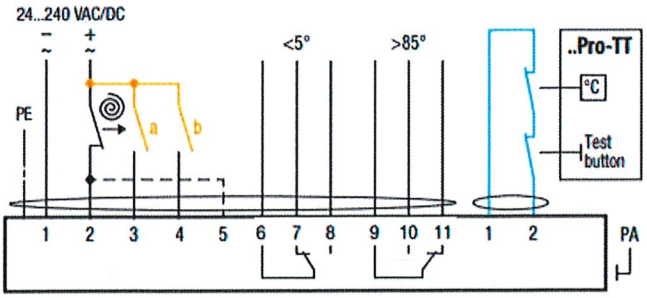

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	77-ZSL-001	: B-100 Fire Damper AHU1 Inlet Air	Dwg	123A90-DDL-IN-LIS-40089		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module			
TASK	code	C10003777	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity FTS	Discipline	Instrumental	Form FJ01D	Digital Loop

LOOP DATA

Loop TAG	77-ZSL-001			TSLD	123A90-FDL-IN-DG-40014 rev.1_A				
IO Type	Input	Yes	Output	No	Energy by transmitter	No	Energy by system	Yes	
Marshalling	B400-FGS-001	Terminal	01A/01B	Slot	03	Rack	05	Chanel	01

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	NA	Alarm/trip	NA	NA
4	De-Energise Loop (open loop) and record status	Normal	NA	Alarm/trip	NA	NA
5	Record Fail Safe position	Open	NA	Closed	NA	NA

LOOP SERVICE

		Action	Alarm / Control			Display	
		Trip	GA	DCS	SOE	DCS	
6	Loop energized	No	Yes	Yes	Yes	OK	OK
7	Loop not energized	No	Yes	Yes	Yes	OK	OK
8	Checking of line monitoring	NA	NA	NA	NA	NA	NA
9	Checking of Maintenance Inhibition	NA	NA	NA	NA	NA	NA
10	Associated safety Level / bar						NA
11	Associated outputs						NA

LOOP DOCUMENTATION

12	Loop diagram is marked up and attached to this test sheet	OK
13	Cause and effect chart is highlighted accordingly	OK
14	Any defect is recorded for punch list issuance	NA

TESTING & MEASUREMENT INSTRUMENT USED

Type	Serial N.	Calibration Certificate	Validity
MULTIMETER FLUKE	AW1/018 17140769	7715/24	10/07/2025

Comments:

	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM COMM		CW COMM
Name	Laurentiu Grozavu	Giandonato Delmissier	Jamie McAllister
Date	2025-05-01	2025-05-16	2025-05-22

PROVERLIS Digitaly signed by Laurentiu Grozavu 2025-05-01T08:55:21.820Z

PROVERLIS Digitaly signed by Giandonato Delmissier 2025-05-16T12:06:59.758Z

PROVERLIS Digitaly signed by Jamie McAllister 2025-05-22T09:47:41.129Z

Signature			

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 01


B-100

ITER – B400

FIRE AND GAS SYSTEM

CENTRAL CONTROL ROOM

OPERATOR CONSOLE

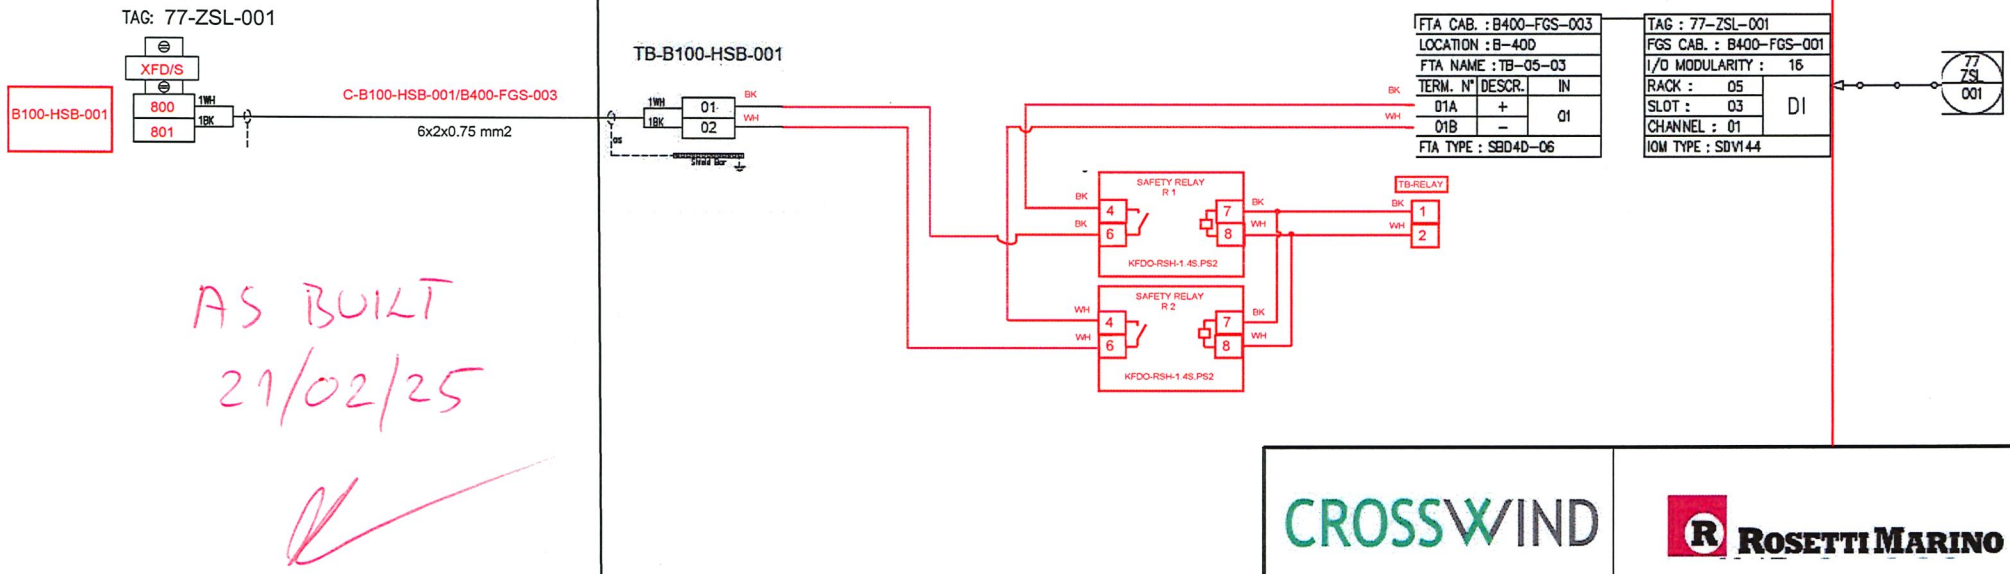

AS BUILT
21/02/25

CROSSWIND

ROSETTI MARINO

TITLE : INSTRUMENT LOOP DIAGRAM
77–ZSL–001
B–100 FIRE DAMPER AHU1 INLET AIR

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	06/12/2024	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 1_A | DATE: 20/12/24 | SIGNATURE: C.Pilato
ROSETTI MARINO SpA

CONTRACT NO./TITLE CONTRACT_NO. | SCALE 1:1
DRAWN: VBA | CHECKED: LCA | APPROVED: DLO | DATE 23/10/2024
A3 | DRAWING NO. 123A90–DDL–IN–DG–40014 | SHEET 307 | REV. 01

File Name : 123A90-DDL-IN-DG-40014_001.01

Electrical actuator
SCHISCHEK

Description		On-off 3-pos., spring-return, 2 micro switches, IP66
Torque		15Nm
Power		24...240VAC/DC (at rest 5W)
Angle of rotation		95°
Running time	M	3s / 15s / 30s / 60s / 120s
		3s / 10s
Dimensions (LxWxH)		210x95x80mm
Shaft		square 12x12mm

..Pro-TT




Safety temperature trigger
Thermal fuse
(Available for 72-95°C)

Model	InMax 15-BF	RedMax 15-BF	ExMax 15-BF
			
Zone	SAFE AREA	ATEX AREA ZONE 2, 22 GAS + DUST	ATEX AREA ZONE 1, 2, 21, 22 GAS + DUST

ELECTRICAL INSTALLATION

For 3-pos variation: add orange connection (a and b on 3 and 4)
For standard wiring: Spring return in 10s
For additional wiring on terminal 5: Spring return in 3s

On-off / 3 pos. - spring return + tripping circuit

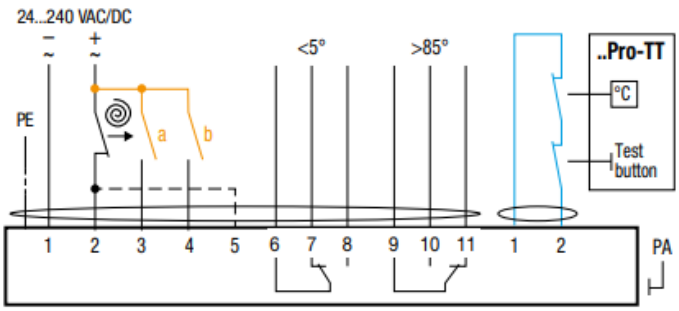

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	77-HY-002	: B-100 Fire Damper AHU2 Inlet Air	Dwg	123A90-DDL-IN-LIS-40089		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module			
TASK	code	C10003778	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity FTS	Discipline	Instrumental	Form FJ01D	Digital Loop

LOOP DATA

Loop TAG	77-HY-002			TSLD	123A90-FDL-IN-DG-40014 rev.1A		
IO Type	Input	No	Output Yes	Energy by transmitter	No	Energy by system	Yes
Marshalling	B400-FGS-001	Terminal	10A/10B	Slot	07	Rack 05	Chanel 010

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	Yes	Alarm/trip	No	OK
4	De-Energise Loop (open loop) and record status	Normal	Yes	Alarm/trip	No	OK
5	Record Fail Safe position	Open	NA	Closed	NA	NA

LOOP SERVICE

		Action	Alarm / Control			Display	
		Trip	GA	DCS	SOE	DCS	
6	Loop energized	No	Yes	Yes	Yes	OK	OK
7	Loop not energized	No	Yes	Yes	Yes	OK	OK
8	Checking of line monitoring	NA	NA	NA	NA	NA	NA
9	Checking of Maintenance Inhibition	Yes	Yes	Yes	Yes	OK	OK
10	Associated safety Level / bar						NA
11	Associated outputs						NA

LOOP DOCUMENTATION

12	Loop diagram is marked up and attached to this test sheet	OK
13	Cause and effect chart is highlighted accordingly	OK
14	Any defect is recorded for punch list issuance	NA

TESTING & MEASUREMENT INSTRUMENT USED

Type	Serial N.	Calibration Certificate	Validity
MULTIMETER FLUKE	AW1/018 17140769	7715/24	10/07/2025

Comments:

	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM	RM COMM	CW Com
Name	Emerik Copkovic	Giandonato Delmissier	Jamie McAllister
Date	2025-02-28	2025-03-05	2025-03-11


PROVERLIS Digitaly signed by Emerik Copkovic 2025-02-28T19:04:44.451Z

PROVERLIS Digitaly signed by Giandonato Delmissier 2025-03-05T09:35:48.898Z

PROVERLIS Digitaly signed by Jamie McAllister 2025-03-11T11:26:59.260Z

Signature			

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 01

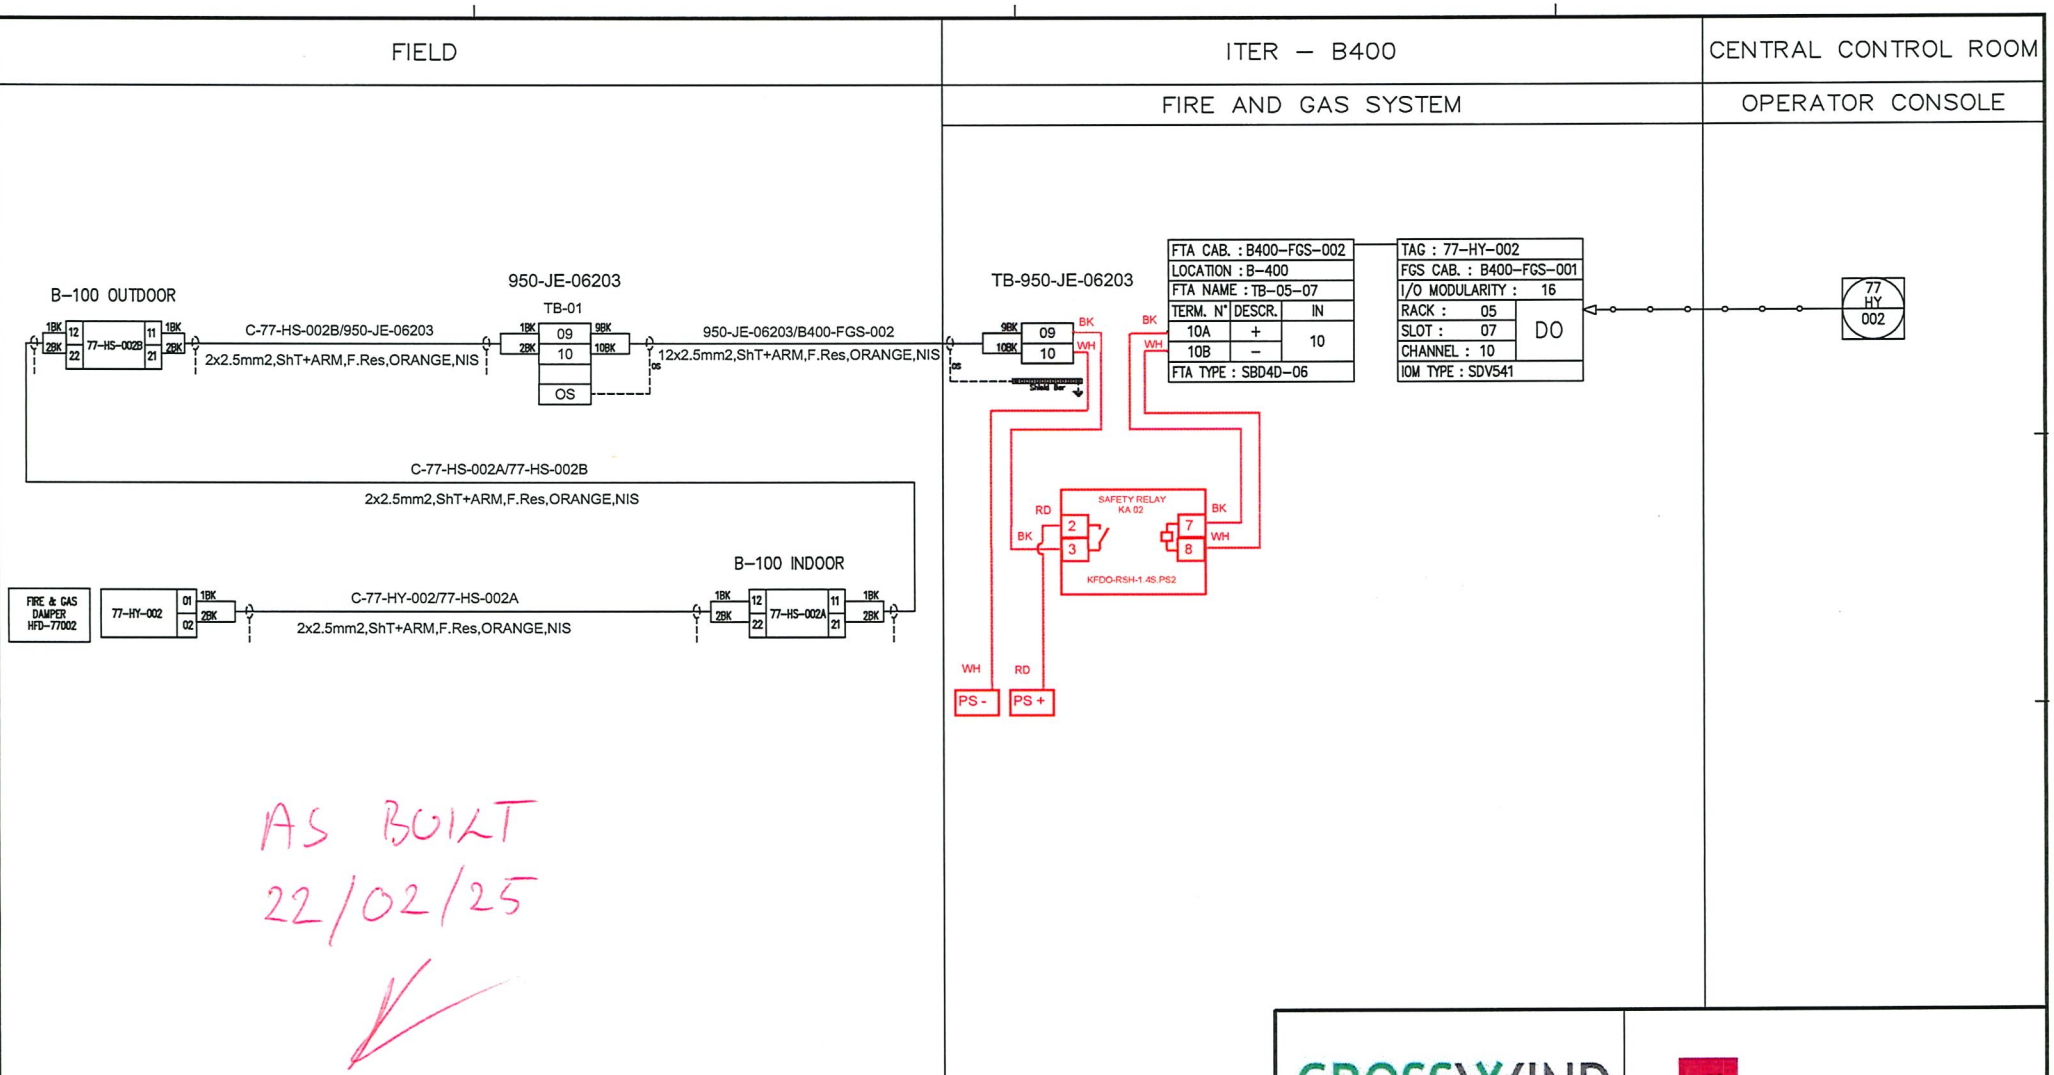

AS BUILT
22/02/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	06/12/2024	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV: 1_A | DATE: 20/12/24 | SIGNATURE: C.Pilato
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSTRUMENT LOOP DIAGRAM
77–HY–002
B–100 FIRE DAMPER AHU2 INLET AIR

CONTRACT NO./TITLE CONTRACT_NO. | SCALE 1:1

DRAWN: VBA | CHECKED: LCA | APPROVED: DLO | DATE 23/10/2024

A3 | DRAWING NO. 123A90–DDL–IN–DG–40014 | SHEET 357 | REV. 01

File Name : 123A90-DDL-IN-DG-40014_REV.01

Electrical actuator
SCHISCHEK

Description		On-off 3-pos., spring-return, 2 micro switches, IP66
Torque		15Nm
Power		24...240VAC/DC (at rest 5W)
Angle of rotation		95°
Running time	M	3s / 15s / 30s / 60s / 120s
		3s / 10s
Dimensions (LxWxH)		210x95x80mm
Shaft		square 12x12mm

..Pro-TT




Safety temperature trigger
Thermal fuse
(Available for 72-95°C)

Model	InMax 15-BF	RedMax 15-BF	ExMax 15-BF
			
Zone	SAFE AREA	ATEX AREA ZONE 2, 22 GAS + DUST	ATEX AREA ZONE 1, 2, 21, 22 GAS + DUST

ELECTRICAL INSTALLATION

For 3-pos variation: add orange connection (a and b on 3 and 4)
For standard wiring: Spring return in 10s
For additional wiring on terminal 5: Spring return in 3s

On-off / 3 pos. - spring return + tripping circuit

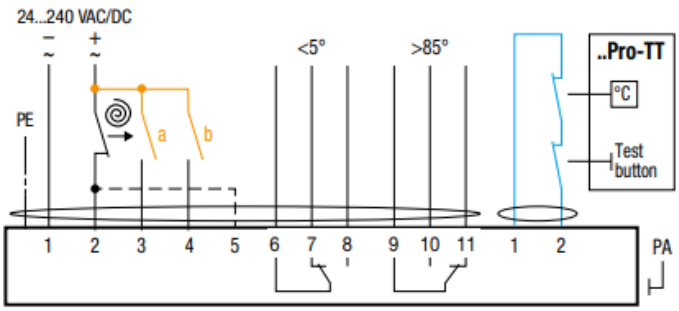

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	77-ZSL-002	: B-100 Fire Damper AHU2 Inlet Air	Dwg	123A90-DDL-IN-LIS-40089		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module			
TASK	code	C10003779	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity	FTS	Discipline	Instrumental	Form	FJ01D	Digital Loop

LOOP DATA

Loop TAG	77-ZSL-002			TSLD	123A90-FDL-IN-DG-40014 rev.1A		
IO Type	Input	Yes	Output	No	Energy by transmitter	No	Energy by system	Yes
Marshalling	B400-FGS-001	Terminal	02A/02B	Slot	03	Rack	05	Chanel	02

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	NA	Alarm/trip	NA	NA
4	De-Energise Loop (open loop) and record status	Normal	NA	Alarm/trip	NA	NA
5	Record Fail Safe position	Open	NA	Closed	NA	NA

LOOP SERVICE

		Action	Alarm / Control			Display	
		Trip	GA	DCS	SOE	DCS	
6	Loop energized	No	Yes	Yes	Yes	OK	OK
7	Loop not energized	No	Yes	Yes	Yes	OK	OK
8	Checking of line monitoring	NA	NA	NA	NA	NA	NA
9	Checking of Maintenance Inhibition	NA	NA	NA	NA	NA	NA
10	Associated safety Level / bar						NA
11	Associated outputs						NA

LOOP DOCUMENTATION

12	Loop diagram is marked up and attached to this test sheet	OK
13	Cause and effect chart is highlighted accordingly	OK
14	Any defect is recorded for punch list issuance	NA

TESTING & MEASUREMENT INSTRUMENT USED

Type	Serial N.	Calibration Certificate	Validity
MULTIMETER FLUKE	AW1/018 17140769	7715/24	10/07/2025

Comments:

	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM	RM COMM	CW Com
Name	Emerik Copkovic	Giandonato Delmissier	Jamie McAllister
Date	2025-02-28	2025-03-05	2025-03-11

PROVERLIS Digitaly signed by Emerik Copkovic 2025-02-28T19:04:58.445Z

PROVERLIS Digitaly signed by Giandonato Delmissier 2025-03-05T09:36:21.262Z

PROVERLIS Digitaly signed by Jamie McAllister 2025-03-11T11:27:42.210Z

Signature			

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 01


B-100

ITER – B400

FIRE AND GAS SYSTEM

CENTRAL CONTROL ROOM

OPERATOR CONSOLE

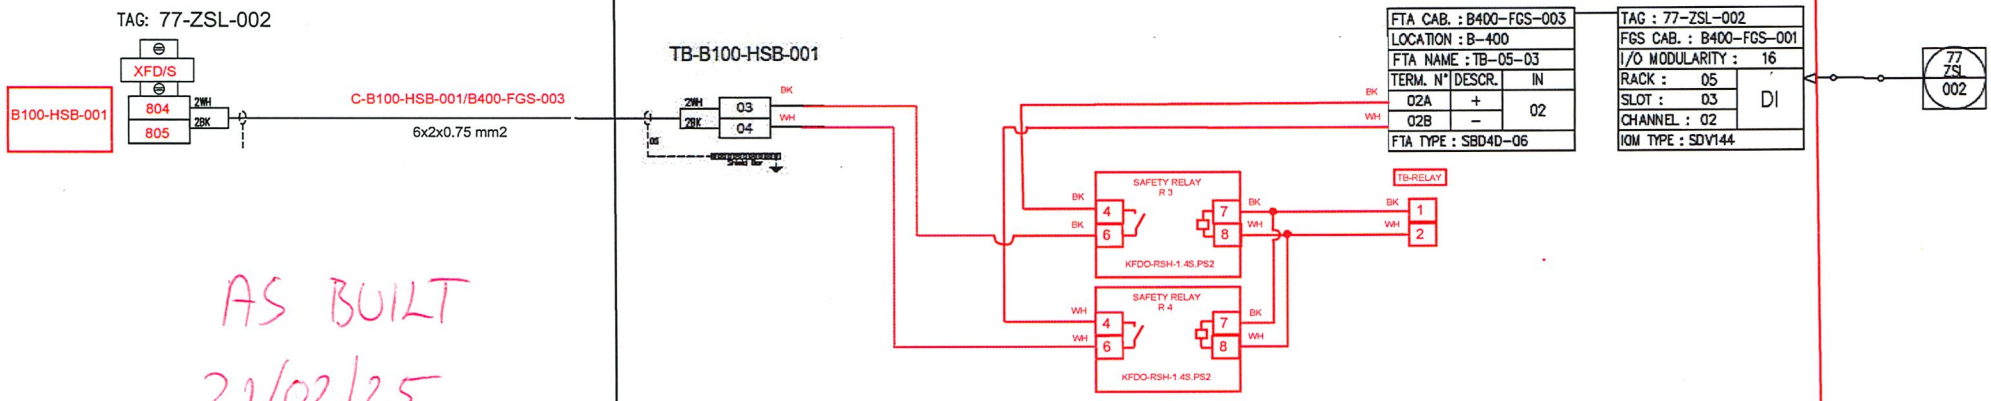

AS BUILT
21/02/25

CROSSWIND

ROSETTI MARINO

TITLE :

INSTRUMENT LOOP DIAGRAM

77–ZSL–002

B–100 FIRE DAMPER AHU2 INLET AIR

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	06/12/2024	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV: 1_A | DATE: 20/12/24 | SIGNATURE: C.Pilato
ROSETTI MARINO SpA

CONTRACT NO./TITLE CONTRACT_NO. | SCALE 1:1

DRAWN: VBA | CHECKED: LCA | APPROVED: DLO | DATE 23/10/2024

A3 | DRAWING NO. 123A90–DDL–IN–DG–40014 | SHEET 308 | REV. 01

File Name : 123A90-DDL-IN-DG-40014_REV01

Electrical actuator
SCHISCHEK

Description		On-off 3-pos., spring-return, 2 micro switches, IP66
Torque		15Nm
Power		24...240VAC/DC (at rest 5W)
Angle of rotation		95°
Running time	M	3s / 15s / 30s / 60s / 120s
		3s / 10s
Dimensions (LxWxH)		210x95x80mm
Shaft		square 12x12mm

..Pro-TT




Safety temperature trigger
Thermal fuse
(Available for 72-95°C)

Model	InMax 15-BF	RedMax 15-BF	ExMax 15-BF
			
Zone	SAFE AREA	ATEX AREA ZONE 2, 22 GAS + DUST	ATEX AREA ZONE 1, 2, 21, 22 GAS + DUST

ELECTRICAL INSTALLATION

For 3-pos variation: add orange connection (a and b on 3 and 4)
For standard wiring: Spring return in 10s
For additional wiring on terminal 5: Spring return in 3s

On-off / 3 pos. - spring return + tripping circuit

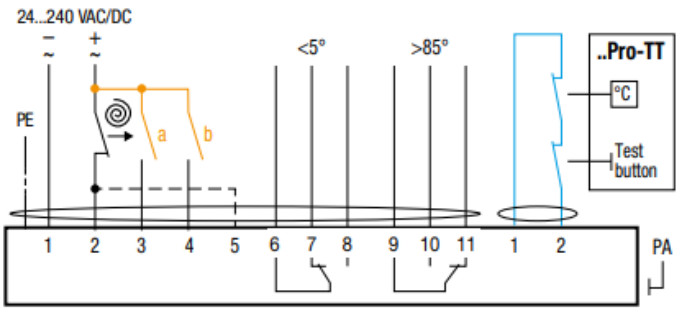

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	77-HY-003	: B-100 Fire Damper Exhaust Air	Dwg	123A90-DDL-IN-LIS-40089		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module			
TASK	code	C10003780	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity	FTS	Discipline	Instrumental	Form	FJ01D	Digital Loop

LOOP DATA

Loop TAG	77-HY-003			TSLD	123A90-FDL-IN-DG-40014 rev.1A		
IO Type	Input	No	Output	Yes	Energy by transmitter	No	Energy by system	Yes
Marshalling	B400-FGS-001	Terminal	10A/10B	Slot	07	Rack	03	Chanel	10

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	Yes	Alarm/trip	No	OK
4	De-Energise Loop (open loop) and record status	Normal	Yes	Alarm/trip	No	OK
5	Record Fail Safe position	Open	NA	Closed	NA	NA

LOOP SERVICE

		Action	Alarm / Control			Display	
		Trip	GA	DCS	SOE	DCS	
6	Loop energized	No	Yes	Yes	Yes	OK	OK
7	Loop not energized	No	Yes	Yes	Yes	OK	OK
8	Checking of line monitoring	NA	NA	NA	NA	NA	NA
9	Checking of Maintenance Inhibition	Yes	Yes	Yes	Yes	OK	OK
10	Associated safety Level / bar						NA
11	Associated outputs						NA

LOOP DOCUMENTATION

12	Loop diagram is marked up and attached to this test sheet	OK
13	Cause and effect chart is highlighted accordingly	OK
14	Any defect is recorded for punch list issuance	NA

TESTING & MEASUREMENT INSTRUMENT USED

Type	Serial N.	Calibration Certificate	Validity
MULTIMETER FLUKE	AW1/018 17140769	7715/24	10/07/2025

Comments:

	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM	RM COMM	CW Com
Name	Emerik Copkovic	Giandonato Delmissier	Jamie McAllister
Date	2025-02-28	2025-03-05	2025-03-11


PROVERLIS Digitaly signed by Emerik Copkovic 2025-02-28T19:05:14.412Z

PROVERLIS Digitaly signed by Giandonato Delmissier 2025-03-05T09:36:43.244Z

PROVERLIS Digitaly signed by Jamie McAllister 2025-03-11T11:28:16.861Z

Signature			

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 01

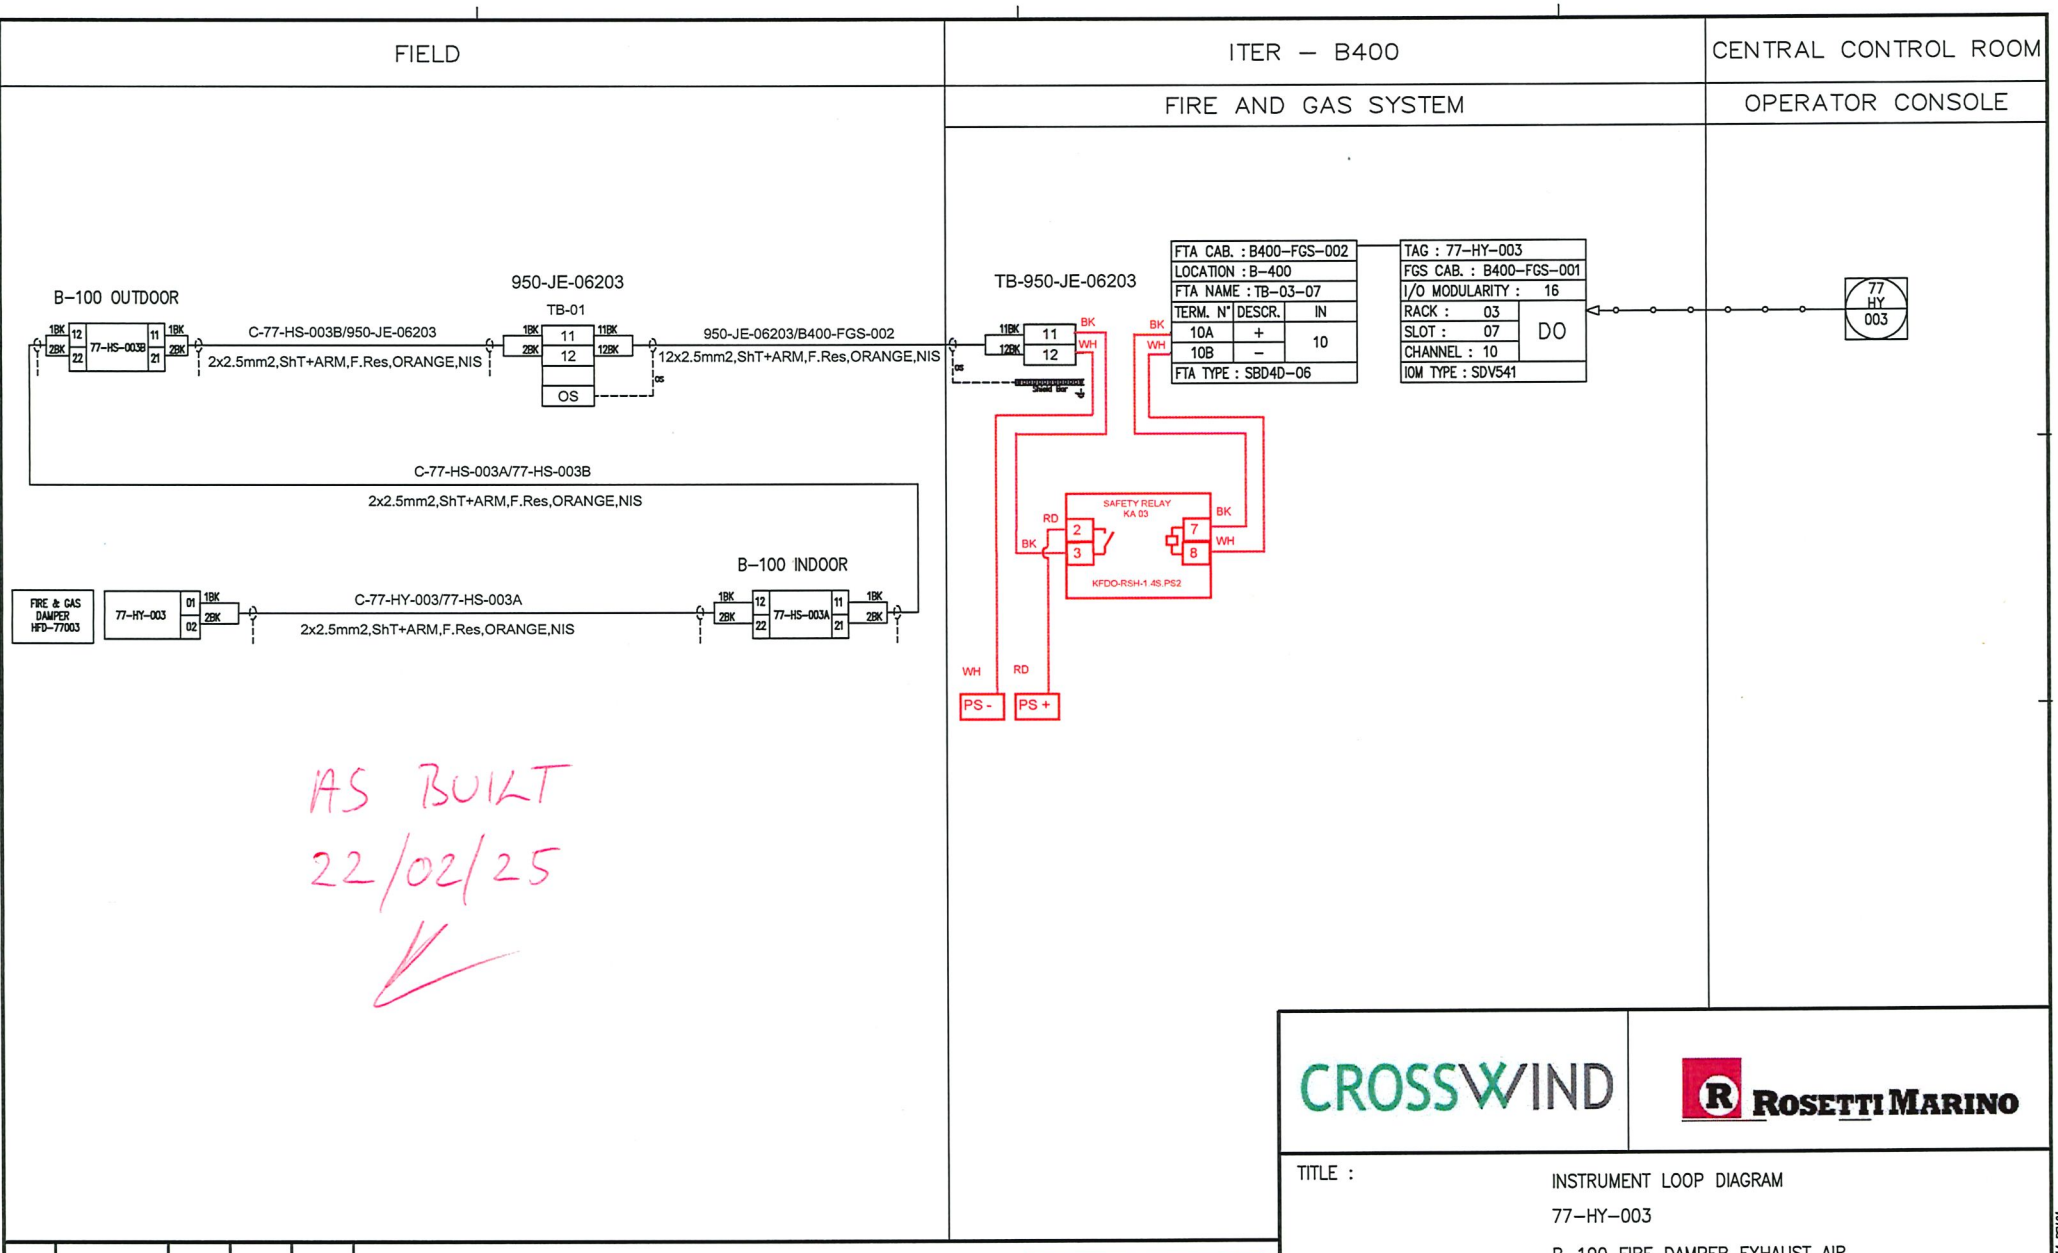

AS BUILT
22/02/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	06/12/2024	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV: 1_A | DATE: 20/12/24 | SIGNATURE: C.Pilato
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSTRUMENT LOOP DIAGRAM
77–HY–003
B–100 FIRE DAMPER EXHAUST AIR

CONTRACT NO./TITLE CONTRACT_NO. | SCALE 1:1
DRAWN: VBA | CHECKED: LCA | APPROVED: DLO | DATE 23/10/2024
A3 | DRAWING NO. 123A90–DDL–IN–DG–40014 | SHEET 358 | REV. 01

File Name : 123A90-DDL-IN-DG-40014_REV.01

Electrical actuator
SCHISCHEK

Description		On-off 3-pos., spring-return, 2 micro switches, IP66
Torque		15Nm
Power		24...240VAC/DC (at rest 5W)
Angle of rotation		95°
Running time	M	3s / 15s / 30s / 60s / 120s
		3s / 10s
Dimensions (LxWxH)		210x95x80mm
Shaft		square 12x12mm

..Pro-TT




Safety temperature trigger
Thermal fuse
(Available for 72-95°C)

Model	InMax 15-BF	RedMax 15-BF	ExMax 15-BF
			
Zone	SAFE AREA	ATEX AREA ZONE 2, 22 GAS + DUST	ATEX AREA ZONE 1, 2, 21, 22 GAS + DUST

ELECTRICAL INSTALLATION

For 3-pos variation: add orange connection (a and b on 3 and 4)
For standard wiring: Spring return in 10s
For additional wiring on terminal 5: Spring return in 3s

On-off / 3 pos. - spring return + tripping circuit

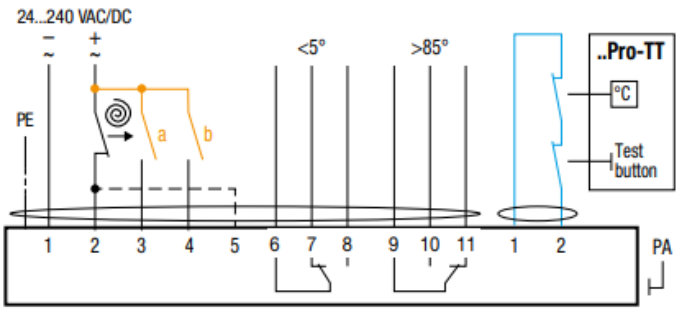

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	77-ZSL-003	: B-100 Fire Damper Exhaust Air	Dwg	123A90-DDL-IN-LIS-40089		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module			
TASK	code	C10003781	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity FTS	Discipline	Instrumental	Form FJ01D	Digital Loop

LOOP DATA

Loop TAG	77-ZSL-003			TSLD	123A90-FDL-IN-DG-40014 rev.1A		
IO Type	Input Yes	Output No		Energy by transmitter	No	Energy by system	Yes
Marshalling	B400-FGS-001	Terminal 03A/03B		Slot 03	Rack 05	Chanel 03	

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	NA	Alarm/trip	NA	NA
4	De-Energise Loop (open loop) and record status	Normal	NA	Alarm/trip	NA	NA
5	Record Fail Safe position	Open	NA	Closed	NA	NA

LOOP SERVICE

		Action	Alarm / Control			Display	
		Trip	GA	DCS	SOE	DCS	
6	Loop energized	No	Yes	Yes	Yes	OK	OK
7	Loop not energized	No	Yes	Yes	Yes	OK	OK
8	Checking of line monitoring	NA	NA	NA	NA	NA	NA
9	Checking of Maintenance Inhibition	NA	NA	NA	NA	NA	NA
10	Associated safety Level / bar						NA
11	Associated outputs						NA

LOOP DOCUMENTATION

12	Loop diagram is marked up and attached to this test sheet	OK
13	Cause and effect chart is highlighted accordingly	OK
14	Any defect is recorded for punch list issuance	NA

TESTING & MEASUREMENT INSTRUMENT USED

Type	Serial N.	Calibration Certificate	Validity
MULTIMETER FLUKE	AW1/018 17140769	7715/24	10/07/2025

Comments:

	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company		RM COMM	CW Com
Name	Emerik Copkovic	Giandonato Delmissier	Jamie McAllister
Date	2025-02-28	2025-03-05	2025-03-11

PROVERLIS Digitaly signed by Emerik Copkovic 2025-02-28T19:05:45.253Z

PROVERLIS Digitaly signed by Giandonato Delmissier 2025-03-05T09:37:11.117Z

PROVERLIS Digitaly signed by Jamie McAllister 2025-03-11T11:28:54.246Z

Signature			

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 01


B-100

ITER – B400

FIRE AND GAS SYSTEM

CENTRAL CONTROL ROOM

OPERATOR CONSOLE

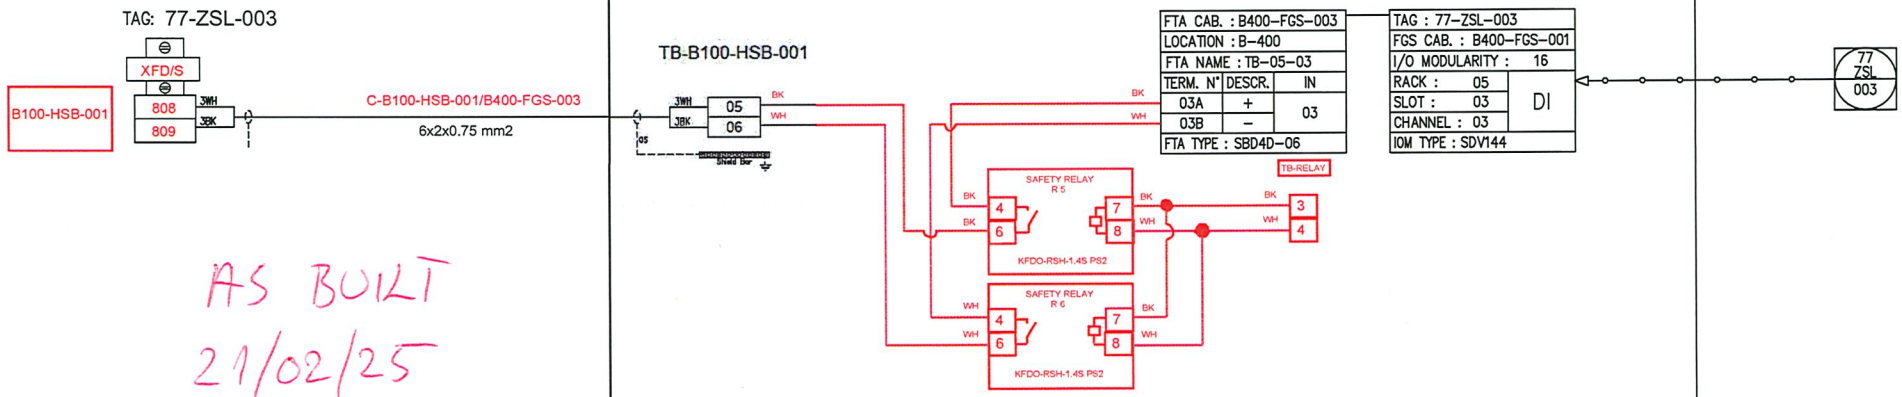

AS BUILT
21/02/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	06/12/2024	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 1_A | DATE: 20/12/24 | SIGNATURE: C.Pilato
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSTRUMENT LOOP DIAGRAM
77-ZSL-003
B-100 FIRE DAMPER EXHAUST AIR

CONTRACT NO./TITLE CONTRACT_NO. | SCALE 1:1

DRAWN: VBA | CHECKED: LCA | APPROVED: DLO | DATE 23/10/2024

A3 | DRAWING NO. 123A90-DDL-IN-DG-40014 | SHEET 309 | REV. 01

File Name : 123A90-DDL-IN-DG-40014_REV01

Electrical actuator
SCHISCHEK

Description		On-off 3-pos., spring-return, 2 micro switches, IP66
Torque		15Nm
Power		24...240VAC/DC (at rest 5W)
Angle of rotation		95°
Running time	M	3s / 15s / 30s / 60s / 120s
		3s / 10s
Dimensions (LxWxH)		210x95x80mm
Shaft		square 12x12mm

..Pro-TT




Safety temperature trigger
Thermal fuse
(Available for 72-95°C)

Model	InMax 15-BF	RedMax 15-BF	ExMax 15-BF
			
Zone	SAFE AREA	ATEX AREA ZONE 2, 22 GAS + DUST	ATEX AREA ZONE 1, 2, 21, 22 GAS + DUST

ELECTRICAL INSTALLATION

For 3-pos variation: add orange connection (a and b on 3 and 4)
For standard wiring: Spring return in 10s
For additional wiring on terminal 5: Spring return in 3s

On-off / 3 pos. - spring return + tripping circuit

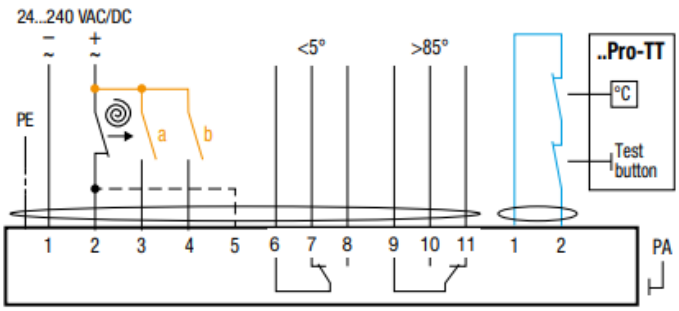

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	950-MFA-06101	: FZ-06 MFA Activation			Dwg	123A90-DDL-SAF-DL-30027
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)			Module	LD
TASK	code	C10004432		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	COMM	Activity FTS	Discipline	Instrumental	Form	FJ04PB_FGS Push Button Fire&Gas

LOOP DATA

Loop TAG	950-MFA-06101				TSLD	123A90-FDL-IN-DG-40014 rev.0_a			
IO Type	Input	Yes	Output	No	Energy by transmitter	No	Energy by system	Yes	
Marshalling	B400-FGS-001	Terminal	07A/07B		Slot	05	Rack	03	Chanel 7

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	Yes	Alarm/trip	Yes	OK
4	De-Energise Loop (open loop) and record status	Normal	NA	Alarm/trip	NA	OK
5	Record Fail Safe position	Open	Yes	Closed	NA	OK

LOOP SERVICE

		Action Fire alarm		Alarm / Control FGS		Display PCS	
6	Loop energized	Yes		Yes		OK	OK
7	Loop not energized	NA		NA		NA	NA
8	Checking of line monitoring	Yes		Yes		OK	OK
9	Checking of Maintenance Inhibition	NA		NA		NA	NA
10	Associated safety Level / bar						NA
11	Associated outputs						NA

LOOP DOCUMENTATION

12	Loop diagram is marked up and attached to this test sheet	OK
13	Cause and effect chart is highlighted accordingly	OK
14	Any defect is recorded for punch list issuance	OK

Comments:

Page 1/1	Performed by	☒ WITNESS ☐ REVIEW	☒ WITNESS ☐ REVIEW
Company	RM COMM	RM COMM	cw
Name	Laurentiu Grozavu	Giandonato Delmissier	John Mackillop
Date	2025-01-10	2025-01-10	2025-01-11
Signature	PROVERLIS Digitaly signed by Laurentiu Grozavu 2025-01-10T12:43:46.089Z	PROVERLIS Digitaly signed by Giandonato Delmissier 2025-01-10T15:29:34.247Z	PROVERLIS Digitaly signed by John Mackillop 2025-01-11T09:24:23.833Z

SM87BG & SM87PB manual call point range

Ex d, Ex ia, weatherproof



Overview

These manual fire alarm, emergency shutdown break-glass and pushbutton units have been designed for the most arduous environmental conditions.

The units are both easy to install and maintain. Intrinsically safe Ex ia and flameproof Ex d versions of each model are available.

A choice of either stainless steel or alloy makes the range suitable for either the offshore or onshore industries. Stainless steel, one of the most durable materials available on the market, is both hard wearing and corrosion resistant, increasing the life of products in harsh environments and therefore reducing maintenance costs.

Features

- Zone 0, Zone 1 and Zone 2 use*
- ATEX certified
- UL listed for USA and Canada (SM87PBL only). Class I, Div 1, Groups C & D
- ULC certified (SM87PBL only) for Class I, Zone 1 Groups C & D
- CSA certified
- IECEx certified
- Brazilian (INMETRO) certified
- Russian Fire certified
- PESO certified (Ex d only)
- SIL 2 certified (SM87PB only)
- IP66 and IP67
- DNV type approval (IEC 60945) (SM87PB only)
- Certified temperature: –55°C to +70°C*
- Stainless steel or marine grade alloy
- Robust yet lightweight
- Easy to maintain

*Model dependent

Eaton
Unit B, Sutton Parkway
Oddicroft Lane
Sutton in Ashfield
United Kingdom
NG17 5FB

T: +44 (0) 1623 444 400
www.crouse-hinds.com/hac
MEDCSales@Eaton.com

© 2024 Eaton
All Rights Reserved
Printed in UK
Publication
No.DSMC0005/H
March 2024

Eaton is a registered trademark.

All other trademarks are property of their respective owners.

Powering Business Worldwide

All specifications, dimensions, weights and tolerances are nominal (typical) and Eaton reserve the right to vary all data without prior notice.
No liability is accepted for any consequence of use.

Certifications


ATEX Ex d	Cert. no. Baseefa03ATEX0075. ATEX Approved Ex II 2GD Certified to: EN60079-0, EN60079-1, EN60079-31 Ex d IIC T5/T6 Gb, Ex tb IIIC T85°C/T100°C Db. IP66/IP67
ATEX Ex ia	Cert no. Baseefa 02ATEX0152X. ATEX Approved Ex II 1GD Certified to: EN60079-0, EN60079-11 Ex ia IIC T4 Ga, Ex ia IIIC T135°C Da
IECEx Ex d	Cert. no. IECEx BAS 09.0060 Certified to: EN60079-0, EN60079-1, EN60079-31 Ex d IIC T5/T6 Gb, Ex tb IIIC T85°/T100°C Db. IP66/IP67
IECEx Ex ia	Cert. no. IECEx BAS 10.0033X Certified to: IEC60079-0, IEC60079-11, Ex ia IIC T4 Ga, Ex ia IIIC T135°C Da
UL	Listing no. E186629 UL listed to Class 1, Div 1. Groups C & D. (SM87PBL)
ULC	Cert. no. 20091023-E320282 ULC certified for Class I, Zone 1 Groups C & D (SM87PBL)
CSA Explosion proof	Class 1, Div 1 & 2. Group D Ex d IIC T5/T6 Gb
CSA Intrinsically safe	Class 1, Div 1 & 2. Groups A-D
INMETRO Ex d	Ex db IIC T5/T6 Gb
Type Approvals	DNV (IEC 60945) (Stainless Steel SM87PB only)
SIL	SM87PB only - SIL2 Certification to IEC61508. Cert no. 20151118-4786827453
CCC	Ex d IIC T5/T6 Gb, Ex tD A21 IP66/IP67 T85°C/T100°C

Specifications


Material	Grade 316 ANC4B stainless steel or LM 25 TF marine grade alloy
Finish	Paint finish as standard or to customer specification
Voltage	Ex d 24V a.c./d.c. Ex ia 28V
Rating	2A
Switches	2 pole c/o, wired to terminals Optional up to 4 pole (UL version 2 pole only)
Optional indicator	A red high intensity LED can be fitted for alarm indication As standard the LED is not provided with over current protection. The forward current (If) should be limited to 20mA
Certified temp	Ex d* –55°C to +70°C. Ex ia* –55°C to +60°C –20°C to +55°C (LED version only) UL –40°C to +70°C, –20°C to +55°C (LED version only) CSA Explosion proof - Class 1, Div 1 & 2. –50°C to +55°C CSA - Ex d IIC –55°C to +70°C CSA Intrinsically safe - Class 1, Div 1 & 2 –50°C to +40°C *Note: includes ATEX, IECEx & INMETRO versions
Weight	3·8 kg. steel (approx.) or 2.5 kg. alloy (approx)
Ingress protection	IP66 & IP67. SM87PB IP68 (35m for 40 hours)
Entries	Up to 4 x M20 or M25 ISO Ex d/Ex ia Up to 4 x ½" or ¾" NPT UL Stainless steel version comes with two entries as standard. Units ordered with a single entry ordering code are supplied with 2x entries inc. plug on the opposite side
Terminals	Will accept up to 1·5mm² cable
Resistor values	470R minimum (d.c. & I.S. units only)

General arrangement drawing (all dimensions in mm)

Break glass

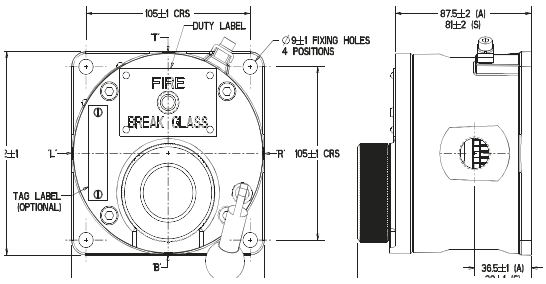

Push button

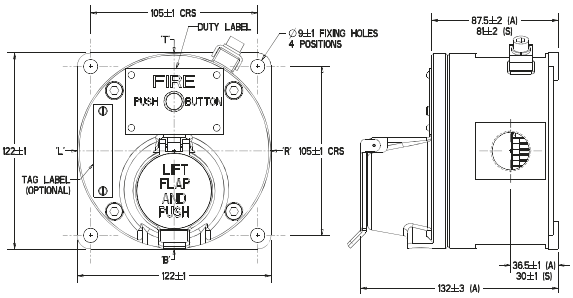

Both the Ex ia units and the Ex d units have the same external appearance. Also the internal components are identical throughout the range. Each unit can be wired for either NO, NC or CO contacts to customer specification

Ordering requirements

The following code is designed to help in selection of the correct unit. Build up the reference number by inserting the code for each component into the appropriate box

Unit	Model	Material	Certification	Entries	Duty label	Tag label	Options	Finish
SM87	PBL	S	D	1B1R	O	Y	HD	R

Material*	Code
Stainless steel	S
Alloy	A

*UL version only available in alloy

Model*	Code
Breakglass latching	BGL
Lift flap breakglass latching	LBGL
Push button latching key reset	PBL
Push button only momentary action	PBM

*UL and ULC versions only available in PBL model

Certification	Code
Ex ia	I
Ex d	D
IECEx - Ex ia	IJ
IECEx - Ex d	DJ
UL	UL
ULC	UC
CSA - Intrinsically Safe	IC
CSA - Ex proof	DC
INMETRO - Ex d	DM
CCC	DQ

Entries	Code
M20	1
M25	2
½" NPT	3
¾" NPT	4
Other	5
Position	
Top	*T
Bottom	*B
RHS	*R
LHS	*L

*Prefix position with size code i.e. 1T1B = M20 Top and Bottom

Duty label	Code
Fire breakglass	1
Push button	2
Fire push button	3
ESDO abandon	4
Burning house logo	5
Fire/FEU	6†
Other	O*
None	N

*Please specify
†This option must be used when ordering a red callpoint for ULC Fire Alarm applications

Tag label	Code
Required	Y*
Not required	N

*Please specify

Options	Code
Not required	N
LED	A
Resistor series	G*
Resistor EOL	H*
Diode	D*
3 pole c/o switch	T
4 pole c/o switch	F


*Please specify

Finish	Code
Red	R
Blue	B
Yellow	Y
Yellow/black stripes	X
Special	S*

*Please specify

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 00

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

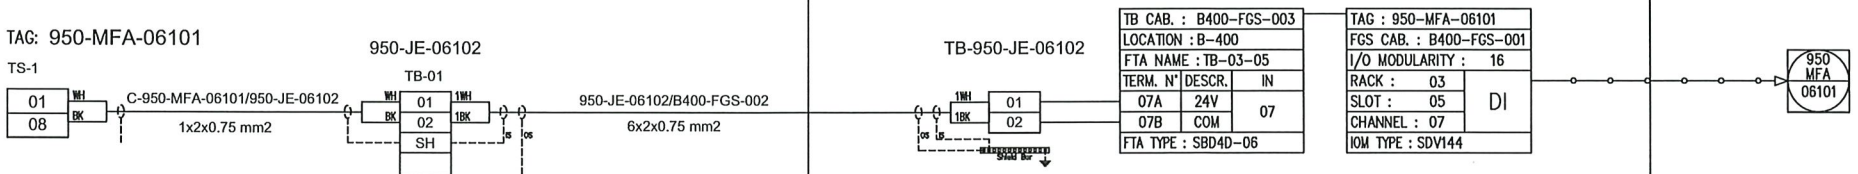

NO MARK UP
Longjam
03/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 0_A | DATE: 23/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE :
INSRUMENT LOOP DIAGRAM
950-MFA-06101
FZ-06 MANUAL FIRE ALARM (MFA)

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 344	REV. 00

File Name : 123A90-DDL-IN-DG-40014_REV.00

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	950-MFA-06102	: FZ-06 MFA Activation			Dwg	123A90-DDL-SAF-DL-30027
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)			Module	LD
TASK	code	C10004433		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	COMM	Activity FTS	Discipline	Instrumental	Form	FJ04PB_FGS Push Button Fire&Gas

LOOP DATA

Loop TAG	950-MFA-06102			TSLD	123A90-FDL-IN-DG-40014 rev.0_a		
IO Type	Input	Yes	Output	No	Energy by transmitter	No	Energy by system	Yes
Marshalling	B400-FGS-001	Terminal	08A/08B	Slot	05	Rack	03	Chanel	8

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	Yes	Alarm/trip	Yes	OK
4	De-Energise Loop (open loop) and record status	Normal	NA	Alarm/trip	NA	OK
5	Record Fail Safe position	Open	Yes	Closed	NA	OK

LOOP SERVICE

		Action Fire alarm		Alarm / Control FGS		Display PCS	
6	Loop energized	Yes		Yes		OK	OK
7	Loop not energized	NA		NA		NA	NA
8	Checking of line monitoring	Yes		Yes		OK	OK
9	Checking of Maintenance Inhibition	NA		NA		NA	NA
10	Associated safety Level / bar						NA
11	Associated outputs						NA

LOOP DOCUMENTATION

12	Loop diagram is marked up and attached to this test sheet	OK
13	Cause and effect chart is highlighted accordingly	OK
14	Any defect is recorded for punch list issuance	OK

Comments:

Page 1/1	Performed by	☉ WITNESS ☐ REVIEW	☉ WITNESS ☐ REVIEW
Company	RM COMM	RM COMM	cw
Name	Laurentiu Grozavu	Giandonato Delmissier	John Mackillop
Date	2025-01-10	2025-01-10	2025-01-11
Signature	PROVERLIS Digitaly signed by Laurentiu Grozavu 2025-01-10T12:44:57.601Z	PROVERLIS Digitaly signed by Giandonato Delmissier 2025-01-10T15:29:53.841Z	PROVERLIS Digitaly signed by John Mackillop 2025-01-11T09:24:50.939Z

SM87BG & SM87PB manual call point range

Ex d, Ex ia, weatherproof



Overview

These manual fire alarm, emergency shutdown break-glass and pushbutton units have been designed for the most arduous environmental conditions.

The units are both easy to install and maintain. Intrinsically safe Ex ia and flameproof Ex d versions of each model are available.

A choice of either stainless steel or alloy makes the range suitable for either the offshore or onshore industries. Stainless steel, one of the most durable materials available on the market, is both hard wearing and corrosion resistant, increasing the life of products in harsh environments and therefore reducing maintenance costs.

Features

- Zone 0, Zone 1 and Zone 2 use*
- ATEX certified
- UL listed for USA and Canada (SM87PBL only). Class I, Div 1, Groups C & D
- ULC certified (SM87PBL only) for Class I, Zone 1 Groups C & D
- CSA certified
- IECEx certified
- Brazilian (INMETRO) certified
- Russian Fire certified
- PESO certified (Ex d only)
- SIL 2 certified (SM87PB only)
- IP66 and IP67
- DNV type approval (IEC 60945) (SM87PB only)
- Certified temperature: –55°C to +70°C*
- Stainless steel or marine grade alloy
- Robust yet lightweight
- Easy to maintain

*Model dependent

Eaton
Unit B, Sutton Parkway
Oddicroft Lane
Sutton in Ashfield
United Kingdom
NG17 5FB

T: +44 (0) 1623 444 400
www.crouse-hinds.com/hac
MEDCSales@Eaton.com

© 2024 Eaton
All Rights Reserved
Printed in UK
Publication
No.DSMC0005/H
March 2024

Eaton is a registered trademark.

All other trademarks are property of their respective owners.

Powering Business Worldwide

All specifications, dimensions, weights and tolerances are nominal (typical) and Eaton reserve the right to vary all data without prior notice.
No liability is accepted for any consequence of use.

Certifications


ATEX Ex d	Cert. no. Baseefa03ATEX0075. ATEX Approved Ex II 2GD Certified to: EN60079-0, EN60079-1, EN60079-31 Ex d IIC T5/T6 Gb, Ex tb IIIC T85°C/T100°C Db. IP66/IP67
ATEX Ex ia	Cert no. Baseefa 02ATEX0152X. ATEX Approved Ex II 1GD Certified to: EN60079-0, EN60079-11 Ex ia IIC T4 Ga, Ex ia IIIC T135°C Da
IECEx Ex d	Cert. no. IECEx BAS 09.0060 Certified to: EN60079-0, EN60079-1, EN60079-31 Ex d IIC T5/T6 Gb, Ex tb IIIC T85°/T100°C Db. IP66/IP67
IECEx Ex ia	Cert. no. IECEx BAS 10.0033X Certified to: IEC60079-0, IEC60079-11, Ex ia IIC T4 Ga, Ex ia IIIC T135°C Da
UL	Listing no. E186629 UL listed to Class 1, Div 1. Groups C & D. (SM87PBL)
ULC	Cert. no. 20091023-E320282 ULC certified for Class I, Zone 1 Groups C & D (SM87PBL)
CSA Explosion proof	Class 1, Div 1 & 2. Group D Ex d IIC T5/T6 Gb
CSA Intrinsically safe	Class 1, Div 1 & 2. Groups A-D
INMETRO Ex d	Ex db IIC T5/T6 Gb
Type Approvals	DNV (IEC 60945) (Stainless Steel SM87PB only)
SIL	SM87PB only - SIL2 Certification to IEC61508. Cert no. 20151118-4786827453
CCC	Ex d IIC T5/T6 Gb, Ex tD A21 IP66/IP67 T85°C/T100°C

Specifications


Material	Grade 316 ANC4B stainless steel or LM 25 TF marine grade alloy
Finish	Paint finish as standard or to customer specification
Voltage	Ex d 24V a.c./d.c. Ex ia 28V
Rating	2A
Switches	2 pole c/o, wired to terminals Optional up to 4 pole (UL version 2 pole only)
Optional indicator	A red high intensity LED can be fitted for alarm indication As standard the LED is not provided with over current protection. The forward current (If) should be limited to 20mA
Certified temp	Ex d* –55°C to +70°C. Ex ia* –55°C to +60°C –20°C to +55°C (LED version only) UL –40°C to +70°C, –20°C to +55°C (LED version only) CSA Explosion proof - Class 1, Div 1 & 2. –50°C to +55°C CSA - Ex d IIC –55°C to +70°C CSA Intrinsically safe - Class 1, Div 1 & 2 –50°C to +40°C *Note: includes ATEX, IECEx & INMETRO versions
Weight	3·8 kg. steel (approx.) or 2.5 kg. alloy (approx)
Ingress protection	IP66 & IP67. SM87PB IP68 (35m for 40 hours)
Entries	Up to 4 x M20 or M25 ISO Ex d/Ex ia Up to 4 x ½" or ¾" NPT UL Stainless steel version comes with two entries as standard. Units ordered with a single entry ordering code are supplied with 2x entries inc. plug on the opposite side
Terminals	Will accept up to 1·5mm² cable
Resistor values	470R minimum (d.c. & I.S. units only)

General arrangement drawing (all dimensions in mm)

Break glass

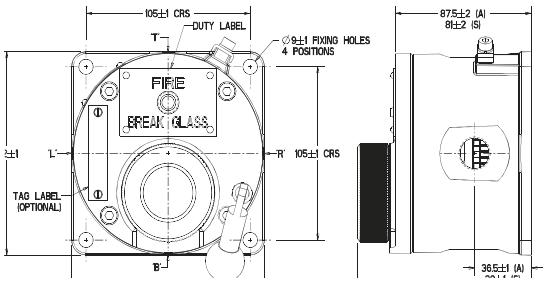

Push button

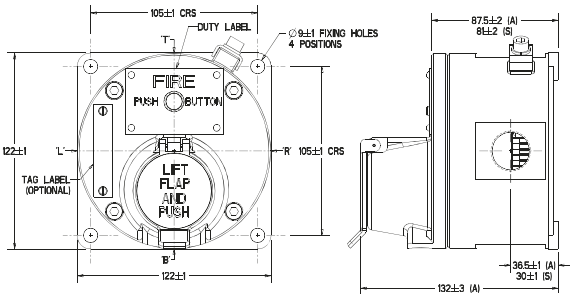

Both the Ex ia units and the Ex d units have the same external appearance. Also the internal components are identical throughout the range. Each unit can be wired for either NO, NC or CO contacts to customer specification

Ordering requirements

The following code is designed to help in selection of the correct unit. Build up the reference number by inserting the code for each component into the appropriate box

Unit	Model	Material	Certification	Entries	Duty label	Tag label	Options	Finish
SM87	PBL	S	D	1B1R	O	Y	HD	R

Material*	Code
Stainless steel	S
Alloy	A

*UL version only available in alloy

Model*	Code
Breakglass latching	BGL
Lift flap breakglass latching	LBGL
Push button latching key reset	PBL
Push button only momentary action	PBM

*UL and ULC versions only available in PBL model

Certification	Code
Ex ia	I
Ex d	D
IECEx - Ex ia	IJ
IECEx - Ex d	DJ
UL	UL
ULC	UC
CSA - Intrinsically Safe	IC
CSA - Ex proof	DC
INMETRO - Ex d	DM
CCC	DQ

Entries	Code
M20	1
M25	2
½" NPT	3
¾" NPT	4
Other	5
Position	
Top	*T
Bottom	*B
RHS	*R
LHS	*L

*Prefix position with size code i.e. 1T1B = M20 Top and Bottom

Duty label	Code
Fire breakglass	1
Push button	2
Fire push button	3
ESDO abandon	4
Burning house logo	5
Fire/FEU	6†
Other	O*
None	N

*Please specify
†This option must be used when ordering a red callpoint for ULC Fire Alarm applications

Tag label	Code
Required	Y*
Not required	N

*Please specify

Options	Code
Not required	N
LED	A
Resistor series	G*
Resistor EOL	H*
Diode	D*
3 pole c/o switch	T
4 pole c/o switch	F


*Please specify

Finish	Code
Red	R
Blue	B
Yellow	Y
Yellow/black stripes	X
Special	S*

*Please specify

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 00

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

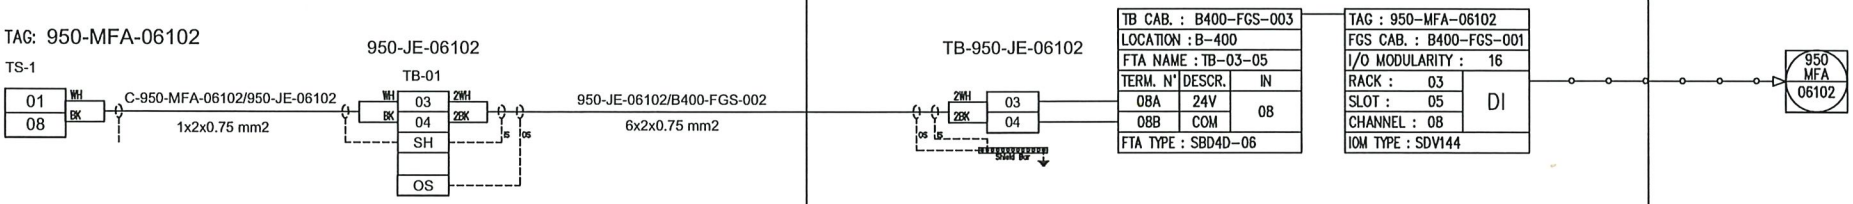

NO MARK UP
03/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 0_A | DATE: 23/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSRUMENT LOOP DIAGRAM
950-MFA-06102
FZ-06 MANUAL FIRE ALARM (MFA)

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 345	REV. 00

File Name : 123A90-DDL-IN-DG-40014_REV.00

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	950-MFA-06201	: FZ-06 MFA Activation - B-100 Indoor	Dwg	123A90-DDL-SAF-DL-30027		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module	LD_B-100		
TASK	code	C10004434	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	COMM	Activity FTS	Discipline	Instrumental	Form	FJ04PB_FGS Push Button Fire&Gas

LOOP DATA

Loop TAG	950-MFA-06201			TSLD	123A90-FDL-IN-DG-40014 rev 0_A		
IO Type	Input Yes	Output No		Energy by transmitter	No	Energy by system	Yes
Marshalling	B400-FGS-001	Terminal 06A-06B		Slot 05	Rack 04	Chanel 06	

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	Yes	Alarm/trip	Yes	OK
4	De-Energise Loop (open loop) and record status	Normal	NA	Alarm/trip	NA	OK
5	Record Fail Safe position	Open	Yes	Closed	No	OK

LOOP SERVICE

		Action Fire alarm		Alarm / Control FGS		Display PCS	
6	Loop energized	Yes		Yes		OK	OK
7	Loop not energized	NA		NA		NA	NA
8	Checking of line monitoring	Yes		Yes		OK	OK
9	Checking of Maintenance Inhibition	NA		NA		NA	NA
10	Associated safety Level / bar						
11	Associated outputs						

LOOP DOCUMENTATION

12	Loop diagram is marked up and attached to this test sheet	OK
13	Cause and effect chart is highlighted accordingly	OK
14	Any defect is recorded for punch list issuance	

Comments:

Page 1/1	Performed by	☒ WITNESS ☐ REVIEW	☒ WITNESS ☐ REVIEW
Company	RM	RM COMM	cw
Name	Alejandro Sasia	Giandonato Delmissier	John Mackillop
Date	2025-01-10	2025-01-10	2025-01-11
Signature	Digitaly signed by Alejandro Sasia 2025-01-10T13:40:13.521Z	Digitaly signed by Giandonato Delmissier 2025-01-10T15:30:13.257Z	Digitaly signed by John Mackillop 2025-01-11T09:28:06.874Z

SM87BG & SM87PB manual call point range

Ex d, Ex ia, weatherproof



Overview

These manual fire alarm, emergency shutdown break-glass and pushbutton units have been designed for the most arduous environmental conditions.

The units are both easy to install and maintain. Intrinsically safe Ex ia and flameproof Ex d versions of each model are available.

A choice of either stainless steel or alloy makes the range suitable for either the offshore or onshore industries. Stainless steel, one of the most durable materials available on the market, is both hard wearing and corrosion resistant, increasing the life of products in harsh environments and therefore reducing maintenance costs.

Features

- Zone 0, Zone 1 and Zone 2 use*
- ATEX certified
- UL listed for USA and Canada (SM87PBL only). Class I, Div 1, Groups C & D
- ULC certified (SM87PBL only) for Class I, Zone 1 Groups C & D
- CSA certified
- IECEx certified
- Brazilian (INMETRO) certified
- Russian Fire certified
- PESO certified (Ex d only)
- SIL 2 certified (SM87PB only)
- IP66 and IP67
- DNV type approval (IEC 60945) (SM87PB only)
- Certified temperature: –55°C to +70°C*
- Stainless steel or marine grade alloy
- Robust yet lightweight
- Easy to maintain

*Model dependent

Eaton
Unit B, Sutton Parkway
Oddicroft Lane
Sutton in Ashfield
United Kingdom
NG17 5FB

T: +44 (0) 1623 444 400
www.crouse-hinds.com/hac
MEDCSales@Eaton.com

© 2024 Eaton
All Rights Reserved
Printed in UK
Publication
No.DSMC0005/H
March 2024

Eaton is a registered trademark.

All other trademarks are property of their respective owners.

Powering Business Worldwide

All specifications, dimensions, weights and tolerances are nominal (typical) and Eaton reserve the right to vary all data without prior notice.
No liability is accepted for any consequence of use.

Certifications


ATEX Ex d	Cert. no. Baseefa03ATEX0075. ATEX Approved Ex II 2GD Certified to: EN60079-0, EN60079-1, EN60079-31 Ex d IIC T5/T6 Gb, Ex tb IIIC T85°C/T100°C Db. IP66/IP67
ATEX Ex ia	Cert no. Baseefa 02ATEX0152X. ATEX Approved Ex II 1GD Certified to: EN60079-0, EN60079-11 Ex ia IIC T4 Ga, Ex ia IIIC T135°C Da
IECEx Ex d	Cert. no. IECEx BAS 09.0060 Certified to: EN60079-0, EN60079-1, EN60079-31 Ex d IIC T5/T6 Gb, Ex tb IIIC T85°/T100°C Db. IP66/IP67
IECEx Ex ia	Cert. no. IECEx BAS 10.0033X Certified to: IEC60079-0, IEC60079-11, Ex ia IIC T4 Ga, Ex ia IIIC T135°C Da
UL	Listing no. E186629 UL listed to Class 1, Div 1. Groups C & D. (SM87PBL)
ULC	Cert. no. 20091023-E320282 ULC certified for Class I, Zone 1 Groups C & D (SM87PBL)
CSA Explosion proof	Class 1, Div 1 & 2. Group D Ex d IIC T5/T6 Gb
CSA Intrinsically safe	Class 1, Div 1 & 2. Groups A-D
INMETRO Ex d	Ex db IIC T5/T6 Gb
Type Approvals	DNV (IEC 60945) (Stainless Steel SM87PB only)
SIL	SM87PB only - SIL2 Certification to IEC61508. Cert no. 20151118-4786827453
CCC	Ex d IIC T5/T6 Gb, Ex tD A21 IP66/IP67 T85°C/T100°C

Specifications


Material	Grade 316 ANC4B stainless steel or LM 25 TF marine grade alloy
Finish	Paint finish as standard or to customer specification
Voltage	Ex d 24V a.c./d.c. Ex ia 28V
Rating	2A
Switches	2 pole c/o, wired to terminals Optional up to 4 pole (UL version 2 pole only)
Optional indicator	A red high intensity LED can be fitted for alarm indication As standard the LED is not provided with over current protection. The forward current (If) should be limited to 20mA
Certified temp	Ex d* –55°C to +70°C. Ex ia* –55°C to +60°C –20°C to +55°C (LED version only) UL –40°C to +70°C, –20°C to +55°C (LED version only) CSA Explosion proof - Class 1, Div 1 & 2. –50°C to +55°C CSA - Ex d IIC –55°C to +70°C CSA Intrinsically safe - Class 1, Div 1 & 2 –50°C to +40°C *Note: includes ATEX, IECEx & INMETRO versions
Weight	3·8 kg. steel (approx.) or 2.5 kg. alloy (approx)
Ingress protection	IP66 & IP67. SM87PB IP68 (35m for 40 hours)
Entries	Up to 4 x M20 or M25 ISO Ex d/Ex ia Up to 4 x ½" or ¾" NPT UL Stainless steel version comes with two entries as standard. Units ordered with a single entry ordering code are supplied with 2x entries inc. plug on the opposite side
Terminals	Will accept up to 1·5mm² cable
Resistor values	470R minimum (d.c. & I.S. units only)

General arrangement drawing (all dimensions in mm)

Break glass

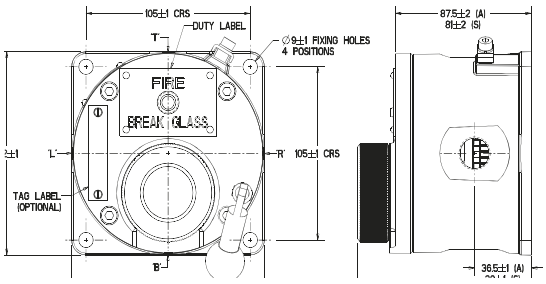

Push button

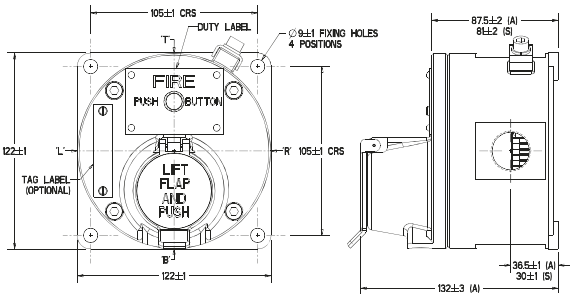

Both the Ex ia units and the Ex d units have the same external appearance. Also the internal components are identical throughout the range. Each unit can be wired for either NO, NC or CO contacts to customer specification

Ordering requirements

The following code is designed to help in selection of the correct unit. Build up the reference number by inserting the code for each component into the appropriate box

Unit	Model	Material	Certification	Entries	Duty label	Tag label	Options	Finish
SM87	PBL	S	D	1B1R	O	Y	HD	R

Material*	Code
Stainless steel	S
Alloy	A

*UL version only available in alloy

Model*	Code
Breakglass latching	BGL
Lift flap breakglass latching	LBGL
Push button latching key reset	PBL
Push button only momentary action	PBM

*UL and ULC versions only available in PBL model

Certification	Code
Ex ia	I
Ex d	D
IECEx - Ex ia	IJ
IECEx - Ex d	DJ
UL	UL
ULC	UC
CSA - Intrinsically Safe	IC
CSA - Ex proof	DC
INMETRO - Ex d	DM
CCC	DQ

Entries	Code
M20	1
M25	2
½" NPT	3
¾" NPT	4
Other	5
Position	
Top	*T
Bottom	*B
RHS	*R
LHS	*L

*Prefix position with size code i.e. 1T1B = M20 Top and Bottom

Duty label	Code
Fire breakglass	1
Push button	2
Fire push button	3
ESDO abandon	4
Burning house logo	5
Fire/FEU	6†
Other	O*
None	N

*Please specify
†This option must be used when ordering a red callpoint for ULC Fire Alarm applications

Tag label	Code
Required	Y*
Not required	N

*Please specify

Options	Code
Not required	N
LED	A
Resistor series	G*
Resistor EOL	H*
Diode	D*
3 pole c/o switch	T
4 pole c/o switch	F


*Please specify

Finish	Code
Red	R
Blue	B
Yellow	Y
Yellow/black stripes	X
Special	S*

*Please specify

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 00

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

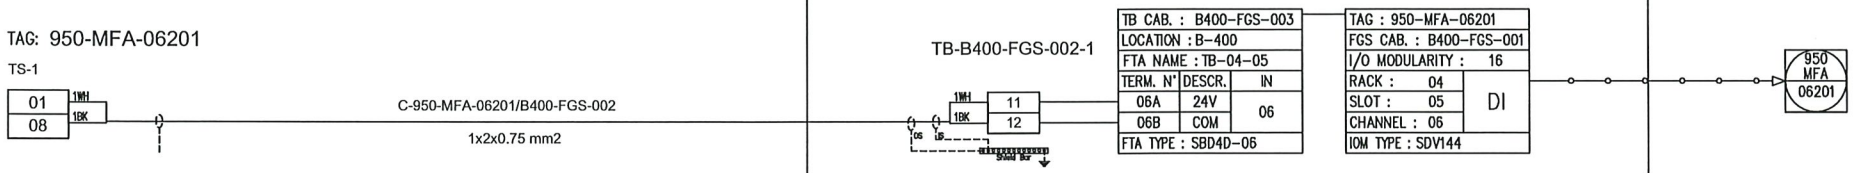

NO MARK UP
L Grogan
03/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 0_A | DATE: 23/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSRUMENT LOOP DIAGRAM
950-MFA-06201
FZ-06 MANUAL FIRE ALARM (MFA)

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 346	REV. 00

File Name : 123A90-DDL-IN-DG-40014_REV.00

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	950-XL-06101	: FZ-06 Gas Beacon Activation		Dwg	123A90-DDL-SAF-DL-30027	
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)		Module	LD	
TASK	code	C10004452	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity FTS	Discipline Instrumental	Form FJ04FB		Flashing Beacon

LOOP DATA

Loop TAG	950-XL-06101			TSLD	123A90-FDL-IN-DG-40014 rev.0_a		
IO Type	Input	No	Output Yes	Energy by transmitter	No	Energy by system	Yes
Marshalling	B400-FGS-001	Terminal	02A/02B	Slot	07	Rack 05	Chanel 2

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	Yes	Alarm/trip	Yes	OK
4	De-Energise Loop (open loop) and record status	Normal	NA	Alarm/trip	NA	NA
5	Record Fail Safe position	Open	NA	Closed	NA	NA

LOOP SERVICE

		Action Fire alarm	Action Gas alarm	Alarm/Control FGS		Display PCS	
6	Loop energized	No	Yes	Yes		OK	OK
7	Loop not energized	NA	NA	NA		NA	NA
8	Checking of line monitoring	NA	Yes	Yes		OK	OK
9	Checking of Maintenance Inhibition	NA	NA	NA		NA	NA
10	Associated safety Level / bar						
11	Associated outputs						OK
12	Flash beacon	RED		AMBER			

LOOP DOCUMENTATION

13	Loop diagram is marked up and attached to this test sheet	OK
14	Cause and effect chart is highlighted accordingly	OK
15	Any defect is recorded for punch list issuance	OK

Comments:

	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM COMM	RM COMM	CW
Name	Laurentiu Grozavu	Giandonato Delmissier	John Mackillop
Date	2025-01-10	2025-01-10	2025-01-11
Signature	Digitaly signed by Laurentiu Grozavu 2025-01-10T12:45:44.042Z	Digitaly signed by Giandonato Delmissier 2025-01-10T15:30:30.109Z	Digitaly signed by John Mackillop 2025-01-11T09:25:25.366Z

SM87HXB 5 joule xenon and SM87LED high intensity LED beacon range

Ex d, weatherproof



Overview

These certified beacons have been designed for use in harsh environmental conditions. The stainless steel or marine grade alloy enclosures are suitable for use offshore or onshore, where lightweight combined with corrosion resistance and strength is required. Units can be painted to customer specification and fitted with identification labels.

LED version available, offering extended lifetimes.

Stainless steel, one of the most durable materials available on the market, is both hard wearing and corrosion resistant, increasing the life of products in harsh environments and therefore reducing maintenance costs.

Features

- Zone 1 and Zone 2 use
- Ex d IIC T4/T5/T6
- ATEX approved, Ex II 2GD
- IECEx certified Gb, Db
- UL listed for USA and Canada
  - Class I, Div 1, Groups C & D
  - Class I, Zone 1, AExd IIB
- CSA certified
- CQST certified*
- INMETRO certified*
- SIL 2 certified
- CCOE certified
- IP66 and IP67
- Certified temperature: –55°C to +70°C*
- Stainless steel or marine grade alloy
- Xenon or LED versions
- Various lens colours
- Optional lens guard
- Telephone or relay initiated

*Depending on version

Eaton
Unit B, Sutton Parkway
Oddicroft Lane
Sutton in Ashfield
United Kingdom
NG17 5FB

T: +44 (0) 1623 444 400
www.crouse-hinds.com/hac
MEDCSales@Eaton.com

© 2024 Eaton
All Rights Reserved
Printed in UK
Publication
No.DSMC0041/F
March 2024

Eaton is a registered trademark.

All other trademarks are property of their respective owners.

All specifications, dimensions, weights and tolerances are nominal (typical) and Eaton reserve the right to vary all data without prior notice. No liability is accepted for any consequence of use.


Certifications

ATEX Ex d	Cert. no. Baseefa 03ATEX0222 Certified to: EN60079-0, EN60079-1, EN60079-31 SM87HXB: Ex II 2GD, Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db SM87LED: Ex II 2GD, Ex d IIC T6 Gb, Ex tb IIIC T55°C/ T70°C Db
IECEx Ex d	Cert. no. IECEx BAS 09.0059 Certified to: IEC60079-0, IEC60079-1, IEC60079-31 SM87HXB: Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db SM87LED: Ex d IIC T6 Gb, Ex tb IIIC T55°C/ T70°C Db
UL	Listing no. E187894 Class I, Div 1, Groups C & D Class I, Zones 1. (SM87HXB & SM87XBT only)
CSA	Cert no. 96406. (SM87HXB only) Certified to: C22.2 Nos 0, 0.4, 0.5, 9, 30-M1986, 94-M91, 137-M1981 Class I, Div 1. Group D
INMETRO Ex d	SM87HXB: Ex db IIC T5/T6 Gb, Ex tb IIIC T80°C/T95°C Db SM87LED: Ex db IIC T6 Gb, Ex tb IIIC T70°C Db
CQST Ex d	SM87HXB: Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db
SIL	SIL2 certification to IEC61508. Cert. No. 20151119-4786827453

Specifications

Material	SM87HXBS and SM87LEDS: Grade 316 ANC4B stainless steel SM87HXBA and SM87LEDA: LM25 TF marine grade alloy Lens: glass UL version available only in marine grade alloy
Finish	Epoxy paint finish as standard
Certified temp	SM87HXB: ATEX, IECEx, CQST, INMETRO -55°C to +70°C (T5) -55°C to +55°C (T6) UL -55°C to +70°C CSA -50°C to +40°C SM87LED: ATEX, IECEx, CQST, INMETRO -55°C to +55°C* (T6) * Operating temperature is -20°C to +55°C
Weight	SM87HXBS & SM87LEDS: 3.8kg each (approx) SM87HXBA & SM87LEDA: 2kg. each (approx)
Ingress protection	IP66 & IP67
Entries	Up to 4 x M20 / M25 ISO or 1/2" / 3/4" NPT
Terminals	SM87HXB SM87LED: Terminal suitable for 2.5mm2 cable
Relay initiate	Initiation by telephone ringing tone or low voltage control signals
Labels	Duty & tag labels optional

General arrangement drawing (all dimensions in mm)

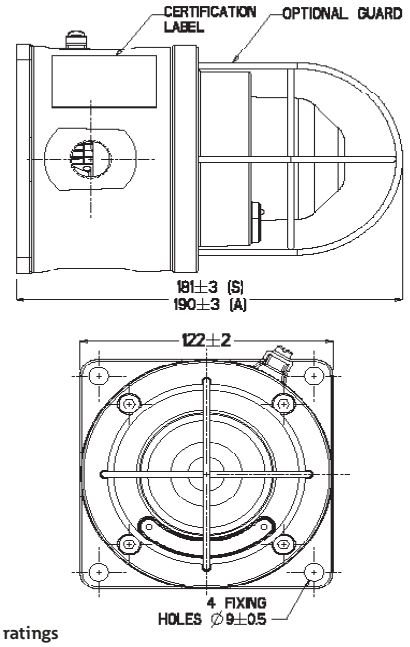

Electrical ratings

	d.c.		a.c. 50/60Hz				
Voltage	24	48	110	120	220	240	254
Tube energy (Joules) SM87HXB	5	5	6	7	6	7	8
Current consumption SM87HXB	393	175	250	275	120	135	153
Current consumption SM87LED (mA)	165	85	N/A	N/A	N/A	N/A	N/A
Effective intensity (Cd)	29	29	32	39	32	39	44
Peak intensity (Cd)	22213	22213	25061	30187	25061	30187	34174

NOTE: The above figures (Cd) are for a clear lens @ 1Hz flash rate

Multiplying factor for coloured lenses

Red	Blue	Amber	Green	Yellow
0.15	0.12	0.51	0.49	0.36

The photometric data given above has been verified by BSI. Reports are available if required

LED light output - steady or flashing (customer selectable)

	Red	Blue	Amber	Green
Total LED output (candela)	192	64	64	17

LED/lens colour: red, blue, green, amber, yellow (not LED) or clear
Flash rate: 90fpm as standard, other flash rates available on request

Flash rate: 60fpm

Ordering requirements

The following code is designed to help in selection of the correct unit. Build up the reference number by inserting the code for each component into the appropriate box

Model	Certification	Voltage	Lens/LED colour	Guard	Entries	Tag/duty	Options	Finish
SM87LEDS	B	024	A	Y	1B1R	Y	N	R

Model

Voltage	Code
Xenon (stainless steel)	SM87HXBS
Xenon (alloy)	SM87HXBA
LED Exd (stainless steel)	SM87LEDS
LED Exd (alloy)	SM87LEDA

Certification

Certification	Code
ATEX	B
IECEx	J
UL	UL†
CSA	C‡
Chinese(CQST)	Q
INMETRO	DM

† Only SM87HXBA is available UL certified
‡ Only SM87HXB

Voltage

Voltage	Code
24 V d.c.	024
48 V d.c.	048
110 V a.c. not LED	110
120 V a.c. not LED	120
220 V a.c. not LED	220
240 V a.c. not LED	240
254 V a.c. not LED	254

Lens/LED colour

Colour	Code
Clear	C
Red	R
Blue	B
Green	G
Amber	A
Yellow (not LED)	Y

Guard

Guard	Code
None	N
Yes	Y

Entries

Entries	Code
M20	1
M25	2
1/2" NPT	3
3/4" NPT	4
Top	*T
Bottom	*B
RHS	*R
LHS	*L

* Prefix position with entry size code
e.g. 1T1B=M20 Top and Bottom entries

Tag/duty

Label	Code
None	N
Yes	Y*

* Please specify wording (Note: 15 characters maximum)

Options

Options	Code
Telephone	T*‡
Relay	R*‡
EOL resistor	E*†
None	N

* Not available on UL versions
† Please specify
‡ For SM87LED please specify if steady or flashing is required


Finish

Colour	Code
Red	R
Blue	B
Yellow	Y
Yellow/ black stripe	X
Grey	G
White	W
Special	S*

*Please specify

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 00

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

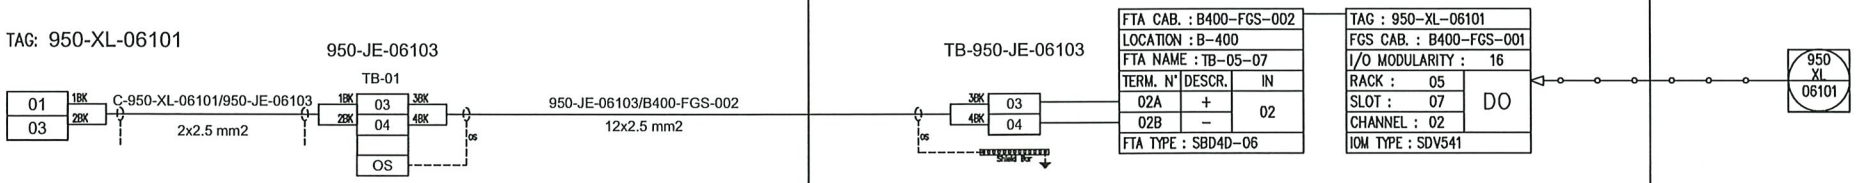

NO MARK UP
Lorgnam
03/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 0_A | DATE: 23/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSRUMENT LOOP DIAGRAM
950-XL-06101
FZ-06 OPTICAL EXP GAS ALARM

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 395	REV. 00

File Name : 123A90-DDL-IN-DG-40014_REV.00

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	950-XL-06102	: FZ-06 Fire Beacon Activation		Dwg	123A90-DDL-SAF-DL-30027	
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)		Module	LD	
TASK	code	C10004453	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity FTS	Discipline Instrumental	Form FJ04FB		Flashing Beacon

LOOP DATA

Loop TAG	950-XL-06102			TSLD	123A90-FDL-IN-DG-40014 rev 1_A				
IO Type	Input	No	Output	Yes	Energy by transmitter	No	Energy by system	Yes	
Marshalling	B400-FGS-001	Terminal	02A-02B	Slot	07	Rack	05	Chanel	02

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	Yes	Alarm/trip	Yes	OK
4	De-Energise Loop (open loop) and record status	Normal	NA	Alarm/trip	NA	NA
5	Record Fail Safe position	Open	NA	Closed	NA	NA

LOOP SERVICE

		Action Fire alarm	**Action** Gas alarm	**Alarn/Control** FGS		**Display** PCS	
6	Loop energized	Yes	No	Yes		OK	OK
7	Loop not energized	NA	NA	NA		NA	NA
8	Checking of line monitoring	Yes	NA	Yes		OK	OK
9	Checking of Maintenance Inhibition	NA	NA	NA		NA	NA
10	Associated safety Level / bar						
11	Associated outputs						OK
12	Flash beacon	RED	●	AMBER			

LOOP DOCUMENTATION

13	Loop diagram is marked up and attached to this test sheet	OK
14	Cause and effect chart is highlighted accordingly	OK
15	Any defect is recorded for punch list issuance	OK

Comments:

	Performed by	☐ WITNESS ☐ REVIEW	● WITNESS ☐ REVIEW
Company	RM	RM COMM	CW
Name	Alejandro Sasia	Giandonato Delmissier	John Mackillop
Date	2025-01-10	2025-01-10	2025-01-11
Signature	PROVERLIS Digitaly signed by Alejandro Sasia 2025-01-10T13:52:19.820Z	PROVERLIS Digitaly signed by Giandonato Delmissier 2025-01-10T15:30:46.367Z	PROVERLIS Digitaly signed by John Mackillop 2025-01-11T09:25:53.805Z

SM87HXB 5 joule xenon and SM87LED high intensity LED beacon range

Ex d, weatherproof



Overview

These certified beacons have been designed for use in harsh environmental conditions. The stainless steel or marine grade alloy enclosures are suitable for use offshore or onshore, where lightweight combined with corrosion resistance and strength is required. Units can be painted to customer specification and fitted with identification labels.

LED version available, offering extended lifetimes.

Stainless steel, one of the most durable materials available on the market, is both hard wearing and corrosion resistant, increasing the life of products in harsh environments and therefore reducing maintenance costs.

Features

- Zone 1 and Zone 2 use
- Ex d IIC T4/T5/T6
- ATEX approved, Ex II 2GD
- IECEx certified Gb, Db
- UL listed for USA and Canada
  - Class I, Div 1, Groups C & D
  - Class I, Zone 1, AExd IIB
- CSA certified
- CQST certified*
- INMETRO certified*
- SIL 2 certified
- CCOE certified
- IP66 and IP67
- Certified temperature: –55°C to +70°C*
- Stainless steel or marine grade alloy
- Xenon or LED versions
- Various lens colours
- Optional lens guard
- Telephone or relay initiated

*Depending on version

Eaton
Unit B, Sutton Parkway
Oddicroft Lane
Sutton in Ashfield
United Kingdom
NG17 5FB

T: +44 (0) 1623 444 400
www.crouse-hinds.com/hac
MEDCSales@Eaton.com

© 2024 Eaton
All Rights Reserved
Printed in UK
Publication
No.DSMC0041/F
March 2024

Eaton is a registered trademark.

All other trademarks are property of their respective owners.

All specifications, dimensions, weights and tolerances are nominal (typical) and Eaton reserve the right to vary all data without prior notice. No liability is accepted for any consequence of use.


Certifications

ATEX Ex d	Cert. no. Baseefa 03ATEX0222 Certified to: EN60079-0, EN60079-1, EN60079-31 SM87HXB: Ex II 2GD, Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db SM87LED: Ex II 2GD, Ex d IIC T6 Gb, Ex tb IIIC T55°C/ T70°C Db
IECEx Ex d	Cert. no. IECEx BAS 09.0059 Certified to: IEC60079-0, IEC60079-1, IEC60079-31 SM87HXB: Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db SM87LED: Ex d IIC T6 Gb, Ex tb IIIC T55°C/ T70°C Db
UL	Listing no. E187894 Class I, Div 1, Groups C & D Class I, Zones 1. (SM87HXB & SM87XBT only)
CSA	Cert no. 96406. (SM87HXB only) Certified to: C22.2 Nos 0, 0.4, 0.5, 9, 30-M1986, 94-M91, 137-M1981 Class I, Div 1. Group D
INMETRO Ex d	SM87HXB: Ex db IIC T5/T6 Gb, Ex tb IIIC T80°C/T95°C Db SM87LED: Ex db IIC T6 Gb, Ex tb IIIC T70°C Db
CQST Ex d	SM87HXB: Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db
SIL	SIL2 certification to IEC61508. Cert. No. 20151119-4786827453

Specifications

Material	SM87HXBS and SM87LEDS: Grade 316 ANC4B stainless steel SM87HXBA and SM87LEDA: LM25 TF marine grade alloy Lens: glass UL version available only in marine grade alloy
Finish	Epoxy paint finish as standard
Certified temp	SM87HXB: ATEX, IECEx, CQST, INMETRO -55°C to +70°C (T5) -55°C to +55°C (T6) UL -55°C to +70°C CSA -50°C to +40°C SM87LED: ATEX, IECEx, CQST, INMETRO -55°C to +55°C* (T6) * Operating temperature is -20°C to +55°C
Weight	SM87HXBS & SM87LEDS: 3.8kg each (approx) SM87HXBA & SM87LEDA: 2kg. each (approx)
Ingress protection	IP66 & IP67
Entries	Up to 4 x M20 / M25 ISO or 1/2" / 3/4" NPT
Terminals	SM87HXB SM87LED: Terminal suitable for 2.5mm2 cable
Relay initiate	Initiation by telephone ringing tone or low voltage control signals
Labels	Duty & tag labels optional

General arrangement drawing (all dimensions in mm)

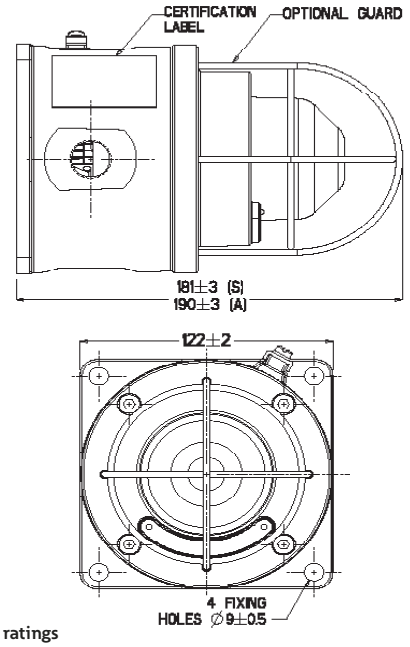

Electrical ratings

	d.c.		a.c. 50/60Hz				
Voltage	24	48	110	120	220	240	254
Tube energy (Joules) SM87HXB	5	5	6	7	6	7	8
Current consumption SM87HXB	393	175	250	275	120	135	153
Current consumption SM87LED (mA)	165	85	N/A	N/A	N/A	N/A	N/A
Effective intensity (Cd)	29	29	32	39	32	39	44
Peak intensity (Cd)	22213	22213	25061	30187	25061	30187	34174

NOTE: The above figures (Cd) are for a clear lens @ 1Hz flash rate

Multiplying factor for coloured lenses

Red	Blue	Amber	Green	Yellow
0.15	0.12	0.51	0.49	0.36

The photometric data given above has been verified by BSI. Reports are available if required

LED light output - steady or flashing (customer selectable)

	Red	Blue	Amber	Green
Total LED output (candela)	192	64	64	17

LED/lens colour: red, blue, green, amber, yellow (not LED) or clear
Flash rate: 90fpm as standard, other flash rates available on request

Flash rate: 60fpm

Ordering requirements

The following code is designed to help in selection of the correct unit. Build up the reference number by inserting the code for each component into the appropriate box

Model	Certification	Voltage	Lens/LED colour	Guard	Entries	Tag/duty	Options	Finish
SM87LEDS	B	024	R	Y	1B1R	Y	N	R

Voltage	Code
Xenon (stainless steel)	SM87HXBS
Xenon (alloy)	SM87HXBA
LED Exd (stainless steel)	SM87LEDS
LED Exd (alloy)	SM87LEDA

Voltage	Code
24 V d.c.	024
48 V d.c.	048
110 V a.c. not LED	110
120 V a.c. not LED	120
220 V a.c. not LED	220
240 V a.c. not LED	240
254 V a.c. not LED	254

Guard	Code
None	N
Yes	Y

Label	Code
None	N
Yes	Y*

* Please specify wording (Note: 15 characters maximum)

Colour	Code
Red	R
Blue	B
Yellow	Y
Yellow/ black stripe	X
Grey	G
White	W
Special	S*

*Please specify

Certification	Code
ATEX	B
IECEx	J
UL	UL†
CSA	C‡
Chinese(CQST)	Q
INMETRO	DM

† Only SM87HXBA is available UL certified
‡ Only SM87HXB


Colour	Code
Clear	C
Red	R
Blue	B
Green	G
Amber	A
Yellow (not LED)	Y

Entries	Code
M20	1
M25	2
1/2" NPT	3
3/4" NPT	4
Top	*T
Bottom	*B
RHS	*R
LHS	*L

* Prefix position with entry size code
e.g. 1T1B=M20 Top and Bottom entries

Options	Code
Telephone	T*‡
Relay	R*‡
EOL resistor	E*†
None	N


* Not available on UL versions
† Please specify
‡ For SM87LED please specify if steady or flashing is required

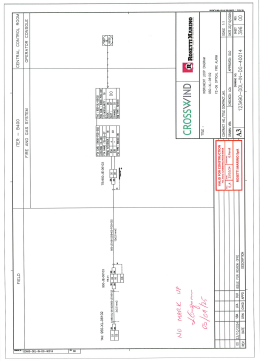

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 00

FIELD | ITER – B400

FIRE AND GAS SYSTEM

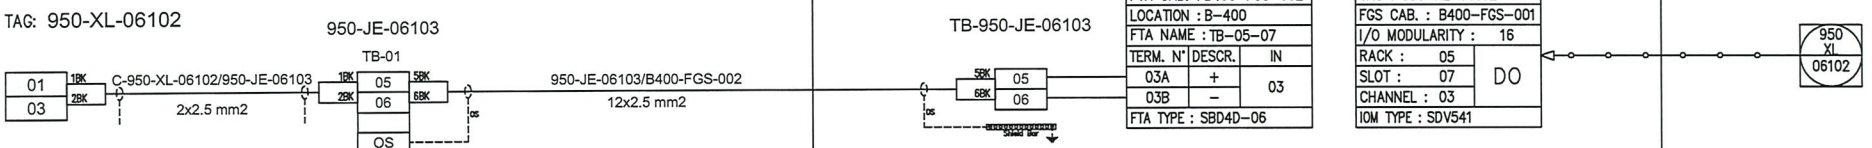

NO MARK UP

L Guzzo

03/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 0_A | DATE: 23/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSRUMENT LOOP DIAGRAM
950-XL-06102
FZ-06 OPTICAL FIRE ALARM

CONTRACT NO./TITLE CONTRACT_NO. | SCALE 1:1

DRAWN: VBA | CHECKED: LCA | APPROVED: DLO | DATE 23/10/2024

A3 | DRAWING NO. 123A90-DDL-IN-DG-40014 | SHEET 396 | REV. 00

File Name : 123A90-DDL-IN-DG-40014_REV00

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	950-XL-06103	: FZ-06 Gas Beacon Activation		Dwg	123A90-DDL-SAF-DL-30027	
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)		Module	LD	
TASK	code	C10004454	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity FTS	Discipline Instrumental	Form FJ04FB		Flashing Beacon

LOOP DATA

Loop TAG	950-XL-06103			TSLD	123A90-FDL-IN-DG-40014 rev. 0_a				
IO Type	Input	Yes	Output	No	Energy by transmitter	No	Energy by system	Yes	
Marshalling	B400-FGS-001	Terminal	04A/04B	Slot	07	Rack	05	Chanel	04

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	Yes	Alarm/trip	Yes	OK
4	De-Energise Loop (open loop) and record status	Normal	NA	Alarm/trip	NA	NA
5	Record Fail Safe position	Open	NA	Closed	NA	NA

LOOP SERVICE

		Action Fire alarm	Action Gas alarm	Alarm/Control FGS		Display PCS	
6	Loop energized	No	Yes	Yes		OK	OK
7	Loop not energized	NA	NA	NA		NA	NA
8	Checking of line monitoring	NA	Yes	Yes		OK	OK
9	Checking of Maintenance Inhibition	NA	NA	NA		NA	NA
10	Associated safety Level / bar						OK
11	Associated outputs						OK
12	Flash beacon	RED		AMBER			

LOOP DOCUMENTATION

13	Loop diagram is marked up and attached to this test sheet	OK
14	Cause and effect chart is highlighted accordingly	OK
15	Any defect is recorded for punch list issuance	OK

Comments:

	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM COMM	RM COMM	CW
Name	Laurentiu Grozavu	Giandonato Delmissier	John Mackillop
Date	2025-01-10	2025-01-10	2025-01-11
Signature	Digitaly signed by Laurentiu Grozavu 2025-01-10T14:04:31.054Z	Digitaly signed by Giandonato Delmissier 2025-01-10T15:31:03.528Z	Digitaly signed by John Mackillop 2025-01-11T09:26:12.247Z

SM87HXB 5 joule xenon and SM87LED high intensity LED beacon range

Ex d, weatherproof



Overview

These certified beacons have been designed for use in harsh environmental conditions. The stainless steel or marine grade alloy enclosures are suitable for use offshore or onshore, where lightweight combined with corrosion resistance and strength is required. Units can be painted to customer specification and fitted with identification labels.

LED version available, offering extended lifetimes.

Stainless steel, one of the most durable materials available on the market, is both hard wearing and corrosion resistant, increasing the life of products in harsh environments and therefore reducing maintenance costs.

Features

- Zone 1 and Zone 2 use
- Ex d IIC T4/T5/T6
- ATEX approved, Ex II 2GD
- IECEx certified Gb, Db
- UL listed for USA and Canada
  - Class I, Div 1, Groups C & D
  - Class I, Zone 1, AExd IIB
- CSA certified
- CQST certified*
- INMETRO certified*
- SIL 2 certified
- CCOE certified
- IP66 and IP67
- Certified temperature: –55°C to +70°C*
- Stainless steel or marine grade alloy
- Xenon or LED versions
- Various lens colours
- Optional lens guard
- Telephone or relay initiated

*Depending on version

Eaton
Unit B, Sutton Parkway
Oddicroft Lane
Sutton in Ashfield
United Kingdom
NG17 5FB

T: +44 (0) 1623 444 400
www.crouse-hinds.com/hac
MEDCSales@Eaton.com

© 2024 Eaton
All Rights Reserved
Printed in UK
Publication
No.DSMC0041/F
March 2024

Eaton is a registered trademark.

All other trademarks are property of their respective owners.

All specifications, dimensions, weights and tolerances are nominal (typical) and Eaton reserve the right to vary all data without prior notice. No liability is accepted for any consequence of use.


Certifications

ATEX Ex d	Cert. no. Baseefa 03ATEX0222 Certified to: EN60079-0, EN60079-1, EN60079-31 SM87HXB: Ex II 2GD, Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db SM87LED: Ex II 2GD, Ex d IIC T6 Gb, Ex tb IIIC T55°C/ T70°C Db
IECEx Ex d	Cert. no. IECEx BAS 09.0059 Certified to: IEC60079-0, IEC60079-1, IEC60079-31 SM87HXB: Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db SM87LED: Ex d IIC T6 Gb, Ex tb IIIC T55°C/ T70°C Db
UL	Listing no. E187894 Class I, Div 1, Groups C & D Class I, Zones 1. (SM87HXB & SM87XBT only)
CSA	Cert no. 96406. (SM87HXB only) Certified to: C22.2 Nos 0, 0.4, 0.5, 9, 30-M1986, 94-M91, 137-M1981 Class I, Div 1. Group D
INMETRO Ex d	SM87HXB: Ex db IIC T5/T6 Gb, Ex tb IIIC T80°C/T95°C Db SM87LED: Ex db IIC T6 Gb, Ex tb IIIC T70°C Db
CQST Ex d	SM87HXB: Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db
SIL	SIL2 certification to IEC61508. Cert. No. 20151119-4786827453

Specifications

Material	SM87HXBS and SM87LEDS: Grade 316 ANC4B stainless steel SM87HXBA and SM87LEDA: LM25 TF marine grade alloy Lens: glass UL version available only in marine grade alloy
Finish	Epoxy paint finish as standard
Certified temp	SM87HXB: ATEX, IECEx, CQST, INMETRO -55°C to +70°C (T5) -55°C to +55°C (T6) UL -55°C to +70°C CSA -50°C to +40°C SM87LED: ATEX, IECEx, CQST, INMETRO -55°C to +55°C* (T6) * Operating temperature is -20°C to +55°C
Weight	SM87HXBS & SM87LEDS: 3.8kg each (approx) SM87HXBA & SM87LEDA: 2kg. each (approx)
Ingress protection	IP66 & IP67
Entries	Up to 4 x M20 / M25 ISO or 1/2" / 3/4" NPT
Terminals	SM87HXB SM87LED: Terminal suitable for 2.5mm2 cable
Relay initiate	Initiation by telephone ringing tone or low voltage control signals
Labels	Duty & tag labels optional

General arrangement drawing (all dimensions in mm)

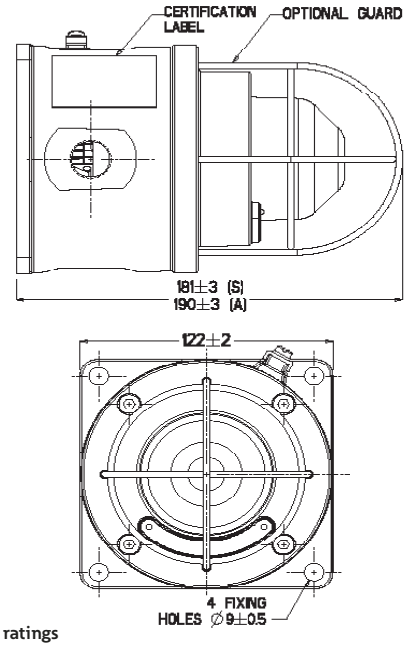

Electrical ratings

	d.c.		a.c. 50/60Hz				
Voltage	24	48	110	120	220	240	254
Tube energy (Joules) SM87HXB	5	5	6	7	6	7	8
Current consumption SM87HXB	393	175	250	275	120	135	153
Current consumption SM87LED (mA)	165	85	N/A	N/A	N/A	N/A	N/A
Effective intensity (Cd)	29	29	32	39	32	39	44
Peak intensity (Cd)	22213	22213	25061	30187	25061	30187	34174

NOTE: The above figures (Cd) are for a clear lens @ 1Hz flash rate

Multiplying factor for coloured lenses

Red	Blue	Amber	Green	Yellow
0.15	0.12	0.51	0.49	0.36

The photometric data given above has been verified by BSI. Reports are available if required

LED light output - steady or flashing (customer selectable)

	Red	Blue	Amber	Green
Total LED output (candela)	192	64	64	17

LED/lens colour: red, blue, green, amber, yellow (not LED) or clear
Flash rate: 90fpm as standard, other flash rates available on request

Flash rate: 60fpm

Ordering requirements

The following code is designed to help in selection of the correct unit. Build up the reference number by inserting the code for each component into the appropriate box

Model	Certification	Voltage	Lens/LED colour	Guard	Entries	Tag/duty	Options	Finish
SM87LEDS	B	024	A	Y	1B1R	Y	N	R

Model

Voltage	Code
Xenon (stainless steel)	SM87HXBS
Xenon (alloy)	SM87HXBA
LED Exd (stainless steel)	SM87LEDS
LED Exd (alloy)	SM87LEDA

Certification

Certification	Code
ATEX	B
IECEx	J
UL	UL†
CSA	C‡
Chinese(CQST)	Q
INMETRO	DM

† Only SM87HXBA is available UL certified
‡ Only SM87HXB

Voltage

Voltage	Code
24 V d.c.	024
48 V d.c.	048
110 V a.c. not LED	110
120 V a.c. not LED	120
220 V a.c. not LED	220
240 V a.c. not LED	240
254 V a.c. not LED	254

Lens/LED colour

Colour	Code
Clear	C
Red	R
Blue	B
Green	G
Amber	A
Yellow (not LED)	Y

Guard

Guard	Code
None	N
Yes	Y

Entries

Entries	Code
M20	1
M25	2
1/2" NPT	3
3/4" NPT	4
Top	*T
Bottom	*B
RHS	*R
LHS	*L

* Prefix position with entry size code
e.g. 1T1B=M20 Top and Bottom entries

Tag/duty

Label	Code
None	N
Yes	Y*

* Please specify wording (Note: 15 characters maximum)

Options

Options	Code
Telephone	T*‡
Relay	R*‡
EOL resistor	E*†
None	N

* Not available on UL versions
† Please specify
‡ For SM87LED please specify if steady or flashing is required

Finish


Colour	Code
Red	R
Blue	B
Yellow	Y
Yellow/ black stripe	X
Grey	G
White	W
Special	S*

*Please specify

DRAWING NO. 123A90-DDL-IN-DG-40014

REV. 00

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

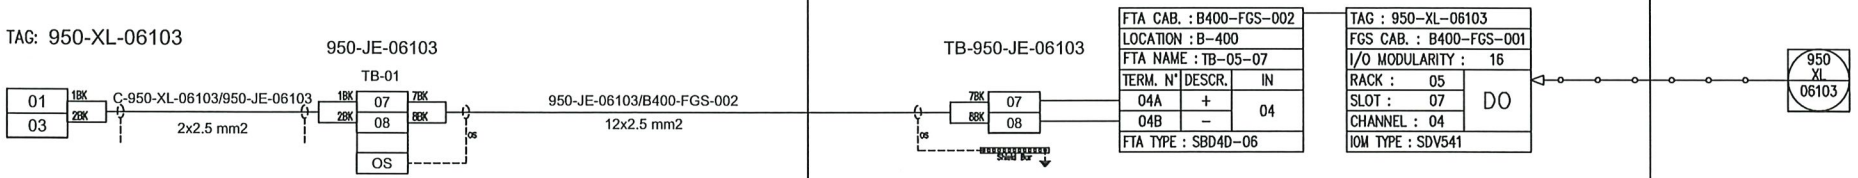

NO MARK UP

L Gagliardi

03/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 0_A | DATE: 23/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSRUMENT LOOP DIAGRAM
950-XL-06103
FZ-06 OPTICAL EXP GAS ALARM

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 397	REV. 00

File Name : 123A90-DDL-IN-DG-40014_REV.00

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	950-XL-06104	: FZ-06 Fire Beacon Activation		Dwg	123A90-DDL-SAF-DL-30027	
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)		Module	LD	
TASK	code	C10004455	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity FTS	Discipline Instrumental	Form FJ04FB		Flashing Beacon

LOOP DATA

Loop TAG	950-XL-06104			TSLD	123A90-FDL-IN-DG-40014 rev. 0_a				
IO Type	Input	Yes	Output	NA	Energy by transmitter	No	Energy by system	Yes	
Marshalling	B400-FGS-001	Terminal	05A/05B	Slot	07	Rack	05	Chanel	05

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	Yes	Alarm/trip	Yes	OK
4	De-Energise Loop (open loop) and record status	Normal	NA	Alarm/trip	NA	NA
5	Record Fail Safe position	Open	NA	Closed	NA	NA

LOOP SERVICE

		Action Fire alarm	Action Gas alarm	Alarm/Control FGS		Display PCS	
6	Loop energized	Yes	NA	Yes		OK	OK
7	Loop not energized	NA	NA	NA		NA	NA
8	Checking of line monitoring	Yes	NA	Yes		OK	OK
9	Checking of Maintenance Inhibition	NA	NA	NA		NA	NA
10	Associated safety Level / bar						OK
11	Associated outputs						OK
12	Flash beacon	RED	●	AMBER			

LOOP DOCUMENTATION

13	Loop diagram is marked up and attached to this test sheet	OK
14	Cause and effect chart is highlighted accordingly	OK
15	Any defect is recorded for punch list issuance	OK

Comments:

	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM COMM	RM COMM	CW
Name	Laurentiu Grozavu	Giandonato Delmissier	John Mackillop
Date	2025-01-10	2025-01-10	2025-01-11
Signature	PROVERLIS Digitaly signed by Laurentiu Grozavu 2025-01-10T14:02:10.422Z	PROVERLIS Digitaly signed by Giandonato Delmissier 2025-01-10T15:31:21.092Z	PROVERLIS Digitaly signed by John Mackillop 2025-01-11T09:26:50.083Z

SM87HXB 5 joule xenon and SM87LED high intensity LED beacon range

Ex d, weatherproof



Overview

These certified beacons have been designed for use in harsh environmental conditions. The stainless steel or marine grade alloy enclosures are suitable for use offshore or onshore, where lightweight combined with corrosion resistance and strength is required. Units can be painted to customer specification and fitted with identification labels.

LED version available, offering extended lifetimes.

Stainless steel, one of the most durable materials available on the market, is both hard wearing and corrosion resistant, increasing the life of products in harsh environments and therefore reducing maintenance costs.

Features

- Zone 1 and Zone 2 use
- Ex d IIC T4/T5/T6
- ATEX approved, Ex II 2GD
- IECEx certified Gb, Db
- UL listed for USA and Canada
  - Class I, Div 1, Groups C & D
  - Class I, Zone 1, AExd IIB
- CSA certified
- CQST certified*
- INMETRO certified*
- SIL 2 certified
- CCOE certified
- IP66 and IP67
- Certified temperature: –55°C to +70°C*
- Stainless steel or marine grade alloy
- Xenon or LED versions
- Various lens colours
- Optional lens guard
- Telephone or relay initiated

*Depending on version

Eaton
Unit B, Sutton Parkway
Oddicroft Lane
Sutton in Ashfield
United Kingdom
NG17 5FB

T: +44 (0) 1623 444 400
www.crouse-hinds.com/hac
MEDCSales@Eaton.com

© 2024 Eaton
All Rights Reserved
Printed in UK
Publication
No.DSMC0041/F
March 2024

Eaton is a registered trademark.

All other trademarks are property of their respective owners.

Powering Business Worldwide

All specifications, dimensions, weights and tolerances are nominal (typical) and Eaton reserve the right to vary all data without prior notice.
No liability is accepted for any consequence of use.


Certifications

ATEX Ex d	Cert. no. Baseefa 03ATEX0222 Certified to: EN60079-0, EN60079-1, EN60079-31 SM87HXB: Ex II 2GD, Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db SM87LED: Ex II 2GD, Ex d IIC T6 Gb, Ex tb IIIC T55°C/ T70°C Db
IECEx Ex d	Cert. no. IECEx BAS 09.0059 Certified to: IEC60079-0, IEC60079-1, IEC60079-31 SM87HXB: Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db SM87LED: Ex d IIC T6 Gb, Ex tb IIIC T55°C/ T70°C Db
UL	Listing no. E187894 Class I, Div 1, Groups C & D Class I, Zones 1. (SM87HXB & SM87XBT only)
CSA	Cert no. 96406. (SM87HXB only) Certified to: C22.2 Nos 0, 0.4, 0.5, 9, 30-M1986, 94-M91, 137-M1981 Class I, Div 1. Group D
INMETRO Ex d	SM87HXB: Ex db IIC T5/T6 Gb, Ex tb IIIC T80°C/T95°C Db SM87LED: Ex db IIC T6 Gb, Ex tb IIIC T70°C Db
CQST Ex d	SM87HXB: Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db
SIL	SIL2 certification to IEC61508. Cert. No. 20151119-4786827453

Specifications

Material	SM87HXBS and SM87LEDS: Grade 316 ANC4B stainless steel SM87HXBA and SM87LEDA: LM25 TF marine grade alloy Lens: glass UL version available only in marine grade alloy
Finish	Epoxy paint finish as standard
Certified temp	SM87HXB: ATEX, IECEx, CQST, INMETRO -55°C to +70°C (T5) -55°C to +55°C (T6) UL -55°C to +70°C CSA -50°C to +40°C SM87LED: ATEX, IECEx, CQST, INMETRO -55°C to +55°C* (T6) * Operating temperature is -20°C to +55°C
Weight	SM87HXBS & SM87LEDS: 3.8kg each (approx) SM87HXBA & SM87LEDA: 2kg. each (approx)
Ingress protection	IP66 & IP67
Entries	Up to 4 x M20 / M25 ISO or 1/2" / 3/4" NPT
Terminals	SM87HXB SM87LED: Terminal suitable for 2.5mm2 cable
Relay initiate	Initiation by telephone ringing tone or low voltage control signals
Labels	Duty & tag labels optional

General arrangement drawing (all dimensions in mm)

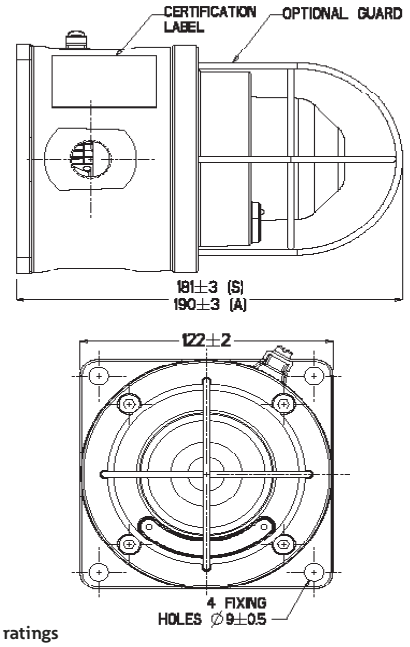

Electrical ratings

	d.c.		a.c. 50/60Hz				
Voltage	24	48	110	120	220	240	254
Tube energy (Joules) SM87HXB	5	5	6	7	6	7	8
Current consumption SM87HXB	393	175	250	275	120	135	153
Current consumption SM87LED (mA)	165	85	N/A	N/A	N/A	N/A	N/A
Effective intensity (Cd)	29	29	32	39	32	39	44
Peak intensity (Cd)	22213	22213	25061	30187	25061	30187	34174

NOTE: The above figures (Cd) are for a clear lens @ 1Hz flash rate

Multiplying factor for coloured lenses

Red	Blue	Amber	Green	Yellow
0.15	0.12	0.51	0.49	0.36

The photometric data given above has been verified by BSI. Reports are available if required

LED light output - steady or flashing (customer selectable)

	Red	Blue	Amber	Green
Total LED output (candela)	192	64	64	17

LED/lens colour: red, blue, green, amber, yellow (not LED) or clear
Flash rate: 90fpm as standard, other flash rates available on request

Flash rate: 60fpm

Ordering requirements

The following code is designed to help in selection of the correct unit. Build up the reference number by inserting the code for each component into the appropriate box

Model	Certification	Voltage	Lens/LED colour	Guard	Entries	Tag/duty	Options	Finish
SM87LEDS	B	024	R	Y	1B1R	Y	N	R

Voltage	Code
Xenon (stainless steel)	SM87HXBS
Xenon (alloy)	SM87HXBA
LED Exd (stainless steel)	SM87LEDS
LED Exd (alloy)	SM87LEDA

Voltage	Code
24 V d.c.	024
48 V d.c.	048
110 V a.c. not LED	110
120 V a.c. not LED	120
220 V a.c. not LED	220
240 V a.c. not LED	240
254 V a.c. not LED	254

Guard	Code
None	N
Yes	Y

Label	Code
None	N
Yes	Y*

* Please specify wording (Note: 15 characters maximum)

Colour	Code
Red	R
Blue	B
Yellow	Y
Yellow/ black stripe	X
Grey	G
White	W
Special	S*

*Please specify

Certification	Code
ATEX	B
IECEx	J
UL	UL†
CSA	C‡
Chinese(CQST)	Q
INMETRO	DM

† Only SM87HXBA is available UL certified
‡ Only SM87HXB

Colour	Code
Clear	C
Red	R
Blue	B
Green	G
Amber	A
Yellow (not LED)	Y

Entries	Code
M20	1
M25	2
1/2" NPT	3
3/4" NPT	4
Top	*T
Bottom	*B
RHS	*R
LHS	*L


* Prefix position with entry size code
e.g. 1T1B=M20 Top and Bottom entries

Options	Code
Telephone	T*‡
Relay	R*‡
EOL resistor	E*†
None	N

* Not available on UL versions
† Please specify
‡ For SM87LED please specify if steady or flashing is required

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 00

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

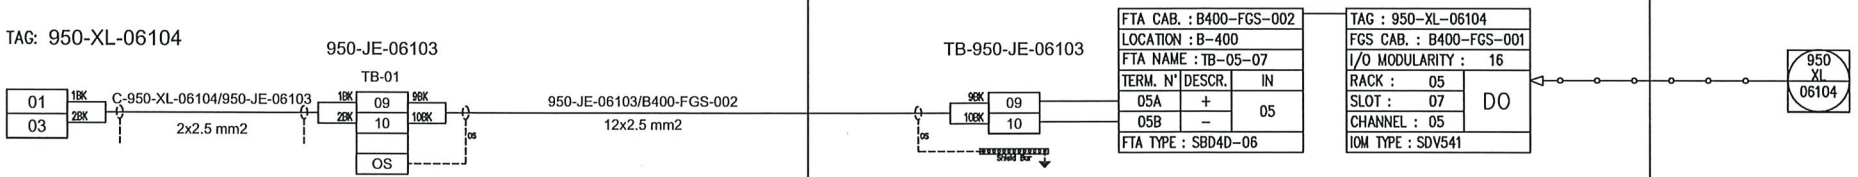

NO MARK UP
L Grugnan
03/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 0_A | DATE: 23/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSRUMENT LOOP DIAGRAM
950-XL-06104
FZ-06 OPTICAL FIRE ALARM

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 398	REV. 00

File Name : 123A90-DDL-IN-DG-40014_REV.00

ROSETTI MARINO | CROSSWIND

ITEM	Tag	950-XL-06201	: FZ-06 Gas Beacon Act. - B-100 Indoor	Dwg	123A90-DDL-SAF-DL-30027		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module	LD_B-100		
TASK	code	C10004456	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity FTS	Discipline	Instrumental	Form FJ04FB	Flashing Beacon

LOOP DATA

Loop TAG	950-XL-06201			TSLD	123A90-FDL-IN-DG-40014 rev 1_A		
IO Type	Input	No	Output	Yes	Energy by transmitter	No	Energy by system	Yes
Marshalling	B400-FGS-001	Terminal		Slot		Rack		Chanel	

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	Yes	Alarm/trip	Yes	OK
4	De-Energise Loop (open loop) and record status	Normal	NA	Alarm/trip	NA	NA
5	Record Fail Safe position	Open	NA	Closed	NA	NA

LOOP SERVICE

		Action Fire alarm	**Action** Gas alarm	**Alarn/Control** FGS		**Display** PCS	
6	Loop energized	No	Yes	Yes		OK	OK
7	Loop not energized	NA	NA	NA		NA	NA
8	Checking of line monitoring	NA	Yes	Yes		OK	OK
9	Checking of Maintenance Inhibition	NA	NA	NA		NA	NA
10	Associated safety Level / bar						
11	Associated outputs						OK
12	Flash beacon	RED		AMBER	●		

LOOP DOCUMENTATION

13	Loop diagram is marked up and attached to this test sheet	OK
14	Cause and effect chart is highlighted accordingly	OK
15	Any defect is recorded for punch list issuance	OK

Comments:

	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM	RM COMM	CW
Name	Alejandro Sasia	Giandonato Delmissier	John Mackillop
Date	2025-01-10	2025-01-10	2025-01-11
Signature	Digitaly signed by Alejandro Sasia 2025-01-10T14:18:52.098Z	Digitaly signed by Giandonato Delmissier 2025-01-10T15:31:38.605Z	Digitaly signed by John Mackillop 2025-01-11T09:27:24.729Z

SM87HXB 5 joule xenon and SM87LED high intensity LED beacon range

Ex d, weatherproof



Overview

These certified beacons have been designed for use in harsh environmental conditions. The stainless steel or marine grade alloy enclosures are suitable for use offshore or onshore, where lightweight combined with corrosion resistance and strength is required. Units can be painted to customer specification and fitted with identification labels.

LED version available, offering extended lifetimes.

Stainless steel, one of the most durable materials available on the market, is both hard wearing and corrosion resistant, increasing the life of products in harsh environments and therefore reducing maintenance costs.

Features

- Zone 1 and Zone 2 use
- Ex d IIC T4/T5/T6
- ATEX approved, Ex II 2GD
- IECEx certified Gb, Db
- UL listed for USA and Canada
  - Class I, Div 1, Groups C & D
  - Class I, Zone 1, AExd IIB
- CSA certified
- CQST certified*
- INMETRO certified*
- SIL 2 certified
- CCOE certified
- IP66 and IP67
- Certified temperature: –55°C to +70°C*
- Stainless steel or marine grade alloy
- Xenon or LED versions
- Various lens colours
- Optional lens guard
- Telephone or relay initiated

*Depending on version

Eaton
Unit B, Sutton Parkway
Oddicroft Lane
Sutton in Ashfield
United Kingdom
NG17 5FB

T: +44 (0) 1623 444 400
www.crouse-hinds.com/hac
MEDCSales@Eaton.com

© 2024 Eaton
All Rights Reserved
Printed in UK
Publication
No.DSMC0041/F
March 2024

Eaton is a registered trademark.

All other trademarks are property of their respective owners.

All specifications, dimensions, weights and tolerances are nominal (typical) and Eaton reserve the right to vary all data without prior notice. No liability is accepted for any consequence of use.


Certifications

ATEX Ex d	Cert. no. Baseefa 03ATEX0222 Certified to: EN60079-0, EN60079-1, EN60079-31 SM87HXB: Ex II 2GD, Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db SM87LED: Ex II 2GD, Ex d IIC T6 Gb, Ex tb IIIC T55°C/ T70°C Db
IECEx Ex d	Cert. no. IECEx BAS 09.0059 Certified to: IEC60079-0, IEC60079-1, IEC60079-31 SM87HXB: Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db SM87LED: Ex d IIC T6 Gb, Ex tb IIIC T55°C/ T70°C Db
UL	Listing no. E187894 Class I, Div 1, Groups C & D Class I, Zones 1. (SM87HXB & SM87XBT only)
CSA	Cert no. 96406. (SM87HXB only) Certified to: C22.2 Nos 0, 0.4, 0.5, 9, 30-M1986, 94-M91, 137-M1981 Class I, Div 1. Group D
INMETRO Ex d	SM87HXB: Ex db IIC T5/T6 Gb, Ex tb IIIC T80°C/T95°C Db SM87LED: Ex db IIC T6 Gb, Ex tb IIIC T70°C Db
CQST Ex d	SM87HXB: Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db
SIL	SIL2 certification to IEC61508. Cert. No. 20151119-4786827453

Specifications

Material	SM87HXBS and SM87LEDS: Grade 316 ANC4B stainless steel SM87HXBA and SM87LEDA: LM25 TF marine grade alloy Lens: glass UL version available only in marine grade alloy
Finish	Epoxy paint finish as standard
Certified temp	SM87HXB: ATEX, IECEx, CQST, INMETRO -55°C to +70°C (T5) -55°C to +55°C (T6) UL -55°C to +70°C CSA -50°C to +40°C SM87LED: ATEX, IECEx, CQST, INMETRO -55°C to +55°C* (T6) * Operating temperature is -20°C to +55°C
Weight	SM87HXBS & SM87LEDS: 3.8kg each (approx) SM87HXBA & SM87LEDA: 2kg. each (approx)
Ingress protection	IP66 & IP67
Entries	Up to 4 x M20 / M25 ISO or 1/2" / 3/4" NPT
Terminals	SM87HXB SM87LED: Terminal suitable for 2.5mm2 cable
Relay initiate	Initiation by telephone ringing tone or low voltage control signals
Labels	Duty & tag labels optional

General arrangement drawing (all dimensions in mm)

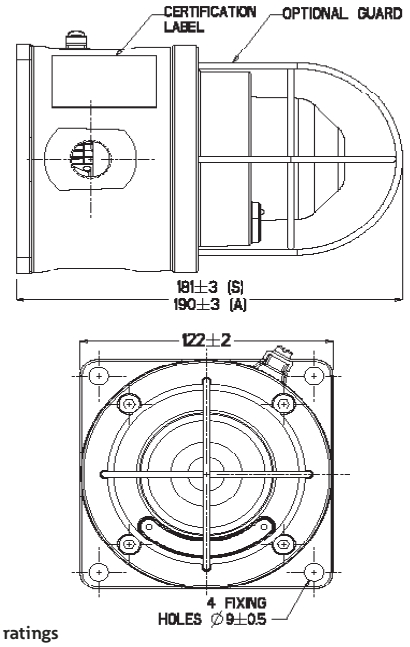

Electrical ratings

	d.c.		a.c. 50/60Hz				
Voltage	24	48	110	120	220	240	254
Tube energy (Joules) SM87HXB	5	5	6	7	6	7	8
Current consumption SM87HXB	393	175	250	275	120	135	153
Current consumption SM87LED (mA)	165	85	N/A	N/A	N/A	N/A	N/A
Effective intensity (Cd)	29	29	32	39	32	39	44
Peak intensity (Cd)	22213	22213	25061	30187	25061	30187	34174

NOTE: The above figures (Cd) are for a clear lens @ 1Hz flash rate

Multiplying factor for coloured lenses

Red	Blue	Amber	Green	Yellow
0.15	0.12	0.51	0.49	0.36

The photometric data given above has been verified by BSI. Reports are available if required

LED light output - steady or flashing (customer selectable)

	Red	Blue	Amber	Green
Total LED output (candela)	192	64	64	17

LED/lens colour: red, blue, green, amber, yellow (not LED) or clear
Flash rate: 90fpm as standard, other flash rates available on request

Flash rate: 60fpm

Ordering requirements

The following code is designed to help in selection of the correct unit. Build up the reference number by inserting the code for each component into the appropriate box

Model	Certification	Voltage	Lens/LED colour	Guard	Entries	Tag/duty	Options	Finish
SM87LEDS	B	024	A	Y	1B1R	Y	N	R

Model

Voltage	Code
Xenon (stainless steel)	SM87HXBS
Xenon (alloy)	SM87HXBA
LED Exd (stainless steel)	SM87LEDS
LED Exd (alloy)	SM87LEDA

Certification

Certification	Code
ATEX	B
IECEx	J
UL	UL†
CSA	C‡
Chinese(CQST)	Q
INMETRO	DM

† Only SM87HXBA is available UL certified
‡ Only SM87HXB

Voltage

Voltage	Code
24 V d.c.	024
48 V d.c.	048
110 V a.c. not LED	110
120 V a.c. not LED	120
220 V a.c. not LED	220
240 V a.c. not LED	240
254 V a.c. not LED	254

Lens/LED colour

Colour	Code
Clear	C
Red	R
Blue	B
Green	G
Amber	A
Yellow (not LED)	Y

Guard

Guard	Code
None	N
Yes	Y

Entries

Entries	Code
M20	1
M25	2
1/2" NPT	3
3/4" NPT	4
Top	*T
Bottom	*B
RHS	*R
LHS	*L

* Prefix position with entry size code
e.g. 1T1B=M20 Top and Bottom entries

Tag/duty

Label	Code
None	N
Yes	Y*

* Please specify wording (Note: 15 characters maximum)

Options

Options	Code
Telephone	T*‡
Relay	R*‡
EOL resistor	E*†
None	N

* Not available on UL versions
† Please specify
‡ For SM87LED please specify if steady or flashing is required


Finish

Colour	Code
Red	R
Blue	B
Yellow	Y
Yellow/ black stripe	X
Grey	G
White	W
Special	S*

*Please specify

DWG NO. 123A90-DDL-IN-DG-40014 REV. 00

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

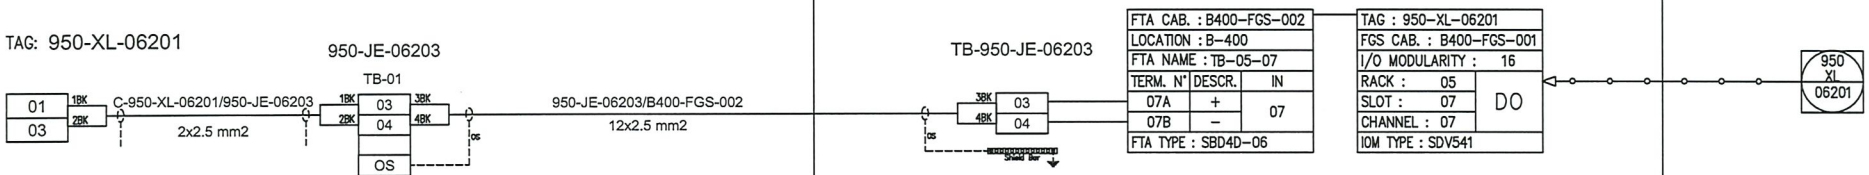

NO MARK UP
L Grigoriou
03/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 0_A | DATE: 23/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSRUMENT LOOP DIAGRAM
950-XL-06201
FZ-06 OPTICAL EXP GAS ALARM B-100 HV/MV SWGR ROOM

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 399	REV. 00

File Name : 123A90-DDL-IN-DG-40014_REV00

ROSETTI MARINO | CROSSWIND

ITEM	Tag	950-XL-06202	: FZ-06 Fire Beacon Act. - B-100 Indoor	Dwg	123A90-DDL-SAF-DL-30027		
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)	Module	LD_B-100		
TASK	code	C10004457	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity FTS	Discipline	Instrumental	Form FJ04FB	Flashing Beacon

LOOP DATA

Loop TAG	950-XL-06202			TSLD	123A90-FDL-IN-DG-40014 rev 1_A				
IO Type	Input	No	Output	Yes	Energy by transmitter	No	Energy by system	Yes	
Marshalling	B400-FGS-001	Terminal	08A-08B	Slot	07	Rack	05	Chanel	08

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	Yes	Alarm/trip	Yes	OK
4	De-Energise Loop (open loop) and record status	Normal	NA	Alarm/trip	NA	NA
5	Record Fail Safe position	Open	NA	Closed	NA	NA

LOOP SERVICE

		Action Fire alarm	**Action** Gas alarm	**Alarn/Control** FGS		**Display** PCS	
6	Loop energized	Yes	No	Yes		OK	OK
7	Loop not energized	NA	NA	NA		NA	NA
8	Checking of line monitoring	Yes	NA	Yes		OK	OK
9	Checking of Maintenance Inhibition	NA	NA	NA		NA	NA
10	Associated safety Level / bar						
11	Associated outputs						
12	Flash beacon	RED	●	AMBER			

LOOP DOCUMENTATION

13	Loop diagram is marked up and attached to this test sheet	OK
14	Cause and effect chart is highlighted accordingly	OK
15	Any defect is recorded for punch list issuance	OK

Comments:

	Performed by	☐ WITNESS ☐ REVIEW	☐ WITNESS ☐ REVIEW
Company	RM	RM COMM	CW
Name	Alejandro Sasia	Giandonato Delmissier	John Mackillop
Date	2025-01-10	2025-01-10	2025-01-11
Signature	Digitaly signed by Alejandro Sasia 2025-01-10T14:30:47.757Z	Digitaly signed by Giandonato Delmissier 2025-01-10T15:31:54.695Z	Digitaly signed by John Mackillop 2025-01-11T09:27:54.478Z

SM87HXB 5 joule xenon and SM87LED high intensity LED beacon range

Ex d, weatherproof



Overview

These certified beacons have been designed for use in harsh environmental conditions. The stainless steel or marine grade alloy enclosures are suitable for use offshore or onshore, where lightweight combined with corrosion resistance and strength is required. Units can be painted to customer specification and fitted with identification labels.

LED version available, offering extended lifetimes.

Stainless steel, one of the most durable materials available on the market, is both hard wearing and corrosion resistant, increasing the life of products in harsh environments and therefore reducing maintenance costs.

Features

- Zone 1 and Zone 2 use
- Ex d IIC T4/T5/T6
- ATEX approved, Ex II 2GD
- IECEx certified Gb, Db
- UL listed for USA and Canada
  - Class I, Div 1, Groups C & D
  - Class I, Zone 1, AExd IIB
- CSA certified
- CQST certified*
- INMETRO certified*
- SIL 2 certified
- CCOE certified
- IP66 and IP67
- Certified temperature: –55°C to +70°C*
- Stainless steel or marine grade alloy
- Xenon or LED versions
- Various lens colours
- Optional lens guard
- Telephone or relay initiated

*Depending on version

Eaton
Unit B, Sutton Parkway
Oddicroft Lane
Sutton in Ashfield
United Kingdom
NG17 5FB

T: +44 (0) 1623 444 400
www.crouse-hinds.com/hac
MEDCSales@Eaton.com

© 2024 Eaton
All Rights Reserved
Printed in UK
Publication
No.DSMC0041/F
March 2024

Eaton is a registered trademark.

All other trademarks are property of their respective owners.

All specifications, dimensions, weights and tolerances are nominal (typical) and Eaton reserve the right to vary all data without prior notice. No liability is accepted for any consequence of use.


Certifications

ATEX Ex d	Cert. no. Baseefa 03ATEX0222 Certified to: EN60079-0, EN60079-1, EN60079-31 SM87HXB: Ex II 2GD, Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db SM87LED: Ex II 2GD, Ex d IIC T6 Gb, Ex tb IIIC T55°C/ T70°C Db
IECEx Ex d	Cert. no. IECEx BAS 09.0059 Certified to: IEC60079-0, IEC60079-1, IEC60079-31 SM87HXB: Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db SM87LED: Ex d IIC T6 Gb, Ex tb IIIC T55°C/ T70°C Db
UL	Listing no. E187894 Class I, Div 1, Groups C & D Class I, Zones 1. (SM87HXB & SM87XBT only)
CSA	Cert no. 96406. (SM87HXB only) Certified to: C22.2 Nos 0, 0.4, 0.5, 9, 30-M1986, 94-M91, 137-M1981 Class I, Div 1. Group D
INMETRO Ex d	SM87HXB: Ex db IIC T5/T6 Gb, Ex tb IIIC T80°C/T95°C Db SM87LED: Ex db IIC T6 Gb, Ex tb IIIC T70°C Db
CQST Ex d	SM87HXB: Ex d IIC T5/T6 Gb, Ex tb IIIC T65°C/ T80°C/ T95°C Db
SIL	SIL2 certification to IEC61508. Cert. No. 20151119-4786827453

Specifications

Material	SM87HXBS and SM87LEDS: Grade 316 ANC4B stainless steel SM87HXBA and SM87LEDA: LM25 TF marine grade alloy Lens: glass UL version available only in marine grade alloy
Finish	Epoxy paint finish as standard
Certified temp	SM87HXB: ATEX, IECEx, CQST, INMETRO -55°C to +70°C (T5) -55°C to +55°C (T6) UL -55°C to +70°C CSA -50°C to +40°C SM87LED: ATEX, IECEx, CQST, INMETRO -55°C to +55°C* (T6) * Operating temperature is -20°C to +55°C
Weight	SM87HXBS & SM87LEDS: 3.8kg each (approx) SM87HXBA & SM87LEDA: 2kg. each (approx)
Ingress protection	IP66 & IP67
Entries	Up to 4 x M20 / M25 ISO or 1/2" / 3/4" NPT
Terminals	SM87HXB SM87LED: Terminal suitable for 2.5mm2 cable
Relay initiate	Initiation by telephone ringing tone or low voltage control signals
Labels	Duty & tag labels optional

General arrangement drawing (all dimensions in mm)

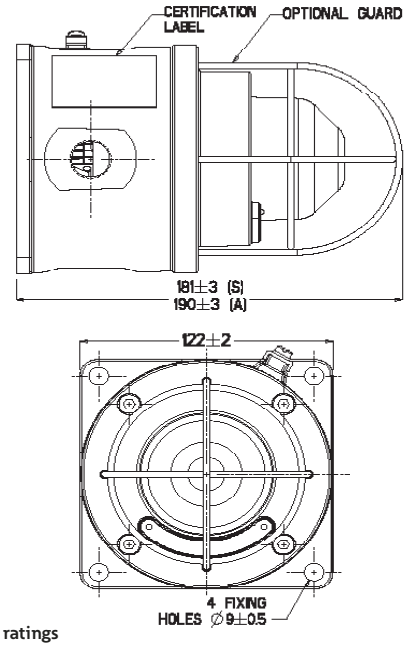

Electrical ratings

	d.c.		a.c. 50/60Hz				
Voltage	24	48	110	120	220	240	254
Tube energy (Joules) SM87HXB	5	5	6	7	6	7	8
Current consumption SM87HXB	393	175	250	275	120	135	153
Current consumption SM87LED (mA)	165	85	N/A	N/A	N/A	N/A	N/A
Effective intensity (Cd)	29	29	32	39	32	39	44
Peak intensity (Cd)	22213	22213	25061	30187	25061	30187	34174

NOTE: The above figures (Cd) are for a clear lens @ 1Hz flash rate

Multiplying factor for coloured lenses

Red	Blue	Amber	Green	Yellow
0.15	0.12	0.51	0.49	0.36

The photometric data given above has been verified by BSI. Reports are available if required

LED light output - steady or flashing (customer selectable)

	Red	Blue	Amber	Green
Total LED output (candela)	192	64	64	17

LED/lens colour: red, blue, green, amber, yellow (not LED) or clear
Flash rate: 90fpm as standard, other flash rates available on request

Flash rate: 60fpm

Ordering requirements

The following code is designed to help in selection of the correct unit. Build up the reference number by inserting the code for each component into the appropriate box

Model	Certification	Voltage	Lens/LED colour	Guard	Entries	Tag/duty	Options	Finish
SM87LEDS	B	024	R	Y	1B1R	Y	N	R

Voltage	Code
Xenon (stainless steel)	SM87HXBS
Xenon (alloy)	SM87HXBA
LED Exd (stainless steel)	SM87LEDS
LED Exd (alloy)	SM87LEDA

Voltage	Code
24 V d.c.	024
48 V d.c.	048
110 V a.c. not LED	110
120 V a.c. not LED	120
220 V a.c. not LED	220
240 V a.c. not LED	240
254 V a.c. not LED	254

Guard	Code
None	N
Yes	Y

Label	Code
None	N
Yes	Y*

* Please specify wording (Note: 15 characters maximum)

Colour	Code
Red	R
Blue	B
Yellow	Y
Yellow/ black stripe	X
Grey	G
White	W
Special	S*

*Please specify

Certification	Code
ATEX	B
IECEx	J
UL	UL†
CSA	C‡
Chinese(CQST)	Q
INMETRO	DM

† Only SM87HXBA is available UL certified
‡ Only SM87HXB


Colour	Code
Clear	C
Red	R
Blue	B
Green	G
Amber	A
Yellow (not LED)	Y

Entries	Code
M20	1
M25	2
1/2" NPT	3
3/4" NPT	4
Top	*T
Bottom	*B
RHS	*R
LHS	*L

* Prefix position with entry size code
e.g. 1T1B=M20 Top and Bottom entries


Options	Code
Telephone	T*‡
Relay	R*‡
EOL resistor	E*†
None	N

* Not available on UL versions
† Please specify
‡ For SM87LED please specify if steady or flashing is required

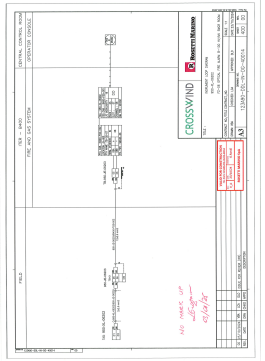

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 00

FIELD	ITER – B400
	FIRE AND GAS SYSTEM

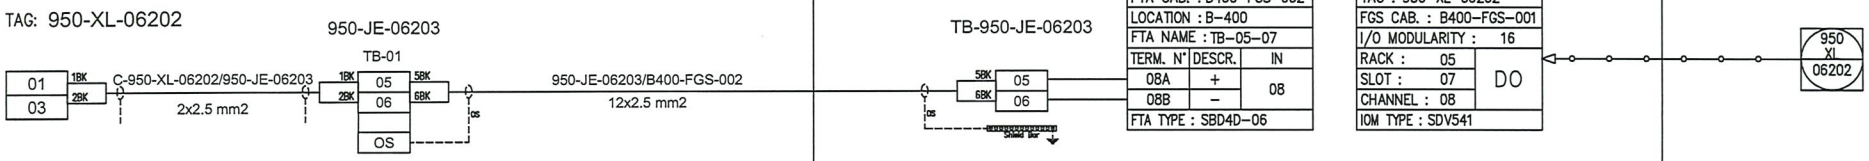

NO MARK UP
L Gregoriano
03/01/25

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV.: 0_A | DATE: 23/10/24 | SIGNATURE: G.Randi
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSRUMENT LOOP DIAGRAM
950-XL-06202
FZ-06 OPTICAL FIRE ALARM B-100 HV/MV SWGR ROOM

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024

A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 400	REV. 00

File Name : 123A90-DDL-IN-DG-40014_REV00

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	950-XZ-06101	: FZ-06 Sounder Activation		Dwg	123A90-DDL-SAF-DL-30027	
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)		Module		
TASK	code	C10004473	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity FTS	Discipline Instrumental	Form	FJ04MS	Monotone Sounder

LOOP DATA

Loop TAG	950-XZ-06101			TSLD	123A90-DDL-IN-DG-40014 rev. 1_A		
IO Type	Input	No	Output	Yes	Energy by transmitter	No	Energy by system Yes
Marshalling	B400-FGS-001	Terminal	01A/01B	Slot	07	Rack 05	Chanel 01

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	No	Alarm/trip	Yes	OK
4	De-Energise Loop (open loop) and record status	Normal	Yes	Alarm/trip	No	OK
5	Record Fail Safe position	Open	NA	Closed	NA	NA

LOOP SERVICE

		Action Fire&Gas alarm		Alarm / Control FGS		Display PCS	
6	Loop energized	Yes		Yes		NA	OK
7	Loop not energized	No		Yes		NA	OK
8	Checking of line monitoring	Yes		Yes		OK	OK
9	Checking of Maintenance Inhibition	NA		NA		NA	NA
10	Associated safety Level / bar						NA
11	Associated outputs						NA

LOOP DOCUMENTATION

12	Loop diagram is marked up and attached to this test sheet	OK
13	Cause and effect chart is highlighted accordingly	OK
14	Any defect is recorded for punch list issuance	NA

Comments:

Page 1/1	Performed by	☒ WITNESS ☐ REVIEW	☒ WITNESS ☐ REVIEW
Company	RM COMM	RM COMM	CW
Name	Marco Di Maria	Giandonato Delmissier	John Mackillop
Date	2025-02-08	2025-02-08	2025-02-11
Signature	PROVERLIS Digitaly signed by Marco Di Maria 2025-02-08T11:22:30.478Z	PROVERLIS Digitaly signed by Giandonato Delmissier 2025-02-08T22:31:41.676Z	PROVERLIS Digitaly signed by John Mackillop 2025-02-11T05:39:48.320Z

DB3BM sounders range up to 116dB

Ex d, weatherproof



Overview

The DB3BM is a high power explosion proof sounder, introduced as a replacement for the current DB1 / DB1H with improved functionality and performance. Certified for use in a wide range of temperatures from -60°C to +85°C the Ex enclosure is manufactured in either marine grade alloy or stainless steel with a rugged thermoplastic flare providing a corrosion free and aesthetically pleasing product.

Capable of producing 116 dB @ 1m and with a range of pre-recorded tones, the DB3BM includes an integral volume control which is ideal when a lower output is required.

The unit is provided with versatile control options allowing compatibility with a wide range of control methods and PLCs.

The standard DC unit provides 3 tone stages, each stage has 28 tones available which can be independently selected. The unit can be controlled by reversing the polarity of the power supply (2 stage) or providing a common negative and switching between multiple positive supplies.

The DB3BM proves its versatility by additionally being able to work with a common positive supply and switching the negatives. The tone stages of the DB3BM can also be controlled via voltage free contacts provided by a control panel.

The flexibility of the range continues with a wide range of supply voltages. The short flare option is a worthy addition to the range offering a high SPL in a compact unit.

Features

- UKEX / ATEX / IECEx
  Ex db IIC T4/T5/T6 Gb
  Ex tb IIIC T4/T5/T6 Db
- Certified temperature: –60°C to +85°C
- IP66 & IP67 (terminal only)
- Up to 116 dB output @ 1 m
- Integral volume control
- 28 tones, user selectable
- 3 stage unit remotely switchable
- Tones can be programmed to customer's specification
- DC supply voltage between 12 V and 48 V
- End of line resistor option
- Sounder & beacon combination units available, for further details contact MEDC
- Ex enclosure – marine grade alloy or stainless steel
- Flare - high impact thermoplastic polyester
- Stainless steel mounting bracket and cover screws
- Mounting bracket has ratchet facility as standard
- Swivel bracket standard on Stainless steel unit, optional on Alloy units



Stainless steel body, short flare version

ATEX IECEx UKCA

Eaton
Unit B, Sutton Parkway
Oddicroft Lane
Sutton in Ashfield
United Kingdom
NG17 5FB

T: +44 (0) 1623 444 400
www.crouse-hinds.com/hac
MEDCSales@Eaton.com

Powering Business Worldwide

© 2022 Eaton
All Rights Reserved
Printed in UK
Publication
No.DSMC0032/B
March 2022

Eaton is a registered trademark.

All other trademarks are property of their respective owners.

All specifications, dimensions, weights and tolerances are nominal (typical) and Eaton reserve the right to vary all data without prior notice.
No liability is accepted for any consequence of use.

Certifications

ATEX Ex db	Cert. no. UL 21 ATEX02559X. Certified to: EN IEC 60079-0, EN 60079-1, 31 Ex II 2GD, Ex db IIC T3/T4/T5/T6 Gb, Ex tb IIIC T200°C/T135°C/T100°C/T85°C Db, IP66 (IP65 short flare)
IECEx Ex db	Cert. no. IECEx ULD 21.0017X. Certified to: IEC60079-0,1,31 Ex db IIC T3/T4/T5/T6 Gb, Ex tb IIIC T200°C/T135°C/T100°C/T85°C Db, IP66 (IP65 short flare)
UKEX Ex db	Cert. no. UL21UKEX2209X. Certified to: EN IEC 60079-0, EN 60079-1, 31 Ex II 2GD, Ex db IIC T3/T4/T5/T6 Gb, Ex tb IIIC T200°C/T135°C/T100°C/T85°C Db IP66 (IP65 short flare)
Safe Area	EN 61010-1, EN 60529, EN61000-6

Specifications

Material	Ex enclosure – marine grade alloy or stainless steel Flare - flame retardant, high impact, UV stable, thermoplastic polyester (UV stability tested to ISO 4892 part 3) Hardware - bracket, fixings and captive cover screws in 316 stainless steel
Fire retardancy	Outer flare - thermoplastic polyester. V0 flammability rating
Finish	Body – alloy: painted black. Stainless steel: painted black. Flare - natural black, natural red or painted as specified
Voltage	DC: 12 - 48 V. AC: Up to 254 V. if using EOL resistor/s the maximum power dissipation must be limited to 3 W.
Weight	Alloy - 4.4 kg, stainless steel 8.35 kg based on long flare DC unit
Ingress protection	IP66 & IP67 (terminal only). IP65 short flare
Entries	Up to 2 x M20 or M25 or ½"or ¾" NPT. Blanking plug available
Terminals	AC: 4 x 1.5mm² (loop in / out power), 3 x 2.5mm² (tone selection) (standard unit only) DC: 8 x 2.5mm² (8 for loop in / out power and tone selection) (standard unit only)
Mounting arrangement	Stainless steel bracket with ratchet facility, optional swivel bracket available. Swivel standard on stainless steel unit
Labels	Optional duty and tag labels available
Tone information	28 tones per stage. Additional custom tones available (contact MEDC) Suitable for use with 200 Hz tones
Relative Humidity	99% Non-condensing

Tone activation and selection

Voltage	Unit	No.of stages	Tone activation	Tone selection
DC	Standard	1	Apply power	1 x DIP switch
		2	Reverse polarity	2 x DIP switches
			Common -ve with 2 +ve supplies	2 x DIP switches
			*Common +ve with 2 -ve supplies	2 x DIP switches
		3	Common -ve with 3 +ve supplies	3 x DIP switches
	Alternative tone activation (Option M)	2	*Common -ve with 2 +ve supplies	2 x DIP switches
		3	Common +ve with 3 -ve supplies	3 x DIP switches
	Alternative tone activation (remote) (Option R)	1-5	Volt free activation (remote switching)	1 x DIP switch for stage 1. Tone pre-selected for subsequent stages
AC	Standard	1	Apply power	1 x DIP switch
	Alternative tone activation (remote) (Option R)	1-2	Volt free activation (remote switching)	1 x DIP switch for stage 1. Tone preselected for the 2nd stage

*Reverse polarity line monitoring can be used with common positive or negative switching to give up to 2 operational stages and a 3rd monitoring connection. An EOL resistor can be fitted as shown in the technical manual. All connection details are shown in the technical manual.

Current consumption: Based on a continuous 970Hz tone

Voltage	Current for IIC unit	Current for IIIC unit
12 Vdc	700 mA	716 mA
24 Vdc	329 mA	339 mA
48 Vdc	171 mA	173 mA
110 Vac	115 mA	122 mA
120 Vac	106 mA	113 mA
220 Vac	59 mA	63 mA
230 Vac	52 mA	55 mA
240 Vac	55 mA	58 mA
254 Vac	59 mA	63 mA


	Ex d/UL min	Max
Certified temperature	-60°C	+85°C


Operating temperature at launch (DC Only): -40 °C min +85 °C max
-55 °C as standard to follow. Please contact MEDC for low temperature options

	Short Flare	Long Flare
Max output (dB) 1400Hz @ 1m	113 dB	116 dB

For Labels and Entries select any option as required. For Options select either (N) None or (E) EOL as required
Tolerance +/-3dB. Please see the technical manual for tone specific SPL values

General arrangement drawing (all dimensions in mm)

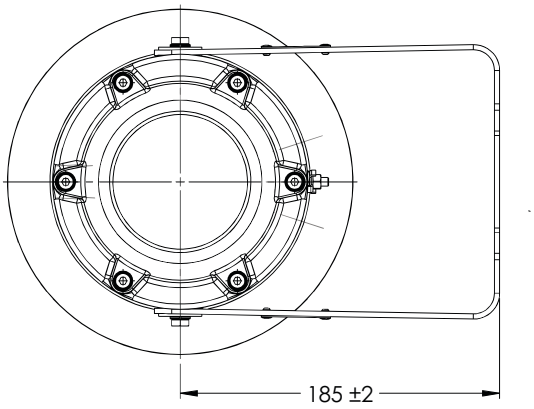

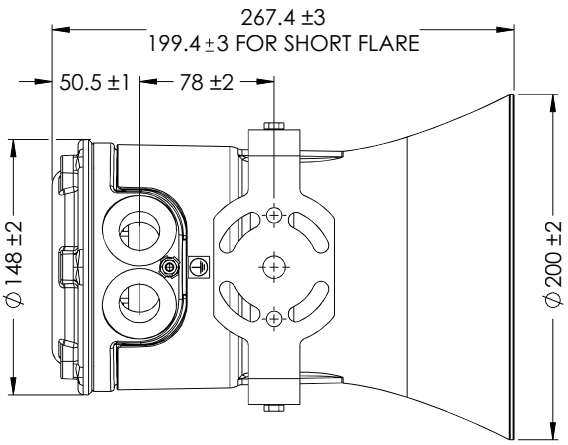

Ordering requirements

The following code is designed to help in selection of the correct unit. Build up the reference number by inserting the code for each component into the appropriate box

Model: DB3BM

Material: S

Finish	Code
Alloy	A
Stainless Steel	S

Ex Certification: D

Ex Certification	Code
UKEX/ATEX Ex d	D
IECEx Ex d	J
Weatherproof	W

Voltage: 048

Voltage	Code
12-48 Vdc	048‡
110 Vac	110
120 Vac	120*
220 Vac	220
230 Vac	230
240 Vac	240*
254 Vac	254

*Complies with UL regulated power supply requirements

Labels: DT

Labels	Code
None	N
Duty	D*
Tag	T*

*Please specify

Entries: 1B

Entries	Code
1 x M20	1B
2 x M20	2B
2 x M20 inc 1 x plug	2BP
1 x ½" NPT	1C
2 x ½" NPT	2C
2 x ½" NPT inc 1 x plug	2CP
1 x M25	1D
2 x M25	2D
2 x M25 inc 1x plug	2DP
1 x ¾" NPT	1E
2 x ¾" NPT	2E
2 x ¾" NPT inc 1x plug	2EP

Options: N

Options	Code
None	N
Swivel bracket	B‡
EOL	E*
Alternative tone activation	M**
Volt free activation (remote)	R**
Short flare	S
Custom tones (not std 27)	TΔ

‡ Alloy only - stainless steel has swivel as standard
*Specify value max power dissipation is 3W
**These options cannot be selected together
ΔSpecify details

Finish: R (RAL 3020)


Finish	Code
Natural black	N
Natural red	R
Yellow	Y
Grey	G
Blue	B
Special	S*

*Please specify

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 01

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

AS BUILT
05/02/25

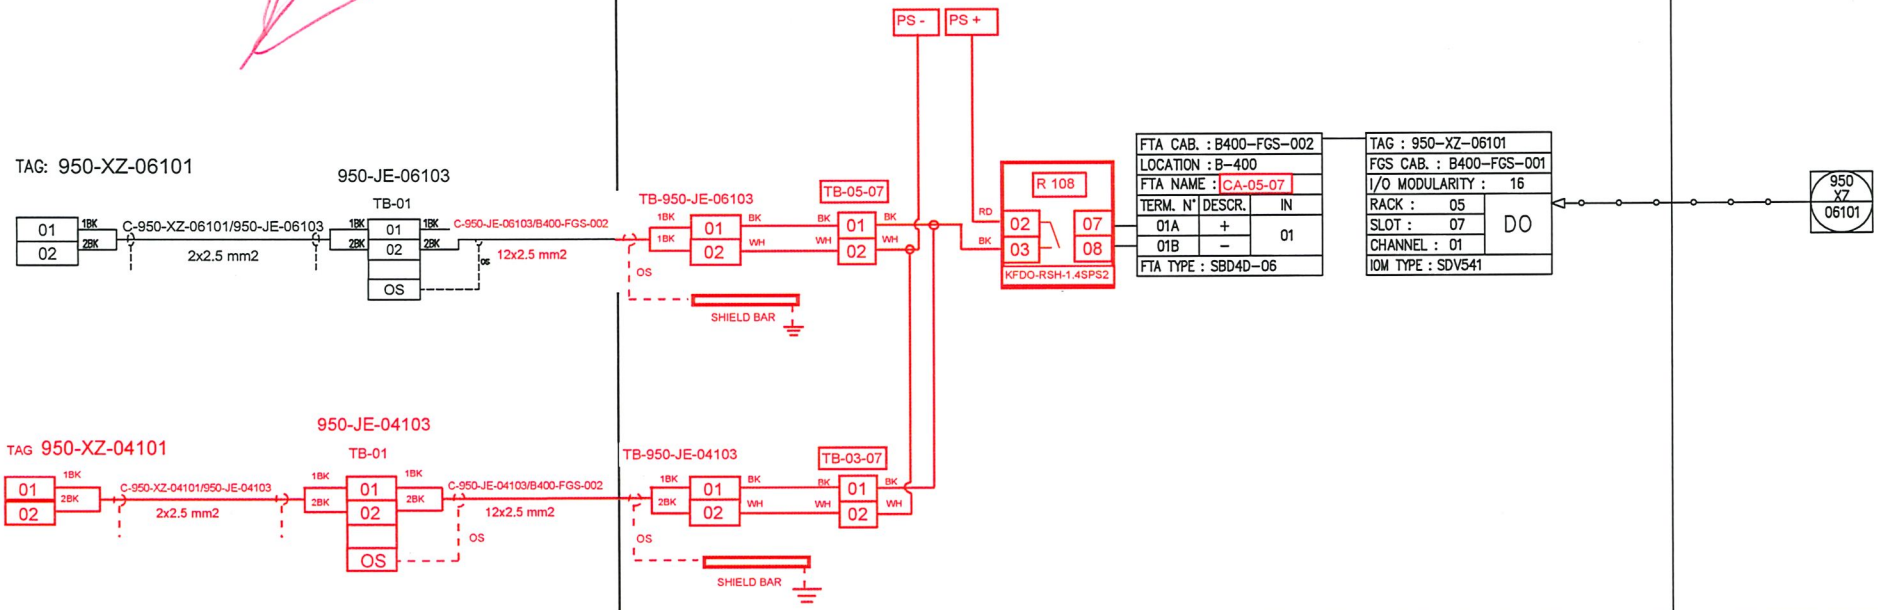

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	06/12/2024	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV: 1_A | DATE: 20/12/24 | SIGNATURE: C.Pilato
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSTRUMENT LOOP DIAGRAM
950-XZ-06101
FZ-06 ACOUSTIC FIRE&GAS ALARM

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024
A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 421	REV. 01

File Name : 123A90-DDL-IN-DG-40014_REV.01

ROSETTI MARINO | PROVERLIS | CROSSWIND

ITEM	Tag	950-XZ-06201	: FZ-06 Sounder Act. - B-100 Indoor		Dwg	123A90-DDL-SAF-DL-30027	
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)		Module	LD_B-100	
TASK	code	C10004474	Location	Onshore Activities	User	Rosetti Marino Quality Control	
FORM	Process	PRE-COMM	Activity	FTS	Discipline	Instrumental	Form FJ04MS	Monotone Sounder

LOOP DATA

Loop TAG	950-XZ-06201				TSLD	123A90-DDL-IN-DG-40014 rev. 1_A			
IO Type	Input	No	Output	Yes	Energy by transmitter	No	Energy by system	Yes	
Marshalling	B400-FGS-001	Terminal	06A/06B		Slot	07	Rack	05	Chanel 06

LOOP TEST

1	Check earth isolation of the loop.					OK
2	Connect loop to terminal					OK
3	Energise Loop (close loop) and record status	Normal	No	Alarm/trip	Yes	OK
4	De-Energise Loop (open loop) and record status	Normal	Yes	Alarm/trip	No	OK
5	Record Fail Safe position	Open	NA	Closed	NA	NA

LOOP SERVICE

		Action Fire&Gas alarm		Alarm / Control FGS		Display PCS	
6	Loop energized	Yes		Yes		NA	OK
7	Loop not energized	No		Yes		NA	OK
8	Checking of line monitoring	Yes		Yes		OK	OK
9	Checking of Maintenance Inhibition	NA		NA		NA	NA
10	Associated safety Level / bar						NA
11	Associated outputs						NA

LOOP DOCUMENTATION

12	Loop diagram is marked up and attached to this test sheet	OK
13	Cause and effect chart is highlighted accordingly	OK
14	Any defect is recorded for punch list issuance	NA

Comments:

Page 1/1	Performed by	☒ WITNESS ☐ REVIEW	☒ WITNESS ☐ REVIEW
Company	RM COMM	RM COMM	CW
Name	Marco Di Maria	Giandonato Delmissier	John Mackillop
Date	2025-02-08	2025-02-08	2025-02-11
Signature	PROVERLIS Digitaly signed by Marco Di Maria 2025-02-08T11:24:59.437Z	PROVERLIS Digitaly signed by Giandonato Delmissier 2025-02-08T22:32:06.952Z	PROVERLIS Digitaly signed by John Mackillop 2025-02-11T05:40:22.869Z

DB3BM sounders range up to 116dB

Ex d, weatherproof



Overview

The DB3BM is a high power explosion proof sounder, introduced as a replacement for the current DB1 / DB1H with improved functionality and performance. Certified for use in a wide range of temperatures from -60°C to +85°C the Ex enclosure is manufactured in either marine grade alloy or stainless steel with a rugged thermoplastic flare providing a corrosion free and aesthetically pleasing product.

Capable of producing 116 dB @ 1m and with a range of pre-recorded tones, the DB3BM includes an integral volume control which is ideal when a lower output is required.

The unit is provided with versatile control options allowing compatibility with a wide range of control methods and PLCs.

The standard DC unit provides 3 tone stages, each stage has 28 tones available which can be independently selected. The unit can be controlled by reversing the polarity of the power supply (2 stage) or providing a common negative and switching between multiple positive supplies.

The DB3BM proves its versatility by additionally being able to work with a common positive supply and switching the negatives. The tone stages of the DB3BM can also be controlled via voltage free contacts provided by a control panel.

The flexibility of the range continues with a wide range of supply voltages. The short flare option is a worthy addition to the range offering a high SPL in a compact unit.

Features

- UKEX / ATEX / IECEx
  Ex db IIC T4/T5/T6 Gb
  Ex tb IIIC T4/T5/T6 Db
- Certified temperature: –60°C to +85°C
- IP66 & IP67 (terminal only)
- Up to 116 dB output @ 1 m
- Integral volume control
- 28 tones, user selectable
- 3 stage unit remotely switchable
- Tones can be programmed to customer's specification
- DC supply voltage between 12 V and 48 V
- End of line resistor option
- Sounder & beacon combination units available, for further details contact MEDC
- Ex enclosure – marine grade alloy or stainless steel
- Flare - high impact thermoplastic polyester
- Stainless steel mounting bracket and cover screws
- Mounting bracket has ratchet facility as standard
- Swivel bracket standard on Stainless steel unit, optional on Alloy units



Stainless steel body, short flare version

ATEX IECEx UKCA

Eaton
Unit B, Sutton Parkway
Oddicroft Lane
Sutton in Ashfield
United Kingdom
NG17 5FB

T: +44 (0) 1623 444 400
www.crouse-hinds.com/hac
MEDCSales@Eaton.com

Powering Business Worldwide

© 2022 Eaton
All Rights Reserved
Printed in UK
Publication
No.DSMC0032/B
March 2022

Eaton is a registered trademark.

All other trademarks are property of their respective owners.

All specifications, dimensions, weights and tolerances are nominal (typical) and Eaton reserve the right to vary all data without prior notice.
No liability is accepted for any consequence of use.

Certifications

ATEX Ex db	Cert. no. UL 21 ATEX02559X. Certified to: EN IEC 60079-0, EN 60079-1, 31 Ex II 2GD, Ex db IIC T3/T4/T5/T6 Gb, Ex tb IIIC T200°C/T135°C/T100°C/T85°C Db, IP66 (IP65 short flare)
IECEx Ex db	Cert. no. IECEx ULD 21.0017X. Certified to: IEC60079-0,1,31 Ex db IIC T3/T4/T5/T6 Gb, Ex tb IIIC T200°C/T135°C/T100°C/T85°C Db, IP66 (IP65 short flare)
UKEX Ex db	Cert. no. UL21UKEX2209X. Certified to: EN IEC 60079-0, EN 60079-1, 31 Ex II 2GD, Ex db IIC T3/T4/T5/T6 Gb, Ex tb IIIC T200°C/T135°C/T100°C/T85°C Db IP66 (IP65 short flare)
Safe Area	EN 61010-1, EN 60529, EN61000-6

Specifications

Material	Ex enclosure – marine grade alloy or stainless steel Flare - flame retardant, high impact, UV stable, thermoplastic polyester (UV stability tested to ISO 4892 part 3) Hardware - bracket, fixings and captive cover screws in 316 stainless steel
Fire retardancy	Outer flare - thermoplastic polyester. V0 flammability rating
Finish	Body – alloy: painted black. Stainless steel: painted black. Flare - natural black, natural red or painted as specified
Voltage	DC: 12 - 48 V. AC: Up to 254 V. if using EOL resistor/s the maximum power dissipation must be limited to 3 W.
Weight	Alloy - 4.4 kg, stainless steel 8.35 kg based on long flare DC unit
Ingress protection	IP66 & IP67 (terminal only). IP65 short flare
Entries	Up to 2 x M20 or M25 or ½"or ¾" NPT. Blanking plug available
Terminals	AC: 4 x 1.5mm² (loop in / out power), 3 x 2.5mm² (tone selection) (standard unit only) DC: 8 x 2.5mm² (8 for loop in / out power and tone selection) (standard unit only)
Mounting arrangement	Stainless steel bracket with ratchet facility, optional swivel bracket available. Swivel standard on stainless steel unit
Labels	Optional duty and tag labels available
Tone information	28 tones per stage. Additional custom tones available (contact MEDC) Suitable for use with 200 Hz tones
Relative Humidity	99% Non-condensing

Tone activation and selection

Voltage	Unit	No.of stages	Tone activation	Tone selection
DC	Standard	1	Apply power	1 x DIP switch
		2	Reverse polarity	2 x DIP switches
			Common -ve with 2 +ve supplies	2 x DIP switches
			*Common +ve with 2 -ve supplies	2 x DIP switches
		3	Common -ve with 3 +ve supplies	3 x DIP switches
	Alternative tone activation (Option M)	2	*Common -ve with 2 +ve supplies	2 x DIP switches
		3	Common +ve with 3 -ve supplies	3 x DIP switches
	Alternative tone activation (remote) (Option R)	1-5	Volt free activation (remote switching)	1 x DIP switch for stage 1. Tone pre-selected for subsequent stages
AC	Standard	1	Apply power	1 x DIP switch
	Alternative tone activation (remote) (Option R)	1-2	Volt free activation (remote switching)	1 x DIP switch for stage 1. Tone preselected for the 2nd stage

*Reverse polarity line monitoring can be used with common positive or negative switching to give up to 2 operational stages and a 3rd monitoring connection. An EOL resistor can be fitted as shown in the technical manual. All connection details are shown in the technical manual.

Current consumption: Based on a continuous 970Hz tone

Voltage	Current for IIC unit	Current for IIIC unit
12 Vdc	700 mA	716 mA
24 Vdc	329 mA	339 mA
48 Vdc	171 mA	173 mA
110 Vac	115 mA	122 mA
120 Vac	106 mA	113 mA
220 Vac	59 mA	63 mA
230 Vac	52 mA	55 mA
240 Vac	55 mA	58 mA
254 Vac	59 mA	63 mA


	Ex d/UL min	Max
Certified temperature	-60°C	+85°C


Operating temperature at launch (DC Only): -40 °C min +85 °C max
-55 °C as standard to follow. Please contact MEDC for low temperature options

	Short Flare	Long Flare
Max output (dB) 1400Hz @ 1m	113 dB	116 dB

For Labels and Entries select any option as required. For Options select either (N) None or (E) EOL as required
Tolerance +/-3dB. Please see the technical manual for tone specific SPL values

General arrangement drawing (all dimensions in mm)

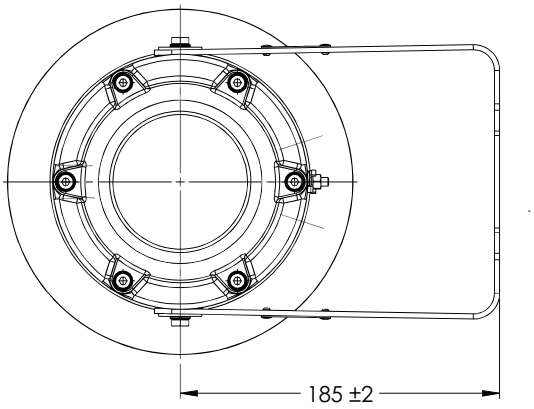

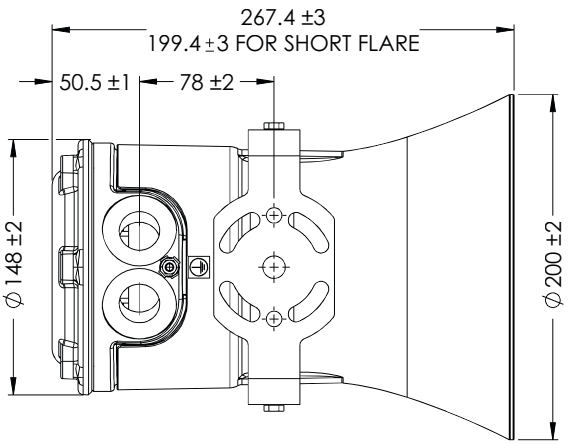

Ordering requirements

The following code is designed to help in selection of the correct unit. Build up the reference number by inserting the code for each component into the appropriate box

Model: DB3BM

Material: S

Finish	Code
Alloy	A
Stainless Steel	S

Ex Certification: D

Ex Certification	Code
UKEX/ATEX Ex d	D
IECEx Ex d	J
Weatherproof	W

Voltage: 048

Voltage	Code
12-48 Vdc	048‡
110 Vac	110
120 Vac	120*
220 Vac	220
230 Vac	230
240 Vac	240*
254 Vac	254

*Complies with UL regulated power supply requirements

Labels: DT

Labels	Code
None	N
Duty	D*
Tag	T*

*Please specify

Entries: 1B

Entries	Code
1 x M20	1B
2 x M20	2B
2 x M20 inc 1 x plug	2BP
1 x ½" NPT	1C
2 x ½" NPT	2C
2 x ½" NPT inc 1 x plug	2CP
1 x M25	1D
2 x M25	2D
2 x M25 inc 1x plug	2DP
1 x ¾" NPT	1E
2 x ¾" NPT	2E
2 x ¾" NPT inc 1x plug	2EP

Options: N

Options	Code
None	N
Swivel bracket	B‡
EOL	E*
Alternative tone activation	M**
Volt free activation (remote)	R**
Short flare	S
Custom tones (not std 27)	TΔ

‡ Alloy only - stainless steel has swivel as standard
*Specify value max power dissipation is 3W
**These options cannot be selected together
ΔSpecify details

Finish: R (RAL 3020)


Finish	Code
Natural black	N
Natural red	R
Yellow	Y
Grey	G
Blue	B
Special	S*

*Please specify

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 01

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

AS BUILT
05/02/25

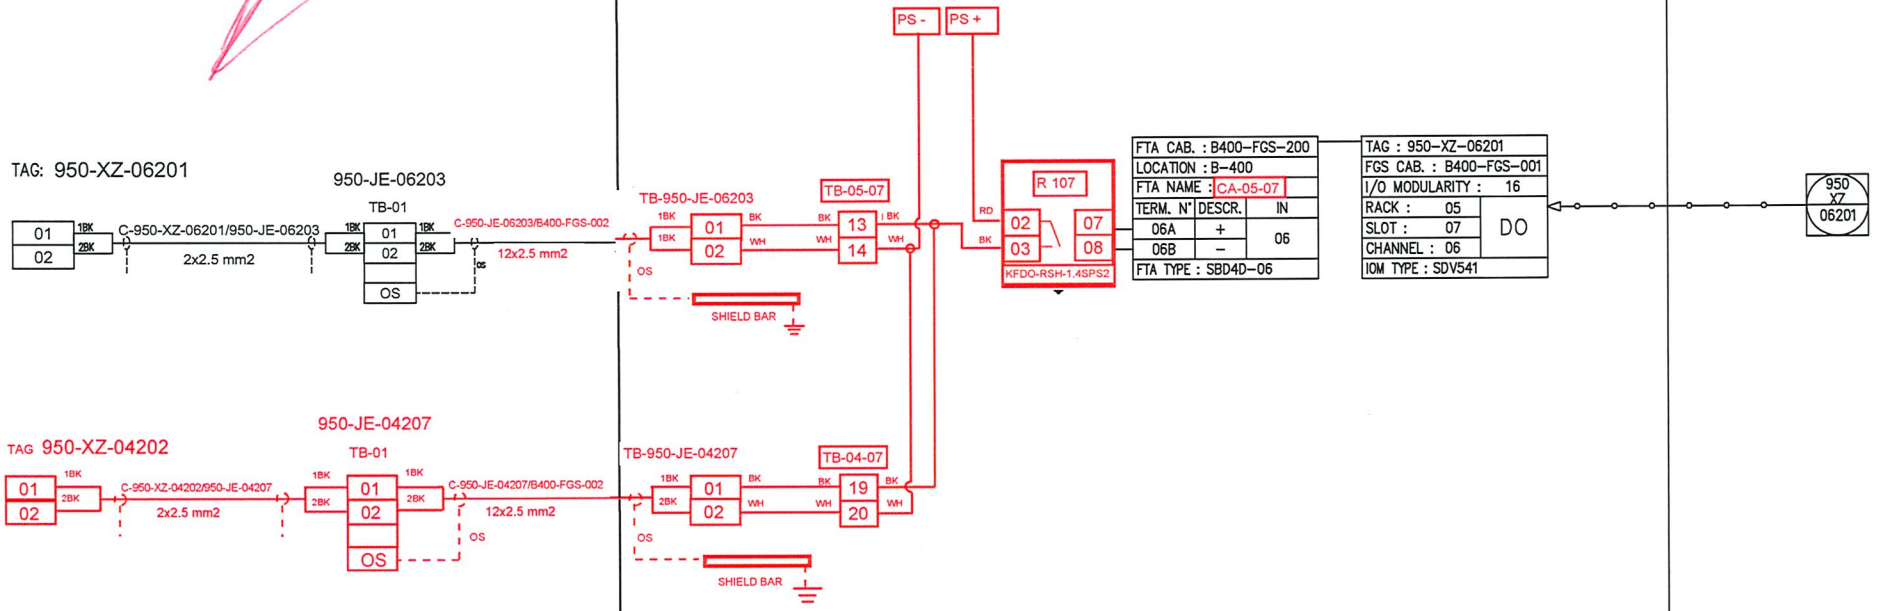

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	06/12/2024	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV. 1_A | DATE: 20/12/24 | SIGNATURE: C.Pilato
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSTRUMENT LOOP DIAGRAM
950-XZ-06201
FZ-06 ACOUSTIC FIRE&GAS ALARM B-100 HV/MV SWGR ROOM

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024
A3	DRAWING NO. 123A90-DDL-IN-DG-40014	SHEET 422	REV. 01

File Name : 123A90-DDL-IN-DG-40014_REV.01

ITEM	Tag	950-FDZ-06102	: Flame Detector - FZ-06 B-100 Area			Dwg	123A90-DDL-SAF-DL-30027
	S/Sys	70-17	: F&G Devices FZ-06 (B-100 HV/MV Switchroom Area)			Module	LD_B-100_Ext
TASK	code	C10004856		Location	Onshore Activities	User	Rosetti Marino Quality Control
FORM	Process	COMM	Activity FTS	Discipline	Instrumental Form FJ04F		Fire Detection

Loop Tag:	950-FDZ-06102			TDSL rev.:	123A90-FDL-IN-DG-40014 rev.1A		
Cabinet:	B400-FGS-001	Rack:	05	Slot:	01	Channel:	10
Output Signal:	mA						

Threshold: Fire Alarm - H [ ] Fire Alarm - HH [20 mA]

Checking of Dirty optical [●]

Checking of invalidity [●]

Checking of Maintenance inhibition [ ]

TESTING & MEASUREMENT INSTRUMENT USED

Type	Serial N.	Calibration Certificate	Validity
FLS-FSIM-UV-IR	1544		

Comments:

	Performed by	● WITNESS ☐ REVIEW	● WITNESS ☐ REVIEW
Company	RM COMM	RM COMM	CW OPS
Name	Laurentiu Grozavu	Giandonato Delmissier	Jamie McAllister
Date	2025-01-29	2025-01-29	2025-01-30
Signature	Digitaly signed by Laurentiu Grozavu 2025-01-29T06:54:16.422Z	Digitaly signed by Giandonato Delmissier 2025-01-29T09:06:30.498Z	Digitaly signed by Jamie McAllister 2025-01-30T07:57:59.899Z

FlameSpec
UV-IR
UV-IR Flame Detector



The FlameSpec UV-IR will detect fires and explosions extremely quickly, thereby allowing mitigation steps to be initiated more rapidly to limit event escalation.

Introduction

The FlameSpec-UV-IR flame detector provides ultra-fast response, high performance and reliable detection of a large variety of fires including hydrocarbon fires (visible and non-visible), as well as hydrogen and methane/hydrogen mixed fires. The detector addresses slow growing fires as well as fast eruptions of fire using improved UV-IR technology. The detector operates in all weather and light conditions.

Key Benefits

- High immunity to false alarm
- High sensitivity – up to 100 ft. (30m) for a 1 ft^2 (0.1m^2) n-heptane pan fire.
- Hydrocarbon and non-hydrocarbon flame detection.
- Ultra-fast detection mode detection within 5 milliseconds for fireballs or explosions
- High speed (<0.5s) model [X5] available for compliance with NFPA 33.
- Four sensitivity levels.
- Universal outputs, 3 and 4 wire, 4-20 mA sink / source, Fire, Auxiliary and Fault Relays. RS485 port using Modbus RTU.
- Event logger – alarms, faults and other relevant events are logged to non-volatile memory
- Built-in-Test (BIT) – Automatic and manual self-test of window cleanliness and overall detector operation.
- Dirty optics warning for preventive maintenance needs.
- HART® 7, for configuration & maintenance - option available.
- Window heater to avoid condensation and icing.
- Stainless steel tilt mount with horizontal and vertical adjustment.
- Functional safety - SIL 2 capable - option available.
- Detect high UV (sparks and arcs) or IR levels via auxiliary relay and 4-20mA.

Fire and Gas Detection Technologies Inc. | 4222 E. La Palma Ave. Anaheim, CA 92807 USA
Tel: (+1) 714-671-8500 | support@fg-detection.com
Version: F110V0010.08 • May 2023

FlameSpec UV-IR

UV-IR Flame Detector

Model: FLS-UV-IR

Response Characteristics

Fuel	Size	Sensitivity	Distance ft. (m)	Avrg Resp.Time (s)
N-Heptane	1 x 1 ft.	Extreme	98 (30)	2.0
N-Heptane	1 x 1 ft.	High	75 (23)	1.7
N-Heptane	1 x 1 ft.	Medium	49 (15)	1.0
N-Heptane	1 x 1 ft.	Low	16 (5)	1.0
Gasoline	2 x 2 ft.	Extreme	197 (60)	3.3
Gasoline	1 x 1 ft.	Extreme	98 (30)	1.8
Gasoline	1 x 1 ft.	Medium	49 (15)	1.3
Methane	32-in Plume	Extreme	59 (18)	1.4
Methane	32-in Plume	Medium	30 (9)	0.9
LPG	32-in Plume	Extreme	75 (23)	1.2
LPG	32-in Plume	High	56 (17)	1.6
LPG	32-in Plume	Medium	33 (10)	1.2
LPG	32-in Plume	Low	13 (4)	1.2
Diesel	1 x 1 ft.	Extreme	75 (23)	2.6
Diesel	1 x 1 ft.	Medium	36 (11)	1.2
JP5	1 x 1 ft.	Extreme	75 (23)	3.3
JP5	1 x 1 ft.	High	56 (17)	1.8
JP5	1 x 1 ft.	Medium	36 (11)	1.2
JP5	1 x 1 ft.	Low	16 (5)	1.2
Kerosene	1 x 1 ft.	Extreme	75 (23)	1.8
Kerosene	1 x 1 ft.	Medium	36 (11)	0.9
Methanol	1 x 1 ft.	Extreme	52 (16)	0.8
Methanol	1 x 1 ft.	High	43 (13)	3.2
Methanol	1 x 1 ft.	Medium	30 (9)	1.3
Methanol	1 x 1 ft.	Low	10 (3)	2.7
Ethanol	1 x 1 ft.	Extreme	62 (19)	4.1
Ethanol	1 x 1 ft.	Medium	31 (9.5)	2.9
Isopropanol	1 x 1 ft.	Extreme	75 (23)	2.2
Isopropanol	1 x 1 ft.	Medium	36 (11)	0.8
Polypropylene	1 x 1 ft.	Extreme	49 (15)	1.4
Polypropylene	1 x 1 ft.	Medium	23 (7)	0.9
Hydrogen	32-in Plume	Extreme	66 (20)	6.4
Hydrogen	32-in Plume	Medium	33 (10)	1.0
Syngas (30%CH_4:70%H_2)	32-in Plume	Extreme	59 (18)	3.2
Syngas (30%CH_4:70%H_2)	32-in Plume	Medium	33 (10)	1.2

FlameSpec UV-IR

UV-IR Flame Detector

Model: FLS-UV-IR

Immunity to False Alarm

False Alarm Source	Modulated		Unmodulated	
	Distance ft. (m)	Response	Distance ft. (m)	Response
Sunlight, Direct, Reflected		No Alarm		No Alarm
Incandescent frosted glass light, 300W	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Fluorescent, 70W (3x23.3W)	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Electric arc	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Arc welding	10.0 (3.0)	No Alarm	10.0 (3.0)	No Alarm
Radiation heater, 2000W	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Halogen lamp (500W) non-shielded	7.0 (2.0)	No Alarm	7.0 (2.0)	No Alarm
Halogen lamp (1000W)	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Mercury vapor lamp 160Wx3	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Exhausts	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Projector led	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Solenoid bell	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
soldering iron	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm
Electric Drill	2.0 (0.5)	No Alarm	2.0 (0.5)	No Alarm

FlameSpec UV-IR

UV-IR Flame Detector

Model: FLS-UV-IR

FIRE DETECTION	**Detection time and distance**	5ms for fast burst of explosion 1s for 1 ft² (0.1m²) n-heptane pan fire at 0–50 ft. (0–15m) < 2s for 1 ft² (0.1m²) n-heptane pan fire at 50–100 ft. (15–30m)
	Sensitivity Range	4 sensitivity ranges: Extreme, High, Medium, Low
	Field of view (IR detection)	90° Horizontal, 80° Vertical
	Time Delay	0-30 seconds
	Built in Test	Automatic and Manual
ELECTRICAL SPECIFICATIONS	**Operating Voltage**	24 VDC nominal (18-32 VDC)
	Current Consumption	Standby: 120mA 180mA all systems in operation (including window heater)
	Electrical Entries	2x cable and conduit entries 3/4" NPT(F) or M25x1.5
	Wiring	14-17 AWG (2.5–1.0 mm²)
OUTPUTS	**Relays**	SPST volt-free contacts rated 2A at 30 VDC 3 relays: Alarm & Auxiliary – normally open; Fault – normally closed
	0-20mA (stepped) current output	3 wire and 4 wire (isolated) configurations (sink and source) HART® rev 7.0 (option available)
	Indication	Tri-color LED (Green, Yellow, Red)
	Modbus	RTU compatible on RS-485
MECHANICAL SPECIFICATIONS	**Size**	5.51 x 3.54 × 3.54" (140×90×90mm)
	Weight	Detector (Stainless Steel 316): 6.6 lbs. (3.0 kg) Tilt mount (Stainless Steel 316): 3.3 lbs. (1.5 kg)
ENVIRONMENTAL SPECIFICATIONS	**Temperature Range**	Operating: -67°F to +185°F (-55°C to +85°C) Storage: -67°F to +185°F (-55°C to +85°C)
	Humidity	Up to 99% (RH), non-condensing
	Ingress Protection	IP66 & 68 (2m, 24hr); NEMA 4X & 6P
APPROVALS	**ATEX**	ATEX: II 2 G D Ex db IIC T5 Gb or Ex db eb IIC T5 Gb and Ex tb IIIC T95°C Db -55°C<Ta<75°C Ex db IIC T4 Gb or Ex db eb IIC T4 Gb and Ex tb IIIC T105°C Db -55°C<Ta<85°C
	IECEx, INMETRO & PESO	Ex db IIC T5 Gb -50°C≤Ta≤75°C Ex db IIC T4 Gb -50°C≤Ta≤85°C
	FMus & FMc	Class I, Div. 1, Groups B, C & D; T4 Class I, Zone 1, AEx/Ex db IIC T4 Gb T4 -50°C≤Ta≤85°C T5 -50°C≤Ta≤75°C
	EAC CU TR	1Ex d IIC T5 Gb or 1Ex de IIC T5 Gb and Ex tb IIIC T95°C Db -55°C≤Ta≤75°C 1Ex d IIC T4 Gb or 1Ex de IIC T4 Gb and Ex tb IIIC T105°C Db -55°C≤Ta≤85°C
	Performance	ANSI FM 3260 EN 54-10
	Functional safety	Certified SIL2 capable per IEC 61508:2010 High & Low demand (option available)

ACCESSORIES	**Tilt mount, model FLS-TMO-S01**	**High vibration mounting bracket, model FLS-MIL-S01**
	Weather cover, model FLS-WCO-S01	**Flame simulator, model FLS-FSIM-UV-IR-KIT**
	2" & 3" pole mount adapter, model FLS-PMA-S23	**Airshield, model FLS-ASD-S01**
	Duct mount with window, model FLS-DMW-S01	**Duct mount for airshield, model FLS-DMX-S01**
WARRANTY	**5 years**	

FlameSpec
FLS-FSIM
Flame Simulator Family



The FlameSpec Flame Simulator range provides fast and convenient detector verification in the field.

Introduction

Flame simulators are often used by industry to perform detector testing during commissioning and periodic system testing. FlameSpec simulators differ from many competing products because they test the active sensors and detection algorithms of the devices without using "bypass" techniques to trick the detector into responding.

The FSIM range is lightweight, simple to use and has a modern ergonomic design. Suitable for use in hazardous areas, the FSIM-IR3 has an extended trigger distance of up to 30 feet (10 meters) from the detector.

Three FSIM models are available, depending on the FlameSpec Detector to be tested, IR3, IR3-H2 and UV-IR.

Key Benefits

- Tests the active sensors and detection algorithms, without using "bypass" techniques.
  - No tricks, detector performance assured.
- Works from distance up to 30 feet (10 meters).
  - Reduces the need for scaffolding.
- Hazardous area use approved.
  - Hot work permits not needed required.
- Lightweight and simple to use.
  - More than 1,000 activations between charges.
- Includes carrying strap, protective storage case, battery charger and operating instructions.
- Easy to transport & supplied with everything needed.
- Complementary to FlameSpec Detector inbuilt test features.
  - Enables full end to end (loop) system test.

Fire and Gas Detection Technologies Inc. | 4222 E. La Palma Ave., Anaheim, CA 92807
Tel: (+1) 714-671-8500 | support@fg-detection.com
Version: F300V0010.04 • Oct 2023

FlameSpec-FLS-FSIM


Flame Simulator Family

	Simulator Kits Part Nos	FLS-FSIM-IR3-KIT	FLS-FSIM-IR3-H2-KIT	FLS-FSIM-UV-IR-KIT
	Detector type	FLS-IR3[1] FLS-IR3-HD[1]	FLS-IR3-H2 FLS-IR3-H2-HD	FLS-UV-IR FLS-UV-IR-HD
OPERATION DISTANCES	**Detector Sensitivity**	ft. m	ft. m	ft. m
	Extreme	30 9.0	30 9.0	42.5 13.0
	High	20 6.0	20 6.0	26 8.0
	Medium	10 3.0	10 3.0	20 6.0
	Low	3.3[2] 1.0[2]	3.3[2] 1.0[2]	6.6 2.0
ELECTRICAL SPECIFICATIONS	**Operating Voltage nominal, V**	3.7	3.7	3.7
	Number of activations between charging	~1000	~1000	~50
	Battery Capacity, mAh	>3000	>3000	>3000
	Charging time, hours	up to 3	up to 3	up to 3
	Indication	3 Color LED (Green, Yellow, Red)		
	All Simulator Models			
MECHANICAL SPECIFICATIONS	**Size**	3.9 x 3.9 x 7.8" (100 x 100 x 200mm)		
	Weight	3.96 lbs. (1.8 kg)		
	Simulator Enclosure Material	Painted Aluminum LM25		
ENVIRONMENTAL SPECIFICATIONS	**Ingress Protection**	IP65 (NEMA 4X)		
	Humidity	up to 99% (RH), non-condensing		
	Operating temperature	Min: −4°F (−20°C) Max: +122°F (+50°C)		
APPROVALS	**Explosion proof**	ATEX Ex II 2 G Ex db ib op is IIC T6 Gb Ex II 2 D Ex tb ib op is IIIC T85°C Db -20°C<Ta<+50°C		
ACCESSORIES included in kits	**Carrying Case**	FLS-FSIM-CASE		
	Carrying Strap	FLS-FSIM-STRAP		
	Cover Tool	FLS-FSIM-TOOL		
	Allen Key	FLS-FSIM-ALLEN		
	Battery Charger	FLS-FSIM-CHRGR		
WARRANTY	**3 Years**			

[1]not CO2L variant
[2]with collimator removed

DRAWING NO. 123A90-DDL-IN-DG-40014 REV. 01

FIELD	ITER – B400	CENTRAL CONTROL ROOM
	FIRE AND GAS SYSTEM	OPERATOR CONSOLE

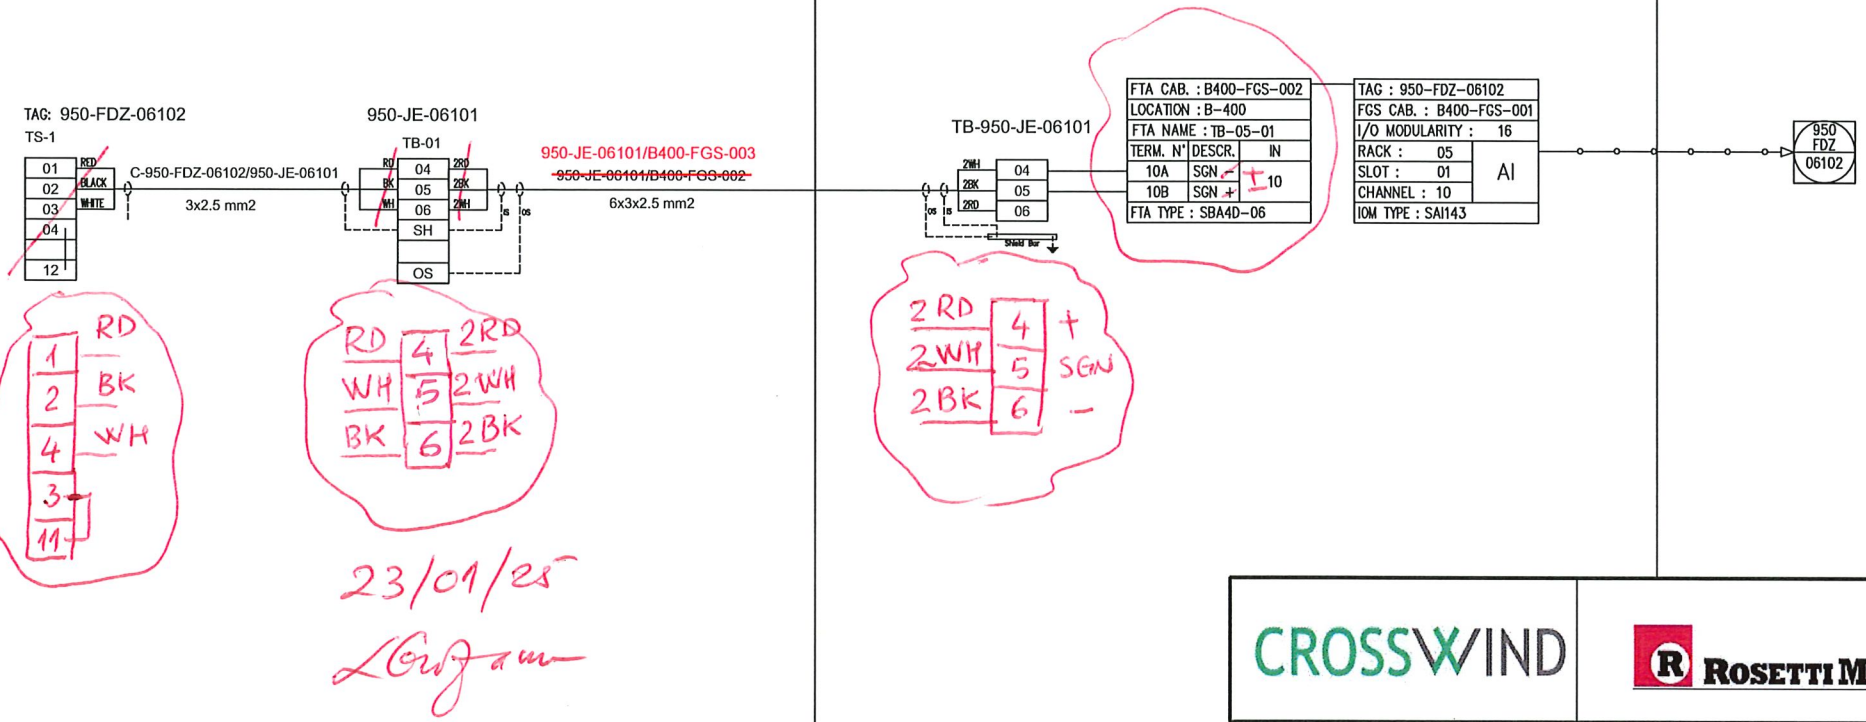

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	06/12/2024	VBA	LCA	DLO	ACCEPTED FOR CONSTRUCTION (AFC)
00	23/10/2024	VBA	LCA	DLO	ISSUE FOR REVIEW (IFR)

VALID FOR CONSTRUCTION
FDL DWG: 123A90-FDL-IN-DG-40014
REV: 1_A | DATE: 20/12/24 | SIGNATURE: C.Pilato
ROSETTI MARINO SpA

CROSSWIND

ROSETTI MARINO

TITLE : INSTRUMENT LOOP DIAGRAM
950–FDZ–06102
FZ–06 FLAME DETECT. IN B–100/TRANSFORMER AREA

CONTRACT NO./TITLE CONTRACT_NO.			SCALE 1:1
DRAWN: VBA	CHECKED: LCA	APPROVED: DLO	DATE 23/10/2024
A3	DRAWING NO. 123A90–DDL–IN–DG–40014	SHEET 198	REV. 01

File Name : 123A90-DDL-IN-DG-40014_REV.01

Section 4.4 Instrumentation “As-Commissioned” interconnection diagrams

NOT APPLICABLE

Section 4.5 Telecommunication functional test sheets index

NOT APPLICABLE

Section 4.6 Telecommunication
“As-Commissioned” I.C.D. / TSLD's

NOT APPLICABLE

Section 5 SITE / OPERATIONAL

Section 5.1 Operational Test Procedure

CROSSWIND	**123A90 - HOLLANDSE KUST NOORD WIND PARK BLPH Project** **COMMISSIONING DOSSIER INDEX**	ROSETTI MARINO

Main reference document **123A90-PML-COM-PRO-03054 _ OTP – F&G and ESD C&E Logics** has been uploaded in the Subsystem 70-00 Commissioning Dossier Sect. 5.1

FIRE ZONE 06
B-100 (HV CONTAINER)

FZ-01= FUEL CELL AREA
FZ-02= H2 STORAGE VESSELS AREA
FZ-03= ELECTROLYZER AREA
FZ-04= B-200/B-300/B-400 CONTAINERS AREA
FZ-05= BESS AREA
FZ-06= B-100 CONTAINER AREA
FZ-07= MASTER POINT AREA
FZ-08= TRANSITION PIECE AREA

EFFECT

No.	SYS	NOTES	DESCRIPTION	TAG No.
1	AUDIO / VISUAL ALERT		OPERATOR WORKSTATION DISPLAY - EVENT/ALARM	
3	AUDIO / VISUAL ALERT		F&G ALARM ON CAP ONSHORE	
5	AUDIO / VISUAL ALERT	TO SHEET 17	GAS BEACON ACTIVATION - AMBER	
7	AUDIO / VISUAL ALERT	TO SHEET 17	FIRE BEACON ACTIVATION - RED	
9	AUDIO / VISUAL ALERT	TO SHEET 17	SOUNDER ACTIVATION	
11	AUDIO / VISUAL ALERT		WAVE-OFF LIGHT ACTIVATION TO NAVAIDS	72-XS-001
17	SIS SYSTEM	3	ESD-1D TO SIS SYTEM	70-XS-002
19	SIS SYSTEM	3	INHIBIT BATTERY CHARGING B-100 TO SIS	70-XS-008
21	SIS SYSTEM	3	H2/SMOKE INSIDE B-100 (ELECT. ISOLATION) TO SIS SYTEM	70-XS-006
23	SIS SYSTEM	3	H2/SMOKE INTAKE B-100 TO SIS SYTEM	70-XS-015
27	ELECTRIC ISOLATION	4	ELECTR. ISOLATION LIMIT SWITCHES FGS DAMPERS B-100 (77-ZSL-001/002/003)	70-XS-011
34	OTHER		CLOSE F&G DAMPER 77-HFD-001 B-100 (HV CONTAINER)	77-HY-001
35	OTHER		CLOSE F&G DAMPER 77-HFD-002 B-100 (HV CONTAINER)	77-HY-002
36	OTHER		CLOSE F&G DAMPER 77-HFD-003 B-100 (HV CONTAINER)	77-HY-003

TAG Nos	CAUSE DESCRIPTION	VOTING	INHIBITION	REMARK		1	3	5	7	9	11	17	19	21	23	27	34	35	36
950-GDZ-06204 950-GDZ-06205 950-GDZ-06206	H2 GAS LOW (ELECTROCHEM. POINT 5% LFL)	1oo3	X		1	X	F												
	H2 GAS HIGH (ELECTROCHEM. POINT 10% LFL)	1oo3	X		2	X	F												
	H2 GAS HIGH CONFIRMED (ELECTROCHEM. POINT 10% LFL)	2oo3			3	X	F	X		X	(1)		(2)	(1)		(1)	(1)	(1)	(1)
					4														
950-GDZ-06201 950-GDZ-06202 950-GDZ-06203	AIR INTAKE-H2 GAS LOW (ELECTROCHEM. POINT 5% LFL)	1oo3	X		5	X	F												
	AIR INTAKE -H2 GAS HIGH (ELECTROCHEM. POINT 10% LFL)	1oo3	X		6	X	F												
	AIR INTAKE -H2 GAS HIGH CONFIRMED (ELECT. POINT 10% LFL)	2oo3			7	X	F	X		X	X	X			X		X	X	X
					8														
					9														
950-SDZ-06204 950-SDZ-06205 950-SDZ-06206	SMOKE DETECTION SINGLE	1oo3	X		10	X	F												
	SMOKE DETECTION CONFIRMED	2oo3			11	X	F		X	X	X			X			X	X	X
					12														
					13														
950-SDZ-06201 950-SDZ-06202 950-SDZ-06203	AIR INTAKE - SMOKE DETECTION SINGLE	1oo3	X		14	X	F												
	AIR INTAKE - SMOKE DETECTION CONFIRMED	2oo3			15	X	F		X	X	X	X			X		X	X	X
					16														
79-XA-001	ASD PUSH BUTTON ACTIVATION FROM SIS SYSTEM			NOTE 3	17												X	X	X
					18														
					19														
					20														
					21														
					22														
					23														
					24														
					25														
					26														
					27														
					28														
					29														
					30														
					31														
					32														
					33														
					34														
					35														
					36														
					37														
					38														
					39														
					40														
					41														

NOTES:

1. Logic activation only in case of 2ooN H2 confirmed is caused by H2 detectors inside B-100 container and at least one of platform H2 detectors (excluded inside B-100 container) is Alarmed/Failed.

2. Logic activation only in case of 2ooN H2 confirmed is caused by H2 detectors inside B-100 container and all the others platform H2 detectors (excluded inside B-100 container) shall not be Alarmed/Failed.

3. FGS AND SIS SYSTEM EXCHANGE DATA BETWEEN THEM BY USING THE Vnet/IP NETWORK. THIS IS IMPLEMENTED AS REDUNDANT SAFETY COMMUNICATION, APPROVED FOR SIL 3 LOOP.

4. INTERNAL WIRING ISOLATION INSIDE FGS CABINETS.

LEGEND

TEST COMPLETED
GIANDONATO DEL MISSIER
15-03-2025
[signature]
PUNCH LIST HAS BEEN RAISED TO REFLECT REMOTE RESET ISSUE TO BE RESOLVED. ALL OTHER TESTING ACKNOWLEDGED BY CROSSWIND 15/04/25
[signature] MARTIN [illegible]

REFERENCE DOCUMENTS	
TITLE	NUMBER
Process Safety Cause and Effect Matrix	123A90-DDL-IN-CE-40000
Process Safety Cause and Effect Block Diagram	123A90-DDL-PR-DG-80000
F&G detectors Layout - Lower deck and Upper deck	123A90-DDL-SAF-DL-30027
F&G detectors Layout - Below Lower deck	123A90-DDL-SAF-DL-30028

Rev.	Date	Status	Description	DRN	CHKD	APPD
00	08/03/2024	IFA	Issue for Acceptance (IFA)	LCA	MGA	DLO
01	12/06/2024	AFC	Accepted for Construction (AFC)	LCA	MGA	DLO
02	08/10/2024	AFC	Accepted for Construction (AFC)	LCA	MGA	DLO
03	11/02/2025	AFC	Accepted for Construction (AFC)	LCA	MGA	DLO

CROSSWIND ROSETTI MARINO

Fire & Gas Cause & Effect Matrix: B-100 (HV CONTAINER)

HOLLANDSE KUST NOORD WIND PARK Project
Contract No. CW-I-WP4-2023-05

DATE 11/02/2025

Sheet. 5 of 17 03

FIRE ZONE 01/02/03/04/05/06
FIRE OPEN AREA

FZ-01= FUEL CELL AREA
FZ-02= H2 STORAGE VESSELS AREA
FZ-03= ELECTROLYZER AREA
FZ-04= B-200/B-300/B-400 CONTAINERS AREA
FZ-05= BESS AREA
FZ-06= B-100 CONTAINER AREA
FZ-07= MASTER POINT AREA
FZ-08= TRANSITION PIECE AREA

EFFECT

SYS	Column	NOTES	DESCRIPTION	TAG No.
AUDIO / VISUAL ALERT	1		OPERATOR WORKSTATION DISPLAY - EVENT/ALARM	
	3		F&G ALARM ON CAP ONSHORE	
	5	TO SHEET 17	GAS BEACON ACTIVATION - AMBER	
	7	TO SHEET 17	FIRE BEACON ACTIVATION - RED	
	9	TO SHEET 17	SOUNDER ACTIVATION	
	11		WAVE-OFF LIGHT ACTIVATION TO NAVAIDS	72-XS-001
SIS SYSTEM	17	1	ESD-1D TO SIS SYTEM	70-XS-002
ELECTRIC ISOLATION	27–32			
OTHER	33–53			

TAG Nos	CAUSE DESCRIPTION	VOTING	INHIBITION	REMARK		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
950-FDZ-01101 950-FDZ-01102 950-FDZ-01103 950-FDZ-01104	FZ-01 - FLAME (UV/IR)	1oo4	X		1	X		F														
	FZ-01 - FLAME CONFIRMED (UV/IR)	2oo4			2	X		F				X		X		X						X
					3																	
950-FDZ-02101 950-FDZ-02102 950-FDZ-02103 950-FDZ-02104	FZ-02 - FLAME (UV/IR)	1oo4	X		4	X		F														
	FZ-02 - FLAME CONFIRMED (UV/IR)	2oo4			5	X		F				X		X		X						X
					6																	
950-FDZ-03101 950-FDZ-03102 950-FDZ-03103 950-FDZ-03104	FZ-03 (ELECTROLYZER AREA) - FLAME (UV/IR)	1oo4	X		7	X		F														
	FZ-03 (ELECTROLYZER AREA) - FLAME CONFIRMED (UV/IR)	2oo4			8	X		F				X		X		X						X
					9																	
950-FDZ-04101 950-FDZ-04102 950-FDZ-04103 950-FDZ-04104	FZ-04 - FLAME (UV/IR)	1oo4	X		10	X		F														
	FZ-04 - FLAME CONFIRMED (UV/IR)	2oo4			11	X		F				X		X		X						X
					12																	
950-FDZ-05101 950-FDZ-05102 950-FDZ-05103 950-FDZ-05104	FZ-05 - FLAME (UV/IR)	1oo4	X		13	X		F														
	FZ-05 - FLAME CONFIRMED (UV/IR)	2oo4			14	X		F				X		X		X						X
					15																	
950-FDZ-06101 950-FDZ-06102	FZ-06 - FLAME (UV/IR)	1oo2			16	X		F														
	FZ-06 - FLAME CONFIRMED (UV/IR)	2oo2			17	X		F				X		X		X						X
					18																	
					19																	
					20																	
					21																	
					22																	
					23																	
					24																	
					25																	
					26																	
					27																	
					28																	
					29																	
					30																	
					31																	
					32																	
					33																	
					34																	
					35																	
					36																	
					37																	
					38																	
					39																	
					40																	
					41																	

NOTES:
1. FGS AND SIS SYSTEM EXCHANGE DATA BETWEEN THEM BY USING THE Vnet/IP NETWORK. THIS IS IMPLEMENTED AS REDUNDANT SAFETY COMMUNICATION, APPROVED FOR SIL 3 LOOP.

LEGEND

TEST COMPLETED
GIANDONATO R.M.
14.03-2025

GERRY MCCANN
CROSSWIND
14/3/25

REFERENCE DOCUMENTS	
TITLE	NUMBER
Process Safety Cause and Effect Matrix	123A90-DDL-IN-CE-40000
Process Safety Cause and Effect Block Diagram	123A90-DDL-PR-DG-80000
F&G detectors Layout - Lower deck and Upper deck	123A90-DDL-SAF-DL-30027
F&G detectors Layout - Below Lower deck	123A90-DDL-SAF-DL-30028

Rev.	Date	Status	Description	DRN	CHKD	APPD
00	08/03/2024	IFA	Issue for Acceptance (IFA)	LCA	MGA	DLO
01	12/06/2024	AFC	Accepted for Construction (AFC)	LCA	MGA	DLO
02	08/10/2024	AFC	Accepted for Construction (AFC)	LCA	MGA	DLO
03	11/02/2025	AFC	Accepted for Construction (AFC)	LCA	MGA	DLO

CROSSWIND — ROSETTI MARINO

Fire & Gas Cause & Effect Matrix: FIRE OPEN AREA | DATE | 11/02/2025

HOLLANDSE KUST NOORD WIND PARK Project
Contract No. CW4-WP4-2023-05 | Sheet 15 of 17 | 03

FIRE ZONE 01/02/03/04/05/06/7
MFA PUSH BUTTONS

FZ-01= FUEL CELL AREA
FZ-02= H2 STORAGE VESSELS AREA
FZ-03= ELECTROLYZER AREA
FZ-04= B-200/B-300/B-400 CONTAINERS AREA
FZ-05= BESS AREA
FZ-06= B-100 CONTAINER AREA
FZ-07= MASTER POINT AREA
FZ-08= TRANSITION PIECE AREA

EFFECT

TAG Nos	CAUSE: DESCRIPTION	VOTING	INHIBITION	REMARK	TAG No.	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53
					SYS	AUDIO / VISUAL ALERT																SIS SYSTEM										ELECTRIC ISOLATION						OTHER																				
					NOTES					TO SHEET 17		TO SHEET 17		TO SHEET 17																																												
					DESCRIPTION	OPERATOR WORKSTATION DISPLAY - EVENT/ALARM		F&G ALARM ON CAP ONSHORE		GAS BEACON ACTIVATION - AMBER		FIRE BEACON ACTIVATION - RED		SOUNDER ACTIVATION																																												
					1																																																						
950-MFA-01101	FZ-01 MFA ACTIVATION		X	1	2	X		F				X		X																																												
950-MFA-01102	FZ-01 MFA ACTIVATION		X	1	3	X		F				X		X																																												
950-MFA-01103	FZ-01 MFA ACTIVATION		X	1	4	X		F				X		X																																												
					5																																																						
950-MFA-02101	FZ-02 MFA ACTIVATION		X	1	6	X		F				X		X																																												
					7																																																							
950-MFA-03101	FZ-03 MFA ACTIVATION		X	1	8	X		F				X		X																																												
950-MFA-03102	FZ-03 MFA ACTIVATION		X	1	9	X		F				X		X																																												
950-MFA-03103	FZ-03 MFA ACTIVATION		X	1	10	X		F				X		X																																												
950-MFA-03104	FZ-03 MFA ACTIVATION		X	1	11	X		F				X		X																																												
					12																																																								
950-MFA-04101	FZ-04 MFA ACTIVATION		X	1	13	X		F				X		X																																												
950-MFA-04102	FZ-04 MFA ACTIVATION		X	1	14	X		F				X		X																																												
					15																																																							
950-MFA-04201	FZ-04 MFA ACTIVATION - B-400 INDOOR		X	1	16	X		F				X		X																																												
950-MFA-04202	FZ-04 MFA ACTIVATION - B-400 INDOOR		X	1	17	X		F				X		X																																												
950-MFA-04203	FZ-04 MFA ACTIVATION - B-400 INDOOR		X	1	18	X		F				X		X																																												
					19																																																							
950-MFA-05101	FZ-05 MFA ACTIVATION		X	1	20	X		F				X		X																																												
950-MFA-05102	FZ-05 MFA ACTIVATION		X	1	21	X		F				X		X																																												
950-MFA-05103	FZ-05 MFA ACTIVATION		X	1	22	X		F				X		X																																												
950-MFA-05104	FZ-05 MFA ACTIVATION		X	1	23	X		F				X		X																																												
					24																																																							
950-MFA-05201	FZ-05 MFA ACT. - WATER TREAT. PK INDOOR		X	1	25	X		F				X		X																																												
					26																																																							
950-MFA-06101	FZ-06 MFA ACTIVATION		X	1	27	X		F				X		X																																												
950-MFA-06102	FZ-06 MFA ACTIVATION		X	1	28	X		F				X		X																																												
					29																																																							
950-MFA-06201	FZ-06 MFA ACTIVATION - B-100 INDOOR		X	1	30	X		F				X		X																																												
					31																																																							
950-MFA-07101	FZ-07 MFA ACTIVATION		X	1	32	X		F				X		X																																												
					33																																																							
					34																																																							
					35																																																							
					36																																																							
					37																																																							
					38																																																							
					39																																																							
					40																																																							
					41																																																							

NOTES:
1. THE FLASHING ALARM ON CAP ONSHORE IS A CUMULATIVE OF ALL ASD PUSH BUTTONS ACTIVATION.

LEGEND

GERRY MCCANN
CROSSWIND
12/3/2025

TEST COMPLETED
12-03-2025
GIANDONATO R.U.

REFERENCE DOCUMENTS

TITLE	NUMBER
Process Safety Cause and Effect Matrix	123A90-DDL-IN-CE-40000
Process Safety Cause and Effect Block Diagram	123A90-DDL-PR-DG-80000
F&G detectors Layout - Lower deck and Upper deck	123A90-DDL-SAF-DL-30027
F&G detectors Layout - Below Lower deck	123A90-DDL-SAF-DL-30028

Rev.	Date	Status	Description	DRN	CHKD	APPD
00	08/03/2024	IFA	Issue for Acceptance (IFA)	LCA	MGA	DLO
01	12/06/2024	AFC	Accepted for Construction (AFC)	LCA	MGA	DLO
02	08/10/2024	AFC	Accepted for Construction (AFC)	LCA	MGA	DLO
03	11/02/2025	AFC	Accepted for Construction (AFC)	LCA	MGA	DLO

CROSSWIND — ROSETTI MARINO

Fire & Gas Cause & Effect Matrix: MFA PUSH BUTTONS

DATE 11/02/2025

HOLLANDSE KUST NOORD WIND PARK Project
Contract No. CW4-WP4-2023-05

Sheet. 16 of 17 | 03

FIRE ZONE 01/02/03/04/05/06/7
SOUNDERS AND BEACONS

FZ-01= FUEL CELL AREA
FZ-02= H2 STORAGE VESSELS AREA
FZ-03= ELECTROLYZER AREA
FZ-04= B-200/B-300/B-400 CONTAINERS AREA
FZ-05= BESS AREA
FZ-06= B-100 CONTAINER AREA
FZ-07= MASTER POINT AREA
FZ-08= TRANSITION PIECE AREA

CAUSE

TAG Nos	DESCRIPTION	VOTING	INHIBITION	REMARK	No.
	GAS CONFIRMED IN B-100 (HV CONTAINER)			From sheet 5	1
	GAS CONFIRMED B-200 IN (LV CONTAINER)			From sheet 6	2
	GAS CONFIRMED IN B-300 (UPS CONTAINER)			From sheet 7	3
	GAS CONFIRMED IN B-400 (ITER CONTAINER)			From sheet 8	4
	GAS CONFIRMED IN FUEL CELL			From sheet 9	5
	GAS CONFIRMED IN BESS			From sheet 10	6
	GAS CONFIRMED IN ELECTROLYZER			From sheet 11	7
	GAS CONFIRMED IN WATER TREAT. PKG			From sheet 12	8
	HYDROGEN OPEN AREA			From sheet 13	9
					10
	SMOKE CONFIRMED IN B-100 (HV CONTAINER)			From sheet 5	11
	SMOKE CONFIRMED B-200 IN (LV CONTAINER)			From sheet 6	12
	SMOKE CONF. IN B-300 (UPS CONTAINER)			From sheet 7	13
	SMOKE CONF. IN B-400 (ITER CONTAINER)			From sheet 8	14
	SMOKE CONFIRMED IN FUEL CELL			From sheet 9	15
	SMOKE CONFIRMED IN BESS			From sheet 10	16
	SMOKE CONFIRMED IN ELECTROLYZER			From sheet 11	17
	SMOKE CONFIRMED IN WATER TREAT. PKG			From sheet 12	18
	FIRE OPEN AREA			From sheet 15	19
					20
	O2 GAS HIGH CONFIRMED			From sheet 14	21
					22
	MFA PUSH BUTTONS ACTIVATION FZ 01/02/03/04/05/06/7			From sheet 16	23
					24
79-XA-001	ASD ACTIVATION FROM SIS SYSTEM			NOTE 1	25
79-XA-002	ESD-1D ACTIVATION FROM SIS SYSTEM			NOTE 1	26
79-XA-003	ESD-1 ACTIVATION FROM SIS SYSTEM			NOTE 1	27
					28
79-XA-004	MOB PUSH BUTTONS ACTIVATION FROM SIS SYSTEM			NOTE 1	29
					30
					31
					32
					33
					34
					35
					36
					37
					38
					39
					40
					41

EFFECT

No.	SYS	TAG No.	DESCRIPTION	NOTES
1				
2	GAS VISUAL ALERT BEACONS (AMBER)	950-XL-01101	FZ-01 GAS BEACON ACTIVATION	
3	GAS VISUAL ALERT BEACONS (AMBER)	950-XL-02101	FZ-02 GAS BEACON ACTIVATION	
4	GAS VISUAL ALERT BEACONS (AMBER)	950-XL-03101	FZ-03 GAS BEACON ACTIVATION	
5	GAS VISUAL ALERT BEACONS (AMBER)	950-XL-03103	FZ-03 GAS BEACON ACTIVATION	
6	GAS VISUAL ALERT BEACONS (AMBER)	950-XL-04101	FZ-04 GAS BEACON ACTIVATION	
7	GAS VISUAL ALERT BEACONS (AMBER)	950-XL-04103	FZ-04 GAS BEACON ACTIVATION	
8	GAS VISUAL ALERT BEACONS (AMBER)	950-XL-04201	FZ-04 GAS BEACON ACT. - B-400 INDOOR	
9	GAS VISUAL ALERT BEACONS (AMBER)	950-XL-04203	FZ-04 GAS BEACON ACT. - B-300 INDOOR	
10	GAS VISUAL ALERT BEACONS (AMBER)	950-XL-04205	FZ-04 GAS BEACON ACT. - B-200 INDOOR	
11	GAS VISUAL ALERT BEACONS (AMBER)	950-XL-05201	FZ-05 GAS BEACON ACT. - WATER T. INDOOR	
12	GAS VISUAL ALERT BEACONS (AMBER)	950-XL-06101	FZ-06 GAS BEACON ACTIVATION	
13	GAS VISUAL ALERT BEACONS (AMBER)	950-XL-06103	FZ-06 GAS BEACON ACTIVATION	
14	GAS VISUAL ALERT BEACONS (AMBER)	950-XL-06201	FZ-06 GAS BEACON ACT. - B-100 INDOOR	
15	GAS VISUAL ALERT BEACONS (AMBER)	950-XL-07101	FZ-07 GAS BEACON ACTIVATION	
16				
17				
18	FIRE VISUAL ALERT BEACONS (RED)	950-XL-01102	FZ-01 FIRE BEACON ACTIVATION	
19	FIRE VISUAL ALERT BEACONS (RED)	950-XL-02102	FZ-02 FIRE BEACON ACTIVATION	
20	FIRE VISUAL ALERT BEACONS (RED)	950-XL-03102	FZ-03 FIRE BEACON ACTIVATION	
21	FIRE VISUAL ALERT BEACONS (RED)	950-XL-03104	FZ-03 FIRE BEACON ACTIVATION	
22	FIRE VISUAL ALERT BEACONS (RED)	950-XL-04102	FZ-04 FIRE BEACON ACTIVATION	
23	FIRE VISUAL ALERT BEACONS (RED)	950-XL-04104	FZ-04 FIRE BEACON ACTIVATION	
24	FIRE VISUAL ALERT BEACONS (RED)	950-XL-04202	FZ-04 FIRE BEACON ACT. - B-400 INDOOR	
25	FIRE VISUAL ALERT BEACONS (RED)	950-XL-04204	FZ-04 FIRE BEACON ACT. - B-300 INDOOR	
26	FIRE VISUAL ALERT BEACONS (RED)	950-XL-04206	FZ-04 FIRE BEACON ACT. - B-200 INDOOR	
27	FIRE VISUAL ALERT BEACONS (RED)	950-XL-05202	FZ-05 FIRE BEACON ACT. - WATER T. INDOOR	
28	FIRE VISUAL ALERT BEACONS (RED)	950-XL-06102	FZ-06 FIRE BEACON ACTIVATION	
29	FIRE VISUAL ALERT BEACONS (RED)	950-XL-06104	FZ-06 FIRE BEACON ACTIVATION	
30	FIRE VISUAL ALERT BEACONS (RED)	950-XL-06202	FZ-06 FIRE BEACON ACT. - B-100 INDOOR	
31	FIRE VISUAL ALERT BEACONS (RED)	950-XL-07102	FZ-07 FIRE BEACON ACTIVATION	
32				
33				
34	AUDIO ALERT SOUNDERS	950-XZ-01101	FZ-01 SOUNDER ACTIVATION	
35	AUDIO ALERT SOUNDERS	950-XZ-01102	FZ-01 SOUNDER ACTIVATION	
36	AUDIO ALERT SOUNDERS	950-XZ-02101	FZ-02 SOUNDER ACTIVATION	
37	AUDIO ALERT SOUNDERS	950-XZ-03101	FZ-03 SOUNDER ACTIVATION	
38	AUDIO ALERT SOUNDERS	950-XZ-03102	FZ-03 SOUNDER ACTIVATION	
39	AUDIO ALERT SOUNDERS	950-XZ-04101	FZ-04 SOUNDER ACTIVATION	
40	AUDIO ALERT SOUNDERS	950-XZ-04102	FZ-04 SOUNDER ACTIVATION	
41	AUDIO ALERT SOUNDERS	950-XZ-04201	FZ-04 SOUNDER ACT. - B-400 INDOOR	
42	AUDIO ALERT SOUNDERS	950-XZ-04202	FZ-04 SOUNDER ACT. - B-300 INDOOR	
43	AUDIO ALERT SOUNDERS	950-XZ-04203	FZ-04 SOUNDER ACT. - B-200 INDOOR	
44	AUDIO ALERT SOUNDERS	950-XZ-05101	FZ-05 SOUNDER ACTIVATION	
45	AUDIO ALERT SOUNDERS	950-XZ-05102	FZ-05 SOUNDER ACTIVATION	
46	AUDIO ALERT SOUNDERS	950-XZ-05103	FZ-05 SOUNDER ACTIVATION	
47	AUDIO ALERT SOUNDERS	950-XZ-05104	FZ-05 SOUNDER ACTIVATION	
48	AUDIO ALERT SOUNDERS	950-XZ-05201	FZ-05 SOUNDER ACTIVATION - WTER T. INDOOR	
49	AUDIO ALERT SOUNDERS	950-XZ-06101	FZ-06 SOUNDER ACTIVATION	
50	AUDIO ALERT SOUNDERS	950-XZ-06201	FZ-06 SOUNDER ACT. - B-100 INDOOR	2
51	AUDIO ALERT SOUNDERS	950-XZ-07101	FZ-07 SOUNDER ACTIVATION	
52				
53		72-XS-001	WAVE-OFF LIGHT ACTIVATION TO NAVAIDS	

Matrix (effects 1–17)

Row	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
1		X	X	X	X	X	X	X	X	X	X	X	X	X	X		
2		X	X	X	X	X	X	X	X	X	X	X	X	X	X		
3		X	X	X	X	X	X	X	X	X	X	X	X	X	X		
4		X	X	X	X	X	X	X	X	X	X	X	X	X	X		
5		X	X	X	X	X	X	X	X	X	X	X	X	X	X		
6		X	X	X	X	X	X	X	X	X	X	X	X	X	X		
7		X	X	X	X	X	X	X	X	X	X	X	X	X	X		
8		X	X	X	X	X	X	X	X	X	X	X	X	X	X		
9		X	X	X	X	X	X	X	X	X	X	X	X	X	X		
10																	
11																	
12																	
13																	
14																	
15																	
16																	
17																	
18																	
19																	
20																	
21		X	X	X	X	X	X	X	X	X	X	X	X	X	X		
22																	
23																	
24																	
25		X	X	X	X	X	X	X	X	X	X	X	X	X	X		
26		X	X	X	X	X	X	X	X	X	X	X	X	X	X		
27		X	X	X	X	X	X	X	X	X	X	X	X	X	X		
28																	
29		X	X	X	X	X	X	X	X	X	X	X	X	X	X		
30																	
31																	
32																	
33																	
34																	
35																	
36																	
37																	
38																	
39																	
40																	
41																	

Matrix (effects 18–33)

Row	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33
1																
2																
3																
4																
5																
6																
7																
8																
9																
10																
11	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
12	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
13	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
14	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
15	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
16	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
17	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
18	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
19	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
20																
21																
22																
23	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
24																
25	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
26	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
27	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
28																
29	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
30																
31																
32																
33																
34																
35																
36																
37																
38																
39																
40																
41																

Matrix (effects 34–53)

Row	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53
1	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
2	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
3	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
4	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
5	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
6	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
7	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
8	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
9	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
10																				
11	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
12	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
13	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
14	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
15	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
16	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
17	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
18	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
19	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
20																				
21	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
22																				
23	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
24																				
25	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		X
26	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		X
27	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		X
28																				
29	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X		
30																				
31																				
32																				
33																				
34																				
35																				
36																				
37																				
38																				
39																				
40																				
41																				

NOTES:
1. FGS AND SIS SYSTEM EXCHANGE DATA BETWEEN THEM BY USING THE VnetIP NETWORK. THIS IS IMPLEMENTED AS REDUNDANT SAFETY COMMUNICATION, APPROVED FOR SIL 3 LOOP
2. It will be possible to deactivate the sounder 950-XZ-07101 (installed in Master Area) from CAP onshore.

LEGEND

TEST COMPLETED
GIANDONATO R.M.
19-03-2025

WITNESSED

PAUL WILLIAMSON
CROSSWIND
19-MAR-2025

REFERENCE DOCUMENTS	
TITLE	NUMBER
Process Safety Cause and Effect Matrix	123A90-DDL-IN-CE-40000
Process Safety Cause and Effect Block Diagram	123A90-DDL-PR-DG-80000
F&G detectors Layout - Lower deck and Upper deck	123A90-DDL-SAF-DL-30027
F&G detectors Layout - Below Lower deck	123A90-DDL-SAF-DL-30028

Rev.	Date	Status	Description	DRN	CHKD	APPD
00	08/03/2024	IFA	Issue for Acceptance (IFA)	LCA	MGA	DLO
01	12/06/2024	AFC	Accepted for Construction (AFC)	LCA	MGA	DLO
02	08/10/2024	AFC	Accepted for Construction (AFC)	LCA	MGA	DLO
03	11/02/2025	AFC	Accepted for Construction (AFC)	LCA	MGA	DLO

CROSSWIND ROSETTI MARINO

Fire & Gas Cause & Effect Matrix: SOUNDERS AND BEACONS

DATE 11/02/2025

HOLLANDSE KUST NOORD WIND PARK Project
Contract No. CW-I-WP4-2023-05

 03

Section 5.2 Operational Test Certificates

NOT APPLICABLE

Section 6 PIPING AND VESSEL PREPARATION

Section 6.1 Final Mechanical / Vessel Inspection Checks Index

NOT APPLICABLE

Section 6.2 Leak Test / Drying / Inerting Test Sheets Index

NOT APPLICABLE

Section 6.3 Chemical Loading & First Fill records Index

NOT APPLICABLE

Section 6.4 Chemical Cleaning Reports and Records Index

NOT APPLICABLE

Section 6.5 Lubrication Schedule

NOT APPLICABLE

Section 7 VENDOR

Section 7.1 Vendor Package Summary Index

NOT APPLICABLE

Section 7.2 SAT Procedure with associated punch list and reference (Front Page)

NOT APPLICABLE

Section 7.3 Vendor Spares & Special Tools lists references

ROSETTI MARINO

SPARE PARTS LIST

CROSSWIND

Document Title	**SPARE PART INDEX REGISTER (COMMISSIONING, 2-YEAR's) - FIRE AND GAS FIELD EQUIPMENT**
The document relates to	**HOLLANDSE KUST NOORD WIND PARK Project - Base Load Power Hub (BLPH)**
Contract	**CW-I-WP4-2023-05**

Project ID	Doc. n°	Rev.	Rev. Date	Status	Class
123A90	**1724000821-COM-LIS-00011**	**Issued for review**	**22-Oct-24**	**IFR**	**2**

The equipment consists of the following units/components

1 Tag no.

2 Tag description

Supplier: FORES ENGINEERING srl	PO Number: 1721002632	PO description: FIRE AND GAS FIELD EQUIPMENT	Contact name: MRS MATTEO OSSANI
Address: VIA SECONDO CASADEI 12 47122 Forli ITALY		Supplier telephone no: +39.0543.813811	Contact mobile no:
		E-mail: Fores@fores.it	WEBSITE http://www.fores.it/

General Information:

3 Manufacturer model/type no.

4 Manufacturer serial no.

5 No. of units

6 Quantity of parts FITTED / INSTALLED per unit/component

Item Number	Total number of identical spares installed	MATERIALS DATA																		Commissioning spares	2 Years spares	Remarks
		Description of recommended spare parts	Parts/drawing ref.			Material	Certicate Type (if applicable)	Certicate Reference (if applicable)	Shelf life (years)	Weight (net)	Weight (gross)	Volume	HS Code	ECCN Code	% US Content	Country of origin	Supplier part no.	Manufacturer part no.	Manufacturername	Quantity ordered	Quantity ordered	
			Project Datasheet no.	Project Detail dwg. no.	Item ref.																	
7	8	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28
1	24	SMOKE DETECTOR ZETTLER MR601TEx	1724000821-IN-DS-00004	1724000821-IN-DA-00003		FR110 "Bayblend" fire resistant												MR601TEx	ZETTLER	0	1	
2	49	GAS DETECTOR HYDROGEN Dräger Polytron® 8200 CAT DQ	1724000821-IN-DS-00004	1724000821-IN-DA-00003		AISI 316												Polytron® 8200 CAT DQ d S	Dräger	0	1	
3	9	GAS DETECTOR ULTRASONIC Dräger Polytron® 8900 UGLD	1724000821-IN-DS-00004	1724000821-IN-DA-00003		AISI 316												Polytron® 8900 UGLD d S 4-	Dräger	0	1	
4	3	GAS DETECTOR OXYGEN Dräger Polytron 8100 EC d S 4-	1724000821-IN-DS-00004	1724000821-IN-DA-00003		AISI 316												Polytron 8100 EC d S 4-	Dräger	0	1	
5	22	FLAME DETECTOR FGD FlameSpec FLS-UV-IR-AS11	1724000821-IN-DS-00004	1724000821-IN-DA-00003		AISI 316												FlameSpec FLS-UV-IR-AS11	FGD	0	1	
6	21	PUSH BUTTON MEDC SM87PBL MANUAL FIRE ALARM	1724000821-IN-DS-00004	1724000821-IN-DA-00003		AISI 316												SM87PB	MEDC	0	1	
7	20	PUSH BUTTON MEDC SM87PBL PUSH BUTTON TO SIS	1724000821-IN-DS-00004	1724000821-IN-DA-00003		AISI 316												SM87PB	MEDC	0	1	
8	13	GAS FLASH BEACON (AMBER) MEDC SM87LEDS	1724000821-IN-DS-00004	1724000821-IN-DA-00003		AISI 316												SM87LEDS	MEDC	0	1	
9	13	FIRE FLASH BEACON (RED) MEDC SM87LEDS	1724000821-IN-DS-00004	1724000821-IN-DA-00003		AISI 316												SM87LEDS	MEDC	0	1	
10	17	SOUNDER MEDC DB3B	1724000821-IN-DS-00004	1724000821-IN-DA-00003		AISI 316												DB3B	MEDC	0	1	
11	32	PUSH BUTTON DPDT CONTACT EATON GHG 432	1724000821-IN-DS-00004	1724000821-IN-DA-00003		Polyamide												GHG 432	EATON	0	0	
12																						
13																						
14																						
15																						
16																						
17																						
18																						
19																						
20																						
21																						
22																						
23																						
24																						
25																						
26																						
27																						
28																						
29																						
30																						
31																						
32																						
33																						
34																						
35																						
36																						
37																						
38																						
39																						
40																						
41																						
42																						
43																						
44																						
45																						

Section 7.4 Vendor Data / Operations / Maintenance Manuals References

NOT APPLICABLE

Section 8 LIST OF MODIFICATIONS

NOT APPLICABLE

Section 8.1 List of changes

NOT APPLICABLE

Section 9 SUPPORTING DOCUMENTS

NOT APPLICABLE