

DRAWING NO. 123A90-DDL-ST-DD-90034

REV. 01


APPLICABLE FOR PLATE GIRDERS CONNECTION AND BEAMS WITH HEIGHT > 400

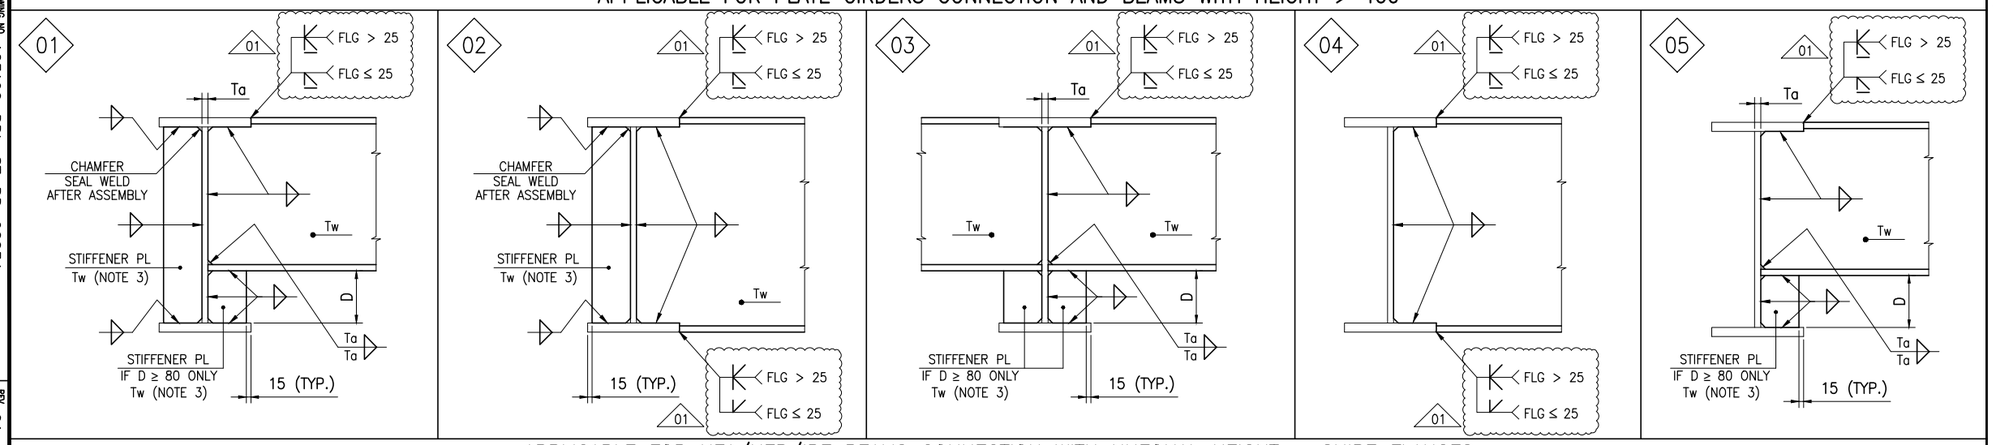



APPLICABLE FOR HEA/HEB/IPE BEAMS CONNECTION WITH UNEQUAL HEIGHT – SNIPE FLANGES

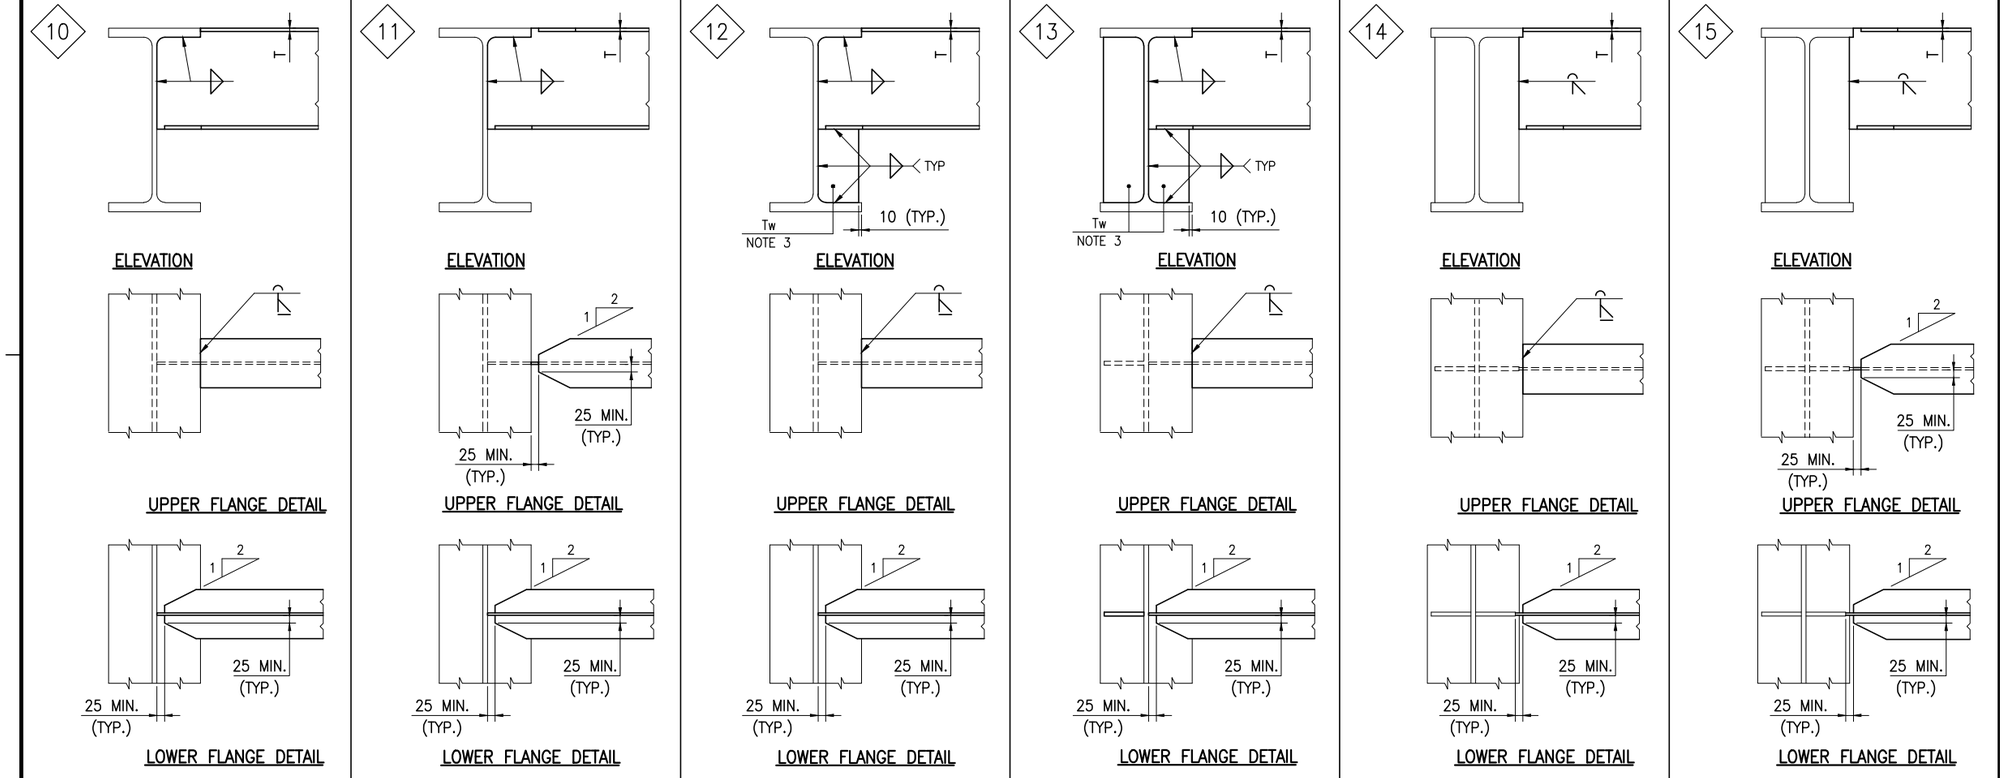


APPLICABLE FOR HEA/HEB/IPE/UPN BEAMS CONNECTION WITH UNEQUAL HEIGHT ≤ 400

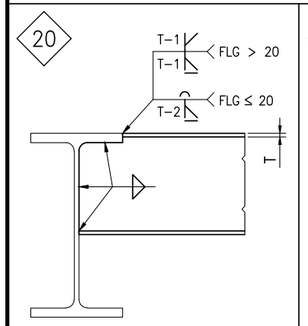

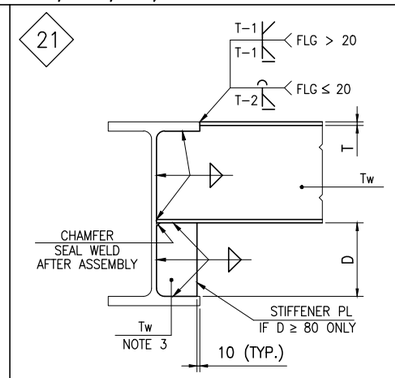

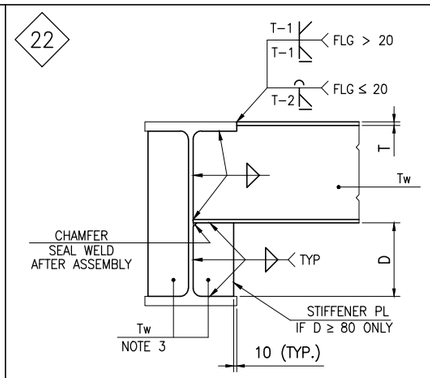

APPLICABLE FOR HEA/HEB/IPE/UPN BEAMS CONNECTION – EQUAL HEIGHT

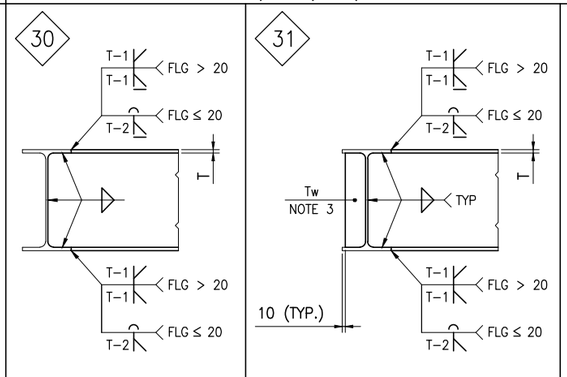

NOTES:

1 – ALL DIMENSIONS ARE IN mm (U.N.O.)
2 – TYPICAL FRAMING DETAILS AS SHOWN MAY BE INVERTED.
3 – WEB INSERT (Tw) MATERIAL AND THICKNESS TO MATCH WEB OF INCOMING MEMBER.
THICKNESS SHALL BE TO THE NEAREST (HIGHER) STANDARD PLATE SIZE AND NOT LESS THAN 6 mm U.N.O.
4 – ALL FILLET WELDS SHALL BE CONTINUOUS AND THE LEG SIZE SHALL BE EQUAL 0.7 THE MINIMUM THICKNESS TO BE JOINTED U.N.O.

TECON

REV.	DATE	DRN	CHKD	APPD	DESCRIPTION
01	31/01/24	SGR	AB	DLS	ACCEPTED FOR CONSTRUCTION (AFC)
00	13/10/23	SGR	AB	DLS	ISSUE FOR REVIEW (IFR)

CROSSWIND

ROSETTI MARINO

TITLE :
BASE LOAD POWER HUB (BLPH)
STANDARD DRAWINGS
TYPICAL BEAM CONNECTIONS

CONTRACT NO./TITLE CW-I-WP4-2023-05/HOLLANDSE KUST NOORD WIND PARK			SCALE 1:10
DRAWN S.GRIFFINI	CHECKED A.BALZAROTTI	APPROVED D.LO STERZO	DATE 31/01/24
A1	DRAWING NO. 123A90-DDL-ST-DD-90034	SHEET 001	REV. 01

File Name : 123A90-DDL-ST-DD-90034_01.dwg